


PRINTINGS
 DEC. 20, 2018
 DEC. 28, 2018
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 7, 2019
 FEB. 9, 2019
 MAY 27, 2019

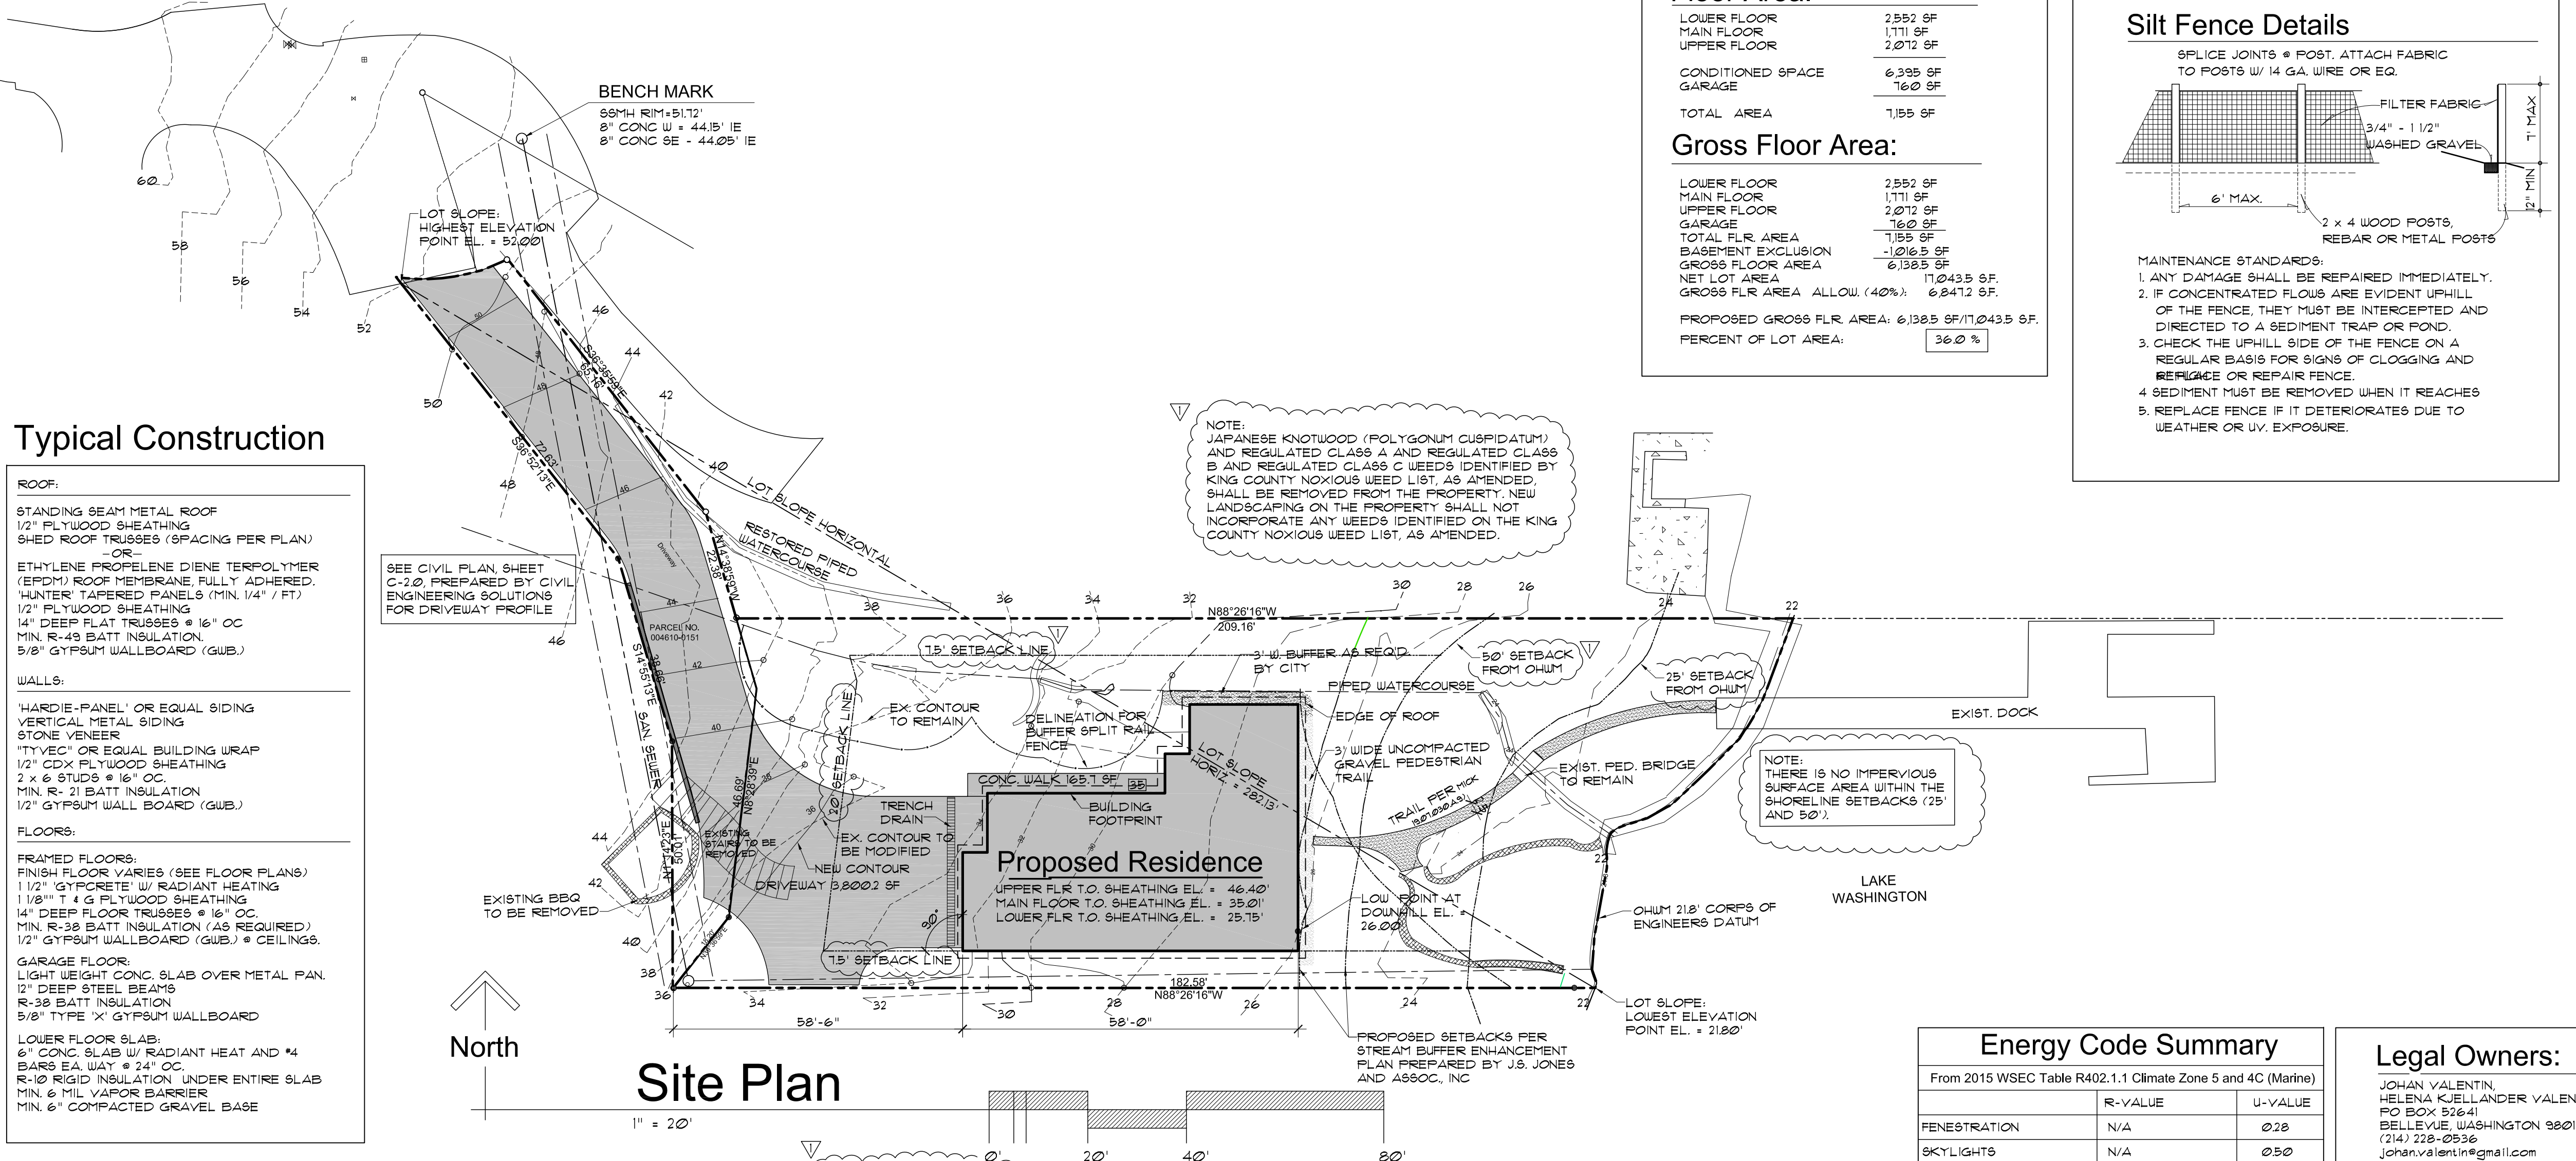


Typical Construction

- ROOF:**
 STANDING BEAM METAL ROOF
 1/2" PLYWOOD SHEATHING
 SHED ROOF TRUSSES (SPACING PER PLAN)
 -OR-
 ETHYLENE PROPYLENE DIENE TERPOLYMER (EPDM) ROOF MEMBRANE FULLY ADHERED.
 HUNTER TAPERED PANELS (MIN 1/4" / FT)
 1/2" PLYWOOD SHEATHING
 14" DEEP FLAT TRUSSES @ 16" OC
 MIN. R-49 BATT INSULATION
 5/8" GYPSUM WALLBOARD (GWB.)
- WALLS:**
 "HARDIE-PANEL" OR EQUAL SIDING
 VERTICAL METAL SIDING
 STONE VENEER
 "TYVEC" OR EQUAL BUILDING WRAP
 1/2" CDX PLYWOOD SHEATHING
 2 x 6 STUDS @ 16" OC
 MIN. R-21 BATT INSULATION
 1/2" GYPSUM WALL BOARD (GWB.)
- FLOORS:**
 FRAMED FLOORS.
 FINISH FLOOR VARIES (SEE FLOOR PLANS)
 1 1/2" GYPCRETE W/ RADIANT HEATING
 1 1/8" T & G PLYWOOD SHEATHING
 14" DEEP FLOOR TRUSSES @ 16" OC
 MIN. R-38 BATT INSULATION (AS REQUIRED)
 1/2" GYPSUM WALLBOARD (GWB.) @ CEILINGS.
- GARAGE FLOOR:**
 LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
 12" DEEP STEEL BEAMS
 R-38 BATT INSULATION
 5/8" TYPE 'X' GYPSUM WALLBOARD
- LOWER FLOOR SLAB:**
 6" CONC. SLAB W/ RADIANT HEAT AND #4 BARS EA. WAY @ 24" OC
 R-10 RIGID INSULATION UNDER ENTIRE SLAB
 MIN. 6" MIL VAPOR BARRIER
 MIN. 6" COMPACTED GRAVEL BASE
- SEE TREE REPORT PREPARED BY THOMAS BOYCE, ISA CERTIFIED ARBORIST (ATTACHED) FOR TREE INVENTORY, LOCATION AND PROPOSED REMOVAL**
- SEE BUFFER REDUCTION MITIGATION PLAN PREPARED BY J.S. JONES AND ASSOCIATES, INC. ENVIRONMENTAL CONSULTANTS**
- SITE INFORMATION FROM TOPOGRAPHY / BOUNDARY SURVEY BY SITE SURVEYING. SEE SHEET A-12.**
- FIRE CODE ALTERNATE REQUIRED. PROVIDE FIRE RETARDANT COATING TREATMENT IN ATTIC AND CRAWL SPACE.**
- INSTALL AN IRC APPENDIX 13R FIRE SPRINKLER SYSTEM.**
- INSTALL A MONITORED NFPA 12 LOW VOLTAGE FIRE ALARM**

Site Plan

1" = 20'

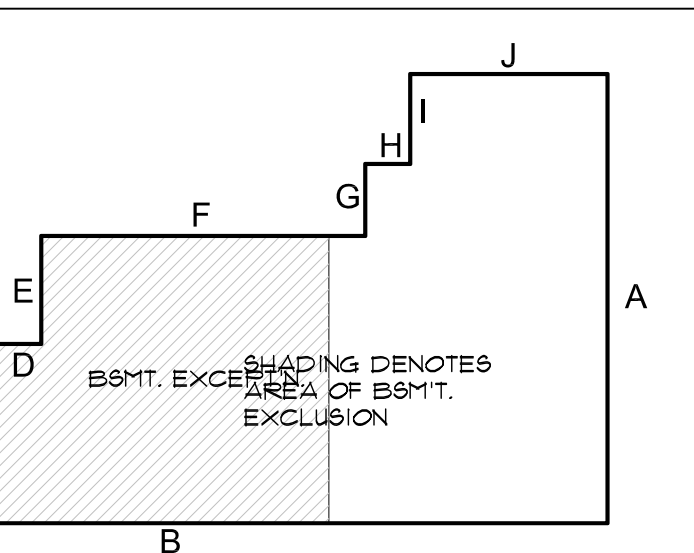


Building Footprint
 NOT TO SCALE

Basement Exclusion Calculation

WALL SEGMENT	WALL LENGTH	PERCENT COVERAGE	PRODUCT
A	50.00'	0.00%	0.00'
B	68.00'	31.8%	21.62'
C	20.00'	81.5%	17.50'
D	5.00'	94.3%	4.72'
E	12.00'	94.4%	11.33'
F	36.00'	65.6%	23.62'
G	8.00'	40.2%	3.22'
H	5.00'	41.0%	2.05'
I	10.00'	40.4%	4.04'
J	22.00'	26.7%	5.87'
TOTAL	236.00'	39.8%	93.96'

93.96' / 236.00' = 39.8%
 BASEMENT AREA = 2552 SF
 BASEMENT EXCLUSION = 2552 SF x 39.8% = 1016.00 SF

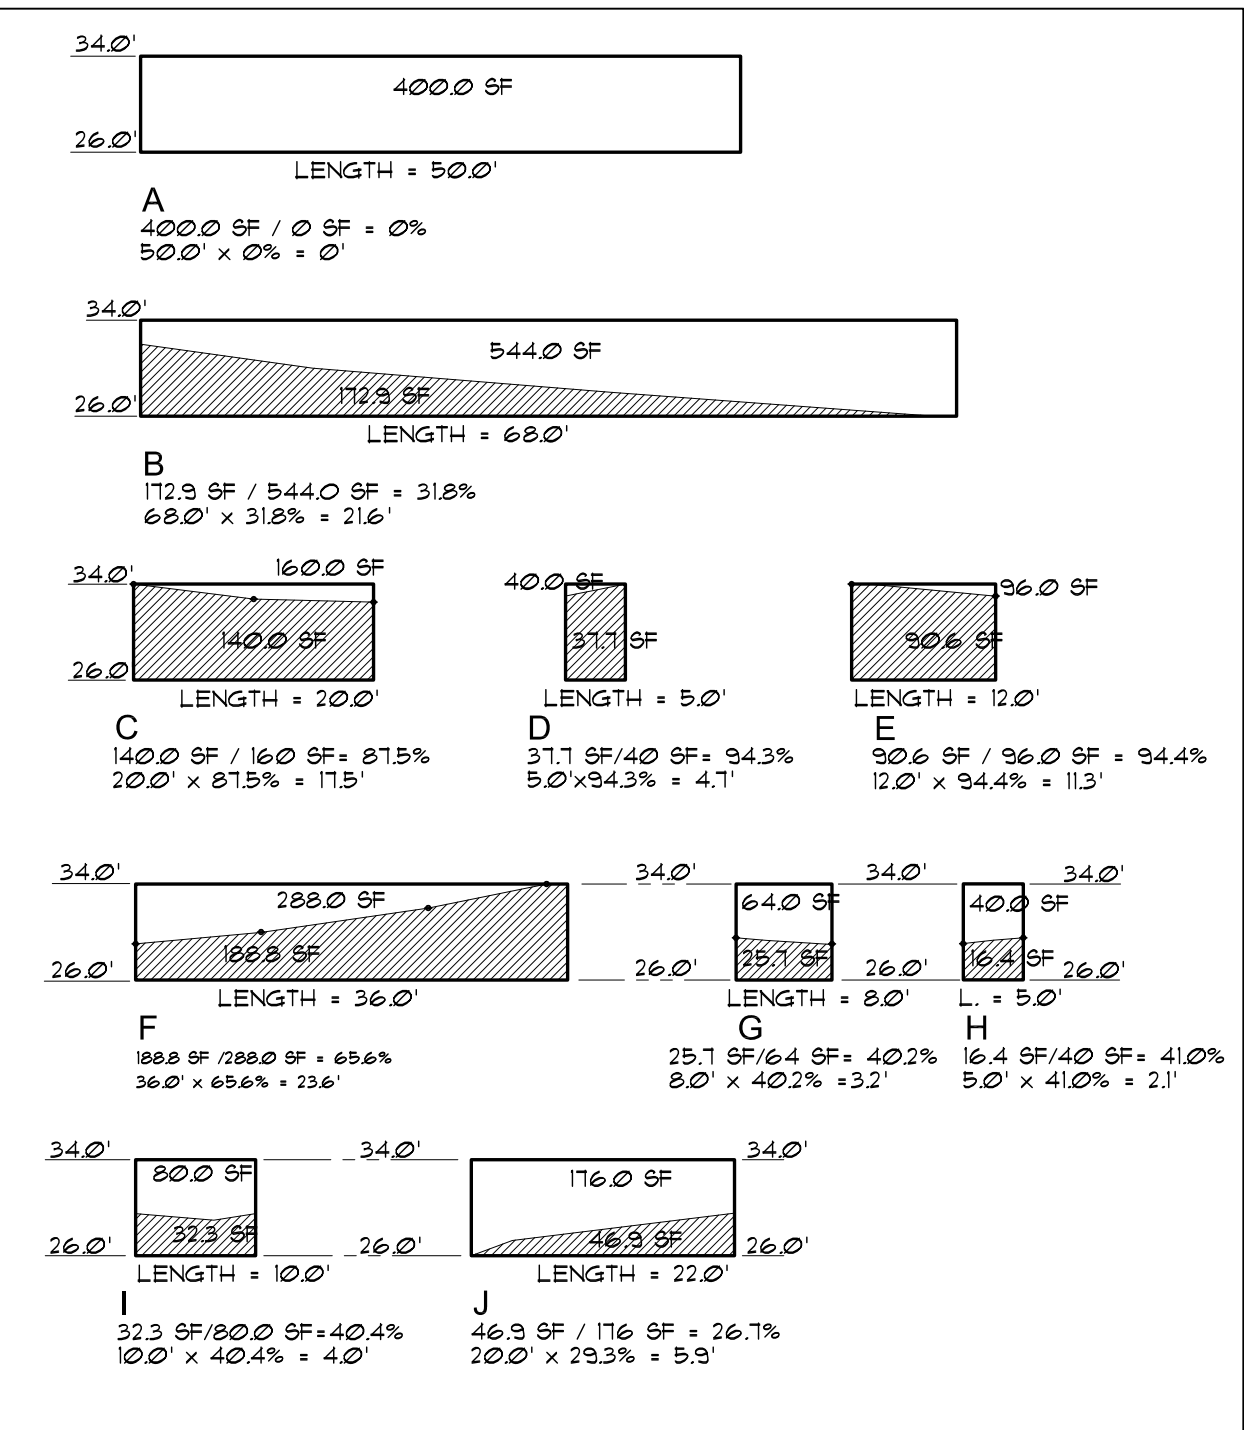

Wall Diagrams
 1/8" = 1'-0"

Topo / Survey Accuracy

HIGHEST ELEVATION POINT 52.00'
 LOWEST ELEVATION POINT 21.80'
 ELEVATION DIFFERENCE 30.20'
 HORIZ. DIST. BETWEEN PTS. 282.13'

LOT SLOPE = 30.20' / 282.13' = 10.70%

Lot Slope

HIGHEST ELEVATION POINT 52.00'
 LOWEST ELEVATION POINT 21.80'
 ELEVATION DIFFERENCE 30.20'
 HORIZ. DIST. BETWEEN PTS. 282.13'

LOT SLOPE = 30.20' / 282.13' = 10.70%

Lot Coverage

HOUSE (ROOF) 2991 SF
 DRIVEWAY 3800 SF
 TOTAL 6691 SF
 LOT AREA 11043.5 SF
 ALLOWABLE (40%) 6817 SF
 ACTUAL (6691 / 11043.5) 39.3%

Hardscape:

CONCRETE WALKWAY 165.1 SF
 HARDSCAPE = 165.1 / 11043.5 = 1%
 ALLOWABLE HARDSCAPE 9%
 11043.5 x 0.09 = 1533.9 SF

Downhill Ht. Limit:

LOW POINT EL. 26.00'
 ALLOWABLE 30' HEIGHT EL. 56.00'
 TOP OF WALL EL. 55.53'

HEIGHT LIMIT SHOWN ON BUILDING SECTIONS AND EXTERIOR ELEVATIONS, SHEETS A-9 THRU A-12.

Height Limit Calculations

WALL SEGMENT	MID-PT. ELEVATION	SEGMENT LENGTH	MID-PT. x LENGTH
1	26.25'	50.00'	1312.50 SF
2	28.00'	68.00'	1904.00 SF
3	32.75'	20.00'	655.00 SF
4	33.50'	5.00'	167.50 SF
5	33.75'	12.00'	405.00 SF
6	31.25'	36.00'	1125.00 SF
7	29.25'	8.00'	234.00 SF
8	29.25'	5.00'	146.25 SF
9	29.00'	10.00'	290.00 SF
10	28.00'	22.00'	616.00 SF
TOTAL		236.00'	6872.25 SF

AVERAGE BUILDING EL. = 6872.25 SF / 236.00' = 29.12'
 ALLOWABLE HEIGHT = 29.12' + 30' = 59.12'
 ACTUAL RIDGE HEIGHT = 59.12'


Floor Area:

LOWER FLOOR	2,552 SF
MAIN FLOOR	1,771 SF
UPPER FLOOR	2,072 SF
TOTAL	6,395 SF

Gross Floor Area:

LOWER FLOOR	2,552 SF
MAIN FLOOR	1,771 SF
UPPER FLOOR	2,072 SF
GARAGE	160 SF
TOTAL FLR. AREA	7,155 SF
BASEMENT EXCLUSION	-1,016.5 SF
GROSS FLOOR AREA	6,138.5 SF
NET LOT AREA	11,043.5 SF
GROSS FLR AREA ALLOW. (40%)	6,817.4 SF
PERCENT OF LOT AREA:	36.0 %

Silt Fence Details

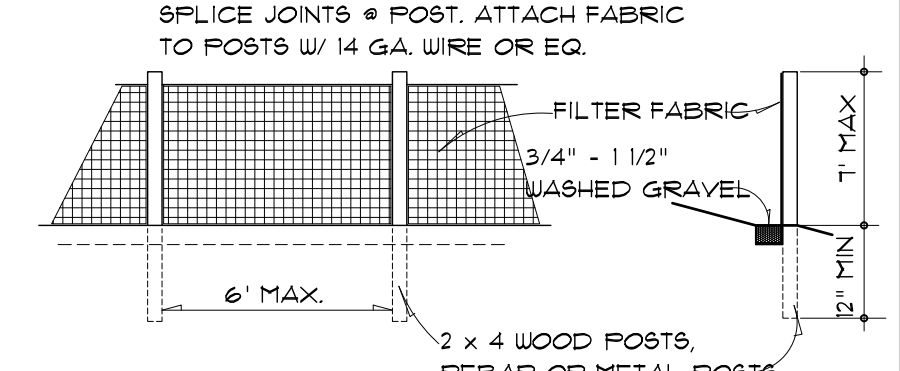

- MAINTENANCE STANDARDS:**
1. ANY DAMAGE SHALL BE REPAIRED IMMEDIATELY.
 2. IF CONCENTRATED FLOWS ARE EVIDENT UPHILL OF THE FENCE, THEY MUST BE INTERCEPTED AND DIRECTED TO A SEDIMENT TRAP OR POND.
 3. CHECK THE UPHILL SIDE OF THE FENCE ON A REGULAR BASIS FOR SIGNS OF CLOGGING AND BREAKAGE OR REPAIR FENCE.
 4. SEDIMENT MUST BE REMOVED WHEN IT REACHES THE SEDIMENT TRAP OR POND.
 5. REPLACE FENCE IF IT DETERIORATES DUE TO WEATHER OR UV. EXPOSURE.

Legal Description:

PARCEL NO. 004610-0150 + 004610-0151

THAT PORTION OF TRACTS 2 AND 3 OF ADAMS LAKE WASHINGTON TRACTS, AS PER PLAT RECORDED IN VOLUME 11 OF PLATS, PAGE 80, RECORDS OF KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHWEST CORNER OF SAID TRACT 2; THENCE ALONG THE NORTH LINE OF SAID TRACT 2 SOUTH 88°26'16" EAST 1240 FEET, MORE OR LESS, TO AN IRON PIPE MONUMENT ON THE EASTERLY MARGIN OF EAST MERCER WAY, SAID IRON PIPE BEING ON THE CENTERLINE PRODUCED BY A 30 FOOT ROAD EASEMENT RECORDED FEBRUARY 19, 1953 UNDER RECORDING NUMBER 4316894; THENCE SOUTH 80°23'50" EAST ALONG SAID CENTERLINE, 560.83 FEET TO AN IRON PIPE MONUMENT WHICH IS THE CENTER POINT OF A CIRCULAR TURNAROUND SAID TURNAROUND BEING THE EASTERLY TERMINUS OF SAID 30 FOOT ROAD EASEMENT; THENCE SOUTH 24°30'23" EAST 380.00 FEET TO THE TRUE POINT OF BEGINNING OF THE TRACT HEREIN DESCRIBED; THENCE SOUTH 36°52'13" EAST 65.25 FEET; THENCE SOUTH 14°55'13" EAST 22.38 FEET TO A POINT IN A LINE WHICH IS PARALLEL WITH AND 185 FEET SOUTH OF THE NORTH LINE OF SAID TRACT 2; THENCE SOUTH 88°26'16" EAST SAID PARALLEL LINE, TO THE SHORE OF LAKE WASHINGTON; THENCE SOUTHERLY, ALONG SAID SHORE, TO A POINT DRAIN PARALLEL WITH AND 20 FEET SOUTH OF THE EASTERLY EXTENSION OF THE NORTH LINE OF TRACT 3 IN ADAMS LAKE WASHINGTON TRACTS; THENCE, ALONG SAID PARALLEL LINE, NORTH 88°26'16" WEST TO A POINT ON THE SOUTHEASTERLY BOUNDARY OF A TRACT OF LAND DESCRIBED IN CONTRACT SALE TO MILTON L. WITTENDALE RECORDED UNDER RECORDING NUMBER 3936791; THENCE NORTH 01°14'23" EAST 50.00 FEET; THENCE NORTH 14°55'13" WEST 38.66 FEET; THENCE NORTH 36°52'13" WEST 12.14 FEET TO A POINT IN THE MARGIN OF THE TURNAROUND IN SAID ROAD EASEMENT FROM WHICH THE CENTER BEARS NORTH 10°53'34" EAST 380.00 FEET; THENCE ON A CURVE TO THE LEFT WITH A RADIUS OF 380.00 FEET A DISTANCE OF 23.48 FEET TO THE TRUE POINT OF BEGINNING;

TOGETHER WITH SECOND CLASS SHORELANDS, AS CONVEYED BY THE STATE OF WASHINGTON, ADJACENT TO AND ABUTTING UPON THE PARCEL OF LAND HEREIN ABOVE DESCRIBED AND LYING BETWEEN THE NORTH AND SOUTH BOUNDARIES THEREOF EXTENDED EASTERLY.

PARCEL C:

NON-EXCLUSIVE EASEMENTS FOR INGRESS AND EGRESS, AS CREATED BY INSTRUMENTS RECORDED FEBRUARY 19, 1953, UNDER RECORDING NUMBER 4316894, RECORDED SEPTEMBER 24, 1953, UNDER RECORDING NUMBER 4381750, AND RECORDED MARCH 20, 1956, UNDER RECORDING NUMBER 4614371.

SITUATE IN THE CITY OF SEATTLE, COUNTY OF KING, STATE OF WASHINGTON.

Energy Code Summary

From 2015 WSEC Table R402.1.1 Climate Zone 5 and 4C (Marine)

	R-VALUE	U-VALUE
PENETRATION	N/A	0.28
SKYLIGHTS	N/A	0.50
CEILINGS (TRUSSES)	R-49	0.026
CEILINGS PER R402.2.1	R-38 (ADV)	0.026
WOOD FRAMED WALLS	R-21 (INT)	0.056
FLOORS	R-30	0.029
BELOW GRADE WALLS	R-10 C.I. INTERIOR R-21 INT & TB.	0.042

SLAB ON GRADE R-10 UNDER ENTIRE SLAB

R406 Additional Energy Efficiency Requirements

Credits Required

LARGE DWELLING UNIT (+ 5,000 SQ. FT.) 43

Credits Provided

1a EFFICIENT BUILDING ENVELOPE (0.5 CREDITS)

PRESCRIPTIVE COMPLIANCE IS BASED ON TABLE R402.1 WITH THE FOLLOWING MODIFICATIONS:

VERTICAL PENETRATION U=0.28
 FLOOR R-38
 SLAB ON GRADE R-10 PERIMETER AND UNDER ENTIRE SLAB
 BELOW GRADE SLAB R-10 PERIMETER AND UNDER ENTIRE SLAB OR COMPLIANCE BASE ON SECTION R402.1.4 REDUCE THE TOTAL BY 15%.

2a AIR LEAKAGE CONTROL & EFFICIENT VENTILATION (0.5 CR)

COMPLIANCE BASED ON R402.1.2. REDUCE THE TESTED AIR LEAKAGE TO 30 AIR CHANGES PER HOUR MAXIMUM AND:
 ALL WHOLE HOUSE VENTILATION REQUIREMENTS AS DETERMINED BY SECTION M903.1 OF THE INTERNATIONAL RESIDENTIAL CODE SHALL BE MET WITH A HIGH EFFICIENCY FAN (MAXIMUM 0.35 WATTS / CFM), NOT INTERLOCKED WITH THE FURNACE FAN.

3a HIGH EFFICIENCY HVAC EQUIPMENT (1.0 CREDITS)

GAS, PROPANE OR OIL FIRED BOILER WITH MINIMUM AFUE OF 93%. PROJECTS THAT ONLY INCLUDE CREDIT FROM ONE SPACE HEATING OPTION, 34, 36, 3c OR 3d, WHEN A HOUSING UNIT HAS TWO PIECES OF EQUIPMENT (IE, TWO FURNACES) BOTH MUST MEET THE STANDARD TO RECEIVE THE CREDIT.

4 HIGH EFFICIENCY HVAC DISTRIBUTION SYSTEM (1.0 CR)

ALL HEATING AND COOLING SYSTEM COMPONENTS INSTALLED INSIDE THE CONDITIONED SPACE. THIS INCLUDES ALL EQUIPMENT AND DISTRIBUTION SYSTEM COMPONENTS SUCH AS FORGED AIR DUCTS, HYDRONIC PIPING, HYDRONIC FLOOR HEATING LOOP, CONVECTORS AND RADIATORS. ALL COMBUSTION EQUIPMENT SHALL BE DIRECT VENT OR SEALED COMBUSTION.

5c EFFICIENT WATER HEATING (1.5 CREDITS)

WATER HEATING SYSTEM SHALL INCLUDE ONE OF THE FOLLOWING: GAS, PROPANE OR OIL WATER HEATER WITH A MINIMUM EF OF 0.9;
 OR
 SOLAR WATER HEATING SUPPLEMENTING A MINIMUM STANDARD WATER HEATER. SOLAR WATER HEATING WILL PROVIDE A RATED MINIMUM SAVINGS OF 85 THERMS OR 2000 KWH BASED ON SOLAR RATING AND CERTIFICATION CORPORATION (SRCC) ANNUAL PERFORMANCE OF 0.3-300 CERTIFIED SOLAR WATER HEATING SYSTEMS OR
 ELECTRIC HEAT PUMP WATER HEATER WITH A MINIMUM EF OF 2.0 AND MEETING THE STANDARDS OF NECA'S NORTHERN CLIMATE SPECIFICATIONS FOR HEAT PUMP WATER HEATERS.

Legal Owners:

JOHAN VALENTIN,
 HELENA KJELLANDER VALENTIN
 P.O. BOX 5428
 BELLEVUE, WASHINGTON 98015
 (214) 228-0536
 johanvalentin@gmail.com

Contractor:

ASPEN HOMES NW
 MIKE YEGANEH, PRINCIPAL
 P.O. BOX 1056
 MERCER ISLAND, WASHINGTON 98040
 (206) 199-3016
 mike@aspenhomesnw.com

Architect:

THE HURI ASSOCIATES
 ED. L. HURI, PRINCIPAL
 6908 - 168th St. SW., Lynnwood, WA 98037
 EDMONDS, WASHINGTON 98026
 (425) 286-3985
 e-huri@msn.com

Structural Engineer:

FORSMAN ENGINEERING
 ARNOLD FORSMAN, PE
 30014 - 2nd COURT SE
 FEDERAL WAY, WASHINGTON 98003
 (253) 815-9182
 forsmanengineering@comcast.net

GeoTech. Engineer:

THOR CHRISTENSEN, PE
 GEOTECH CONSULTANTS, INC.
 2401 10TH AVE E
 SEATTLE, WASHINGTON 98102
 (425) 741-5618

Civil Engineer:

DUFFY ELLIS, PE
 CIVIL ENGINEERING SOLUTIONS
 102 N. CANAL ST.
 SEATTLE, WASHINGTON 98101
 (206) 530-0342
 duffy@csolutionsus.com

Surveyor:

SITE SURVEYING, INC.
 2193 NE 11TH ST
 SASTAMISH, WA 98074
 425-299-4411
 duffy@csolutionsus.com

Arborist:

THOMAS BOYCE
 12271 HUCKLEBERRY LANE
 ARLINGTON, WA 98023
 Tooyge15@msn.com

Environmental Consultants:

J.S. JONES AND ASSOCIATES
 P.O. BOX 1908
 ISSAQUAH, WA 98027

Electrician

ENERGY
 ELIJAH CLARK
 32821 NE 142ND ST
 DUVALL, WA 98015
 425-681-1099
 Eli@elclark.com

Project Address:

4350 E. MERCER WAY
 MERCER ISLAND, WA 98040

Parcel No.

004610-0150

Permit No.

1902-013

Zoning

R-15


Index:

- A1 SITE PLAN, SITE INFO, GENERAL PROJECT INFORMATION
- A1.2 BOUNDARY AND TOPOGRAPHIC SURVEY
- A1.3 TREE PLAN
- A1.4 STREAM BUFFER ENHANCEMENT PLAN
- A2 FOUNDATION PLAN
- A2.1 FOUNDATION PILING PLAN
- A3 LOWER FLOOR PLAN, DOOR AND WINDOW SCHEDULES
- A4 MAIN FLOOR FRAMING PLAN
- A5 MAIN FLOOR PLAN
- A6 UPPER FLOOR FRAMING PLAN
- A7 UPPER FLOOR PLAN
- A8 ROOF FRAMING PLAN
- A8.1 ROOF DRAINAGE PLAN
- A9 BUILDING SEC. A-A AND B-B
- A10 BUILDING SEC. C-C AND D-D
- A11 BUILDING SEC. E-E AND F-F
- A12 NORTH AND WEST ELEVATIONS
- A13 SOUTH AND EAST ELEVATIONS
- A14 EAST EXTERIOR ELEVATION
- SD-1 STRUCTURAL NOTES
- SD-2 STRUCTURAL DETAILS
- SD-3 STRUCTURAL DETAILS
- SSW1 SIMPSON STRONG WALL DETAILS
- SSW2 SIMPSON STRONG WALL DETAILS
- C-1.0 EROSION CONTROL PLAN
- C-1.2 TESC AND CITY NOTES / TESC DETAILS
- C-2.0 DRAINAGE / CIVIL PLAN
- C-3.5 DRAINAGE DETAILS / STORM PROFILE

REVISED
 MAY 27, 2019, ADDED 25 AND 50 FOOT SETBACK FROM CHIMNEY, ADDED NOXIOUS WEED LIST, ADDED NOTES FROM TREE INSPECTION


The Valentin Residence
 Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

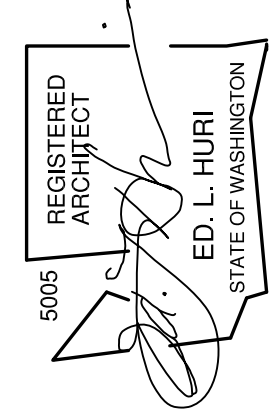


val 11-01
 E.L.H.
 FEB. 11, 2019

A-1

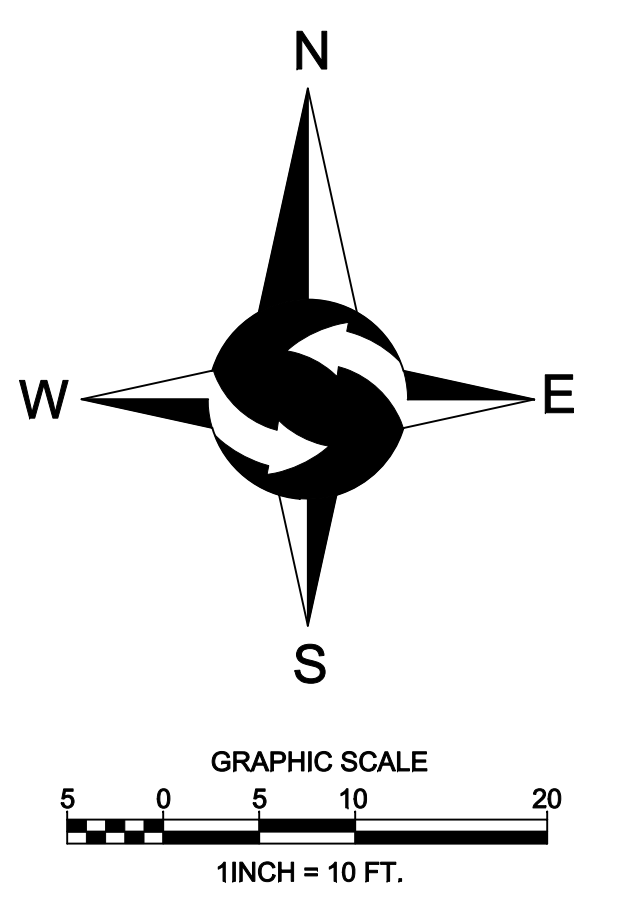


SE 1/4, NE 1/4, SEC 18, TWP 24N, RNG 5E, W.M.

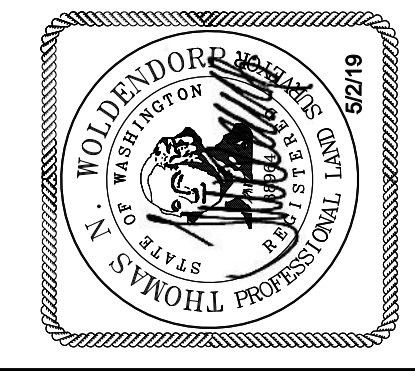

TOPOGRAPHIC SURVEY
 JOHN VALENTIN
 4350 E MERCER WAY
 MERCER ISLAND, WA 98040

DATE	REVISION	DRN

PROJECT NO. 18-023
 DRAWN BY: EFJ
 CHECKED BY: TNW
 DATE: 2/13/19
 SHEET 1 OF 2

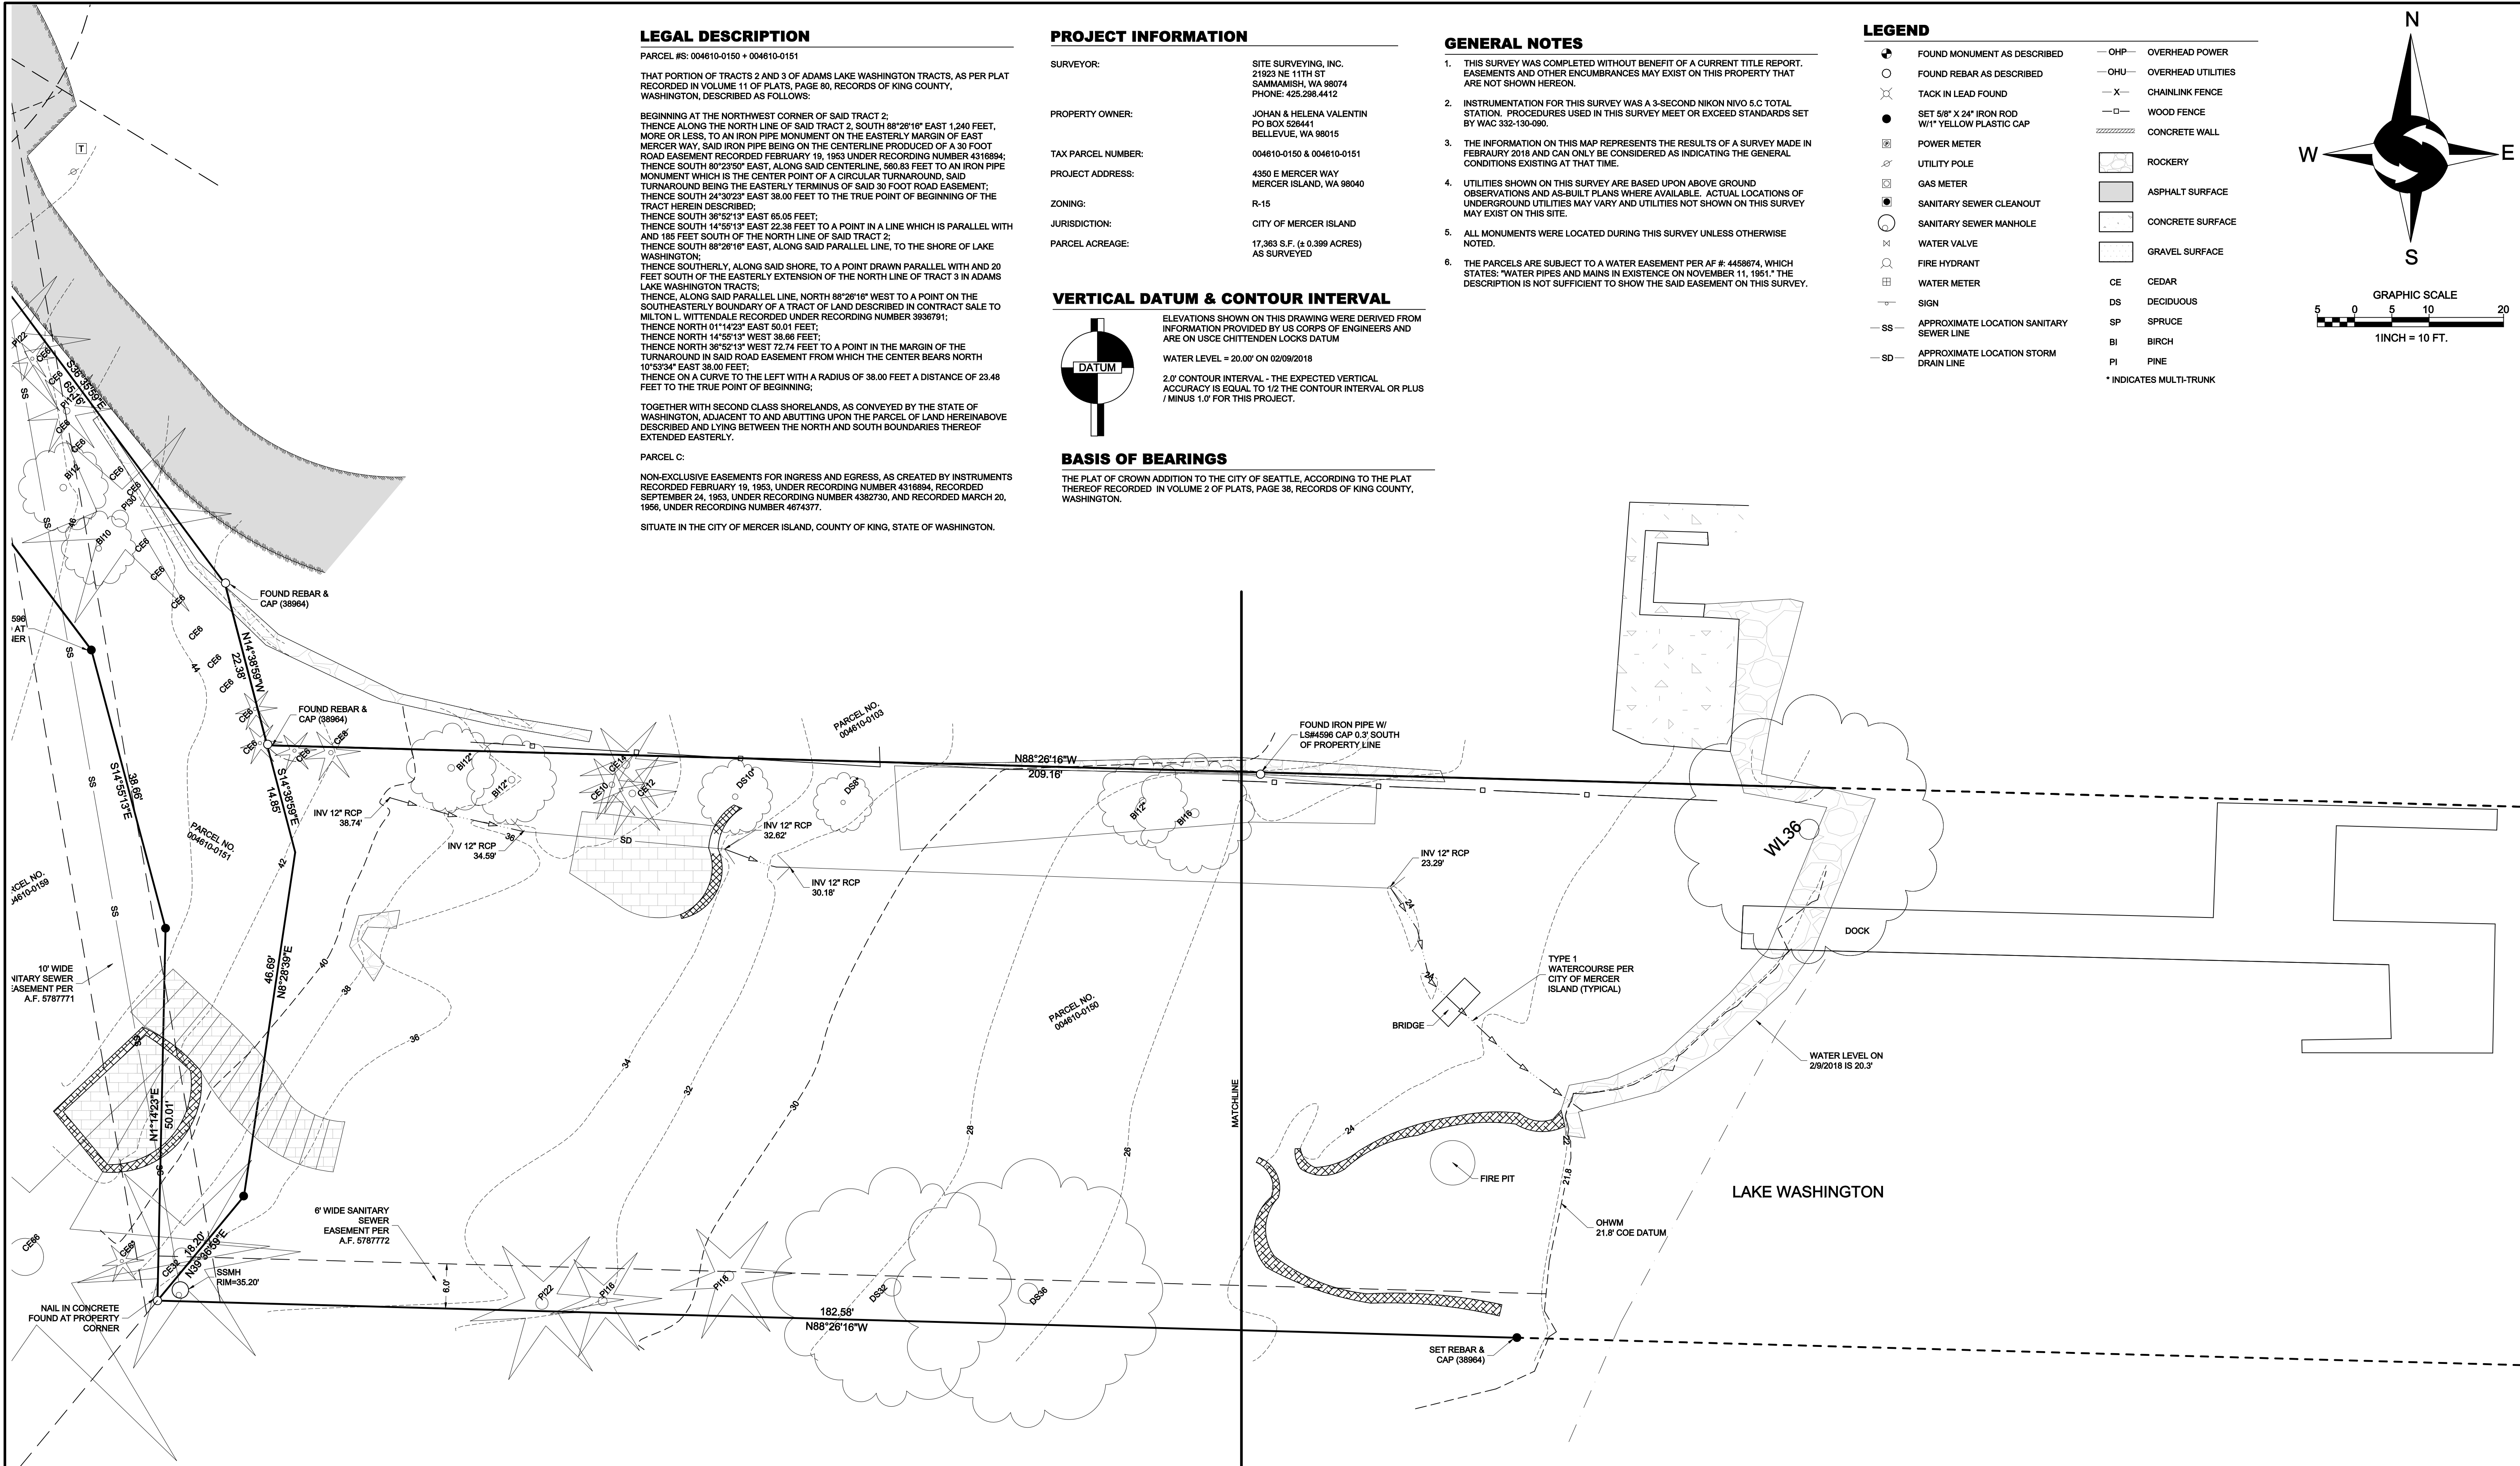

LEGAL DESCRIPTION

PARCEL #S: 004610-0150 + 004610-0151
 THAT PORTION OF TRACTS 2 AND 3 OF ADAMS LAKE WASHINGTON TRACTS, AS PER PLAT RECORDED IN VOLUME 11 OF PLATS, PAGE 80, RECORDS OF KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHWEST CORNER OF SAID TRACT 2; THENCE ALONG THE NORTH LINE OF SAID TRACT 2, SOUTH 88°26'16" EAST 1,240 FEET, MORE OR LESS, TO AN IRON PIPE MONUMENT ON THE EASTERLY MARGIN OF EAST MERCER WAY, SAID IRON PIPE BEING ON THE CENTERLINE PRODUCED OF A 30 FOOT ROAD EASEMENT RECORDED FEBRUARY 19, 1953 UNDER RECORDING NUMBER 4316894; THENCE SOUTH 80°23'50" EAST, ALONG SAID CENTERLINE, 560.83 FEET TO AN IRON PIPE MONUMENT WHICH IS THE CENTER POINT OF A CIRCULAR TURNAROUND, SAID TURNAROUND BEING THE EASTERLY TERMINUS OF SAID 30 FOOT ROAD EASEMENT; THENCE SOUTH 24°30'23" EAST 38.00 FEET TO THE TRUE POINT OF BEGINNING OF THE TRACT HEREIN DESCRIBED;

THENCE SOUTH 38°52'13" EAST 65.05 FEET; THENCE SOUTH 14°55'13" EAST 22.38 FEET TO A POINT IN A LINE WHICH IS PARALLEL WITH AND 185 FEET SOUTH OF THE NORTH LINE OF SAID TRACT 2; THENCE SOUTH 88°26'16" EAST, ALONG SAID PARALLEL LINE, TO THE SHORE OF LAKE WASHINGTON;

THENCE SOUTHERLY, ALONG SAID SHORE, TO A POINT DRAWN PARALLEL WITH AND 20 FEET SOUTH OF THE EASTERLY EXTENSION OF THE NORTH LINE OF TRACT 3 IN ADAMS LAKE WASHINGTON TRACTS;

THENCE, ALONG SAID PARALLEL LINE, NORTH 88°26'16" WEST TO A POINT ON THE SOUTHEASTERLY BOUNDARY OF A TRACT OF LAND DESCRIBED IN CONTRACT SALE TO MILTON L. WITTENDALE RECORDED UNDER RECORDING NUMBER 3936791; THENCE NORTH 01°14'23" EAST 50.01 FEET;

THENCE NORTH 14°55'13" WEST 38.66 FEET; THENCE NORTH 38°52'13" WEST 72.74 FEET TO A POINT IN THE MARGIN OF THE TURNAROUND IN SAID ROAD EASEMENT FROM WHICH THE CENTER BEARS NORTH 10°53'34" EAST 38.00 FEET;

THENCE ON A CURVE TO THE LEFT WITH A RADIUS OF 38.00 FEET A DISTANCE OF 23.48 FEET TO THE TRUE POINT OF BEGINNING;

TOGETHER WITH SECOND CLASS SHORELANDS, AS CONVEYED BY THE STATE OF WASHINGTON, ADJACENT TO AND ABUTTING UPON THE PARCEL OF LAND HEREINABOVE DESCRIBED AND LYING BETWEEN THE NORTH AND SOUTH BOUNDARIES THEREOF EXTENDED EASTERLY.

PARCEL C:
 NON-EXCLUSIVE EASEMENTS FOR INGRESS AND EGRESS, AS CREATED BY INSTRUMENTS RECORDED FEBRUARY 19, 1953, UNDER RECORDING NUMBER 4316894, RECORDED SEPTEMBER 24, 1953, UNDER RECORDING NUMBER 4382730, AND RECORDED MARCH 20, 1959, UNDER RECORDING NUMBER 4674377.

SITUATE IN THE CITY OF MERCER ISLAND, COUNTY OF KING, STATE OF WASHINGTON.

PROJECT INFORMATION

SURVEYOR: SITE SURVEYING, INC.
 21923 NE 11TH ST
 SAMMAMISH, WA 98074
 PHONE: 425.298.4412
 PROPERTY OWNER: JOHAN & HELENA VALENTIN
 PO BOX 526441
 BELLEVUE, WA 98015
 TAX PARCEL NUMBER: 004610-0150 & 004610-0151
 PROJECT ADDRESS: 4350 E MERCER WAY
 MERCER ISLAND, WA 98040
 ZONING: R-15
 JURISDICTION: CITY OF MERCER ISLAND
 PARCEL ACREAGE: 17,363 S.F. (± 0.399 ACRES)
 AS SURVEYED

VERTICAL DATUM & CONTOUR INTERVAL

ELEVATIONS SHOWN ON THIS DRAWING WERE DERIVED FROM INFORMATION PROVIDED BY US CORPS OF ENGINEERS AND ARE ON USCE CHITTENDEN LOCKS DATUM
 WATER LEVEL = 20.00' ON 02/09/2018
 2.0' CONTOUR INTERVAL - THE EXPECTED VERTICAL ACCURACY IS EQUAL TO 1/2 THE CONTOUR INTERVAL OR PLUS / MINUS 1.0' FOR THIS PROJECT.

BASIS OF BEARINGS



THE PLAT OF CROWN ADDITION TO THE CITY OF SEATTLE, ACCORDING TO THE PLAT THEREOF RECORDED IN VOLUME 2 OF PLATS, PAGE 38, RECORDS OF KING COUNTY, WASHINGTON.

GENERAL NOTES

- THIS SURVEY WAS COMPLETED WITHOUT BENEFIT OF A CURRENT TITLE REPORT. EASEMENTS AND OTHER ENCUMBRANCES MAY EXIST ON THIS PROPERTY THAT ARE NOT SHOWN HEREON.
- INSTRUMENTATION FOR THIS SURVEY WAS A 3-SECOND NIKON NIVO 5.C TOTAL STATION. PROCEDURES USED IN THIS SURVEY MEET OR EXCEED STANDARDS SET BY WAC 332-130-090.
- THE INFORMATION ON THIS MAP REPRESENTS THE RESULTS OF A SURVEY MADE IN FEBRUARY 2018 AND CAN ONLY BE CONSIDERED AS INDICATING THE GENERAL CONDITIONS EXISTING AT THAT TIME.
- UTILITIES SHOWN ON THIS SURVEY ARE BASED UPON ABOVE GROUND OBSERVATIONS AND AS-BUILT PLANS WHERE AVAILABLE. ACTUAL LOCATIONS OF UNDERGROUND UTILITIES MAY VARY AND UTILITIES NOT SHOWN ON THIS SURVEY MAY EXIST ON THIS SITE.
- ALL MONUMENTS WERE LOCATED DURING THIS SURVEY UNLESS OTHERWISE NOTED.
- THE PARCELS ARE SUBJECT TO A WATER EASEMENT PER AF # 4458874, WHICH STATES: "WATER PIPES AND MAINS IN EXISTENCE ON NOVEMBER 11, 1951." THE DESCRIPTION IS NOT SUFFICIENT TO SHOW THE SAID EASEMENT ON THIS SURVEY.

LEGEND

- FOUND MONUMENT AS DESCRIBED
- FOUND REBAR AS DESCRIBED
- TACK IN LEAD FOUND
- SET 5/8" X 24" IRON ROD W/1" YELLOW PLASTIC CAP
- POWER METER
- UTILITY POLE
- GAS METER
- SANITARY SEWER CLEANOUT
- SANITARY SEWER MANHOLE
- WATER VALVE
- FIRE HYDRANT
- WATER METER
- SIGN
- APPROXIMATE LOCATION SANITARY SEWER LINE
- APPROXIMATE LOCATION STORM DRAIN LINE
- OHP - OVERHEAD POWER
- OHU - OVERHEAD UTILITIES
- CHAINLINK FENCE
- WOOD FENCE
- CONCRETE WALL
- ROCKERY
- ASPHALT SURFACE
- CONCRETE SURFACE
- GRAVEL SURFACE
- CE - CEDAR
- DS - DECIDUOUS
- SP - SPRUCE
- BI - BIRCH
- PI - PINE
- * INDICATES MULTI-TRUNK

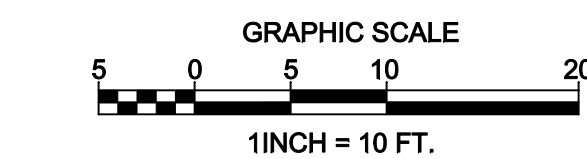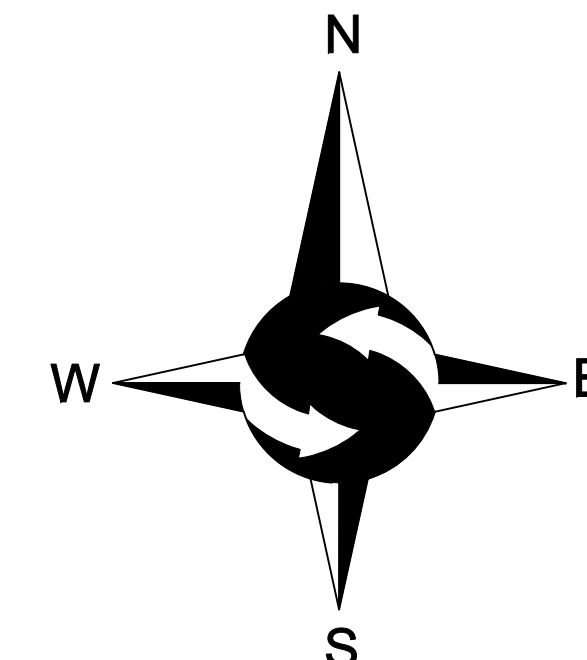


SE 1/4, NE 1/4, SEC 18, TWP 24N, RNG 5E, W.M.

PROJECT NO.	18-023
DRAWN BY:	EFJ
CHECKED BY:	TNW
DATE:	2/13/19
SHEET	2 OF 2

TOPOGRAPHIC SURVEY
 JOHN VALENTIN
 4350 E MERCER WAY
 MERCER ISLAND, WA 98040

© 2017, SITE SURVEYING, INC., ALL RIGHTS RESERVED


DATE	REVISION	DRN

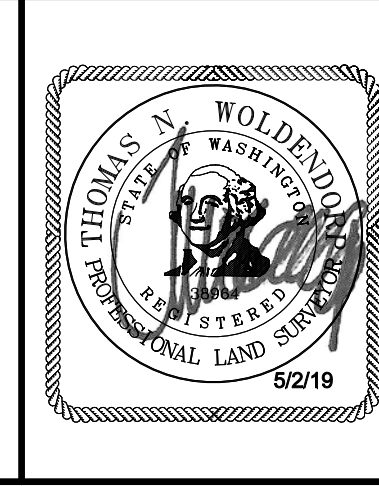

Site Surveying, Inc.


www.sitesurveymapping.com 21923 NE 11th Street Sammamish, WA 98074 Phone: 425.298.4412

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

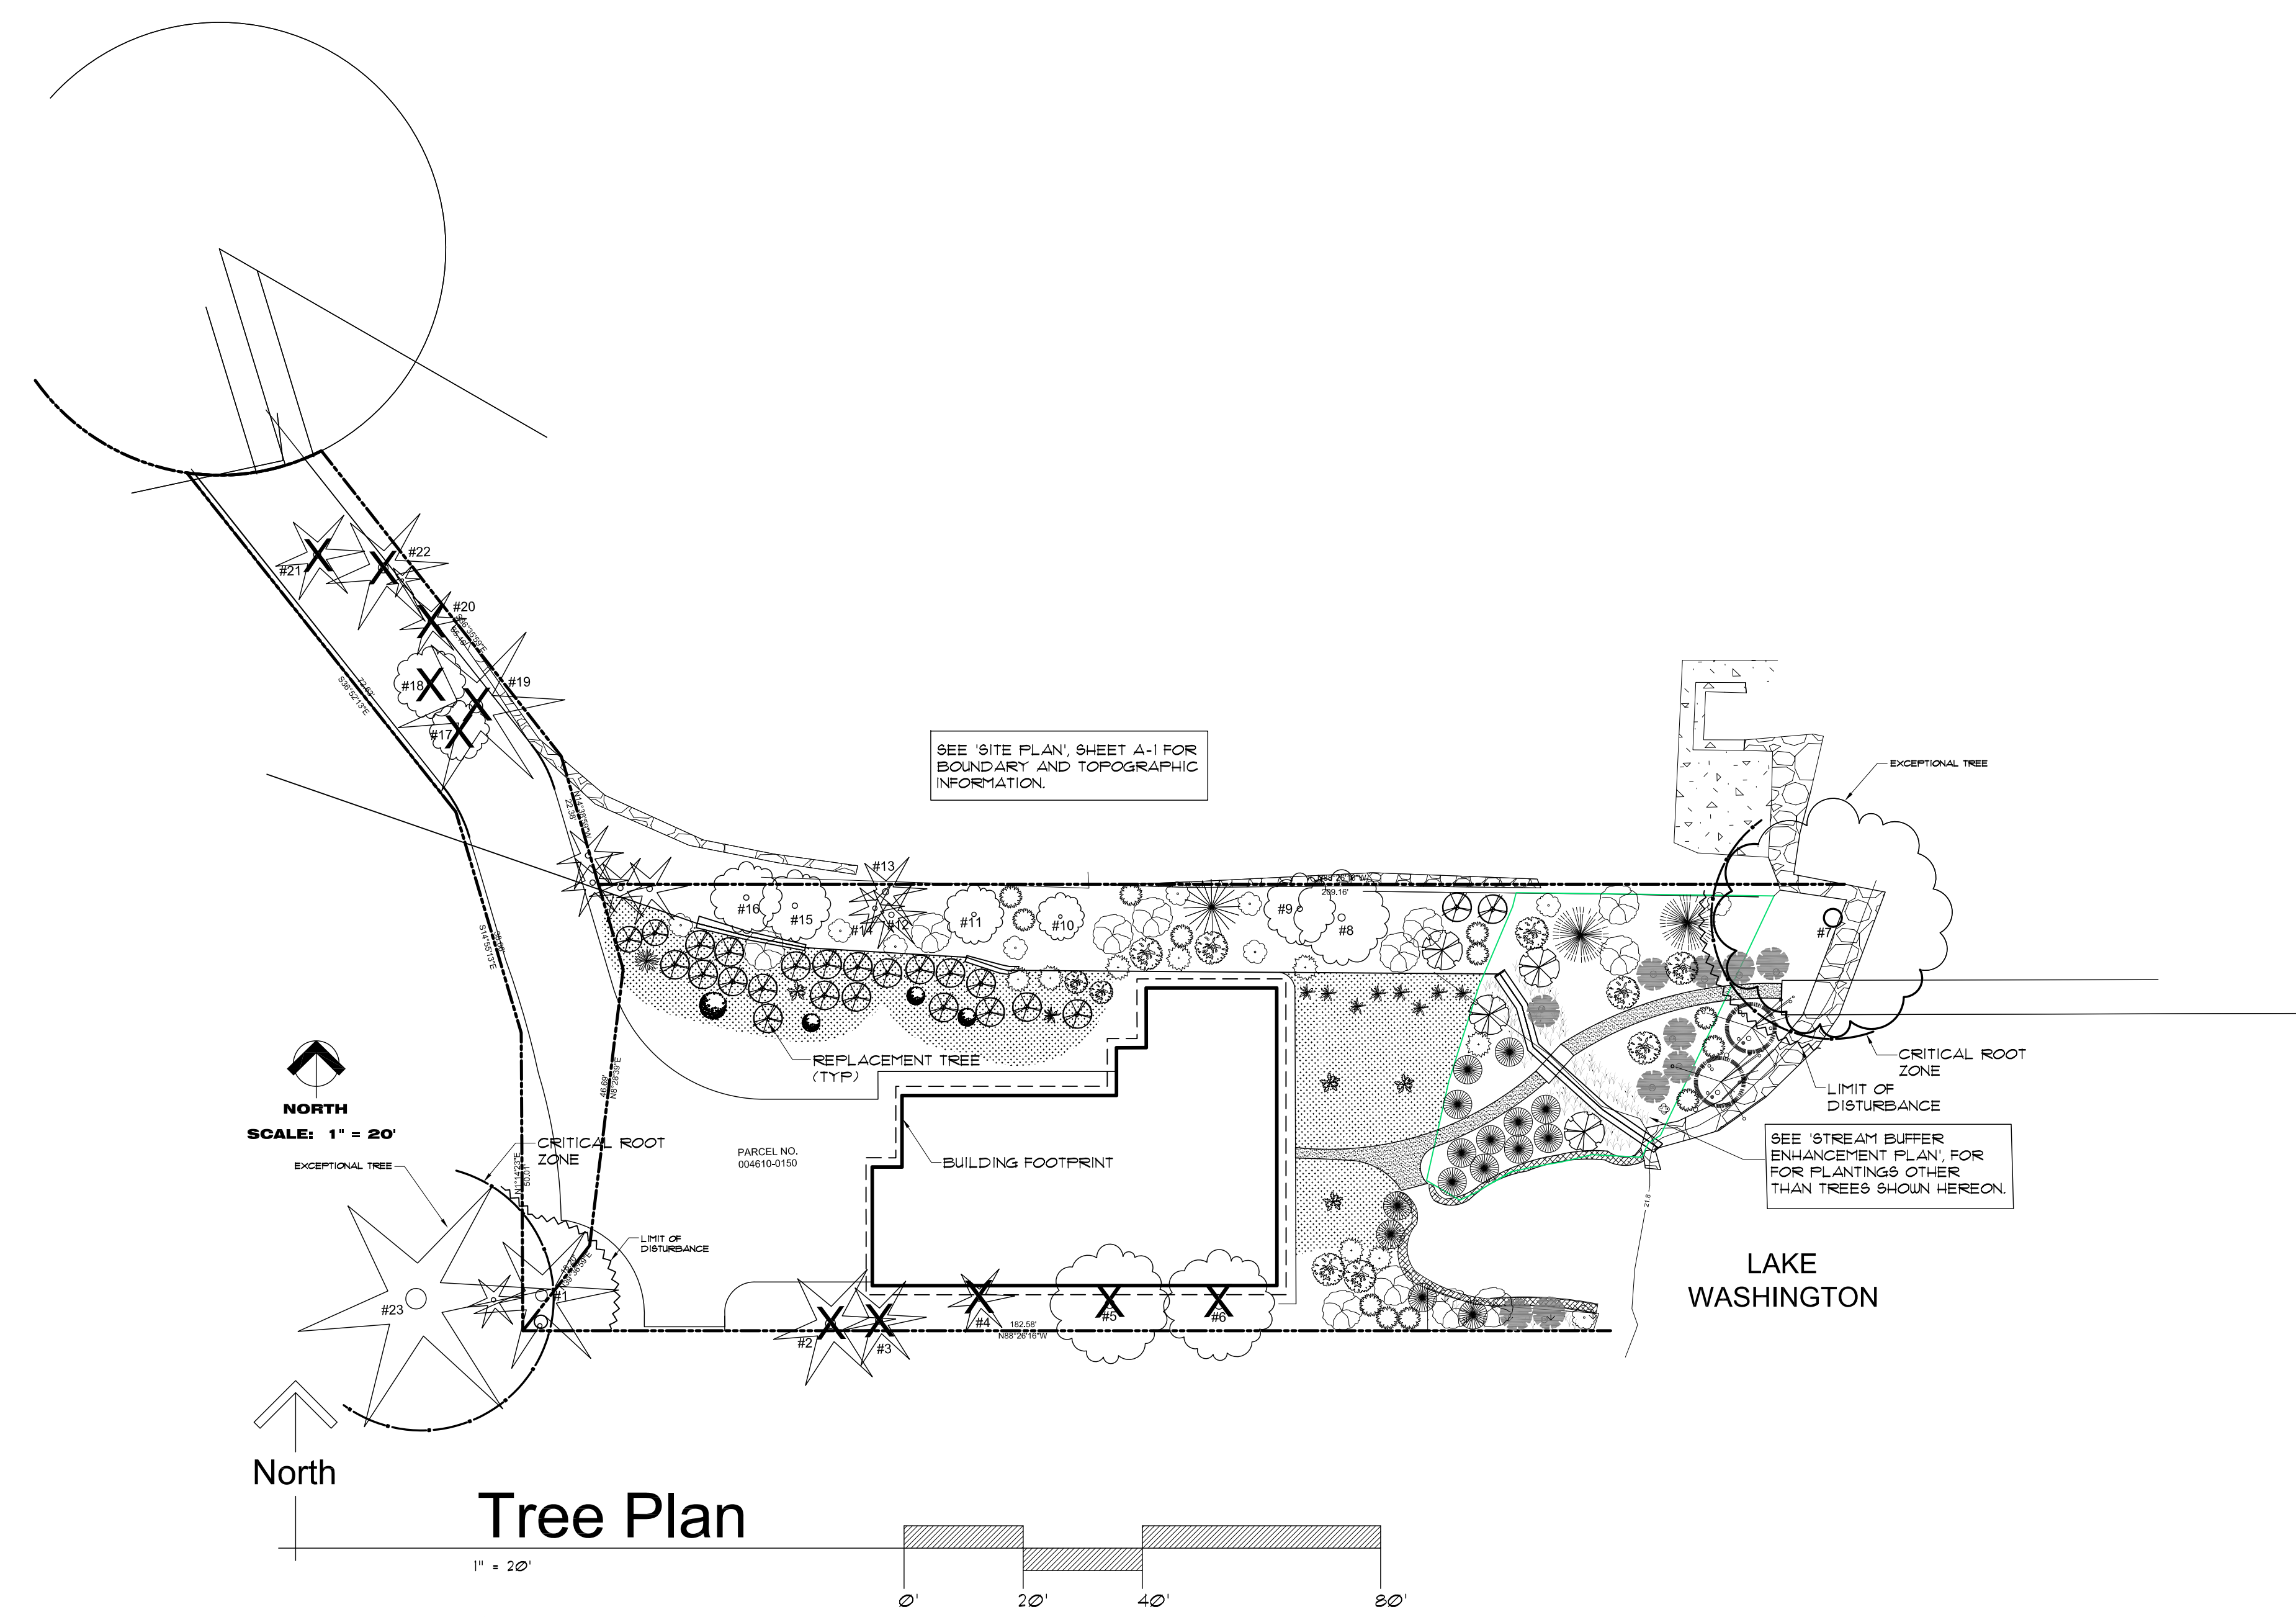

Tree Inventory

No.	Species	Common Name	DBH	RDL Radial Dipline	Comments	Retain / Remove
1	THUJA PLICATA	WESTERN RED CEDAR	28 IN.	12 FT	NORMAL VIGOR	RETAIN
2	PINUS SP.	PINE	22 IN.	6 FT	POOR VIGOR	REMOVE
3	PINUS SP.	PINE	16 IN.	6 FT	POOR VIGOR	REMOVE
4	PINUS SP.	PINE	18 IN.	6 FT	POOR VIGOR	REMOVE
5	POPULUS TRICHOCARPA	LOMBARDY POPLAR	32 IN.	10 FT	POOR VIGOR	REMOVE
6	POPULUS TRICHOCARPA	LOMBARDY POPLAR	35 IN.	9 FT	POOR VIGOR	REMOVE
7	SALIX BABYLONICA	WEeping WILLOW	36 IN.	20 FT	POOR VIGOR	RETAIN
8	BETULA PapyRIFERA	PAPERBARK BIRCH	16 IN.	12 FT	FAIR VIGOR	RETAIN
9	BETULA PapyRIFERA	PAPERBARK BIRCH	12 IN.	12 FT	NORMAL VIGOR	RETAIN
10	FRANUS BLIREANA	FLOWERING PLUM	8 IN.	15 FT	SENEsCENT	RETAIN
11	FRANUS BLIREANA	FLOWERING PLUM	12 IN.	15 FT	SENEsCENT	RETAIN
12	THUJA PLICATA	WESTERN RED CEDAR	12 IN.	10 FT	NORMAL VIGOR	RETAIN
13	THUJA PLICATA	WESTERN RED CEDAR	14 IN.	15 FT	NORMAL VIGOR	RETAIN
14	THUJA PLICATA	WESTERN RED CEDAR	10 IN.	10 FT	NORMAL VIGOR	RETAIN
15	BETULA PapyRIFERA	PAPERBARK BIRCH	12 IN.	15 FT	NORMAL VIGOR	RETAIN
16	BETULA PapyRIFERA	PAPERBARK BIRCH	12 IN.	15 FT	NORMAL VIGOR	RETAIN
17	BETULA PapyRIFERA	PAPERBARK BIRCH	10 IN.	10 FT	NORMAL VIGOR	REMOVE
18	BETULA PapyRIFERA	PAPERBARK BIRCH	12 IN.	10 FT	NORMAL VIGOR	REMOVE
19	PINUS SP.	PINE	18 IN.	15 FT	FAIR VIGOR	REMOVE
20	PINUS SP.	PINE	12 IN.	10 FT	FAIR VIGOR	REMOVE
21	CALOCEDRUS DECURRENS	INCENSE CEDAR	16 IN.	10 FT	GOOD VIGOR	REMOVE
22	PINUS SP.	PINE	22 IN.	15 FT	NORMAL VIGOR	REMOVE
23	SEQUOIA SEMPREVIRENS	COAST REDWOOD	66 IN.	20 FT	ON NEIGHBOR PROPERTY HDL ON SUBJECT PROPERTY	RETAIN

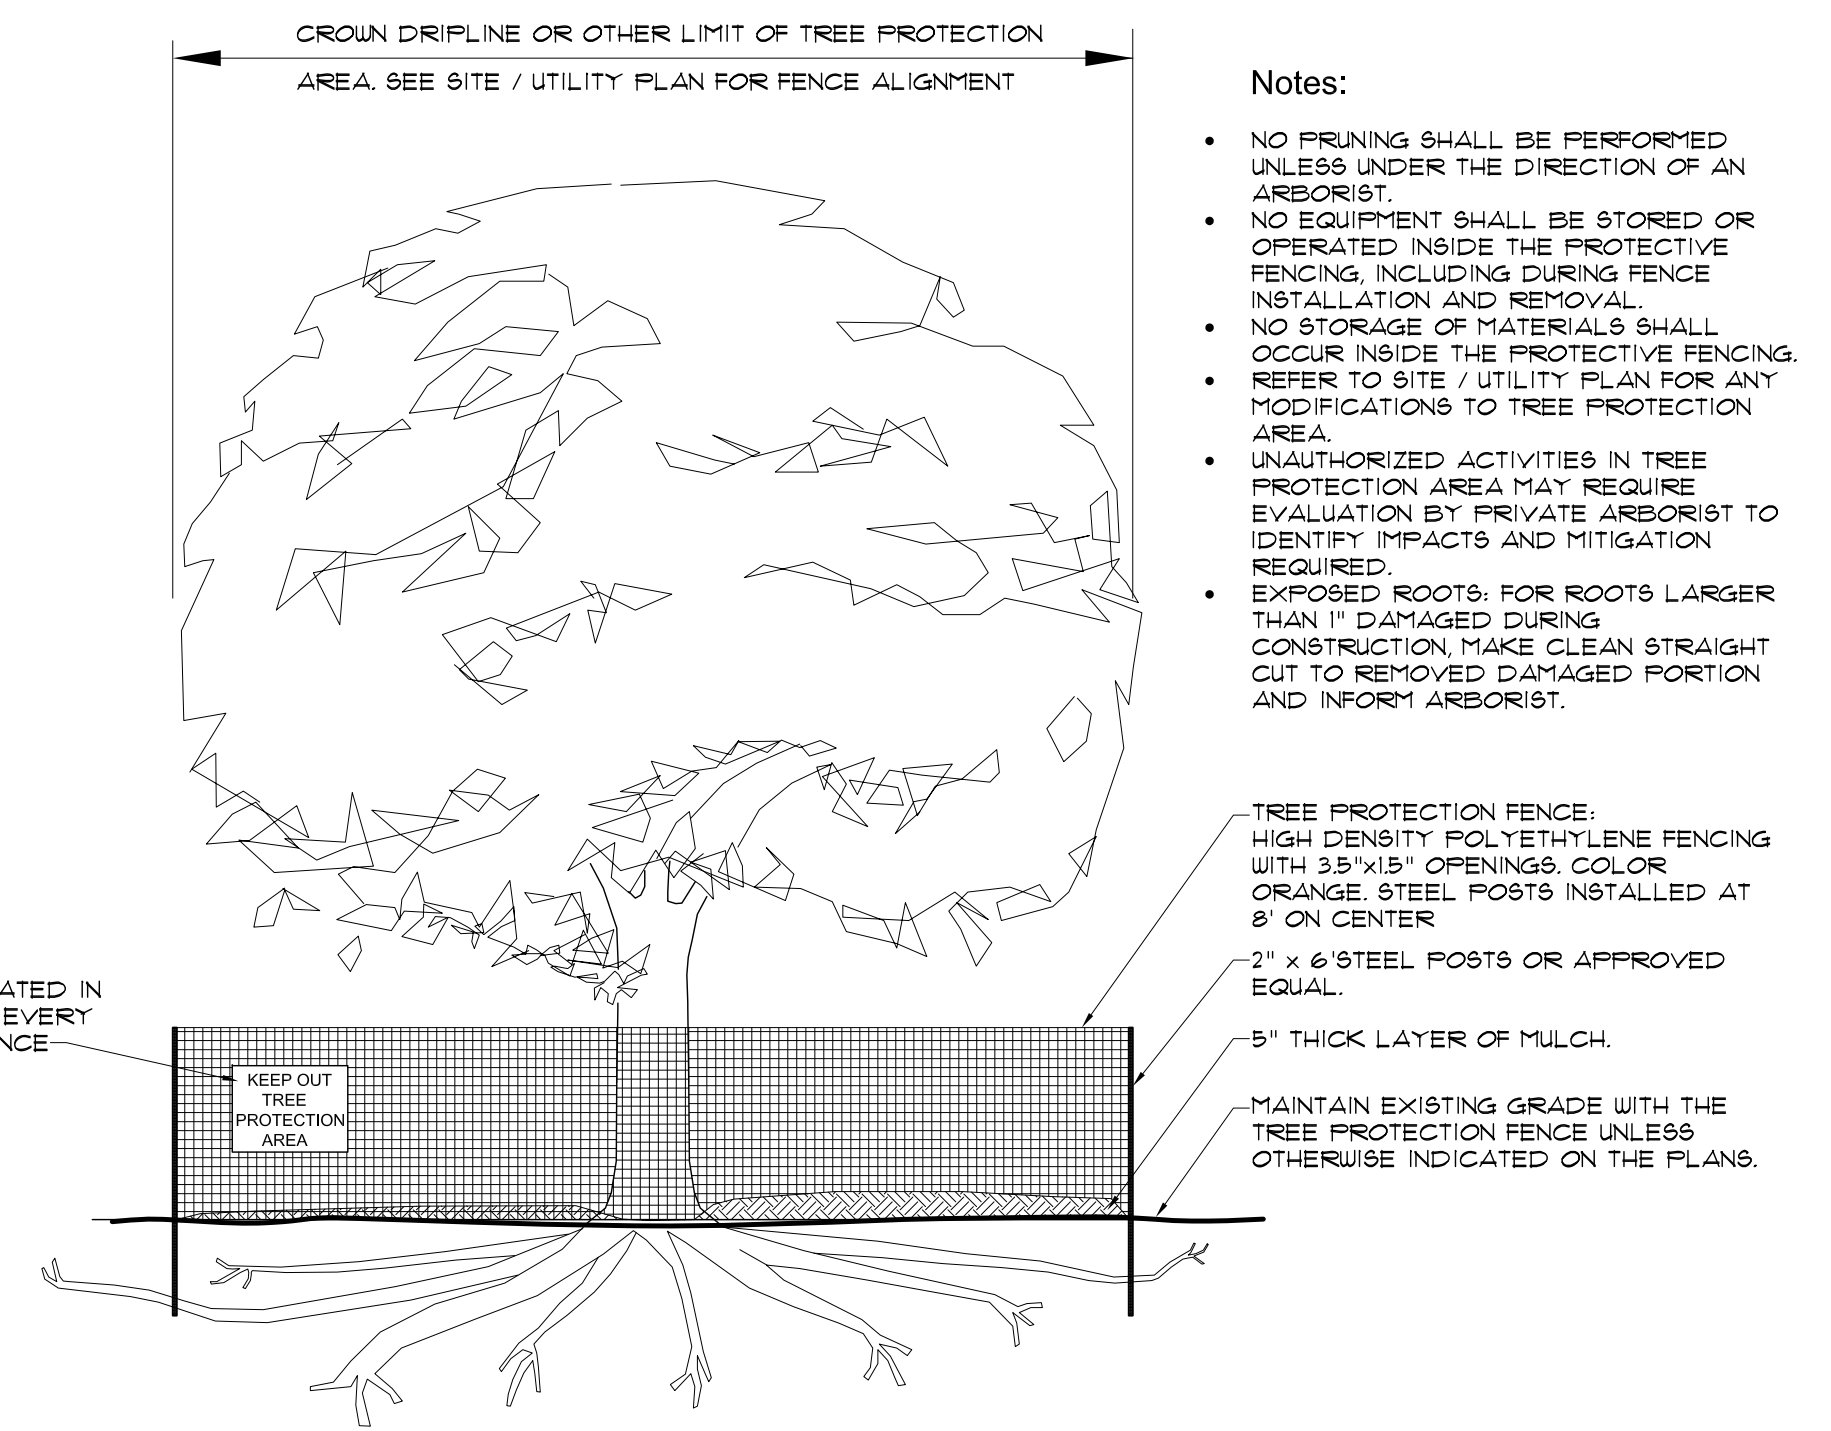

Tree Protection Zone (TPZ)

- THIS FENCE SHALL NOT BE REMOVED / MOVED FROM THE APPROVED LOCATION WITHOUT WRITTEN AUTHORIZATION FROM THE CITY ARBORIST AND SUPERVISION BY THE PROJECT ARBORIST.
- NO PRUNING SHALL BE PERFORMED UNLESS UNDER THE DIRECTION OF THE PROJECT ARBORIST.
- NO GRADING, EXCAVATION, STORAGE (MATERIALS, EQUIPMENT, VEHICLES, ETC.), OR OTHER UNPERMITTED ACTIVITY SHALL OCCUR INSIDE THE PROTECTIVE FENCING.
- UNAUTHORIZED ACTIVITIES IN TREE PROTECTION AREAS MAY REQUIRE IMMEDIATE EVALUATION BY THE PROJECT ARBORIST TO IDENTIFY IMPACTS AND POTENTIAL MITIGATION.
- PENALTIES FOR DAMAGING OR REMOVING A SAVED TREE MAY BE A FINE UP TO THREE TIMES THE VALUE OF THE TREE PLUS RESTORATION (MCC 19.0160).
- ANY WORK IN APPROVED TPZ MUST BE WITH THE PERMISSION OF THE CITY ARBORIST (206) 215-1112, jam@mercer.gov.

REVISED

The Valentin Residence

Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA, 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com


5005 REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON

VAL 17-01
 E.L.H.
 FEB. 11, 2019

A-1.3

OF

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

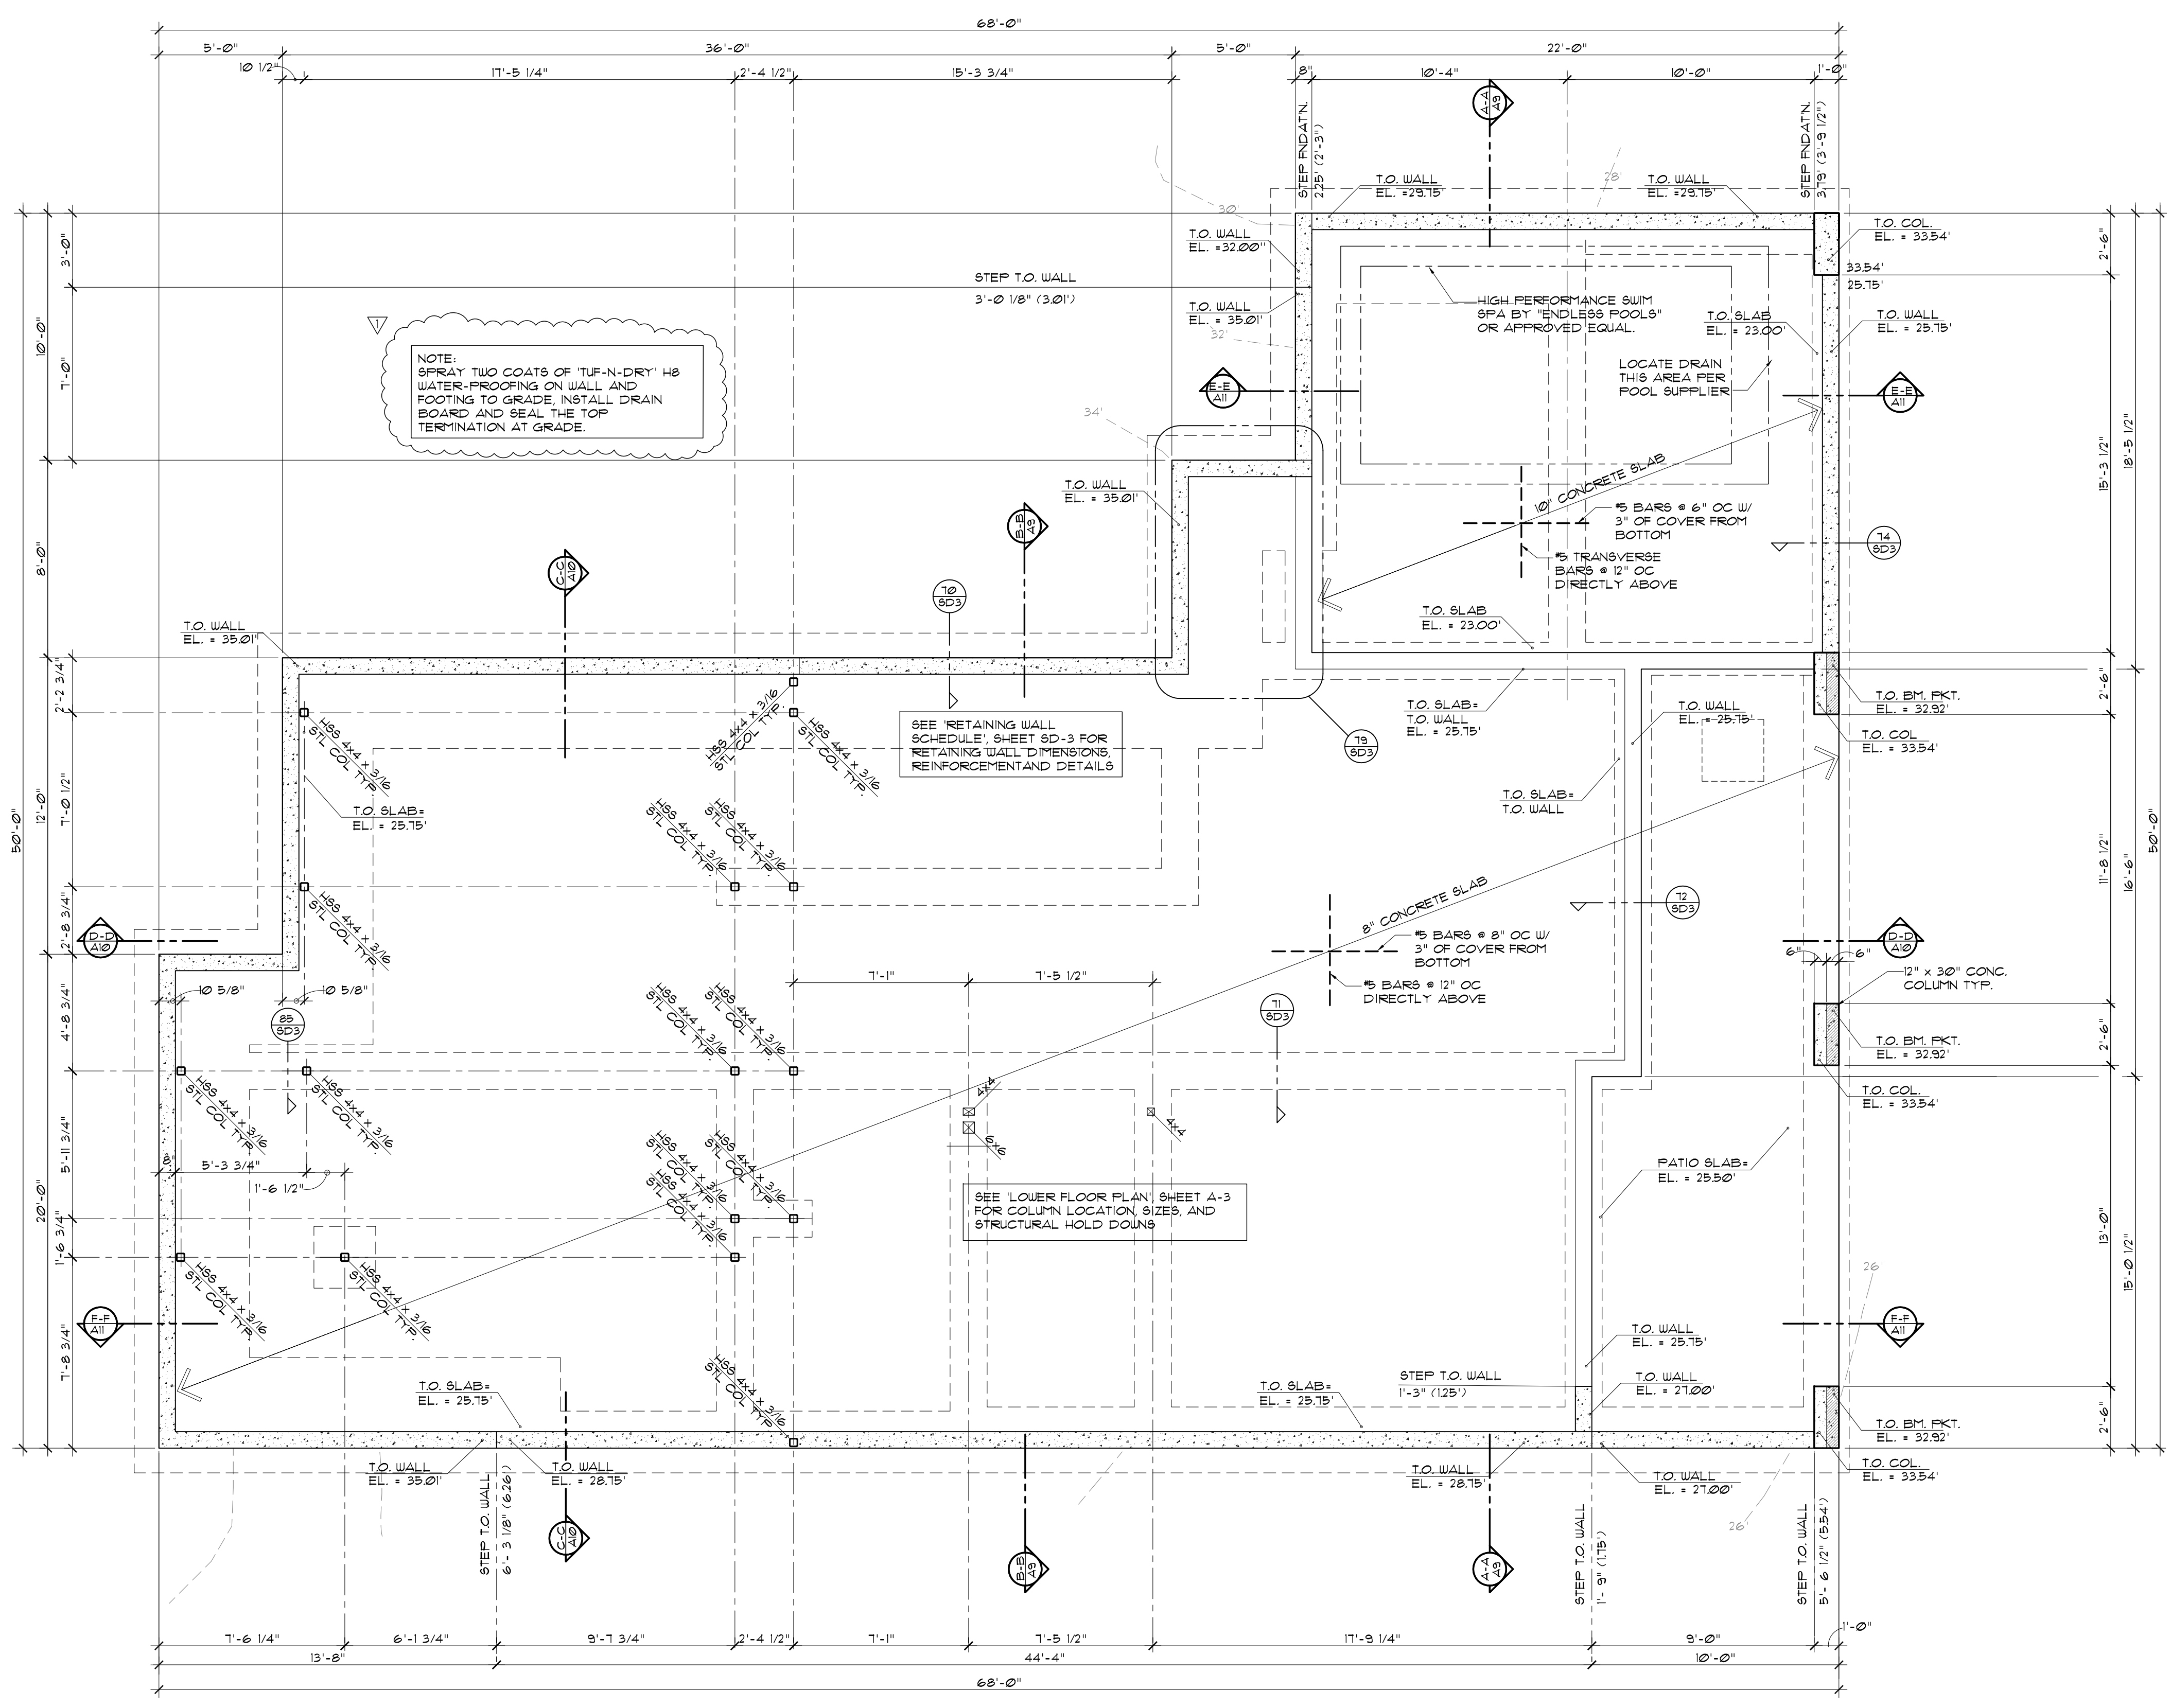


Foundation Plan

North
 1/4" = 1'-0"
 T.O. SLAB ELEV. = 25.75' (25'-9")
 T.O. POOL SLAB ELEV. = 23.00' (23'-0")


Foundation Notes

- SITEWORK:**
 EXCAVATE AND DISPOSE OF TOPSOIL, ORGANIC MATERIAL, LOOSE NATIVE MATERIAL AND OTHER DELETERIOUS MATERIAL WITHIN FIVE FEET OF THE BUILDING.
 FOOTINGS SHALL BEAR ON FIRM, UNDISTURBED EARTH OR COMPACTED STRUCTURAL FILL.
 STRUCTURAL FILL SHALL BE GRAVEL BORROW, OR APPROVED WELL GRADE BANKRUN GRAVEL (MAXIMUM 4" ROCK SIZE WITH NO FROZEN SOIL, ORGANIC OR DELETERIOUS MATERIAL), OR LEAN CONCRETE (16 ± 2000 PSI). GRAVEL SHALL BE PLACED IN 6" MAXIMUM LIFTS AND COMPACTED TO 98% RELATIVE DENSITY PER ASTM D-1557.
- CAST IN PLACE CONCRETE:**
 MIX, DELIVER AND PLACE ALL CONCRETE IN ACCORDANCE WITH ASTM C-94, ACI 304, ACI 305, ACI 306 AND ACI 318.
 ALL EXTERIOR FOOTINGS SHALL BE PLACED A MINIMUM OF 12" BELOW THE UNDISTURBED GROUND SURFACE BUT MUST EXTEND BELOW THE FROST LINE AS SPECIFIED IN IRC TABLE R3012(1).
 TOP OF CONCRETE FOUNDATION SLAB SHALL EXTEND ABOVE THE FINISH GRADE ADJACENT TO THE FOUNDATION AT ALL POINTS A MINIMUM OF 6".
 WOOD FRAMING SHALL BEAR UPON A 3x6 PRESSURE TREATED MUD SILL TYPICAL. ANCHOR BOLT SIZE AND SPACING SHALL BE IN ACCORDANCE TO THAT SHOWN ON THE SHEARWALL SCHEDULE AND NOTES.
- HOLD DOWNS:**
 STRUCTURAL HOLD DOWNS ARE SHOWN AND NOTED ON THE "FOUNDATION PLAN", SHEET A-4. FOUNDATION CONTRACTOR SHALL CONFIRM AND VERIFY LOCATION OF ALL HOLD DOWNS PRIOR TO PLACEMENT OF CONCRETE.
- DAMPENING:**
 FOUNDATION WALLS THAT RETAIN EARTH AND ENCLOSE HABITABLE OR USABLE SPACES LOCATED BELOW GRADE SHALL BE DAMPROOFED FROM THE TOP OF THE FOOTING TO THE FINISHED GRADE.
- COLUMNS:**
 WOOD COLUMNS SHALL BE PROTECTED FROM DECAY AS SET FORTH IN SECTION R-313 (I.R.C.).
- GENERAL:**
 SLOPE ALL DRAIN LINES AT 2% MINIMUM TOWARD OUTLET. PROVIDE CLEAN OUTS OR CONTROL STRUCTURES AS APPROPRIATE.
 ALL DRAINAGE PIPING AND STRUCTURES SUBJECT TO INSPECTION PRIOR TO BACKFILLING.
 ROOF AND FOOTING DRAINS MAY BE COMBINED BEYOND THE LOWEST POINT OF THE FOOTING DRAIN.
 USE SAND COLLARS AT C.B. CONNECTIONS TO PVC PIPE.
- ROOF DRAINS:**
 NUMBER AND SIZE SHALL BE IN CONFORMANCE WITH THE INTERNATIONAL RESIDENTIAL CODE.
 DOWN SPOUTS SHALL BE TIED INTO A NON-PERFORATED, RIGID, SMOOTH BORE PIPE, WHICH DRAINS TO AN APPROVED STORM SYSTEM.
- DRAIN PIPE SHALL MEET THE STANDARDS FOR D2129 FOR PVC PIPE OR GR F-405 FOR SMOOTH BORE HDPE PIPE.**
 PROVIDE CLEAN OUTS AT THE UPPER END OF THE SYSTEM AND AT EACH CUMULATIVE CHANGE OF DIRECTION IN EXCESS OF 135 DEGREES.
 ALL PIPE FITTINGS SHALL BE OF THE SAME MATERIAL AS THE STRAIGHT PIPE. GLUED JOINTS SHALL USE A BONDING AGENT RECOMMENDED BY THE MANUFACTURER.
- FOOTING DRAINS:**
 FOOTING DRAINS SHALL BE INSTALLED AROUND ALL FOUNDATIONS WHICH ENCLOSE A CRAWL SPACE, CELLAR, BASEMENT, GARAGE OR OTHER BUILDING SPACE.
- DRAINS SHALL BE CONSTRUCTED OF PERFORATED PIPE INSTALLED AT THE BASE OF THE FOOTING.**
 DRAIN PIPE SHALL MEET THE STANDARDS FOR D2129 FOR PVC PIPE WITH THE PERFORATIONS DIRECTED DOWNWARD. GRANULAR BACKFILL SHALL BE PLACED AROUND AND ABOVE THE FOOTING DRAIN TO A MIN. DEPTH OF 12" OVER DRAIN PIPE. A FILTER FABRIC SHALL BE USED TO PREVENT SOIL PARTICLES FROM ENTERING THE FOOTING DRAIN. IT IS PREFERABLE THAT THE FABRIC BE PLACED BETWEEN THE GRANULAR FILL AND THE NATIVE SOILS.

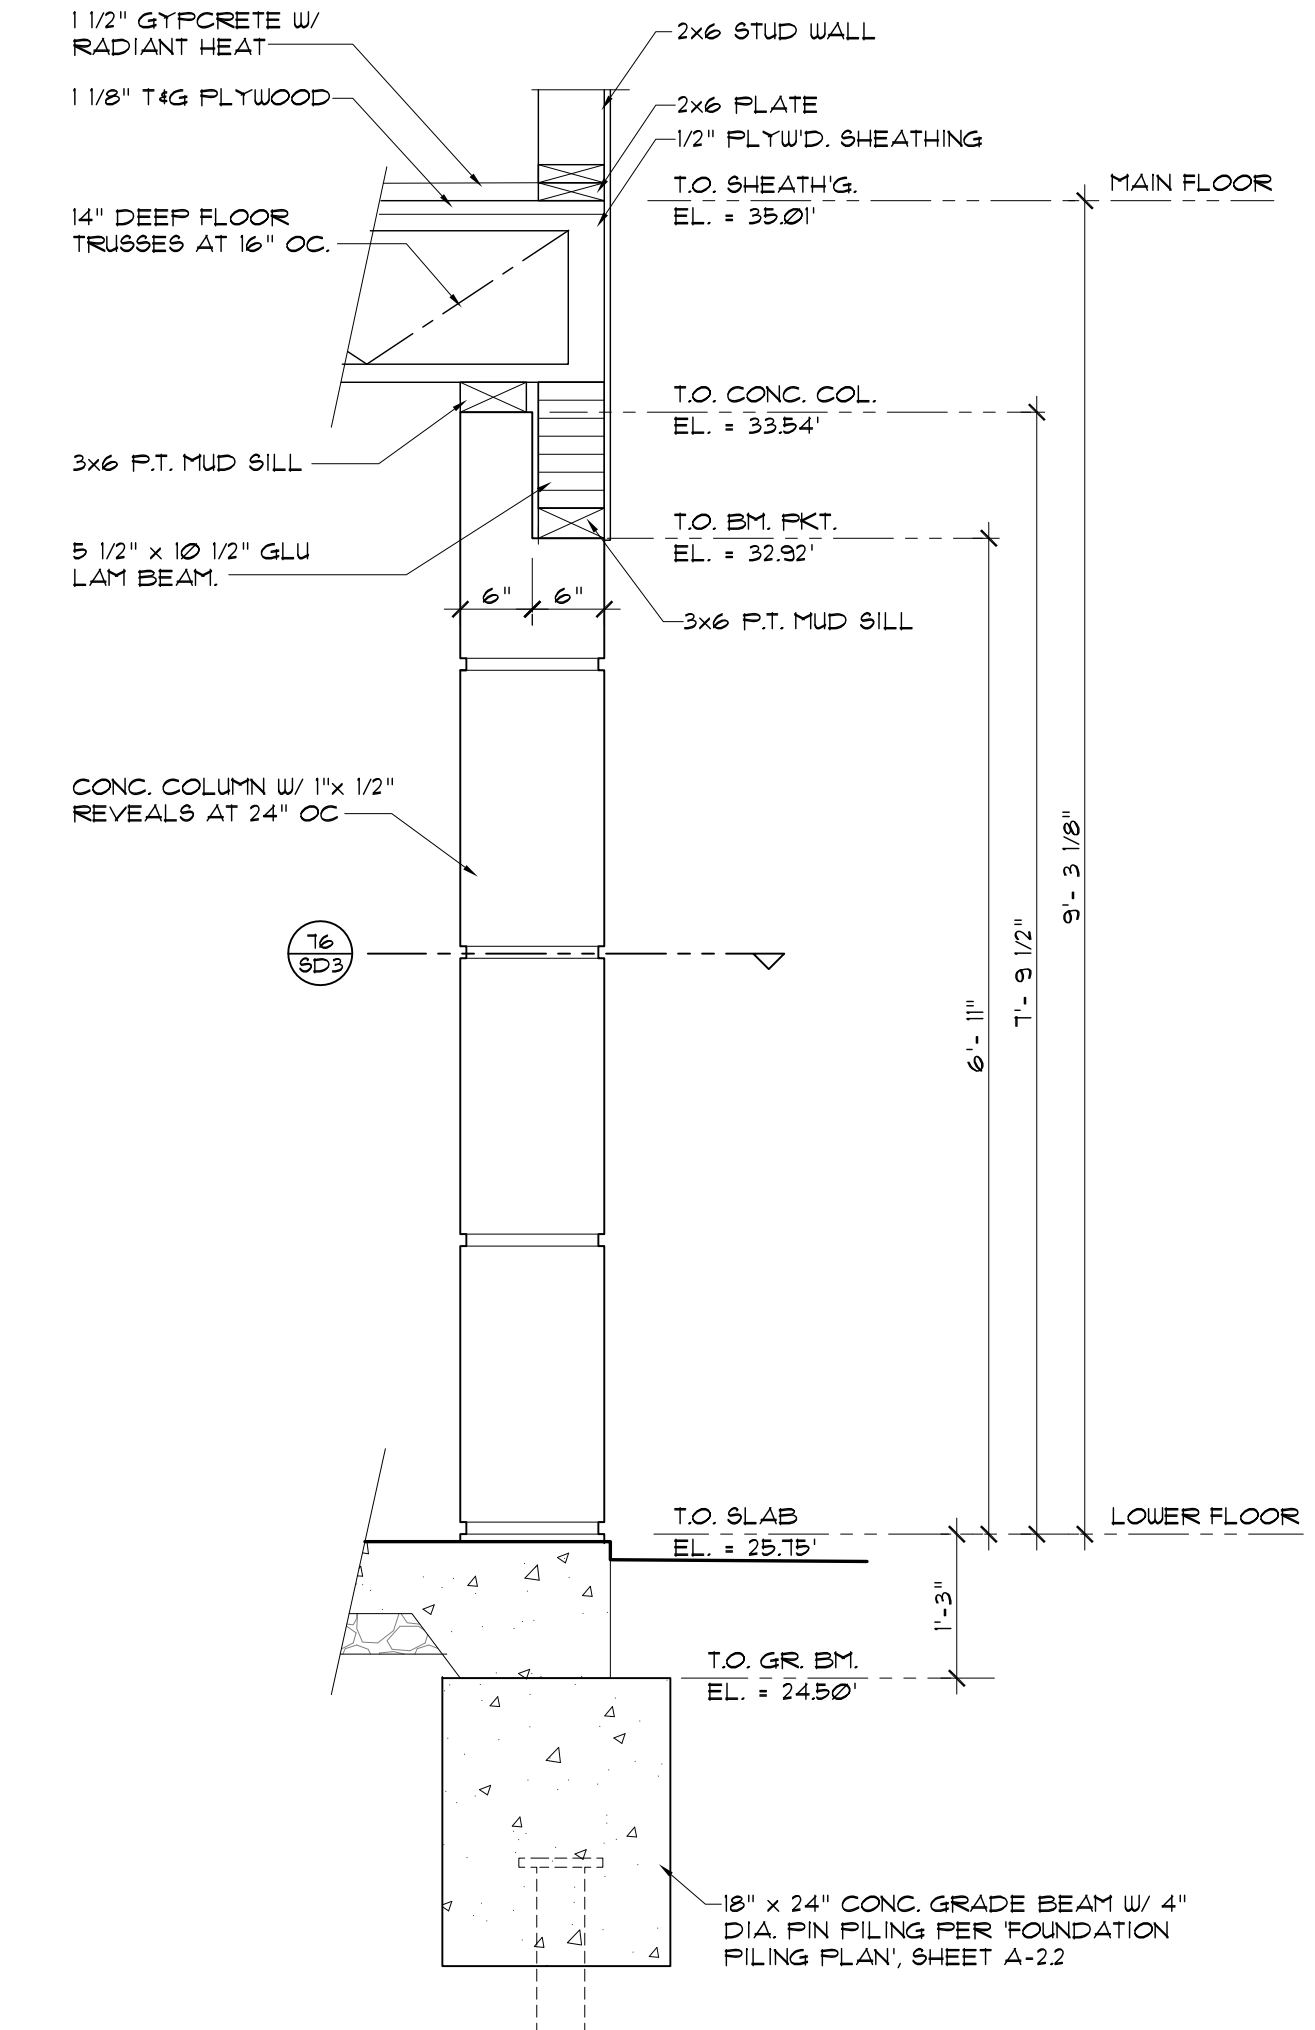

Conc. Col. Detail

3/4" = 1'-0"

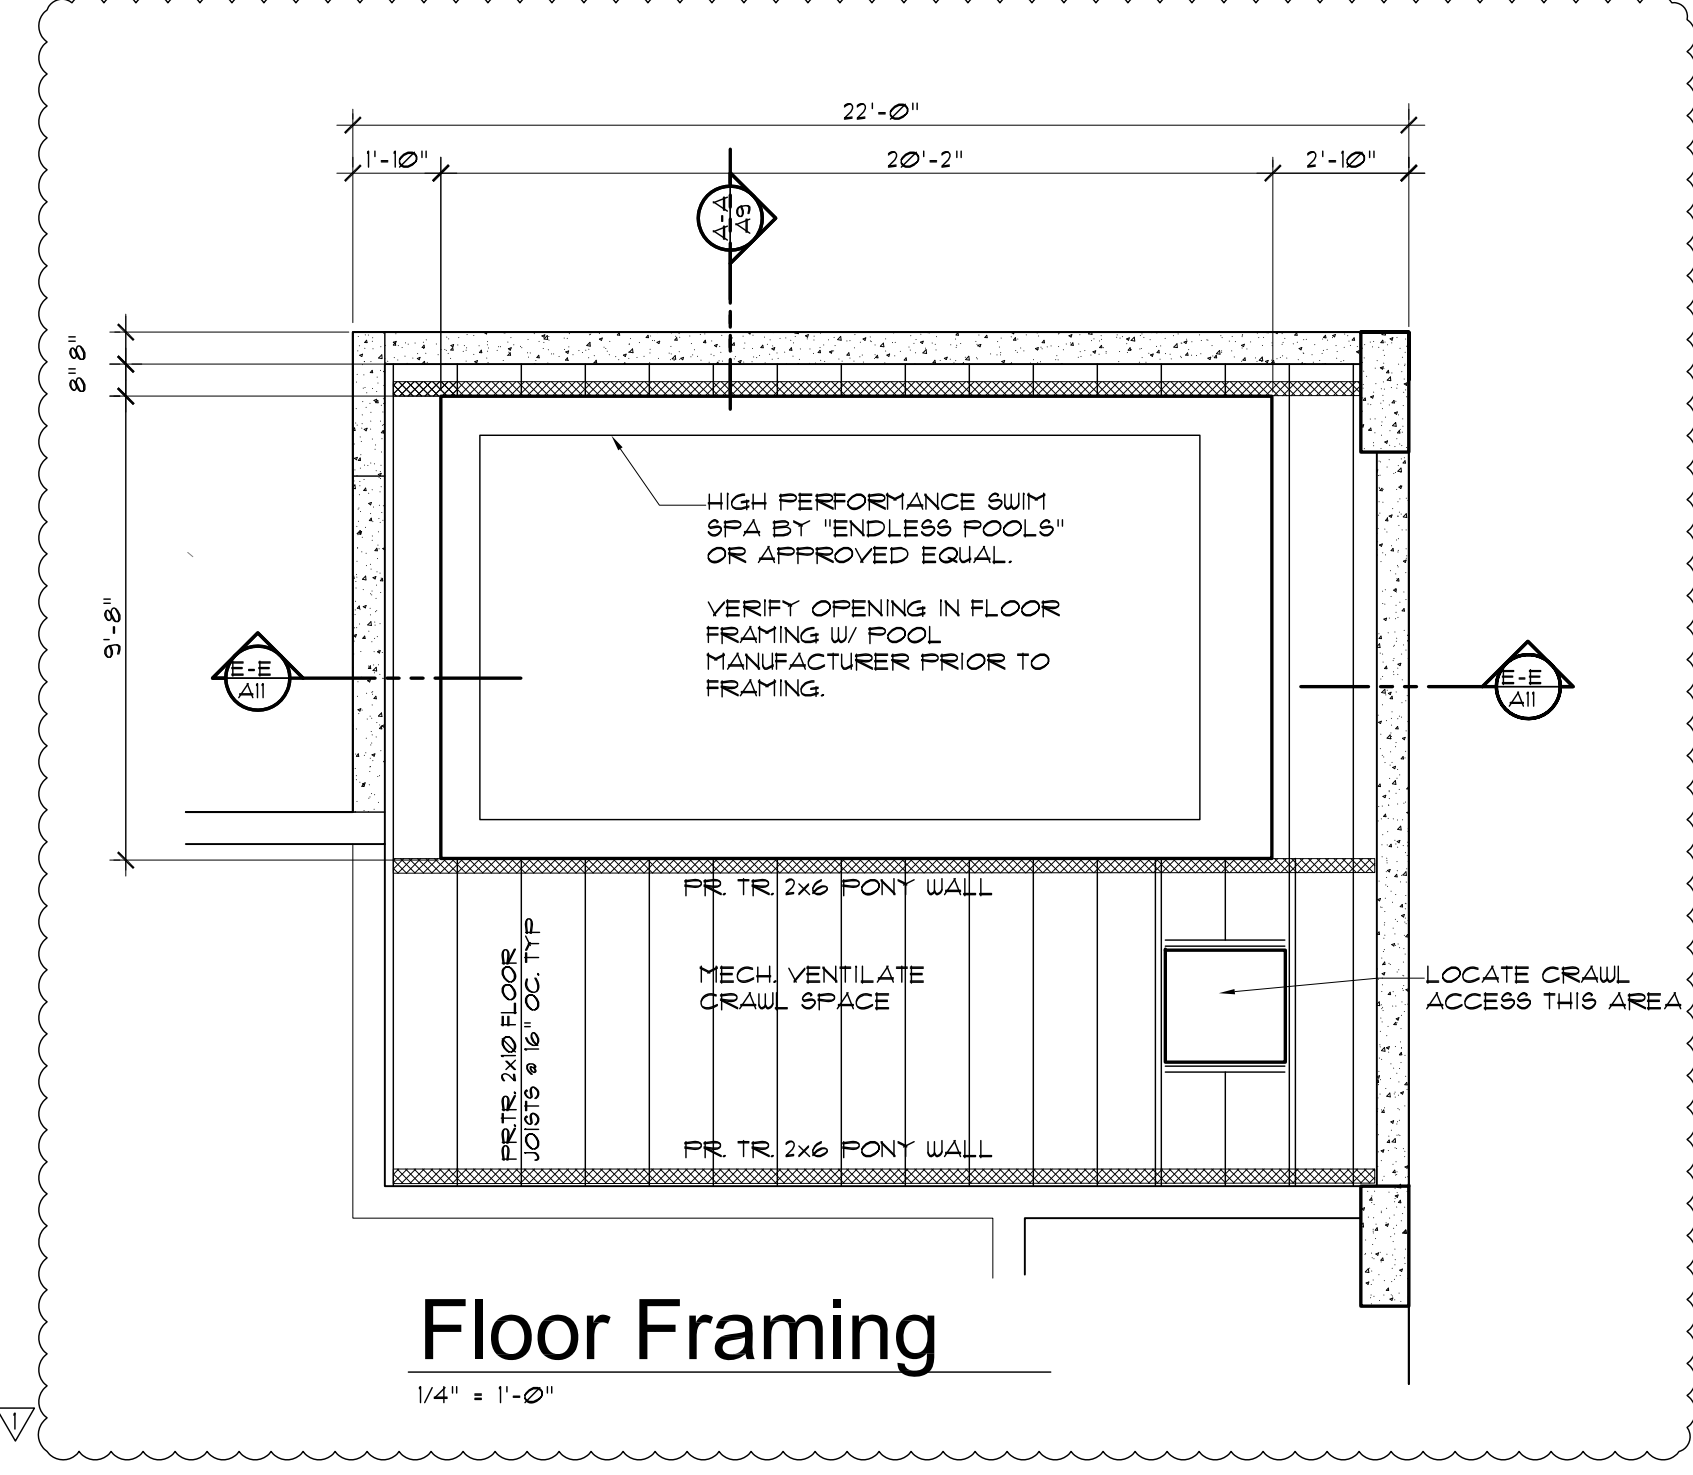

Floor Framing

1/4" = 1'-0"

REVISED
 MAY 21, 2019, ADDED NOTE FOR WATER-PROOFING FOUNDATION.
 ADDED FLOOR FRAMING PLAN FOR POOL ROOM.

The Valentin Residence

Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150/Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com


REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON

val 17-01
 E.L.H.
 FEB. 11, 2019

A-2

OF

PRINTINGS
 DEC. 20, 2018
 DEC. 28, 2018
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 11, 2019
 FEB. 19, 2019
 MAY 21, 2019

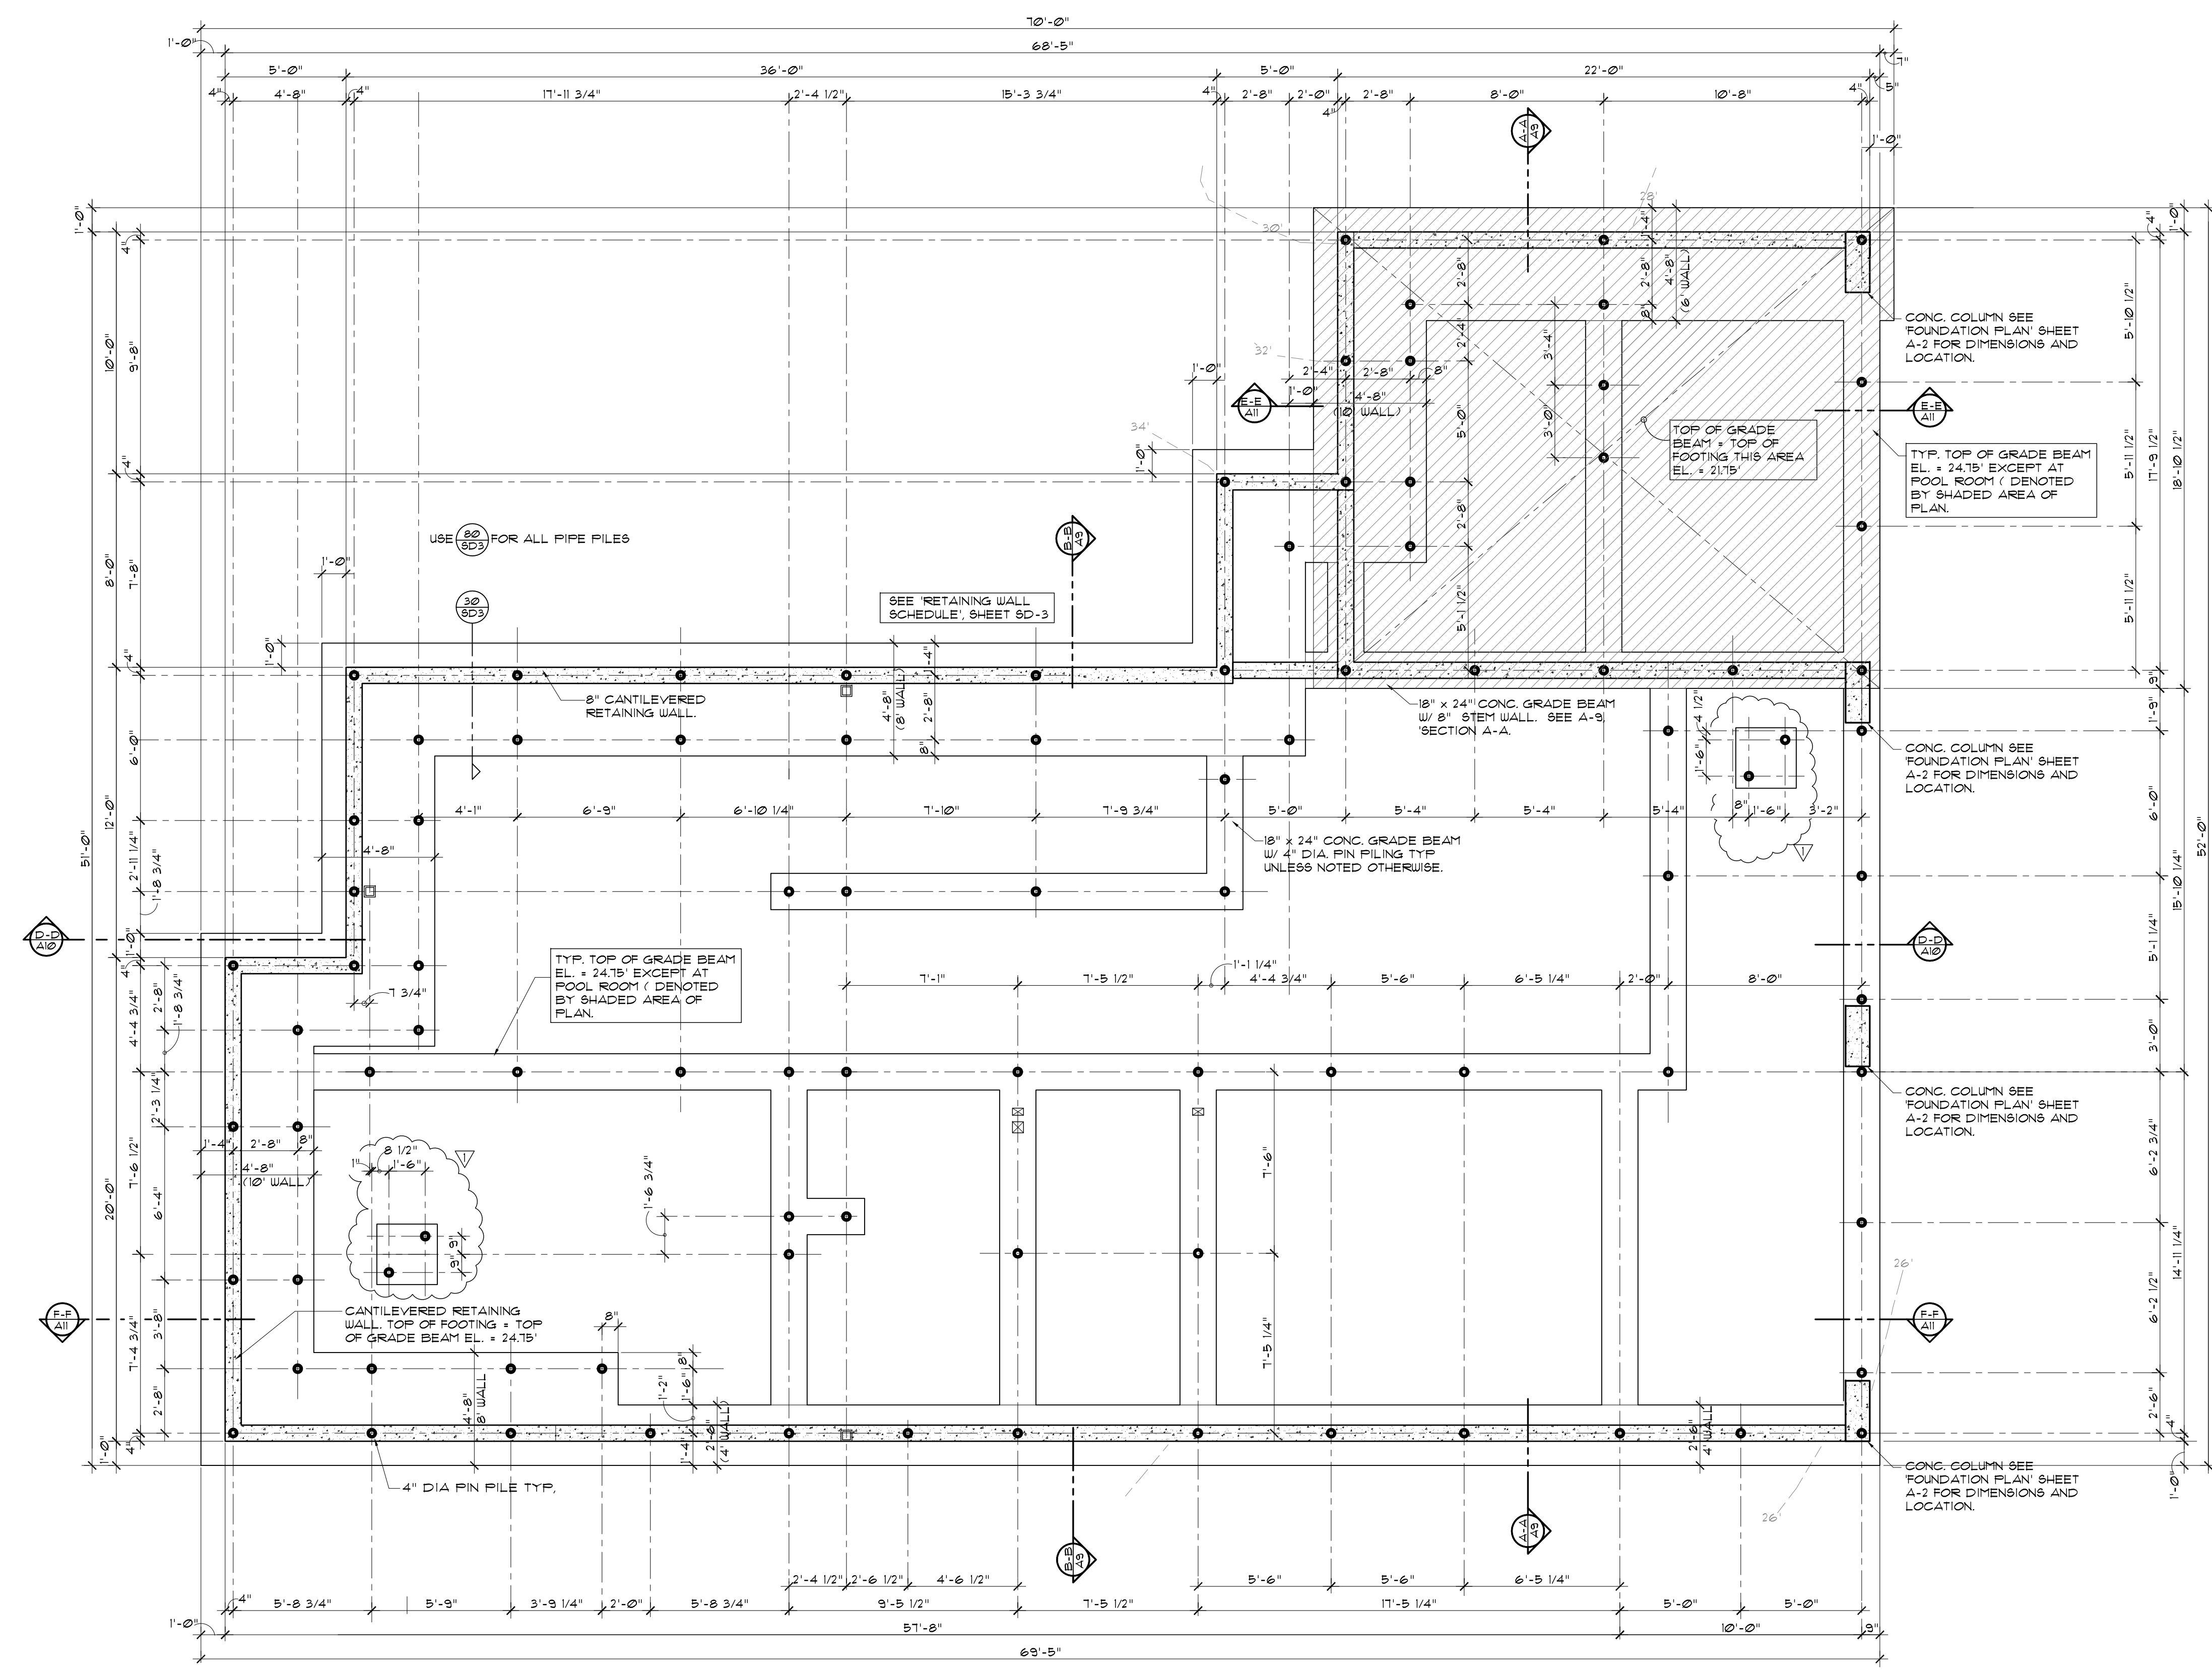

Footing Schedule	
F 1B	1' - 6" x 1' - 6" x 10" THK W/ (2) #4 EW
F 2D	2' - 0" x 2' - 0" x 10" THK W/ (2) #4 EW
F 2B	2' - 6" x 2' - 6" x 10" THK W/ (2) #4 EW
F 3D	3' - 0" x 3' - 0" x 12" THK W/ (3) #4 EW
F 3B	3' - 6" x 3' - 6" x 12" THK W/ (3) #4 EW

Foundation Notes

SITEWORK:
 EXCAVATE AND DISPOSE OF TOPSOIL, ORGANIC MATERIAL, LOOSE NATIVE MATERIAL AND OTHER DELETERIOUS MATERIAL WITHIN FIVE FEET OF THE BUILDING.

FOOTINGS SHALL BEAR ON FIRM, UNDISTURBED EARTH OR COMPACTED STRUCTURAL FILL.

STRUCTURAL FILL SHALL BE GRAVEL BORROW OR APPROVED WELL GRADE BANKRUN GRAVEL (MAXIMUM 4" ROCK SIZE WITH NO FROZEN SOIL, ORGANIC OR DELETERIOUS MATERIAL), OR LEAN CONCRETE (1'c + 2000 PSI). GRAVEL SHALL BE PLACED IN 16" MAXIMUM LIFTS AND COMPACTED TO 95% RELATIVE DENSITY PER ASTM D-1557.

CAST IN PLACE CONCRETE:
 MIX, DELIVER AND PLACE ALL CONCRETE IN ACCORDANCE WITH ASTM C-94, ACI 304, ACI 305, ACI 306 AND ACI 318.

ALL EXTERIOR FOOTINGS SHALL BE PLACED A MINIMUM OF 12" BELOW THE UNDISTURBED GROUND SURFACE BUT MUST EXTEND BELOW THE FROST LINE AS SPECIFIED IN IRC TABLE R302(1).

TOP OF CONCRETE FOUNDATION SLAB SHALL EXTEND ABOVE THE FINISH GRADE ADJACENT TO THE FOUNDATION AT ALL POINTS A MINIMUM OF 6".

WOOD FRAMING SHALL BEAR UPON A 3x6 PRESSURE TREATED MID GILL TYPICAL ANCHOR BOLT SIZE AND SPACING SHALL BE IN ACCORDANCE TO THAT SHOWN ON THE SHEARWALL SCHEDULE AND NOTES.

HOLD DOWNS:
 STRUCTURAL HOLD DOWNS ARE SHOWN AND NOTED ON THE FOUNDATION PLAN, SHEET A-2 AND FLOOR PLANS A-4 AND A-6. FOUNDATION CONTRACTOR SHALL CONFIRM AND VERIFY LOCATION OF ALL HOLD DOWNS PRIOR TO PLACEMENT OF CONCRETE.

DAMP-PROOFING:
 FOUNDATION WALLS THAT RETAIN EARTH AND ENCLOSE HABITABLE OR USABLE SPACES LOCATED BELOW GRADE SHALL BE DAMP-PROOFED FROM THE TOP OF THE FOOTING TO THE FINISHED GRADE.

COLUMNS:
 WOOD COLUMNS SHALL BE PROTECTED FROM DECAY AS SET FORTH IN SECTION R-319 (IRC).

GENERAL:
 SLOPE ALL DRAIN LINES AT 2% MINIMUM TOWARD OUTLET. PROVIDE CLEAN OUTS OR CONTROL STRUCTURES AS APPROPRIATE.
 ALL DRAINAGE PIPING AND STRUCTURES SUBJECT TO INSPECTION PRIOR TO BACKFILLING.
 ROOF AND FOOTING DRAINS MAY BE COMBINED BEYOND THE LOWEST POINT OF THE FOOTING DRAIN.
 USE SAND COLLARS AT CB CONNECTIONS TO PVC PIPE.

ROOF DRAINS:
 NUMBER AND SIZE SHALL BE IN CONFORMANCE WITH THE INTERNATIONAL RESIDENTIAL CODE.

DRAIN SPOUTS SHALL BE TIED INTO A NON-PERFORATED, RIGID, SMOOTH BORE PIPE, WHICH DRAINS TO AN APPROVED STORM SYSTEM.

DRAIN PIPE SHALL MEET THE STANDARDS FOR D2129 FOR PVC PIPE OR GR F-405 FOR SMOOTH BORE HDPE PIPE.

PROVIDE CLEAN OUTS AT THE UPPER END OF THE SYSTEM AND AT EACH CUMULATIVE CHANGE OF DIRECTION IN EXCESS OF 135 DEGREES.

ALL PIPE FITTINGS SHALL BE OF THE SAME MATERIAL AS THE STRAIGHT PIPE. GLUED JOINTS SHALL USE A BONDING AGENT RECOMMENDED BY THE MANUFACTURER.

FOOTING DRAINS:
 FOOTING DRAINS SHALL BE INSTALLED AROUND ALL FOUNDATIONS WHICH ENCLOSE A CRAWLSPACE, CELLAR, BASEMENT, GARAGE OR OTHER BUILDING SPACE.

DRAINS SHALL BE CONSTRUCTED OF PERFORATED PIPE INSTALLED AT THE BASE OF THE FOOTING.

DRAIN PIPE SHALL MEET THE STANDARDS FOR D2129 FOR PVC PIPE, WITH THE PERFORATIONS DIRECTED DOWNWARD. GRANULAR BACKFILL SHALL BE PLACED AROUND AND ABOVE THE FOOTING DRAIN TO A MIN. DEPTH OF 12" OVER DRAIN PIPE. A FILTER FABRIC SHALL BE USED TO PREVENT SOIL PARTICLES FROM ENTERING THE FOOTING DRAIN. IT IS PREFERABLE THAT THE FABRIC BE PLACED BETWEEN THE GRANULAR FILL AND THE NATIVE SOILS.

Foundation Pin Piling Plan

North
 1/4" = 1'-0"

● DENOTES 4" DIA PIN FILE

THIS PLAN FOR PILING LAYOUT ONLY. SEE FOUNDATION PLAN, SHEET A2 FOR ALL OTHER DIMENSIONS, ELEVATIONS, HOLD DOWNS AND RELATED INFORMATION.

REFER TO LOWER AND MAIN FLOOR PLANS (SHEETS A-4 AND A-6) FOR HOLD DOWN LOCATIONS RELATIVE TO OPENINGS.

4'-8" 10" WALL
 DENOTES WIDTH OF FOOTING FROM RETAINING WALL SCHEDULE.

4'-8" 10" WALL
 DENOTES WALL HEIGHT FROM RETAINING WALL SCHEDULE.

USE (80/30) FOR ALL PIPE PILES

REVISED MAY 21, 2019, ADDED FOOTING AND FIN FILES FOR CIRCULAR STAIR, ADDED ADDITIONAL FIN FILE FOR ISOLATED FOOTING

The Valentin Residence

Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com


5005 REGISTERED ARCHITECT ED. L. HURI STATE OF WASHINGTON

VAL 17-01
 E.L.H.
 FEB. 11, 2019

A-2.1

OF

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 7, 2019
 FEB. 9, 2019
 MAY 21, 2019

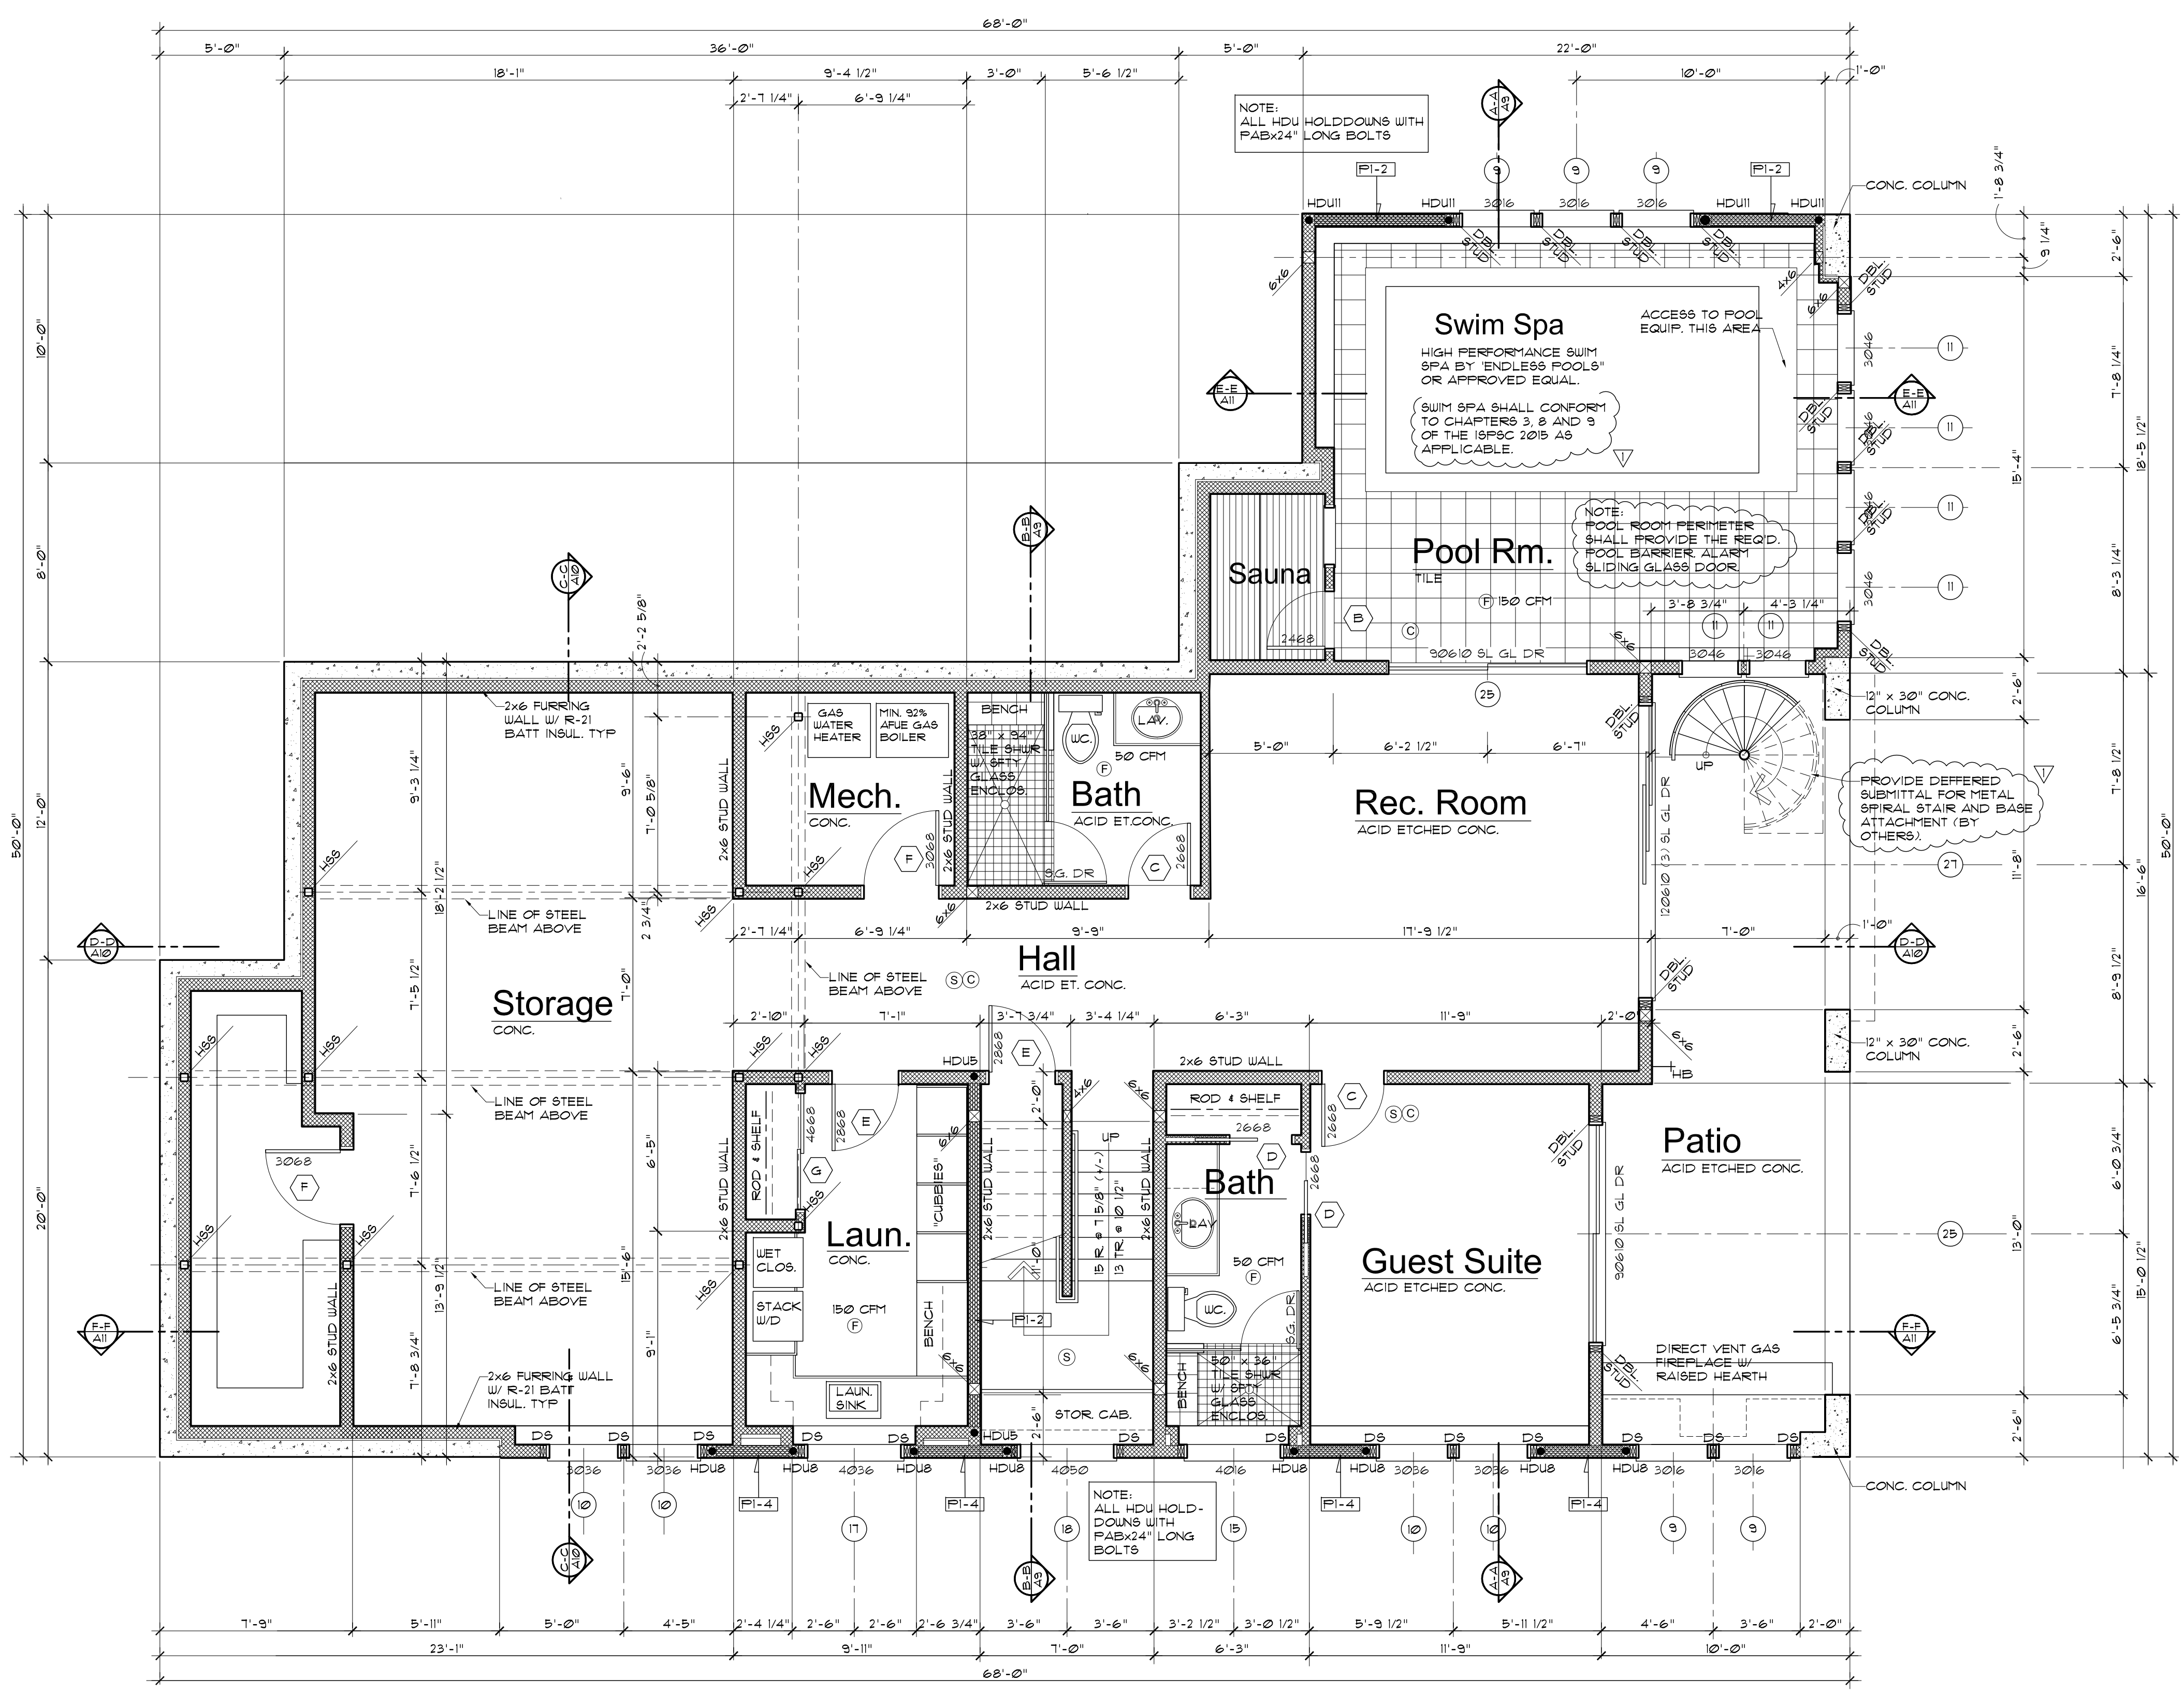

Window Schedule

MARK	QTY.	TYPE	SIZE	LOCATION	COMMENTS	U VALUE REQ'D.	AREA / UNIT	GLAZED AREA
1	8	PIC.	1'-0" x 1'-6"	GARAGE		0.28	15 SF	12.0 SF
2	8	PIC.	1'-0" x 6'-0"	GARAGE	SAFETY / TEMP. GLASS		6.00 SF	48.0 SF
3	1	CSMT.	1'-6" x 3'-6"	MASTER BATH			5.25 SF	5.25 SF
4	1	PIC.	1'-6" x 5'-0"	HALL	SAFETY / TEMP. GLASS		7.50 SF	7.50 SF
5	1	PIC.	2'-0" x 1'-6"	BATH			3.00 SF	3.00 SF
6	1	CSMT.	2'-0" x 3'-0"	BATH			6.00 SF	6.00 SF
7	1	CSMT.	2'-0" x 3'-6"	M. BA.			7.00 SF	7.00 SF
8	4	3 CSMT / 1 PIC	2'-6" x 3'-6"	M. BA. LAUN.			8.75 SF	35.00 SF
9	22	PIC	3'-0" x 1'-6"	GR. RM. POOL. PATIO, MASTER			4.50 SF	99.00 SF
10	4	CSMT.	3'-0" x 3'-6"	GUEST, STOR.			10.50 SF	42.00 SF
11	8	4 CSMT / 4 PIC	3'-0" x 4'-6"	POOL RM.	SAFETY / TEMP. GLASS		13.50 SF	108.00 SF
12	7	1 PIC / 6 CSMT	3'-0" x 5'-0"	BR 3, BR 4			15.0 SF	105.00
13	8	COMBO	3'-0" x 4'-6" PIC 3'-0" x 1'-6" AUN.	GREAT RM.	SAFETY GL., MATCH DR. W.		18.0 SF	144.00 SF
14	7	COMBO	3'-0" x 5'-0" PIC 3'-0" x 1'-6" AUN.	BR 2,	SAFETY GLASS		19.50 SF	136.50 SF
15	8	6 PIC / 2 AUN.	4'-0" x 1'-6"	GR. RM. KIT, BATH	3 PIC COMBO FORMS TRANSOM FOR SL. GL. DR. (VERIFY)		6.00 SF	48.00 SF
16	1	PIC.	4'-0" x 3'-6"	KIT.			14.00 SF	14.00 SF
17	1	DBL. CSMT.	4'-0" x 3'-6"	LAUN.			14.00 SF	14.00 SF
18	3	PIC.	4'-0" x 5'-0"	M. BA. STAIR	SAFETY GL. * M. BA.		20.00 SF	60.00 SF
19	1	PIC.	4'-0" x 6'-6"	STAIR			26.00 SF	26.00 SF
20	2	COMBO	4'-0" x 4'-6" PIC 4'-0" x 1'-6" PIC	GREAT RM.			24.00 SF	48.00 SF
21	2	PIC.	5'-0" x 1'-6"	KIT.			7.50 SF	15.00 SF
22	2	PIC.	5'-0" x 3'-6"	KIT.			17.50 SF	35.00 SF
23	2	PIC.	6'-0" x 1'-6"	KIT.			9.00 SF	18.00 SF
24	2	PIC.	6'-0" x 3'-6"	KIT.			21.00 SF	42.00 SF
25	3	SL. GL. DR.	9'-0" x 6'-10"	GUEST, POOL			61.50 SF	184.50 SF
26	1	SL. GL. DR.	9'-0" x 6'-10"	MASTER			72.00 SF	72.00 SF
27	2	SL. GL. DR.	12'-0" x 6'-10"	DINING, REC. RM.	3 PANEL, SAFETY GL.	0.28	81.36 SF	163.32 SF
SKYLIGHTS								
							TOTAL WINDOW AREA	1,498.80 SF
							0.50	16.00 SF
							TOTAL GLAZED AREA	1,562.80 SF

Door Schedule

GLAZED DOOR AREAS NOTED ON WINDOW SCHEDULE

MARK	QTY.	SIZE	TYPE	LOCATION	COMMENTS
A	2	2'-2" x 6'-8"	INT. CSMT	CLOSETS	
B	2	2'-4" x 6'-8"	INT. CSMT.	PAN., SAUNA	
C	3	2'-6" x 6'-8"	INT. CSMT.	GUEST PANTRY, FOR ENTRY CLOS.	
D	5	2'-6" x 6'-8"	POCKET	GUEST BA., PANTRY, HUD ROOM	
E	2	2'-8" x 6'-8"	INT. CSMT	STAIR LAUN.	
F	3	3'-0" x 6'-8"	CSMT	GAR. MECH., STOR.	SOLID CORE W/ SELF CLOSER AT GARAGE INT. CSMT. AT MECH AND STOR.
G	1	4'-6" x 6'-8"	BI-PASS	LAUN.	
H	1	5'-0" x 6'-8"	PIVOT	FOYER	MEAS. TO PROVIDE EXACT LAYOUT BASED ON ALLOWABLE ROUGH OPENING.
I	1	8'-0" x 8'-0"	O/H GARAGE	GARAGE	W/ ELECTRIC OPENER
J	1	16'-0" x 8'-0"	O/H GARAGE	GARAGE	W/ ELECTRIC OPENER
K	1	2'-2" x 8'-0"	POCKET	WIC	
L	1	2'-4" x 8'-0"	POCKET	M. BATH	
M	7	2'-6" x 8'-0"	INT. CSMT.	BR 2, BR 3, BR 4, BATH WIC	
N	2	2'-6" x 8'-0"	POCKET	BATH	
O	1	FR.	INT. CSMT.	MASTER	
P	1	2'-8" x 8'-0"	INT. CSMT.	LAUNDRY	
Q	2	3'-6" x 8'-0"	BI-PASS	HALL	
R	1	4'-0" x 8'-0"	BI-PASS	BR 4	
S	1	6'-0" x 8'-0"	BI-PASS	BR 4	

Lower Floor Plan 2,268 sf
 1/4" = 1'-0"
 T.O. SLAB ELEV. = 25.75' (25'-9") 2,552 SF INCL. PATIO (284 SF)

- Legend:**
- DENOTES SIMPSON HOLD DOWN AS NOTED
 - DENOTES SIMPSON STRAP (VERT.) AS NOTED
 - SW-# SHEAR WALL PANEL NO. (SEE SCHEDULE)
 - DENOTES STUD WALL FRAMING
 - DENOTES SHEAR PANEL
 - F EXHAUST FAN (SEE SIZING NOTES)
 - S 110V SMOKE DETECTOR W/ BATTERY BACK UP.
 - C CARBON MONOXIDE DETECTOR
 - 102-6 DENOTES FLR. ELEV. (T.O. SLAB) / T.O. 5HT'G.)
 - D8 DOWN SPOUT
 - H2 HOSE BIBB
 - H88 4"x4"x3/16" STEEL COLUMN
 - D8 DOUBLE STUD

General Notes:

ALL EXTERIOR WALLS OR WALLS BETWEEN HEATED AND UNHEATED SPACES SHALL BE 2 x 6 STUDS @ 16" OC TYPICAL UNLESS NOTED OTHERWISE (UNO.) WITH 6 x 10 HEADERS AT ALL OPENINGS IN BEARING WALLS UNO. (SEE FRAMING PLANS).

ALL INTERIOR WALLS SHALL BE 2 x 4 STUDS @ 16" OC TYP. UNO. WITH 4 x 10 HEADERS (BEARING WALLS); UNO.

ALL DIMENSIONS SHOWN ARE TO FACE OF FRAMING UNO.

BUILDING OFFSET DIMENSIONS; F.O. FRAMING + F.O. CONCRETE AT FOUNDATION WALLS TYP. UNO.

PLATE HEIGHT THIS FLOOR = 8'-0" TYP. (UNO.)

SOLID BLOCK ALL SUPPORTS AND FIRE BLOCK ALL PLUMBING PENETRATIONS AND LOCATIONS REQUIRED BY IBC/2011 PROVIDE FIRE BLOCKING TO ALL CONCEALED DRAFT OPENINGS TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN FLOORS.

SEE FLOOR FRAMING PLANS FOR HEADER NOTATIONS AND ALL COLUMN / BEAM SIZES AND LOCATIONS.

ALL HOLD DOWNS ARE TO BE SIMPSON (TYPE AND SIZE AS NOTED ON PLANS AND SHEAR WALL SCHEDULE). SEE FLOOR FOUNDATION AND FRAMING PLANS FOR LOCATION AND TYPE OF ALL SHEAR WALL PANEL TYPE AND ANCHOR BOLT SPACING AT PANELS. ALL STRAP TIE DOWNS SHALL HAVE A MINIMUM 1 1/2" EDGE COVER PROVIDE TRIPLE 2x STUDS AS REQUIRED FOR PROPER PLACEMENT.

Typical Construction

ROOF:

STANDING BEAM METAL ROOF
 1/2" PLYWOOD SHEATHING
 SHED ROOF TRUSSES (SPACING PER PLAN)
 OR
 11/8" T & G PLYWOOD SHEATHING
 EPDM ROOF MEMBRANE, FULLY ADHERED.
 HUNTER TAPERED PANELS (MIN. 1/4" / FT)
 1/2" PLYWOOD SHEATHING
 14" DEEP FLAT TRUSSES @ 16" OC
 MIN. R-49 BATT OR BLOW-IN INSULATION
 5/8" GYPSUM WALLBOARD (GWB.)

FLOORS:

FRAMED FLOORS:
 FINISH FLOOR VARIES (SEE FLOOR PLANS)
 1 1/2" GYPCRETE W/ RADIANT HEATING
 11/8" T & G PLYWOOD SHEATHING
 14" DEEP FLOOR TRUSSES @ 16" OC
 MIN. R-38 BATT INSULATION (AS REQUIRED)
 1/2" GYPSUM WALLBOARD (GWB.) @ CEILINGS.

GARAGE FLOOR:
 LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
 16" DEEP STEEL BEAMS
 R-38 BATT INSULATION
 5/8" TYPE 'X' GYPSUM WALLBOARD

LOWER FLOOR SLAB:
 6" CONC. SLAB W/ RADIANT HEAT AND *4 STONE VENEER
 11/8" T & G PLYWOOD SHEATHING
 R-10 RIGID INSULATION UNDER ENTIRE SLAB.
 MIN. 6 MIL VAPOR BARRIER
 MIN. 6" COMPACTED GRAVEL BASE


WALLS:

HARDIE-PANEL OR EQUAL SIDING
 VERTICAL METAL SIDING
 STONE VENEER
 TYVEC OR EQUAL BUILDING WRAP
 1/2" CDX PLYWOOD SHEATHING
 2 x 6 STUDS @ 16" OC
 1/2" GYPSUM WALL BOARD (GWB.)

REVISED
 MAY 21, 2019: ADDED NOTE FOR DEFERRED SUBMITTAL OF METAL STAIR AND BASE ATTACHMENT. ADDED SAFETY GLAZING NOTE TO WINDOW SCHEDULE. ADDED SAUNA SPA NOTES.



The Valentin Residence
 Parcel No. 004610-0150 and 004610-001151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

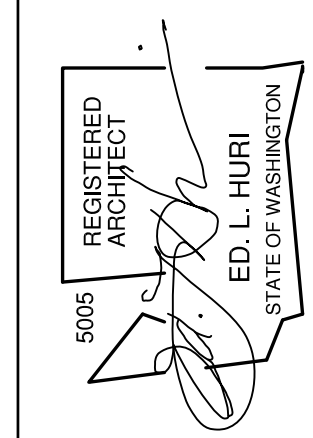

val 11-01
 E.L.H.
 FEB. 11, 2019

PRINTINGS
 DEC. 20, 2018
 DEC. 28, 2018
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

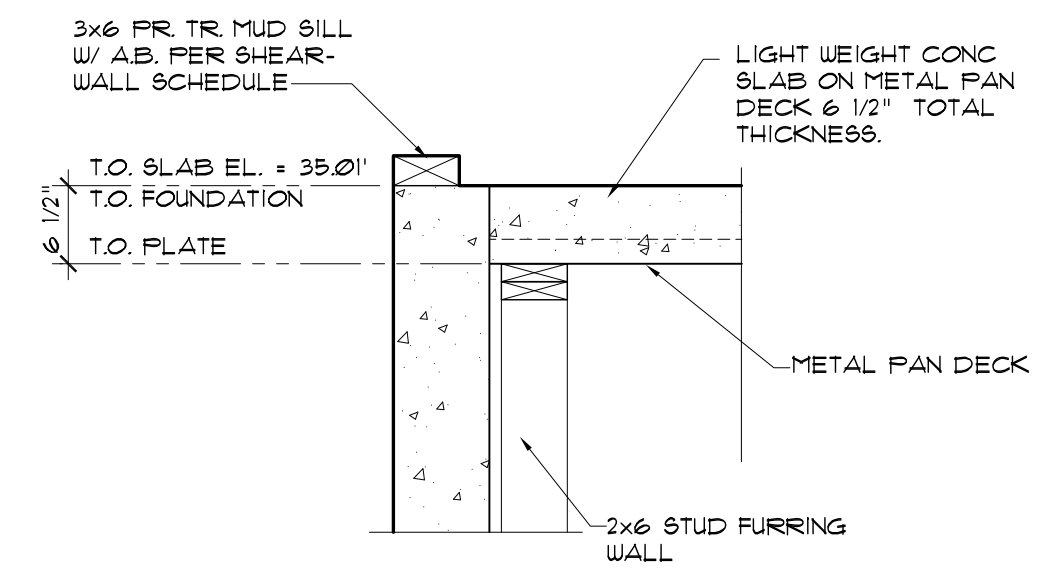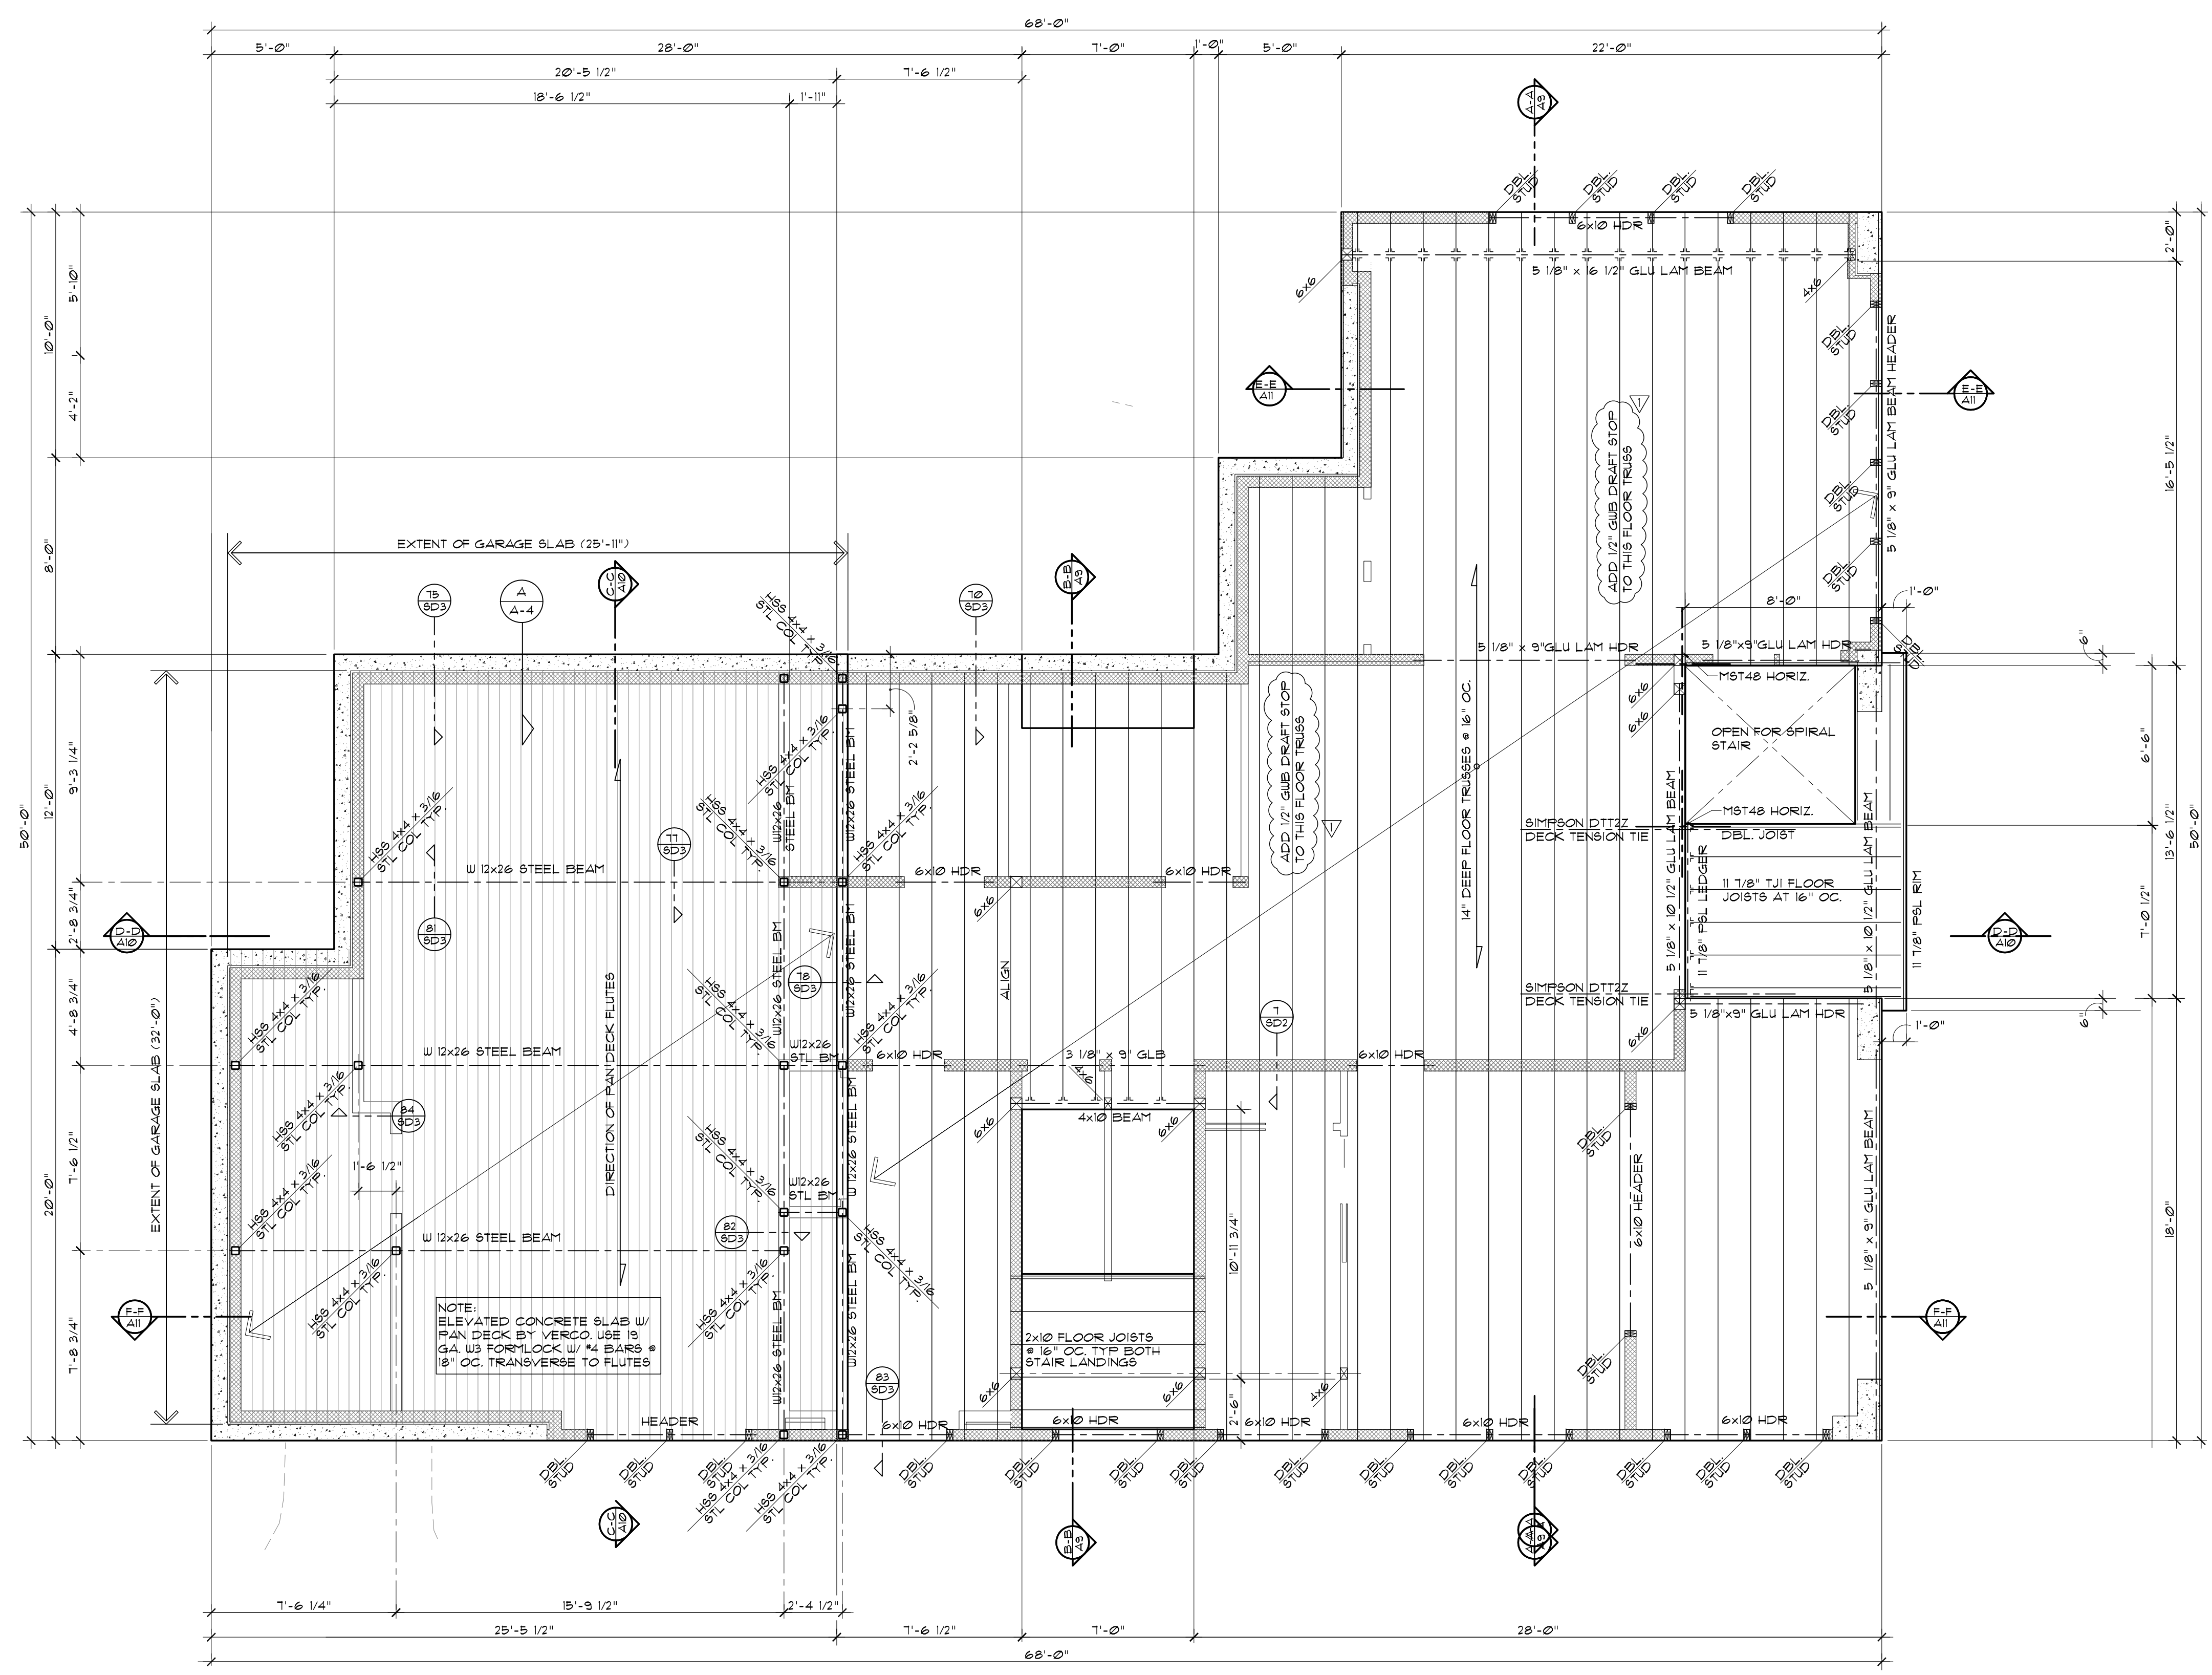

'A' Detail
 3/4" = 1'-0"

Main Floor Framing Plan

North
 1/4" = 1'-0"

Framing Notes:


- GENERAL:**
 THE ENDS OF EACH JOIST, BEAM OR GIRDER SHALL HAVE NOT LESS THAN 1 1/2" OF BEARING ON WOOD OR METAL AND NOT LESS THAN 3" ON CONCRETE OR MASONRY.
 JOIST FRAMING FROM OPPOSITE SIDES OVER A BEARING SUPPORT SHALL LAP A MINIMUM OF 3" AND SHALL BE NAILED TOGETHER WITH A MINIMUM OF THREE (3) 10d FACE NAILS.
 JOIST FRAMING TO THE SIDE OF A BEAM OR GIRDER SHALL BE SUPPORTED BY SIMPSON LUG HANGERS, BEAM / COLUMN USE CCG TYPE HANGERS, BEAM / BEAM USE SIMPSON HUCQ TYPE UNLESS NOTED OTHERWISE (U.N.O.).
 JOISTS SHALL BE SUPPORTED Laterally AT THE ENDS BY FULL DEPTH SOLID BLOCKING NOT LESS THAN 2" NOMINAL THICKNESS OR BY ATTACHMENT TO A HEADER, RIM JOIST OR TO AN ADJOINING STUD; OR SHALL OTHERWISE PROVIDED WITH LATERAL SUPPORT TO PREVENT ROTATION.
- FRAMING LUMBER:**
 PROVIDE S4S, S-DRY, ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE PRESERVATIVE TREATED.
 NAIL IN ACCORDANCE WITH IBC TABLE 23-04.5.1 OR AS INDICATED ON THE DRAWINGS.
 USE FULL HEIGHT STUDS AND USE MULTIPLE STUDS TO ACHIEVE FULL BEARING UNDER BEAM ENDS OR POSTS IN WALL UNLESS NOTED OTHERWISE ON DRAWINGS.
- BEAMS:**
 AITC COMBINE 24F-V4 FOR SINGLE SPANS AND 24F-V8 FOR CONTINUOUS MULTIPLE SPANS; MANUFACTURER'S STANDARD CAMBER.
- LAMINATED VENEER LUMBER (LVL):**
 WEYERHAEUSER MICRO-LAM OR APPROVED ALTERNATE PRODUCTS SHALL BE PROVEN BY TESTING AS DEMONSTRATED BY ICCB OR NER ACCEPTANCE.
- PARALLEL STRAND LUMBER (PSL):**
 WEYERHAEUSER PARALLAM OR APPROVED ALTERNATE PRODUCTS SHALL BE PROVEN BY TESTING AS DEMONSTRATED BY ICCB OR NER ACCEPTANCE.
- PLYWOOD WEB JOISTS:**
 WEYERHAEUSER AS INDICATED ON THE DRAWINGS OR AN APPROVED ALTERNATE. PLYWOOD WEB JOISTS SHALL BE MANUFACTURED WITH APA STRUCTURAL PLYWOOD MACHINE STRESS RATED OR MICRO-LAM LUMBER FLANGES AND WATERPROOF GLUES.
- METAL PLATE WOOD TRUSSES:**
 TRUSSES SHALL BE DESIGNED AND FACTORY MANUFACTURED IN CONFORMANCE WITH TPI-85. METAL PLATE CONNECTORS SHALL BE ICC APPROVED. TOP CHORDS SHALL BE DOUGLAS FIR - LARCH.
 TRUSS MANUFACTURER SHALL PROVIDE DRAWINGS AND CALCULATIONS, INCLUDING PLACING PLANS AND STRESS DIAGRAMS, FOR REVIEW BY THE ENGINEER PRIOR TO FABRICATION.
- FLOOR SHEATHING:**
 FLOOR SHEATHING SHALL BE 1 1/8" TONGUE AND GROOVE (T&G) APA RATED PLYWOOD, GLUED AND SCREWED TO FLOOR JOISTS.
 ADHESIVES SHALL CONFORM TO APA SPECIFICATION AF&S-01. PROVIDE T&G EDGES ON LONG PANEL EDGES. SCREWS SHALL BE XXX AT 6" ON CENTER AT PANEL EDGES AND 10" ON CENTER AT INTERMEDIATE SUPPORTS.
 PLYWOOD SHALL BE LAID WITH FACE GRAIN PERPENDICULAR TO SUPPORTS AND END JOINTS SHALL BE STAGGERED 4'-0".

NOTE:
 ALL FLOOR FRAMING SHALL BE 14" DEEP FLOOR TRUSSES AT 16" OC TYPICAL UNLESS NOTED OTHERWISE W/ 1 1/8" T&G PLYWOOD SHEATHING AND 1 1/2" GYPCRETE
 TO GYPCRETE EL. = 35.14'
 TO SHEATHING EL. = 35.01'

REVISED
 MAY 21, 2019. ADDED DRAFTSTOPS AS REQD.


The Valentin Residence

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

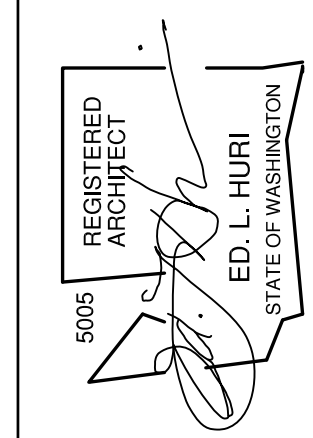

val 17-01
 E.L.H.
 FEB. 11, 2019

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 7, 2019
 FEB. 9, 2019
 MAY 27, 2019

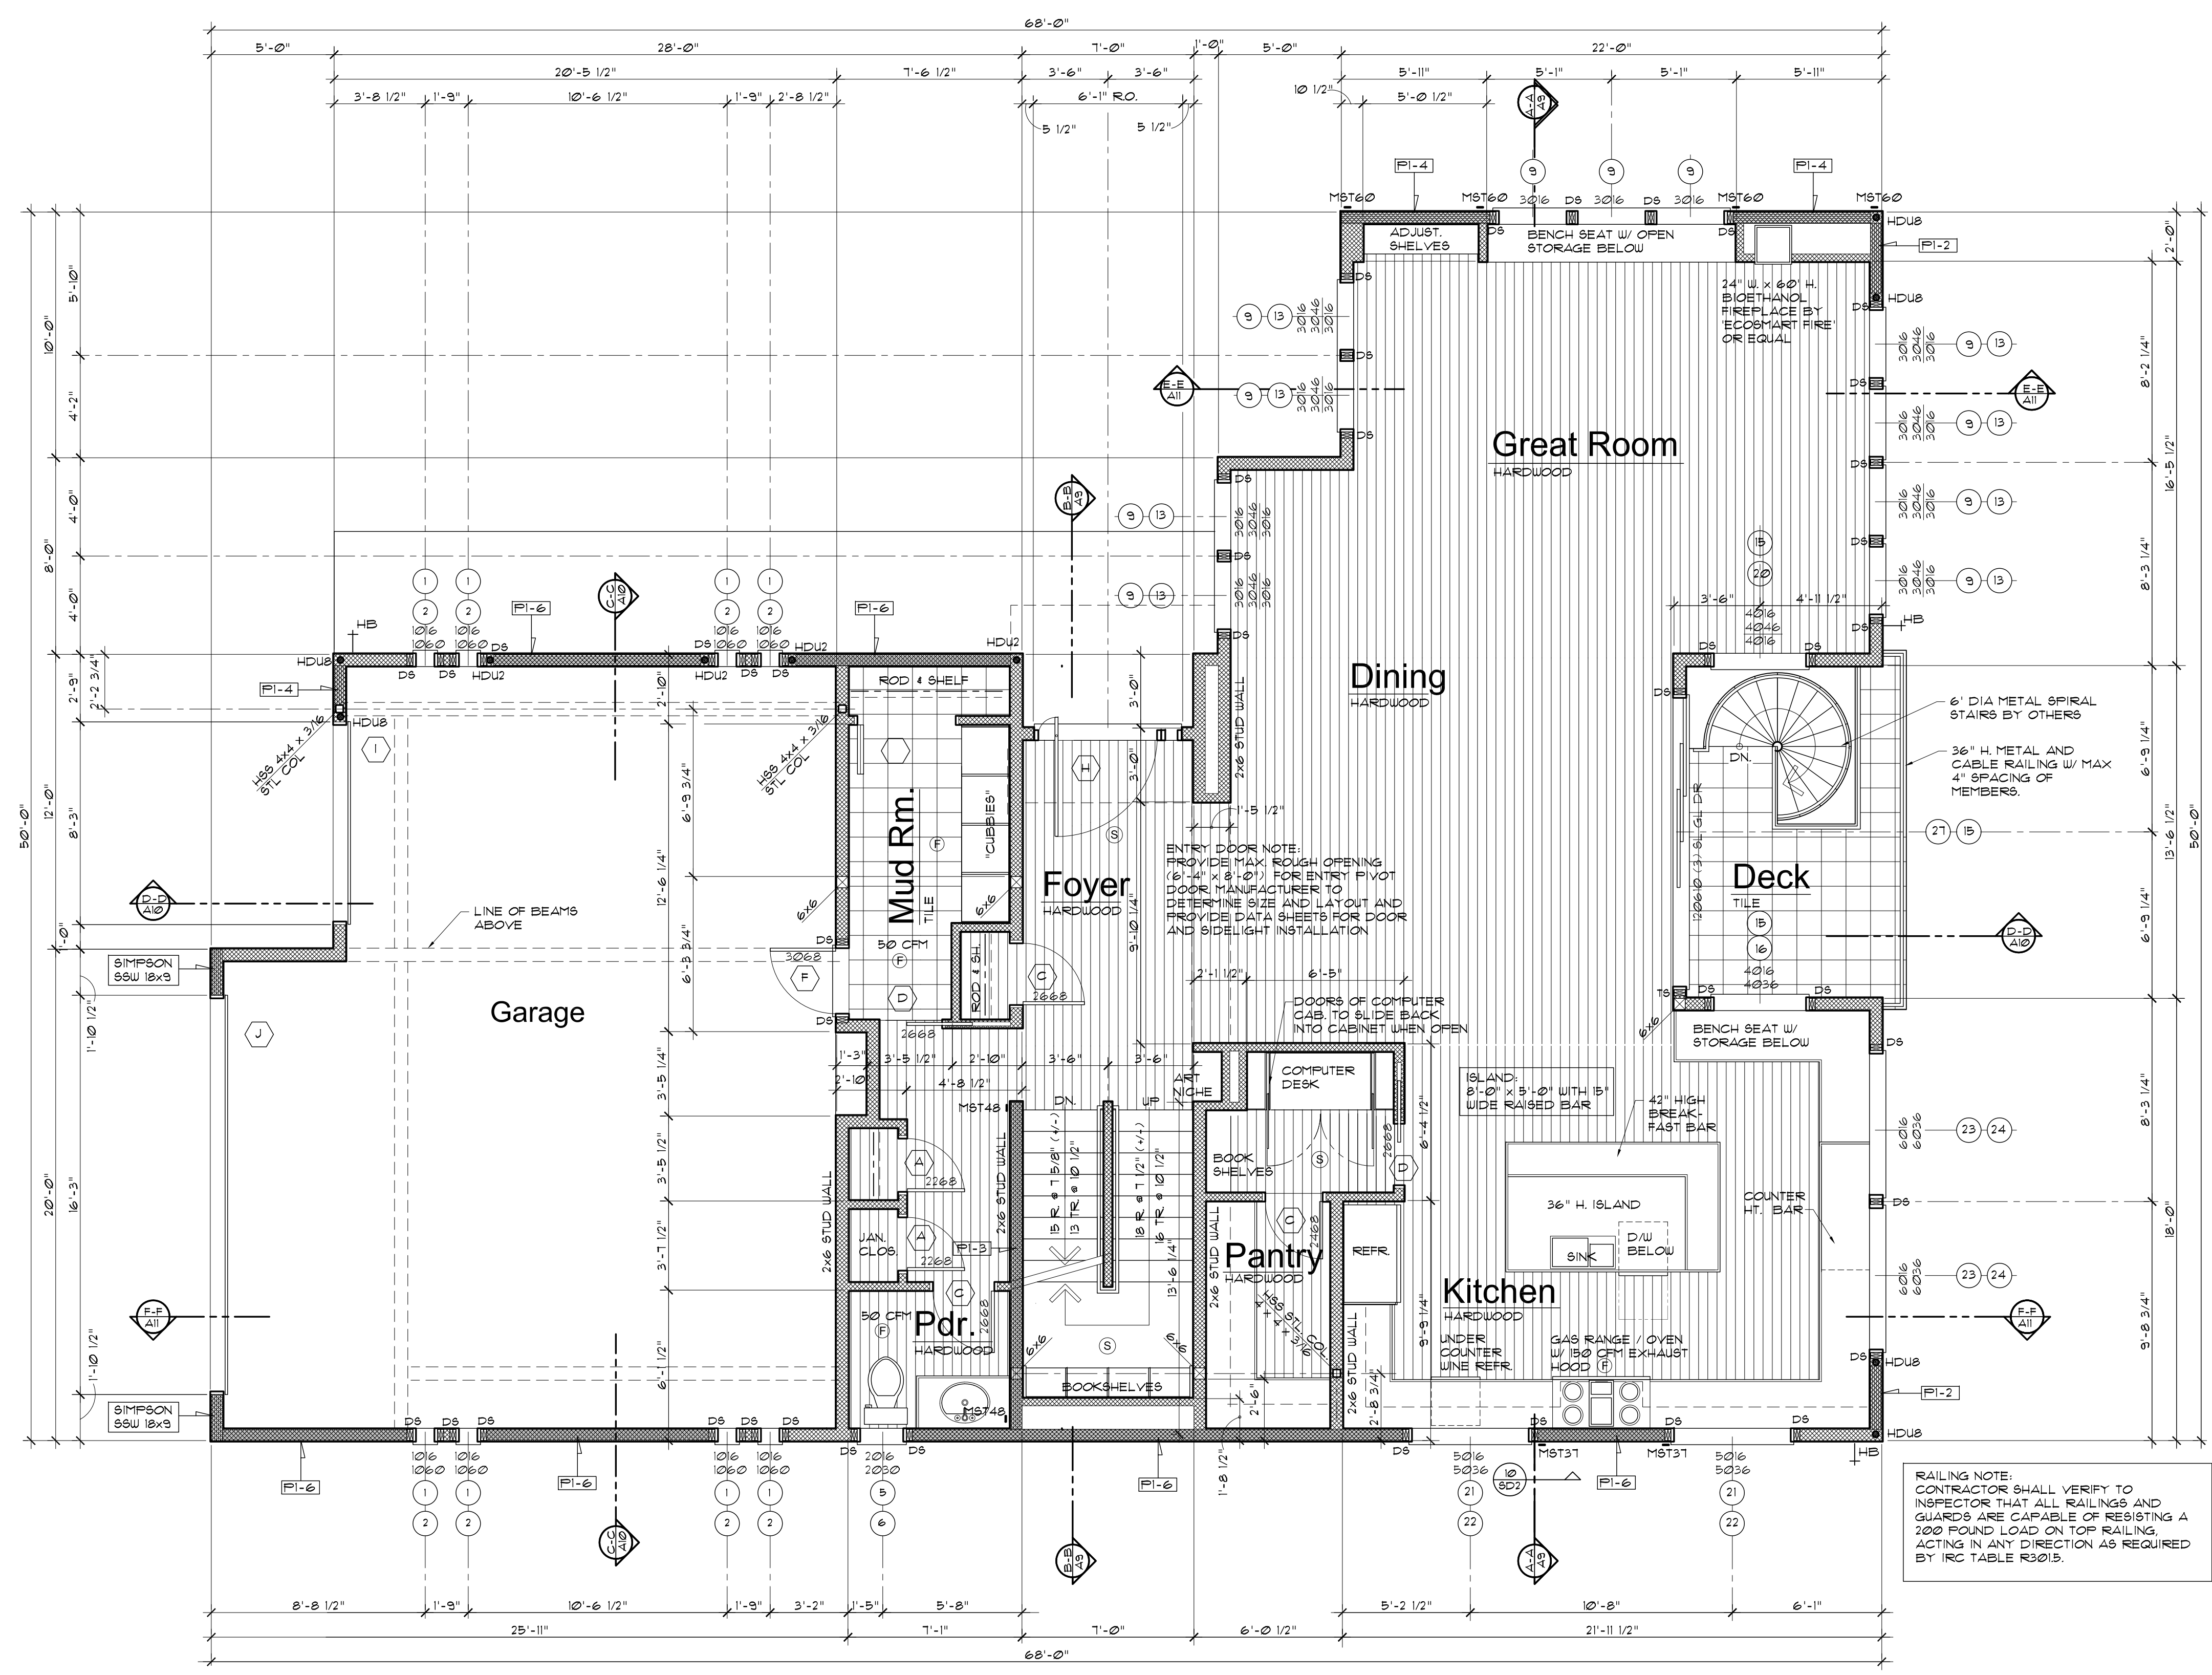

Shearwall Schedule:

SHEAR WALL TYPE	NAIL SIZE	EDGES	FIELD	TOP PLATE NAIL G.	TOP FL. LTP4 SPACING	BLOCK'G REQ'D.	PLATE ANCHORS	MIN. PLATE SIZE	SOLE PLATE NAILING	HEM-FIR #2 #/FT.	DOUG-FIR #2 #/FT.
FI-6	10d	6"	12"	N/A	24"	Yes	5/8" dia @ 32" O.C.	2x	(2) 16d @ 10" O.C.	279	310
FI-5	10d	5"	12"	N/A	18"	Yes	5/8" dia @ 32" O.C.	2x	(2) 16d @ 8" O.C.	348	350
FI-4	10d	4"	12"	N/A	16"	Yes	5/8" dia @ 24" O.C.	3x	(2) 16d @ 7" O.C.	418	460
FI-3	10d	3"	12"	N/A	12"	Yes	5/8" dia @ 24" O.C.	3x	(2) 16d @ 5" O.C.	545	600
FI-2	10d	2"	12"	N/A	8"	Yes	5/8" dia @ 16" O.C.	3x	(3) 16d @ 5" O.C.	713	770
FI-6	10d	6"	12"	N/A	12"	Yes	5/8" dia @ 16" O.C.	3x	(2) 16d @ 5" O.C.	558	620
FI-4	10d	4"	12"	N/A	8"	Yes	5/8" dia @ 16" O.C.	3x	(3) 16d @ 5" O.C.	836	920
FI-3	10d	3"	12"	N/A	6"	Yes	5/8" dia @ 12" O.C.	3x	(4) 16d @ 5" O.C.	1030	1200
FI-2	10d	2"	12"	N/A	4"	Yes	5/8" dia @ 12" O.C.	3x	(4) 16d @ 4" O.C.	1426	1540

NOTE:
 FOR ALL SHEARWALL PANELS WITH EDGE NAILING OF 4" O.C. OR LESS (FI-4 OR BELOW), 3x STUDS ARE REQUIRED WHERE JOINT BETWEEN TWO ADJACENT PANELS FALL ON AN INDIVIDUAL STUD.

Shearwall Schedule Notes:

- G1 - GYPSUM WALLBOARD ONE SIDE
 G2 - GYPSUM WALLBOARD TWO SIDES
 FI - 1/2" PLYWOOD OR A.P.A. RATED SHEATHING ONE SIDE
 F2 - 1/2" PLYWOOD OR A.P.A. RATED SHEATHING TWO SIDES
- WHEN ALLOWABLE SHEAR WALL VALUES EXCEED 350 pif, 3x MINIMUM STUDS REQUIRED AT ADJOINING PANEL EDGES
- NAILS SHALL BE 10d COMMON, UNLESS NOTED OTHERWISE
- WHERE PLYWOOD IS TWO SIDES OF WALL, PANEL EDGES SHALL FALL ON SEPARATE STUDS EACH SIDE
- ALL PANEL EDGES SHALL BE BACKED WITH 2" NOMINAL OR WIDER FRAMING UNLESS NOTED OTHERWISE. INSTALL PANELS EITHER HORIZONTALLY OR VERTICALLY FOR PLYWOOD OR A.P.A. RATED SHEATHING. GYPSUM SHEAR WALLS SHALL BE INSTALLED WITH PANELS RUNNING HORIZONTALLY. SPACE NAILS AT 12" ON CENTER AT INTERMEDIATE SUPPORTS.
- TYPICAL EXTERIOR WALL SHALL BE 1/2" PLYWOOD OR 15/32" A.P.A. RATED SHEATHING (UNLESS NOTED OTHERWISE) WITH NAILS SPACED AT 6" ON CENTER AT PANEL EDGES AND 12" ON CENTER IN FIELD. BLOCK ALL PANEL EDGES.
- TYPICAL INTERIOR WALL SHALL BE 1/2" GYPSUM WALLBOARD UNLESS NOTED OTHERWISE. NAIL WITH 5d COOLER NAILS AT 11" ON CENTER ALL STUDS AND PLATES. BLOCK ALL PANEL EDGES.

ROOF AND FLOOR SHEATHING:
 ROOF SHEATHING SHALL BE 15/32" A.P.A. RATED PLYWOOD OR AS NOTED ON PLANS. NAILING SHALL BE 8d COMMON NAILS AT 6" ON CENTER AT PANEL EDGES AND 12" ON CENTER AT INTERMEDIATE SUPPORTS.
 FLOOR SHEATHING SHALL BE 1 1/8" A.P.A. RATED PLYWOOD SCREWED AND GLUED TO SUPPORTS. ADHESIVES SHALL CONFORM TO A.P.A. SPECIFICATION 487.01. PROVIDE TONGUE AND GROOVE EDGES AT LONG PANEL EDGES. SCREWS SHALL BE AT 6" ON CENTER AT PANEL EDGES AND 10" ON CENTER AT INTERMEDIATE SUPPORTS. PLYWOOD SHALL BE LAID WITH FACE GRAIN PERPENDICULAR TO SUPPORTS AND END JOIST STAGGERED 4'-0".

HOLDDOWNS:
 PROVIDE HOLDDOWNS TO FOUNDATION AT END OF WALLS WHERE SHOWN ON PLANS.

Window Notes:

SEE WINDOW SCHEDULE, SHEET A-3.

WINDOWS SHOWN ARE 'GENERIC' SIZES ONCE A MANUFACTURER IS CHOSEN, SAID MANUFACTURER SHALL SUPPLY A MODIFIED WINDOW SCHEDULE TO THE OWNER AND ARCHITECT FOR APPROVAL PRIOR TO PLACING WINDOW ORDER.

CONTRACTOR OR WINDOW SUPPLIER / MANUFACTURER SHALL VERIFY ALL ROUGH OPENINGS PRIOR TO ORDERING WINDOWS.

EVERY SLEEPING ROOM SHALL HAVE AT LEAST ONE OPERABLE DOOR OR WINDOW APPROVED FOR EMERGENCY EGRESS. EGRESS WINDOWS ARE NOTED ON EXTERIOR ELEVATIONS.

EGRESS WINDOWS SHALL HAVE A MINIMUM NET CLEAR OPENING AREA OF NOT LESS THAN 5.7 SQ. FT. THE MINIMUM OPENABLE HEIGHT SHALL BE 20". THE OPENABLE HEIGHT X THE OPENABLE WIDTH SHALL NOT BE LESS THAN 5.7 SQ. FEET.

SAFETY GLAZING IS REQUIRED FOR ALL INTERIOR AND EXTERIOR GLASS SUBJECT TO HUMAN IMPACT. WINDOW SUPPLIER / MANUFACTURER TO VERIFY THOSE WINDOWS REQUIRING SAFETY GLAZING.

EACH PANE OF SAFETY GLASS MUST BE IDENTIFIED BY A PERMANENT LABEL THAT INDICATES THE MANUFACTURER OR INSTALLER. WHEN TEMPERED GLASS IS USED AS SAFETY GLAZING, THE IDENTIFICATION SHALL BE ETCHED OR CERAMIC FIRED AND THE MARKING MUST REMAIN VISIBLE WHEN THE UNIT OF GLASS IS INSTALLED.

ARTIFICIAL LIGHTING PER IRC R302.1, EXCEPTION 2 SHALL BE INSTALLED IN ANY HABITABLE ROOM WITH AGGREGATE GLAZING OF LESS THAN 8% OF FLOOR AREA.

Main Floor Plan 1,661 sf

1/4" = 1'-0" T.O. SHEATHING EL. = 35.01' / T.O. GYPCRETE EL. = 35.14'
 GARAGE = 160 SF DECK + 110 SF ADDITIONAL

- Legend:**
- DENOTES SIMPSON HOLD DOWN AS NOTED
 - DENOTES SIMPSON STRAP (VERT.) AS NOTED
 - SW-# DENOTES SHEAR WALL PANEL NO. (SEE SCHEDULE)
 - DENOTES STUD WALL FRAMING
 - DENOTES SHEAR PANEL
 - F EXHAUST FAN (SEE SIZING NOTES)
 - SDV 110V SMOKE DETECTOR W/ BATTERY BACK UP.
 - C CARBON MONOXIDE DETECTOR
 - 101-# DENOTES FLR. ELEV. (T.O. SLAB/ T.O. 9TH'G.)
 - DS DOWN SPOUT
 - HB HOSE BIBB
 - DS DOUBLE STUD
 - TS TRIPLE STUD

General Notes:

ALL EXTERIOR WALLS OR WALLS BETWEEN HEATED AND UNHEATED SPACES SHALL BE 2 x 6 STUDS @ 16" O.C. TYPICAL UNLESS NOTED OTHERWISE (UNO.) WITH 6 x 10 HEADERS AT ALL OPENINGS IN BEARING WALLS UNO. (SEE FRAMING PLANS).

ALL INTERIOR WALLS SHALL BE 2 x 4 STUDS @ 16" O.C. TYP. UNO. WITH 4 x 10 HEADERS (BEARING WALLS) UNO.

ALL DIMENSIONS SHOWN ARE TO FACE OF FRAMING UNO.

BUILDING OFFSET DIMENSIONS: F.O. FRAMING = F.O. CONCRETE AT FOUNDATION WALLS TYP. UNO.

PLATE HEIGHT THIS FLOOR = 10' - 1 1/2" TYP. FROM SHEATHING, TYP. UNLESS NOTED OTHERWISE.

SOLID BLOCK ALL SUPPORTS AND FIRE BLOCK ALL PLUMBING PENETRATIONS AND LOCATIONS REQUIRED BY R302.11 PROVIDE FIRE BLOCKING TO ALL CONCEALED DRAFT OPENINGS TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN FLOORS.

SEE FLOOR FRAMING PLANS FOR HEADER NOTATIONS AND ALL COLUMN / BEAM SIZES AND LOCATIONS.

ALL HOLD DOWNS ARE TO BE SIMPSON (TYPE AND SIZE AS NOTED ON PLANS AND SHEAR WALL SCHEDULE). SEE FLOOR, FOUNDATION, AND FRAMING PLANS FOR LOCATION AND TYPE OF ALL SHEAR WALL PANEL TYPE AND ANCHOR BOLT SPACING AT PANELS. ALL STRAP TIE DOWNS SHALL HAVE A MINIMUM 1 1/2" EDGE COVER. PROVIDE TRIPLE 2x STUDS AS REQUIRED FOR PROPER PLACEMENT.

Typical Construction

ROOF:	FLOORS:
STANDING SEAM METAL ROOF	FRAMED FLOORS:
1/2" PLYWOOD SHEATHING	FINISH FLOOR VARIES (SEE FLOOR PLANS)
SHED ROOF TRUSSES (SPACING PER PLAN)	1 1/2" GYPCRETE W/ RADIANT HEATING
OR	1 1/8" T & G PLYWOOD SHEATHING
EPPM ROOF MEMBRANE FULLY ADHERED.	14" DEEP FLOOR TRUSSES @ 16" O.C.
HUNTER TAPERED PANELS (MIN. 1/4" FT)	MIN. R-38 BATT INSULATION (AS REQUIRED)
1/2" PLYWOOD SHEATHING	1/2" GYPCRETE WALLBOARD (GWB) @ CEILING.
14" DEEP FLAT TRUSSES @ 16" O.C.	
MIN. R-49 BATT OR BLOW-IN INSULATION	GARAGE FLOOR:
5/8" GYPCRETE WALLBOARD (GWB.)	LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
	16" DEEP STEEL BEAMS
	R-38 BATT INSULATION
	5/8" TYPE 'X' GYPCRETE WALLBOARD
	LOWER FLOOR SLAB:
	6" CONC. SLAB W/ RADIANT HEAT AND #4 BARS EA. WAY @ 24" O.C.
	12" TYPE 'C' OR EQUAL BUILDING WRAP
	1" CDX PLYWOOD SHEATHING
	2 x 6 STUDS @ 16" O.C.
	MIN. R-21 BATT INSULATION
	1/2" GYPCRETE WALL BOARD (GWB.)

REVISED

The Valentin Residence

Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com


5005 REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON

VAL 17-01
 E.L.H.
 FEB. 11, 2019

A-5

OF

PRINTINGS
 DEC. 20, 2018
 DEC. 28, 2018
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

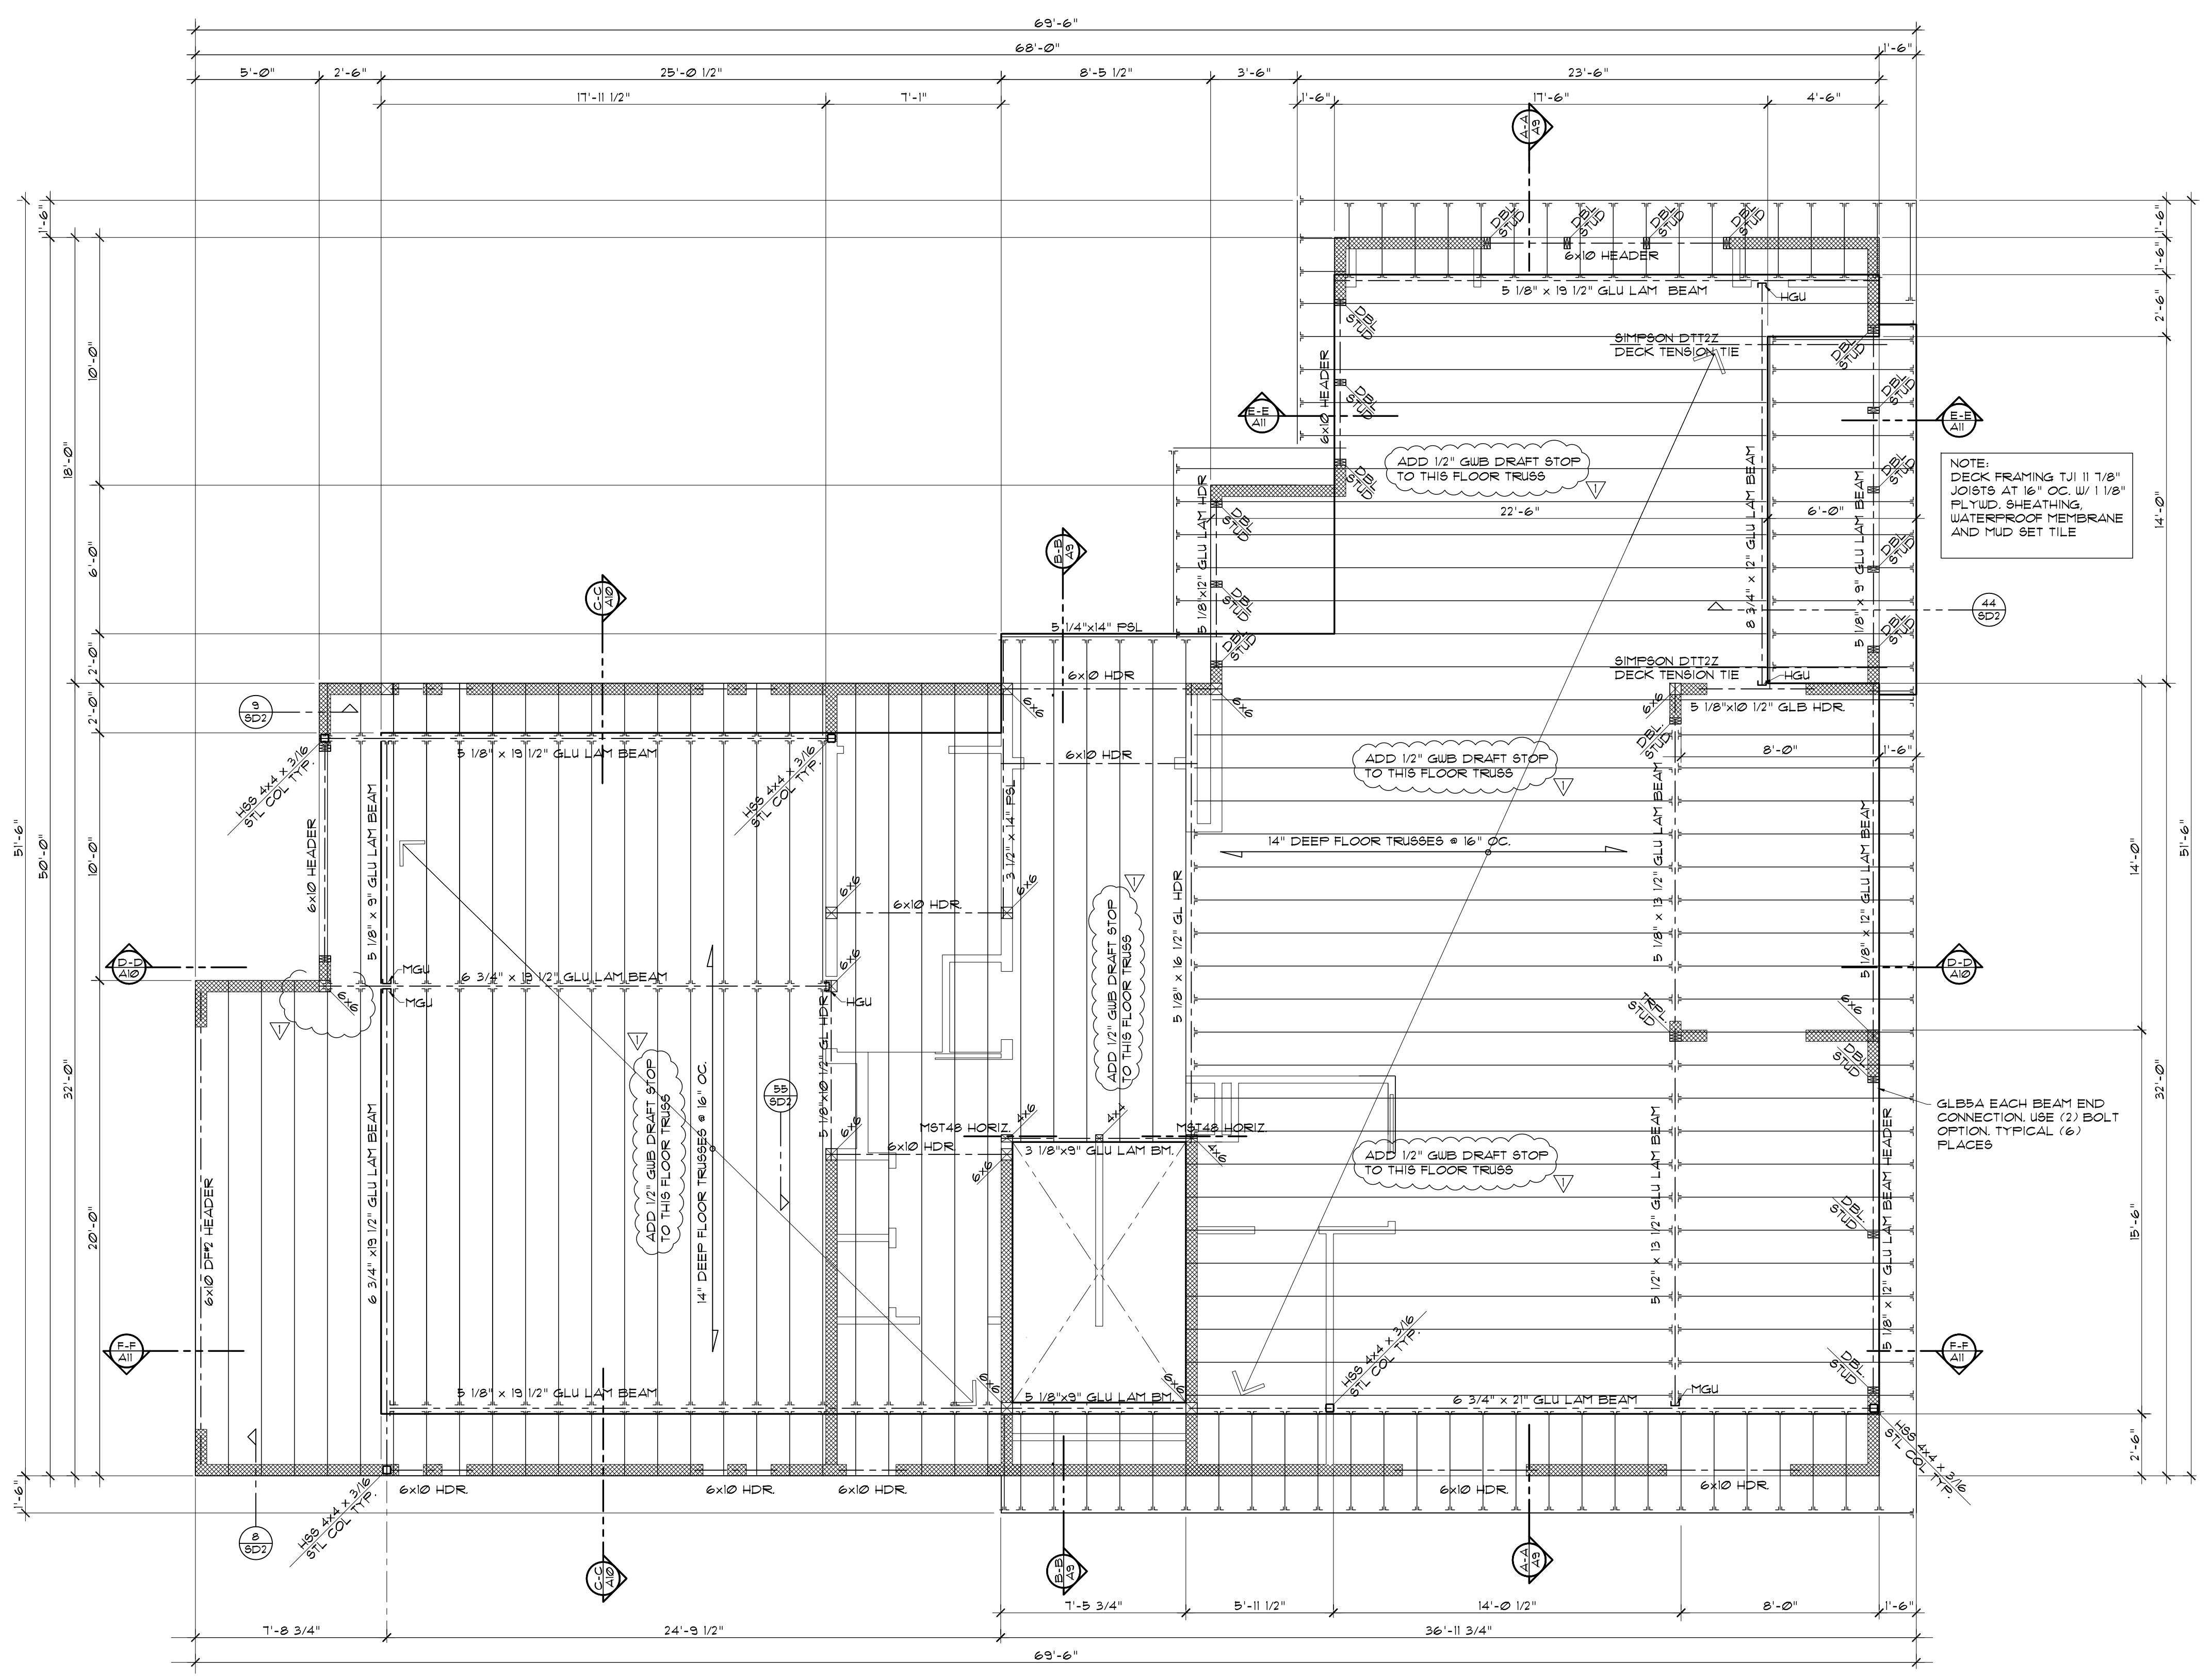

Upper Floor Framing Plan

North
 1/4" = 1'-0"
 T.O. SHEATHING EL. = 35.01' / T.O. GYPCRETE EL. = 35.14'

NOTE:
 ALL FLOOR FRAMING SHALL BE 14" DEEP FLOOR TRUSSES AT 16" OC. TYPICAL UNLESS NOTED OTHERWISE W/ 1 1/8" T&G PLYWOOD SHEATHING AND 1 1/2" GYPCRETE W/ RADIANT HEAT

Framing Notes:

GENERAL:
 THE ENDS OF EACH JOIST, BEAM OR GIRDER SHALL HAVE NOT LESS THAN 1 1/2" OF BEARING ON WOOD OR METAL AND NOT LESS THAN 3" ON CONCRETE OR MASONRY.
 JOIST FRAMING FROM OPPOSITE SIDES OVER A BEARING SUPPORT SHALL LAP A MINIMUM OF 3' AND SHALL BE NAILED TOGETHER WITH A MINIMUM OF THREE (3) 10d FACE NAILS.
 JOIST FRAMING TO THE SIDE OF A BEAM OR GIRDER SHALL BE SUPPORTED BY SIMPSON LUS HANGERS, BEAM / COLUMN USE CCG TYPE HANGERS, BEAM / BEAM USE SIMPSON HUCQ TYPE UNLESS NOTED OTHERWISE (UNO).
 JOISTS SHALL BE SUPPORTED Laterally at the ends by full depth solid blocking not less than 2" nominal thickness or by attachment to a header, rim joist or to an adjoining stud; or shall otherwise provided with lateral support to prevent rotation.

FRAMING LUMBER:
 PROVIDE S4S, S-DRY, ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE PRESERVATIVE TREATED.
 NAIL IN ACCORDANCE WITH IBC TABLE 23-04.9.1 OR AS INDICATED ON THE DRAWINGS.
 USE FULL HEIGHT STUDS AND USE MULTIPLE STUDS TO ACHIEVE FULL BEARING UNDER BEAM ENDS OR POSTS IN WALL UNLESS NOTED OTHERWISE ON DRAWINGS.
BEAMS:
 A1C COMBINATION 24F-V4 FOR SINGLE SPANS AND 24F-V8 FOR CONTINUOUS MULTIPLE SPANS; MANUFACTURER'S STANDARD CAMBER.

LAMINATED VENEER LUMBER (LVL):
 WEYERHAEUSER MICRO-LAM OR APPROVED ALTERNATE PRODUCTS SHALL BE PROVEN BY TESTING AS DEMONSTRATED BY ICBO OR NER ACCEPTANCE.
PARALLEL STRAND LUMBER (PSL):
 WEYERHAEUSER PARALLAM OR APPROVED ALTERNATE PRODUCTS SHALL BE PROVEN BY TESTING AS DEMONSTRATED BY ICBO OR NER ACCEPTANCE.
PLYWOOD WEB JOISTS:
 WEYERHAEUSER AS INDICATED ON THE DRAWINGS OR AN APPROVED ALTERNATE PLYWOOD WEB JOISTS SHALL BE MANUFACTURED WITH APA STRUCTURAL PLYWOOD, MACHINE STRESS RATED OR MICRO-LAM LUMBER FLANGES AND WATERPROOF GLUES.

METAL PLATE WOOD TRUSSES:
 TRUSSES SHALL BE DESIGNED AND FACTORY MANUFACTURED IN CONFORMANCE WITH TPI-85. METAL PLATE CONNECTORS SHALL BE ICC APPROVED. TOP CHORDS SHALL BE DOUGLAS FIR - LARCH.
 TRUSS MANUFACTURER SHALL PROVIDE DRAWINGS AND CALCULATIONS, INCLUDING PLACING PLANS AND STRESS DIAGRAMS, FOR REVIEW BY THE ENGINEER PRIOR TO FABRICATION.
SHEARWALLS:
 SEE 'SHEARWALL NOTES' AND SCHEDULE.
 SHEARWALLS WITH NAIL SPACING OF 4" OC. OR TIGHTER SHALL BE FRAMED WITH 3x STUDS AND PLATES.

FLOOR SHEATHING:
 FLOOR SHEATHING SHALL BE 1 1/8" TONGUE AND GROOVE (T&G) A.F.A. RATED PLYWOOD, GLUED AND SCREWED TO FLOOR JOISTS.
 ADHESIVES SHALL CONFORM TO A.F.A. SPECIFICATION AFG-01. PROVIDE T&G EDGES ON LONG PANEL EDGES. SCREWS SHALL BE XXX AT 6" ON CENTER AT PANEL EDGES AND 10" ON CENTER AT INTERMEDIATE SUPPORTS.
 PLYWOOD SHALL BE LAID WITH FACE GRAIN PERPENDICULAR TO SUPPORTS AND END JOINTS SHALL BE STAGGERED 4'-0".

REVISED
 MAY 21, 2019. ADDED DRAFTSTOPS AS REQ'D.

The Valentin Residence

Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150/Mercer Island, Washington 98040


Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA, 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

5005 REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON

val 11-01
 E.L.H.
 FEB. 11, 2019

A-6
 OF

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 7, 2019
 FEB. 9, 2019
 MAY 21, 2019

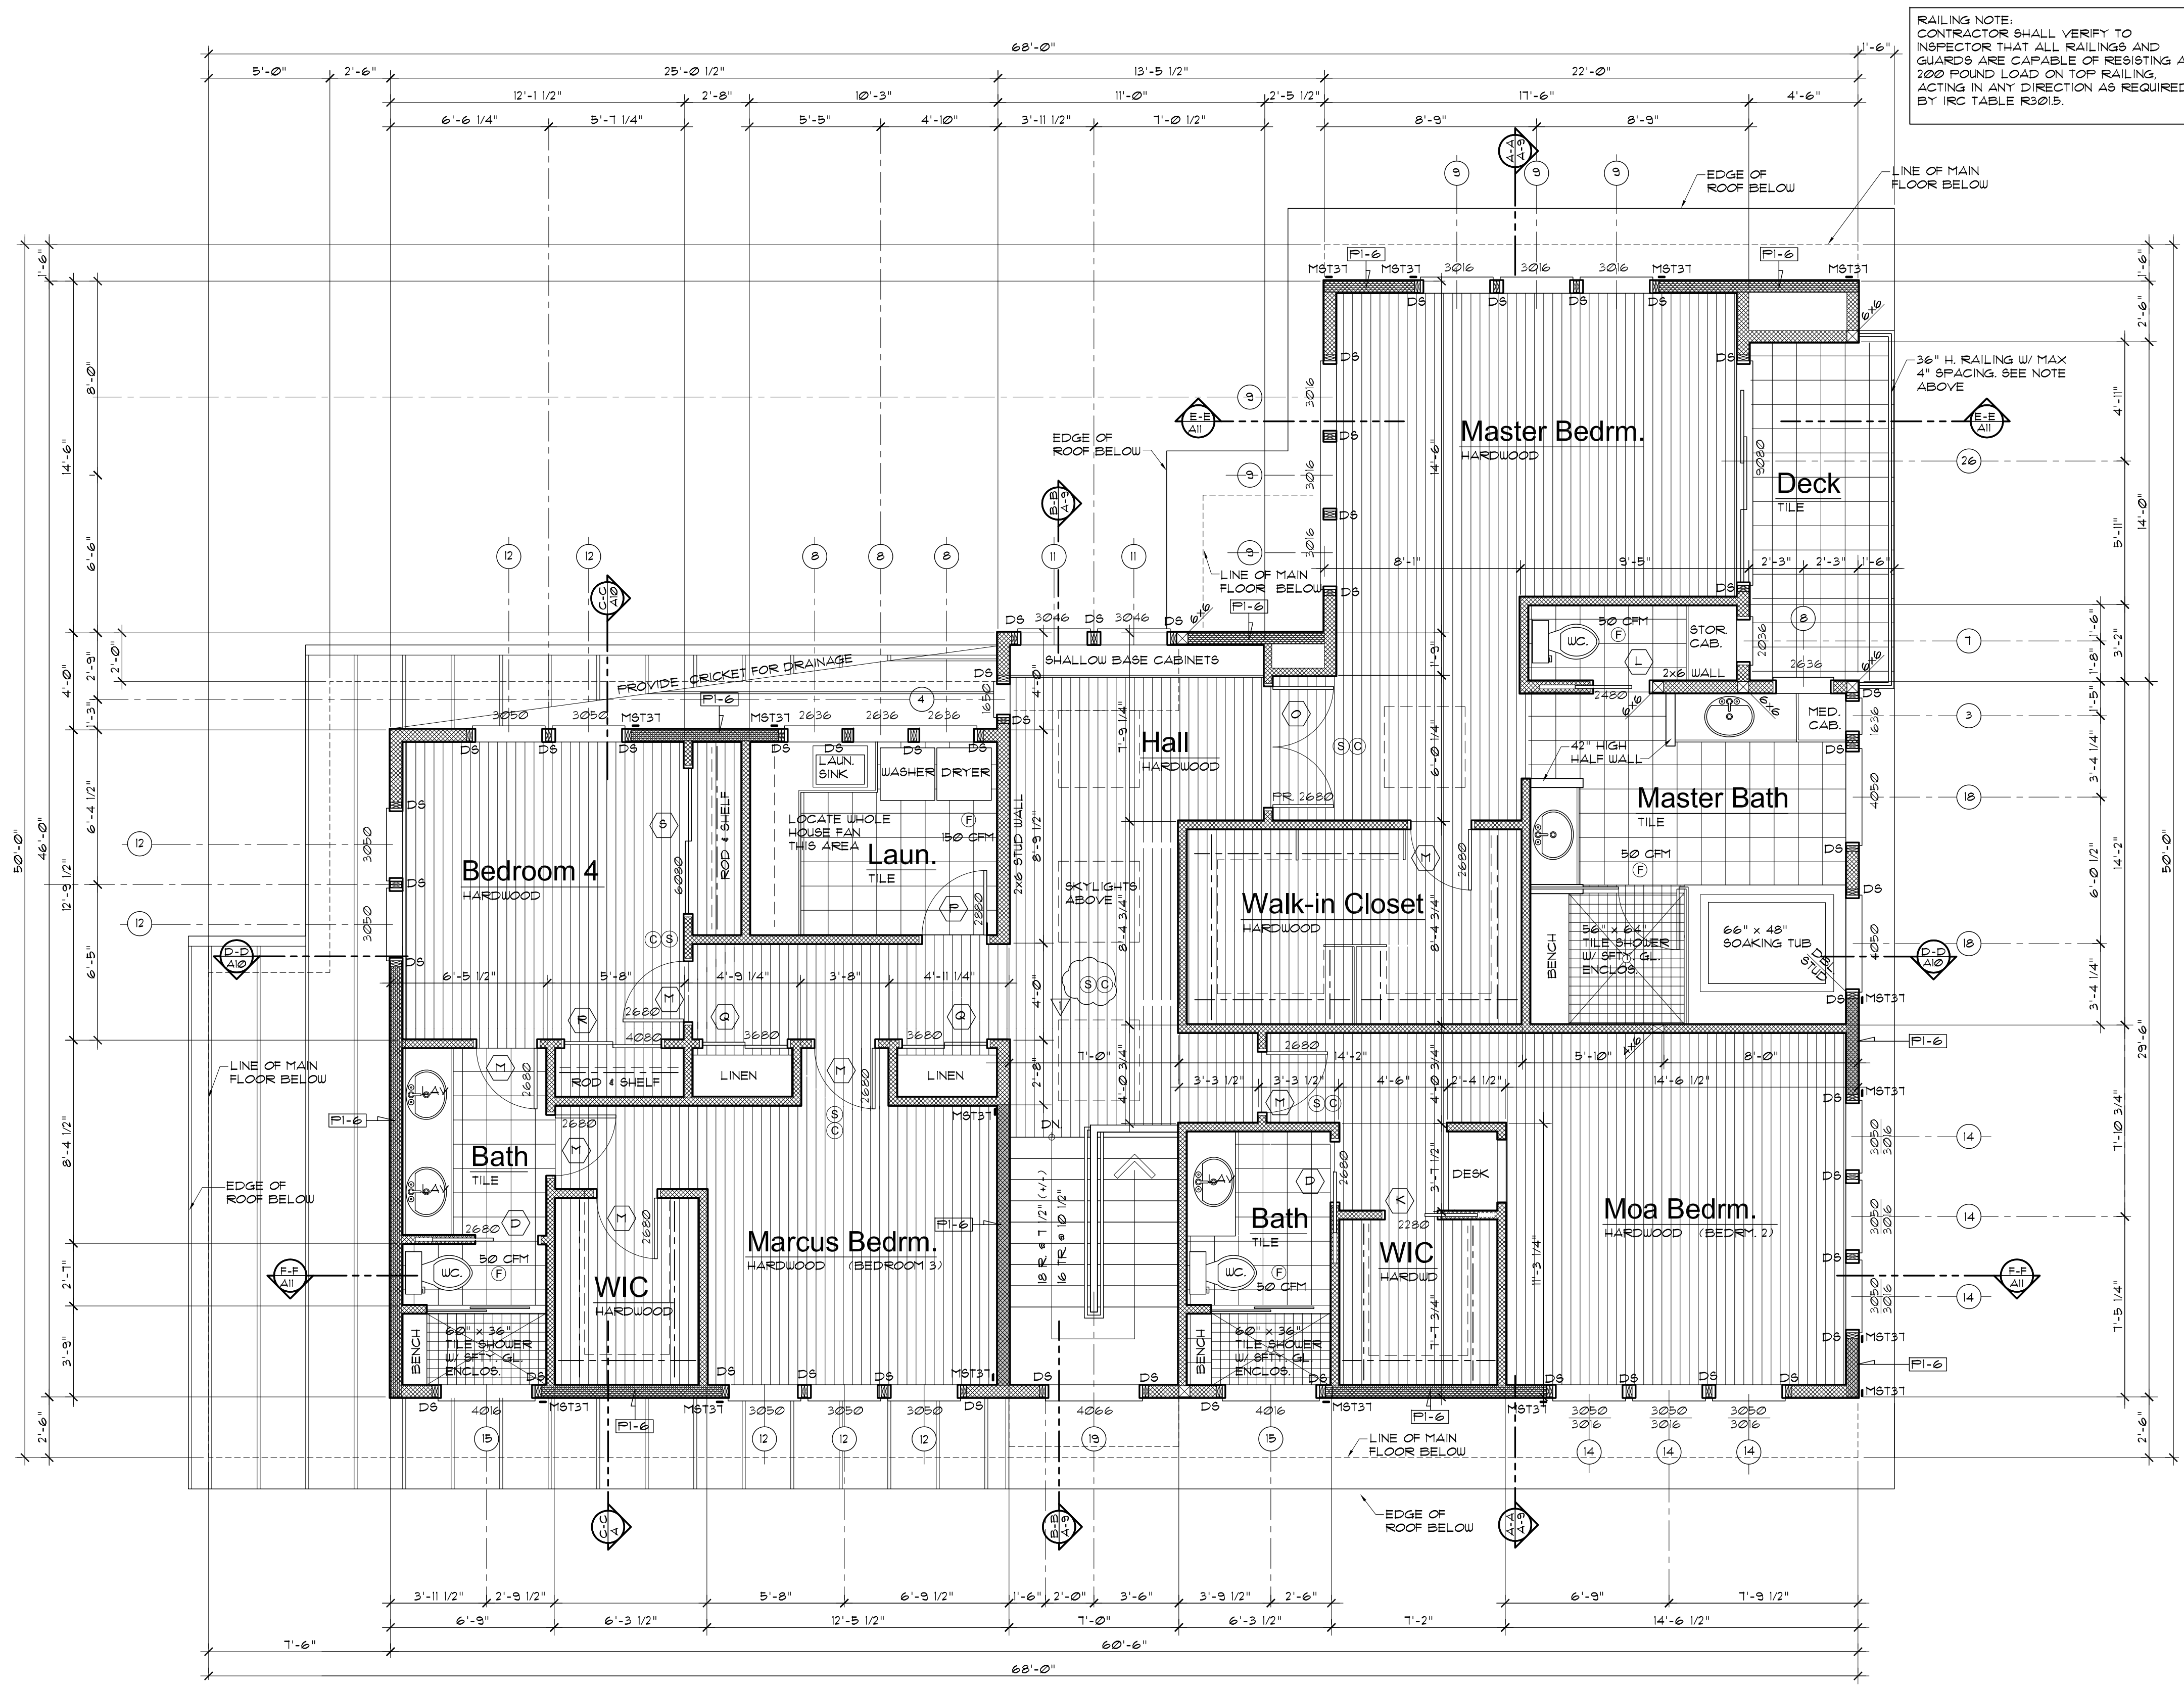

Whole House Ventilation System:

WHOLE HOUSE MECHANICAL VENTILATION SYSTEM SHALL BE DESIGNED IN ACCORDANCE WITH SECTIONS M1501.3.1 THROUGH M1501.3.3.

INTEGRATED WHOLE-HOUSE VENTILATION SYSTEM SHALL PROVIDE OUTDOOR AIR AT THE RATE CALCULATED USING SECTION M1501.3.3. INTEGRATED FORCED AIR VENTILATION SYSTEMS SHALL DISTRIBUTE OUTDOOR AIR TO EACH HABITABLE SPACE THROUGH THE FORCED AIR SYSTEM DUCTS. INTEGRATED FORCED AIR VENTILATION SYSTEM SHALL HAVE AN OUTDOOR INLET DUCT CONNECTING A TERMINAL ELEMENT ON THE OUTSIDE OF THE BUILDING TO THE RETURN AIR FLEXUM OF THE FORCED AIR SYSTEM. THE OUTDOOR AIR INLET CONNECTION TO THE RETURN AIR STREAM SHALL BE LOCATED UPSTREAM OF THE FORCED AIR SYSTEM BLOWER AND SHALL NOT CONNECT DIRECTLY INTO THE FURNACE CABINET TO PREVENT SHOCK TO THE HEAT EXCHANGER. THE SYSTEM SHALL BE EQUIPPED WITH A MOTORIZED DAMPER CONNECTED TO THE AUTOMATIC VENTILATION CONTROL AS SPECIFIED IN SECTION M1501.3.2. THE REQUIRED FLOW RATE SHALL BE VERIFIED BY FIELD TESTING WITH A FLOW HOOD OR A FLOW MEASURING STATION.

TABLE M1501.3.3(1)
 CONT. WHOLE HOUSE MECH. VENT. SYSTEM AIR FLOW REQMTS

DUELLING UNIT FLOOR AREA (< 60 FT.)	NUMBER OF BEDROOMS				
	0-1	2-3	4-5	6-7	>7
< 1500	30	45	60	75	90
1501-3000	45	60	75	90	105
3001-4500	60	75	90	105	120
4501-6000	75	90	105	120	135
6001-7500	90	105	120	135	150
>7500	105	120	135	150	165

Source Specific Exhaust Ventilation:

REQUIRED IN EACH KITCHEN, BATHROOM, WATER CLOSET COMPLET, LAUNDRY ROOM AND OTHER ROOMS WHERE WATER VAPOR OR COOKING ODOR IS PRODUCED.

MINIMUM SOURCE SPECIFIC VENTILATION REQUIREMENTS

	BATH/TOILET ROOMS	KITCHENS
INTERMITTENT OPERATION	50 CFM	100 CFM
CONTINUOUS OPERATION	20 CFM	25 CFM

Typical Construction

ROOF:
 STANDING SEAM METAL ROOF
 1/2" PLYWOOD SHEATHING
 SHED ROOF TRUSSES (SPACING PER PLAN)
 OR
 EPDM ROOF MEMBRANE, FULLY ADHERED, HANTER TAPERED PANELS (MIN. 1/4" / FT)
 1/2" PLYWOOD SHEATHING
 14" DEEP FLAT TRUSSES @ 16" OC
 MIN. R-49 BATT OR BLOW-IN INSULATION
 5/8" GYPSUM WALLBOARD (GWB.)

WALLS:
 'HARDIE-PANEL' OR EQUAL SIDING
 VERTICAL METAL SIDING
 STONE VENEER
 'TYVEC' OR EQUAL BUILDING WRAP
 1/2" CDX PLYWOOD SHEATHING
 2 x 6 STUDS @ 16" OC
 MIN. R-21 BATT INSULATION
 1/2" GYPSUM WALL BOARD (GWB.)

FLOORS:
 FRAMED FLOORS:
 FINISH FLOOR VARIES (SEE FLOOR PLANS)
 1 1/2" GYPCRETE W/ RADIANT HEATING
 1 1/8" T & G PLYWOOD SHEATHING
 14" DEEP FLOOR TRUSSES @ 16" OC
 MIN. R-38 BATT INSULATION (AS REQUIRED)
 1/2" GYPSUM WALLBOARD (GWB.) @ CEILINGS.

GARAGE FLOOR:
 LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
 TOP HUNG METAL TRUSSES @ 16" OC
 16" DEEP STEEL BEAMS
 R-38 BATT INSULATION
 5/8" TYPE 'X' GYPSUM WALLBOARD

LOWER FLOOR SLAB:
 6" CONC. SLAB W/ RADIANT HEAT AND #4 BARS EA. WAY @ 24" OC
 R-10 RIGID INSULATION
 MIN. 6" MIL. VAPOR BARRIER
 MIN. 6" COMPACTED GRAVEL BASE

Shearwall Schedule Notes:

- G1 - GYPSUM WALLBOARD ONE SIDE
 G2 - GYPSUM WALLBOARD TWO SIDES
 P1 - 1/2" PLYWOOD OR A.P.A. RATED SHEATHING ONE SIDE
 P2 - 1/2" PLYWOOD OR A.P.A. RATED SHEATHING TWO SIDES
- WHEN ALLOWABLE SHEAR WALL VALUES EXCEED 350 pif, 3x MINIMUM STUDS REQUIRED AT ADJOINING PANEL EDGES (i.e. P1-4 DESIGNATION OR BELOW).
- NAILS SHALL BE 10d COMMON, UNLESS NOTED OTHERWISE.
- WHERE PLYWOOD IS TWO SIDES OF WALL, PANEL EDGES SHALL FALL ON SEPARATE STUDS EACH SIDE.
- ALL PANEL EDGES SHALL BE BACKED WITH 2" NOMINAL OR WIDER FRAMING UNLESS NOTED OTHERWISE. INSTALL PANELS EITHER HORIZONTALLY OR VERTICALLY FOR PLYWOOD OR A.P.A. RATED SHEATHING. GYPSUM SHEAR WALLS SHALL BE INSTALLED WITH PANELS RUNNING HORIZONTALLY. SPACE NAILS AT 12" ON CENTER AT INTERMEDIATE SUPPORTS.
- TYPICAL EXTERIOR WALL SHALL BE 1/2" GYPSUM WALLBOARD UNLESS NOTED OTHERWISE. NAIL WITH 5d COOLER NAILS AT 12" ON CENTER AT PANEL EDGES AND 12" ON CENTER IN FIELD. BLOCK ALL PANEL EDGES.
- TYPICAL INTERIOR WALL SHALL BE 1/2" GYPSUM WALLBOARD UNLESS NOTED OTHERWISE. NAIL WITH 5d COOLER NAILS AT 12" ON CENTER AT STUDS AND PLATES. BLOCK ALL PANEL EDGES.
- OR-
- 5/8" GYPSUM WALLBOARD. NAIL WITH 6d COOLER NAILS AT 12" ON CENTER AT PANEL EDGES AND PLATES.
- TYPICAL ANCHOR BOLTS TO BE 5/8" DIAMETER HOT DIPPE GALVANIZED AT 12" ON CENTER UNLESS NOTED OTHERWISE. ALL BOLTS MUST HAVE 3x3 HDG SQUARE WASHERS INSTALLED.
- MASAT BOLT SILL ANCHORS MAY BE SUBSTITUTED FOR ANCHOR BOLTS. USE SPACING PROVIDED FOR ANCHOR BOLTS.
- ALL FRAMING HOLD DOWNS AND CLIPS TO BE SIMPSON BRAND OR EQUIVALENT.
- DO NOT OVER DRIVE NAILS INTO SHEATHING.
- ROOF AND FLOOR SHEATHING:
 ROOF SHEATHING SHALL BE 1/2" A.P.A. RATED PLYWOOD OR AS NOTED ON PLANS. NAILING SHALL BE 8d COMMON NAILS AT 6" ON CENTER AT PANEL EDGES AND 12" ON CENTER AT INTERMEDIATE SUPPORTS.
 FLOOR SHEATHING SHALL BE 1 1/8" A.P.A. RATED PLYWOOD SCREWED AND GLUED TO SUPPORTS. ADHESIVES SHALL CONFORM TO A.P.A. SPECIFICATION AFG 01. PROVIDE TONGUE AND GROOVE EDGES AT LONG PANEL EDGES. SCREWS SHALL BE AT 6" ON CENTER AT PANEL EDGES AND 10" ON CENTER AT INTERMEDIATE SUPPORTS.
 PLYWOOD SHALL BE LAID WITH FACE GRAIN PERPENDICULAR TO SUPPORTS AND END JOIST STAGGERED 4'-0".
- HOLDDOWNS:
 PROVIDE HOLDDOWNS TO FOUNDATION AT END OF WALLS WHERE SHOWN ON PLANS.

Upper Floor Plan 2,062 sf

North DECK ADD'L. #84 SF T.O. SHEATHING EL. = 46.40' / T.O. GYPCRETE EL. = 46.53'
 1/4" = 1'-0"

- Legend:**
- DENOTES SIMPSON HOLD DOWN AS NOTED
 - DENOTES SIMPSON STRAP (VERT.) AS NOTED
 - SW-# SHEAR WALL PANEL NO. (SEE SCHEDULE)
 - DENOTES STUD WALL FRAMING
 - DENOTES SHEAR PANEL
 - F EXHAUST FAN (SEE SIZING NOTES)
 - S 110V SMOKE DETECTOR W/ BATTERY BACK UP.
 - C CARBON MONOXIDE DETECTOR
 - 102-6 DENOTES FLR. ELEV. (T.O. SLAB) / T.O. 5HT'G.)
 - DS DOWN SPOUT
 - HBI HOSE BIBB
 - DS DOUBLE STUD
 - T6 TRIPLE STUD

General Notes:

ALL EXTERIOR WALLS OR WALLS BETWEEN HEATED AND UNHEATED SPACES SHALL BE 2 x 6 STUDS @ 16" OC. TYP. UNLESS NOTED OTHERWISE (UNO.) WITH 6 x 10 HEADERS AT ALL OPENINGS IN BEARING WALLS UNO. (SEE FRAMING PLANS).

ALL INTERIOR WALLS SHALL BE 2 x 4 STUDS @ 16" OC. TYP. UNO. WITH 4 x 10 HEADERS (BEARING WALLS); UNO.

ALL DIMENSIONS SHOWN ARE TO FACE OF FRAMING UNO.

BUILDING OFFSET DIMENSIONS: F.O. FRAMING + F.O. CONCRETE AT FOUNDATION WALLS TYP. UNO.

PLATE HEIGHT THIS FLOOR = 9'-1 1/2" FROM SHEATHING TYP. UNLESS NOTED OTHERWISE.

SOLID BLOCK ALL SUPPORTS AND FIRE BLOCK ALL PLUMBING PENETRATIONS AND LOCATIONS REQUIRED BY R302.11 PROVIDE FIRE BLOCKING TO ALL CONCEALED DUCT OPENINGS TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN FLOORS.

SEE FLOOR FRAMING PLANS FOR HEADER NOTATIONS AND ALL COLUMN / BEAM SIZES AND LOCATIONS.

ALL HOLD DOWNS ARE TO BE SIMPSON (TYPE AND SIZE AS NOTED ON PLANS AND SHEAR WALL SCHEDULE). SEE FLOOR FOUNDATION AND FRAMING PLANS FOR LOCATION AND TYPE OF ALL SHEAR WALL PANEL TYPE AND ANCHOR BOLT SPACING AT PANELS. ALL STRAP TIE DOWNS SHALL HAVE A MINIMUM 1 1/2" EDGE COVER PROVIDE TRIPLE 2x STUDS AS REQUIRED FOR PROPER PLACEMENT.

Shearwall Schedule:

SHEAR WALL TYPE	NAIL SIZE	EDGES	FIELD	TOP PL. NAIL G.	TOP PL. LTP4 SPACING	BLOCK/G REQ'D	PLATE ANCHORS	MIN. PLATE SIZE	SOLE PLATE NAILING	HEM-FIR #2 #/F.	DOUG-FIR #2 #/F.
P1-6	10d	6"	12"	N/A	24"	Yes	5/8" dia @ 32" O.C.	2x	(2) 16d @ 10" O.C.	27s	310
P1-5	10d	5"	12"	N/A	18"	Yes	5/8" dia @ 32" O.C.	2x	(2) 16d @ 8" O.C.	34s	350
P1-4	10d	4"	12"	N/A	16"	Yes	5/8" dia @ 24" O.C.	3x	(2) 16d @ 7" O.C.	41s	460
P1-3	10d	3"	12"	N/A	12"	Yes	5/8" dia @ 24" O.C.	3x	(2) 16d @ 5" O.C.	54s	600
P1-2	10d	2"	12"	N/A	8"	Yes	5/8" dia @ 16" O.C.	3x	(3) 16d @ 5" O.C.	71s	710
P2-6	10d	6"	12"	N/A	12"	Yes	5/8" dia @ 16" O.C.	3x	(2) 16d @ 5" O.C.	55s	620
P2-4	10d	4"	12"	N/A	8"	Yes	5/8" dia @ 16" O.C.	3x	(3) 16d @ 5" O.C.	83s	920
P2-3	10d	3"	12"	N/A	6"	Yes	5/8" dia @ 12" O.C.	3x	(4) 16d @ 5" O.C.	109s	1200
P2-2	10d	2"	12"	N/A	4"	Yes	5/8" dia @ 12" O.C.	3x	(4) 16d @ 4" O.C.	142s	1540

NOTE:
 FOR ALL SHEARWALL PANELS WITH EDGE NAILING OF 4" OC. OR LESS (P1-4 OR BELOW), 3x STUDS ARE REQUIRED WHERE JOINT BETWEEN TWO ADJACENT PANELS FALL ON AN INDIVIDUAL STUD.

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

The Valentin Residence
 Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040


REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON

MAY 21, 2019
 ADDED SPOKE AND CARBON MONOXIDE DETECTORS TO CORRIDOR

val IT-01
 E.L.H.
 FEB. 11, 2019

A-7
 OF

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

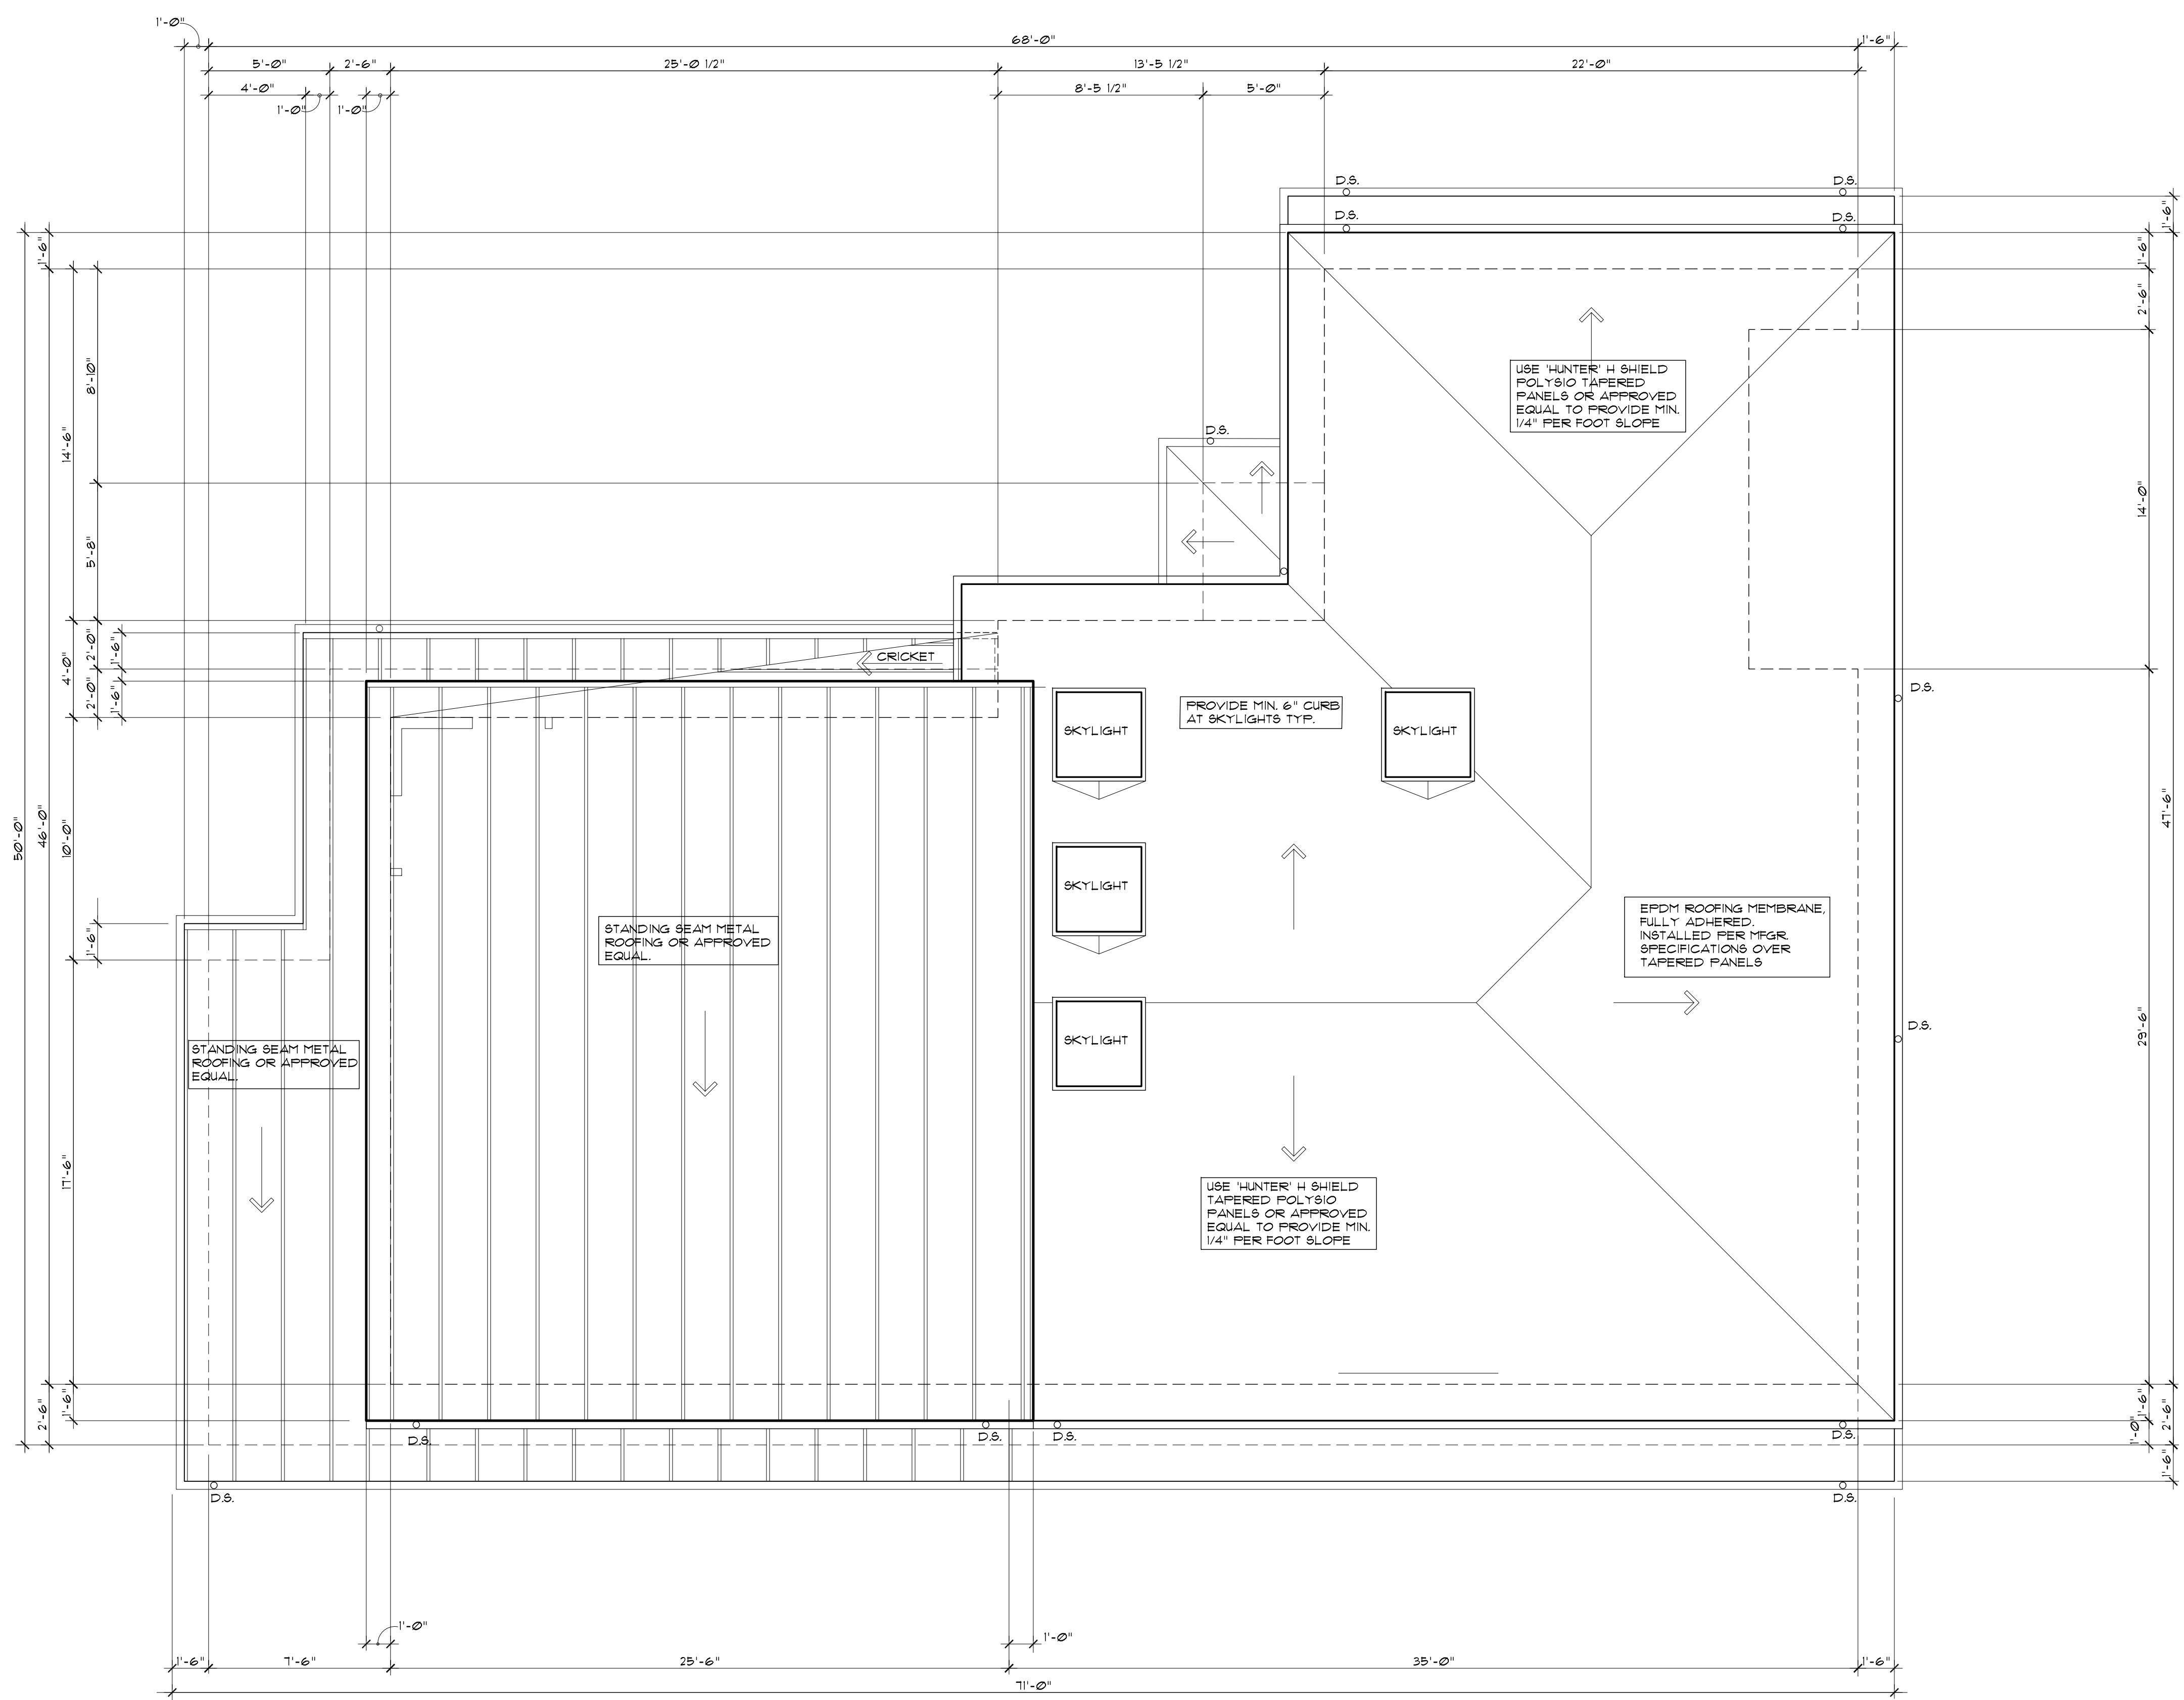

Roof Drainage Plan
 North
 1/4" = 1'-0"

ETHYLENE PROPYLENE DIENE TERPOLYMER (EPDM) SINGLE PLY ROOFING MEMBRANE TYPICAL UNLESS OTHERWISE NOTED.

REVISED

The Valentin Residence

Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150/Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA, 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com


5005 REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON

val 17-01	ELLH	FEB. 11, 2019	
-----------	------	---------------	--

A-8.1


OF

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 1, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

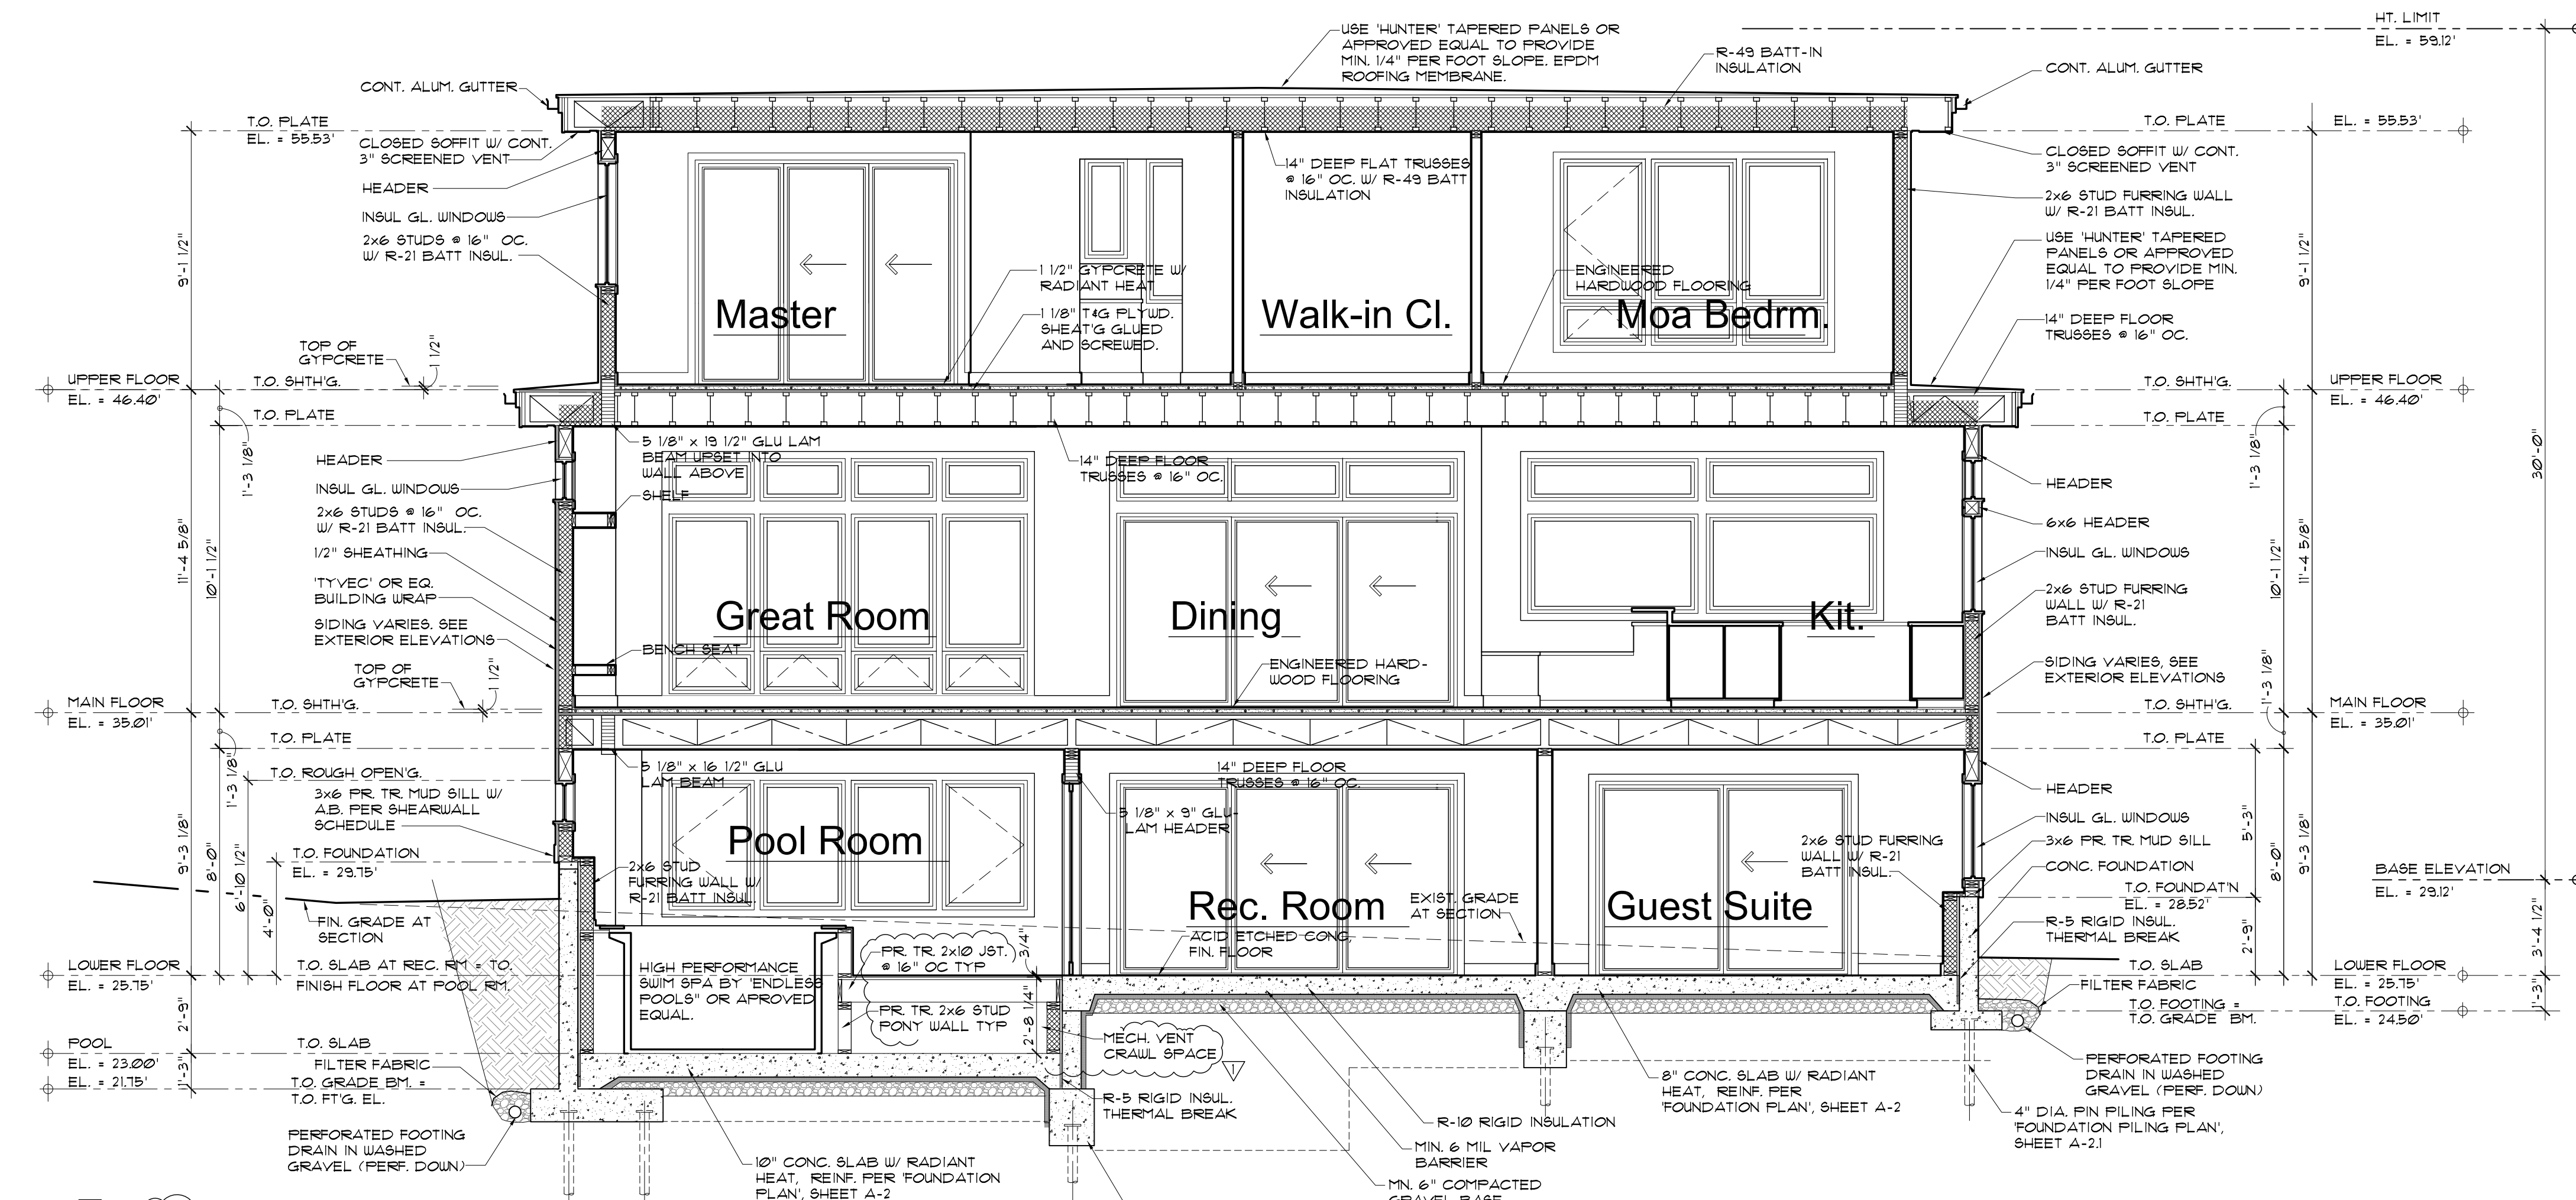

Section A-A
 1/4" = 1'-0"

NOTE:
 SPRAY TWO COATS OF 'TUF-N-DRY' H8
 WATER-PROOFING ON WALL AND
 FOOTING TO GRADE, INSTALL DRAIN
 BOARD AND SEAL THE TOP
 TERMINATION AT GRADE.

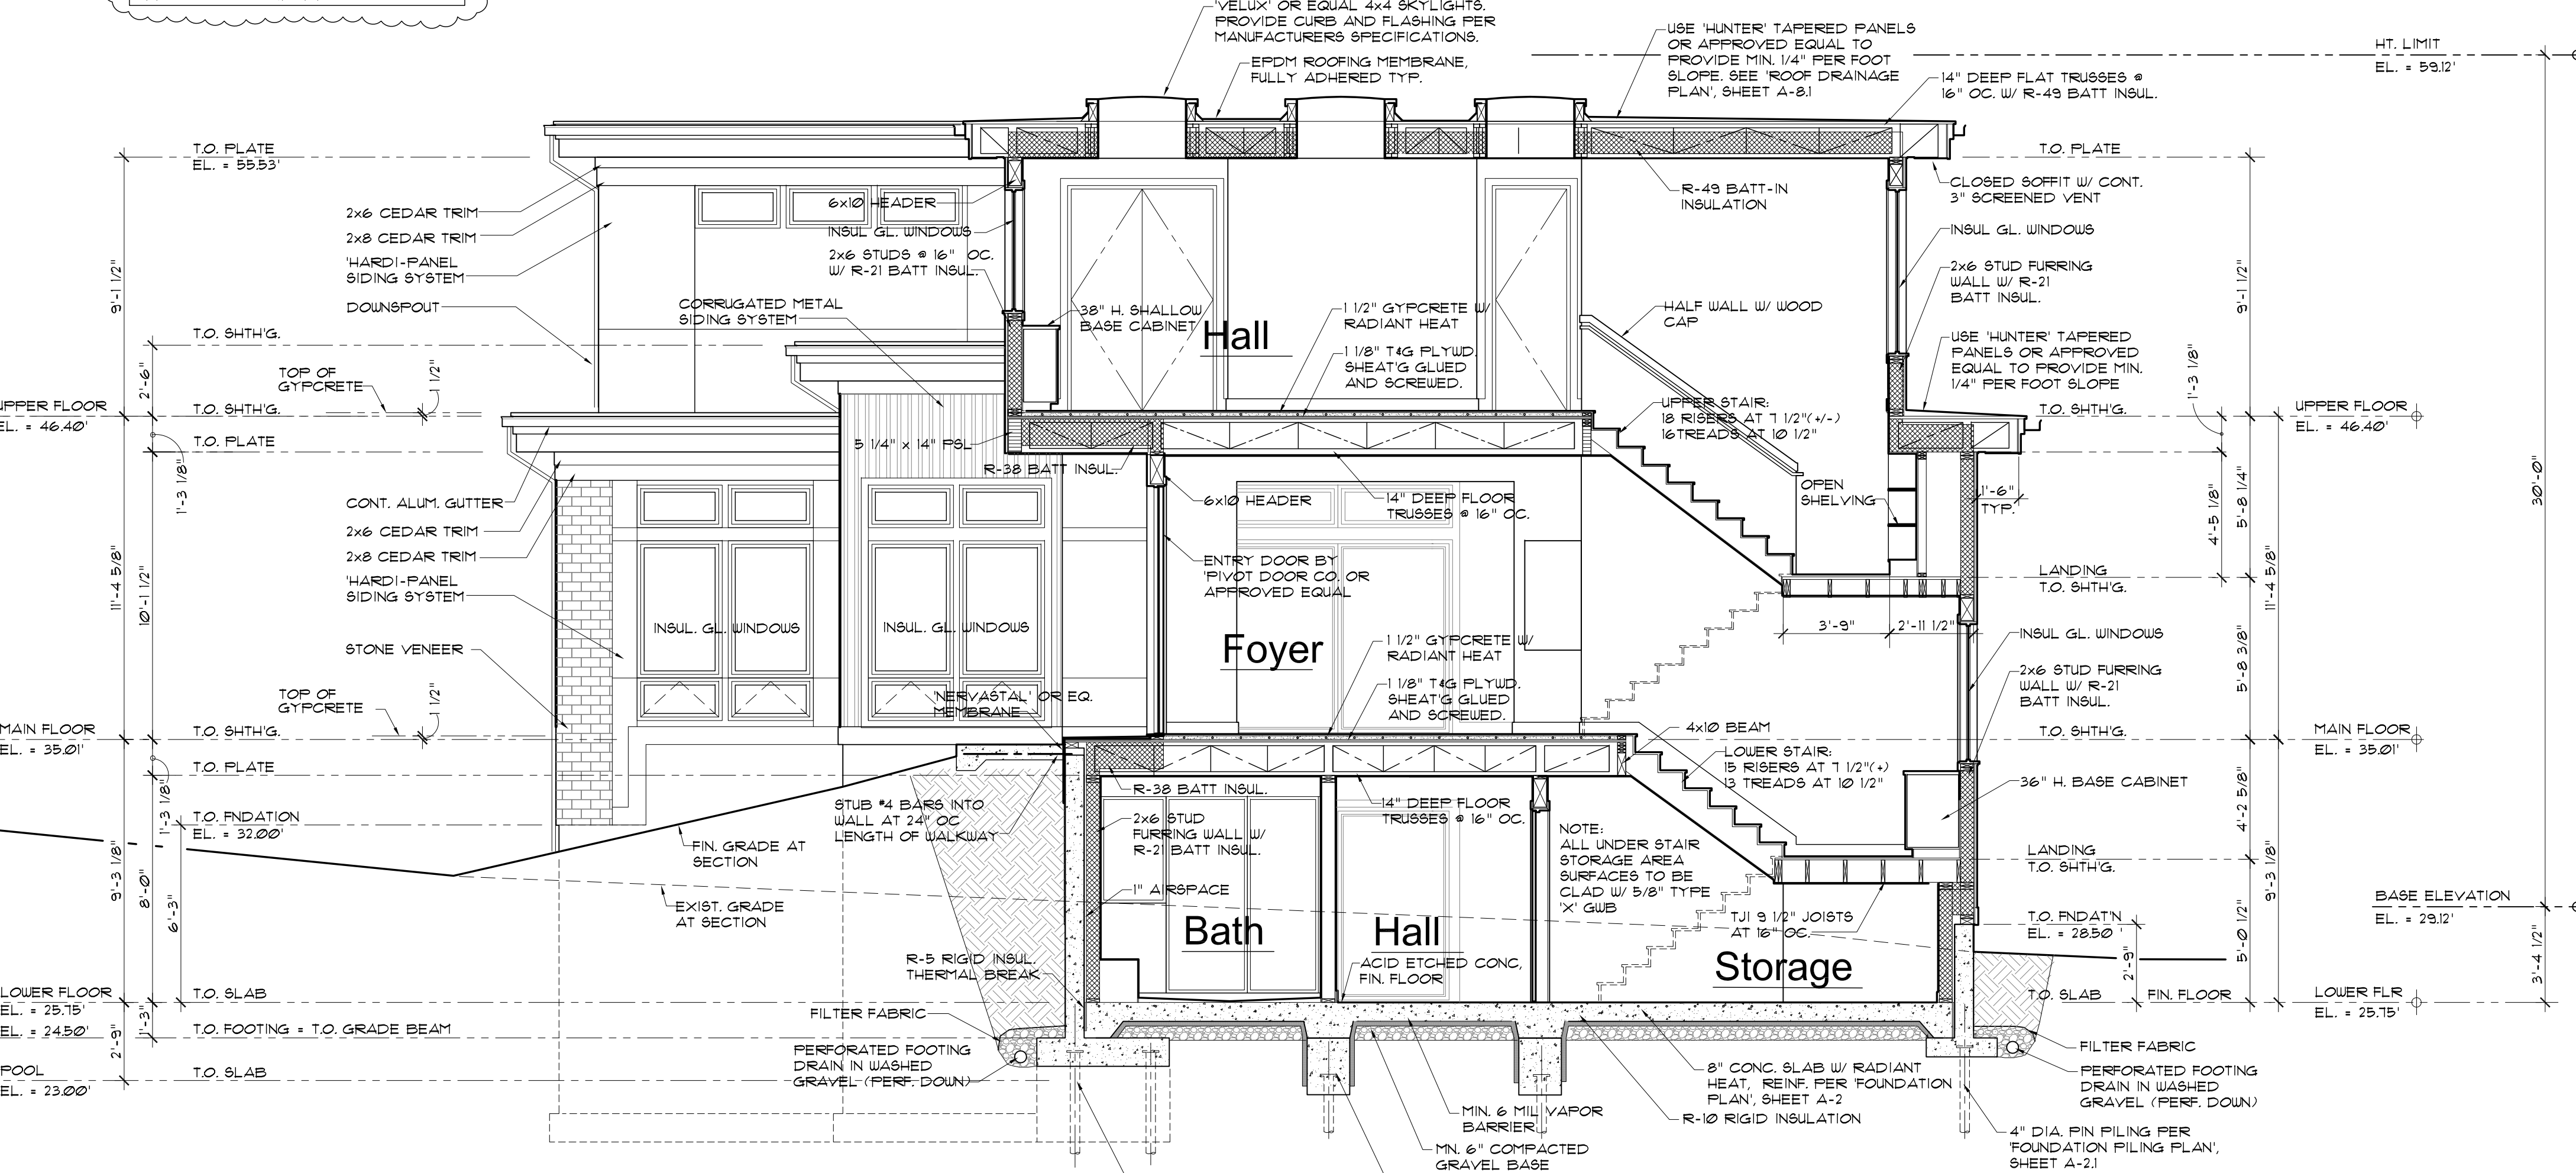

Section B-B
 1/4" = 1'-0"

Typical Construction


- ROOF:**
 STANDING SEAM METAL ROOF
 1/2" PLYWOOD SHEATHING
 SHED ROOF TRUSSES (SPACING PER PLAN)
 OR
 EPDM ROOF MEMBRANE, FULLY ADHERED,
 'HUNTER' TAPERED PANELS (1/2" / FT.)
 1/2" PLYWOOD SHEATHING
 14" DEEP FLAT TRUSSES @ 16" OC
 MIN. R-49 BATT OR BLOW-IN INSULATION
 5/8" GYPSUM WALLBOARD (GWB.)
- WALLS:**
 'HARDIE-PANEL' OR EQUAL SIDING
 VERTICAL METAL SIDING
 STONE VENEER
 'TYVEC' OR EQUAL BUILDING WRAP
 1/2" CDX PLYWOOD SHEATHING
 2 x 6 STUDS @ 16" OC
 MIN. R-21 BATT INSULATION
 1/2" GYPSUM WALLBOARD (GWB.)
- FLOORS:**
 FRAMED FLOORS
 FINISH FLOOR VARIES (SEE FLOOR PLANS)
 1 1/2" GYPCRETE W/ RADIANT HEATING
 1 1/8" 1" x 4" PLYWOOD SHEATHING
 14" DEEP FLOOR TRUSSES @ 16" OC
 MIN. R-38 BATT INSULATION (AS REQUIRED)
 1/2" GYPSUM WALLBOARD @ CEILINGS.
- GARAGE FLOOR:**
 LIGHT WEIGHT CONC. SLAB OVER METAL PAN,
 16" DEEP STEEL BEAMS
 R-38 BATT INSULATION
 5/8" TYPE 'X' GYPSUM WALLBOARD
- LOWER FLOOR SLAB:**
 6" CONC. SLAB W/ RADIANT HEAT AND #4
 BARS EA WAY @ 24" OC
 R-10 RIGID INSULATION
 MIN. 6 MIL VAPOR BARRIER
 MIN. 6" COMPACTED GRAVEL BASE

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com
 REGISTERED ARCHITECT
 ED. L. HURI
 STATE OF WASHINGTON
 5005
 val 17-01
 ELL.H.
 FEB. 11, 2019
 A-9
 OF

REVISED
 MAY 21, 2019, ADDED NOTE FOR
 WATER-PROOFING FOUNDATION.
 ADDED POOL ROOF FLOOR FINISHING INFO.

The Valentin Residence
 Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 7, 2019
 FEB. 9, 2019
 MAY 21, 2019

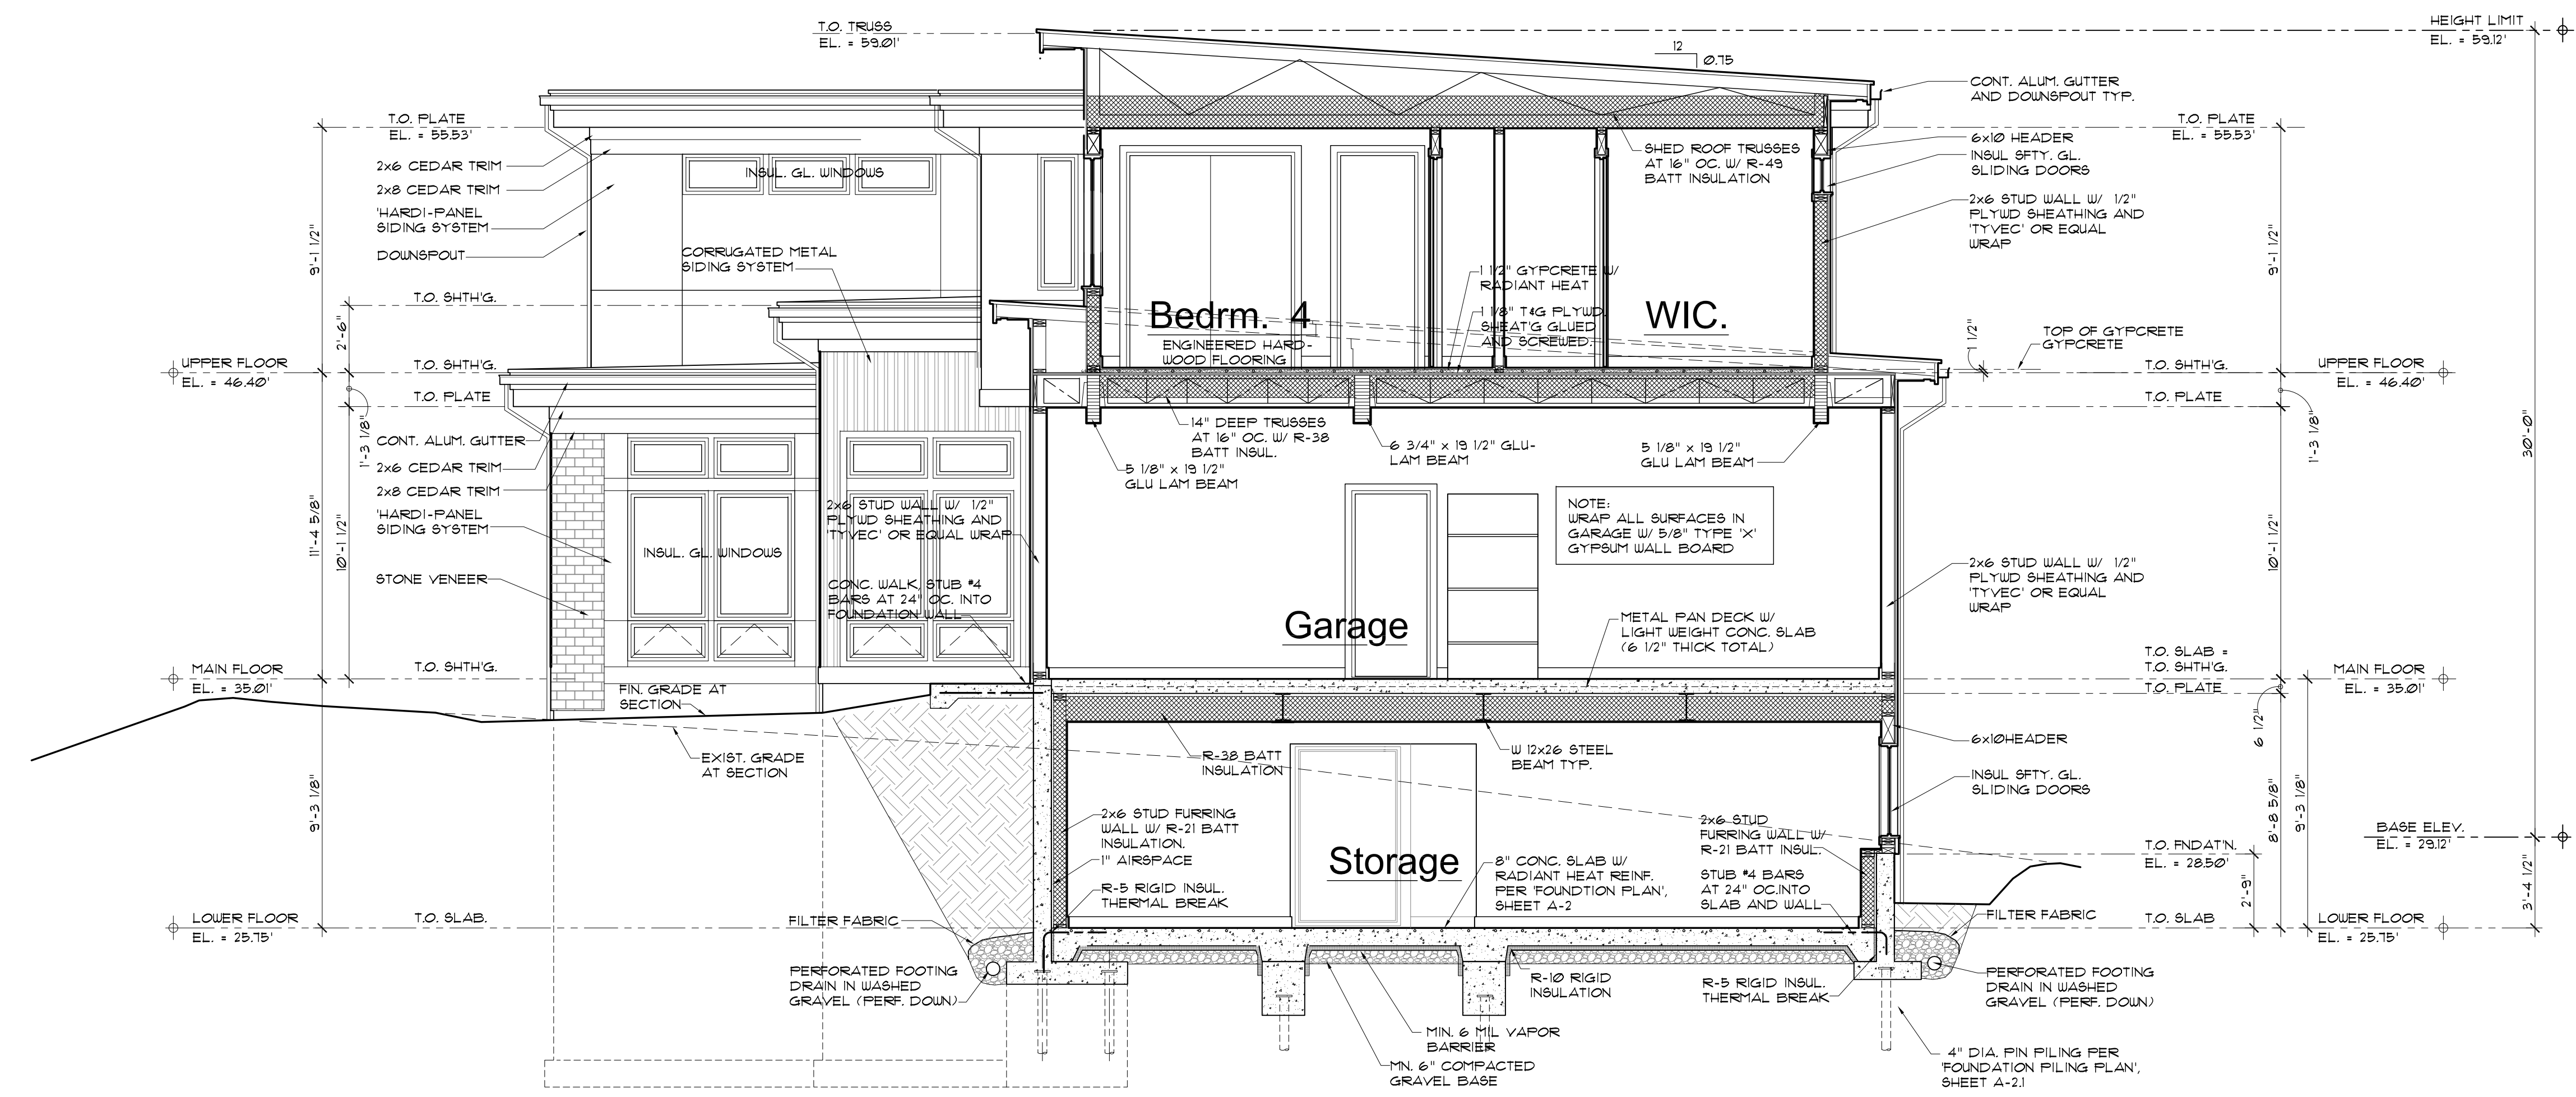

Section C-C
 1/4" = 1'-0"


Typical Construction

- ROOF:**
 STANDING BEAM METAL ROOF
 1/2" PLYWOOD SHEATHING
 SHED ROOF TRUSSES (SPACING PER PLAN)
 OR
 EPDM ROOF MEMBRANE FULLY ADHERED.
 'HUNTER' TAPERED PANELS (1/2" / FT.)
 1/2" PLYWOOD SHEATHING
 14" DEEP FLAT TRUSSES @ 16" OC.
 MIN. R-49 BATT OR BLOW-IN INSULATION
 5/8" GYPSUM WALLBOARD (GWB.)
- WALLS:**
 'HARDIE-PANEL' OR EQUAL SIDING
 VERTICAL METAL SIDING
 STONE VENEER
 'TYVEC' OR EQUAL BUILDING WRAP
 1/2" CDX PLYWOOD SHEATHING
 2 x 6 STUDS @ 16" OC.
 MIN. R-21 BATT INSULATION
 1/2" GYPSUM WALLBOARD (GWB.)
- FLOORS:**
FRAMED FLOORS:
 FINISH FLOOR VARIES (SEE FLOOR PLANS)
 1 1/2" GYPCRETE W/ RADIANT HEATING
 1 1/8" T & G PLYWOOD SHEATHING
 14" DEEP FLOOR TRUSSES @ 16" OC.
 MIN. R-38 BATT INSULATION (AS REQUIRED)
 1/2" GYPSUM WALLBOARD (GWB.) @ CEILING.
- GARAGE FLOOR:**
 LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
 12" DEEP STEEL BEAMS
 R-38 BATT INSULATION
 5/8" TYPE 'X' GYPSUM WALLBOARD
- LOWER FLOOR SLAB:**
 6" CONC. SLAB W/ RADIANT HEAT AND #4 BARS EA. WAY @ 24" OC.
 R-10 RIGID INSULATION
 MIN. 6 MIL VAPOR BARRIER
 MIN. 6" COMPACTED GRAVEL BASE

REVISED
 MAY 21, 2019, ADDED NOTE FOR WATER-PROOFING FOUNDATION.
 ADDED DRAG STRUT HEIGHTS.


The Valentin Residence
 Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150/Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

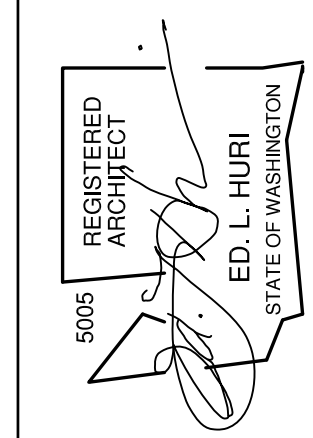


val 17-01
 E.L.H.
 FEB. 11, 2019

A-10
 OF

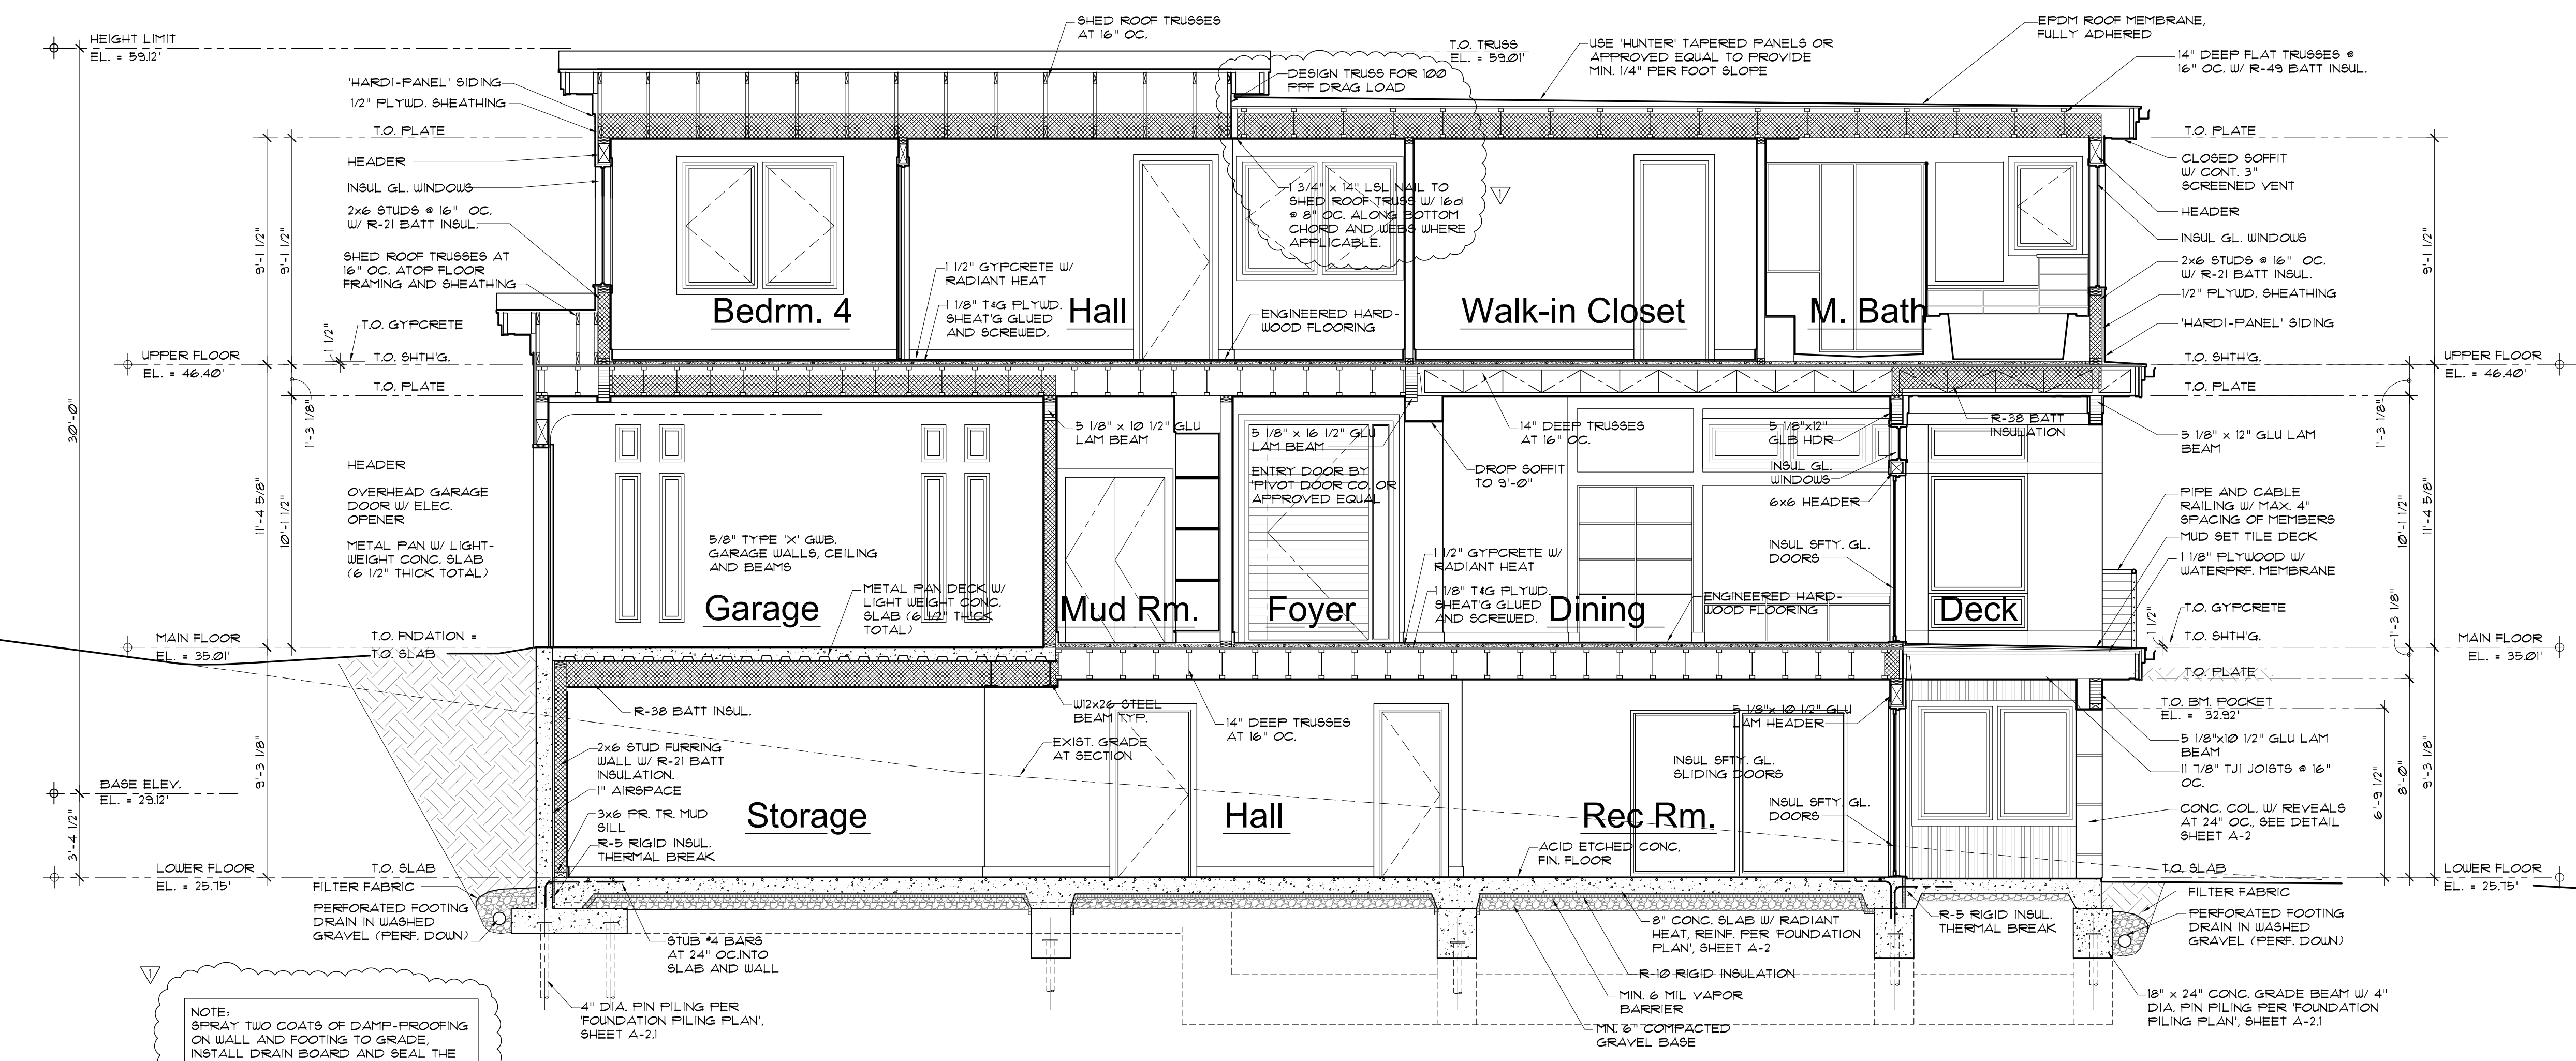

Section D-D
 1/4" = 1'-0"

PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 7, 2019
 FEB. 9, 2019
 MAY 21, 2019

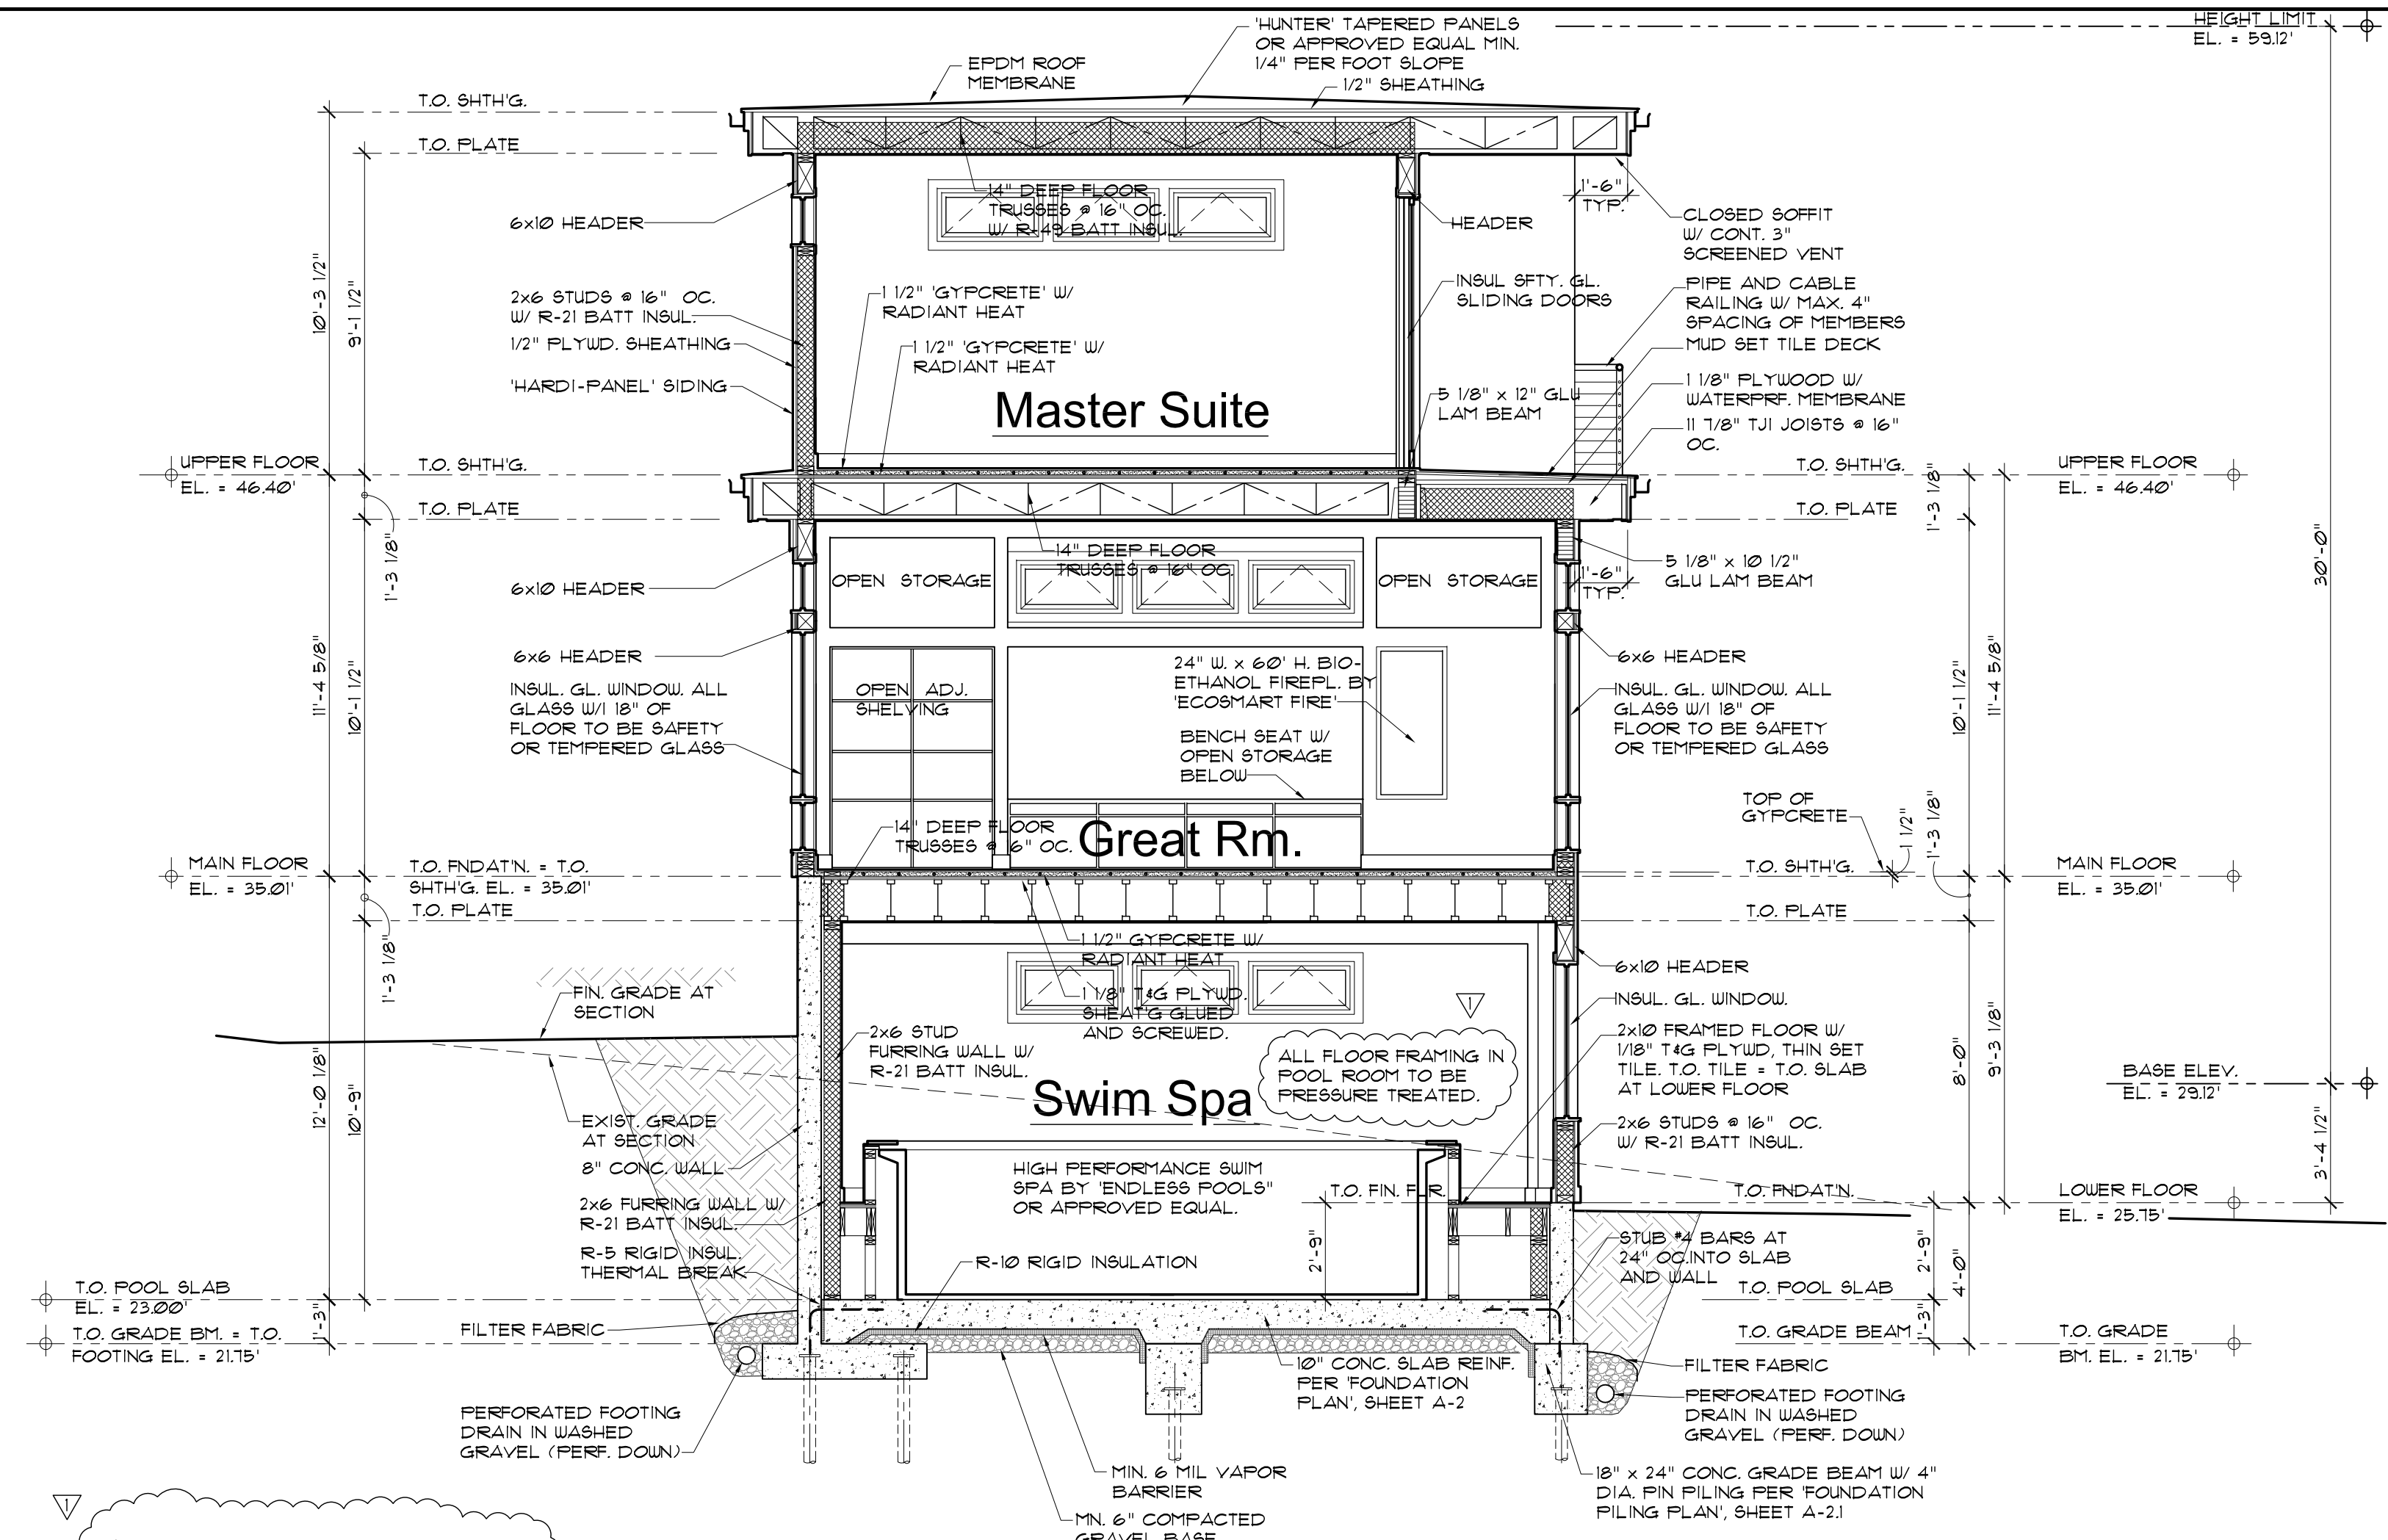


Section E-E
 1/4" = 1'-0"

NOTE: SPRAY TWO COATS OF DAMP-PROOFING ON WALL AND FOOTING TO GRADE. INSTALL DRAIN BOARD AND SEAL THE TOP TERMINATION AT GRADE.

Typical Construction


- ROOF:**
 - STANDING BEAM METAL ROOF
 - 1/2" PLYWOOD SHEATHING
 - SHED ROOF TRUSSES (SPACING PER PLAN)
 - OR-
 - EPDM ROOF MEMBRANE, FULLY ADHERED.
 - 'HUNTER' TAPERED PANELS (1/2" / FT.)
 - 1/2" PLYWOOD SHEATHING
 - 14" DEEP FLAT TRUSSES @ 16" OC
 - MIN. R-49 BATT OR BLOW-IN INSULATION
 - 5/8" GYPSUM WALLBOARD (GWB.)
- WALLS:**
 - 'HARDI-PANEL' OR EQUAL SIDING
 - VERTICAL METAL SIDING
 - STONE VENER
 - 'TYVEC' OR EQUAL BUILDING WRAP
 - 1/2" CDX PLYWOOD SHEATHING
 - 2 x 6 STUDS @ 16" OC
 - MIN. R-21 BATT INSULATION
 - 1/2" GYPSUM WALL BOARD (GWB.)
- FLOORS:**
 - FRAMED FLOORS:
 - FINISH FLOOR VARIES (SEE FLOOR PLANS)
 - 1 1/2" GYPCRETE W/ RADIANT HEATING
 - 1 1/8" T & G PLYWOOD SHEATHING
 - 14" DEEP FLOOR TRUSSES @ 16" OC
 - MIN. R-38 BATT INSULATION (AS REQUIRED)
 - 1/2" GYPSUM WALLBOARD @ CEILINGS.
- GARAGE FLOOR:**
 - LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
 - 12" DEEP STEEL BEAMS
 - R-38 BATT INSULATION
 - 5/8" TYPE 'X' GYPSUM WALLBOARD
- LOWER FLOOR SLAB:**
 - 6" CONC. SLAB W/ RADIANT HEAT AND #4 BARS EA. WAY @ 24" OC
 - R-10 RIGID INSULATION
 - MIN. 6 MIL VAPOR BARRIER
 - MIN. 6" COMPACTED GRAVEL BASE

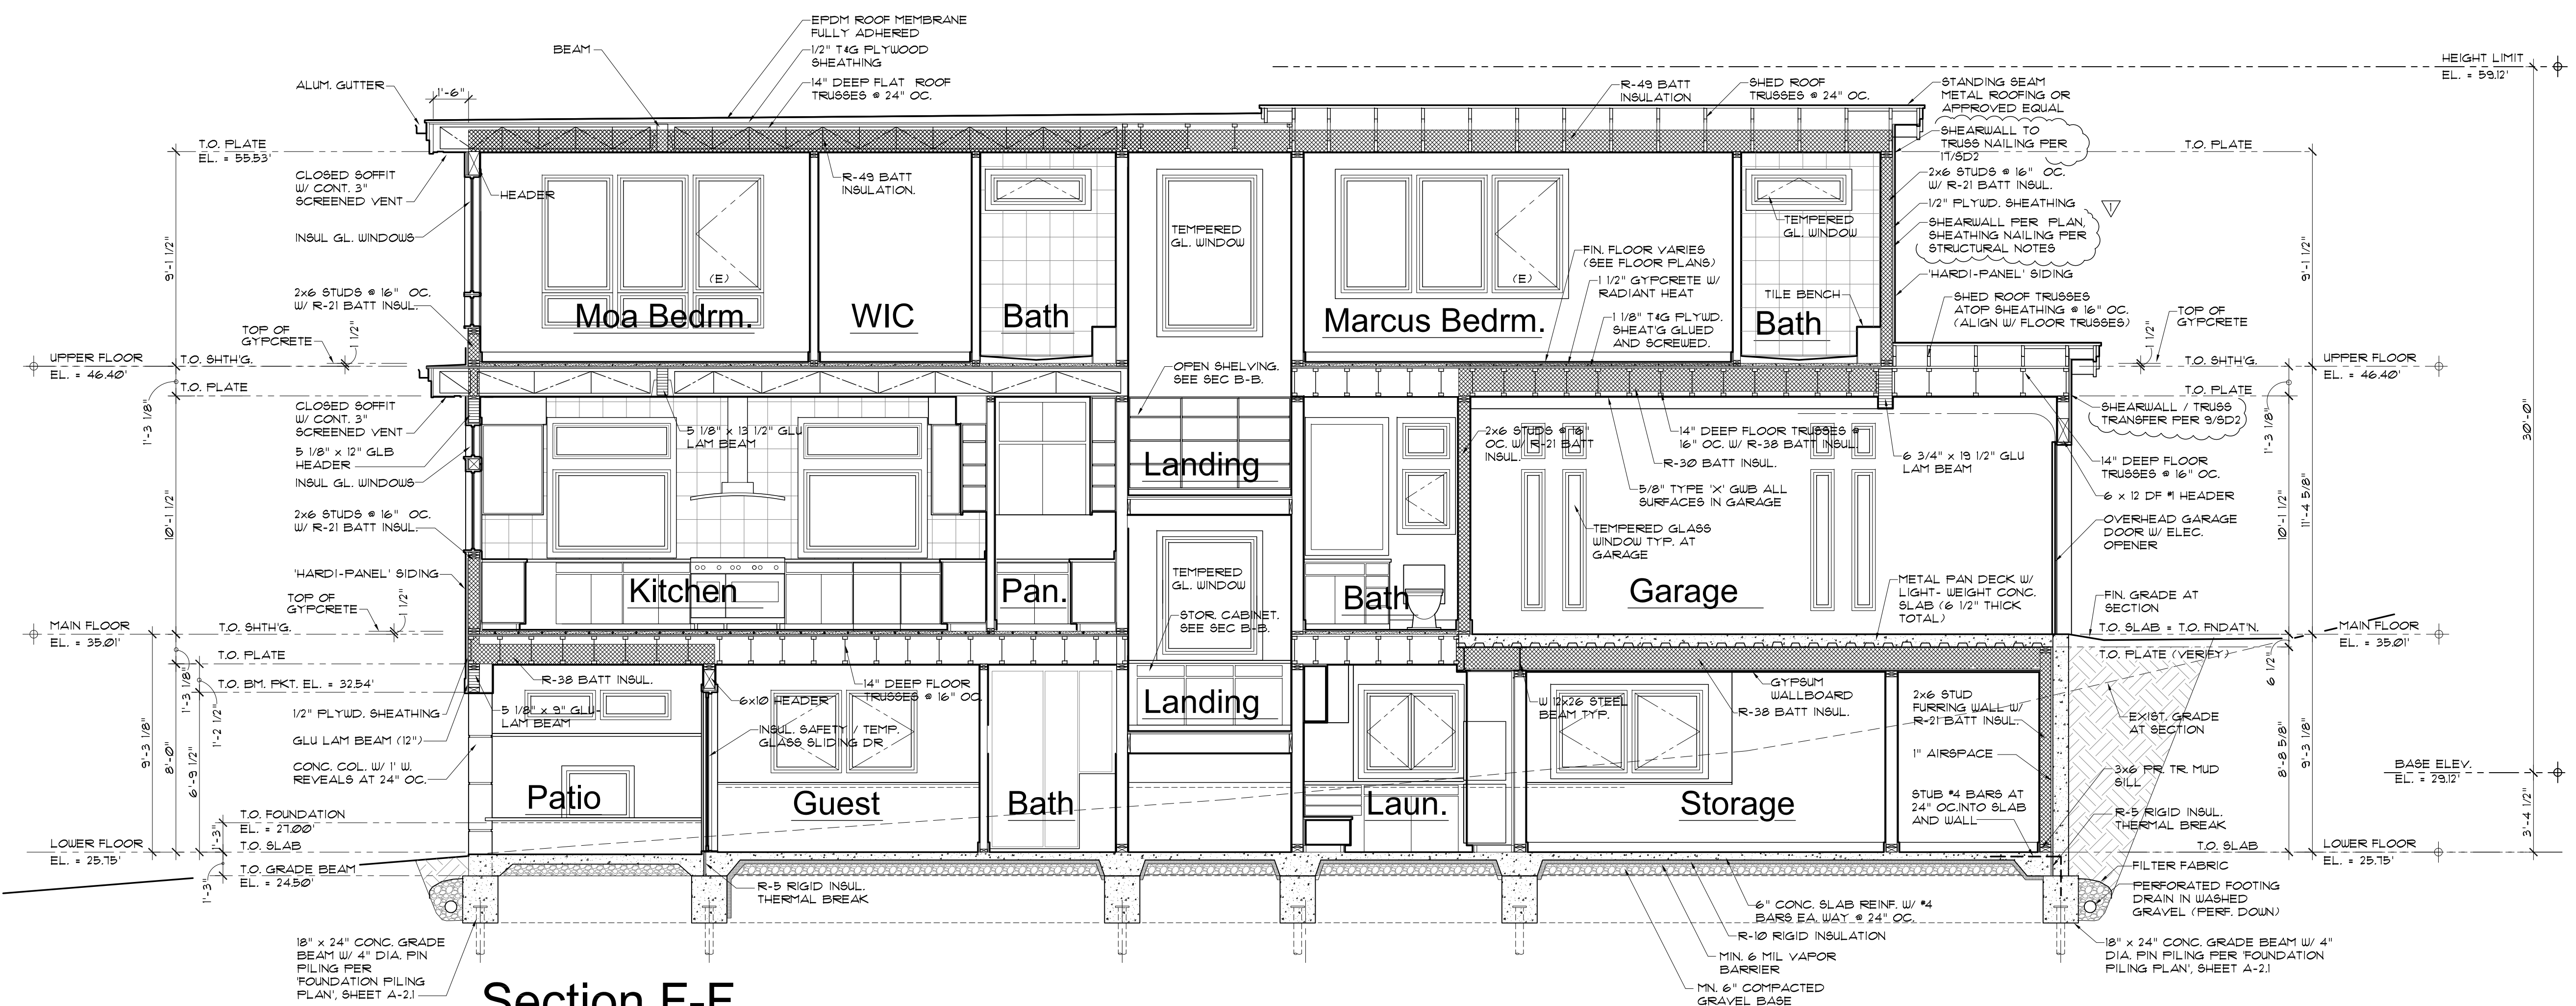

Section F-F
 1/4" = 1'-0"


REVISED
 MAY 21, 2019, ADDED NOTE FOR WATER-PROOFING FOUNDATION
 ADDED FLOOR FRAMING NOTES AT SWIM SPA
 ADDED SHEAR TRANSFER REFERENCES
The Valentin Residence
 Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150 Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

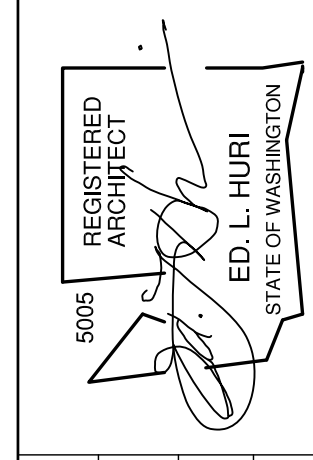

val 11-01
 E.L.H.
 FEB. 11, 2019


PRINTINGS
 DEC. 20, 2019
 DEC. 28, 2019
 JAN. 5, 2019
 JAN. 9, 2019
 JAN. 10, 2019
 JAN. 13, 2019
 JAN. 18, 2019
 JAN. 20, 2019
 JAN. 21, 2019
 FEB. 1, 2019
 FEB. 4, 2019
 FEB. 1, 2019
 FEB. 9, 2019
 MAY 21, 2019

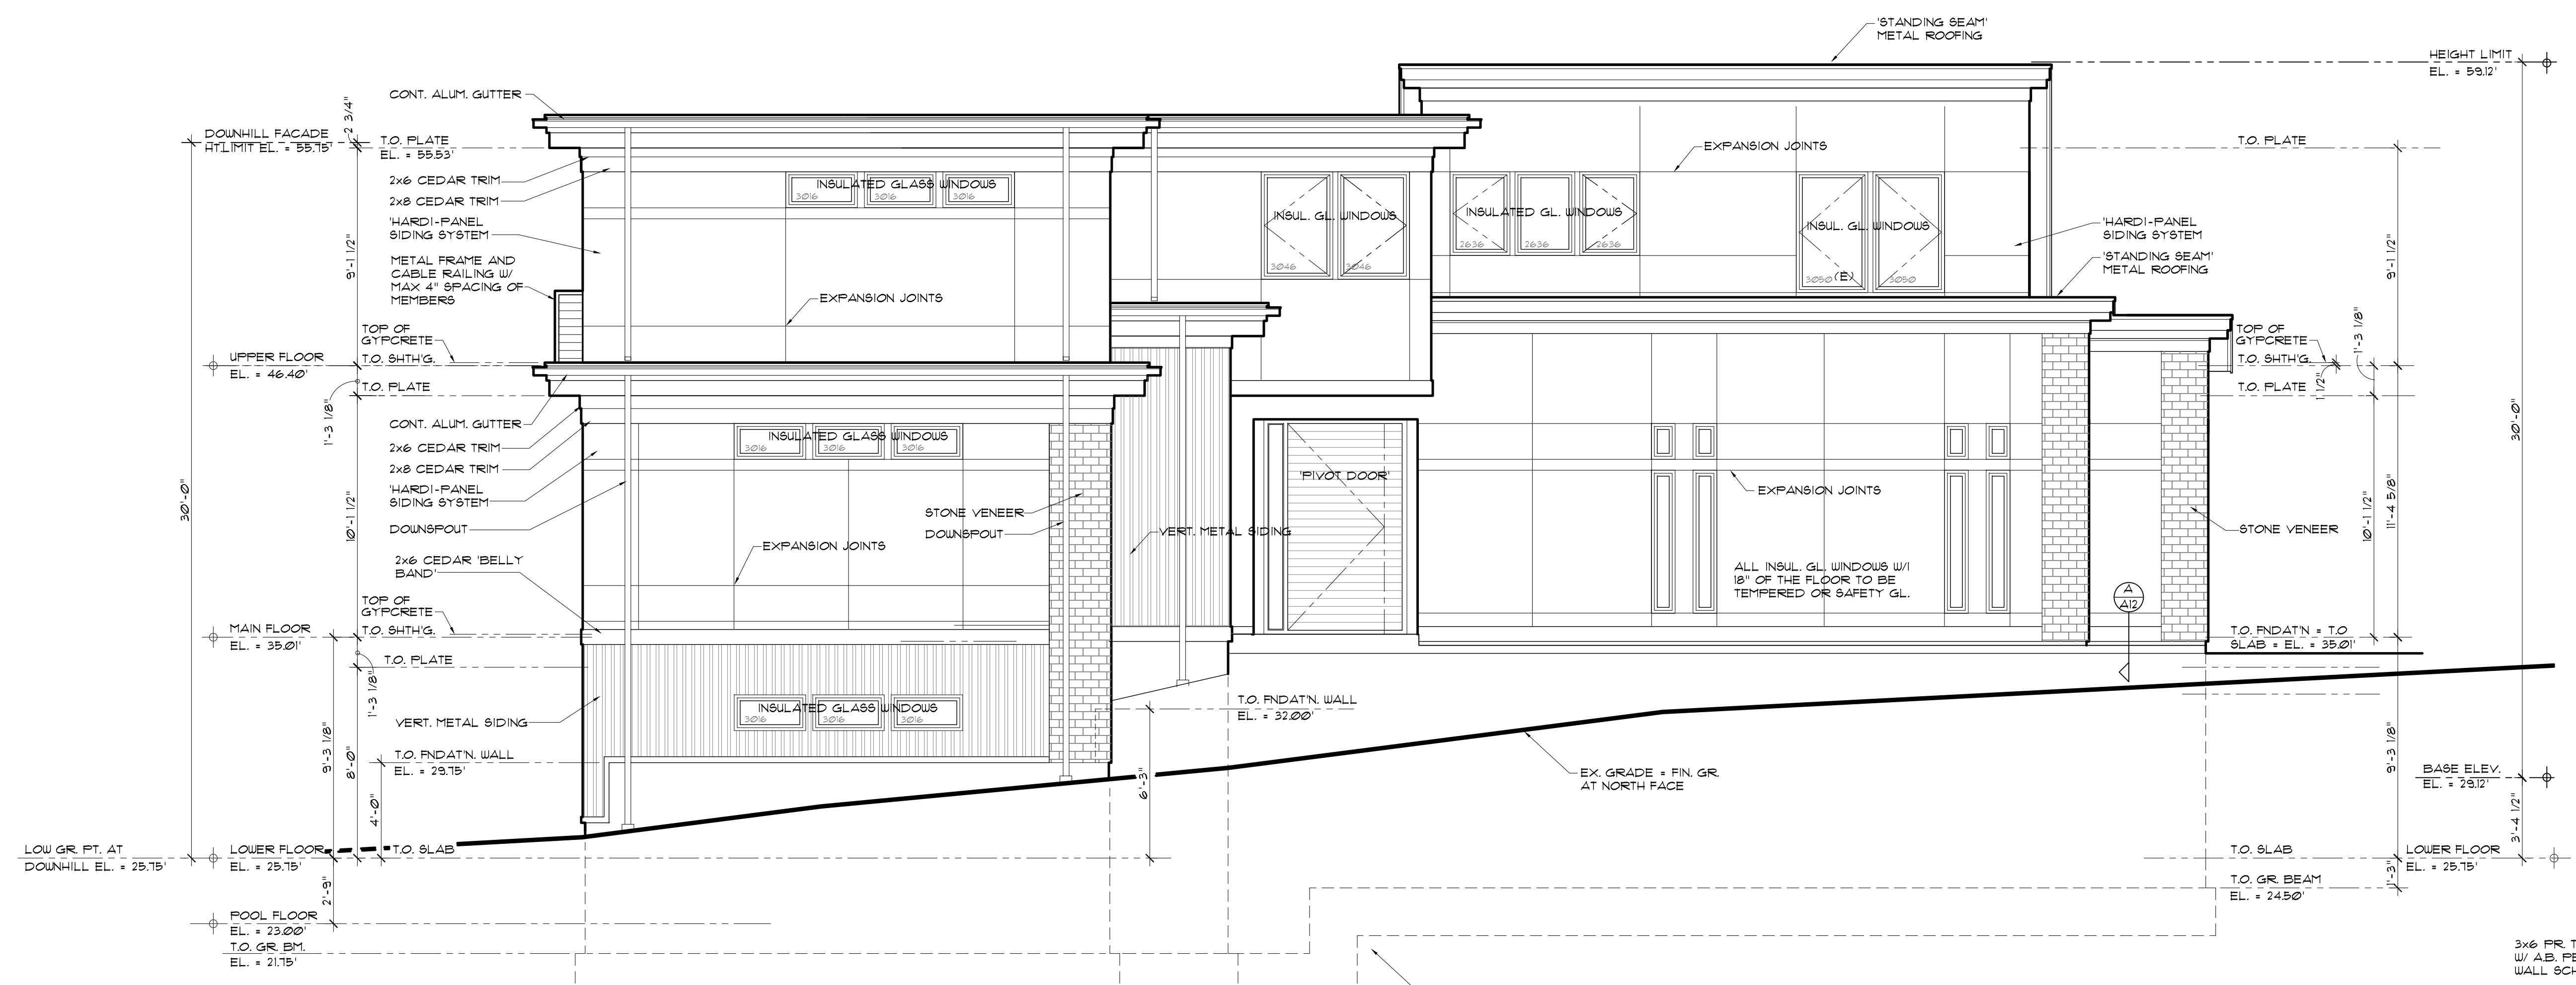


North
 1/4" = 1'-0"

Typical Construction

- ROOF:**
 STANDING SEAM METAL ROOF
 1/2" PLYWOOD SHEATHING
 SHED ROOF TRUSSES @ 24" OC.
 OR
 EPDM ROOF MEMBRANE FULLY ADHERED.
 HUNTER TAFFERED PANELS (1/2" / FT)
 1/2" PLYWOOD SHEATHING
 14" DEEP FLAT TRUSSES @ 16" OC
 MIN. R-49 BATT OR BLOW-IN INSULATION
 5/8" GYPSUM WALLBOARD (GWB.)
- WALLS:**
 HARDI-PANEL OR EQUAL SIDING
 VERTICAL METAL SIDING
 STONE VENEER
 ITYVEC OR EQUAL BUILDING WRAP
 1/2" CDX PLYWOOD SHEATHING
 2 x 6 STUDS @ 16" OC
 MIN. R-21 BATT INSULATION
 1/2" GYPSUM WALL BOARD (GWB.)
- FLOORS:**
 FRAMED FLOORS
 FINISH FLOOR VARIES (SEE FLOOR PLANS)
 1 1/2" GYPCRETE W/ RADIANT HEATING
 1 1/8" T & G PLYWOOD SHEATHING
 14" DEEP FLOOR TRUSSES @ 16" OC
 MIN. R-38 BATT INSULATION (AS REQUIRED)
 1/2" GYPSUM WALLBOARD (GWB.) @ CEILING.
 GARAGE FLOOR:
 LIGHT WEIGHT CONC. SLAB OVER METAL PAN.
 12" DEEP STEEL BEAMS
 R-38 BATT INSULATION
 5/8" TYPE 'X' GYPSUM WALLBOARD
 LOWER FLOOR SLAB:
 6" CONC. SLAB W/ RADIANT HEAT AND #4 BARS EA. WAY @ 24" OC.
 R-10 RIGID INSULATION
 MIN. 6 MIL VAPOR BARRIER
 MIN. 6" COMPACTED GRAVEL BASE

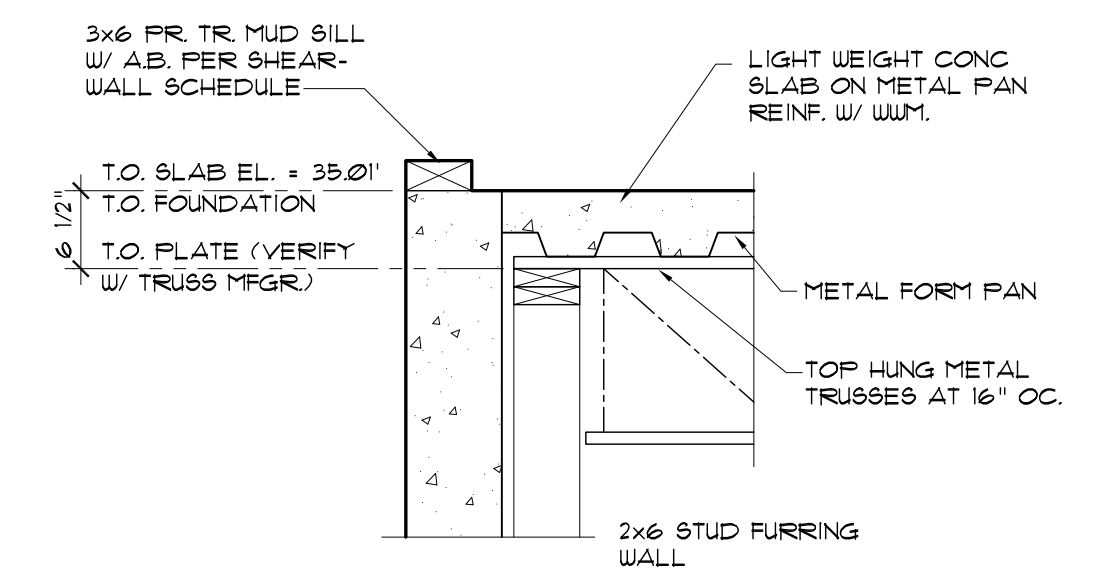

'A' Detail
 3/4" = 1'-0"

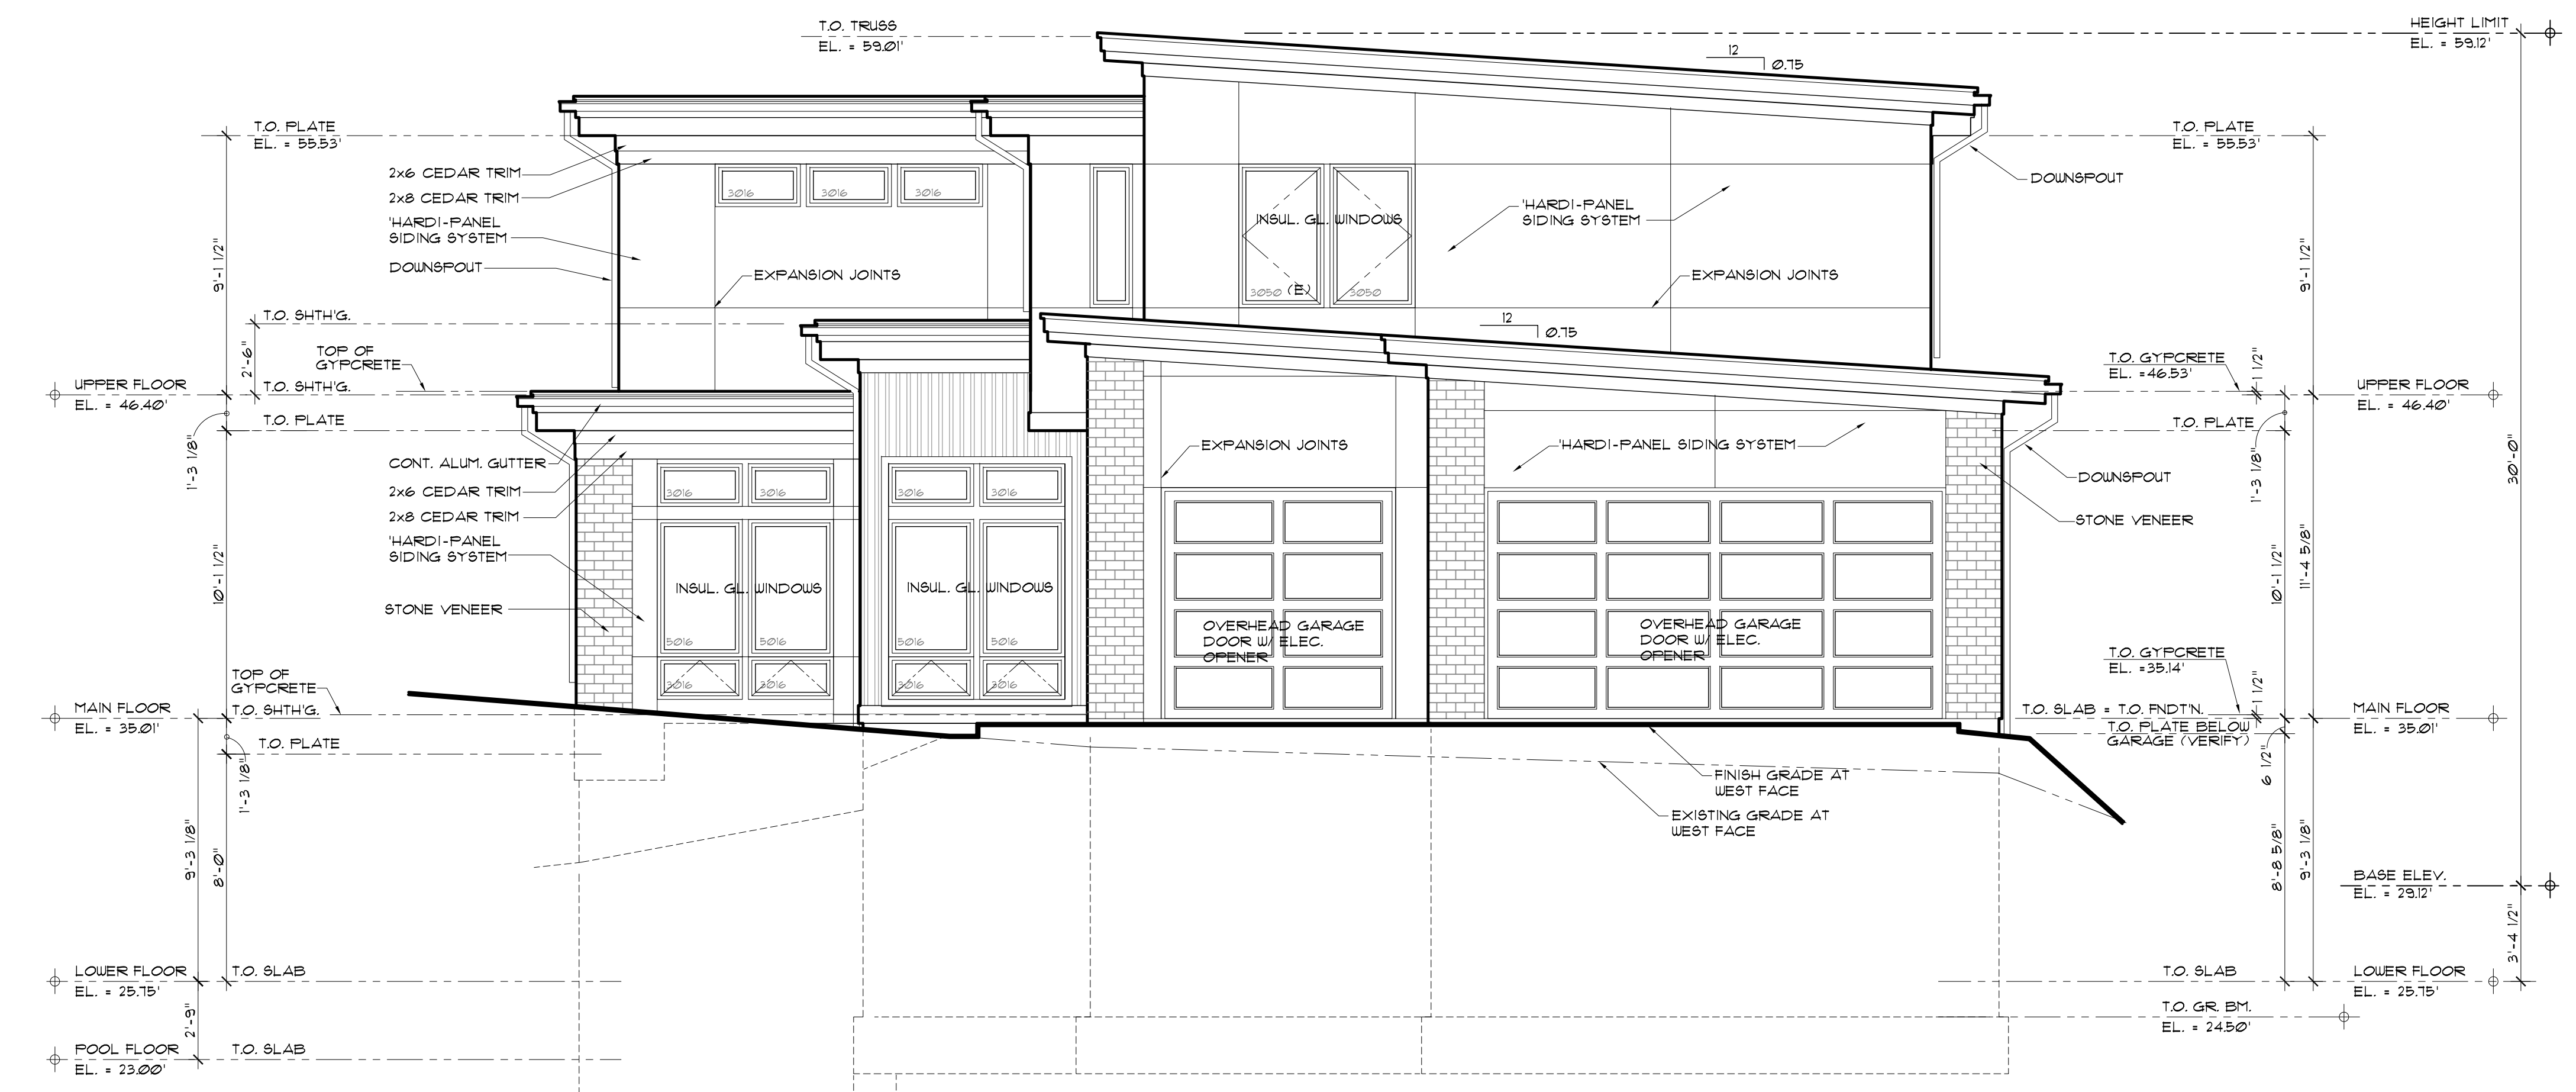


West
 1/4" = 1'-0"

REVISED

The Valentin Residence
 Parcel No. 004610-0150 and 004610-00151
 4350 E. Mercer Way Parcel No. 004610-0150/Mercer Island, Washington 98040

Ed. L. Huri, Architect
 6908 - 168th St. SW., Lynnwood, WA. 98037
 Architectural Design & Planning
 (425) 286-3985 e-huri@msn.com

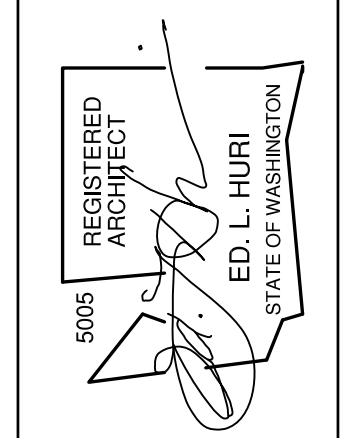

val 17-01
 E.L.H.
 FEB. 11, 2019

A-12
 OF

STRUCTURAL NOTES:

GENERAL

CODE: all materials, methods, and workmanship shall conform to the International Building Code, 2015 edition (IBC).

LOADS: dead load actual
 roof load 25 psf Snow
 floor load 40 psf residential deck live load
 60 psf residential deck live load
 50 psf storage load or 3000# wheel load
 wind load simplified method
 110 mph wind speed, Kz1 = 1.0
 exposure C, I = 1.0.
 seismic category D, Simplified Method, I=1.0, Sds=0.939

SOILS REPORT: Geotech Consultants, Inc.
FOUNDATION SOIL: Geotechnical firm, file number 17464

Laterals active pressure: 40 psf/ft
 passive resistance: 250 psf/ft
 Soldier Pipe Walls Active: 430 psf
 Soldier Pipe Walls Passive: 320 psf
 Pipe Piles- 4" Diameter pipe piling ASTM A53 Grade A Schedule 40 10 Ton capacity
 Pipe piling should be driven to a point of refusal by means of 1100# hammer w/maximum 10 sec./in. or 800# hammer w/maximum 15 sec./in. or 650# hammer w/maximum 20 sec./in.

APPROVALS: Approval, materials or methods shall be approved in writing by the engineer of record, prior to ordering, fabrication, and/or proceeding with specified work.

SUBMITTALS (Shop Drawings, Certifications, Test Reports, Calculations): the contractor shall submit to the engineer of record for review prior to fabrication, for the following items:

- Preconstruction meeting with a Simpson Strongtie Representative and contractor required for Simpson Strongtie Shearwall panels, metal plate wood trusses
- INSPECTION AND TESTING:** an independent qualified testing laboratory, employed by the owner, shall perform inspection and testing in accordance with IBC Section 1701 for the following items:
 - compaction: moisture content: 2 daily, ASTM D-2216. field density: 2 daily, ASTM-D-1556.
 - gravel borrow and structural fill: gradation: 1 each material type, ASTM D-1140 and ASTM D-546. moisture content: 1 each material type, ASTM D-2216. moisture density relationship: 1 each material type, ASTM D-1557.
 - Concrete compressive strength when over 2500 psi: four compressive strength specimens shall be made for each 100 cubic yards, or each 7 day concrete is poured, whichever is greater. The specimens of 7 day concrete shall be taken in accordance with ASTM C-172. Specimens shall be taken in accordance with ASTM C-31, and tested in accordance with ASTM C-39 for compressive strength.

The inspection agency shall submit inspection and test reports to the owner and the engineer of record.

STEINWORK
FOUNDATION: footings shall bear on firm undisturbed earth or compacted structural fill.
EXCAVATION: excavate and dispose of topsoil, organic material, loose native material, and other deleterious material within 5 feet of the building area.
STRUCTURAL FILL: gravel borrow, or approved well graded hotrun gravel (minimum rock size 4", no frozen soil, organic material, or other deleterious material), or lean concrete (f'c = 2000 psi), gravel shall be placed in 18 inch maximum lifts and compacted to 95% relative density per ASTM D-1557.

ROCKERY ROCK: All rocks shall be hard and free of seams, cracks and holes. Rocks shall be tested by a qualified testing laboratory. The test shall be generally rectangular in shape and individually placed for good fit. Rocks shall bear on flat faces of at least two other rocks, whenever possible. Rocks shall be placed to prevent continuous joint planes vertically or horizontally. Horizontal joint planes shall slope away from the wall face. Use Five Man Rock (48" to 54" maximum dimension, 4,000 lb. to 6,000 lb.)

FLITER FABRIC: AMOCO 4545 or Exon P0511

CAST-IN-PLACE CONCRETE
CONCRETE: mix, deliver, and place in accordance with ASTM C-94, ACI 308, ACI 305, ACI 306, and ACI 318. No aluminum (conduit, or other miscellaneous items) shall be embedded in concrete.

FOOTINGS & FOUNDATION WALLS:
 f'c = 2500 psi @ 28 days for strength, 3,000 psi for durability.
 Type I or Type II Portland Cement, 5-1/2 Sack Min.
 0.51 Max. Water/Cement Ratio
 1-1/2 inch Max. Aggregate Size
 3-5 3/4 Entrained Air

SLAB ON GRADE:
 f'c = 2,500 psi @ 28 days for strength, 3,000 psi for durability.
 Type I or Type II Portland Cement, 6 Sack Min.
 1 inch Max. Aggregate Size
 5-7 3/4 Entrained Air

FLOOR TOPPING:
 f'c = 1,250 psi @ 28 days

LEAN CONCRETE:
 f'c = 2,000 psi @ 28 days.

CONTROLLED DENSITY FILL:
 f'c = 300 psi @ 28 days
 7/8 inch Max. Aggregate Size

WATER: Clean and potable.
AGGREGATES: ASTM C-33.

REINFORCING: Deformed bar ASTM A-615, Grade 40 for bars #4 and smaller; Grade 60 for bars #5 and larger; welded wire fabric ASTM A-185, Grade 75.
REINFORCING MECHANICAL SPLICES: ERCO QUICK WEDGE or approved alternate. Alternate shall be ICC approved to develop 125% of specified yield tension for the grade of reinforcing specified. Install in accordance with manufacturer's instructions.

ADMITTRES: Conform to ASTM C-280 or ASTM C-494 as applicable. Concrete choloride shall not be added to the concrete mix.
FINISHING: As noted, in accordance with ACI-301.

CURING: Protect all freshly placed concrete from premature drying and excessive hot or cold temperature, for seven days after pouring.
JOINT SEALERS: Poured two part polyurethane resilient sealant NONSHPK GROUT: Master Builders Set Grout. Install in accordance with the manufacturer's instructions.

BOUND ANCHORS: Simpson Set-xx, epoxy to meet ASTM C-881 Specification Type I, and grade 5, class C epoxy install in accordance with the manufacturer's instructions. Minimum depth recommended by manufacturer but not less than:
 1/2" Dia. -- Embed 3" Min.
 5/8" Dia. -- Embed 4" Min.
 3/4" Dia. -- Embed 4" Min.

EXPANSION ANCHORS: Simpson Strong Bolt Wedge Anchors. Install in accordance with manufacturer's instructions. Minimum depth recommended by manufacturer but not less than:
 1/2" Dia. -- Embed 3" Min.
 5/8" Dia. -- Embed 4" Min.
 3/4" Dia. -- Embed 5" Min.

MASSORY INSPECTION: Special inspection per IBC Sections 1701 and 2105 is not required for all masonry.
CMU WALLS: f'm = 1350 psi (1500 psi fully grouted).
BLOCK: ASTM C-90, Grade N-1 [Types S-1 (interior exposure only) 50/20, f'c = 1000 psi @ 28 days, linear shrinkage 0.045 to 0.065% max.]
BRICK VENEER: Brick ASTM C-216, install 22 Ga. x 1" galvanized the every 2.0 square feet with #9 wire continuous in horizontal motor joint at ties.

MORRIS: ASTM C-270, Type S, f'c = 1800 psi @ 28 days.
GROUT: ASTM C-476, f'c = 2000 psi @ 28 days.
REINFORCING FOR MASSORY: BAR, ASTM A-615, Grade 40, wire joint reinforcing, IBC Standard 21-10, ASTM A-82 Wire, Galvanized, use prefabricated corners and ties.

STRUCTURAL STEEL
GENERAL: All fabrication and erection shall conform to the AISC Steel Construction Manual, 14th Edition, and the AISC Specification for the Hot Rolled Shapes and Plate. ASTM A-36, Fy = 36 ksi.
STRUCTURAL PIPE: ASTM A-53 GRADE B, Fy = 35 ksi.
STEEL PIPE PILES: ASTM A-272 GRADE 2, Fy = 35 ksi.
STRUCTURAL TUBING: ASTM A-500 GRADE B, Fy = 46 ksi.

LIGHT GAGE STUDS AND JOISTS: ASTM A-446, provide all accessories including but not limited to: tracks, clips, web stiffeners, anchors, fasteners, and other accessories required for fastening devices, resilient clips, and other accessories required for fastening devices. Use USC or KNORR as indicated or approved alternate shall be equal or greater load capacity. All studs joists and accessories shall be produced by a single manufacturer except as noted on the drawings or as approved by the engineer of record. Accessories shall be proven by testing as demonstrated either by ICC or other approved or through a test program conforming to BS STANDARD ZS:1737.
WELDING: Conform to AWS D1.1. All welding shall be by WABO certified welders. E70XX electrodes.

CARPENTRY
FRAMING LUMBER: Provide S4S, S-Dry. All lumber in contact with concrete or masonry shall be pressure preservative treated. Nail in conformance with IBC Table 23-04.9.1 or as indicated on the drawings. Use full height studs at exterior walls. Double joists are required under partial bearing walls. Use multiple studs to achieve full bearing under beam ends or posts in wall from above, unless noted otherwise.
PLATES: Hem-Fir No. 2
 F1 = 500 psi, Fc broag = 405 psi
 Douglas Fir No. 2
 F1 = 575 psi, Fc broag = 625 psi

STUDS: Hem-Fir No. 2
 F1 = 850 psi, Fc// = 1,350 psi, E = 1,300 ksi
 Douglas Fir No. 2
 F1 = 900 psi, Fc// = 1,500 psi, E = 1,600 ksi

JOISTS: Hem-Fir No. 2
 Douglas Fir No. 2
 F1 = 900 psi, Fy = 180 psi, E = 1,600 ksi

BEAMS: Douglas Fir No. 2
 2x--: F1 = 900 psi, Fy = 180 psi, E = 1,600 ksi
 4x--: F1 = 1,400 psi, Fy = 280 psi, E = 1,800 ksi
 6x--: F1 = 875 psi, Fy = 170 psi, E = 1,300 ksi

POSTS: Douglas Fir No. 1
 4x--: Fc// = 1,500 psi, E = 1,600 ksi
 6x--: Fc// = 1,000 psi, E = 1,300 ksi

DECKING: Hem-Fir Commercial Dwp
 2x6: F1 = 850 psi, Fy = 1,000 psi, E = 1,300 ksi
 4x8: F1 = 850 psi, Fy = 1,000 psi, E = 1,300 ksi
 4x12: F1 = 850 psi, E = 1,000 ksi

MISC.: Douglas Fir No. 2 OR Hem-Fir No. 2
 F1 = 850 psi, E = 1,300 ksi

GLU-LAMINATED TIMBER: Shall conform to AITC 117-84 and ANSI 190.1: Industrial Appearance Grade in conformance with AITC 110-84 (except as noted on the drawings). Handle, store and erect in accordance with AITC 111-79.

BEAMS: A1C Combination 24f-V4 for single spans and 24f-V8 for continuous multiple spans; manufacturer's standard camber.

LAMINATED VENEER LUMBER (LVL): Weyerhaeuser MICRO=LAM as indicated on drawings or approved alternate. Products shall be proven by testing as demonstrated either by ICC or NER acceptance. Minimum allowable design stresses shall be as follows:
 1.9E DF MICRO=LAM LVL F1 = 2,600 psi, Fy = 285 psi
 Fc// = 2,460 psi, Fc broag = 750 psi, E = 1,800 ksi.

PARALLEL STRAND LUMBER (PSL): Weyerhaeuser Paradigm as indicated on the drawings or approved alternate. Products shall be proven by testing as demonstrated either by ICC or NER acceptance. Minimum allowable design stresses shall be as follows:
 2.0E DF PARALLAM PSL F1 = 2,900 psi, Fy = 290 psi
 Fc// = 2,900 psi, Fc broag = 750 psi, E = 2,000 ksi.

2 IE DF PARALLAM PSL: F1 = 3,100 psi, Fy = 290 psi
 Fc// = 2,900 psi, Fc broag = 750 psi, E = 2,100 ksi.

STRUCTURAL WOOD PANELS: A.P.A. rated sheathing as noted. Install panels with the long dimension across supports, and continuous across two or more spans. Space panels 16" at joint.

PLYWOOD WEB JOISTS: Weyerhaeuser as indicated on drawings or manufacturer with A.P.A. structural plywood, machine stress rated or MICRO=LAM lumber flanges, and waterproof glues. Joist manufacturer shall provide drawings showing all critical dimensions for determining fit and placement in the building, temporary and permanent bracing and blocking, materials used, and load capacity or design load. Drawings shall be submitted to the engineer of record for approval in Washington. Products shall be proven by testing as demonstrated either by ICC and NER acceptance.

METAL PLATE WOOD TRUSSES: Trusses shall be designed and factory manufactured in conformance with F19-85. Metal plate connectors shall be designed and tested in accordance with ICC-ES E-1088. Design trusses for the following minimum loadings:
 top chord live load 25 psf
 top chord dead load 10 psf
 bottom chord dead load 10 psf
 total load 45 psf (55 psf for the roof)

Truss manufacturer shall provide drawings and calculations, including plying plans and stress diagrams, for review by the engineer, prior to fabrication. Provide for srops, hips and valleys, bearing points, bearing stress, girders, truss connections, mechanical and other special loads, and other details. All truss members shall be protected from fire. Trusses shall be located as shown on the drawings. Other special framing for hips, valleys, etc. Shall be determined by the manufacturer. Submitted documents shall be stamped, signed, and dated by a structural engineer licensed in the State of Washington. All noted truss documents to be on job site available for inspector.

FASTENERS
NAILS AND SPIKES: Common, except as noted on the drawings.
LAG SCREWS: ANSI B18.2.1.
BOLTS, NUTS AND WASHERS: ASTM A-307 GRADE A or B, ANSI B18.2.1; ASTM A-563 GRADE A, ANSI B18.2.2; ASTM F-844.

FRAMING CONNECTORS: Simpson as noted. Products shall be proven by testing as demonstrated either by ICC or other approved or through a test program conforming to BS STANDARD ZS:1737. Hot Dipped Galvanized (G185), stainless steel, or meet ASTM-153 requirements. For D.F. treated or retentions of AOC or CBA higher than 0.40, or CBA over 0.20, stainless steel required.
PRESSURE PRESERVATIVE TREATMENT: oil treated lumber shall be marked with a preservative retention level and species. Retention level shall be in accordance with AWPA M-4, except for preservative penetrations in accordance with AWPA M-4. After treatment air or kiln dry to a maximum moisture content of 19%.

LUMBER (DOUGLAS FIR-LARCH):
TREATMENT: AMPA U1
PRESERVATIVE: AMPA P-5, ACZA
RETENTION: 0.25 [0.40 ground contact or fresh water] pounds per cubic foot
QUALITY MARK: AWPB LP-2 OR LP-22 [ground contact]

LUMBER (HEM-FIR):
TREATMENT: AMPA U1
PRESERVATIVE: AMPA P-5, CCA
RETENTION: 0.25 [0.40 ground contact or fresh water] pounds per cubic foot
QUALITY MARK: AWPB LP-2 OR LP-22 [ground contact]

PLYWOOD:
TREATMENT: AMPA U1
PRESERVATIVE: AMPA P-5, CCA OR ACZA
RETENTION: 0.25 [0.40 ground contact or fresh water] pounds per cubic foot
QUALITY MARK: AWPB LP-2 OR LP-22 [ground contact]

GLU-LAMINATED TIMBERS:
TREATMENT: AMPA U1
PRESERVATIVE: AMPA P-8, PentaChlorophenol
RETENTION: 0.40 [0.50 Ground Contact] pounds per cubic foot
QUALITY MARK:

Shear Wall Designation	Height	Edges	Field	Top Plate Nailing	Top Plate Spacing	Blocking Required	Plate Anchors	Min. Plate	Side Nailing	Hem-Fir #/Ft	Doug-Fir #/Ft	
P1-6	10d	6"	12"	N/A	24"	Yes	5/8" @ 32" O.C.	2x	(2)	16d @ 10" O.C.	2/9	3/10
P1-5	10d	4"	12"	N/A	18"	Yes	5/8" @ 32" O.C.	2x	(2)	16d @ 8" O.C.	3/8	4/10
P1-4	10d	4"	12"	N/A	18"	Yes	5/8" @ 24" O.C.	3x	(2)	16d @ 7" O.C.	3/8	4/10
P1-3	10d	2"	12"	N/A	6"	Yes	5/8" @ 16" O.C.	3x	(2)	16d @ 5" O.C.	2/3	3/10
P2-6	10d	6"	12"	N/A	12"	Yes	5/8" @ 16" O.C.	3x	(2)	16d @ 5" O.C.	5/8	6/10
P2-4	10d	4"	12"	N/A	6"	Yes	5/8" @ 16" O.C.	3x	(3)	16d @ 5" O.C.	8/16	9/10
P2-3	10d	4"	12"	N/A	6"	Yes	5/8" @ 12" O.C.	3x	(4)	16d @ 5" O.C.	10/10	12/10
P2-2	10d	2"	12"	N/A	4"	Yes	5/8" @ 12" O.C.	3x	(4)	16d @ 4" O.C.	14/20	15/40

Shear Wall Notes:



- P1 - 1/2" Plywood or A.P.A. rated sheathing one side.
- When allowable height exceeds 350 ft, 3X minimum wall studs required at adjoining panel edges. (i.e. P1-4 designation or below).
- Nails shall be 10d common, unless noted otherwise.
- Where plywood is 2 sides of wall, joints shall fall on separate studs each side.
- All panel edges backed with 2-inch nominal or wider framing, unless noted otherwise. Install panels either horizontally or vertically for A.P.A. rated sheathing, gypsum shear walls shall be installed with the sheathing running horizontally. Space 15/32" A.P.A. rated spore nails at intermediate supports.
- Edges 6" O.C. 12" O.C. field Block all edges.
- Typical interior- 1/2" gypsum wall board. Nail with 5d cooler nails at 7" O.C. all studs and plates. Block all shear wall edges.
- 5/8" gypsum wall board. Nail with 6d cooler nails at 7" O.C. all studs and plates.
- Typical anchor bolts 5/8" dia. Hot Dipped Galvanized 72" O.C. unless otherwise noted. All bolts must have 3X3X0.295 square washers installed - 7" minimum embedment.
- 3X3X0.295 square washers installed - 7" minimum embedment.
- All Wood structure may be substituted for anchor bolt. Use spacing provided for anchor bolts.
- Do not override nails into sheathing.

Roof and floor sheathing: 3/4" A.P.A. rated sheathing (24"0). Nailing shall be 8d (common) @ 6" O.C. at panel edges, and 12" O.C. at intermediate supports.
Floor sheathing: 15/32" A.P.A. rated sheathing (48/24) nailed and glued. Adhesives shall conform to A.P.A. specification A.C. 01. Provided TAG edges at long panel edges. Nailing shall be 8d (common) at 6" O.C. at panel edges and 10" O.C. at intermediate supports.
 Plywood shall be laid with face grain perpendicular to supports and end joints staggered 4'-0".

Hold-downs: Provide hold-downs to foundation at ends of walls where shown on plans.
 Installation instruction of Simpson Steel StrongWall and Wood StrongWall come attached to the wall assemblies. Please read and understand the design drawings and product information before installing the anchoring elements of the walls. If installation instructions are not present refer to Simpson Strong-Tie Catalog C-SW07 or www.strongtie.com.
 Simpson strong-tie will provide upon request, training and field review before the installation of the anchoring elements of the Steel and/or Wood wall assemblies. To request such training, please call (800) 999-5099 Ext. 1082 and provide name, project address and contact information. You may also e-mail requests to khoum@strongtie.com. Please allow 24 hours notice for scheduling.

REVISIONS	BY	DATE
1	SRL	5/27/19
2		
3		
4		
5		
6		
7		

FORSMAN ENGINEERING
 30014 2nd Court S. Federal Way, WA 98003
 (253) 815-9182 Fax (253) 529-9438
 forsmenengineering.com ccast.net

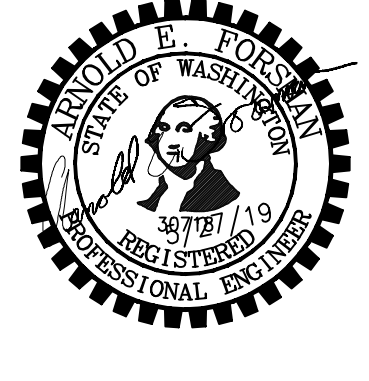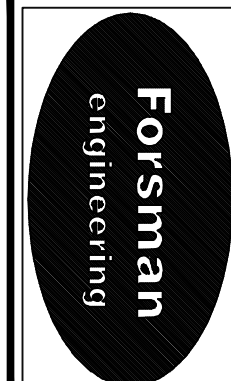


Valentin Residence
 4350 East Mercer Way
 Mercer Island Washington 98040


Standard Structural Notes

DESIGNED	MR
DRAWN	RL/SRL
CHECKED	RLJ
DATE	02/10/19
PROJECT	18062
FILENAME	18062-SD-DWG
PLOT AT	1 = 1/8"
SCALE	NONE


SD1

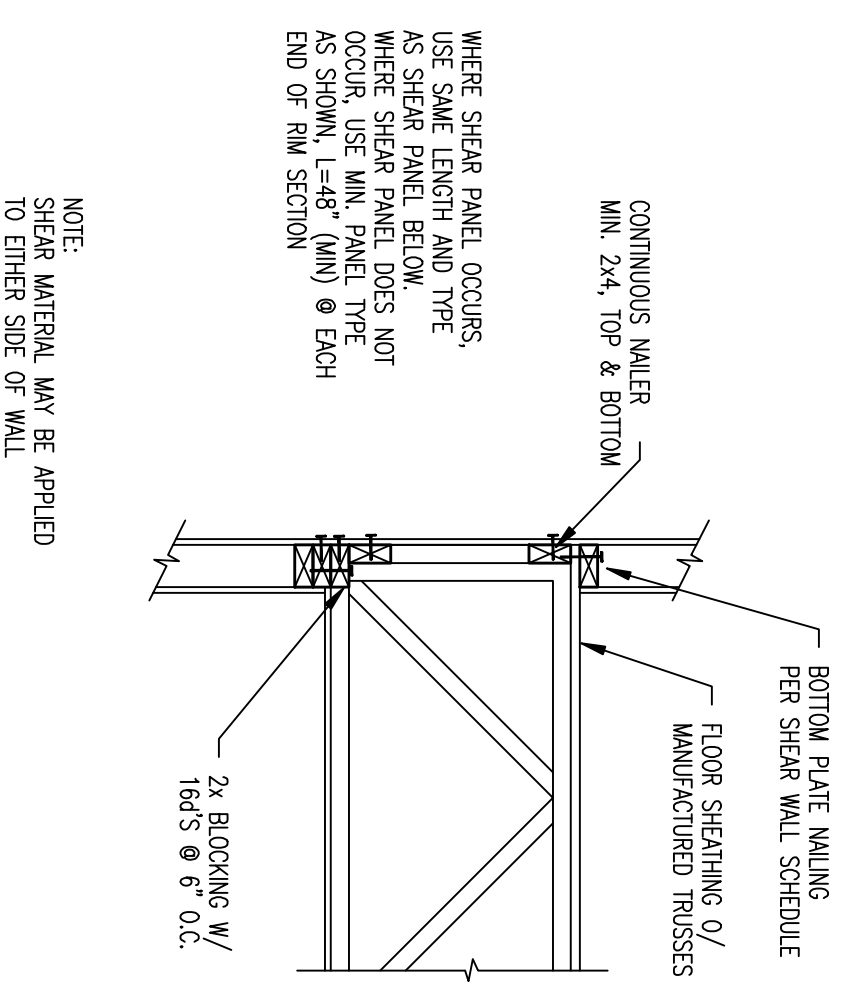


8 JOISTS PERPENDICULAR TO WALL
3/4" = 1'-0"

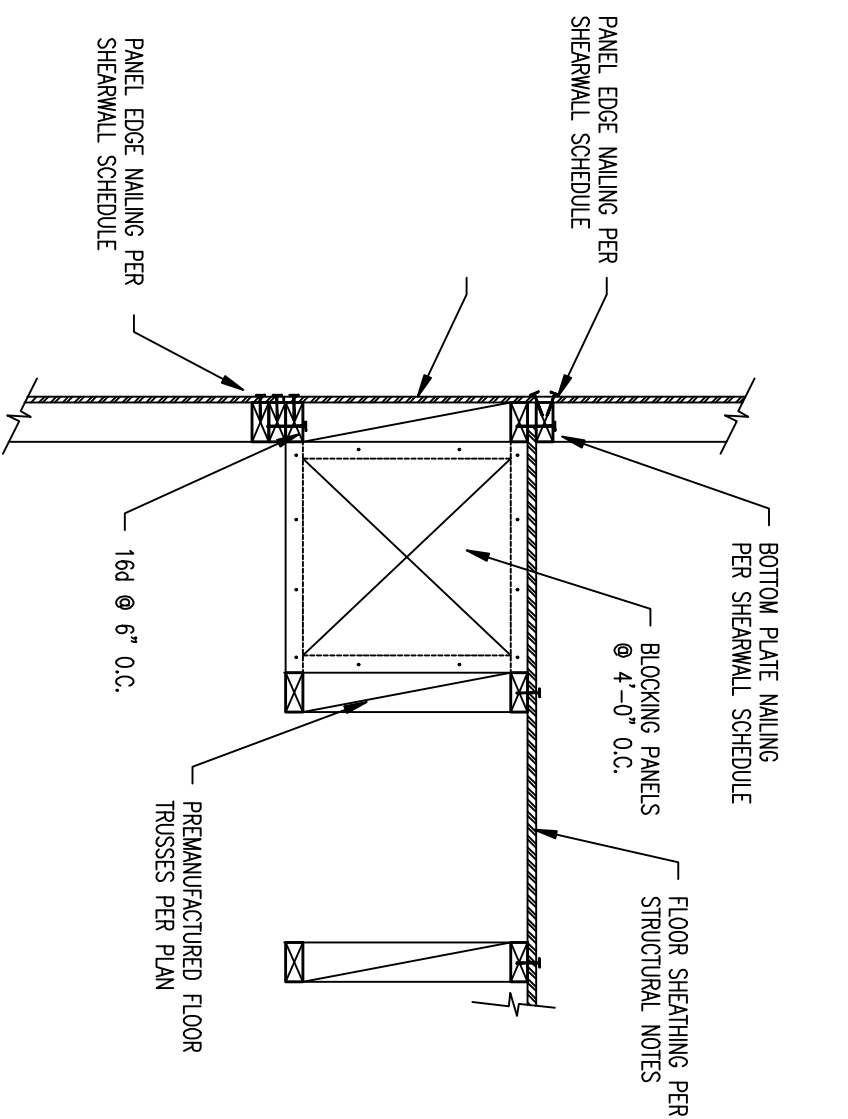


9 FLOOR TRUSS TO EXTERIOR WALL (TRUSSES PARALLEL)
3/4" = 1'-0"

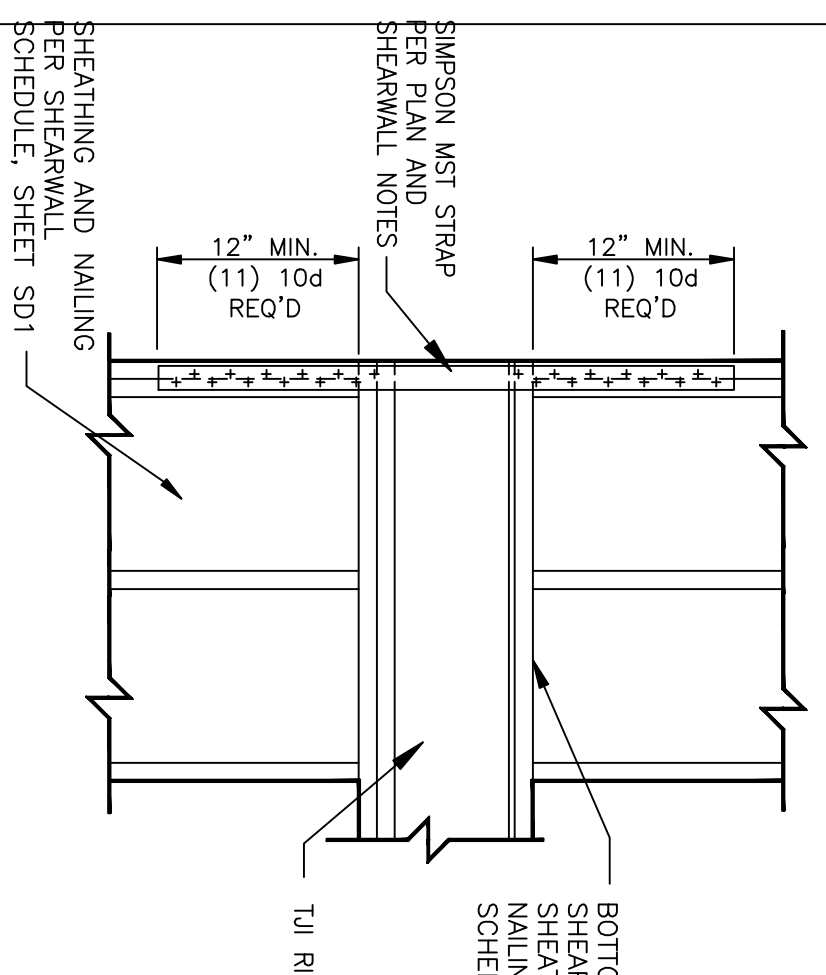


10 TYPICAL HOLD-DOWN BETWEEN FLOORS
3/4" = 1'-0"

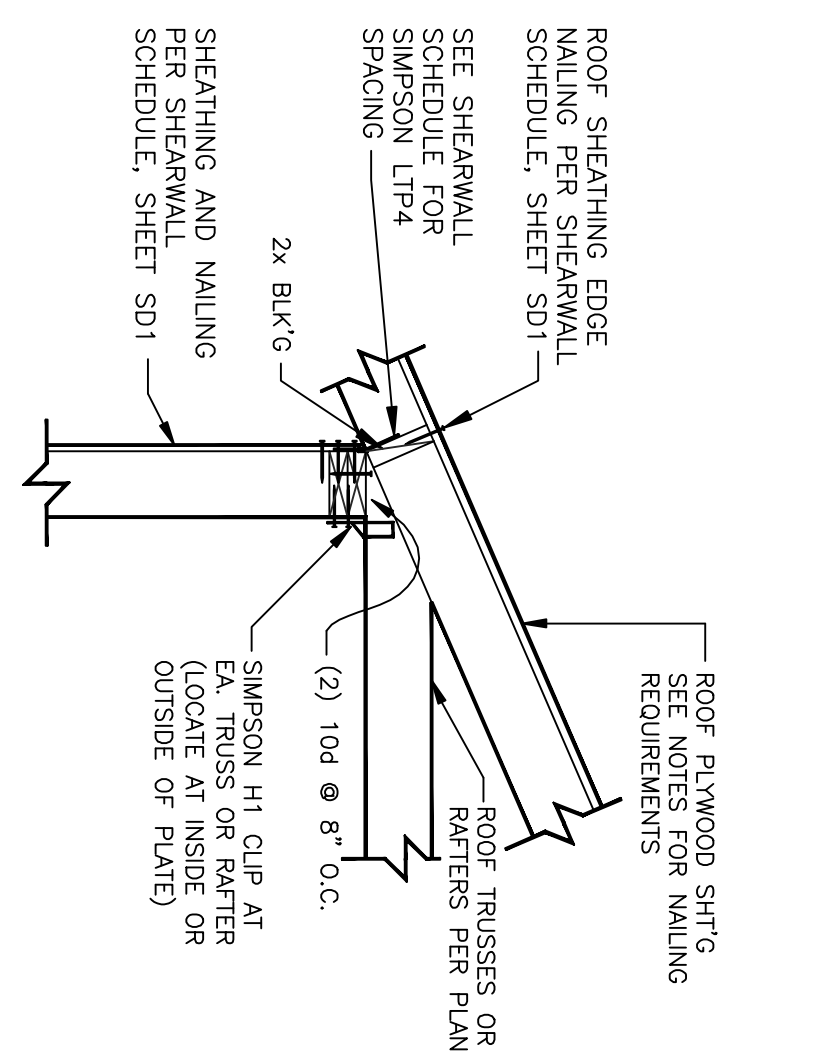


16 SECTION - ROOF TRUSS PERPENDICULAR
3/4" = 1'-0"

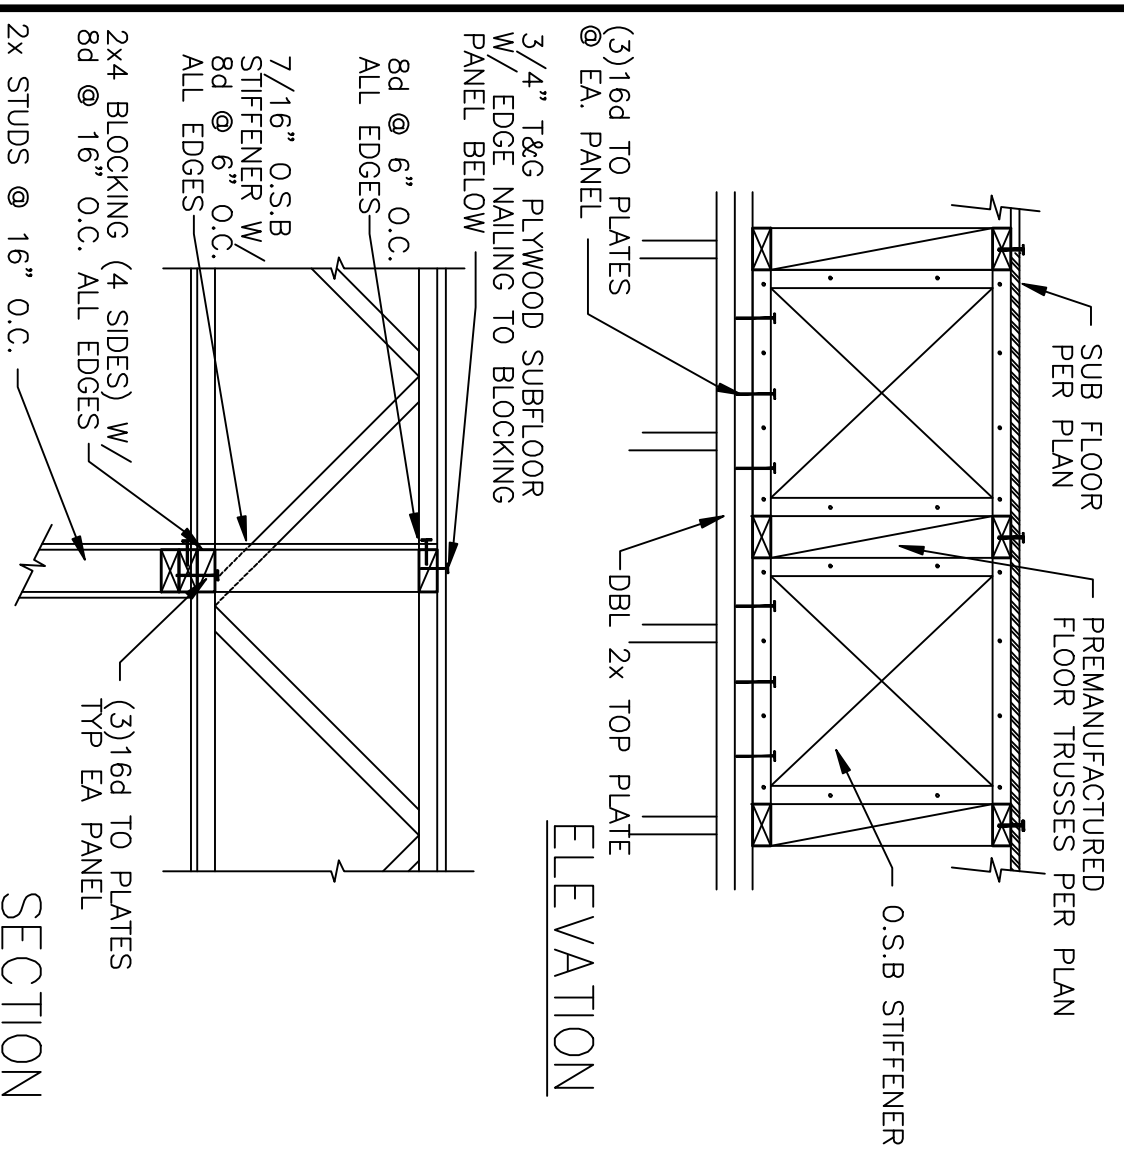


7 FLOOR TRUSS BLOCKING
3/4" = 1'-0"

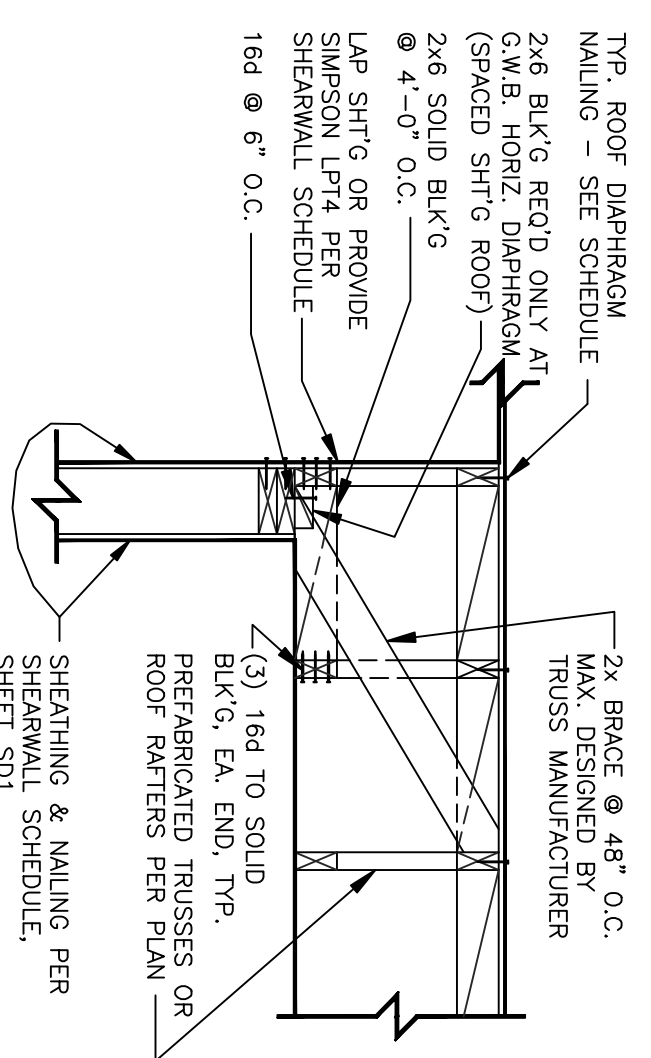


17 SECTION - ROOF TRUSS PARALLEL
3/4" = 1'-0"

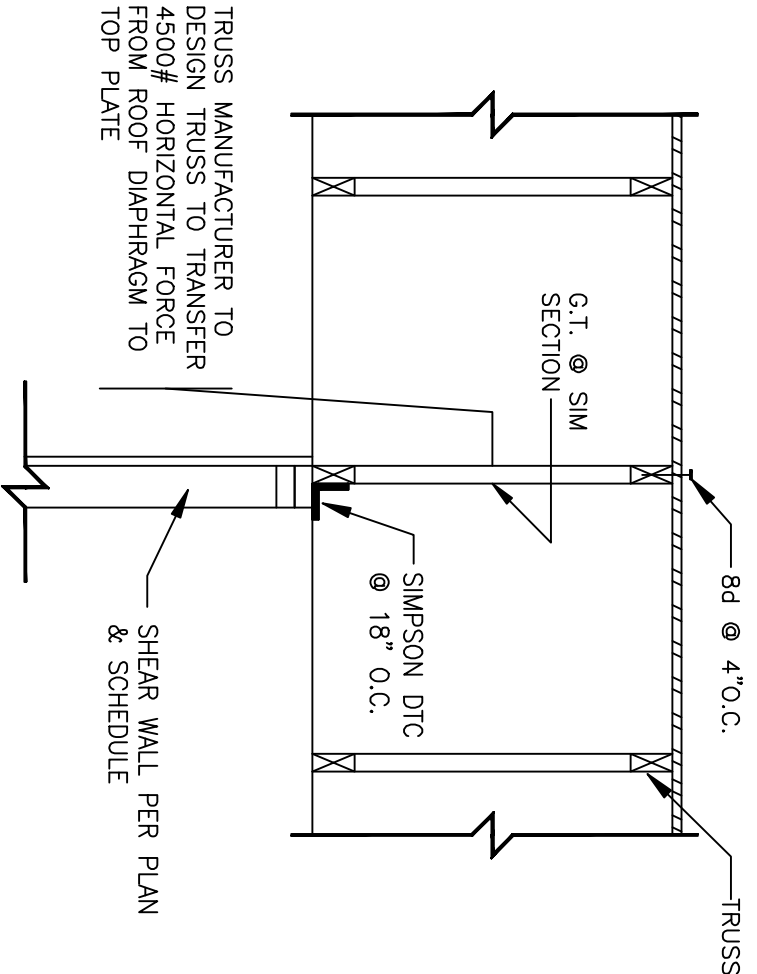


43 PARALLEL TRUSS TRANSFER
3/4" = 1'-0"

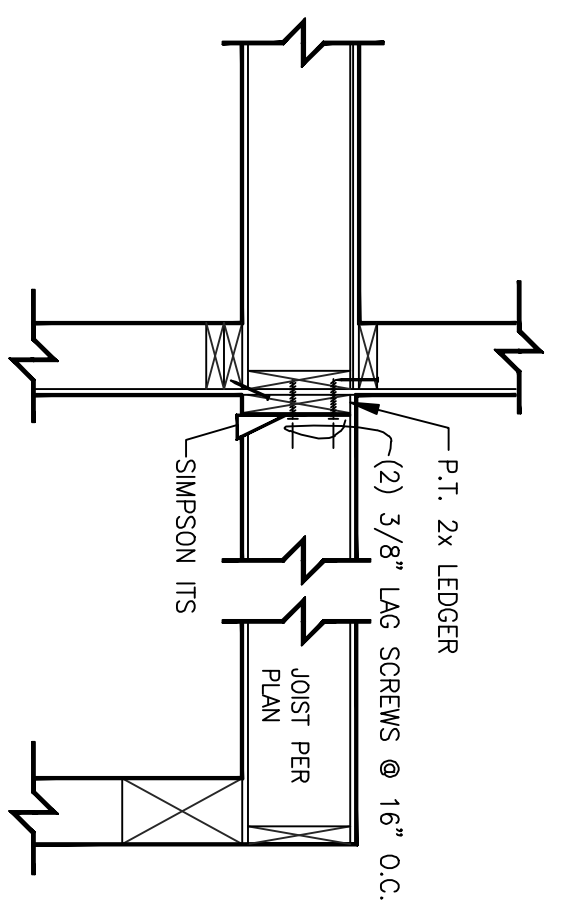

44 SECTION AT DECK
3/4" = 1'-0"

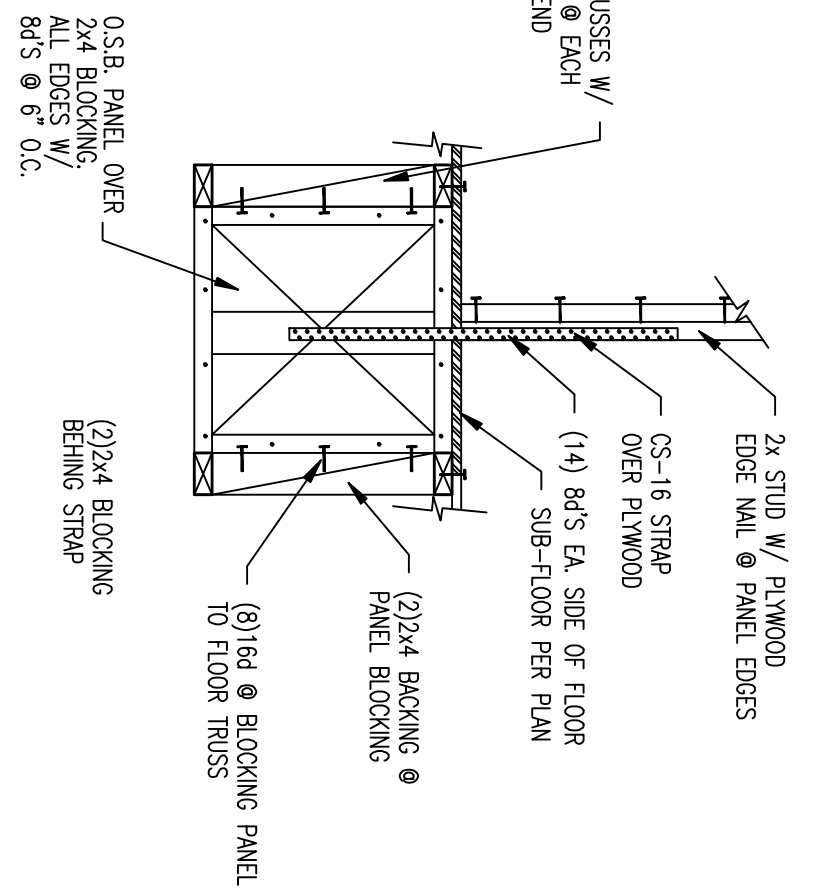


55 2ND FLOOR HD STRAP TO BLK'G PANEL
3/4" = 1'-0"

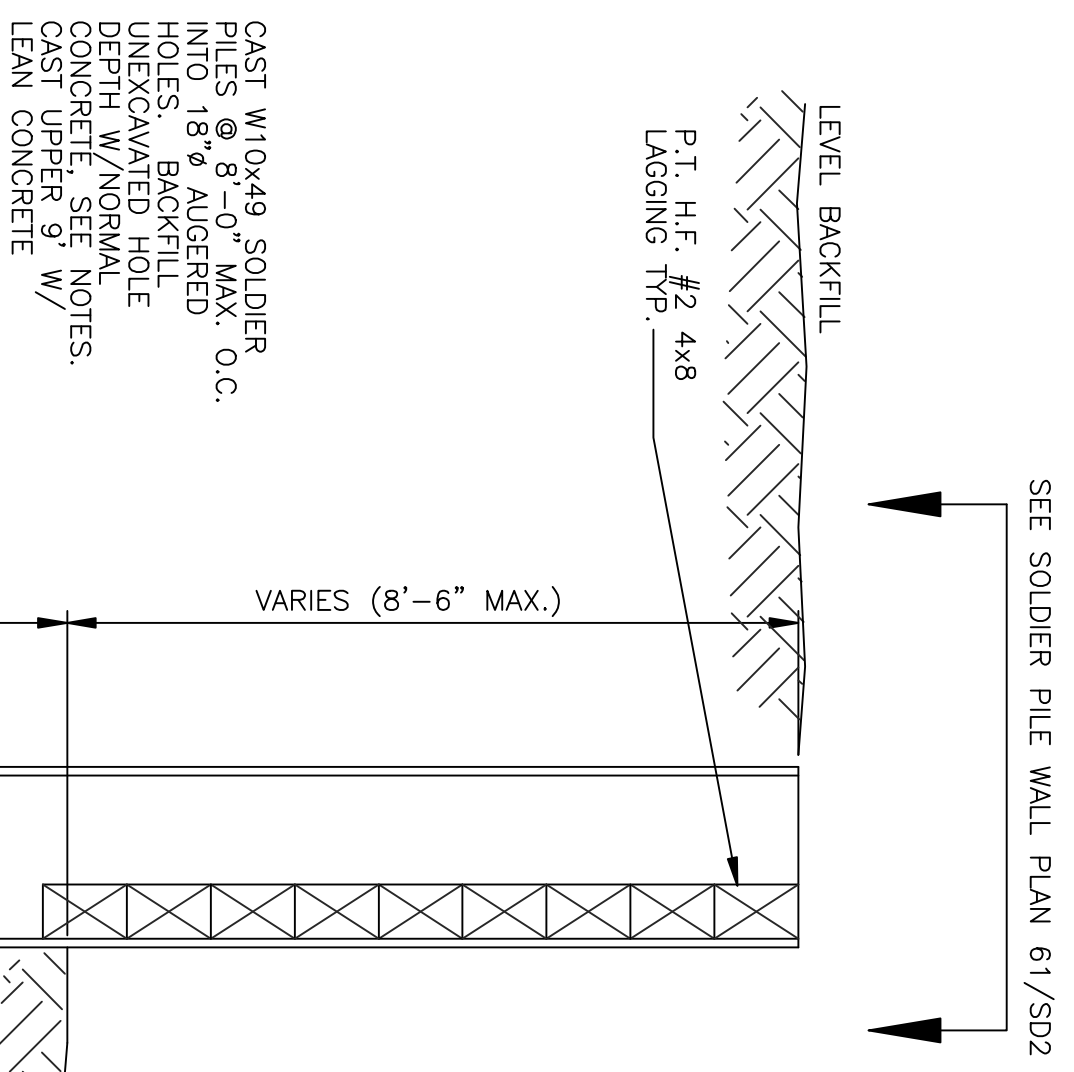

CAST W10x49 SOLDIER PILES @ 8'-0" MAX. O.C. HOLES, BACKFILL DNECAVATED HOLE DENSELY WITH NORMAL WEIGHT CAST UPPER 9" W/ LEAN CONCRETE

DESIGN CRITERIA:
ACTIVE PRESSURE = 45 psf
PASSIVE PRESSURE = 300 psf
2xPILE DIA.

60 SOLDIER PILE WALL SECTION
1/2" = 1'-0"

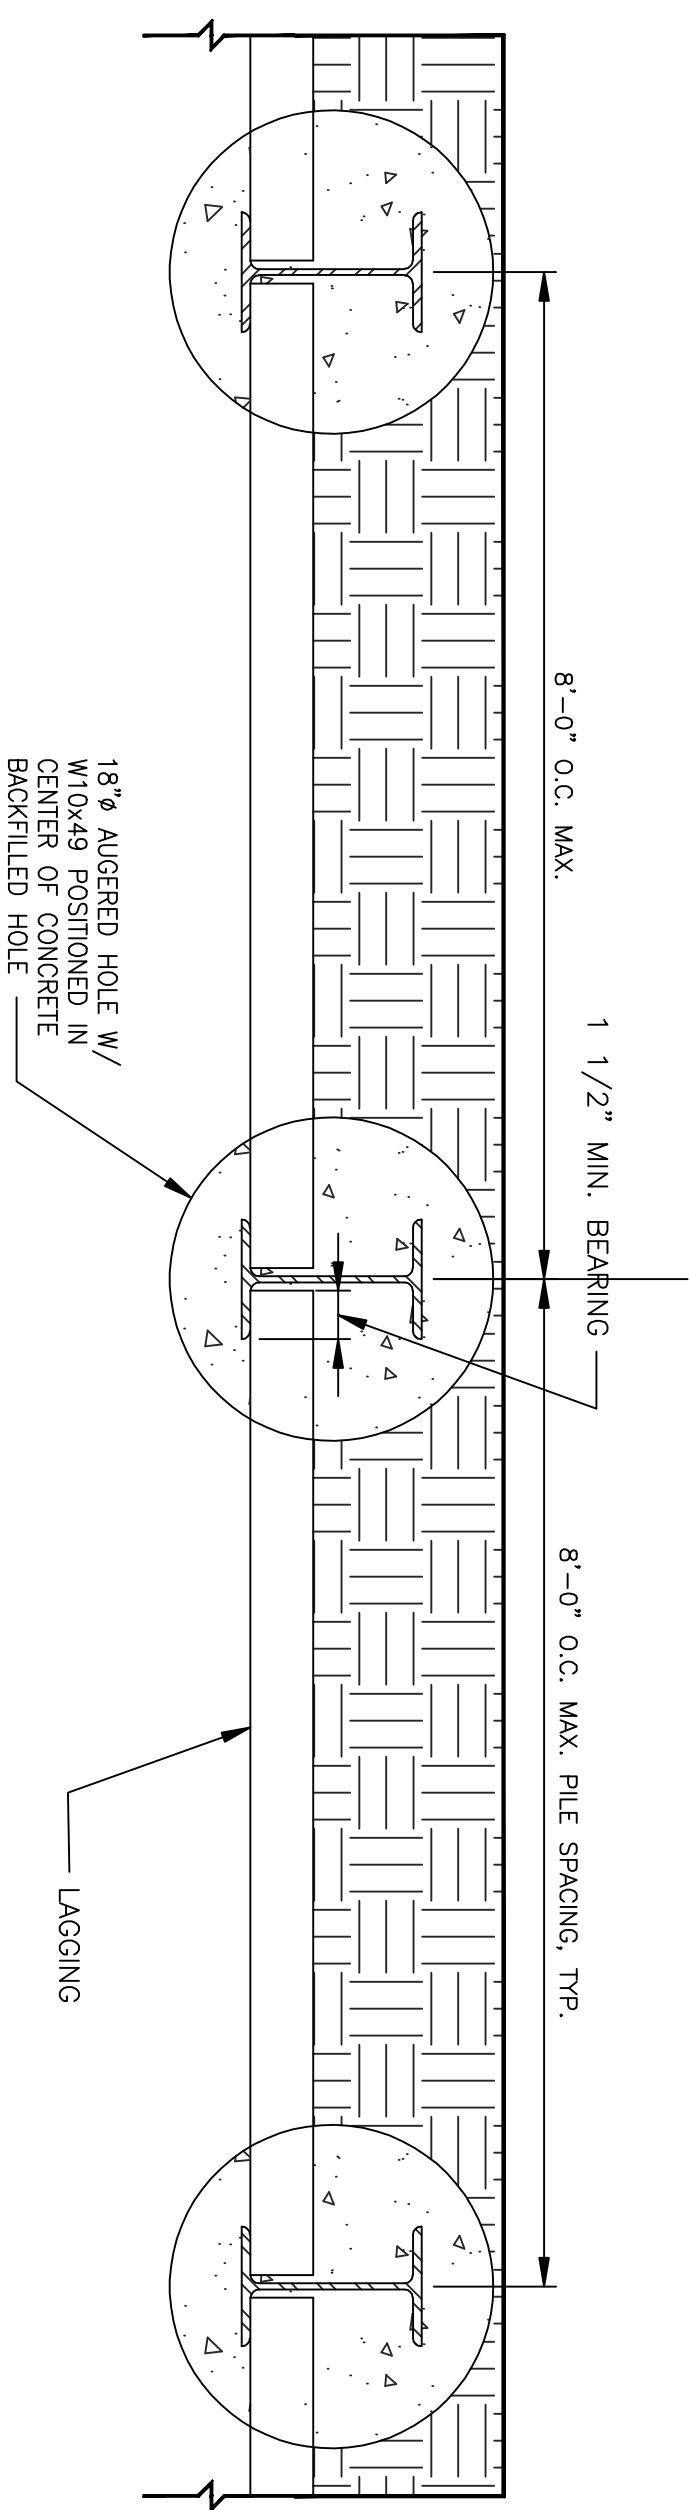

61 SOLDIER PILE WALL PLAN
1/2" = 1'-0"

Valentin Residence
4350 East Mercer Way
Mercer Island Washington 98040

Standard Structural Details





COPYRIGHT 2019 FORZMAN ENGINEERING

REVISIONS	BY	DATE
1	MODIFICATIONS PER ENGINEER	SRL 5/27/19
2		
3		
4		
5		
6		
7		

FORZMAN ENGINEERING
30014 2nd Court S. Federal Way, WA 98003
(253) 815-9182 Fax (253) 529-9438
forzmanengineering@comcast.net


Forzman
engineering

DESIGNED	ME
DRAWN	RLJ/SRL
CHECKED	RLJ
DATE	5/27/19
PROJECT	18062
FILENAME	18062-SD2.DWG
PLOT AT	1 = 18
SCALE	AS NOTED

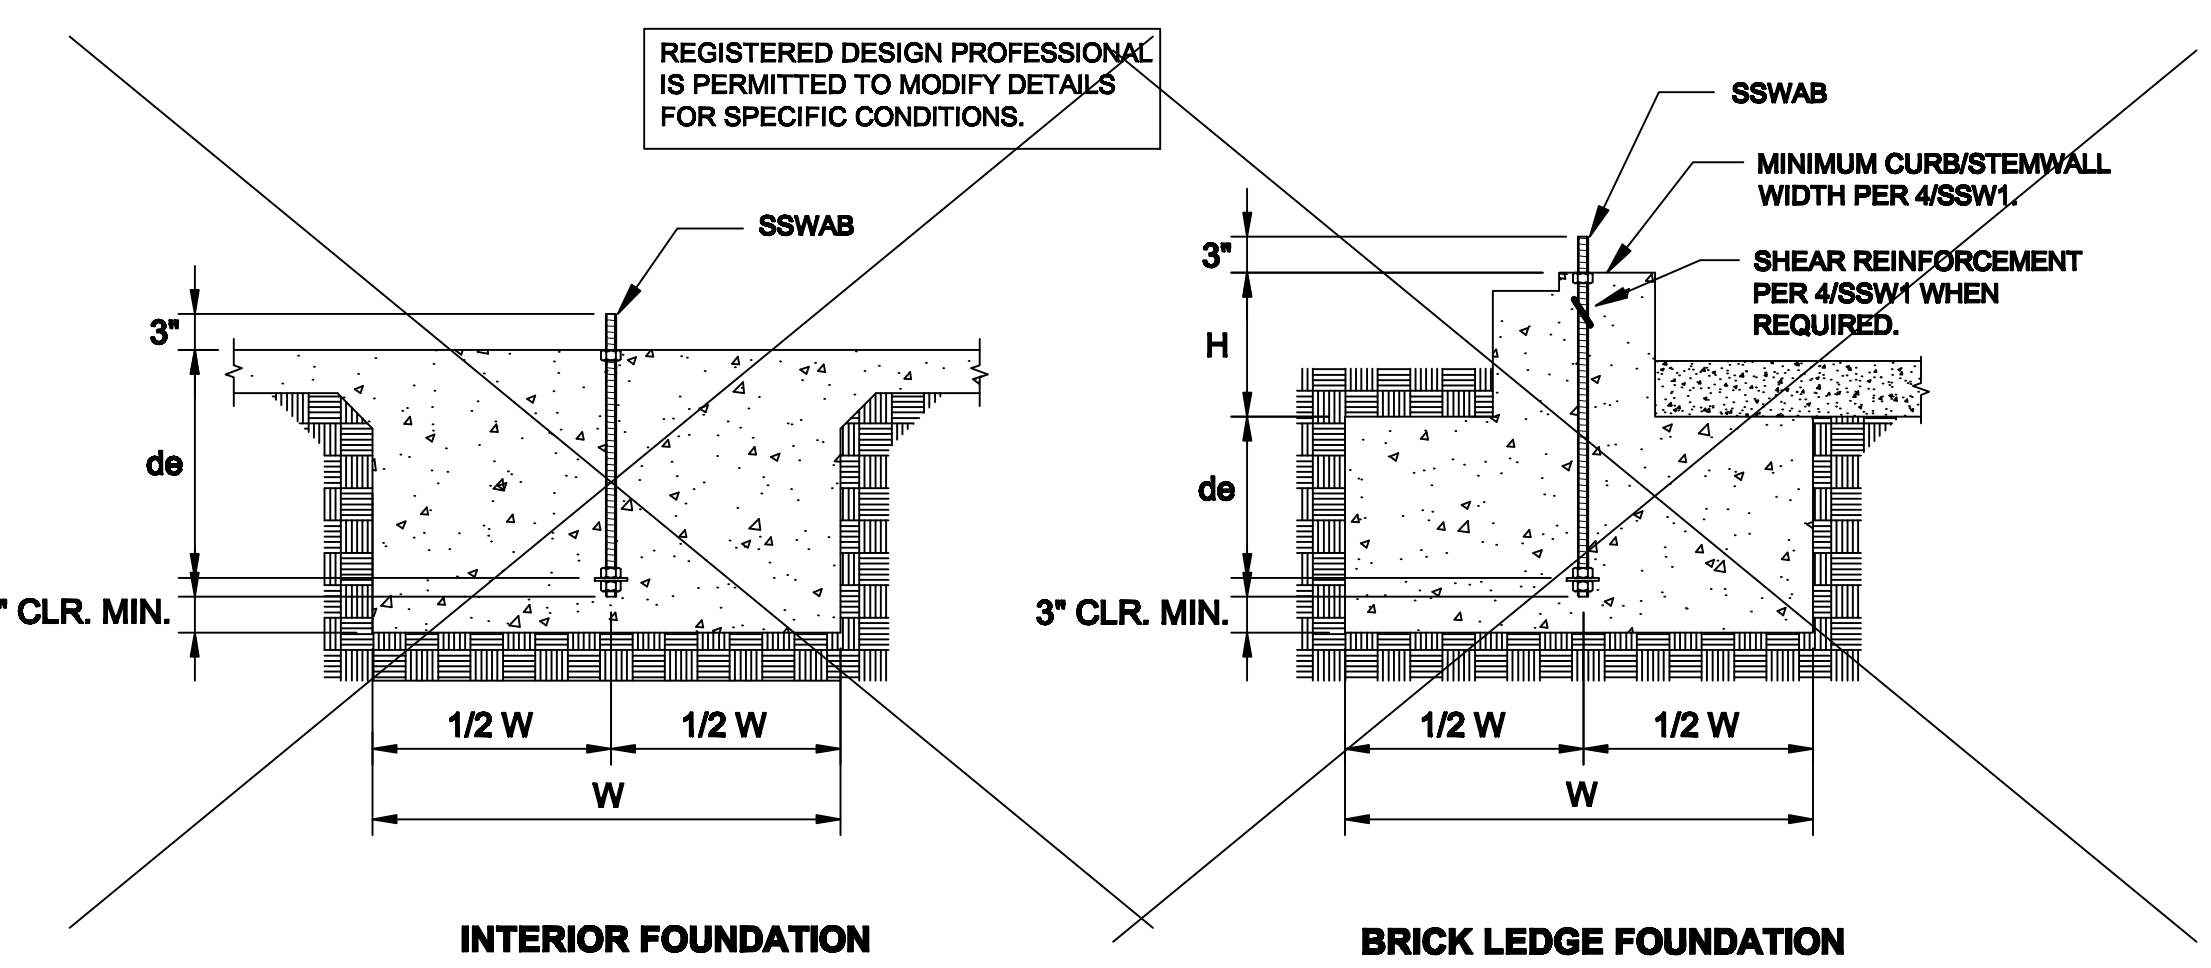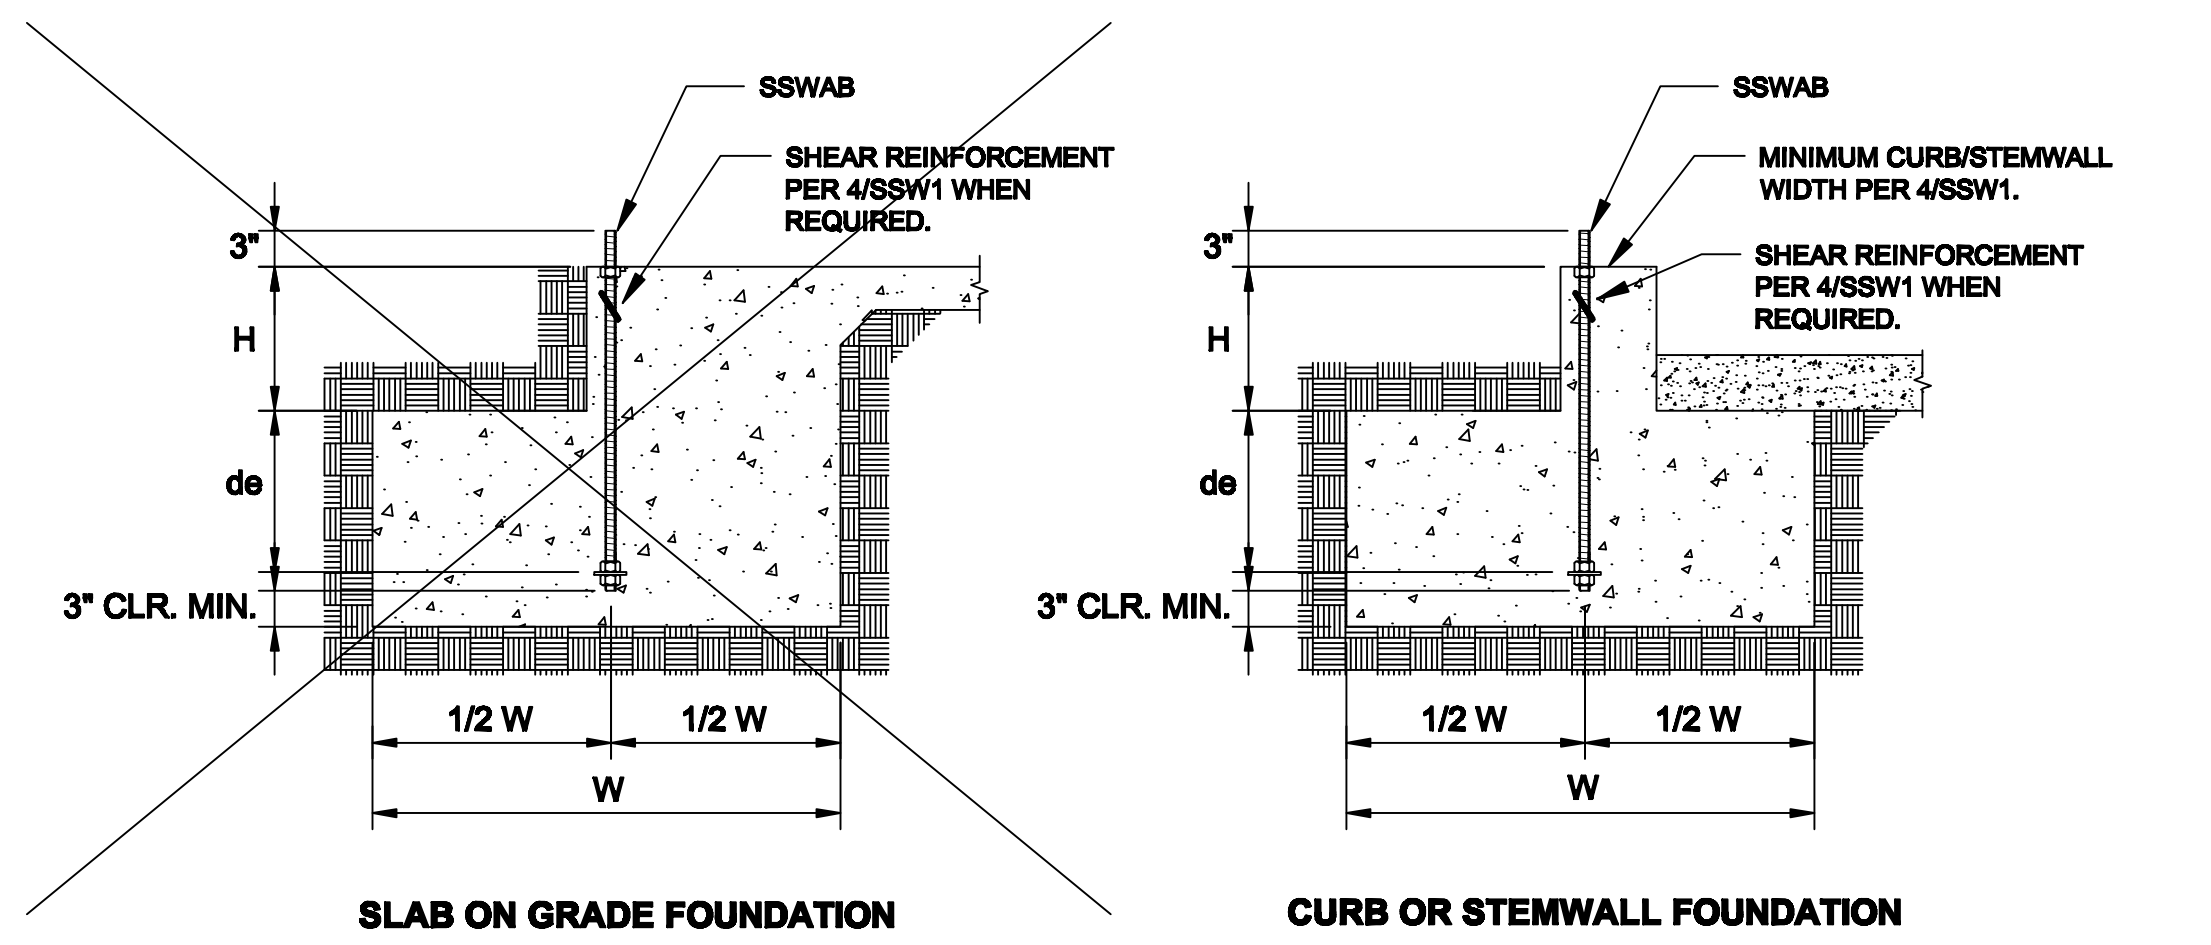

NOTES:
 1. SEE 2/SSW1 AND 3/SSW1 FOR DIMENSIONS AND ADDITIONAL NOTES.
 2. SEE 4/SSW1 FOR SHEAR REINFORCEMENT WHEN REQUIRED.
 3. MAXIMUM H = l_e - d_e. SEE 5/SSW1 AND 6/SSW1 FOR l_e.

STEEL STRONG-WALL ANCHORAGE - TYPICAL SECTIONS 1

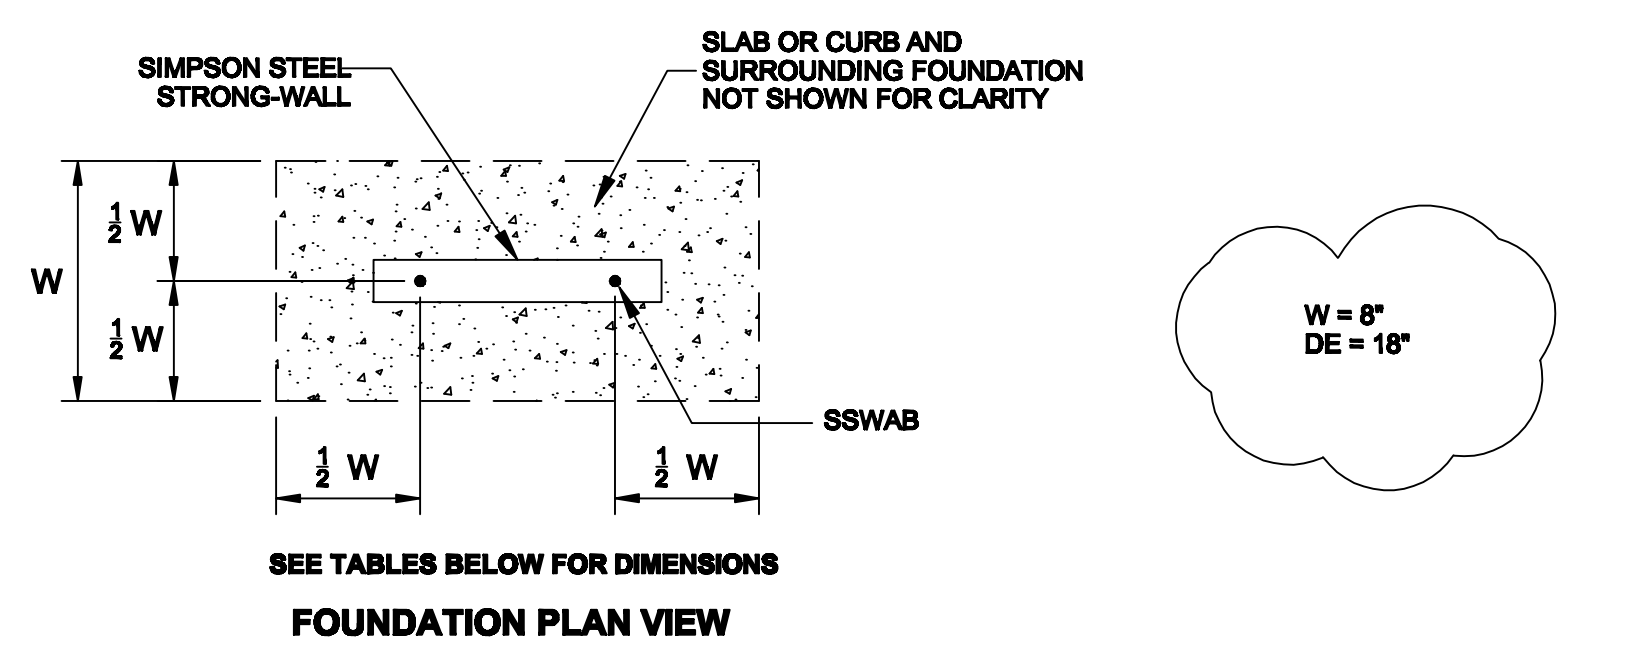

STEEL STRONG-WALL ANCHORAGE SOLUTIONS FOR 2500 PSI CONCRETE

DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	SSWAB 3/4" ANCHOR BOLT			SSWAB 1" ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbe)	W (in)	d _e (in)	ASD ALLOWABLE UPLIFT (lbe)	W (in)	d _e (in)
SEISMIC	CRACKED	STANDARD *	8,800	22	8	16,100	33	11
		HIGH STRENGTH	9,800	24	8	17,100	35	12
			16,500	36	12	33,000	61	17
	UNCRAKED	STANDARD	8,800	19	7	15,700	28	10
		HIGH STRENGTH	9,800	21	7	17,100	30	10
			16,300	31	11	32,300	44	15
WIND	CRACKED	STANDARD *	5,100	14	6	8,200	16	6
		HIGH STRENGTH	7,400	18	6	11,400	24	8
			9,800	22	8	17,100	32	11
	UNCRAKED	STANDARD	5,000	12	6	6,400	14	6
		HIGH STRENGTH	7,800	16	6	12,500	22	8
			9,800	19	7	17,100	28	10

NOTES:
 1. ANCHORAGE DESIGNS CONFORM TO ACI 318-14 AND ACI 318-11 APPENDIX D WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
 2. ANCHOR STRENGTH INDICATES REQUIRED GRADE OF SSWAB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A448).
 3. SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SD C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-11 SECTION D.3.3.4.
 4. WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SD C.
 5. FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
 6. REFER TO 1/SSW1 FOR d_e.


SSWAB TENSION ANCHORAGE SCHEDULE 2500 PSI 2

STEEL STRONG-WALL ANCHORAGE SOLUTIONS FOR 3500 PSI CONCRETE

DESIGN CRITERIA	CONCRETE CONDITION	ANCHOR STRENGTH	SSWAB 3/4" ANCHOR BOLT			SSWAB 1" ANCHOR BOLT		
			ASD ALLOWABLE UPLIFT (lbe)	W (in)	d _e (in)	ASD ALLOWABLE UPLIFT (lbe)	W (in)	d _e (in)
SEISMIC	CRACKED	STANDARD	9,800	20	7	15,700	29	10
		HIGH STRENGTH	9,800	21	7	17,100	31	11
			18,200	32	11	33,000	48	18
	UNCRAKED	STANDARD	19,900	34	12	35,300	48	18
		HIGH STRENGTH	8,800	17	6	15,700	25	9
			9,800	19	7	17,100	27	9
WIND	CRACKED	STANDARD	6,000	14	6	7,300	16	6
		HIGH STRENGTH	7,300	16	6	13,500	24	8
			9,800	20	7	17,100	29	10
	UNCRAKED	STANDARD	11,800	22	8	22,700	34	12
		HIGH STRENGTH	13,500	24	8	27,400	38	13
			17,000	28	10	32,300	42	14

NOTES:
 1. ANCHORAGE DESIGNS CONFORM TO ACI 318-14 AND ACI 318-11 APPENDIX D WITH NO SUPPLEMENTARY REINFORCEMENT FOR CRACKED OR UNCRACKED CONCRETE AS NOTED.
 2. ANCHOR STRENGTH INDICATES REQUIRED GRADE OF SSWAB ANCHOR BOLT. STANDARD (ASTM F1554 GRADE 36) OR HIGH STRENGTH (HS) (ASTM A448).
 3. SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SD C MAY USE WIND ANCHORAGE SOLUTIONS. SEISMIC ANCHORAGE DESIGNS CONFORM TO ACI 318-14 SECTION 17.2.3.4.3 AND ACI 318-11 SECTION D.3.3.4.
 4. WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B AND DETACHED 1 AND 2 FAMILY DWELLINGS IN SD C.
 5. FOUNDATION DIMENSIONS ARE FOR ANCHORAGE ONLY. FOUNDATION DESIGN (SIZE AND REINFORCEMENT) BY OTHERS. THE REGISTERED DESIGN PROFESSIONAL MAY SPECIFY ALTERNATE EMBEDMENT, FOOTING SIZE OR ANCHOR BOLT.
 6. SEE 1/SSW1 AND 2/SSW1 FOR W AND d_e.

SSWAB TENSION ANCHORAGE SCHEDULE 3500/4500 PSI 3

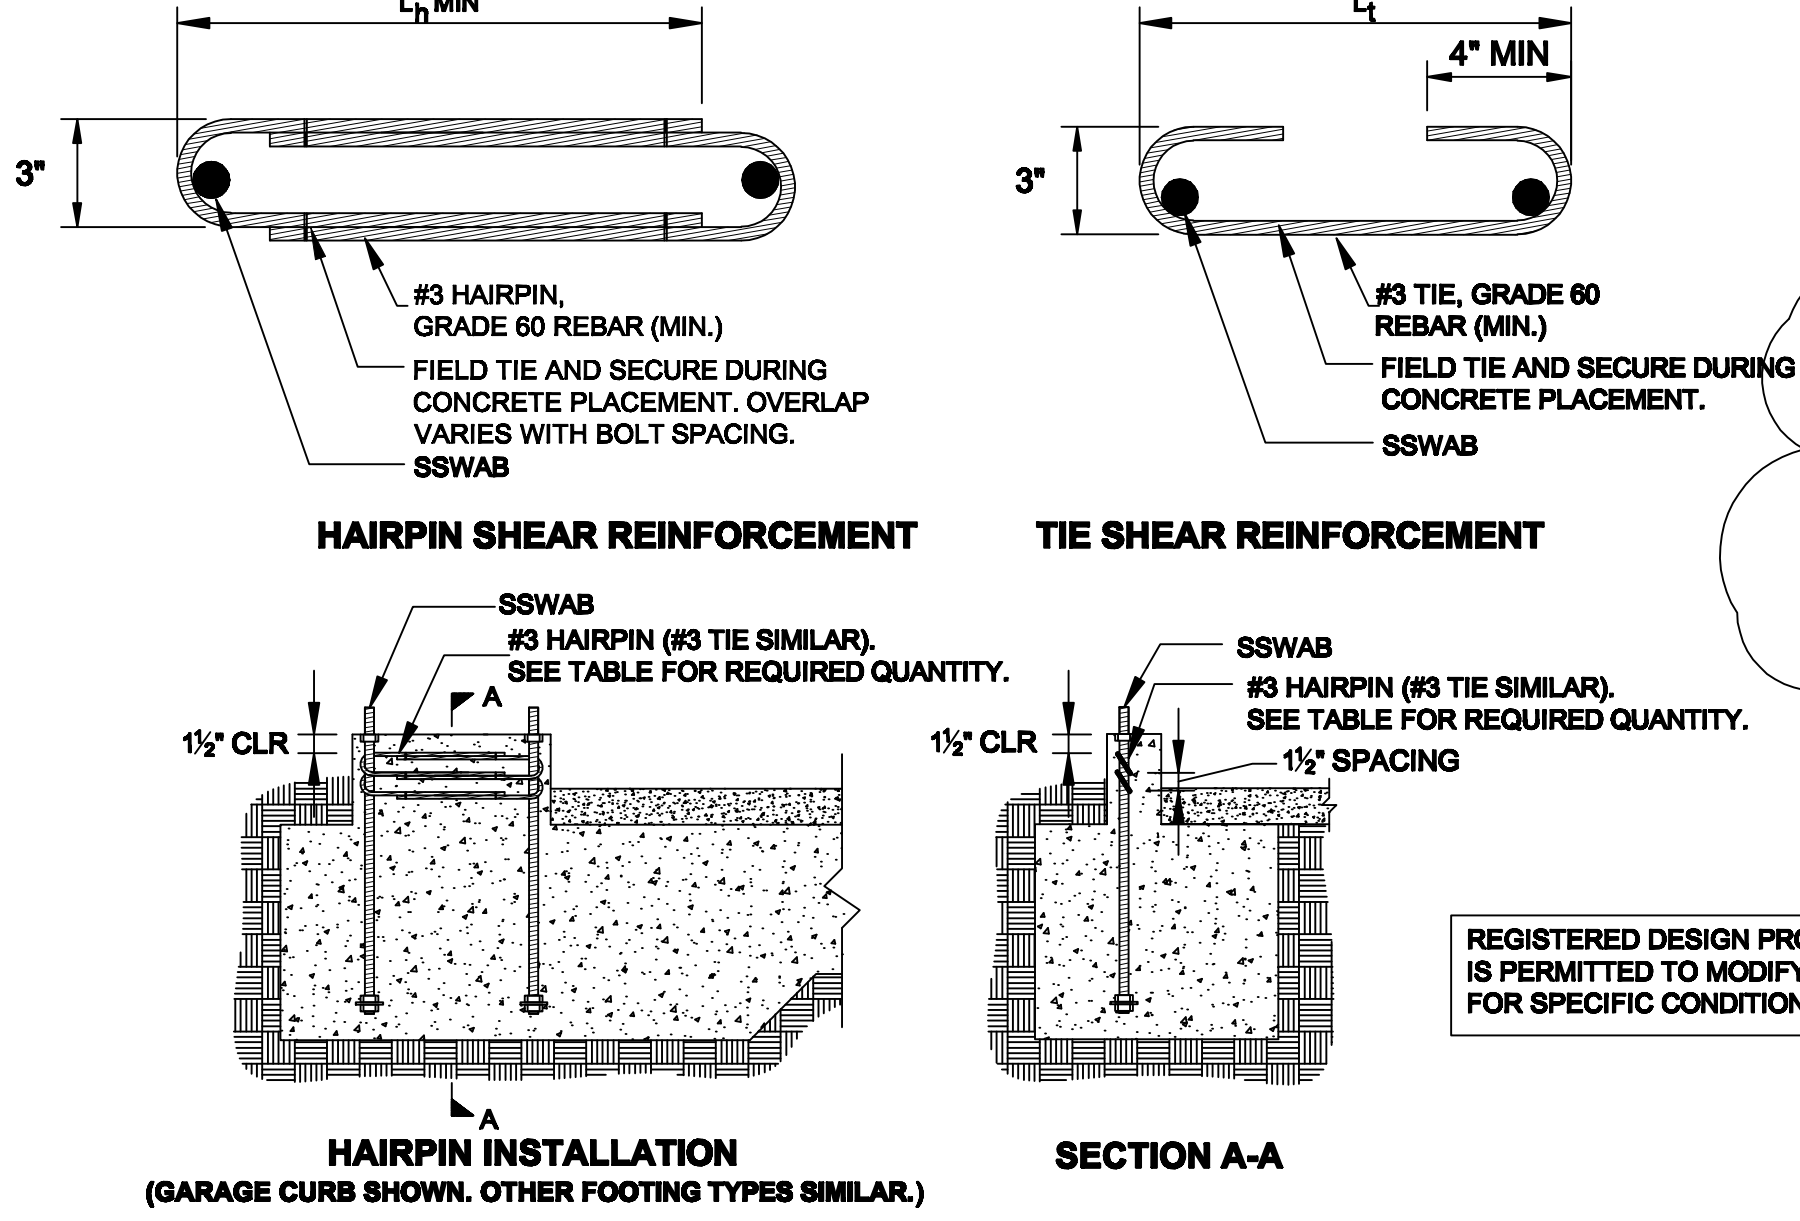


STEEL STRONG-WALL SHEAR ANCHORAGE

MODEL	L ₁ OR L ₂ (in)	SHEAR REINFORCEMENT	MIN. CURB / STEMWALL WIDTH (in)	SHEAR REINFORCEMENT	MIN. CURB / STEMWALL WIDTH (in)	ASD ALLOWABLE SHEAR LOAD V (lbe) *			
						6" MIN CURB / STEMWALL		8" MIN CURB / STEMWALL	
						UNCRAKED	CRACKED	UNCRAKED	CRACKED
SSW12	9	(1) #3 TIE	6	NONE REQUIRED	-	1230	880	1440	1030
SSW15	12	(2) #3 TIES	6	NONE REQUIRED	-	1560	1135	1810	1295
SSW18	14	(1) #3 HAIRPIN	6"	(1) #3 HAIRPIN	6	HAIRPIN REINFORCEMENT ACHIEVES MAXIMUM ALLOWABLE SHEAR LOAD OF THE STEEL STRONG-WALL PANEL			
SSW21	15	(2) #3 HAIRPIN	6"	(1) #3 HAIRPIN	6				
SSW24	17	(2) #3 HAIRPIN	6"	(1) #3 HAIRPIN	6				



NOTES:
 1. SHEAR ANCHORAGE DESIGNS CONFORM TO ACI 318-14 AND ACI 318-11 AND ASSUME MINIMUM f_c = 2,500 PSI CONCRETE. SEE DETAILS 1/SSW1 TO 3/SSW1 FOR TENSION ANCHORAGE.
 2. SHEAR REINFORCEMENT IS NOT REQUIRED FOR PANELS INSTALLED ON A WOOD FLOOR, INTERIOR FOUNDATION APPLICATIONS (PANEL INSTALLED AWAY FROM EDGE OF CONCRETE), OR BRACED WALL PANEL APPLICATIONS.
 3. SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SD C MAY USE WIND ANCHORAGE SOLUTIONS.
 4. WIND INCLUDES SEISMIC DESIGN CATEGORY A AND B.
 5. MINIMUM CURB/STEMWALL WIDTH IS 6" WHEN STANDARD STRENGTH SSWAB IS USED.
 6. USE (1) #3 TIE FOR SSW12 AND SSW15 WHEN THE STEEL STRONG-WALL PANEL DESIGN SHEAR FORCE EXCEEDS THE TABULATED ANCHORAGE ALLOWABLE SHEAR LOAD.
 7. CONCRETE EDGE DISTANCE FOR ANCHORS MUST COMPLY WITH ACI 318-14 SECTION 17.7.2 AND ACI 318-11 D.8.2.

STEEL STRONG-WALL ANCHOR BOLT SHEAR ANCHORAGE 4

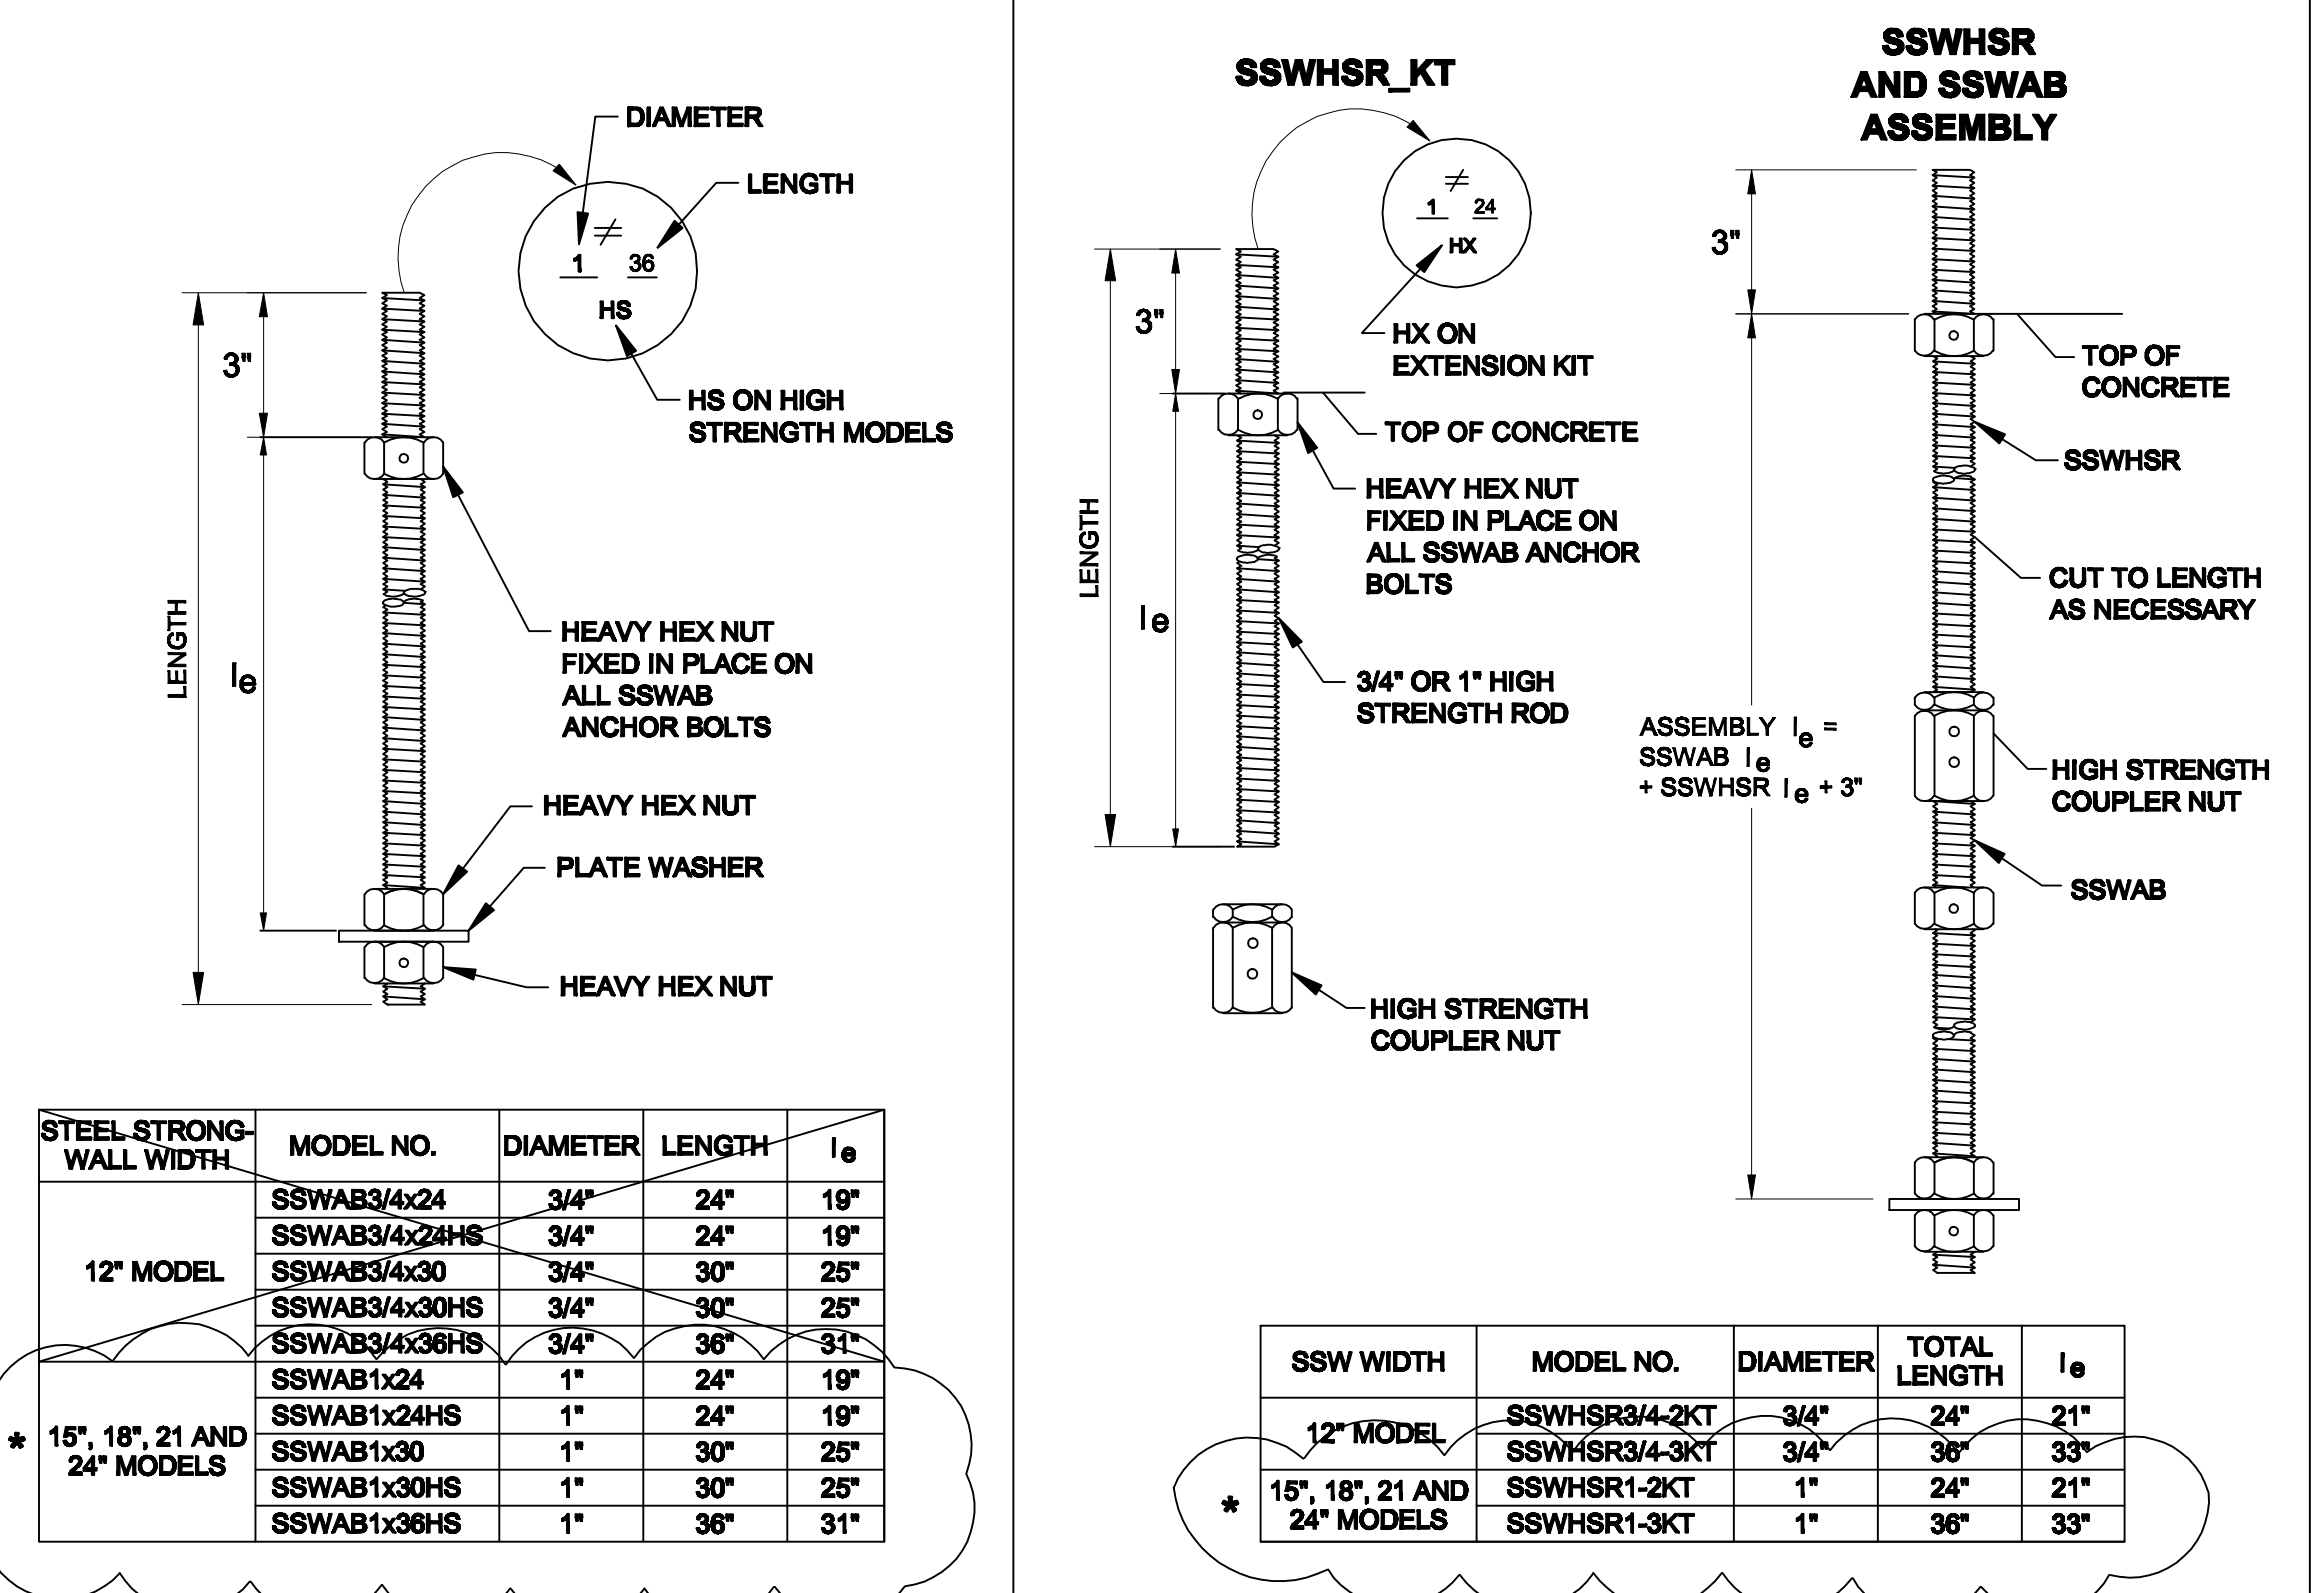

STEEL STRONG-WALL ANCHOR BOLT SHEAR ANCHORAGE

STEEL STRONG-WALL WIDTH	MODEL NO.	DIAMETER	LENGTH	l _e
12" MODEL	SSWAB3/4x24	3/4"	24"	19"
	SSWAB3/4x24HS	3/4"	24"	19"
	SSWAB3/4x30	3/4"	30"	25"
	SSWAB3/4x30HS	3/4"	30"	25"
	SSWAB3/4x36HS	3/4"	36"	31"
	SSWAB1x24	1"	24"	19"
15", 18", 21 AND 24" MODELS	SSWAB1x24HS	1"	24"	19"
	SSWAB1x30	1"	30"	25"
	SSWAB1x30HS	1"	30"	25"
	SSWAB1x36HS	1"	36"	31"

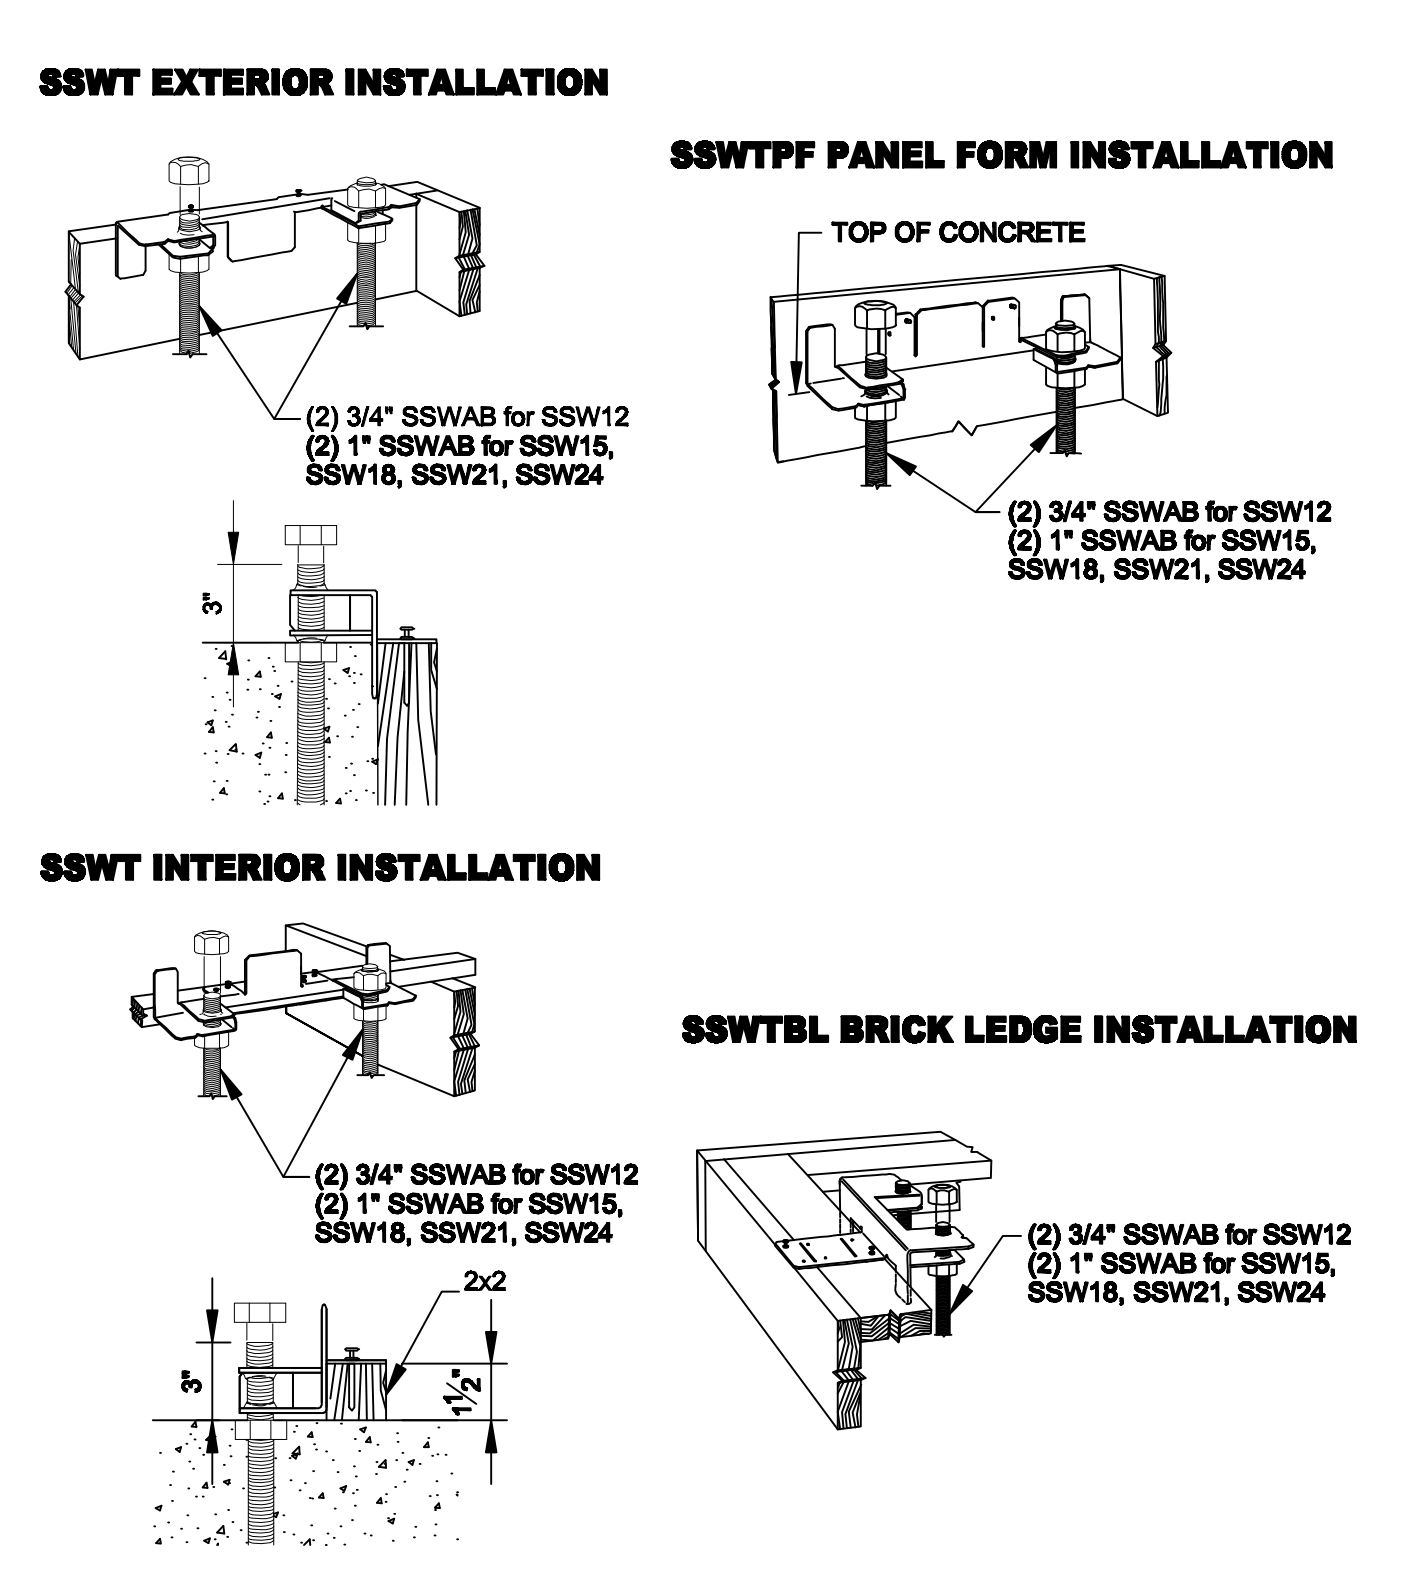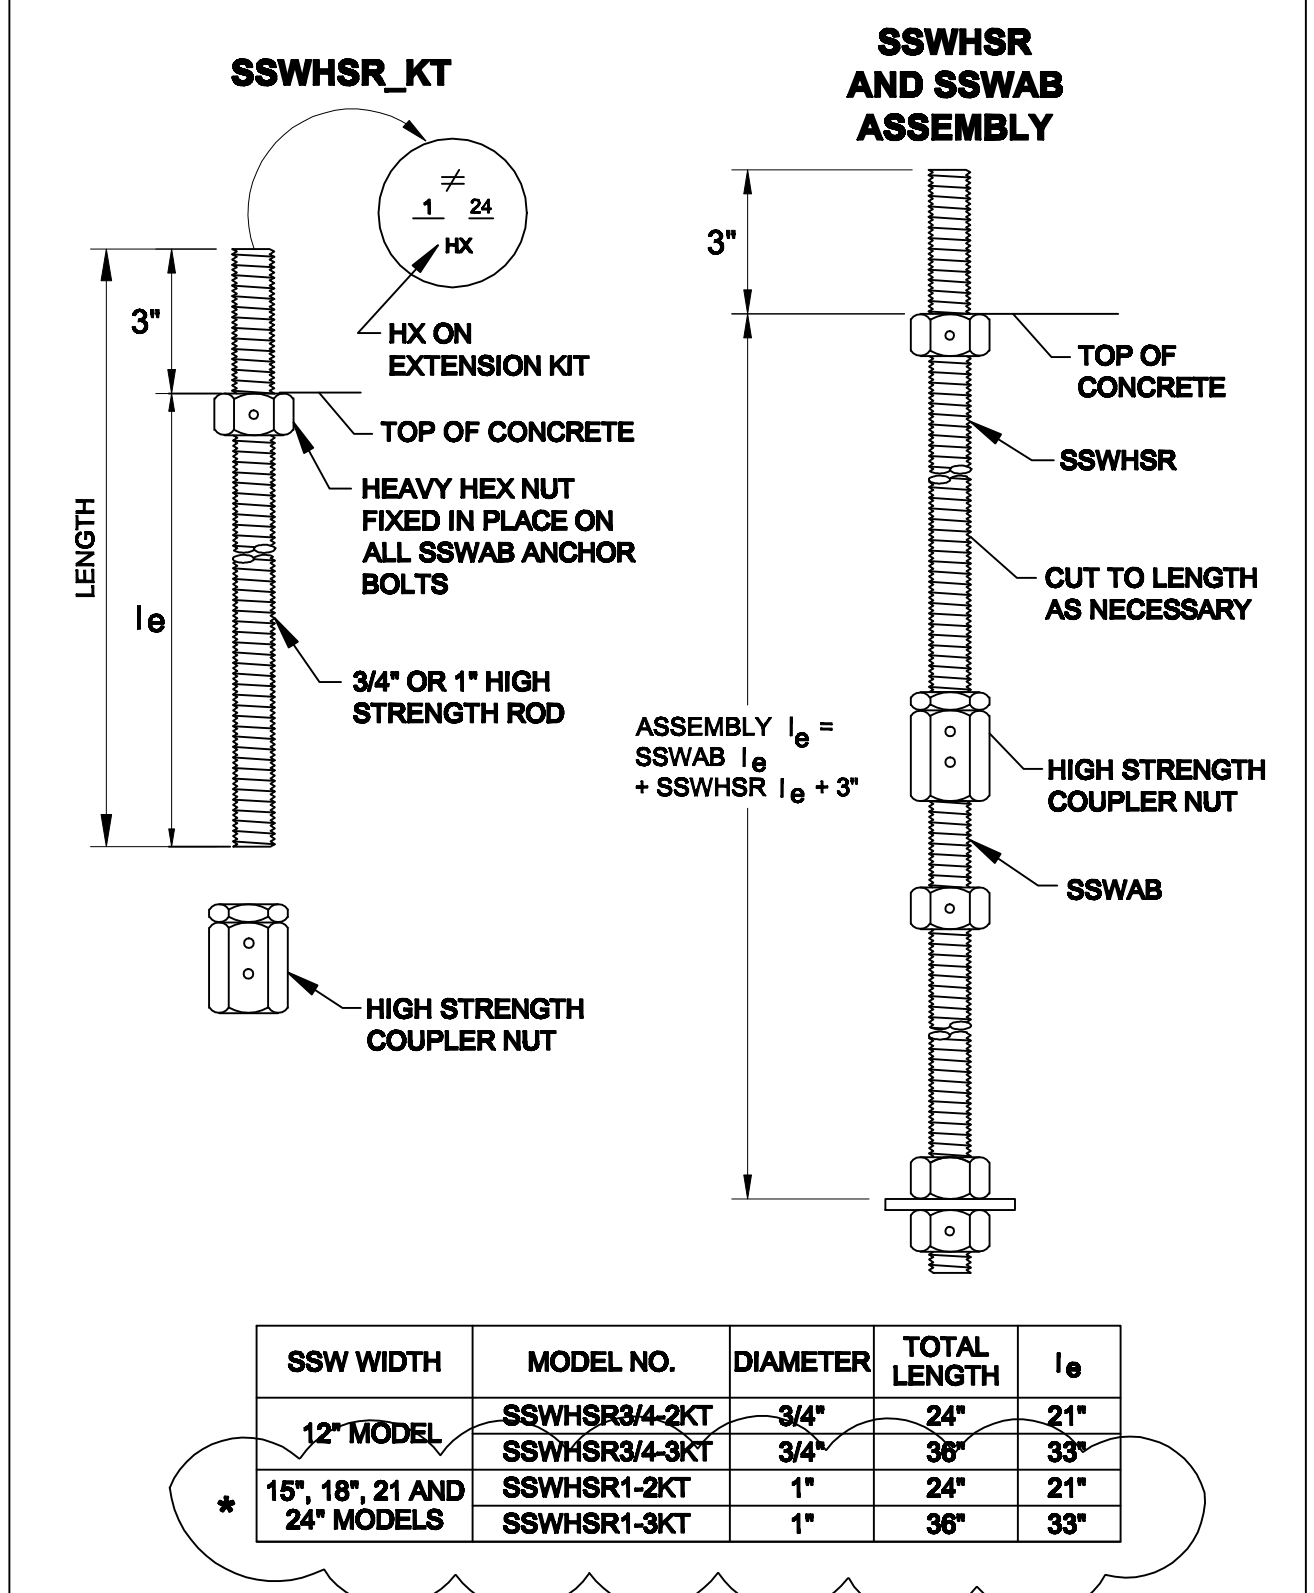

SSW ANCHOR BOLTS 5

SSW ANCHOR BOLT EXTENSION 6

SSW ANCHOR BOLT TEMPLATES 7

REVISIONS

NO.	DATE	REVISIONS
1	9/27/2009	2008 IBC REVISIONS
2	4/18/2014	2012 IBC REVISIONS
3	8/08/2016	2015 IBC REVISIONS











SIMPSON STRONG-TIE COMPANY, INC.
 HOME OFFICE: 1955 WILKAS POSITAS BLVD., PLEASANTON, CA 94566
 TEL: (800) 999-5099
 THERE IS NO EQUAL

STEEL STRONG-WALL ANCHORAGE DETAILS ENGINEERED DESIGNS
 SIMPSON Strong-Tie
 THERE IS NO EQUAL

NAME: _____
 DATE: 8-8-2016
 SCALE: N.T.S.
 CHECKED: _____
 SHEET: **SSW1**
 OF SHEETS
 JOB NO. _____

STEEL STRONG-WALL MODELS

STD. WALL MODEL NO.	-STK WALL MODEL NO.	H (in)	T (in)	HOLD-DOWN ANCHOR BOLTS ²	QTY. OF TOP OF WALL SCREWS ¹
SSW12x7	--	80	3 1/2	(2) 3/4"	4
SSW15x7	--	80	3 1/2	(2) 1"	6
SSW18x7	--	80	3 1/2	(2) 1"	9
SSW21x7	--	80	3 1/2	(2) 1"	12
SSW24x7	--	80	3 1/2	(2) 1"	14
SSW12x7.4	--	85 1/2	3 1/2	(2) 3/4"	4
SSW15x7.4	--	85 1/2	3 1/2	(2) 1"	6
SSW18x7.4	--	85 1/2	3 1/2	(2) 1"	9
SSW21x7.4	--	85 1/2	3 1/2	(2) 1"	12
SSW24x7.4	--	85 1/2	3 1/2	(2) 1"	14
SSW12x8	--	93 1/4	3 1/2	(2) 3/4"	4
SSW15x8	--	93 1/4	3 1/2	(2) 1"	6
SSW18x8	--	93 1/4	3 1/2	(2) 1"	9
SSW21x8	--	93 1/4	3 1/2	(2) 1"	12
SSW24x8	--	93 1/4	3 1/2	(2) 1"	14
SSW12x9	--	105 1/4	3 1/2	(2) 3/4"	4
SSW15x9	--	105 1/4	3 1/2	(2) 1"	6
SSW18x9	--	105 1/4	3 1/2	(2) 1"	9
SSW21x9	--	105 1/4	3 1/2	(2) 1"	12
SSW24x9	--	105 1/4	3 1/2	(2) 1"	14
SSW12x10	--	117 1/4	3 1/2	(2) 3/4"	4
SSW15x10	--	117 1/4	3 1/2	(2) 1"	6
SSW18x10	--	117 1/4	3 1/2	(2) 1"	9
SSW21x10	--	117 1/4	3 1/2	(2) 1"	12
SSW24x10	--	117 1/4	3 1/2	(2) 1"	14
SSW15x11	--	129 1/4	5 1/2	(2) 1"	6
SSW18x11	--	129 1/4	5 1/2	(2) 1"	9
SSW21x11	--	129 1/4	5 1/2	(2) 1"	12
SSW24x11	--	129 1/4	5 1/2	(2) 1"	14
SSW15x12	--	141 1/4	5 1/2	(2) 1"	6
SSW18x12	--	141 1/4	5 1/2	(2) 1"	9
SSW21x12	--	141 1/4	5 1/2	(2) 1"	12
SSW24x12	--	141 1/4	5 1/2	(2) 1"	14
SSW18x13	--	153 1/4	5 1/2	(2) 1"	9
SSW21x13	--	153 1/4	5 1/2	(2) 1"	12
SSW24x13	--	153 1/4	5 1/2	(2) 1"	14

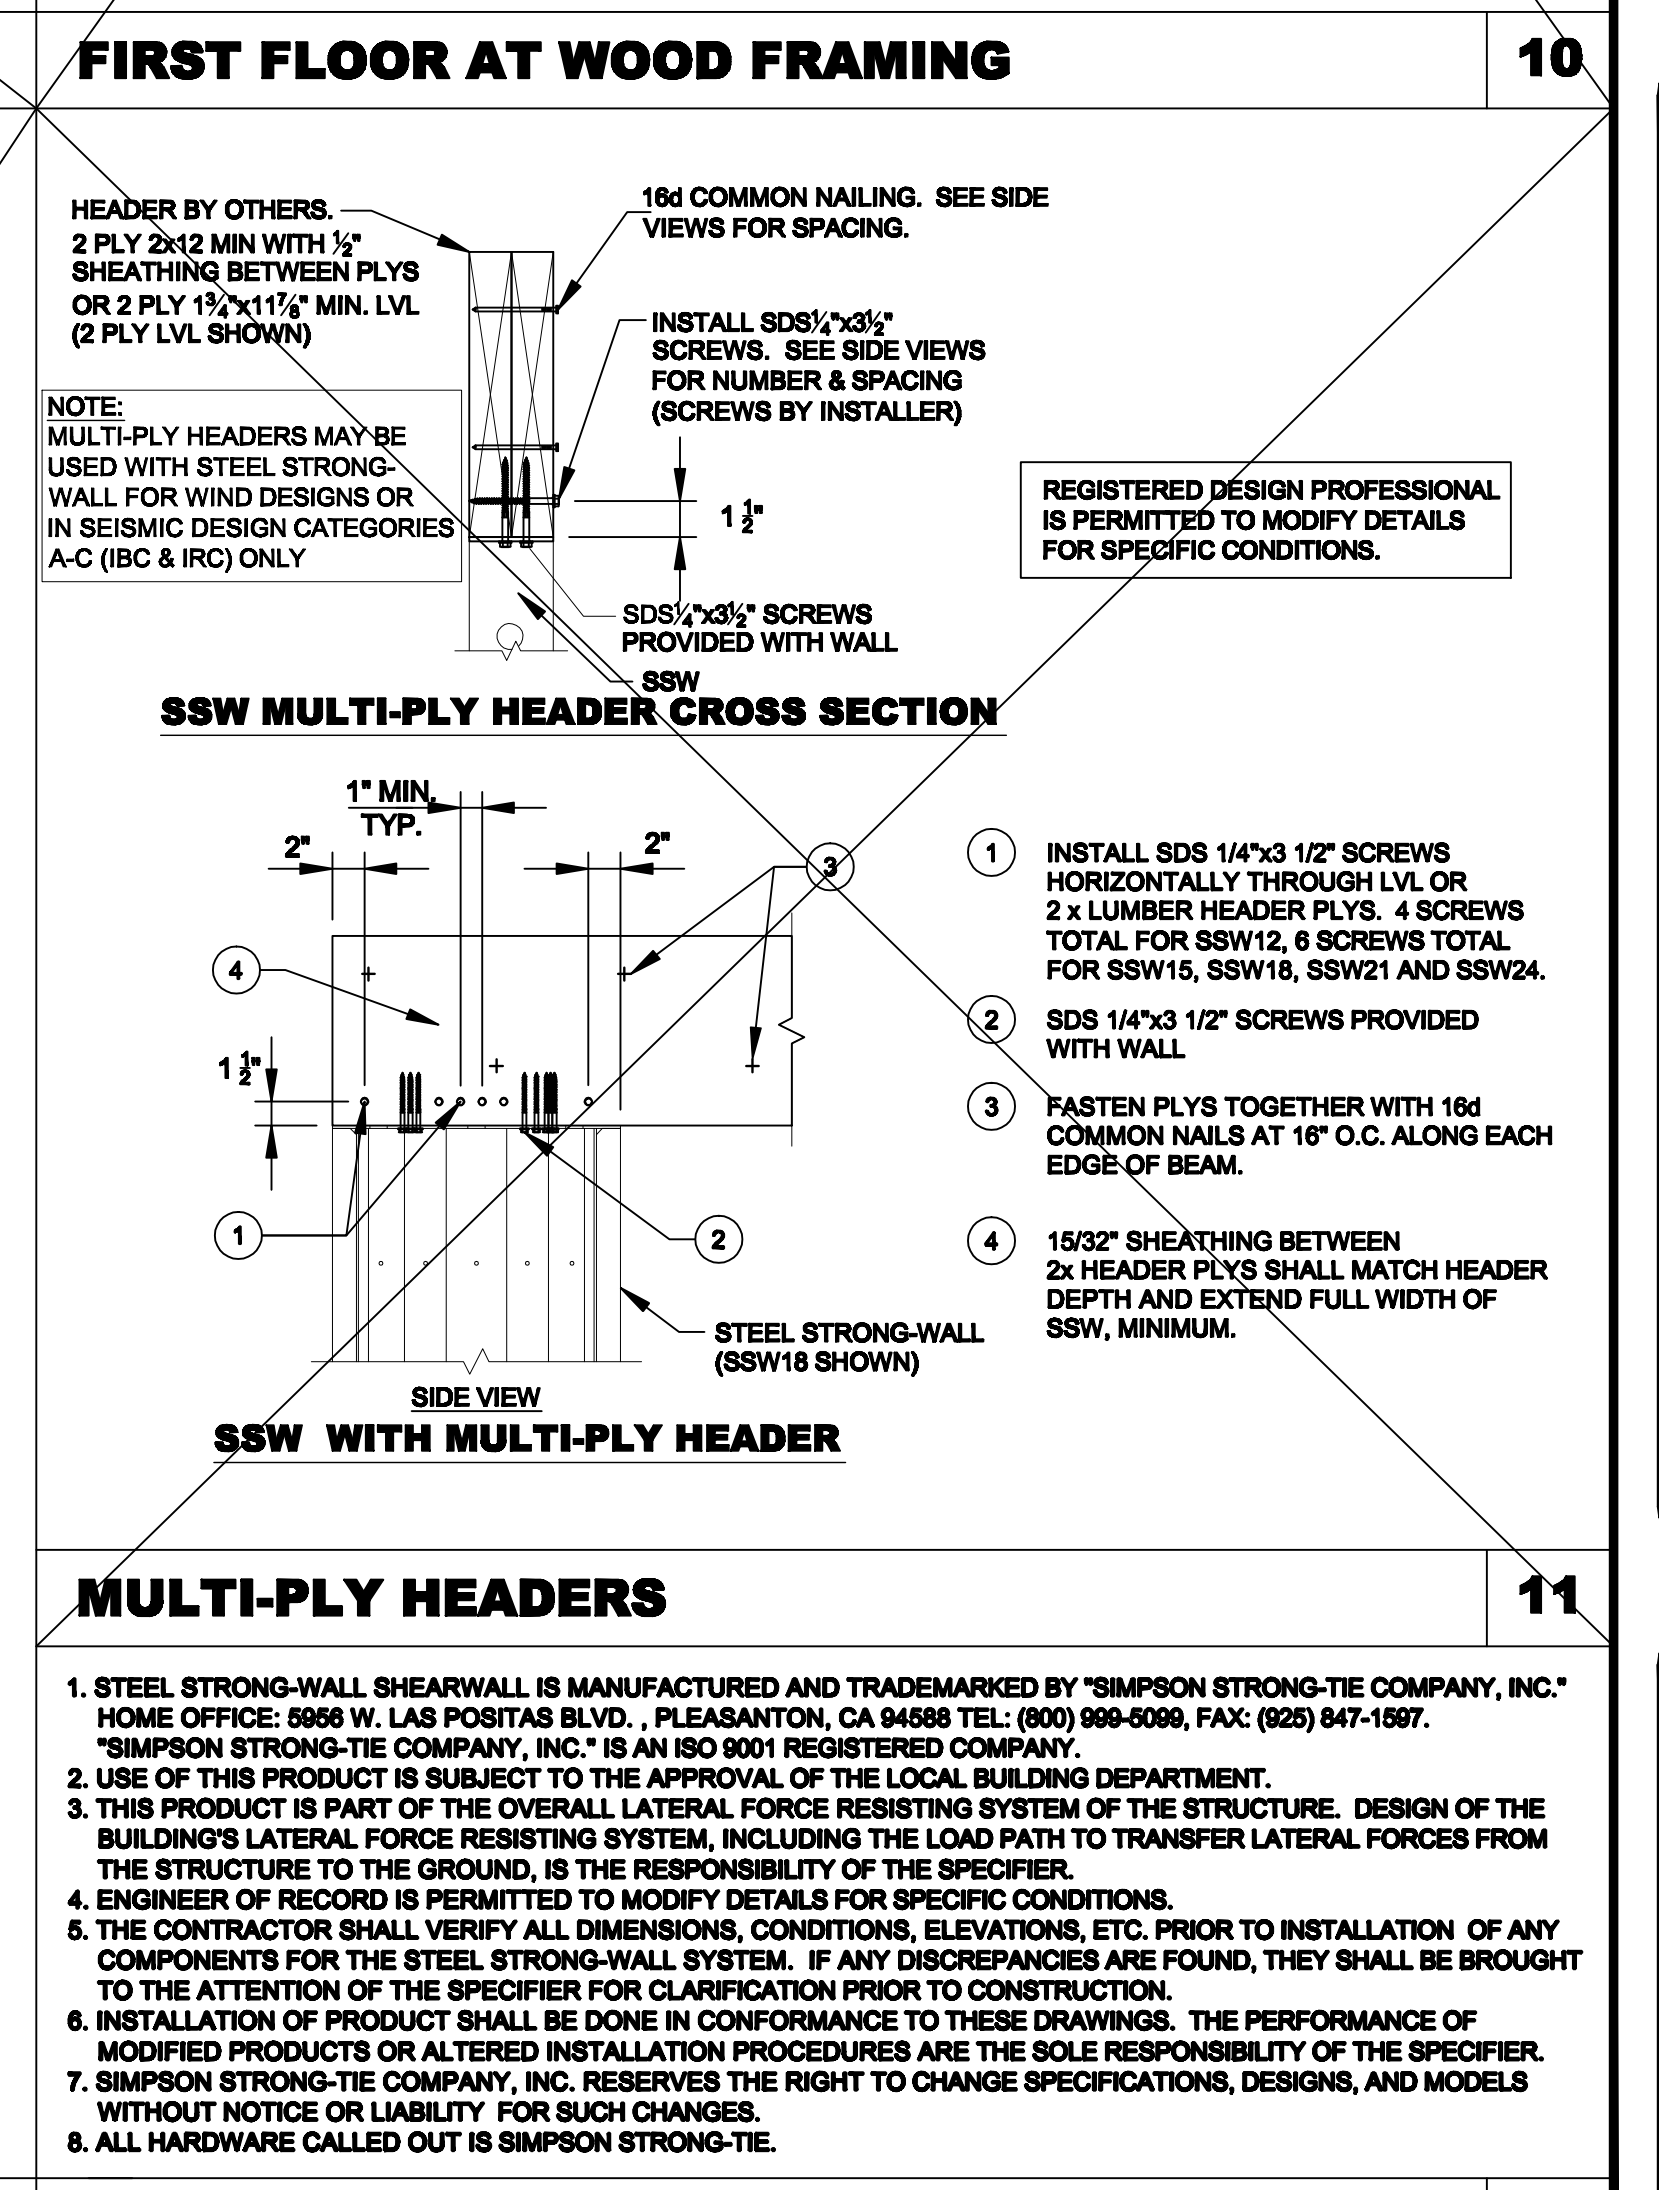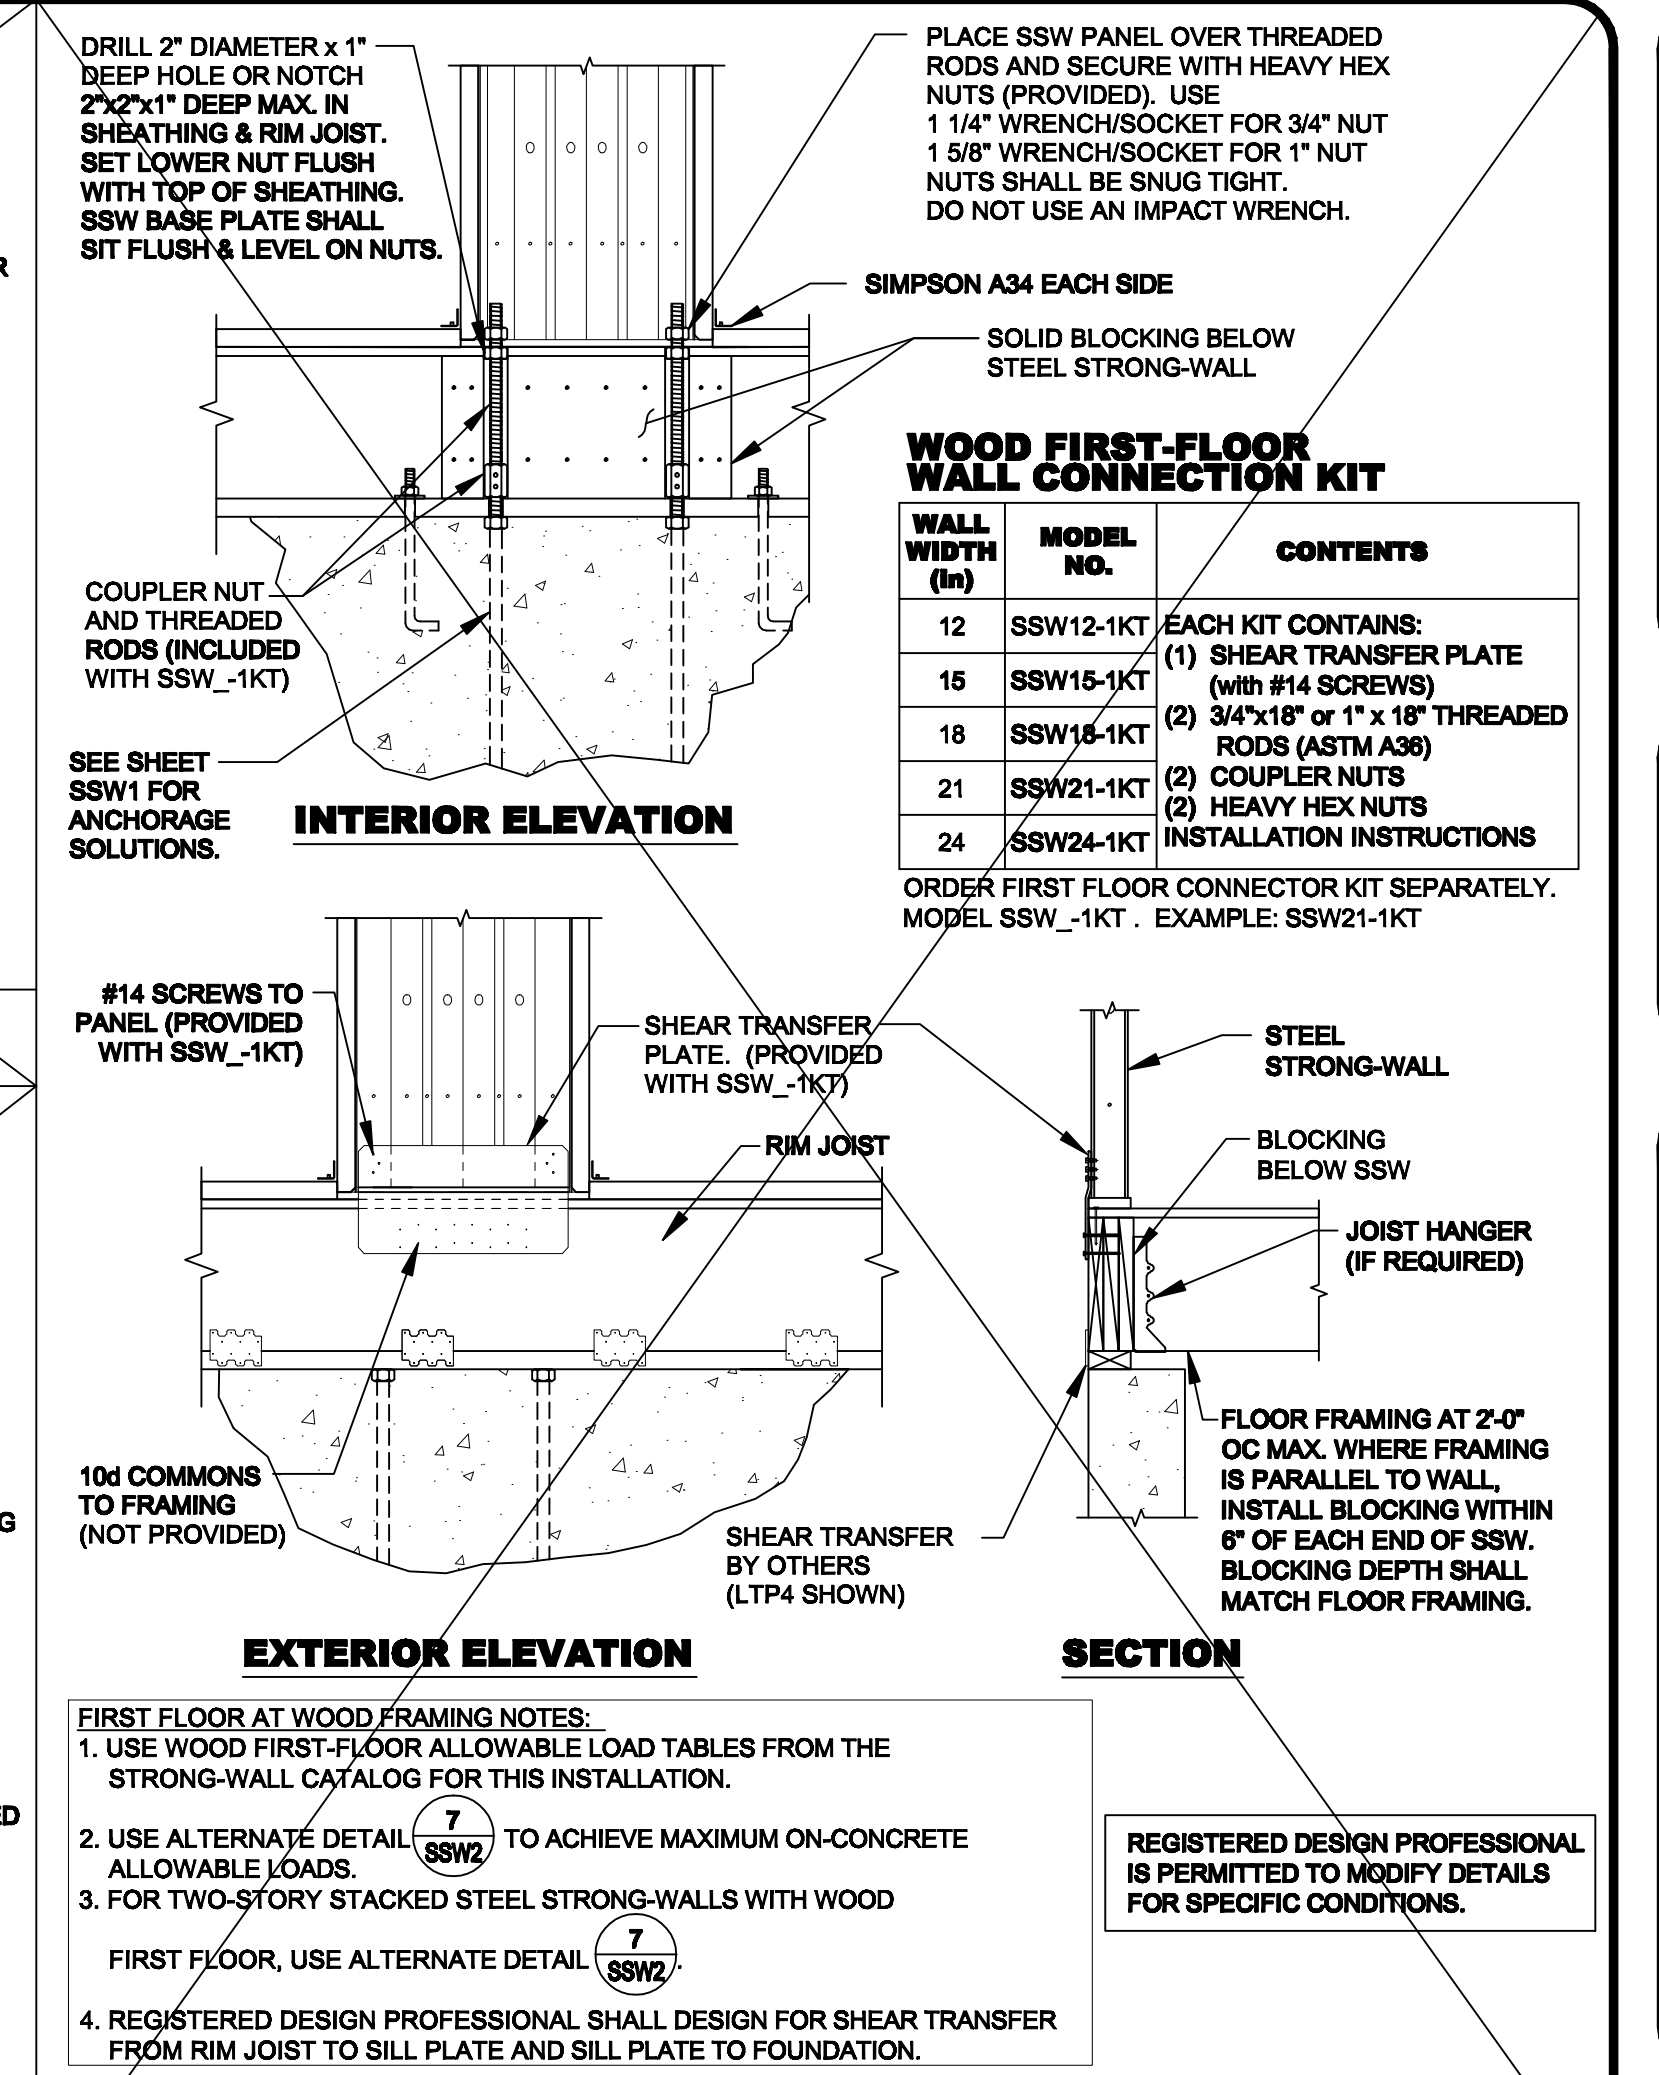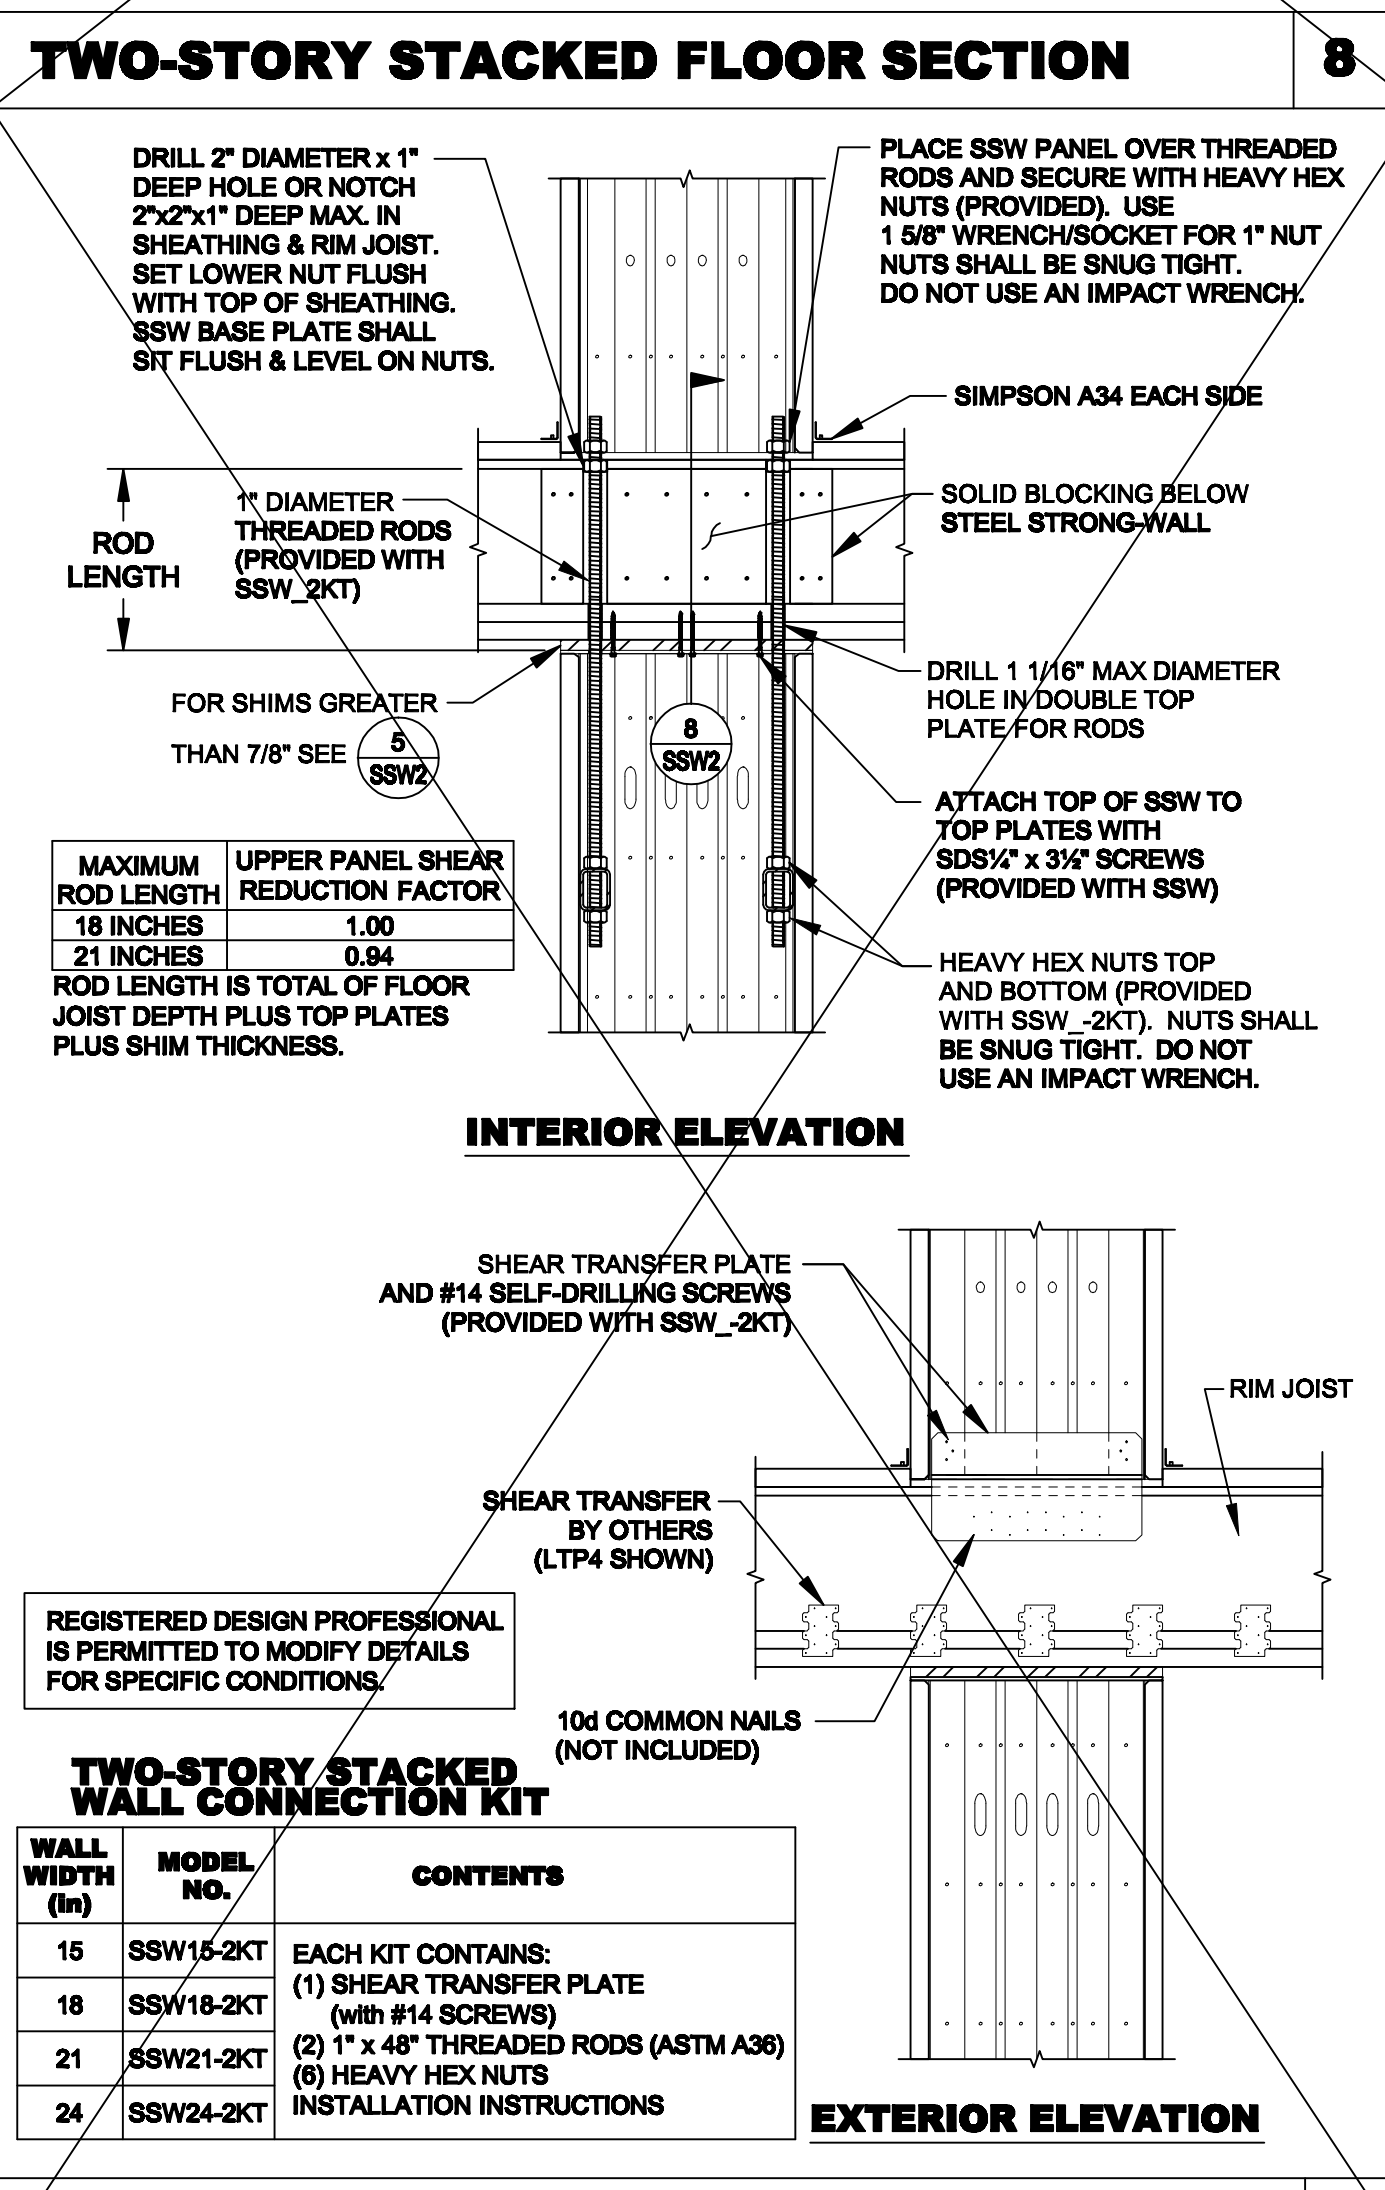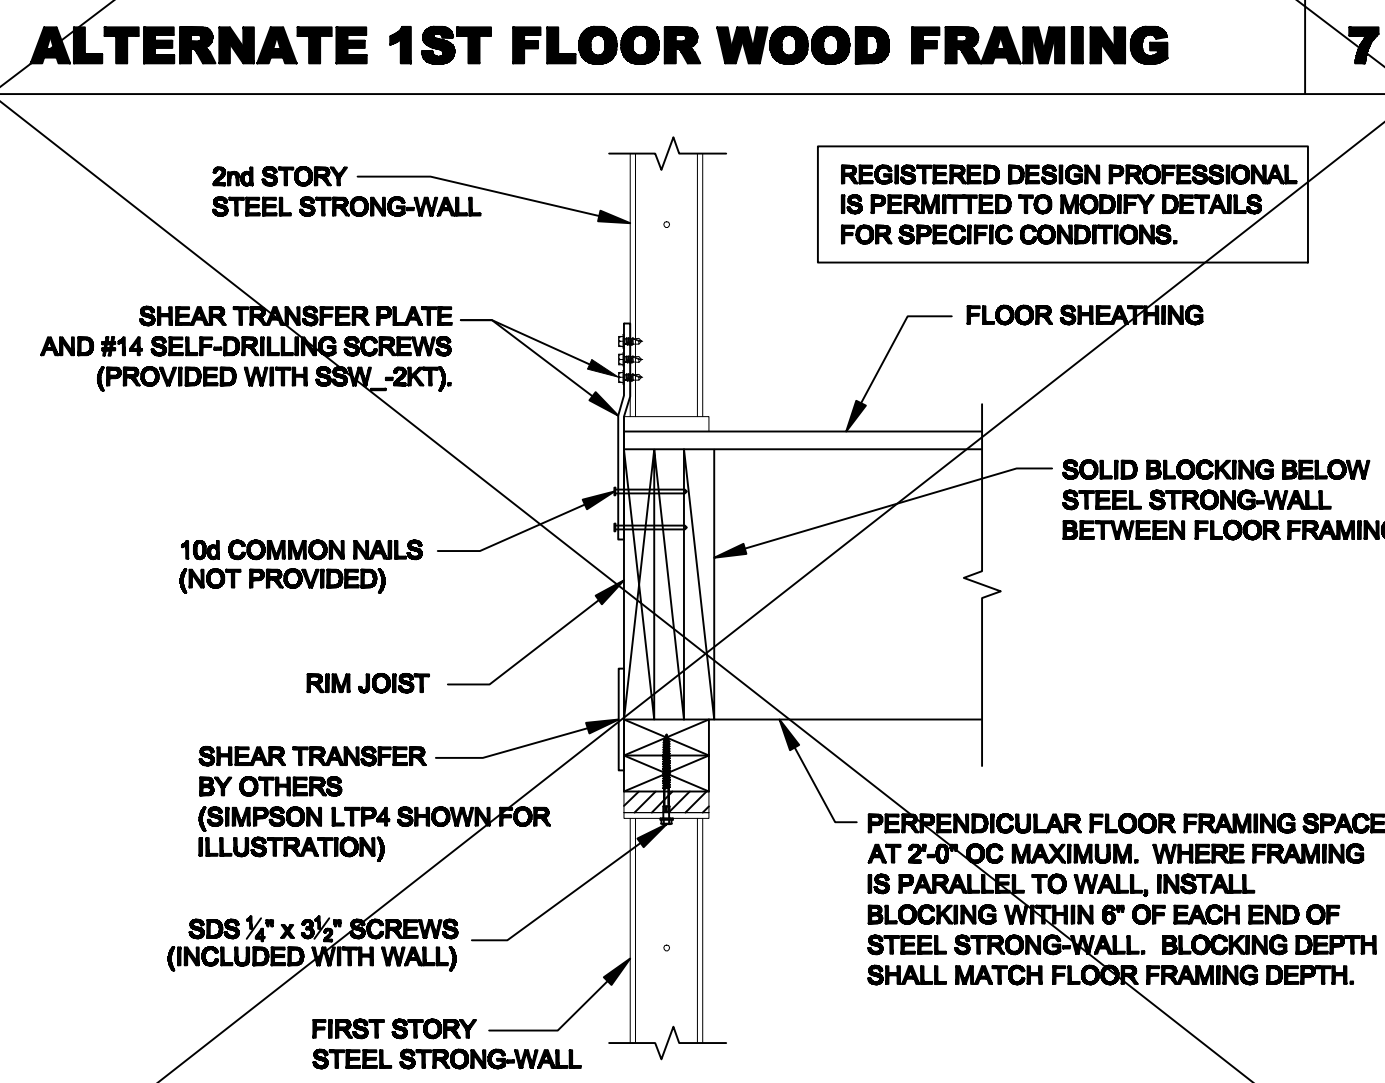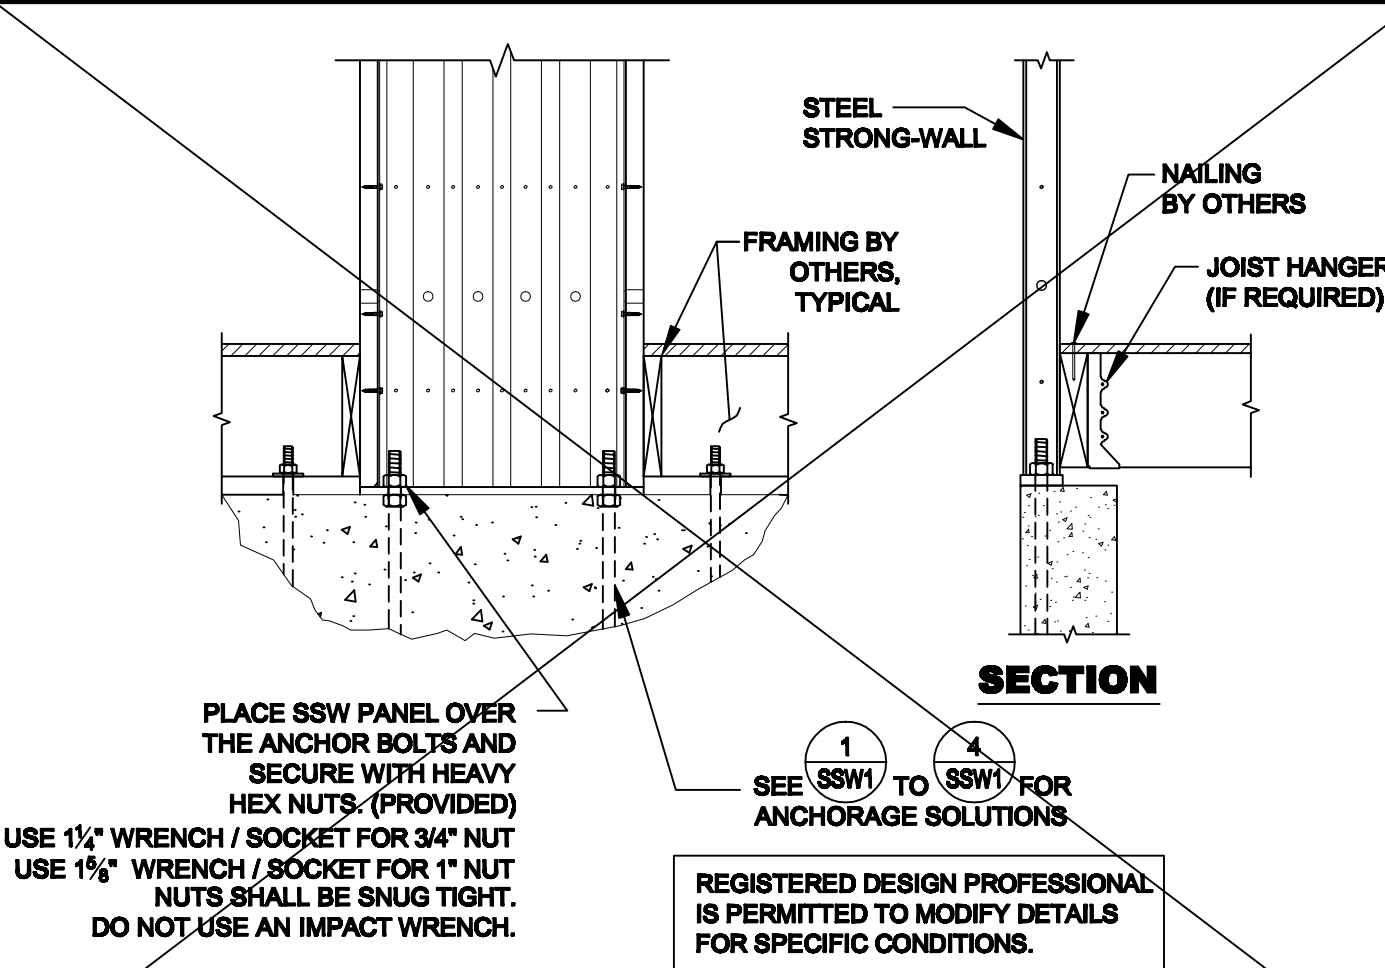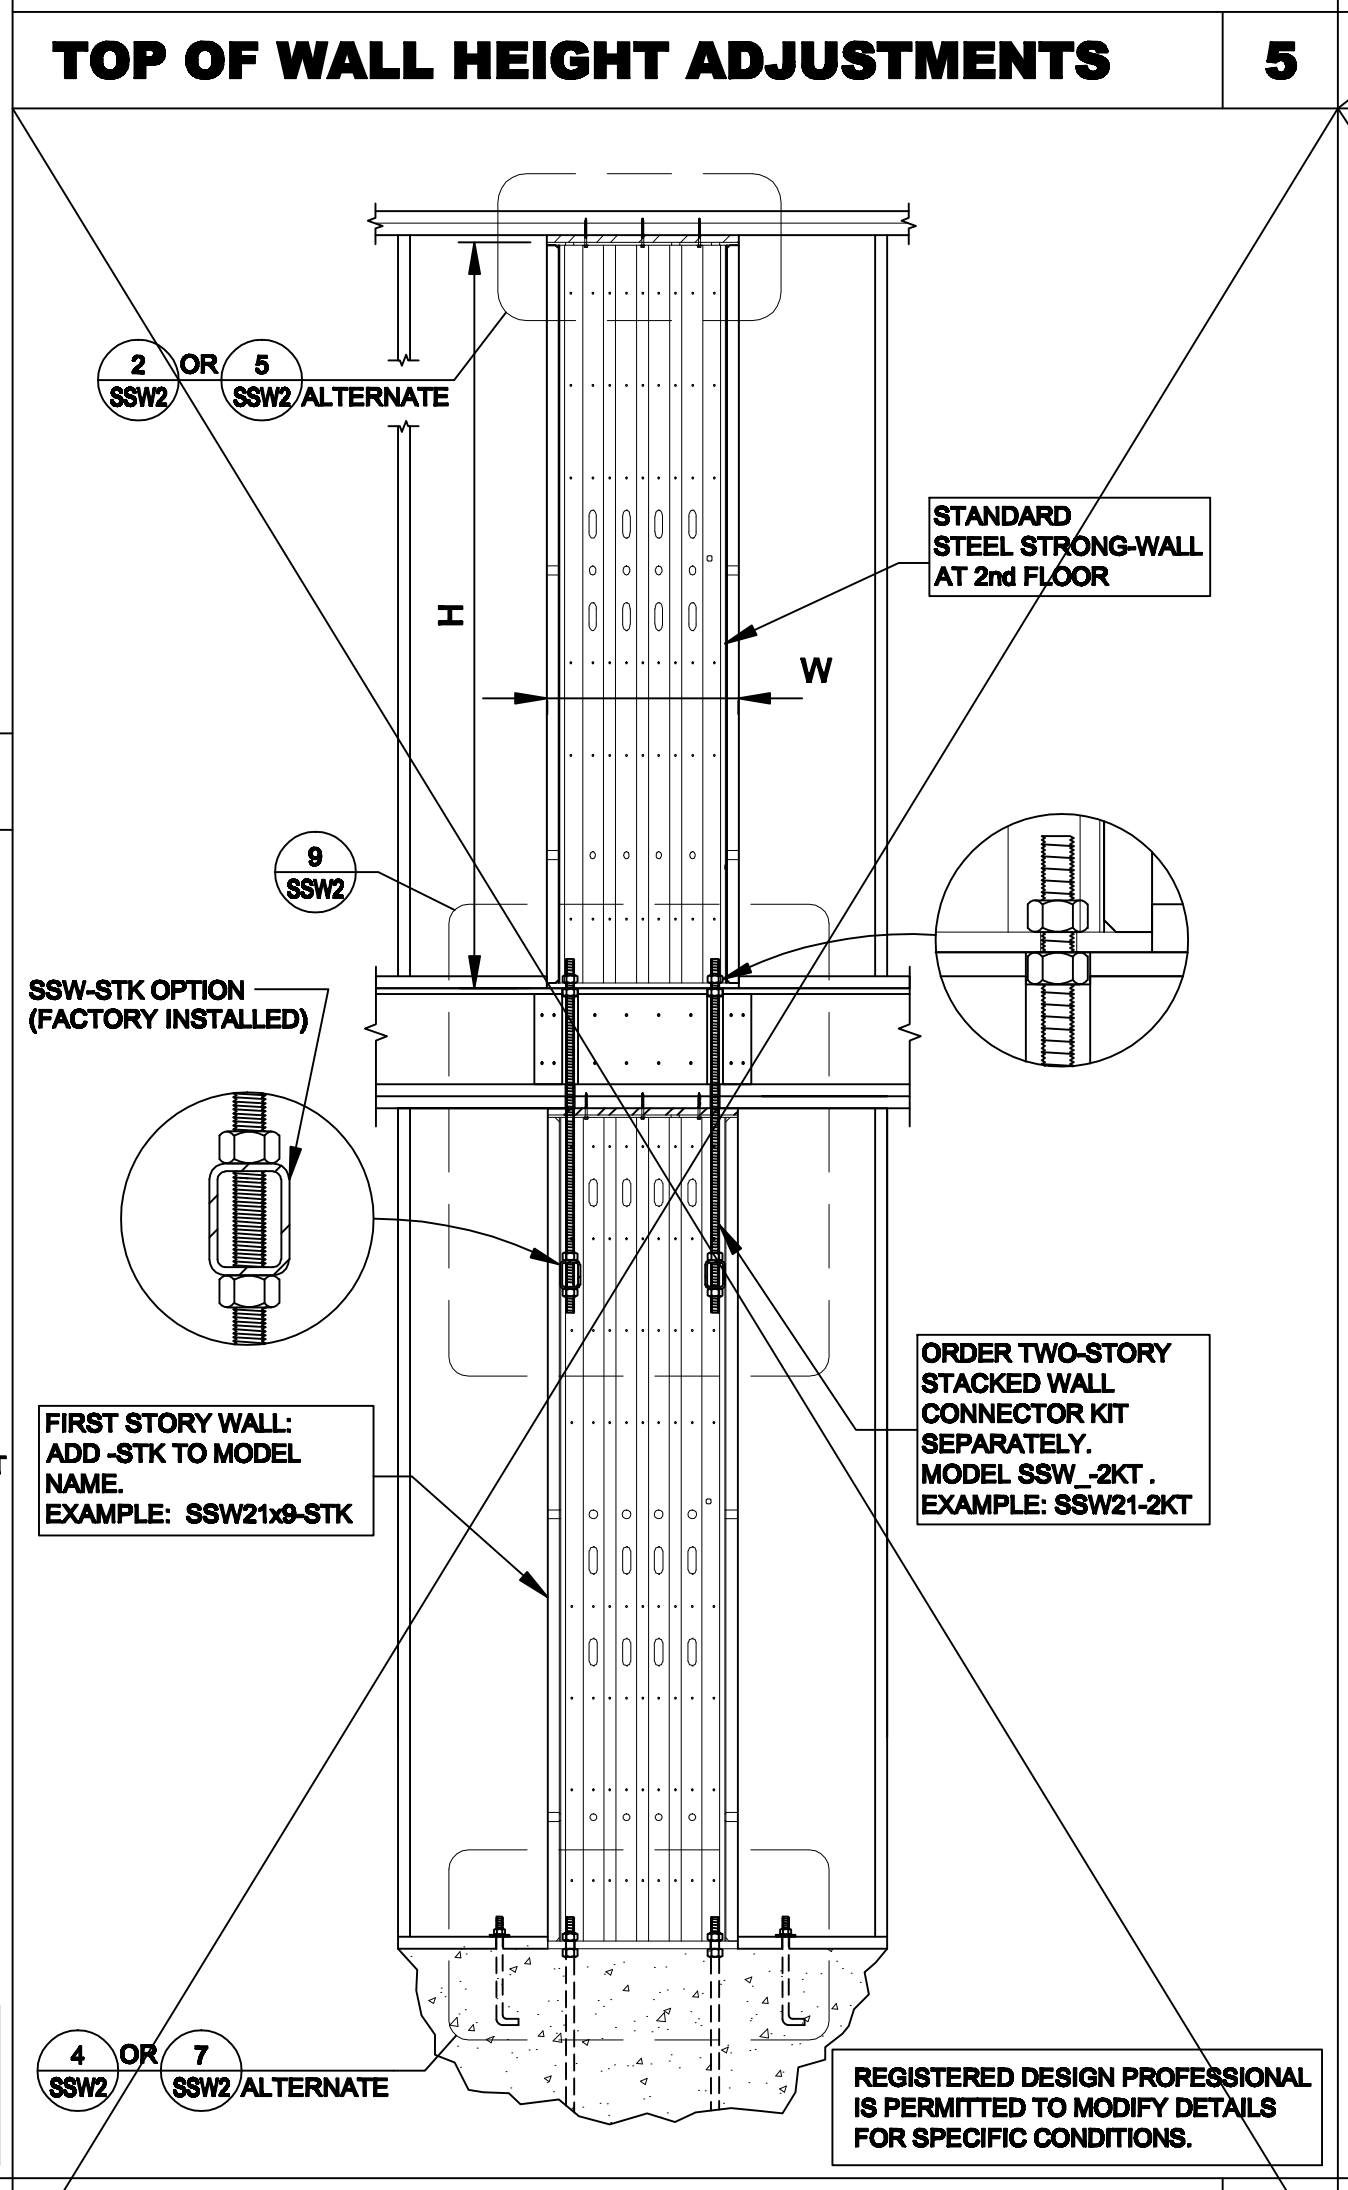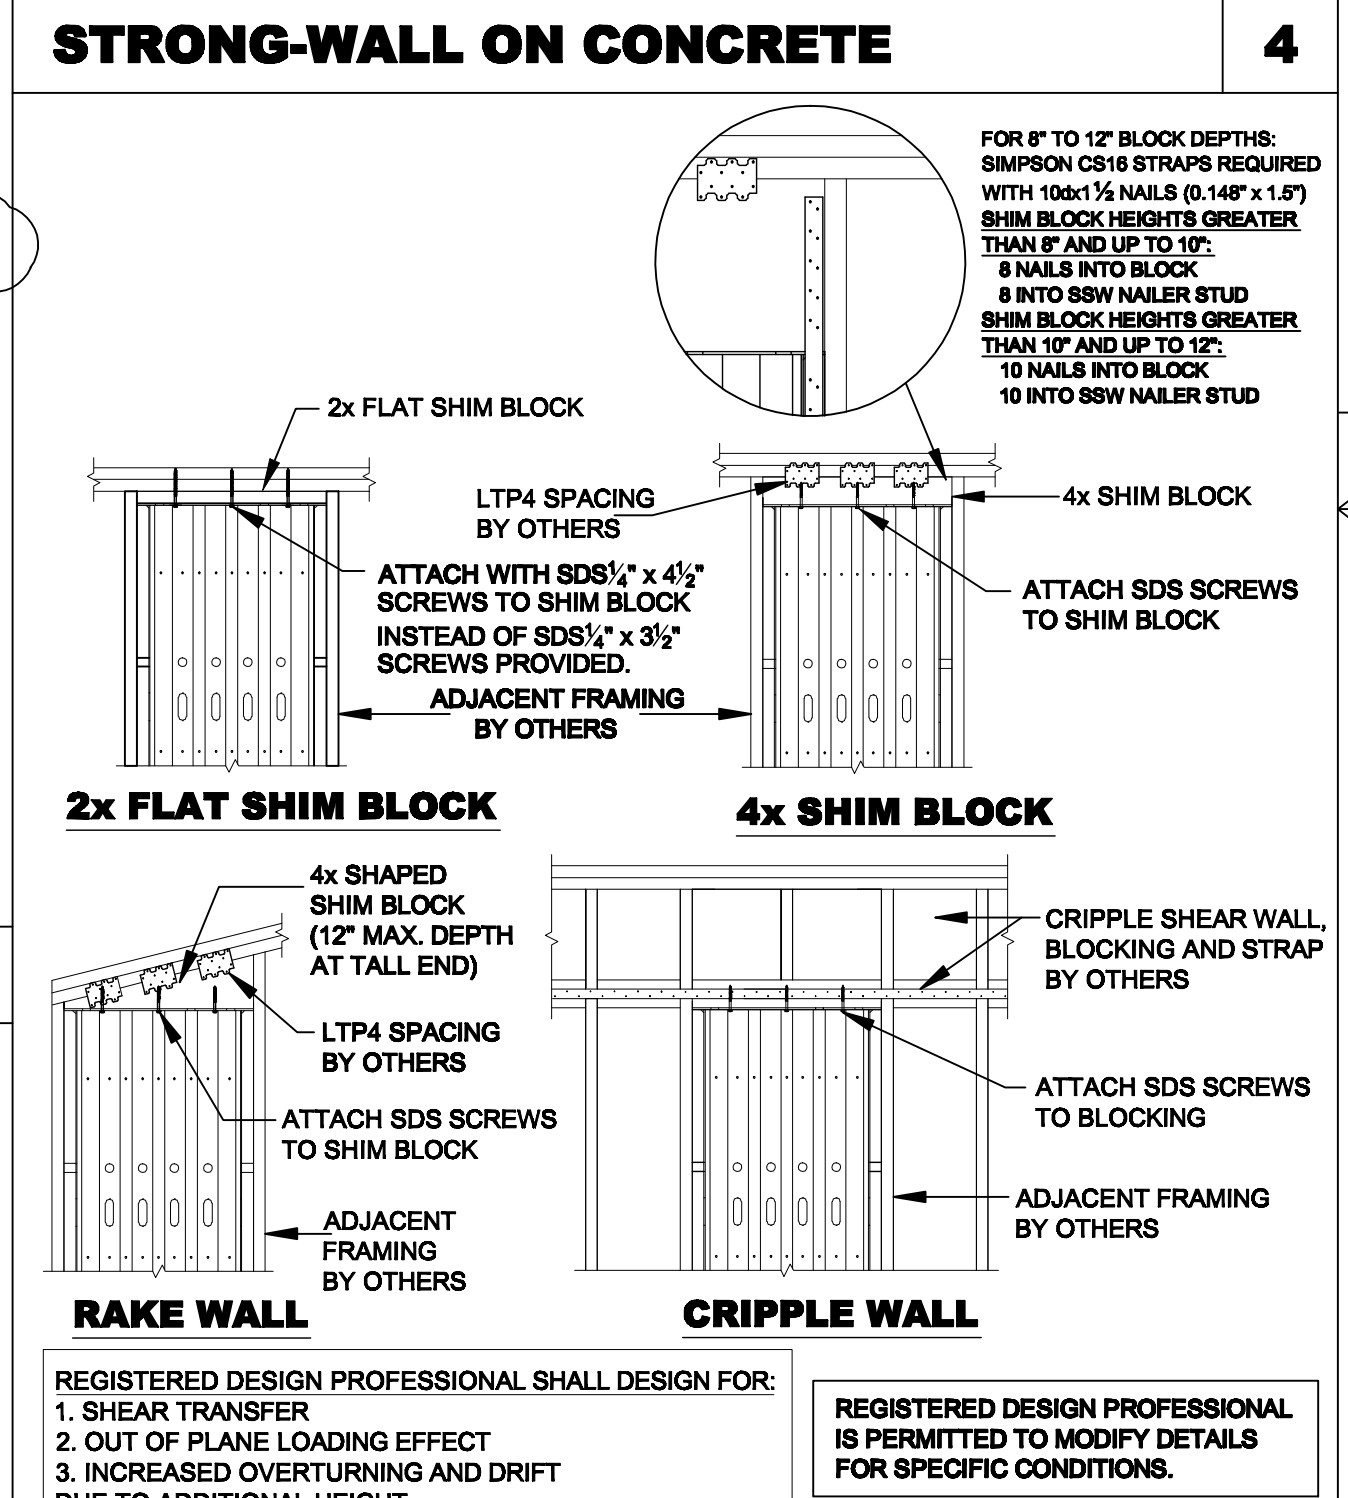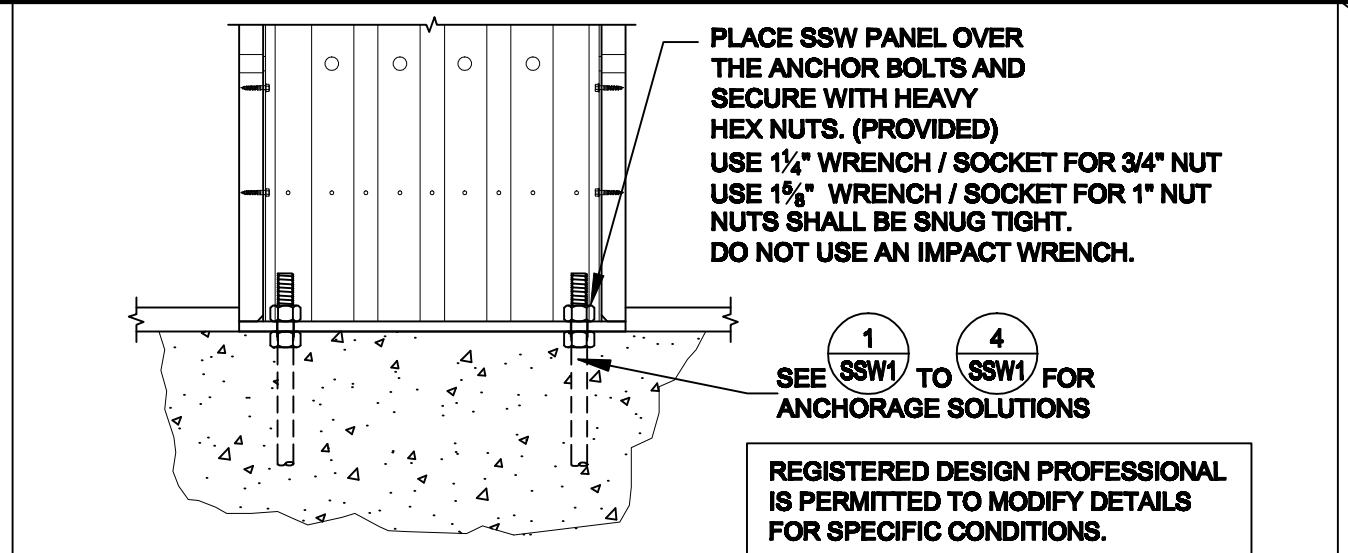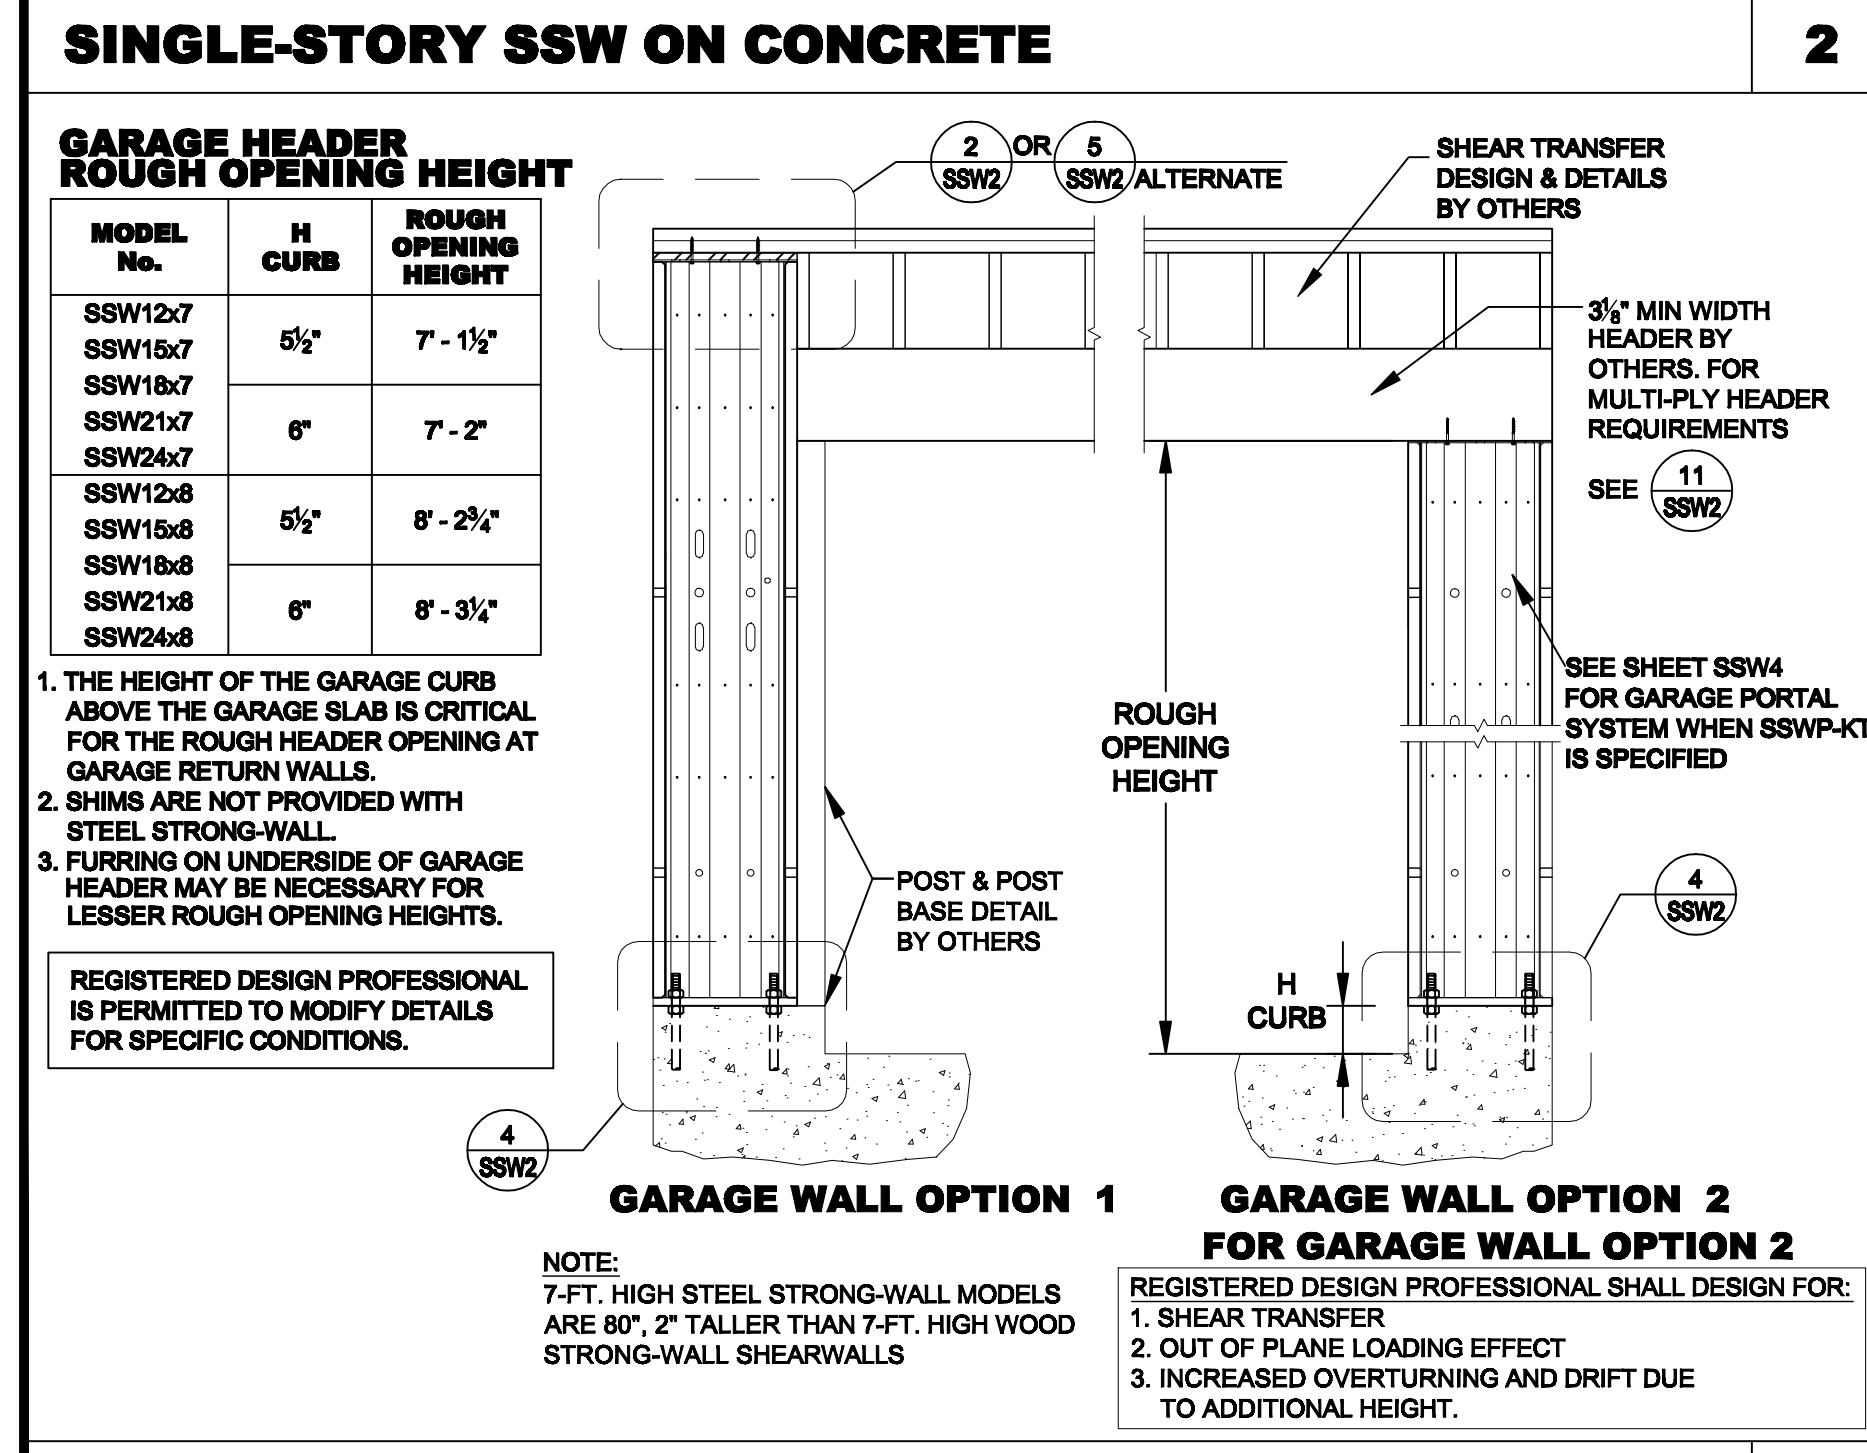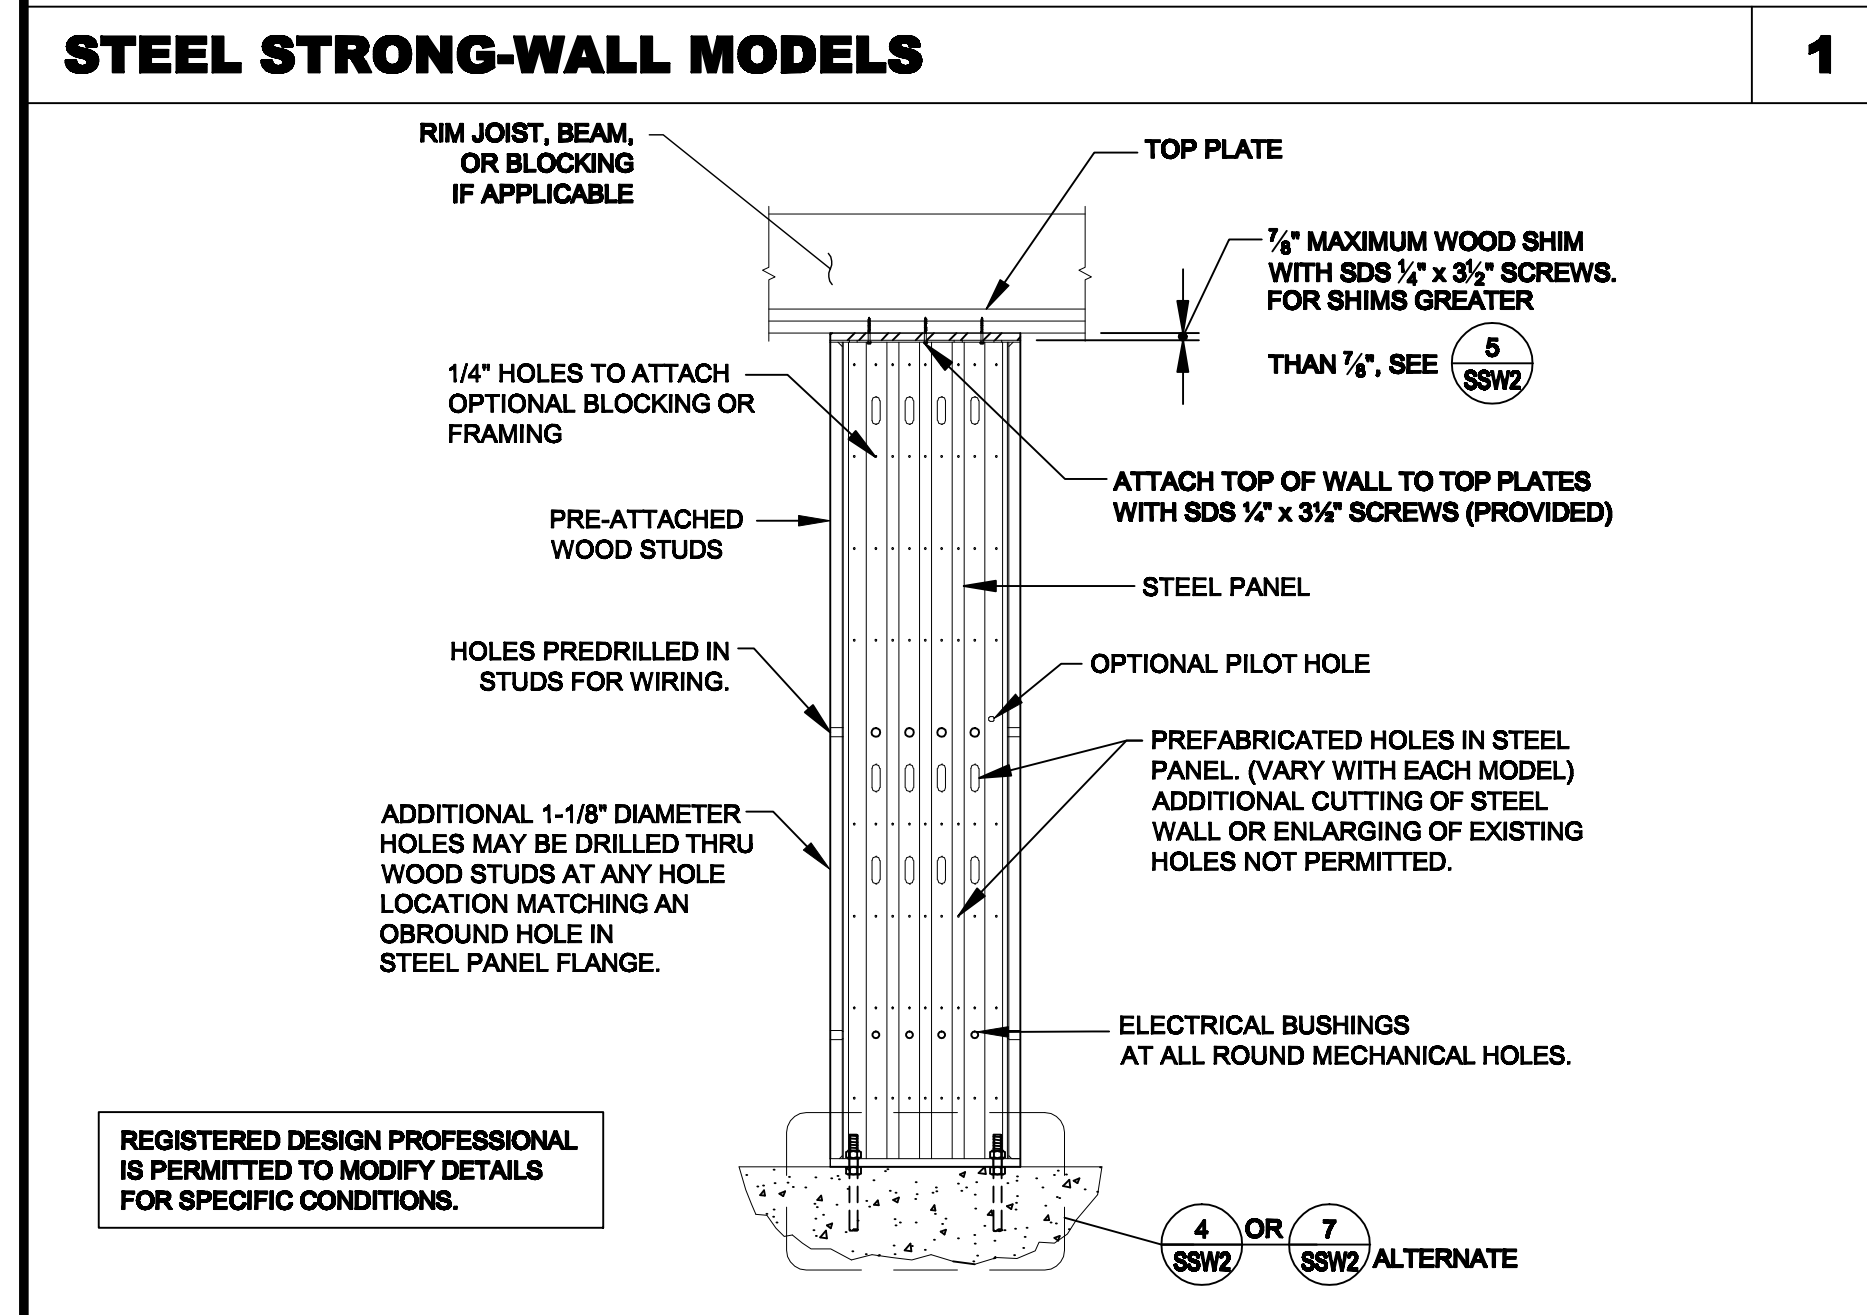

REVISIONS

NO.	DATE	DESCRIPTION
1	06/12/2009	2008 IBC REVISIONS
2	04/19/2014	2012 IBC REVISIONS
3	08/08/2016	2015 IBC REVISIONS

SIMPSON STRONG-TIE COMPANY, INC.

HOME OFFICE: 6968 W. LAS POSTAS BLVD., P.O. BOX 100, LAS POSTAS, CA 94558
 TEL: (925) 999-5099

STEEL STRONG-WALL FRAMING DETAILS ENGINEERED DESIGNS

REGISTERED DESIGN PROFESSIONAL IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.

NOTES

- STEEL STRONG-WALL SHEARWALL IS MANUFACTURED AND TRADEMARKED BY "SIMPSON STRONG-TIE COMPANY, INC." HOME OFFICE: 6968 W. LAS POSTAS BLVD., PLEASANTON, CA 94588 TEL: (925) 999-5099, FAX: (925) 847-1597.
- USE OF THIS PRODUCT IS SUBJECT TO THE APPROVAL OF THE LOCAL BUILDING DEPARTMENT.
- THIS PRODUCT IS PART OF THE OVERALL LATERAL FORCE RESISTING SYSTEM OF THE STRUCTURE. DESIGN OF THE BUILDING'S LATERAL FORCE RESISTING SYSTEM, INCLUDING THE LOAD PATH TO TRANSFER LATERAL FORCES FROM THE STRUCTURE TO THE GROUND, IS THE RESPONSIBILITY OF THE SPECIFIER.
- ENGINEER OF RECORD IS PERMITTED TO MODIFY DETAILS FOR SPECIFIC CONDITIONS.
- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, CONDITIONS, ELEVATIONS, ETC. PRIOR TO INSTALLATION OF ANY COMPONENTS FOR THE STEEL STRONG-WALL SYSTEM. IF ANY DISCREPANCIES ARE FOUND, THEY SHALL BE BROUGHT TO THE ATTENTION OF THE SPECIFIER FOR CLARIFICATION PRIOR TO CONSTRUCTION.
- INSTALLATION OF PRODUCT SHALL BE DONE IN CONFORMANCE TO THESE DRAWINGS. THE PERFORMANCE OF MODIFIED PRODUCTS OR ALTERED INSTALLATION PROCEDURES ARE THE SOLE RESPONSIBILITY OF THE SPECIFIER.
- SIMPSON STRONG-TIE COMPANY, INC. RESERVES THE RIGHT TO CHANGE SPECIFICATIONS, DESIGNS, AND MODELS WITHOUT NOTICE OR LIABILITY FOR SUCH CHANGES.
- ALL HARDWARE CALLED OUT IS SIMPSON STRONG-TIE.

NAME _____

DATE 8-8-2016


SCALE N.T.S.

CHECKED _____

SHEET **SSW2**

OF SHEETS

JOB NO. _____

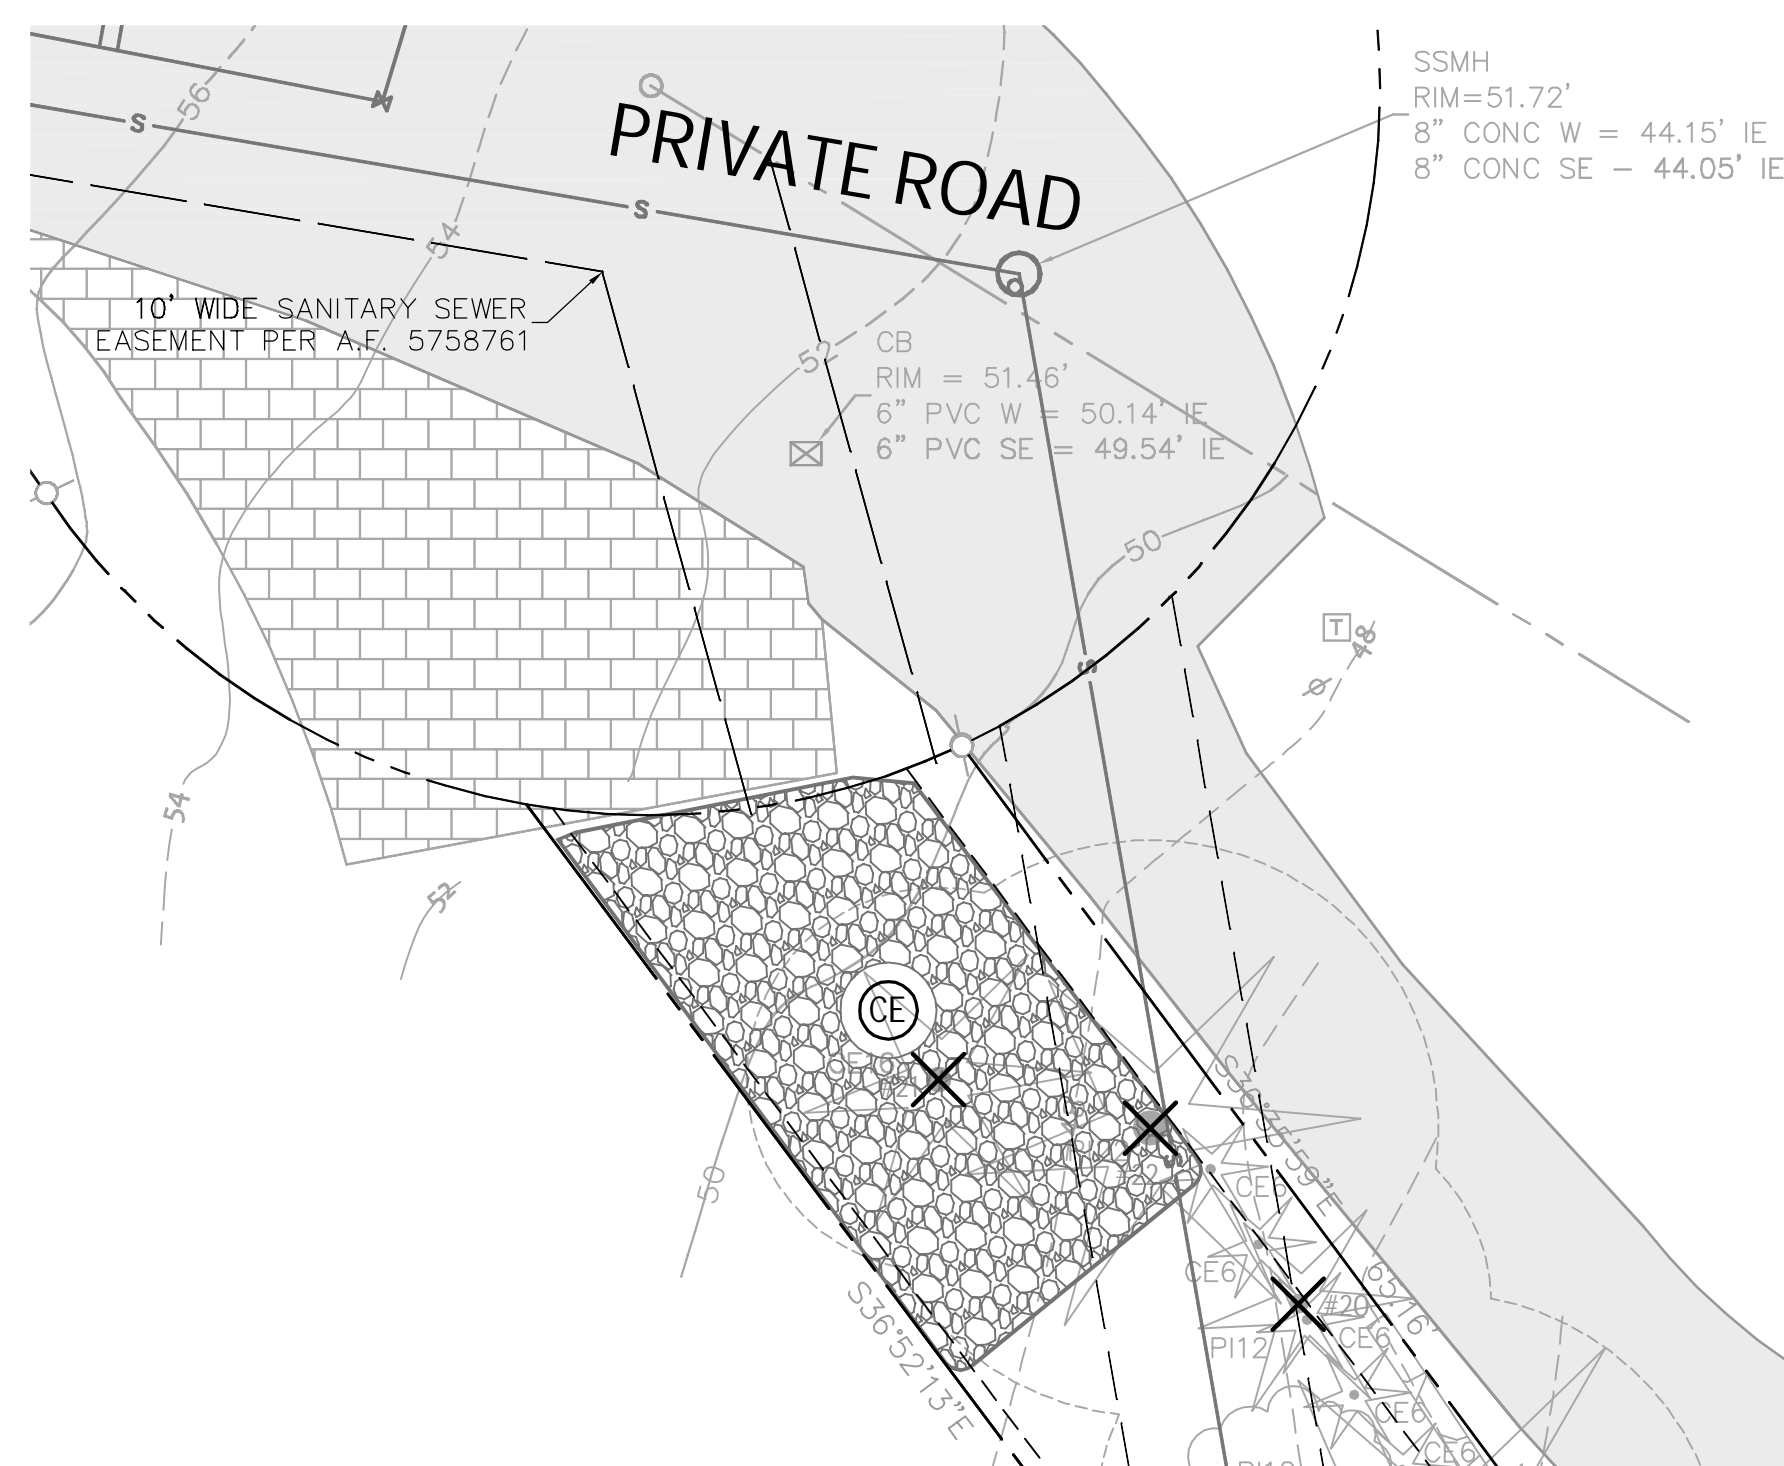

TREE INVENTORY & REPLACEMENT PLAN

SEE ARBORIST REPORT & DEVELOPMENT TREE PLAN BY THOMAS BOYCE, PROJECT ARBORIST, JANUARY 27, 2019

EROSION CONTROL NOTES & DETAILS

SHEET C1.2

SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION. SEE DETAIL ON C1.2.

SOLDIER PILE SHORING NOTES

PER NOTES FROM MARC MCGINNIS, GEOTECH CONSULTANTS.
 -SOLDIER PILES SHOULD BE DRILLED THEN CAST IN PLACE
 -MAX 6' SPACING
 -SLOPED CUTS TALLER THAN 6' MAY NOT WORK DEPENDING ON SEEPAGE LEVELS (GROUNDWATER)
 -HEAVY GROUNDWATER COULD BE ENCOUNTERED

EROSION CONTROL LEGEND



- LIMITS OF DISTURBANCE
- FILTER FABRIC FENCE (SILT FENCE) (SF)
 - STABILIZED CONSTRUCTION ENTRANCE (CE)
 - CATCH BASIN INLET PROTECTION (IP)
 - INTERCEPTOR SWALE SEE COR DWG 504 TYPE A TEMPORARY SWALE (IS)
 - TREE PROTECTION FENCING (TP)
 - STOCKPILE (ST)
 - STRAW WATTLES (SW)
 - PLASTIC COVERING (PC)
 - COMPOST SOCK (CS)
 - COMPOST BERM (CB)
- USE AS NEEDED
- COVER EXPOSED AREAS WITHIN MERCER ISLAND TIME LIMIT
- SEDIMENT CONTROL OPTION RECOMMENDED IN LIEU OF SILT FENCE
- SEDIMENT CONTROL OPTION RECOMMENDED IN LIEU OF SILT FENCE

JAPANESE KNOTWEED REMOVAL

Japanese knotweed (*Polygonum cuspidatum*) and Regulated Class A, Regulated Class B, and Regulated Class C weeds identified on the King county Noxious Weed list, as amended, shall be removed from the property. New landscaping on the property shall not incorporate any weeds identified on the King county Noxious Weed list, as amended.

TREE TABLE

Tree Inventory						
No.	Species	Common Name	DBH	ROL	Comments	Retain / Remove
1	TALIA FLICATA	WESTERN RED CEDAR	28 IN	12 FT	NORMAL VIGOR	RETAIN
2	FINUS SP.	PINE	22 IN	6 FT	POOR VIGOR	REMOVE
3	FINUS SP.	PINE	18 IN	6 FT	POOR VIGOR	REMOVE
4	FINUS SP.	PINE	18 IN	6 FT	POOR VIGOR	REMOVE
5	POPULUS TRICHOCARPA	LOMBARDY POPLAR	32 IN	10 FT	POOR VIGOR	REMOVE
6	POPULUS TRICHOCARPA	LOMBARDY POPLAR	35 IN	9 FT	POOR VIGOR	REMOVE
7	SALIX BABYLONICA	WEBBER WILLOW	36 IN	20 FT	POOR VIGOR	RETAIN
8	BETULA Papyrifera	PAPERBARK BIRCH	16 IN	12 FT	FAIR VIGOR	RETAIN
9	BETULA Papyrifera	PAPERBARK BIRCH	12 IN	12 FT	NORMAL VIGOR	RETAIN
10	FRINUS BLIREANA	FLOWERING PLUM	8 IN	15 FT	SENESCENT	RETAIN
11	FRINUS BLIREANA	FLOWERING PLUM	12 IN	15 FT	SENESCENT	RETAIN
12	TALIA FLICATA	WESTERN RED CEDAR	12 IN	10 FT	NORMAL VIGOR	RETAIN
13	TALIA FLICATA	WESTERN RED CEDAR	14 IN	15 FT	NORMAL VIGOR	RETAIN
14	TALIA FLICATA	WESTERN RED CEDAR	10 IN	10 FT	NORMAL VIGOR	RETAIN
15	BETULA Papyrifera	PAPERBARK BIRCH	12 IN	15 FT	NORMAL VIGOR	RETAIN
16	BETULA Papyrifera	PAPERBARK BIRCH	12 IN	15 FT	NORMAL VIGOR	RETAIN
17	BETULA Papyrifera	PAPERBARK BIRCH	10 IN	10 FT	NORMAL VIGOR	REMOVE
18	BETULA Papyrifera	PAPERBARK BIRCH	12 IN	10 FT	NORMAL VIGOR	REMOVE
19	FINUS SP.	PINE	18 IN	15 FT	FAIR VIGOR	REMOVE
20	FINUS SP.	PINE	12 IN	10 FT	FAIR VIGOR	REMOVE
21	CALOCEDRUS DECCURENS	INCENSE CEDAR	16 IN	10 FT	GOOD VIGOR	REMOVE
22	FINUS SP.	PINE	22 IN	15 FT	NORMAL VIGOR	REMOVE
23	SEQUOIA SEMPREVIRENS	COAST REDWOOD	66 IN	20 FT	ON NEIGHBOR PROPERTY	RETAIN

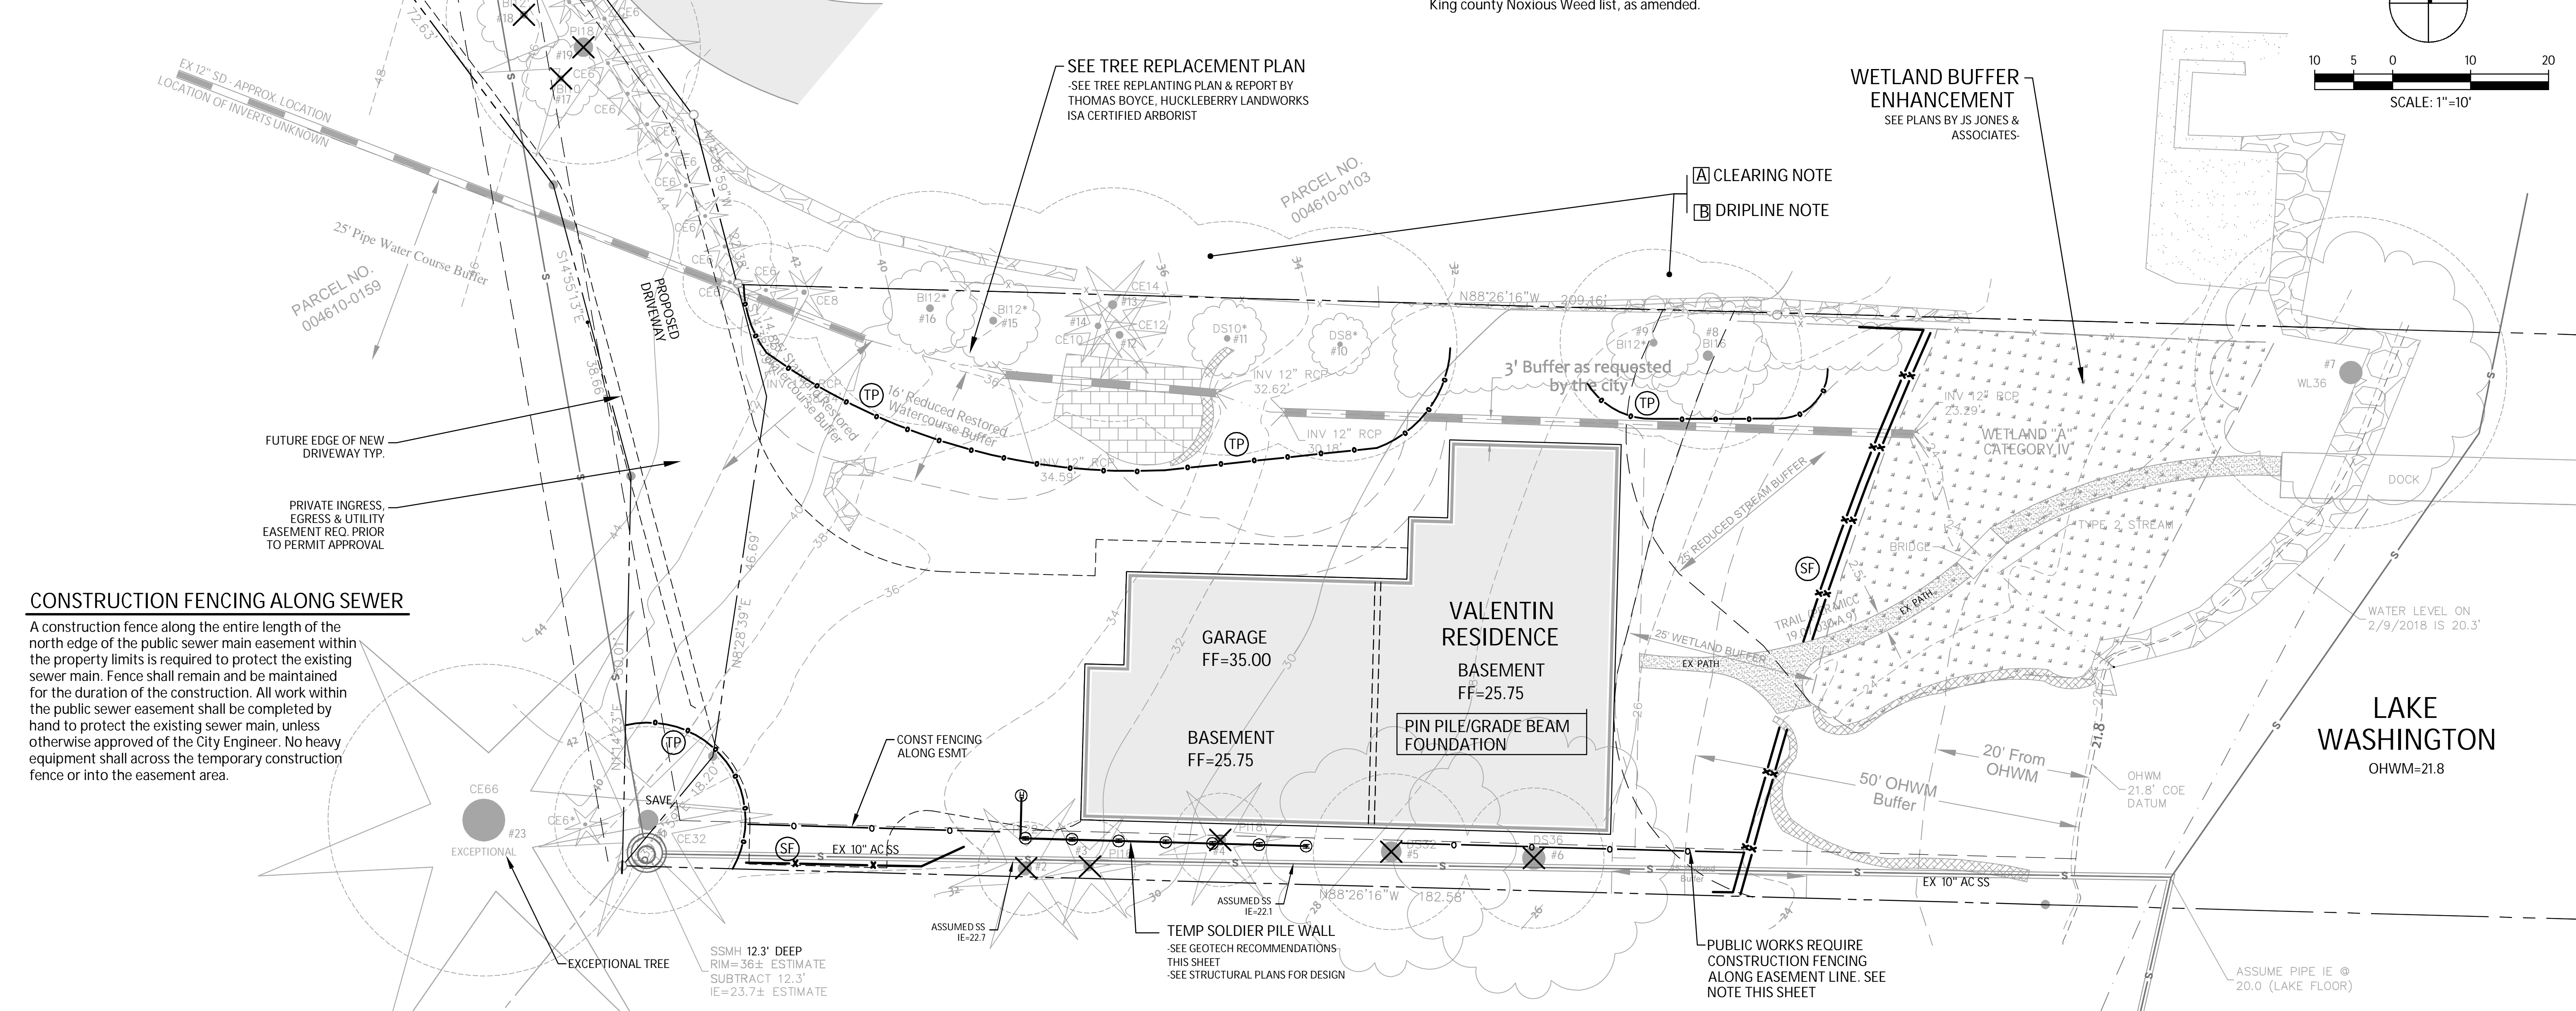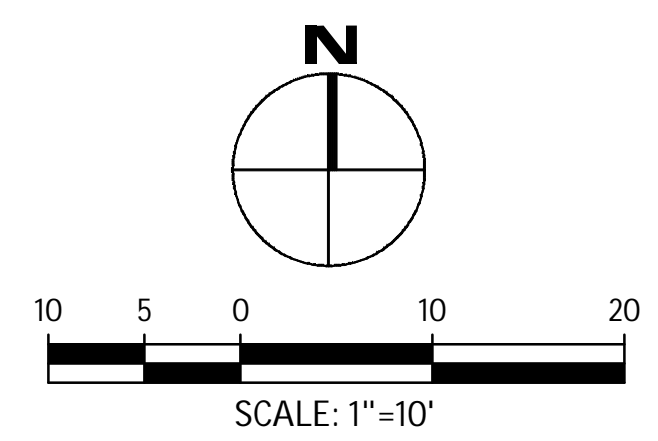

CONSTRUCTION FENCING ALONG SEWER


A construction fence along the entire length of the north edge of the public sewer main easement within the property limits is required to protect the existing sewer main. Fence shall remain and be maintained for the duration of the construction. All work within the public sewer easement shall be completed by hand to protect the existing sewer main, unless otherwise approved of the City Engineer. No heavy equipment shall cross the temporary construction fence or into the easement area.

NO.	DATE	BY	REVISIONS

APPLICANT:
 JOHAN VALENTIN
 PO BOX 52641
 BELLEVUE, WA 98015

811
 Know what's below.
 Call before you dig.


DATE: May 13, 2019
 JOB# 1704
 DRAFTED: CH DESIGN: DE
 DIGITAL SIGNATURE

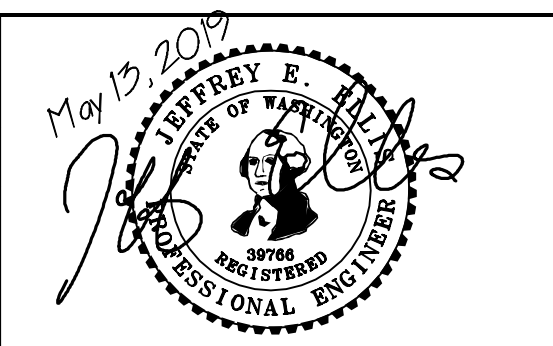

CIVIL ENGINEERING SOLUTIONS
 102 NW CANAL STREET SEATTLE, WA 98107
 PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

EROSION CONTROL PLAN
 VALENTIN RESIDENCE
 4350 E. MERCER WAY, MERCER ISLAND, WA 98040

DRAWING NO: C1.0
 APN 004610-0150
 1902-013

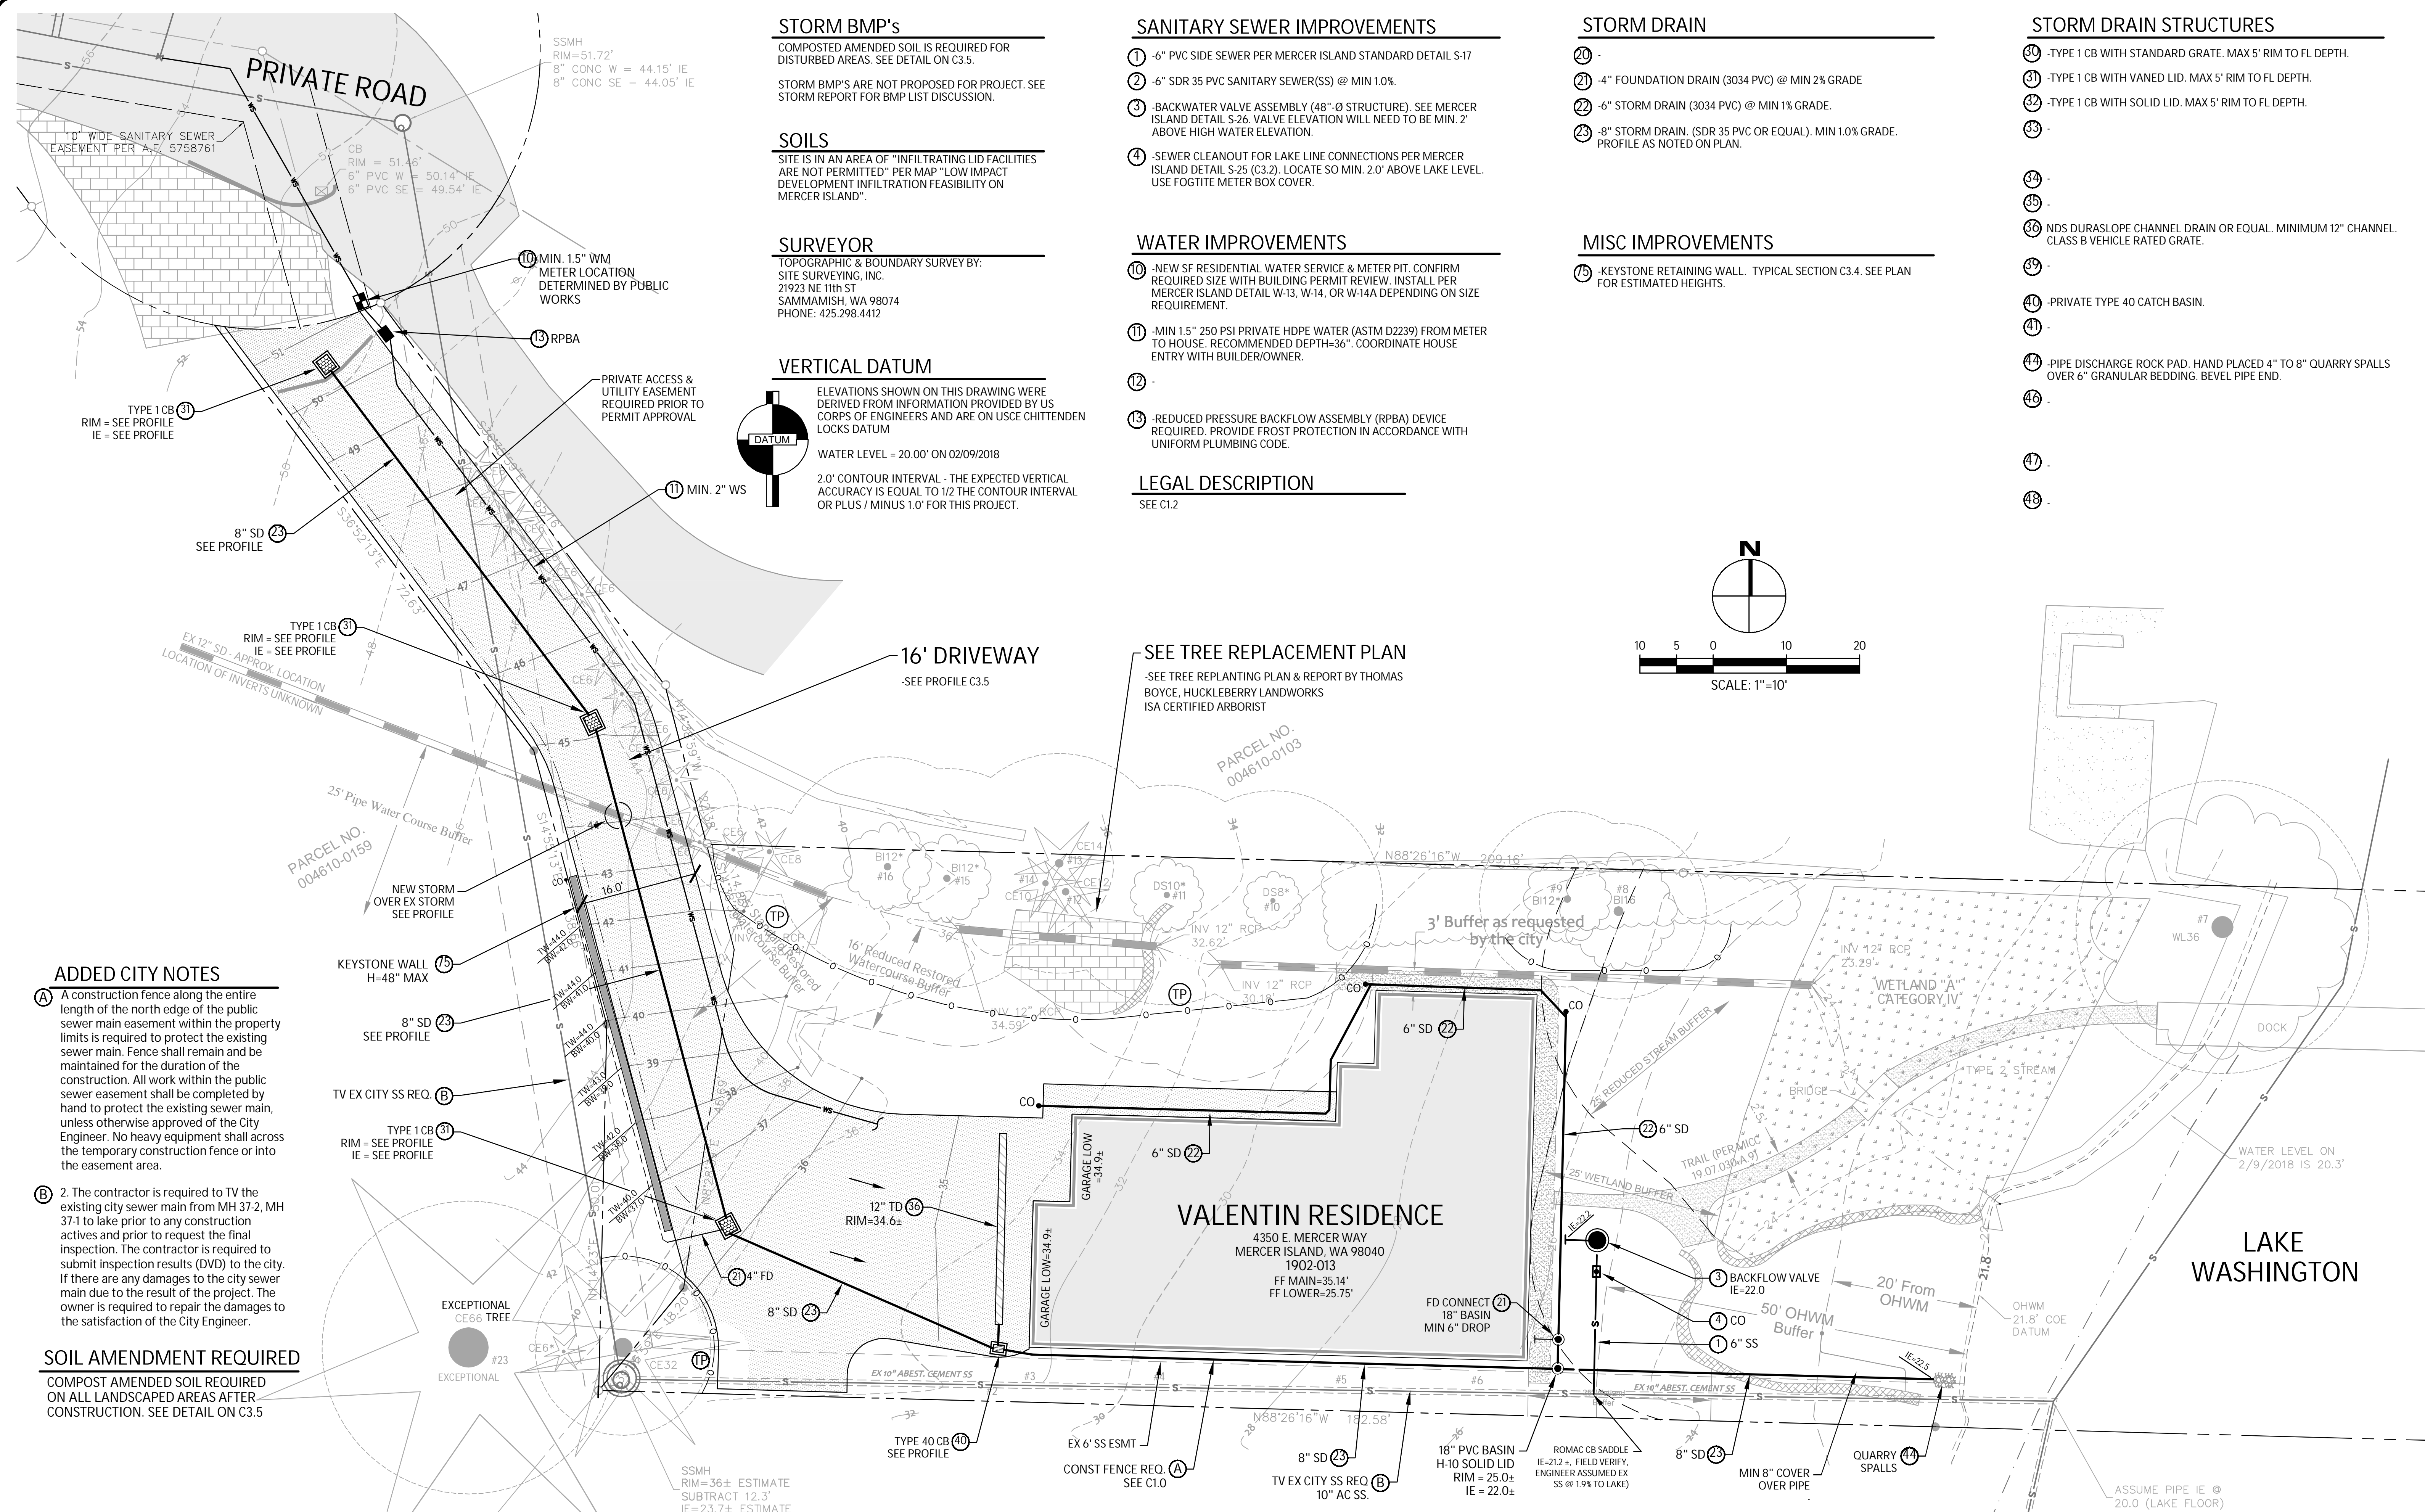

STORM BMP's
 COMPOSTED AMENDED SOIL IS REQUIRED FOR DISTURBED AREAS. SEE DETAIL ON C3.5.
 STORM BMP'S ARE NOT PROPOSED FOR PROJECT. SEE STORM REPORT FOR BMP LIST DISCUSSION.

SOILS
 SITE IS IN AN AREA OF "INFILTRATING LID FACILITIES ARE NOT PERMITTED" PER MAP "LOW IMPACT DEVELOPMENT INFILTRATION FEASIBILITY ON MERCER ISLAND".

SURVEYOR
 TOPOGRAPHIC & BOUNDARY SURVEY BY:
 SITE SURVEYING, INC.
 21923 NE 11th ST
 SAMMAMISH, WA 98074
 PHONE: 425.298.4412

VERTICAL DATUM
 ELEVATIONS SHOWN ON THIS DRAWING WERE DERIVED FROM INFORMATION PROVIDED BY US CORPS OF ENGINEERS AND ARE ON USCE CHITTENDEN LOCKS DATUM
 WATER LEVEL = 20.00' ON 02/09/2018
 2.0' CONTOUR INTERVAL - THE EXPECTED VERTICAL ACCURACY IS EQUAL TO 1/2 THE CONTOUR INTERVAL OR PLUS / MINUS 1.0' FOR THIS PROJECT.

SANITARY SEWER IMPROVEMENTS

- 6" PVC SIDE SEWER PER MERCER ISLAND STANDARD DETAIL S-17
- 6" SDR 35 PVC SANITARY SEWER(SS) @ MIN 1.0%.
- BACKWATER VALVE ASSEMBLY (48" Ø STRUCTURE). SEE MERCER ISLAND DETAIL S-26. VALVE ELEVATION WILL NEED TO BE MIN. 2' ABOVE HIGH WATER ELEVATION.
- SEWER CLEANOUT FOR LAKE LINE CONNECTIONS PER MERCER ISLAND DETAIL S-25 (C3.2). LOCATE SO MIN. 2.0' ABOVE LAKE LEVEL. USE FOGTITE METER BOX COVER.

WATER IMPROVEMENTS

- NEW SF RESIDENTIAL WATER SERVICE & METER PIT. CONFIRM REQUIRED SIZE WITH BUILDING PERMIT REVIEW. INSTALL PER MERCER ISLAND DETAIL W-13, W-14, OR W-14A DEPENDING ON SIZE REQUIREMENT.
- MIN 1.5" 250 PSI PRIVATE HDPE WATER (ASTM D2239) FROM METER TO HOUSE. RECOMMENDED DEPTH=36". COORDINATE HOUSE ENTRY WITH BUILDER/OWNER.
- REDUCED PRESSURE BACKFLOW ASSEMBLY (RPBA) DEVICE REQUIRED. PROVIDE FROST PROTECTION IN ACCORDANCE WITH UNIFORM PLUMBING CODE.

LEGAL DESCRIPTION
 SEE C12

STORM DRAIN

- 4" FOUNDATION DRAIN (3034 PVC) @ MIN 2% GRADE
- 6" STORM DRAIN (3034 PVC) @ MIN 1% GRADE.
- 8" STORM DRAIN (SDR 35 PVC OR EQUAL), MIN 1.0% GRADE. PROFILE AS NOTED ON PLAN.

MISC IMPROVEMENTS

- KEYSTONE RETAINING WALL. TYPICAL SECTION C3.4. SEE PLAN FOR ESTIMATED HEIGHTS.

STORM DRAIN STRUCTURES


- TYPE 1 CB WITH STANDARD GRATE. MAX 5' RIM TO FL DEPTH.
- TYPE 1 CB WITH VANED LID. MAX 5' RIM TO FL DEPTH.
- TYPE 1 CB WITH SOLID LID. MAX 5' RIM TO FL DEPTH.
-
-
-
-
-
-
- NDS DURASLOPE CHANNEL DRAIN OR EQUAL. MINIMUM 12" CHANNEL. CLASS B VEHICLE RATED GRATE.
-
-
- PRIVATE TYPE 40 CATCH BASIN.
-
- PIPE DISCHARGE ROCK PAD. HAND PLACED 4" TO 8" QUARRY SPALLS OVER 6" GRANULAR BEDDING. BEVEL PIPE END.
-
-
-

ADDED CITY NOTES

A A construction fence along the entire length of the north edge of the public sewer main easement within the property limits is required to protect the existing sewer main. Fence shall remain and be maintained for the duration of the construction. All work within the public sewer easement shall be completed by hand to protect the existing sewer main, unless otherwise approved of the City Engineer. No heavy equipment shall cross the temporary construction fence or into the easement area.

B 2. The contractor is required to TV the existing city sewer main from MH 37-2, MH 37-1 to lake prior to any construction activities and prior to request the final inspection. The contractor is required to submit inspection results (DVD) to the city. If there are any damages to the city sewer main due to the result of the project. The owner is required to repair the damages to the satisfaction of the City Engineer.

SOIL AMENDMENT REQUIRED
 COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION. SEE DETAIL ON C3.5

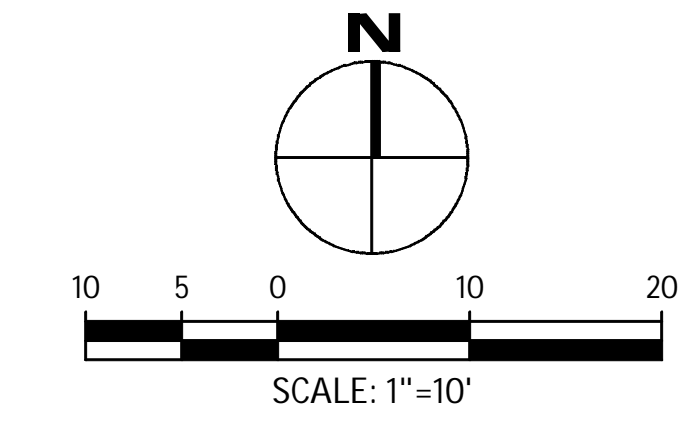


NO.	DATE	BY	REVISIONS

APPLICANT:
 JOHAN VALENTIN
 PO BOX 52641
 BELLEVUE, WA 98015

811
 Know what's below.
 Call before you dig.

DATE: May 13, 2019
 JOB# 1704
 DRAFTED: DE DESIGN: DE
 DIGITAL SIGNATURE

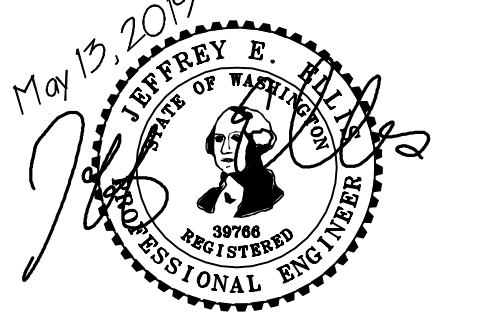


CIVIL ENGINEERING SOLUTIONS
 102 NW CANAL STREET SEATTLE, WA 98107
 PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

DRAINAGE / CIVIL PLAN
 VALENTIN RESIDENCE
 4350 E. MERCER WAY, MERCER ISLAND, WA 98040

DRAWING NO:
C2.0
 APN 004610-0150
1902-013

LAKE CONNECTION CLEANOUT

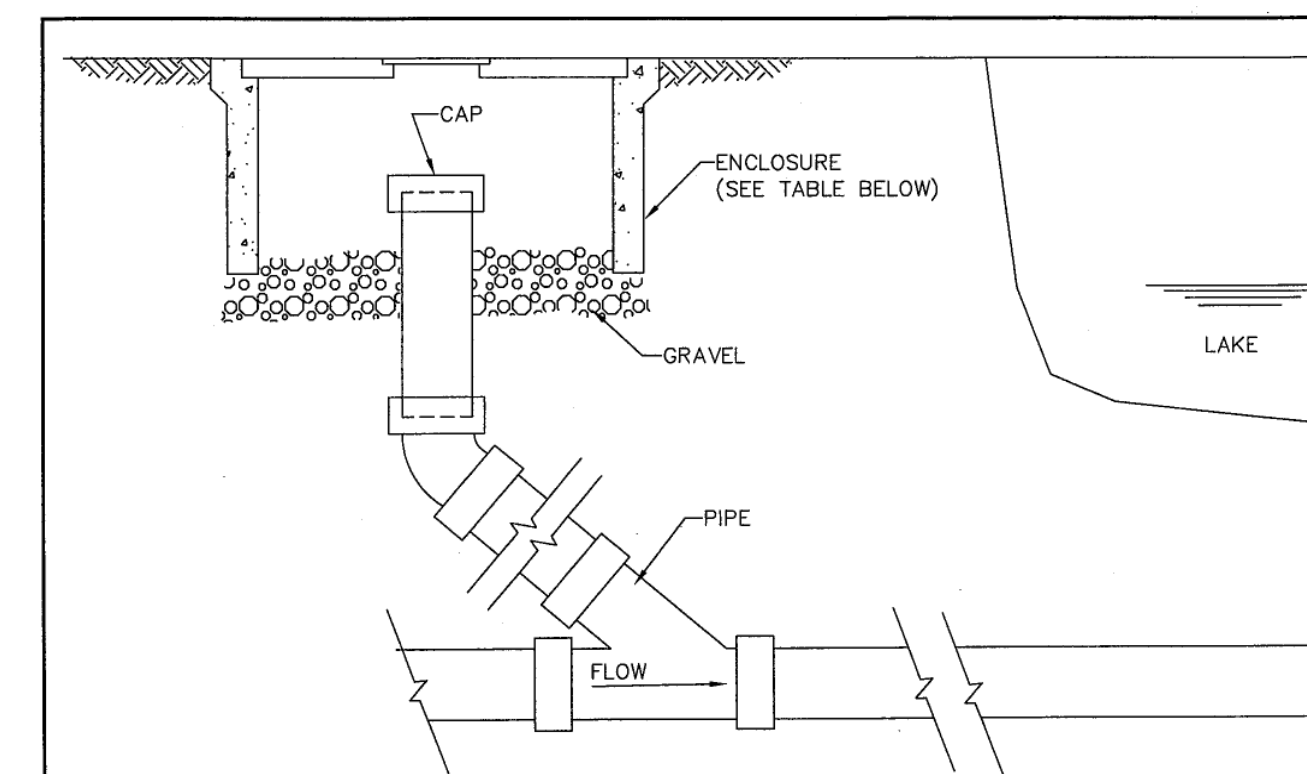

PIPE SIZE	MATERIAL	CAP	ENCLOSURE	COMMENTS
6"	PVC	SIDU MECHANICAL SEWER PLUG	CONC. METER BOX, FOGTITE 1-D	INSTALLATION BELOW HYDRAULIC GRADIENT
6"	PVC	PVC CAP W/O GASKET	CONC. METER BOX, FOGTITE 1-D	INSTALLATION ABOVE HYDRAULIC GRADIENT
6"	DIP	MECHANICAL JOINT CAP	CONC. METER BOX, FOGTITE 1-D	INSTALLATION ABOVE HYDRAULIC GRADIENT
8"	PVC	PVC CAP W/O GASKET	CONC. METER BOX, FOGTITE NO. 2 (CONC. LID W/ ALUM. INS. PLATE)	INSTALLATION ABOVE HYDRAULIC GRADIENT
8"	DIP	MECHANICAL JOINT CAP	CONC. METER BOX, FOGTITE NO. 2 (CONC. LID W/ ALUM. INS. PLATE)	INSTALLATION ABOVE HYDRAULIC GRADIENT

NOTES

- IF POSSIBLE, CLEANOUT TO BE LOCATED JUST ABOVE HYDRAULIC GRADIENT OF LAKE LINE. CLEANOUT SHOULD ALSO BE LOCATED TO PROVIDE EASY ACCESS FOR INSPECTION AND MAINTENANCE BY THE HOME OWNER.
- SEE S-23 & S-24 FOR BACK WATER VALVE LOCATION.




CITY OF MERCER ISLAND
STANDARD DETAILS
SEWER

SIDE SEWER CLEANOUT FOR LAKE LINE CONNECTIONS

6-5-2009 NO SCALE **S-25**

REV DATE APPROVED

BACKWATER VALVE & MH

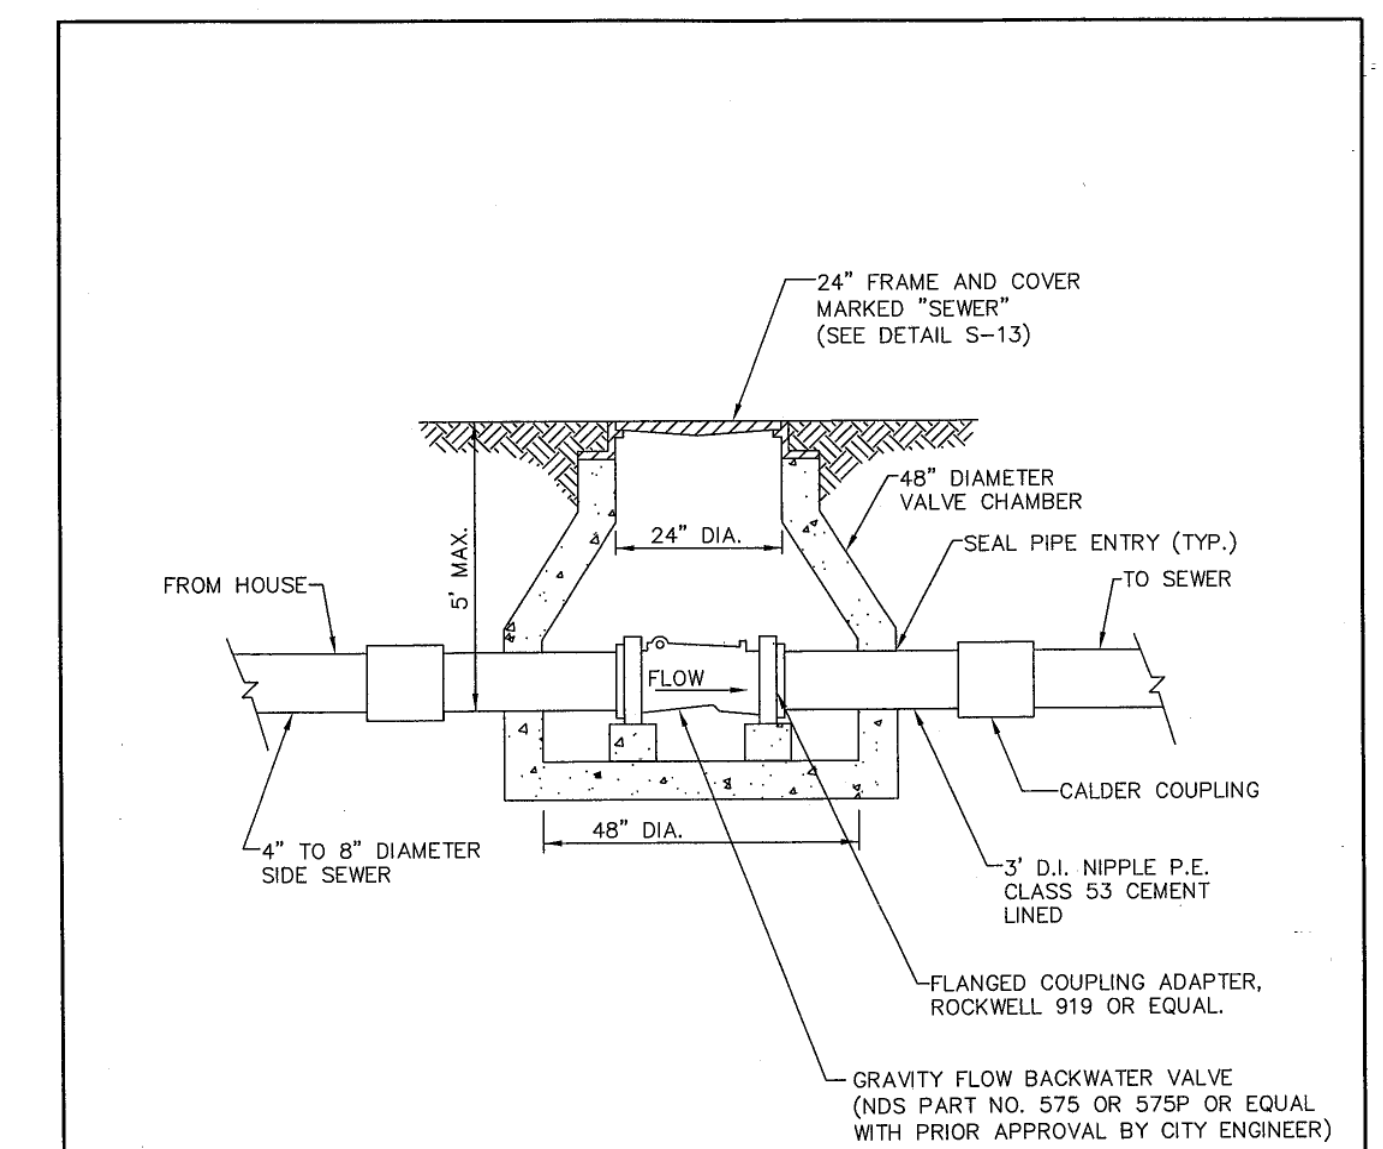

CITY OF MERCER ISLAND
STANDARD DETAILS
SEWER

BACK WATER VALVE ASSEMBLY FOR JOINT USE SIDE SEWER (4" OR 6" DIAMETER)


6-5-2009 NO SCALE **S-26**

REV DATE APPROVED



APPLICANT:
JOHAN VALENTIN
PO BOX 52641
BELLEVUE, WA 98015

DATE: May 08, 2019
JOB# 1704
DRAFTED: DE DESIGN: DE
DIGITAL SIGNATURE

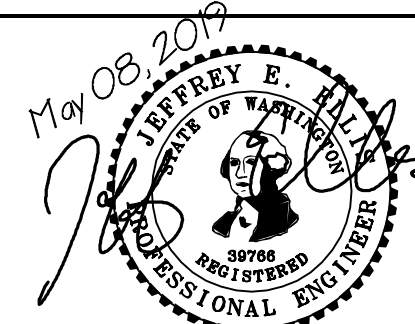

CIVIL ENGINEERING SOLUTIONS

102 NW CANAL STREET SEATTLE, WA 98107
PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

SAN SEWER DETAILS

VALENTIN RESIDENCE
4350 E. MERCER WAY, MERCER ISLAND, WA 98040

DRAWING NO:

C3.2

APN 004610-0150
1902-013

NO.	DATE	BY	REVISIONS

KEYSTONE GRAVITY WALL (DRIVEWAY)

KEYSTONE STANDARD 18" UNITS
MAX 48" HEIGHT

RETAINING WALL BACKFILL SPEC

SOURCE: GEOTECHNICAL REPORT BY GEOTECH CONSULTANTS, INC

Retaining Wall Backfill and Waterproofing

Backfill placed behind retaining or foundation walls should be coarse, free-draining structural fill containing no organics. This backfill should contain no more than 5 percent silt or clay particles and have no gravel greater than 4 inches in diameter. The percentage of particles passing the No. 4 sieve should be between 25 and 70 percent. If the native soil is used as backfill, a minimum 12-inch width of free-draining gravel should be placed against the backfilled retaining walls. The gravel should be hydraulically connected to the foundation drain system.


The purpose of these backfill requirements is to ensure that the design criteria for a retaining wall are not exceeded because of a build-up of hydrostatic pressure behind the wall. Also, subsurface drainage systems are not intended to handle large volumes of water from surface runoff. The top 12 to 18 inches of the backfill should consist of a compacted, relatively impermeable soil or topsoil, or the surface should be paved. The ground surface must also slope away from backfilled walls to reduce the potential for surface water to percolate into the backfill. Water percolating through pervious surfaces (pavers, gravel, permeable pavement, etc.) must also be prevented from flowing toward walls or into the backfill zone. The compacted subgrade below pervious surfaces and any associated drainage layer should therefore be sloped away. Alternatively, a membrane and subsurface collection system could be provided below a pervious surface.

It is critical that the wall backfill be placed in lifts and be properly compacted, in order for the above-recommended design earth pressures to be appropriate. The wall design criteria assume that the backfill will be well-compacted in lifts no thicker than 12 inches. The compaction of backfill near the walls should be accomplished with hand-operated equipment to prevent the walls from being overloaded by the higher soil forces that occur

during compaction. The section entitled *General Earthwork and Structural Fill* contains additional recommendations regarding the placement and compaction of structural fill behind retaining and foundation walls.

The above recommendations are not intended to waterproof below-grade walls, or to prevent the formation of mold, mildew or fungi in interior spaces. Over time, the performance of subsurface drainage systems can degrade, subsurface groundwater flow patterns can change, and utilities can break or develop leaks. Therefore, waterproofing should be provided where future seepage through the walls is not acceptable. This typically includes limiting cold-joints and wall penetrations, and using bentonite panels or membranes on the outside of the walls. There are a variety of different waterproofing materials and systems, which should be installed by an experienced contractor familiar with the anticipated construction and subsurface conditions. Applying a thin coat of asphalt emulsion to the outside face of a wall is not considered waterproofing, and will only help to reduce moisture generated from water vapor or capillary action from seeping through the concrete. As with any project, adequate ventilation of basement and crawl space areas is important to prevent a buildup of water vapor that is commonly transmitted through concrete walls from the surrounding soil, even when seepage is not present. This is appropriate even when waterproofing is applied to the outside of foundation and retaining walls. We recommend that you contact an experienced envelope consultant if detailed recommendations or specifications related to waterproofing design, or minimizing the potential for infestations of mold and mildew are desired.

The *General, Slabs-On-Grade, and Drainage Considerations* sections should be reviewed for additional recommendations related to the control of groundwater and excess water vapor for the anticipated construction.

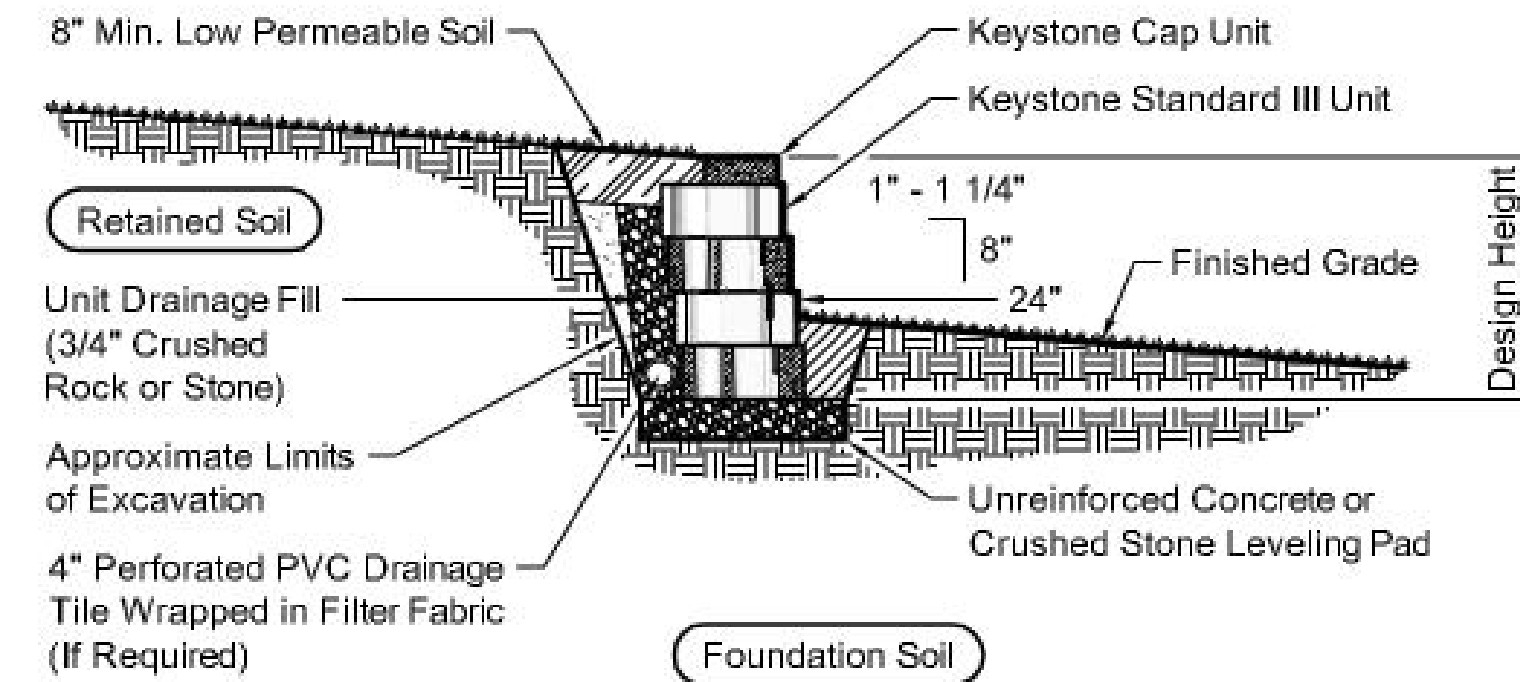

Typical Gravity Wall Section


Standard III Unit - 1" Setback

NO.	DATE	BY	REVISIONS

APPLICANT:
JOHAN VALENTIN
PO BOX 52641
BELLEVUE, WA 98015



DATE: May 08, 2019
JOB# 1704
DRAFTED: DE DESIGN: DE
DIGITAL SIGNATURE

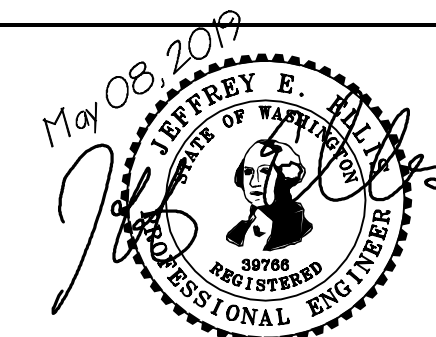

CIVIL ENGINEERING SOLUTIONS

102 NW CANAL STREET SEATTLE, WA 98107
PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US


MISC DETAILS
VALENTIN RESIDENCE
4350 E. MERCER WAY, MERCER ISLAND, WA 98040

DRAWING NO:


C3.4

APN 004610-0150
1902-013

PRIVATE DRIVEWAY / STORM PROFILE

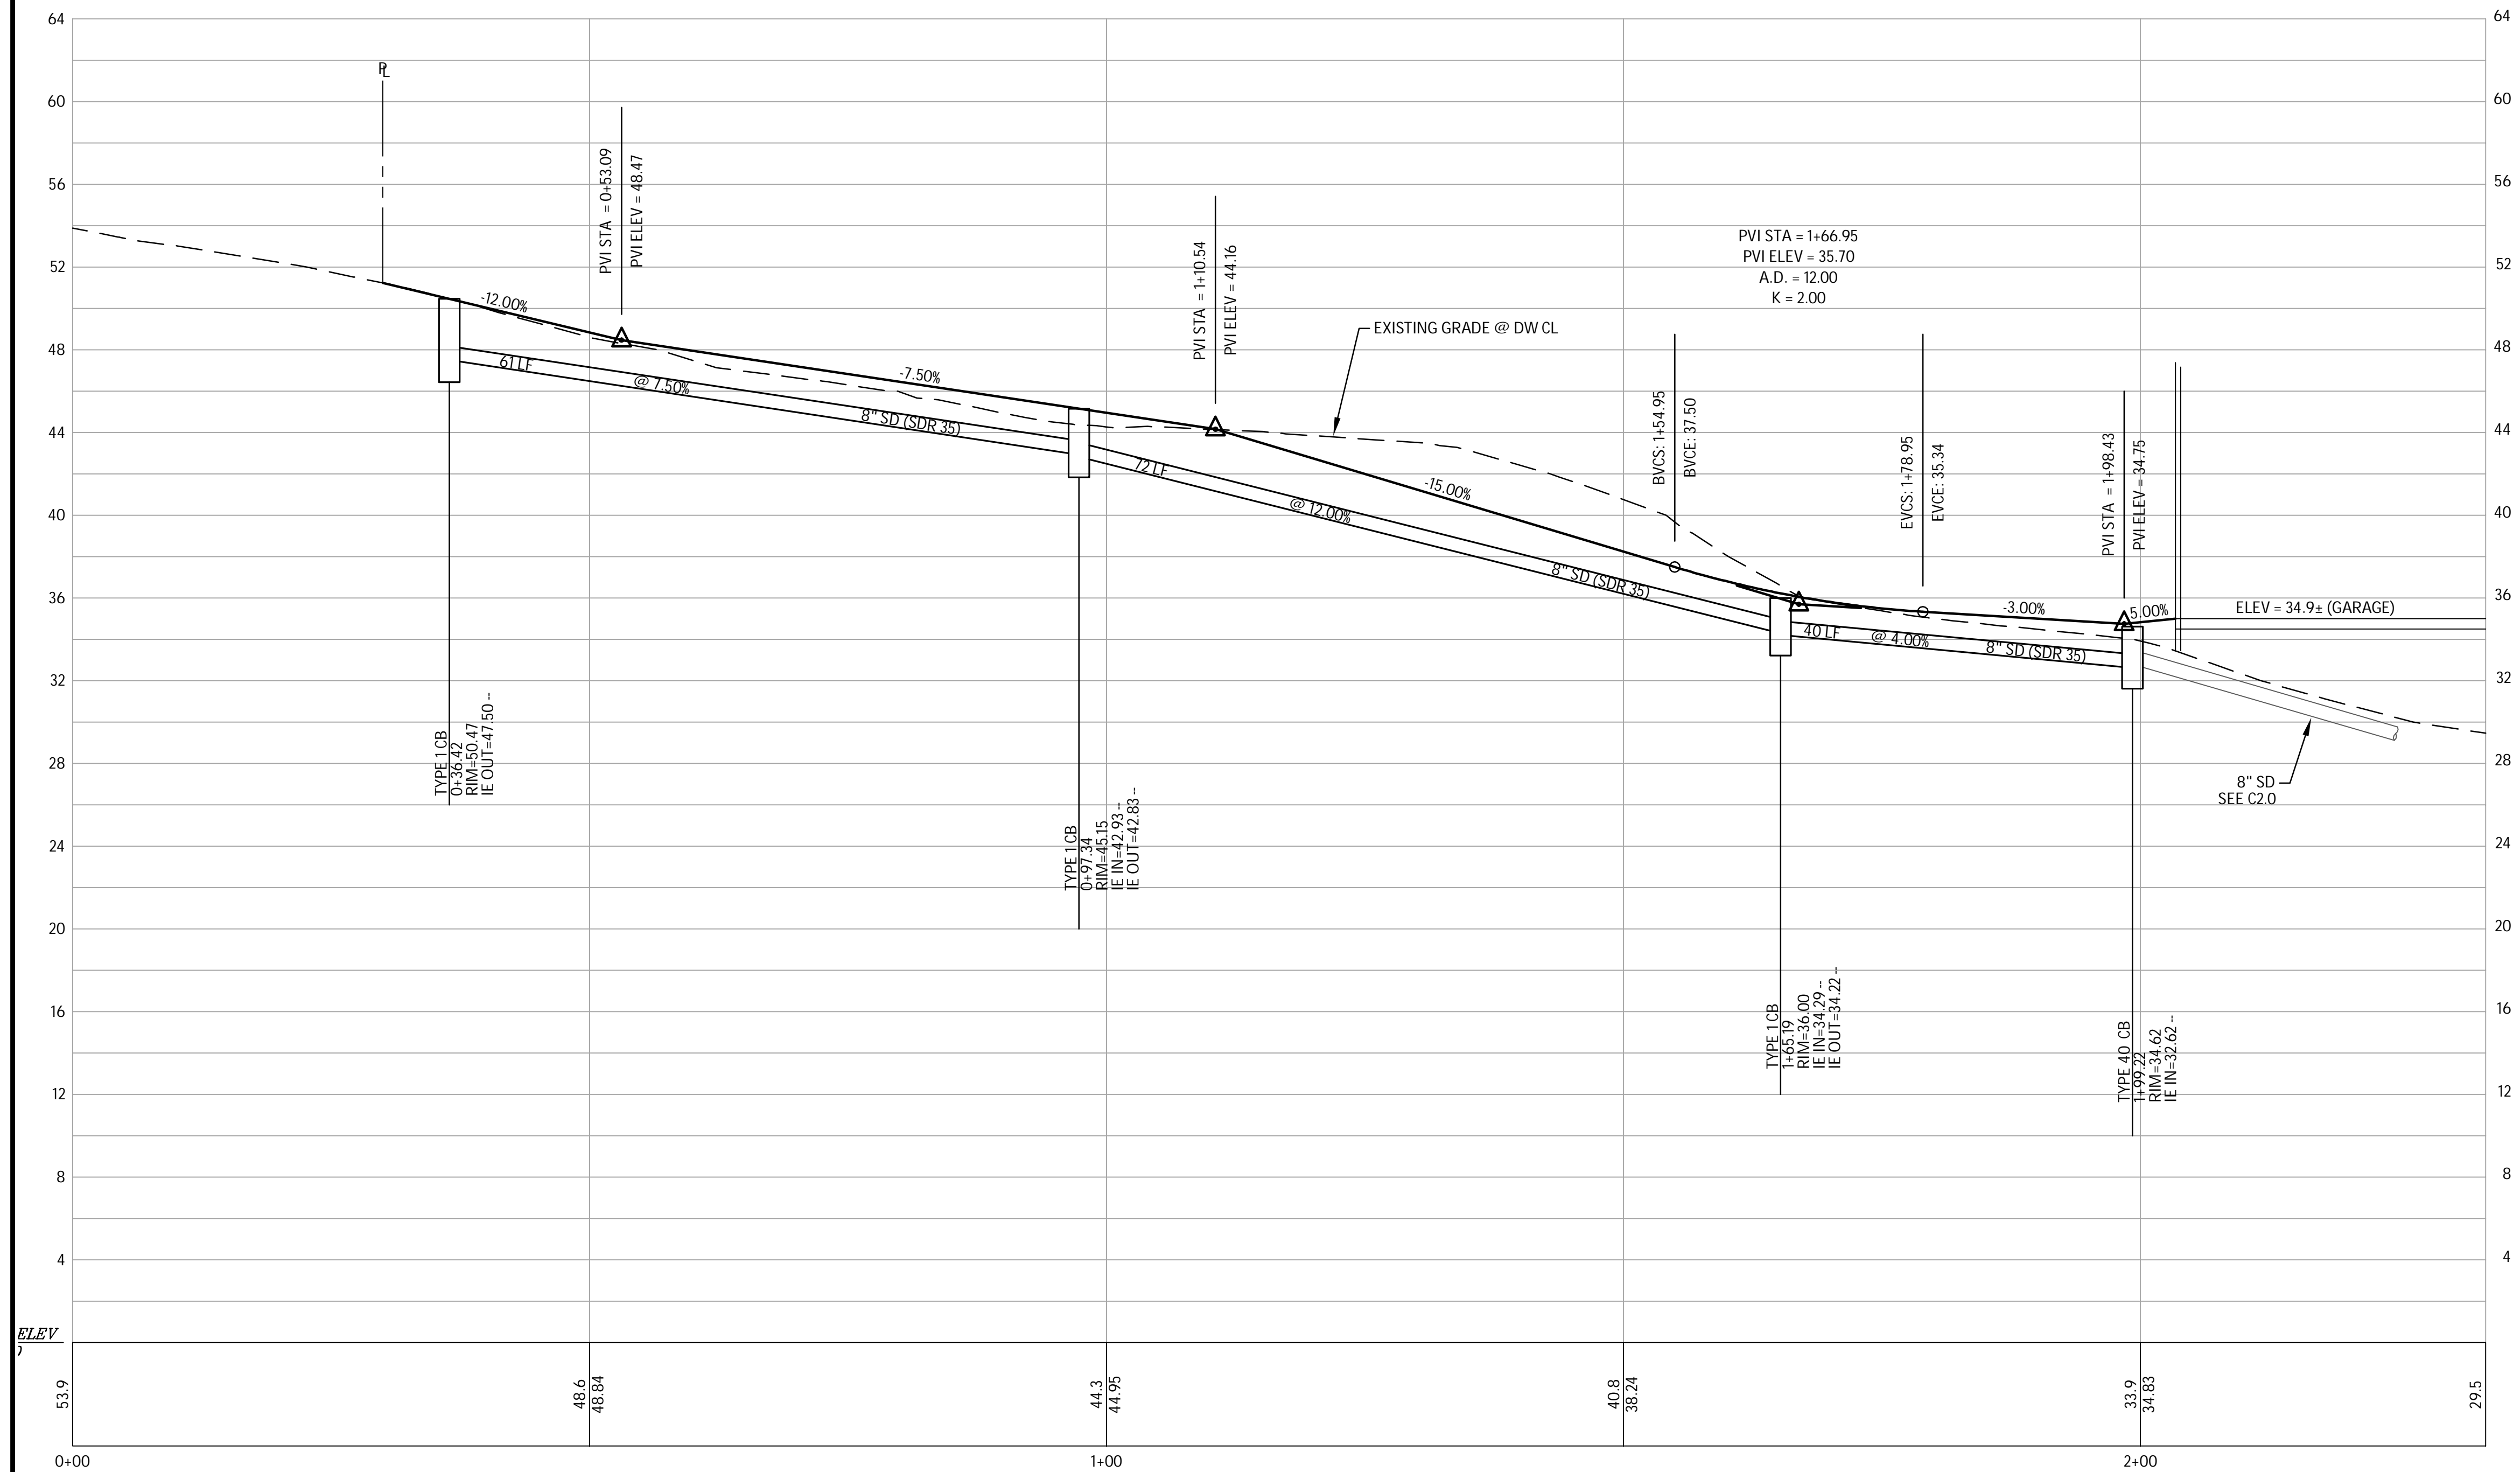

COMPOST AMENDED SOIL SPEC

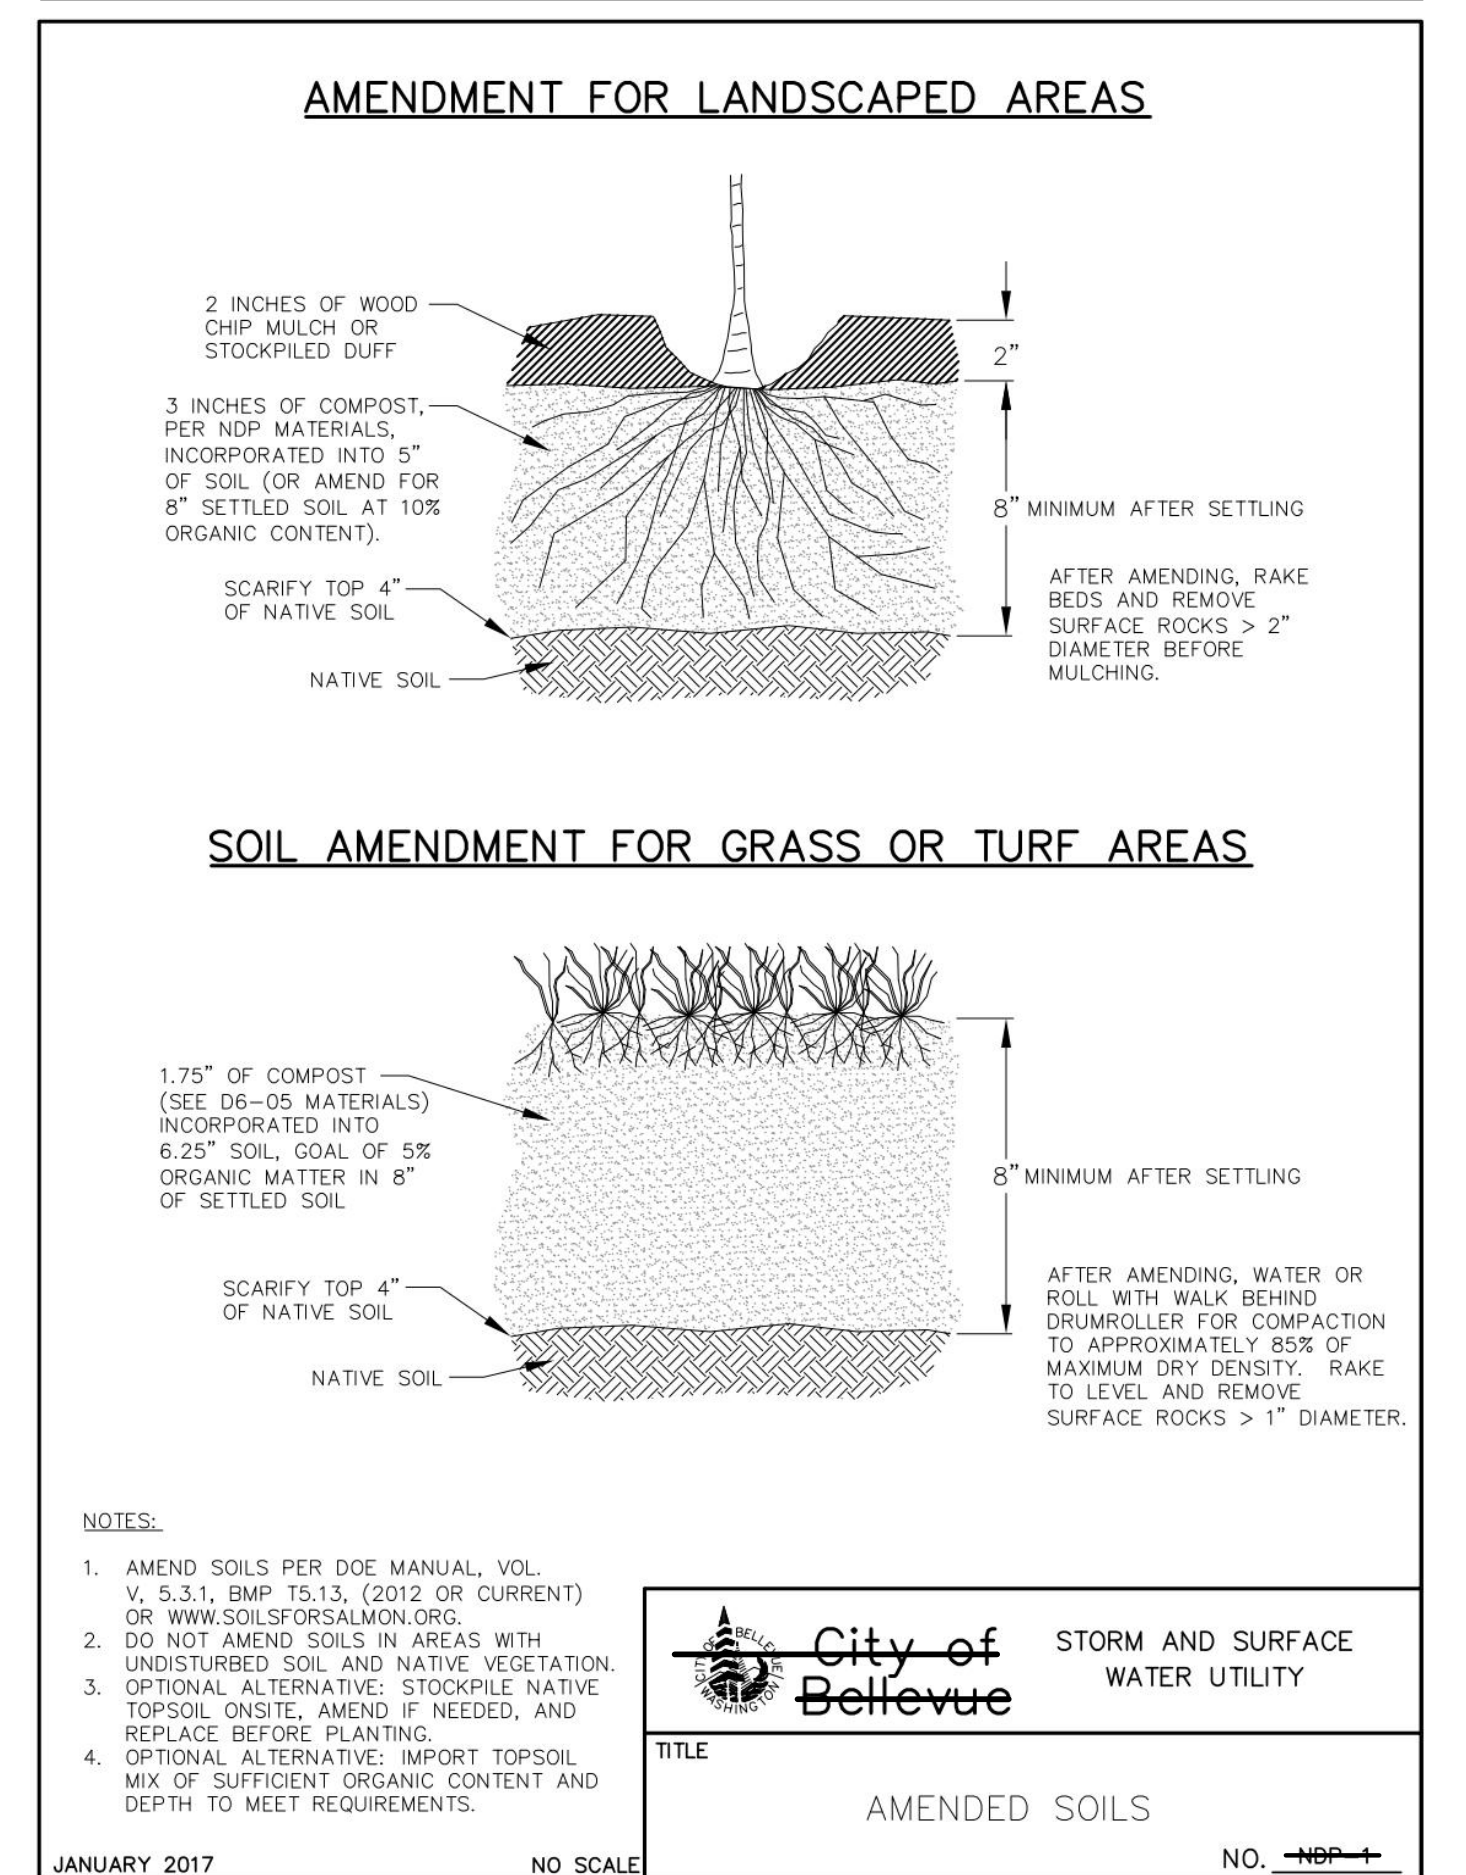


NO.	DATE	BY	REVISIONS

APPLICANT:
 JOHAN VALENTIN
 PO BOX 52641
 BELLEVUE, WA 98015



DATE: May 08, 2019
 JOB# 1704
 DRAFTED: SS DESIGN: SS
 DIGITAL SIGNATURE

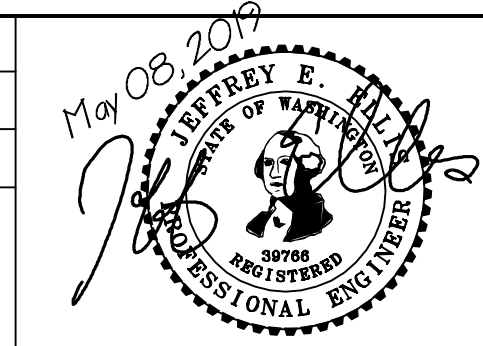

CIVIL ENGINEERING SOLUTIONS
 102 NW CANAL STREET SEATTLE, WA 98107
 PHONE: 206.930.0342 DUFFY@CESOLUTIONS.WA

DRAINAGE DETAILS / STORM PROFILE
 VALENTIN RESIDENCE
 4350 E. MERCER WAY, MERCER ISLAND, WA 98040

DRAWING NO:
C3.5
 APN 004610-0150
 1902-013