

GENERAL NOTES

- CODE COMPLIANCE**
ALL WORK SHALL COMPLY WITH THE 2015 IBC, 2015 IMC, 2015 IFGC, 2015 UFC, 2015 IPMC, 2008 NEC, 2015 INTERNATIONAL ENERGY CONSERVATION CODE WITH WASHINGTON STATE AMENDMENTS, 2009 ICC A117.1, AND WITH ALL LOCAL CODES AND ORDINANCES.
- DIMENSIONS**
A. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. NOTIFY THE ARCHITECT OF DISCREPANCIES. IF WORK IS STARTED PRIOR TO NOTIFICATION, THE GENERAL AND SUBCONTRACTOR PROCEED AT THEIR OWN RISK.
B. UNLESS OTHERWISE NOTED, PLAN DIMENSIONS ARE TO FACE OF STUDS OR FACE OF CONCRETE WALLS. FACE OF STONE VENEER LIES 1/2" OUTSIDE THE FACE OF FRAMING. INTERIOR PLAN DIMENSIONS ARE TO FACE OF STUDS UNLESS OTHERWISE NOTED.
C. VERIFY ALL ROUGH-DIMENSIONS FOR WINDOWS, DOORS, PLUMBING, ELECTRICAL FIXTURES AND APPLIANCES PRIOR TO COMMITMENT OF WORK. NOTIFY ARCHITECT OF ANY DISCREPANCIES OF DIMENSIONAL TOLERANCES REQUIRED.
- DOCUMENT REVIEW/VERIFICATION**
CONSULT WITH ARCHITECT REGARDING ANY SUSPECTED ERRORS, OMISSIONS, OR CHANGES ON PLANS BEFORE PROCEEDING WITH THE WORK.
- ROUGH OPENINGS/BACKING**
VERIFY SIZE AND LOCATION, AS WELL AS PROVIDE ALL OPENINGS THROUGH FLOORS AND WALLS. FURRING, CURBS, ANCHORS, INSERTS, EQUIPMENT BASES AND ROUGH BUCKS/BACKING FOR SURFACE-MOUNTED ITEMS.
- FURRING**
PROVIDE FURRING AS REQUIRED TO CONCEAL MECHANICAL AND/OR ELECTRICAL EQUIPMENT IN FINISHED AREAS. FURRING NOT SHOWN ON PLANS SHALL BE APPROVED BY ARCHITECT PRIOR TO CONSTRUCTION.
- GRADES** VERIFY ALL GRADES AND THEIR RELATIONSHIP TO THE BUILDINGS(S).
- FLOOR LINES** "FLOOR LINE" REFERS TO TOP OF CONCRETE SLAB OR TOP OF WOOD SUBFLOOR.
- REPETITIVE FEATURES** OFTEN DRAWN ONLY ONCE AND SHALL BE PROVIDED AS IF FULLY DRAWN.
- DOORS**
DOORS NOT DIMENSIONALLY LOCATED SHALL BE 6" FROM STUD FACE TO EDGE OF DOOR, ROUGH OPENING OR CENTERED BETWEEN WALLS AS SHOWN.
- WOOD MEMBERS IN CONTACT WITH CONCRETE, AND/OR EXPOSED TO WEATHER**
TO BE PRESSURE TREATED, TYPICAL. PROVIDE PRESSURE TREATED SILL PLATE IF FINISH GRADE IS WITHIN 8" TYPICAL.
- FRAMING**
ALL NEW INTERIOR FRAME PARTITIONS TO BE 2X4 @ 16" O.C. & ALL NEW EXTERIOR FRAME PARTITIONS TO BE 2X6 @ 16" O.C., UNLESS OTHERWISE NOTED. VERIFY W/ STRUCTURAL DRAWINGS. EXISTING EXTERIOR WALLS ARE 2X4 STUDS @ 16" O.C. AND ARE TO REMAIN.
- VENTILATION**
VENT ALL BATHROOM FANS, LAUNDRY FANS, RANGE HOODS AND DRYERS TO OUTSIDE ATMOSPHERE. BATHROOM UTILITY ROOM FANS SHALL BE CAPABLE OF 5 AIR CHANGES PER HOUR AND SHALL BE VENTED DIRECTLY TO THE OUTSIDE THROUGH SMOOTH, RIGID, NON-CORROSIVE METAL 24 GA. DUCTWORK. FLEX DUCTING IS NOT ALLOWED.
- FLUES** FLUES TO BE LOCATED MINIMUM 2" FROM ALL COMBUSTIBLE MATERIALS.
- DOWNSPOUTS** LOCATED SPACES OF STUD WALLS AND PARTITIONS. 2) AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES. 3) IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT T.O. & B.O. RUN. 4) AT OPENINGS AROUND VENTS, PIPES, ETC. AT CEILING AND FLOOR LEVEL.
- PROTECTION**
PROTECT ALL EXISTING FINISHES AND SURFACES. ANY DAMAGE WILL BE REPAIRED WITHOUT ADDITIONAL COST TO OWNER.
- PERMITS**
SEPARATE ELECTRICAL, MECHANICAL, AND PLUMBING PERMITS ARE REQUIRED IN ADDITION TO THE BASIC BUILDING PERMIT.
- ROOFING**
PROVIDE NEW ROOFING TO MATCH EXISTING.
- EXHAUST DUCTS**
PROVIDE BACKDRAFT DAMPERS AT ALL EXHAUST DUCTS. PROVIDE COMBUSTION AIR OPENINGS INTO FURNACE ROOM PER UMC 703.
- APPLIANCES**
CLEARANCES OF UL LISTED APPLIANCES FROM COMBUSTIBLE MATERIALS SHALL BE AS SPECIFIED IN UL LISTING.
- WATER FLOW**
SHOWER SHALL BE EQUIPPED WITH FLOW CONTROL DEVICE TO LIMIT WATER FLOW TO 2.5 GALLONS PER MINUTE.
- SMOKE DETECTORS**
SMOKE & CARBON MONOXIDE THROUGHOUT NEW CONSTRUCTION. TO BE MONITORED PER FIRE DEPARTMENT REQUIREMENTS.
- FIREBLOCKING**
FIREBLOCKING SHALL BE PROVIDED IN WOOD-FRAMED CONSTRUCTION PER 2015 IRC SECTION R302.11, SPECIFICALLY: 1) IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS. 2) AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES. 3) IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT T.O. & B.O. RUN. 4) AT OPENINGS AROUND VENTS, PIPES, ETC. AT CEILING AND FLOOR LEVEL.

ENERGY NOTES

- CODE:** 2015 W.S.E.C. & 2015 I.R.C. IAC 51-11R CLIMATIC ZONE: ZONE #4 - MARINE
- SPACE HEAT TYPE:** NATURAL GAS, FORCED AIR SYSTEM THERMAL STANDARDS: UNLIMITED OPTION
- INSULATION VALUES:** WALLS: R-21 FOR OPENINGS: R-21
FLAT ATTIC/Ceilings: R-49
VAULTED Ceilings: R-38
FLOORS (OVER UNHEATED SPACES): R-30
SLAB-ON-GRADE: R-10
- AIR INFILTRATION:** MANUFACTURED DOORS/WINDOWS: CONFORM TO SECTION R402.4.3 OF THE WASHINGTON STATE ENERGY CODE
- EXTERIOR JOINTS/OPENINGS:** SEAL, CAULK, GASKET OR WEATHERSTRIP TO LIMIT AIR LEAKAGE AT EXTERIOR JOINTS AROUND WINDOW AND DOOR FRAMES, OPENINGS BETWEEN WALLS AND FOUNDATION, BETWEEN WALLS AND ROOF, OPENINGS AT PENETRATIONS OF UTILITY SERVICES AND ALL OTHER SUCH OPENINGS IN THE BUILDING ENVELOPE
- MOISTURE CONTROL:** WALLS: VAPOR RETARDER BONDED TO BATT INSULATION; INSTALL WITH STAPLES NOT MORE THAN 8 INCHES ON CENTER AND WITH A GAP BETWEEN AND OVER FRAMING NOT GREATER THAN 1/16 OF AN INCH. OR, VAPOR RETARDER OF ONE PERM CUP RATING (4 MIL POLYETHYLENE)
- ATTIC/Ceilings:** VAPOR RETARDER OF ONE PERM CUP RATING (4 MIL POLYETHYLENE). INSTALL CONTINUOUSLY
- CRAWL SPACE:** 6 MIL POLYETHYLENE
- VENTILATION:** ATTICS WITH LOOSE FILL: N.A. BAFFLE VENT OPENINGS TO DEFLECT AIR ABOVE INSULATION SURFACE ENCLOSED JOIST OR RAFTER SPACES; PROVIDE MINIMUM OF ONE INCH CLEAR VENTED AIR SPACE ABOVE INSULATION. TAPER OR COMPRESS INSULATION AT PERIMETER TO INSURE PROPER VENTILATION, MAINTAINING MINIMUM OF R-38.
- HEATING & COOLING:** AIR SOURCE HEAT PUMP W/ MIN HSPF OF 9.0
- TEMP. CONTROL:** FOR HEATING AND COOLING, THERMOSTAT SHALL BE CAPABLE OF BEING SET FROM 55-85 DEGREES FAHRENHEIT AND OF OPERATING THE HEATING/COOLING SYSTEM IN SEQUENCE. THERMOSTAT TO BE AUTOMATIC DAY/NIGHT SETBACK TYPE.
- DUCT INSULATION:** THERMALLY INSULATE ALL PLENUMS, DUCTS AND ENCLOSURES IN ACCORDANCE WITH SECTION R403.3.1 OF THE WASHINGTON STATE ENERGY CODE.
- a. ALL HEATING DUCTS IN UNCONDITIONED SPACES SHALL BE INSULATED WITH A MIN. OF R-8. ALL SEAM JOINTS SHALL BE TAPED, SEALED AND FASTENED WITH THE MINIMUM OF FASTENERS PER WSEC.
- b. DUCTS WITHIN A CONCRETE SLAB OR IN THE GROUND SHALL BE INSULATED TO R-10, WITH INSULATION DESIGNED TO BE USED BELOW GRADE.
- LIGHTING:** RECESSED LIGHTING FIXTURES INSTALLED IN BUILDING ENVELOPE SHALL COMPLY WITH WSEC PROVISIONS AND SHALL BE LISTED.
- PIPE INSULATION:** ALL HOT WATER PIPES, AND NON-RECIRCULATING COLD WATER PIPES LOCATED IN UNCONDITIONED SPACE, SHALL BE INSULATED TO R-3 MIN. PLUMBING OR MECHANICAL CANNOT DISPLACE THE REQUIRED INSULATION.
- WHOLE HOUSE VENTILATION:**
- WHOLE HOUSE VENTILATION SHALL BE PROVIDED BY EXHAUST FAN PROVIDING 320 CFM RUNNING INTERMITTENTLY PER 2015 IRC TABLE M1507.3.3 (1&2). FAN SHALL BE LESS THAN 35 WATT PER CFM AND CONNECTED TO A 24 HOUR CLOCK TIMER AND HAVE A SONE RATING OF LESS THAN 1.0. VENTILATION SHALL BE ABLE TO OPERATE INDEPENDENTLY OF HEATING SYSTEM.
 - SYSTEM SHALL HAVE A 5/8" SMOOTH FRESH AIR DUCT W/ LOUVER & SCREEN CONNECTED TO THE RETURN AIR STREAM 4' UPSTREAM OF THE AIR HANDLER AND INSULATED W/ R-4 MIN IN HEATED AREAS.
 - SHALL HAVE A FILTER WITH A MERV OF AT LEAST 6 INSTALLED IN AN EASILY ACCESSIBLE LOCATION.
 - FRESH AIR VENT SHALL BE LOCATED AWAY FROM SOURCES OF ODORS OR FUMES, MIN 10' FROM PLUMBING OR APPLIANCE VENTS, AWAY FROM ROOMS W/ FUEL BURNING APPLIANCES, AND OUT OF ATTICS, CRAWL SPACES, AND GARAGES.
 - AIRFLOW FOR WHOLE HOUSE EXHAUST FAN SHALL BE PROVIDED BY UNDERCUTTING INTERIOR DOORS 1/2" ABOVE FINISHED FLOOR, TYP.
- PLUMBING FIXTURES:** ALL PLUMBING FIXTURES SHALL CONFORM TO RCW 19.27.170
ALL TOILETS 1.6 GPM MAX URINALS 1.0 GPM MAX
SHOWERHEADS < 1.75 GPM FAUCETS < 1.75 GPM
LAVATORIES < 1.0 GPM

PROJECT DATA

PROJECT ADDRESS: 4307 E MERCER WAY
MERCER ISLAND 98040

PROPERTY TAX ID NUMBER: 546110-0090

SCOPE OF WORK: RENOVATION OF EXISTING GARAGE INTO NEW LIVING ROOM. ADDITION OF NEW CARPORT. INSTALLATION OF NEW NANA-DOOR AND NANA-WINDOW. INTERIOR REMODEL OF EXISTING BEDROOM INTO NEW MASTER BATH, INCLUDING NEW BLUMPOUT UNDER EXISTING ROOF. ADDITION OF NEW ROOF OVER (E) DECK, NEW LOWER DECK

ZONING: R-15

CONSTRUCTION TYPE: TYPE V B

SEISMIC ZONE: 3

NUMBER OF STORIES: 1 STORY + DAYLIGHT BASEMENT

FIRE PROTECTION: NONE

BUILDING HEIGHT: MAX. 30 FT ABOVE AVERAGE BUILDING ELEV.

GROSS FLOOR AREA: 12,000 SF OR 40 % LOT AREA, WHICHEVER IS LESS

LOT AREA: 11,214 SF

SETBACKS: FRONT LOT LINE = 20 FT
REAR LOT LINE = 25 FT
SIDE LOT LINES = LOTS >90' WIDTH: SUM OF 17% LOT WIDTH, BOTH >5 FT

PROJECT TEAM

OWNER: ANDRE MARSHALL
4307 E. MERCER WAY
MERCER ISLAND, WA 98040
PHONE: 206.388.2075
ANDREMARSHALLJR@GMAIL.COM

CONTRACTOR: BETTER BUILDERS
4800 CALIFORNIA AVE SW
SEATTLE, WA 98116
PHONE: 206.388.2075
CONTACT: [REDACTED]

ARCHITECT: STURMAN ARCHITECTS, INC.
9 - 103RD AVENUE NE SUITE 203
BELLEVUE, WA 98004
PHONE: 425.451.7003
CONTACT: BRAD STURMAN

STRUCTURAL: SWENSON S&Y FACET STRUCTURAL ENGINEERING
2124 3RD AVE, STE. 100
SEATTLE, WA 98121
PHONE: 206.443.8212
CONTACT: BLAZE BRESKO

SHEET INDEX

- A1.0 COVER SHEET - GENERAL & ENERGY NOTES, LEGAL, PROJECT DATA, CUT-FILL CALC, INDEX, SITE PLAN
- SURVEY
- C1.0 EROSION & CONSTRUCTION STORMWATER CONTROL NOTES AND DETAILS
- A2.0 LOWER FLOOR PLAN
A2.1 MAIN FLOOR PLAN
A2.2 ROOF PLAN
A3.0 EXTERIOR ELEVATIONS
A4.0 BUILDING SECTIONS
A4.1 BUILDING SECTIONS
A5.0 WALL SECTIONS
- S-1 ENGINEERING PLAN
S-2 CARPORT PLAN
S-3 RETROFIT SHEAR WALL DETAIL
S-4 STRUCTURAL DETAILS
S-5 STRUCTURAL DETAILS
S-6 STRUCTURAL DETAILS
S-7 STRUCTURAL DETAILS
- AB-1 AS-BUILT LOWER FLOOR PLAN
AB-2 AS-BUILT MAIN FLOOR PLAN
- NEW STRUCTURAL SHEETS:**
S1.1 GENERAL STRUCTURAL NOTES
S2.1 MAIN FLOOR FRAMING/ FOUNDATION PLAN
S2.2 ROOF FRAMING PLAN
S3.1 STRUCTURAL DETAILS

GROSS FLOOR AREA

MAX GFA FOR R-15 IS EITHER 12,000 SQUARE FEET OR 40% OF THE LOT AREA, WHICHEVER IS LESS

40% OF 11,214 SF = 4,485.6 SF, SO THIS IS THE MAX ALLOWABLE GFA.

2974.1 SF OF GROSS FLOOR AREA IS LESS THAN MAXIMUM 4,485.6 SF

LEGAL DESCRIPTION

MERCERWOOD PARK ADD LESS POR WLY OF LN RGN S 07-01-36 W FR PT ON RD MGN 8 FT NE OF MOST WLY COR
PLAT BLOCK:
PLAT LOT: 9

CUT/FILL


CUT = 0 C.Y.
FILL = 0 C.Y.

2015 WSEC CREDITS


THIS PROJECT IS ADDING LESS THAN 500 SF OF CONDITIONED FLOOR AREA SO A CREDIT OF .5 IS REQUIRED.

CREDITS	OPTION	DESCRIPTION
.5	5A	EFFICIENT WATER HEATING
TOTAL CREDITS	.5	

VICINITY MAP

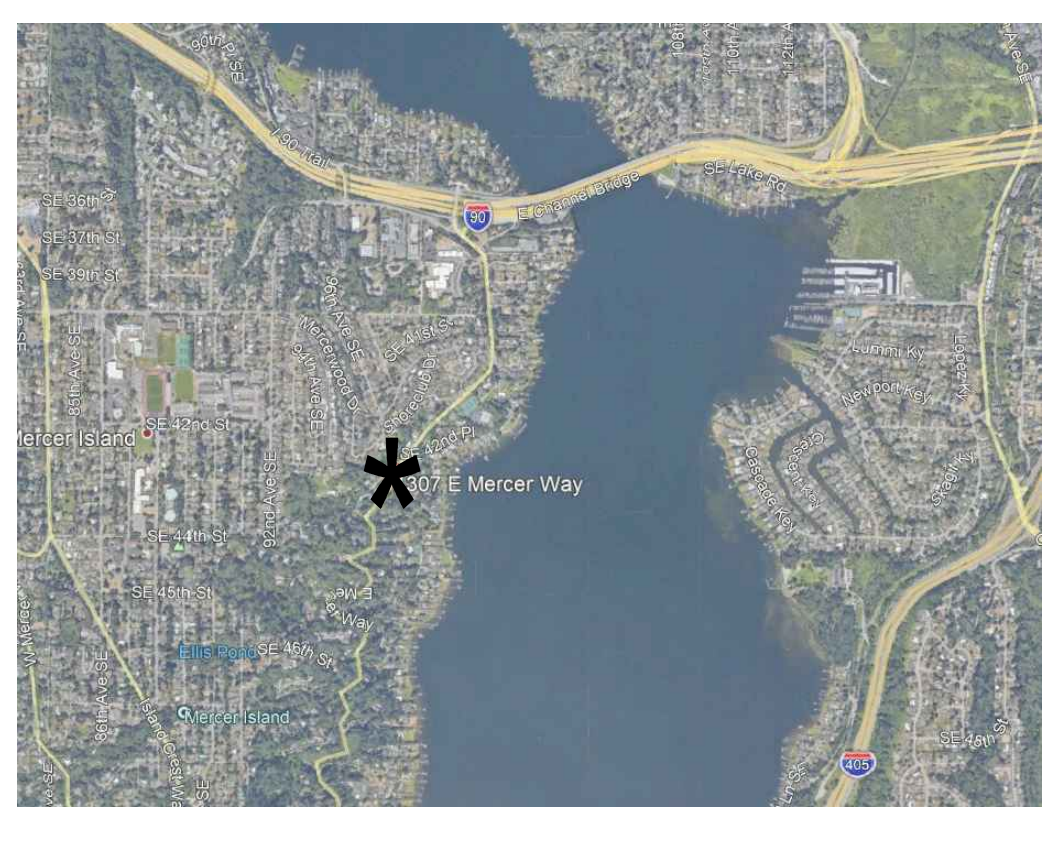

ABE KEY PLAN NO SCALE

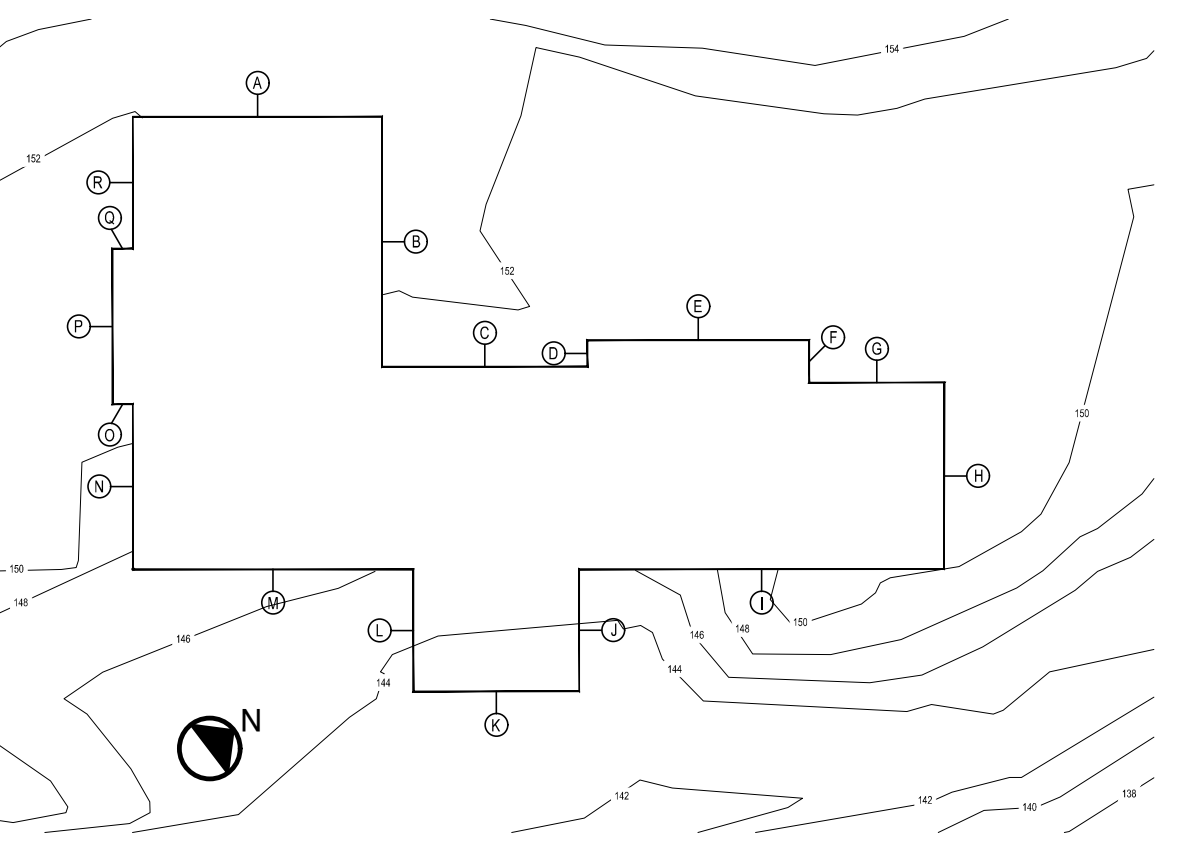

LOT COVERAGE (IMPERVIOUS AREA)

	GROSS LOT S.F.	MAIN ROOF STRUCT	DRIVES/PARKING	TOTAL LOT COVERAGE	% LOT COVERAGE	GRAVEL	SITE STEPS	DECK	PATIO	FRONT WALK	TOTAL HARDSCAPE	% HARDSCAPE
EXISTING IMPERVIOUS AREA	11,214 SF	2440 SF	2205 SF	4645 SF	41.4%	105.8 SF	59.5 SF	618 SF	483 SF	0 SF	1266.3 SF	11.3%
PROPOSED IMPERVIOUS AREA		2958.7 SF	934.7 SF	3893.4 SF	34.7%	60.9 SF	0 SF	502.5 SF	0 SF	140.8 SF	772.8 SF	6.9%
NET GAIN/LOSS IMPERVIOUS AREA		+518.7 SF	-1270.3 SF	-751.6 SF	-6.9%	-44.9 SF	-59.5 SF	-115.5 SF	-483 SF	+140.8 SF	-493.5 SF	-4.4%
% ALLOWED IMPERVIOUS AREA				3925 SF ALLOWABLE	35%						1029.26 SF ALLOWABLE	9%

HIGHEST EL: 174.0'
LOWEST EL: 132.0'
ELEVATION DIFFERENCE= 42.0'
42.0' DIVIDED BY 166.56' (HORIZ. DIST. BTWN. HIGHEST & LOWEST ELEV.) = 25

LOT SLOPE IS 25%, WHICH IS GREATER THAN 15%, SO LOT COVERAGE ALLOWED IS 35%.

ADDITIONAL 9% OF LOT SIZE WILL DETERMINE ALLOWABLE HARDSCAPE SURFACE


AVERAGE BUILDING ELEVATION

	Wall Length	Elevation Pt.	Wall Length X Elev. Pt.
A	24	152.0	3648
B	24	152.0	3648
C	19.71	151.5	2986.065
D	2.54	151.5	384.81
E	21.31	151.0	3217.81
F	4.06	151.0	613.06
G	13	151.0	1963
H	17.92	150.5	2696.96
I	35	149.0	5215
J	11.71	144.0	1686.24
K	16	143.0	2288
L	11.71	144.5	1692.095
M	26.94	146.5	3946.71
N	15.83	149.0	2358.67
O	2	150.5	301
P	14.94	151.0	2255.94
Q	2	151.0	302
R	12.67	151.5	1919.505
TOTAL	275.34	2690.5	41122.865

Average Building Elevation: 149.35

BUILDING AREA

	LOWER FLOOR	MAIN FLOOR	HEATED SUB-TOTAL	ATTACHED GARAGE	ATTACHED CARPORT	GRAND TOTAL	UNHEATED DECKS
EXISTING HOUSE:	789.5 SF	1454.3 SF	2243.8 SF	497.7 SF	0 SF	2741.5 SF	595.4 SF
PROPOSED CHANGES:	+4 0 SF	+497.7 SF	+497.7 SF	-497.7 SF	+232.6 SF	+232.6 SF	+311.5 SF
PROPOSED HOUSE:	789.5 SF	1952 SF	2741.5 SF	0 SF	232.6 SF	2974.1 SF	906.9 SF

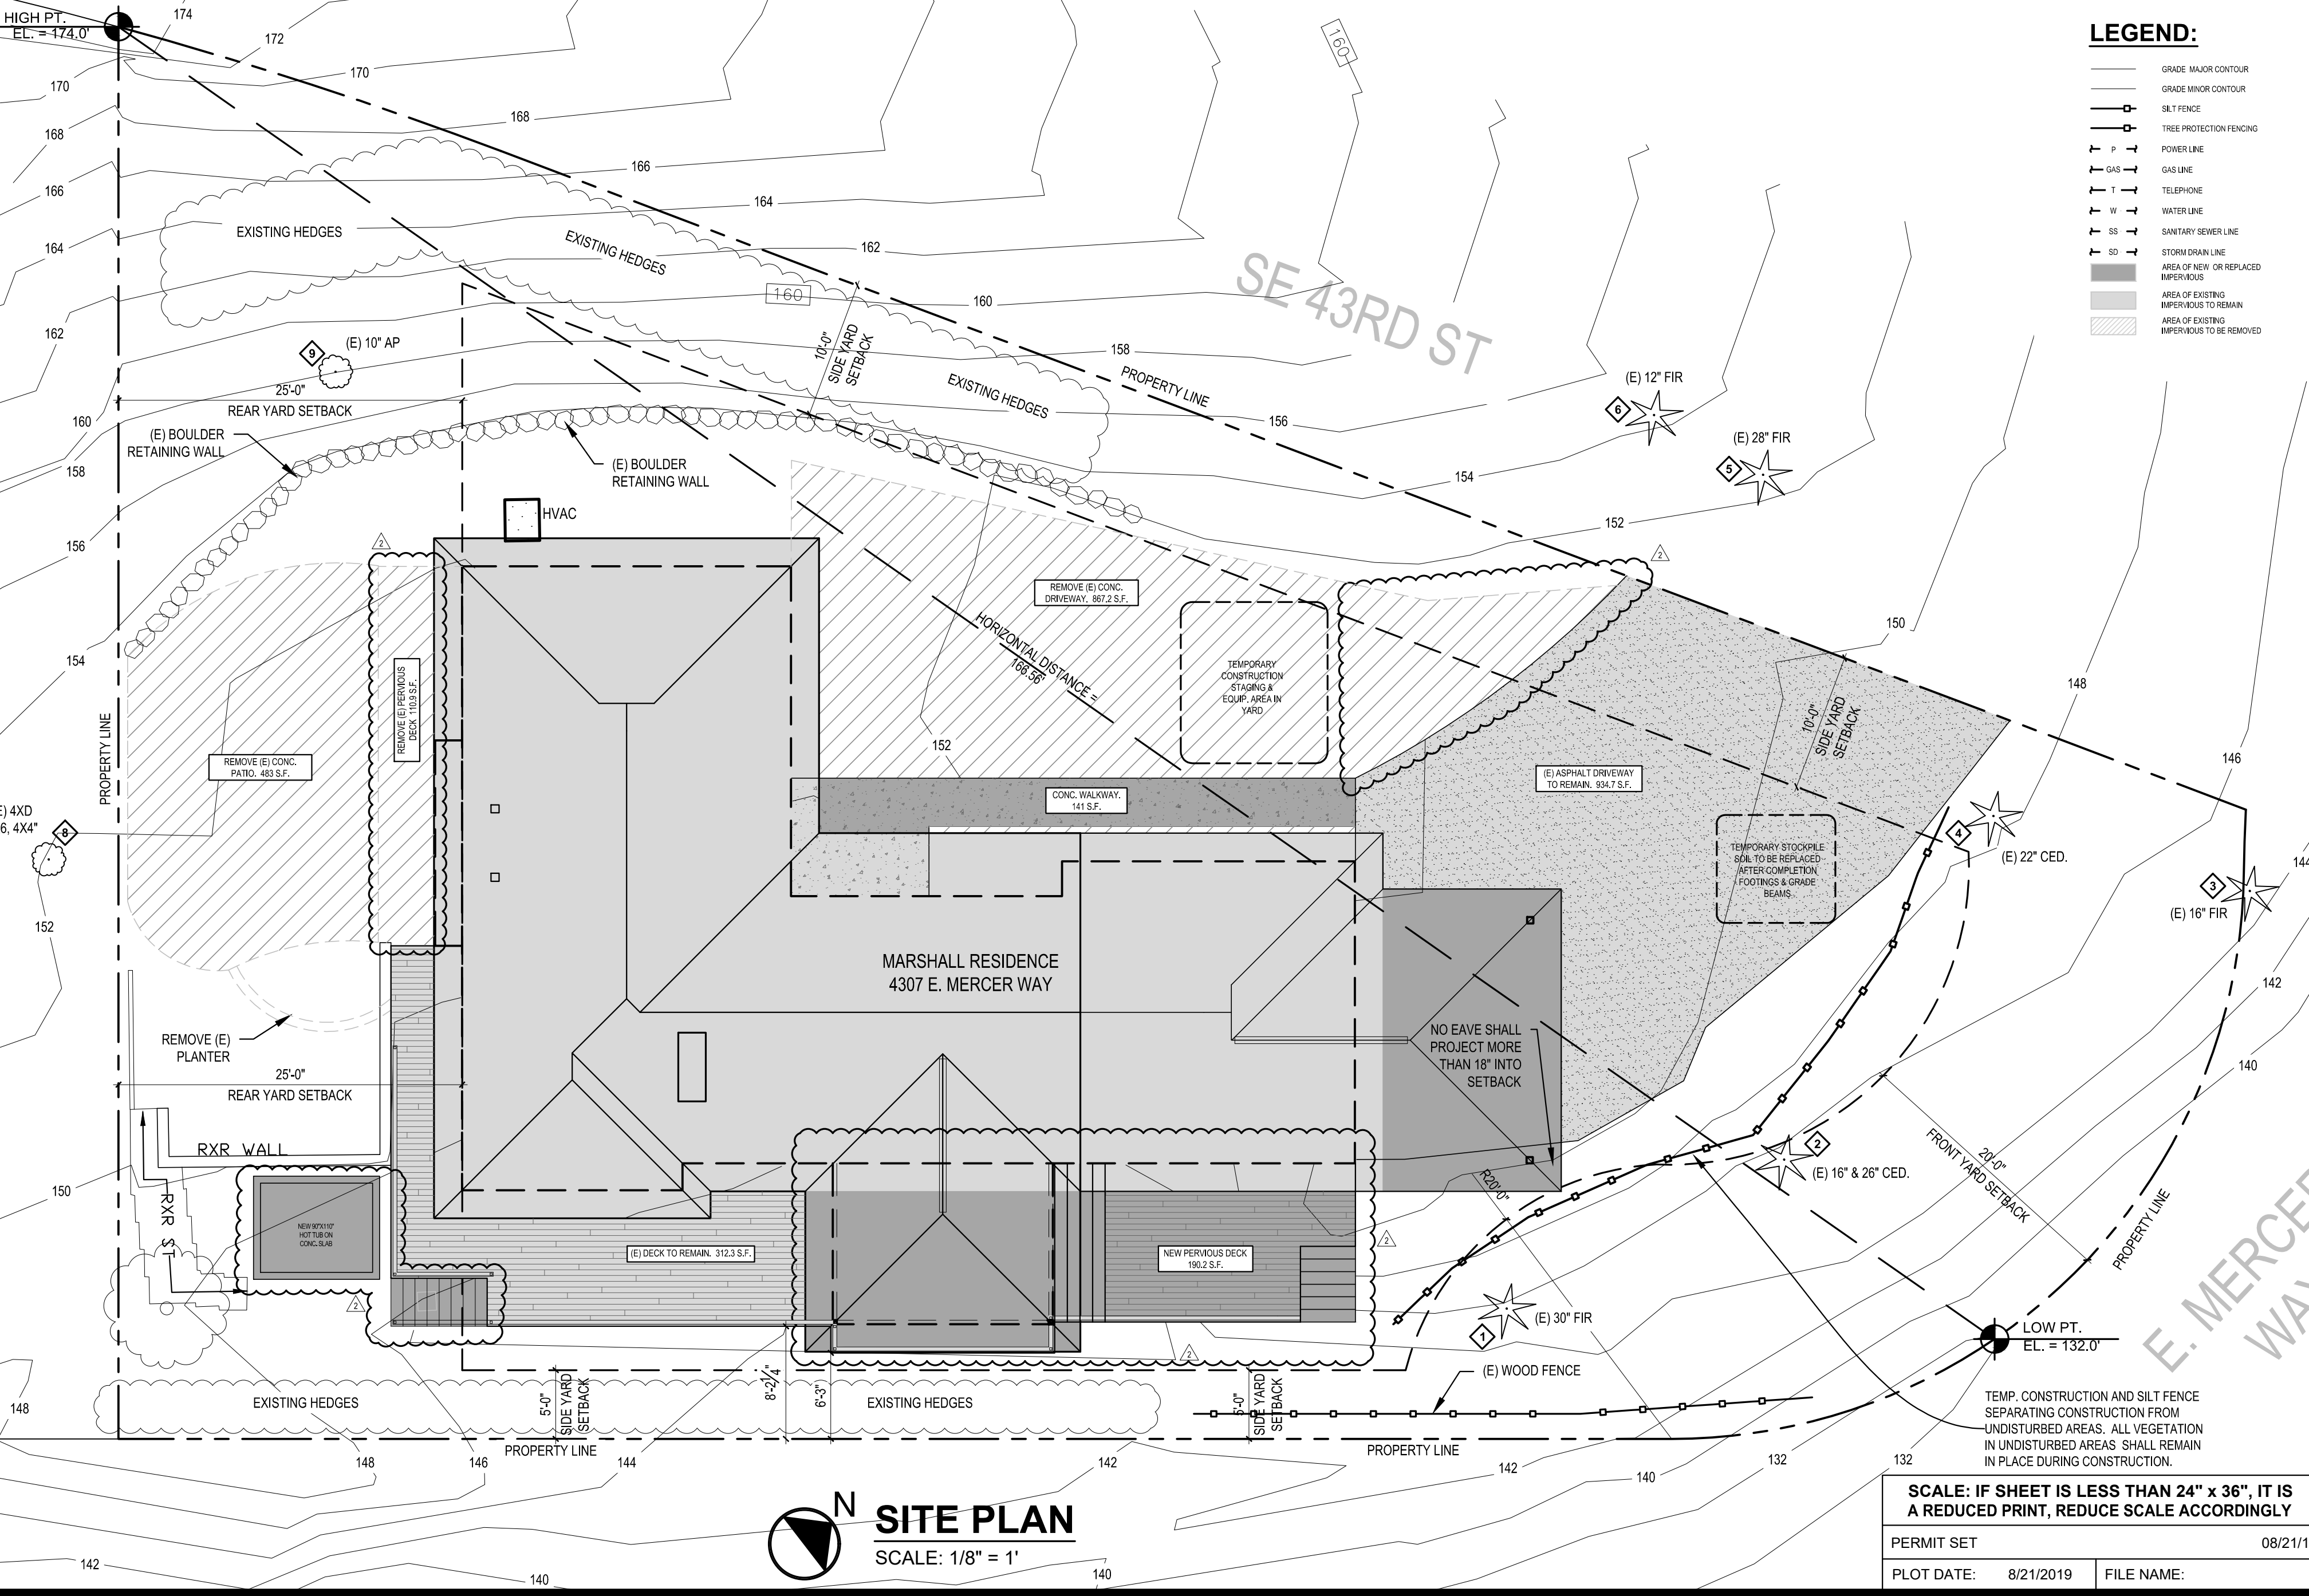

STURMAN ARCHITECTS

TEL (425) 451-7003

9 103rd Avenue NE
Suite 203
Bellevue, WA 98004

REGISTERED ARCHITECT

BRADLEY J. STURMAN
STATE OF WASHINGTON

www.sturmanarchitects.com
All Rights Reserved
© 2019

MARSHALL RESIDENCE PERMIT SET

4307 EAST MERCER WAY

MERCER ISLAND, WA 98040

GENERAL NOTES

SITE PLAN

REVISIONS:

1	2019-04-30	PERMIT CORRECTIONS #1
2	2019-04-30	DESIGN REVISIONS
3		
4		
5		

DRAWN BY: KE



CHECKED BY: BJS

SHEET **A1.0** OF

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY

PERMIT SET 08/21/19

PLOT DATE: 8/21/2019 FILE NAME:

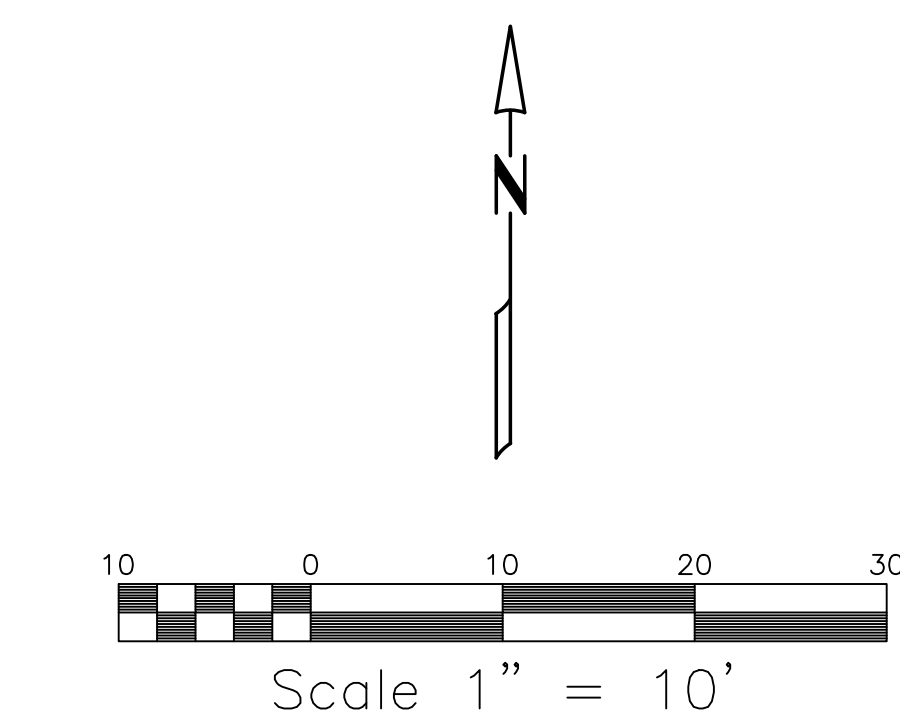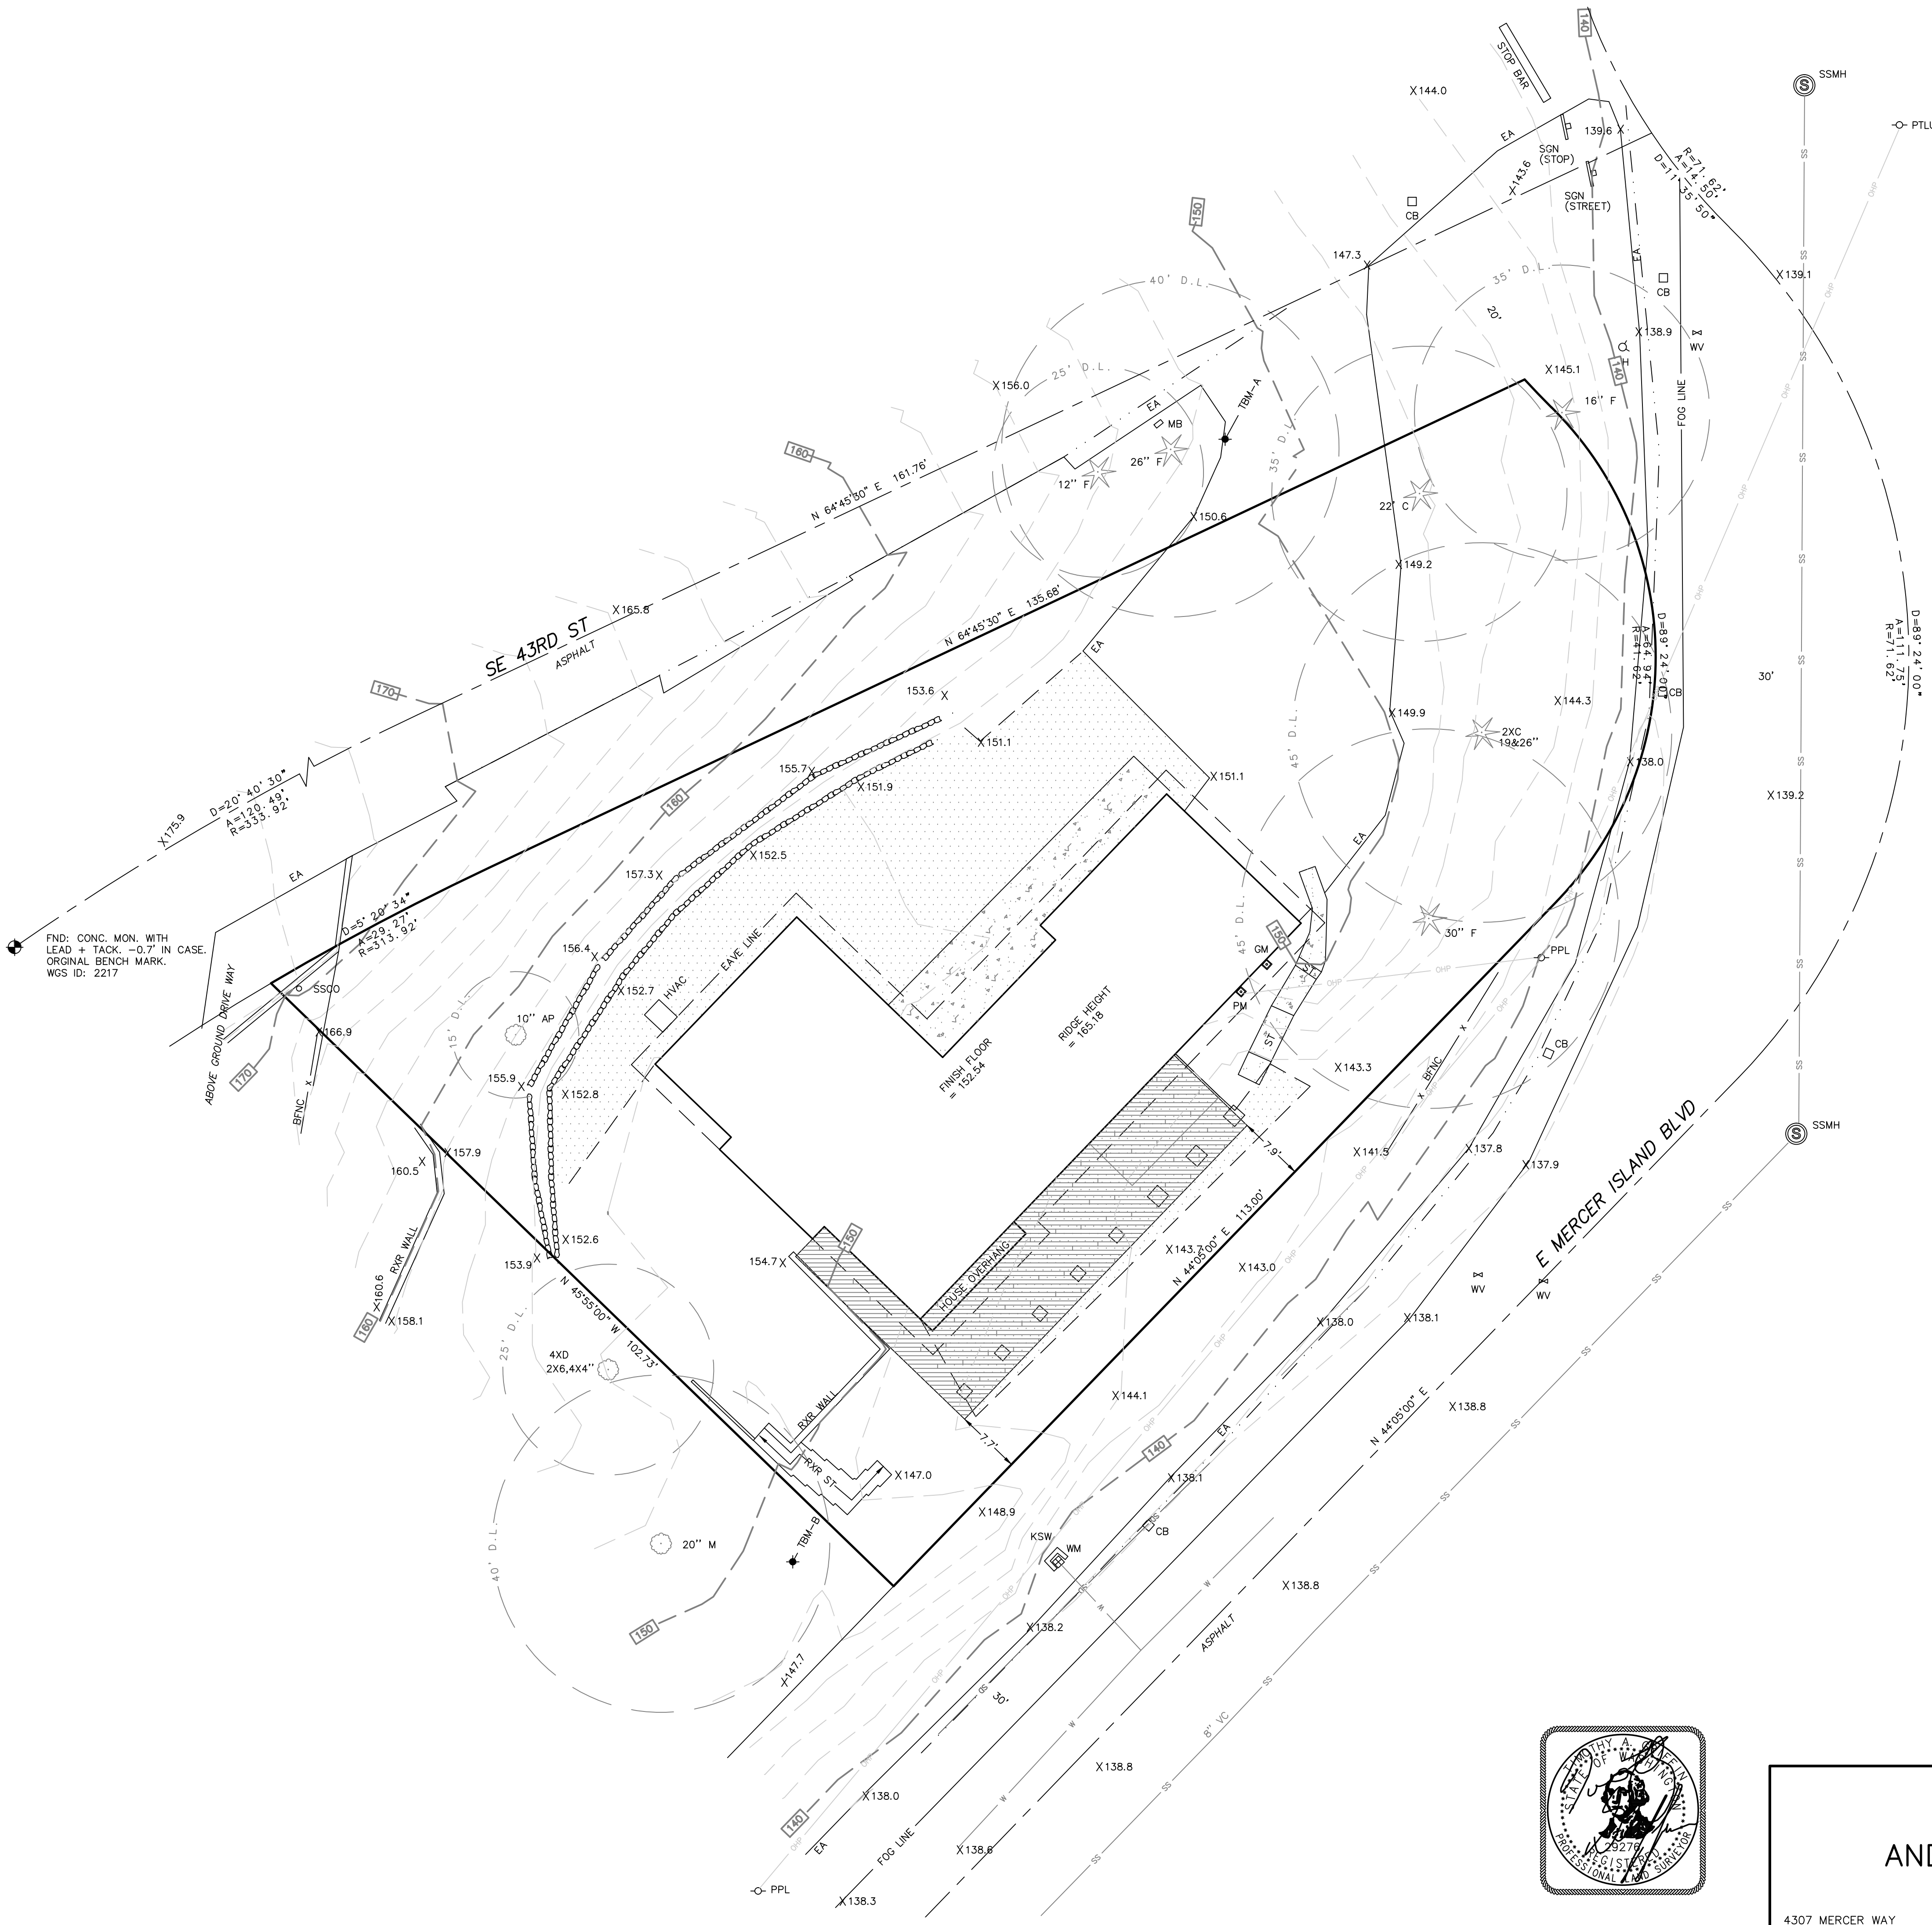

MERIDIAN
ASSUMED

DATUM
NAVD 88

CONTOUR INTERVAL = 2'

EQUIPMENT & PROCEDURES
FIELD SURVEY CONDUCTED USING A COMBINATION OF GPS USING A REFERENCE NETWORK AND A 5" ELECTRONIC TOTAL STATION WAS USED FOR THIS FIELD TRAVERSE SURVEY. SURVEY PROCEDURES MEET OR EXCEED STATE STANDARDS AS SPECIFIED BY W.A.C. 332-130 WITH REGARD TO LINEAR AND ANGULAR CLOSURES. ALL MEASURING INSTRUMENTS FOR THIS SURVEY HAVE BEEN MAINTAINED ACCORDING TO MANUFACTURER'S SPECIFICATIONS AND HAVE BEEN COMPARED WITH A NATIONAL GEODETIC SURVEY CALIBRATED BASELINE WITHIN THE LAST 12 MONTHS.

BENCHMARKS
ORIGINAL BM: CONC. MON WITH LEAD + TACK, WGS DESIGNATION 2217, LOCATION SHOWN ON DRAWING. ELEV. = 184.73

TBM - A: SET MAG NAIL. ELEV. = 150.92

TBM - B: SET HUB + MAG NAIL. ELEV. = 149.04

GENERAL NOTES


1. THE INFORMATION DEPICTED ON THIS MAP REPRESENTS THE RESULTS OF A SURVEY MADE ON THE DATE INDICATED AND CAN ONLY BE CONSIDERED AS INDICATING THE GENERAL CONDITION EXISTING AT THAT TIME.
2. UNDERGROUND UTILITIES WERE LOCATED BASED ON THE SURFACE EVIDENCE OF UTILITIES (I.E. PAINT MARKS, SAW CUTS IN PAVEMENT, COVERS, LIDS ETC.). THE CONTRACTOR SHALL VERIFY THE EXACT LOCATION, ELEVATION AND SIZE OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.
3. TREE SIZES WERE LOCATED & SPECIES DETERMINED TO THE BEST OF OUR ABILITY. HOWEVER, THE SURVEYORS DOES NOT WARRANT THE ACCURACY OF SIZE & SPECIES SHOWN HEREON. ANY TREES CONSIDERED TO BE CRITICAL SHOULD BE VERIFIED BY A TRAINED ARBORIST.
4. THIS MAP DOES NOT PURPORT TO SHOW EASEMENTS OF RECORD, IF ANY.
5. NO PROPERTY CORNERS WERE SET IN CONJUNCTION WITH THIS SURVEY.
6. THE INTENT OF THIS SURVEY IS TO AID IN DESIGN FOR THIS SITE.
7. THE BOUNDARY FOR THIS SURVEY WAS COMPUTED FROM THE PLAT OF MERCERWOOD PARK, AS RECORDED IN VOLUME 70 OF PLATS, PAGE 63 RECORDS OF KING COUNTY, WASHINGTON.

LEGAL DESCRIPTION
LOT 9, MERCERWOOD PARK, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 70 OF PLATS, PAGE 63 IN KING COUNTY, WASHINGTON, EXCEPT THAT PORTION DESCRIBED AS FOLLOWS:
BEGINNING AT THE MOST WESTERLY CORNER OF SAID LOT 9; THENCE SOUTH 45°59'55" EAST ALONG THE LINE BETWEEN LOTS 8 AND 9 OF SAID SHORTPLAT, A DISTANCE OF 8.00 FEET; THENCE NORTH 07°01'36" EAST 9.62 FEET; THENCE ALONG THE MARGIN OF SOUTHEAST 43RD ST ALONG A CURVE TO THE LEFT HAVING A RADIUS OF 313.92 FEET, THE CENTER OF WHICH BEARS SOUTH 29°12'23" EAST, AN ARC DISTANCE OF 8.00 FEET TO THE POINT OF BEGINNING.
SITUATE IN THE CITY OF MERCER ISLAND, COUNTY OF KING, STATE OF WASHINGTON.

LEGEND:


BFNC	BOARD FENCE	X	FENCE LINE AS NOTED
CB	CATCH BASIN	OHP	OVERHEAD POWER LINE
DL	DRIP LINE	—	ROCK WALL
EA	EDGE OF ASPHALT	—	STORM DRAIN LINE
FH	FIRE HYDRANT	SS	SANITARY SEWER LINE
KSW	KEY STONE WALL	W	WATER LINE
MB	MAIL BOX		
PM	POWER METER		
PFL	POWER POLE W/LIGHT		
PTLU	POWER POLE W/XFMR&LIGHT&UG		
RXR	RAIL ROAD TIE		
SGN	SIGN		
SSCO	SANITARY SEWER CLEANOUT		
WM	WATER METER		
WV	WATER VALVE		
AP	APPLE		
C	CEDAR		
D	DECIDUOUS		
F	FIR		
M	MAPLE		

PARCEL # 5461100090
SE1/4, NE1/4, SEC. 18, T. 24 N., R. 5 E., W.M.
MERCER ISLAND, WASHINGTON

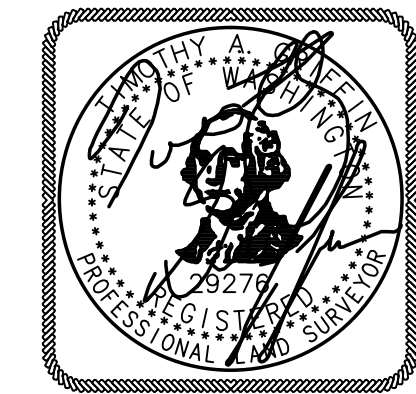


TOPOGRAPHIC SURVEY for ANDRE MARSHALL		
4307 MERCER WAY MERCER ISLAND, WASHINGTON 98004		
Tye Surveyors PROFESSIONAL LAND SURVEYORS 10007 GREENWOOD AV. N. SEATTLE, WA. 98133 206-525-3660		
DRAWN BY: RG	DATE: 7-24-19	JOB NO.: 19107
CHKD BY: TG	SCALE: 1" = 10'	SHEET: 1 OF 1

TREE & VEGETATION PROTECTION

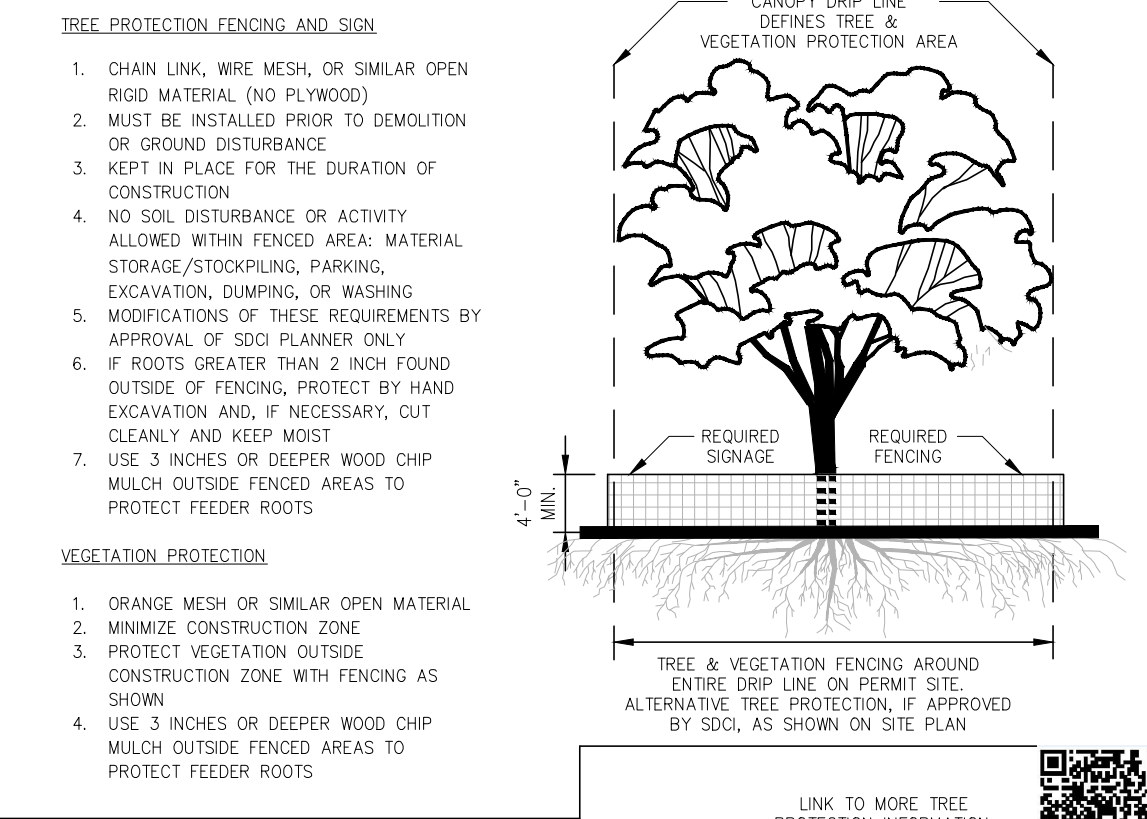

SYMBOL:

COMPOST SOCK

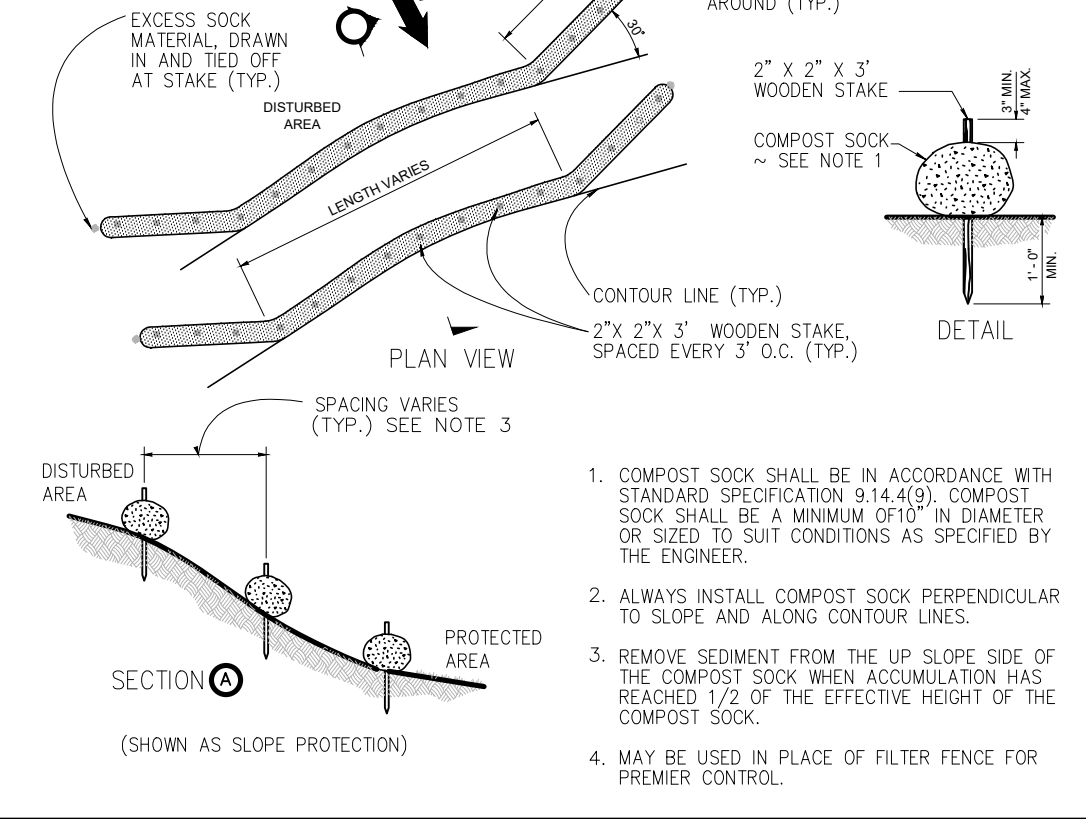

SYMBOL:

EROSION AND SEDIMENTATION CONTROL NOTES


- NOT USED
- NOT USED
- PERIMETER PROTECTION MAY BE USED AS THE SOLE FORM OF TREATMENT WHEN THE FLOWPATH MEETS THE CRITERIA LISTED BELOW. IF THESE ARE NOT MET, PERIMETER PROTECTION SHALL ONLY BE USED AS A BACKUP TO A SEDIMENT TRAP OR POND.

AVERAGE SLOPE	SLOPE PERCENT	FLOWPATH LENGTH
1.5H:1V OR LESS	67% OR LESS	100 FEET
2H:1V OR LESS	50% OR LESS	115 FEET
4H:1V OR LESS	25% OR LESS	150 FEET
6H:1V OR LESS	16.7% OR LESS	200 FEET
10H:1V OR LESS	10% OR LESS	250 FEET
- THE CONTRACTOR SHALL STABILIZE DENUDED AREAS AND SOIL STOCKPILES AS FOLLOWS:
 - DENUDED AREAS SHALL BE COVERED BY MULCH, SOD, PLASTIC, OR OTHER BMP'S APPROVED BY THE ENGINEER. WHERE POSSIBLE NATURAL VEGETATION SHALL BE MAINTAINED FOR EROSION AND SEDIMENT CONTROL.
- AS CONSTRUCTION PROGRESSES AND SEASONAL CONDITIONS DICTATE, THE EROSION CONTROL FACILITIES SHALL BE MAINTAINED AND/OR ALTERED AS REQUIRED TO ENSURE CONTINUING EROSION/SEDIMENT CONTROL.
- EVERY EFFORT SHALL BE MADE TO CLOSE UTILITY TRENCHES BY THE END OF THE DAY AND MATERIAL EXCAVATED DURING UNDERGROUND UTILITY CONSTRUCTION SHALL BE PLACED ON THE UPHILL SIDE OF TRENCHES (WHERE CONSISTENT WITH SAFETY AND SPACE CONSIDERATIONS).
- ALL TEMPORARY EROSION AND SEDIMENT CONTROL BMP'S SHALL BE MAINTAINED IN A SATISFACTORY CONDITION UNTIL SUCH TIME THAT CLEARING AND/OR CONSTRUCTION IS COMPLETED, PERMANENT DRAINAGE FACILITIES ARE IN OPERATION, AND THE POTENTIAL FOR EROSION HAS PASSED.
- AT A MINIMUM, EROSION AND SEDIMENT CONTROL FACILITIES SHALL BE MAINTAINED MONTHLY, OR FOLLOWING EACH RUNOFF-PRODUCING STORM, TO ENSURE PROPER OPERATION OF ALL EROSION AND SEDIMENT CONTROL FACILITIES. SEDIMENT SHALL BE REMOVED FROM BMP'S WHEN IT REACHES D-FOOT DEPTH.
- THE PUBLIC RIGHT-OF-WAY SHALL BE KEPT CLEAN. TRACKING OF MUD AND DEBRIS FROM THE SITE WILL NOT BE ALLOWED. FAILURE TO COMPLY WITH THIS CONDITION MAY RESULT IN ALL WORK ON SITE BEING STOPPED.
- THE WASHINGTON STATE CLEAN AIR ACT REQUIRES THE USE OF ALL KNOWN AVAILABLE, AND REASONABLE MEANS OF CONTROLLING AIR POLLUTION, INCLUDING DUST. DUST CAN BE CONTROLLED BY WETTING EXPOSED SOILS, WASHING TRUCK WHEELS BEFORE THEY LEAVE THE SITE, AND INSTALLING AND MAINTAINING ROCK CONSTRUCTION ENTRANCES. CONSTRUCTION VEHICLE TRACK-OUT IS A MAJOR SOURCE OF DUST AND ANY EVIDENCE OF TRACK-OUT CAN TRIGGER FINES FROM THE DEPARTMENT OF ECOLOGY OF THE PUGET SOUND AIR POLLUTION CONTROL AGENCY.
- NOT USED
- THE CONTRACTOR SHALL REMOVE ALL TEMPORARY EROSION AND SEDIMENTATION CONTROL BMP'S WITHIN 30 DAYS AFTER FINAL SITE STABILIZATION OR AFTER THEY ARE NO LONGER NECESSARY.

PRIOR TO BEGINNING CLEARING OR GRADING


- INSTALL THE SLIT FENCE AS INDICATED ON THE SITE PLAN & SHEET C1.0
- PLACE A THICK LAYER OF STRAW OR MULCH ON ALL AREAS OF BARE SOIL OUTSIDE OF THE PLANNED NEW CONSTRUCTION. THIS IS PARTICULARLY IMPORTANT IN THE SOUTH, LOW END OF THE LOT.
- INSTALL PRE MANUFACTURED SILT SOCKS IN THE TWO EXISTING CATCH BASINS LOCATED SOUTH & EAST OF THE SITE. THIS CATCH BASIN PROTECTION MUST BE CHECKED PERIODICALLY, & CLEANED AS NECESSARY, TO PREVENT THE SILT SOCKS FROM BECOMING OVERLOADED WITH SILT & DEBRIS FROM SURFACE RUNOFF.
- CONSTRUCT A STABILIZED CONSTRUCTION ENTRANCE, AS SHOWN ON SHEET C1.0 OF THE DRAWINGS, WHEREVER TRUCKS WILL DRIVE OFF OF PAVED SURFACES TO IMPORT OR EXPORT DEBRIS & SOIL.
- DURING GRADING AND CONSTRUCTION
 - COVER ANY SOIL STOCKPILES WITH PLASTIC SHEETING THAT IS STAKED OR WEIGHTED TO PREVENT IT FROM BLOWING AWAY.
 - ALLOW NO RUNOFF FROM THE EXCAVATION FOR THE SOUTHERN ADDITION TO FLOW ACROSS THE GROUND SURFACE TOWARD THE SOUTH. THIS MAY REQUIRE CREATING A SOIL BERM ALONG THE SOUTHERN EDGE OF THE EXCAVATION. IF SILTY RUNOFF COLLECTS IN THE EXCAVATION, IT MAY NEED TO BE PUMPED TO A TEMPORARY HOLDING TANK FOR DISPOSAL OFF SITE.
 - FOLLOWING CONSTRUCTION OF THE FOUNDATION WALLS, PROCEED IMMEDIATELY WITH INSTALLATION OF DRAINAGE & WATER PROOFING, THEN COMPLETION OF BACKFILLING.
 - SPREAD STRAW OR MULCH AGAIN ON ALL BARE SOIL OUTSIDE OF THE BACKFILLED FOUNDATIONS, UNLESS PERMANENT LANDSCAPING & VEGETATION WILL BE IMMEDIATELY ESTABLISHED.

STOCKPILE AND EXPOSED SLOPE COVERING

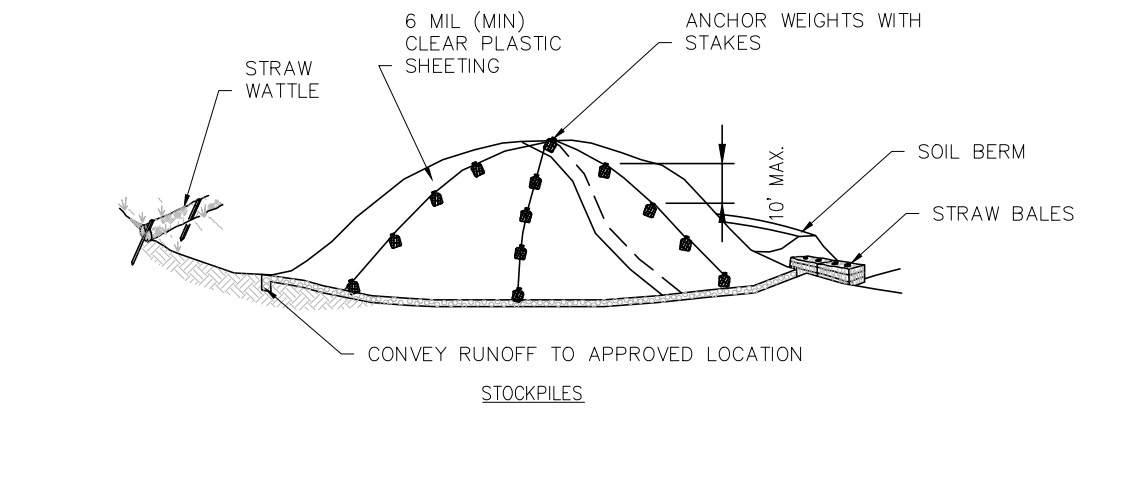


SYMBOL:

STABILIZED CONSTRUCTION ACCESS

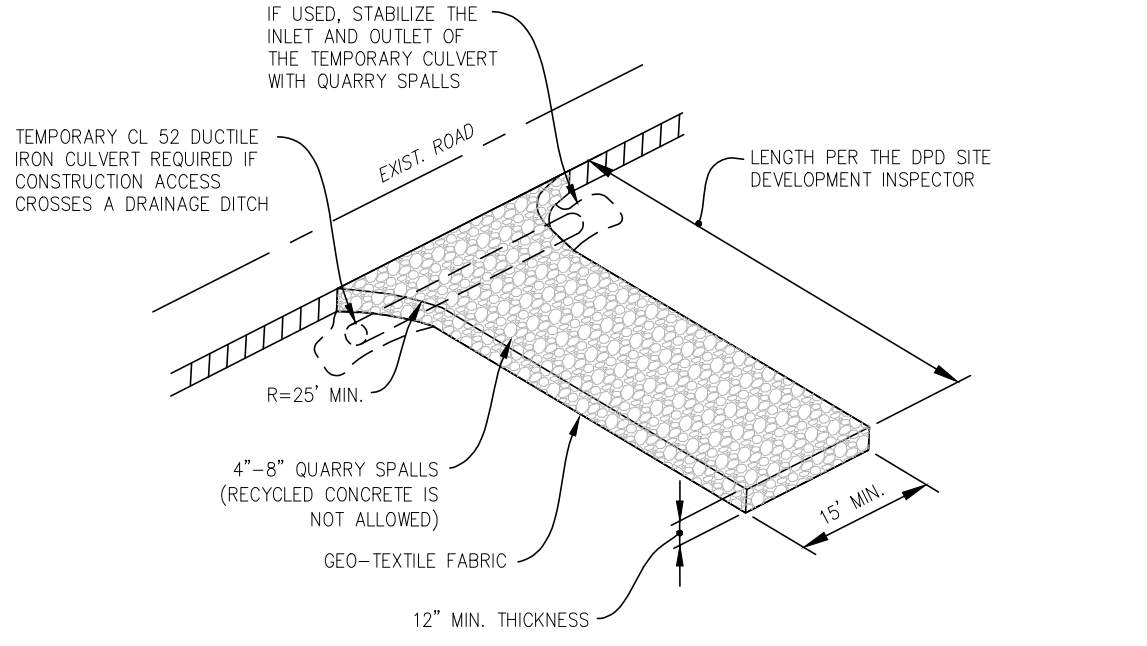

SYMBOL:


SOIL AMENDMENT

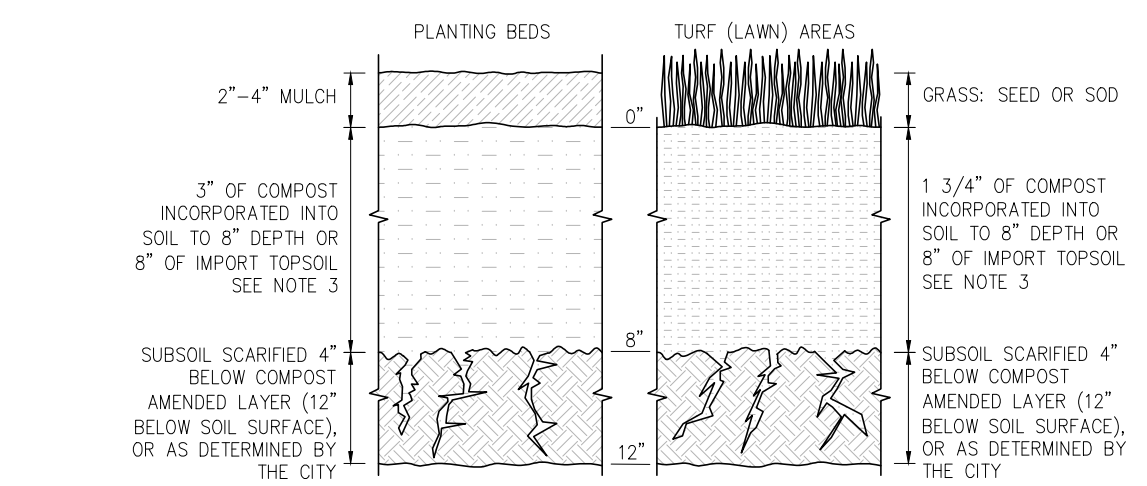

- NOTES:**
- POST CONSTRUCTION SOIL AMENDMENT IS REQUIRED ON ALL AREAS NOT COVERED BY IMPERVIOUS SURFACE WHERE SOIL IS DISTURBED DURING CONSTRUCTION.
 - SOIL AMENDMENT MUST PASS A 12 INCH MINIMUM PROBE TEST.
 - IMPORT TOPSOIL, IF USED, MUST MEET THE REQUIREMENTS OF THE 2016 SEATTLE STORMWATER MANUAL, VOL. 1, SECTIONS 5.1.5.1 AND 5.1.5.3.

SYMBOL:

FILTER FENCE

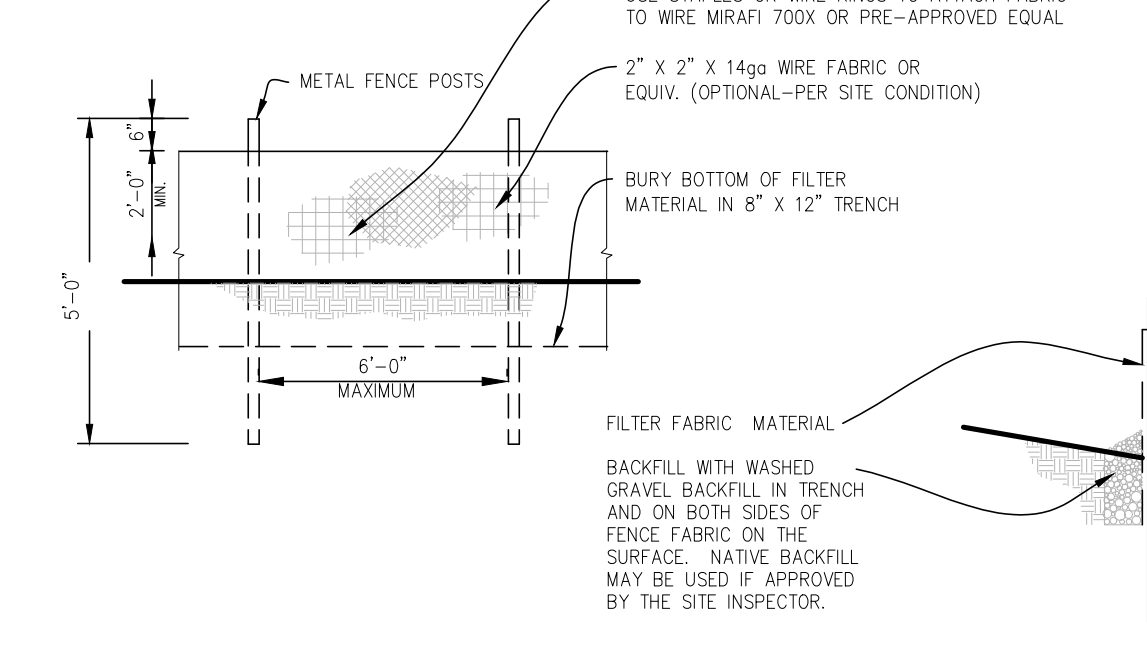

SYMBOL:

COVER MEASURES

TEMPORARY EROSION CONTROL SEED MIX:	% WEIGHT	% PURITY	% GERMINATION
ANNUAL OR PERENNIAL RYE (LOLIUM MULTIFLORUM OR LOLIUM PERENNE)	40	98	90
REDFEED OR COLONIAL BENTGRASS (AGROSTIS ALBA OR AGROSTIS TENUIS)	10	92	85

COVER METHODS INCLUDE THE USE OF MULCH, EROSION CONTROL NETS AND BLANKETS, PLASTIC COVERING, SEEDING, AND SODDING. MULCH AND PLASTIC SHEETING ARE PRIMARILY INTENDED TO PROTECT DISTURBED AREAS FOR A SHORT PERIOD OF TIME, TYPICALLY DAYS TO A FEW MONTHS. SEEDING AND SODDING ARE MEASURES FOR AREAS THAT ARE TO REMAIN UNWORKED FOR MONTHS.

PERMANENT SEED MIX:	% WEIGHT	% PURITY	% GERMINATION	REMARKS
PERENNIAL RYE BLEND (LOLIUM PERENNE)	70	98	90	THIS MIX IS PROVIDED AS JUST ONE RECOMMENDED POSSIBILITY. LOCAL SUPPLIERS SHOULD BE CONSULTED FOR THEIR RECOMMENDATIONS BECAUSE THE APPROPRIATE MIX DEPENDS ON A VARIETY OF FACTORS, INCLUDING EXPOSURE, SOIL TYPE, SLOPE, AND EXPECTED FOOT TRAFFIC.
CHEWINGS AND RED FESCUE BLEND (FESTUCA RUBRA VAR. COMMUTATA OR FESTUCA RUBRA)	30	98	90	

MULCH STANDARDS AND GUIDELINES:	MULCH MATERIAL	QUALITY STANDARDS	APPLICATION RATES	REMARKS
STRAW	AIR-DRIED; FREE FROM UNDESIRABLE SEED AND COARSE MATERIAL.	2"-3" THICK; 2-3 BALES PER 1000 SF OR 2-3 TONS PER ACRE	COST-EFFECTIVE PROTECTION WHEN APPLIED WITH ADEQUATE THICKNESS. HAND-APPLICATION GENERALLY REQUIRES GREATER THICKNESS THAN BLOWN STRAW. STRAW SHOULD BE CRIMPED TO AVOID WIND BLOW. THE THICKNESS OF STRAW MAY BE REDUCED BY HALF WHEN USED IN CONJUNCTION WITH SEEDING.	THIS IS A COST-EFFECTIVE WAY TO DISPOSE OF DEBRIS FROM CLEARING AND GRUBBING, AND IT ELIMINATES THE PROBLEMS ASSOCIATED WITH BURNING. GENERALLY, IT SHOULD NOT BE USED ON SLOPES ABOVE APPROXIMATELY 10% BECAUSE OF ITS TENDENCY TO BE TRANSPORTED BY RUNOFF. IT IS NOT RECOMMENDED WITHIN 200 FEET OF SURFACE WATERS. IF SEEDING IS EXPECTED SHORTLY AFTER MULCH, THE DECOMPOSITION OF THE CHIPPED VEGETATION MAY TIE UP NUTRIENTS IMPORTANT TO GRASS ESTABLISHMENT.

CONSTRUCTION STORMWATER CONTROL (CSC) NOTES

- BMP'S SHALL BE INSTALLED PRIOR TO STARTING CONSTRUCTION TO ENSURE SEDIMENT-LADEN WATER DOES NOT LEAVE THE PROJECT SITE OR ENTER ROADSIDE DITCHES, STORM DRAINS, SURFACE WATERS, OR WETLANDS.
- THE BMP'S INCLUDED IN THIS PLAN ARE THE MINIMUM REQUIREMENTS FOR ANTICIPATED SITE CONDITIONS. THE APPLICANT IS RESPONSIBLE FOR ENSURING THAT BMP'S ARE MODIFIED AS NEEDED FOR UNEXPECTED STORM EVENTS OR OTHER UNFORESEEN CIRCUMSTANCES, AND TO ACCOUNT FOR CHANGING SITE CONDITIONS.
- ANY AREAS OF DISTURBED SOIL THAT WILL NOT BE WORKED FOR TWO CONSECUTIVE DAYS DURING THE WET SEASON (OCT 1 TO APRIL 30) OR SEVEN DAYS DURING THE DRY SEASON (MAY 1 TO SEPT 30) SHALL BE IMMEDIATELY STABILIZED WITH APPROVED BMP'S METHODS (E.G. STRAW, MULCH, PLASTIC COVERING, COLD MIX, ETC.)
- CITY STREETS AND SIDEWALKS SHALL BE KEPT CLEAN AT ALL TIMES.
- POLLUTION CONTROL MEASURES SHALL BE FOLLOWED TO ENSURE THAT NO LIQUID PRODUCTS OR CONTAMINATED WATER ENTERS ANY STORM DRAINAGE FACILITIES OR OTHERWISE LEAVES THE PROJECT SITE. ANY HAZARDOUS MATERIALS OR LIQUID PRODUCTS THAT HAVE THE POTENTIAL TO POLLUTE RUNOFF SHALL BE STORED AND DISPOSED OF PROPERLY.
- ENSURE THAT WASHOUT FROM CONCRETE TRUCKS IS PERFORMED OFF-SITE OR IN DESIGNATED CONCRETE WASHOUT AREAS ONLY. DO NOT WASH OUT CONCRETE TRUCKS ONTO THE GROUND, OR TO STORM DRAINS OR OPEN DITCHES. DO NOT DUMP EXCESS CONCRETE ONSITE, EXCEPT IN DESIGNATED CONCRETE WASHOUT AREAS.
- ALL AREAS OF DISTURBED SOIL SHALL BE FULLY STABILIZED WITH THE APPROPRIATE SOIL AMENDMENT AND COVER MEASURES AT COMPLETION OF THE PROJECT. TYPICAL COVER MEASURES INCLUDE LANDSCAPING OR HYDROSEED WITH MULCH.

CONSTRUCTION SEQUENCE

- SCHEDULE THE PRE-CONSTRUCTION MEETING.
- FLAG OR FENCE ALL CRITICAL AREAS AND CLEARING LIMITS.
- POST A SIGN WITH THE NAME AND PHONE NUMBER OF THE E.S.C. SUPERVISOR.
- GRADE AND INSTALL CONSTRUCTION ENTRANCE(S).
- INSTALL PERIMETER PROTECTION (SILT FENCE, BRUSH BARRIER, ETC.).
- CONSTRUCT SEDIMENT PONDS AND TRAPS, IF REQUIRED.
- GRADE AND STABILIZE CONSTRUCTION ROADS.
- CONSTRUCT SURFACE WATER CONTROLS (INTERCEPTOR DIKES, PIPE SLOPE DRAINS, ETC.) SIMULTANEOUSLY WITH CLEARING AND GRADING FOR PROJECT DEVELOPMENT.
- INSTALL UTILITIES.
- MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH LOCAL STANDARDS AND MANUFACTURER'S RECOMMENDATIONS.
- RELOCATE SURFACE WATER CONTROLS OR EROSION CONTROL MEASURES, OR INSTALL NEW MEASURES SO THAT AS SITE CONDITIONS CHANGE, THE EROSION AND SEDIMENT CONTROL IS ALWAYS IN ACCORDANCE WITH THE ACCEPTED STANDARD BMP'S.
- COVER ALL AREAS THAT WILL BE UNWORKED FOR MORE THAN SEVEN DAYS DURING THE DRY SEASON OR TWO DAYS DURING THE WET SEASON WITH STRAW, WOOD FIBER MULCH, COMPOST, PLASTIC SHEETING, OR EQUIVALENT.
- STABILIZE ALL AREAS WITHIN SEVEN DAYS OF REACHING FINAL GRADE.
- SEED OR SOD ANY AREAS OF THE PROJECT, STABILIZE ALL DISTURBED AREA AND REMOVE BMP'S IFF APPROPRIATE
- UPON COMPLETION OF THE PROJECT, STABILIZE ALL DISTURBED AREAS AND REMOVE BMP'S IF APPROPRIATE.

INTERCEPTOR DIKE AND SWALE NOTES AND FIGURES

INTERCEPTOR DIKES AND SWALES ARE REQUIRED IN THE FOLLOWING SITUATIONS:

- AT THE TOP OF ALL SLOPES IN EXCESS OF 3H:1V AND WITH MORE THAN 20 FEET OF VERTICAL RELIEF.
- AT INTERVALS ON ANY SLOPE THAT EXCEEDS THE DIMENSIONS SPECIFIED IN THIS SECTION FOR THE HORIZONTAL SPACING OF DIKES AND SWALES.
- INTERCEPTOR DIKES AND SWALES SHALL BE SPACED HORIZONTALLY AS FOLLOWS:

AVERAGE SLOPE	SLOPE PERCENT	FLOWPATH
20H:1V OR LESS	3-5%	300 FEET
(10 TO 20)H:1V	5-10%	200 FEET
(4 TO 10)H:1V	10-25%	100 FEET
(2 TO 4)H:1V	25-50%	50 FEET
- FOR SLOPES STEEPER THAN 2H:1V WITH MORE THAN 10 FEET OF VERTICAL RELIEF, BENCHES MAY BE CONSTRUCTED OR CLOSER SPACED INTERCEPTOR DIKES OR SWALES CAN BE USED. WHICHEVER MEASURE IS CHOSEN, THE SPACING AND CAPACITY OF THE MEASURES MUST BE DESIGNED BY THE ENGINEER AND THE DESIGN MUST INCLUDE PROVISIONS FOR EFFECTIVELY INTERCEPTING THE HIGH VELOCITY RUNOFF ASSOCIATED WITH STEEP SLOPES.
- IF THE DIKES OR SWALES INTERCEPTS RUNOFF FROM THE DISTURBED AREAS, IT SHALL DISCHARGE TO A STABLE CONVEYANCE SYSTEM THAT ROUTES THE RUNOFF TO AN ACCEPTABLE BMP. IF THE DIKE OR SWALE INTERCEPTS RUNOFF THAT ORIGINATES FROM UNDISTURBED AREAS, IT SHALL DISCHARGE TO A STABLE CONVEYANCE SYSTEM THAT ROUTES THE RUNOFF DOWNSLOPE OF ANY DISTURBED AREAS AND RELEASE THE WATER AT A STABILIZED OUTLET.
- CONSTRUCTION TRAFFIC OVER TEMPORARY DIKES AND SWALES SHALL BE MINIMIZED.

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY

PERMIT SET	08/21/19
PLOT DATE: 8/21/2019	FILE NAME:

STURMAN ARCHITECTS

TEL (425) 451-7003

9 103rd Avenue NE
Suite 203
Bellevue, WA 98004

5562 REGISTERED ARCHITECT

BRADLEY J. STURMAN
STATE OF WASHINGTON

www.sturmanarchitects.com
All Rights Reserved
© 2019

MARSHALL RESIDENCE PERMIT SET
4307 EAST MERCER WAY
MERCER ISLAND, WA 98040

EROSION & CONSTRUCTION STORMWATER CONTROL NOTES AND DETAILS

REVISIONS:

2019-5-20	PERMIT CORRECTIONS #1
2019-8-26	DESIGN REVISIONS

DRAWN BY: KE

CHECKED BY: BJS

SHEET

C1.0


OF

REVISIONS:	DATE	DESCRIPTION
△	2019-05-30	PERMIT CORRECTIONS #1
△	2019-06-28	DESIGN REVISIONS

DRAWN BY: KE
CHECKED BY: BJS

SHEET
A2.0

OF

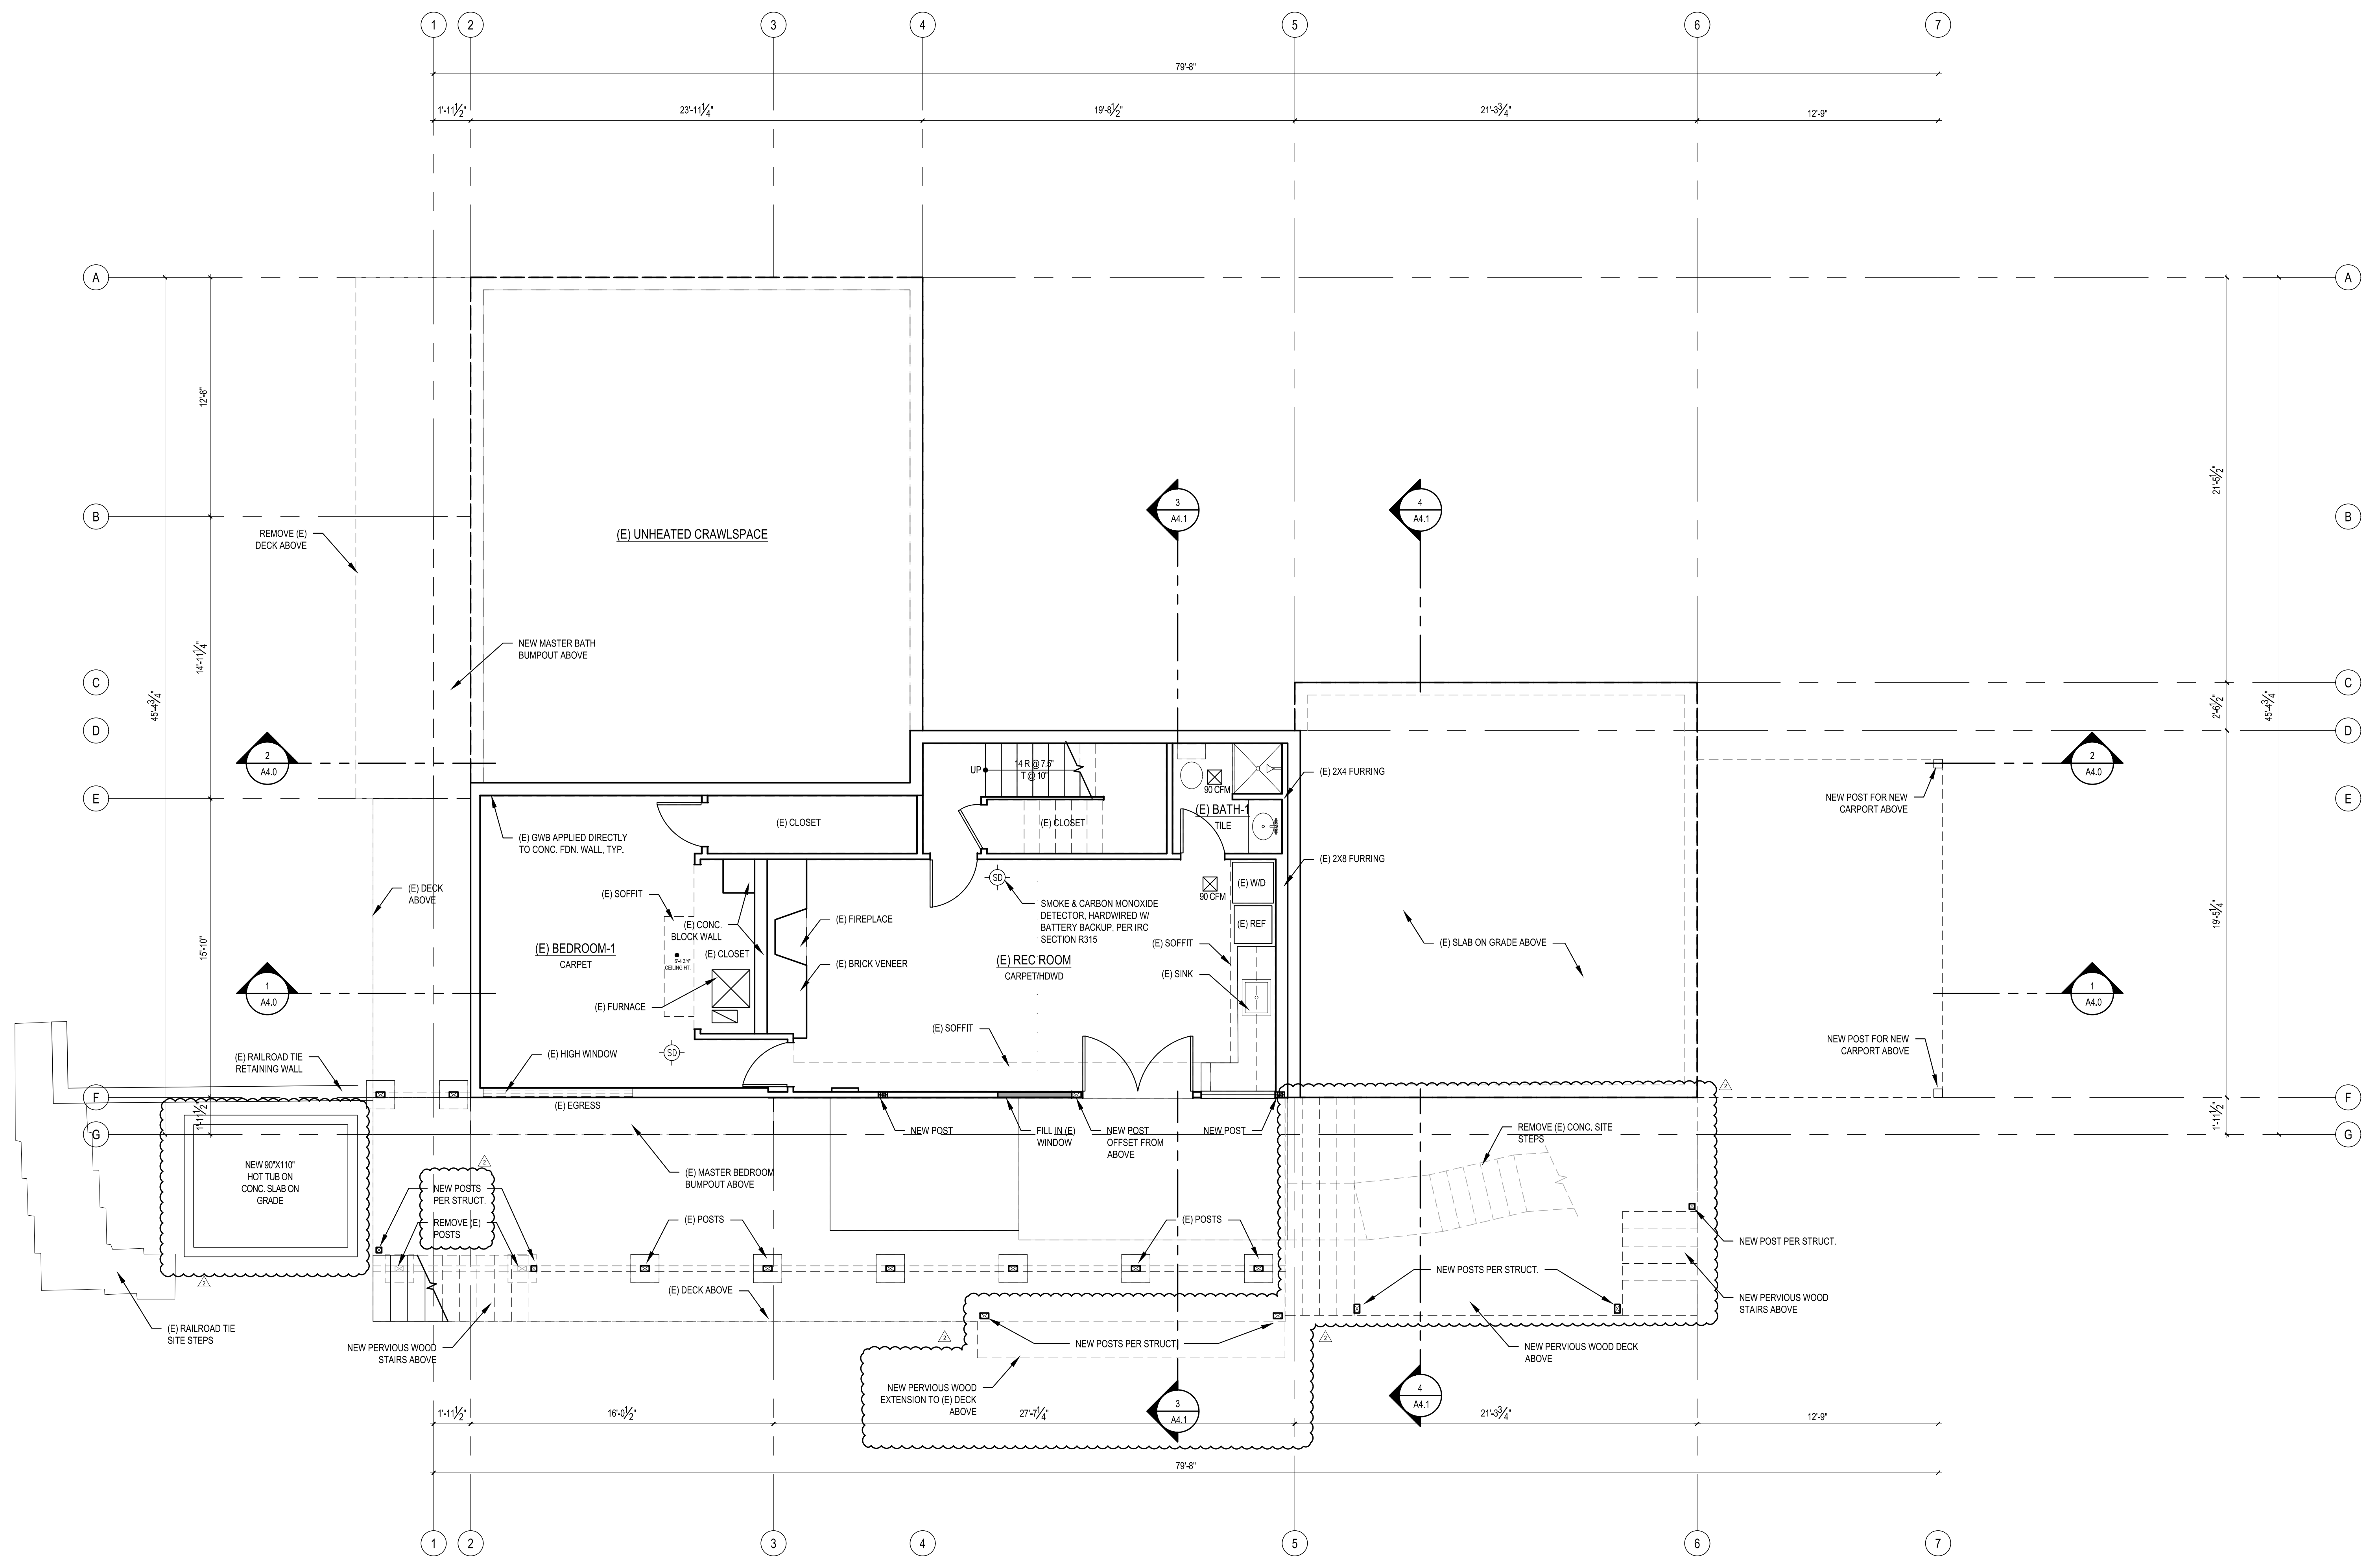

LOWER FLOOR PLAN
SCALE: 1/4" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY	
PERMIT SET	08/21/19
PLOT DATE: 8/21/2019	FILE NAME:

REVISIONS:


1	2019-05-30 PERMIT CORRECTIONS #1
2	2019-05-28 DESIGN REVISIONS

DRAWN BY: KE
CHECKED BY: BJS

SHEET
A2.1
OF

CRAWLSPACE CALCULATIONS
428 SF / 300 = 1.43 SF
1.43 SF X 144 = 205.92 SQ. IN.
68 SQ. IN. STND. VENT.
205.92 / 68 = 3.03 VENTS REQ

USE APPROVED CLASS I VAPOR RETARDER
PER IBC R408.2, EXCEPTION.

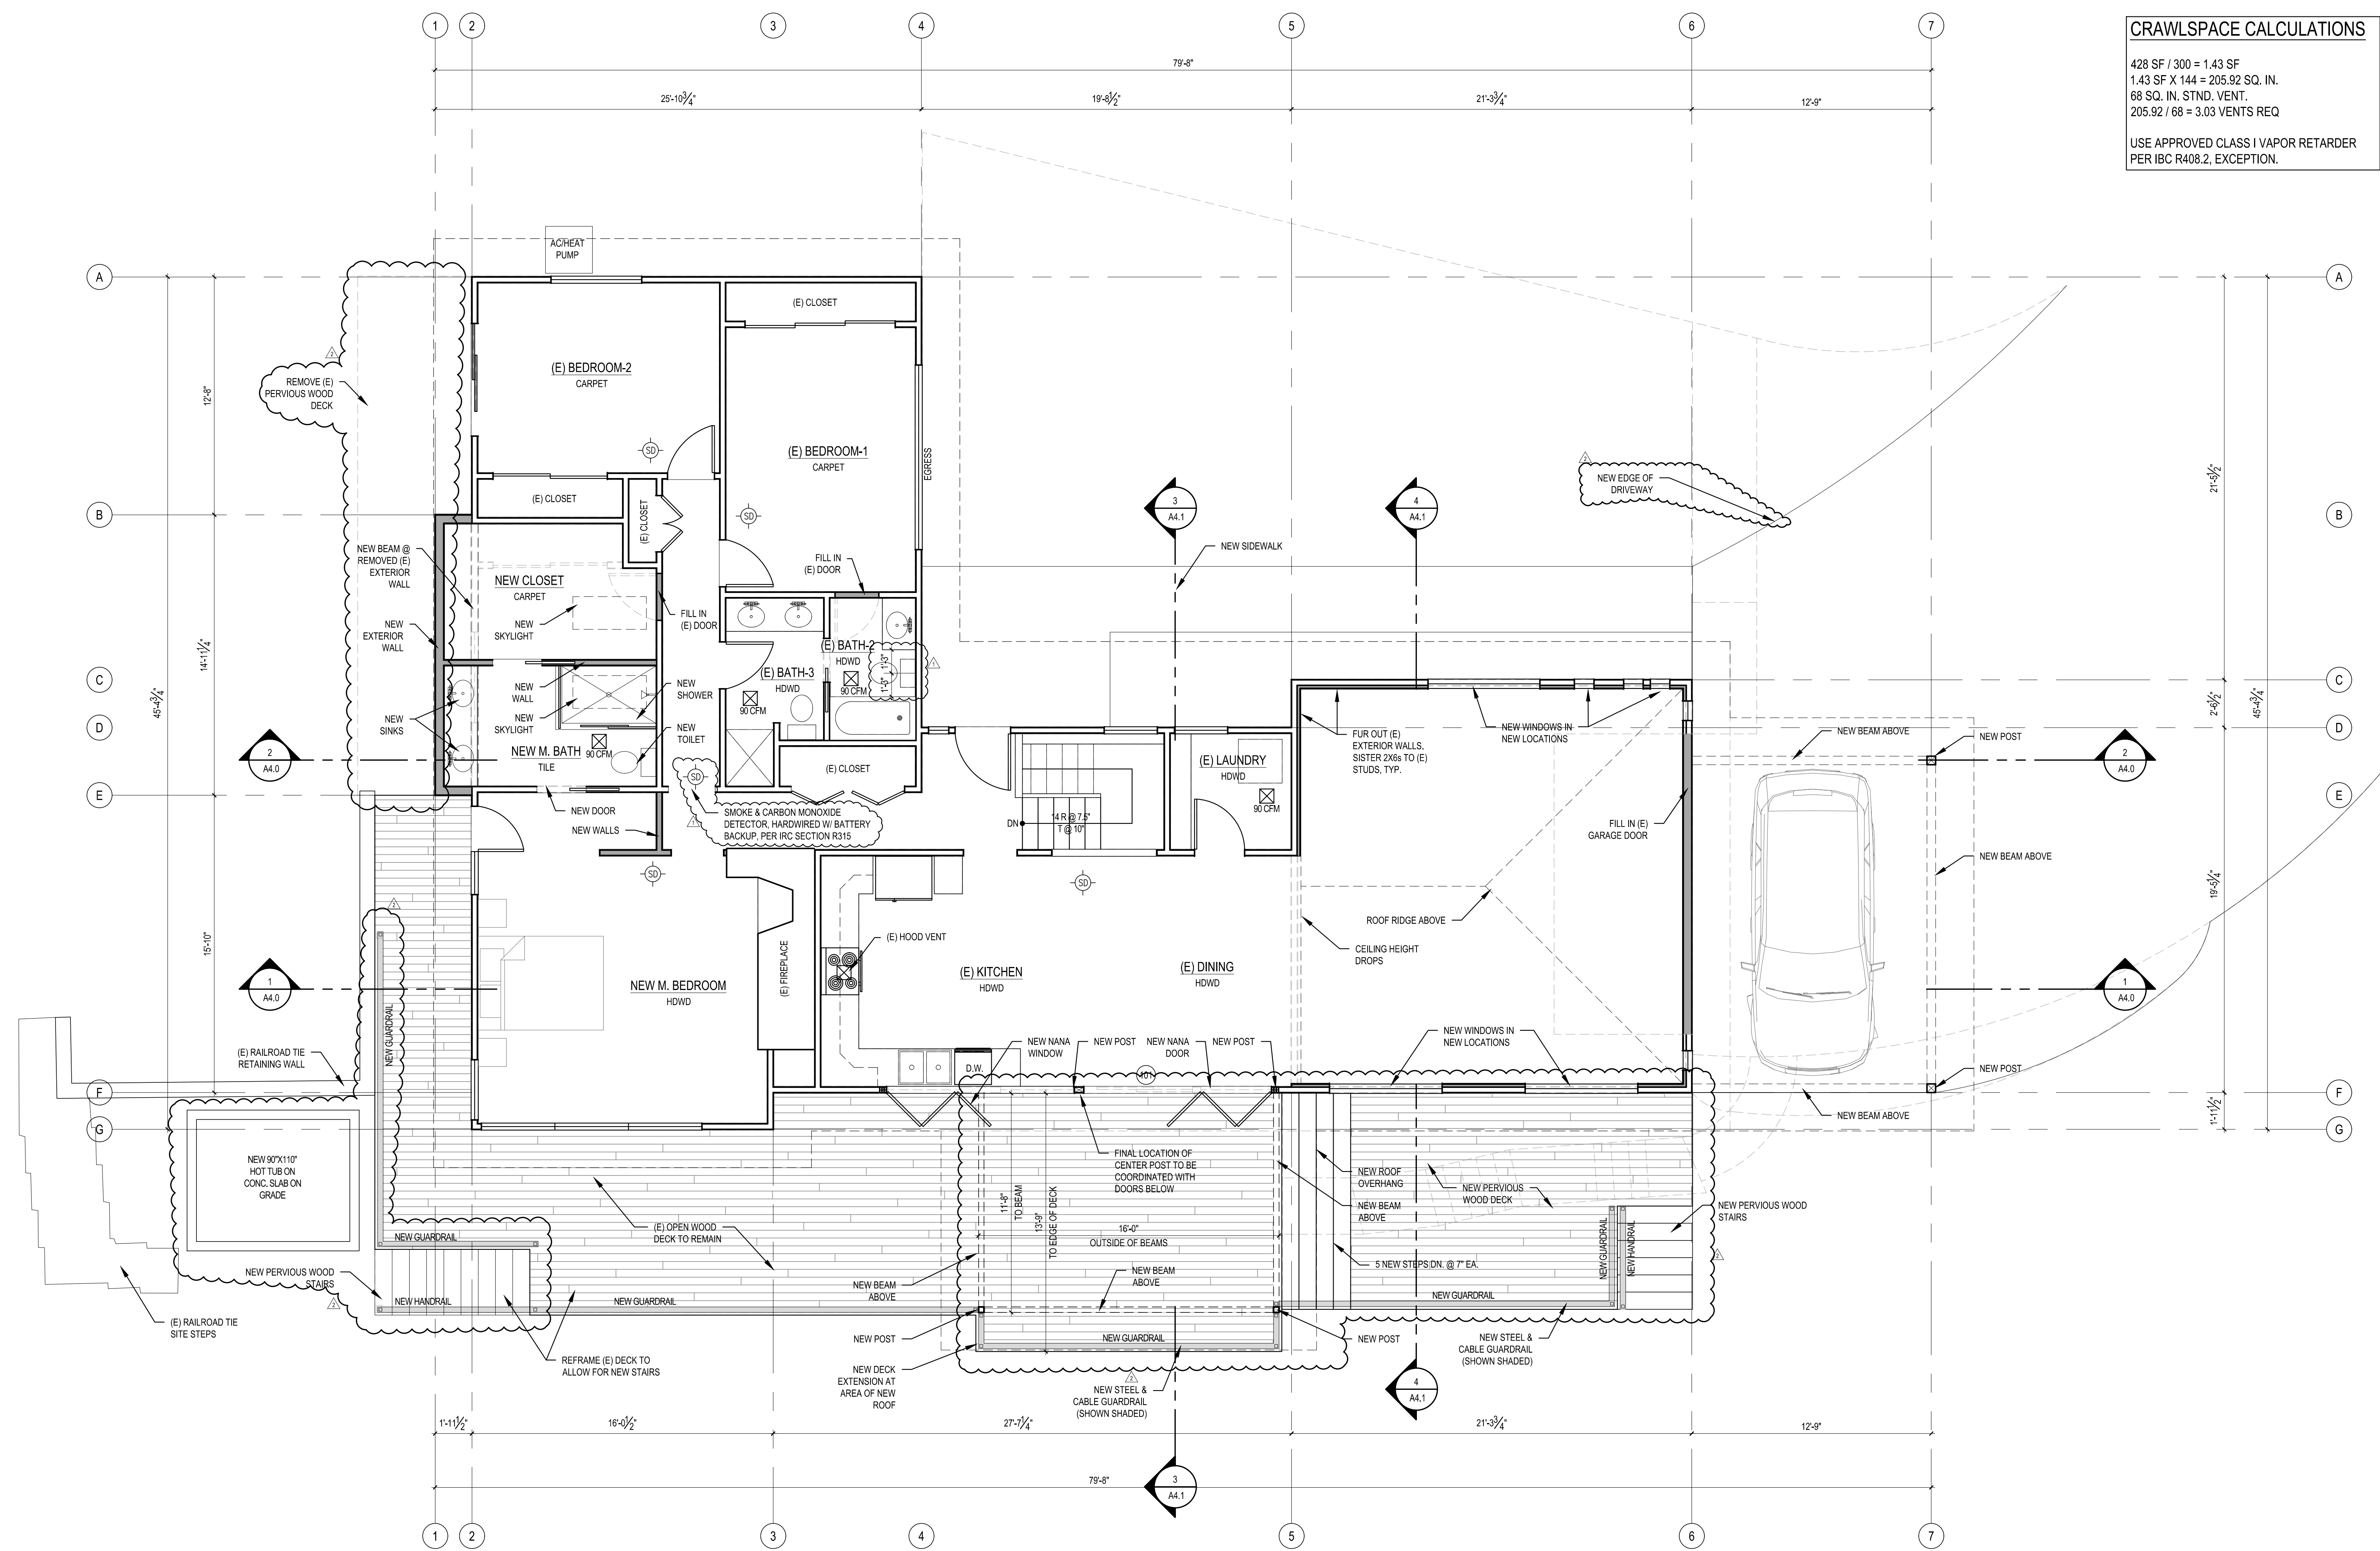

MAIN FLOOR PLAN
SCALE: 1/4" = 1'

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY
PERMIT SET: 08/21/19
PLOT DATE: 8/21/2019 FILE NAME:

REVISIONS:

△	2019-05-30 PERMIT CORRECTIONS #1
△	2019-05-28 DESIGN REVISIONS
△	
△	
△	


DRAWN BY: KE

CHECKED BY: BJS

SHEET

A2.2

OF

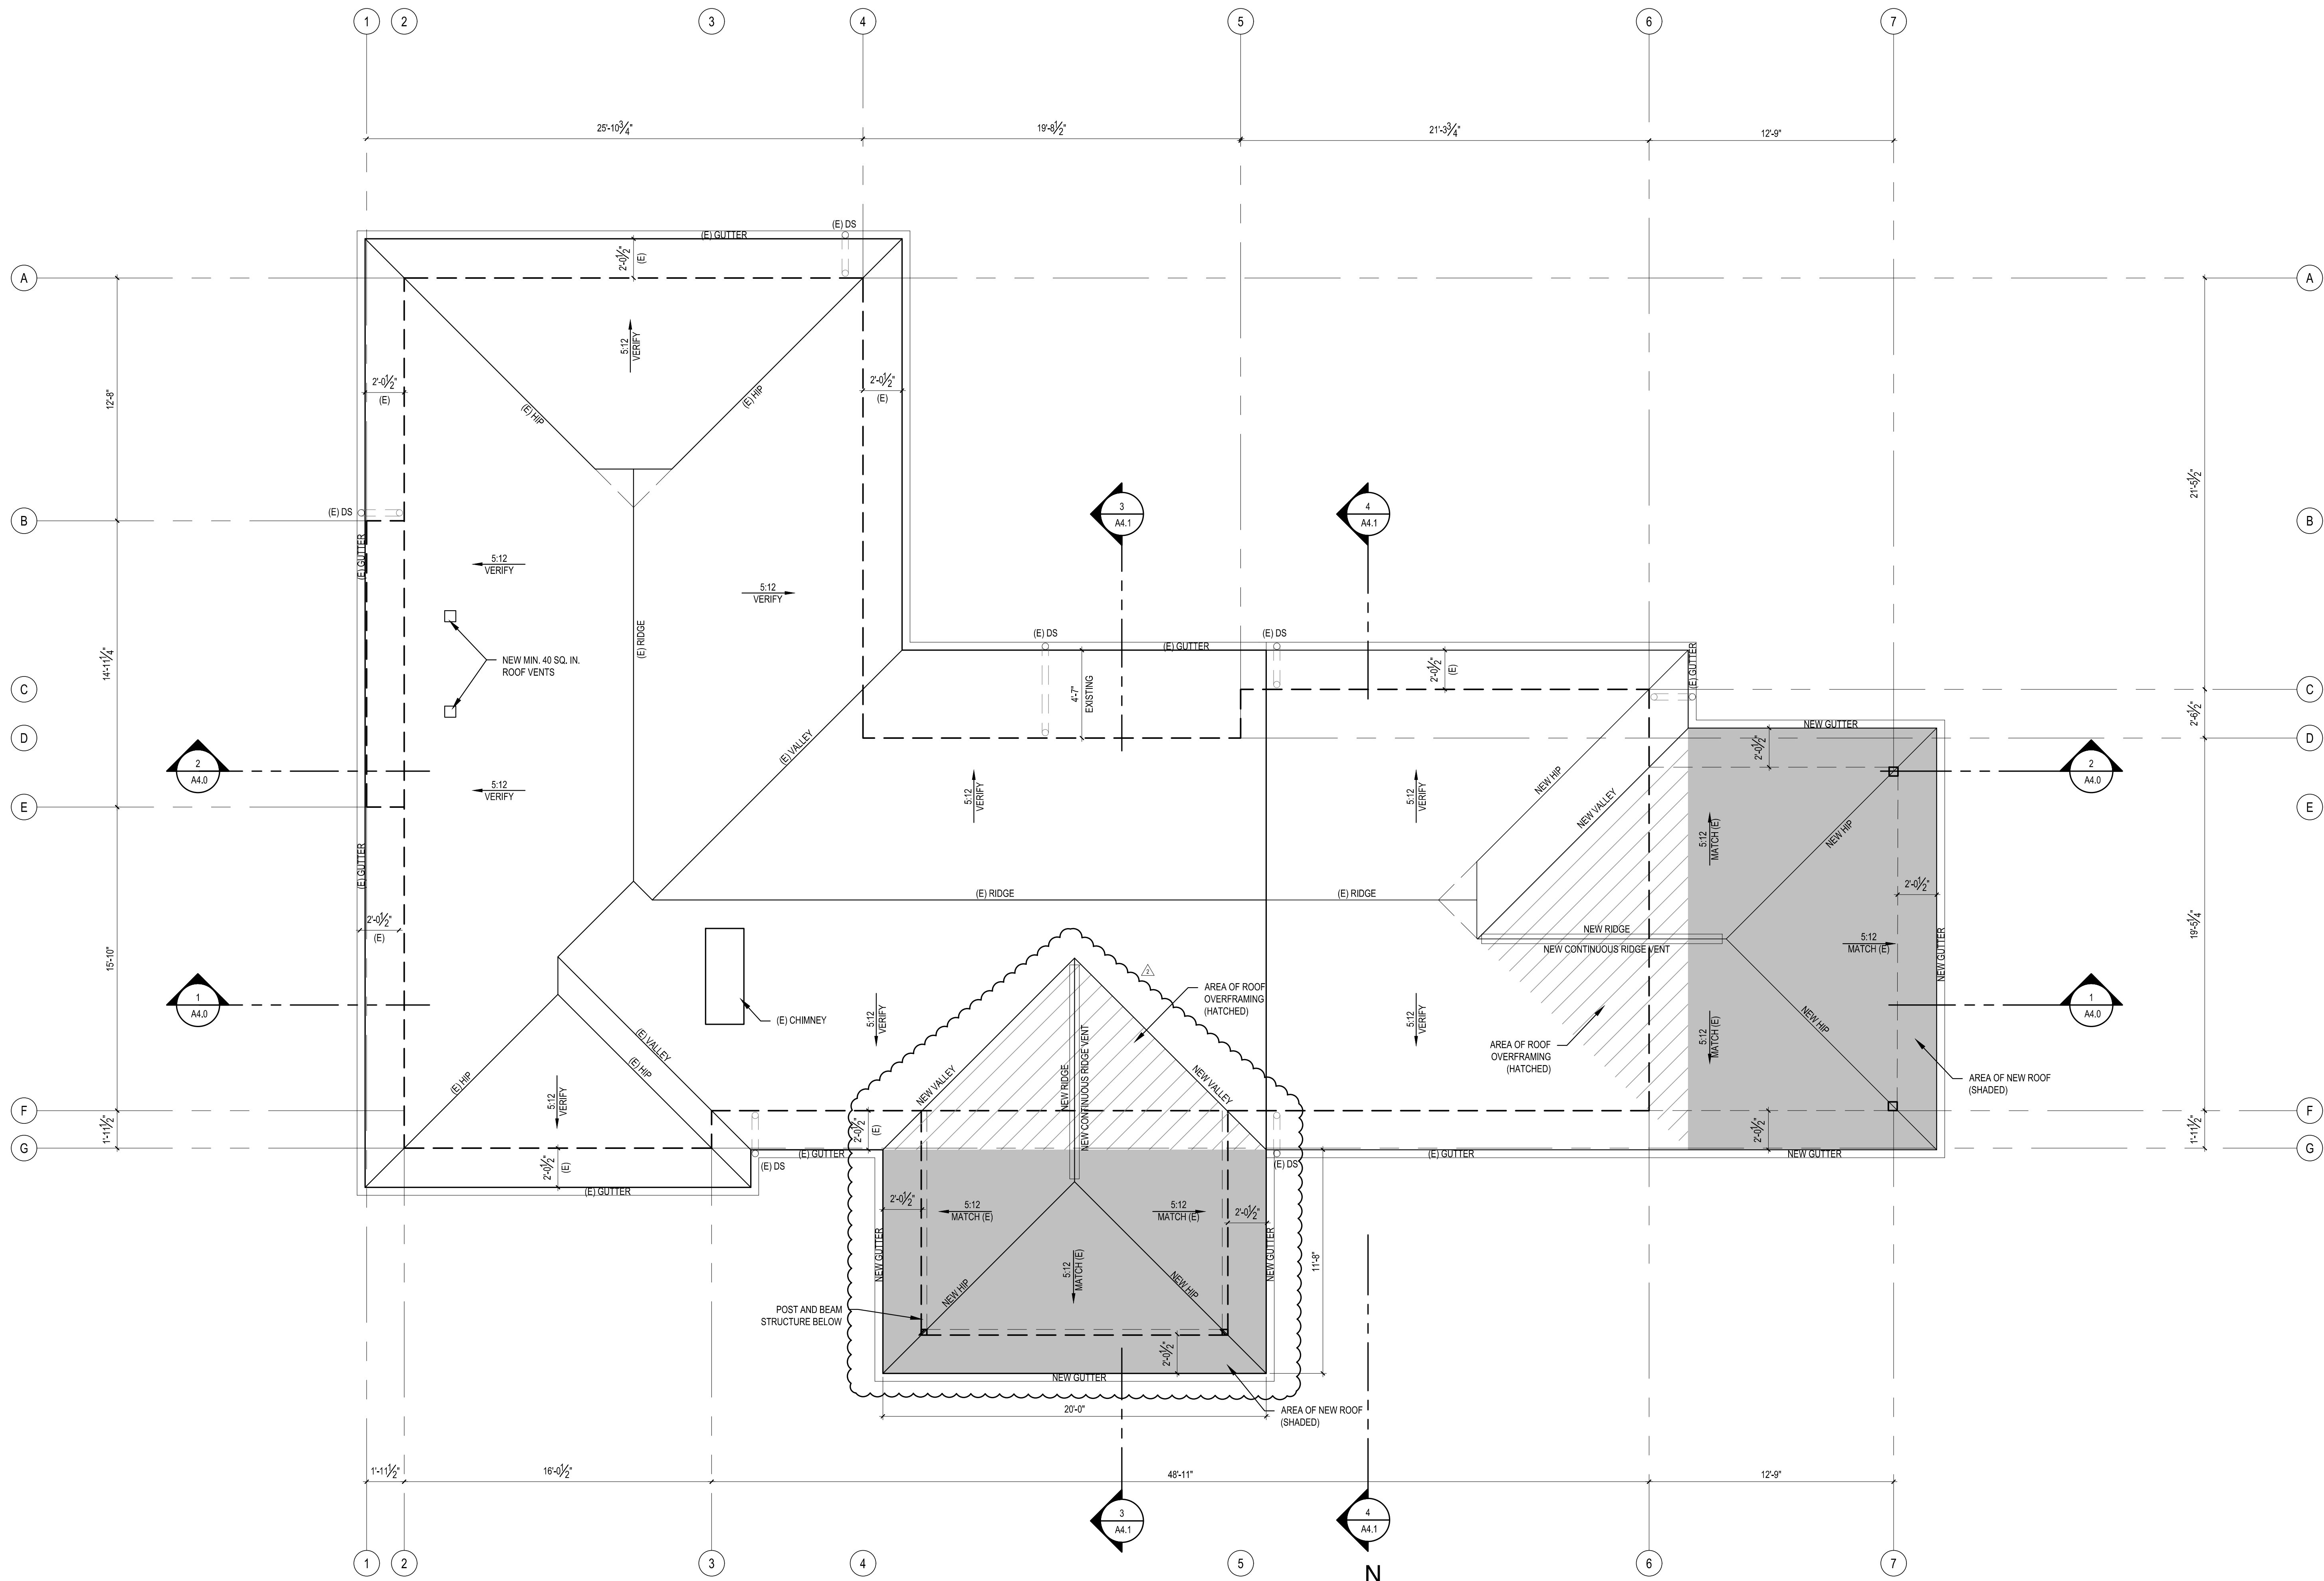

ROOF PLAN
SCALE: 1/4" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY

PERMIT SET	08/21/19
PLOT DATE: 8/21/2019	FILE NAME:


REVISIONS:	
▲ 2019-04-30 PERMIT CORRECTIONS #1	
▲ 2019-04-26 DESIGN REVISIONS	
▲	
▲	
▲	

DRAWN BY: KE
CHECKED BY: BJS


SHEET

A3.0

OF

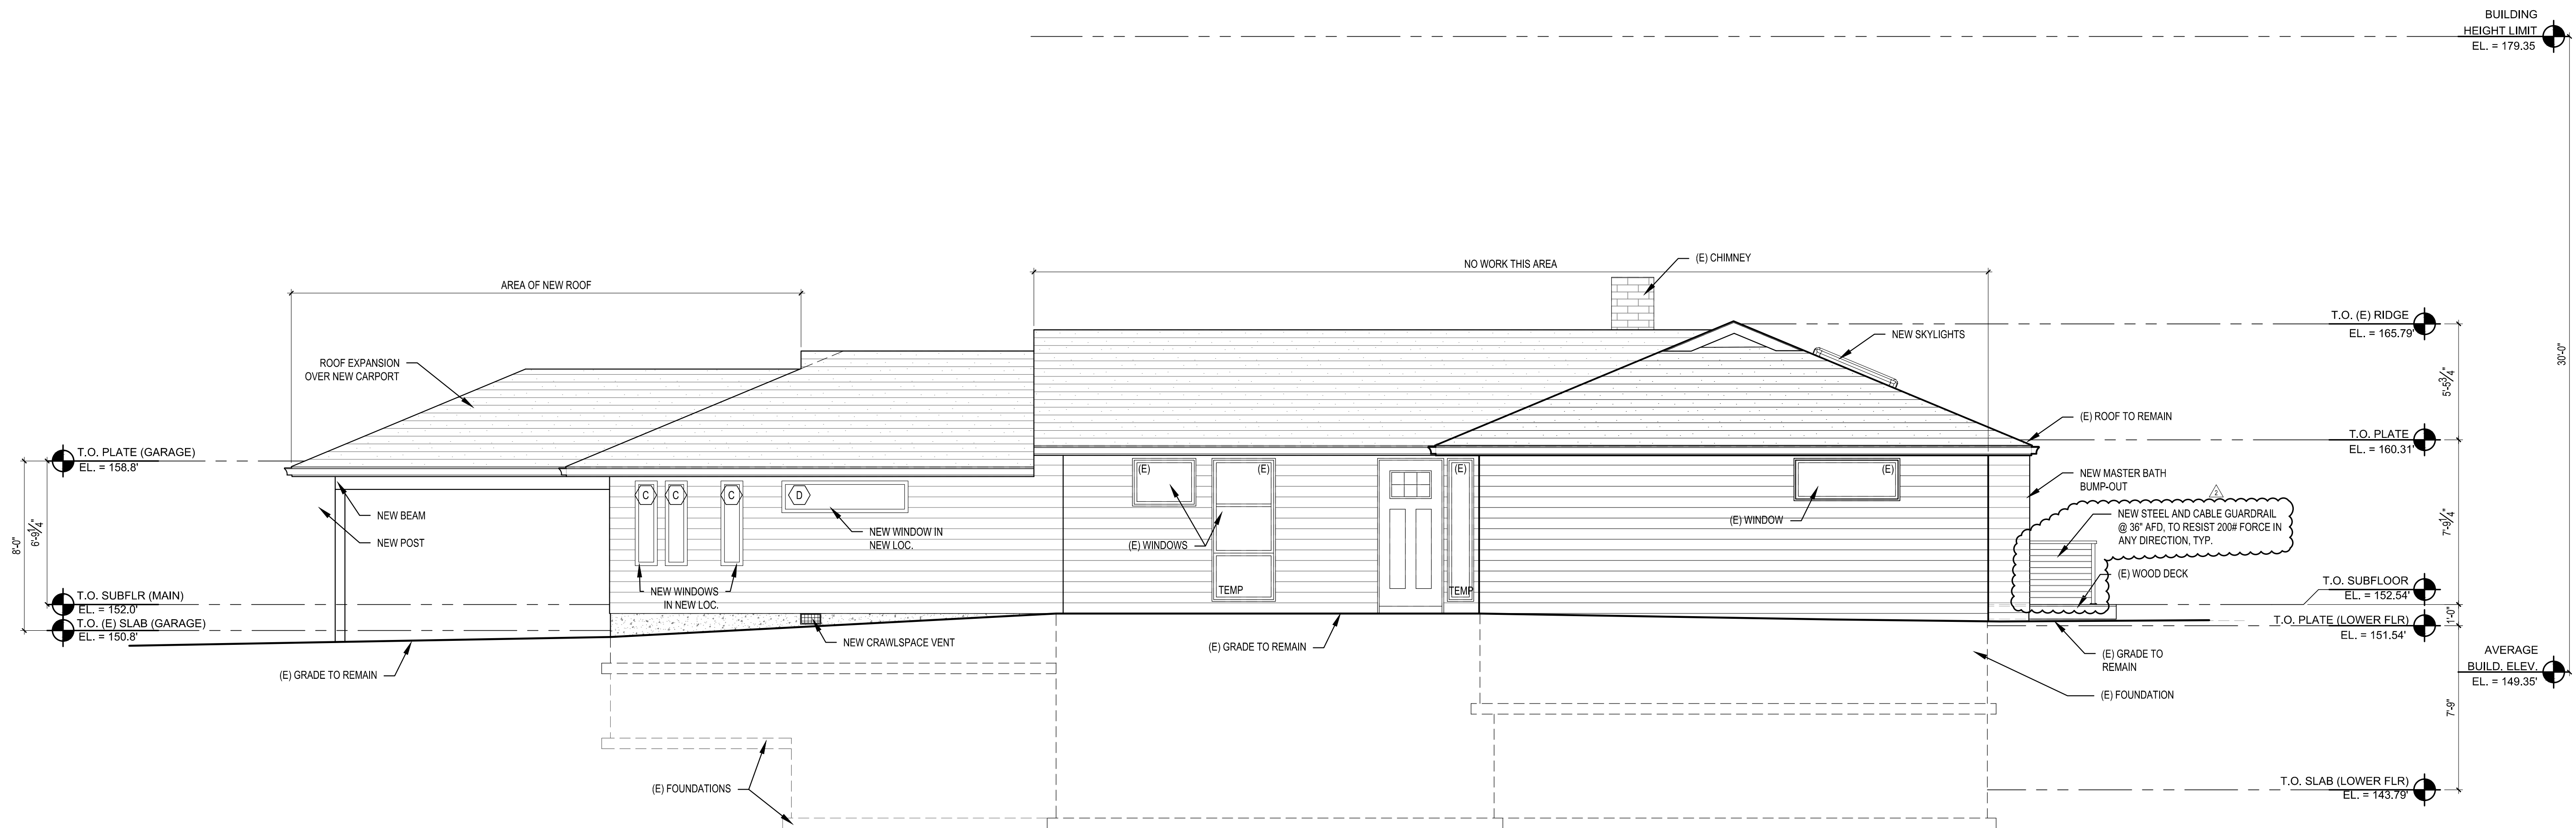

① NORTHWEST EXT. ELEVATION
SCALE: 1/4" = 1'-0"

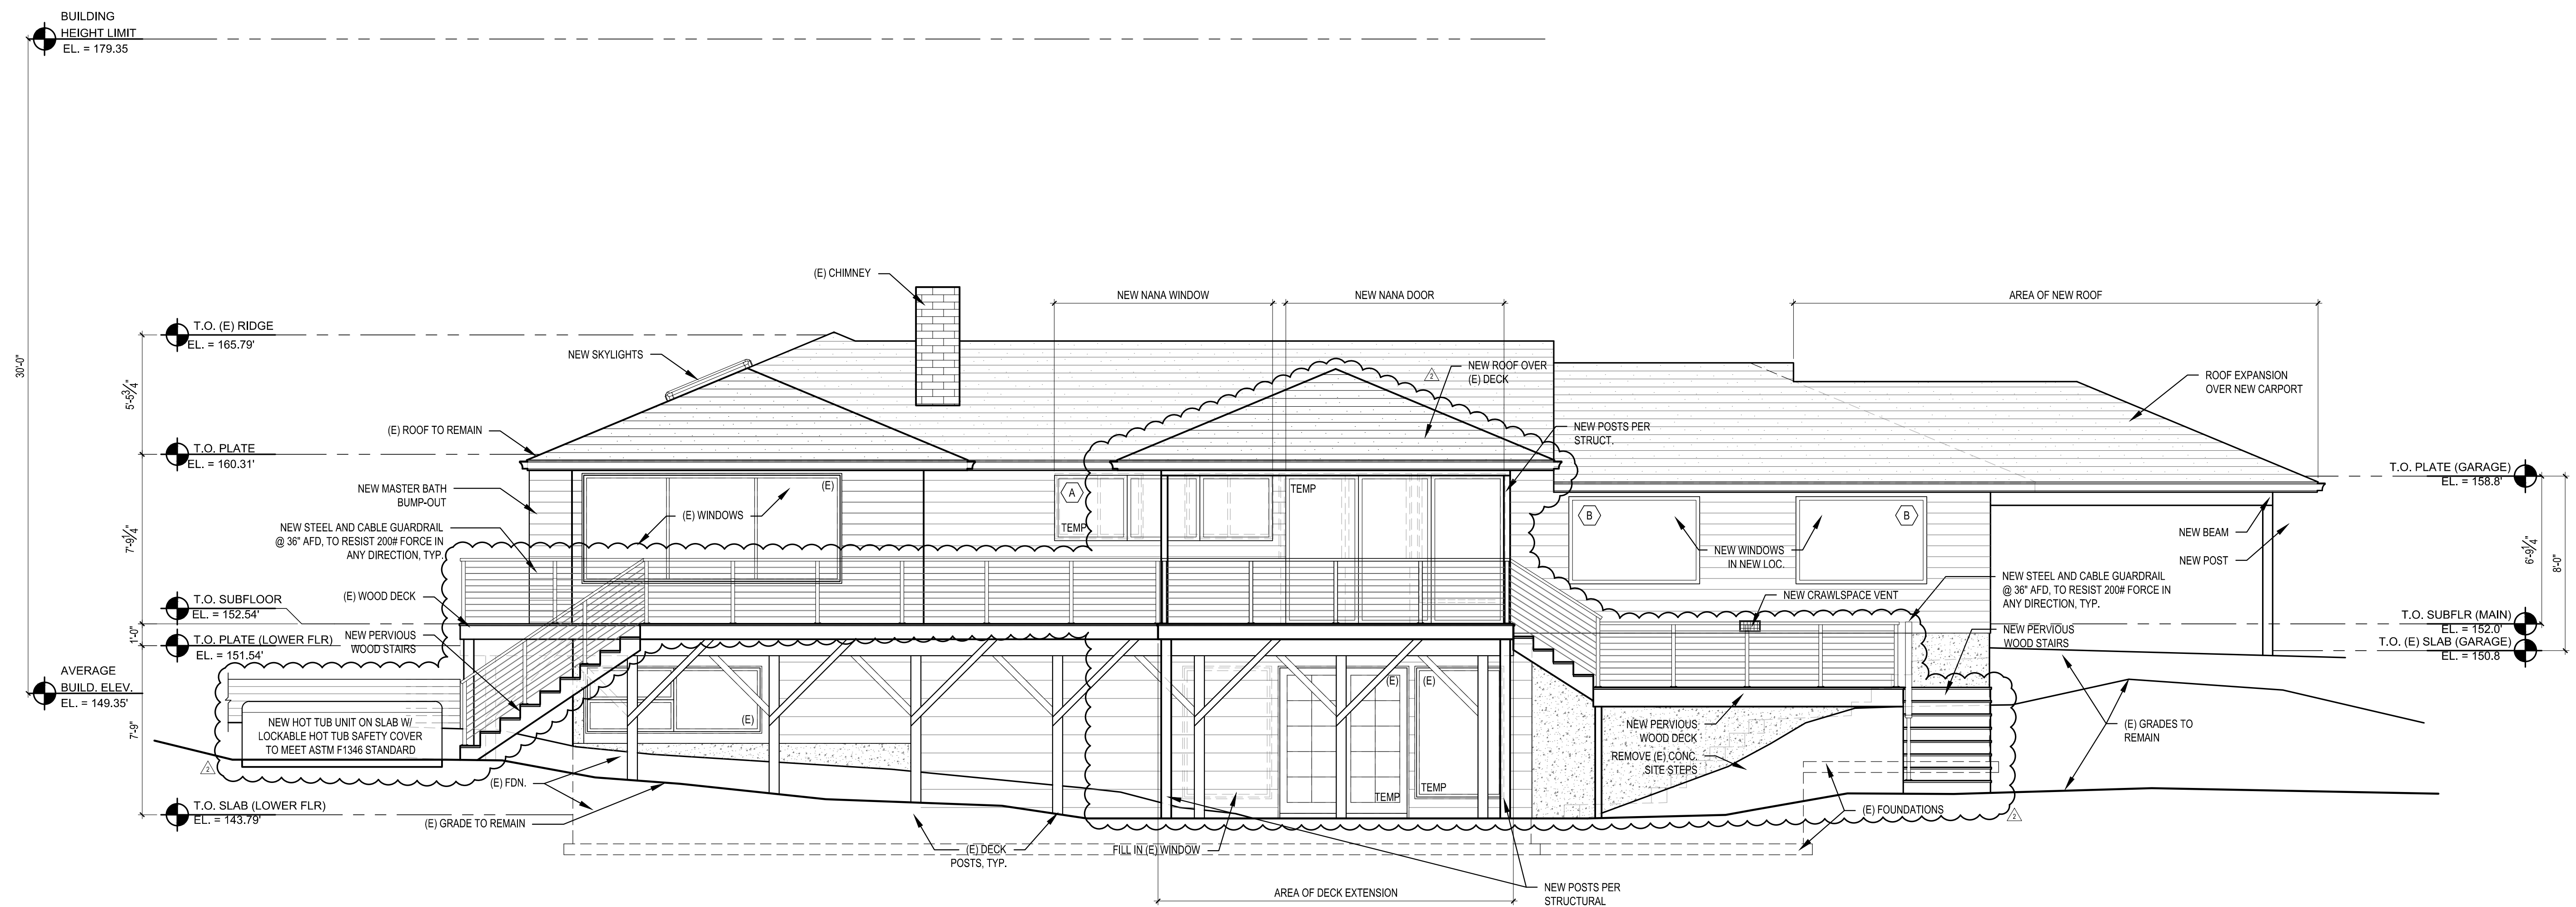

② SOUTHEAST EXT. ELEVATION
SCALE: 1/4" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY	
PERMIT SET	08/21/19
PLOT DATE: 8/21/2019	FILE NAME:


REVISIONS:	2019-04-30 PERMIT CORRECTIONS #1
1	2019-04-26 DESIGN REVISIONS
2	
3	
4	
5	
6	
7	
8	
9	
10	

DRAWN BY: KE
CHECKED BY: BJS


SHEET

A3.1

OF

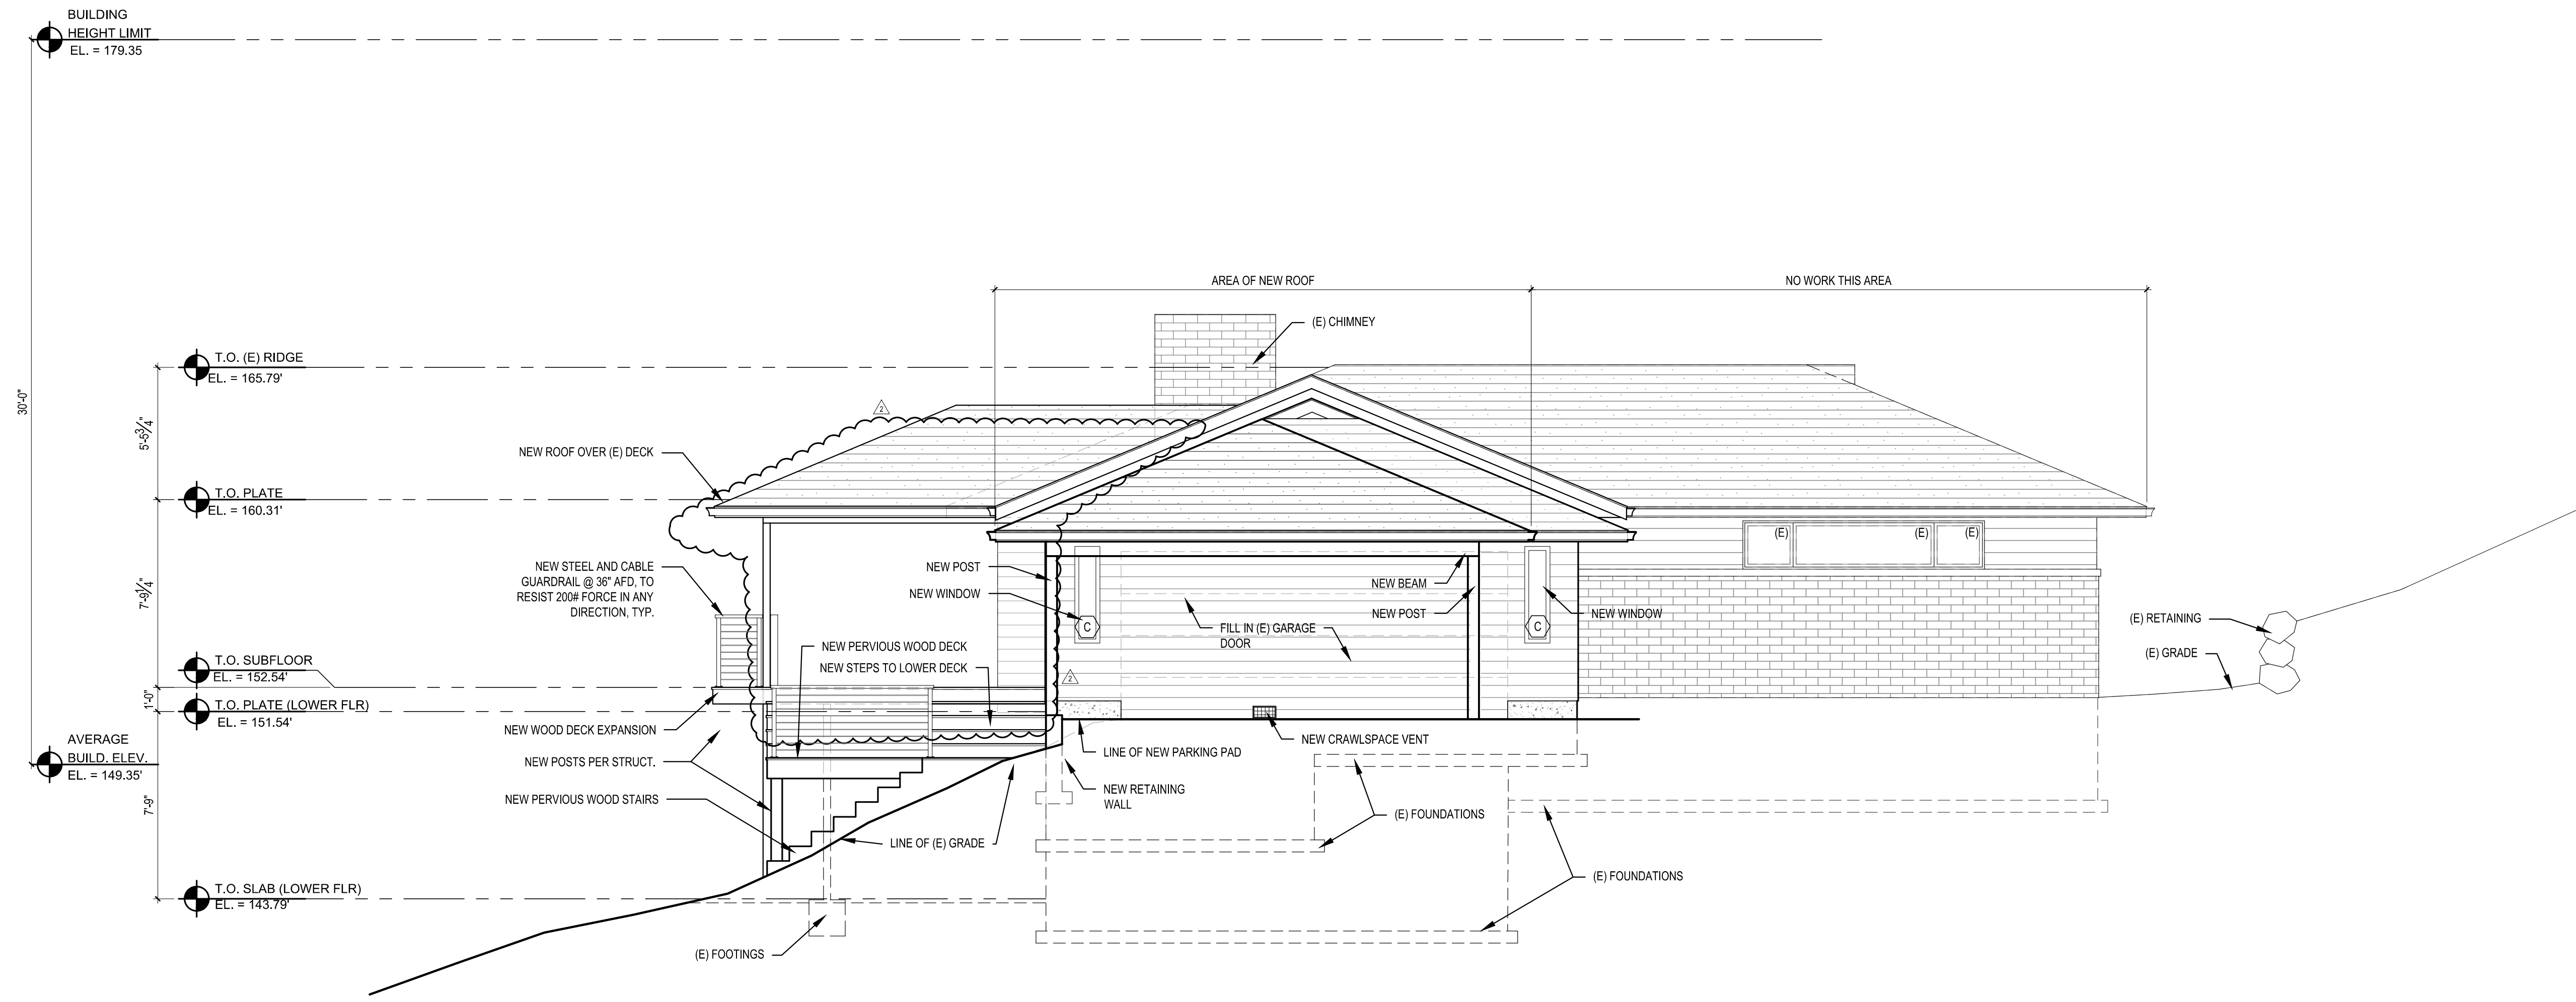

③ NORTHEAST EXT. ELEVATION
SCALE: 1/4" = 1'-0"

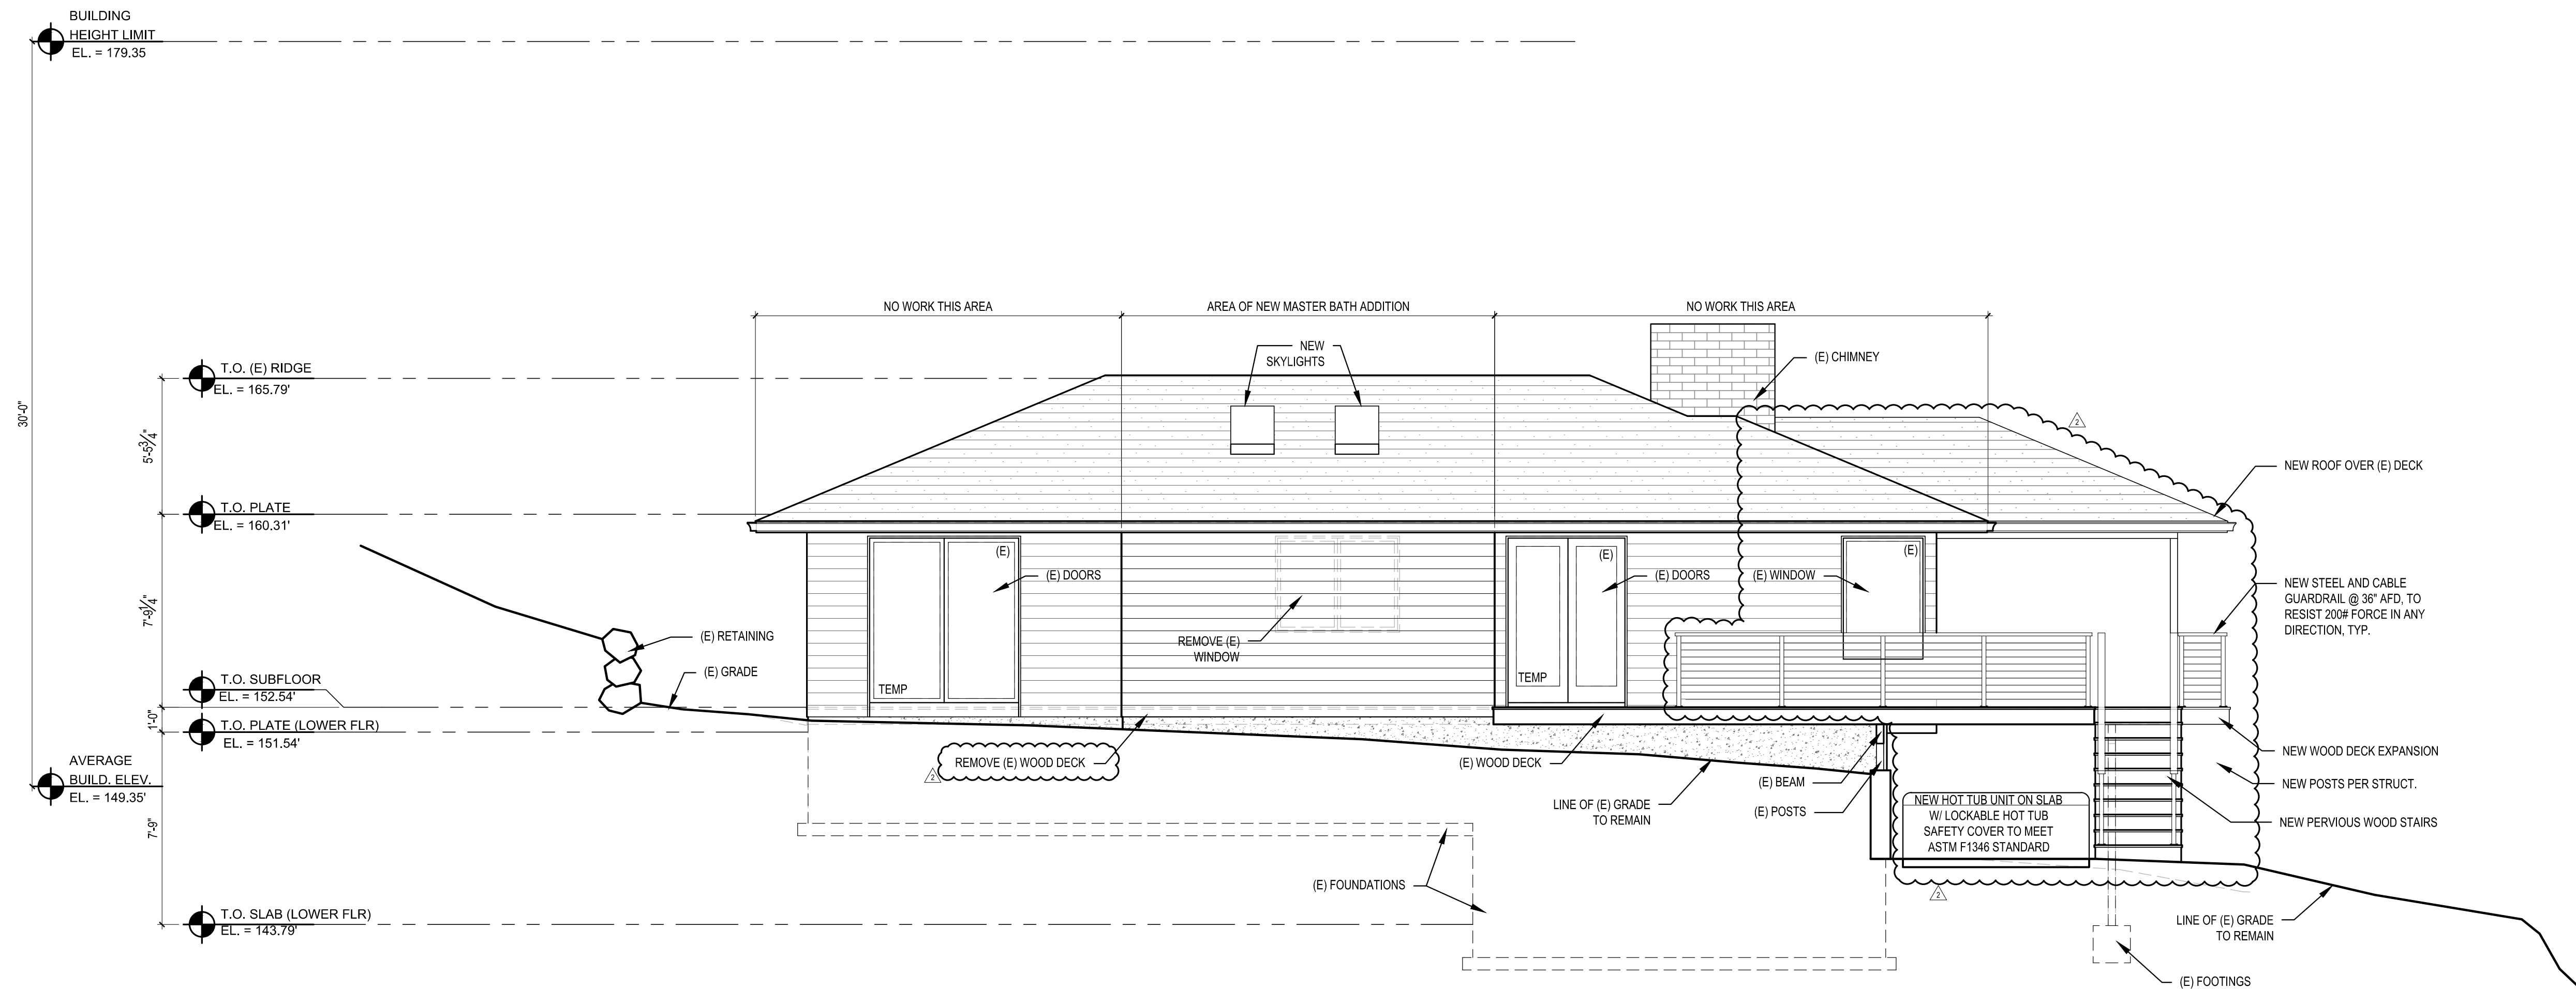

④ SOUTHWEST EXT. ELEVATION
SCALE: 1/4" = 1'-0"


SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY
PERMIT SET 08/21/19
PLOT DATE: 8/21/2019 FILE NAME:

REVISIONS:	DATE	DESCRIPTION
1	2019-04-30	PERMIT CORRECTIONS #1
2	2019-04-26	DESIGN REVISIONS


DRAWN BY: KE
CHECKED BY: BJS

SHEET
A4.0

OF

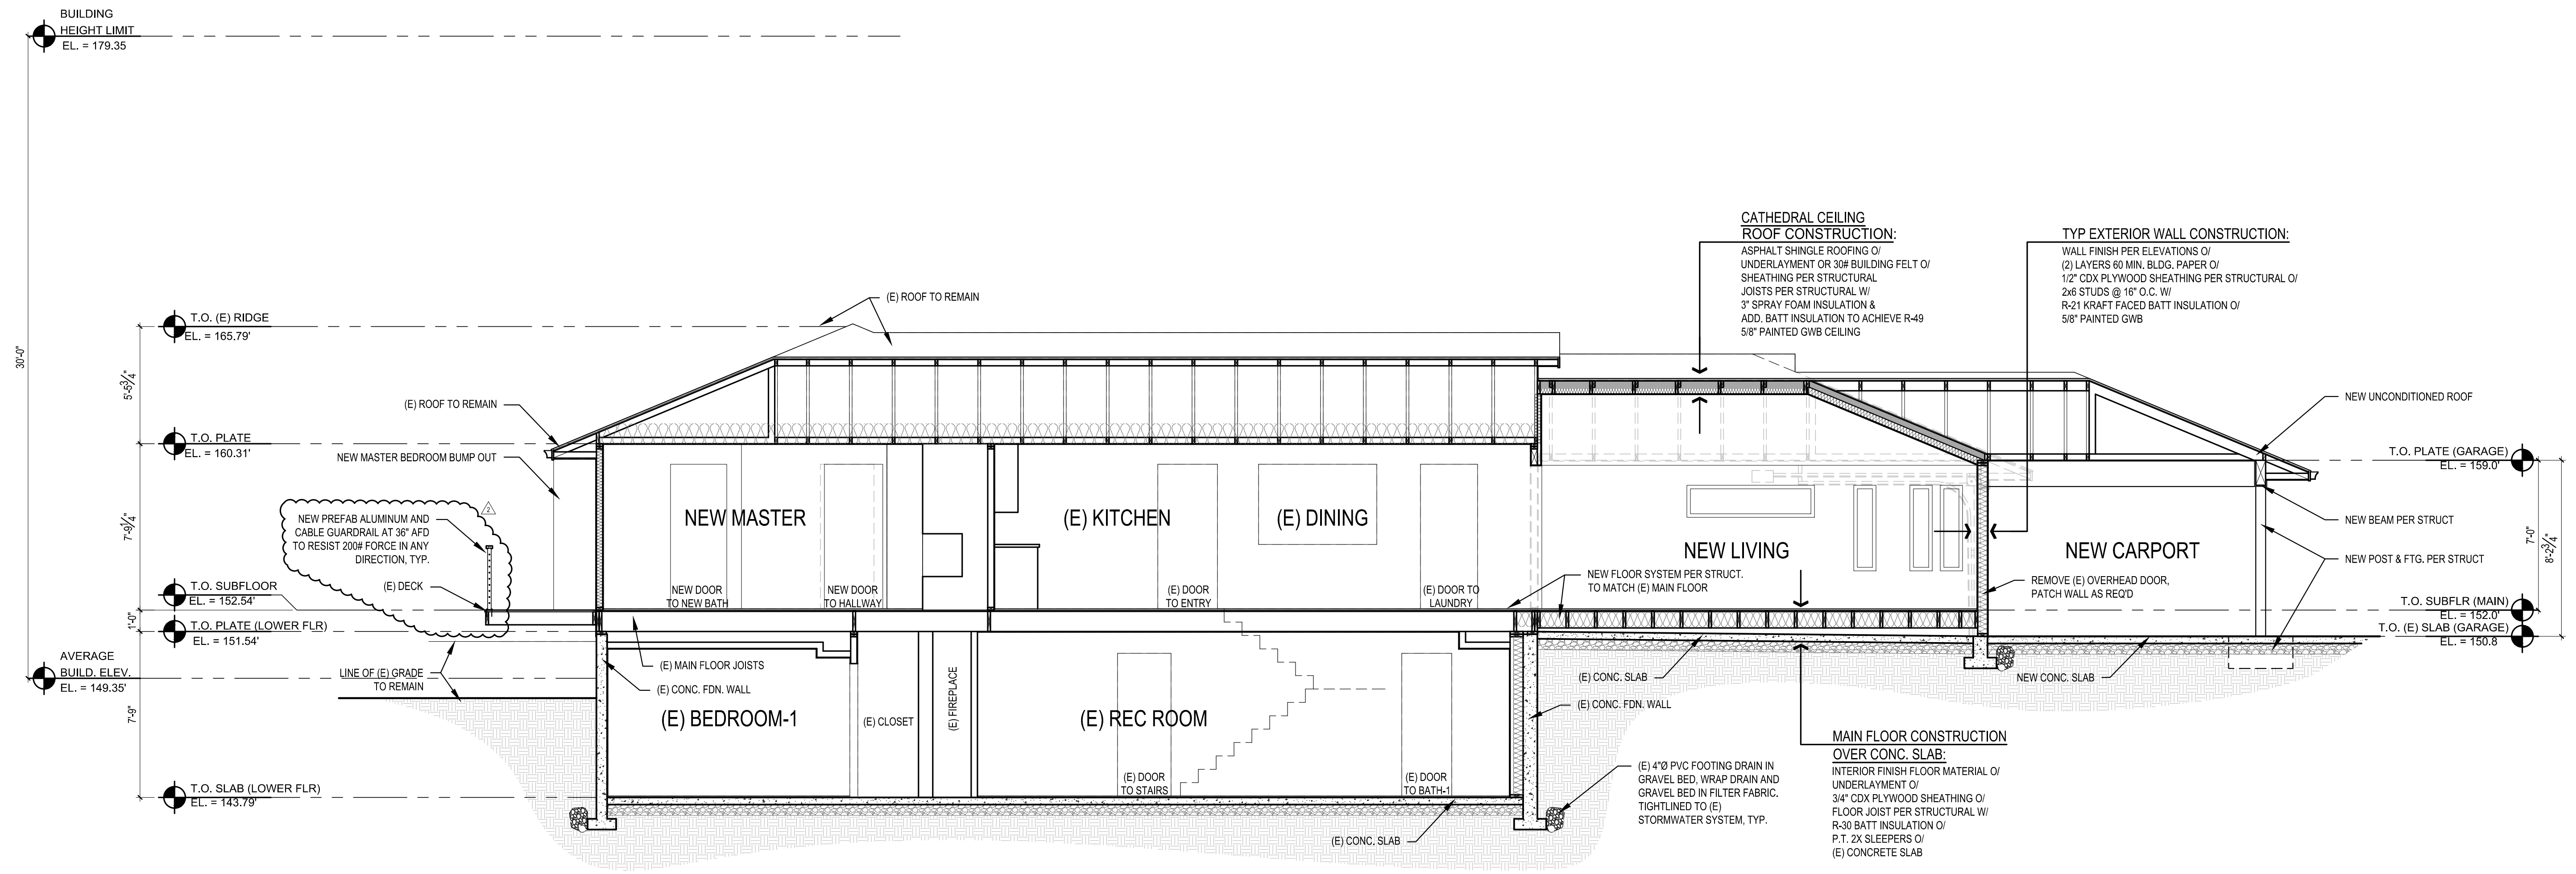

① BUILDING SECTION
SCALE: 1/4" = 1'-0"

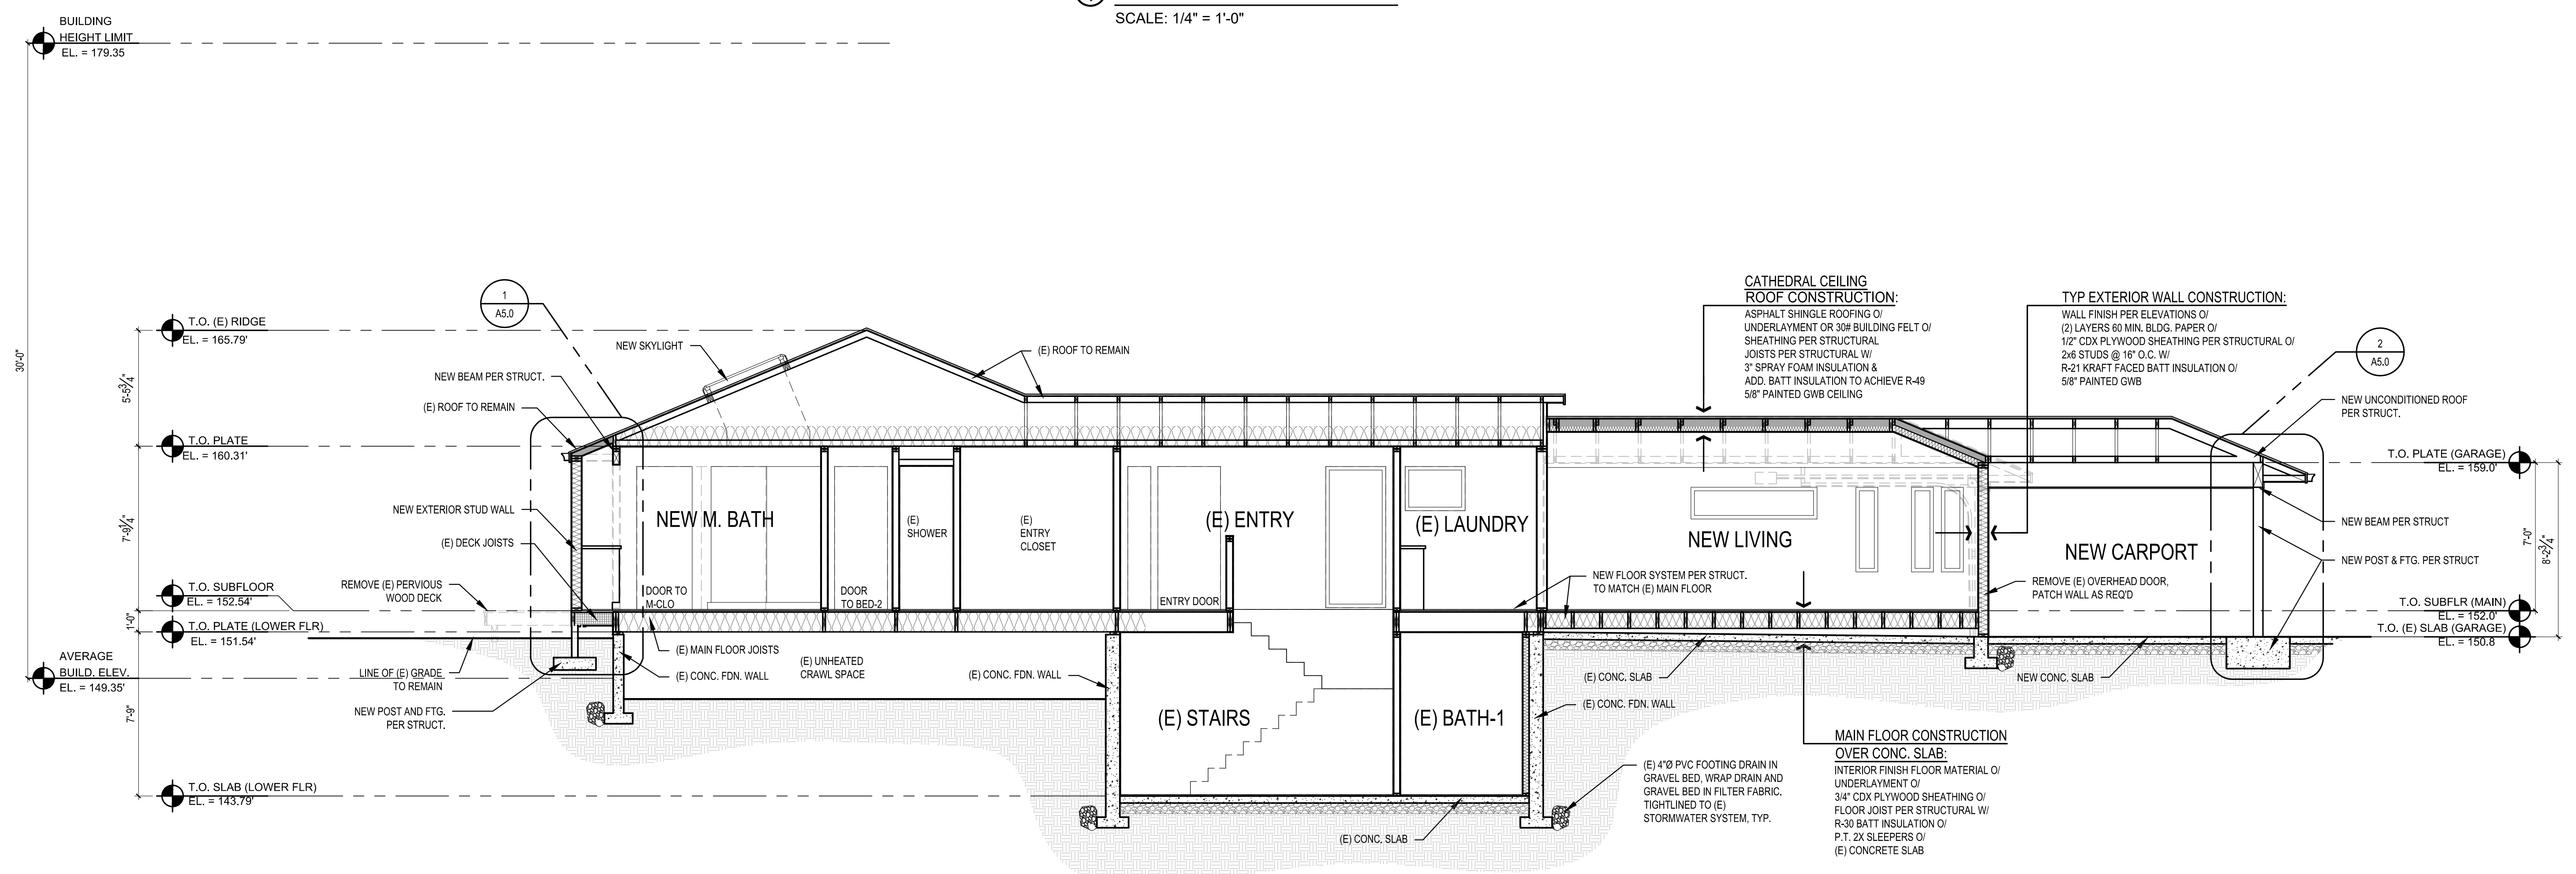

② BUILDING SECTION
SCALE: 1/4" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY	
PERMIT SET	08/21/19
PLOT DATE: 8/21/2019	FILE NAME:

REVISIONS:	2019-4-30 PERMIT CORRECTIONS #1
	2019-4-26 DESIGN REVISIONS


DRAWN BY: KE

CHECKED BY: BJS


SHEET

A4.1

OF

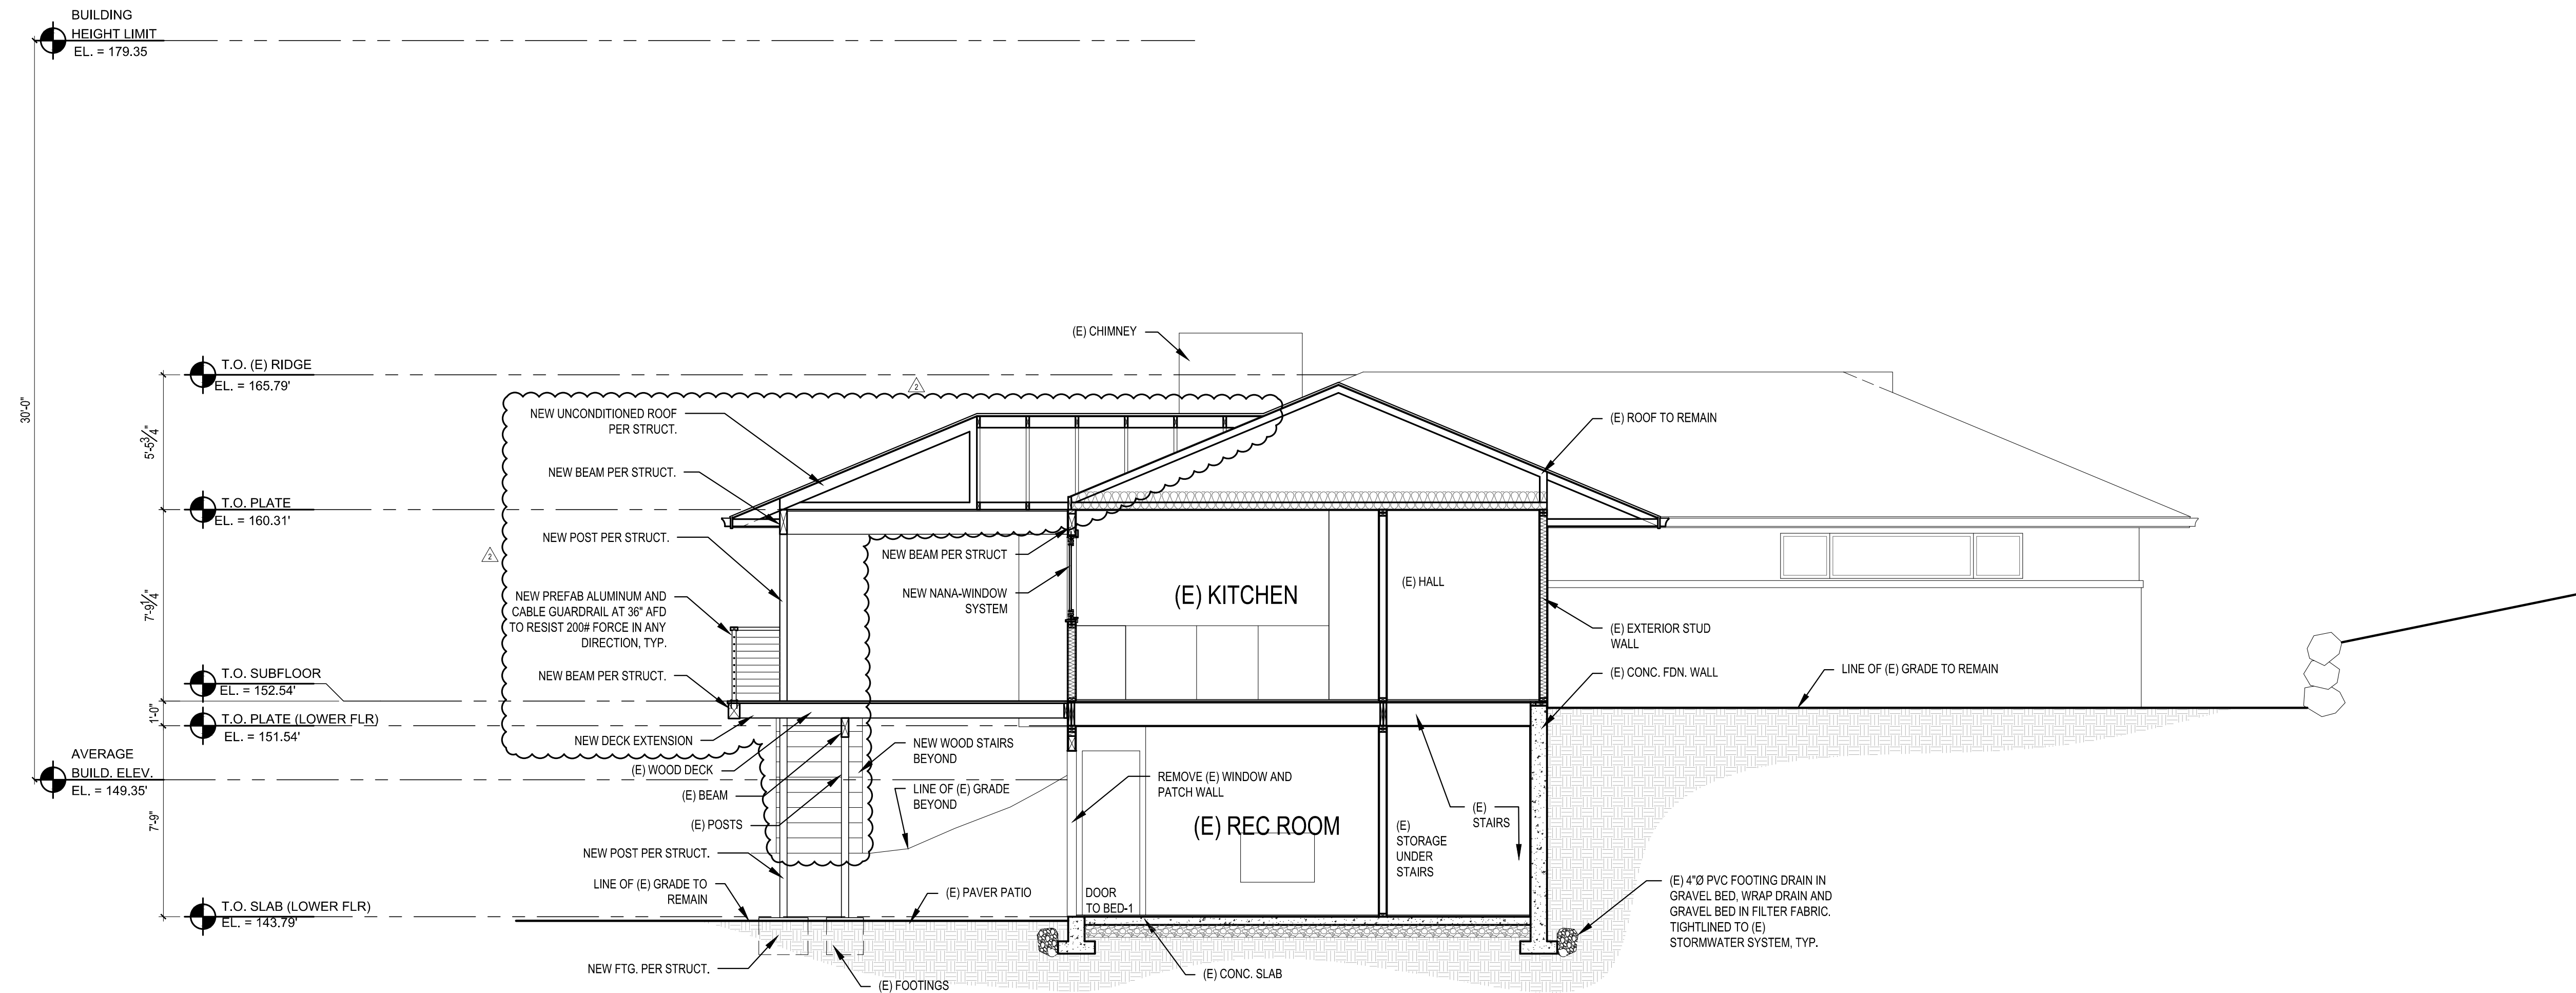


③ BUILDING SECTION
SCALE: 1/4" = 1'-0"

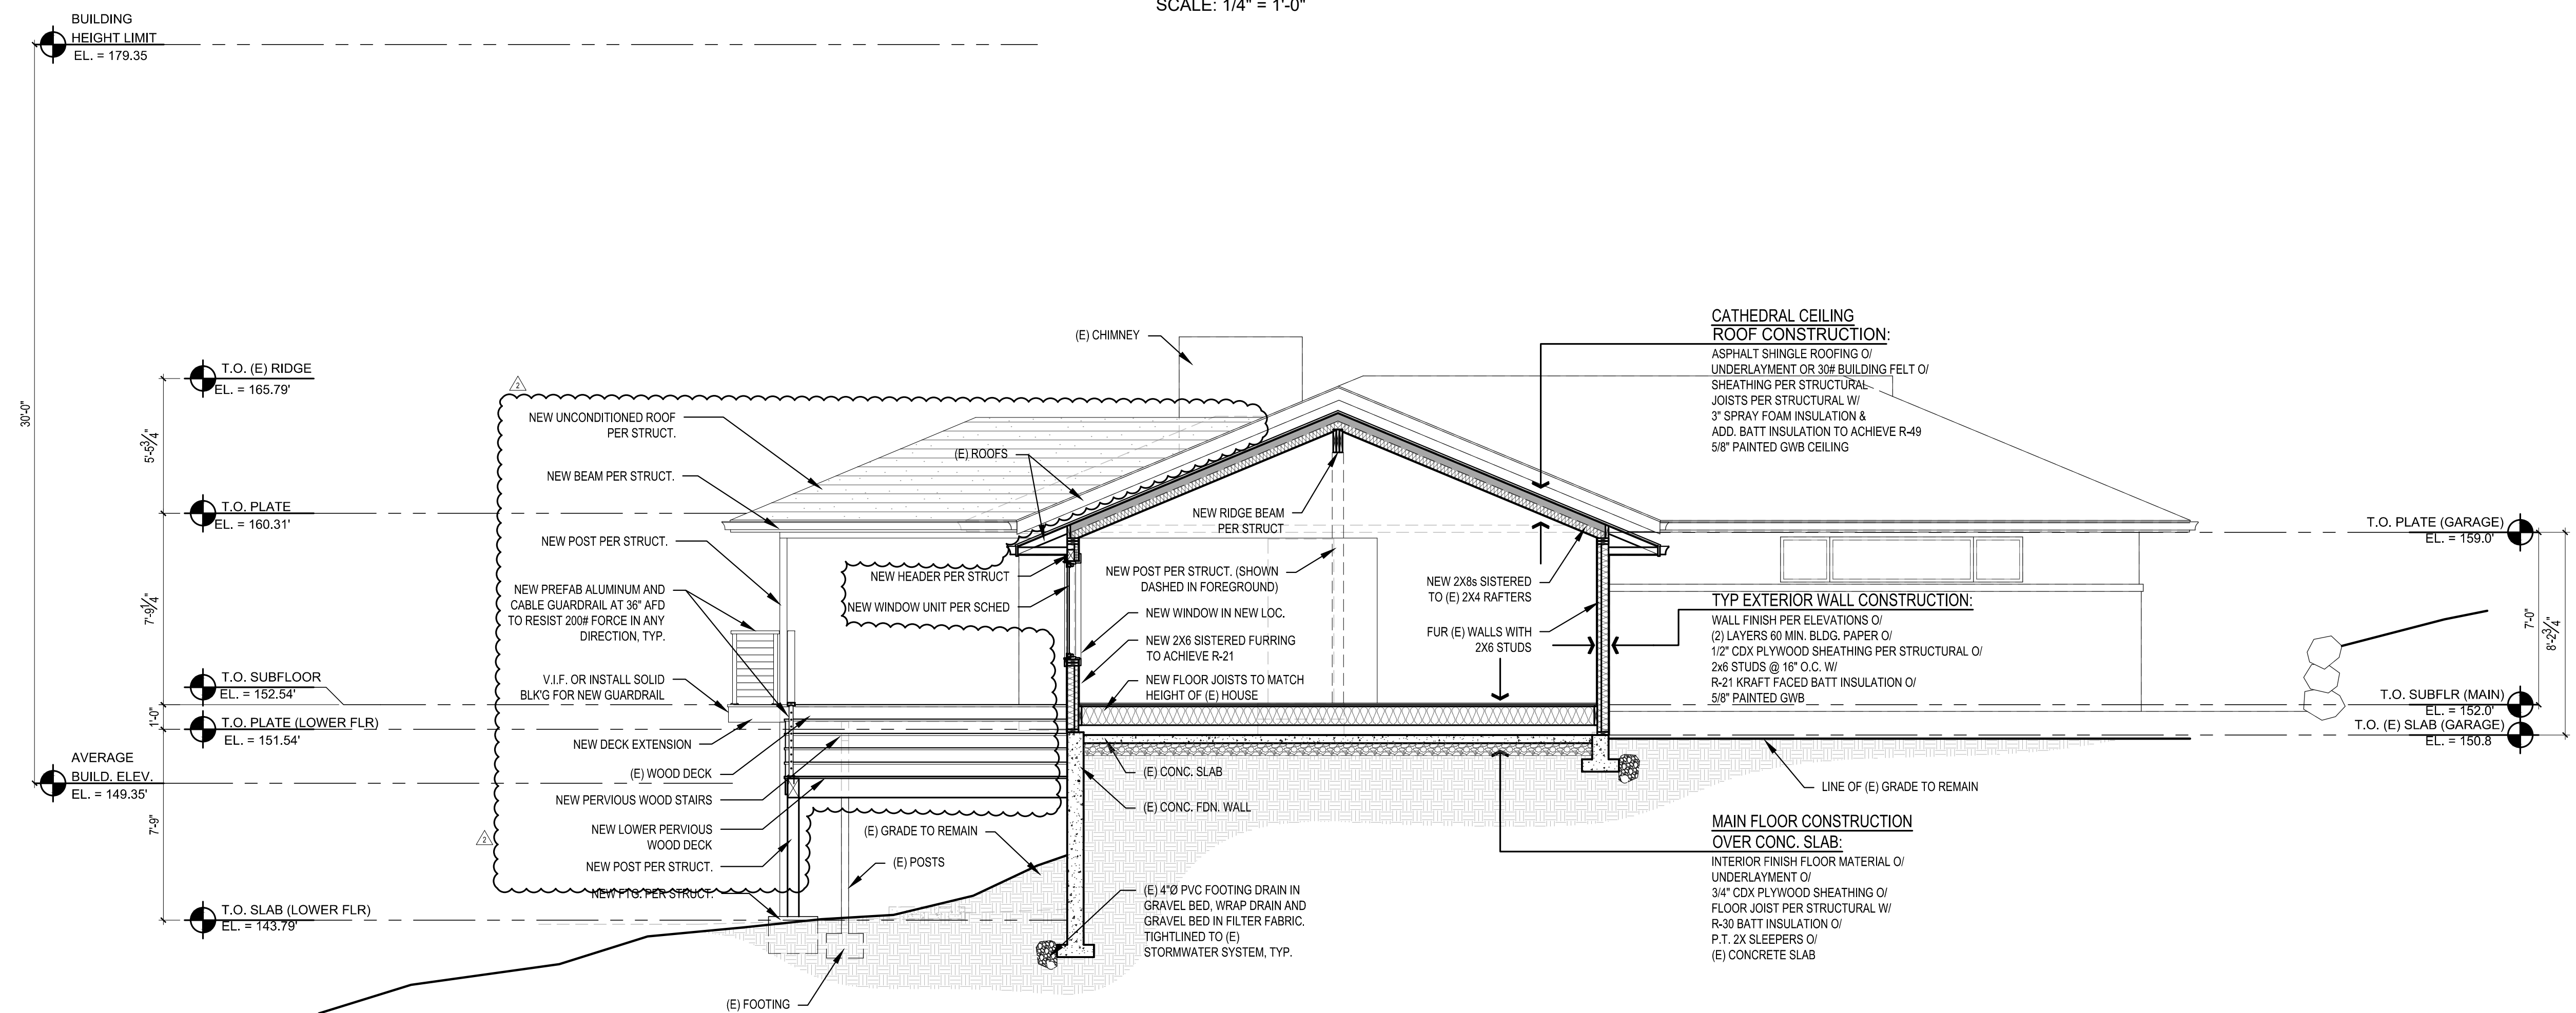


④ BUILDING SECTION
SCALE: 1/4" = 1'-0"


SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY	
PERMIT SET	08/21/19
PLOT DATE: 8/21/2019	FILE NAME:

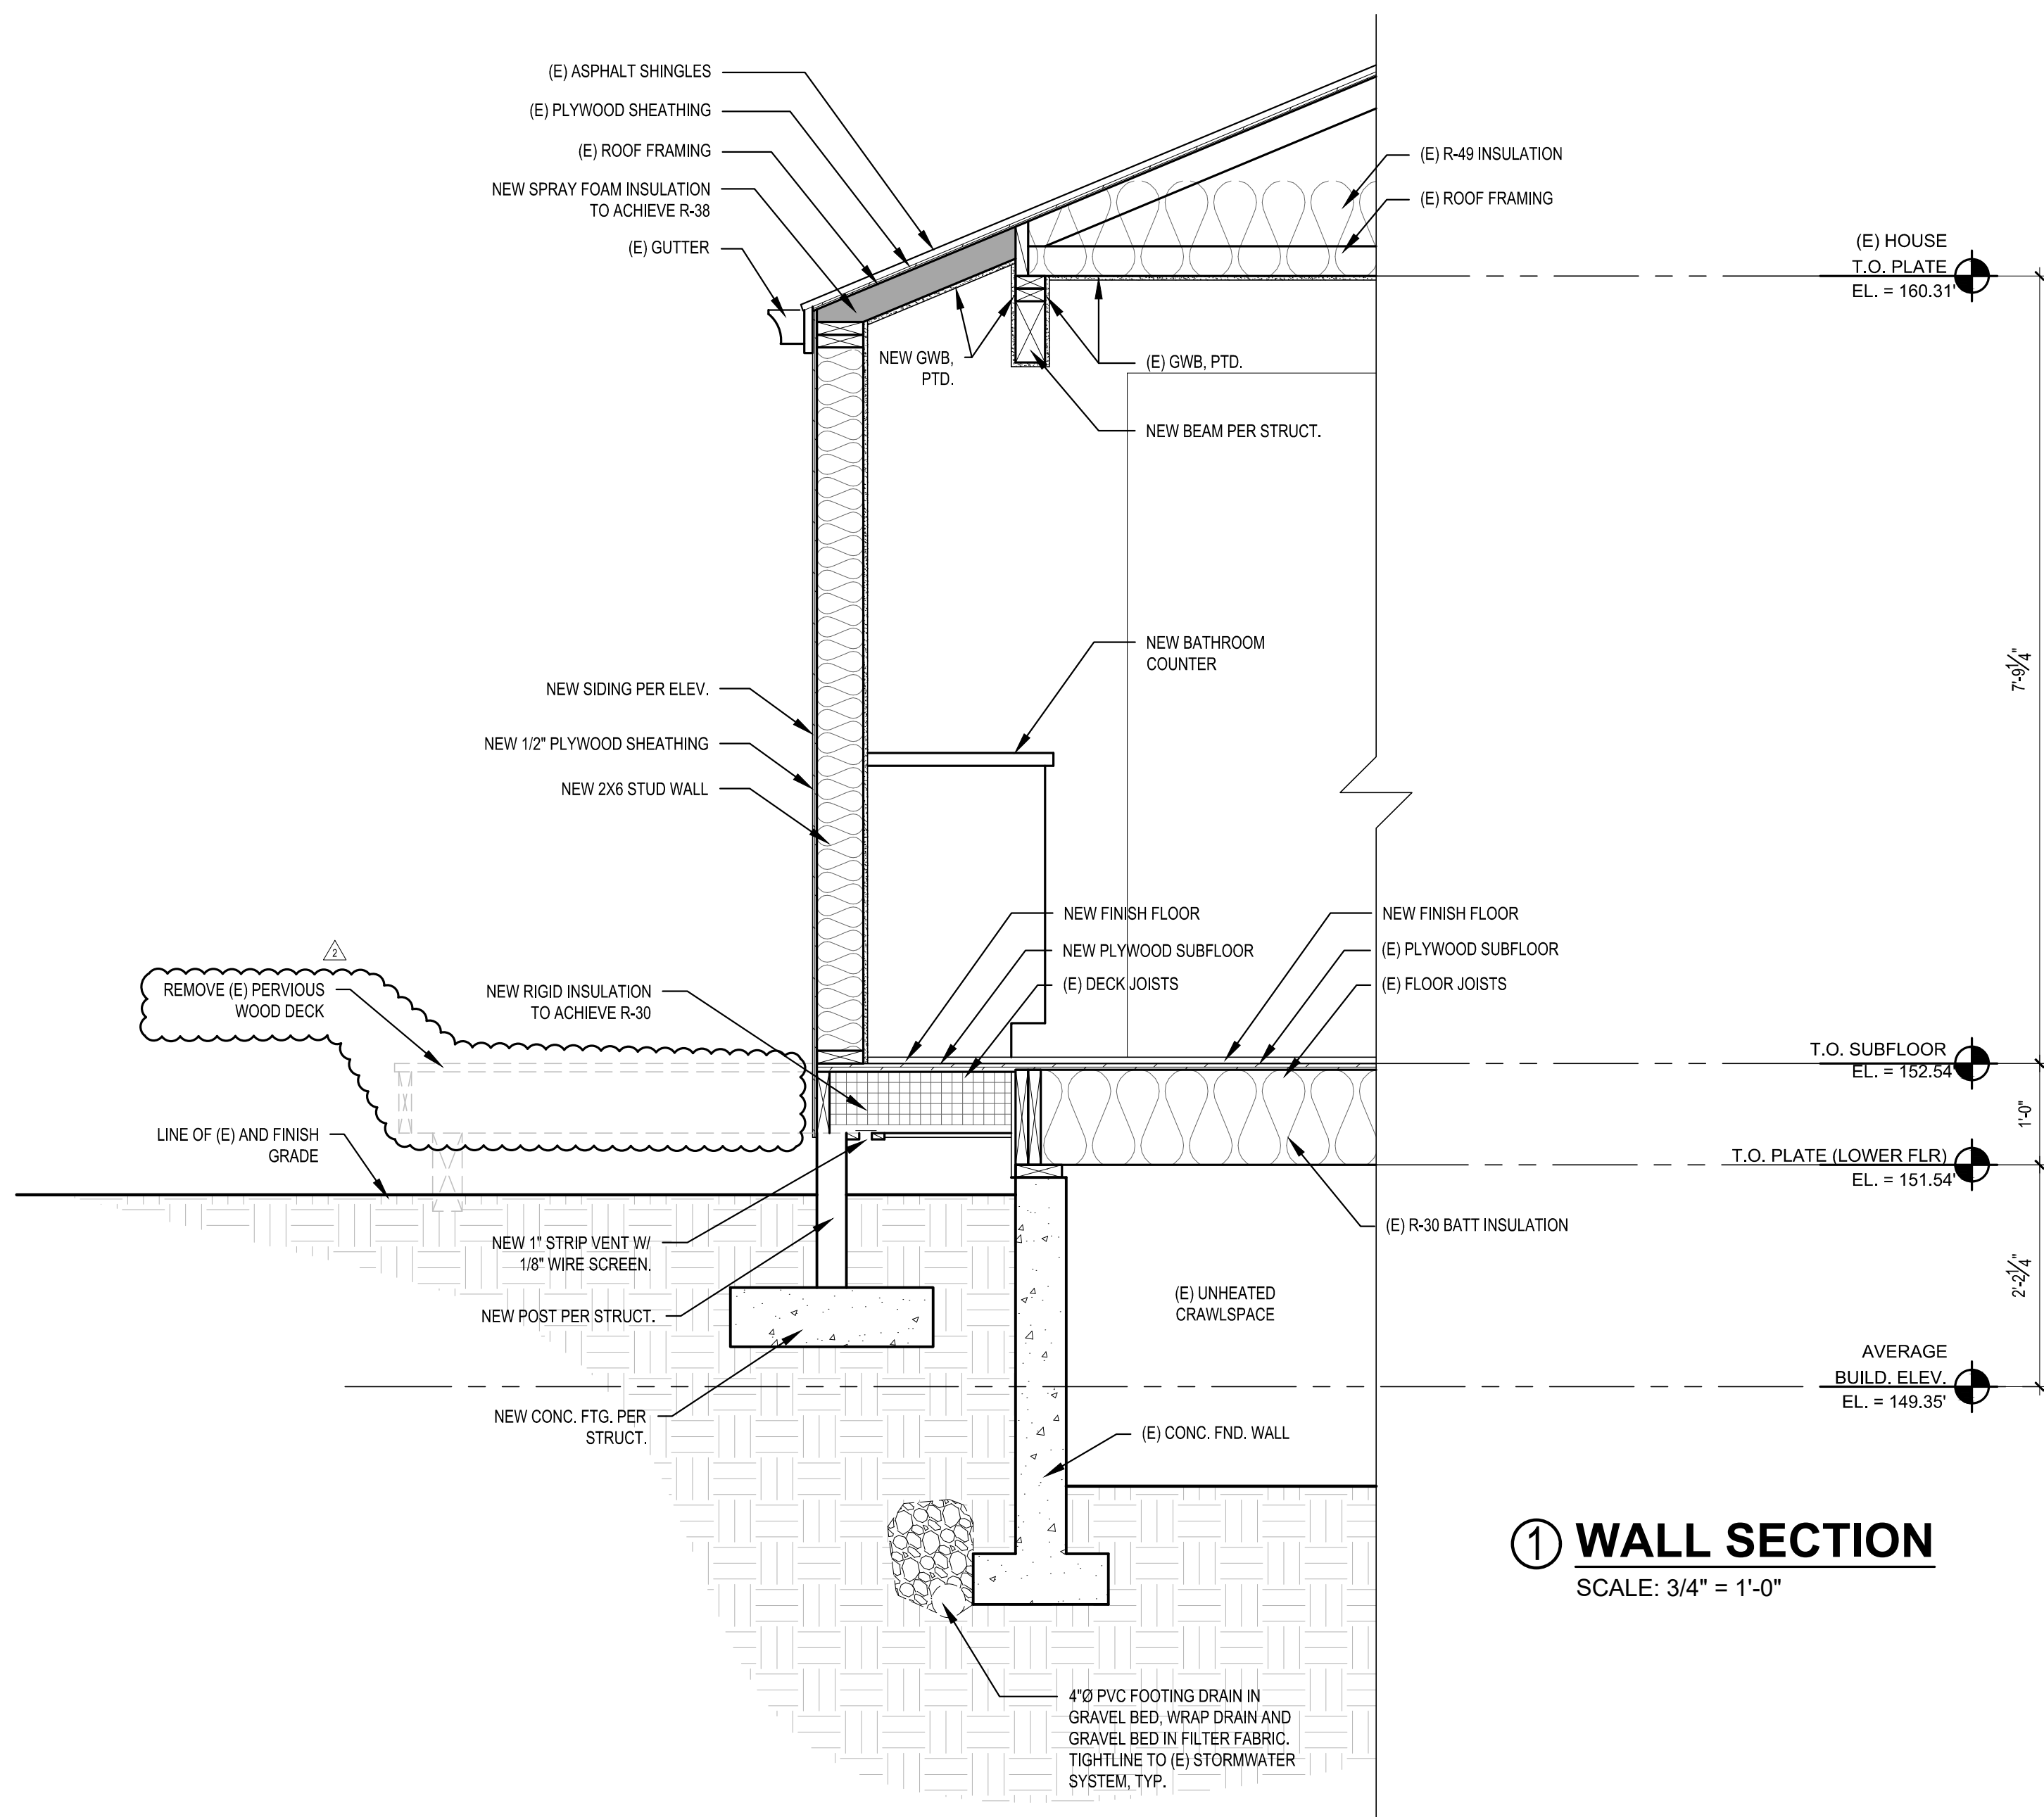


1 WALL SECTION
SCALE: 3/4" = 1'-0"

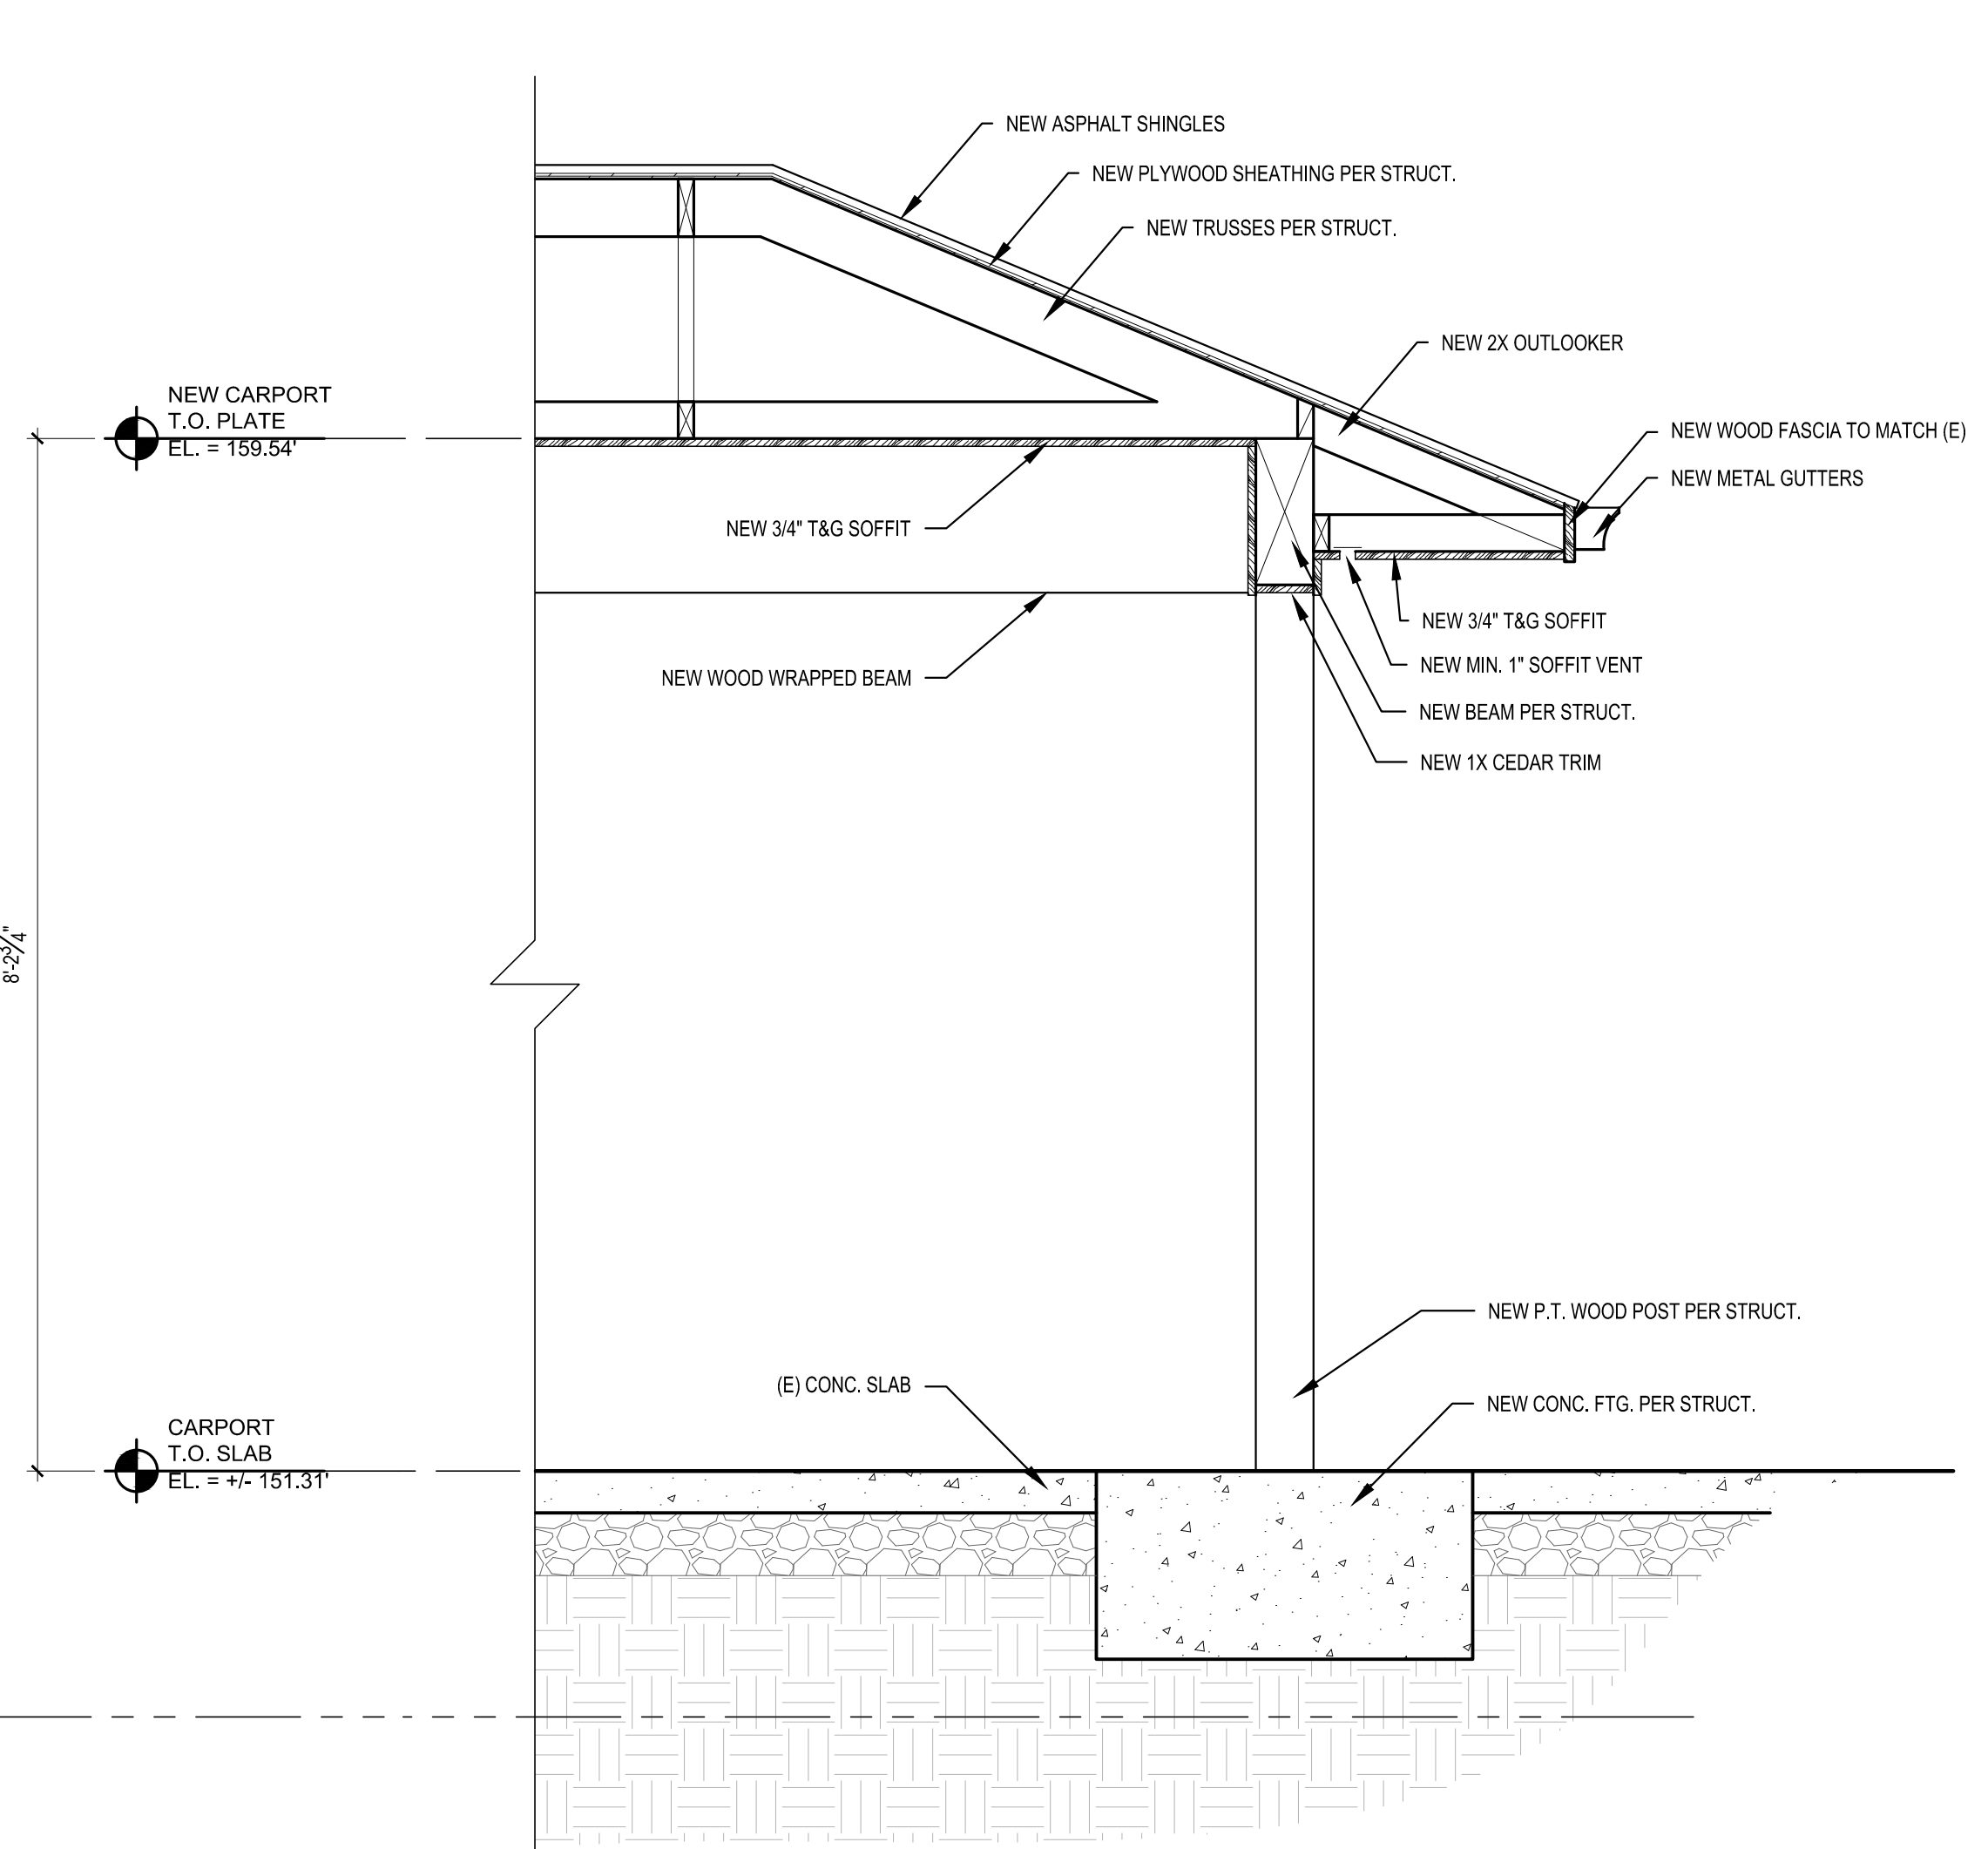


2 WALL SECTION
SCALE: 3/4" = 1'-0"

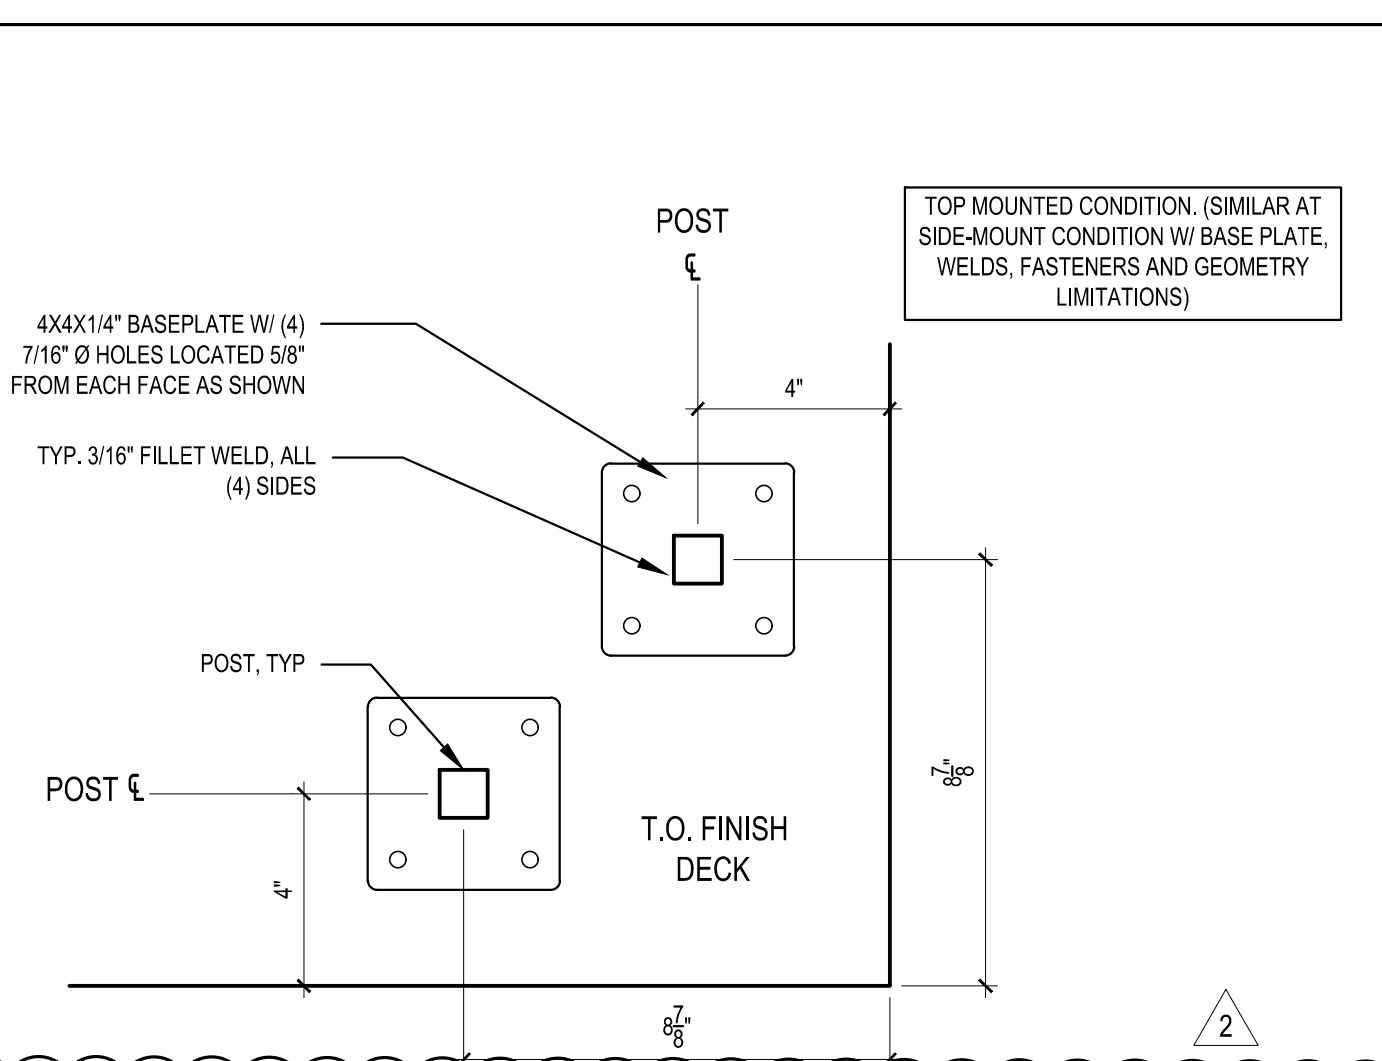


3 GUARDRAIL PLATE ATTACHMENT
SCALE: 3" = 1'-0"
SIM. AT SIDE-MOUNTED

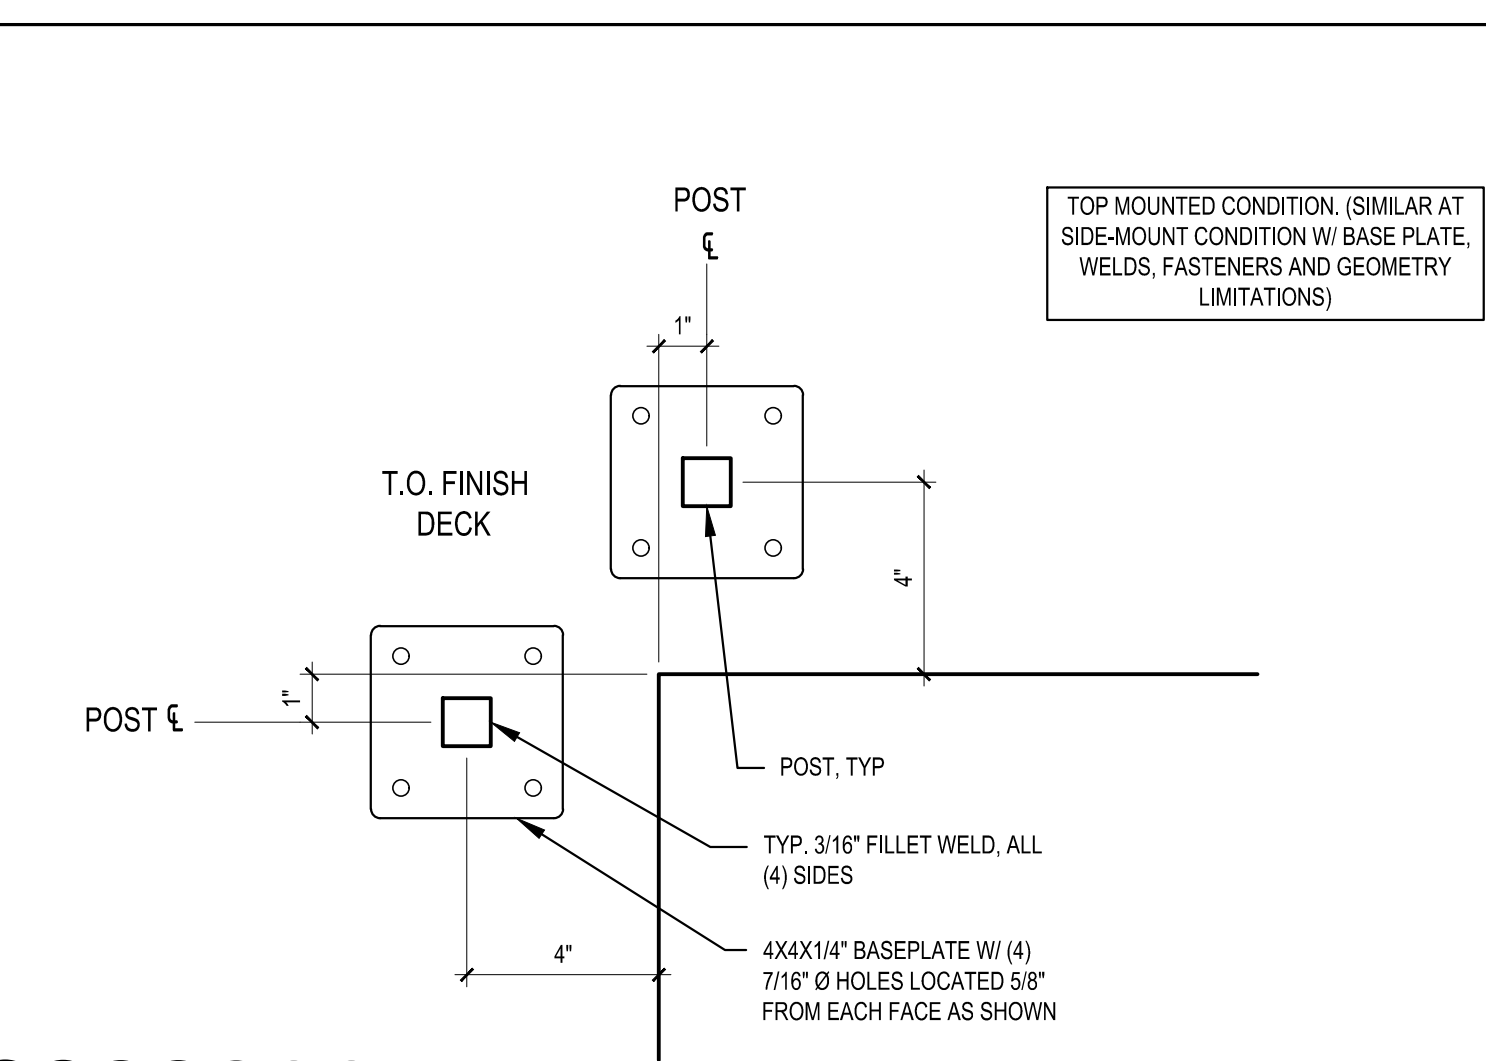

4 GUARDRAIL PLATE ATTACHMENT
SCALE: 3" = 1'-0"
SIM. AT SIDE-MOUNTED

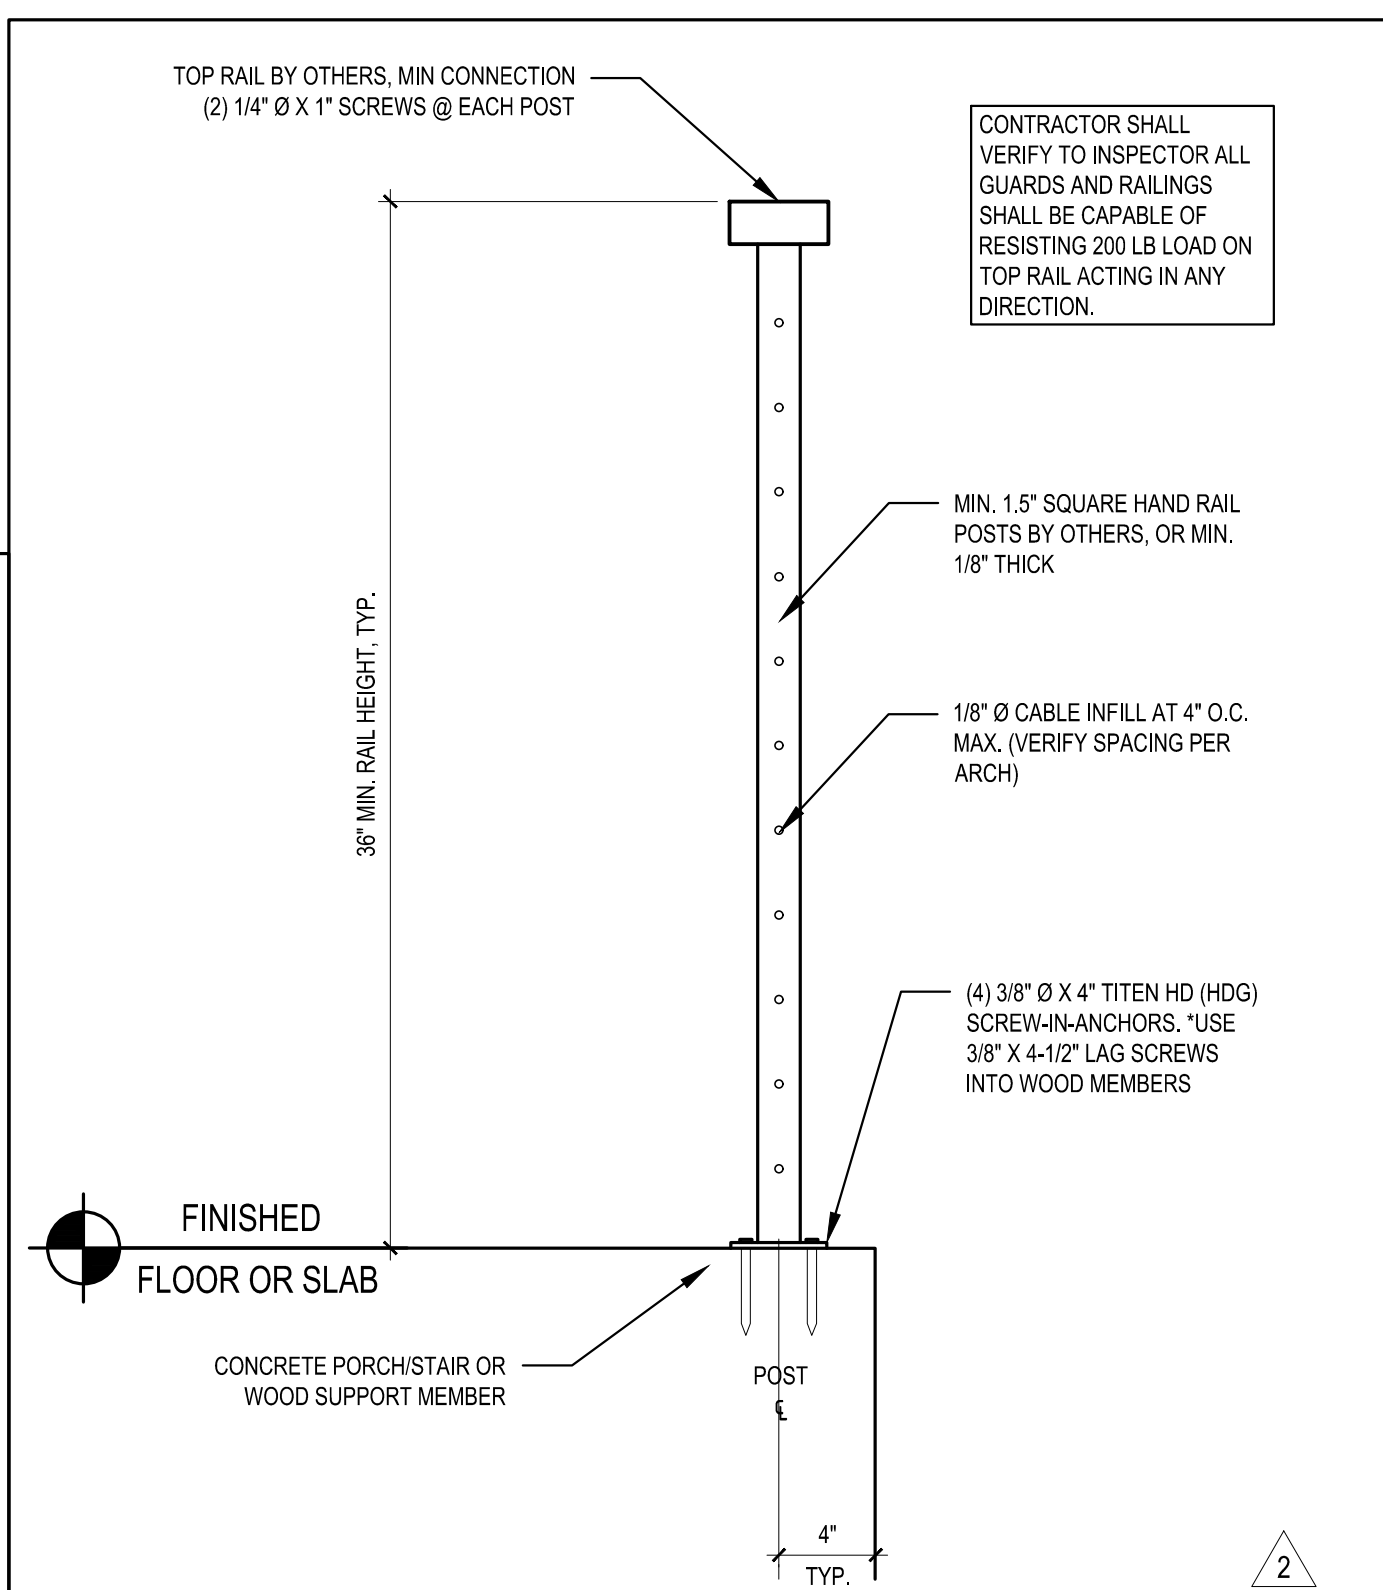

5 RAILING ATTACHMENT - TOP-MOUNTED
SCALE: 1-1/2" = 1'-0"

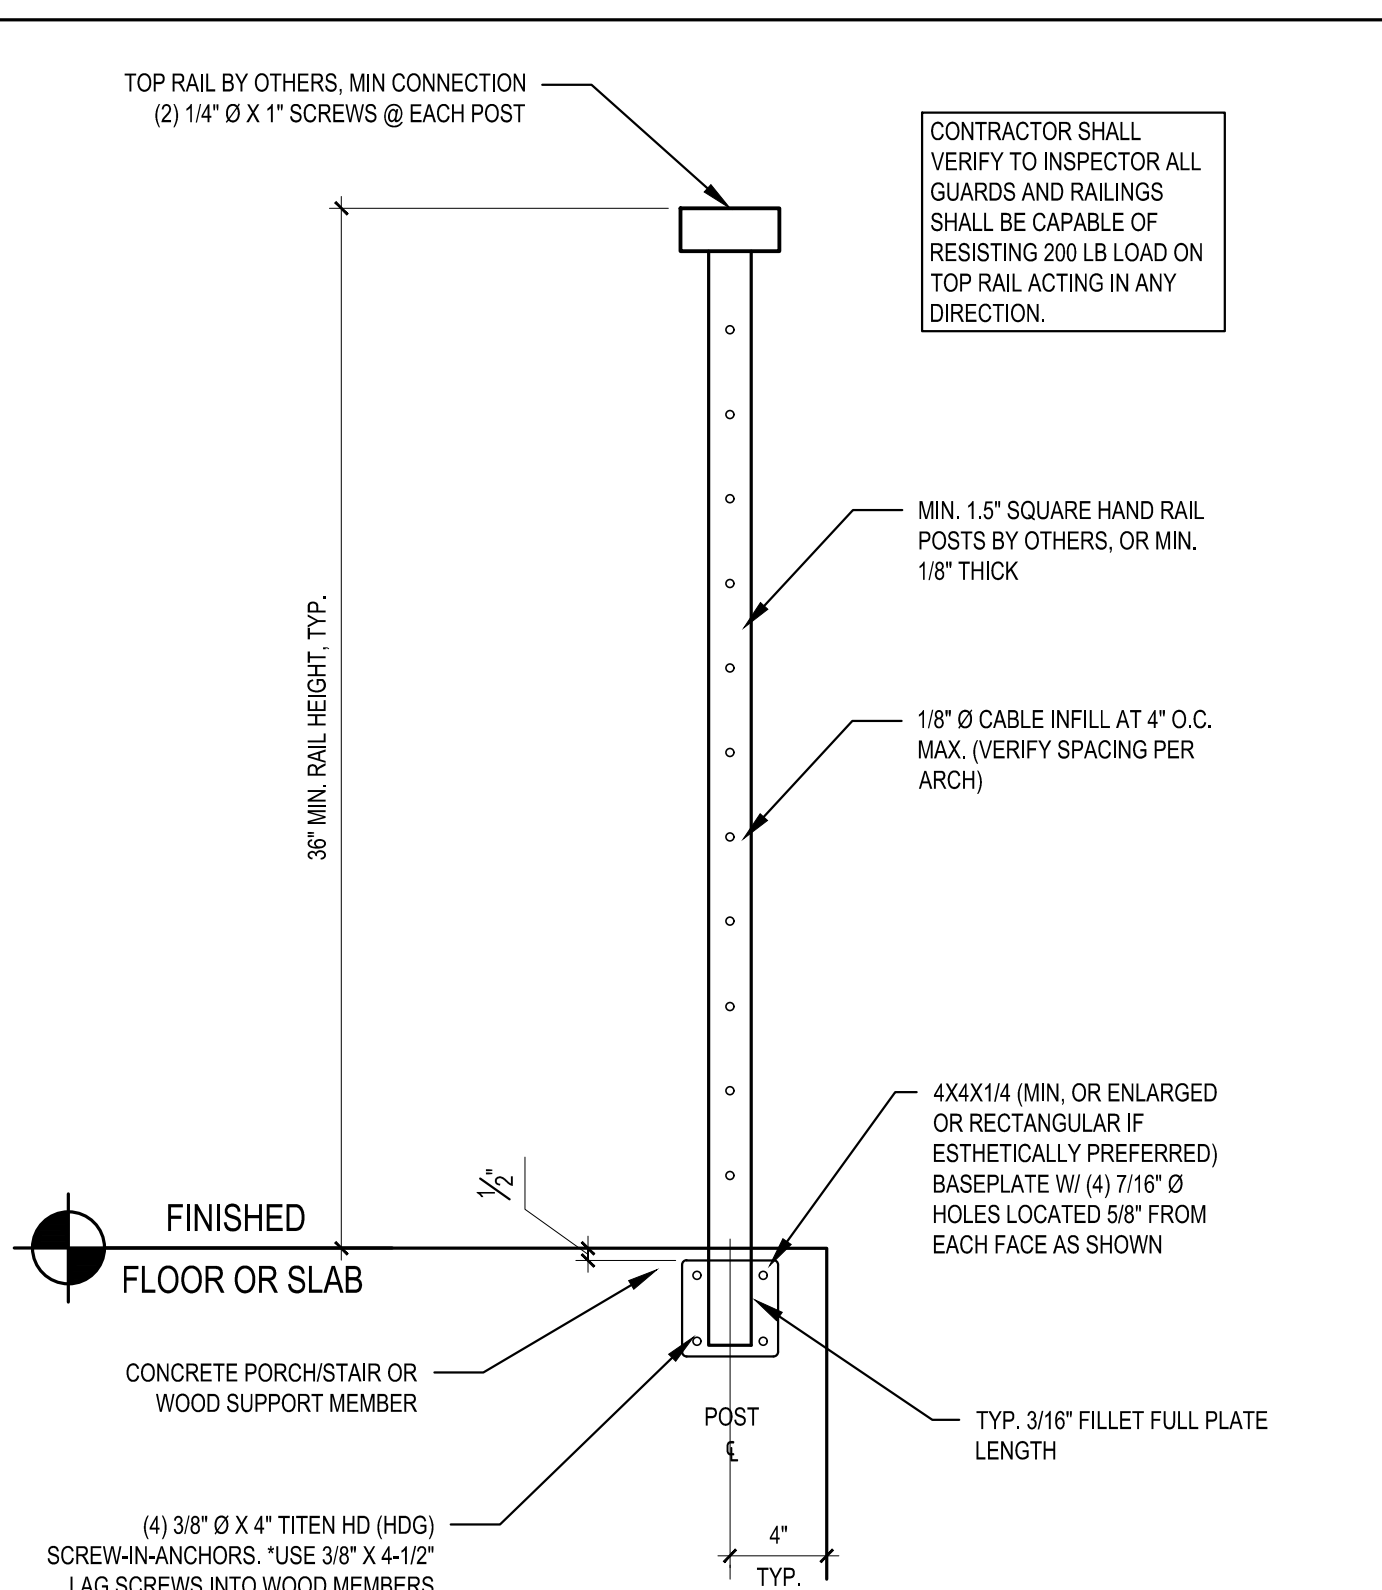

6 RAILING ATTACHMENT - SIDE-MOUNTED
SCALE: 1-1/2" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT. REDUCE SCALE ACCORDINGLY

PERMIT SET 08/21/19
PLOT DATE: 8/21/2019 FILE NAME:

General Structural Notes

THE FOLLOWING APPLY UNLESS SHOWN OTHERWISE ON THE DRAWINGS

CRITERIA

- ALL MATERIALS, WORKMANSHIP, DESIGN, AND CONSTRUCTION SHALL CONFORM TO THE DRAWINGS, SPECIFICATIONS, AND THE 2015 INTERNATIONAL BUILDING CODE.
- DESIGN LOADING CRITERIA:
RESIDENTIAL - ONE AND TWO-FAMILY DWELLINGS
FLOOR LIVE LOAD 40 PSF
ROOF
ROOF DEAD LOAD 15 PSF
ROOF LIVE LOAD 25 PSF
DECK LIVE LOAD 60 PSF
DEFLECTION CRITERIA
LIVE LOAD DEFLECTION L/360
TOTAL LOAD DEFLECTION L/240
ENVIRONMENTAL LOADS
SNOW 25 PSF
WIND . . . Kzt= 1.23, Cgpi=0.18, 110 MPH, RISK CATEGORY II, EXPOSURE "C"
EARTHQUAKE . ANALYSIS PROCEDURE: EQUIVALENT LATERAL FORCE PROCEDURE
LATERAL SYSTEM: LIGHT FRAMED SHEAR WALLS
SITE CLASS=D, Ss=141, Sds=.94, S1=.54, SD1=.54, Cs=0.144
SDC D, Ie=1.0, R=6.5
- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS FOR BIDDING AND CONSTRUCTION. ARCHITECTURAL DRAWINGS ARE THE PRIME CONTRACT DRAWINGS. ANY DISCREPANCIES FOUND AMONG THE DRAWINGS, THE SPECIFICATION, THESE GENERAL NOTES AND THE SITE CONDITIONS SHALL BE REPORTED TO THE ARCHITECT, WHO SHALL CORRECT SUCH DISCREPANCY IN WRITING. ANY WORK DONE BY THE GENERAL CONTRACTOR AFTER DISCOVERY OF SUCH DISCREPANCY SHALL BE DONE AT THE GENERAL CONTRACTOR'S RISK.
- PRIMARY STRUCTURAL ELEMENTS NOT DIMENSIONED ON THE STRUCTURAL PLANS AND DETAILS SHALL BE LOCATED BY THE ARCHITECTURAL PLANS AND DETAILS. VERTICAL DIMENSION CONTROL IS DEFINED BY THE ARCHITECTURAL WALL SECTIONS, BUILDING SECTION, AND PLANS. DETAILING AND SHOP DRAWING PRODUCTION FOR STRUCTURAL ELEMENTS WILL REQUIRE DIMENSIONAL INFORMATION CONTAINED IN BOTH ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SAFETY PRECAUTIONS AND THE METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES REQUIRED TO PERFORM THE CONTRACTORS WORK. THE STRUCTURAL ENGINEER HAS NO OVERALL SUPERVISORY AUTHORITY OR ACTUAL AND/OR DIRECT RESPONSIBILITY FOR THE SPECIFIC WORKING CONDITIONS AT THE SITE AND/OR FOR ANY HAZARDS RESULTING FROM THE ACTIONS OF ANY TRADE CONTRACTOR. THE STRUCTURAL ENGINEER HAS NO DUTY TO INSPECT, SUPERVISE, NOTE, CORRECT, OR REPORT ANY HEALTH OR SAFETY DEFICIENCIES TO THE OWNER, CONTRACTORS, OR OTHER ENTITIES OR PERSONS AT THE PROJECT SITE.
- CONTRACTOR SHALL PROVIDE TEMPORARY BRACING FOR THE STRUCTURE AND STRUCTURAL COMPONENTS UNTIL ALL FINAL CONNECTIONS HAVE BEEN COMPLETED IN ACCORDANCE WITH THE PLANS. CONFORM TO ASCE 37-14 "DESIGN LOADS ON STRUCTURES DURING CONSTRUCTION".
- DRAWINGS INDICATE GENERAL AND TYPICAL DETAILS OF CONSTRUCTION. WHERE CONDITIONS ARE NOT SPECIFICALLY INDICATED BUT ARE OF SIMILAR CHARACTER TO DETAILS SHOWN, SIMILAR DETAILS OF CONSTRUCTION SHALL BE USED, SUBJECT TO REVIEW AND APPROVAL BY THE ARCHITECT AND THE STRUCTURAL ENGINEER.
- ALL STRUCTURAL SYSTEMS, WHICH ARE TO BE COMPOSED OF COMPONENTS TO BE FIELD ERECTED, SHALL BE SUPERVISED BY THE SUPPLIER DURING MANUFACTURING, DELIVERY, HANDLING, STORAGE AND ERECTION IN ACCORDANCE WITH INSTRUCTIONS PREPARED BY THE SUPPLIER.
- SHOP DRAWINGS FOR THE FOLLOWING ITEMS SHALL BE SUBMITTED TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION OF THESE ITEMS.

CONNECTOR PLATE WOOD ROOF TRUSSES
- SHOP DRAWING REVIEW: DIMENSIONS AND QUANTITIES ARE NOT REVIEWED BY THE ENGINEER OF RECORD, THEREFORE MUST BE VERIFIED BY THE CONTRACTOR. CONTRACTOR SHALL REVIEW AND STAMP DRAWINGS PRIOR TO REVIEW BY ENGINEER OF RECORD. CONTRACTOR SHALL REVIEW DRAWINGS FOR CONFORMANCE WITH THE MEANS, METHODS, TECHNIQUES, SEQUENCES AND OPERATIONS OF CONSTRUCTION, AND ALL SAFETY PRECAUTIONS AND PROGRAMS INCIDENTAL THERETO. SUBMITTALS SHALL INCLUDE A REPRODUCIBLE AND ONE COPY; REPRODUCIBLE WILL BE MARKED AND RETURNED WITHIN TWO WEEKS OF RECEIPT WITH A NOTATION INDICATING THAT THE SUBMITTAL HAS BEEN FOUND TO BE IN GENERAL CONFORMANCE WITH THE DESIGN OF THE BUILDING. THE SUBMITTED ITEMS SHALL NOT BE INSTALLED UNTIL THEY HAVE BEEN APPROVED BY THE BUILDING OFFICIAL.

GEOTECHNICAL

- FOUNDATION NOTES: ALLOWABLE SOIL PRESSURE AND LATERAL EARTH PRESSURE ARE ASSUMED AND THEREFORE MUST BE VERIFIED BY A QUALIFIED SOILS ENGINEER OR APPROVED BY THE BUILDING OFFICIAL. IF SOILS ARE FOUND TO BE OTHER THAN ASSUMED, NOTIFY THE STRUCTURAL ENGINEER FOR POSSIBLE FOUNDATION REDESIGN.

FOOTINGS SHALL BEAR ON FIRM, UNDISTURBED EARTH AT LEAST 18" BELOW ADJACENT FINISHED GRADE. UNLESS OTHERWISE NOTED, FOOTINGS SHALL BE CENTERED BELOW COLUMNS OR WALLS ABOVE.

ALLOWABLE SOIL PRESSURE. 1500 PSF

RENOVATION

- DEMOLITION: CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS BEFORE COMMENCING ANY DEMOLITION. SHORING SHALL BE INSTALLED TO SUPPORT EXISTING CONSTRUCTION AS REQUIRED AND IN A MANNER SUITABLE TO THE WORK SEQUENCES. DEMOLITION DEBRIS SHALL NOT BE ALLOWED TO DAMAGE OR OVERLOAD THE EXISTING STRUCTURE. LIMIT CONSTRUCTION LOADING (INCLUDING DEMOLITION DEBRIS) ON EXISTING FLOOR SYSTEMS TO 40 PSF.
- CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS, MEMBER SIZES, AND CONDITIONS PRIOR TO COMMENCING ANY WORK. ALL DIMENSIONS OF EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS ARE INTENDED AS GUIDELINES ONLY AND MUST BE VERIFIED. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT AND STRUCTURAL ENGINEER IF EXISTING CONDITIONS DETERMINED DURING WORK VARY FROM THE EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS.

CONCRETE

- CONCRETE SHALL BE MIXED, PORTIONED, CONVEYED AND PLACED IN ACCORDANCE WITH ACI 301, INCLUDING TESTING PROCEDURES. CONCRETE SHALL ATTAIN A 28-DAY STRENGTH OF $f'c = 3,000$ PSI AND MIX SHALL CONTAIN NOT LESS THAN 5-1/2 SACKS OF CEMENT PER CUBIC YARD AND SHALL BE PROPORTIONED TO PRODUCE A SLUMP OF 5" OR LESS. REQUIRED CONCRETE STRENGTH IS BASED ON THE DURABILITY REQUIREMENTS OF SECTION 1904 OF THE IBC. DESIGN STRENGTH $f'c = 2,500$ PSI.
- REINFORCING STEEL SHALL CONFORM TO ASTM A615 GRADE 60, Fy=60,000 PSI.
- CONCRETE PROTECTION (COVER) FOR REINFORCING STEEL SHALL BE AS FOLLOWS:

UNFORMED SURFACES CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3"
FORMED SURFACES EXPOSED TO EARTH OR WEATHER (#5 BARS OR SMALLER) . . 1-1/2"

WOOD

- FRAMING LUMBER SHALL BE S-DRY, KD, OR MC-19, AND GRADED AND MARKED IN CONFORMANCE WITH WCLIB STANDARD, GRADING RULES FOR WEST COAST LUMBER NO. 17, OR WMPA STANDARD, WESTERN LUMBER GRADING RULES 2011. FURNISH TO THE FOLLOWING MINIMUM STANDARDS:

JOISTS (2X & 3X MEMBERS) HEM-FIR NO. 2
MINIMUM BASE VALUE, Fb = 850 PSI
AND BEAMS (4X MEMBERS) DOUGLAS FIR-LARCH NO. 1
MINIMUM BASE VALUE, Fb = 1000 PSI
BEAMS (INCL. 6X AND LARGER) DOUGLAS FIR-LARCH NO. 1
MINIMUM BASE VALUE, Fb = 1350 PSI
POSTS (4X MEMBERS) DOUGLAS FIR-LARCH NO. 2
MINIMUM BASE VALUE, Fc = 1350 PSI
DOUGLAS FIR-LARCH NO. 1
MINIMUM BASE VALUE, Fc = 1000 PSI

STUDS, PLATES & MISC. FRAMING: DOUGLAS-FIR-LARCH OR HEM-FIR NO. 2
- GLUED LAMINATED MEMBERS SHALL BE FABRICATED IN CONFORMANCE WITH ASTM AND ANSI/AITC STANDARDS. EACH MEMBER SHALL BEAR AN AITC OR APA-EWS IDENTIFICATION MARK AND SHALL BE ACCOMPANIED BY AN AITC OR APA-EWS CERTIFICATE OF CONFORMANCE. ALL BEAMS SHALL BE DOUGLAS FIR COMBINATION 24F-V4, Fb = 2,400 PSI, Fv =265 PSI.
- PREFABRICATED CONNECTOR PLATE WOOD ROOF TRUSSES SHALL BE DESIGNED BY THE MANUFACTURER IN ACCORDANCE WITH THE "NATIONAL DESIGN STANDARD FOR METAL PLATE-CONNECTED WOOD TRUSS CONSTRUCTION, ANSI/TPI 1" BY THE TRUSS PLATE INSTITUTE FOR THE SPANS AND CONDITIONS SHOWN ON THE PLANS. LOADING SHALL BE AS FOLLOWS:

TOP CHORD LIVE LOAD 25 PSF
TOP CHORD DEAD LOAD 10 PSF
BOTTOM CHORD DEAD LOAD 5 PSF
TOTAL LOAD 40 PSF

WIND UPLIFT (TOP CHORD) 10 PSF
BOTTOM CHORD LIVE LOAD 10 PSF
(BOTTOM CHORD LIVE LOAD DOES NOT ACT CONCURRENTLY WITH THE ROOF LIVE LOAD)

WOOD TRUSSES SHALL UTILIZE APPROVED CONNECTOR PLATES (GANGNAIL OR EQUAL). SUBMIT SHOP DRAWINGS AND DESIGN CALCULATIONS TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION. SUBMITTED DOCUMENTS SHALL BE SIGNED AND STAMPED BY A STRUCTURAL ENGINEER REGISTERED IN THE STATE OF WASHINGTON. PROVIDE FOR SHAPES, BEARING POINTS, INTERSECTIONS, HIPS, VALLEYS, ETC., SHOWN ON THE DRAWINGS. EXACT COMPOSITION OF SPECIAL HIP, VALLEY, AND INTERSECTION AREAS (USE OF GIRDER TRUSSES, JACK TRUSSES, STEP-DOWN TRUSSES, ETC.) SHALL BE DETERMINED BY THE MANUFACTURER UNLESS SPECIFICALLY INDICATED ON THE PLANS. PROVIDE ALL TRUSS TO TRUSS AND TRUSS TO GIRDER TRUSS CONNECTION DETAILS AND REQUIRED CONNECTION MATERIALS. PROVIDE FOR ALL TEMPORARY AND PERMANENT TRUSS BRACING AND BRIDGING.
--

WOOD TRUSSES SHALL UTILIZE APPROVED CONNECTOR PLATES (GANGNAIL OR EQUAL). SUBMIT SHOP DRAWINGS AND DESIGN CALCULATIONS TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION. SUBMITTED DOCUMENTS SHALL BE SIGNED AND STAMPED BY A STRUCTURAL ENGINEER REGISTERED IN THE STATE OF WASHINGTON. PROVIDE FOR SHAPES, BEARING POINTS, INTERSECTIONS, HIPS, VALLEYS, ETC., SHOWN ON THE DRAWINGS. EXACT COMPOSITION OF SPECIAL HIP, VALLEY, AND INTERSECTION AREAS (USE OF GIRDER TRUSSES, JACK TRUSSES, STEP-DOWN TRUSSES, ETC.) SHALL BE DETERMINED BY THE MANUFACTURER UNLESS SPECIFICALLY INDICATED ON THE PLANS. PROVIDE ALL TRUSS TO TRUSS AND TRUSS TO GIRDER TRUSS CONNECTION DETAILS AND REQUIRED CONNECTION MATERIALS. PROVIDE FOR ALL TEMPORARY AND PERMANENT TRUSS BRACING AND BRIDGING.

- PLYWOOD SHEATHING SHALL BE GRADE C-D, EXTERIOR GLUE OR STRUCTURAL II, EXTERIOR GLUE IN CONFORMANCE WITH DOC PS 1 OR PS 2. ORIENTED STRAND BOARD OF EQUIVALENT THICKNESS, EXPOSURE RATING AND PANEL INDEX MAY BE USED IN LIEU OF PLYWOOD.

ROOF SHEATHING SHALL BE 1/2" (NOMINAL) WITH SPAN RATING 32/16.
FLOOR SHEATHING SHALL BE 3/4" (NOMINAL) WITH SPAN RATING 48/24.
WALL SHEATHING SHALL BE 1/2" (NOMINAL) WITH SPAN RATING 24/0.

- ALL WOOD IN DIRECT CONTACT WITH CONCRETE SHALL BE PRESSURE-TREATED WITH AN APPROVED PRESERVATIVE.
- PRESERVATIVE TREATED WOOD SHALL BE TREATED PER AWPA STANDARD U1 TO THE USE CATEGORY EQUAL TO OR HIGHER THAN THE INTENDED APPLICATION. TREATED WOOD FOR ABOVE GROUND USE SHALL BE TREATED TO AWPA UC3B. WOOD IN CONTINUOUS CONTACT WITH FRESH WATER OR SOIL SHALL BE TREATED TO AWPA UC4A. WOOD FOR USE IN PERMANENT FOUNDATIONS SHALL BE TREATED TO AWPA UC4B.
- FASTENERS AND TIMBER CONNECTORS USED WITH TREATED WOOD SHALL HAVE CORROSION RESISTANCE AS INDICATED IN THE FOLLOWING TABLE, UNLESS OTHERWISE NOTED.

WOOD TREATMENT	CONDITION	PROTECTION
HAS NO AMMONIA CARRIER	INTERIOR DRY	G90 GALVANIZED
CONTAINS AMMONIA CARRIER	INTERIOR DRY	G185 OR A185 HOT DIPPED OR CONTINUOUS HOT-GALVANIZED PER ASTM A653
CONTAINS AMMONIA CARRIER	INTERIOR WET	TYPE 304 OR 316 STAINLESS
CONTAINS AMMONIA CARRIER	EXTERIOR	TYPE 304 OR 316 STAINLESS
AZCA	ANY	TYPE 304 OR 316 STAINLESS

INTERIOR DRY CONDITIONS SHALL HAVE WOOD MOISTURE CONTENT LESS THAN 19%. WOOD MOISTURE CONTENT IN OTHER CONDITIONS (INTERIOR WET, EXTERIOR WET, AND EXTERIOR DRY) IS EXPECTED TO EXCEED 19%. CONNECTORS AND THEIR FASTENERS SHALL BE THE SAME MATERIAL. COMPLY WITH THE TREATMENT MANUFACTURERS RECOMMENDATIONS FOR PROTECTION OF METAL.

- TIMBER CONNECTORS CALLED OUT BY LETTERS AND NUMBERS SHALL BE "STRONG-TIE" BY SIMPSON COMPANY, AS SPECIFIED IN THEIR CATALOG NUMBER C-C-2019. CONNECTORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

ALL 2X JOISTS SHALL BE CONNECTED TO FLUSH BEAMS WITH "LUS" SERIES JOIST HANGERS. ALL SHIMS SHALL BE SEASONED AND DRIED AND THE SAME GRADE (MINIMUM)AS MEMBERS CONNECTED.

WOOD FASTENERS

- ALL NAIL SIZES SPECIFIED ON DRAWINGS ARE BASED ON THE FOLLOWING SPECIFICATIONS:


SIZE	LENGTH	DIAMETER
8d	2-1/2"	0.131"
16d	3-1/4"	0.131"

- ALL BOLTS IN WOOD MEMBERS SHALL CONFORM TO ASTM A307. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG BOLTS BEARING ON WOOD. INSTALLATION OF LAG BOLTS SHALL CONFORM TO THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION WITH A LEAD BORE HOLE OF 60 TO 70 PERCENT OF THE SHANK DIAMETER. LEAD HOLES ARE NOT REQUIRED FOR 3/8" AND SMALLER LAG SCREWS.

26. WOOD FRAMING NOTES--THE FOLLOWING APPLY UNLESS OTHERWISE SHOWN ON THE PLANS:

- ALL WOOD FRAMING DETAILS NOT SHOWN OTHERWISE SHALL BE CONSTRUCTED TO THE MINIMUM STANDARDS OF THE INTERNATIONAL BUILDING CODE, THE AITC "TIMBER CONSTRUCTION MANUAL" AND THE AF&PA "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION". MINIMUM NAILING, UNLESS OTHERWISE NOTED, SHALL CONFORM TO IBC TABLE 2304.10.1. COORDINATE THE SIZE AND LOCATION OF ALL OPENINGS WITH MECHANICAL AND ARCHITECTURAL DRAWINGS.
- ROOF FRAMING: PROVIDE SOLID BLOCKING AT ALL BEARING POINTS. TOE-NAIL JOISTS TO SUPPORTS WITH TWO 16d NAILS. ATTACH TIMBER JOISTS TO FLUSH HEADERS OR BEAMS WITH SIMPSON METAL JOIST HANGERS IN ACCORDANCE WITH NOTES ABOVE. NAIL ALL MULTI JOIST BEAMS TOGETHER WITH TWO ROWS 16d @ 12" ON-CENTER.

UNLESS OTHERWISE NOTED ON THE PLANS, PLYWOOD ROOF SHEATHING SHALL BE LAID UP WITH GRAIN PERPENDICULAR TO SUPPORTS AND NAILED AT 6" ON-CENTER WITH 8d NAILS TO FRAMED PANEL EDGES, AND @ 12" ON-CENTER TO INTERMEDIATE SUPPORTS. PROVIDE APPROVED PLYWOOD EDGE CLIPS CENTERED BETWEEN JOISTS/TRUSSES AT UNBLOCKED ROOF SHEATHING EDGES.

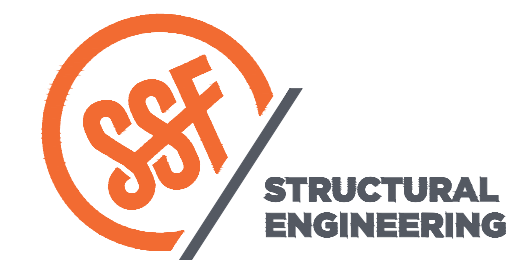

2124 Third Avenue - Suite 100 - Seattle, WA 98121
P: 206.443.6212
ssfengineers.com

934 Broadway - Tacoma, WA 98402
P: 253.284.9470
ssfengineers.com

Copyright 2019 Swenson Say Fagitt - All Rights Reserved



08/20/19

DRAWN:	RJ
DESIGN:	ABB
CHECKED:	ABB
APPROVED:	ABB

REVISIONS:	

JURISDICTIONAL APPROVAL STAMP:

PROJECT TITLE:
Marshall Residence
4307 East Mercer Way
Mercer Island, WA 98040

Phase 1B

ARCHITECT:
Sturman Architects
9 103rd Ave NE Suite 203
Bellevue, WA 98004

ISSUE:
Permit Set

SHEET TITLE:
General Structural Notes

SCALE:
-

DATE:
Aug. 20, 2019

PROJECT NO:
01310-2019-02

SHEET NO:

S1.1



08/20/19

DRAWN:	RJ
DESIGN:	ABB
CHECKED:	ABB
APPROVED:	ABB

REVISIONS:

JURISDICTIONAL APPROVAL STAMP:

PROJECT TITLE:
Marshall Residence
4307 East Mercer Way
Mercer Island, WA 98040

Phase 1B


ARCHITECT:
Sturman Architects
9 103rd Ave NE Suite 203
Bellevue, WA 98004

ISSUE:
Permit Set

SHEET TITLE:
Main Floor Framing / Foundation Plan


SCALE: 1/4" = 1'-0" U.N.O.
DATE: Aug. 20, 2019
PROJECT NO: 01310-2019-02
SHEET NO:

S2.1

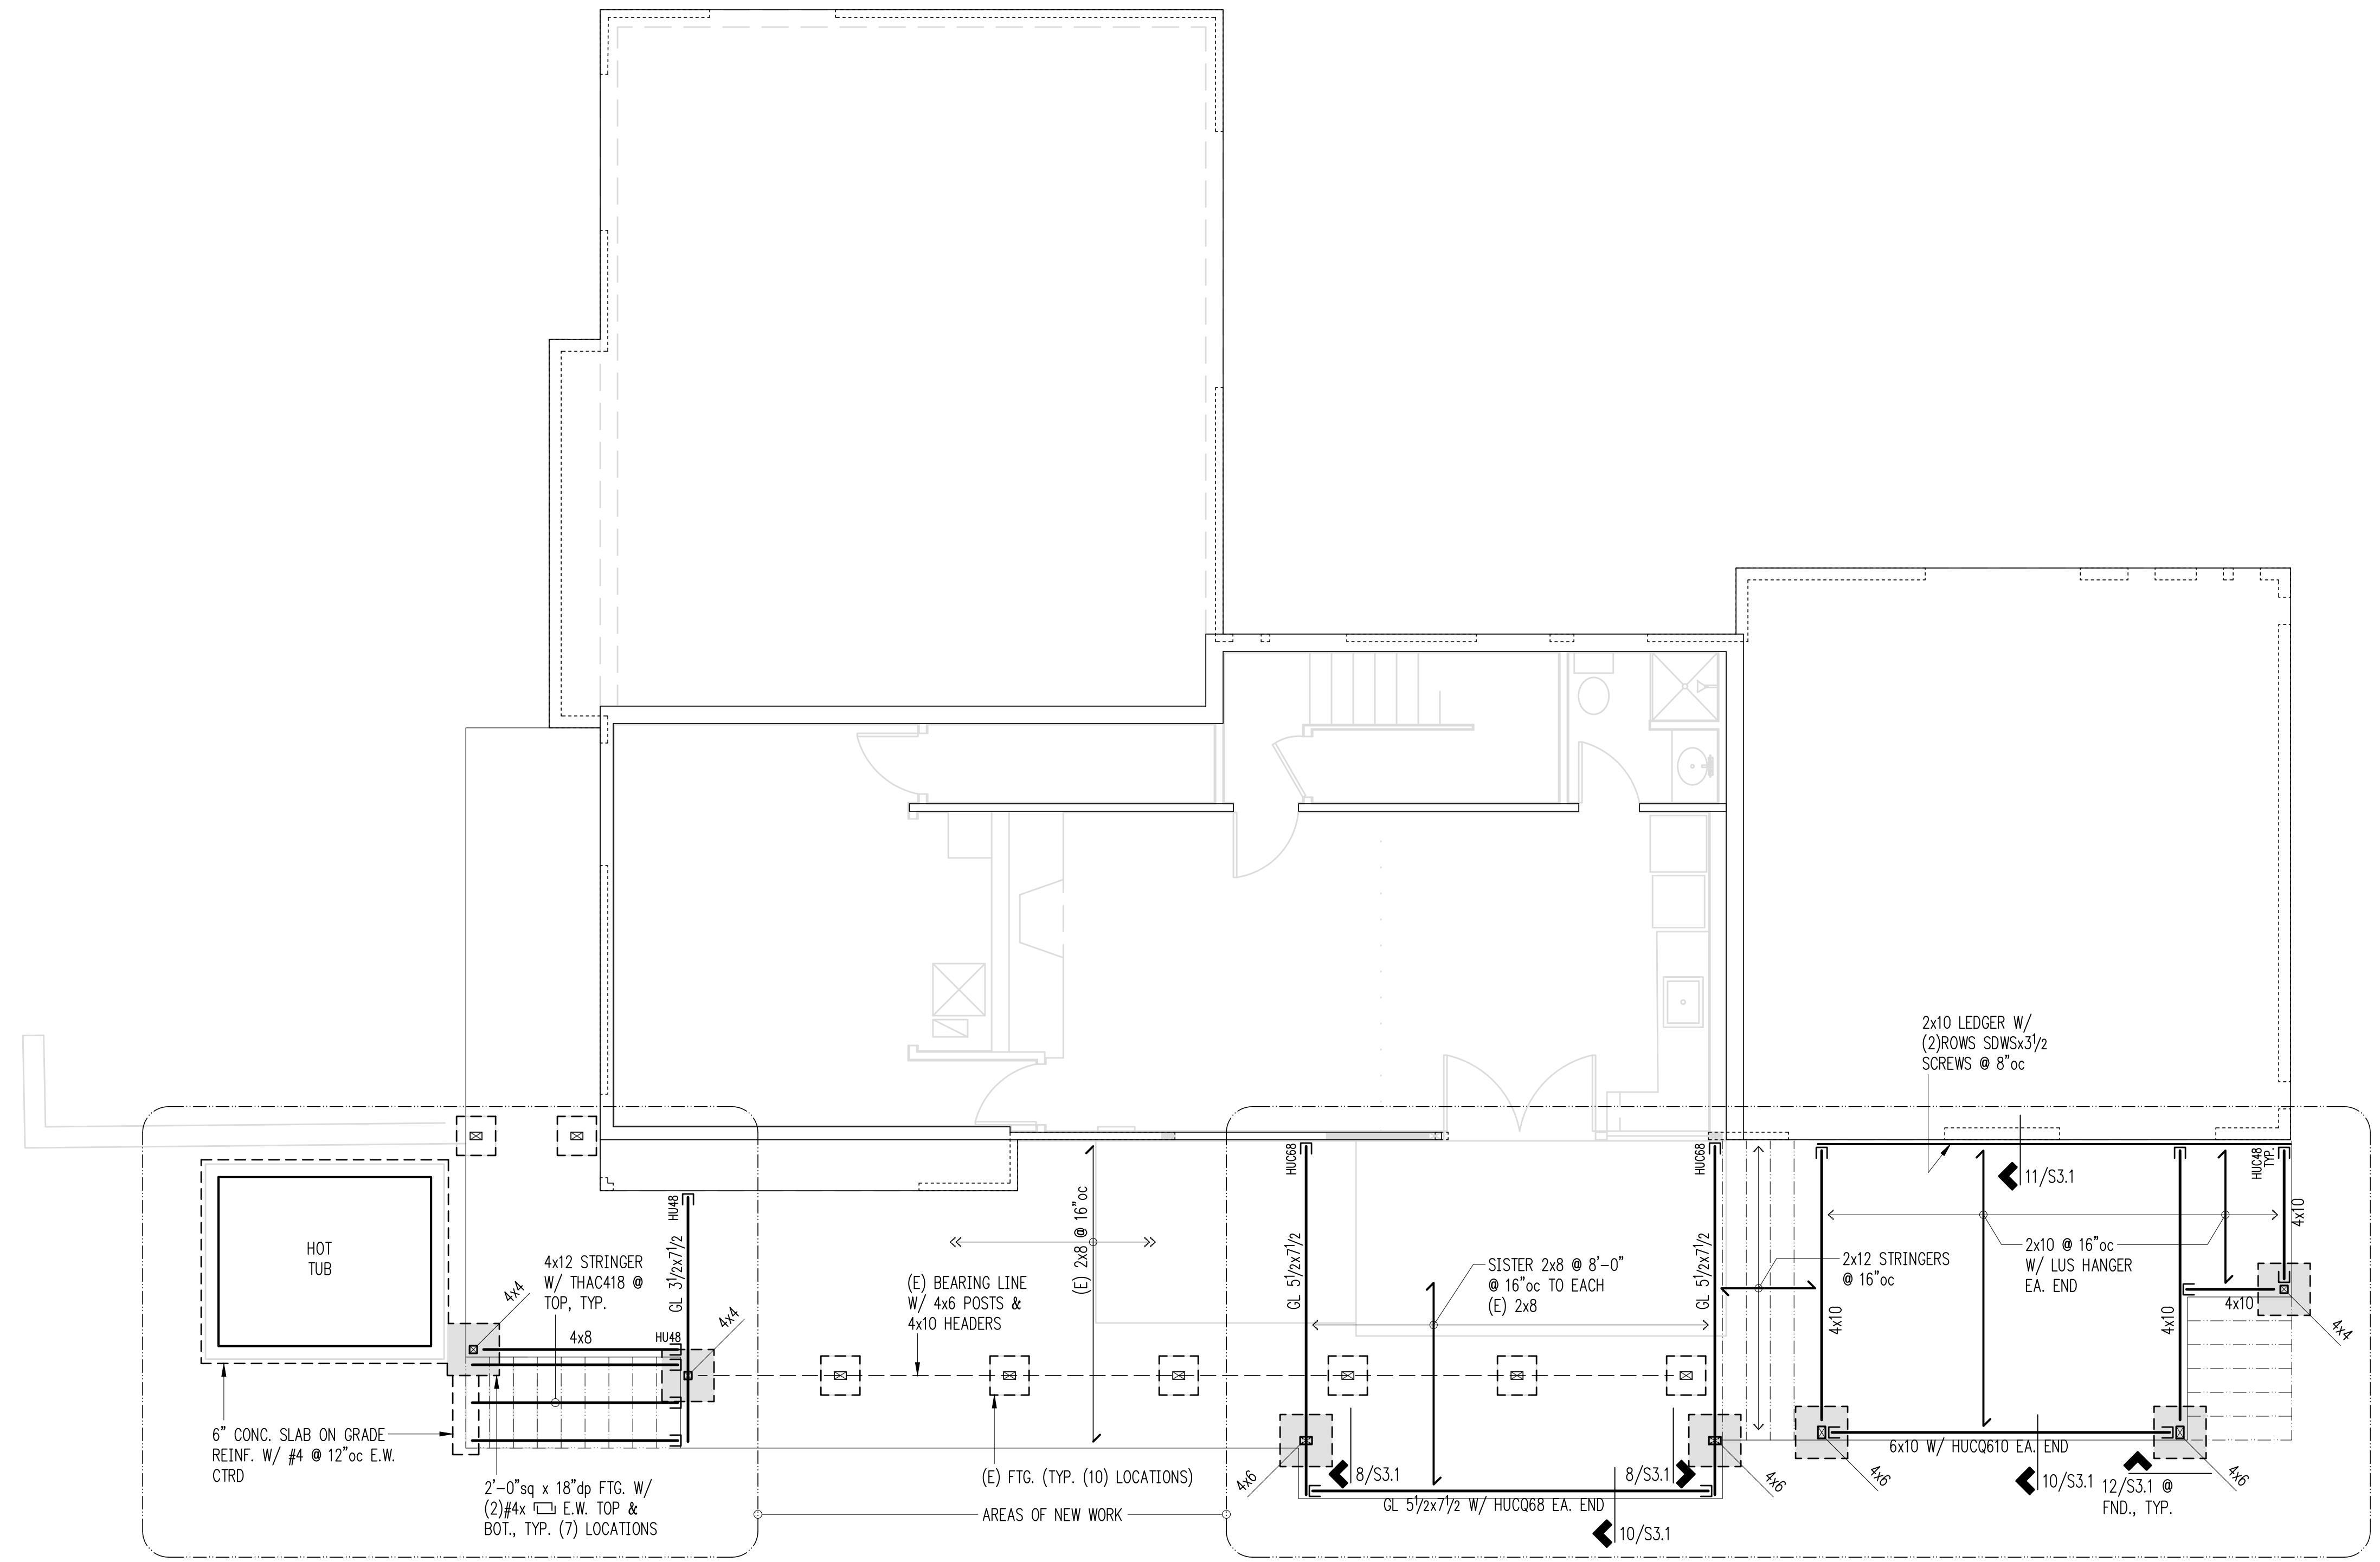

Main Floor Framing / Foundation Plan

Scale: 1/4" = 1'-0"





DRAWN: RJ
 DESIGN: ABB
 CHECKED: ABB
 APPROVED: ABB

REVISIONS:

JURISDICTIONAL APPROVAL STAMP:

PROJECT TITLE:

Marshall Residence
 4307 East Mercer Way
 Mercer Island, WA 98040

Phase 1B

ARCHITECT:

Sturman Architects
 9 103rd Ave NE Suite 203
 Bellevue, WA 98004

ISSUE:

Permit Set

SHEET TITLE:

Roof Farming Plan


SCALE: 1/4" = 1'-0" U.N.O.

DATE: Aug. 20, 2019


PROJECT NO: 01310-2019-02

SHEET NO:

S2.2

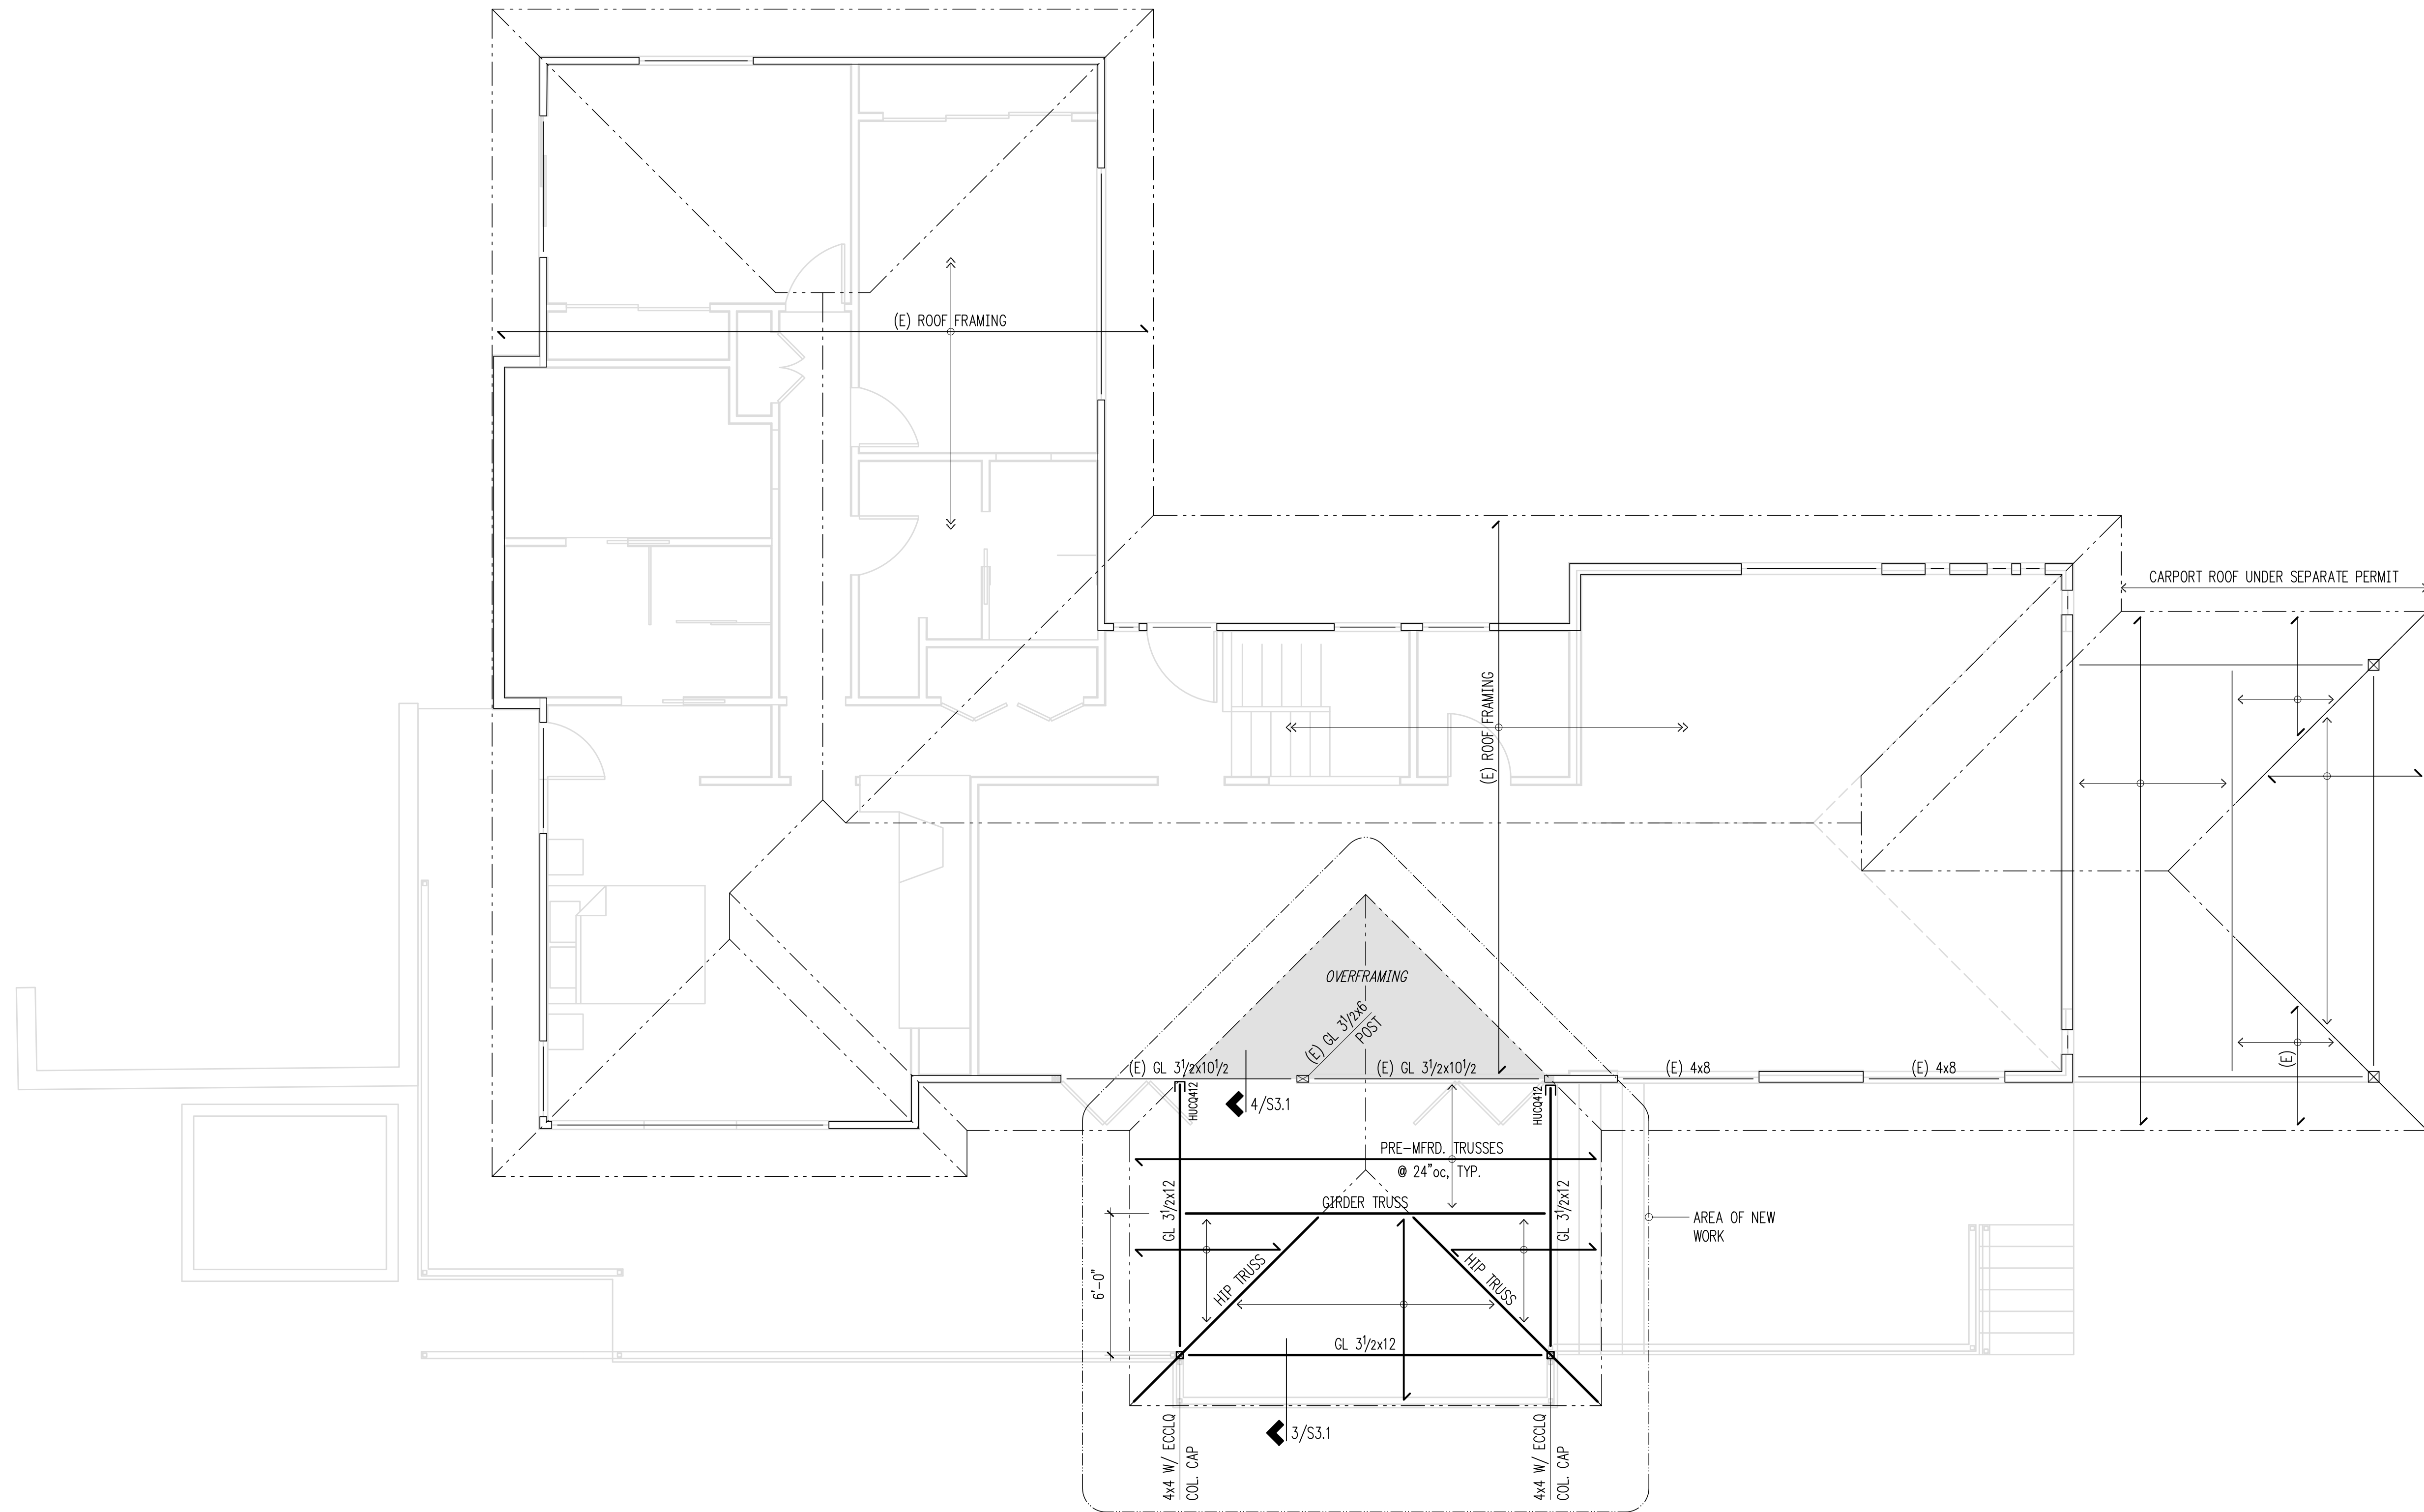

Roof Framing Plan
 Scale: 1/4" = 1'-0"





DRAWN: RJ
 DESIGN: ABB
 CHECKED: ABB
 APPROVED: ABB

REVISIONS:

JURISDICTIONAL APPROVAL STAMP:

PROJECT TITLE:
Marshall Residence
 4307 East Mercer Way
 Mercer Island, WA 98040

Phase 1B

ARCHITECT:
Sturman Architects
 9 103rd Ave NE Suite 203
 Bellevue, WA 98004

ISSUE:
Permit Set

SHEET TITLE:



Details

SCALE: 3/4" = 1'-0" U.N.O.
 DATE: Aug. 20, 2019
 PROJECT NO: 01310-2019-02
 SHEET NO:

S3.1





1

2

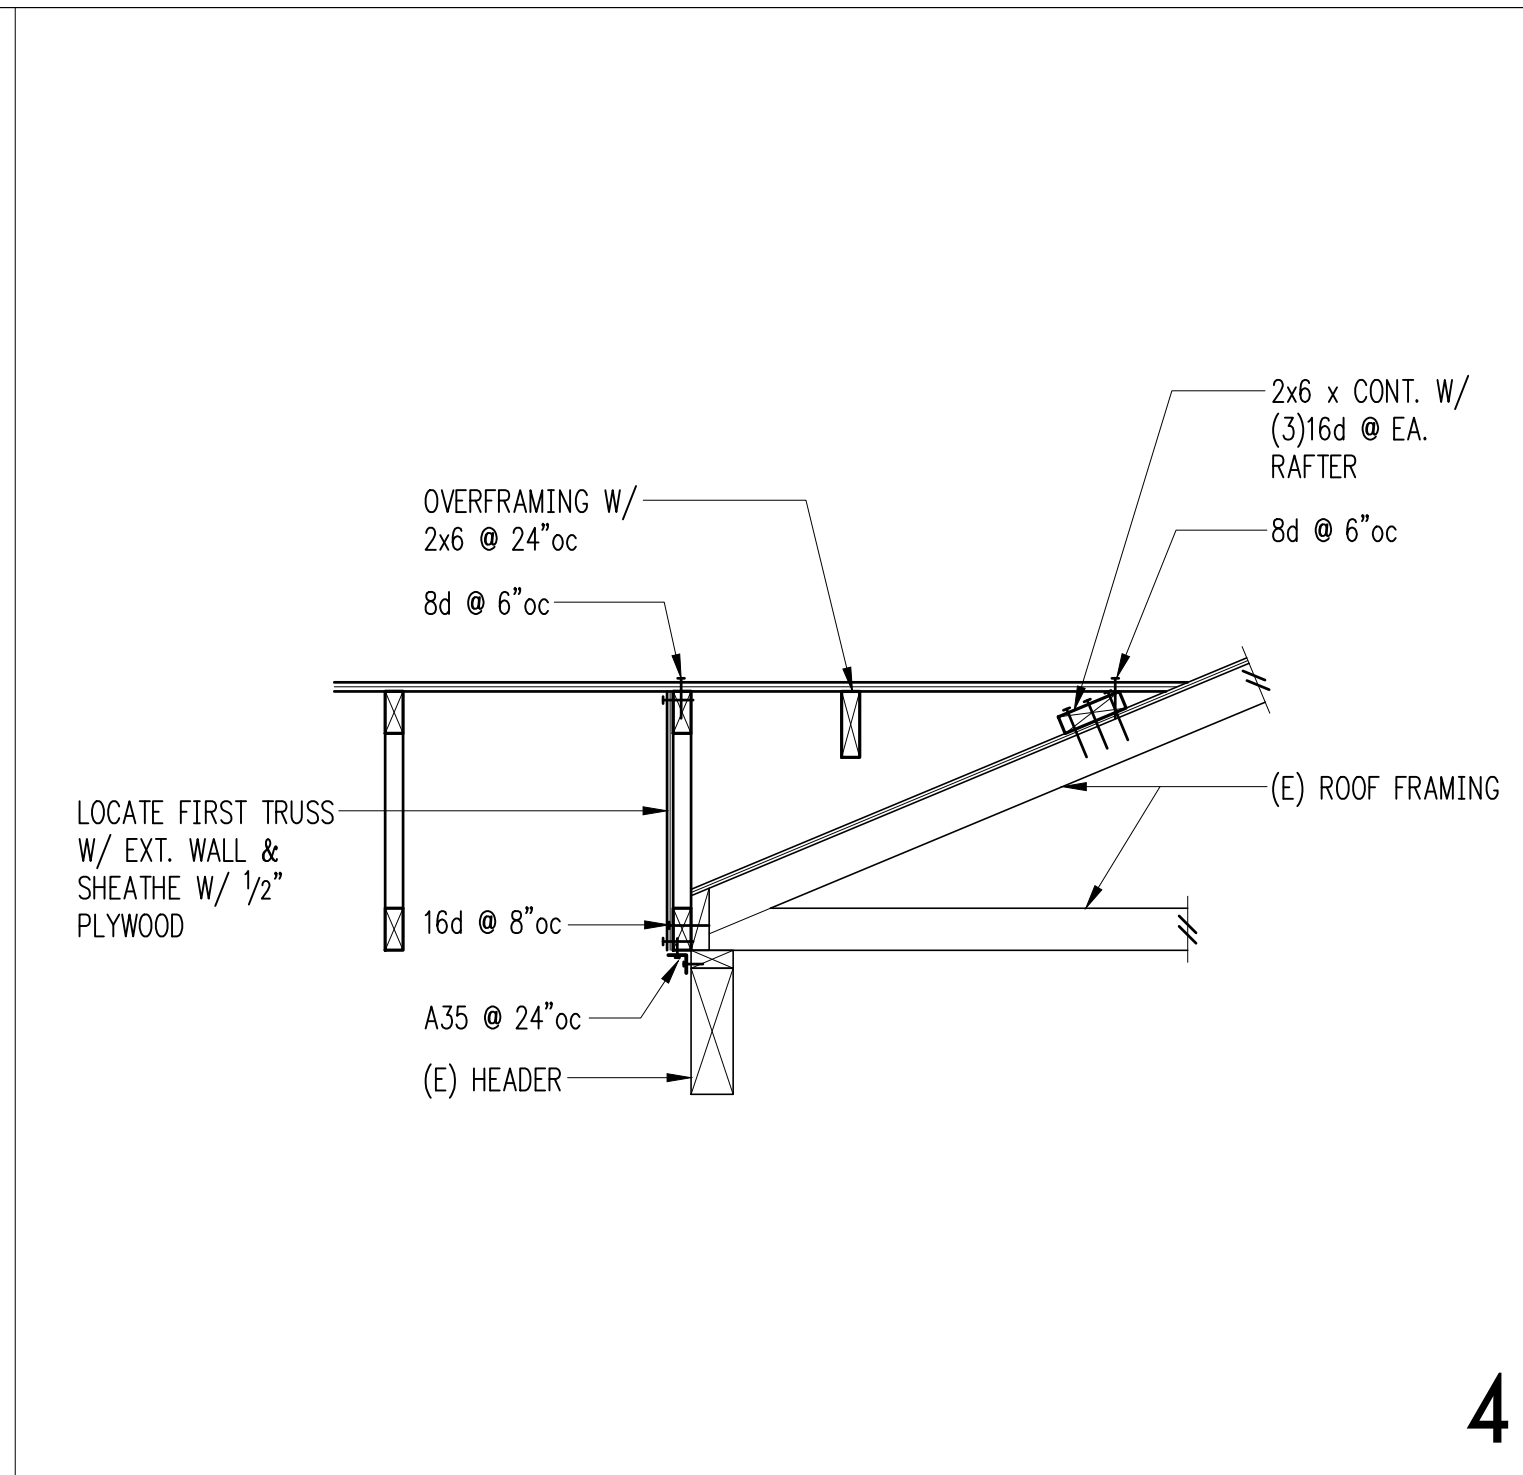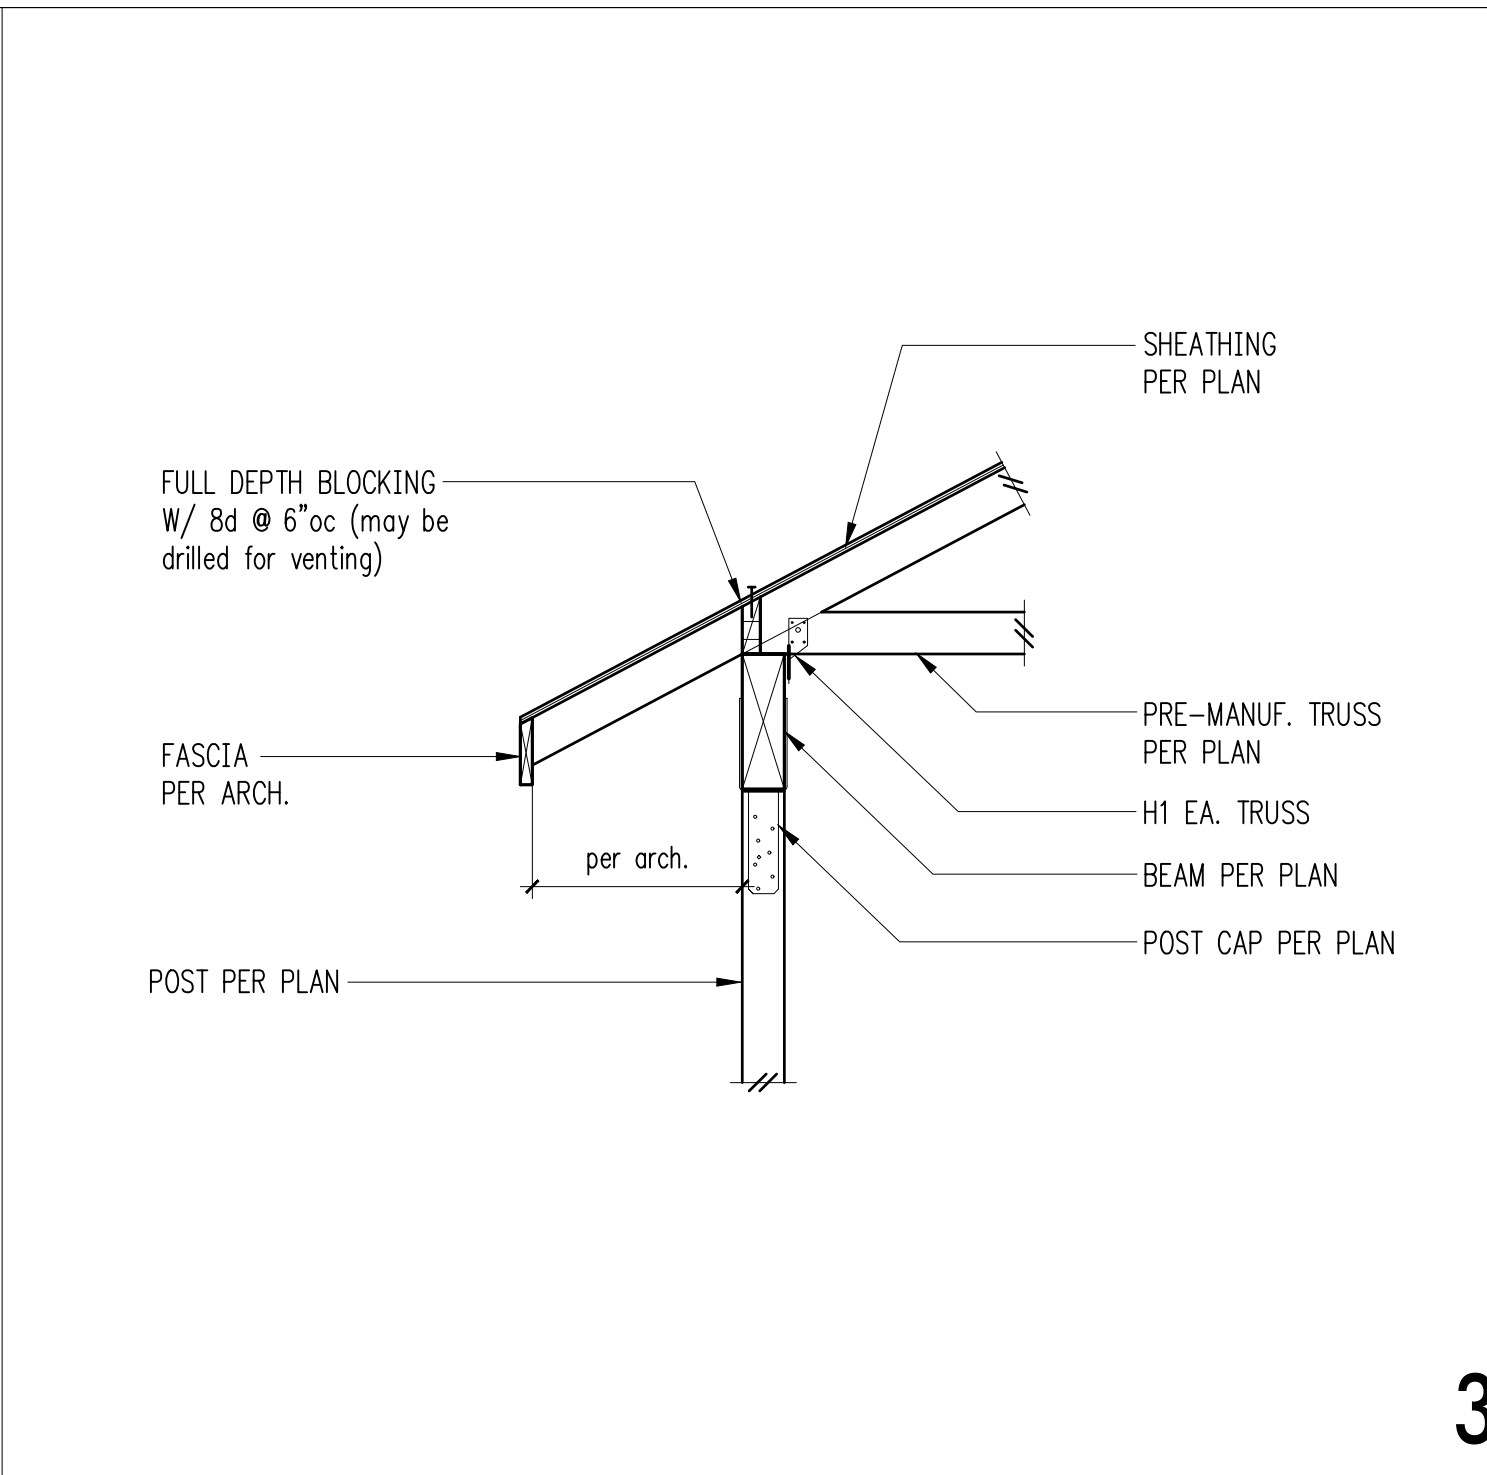

5

6

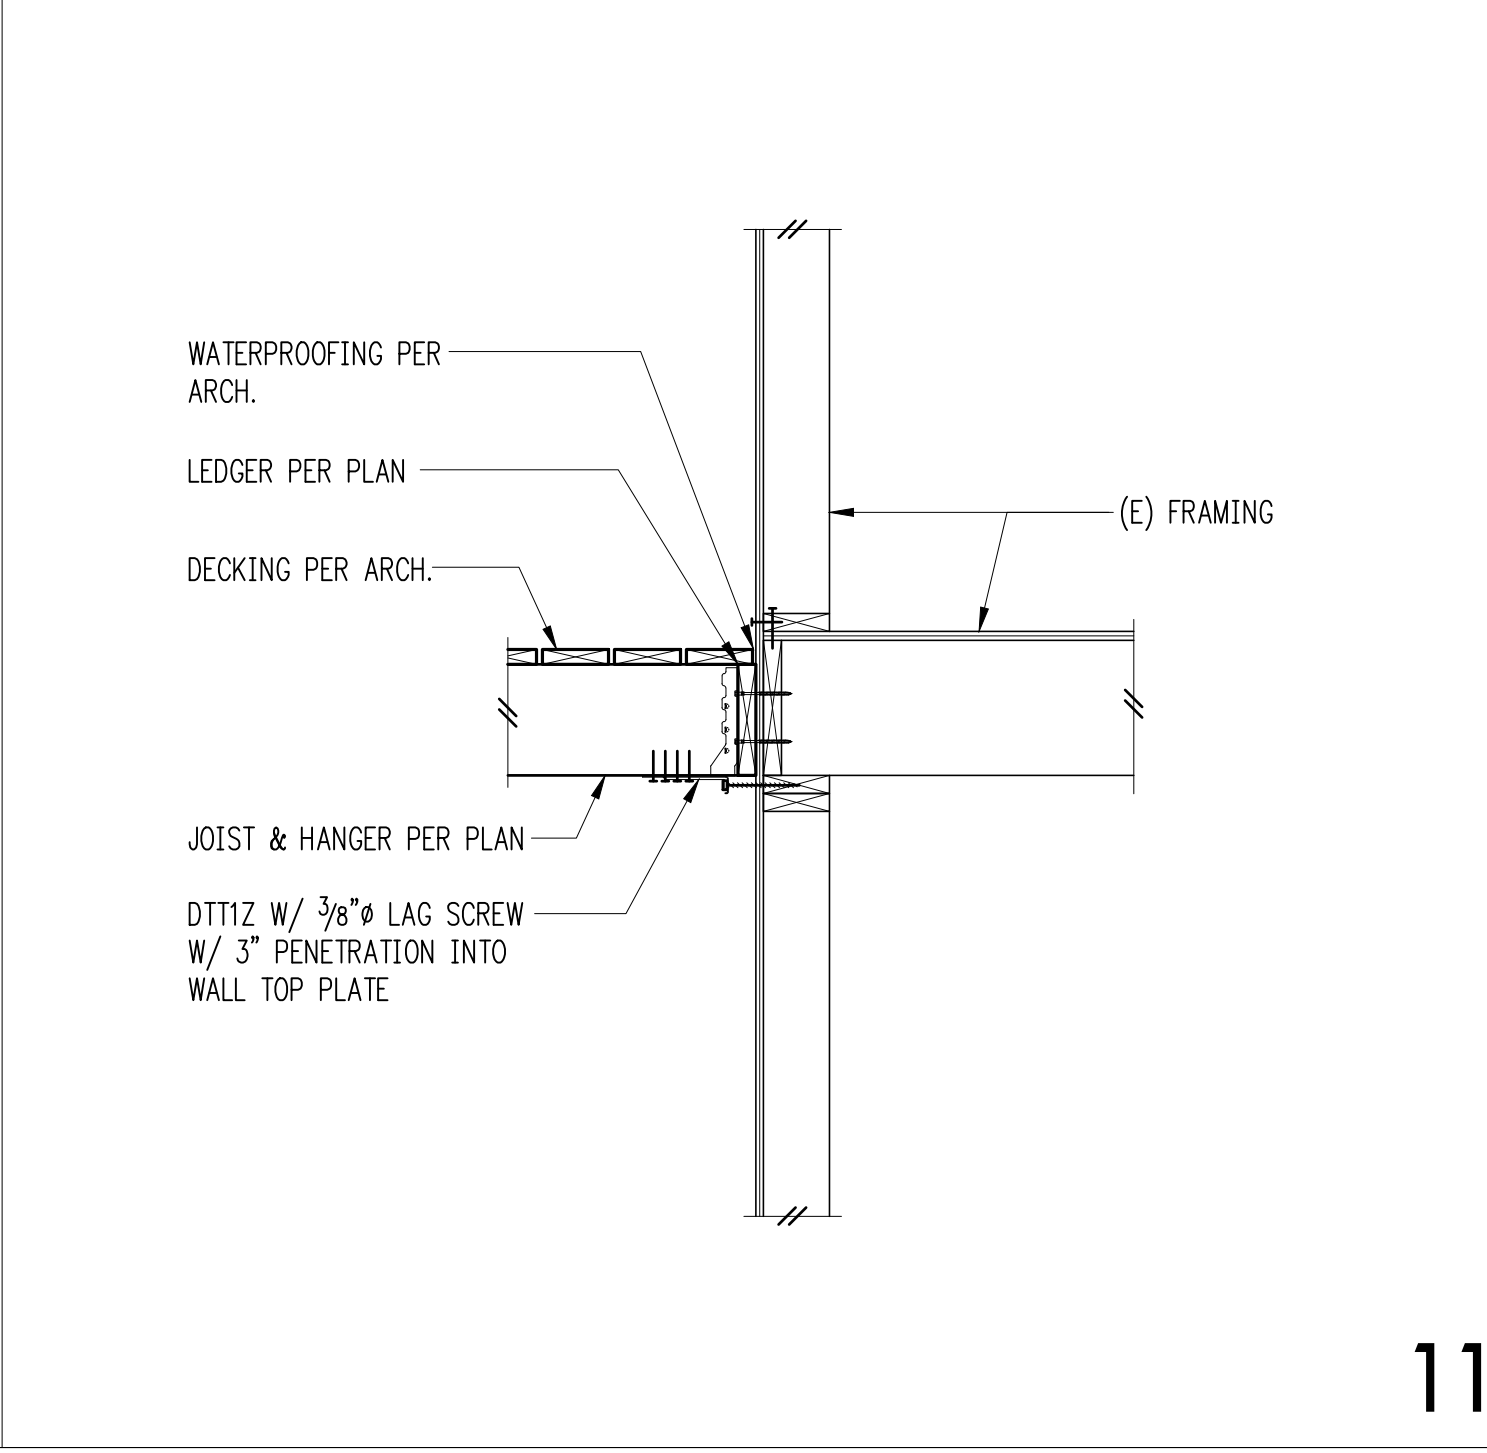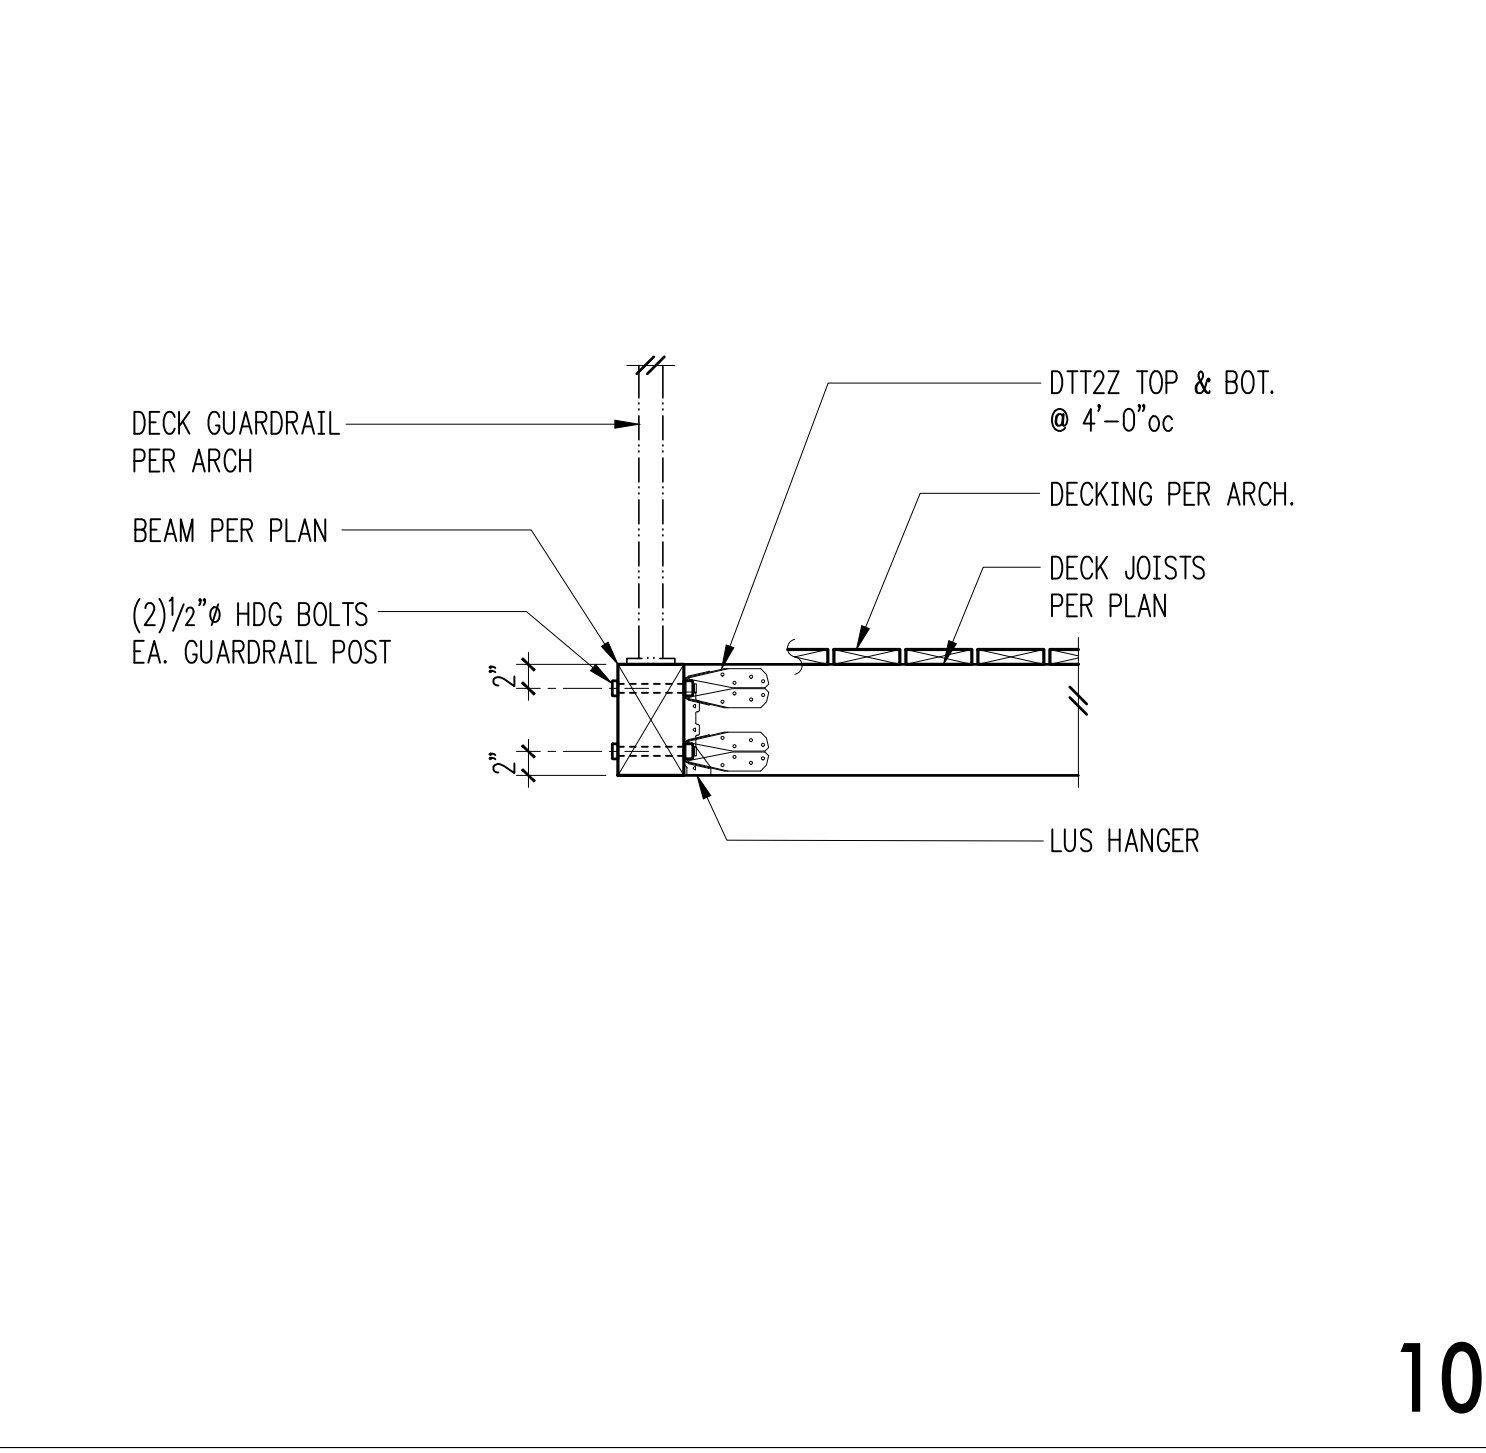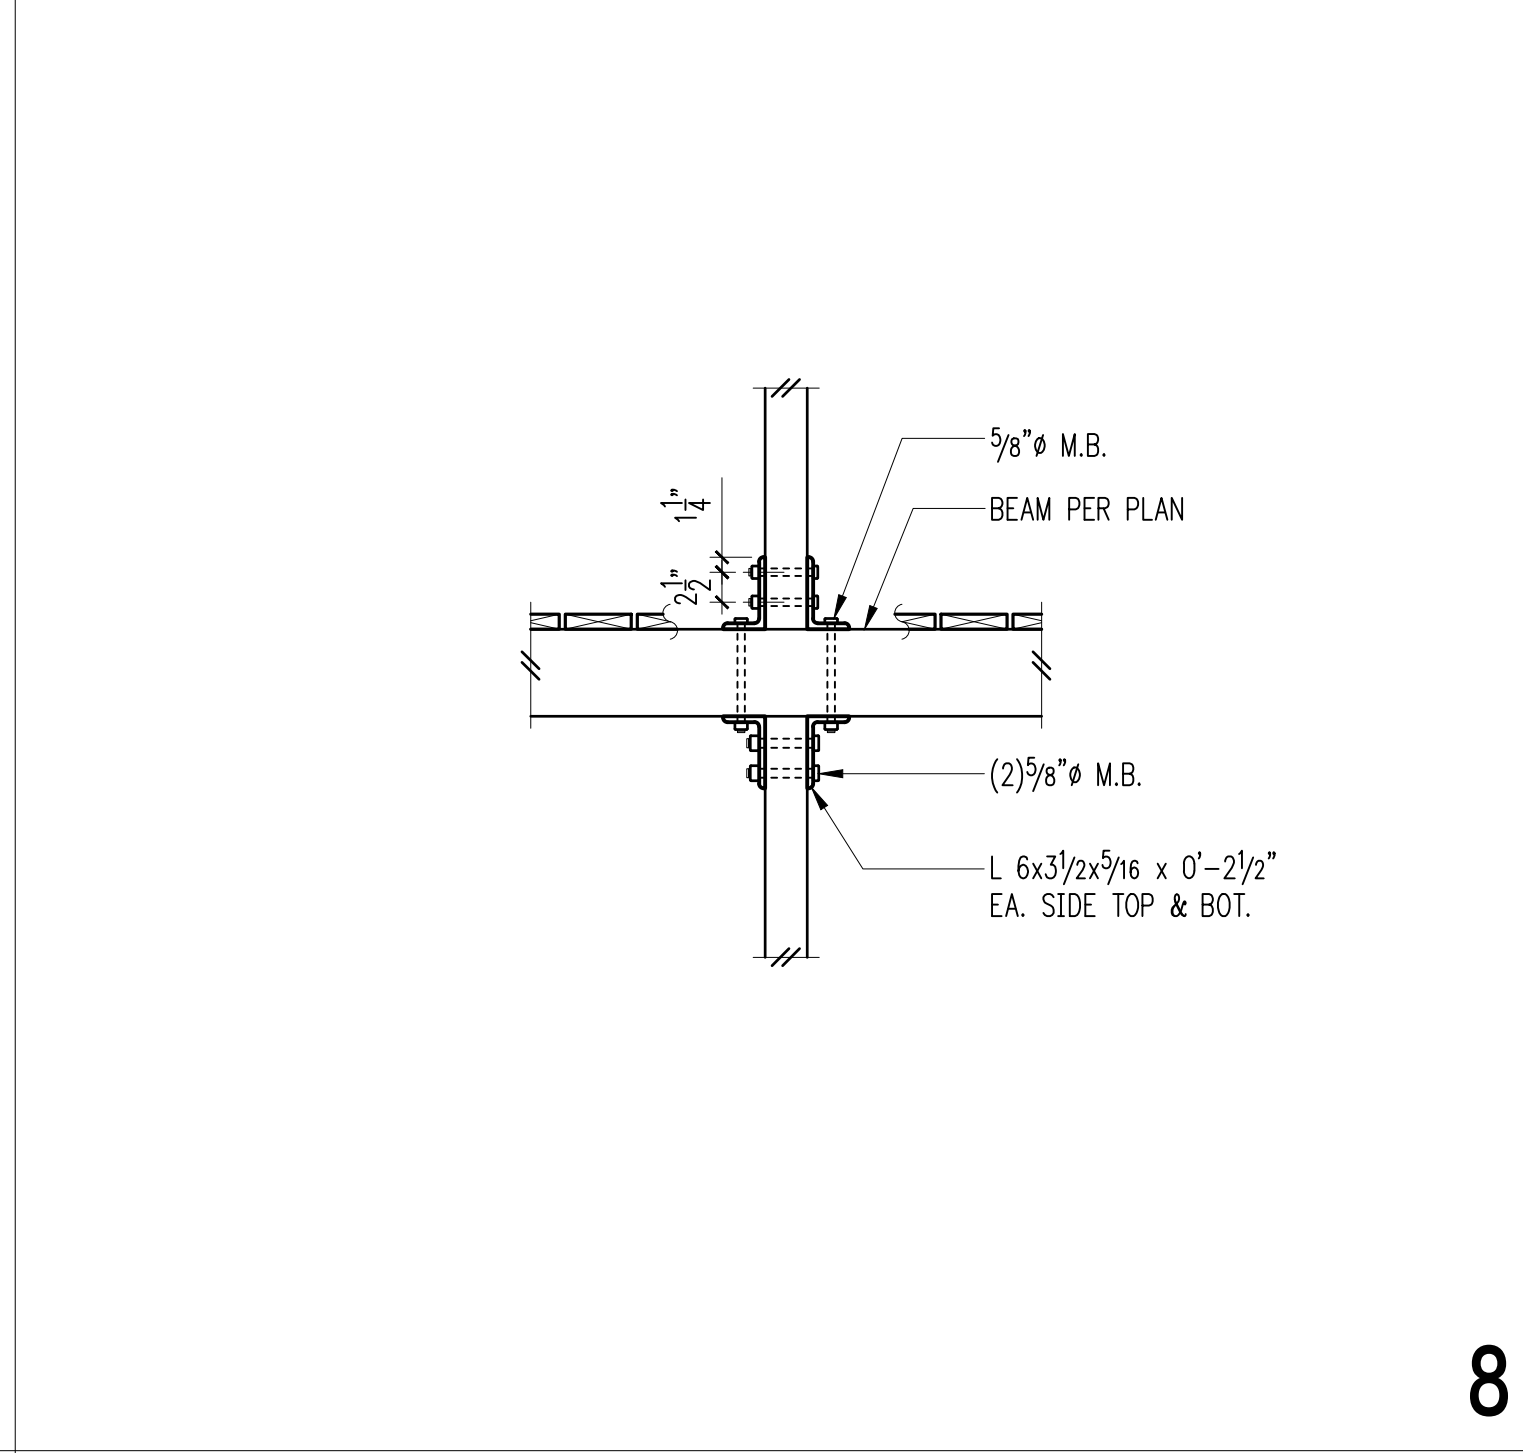

9


12

REVISIONS:	2019-05-30 PERMIT CORRECTIONS #1

DRAWN BY: KE
CHECKED BY: BJS

SHEET
AB-1

OF

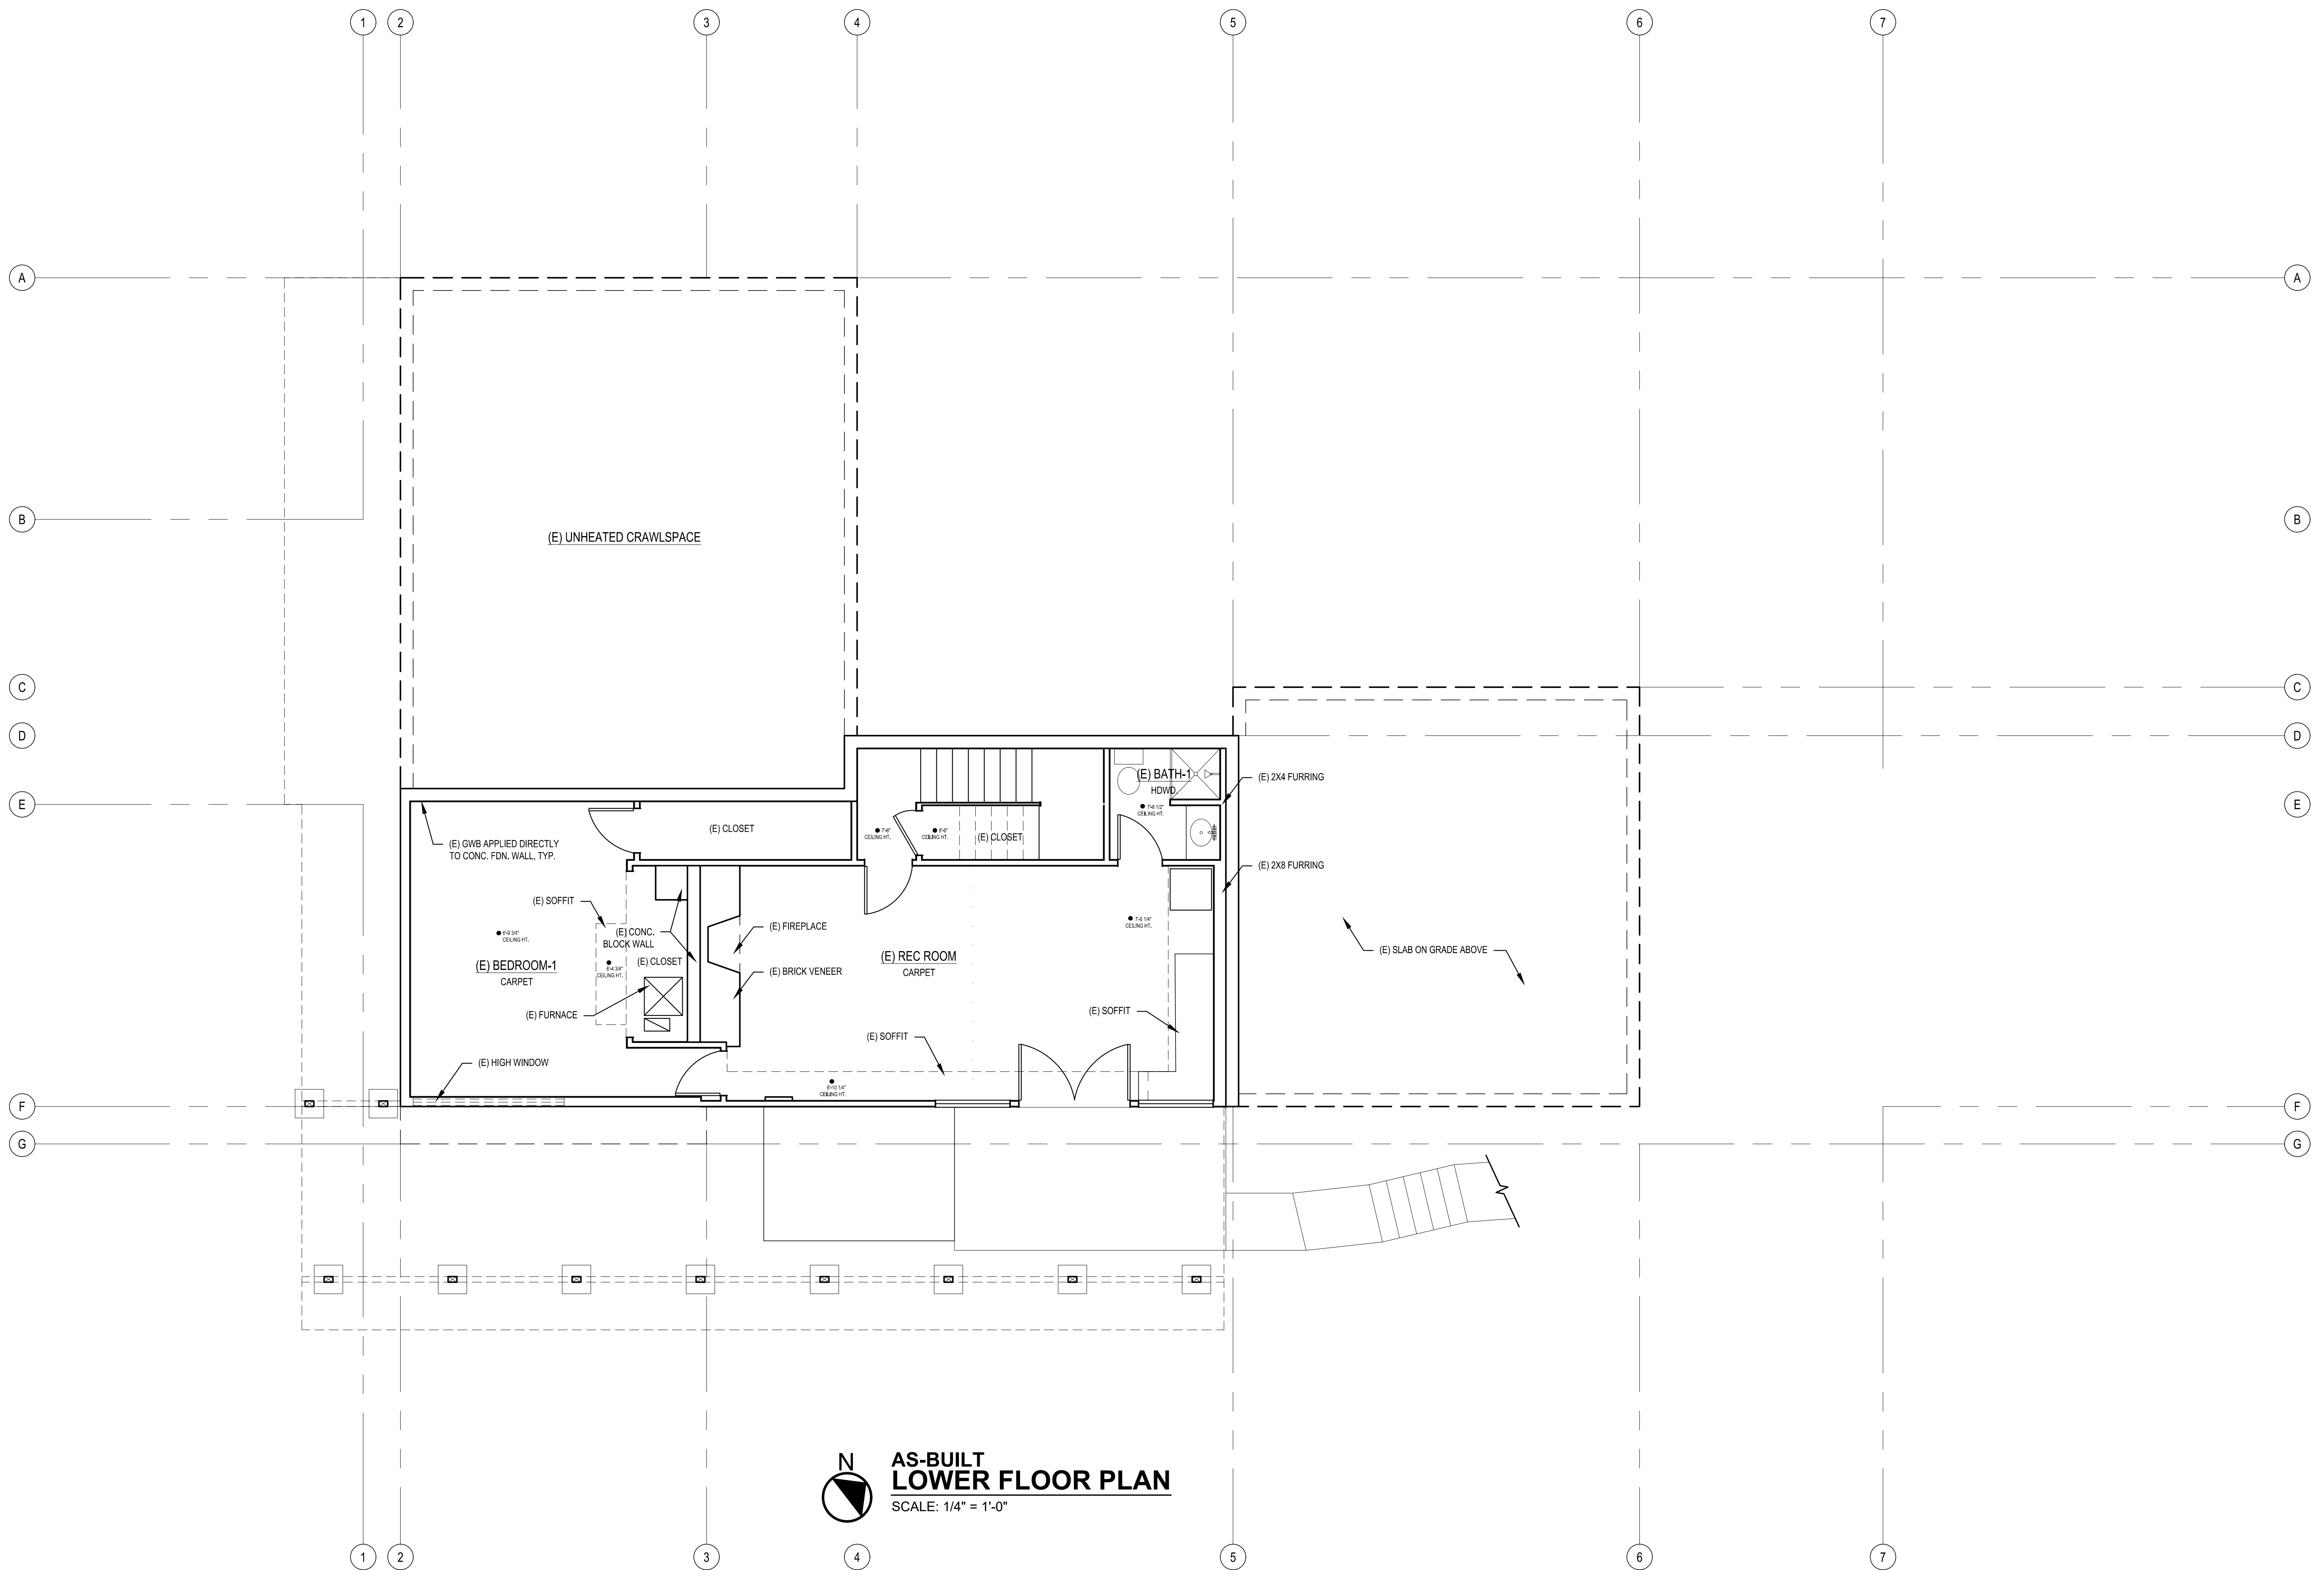

AS-BUILT
LOWER FLOOR PLAN
SCALE: 1/4" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY


PERMIT SET 05/30/19

PLOT DATE: 5/30/2019 FILE NAME:

REVISIONS:	2019-05-30 PERMIT CORRECTIONS #1

DRAWN BY: KE
CHECKED BY: BJS

SHEET
AB-2
OF

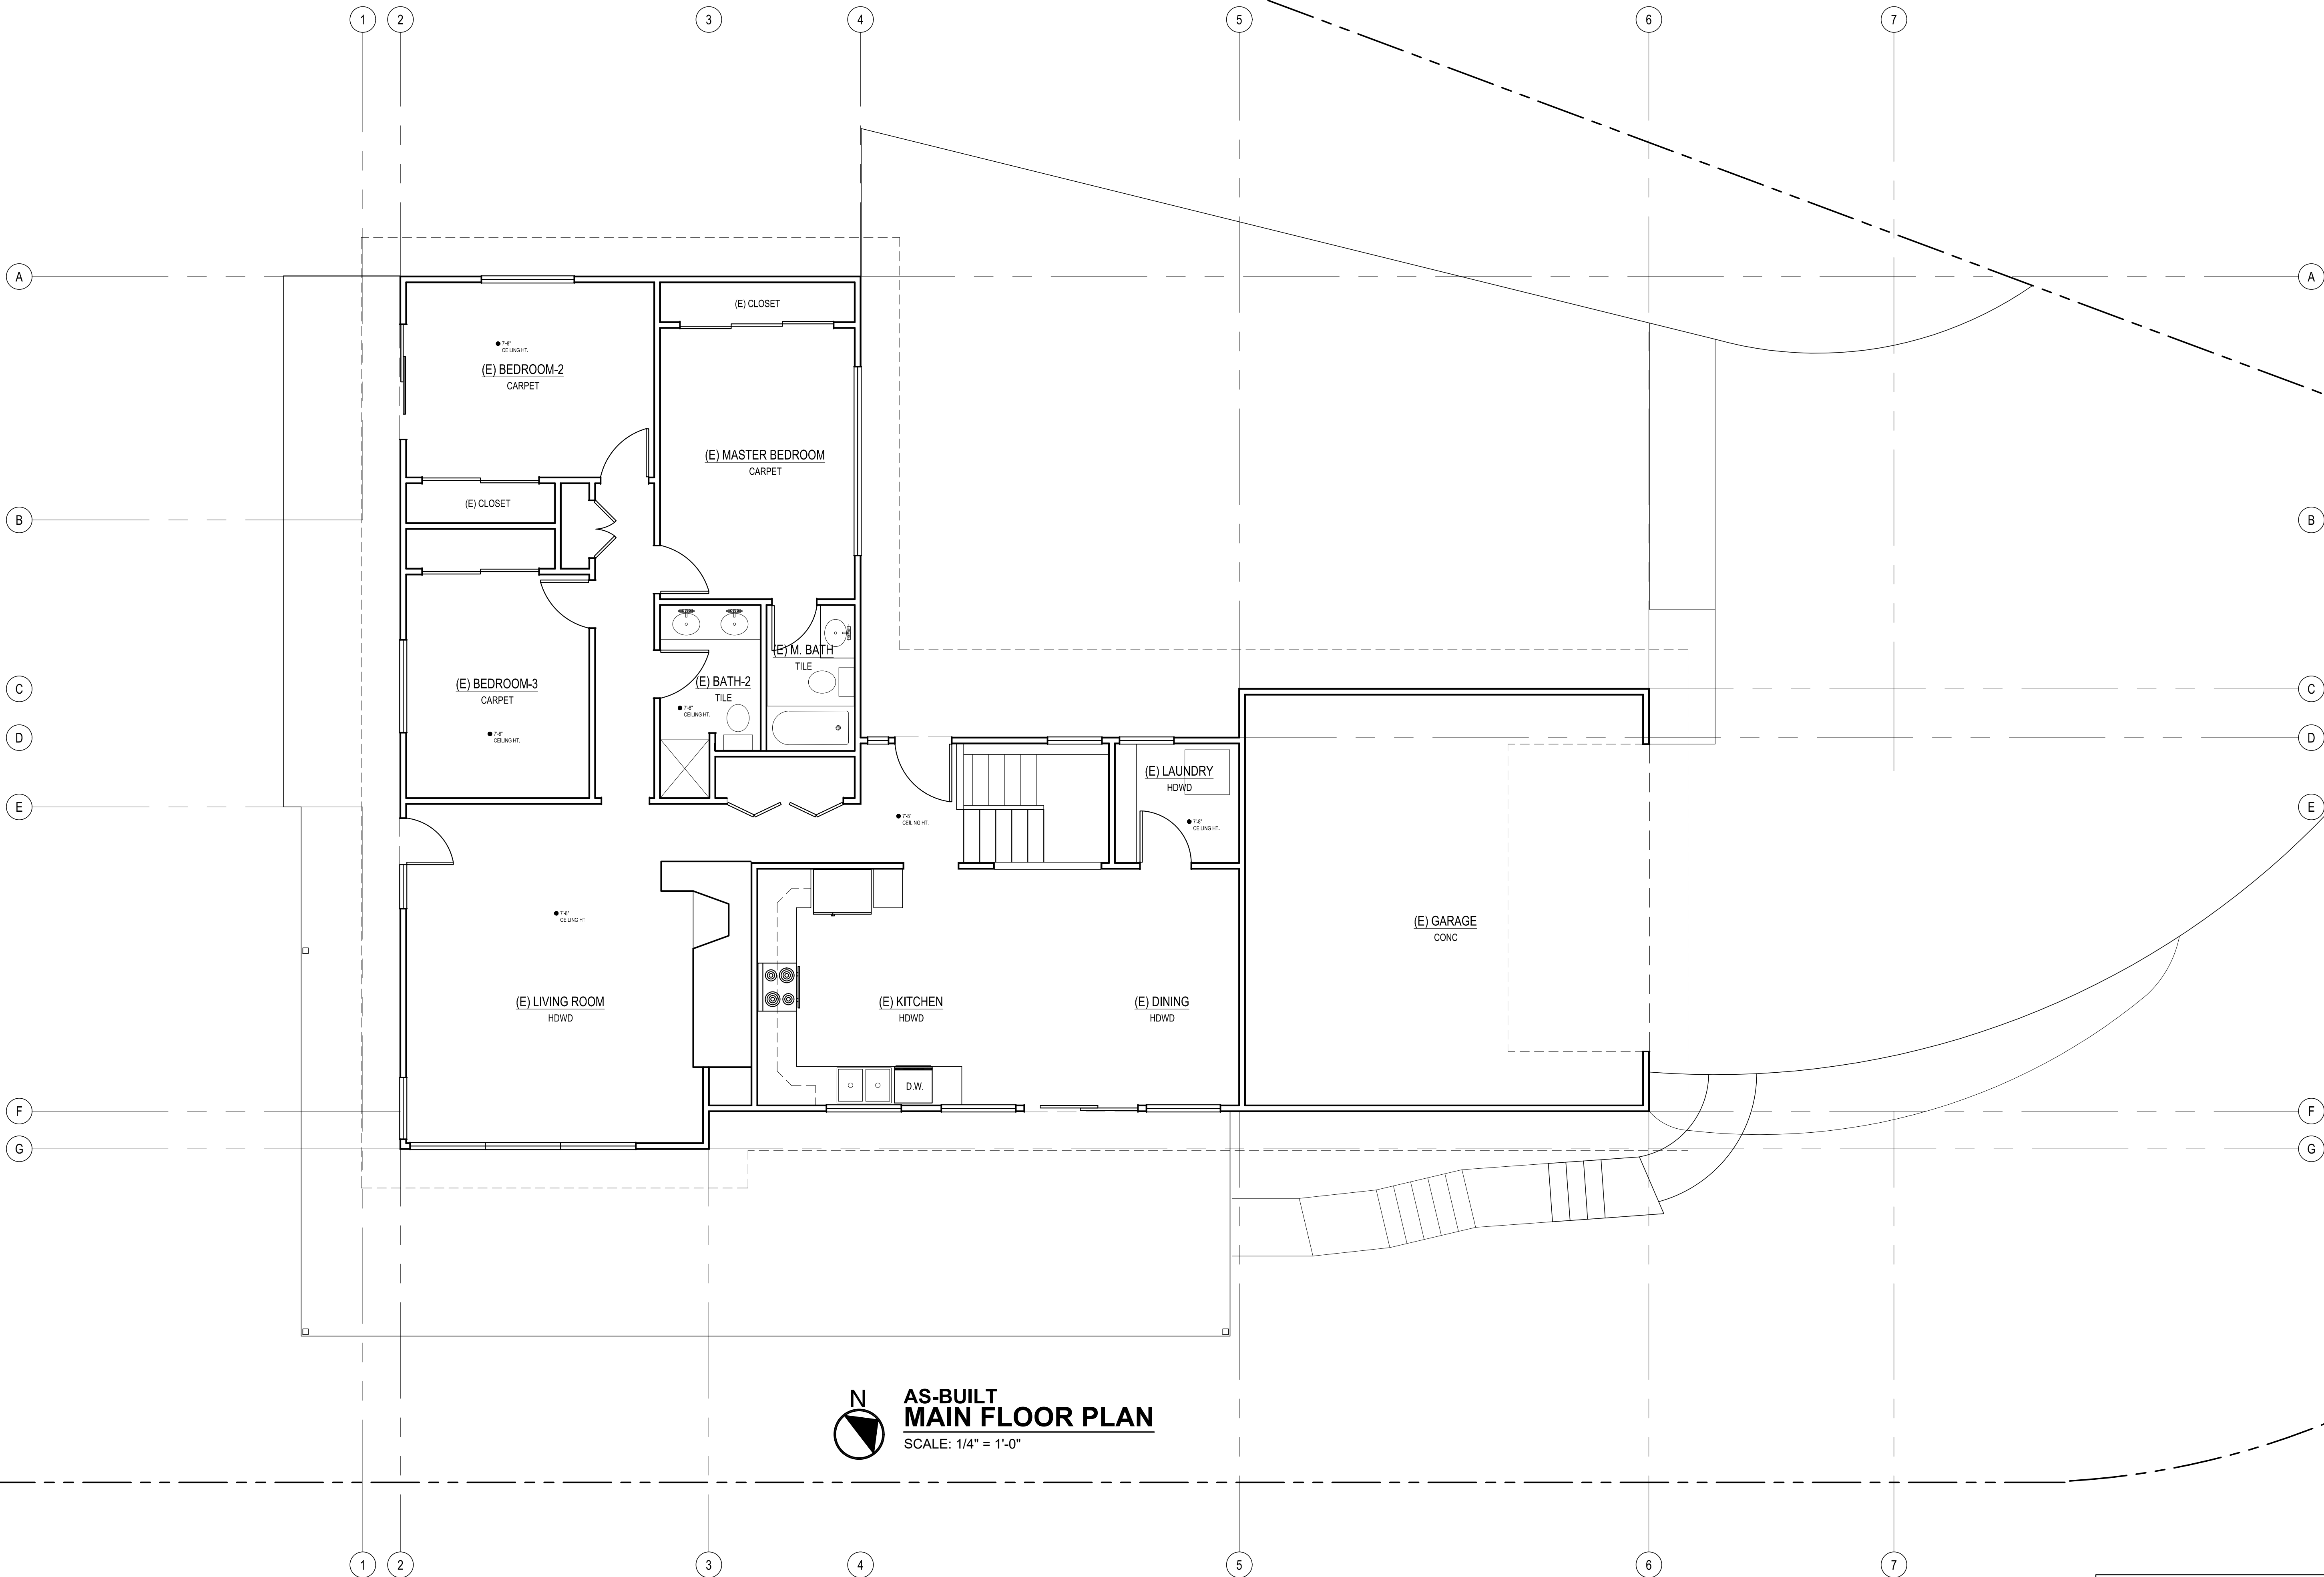

AS-BUILT
MAIN FLOOR PLAN
SCALE: 1/4" = 1'-0"

SCALE: IF SHEET IS LESS THAN 24" x 36", IT IS A REDUCED PRINT, REDUCE SCALE ACCORDINGLY
PERMIT SET 05/30/19
PLOT DATE: 5/30/2019 FILE NAME: