

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2015 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This calculator will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

The glazing (window) and door portion of this calculator assumes the installed glazing and door products have an area weighted average U-factor of 0.30. The incorporated insulation requirements are the minimum prescriptive amounts specified by the 2015 WSEC.

Please fill out all of the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please call the WSU Energy Extension Program at (360) 956-2042 for assistance.

Project Information

Chung Residence Addition
 4027 93rd Ave SE
 Mercer Island, WA 98040

Contact Information

Steve Joo
 steve.joo@hotmail.com
 206-306-6738

Heating System Type:

All Other Systems Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions".

Design Temperature

[Instructions](#)

Mercer Island

Design Temperature Difference (ΔT)
 $\Delta T = \text{Indoor (70 degrees)} - \text{Outdoor Design Temp}$

45

Area of Building

Conditioned Floor Area

[Instructions](#)

Conditioned Floor Area (sq ft)

2,110

Average Ceiling Height

[Instructions](#)

Average Ceiling Height (ft)

7.8

Conditioned Volume

16,521

Glazing and Doors

[Instructions](#)

U-Factor X Area = UA
 0.30 X 308 = 92.28

Skylights

[Instructions](#)

U-Factor X Area = UA
 0.50 X 8 = 4.00

Insulation

Attic

[Instructions](#)

R-49

U-Factor X Area = UA
 0.026 X 1,916 = 49.82

Single Rafter or Joist Vaulted Ceilinas

[Instructions](#)

No Vaulted Ceilings in this project.

U-Factor X Area = UA
 --- X --- = ---

Above Grade Walls (see Figure 1)

[Instructions](#)

R-21 Intermediate

U-Factor X Area = UA
 0.056 X 1,647 = 92.23

Floors

[Instructions](#)

R-38

U-Factor X Area = UA
 0.025 X 1,916 = 47.90

Below Grade Walls (see Figure 1)

[Instructions](#)

No Below Grade Walls in this project.

U-Factor X Area = UA
 --- X --- = ---

Slab Below Grade (see Figure 1)

[Instructions](#)

No Slab Below Grade in this project.

F-Factor X Length = UA
 --- X --- = ---

Slab on Grade (see Figure 1)

[Instructions](#)

No Slab on Grade in this project.

F-Factor X Length = UA
 --- X --- = ---


Location of Ducts

[Instructions](#)

Unconditioned Space

Duct Leakage Coefficient

1.10

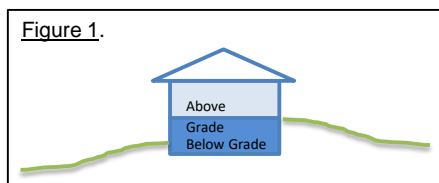

Sum of UA	286.23
Envelope Heat Load	12,880 Btu / Hour
<i>Sum of UA X ΔT</i>	
Air Leakage Heat Load	8,029 Btu / Hour
<i>Volume X 0.6 X ΔT X .018</i>	
Building Design Heat Load	20,910 Btu / Hour
<i>Air Leakage + Envelope Heat Loss</i>	
Building and Duct Heat Load	23,001 Btu / Hour
<i>Ducts in unconditioned space: Sum of Building Heat Loss X 1.10</i>	
<i>Ducts in conditioned space: Sum of Building Heat Loss X 1</i>	
Maximum Heat Equipment Output	28,751 Btu / Hour
<i>Building and Duct Heat Loss X 1.40 for Forced Air Furnace</i>	
<i>Building and Duct Heat Loss X 1.25 for Heat Pump</i>	