

Geotechnical Engineering Design Report
Mercer Island Multi-Family
Development
Seattle, Washington

Prepared for
Hines

May 1, 2015
17984-01

Geotechnical Engineering Design Report

Mercer Island Multi-Family Development

Mercer Island, Washington

Prepared for

Hines

May 1, 2015

17984-01

Prepared by

Hart Crowser, Inc.



Matthew W. Veenstra, PE
Geotechnical Engineer



May 1, 2015

David G. Winter, PE
Vice President

Contents

PROJECT UNDERSTANDING	1
SITE CONDITIONS	1
FIELD EXPLORATIONS	2
SOIL CONDITIONS	2
GROUNDWATER CONDITIONS	3
GEOTECHNICAL ENGINEERING CONCLUSIONS AND RECOMMENDATIONS	3
Earthquake Engineering	3
Seismic Setting	3
Seismic Hazards	4
Building Code Seismic Parameters	4
Excavation and Shoring	4
Lateral Soil Pressures for Design of Temporary Shoring Walls	5
Surcharge Pressures on Shoring	6
Soldier Pile Design	6
Lagging Design	6
Tieback Design	7
Permanent Subgrade Wall Design	8
Earth Pressures	8
Hydrostatic Groundwater Pressure	9
Seismic Earth Pressure on Walls	9
Surcharge Pressures on Walls	9
Foundation Design Recommendations	9
GROUNDWATER CONTROL	10
Slug Results	10
Temporary Construction Dewatering	10
Permanent Drainage	10
Walls Placed Against Shoring	11
Slabs-on-Grade	11
Backfilled Walls	11
Final Site Drainage	12
Pavement Areas	12
GEOTECHNICAL RECOMMENDATIONS FOR CONSTRUCTION	12

Soldier Pile Installation	12
Lagging Installation	13
Tieback Installation	13
Shoring Monitoring Program	16
Foundation Construction	17
Earthwork	18
Site Preparation and Grading	18
Structural Fill	18
Use of On-Site Soil as Structural Fill	19
Temporary Cuts	19

RECOMMENDATIONS FOR CONTINUING GEOTECHNICAL SERVICES	20
---	-----------

REFERENCES	20
-------------------	-----------

TABLES

1	2012 IBC Seismic Design Parameters	4
2	Axial Capacity Parameters for Drilled Soldier Piles	6
3	Recommended Temporary Lagging Thickness	7
4	Tentative Pullout Resistance for Tiebacks with Pressure-Grouted Bond Zone	7
5	Soil Equivalent Fluid Unit Weights for Walls Backfilled with Structural Fill	9

FIGURES

1	Vicinity Map
2	Site and Exploration Plan
3	Generalized Subsurface Cross Section A-A'
4	Generalized Subsurface Cross Section B-B'
5	Generalized Subsurface Cross Section C-C'
6	Generalized Subsurface Cross Section D-D'
7	Lateral Earth Pressures Temporary Shoring
8	Surcharge Pressures Determination of Lateral Pressure Acting on Adjacent Shoring
9	Lateral Pressures for Permanent Walls Constructed Against Shoring
10	Elevation of Top of Competent Soils

ATTACHMENT 1

Slug Test Results

APPENDIX A

Field Exploration Methods and Analysis

APPENDIX B

Historical Explorations

Geotechnical Report

Mercer Island Multi-Family Development

Mercer Island, Washington

This report provides our geotechnical engineering recommendations for the Mercer Island Multi-Family Development in Mercer Island, Washington.

Our scope of work included:

- Collecting and assessing subsurface conditions from historical explorations;
- Drilling four borings;
- Installing monitoring wells in two of the borings;
- Conducting one dynamic cone penetration test in the northwest corner of the site;
- Preparing logs of the soil explorations;
- Assessing groundwater conditions including slug testing of new and existing wells;
- Conducting engineering analysis; and
- Preparing this report summarizing our findings and presenting geotechnical recommendations.

We completed this work in general accordance with our contract dated October 15, 2014. This report is for the exclusive use of Hines and its design consultants for specific application to this project and site. We completed this work in accordance with generally accepted geotechnical engineering practices for the nature and conditions of the work completed in the same or similar localities, at the time the work was performed. We make no other warranty, express or implied.

PROJECT UNDERSTANDING

The project consists of a five-story, mixed-use building with one to two levels of below-grade parking. The proposed development site is shown on Figures 1 and 2.

We understand that the grading plan is for a basement finish floor elevation of 63 feet with a ramp up to elevation 72 feet in the northwest corner of the site. The existing ground surface generally slopes from about elevation 90 feet along 78th Avenue SE to about elevation 82 feet along 77th Avenue SE. The bottom of the excavation is expected to be about 22 to 32 feet below existing ground surface.

In this report, the elevation datum is NAVD 88 and the horizontal datum is NAD 83/91. Length and distance units are in U.S. feet unless otherwise noted.

SITE CONDITIONS

We visited the site on September 29, 2013, to observe the condition of the on-site buildings, nearby buildings, and paved surfaces. The buildings did not show signs of excessive building settlement such as large cracks in the walls or sloping lines. We did observe concrete cracking on the exterior stairway on the north side of the 2885 78th Avenue SE building that houses the Seven Star restaurant and a slight separation of concrete masonry unit (CMU) joints on the southwest corner of the 2864 77th

Avenue SE building that houses Terra Bella; however, these observed conditions are not definitively caused by foundation settlement.

According to property records accessed on the City of Mercer Island website, it appears that most of the buildings on or near the site are founded on spread foundations. However, the McDonald's restaurant immediately north of the site and the building immediately north of the McDonald's (2737 78th Avenue SE) were both constructed using timber pile foundations up to 25 feet long, which indicates unsuitable soils in the vicinity.

FIELD EXPLORATIONS

Exploration locations by Hart Crowser for the current project are shown on Figure 2 and exploration logs are provided in Appendix A. We also observed push probes conducted by Farralon Consulting and made our own exploration logs for those explorations. We also reviewed geotechnical reports by Terra Associates, Inc. (Terra 2012) and ABPB Consulting (ABPB 2012). The locations of historical explorations and Farralon's push probes are provided on Figure 2 and the logs are provided in Appendix B.

On November 12 to 13, 2014, we performed a subsurface investigation including four hollow-stem auger borings, HC-1 to HC-4, from 36.5 to 41.5 feet below ground surface (bgs) and one dynamic cone penetrometer, HC-5, to 20.5 feet bgs. We installed monitoring wells in borings HC-1 and HC-2. On November 14, 2014, we developed the monitoring wells and on November 17, 2014, we performed slug testing on monitoring wells in borings HC-1, HC-2, APBP M3, and Terra B-1.

Our understanding of the subsurface conditions is based on current and historical explorations at the site. Subsurface conditions interpreted from explorations at discrete locations on the site and soil properties inferred from the field and laboratory tests formed the basis of the geotechnical recommendations in this report. The nature and extent of variations between explorations may not become evident until additional explorations are performed or construction begins. If variations are encountered, it may be necessary to reevaluate the recommendations made in this report. General soil and groundwater conditions are addressed below. Refer to exploration logs for more detailed information at specific locations.

SOIL CONDITIONS

The subsurface soil conditions are illustrated by generalized subsurface profiles AA' through DD' on Figures 3 through 6. Based on our interpretation of the borings, the regional topography, and our conversations with the current property owners, the site is likely a filled in swamp/marsh lowland area underlain by relatively impermeable glacial silt and clay.

As shown on the subsurface profiles, we have divided the lithology into four main soil units:

Unit 1. Loose to medium dense silty granular FILL, soft SILT, and PEAT. This unit is generally not suitable for conventional spread footings.

Unit 2. Medium stiff to hard SILT and silty CLAY. This unit is generally suitable for conventional spread footings with moderate bearing pressures but may require localized overexcavation and replacement with structural fill to provide adequate foundation subgrade.

Unit 3. Medium dense to dense SAND and silty SAND. This unit may be interbedded with Unit 2 and Unit 4 and is expected to be most prominent and most likely to be encountered along the southern end of the site. Excavations into this unit will likely require dewatering.

Unit 4. Hard SILT. This unit generally underlies the other soil units except along the southern end of the site. This unit is suitable for conventional spread footings with moderate to high bearing pressures.

In this report we define “competent soils” as Soil Units 2, 3 and 4.

GROUNDWATER CONDITIONS

Groundwater was observed during drilling at the site at depths of 5 to 25 feet. Groundwater occurs in the predominantly fine-grain soils (Units 1, 2, and 4) as perched water within discontinuous permeable lenses. Saturated groundwater conditions were observed in Unit 3. For design purposes, we recommend a groundwater table elevation of 75 feet.

GEOTECHNICAL ENGINEERING CONCLUSIONS AND RECOMMENDATIONS

Our recommendations are based on our current understanding of the project and the subsurface conditions interpreted from explorations at and near the site by Hart Crowser and others. If the nature or location of the facilities is different than we have assumed, we should be notified so we can review, change, and/or confirm our recommendations.

Earthquake Engineering

Seismic Setting

The seismicity of Western Washington is dominated by the Cascadia Subduction Zone (CSZ), where the offshore Juan de Fuca plate subducts beneath the continental North American plate. Three main types of earthquakes are typically associated with subduction zone environments: crustal, intraplate, and interplate earthquakes. Seismic records in the Puget Sound area clearly indicate a distinct shallow zone of crustal seismicity, the Seattle Fault, which may have surficial expressions and can extend to depths of 25 to 30 km. A deeper zone is associated with the subducting Juan de Fuca plate and produces intraplate earthquakes at depths of 40 to 70 km beneath the Puget Sound region (e.g., the 1949, 1965, and 2001 earthquakes) and interplate earthquakes at shallow depths near the Washington coast (e.g., the 1700 earthquake with an approximate magnitude of 9.0).

Seismic Hazards

- Based on our analysis and the planned depth of excavation, it is our opinion that the risk of liquefaction occurring across the site is low.
- The site is flat and there is no sloping ground near the site so the risk of lateral spreading or slope failure is low.
- The mapped northernmost splay of the Seattle Fault is about 0.5 miles south of the site. There is a remote potential for surface rupture at the site from a new splay of the Seattle Fault; however, this hazard is very low considering the Seattle Fault's 3,000-year recurrence interval, the many possible locations for surface rupture, and the chance that the fault would not produce surface rupture in this segment of the fault.

Building Code Seismic Parameters

Table 1 provides 2012 International Building Code (IBC) seismic design parameters for the site latitude and longitude and the soil Site Class. The parameters were obtained from the USGS US Seismic Design Maps web application (<http://earthquake.usgs.gov/designmaps/us/application.php>) accessed on December 9, 2014.

Based on the soil conditions across the site, it is our opinion that the site is best characterized as site class D.

Table 1 – 2012 IBC Seismic Design Parameters

Parameter	Value
Latitude	47.58485
Longitude	122.23438
Site Class	D
PGA	0.568
S _s	1.380
S ₁	0.531
F _a	1.0
F _v	1.5

Excavation and Shoring

We recommend a conventional shoring system of soldier piles, tiebacks, and wood lagging.

Our shoring recommendations assume that the excavation will extend down to at least the top of competent soils. Because the actual depth of competent soils may differ from our estimate, we recommend designing the shoring assuming the excavation extends an additional 2 feet below the planned bottom of excavation to allow for potential over-excavation along the shoring wall if needed.

At the ramp in the northwest corner, the shoring should be designed assuming the existing ramp subgrade soils will be excavated down to competent soils, the same as for the rest of the site.

Perched groundwater will likely be encountered in sand zones throughout the excavation depth. Excavations into Soil Unit 3, sandy soils, will likely require active dewatering.

Shoring should be designed by a professional structural engineer registered in the State of Washington. We also recommend that we be given the opportunity to review the geotechnical aspects of the shoring design before construction. It is generally not the purpose of this report to provide specific criteria for the contractor's construction means and methods. It should be the responsibility of the shoring contractor to verify actual ground conditions and determine the construction methods and procedures needed to install an appropriate shoring system.

Lateral Soil Pressures for Design of Temporary Shoring Walls

Lateral earth pressures for the shoring design depend on the type of shoring and its ability to deform. If the top of the shoring is allowed to deform on the order of 0.001 to 0.002 times the shoring height, and if no settlement-sensitive structures or utilities are within the zone of deformation, the shoring may be designed using active earth pressures. If settlement-sensitive structures or utilities exist within the potential zone of deformation, or where the shoring system is too stiff to allow sufficient lateral movement to develop an active condition, at-rest earth pressures should be used to design the shoring.

We expect that temporary shoring will consist of soldier piles and timber lagging with one or more levels of tiebacks. Tied-back or braced walls should be designed using a trapezoidal apparent earth pressure distribution. General earth pressure diagrams and recommendations for temporary shoring are provided on Figure 7.

The lateral earth pressures presented herein for soldier piles are based on non-sloping conditions behind the walls and drained conditions so that hydrostatic water pressure does not act on the walls above the base of the excavation. For design calculations, we recommend adding at least 2 feet to the proposed excavation depth to allow for possible surface pressures near the excavation (e.g., light vehicles, small material stockpiles).

Based on the assumed loading conditions and the applied loads, we expect the shoring system to deflect about 1 inch or less into the excavation. Individual soldier piles may deflect more than 1 inch or deflect away from the excavation.

Hart Crowser should review any soldier piles that deflect more than 1/2 inch to try to identify the cause of the deflection and to determine whether remedial measures are required.

Surcharge Pressures on Shoring

Additional lateral pressures due to surcharge loads (e.g., buildings, footings, heavy equipment, large material stockpiles) should be calculated using methods shown on Figure 8. These loads would be added to the loads calculated for the shoring walls. We recommend Hart Crowser review or complete the estimated surcharge loads when surcharge loads, footprints, and foundation plans of adjacent structures are available.

Soldier Pile Design

We recommend the following for soldier pile design:

- Soldier piles must be designed by a licensed structural engineer;
- Soldier piles should be designed for bending using a uniform loading equivalent to 80 percent of the design values and analyzed for shear using total load;
- To design against kickout, the lateral resistance should be computed using the passive pressure on Figure 7, acting over 2 times the diameter of the concreted shaft section or the pile spacing, whichever is less;
- The embedded portion of the pile shaft should be at least 2 feet in diameter; and
- Piles should be embedded at least 8 feet below the bottom of the excavation.

These recommendations assume proper installation of the soldier piles as discussed later in this report.

We recommend the allowable axial pile capacity parameters in Table 2 to calculate the vertical resistance of the soldier piles. The values assume that soldier piles are embedded into competent soils. The pile side friction above the bottom of the excavation should be neglected. The soldier piles should be embedded at least 10 feet below the base of the excavation.

Table 2 – Axial Capacity Parameters for Drilled Soldier Piles

Soil Unit	Allowable Unit Side Capacity	Allowable Unit End Capacity
Unit 1	0.5 ksf	NA
Units 2 – 4	2 ksf	10 ksf

Lagging Design

Temporary lagging should be designed in accordance with Federal Highway Administration (FHWA) Geotechnical Engineering Circular (GEC) 4 (FHWA 1999), structural engineering guidelines, soil type, and local experience. Table 3 provides recommended lagging thicknesses based on the FHWA recommendations.

Based on our site investigation, we recommend using a Soil Type of “Competent” for the eastern half of the site and “Difficult” for the western half of the site.

Table 3 – Recommended Temporary Lagging Thickness

		Clear Span of Lagging (feet)					
		5	6	7	8	9	10
		Minimum Actual Thickness of Rough Cut Timber Lagging (inches)					
Competent ^a	25 and under	2	3	3	3	4	4
	Over 25 to 60	3	3	3	4	4	5
Difficult ^a	25 and under	3	3	3	4	4	5
	Over 25 to 60	3	3	4	4	5	5
Potentially Dangerous ^a	15 and under	3	3	4	5	See note ^b	See note ^b
	Over 15 to 25	3	4	5	6	See note ^b	See note ^b
	Over 25	4	5	6	See note ^b	See Note ^b	See note ^b

Notes:

- a. Soil type as defined in WSDOT Standard Specifications section 6-16.3(6)A.
- b. For exposed wall heights exceeding the limits in Table 3, or where minimum rough-cut lagging thickness is not provided, the contractor should design the lagging in accordance with structural engineering guidelines and local experience. Soldier pile and lagging shoring may not be appropriate for these cases.

Tieback Design

We recommend the tentative allowable tieback pullout value in Table 4 for a typical 6-inch-diameter drilled hole with a pressure-grouted bond zone. The allowable transfer load includes a recommended factor of safety of 2.0. The factor of safety should be confirmed by completing at least two successful verification tests in each soil type. Additionally, each tieback should be proof-tested to 133 percent of the design load. Our recommended tieback testing program is included in Attachment 1. We recommend that the shoring contractor and/or designer determine a final design tieback pullout resistance based on their previous experience in Seattle, which must then be confirmed by field testing.

Table 4 – Tentative Pullout Resistance for Tiebacks with Pressure-Grouted Bond Zone

Soil Type	Allowable Transfer Load
Competent soils – Soil Units 2 through 4	2 kip/ft

We make the following additional recommendations for tieback design:

- Do not install the bond zone within Soil Unit 1 (fill, soft silt and clay, peat), if present.
- Tieback bond zones should be outside of the no-load zone. The no-load zone is shown on Figure 5 as a zone bounded by a 60-degree line to the horizontal that starts at a distance of $H/4$ from the bottom of the excavation, where H is the excavation height.
- Locate anchors at least three tieback diameters apart.
- Design anchor lengths so that they do not conflict with any underground support elements of adjacent structures.
- Identify existing facilities adjacent to the project site including buried utilities and foundations, as these may affect the location and length of the anchors.
- Allow the contractor to select the tieback anchor material and the installation technique. The shoring contractor should be contractually responsible for the design of the tieback anchors, as tieback capacity is largely a function of the means and methods of installation. The selected installation method must be confirmed using verification and proof-testing, as discussed in Attachment 1.
- Hart Crowser should review the design for anchor locations, capacities, and related criteria prior to implementation.

Permanent Subgrade Wall Design

This section and Figures 8 and 9 provide guidance for determining the permanent subgrade wall loads.

Earth Pressures

Permanent subsurface walls constructed adjacent to soldier pile shoring may be designed using the same earth pressure values and distribution that was used for shoring design. The earth pressure does not include surcharge loads such as loads from adjacent buildings; these must be calculated separately and added to get the total permanent lateral pressure.

Permanent walls that are backfilled and are not adjacent to shoring walls should be designed using a triangular earth pressure distribution. For typical granular fill soil, active and at-rest pressures may be determined using the equivalent fluid unit weights in Table 5. Note that the equivalent fluid density does not include any surface loading conditions or loading due to groundwater hydrostatic pressure; also, the ground surface behind the wall is assumed to be horizontal. Walls without drainage must be designed for full hydrostatic pressure.

The use of active and passive pressure is appropriate if the wall is allowed to yield a minimum of 0.001 times the wall height. For a non-yielding wall, at-rest pressures should be used.

Table 5 – Soil Equivalent Fluid Unit Weights for Walls Backfilled with Structural Fill

Soil Type	Parameter	Value (pcf)
Structural fill	Active earth pressure	35
	At-rest earth pressure	55
	Passive earth pressure ^a	300

Note:

a. Includes a factor of safety of 1.5.

Hydrostatic Groundwater Pressure

For walls permanently drained over the full height of the wall, hydrostatic groundwater pressure buildup is prevented and permanent wall design may neglect groundwater pressure. Hydrostatic uplift of the mat slab can be prevented by installing a drainage system beneath the mat slab.

For walls and floors that are not drained, a triangular lateral hydrostatic pressure of $62.4h_w$ psf should be added, where h_w is the depth of structure below the design groundwater level. The depth of the basement is expected to be above the regional groundwater table. However, perched groundwater will exert full hydrostatic pressure against the walls if they are not adequately drained. For undrained walls, we recommend a design water level of 5 feet bgs.

Seismic Earth Pressure on Walls

Lateral earth pressures based on the design earthquake for active and at-rest conditions can be assumed as uniform pressures in pounds per square foot of $8H$ and $12H$ (where H is the height of the wall in feet), respectively. The seismic earth pressure should be applied from the top of the wall to the bottom of the excavation, as shown on Figure 9. This seismic earth pressure is calculated using the 2012 IBC design hazard level for the site.

Surcharge Pressures on Walls

The pressures shown on Figures 7 and 9 do not include surcharge loads due to buildings, footings, heavy equipment, large stockpiles, and so forth. These loads must be calculated separately, using the methods shown on Figure 8 or similar, and added to the pressures determined using Figures 7 and 9.

We recommend Hart Crowser review or complete the estimated surcharge loads when surcharge loads, footprints, and foundation plans of adjacent structures are available.

Foundation Design Recommendations

We recommend using shallow spread footings bearing on competent soil. For shallow spread foundations bearing on competent soils we recommend an allowable bearing capacity of 3 kips per square foot (ksf). We expect less than 1 inch of post-construction settlement for foundations bearing on competent soils.

Figure 10 provides a contour map of the estimated elevation of the top of competent soils. The contours on Figure 10 are only an estimate and some amount of overexcavation and replacement with structural fill should be expected in order to reach competent soils. Also, any soil on site that is not firm and unyielding, or that is otherwise considered inadequate by Hart Crowser, will need to be over-excavated and replaced with structural fill or controlled density fill (CDF).

At the ramp location in the northwest corner of the site, we recommend over-excavating the ramp subgrade soils down to competent soil and then backfilling back up to ramp subgrade elevation with structural fill. The bottom of footings at the ramp location should be below the ramp backfill.

GROUNDWATER CONTROL

Slug Results

Water levels and slug testing results are presented in Attachment 1 and may be used for design of construction dewatering and estimating water flow into a permanent drainage system. Based on the slug test results we recommend average hydraulic conductivities for wells screened in Soil Unit 3, sand and silty sand, 9.0×10^{-5} to 8.3×10^{-4} centimeters per second (0.3 to 2.4 feet per day).

Temporary Construction Dewatering

Because construction will likely extend below the water table, temporary construction dewatering to maintain suitable working conditions in the excavation will be required. Water collected and discharged during construction will include surface water from precipitation and groundwater and may include process water from construction activities. For excavations to about elevation 70 feet, groundwater inflow is expected to be minimal and we expect that groundwater can be managed using trenches and sumps. For excavations deeper than elevation 70 feet, we recommend active dewatering during construction. We expect that the most efficient dewatering system will be a vacuum wellpoint system installed through the shoring system into saturated sands.

Our field testing and analysis results indicate that groundwater discharge during temporary construction dewatering could be on the order of 25 to 100 gallons per minute for an excavation to elevation 60 feet. Stormwater and process water are not included in this estimate and would generate additional water.

The amount of water discharged from the site depends on many factors including design and operation of the dewatering system (if applicable), the excavation depth and extent, and the variability in soil and groundwater properties. Rainfall, surface water, and groundwater from adjacent utility trenches can significantly increase short-term water discharge rates. Also, the time of year and nearby construction dewatering activities can affect groundwater flows.

Permanent Drainage

We modeled groundwater using the results of our field testing and the excavation footprint. Using the modeling results, we estimate that the average, long-term drainage rates for a subsurface drainage

system are on the order of 10 to 25 gallons per minute. Based on this low discharge rate, it should be feasible to construct the basement using permanent drainage. With a permanent subsurface drainage system, the structure does not have to be designed for hydrostatic groundwater pressure or as a “bathtub.” Limited waterproofing, such as bentonite panels, may be desirable at below-grade stairwells, elevator shafts, equipment rooms, and so forth to reduce seepage potential at the concrete joints. Additional recommendations for permanent drainage are provided below.

Walls Placed Against Shoring

Drainage board (e.g., Miradrain 6100) should be placed full coverage across the shoring wall below elevation 70 feet. Above elevation 70 feet, drainage panel coverage may be reduced to 2-foot-wide strips placed in between the soldier piles and up to the ground surface. The drainage board should be connected to a collector pipe and conveyed to a suitable discharge point.

Slabs-on-Grade

- Slab-on-grade floors should be underlain by a drainage layer consisting of at least 12 inches of free-draining material. We recommend mineral aggregate Type 21 or Type 22, City of Seattle Standard Specification 9-03.16, with the exception that this material should have less than 10 percent sand and less than 3 percent fines based on the minus-3/4 inch fraction.
- Drainage layer material should be submitted to Hart Crowser for gradation analysis and approval.
- Perimeter and cross drains should be placed at the bottom of the drainage layer.
- Cross drains should be spaced no more than 30 feet apart and perimeter drains should extend around the perimeter of the building. The cross drains and the perimeter drains should be tied together and sloped to drain to a suitable discharge point.
- A layer of polyethylene sheeting should be used to protect the drainage layer from concrete as the floor slab is poured.
- Drainage material should be compacted to 90 percent of maximum dry density as determined by the Modified Proctor Method, ASTM D 1557.

Backfilled Walls

Walls with soil backfilled on only one side will require drainage or they must be designed for full hydrostatic pressure. We recommend the following:

- Backfilling should be done with a minimum thickness of 18 inches of free-draining sand or sand and gravel that is well-graded (i.e., that has a wide range in particle size).
- Drains should be installed behind any backfilled subgrade walls. The drains, with cleanouts, should consist of perforated pipe a minimum of 4 inches in diameter placed on a bed of, and surrounded by, at least 6 inches of free-draining sand or sand and gravel. The drains should be sloped to carry the water to a sump or other suitable discharge.

- The backfill should be continuous and should envelop the drainage behind the wall.
- The drainage fill surrounding the pipe should be compatible with the size of the holes in the pipe.

Final Site Drainage

- The site should be graded in such a way that surface water will not pond near the structures.
- Roof drains should not be connected to the subgrade drainage system and should be sloped and tightlined to a suitable outlet away from the proposed building.

Pavement Areas

The pavement areas should be graded in such a way that surface water will not pond and will drain to a suitable outlet.

GEOTECHNICAL RECOMMENDATIONS FOR CONSTRUCTION

Soldier Pile Installation

- Installation methods should minimize caving soils or loosening of soil at the bottom of the drilled shaft which can reduce the bearing capacity in the zone of disturbed soil. Groundwater increases the chances of soil disturbance.
- Tieback de-tensioning and shoring failure could occur if bearing capacity is inadequate and soldier piles settle under the vertical component of the inclined tieback load. We recommend that a Hart Crowser representative closely monitor soldier pile installation for these conditions so construction methods can be adjusted accordingly.
- The contractor should be prepared to case the soldier pile holes where loose soils or groundwater seepage could cause loss of ground. Fill soils can be especially prone to caving and may require casing. The actual need for casing should be determined in the field at the time of installation.
- If the shaft excavation contains water or slurry, the contractor should tremie concrete to the bottom of the hole. Lean mix, concrete, and controlled density fill should not be end-dumped through water or slurry.
- The contractor should be prepared to excavate the soldier piles in a manner that prevents heave or boiling at the bottom of the soldier pile excavation. It may be possible to over-drill the borehole and backfill the bottom of the borehole with structural concrete bearing on undisturbed soil.
- Drilling mud should not be used unless reviewed and approved by Hart Crowser and the structural engineer.

- Soldier pile shoring construction may be difficult if cobbles or loose sand and gravel are encountered in the excavation. If these conditions are encountered, substantial soil raveling could occur. If raveling soils are encountered, we recommend shaft construction methods such as slurry or temporary casing be used to minimize raveling and loss of soil.

Lagging Installation

- Prompt and careful installation of lagging, particularly in areas of seepage and loose soil, is important to maintain the integrity of the excavation. The contractor should be prepared to place lagging in small vertical increments and should also be prepared to backfill voids caused by ground loss behind the shoring system. The proper installation should be the responsibility of the shoring contractor to prevent soil failure or sloughing and loss of ground, and to provide safe working conditions.
- Voids greater than 1 inch should be backfilled with sand, pea gravel, or a porous slurry. The void spaces progressively as the excavation deepens. The backfill must not allow potential hydrostatic pressure buildup behind the wall. Drainage behind the wall must be maintained or hydrostatic water pressure should be added to the recommended lateral earth pressures.
- If there is a slope above the wall, extra lagging should be installed above the shoring wall to provide a partial barrier for material that could ravel down from the slope face and fall into the excavation.

Tieback Installation

- Structural grout should be pumped into the anchor zone using a grout hose or tremie hose placed at the bottom of the anchor.
- The portion of the tieback in the no-load zone should be filled with a non-cohesive mixture of sand-pozzolan-water or equivalent; or, a bond breaker such as plastic sheathing or a PVC pipe should be installed around the tie rods within the no-load zone.
- Tiebacks should be grouted and backfilled immediately after placing the anchor. To prevent collapse of the holes, ground loss, and surface subsidence, anchor holes should not be left open overnight.
- Care should be taken not to mine out large cavities in granular soil.
- Continuous cutting return should be maintained if pneumatic drilling techniques are used, so that air pressure is not channeled to nearby utility vaults, corridors, or subgrade slabs, which may be damaged by air pressure.
- Anchors should be installed to minimize ground loss and previously installed anchors should not be disturbed. During tieback drilling, wet or saturated zones may be encountered and caving or

blow-in could occur. Drilling with a casing may reduce the potential for these conditions and ground loss.

- Tiebacks should be tested to confirm the appropriateness of the anchor design values and to verify that a suitable installation is achieved. The recommended procedures for verification and proof-testing are provided below.

Recommendations for Tieback Testing

The tieback anchor testing program should include verification testing of select tiebacks and proof testing of all production tiebacks. We recommend that tieback testing be done in general accordance with the recommendations in the publication Recommendations for Prestressed Rock and Soil Anchors by the Post Tensioning Institute (PTI 2004) and the recommendations below.

Verification Tests

We recommend a minimum of two verification tests per soil type before installation of production anchors to validate the design pullout value. The geotechnical engineer will select the testing locations with input from the shoring subcontractor. The geotechnical engineer or shoring designer may require additional verification tests when creep susceptibility is suspected or when varying ground conditions are encountered.

Verification tiebacks should be installed by the same methods and personnel, using the same material and equipment, as the production tiebacks; the engineer will determine whether deviations require additional verification testing. At least two successful verification tests should be performed for each installation method and each soil type.

Verification tests load the tieback to 200 percent of the DL and include a 60-minute hold time at 150 percent of the DL. The tieback DLs will be on the shoring drawings. The tieback load should not exceed 80 percent of the steel's ultimate tensile strength. Verification test tiebacks should be incrementally loaded and unloaded using the schedule in Table 11.

Table 11 – Tieback Verification Test Schedule

Load Level	Hold Time
Alignment load	Until stable
0.25DL	10 min
0.5DL	10 min
0.75DL	10 min
1.0DL	10 min
1.25DL	10 min
1.5DL	60 min
1.75DL	10 min
2.0DL	10 min

The alignment load should be the minimum load required to align the testing assembly and should be less than 5 percent of the DL. The dial gauge should be zeroed after the alignment load has stabilized. Perform a creep test at 1.5DL by holding the load constant to within 50 psi and recording deflections at 1, 2, 3, 5, 6, 10, 20, 30, 50, and 60 minutes.

The acceptance criteria for a verification test are:

- The creep rate at 1.5DL is less than 0.08 inches between 6 and 60 minutes and the creep rate is linear or decreasing during the creep test;
- The total tieback displacement is greater than 80 percent of the theoretical elastic elongation of the design unbonded length plus the jack length; and
- The anchor does not pull out under repeated loading.

Proof Tests

Proof tests load the tieback to 1.33DL and include a 10-minute hold time at 1.33DL. The tieback DLs should be on the shoring drawings. The tieback load should not exceed 80 percent of the steel's ultimate tensile strength. Proof tests should be incrementally loaded and unloaded using the schedule in Table 12.

Table 12 – Tieback Proof Test Schedule

Load Level	Hold Time
Alignment load	Until stable
0.25DL	1 min
0.5DL	1 min
0.75DL	1 min
1.0DL	1 min
1.33DL	10 min

The alignment load should be the minimum load required to align the testing assembly and should be less than 5 percent of the design load. The dial gauge should be zeroed after the alignment load has stabilized.

The load should be held constant to within 50 psi and deflections recorded at 1, 2, 3, 5, 6 and 10 minutes. If the tieback deflection between 1 and 10 minutes at 1.33DL exceeds 0.04 inches, the load should be held for an additional 50 minutes and deflections recorded at 20, 30, 50, and 60 minutes.

The acceptance criteria for a proof test are:

- The creep rate at 1.33DL is less than 0.04 inches between 1 and 10 minutes or less than 0.08 inches between 6 and 60 minutes and the creep rate is linear or decreasing during the creep test;

- The total tieback displacement is greater than 80 percent of the theoretical elastic elongation of the design unbonded length plus the jack length; and
- The anchor does not pull out under repeated loading.

Shoring Monitoring

A shoring monitoring program provides early warning if the shoring does not perform as expected. The monitoring program should include a preconstruction survey, periodic surveys during construction, and a post-construction survey.

Preconstruction Survey

A preconstruction survey documents the condition of existing streets, utilities, and buildings. The survey should include video and/or photographic documentation. The size and location of existing cracks in streets and buildings should receive special attention and may be monitored with a crack gauge.

Construction Survey

We recommend adjacent building surveys, optical survey, and inclinometer survey be included in the shoring monitoring program during construction.

All monitoring data should be submitted to Hart Crowser for weekly review. The data will be included in our field transmittals to the project team during construction. Details of our expectations for shoring monitoring are included below.

Adjacent Building Surveys. We recommend that adjacent buildings be surveyed before, during, and after construction. The pre-construction survey will establish the baseline of existing conditions (e.g., identifying the size and locations of any cracks). The surveys should consist of a videotape and/or photographs of the interior and exterior of adjacent buildings and detailed mapping of all cracks. Any existing cracks could be monitored with a crack gauge.

Optical Surveying. We recommend optical surveys of horizontal and vertical movements of: (1) the surface of the adjacent streets, (2) buildings on and adjacent to the site, and (3) the shoring system itself. The contractor, in coordination with the geotechnical engineer, should establish two reference lines adjacent to the excavation at horizontal distances back from the excavation face of about $1/3 H$ and H , where H is the final excavation height. Typically, these lines will be established near the curb line and across the street from the excavation face. The points on the adjacent buildings can be set either at the base or on the roof of the buildings.

Shoring system monitoring should include measuring vertical and horizontal movement at the top of every other soldier pile, and any geotechnical instrumentation (e.g., inclinometers) used for the project.

The measuring system for the shoring monitoring should have an accuracy of at least 0.01 foot. All reference points on the ground surface should be installed and read before excavation begins. The frequency of readings will depend on the results of previous readings and the rate of construction. At a minimum, readings on the external points should be taken twice a week through construction until below-grade structural elements (floors, decks, columns, etc.) are completed, or as specified by the structural and geotechnical engineers. Readings on the top of soldier piles and the face of existing buildings on or adjacent to the property should be taken at least twice a week during this time. We recommend that an independent surveyor hired by the owner to record the data at least once per week with the other reading taken by the surveyor or contractor.

Inclinometer. We recommend installing at least one inclinometer casing behind each shoring wall. The final number and location of the casings should be coordinated with Hart Crowser and the contractor. Hart Crowser can be hired to install the casings behind the shoring using a subcontracted driller; or, the shoring contractor may install the inclinometer casings. We recommend inclinometer surveys at least once per week during shoring construction. After the perimeter footing has been placed and cured, Hart Crowser may elect to reduce the inclinometer survey frequency.

Post-Construction Survey

A post-construction survey includes reviewing the preconstruction survey and comparing it to post-construction conditions. The survey should include video and/or photographic documentation. Changes in the number, size and location of cracks in streets and buildings should be given special attention.

Foundation Construction

Hart Crowser must observe exposed subgrades before footing construction begins to confirm design assumptions about subsurface conditions and subgrade preparation.

The exposed subgrade should be carefully prepared and protected before concrete placement. Considering the high allowable bearing pressures, any loosening of the materials during construction could result in more settlement. It is important that foundation excavations be cleaned of loose or disturbed soil before placing any concrete and that there is no standing water in any foundation excavation. These conditions should be observed by our representative.

Maintain groundwater levels at least 2 feet below the base grade of the footing excavation at all times to prevent the risk of heave, piping, boiling, and other loss or disturbance of subgrade material. This groundwater level should be maintained until after the footing steel and concrete are placed.

Any loose or soft soils that occurs naturally or is disturbed during construction should be overexcavated and replaced with structural for footings. Any visible organic and other unsuitable material should be removed from the exposed subgrade.

It may be necessary to place a 2- to 4-inch-thick lean or structural concrete mat in footing excavations to protect subgrade soil from being softened by water or construction activities after it is exposed. Concrete may only be placed after the geotechnical engineer has checked the subgrade.

Lean mix concrete should be in accordance with 2011 City of Seattle Standard Specifications Section 6-02.3(2)D. Lean concrete should contain between 145 and 200 pounds of cement per cubic yard and have a maximum water-to-cement ratio of 2.

Earthwork

Site Preparation and Grading

We recommend conducting all site grading, paving, and any utility trenching during relatively dry weather conditions.

It may be necessary to relocate or abandon some utilities. Excavation of these utility lines will probably occur through backfill. Abandoned underground utilities should be removed or completely grouted. Ends of remaining abandoned utility lines should be sealed to prevent piping of soil or water into the pipe. Soft or loose backfill should be removed, and excavations should be backfilled with structural fill. Coordination with the utility agency is generally required.

Structural Fill

Backfill placed within the building area or below paved areas should be considered structural fill. We recommend the following for structural fill:

- For imported soil to be used as structural fill, a clean, well-graded sand or sand and gravel with less than 5 percent by weight passing the No. 200 mesh sieve (based on the minus 3/4-inch fraction) should be used. Compaction of soil containing more than about 5 percent fines may be difficult if the material is wet or becomes wet during rainy weather.
- All structural fill should be placed and compacted in lifts with a loose thickness no greater than 10 inches. For hand-operated “jumping jack” compactors, loose lifts should not exceed 6 inches. For small vibrating plate/sled compactors, loose lifts should not exceed 3 inches.
- All structural fill should be compacted to at least 95 percent of the modified Proctor maximum dry density (as determined by ASTM D1557 test procedure).
- The moisture content of the fill should be controlled to within 2 percent of the optimum moisture. Optimum moisture is the moisture content corresponding to the maximum Proctor dry density.
- In wet subgrade areas, clean material with a gravel content of at least 30 to 35 percent may be necessary. Gravel is material coarser than a US No. 4 sieve.
- Before filling begins, samples of the structural and drainage fill should be provided for laboratory testing. Laboratory testing will include a Proctor test and gradation for structural fill and a

gradation for drainage fill. Field testing with a nuclear density gauge uses the maximum dry density determined from a Proctor test so it is important to complete the laboratory testing as soon as possible so backfilling is not delayed.

Use of On-Site Soil as Structural Fill

Our explorations indicated that the near-surface site soil includes silty sand, silt, and clay; we do not recommend using these soils for structural fill. The deeper sand and gravel soils may be used, but they are likely to contain more than 5 percent fines; they will be moisture-sensitive and could be difficult to compact in wet weather.

Temporary Cuts

Because of the variables involved, actual slope grades required for stability in temporary cut areas can only be estimated before construction. We recommend that stability of the temporary slopes used for construction be the sole responsibility of the contractor, since the contractor is in control of the construction operation and is continuously at the site to observe the nature and condition of the subsurface. Excavations should be made in accordance with all local, state, and federal safety requirements.

For planning purposes, the soils across the site are likely OSHA Soil Classification Type C; however, the soil classification must be reevaluated at the time of construction.

The stability and safety of open trenches and cut slopes depend on a number of factors, including:

- Type and density of the soil;
- Presence and amount of any seepage;
- Depth of cut;
- Proximity of the cut to any surcharge loads near the top of the cut, such as stockpiled material, traffic loads, or structures;
- Duration of the open excavation; and
- Care and methods used by the contractor.

Considering these factors, we recommend:

- Using plastic sheeting to protect slopes from erosion; and
- Limiting the duration of open excavations as much as possible.

RECOMMENDATIONS FOR CONTINUING GEOTECHNICAL SERVICES

Before construction begins, we recommend that Hart Crowser continue to meet with the design team as needed to address geotechnical questions that may arise throughout the remainder of the design and permitting process. We also recommend that Hart Crowser review the project plans and specifications to confirm that the geotechnical engineering recommendations have been properly interpreted.

During construction, we recommend that Hart Crowser be retained to perform the following tasks:


- Review contractor submittals;
- Observe shoring installation;
- Observe foundation installations;
- Observe foundation drainage installation;
- Perform other observations as required by the Seattle Department of Planning and Development;
- Attend meetings, as needed; and
- Provide geotechnical engineering support that may arise during construction.

REFERENCES

FHWA 1999. Geotechnical Engineering Circular No. 4, Ground Anchors and Anchored Systems. FHWA-IF-99-015. June 1999.



IBC 2012. International Building Code. International Code Council.

PTI 2004. Recommendations for Prestressed Rock and Soil Anchors, Third Edition. Post Tensioning Institute.

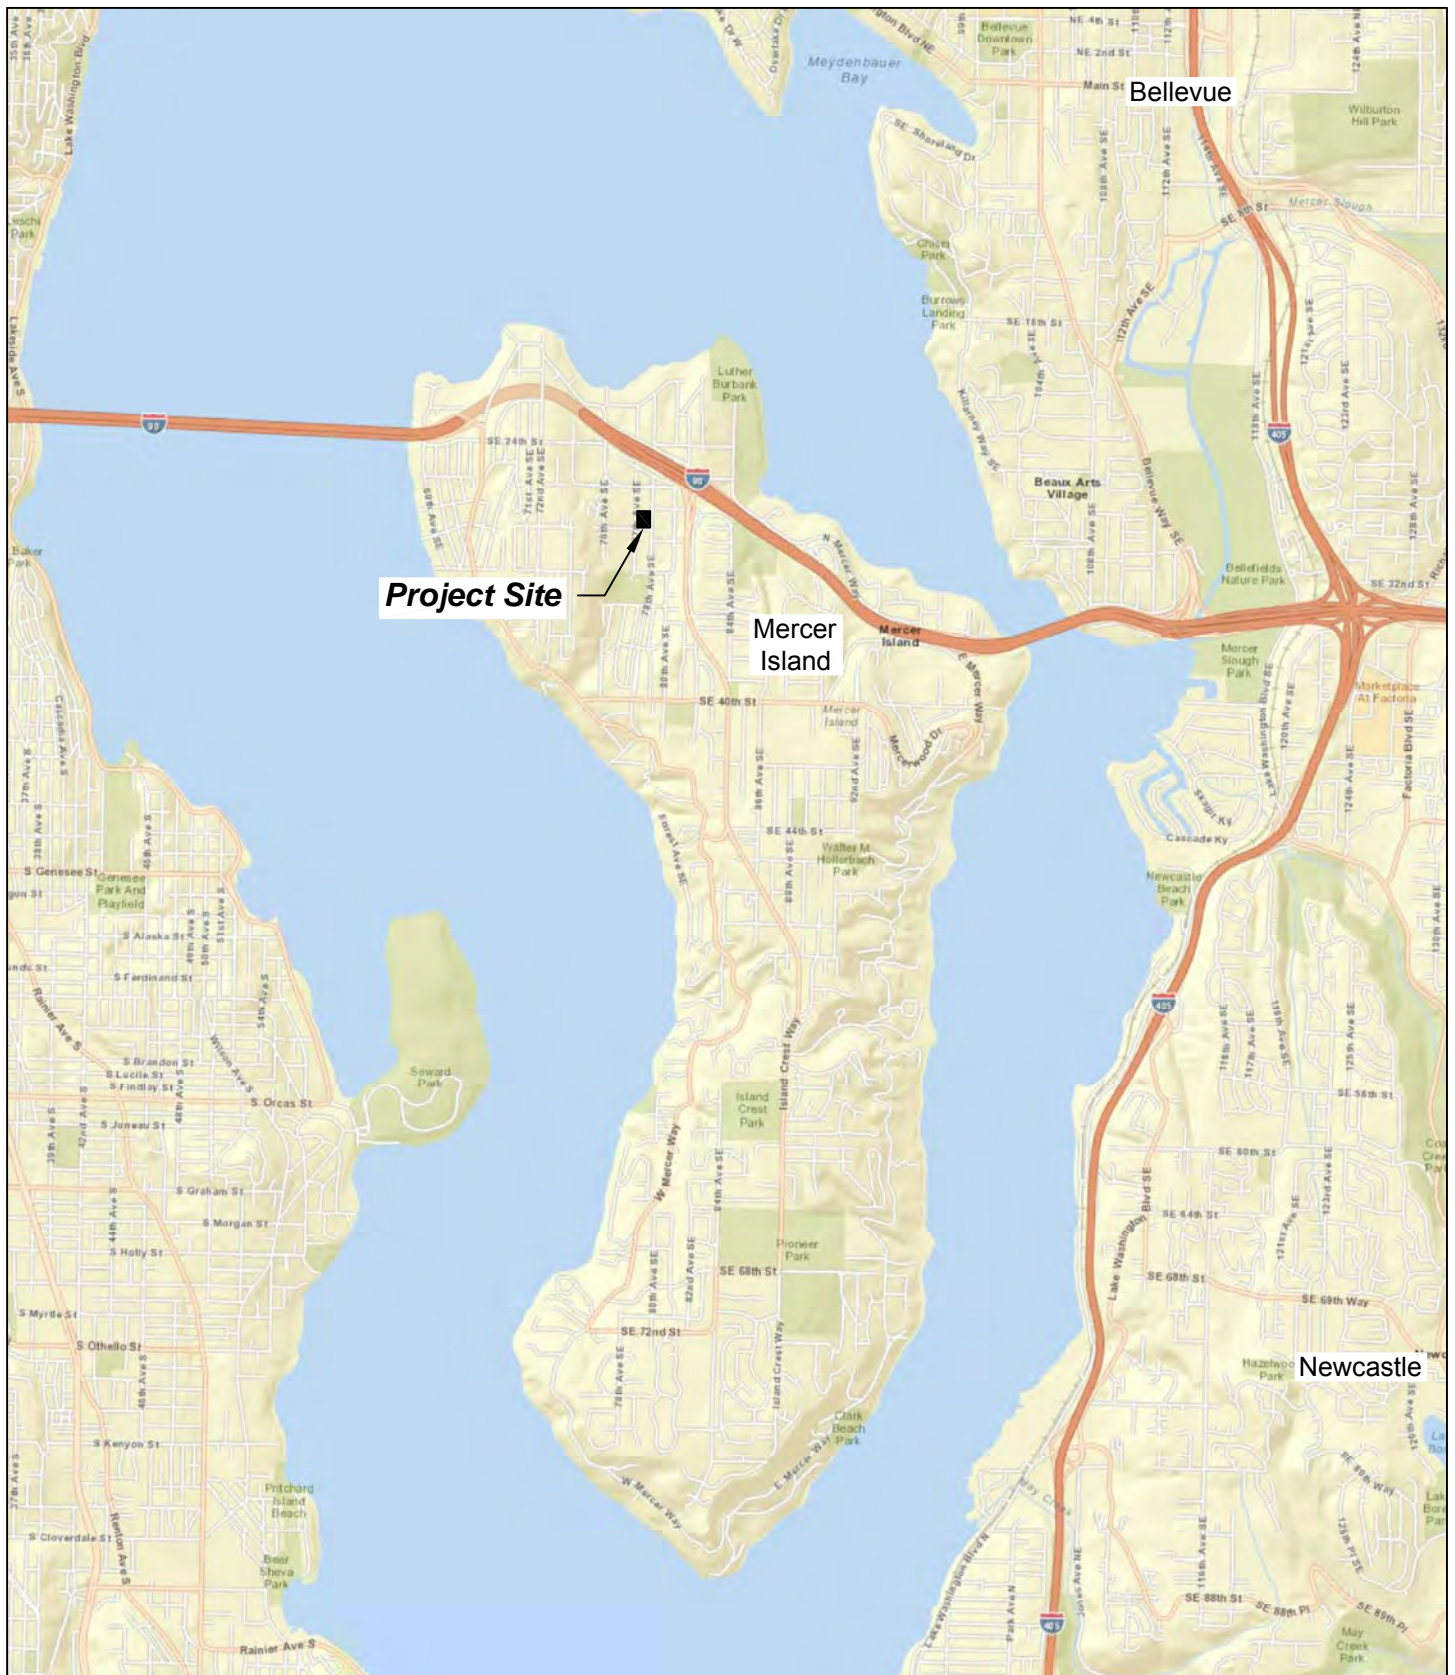

Source: Base map prepared from ArcGIS Online, 2013.

EAL 12/3/14 1798401-001.dwg



Mercer Island Multi-Family Development
Mercer Island, Washington

Vicinity Map


17984-01

12/14



Figure

1


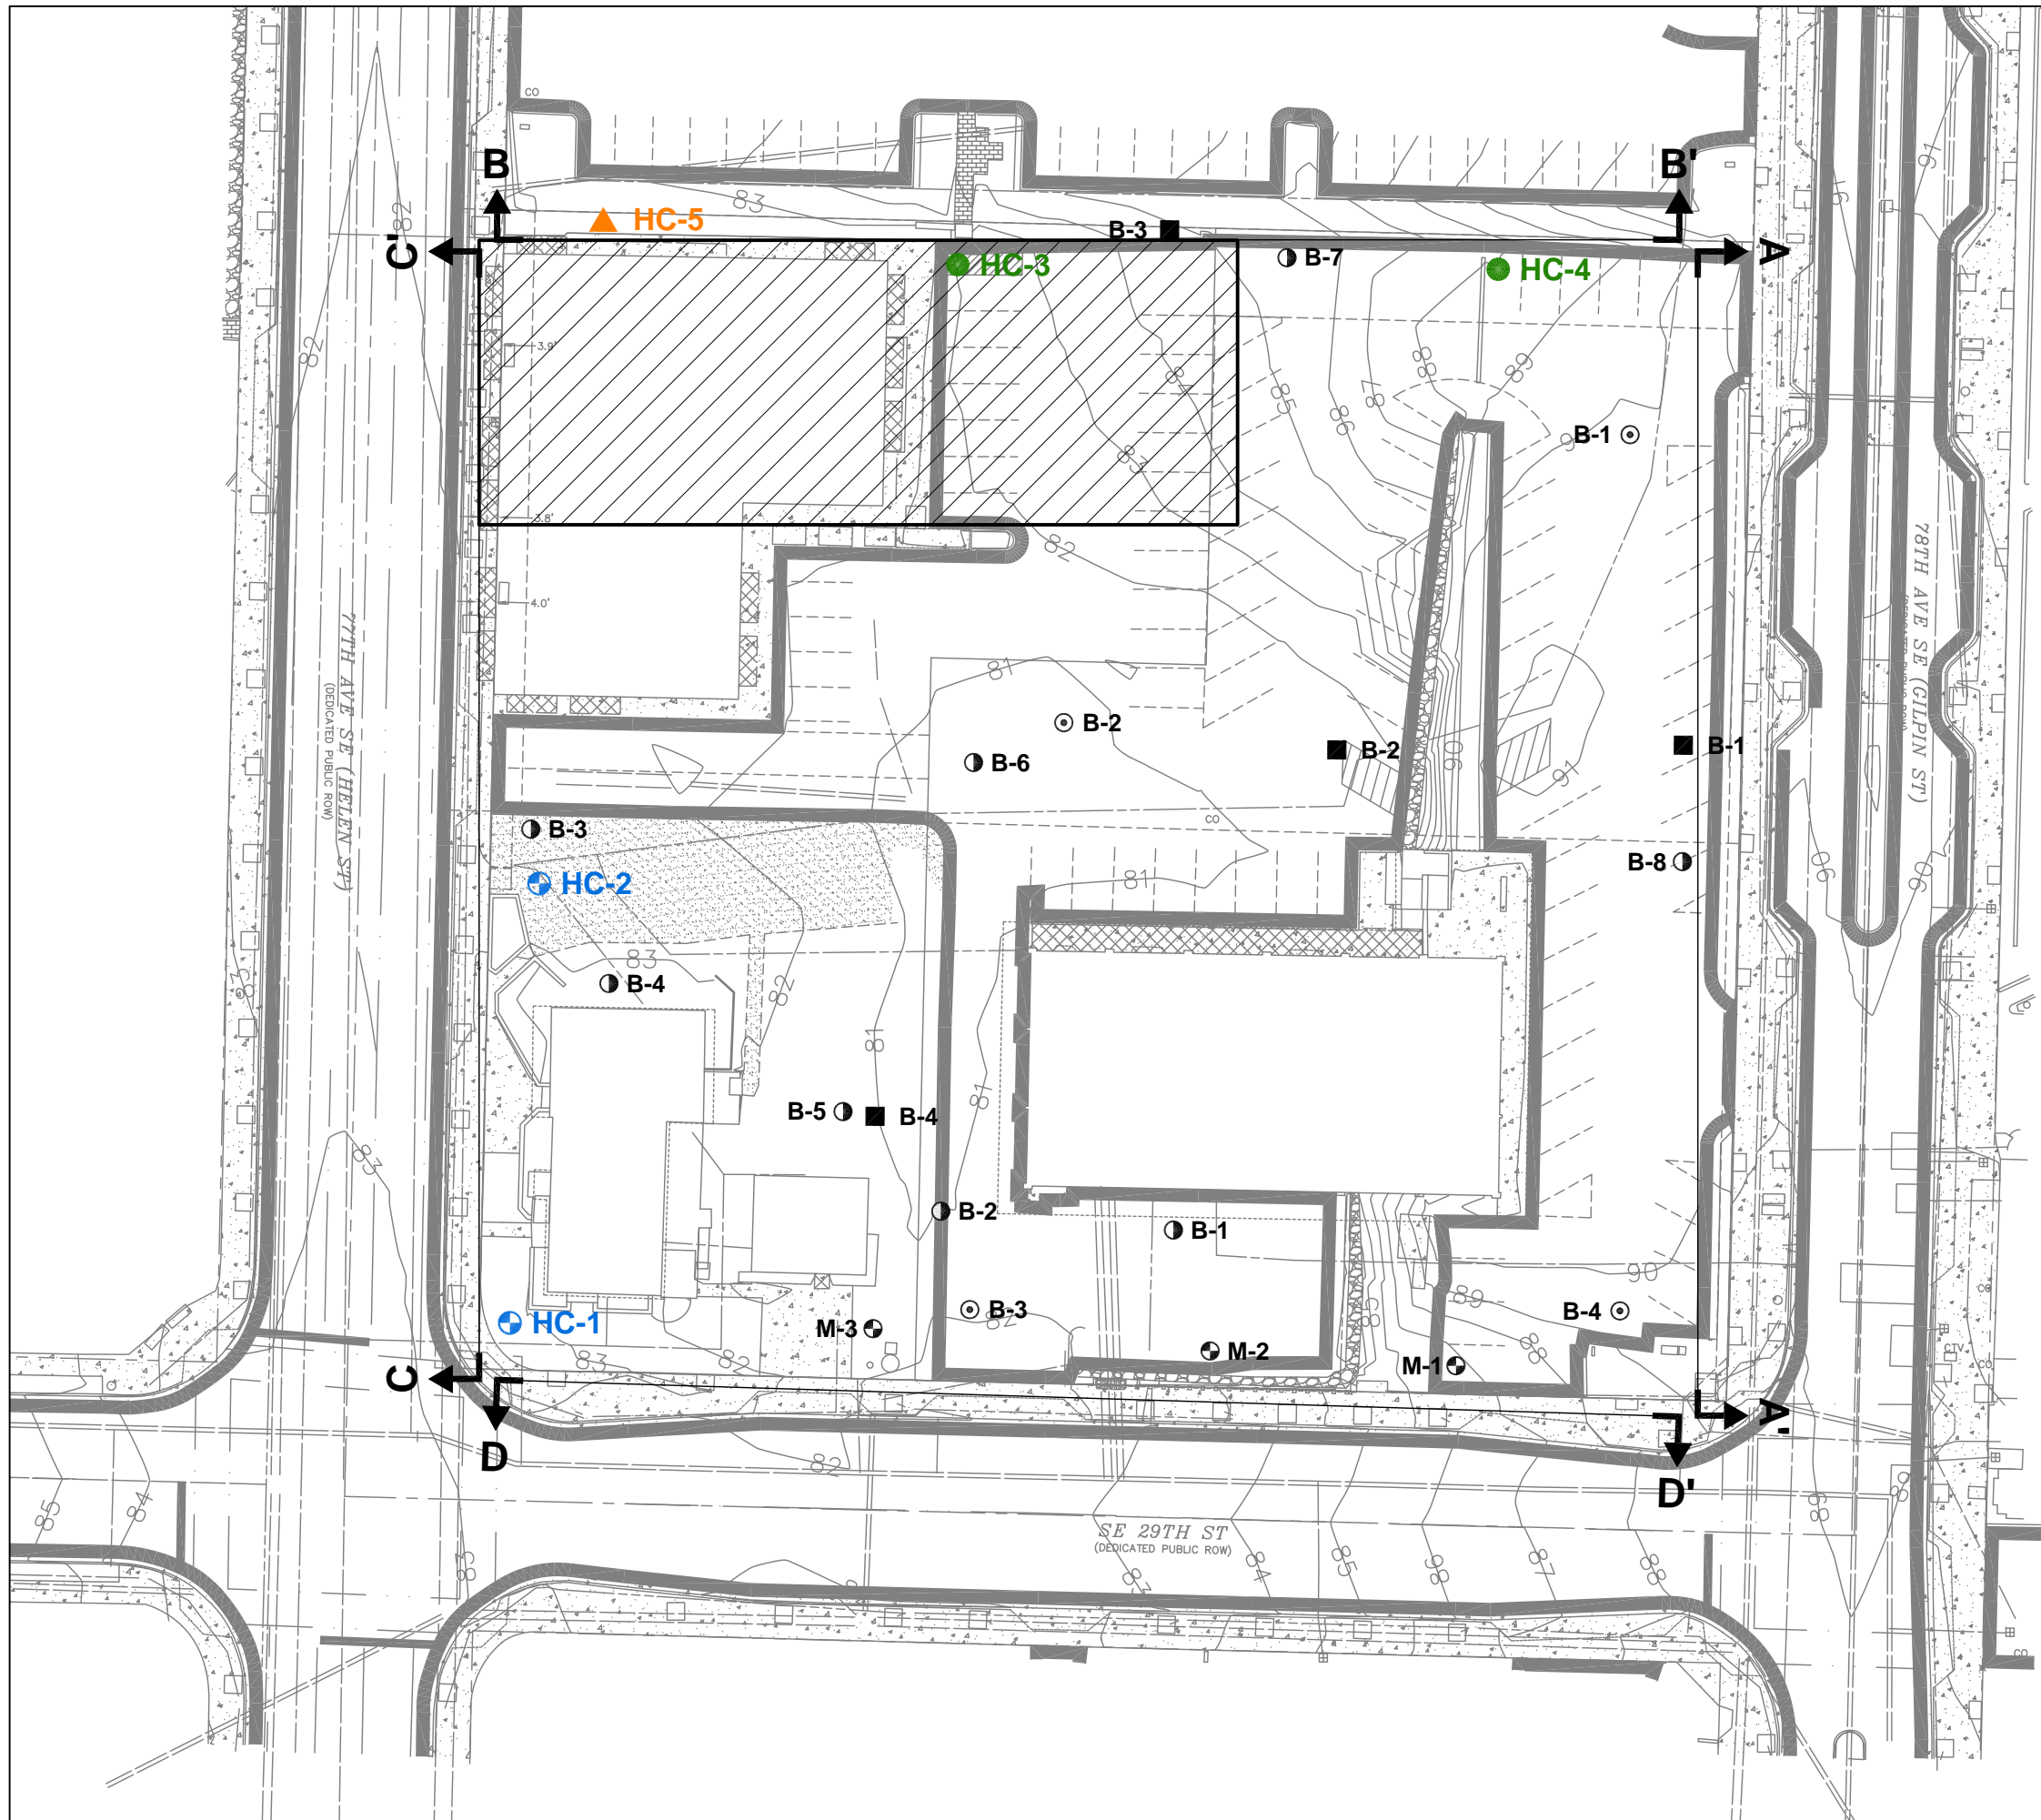


- Current Exploration Location and Number
- HC-3 ● Boring (Hart Crowser)
 - HC-5 ▲ Hand Probe (Hart Crowser)
 - HC-1 ● Monitoring Well (Hart Crowser)

- Previous Exploration Location and Number
- B-1 ■ Boring (ABPB Consulting)
 - B-6 ● Push Probe (Farallon)
 - M-1 ● Monitoring Well (ABPB Consulting)
 - B-1 ⊙ Boring (Terra)

A A' Approximate Cross Section Location and Designation

Approximate Ramp Location



Source: Base map prepared from survey "XS-ALTA-02.dwg," created by Bush, Roed & Hitchings, dated 10/14/14.

Mercer Island Multi-Family Development
Mercer Island, Washington

Site and Exploration Plan


17984-01

4/15




Figure

2

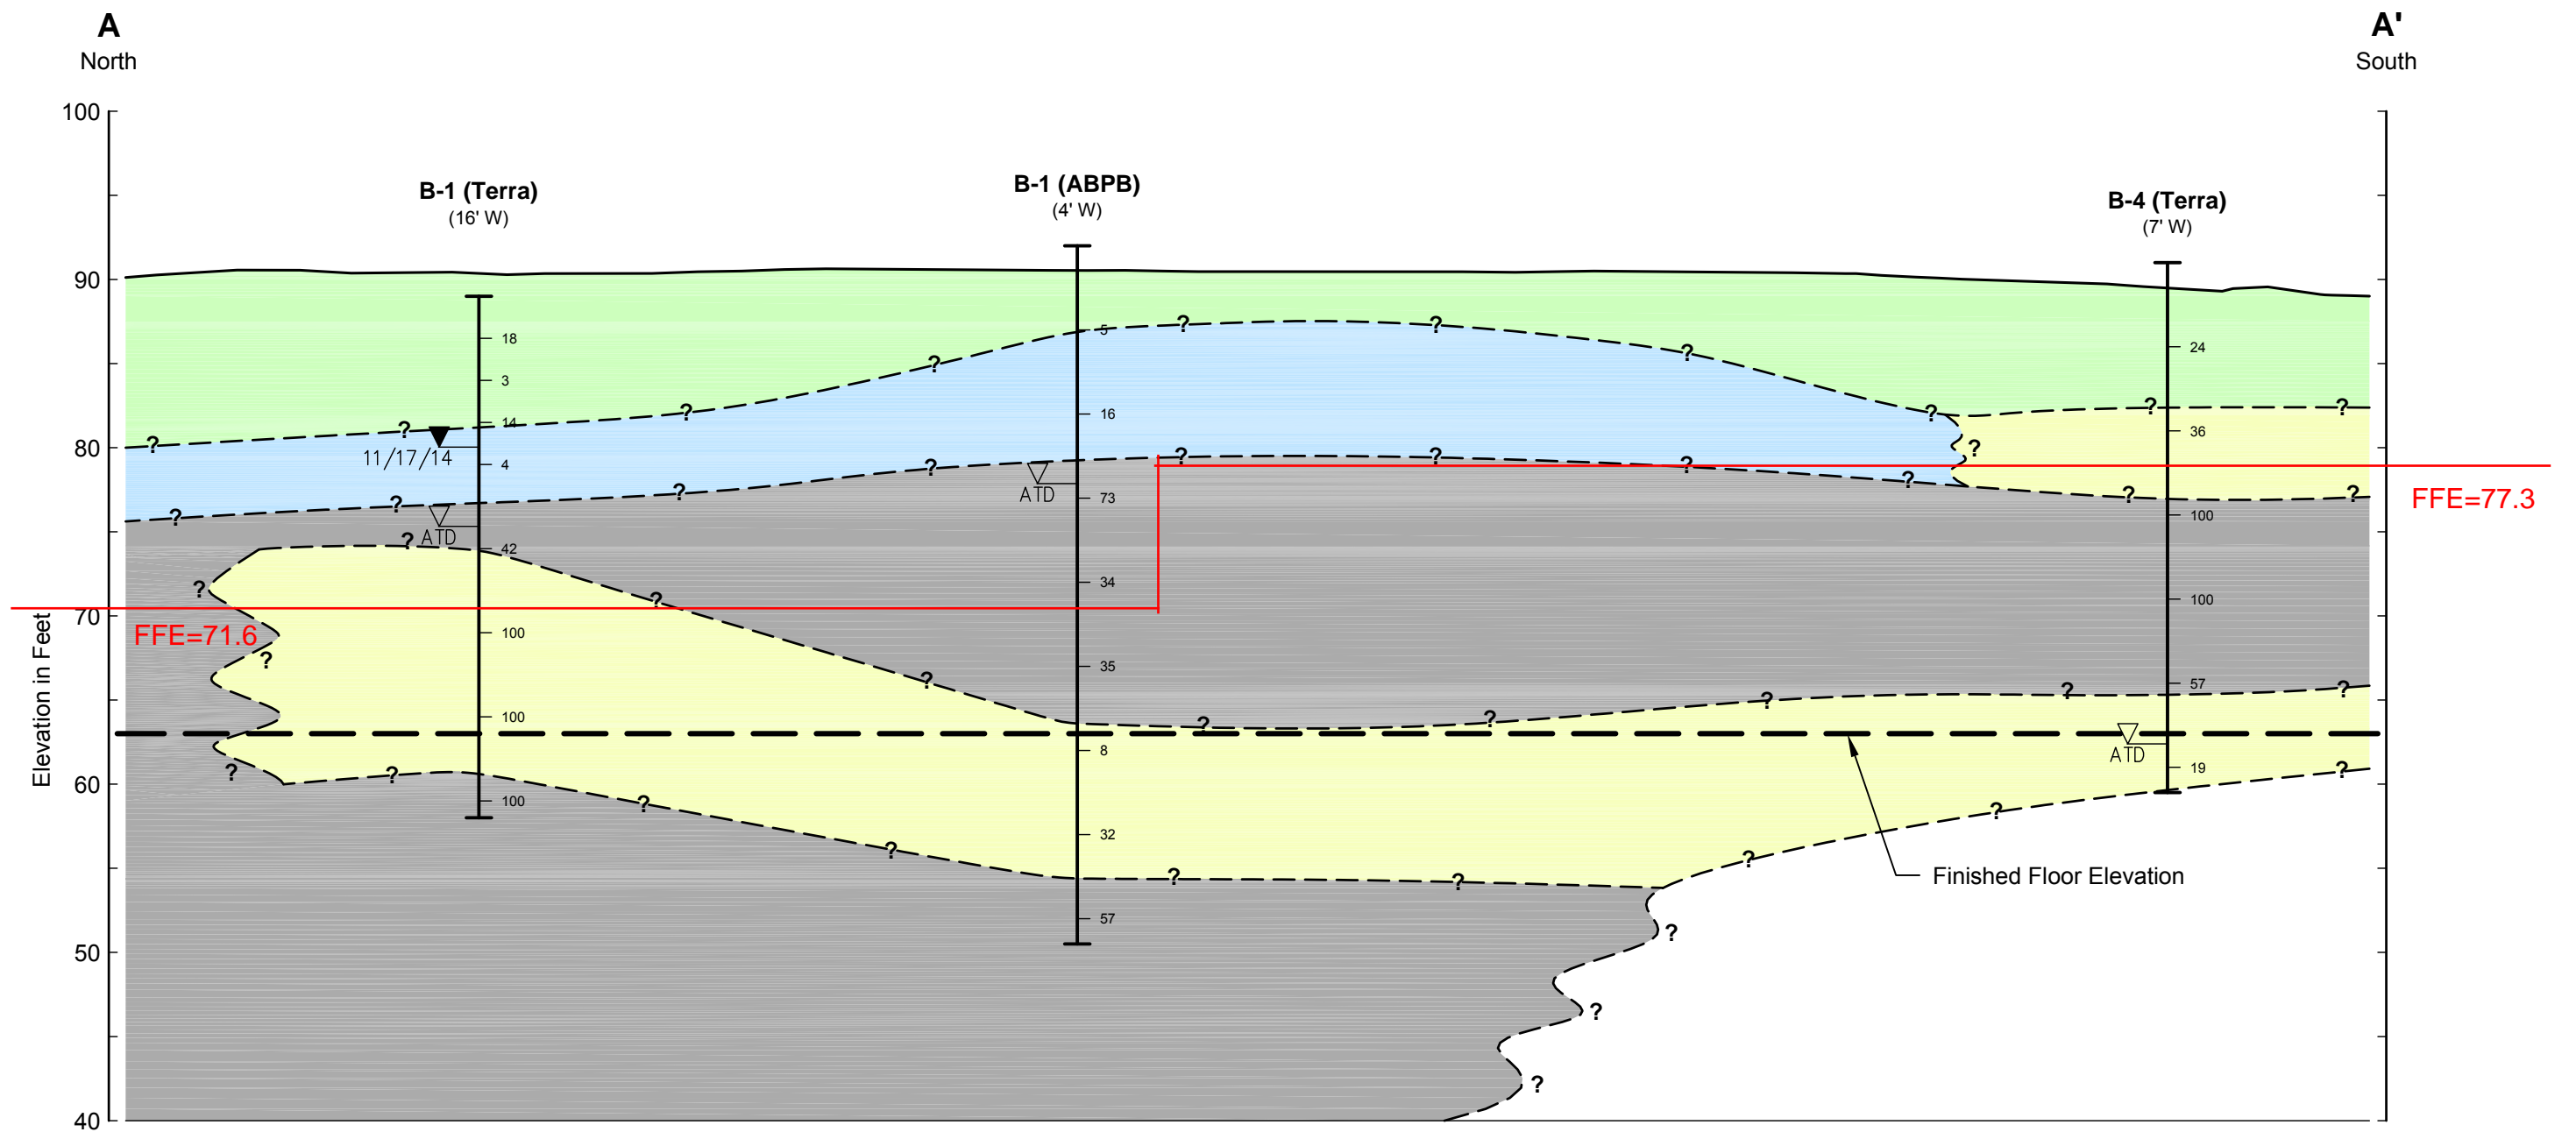

B-1 (Terra) Exploration Number
(16' W) (Offset Distance and Direction)




Exploration Location
 Water Level
 Standard Penetration Resistance in Blows per Foot


- Unit 1**
Loose to medium dense granular FILL, soft SILT, and PEAT
- Unit 2**
Medium stiff to hard SILT and silty CLAY
- Unit 3**
Medium dense to dense SAND and silty SAND
- Unit 4**
Hard SILT

Horizontal Scale in Feet
 0 20 40
 Vertical Scale in Feet
 0 10 20
 Vertical Exaggeration x 2


Mercer Island Multi-Family Development Mercer Island, Washington	
Generalized Subsurface Cross Section A-A'	
17984-01	4/15
	Figure 3

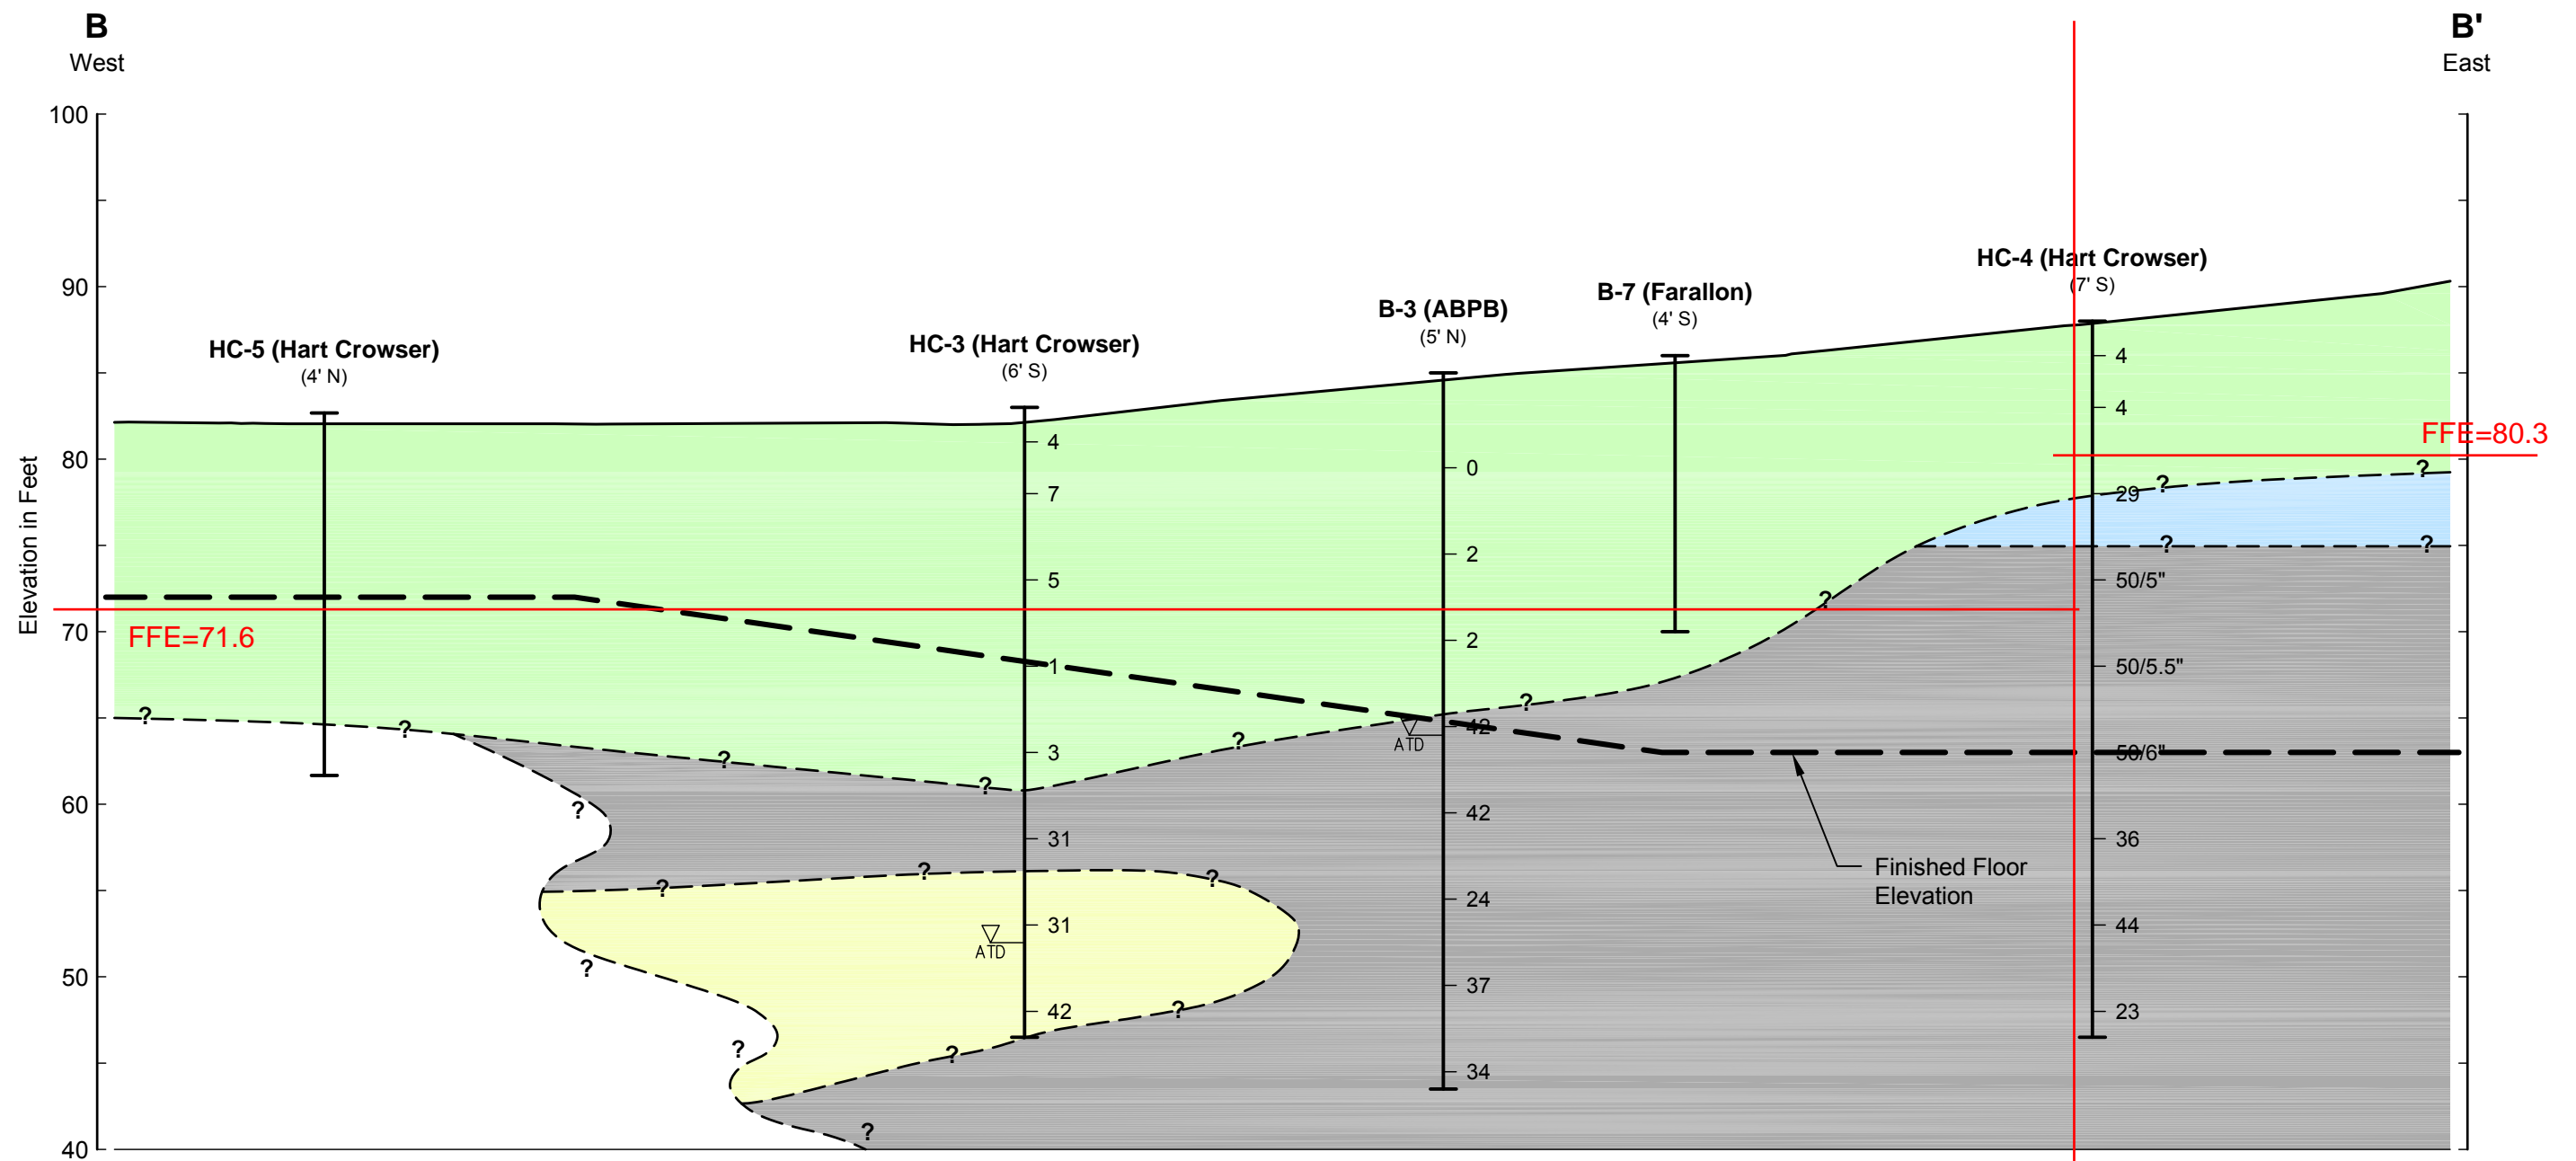

B-1 (Terra) Exploration Number
(16' W) (Offset Distance and Direction)




Exploration Location
Water Level
Standard Penetration Resistance in Blows per Foot



Unit 1
Loose to medium dense granular FILL, soft SILT, and PEAT



Unit 2
Medium stiff to hard SILT and silty CLAY



Unit 3
Medium dense to dense SAND and silty SAND



Unit 4
Hard SILT

Horizontal Scale in Feet
0 20 40
Vertical Scale in Feet
0 10 20
Vertical Exaggeration x 2

Mercer Island Multi-Family Development
Mercer Island, Washington

Generalized Subsurface Cross Section B-B'


17984-01

4/15




Figure


4

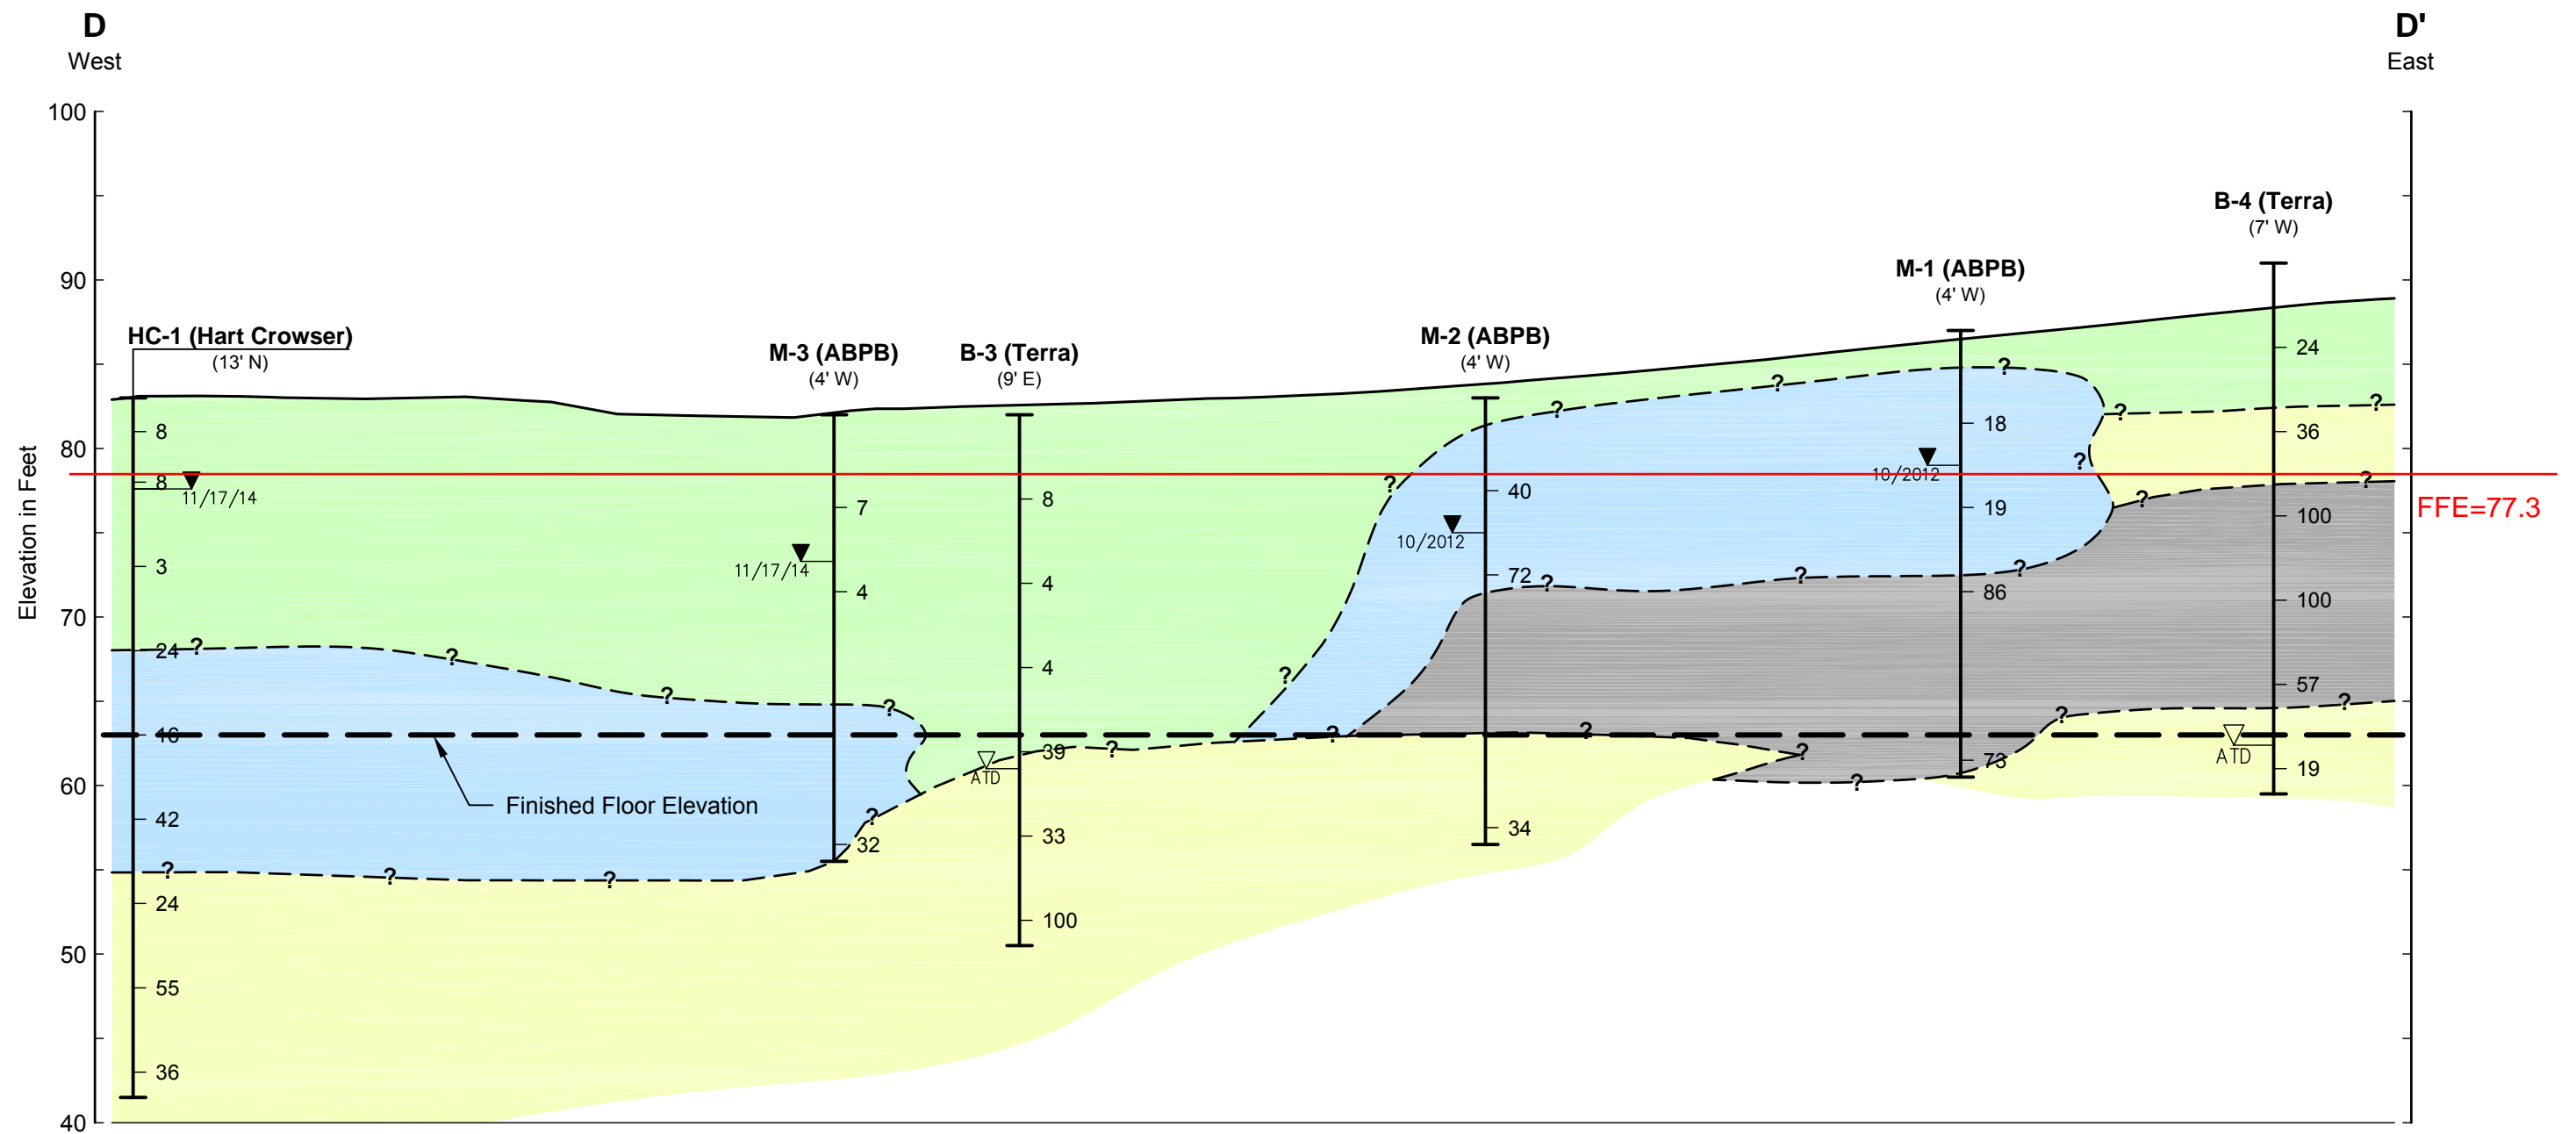

B-1 (Terra) (16' W)
 Exploration Number (Offset Distance and Direction)



Exploration Location
 Water Level
 Standard Penetration Resistance in Blows per Foot



Unit 1
 Loose to medium dense granular FILL, soft SILT, and PEAT


Unit 2
 Medium stiff to hard SILT and silty CLAY

Unit 3
 Medium dense to dense SAND and silty SAND

Unit 4
 Hard SILT


Horizontal Scale in Feet
 0 20 40
 Vertical Scale in Feet
 0 10 20
 Vertical Exaggeration x 2

Mercer Island Multi-Family Development Mercer Island, Washington	
Generalized Subsurface Cross Section D-D'	
17984-01	4/15
	Figure 6

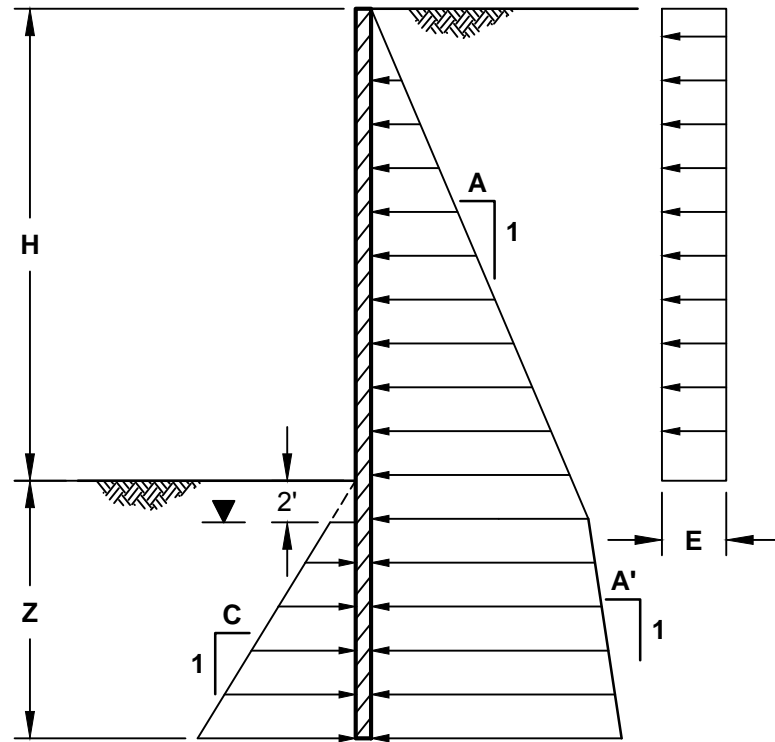


Passive Earth Pressure Active Earth Pressure Uniform Surcharge Pressure

Cantilever Soldier Pile

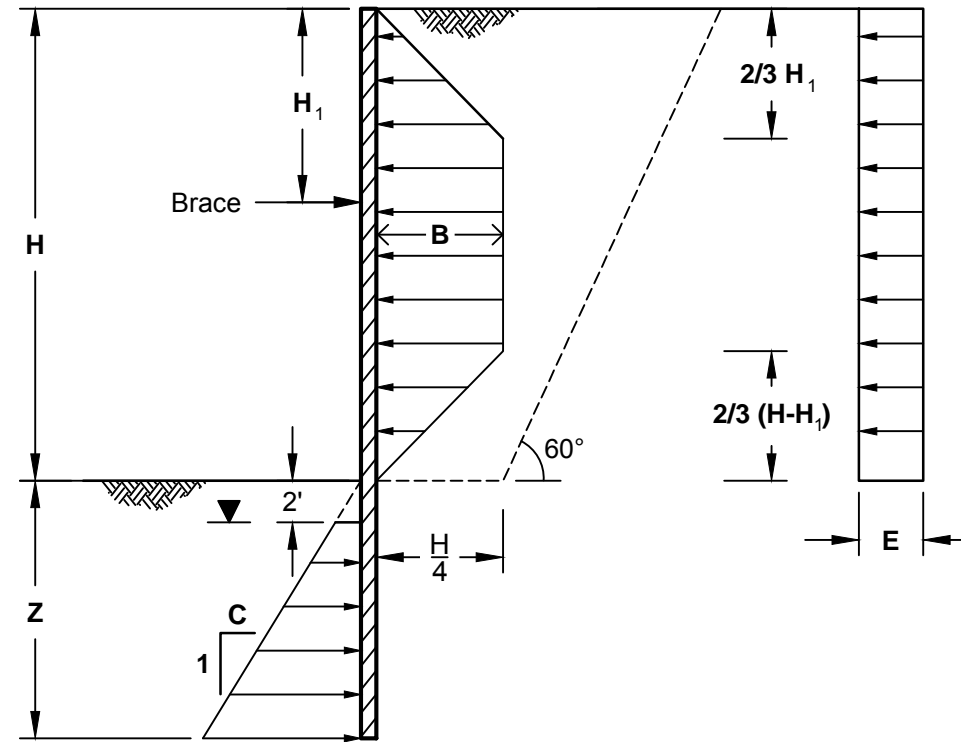

Passive Earth Pressure Apparent Earth Pressure Uniform Surcharge Pressure

Single Braced Wall

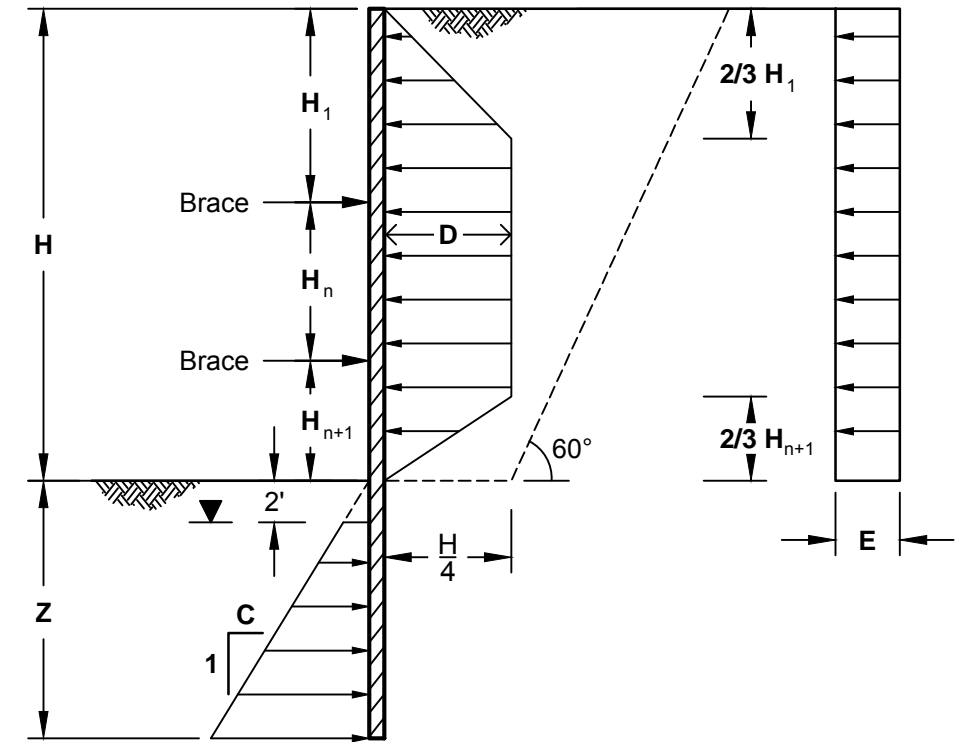

Passive Earth Pressure Apparent Earth Pressure Uniform Surcharge Pressure

Multiple Braced Wall

Recommended Lateral Earth Pressures

	A (Above GWT)	A' (Below GWT)	B	C (Above GWT)	C (Below GWT)	D	E
Active	42 pcf	21 pcf	42H psf	-	-	30H psf	85 psf
At-Rest	60 pcf	30 pcf	60H psf	-	-	45H psf	125 psf
Passive	-	-	-	300 pcf	175 pcf	-	-

Notes:


- All earth pressures are in units of pounds per square foot.
- Minimum recommended embedment (D) is 8 feet.
- Passive pressures are allowable values and include a 1.5 factor of safety.
- Passive pressure acts over 2.5 times the concreted diameter of the soldier pile or the the pile spacing, whichever is less.
- Apparent earth pressure, active earth pressure, and surcharge act over the pile spacing above the base of the excavation.
- Active pressure acts over the pile diameter below the excavation.
- Additional surcharge from footings, large stockpiles, heavy equipment, etc., must be added to these pressures.
- All dimensions are in feet.
- Diagrams are not to scale.

Legend


- H Total Height of Excavation, Feet
- H₁ Depth to Uppermost Tieback, Feet
- H_n Height Between Tiebacks, Feet
- H_{n+1} Distance from Base of Excavation to Lowermost Tieback, Feet
- Z Embedment Depth, Feet
- A,B,C, ... Earth Pressure Factors, See Table
- No-Load Zone
- ▼ Groundwater Table (GWT)

Mercer Island Multi-Family Development Mercer Island, Washington	
Lateral Earth Pressures Temporary Shoring	
17984-01	12/14
	Figure 7

**A. Strip Footing
Cross Section View**

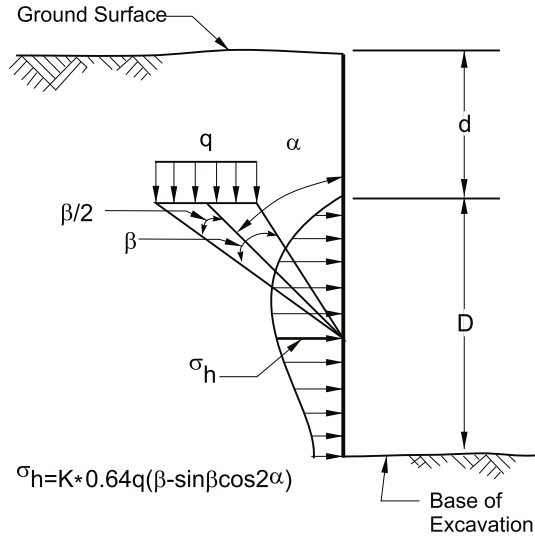

**B(1). Small Isolated Footing
Cross Section View**

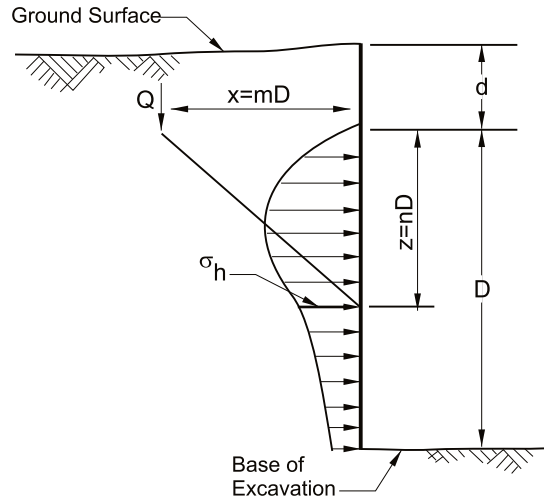


(For $m > 0.4$)

$$\sigma_h = K_1 \frac{1.77Q}{D^2} \frac{m^2 n^2}{(m^2 + n^2)^3}$$


(For $m \leq 0.4$)

$$\sigma_h = K_1 \frac{0.28Q}{D^2} \frac{n^2}{(0.16 + n^2)^3}$$

B(2). Plan View

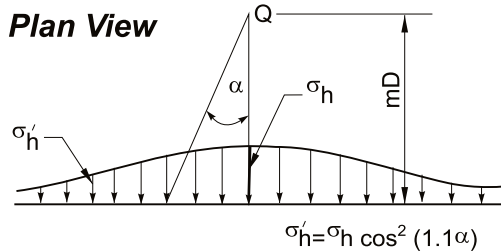

**C. Continuous Wall Footing
Parallel to Excavation
Cross Section View**

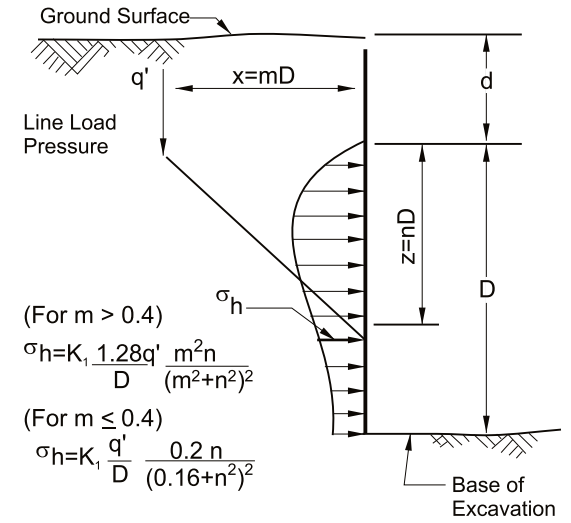

(For $m > 0.4$)

$$\sigma_h = K_1 \frac{1.28q' m^2 n}{D (m^2 + n^2)^2}$$

(For $m \leq 0.4$)

$$\sigma_h = K_1 \frac{q'}{D} \frac{0.2 n}{(0.16 + n^2)^2}$$

Definition and Units

- Q Footing Load in Pounds
- D Excavation Depth below Footing in Feet
- d Depth to Base of Footing in Feet
- σ_h Lateral Soil Pressure in PSF
- q Unit Loading Pressure in PSF
- q' Footing Load in Pounds per Foot
- α, β Radians

K_1	Conditions
0.35	Active earth pressure on a flexible wall (e.g., shoring)
0.5	At-rest conditions, where surcharge loads exist prior to excavation
1.0	At-rest conditions, where surcharge loads are applied after construction of permanent wall

- Notes:
1. Lateral pressures from adjacent structures should be added to lateral pressures on Figures 7 and 9.
 2. Wall footings acting other than parallel to the excavation can be treated as series of discrete point loads, using Approach B.
 3. Contact Hart Crowser for surcharge recommendations, if necessary.

Mercer Island Multi-Family Development
Mercer Island, Washington


Surcharge Pressures Determination of Lateral Pressure Acting on Adjacent Shoring

17984-01

HART CROWSER

Figure 8

12/14

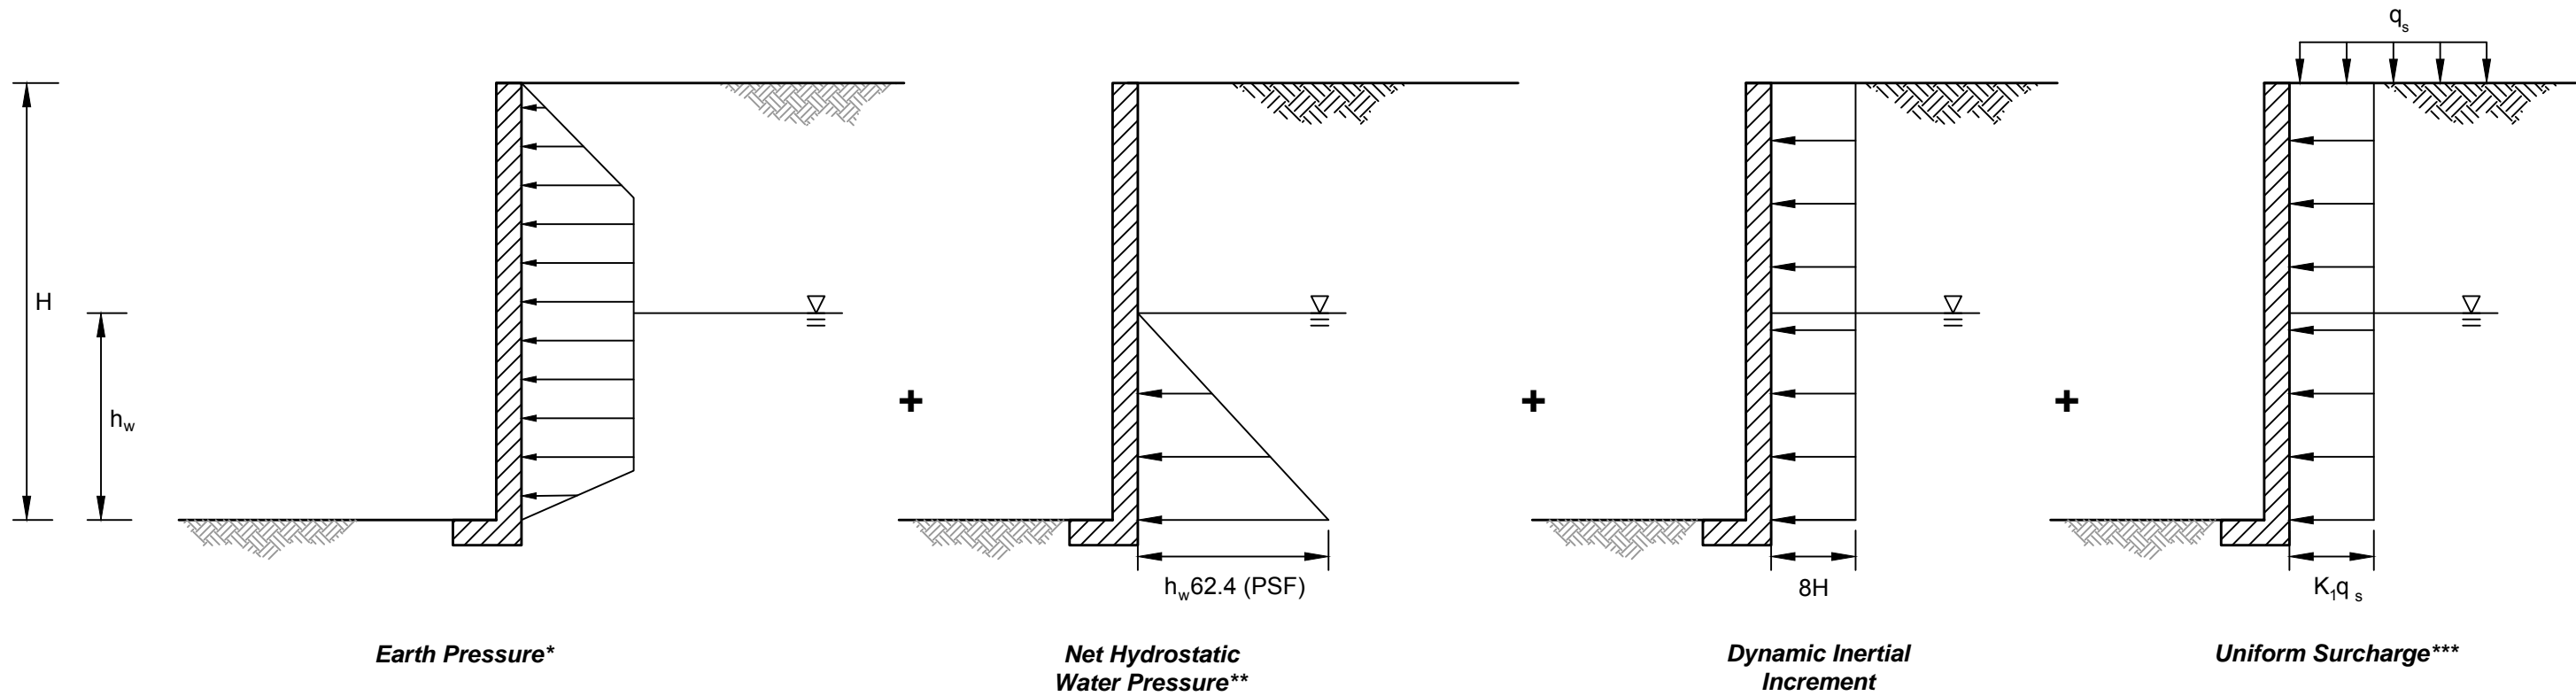

* The same earth pressure distributions determined for temporary shoring should be used for permanent walls constructed against shoring (See Figure 7).

** Neglect water pressure if permanently drained

*** See Figure 8 for K_1


Legend

- H Height from bottom of excavation to ground surface in feet
- q_s Traffic surcharge
- h_w Depth of excavation below groundwater table
- ∇ Groundwater table

Notes

1. All pressures are in units of pounds per square foot.
2. Diagrams do not include surcharge loading due to adjacent structures; see Figure 8.
3. Diagrams not to scale.


Mercer Island Multi-Family Development Mercer Island, Washington	
Lateral Pressures for Permanent Walls Constructed Against Shoring	
17984-01	12/14
	Figure 9

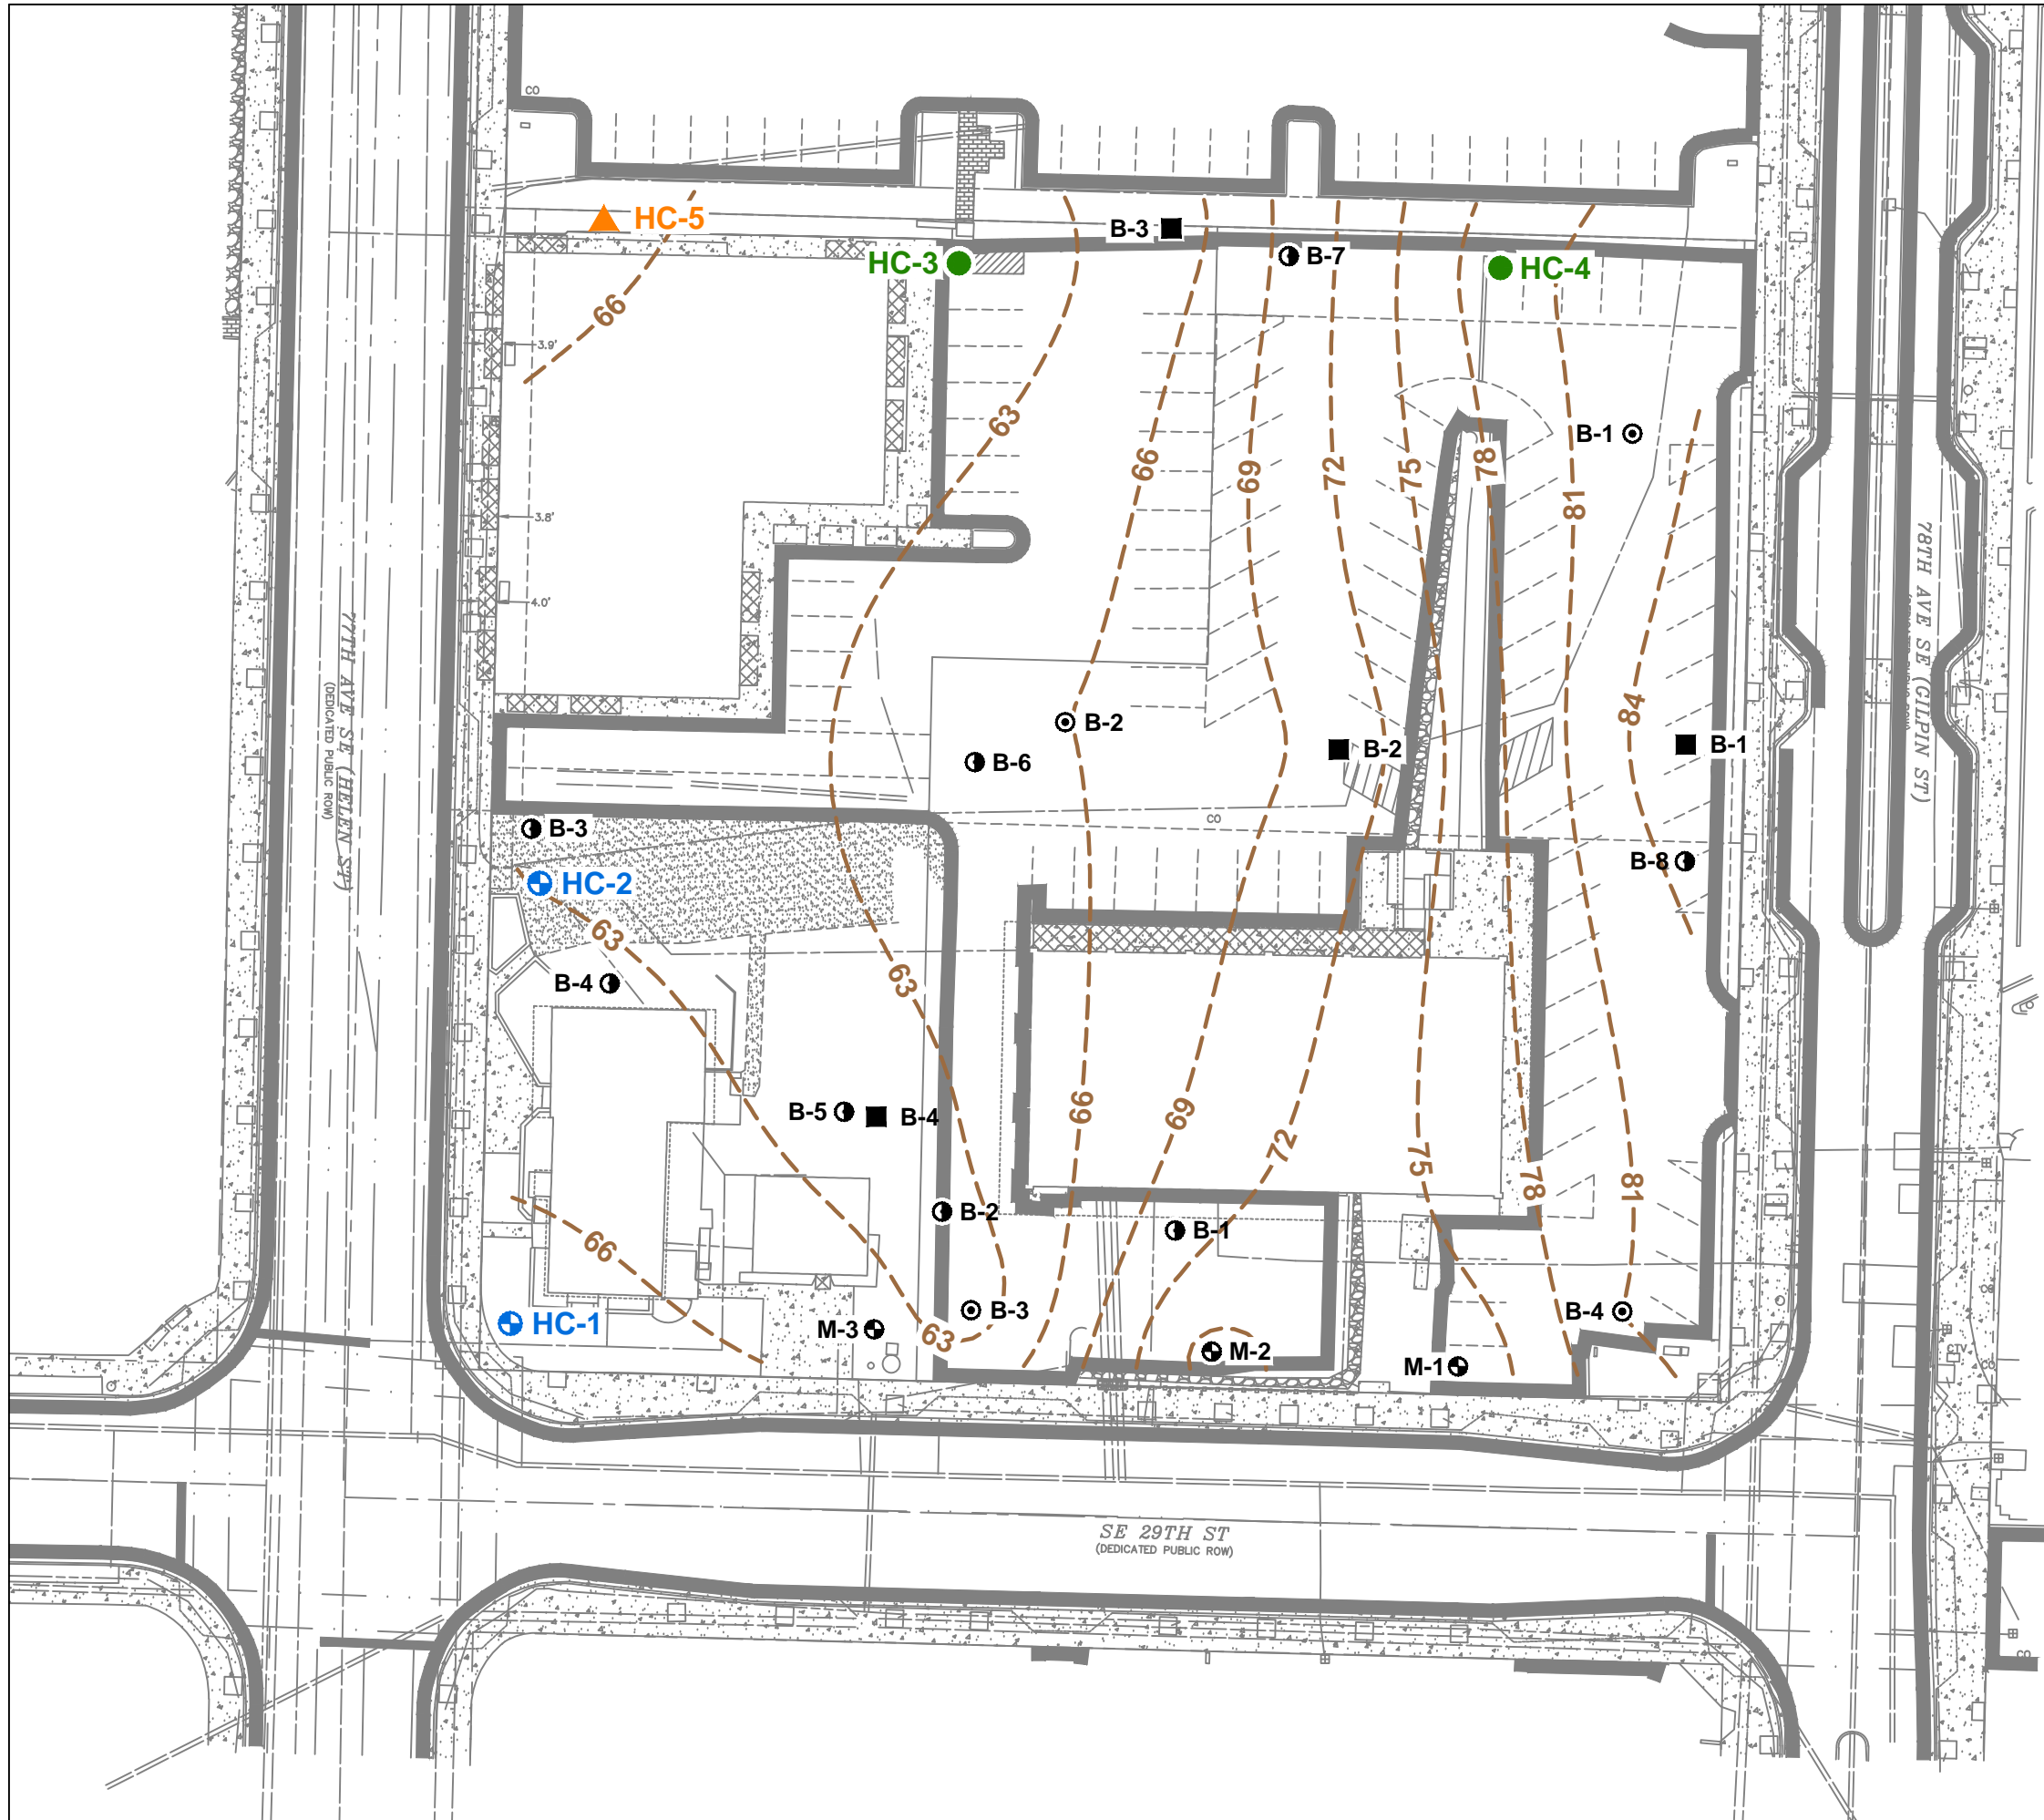

- Current Exploration Location and Number
- HC-3 ● Boring (Hart Crowser)
 - HC-5 ▲ DCP (Hart Crowser)
 - HC-1 ● Monitoring Well (Hart Crowser)

- Previous Exploration Location and Number
- B-1 ■ Boring (ABPB Consulting)
 - B-6 ● Push Probe (Farallon)
 - M-1 ● Monitoring Well (ABPB Consulting)
 - B-1 ⊙ Boring (Terra)

84 - - - Top of Competent Soils Contour Elevation in Feet



Source: Base map prepared from survey "XS-ALTA-02.dwg," created by Bush, Roed & Hitchings, dated 10/14/14.

Mercer Island Multi-Family Development Mercer Island, Washington	
Elevation of Top of Competent Soils	
17984-01	12/14
	Figure 10

EAL 12/10/14 1798401-010.dwg

ATTACHMENT 1
Slug Test Results

MEMORANDUM

DATE: December 12, 2014

TO: Hines

FROM: Angie Goodwin, LHG
Roy Jensen, LHG

RE: **Summary of Mercer Island Multi-Family Development Slug Test Results
Mercer Island, Washington
17984-01**

This technical memorandum presents the results of slug testing that was conducted for the Mercer Island Multi-Family Development in Mercer Island, Washington. The development is located on the northwest corner of the intersection of SE 29th Street and 78th Avenue SE. We understand that current development plans include one to two stories of below grade parking and five levels of housing and mixed-use space plus rooftop mechanical equipment. Slug tests were performed to determine hydraulic conductivity of formation for use in estimating flow rates during dewatering.

Slug tests are performed by suddenly inserting or removing a solid PVC rod in a well and measuring the recovery of the water levels during the test. A test conducted by the insertion of the PVC rod into the well is referred to as a falling head test and the following removal of the rod is called a rising head test. The water level data generated from the tests were analyzed using the commercial software Aquifer^{Win32} Version 3 (Environmental Simulations, Inc., 2003). The slug test analysis is based on the Bouwer and Rice method (Bouwer and Rice 1976; Bouwer 1989) to obtain an estimated value of hydraulic conductivity of the aquifer.

Slug Testing Results

Slug testing was conducted in wells HC-1, HC-2, ABPB-M3, and Terra-B1 on November 17, 2014. A summary of monitoring well construction details is provided in Table 1. Shallow soils at the project site consist of Fill, silty Sand, and Silt units. The wells were screened in two stratigraphic units and are summarized below:

- HC-1 was screened in the Silt and silty Sand units;
- HC-2 was screened in the silty Sand unit;



- ABPB-M3 boring log did not identify the screened interval, but it was assumed the well was screened in the Silt and silty Sand units; and
- Terra-B1 was screened in the Silt unit.

A summary of slug testing results is provided in Table 2. The slug test plots are provided as Figures 1 through 6. Multiple sets of falling and rising head tests were performed on each well. The results of the falling and rising head tests compare favorably. Average hydraulic conductivities determined from slug tests range from 9.0×10^{-5} to 8.3×10^{-4} cm/sec (0.3 to 2.4 feet/day). This hydraulic conductivity range is typical for silt and silty sand (Freeze and Cherry 1979).

References

Bouwer H. 1989. The Bouwer and Rice Slug Test – An Update. *Ground Water* 27(3): 304-309.

Bouwer H. and R.C. Rice 1976. A Slug Test for Determining Hydraulic Conductivity of Unconfined Aquifers with Completely or Partially Penetrating Wells. *Water Resources Research* 12(3): 423-428.

Environmental Simulations, Inc. 2003. Guide to Using Aquifer^{Win32} Version 3.

Freeze, R.A. and J.A. Cherry 1979. *Groundwater*. Prentice-Hall, Englewood Cliffs, New Jersey.

Attachments:

Table 1 – Monitoring Well Construction Summary

Table 2 – Summary of Slug Test Results

Figure 1 – HC-1 and HC-2 Hydrographs

Figure 2 – ABPB-M3 and Terra-B1 Hydrographs

Figure 3 – HC-1 Representative Slug Tests Results

Figure 4 – HC-2 Representative Slug Tests Results

Figure 5 – ABPB-M3 Representative Slug Tests Results

Figure 6 – Terra-B1 Representative Slug Tests Results

Table 1 - Monitoring Well Construction Summary

Well ID	HC-1	HC-2	ABPB-M3	Terra-B1
Boring Depth in Feet	41.5	41.5	26.5	31
Well Depth in Feet	40	39	25	17
Screen Interval Depth in Feet	20 to 40	29 to 39	NA	7 to 17
Depth to Sediment in Feet (1)	39.95	36.74	23.10	16.54
Depth to Water in Feet (1)	5.38	5.43	2.75	8.71
Saturated Thickness in Feet	35	31	20	8
Screened Interval Soil Description	ML - SM	SM	ML - SM	ML

Notes:

(1) Depth to sediment and depth to water was measured on November 17, 2014.



SM = Silty SAND

ML = Sandy SILT

NA = Data not available.

Table 2 - Summary of Slug Test Results

Well ID	Test Type	Test Number	Bouwer and Rice	
			K in ft/day	K in cm/sec
HC-1	Falling Head	Test 1	0.3	1.1E-04
	Rising Head	Test 1	0.4	1.4E-04
	Falling Head	Test 2	0.3	1.2E-04
	Rising Head	Test 2	0.4	1.5E-04
	Falling Head	Test 3	0.4	1.5E-04
	Rising Head	Test 3	0.4	1.5E-04
	Falling Head	Test 4	0.4	1.4E-04
	Rising Head	Test 4	0.4	1.5E-04
		<i>Average</i>	<i>0.4</i>	<i>1.4E-04</i>
HC-2	Falling Head	Test 1	2.4	8.4E-04
	Rising Head	Test 1	2.6	9.2E-04
	Falling Head	Test 2	2.1	7.5E-04
	Rising Head	Test 2	2.2	7.7E-04
	Falling Head	Test 3	2.6	9.3E-04
	Rising Head	Test 3	2.4	8.6E-04
	Falling Head	Test 4	1.9	6.6E-04
	Rising Head	Test 4	2.7	9.4E-04
		<i>Average</i>	<i>2.4</i>	<i>8.3E-04</i>
ABPB-M3	Falling Head	Test 1	1.8	6.3E-04
	Rising Head	Test 1	1.8	6.2E-04
	Falling Head	Test 2	1.8	6.5E-04
	Rising Head	Test 2	1.9	6.6E-04
	Falling Head	Test 3	1.6	5.7E-04
	Rising Head	Test 3	1.9	6.8E-04
	Falling Head	Test 4	1.9	6.7E-04
	Rising Head	Test 4	2.1	7.3E-04
		<i>Average</i>	<i>1.8</i>	<i>6.5E-04</i>
Terra-B1	Falling Head	Test 1	0.2	5.7E-05
	Rising Head	Test 1	0.5	1.8E-04
	Falling Head	Test 2	0.1	3.1E-05
	Rising Head	Test 2	0.3	1.2E-04
	Falling Head	Test 3	0.2	5.3E-05
	Rising Head	Test 3	0.3	1.1E-04
	Falling Head	Test 4	0.2	6.5E-05
	Rising Head	Test 4	0.3	1.0E-04
		<i>Average</i>	<i>0.3</i>	<i>9.0E-05</i>

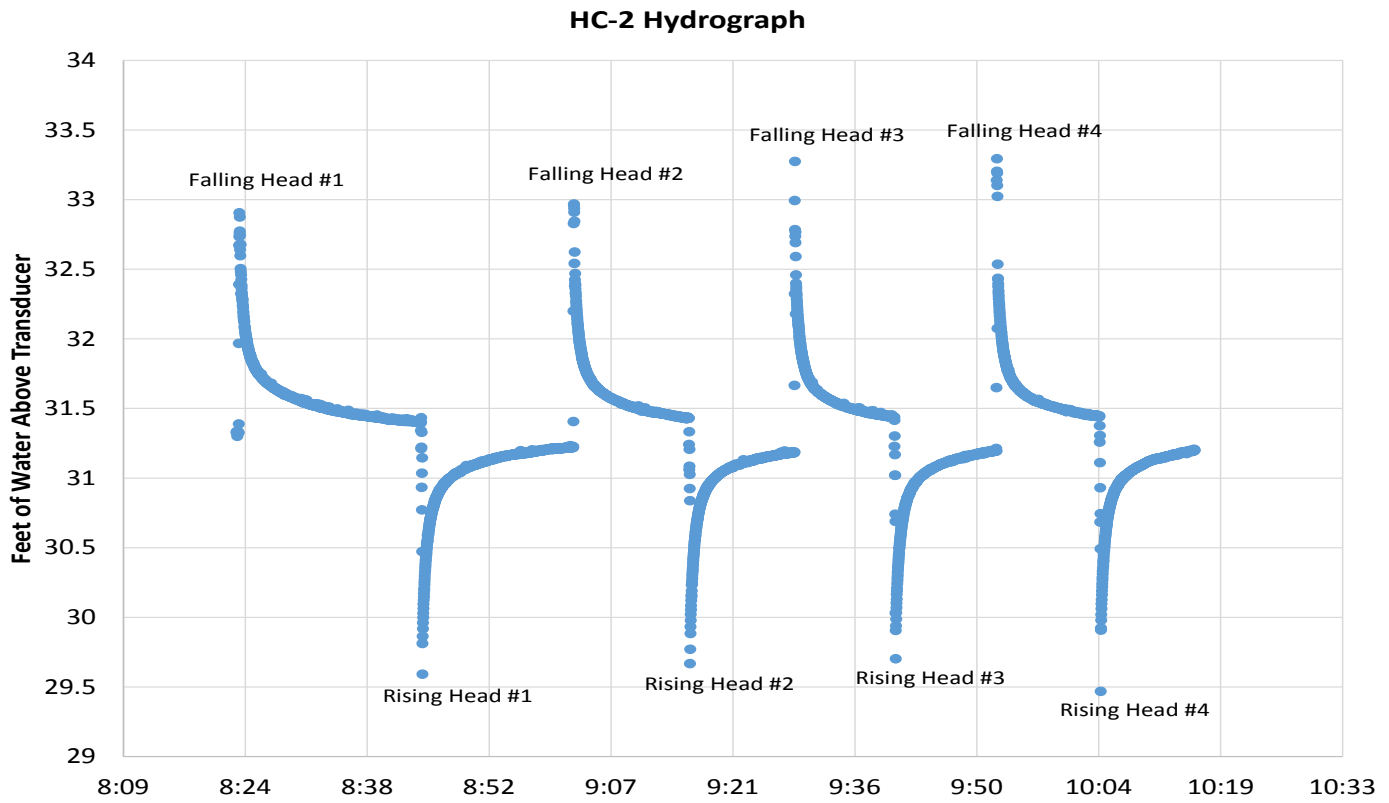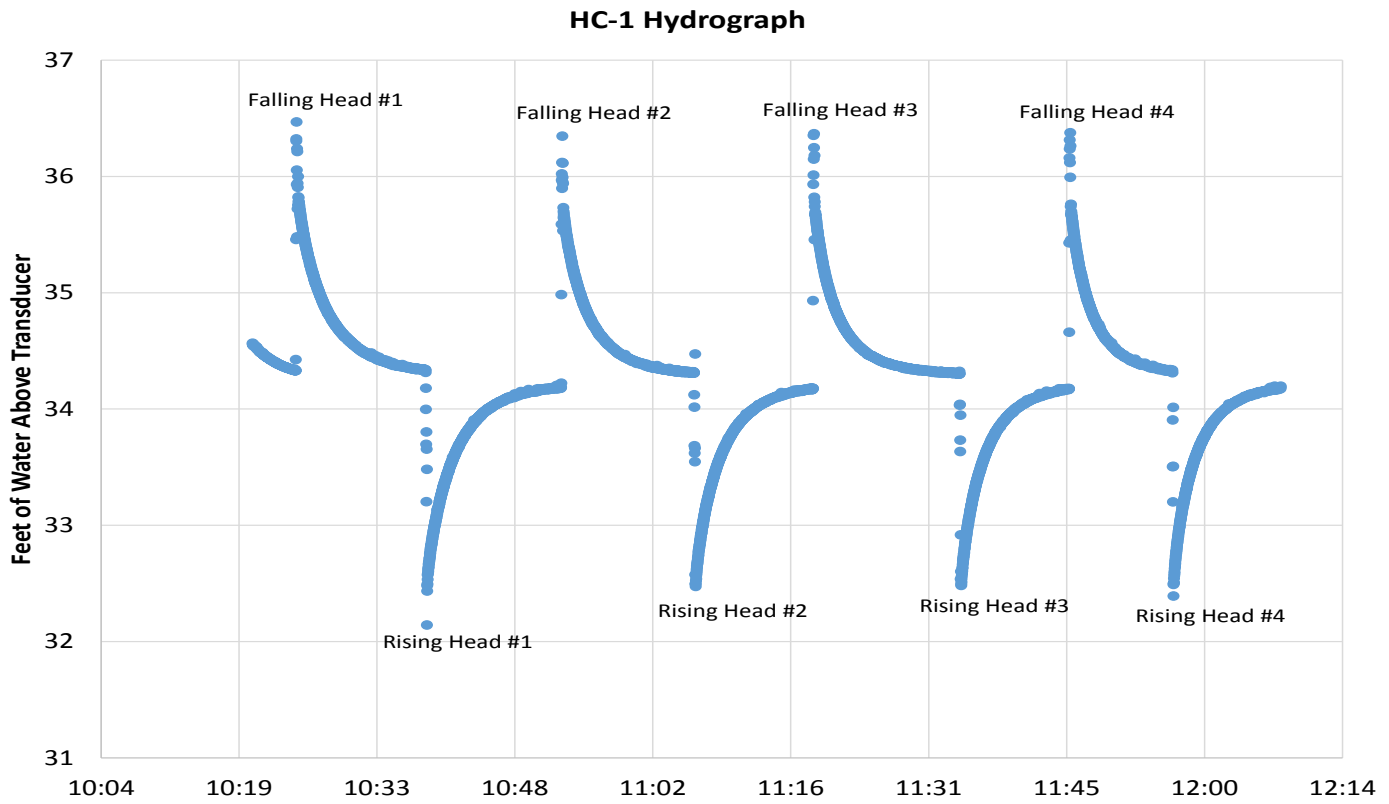

Mercer Island Multi-Family Development
Mercer Island, Washington

HC-1 and HC-2 Hydrographs



17984-01

12/14



Figure

1

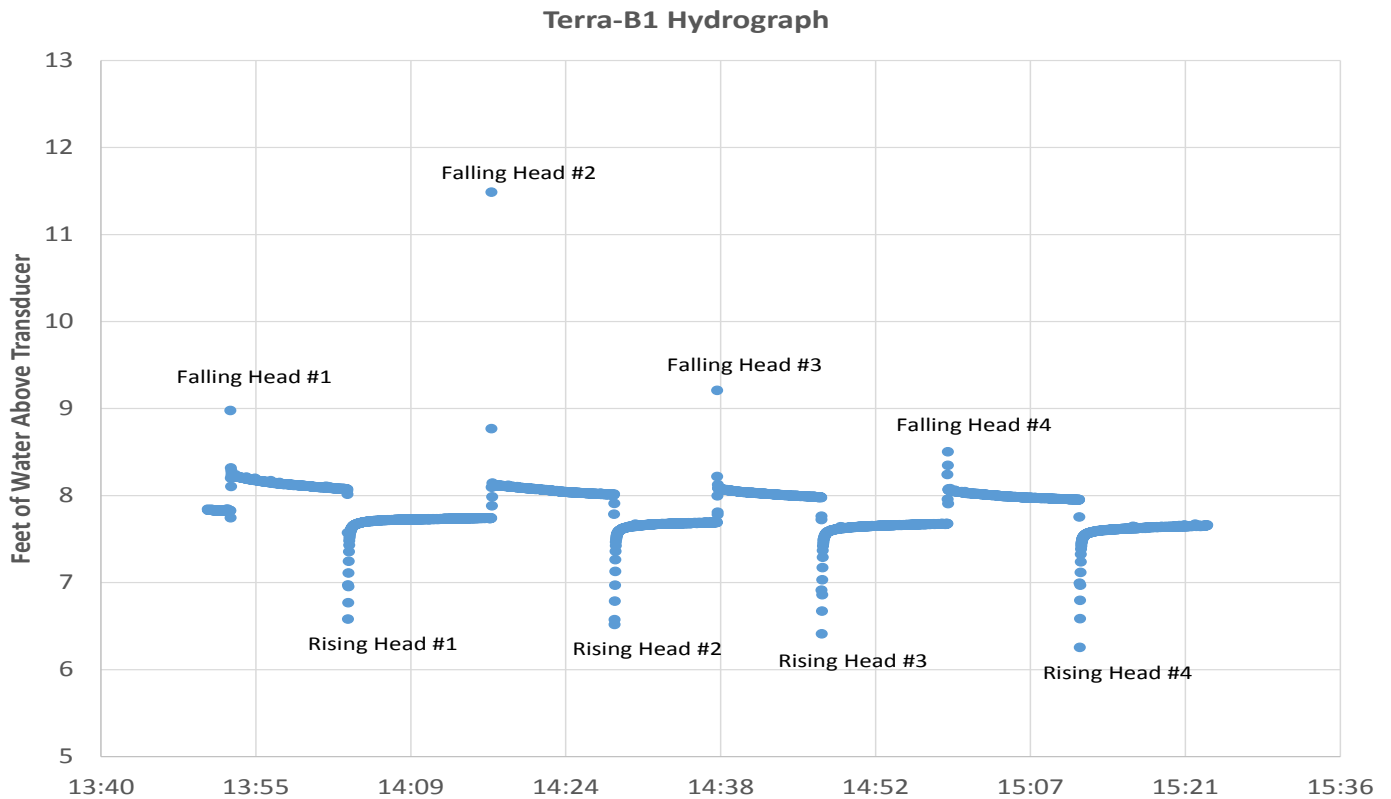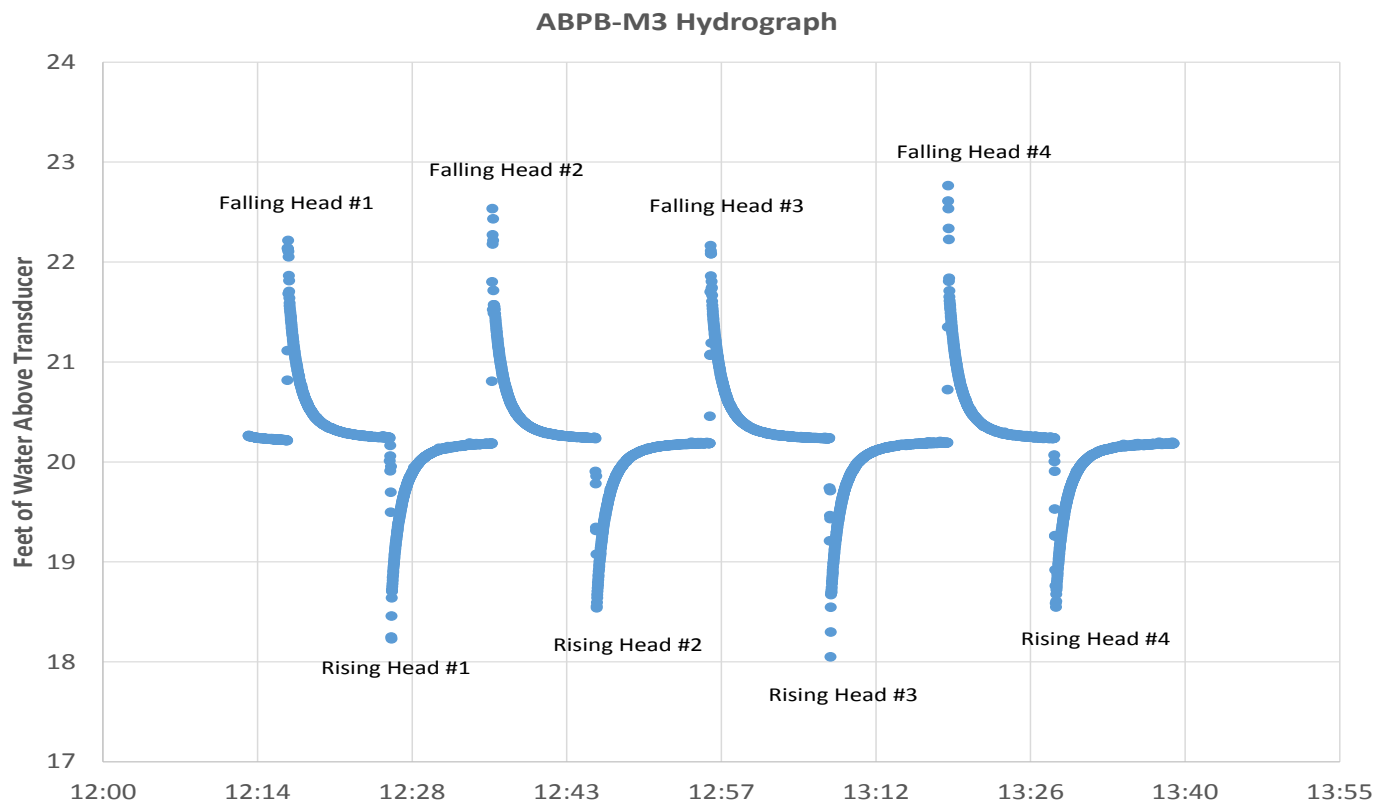

Mercer Island Multi-Family Development
Mercer Island, Washington

ABPB-M3 and Terra B-1 Hydrographs

17984-01


12/14




Figure

2

HC-1 Falling Head Test #1

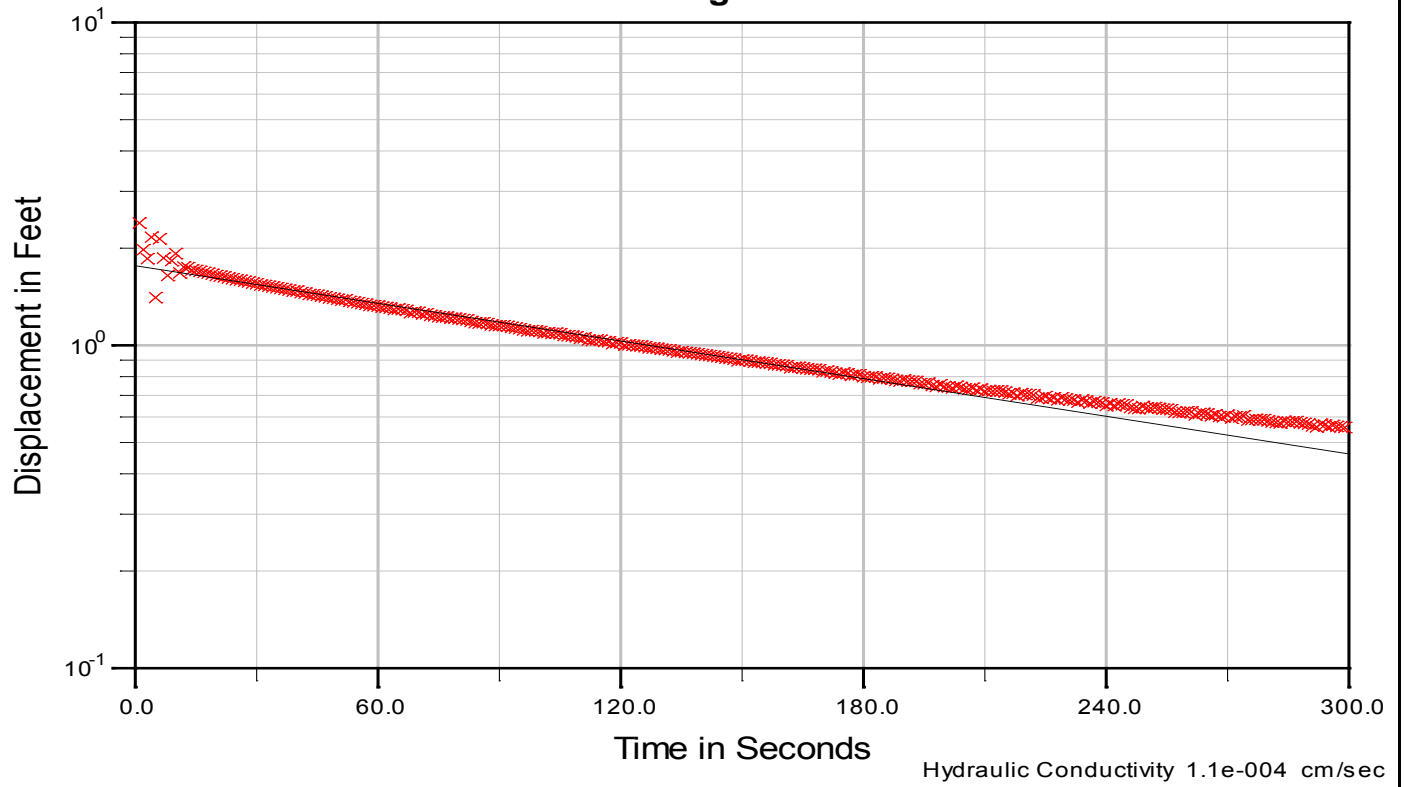

HC-1 Rising Head #1

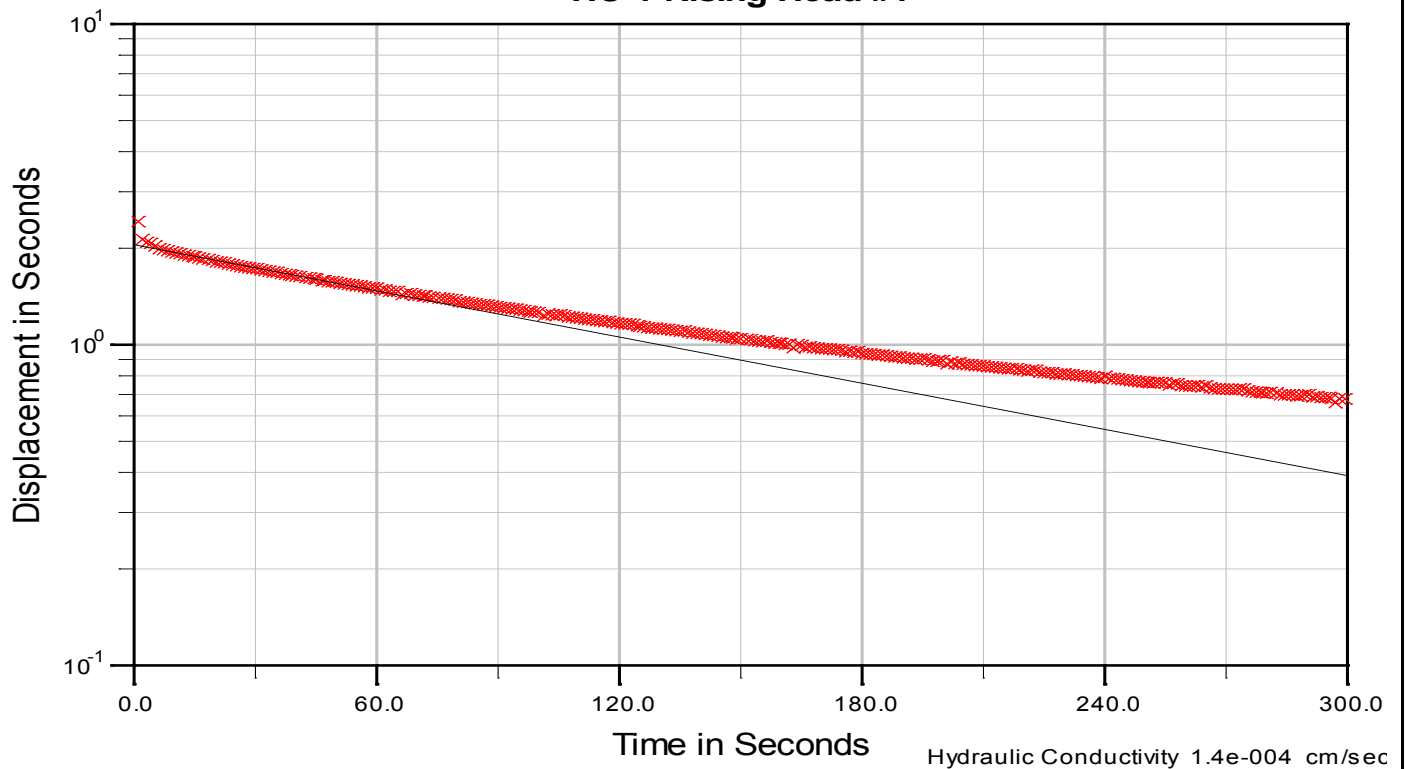

A:\J 12/11/14 L:\Project Notebook\1798401 Mercer Island Multi family\Slug-test\Files\Slug Test

Note:
Bouwer and Rice method was used for the slug test analysis.

Mercer Island Multi-Family Development
Mercer Island, Washington

HC-1 Representative Slug Tests Results

17984-01


12/14




Figure

3

HC-2 Falling Head #1

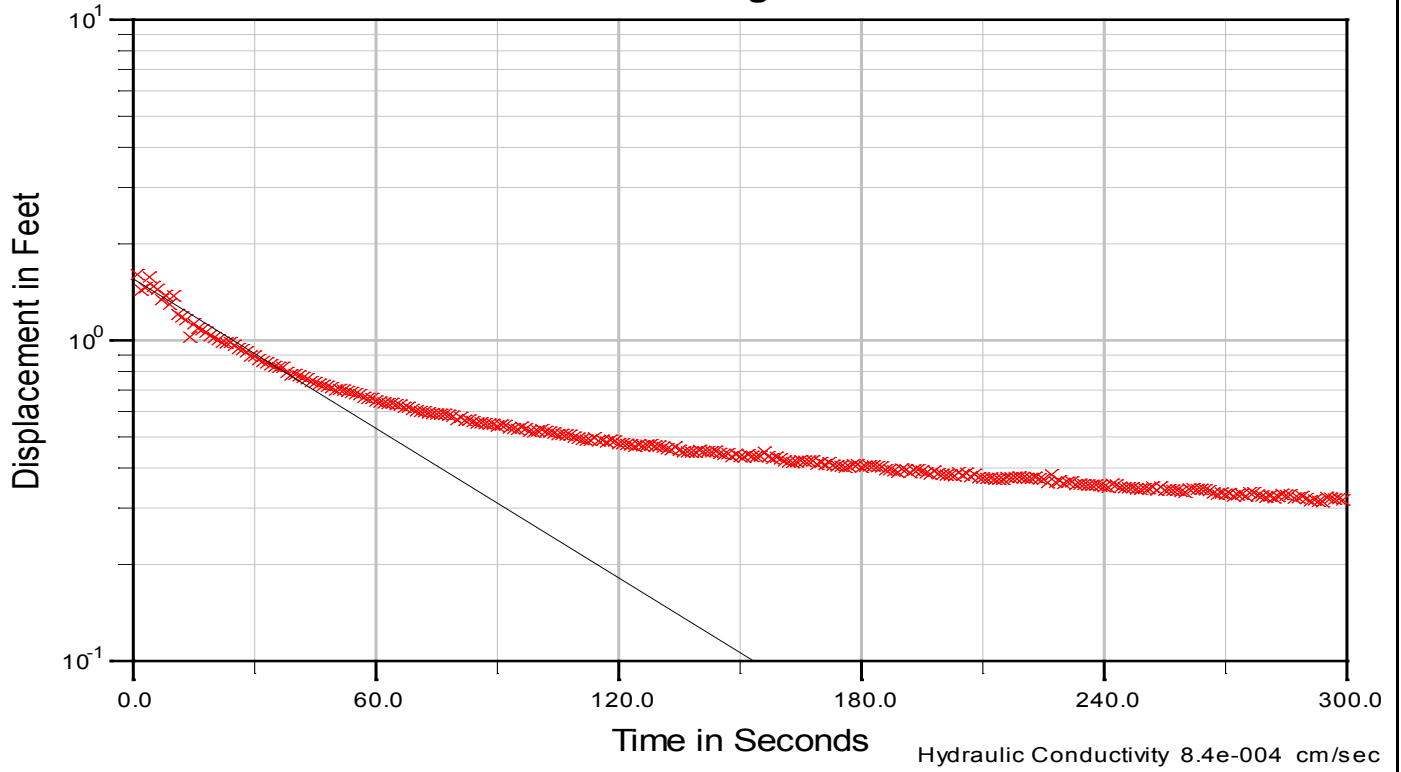

HC-2 Rising Head #1

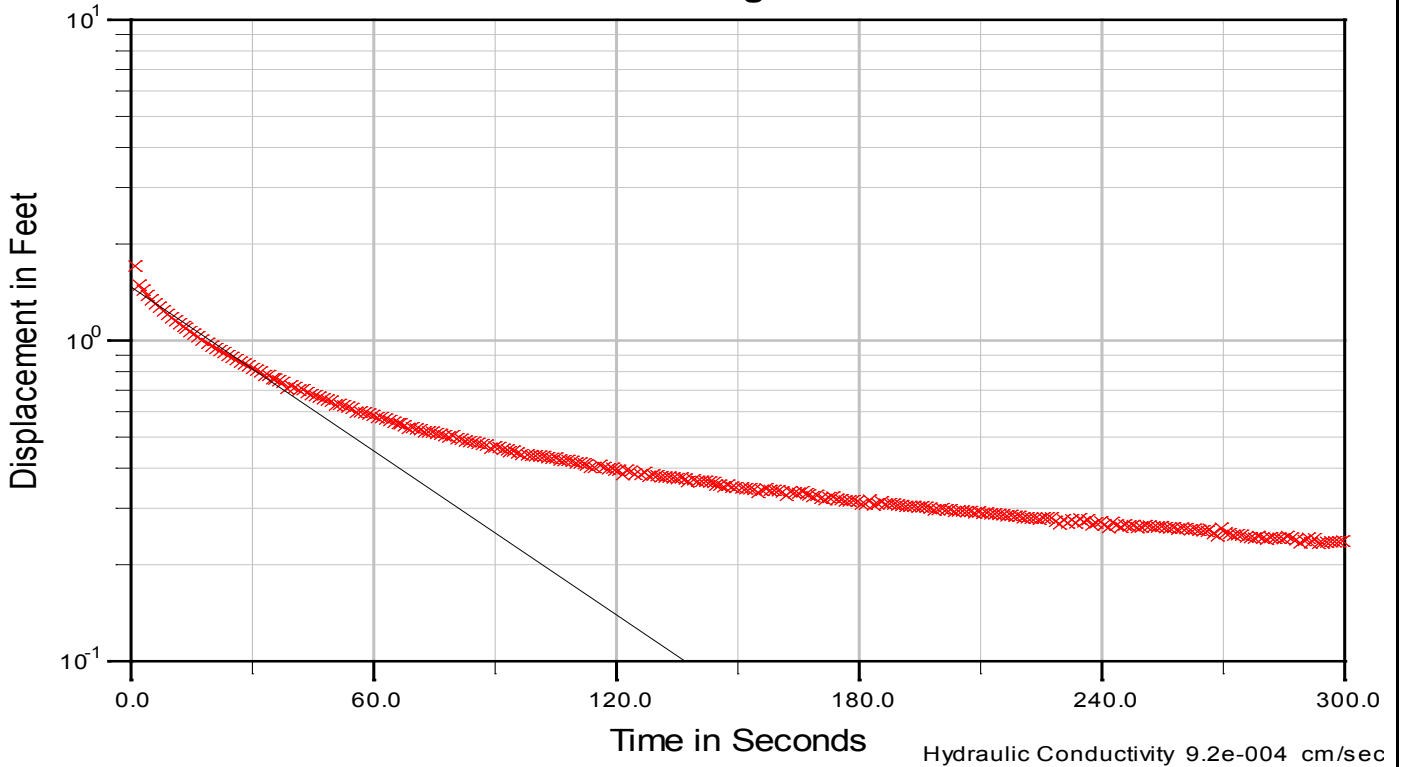

A:\JG 12/11/14 L:\Project Notebook\1798401 Mercer Island Multi family\Slug-test Files\Slug Test

Note:
Bouwer and Rice method was used for the slug test analysis.

Mercer Island Multi-Family Development
Mercer Island, Washington

HC-2 Representative Slug Tests Results

17984-01


12/14




Figure

4

ABPB-M3 - Falling Head #1

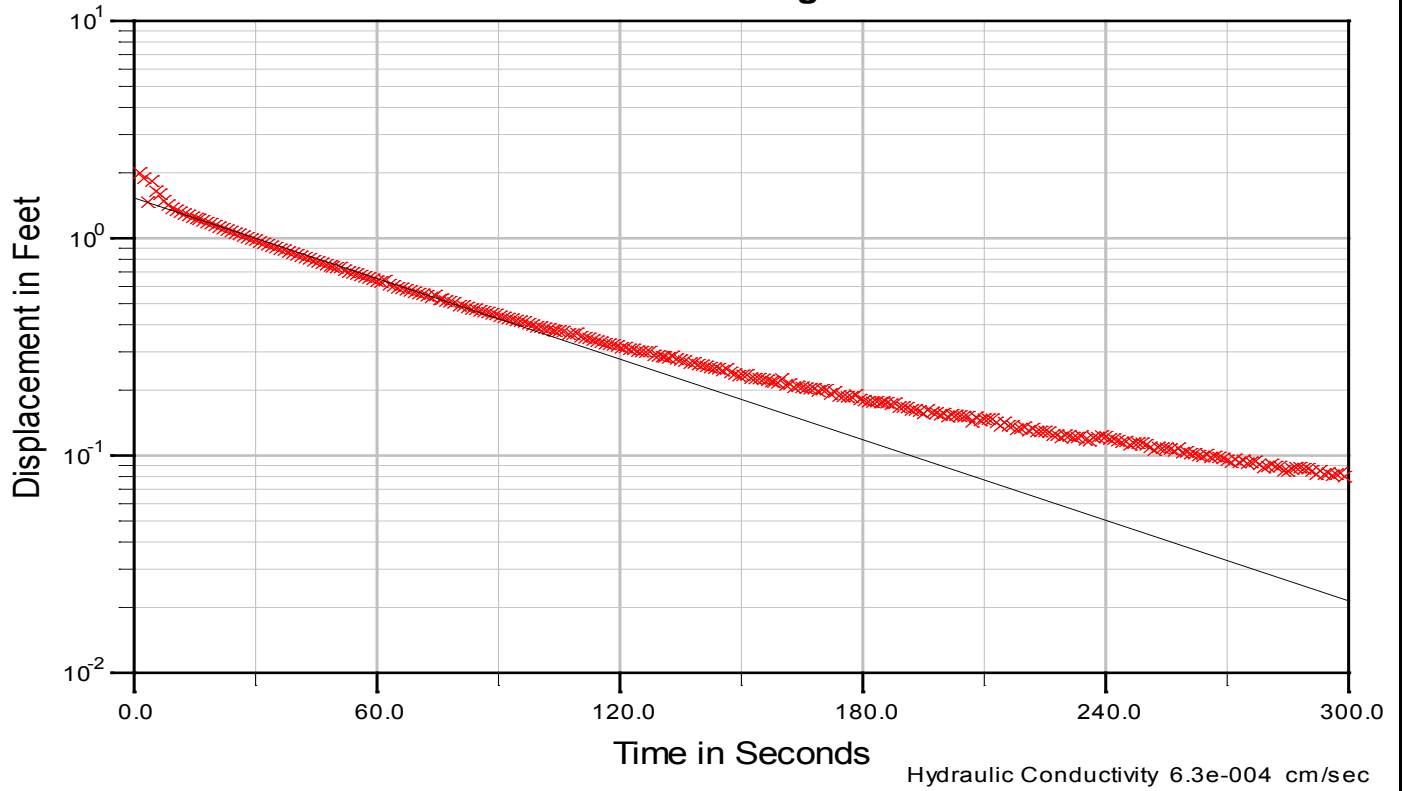

ABPB-M3 Rising Head #1

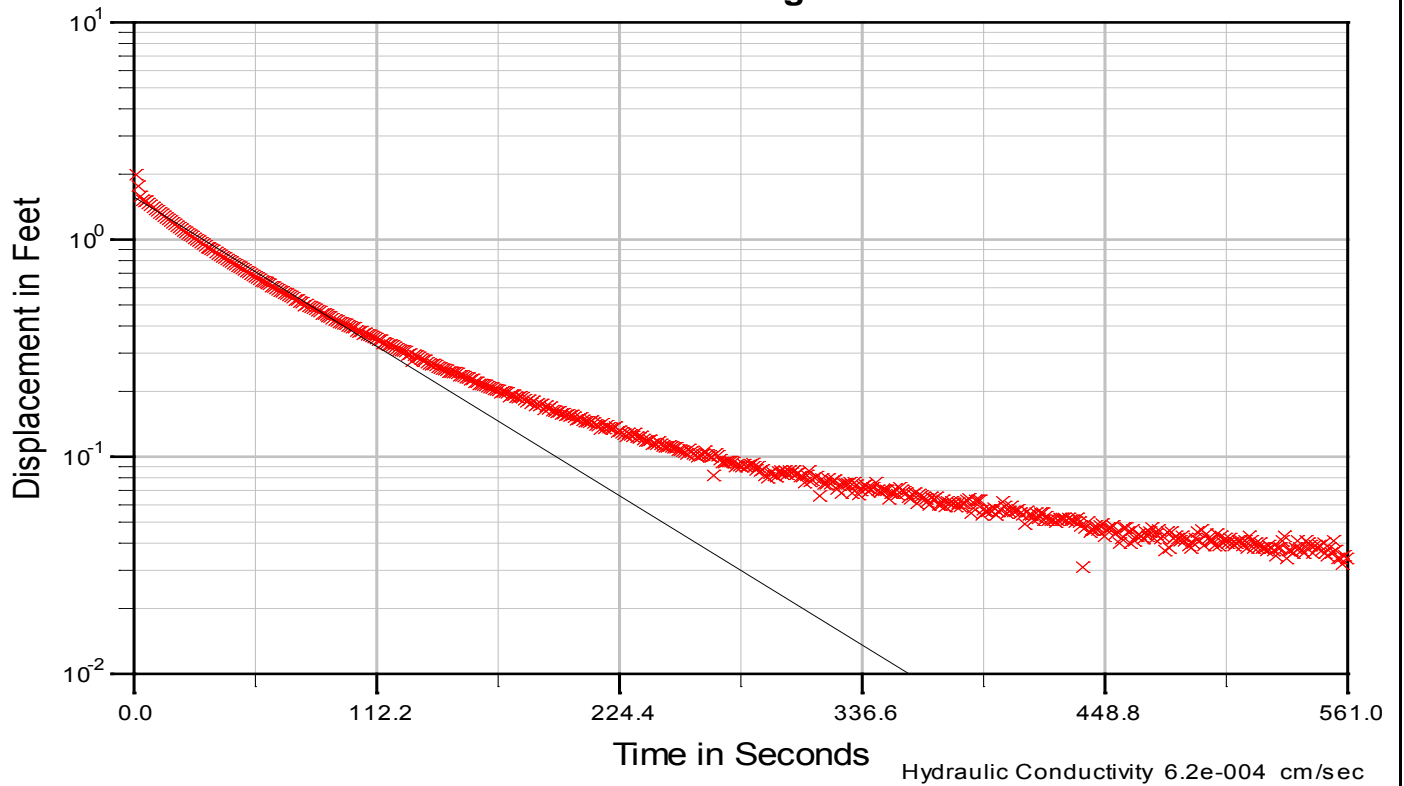

AUG 12/11/14 L:\Project Notebook\1798401 Mercer Island Multi family\Slug-test-Files\Slug Test

Note:
Bouwer and Rice method was used for the slug test analysis.

Mercer Island Multi-Family Development
Mercer Island, Washington

ABPB-M3 Representative Slug Tests Results

17984-01


12/14




Figure

5

Terra-B1 Falling Head #1

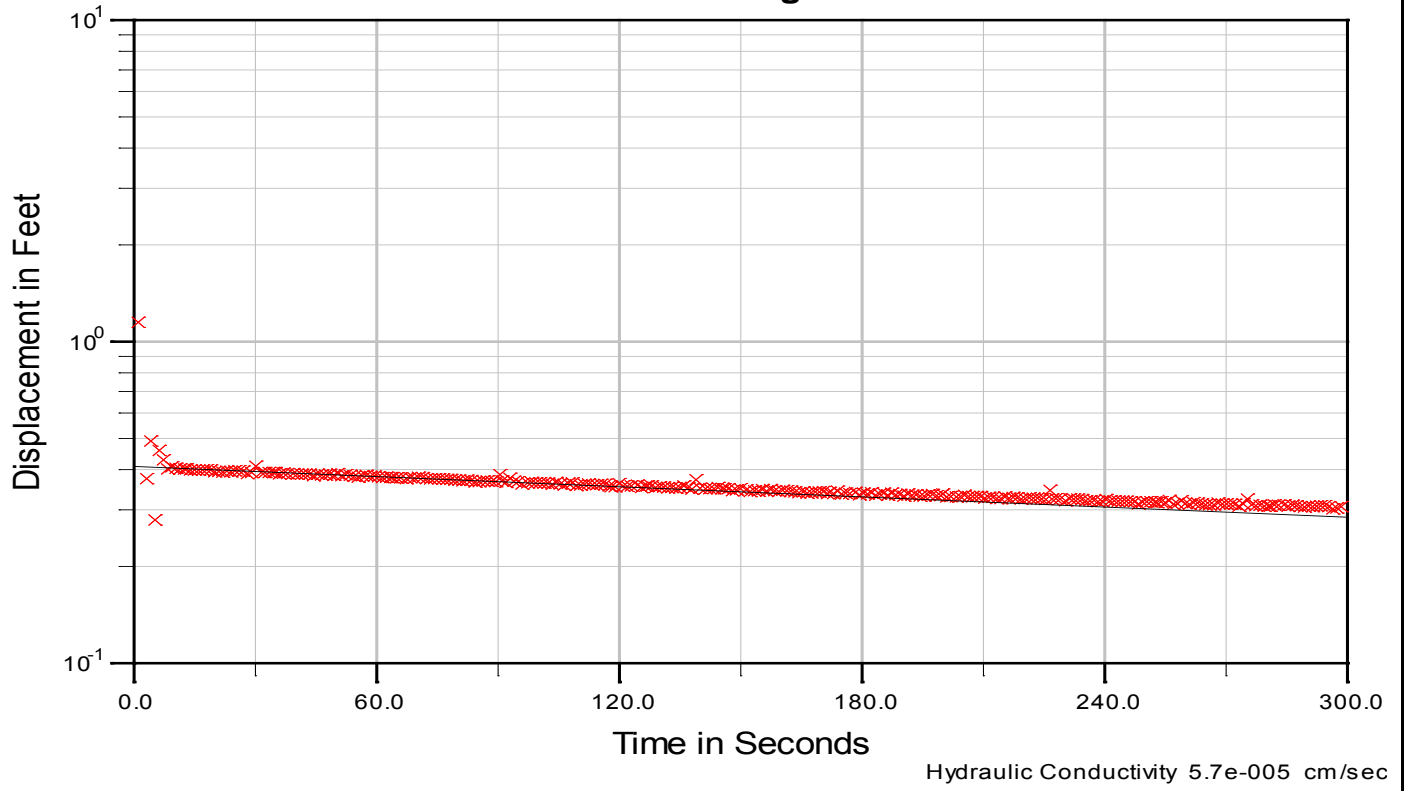

Terra-B1 Rising Head #1

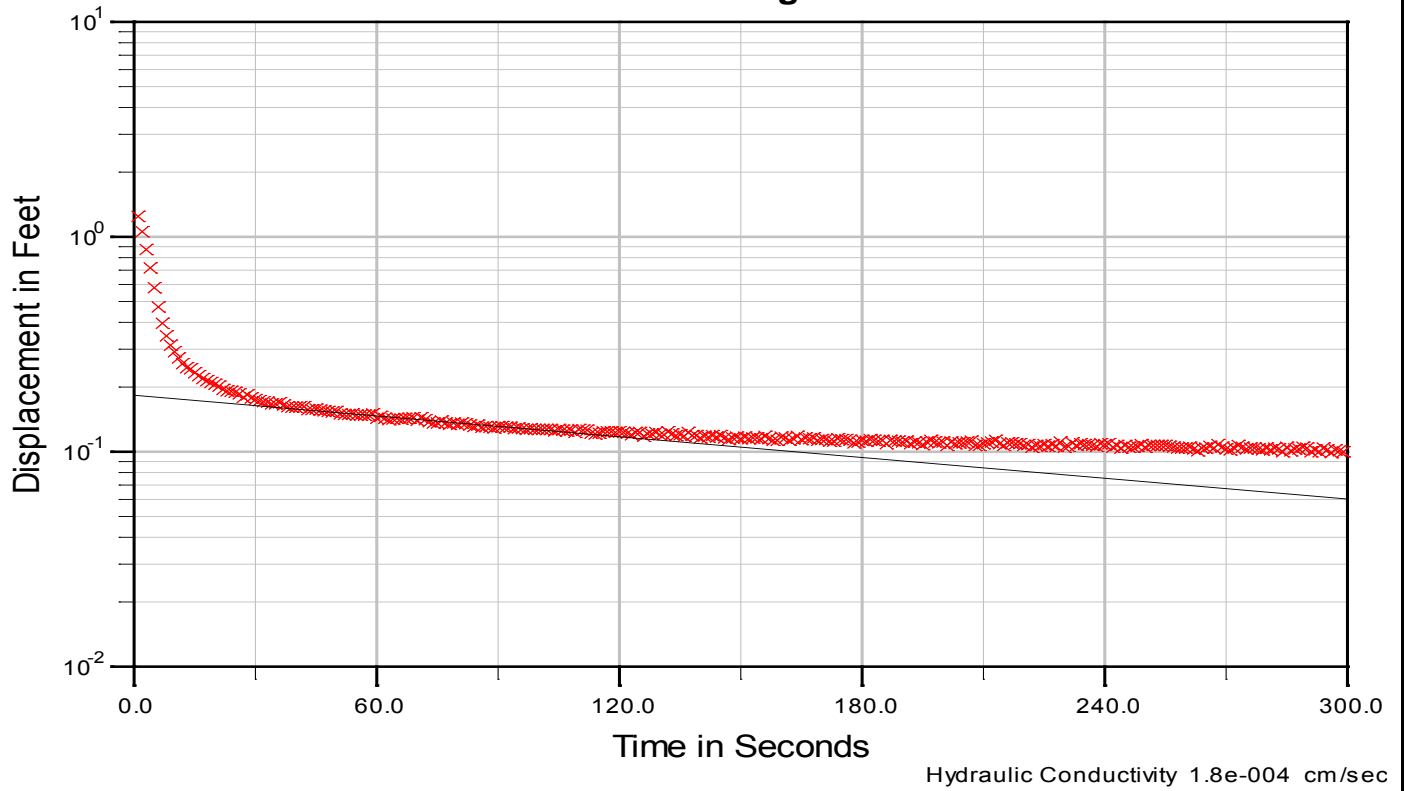

A:\J 12/11/14 L:\Project Notebook\1798401 Mercer Island Multi family\Slug-test-Files\Slug Test

Note:

Bouwer and Rice method was used for the slug test analysis.

Mercer Island Multi-Family Development
Mercer Island, Washington

Terra-B1 Representative Slug Tests Results

17984-01

12/14



Figure

6

APPENDIX A

Field Exploration Methods and Analysis

APPENDIX A

Field Exploration Methods and Analysis

This appendix documents the processes Hart Crowser used to determine the nature of the soils at the project site, and discusses:

- Explorations and their locations;
- Auger borings; and
- Standard Penetration Test procedures.

Explorations and Their Locations

The exploration logs in this appendix show our interpretation of the drilling, sampling, and testing data. These logs indicate the approximate depth where the soils change. Note that the soil changes may be gradual and may vary in depth across the site.

In the field, we classified the soil samples according to the methods shown on Figure A-1 - Key to Exploration Logs. This figure also provides a legend explaining the symbols and abbreviations used on the logs.

Explorations were located with a measuring tape from existing physical features. Elevations are referenced to the North American Vertical Datum of 1988 (NAVD88) and were estimated from the provided topographic survey.

Auger Borings

Borings were drilled with a 5.5-inch-inside-diameter, hollow-stem auger and were advanced with a truck-mounted drill rig subcontracted by Hart Crowser. The drilling was continuously observed by a geologist from Hart Crowser. A detailed field log was prepared for the boring. Using the Standard Penetration Test (SPT), we obtained samples at minimum 5-foot intervals.

Standard Penetration Test Procedures

The SPT is an approximate measure of soil density and consistency. To be useful, the results must be interpreted in conjunction with other tests. The SPT (as described in ASTM D 1586) was used to obtain disturbed soil samples.

This test employs a standard 2-inch-outside-diameter, split-spoon sampler. Using a 140-pound autohammer, free-falling 30 inches, the sampler is driven into the soil for 18 inches. The number of blows required to drive the sampler the last 12 inches is the Standard Penetration Resistance. This resistance, or blow count, measures the relative density of granular soils and the consistency of cohesive soils. The blow counts are plotted on the boring logs at their respective sample depths.

Soil samples were recovered from the split-spoon sampler, field classified, and placed into watertight jars. They were taken to Hart Crowser's laboratory for further testing.

In the Event of Hard Driving

Occasionally, very dense materials preclude driving the total 18-inch sample. When this happens, the penetration resistance is entered on logs as follows:

Penetration less than 6 inches. The log indicates the total number of blows over the number of inches of penetration.

Penetration greater than 6 inches. The blow count noted on the log is the sum of the total number of blows completed after the first 6 inches of penetration. This sum is expressed over the number of inches driven that exceed the first 6 inches. The number of blows needed to drive the first 6 inches are not reported. For example, a blow count series of 12 blows for 6 inches, 30 blows for 6 inches, and 50 (the maximum number of blows counted within a 6-inch increment for SPT) for 3 inches would be recorded as 80/9.

Monitoring Well Installation

After drilling, monitoring wells were installed in HC-1 and HC-2 for groundwater level monitoring and slug testing.

Two-inch-diameter Schedule 40 PVC riser pipe and two-inch-diameter 0.020-inch machine-slotted screen were used for the well casings and screens. The well screen and casing riser were lowered down through the open hole. Well seals were constructed by placing bentonite chips in the annular space on top of the filter sand to within 3 feet of the ground surface. The remaining annular space was backfilled with concrete to complete the surface seal. The monitoring well construction details are illustrated on the boring logs.

The monitoring wells were installed in accordance with Washington State Department of Ecology regulations.

Key to Exploration Logs

Sample Description

Classification of soils in this report is based on visual field and laboratory observations which include density/consistency, moisture condition, grain size, and plasticity estimates and should not be construed to imply field nor laboratory testing unless presented herein. Visual-manual classification methods of ASTM D 2488 were used as an identification guide.

Soil descriptions consist of the following:

Density/consistency, moisture, color, minor constituents, MAJOR CONSTITUENT, additional remarks.

Density/Consistency

Soil density/consistency in borings is related primarily to the Standard Penetration Resistance. Soil density/consistency in test pits and probes is estimated based on visual observation and is presented parenthetically on the logs.

SAND or GRAVEL Density	Standard Penetration Resistance (N) in Blows/Foot	SILT or CLAY Consistency	Standard Penetration Resistance (N) in Blows/Foot	Approximate Shear Strength in TSF
Very loose	0 to 4	Very soft	0 to 2	<0.125
Loose	4 to 10	Soft	2 to 4	0.125 to 0.25
Medium dense	10 to 30	Medium stiff	4 to 8	0.25 to 0.5
Dense	30 to 50	Stiff	8 to 15	0.5 to 1.0
Very dense	>50	Very stiff	15 to 30	1.0 to 2.0
		Hard	>30	>2.0

Sampling Test Symbols

1.5" I.D. Split Spoon	Grab (Jar)	3.0" I.D. Split Spoon
Shelby Tube (Pushed)	Bag	
Cuttings	Core Run	

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS	
			GRAPH	LETTER		
COARSE GRAINED SOILS MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE	GRAVEL AND GRAVELLY SOILS	CLEAN GRAVELS (LITTLE OR NO FINES)		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
		GRAVELS WITH FINES (APPRECIABLE AMOUNT OF FINES)		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
	SAND AND SANDY SOILS	CLEAN SANDS (LITTLE OR NO FINES)		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES	
		SANDS WITH FINES (APPRECIABLE AMOUNT OF FINES)		SM	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES	
	FINE GRAINED SOILS MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	SILTS AND CLAYS	LIQUID LIMIT LESS THAN 50		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY
					CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS
				OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY	
SILTS AND CLAYS	LIQUID LIMIT GREATER THAN 50		MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS		
			CH	INORGANIC CLAYS OF HIGH PLASTICITY		
			OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS		
HIGHLY ORGANIC SOILS				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS	

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS

Moisture

Dry	Little perceptible moisture
Damp	Some perceptible moisture, likely below optimum
Moist	Likely near optimum moisture content
Wet	Much perceptible moisture, likely above optimum

Minor Constituents

Estimated Percentage

Trace	<5
Slightly (clayey, silty, etc.)	5 - 12
Clayey, silty, sandy, gravelly	12 - 30
Very (clayey, silty, etc.)	30 - 50


Laboratory Test Symbols

GS	Grain Size Classification
CN	Consolidation
UU	Unconsolidated Undrained Triaxial
CU	Consolidated Undrained Triaxial
CD	Consolidated Drained Triaxial
QU	Unconfined Compression
DS	Direct Shear
K	Permeability
PP	Pocket Penetrometer
	Approximate Compressive Strength in TSF
TV	Torvane
	Approximate Shear Strength in TSF
CBR	California Bearing Ratio
MD	Moisture Density Relationship
AL	Atterberg Limits
	Water Content in Percent
	Liquid Limit Natural Plastic Limit
PID	Photoionization Detector Reading
CA	Chemical Analysis
DT	In Situ Density in PCF
OT	Tests by Others

Groundwater Indicators

	Groundwater Level on Date or (ATD) At Time of Drilling
	Groundwater Seepage (Test Pits)

Sample Key

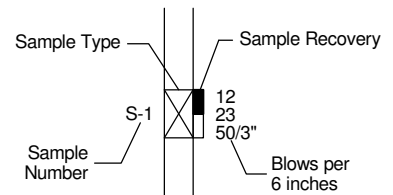

HARTCROWSER

17984-01


11/14

Figure A-1

Boring Log HC-1

Location: 47.584459, -122.234890
 Approximate Ground Surface Elevation: 83 Feet
 Horizontal Datum: WGS84
 Vertical Datum: NAVD88

Drill Equipment: HSA (Diedrich D50)
 Hammer Type: Auto-Trip
 Hole Diameter: 8 inches
 Logged By: M. Smith Reviewed By: M. Veenstra

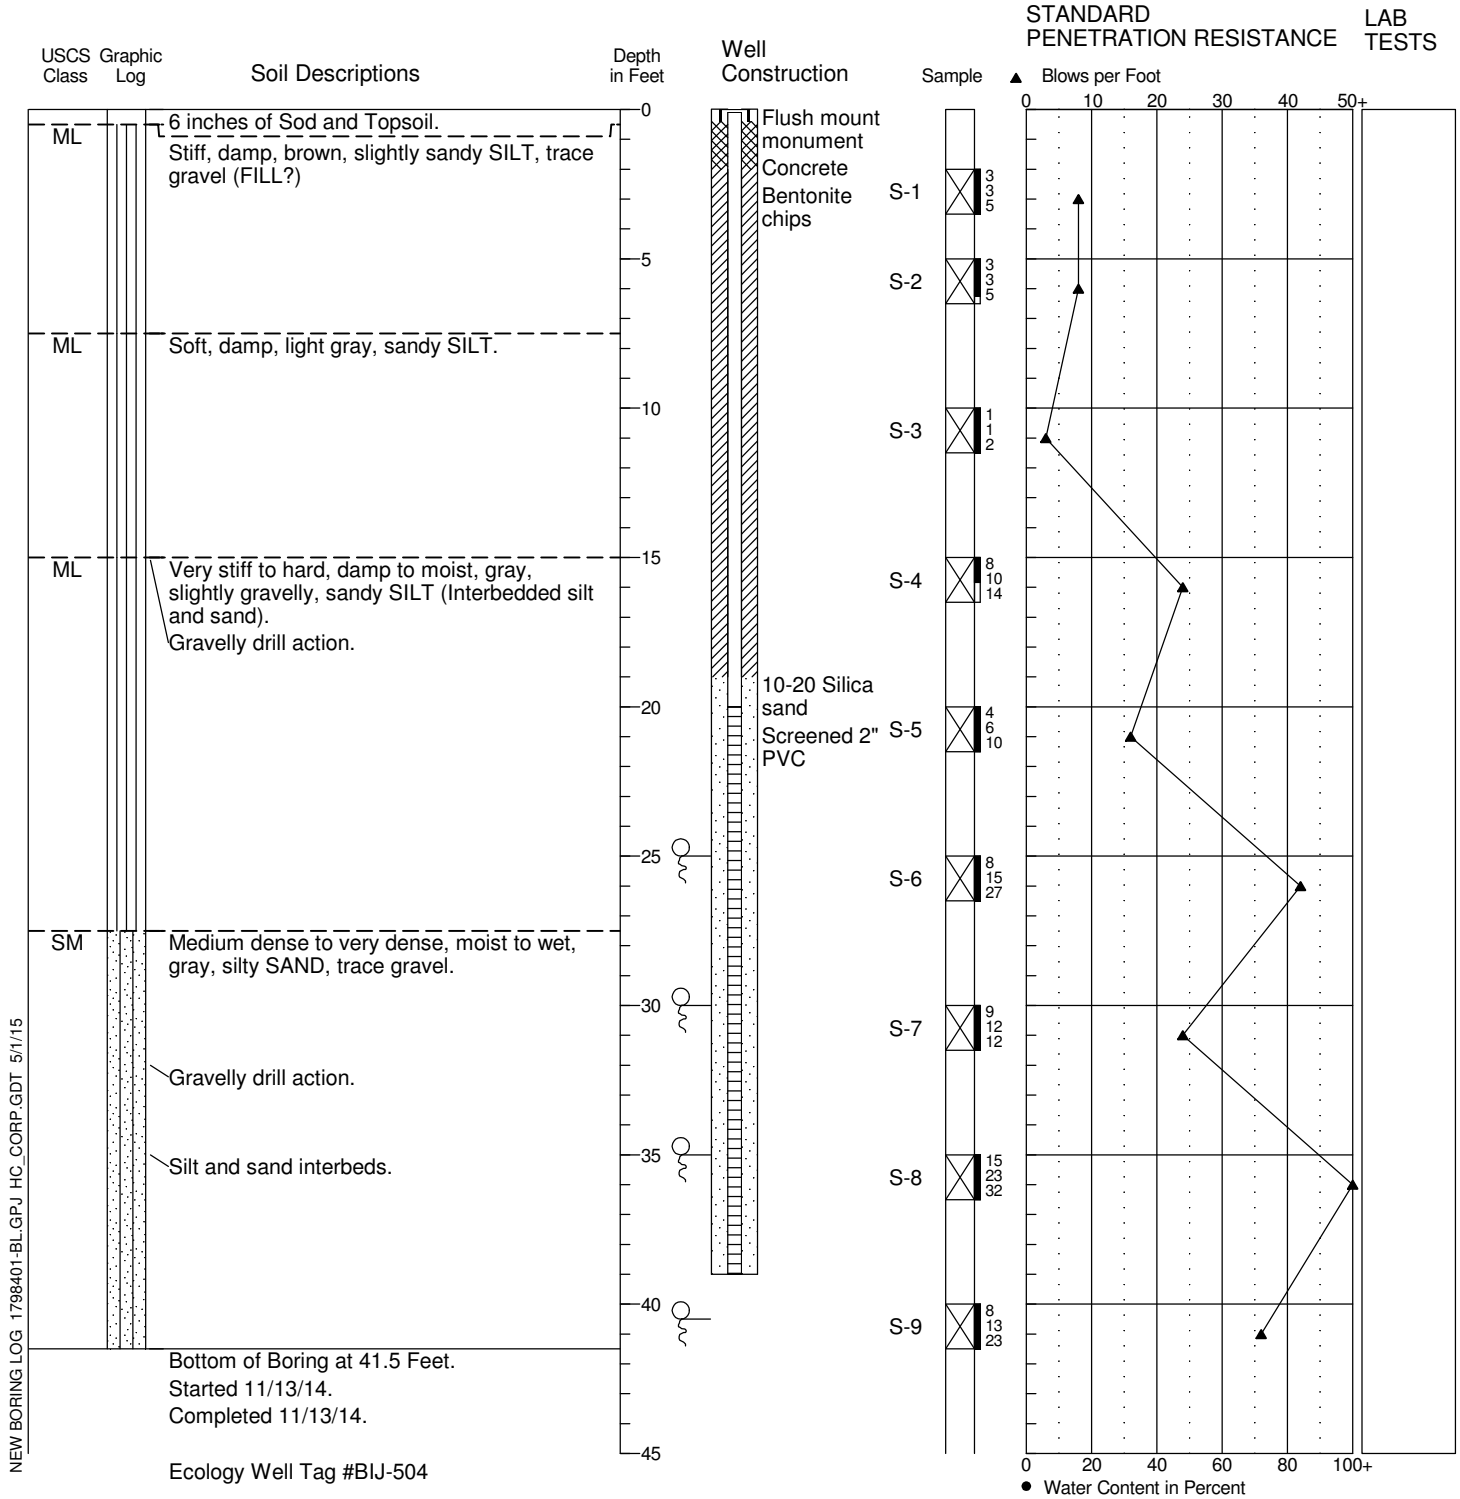


1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.

Boring Log HC-2

Location: 47.584729, -122.234870
 Approximate Ground Surface Elevation: 83 Feet
 Horizontal Datum: WGS84
 Vertical Datum: NAVD88

Drill Equipment: HSA (Diedrich D50)
 Hammer Type: Auto-Trip
 Hole Diameter: 8 inches
 Logged By: M. Smith Reviewed By: M. Veenstra


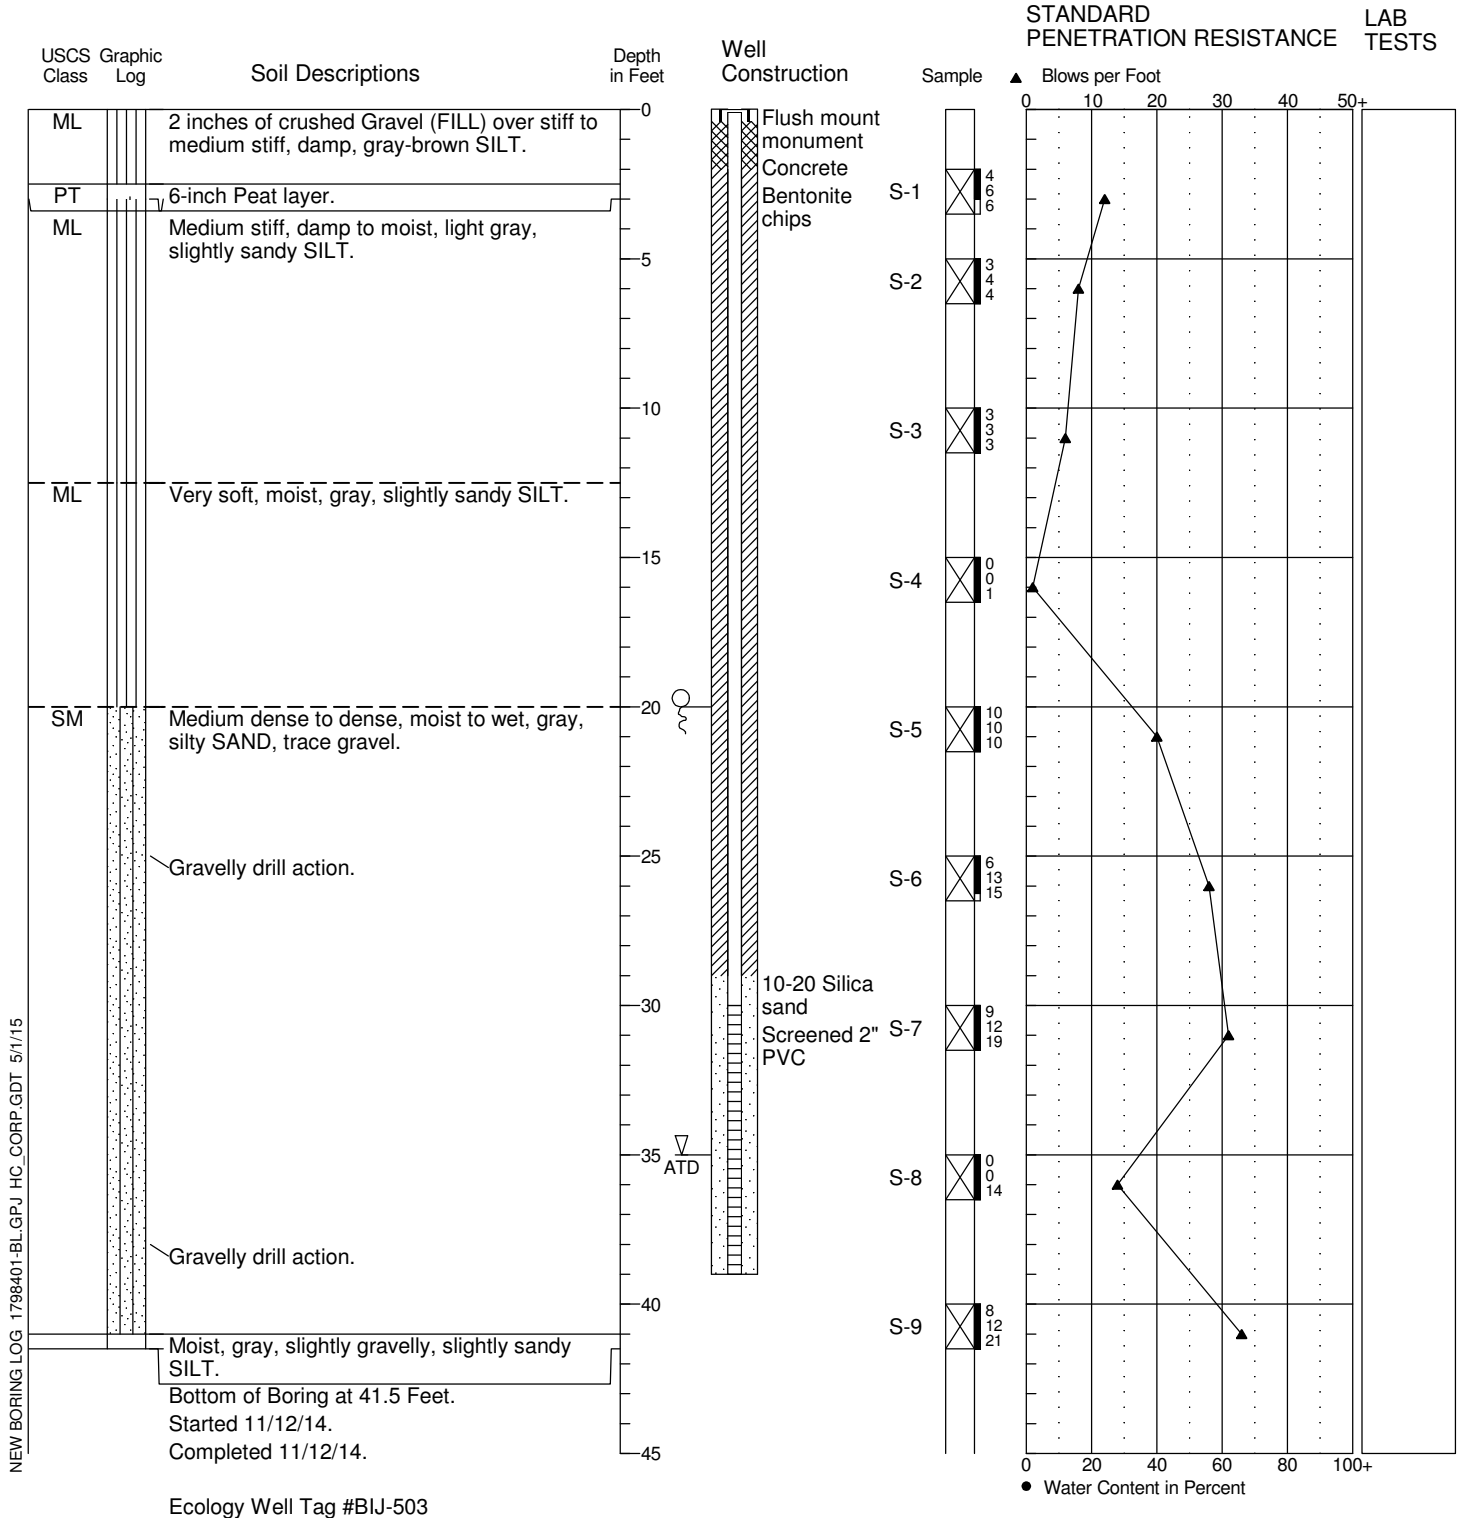


1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.

Boring Log HC-3

Location: 47.585134, -122.234493
 Approximate Ground Surface Elevation: 83 Feet
 Horizontal Datum: WGS84
 Vertical Datum: NAVD88

Drill Equipment: HSA (Diedrich D50)
 Hammer Type: Auto-Trip
 Hole Diameter: 8 inches
 Logged By: M. Smith Reviewed By: M. Veenstra

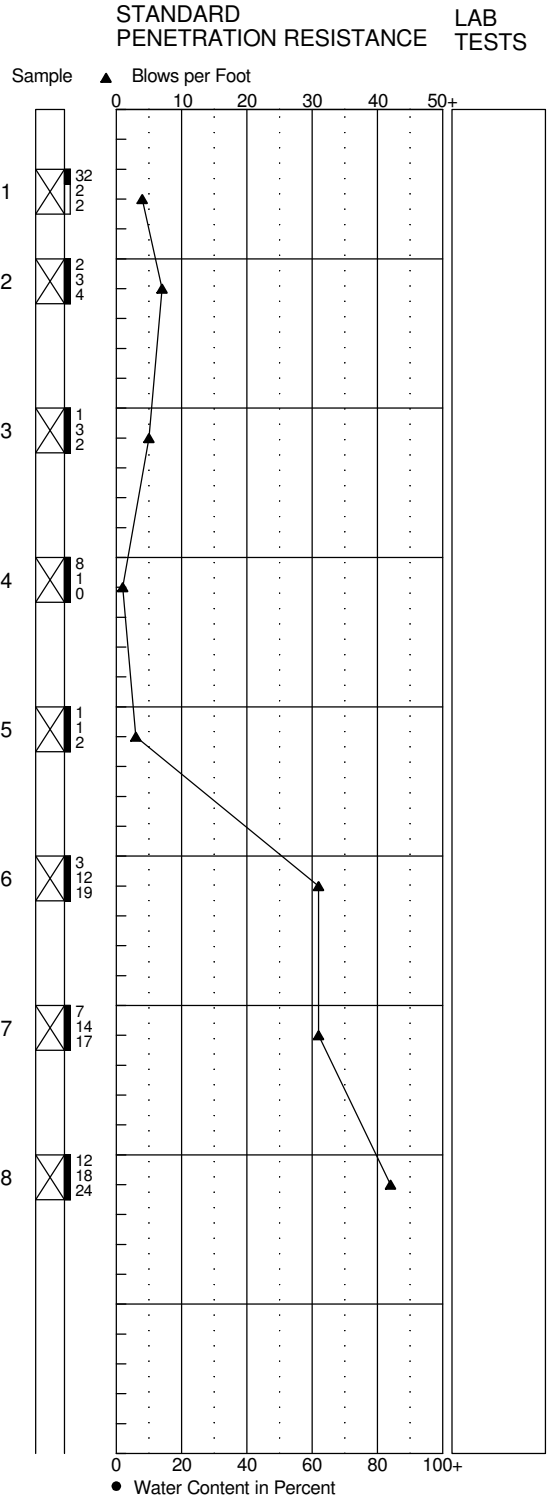
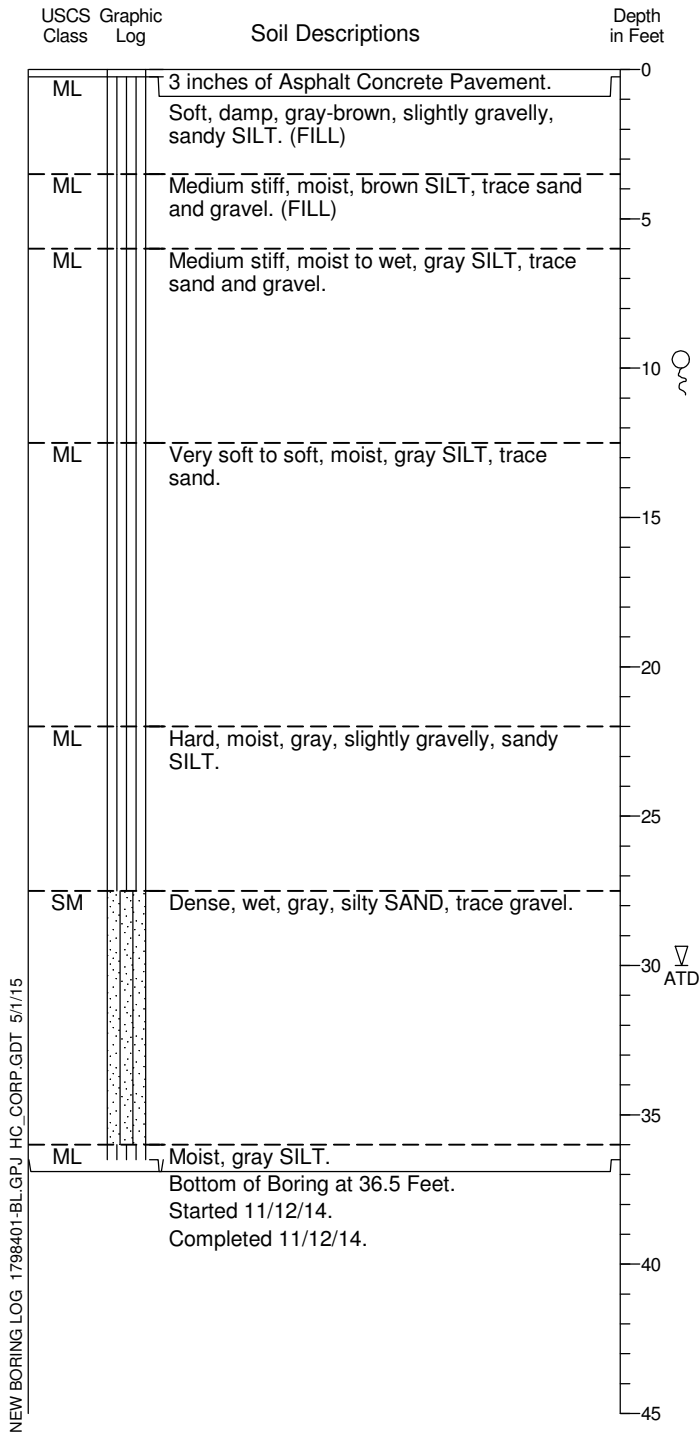


1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.

Boring Log HC-4

Location: 47.585142, -122.233965
 Approximate Ground Surface Elevation: 88 Feet
 Horizontal Datum: WGS84
 Vertical Datum: NAVD88

Drill Equipment: HSA (Diedrich D50)
 Hammer Type: Auto-Trip
 Hole Diameter: 8 inches
 Logged By: M. Smith Reviewed By: M. Veenstra

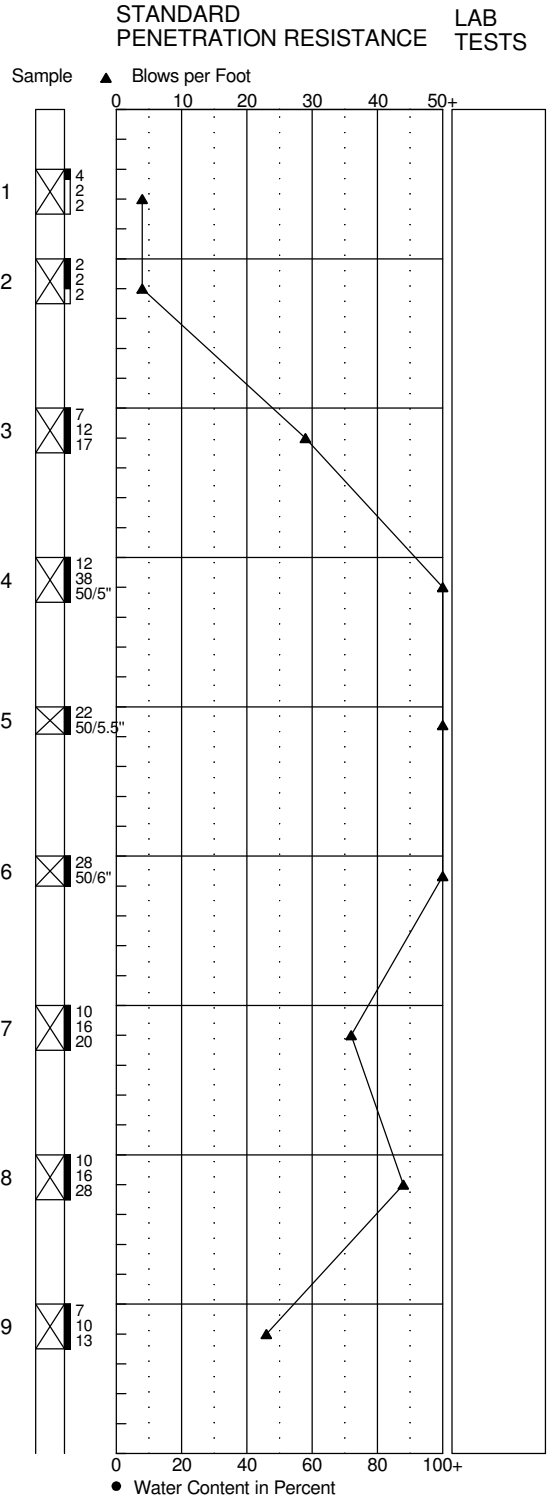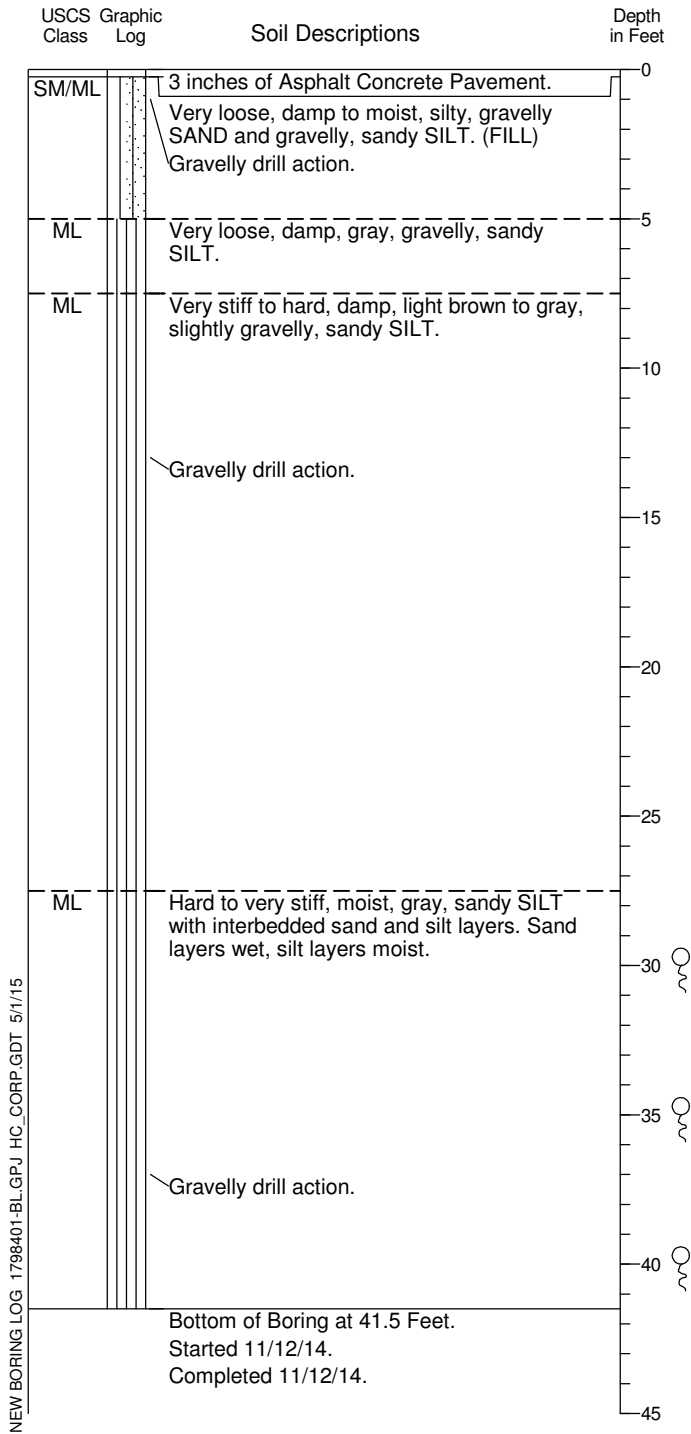


NEW BORING LOG 1798401-BL.GPJ HC_CORP.GDT 5/1/15

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.

Push Probe Log B-1

Location: Lat: 47.58453 Long: -122.2343
 Approximate Ground Surface Elevation: 82 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

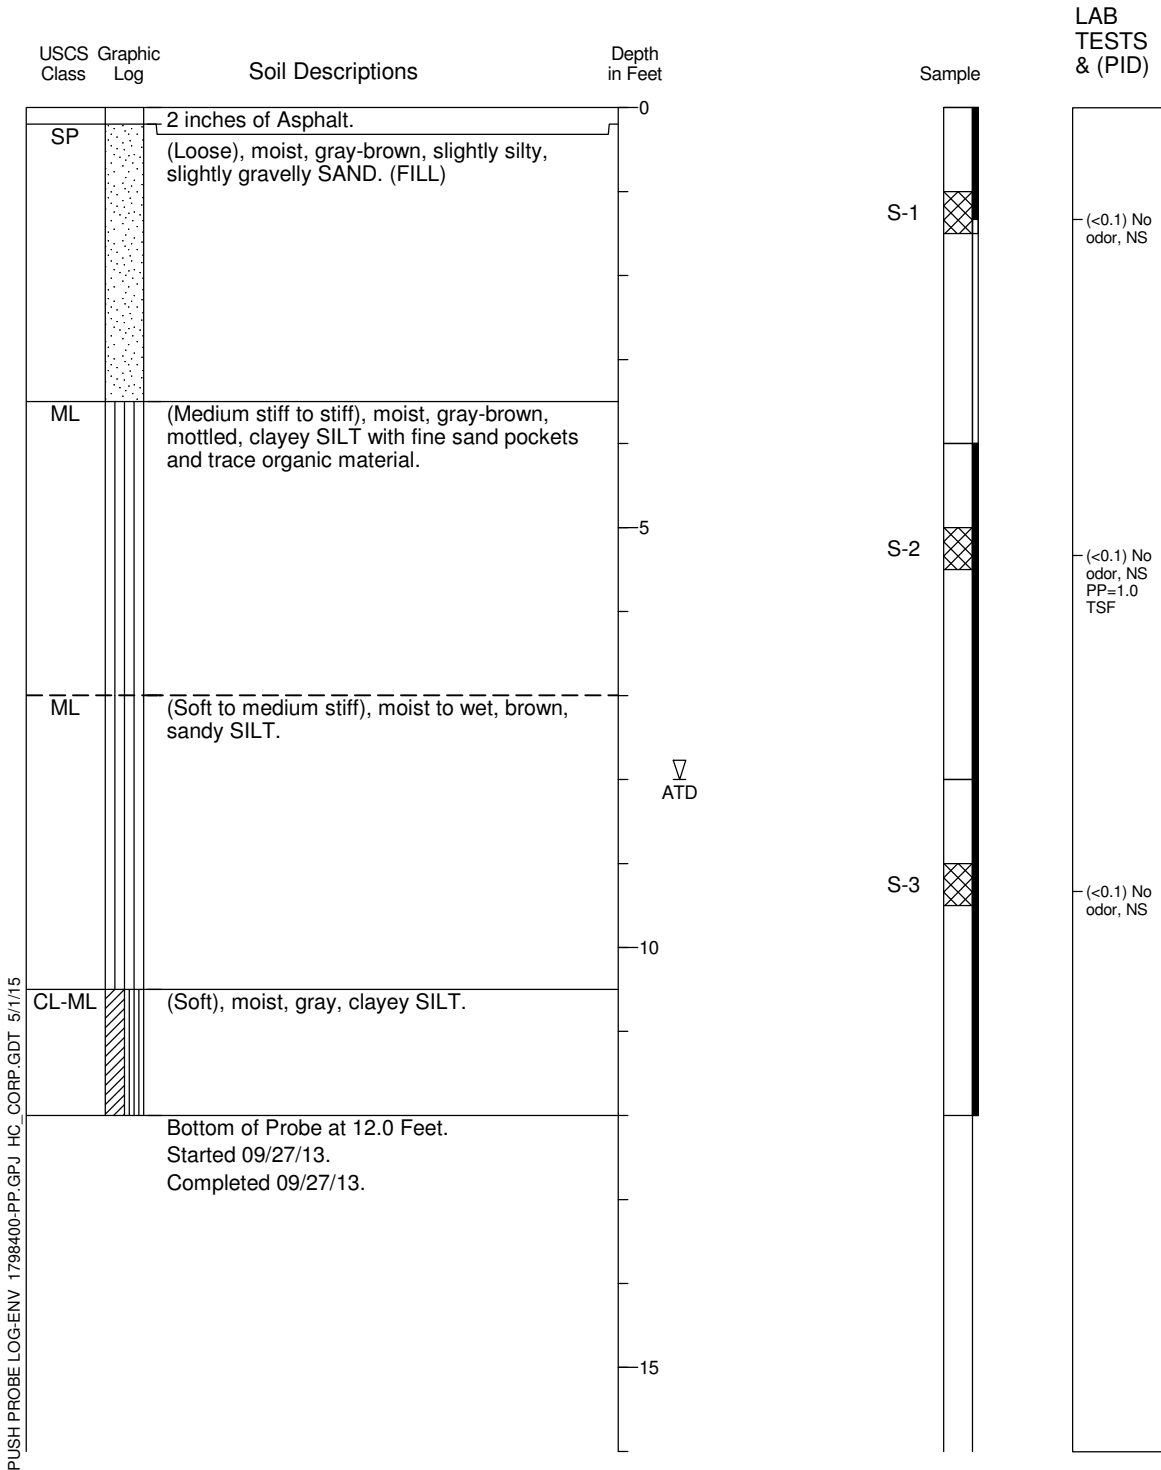

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00


9/13

Figure A-6

Push Probe Log B-2

Location: Lat: 47.58454 Long: -122.2345
 Approximate Ground Surface Elevation: 82 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

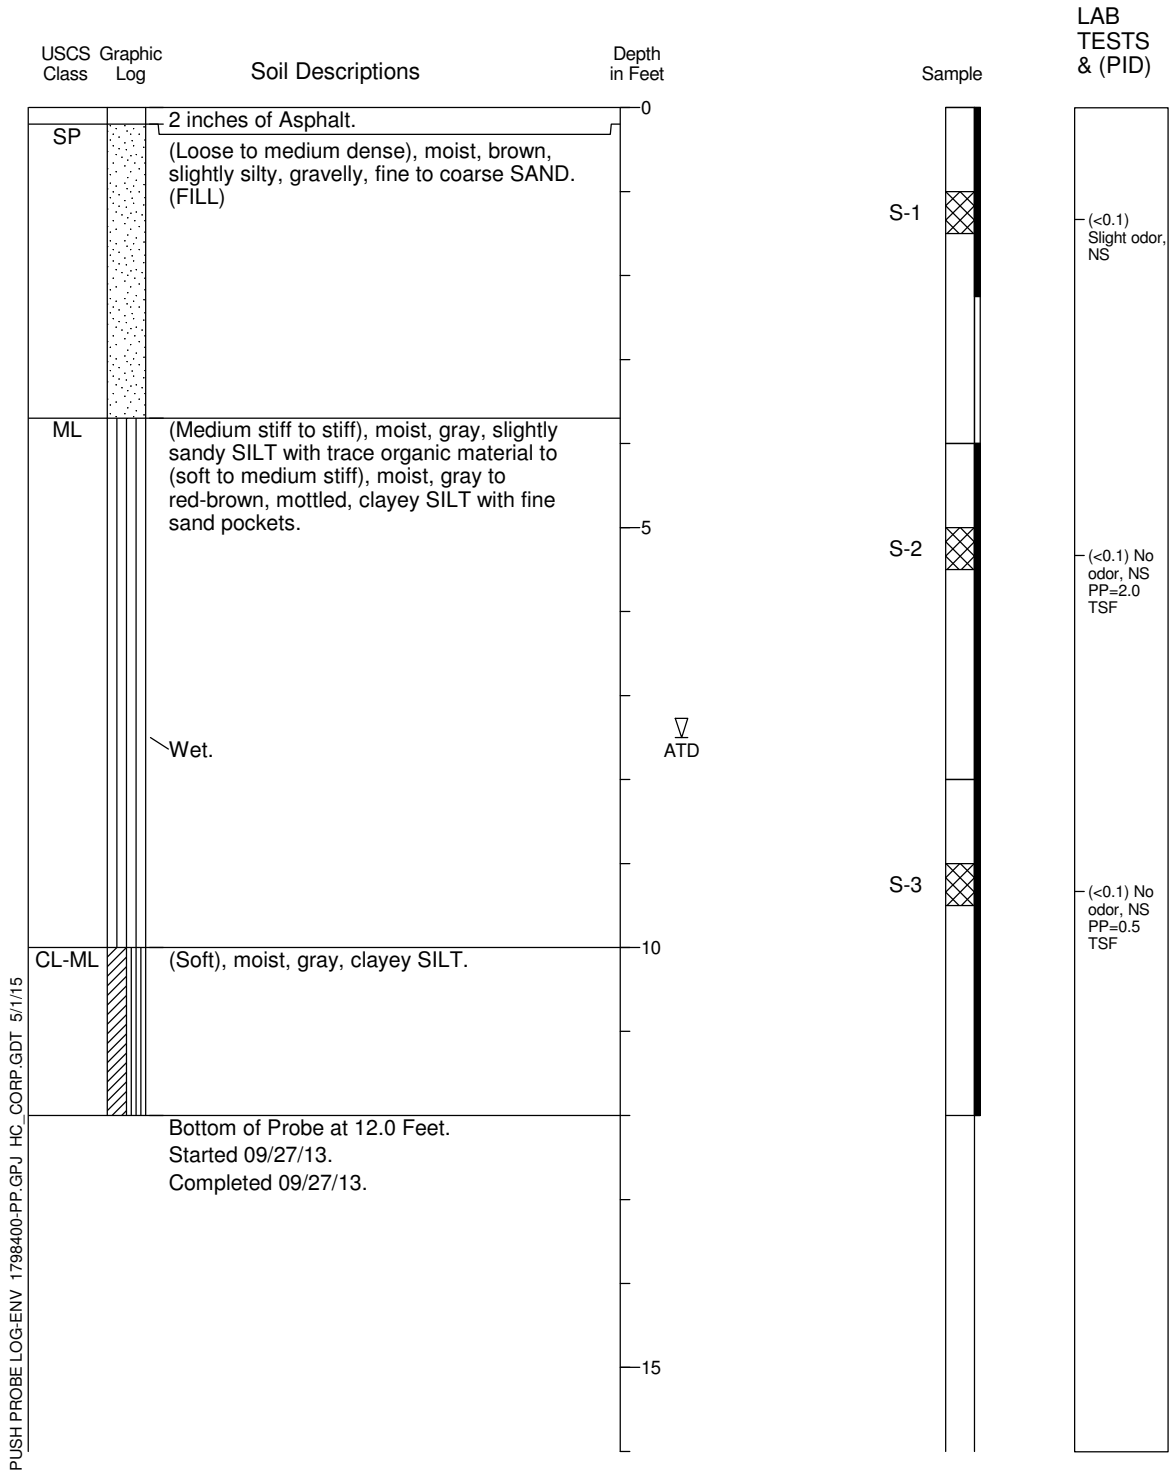


1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen

Push Probe Log B-3

Location: Lat: 47.58477 Long: -122.2349
 Approximate Ground Surface Elevation: 84 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

LAB TESTS

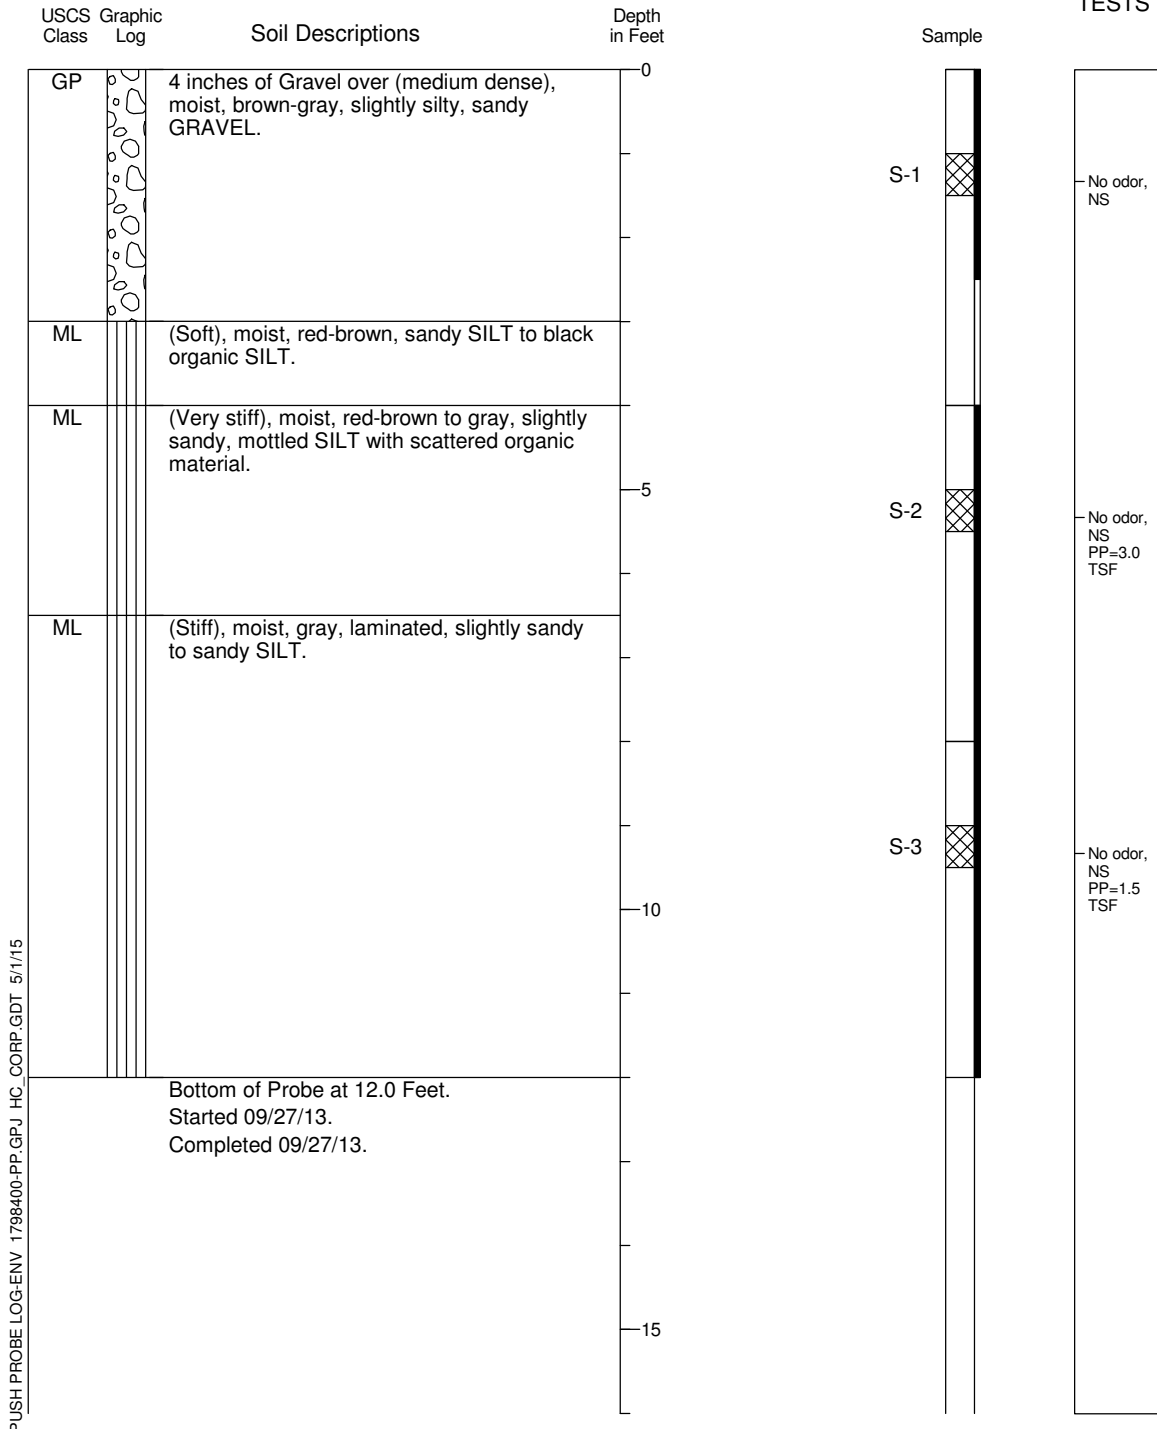

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00

9/13


Figure A-8

Push Probe Log B-4

Location: Lat: 47.58468 Long: -122.2348
 Approximate Ground Surface Elevation: 84 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

LAB TESTS

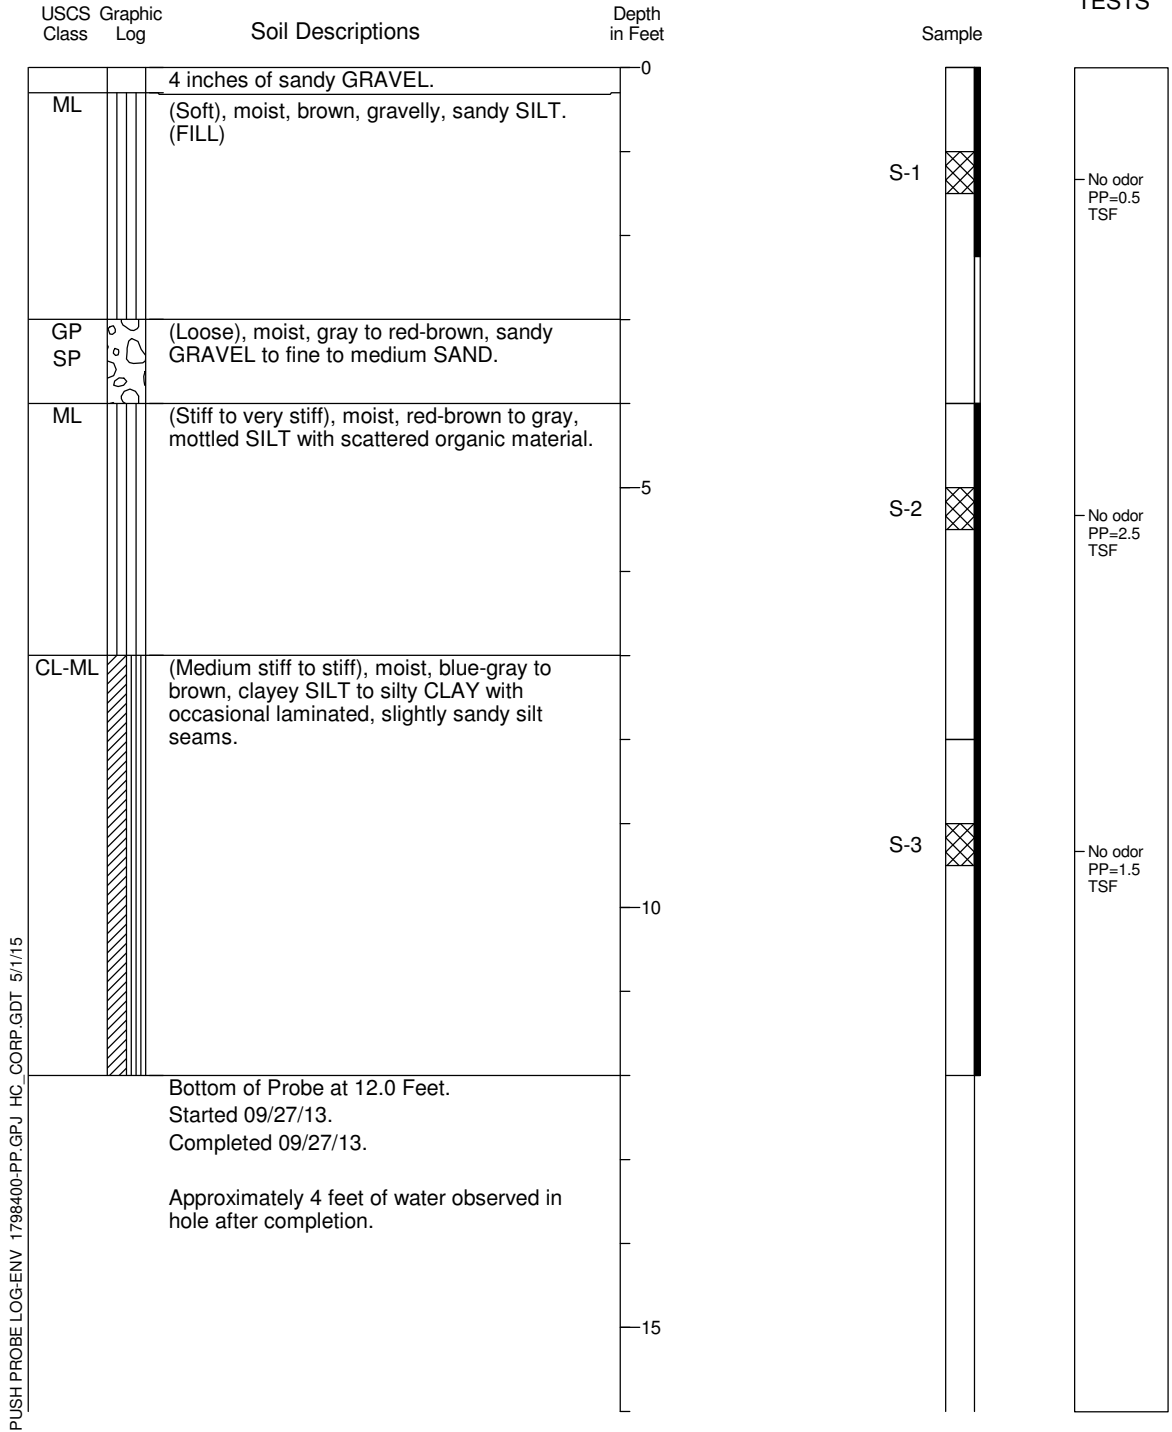

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00

9/13


Figure A-9

Push Probe Log B-5

Location: Lat: 47.5846 Long: -122.2346
 Approximate Ground Surface Elevation: 81 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

LAB TESTS

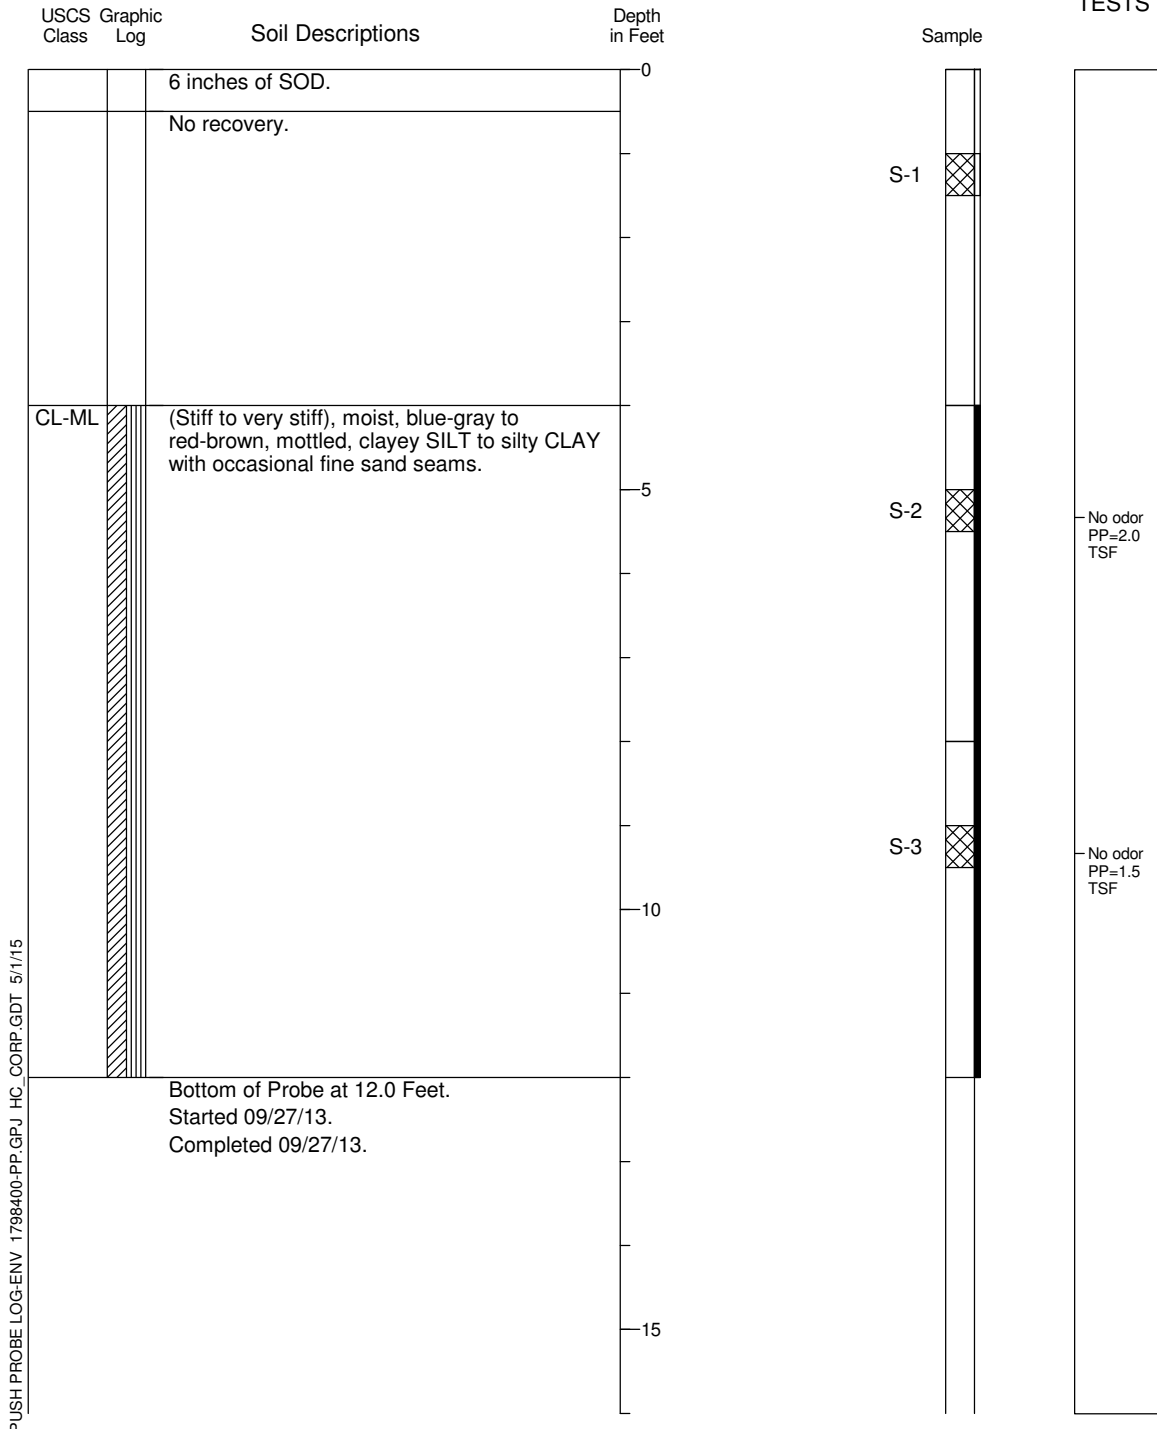

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00


9/13

Figure A-10

Push Probe Log B-6

Location: Lat: 47.58482 Long: -122.2345
 Approximate Ground Surface Elevation: 81 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

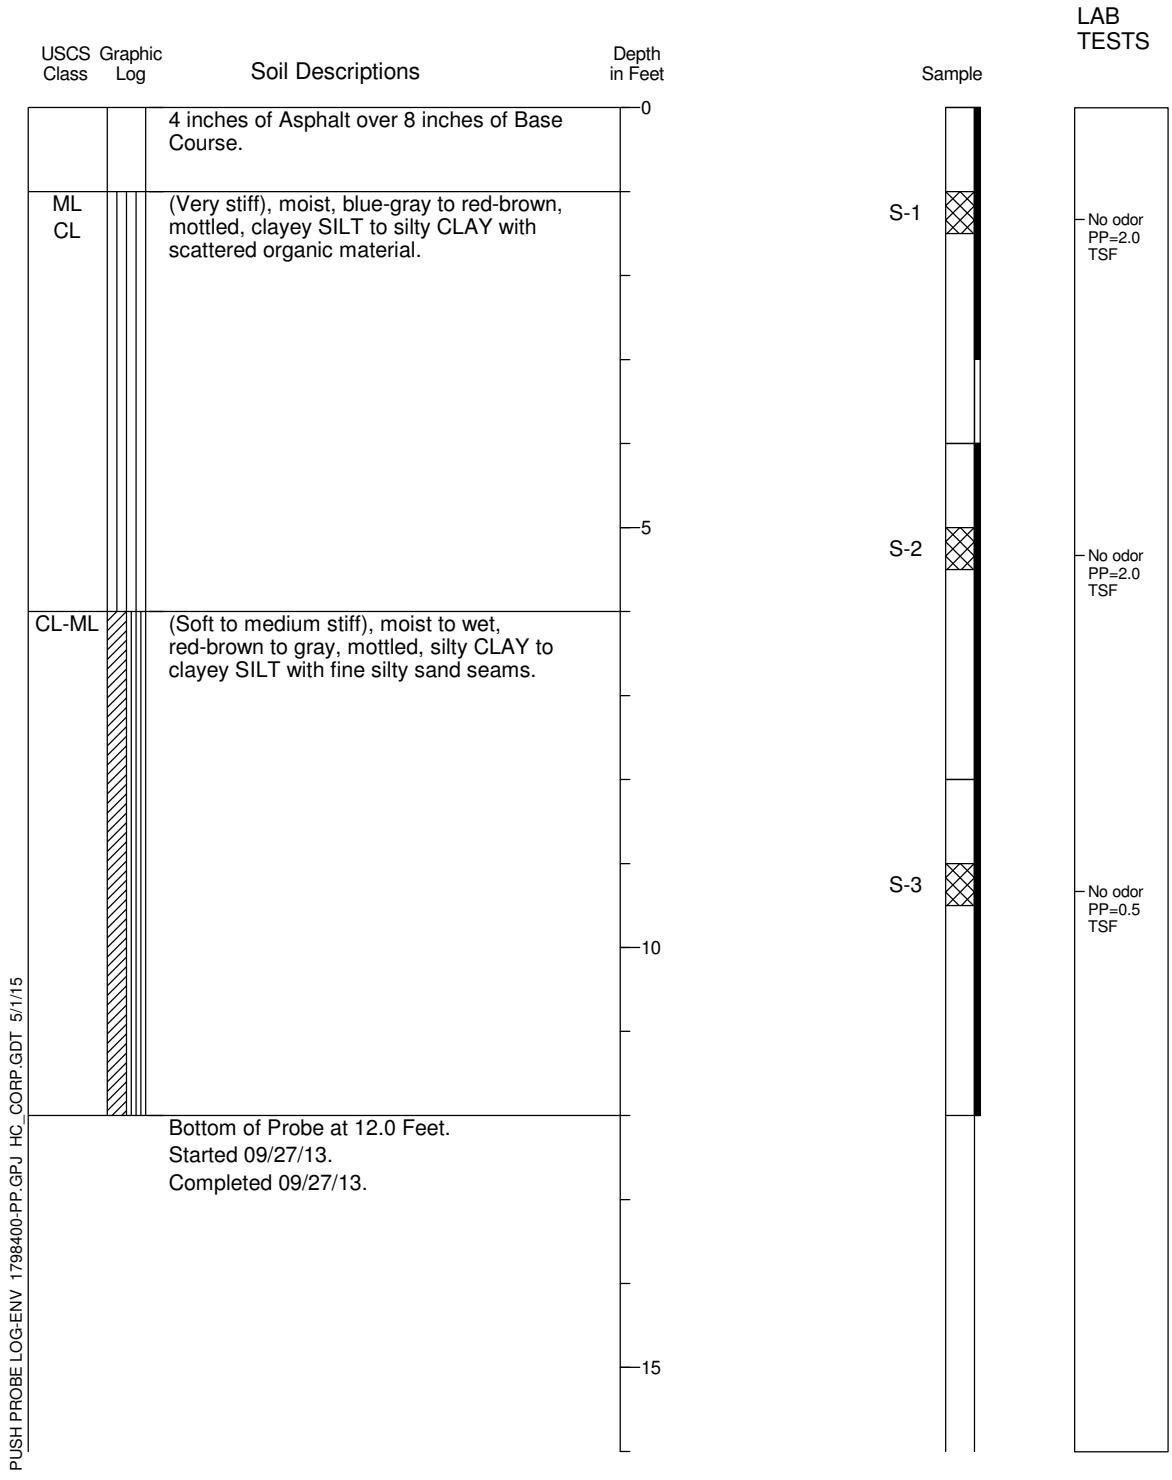

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00

9/13


Figure A-11

Push Probe Log B-7

Location: Lat: 47.58514 Long: -122.2342
 Approximate Ground Surface Elevation: 86 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

LAB TESTS

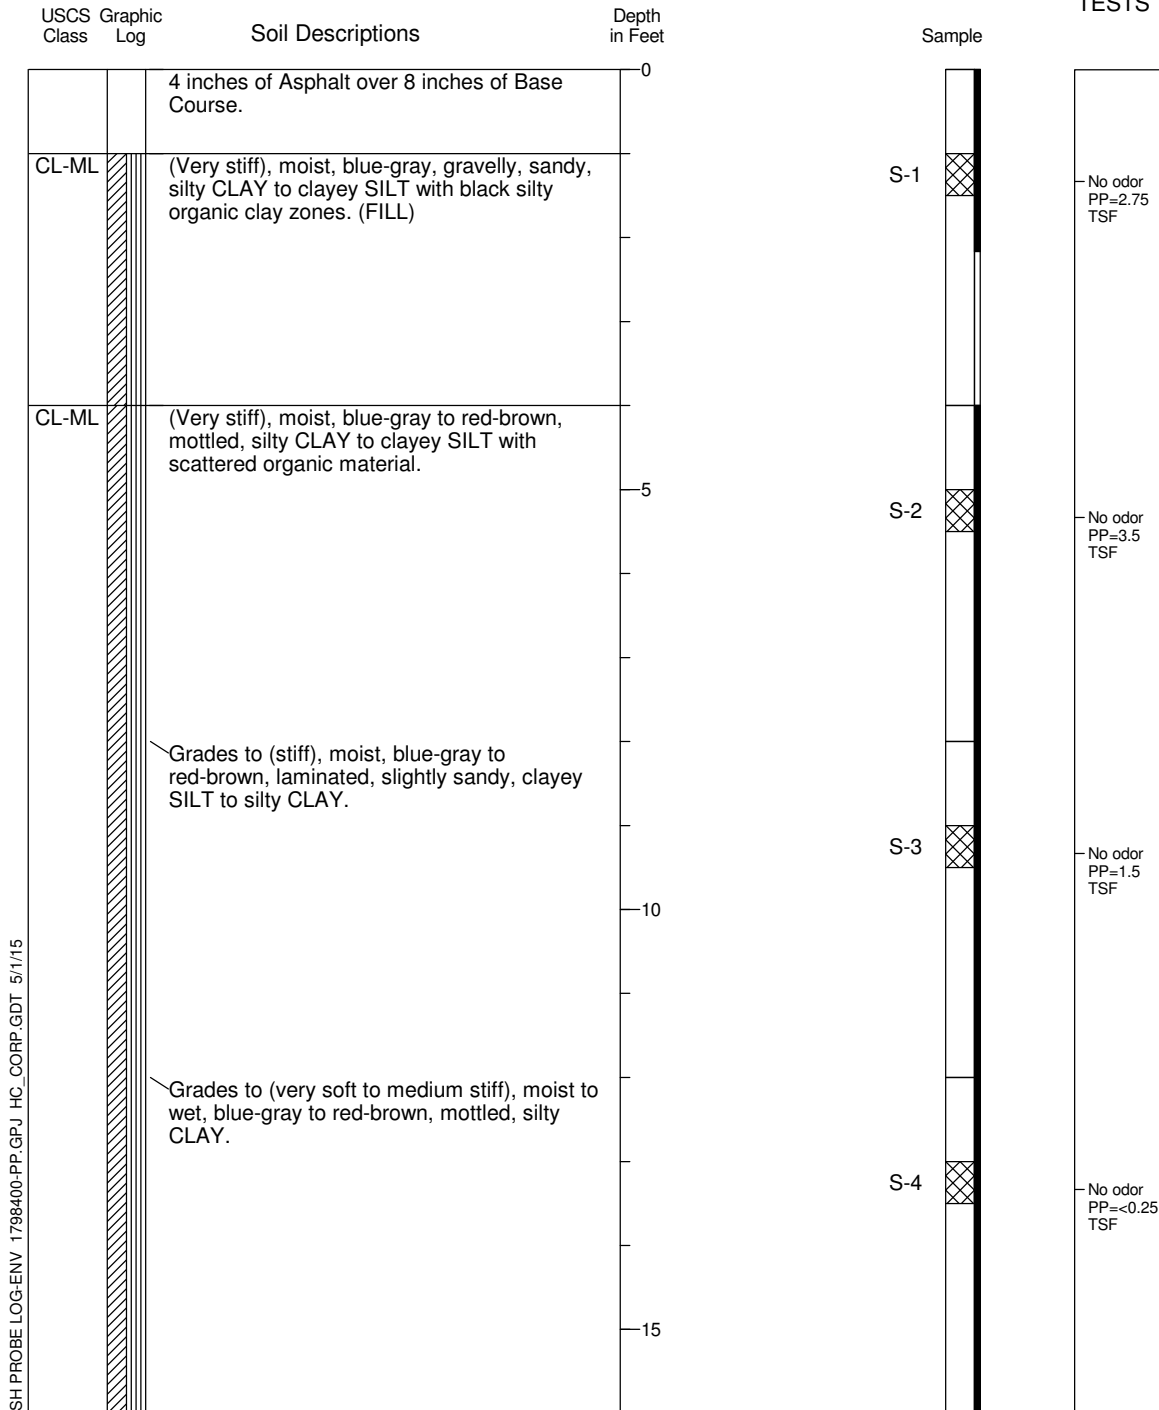

PUSH PROBE LOG-ENV 1798400-PP.GPJ HC_CORP.GDT 5/1/15

Bottom of Probe at 16.0 Feet.
 Started 09/27/13.
 Completed 09/27/13.

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00

9/13


Figure A-12

Push Probe Log B-8

Location: Lat: 47.58477 Long: -122.2338
 Approximate Ground Surface Elevation: 92 Feet
 Horizontal Datum: WGS 84
 Vertical Datum: NAVD88

Drill Equipment: Push Probe
 Sample Type: Acetate Liner
 Hole Diameter: 2 inches
 Logged By: W. McDonald Reviewed By: M. Veenstra

LAB TESTS

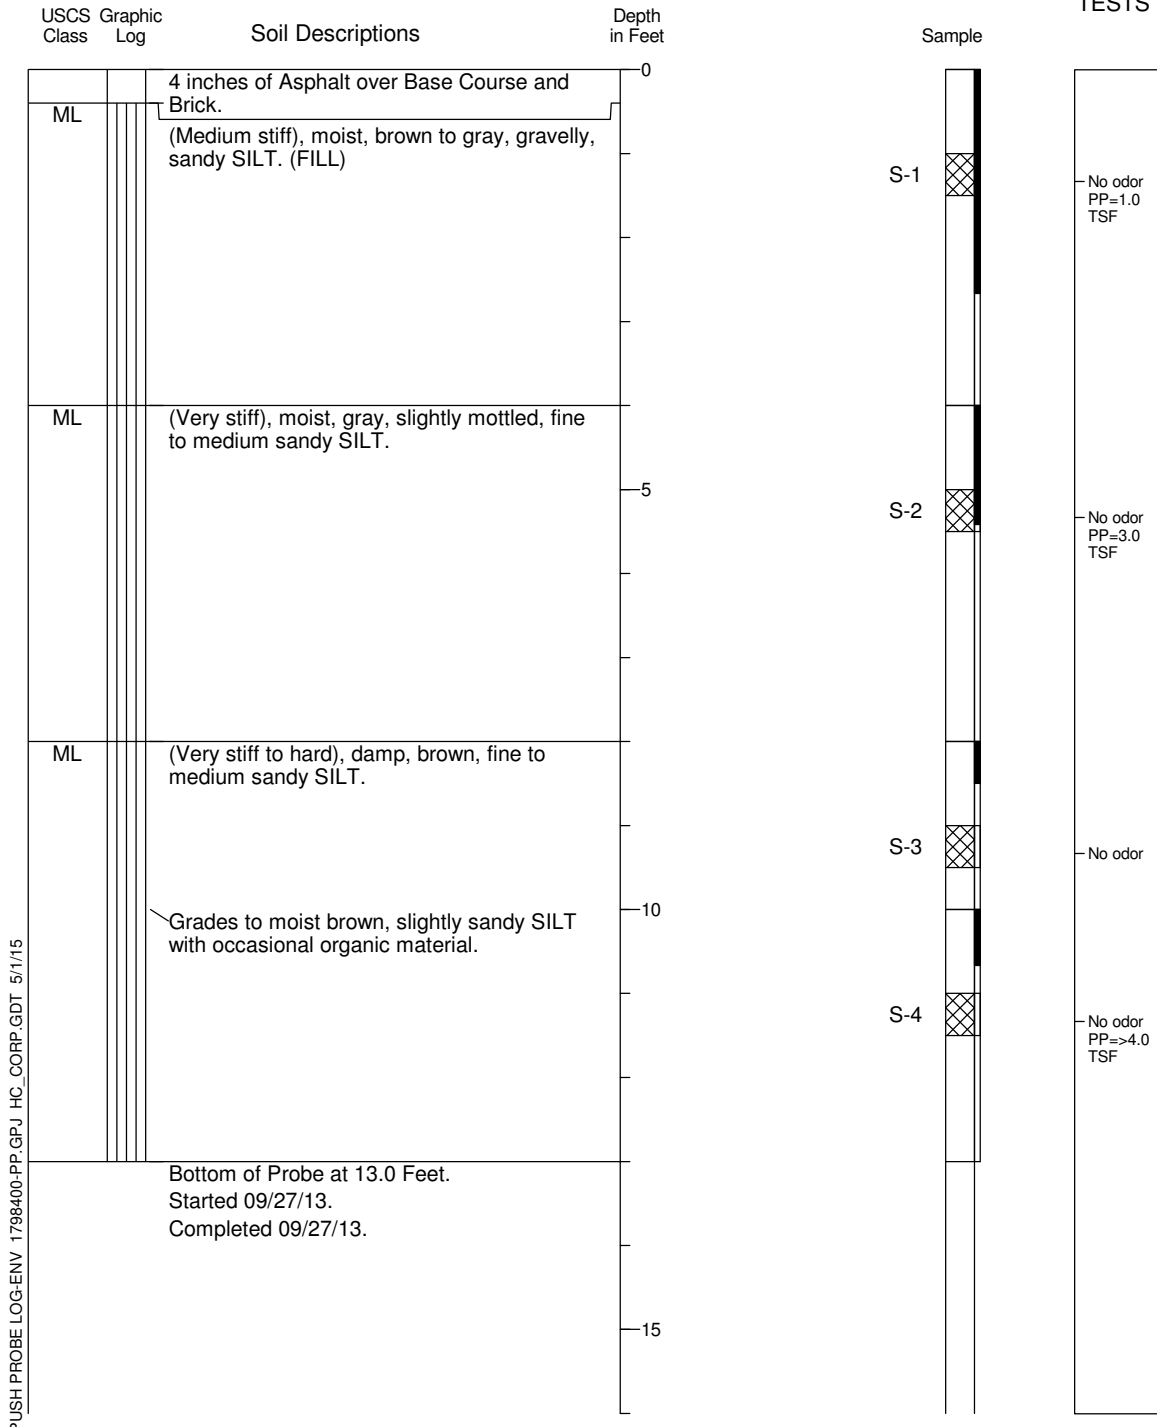

1. Refer to Figure A-1 for explanation of descriptions and symbols.
2. Soil descriptions and stratum lines are interpretive and actual changes may be gradual.
3. USCS designations are based on visual manual classification (ASTM D 2488) unless otherwise supported by laboratory testing (ASTM D 2487).
4. Groundwater level, if indicated, is at time of drilling (ATD) or for date specified. Level may vary with time.
5. NS = No Sheen; SS = Slight Sheen; MS = Moderate Sheen; HS = Heavy Sheen



HARTCROWSER

17984-00

9/13

Figure A-13

WILDCAT DYNAMIC CONE LOG

Hart Crowser
1700 Westlake Ave N.
Seattle, WA 98109

PROJECT NUMBER: 1798401
DATE STARTED: 11-20-2014
DATE COMPLETED: 11-20-2014

HOLE #: HC-5
CREW: Jesse Overton
PROJECT: Mercer Island Multi-Family
ADDRESS: _____
LOCATION: Mercer Island, Washington

SURFACE ELEVATION: _____
WATER ON COMPLETION: _____
HAMMER WEIGHT: 35 lbs.
CONE AREA: 10 sq. cm

DEPTH	BLOWS PER 10 cm	RESISTANCE Kg/cm ²	GRAPH OF CONE RESISTANCE				N'	TESTED CONSISTENCY	
			0	50	100	150		NON-COHESIVE	COHESIVE
-	18	79.9				22	MEDIUM DENSE	VERY STIFF
-	23	102.1				25+	MEDIUM DENSE	VERY STIFF
- 1 ft	14	62.2				17	MEDIUM DENSE	VERY STIFF
-	12	53.3				15	MEDIUM DENSE	STIFF
-	10	44.4				12	MEDIUM DENSE	STIFF
- 2 ft	9	40.0				11	MEDIUM DENSE	STIFF
-	9	40.0				11	MEDIUM DENSE	STIFF
-	10	44.4				12	MEDIUM DENSE	STIFF
- 3 ft	14	62.2				17	MEDIUM DENSE	VERY STIFF
- 1 m	9	40.0				11	MEDIUM DENSE	STIFF
-	11	42.5				12	MEDIUM DENSE	STIFF
- 4 ft	11	42.5				12	MEDIUM DENSE	STIFF
-	11	42.5				12	MEDIUM DENSE	STIFF
-	10	38.6				11	MEDIUM DENSE	STIFF
- 5 ft	8	30.9				8	LOOSE	MEDIUM STIFF
-	6	23.2				6	LOOSE	MEDIUM STIFF
-	6	23.2				6	LOOSE	MEDIUM STIFF
- 6 ft	7	27.0				7	LOOSE	MEDIUM STIFF
-	6	23.2				6	LOOSE	MEDIUM STIFF
- 2 m	6	23.2				6	LOOSE	MEDIUM STIFF
- 7 ft	6	20.5				5	LOOSE	MEDIUM STIFF
-	6	20.5				5	LOOSE	MEDIUM STIFF
-	5	17.1				4	VERY LOOSE	SOFT
- 8 ft	6	20.5				5	LOOSE	MEDIUM STIFF
-	5	17.1				4	VERY LOOSE	SOFT
-	5	17.1				4	VERY LOOSE	SOFT
- 9 ft	6	20.5				5	LOOSE	MEDIUM STIFF
-	6	20.5				5	LOOSE	MEDIUM STIFF
-	6	20.5				5	LOOSE	MEDIUM STIFF
- 3 m 10 ft	6	20.5				5	LOOSE	MEDIUM STIFF
-	6	18.4				5	LOOSE	MEDIUM STIFF
-	6	18.4				5	LOOSE	MEDIUM STIFF
-	12	36.7				10	LOOSE	STIFF
- 11 ft	9	27.5				7	LOOSE	MEDIUM STIFF
-	6	18.4				5	LOOSE	MEDIUM STIFF
-	7	21.4				6	LOOSE	MEDIUM STIFF
- 12 ft	4	12.2	...				3	VERY LOOSE	SOFT
-	5	15.3				4	VERY LOOSE	SOFT
-	6	18.4				5	LOOSE	MEDIUM STIFF
- 4 m 13 ft	6	18.4				5	LOOSE	MEDIUM STIFF

DEPTH	BLOWS PER 10 cm	RESISTANCE Kg/cm ²	GRAPH OF CONE RESISTANCE				N'	TESTED CONSISTENCY	
			0	50	100	150		NON-COHESIVE	COHESIVE
-	7	19.4				5	LOOSE	MEDIUM STIFF
-	7	19.4				5	LOOSE	MEDIUM STIFF
- 14 ft	9	24.9				7	LOOSE	MEDIUM STIFF
-	8	22.2				6	LOOSE	MEDIUM STIFF
-	8	22.2				6	LOOSE	MEDIUM STIFF
- 15 ft	7	19.4				5	LOOSE	MEDIUM STIFF
-	9	24.9				7	LOOSE	MEDIUM STIFF
-	9	24.9				7	LOOSE	MEDIUM STIFF
- 16 ft	8	22.2				6	LOOSE	MEDIUM STIFF
- 5 m	10	27.7				7	LOOSE	MEDIUM STIFF
-	9	22.9				6	LOOSE	MEDIUM STIFF
- 17 ft	10	25.4				7	LOOSE	MEDIUM STIFF
-	10	25.4				7	LOOSE	MEDIUM STIFF
-	12	30.5				8	LOOSE	MEDIUM STIFF
- 18 ft	11	27.9				7	LOOSE	MEDIUM STIFF
-	12	30.5				8	LOOSE	MEDIUM STIFF
-	24	61.0				17	MEDIUM DENSE	VERY STIFF
- 19 ft	33	83.8				23	MEDIUM DENSE	VERY STIFF
-	21	53.3				15	MEDIUM DENSE	STIFF
- 6 m	21	53.3				15	MEDIUM DENSE	STIFF
- 20 ft	20	46.6				13	MEDIUM DENSE	STIFF
-	28	65.2				18	MEDIUM DENSE	VERY STIFF
- 21 ft	50	116.5				25+	DENSE	HARD
-									
-									
- 22 ft									
-									
- 7 m 23 ft									
-									
-									
- 24 ft									
-									
-									
- 25 ft									
-									
- 26 ft									
- 8 m									
-									
- 27 ft									
-									
- 28 ft									
-									
- 29 ft									
- 9 m									

APPENDIX B

Historical Explorations

APPENDIX B


Historical Explorations

Historical exploration logs are included in this appendix as follows:

Terra 2012. Preliminary Geotechnical Report, Mercer Island North, 2885 - 78th Avenue SE, Mercer Island, Washington. May 10, 2012. Project No. T-6714.

ABPB 2012. Preliminary Geotechnical Report, Multifamily Residential Project, 2885 - 78th Avenue SE, Mercer Island, Washington. October 23, 2012. Project No. 1350.

Logs and test reports by others are included as they were produced by others for reference only and Hart Crowser is not responsible for the accuracy or completeness of the information presented in the logs. Approximate locations of the explorations by others are shown on Figure 2 of this report; actual locations may differ from those shown.

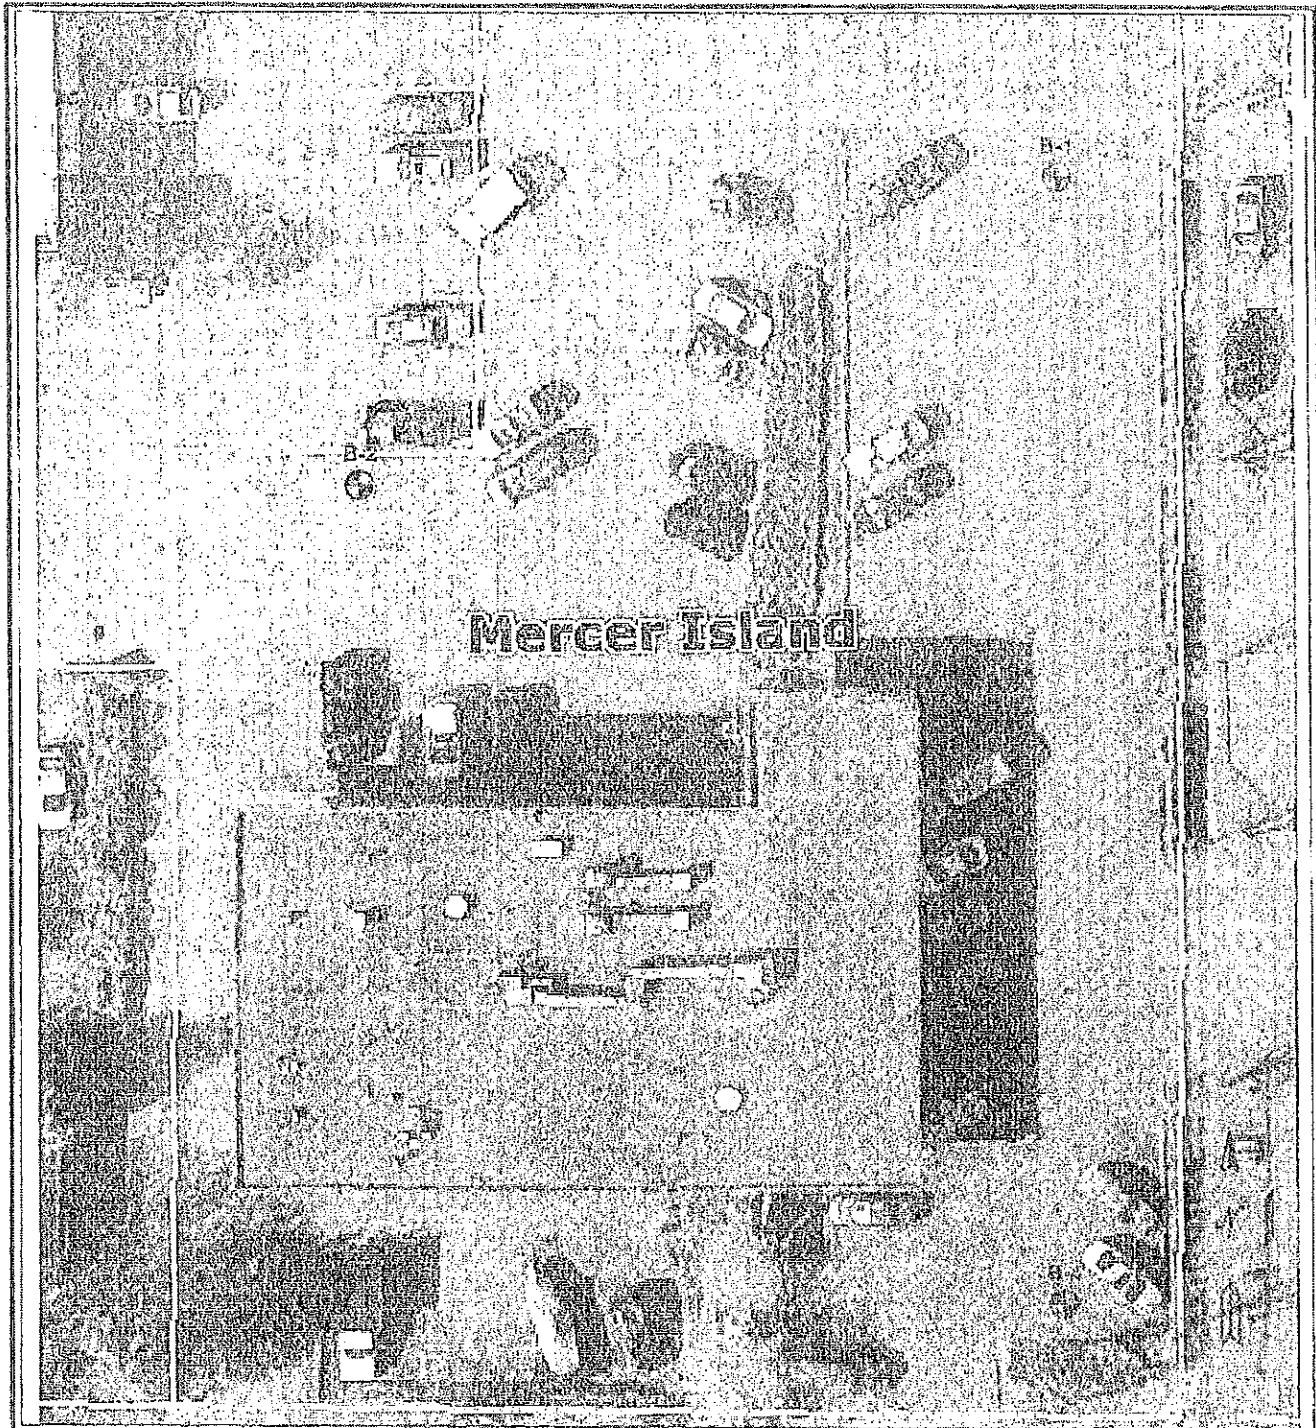

NOTE:

THIS SITE PLAN IS SCHEMATIC. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE. IT IS INTENDED FOR REFERENCE ONLY AND SHOULD NOT BE USED FOR DESIGN OR CONSTRUCTION PURPOSES.

LEGEND:

⊕ APPROXIMATE BORING LOCATION

REFERENCE:

SITE PLAN PROVIDED BY KING COUNTY IMAP



Terra Associates, Inc.
 Consultants in Geotechnical Engineering
 Geology and
 Environmental Earth Sciences

**EXPLORATION LOCATION PLAN
 MERCER ISLAND NORTH
 MERCER ISLAND, WASHINGTON**

Proj. No. T-6714


Date MAY 2012

Figure 2

MAJOR DIVISIONS			LETTER SYMBOL	TYPICAL DESCRIPTION
COARSE GRAINED SOILS More than 50% material larger than No. 200 sieve size	GRAVELS More than 50% of coarse fraction is larger than No. 4 sieve	Clean Gravels (less than 5% fines)	GW	Well-graded gravels, gravel-sand mixtures, little or no fines.
		Gravels with fines	GP	Poorly-graded gravels, gravel-sand mixtures, little or no fines.
			GM	Silly gravels, gravel-sand-silt mixtures, non-plastic fines.
			GC	Clayey gravels, gravel-sand-clay mixtures, plastic fines.
	SANDS More than 50% of coarse fraction is smaller than No. 4 sieve	Clean Sands (less than 5% fines)	SW	Well-graded sands, gravelly sands, little or no fines.
		Sands with fines	SP	Poorly-graded sands or gravelly sands, little or no fines.
			SM	Silly sands, sand-silt mixtures, non-plastic fines.
			SC	Clayey sands, sand-clay mixtures, plastic fines.
FINE GRAINED SOILS More than 50% material smaller than No. 200 sieve size	SILTS AND CLAYS Liquid limit is less than 50%	ML	Inorganic silts, rock flour, clayey silts with slight plasticity.	
		CL	Inorganic clays of low to medium plasticity, (lean clay).	
		OL	Organic silts and organic clays of low plasticity.	
	SILTS AND CLAYS Liquid limit is greater than 50%	MH	Inorganic silts, elastic.	
		CH	Inorganic clays of high plasticity, fat clays.	
		OH	Organic clays of high plasticity.	
HIGHLY ORGANIC SOILS			PT	Peat.

DEFINITION OF TERMS AND SYMBOLS

COHESIONLESS	Density	Standard Penetration Resistance in Blows/Foot	I 2" OUTSIDE DIAMETER SPLIT SPOON SAMPLER I 2.4" INSIDE DIAMETER RING SAMPLER OR SHELBY TUBE SAMPLER ∇ WATER LEVEL (DATE) Tr TORVANE READINGS, tsf Pp PENETROMETER READING, tsf DD DRY DENSITY, pounds per cubic foot LL LIQUID LIMIT, percent PI PLASTIC INDEX N STANDARD PENETRATION, blows per foot
	Very loose	0-4	
Loose	4-10		
Medium dense	10-30		
Dense	30-50		
Very dense	>50		
COHESIVE	Consistency	Standard Penetration Resistance in Blows/Foot	
	Very soft	0-2	
	Soft	2-4	
	Medium stiff	4-8	
	Stiff	8-16	
	Very stiff	16-32	
	Hard	>32	



Terra Associates, Inc.

Consultants in Geotechnical Engineering
Geology and
Environmental Earth Sciences

UNIFIED SOIL CLASSIFICATION SYSTEM
MERCER ISLAND NORTH
MERCER ISLAND, WASHINGTON

Proj. No. T-6714

Date MAY 2012

Figure A-1

LOG OF BORING NO. B-1

Figure No. A-2

Project: Mercer Island North Project No: T-6714 Date Drilled: 4-25-12

Client: PMF Investments Driller: BORETEC Logged By: CSD

Location: Mercer Island, Washington Approx. Elev: N/A

Depth (ft)	Sample Interval	Soil Description	Consistency/ Relative Density	Moisture Content % Wp -----x----- Wl 10 20 30 40	Pocket Penetrometer				Observ. Well
					TSF				
					1	2	3	4	
1		(4 inches ASPHALT)							
2		FILL: brown sand with silt and gravel, fine to coarse grained, moist.	Medium Dense		18				
3									
4		FILL: brown and gray silty sand with gravel, fine to medium grained, moist.	Loose	18.3 x	3				
5									
6		Dark brown SILT with organics, fine grained, moist.	Loose						
7		Gray SILT, fine grained, moist, sand pockets, slight mottling.	Stiff	40.0 x	14				
8									
9		Brown SILT, fine grained, moist to wet, sand pockets.	Medium Stiff	28.2 x	4				
10									
11		Gray silty SAND, fine to medium grained, moist to wet. (SM)	Very Dense	22.5 x	42				
12									
13		*See Next Page		14.5 x					
14									
15									
16									
17									
18									
19									
20									

Note: This borehole log has been prepared for geotechnical purposes. This information pertains only to this boring location and should not be interpreted as being indicative of other areas of the site.



Terra Associates, Inc.
 Consultants in Geotechnical Engineering, Geology and Environmental Earth Sciences

LOG OF BORING NO. B-1

Figure No. A-2

Project: Mercer Island North Project No: T-6714 Date Drilled: 4-25-12
 Client: PMF Investments Driller: BORETEC Logged By: CSD
 Location: Mercer Island, Washington Approx. Elev: N/A

Depth (ft)	Sample Interval	Soil Description	Consistency/ Relative Density	Moisture Content % Wp -----x----- Wl 10 20 30 40	Pocket Penetrometer				Observ. Well
					1	2	3	4	
					SPT (N) Blows/ft				
21		Gray silty SAND, fine to medium grained, moist to wet. (SM)	Very Dense	12.5 x					50/4
22									
23									
24									
25				15.2 x					50/6
26									
27									
28									
29		Gray SILT, fine grained, moist. (ML)	Hard						
30						12.4 x			
31									
32		Test boring terminated at 31 feet. Perched groundwater observed at 13 feet during drilling. Boring converted to 2-inch monitoring well.							
33									
34									
35									
36									
37									
38									
39									
40									

Note: This borehole log has been prepared for geotechnical purposes. This information pertains only to this boring location and should not be interpreted as being indicative of other areas of the site.



Terra Associates, Inc.
 Consultants in Geotechnical Engineering, Geology and Environmental Earth Sciences

LOG OF BORING NO. B-2

Figure No. A-3

Project: Mercer Island North Project No: T-6714 Date Drilled: 4-25-12

Client: PMF Investments Driller: BORETEC Logged By: CSD

Location: Mercer Island, Washington Approx. Elev: N/A

Depth (ft)	Sample Interval	Soil Description	Consistency/ Relative Density	Moisture Content % Wp ---x--- Wl 10 30 50 70 90	Pocket Penetrometer					
					TSF			SPT (N)		
					1	2	3	4		
					Blows/ft					
					10	20	30	40		
1		(4 inches ASPHALT)								
2		FILL: brown gravel, fine to coarse grained, saturated.		43.0 x				13		
3										
4		Gray sandy SILT, fine grained, moist to wet, mottled. (ML) LL=33 PL=26 PI=7	Soft	40.0 x				6		
5										
6										
7						43.7 x				4
8										
9										
10				58.3 x				2		
11										
12										
13		Gray SILT, fine grained, moist to wet. (ML)	Hard							
14										
15						17.5 x				41
16										
17										
18										
19										
20			Loose	25.1 x				6		
21										
22										
23		Gray SAND, fine to medium grained, saturated. (SP)	Medium Dense							
24										
25						23.2 x				29
26										
27										
28										
29			Dense							
30				20.6 x						
31										
32										
33		Test boring terminated at 31.5 feet.								
34		Groundwater observed at 19.5 feet during drilling.								
35										

80/5"

Note: This borehole log has been prepared for geotechnical purposes. This information pertains only to this boring location and should not be interpreted as being indicative of other areas of the site.



Terra Associates, Inc.
 Consultants in Geotechnical Engineering, Geology and Environmental Earth Sciences


LOG OF BORING NO. B-3

Figure No. A-4

Project: Mercer Island North Project No: T-6714 Date Drilled: 4-25-12
 Client: PMF Investments Driller: BORETEC Logged By: CSD
 Location: Mercer Island, Washington Approx. Elev: N/A

Depth (ft)	Sample Interval	Soil Description	Consistency/ Relative Density	Moisture Content % Wp -----x----- Wl 10 30 50 70 90	Pocket Penetrometer			
					Δ	TSF		
					1	2	3	4
					SPT (N) Blows/ft			
					10	20	30	40
1		(4 inches ASPHALT)						
2		FILL: gray silty sand with gravel, fine to medium grained, moist.	Medium Dense					
3								
4								
5				46.4				8
6				x				8
7								
8		Gray SILT, fine grained, moist, occasional brown sand pocket, mollified. (ML)						
9								
10				46.2				4
11		LL=34		x				4
12		PL=27						
13		PI=7	Medium Stiff					
14								
15		*At 15 feet soil becomes wet, no sand pockets		43.4				4
16				x				4
17								
18								
19								
20				20.8				39
21				x				39
22				17.2				
23				x				
24								
25				21.0				33
26		Gray SAND, fine to medium grained, saturated, (SP)	Dense	x				33
27								
28								
29								
30				26.7				80/5"
31				x				80/5"
32								
33		Test boring terminated at 31.5 feet.						
34		Groundwater observed at 21 feet during drilling.						
35		Groundwater observed at 15.5 feet after drilling.						
36								
37								
38								
39								
40								

Note: This borehole log has been prepared for geotechnical purposes. This information pertains only to this boring location and should not be interpreted as being indicative of other areas of the site.



Terra Associates, Inc.
 Consultants in Geotechnical Engineering, Geology and Environmental Earth Sciences


LOG OF BORING NO. B-4

Figure No. A-5

Project: Mercer Island North Project No: T-6714 Date Drilled: 4-25-12
 Client: PMF Investments Driller: BORETEC Logged By: CSD
 Location: Mercer Island, Washington Approx. Elev: N/A


Depth (ft)	Sample Interval	Soil Description	Consistency/ Relative Density	Moisture Content % Wp -----x----- Wl 10 30 50 70 90	Pocket Penetrometer			
					Δ	TSF	Δ	SPT (N) Blows/ft
1		(3.5 inches ASPHALT)						
2								
3								
4								
5		FILL; mix of brown sand with silt and gravel and gray silty sand with gravel, fine to coarse grained, moist.	Medium Dense	16.9 x			24 *	
6								
7								
8								
9								
10								56
11		Brown silty SAND, fine to medium grained, moist. (SM)	Very Dense	15.2 x				
12								
13								
14								
15								90/4"
16								
17								
18								
19								
20		Gray SILT, fine grained, moist. (ML)	Hard	11.2 x				50/5"
21								
22								
23								
24								
25								
26								57
27								
28								
29		Gray SAND, fine to medium grained, saturated. (SP)	Medium Dense	21.9 x			19 *	
30								
31								
32								
33		Test boring terminated at 31.5 feet.						
34		Groundwater observed at 29 feet during drilling.						
36		Groundwater observed at 22 feet after drilling.						
37								
38								
39								
40								

Note: This borehole log has been prepared for geotechnical purposes. This information pertains only to this boring location and should not be interpreted as being indicative of other areas of the site.



Terra Associates, Inc.
 Consultants in Geotechnical Engineering, Geology and Environmental Earth Sciences

Particle Size Distribution Report

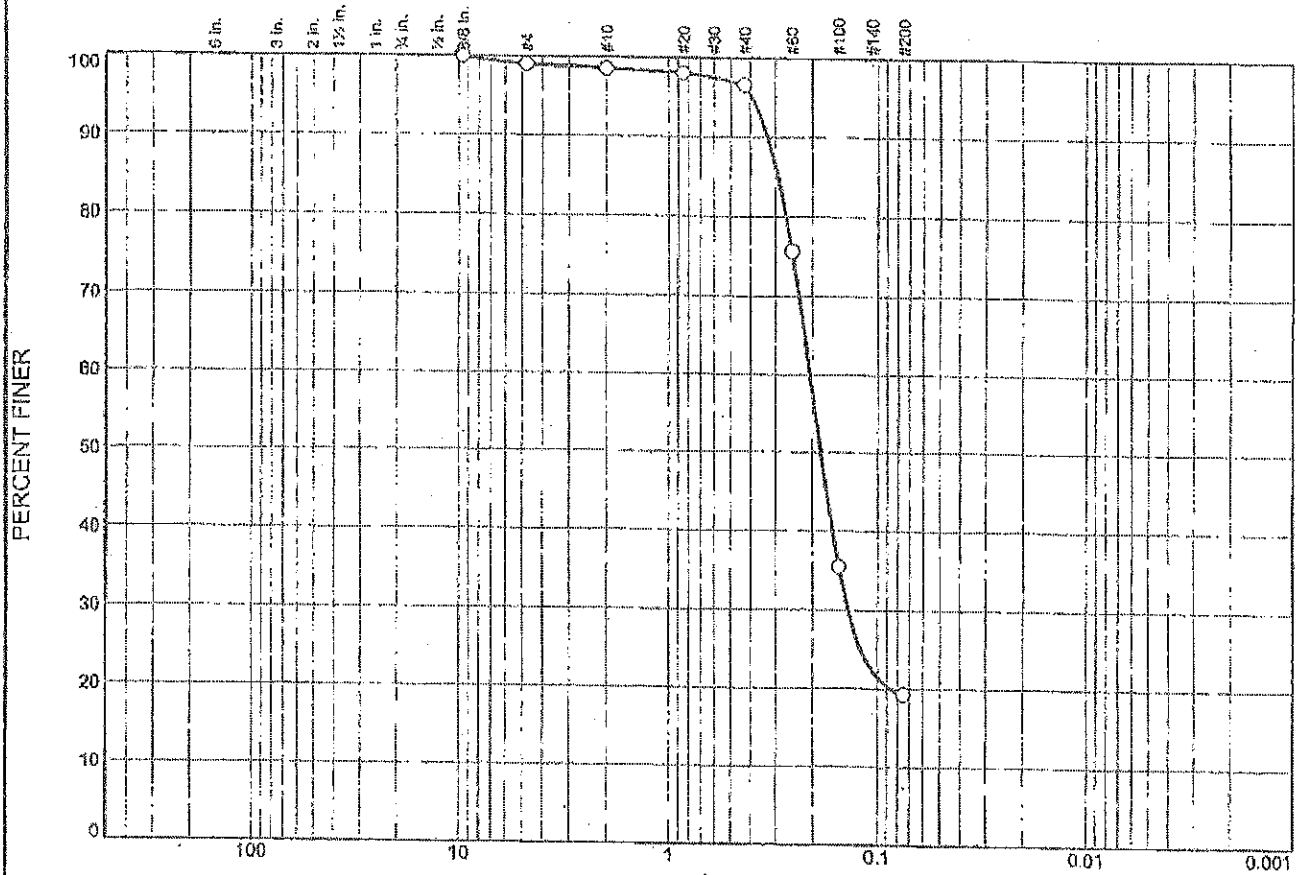

GRAIN SIZE - mm.

%	+3"	% Gravel		% Sand			% Fines			
		Coarse	Fine	Coarse	Medium	Fine	Silt	Clay		
○	0.0	0.0	1.0	0.5	1.9	77.3	19.3			
×	LL	PL	D ₈₅	D ₆₀	D ₅₀	D ₃₀	D ₁₅	D ₁₀	C _c	C _u
○			0.2925	0.2051	0.1822	0.1354				

Material Description						USCS	AASHTO
○ Silty SAND						SM	

Project No. T-6714 Client: PMF Investments
 Project: Mercer Island North
 Mercer Island, Washington
 ○ Location: Test Boring B-1 Depth: -25' Sample Number: 7


 Terra Associates, Inc.
 Kirkland, WA

Remarks:
 ○ Tested on 4/27/2012

Figure A-6

Tested By: BS

Project : Mercer Island Multi-Family		Boring No. B-1	
Project No. 1350	Date : 10-2-12		
Client : Continental Pacific	Elevation 92 Feet		
Location: East Side	Logged By: Paul Bonifaci		

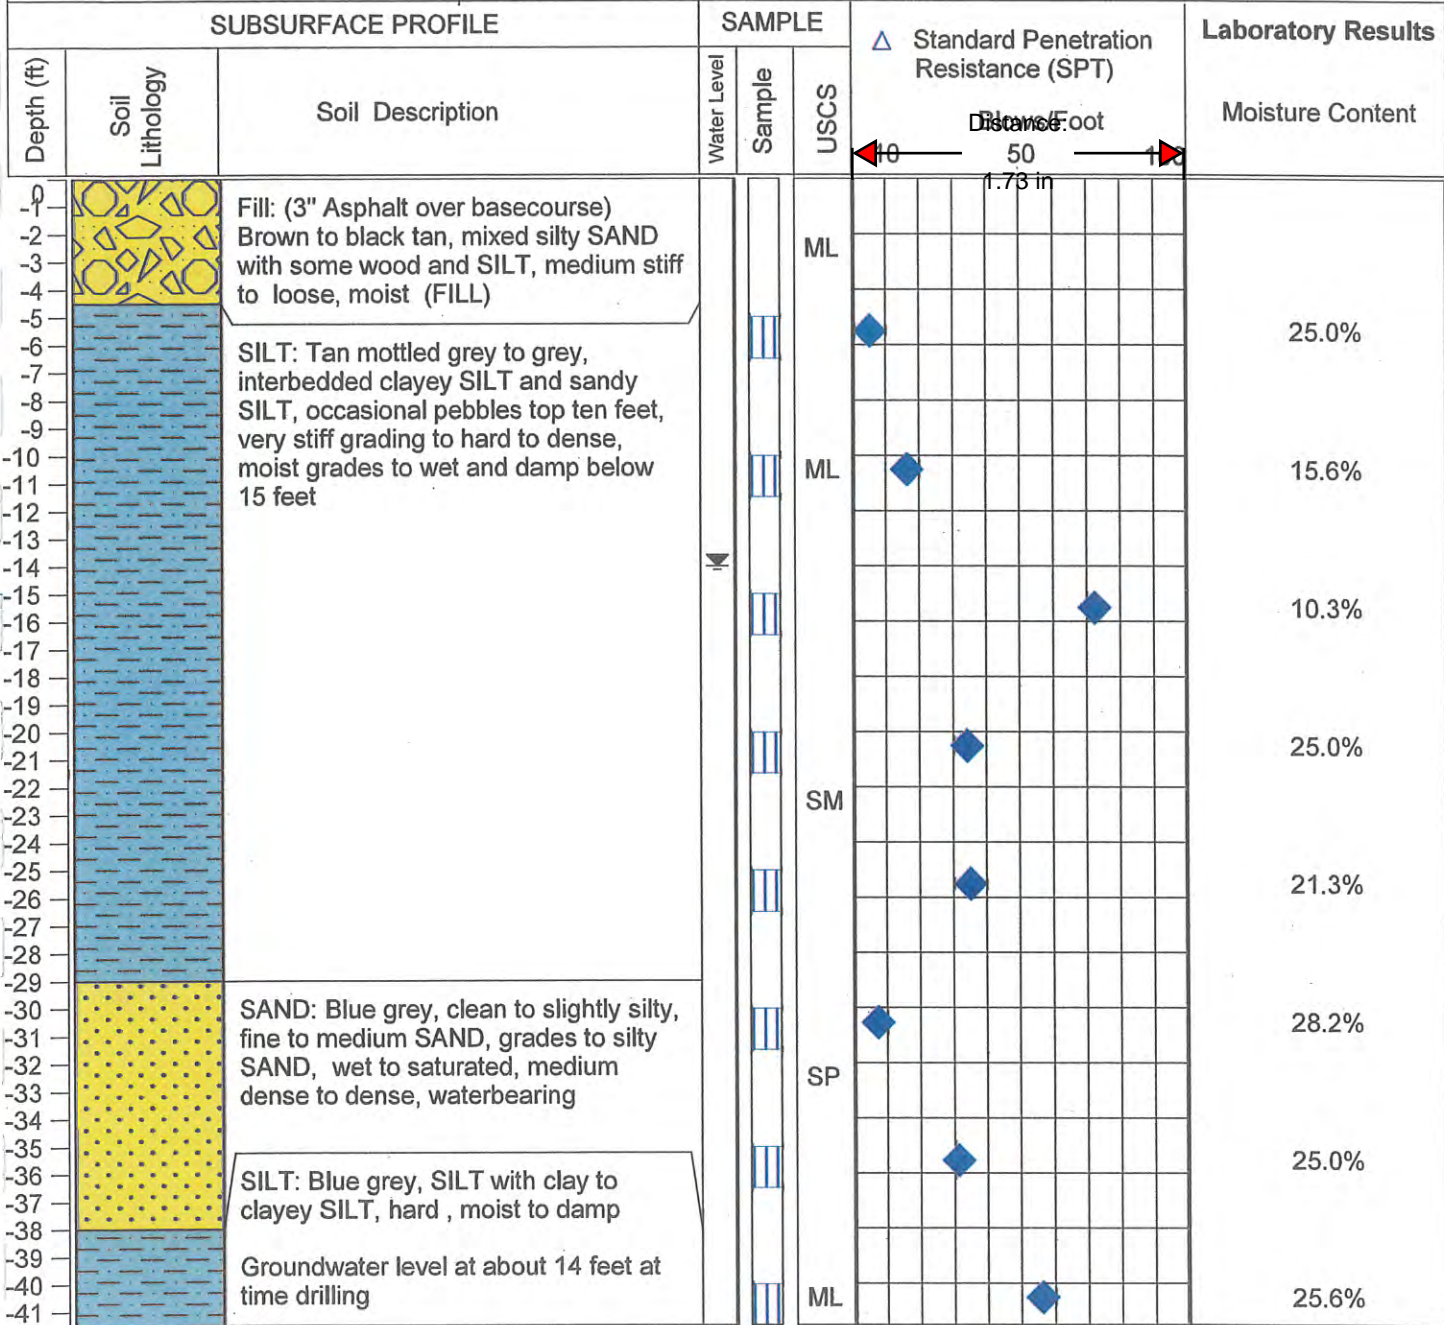


**ABPB Consulting
Geotechnical Consultants**

12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544

Project : Mercer Island Multi-Family
Project No. 1350 **Date :** 10-2-12
Client : Continental Pacific **Elevation** 82 Feet
Location: East Side **Logged By:** Paul Bonifaci

Boring No. B-2

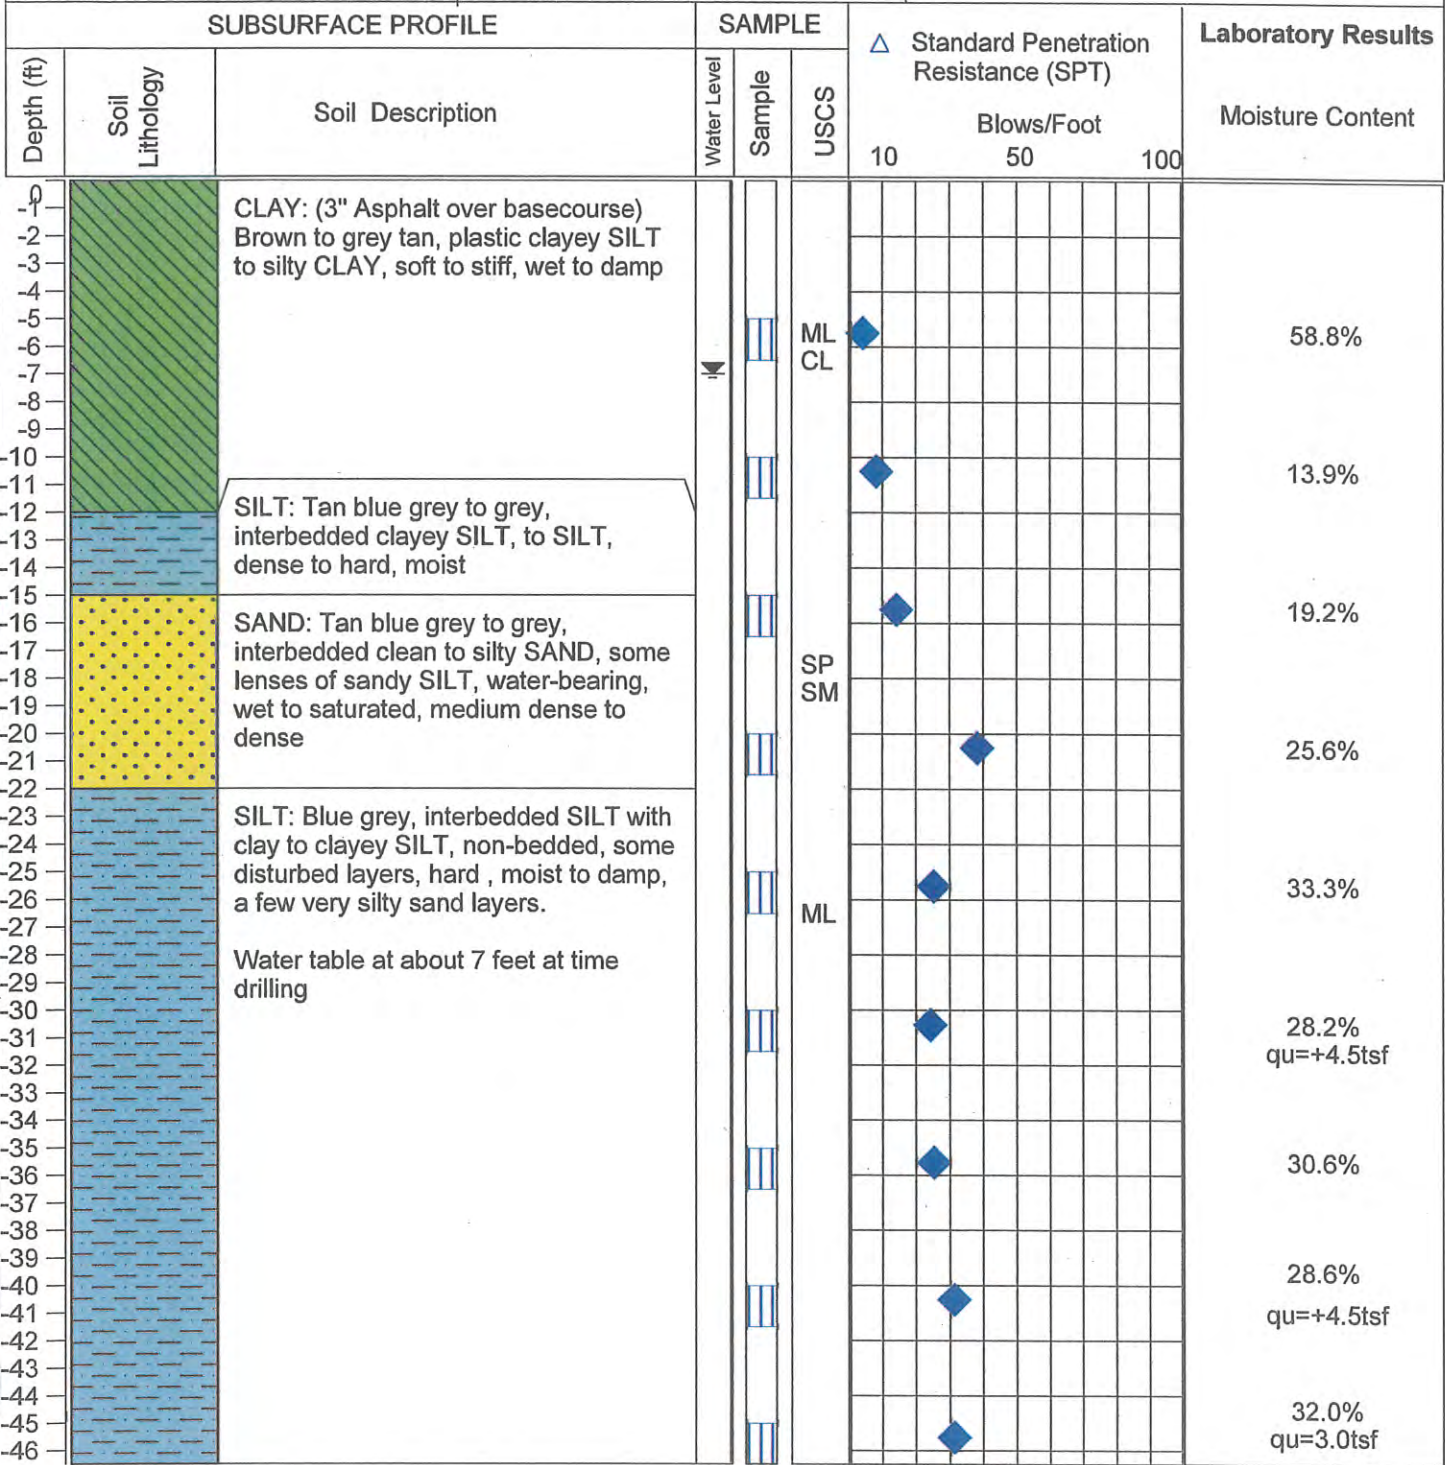

**ABPB Consulting
Geotechnical Consultants**

12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544

Project : Mercer Island Multi-Family		Boring No. B-3	
Project No. 1350	Date : 10-2-12		
Client : Continental Pacific	Elevation 85 Feet		
Location: NW corner	Logged By: Paul Bonifaci		

SUBSURFACE PROFILE			SAMPLE			Standard Penetration Resistance (SPT)			Laboratory Results
Depth (ft)	Soil Lithology	Soil Description	Water Level	Sample	USCS	Blows/Foot			Moisture Content
						10	50	100	
-0		FILL: (3" Asphalt over basecourse)							
-2		Brown to grey tan, silty gravelly SAND (FILL), loose, moist			SM				
-4		PEAT: Interbedded brown, organic PEAT, mixed with silty organic CLAY, very soft, wet			Pt	◆			65.2%
-6									
-8									
-10		CLAY: Tan blue grey, interbedded silty CLAY and clayey SILT, scattered organic fragments, very soft to soft, damp to wet			CL	◆			45.0% qu=0.75tsf
-12					ML				
-14									
-16						◆			44.7% qu=0.25tsf
-18									
-20									
-21		SILT: Blue grey, interbedded SILT with clay to clayey SILT, non-bedded, occasional sandy SILT layers, hard, moist to damp, a few very silty sand layers.					◆		26.5%
-23									
-25					ML		◆		21.9% qu=2.5tsf
-27		Water table at about 7 feet at time drilling							
-29									
-30							◆		37.9%
-32									
-34									
-35									
-36							◆		20.0% qu=+4.5tsf
-38									
-40									
-41							◆		29.0

**ABPB Consulting
Geotechnical Consultants**


12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544

Date : Oct. 2012

Project Name: Mercer Island Multi-Family

Figure 5

Project : Mercer Island Multi-Family		Boring No. B -4	
Project No. 1350	Date : 10-2-12		
Client : Continental Pacific	Elevation 81 Feet		
Location: SW side	Logged By: Paul Bonifaci		

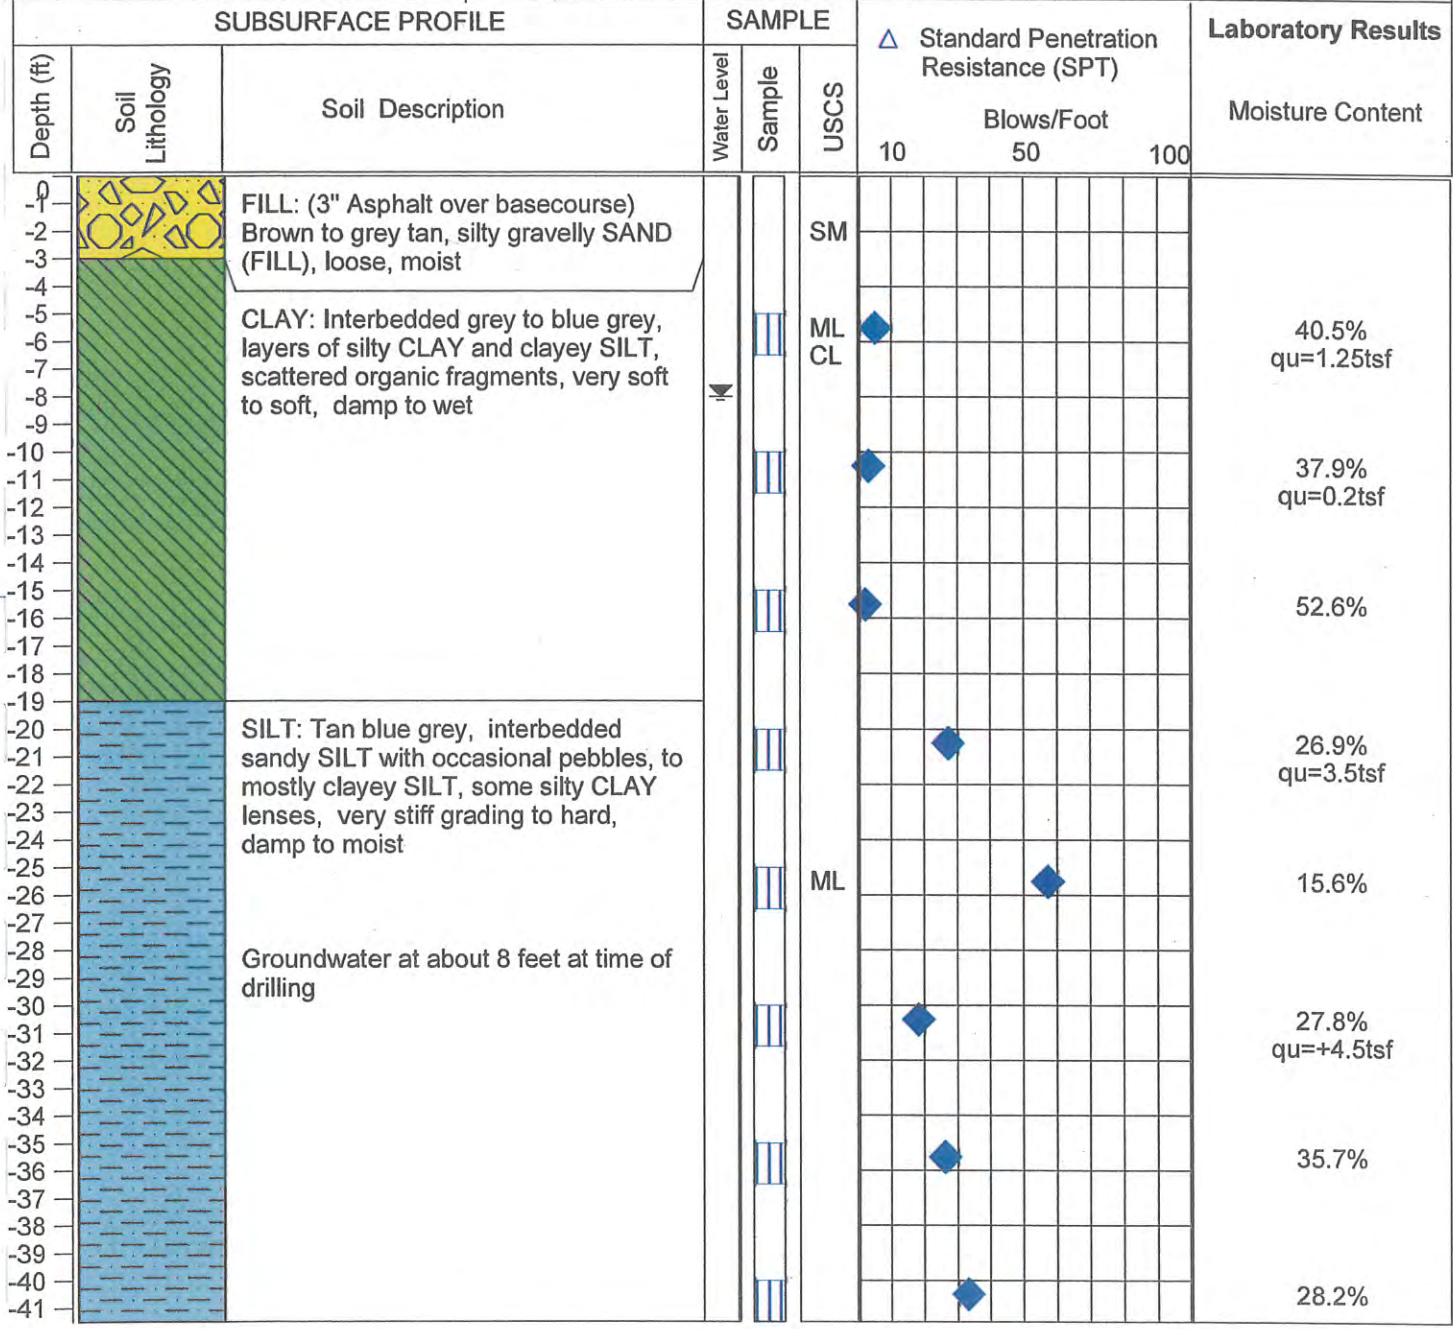


**ABPB Consulting
Geotechnical Consultants**

12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544

Date : Oct. 2012	Project Name: Mercer Island Multi-Family	Figure 6
------------------	--	----------

Project : Mercer Island Multi-Family		Boring No. M-1	
Project No. 1350	Date : 10-19-12		
Client : Continental Pacific	Elevation 87 feet		
Location: South Side	Logged By: Terry Bukowsky		

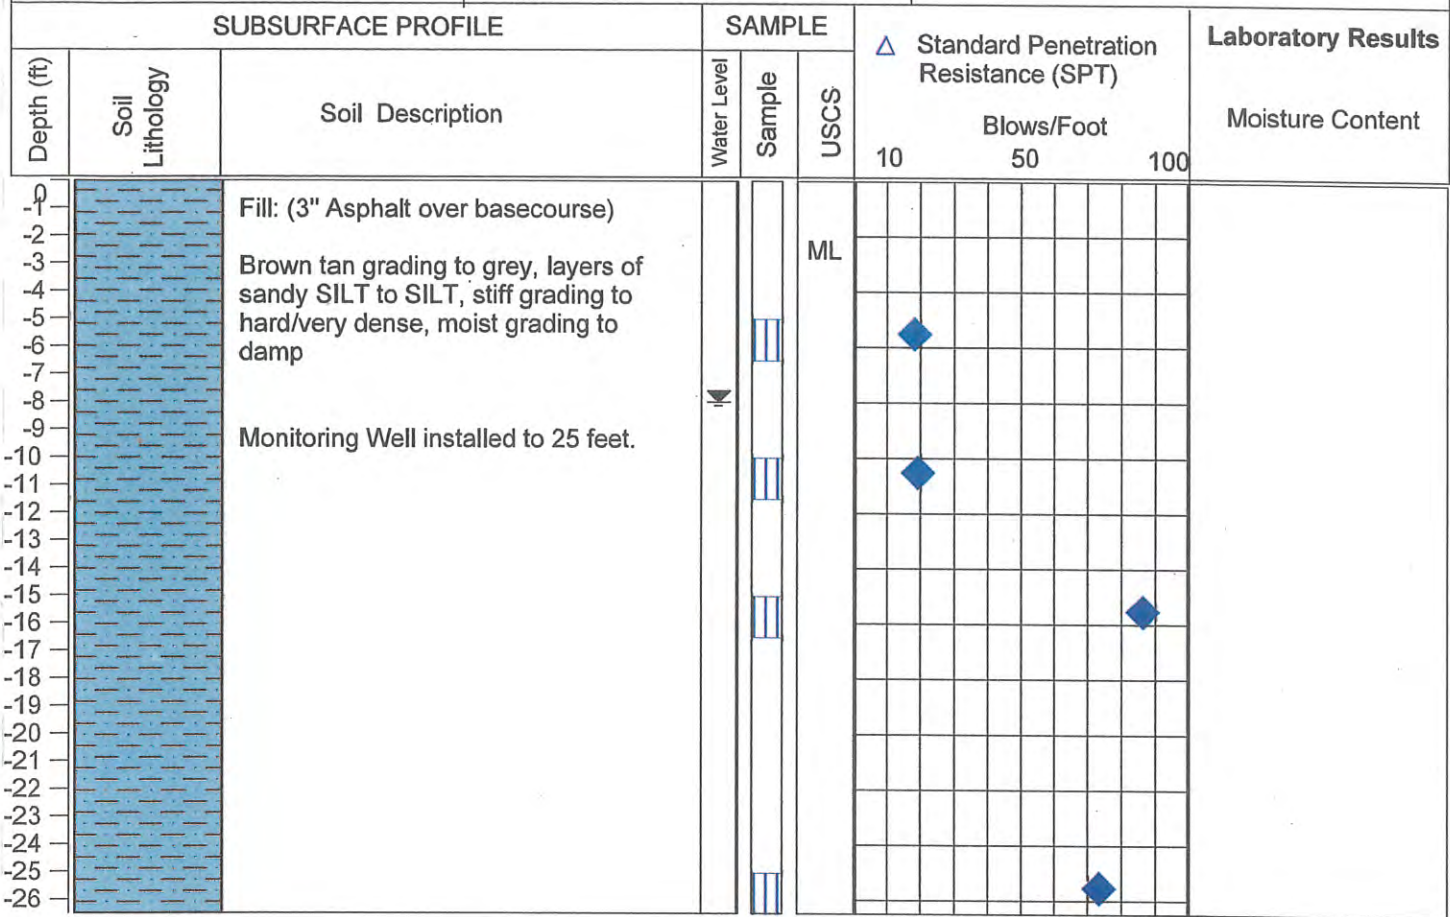

**ABPB Consulting
Geotechnical Consultants**

12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544


Date : Oct. 2012

Project Name: Mercer Island Multi-Family

Figure 7

Project : Mercer Island Multi-Family
Project No. 1350 **Date :** 10-20-12
Client : Continental Pacific **Elevation** 83 feet
Location: South Side **Logged By:** Terry Bukowsky


Boring No. M-2

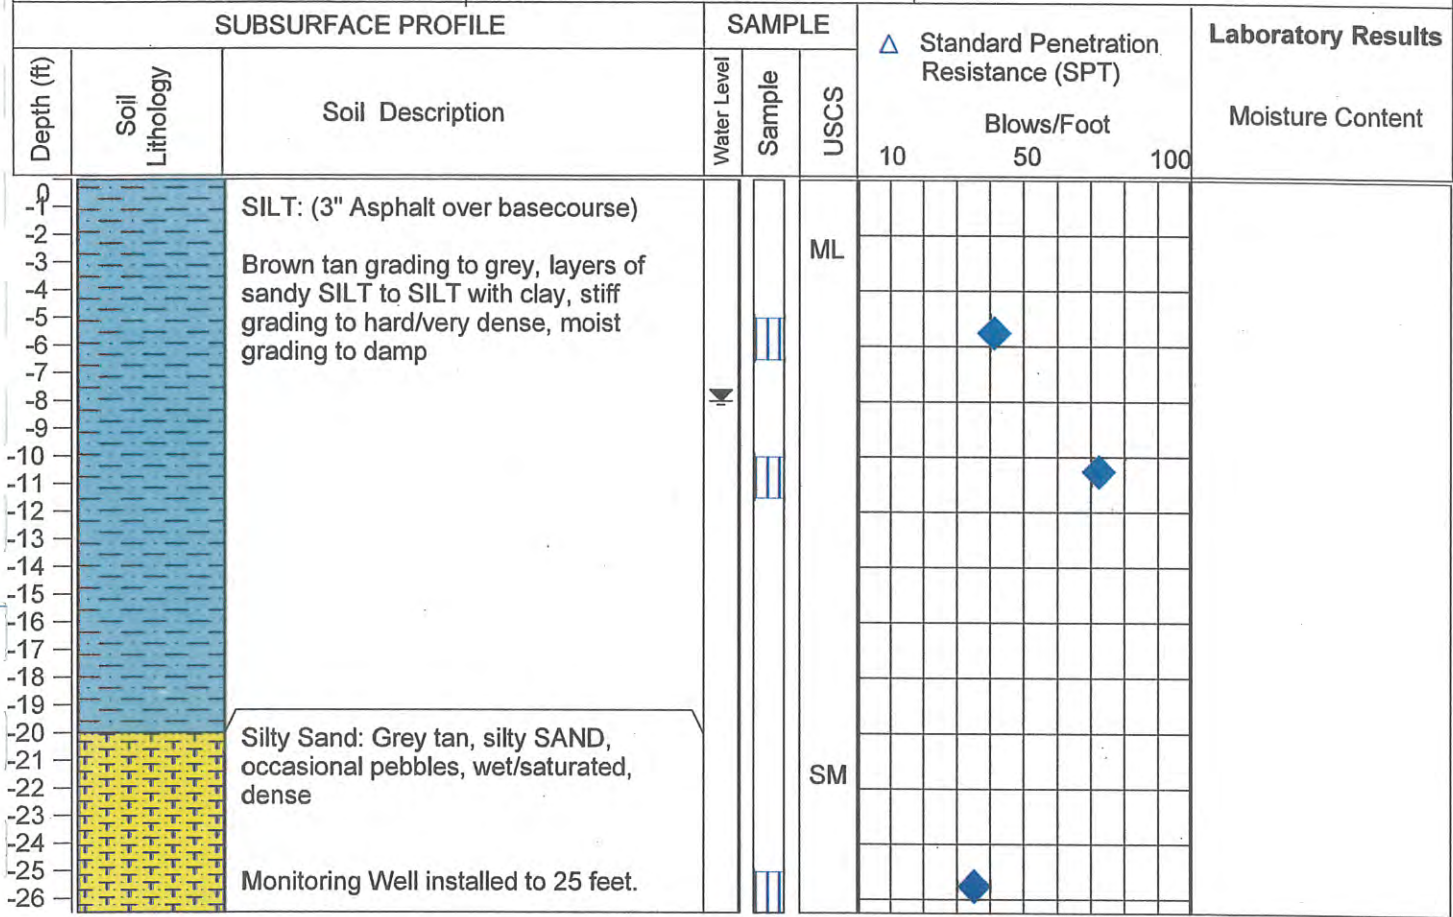

ABPB Consulting
Geotechnical Consultants

12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544

Project : Mercer Island Multi-Family		Boring No. M-3	
Project No. 1350	Date : 10-20-12		
Client : Continental Pacific	Elevation 82 feet		
Location: South Side	Logged By: Terry Bukowsky		

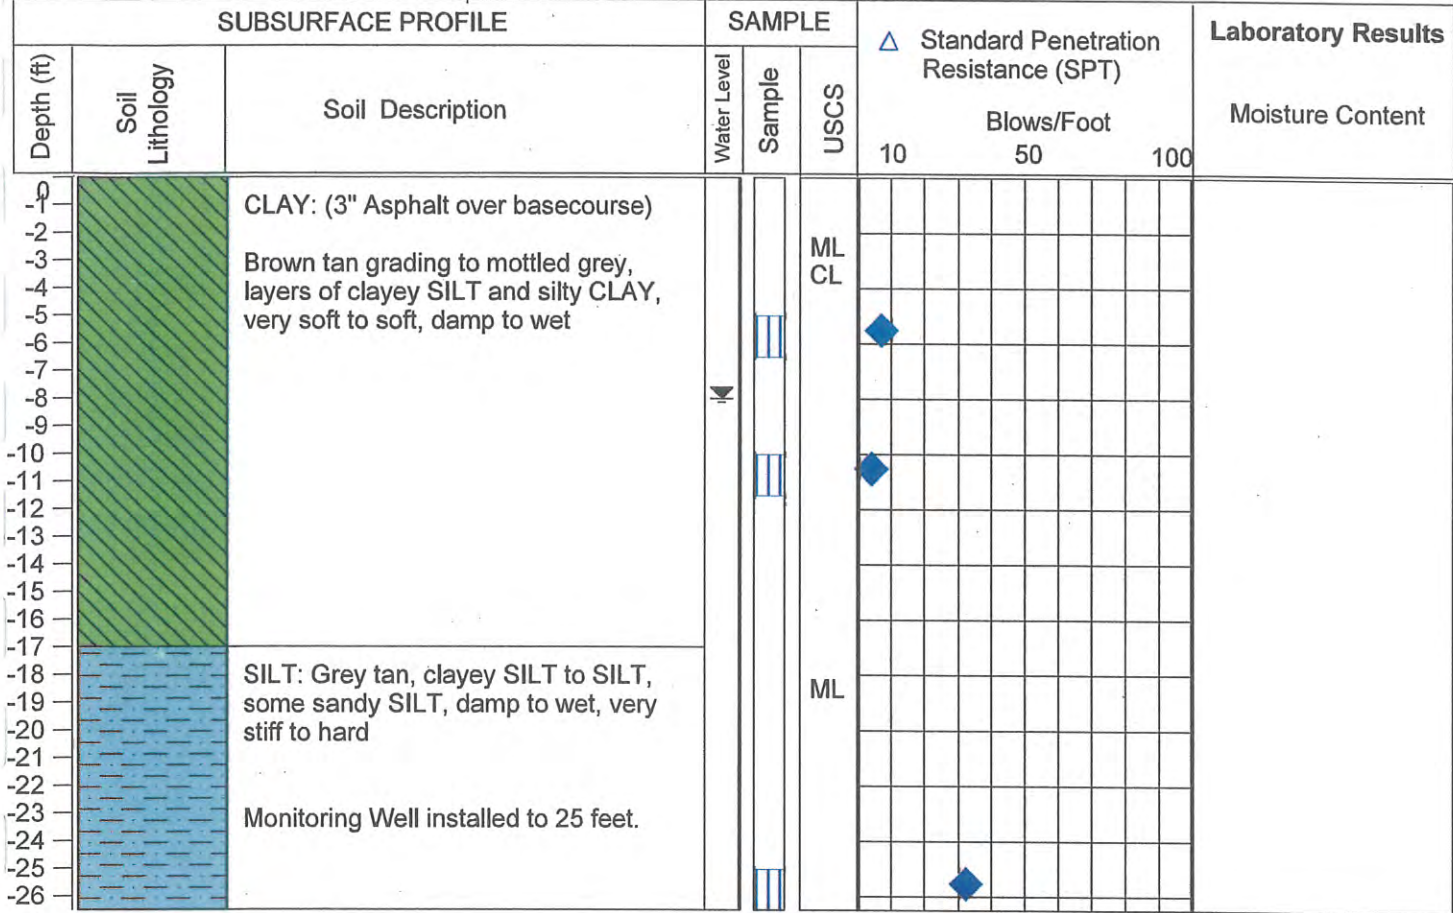

**ABPB Consulting
Geotechnical Consultants**

12525 Willows Road, Suite 80, Kirkland, Washington (425) 820-2544