




Side Elevation



Rear Elevation

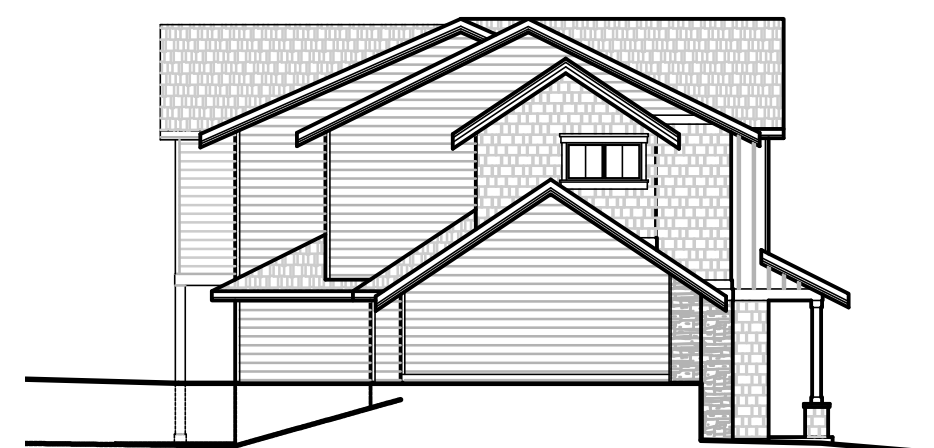

Side Elevation



**DRAWING INDEX**


- A1. CODE NOTES
- A1.1. SITE PLAN
- C4.2. GRADING & DRAINAGE PLAN
- T001. SURVEY
- T002. SURVEY
- A2.0. FOUNDATION PLAN
- A2.1. LOWER FLOOR PLAN
- A2.2. MAIN FLOOR FRAMING PLAN
- A3. MAIN FLOOR PLAN
- A4. UPPER FLOOR FRAMING PLAN
- A5. UPPER FLOOR PLAN
- A6. UPPER ROOF
- A7. ELEVATIONS
- A8. ELEVATIONS
- A9. BUILDING SECTIONS
- DI. STANDARD DETAILS
- S-0.0. STRUCTURAL NOTES
- LB-1. STRUCTURAL DETAILS
- LB-2. STRUCTURAL DETAILS
- SD.1. STRUCTURAL DETAILS
- SD.02. STRUCTURAL DETAILS

Permit 2105-175  
**Pratt Plat**


7921 SE 72nd PL Lot 2  
Mercer Island, WA 98040

**SQUARE FOOTAGE**


MAIN FLOOR	1558 SF
UPPER FLOOR	1793 SF
LOWER FLOOR	1260 SF
TOTAL	4611 SF
GARAGE	639 SF
PORCH/PATIO	224/259 SF

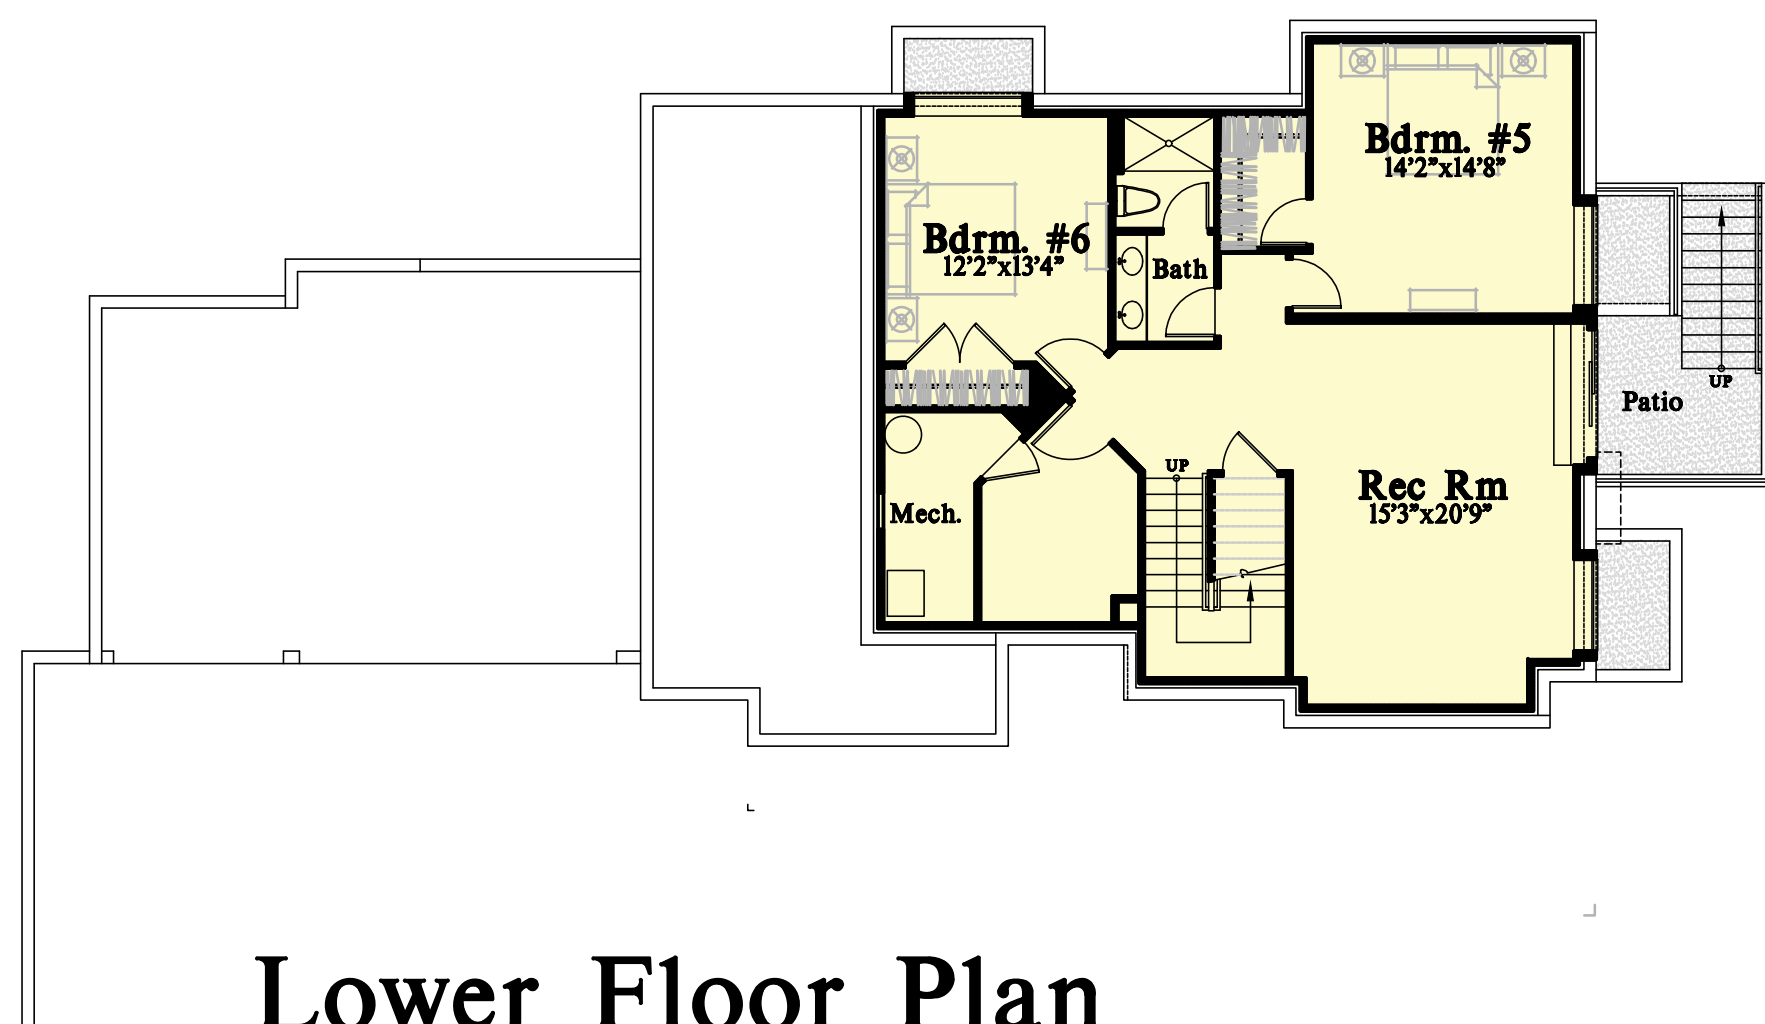


Lower Floor Plan

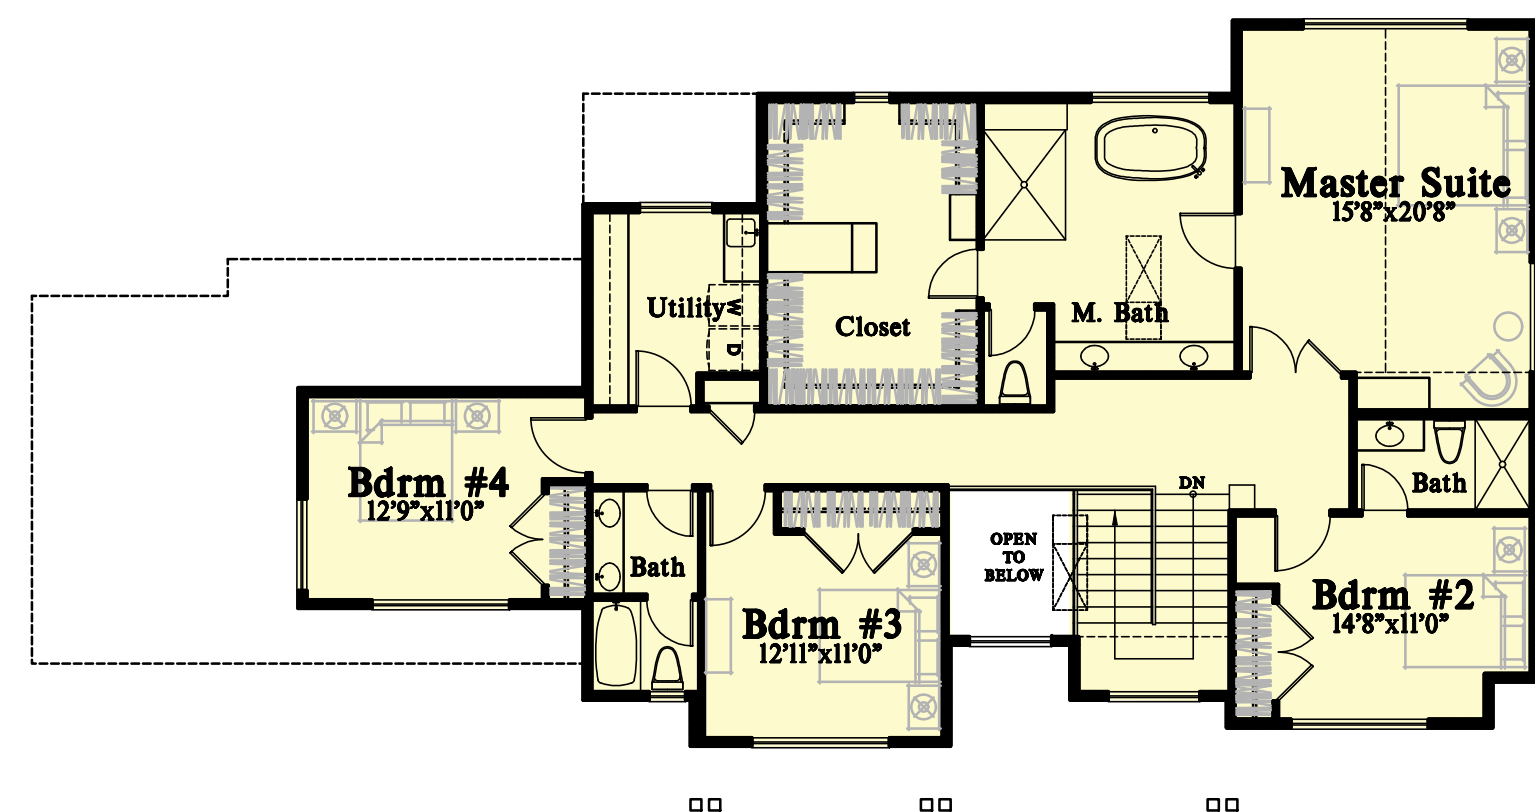

Upper Floor Plan

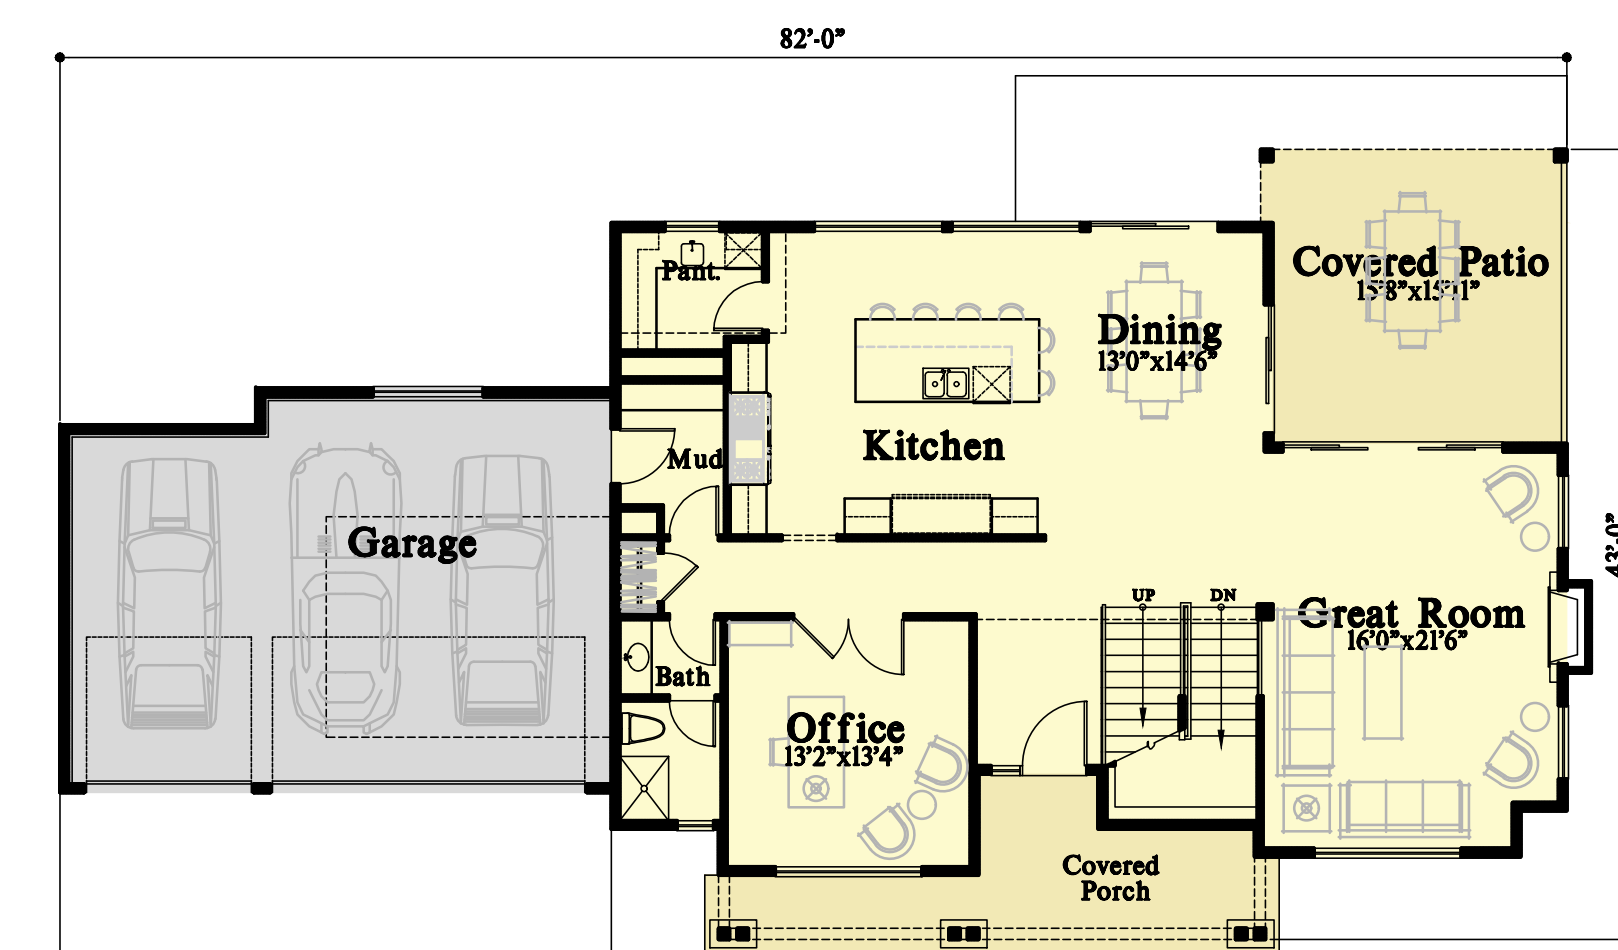

Main Floor Plan

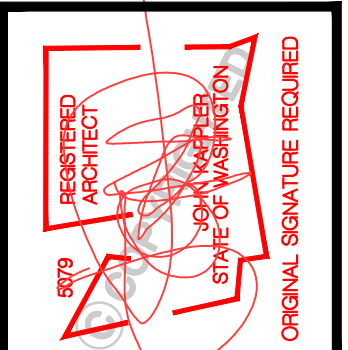

Date	By	Description
06/20/21 SM	PERMIT SET	
07/22/21 SM	JURISDICTIONAL COMMENTS	

Permit 2105-175  
**Pratt Plat**  
Lot 2  
7921 SE 72nd PL  
Mercer Island, WA 98040  
THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED.


ARCHITECTURAL INNOVATIONS, P.S.  
Forward Thinking Design Solutions For Your Environment  
14311 SE 16th St  
Bellevue, WA 98007  
1-800-888-4517  
www.kadachangeplans.com

Reviewed  
Kolk Consulting Group, Inc.  
C. Kolk  
07/30/2021

TITLE	
JOB NO.:	1903521
STARTING NO.:	1903505

SHEET  
**COVER SHEET**



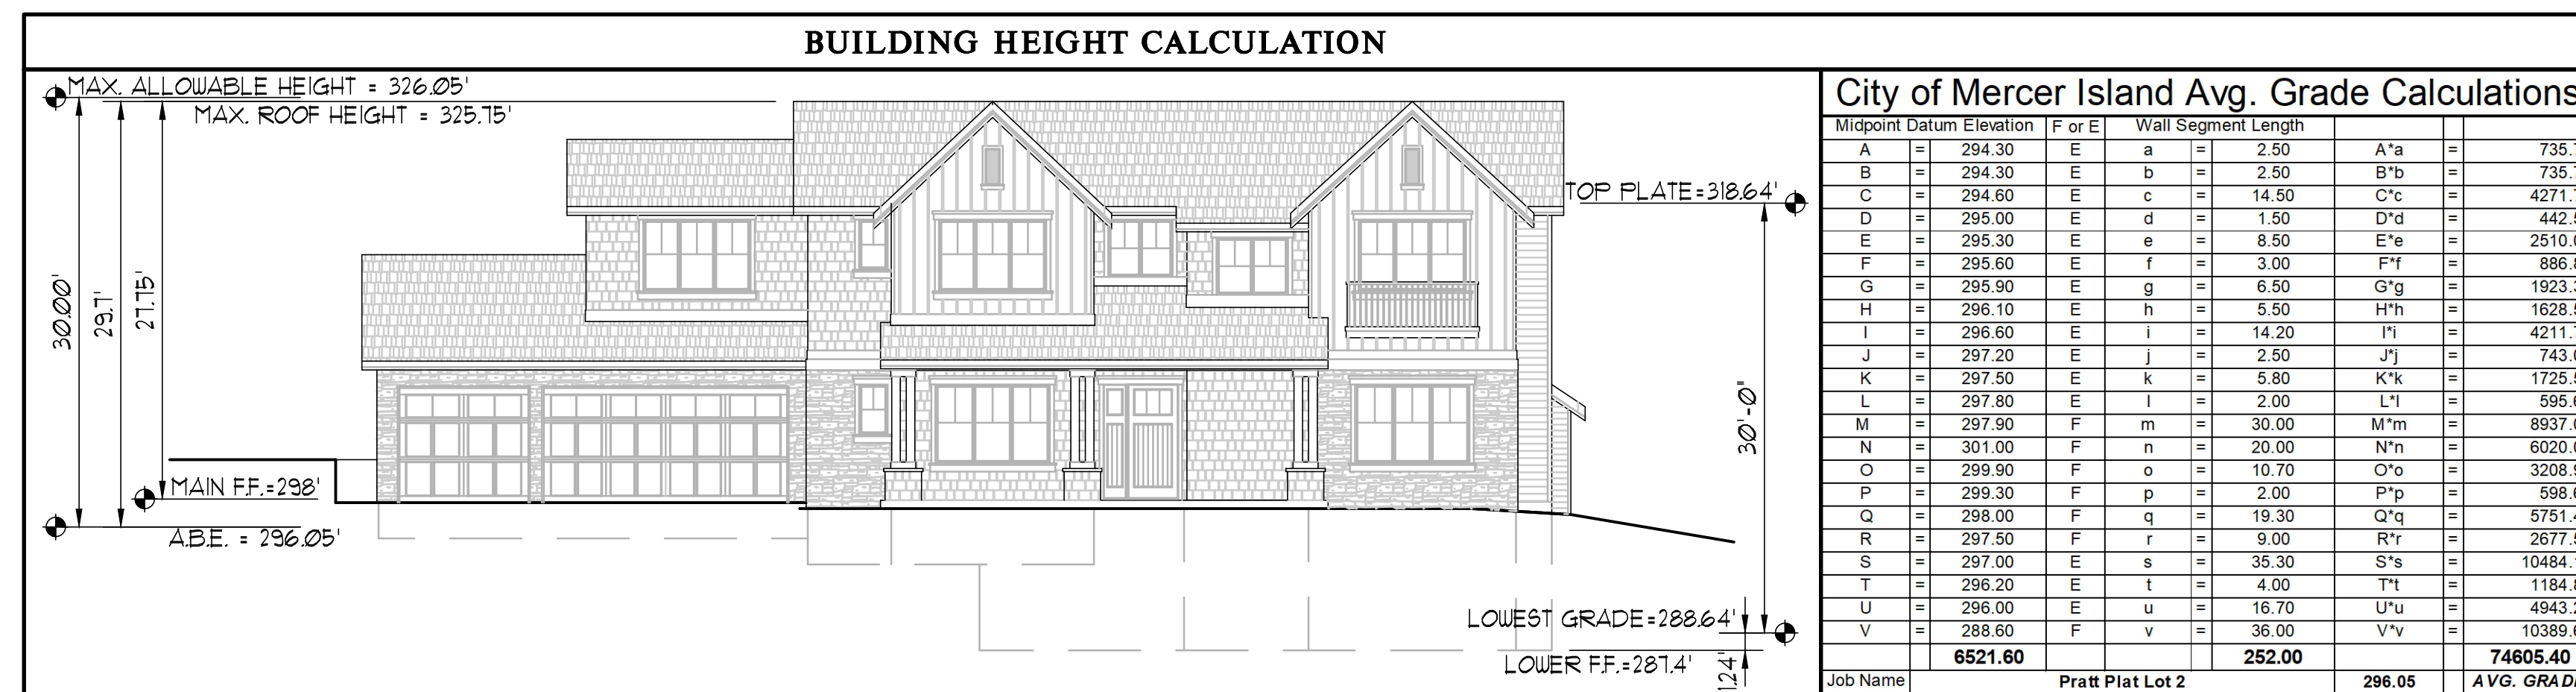

#### City of Mercer Island Avg. Grade Calculations

Midpoint	Datum Elevation	F or E	Wall Segment Length	Result
A	294.30	E	a	735.75
B	294.30	E	b	735.75
C	294.60	E	c	4271.76
D	295.00	E	d	442.50
E	295.30	E	e	2610.09
F	295.60	E	f	886.80
G	295.90	E	g	1923.39
H	296.10	E	h	1628.55
I	296.50	E	i	4211.72
J	297.20	E	j	743.00
K	297.50	E	k	1725.50
L	297.80	E	l	595.50
M	297.90	F	m	8937.00
N	301.00	F	n	6020.00
O	299.90	F	o	3208.93
P	299.30	F	p	598.60
Q	298.00	F	q	5751.40
R	297.50	F	r	2677.50
S	297.00	E	s	10484.10
T	296.20	E	t	1184.80
U	296.00	F	u	4943.20
V	288.60	F	v	10389.60
<b>Total</b>	<b>6521.60</b>		<b>252.00</b>	<b>74605.40</b>

Job Name: Pratt Plat Lot 2  
Avg. Grade: 296.05

#### City of Mercer Island GFA Calculations

Wall Length	Percentage	Plan or Elevation	Result
A	2.5	75.1%	1.9
B	2.5	75.1%	1.9
C	14.5	80.0%	11.6
D	1.5	83.7%	1.3
E	8.5	89.0%	7.6
F	3	90.0%	2.7
G	14.5	94.4%	13.7
H	30	100.0%	30.0
I	23.3	100.0%	23.3
J	4	100.0%	4.0
K	16.75	94.3%	15.8
L	30	63.1%	22.7
T	157.05		158.4
<b>Total Average Result</b>			<b>0.9</b>

Lot Size = 10,348 SF x 40% = 4139 SF

Area	Description
1615	Main Floor (1558-57) AREA > 16'
561	Garage (639-78) EXCLUDED
1793	Upper Floor (1890-97) STAIRS
166	Lower Floor (1290-1094) EXCLUDED
4135	

Wall Length	Percentage	Plan or Elevation	Result
a	30	0.0%	0.0
b	20	35.0%	7.0
c	10.7	27.9%	3.0
d	2	23.0%	0.5
e	19.3	11.8%	2.2
f	22	0.0%	0.0
T	104		10.7
<b>Total Average Result</b>			<b>0.1</b>



#### SITE INFO

**STREET ADDRESS:**  
7921 SE 72nd PL, Mercer Island, WA 98040

**PARCEL NUMBER:**  
34d

**SITE DEVELOPMENT PERMIT:**  
1903-061

**LEGAL DESCRIPTION:**  
LOT(S) 2, CAYSON FIELDS, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 295 OF PLATS, PAGE 69, RECORDS OF KING COUNTY, WASHINGTON.

#### ZONING

**ZONING:** R-96  
**SINGLE FAMILY RESIDENTIAL STRICKS**

**FRONT YARD - 20'**  
**REAR YARD - 25'**  
**SIDE YARD - 176" COMBINED (7% OF 104')**  
**VARIABLE MIN. 583' (3% OF 1768'), 7.5' OR 10'**


**LOT COVERAGE**  
40% - LOT SLOPE IS LESS THAN 15%

**REQUIRED LANDSCAPE AREA**  
60% - LOT SLOPE IS LESS THAN 15%

**HARDSCAPE COVERAGE**  
5%

**ALLOWED GFA**  
40%

**ALLOWABLE BUILDING HEIGHT**  
3' ABOVE AVERAGE BUILDING ELEVATION TO TOP OF STRUCTURE  
3' ABOVE LOWEST GRADE TO TOP OF WALL

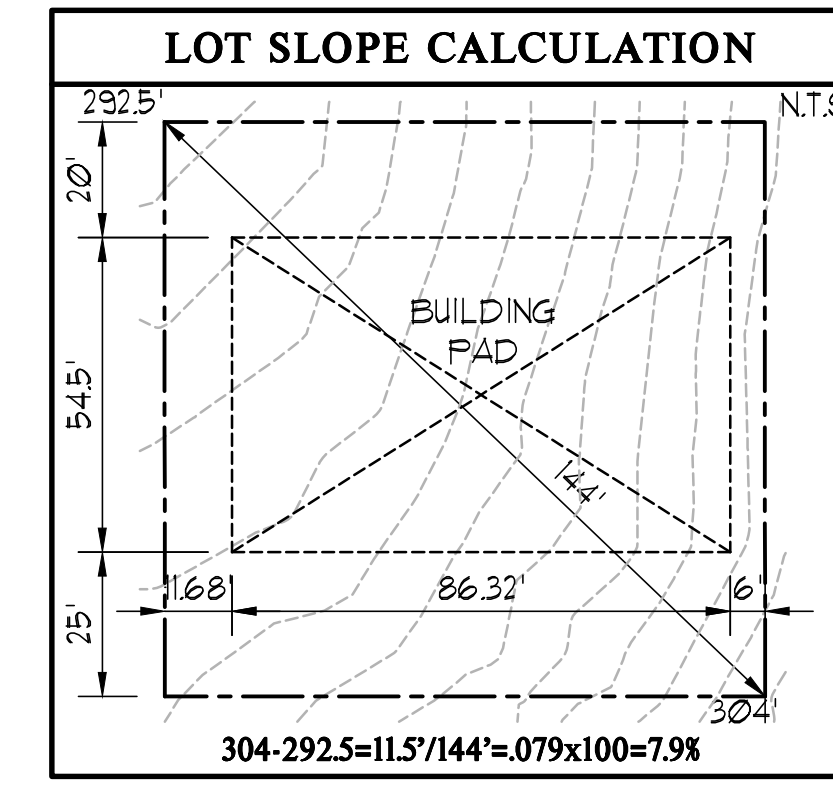



**NOTE:**  
WEEDS TO BE REMOVED FROM SITE

#### SITE CALCULATIONS

10,348 SF	GROSS LOT AREA
10,348 SF	LOT AREA
x 40%	
4,139 SF	ALLOWABLE IMPERVIOUS COVERAGE
2,464 SF	HOUSE ROOF (includes gutters)
551 SF	COVERED PATIO & PORCH (includes gutters)
4 SF	A/C PAD (excludes area under eaves)
823 SF	DRIVEWAY (excludes area under eaves)
3,812 SF / 36.8%	TOTAL COVERAGE
10,296 SF	LOT AREA
x 9%	
927 SF	ALLOWABLE HARDSCAPE COVERAGE
73 SF	FRONT WALK (excludes portion w/ eaves)
181 SF	WINDOW WELLS (excludes portion w/ eaves)
123 SF	UNCOVERED PATIO (excludes portion w/ eaves)
23 SF	RETAINING WALLS (excludes portion w/ eaves)
400 SF / 3.8%	TOTAL HARDSCAPE COVERAGE

#### LEGEND

- — — — — DESIGNATES WATER
- s — s — s — DESIGNATES SEWER
- so — so — so — DESIGNATES STORM
- fd — fd — fd — DESIGNATES FOOTING DRAIN
- GAS — GAS — DESIGNATES GAS
- E — E — E — DESIGNATES ELECTRICAL
- TCOM — TCOM — DESIGNATES TELECOMMUNICATIONS
- — — — — DESIGNATES EXISTING GRADE
- — — — — DESIGNATES FINISHED GRADE
- — — — — DESIGNATES TREE DRIPLINE
- X — — — — — DESIGNATES TREE FENCING

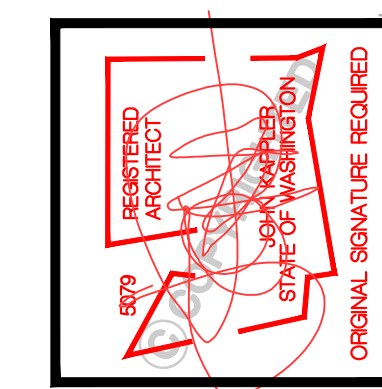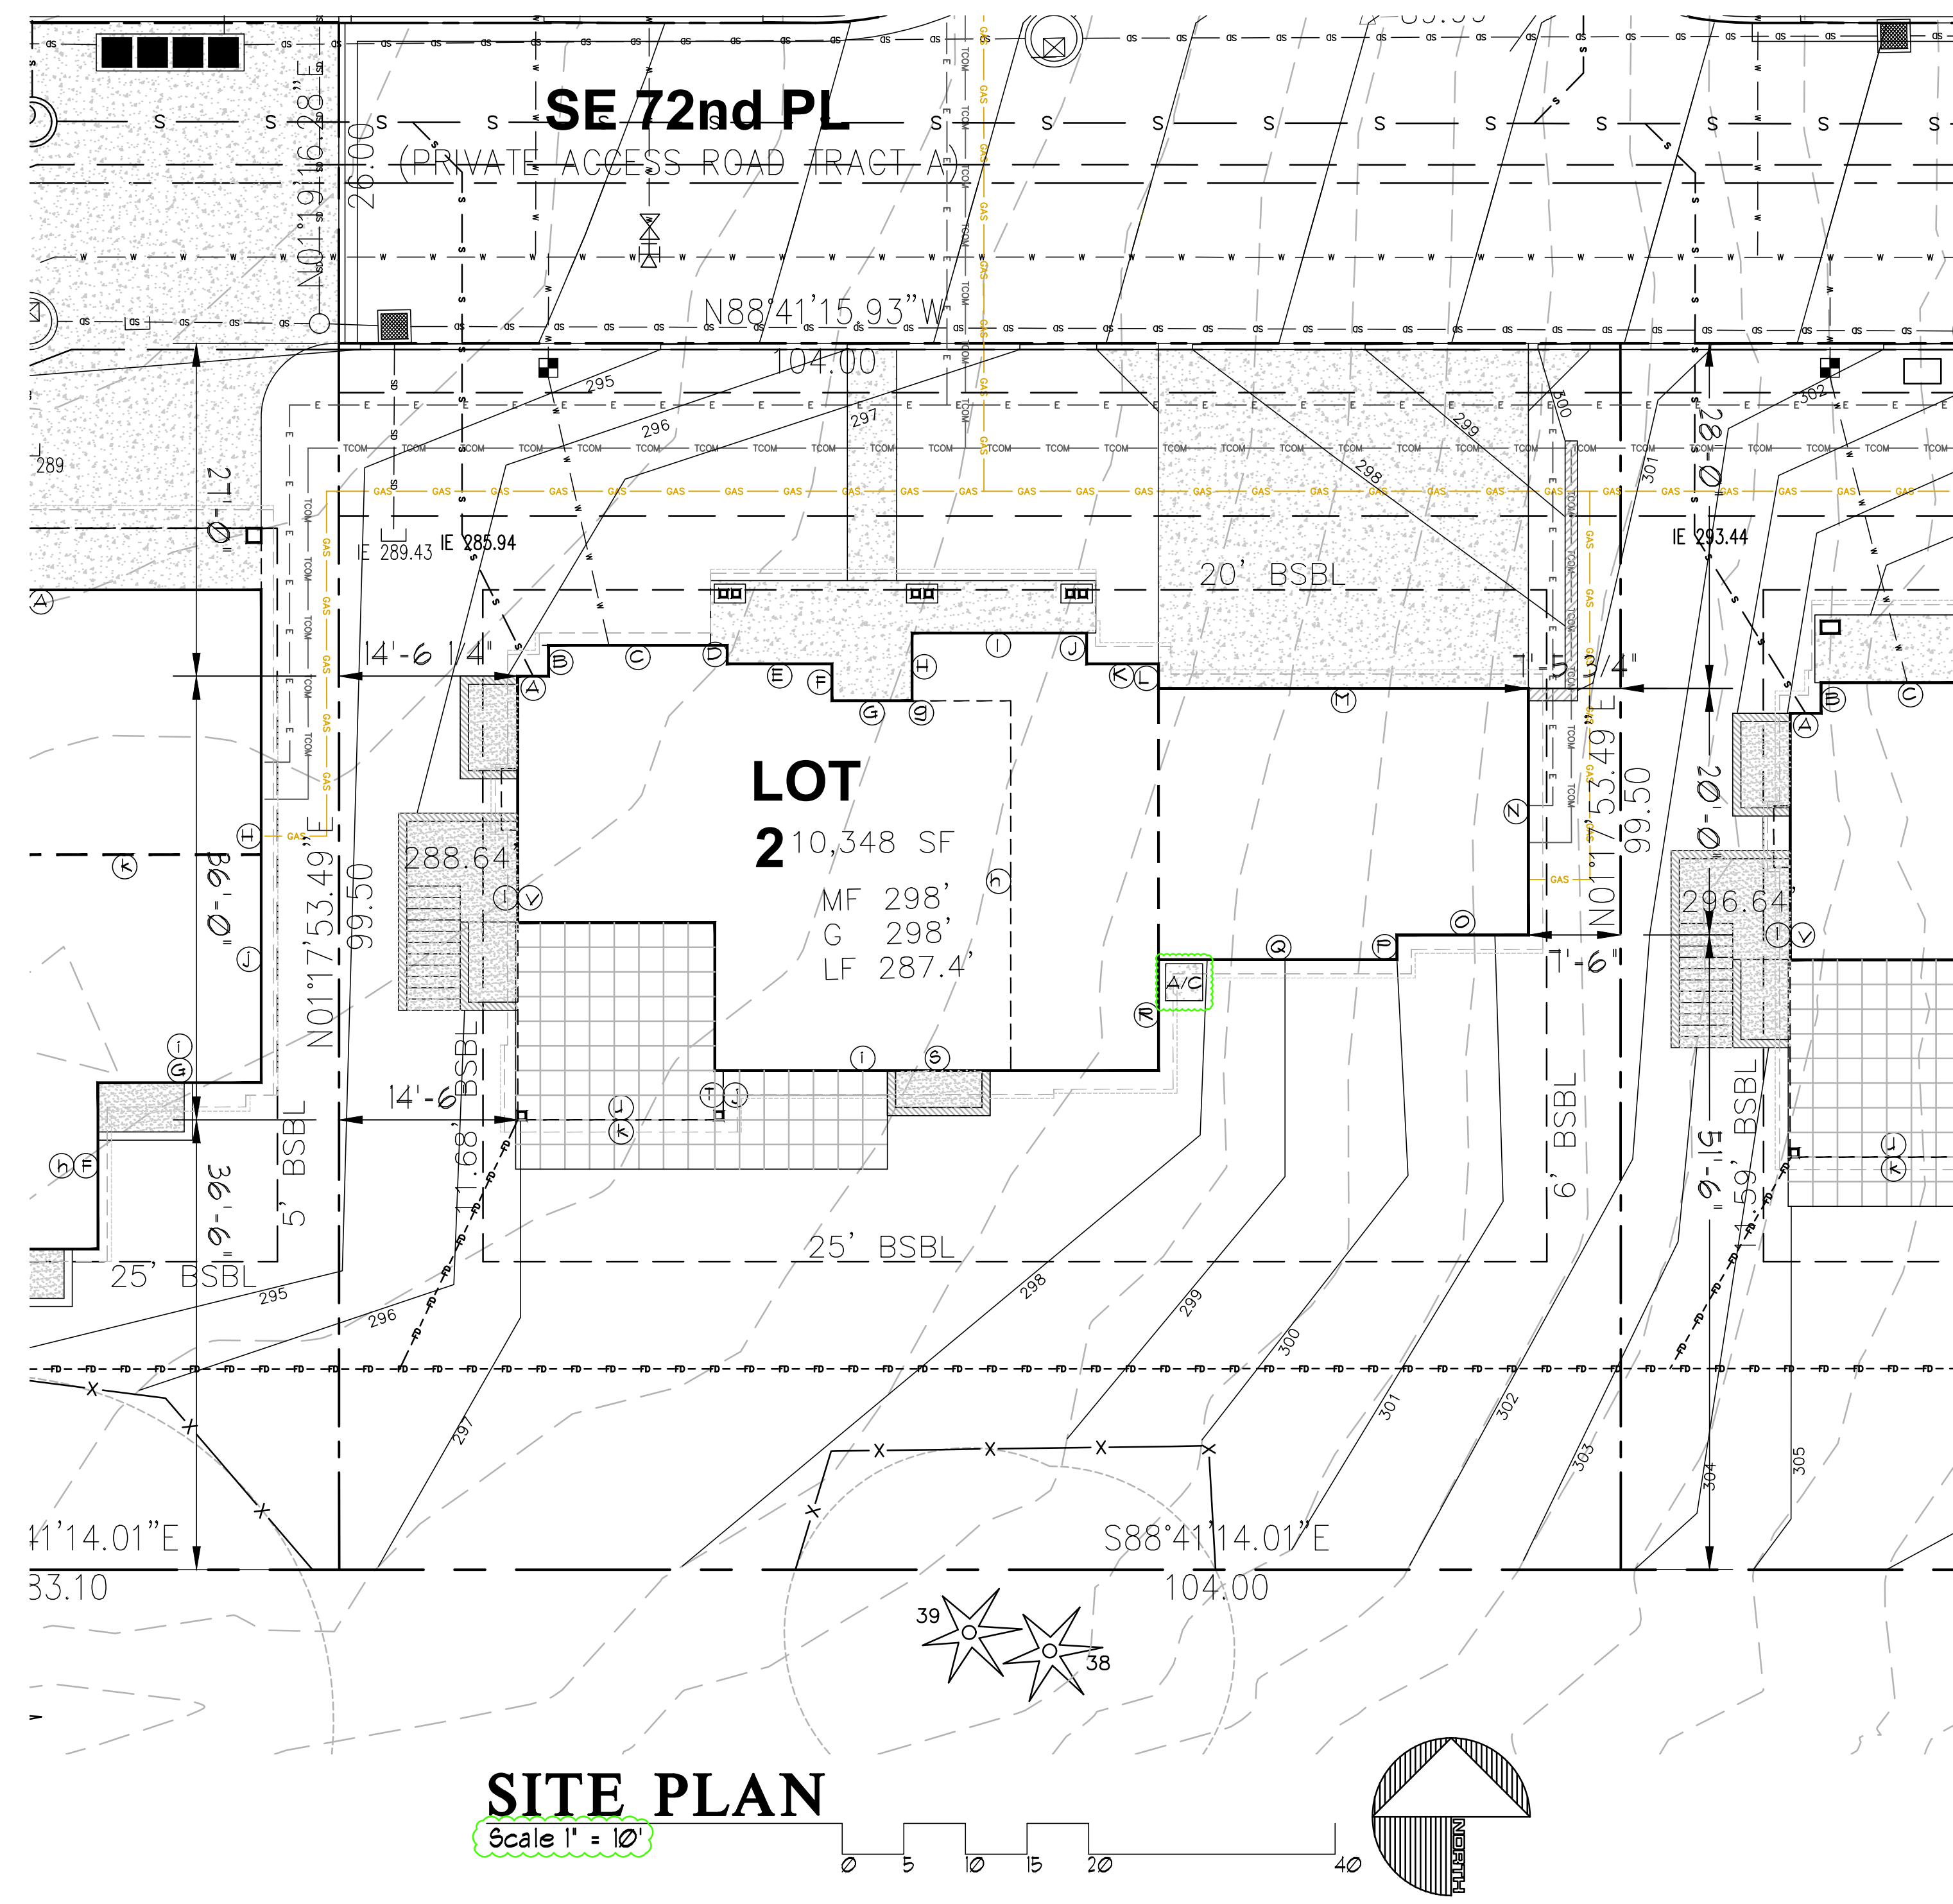

Date	By	Description
04/30/21	SM	PERMIT SET
07/14/21	SM	JURISDICTIONAL COMMENTS

Permit #2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED.


**ARCHITECTURAL INNOVATIONS, P.S.**  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 16th St  
 Bellevue, WA 98007  
 1-800-888-4517  
 www.kapplerhomeplans.com

TITLE
JOB NO.:
1814314.2
STARTING NO.:

SHEET

# A1.1

Reviewed  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

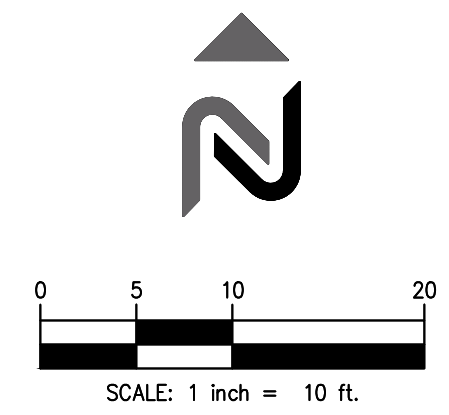

**SITE**

- — — — — PROPERTY LINE
- — — — — BUILDING LINE
- ||||| CROSSWALK
- BOLLARDS
- ▱ CURB RAMP
- 401 — MINOR CONTOUR
- 400 — MAJOR CONTOUR
- - - - - RIDGE LINE
- xxx.xx SPOT ELEVATION
- 1.3% SLOPE ARROWS
- ROCKERY
- ▨ CIP CONCRETE WALL
- ▩ ASPHALT
- ▧ CONCRETE DRIVEWAY
- ▤ SIDEWALK
- ▥ LANDSCAPE
- ▦ GRAVEL PATH
- FD - - FD - FOUNDATION DRAIN LINE
- - - - - STORM DRAIN LINE
- FOUNDATION DRAIN
- STORM CLEANOUT
- NYOPLAST DRAIN PER DETAIL 1/C2.4 OF THE FINAL ENGINEERING PLANS



11235 s.e. 6th street | suite 150  
 bellevue, wa 98004  
 t: 425.453.9501 | f: 425-453-8208  
 www.navixeng.com

**CLIENT/OWNER**

**CAYSON FIELDS LLC**

P.O. BOX 791  
 MERCER ISLAND,  
 WASHINGTON 98040

**PROJECT NAME**


**PRATT  
 PROPERTY**

NAVIX PROJECT NUMBER: 50-215-003

**PROJECT ADDRESS**

**7233 80TH AVE SE  
 MERCER ISLAND, WA 98040**

**STAMP**

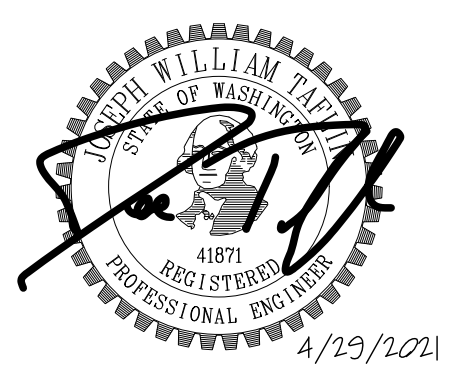

**REVISIONS**

REV	ISSUED FOR:	DATE
	BUILDING PERMIT	04.29.21



**SECTION, TOWNSHIP, RANGE:**

**SECTION 25, TOWNSHIP 24 NORTH,  
 RANGE 4 EAST, W.M.**

**PROJECT TEAM**

REVIEWED BY: J. TAFLIN  
 DESIGNED BY: K. GREKOV


**SHEET NAME**

**LOT 2 GRADING  
 AND DRAINAGE  
 PLAN**

**SHEET NUMBER**

**C4.2**

**Reviewed**  
 Koike Consulting Group, Inc.  
 C. Koike  
 07/30/2021

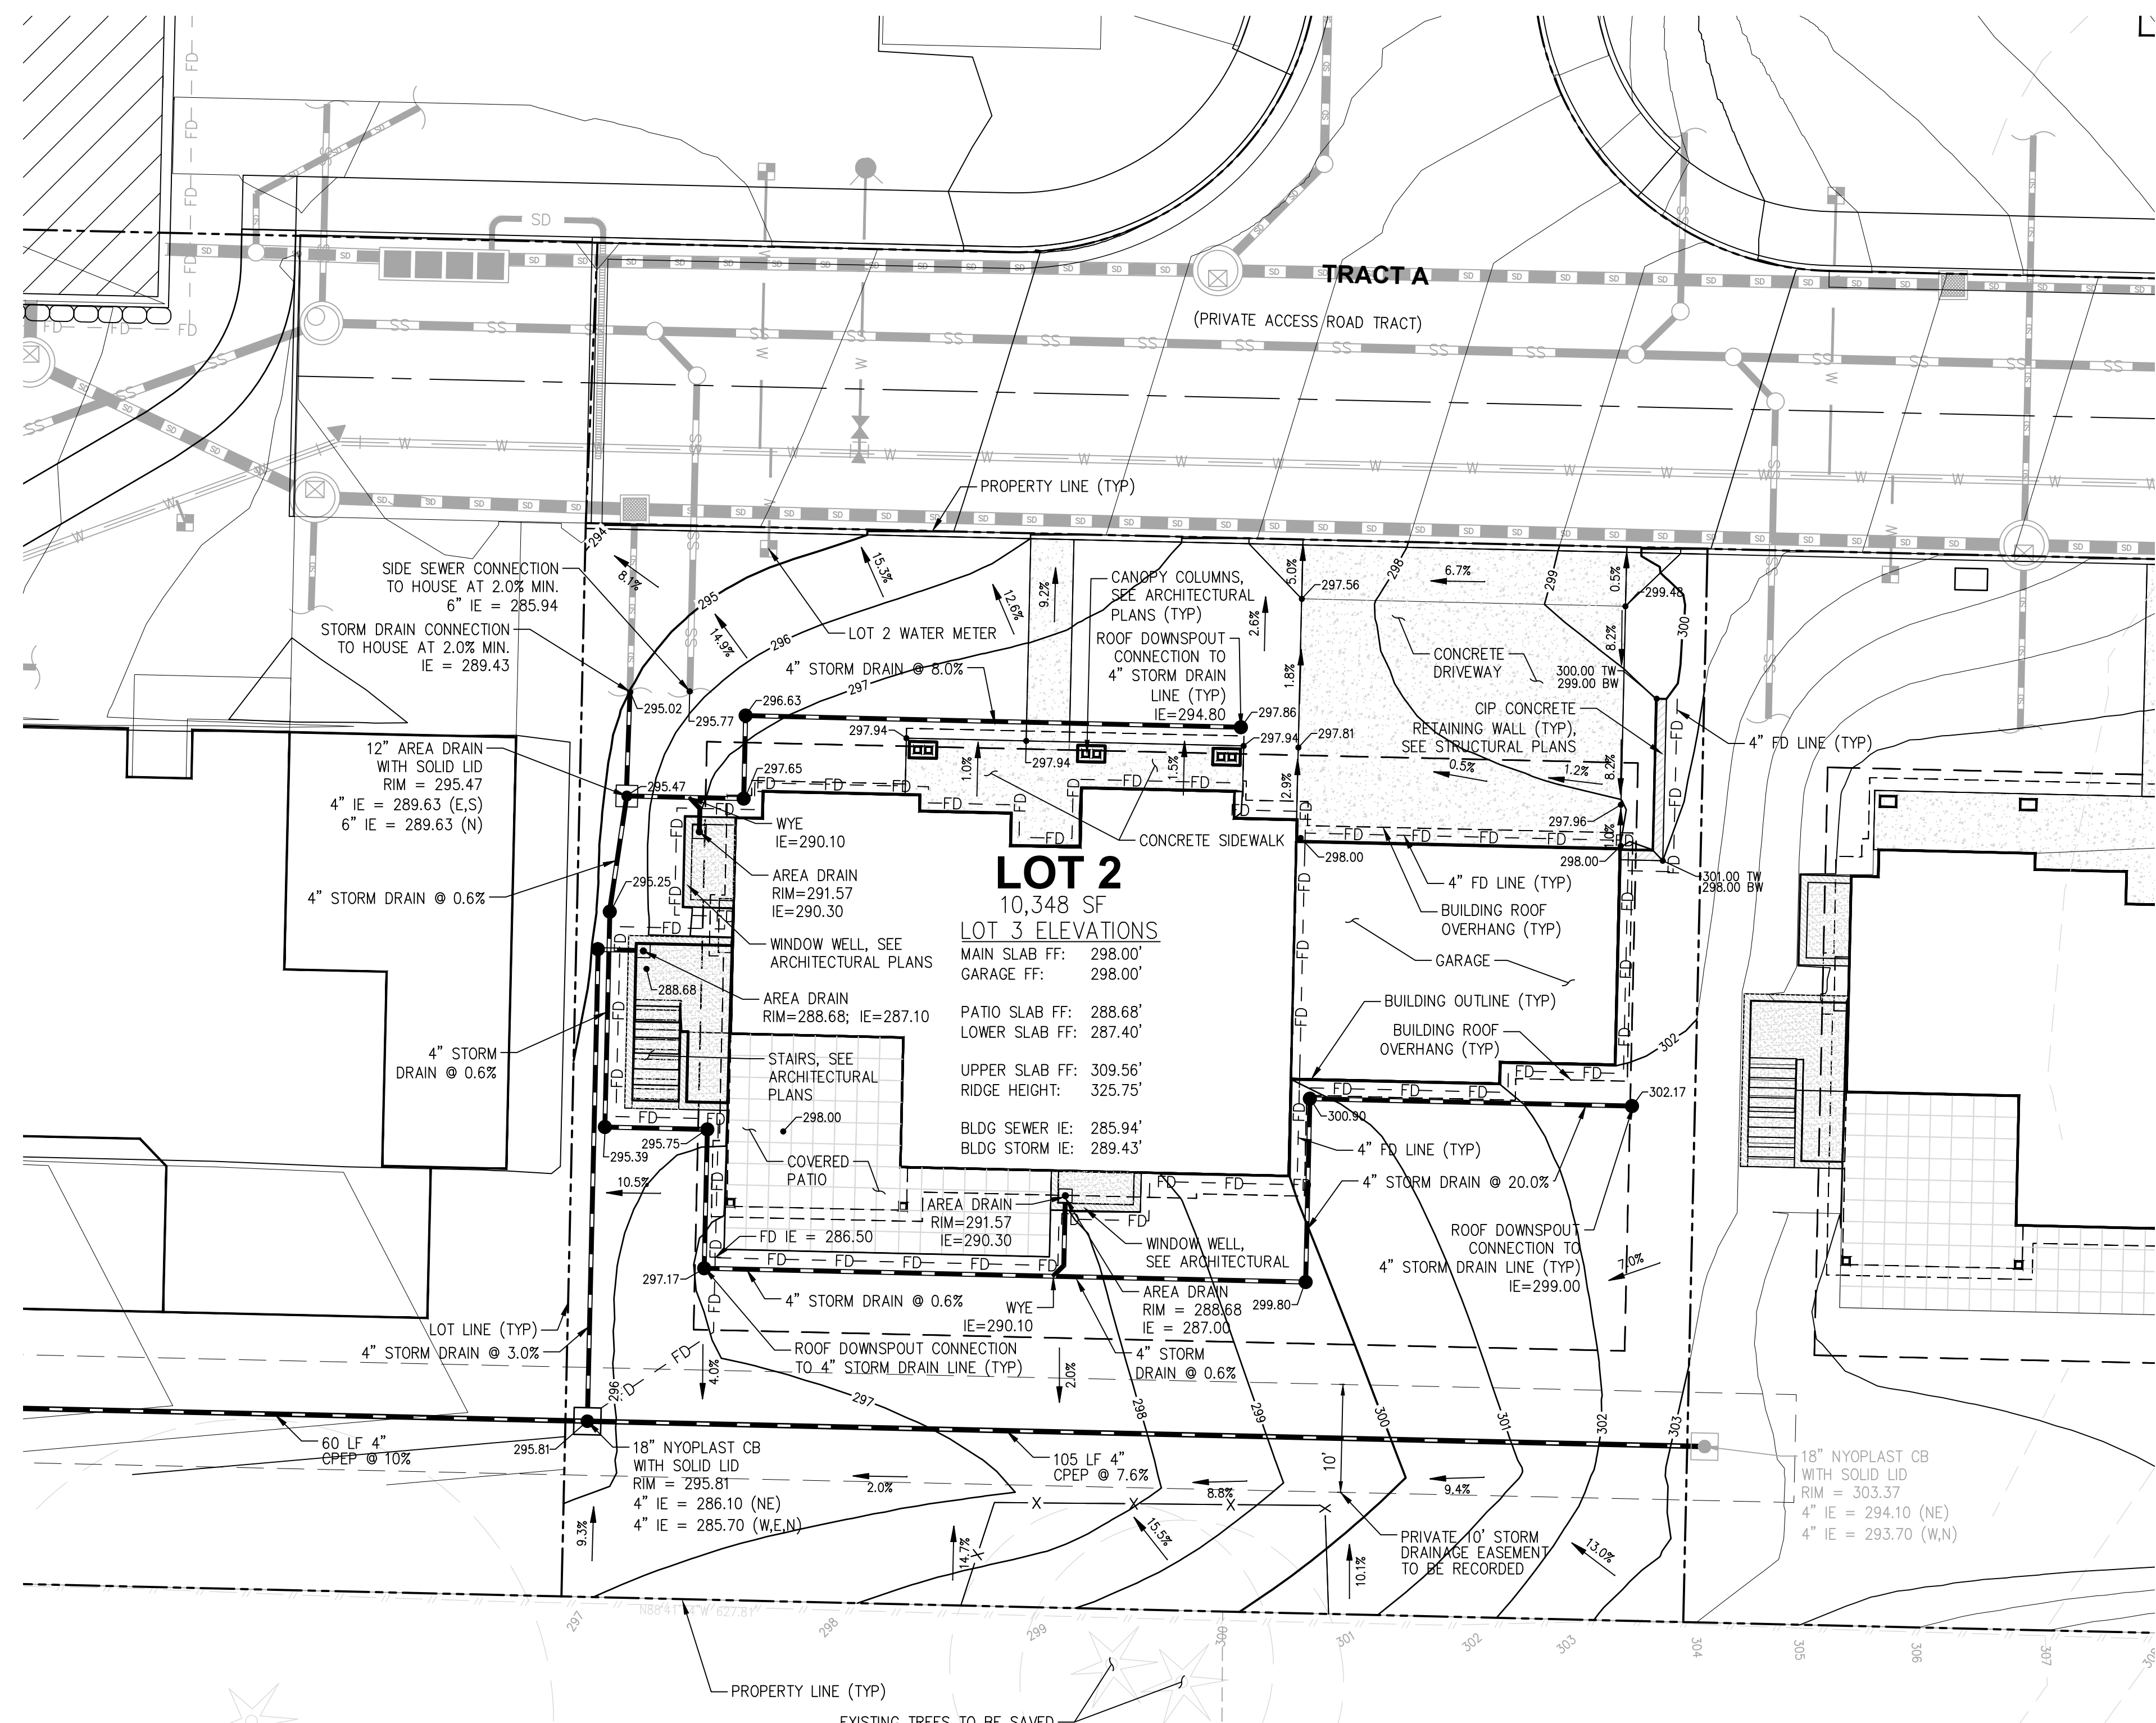

**GEOTECHNICAL SPECIAL INSPECTIONS**

1. MONITORING OF EROSION CONTROL.
2. OBSERVATION AND MONITORING OF EXCAVATION.
3. SUBSURFACE DRAINAGE INSTALLATION.

**GRADING NOTES (NAVIX)**

1. THE SPOT ELEVATIONS INDICATED ON THIS PLAN REPRESENT THE DESIGN TOP OF PAVEMENT OR SURFACE, UNLESS OTHERWISE NOTED.
2. CONTRACTOR IS RESPONSIBLE FOR DEMOLITION OF EXISTING STRUCTURES INCLUDING REMOVAL OF ANY EXISTING UTILITIES SERVING THE STRUCTURE. UTILITIES ARE TO BE REMOVED TO THE RIGHT-OF-WAY.
3. CONTRACTOR SHALL APPLY STABILIZATION FABRIC TO ALL SLOPES 3H:1V OR STEEPER. CONTRACTOR SHALL STABILIZE DISTURBED AREAS IN ACCORDANCE WITH LOCAL SPECIFICATION.
4. ALL CUT AND FILL SLOPES SHALL BE 3:1 OR FLATTER UNLESS OTHERWISE NOTED.
5. CONTRACTOR SHALL ASSURE POSITIVE DRAINAGE AWAY FROM BUILDING FOR ALL NATURAL AND PAVED AREAS AND SHALL GRADE ALL AREAS TO PRECLUDE PONDING OF WATER.
6. ALL POLLUTANTS OTHER THAN SEDIMENT ON-SITE DURING CONSTRUCTION SHALL BE HANDLED AND DISPOSED OF IN A MANNER THAT DOES NOT CAUSE CONTAMINATION OF STORMWATER. THE CONTRACTOR SHALL ADHERE TO ALL TERMS AND CONDITIONS AS OUTLINED IN THE GENERAL N.P.D.E.S. PERMIT FOR STORMWATER DISCHARGE ASSOCIATED WITH CONSTRUCTION ACTIVITIES.
7. PROPERTIES AND WATERWAYS DOWNSTREAM OF THE SITE SHALL BE PROTECTED FROM EROSION DUE TO INCREASES IN THE VOLUME, VELOCITY AND PEAK FLOW RATE OF STORMWATER RUNOFF FROM PROJECT SITE.
8. CONSTRUCTION SHALL COMPLY WITH ALL APPLICABLE GOVERNING CODES AND BE CONSTRUCTED TO SAME.
9. CONTRACTOR TO REMOVE UNSUITABLE SOILS LOCATED WITHIN THE BUILDINGS FOOTING AREA.
10. FOR BOUNDARY AND TOPOGRAPHIC INFORMATION REFER TO PROJECT SURVEY AND FINAL ENGINEERING PLANS.
11. ALL GRADING, SITE PREPARATION, AND EARTHWORK SHALL BE PERFORMED IN ACCORDANCE WITH THE PROJECT GEOTECHNICAL ENGINEERING REPORT, PROJECT 16-106, PREPARED BY PANGELO, DATED APRIL 28, 2016 AND GEOTECHNICAL EVALUATION, PROJECT T-8177, PREPARED BY TERRA ASSOCIATES INC., DATED JUNE 11, 2019.
12. ALL FILL MATERIAL SHALL BE APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT AND COMPACTION.
13. IF NEW FILL IS PLACED OVER EXISTING SLOPES OF 20% OR GREATER, THE STRUCTURAL FILL SHOULD BE KEYED AND BENCHED INTO COMPETENT NATIVE SLOPE SOILS. SEE FIGURE 4 ON SHEET C-2.6.
14. ALL EXISTING TREES THAT CAN FEASIBLY BE RETAINED WILL BE PRESERVED. CONTRACTOR WILL WORK WITH CITY ARBORIST AND OTHER STAFF TO MAXIMIZE TREE RETENTION.
15. THE TOTAL IMPERVIOUS SURFACE ON LOT WILL NOT EXCEED THE NET MAXIMUM LOT COVERAGE AREA.

**LOT INFORMATION**


LOT#	LOT AREA (SF)	LOT COVERAGE CALCULATIONS			
		GROSS MAX LOT COVERAGE ALLOWED (% / SF)	GROSS MAX LOT COVERAGE PROVIDED (% / SF)		
2	10,348	40%	4,139	39%	4,135

B: \\Washington\Mercer Island\Wes G\Pratt\2Drawings\PRTT\_142L.dwg Apr 30, 2021 11:01am

APN  
 927080-0050  
 DOWDY

1.76'  
 1.67'  
 1.88'

# BOUNDARY AND TOPOGRAPHIC SURVEY

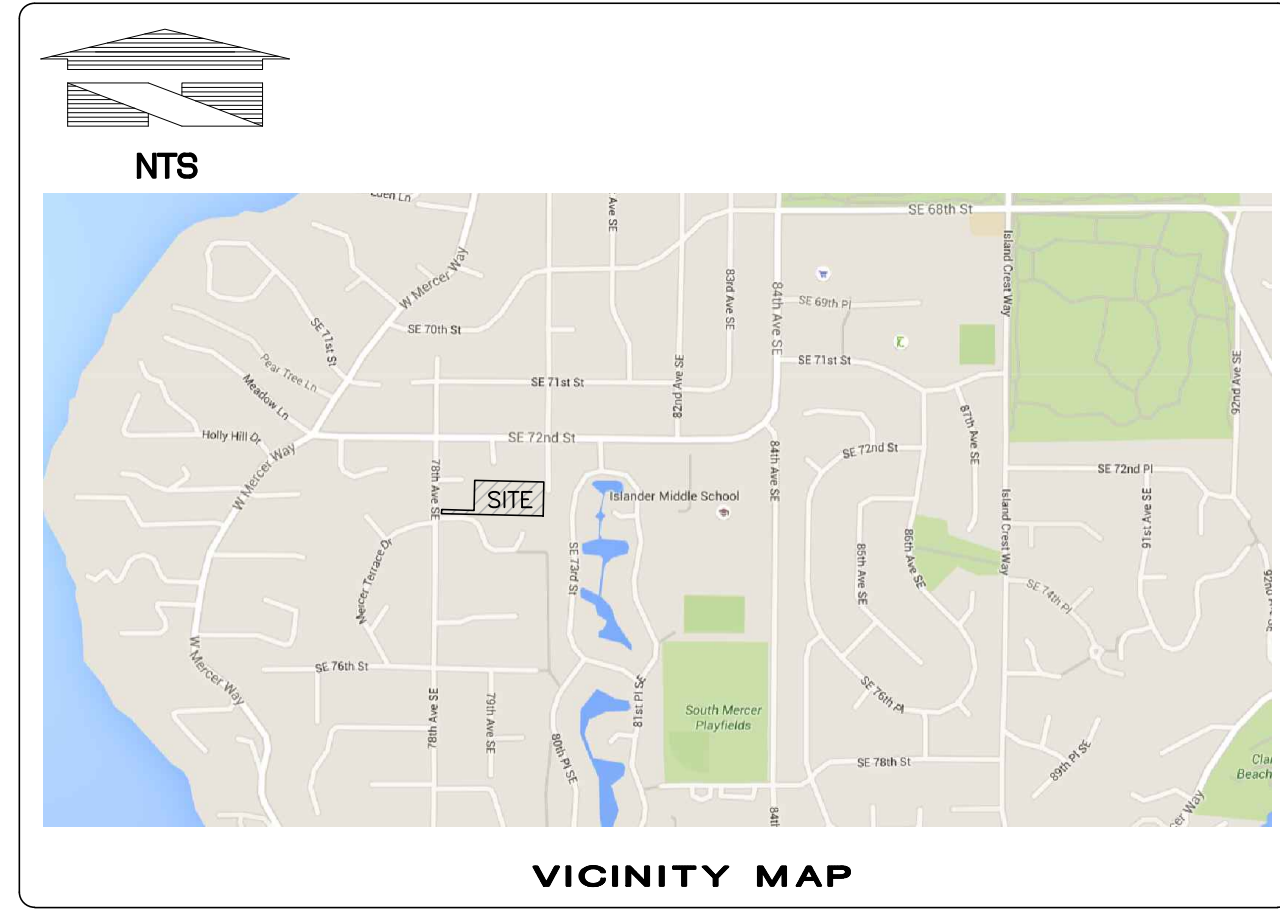

## LEGAL DESCRIPTION

THE EAST 427.40 FEET OF THE SOUTH 210.00 FEET OF THE NORTH 450.00 FEET OF THE EAST HALF OF THE NORTHWEST QUARTER OF THE SOUTHEAST QUARTER OF SECTION 25, TOWNSHIP 24 NORTH, RANGE 4 EAST, W.M., IN KING COUNTY, WASHINGTON;  
TOGETHER WITH THE SOUTH 25 FEET OF THE SOUTH 110 FEET OF THE NORTH 450 FEET OF THE EAST HALF OF THE NORTHWEST QUARTER OF THE SOUTHEAST QUARTER OF SAID SECTION, LYING WEST OF THE WEST LINE OF THE EAST 427.40 FEET OF SAID SUBDIVISION;  
EXCEPT PORTION CONVEYED TO KING COUNTY FOR ROAD PURPOSES BY DEED RECORDED UNDER RECORDING NO. 1626935,  
SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

## SPECIAL EXCEPTIONS

- EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO AS SHOWN IN THE DOCUMENT  
RECORDING DATE: JUNE 12, 1950  
RECORDING NO.: 4024150  
PURPOSE: INGRESS AND EGRESS  
AFFECTS: EAST 30 FEET (AS SHOWN)
- EASEMENT(S) FOR THE PURPOSE(S) SHOWN BELOW AND RIGHTS INCIDENTAL THERETO, AS GRANTED IN A DOCUMENT:  
GRANTED TO: PUGET SOUND POWER & LIGHT COMPANY  
PURPOSE: ELECTRIC TRANSMISSION  
RECORDING DATE: AUGUST 11, 1954  
RECORDING NO.: 4474176  
(BLANKET EASEMENT LOCATED WITHIN THE EAST 30' AS SHOWN)
- 3-6. ARE GENERAL OR TAX EXCEPTIONS, NOT APPLICABLE TO BE SHOWN ON THIS SURVEY.

## BASIS OF BEARING

BASIS OF BEARING FOR THIS SURVEY IS A LINE BETWEEN CITY OF MERCER ISLAND MI 1056 AT THE NORTHEAST CORNER OF THE SOUTHEAST QUARTER OF SECTION 25, T24N, R04E, W.M. AND MERCER ISLAND 1519 AT THE SOUTHWEST CORNER OF SAID QUARTER. BEARING BETWEEN THESE MONUMENTS WAS TAKEN AS SOUTH 46°01'02" WEST.

## BASIS OF ELEVATION

BASIS OF NAVD88 ELEVATION WAS TAKEN FROM MERCER ISLAND CONTROL MONUMENT 3190 AT THE INTERSECTION OF SE 72ND STREET AND 80TH AVENUE SE. ELEVATION TAKEN AS 302.674'

CHECKED WITH HIGH ACCURACY LEVEL NETWORK TO CITY OF MERCER ISLAND 3188 WITH A CLOSURE OF 0.000' FROM PUBLISHED. ELEVATION OF 3188 WAS TAKEN AT 260.671'.

## ADDRESS

7233 80TH AVENUE SE  
MERCER ISLAND, WA 98040

## TAX PARCEL NO. AND AREA

252404-9111, 94,764± SQ. FT. (2.175± ACRES)

## FLOOD INFORMATION

PROPERTY IS LOCATED ON FEMA MAP MAP NUMBER 53033C0675 F, NOT PRINTED.

## PROCEDURE / NARRATIVE:

A FIELD TRAVERSE USING A FOCUS 30 ROBOTIC TOTAL STATION AND A SPECTRA PRECISION RANGER 3 DATA COLLECTOR SUPPLEMENTED WITH FIELD NOTES AND TOPCON GRS NETWORK RTK GPS ROVER, WAS PERFORMED, ESTABLISHING THE ANGULAR, DISTANCE, AND VERTICAL RELATIONSHIPS BETWEEN THE MONUMENTS, PROPERTY LINES AND IMPROVEMENTS. THE RESULTING DATA MEETS OR EXCEEDS THE STANDARDS FOR LAND BOUNDARY SURVEYS AS SET FORTH IN WAC 332-130-090.

## REFERENCE SURVEYS:

- PLAT OF WEST RIDGE LANE, VOL. 96, PAGE 49
- MERCER ISLAND SHORT PLAT AMENDMENT NO. SUB06-016, REC. NO. 20070530900002
- ROS REC. NO. 20110923900002
- ROS REC. NO. 20080717900012

## NOTES



- ALL DISTANCES ON THIS SURVEY ARE SHOWN IN US SURVEY FOOT
- UTILITIES ON THIS SURVEY ARE SHOWN PER SURFACE OBSERVATIONS OBTAINED IN THE FIELD AT TIME OF SURVEY. UNDERGROUND UTILITY LOCATE PAINT MARKS WERE PLACED AS PART OF THIS SURVEY AND UTILITIES SHOWN ARE A RESULT OF THESE PAINT MARKINGS AND OTHER SURFACE OBSERVATIONS AS WELL AS READILY AVAILABLE UTILITY MAPS.
- TICOR TITLE COMPANY COMMITMENT NUMBER 70042742, EFFECTIVE DATE FEBRUARY 22, 2016 AT 08:00 A.M. WAS UTILIZED FOR THIS SURVEY.
- FIELD SURVEY WAS PERFORMED ON APRIL 13, 14 & 16, 2016 AND MONUMENTS SHOWN AS FOUND WERE VISITED ON THIS DAY.

## SURVEYOR'S CERTIFICATE:

THIS IS TO CERTIFY THAT THIS MAP OR PLAT AND THE SURVEY UPON WHICH IT IS BASED WERE MADE BY ME OR UNDER MY DIRECTION AND CORRECTLY REFLECTS THE CONDITIONS OF THIS SITE AS OF THE DATE OF THE FIELD SURVEY.

TREVOR S. LANKTREE P.L.S.  
WASHINGTON REGISTRATION NO. 45789

2-02-2017  
DATE

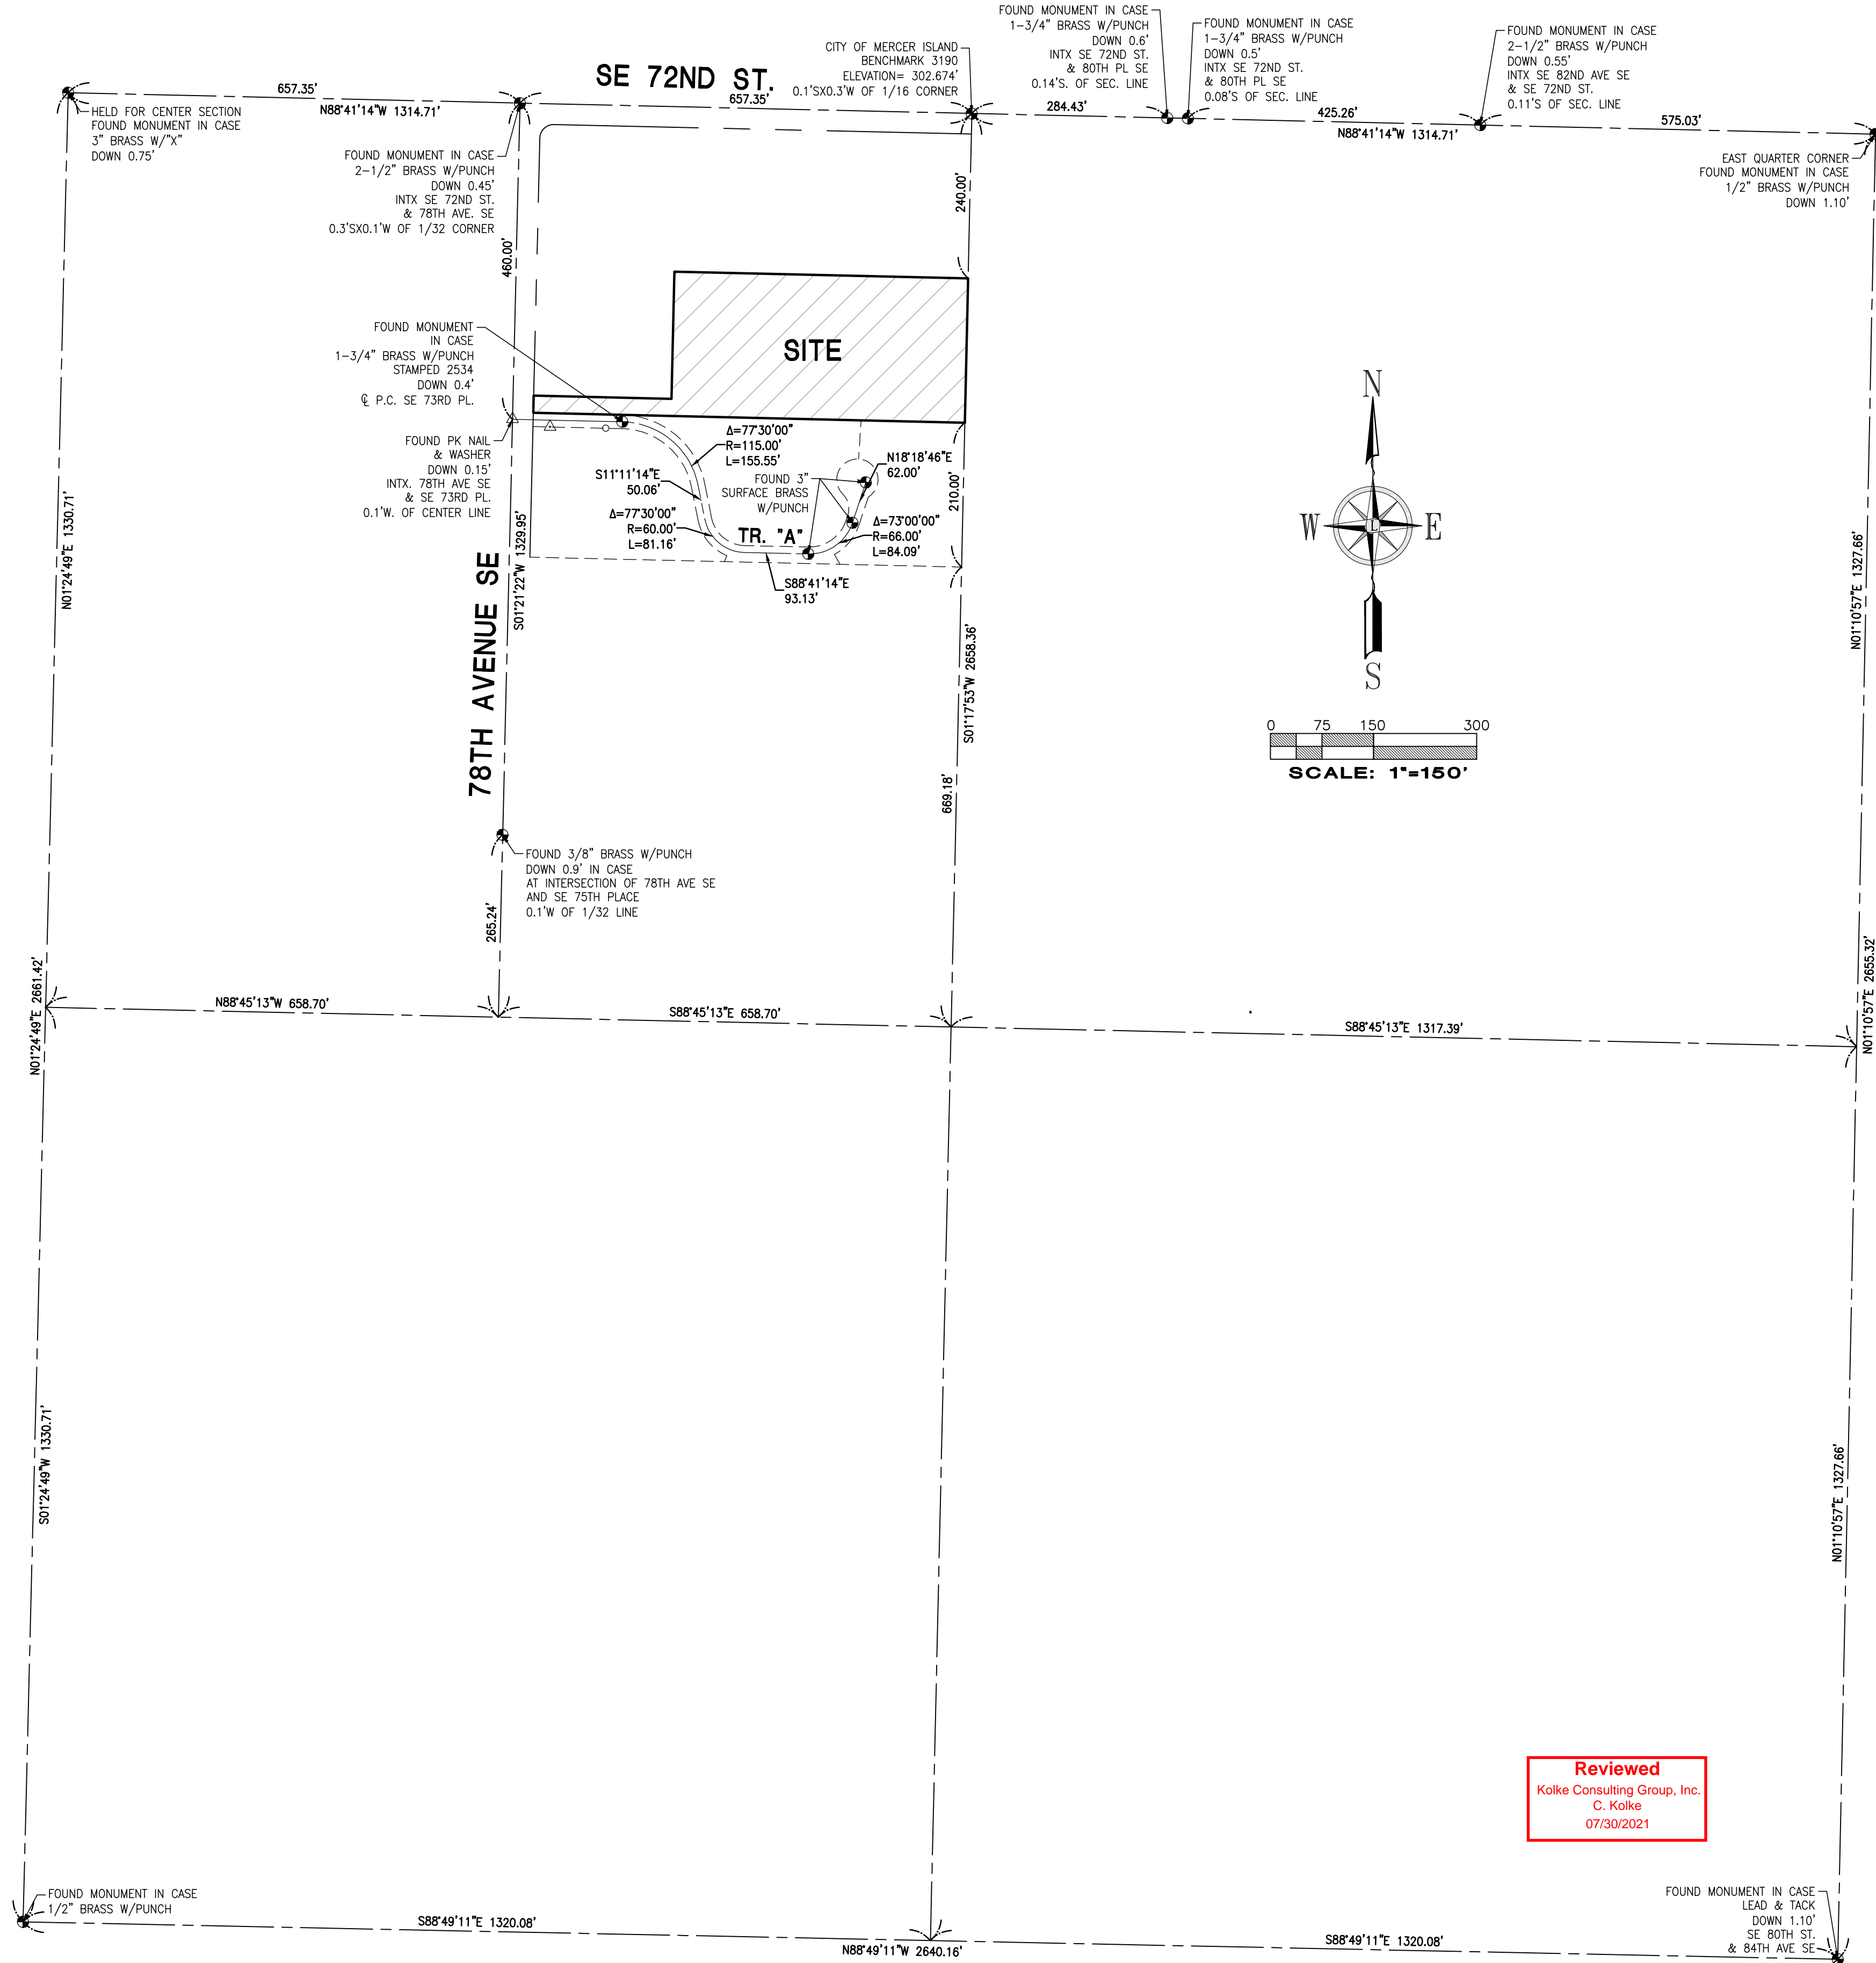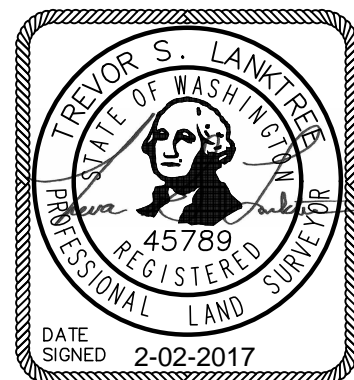


**Reviewed**  
Kolke Consulting Group, Inc.  
C. Kolke  
07/30/2021

<b>Title:</b> BOUNDARY AND TOPOGRAPHIC SURVEY PTN OF THE NW1/4, OF THE SE1/4 OF SEC. 25, TWP. 24 N., RGE 4 EAST, W. M. CITY OF MERCER ISLAND KING COUNTY STATE OF WASHINGTON	
<b>For:</b> BELLEVUE PACIFIC PROPERTIES GROUP, LLC 3029 92ND AVENUE NE CLYDE HILL, WA 98004	
Scale: Horizontal 1"=150' Vertical 1"=150'	Designed: [Blank] Drawn: [Blank] Checked: [Blank] Approved: [Blank] Date: 4/22/16
<b>LANKTREE LAND SURVEYING, INC.</b> 32320 111TH PLACE S.E., AUBURN, WA 98092 PHONE: (253) 653-6423 FAX: (253) 793-1616 WWW.LANKTREELANDSURVEYING.COM	
Job Number <b>2120</b>	Sheet <b>TO01</b> 1 of 4

# BOUNDARY AND TOPOGRAPHIC SURVEY

SEE MATCHLINE B SHEET 3 OF 4

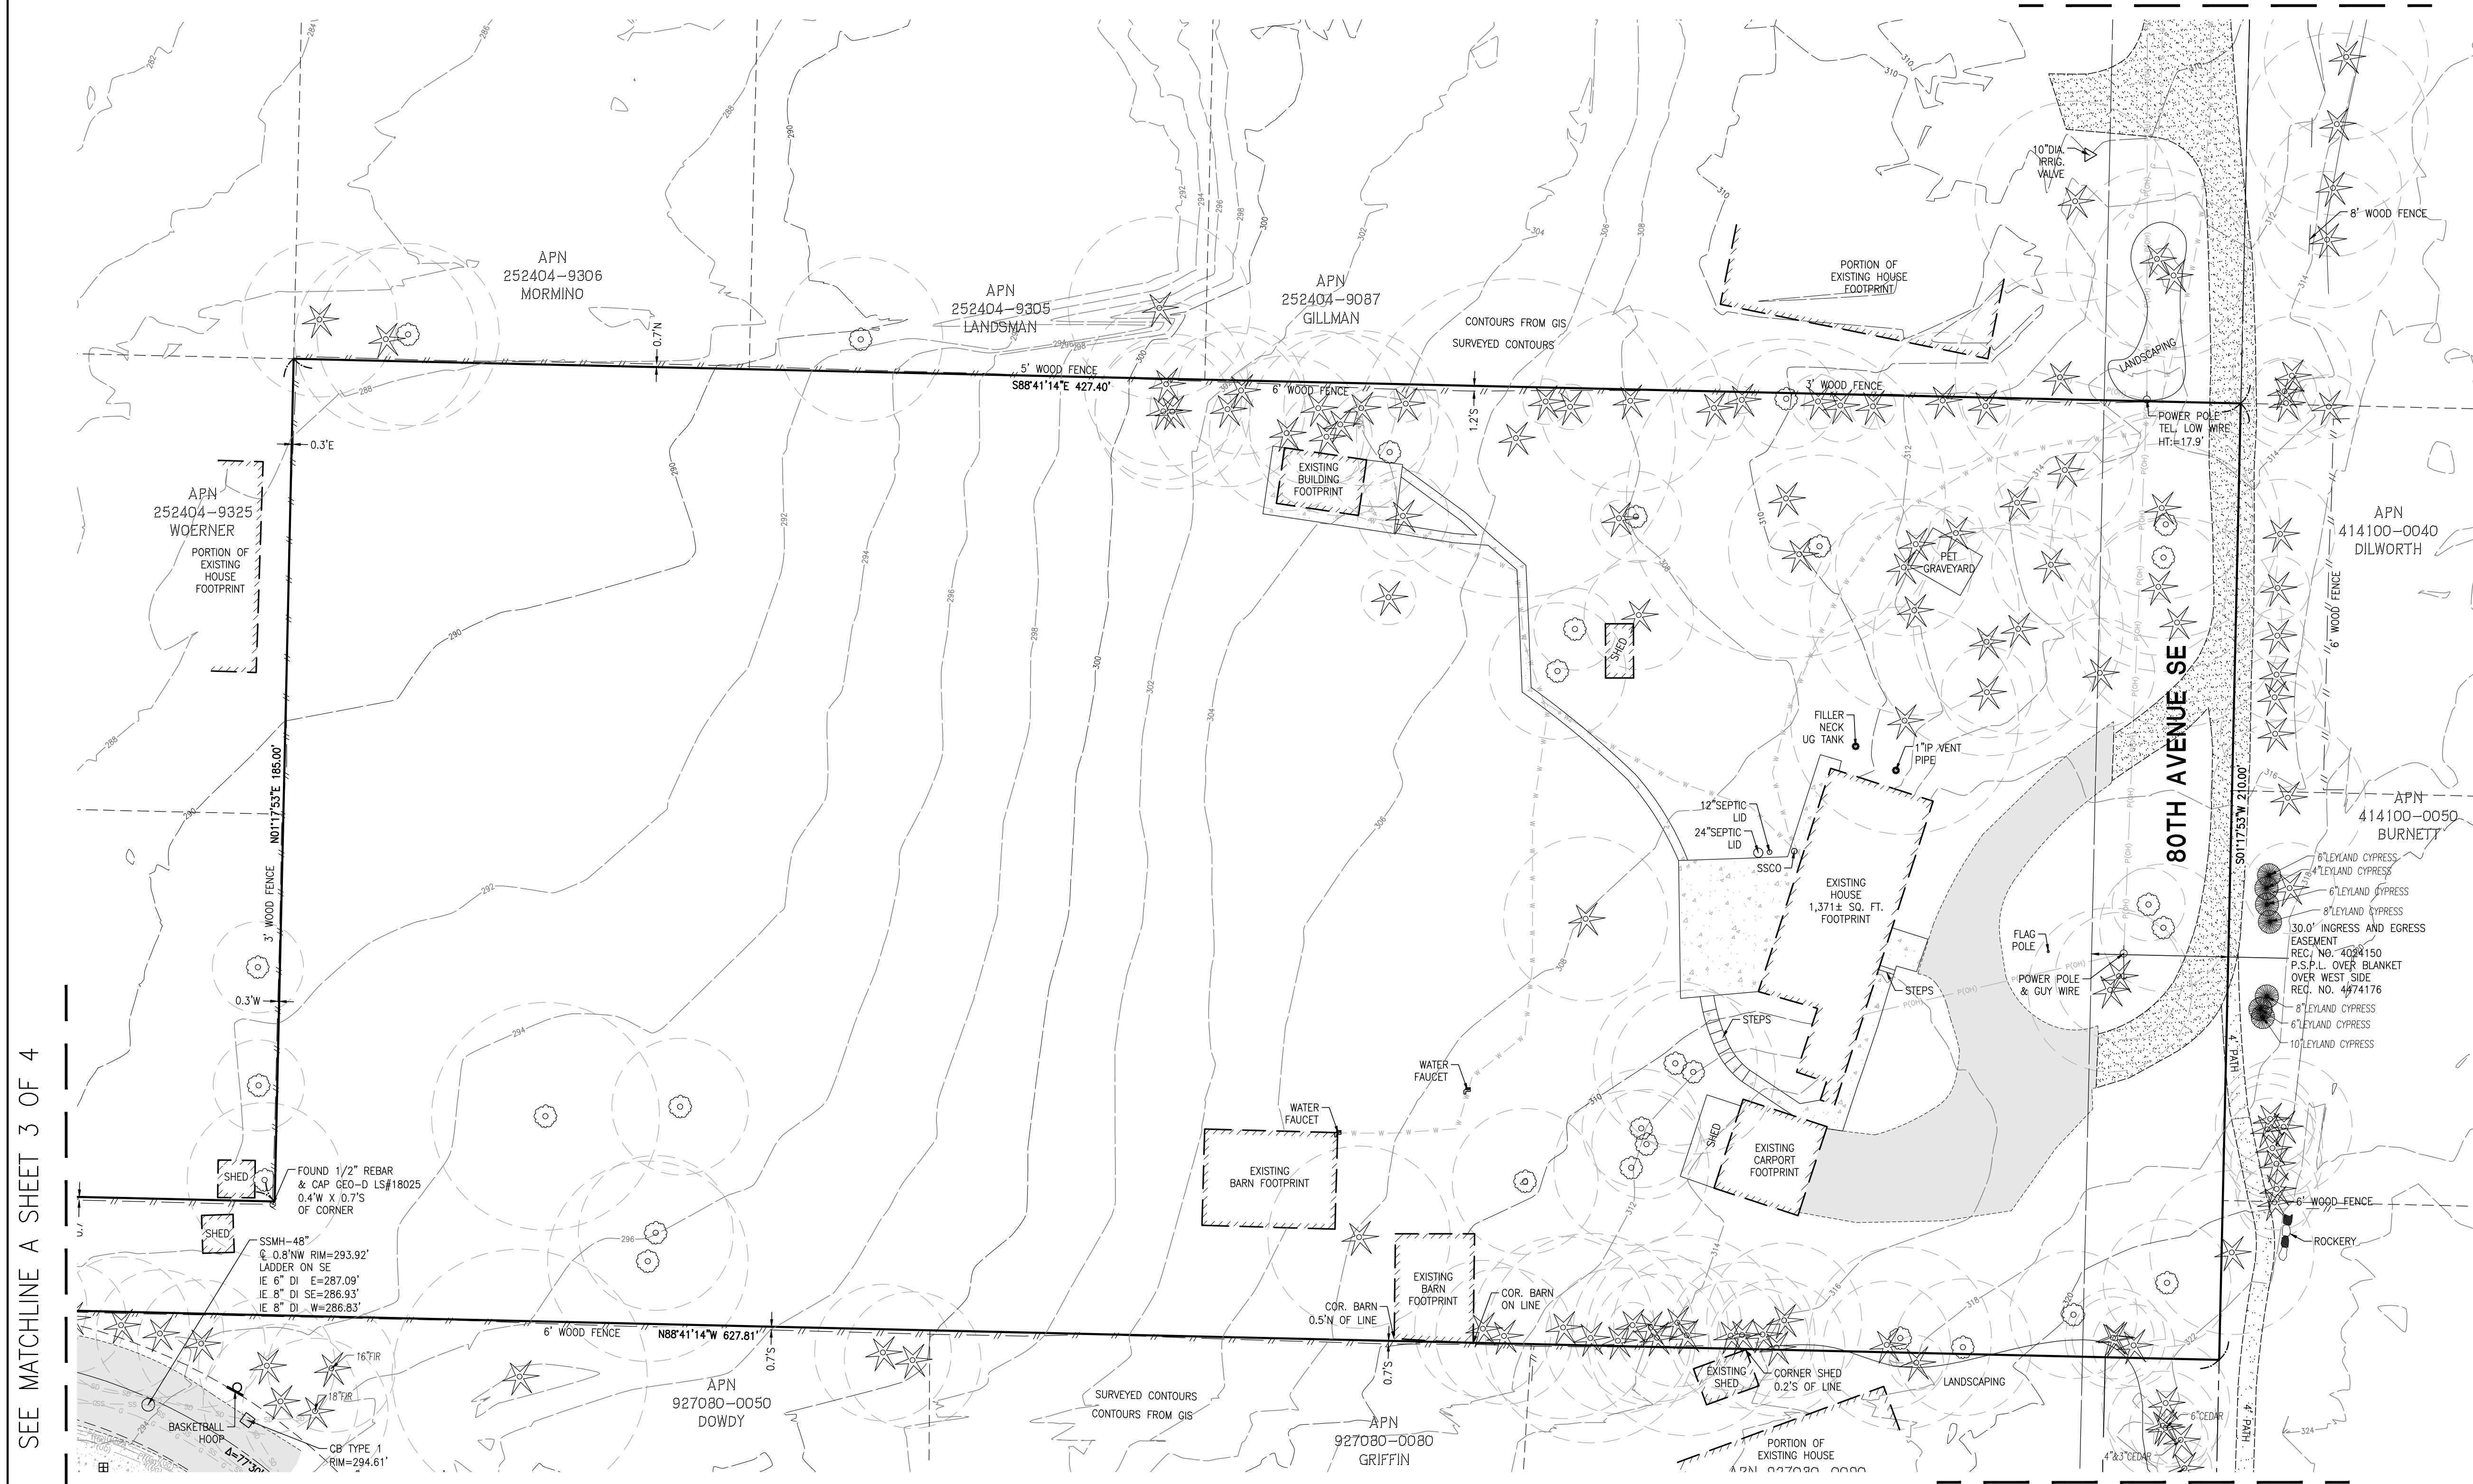

SEE MATCHLINE A SHEET 3 OF 4

SEE MATCHLINE C SHEET 3 OF 4

No.	Date	By	Chk.	Appr.	Revision
1	2/2/17	SKK	TSL	TSL	ADDED TOPO FOR WATER EXTENSION ALONG BOTH AVE. SE


**Title:** BOUNDARY AND TOPOGRAPHIC SURVEY  
 PTN OF THE NW1/4, OF THE SE1/4 OF SEC. 25,  
 TWP. 24 N., RGE 4 EAST, W. M.  
 CITY OF MERCER ISLAND  
 KING COUNTY STATE OF WASHINGTON

**For:** BELLEVUE PACIFIC  
 PROPERTIES GROUP, LLC  
 3029 92ND AVENUE NE  
 CLYDE HILL, WA 98004

Designed	Drawn	Checked	Approved	Date
—	BGM	TSL/jk	TSL	4/22/16

**LANKTREE LAND SURVEYING, INC.**  
 32320 111TH PLACE S.E., AUBURN, WA 98092  
 PHONE: (253) 653-6423  
 FAX: (253) 793-1616  
 WWW.LANKTREELANDSURVEYING.COM

Job Number: **2120**  
 Sheet: **TO02**  
 of **4**

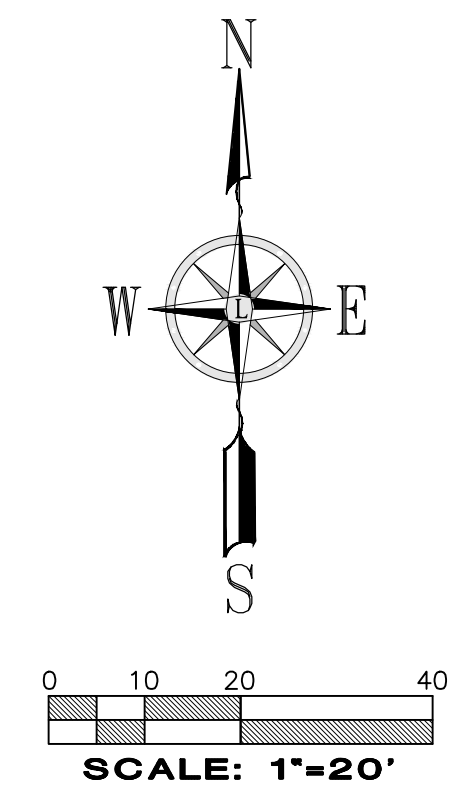

Reviewed  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021



**STRUCTURAL FRAMING NOTES**

- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x BLOCKING BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN) PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 #2@13" NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 #2@13" NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH)
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 4) PROVIDE 2" OSB OR 3" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON 502.0)
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2@13" NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2@13" NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE 4 HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x MIN @ HD'S
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 2" OSB OR 3" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE 502.0)
- 10) FASTEN PT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/2" x 2 3/4" LONG TAPLON SCREWS @ 6" O.C. (16 TOTAL) SEE DETAIL 19/502.02 FOR MORE INFO.
- 11) PROVIDE M5TC66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSSES)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED) FASTEN SHEATHING TO OSB RIM W/ 2 #2@13" NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE 4 HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**FOUNDATION DRAINAGE/WATERPROOFING**

EXTERIOR FOUNDATION WALLS THAT RETAIN EARTH AND ENCLOSE INTERIOR SPACES AND FLOORS BELOW SHALL BE WATERPROOFED FROM THE HIGHER OF THE TOP OF THE FOOTING OR 6" BELOW THE TO OF THE BASEMENT FLOOR TO THE FINISHED GRADE. Provisions for wall drainage should consist of a rigid 4-inch diameter perforated drainage pipe behind and at the base of the wall footings. The drainage pipe should be embedded in 12" to 18" inches of pea gravel or clean crushed rock. A minimum 12-inch wide layer of free draining granular soils (1/2" pea gravel or washed rock) is recommended adjacent to the wall for the full height of the wall. Alternatively, a composite drainage material, such as Miradrain 6000 may be used in lieu of a vertical free draining granular soil layer. The composite drainage material should be installed per the manufacturer's recommendations. The drainage at the base of the wall should be graded to direct water to a suitable outlet.

**CRAWL SPACE VENTS**

1. CRAWL SPACE AREA 408 SF
2. CRAWL SPACE AREA / 300 = 1.36 SF OF VENT AREA REQUIRED
3. TYPICAL VENT SIZE = 14"x8"x15" (75% EFFICIENCY) = 58 SF PER VENT NET FREE AREA
4. VENT AREA / 58 = 2.34 VENTS REQUIRED
5. 3 VENTS SHOULD (SEE PLAN FOR LOCATION)
6. 3 VENTS x 58 = 174 SF OF VENT AREA PROVIDED
7. VENTS SHALL BE COVERED WITH CORROSION RESISTANT WIRE MESH WITH OPENINGS OF 1/4" MAX.
8. VENTS LOCATED IN RIM JOIST MUST BE PERMANENTLY BAFFLED. USEC 502.1.4.1

**GENERAL FRAMING NOTES**


1. SEE TYPICAL MATERIALS LIST ON SECTION SHEET
2. SEE SHEET A-1 FOR ALL GENERAL NOTES AND FOR ALL REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.
3. TRUSS DESIGN BY HEG. TRUSS PLAN SHOWN IS FOR GENERAL LAYOUT ONLY. SEE DIV. 0502.10A SHEET A-1 - TRUSS LOADING. SEE DIV. 0502.10A SHEET A-1 - TRUSS SPAN PER FLOOR PLANS - TRUSS TYPE PER ROOF FRAMING PLAN
4. ROOF FRAMING SPACING, 24" o.c. UNO.
5. ROOF PITCH - EXTERIOR PER ELEVATION INTERIOR PER SECTION.
6. RAFTER TAIL 2x4. VERIFY.
7. ROOF TAIL AND RAKE OVERHANG PER ROOF PLAN.
8. ALL HEADERS ARE 4x10 OF #2 UNO. PROVIDE (1) TRIMMER STUD UP TO 4'-0" SPAN AND (2) TRIMMER STUDS OVER 4'-0" UNO. SEE DIV. 05100 SHEET A-1
9. STUD NOTCHING AND BORING PER I.R.C. SECT. R602.6 - BEARING OR EXTERIOR WALL MAXIMUM NOTCH 25% BORING 40% - 60% MAXIMUM BORING IF DOUBLED WITH NOT MORE THAN (2) SUCCESSIVE STUDS BORED. - NON-BEARING MAXIMUM NOTCH 40% BORING 60%. - NO NOTCHING OR BORING SHALL BE MADE TO EACH STUD

**FOUNDATION KEYNOTES**


- FP-1 CONCRETE STEM WALL, 8" WIDE WITH MIN. 15"x1' FOOTING. SEE DETAILS FOR ADDITIONAL INFORMATION. SEE DIV. 3 SHEET A-1
- FP-2 CONCRETE STEM WALL, 6" WIDE WITH MIN. 12"x6' FOOTING. SEE DETAILS FOR ADDITIONAL INFORMATION. SEE DIV. 3 SHEET A-1
- FP-3 CONCRETE SLAB ON GRADE SHALL BE 4" THICK STEEL TROULED FINISH W/ 6x6 W/40x14 WUF ON 4" GRANULAR FILL. SLOPE 2' TO DOOR. PROVIDE THICKENED EDGE AT DOOR. SEE DIV. 3 SHEET A-1
- FP-4 PROVIDE A 6-MIL POLYETHYLENE OR APPROVED VAPOR BARRIER WITH JOINTS LAPPED NOT LESS THAN 6" BETWEEN THE CONCRETE SLAB AND THE BASE COURSE OR PREPARED SUBGRADE.
- FP-5 CRAWL SPACE VENT. SEE CALCULATION. SEE DIV. 1 SHEET A-1
- FP-6 ALL CRIPPLE WALLS ARE 2x6 OR 3x4 @ 16" o.c. UNO. 14" MIN. STUD LENGTH PER IRC. SEE DIV. 6 SHEET A-1
- FP-7 4x10 BEAM LINE UNO. MIN. 1' CLEARANCE FROM CONCRETE AT END OF BEAMS. SEE DIV. 6 SHEET A-1
- FP-8 4x4 PRESSURE TREATED POST (SCAB POST AND BEAM WITH 2x4) ON 80# FELT ON MAT FOOTING UNO. PROVIDE 4x6 POST @ BEAM SPICE & POSITIVE CONNECTION FROM POST TO FOOTING. PER DETAIL 16/D1. SEE DIV. 6 SHEET A-1
- FP-9 6 MIL BLACK POLYETHYLENE GROUND COVER. SEE DIV. 1 SHEET A-1
- FP-10 ELECTRICAL SERVICE: PROVIDE (1) 1 1/2" SCHEDULE 80 PVC CONDUIT FOR ELECTRICAL SERVICE AND (1) 8x8 GALVANIZED ROD FOR ELECTRICAL GROUNDING. SEE DIV. 16 AND VERIFY W/ SITE CONDITIONS
- FP-11 BLOCK OUT IN STEM WALL FOR DOORS, HVAC, ETC. AS REQUIRED
- FP-12 18"x24" CRAWL SPACE ACCESS. INSULATE AND WEATHER STRIP. SEE DIV. 0502.1 SHEET A-1
- FP-13 24"x24"x12" MAT FOOTING ON SOLID SUBSTRATE W/ (2) #4 BAR EACH WAY OR 12"x1" STRIP FOOTING
- FP-14 24"x24"x16" MAT FOOTING ON SOLID SUBSTRATE W/ (2) #4 BAR EACH WAY OR 12"x1" STRIP FOOTING
- FP-15 30"x30"x12" MAT FOOTING ON SOLID SUBSTRATE W/ (2) #4 BAR EACH WAY OR 15"x1" STRIP FOOTING
- FP-16 36"x36"x12" MAT FOOTING ON SOLID SUBSTRATE W/ (2) #4 BAR EACH WAY
- FP-17 8TB STEEL 12" INTO SLAB @ 12" o.c.
- FP-18 FLOOR JOIST SEE DIV. 6 SHEET A-1
- FP-19 4x8 BEAM LINE, SOLID BLOCKING BETWEEN JOIST OVER SUPPORT. SEE DIVISION 06100 SHEET A-1
- FP-20 PROVIDE SOLID BLOCKING THRU JOIST SYSTEM TO PROVIDE SAME AREA OF BEAM SUPPORT AS ABOVE AND BELOW SEE DIV. 6 SHEET A-1
- FP-21 MIN. 1' CLEARANCE FROM CONCRETE AT END OF BEAMS
- FP-22 EXTEND PIER MIN 18" BELOW SURROUNDING GRADE
- FP-23 3" DIAMETER STEEL POST
- FP-24 EDGE OF CONCRETE

**SYMBOLS & LEGEND**

- POINT LOADS FROM ABOVE
- POINT LOADS FROM ABOVE W/ LOADING
- POINT LOAD TRANSFERING DOWN
- POINT LOAD TRANSFERING DOWN W/ LOADING
- POINT LOAD TRANSFERED BY KICKER
- HOLD DOWN WITH SIZE DESIGNATION
- VERTICAL STRAP WITH SIZE DESIGNATION TO BE USED ON FLOOR BELOW
- HORIZONTAL STRAP WITH SIZE DESIGNATION
- INDICATES BEAM CALCULATION WITH INDEXED NUMBER
- WALL ABOVE
- WALL BELOW

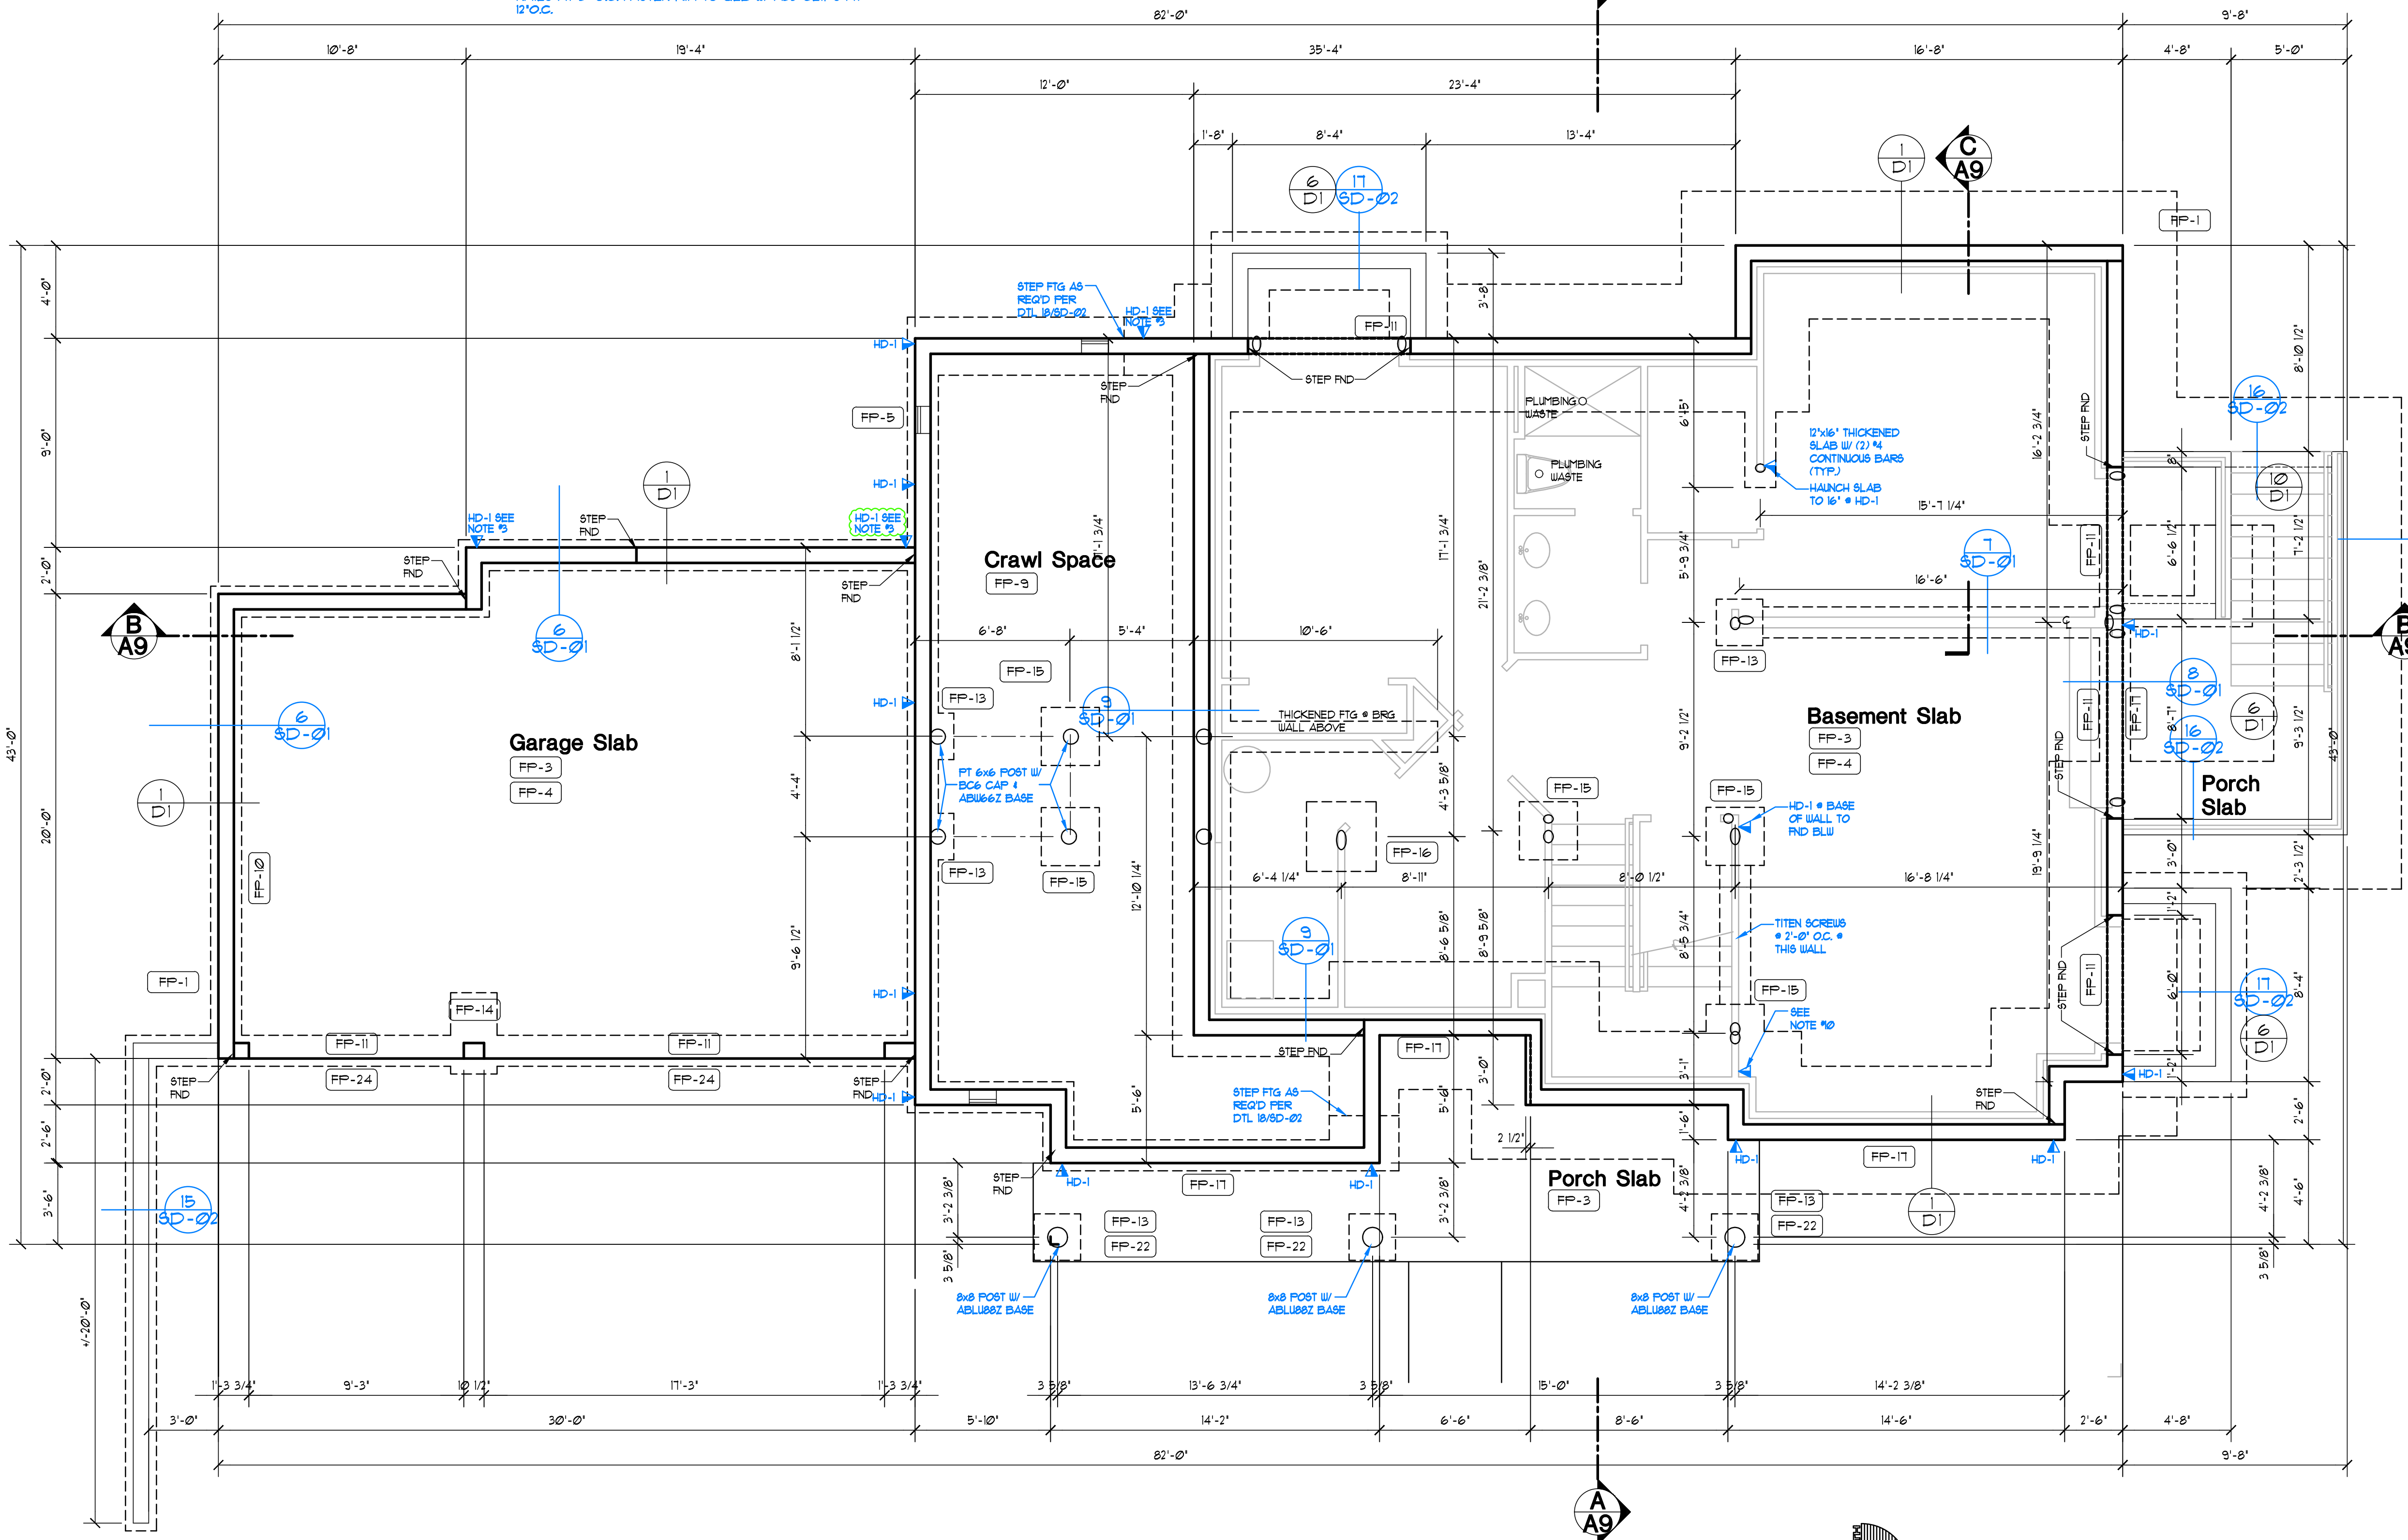

**FOUNDATION PLAN**  
Scale 1/4"=1'-0"

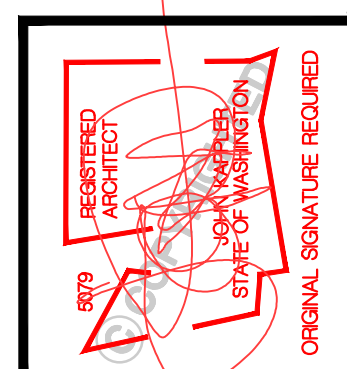

Date	By	Description
06/20/21	SM	PERMIT SET
07/22/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 16th St  
 Bellevue, WA 98007  
 1-800-888-4517  
 www.kapichonplank.com

Reviewed  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE  
 JOB NO.: 19035.21  
 STARTING NO.: 19035.05

SHEET  
**A2.0**

**STRUCTURAL FRAMING NOTES**

- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x BLOCKING BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN) PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 #2x131' NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 #2x131' NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH)
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 4) PROVIDE 2" OSB OR 3/4" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON 802.0)
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2x131' NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2x131' NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE 4 HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x # HD
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 2" OSB OR 3/4" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE 802.0)
- 10) FASTEN FT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/2" x 2 3/8" LONG TAPLON SCREWS @ 6" O.C. (18 TOTAL) SEE DETAIL 19/82.02 FOR MORE INFO.
- 11) PROVIDE M8TC66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSS)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED) FASTEN SHEATHING TO OSB RIM W/ 2 #2x131' NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE 4 HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**SYMBOLS AND LEGEND**


- FAN - DIRECT VENT TO OUTSIDE
  - BATHROOMS/LAUNDRY 50 CFM MIN.
  - KITCHEN EXHAUST HOOD TO BE MIN. OF 100CFM. IF EXHAUST HOOD EXCEEDS 400 CFM MAKE UP AIR MUST BE PROVIDED PER SECTION M1803.6.
- WHOLE-HOUSE FAN TO RUN CONTINUOUS 4 CONFORM TO IRC, M1805.4. FAN SIZE PER PLAN. FAN RATE TO BE ADJUSTED BY A FACTOR OF 15 FOR A NON-BALANCED NON-DISTRIBUTED SYSTEM. FRESH AIR TO BE PROVIDED BY THE FORCED AIR SYSTEM DUCTS PER SECTION M1805.4.1. FAN TO HAVE A SONG RATING OF 10 OR LESS MEASURED AT 0.1 INCHES WATER GAUGE
- THERMOSTAT @ 50" ABOVE FLOOR
- 110V SMOKE ALARM PER IRC, R314 WITH BATTERY BACKUP INTERCONNECTED. USE A COMBINATION SMOKE/CARBON MONOXIDE ALARM WHEN NOTED PER SECTION M1803.6.
- MECHANICAL, PLUMBING, AND ELECTRICAL SYSTEM FOR UNITS: PER DIV. 15.16 SEE SHEET A1
- FURN (WH)
  - A. PROVIDE 6" DIAMETER FRESH AIR INTAKE FROM OUTSIDE TO RETURN AIR PLENUM AT FURNACE WITH THERMOSTATED FLOW DAMPERS.
  - B. PROVIDE THERMAL EXPANSION TANK AT WATER HEATER.
  - C. STRAP WATER HEATER TO FRAMING TOP AND BOTTOM.
  - D. PROVIDE PRESSURE RELIEF LINE PLUMBED TO OUTSIDE.

**GENERAL PLAN NOTES**


1. SEE SHEET A-1 FOR ALL GENERAL NOTES AND REQUIREMENTS.
2. ENERGY AND AIR QUALITY INFORMATION SEE DIV. 11 SHEET A-1
3. SEE BUILDING ELEVATION FOR WINDOW OPERATION SEE DIV. 8 SHEET A-1
4. SEE TYP. MATERIALS LIST ON SECTION SHEET
5. SEE SHEET A-1 FOR ALL NOTES AND REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.

**FLOOR PLAN KEY NOTES**

- P-1 OCCUPANCY SEPARATION: APPLY (1) LAYER OF 5/8" G.I.B. TO GARAGE SIDE OF RESIDENCE, ATTIC SPACES, AND TO ALL BEAMS AND POSTS SUPPORTING A FLOOR-CEILING ASSEMBLY. APPLY (1) LAYER OF 5/8" TYPE 'X' G.I.B. TO GARAGE CEILING WHEN UNDER HABITABLE ROOF. DUCTS THROUGH WALL OR CEILING COMMON TO HOUSE SHALL HAVE MINIMUM 26 GAUGE STEEL SEE DIV. 01002.6.A SHEET A-1.
- P-2 1/2" MIN. SELF-CLOSING SOLID WOOD CORE HONEY-COMB CORE STEEL OR 20-MINUTE FIRE RATED DOOR SEE DIV. 01002.6.B SHEET A-1
- P-3 STAIR ASSEMBLY NOTES: PER IRC, SECTION R311.5 AND DETAIL 4/D
  - A. HEADROOM MIN. 6'-8". WIDTH MIN. 3'-0".
  - B. TREADS 10" MIN. DEPTH AND MIN. WIDTH OF 36" ABOVE HANDRAIL HEIGHT, RISERS 7 1/2" MAX. HT. TREAD NOSING TO BE MINIMUM 3/4" AND A MAXIMUM OF 1/4" ON STAIRS WITH SOLID RISERS.
  - C. HANDRAIL MIN. 34" TO MAX. 38" ABOVE TREAD NOSING. HANDRAIL TYPE 1 CIRCULAR TO HAVE 1/4" MIN. TO 2" MAX. CROSS SECTION DIMENSION AND 1 1/2" MIN. CLEAR FROM WALL. RETURN RAIL ENDS. HANDRAILS SHALL BE STRONG ENOUGH TO RESIST A 200 POUND POINT LOAD IN ANY DIRECTION PER IRC, TABLE R302.5
  - D. INSTALL FIRE BLOCKING BETWEEN STRINGERS AT THE TOP AND BOTTOM OF EACH RUN PER IRC, SECTION R302.11.
  - E. COVER USABLE SPACE UNDER STAIR W/ 1/2" G.I.B. PER IRC, SECTION R302.1.
  - F. INTERMEDIATE BALUSTERS SHALL BE SPACED W/ LESS THAN 4" BETWEEN BALUSTERS.
  - G. PROVIDE STAIRWAY ILLUMINATION PER IRC, SECTION R302.6.
- P-4 SAFETY GLAZING PER IRC, SECTION R308
  - A. WINDOWS WITHIN 18" OF FLOOR
  - B. WINDOWS WITHIN A 24" ARC OF DOORS
  - C. WINDOWS AT TUBS AND SHOWERS
  - D. GLAZING IN DOORS
  - E. LESS THAN 60" HORIZ. FROM THE BOT. STAIR TREAD NOSING 4 BOT. EDGE OF GLAZING IS LESS THAN 36" ABV. LANDING/WALKING SURFACE SEE DIV. 08000 SHEET A-1
- P-5 EGRESS WINDOW PER IRC, SECTION R310 SEE DIV. 08600 SHEET A-1
- P-6 IGNITERS FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN. ABOVE TOP OF SLAB. SEE DIV. 15 SHEET A-1
- P-7 COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NON-ABSORBENT MATERIAL TO 12" ABOVE DRAIN INLETS. PER IRC, SECTION 302.12. SEE DIV. 09250 SHEET A-1
- P-8 (2) LAYERS OF FLOOR SHEATHING OVER FRAMING
- P-9 7/8" MAX. RISER WITH 10" MIN. RUN. IF MORE THAN (3) RISERS, HANDRAIL REQUIRED PER IRC, SECTION R311.8. SEE DIV. 01002.1 SHEET A-1
- P-10 18"x24" CRAWL SPACE ACCESS. INSULATE AND WEATHER STRIP. SEE DIV. 01002.1 SHEET A-1
- P-11 22"x30" ATTIC SPACE ACCESS W/ 30" HEAD CLEARANCE. INSULATE AND WEATHER STRIP. SEE DIV. 01002.2 SHEET A-1
- P-12 FLOOR MATERIAL BREAK LINE
- P-13 WALL LINE ABOVE
- P-14 WALL LINE BELOW
- P-15 FIREPLACE ASSEMBLY NOTES:
  - A. DIRECT VENT GAS FIREPLACES MUST BE LISTED, LABELED, INSTALLED PER MFG. SPECIFICATIONS, SHALL CONFORM TO IRC REQUIREMENTS. SEE DIV. 01002.12 SHEET A-1
  - B. ZERO CLEARANCE FIREPLACES SHALL CONFORM TO IRC REQUIREMENTS. SEE DIV. 01002.12 SHT A-1
  - C. HEARTH SHALL CONFORM TO IRC REQUIREMENT SEE DIV. 01002.12
  - D. FIREBLOCK OPENINGS AROUND PENETRATIONS @ EACH FLOOR PER IRC, SECTION R1002.15.
  - E. FIREPLACE MUST COMPLY WITH UL 121 TESTING
- P-16 SEE SITE PLAN FOR EXTENT OF WALKS & DRIVEWAYS
- P-17 3" DIAMETER STEEL POST
- P-18 36" GUARDRAIL PER IRC, SECTION R312 & TABLE R301.5 CONTRACTOR TO VERIFY TO INSPECTOR THAT ALL GUARDS & RAILINGS ARE CAPABLE OF RESISTING 200lb LOAD ON TOP RAIL ACTING IN ANY DIRECTION SEE DETAIL 8/D1.
- P-19 15" VENT FOR MECHANICAL. 1" CLEARANCE ALL SIDES PER IRC, SECTION R302.11. SEE DIV. 15 SHEET A-1
- P-20 PLANT SHELF
- P-21 UPPER AND LOWER LINEN CABINETS
- P-22 SOFFIT AREA
- P-23 INTEGRATED MAKE UP AIR
- P-24 2x6 STUDS W/ R-21 INSULATION MIN.

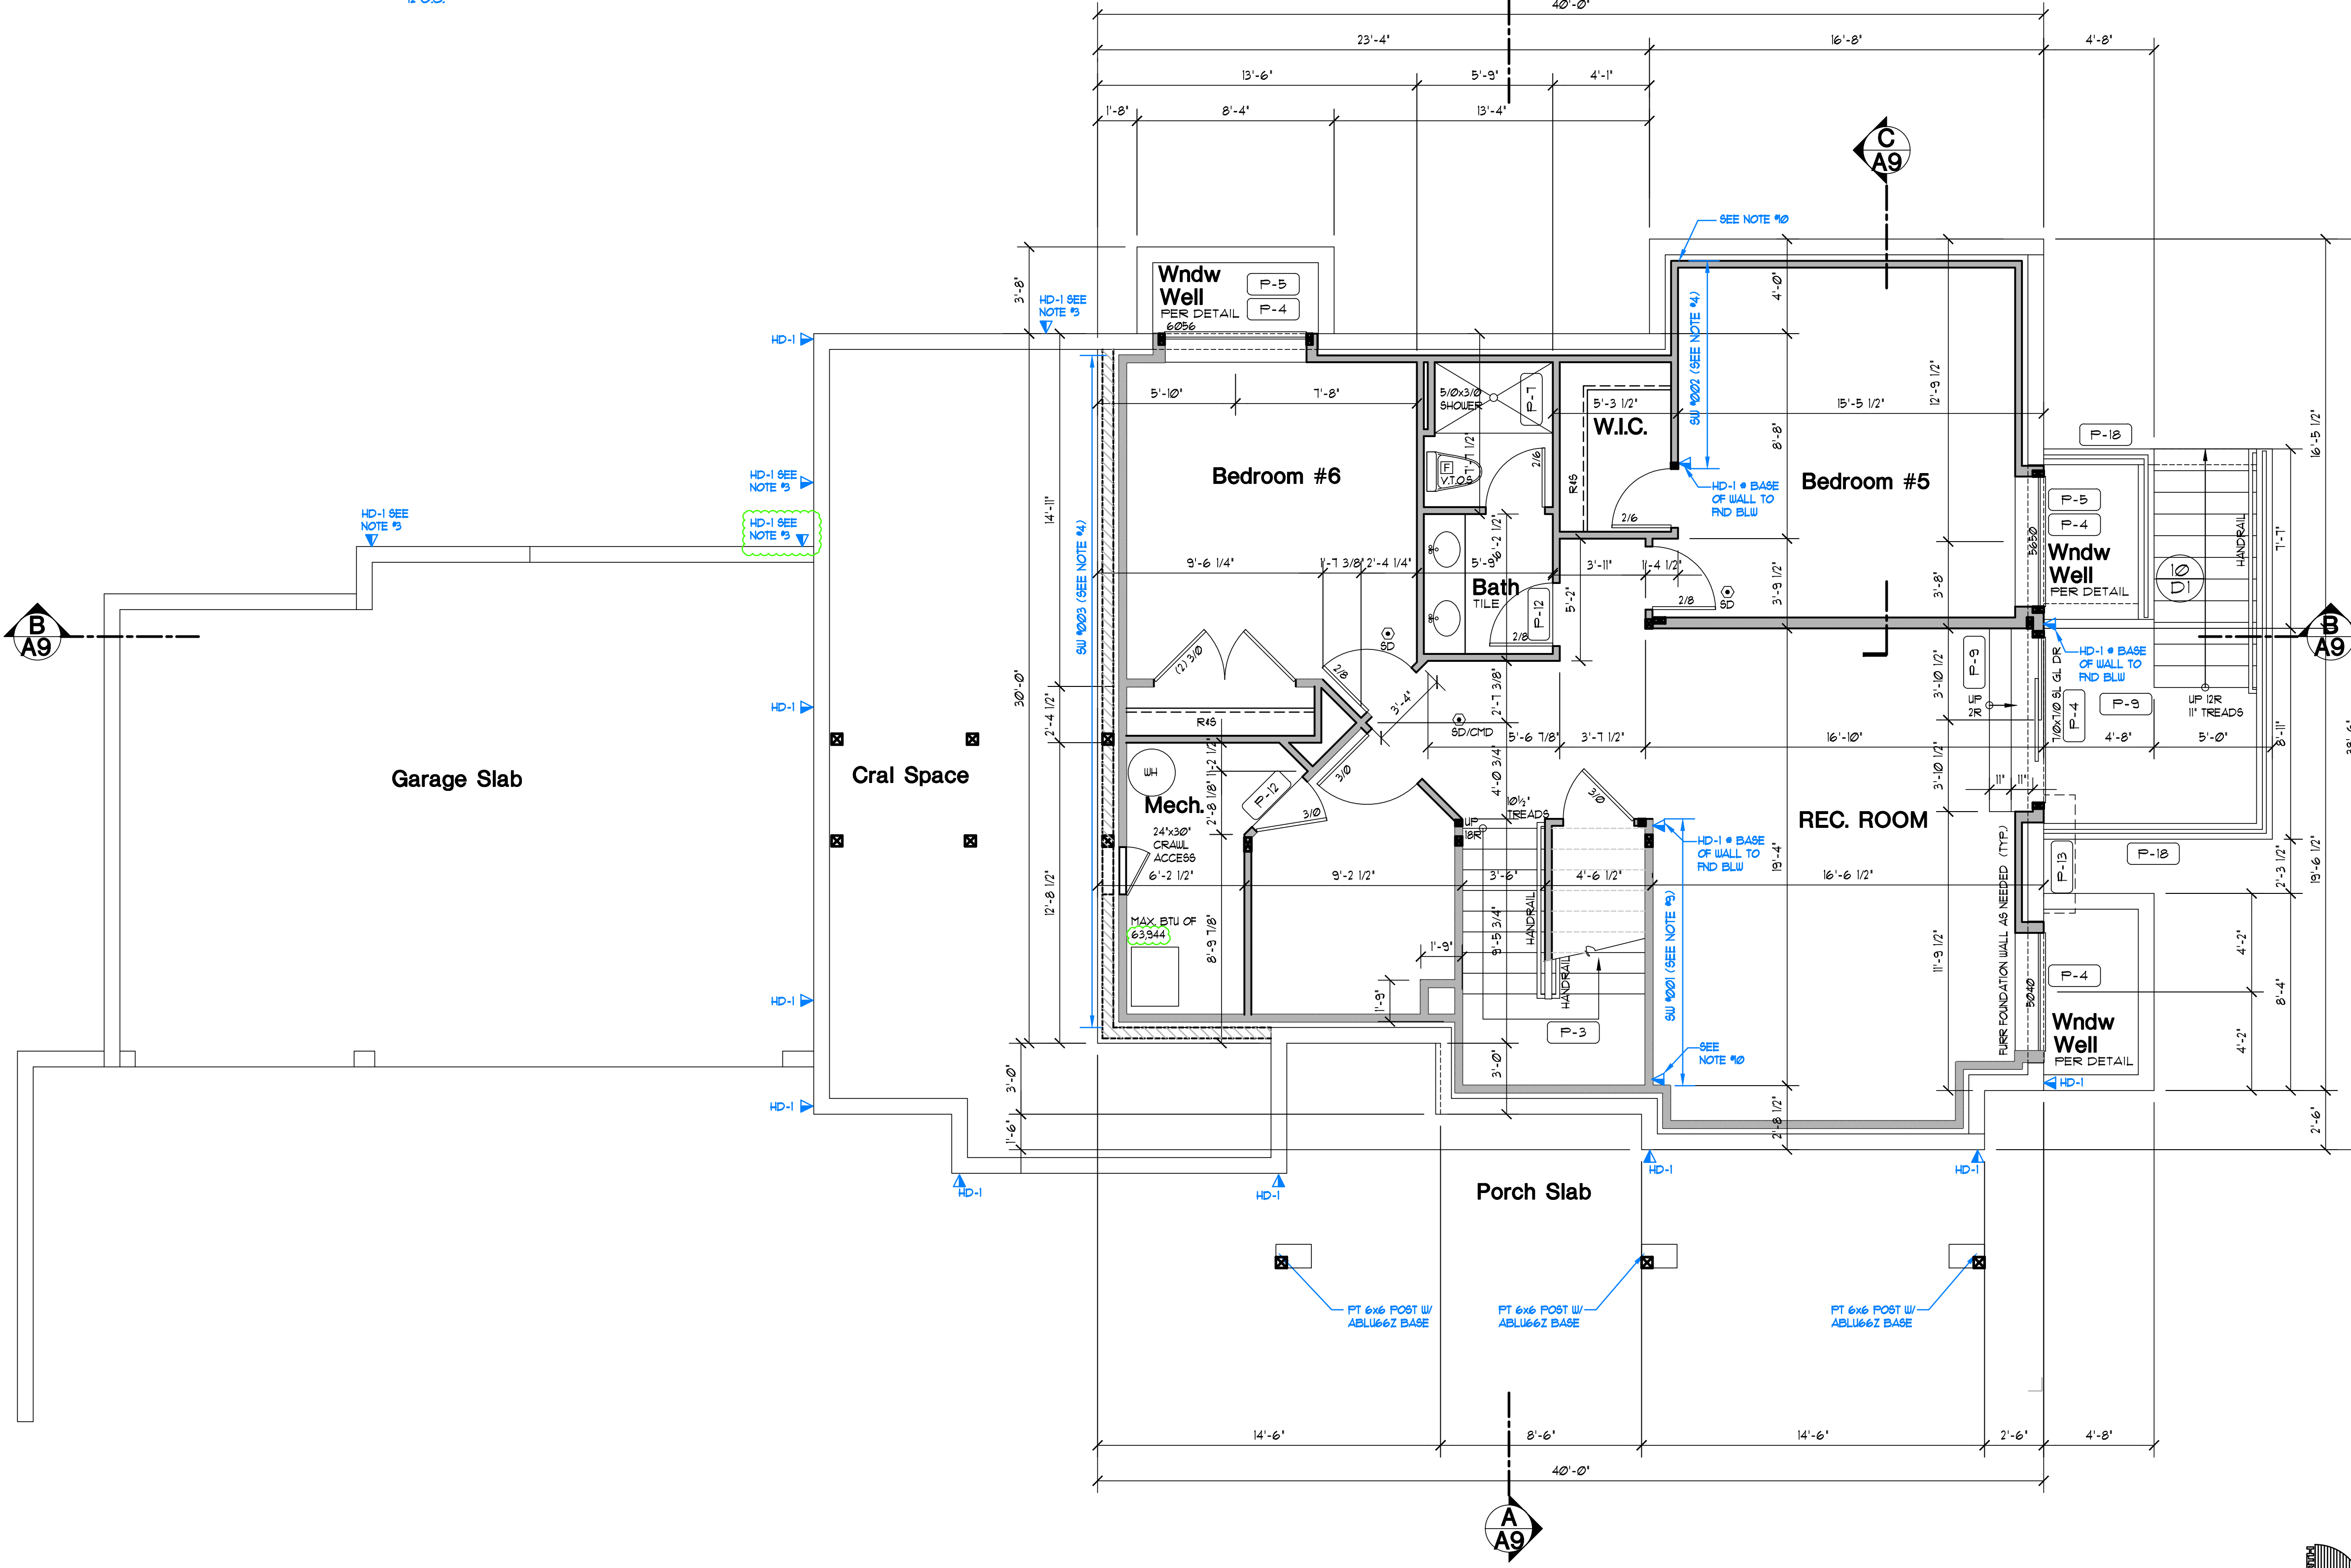

**LOWER FLOOR PLAN**  
Scale 1/4"=1'-0"

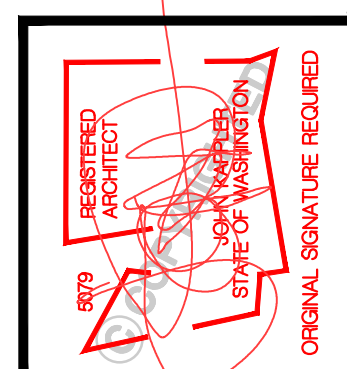

Date	By	Description
4/30/21	SM	PERMIT SET
07/22/21	SM	JURISDICTIONAL COMMENTS

Permit #2105-176  
**Pratt Plat**  
Lot 3  
7931 SE 72nd PL  
Mercer Island, WA 98040  
THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
Forward Thinking Design Solutions For Your Environment  
14311 SE 16th St  
Bellevue, WA 98007  
1-800-888-4517  
www.kapichonplanning.com

Reviewed  
Kolke Consulting Group, Inc.  
C. Kolke  
07/30/2021

TITLE	NO.
JOB NO.:	19036.21
STARTING NO.:	19036.05

SHEET  
**A2.1**



**STRUCTURAL FRAMING NOTES**


- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x DBL TOP PLATE BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN). PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 1/2"x0.131" NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 1/2"x0.131" NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH)
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN AT HD'S
- 4) PROVIDE 2" OSB OR 3/4" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON S020)
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 1/2"x0.131" NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 1/2"x0.131" NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE @ HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x @ HD
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 2" OSB OR 3/4" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE S020)
- 10) FASTEN FT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/2" x 2 1/2" LONG TAPLON SCREWS @ 6" O.C. (18 TOTAL) SEE DETAIL 19/SD.02 FOR MORE INFO.
- 11) PROVIDE M8TC66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSSES)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED) FASTEN SHEATHING TO OSB RIM W/ 2 1/2"x0.131" NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE @ HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**GENERAL FRAMING NOTES**

1. SEE TYPICAL MATERIALS LIST ON SECTION SHEET
2. SEE SHEET A-1 FOR ALL GENERAL NOTES AND FOR ALL REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.
3. TRUSS DESIGN BY MFG. TRUSS PLAN SHOWN IS FOR GENERAL LAYOUT ONLY. SEE DIV. 02000 SHEET A-1 - TRUSS LOADING. SEE DIV. 02000A SHEET A-1 - TRUSS SPAN PER FLOOR PLANS - TRUSS TYPE PER ROOF FRAMING PLAN
4. ROOF FRAMING SPACING, 24" o.c. UNO.
5. ROOF PITCH- EXTERIOR PER ELEVATION INTERIOR PER SECTION.
6. RAFTER TAIL 2x4. VERIFY.
7. ROOF TAIL AND RAKE OVERHANG PER ROOF PLAN.
8. ALL HEADERS ARE 4x10 DF #2 UNO. (B) PROVIDE (1) TRIMMER STUD UP TO 4'-0" SPAN AND (2) TRIMMER STUDS OVER 4'-0" UNO. SEE DIV. 06100 SHEET A-1
9. STUD NOTCHING AND BORING PER I.R.C. SECT. R602.6 - BEARING OR EXTERIOR WALL MAXIMUM NOTCH 25% BORING 40% - 60% MAXIMUM BORING IF DOUBLED WITH NOT MORE THAN (2) SUCCESSIVE STUDS BORED. NON-BEARING MAXIMUM NOTCH 40% BORING 60% - HOLES NO CLOSER THAN 5/8" TO FACE OF STUD.

**FRAMING PLAN KEYNOTES**


- F-1 BACK FRAMING AND SOFFIT AREA AS REQUIRED TO ALLOW FOR HVAC DUCTING. SEE DIV. 05 SHEET A-1.
- F-2 RAKED PONY WALL ON TOP OF LOWER ROOF FRAMING MEMBERS SUPPORTING UPPER ROOF FRAMING MEMBERS.
- F-3 ALIGN EDGE OF JOIST WITH FACE OF WALL
- F-4 ALIGN INSIDE FACE OF BEAM WITH OUTSIDE FACE OF WALL
- F-5 UPSET - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOIST AND TOP OF BEAM EXTENDS UP ABOVE JOISTS
- F-6 TOP OF BEAM IS FLUSH WITH BOTTOM OF JOIST WITH NO TOP PLATE. CUT ADJACENT FRAMING MEMBERS INTO BEAM FOR ADEQUATE SUPPORT.
- F-7 ATTIC SPACE VENT SEE CALCULATION SEE DIV. 02002.3.B SHEET A-1
- F-8 FLOOR JOIST - SEE SCHEDULE DWG. SEE DIV. 06100 SHEET A-1
- F-9 SEE ELEVATIONS AND SECTIONS FOR PLATE HEIGHT
- F-10 PRESSURE BLOCKING SEE DIV. 06100 SHEET A-1
- F-11 FLUSH - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOISTS
- F-12 TOP OF BEAM FLUSH W/ TOP OF JOIST AND BEAM EXTENDS DOWN BELOW JOISTS
- F-13 TOP OF BEAM 3" BELOW TOP OF FLOOR TRUSS. FLOOR TRUSSES TO BE TOP CHORD BEARING.
- F-14 2x OVERFRAMING @ 24" O.C. PROVIDE 2x6 STRONGBACK FURLINS AND 2x KICKERS AT 6'-0" O.C. TO TRUSSES BELOW.
- F-15 2x6 CEILING JOISTS @ 24" O.C.

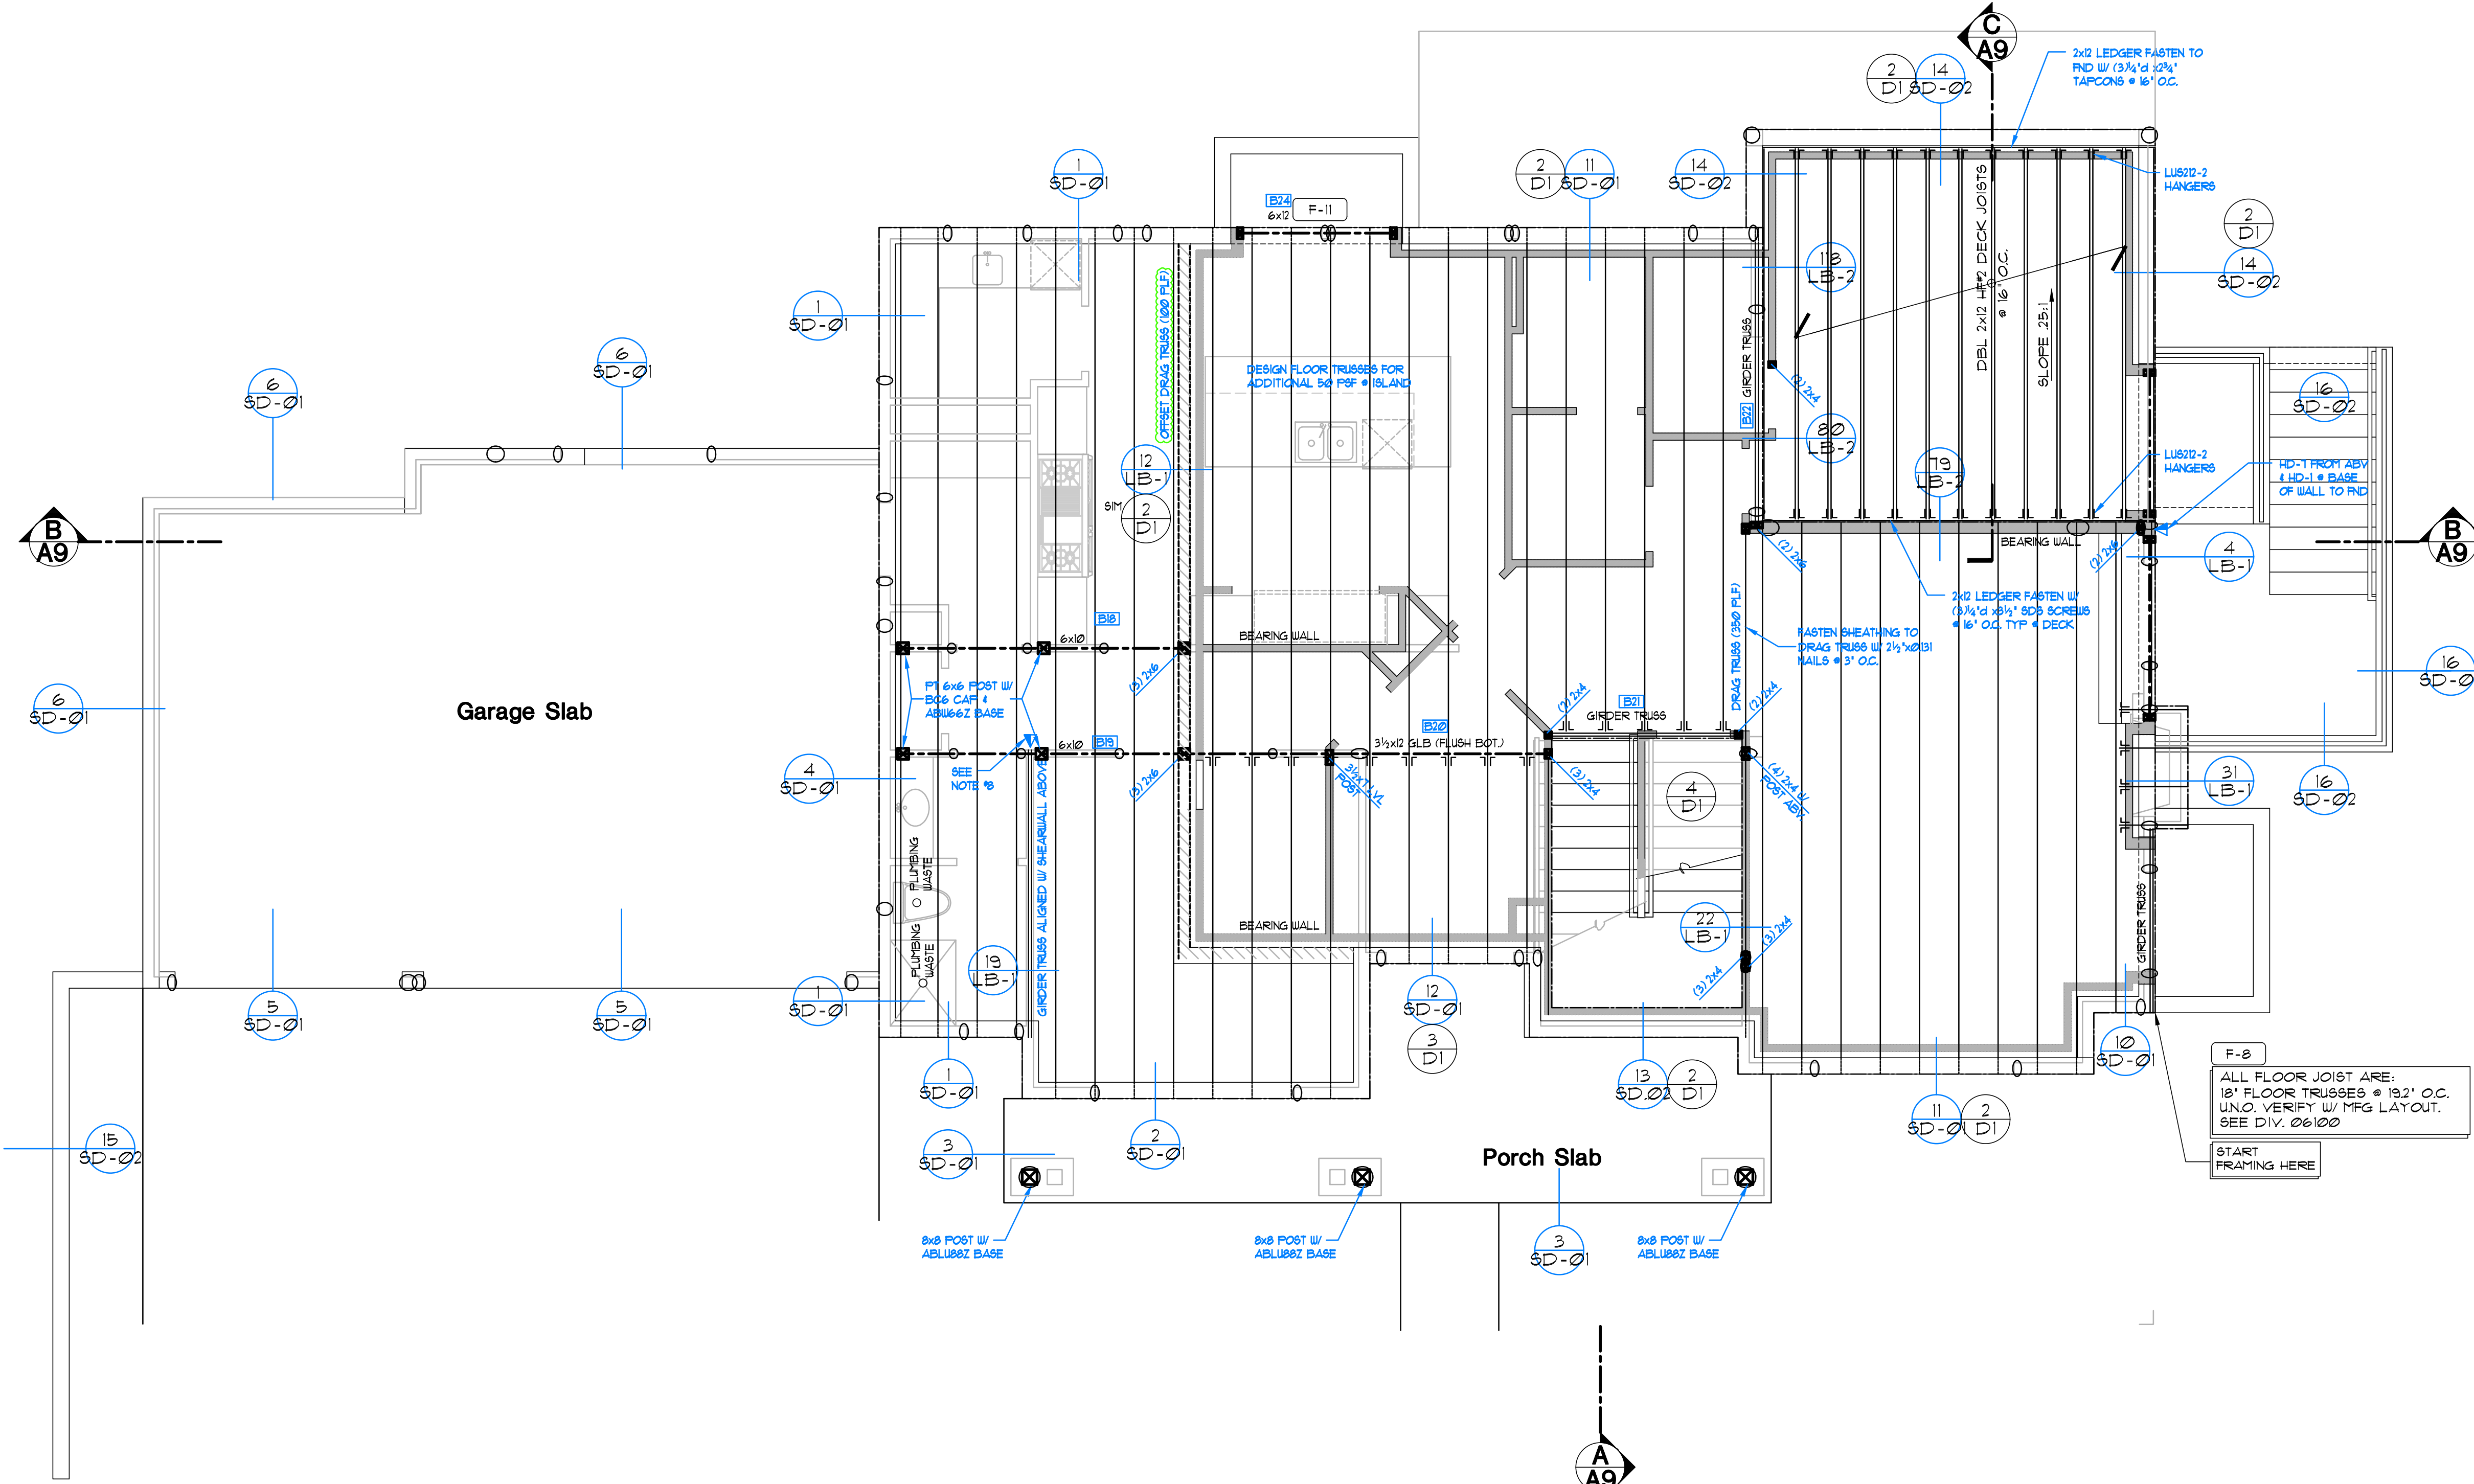

**MAIN FLOOR FRAMING PLAN**  
Scale 1/4"=1'-0"

**SYMBOLS & LEGEND**

- POINT LOADS FROM ABOVE
- POINT LOADS FROM ABOVE W/ LOADING
- POINT LOAD TRANSFERING DOWN
- POINT LOAD TRANSFERING DOWN W/ LOADING
- HANGER
- POINT LOAD TRANSFERED BY KICKER
- HOLD DOWN WITH SIZE DESIGNATION
- VERTICAL STRAP WITH SIZE DESIGNATION TO BE USED ON FLOOR BELOW
- HORIZONTAL STRAP WITH SIZE DESIGNATION
- INDICATES BEAM CALCULATION WITH INDEXED NUMBER
- ▬ WALL ABOVE
- ▬ WALL BELOW

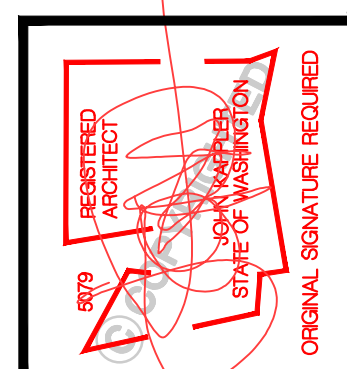

Date	By	Description
06/20/21	SM	PERMIT SET
07/14/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
Lot 2  
7921 SE 72nd PL  
Mercer Island, WA 98040  
THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

**ARCHITECTURAL INNOVATIONS, P.S.**  
Forward Thinking Design Solutions For Your Environment  
14311 SE 16th St  
Bellevue, WA 98007  
1-800-888-4517  
www.kapellechanceplans.com

**Reviewed**  
Koike Consulting Group, Inc.  
C. Koike  
07/30/2021

TITLE	
JOB NO.:	1903321
STARTING NO.:	1903305

SHEET  
**A2.2**

NOTE: UNLESS OTHERWISE NOTED, ENGINEERING AND CALCULATIONS ARE NOT PROVIDED IN THESE DRAWINGS.

**STRUCTURAL FRAMING NOTES**

- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x BLOCKING BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN). PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 #2@13" NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 #2@13" NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH).
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN AT HD-5.
- 4) PROVIDE 2" OSB OR 3" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON S020).
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2@13" NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN). FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2@13" NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE + HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x @ HD
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 2" OSB OR 3" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE S020)
- 10) FASTEN FT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/2" x 3" LONG TAPLON SCREWS @ 6" O.C. (18 TOTAL). SEE DETAIL 19/SD/02 FOR MORE INFO.
- 11) PROVIDE M5TC66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSSES)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED) FASTEN SHEATHING TO OSB RIM W/ 2 #2@13" NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE + HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD-5
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**SYMBOLS AND LEGEND**



- FAN - DIRECT VENT TO OUTSIDE
  - BATHROOMS/LAUNDRY 50 CFM MIN.
  - KITCHEN EXHAUST HOOD TO BE MIN. OF 100CFM. IF EXHAUST HOOD EXCEEDS 400 CFM MAKE UP AIR MUST BE PROVIDED PER SECTION M1023.6.
- WHOLE-HOUSE FAN TO RUN CONTINUOUS & CONFORM TO IRC, M1025.4. FAN SIZE PER PLAN. FAN RATE TO BE ADJUSTED BY A FACTOR OF 15 FOR A NON BALANCED NON DISTRIBUTED SYSTEM. FRESH AIR TO BE PROVIDED BY THE FORCED AIR SYSTEM DUCTS PER SECTION M1025.4.1. FAN TO HAVE A SONE RATING OF 10 OR LESS MEASURED AT 21 INCHES WATER GAUGE
- THERMOSTAT @ 50" ABOVE FLOOR
- 110V SMOKE ALARM PER IRC, R314 WITH BATTERY BACKUP INTERCONNECTED. USE A COMBINATION SMOKE/CARBON MONOXIDE ALARM WHEN NOTED MECHANICAL, PLUMBING, AND ELECTRICAL SYSTEM FOR UNITS. PER DIV. 15.16 SEE SHEET A1
- MECHANICAL, PLUMBING, AND ELECTRICAL SYSTEM FOR UNITS: PER DIV. 15.16 SEE SHEET A1
- FURN (FURN)
  - A. PROVIDE 6" DIAMETER FRESH AIR INTAKE FROM OUTSIDE TO RETURN AIR PLENUM AT FURNACE WITH MOTORIZED FLOW DAMPERS.
  - B. PROVIDE THERMAL EXPANSION TANK AT WATER HEATER.
  - C. STRAP WATER HEATER TO FRAMING TOP AND BOTTOM.
  - D. PROVIDE PRESSURE RELIEF LINE PLUMBED TO OUTSIDE.

**GENERAL PLAN NOTES**

1. SEE SHEET A-1 FOR ALL GENERAL NOTES AND REQUIREMENTS.
2. ENERGY AND AIR QUALITY INFORMATION SEE DIV. 11 SHEET A-1
3. SEE BUILDING ELEVATION FOR WINDOW OPERATION SEE DIV. 8 SHEET A-1
4. SEE TYP. MATERIALS LIST ON SECTION SHEET
5. SEE SHEET A-1 FOR ALL NOTES AND REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.

**FLOOR PLAN KEY NOTES**

- P-1 OCCUPANCY SEPARATION: APPLY (1) LAYER OF 5/8" G.W.B. TO GARAGE SIDE OF RESIDENCE, ATTIC SPACES, AND TO ALL BEAMS AND POSTS SUPPORTING A FLOOR-CEILING ASSEMBLY. APPLY (1) LAYER OF 5/8" TYPE 'X' G.W.B. TO GARAGE CEILING WHEN UNDER HABITABLE ROOMS. DUCTS THROUGH WALL OR CEILING COMMON TO HOUSE SHALL HAVE MINIMUM 26 GAUGE STEEL SEE DIV. 01022.6.A SHEET A-1
- P-2 1/2" MIN. SELF CLOSING SOLID WOOD CORE, HONEY-COMB CORE STEEL OR 20-MINUTE FIRE RATED DOOR SEE DIV. 01022.6.B SHEET A-1
- P-3 STAIR ASSEMBLY NOTES: PER IRC, SECTION R315 AND DETAIL 47/D
  - A. HEADROOM MIN. 6'-8". WIDTH MIN. 3'-0".
  - B. TREADS 10" MIN. DEPTH AND MIN. WIDTH OF 36" ABOVE HANDRAIL HEIGHT, RISERS 7 1/2" MAX. HT. TREAD NOSING TO BE MINIMUM 3/4" AND A MAXIMUM OF 1/4" ON STAIRS WITH SOLID RISERS.
  - C. HANDRAIL MIN. 34" TO MAX 38" ABOVE TREAD NOSING. HANDRAIL TYPE I CIRCULAR TO HAVE 1 1/4" MIN. TO 2" MAX. CROSS SECTION DIMENSION AND 1 1/2" MIN. CLEAR FROM WALL. RETURN RAIL ENDS. HANDRAILS SHALL BE STRONG ENOUGH TO RESIST A 200 POUND POINT LOAD IN ANY DIRECTION PER IRC, TABLE R301.5
  - D. INSTALL FIRE BLOCKING BETWEEN STRINGERS AT THE TOP AND BOTTOM OF EACH RUN PER IRC, SECTION R302.11
  - E. COVER USABLE SPACE UNDER STAIR W/ 1/2" G.W.B. PER IRC, SECTION R302.1
  - F. INTERMEDIATE BALUSTERS SHALL BE SPACED W/ LESS THAN 4" BETWEEN BALUSTERS.
  - G. PROVIDE STAIRWAY ILLUMINATION PER IRC, SECTION R303.6. SEE DIV. 01022.1 SHEET A-1
- P-4 SAFETY GLAZING PER IRC, SECTION R308
  - A. WINDOWS WITHIN 18" OF FLOOR
  - B. WINDOWS WITHIN A 24" ARC OF DOORS
  - C. WINDOWS AT TUBS AND SHOWERS
  - D. GLAZING IN DOORS
  - E. LESS THAN 60" HORIZ. FROM THE BOT. STAIR TREAD NOSING, 4 BOT. EDGE OF GLAZING IS LESS THAN 36" ABV. LANDING/WALKING SURFACE SEE DIV. 08800 SHEET A-1
- P-5 EGRESS WINDOW PER IRC, SECTION R310 SEE DIV. 08600 SHEET A-1
- P-6 IGNITERS FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN. ABOVE TOP OF SLAB. SEE DIV. 15 SHEET A-1
- P-7 COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NON-ABSORBENT MATERIAL TO 12" ABOVE DRAIN INLETS. PER IRC, SECTION 3012. SEE DIV. 09250 SHEET A-1
- P-8 (2) LAYERS OF FLOOR SHEATHING OVER FRAMING
- P-9 3/4" MAX. RISER WITH 10" MIN. RUN. IF MORE THAN (3) RISERS, HANDRAIL REQUIRED PER IRC, SECTION R311.8. SEE DIV. 01022.1 SHEET A-1
- P-10 18"x24" CRAWL SPACE ACCESS. INSULATE AND WEATHER STRIP. SEE DIV. 01022.1 SHEET A-1
- P-11 22"x30" ATTIC SPACE ACCESS W/ 30" HEAD CLEARANCE. INSULATE AND WEATHER STRIP. SEE DIV. 01022.2 SHEET A-1
- P-12 FLOOR MATERIAL BREAK LINE
- P-13 WALL LINE ABOVE
- P-14 WALL LINE BELOW
- P-15 FIREPLACE ASSEMBLY NOTES:
  - A. DIRECT VENT GAS FIREPLACES, MUST BE LISTED, LABELED, INSTALLED PER MFG. SPECIFICATIONS, SHALL CONFORM TO IRC REQUIREMENTS. SEE DIV. 01022.12 SHEET A-1
  - B. ZERO CLEARANCE FIREPLACES SHALL CONFORM TO IRC REQUIREMENTS. SEE DIV. 01022.12 SHEET A-1
  - C. HEARTH SHALL CONFORM TO IRC REQUIREMENT SEE DIV. 01022.12
  - D. FIREBLOCK OPENINGS AROUND PENETRATIONS @ EACH FLOOR PER IRC, SECTION 10203.15
  - E. FIREPLACE MUST COMPLY WITH UL 121 TESTING
- P-16 SEE SITE PLAN FOR EXTENT OF WALKS & DRIVEWAYS
- P-17 3" DIAMETER STEEL POST
- P-18 36" GUARDRAIL PER IRC, SECTION R312 & TABLE R301.5 CONTRACTOR TO VERIFY TO INSPECTOR THAT ALL GUARDS & RAILINGS ARE CAPABLE OF RESISTING 200LB LOAD ON TOP RAIL ACTING IN ANY DIRECTION SEE DETAIL 8/D1.
- P-19 15" VENT FOR MECHANICAL. 1" CLEARANCE ALL SIDES PER IRC, SECTION R302.11. SEE DIV. 15 SHEET A-1
- P-20 PLANT SHELF
- P-21 UPPER AND LOWER LINEN CABINETS
- P-22 SOFFIT AREA
- P-23 INTEGRATED MAKE UP AIR
- P-24 2x6 STUDS W/ R-21 INSULATION MIN.

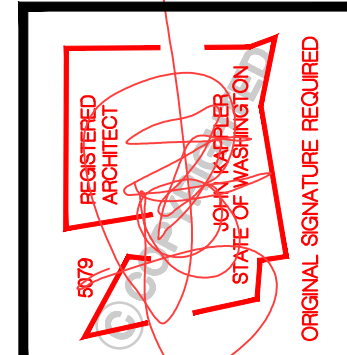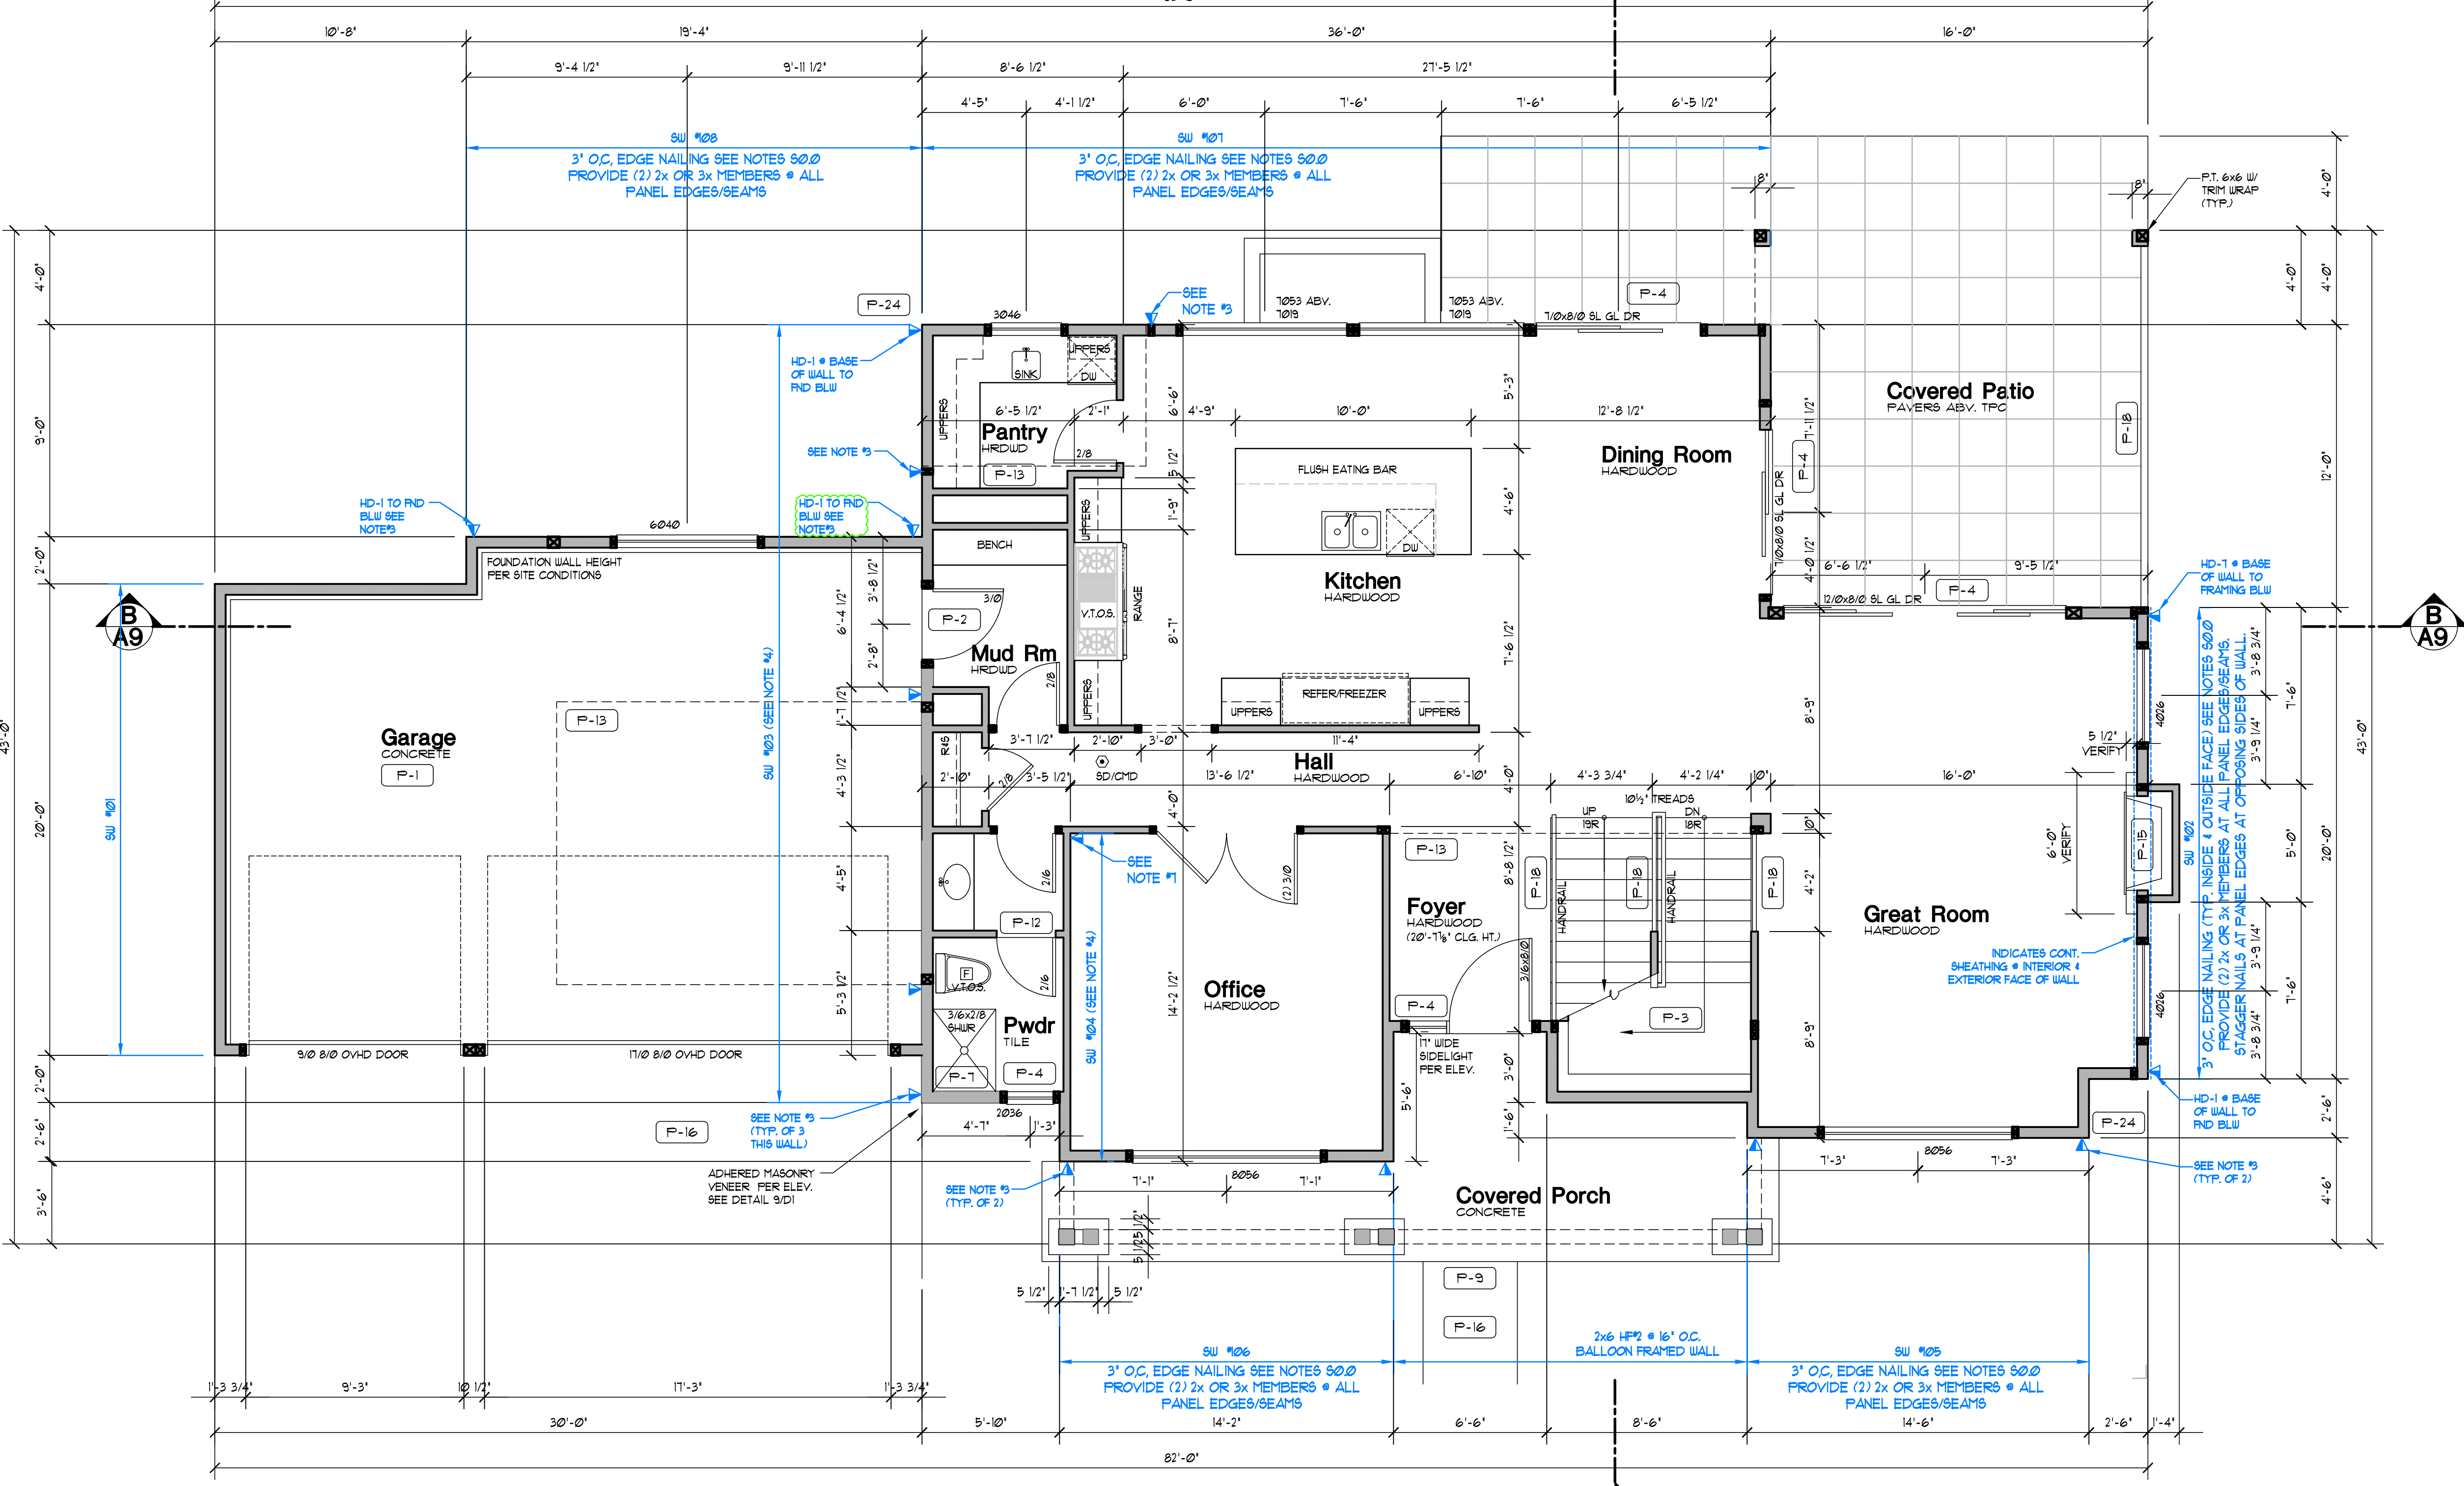

Date	By	Description
06/20/21	SM	PERMIT SET
07/22/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 16th St  
 Bellevue, WA 98007  
 1-800-888-4517  
[www.kspdesign.com](http://www.kspdesign.com)

Reviewed  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE	JOB NO.	STARTING NO.
	1903521	1903505

SHEET  
**A3**

**MAIN FLOOR PLAN**  
 Scale 1/4"=1'-0"

**SQUARE FOOTAGE**

MAIN FLOOR	1558 SF
UPPER FLOOR	1793 SF
LOWER FLOOR	1260 SF
<b>TOTAL</b>	<b>4611 SF</b>
GARAGE	639 SF
PORCH/PATIO	224/259 SF

**STRUCTURAL FRAMING NOTES**


- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x BLOCKING BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN) PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 3/8x131" NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 3/8x131" NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH)
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN AT HD'S
- 4) PROVIDE 3/4" OSB OR 5/8" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON 8020)
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 3/8x131" NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 3/8x131" NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE 4 HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x @ HD
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 3/4" OSB OR 5/8" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE 8020)
- 10) FASTEN FT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/2" x 2 3/8" LONG TAPCON SCREWS @ 6" O.C. (18 TOTAL) SEE DETAIL 19/SD/02 FOR MORE INFO.
- 11) PROVIDE M8C66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSSES)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED) FASTEN SHEATHING TO OSB RIM W/ 2 3/8x131" NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE 4 HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**GENERAL FRAMING NOTES**

1. SEE TYPICAL MATERIALS LIST ON SECTION SHEET
2. SEE SHEET A-1 FOR ALL GENERAL NOTES AND FOR ALL REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.
3. TRUSS DESIGN BY MFG. TRUSS PLAN SHOWN IS FOR GENERAL LAYOUT ONLY. SEE DIV. 02000 SHEET A-1 - TRUSS LOADING. SEE DIV. 02000 SHEET A-1 - TRUSS SPAN PER FLOOR PLANS - TRUSS TYPE PER ROOF FRAMING PLAN
4. ROOF FRAMING SPACING, 24" o.c. UNO.
5. ROOF PITCH - EXTERIOR PER ELEVATION INTERIOR PER SECTION.
6. RAFTER TAIL 2x4. VERIFY.
7. ROOF TAIL AND RAKE OVERHANG PER ROOF PLAN.
8. ALL HEADERS ARE 4x10 DF #2 UNO. [B] PROVIDE (1) TRIMMER STUD UP TO 4'-0" SPAN AND (2) TRIMMER STUDS OVER 4'-0" UNO. SEE DIV. 06100 SHEET A-1
9. STUD NOTCHING AND BORING PER I.R.C. SECT. R602.6 BORING 40% - 60% MAXIMUM BORING IF DOUBLED WITH NOT MORE THAN (2) SUCCESSIVE STUDS BORED. NON-BEARING MAXIMUM NOTCH 40% BORING 60%. HOLES NO CLOSER THAN 5/8" TO FACE OF STUD.

**FRAMING PLAN KEYNOTES**

- F-1 BACK FRAMING AND SOFFIT AREA AS REQUIRED TO ALLOW FOR HVAC DUCTING. SEE DIV. 05 SHEET A-1
- F-2 RAKED PONY WALL ON TOP OF LOWER ROOF FRAMING MEMBERS SUPPORTING UPPER ROOF FRAMING MEMBERS.
- F-3 ALIGN EDGE OF JOIST WITH FACE OF WALL
- F-4 ALIGN INSIDE FACE OF BEAM WITH OUTSIDE FACE OF WALL
- F-5 UPSET - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOIST AND TOP OF BEAM EXTENDS UP ABOVE JOISTS
- F-6 TOP OF BEAM IS FLUSH WITH BOTTOM OF JOIST WITH NO TOP PLATE. CUT ADJACENT FRAMING MEMBERS INTO BEAM FOR ADEQUATE SUPPORT.
- F-7 ATTIC SPACE VENT SEE CALCULATION SEE DIV. 02023.B SHEET A-1
- F-8 FLOOR JOIST - SEE SCHEDULE DWG. SEE DIV. 06100 SHEET A-1
- F-9 SEE ELEVATIONS AND SECTIONS FOR PLATE HEIGHT
- F-10 PRESSURE BLOCKING SEE DIV. 06100 SHEET A-1
- F-11 FLUSH - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOISTS
- F-12 TOP OF BEAM FLUSH W/ TOP OF JOIST AND BEAM EXTENDS DOWN BELOW JOISTS
- F-13 TOP OF BEAM 3" BELOW TOP OF FLOOR TRUSS. FLOOR TRUSSES TO BE TOP CHORD BEARING.
- F-14 2x OVERFRAMING @ 24" O.C. PROVIDE 2x6 STRONGBACK FURLINS AND 2x KICKERS AT 6'-0" O.C. TO TRUSSES BELOW.
- F-15 2x6 CEILING JOISTS @ 24" O.C.

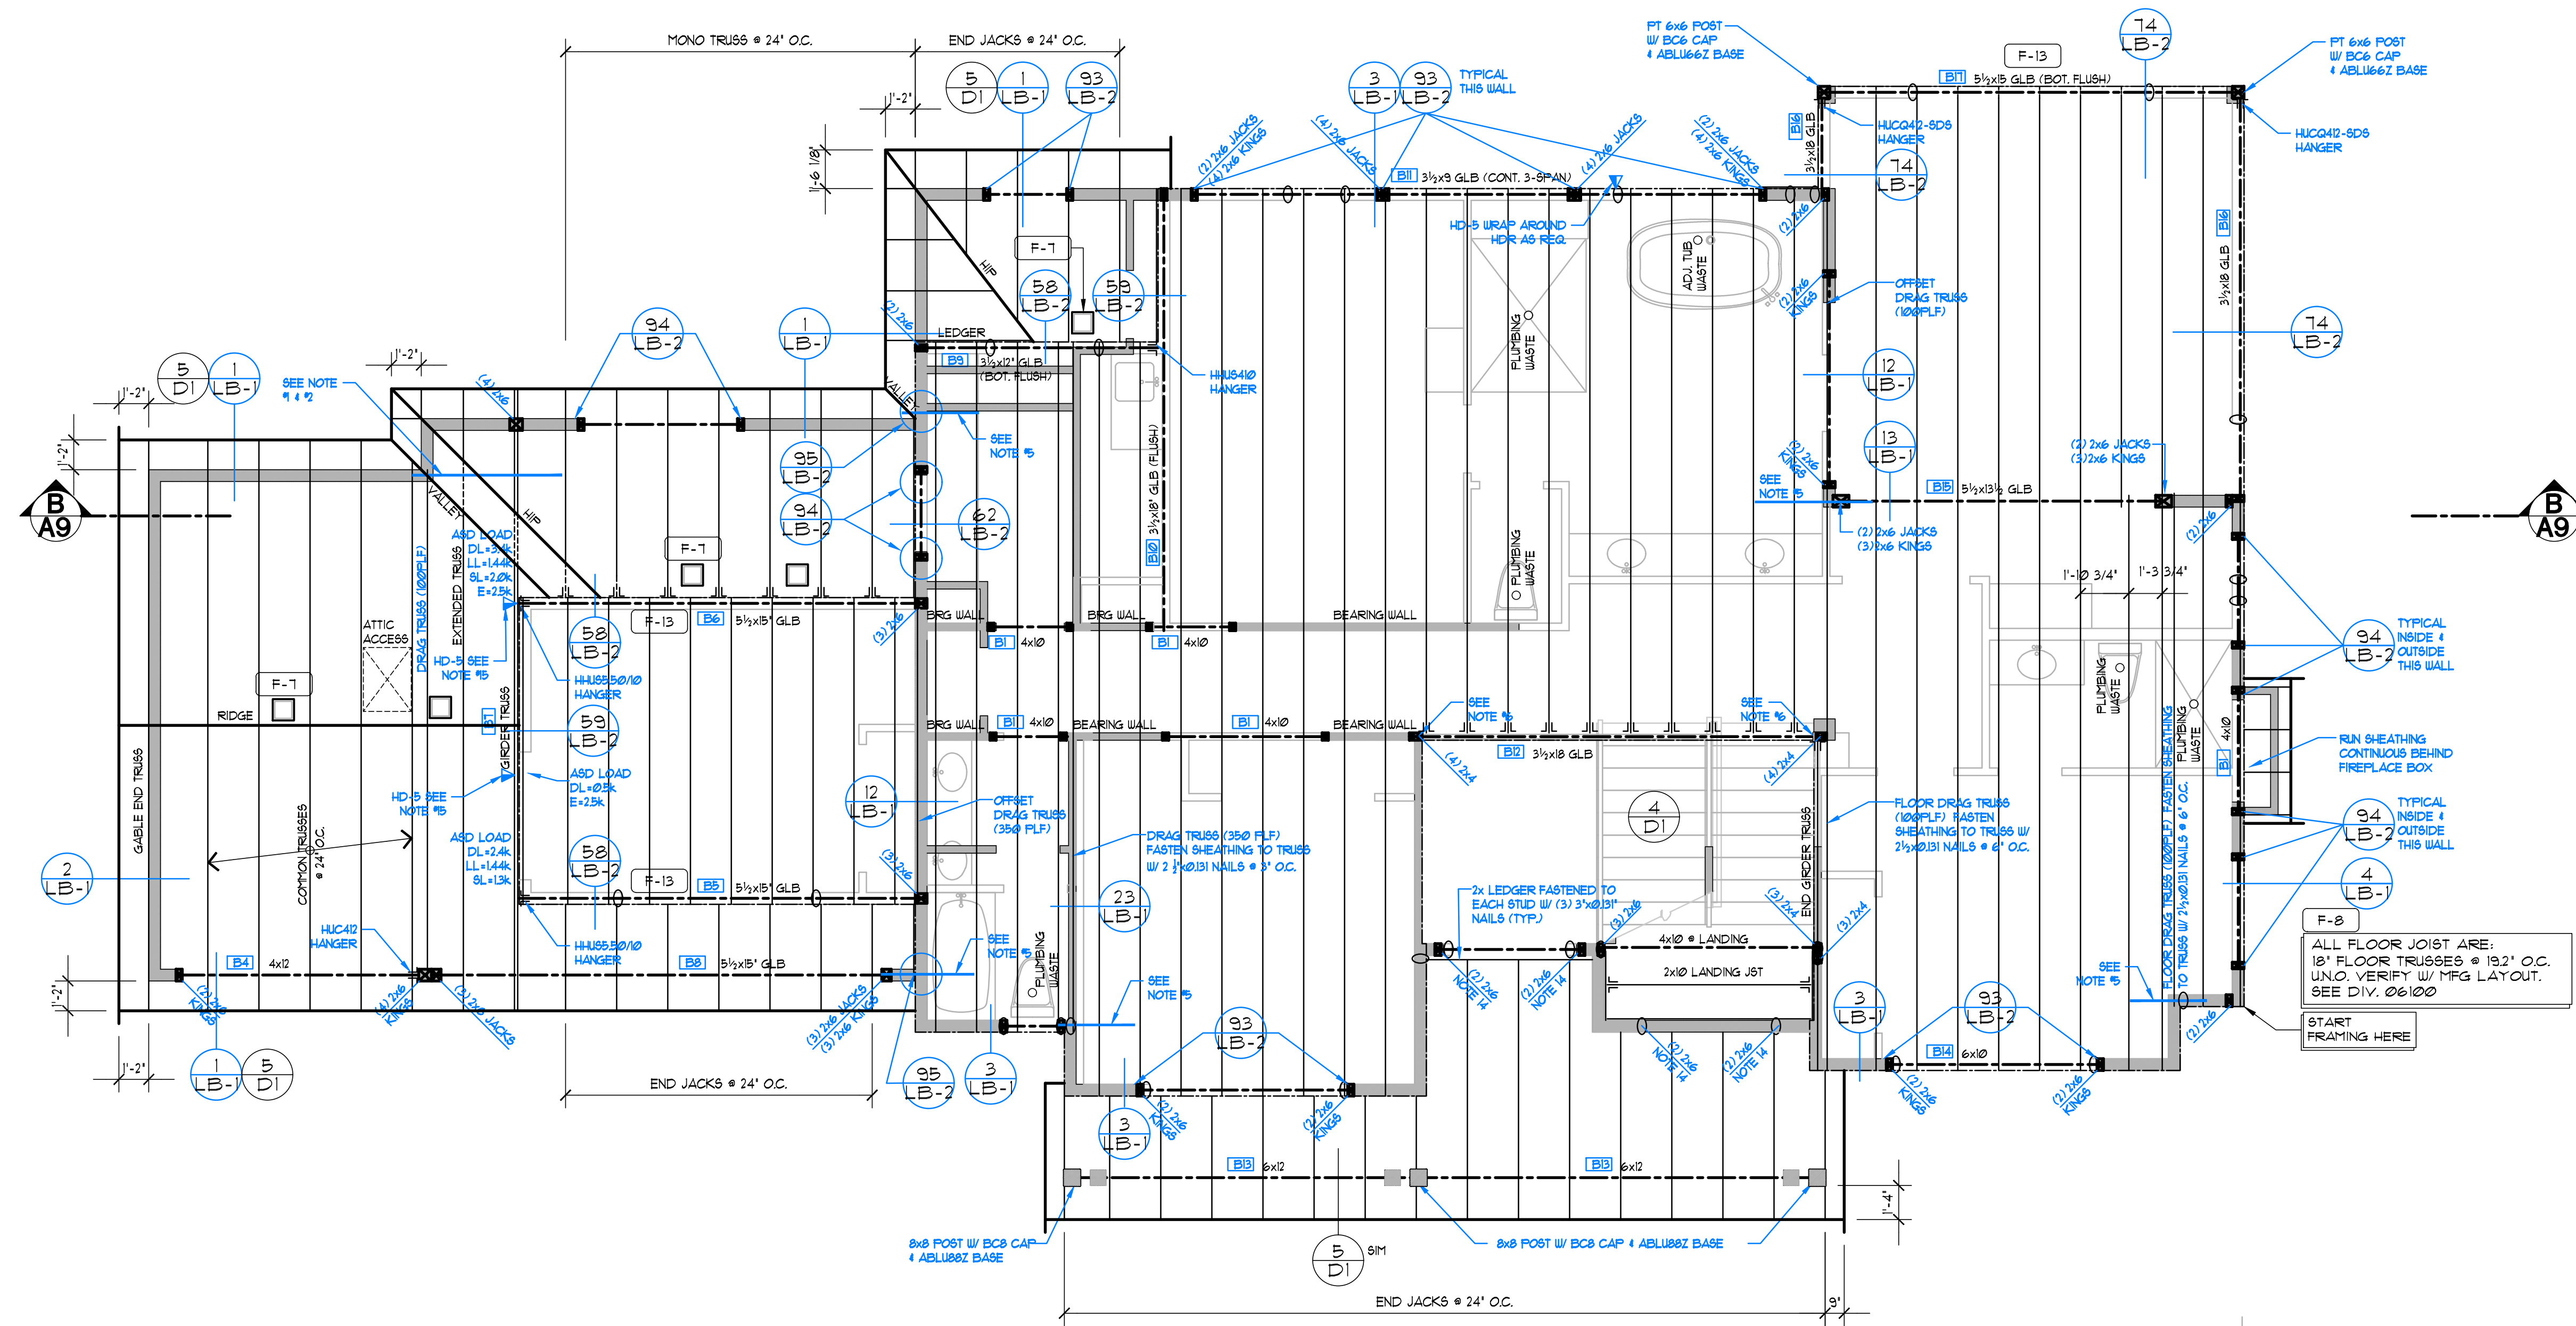


**UPPER FLOOR/LOWER ROOF FRAMING PLAN**

Scale 1/4"=1'-0"

**SYMBOLS & LEGEND**

- POINT LOADS FROM ABOVE
- POINT LOADS FROM ABOVE W/ LOADING
- POINT LOAD TRANSFERING DOWN
- POINT LOAD TRANSFERING DOWN W/ LOADING
- HANGER
- POINT LOAD TRANSFERED BY KICKER
- HOLD DOWN WITH SIZE DESIGNATION
- VERTICAL STRAP WITH SIZE DESIGNATION TO BE USED ON FLOOR BELOW
- HORIZONTAL STRAP WITH SIZE DESIGNATION
- INDICATES BEAM CALCULATION WITH INDEXED NUMBER
- ▬ WALL ABOVE ▬ WALL BELOW

NOTE: UNLESS OTHERWISE NOTED, ENGINEERING AND CALCULATIONS ARE NOT PROVIDED IN THESE DRAWINGS.

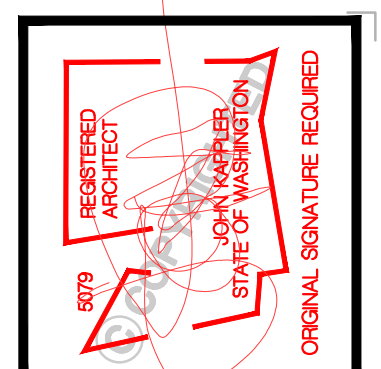

Date	By	Description
06/02/21	SM	PERMIT SET
07/14/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 16th St  
 Bellevue, WA 98007  
 1-800-888-4517  
 www.kadellchanceplans.com

**Reviewed**  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE	
UPPER FLOOR/LOWER ROOF FRAMING PLAN	
JOB NO.:	1903321
STARTING NO.:	1903305
SHEET	A4

**STRUCTURAL FRAMING NOTES**

- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x BLOCKING BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN) PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 #2x131' NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 #2x131' NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH)
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN AT HD'S
- 4) PROVIDE 2" OSB OR 3/4" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON 802.0)
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2x131' NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN) FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2x131' NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE 4 HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x @ HD
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 2" OSB OR 3/4" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE 802.0)
- 10) FASTEN FT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/2" x 3" LONG TAPCON SCREWS @ 6" O.C. (18 TOTAL) SEE DETAIL 19/SD.02 FOR MORE INFO.
- 11) PROVIDE M5TC66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSS)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED) FASTEN SHEATHING TO OSB RIM W/ 2 #2x131' NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE 4 HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**SYMBOLS AND LEGEND**


- FAN - DIRECT VENT TO OUTSIDE
  - BATHROOMS/LAUNDRY 50 CFM MIN.
  - KITCHEN EXHAUST HOOD TO BE MIN. OF 100CFM. IF EXHAUST HOOD EXCEEDS 400 CFM MAKE UP AIR MUST BE PROVIDED PER SECTION M1503.6.
- WHOLE-HOUSE FAN TO RUN CONTINUOUS 4 CONFORM TO IRC, M1505.4. FAN SIZE PER PLAN. FAN RATE TO BE ADJUSTED BY A FACTOR OF 15 FOR A NON BALANCED NON DISTRIBUTED SYSTEM. FRESH AIR TO BE PROVIDED BY THE FORCED AIR SYSTEM DUCTS PER SECTION M1505.4.1. FAN TO HAVE A SONE RATING OF 10 OR LESS MEASURED AT 0.1 INCHES WATER GAUGE
- THERMOSTAT @ 50" ABOVE FLOOR
- 110V SMOKE ALARM PER IRC, R314 WITH BATTERY BACKUP INTERCONNECTED. USE A COMBINATION SMOKE/CARBON MONOXIDE ALARM WHEN NOTED MECHANICAL, PLUMBING, AND ELECTRICAL SYSTEM FOR UNITS. PER DIV. 15.16 SEE SHEET A1
- Mechanical, Plumbing, and Electrical Symbols:
  - FURN (FURNACE)
  - WH (WATER HEATER)
- Other symbols: A (AIR INTAKE), B (THERMAL EXPANSION TANK), C (STRAP WATER HEATER TO FRAMING TOP AND BOTTOM), D (PRESSURE RELIEF LINE PLUMBED TO OUTSIDE).

**GENERAL PLAN NOTES**

1. SEE SHEET A-1 FOR ALL GENERAL NOTES AND REQUIREMENTS.
2. ENERGY AND AIR QUALITY INFORMATION SEE DIV. 11 SHEET A-1
3. SEE BUILDING ELEVATION FOR WINDOW OPERATION SEE DIV. 8 SHEET A-1
4. SEE TYP. MATERIALS LIST ON SECTION SHEET
5. SEE SHEET A-1 FOR ALL NOTES AND REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.


**FLOOR PLAN KEY NOTES**

- P-1 OCCUPANCY SEPARATION: APPLY (1) LAYER OF 5/8" G.W.B. TO GARAGE SIDE OF RESIDENCE, ATTIC SPACES, AND TO ALL BEAMS AND POSTS SUPPORTING A FLOOR-CEILING ASSEMBLY. APPLY (1) LAYER OF 5/8" TYPE 'X' G.W.B. TO GARAGE CEILING WHEN UNDER HABITABLE ROOMS. DUCTS THROUGH WALL OR CEILING COMMON TO HOUSE SHALL HAVE MINIMUM 26 GAUGE STEEL SEE DIV. 01002.6.A SHEET A-1
- P-2 1/2" MIN. SELF CLOSING SOLID WOOD CORE, HONEY-COMB CORE STEEL OR 20-MINUTE FIRE RATED DOOR SEE DIV. 01002.6.B SHEET A-1
- P-3 STAIR ASSEMBLY NOTES: PER IRC, SECTION R315 AND DETAIL 4/D
  - A. HEADROOM MIN. 6'-8". WIDTH MIN. 3'-0".
  - B. TREADS 10" MIN. DEPTH AND MIN. WIDTH OF 36" ABOVE HANDRAIL HEIGHT, RISERS 7 1/2" MAX. HT. TREAD NOSING TO BE MINIMUM 3/4" AND A MAXIMUM OF 1/4" ON STAIRS WITH SOLID RISERS.
  - C. HANDRAIL MIN. 34" TO MAX 38" ABOVE TREAD NOSING. HANDRAIL TYPE 1 CIRCULAR TO HAVE 1 1/4" MIN. TO 2" MAX. CROSS SECTION DIMENSION AND 1 1/2" MIN. CLEAR FROM WALL, RETURN RAIL ENDS. HANDRAILS SHALL BE STRONG ENOUGH TO RESIST A 200 POUND POINT LOAD IN ANY DIRECTION PER IRC, TABLE R301.5
  - D. INSTALL FIRE BLOCKING BETWEEN STRINGERS AT THE TOP AND BOTTOM OF EACH RUN PER IRC, SECTION R302.11
  - E. COVER USABLE SPACE UNDER STAIR W/ 1/2" G.W.B. PER IRC, SECTION R302.1.
  - F. INTERMEDIATE BALUSTERS SHALL BE SPACED W/ LESS THAN 4" BETWEEN BALUSTERS.
  - G. PROVIDE STAIRWAY ILLUMINATION PER IRC, SECTION R303.6. SEE DIV. 01002.1 SHEET A-1.
- P-4 SAFETY GLAZING PER IRC, SECTION R308
  - A. WINDOWS WITHIN 18" OF FLOOR
  - B. WINDOWS WITHIN A 24" ARC OF DOORS
  - C. WINDOWS AT TUBS AND SHOWERS
  - D. GLAZING IN DOORS
  - E. LESS THAN 60" HORIZ. FROM THE BOT. STAIR TREAD NOSING 4" BOT. EDGE OF GLAZING IS LESS THAN 36" ABV. LANDING/WALKING SURFACE SEE DIV. 08000 SHEET A-1
- P-5 EGRESS WINDOW PER IRC, SECTION R310 SEE DIV. 08000 SHEET A-1
- P-6 IGNITERS FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN. ABOVE TOP OF SLAB. SEE DIV. 15 SHEET A-1
- P-7 COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NON-ABSORBENT MATERIAL TO 12" ABOVE DRAIN INLETS. PER IRC, SECTION 3012. SEE DIV. 09250 SHEET A-1
- P-8 (2) LAYERS OF FLOOR SHEATHING OVER FRAMING
- P-9 3/4" MAX. RISER WITH 10" MIN. RUN. IF MORE THAN (3) RISERS, HANDRAIL REQUIRED PER IRC, SECTION R311.8. SEE DIV. 01002.1 SHEET A-1
- P-10 18"x24" CRAWL SPACE ACCESS. INSULATE AND WEATHER STRIP. SEE DIV. 01002.1 SHEET A-1
- P-11 22"x30" ATTIC SPACE ACCESS W/ 30" HEAD CLEARANCE. INSULATE AND WEATHER STRIP. SEE DIV. 01002.2 SHEET A-1
- P-12 FLOOR MATERIAL BREAK LINE
- P-13 WALL LINE ABOVE
- P-14 WALL LINE BELOW
- P-15 FIREPLACE ASSEMBLY NOTES:
  - A. DIRECT VENT GAS FIREPLACES MUST BE LISTED, LABELED, INSTALLED PER MFG. SPECIFICATIONS, SHALL CONFORM TO IRC REQUIREMENTS. SEE DIV. 01002.12 SHEET A-1
  - B. ZERO CLEARANCE FIREPLACES SHALL CONFORM TO IRC REQUIREMENTS. SEE DIV. 01002.12 SHEET A-1
  - C. HEARTH SHALL CONFORM TO IRC REQUIREMENT SEE DIV. 01002.12
  - D. FIREBLOCK OPENINGS AROUND PENETRATIONS @ EACH FLOOR PER IRC, SECTION R1003.15.
  - E. FIREPLACE MUST COMPLY WITH UL 127 TESTING SEE DETAIL 8/D1.
- P-16 SEE SITE PLAN FOR EXTENT OF WALKS & DRIVEWAYS
- P-17 3" DIAMETER STEEL POST
- P-18 36" GUARDRAIL PER IRC, SECTION R312 & TABLE R301.5 CONTRACTOR TO VERIFY TO INSPECTOR THAT ALL GUARDS & RAILINGS ARE CAPABLE OF RESISTING 200LB LOAD ON TOP RAIL ACTING IN ANY DIRECTION SEE DETAIL 8/D1.
- P-19 15" VENT FOR MECHANICAL. 1" CLEARANCE ALL SIDES PER IRC, SECTION R302.11 SEE DIV. 15 SHEET A-1
- P-20 PLANT SHELF
- P-21 UPPER AND LOWER LINEN CABINETS
- P-22 SOFFIT AREA
- P-23 INTEGRATED MAKE UP AIR
- P-24 2x6 STUDS W/ R-21 INSULATION MIN.

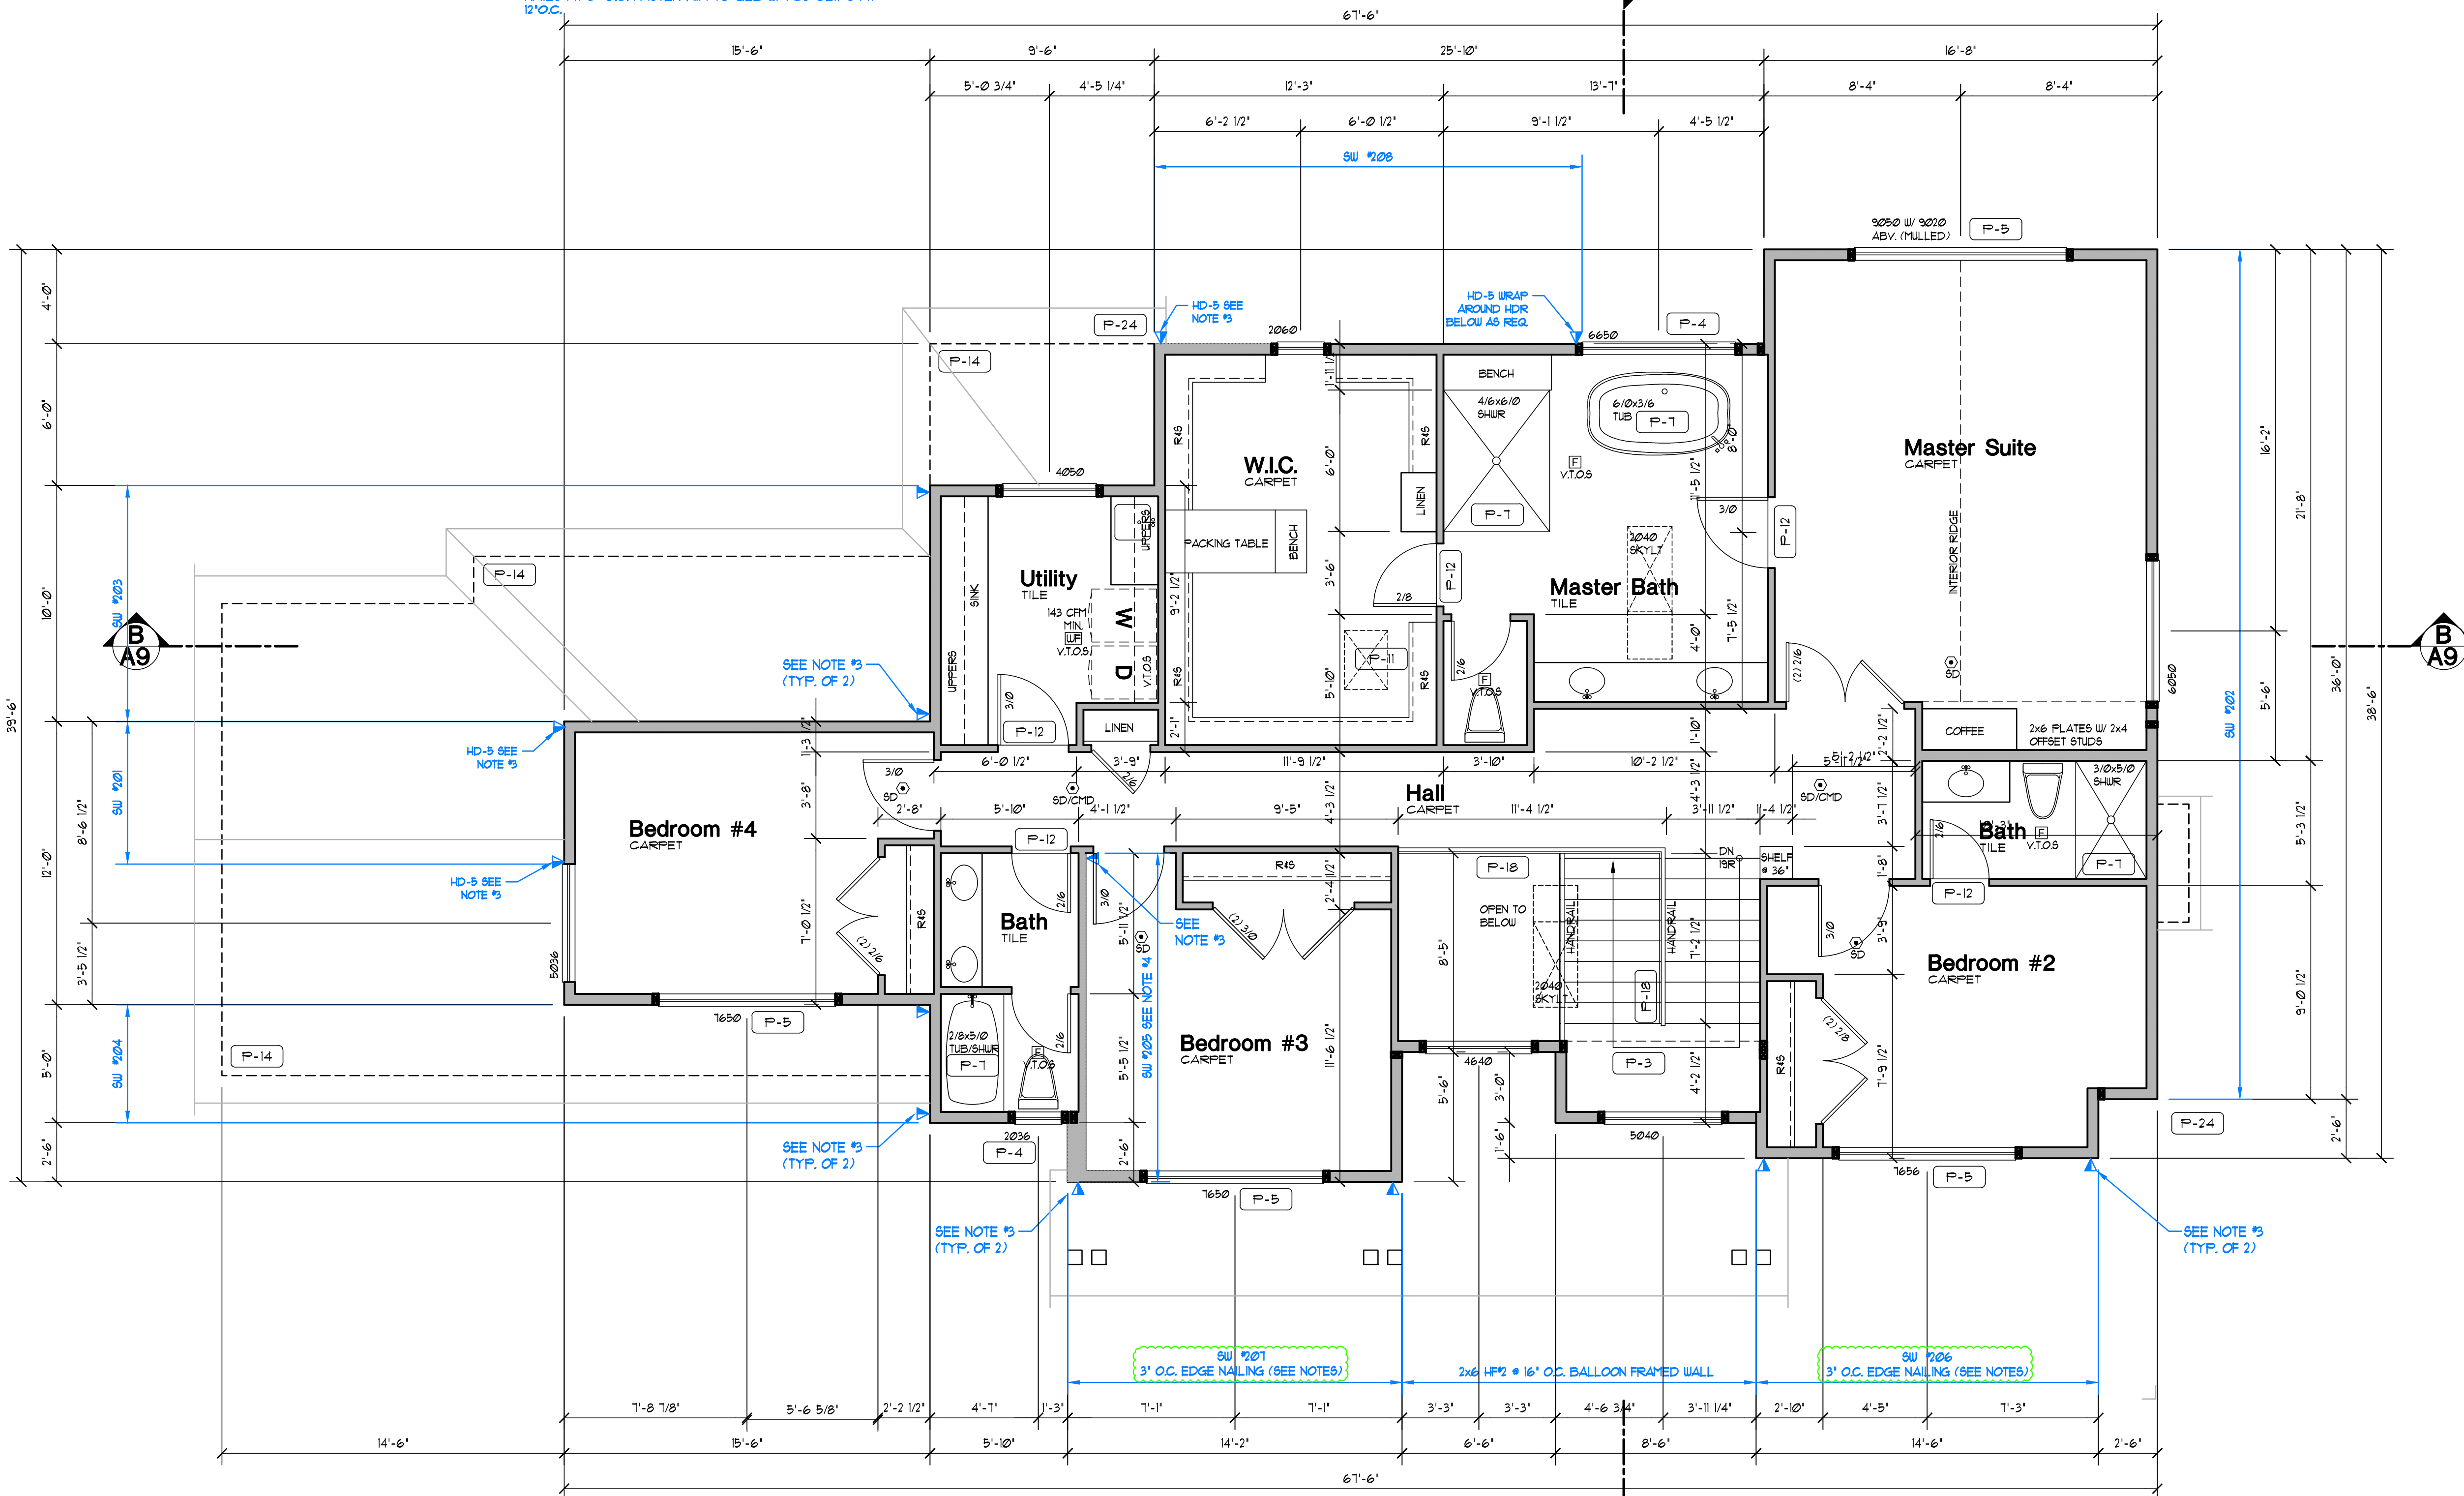

**UPPER FLOOR PLAN**

Scale 1/4"=1'-0"

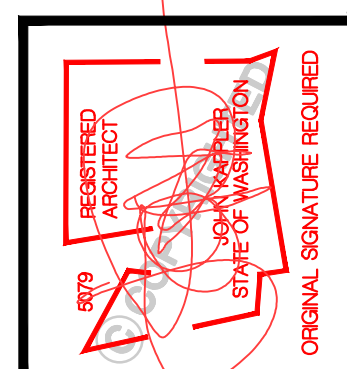

Date	By	Description
06/20/21	SM	PERMIT SET
07/22/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 16th St  
 Bellevue, WA 98007  
 1-800-888-4517  
 www.knapichomeplans.com

Reviewed  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE  
 JOB NO.: 1903521  
 STARTING NO.: 1903505

SHEET  
**A5**

**STRUCTURAL FRAMING NOTES**

- 1) PROVIDE SIMPSON C816 STRAP FROM DBL TOP PLATE (13' END LENGTH) TO UNDERSIDE OF 2x BLOCKING BETWEEN TRUSS BOTTOM CHORDS FOR (3) TRUSS BAYS (6'-0" MIN). PROVIDE 2x BLOCKING AT TOP CHORDS OF TRUSSES AND SHEATHING BETWEEN TOP CHORD AND BOTTOM CHORD BLOCKING FASTENED WITH 2 #2x0.131" NAILS AT 6" O.C. AT SHEATHING EDGES. FASTEN ROOF SHEATHING TO BLOCKING WITH 2 #2x0.131" NAILS AT 6" O.C.
- 2) PROVIDE SIMPSON C816 STRAP FROM DOUBLE TOP PLATE (13' END LENGTH) TO BOTTOM CHORD OF ROOF DRAG TRUSS (13' END LENGTH)
- 3) HD-5 FROM ABOVE PLUS HD-1 @ BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN AT HD'S (SEE NOTES ON 802.0)
- 4) PROVIDE 3/4" OSB OR 5/8" PLYWOOD FASTENED PER TYP. EXTERIOR WALL SHEATHING SPECIFICATIONS (SEE NOTES ON 802.0)
- 5) PROVIDE C816 STRAP FROM TOP OF DBL TOP PLATE (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN). FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2x0.131" NAILS @ 6" O.C.
- 6) PROVIDE C816 STRAP FROM BOTTOM OF FLUSH BOTTOM OF BEAM (13' MIN END LENGTH) TO BOTTOM OF FULL HT. TRUSS BLOCKING BETWEEN FLOOR TRUSSES (3'-0" MIN). FASTEN FLOOR SHEATHING TO BLOCKING W/ 2 #2x0.131" NAILS @ 6" O.C.
- 7) HD-5 FROM ABOVE 4 HD-1 @ BASE OF WALL TO FRAMING BELOW. PROVIDE (2) 2x @ HD
- 8) HD-1 FROM ABOVE WRAP END LENGTH AROUND FLUSH BOTTOM BEAM AS REQUIRED
- 9) PROVIDE 3/4" OSB OR 5/8" PLYWOOD FASTENED PER 3" O.C. EDGE NAILING SPECIFICATIONS (SEE NOTE 802.0)
- 10) FASTEN FT END SHEARWALL STUD TO FOUNDATION WALL W/ 1/4" x 3" LONG TAPLON SCREWS @ 6" O.C. (18 TOTAL). SEE DETAIL 19/SD.02 FOR MORE INFO.
- 11) PROVIDE M8TC66 STRAP FROM BOTTOM OF GLB TO BOTTOM OF DRAG TRUSS (NOT REQUIRED @ CONTINUOUS DRAG TRUSSES)
- 12) PROVIDE CONTINUOUS OSB RIM ABOVE GLB TO UNDERSIDE OF SHEATHING (TYP. OSB HVAC HOLES PERMITTED). FASTEN SHEATHING TO OSB RIM W/ 2 #2x0.131" NAILS AT 3" O.C. FASTEN RIM TO GLB W/ ASS CLIPS AT 12" O.C.
- 13) HD-5 FROM ABOVE 4 HD-1 AT BASE OF WALL TO FOUNDATION BELOW. PROVIDE (2) 2x MIN @ HD'S
- 14) BALLOON FRAME KING STUDS
- 15) HD-5 FROM ABOVE WRAP END LENGTH AROUND GIRDER TRUSS AS REQUIRED.

**GENERAL FRAMING NOTES**

1. SEE TYPICAL MATERIALS LIST ON SECTION SHEET
2. SEE SHEET A-1 FOR ALL GENERAL NOTES AND FOR ALL REQUIREMENTS CONCERNING MECHANICAL, PLUMBING, AND ELECTRICAL.
3. TRUSS DESIGN BY MFG. TRUSS PLAN SHOWN IS FOR GENERAL LAYOUT ONLY. SEE DIV. 6100 SHEET A-1 - TRUSS LOADING. SEE DIV. 0202.10A SHEET A-1 - TRUSS SPAN PER FLOOR PLANS - TRUSS TYPE PER ROOF FRAMING PLAN
4. ROOF FRAMING SPACING, 24" O.C. UNO.
5. ROOF PITCH - EXTERIOR PER ELEVATION INTERIOR PER SECTION.
6. RAFTER TAIL 2x4. VERIFY.
7. ROOF TAIL AND RAKE OVERHANG PER ROOF PLAN.
8. ALL HEADERS ARE 4x10 DF #2 UNO. [B] PROVIDE (1) TRIMMER STUD UP TO 4'-0" SPAN AND (2) TRIMMER STUDS OVER 4'-0" UNO. SEE DIV. 06100 SHEET A-1
9. STUD NOTCHING AND BORING PER I.R.C. SECT. R602.6 - BEARING OR EXTERIOR WALL MAXIMUM NOTCH 25% BORING 40% - 60% MAXIMUM BORING IF DOUBLED WITH NOT MORE THAN (2) SUCCESSIVE STUDS BORED. NON-BEARING MAXIMUM NOTCH 40% BORING 60%. HOLES NO CLOSER THAN 5/8" TO FACE OF STUD.

**FRAMING PLAN KEYNOTES**

- F-1 BACK FRAMING AND SOFFIT AREA AS REQUIRED TO ALLOW FOR HVAC DUCTING.
- F-2 RAKED PONY WALL ON TOP OF LOWER ROOF FRAMING MEMBERS SUPPORTING UPPER ROOF FRAMING MEMBERS.
- F-3 ALIGN EDGE OF JOIST WITH FACE OF WALL
- F-4 ALIGN INSIDE FACE OF BEAM WITH OUTSIDE FACE OF WALL
- F-5 UPSET - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOIST AND TOP OF BEAM EXTENDS UP ABOVE JOISTS
- F-6 TOP OF BEAM IS FLUSH WITH BOTTOM OF JOIST WITH NO TOP PLATE. CUT ADJACENT FRAMING MEMBERS INTO BEAM FOR ADEQUATE SUPPORT.
- F-7 ATTIC SPACE VENT SEE CALCULATION SEE DIV. 0202.3.B SHEET A-1
- F-8 FLOOR JOIST - SEE SCHEDULE DUG. SEE DIV. 06100 SHEET A-1
- F-9 SEE ELEVATIONS AND SECTIONS FOR PLATE HEIGHT
- F-10 PRESSURE BLOCKING SEE DIV. 06100 SHEET A-1
- F-11 FLUSH - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOISTS
- F-12 TOP OF BEAM FLUSH W/ TOP OF JOIST AND BEAM EXTENDS DOWN BELOW JOISTS
- F-13 TOP OF BEAM 3" BELOW TOP OF FLOOR TRUSS. FLOOR TRUSSES TO BE TOP CHORD BEARING.
- F-14 2x OVERFRAMING @ 24" O.C. PROVIDE 2x6 STRONGBACK FURLINS AND 2x KICKERS AT 6'-0" O.C. TO TRUSSES BELOW.
- F-15 2x6 CEILING JOISTS @ 24" O.C.

**ROOF VENT CALCULATION**



TOTAL ROOF AREA	947	SF/300	= 649	SF OF VENT AREA REQ
40% MIN. AT 36" MAX BELOW RIDGE	= 26	SF MIN.		
50% MAX. AT 36" MAX BELOW RIDGE	= 324	SF MAX.		
9	ROOF JACKS AT 50 SQ. IN. EACH	450	SQ. IN. = 312	SF
107	L.F. OF EAVE VENTS AT 3.3-SQ. IN./L.F.	3531	SQ. IN. = 245	SF
3	ROOF JACKS AT 50 SQ. IN. EACH	150	SQ. IN. = 104	SF
	(36" MAX. ABOVE EAVES)		TOTAL = 349	SF
			TOTAL SF OF VENTILATION PROVIDED	= 661

**SYMBOLS & LEGEND**

- POINT LOADS FROM ABOVE
- POINT LOADS FROM ABOVE W/ LOADING
- POINT LOAD TRANSFERING DOWN
- POINT LOAD TRANSFERING DOWN W/ LOADING
- HANGER
- POINT LOAD TRANSFERED BY KICKER
- HOLD DOWN WITH SIZE DESIGNATION
- VERTICAL STRAP WITH SIZE DESIGNATION TO BE USED ON FLOOR BELOW
- HORIZONTAL STRAP WITH SIZE DESIGNATION
- INDICATES BEAM CALCULATION WITH INDEXED NUMBER
- ▬ WALL ABOVE
- ▬ WALL BELOW

**UPPER ROOF FRAMING PLAN**

SCALE 1/4"=1'-0"

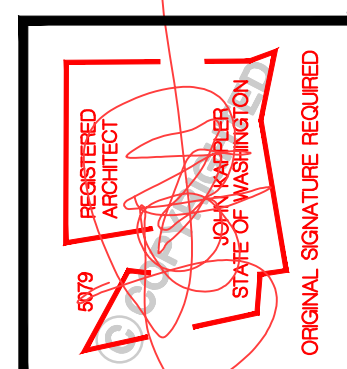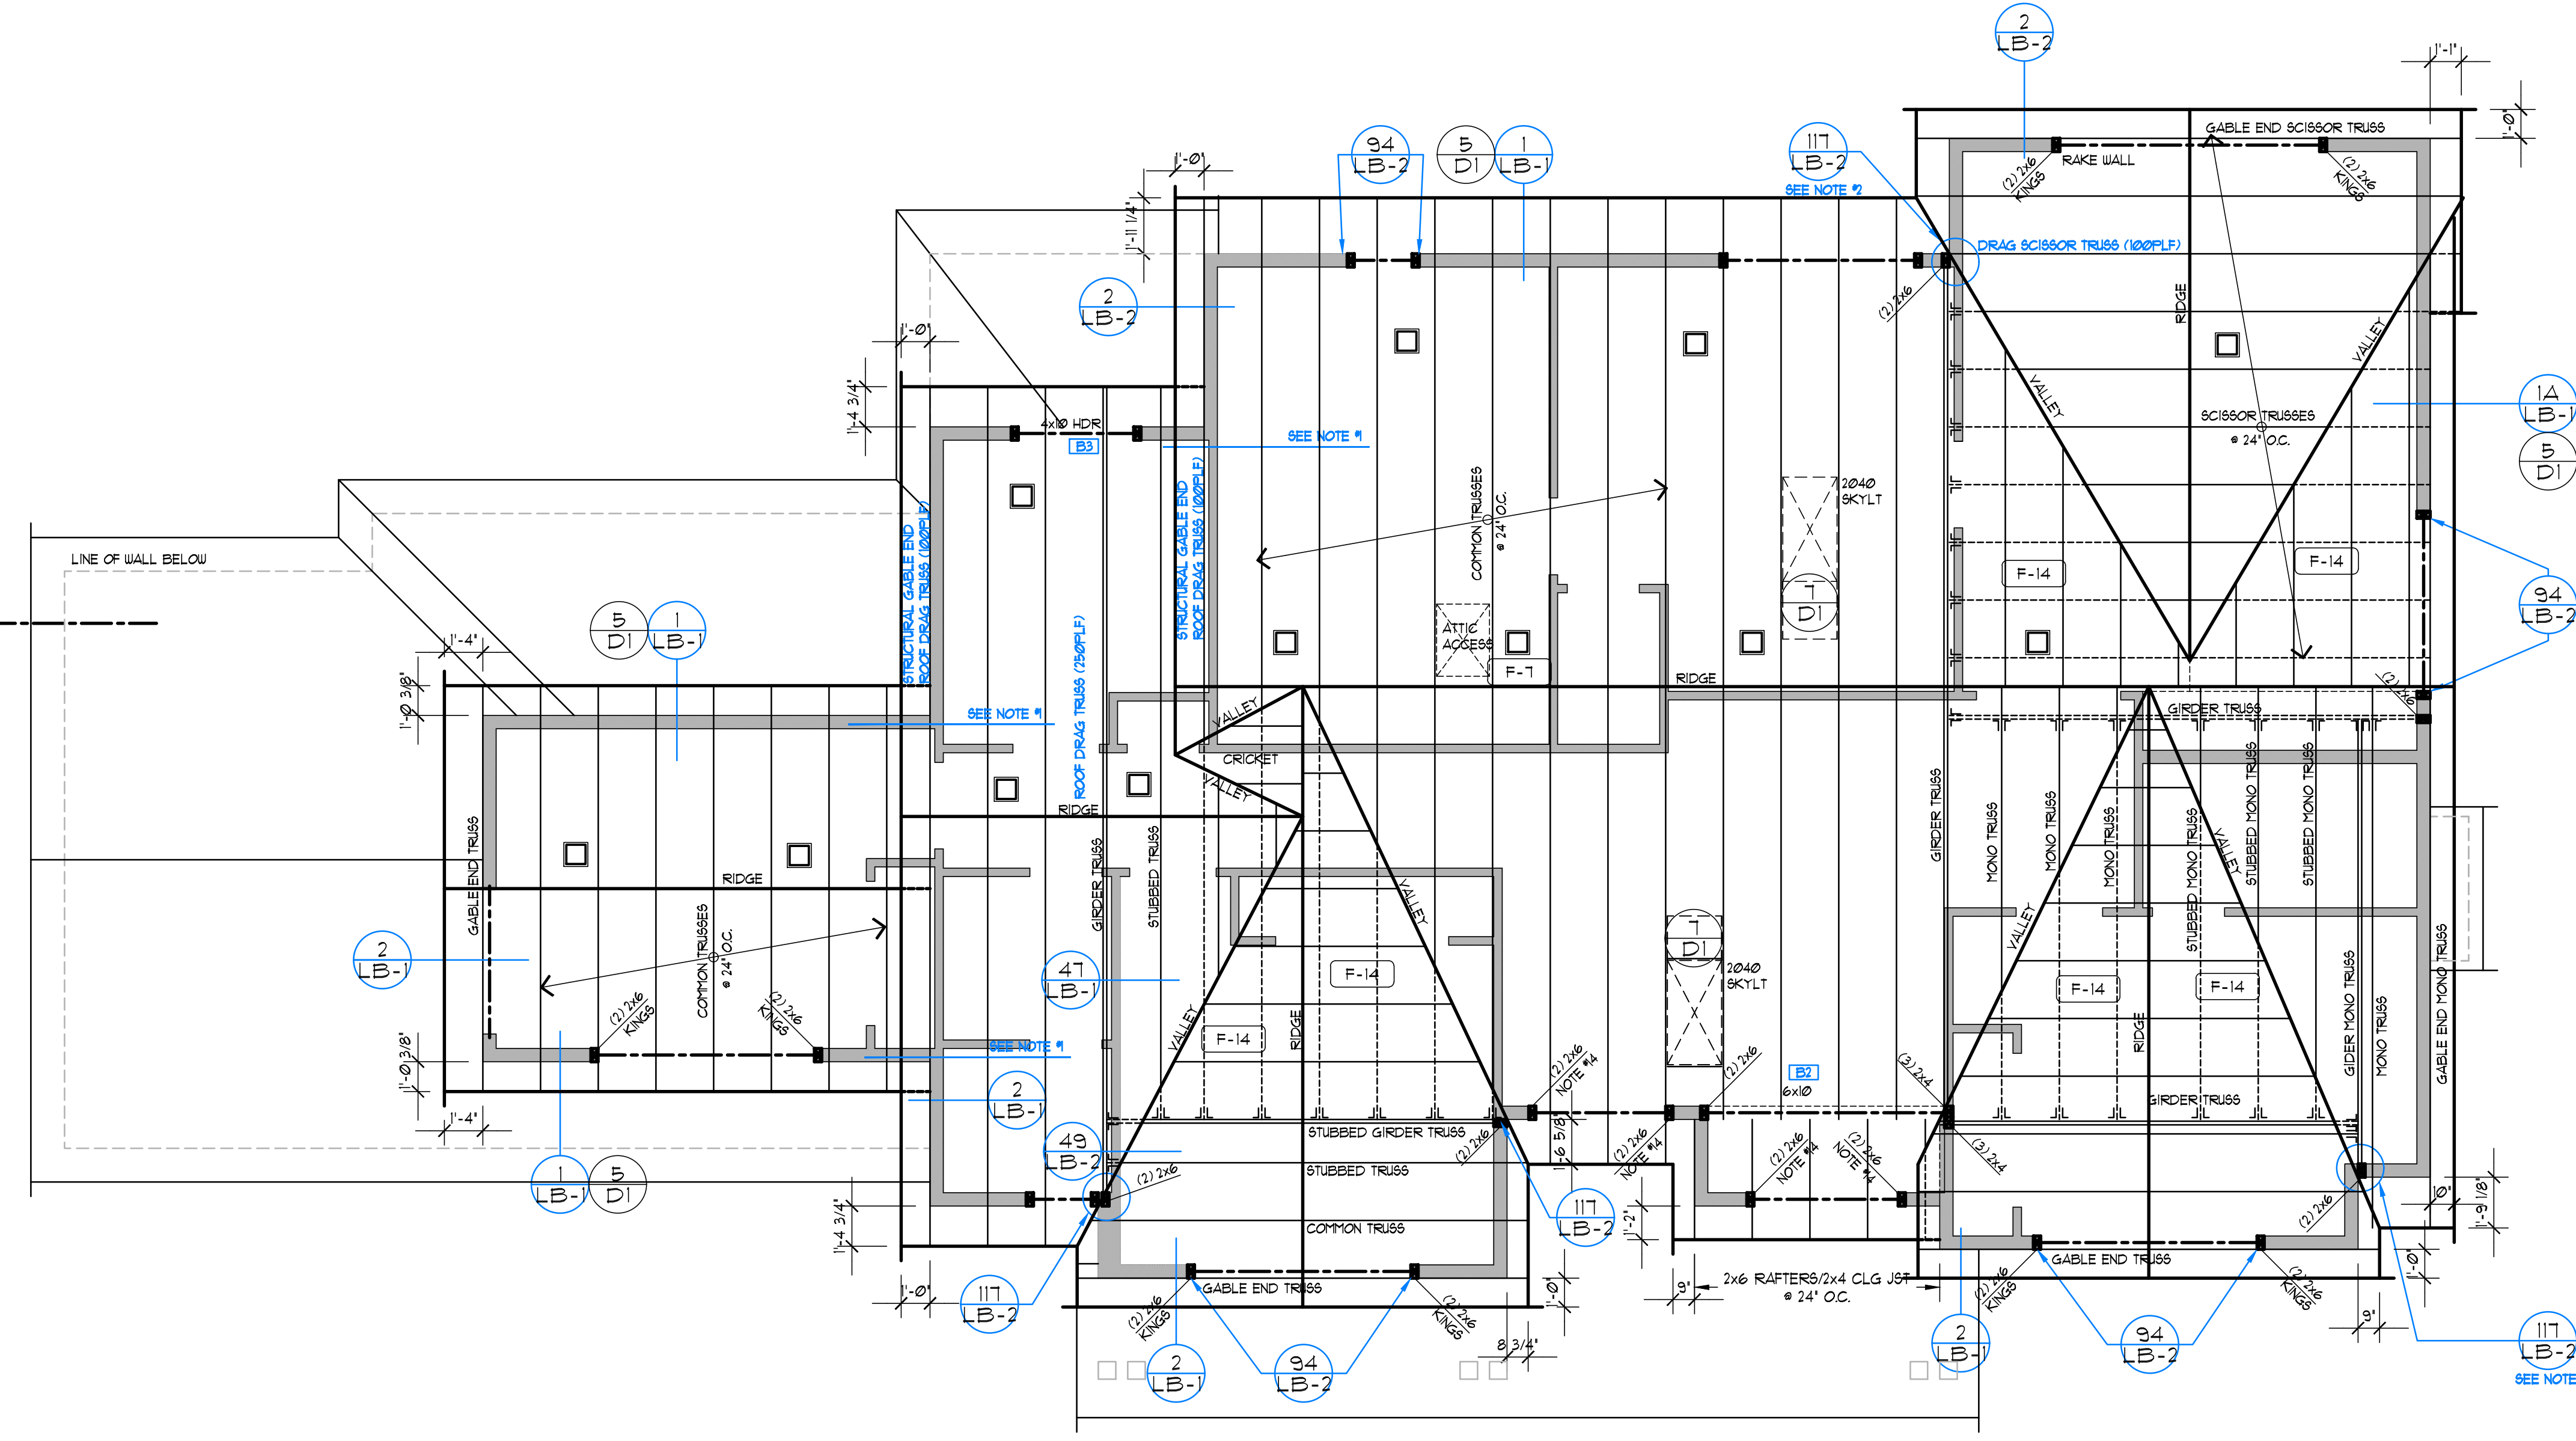

Date	By	Description
06/20/21	SM	PERMIT SET
07/14/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

**ARCHITECTURAL INNOVATIONS, P.S.**  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 16th St  
 Bellevue, WA 98007  
 1-800-888-4517  
 www.kadellchanceplans.com

**Reviewed**  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE	
JOB NO.:	19033.05
STARTING NO.:	19033.05


SHEET  
**A6**



**NORTH ELEVATION**  
Scale 1/4"=1'-0"



**WEST ELEVATION**  
Scale 1/4"=1'-0"

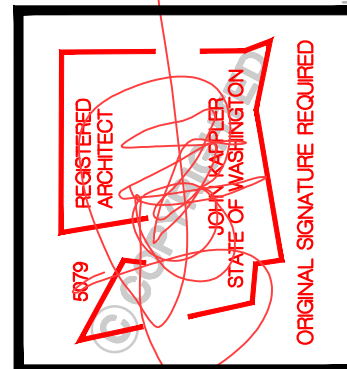

Date	By	Description
04/20/21	SM	PERMIT SET
07/14/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 64th St.  
 Bellevue, WA 98007  
 1-800-888-4517  
 www.kapplerhomeplans.com

**Reviewed**  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021


TITLE
JOB NO. : 19035.21
STARTING NO. : 19035.05

SHEET  
**A7**




**SOUTH ELEVATION**

Scale 1/4"=1'-0"

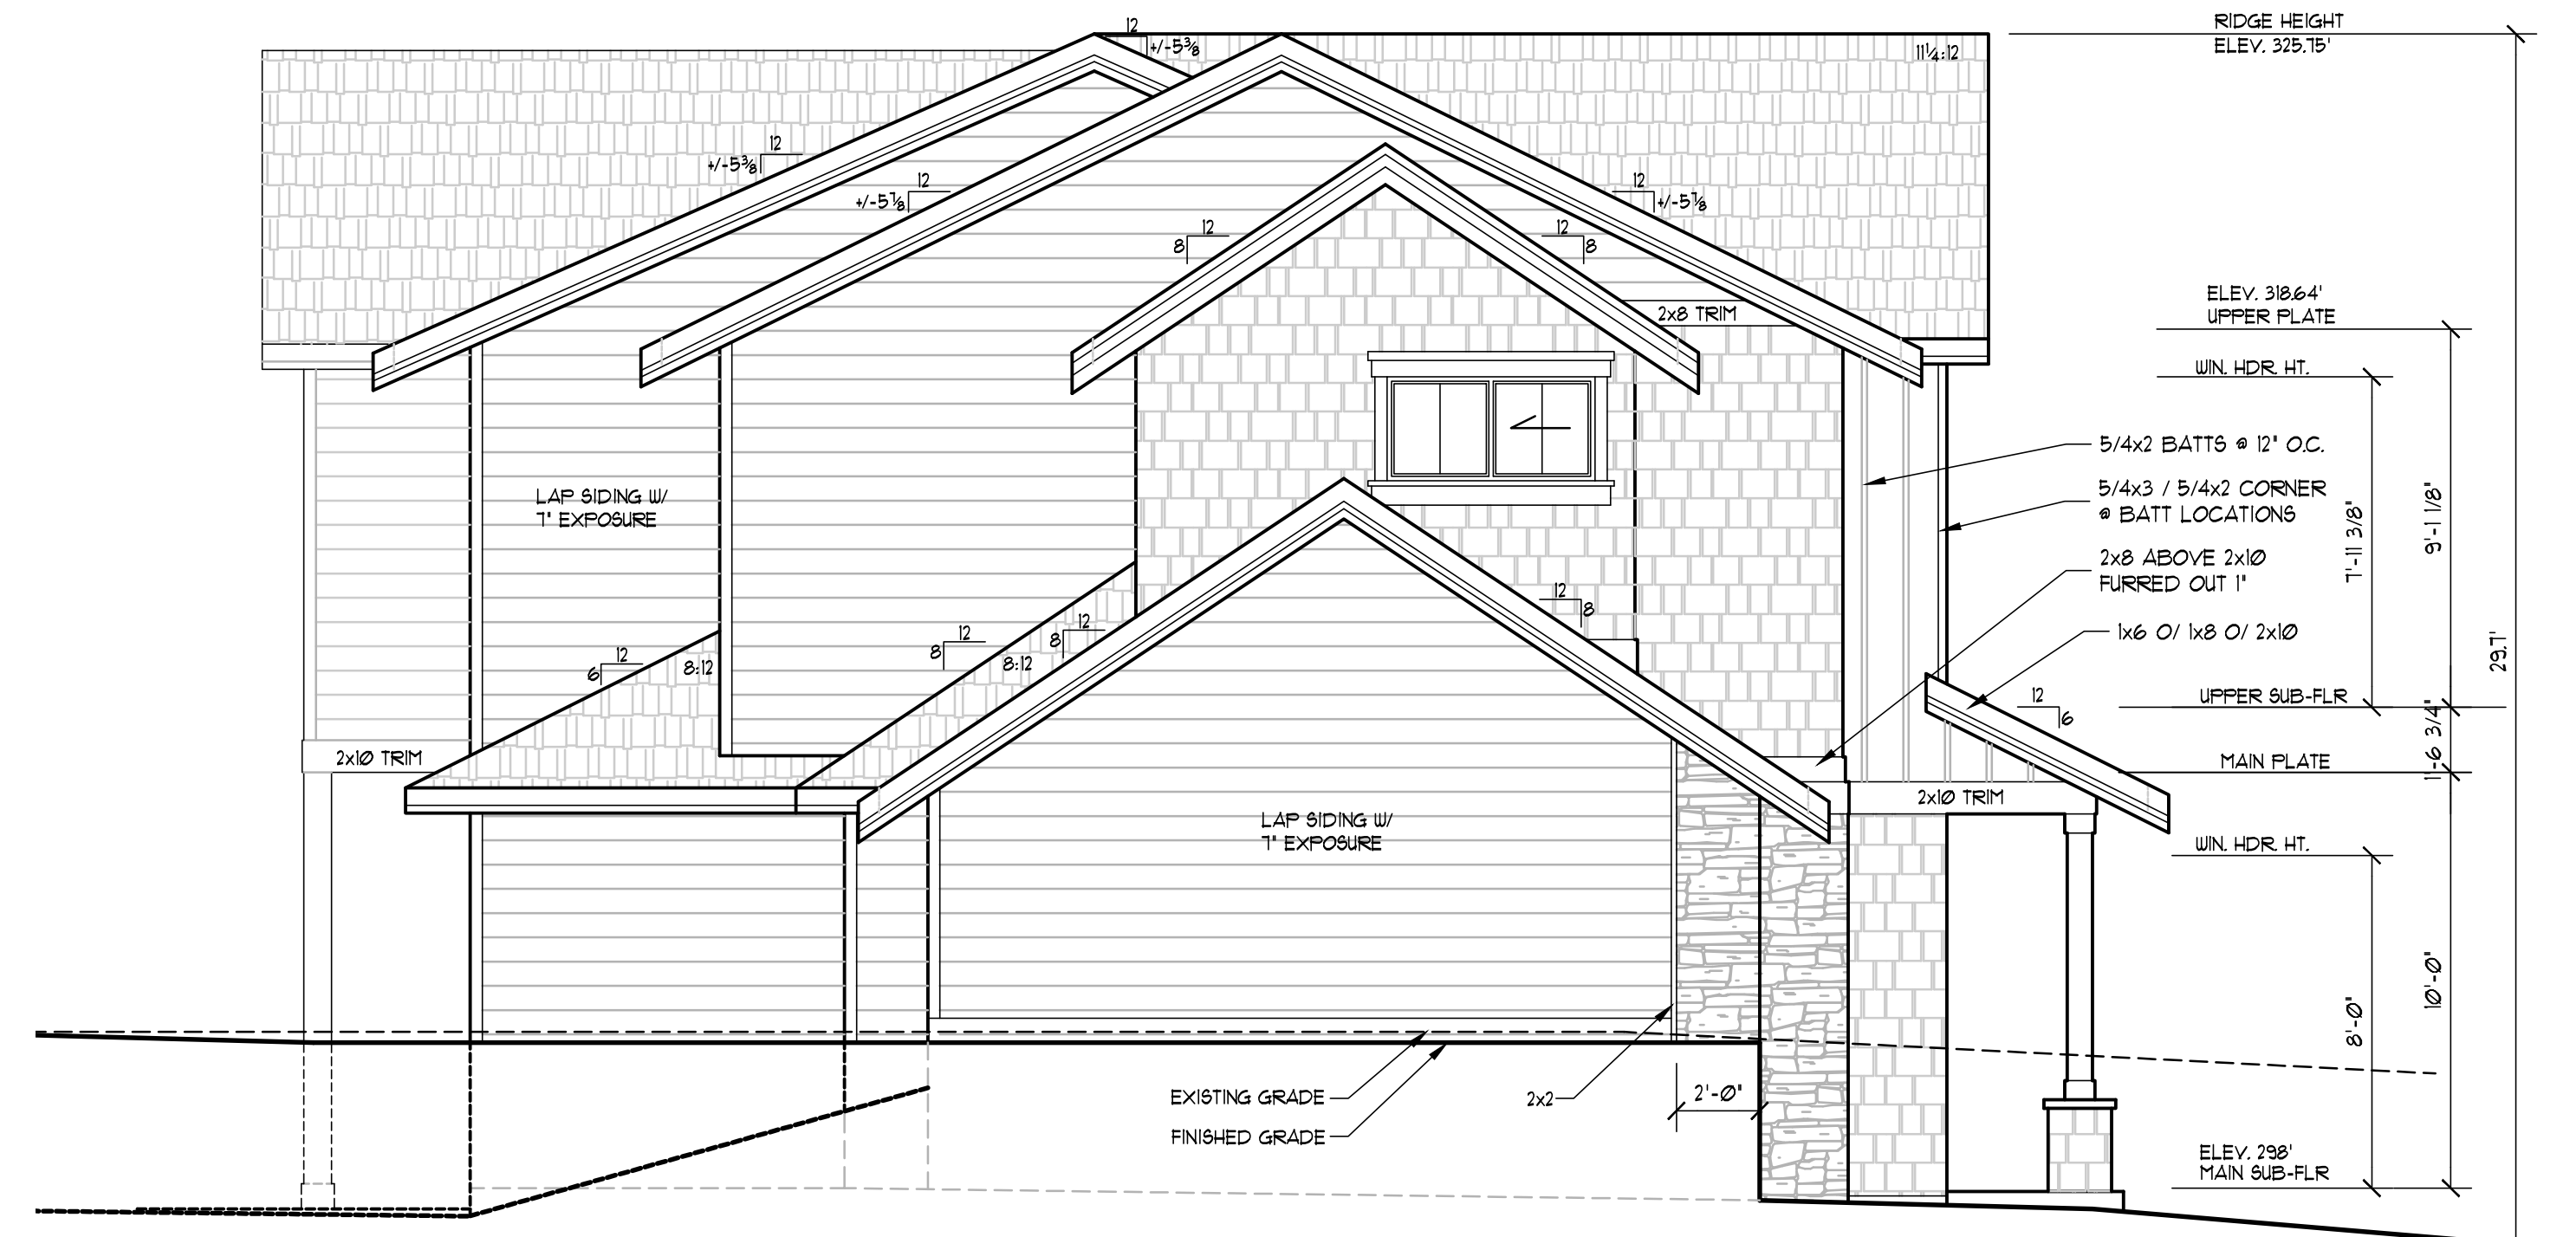

**EAST ELEVATION**

Scale 1/4"=1'-0"

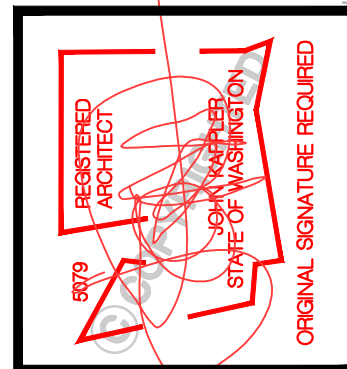

Date	By	Description
04/30/21	SM	PERMIT SET
07/14/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

**ARCHITECTURAL INNOVATIONS, P.S.**  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 14th St.  
 Bellevue, WA 98007  
 1-800-888-4517  
[www.kapplerhomeplans.com](http://www.kapplerhomeplans.com)

**Reviewed**  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE
JOB NO.: 19035.21
STARTING NO.: 19035.05

SHEET
<b>A8</b>

# TYPICAL BUILDING MATERIALS

## ROOF CONSTRUCTION

- ROOFING: (DIV. 7)
- BUILDING PAPER: (DIV. 7)
- SHEATHING: (DIV. 6)
- FRAMING: (DIV. 6)
- INSULATION: (DIV. 7)
- SOFFIT: (DIV. 7)
- GWB: (DIV. 9)
- SKYLIGHTS: (DIV. 8)
- SHINGLES (DIV. 01000.5)
- 30# BUILDING PAPER
- 7/16" O.S.B. OR EQUAL
- PER PLAN
- R-49 BLOWN-IN/R-38 BATT @ VAULTS
- PER SPECIFICATIONS
- 5/8" GWB
- LAMINATED GLAZING U=0.50 MAX.

## EXTERIOR WALL CONSTRUCTION

- SIDING MATERIAL: (DIV. 7)
- BUILDING WRAP: (DIV. 7)
- SHEATHING: (DIV. 6)
- FRAMING: (DIV. 6)
- INSULATION: (DIV. 7)
- GWB: (DIV. 9)
- DOORS: (DIV. 8)
- WINDOWS: (DIV. 8)
- WOOD SIDING (DIV. 0100.5)
- 15# BUILDING PAPER
- 1/2" CDX PLYWOOD OR EQUAL
- 2 X 6 STUDS AT 16" O.C.
- R-21 BATT W/ INTEGRAL VAPOR BARRIER
- PROVIDE CLASS II VAPOR RETARDER IN MARINE ZONE 4
- 1/2" GWB
- U=0.20
- U=0.20

## FLOOR CONSTRUCTION

- FLOORING: (DIV. 9)
- SUBFLOOR: (DIV. 6)
- FRAMING: (DIV. 6)
- INSULATION: (DIV. 7)
- SOFFIT: (DIV. 7)
- TRIM: (DIV. 6)
- FINISH PER PLANS (DIV. 0100.5)
- 3/4" T&G PLYWD, COMPLY, OR EQ
- PER PLANS
- R-30 BATT
- PER SPECIFICATIONS

## TRIM: (DIV. 6)


- WINDOW: (WITH NO BRICK MOLD)
- CORNER BOARDS:
- FASCIA:
- HEAD: 5/4x3 OVER 2x8
- JAMB: 5/4x4
- SILL: 2x6 WITH 2x3 STOOL
- INSIDE: 2x2
- OUTSIDE: 5/4x4 / 5/4x3
- 5/4x8 UNO

## ENERGY CODE REQUIREMENTS

- THE BUILDER SHALL COMPLETE AND POST AN "INSULATION CERTIFICATE FOR RESIDENTIAL CONSTRUCTION" WITHIN 3' OF THE ELECTRICAL PANEL PRIOR TO FINAL INSPECTION. THE CERTIFICATE SHALL LIST THE PREDOMINANT R-VALUES OF INSULATION INSTALLED IN OR ON CEILING/ROOF, WALLS, FOUNDATION (SLAB, BELOW-GRADE WALL, AND/OR FLOOR) AND DUCTS OUTSIDE CONDITIONED SPACES; U-FACTORS FOR FENESTRATION AND THE SOLAR HEAT GAIN COEFFICIENT (SHGC) OF FENESTRATION; THE RESULTS FROM ANY REQUIRED DUCT SYSTEM AND BUILDING ENVELOPE AIR LEAKAGE TESTING DONE ON THE BUILDING; AND THE RESULTS FROM THE WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM FLOW RATE TEST.
- A MINIMUM OF 90% PERMANENTLY INSTALLED LAMPS IN LIGHTING FIXTURES SHALL BE HIGH-EFFICIENCY LAMPS.


## ENERGY CREDITS

- 2 FUEL NORMALIZATION 10 CREDIT**  
HEAT PUMP
- 12 EFFICIENT BUILDING ENVELOPE 10 CREDIT**  
VERTICAL FENESTRATION MIN U=20
- 21 AIR LEAKAGE CONTROL & EFFICIENT VENTILATION 5 CREDIT**  
Reduce the tested air leakage to 3.0 air changes per hour maximum at 50 Pascals  
And  
All whole house ventilation requirements as determined by Section M1507.3 of the International Residential Code or Section 403.8 of the International Mechanical Code shall be met with a high efficiency fan(s) (maximum 0.35 watts/cfm), not interlocked with the furnace fan (if present). Ventilation systems using a furnace including an ECM motor are allowed, provided that they are controlled to operate at low speed in ventilation only mode.
- 35 HIGH EFFICIENCY HVAC 15 CREDIT**  
AIR-SOURCE, CENTRALLY DUCTED HEAT PUMP WITH MINIMUM HSPF OF 11.0
- 55 EFFICIENT WATER HEATING 2.0 CREDIT**  
ELECTRIC HEAT PUMP WATER HEATER MEETING THE STANDARDS FOR TIER III OF NBEA's ADVANCED WATER HEATING SPECIFICATION.

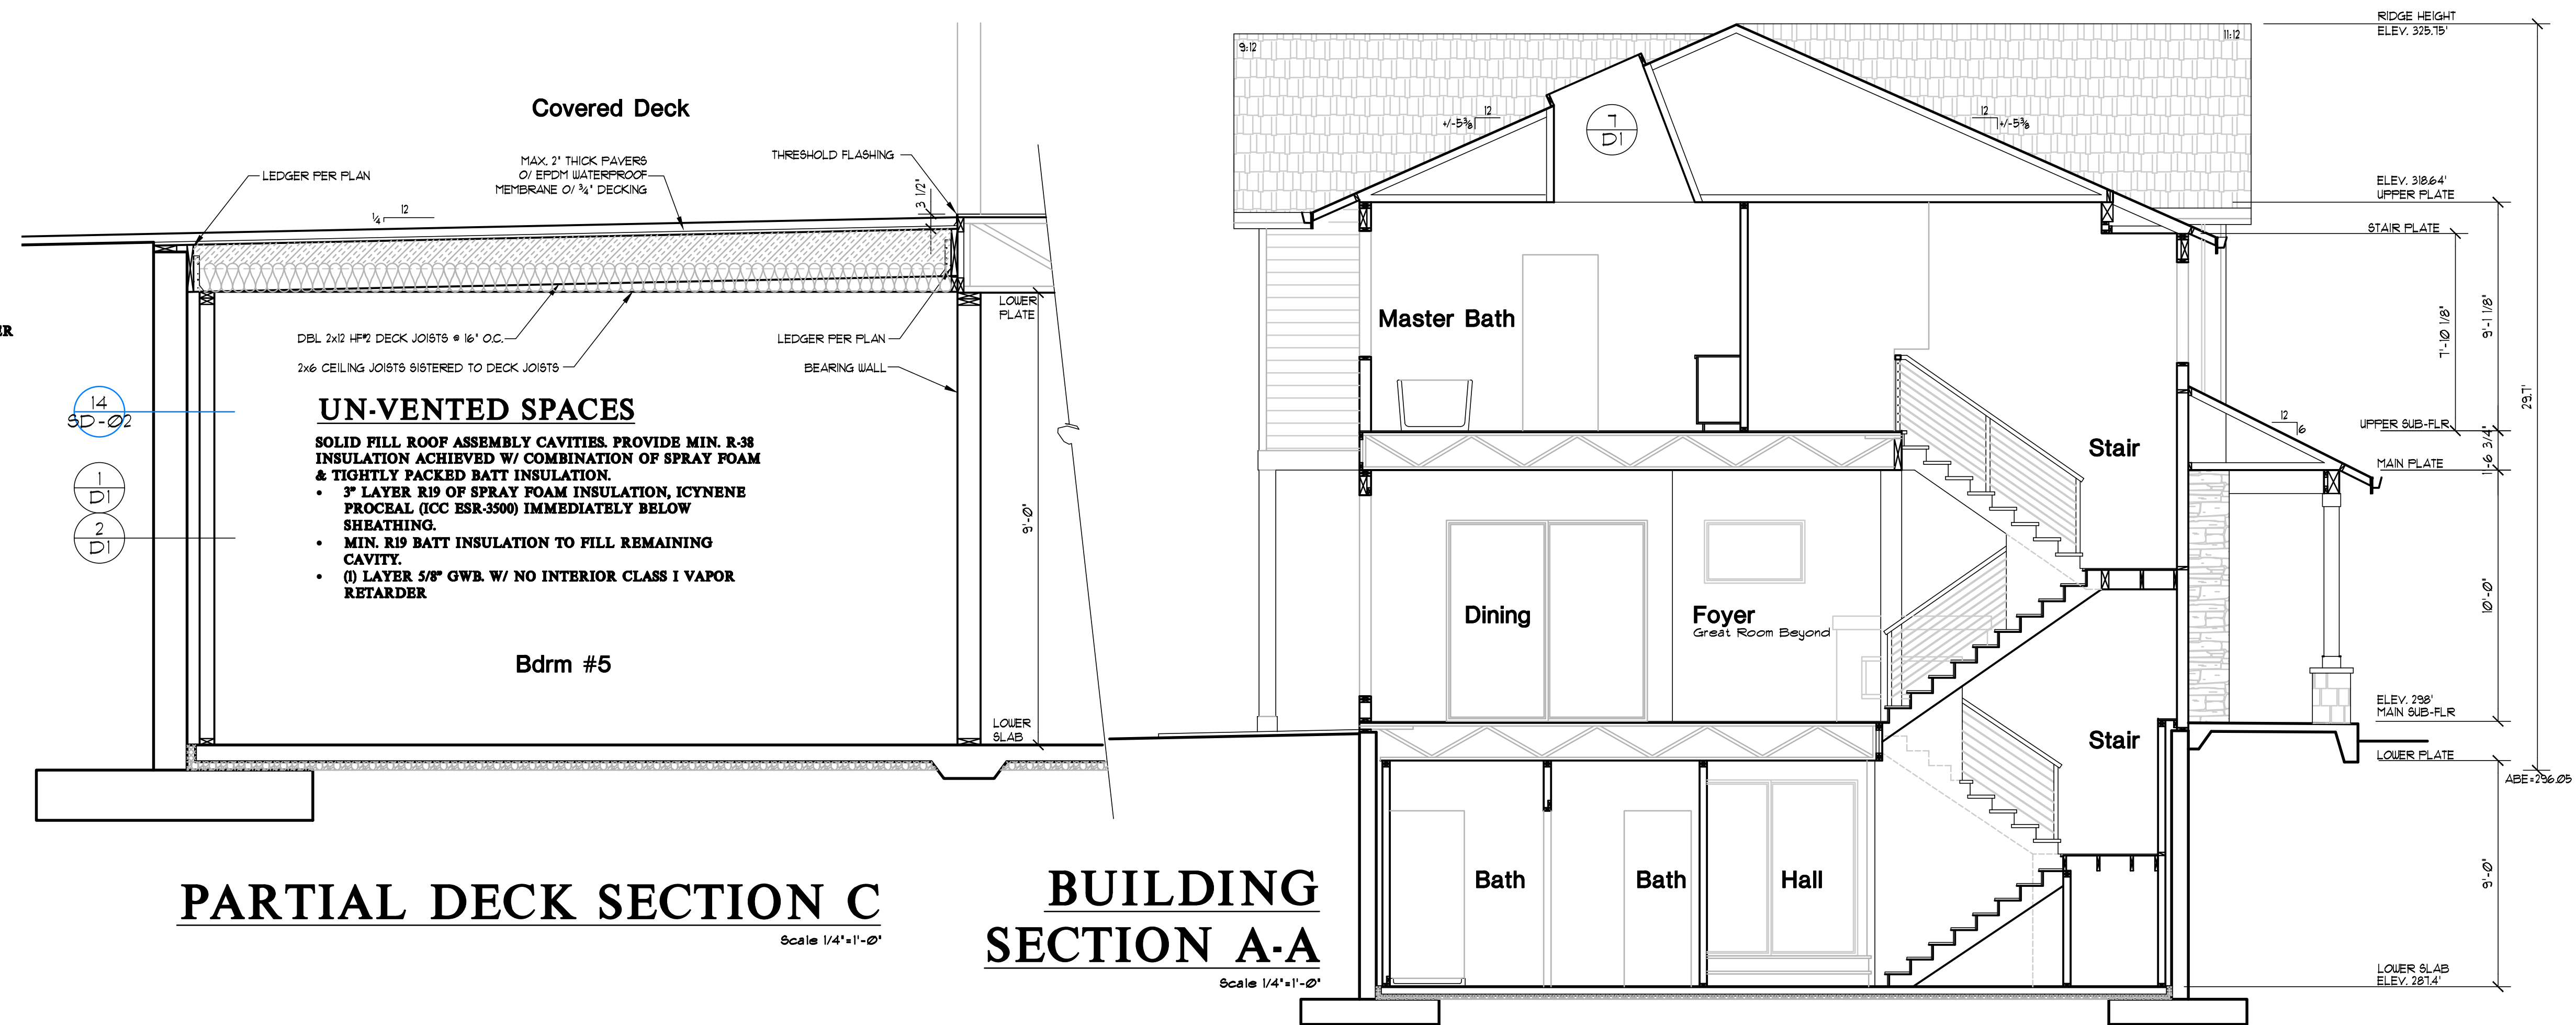


**PARTIAL DECK SECTION C**  
Scale 1/4"=1'-0"

**BUILDING SECTION A-A**  
Scale 1/4"=1'-0"

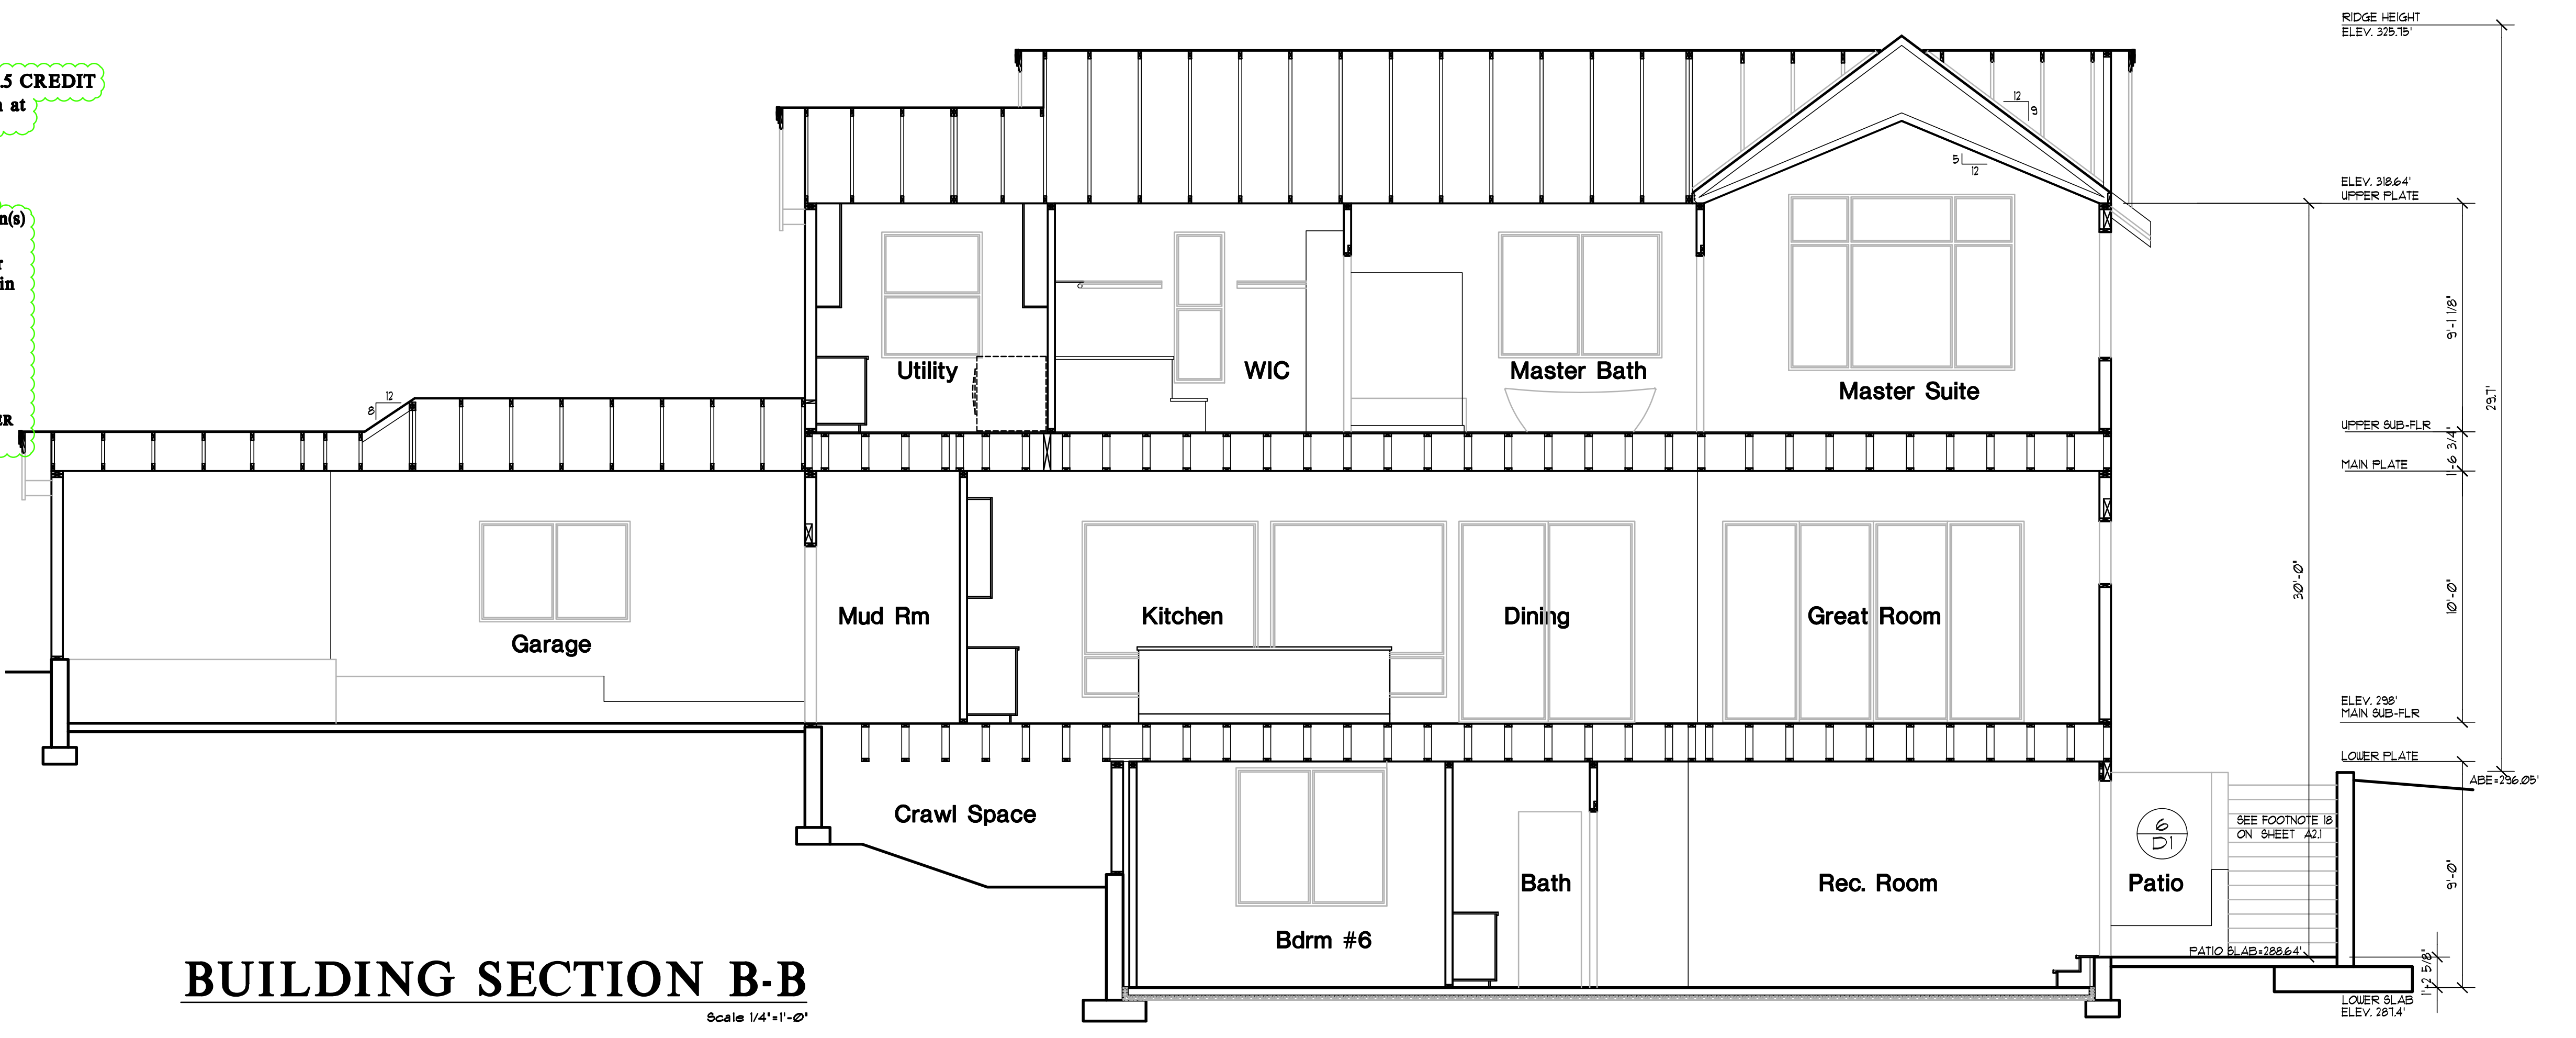

**BUILDING SECTION B-B**  
Scale 1/4"=1'-0"

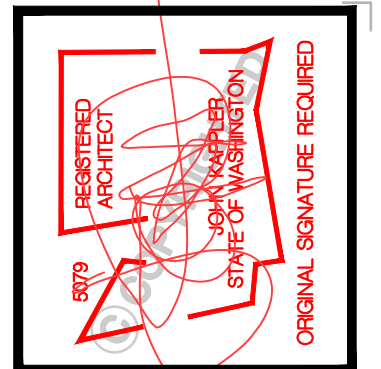

Date	By	Description
04/20/21	SM	PERMIT SET
07/22/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
 Lot 2  
 7921 SE 72nd PL  
 Mercer Island, WA 98040  
 THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED


**ARCHITECTURAL INNOVATIONS, P.S.**  
 Forward Thinking Design Solutions For Your Environment  
 14311 SE 45th St.  
 Bellevue, WA 98007  
 1-800-888-4517  
[www.kaplanhomeplans.com](http://www.kaplanhomeplans.com)

**Reviewed**  
 Kolke Consulting Group, Inc.  
 C. Kolke  
 07/30/2021

TITLE	
JOB NO.:	19035.21
STARTING NO.:	19035.05


SHEET  
**A9**



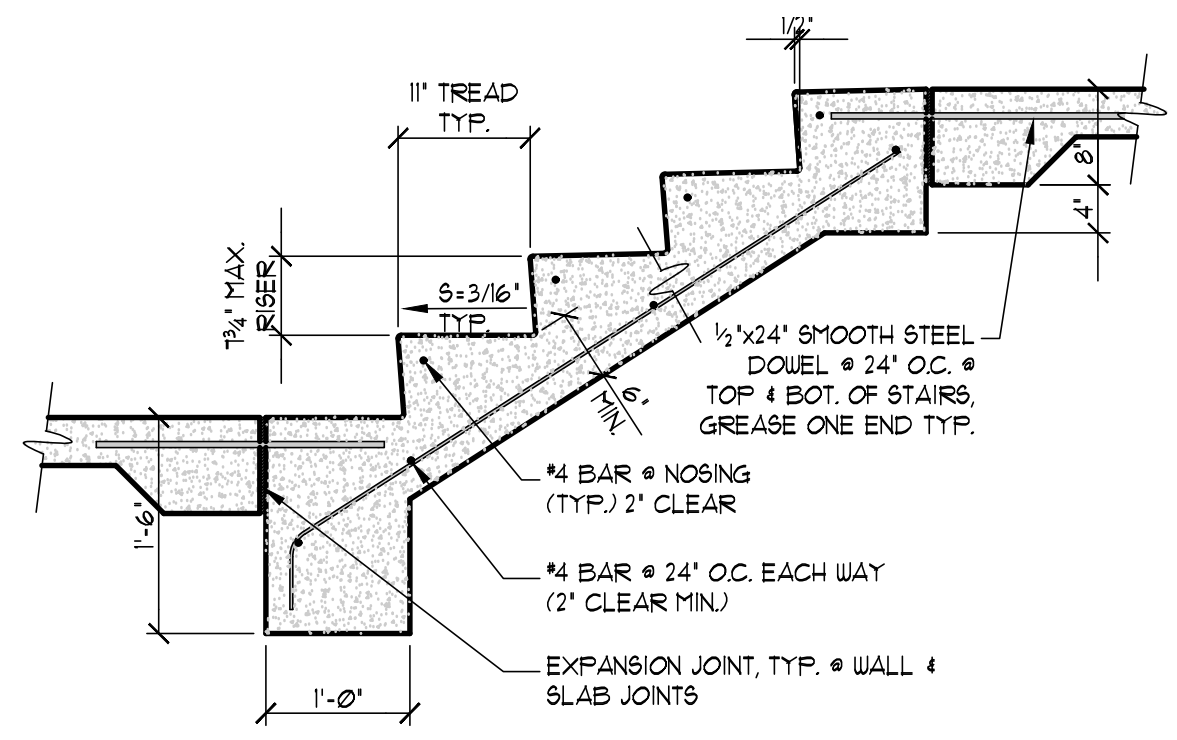


- SEE PLANS FOR STAIR LOCATIONS & APPROXIMATE NUMBER OF RISERS. CONTRACTOR TO FIELD DETERMINE RISER QUANTITY BASED ON SITE CONDITIONS.
- SEE PLANS FOR LOCATIONS OF GUARDS & HANDRAILS
- PROVIDE MEDIUM BROOM FINISH ON ALL STAIR TREADS UNLESS OTHERWISE SPECIFIED


**10 EXTERIOR STAIRWAY DETAIL**  
3/4"=1'-0"

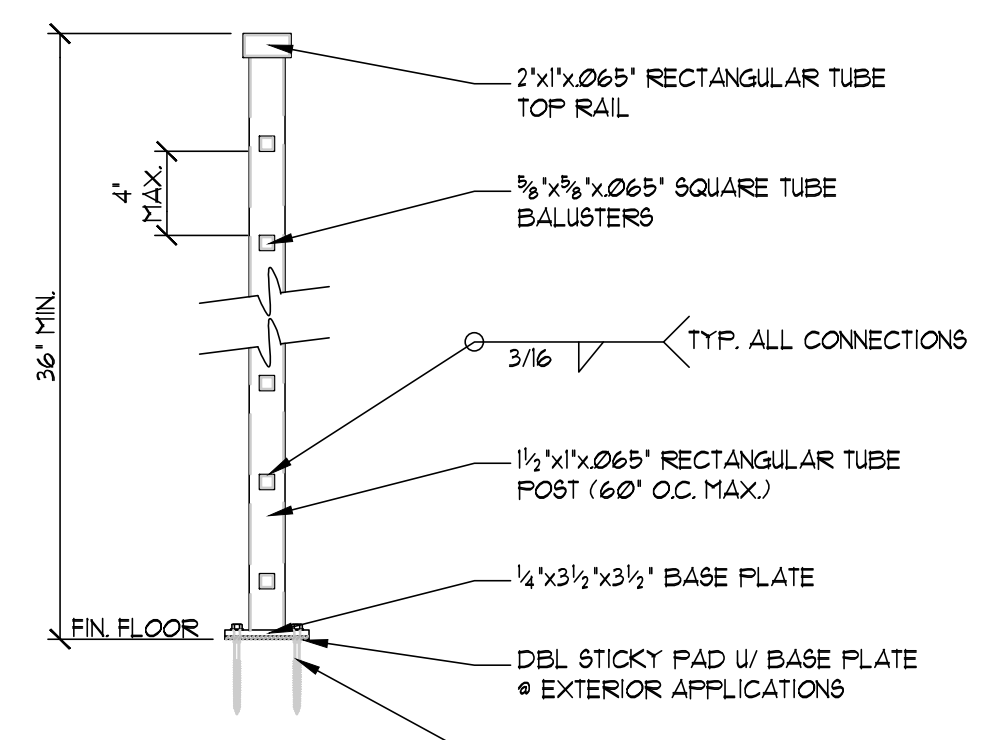

**8 STANDARD RAIL DETAIL**  
1 1/2"=1'-0"

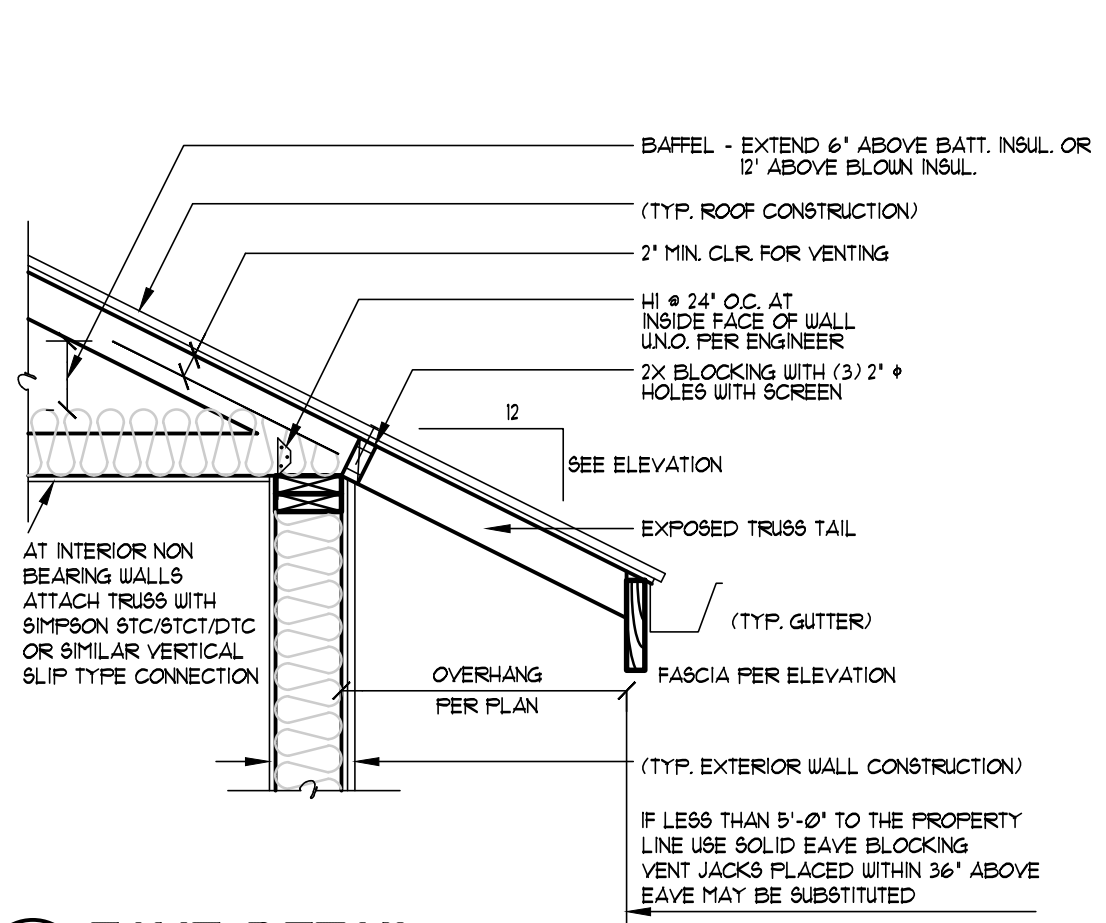

**5 EAVE DETAIL**  
3/4"=1'-0"

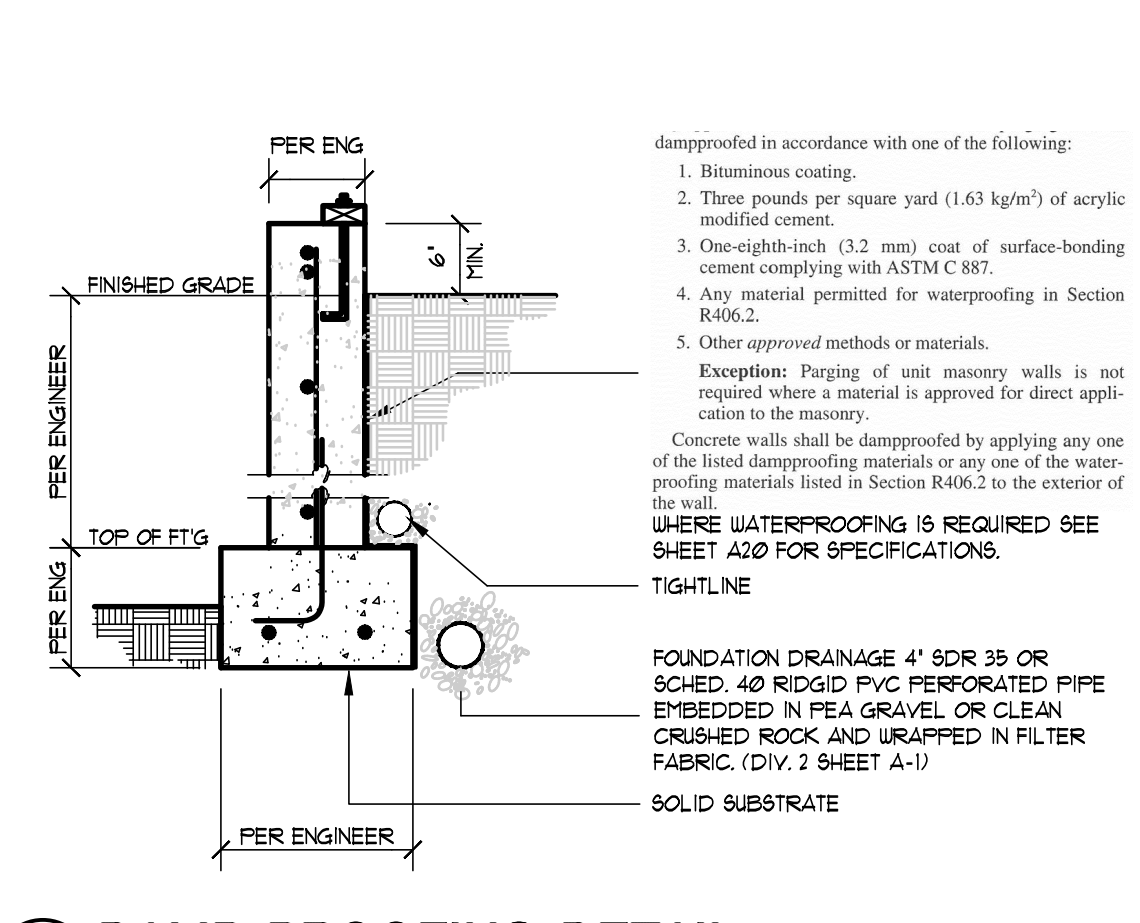


**1 DAMP PROOFING DETAIL**  
3/4"=1'-0"

**WINDOW WELL**


**R310.2 Window wells.** The minimum horizontal area of the window well shall be 9 square feet (0.9 m<sup>2</sup>), with a minimum horizontal projection and width of 36 inches (914 mm). The area of the window well shall allow the emergency escape and rescue opening to be fully opened.

**Exception:** The ladder or steps required by Section R310.2.1 shall be permitted to encroach a maximum of 6 inches (152 mm) into the required dimensions of the window well.


**R310.2.1 Ladder and steps.** Window wells with a vertical depth greater than 44 inches (1118 mm) shall be equipped with a permanently affixed ladder or steps usable with the window in the fully open position. Ladders or steps required by this section shall not be required to comply with Sections R311.7 and R311.8. Ladders or rungs shall have an inside width of at least 12 inches (305 mm), shall project at least 3 inches (76 mm) from the wall and shall be spaced not more than 18 inches (457 mm) on center vertically for the full height of the window well.

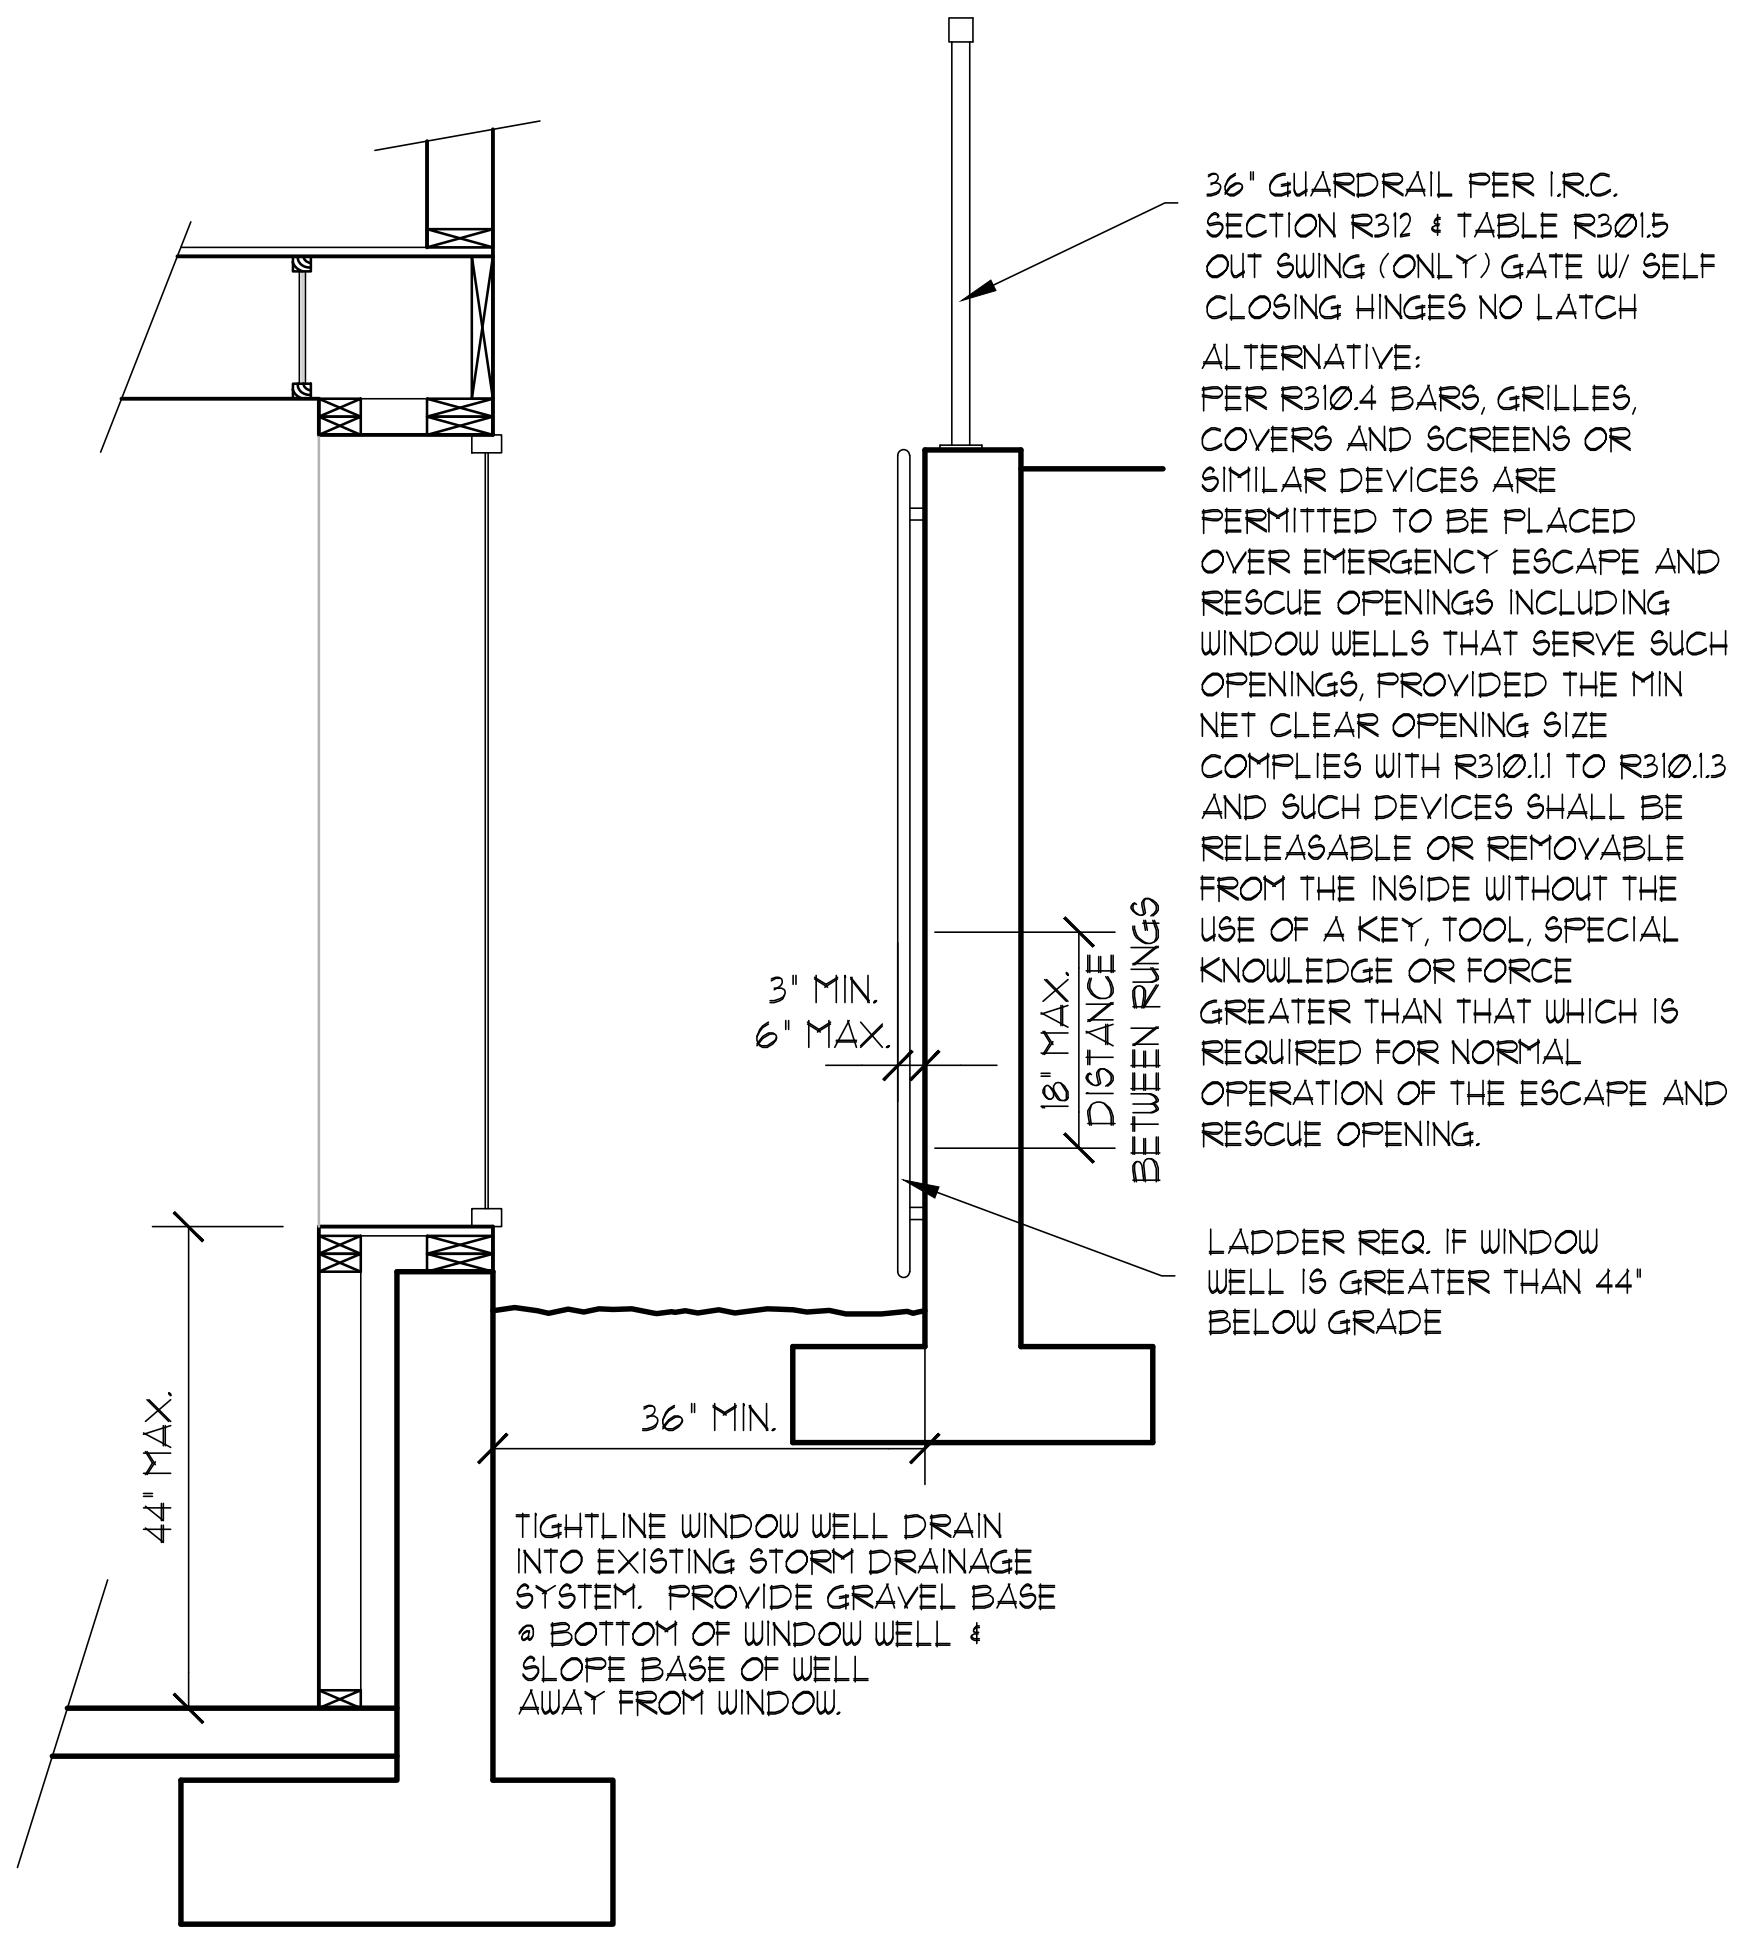


**6 WINDOW WELL DETAIL**  
3/4"=1'-0"

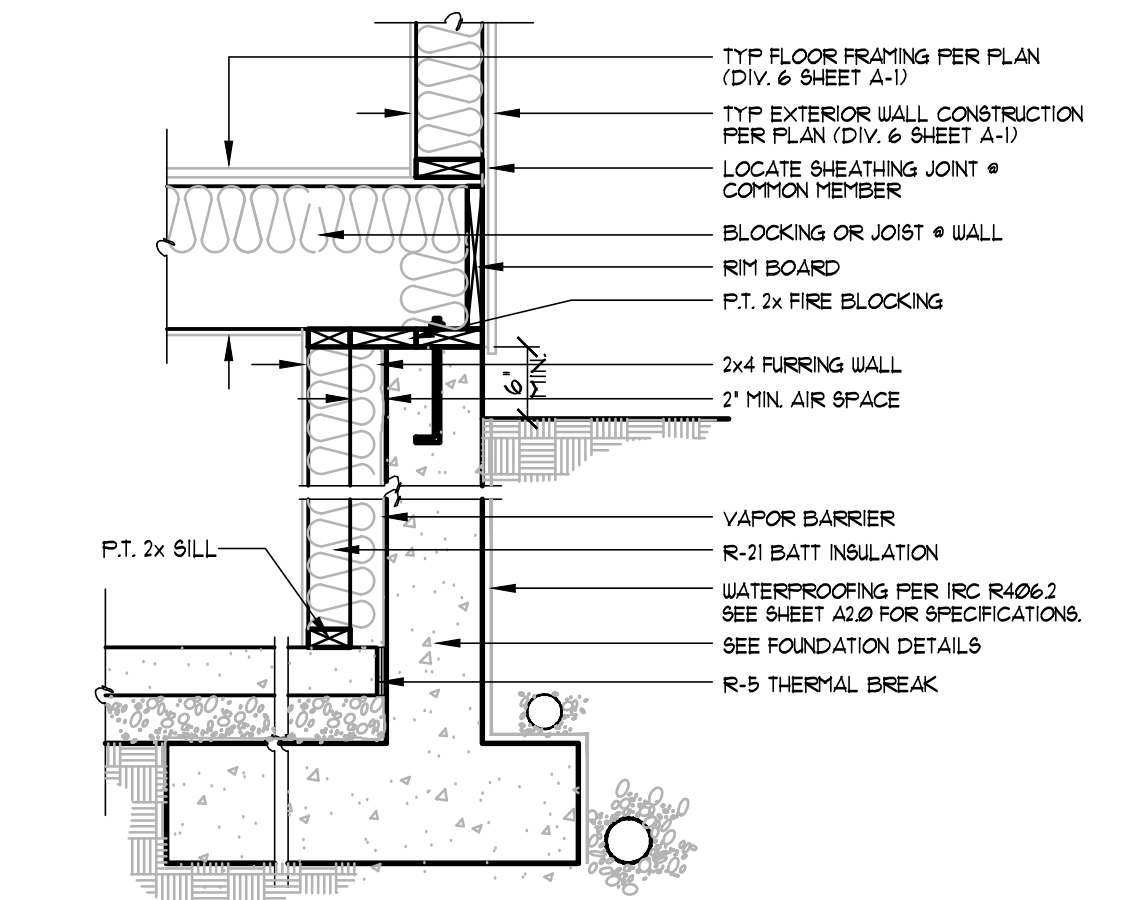


**2 FURRING DETAIL (NON INSULATED FLR)**  
3/4"=1'-0"

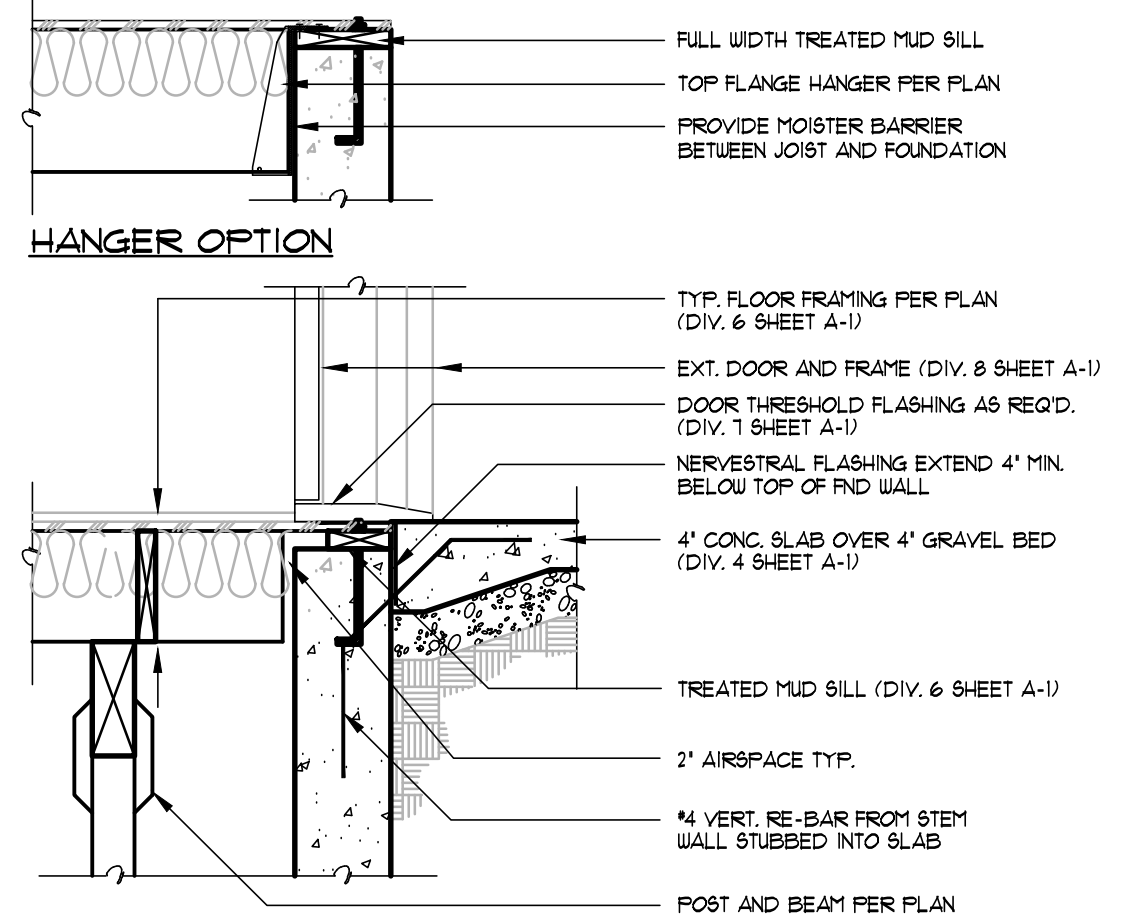


**3 EXT. DOOR THRESHOLD DETAIL**  
3/4"=1'-0"

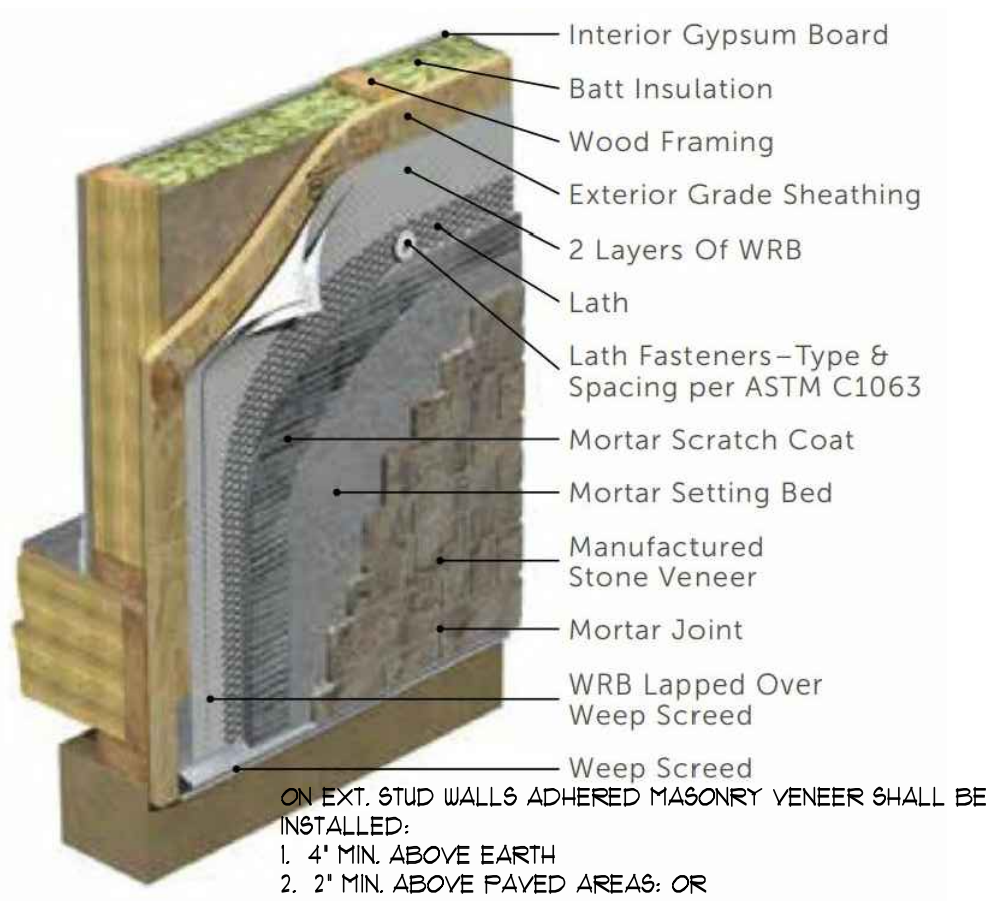


**9 STONE VENEER DETAIL**  
N.T.S.

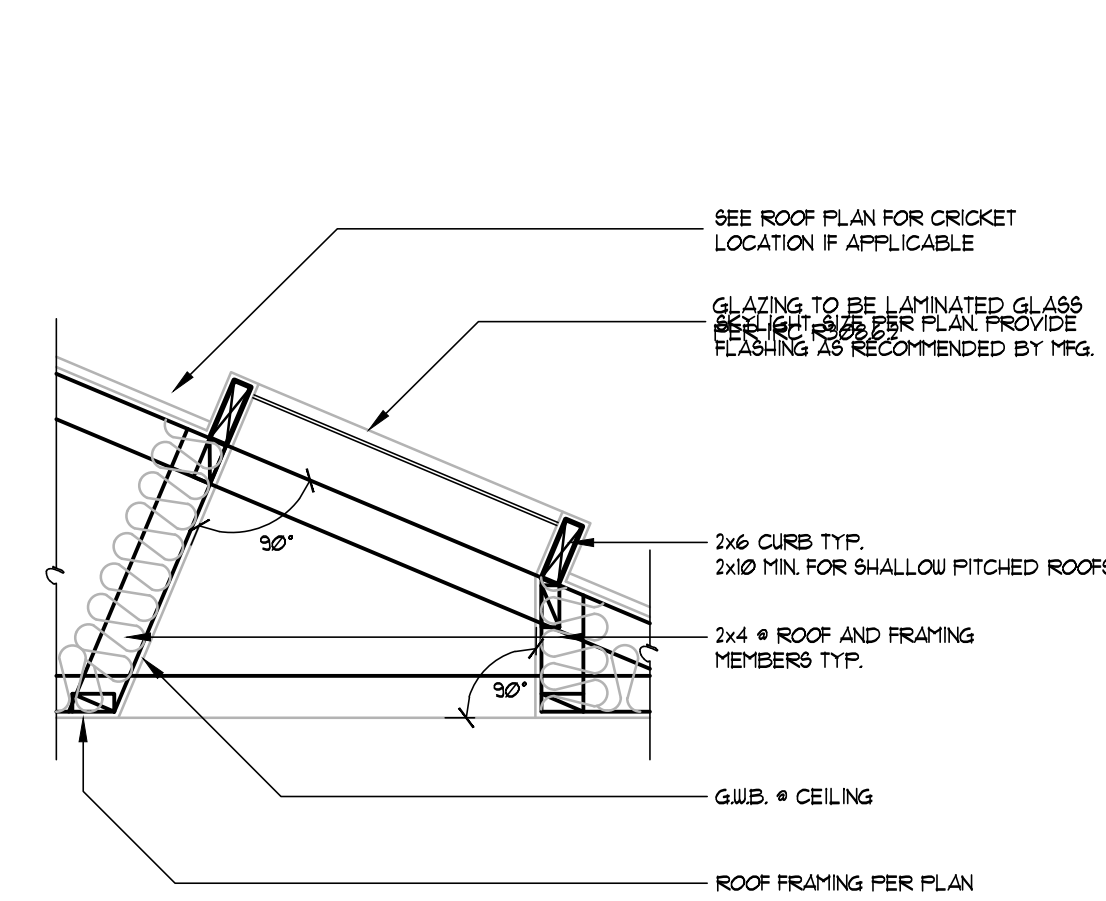

**7 SKYLIGHT FLARE WELL DETAIL**  
3/4"=1'-0"

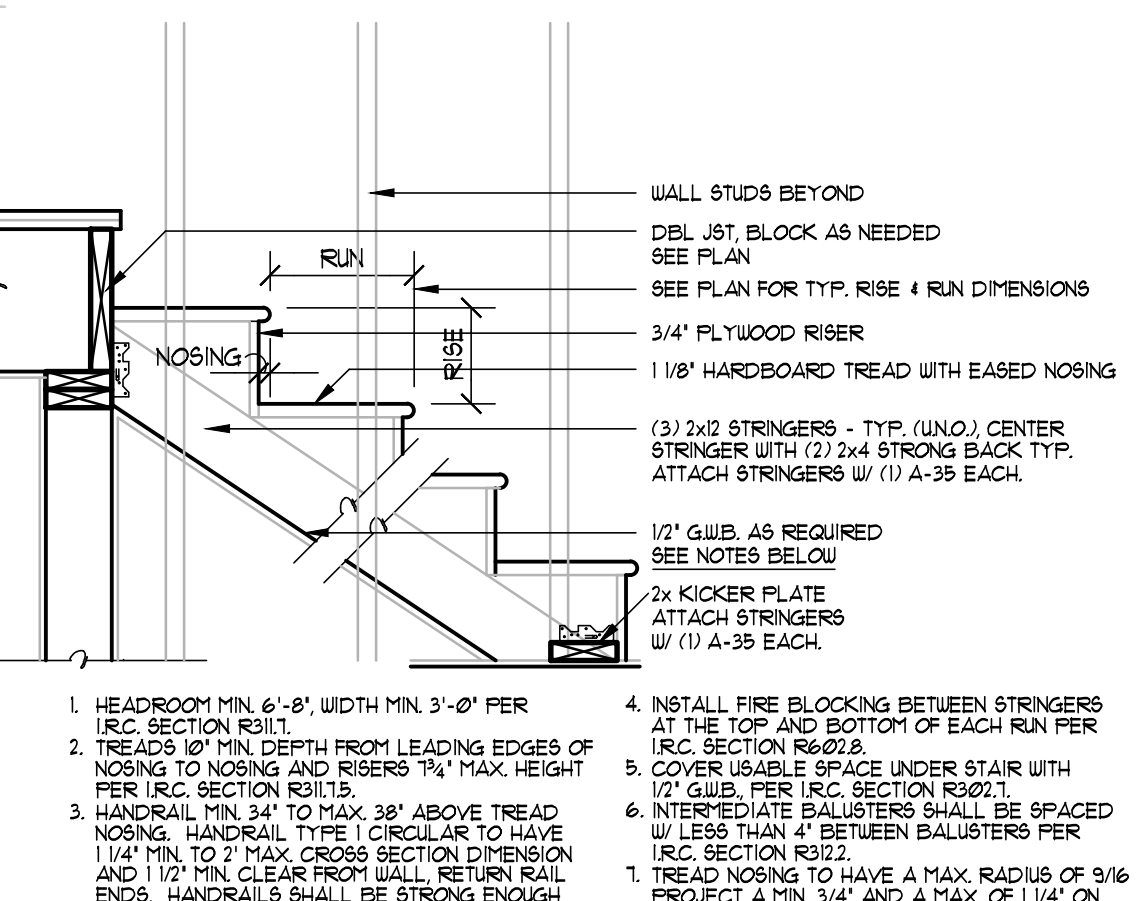

**4 STAIR SECTION DETAIL**  
3/4"=1'-0"

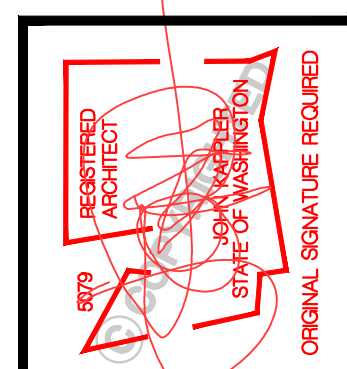

Date	By	Description
04/20/21	SM	PERMIT SET
07/22/21	SM	JURISDICTIONAL COMMENTS

Permit 2105-175  
**Pratt Plat**  
Lot 2  
7921 SE 72nd PL  
Mercer Island, WA 98040  
THIS DRAWING IS © COPYRIGHTED ARCHITECTURAL INNOVATIONS, P.S. ALL RIGHTS RESERVED

ARCHITECTURAL INNOVATIONS, P.S.  
Forward Thinking Design Solutions For Your Environment  
14311 SE 16th St  
Bellevue, WA 98007  
1-800-888-4517  
www.kapellchanceplans.com

Reviewed  
Kolke Consulting Group, Inc.  
C. Kolke  
07/30/2021

TITLE
JOB NO.: 1903521
STARTING NO.: 1903505

SHEET  
**D1**

08100-07300-01

08300-07100-01


08100-03300-21\_CUT

08100-05300-06\_CUT

07300-08100-01

08200-08100-01



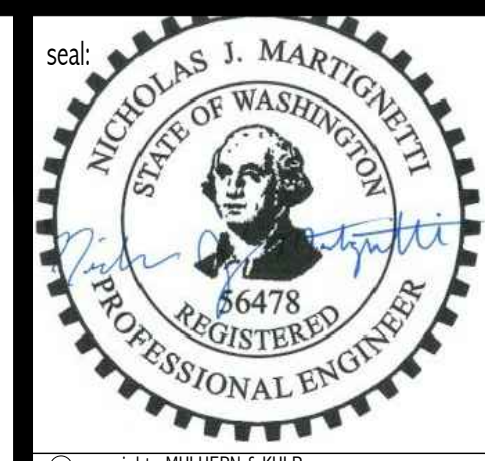

© copyright: MULHERN+KULP Structural Engineering, Inc.



M&K project number:  
**203-20001**

project mgr: **NJM**  
drawn by: **RJZ**  
issue date: **12-22-20**


REVISIONS:

date:	initial:
07/15/21	RJD
UPDATED SHEET:	


ARCHITECTURAL  
INNOVATIONS

STRUCTURAL DETAILS  
**PRATT PLOT - LOT 2**  
**7233 80TH AVE SE**  
MERCER ISLAND, WASHINGTON


sheet:  
**LB-1**

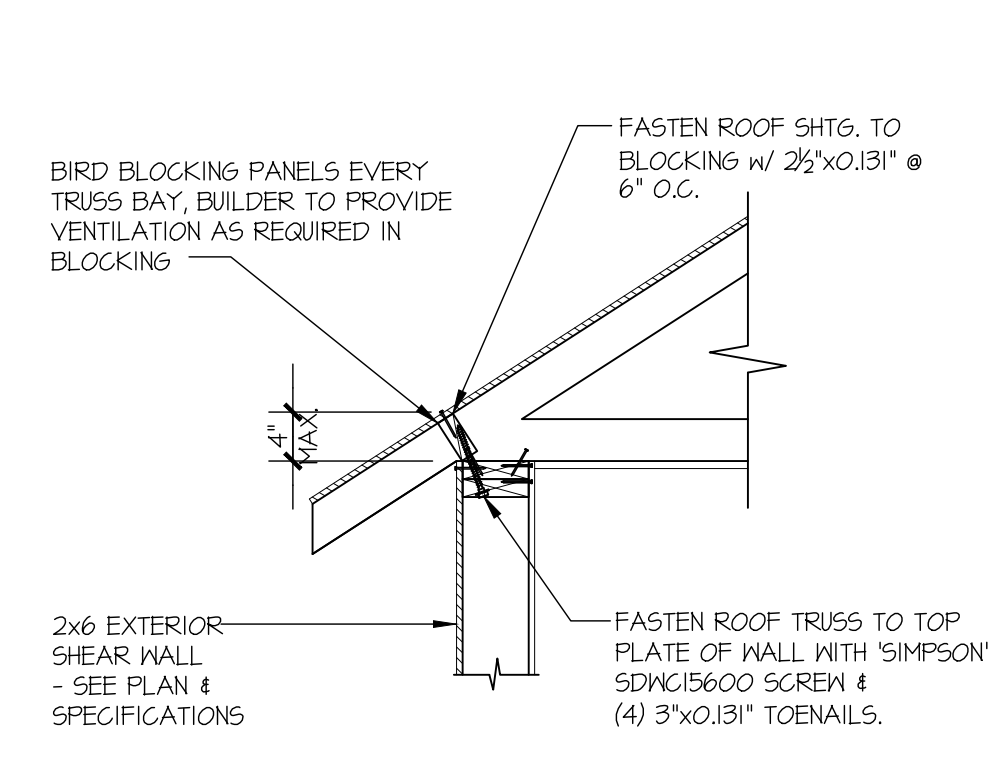


**1** TYPICAL SHEAR TRANSFER DETAIL @ ROOF  
SCALE: 3/4"=1'-0" HEEL HEIGHT LESS THAN 4"

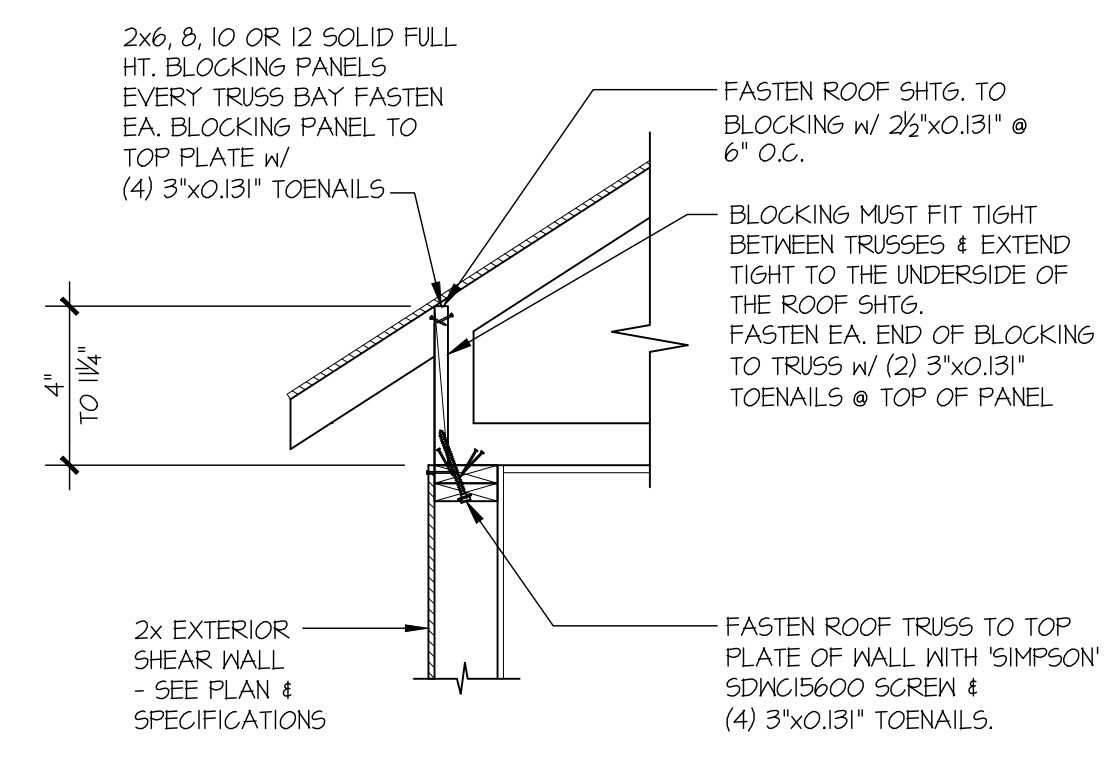


**2** TYPICAL SHEAR TRANSFER DETAIL @ ROOF  
SCALE: 3/4"=1'-0" HEEL HEIGHT BETWEEN 4" - 11 1/2"

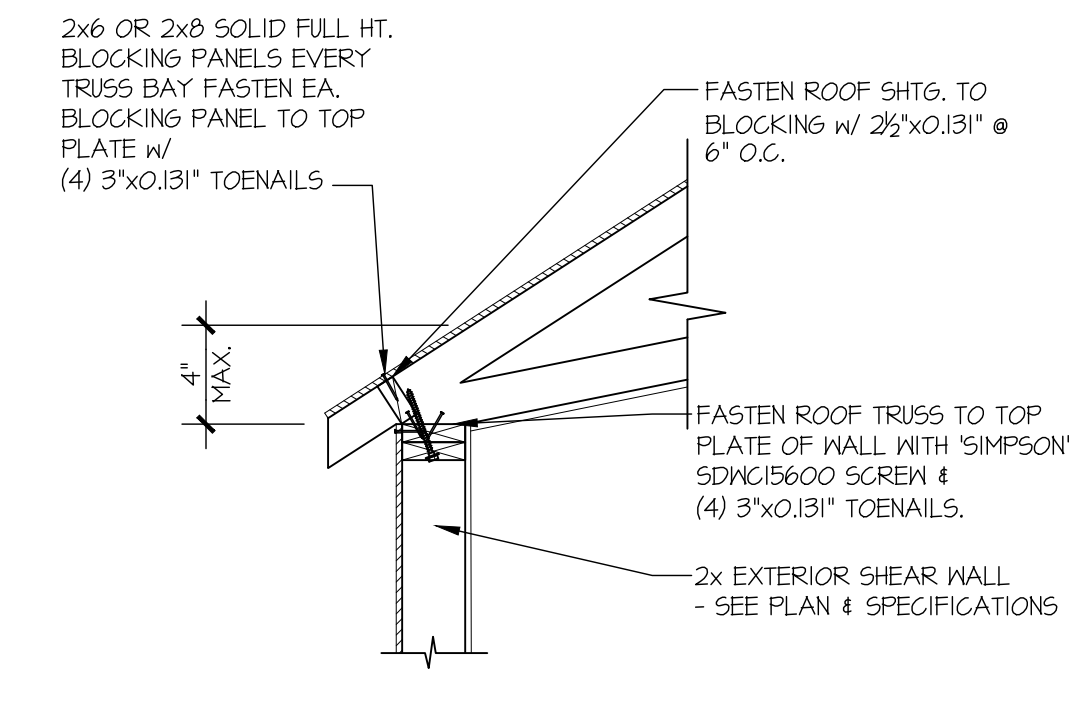


**1A** TYPICAL SHEAR TRANSFER DETAIL @ VAULTED CEILING  
SCALE: 3/4"=1'-0"

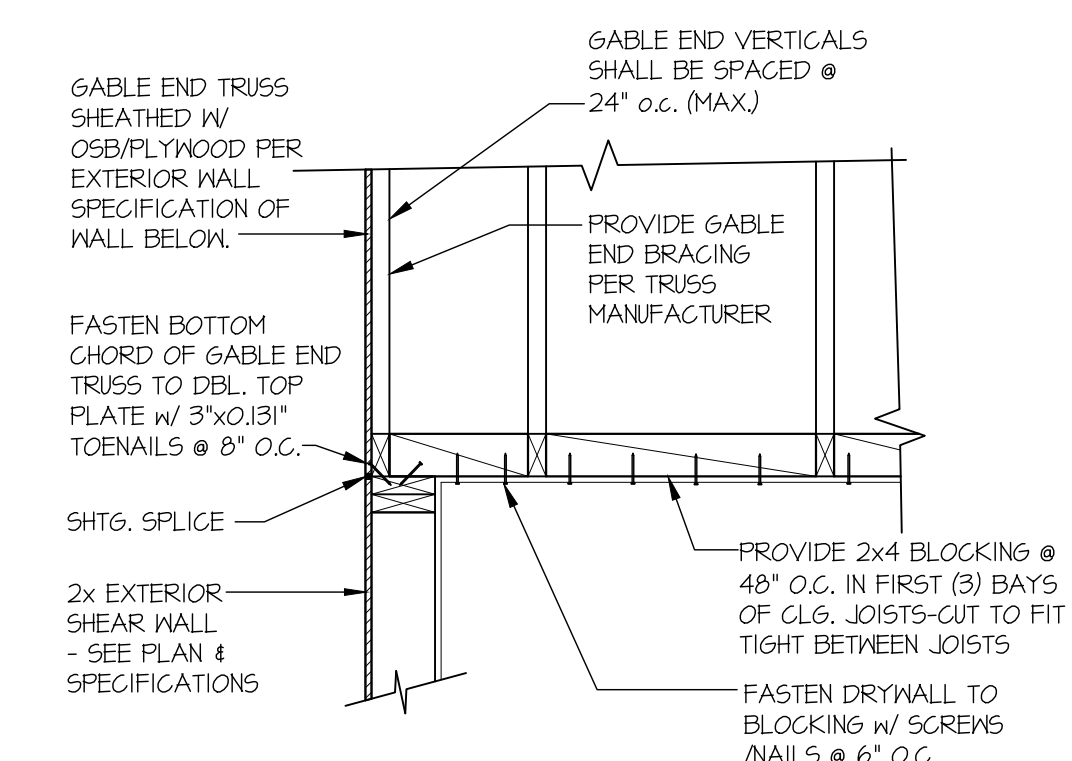


**2** TYPICAL GABLE END DETAIL  
SCALE: 3/4"=1'-0"

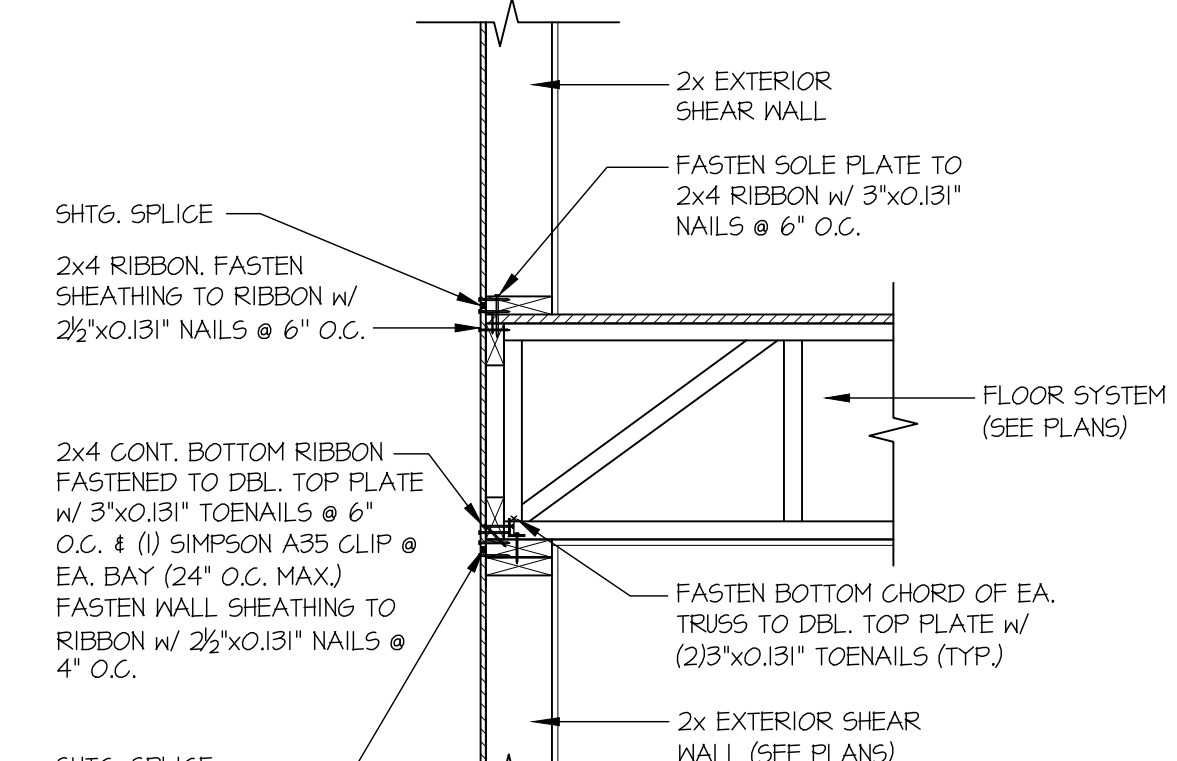


**3** TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ EXTERIOR WALL  
SCALE: 3/4"=1'-0" PERPENDICULAR FRAMING

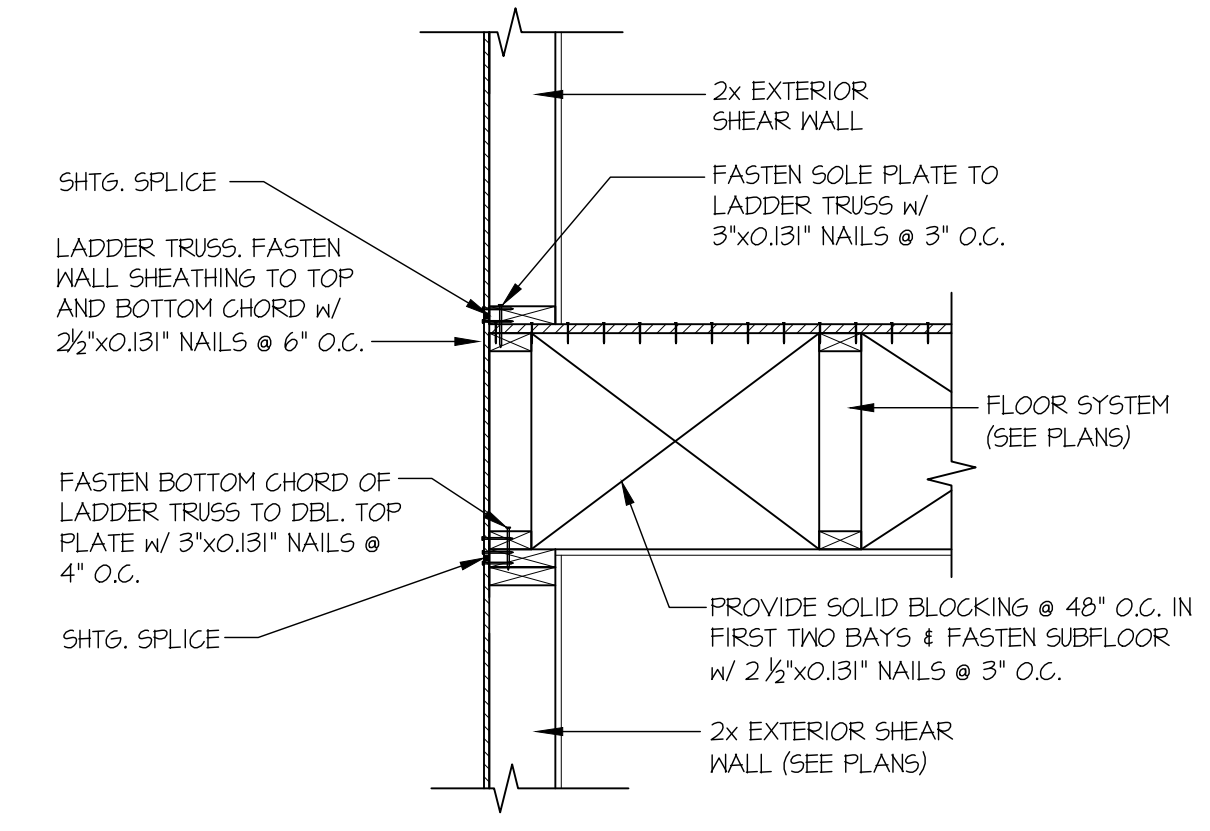


**4** TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ EXTERIOR WALL  
SCALE: 3/4"=1'-0" PARALLEL FRAMING

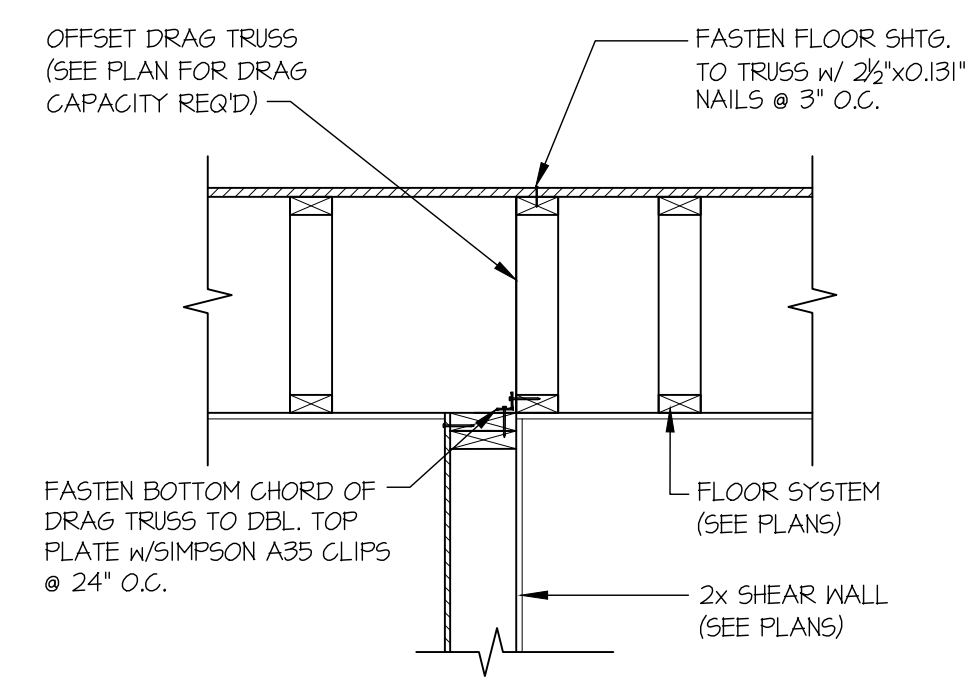


**12** SHEAR TRANSFER DETAIL @ SHEAR WALL BELOW  
SCALE: 3/4"=1'-0"

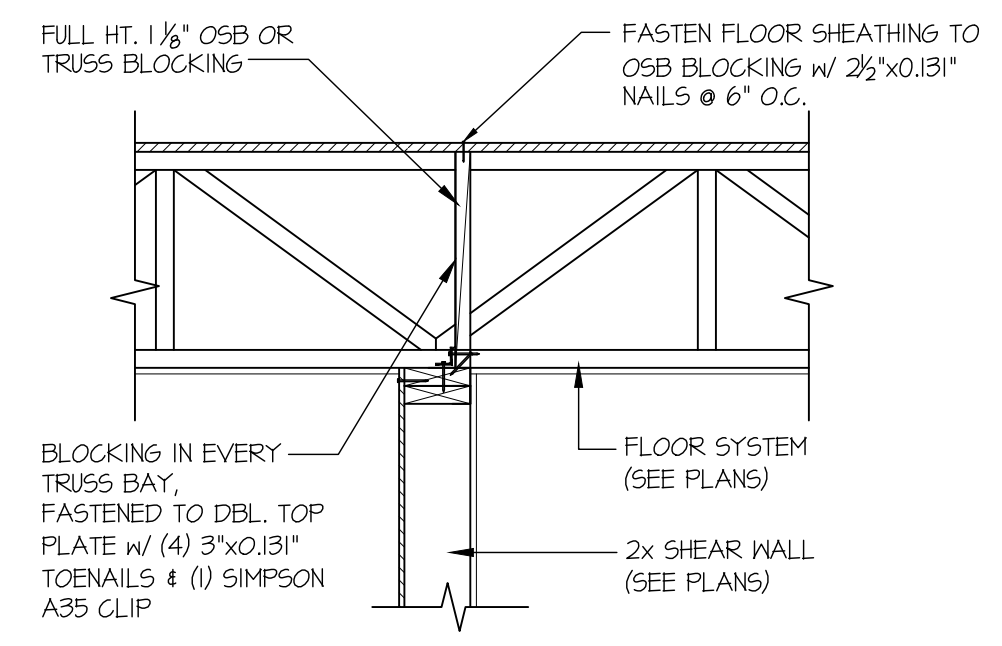


**13** SHEAR TRANSFER DETAIL @ SHEAR WALL BELOW  
SCALE: 3/4"=1'-0"

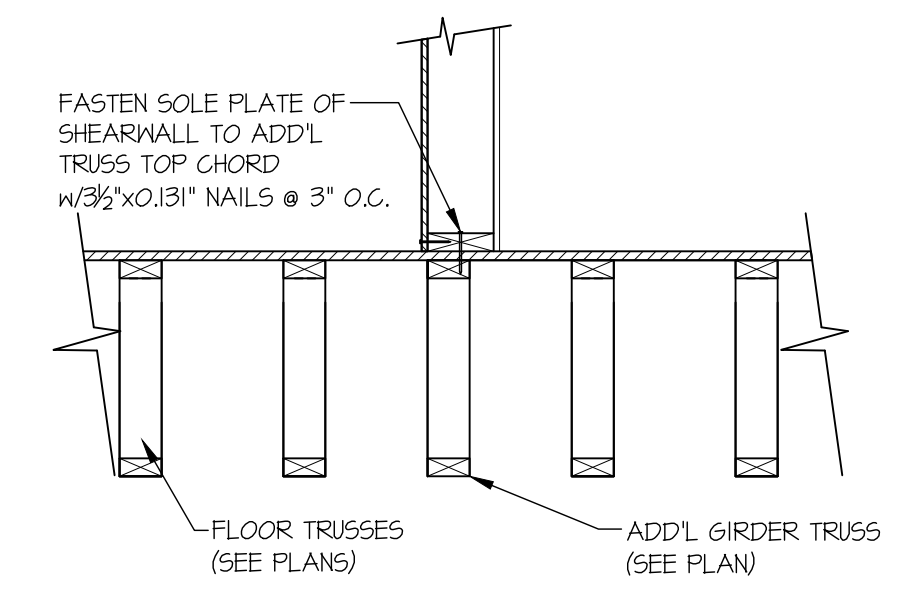


**19** SHEAR TRANSFER DETAIL @ INTERIOR SHEARWALL ABOVE  
SCALE: 3/4"=1'-0" PARALLEL FRAMING

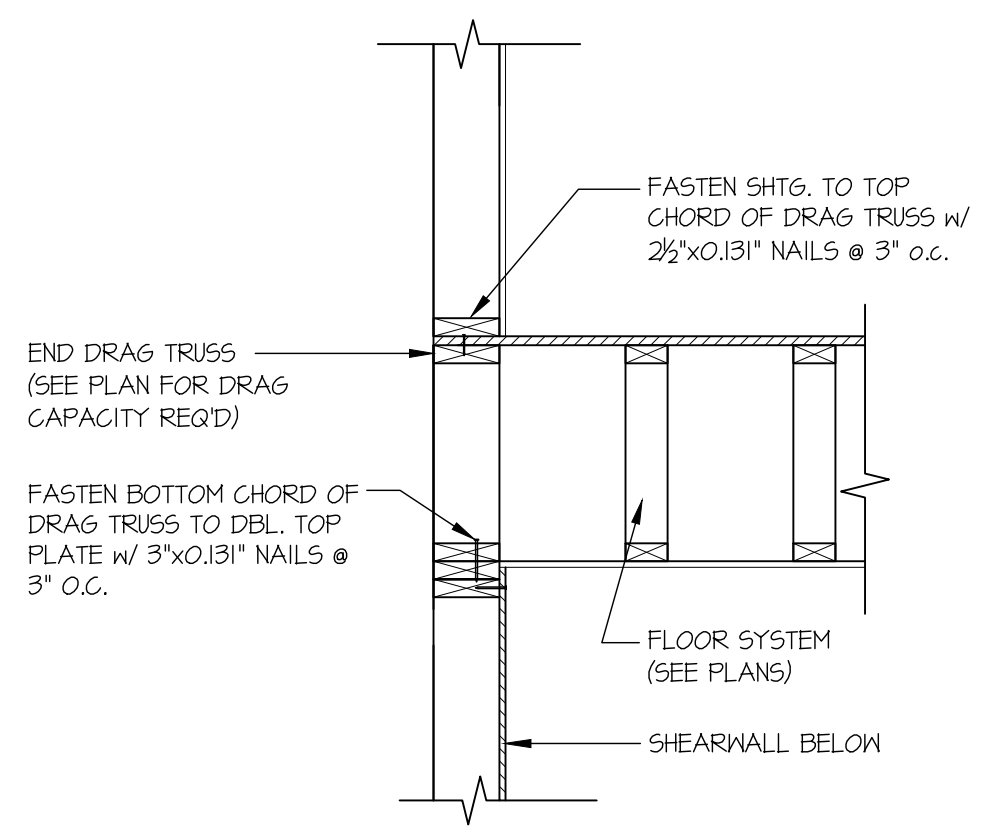


**22** TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ EXTERIOR WALL  
SCALE: 3/4"=1'-0"

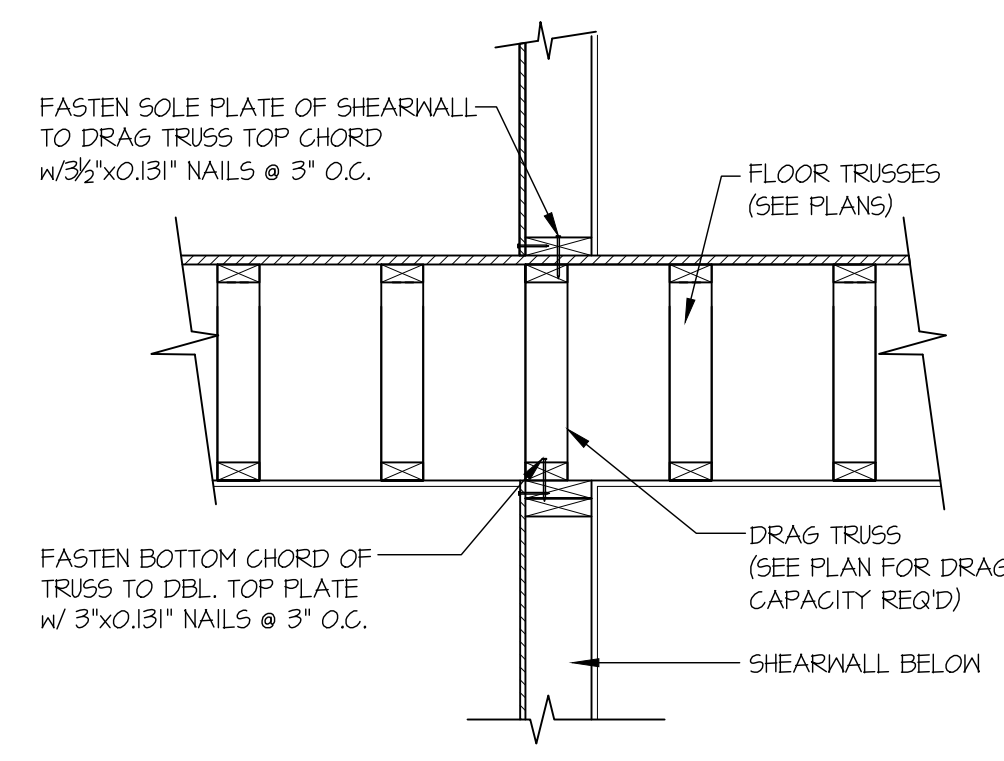

**23** SHEAR TRANSFER DETAIL @ INTERIOR SHEAR WALL  
SCALE: 3/4"=1'-0"

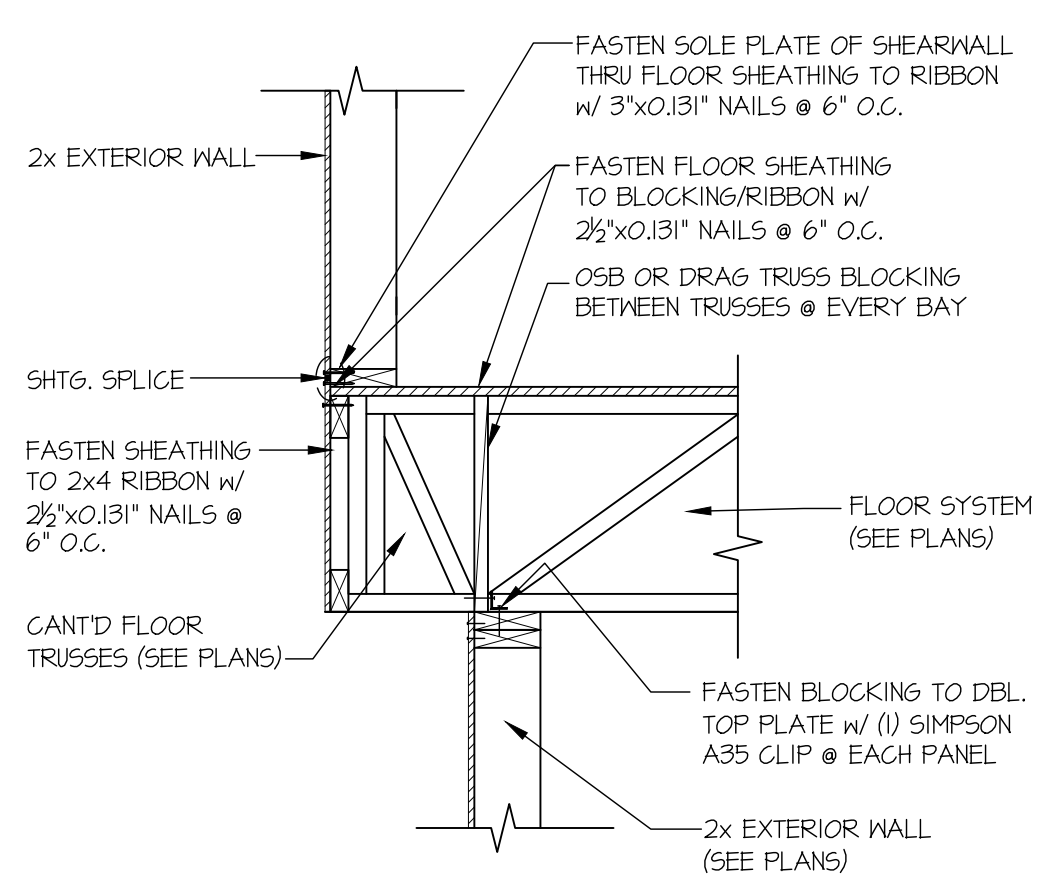


**31** SHEAR TRANSFER DETAIL BETWEEN FLOORS @ CANT'D EXT. WALL  
SCALE: 3/4"=1'-0"

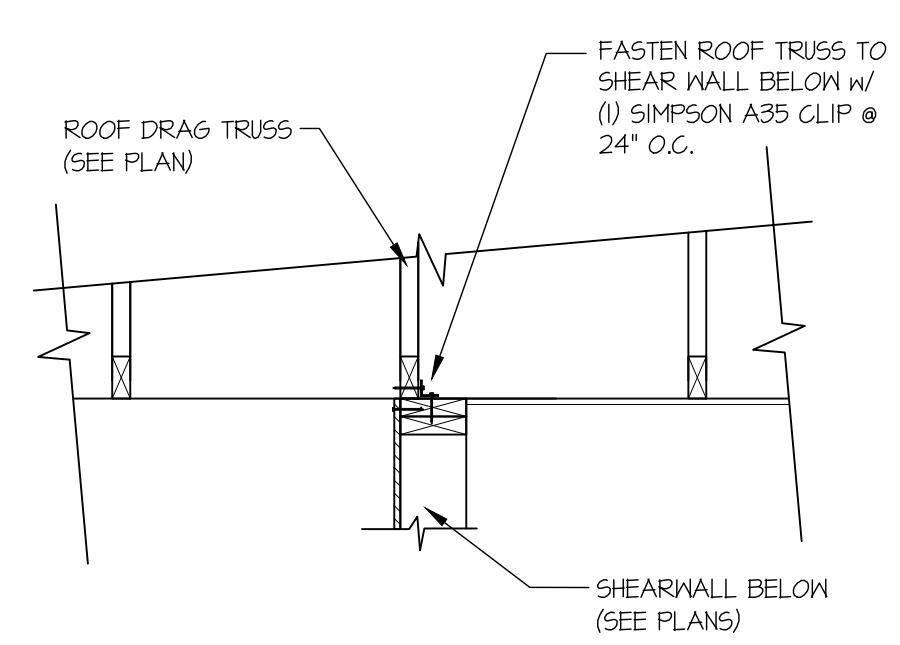


**47** SHEAR TRANSFER DETAIL @ INTERIOR SHEARWALL BELOW  
SCALE: 3/4"=1'-0"


Reviewed  
Kolke Consulting Group, Inc.  
C. Kolke  
07/30/2021

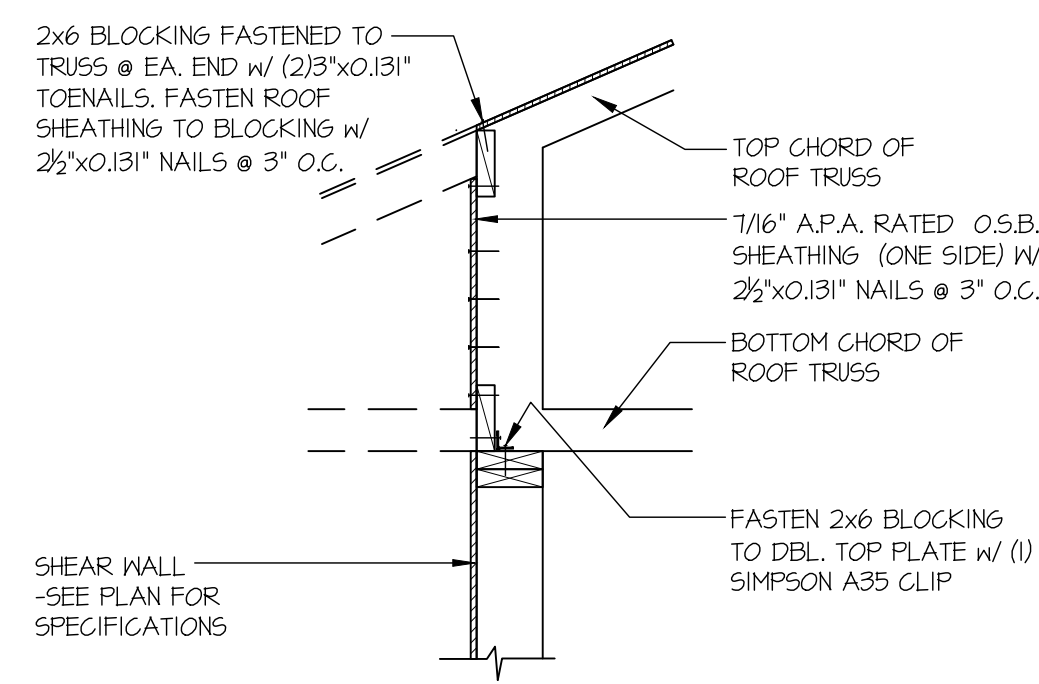


**49** SHEAR TRANSFER DETAIL @  
 SHEARWALL BELOW  
 SCALE: 3/4"=1'-0"

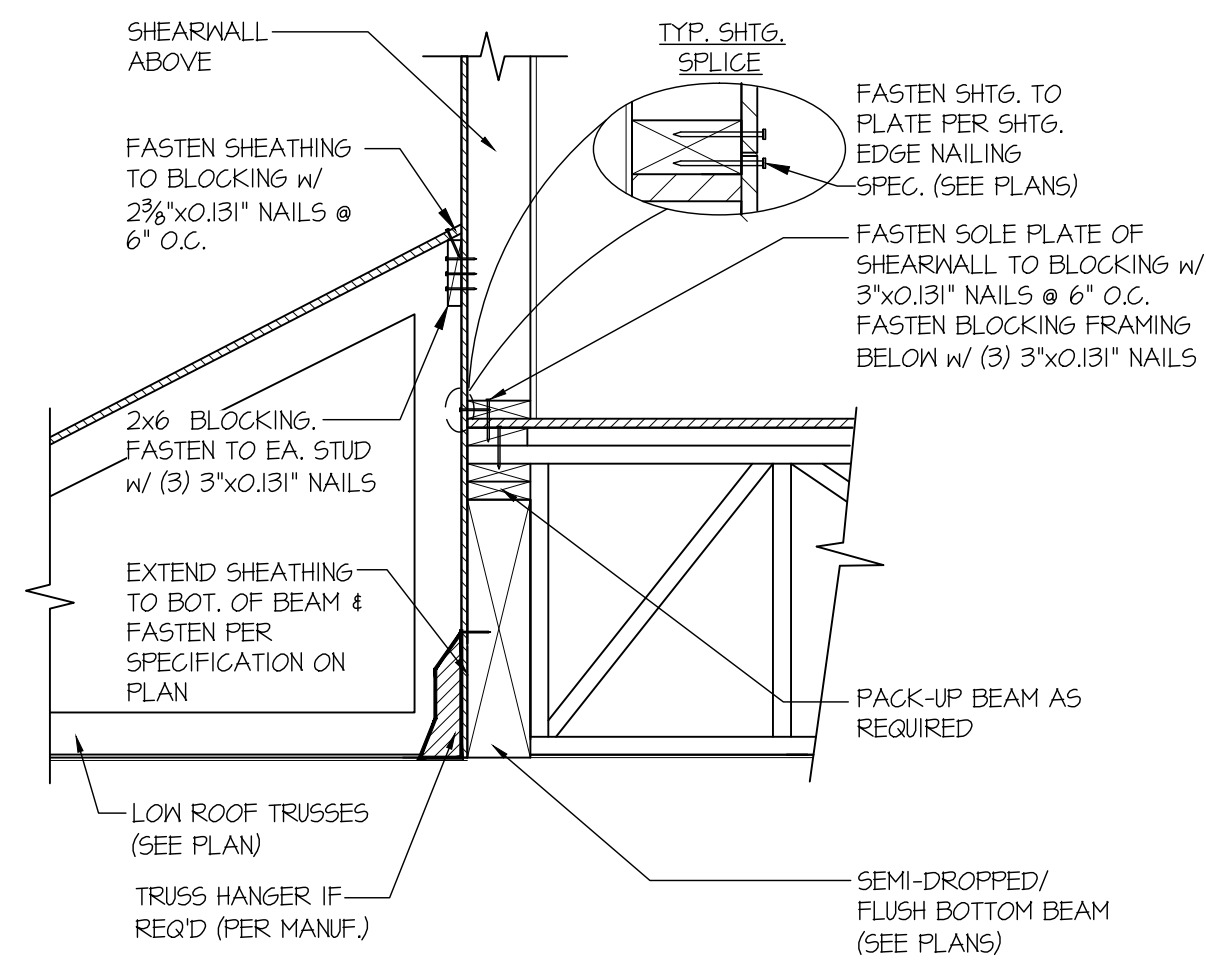


**58** SHEAR TRANSFER DETAIL @  
 EXTERIOR SHEARWALL ABOVE  
 SCALE: 3/4"=1'-0"

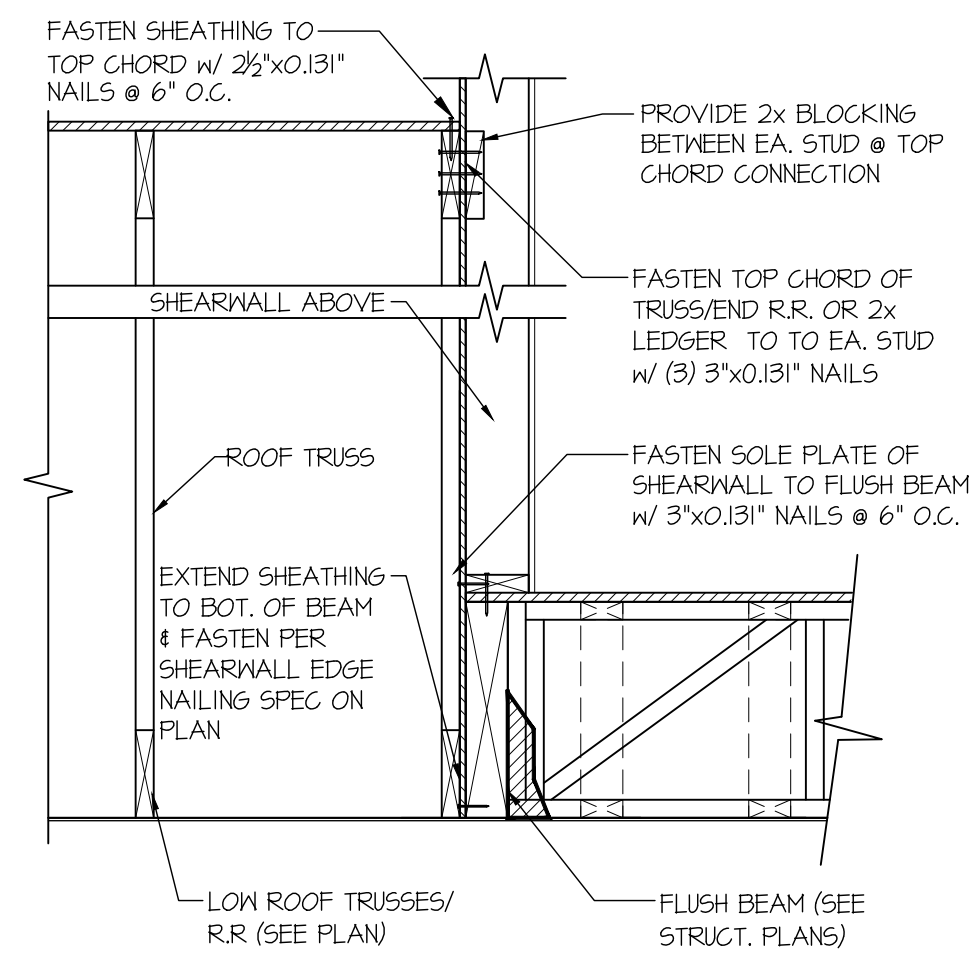


**59** SHEAR TRANSFER DETAIL @  
 EXTERIOR SHEARWALL ABOVE  
 SCALE: 3/4"=1'-0"

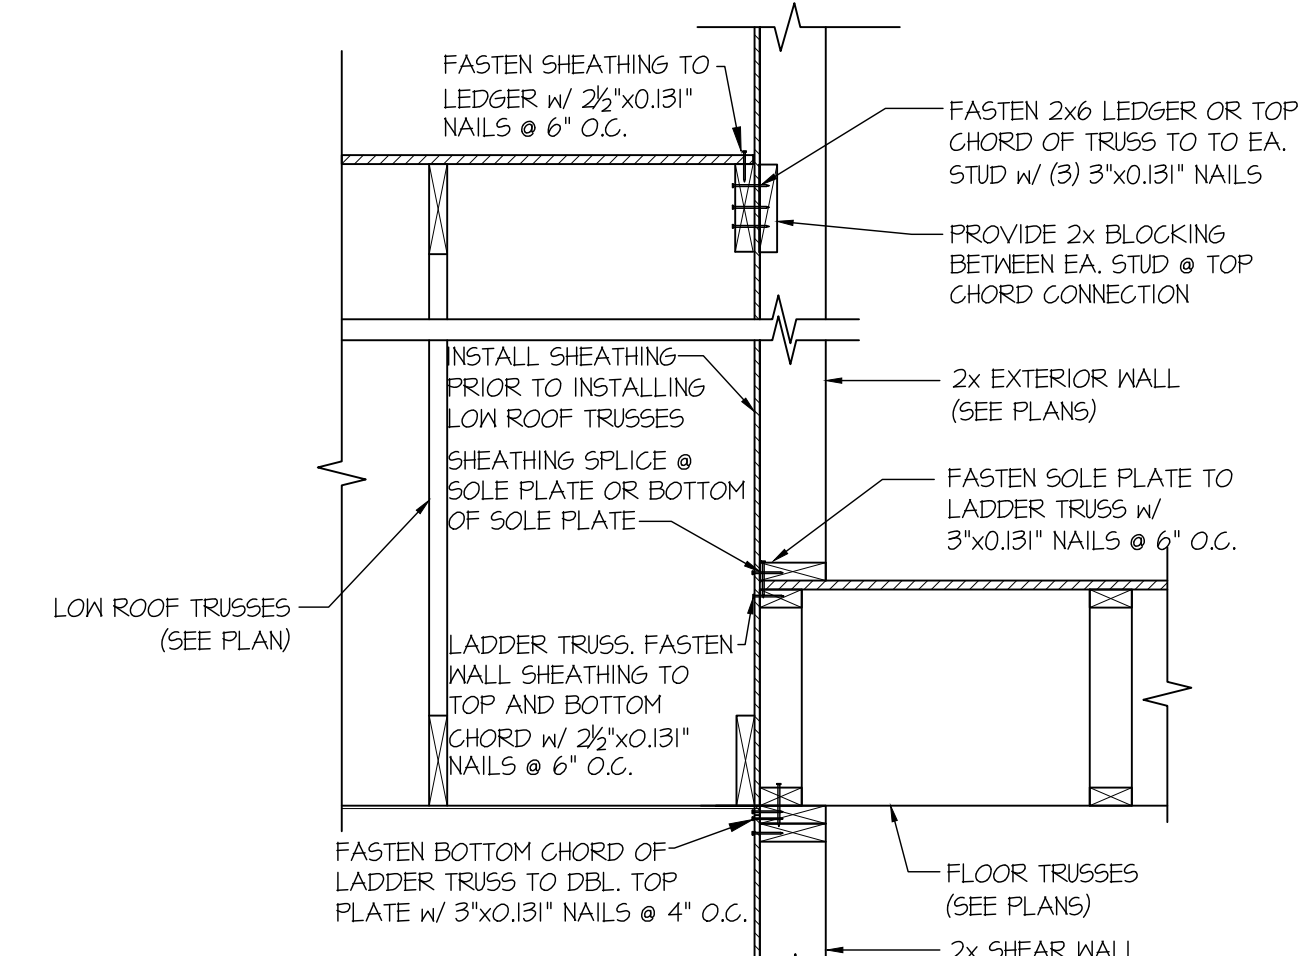


**62** TYPICAL SHEAR TRANSFER DETAIL  
 BETWEEN FLOORS @ INTERIOR WALL  
 SCALE: 3/4"=1'-0"

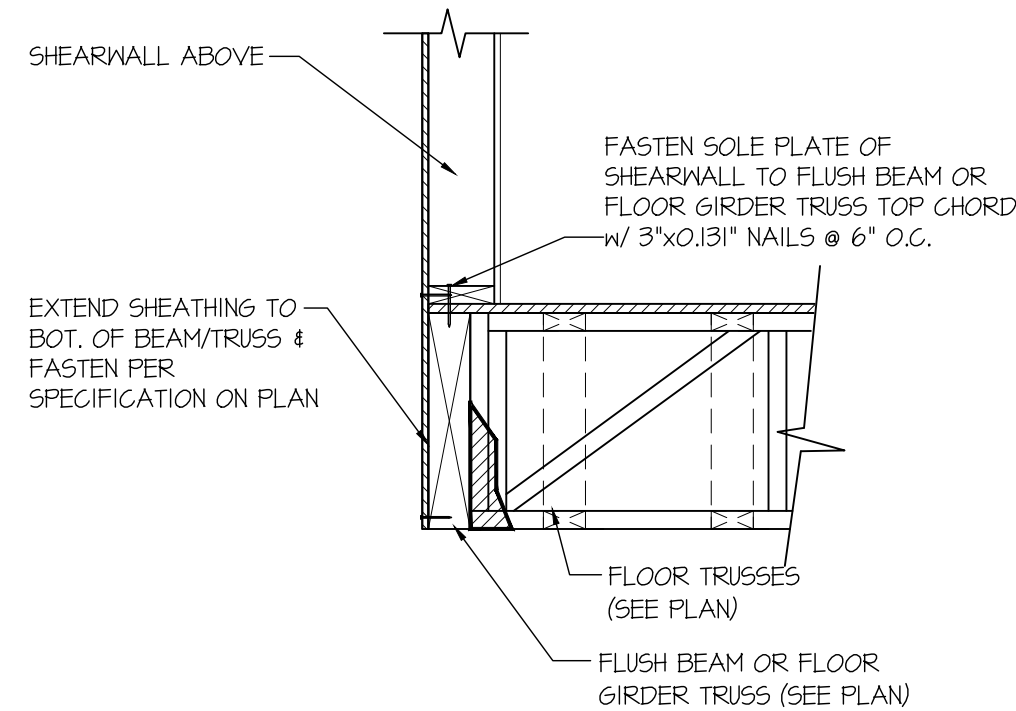


**74** SHEAR TRANSFER DETAIL @  
 EXTERIOR SHEARWALL ABOVE  
 SCALE: 3/4"=1'-0"

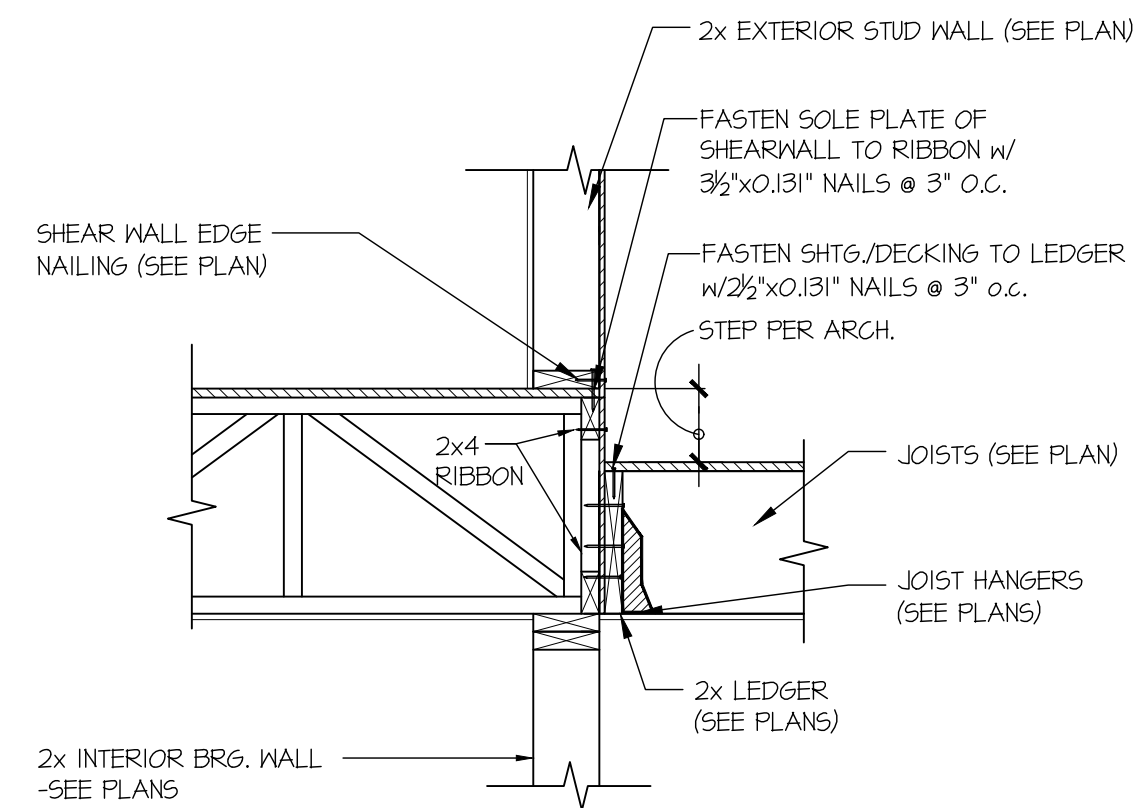


**79** TYPICAL SHEAR TRANSFER  
 DETAIL @ EXT. DECK FRAMING  
 SCALE: 3/4"=1'-0"

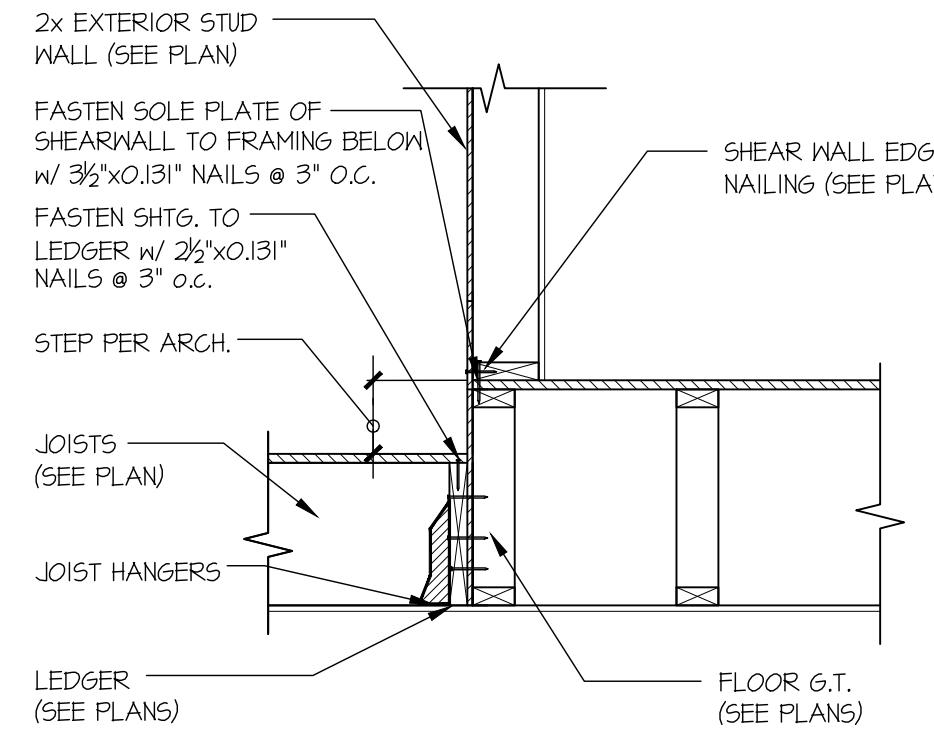


**80** TYPICAL SHEAR TRANSFER  
 DETAIL @ EXT. DECK FRAMING  
 SCALE: 3/4"=1'-0"

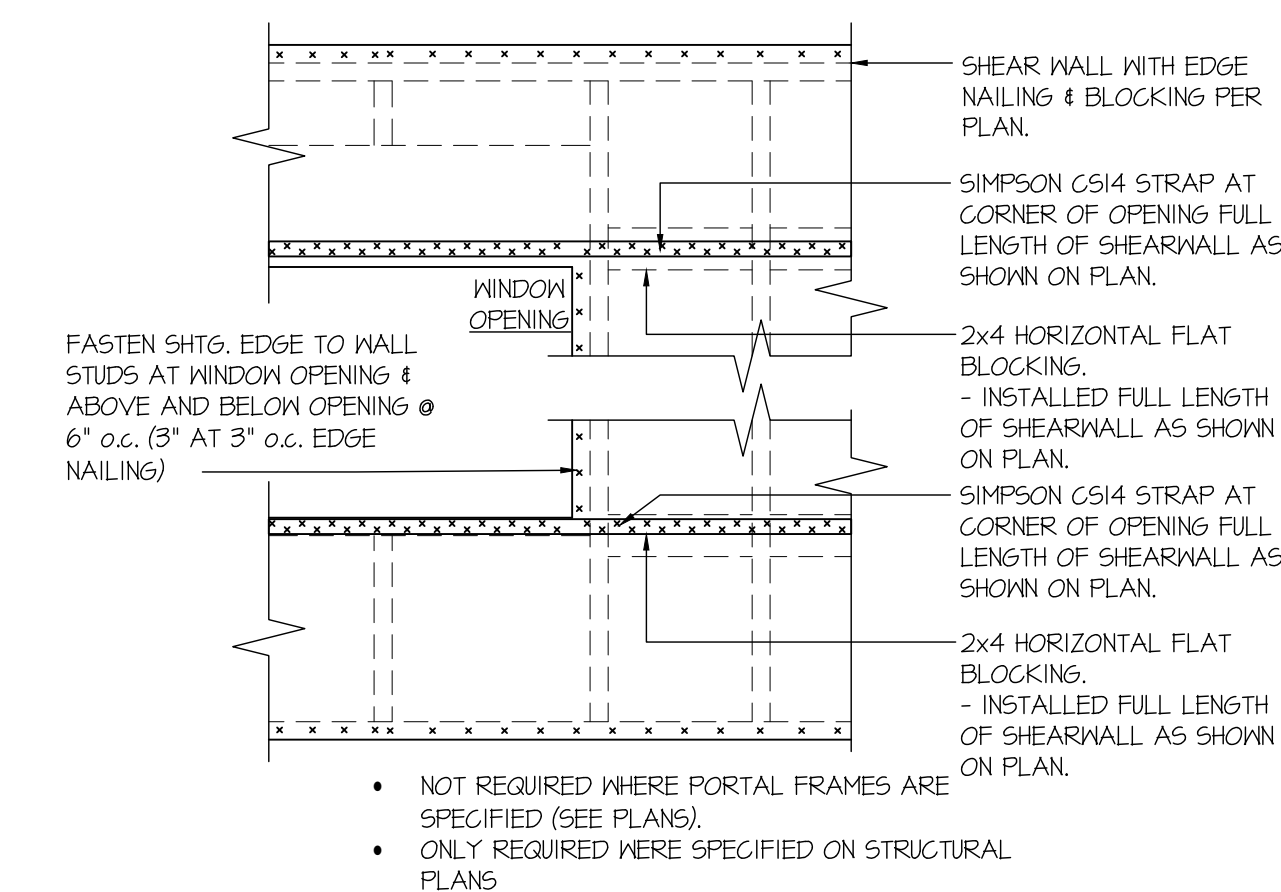


**93** EXT. WALL & INT. SHEARWALL  
 OPENING ELEVATION  
 SCALE: NTS

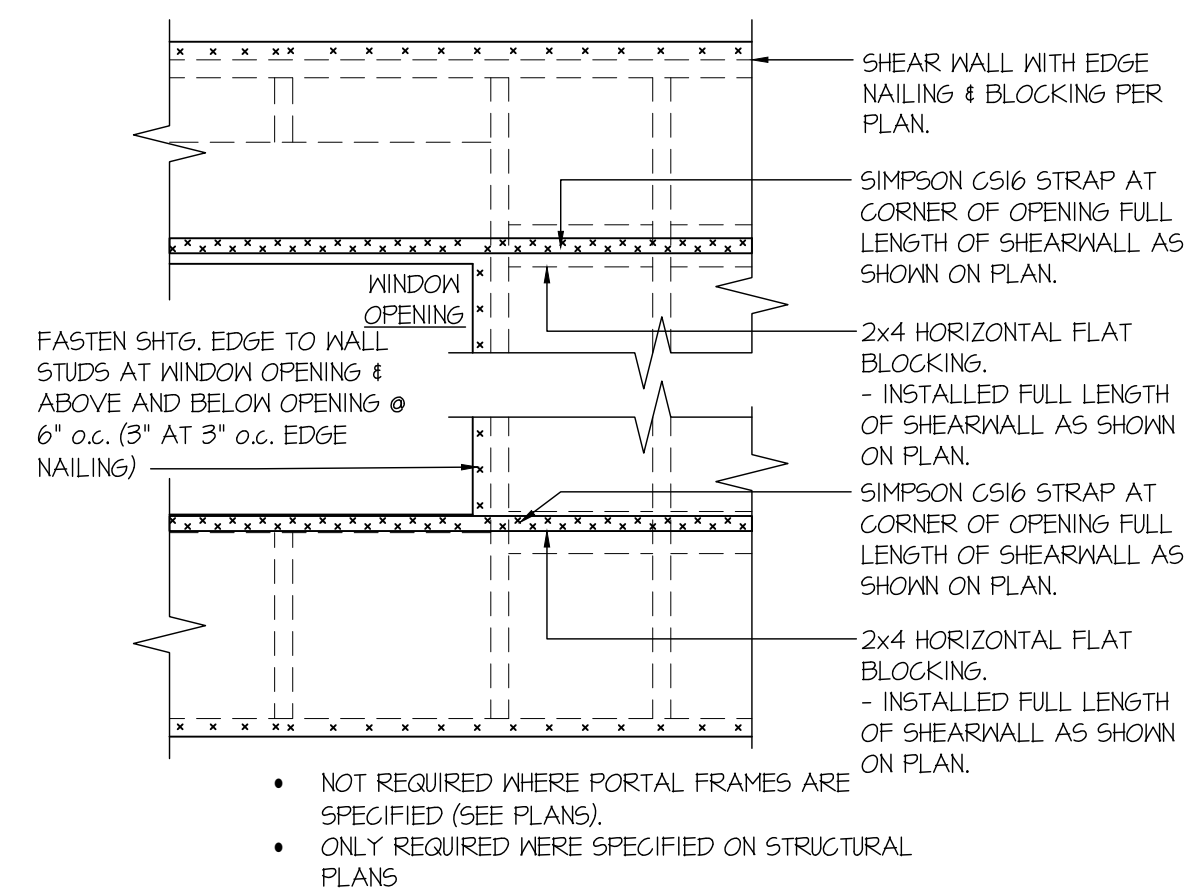


**94** EXT. WALL & INT. SHEARWALL  
 OPENING ELEVATION  
 SCALE: NTS

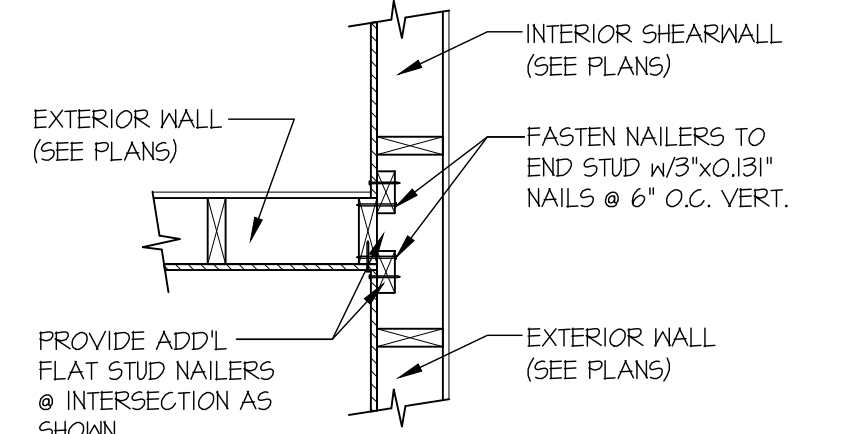


**95** SHEAR TRANSFER DETAIL @  
 INTERSECTING INT. SHEARWALL  
 SCALE: 3/4"=1'-0" SHTG. ON SAME FACE

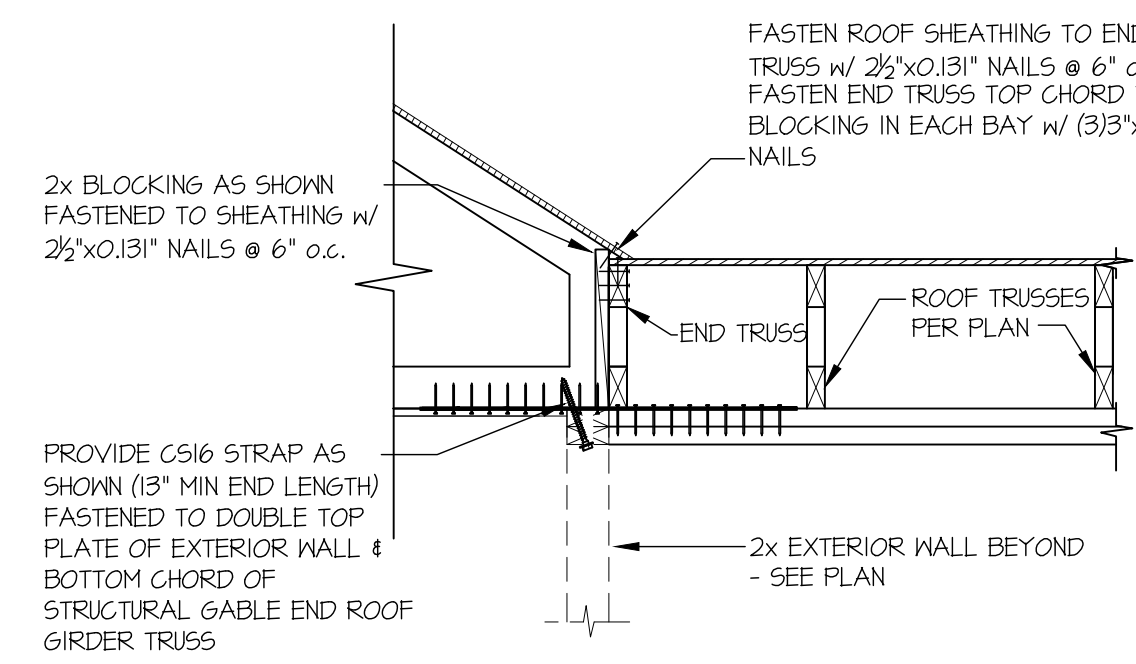

**117** STRAP DETAIL  
 SCALE: 3/4"=1'-0"

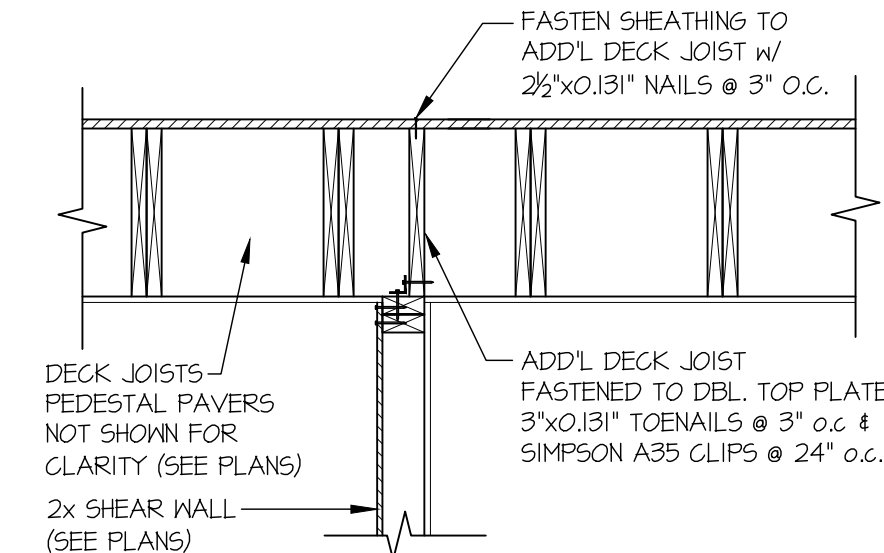

**118** SHEAR TRANSFER DETAIL  
 @ INTERIOR SHEAR WALL  
 SCALE: 3/4"=1'-0"

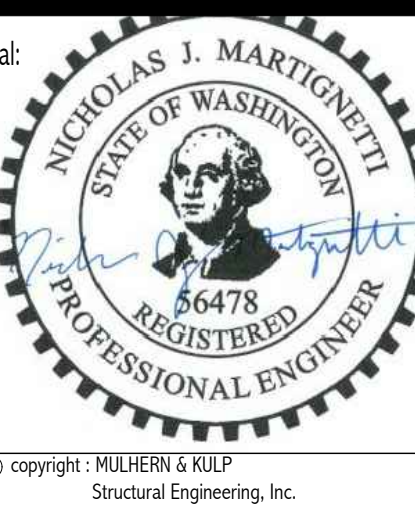

**MULHERN+KULP**  
RESIDENTIAL STRUCTURAL ENGINEERING  
7720 Trade Street, Suite 350, San Diego, CA 92121  
p 619-550-0010 • mulhern+kulp.com

M&K project number:  
**203-20001**

project mgr: NJM  
drawn by: RJZ  
issue date: 12-22-20


REVISIONS:

date:	initial:
07/15/21	RJD
UPDATED SERIES:	


ARCHITECTURAL  
INNOVATIONS

STRUCTURAL DETAILS  
PRATT PLOT - LOT 2  
7233 80TH AVE SE  
MERCER ISLAND, WASHINGTON


sheet:  
**SD.01**

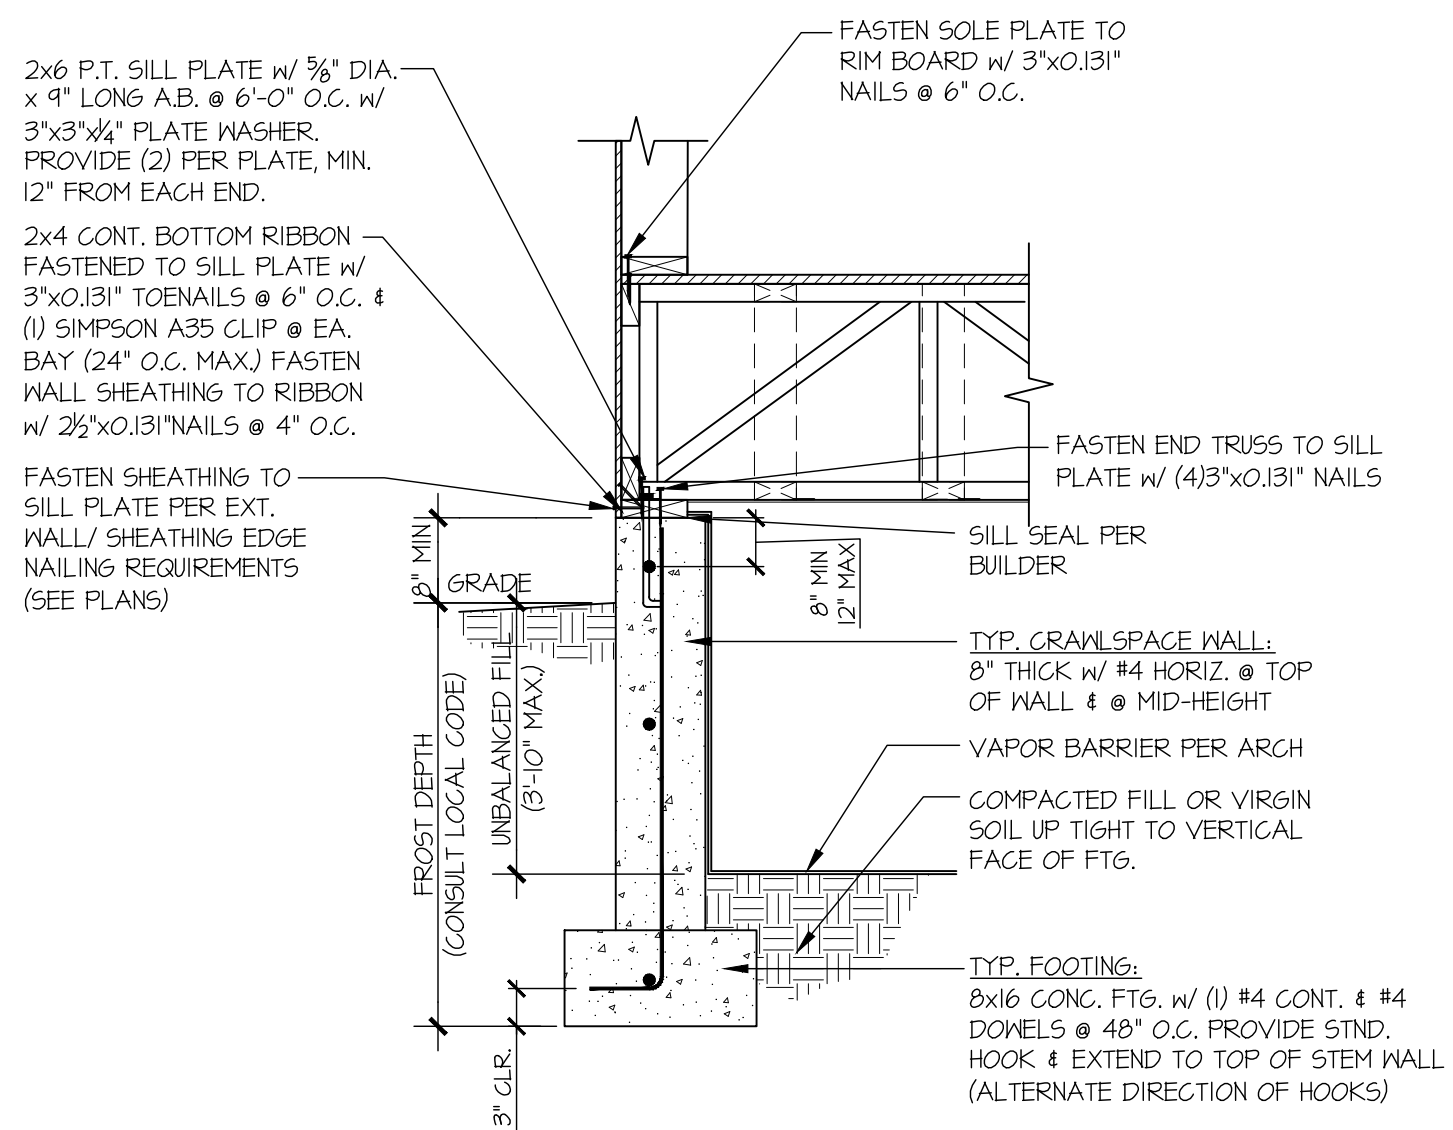


1 TYPICAL CRAWLSPACE FOUNDATION  
SCALE: 3/4"=1'-0"

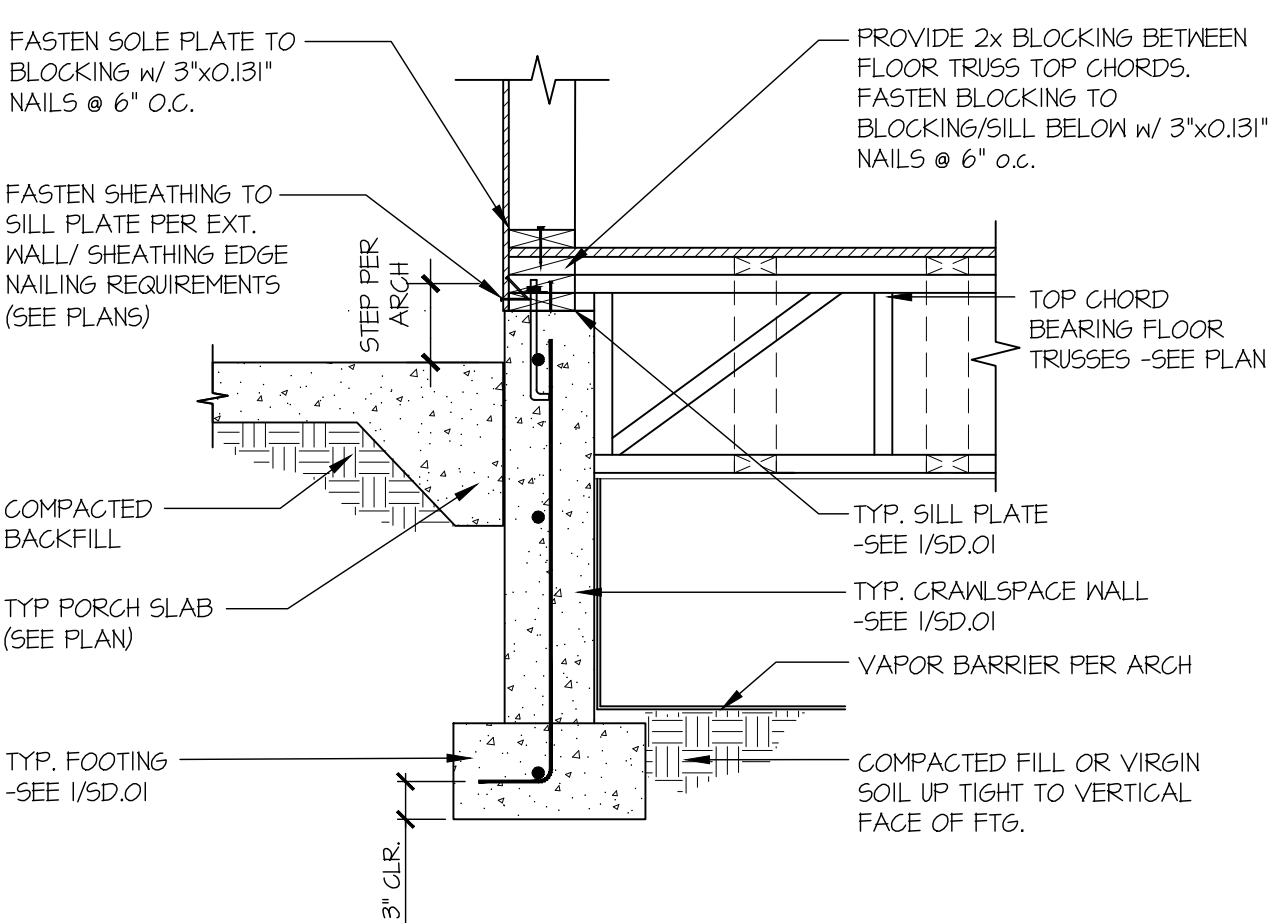


2 TYPICAL CRAWLSPACE FOUNDATION @ PORCH SLAB  
SCALE: 3/4"=1'-0"

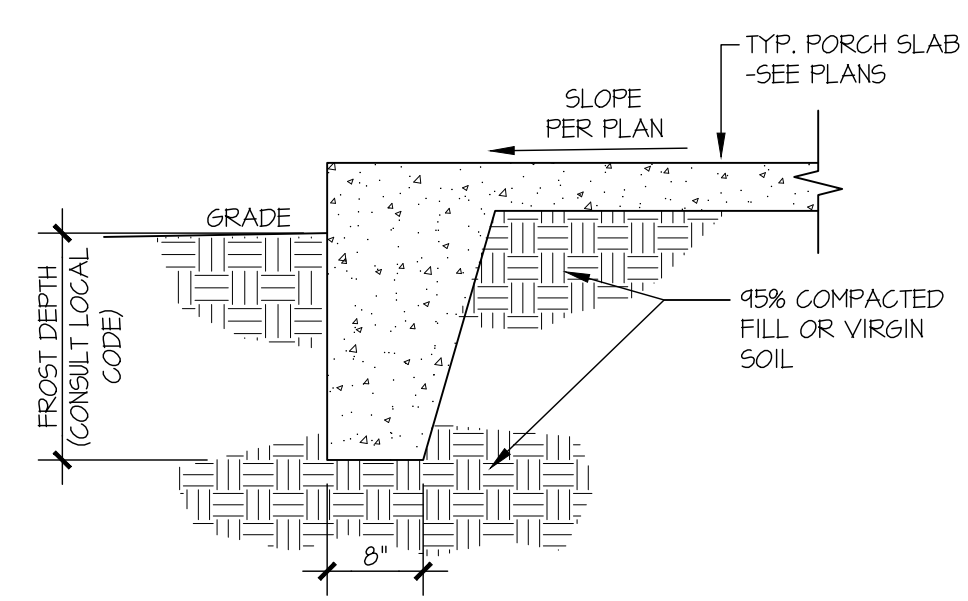


3 TYPICAL FOOTING @ PORCH SLAB  
SCALE: 3/4"=1'-0"

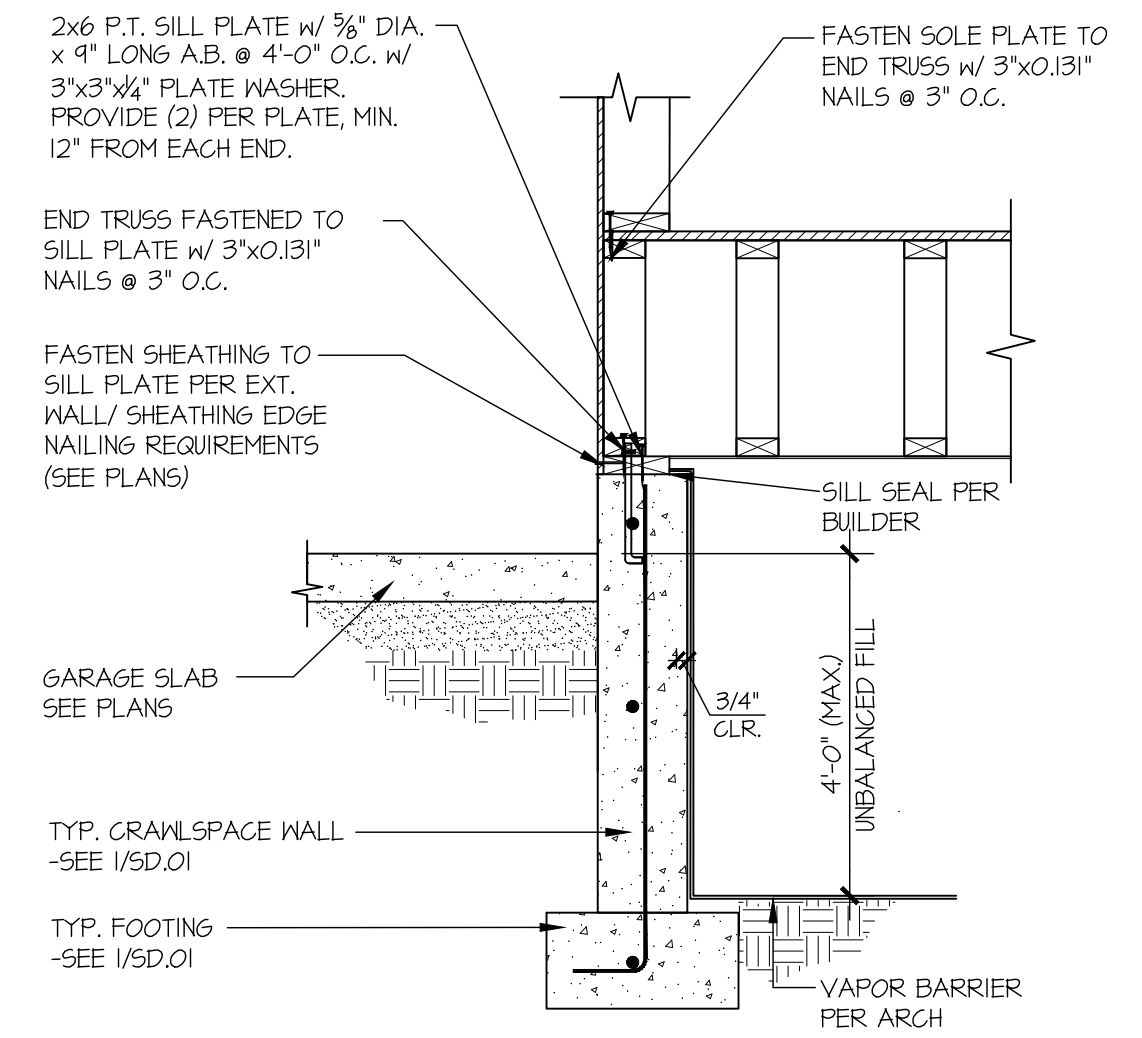


4 TYPICAL CRAWLSPACE FOUNDATION @ GARAGE SLAB  
SCALE: 3/4"=1'-0"

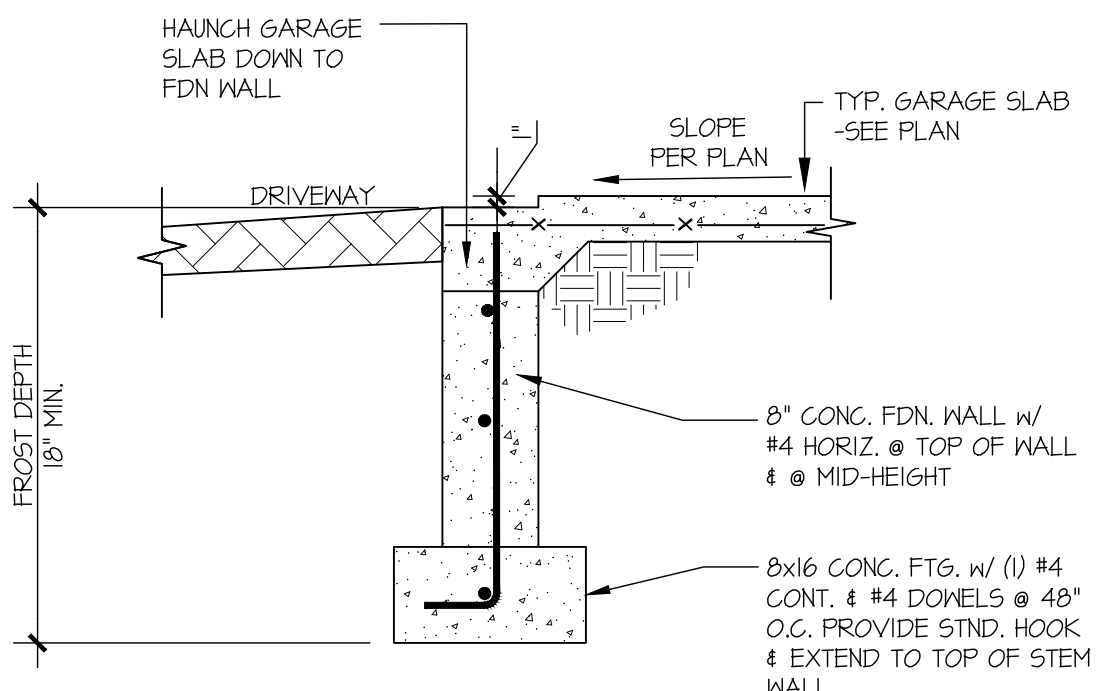


5 TYPICAL FOUNDATION @ GARAGE DOOR OPENING  
SCALE: 3/4"=1'-0"

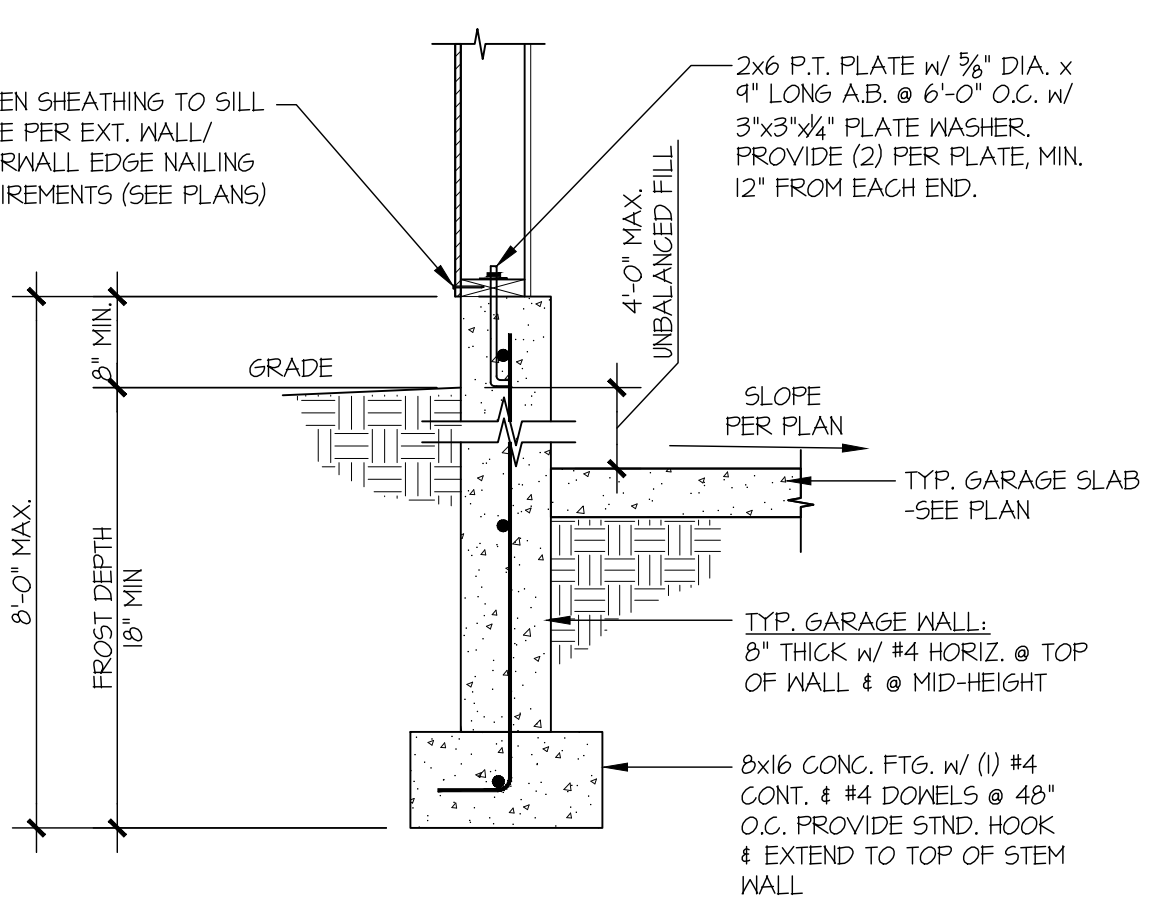


6 TYPICAL EXT. GARAGE FOUNDATION  
SCALE: 3/4"=1'-0"

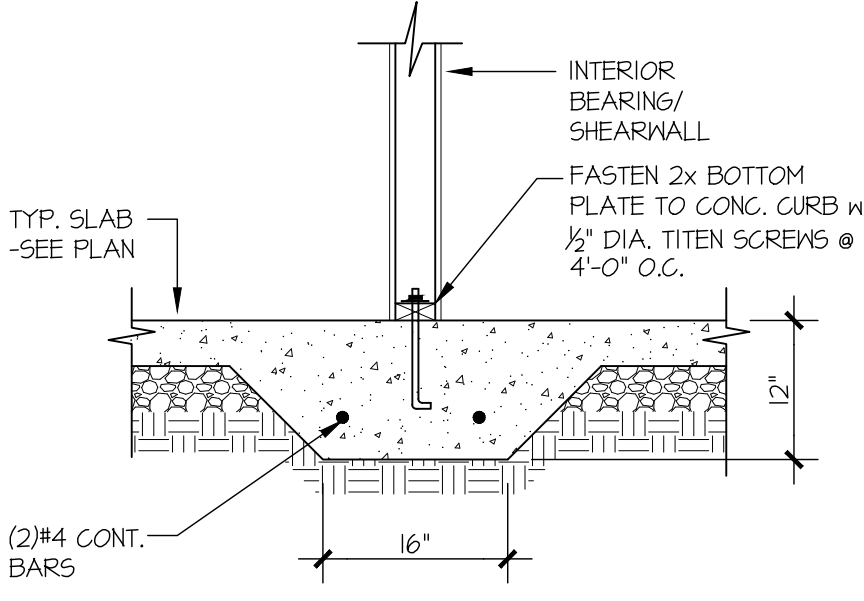


7 TYPICAL THICKENED SLAB @ INTERIOR BEARING WALL  
SCALE: 3/4"=1'-0"

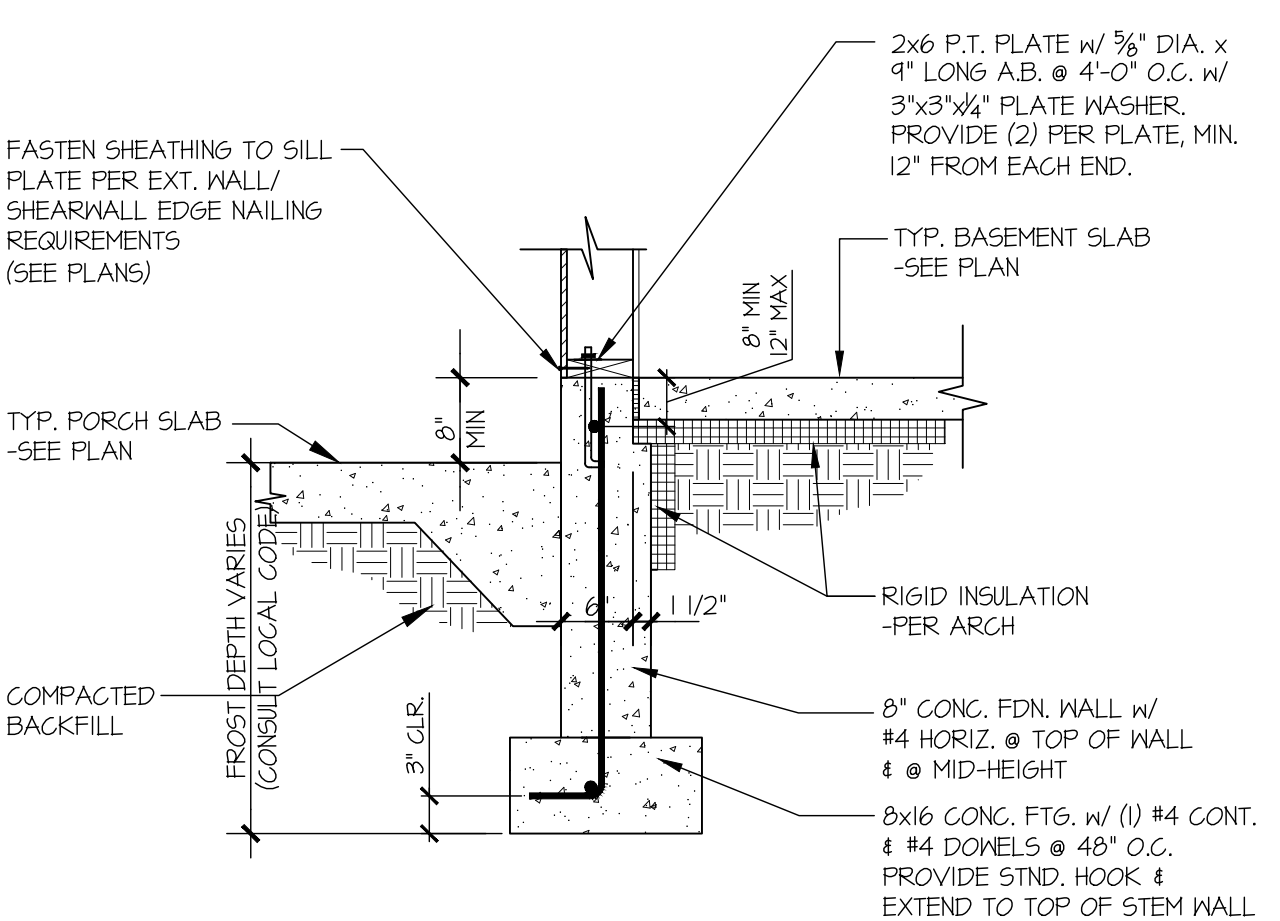


8 TYPICAL FOOTING @ WALKOUT BASEMENT  
SCALE: 3/4"=1'-0"

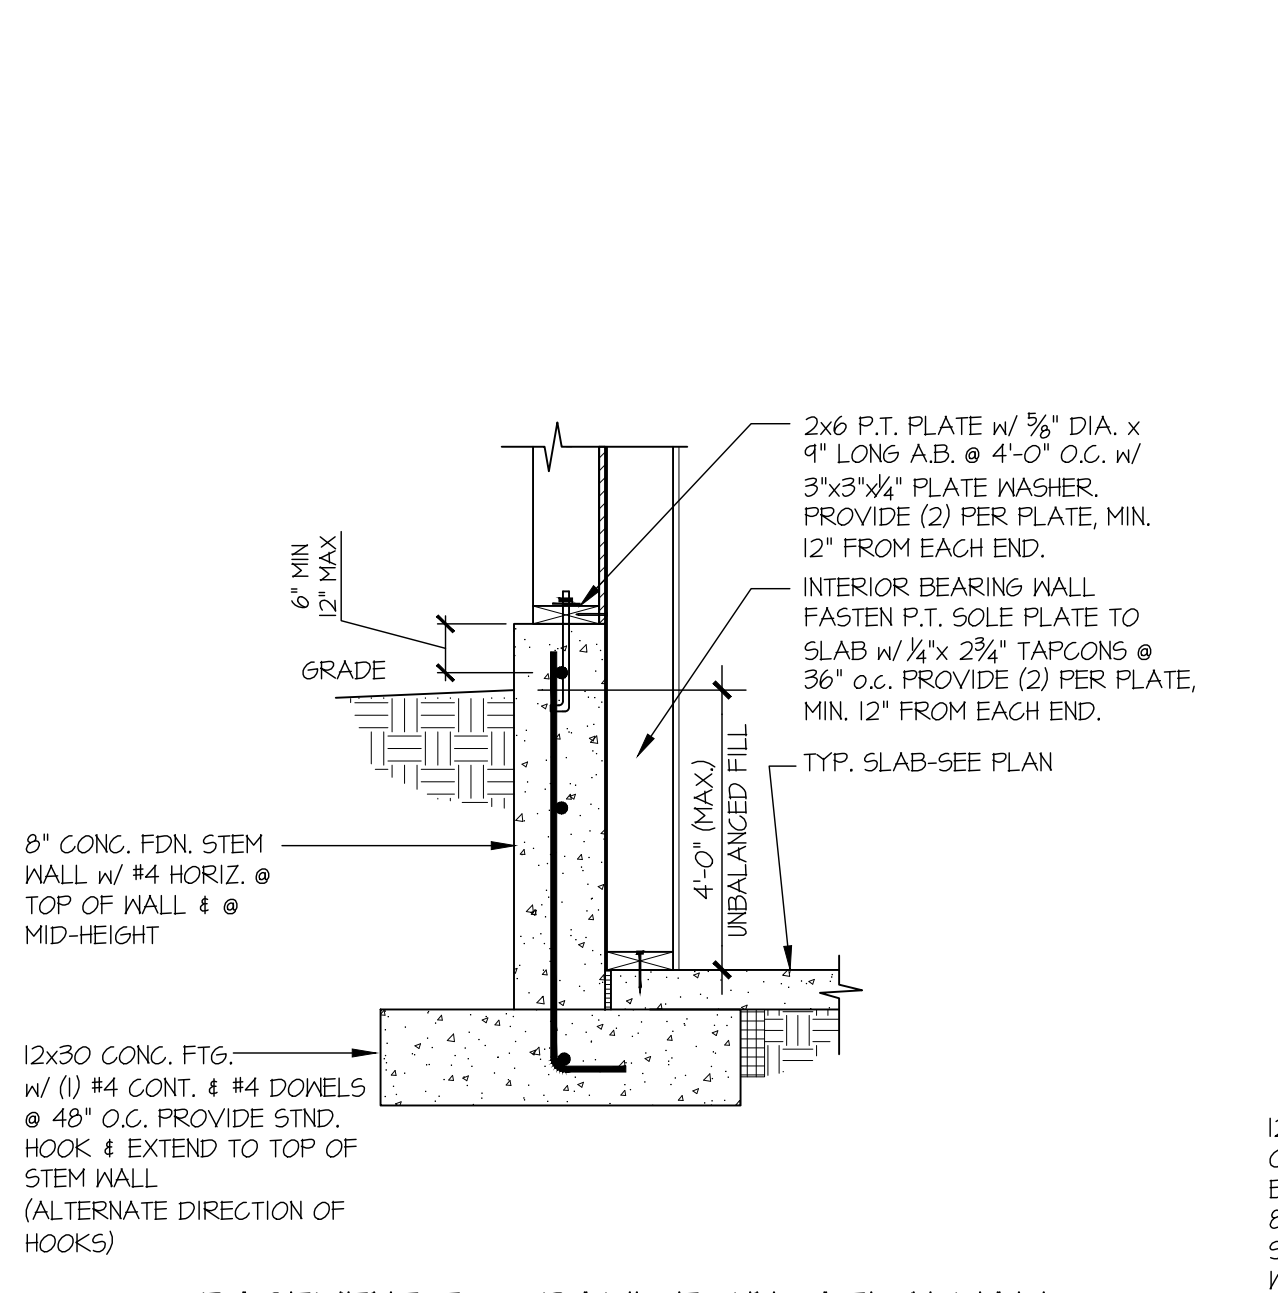


9 BASEMENT TO CRAWL FOUNDATION WALL  
SCALE: 3/4"=1'-0"

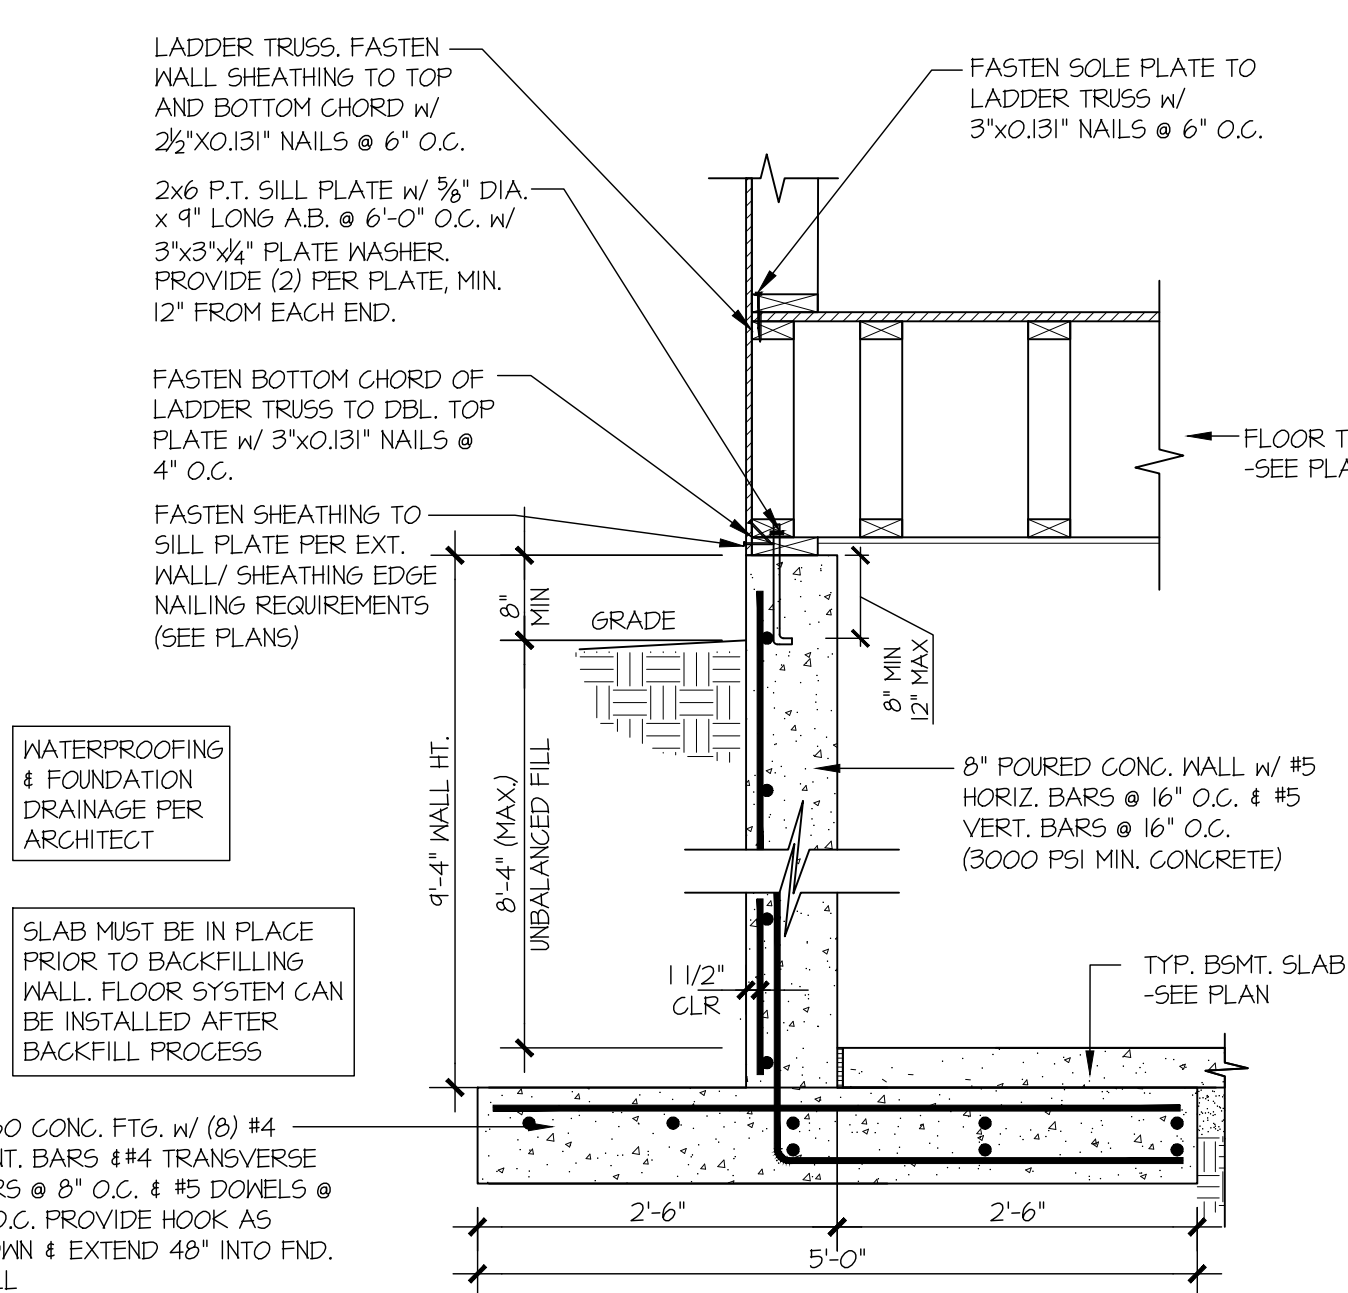

10 BASEMENT FOUNDATION WALL  
SCALE: 3/4"=1'-0"

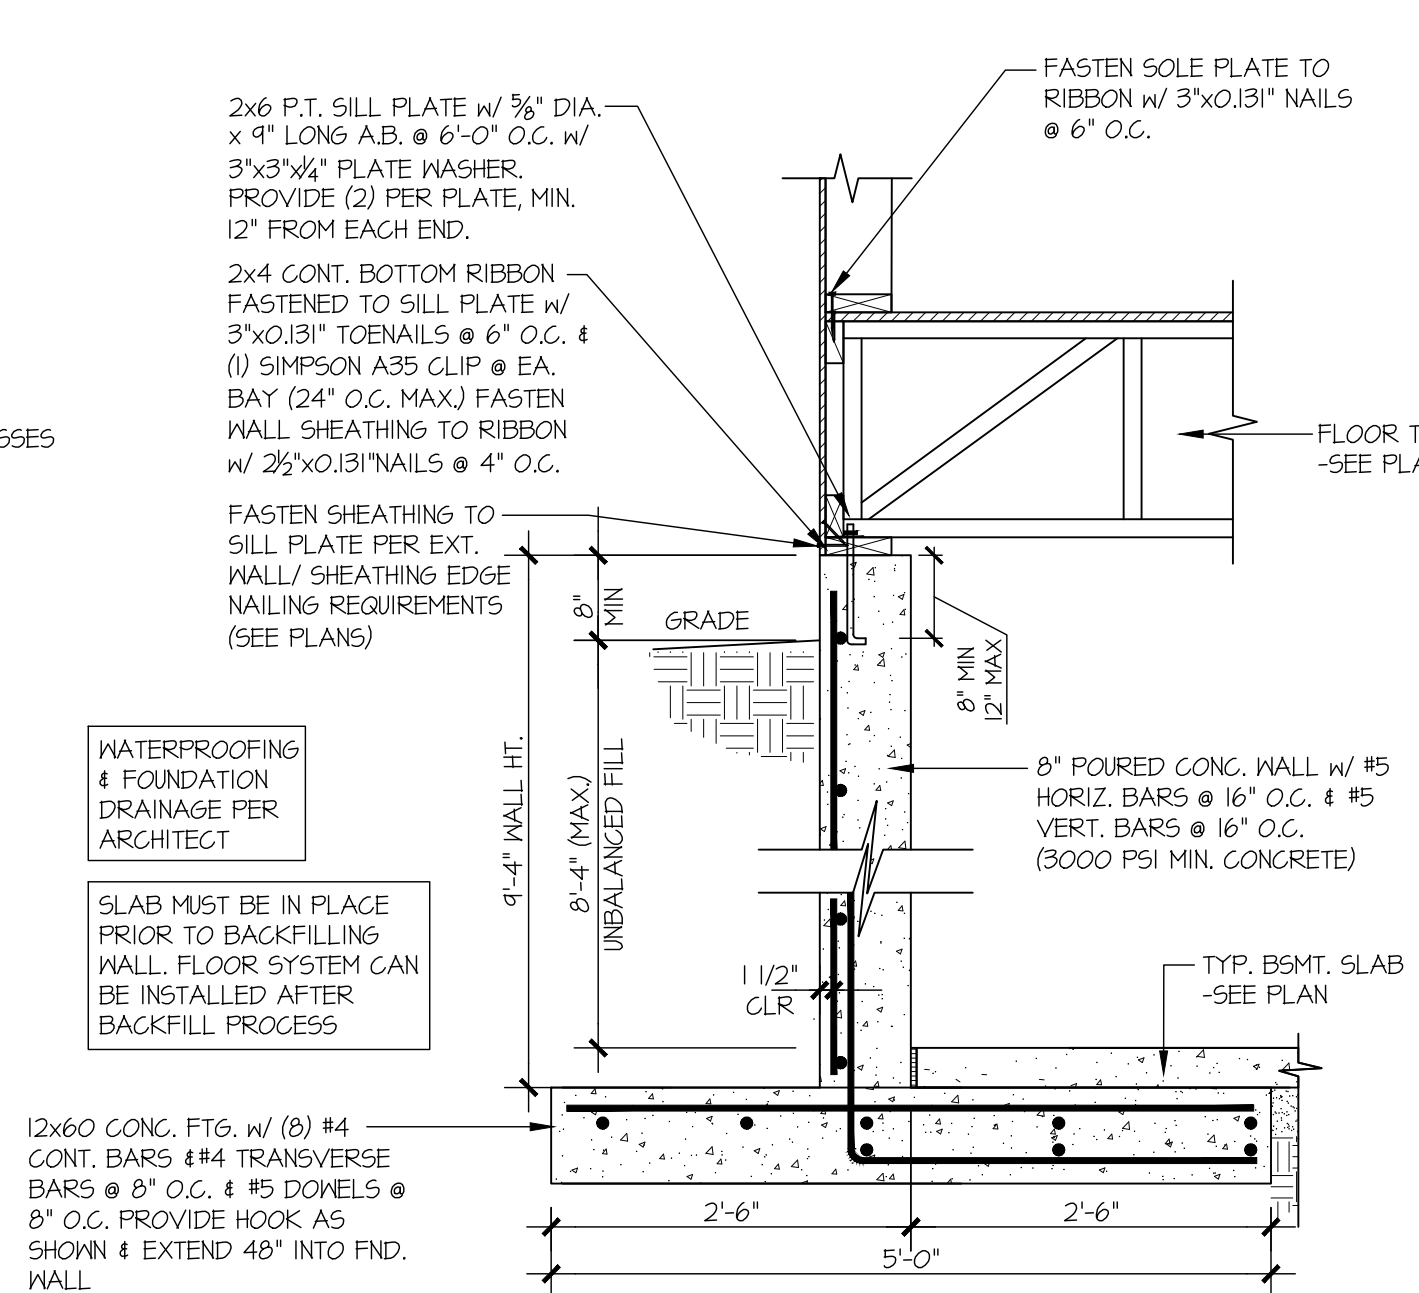


11 BASEMENT FOUNDATION WALL  
SCALE: 3/4"=1'-0"

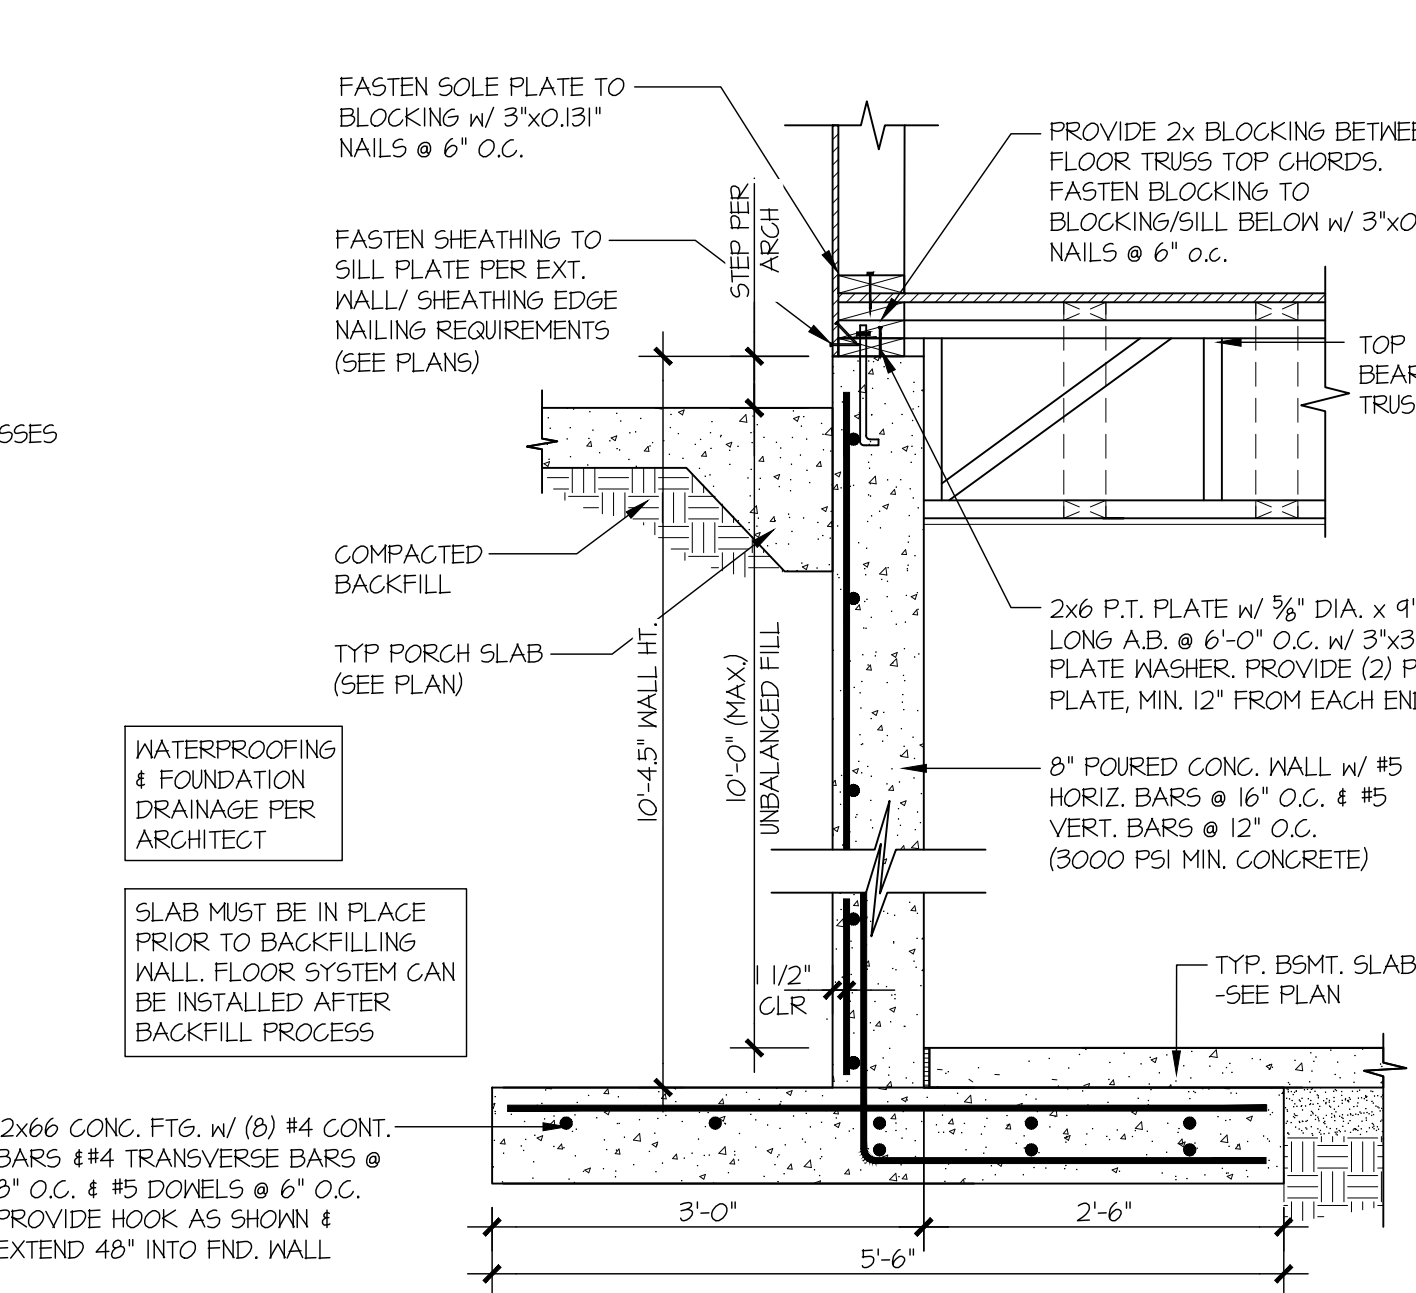

12 BASEMENT FOUNDATION WALL  
SCALE: 3/4"=1'-0"

Reviewed  
Kolkha Consulting Group, Inc.  
C. Kolkha  
07/30/2021

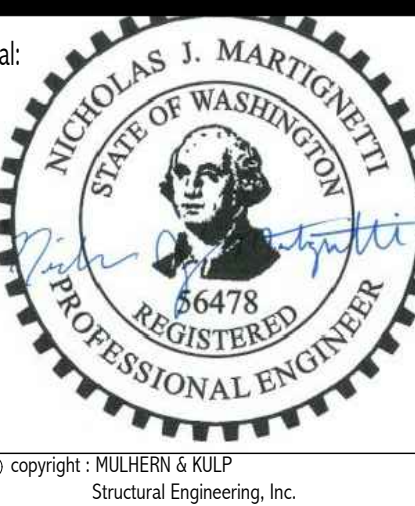

**MULHERN+KULP**  
RESIDENTIAL STRUCTURAL ENGINEERING  
7220 Trade Street, Suite 350, San Diego, CA 92121  
p 619-660-0010 • mulhern+kulp.com











M&K project number:  
203-20001  
project mgr: NJM  
drawn by: RJZ  
issue date: 12-22-20

REVISIONS:  
date: 01/15/21 initial: RJZ  
updated series:

ARCHITECTURAL  
INNOVATIONS

STRUCTURAL DETAILS  
PRATT PLOT - LOT 2  
7233 80TH AVE SE  
MERCER ISLAND, WASHINGTON

sheet:  
**SD.02**

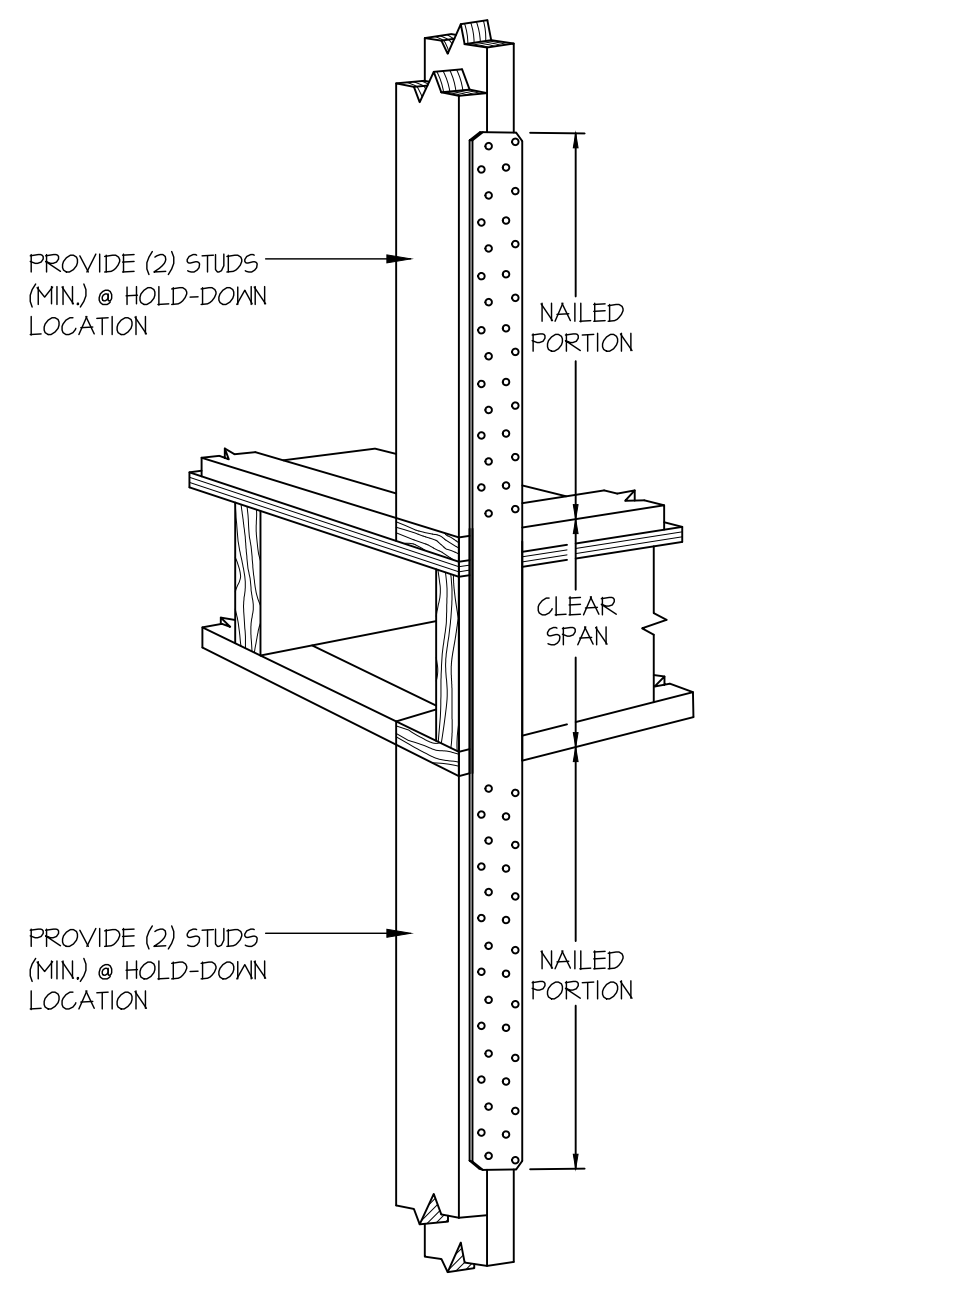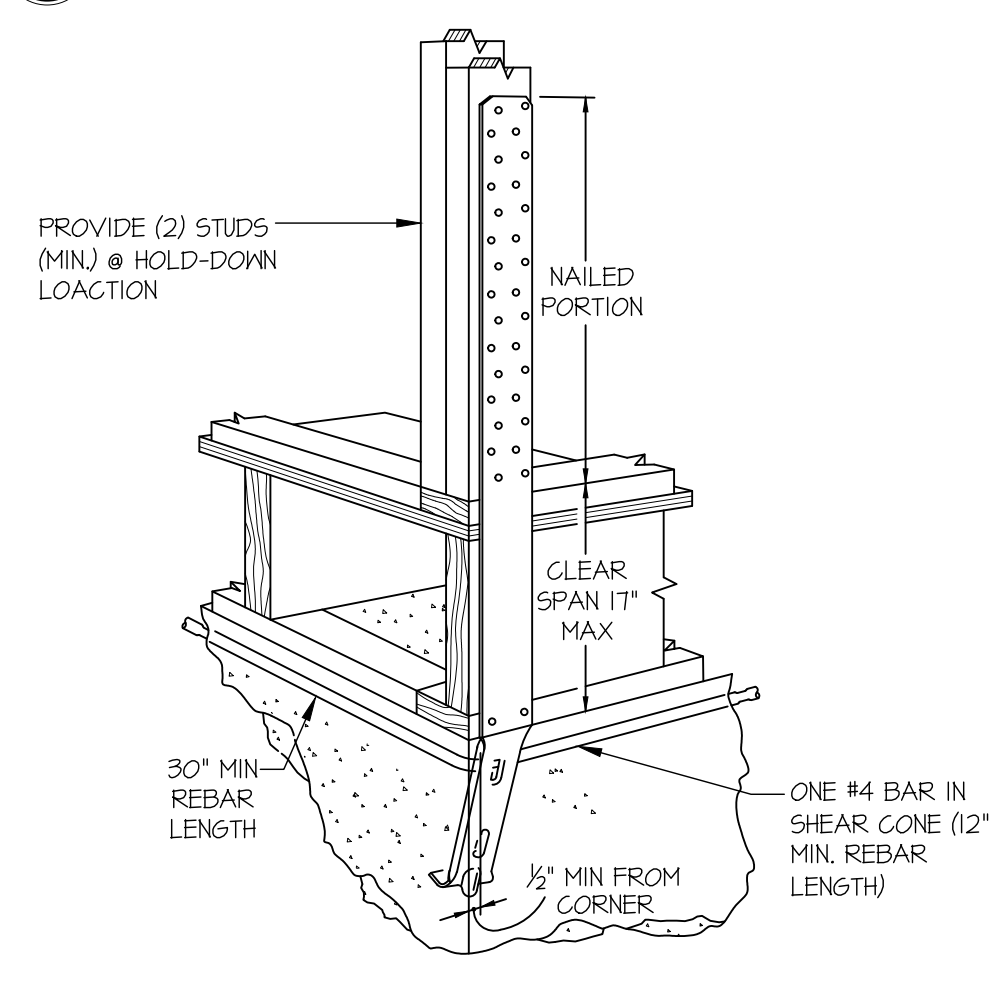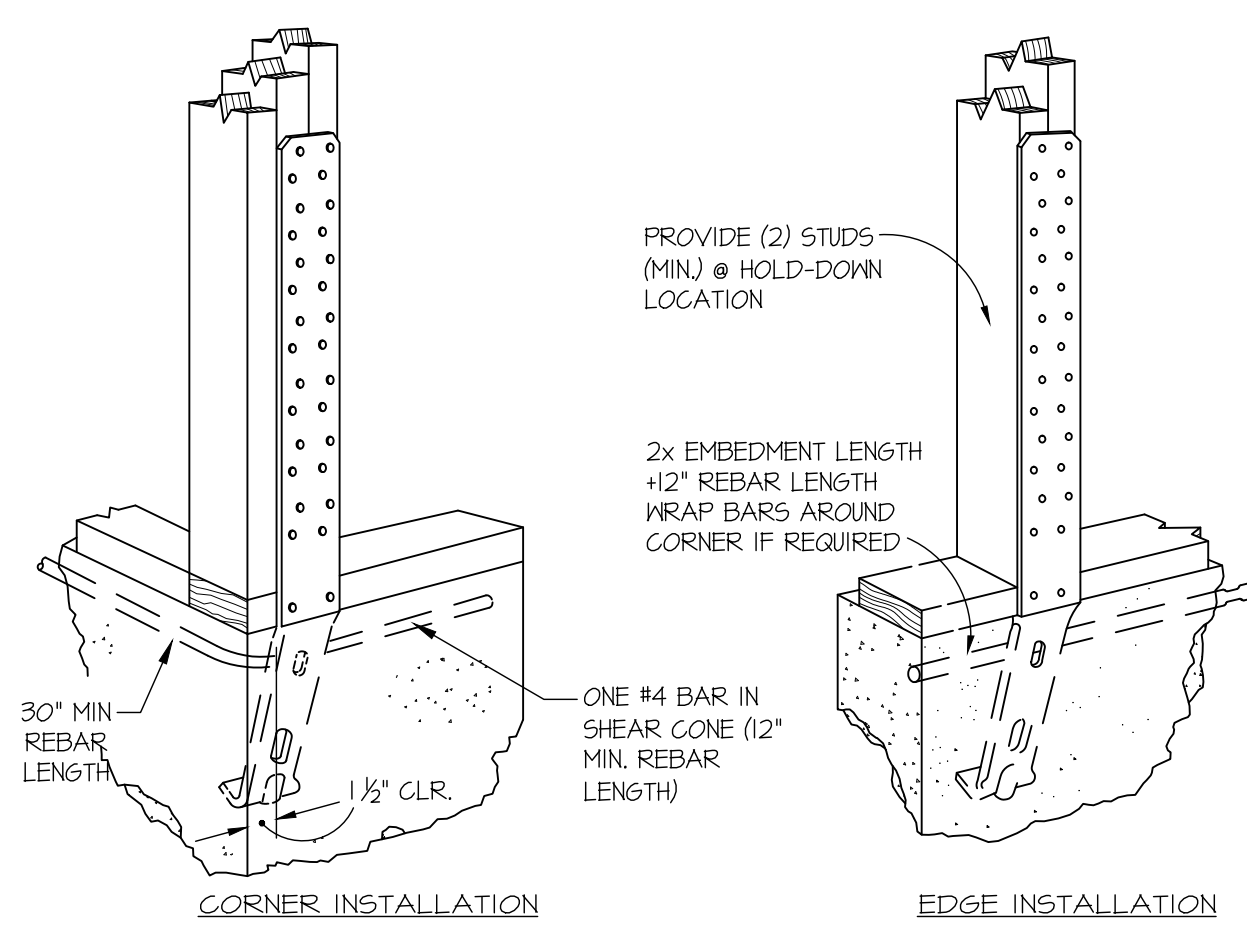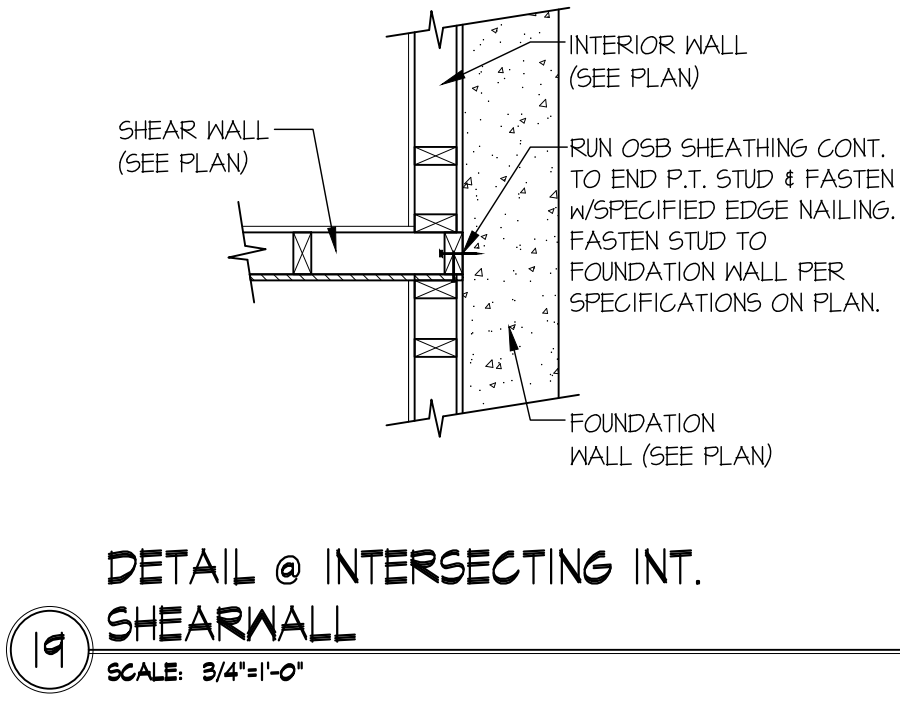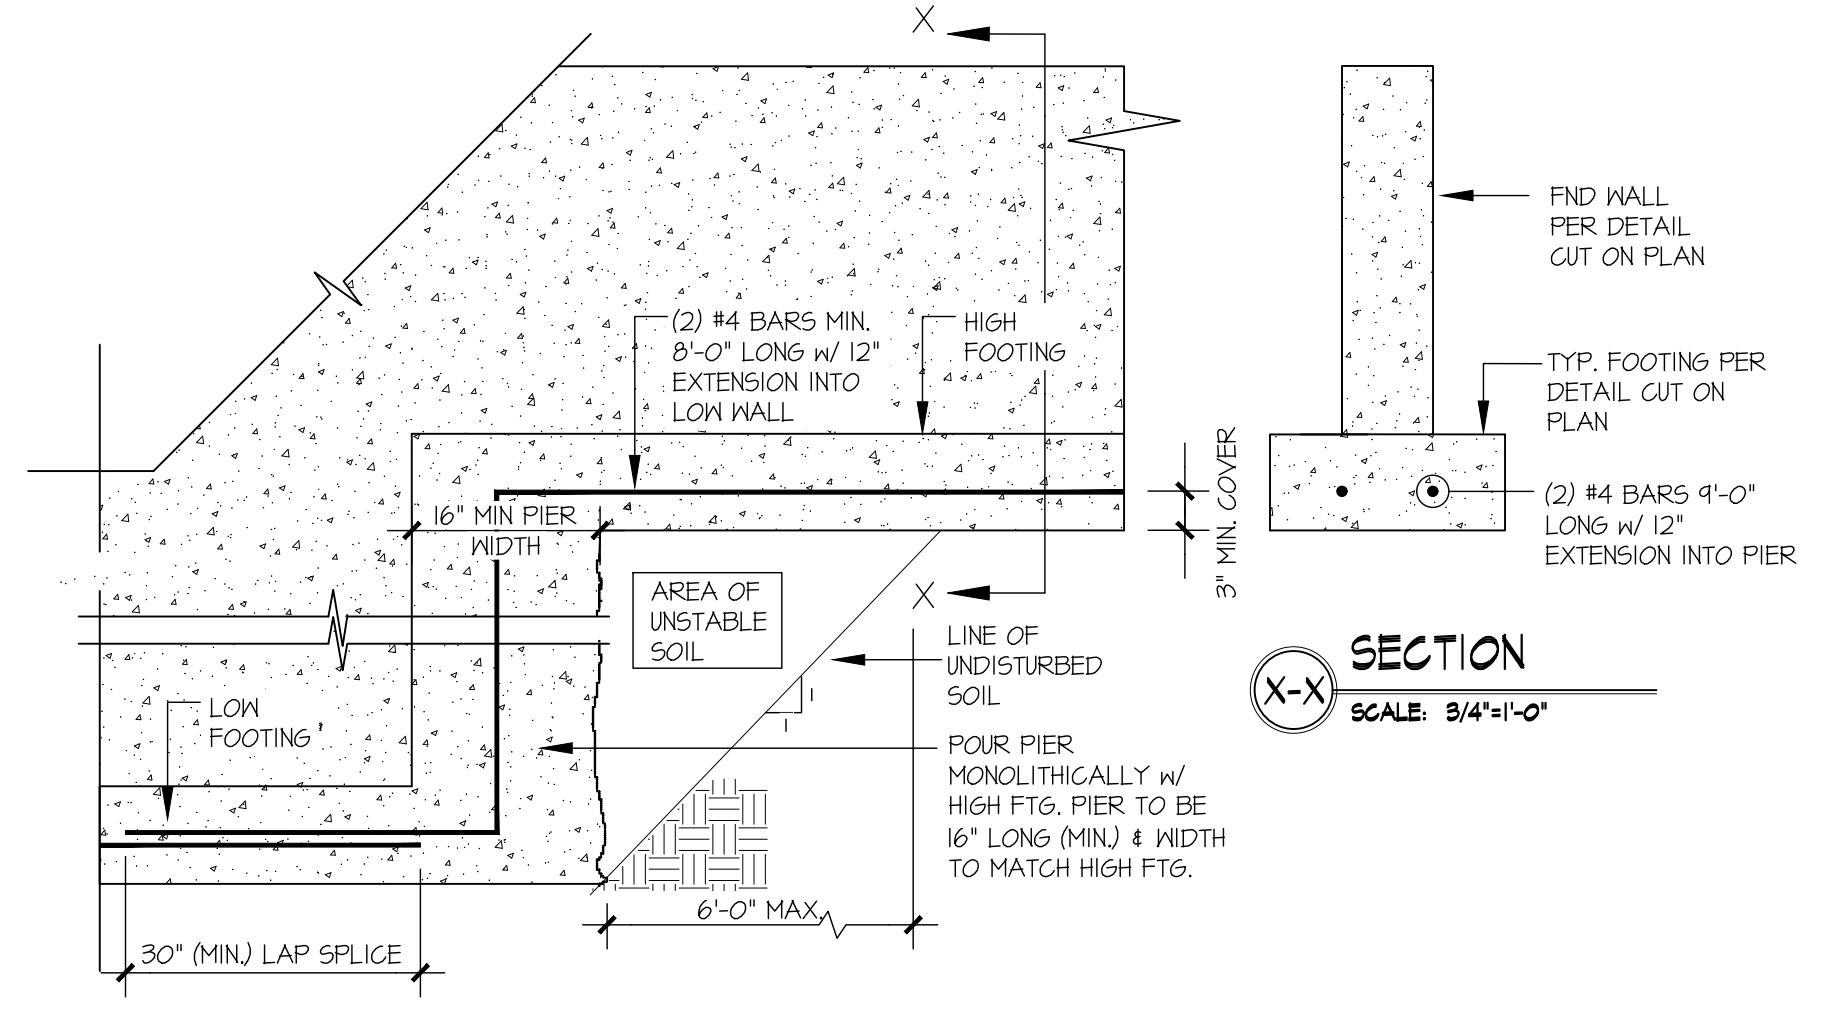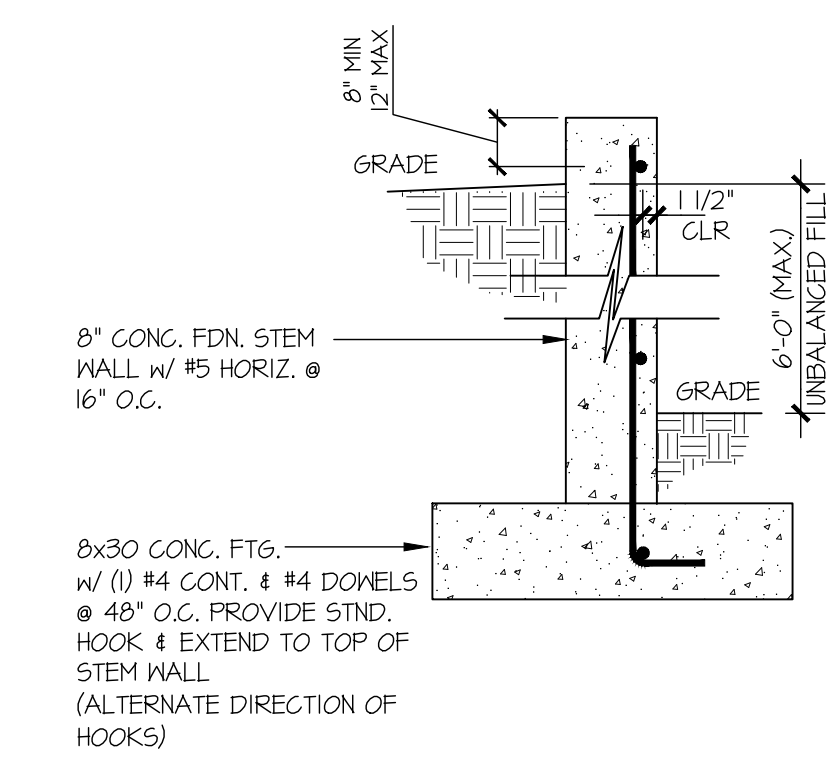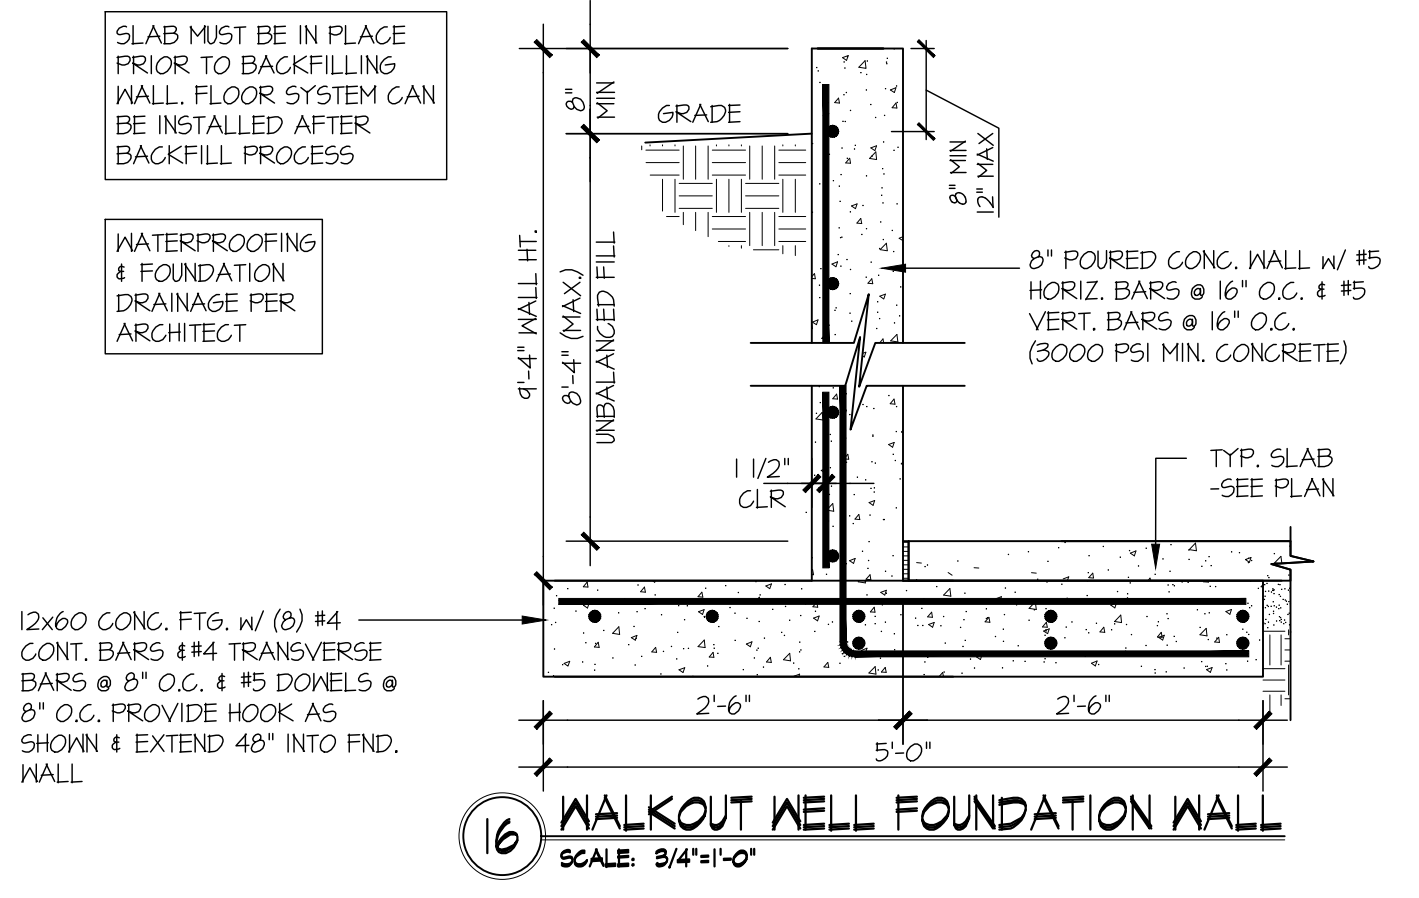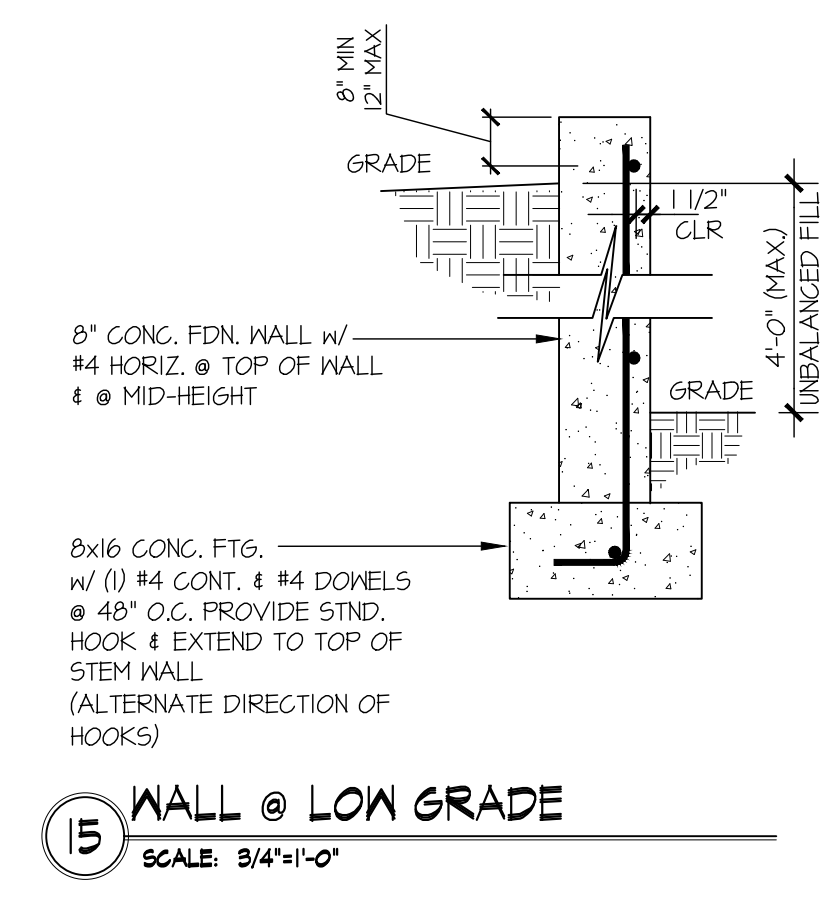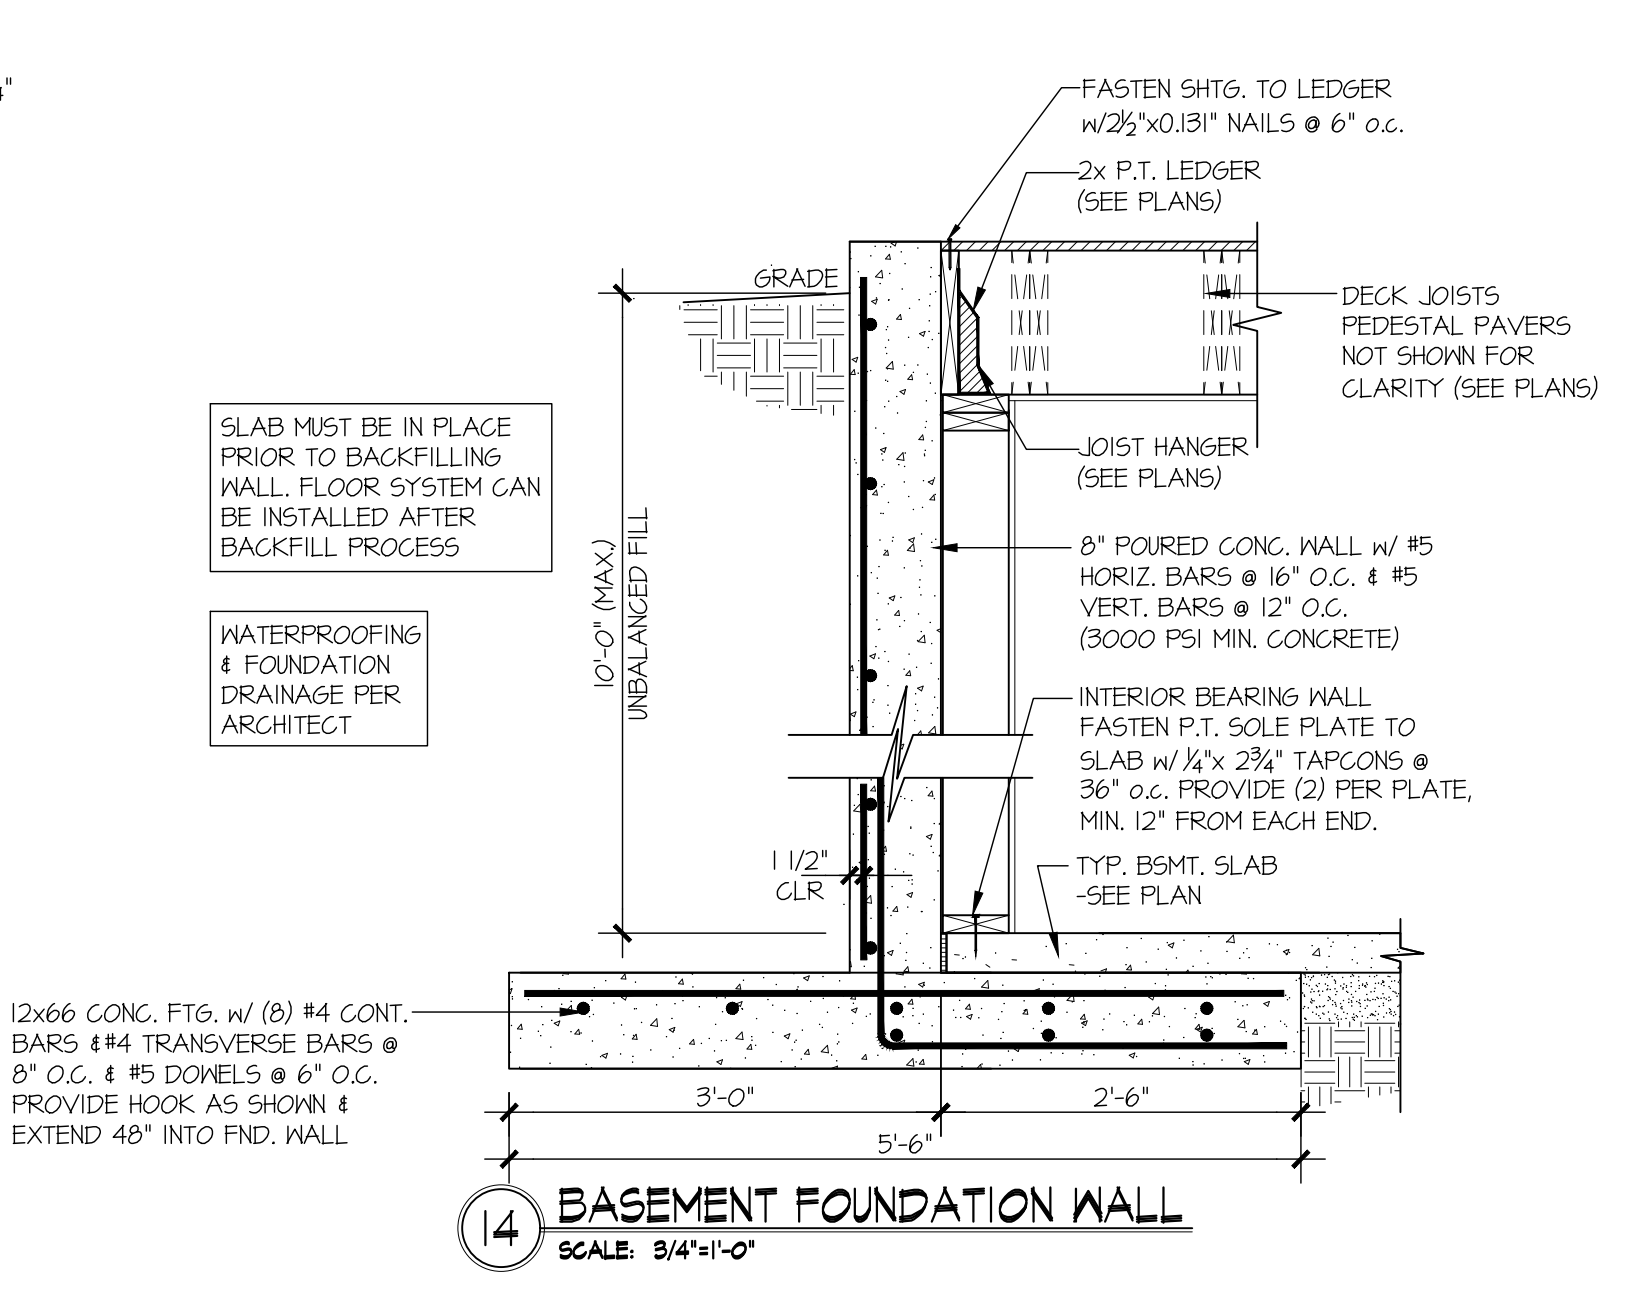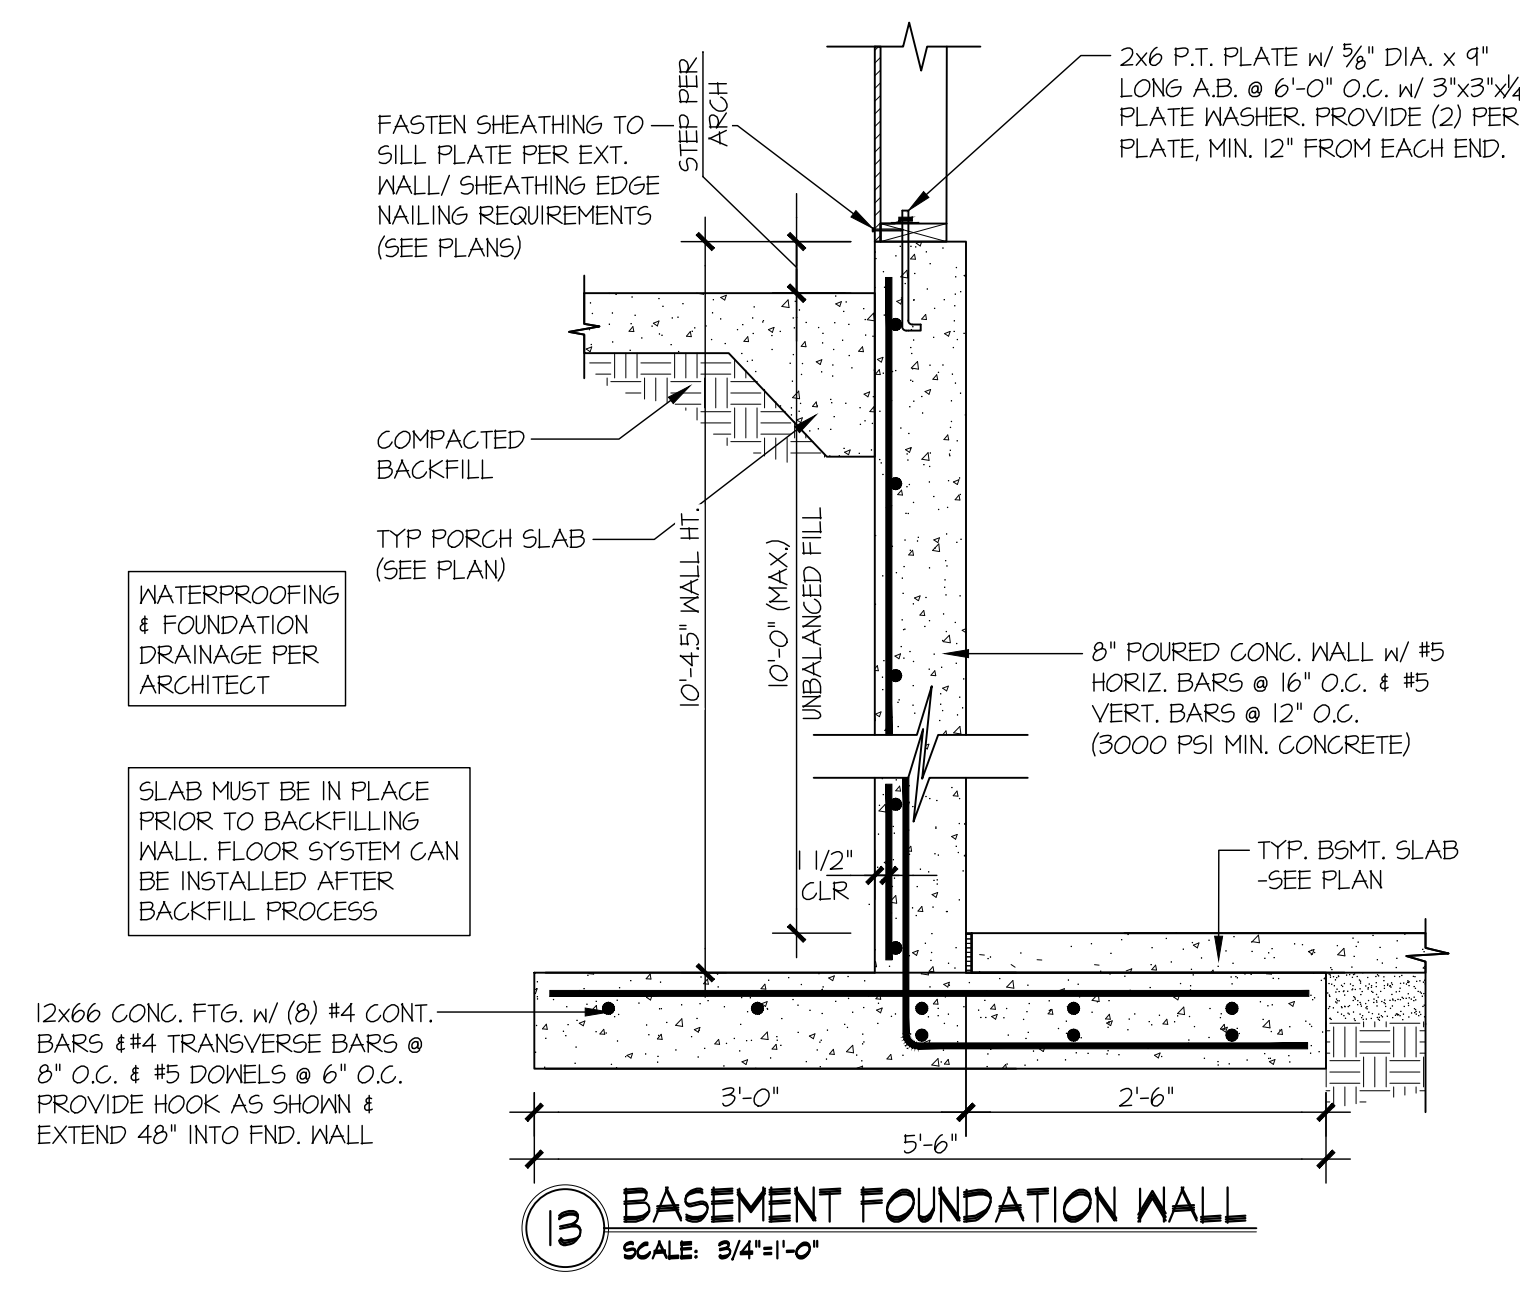

Reviewed  
Kolke Consulting Group, Inc.  
C. Kolke  
07/30/2021