

SUBMITTAL #: 1 2 3 4

- NO EXCEPTIONS TAKEN
 APPROVED AS NOTED
 REVIEWED ONLY
- REVISE AND RESUBMIT
 REJECTED - RESUBMIT
 NOT REVIEWED
- RESUBMIT FOR RECORD
 FOR RECORD
- TYPICAL - U.N.O.

SEE: LEFT

Shop drawing review is for general conformance with plans, specifications and the design concept of the Project as expressed in the Contract Documents. The corrections or comments made on submittals shall not relieve the Contractor from any obligation contained in the Contract Documents. Review and approval is not for the purpose of determining the completeness, accuracy or correctness of dimensions, quantities or other details. Approval assumes no responsibility whatsoever for the correctness, nor does it imply authorization of additional work. The Structural Engineer's review shall not constitute approval of any fabrication or construction means, methods, techniques, or sequences; or any safety precautions or procedures.

REVIEWED BY: RJD

M+K PROJECT #: 203-20001 DATE: 10/1/21

****VERIFY ALL PLUMBING DROP LOCATIONS BEFORE FINAL PLACEMENT OF TRUSSES. **DO NOT SPACE TRUSSES MORE THAN 16" O.C.****

LOADING:
T.C. LL = 40 PSF
T.C. DL = 10 PSF
B.C. DL = 10 PSF

TOTAL LOAD: 60 PSF

2015 IRC CODE

LAY-OUT DIMENSIONS:
FEET - INCHES - SIXTEENTHS
(6'-7 3/4" = 6-7-12)
****DRAWING IS NOT TO SCALE**

CAUTION: DO NOT CUT, DRILL OR ALTER ANY TRUSSES WITHOUT PRIOR APPROVAL FROM ROOF TRUSS SUPPLY, INC.

NOTES:


- ALL FLOOR TRUSSES SHALL BE 18" DEEP SPACED AT 16" O.C. UNLESS NOTED OTHERWISE.
- INDICATES (2X6) CONTINUOUS LATERAL/IMPACT BRACING W/TRUSSED BLOCKING PANELS SHOWN AS "X". (SEE TRUSS ENGINEERING FOR LOCATION) (SEE DETAIL)
- INTERIOR BEARING / SHEAR WALL. (DESIGNED BY OTHERS) INSTALL SHEAR OR BLOCKING PANELS BETWEEN TRUSSES AS SHOWN.
- %% ALIGN (2X) CRIPPLE STUDS UNDER WINDOW TRIMMERS OR GIRDER TRUSS ABOVE. ATTACH TO (2X) CONTINUOUS RIBBON OR INSERT BETWEEN TRIMMERS AND GIRDER TRUSSES ALIGN W/TRUSS BELOW. INSTALL (1) CRIPPLE STUD TO EACH FACE OF TRUSS AS SHOWN. (SEE STRUCTURAL FRAMING PLAN FOR LOCATION) (CRIPPLE STUDS SHALL BE INSTALLED & PROVIDED BY FRAMER) %%


NOTES (CONT.)

- INSTALL (2) 2x6x18" CRIPPLE STUDS TO ALIGN UNDER GIRDER TRUSS ABOVE. FLUSH TIGHT TO TOP OF BEARING WALL AND UNDERSIDE OF FLOOR DIAPHRAGM. (MUST BE INSTALLED BY FRAMER!!)
- (2X4) CONTINUOUS RIBBON TO TOP AND BOTTOM AT EXTERIOR BEARING/SHEAR WALL. (SEE STRUCTURAL FRAMING PLAN)
- (2X4) CONTINUOUS RIBBON TO TOP AND BOTTOM OF TRUSS AT END OF CANTILEAVER. (SEE STRUCTURAL FRAMING PLAN)
- (6x) DROP BEAM. (DESIGNED BY OTHERS...SEE STRUCTURAL PLAN)
- (3-1/2") FLUSH GLU-LAM BEAM (DESIGNED BY OTHERS...SEE STRUCTURAL PLAN)
- 0'-8" FOUNDATION WALL WITH (1-1/2" x 8") P.T. TOP PLATE. P.T. TOP PLATE MUST BE FULL WIDTH OF FOUNDATION WALL!! HANG TRUSSES FROM FOUNDATION WALL.

FLOOR LAY-OUT LEGEND:

SYMBOL	DESCRIPTION
▲	LEFT END OF TRUSS ("DO NOT INSTALL TRUSSES IN REVERSE OR UPSIDE DOWN. SEE TRUSS ENGINEERING FOR CORRECT TRUSS PLACEMENT")
\$\$	TRUSS LAY-OUT SHIFTED (TRUSS LAY-OUT SHIFTED TO AVOID PLUMBING DROPS. "DO NOT CUT, DRILL OR ALTER ANY TRUSSES WITHOUT PRIOR APPROVAL FROM RTS")
##	ADDITIONAL TRUSS ADDED ("ADDITIONAL FLOOR TRUSS ADDED TO AVOID "OVERSPACING" OF SUBFLOOR)

 = RAISED FOUNDATION WALL (SEE NOTE "10")


 = AREA FIELD FRAMED BY OTHERS

INSTALLATION NOTE:

DO NOT INSTALL TRUSSES IN REVERSE OR "UP-SIDE-DOWN"! SEE TRUSS ENGINEERING FOR PROPER INSTALLATION. ALIGN INTERIOR BEARING AS SHOWN ON ENGINEERING DRAWINGS.

NOTE: ALL HANGER NAILS MUST BE 16d SINKER (3-1/4" LONG)...TYP. UNLESS NOTED OTHERWISE

QTY	TYPE	SYMBOL
64	THA422	①
9	HUS46	②
1	HUC46	③
4	THAC422	④
10	MIT48	⑤
1	THA222-2	⑥
1	HGUS26-2	⑦

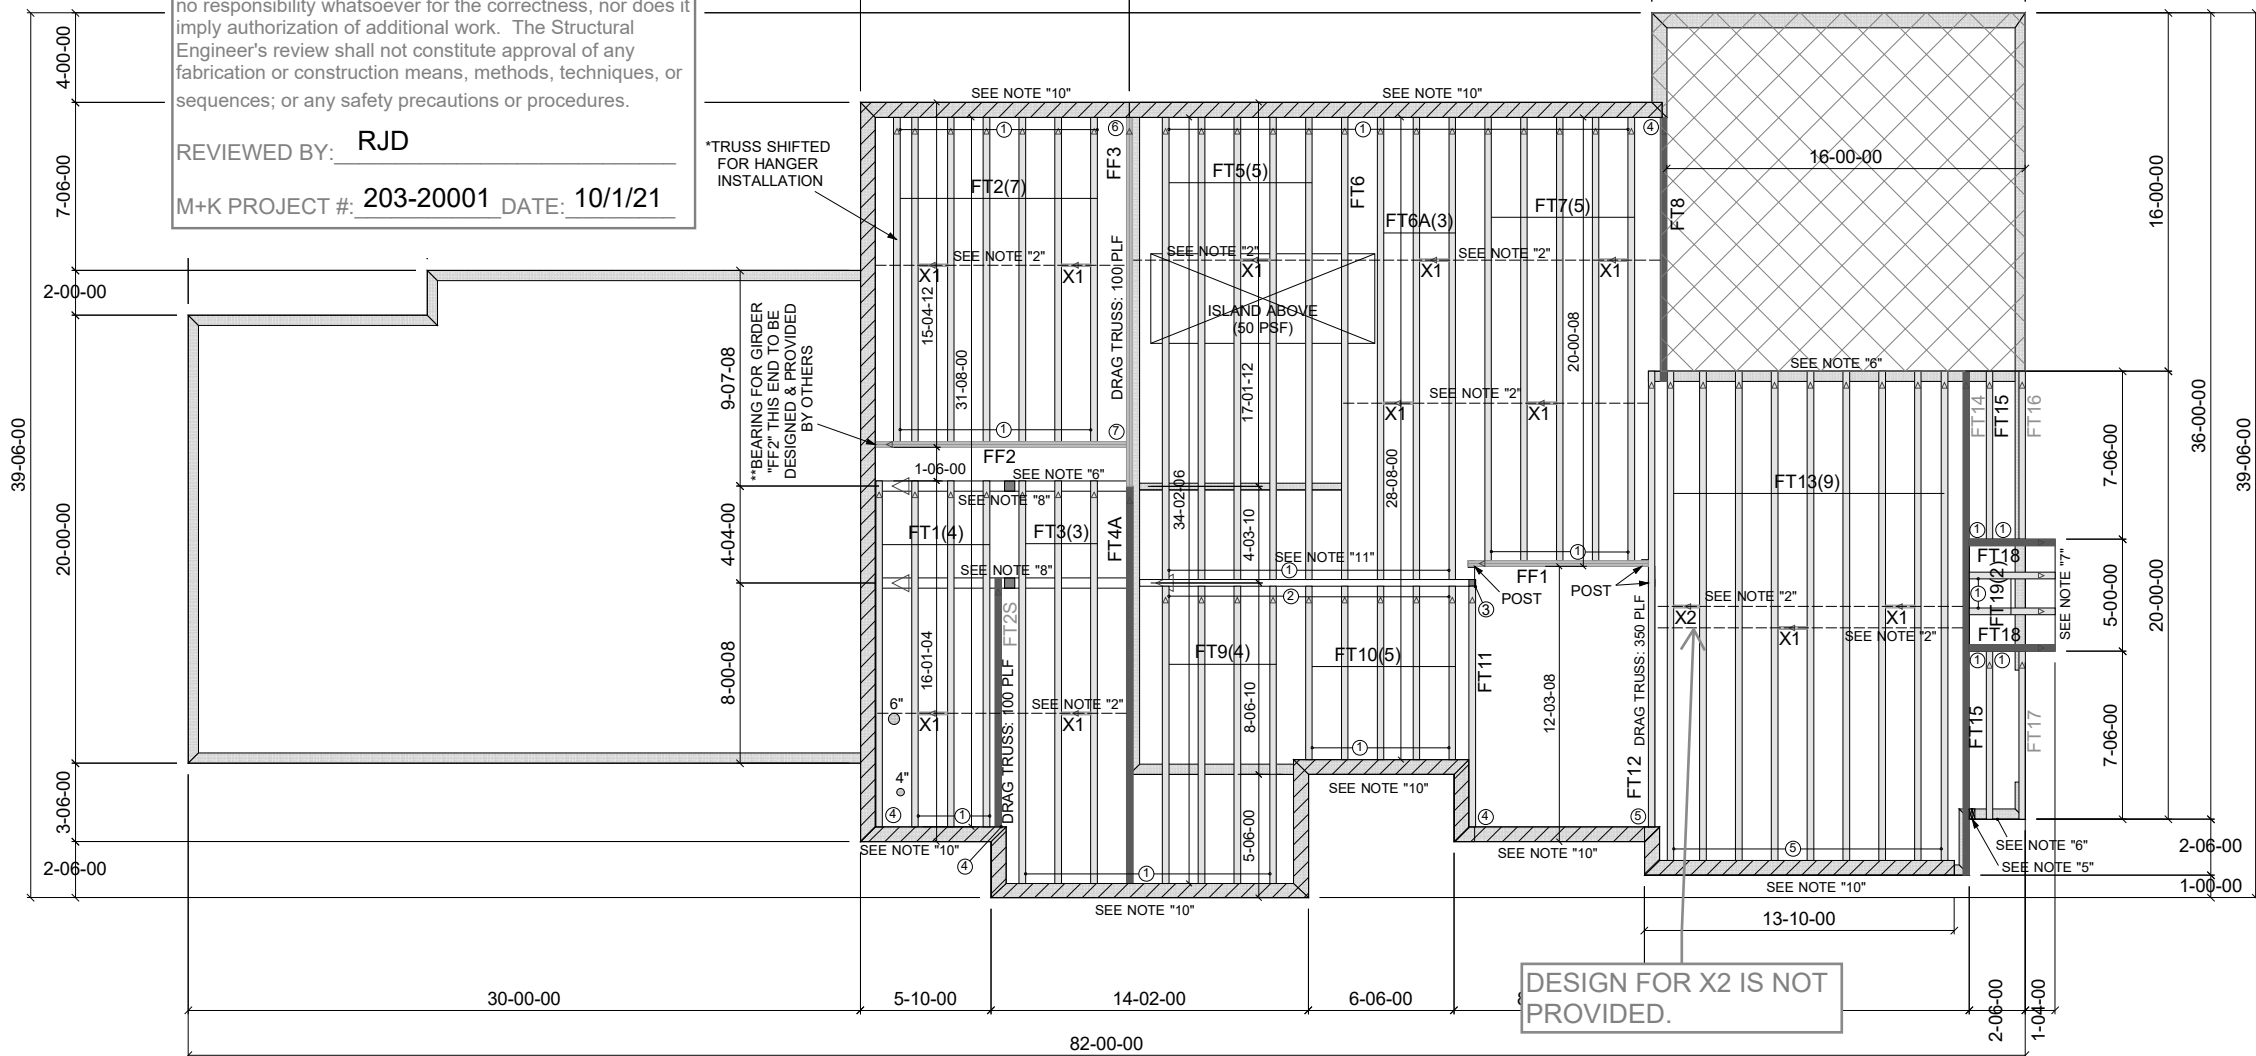

Job #: J-21-01726-E

Customer: **HBG**
Project: **HIGHLAND BUILDERS**
Plan: **GAR LEFT LOT 3**

Issue Date:

7/1/2021

Revision-2


//

Revision-3

//

Above plan provided for truss placement only. Refer to truss calculations and engineering structural drawings for all further information. Building designer/engineer of record are responsible for all non truss to truss connections. Building designer/engineer of record to review and approve all designs prior to construction.

Drawn By:

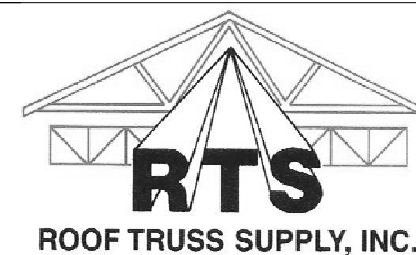



MiTek USA, Inc.
250 Klug Circle
Corona, CA 92880
951-245-9525

Re: J-21-01726-E
HBG-LOT 3

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Roof Truss Supply.

Pages or sheets covered by this seal: K10367370 thru K10367394

My license renewal date for the state of Washington is September 28, 2023.



September 27, 2021

Zhao, Xiaoming


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J-21-01726-E	Truss FF1	Truss Type FLOOR	Qty 1	Ply 2	HBG-LOT 3	K10367370
---------------------	--------------	---------------------	----------	----------	-----------	-----------


Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:17 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-HXFczRMeMo75AiDvGcYwk97TkNTNb9pB_27AE7yZOWm



Scale = 1:15.1

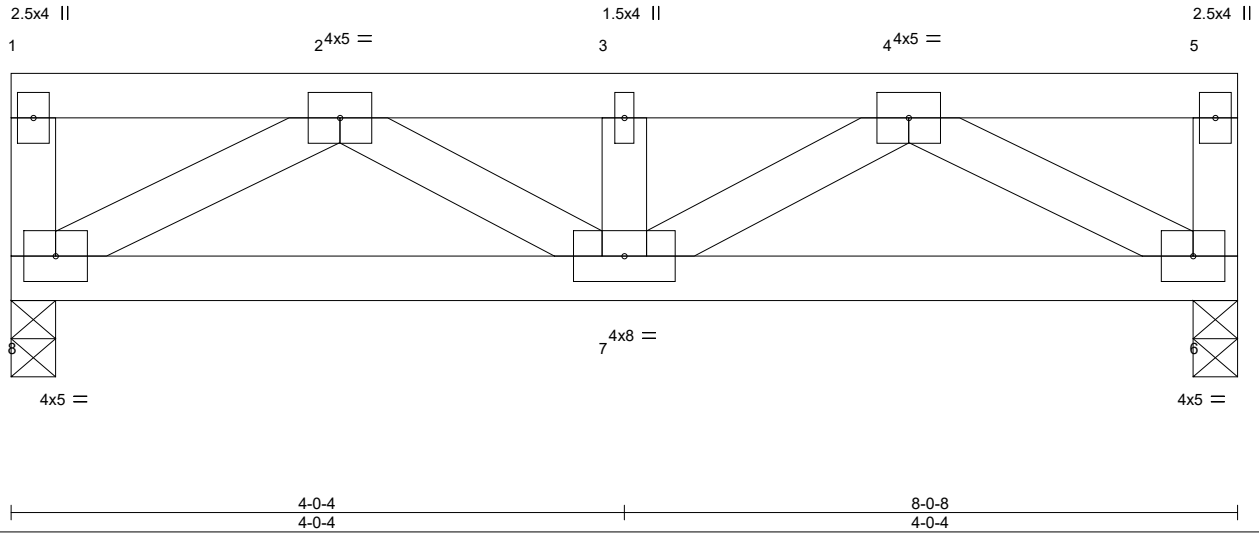

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.33	Vert(LL)	-0.04	7	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.51	Vert(CT)	-0.06	7	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.42	Horz(CT)	0.02	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 63 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2	TOP CHORD Structural wood sheathing directly applied or 5-8-14 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std	

REACTIONS. (size) 8=0-3-8, 6=0-3-8
Max Grav 8=2528(LC 1), 6=2528(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-8=-615/0, 2-3=-4093/0, 3-4=-4093/0, 5-6=-615/0
BOT CHORD 7-8=0/3228, 6-7=0/3228
WEBS 2-8=-3601/0, 2-7=0/1029, 3-7=-1098/0, 4-7=0/1029, 4-6=-3601/0

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-3-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- Plates checked for a plus or minus 20 degree rotation about its center.
- Girder carries tie-in span(s): 20-0-8 from 0-0-0 to 8-0-8
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 1-5=-632(F=-533), 6-8=-20



September 27, 2021

Job J-21-01726-E	Truss FF2	Truss Type FLOOR	Qty 1	Ply 2	HBG-LOT 3	K10367371
---------------------	--------------	---------------------	----------	----------	-----------	-----------


Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:18 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-ljp_BnNH76Fynso5qJ39HNgfnniVKYPLDitknZyZOWl



Scale = 1:19.1

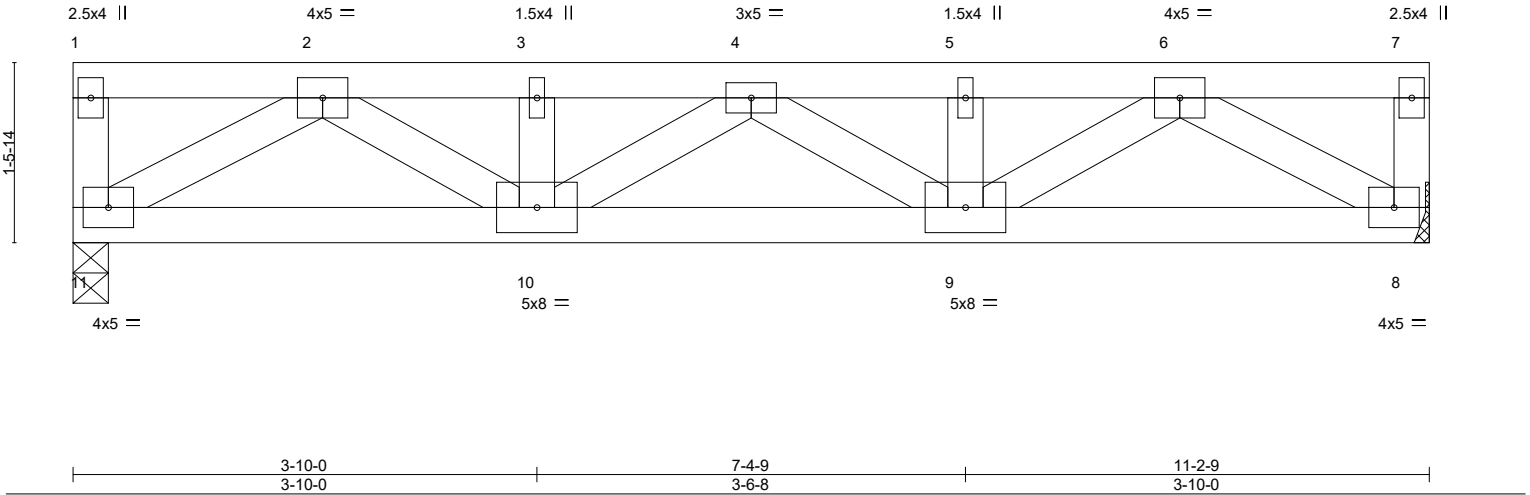

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.31	Vert(LL)	-0.10 9-10	>999	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.90	Vert(CT)	-0.14 9-10	>913	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.66	Horz(CT)	-0.04 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 87 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 HF No.2
BOT CHORD 2x4 HF No.2
WEBS 2x4 HF Stud/Std

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 11=0-3-8, 8=Mechanical
Max Grav 11=2679(LC 1), 8=2679(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-11=-459/0, 2-3=-5426/0, 3-4=-5426/0, 4-5=-5426/0, 5-6=-5426/0, 7-8=-459/0
BOT CHORD 10-11=0/3563, 9-10=0/6061, 8-9=0/3563
WEBS 2-11=-4062/0, 2-10=0/2249, 3-10=-789/0, 4-10=-766/0, 4-9=-766/0, 5-9=-789/0, 6-9=0/2249, 6-8=-4062/0

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-4-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Girder carries tie-in span(s): 14-5-12 from 0-0-0 to 11-2-9
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 1-7=-471(F=-371), 8-11=-20



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FF3	Truss Type FLOOR	Qty 1	Ply 2	HBG-LOT 3	K10367372
---------------------	--------------	---------------------	----------	----------	-----------	-----------


Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:19 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-DwNMO7NvuPNpP0NIO1aOpaCozB623zcUSMchJ?yZOWk



Scale = 1:28.2

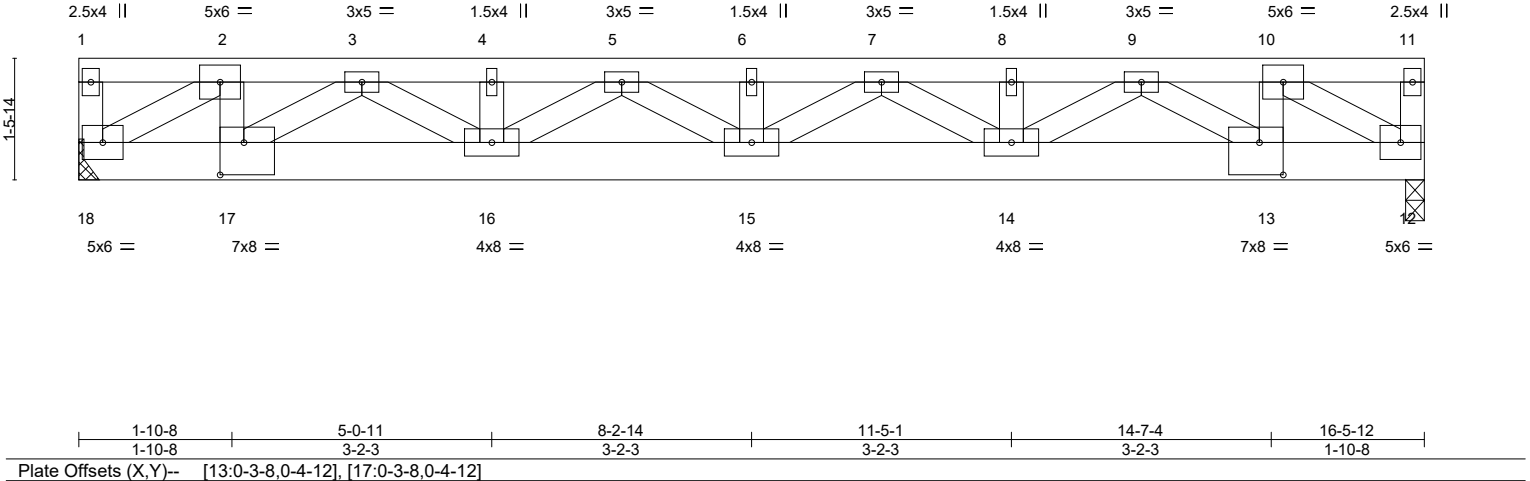

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.41	in (loc) l/defl L/d	MT20	185/148
TCDL 10.0	Plate Grip DOL 1.00	BC 0.68	Vert(LL) -0.13 15 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.79	Vert(CT) -0.20 14-15 >970 360		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.04 12 n/a n/a		
	Code IRC2015/TPI2014			Weight: 149 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 HF No.2
BOT CHORD 2x6 HF No.2
WEBS 2x4 HF Stud/Std

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-3-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 18=Mechanical, 12=0-2-12
Max Grav 18=1063(LC 1), 12=3169(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1451/0, 3-4=-3484/0, 4-5=-3484/0, 5-6=-4658/0, 6-7=-4658/0, 7-8=-5078/0, 8-9=-5078/0, 9-10=-4311/0, 10-11=-304/108
BOT CHORD 17-18=0/1451, 16-17=0/2578, 15-16=0/4207, 14-15=0/5015, 13-14=0/4862, 12-13=0/4311
WEBS 2-18=-1644/0, 2-17=0/779, 3-17=-1376/0, 3-16=0/1107, 5-16=-883/0, 5-15=-33/608, 7-15=-505/92, 9-14=-110/370, 9-13=-704/28, 10-13=0/2690, 10-12=-4872/0

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-2-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced floor live loads have been considered for this design.
 - As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 12.
 - This truss has been designed for a total drag load of 100 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 16-5-12 for 100.0 plf.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2679 lb down at 14-7-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 1-11=-80, 12-18=-16



September 27, 2021

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	---

Job J-21-01726-E	Truss FF3	Truss Type FLOOR	Qty 1	Ply 2	HBG-LOT 3 Job Reference (optional)	K10367372
---------------------	--------------	---------------------	----------	-----------------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:19 2021 Page 2
ID:49MjCVuD74jFLC0rXMNHInztALX-DwNMO7NvuPNpP0NIO1aOpaCozB623zcUSMchJ?yZOwk

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 13=-2679(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FT1	Truss Type Floor	Qty 4	Ply 1	HBG-LOT 3	K10367373
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:23 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-6hdtEURPxtFudh3dsfK_QNUcoYE?vQ4M_aVSmyZOWg

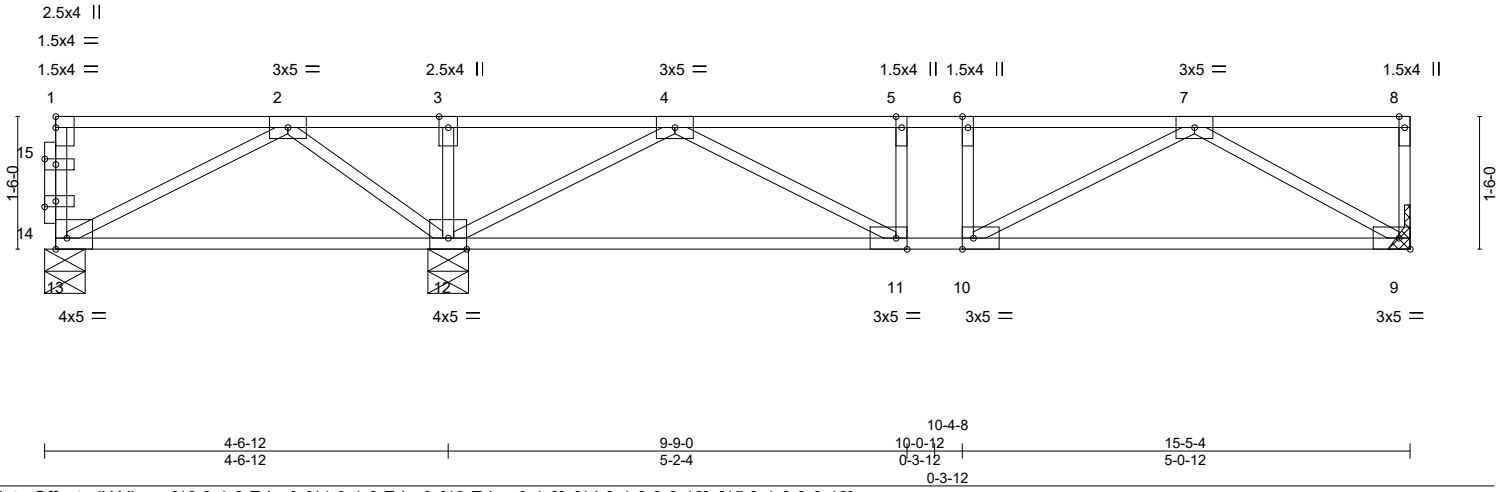


Plate Offsets (X,Y)--	[10:0-1-8,Edge], [11:0-1-8,Edge], [13:Edge,0-1-8], [14:0-1-8,0-0-12], [15:0-1-8,0-0-12]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.37	Vert(LL) -0.05 9-10 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.41	Vert(CT) -0.15 9-10 >869 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.29	Horz(CT) 0.01 9 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 63 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13.

REACTIONS. (size) 12=0-5-8, 13=0-5-8, 9=Mechanical
Max Grav 12=1868(LC 1), 13=1067(LC 3), 9=459(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-13=-1000/0, 2-3=0/451, 3-4=0/451, 4-5=-824/0, 5-6=-824/0, 6-7=-824/0
BOT CHORD 11-12=0/399, 10-11=0/824, 9-10=0/611
WEBS 3-12=-1080/0, 2-13=-88/259, 2-12=-429/0, 4-11=0/493, 4-12=-937/0, 7-10=0/260, 7-9=-706/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 916 lb down at 0-2-4, and 918 lb down at 4-6-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 9-13=-16, 1-8=-80
Concentrated Loads (lb)
Vert: 1=-916(F) 3=-918(F)

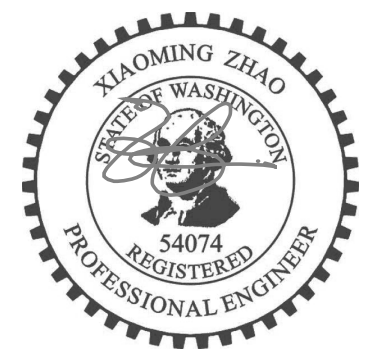

September 27, 2021

Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367374
J-21-01726-E	FT2	Floor	7	1		
Job Reference (optional)						

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:53 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-DSRDXIoEtsf_UE_qNABMBIcaGuiq1QHUGfr4W1yZOWC



Scale = 1:24.6


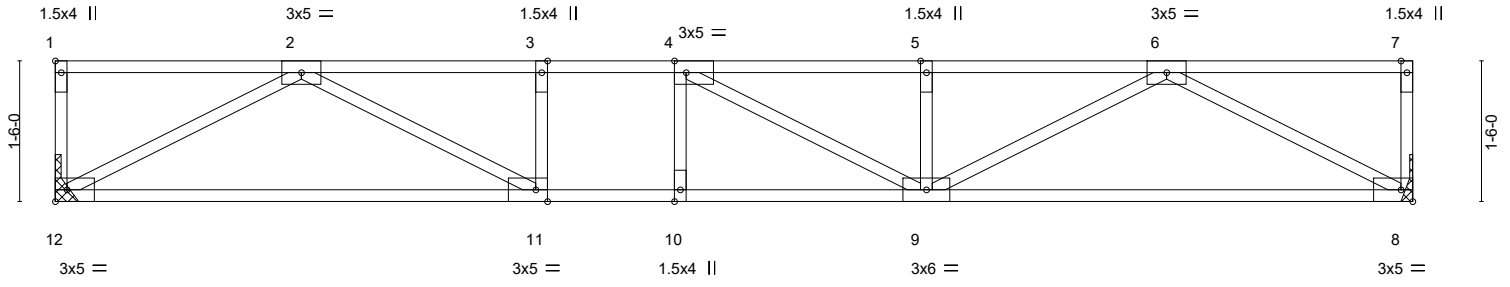


Plate Offsets (X,Y)-- [1:Edge,0-0-12], [4:0-1-8,Edge], [11:0-1-8,Edge]									
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.48	Vert(LL)	-0.16	9-10	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.76	Vert(CT)	-0.21	9-10	>834		
BCLL 0.0	Rep Stress Incr	YES	WB 0.45	Horz(CT)	-0.03	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 57 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud(Std(flat))	

REACTIONS. (size) 12=Mechanical, 8=Mechanical
Max Grav 12=689(LC 1), 8=689(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1740/0, 3-4=-1740/0, 4-5=-1719/0, 5-6=-1719/0
BOT CHORD 11-12=0/1072, 10-11=0/1740, 9-10=0/1740, 8-9=0/1067
WEBS 2-12=-1216/0, 2-11=0/772, 6-8=-1211/0, 6-9=0/740, 4-9=-264/157

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

Job J-21-01726-E	Truss FT2S- Cond1	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367375
---------------------	-----------------------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:57 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-6EgkM6rKx59QzrHbc?GIMbnliV70zHA4BGplfoyZOW8



Scale = 1:18.5

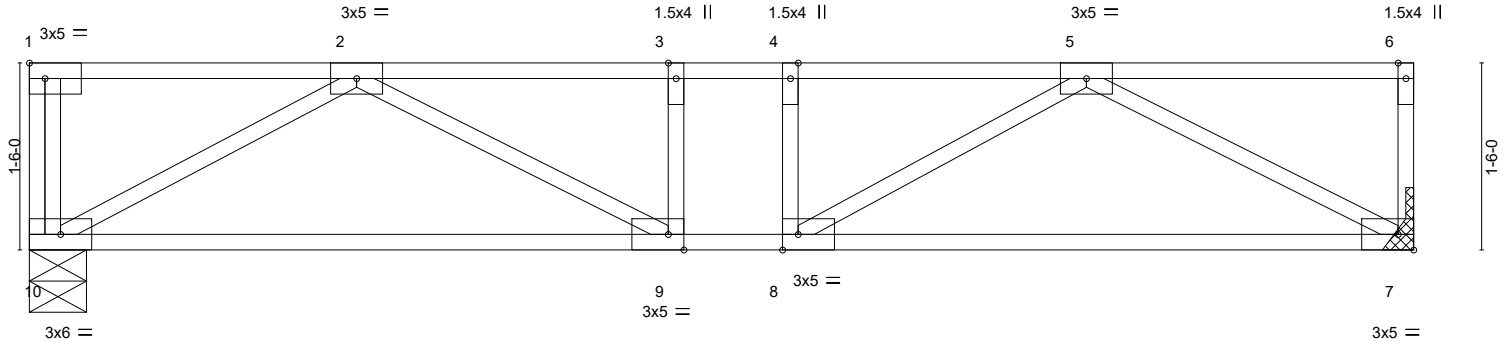


Plate Offsets (X, Y)-- [8:0-1-8,Edge], [9:0-1-8,Edge]					
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.32	Vert(LL) -0.09 9-10 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.49	Vert(CT) -0.19 9-10 >680 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.27	Horz(CT) 0.02 7 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 46 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 7=Mechanical, 10=0-5-8
Max Grav 7=540(LC 2), 10=540(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-250/225, 2-3=-1124/0, 3-4=-1073/0, 4-5=-1111/0, 5-6=-256/231
BOT CHORD 9-10=-79/812, 8-9=0/1073, 7-8=-55/810
WEBS 5-7=-935/84, 5-8=-187/591, 2-10=-922/83, 2-9=-198/604

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) This truss has been designed for a total drag load of 100 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-1-4 for 100.0 plf.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-E	Truss FT2S- Cond2	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367375
---------------------	-----------------------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:58 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-aQE6aSsMiOHHb?snAjnXupKTSvTFikQEQwZrBFyZOW7



Scale = 1:18.5

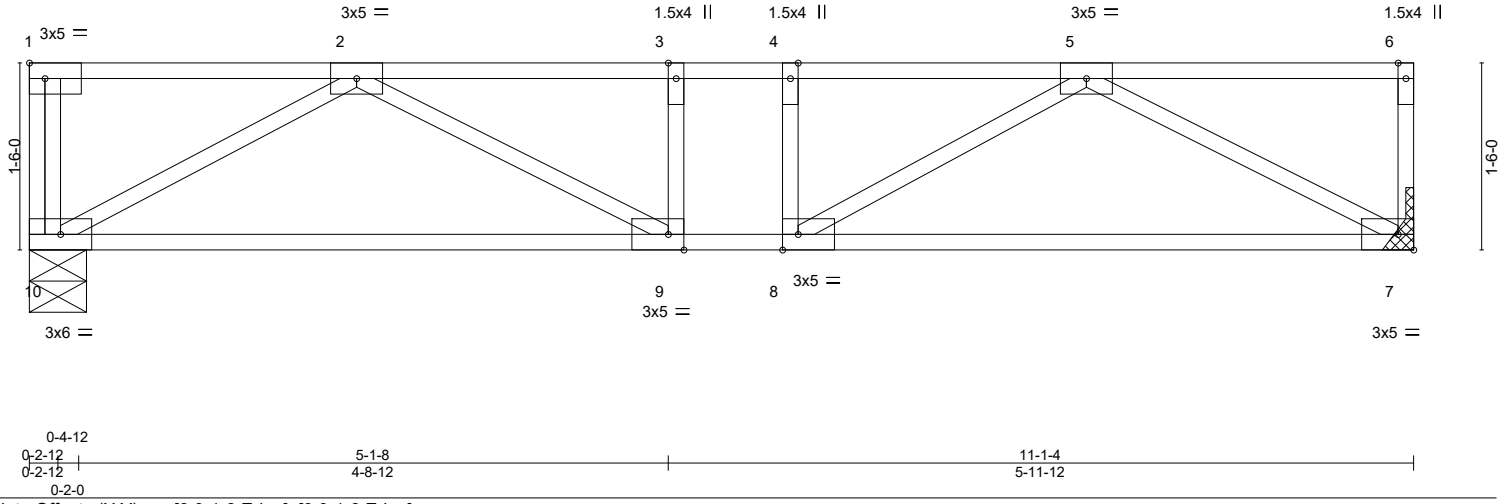


Plate Offsets (X, Y)--	[8:0-1-8,Edge], [9:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.32	Vert(LL) -0.09 9-10 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.49	Vert(CT) -0.19 9-10 >680 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.27	Horz(CT) 0.02 7 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 46 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 7=Mechanical, 10=0-5-8
Max Grav 7=540(LC 2), 10=6384(LC 14)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-250/225, 2-3=-1124/0, 3-4=-1073/0, 4-5=-1111/0, 5-6=-256/231
BOT CHORD 9-10=-79/812, 8-9=0/1073, 7-8=-55/810
WEBS 5-7=-935/84, 5-8=-187/591, 2-10=-922/83, 2-9=-198/604

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Load case(s) 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 5) This truss has been designed for a total drag load of 100 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-1-4 for 100.0 plf.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
14) User defined: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 7-10=-16(F), 1-6=-80(F)
Concentrated Loads (lb)
Vert: 10=-5860(F)

Job J-21-01726-E	Truss FT2S- Cond3	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367375
---------------------	-----------------------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:58 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-aQE6aSSmIOHHb?snAjnXupKTSvTFikQEwZrBFyZOW7



Scale = 1:18.5

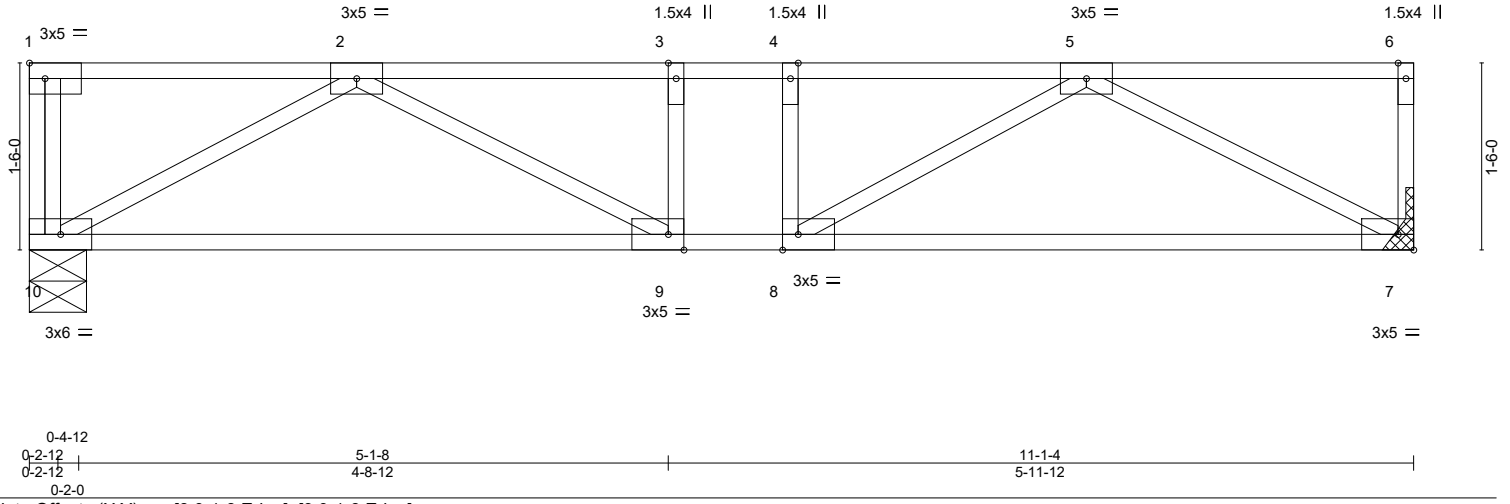


Plate Offsets (X, Y)--	[8:0-1-8,Edge], [9:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.32	Vert(LL) -0.09 9-10 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.49	Vert(CT) -0.19 9-10 >680 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.27	Horz(CT) 0.02 7 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 46 lb	FT = 20%F, 11%E


LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 7=Mechanical, 10=0-5-8
 Max Uplift 10=5336(LC 14)
 Max Grav 7=540(LC 2), 10=540(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-250/225, 2-3=-1124/0, 3-4=-1073/0, 4-5=-1111/0, 5-6=-256/231
 BOT CHORD 9-10=-79/812, 8-9=0/1073, 7-8=-55/810
 WEBS 5-7=-935/84, 5-8=-187/591, 2-10=-922/83, 2-9=-198/604

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5336 lb uplift at joint 10.
 - 5) Load case(s) 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 6) This truss has been designed for a total drag load of 100 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-1-4 for 100.0 plf.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
 14) User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 7-10=-16(F), 1-6=-80(F)
 Concentrated Loads (lb)
 Vert: 10=5860(F)

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	--

Job J-21-01726-E	Truss FT3	Truss Type Floor	Qty 3	Ply 1	HBG-LOT 3	K10367376
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:59 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-2coUnos?TIP8C9R_kQlMR0sdbJoZR8LNealPjhyZOW6



Scale = 1:30.4

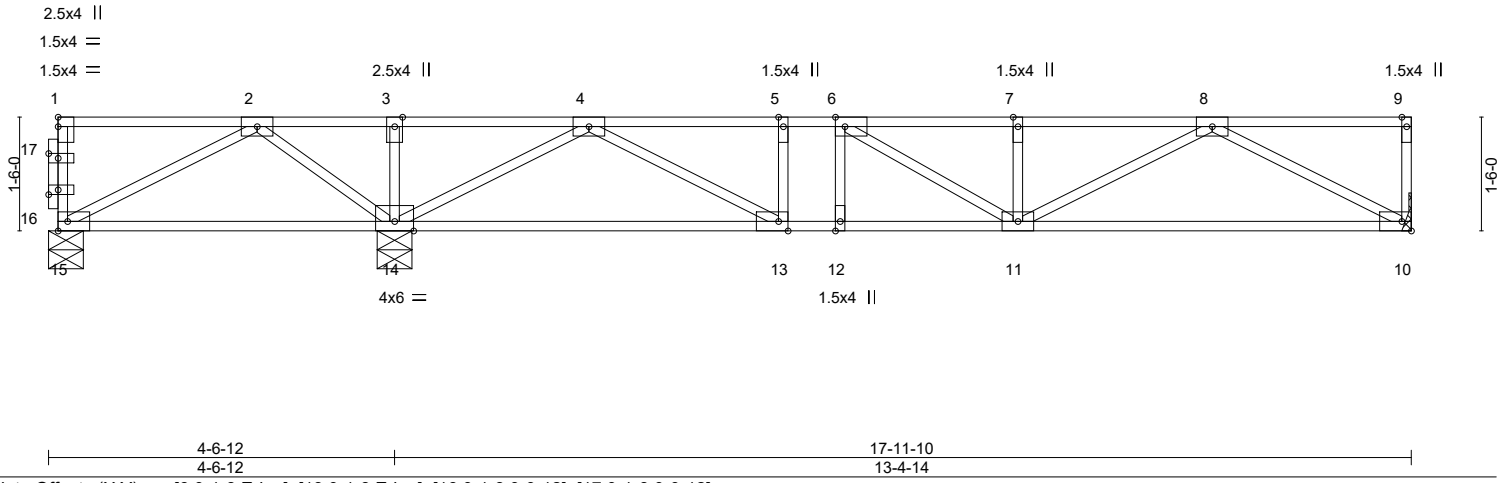


Plate Offsets (X,Y)--	[6:0-1-8,Edge], [13:0-1-8,Edge], [16:0-1-8,0-0-12], [17:0-1-8,0-0-12]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.43	Vert(LL) -0.07 11-12 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.55	Vert(CT) -0.14 10-11 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.48	Horz(CT) 0.01 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 73 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 14-15.

REACTIONS. (size) 14=0-5-8, 15=0-5-8, 10=Mechanical
Max Grav 14=2351(LC 1), 15=980(LC 3), 10=555(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-15=-961/0, 2-3=0/801, 3-4=0/801, 4-5=-1033/0, 5-6=-1033/0, 6-7=-1215/0, 7-8=-1215/0
BOT CHORD 14-15=-435/0, 13-14=0/320, 12-13=0/1033, 11-12=0/1033, 10-11=0/820
WEBS 3-14=-1311/0, 2-15=0/494, 2-14=-610/0, 4-14=-1245/0, 4-13=0/818, 8-10=-930/0, 8-11=0/449, 6-11=-21/310

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x5 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 877 lb down at 0-2-4, and 1145 lb down at 4-6-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 10-15=-16, 1-9=-80
Concentrated Loads (lb)
Vert: 1=-877(F) 3=-1145(F)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FT4A	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367377
---------------------	---------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:01 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-?wECUuf?JfsSTbMrrKEWRy?66Yuv7Eg6unVoZyZOW4



Scale = 1:30.1

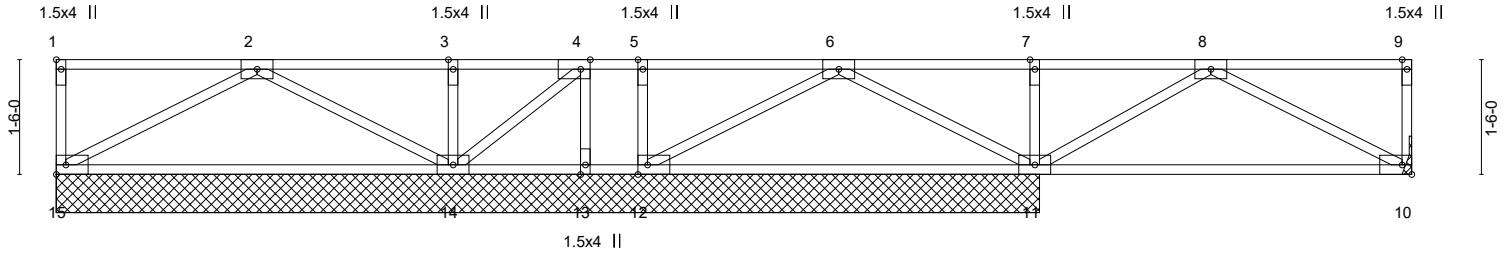


Plate Offsets (X,Y)--	[1:Edge,0-0-12], [4:0-1-8,Edge], [12:0-1-8,Edge]
-----------------------	--


LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.30	Vert(LL) 0.00	11	****	480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00		BC 0.30	Vert(CT) -0.10	14-15	>607	360		
BCLL 0.0	Rep Stress Incr NO		WB 0.13	Horz(CT) 0.00	10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 72 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 14-15.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. All bearings 12-10-4 except (jt=length) 10=Mechanical.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) 15, 12, 10 except 13=-254(LC 7)
 Max Grav All reactions 250 lb or less at joint(s) 13 except 11=535(LC 1), 15=277(LC 12), 14=422(LC 8), 12=422(LC 12), 10=274(LC 11)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-256/256, 2-3=-240/264, 5-6=-264/284, 6-7=-236/266, 7-8=-228/259, 8-9=-256/256
 BOT CHORD 14-15=-238/340, 11-12=-254/317, 10-11=-208/306
 WEBS 2-15=-380/262, 6-11=-416/264, 2-14=-447/251, 6-12=-409/270, 4-14=-310/305, 8-10=-377/277, 8-11=-428/240

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x5 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 12, 10 except (jt=lb) 13=254.
 - 6) This truss has been designed for a total drag load of 100 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 17-8-10 for 100.0 plf.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.

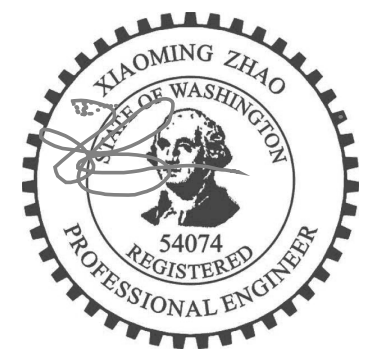

September 27, 2021


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	---

Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367379
J-21-01726-E	FT6	Floor	1	1		


Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:04 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-PabNqVw7IE2QJwJxWzux84aQHKQE6Hh6os0APuyZOW1



Scale = 1:34.1

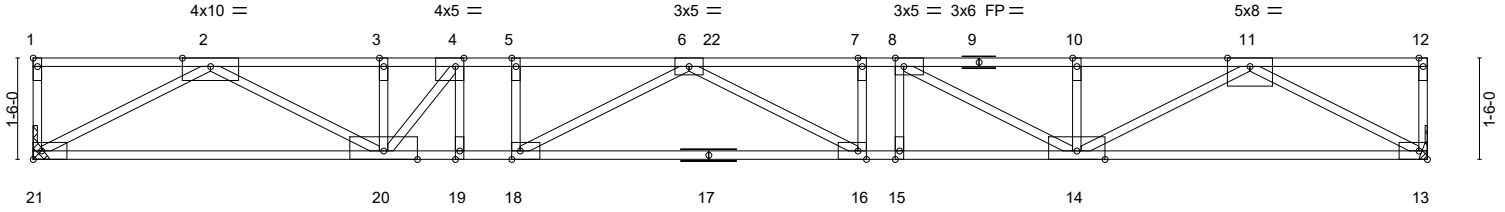

DEFLECTION HERE IS .57" BUT THE NEXT TRUSS (FT5) DEFLECTS ONLY .24". DEFLECTIONS SHOULD BE WITHIN 1/8" BETWEEN ADJACENT TRUSSES. (TYP.)

Plate Offsets (X,Y)-- [1:Edge,0-0-12], [4:0-1-8,Edge], [8:0-1-8,Edge], [16:0-1-8,Edge], [18:0-1-8,Edge]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/d	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.69	Vert(LL)	-0.35	16-18	>707	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.83	Vert(CT)	-0.57	16-18	>431	360	M18SHS	220/195
BCLL 0.0	Rep Stress Incr	NO	WB 0.98	Horz(CT)	-0.07	21	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S							

LUMBER-
TOP CHORD 2x4 DF 2400F 2.0E(flat)
BOT CHORD 2x4 DF 2400F 2.0E(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 13=Mechanical, 21=Mechanical
Max Grav 13=1104(LC 1), 21=1166(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3437/0, 3-4=-3437/0, 4-5=-4163/0, 5-6=-4163/0, 6-7=-4222/0, 7-8=-4222/0, 8-10=-3228/0, 10-11=-3228/0
BOT CHORD 20-21=0/1957, 19-20=0/4163, 18-19=0/4163, 16-18=0/4637, 15-16=0/4222, 14-15=0/4222, 13-14=0/1837
WEBS 4-19=0/378, 7-16=0/265, 2-21=-2221/0, 2-20=0/1679, 4-20=-1243/0, 6-18=-683/0, 6-16=-700/0, 11-13=-2085/0, 11-14=0/1578, 8-14=-1189/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 20 degree rotation about its center.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-21=-16, 1-4=-80, 4-22=-160(F=80), 12-22=-80



September 27, 2021

Job J-21-01726-E	Truss FT6A	Truss Type Floor	Qty 3	Ply 1	HBG-LOT 3	K10367380
---------------------	---------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:06 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-Lyj7FByOpsI8YETKeOwPDVfoS77CaENPFVAVGTnyZOW?



Scale = 1:34.2

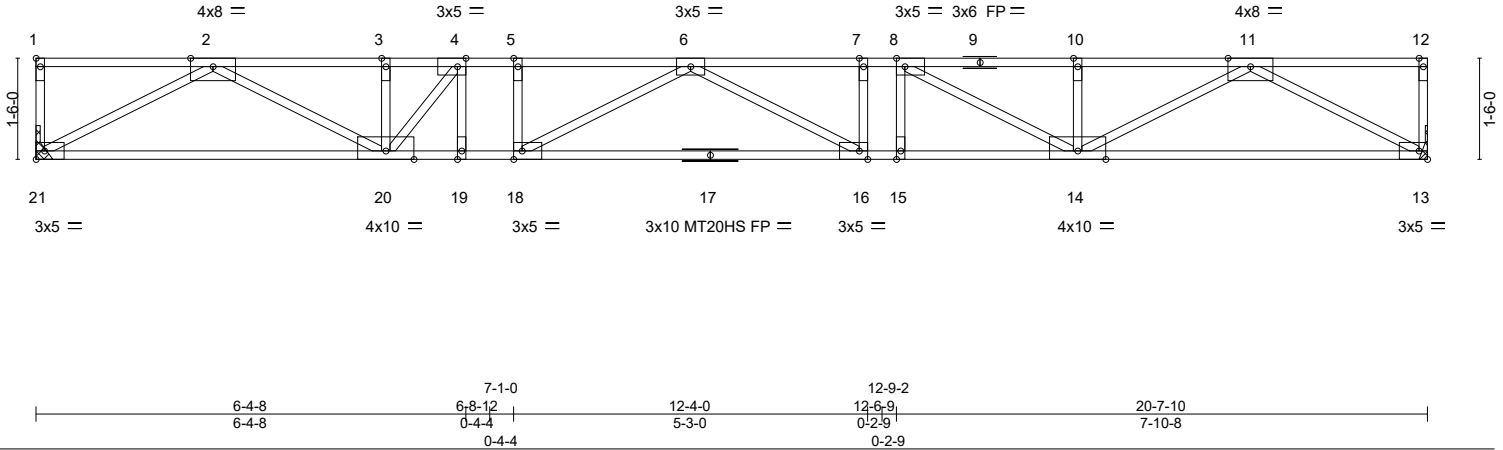


Plate Offsets (X,Y)--	[1:Edge,0-0-12], [4:0-1-8,Edge], [8:0-1-8,Edge], [16:0-1-8,Edge], [18:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.52	Vert(LL) -0.30 16-18 >833 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.80	Vert(CT) -0.50 16-18 >495 360	MT20HS	165/146
BCLL 0.0	Rep Stress Incr YES	WB 0.78	Horz(CT) -0.07 21 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 92 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 DF No.1&Btr(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 13=Mechanical, 21=Mechanical
Max Grav 13=984(LC 1), 21=984(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2771/0, 3-4=-2771/0, 4-5=-3262/0, 5-6=-3262/0, 6-7=-3525/0, 7-8=-3525/0, 8-10=-2789/0, 10-11=-2789/0
BOT CHORD 20-21=0/1619, 19-20=0/3262, 18-19=0/3262, 16-18=0/3676, 15-16=0/3525, 14-15=0/3525, 13-14=0/1615
WEBS 2-21=-1838/0, 2-20=0/1306, 4-20=-873/0, 6-18=-614/0, 6-16=-400/0, 11-13=-1833/0, 11-14=0/1332, 8-14=-898/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 20 degree rotation about its center.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-E	Truss FT7	Truss Type Floor	Qty 5	Ply 1	HBG-LOT 3	K10367381
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:07 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-p9HWTXz0a9Q?AO2WC6RemiBy1XTOJhZYUqEq?DyZOW_



Scale = 1:32.7

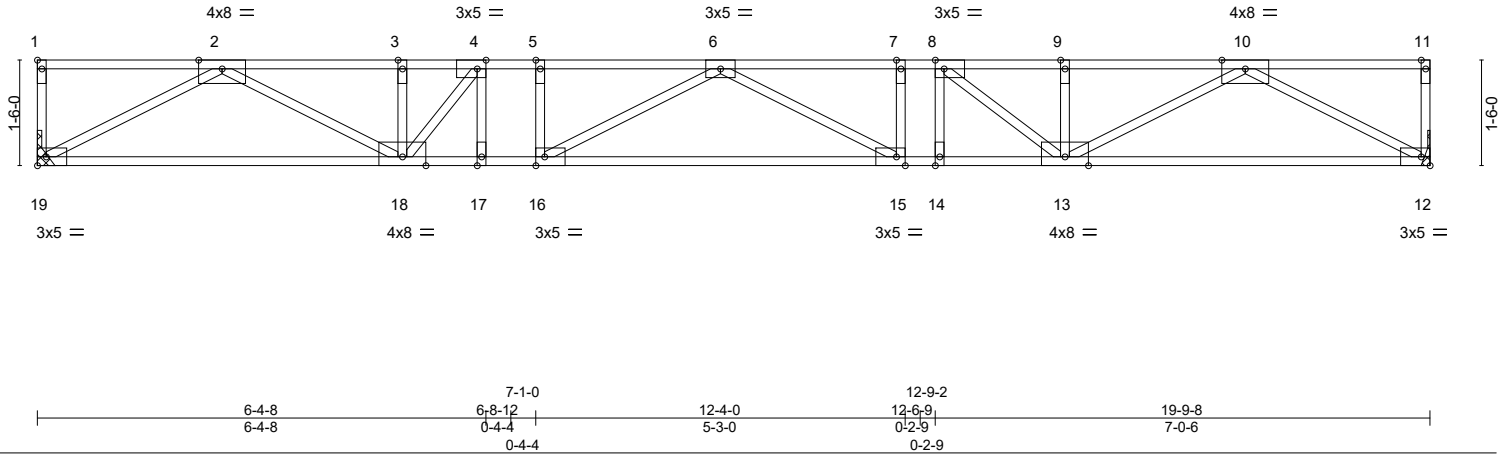


Plate Offsets (X,Y)-- [1:Edge,0-0-12], [4:0-1-8,Edge], [8:0-1-8,Edge], [15:0-1-8,Edge], [16:0-1-8,Edge]										
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.59	Vert(LL)	-0.31	15-16	>774	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.80	Vert(CT)	-0.51	15-16	>460	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.72	Horz(CT)	-0.06	19	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 85 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 5-11-1 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 19=Mechanical, 12=Mechanical
Max Grav 19=943(LC 1), 12=943(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2622/0, 3-4=-2622/0, 4-5=-3066/0, 5-6=-3066/0, 6-7=-3163/0, 7-8=-3163/0, 8-9=-2626/0, 9-10=-2626/0
BOT CHORD 18-19=0/1544, 17-18=0/3066, 16-17=0/3066, 15-16=0/3388, 14-15=0/3163, 13-14=0/3163, 12-13=0/1542
WEBS 4-17=0/273, 2-19=-1752/0, 2-18=0/1223, 4-18=-804/0, 6-16=-515/0, 6-15=-436/0, 10-12=-1750/0, 10-13=0/1230, 8-13=-757/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.




September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	---

Job J-21-01726-E	Truss FT8	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367382
---------------------	--------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:09 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHInztALX-IXOGuD_G6ngjPiCvJXU6r7HFnl7wnacrx8jw36yZOVy



Scale = 1:19.5

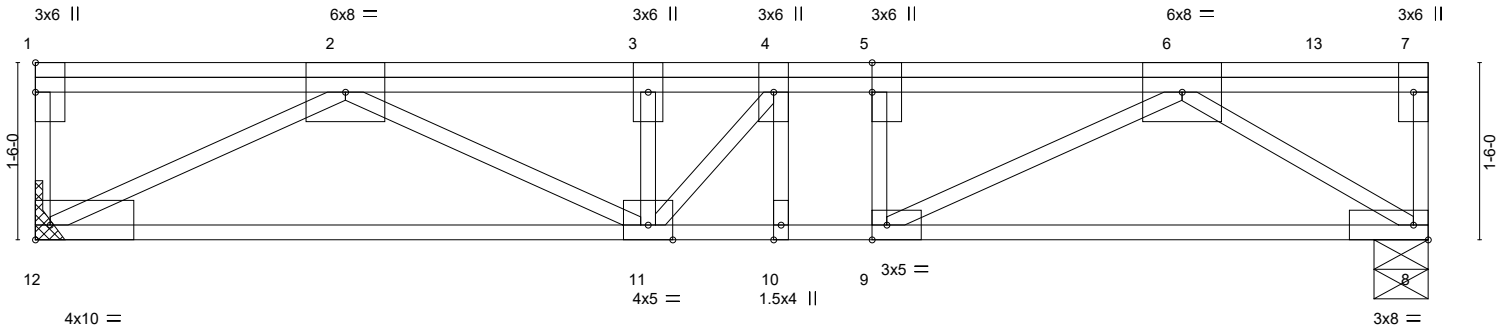


Plate Offsets (X,Y)--	[5:0-3-0,0-0-0], [9:0-1-8,Edge], [12:Edge,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.77	Vert(LL)	-0.08	10-11	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.86	Vert(CT)	-0.17	11-12	>837		
BCLL 0.0	Rep Stress Incr	NO	WB 0.81	Horz(CT)	-0.04	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 62 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 HF No.2(flat)
 BOT CHORD 2x4 HF No.2(flat)
 WEBS 2x4 HF Stud/Std(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 12=Mechanical, 8=0-5-8
 Max Grav 12=1644(LC 1), 8=1636(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-12=-315/0, 7-8=-587/0, 2-3=-2589/0, 3-4=-2589/0, 4-5=-2319/0, 5-6=-2319/0
 BOT CHORD 11-12=0/2530, 10-11=0/2319, 9-10=0/2319, 8-9=0/1572
 WEBS 5-9=-298/12, 2-12=-2842/0, 2-11=-138/318, 3-11=-261/9, 4-11=-61/603, 6-9=0/1004, 6-8=-1875/0

NOTES-

- Unbalanced floor live loads have been considered for this design.
- Plates checked for a plus or minus 20 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 760 lb down at 2-8-0, and 760 lb down at 10-11-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 8-12=-16, 1-2=-270(F=-190), 2-13=-80, 7-13=-270(F=-190)
 Concentrated Loads (lb)
 Vert: 2=-760(F) 13=-760(F)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




250 Klug Circle
 Corona, CA 92880


Job J-21-01726-E	Truss FT9	Truss Type Floor	Qty 4	Ply 1	HBG-LOT 3	K10367383
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:10 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-Ekye5Z?ut4oa1m5tE?LOLPXXIb4WBJ?AoTUbYyZOvx



Scale = 1:22.5

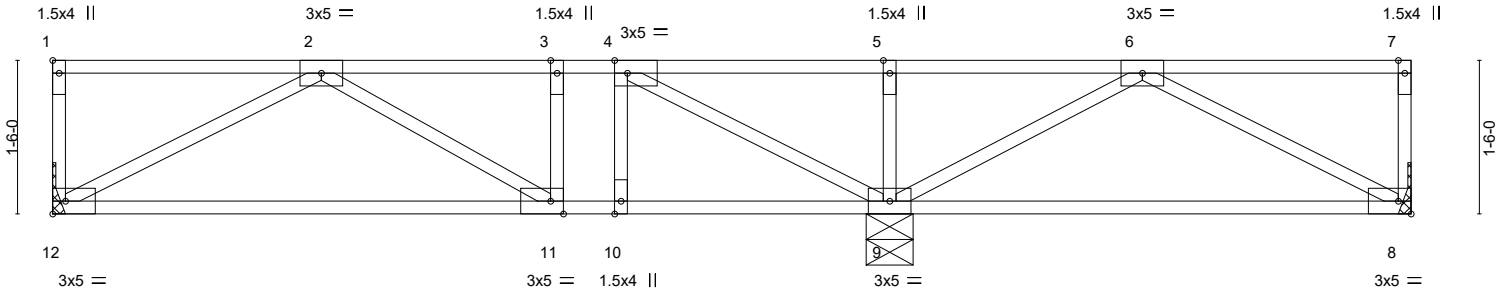

	8-2-2	8-2,14	13-3-4
	8-2-2	0-0-12	5-0-6
Plate Offsets (X,Y)--	[1:Edge,0-0-12], [4:0-1-8,Edge], [11:0-1-8,Edge]		


LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.04	11-12	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.36	Vert(CT)	-0.14	11-12	>690		
BCLL 0.0	Rep Stress Incr	YES	WB 0.18	Horz(CT)	0.01	8	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 54 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 9=0-5-8, 12=Mechanical, 8=Mechanical
Max Grav 9=690(LC 1), 12=372(LC 3), 8=238(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-494/0, 3-4=-494/0
BOT CHORD 11-12=0/483, 10-11=0/494, 9-10=0/494
WEBS 2-12=-548/0, 4-9=-627/0, 6-8=-264/0, 6-9=-292/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.

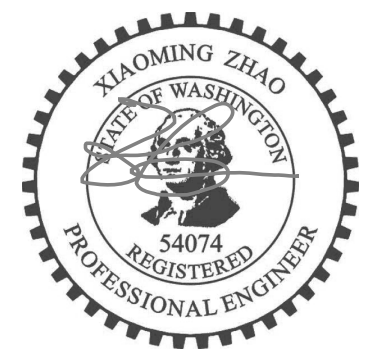


September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-E	Truss FT10	Truss Type Floor	Qty 5	Ply 1	HBG-LOT 3	K10367384
---------------------	---------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:25 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-24kdfASgTF7z7xrSkHho3rSrfcFgTrpNql3bWfyZOwe



Scale = 1:14.3

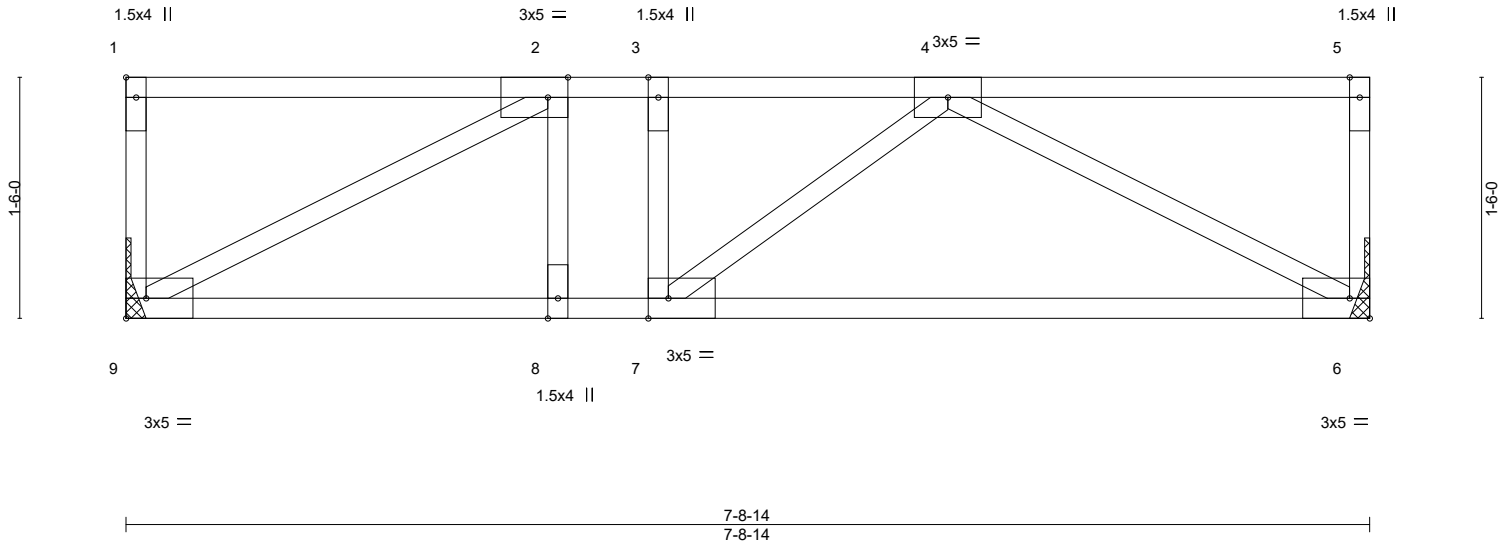


Plate Offsets (X,Y)--	[1:Edge,0-0-12], [2:0-1-8,Edge], [7:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.27	Vert(LL) -0.03 6-7 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.29	Vert(CT) -0.09 6-7 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.17	Horz(CT) 0.01 6 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 33 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 6=Mechanical, 9=Mechanical
Max Grav 6=365(LC 1), 9=365(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-508/0, 3-4=-508/0
BOT CHORD 8-9=0/508, 7-8=0/508, 6-7=0/474
WEBS 4-6=-538/0, 2-9=-573/0

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) Plates checked for a plus or minus 20 degree rotation about its center.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367385
J-21-01726-E	FT11	Floor	1	1		


Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:26 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-WGI0sWTIEZFq5PEl?C1b3?uh?S4CCpW3yp935yZOWd



Scale = 1:18.2

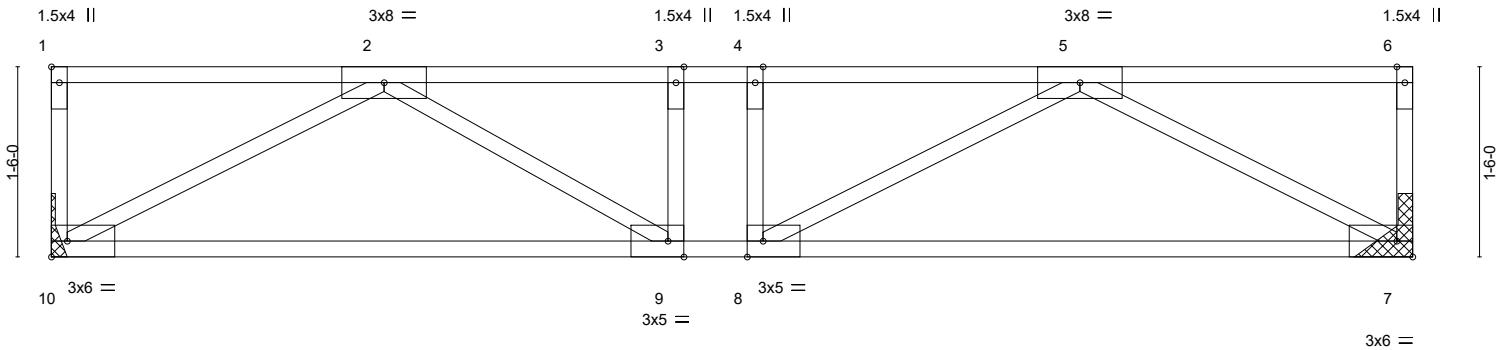

10-8-14
10-8-14

Plate Offsets (X,Y)-- [1:Edge,0-0-12], [8:0-1-8,Edge], [9:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.83	Vert(LL)	-0.11	7-8	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.85	Vert(CT)	-0.25	7-8	>512		
BCLL 0.0	Rep Stress Incr	NO	WB 0.57	Horz(CT)	0.03	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 44 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 7=Mechanical, 10=Mechanical
Max Grav 7=1168(LC 1), 10=1168(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2315/0, 3-4=-2315/0, 4-5=-2315/0
BOT CHORD 9-10=0/1720, 8-9=0/2315, 7-8=0/1723
WEBS 5-7=-1955/0, 2-10=-1952/0, 5-8=0/770, 2-9=0/797, 3-9=-275/0, 4-8=-267/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 7-10=-20, 1-6=-200(F=-100)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367386
J-21-01726-E	FT12	Floor	1	1		

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:30 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-O1YWitWoloFEijPXqHzmv9gQdyX8yc6zanMCsyZOwZ



Scale = 1:34.6

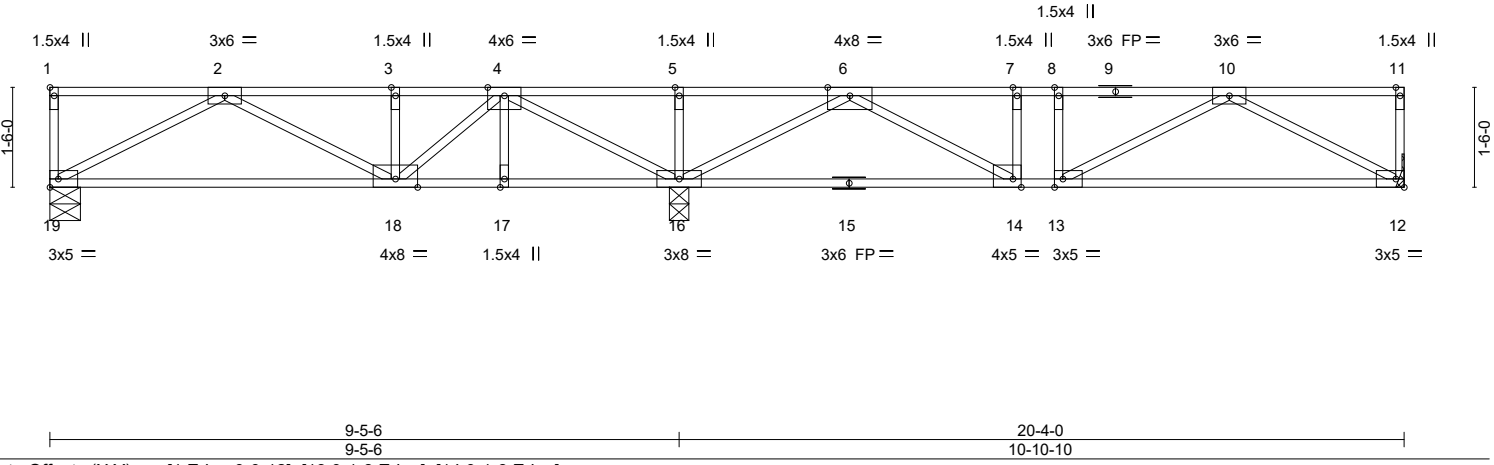


Plate Offsets (X,Y)--	[1:Edge,0-0-12], [13:0-1-8,Edge], [14:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.39	Vert(LL) -0.11 12-13 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.31	Vert(CT) -0.19 12-13 >671 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.71	Horz(CT) 0.01 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 90 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 DF 2400F 2.0E(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 DF 2400F 2.0E(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 12=Mechanical, 16=0-3-8, 19=0-5-8
 Max Uplift 12=-192(LC 7), 19=-451(LC 6)
 Max Grav 12=1116(LC 11), 16=1807(LC 1), 19=701(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-897/897, 2-3=-1215/992, 3-4=-707/383, 4-5=-990/1753, 5-6=-331/1258,
 6-7=-2272/710, 7-8=-1689/0, 8-10=-2032/390, 10-11=-897/897
 BOT CHORD 18-19=-740/989, 17-18=-969/786, 16-17=-862/679, 14-16=-958/1577, 13-14=0/1689,
 12-13=-643/1723
 WEBS 5-16=-362/0, 2-19=-1275/1043, 4-16=-1625/890, 2-18=-1114/1133, 10-12=-1976/553,
 6-16=-2333/444, 10-13=-907/1186, 6-14=-740/1605, 7-14=-578/229, 8-13=-360/323,
 4-18=-674/1042

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=192, 19=451.
 - 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 20-4-0 for 350.0 plf.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 12-19=-16, 1-5=-80, 5-11=-180(F=-100)

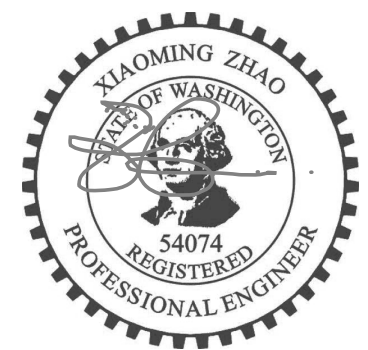

September 27, 2021

Job J-21-01726-E	Truss FT13	Truss Type Floor	Qty 9	Ply 1	HBG-LOT 3	K10367387
---------------------	---------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:31 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-tD5vvDXR35u6rslb5YoCl6inf0BotNdFCDWwkJyZOWY



Scale = 1:37.0

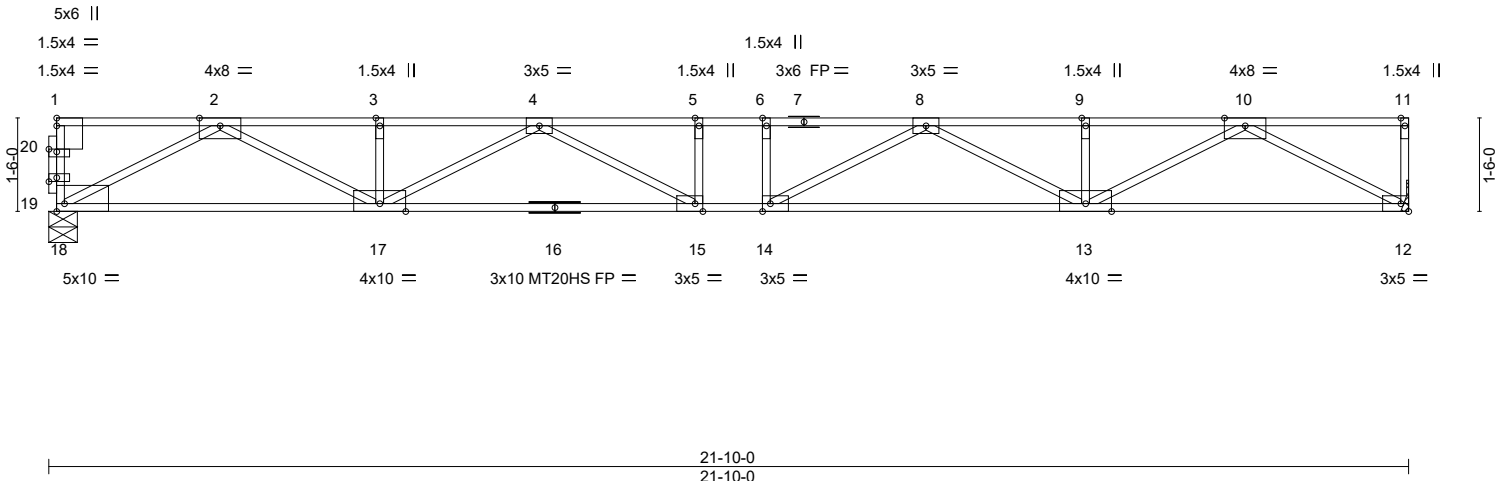


Plate Offsets (X,Y)--	[14:0-1-8,Edge], [15:0-1-8,Edge], [18:Edge,0-1-8], [19:0-1-8,0-0-12], [20:0-1-8,0-0-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.68	Vert(LL)	-0.33	15	>778	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.75	Vert(CT)	-0.50	13-14	>513	360	MT20HS	165/146
BCLL 0.0	Rep Stress Incr	NO	WB 0.85	Horz(CT)	0.08	12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 91 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 5-4-12 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 12=Mechanical, 18=0-5-8
Max Grav 12=1035(LC 1), 18=3287(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-2333/0, 2-3=-2993/0, 3-4=-2993/0, 4-5=-4075/0, 5-6=-4075/0, 6-8=-4075/0, 8-9=-2993/0, 9-10=-2993/0
BOT CHORD 17-18=0/1715, 15-17=0/3739, 14-15=0/4075, 13-14=0/3739, 12-13=0/1715
WEBS 2-18=-1947/0, 2-17=0/1450, 4-17=-847/0, 4-15=-22/629, 10-12=-1946/0, 10-13=0/1451, 8-13=-847/0, 8-14=-22/629

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2252 lb down at 0-2-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-18=-16, 1-11=-80
Concentrated Loads (lb)
Vert: 1=-2252(F)



September 27, 2021

Job J-21-01726-E	Truss FT14- Cond1	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367388
---------------------	-----------------------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:38 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnzALX-9a1YNccqPFm7BxKx?WQr5bVw9Xi0XFHppjnUPyZOWr

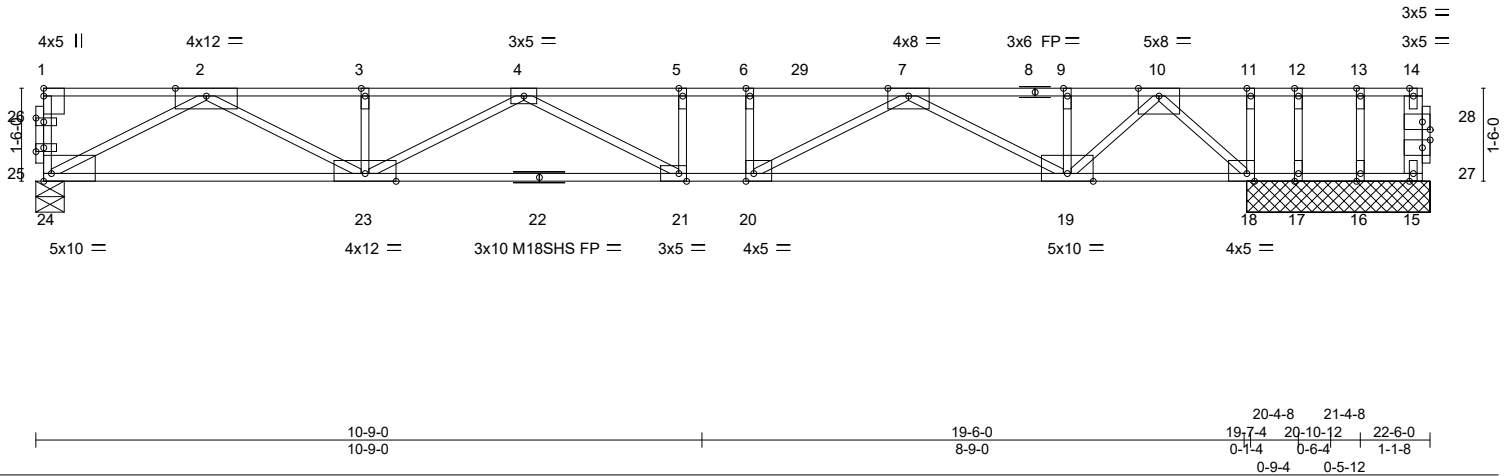



Plate Offsets (X,Y)--	[18:0-1-8,Edge], [20:0-1-8,Edge], [21:0-1-8,Edge], [24:Edge,0-1-8], [25:0-1-8,0-0-12], [26:0-1-8,0-0-12], [27:0-1-8,0-1-8], [28:0-1-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.86	Vert(LL)	-0.27	21-23	>861	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.93	Vert(CT)	-0.58	21-23	>398	M18SHS	220/195
BCLL 0.0	Rep Stress Incr	NO	WB 0.92	Horz(CT)	0.11	15	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 102 lb	FT = 20%F, 11%E


LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 DF 2400F 2.0E(flat)	TOP CHORD Structural wood sheathing directly applied or 5-11-12 oc purlins, except end verticals.	
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat) *Except* 14-15: 4x4 DF No.2&BTR G(flat), 2-23: 2x4 HF No.2(flat)		

REACTIONS. All bearings 2-11-8 except (jt=length) 24=0-5-8.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 17=-215(LC 9)
 Max Grav All reactions 250 lb or less at joint(s) except 15=262(LC 4), 24=3478(LC 3), 18=1773(LC 1), 16=890(LC 1), 17=662(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-24=-2335/0, 14-15=-259/0, 2-3=-3703/0, 3-4=-3703/0, 4-5=-4899/0, 5-6=-4899/0, 6-7=-4899/0, 7-9=-2303/0, 9-10=-2303/0
 BOT CHORD 23-24=0/2068, 21-23=0/4798, 20-21=0/4899, 19-20=0/3892, 18-19=0/1156
 WEBS 2-24=-2347/0, 2-23=0/1857, 4-23=-1243/0, 4-21=-382/623, 7-19=-1804/0, 7-20=0/1172, 6-20=-473/0, 11-18=-572/0, 10-19=0/1571, 10-18=-1578/0, 13-16=-852/0, 12-17=-686/120

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 215 lb uplift at joint 17.
 - Load case(s) 3, 4, 5, 6, 8 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2252 lb down at 0-2-4, and 310 lb down at 7-7-12, and 310 lb down at 12-4-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 15-24=-16, 1-11=-80, 11-14=-792(F=-712)

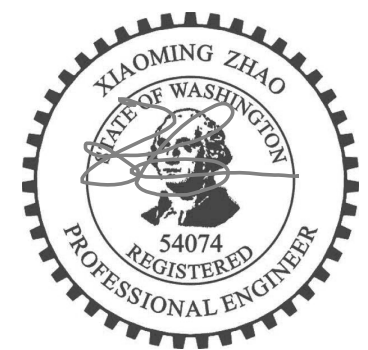

September 27, 2021

Job J-21-01726-E	Truss FT14- Cond1	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367388
---------------------	-----------------------------	----------------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:38 2021 Page 2
ID:49MjCVuD74jFLC0rXMNHlnztALX-9a1YNccqPFm7BxKx?WQr5bVw9rXi0XFHppjnUPyZOwR

LOAD CASE(S) Standard

Concentrated Loads (lb)

Vert: 1=-2252(F) 4=-310(F) 29=-310(F)

3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 15-24=-16, 1-11=-80, 11-14=-253(F=-237)

Concentrated Loads (lb)

Vert: 1=-2252(F) 4=-310(F) 29=-310(F)

4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 15-24=-16, 1-11=-16, 11-14=-792(F=-712)

Concentrated Loads (lb)

Vert: 1=-751(F) 4=-103(F) 29=-103(F)

5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 15-24=-16, 1-11=-80, 11-14=-253(F=-237)

Concentrated Loads (lb)

Vert: 1=-2252(F) 4=-310(F) 29=-310(F)

6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 15-24=-16, 1-11=-16, 11-14=-792(F=-712)

Concentrated Loads (lb)

Vert: 1=-751(F) 4=-103(F) 29=-103(F)

8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 15-24=-16, 1-5=-16, 5-11=-80, 11-14=-792(F=-712)

Concentrated Loads (lb)

Vert: 1=-751(F) 4=-103(F) 29=-310(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FT14- Cond2	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367388
---------------------	-----------------------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:38 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnzALX-9a1YNccqPFm7BxKx?WQr5bVw9rXi0XFHppjnUPyZOWR

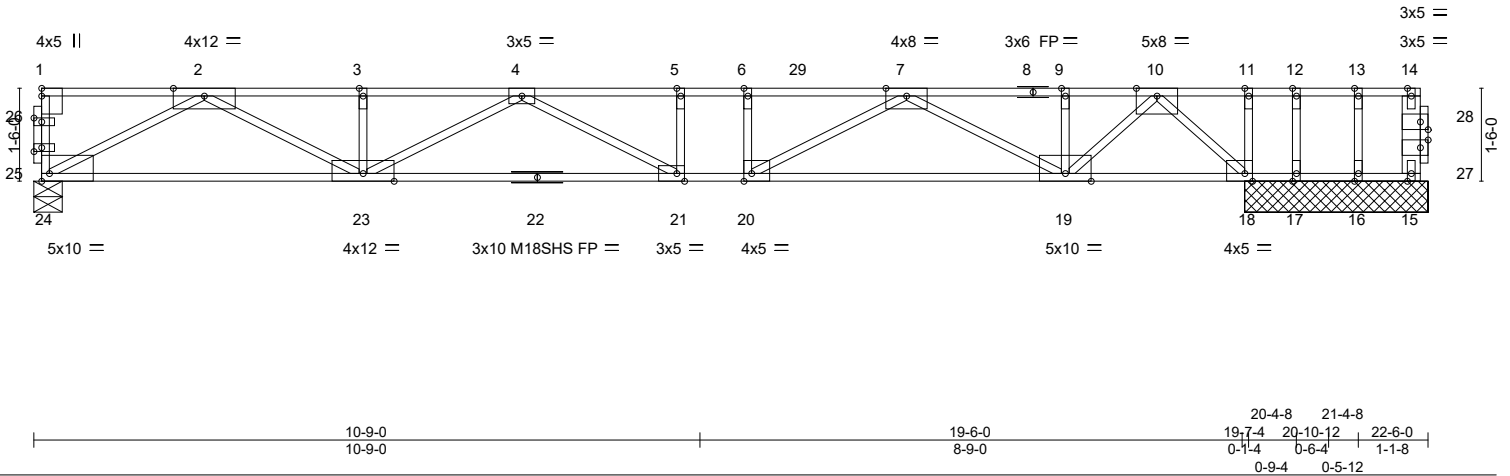

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.86	Vert(LL)	-0.27	21-23	>861	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.93	Vert(CT)	-0.58	21-23	>398	M18SHS	220/195
BCLL 0.0	Rep Stress Incr	NO	WB 0.92	Horz(CT)	0.11	15	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 102 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 DF 2400F 2.0E(flat)	TOP CHORD Structural wood sheathing directly applied or 5-11-12 oc purlins, except end verticals.	
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat) *Except* 14-15: 4x4 DF No.2&BTR G(flat), 2-23: 2x4 HF No.2(flat)		


REACTIONS. All bearings 2-11-8 except (jt=length) 24=0-5-8.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 17=-215(LC 9)
 Max Grav All reactions 250 lb or less at joint(s) except 15=1961(LC 23), 24=3478(LC 3), 18=1773(LC 23), 16=890(LC 23), 17=662(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-24=-2335/0, 14-15=-259/0, 2-3=-3703/0, 3-4=-3703/0, 4-5=-4899/0, 5-6=-4899/0, 6-7=-4899/0, 7-9=-2303/0, 9-10=-2303/0
 BOT CHORD 23-24=0/2068, 21-23=0/4798, 20-21=0/4899, 19-20=0/3892, 18-19=0/1156
 WEBS 2-24=-2347/0, 2-23=0/1857, 4-23=-1243/0, 4-21=-382/623, 7-19=-1804/0, 7-20=0/1172, 6-20=-473/0, 11-18=-572/0, 10-19=0/1571, 10-18=-1578/0, 13-16=-852/0, 12-17=-686/120

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 215 lb uplift at joint 17.
 - Load case(s) 3, 4, 5, 6, 8, 23 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2252 lb down at 0-2-4, and 310 lb down at 7-7-12, and 310 lb down at 12-4-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 15-24=-16, 1-11=-80, 11-14=-792(F=-712)

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	--

Job J-21-01726-E	Truss FT14- Cond2	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367388
---------------------	-----------------------------	----------------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:38 2021 Page 2
ID:49MjCVuD74jFLC0rXMNHlnztALX-9a1YNccqPFm7BxKx?WQr5bVw9rXi0XFHppjnUPyZOwR

LOAD CASE(S) Standard Except:

- Concentrated Loads (lb)
Vert: 1=-2252(F) 4=-310(F) 29=-310(F)
- 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-80, 11-14=-253(F=-237)
Concentrated Loads (lb)
Vert: 1=-2252(F) 4=-310(F) 29=-310(F)
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-16, 11-14=-792(F=-712)
Concentrated Loads (lb)
Vert: 1=-751(F) 4=-103(F) 29=-103(F)
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-80, 11-14=-253(F=-237)
Concentrated Loads (lb)
Vert: 1=-2252(F) 4=-310(F) 29=-310(F)
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-16, 11-14=-792(F=-712)
Concentrated Loads (lb)
Vert: 1=-751(F) 4=-103(F) 29=-103(F)
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-24=-16, 1-5=-16, 5-11=-80, 11-14=-792(F=-712)
Concentrated Loads (lb)
Vert: 1=-751(F) 4=-103(F) 29=-310(F)
- 23) User defined: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 15-24=-16(F), 1-11=-80(F), 11-14=-792(F)
Concentrated Loads (lb)
Vert: 1=-2252(F) 15=-1705(F) 4=-310(F) 29=-310(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FT14- Cond3	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3	K10367388
---------------------	-----------------------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:38 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-9a1YNccqPFm7BxKx?WQr5bVw9rXi0XFHppjnUPyZOWR

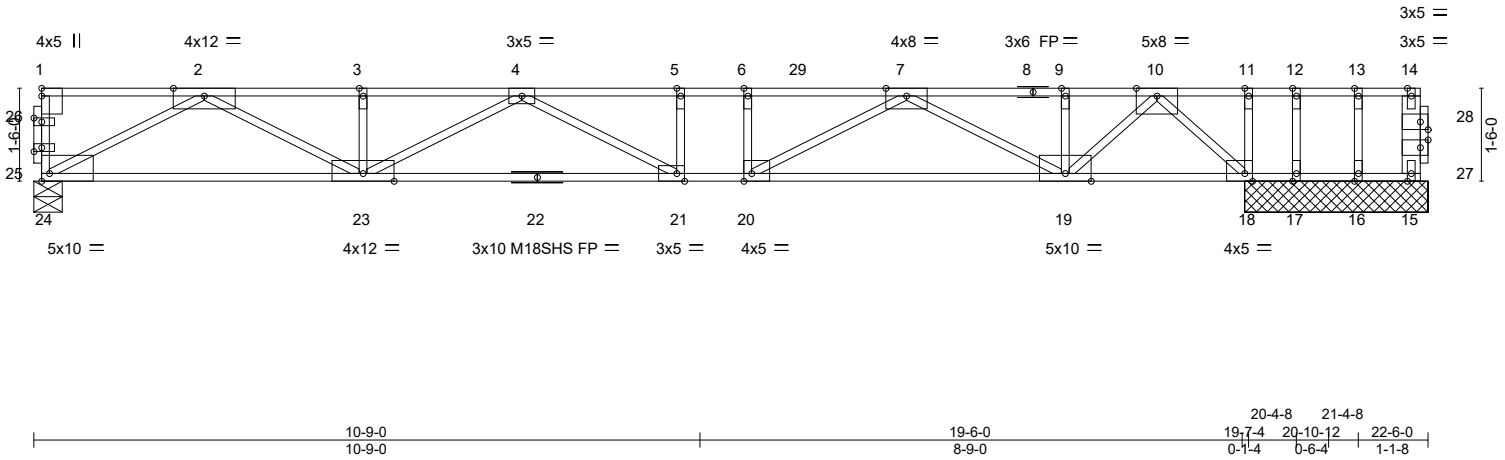



Plate Offsets (X,Y)--	[18:0-1-8,Edge], [20:0-1-8,Edge], [21:0-1-8,Edge], [24:Edge,0-1-8], [25:0-1-8,0-0-12], [26:0-1-8,0-0-12], [27:0-1-8,0-1-8], [28:0-1-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.86	Vert(LL)	-0.27	21-23	>861	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.93	Vert(CT)	-0.58	21-23	>398	360	M18SHS	220/195
BCLL 0.0	Rep Stress Incr	NO	WB 0.92	Horz(CT)	0.11	15	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 102 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 DF 2400F 2.0E(flat)	TOP CHORD Structural wood sheathing directly applied or 5-11-12 oc purlins, except end verticals.	
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat) *Except* 14-15: 4x4 DF No.2&BTR G(flat), 2-23: 2x4 HF No.2(flat)		


REACTIONS. All bearings 2-11-8 except (jt=length) 24=0-5-8.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 15=-1449(LC 23), 17=-215(LC 9)
 Max Grav All reactions 250 lb or less at joint(s) except 15=262(LC 4), 24=3478(LC 3), 18=1773(LC 23), 16=890(LC 23), 17=662(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-24=-2335/0, 14-15=-259/0, 2-3=-3703/0, 3-4=-3703/0, 4-5=-4899/0, 5-6=-4899/0, 6-7=-4899/0, 7-9=-2303/0, 9-10=-2303/0
 BOT CHORD 23-24=0/2068, 21-23=0/4798, 20-21=0/4899, 19-20=0/3892, 18-19=0/1156
 WEBS 2-24=-2347/0, 2-23=0/1857, 4-23=-1243/0, 4-21=-382/623, 7-19=-1804/0, 7-20=0/1172, 6-20=-473/0, 11-18=-572/0, 10-19=0/1571, 10-18=-1578/0, 13-16=-852/0, 12-17=-686/120

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1449 lb uplift at joint 15 and 215 lb uplift at joint 17.
 - Load case(s) 3, 4, 5, 6, 8, 23 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2252 lb down at 0-2-4, and 310 lb down at 7-7-12, and 310 lb down at 12-4-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	--

Job J-21-01726-E	Truss FT14- Cond3	Truss Type Floor Girder	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367388
---------------------	-----------------------------	----------------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:39 2021 Page 2
ID:49MjCVuD74jFLC0rXMNHlnztALX-emawbydSAZuzp4v8ZDx4do15vFtxl_VR2TSL0ryZOwQ

LOAD CASE(S) Standard Except:

- Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-80, 11-14=-792(F=-712)
- Concentrated Loads (lb)
Vert: 1=-2252(F) 4=-310(F) 29=-310(F)
- 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-80, 11-14=-253(F=-237)
 - Concentrated Loads (lb)
Vert: 1=-2252(F) 4=-310(F) 29=-310(F)
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-16, 11-14=-792(F=-712)
 - Concentrated Loads (lb)
Vert: 1=-751(F) 4=-103(F) 29=-103(F)
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-80, 11-14=-253(F=-237)
 - Concentrated Loads (lb)
Vert: 1=-2252(F) 4=-310(F) 29=-310(F)
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
Vert: 15-24=-16, 1-11=-16, 11-14=-792(F=-712)
 - Concentrated Loads (lb)
Vert: 1=-751(F) 4=-103(F) 29=-103(F)
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
Vert: 15-24=-16, 1-5=-16, 5-11=-80, 11-14=-792(F=-712)
 - Concentrated Loads (lb)
Vert: 1=-751(F) 4=-103(F) 29=-310(F)
- 23) User defined: Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
Vert: 15-24=-16(F), 1-11=-80(F), 11-14=-792(F)
 - Concentrated Loads (lb)
Vert: 1=-2252(F) 15=1705(F) 4=-310(F) 29=-310(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FT15	Truss Type Floor	Qty 2	Ply 1	HBG-LOT 3	K10367389
---------------------	---------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:39 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-emawbydSAZuzp4v8ZDx4do1AKF1piAXR2TSL0ryZOwQ



Scale = 1:14.0

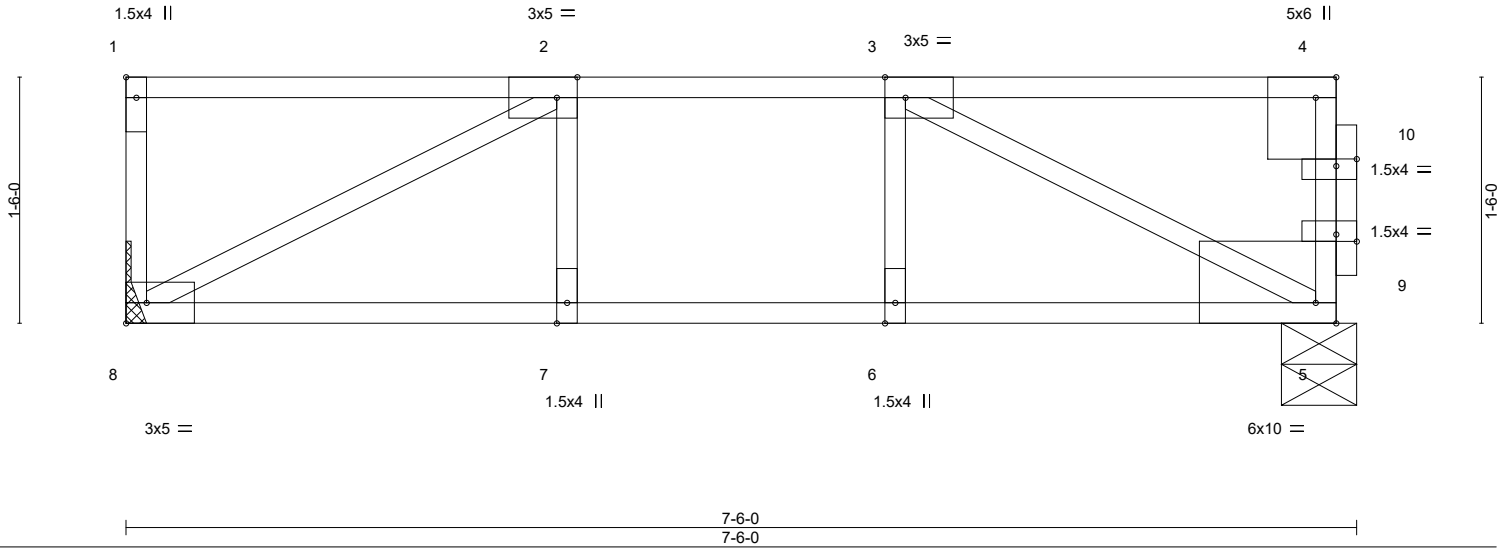


Plate Offsets (X,Y)-- [1:Edge,0-0-12], [2:0-1-8,Edge], [3:0-1-8,Edge], [4:0-1-8,Edge], [5:Edge,0-1-8], [9:0-1-8,0-0-8], [10:0-1-8,0-0-8]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.55	Vert(LL)	-0.04	5-6	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.29	Vert(CT)	-0.05	5-6	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.15	Horz(CT)	0.01	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 31 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 5=0-5-8, 8=Mechanical
Max Grav 5=2600(LC 1), 8=348(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 4-5=-2347/0, 2-3=-461/0
BOT CHORD 7-8=0/461, 6-7=0/461, 5-6=0/461
WEBS 3-5=-521/0, 2-8=-521/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2252 lb down at 7-3-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-8=-16, 1-4=-80
Concentrated Loads (lb)
Vert: 4=-2252(F)



September 27, 2021


Job J-21-01726-E	Truss FT16- Cond1	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367390
---------------------	-----------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:44 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnzALX-_jOpegha?5WGvso5LnXFKsk_FGoLQQBACIA6h2yZOWL

0-1-8

Scale = 1:13.9

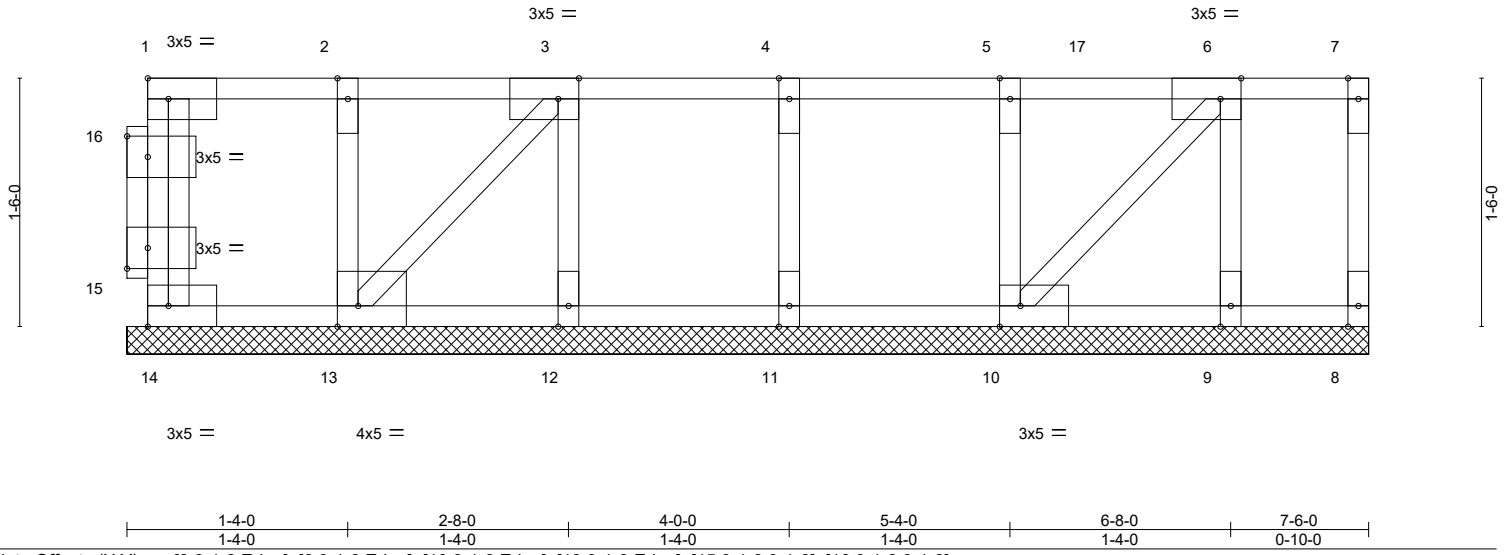

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.76	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.25	Horz(CT)	-0.00	8	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 35 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 DF No.1&Btr(flat)	TOP CHORD	Structural wood sheathing directly applied or 7-6-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)		
OTHERS 2x4 HF Stud/Std(flat)		


REACTIONS. All bearings 7-6-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 14, 8, 12, 11 except 13=1039(LC 1), 10=826(LC 1), 9=863(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-13=-1077/0, 5-10=-734/0, 6-9=-839/0

- NOTES-**
- 1) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.
 - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 720 lb down at 1-7-4, and 720 lb down at 5-10-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-14=-20, 1-2=-460(F=-360), 2-17=-100, 7-17=-460(F=-360)
Concentrated Loads (lb)
Vert: 2=-720(F) 17=-720(F)

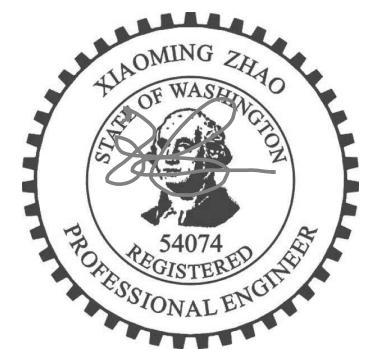

September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-E	Truss FT16- Cond2	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367390
---------------------	-----------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:44 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHInztALX-_jOpegha?5WGvso5LnXFKsk_FGoLQQBACIA6h2yZOWL

0-1-8

Scale = 1:13.9

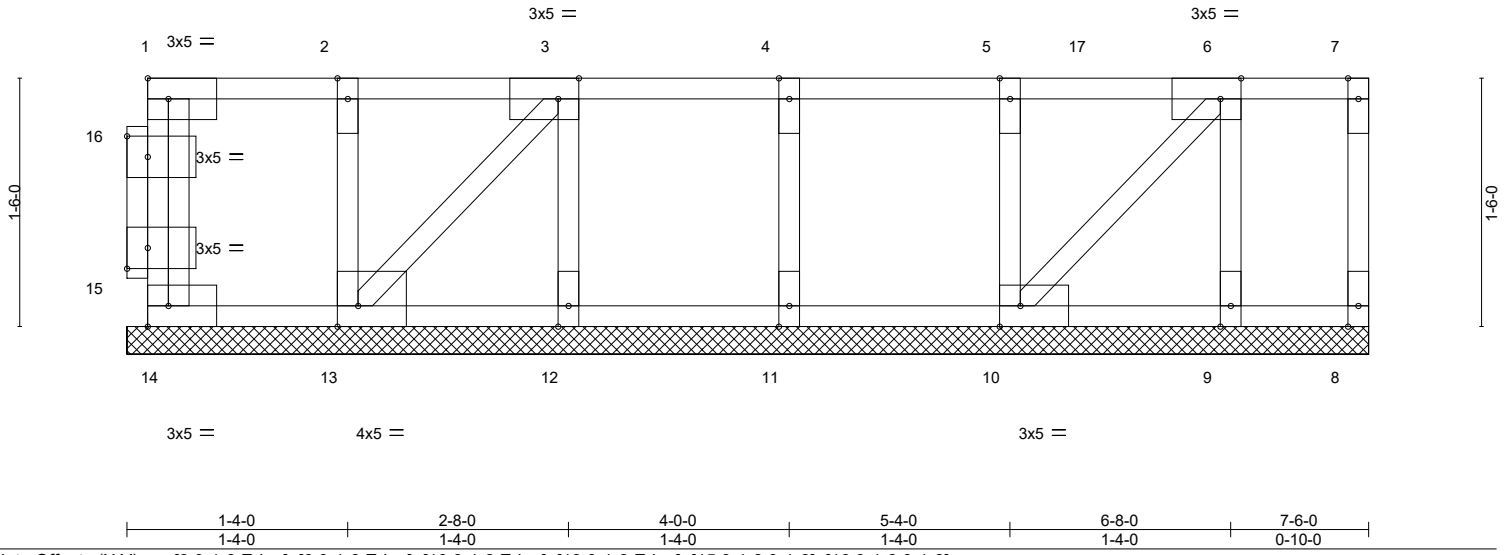


Plate Offsets (X,Y)--	[3:0-1-8,Edge], [6:0-1-8,Edge], [10:0-1-8,Edge], [13:0-1-8,Edge], [15:0-1-8,0-1-8], [16:0-1-8,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.76	Vert(LL) n/a - n/a 999	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.02	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr NO	WB 0.25	Horz(CT) -0.00 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 35 lb	FT = 20%F, 11%E


LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 DF No.1&Btr(flat)	TOP CHORD Structural wood sheathing directly applied or 7-6-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat)		
OTHERS 2x4 HF Stud/Std(flat)		

REACTIONS. All bearings 7-6-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 8, 12, 11 except 14=5512(LC 3), 13=1039(LC 1), 10=826(LC 1), 9=863(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-13=-1077/0, 5-10=-734/0, 6-9=-839/0

- NOTES-**
- All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Load case(s) 3 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 720 lb down at 1-7-4, and 720 lb down at 5-10-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard Except:
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-14=-20, 1-2=-460(F=-360), 2-17=-100, 7-17=-460(F=-360)
Concentrated Loads (lb)
Vert: 2=-720(F) 17=-720(F)
 - User defined: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 8-14=-20(F), 1-2=-460(F), 2-17=-100(F), 7-17=-460(F)
Concentrated Loads (lb)
Vert: 14=-5285(F) 2=-720(F) 17=-720(F)

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	--

Job J-21-01726-E	Truss FT16- Cond3	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367390
---------------------	-----------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:44 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-_jOpegha?5WGvso5LnXFKsk_FGoLQQBACIA6h2yZOwL

0-1-8

Scale = 1:13.9

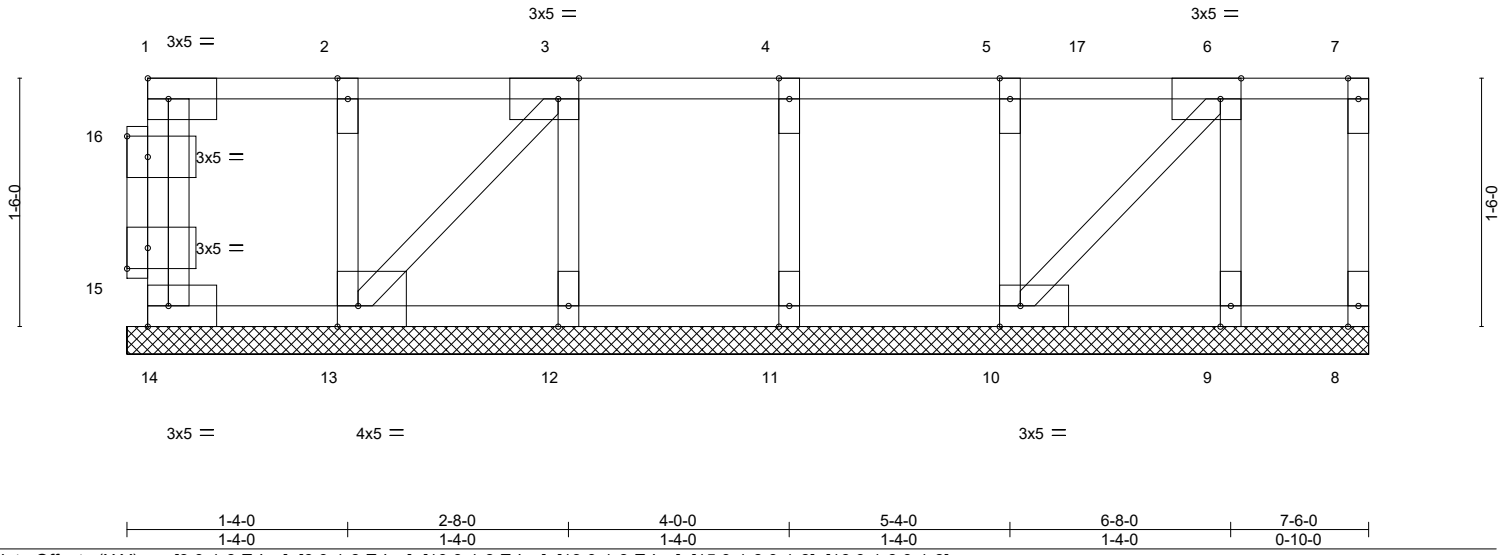


Plate Offsets (X,Y)--	[3:0-1-8,Edge], [6:0-1-8,Edge], [10:0-1-8,Edge], [13:0-1-8,Edge], [15:0-1-8,0-1-8], [16:0-1-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.76	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.25	Horz(CT)	-0.00	8	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 35 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 DF No.1&Btr(flat)	TOP CHORD Structural wood sheathing directly applied or 7-6-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat)		
OTHERS 2x4 HF Stud/Std(flat)		

REACTIONS. All bearings 7-6-0.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 14--5058(LC 3)
 Max Grav All reactions 250 lb or less at joint(s) 14, 8, 12, 11 except 13=1039(LC 1), 10=826(LC 1), 9=863(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-13=-1077/0, 5-10=-734/0, 6-9=-839/0

- NOTES-**
- All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5058 lb uplift at joint 14.
 - Load case(s) 3 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 720 lb down at 1-7-4, and 720 lb down at 5-10-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 8-14=-20, 1-2=-460(F=-360), 2-17=-100, 7-17=-460(F=-360)
 Concentrated Loads (lb)
 Vert: 2=-720(F) 17=-720(F)
- User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 8-14=-20(F), 1-2=-460(F), 2-17=-100(F), 7-17=-460(F)

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>250 Klug Circle Corona, CA 92880</p>
--	---

Job J-21-01726-E	Truss FT16- Cond3	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367390
---------------------	-----------------------------	---------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:44 2021 Page 2
ID:49MjCVuD74jFLC0rXMNHInztALX-_jOpegha?5WGvso5LnXFKsk_FGoLQQBACIA6h2yZOwL

LOAD CASE(S)

Concentrated Loads (lb)

Vert: 14=5285(F) 2=-720(F) 17=-720(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880

Job J-21-01726-E	Truss FT17- Cond1	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367391
---------------------	-----------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:47 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-PI3yGhjTl0vrmJWg1v4yyUMU1TmldmkujiOmNlyZOWl



Scale = 1:13.9

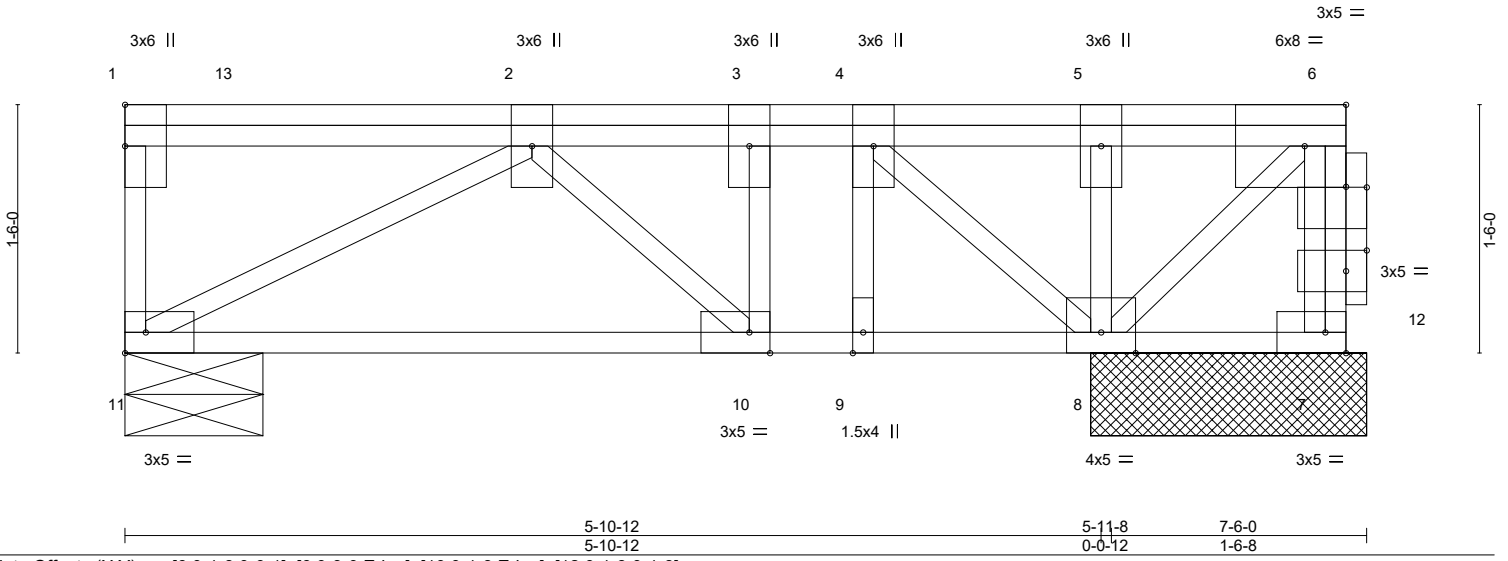


Plate Offsets (X,Y)--	[6:0-1-8,0-0-1], [6:0-3-0,Edge], [10:0-1-8,Edge], [12:0-1-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.78	Vert(LL)	-0.01	10-11	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.29	Vert(CT)	-0.04	10-11	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.26	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 44 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 7-8.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 7=1-8-0, 8=1-8-0, 11=10-10-0
 Max Uplift 7=-55(LC 3)
 Max Grav 7=260(LC 4), 8=1638(LC 1), 11=1101(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-11=-740/0, 6-7=-251/63, 2-3=-254/0, 3-4=-254/0
 BOT CHORD 10-11=0/612, 9-10=0/254, 8-9=0/254
 WEBS 5-8=-1135/0, 2-11=-698/0, 4-8=-553/0, 2-10=-520/0, 3-10=0/408

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 7.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 720 lb down at 0-8-8, and 720 lb down at 5-11-8 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 7-11=-16, 1-13=-440(F=-360), 5-13=-80, 5-6=-440(F=-360)
 Concentrated Loads (lb)
 Vert: 5=-720(F) 13=-720(F)



September 27, 2021

Job J-21-01726-E	Truss FT17- Cond2	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367391
---------------------	-----------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:47 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-PI3yGhjTl0vrmJWg1v4yyUMU1TmidmkujOmiNyzOwl



Scale = 1:13.9

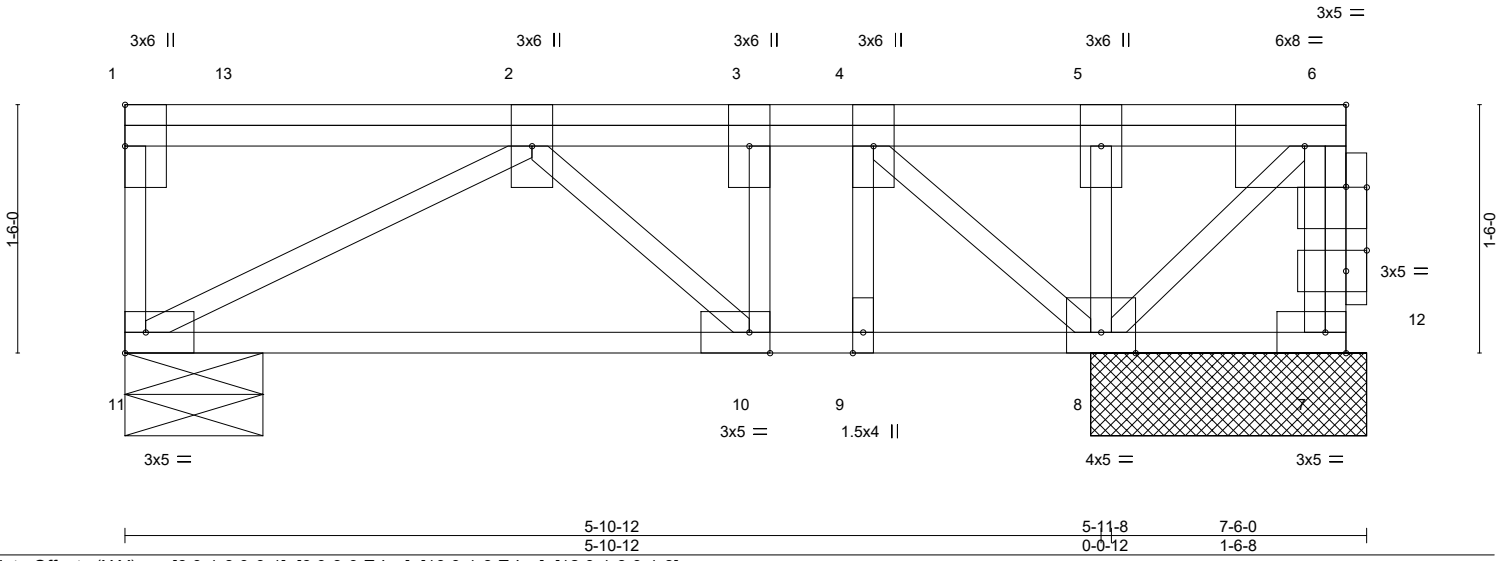


Plate Offsets (X,Y)--	[6:0-1-8,0-0-1], [6:0-3-0,Edge], [10:0-1-8,Edge], [12:0-1-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.78	Vert(LL)	-0.01	10-11	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.29	Vert(CT)	-0.04	10-11	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.26	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 44 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 7-8.	
WEBS 2x4 HF Stud/Std(flat)		


REACTIONS. (size) 7=1-8-0, 8=1-8-0, 11=10-10-0
 Max Uplift 7=-55(LC 3)
 Max Grav 7=5429(LC 11), 8=1638(LC 11), 11=1101(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-11=-740/0, 6-7=-251/63, 2-3=-254/0, 3-4=-254/0
 BOT CHORD 10-11=0/612, 9-10=0/254, 8-9=0/254
 WEBS 5-8=-1135/0, 2-11=-698/0, 4-8=-553/0, 2-10=-520/0, 3-10=0/408

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 7.
 - Load case(s) 11 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 720 lb down at 0-8-8, and 720 lb down at 5-11-8 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:


- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 7-11=-16, 1-13=-440(F=-360), 5-13=-80, 5-6=-440(F=-360)
 Concentrated Loads (lb)
 Vert: 5=-720(F) 13=-720(F)
- User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 7-11=-16(F), 1-13=-440(F), 5-13=-80(F), 5-6=-440(F)
 Concentrated Loads (lb)
 Vert: 7=-5285(F) 5=-720(F) 13=-720(F)

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	--

Job J-21-01726-E	Truss FT17- Cond3	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367391
---------------------	-----------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:47 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHInztALX-PI3yGhjTl0vrmJWg1v4yyUMU1TmidmkujOmiNyZ0wl



Scale = 1:13.9

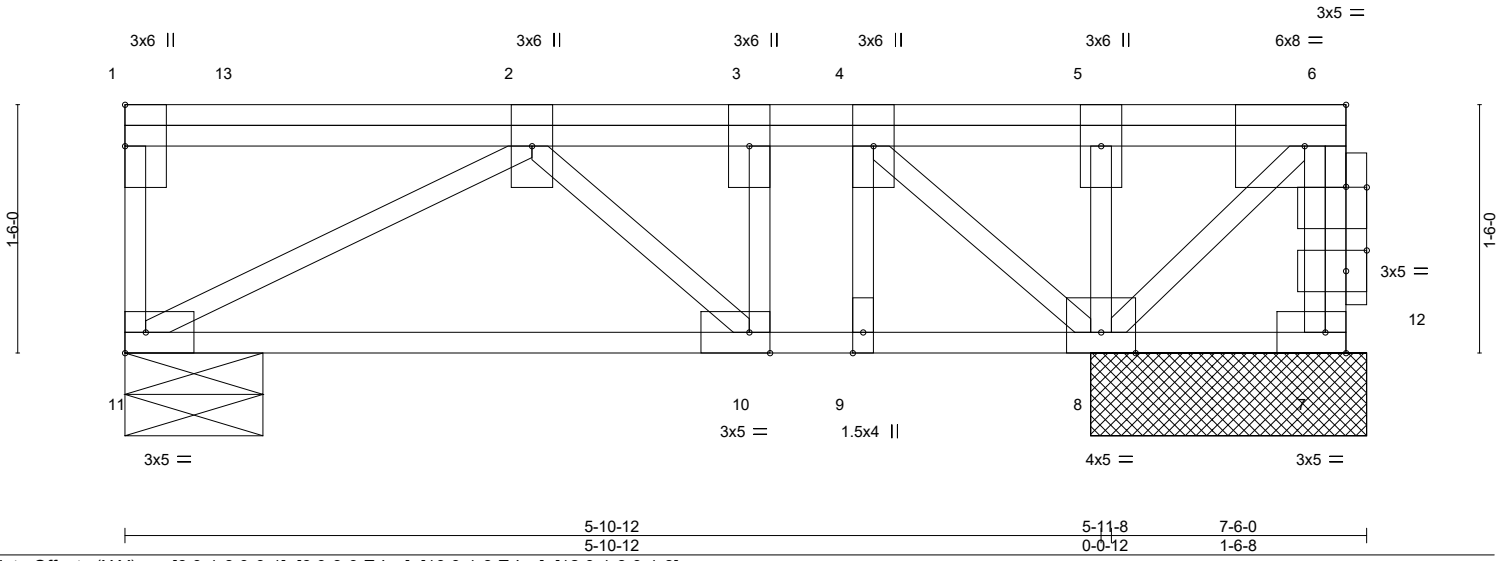


Plate Offsets (X,Y)--	[6:0-1-8,0-0-1], [6:0-3-0,Edge], [10:0-1-8,Edge], [12:0-1-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.78	Vert(LL)	-0.01	10-11	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.29	Vert(CT)	-0.04	10-11	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.26	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 44 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 7-8.	
WEBS 2x4 HF Stud/Std(flat)		


REACTIONS. (size) 7=1-8-0, 8=1-8-0, 11=10-10-0
 Max Uplift 7=-5141(LC 11)
 Max Grav 7=260(LC 4), 8=1638(LC 11), 11=1101(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-11=-740/0, 6-7=-251/63, 2-3=-254/0, 3-4=-254/0
 BOT CHORD 10-11=0/612, 9-10=0/254, 8-9=0/254
 WEBS 5-8=-1135/0, 2-11=-698/0, 4-8=-553/0, 2-10=-520/0, 3-10=0/408

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5141 lb uplift at joint 7.
 - Load case(s) 11 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 720 lb down at 0-8-8, and 720 lb down at 5-11-8 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 7-11=-16, 1-13=-440(F=-360), 5-13=-80, 5-6=-440(F=-360)
 Concentrated Loads (lb)
 Vert: 5=-720(F) 13=-720(F)
- User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 7-11=-16(F), 1-13=-440(F), 5-13=-80(F), 5-6=-440(F)
 Concentrated Loads (lb)
 Vert: 7=5285(F) 5=-720(F) 13=-720(F)

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	--

Job J-21-01726-E	Truss FT18	Truss Type Floor Girder	Qty 2	Ply 1	HBG-LOT 3	K10367392
---------------------	---------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:50 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-ptl4ujlLbxHQdnFFi1efa7_8RhqgqAf2ahdQvivyZOWF

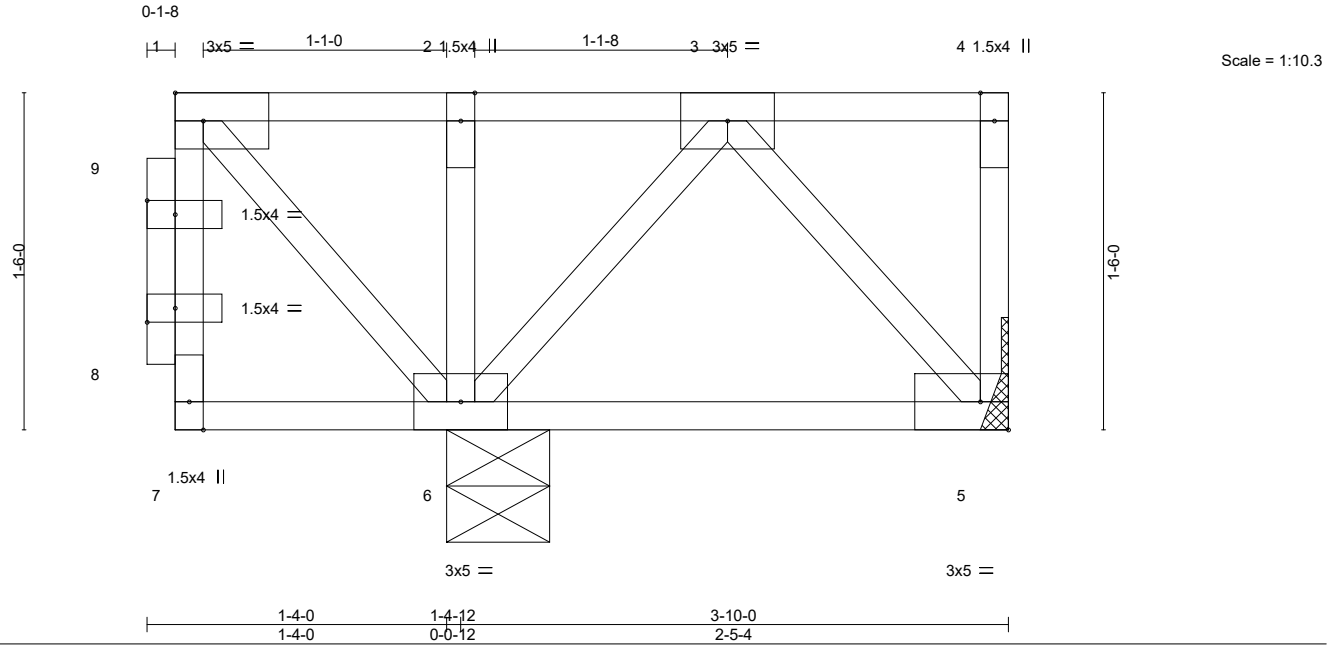


Plate Offsets (X,Y)--	[8:0-1-8,0-0-12], [9:0-1-8,0-0-12]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.20	Vert(LL) -0.00 6 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.08	Vert(CT) -0.01 5-6 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.06	Horz(CT) 0.00 5 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 20 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 3-10-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 6=0-5-8, 5=Mechanical
Max Grav 6=465(LC 1), 5=310(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-6=-253/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Girder carries tie-in span(s): 7-6-0 from 1-4-0 to 3-8-8
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-7=-16, 1-2=-80, 2-4=-253(F=-173)



September 27, 2021

Job J-21-01726-E	Truss FT19	Truss Type Floor Girder	Qty 2	Ply 1	HBG-LOT 3	K10367393
---------------------	---------------	----------------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:45:51 2021 Page 1
ID:49MjCVuD74jFLC0rXMNHlnztALX-H4JS63mzLFPHFwqRGI9u6KXLq4BNZd2CpLMzR9yZOWE

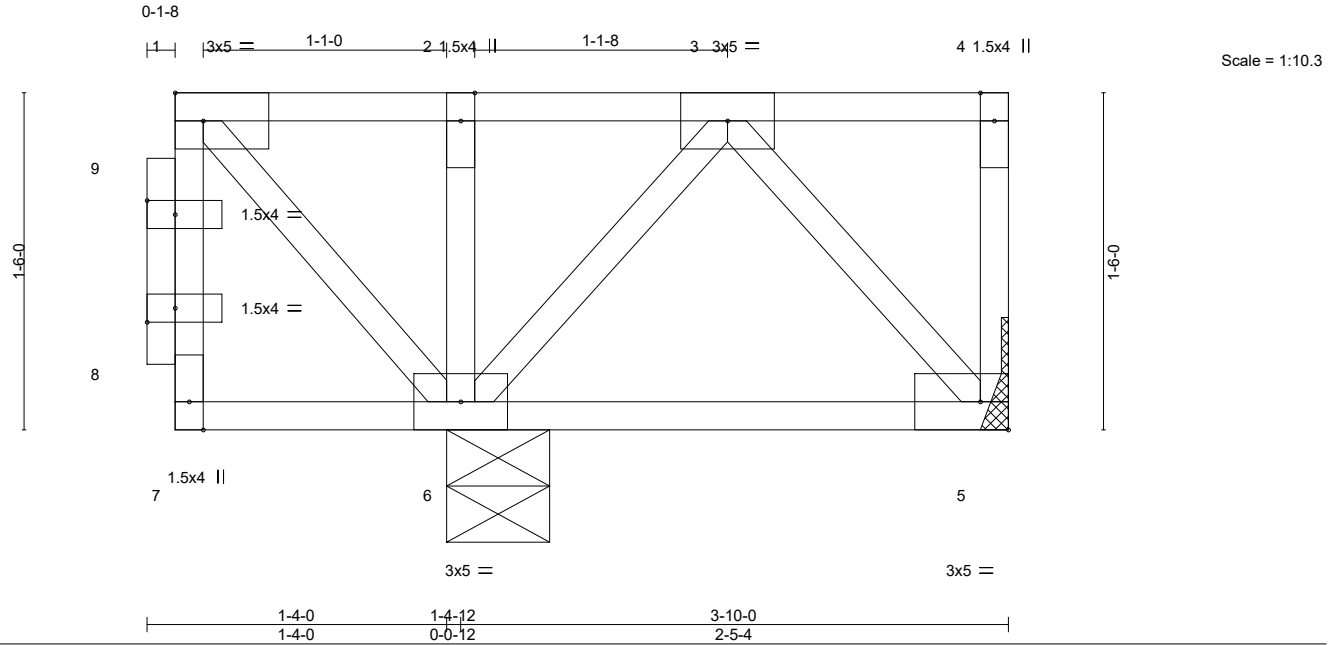


Plate Offsets (X,Y)--	[8:0-1-8,0-0-12], [9:0-1-8,0-0-12]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.09	Vert(LL) 0.00 6 >999 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.05	Vert(CT) -0.00 5-6 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.05	Horz(CT) -0.00 5 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 20 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 3-10-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 6=0-5-8, 5=Mechanical
Max Uplift 5=42(LC 3)
Max Grav 6=410(LC 1), 5=87(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 5.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 100 lb down at 0-2-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-7=-16, 1-4=-80
Concentrated Loads (lb)
Vert: 1=-100(F)




September 27, 2021

Job J-21-01726-E	Truss X1	Truss Type FLOOR	Qty 12	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367394
---------------------	-------------	---------------------	-----------	----------	---------------------------------------	-----------



Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:46:13 2021 Page 1

ID:49MjCVuD74jFLC0rXMNHlnztALX-eJenja1nA?A9uJVgYMY2?zR6KyiHjalRsmh8CtyZOvu



Scale = 1:10.4

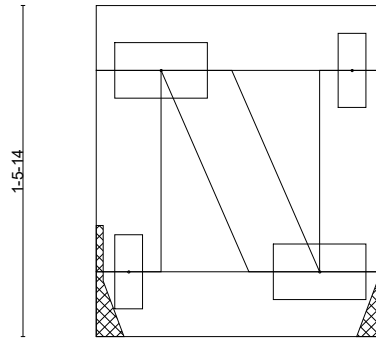

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.03	Vert(LL)	0.00	4 ****	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	-0.00	4 >999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3 n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MP					Weight: 6 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 HF No.2
 BOT CHORD 2x4 HF No.2
 WEBS 2x4 HF Stud/Std

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-3-9 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 3=Mechanical
 Max Grav 4=60(LC 1), 3=60(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- 2) Plates checked for a plus or minus 20 degree rotation about its center.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
 Corona, CA 92880

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

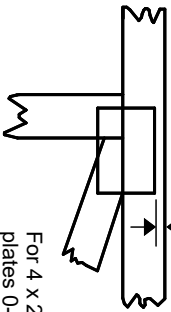

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

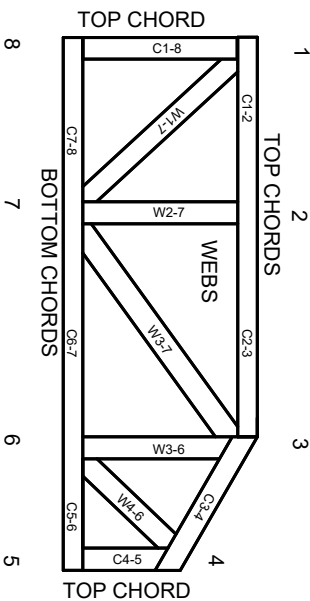

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.



MITek Engineering Reference Sheet: MIL-7473 rev. 5/19/2020

GARAGE: LEFT



SUBMITTAL #: 1 2 3 4

- NO EXCEPTIONS TAKEN
- APPROVED AS NOTED
- REVIEWED ONLY
- RESUBMIT FOR RECORD
- FOR RECORD
- REVISE AND RESUBMIT
- REJECTED - RESUBMIT
- NOT REVIEWED
- TYPICAL - U.N.O.

Shop drawing review is for general conformance with plans, specifications and the design concept of the Project as expressed in the Contract Documents. The corrections or comments made on submittals shall not relieve the Contractor from any obligation contained in the Contract Documents. Review and approval is not for the purpose of determining the completeness, accuracy or correctness of dimensions, quantities or other details. Approval assumes no responsibility whatsoever for the correctness, nor does it imply authorization of additional work. The Structural Engineer's review shall not constitute approval of any fabrication or construction means, methods, techniques, or sequences; or any safety precautions or procedures.

REVIEWED BY: **RJD**

M+K PROJECT #: **203-20001** DATE: **10/1/21**

LAY-OUT DIMENSIONS:
FEET - INCHES - SIXTEENTHS
(6'-7 3/4" = 6-7-12)
**DRAWING IS NOT TO SCALE

****VERIFY ALL PLUMBING DROP LOCATIONS BEFORE FINAL PLACEMENT OF TRUSSES. **DO NOT SPACE TRUSSES MORE THAN 16" O.C.****

LOADING:
T.C. LL = 40 PSF
T.C. DL = 10 PSF
B.C. DL = 10 PSF

TOTAL LOAD: 60 PSF
2015 IRC CODE

NOTES:

- 1.) ALL FLOOR TRUSSES SHALL BE 18" DEEP SPACED AT 19.2" O.C. UNLESS NOTED OTHERWISE.
- 2.) ---- INDICATES (2X6) CONTINUOUS LATERAL/IMPACT BRACING W/TRUSSED BLOCKING PANELS SHOWN AS "X". (SEE TRUSS ENGINEERING FOR LOCATION) (SEE DETAIL)
- 3.) INTERIOR BEARING / SHEAR WALL. (DESIGNED BY OTHERS) INSTALL SHEAR OR BLOCKING PANELS BETWEEN TRUSSES AS SHOWN.
- 4.) %% ALIGN (2X) CRIPPLE STUDS UNDER WINDOW TRIMMERS OR GIRDER TRUSS ABOVE. ATTACH TO (2X) CONTINUOUS RIBBON OR INSERT BETWEEN TRUSS TOP AND BOTTOM CHORDS. WHERE TRIMMERS AND GIRDER TRUSSES ALIGN W/TRUSSES BELOW, INSTALL (1) CRIPPLE STUD TO EACH FACE OF TRUSS AS SHOWN. (SEE STRUCTURAL FRAMING PLAN FOR LOCATION) (CRIPPLE STUDS SHALL BE INSTALLED & PROVIDED BY FRAMER) %%
- 5.) INSTALL (2) 2x6x18" CRIPPLE STUDS TO ALIGN UNDER GIRDER TRUSS ABOVE. FLUSH TIGHT TO TOP OF BEARING WALL AND UNDERSIDE OF FLOOR DIAPHRAGM. (MUST BE INSTALLED BY FRAMER!!)

NOTES (CONT.)

- 6.) (2X4) CONTINUOUS RIBBON TO TOP AND BOTTOM AT EXTERIOR BEARING/SHEAR WALL. (SEE STRUCTURAL FRAMING PLAN)
- 7.) INSTALL (3) 2x6x18" CRIPPLE STUDS TO ALIGN UNDER GIRDER TRUSS ABOVE. FLUSH TIGHT TO TOP OF BEARING WALL AND UNDERSIDE OF FLOOR DIAPHRAGM. (MUST BE INSTALLED BY FRAMER!!)
- 8.) (3-1/2") FLUSH GLU-LAM BEAM. (DESIGNED BY OTHERS...SEE STRUCTURAL PLAN)
- 9.) (5-1/2") FLUSH GLU-LAM BEAM (DESIGNED BY OTHERS...SEE STRUCTURAL PLAN)
- 10.) ROOF GIRDER TRUSS...SEE ROOF TRUSS LAY-OUT AND STRUCTURAL PLAN.
- 11.) (2) 2X4 FLAT BLOCKS BETWEEN TOP CHORD BEARING TRUSSES, PROVIDED & INSTALLED BY OTHERS.
- 12.) EXTEND (3-1/2") FLUSH GLU-LAM BEAM 0'-04" THIS END FOR JOIST HANGER INSTALLATION.
- 13.) TRUSS BLOCKING BETWEEN TRUSSES FOR STRAP...(SEE STRUCTURAL PLAN)

NOTE: ALL HANGER NAILS MUST BE 16d SINKER (3-1/4" LONG)...TYP. UNLESS NOTED OTHERWISE

QTY	TYPE	SYMBOL
11	THA413	①
2	HUC48	②


CAUTION: DO NOT CUT, DRILL OR ALTER ANY TRUSSES WITHOUT PRIOR APPROVAL FROM ROOF TRUSS SUPPLY, INC.

INSTALLATION NOTE:

DO NOT INSTALL TRUSSES IN REVERSE OR "UP-SIDE-DOWN"! SEE TRUSS ENGINEERING FOR PROPER INSTALLATION. ALIGN INTERIOR BEARING AS SHOWN ON ENGINEERING DRAWINGS.


SYMBOL	DESCRIPTION
▲	LEFT END OF TRUSS ("DO NOT INSTALL TRUSSES IN REVERSE OR UPSIDE DOWN. SEE TRUSS ENGINEERING FOR CORRECT TRUSS PLACEMENT")
\$\$	TRUSS LAY-OUT SHIFTED (TRUSS LAY-OUT SHIFTED TO AVOID PLUMBING DROPS. "DO NOT CUT, DRILL OR ALTER ANY TRUSSES WITHOUT PRIOR APPROVAL FROM RTS")
##	ADDITIONAL TRUSS ADDED ("ADDITIONAL FLOOR TRUSS ADDED TO AVOID "OVERSPACING" OF SUBFLOOR)

THERE ARE MULTIPLE BLOCKING OPTIONS (SP1, SP2, SP3...) BUT IT IS NOT CALLED OUT WHICH ARE NEEDED AT EACH LOCATION.

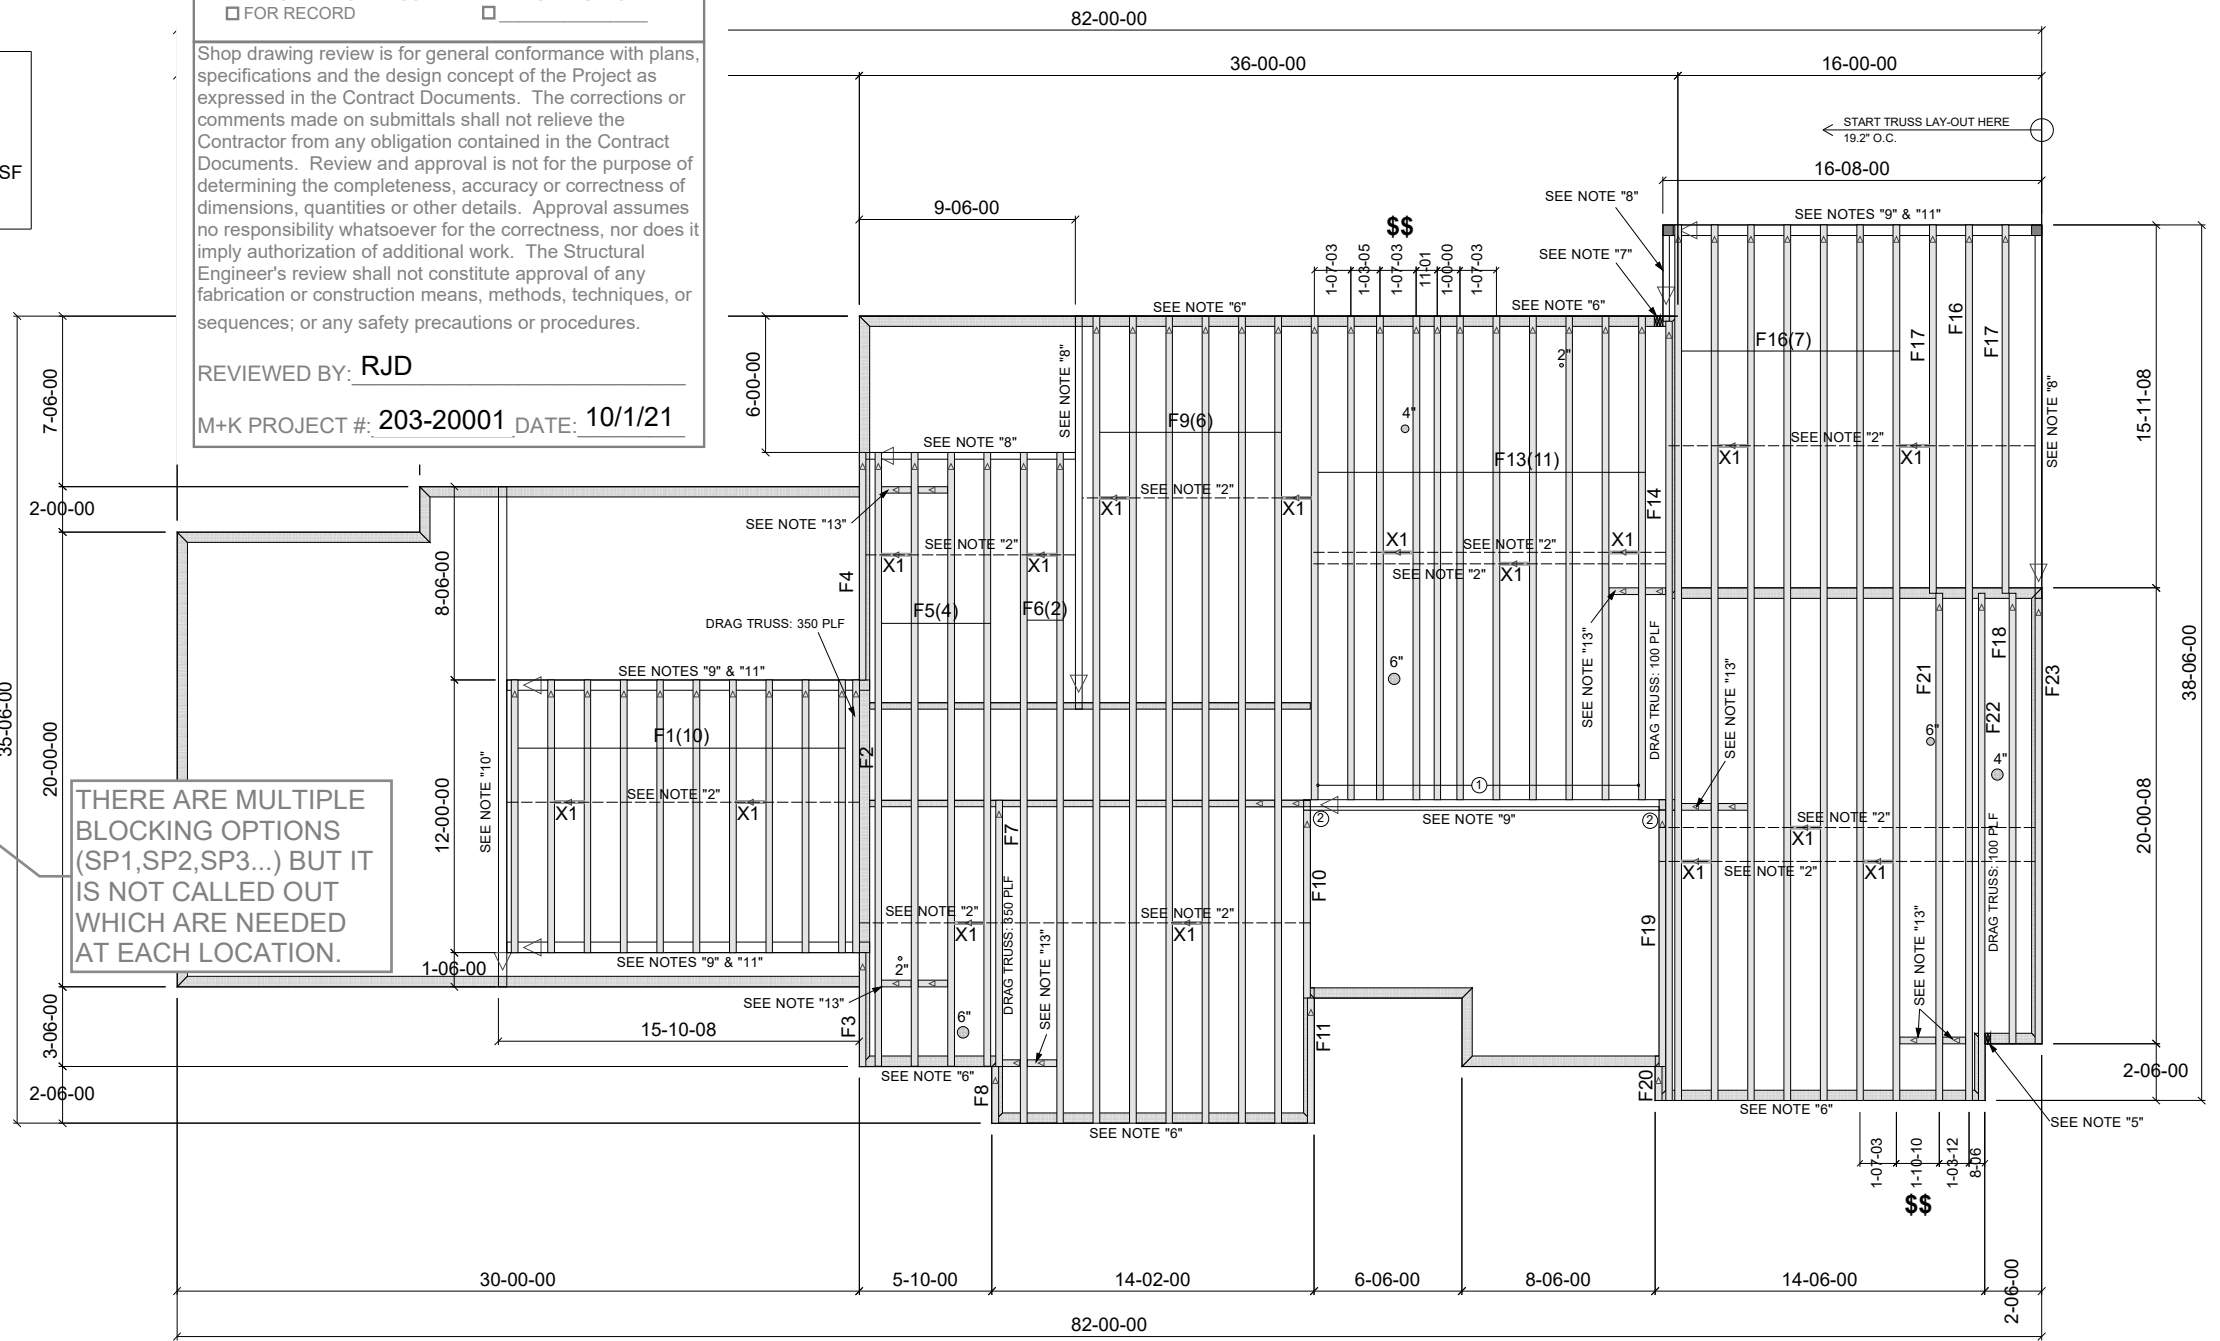

Job #: J-21-01726-G	Issue Date: 6/10/2021
Customer: HBG	Revision-2 8/3/21
Project: HIGHLAND BUILDERS	Revision-3 //
Plan: LOT 3 UPPER FLOOR	
Delivery:	Drawn By:

Above plan provided for truss placement only. Refer to truss calculations and engineering structural drawings for all further information. Building designer/engineer of record are responsible for all non truss to truss connections. Building designer/engineer of record to review and approve all designs prior to construction.

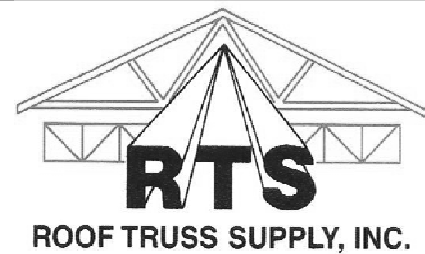



MiTek USA, Inc.

250 Klug Circle
Corona, CA 92880
951-245-9525

Re: J-21-01726-G

HBG-LOT 3

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Roof Truss Supply.

Pages or sheets covered by this seal: K10367431 thru K10367458

My license renewal date for the state of Washington is September 28, 2023.



September 27, 2021


Zhao, Xiaoming

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J-21-01726-G	Truss F1	Truss Type Floor	Qty 10	Ply 1	HBG-LOT 3	K10367431
---------------------	-------------	---------------------	-----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:47:36 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-tcvTCi?zba34sr936ZJPYDNFAPyRf1dfyAl1dzyZoub

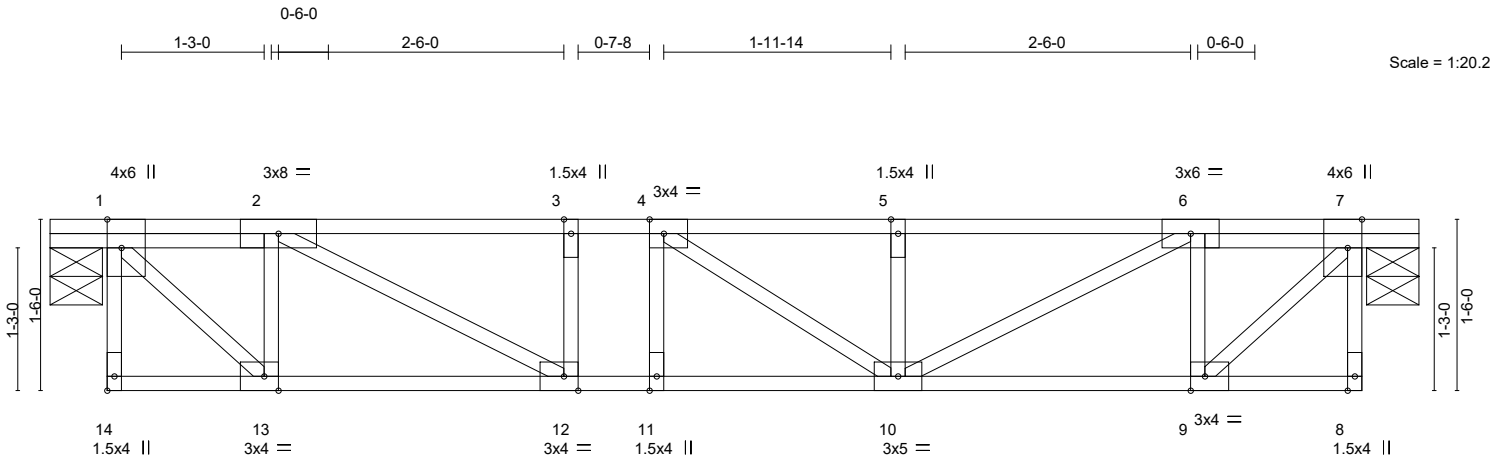

0-6-0	11-5-14	11-11-14
0-6-0	10-11-14	0-6-0

Plate Offsets (X,Y)-- [1:0-3-0,Edge], [4:0-1-8,Edge], [7:0-3-0,Edge], [9:0-1-8,Edge], [12:0-1-8,Edge], [13:0-1-8,Edge], [14:Edge,0-0-12]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.23	Vert(LL)	-0.04	10-11	>999	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.34	Vert(CT)	-0.06	10-11	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.40	Horz(CT)	-0.01	7	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S						Weight: 54 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 1=0-5-8, 7=0-5-8
Max Grav 1=521(LC 1), 7=521(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-490/0, 2-3=-1002/0, 3-4=-1002/0, 4-5=-995/0, 5-6=-995/0, 6-7=-492/0
BOT CHORD 12-13=0/489, 11-12=0/1002, 10-11=0/1002, 9-10=0/491
WEBS 2-13=-436/0, 1-13=0/676, 6-9=-433/0, 7-9=0/679, 6-10=0/568, 2-12=0/579

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.




September 27, 2021


Job J-21-01726-G	Truss F2	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367432
---------------------	-------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:31 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-mCkGlgTeU?HylsdqcpJgq9bhahs2snlbE7Q2tyZ0tk



Scale = 1:20.2

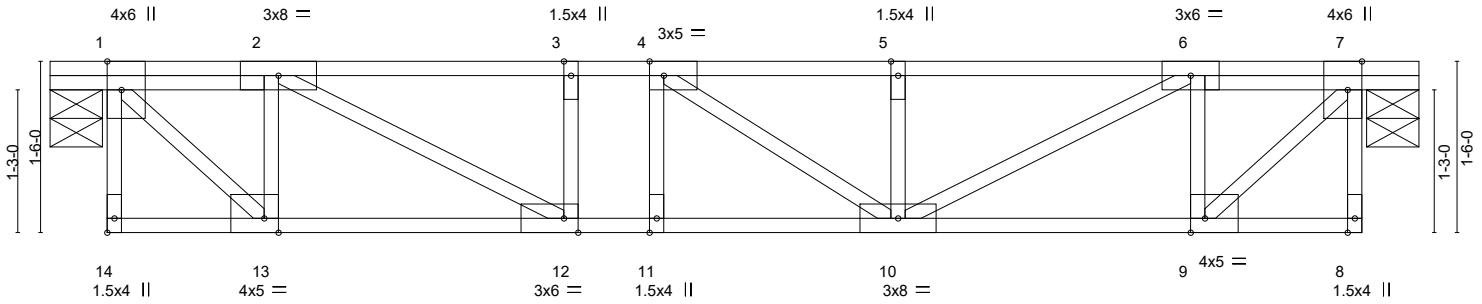

0-6-0	11-5-14	11-11-14
0-6-0	10-11-14	0-6-0

Plate Offsets (X,Y)-- [1:0-3-0,Edge], [4:0-1-8,Edge], [7:0-3-0,Edge], [9:0-1-8,Edge], [12:0-1-8,Edge], [13:0-1-8,Edge], [14:Edge,0-0-12]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.46	Vert(LL)	-0.08	10-11	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.50	Vert(CT)	-0.10	10-11	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.62	Horz(CT)	-0.01	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 54 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 11-12.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 1=0-5-8, 7=0-5-8
 Max Uplift 1=-359(LC 6), 7=-359(LC 7)
 Max Grav 1=807(LC 3), 7=807(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-714/278, 2-3=-1620/779, 3-4=-1002/0, 4-5=-1372/504, 5-6=-1496/624, 6-7=-760/336
 BOT CHORD 13-14=-481/481, 12-13=-816/1117, 11-12=0/1002, 10-11=-607/1491, 9-10=-664/1074, 8-9=-481/433
 WEBS 2-13=-725/403, 1-13=-449/1034, 6-9=-707/383, 7-9=-531/1099, 6-10=-814/1199, 2-12=-1056/1406, 3-12=-375/260, 4-10=-1081/1077, 4-11=-289/292

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=359, 7=359.
 - 4) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-11-14 for 350.0 plf.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	---

Job J-21-01726-G	Truss F3- Cond1	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367433
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:46 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-q48xupt65u8GcVWDGaqn_HCZdww3mJy23Fj4VyZOtV

3x4 =

Q-1-8

1 3x4 =


2 1.5x4 ||

3

4 1.5x4 ||

5 3x4 =

Scale = 1:10.2

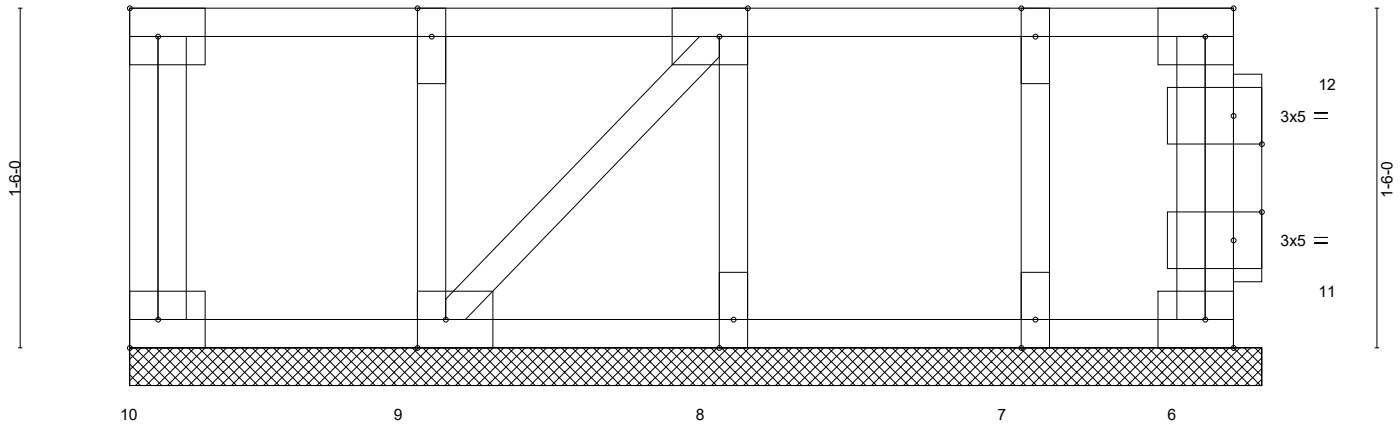

3x4 =

3x4 =

1.5x4 ||

1.5x4 ||

3x4 =

1-4-0

2-8-0

4-0-0

5-0-0

1-4-0

1-4-0

1-4-0

1-0-0

Plate Offsets (X,Y)-- [3:0-1-8,Edge], [5:0-1-8,Edge], [9:0-1-8,Edge], [11:0-1-8,0-1-8], [12:0-1-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.29	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.12	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 25 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)
OTHERS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

[MCT]

REACTIONS. All bearings 5-0-0.

(lb) - Max Grav All reactions 250 lb or less at joint(s) 10 except 6=882(LC 1), 9=536(LC 1), 8=513(LC 1), 7=448(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 5-6=-877/0
WEBS 2-9=-508/0, 3-8=-486/0, 4-7=-424/0

NOTES-

- Plates checked for a plus or minus 20 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 800 lb down at 4-9-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 6-10=-20, 1-5=-360(F=-260)
Concentrated Loads (lb)
Vert: 5=-800(F)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss F3- Cond2	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367433
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:46 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-q48xupt65u8GcVWDGagn_HCZdvw3mJy23Fj4VyZOtV

3x4 =

Q-1-8

1 3x4 =


2 1.5x4 ||

3

4 1.5x4 ||

5 3x4 =

Scale = 1:10.2

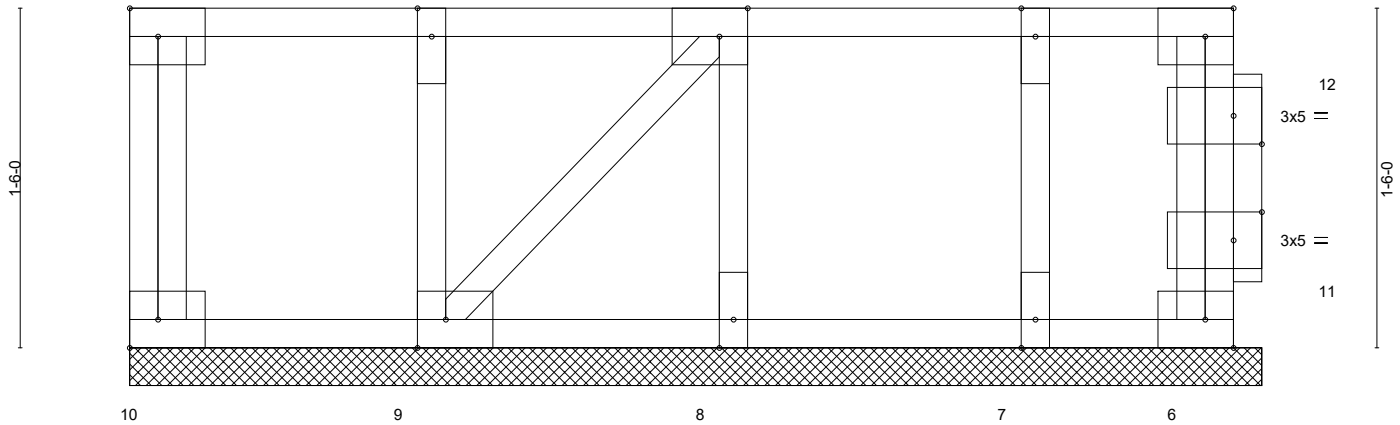

3x4 =

3x4 =

1.5x4 ||

1.5x4 ||

3x4 =

1-4-0

2-8-0

4-0-0

5-0-0

1-4-0

1-4-0

1-4-0

1-0-0

Plate Offsets (X,Y)-- [3:0-1-8,Edge], [5:0-1-8,Edge], [9:0-1-8,Edge], [11:0-1-8,0-1-8], [12:0-1-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.29	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.12	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 25 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 HF No.2(flat)
 BOT CHORD 2x4 HF No.2(flat)
 WEBS 2x4 HF Stud/Std(flat)
 OTHERS 2x4 HF Stud/Std(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

[MCT]

REACTIONS.

All bearings 5-0-0.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 6--823(LC 3)
 Max Grav All reactions 250 lb or less at joint(s) except 10=1884(LC 3), 6=882(LC 1), 9=536(LC 1), 8=513(LC 1), 7=448(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 5-6=-877/0
 WEBS 2-9=-508/0, 3-8=-486/0, 4-7=-424/0

NOTES-

- Plates checked for a plus or minus 20 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 823 lb uplift at joint 6.
- Load case(s) 3 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 800 lb down at 4-9-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 6-10=-20, 1-5=-360(F=-260)
 Concentrated Loads (lb)
 Vert: 5=-800(F)
- User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 6-10=-20(F), 1-5=-360(F)

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
 Corona, CA 92880

Job J-21-01726-G	Truss F3- Cond2	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367433
---------------------	---------------------------	---------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:46 2021 Page 2
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-q48xupt65u8GcVWDGaqn_HCZdvw3mJy23Fj4VyZOtV

LOAD CASE(S)

Concentrated Loads (lb)

Vert: 10=-1705(F) 6=1705(F) 5=-800(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss F3- Cond3	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367433
---------------------	---------------------------	---------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:46 2021 Page 2
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-q48xupt65u8GcVWDGaqn_HCZdvw3mJy23Fj4VyZOtV

LOAD CASE(S)

Concentrated Loads (lb)

Vert: 10=1705(F) 6=-1705(F) 5=-800(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880


Job J-21-01726-G	Truss F4- Cond1	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367434
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:49 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvZY7m?Fzu4Tw-Ffp3XqtlP0Gj73E5u07XPcvgrlxXG6oOk1UNhgyZotS

0-3-8

Scale = 1:18.2

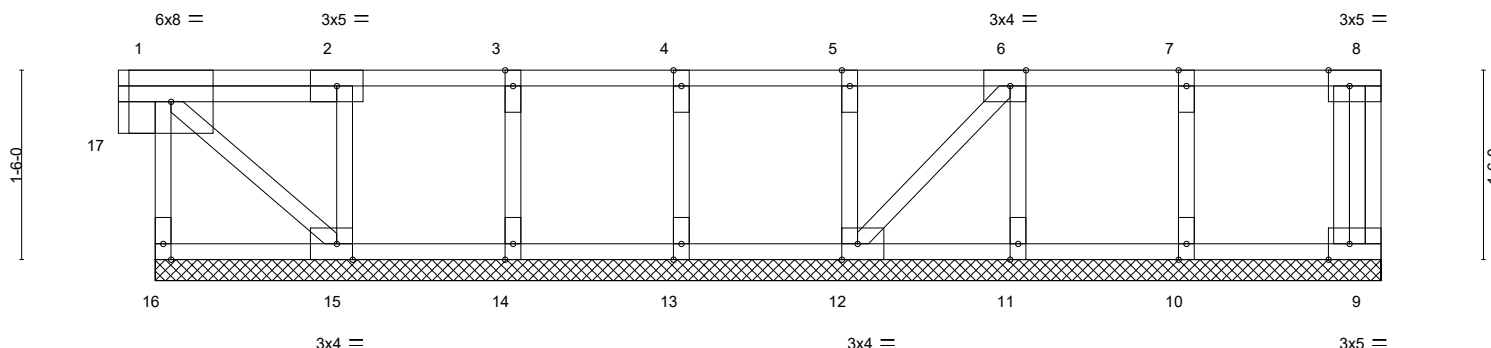

0-3-8	1-9-8	3-1-8	4-5-8	5-9-8	7-1-8	8-5-8	9-9-8	10-0-0
0-3-8	1-6-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-2-8

Plate Offsets (X, Y)-- [6:0-1-8,Edge], [8:0-2-0,Edge], [9:0-2-0,Edge], [12:0-1-8,Edge], [15:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.39	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.14	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 44 lb	FT = 20%F, 11%E


LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat) *Except* 1-17: 4x4 DF No.2&BTR G(flat)		
OTHERS 2x4 HF Stud/Std(flat)		

REACTIONS. All bearings 9-8-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 16, 9 except 15=629(LC 1), 14=495(LC 1), 13=508(LC 1), 12=565(LC 1), 11=426(LC 1), 10=614(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-15=-562/0, 3-14=-470/0, 4-13=-481/0, 5-12=-486/0, 6-11=-401/0, 7-10=-581/0

- NOTES-**
- 1) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) A plate rating reduction of 20% has been applied for the green lumber members.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 9-16=-20, 1-8=-360(F=-260)

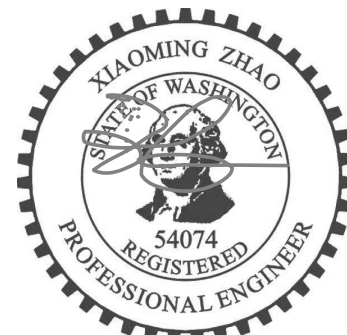

September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job J-21-01726-G	Truss F4- Cond2	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367434
Roof Truss Supply, Woodinville, WA - 98072,					Job Reference (optional)	

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:49 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-Ffp3XqtlIP0Gj73E5uO7XPcvgrXGXG6oOk1UNhgyZOtS

0-3-8

Scale = 1:18.2

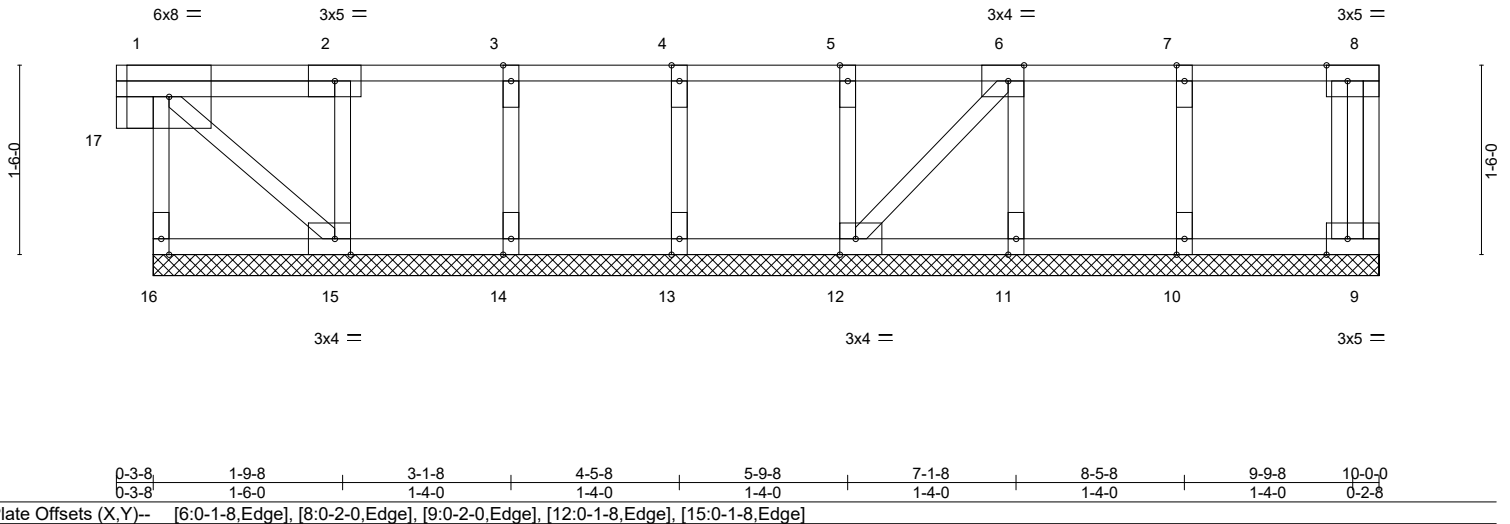

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.39	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.14	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 44 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat) *Except* 1-17: 4x4 DF No.2&BTR G(flat)		
OTHERS 2x4 HF Stud/Std(flat)		

REACTIONS. All bearings 9-8-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 16 except 9=1931(LC 3), 15=629(LC 1), 14=495(LC 1), 13=508(LC 1), 12=565(LC 1), 11=426(LC 1), 10=614(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-15=-562/0, 3-14=-470/0, 4-13=-481/0, 5-12=-486/0, 6-11=-401/0, 7-10=-581/0

- NOTES-**
- All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Load case(s) 3 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard Except:
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 9-16=-20, 1-8=-360(F=-260)
 - User defined: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 9-16=-20(F), 1-8=-360(F)
Concentrated Loads (lb)
Vert: 9=1705(F)


Job J-21-01726-G	Truss F4- Cond3	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367434
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:49 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-Ffp3XqtlP0Gj73E5uO7XPcvglrXG6oOk1UNhgyZOtS

0-3-8

Scale = 1:18.2

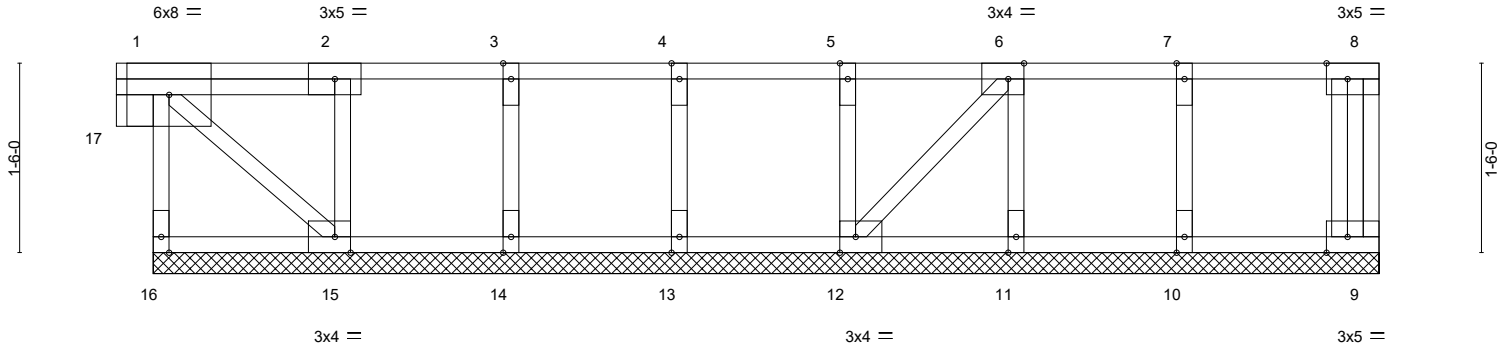

0-3-8	1-9-8	3-1-8	4-5-8	5-9-8	7-1-8	8-5-8	9-9-8	10-0-0
0-3-8	1-6-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-2-8

Plate Offsets (X, Y)-- [6:0-1-8,Edge], [8:0-2-0,Edge], [9:0-2-0,Edge], [12:0-1-8,Edge], [15:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.39	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.14	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-S					Weight: 44 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.	
WEBS 2x4 HF Stud/Std(flat) *Except* 1-17: 4x4 DF No.2&BTR G(flat)		
OTHERS 2x4 HF Stud/Std(flat)		


REACTIONS. All bearings 9-8-8.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 9=-1479(LC 3)
 Max Grav All reactions 250 lb or less at joint(s) 16, 9 except 15=629(LC 1), 14=495(LC 1), 13=508(LC 1), 12=565(LC 1), 11=426(LC 1), 10=614(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-15=-562/0, 3-14=-470/0, 4-13=-481/0, 5-12=-486/0, 6-11=-401/0, 7-10=-581/0

- NOTES-**
- All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1479 lb uplift at joint 9.
 - Load case(s) 3 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 9-16=-20, 1-8=-360(F=-260)
 3) User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 9-16=-20(F), 1-8=-360(F)

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	--

Job J-21-01726-G	Truss F4- Cond3	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367434
---------------------	---------------------------	---------------------	----------	----------	---	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:50 2021 Page 2
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-jsNRkAuNAJOakDpHS6emyqSr2EHm?Z1YzhDxDHyZOtR

LOAD CASE(S)

Concentrated Loads (lb)
Vert: 9=1705(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss F5	Truss Type Floor	Qty 4	Ply 1	HBG-LOT 3	K10367435
---------------------	-------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:52 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvZY7m?Fzu4Tw-fEVC9svehxel_XygZXhE1FXBA2s5TPyrQ?i2I9yZ0tP

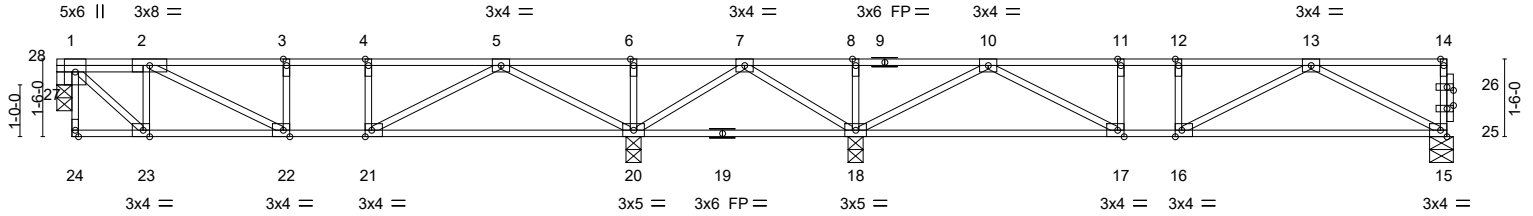

0-3-8 0-3-8	11-1-12 10-10-4	15-5-4 4-3-8	26-11-14 11-6-10
----------------	--------------------	-----------------	---------------------

Plate Offsets (X,Y)-- [16:0-1-8,Edge], [17:0-1-8,Edge], [21:0-1-8,Edge], [22:0-1-8,Edge], [23:0-1-8,Edge], [25:0-1-8,0-0-12], [26:0-1-8,0-0-12]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.07	15-16	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.48	Vert(CT)	-0.32	15-16	>424		
BCLL 0.0	Rep Stress Incr	NO	WB 0.37	Horz(CT)	0.02	15	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						

Weight: 110 lb FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat) *Except*
1-27: 4x4 DF No.2&BTR G(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 18-20.

REACTIONS. All bearings 0-3-8 except (jt=length) 15=0-5-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) except 15=747(LC 5), 20=920(LC 14), 18=918(LC 11), 28=444(LC 5)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 14-15=-338/0, 1-2=-467/0, 2-3=-793/0, 3-4=-793/0, 4-5=-793/0, 5-6=0/656, 6-7=0/656, 7-8=0/523, 8-10=0/523, 10-11=-913/0, 11-12=-913/0, 12-13=-913/0
BOT CHORD 22-23=0/467, 21-22=0/793, 20-21=0/355, 18-20=-465/0, 17-18=0/429, 16-17=0/913, 15-16=0/695
WEBS 2-23=-384/0, 1-23=0/623, 2-22=0/365, 5-20=-960/0, 5-21=0/507, 7-20=-371/34, 7-18=-346/59, 10-18=-986/0, 10-17=0/562, 13-15=-789/0, 13-16=0/267, 1-28=-447/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) A plate rating reduction of 20% has been applied for the green lumber members.
 - 5) Bearing at joint(s) 28 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.
 - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 260 lb down at 26-9-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-24=-16, 1-14=-80
Concentrated Loads (lb)
Vert: 14=-260(F)





September 27, 2021

Job J-21-01726-G	Truss F6	Truss Type Floor	Qty 2	Ply 1	HBG-LOT 3	K10367436
---------------------	-------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:54 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-bddyYxuDYu0Dq62hxj6gcWXsTyxG07uJB8M2yZ0tN

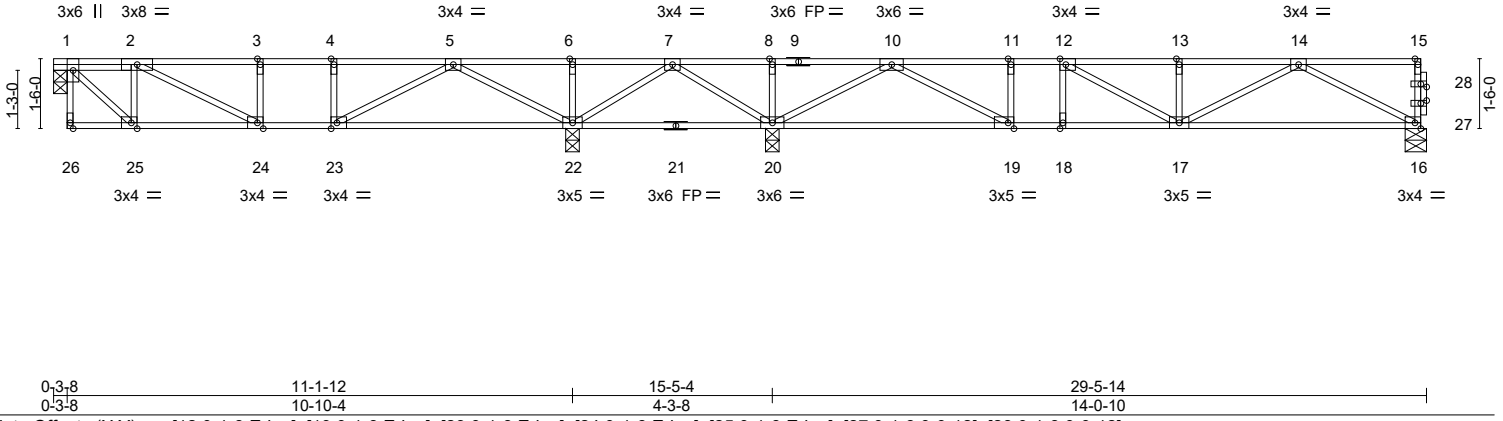

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.48	in (loc) l/defl L/d	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.71	Vert(LL) -0.11 17-18 >999 480		
BCLL 0.0	Rep Stress Incr NO	WB 0.52	Vert(CT) -0.15 16-17 >999 360		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Horz(CT) 0.02 16 n/a n/a		
				Weight: 119 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-22.

REACTIONS. All bearings 0-3-8 except (jt=length) 16=0-5-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) except 16=778(LC 11), 1=447(LC 5), 22=863(LC 3), 20=1146(LC 11)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 15-16=-274/0, 1-2=-429/0, 2-3=-765/0, 3-4=-765/0, 4-5=-765/0, 5-6=0/669, 6-7=0/669, 7-8=0/756, 8-10=0/756, 10-11=-1169/0, 11-12=-1169/0, 12-13=-1345/0, 13-14=-1345/0
BOT CHORD 24-25=0/429, 23-24=0/765, 22-23=0/335, 20-22=-621/0, 19-20=0/394, 18-19=0/1169, 17-18=0/1169, 16-17=0/880
WEBS 2-25=-363/0, 1-25=0/592, 11-19=-257/0, 2-24=0/377, 5-22=-952/0, 5-23=0/497, 7-22=-276/203, 7-20=-512/0, 10-20=-1280/0, 10-19=0/890, 14-16=-999/0, 14-17=0/528, 12-17=-29/290

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 190 lb down at 29-3-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 16-26=-16, 1-15=-80
Concentrated Loads (lb)
Vert: 15=-190(F)



September 27, 2021

Job J-21-01726-G	Truss F7- Cond1	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367437
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:57 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzY7m?Fzu4Tw-0CI5CZzmWTHa4IrdM4GPKIE4U3Z28cBaaHQozNyZOtK



Scale = 1:19.7

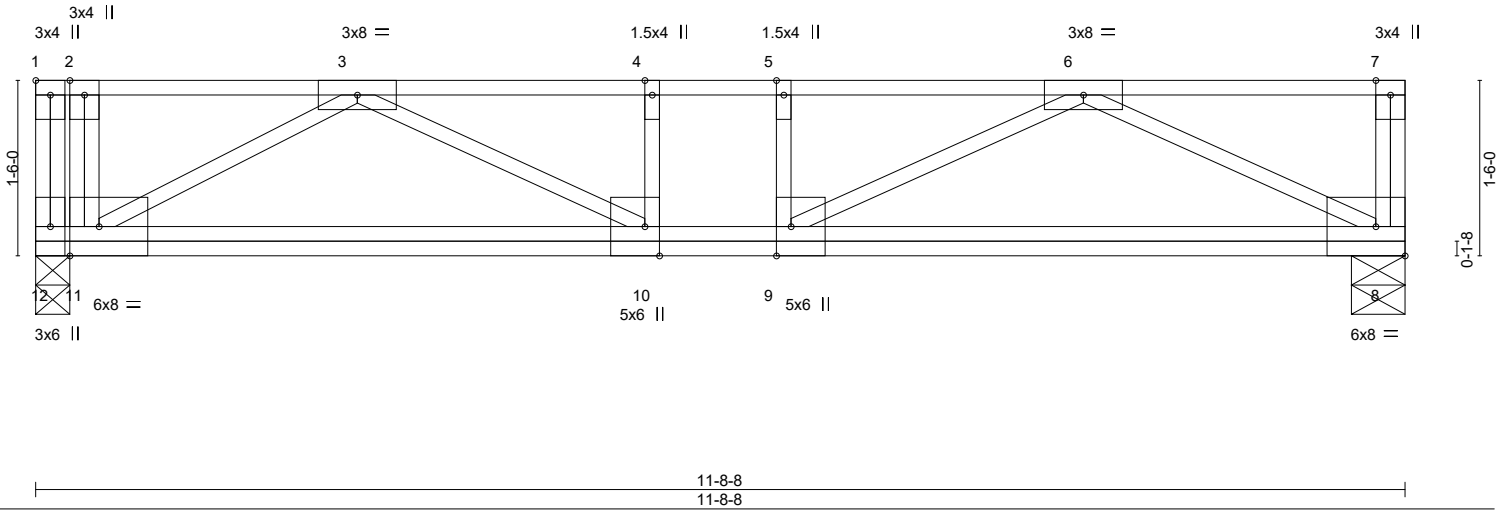


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [9:0-3-0,Edge], [10:0-3-0,Edge], [11:0-3-0,Edge]


LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.31	Vert(LL)	-0.11	8-9	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.46	Vert(CT)	-0.14	8-9	>956		
BCLL 0.0	Rep Stress Incr	YES	WB 0.62	Horz(CT)	0.01	8	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S						
								Weight: 64 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 12=0-3-8, 8=0-5-8
 Max Uplift 12=-313(LC 6), 8=-313(LC 7)
 Max Grav 12=803(LC 3), 8=803(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-919/837, 3-4=-1860/754, 4-5=-1237/0, 5-6=-1839/725, 6-7=-919/827
 BOT CHORD 10-11=-661/1313, 9-10=0/1237, 8-9=-642/1305
 WEBS 3-11=-1594/840, 3-10=-1061/1410, 6-8=-1612/855, 6-9=-988/1331

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 313 lb uplift at joint 12 and 313 lb uplift at joint 8.
 - 4) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-8-8 for 350.0 plf.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

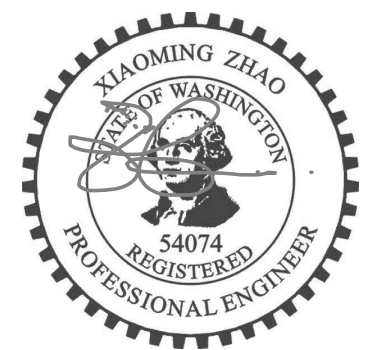

September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	---

Job J-21-01726-G	Truss F7- Cond2	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367437
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:57 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-0CI5CZzmWTHa4IrdM4GPKIE_S3V78cBaaHQozNyZOtK



Scale = 1:19.7

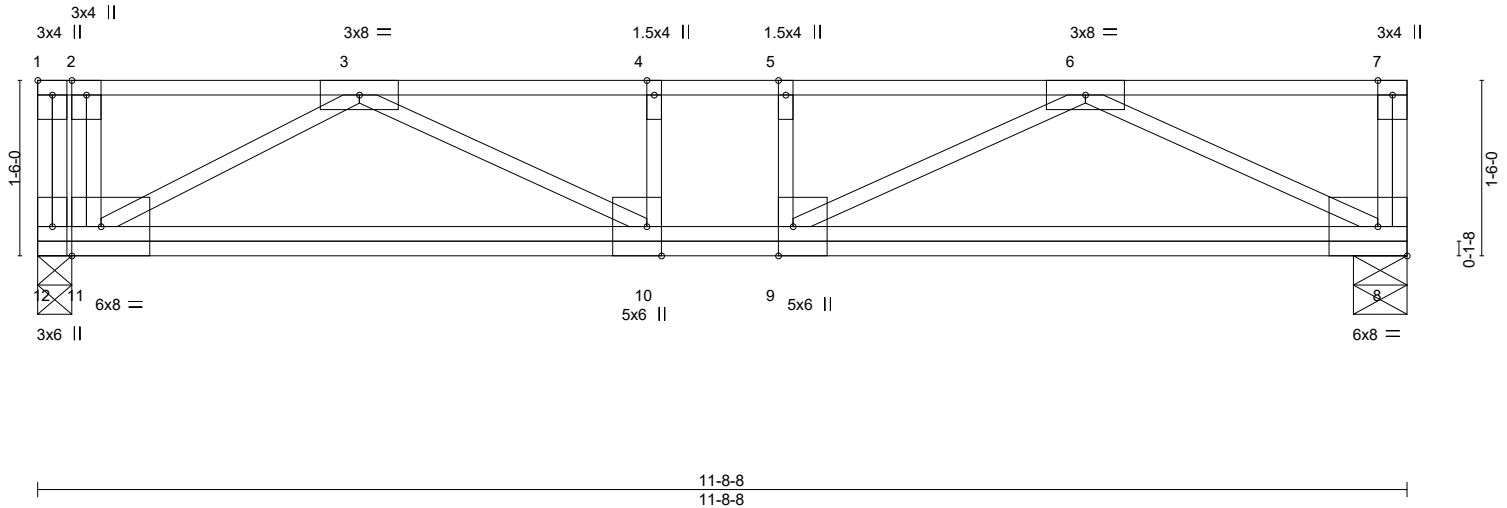


Plate Offsets (X,Y)--	[1:Edge,0-1-8], [9:0-3-0,Edge], [10:0-3-0,Edge], [11:0-3-0,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.70	Vert(LL) -0.23 10-11 >606 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.74	Vert(CT) -0.27 10-11 >506 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.62	Horz(CT) 0.01 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 64 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 12=0-3-8, 8=0-5-8
 Max Uplift 12=-313(LC 6), 8=-313(LC 7)
 Max Grav 12=2211(LC 14), 8=803(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-12=-613/0, 2-3=-919/837, 3-4=-1860/754, 4-5=-1468/0, 5-6=-1839/725, 6-7=-919/827
 BOT CHORD 10-11=-661/1313, 9-10=0/1468, 8-9=-642/1305
 WEBS 3-11=-1594/840, 3-10=-1061/1410, 6-8=-1612/855, 6-9=-988/1331, 2-11=0/617

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 313 lb uplift at joint 12 and 313 lb uplift at joint 8.
 - 4) Load case(s) 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-8-8 for 350.0 plf.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
 14) User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 8-12=-16(F), 1-7=-80(F)
 Concentrated Loads (lb)
 Vert: 11=-1705(F)

Job J-21-01726-G	Truss F7- Cond3	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367437
---------------------	---------------------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:58 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-UOsTQv_PHnPRiSQqwnoeGWnEXTv4t3Rjpx9MVpyZotJ



Scale = 1:19.7

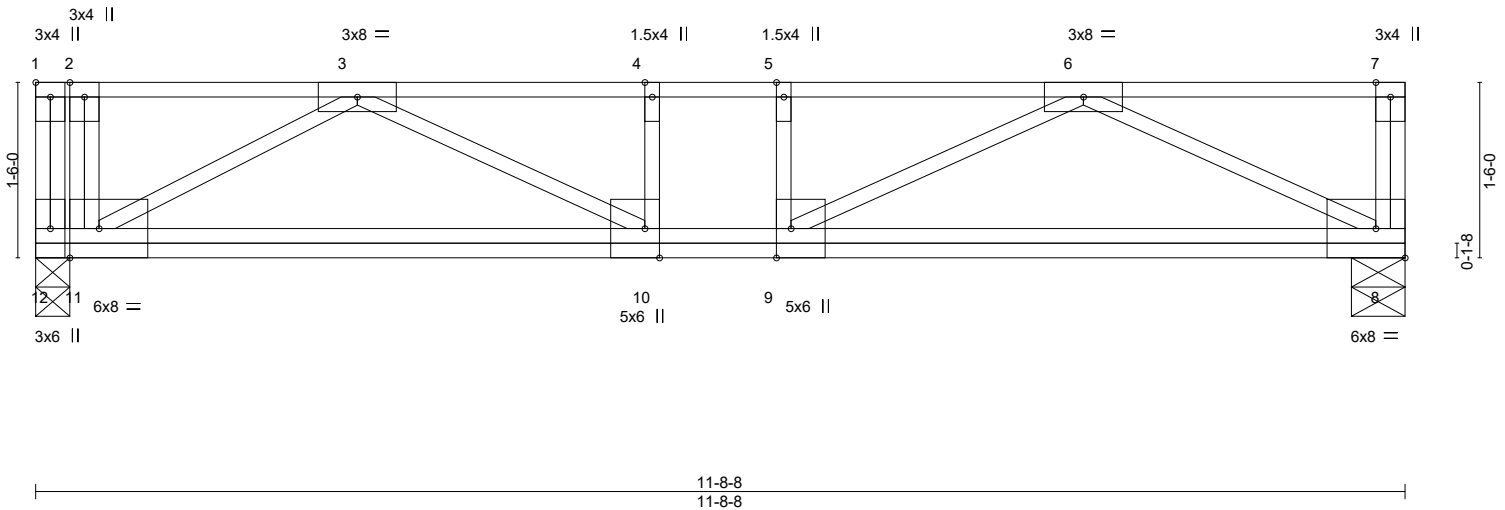


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [9:0-3-0,Edge], [10:0-3-0,Edge], [11:0-3-0,Edge]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.36	Vert(LL)	-0.11	8-9	>999	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.51	Vert(CT)	-0.14	8-9	>956		
BCLL 0.0	Rep Stress Incr	NO	WB 0.62	Horz(CT)	0.01	8	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 64 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	[MCT]
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12.	
WEBS 2x4 HF Stud/Std(flat)		

REACTIONS. (size) 12=0-3-8, 8=0-5-8
 Max Uplift 12=-1112(LC 14), 8=-313(LC 7)
 Max Grav 12=803(LC 3), 8=803(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-12=-129/356, 2-3=-919/837, 3-4=-1860/754, 4-5=-1237/0, 5-6=-1839/725, 6-7=-919/827
 BOT CHORD 10-11=-661/1313, 9-10=0/1237, 8-9=-642/1305
 WEBS 3-11=-1594/840, 3-10=-1061/1410, 6-8=-1612/855, 6-9=-988/1331, 2-11=-511/76

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1112 lb uplift at joint 12 and 313 lb uplift at joint 8.
 - 4) Load case(s) 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 11-8-8 for 350.0 plf.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard Except:
 14) User defined: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 8-12=-16(F), 1-7=-80(F)
 Concentrated Loads (lb)
 Vert: 11=1705(F)

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
--	---

Job J-21-01726-G	Truss F8	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367438
---------------------	-------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:01 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-uzYb2x0Hain0Zv8ObwLLu8PlDg1?4X?9Vu0068yZ0tG

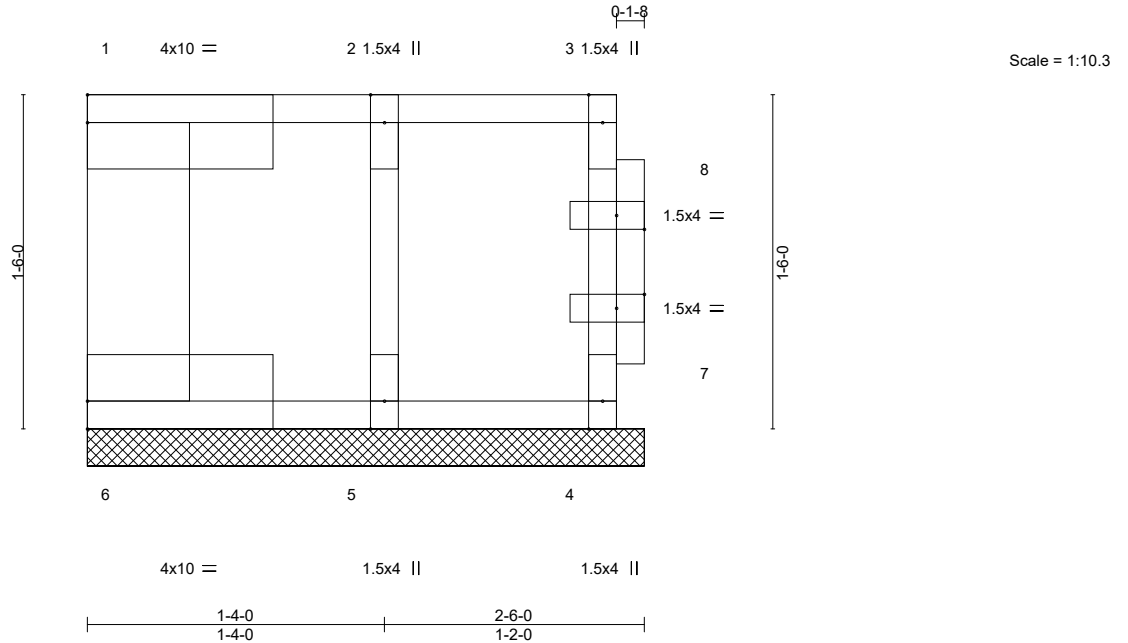


Plate Offsets (X,Y)-- [1:0-0-0,0-1-8], [6:0-0-0,0-1-8], [7:0-1-8,0-0-12], [8:0-1-8,0-0-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.37	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.04	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.19	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 16 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat) *Except*
1-6: 4X6 DF No.2&BTR G(flat)
OTHERS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-6-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 6=2-6-0, 4=2-6-0, 5=2-6-0
Max Grav 6=5275(LC 1), 4=200(LC 1), 5=743(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-5=-705/0, 1-6=-5268/0

- NOTES-**
- Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 5030 lb down at 0-2-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 4-6=-20, 1-3=-550(F=-450)
Concentrated Loads (lb)
Vert: 1=5030(F)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component





250 Klug Circle
Corona, CA 92880

Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367439
J-21-01726-G	F9	Floor	6	1		

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:02 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvZY7m?Fzu4Tw-M95_FH1vL?vtA3jb9dsarMxs14B?pr_JjY7ZeyZOtF

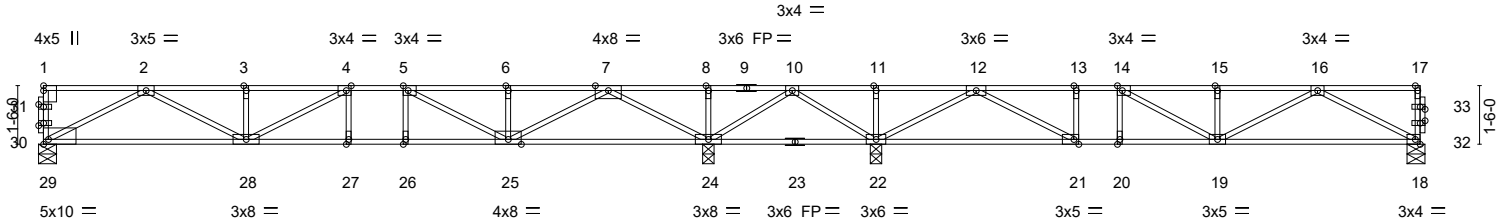

	17-1-12	21-5-4	35-5-14
	17-1-12	4-3-8	14-0-10
Plate Offsets (X, Y)--	[4:0-1-8,Edge], [5:0-1-8,Edge], [14:0-1-8,Edge], [21:0-1-8,Edge], [29:Edge,0-1-8], [30:0-1-8,0-0-12], [31:0-1-8,0-0-12], [32:0-1-8,0-0-12], [33:0-1-8,0-0-12]		

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.58	Vert(LL)	-0.15 27-28	>999	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.83	Vert(CT)	-0.22 27-28	>931	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.71	Horz(CT)	0.04 18	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 142 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 24-25,22-24.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. All bearings 0-5-8 except (jt=length) 24=0-3-8, 22=0-3-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) except 18=776(LC 4), 24=1484(LC 3), 22=1035(LC 4), 29=2400(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-29=-1789/0, 17-18=-274/0, 2-3=-1743/0, 3-4=-1743/0, 4-5=-1775/0, 5-6=-1132/0, 6-7=-1132/0, 7-8=0/1417, 8-10=0/1417, 10-11=0/793, 11-12=0/793, 12-13=-1158/0, 13-14=-1158/0, 14-15=-1338/0, 15-16=-1338/0
BOT CHORD 28-29=0/1079, 27-28=0/1775, 26-27=0/1775, 25-26=0/1775, 22-24=-1098/0, 21-22=0/376, 20-21=0/1158, 19-20=0/1158, 18-19=0/877
WEBS 13-21=-260/0, 2-29=-1224/0, 2-28=0/753, 5-25=-736/0, 7-25=0/1220, 7-24=-1667/0, 10-24=-782/0, 10-22=-307/469, 12-22=-1292/0, 12-21=0/900, 16-18=-995/0, 16-19=0/524, 14-19=-18/301

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 190 lb down at 35-3-10, and 1705 lb down at 0-2-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 18-29=-16, 1-17=-80
Concentrated Loads (lb)
Vert: 1=-1705(F) 17=-190(F)



September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-G	Truss F10	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367440
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:47:42 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-imGkTw3jAqQeamcDTqQpBUd8WqvU3ImXK6lLqDyZOuV



Scale = 1:15.3

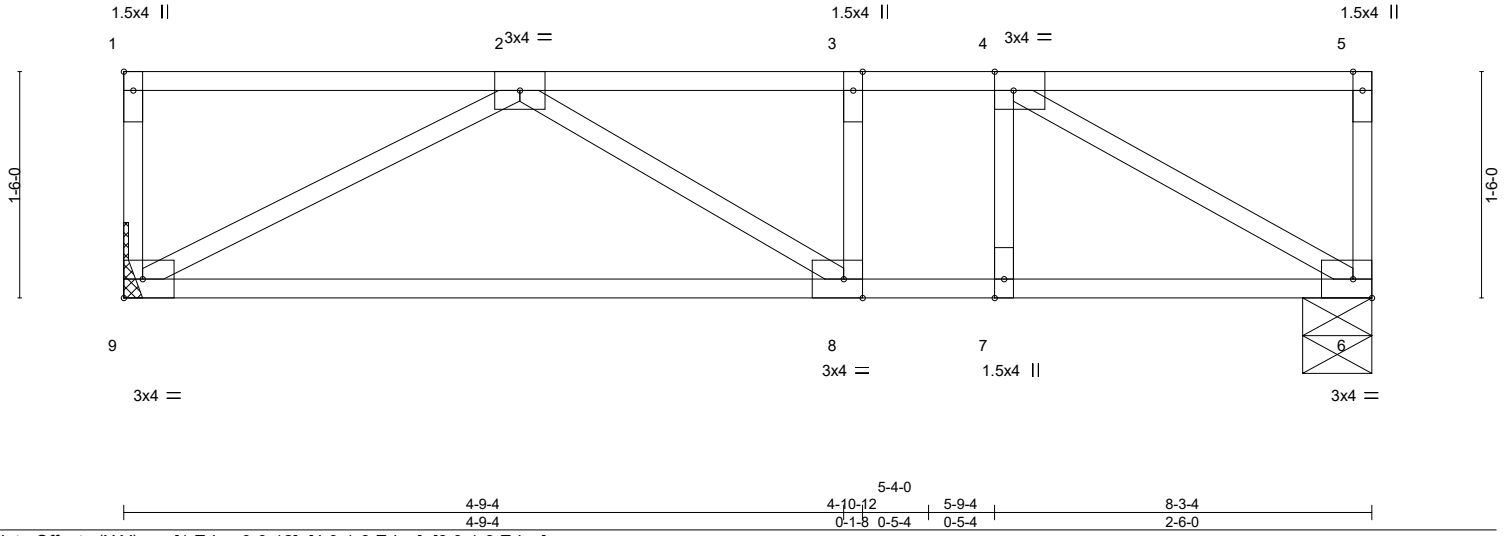


Plate Offsets (X,Y)--	[1:Edge,0-0-12], [4:0-1-8,Edge], [8:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.82	Vert(LL) -0.12 8-9 >821 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.75	Vert(CT) -0.23 8-9 >417 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.36	Horz(CT) 0.02 6 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 34 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 9=Mechanical, 6=0-5-8
Max Grav 9=798(LC 1), 6=798(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1118/0, 3-4=-1118/0
BOT CHORD 8-9=0/1084, 7-8=0/1118, 6-7=0/1118
WEBS 2-9=-1231/0, 4-6=-1292/0

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) Plates checked for a plus or minus 20 degree rotation about its center.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 6-9=-16, 1-5=-180(F=-100)



September 27, 2021

Job J-21-01726-G	Truss F11	Truss Type GABLE	Qty 1	Ply 1	HBG-LOT 3	K10367441
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:47:47 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-3k3dWd7s?zSWWhXUAGNO_uYL95m4k3dGUOT6WQyZOuQ

Q-1-8

Scale = 1:11.6

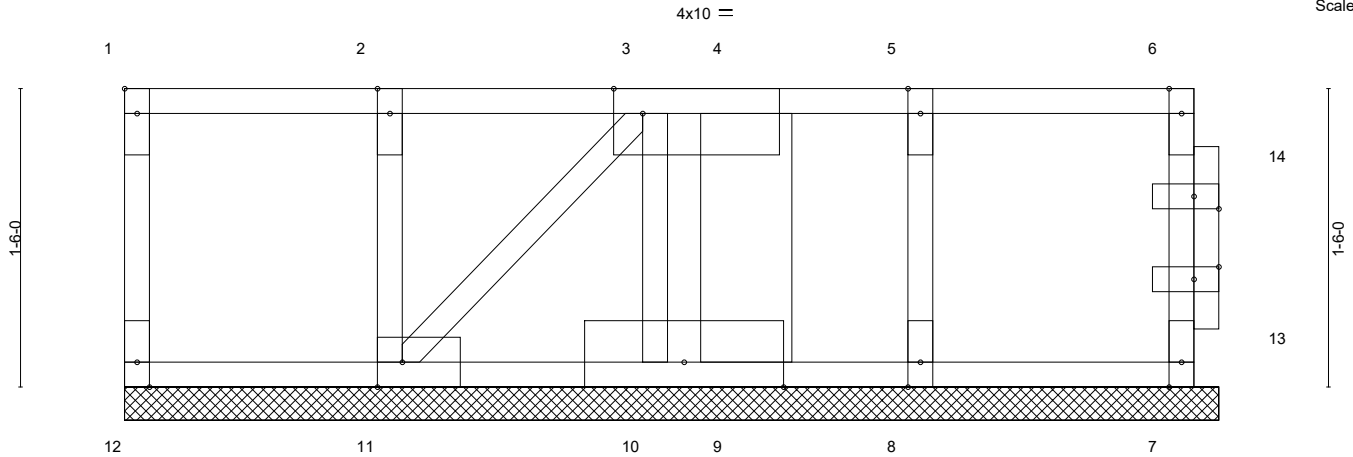


Plate Offsets (X,Y)--	[1:Edge,0-0-12], [3:0-1-12,Edge], [11:0-1-8,Edge], [13:0-1-8,0-0-12], [14:0-1-8,0-0-12]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.12	in (loc) l/defl L/d	MT20	185/148
TCDL 10.0	Plate Grip DOL 1.00	BC 0.02	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.00	WB 0.19	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr NO	Matrix-P	Horz(CT) 0.00 7 n/a n/a		
	Code IRC2015/TPI2014			Weight: 29 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 5-6-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat) *Except* 4-9: 4X6 DF No.2&BTR G(flat)	
OTHERS 2x4 HF Stud/Std(flat)	

REACTIONS. All bearings 5-6-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 12, 7, 11, 10, 8 except 9=5351(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-9=-5346/0

- NOTES-**
- All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails.
Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 5405 lb down at 3-1-8 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 7-12=-20, 1-6=-100
Concentrated Loads (lb)
Vert: 4=-5405(F)



September 27, 2021

Job J-21-01726-G	Truss F13	Truss Type Floor	Qty 11	Ply 1	HBG-LOT 3	K10367442
---------------------	--------------	---------------------	-----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:47:56 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-IT61PIEWtkbEGwgvHmg5mRCaHT6Lz2bYH85KPyZOuH



Scale = 1:36.0

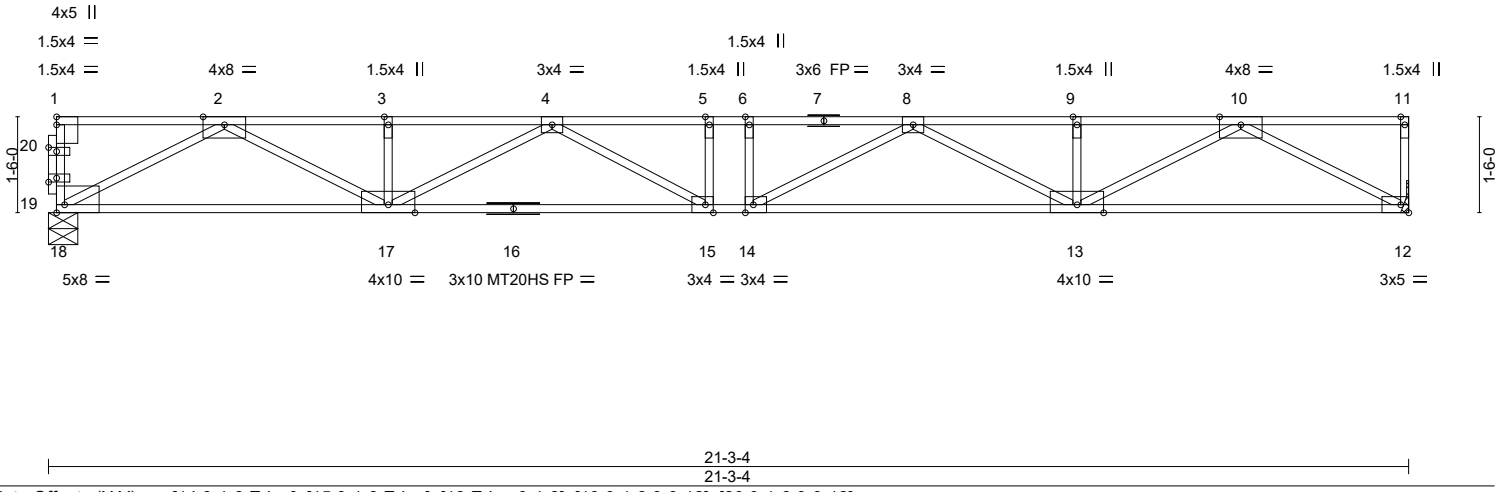


Plate Offsets (X,Y)--	[14:0-1-8,Edge], [15:0-1-8,Edge], [18:Edge,0-1-8], [19:0-1-8,0-0-12], [20:0-1-8,0-0-12]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.61	Vert(LL) -0.30 14 >836 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.73	Vert(CT) -0.46 13-14 >545 360	MT20HS	165/146
BCLL 0.0	Rep Stress Incr NO	WB 0.82	Horz(CT) 0.07 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 89 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 5-7-14 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 12=Mechanical, 18=0-5-8
Max Grav 12=1008(LC 1), 18=2713(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-1786/0, 2-3=-2892/0, 3-4=-2892/0, 4-5=-3875/0, 5-6=-3875/0, 6-8=-3875/0, 8-9=-2893/0, 9-10=-2893/0
BOT CHORD 17-18=0/1664, 15-17=0/3588, 14-15=0/3875, 13-14=0/3589, 12-13=0/1665
WEBS 2-18=-1889/0, 2-17=0/1393, 4-17=-790/0, 4-15=-47/551, 10-12=-1889/0, 10-13=0/1394, 8-13=-790/0, 8-14=-51/551

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1705 lb down at 0-2-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-18=-16, 1-11=-80
Concentrated Loads (lb)
Vert: 1=-1705(F)



September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-G	Truss F16	Truss Type Floor	Qty 8	Ply 1	HBG-LOT 3	K10367444
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:14 2021 Page 1
ID:DfeCB8LIBJ?Z9vzZY7m?Fzu4Tw-mwCqBsSoeGshQh2MLY?JUEYadkqiZ6dFh4V2zMyZOu?

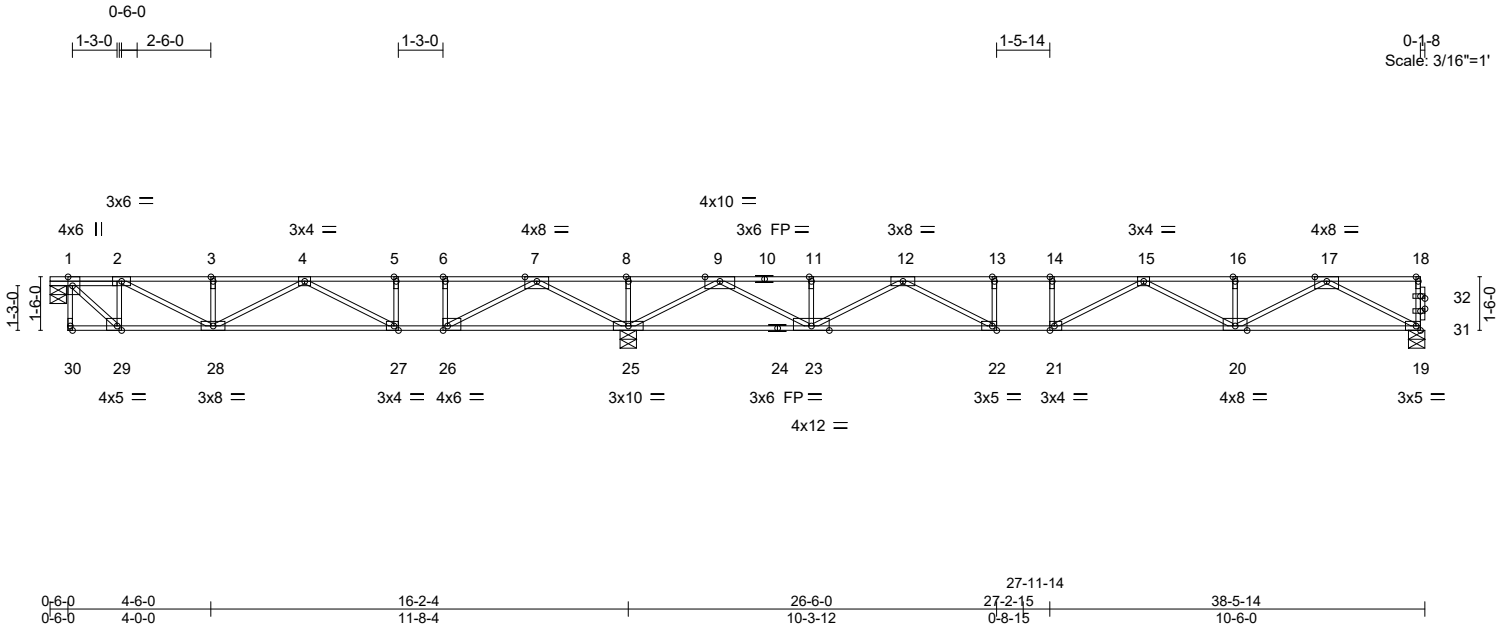


Plate Offsets (X,Y)--	[1:0-3-0,Edge], [21:0-1-8,Edge], [22:0-1-8,Edge], [26:0-1-8,Edge], [27:0-1-8,Edge], [29:0-1-8,Edge], [31:0-1-8,0-0-12], [32:0-1-8,0-0-12]
-----------------------	---

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.93	Vert(LL)	-0.29 20-21	>929	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.77	Vert(CT)	-0.45 20-21	>587	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.87	Horz(CT)	-0.03 25	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 167 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 DF No.1&Btr(flat) *Except* 1-2: 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat) *Except* 9-23: 2x4 HF No.2(flat)	

REACTIONS. (size) 19=0-5-8, 1=0-5-8, 25=0-5-8
Max Grav 19=1124(LC 4), 1=656(LC 3), 25=2160(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 18-19=-272/0, 1-2=-621/0, 2-3=-1410/0, 3-4=-1410/0, 4-5=-1341/605, 5-6=-1341/605,
6-7=-1341/605, 7-8=0/2256, 8-9=0/2256, 9-11=-1515/0, 11-12=-1515/0, 12-13=-3246/0,
13-14=-3246/0, 14-15=-3246/0, 15-16=-2620/0, 16-17=-2620/0
BOT CHORD 28-29=0/620, 27-28=-173/1648, 26-27=-605/1341, 25-26=-1335/299, 23-25=-369/0,
22-23=0/2543, 21-22=0/3246, 20-21=0/3172, 19-20=0/1529
WEBS 2-29=-587/0, 1-29=0/858, 6-26=-491/0, 13-22=-296/0, 2-28=0/892, 4-28=-270/257,
4-27=-749/0, 7-25=-1692/0, 7-26=0/1488, 9-25=-2216/0, 9-23=0/1823, 12-23=-1201/0,
12-22=0/975, 17-19=-1735/0, 17-20=0/1238, 15-20=-626/0, 15-21=-246/360

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 20 degree rotation about its center.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 190 lb down at 38-3-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 19-30=-16, 1-18=-80
Concentrated Loads (lb)
Vert: 18=-190(F)



September 27, 2021

Job J-21-01726-G	Truss F17	Truss Type Floor	Qty 2	Ply 1	HBG-LOT 3	K10367445
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:18 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-fiRL0EVJiUM7vIM7aO4F47JTL9KVzLqciTE57yZotx

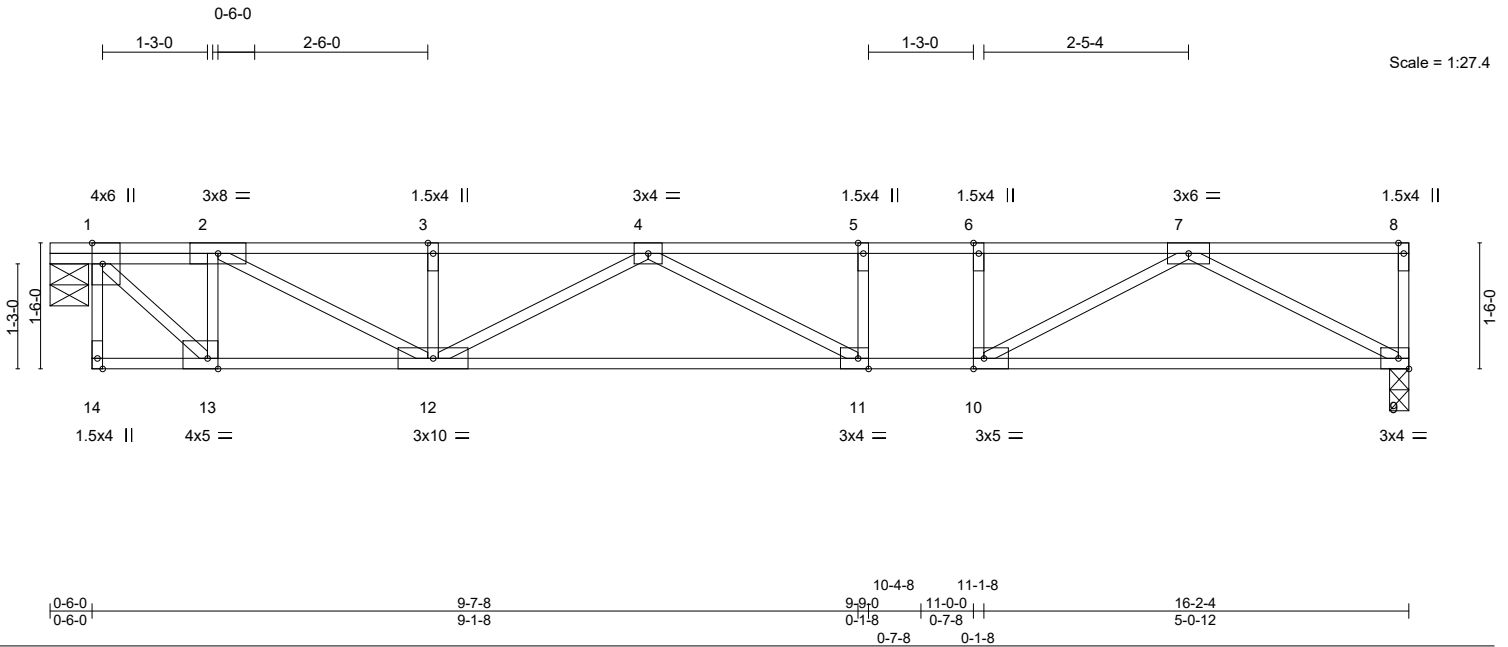



Plate Offsets (X,Y)-- [1:0-3-0,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [13:0-1-8,Edge]									
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.69	Vert(LL)	-0.25 11-12	>759	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.85	Vert(CT)	-0.41 11-12	>459	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.63	Horz(CT)	-0.02 9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 66 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 1=0-5-8, 9=0-2-12
Max Grav 1=747(LC 1), 9=747(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-713/0, 2-3=-1669/0, 3-4=-1669/0, 4-5=-1986/0, 5-6=-1986/0, 6-7=-1986/0
BOT CHORD 12-13=0/712, 11-12=0/2075, 10-11=0/1986, 9-10=0/1178
WEBS 2-13=-668/0, 1-13=0/984, 6-10=-301/0, 2-12=0/1080, 4-12=-461/0, 7-9=-1337/0, 7-10=0/926

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 9.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - 6) CAUTION, Do not erect truss backwards.

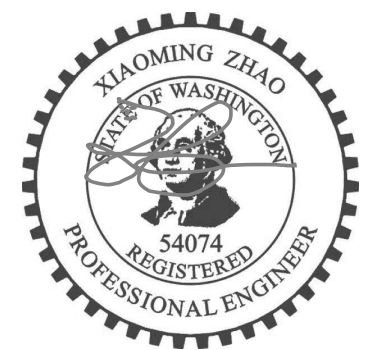

September 27, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 250 Klug Circle Corona, CA 92880
---	---

Job J-21-01726-G	Truss F18	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367446
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:24 2021 Page 1


ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-TrpcHhA4HK6GdDpHweBguLNiamANvcSj_ewZInyZOtr

Job Reference (optional)



0-1-8

Scale = 1:32.4

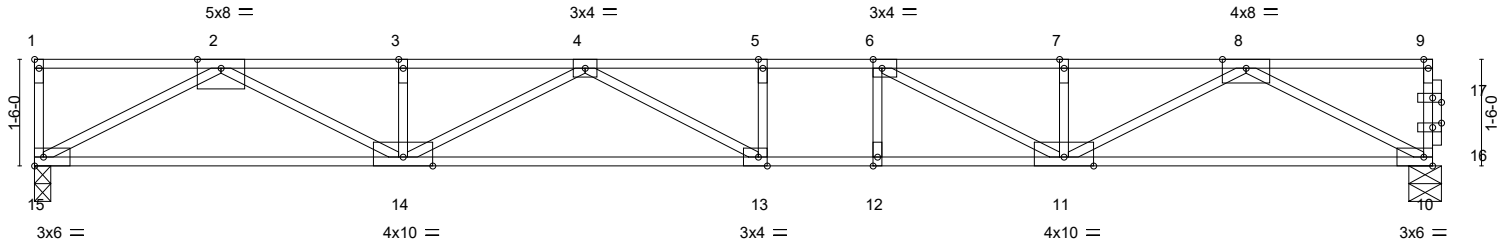

19-9-10
19-9-10

Plate Offsets (X,Y)-- [1:Edge,0-0-12], [6:0-1-8,Edge], [13:0-1-8,Edge], [16:0-1-8,0-0-12], [17:0-1-8,0-0-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.84	Vert(LL)	-0.33 13-14	>719	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 1.00	Vert(CT)	-0.52 13-14	>448	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.91	Horz(CT)	0.07 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 86 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 DF No.1&Btr(flat)
BOT CHORD 2x4 DF No.1&Btr(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-9-9 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 15=0-2-12, 10=0-5-8
Max Grav 15=1173(LC 1), 10=1433(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 9-10=-364/0, 2-3=-3297/0, 3-4=-3297/0, 4-5=-4106/0, 5-6=-4106/0, 6-7=-3270/0, 7-8=-3270/0
BOT CHORD 14-15=0/1922, 13-14=0/3997, 12-13=0/4106, 11-12=0/4106, 10-11=0/1913
WEBS 2-15=-2181/0, 2-14=0/1560, 4-14=-795/0, 4-13=-215/521, 8-10=-2171/0, 8-11=0/1540, 7-11=-274/36, 6-11=-1117/0

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 15.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 260 lb down at 19-7-6 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 10-15=-20, 1-9=-100
Concentrated Loads (lb)
Vert: 9=-260(F)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss F19	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367447
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:29 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-qpcVK?eC6tIz_iFjBmrbP4ConyrawkS8weK_yZOtm



Scale = 1:19.1


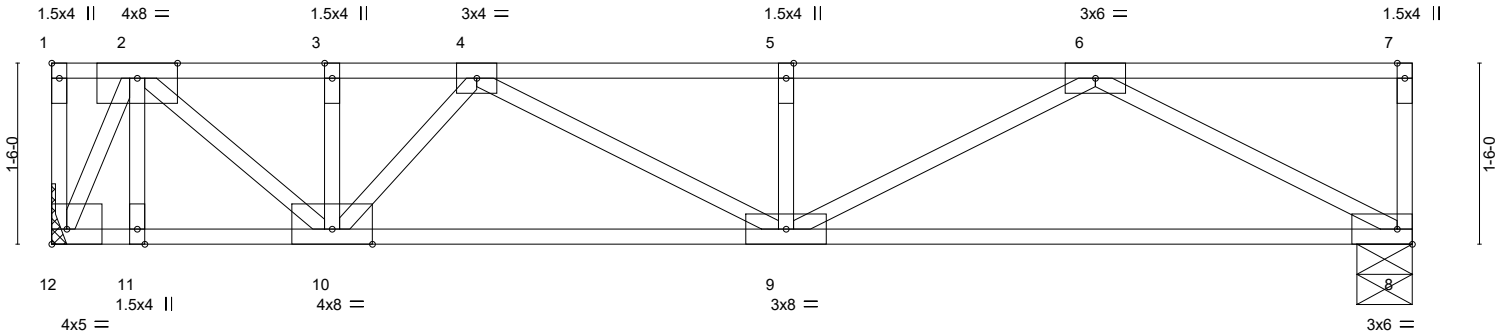


Plate Offsets (X,Y)-- [1:Edge,0-0-12], [12:Edge,0-1-8]									
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.68	Vert(LL) -0.07	9	>999	480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00		BC 0.66	Vert(CT) -0.17	8-9	>778	360		
BCLL 0.0	Rep Stress Incr NO		WB 0.72	Horz(CT) 0.03	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 49 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 12=Mechanical, 8=0-5-8
Max Grav 12=1092(LC 1), 8=1092(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1445/0, 3-4=-1445/0, 4-5=-2289/0, 5-6=-2289/0
BOT CHORD 11-12=0/510, 10-11=0/510, 9-10=0/1938, 8-9=0/1627
WEBS 2-12=-1199/0, 6-8=-1847/0, 6-9=0/751, 5-9=-458/0, 4-9=0/398, 4-10=-751/0, 2-10=0/1228

- NOTES-**
- Plates checked for a plus or minus 20 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 8-12=-16, 1-7=-180(F=-100)



September 27, 2021


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job J-21-01726-G	Truss F20	Truss Type Floor Supported Gable	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367448
---------------------	--------------	-------------------------------------	----------	----------	---------------------------------------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:32 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-EOHey0g5Po78aSRqOKKYD1fS_8XnSiuqus_aJyZOtj

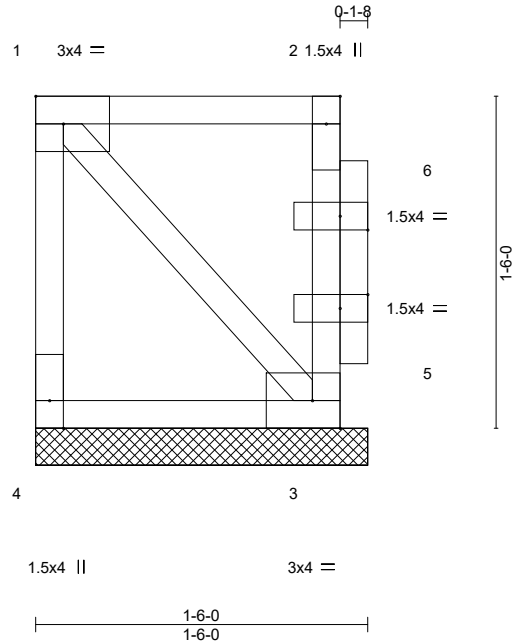

Scale = 1:10.4

Plate Offsets (X,Y)--	[5:0-1-8,0-0-12], [6:0-1-8,0-0-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.91	Vert(LL) n/a - n/a 999	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.02	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr NO	WB 0.00	Horz(CT) -0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 9 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 1-6-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. (size) 4=1-6-0, 3=1-6-0
Max Grav 4=520(LC 1), 3=520(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-4=-508/0, 2-3=-508/0

- NOTES-**
- 1) Plates checked for a plus or minus 20 degree rotation about its center.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 3-4=-20, 1-2=-812(F=-712)

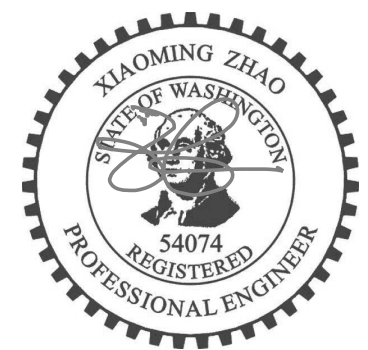

September 27, 2021

Job J-21-01726-G	Truss F21	Truss Type Floor	Qty 1	Ply 1	HBG-LOT 3	K10367449
---------------------	--------------	---------------------	----------	----------	-----------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:37 2021 Page 1


ID:DfeCB8LlBJ?Z9ZvzZY7m?Fzu4Tw-bM5X0kkDEKlQgDjnBtvjw5PaD?fxSVdD_9alGxyZOte

Job Reference (optional)



0-1-8

Scale = 1:36.8

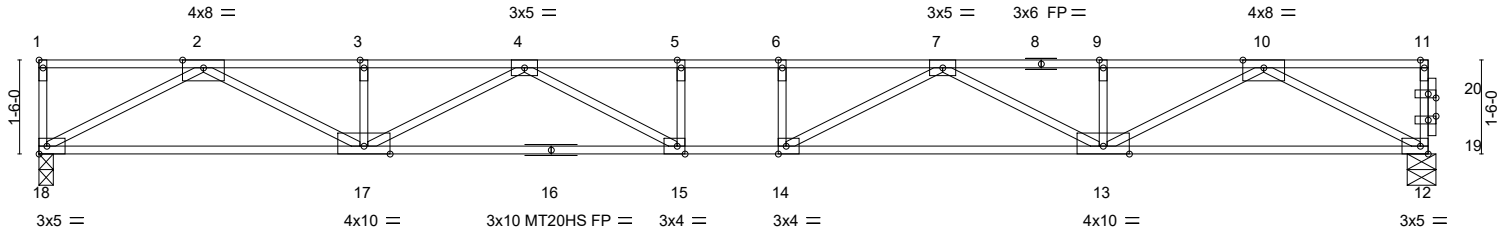

22-3-10
22-3-10

Plate Offsets (X,Y)-- [1:Edge,0-0-12], [14:0-1-8,Edge], [15:0-1-8,Edge], [19:0-1-8,0-0-12], [20:0-1-8,0-0-12]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.59	Vert(LL)	-0.31	14	>861	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.78	Vert(CT)	-0.47	13-14	>564	360	MT20HS	165/146
BCLL 0.0	Rep Stress Incr	NO	WB 0.88	Horz(CT)	0.08	12	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S							
									Weight: 96 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 DF No.1&Btr(flat)
BOT CHORD 2x4 DF No.1&Btr(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 12=0-5-8, 18=0-2-12
Max Grav 12=1248(LC 1), 18=1058(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 11-12=-272/0, 2-3=-3078/0, 3-4=-3078/0, 4-5=-4241/0, 5-6=-4241/0, 6-7=-4241/0, 7-9=-3079/0, 9-10=-3079/0
BOT CHORD 17-18=0/1756, 15-17=0/3862, 14-15=0/4241, 13-14=0/3862, 12-13=0/1756
WEBS 2-18=-1992/0, 2-17=0/1501, 4-17=-889/0, 4-15=0/707, 10-12=-1993/0, 10-13=0/1501, 7-13=-889/0, 7-14=0/707

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 1.5x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 20 degree rotation about its center.
 - 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 18.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.
 - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 190 lb down at 22-1-6 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-18=-16, 1-11=-80
Concentrated Loads (lb)
Vert: 11=-190(F)



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880

Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367450
J-21-01726-G	F22	Floor	1	1		

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:39 2021 Page 1
 ID:DfcCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-XkDHQPIUix?8wXTAllyB?WUSepIKwQdwRT3rKPzY0tc

0-1-8

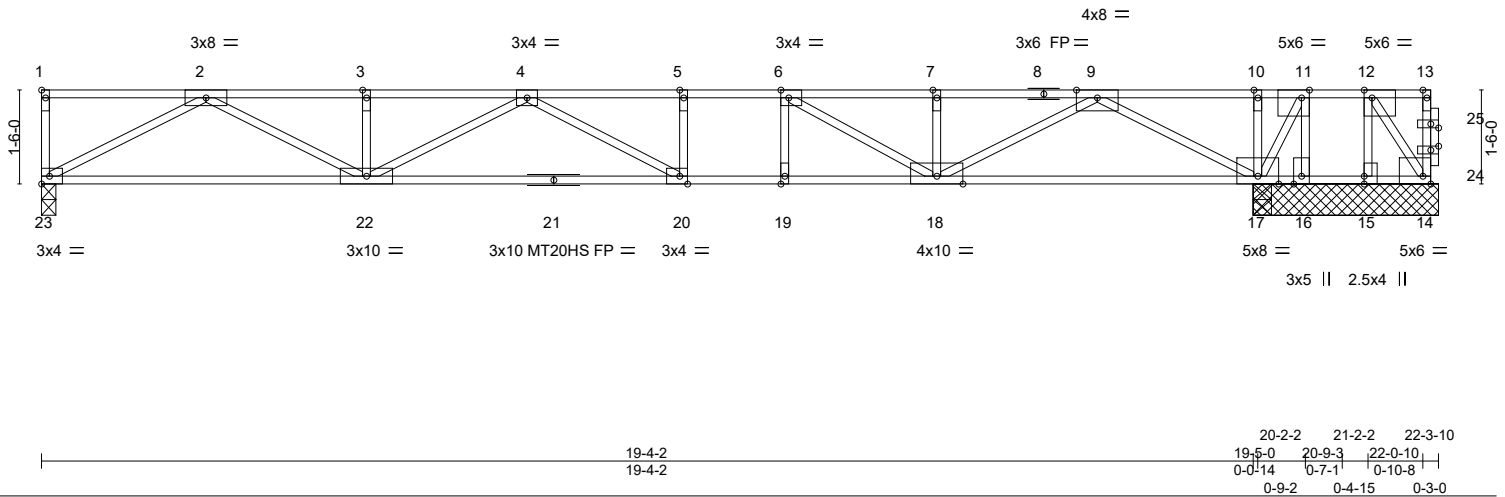



Plate Offsets (X,Y)-- [1:Edge,0-0-12], [6:0-1-8,Edge], [11:0-1-8,Edge], [12:0-1-8,Edge], [14:Edge,0-1-8], [15:0-1-8,0-0-0], [20:0-1-8,Edge], [24:0-1-8,0-0-12], [25:0-1-8,0-0-12]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.87	Vert(LL)	-0.31	20-22	>759	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.97	Vert(CT)	-0.49	20-22	>476	360	MT20HS	165/146
BCLL 0.0	Rep Stress Incr	NO	WB 0.82	Horz(CT)	0.04	17	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S							
									Weight: 96 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 5-10-6 oc purlins, except end verticals.
BOT CHORD 2x4 DF No.1&Btr(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	

REACTIONS. All bearings 2-11-8 except (jt=length) 23=0-2-12.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) except 14=996(LC 12), 16=1314(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 16 except 14=404(LC 11), 17=2977(LC 1), 17=2977(LC 1), 23=822(LC 8), 15=1702(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 13-14=-303/0, 1-2=-256/256, 2-3=-2209/0, 3-4=-2209/0, 4-5=-2364/0, 5-6=-2364/0, 6-7=-1446/0, 7-9=-1516/5, 9-10=0/1425, 10-11=0/1425, 11-12=-39/684
 BOT CHORD 22-23=0/1326, 20-22=0/2542, 19-20=0/2364, 18-19=0/2364, 17-18=-405/522, 16-17=-676/0, 15-16=-684/39, 14-15=-747/123
 WEBS 6-19=-29/265, 10-17=-392/0, 2-23=-1505/0, 2-22=0/1038, 4-22=-505/201, 4-20=-506/345, 9-17=-1861/0, 9-18=0/1399, 6-18=-1150/83, 11-17=-1831/35, 12-14=-235/1339, 12-15=-1665/0, 11-16=-275/1225

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 unless otherwise indicated.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 23.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 996 lb uplift at joint 14 and 1314 lb uplift at joint 16.
 - This truss has been designed for a total drag load of 100 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 22-3-10 for 100.0 plf.
 - This truss has large uplift reaction(s) from gravity load case(s). Proper connection is required to secure truss against upward movement at the bearings. Building designer must provide for uplift reactions indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwars.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-23=-16, 1-10=-80, 10-13=-792(F=-712)



September 27, 2021


Job	Truss	Truss Type	Qty	Ply	HBG-LOT 3	K10367451
J-21-01726-G	F23	GABLE	1	1	Job Reference (optional)	

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:48:43 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-QVSoGno_pAWaP8mxX8079LfdLQu6sN8WWM513TAyZOtY

0-1-8

Scale = 1:31.4

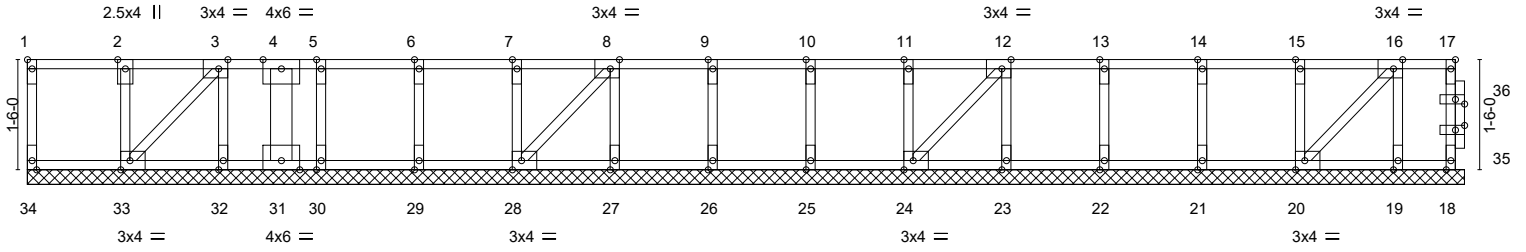

1-4-0	2-8-0	3-5-8	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	16-0-0	17-4-0	18-8-0	19-6-14
1-4-0	1-4-0	0-9-8	0-6-8	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-10-14

Plate Offsets (X,Y)-- [1:Edge,0-0-12], [3:0-1-8,Edge], [8:0-1-8,Edge], [12:0-1-8,Edge], [16:0-1-8,Edge], [20:0-1-8,Edge], [24:0-1-8,Edge], [28:0-1-8,Edge], [33:0-1-8,Edge], [35:0-1-8,0-12], [36:0-1-8,0-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.55	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	NO	WB 0.21	Horz(CT)	0.00	18	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 82 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 HF No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 HF No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 HF Stud/Std(flat)	
4-31: 4x4 DF No.2&BTR G(flat)	
OTHERS 2x4 HF Stud/Std(flat)	

REACTIONS. All bearings 19-6-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) except 34=309(LC 1), 18=874(LC 1), 33=951(LC 1), 32=718(LC 1), 30=450(LC 1), 29=515(LC 1), 28=493(LC 1), 27=519(LC 1), 26=507(LC 1), 25=507(LC 1), 24=506(LC 1), 23=507(LC 1), 22=508(LC 1), 21=503(LC 1), 20=514(LC 1), 19=448(LC 1), 31=3731(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-34=-299/0, 17-18=-870/0
WEBS 2-33=-903/0, 3-32=-695/0, 5-30=-428/0, 6-29=-488/0, 7-28=-478/0, 8-27=-492/0, 9-26=-480/0, 10-25=-480/0, 11-24=-480/0, 12-23=-480/0, 13-22=-481/0, 14-21=-477/0, 15-20=-493/0, 16-19=-425/0, 4-31=-3725/0

- NOTES-**
- All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 20 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - A plate rating reduction of 20% has been applied for the green lumber members.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 3582 lb down at 3-5-8, and 800 lb down at 19-4-10 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 18-34=-20, 1-4=-606(F=-506), 4-17=-360(F=-260)
Concentrated Loads (lb)
Vert: 17=-800(F) 4=-3582(F)




September 27, 2021

Job J-21-01726-G	Truss SP1	Truss Type FLOOR BLOCKING	Qty 9	Ply 1	HBG-LOT 3 K10367452
---------------------	--------------	------------------------------	----------	----------	------------------------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:03 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-qMfMTd2X6J1koDlniKNpzZU7aUi0YP1SyCi7B0yZOtE

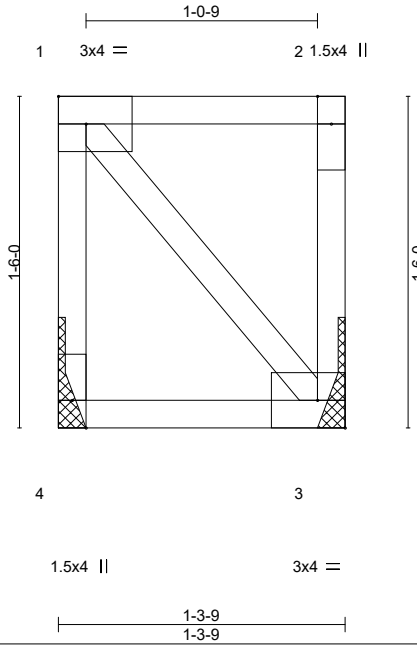

Scale = 1:10.4

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.21	Vert(LL) 0.00 4 **** 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.07	Vert(CT) -0.00 4 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.28	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 8 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 1-3-9 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 3=Mechanical
Max Uplift 4=-463(LC 6), 3=-463(LC 7)
Max Grav 4=505(LC 5), 3=505(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-4=-493/474, 1-2=-369/369
BOT CHORD 3-4=-369/369
WEBS 1-3=-632/632

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Plates checked for a plus or minus 20 degree rotation about its center.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 463 lb uplift at joint 4 and 463 lb uplift at joint 3.
- 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 1-3-9 for 350.0 plf.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss SP2	Truss Type FLOOR BLOCKING	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367453
---------------------	--------------	------------------------------	----------	----------	---------------------------------------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:04 2021 Page 1

ID:DfeCB8LiBJ?Z9ZvzZY7m?Fzu4Tw-IYDkgz39td9bQNtzG2u2Wn1I6u3IHtMcBscgjTyZotD

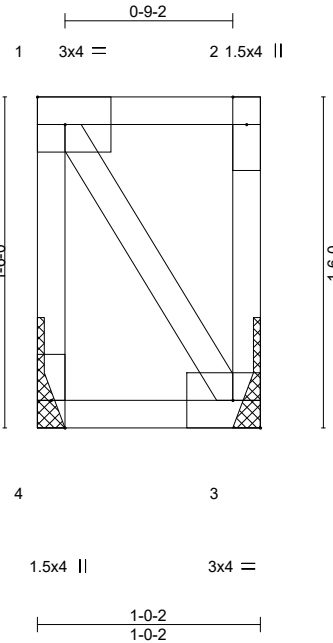

Scale = 1:10.4

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.16	Vert(LL) 0.00 4 **** 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.04	Vert(CT) -0.00 4 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.21	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 7 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 HF No.2(flat)
 BOT CHORD 2x4 HF No.2(flat)
 WEBS 2x4 HF Stud/Std(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-2 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 3=Mechanical
 Max Uplift 4=-467(LC 6), 3=-467(LC 7)
 Max Grav 4=499(LC 5), 3=499(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-4=-490/476, 1-2=-279/279
 BOT CHORD 3-4=-279/279
 WEBS 1-3=-572/572

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Plates checked for a plus or minus 20 degree rotation about its center.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 467 lb uplift at joint 4 and 467 lb uplift at joint 3.
- 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.60) Plate grip DOL=(1.60) Connect truss to resist drag loads along bottom chord from 0-0-0 to 1-0-2 for 350.1 plf.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
 Corona, CA 92880

Job J-21-01726-G	Truss SP3	Truss Type FLOOR BLOCKING	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367454
---------------------	--------------	------------------------------	----------	----------	---------------------------------------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:05 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvZY7m?Fzu4Tw-nkn6ul3odwHS1XSAqlQH3_ZTcHOQJtIQWMEFvyZOtC

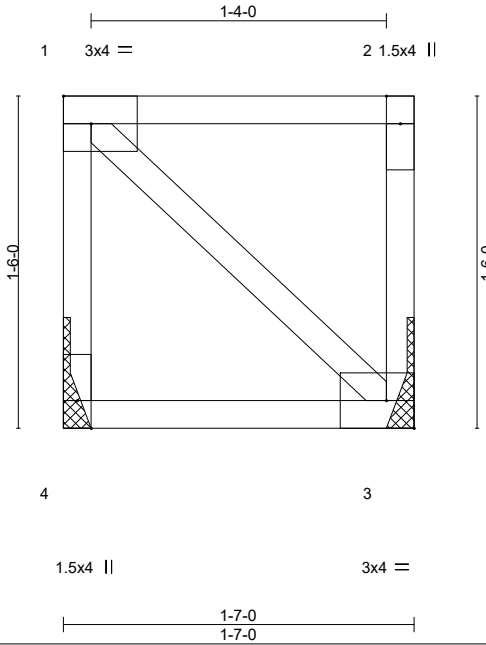

Scale = 1:10.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.17	Vert(LL)	0.00	4	****	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.08	Vert(CT)	-0.00	3-4	>999	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.26	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P							
									Weight: 9 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 1-7-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 3=Mechanical
Max Uplift 4=-458(LC 6), 3=-458(LC 7)
Max Grav 4=510(LC 5), 3=510(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-4=-496/473, 1-2=-459/459
BOT CHORD 3-4=-459/459
WEBS 1-3=-702/702

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Plates checked for a plus or minus 20 degree rotation about its center.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 458 lb uplift at joint 4 and 458 lb uplift at joint 3.
- 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.60) Plate grip DOL=(1.60) Connect truss to resist drag loads along bottom chord from 0-0-0 to 1-7-0 for 350.1 plf.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



250 Klug Circle
Corona, CA 92880


Job J-21-01726-G	Truss SP4	Truss Type FLOOR BLOCKING	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367455
---------------------	--------------	------------------------------	----------	----------	---------------------------------------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:06 2021 Page 1
ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-FxLU5e4QOEPJfg1MOTxWbC6ehIelnvveA5nnLyZOtB

1 3x4 = 2 1.5x4 ||

Scale = 1:10.4

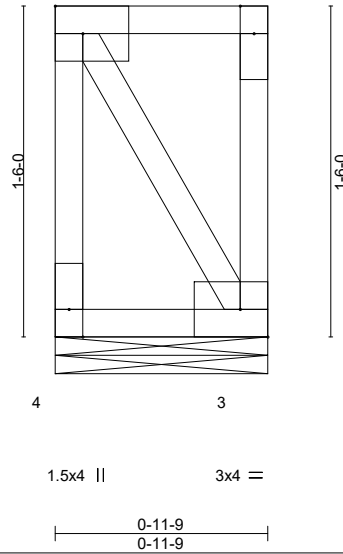

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.04	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.21	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 7 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 0-11-9 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 4=0-11-9, 3=0-11-9
Max Uplift 4=-468(LC 6), 3=-468(LC 7)
Max Grav 4=498(LC 5), 3=498(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-4=-490/476, 1-2=-264/264
BOT CHORD 3-4=-264/264
WEBS 1-3=-564/564

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Plates checked for a plus or minus 20 degree rotation about its center.
- 3) Gable requires continuous bottom chord bearing.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 468 lb uplift at joint 4 and 468 lb uplift at joint 3.
- 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.60) Plate grip DOL=(1.60) Connect truss to resist drag loads along bottom chord from 0-0-0 to 0-11-9 for 350.0 plf.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss SP5	Truss Type FLOOR BLOCKING	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367456
---------------------	--------------	------------------------------	----------	----------	---------------------------------------	-----------


Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:06 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-FxLU5e4QOEPJfg1MOTxWbC6dnh17InLveA5nnLyZOtB



Scale = 1:10.4

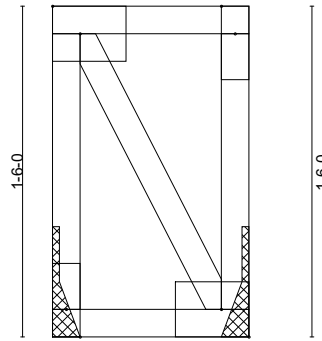

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.21	Vert(LL)	0.00	4	****	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.05	Vert(CT)	-0.00	4	>999	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.24	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P							
									Weight: 7 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 0-10-11 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 3=Mechanical
Max Uplift 4=-469(LC 6), 3=-469(LC 7)
Max Grav 4=497(LC 5), 3=497(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-4=-489/477
WEBS 1-3=-551/551

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 20 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 469 lb uplift at joint 4 and 469 lb uplift at joint 3.
 - 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 0-10-11 for 350.0 plf.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job J-21-01726-G	Truss SP6	Truss Type FLOOR BLOCKING	Qty 1	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367457
---------------------	--------------	------------------------------	----------	----------	---------------------------------------	-----------

Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:07 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-j7vtJ_529YXAHqcYxASi8PfoX54SUEj2tqrKKnyZOtA

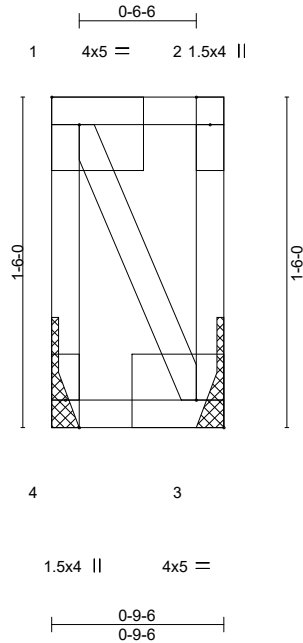

Scale = 1:10.5

Plate Offsets (X,Y)--		[1:Edge,0-1-8], [3:Edge,0-1-8]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.21	Vert(LL) 0.00	4	****	480	MT20	185/148
TCDL 10.0	Lumber DOL	1.00	BC 0.04	Vert(CT) -0.00	4	>999	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.23	Horz(CT) 0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 6 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 HF No.2(flat)
BOT CHORD 2x4 HF No.2(flat)
WEBS 2x4 HF Stud/Std(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 0-9-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 3=Mechanical
Max Uplift 4=-471(LC 6), 3=-471(LC 7)
Max Grav 4=494(LC 5), 3=494(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-4=-488/477
WEBS 1-3=-533/533

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Plates checked for a plus or minus 20 degree rotation about its center.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 471 lb uplift at joint 4 and 471 lb uplift at joint 3.
- 5) This truss has been designed for a total drag load of 350 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 0-9-6 for 350.0 plf.
- 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
Corona, CA 92880

Job J-21-01726-G	Truss X1	Truss Type FLOOR	Qty 16	Ply 1	HBG-LOT 3 Job Reference (optional)	K10367458
---------------------	-------------	---------------------	-----------	----------	---------------------------------------	-----------



Roof Truss Supply, Woodinville, WA - 98072,

8.520 s Aug 27 2021 MiTek Industries, Inc. Mon Sep 27 14:49:08 2021 Page 1

ID:DfeCB8LIBJ?Z9ZvzZY7m?Fzu4Tw-BJTfWK6gwr1u_BiVuz_gdB0AVQDDkdB6UausEyZOt9



Scale = 1:10.4

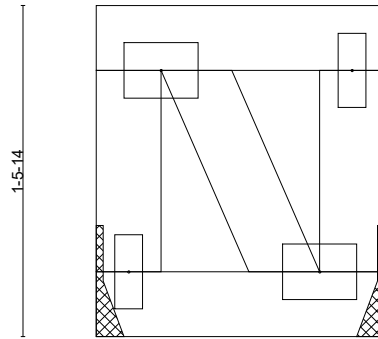

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.03	Vert(LL) 0.00 4 **** 480	MT20	185/148
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) -0.00 4 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MP		Weight: 6 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 HF No.2
 BOT CHORD 2x4 HF No.2
 WEBS 2x4 HF Stud/Std

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-3-9 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 3=Mechanical
 Max Grav 4=60(LC 1), 3=60(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- Plates checked for a plus or minus 20 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 27, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




250 Klug Circle
 Corona, CA 92880

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

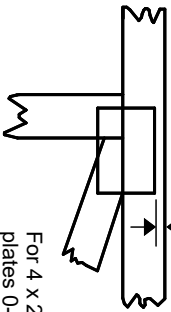

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

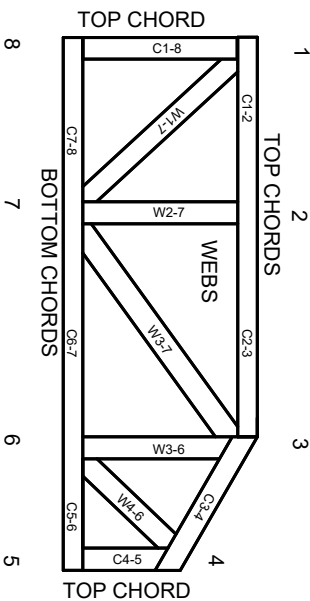

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on Lumber values established by others.

© 2012 MITek® All Rights Reserved



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.



MITek Engineering Reference Sheet: MIL-7473 rev. 5/19/2020