

CONSTRUCTION STORMWATER CONTROL (CSC) GENERAL NOTES

1. VERIFY WITH LOCAL JURISDICTION IF A FIRST GROUND DISTURBANCE INSPECTION IS REQUIRED PRIOR TO START OF WORK ON ALL SITES WITH LAND DISTURBING ACTIVITY.
2. THE APPLICANT SHALL DESIGNATE AN EROSION AND SEDIMENT CONTROL (ESC) SUPERVISOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION AND MAINTENANCE OF EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICES (BMPs). FOR LARGE CONSTRUCTION PROJECTS, THE ESC SUPERVISOR SHOULD BE A CERTIFIED EROSION AND SEDIMENT CONTROL LEAD (CESCL). PROVIDE THE NAME AND PHONE NUMBER OF THE ESC SUPERVISOR TO THE SITE INSPECTOR AT THE FIRST GROUND DISTURBANCE INSPECTION.
3. BMPs SHALL BE INSTALLED PRIOR TO STARTING CONSTRUCTION TO ENSURE SEDIMENT-LADEN WATER DOES NOT LEAVE THE PROJECT SITE OR ENTER ROADSIDE DITCHES, STORM DRAINS, SURFACE WATERS, OR WETLANDS.
4. THE BMPs INCLUDED IN THIS PLAN ARE THE MINIMUM REQUIREMENTS FOR ANTICIPATED SITE CONDITIONS. THE APPLICANT IS RESPONSIBLE FOR ENSURING THAT BMPs ARE MODIFIED AS NEEDED FOR UNEXPECTED STORM EVENTS OR OTHER UNFORESEEN CIRCUMSTANCES, AND TO ACCOUNT FOR CHANGING SITE CONDITIONS.
5. ANY AREAS OF DISTURBED SOIL THAT WILL NOT BE WORKED FOR TWO CONSECUTIVE DAYS DURING THE WET SEASON (OCT 1 TO APRIL 30) OR SEVEN DAYS DURING THE DRY SEASON (MAY 1 TO SEPT 30) SHALL BE IMMEDIATELY STABILIZED WITH APPROVED BMPs METHODS (E.G. STRAW, MULCH, PLASTIC COVERING, COLD MIX, ETC.).
6. GRADING AND/OR SOIL DISTURBING ACTIVITIES MAY BE LIMITED OR PROHIBITED FOR CERTAIN SITES SUBJECT TO ECA STANDARDS (I.E. ECA STEEP SLOPES, LANDSIDE PRONE AREAS, ETC.) BETWEEN OCTOBER 31ST AND APRIL 1ST. VERIFY WITH LOCAL JURISDICTION FOR COMPLIANCE REQUIREMENTS.
7. CITY STREETS AND SIDEWALKS SHALL BE KEPT CLEAN AT ALL TIMES. NO MATERIAL SHALL BE STORED ON CITY STREETS OR SIDEWALKS.
8. POLLUTION CONTROL MEASURES SHALL BE FOLLOWED TO ENSURE THAT NO LIQUID PRODUCTS OR CONTAMINATED WATER ENTERS ANY STORM DRAINAGE FACILITIES OR OTHERWISE LEAVES THE PROJECT SITE. ANY HAZARDOUS MATERIALS OR LIQUID PRODUCTS THAT HAVE THE POTENTIAL TO POLLUTE RUNOFF SHALL BE STORED AND DISPOSED OF PROPERLY.
9. ENSURE THAT WASHOUT FROM CONCRETE TRUCKS IS PERFORMED OFF-SITE OR IN DESIGNATED CONCRETE WASHOUT AREAS ONLY. DO NOT WASH OUT CONCRETE TRUCKS ONTO THE GROUND, OR TO STORM DRAINS OR OPEN DITCHES. DO NOT DUMP EXCESS CONCRETE ONSITE, EXCEPT IN DESIGNATED CONCRETE WASHOUT AREAS.
10. ALL AREAS OF DISTURBED SOIL SHALL BE FULLY STABILIZED WITH THE APPROPRIATE SOIL AMENDMENT AND COVER MEASURES AT COMPLETION OF THE PROJECT. TYPICAL COVER MEASURES INCLUDE LANDSCAPING OR HYDROSEED WITH MULCH.

CONSTRUCTION STORMWATER CONTROL (CSC) PLAN REQUIREMENTS / NARRATIVE

THIS PLAN IS REQUIRED FOR ALL PROJECTS WITH GREATER THAN 750 SQUARE FEET OF LAND DISTURBING ACTIVITIES.

SHOW TEMPORARY AND PERMANENT BEST MANAGEMENT PRACTICES (BMPs) IN THE PLAN VIEW OF THIS SHEET THAT WILL ACCOMPLISH THE MINIMUM REQUIREMENTS DESCRIBED IN THE NARRATIVE BELOW.

THE BMPs SHOWN IN THE PLAN VIEW OF THIS PLAN ARE THE MINIMUM REQUIRED. ADDITIONAL BMPs ARE REQUIRED WHEN MINIMUM CONTROLS ARE NOT SUFFICIENT TO PREVENT EROSION OR TRANSPORT OF SEDIMENT OR OTHER POLLUTANTS FROM THE SITE.

- MARK CLEARING LIMITS
- DELINEATE ENVIRONMENTALLY CRITICAL AREAS
- RETAIN TOP LAYER AND NATIVE VEGETATION
- ESTABLISH CONSTRUCTION ACCESS
- PROTECT DOWNSTREAM PROPERTIES AND RECEIVING WATERS
- PREVENT EROSION AND SEDIMENT TRANSPORT FROM THE SITE
- STABILIZE SOILS
- PROTECT SLOPES
- PROTECT STORM DRAINS
- STABILIZE CHANNEL AND OUTLETS
- CONTROL POLLUTANTS
- CONTROL DEWATERING
- MAINTAIN AND INSPECT BMPs
- EXECUTE CONSTRUCTION STORMWATER CONTROL PLAN
- MINIMIZE OPEN TRENCHES
- PHASE THE PROJECT
- INSTALL PERMANENT FLOW CONTROL AND WATER QUALITY FACILITIES
- PROTECT STORMWATER BMPs PRIOR TO, DURING, AND AFTER CONSTRUCTION

POST CONSTRUCTION SOIL MANAGEMENT PLAN

AT THE END OF PROJECT, ALL AREAS DISTURBED AND NOT COVERED WITH A HARD SURFACE MUST BE AMENDED PER THE SOIL AMENDMENT DETAIL BELOW AND PROBE TO 12-INCHES AT THE SITE FINAL INSPECTION.

LABEL ALL AREAS DISTURBED AND NOT COVERED WITH A HARD SURFACE WITHIN THE SITE AS ONE OF THE FOLLOWING: SA (SOIL AMENDMENT AREA) OR ND (NON-DISTURBED AREA). SEE DEFINITIONS BELOW. DO NOT REFERENCE AN ALTERNATE PLAN SHEET.


DEFINITIONS:

- NON-DISTURBED AREA (ND): VEGETATED AREAS THAT WILL NOT BE SUBJECT TO LAND DISTURBING ACTIVITY DO NOT REQUIRE SOIL AMENDMENT IF THEY ARE FENCED AND CONTINUOUSLY PROTECTED THROUGHOUT CONSTRUCTION. THE FENCING MUST BE IN PLACE AT THE FIRST GROUND DISTURBANCE INSPECTION. THIS WILL BE MONITORED BY THE DPD SITE INSPECTOR. NO DISTURBANCE, INCLUDING VEHICLE TRAFFIC OR MATERIAL STORAGE, IS ALLOWED IN THESE AREAS UNTIL FINAL INSPECTION. LABEL THESE AREAS AS (ND) IN THE PLAN VIEW.
- SOIL AMENDMENT AREA (SA): VEGETATED OR COMPOST AREAS (TURF AND LANDSCAPE) MUST BE AMENDED PER THE SOIL AMENDMENT DETAIL AND THE SUBSOIL MUST BE LOOSENOED SO IT WILL PROBE TO A DEPTH OF 12 INCHES PRIOR TO SITE FINAL INSPECTION. THIS INCLUDES AREAS IMPACTED BY CLEARING AND GRADING, STOCKPILING, SITE ACCESS, PATHWAYS AND MATERIALS OR EQUIPMENT STORAGE. LABEL THESE AREAS AS (SA) IN THE PLAN VIEW.

ESTIMATED COMPOST REQUIRED FOR SOIL AMENDMENT

AREA REQUIRING AMENDMENT (SA) (SQUARE FEET) X 0.0062 = REQUIRED COMPOST (CUBIC YARDS)


SOIL AMENDMENT

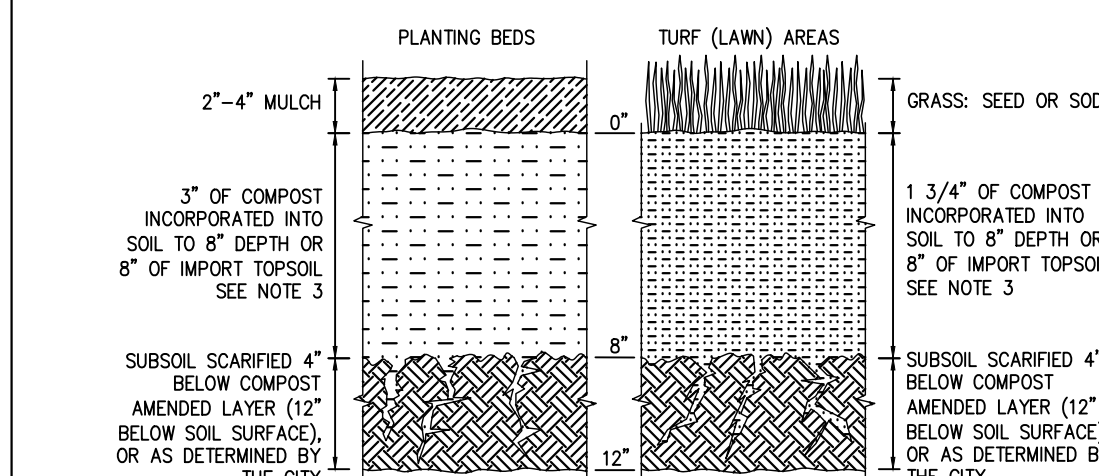

- NOTES:**
1. POST CONSTRUCTION SOIL AMENDMENT IS REQUIRED ON ALL AREAS NOT COVERED BY IMPERVIOUS SURFACE WHERE SOIL IS DISTURBED DURING CONSTRUCTION.
 2. SOIL AMENDMENT MUST PASS A 12 INCH MINIMUM PROBE TEST.
 3. IMPORT TOPSOIL, IF USED, MUST MEET THE REQUIREMENTS OF THE 2016 SEATTLE STORMWATER MANUAL, VOL. 1, SECTIONS 5.1.5.1 AND 5.1.5.3.

SYMBOL: (SA) AREA REQUIRING SOIL AMENDMENT (ND) NON-DISTURBED AREA (SOIL AMENDMENT NOT REQUIRED)


FILTER FENCE

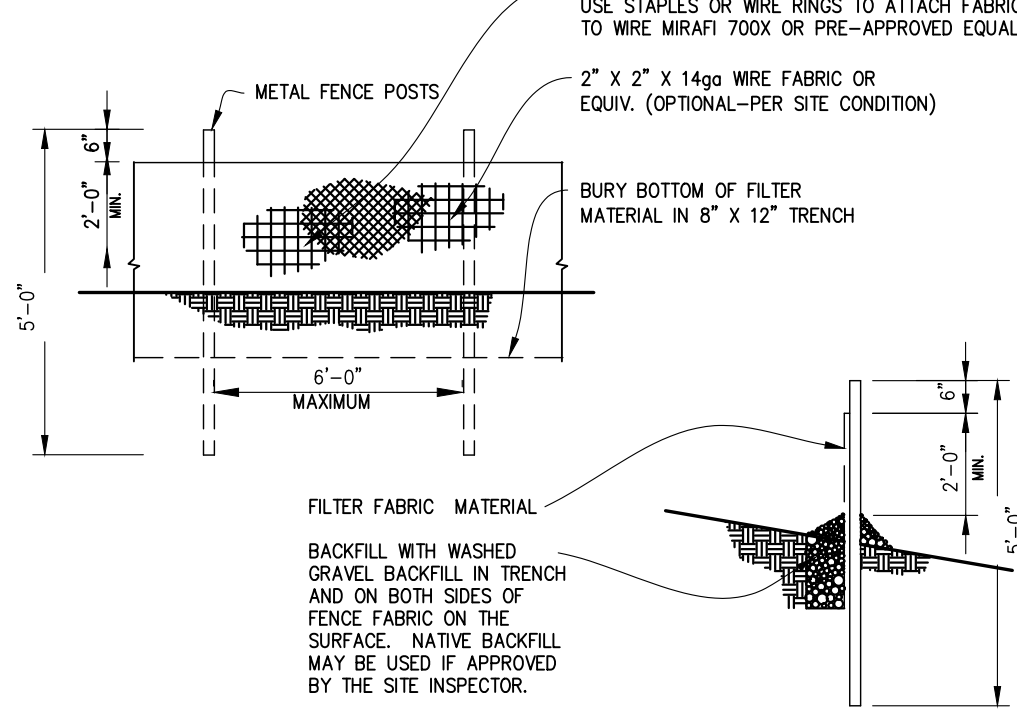

NOTE: ANGLE SILT FENCE BACK UP THE SLOPE AT THE END OF RUN.

SYMBOL: [Symbol]


STABILIZED CONSTRUCTION ACCESS

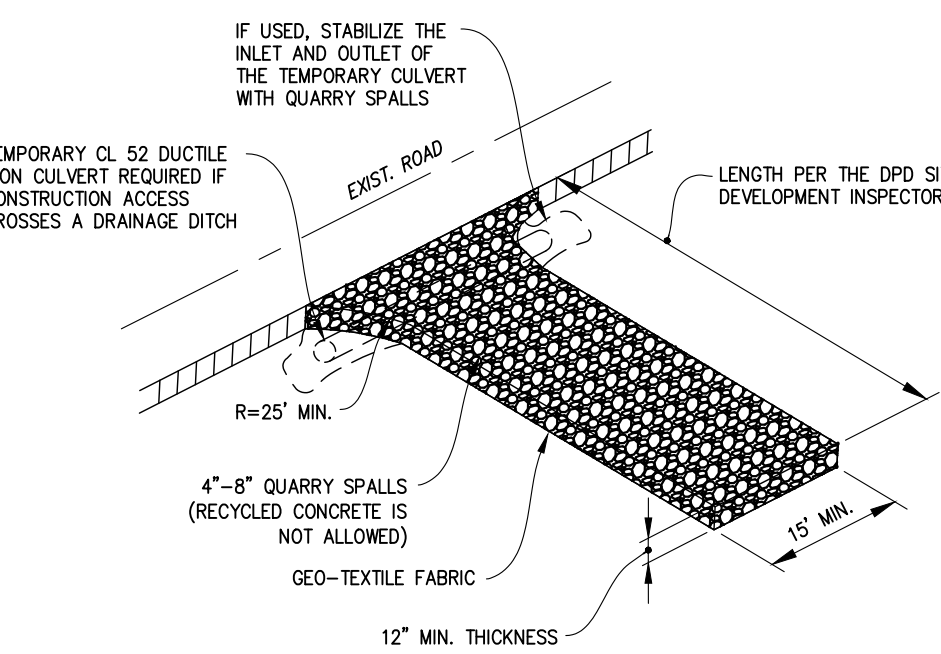

STABILIZED ACCESS SHALL BE USED IN ALL AREAS OF THE SITE WITH VEHICLE TRAFFIC AND PARKING, INCLUDING PLANTING STRIPS. RECYCLED CONCRETE IS NOT ALLOWED.


SYMBOL: [Symbol]

TREE & VEGETATION PROTECTION

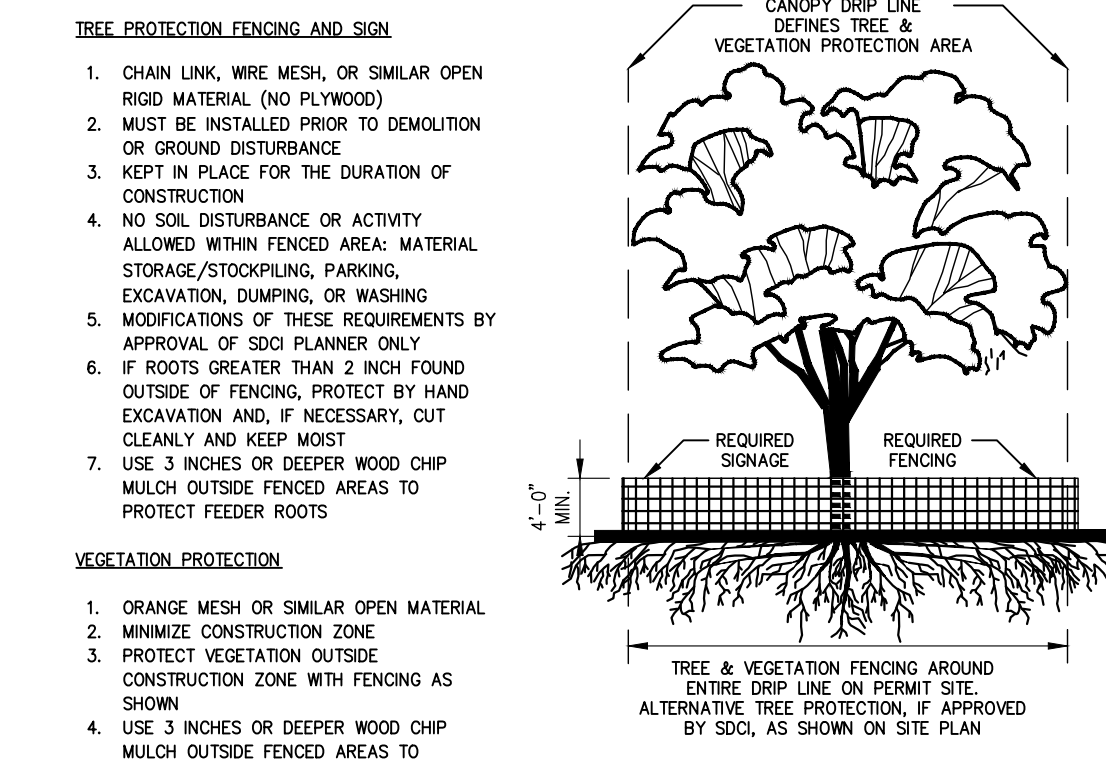


SYMBOL: [Symbol]

COMPOST SOCK

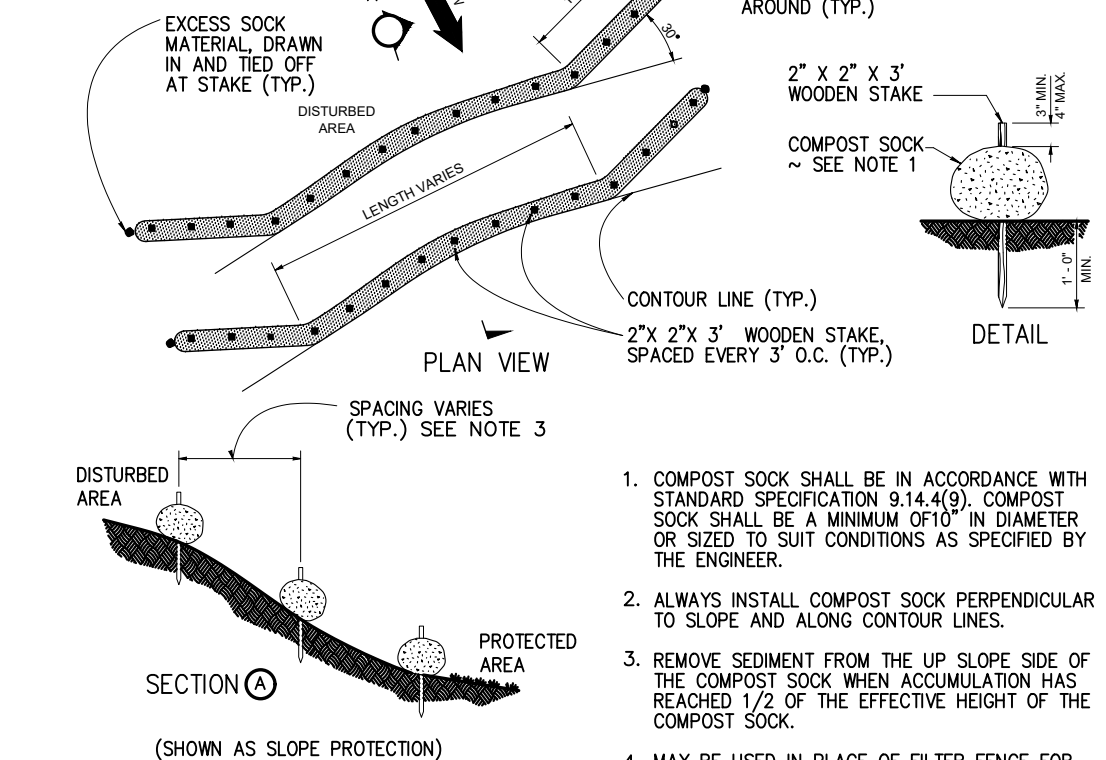


SYMBOL: [Symbol]

STOCKPILE AND EXPOSED SLOPE COVERING

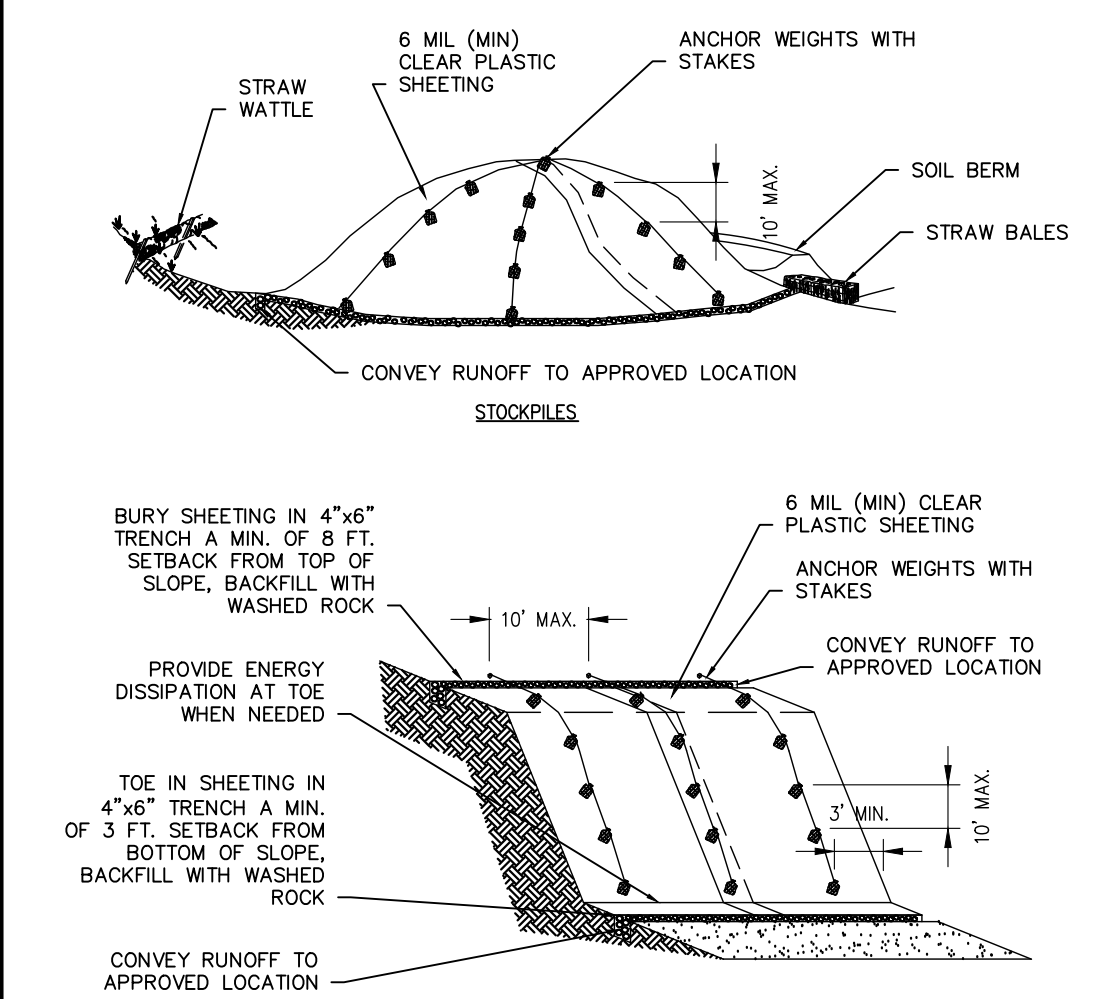

SYMBOL: [Symbol]

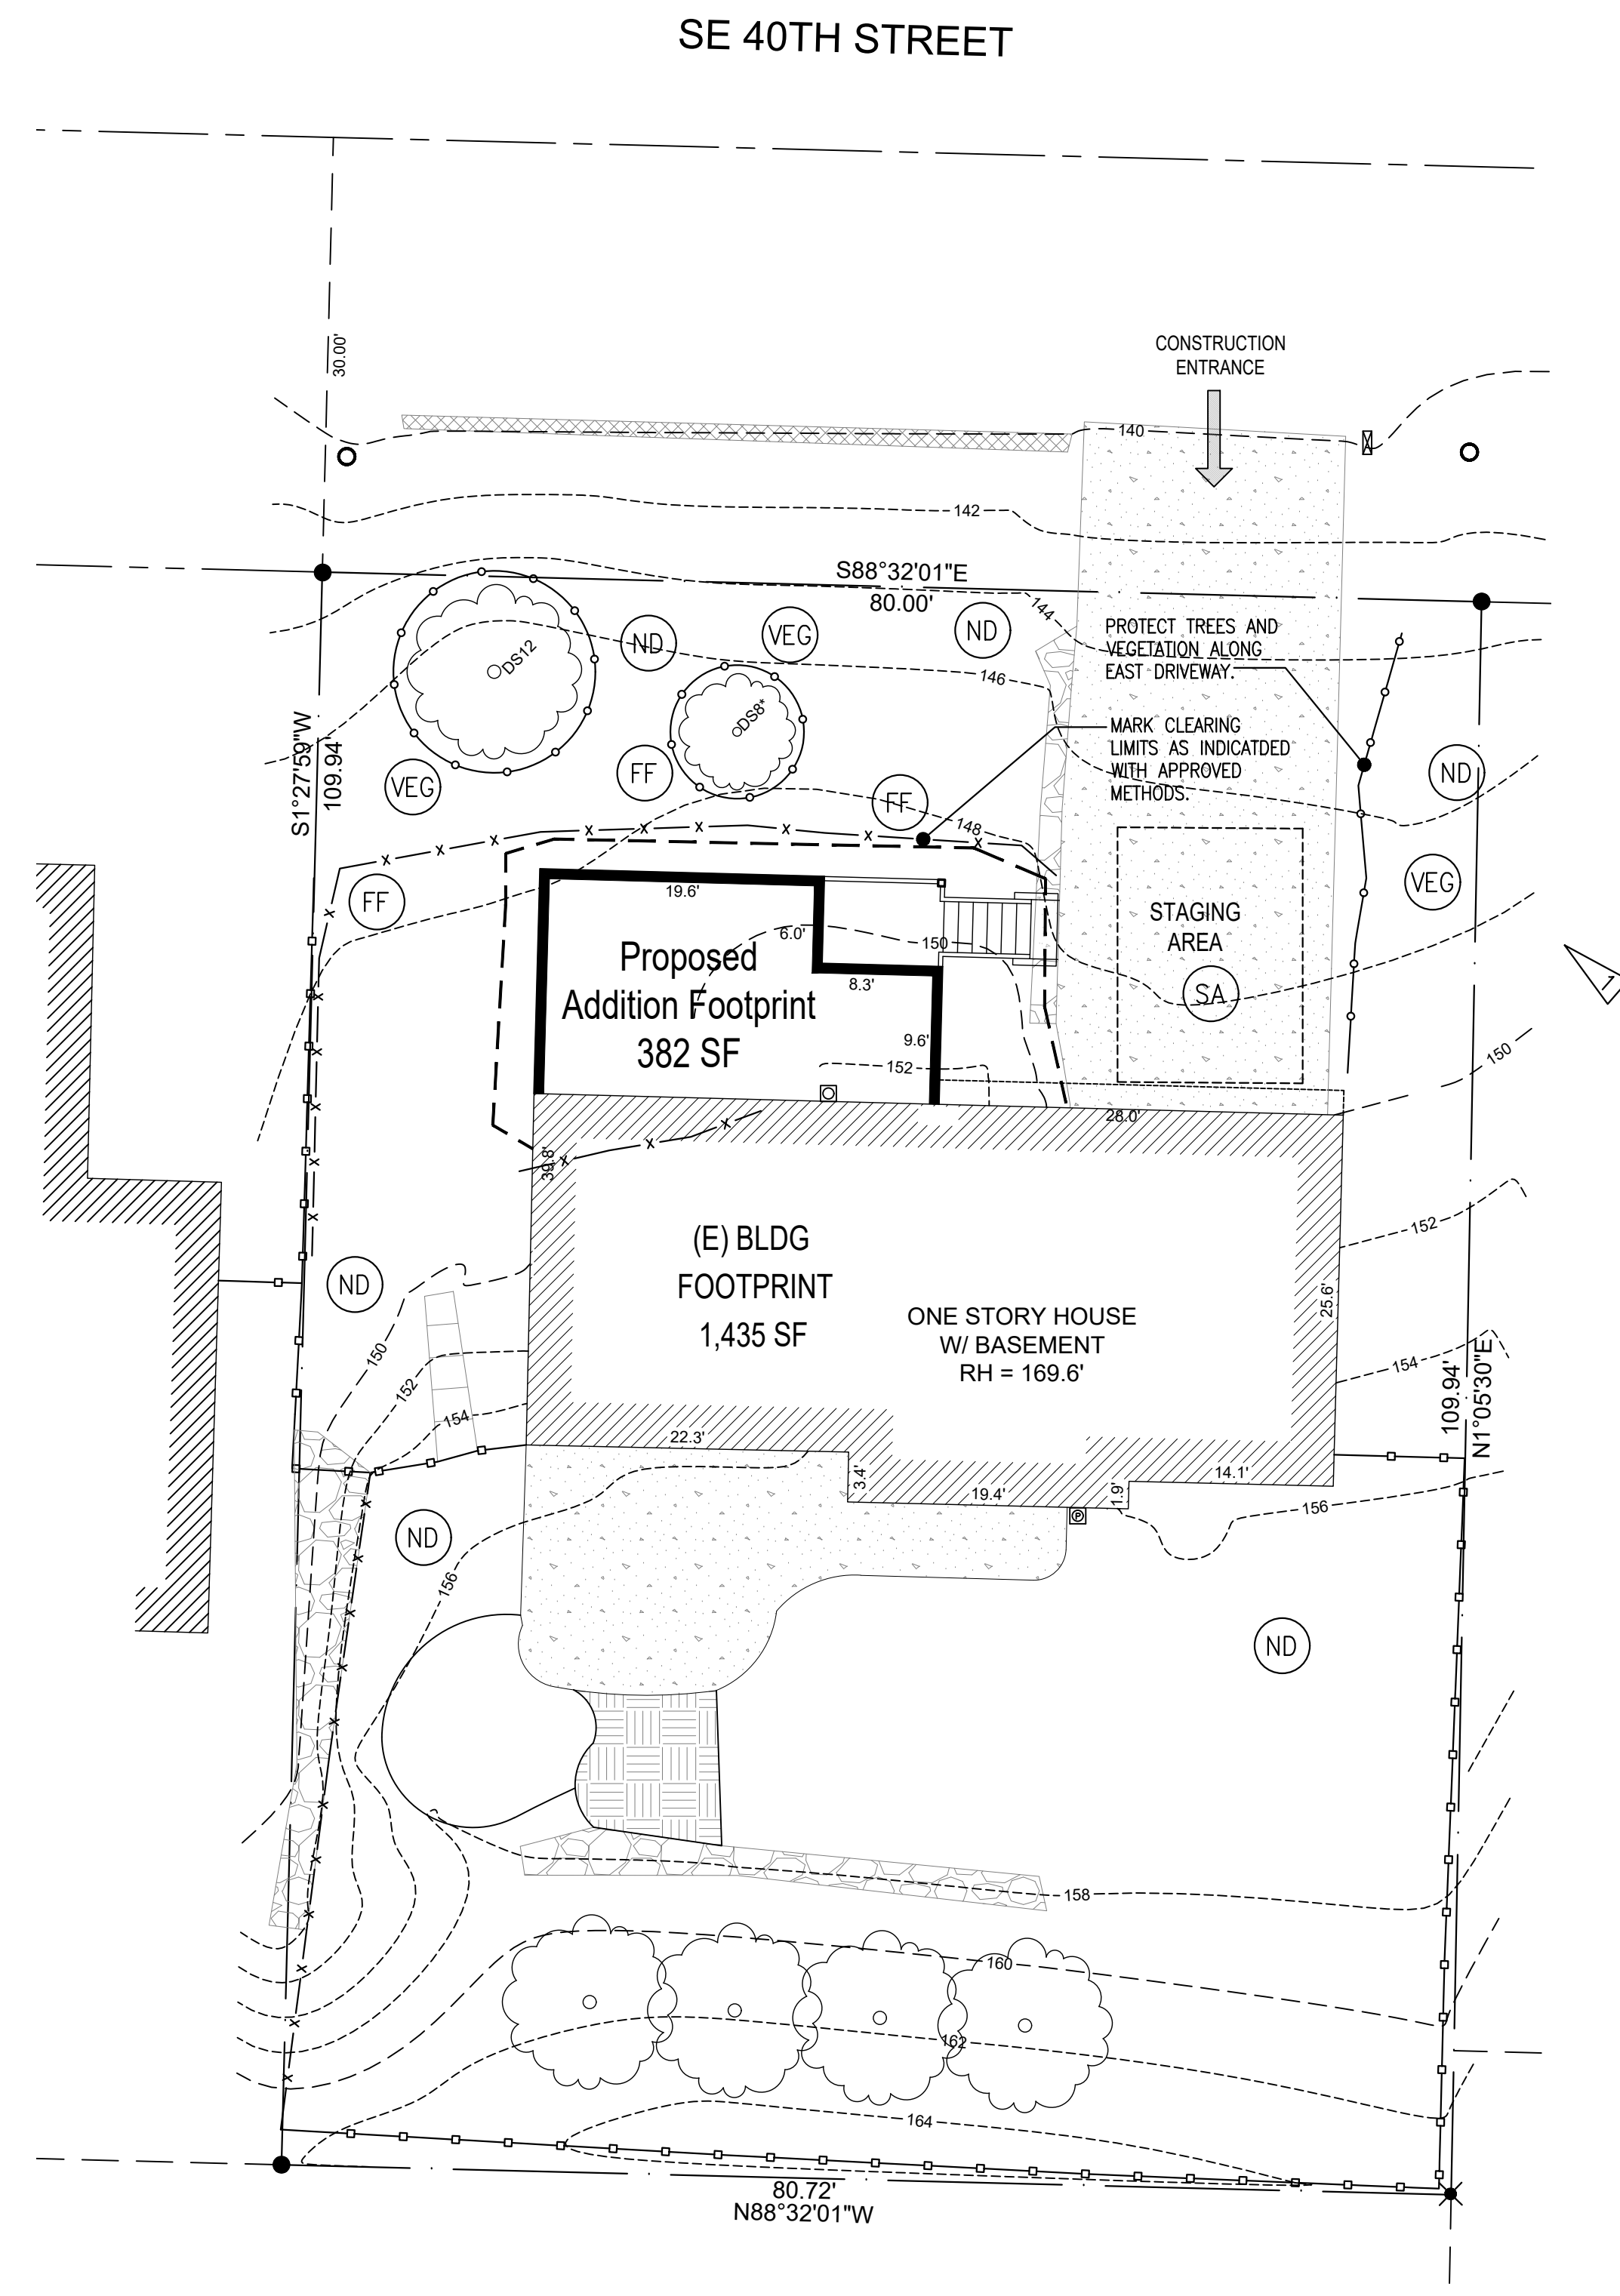

TEMPORARY EROSION & SEDIMENT CONTROL PLAN & POST CONSTRUCTION SOIL MANAGEMENT PLAN

NOTE: THIS PLAN IDENTIFIES THE MINIMUM MEASURES REQUIRED; ADDITIONAL MEASURES MAY BE REQUIRED BASED ON CONSTRUCTION METHODS AND ACTUAL AREA OF DISTURBANCE.

**Permit
Set**

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02

Project No.: 2105.00
Drawn:

ABBREVIATIONS:

ABV ABOVE	DTL DETAIL	GA GAUGE	O/ OVER	SHWR SHOWER
AFF ABOVE FINISH FLOOR	DW DISHWASHER	GB GYPSUM BOARD	OC ON CENTER	SIM SIMILAR
BLDG BUILDING	(E) EXISTING	GLB GLULAM BEAM	OG OBSCURE GLAZING	SPEC SPECIFICATIONS
BLKG BLOCKING	EA EACH	GSM GALVANIZED SHEET METAL	OH OVERHANG	SQ FT SQUARE FEET
BM BEAM	ELEV ELEVATION	HDR HEADER	PL PROPERTY LINE	SQ IN SQUARE INCHES
BOT BOTTOM	EQ EQUAL	HGR HANGER	PL PLATE	STD STANDARD
CIPC CAST-IN-PLACE CONCRETE	EXT EXTERIOR	h HIGH	PT POINT	SUBFLR SUBFLOOR
CL CENTERLINE	EW EACH WAY	HT HEIGHT	PTW PRESERVATIVE TREATED WOOD	T&G TONGUE & GROOVE
CLG CEILING	*EW EGRESS WINDOW	HVAC HEATING, VENTILATION, & AIR-CONDITIONING	REBAR REINFORCEMENT BAR	THK THICK
CLR CLEAR	FDN FOUNDATION	IG INSULATED GLASS	REFR REFRIGERATOR	TOPO TOPOGRAPHY
CMD CARBON MONOXIDE DETECTOR	FG FINISH GRADE	INT INTERIOR	REQD REQUIRED	TOW TOP OF WALL
CO CLEANOUT	FIN FINISH	LAV LAVATORY	REQTS REQUIREMENTS	TYP TYPICAL
CONC CONCRETE	FL FLUSH	LBS POUNDS	RAFT RAFTER	UNO UNLESS NOTED OTHERWISE
CONT CONTINUOUS	FLR FLOOR	LF LINEAR FEET	RO ROUGH OPENING	VTO VENT TO OUTSIDE
D DRYER	FOF FACE OF FINISH	LO LOW	R.O.W. RIGHT-OF-WAY	w WIDE
DBLE DOUBLE	FOS FACE OF STUD	MAX MAXIMUM	RFT RIP-TO-FIT	W WASHER
DEMO DEMOLISH	FRMG FRAMING	MFR MANUFACTURER	RTS RIP-TO-SLOPE	W/ WITH
DIA DIAMETER	FRZR FREEZER	MIN MINIMUM	RV RIM VENT	WC WATER CLOSET
DN DOWN	FT FOOT	(N) NEW	SC SOLID CORNER	WFC WOOD FRAME CONSTRUCTION
DP DEEP	FTG FOOTING	N/A NOT APPLICABLE	SD SMOKE DETECTOR	WH WATER HEATER
DP DIMENSION POINT	FV FIELD VERIFY	NIC NOT IN CONTRACT	SF SQUARE FOOT	WIC WALK-IN-CLOSET
DS DOWNSPOUT	FV FOUNDATION VENT		SG SAFETY GLAZING	WP WORK POINT
				WWF WELDED WIRE FABRIC

WHOLE HOUSE MECHANICAL VENTILATION (M1505.4):

M1505.4.1 SYSTEM DESIGN
 THE WHOLE-HOUSE VENTILATION SYSTEM SHALL CONSIST OF ONE OR MORE SUPPLY OR EXHAUST FANS, OR A COMBINATION OF SUCH, AND ASSOCIATED DUCTS AND CONTROLS. LOCAL EXHAUST OR SUPPLY FANS ARE PERMITTED TO SERVE AS SUCH A SYSTEM. OUTDOOR AIR DUCTS CONNECTED TO THE RETURN SIDE OF AN AIR HANDLER SHALL BE CONSIDERED TO PROVIDE SUPPLY VENTILATION.

M1505.4.2 SYSTEM CONTROLS
 THE WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM SHALL BE PROVIDED WITH CONTROLS THAT ENABLE MANUAL OVERRIDE.

M1505.4.3 MECHANICAL VENTILATION RATE
 THE WHOLEHOUSE MECHANICAL VENTILATION SYSTEM SHALL PROVIDE OUTDOOR AIR AT A CONTINUOUS RATE AS DETERMINED IN ACCORDANCE WITH TABLE M1505.4.3(1) OR EQUATION 15-1. VENTILATION RATE IN CUBIC FEET PER MINUTE = (0.01 x TOTAL SQUARE FOOT AREA OF HOUSE) + [7.5 x (NUMBER OF BEDROOMS + 1)]

EXCEPTION: THE WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM IS PERMITTED TO OPERATE INTERMITTENTLY WHERE THE SYSTEM HAS CONTROLS THAT ENABLE OPERATION FOR NOT LESS THAN 25 PERCENT OF EACH 4-HOUR SEGMENT AND THE VENTILATION RATE PRESCRIBED IN TABLE M1505.4.3(1) IS MULTIPLIED BY THE FACTOR DETERMINED IN ACCORDANCE WITH TABLE M1505.4.3(2).

M1505.4.4 LOCAL EXHAUST RATES
 LOCAL EXHAUST SYSTEM SHALL BE DESIGNED TO HAVE THE CAPACITY TO EXHAUST THE MINIMUM AIRFLOW RATE DETERMINED IN ACCORDANCE WITH TABLE M1505.4.4.

TABLE M1505.4.4
 MINIMUM REQUIRED LOCAL EXHAUST RATES FOR ONE- AND TWO-FAMILY DWELLINGS

AREA OF EXHAUST	EXHAUST RATES
KITCHEN	100 CFM INTERMITTENT OR 25 CFM CONTINUOUS
BATHROOM - TOILET ROOMS	50 CFM INTERMITTENT OR 20 CFM CONTINUOUS

For SI: 1 cubic foot per minute = 0.0004719 m³/s.

TABLE M1505.4.3(1)
 CONTINUOUS WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM AIRFLOW RATE REQUIREMENTS

DWELLING UNIT FLOOR AREA (SQUARE FEET)	NUMBER OF BEDROOMS				
	0-1	2-3	4-5	6-7	> 7
< 1,500	30	45	60	75	90
1,501-3,000	45	60	75	90	105
3,001-4,500	60	75	90	105	120
4,501-6,000	75	90	105	120	135
6,001-7,500	90	105	120	135	150
> 7,500	105	120	135	150	165

For SI: 1 square foot = 0.0929 m², 1 cubic foot per minute = 0.0004719 m³/s.

TABLE M1505.4.3(2)
 INTERMITTENT WHOLE-HOUSE MECHANICAL VENTILATION RATE FACTORS^{a, b}

RUN-TIME PERCENTAGE IN EACH 4-HOUR SEGMENT	25%	33%	50%	66%	75%	100%
FACTOR ^a	4	3	2	1.5	1.3	1.0

- a. For ventilation system run time values between those given, the factors are permitted to be determined by interpolation.
- b. Extrapolation beyond the table is prohibited.

ENERGY CODE COMPLIANCE NOTES:

2018 WASHINGTON STATE ENERGY CODE CHAPTER 4
 PRESCRIPTIVE COMPONENT TABLE R402.1.1 - ZONE 4C

LOCATION	INSULATION REQUIREMENTS
FENESTRATION (UNLIMITED)	U=0.30 OR BETTER
SKYLIGHT (UNLIMITED)	U=0.50 OR BETTER
GLAZING FENESTRATION SHGC	NR
CEILING	R-49
CEILING VAULTED	R-38
WOOD FRAME WALL	R-21 INT
MASS WALL	R-21
FLOOR	R-30
BELOW-GRADE WALL	R-10/15/21 INT-TB
SLAB	R-10, 2 FT.
WINDOW & DOOR HEADERS	R-10 MIN

NOTE:
 1) R-10 CONTINUOUS INSULATION IS REQUIRED UNDER HEATED SLAB ON GRADE FLOORS. SEE SECTION R402.2.9.1.
 2) R7.5 CONTINUOUS INSULATION INSTALLED OVER AN EXISTING SLAB IS DEEMED TO BE EQUIVALENT TO THE REQUIRED PERIMETER SLAB INSULATION WHEN APPLIED TO EXISTING SLABS COMPLYING WITH SECTION R503.1.1.

ENERGY CREDITS CODE COMPLIANCE NOTES:

2018 WASHINGTON STATE ENERGY CODE CHAPTER 4
 ADDITIONAL ENERGY EFFICIENCY REQUIREMENT PER SECTION R406.2


PROJECT TO MEET "SMALL DWELLING UNIT" REQUIREMENTS OF **3.0 CREDITS**

FROM TABLE 406.2 ENERGY CREDITS:


OPTION 4: DHP WITH ZONAL ELECTRIC RESISTANCE PER OPTION 3.4 **0.5 CREDITS**

OPTION 3.4: HIGH EFFICIENCY HVAC **1.5 CREDITS**
 DUCTLESS MINI-SPLIT HEAT PUMP SYSTEM, ZONAL CONTROL: IN HOMES WHERE THE PRIMARY SPACE HEATING SYSTEM IS ZONAL ELECTRIC HEATING, A DUCTLESS MINI-SPLIT HEAT PUMP SYSTEM WITH A MINIMUM HSPF OF 10.0 SHALL BE INSTALLED AND PROVIDE HEATING TO THE LARGEST ZONE OF THE HOUSING UNIT.

OPTION 5.1: EFFICIENT WATER HEATING **1.0 CREDITS**
 WATER HEATING SYSTEM SHALL BE ENERGY STAR RATED GAS OR PROPANE HEATER WITH MINIMUM UEF OF 0.91

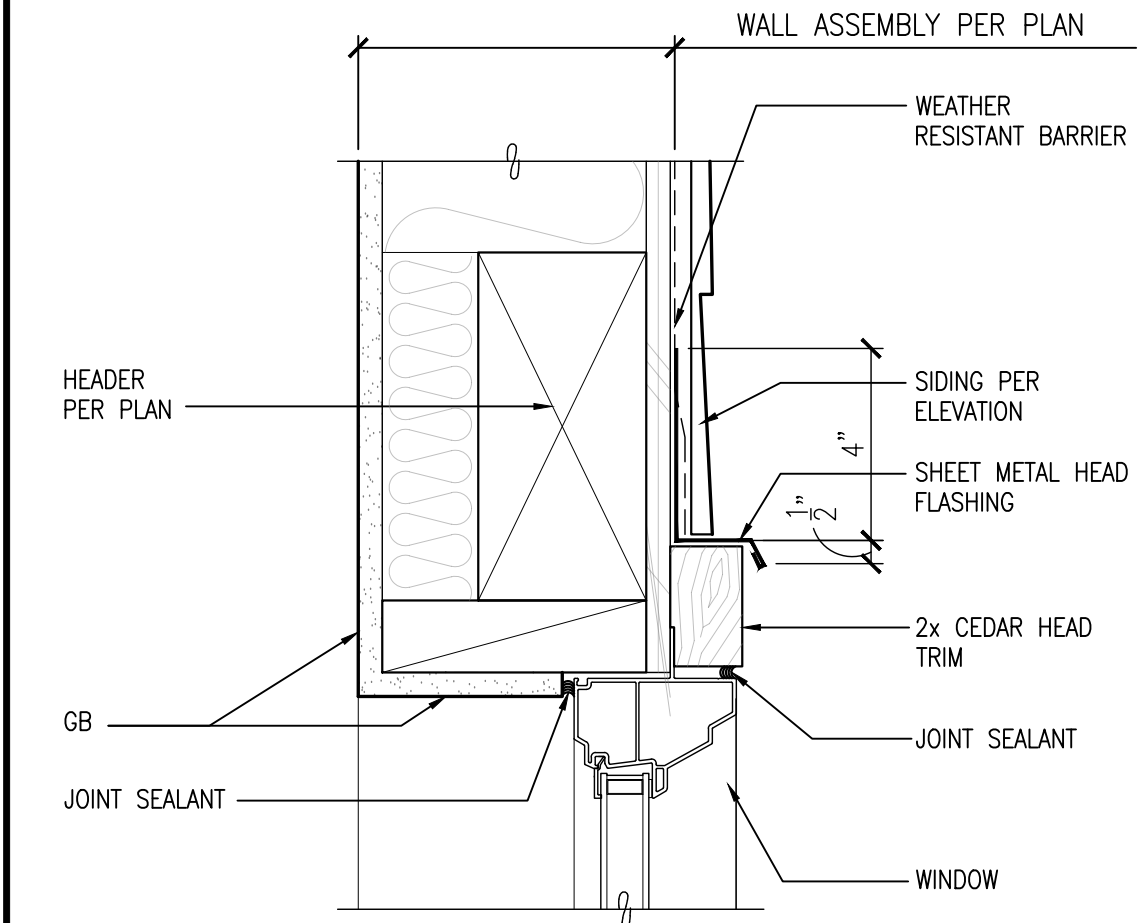


4 HEAD DETAIL
 SCALE: 3"=1'-0"

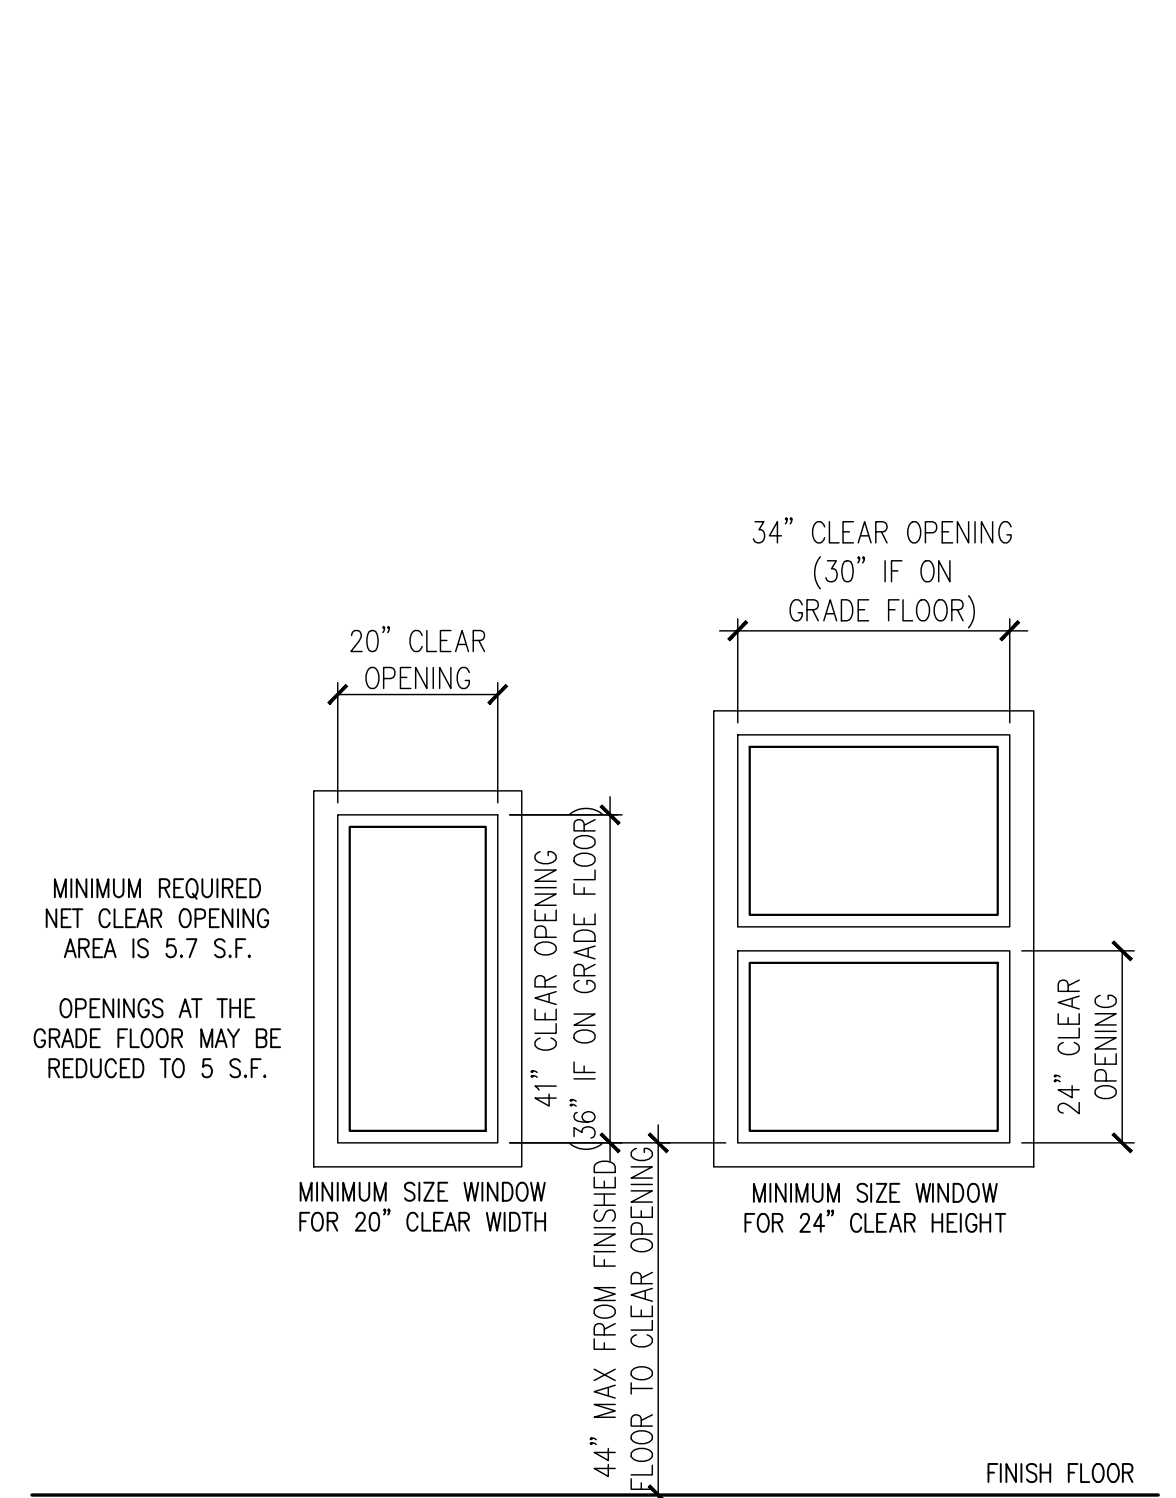


BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM SHALL NOT HAVE LESS THAN ONE OPERABLE EMERGENCY ESCAPE AND RESCUE OPENING. WHERE BASEMENTS CONTAIN ONE OR MORE SLEEPING ROOMS, AN EMERGENCY ESCAPE AND RESCUE OPENING SHALL BE REQUIRED IN EACH SLEEPING ROOM. EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL OPEN DIRECTLY INTO A PUBLIC WAY, OR TO A COURT OR YARD THAT OPENS TO A PUBLIC WAY.

A MINIMUM RESIDENTIAL EGRESS OPENING REQUIREMENTS
 SCALE: 1/2"=1'-0"

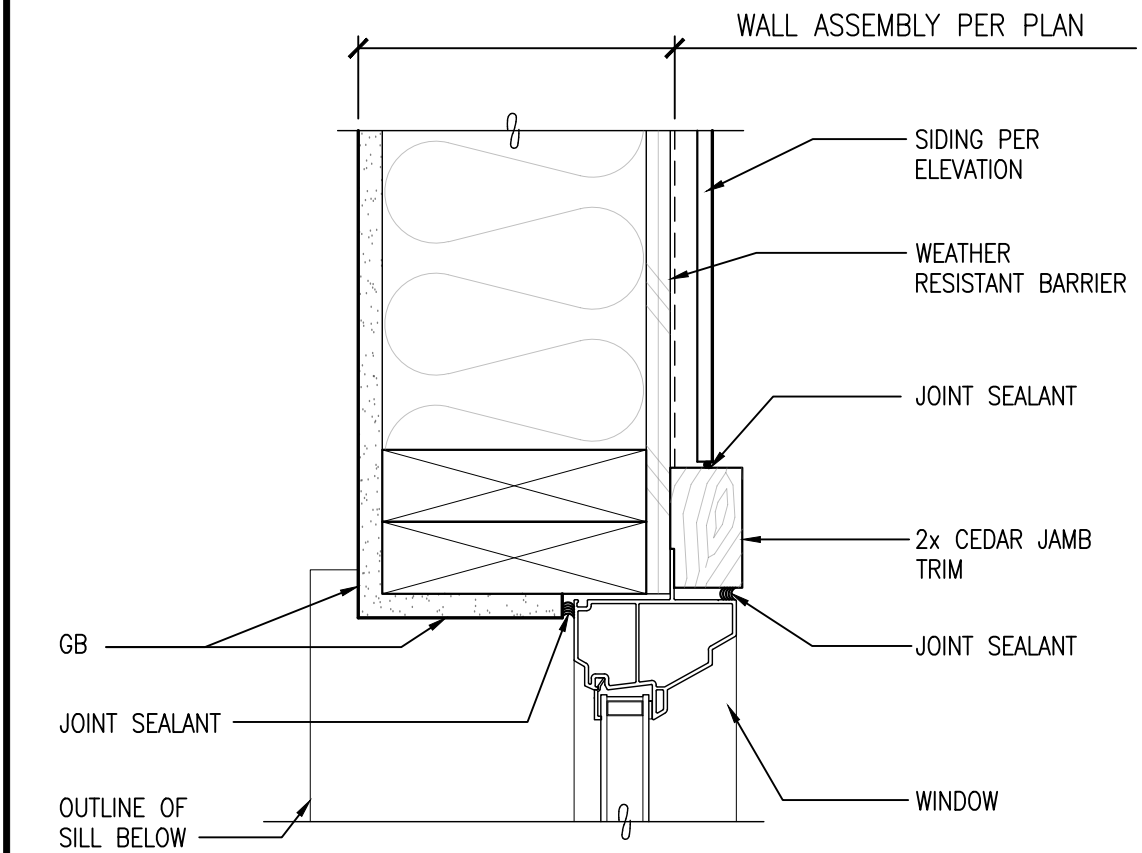

3 JAMB DETAIL
 SCALE: 3"=1'-0"

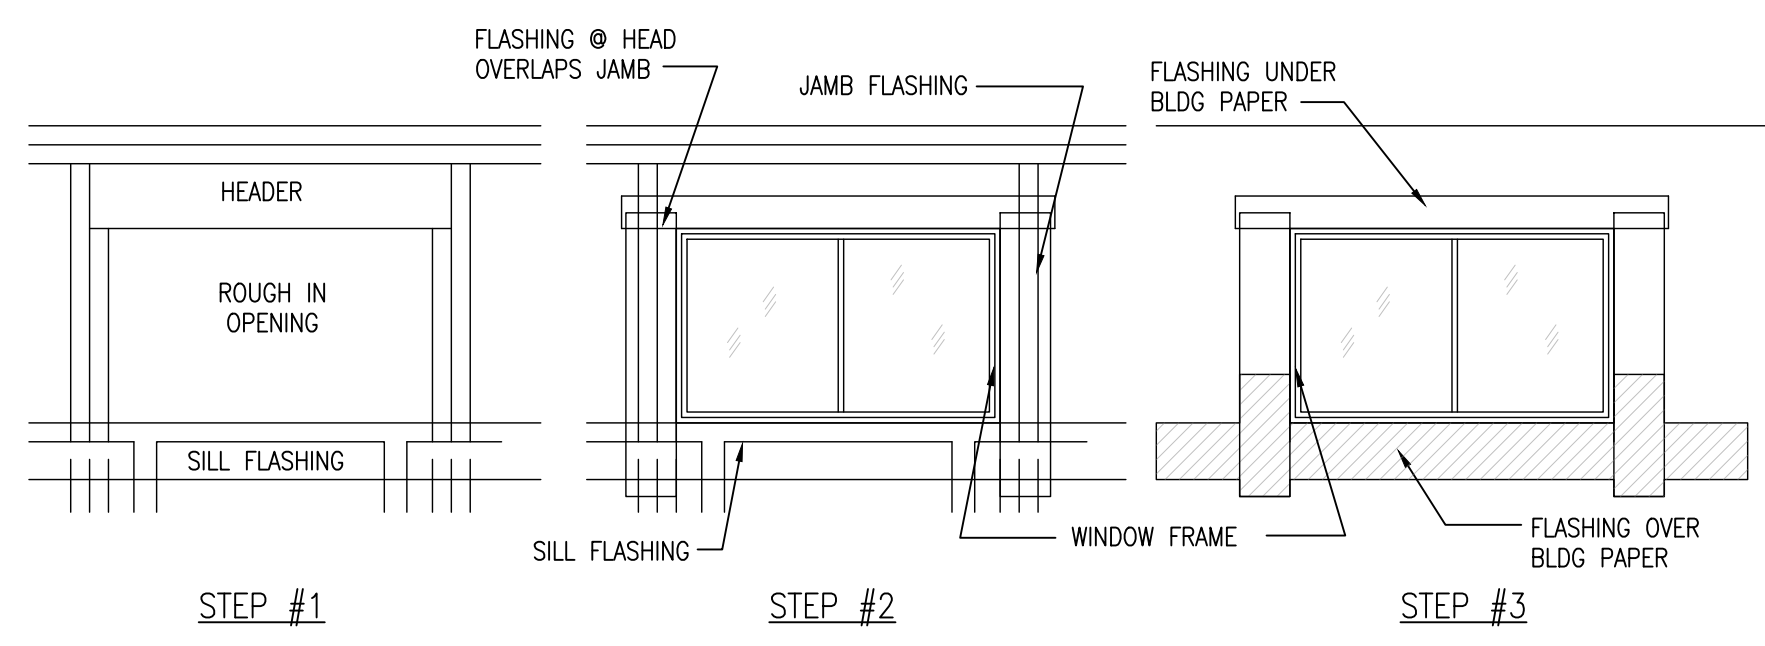

FLASHING OF EXTERIOR WALL OPENINGS:

INDIVIDUALLY FLASH ALL EXTERIOR OPENINGS FOR FIXTURE SUCH AS WINDOWS, DOORS, AND VENTS TO MAKE THEM WATERPROOF. FLASHING MATERIAL SHALL BE MOISTOP BY MANUF. SEALANT SHALL BE COMPATIBLE AND APPROVED BY MANUF. IN HIGH WIND AREAS W.R. GRACE ICE & WATER SHIELD SHALL BE USED, OVER SOLID BACKING. FLASHING MATERIAL AT LEAST 9" WIDE SHALL BE APPLIED IN A WEATHER BOARD FASHION, BEGINNING WITH THE SILL WITH A STRIP LONG ENOUGH TO PROJECT BEYOND THE JAMB FLASHING TO BE APPLIED. THE TWO JAMB FLASHING ARE THEN APPLIED WITH SUFFICIENT LENGTH TO EXTEND BEYOND THE SILL FLASHING, AND WITH THE SAME DISTANCE AT THE TOP.


FOR FIXTURES WITHOUT NAIL-ON FLANGES, THE FLASHING SHALL BE 12" MIN. WIDTH AND EXTEND INTO THE ROUGH FRAME AT THE SILL AND JAMB.

FOR NAIL-ON FLANGE FIXTURE, INSTALL BY PRESSING FLANGE POSITIVELY INTO A CONTINUOUS BEAD OF SEALANT WHICH EXTENDS AROUND THE BOTTOM AND SIDES OF THE FIXTURE.

APPLY THE TOP HORIZONTAL FLASHING LAST, WITH SUFFICIENT LENGTH TO EXTEND BEYOND THE JAMB FLASHING. OVERLAP AND SEAL AGAINST THE TOP NAILING FLANGE OR G.S.M. HEAD FLASHING WITH A CONTINUOUS BEAD OF SEALANT.

APPLY REMAINING WALL SHEATHING PAPER IN A WEATHERBOARD FASHION WITH THE SILL FLASHING LAPPING OVER THE TOP AND THE HEAD AND JAMB FLASHING BELOW.

1 TYPICAL WINDOW OPENING FLASHING REQUIREMENTS
 SCALE: NTS

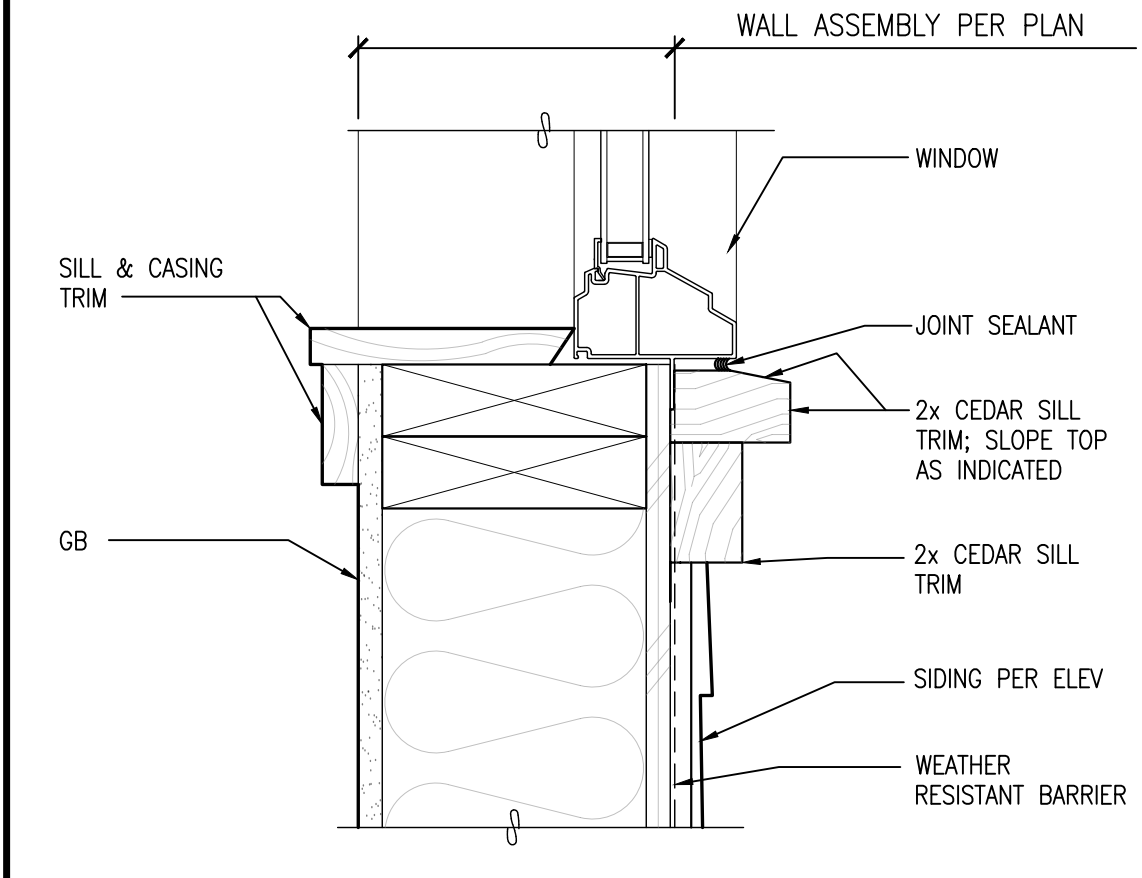

2 SILL DETAIL
 SCALE: 3"=1'-0"

DOOR SCHEDULE (MFR & MODEL OR EQUAL)

IDEN	TYPE	DOOR SIZE		ROUGH OPENING		MATERIAL	QUANTITY	TOTAL AREA	U-FACTOR (MIN OR BETTER NFRC-CERTIFIED)	MFR	NOTES
		WIDTH	HEIGHT	WIDTH	HEIGHT						
D01	PAIRED PANEL	5'-6"	6'-8"	5'-8"	6'-10"	FIBERGLASS WOODCLAD	1	36.7 SF	0.30	TBD	FULL LITE; SAFETY GLAZING
D02	PAIRED PANEL	5'-0"	6'-8"	5'-2"	6'-10"	WOOD	1	-	-	TBD	
D03	PAIRED BI-FOLD	5'-0"	6'-8"	5'-1"	6'-10"	WOOD	1	-	-	TBD	
D04	BI-FOLD	3'-0"	6'-8"	3'-1"	6'-10"	WOOD	1	-	-	TBD	

NOTES:
 (1) SPECIFICATION: (A)

WINDOW SCHEDULE (MFR & MODEL OR EQUAL)

IDEN	TYPE	MATERIAL	SIZE		ROUGH OPENING		QUANTITY	TOTAL AREA	SPEC	DESCRIPTION
			WIDTH	HEIGHT	WIDTH	HEIGHT				
W01	COMBO	VINYL	2'-6"	VARIABLES	2'-6"	VARIABLES	1	19.23 SF	(A)	REFER TO ELEVATION ON SHEET A6.0 - CASEMENT/FIXED (SAFETY GLAZING)
W02	COMBO	VINYL	4'-0"	VARIABLES	4'-0"	VARIABLES	1	33.42 SF	(A)	REFER TO ELEVATION ON SHEET A6.0 - FIXED/FIXED (SAFETY GLAZING)
W03	COMBO	VINYL	4'-0"	VARIABLES	4'-0"	VARIABLES	1	33.42 SF	(A)	REFER TO ELEVATION ON SHEET A6.0 - FIXED/FIXED (SAFETY GLAZING)
W04	COMBO	VINYL	2'-6"	VARIABLES	2'-6"	VARIABLES	1	19.23 SF	(A)	REFER TO ELEVATION ON SHEET A6.0 - CASEMENT/FIXED (SAFETY GLAZING)
W05	CASEMENT	VINYL	2'-6"	5'-0"	2'-6"	5'-0"	1	12.50 SF	(A)	
W06	FIXED	VINYL	6'-0"	8'-5.5"	6'-0"	8'-5.5"	1	42.29 SF	(A)	
W07	CASEMENT	VINYL	2'-6"	5'-0"	2'-6"	5'-0"	1	12.50 SF	(A)	
W08	FIXED	VINYL	5'-6"	2'-0"	5'-6"	2'-0"	1	11.00 SF	(A)	
W09	FIXED	VINYL	3'-0"	5'-8"	3'-0"	5'-8"	1	17.00 SF	(A)	(SAFETY GLAZING)
W10	FIXED	VINYL	3'-0"	6'-6"	3'-0"	6'-6"	1	19.50 SF	(A)	

TOTAL QUANTITY: 10
 TOTAL AREA (SQUARE FEET): 220.09 SF

NOTES:
 (1) SPECIFICATION: (A)
 (A) ALL GLAZING TO HAVE U-FACTOR = 0.30 MAX OR BETTER; NFRC-CERTIFIED (ENERGY CREDIT OPTION 1.3)


Permit Set

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02


Project No.: 2105.00
 Drawn:

DEMOLITION NOTES:

- DAMAGE TO EXISTING MATERIALS & FINISHES NOT SCHEDULED FOR DEMOLITION SHALL BE RESTORED TO ORIGINAL CONDITION AT CONTRACTOR'S EXPENSE. ALL MATERIALS TO MATCH EXISTING IN COLOR, FINISH & QUALITY.
- REMOVE ALL HANGERS, NAILS, WALL ANCHORS, TAPE, & FASTENERS FROM WALLS. PATCH & PAINT REMAINING WALLS WHERE CASEWORK, SHELVING, COATHOOKS, WALLS, WALL ANCHORS, TRIM, ETC. ARE REMOVED. CLEAN ALL WALLS THROUGHOUT AREA OF WORK PRIOR TO PAINTING.
- PATCH REMAINING WALLS WHERE BASE REMOVED AS REQUIRED FOR INSTALLATION OF NEW BASE.

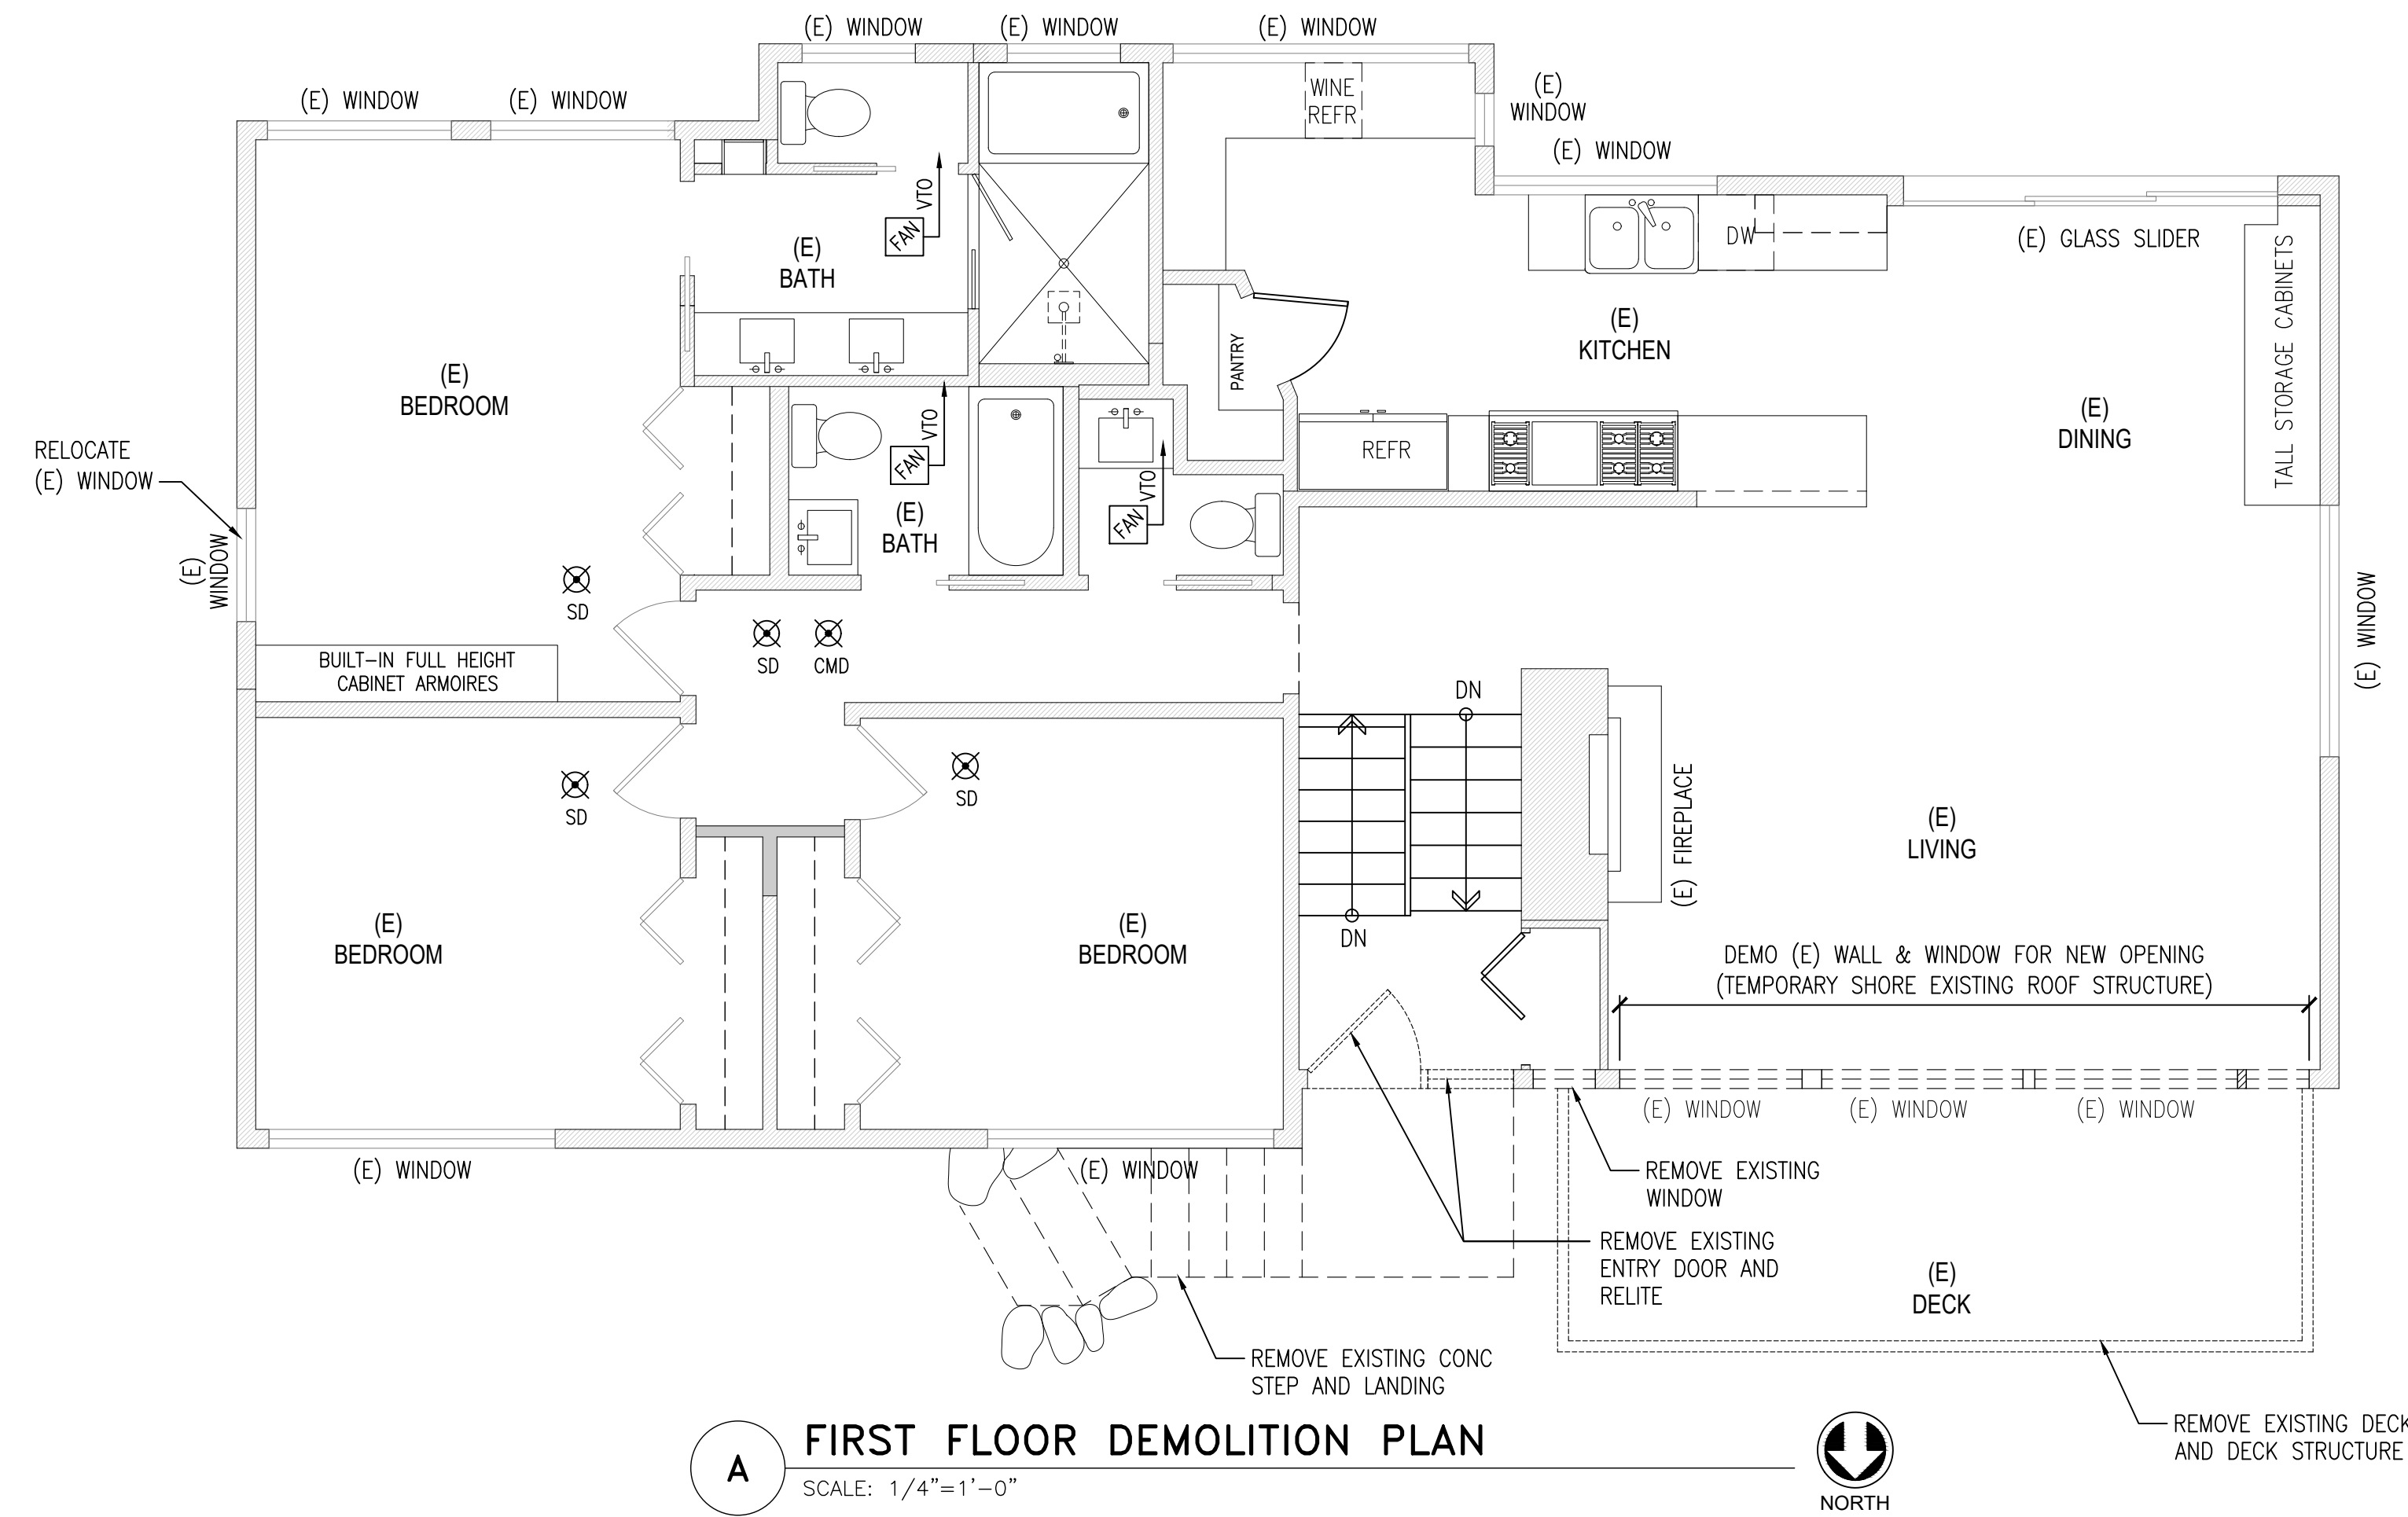

A FIRST FLOOR DEMOLITION PLAN
SCALE: 1/4"=1'-0"
NORTH

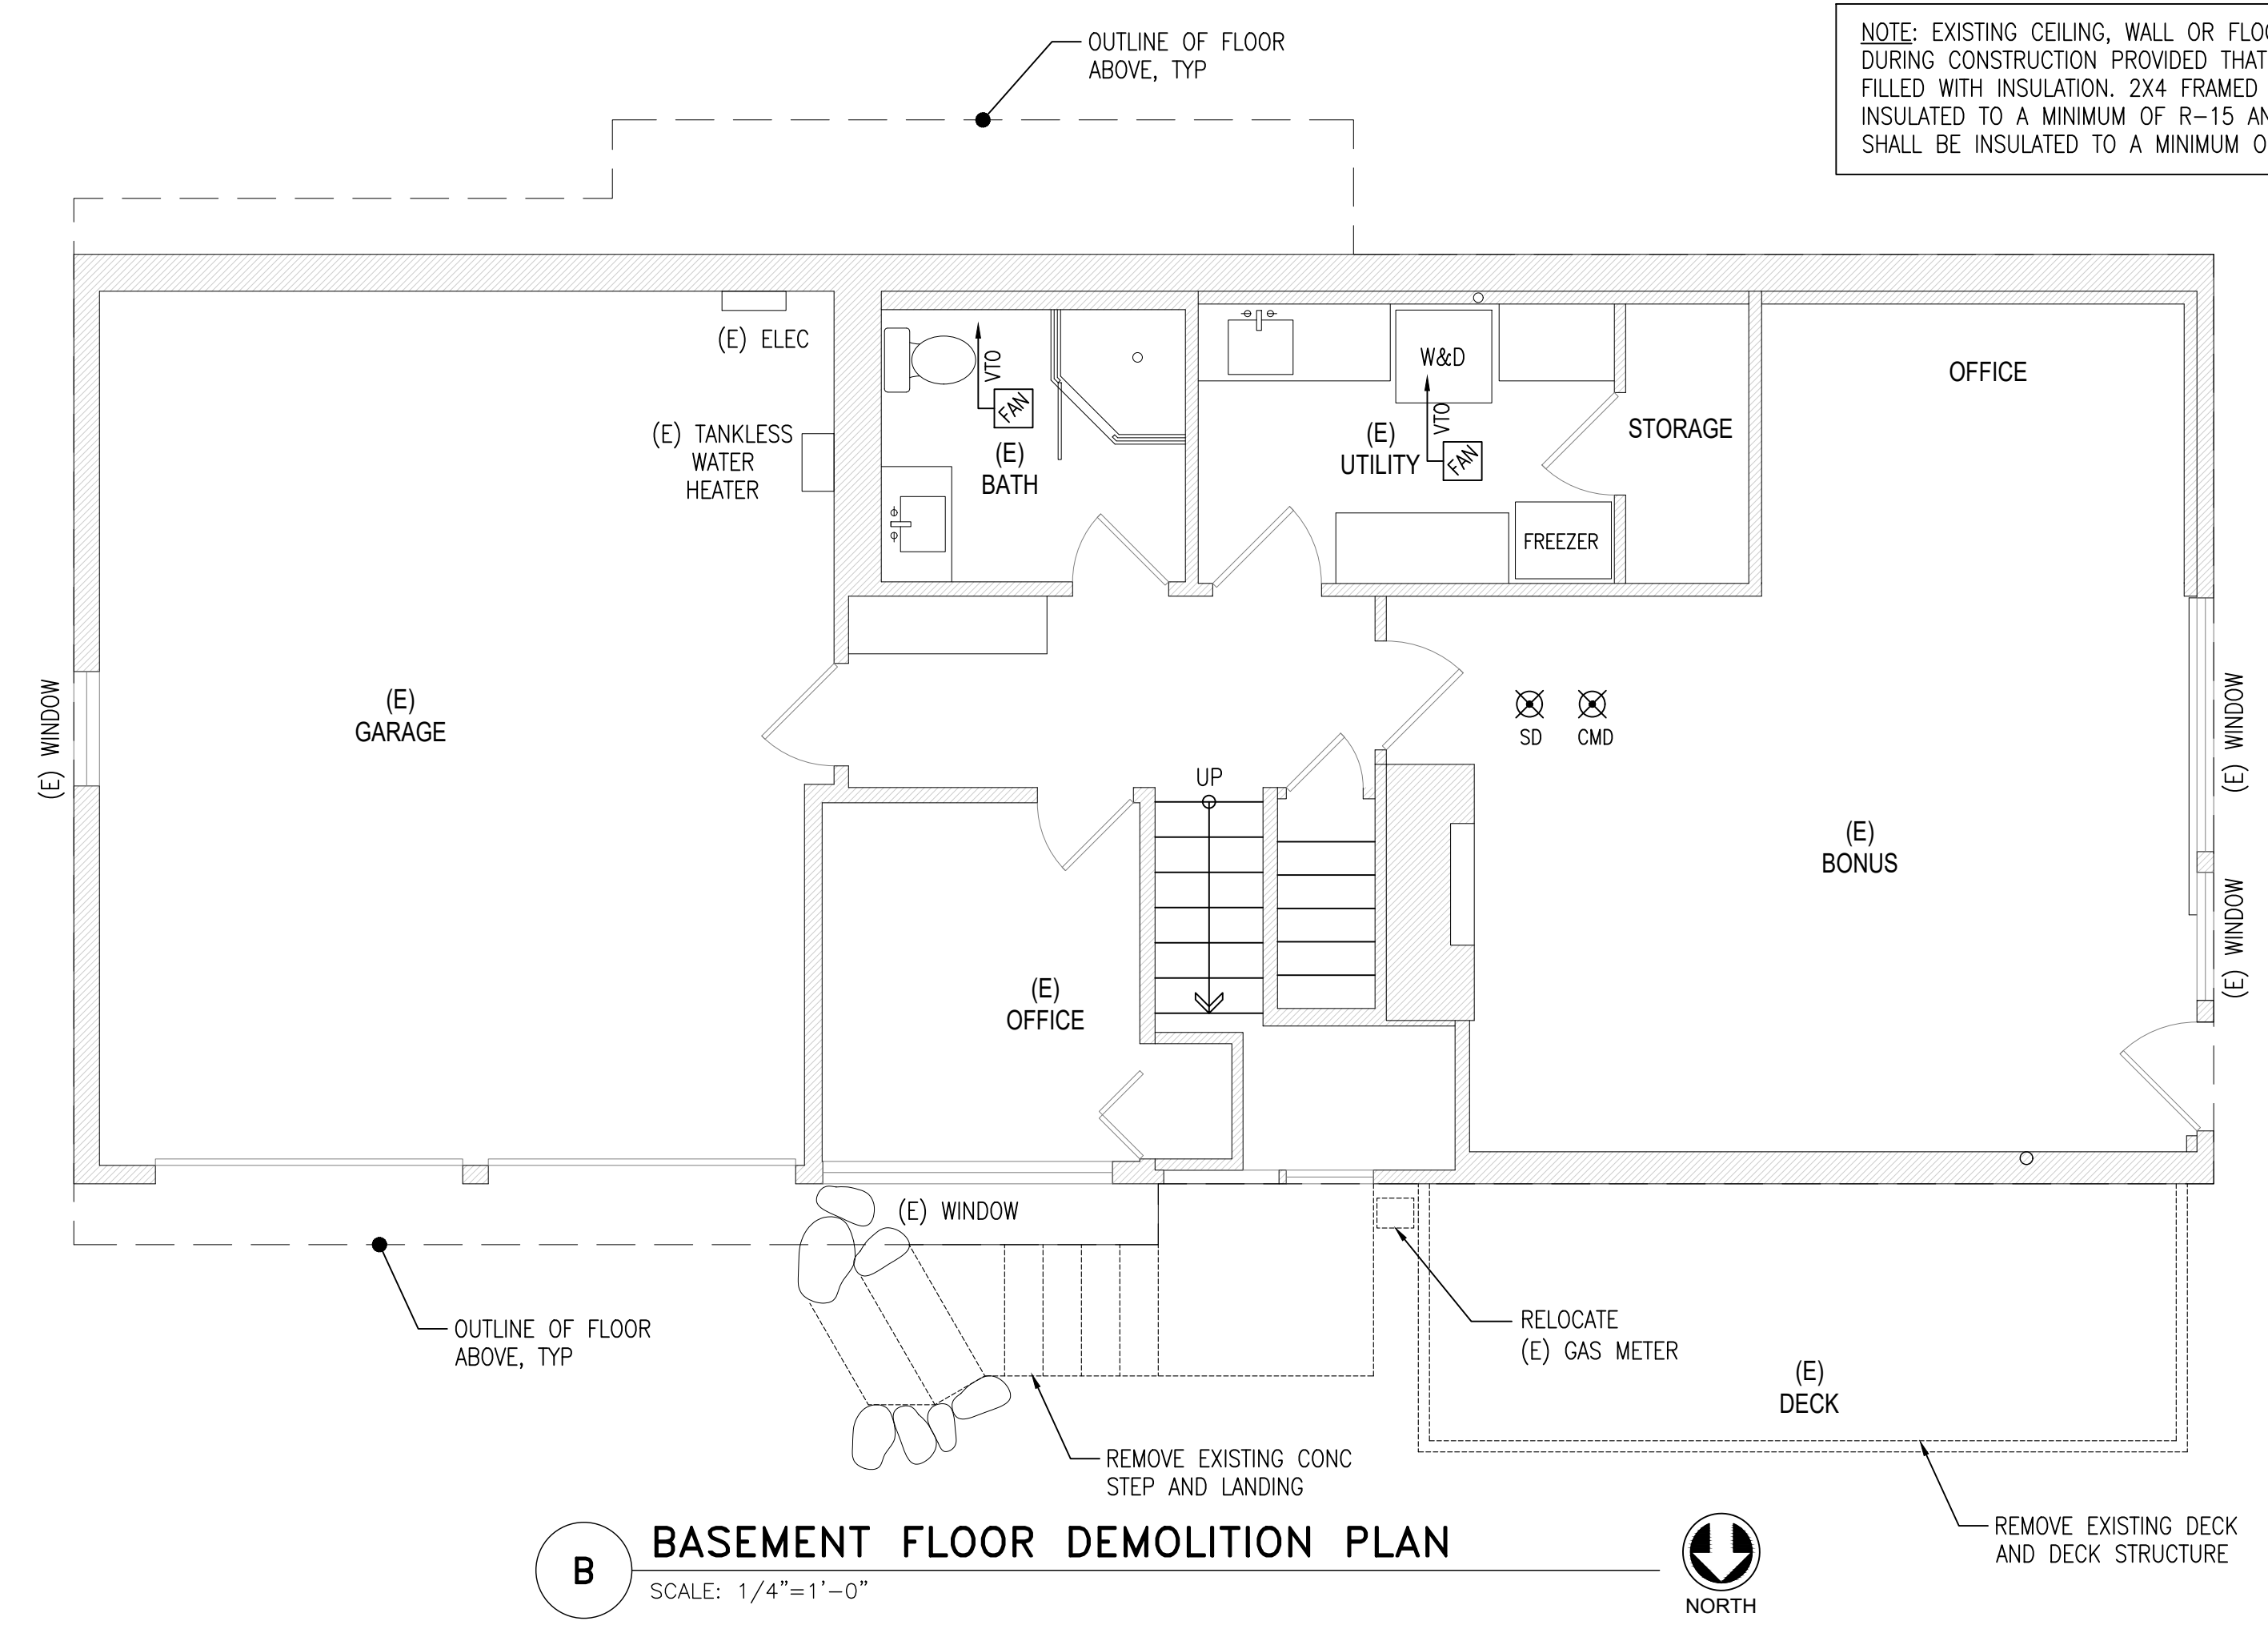

B BASEMENT FLOOR DEMOLITION PLAN
SCALE: 1/4"=1'-0"
NORTH

NOTE: EXISTING CEILING, WALL OR FLOOR CAVITIES EXPOSED DURING CONSTRUCTION PROVIDED THAT THESE CAVITIES ARE FILLED WITH INSULATION. 2X4 FRAMED WALLS SHALL BE INSULATED TO A MINIMUM OF R-15 AND 2X6 FRAMED WALLS SHALL BE INSULATED TO A MINIMUM OF R-21.

Sterba Mironova Residence Addition

9811 SE 40th St
Mercer Island, WA 98040

Permit Set

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02

Project No.: 2105.00
Drawn:

DEMOLITION PLAN

Sheet No:

A2.0

FLOOR PLAN NOTES:

MATERIALS

- A. ALL EXTERIOR WALLS TO BE 2x6 STUDS @ 16" OC.
- B. ALL INTERIOR WALLS TO BE 2x4 STUDS @ 16" OC.
- C. ALL FRAMING HARDWARE TO BE "SIMPSON" OR EQUAL.
- D. WALL SHEATHING TO BE 1/2" PLYWOOD WITH SPAN RATING OF 24/16.
- E. ALL HDR PER STRUCTURAL.

REQUIREMENTS

- 1. PROVIDE FIREBLOCKING PER SECTION R602.8.
- 2. INTERCONNECT SMOKE ALARMS AND PROVIDE PRIMARY & BACKUP POWER PER SECTION R313.

LEGEND

(E) WALL TO REMAIN

NEW 2x WOOD FRAME CONSTRUCTION

SMOKE DETECTOR (IRC - SECTION R314)

CARBON MONOXIDE DETECTOR (IRC - SECTION R315)

EXHAUST FANS: MIN. 50 CFM FOR BATHROOM AND LAUNDRY; MIN. 100 CFM FOR KITCHEN, WITH DIRECT VENT TO EXTERIOR


FOUNDATION PLAN NOTES:

MATERIALS



- A. LUMBER IN CONTACT WITH CONCRETE TO BE PRESERVATIVE TREATED WOOD.
- B. ALL FRAMING HARDWARE TO BE "SIMPSON" OR EQUAL.

REQUIREMENTS


- 1. ALL FOOTINGS TO BEAR ON UNDISTURBED SOIL.
- 2. REROUTE & EXTEND EXISTING STORMWATER TIGHTLINE SYSTEM AS NECESSARY TO ACCOMMODATE NEW AND ABANDONED DOWNSPOUTS.
- 3. PROVIDE FOUNDATION DRAINAGE SYSTEM ALONG EXTERIOR PERIMETER OF ALL FOUNDATION WALLS ENCLOSING THE NEW SPACE. INTEGRATE WITH AND ADJUST EXISTING FOUNDATION DRAINAGE SYSTEM AS APPLICABLE. CONNECT TO STORM WATER TIGHTLINE SYSTEM DOWNSTREAM FROM TIGHTLINE SERVING DOWNSPOUTS.

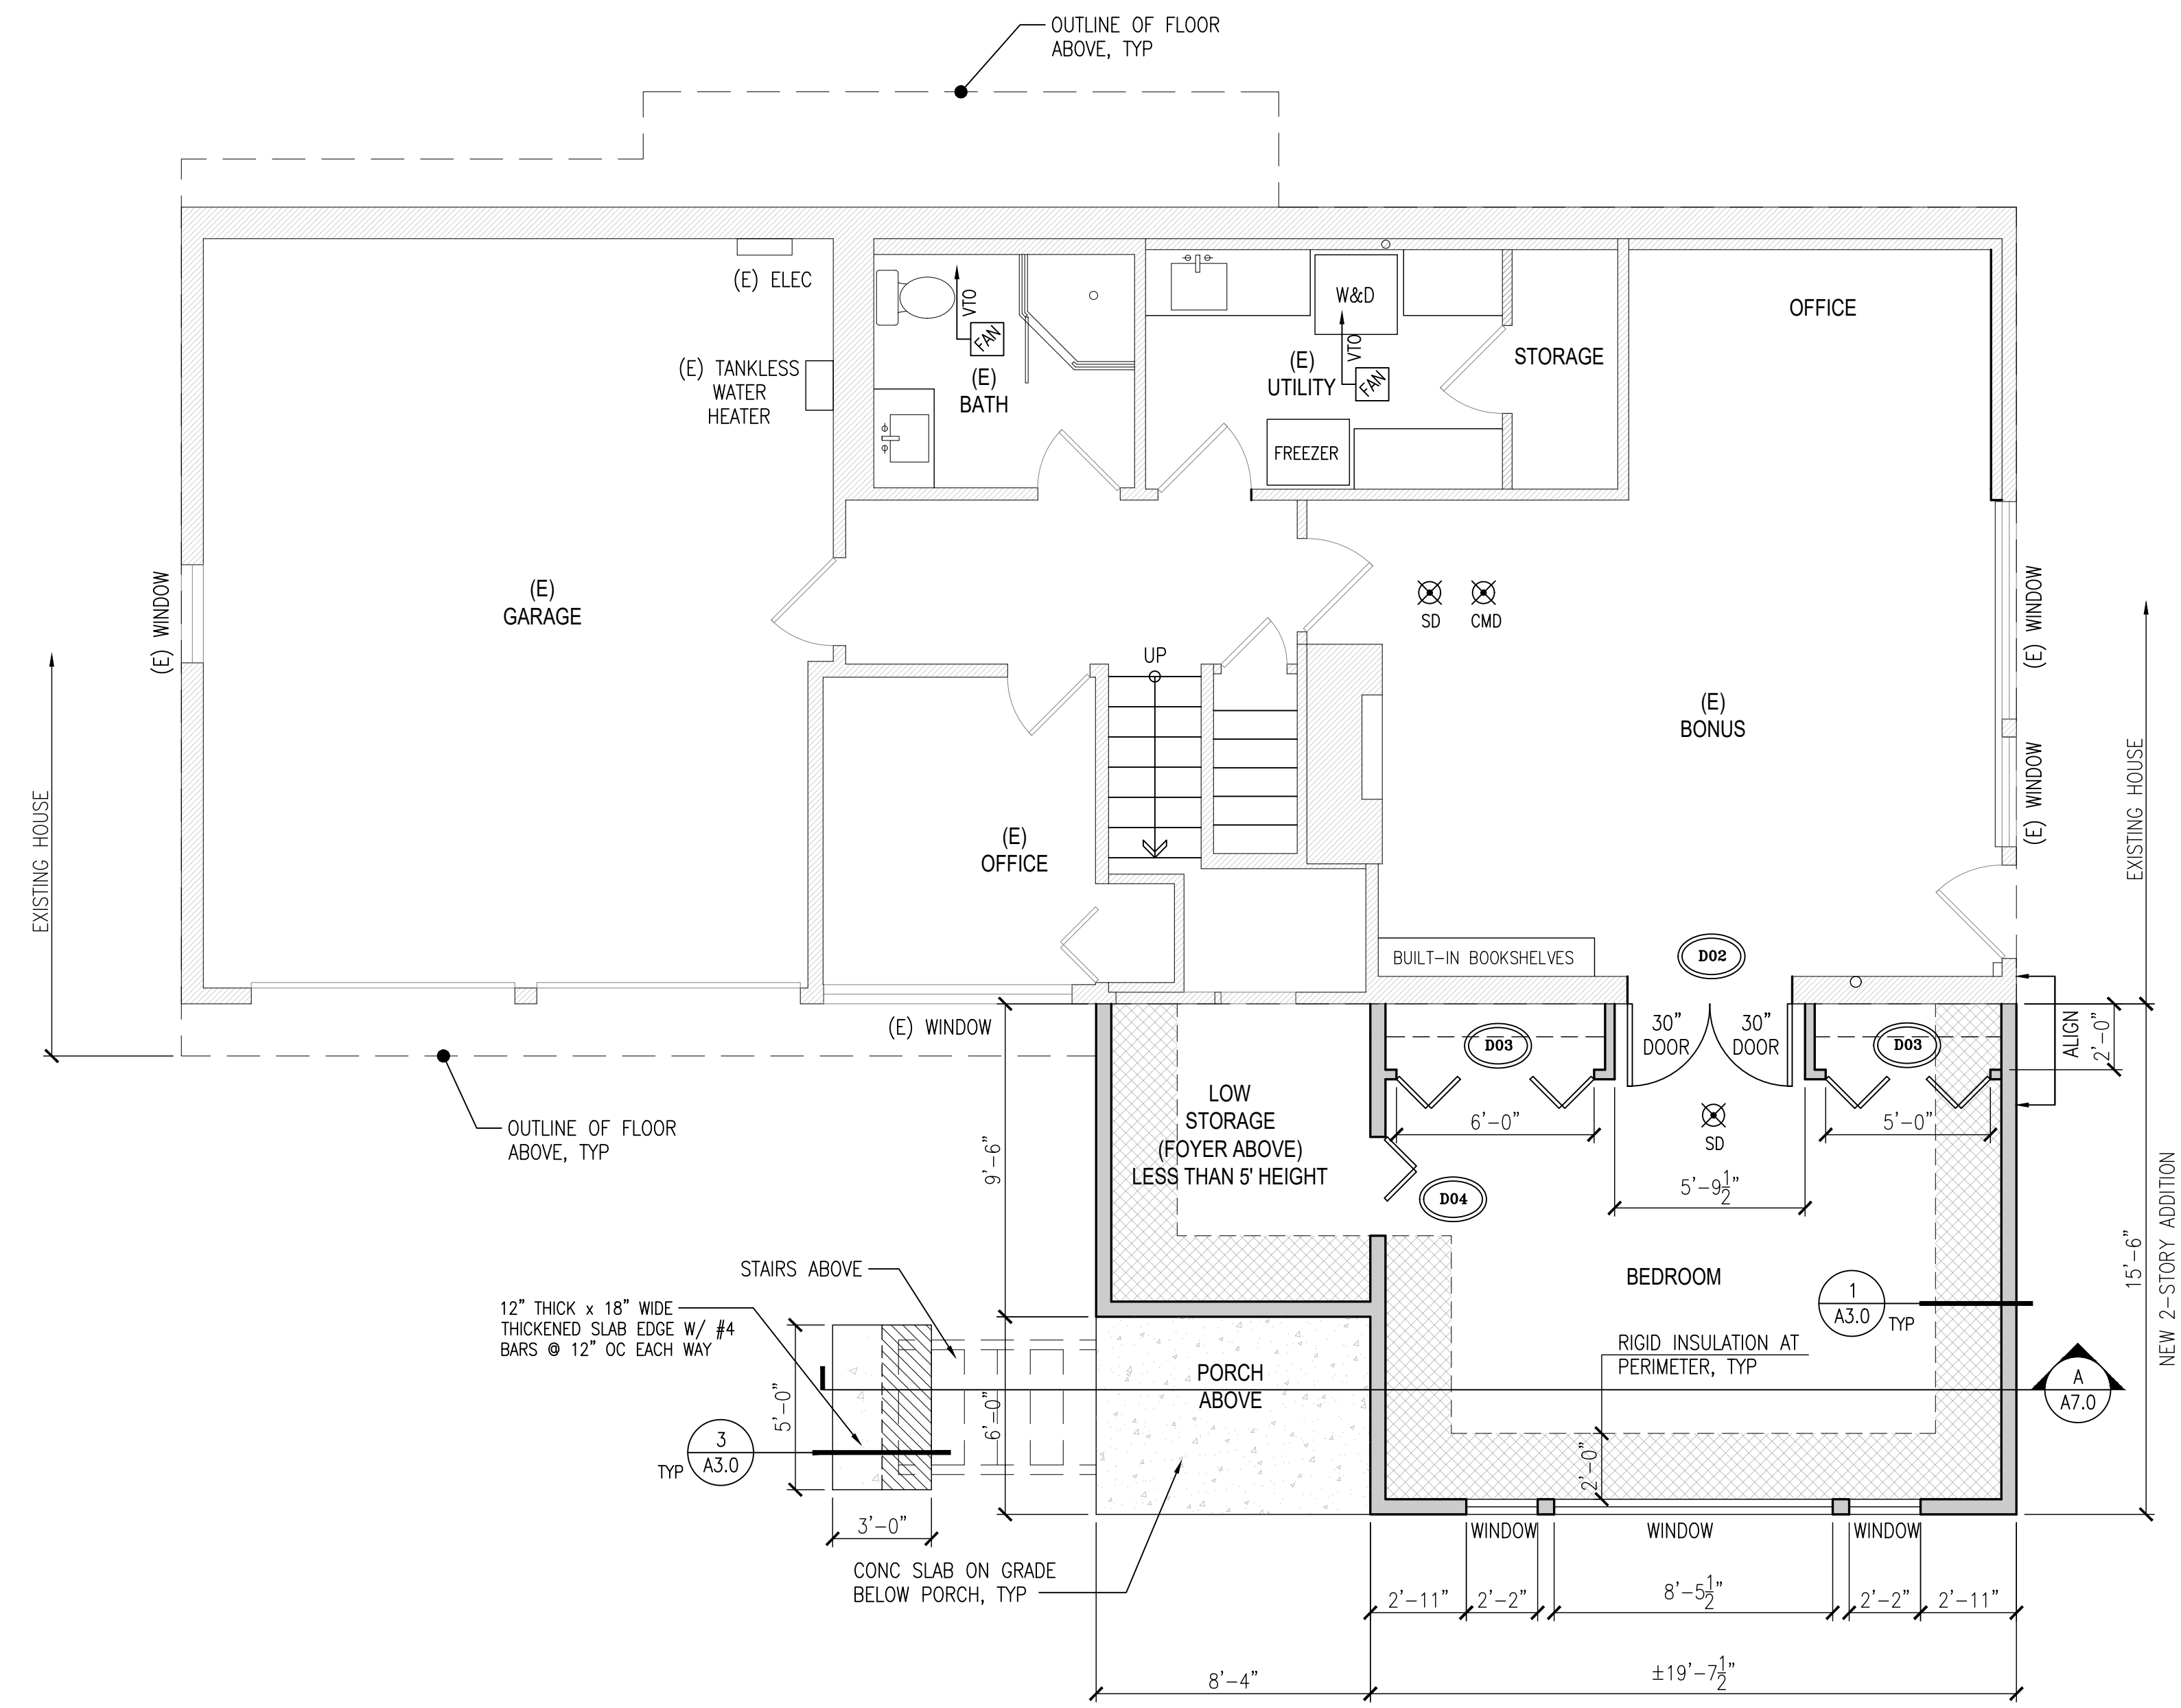


A BASEMENT FLOOR ADDITION PLAN
 SCALE: 1/4"=1'-0"

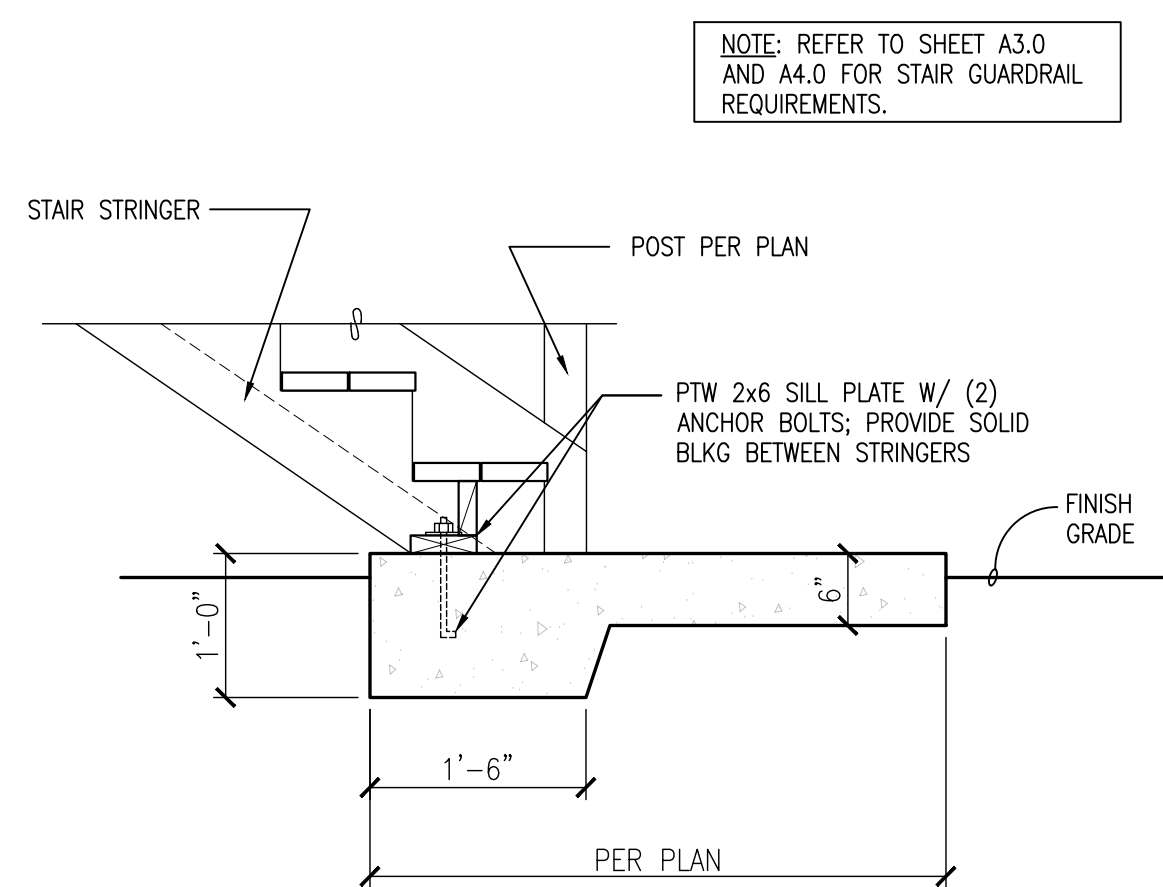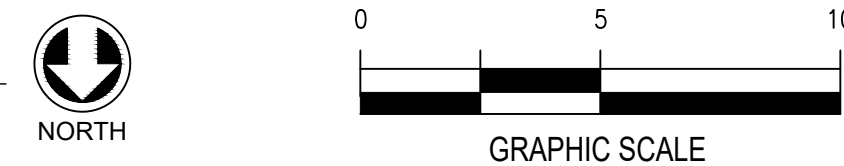

3 DETAIL
 SCALE: 3/4"=1'-0"

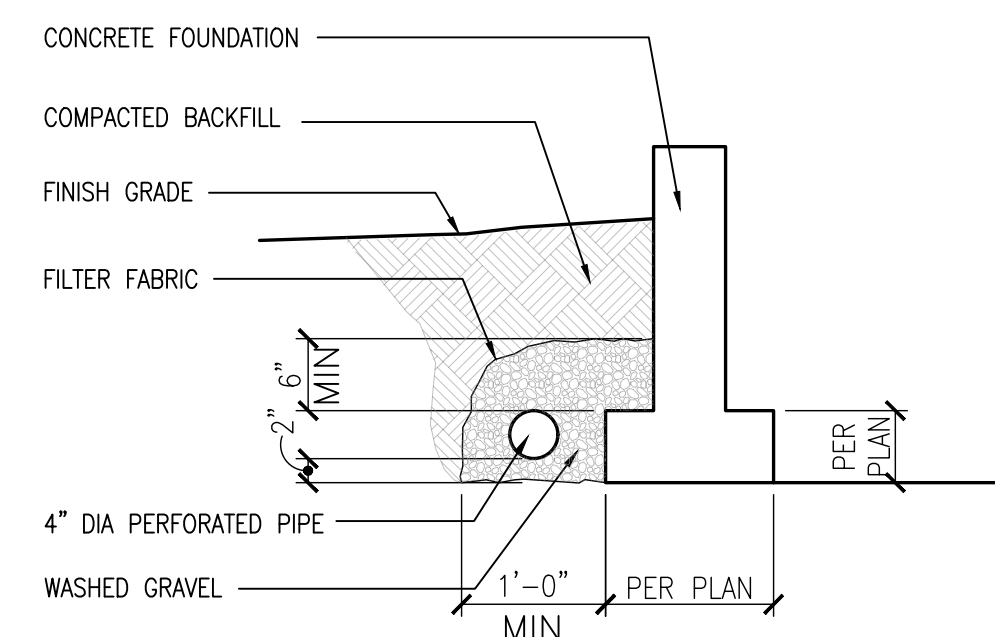

2 FOUNDATION DRAINAGE SYSTEM
 SCALE: 3/4"=1'-0"

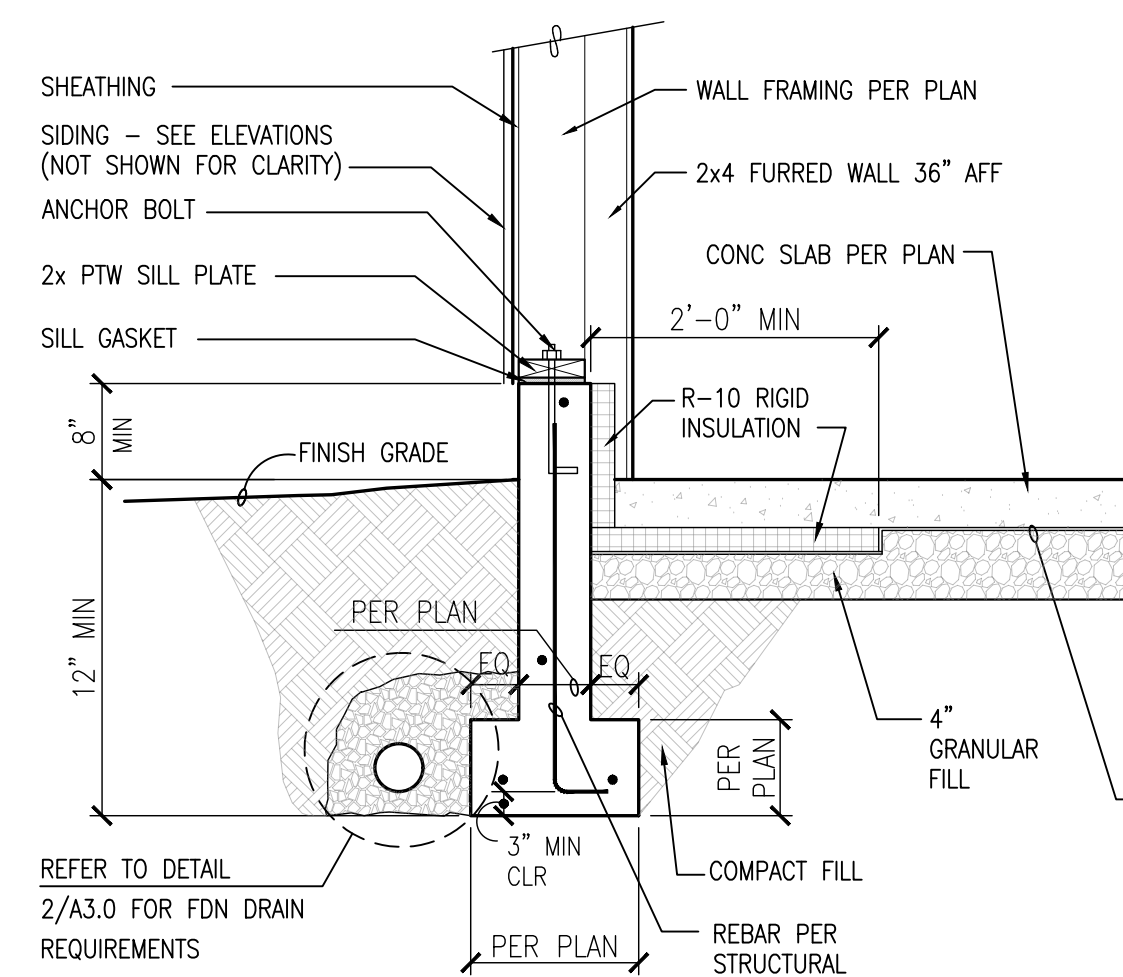

1 DETAIL
 SCALE: 3/4"=1'-0"

REINFORCEMENT SPECIFICATIONS:

- HORIZONTAL STEEL:** PER STRUCTURAL DETAILS
- VERTICAL STEEL:** PER STRUCTURAL DETAILS
- SILL ANCHORAGE:** 5/8" DIA x 10" LONG GALVANIZED ANCHOR BOLTS @ 6'-0" OC MAX. PROVIDE 1/4" THK x 3" SQUARE PLATE WASHERS BETWEEN SILL PLATE AND NUT TYP. UNO IN SHEARWALL SCHEDULE

NOTES:

- 1. STEEL SHALL BE PLACED WITHIN CENTER OF FOUNDATION WALL.
- 2. THERE SHALL BE A MINIMUM OF (2) ANCHOR BOLTS PER FOUNDATION SILL PLATE WITH ONE BOLT LOCATED WITHIN 12" OF EACH END OF EACH FOUNDATION SILL PLATE BUT NO CLOSER THAN 4". EMBED ANCHOR BOLTS 7" MIN.

Sterba Mironova Residence Addition

9811 SE 40th St
 Mercer Island, WA 98040

Permit Set

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02

Project No.: 2105.00
 Drawn:

BASEMENT FLOOR PLAN & DETAILS

Sheet No:

A3.0

FLOOR PLAN NOTES:

MATERIALS

- A. ALL EXTERIOR WALLS TO BE 2x6 STUDS @ 16" OC.
- B. ALL INTERIOR WALLS TO BE 2x4 STUDS @ 16" OC.
- C. ALL FRAMING HARDWARE TO BE "SIMPSON" OR EQUAL.
- D. WALL SHEATHING TO BE 1/2" PLYWOOD WITH SPAN RATING OF 24/16.
- E. ALL HDR PER STRUCTURAL.

REQUIREMENTS

- 1. PROVIDE FIREBLOCKING PER SECTION R602.8.
- 2. INTERCONNECT SMOKE ALARMS AND PROVIDE PRIMARY & BACKUP POWER PER SECTION R313.

LEGEND


(E) WALL TO REMAIN

NEW 2x WOOD FRAME CONSTRUCTION


SD SMOKE DETECTOR (IRC - SECTION R314)

CMD CARBON MONOXIDE DETECTOR (IRC - SECTION R315)

VTO EXHAUST FANS: MIN. 50 CFM FOR BATHROOM AND LAUNDRY; MIN. 100 CFM FOR KITCHEN, WITH DIRECT VENT TO EXTERIOR

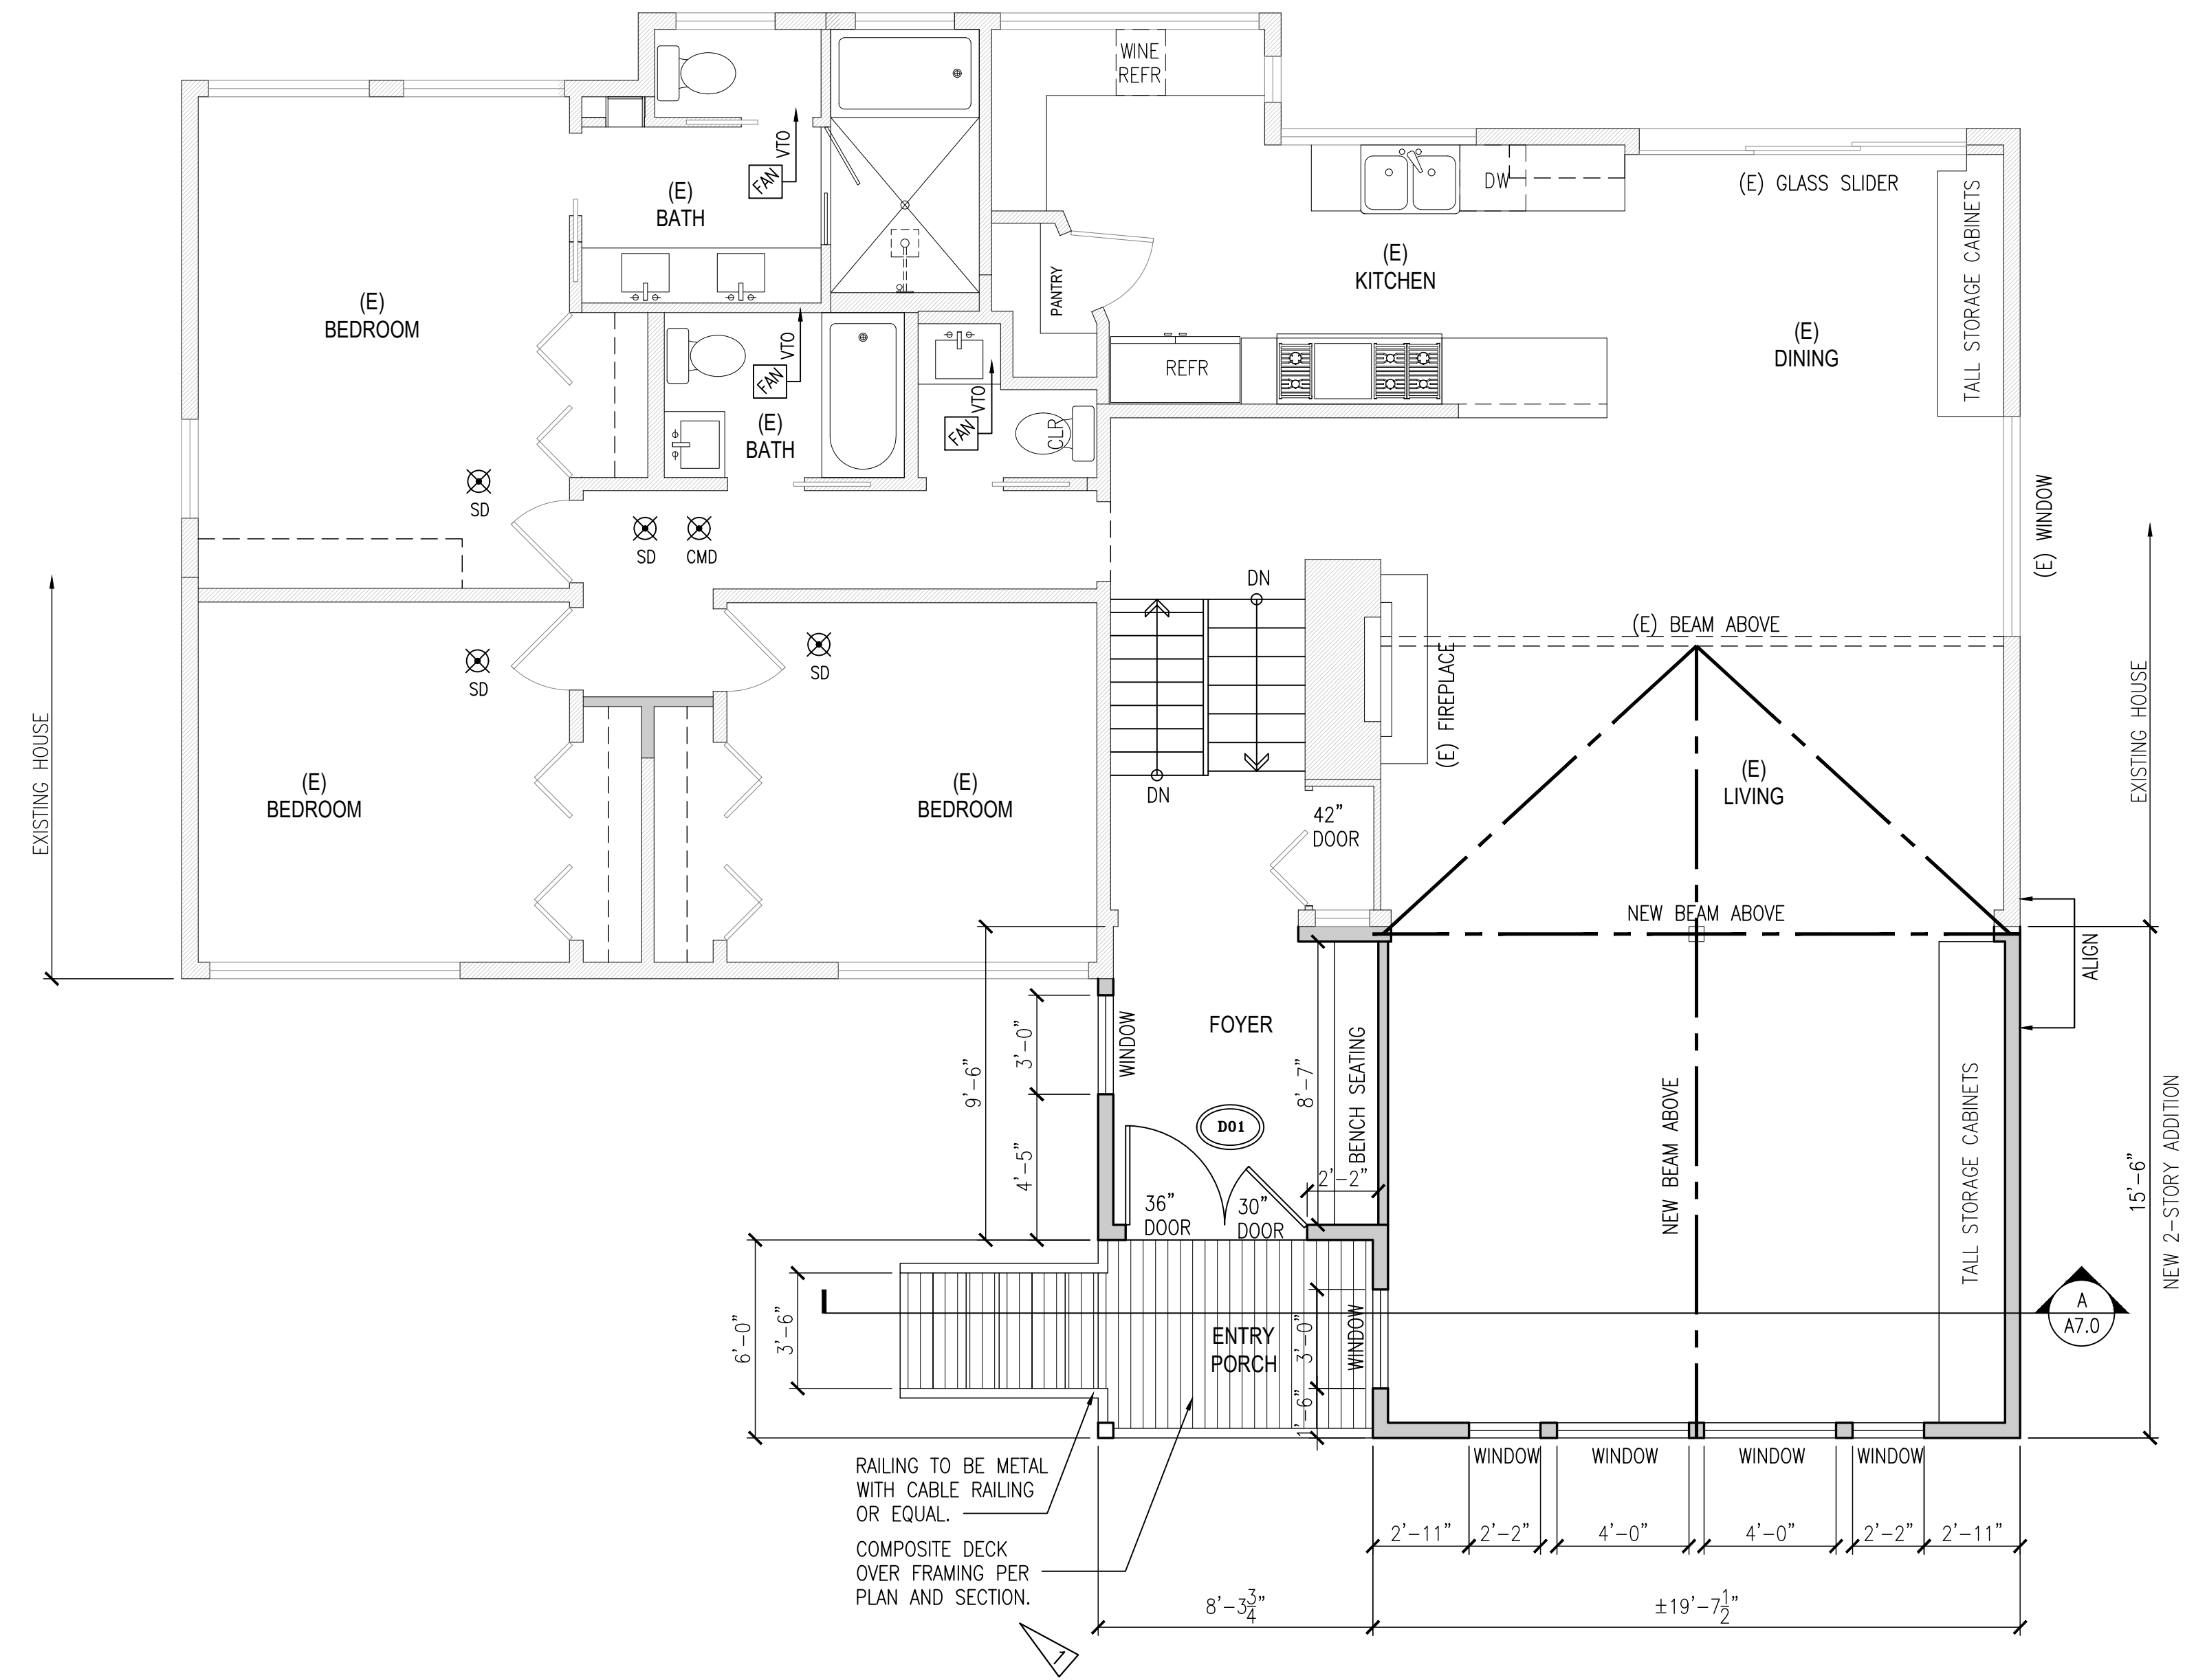

A FIRST FLOOR ADDITION PLAN
SCALE: 1/4"=1'-0"

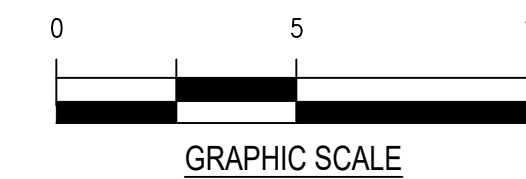

Sterba Mironova
Residence
Addition

9811 SE 40th St
Mercer Island, WA 98040

Permit
Set


Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02

Project No.: 2105.00
Drawn:


FIRST FLOOR
PLAN &
DETAILS

Sheet No:

A4.0

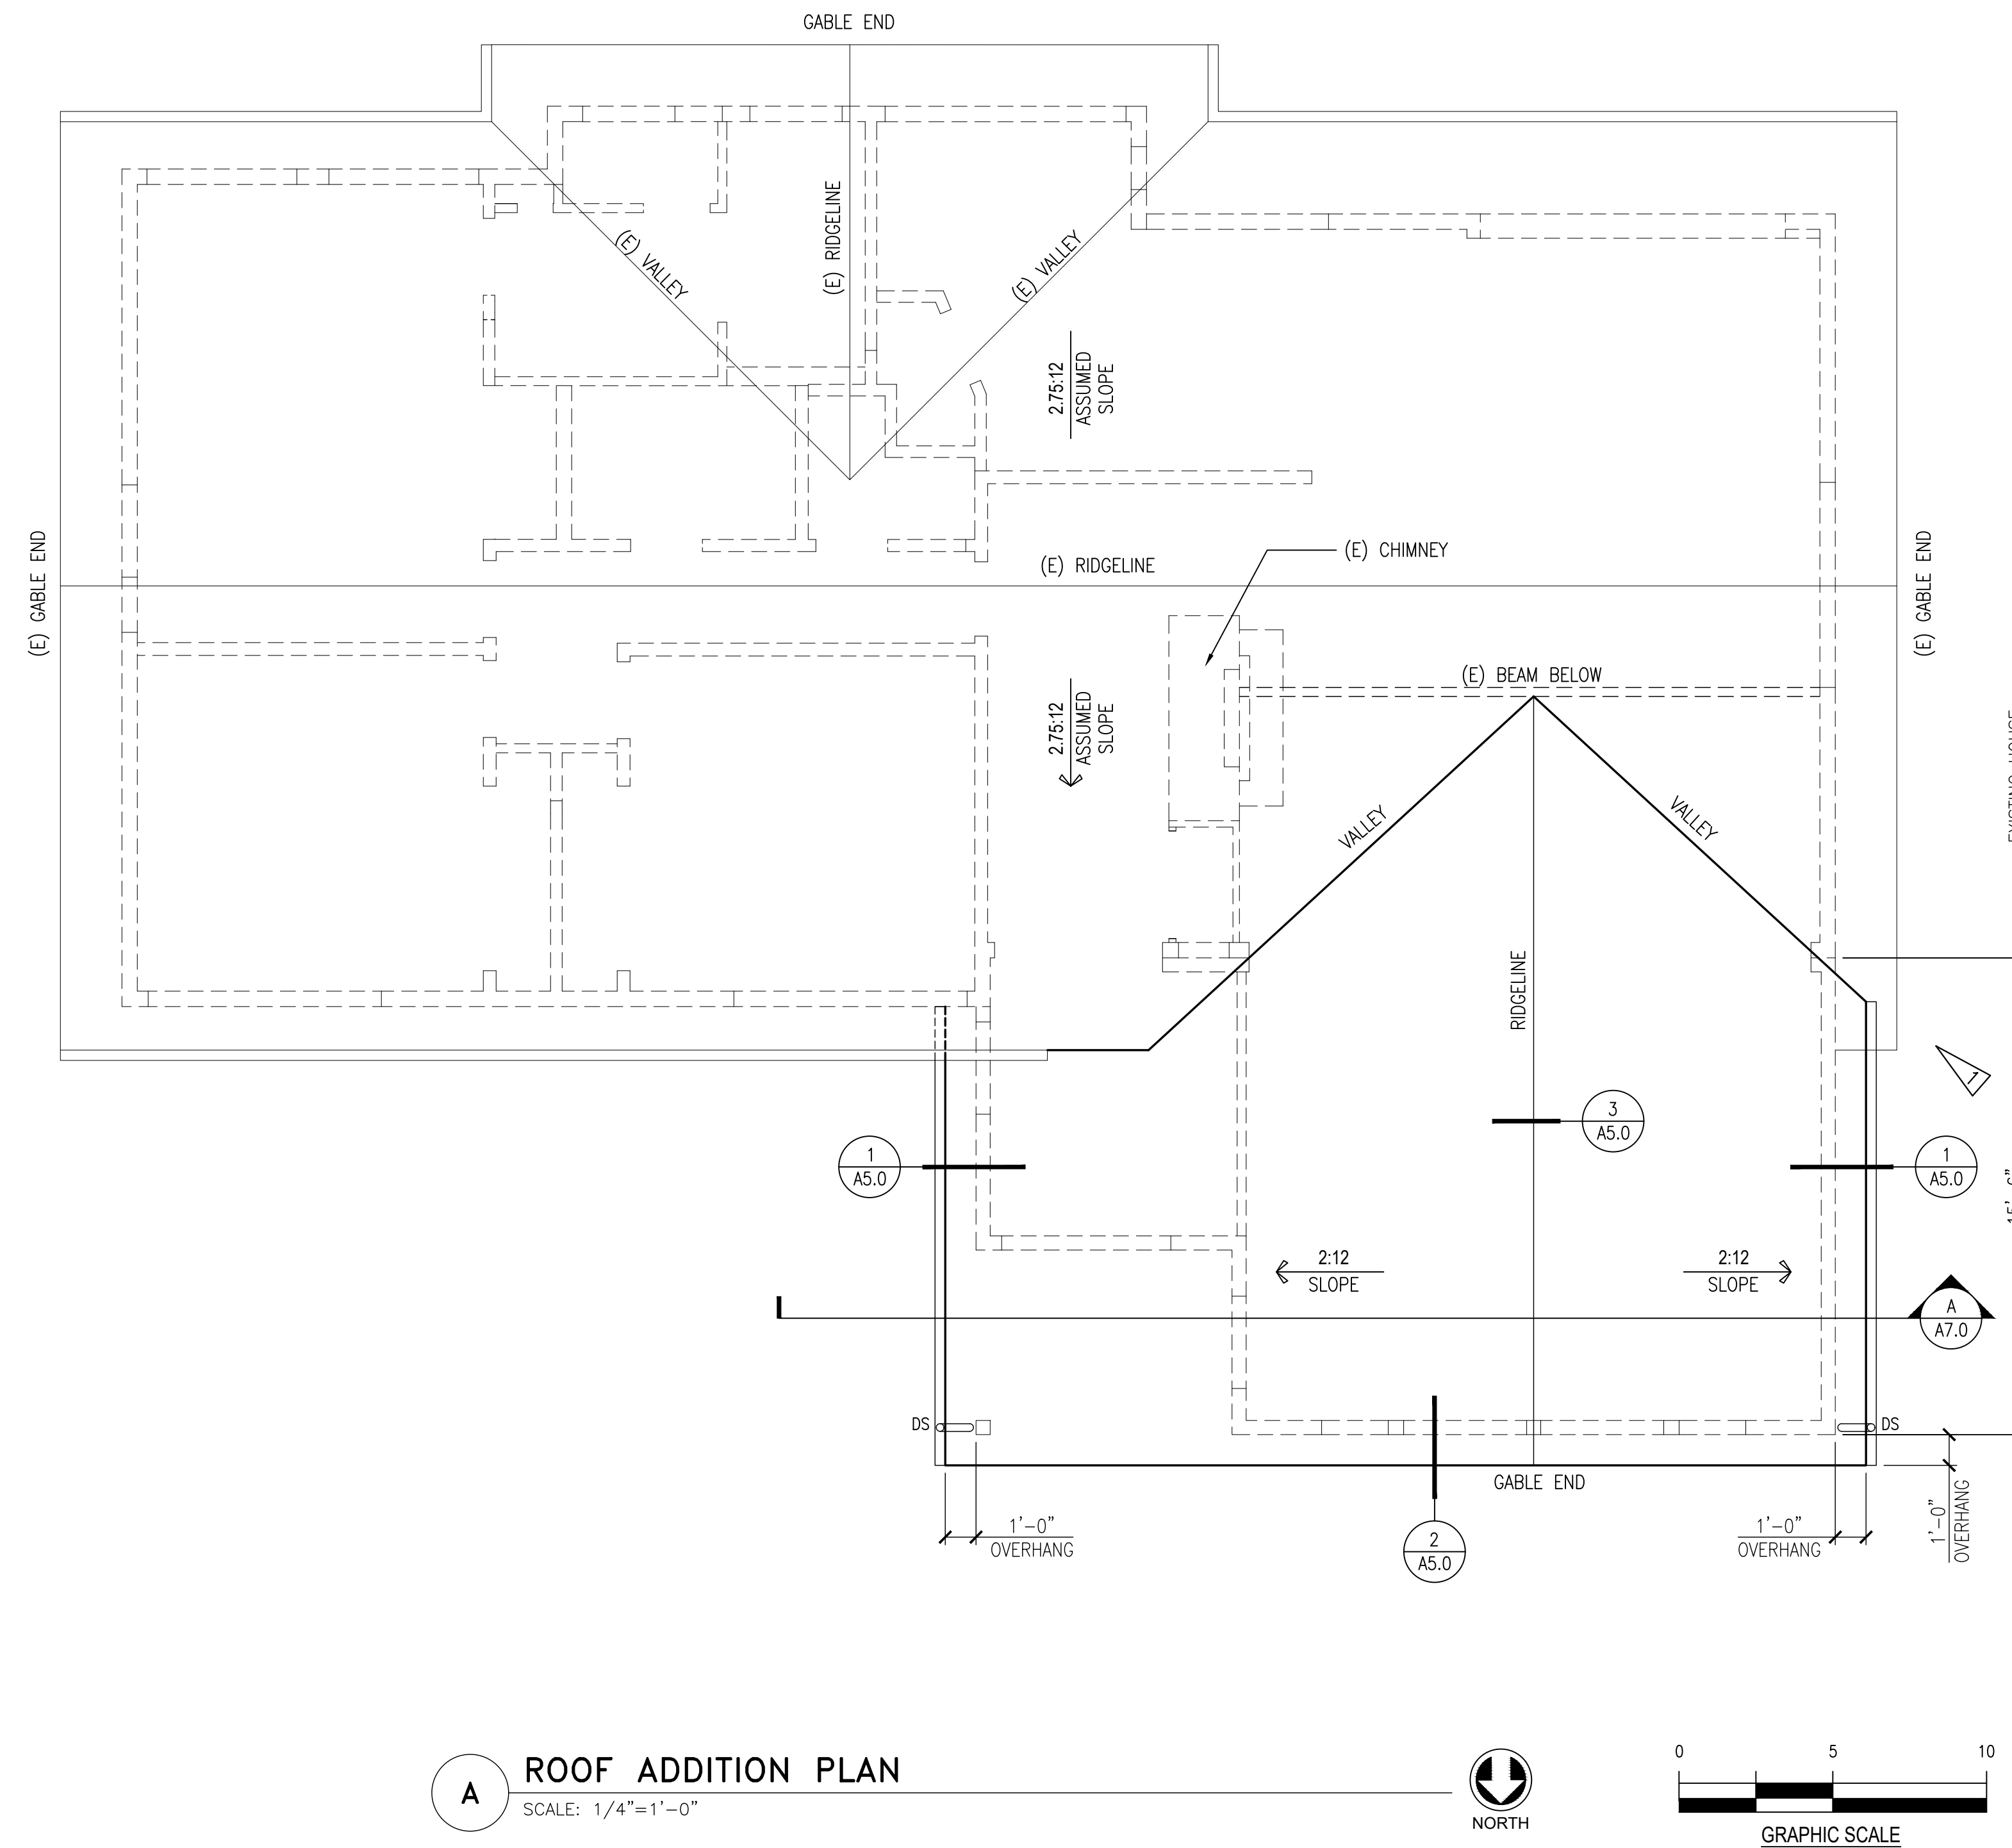

A ROOF ADDITION PLAN
 SCALE: 1/4"=1'-0"

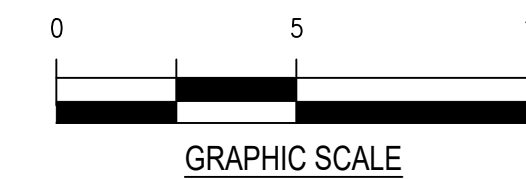

ROOF PLAN NOTES:

MATERIALS

- A. NEW TPO SINGLE PLY MEMBRANE INSTALL PER MFR'S REQUIREMENTS.
- B. ROOF FRAMING – MEMBER SIZE AND SPACING PER PLAN & DETAILS.
- C. ROOF DECKING TO BE 1/2" EXTERIOR GRADE ROOF SHEATHING WITH 32/16 SPAN RATING.
- D. ALL FRAMING HARDWARE TO BE "SIMPSON" OR EQUAL.

REQUIREMENTS

- 1. THERMOPLASTIC SINGLE-PLY ROOFING SHALL COMPLY WITH R905.13.
- 2. THERMOPLASTIC SINGLE-PLY MEMBRANE ROOFS SHALL HAVE A DESIGN SLOPE OF NOT LESS THAN ONE-FOURTH UNIT VERTICAL IN 12 UNITS HORIZONTAL (2-PERCENT SLOPE).
- 3. THERMOPLASTIC SINGLE-PLY ROOF COVERING SHALL COMPLY WITH ASTM D4434, D6754 OR D6878.
- 4. UNDERLAYMENT PER MANUFACTURER'S REQUIREMENTS.
- 5. SPRAYED POLYURETHANE FOAM ROOFING SHALL COMPLY WITH R905.14 AND MANUFACTURER'S REQUIREMENTS.
- 6. SPRAYED-APPLIED POLYURETHANE FOAM INSULATION SHALL COMPLY WITH ASTM C1029, TYPE III OR IV OR ASTM D7425.
- 7. PROVIDE FIREBLOCKING PER SECTION R602.8.

ROOF VENTILATION CALCULATION:

2018 INTERNATIONAL RESIDENTIAL CODE (SECTION R806 ROOF VENTILATION)
 SPRAYED POLYURETHANE FOAM WILL BE USED FOR ROOF INSULATION REQUIREMENT ON THIS PROJECT. ROOF VENTILATION NOT REQUIRED.


Sterba Mironova Residence Addition

9811 SE 40th St
 Mercer Island, WA 98040


Permit Set

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02


Project No.: 2105.00
 Drawn:

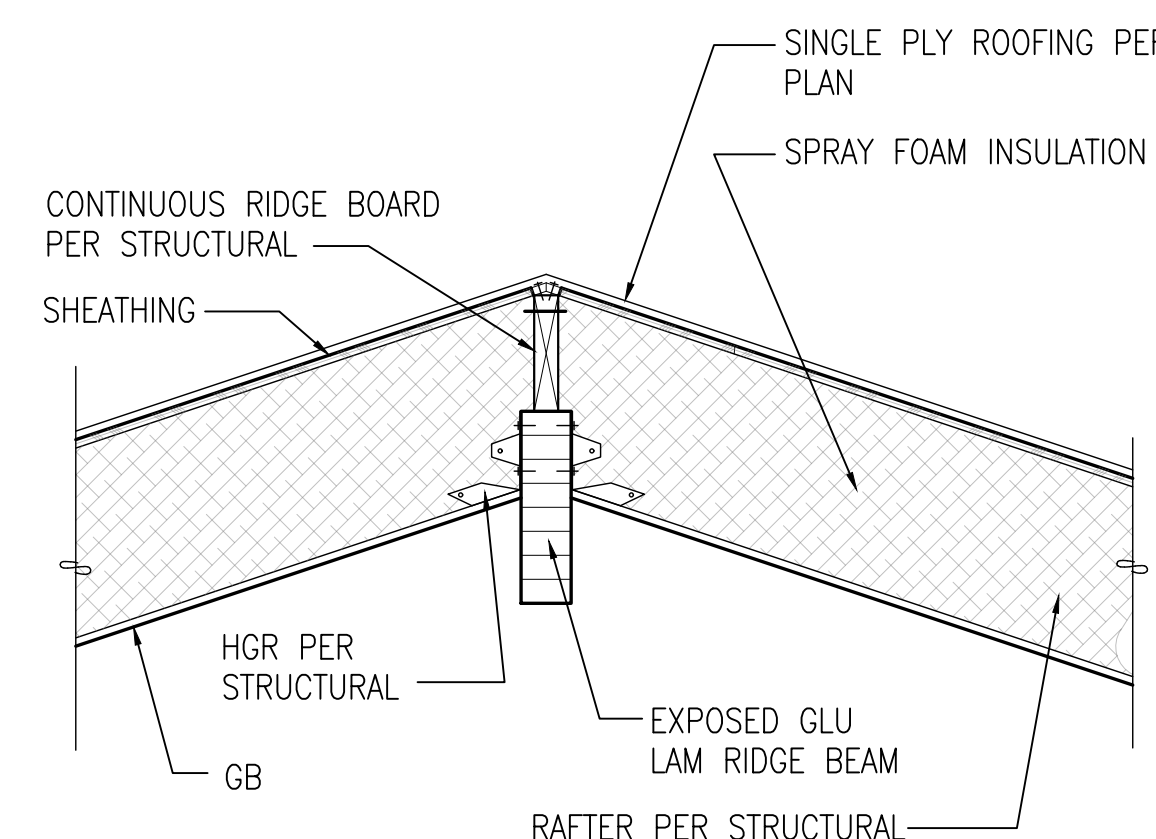

3 DETAIL
 SCALE: 1"=1'-0"

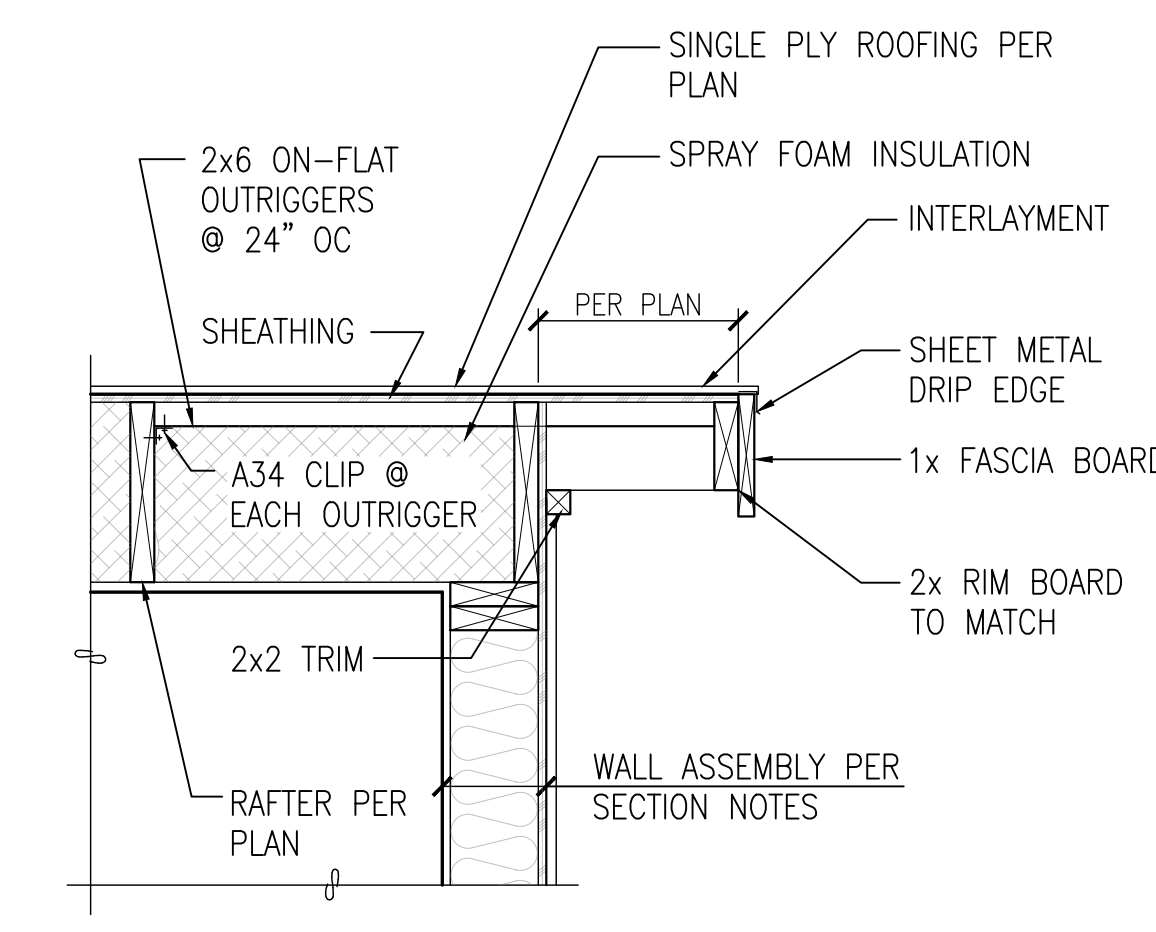

2 DETAIL
 SCALE: 1"=1'-0"

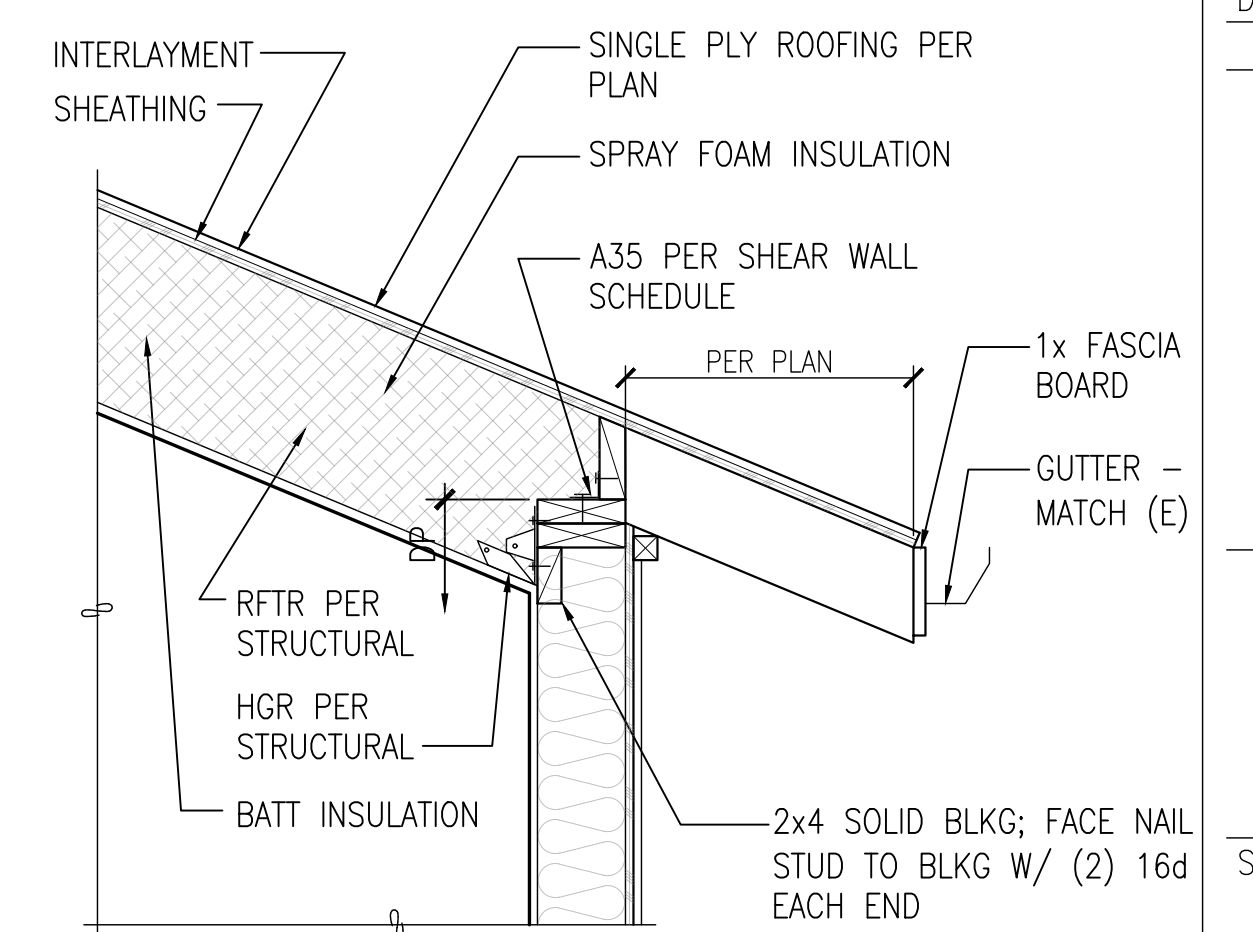


1 DETAIL
 SCALE: 1"=1'-0"

ROOF PLAN & DETAILS


Sheet No:

A5.0

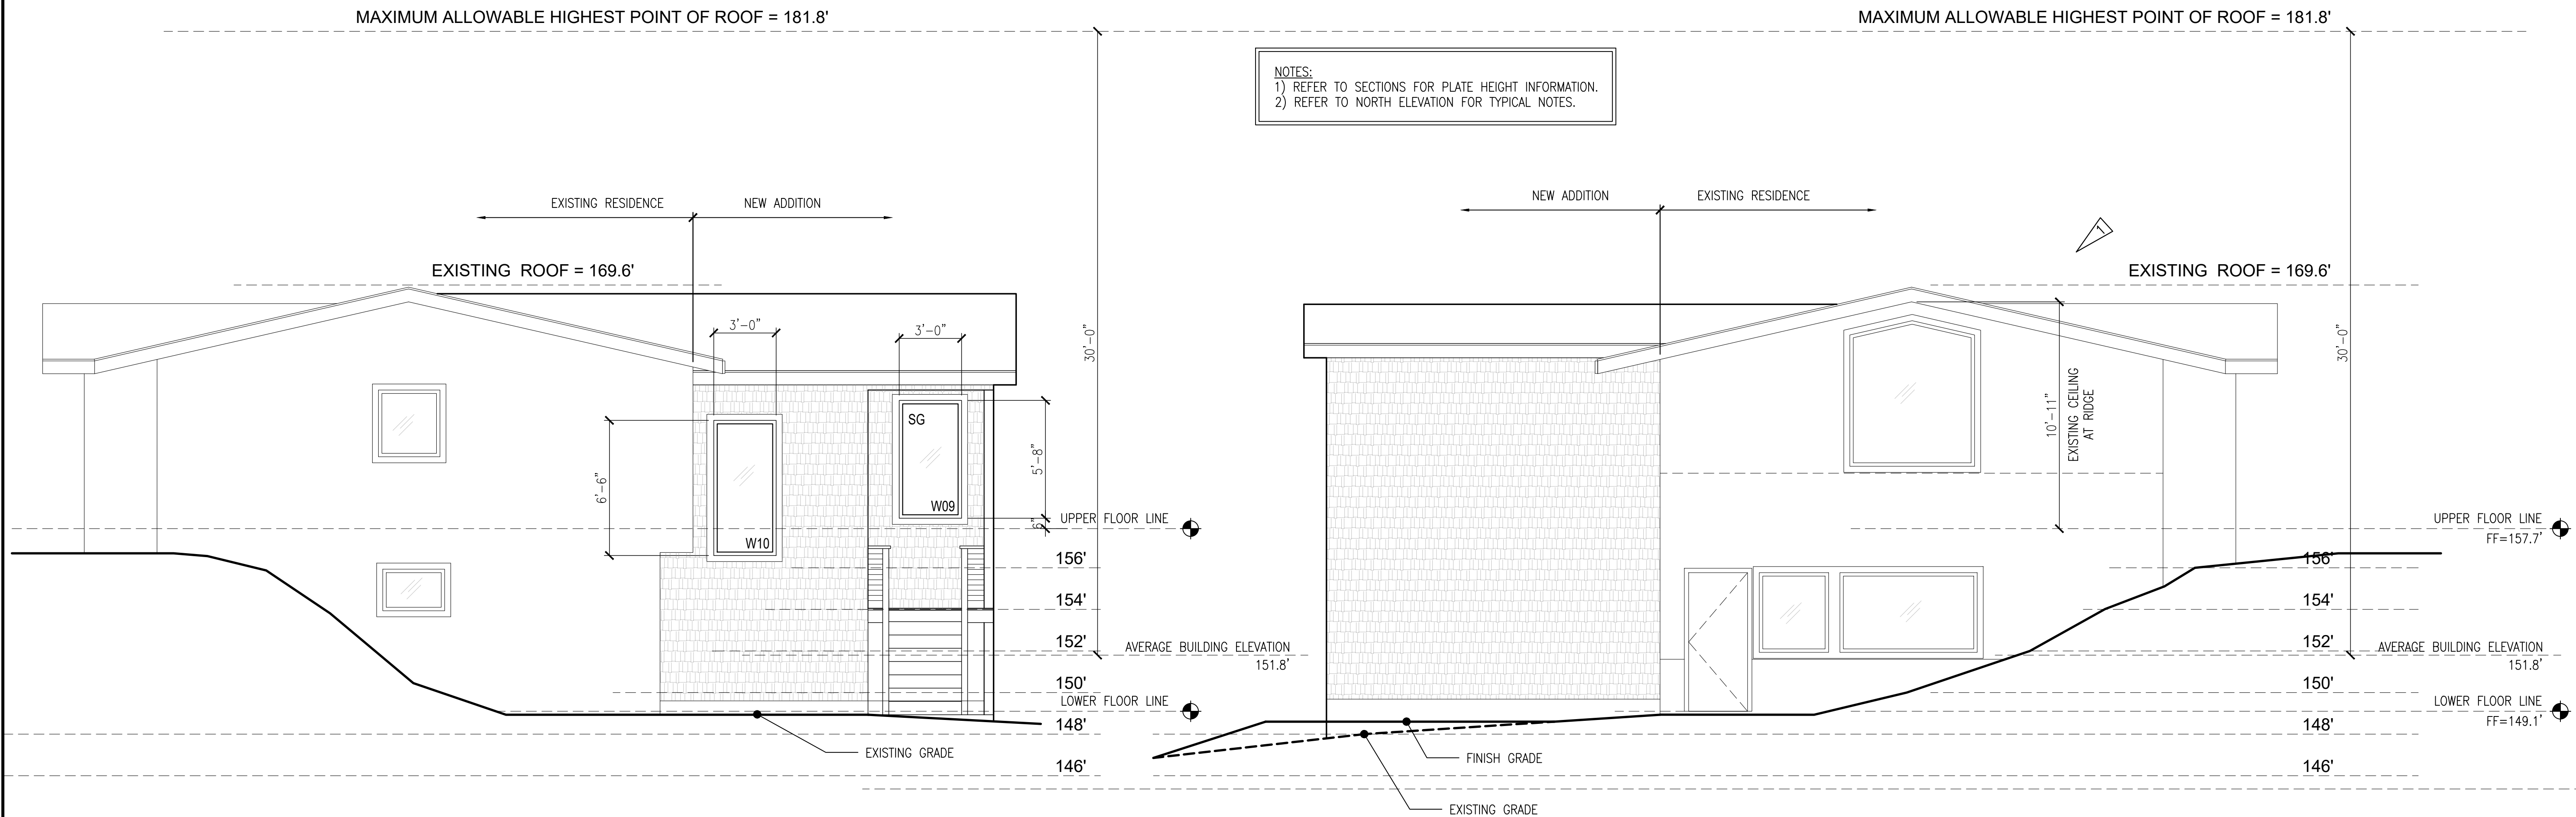

C EAST ELEVATION
 SCALE: 1/4"=1'-0"

B WEST ELEVATION
 SCALE: 1/4"=1'-0"

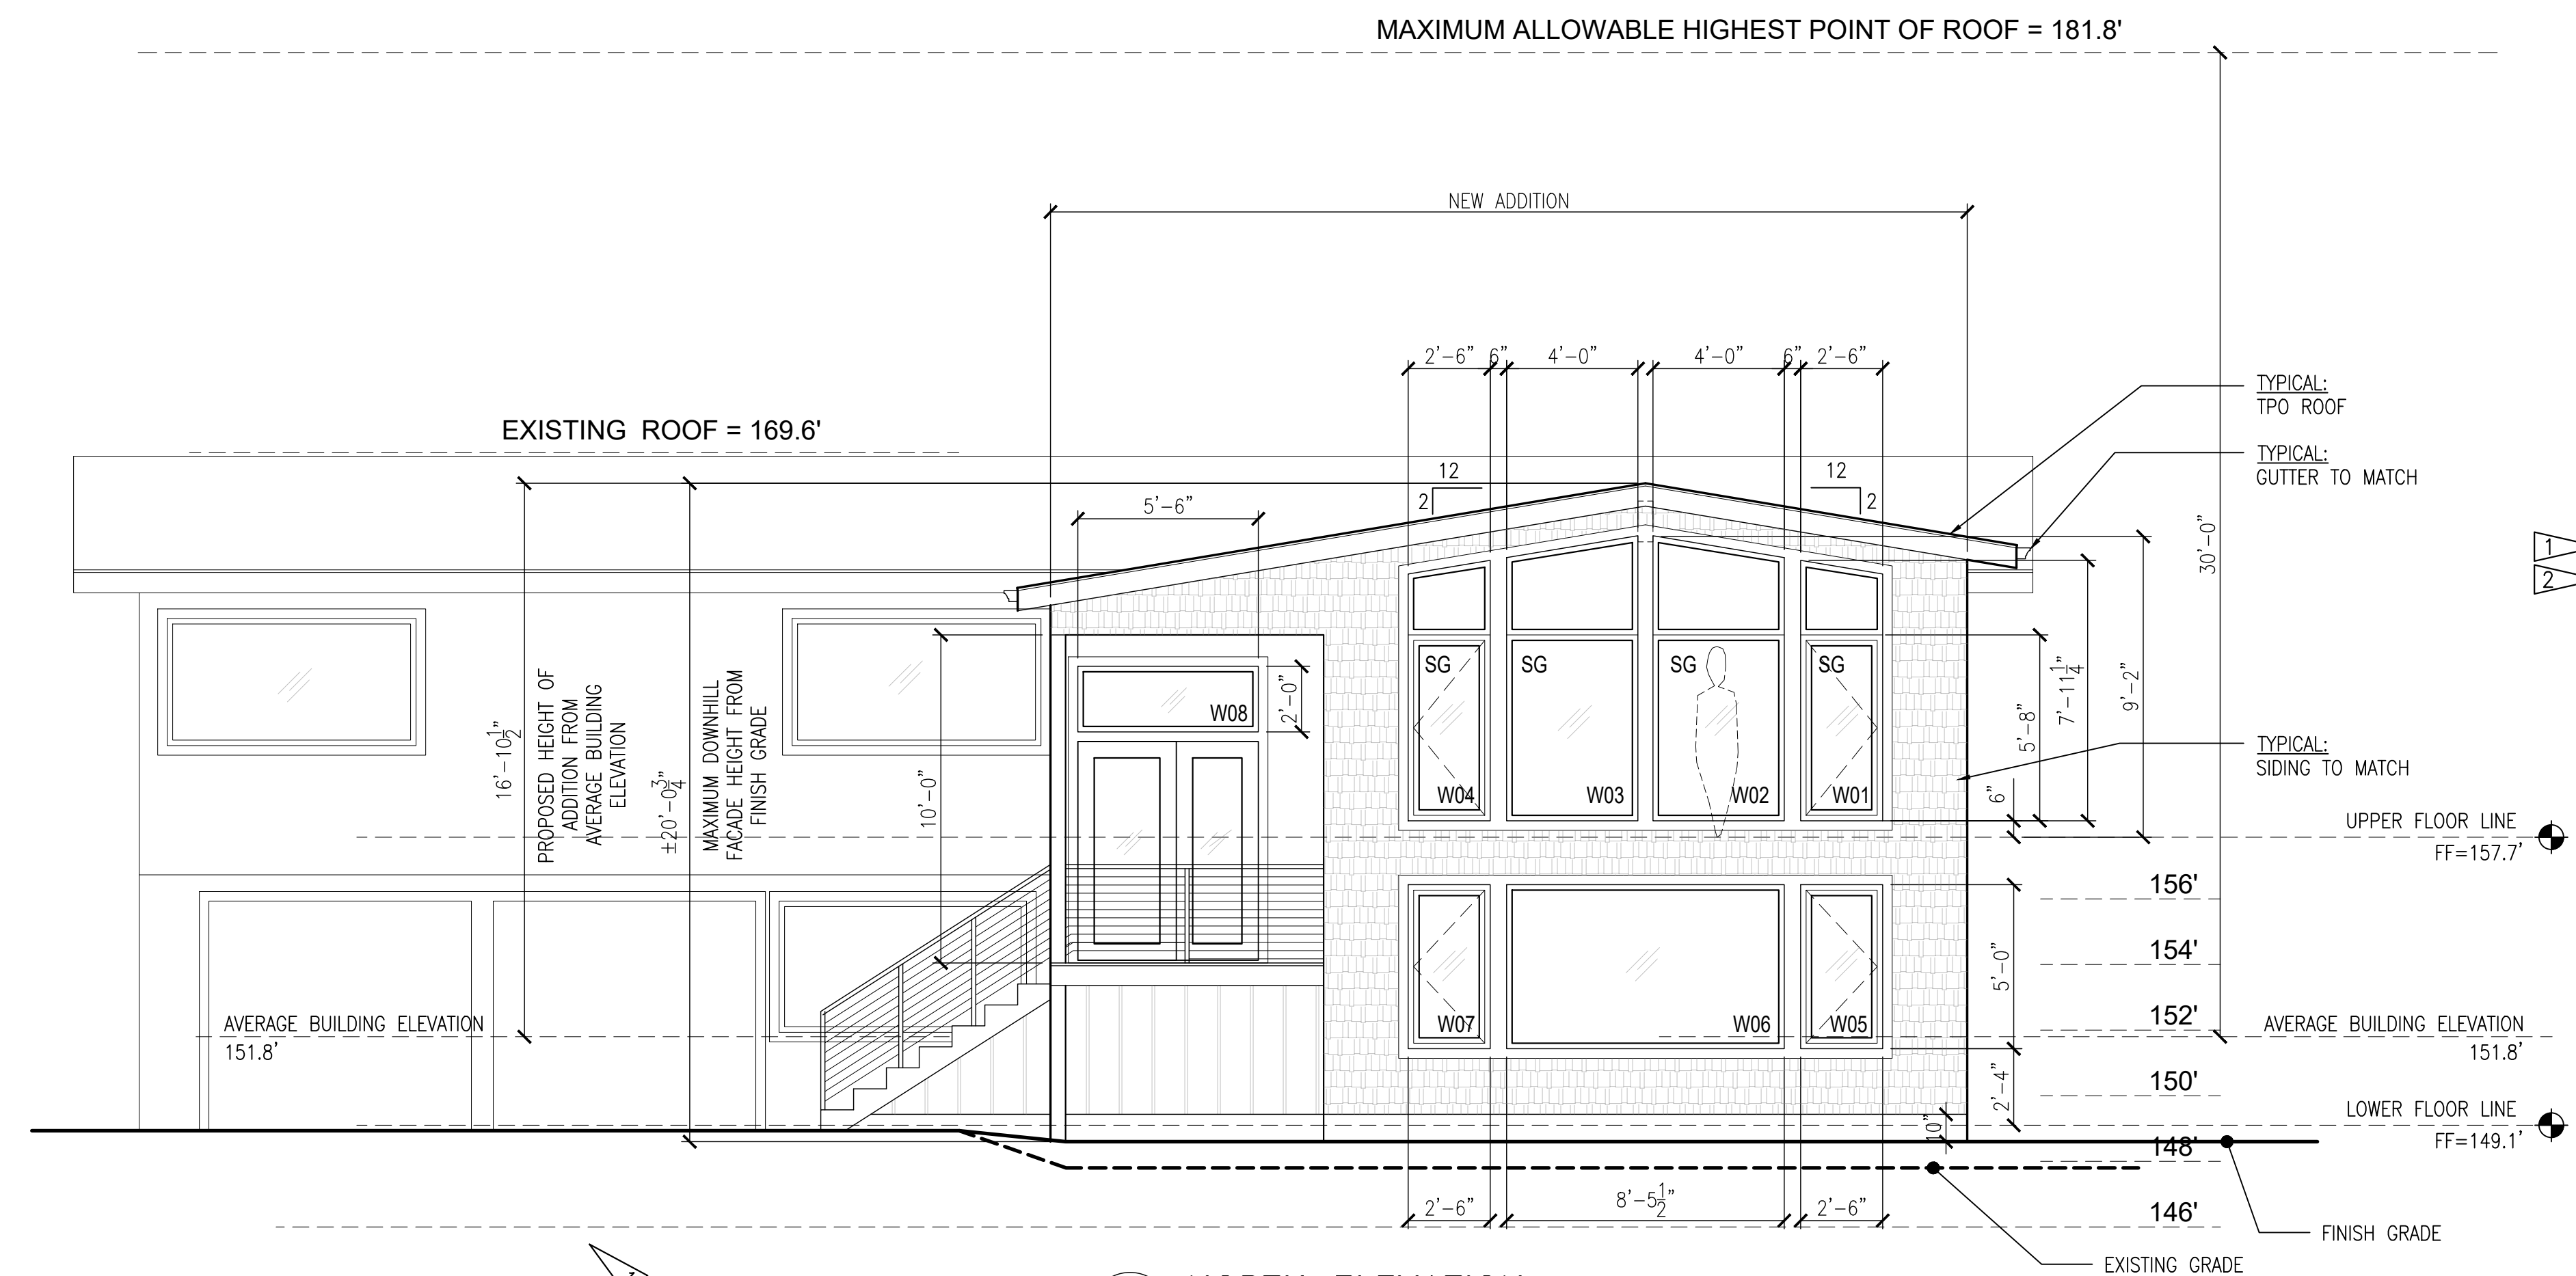

A NORTH ELEVATION
 SCALE: 1/4"=1'-0"


Sterba Mironova
 Residence
 Addition
 9811 SE 40th St
 Mercer Island, WA 98040

Permit Set

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02

Project No.: 2105.00
 Drawn:

ELEVATIONS & DETAILS

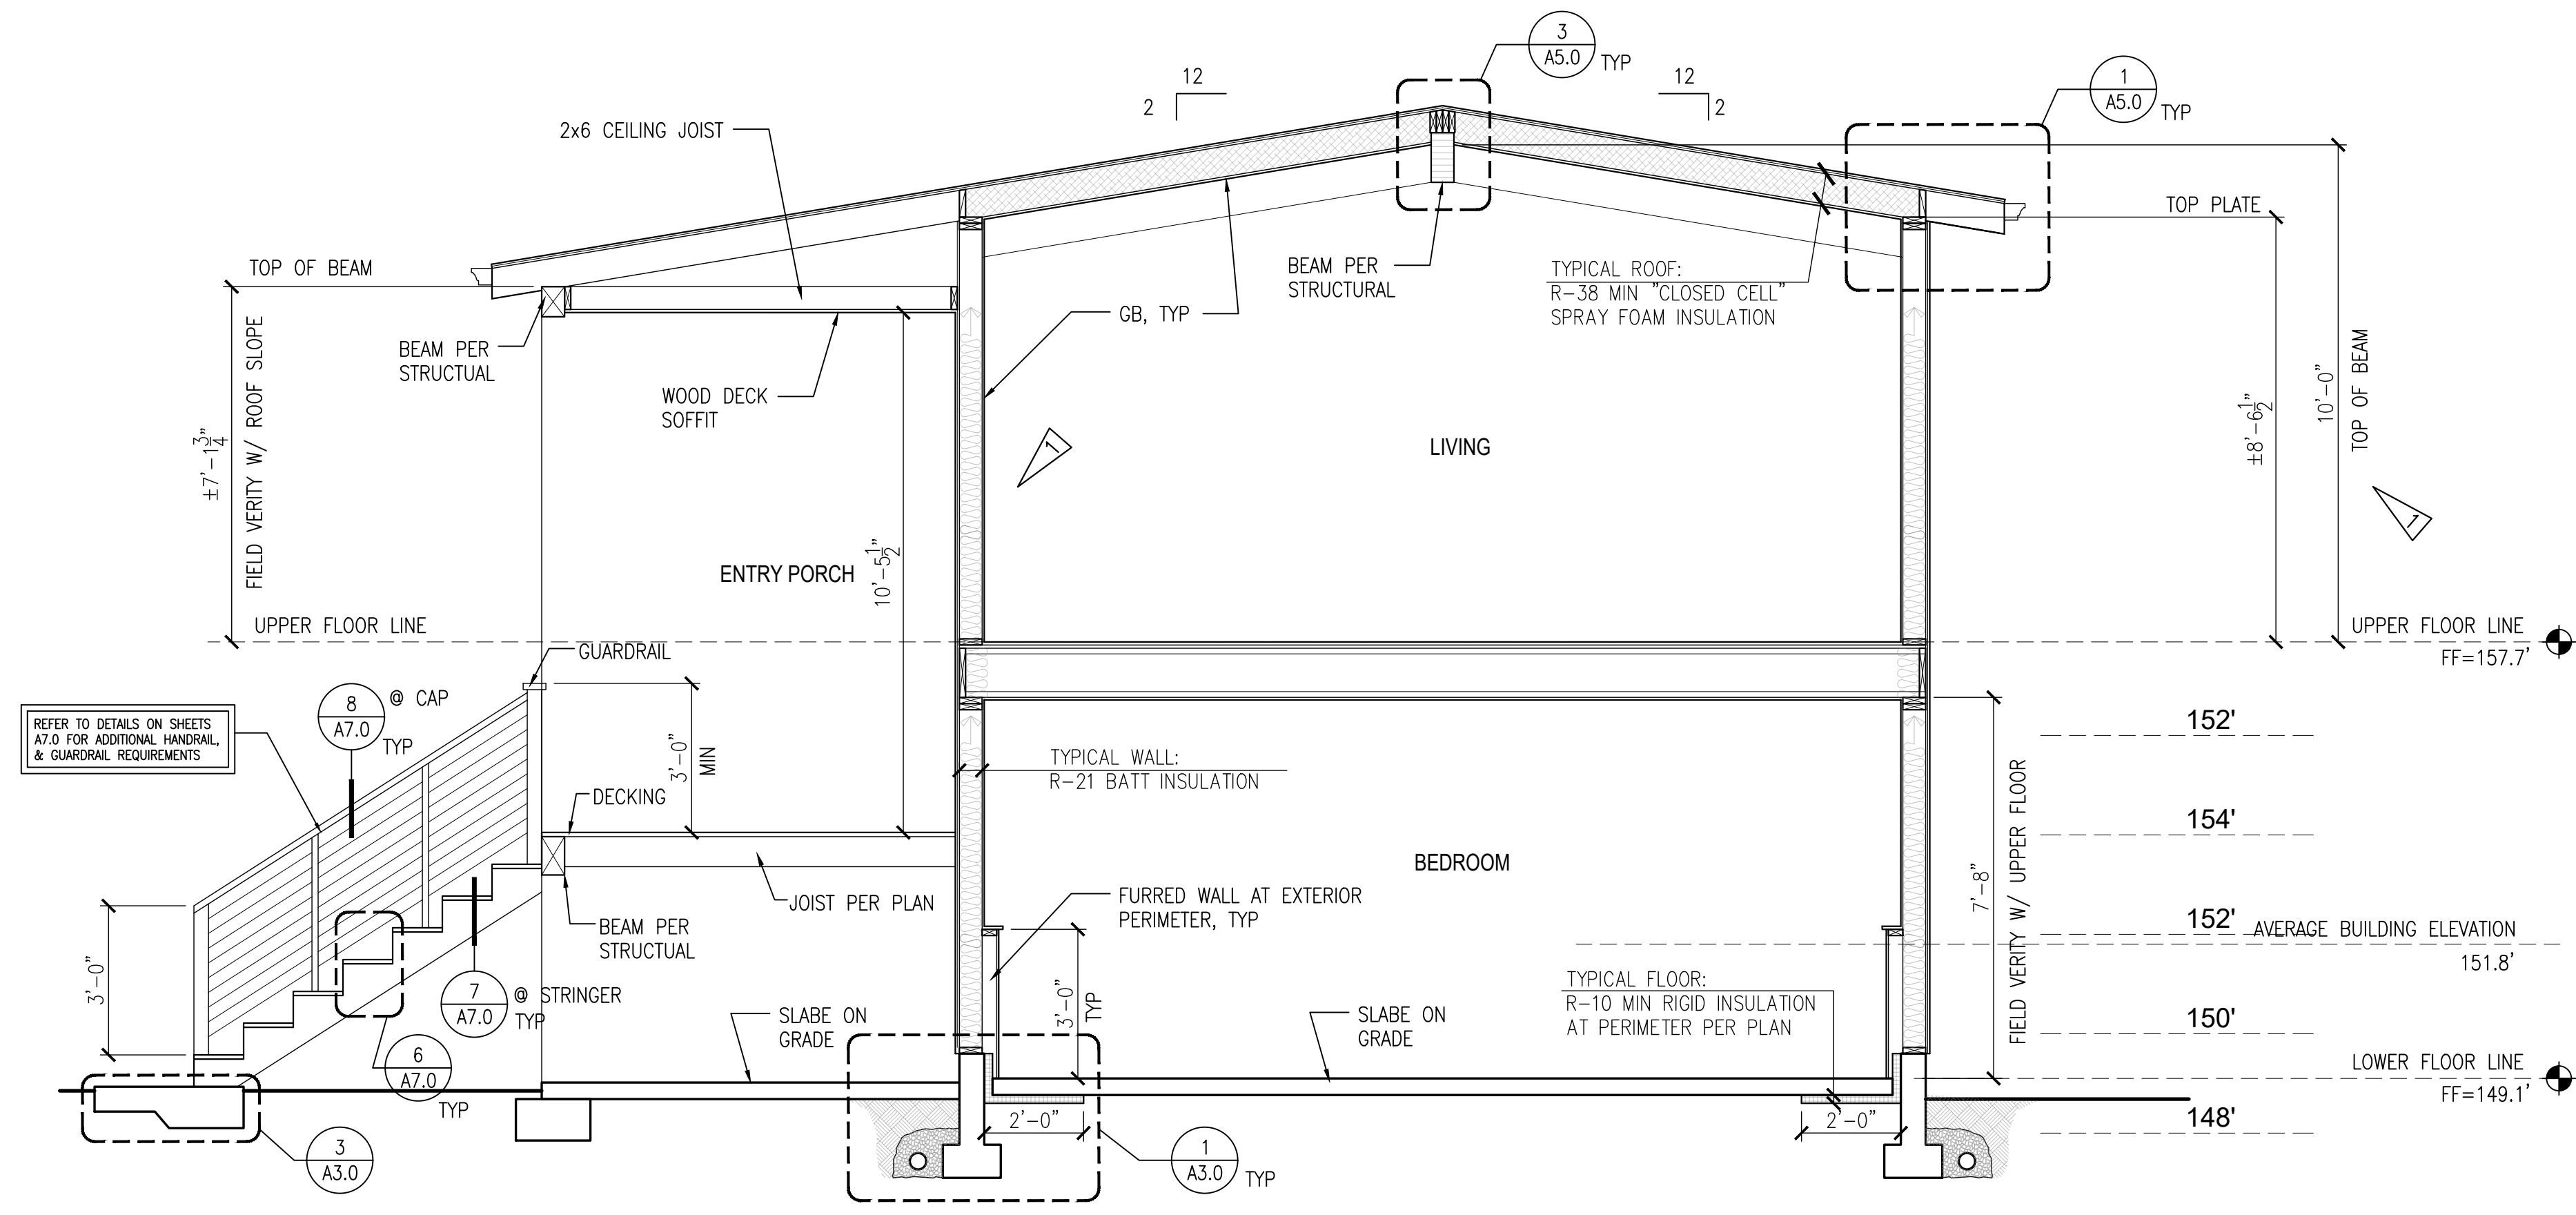

A DETAIL
 SCALE: 3/4"=1'-0"

SECTION NOTES:

TYPICAL ROOF CONSTRUCTION

- THEMOPLASTIC SINGLE-PLY ROOFING (PER R905.13).
- (1) LAYER OF UNDERLAYMENT (PER R905.2.2).
- 1/2" EXTERIOR GRADE ROOF SHEATHING.
- ROOF FRAMING PER PLAN.
- R-38 SPRAY FOAM INSULATION AT RAFTERS.
- 5/8" GB.

TYPICAL WALL CONSTRUCTION


- SIDING PER ELEVATIONS.
- WEATHER-RESISTANT BARRIER MEMBRANE.
- 1/2" EXTERIOR GRADE SHEATHING.
- 2x STUDS @ 16" OC (SEE PLAN FOR SIZE).
- R-21 BATT INSULATION.
- 1/2" GB.

TYPICAL FLOOR/CEILING CONSTRUCTION


- FLOOR FINISHES PER OWNER.
- 3/4" T&G PLYWOOD SUBFLOOR GLUED AND NAILED OVER FLOOR JOISTS.
- FLOOR JOISTS PER PLAN.
- 5/8" GB.

TYPICAL FLOOR CONSTRUCTION


- FLOOR FINISHES PER OWNER.
- 4" CONCRETE SLAB ON GRADE.
- 6 MIL VAPOR RETARDER.
- 4" GRANULAR FILL.
- COMPACT FILL.

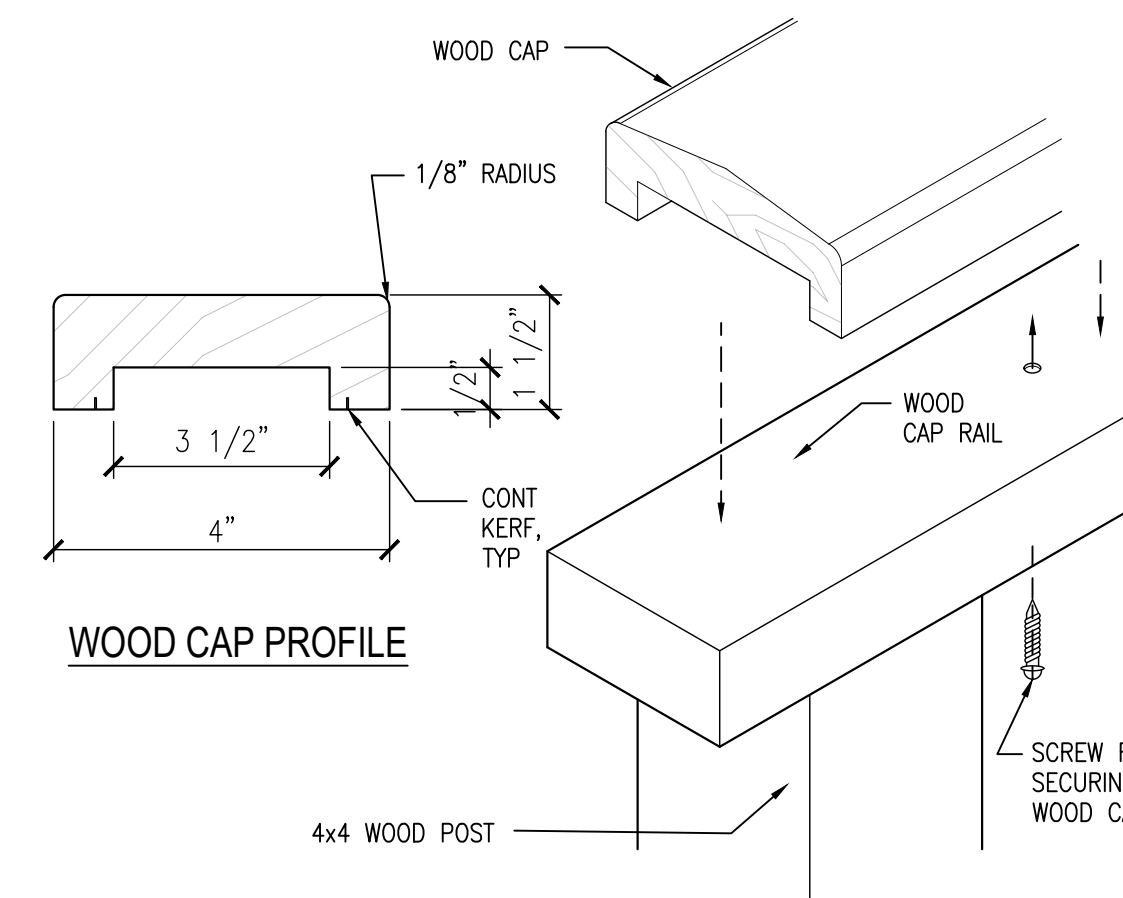


8 DETAIL - CAP AND CAP SUPPORT
 SCALE: NTS

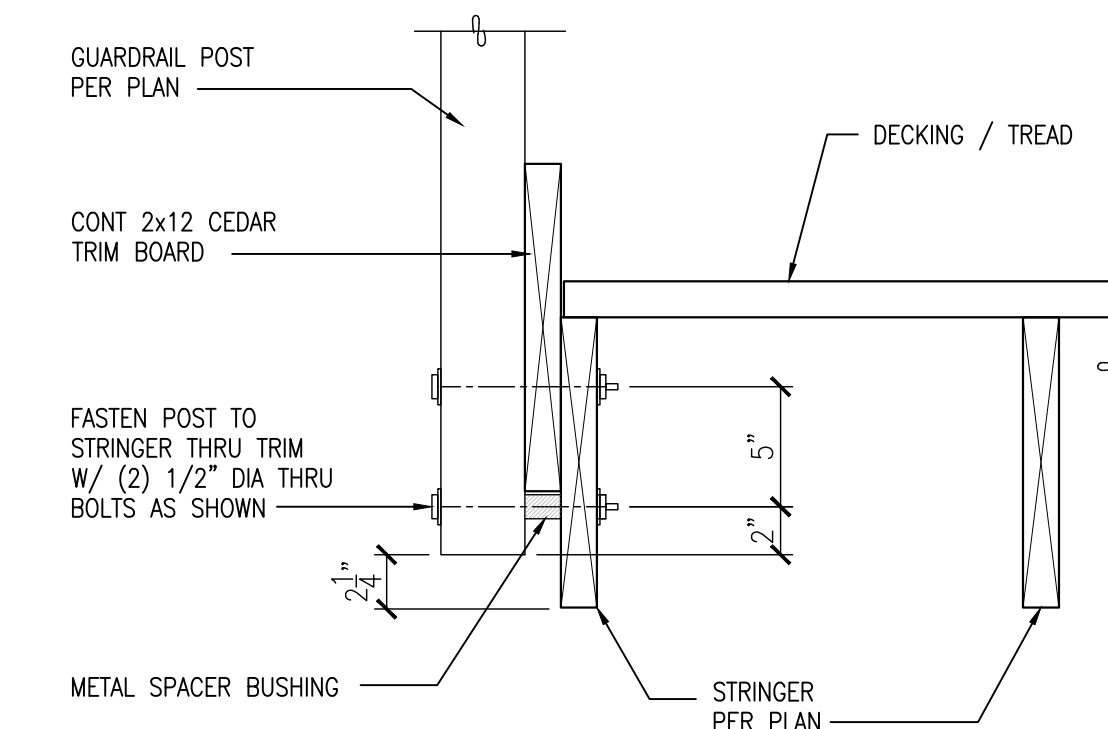


7 STRINGER DETAIL
 SCALE: 1-1/2"=1'-0"

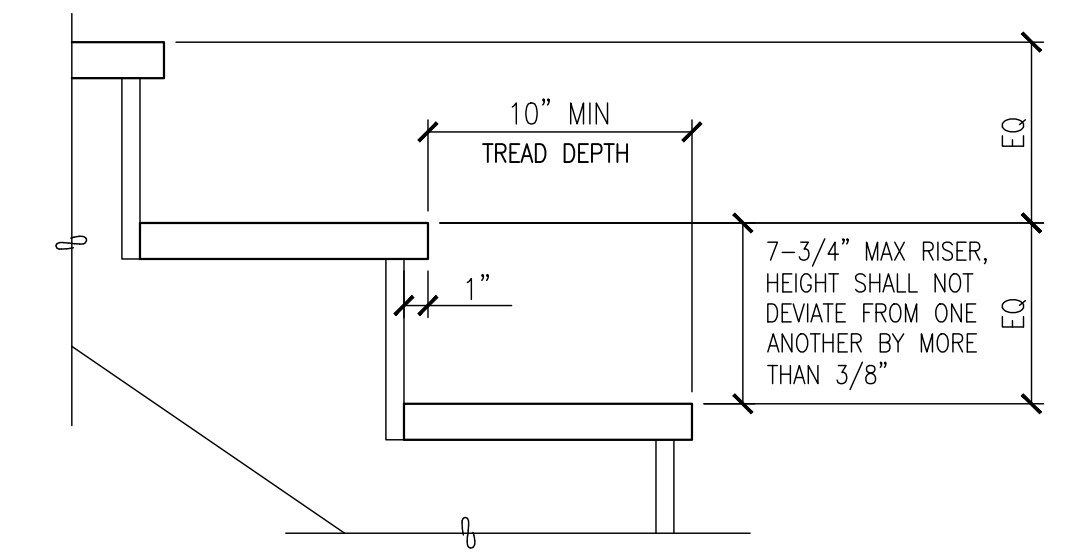

6 TYPICAL TREAD/RISER DETAIL
 SCALE: 1-1/2"=1'-0"

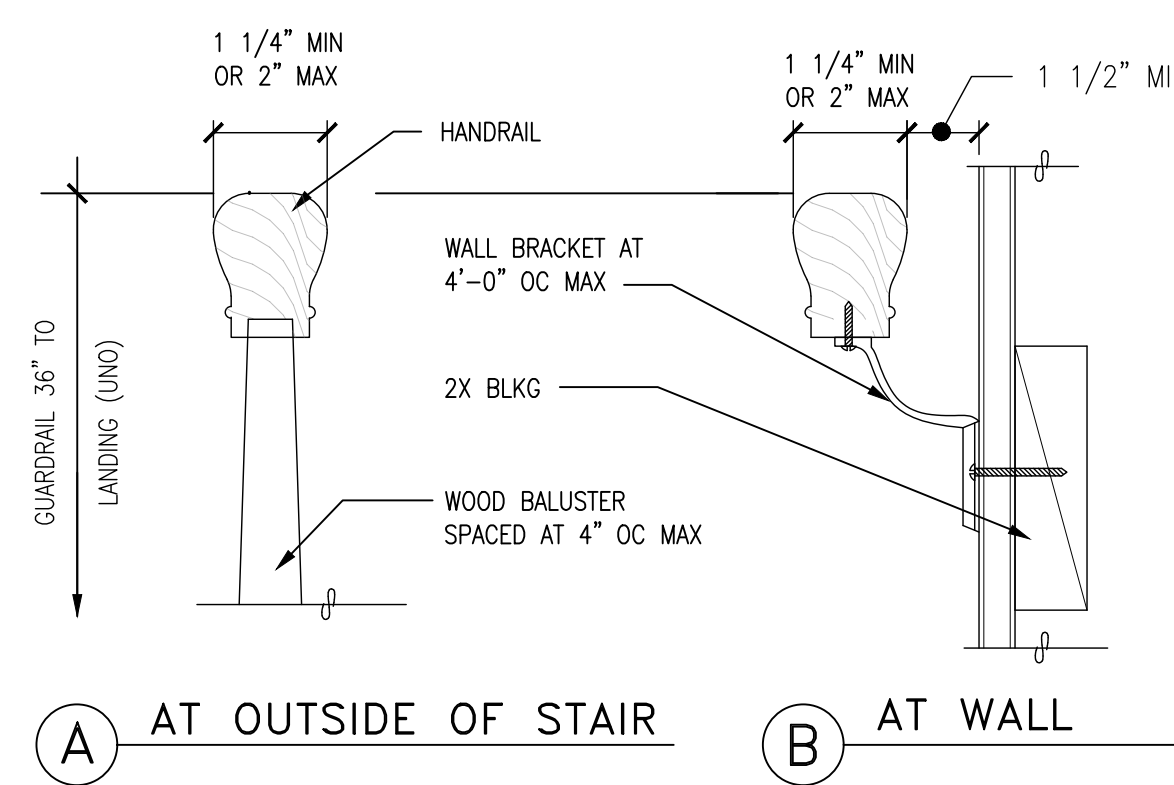

3 TYPICAL HANDRAIL REQUIREMENT
 SCALE: NTS

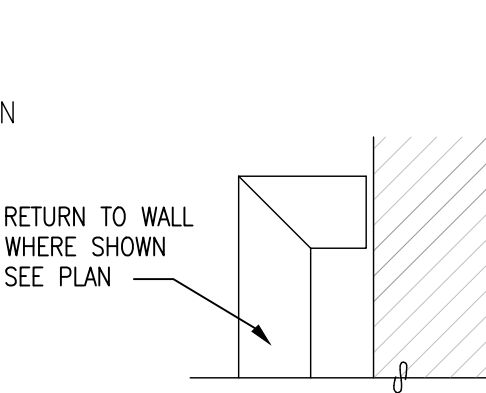

C PLAN

NOTE: HANDRAIL & INSTALLATION SHALL MEET THE REGS OF THE 2018 IRC. FOR SPECIFIC CODE REGS FOR GUARD & HANDRAILS SEE DETAILS THIS PAGE

HANDRAIL AND GUARDRAILS SHALL BE CONSTRUCTED AS FOLLOWS:


GUARDRAILS SHALL NOT BE LESS THAN 36" IN HEIGHT. HANDRAILS SHALL NOT BE LESS THAN 34" OR MORE THAN 38" IN HEIGHT ABOVE THE STAIR NOSING.

OPEN RAILS SHALL HAVE INTERMEDIATE RAILS OR AN ORNAMENTAL PATTERN SUCH AS A 4" DIAMETER SPHERE CANNOT PASS THROUGH.

THE TRIANGULAR OPENINGS AT STAIR TREAD, RISER & BOTTOM SHALL BE SUCH AS A 6" DIAMETER SPHERE CANNOT PASS THROUGH.

THE HANDRAIL CONSTRUCTION SHALL BE ABLE TO RESIST A LOAD OF 200 LBS APPLIED IN ANY DIRECTION AT ANY POINT ALONG THE TOP RAIL.

THIS DIAGRAM ILLUSTRATES THE SPECIFIC REQUIREMENTS OF THE BUILDING CODE AND IS ONLY AN AID FOR CONSTRUCTION

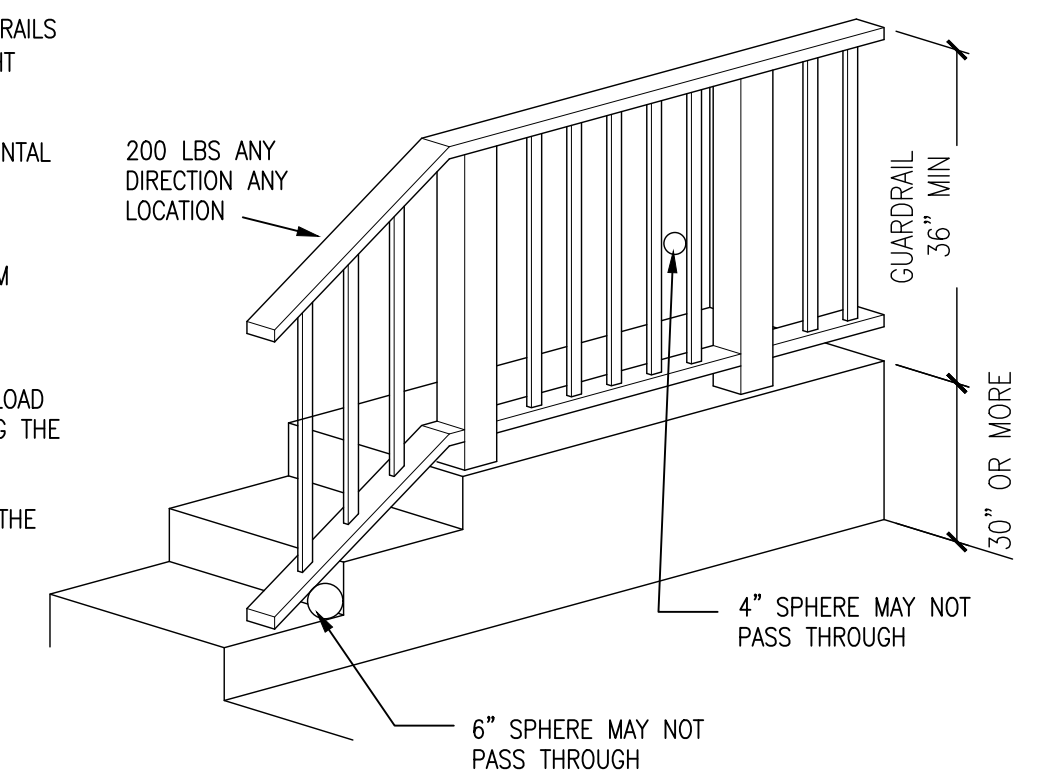

2 TYPICAL HANDRAIL / GUARDRAIL DETAIL
 SCALE: NTS

Sterba Mironova
 Residence
 Addition
 9811 SE 40th St
 Mercer Island, WA 98040

Permit
 Set

Date:	Description:
6/4/21	Permit Intake
1/12/22	Correction 01
3/15/22	Correction 02

Project No.: 2105.00
 Drawn:

SECTION
 &
 DETAILS

Sheet No:

A7.0

STRUCTURAL NOTES

01000: GENERAL REQUIREMENTS
THE STRUCTURAL NOTES SUPPLEMENT THE PLANS AND SPECIFICATIONS. ANY DISCREPANCY FOUND BETWEEN THE DRAWINGS, NOTES, SPECIFICATIONS, SITE CONDITIONS, AND ARCHITECTURAL PLANS SHALL BE REPORTED TO THE ARCHITECT WHO SHALL CORRECT THE DISCREPANCY IN WRITING. ANY WORK COMPLETED AFTER DISCOVERY OF THE DISCREPANCY SHALL BE DONE AT THE CONTRACTOR'S RISK. REFER TO ARCHITECTURAL PLANS FOR OPENINGS, ARCHITECTURAL TREATMENTS, AND DIMENSIONS NOT SHOWN. CONSULT MECHANICAL PLANS FOR DUCTS AND PIPES ETC. NOT SHOWN.

THE CONTRACTOR SHALL PROVIDE BRACING AND SUPPORT REQUIRED FOR TEMPORARY CONSTRUCTION LOADS AND FOR STRUCTURAL COMPONENTS AS REQUIRED DURING ERECTION. BACKFILL BEHIND WALLS SHALL NOT BE PLACED UNTIL THE WALLS ARE PROPERLY SUPPORTED.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION OF ALL WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION OF THE EXCAVATION, SHORING, AND OTHER WORK WITH ALL UTILITIES AND ADJACENT PROPERTIES. CALL THE UTILITY LOCATE SERVICE PRIOR TO ANY WORK AT 1-800-424-5555.

01100: CODE REQUIREMENTS
ALL DESIGN AND CONSTRUCTION SHALL CONFORM TO THE 2018 INTERNATIONAL BUILDING CODE AS ADOPTED BY THE CITY OF MERCER ISLAND.

01200: DESIGN LOADS (RE: S9.1)

LIVE LOADS	
ROOF LIVE	20 PSF
FLOORS (RESIDENTIAL)	40 PSF
DECK	60 PSF

SNOW LOAD DESIGN DATA:
Pg = 20 PSF, Pf = 14 PSF, Ce = 1.0, Is = 1.0, Ct = 1.0
ROOF RAIN-ON-SNOW 25 PSF

AUXILIARY LOAD:
ROOF SOLAR-READY 5 PSF (ENTIRE ROOF)

WIND DESIGN DATA:
BASIC WIND SPEED: 110 MPH (3-SECOND GUST)
WIND IMPORTANCE FACTOR: Iw = 1.0
WIND EXPOSURE: EXPOSURE C
TOPOGRAPHICAL FACTOR: Kzt = 1.3
INTERNAL PRESSURE COEFFICIENT: GCpi = +/- 0.18
COMPONENT/CLADDING WIND PRESSURE: P(C) = 42 PSF*Kzt (ULT)

EARTHQUAKE DESIGN DATA (BOTH BUILDINGS):
SEISMIC IMPORTANCE FACTOR: Ie = 1.0
SPECTRAL RESPONSE ACCELERATIONS: Ss = 1.402, S1 = 0.488
SITE CLASS: SITE CLASS D
SPECTRAL RESPONSE COEFFICIENTS: SDS = 1.122, SD1 = NULL
SEISMIC DESIGN CATEGORY: SEISMIC DESIGN CATEGORY D
BASIC FORCE RESISTING SYSTEM: BEARING WALL SYSTEM
RESPONSE MODIFICATION FACTOR: R = 6.5 (LIGHT FRAME WALLS)
ANALYSIS PROCEDURE: EQUIVALENT LATERAL FORCE

01300: GEOTECHNICAL INFORMATION
EARTHWORK AND FOUNDATIONS SHALL BE CONSISTENT WITH THE GEOTECHNICAL ENGINEERING RECOMMENDATIONS.

THE GEOTECHNICAL DESIGN REPORT PREPARED BY:
GEO TECH CONSULTANTS, INC. REPORT NO. JN21455 DATED: NOVEMBER 22, 2021

ALL SITE PREPARATION AND FOUNDATION CONSTRUCTION TO OVERSEEN BY GEO TECH CONSULTANTS. ALL PILE PILES SHALL BE INSTALLED AND APPROVED UNDER THE CONTINUOUS AND DIRECT OBSERVATION OF THE GEOTECHNICAL SPECIAL INSPECTOR WITH LOG CONFIRMING EACH PILE DRIVEN IN ACCORDANCE WITH SOILS REPORT REFUSAL CRITERIA ALSO LISTED BELOW

ALL FILLS TO BE INSTALLED PER GEOTECHNICAL REPORT RECOMMENDATIONS AND ONSITE GEOTECHNICAL ENGINEERING APPROVAL.

ALL FOUNDATIONS SHALL BE FOUNDED ON PIPE PILE OR BY OTHER MEANS AS DEFINED BY THE GEOTECHNICAL ENGINEER.

GEOTECHNICAL DESIGN PARAMETERS ARE LISTED BELOW:

3" DIA. PIPE PILE 24KIP ULT. AXIAL CAPACITY (12K ALLOW W/2.0 SAFETY FACTOR)
PASSIVE PRESSURE 250 PSF/FT

ALL FOUNDATION INSTALLATIONS SHALL BE SUBJECT TO APPROVAL OF THE GEOTECHNICAL ENGINEER. PIPE PILE:

INSTALLATION REQUIREMENTS:

THREE INCH DIAMETER (NOMINAL) PIPE PILES SHALL CONSIST OF STANDARD (SCHD. 40) "BLACK" (NON-GALV.) ASTM A53 GRADE B STEEL PIPE AND BE DRIVEN TO F.D.R. DEFINED BY:

F.D.R. (FINAL DRIVING RATE) TO ACHIEVE LESS THAN 1 INCH PENETRATION IN 10 SEC OVER THREE CONSECUTIVE CYCLES WITH 850-LB HYDRAULIC JACK-HAMMER

FLAT-WORK:
TO AVOID SETTLEMENT, A STRUCTURAL SLAB WILL SPAN BETWEEN GRADE BEAMS.

01330: SHOP DRAWING SUBMITTAL PROCESS

SHOP DRAWINGS ARE TO BE SUBMITTED TO THE ARCHITECT AND ENGINEER OF RECORD FOR APPROVAL PRIOR TO FABRICATION. IF SHOP DRAWINGS DIFFER FROM THE APPROVED DESIGN DRAWINGS, NEW DESIGN DRAWINGS BEARING THE SEAL AND SIGNATURE OF A LICENSED WASHINGTON STATE STRUCTURAL ENGINEER SHALL BE SUBMITTED ALONG WITH THE SHOP DRAWINGS TO THE APPROPRIATE JURISDICTION FOR APPROVAL PRIOR TO FABRICATION.

SHOP DRAWINGS SHALL BE REQUIRED FOR THE FOLLOWING:

- PIPE PILE STEEL SHOPS

01400: INSPECTIONS AND SPECIAL INSPECTIONS
THE CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE ALL INSPECTIONS REQUIRED BY THE LOCAL BUILDING DEPARTMENT.

SPECIAL INSPECTIONS ARE NOT REQUIRED FOR GROUP R-3 OCCUPANCIES UNLESS OTHERWISE REQUIRED BY THE BUILDING OFFICIAL.

01401: STRUCTURAL OBSERVATION
STRUCTURAL OBSERVATION IS NOT REQUIRED.

01700: EXECUTION REQUIREMENTS
INSTALLATION OF ALL STRUCTURAL COMPONENTS SHALL BE AS REQUIRED PER ALL LOCAL CODES.

02000: SITE CONSTRUCTION
ALL SITE CONSTRUCTION SHALL BE CONSISTENT WITH THE GEOTECHNICAL ENGINEERING RECOMMENDATIONS AS NOTED IN THE GEOTECHNICAL ENGINEERING REPORT (SEE SECTION 01300) AND IN SUBSEQUENT DIRECTIVES.

02260: EXCAVATION SUPPORT AND PROTECTION
EXCAVATION FOR FOUNDATIONS SHALL BE PER PLAN DOWN TO UNDISTURBED NATIVE MATERIAL PER THE GEOTECHNICAL ENGINEERING RECOMMENDATIONS. OVER-EXCAVATED AREAS SHALL BE BACKFILLED WITH LEAN CONCRETE OR PER GEOTECHNICAL RECOMMENDATIONS AT THE CONTRACTOR'S EXPENSE.

EXCAVATION SLOPES SHALL BE SAFE AND SHALL NOT BE GREATER THAN THE LIMITS SPECIFIED BY LOCAL, STATE, AND NATIONAL SAFETY REGULATIONS.

INSTALLATION OF CONSTRUCTION SHORING, IF REQUIRED, SHALL BE PER THE SHORING DRAWINGS, NOTES, AND SPECIFICATIONS.

02300: BACKFILL AND COMPACTION
BACKFILL SHALL NOT BE PLACED UNTIL THE REMOVAL OF FORMWORK AND OF ANY DEBRIS. BACKFILL BEHIND ALL WALLS SHALL NOT BE PLACED UNTIL THE WALLS ARE PROPERLY SUPPORTED. ALL BACKFILL MATERIAL AND PLACEMENT PROCEDURES SHALL BE CONSISTENT WITH THE GEOTECHNICAL ENGINEERING RECOMMENDATIONS.

02832: SEGMENTAL RETAINING WALLS
SEGMENTAL RETAINING WALLS AND MECHANICALLY STABILIZED EARTH (MSE) RETAINING WALLS SHALL BE DESIGNED BY OTHERS.

03000: CONCRETE
CONCRETE CONSTRUCTION SHALL CONFORM TO THE AMERICAN CONCRETE INSTITUTE STANDARD ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE".

CEMENT AND CONCRETE SHALL CONFORM TO IBC SECTION 1903. ADMIXTURES SHALL BE APPROVED BY THE ENGINEER OF RECORD AND SHALL COMPLY WITH ACI 318 SECTION 3.6. CONCRETE EXPOSED TO FREEZING AND THAWING SHALL HAVE AN AIR ENTRAINING ADMIXTURE CONFORMING TO IBC SECTION 1904.2. THE USE OF WATER SOLUBLE CHLORIDE ION SHALL NOT BE USED.

THE CONTRACTOR SHALL SUBMIT MIX DESIGNS TO ENGINEER OF RECORD FOR APPROVAL FOUR WEEKS PRIOR TO PLACING CONCRETE. MIX DESIGNS SHALL BE REVIEWED FOR CONFORMANCE TO IBC SECTIONS 1904 AND 1905.

CONCRETE HAS BEEN DESIGNED FOR $f'_c=2500$ PSI. FOR QUALITY ASSURANCE, CONCRETE MIX DESIGNS SHALL MEET THE FOLLOWING REQUIREMENTS:

28 DAY STRENGTH f'_c (PSI) RATIO	MAX. W/C	MAX. SLUMP	AIR ENTRAINMENT (%)	SPECIAL INSPECTION	LOCATION APPLICATION
3000	0.45	4±1	0±1	NO	FOOTINGS
3000	0.45	4±1	5±1	NO	FOUNDATION WALLS
3000	0.45	4±1	5±1	NO	SLAB ON GRADE, PATIOS
3000	0.45	4±1	5±1	NO	CURBS, WALKS, DRIVES

ONE COMPRESSION TEST MINIMUM SHALL BE COMPILED FOR EVERY 150 CUBIC YARDS OR 5000 SQUARE FEET OF SURFACE AREA FOR EACH MIX DESIGN PLACED EACH DAY. A TEST SHALL BE THE AVERAGE STRENGTH OF TWO CYLINDERS MADE FROM THE SAME SAMPLE AND TESTED AT THE SPECIFIED AGE. ADDITIONAL CYLINDERS MAY BE MADE FOR INFORMATION REGARDING POST TENSIONING, FORM REMOVAL, STRENGTH DEVELOPMENT, OR OTHER PURPOSES. CONCRETE SHALL BE ACCEPTABLE IF:
1. NO TEST FALLS 500 PSI BELOW THE SPECIFIED STRENGTH
2. THE AVERAGE OF ALL SETS OF 3 CONSECUTIVE TESTS DOES NOT FALL BELOW THE SPECIFIED STRENGTH.

CONCRETE NOT MEETING THE ABOVE CRITERIA SHALL BE SUBJECT TO FURTHER TESTING AT NO ADDITIONAL EXPENSE TO THE OWNER.

RESHORING, WHERE REQUIRED, SHALL CONFORM TO ACI 301 SECTION 4.6. SUBMIT PROPOSED RESHORING PLANS TO THE ENGINEER OF RECORD FOR REVIEW.

CHAMFER ALL EXPOSED CORNERS PER THE ARCHITECTURAL PLANS OR 3/4 INCH IF NOT SPECIFIED BY THE ARCHITECT.

REFER TO "01300" FOR APPROVAL PRIOR TO FORMWORK.

03100: REINFORCING STEEL
REINFORCING STEEL DETAILING, FABRICATION, AND PLACEMENT SHALL BE PER ACI 318. REINFORCING STEEL SHALL MEET THE FOLLOWING REQUIREMENTS:

ASTM A-615 DEFORMED BARS GRADE 40 ($f_y=40$ KSI) FOR #3 BARS ONLY
ASTM A-615 DEFORMED BARS GRADE 60 ($f_y=60$ KSI) FOR #4 BARS AND LARGER
ASTM A-706 DEFORMED BARS GRADE 60 ($f_y=60$ KSI) FOR ALL WELDABLE BARS
ASTM A-185 SMOOTH BAR ($f_y=60$ KSI) FOR WELDED WIRE FABRIC

REINFORCING FOR SLABS ON GRADE SHALL BE 12X12 W5X5 WELDED WIRE FABRIC OR FIBER MESH UNLESS NOTED OTHERWISE. PROVIDE LAP SPLICES PER THE LAP SPLICE SCHEDULE ON SHEET S6.1. REINFORCING STEEL AT ALL WALLS, SLABS, AND FOOTINGS SHALL BE CONTINUOUS AROUND CORNERS ELSE CORNER BARS SHALL BE PROVIDED.

COVER REQUIREMENTS SHALL BE AS FOLLOWS UNLESS NOTED OTHERWISE:

CONCRETE CAST AGAINST EARTH	ALL BAR SIZES	3"
FORMED SURFACE EXPOSED TO EARTH OR WEATHER	#6 AND LARGER	2"
	#5 AND SMALLER	1 1/2"
CONCRETE NOT EXPOSED TO EARTH OR WEATHER	WALLS AND JOISTS	
	#14 AND #18 BARS	1 1/2"
	#11 BARS AND SMALLER	3/4"
SLABS AND JOISTS		
	#14 AND #18 BARS	1 1/2"
	#11 BARS AND SMALLER	1"
BEAMS, COLUMNS		
	PRIMARY REINFORCEMENT	1 1/2"
	TIES, STIRRUPS, AND SPIRALS	1 1/2"

REINFORCING STEEL SHALL BE ACCURATELY PLACED AND ADEQUATELY SECURED IN PLACE PRIOR TO CONCRETE PLACEMENT. REINFORCING STEEL SHALL NOT BE FIELD BENT EXCEPT AS NOTED IN THE DESIGN DRAWINGS. WELDING OF REINFORCING STEEL SHALL NOT BE PERMITTED WITHOUT PRIOR APPROVAL OF THE ENGINEER OF RECORD EXCEPT AS NOTED ON THE DESIGN DRAWINGS.

06071: PRESERVATIVE TREATED WOOD PRODUCTS
PRESERVATIVE TREATED WOOD SHALL BE REQUIRED FOR:

ALL WOOD THAT FORMS THE STRUCTURAL SUPPORT OF THE BUILDING, BALCONIES PORCHES, OR SIMILAR PERMANENT BUILDING APPURTENANCES THAT ARE EXPOSED TO THE WEATHER WITHOUT ADEQUATE PROTECTION FROM A ROOF, EAVE, OVERHANG OR OTHER COVERING TO PREVENT MOISTURE OR WATER ACCUMULATION AT THE SURFACE OR AT JOINTS BETWEEN MEMBERS.

ALL WOOD INSTALLED ABOVE GROUND AND RESTING ON AN EXTERIOR CONCRETE OR MASONRY FOUNDATION WILL LESS THAN 8 INCHES FROM EXPOSED EARTH.

POSTS OR COLUMNS SUPPORTING PERMANENT STRUCTURES AND SUPPORTED BY A CONCRETE SLAB OR FOOTING THAT IS IN DIRECT CONTACT WITH THE EARTH. EXCEPT:

- IF LOCATED IN BASEMENTS ON A CONCRETE PIER OR METAL PEDESTAL 1 INCH ABOVE THE SLAB AND SEPARATED THEREFROM BY AN IMPERVIOUS MOISTURE BARRIER.
- IF IN AN ENCLOSED CRAWL SPACE OR AN UNEXCAVATED AREA WITHIN THE BUILDING PERIPHERY AND SUPPORTED BY A CONCRETE PIER OR PEDESTAL MORE THAN 8 INCHES FROM EXPOSED GROUND AND SEPARATED THEREFROM BY AN IMPERVIOUS MOISTURE BARRIER.
- SLEEPERS AND SILLS ON A CONCRETE SLAB ON GRADE THAT DOES NOT HAVE AN IMPERVIOUS MOISTURE BARRIER SEPARATION WITH EXPOSED EARTH.
- LEDGERS AND FURRING ATTACHED DIRECTLY TO THE INTERIOR OF EXTERIOR CONCRETE OR MASONRY WALLS BELOW GRADE.

PRESERVATIVE TREATMENT SHALL BE PER AMERICAN WOOD PRESERVERS' ASSOCIATION (AWPA) SPECIFICATION C2 AND C9 OR APPLICABLE STANDARDS.

ALL FASTENERS (NAILS, BOLTS, MASAS, ANCHORS, PLATES, HANGERS, ETC.) IN CONTACT WITH TREATED LUMBER SHALL BE CORROSION RESISTANT G-185 HOT DIPPED GALVANIZED PER ASTM A153 OR STAINLESS STEEL.

06100: ROUGH FRAMING

SAWN LUMBER SHALL CONFORM TO WEST COAST LUMBER INSPECTION BUREAU (WCLIB) "GRADING AND DRESSING RULES" NO. 17, LATEST EDITION. SAWN LUMBER SHALL BE S4S AND SURFACED DRIED, 19 PERCENT MAXIMUM MOISTURE CONTENT. PROTECT LUMBER FROM WEATHER AND PROVIDE FURTHER DRYING OF ASSEMBLED FRAMING TO MINIMIZE WOOD SHRINKAGE POTENTIAL. ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESERVATIVE TREATED U.N.O. PER PLAN. LUMBER SPECIES, GRADE, AND PROPERTIES FOR EACH USE/LOCATION SHALL BE AS FOLLOWS U.N.O. PER PLAN/SCHEDULE:

SIZE	SPECIES	GRADE	Fb (PSI)	Fv (PSI)	Fcp (PSI)	Fc (PSI)	E (PSI)
2X,4X	DOUGLAS FIR-LARCH	NO. 2	900	180	625	1350	1.6E8
6X	DOUGLAS FIR-LARCH	NO. 1	1200	170	625	1000	1.6E8

06101: STRUCTURAL FINGER JOINTED LUMBER

STRUCTURAL FINGER JOINTED LUMBER SHALL BE PERMITTED TO BE USED INTERCHANGEABLY WITH SAWN LUMBER MEMBERS OF THE SAME SPECIES AND GRADE. STRUCTURAL FINGER JOINTED LUMBER SHALL BE GRADED UNDER AMERICAN LUMBER STANDARD COMMITTEE "PRODUCT STANDARD PS 20-99" LUMBER CLASSIFIED AS STUD USE ONLY SHALL BE LIMITED TO VERTICAL APPLICATIONS ONLY. LUMBER WITH CERTIFIED EXTERIOR JOINTS IS NOT RESTRICTED TO ANY TYPE OF LOADING.

06102: FRAMING NOTES

FRAMING CONNECTORS, ACCESSORIES, AND FASTENERS AS NOTED IN THE PLANS AND DETAILS SHALL BE AS MANUFACTURED BY SIMPSON STRONG-TIE. EQUIVALENT HARDWARE MAY BE USED WITH PRIOR APPROVAL BY ENGINEER OF RECORD. INSTALL ALL HARDWARE PER MANUFACTURERS' SPECIFICATIONS. WHERE STRAPS CONNECT TWO MEMBERS TOGETHER, PLACE HALF OF THE REQUIRED FASTENERS INTO EACH MEMBER. PROVIDE SOLID BLOCKING AT ALL BEARING POINTS. SEE SECTION 06071 FOR FASTENER REQUIREMENTS AT TREATED LUMBER. TYPICAL NAILING NOT SHOWN PER PLAN, DETAIL, OR SCHEDULE SHALL CONFORM TO FASTENING SCHEDULE PER IBC TABLE 2304.10.1 OR TO THE FASTENING SCHEDULE ON SHEET S1.0.

NAILS SHALL BE COMMON UNLESS NOTED OTHERWISE COMMON NAIL DIMENSIONS ARE AS FOLLOWS:

NAIL SIZE	DIAMETER	LENGTH
8d	0.131"	2.5"
10d	0.148"	3.0"
12d	0.148"	3.25"
16d	0.162"	3.5"

UNLESS NOTED OTHERWISE PER SHEARWALL SCHEDULE OR PLANS, MASA AT SILL PLATES SHALL BE PLACED AT 48" O.C. PER 5/S1.2. THERE SHALL BE A MINIMUM OF MASA PER SILL PIECE WITH ONE BOLT LOCATED NOT MORE THAN 12 INCHES NOR LESS THAN 8 INCHES FROM EACH END OF THE PIECE.

06103: JOIST AND BEAM HANGERS

JOIST AND BEAM HANGERS AS NOTED IN THE PLANS SHALL BE AS MANUFACTURED BY SIMPSON STRONG-TIE. EQUIVALENT HARDWARE MAY BE USED WITH PRIOR APPROVAL BY ENGINEER OF RECORD. JOIST AND BEAM HANGERS SHALL BE INSTALLED PER MANUFACTURERS' SPECIFICATIONS AND SHALL BE AS FOLLOWS UNLESS NOTED OTHERWISE PER PLANS OR DETAILS:

MEMBER SIZE	HANGER
SAWN LUMBER	"LUS" SERIES TO MATCH LUMBER SIZE
MANUFACTURED WOOD "I" JOIST	"LUS" SERIES TO MATCH "I" JOIST SIZE
1.75" WIDE PSL OR LVL BEAM	"LBY" SERIES TO MATCH DEPTH
2.69" WIDE PSL BEAM	"LBY" SERIES TO MATCH DEPTH
3.5" WIDE PSL OR LVL BEAM	"GLTV" SERIES TO MATCH DEPTH
5.25" WIDE PSL OR LVL BEAM	"GLTV" SERIES TO MATCH DEPTH
7" WIDE PSL BEAM	"HGLTV" SERIES TO MATCH DEPTH

06104: SHRINKAGE OF WOOD FRAMING
SHRINKAGE IN WOOD FRAMING IS DUE TO LOSS OF MOISTURE CONTENT AND TO COMPRESSION OF ASSEMBLES OF WOOD COMPONENTS. PLUMBING, ELECTRICAL, AND MECHANICAL SYSTEMS AS WELL AS EXTERIOR FINISHES SHALL BE DESIGNED AND BUILT TO ACCOMMODATE 3/8 INCH PER FLOOR WOOD SHRINKAGE. THE USE OF KILN DRIED LUMBER AND PROVIDING A DRYING PROCESS TO THE FRAMING MEMBERS PRIOR TO APPLICATION OF FINISHES WILL HELP CONTROL BUT WILL NOT ELIMINATE SHRINKAGE.

06160: WOOD SHEATHING

WOOD STRUCTURAL PANELS (WSP) SHALL HAVE APA GRADE TRADEMARK OF THE AMERICAN PLYWOOD ASSOCIATION. WOOD SHEATHING PANELS SHALL BE C-D INT APA WITH EXTERIOR GLUE (CDX). ORIENTED STRAND BOARD (OSB) PANELS SHALL BE EXPOSURE 1. PANELS SHALL HAVE THE FOLLOWING THICKNESS, SPAN RATING, AND FASTENING UNLESS NOTED OTHERWISE PER PLAN:

ROOF:	EDGE NAILS	FIELD NAILS
APA 40:20 C-D W/EXTERIOR GLUE	10d AT 6"	10d AT 12"
FLOOR DECKS:	EDGE NAILS	FIELD NAILS
STURD-I-FLOOR OSB 48/24 T&G	10d AT 6"	10d AT 12"
SHEARWALL:	EDGE NAILS	FIELD NAILS
C-D W/EXTERIOR GLUE, U.N.O.	RE: SCHEDULE SHEET S1.2	

ALL ROOF AND FLOOR SHEATHING PANELS SHALL BE INSTALLED FACE GRAIN PERPENDICULAR TO SUPPORTS AND IN A STAGGERED PATTERN UNLESS NOTED OTHERWISE PER PLAN. BLOCKING AT INTERMEDIATE FLOOR AND ROOF SHEATHING JOINTS SHALL NOT BE REQUIRED UNLESS NOTED OTHERWISE PER PLAN. SHEARWALL SHEATHING SHALL BE BLOCKED AT ALL EDGES WITH 2X OR 3X FRAMING PER SHEARWALL SCHEDULE. WHERE FRT ROOF PLY IS REQUIRED AT PARTY WALL STRENGTH PER MFR. SHALL BE EQUAL OR BETTER THAN 24/16 APA-RATED SPAN.

06165: STRUCTURAL GLUED LAMINATED TIMBER

GLUED LAMINATED MEMBERS SHALL HAVE AMERICAN INSTITUTE OF TIMBER CONSTRUCTION (AITC) IDENTIFICATION MARK. EXPOSED MEMBERS SHALL RECEIVE ONE COAT OF END SEALER APPLIED IMMEDIATELY AFTER TRIMMING IN EITHER SHOP OR FIELD. SHOP DRAWINGS SHALL BE SUBMITTED PER THE REQUIREMENTS OF SECTION 01330. DESIGN MATERIAL PROPERTIES SHALL BE AS FOLLOWS:

USE	COMBINATION	SYMBOL	SPECIES	LAYOUT
SIMPLE SPAN BEAM	24F-V4	DF/DF	STANDARD	
CONTINUOUS BEAM	24F-V8	DF/DF	BALANCED	
CANTILEVER BEAM	24F-V8	DF/DF	BALANCED	

UNEXPOSED GLUED LAMINATED TIMBER SHALL BE INDUSTRIAL GRADE. TYPICAL, UNLESS NOTED OTHERWISE. EXPOSED GLUED LAMINATED TIMBER SHALL BE APPEARANCE CLASS PER ARCHITECT.

06190: MANUFACTURED WOOD BEAMS

MANUFACTURED/ENGINEERED WOOD BEAMS SHALL BE THE SIZE AND TYPE SHOWN ON THE DRAWINGS AS MANUFACTURED BY TRUS-JOIST OR APPROVED EQUIVALENT STORAGE, ERECTION, AND INSTALLATION SHALL BE PER MANUFACTURER SPECIFICATIONS. MICROLAM AND PARALLAM MEMBERS SHALL NOT HAVE NOTCHES OR DRILLED HOLES WITHOUT PRIOR ENGINEER OF RECORD APPROVAL. SHOP DRAWINGS SHALL BE SUBMITTED PER THE REQUIREMENTS OF SECTION 01330. DESIGN MATERIAL PROPERTIES SHALL BE AS FOLLOWS:


MEMBER	E	Fb	Fcp	Fv	E MIN.
LVL (MICROLAM)	1.9E6	2600	750	285	965,710
PSL (PARALLAM)	2.0E6	2900	750	290	1,016,535
1.55E LSL (TIMBERSTRAND)	1.55E6	2325	800	310	787,815
LSL RIM (TIMBERSTRAND)	1.3E6	1700	680	400	660,750

STRUCTURAL DETAILS & NOTES SHEET INDEX

SHEET	DESCRIPTION	DATE
S1.1	STRUCTURAL GENERAL NOTES	03/10/22
S1.2	SHEARWALL SCHEDULE AND NOTES	03/10/22
S1.3	HOLD DOWN SCHEDULE AND NOTES	03/10/22
S2.1	FOUNDATION PLAN	03/10/22
S3.1	MAIN FLOOR FRAMING PLAN	03/10/22
S4.1	ROOF FRAMING PLAN	03/10/22
DETAILS		
S6.1	FOUNDATION DETAILS	03/10/22
S9.1	FRAMING DETAILS	03/10/22

ABBREVIATIONS

&	AND	IN.	INCH(E)
@	SHRINKAGE	INFO.	INFORMATION
AT	FEET(FOOT)	INT.	INTERIOR
"	INCH (INCHES)		
#	POUND(S), NUMBER	JST.	JOIST
=	EQUAL(S)	JT.	JOINT
/	PER	K	KIPS(1000)
A.B.	ANCHOR BOLT	LAT.	LATERAL
ABV.	ABOVE	LB.	POUND(S)
ADD.	ADDITIONAL	L.B.	LAG BOLT(S)
ADJ.	ADJACENT	L.G.	LONG(TUDINAL)
ALUM.	ALUMINUM	LGTH.	LENGTH
ALT.	ALTERNATE	LGTH.	LIGHT GAUGE METAL FRAMING
APPRX.	APPROXIMATE(LY)	LLH	LONG LEG HORIZONTAL
ARCH.	ARCHITECT(URAL)	LLV	LONG LEG VERTICAL
ASSY.	ASSEMBLY	LSH	LONG SLOTTED HOLE(S)
B.	BOTTOM	L.T. WT.	LIGHT WEIGHT
BEL.	BELOW	L.W.	LIGHT WEIGHT
BEN.	BOUNDARY EDGE NAILING	MAS.	MASONRY
B.F.	BRACED FRAME	MASN.	MASONRY
BUILD.	BUILDING	MAT.	MATERIAL
BULK.	BLOCKING	MAX.	MAXIMUM
BLW.	BELOW	M.B.	MACHINE BOLT
BM.	BEAM	MBM	METAL BUILDING MANUFACTURER
BMU	BRICK MASONRY UNIT	MECH.	MECHANICAL
BN	BOUNDARY NAILING	M.E.J.	MASONRY EXPANSION JOINT
BNDRY.	BOUNDARY	MEZZ.	MEZZANINE
B.O.	BOTTOM OF	MFR.	MANUFACTURER
B.O.E.	BOTTOM OF EXCAVATION	MIN.	MINIMUM
B.O.F.	BOTTOM OF FOOTING	MISC.	MISCELLANEOUS
BRDG.	BRIDGE(ING)	MTL.	METAL
BRG.	BEARING	(N)	NEW
BTTM.	BOTTOM	N/A	NOT APPLICABLE
B.TWN.	BETWEEN	N.L.B.	NON-LOAD BEARING
C	CAMBER	NO.	NUMBER
CAMB.	CAMBER(ED		

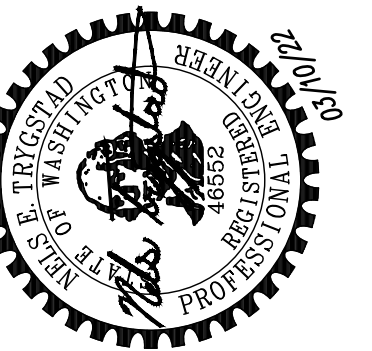

Sterba Mironova Addition
 9811 SE 40th St
 Mercer Island, WA 98040

Permit Set

Date:	Description:
05/17/21	Permit Set
10/15/21	Resubmittal
01/10/22	Resubmittal
03/10/22	Resubmittal

Project No.: CTE#21056
 Drawn:

HOLD DOWN SCHEDULE & NOTES

Sheet No:


S1.3

HOLDOWN & FASTENER SCHEDULE: HF STUDS

HARDWARE TYPE	WOOD MEMBER/POST		FASTENERS	NOTES	DETAILS
	2X4 WALL	2X6 WALL			
MST48	2X4	2X6	(50) 16d	CENTER ON RIM	15/S1.3
STHD14	(2)2X4	(2)2X6	(30) 12d	16" MIN. LAP PER END	14/S1.3
HTT5	(2)2X4	(2)2X6	(26)SD#10X1-1/2"	5/8" DIA. A.B.	EXIST.: 13/S1.3 NEW: 6/S6.1

HOLDOWN & FASTENER NOTES:


- HOLDOWNS SHALL BE AS MANUFACTURED BY THE SIMPSON STRONG-TIE COMPANY.
- 16D = .162" DIA. X 3 1/2" LONG.
- HTT5 ANCHOR MAY BE REPLACED WITH POST-INSTALLED 3/8" DIA. THREADED ROD EMBEDDED IN 3/4" DRILLED, CLEANED HOLE X 15" DEEP WITH SIMPSON "SET" OR "AT" ADHESIVE (RE: TEMPERATURE LIMITS ON PRODUCT); HDUB HOLD DOWN AND ANCHOR IS TO BE REPLACED WITH POST-INSTALLED STRAPS INSTALLED PER DETAIL 6.
- SCREWS ARE SDS 1/4" X 2 1/2" MANUFACTURED BY SIMPSON STRONG-TIE COMPANY.
- HOLDOWNS ANCHORS SHALL BE SECURED IN PLACE PRIOR TO PLACING CONCRETE.
- ANCHOR BOLT NUT SHOULD BE FINGER-TIGHT PLUS 1/3 - 1/2" TURN WITH HAND WRENCH. CARE SHOULD BE TAKEN TO NOT OVER-TORQUE THE NUT. IMPACT WRENCHES SHOULD NOT BE USED.
- HDU HOLDOWNS SHALL BE INSTALLED CENTERED ALONG THE WIDTH OF THE ATTACHED POST.
- RE: NOTES SECTION 06100 "ROUGH FRAMING" FOR THE REQUIRED POST SPECIES AND GRADE.
- HOLDOWNS ATTACH TO SHEARWALL END POST OR TO POST WITH STRAP ABOVE. LOCATE PER STRUCTURAL PLANS AND ARCHITECTURAL DIMENSIONS. INSTALL PER SIMPSON INSTALLATION RECOMMENDATIONS.

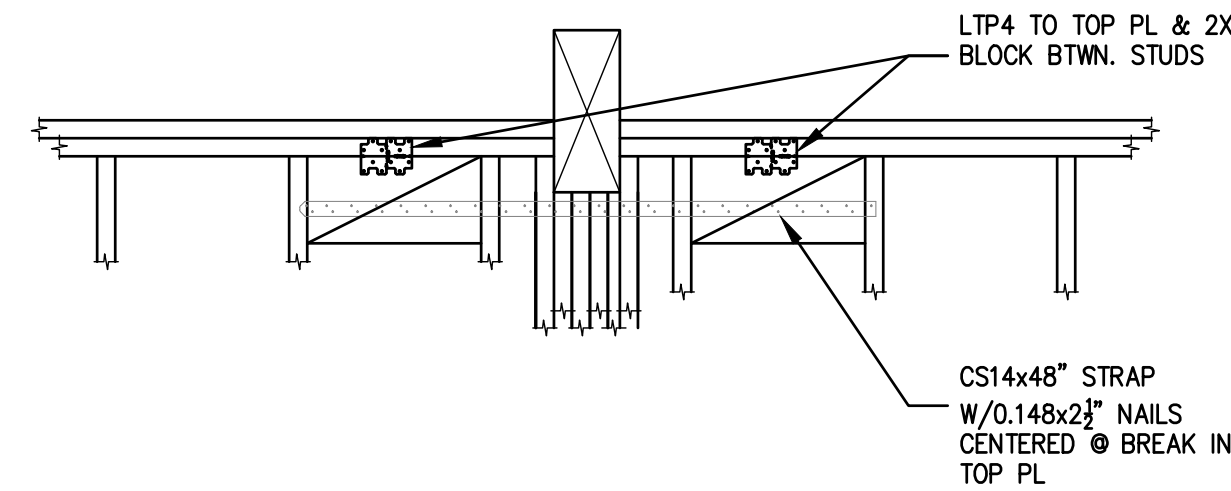

8 TOP PLATE INTERRUPTED BY BEAM


10

HOLDOWN & FASTENER SCHEDULE

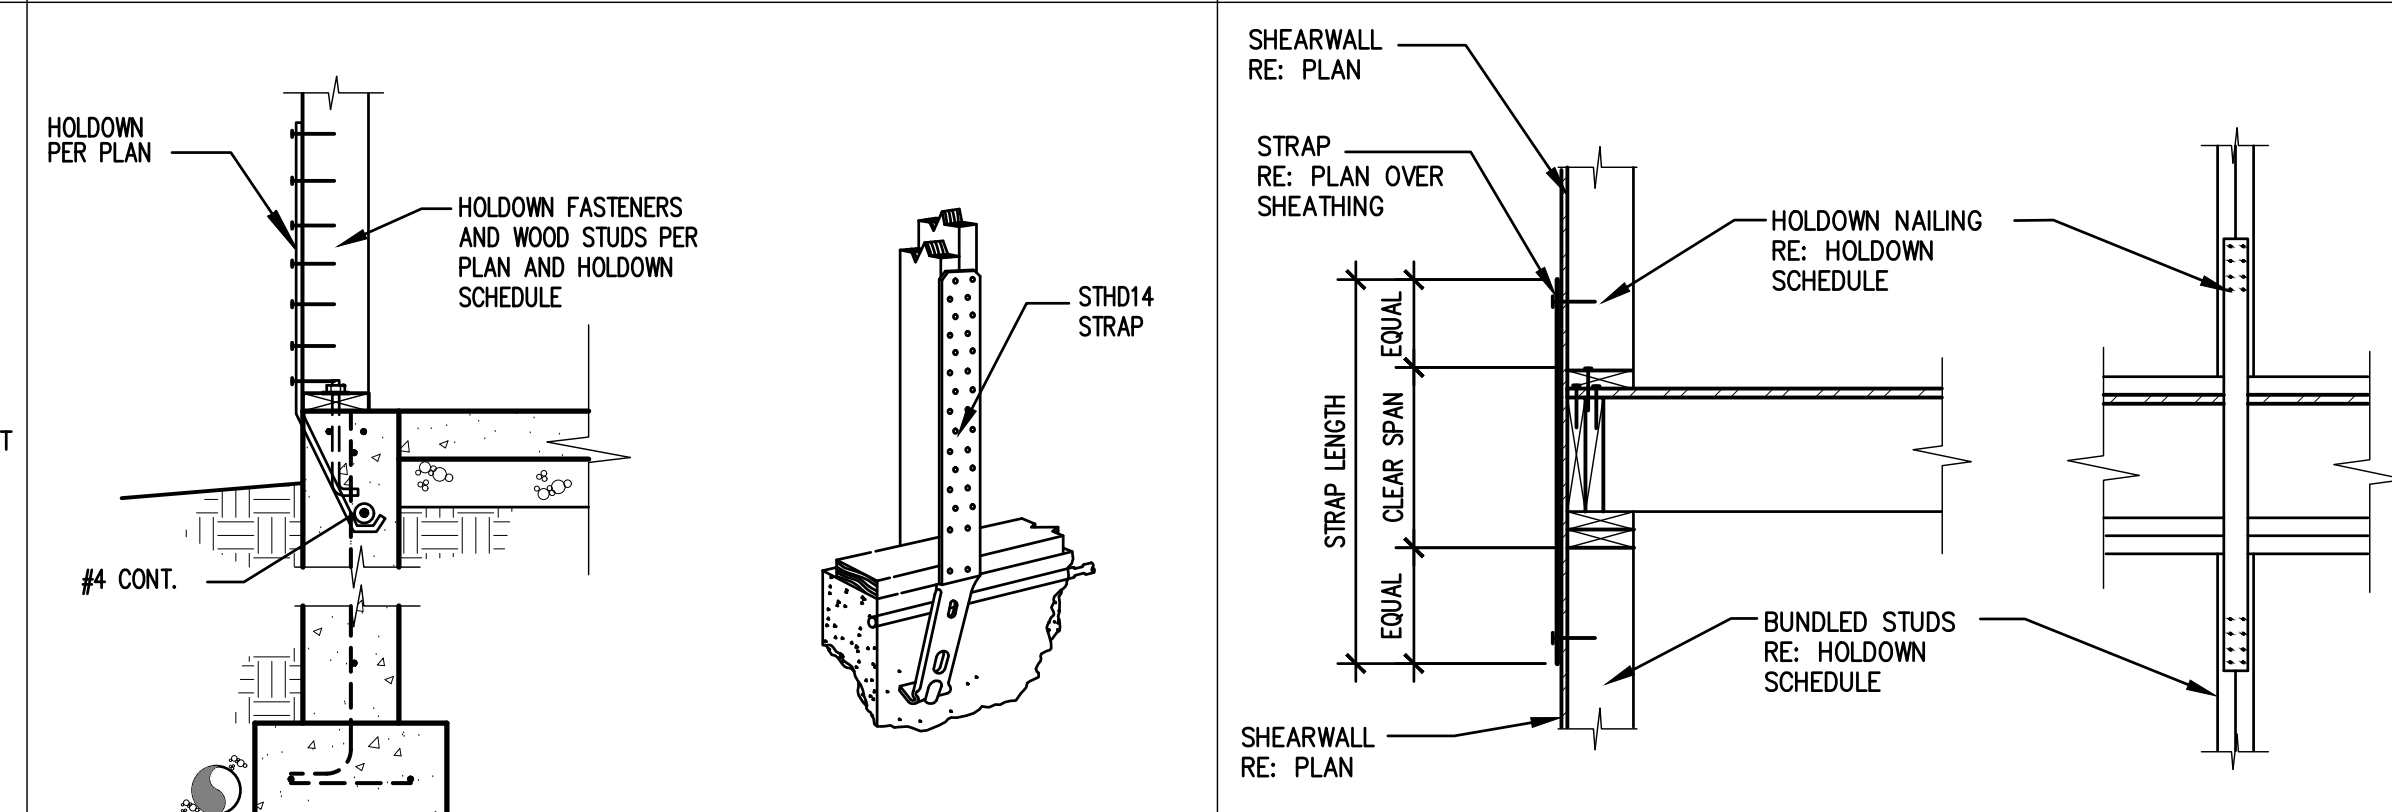


14 EXTERIOR HOLDOWN @ FOUNDATION


15 EXTERIOR HOLDOWN @ FLOOR

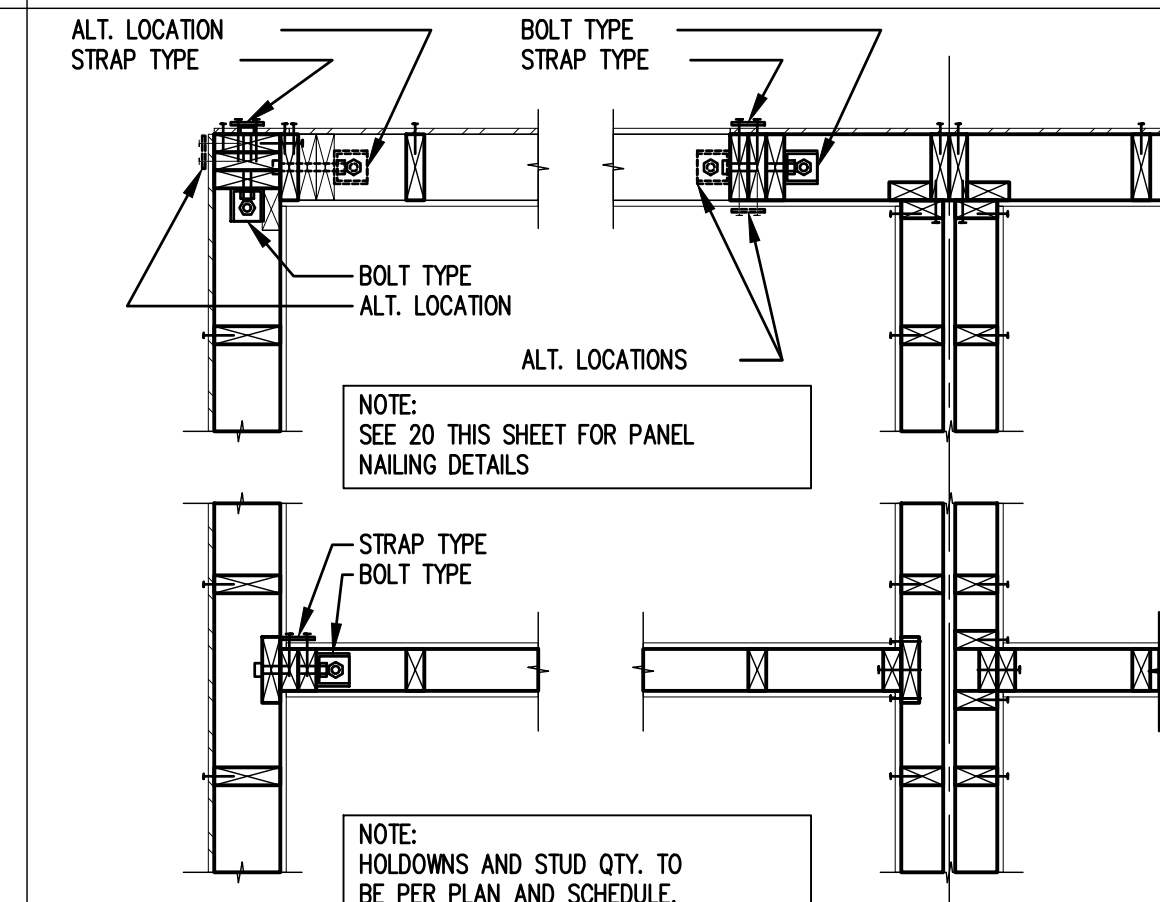


19 HOLDOWN PLACEMENTS

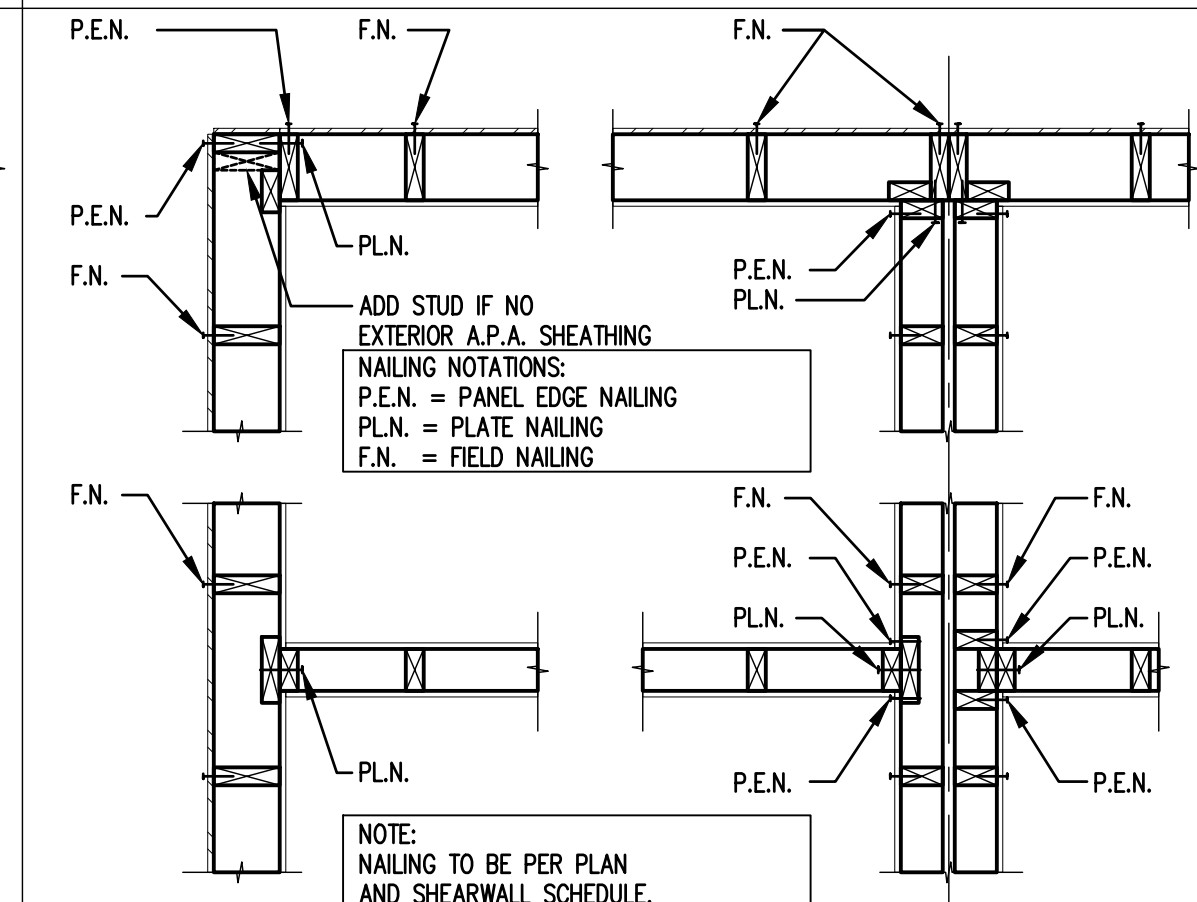


20 STRUCTURAL SHEARWALL INTERSECTIONS

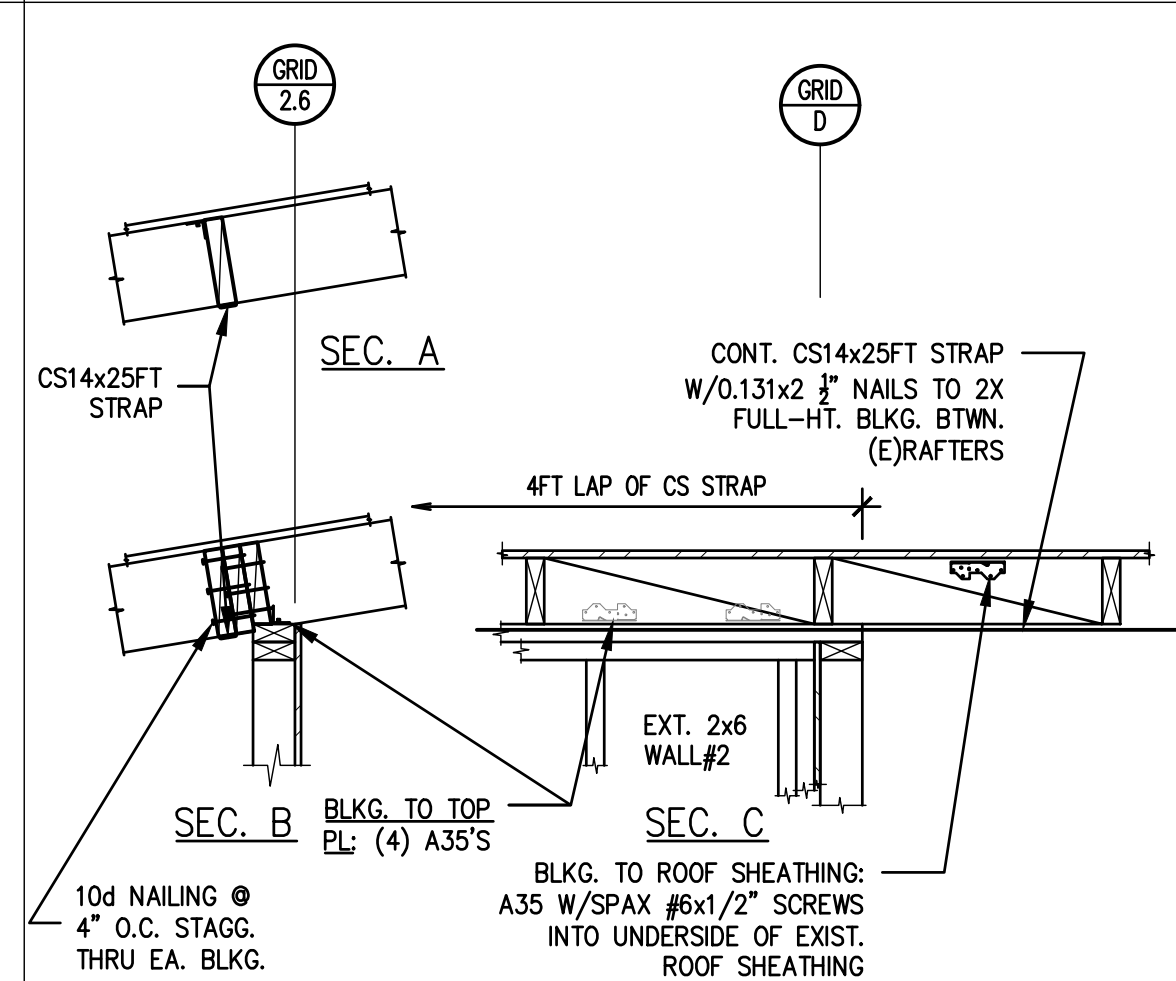


11 DRAG CONNECTION INTO WALL

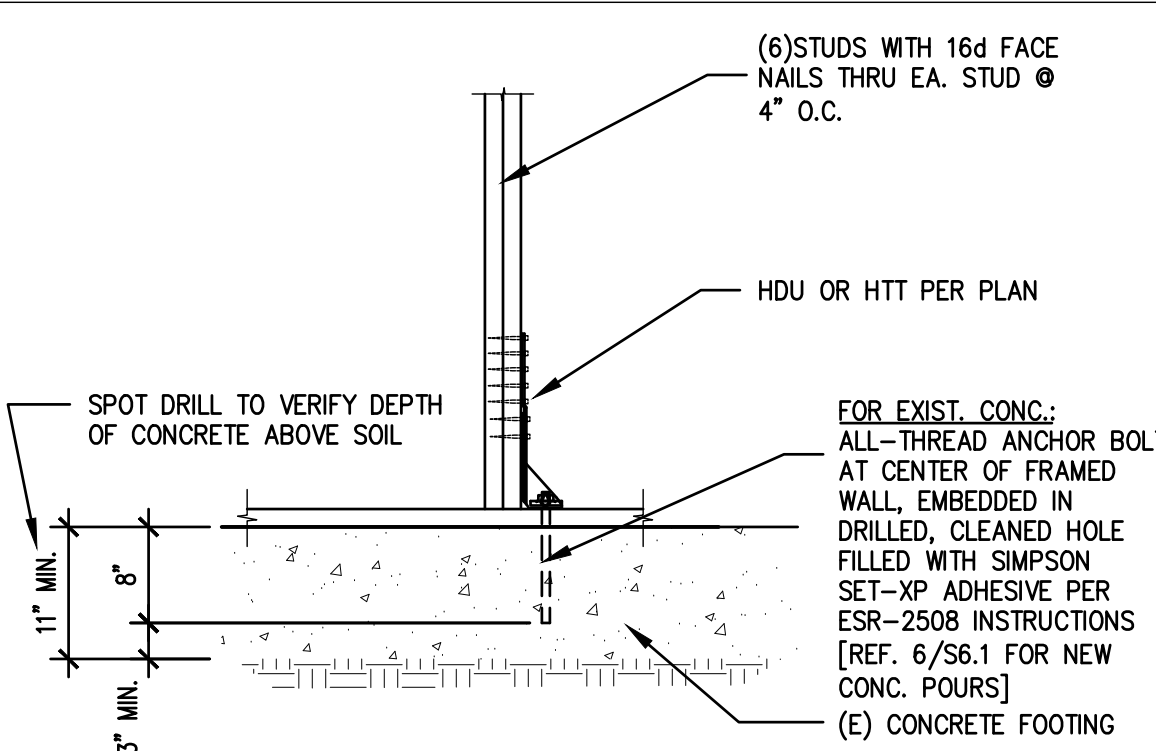


13 POST-INSTALLED HOLD DOWN

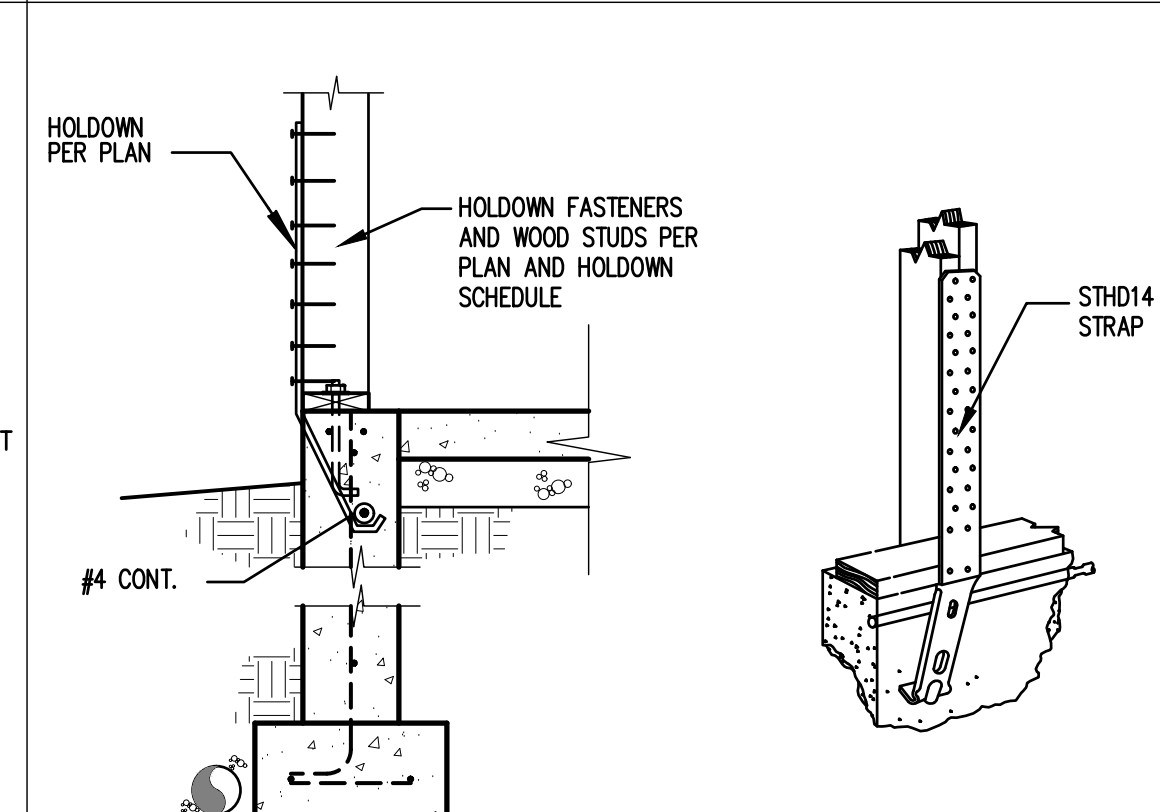


14 EXTERIOR HOLDOWN @ FOUNDATION

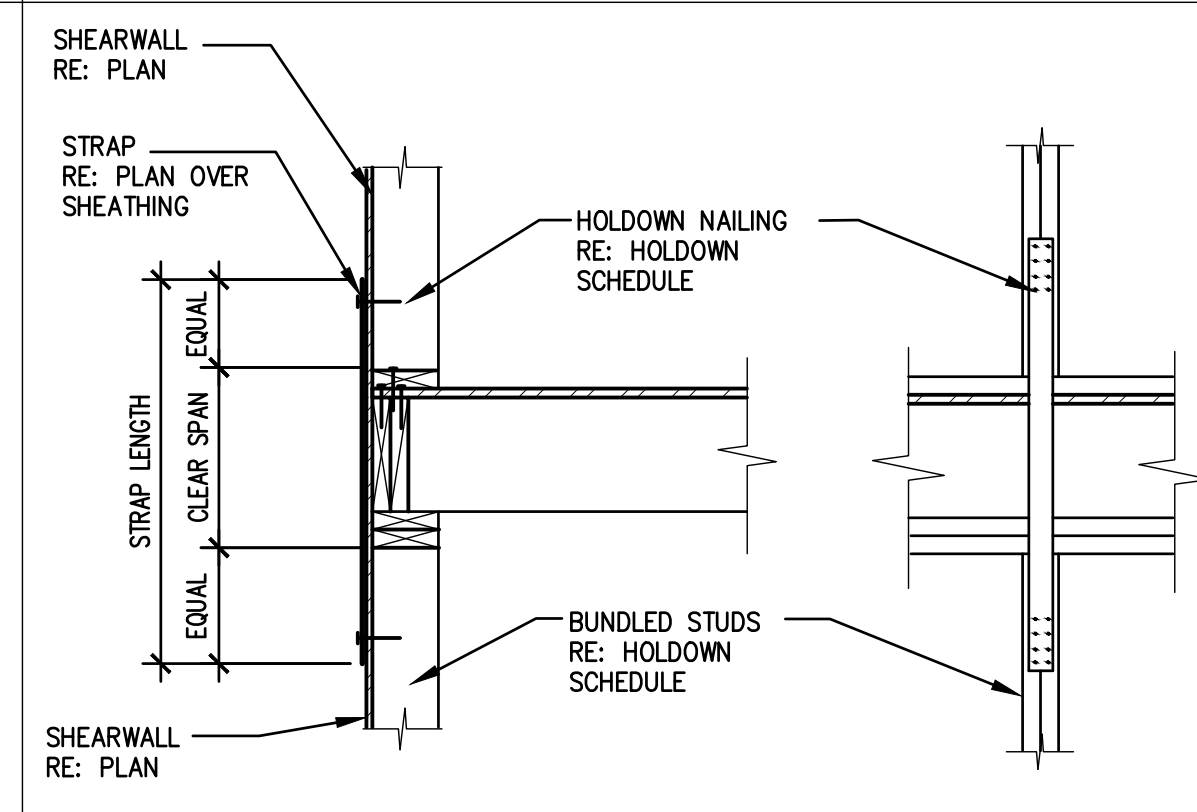


15 EXTERIOR HOLDOWN @ FLOOR

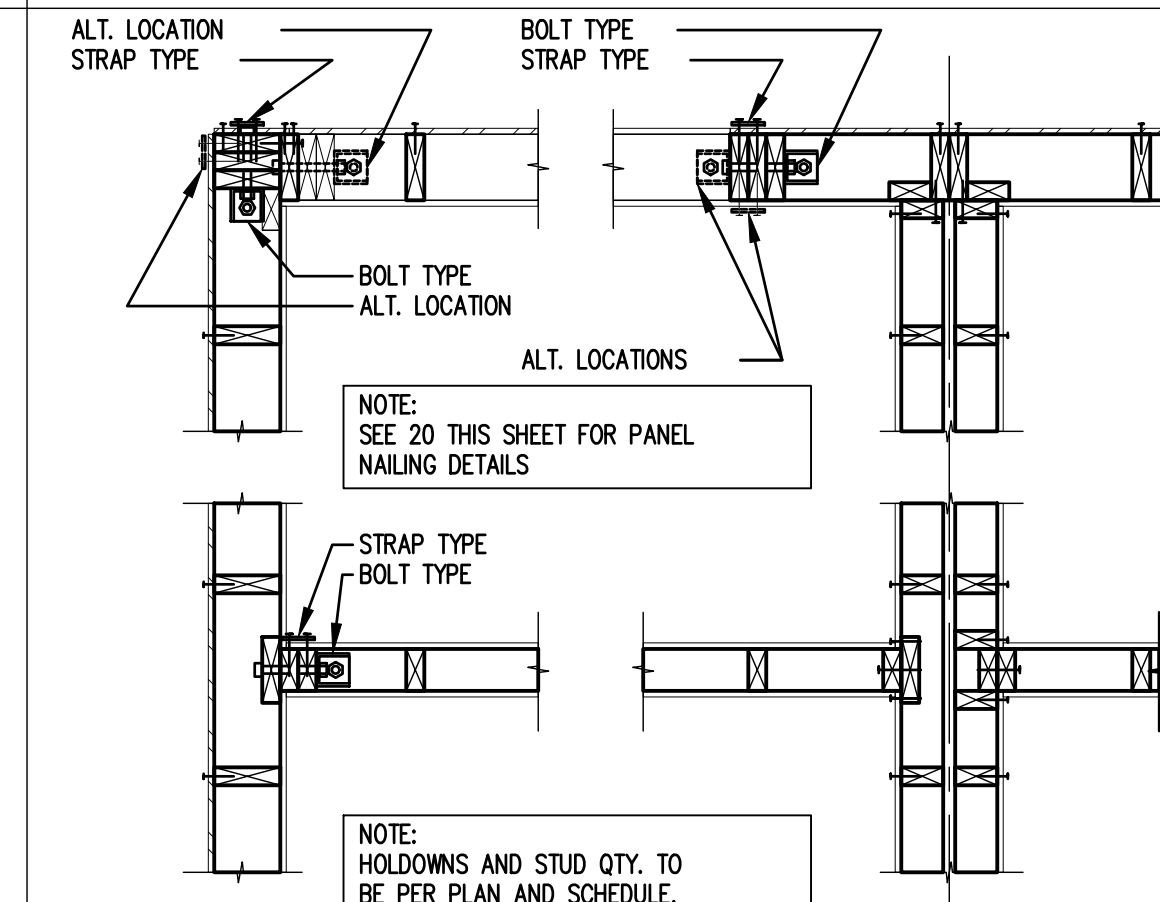


19 HOLDOWN PLACEMENTS

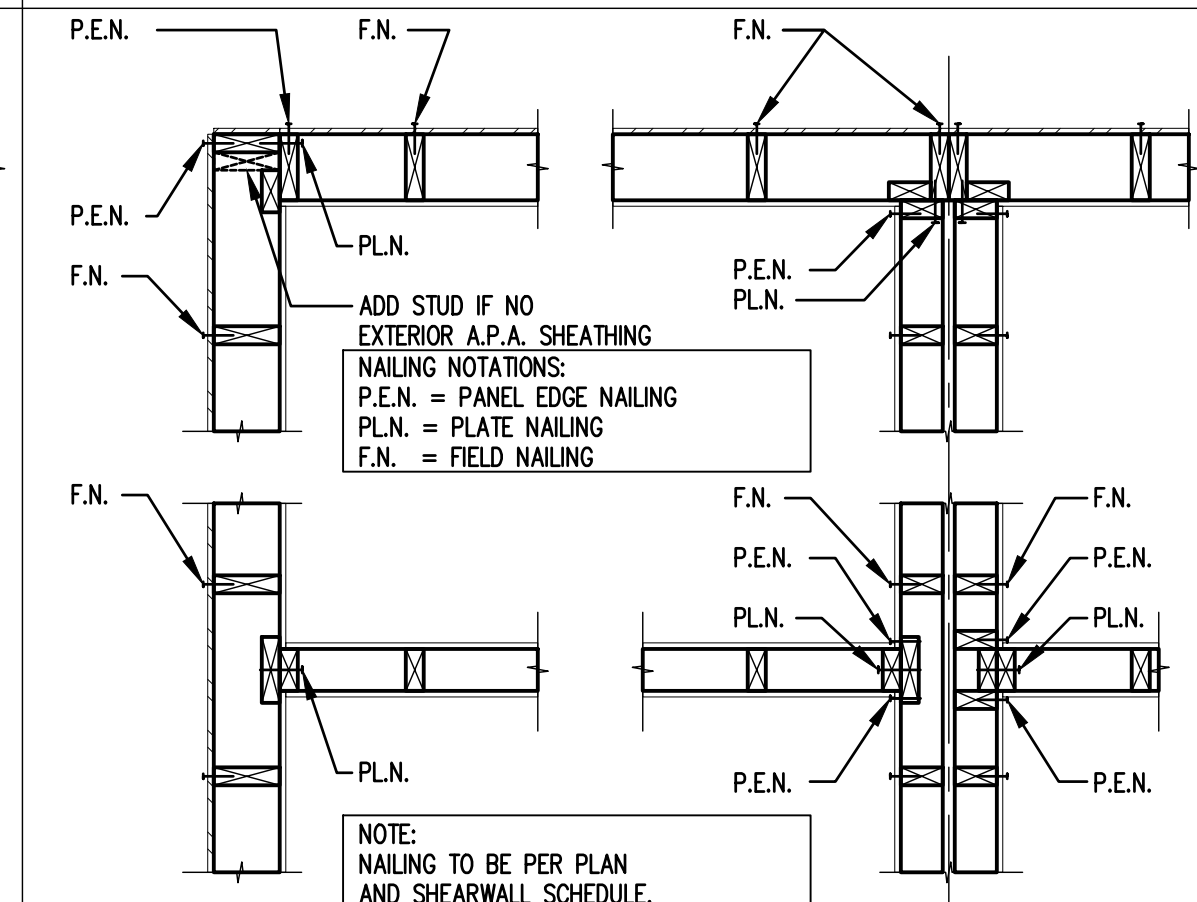

20 STRUCTURAL SHEARWALL INTERSECTIONS

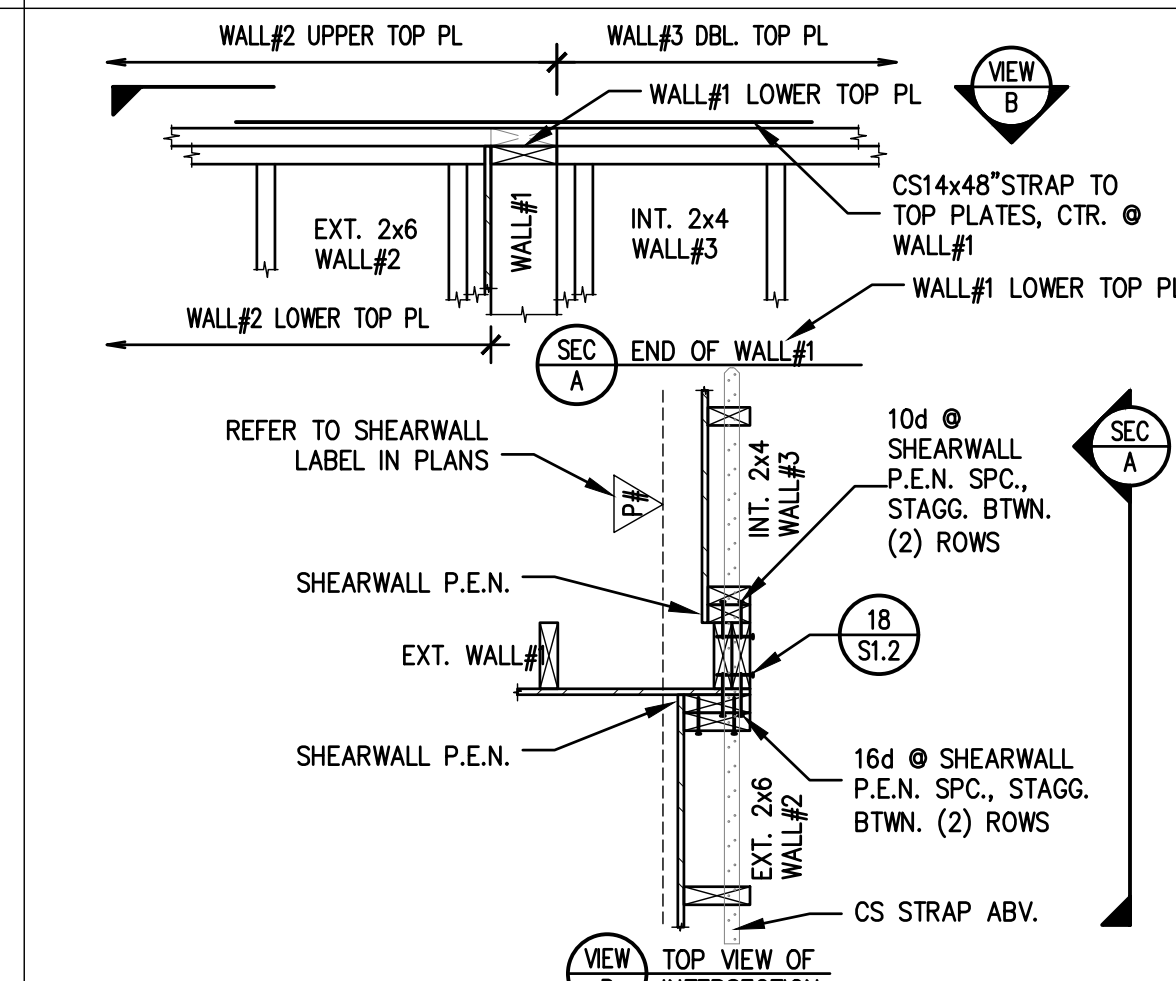

17 CONT. SHEARWALL @ INTERSECTION

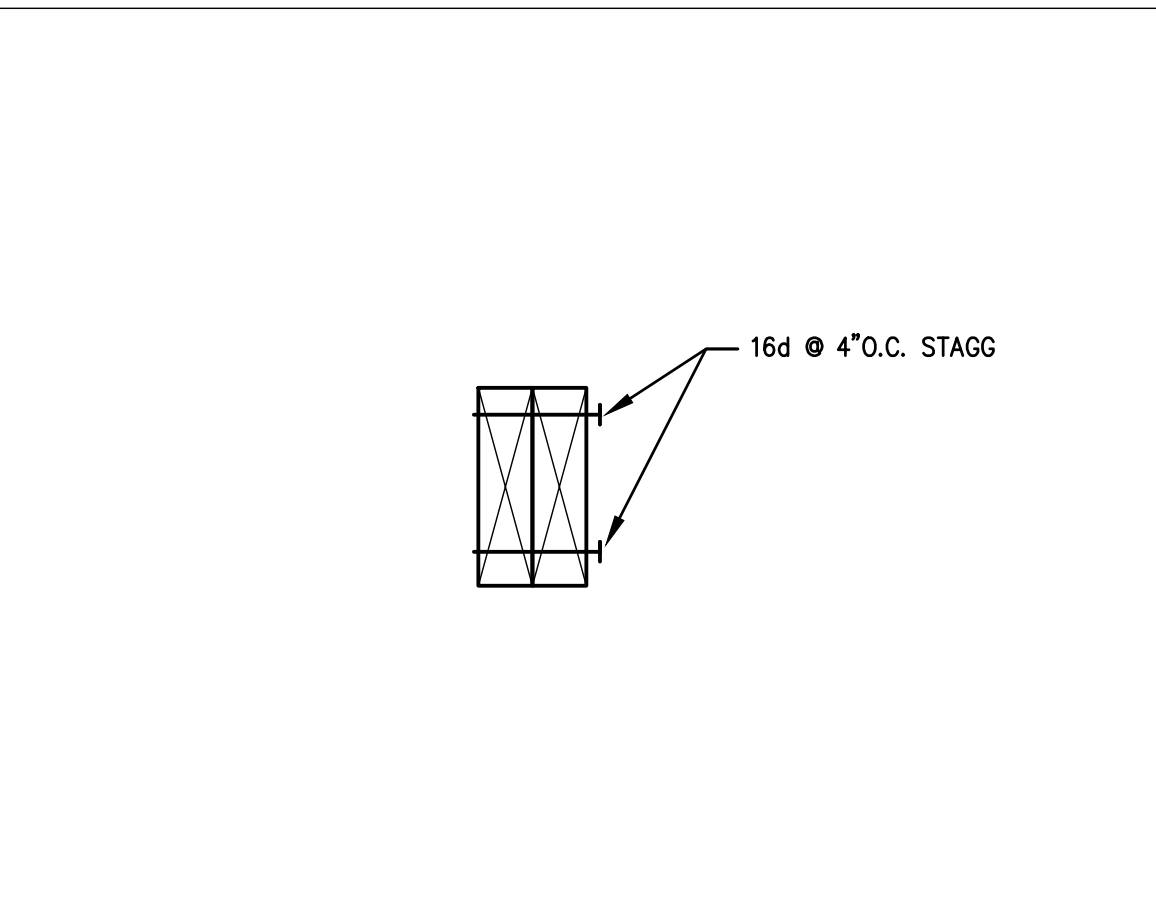

18 TYP. MULTIPLE STUD ATTACHMENT

6

7

11

12

13

14

15


16

17


18

19

20

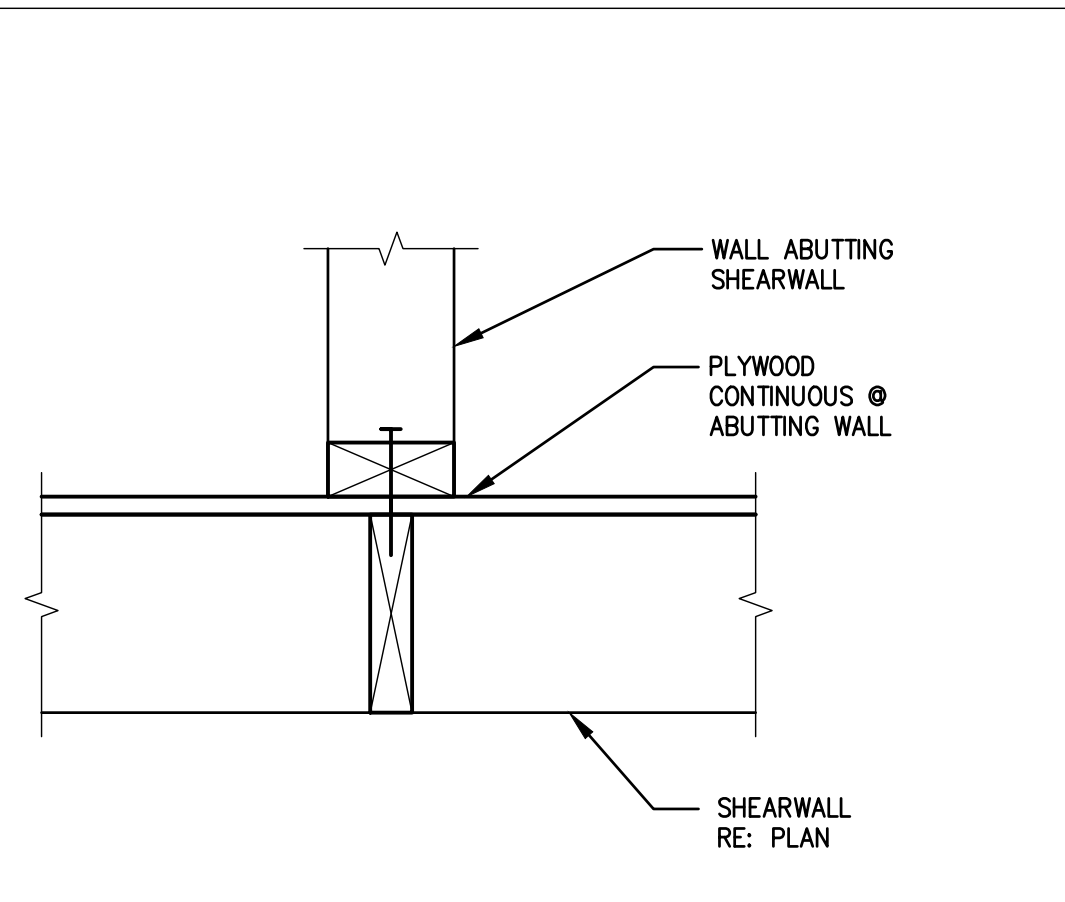

16 TYP. ABUTTING WALL

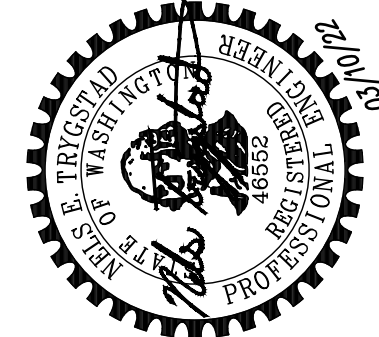

Sterba
 Mironova
 Addition
 9811 SE 40th St
 Mercer Island, WA 98040

Permit
 Set

Date:	Description:
05/17/21	Permit Set
10/15/21	Resubmittal
01/10/22	Resubmittal
03/10/22	Resubmittal

Project No.: CTE#21056
 Drawn:

MAIN FLOOR
 FRAMING
 PLAN

Sheet No:

S3.1

Framing Notes

- REFER TO S9.1 & S9.2 FOR TYPICAL FRAMING DETAILS
- ROOF FRAMING - RAFTERS PER PLAN.
- FLOOR FRAMING - TJI JOISTS PER PLAN. BLOCKING AT BEARING AND SHEARWALLS SHALL BE PER BEARING AND SHEARWALL SCHEDULE (VERIFY EXIST. BRG. LOC.). FLOOR SHEATHING SHALL BE GLUED AND NAILED.
- WALLS INDICATED ARE BELOW THE FRAMING LEVEL (REFER TO SYMBOL KEY FOR TYPE). SEE BEARING WALL SCHEDULE THIS SHEET
- PLUMBING, MECHANICAL, AND ELECTRICAL SYSTEMS SHALL BE DESIGNED AND BUILT TO ACCOMMODATE 3/8" PER FLOOR WOOD SHRINKAGE.
- SEE DETAIL 2/S9.2 FOR TYPICAL HEADER/BUNDLED STUD CONSTRUCTION.
- SEE ARCHITECTURAL FOR DRAFTSTOP AND VENTING LOCATIONS.
- FRAMING MEMBERS AND SHEATHING SHALL BE PER STRUCTURAL NOTES AS NOTED ON SHEET S1.1
- ALL UNLABELLED EXTERIOR WALLS ARE TO BE TYPE 'P6'; SEE SHEARWALL SCHEDULE ON SHEET S1.2
- HANGERS INDICATED ARE AS MANUFACTURED BY SIMPSON STRONG-TIE. SEE SEC. 06103/S1.1 FOR TYPICAL HANGERS, U.N.O.
- PROVIDE JOIST OR BLOCKING ATOP SHEARWALLS.
- SEE ARCHITECTURAL DRAWINGS FOR DIMENSIONS AND TOP PLATE ELEVATIONS OR SUPPORTING BEAM. (RE: 4/S9.2)
- ALL BEAMS AND HEADERS SHALL HAVE A MINIMUM OF (1) FULL HEIGHT STUD AT EACH END FOR BRACING TYPICAL UNLESS NOTED OTHERWISE.
- PROVIDE MINIMUM (2) 2X BUNDLED STUDS UNDER EACH BEAM END, TYPICAL UNLESS NOTED OTHERWISE. (AT HEADERS: TRIMMER+KING=2 BUNDLED STUDS)
- SEE DETAILS 19 & 20 ON SHEET S1.3 FOR TYPICAL CORNER FRAMING DETAILS AT HOLD DOWNS & SHEARWALLS.
- HANGER OCCURS WHERE FLUSH BEAM HANGS TO SUPPORT BEAMS, TYP. U.N.O.



Bearing Wall Stud Schedule

BEARING WALL TYPE	STUD SIZE AND SPACING, U.N.O.
EXTERIOR	2 X 6 AT 16" O.C., U.N.O.
INTERIOR NON-BEARING	2 X 4 AT 16 O.C.

BEARING WALL NOTES


- SEE SHEARWALL SCHEDULE SHEET S1.2 FOR WALL SHEATHING, ADDITIONAL PLATE AND STUD REQUIREMENTS, BLOCKING AND PLATE NAILING. SEE SAWN LUMBER STRUCTURAL NOTES SHEET S1.1 FOR SPECIES AND GRADE OF WALL PLATES AND STUDS.
- SECURE SILL PLATES TO CONCRETE WITH 5/8" DIA. ANCHOR BOLTS AT 48" ON CENTER TYPICAL UNLESS NOTED OTHERWISE. RE: S1.2. REFER TO SHEARWALL AND HOLDDOWN SCHEDULE FOR ADDITIONAL ANCHOR BOLT REQUIREMENTS. WHERE PRESERVATIVE TREATED WOOD IS USED, REFER TO THAT NOTE SECTION FOR CORROSION PROTECTION REQUIREMENTS FOR CONNECTORS.
- SEE 2/S9.2 FOR TOP PLATE SPLICE. PROVIDE ADDITIONAL CONNECTORS AT SHEARWALLS AS INDICATED ON THE PLANS.
- ALIGN STUDS UNDER JOISTS

Framing Legend

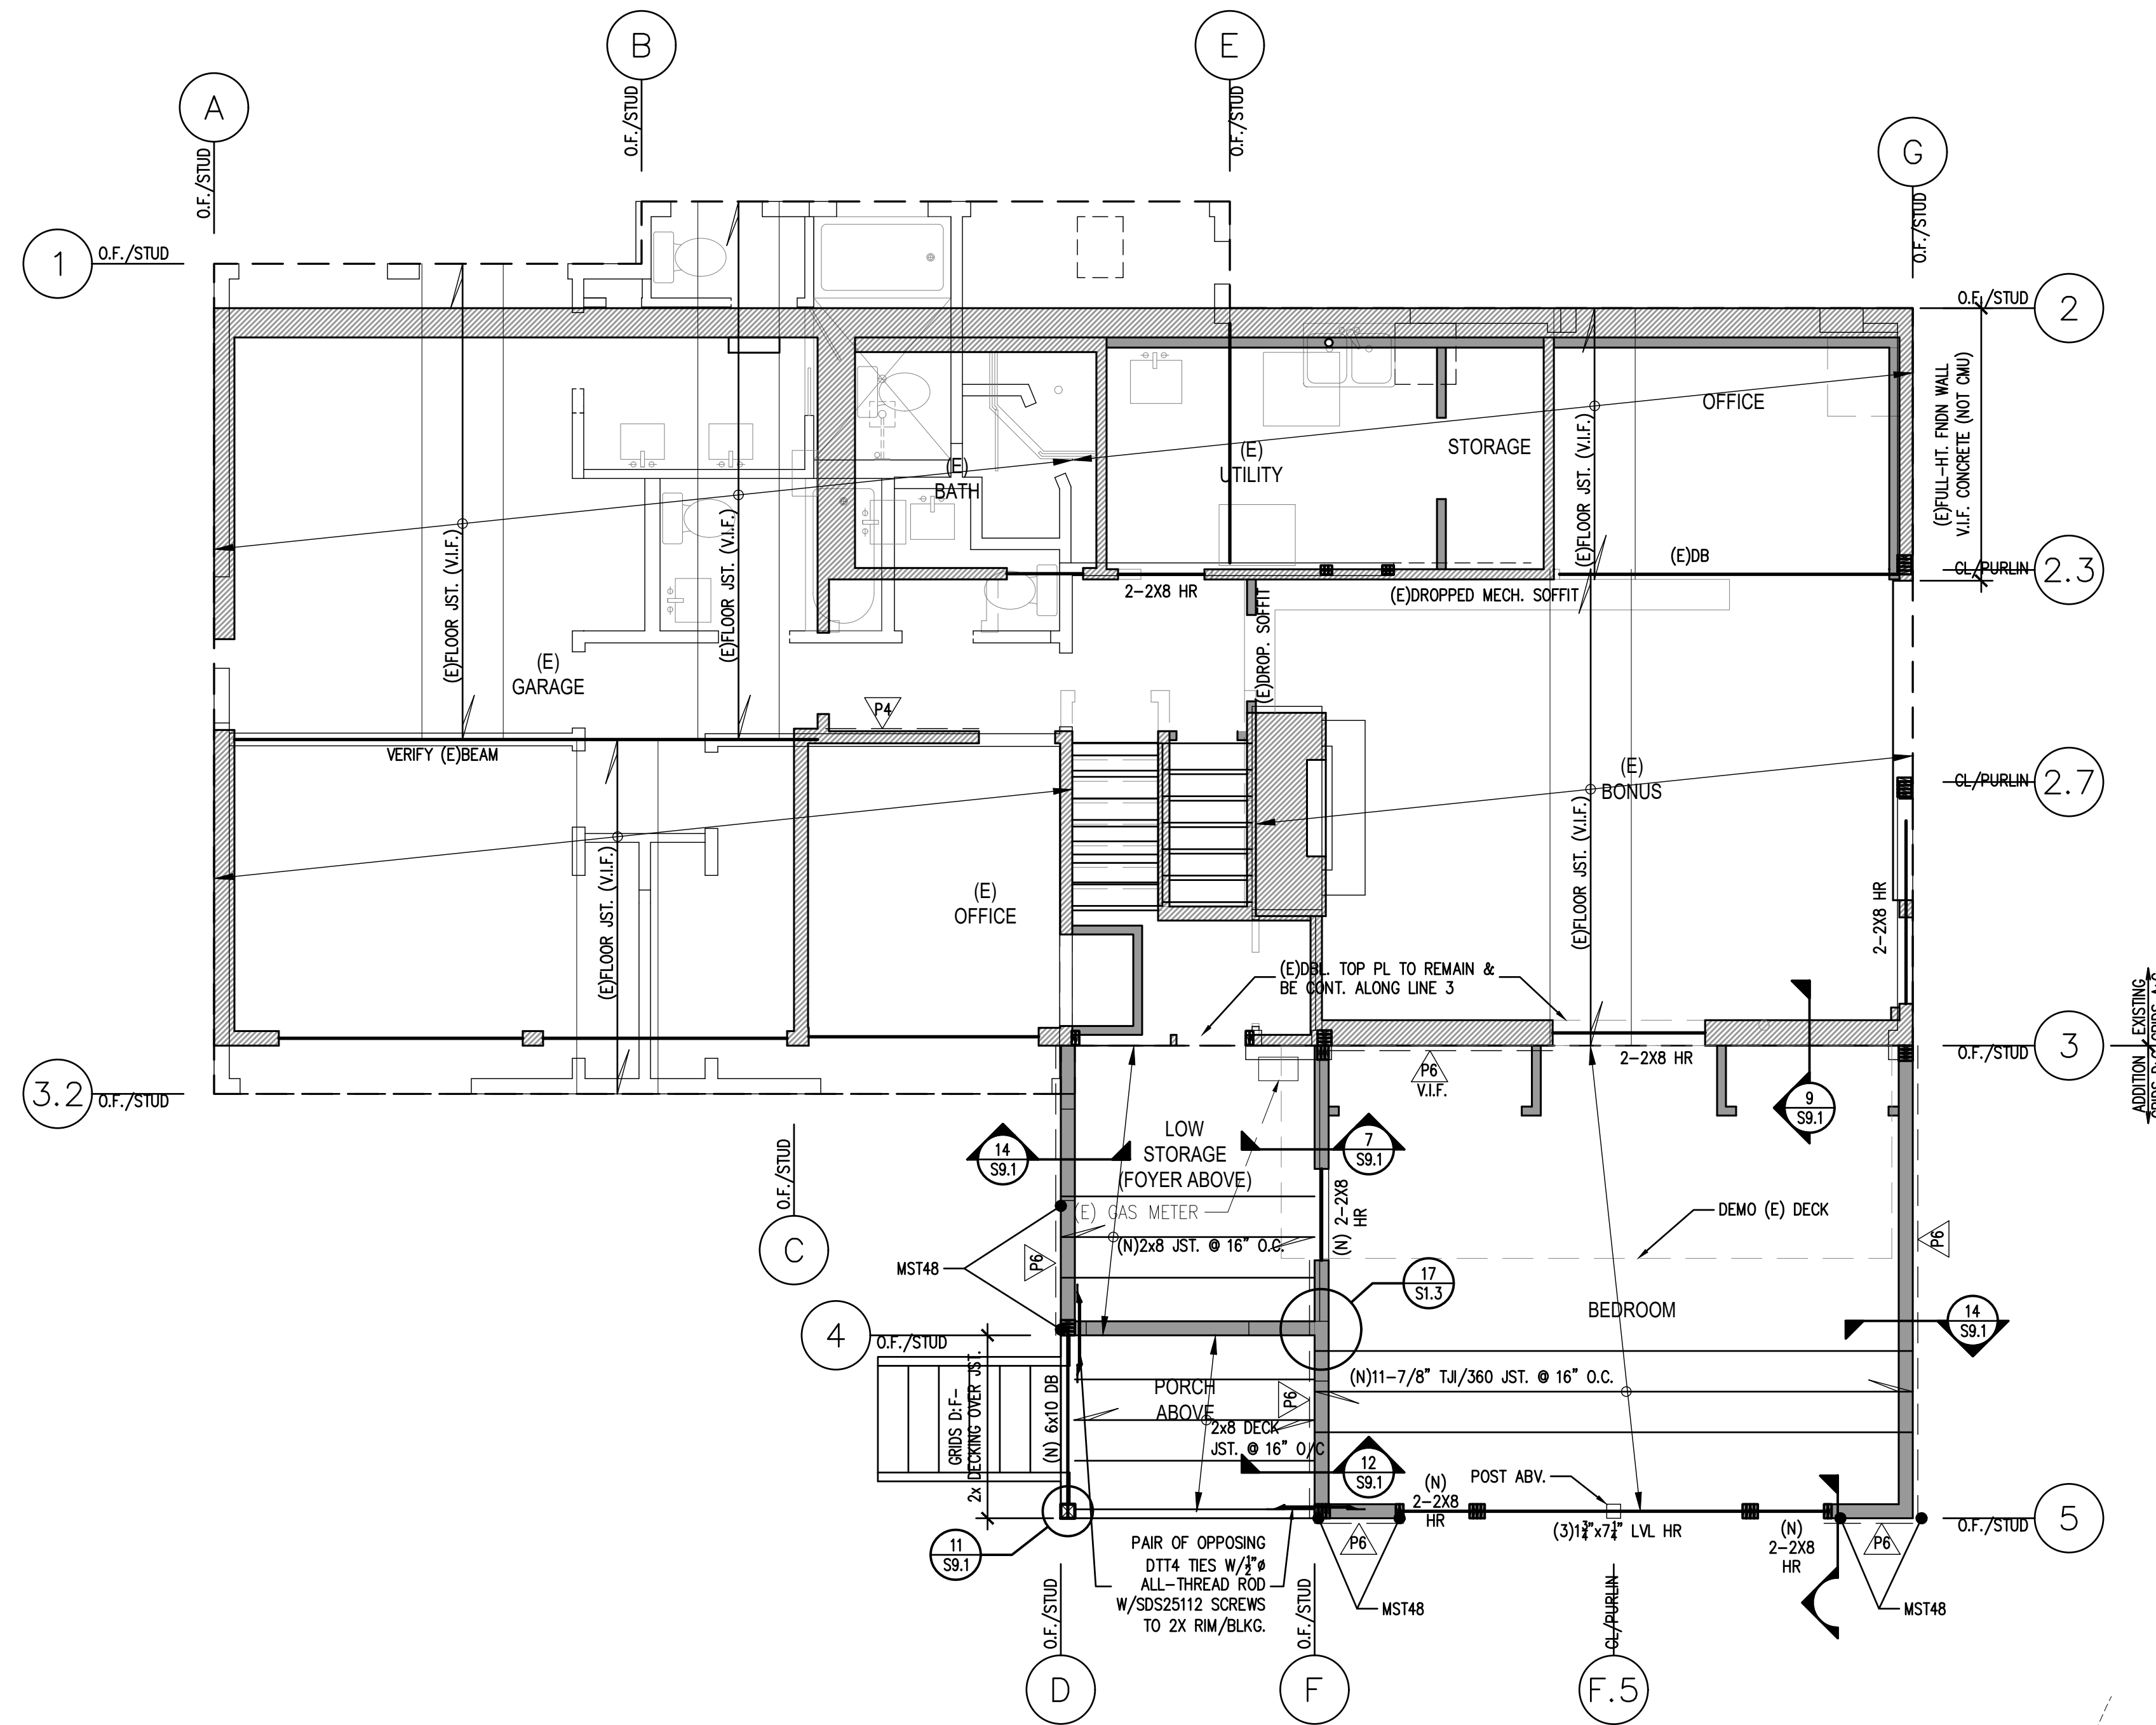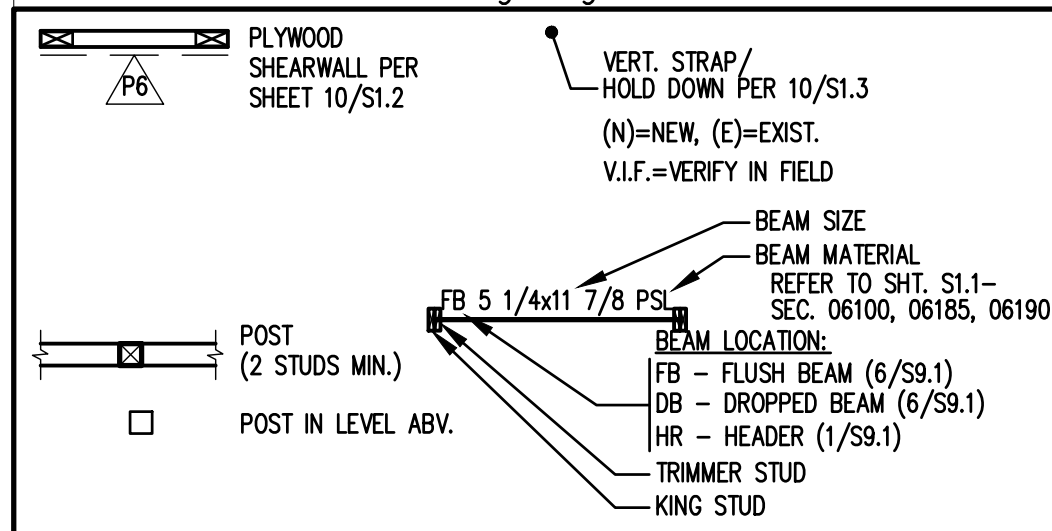


Main Floor Framing Plan

SCALE: 1/4" = 1'-0"



Note:
 PLANS PREPARED USING
 ARCHITECTURAL BACKGROUNDS
 RECEIVED 04/28/2021

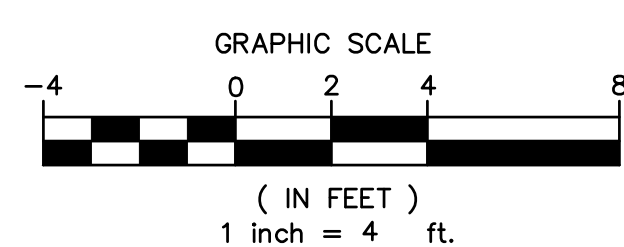

BAR SIZE	LAP CLASS	F _c = 3000PSI		F _c = 4000PSI		F _c = 5000PSI	
		TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS
#3	A	17	14	15	12	14	12
	B	23	17	20	15	18	14
#4	A	23	18	20	16	18	14
	B	30	23	26	20	23	18
#5	A	29	22	25	19	22	17
	B	37	29	32	25	29	22
#6	A	35	27	30	23	27	21
	B	45	35	39	30	35	27
#7	A	63	48	54	42	49	37
	B	81	63	70	54	63	49
#8	A	72	55	62	48	55	43
	B	93	72	80	62	72	55
#9	A	81	62	70	54	63	48
	B	105	81	91	70	81	63


- LENGTHS SHOWN ARE IN INCHES.
- TENSION LAP SPICES SHALL BE CLASS B UNLESS ONE HALF OR LESS OF THE TOTAL REINFORCEMENT IS SPICED WITHIN THE REQUIRED LAP LENGTH.
- TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12" OF CONCRETE CAST BELOW THE BARS.
- TENSION LAP SPICE SHOWN ABOVE ARE FOR CONCRETE COVER GREATER THAN OR EQUAL TO BAR DIAMETER AND CENTER TO CENTER SPACING GREATER THAN TWO BAR DIAMETERS (SPACING AND COVER CASE 1).
- INCREASE LAP SPICE LENGTH BY 1.5 FOR EPOXY COATED REINFORCEMENT.
- INCREASE LAP SPICE LENGTH BY 1.3 FOR LIGHT WEIGHT CONCRETE.
- COMPRESSION LAP SPICES SHALL BE A MINIMUM OF 30 BAR DIAMETERS UNLESS OTHERWISE SHOWN ON THE DRAWINGS.

SCALE:

1

LAP SPICE SCHEDULE

BAR SIZE	D	D	STIRRUP HOOKS/TIES			SEISMIC STIRRUP/TIE	
			90°		135°	135° SEISMIC HOOK	
			A OR G	A OR G	APPROX. H	A OR G	APPROX. H
#3	4db	1 1/2"	4"	4"	2 1/2"	4 1/4"	3"
#4	4db	2"	4 1/2"	4 1/2"	3"	4 1/2"	3"
#5	4db	2 1/2"	6"	5 1/2"	3 3/4"	5 1/2"	3 3/4"
#6	6db	4 1/2"	1'-0"	7 3/4"	4 1/2"	7 3/4"	4 1/2"
#7	6db	5 1/4"	1'-2"	9"	5 1/4"	9"	5 1/4"
#8	6db	6"	1'-4"	10 1/4"	6"	10 1/4"	6"

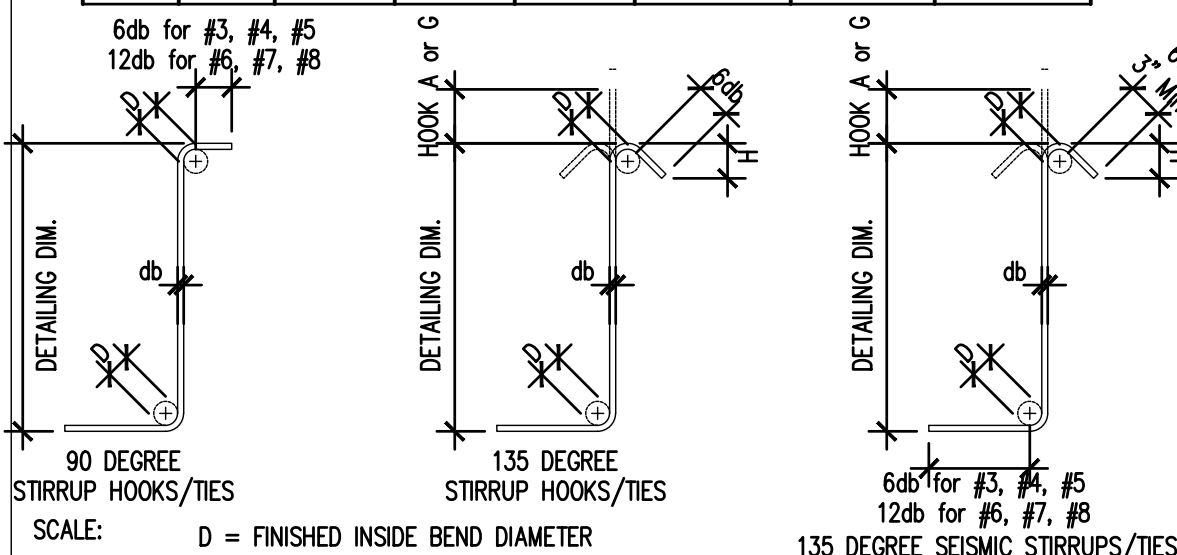

SCALE:


2

STIRRUP and TIE HOOK DETAILS

150'
LOWER FLOOR LINE

148'


146'

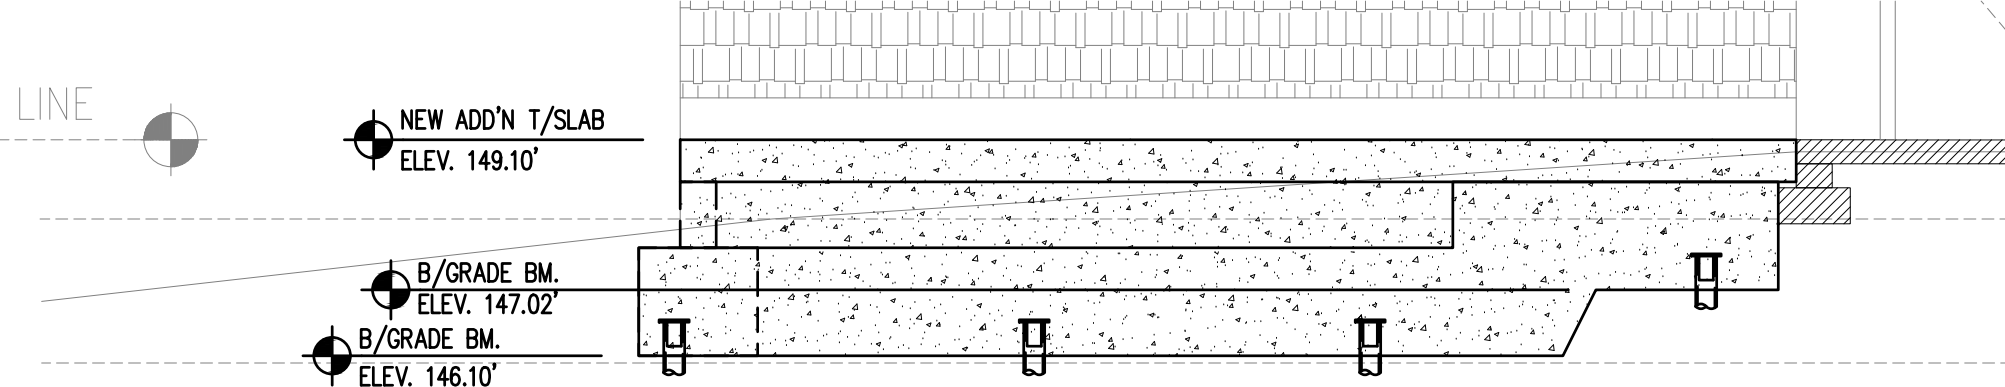

SCALE:

3


GRID G SECTION: GRADE BEAM

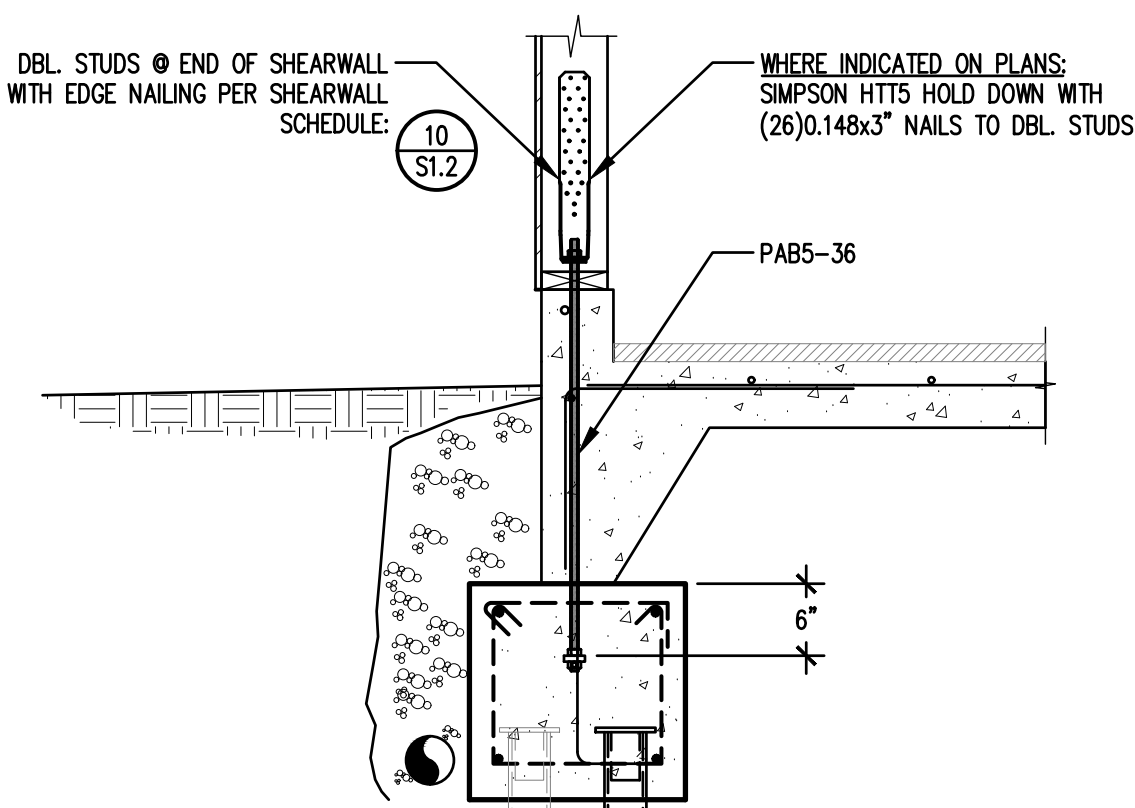

SCALE:

6

HOLDDOWN IN GRADE BEAM

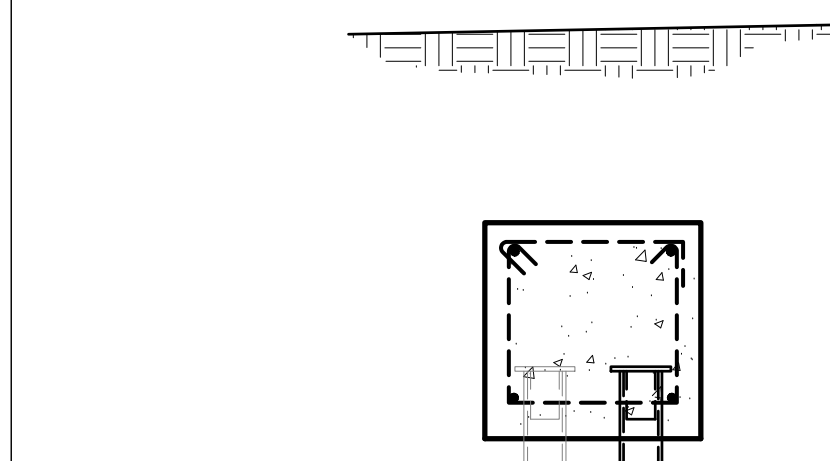


SCALE:

7

GRADE BEAM ACTING AS TIE

SCALE:


8

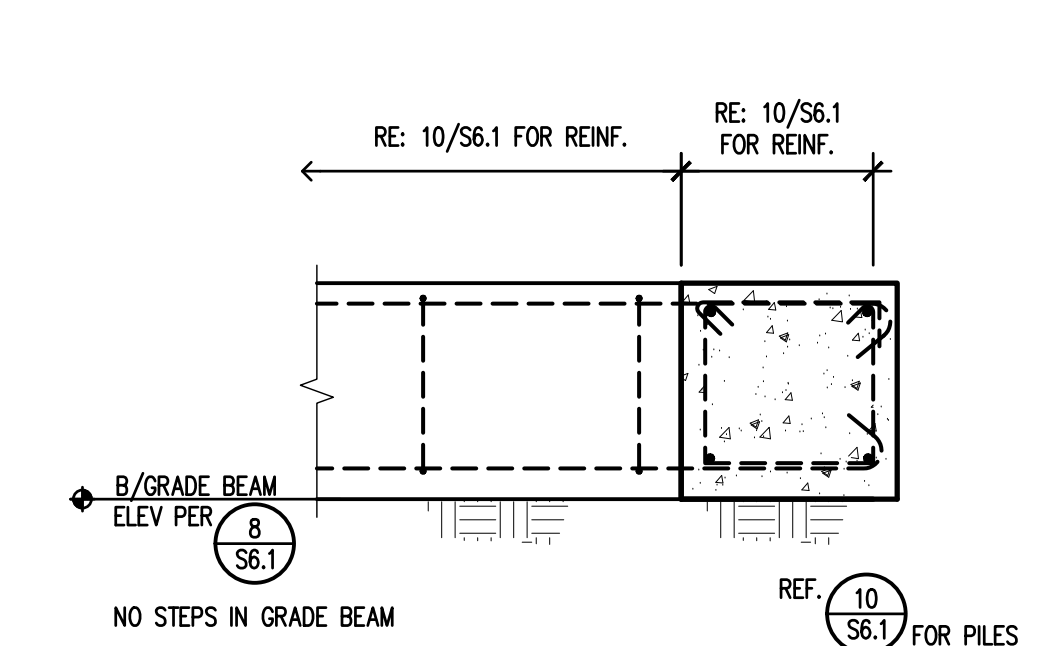

SCALE:

9


GRADE BEAM TO GRADE BEAM SECTION

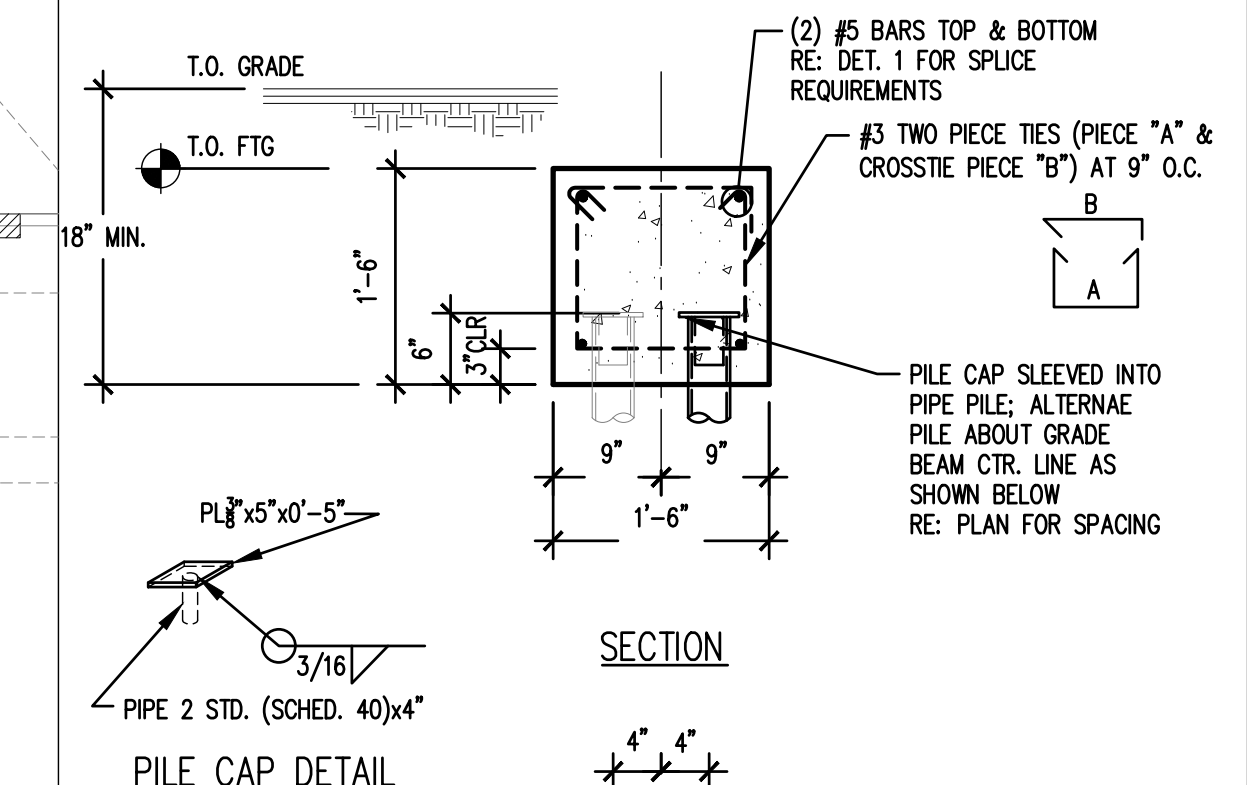

N.T.S.

10


TYPICAL PIPE (PIN) PILE CAP

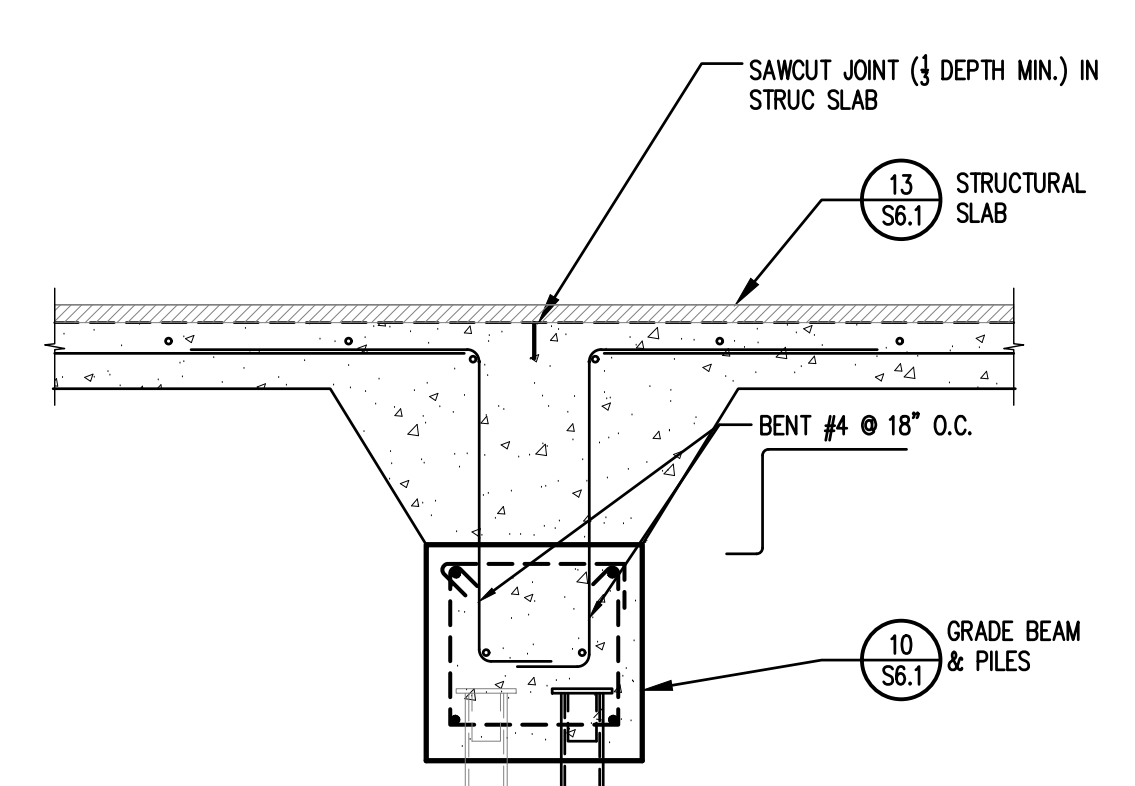

SCALE:

11


STRUC SLAB ON INTERIOR GRADE BEAM

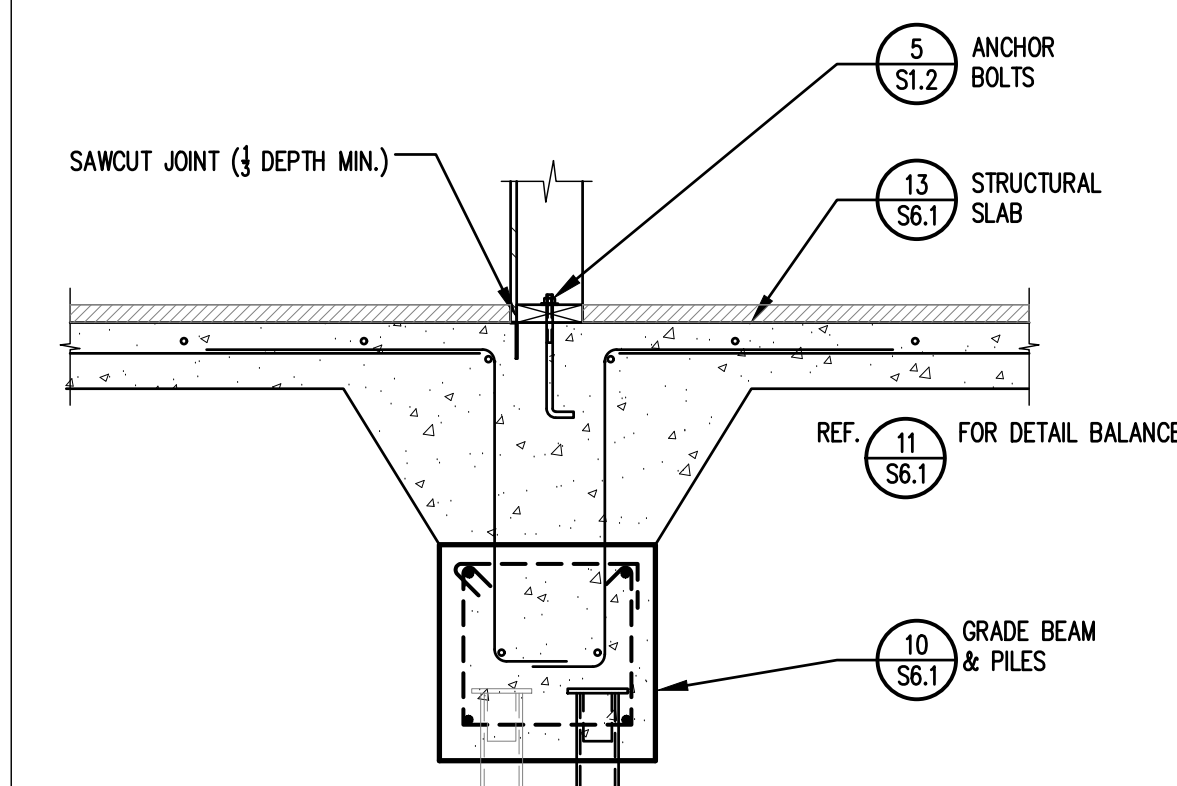

SCALE:

12


WALL ON INTERIOR GRADE BEAM

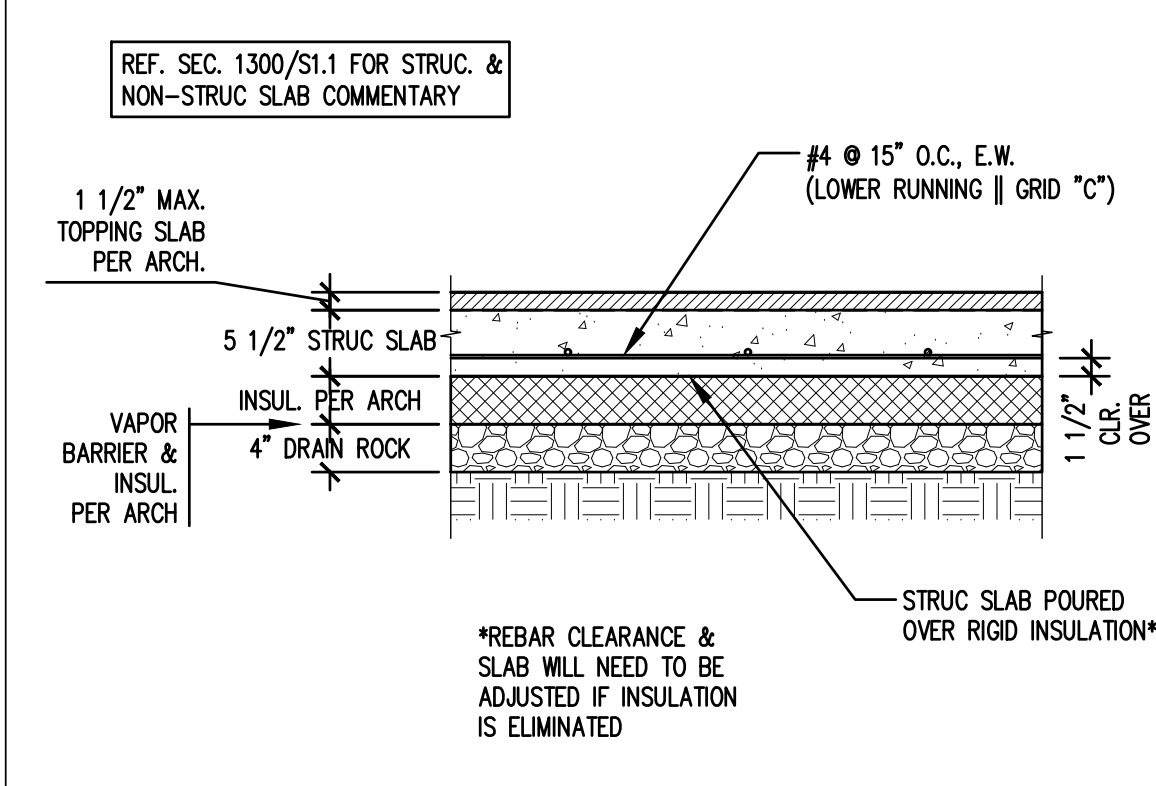

SCALE:

13


ADDITION STRUCTURAL SLAB PROFILE

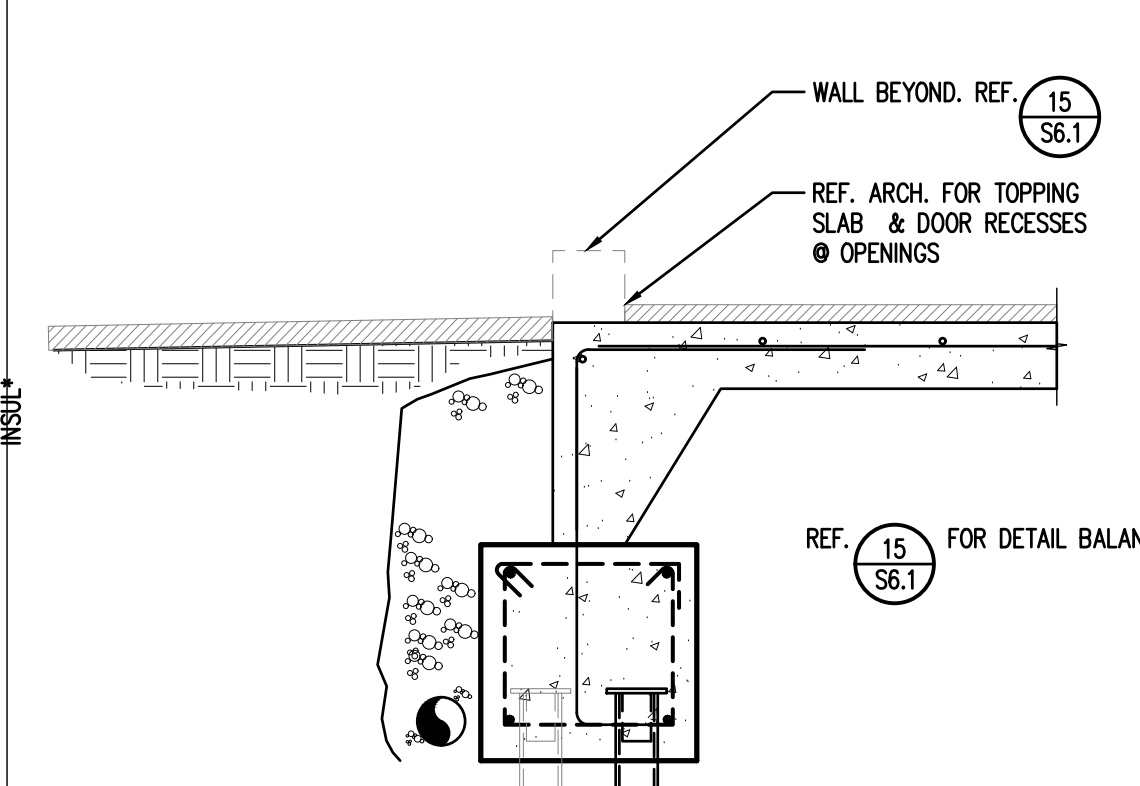

SCALE:

14


ADDITION PERIMETER @ DOOR OPENING

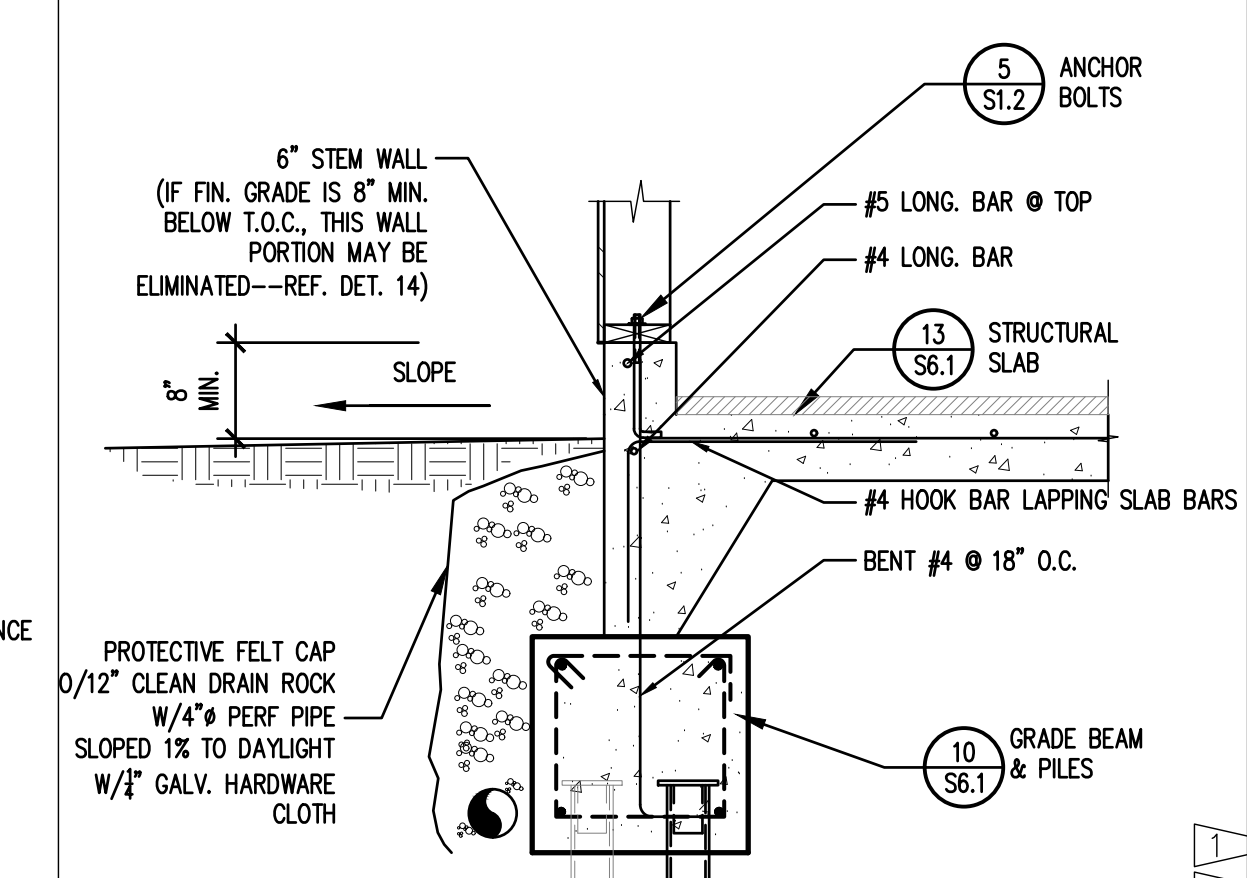

SCALE:

15


ADDITION PERIMETER GRADE BEAM

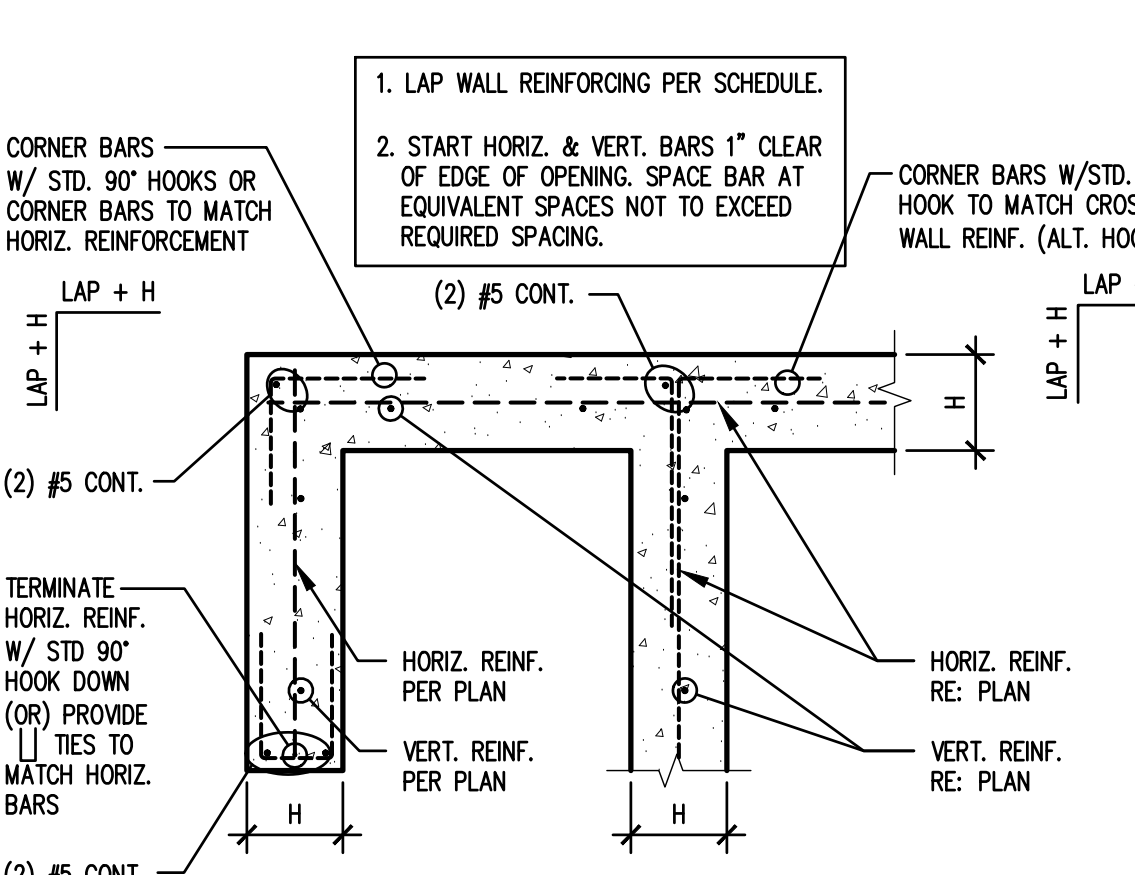

SCALE:

16


SINGLE CURTAIN WALL REINFORCEMENT PLACEMENT

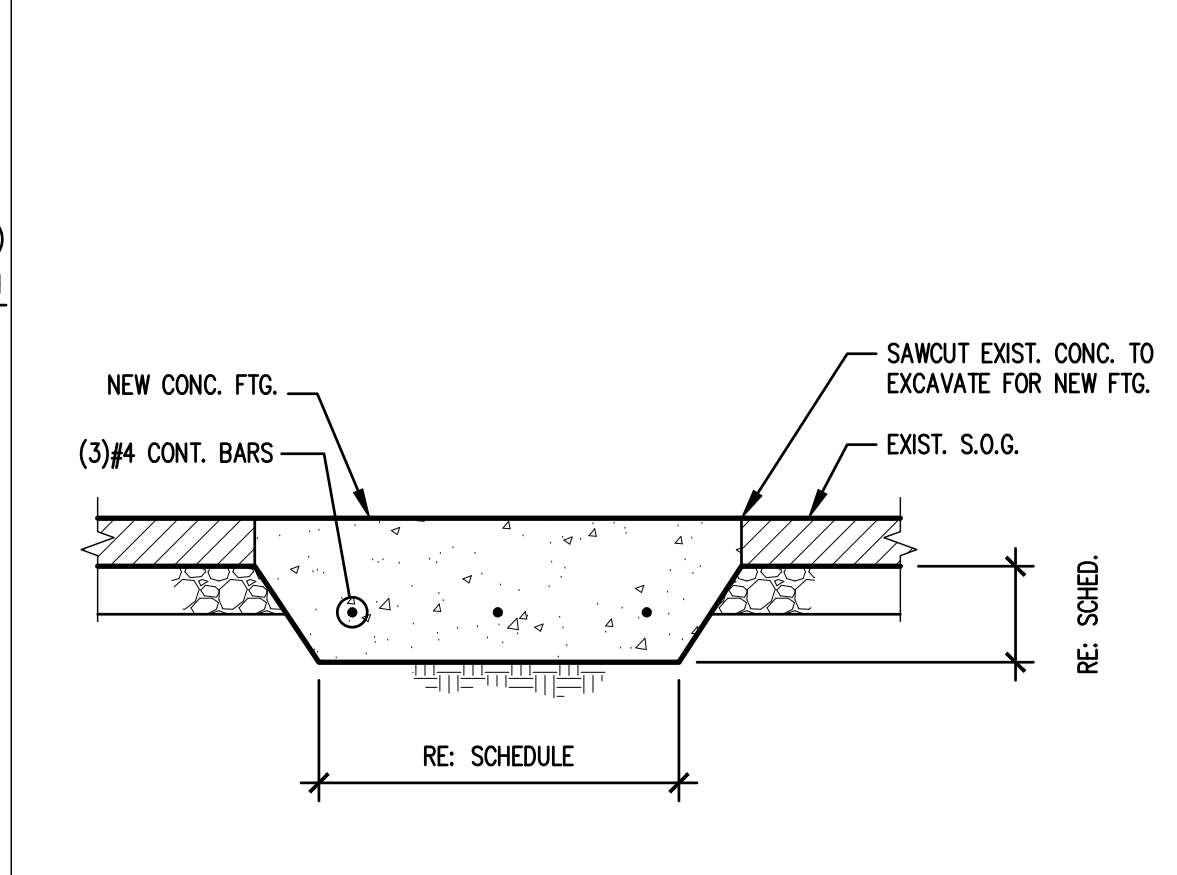

SCALE:

17


TYPICAL INTERIOR POST ON SLAB

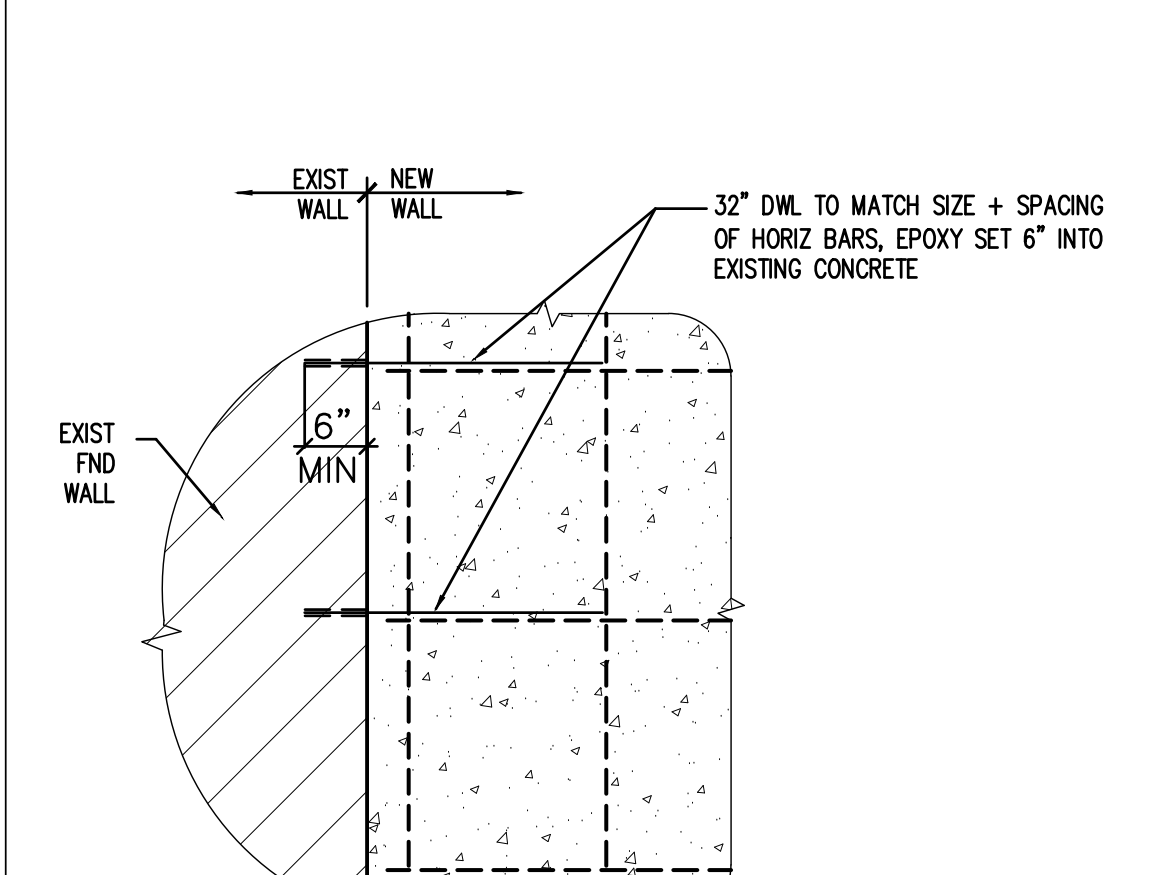

SCALE:

18


NEW FOUNDATION TO EXIST. FND CONN.

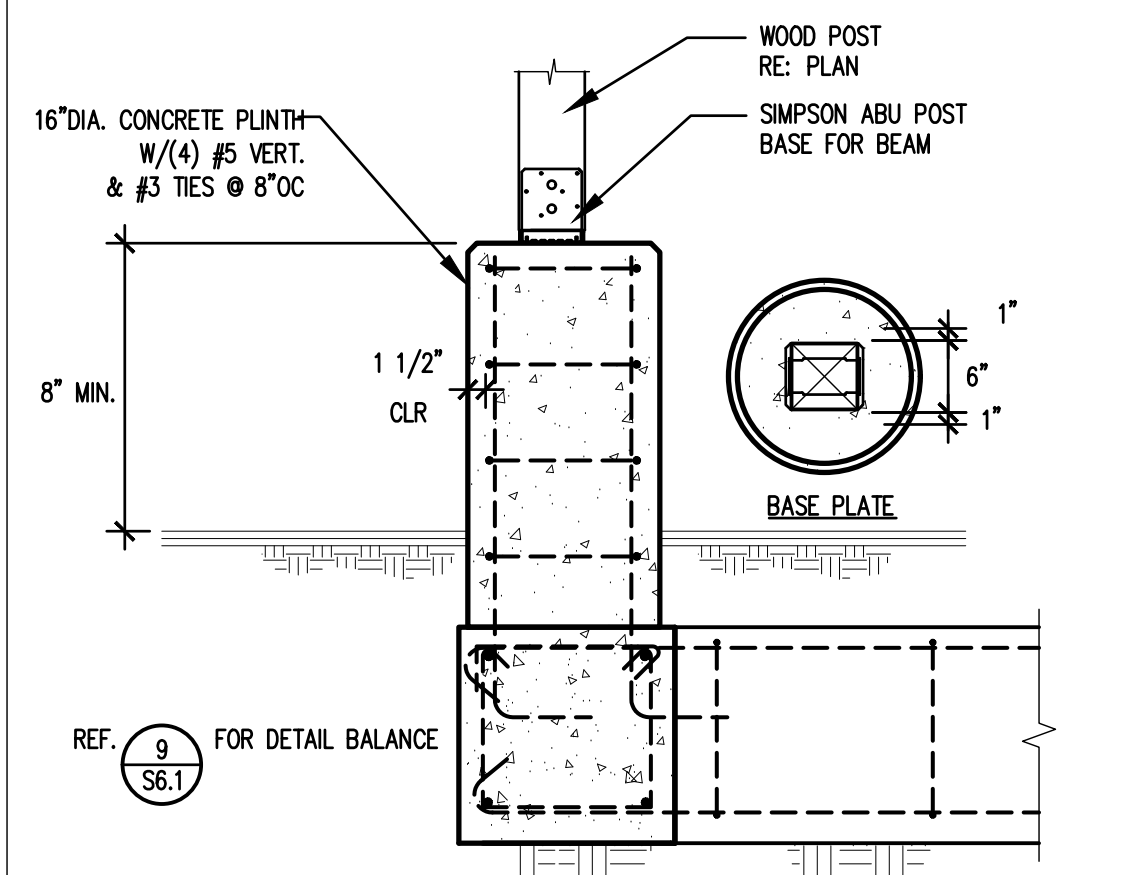

SCALE:

19

NEW ISOLATED PIER FOOTING

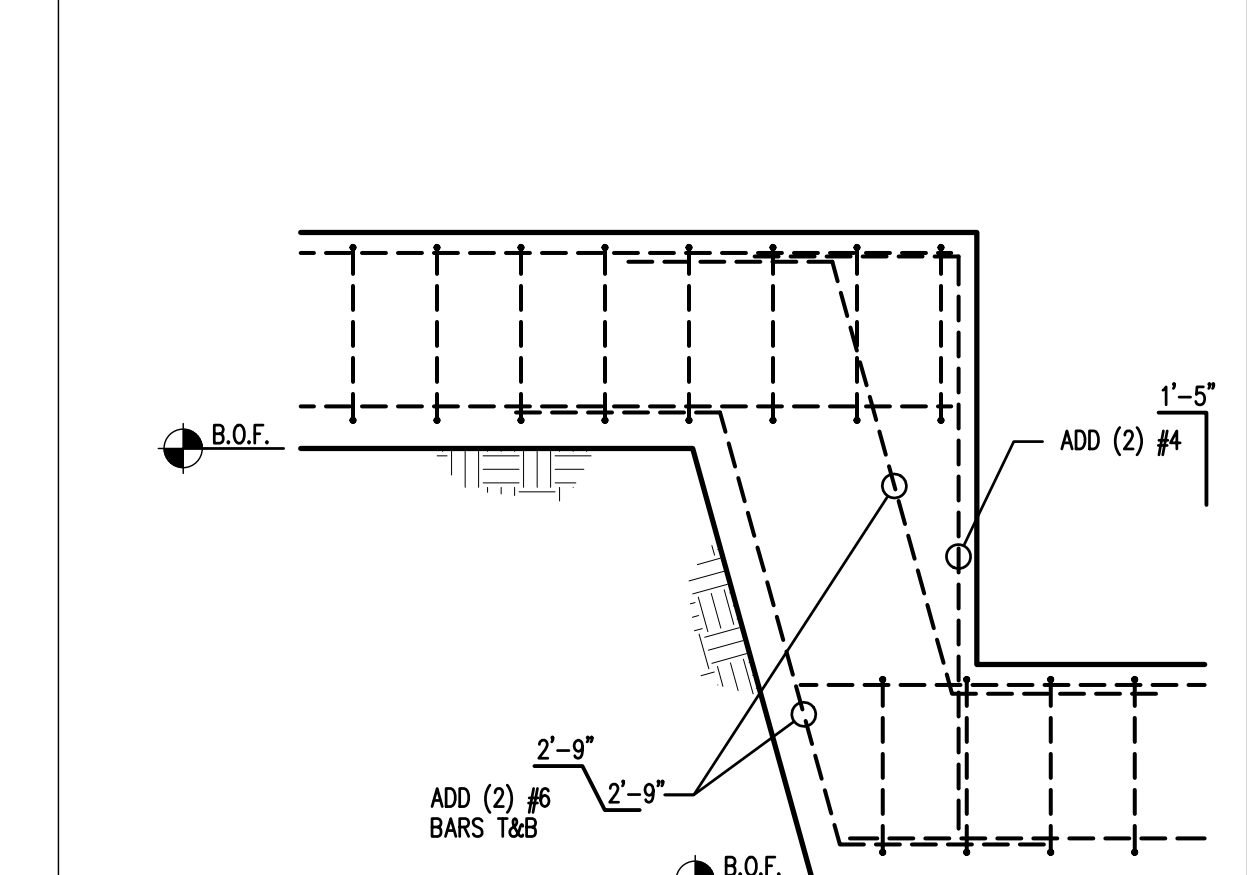

SCALE: NONE


20

GRADE BEAM STEP

TAM Design

10040 Sand Point Way NE
Seattle, WA 98125
calvint006@gmail.com

CT ENGINEERING INC.
Structural Engineers
180 Nickerson Street, Suite 302
206.285.4512 (Y)
206.285.0618 (F)
Seattle, WA 98109

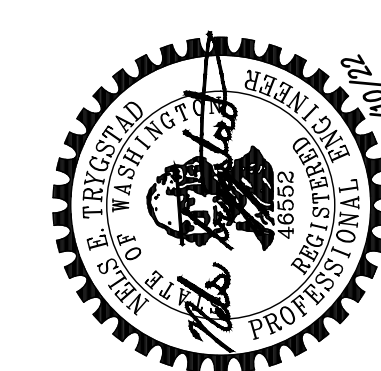Sterba
Mironova
Addition9811 SE 40th St
Mercer Island, WA 98040Permit
Set

Date:	Description:
05/17/21	Permit Set
10/15/21	Resubmittal
01/10/22	Resubmittal
03/10/22	Resubmittal

Project No.: CTE#21056

Drawn:

FOUNDATION
DETAILS

Sheet No:

S6.1

