

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This tool will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

Please complete the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please contact the WSU Energy Program at energycode@energy.wsu.edu or (360) 956-2042 for assistance.

Project Information

2110 Harris Renodel
1640 72nd AVE SE, Mercer Island, WA 98040

Contact Information

Tom Brown
tomb@ghdarch.com
4258283081

Heating System Type: All Other Systems Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions"

Design Temperature

[Instructions](#)

Mercer Island

Design Temperature Difference (ΔT) 45

$\Delta T = \text{Indoor (70 degrees)} - \text{Outdoor Design Temp}$

Area of Building

Conditioned Floor Area

[Instructions](#)

Conditioned Floor Area (sq ft)

302

Average Ceiling Height

[Instructions](#)

Average Ceiling Height (ft)

9.3

Conditioned Volume

2,818

Glazing and Doors

[Instructions](#)

U-0.28

U-Factor X Area = UA
0.280 X 83 = 23.21

Skylights

[Instructions](#)

U-Factor X Area = UA
0.50 X [] = ---

Insulation

Attic

[Instructions](#)

R-49

U-Factor X Area = UA
0.026 X 302 = 7.85

Single Rafter or Joist Vaulted Ceilings

[Instructions](#)

Select R-Value

U-Factor X Area = UA
No selection X [] = ---

Above Grade Walls (see Figure 1)

[Instructions](#)

Select R-Value

U-Factor X Area = UA
No selection X [] = ---

Floors

[Instructions](#)

R-38

U-Factor X Area = UA
0.025 X 302 = 7.55

Below Grade Walls (see Figure 1)

[Instructions](#)

Select R-value

U-Factor X Area = UA
No selection X [] = ---

Slab Below Grade (see Figure 1)

[Instructions](#)

Select conditioning

F-Factor X Length = UA
No selection X [] = ---

Slab on Grade (see Figure 1)

[Instructions](#)

Select R-Value

F-Factor X Length = UA
No selection X [] = ---


Location of Ducts

[Instructions](#)

Conditioned Space

Duct Leakage Coefficient

1.00

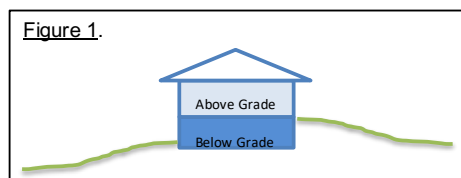

Sum of UA 38.61

Envelope Heat Load 1,738 Btu / Hour
Sum of UA x ΔT

Air Leakage Heat Load 1,369 Btu / Hour
Volume x 0.6 x ΔT x 0.018

Building Design Heat Load 3,107 Btu / Hour
Air leakage + envelope heat loss

Building and Duct Heat Load 3,107 Btu / Hour
Ducts in unconditioned space: sum of building heat loss x 1.10
Ducts in conditioned space: sum of building heat loss x 1

Maximum Heat Equipment Output 3,884 Btu / Hour
Building and duct heat loss x 1.40 for forced air furnace
Building and duct heat loss x 1.25 for heat pump