

ENERGY NOTES

CODE(S): 2018 INTERNATIONAL BUILDING CODE - - - (IBC)
 2018 INTERNATIONAL RESIDENTIAL CODE - - - (IRC)
 2018 WASHINGTON ENERGY CODE - - - (WEC)

CLIMATIC ZONE: **4C - MARINE**

SPACE HEAT TYPE: NATURAL GAS, FORCED AIR

INSULATION VALUES: PRESCRIPTIVE METHOD (ALL NEW AREA)

WALLS: - - - - - R-21
 FLOORS: - - - - - R-49/R-38
 (OVER UNHEATED SPACES)
 VAULTED CEILINGS: - - - - - R-38
 SLAB-ON-GRADE: - - - - - R-10

ATLICS/CEILING: VAPOR RETARDER OF ONE PERM CUP RATING (4 MIL POLYETHYLENE). INSTALL CONTINUOUSLY

CRAWL SPACE: CONTINUOUS 6 MIL POLYETHYLENE

VENTILATION: ATTICS WITH BATTS: BAFFLE VENT OPENINGS TO DEFLECT AIR ABOVE INSULATION SURFACE

ENCLOSED JOIST OR RAFTER SPACES: PROVIDE MINIMUM OF ONE INCH CLEAR VENTED AIR SPACE ABOVE INSULATION. TAPER OR COMPRESS INSULATION AT PERIMETER TO INSURE PROPER VENTILATION

HEATING & COOLING: FORCED AIR NATURAL GAS HEATING SYSTEM.

TEMP. CONTROL: FOR HEATING AND COOLING, THERMOSTAT SHALL BE CAPABLE OF BEING SET FROM 55-85 DEGREES FAHRENHEIT AND OF OPERATING THE HEATING/COOLING SYSTEM IN SEQUENCE. THERMOSTAT TO BE AUTOMATIC DAY/NIGHT SETBACK TYPE.

DUCT INSULATION: THERMALLY INSULATE ALL PLENUMS, DUCTS AND ENCLOSURES IN ACCORDANCE WITH TABLE 406.2 OF THE 2015 WASHINGTON STATE ENERGY CODE.

HEATING & COOLING: FOR HEATING DUCTS IN UNCONDITIONED SPACES SHALL BE INSULATED WITH A MIN. OF R-8. ALL SEAM JOINTS SHALL BE TAPED, SEALED AND FASTENED WITH THE MINIMUM OF FASTENERS PER 2015 WSEC.

MOISTURE CONTROL: VAPOR RETARDER BONDED TO BATT INSULATION; INSTALL WITH STAPLES NOT MORE THAN 8 INCHES ON CENTER AND WITH A GAP BETWEEN AND OVER FRAMING NOT GREATER THAN 1/16 OF AN INCH; OR, VAPOR RETARDER OF ONE PERM CUP RATING (4 MIL POLYETHYLENE)

GENERAL NOTES

- CODE COMPLIANCE**
ALL WORK SHALL COMPLY WITH THE 2018 IBC, 2018 IRC, 2018 IMC, 2018 IFGC, 2018 NATIONAL FUEL GAS CODE, NFPA 54, 2018 LIQUEFIED PETROLEUM GAS CODE, NFPA 58, 2018 IRC, 2018 UPC, 2018 WSEC, WAC 51-11, 2018 WAQ, WAC 51-13, 2018 NEC, AND WITH ALL LOCAL CODES AND ORDINANCES.
- DIMENSIONS**
A. DO NOT SCALE DRAWINGS. VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. NOTIFY THE ARCHITECT OF DISCREPANCIES. IF WORK IS STARTED PRIOR TO NOTIFICATION, THE GENERAL AND SUBCONTRACTOR PROCEED AT THEIR OWN RISK.
B. UNLESS OTHERWISE NOTED, PLAN DIMENSIONS ARE TO FACE OF STUDS OR FACE OF CONCRETE WALLS. FACE OF STONE VENEER LIES 6" +/- OUTSIDE THE FACE OF FRAMING. INTERIOR PLAN DIMENSIONS ARE TO FACE OF STUDS UNLESS OTHERWISE NOTED.
C. VERIFY ALL ROUGH-IN DIMENSIONS FOR WINDOWS, DOORS, PLUMBING, ELECTRICAL FIXTURES AND APPLIANCES PRIOR TO COMMITMENT OF WORK. NOTIFY ARCHITECT OF ANY DISCREPANCIES OF DIMENSIONAL TOLERANCES REQUIRED.
- DOCUMENT REVIEW/VERIFICATION**: CONSULT WITH ARCHITECT REGARDING ANY SUSPECTED ERRORS, OMISSIONS, OR CHANGES ON PLANS BEFORE PROCEEDING WITH THE WORK.
- ROUGH OPENINGS/BACKING**: VERIFY SIZE AND LOCATION, AS WELL AS PROVIDE ALL OPENINGS THROUGH FLOORS AND WALLS, FURRING, CURBS, ANCHORS, INSERTS, EQUIPMENT BASES AND ROUGH BUCKS/BACKING FOR SURFACE-MOUNTED ITEMS.
- FURRING**: PROVIDE FURRING AS REQUIRED TO CONCEAL MECHANICAL AND/OR ELECTRICAL EQUIPMENT IN FINISHED AREAS. FURRING NOT SHOWN ON PLANS SHALL BE APPROVED BY ARCHITECT PRIOR TO CONSTRUCTION.
- GRADES**: VERIFY ALL GRADES AND THEIR RELATIONSHIP TO THE BUILDING(S).
- FLOOR LINES**: "FLOOR LINE" REFERS TO TOP OF CONCRETE SLAB OR TOP OF WOOD SUBFLOOR.
- REPETITIVE FEATURES**: OFTEN DRAWN ONLY ONCE AND SHALL BE COMPLETELY PROVIDED AS IF DRAWN IN FULL.
- DOORS**: DOORS NOT DIMENSIONALLY LOCATED SHALL BE 6" FROM STUD FACE TO EDGE OF DOOR, ROUGH OPENING OR CENTERED BETWEEN WALLS AS SHOWN.
- WOOD ON CONCRETE**: WOOD MEMBERS IN CONTACT WITH CONCRETE AND/OR EXPOSED TO WEATHER, PROVIDE PRESSURE TREATED SILL PLATES.
- FRAMING**: INTERIOR FURRING & PARTITION WALLS TO BE 2x4 @ 16" O.C.
- VENTILATION**: VENT ALL BATHROOM FANS, LAUNDRY FANS, RANGE HOODS AND DRYERS TO OUTSIDE ATMOSPHERE. BATHROOM/UTILITY ROOM FANS SHALL BE DIRECTED TO THE OUTSIDE THROUGH SMOOTH, RIGID, NON-CORROSIVE METAL 2" GA. DUCTWORK. FLEX DUCTING IS NOT ALLOWED.
- FLUES**: FLUES TO BE LOCATED MINIMUM 2" FROM ALL COMBUSTIBLE MATERIALS.
- BASEMENT**: NO LPG PROPANE GAS APPLIANCES ARE ALLOWED IN THE BASEMENT.
- OTHER DOCUMENTATION**: REFER TO STRUCTURAL, MECHANICAL, ELECTRICAL AND/OR LANDSCAPE DRAWINGS FOR ADDITIONAL DRAWINGS, NOTES, SCHEDULES AND SYMBOLS.
- PROTECTION**: PROTECT ALL EXISTING FINISHES & SURFACES. ANY DAMAGE TO BE REPAIRED @ NO ADDITIONAL EXPENSE TO OWNER.
- PERMITS**: SEPARATE ELECTRICAL, MECHANICAL AND PLUMBING PERMITS ARE REQUIRED IN ADDITION TO THE BASIC BUILDING PERMIT.
- ROOFING**: SHEET METAL ROOFING PER IRC TABLE 905.10.3(1) & LOCAL ROOFING STANDARDS.
- FIREPLACE**: PREFABRICATED GAS FIREPLACE SHALL BE PROVIDED WITH THE FOLLOWING:
A. PREFABRICATED FIREPLACE TO BEAR STAMP OF APPROVED TESTING LAB.
B. TIGHT FITTING GLASS OR METAL DOORS
C. OUTSIDE SOURCE OF COMBUSTION AIR DUCTED INTO THE FIREBOX, PER PREFAB. GAS FIREPLACE REQUIREMENTS. (6 SQ. INCHES MIN. W/OVERLAP OUTSIDE AIR DUCT DAMPER).
D. TIGHT FITTING FLUE DAMPERS, OPERATED BY A READILY ACCESSIBLE MANUAL.
- GAS WATER HEATER**: GAS WATER HEATER SHALL BE STRAPPED TO PREVENT DISPLACEMENT IN AN EARTHQUAKE PER UMC 304.4.
- EXHAUST DUCTS**: PROVIDE BACKDRAFT DAMPERS AT ALL EXHAUST DUCTS.
- FURNACE ROOM**: PROVIDE COMBUSTION AIR OPENINGS INTO FURNACE RM. PER UMC 703.
- APPLIANCES**: CLEARANCES OF UL LISTED APPLIANCES FROM COMBUSTIBLE MATERIALS SHALL BE AS SPECIFIED IN UL LISTING.
- WATER FLOW**: SHOWER SHALL BE EQUIPPED WITH FLOW CONTROL DEVICE TO LIMIT WATER FLOW TO 2.5 GALLONS PER MINUTE.
- SMOKE DETECTORS**: S.D. THROUGHOUT NEW CONSTRUCTION PER 2018 IRC R313. TO BE MONITORED PER FIRE DEPT. REQUIREMENTS

ENERGY CREDITS = 6.0

(PRESCRIPTIVE)
TABLE 406.2 ENERGY CREDITS (Single Family)

Option	Description	Credit
HEATING OPTIONS # 2	HEAT PUMP	= 1.0
ENERGY OPTIONS 1.3	EFFICIENT BUILDING ENVELOPE	= 0.5
2.2	AIR LEAKAGE CONTROL & EFFICIENT VENTILATION (COMPLIANCE BASED ON SECT. 402.4.1.2)	= 1.0
3.5	AIR SOURCE, CENTRALLY DUCTED HEAT PUMP (MINIMUM HSPF OF 11.0)	= 1.5
5.5	EFFICIENCY WATER HEATER (MEETING STANDARDS OF Tier III OF NEEA'S SPEC.'S)	= 2.0
6.0 TOTAL ENERGY CREDITS		

ENERGY CODE

-HEATING SYSTEM IS A NATURAL GAS FURNACE FORCED AIR SYSTEM.
 -CONSTRUCTION SHALL ADHERE TO:

GLAZING RATIO

CLIMATE ZONE: **4C - MARINE**
 PRESCRIPTIVE PATH:
MARINE IV

WINDOWS = 0.28 U-FACTOR
 DOORS = 0.20 U-FACTOR

**(A.B.E.)
AVERAGE BUILDING ELEVATION**

MARK	WALL LENGTH	GRADE / ELEVATION	CALCULATION
A	17'	+330.5'	5618.5
B	3.5'	+330.5'	1157
C	22'	+330.5'	7271
D	2.0'	+330.5'	661
E	22'	+330.5'	7271
F	1'	+330.5'	330.5
G	10'	+330.5'	3305
H	21'	+331'	6951
I	16.5'	+331'	5461.5
J	9.5'	+331'	3144.5
K	65'	+331'	21515
L	33'	+331'	10923
TOTAL = 222.5'			

222.5/73,609
 A.B.E. = + 330.826
 Or 330'-10"

LOT INFORMATION

ZONE: **R-9.6**
 LOT: **11,233 s.f.**
 LOT SLOPE:
 HIGH ELEVATION = +333.8' / LOW ELEVATION = +328' :: 5.8' OF SLOPE
 DISTANCE BETWEEN: 5.8/224 = 4.8 %

GROSS FLOOR AREA(S) (G.F.A.)

UPPER FLOOR : 1,959 S.F.
 MAIN FLOOR : 1,359 S.F.
 GARAGE : 694 S.F.
 TOTAL G.F.A. = 4,012.5 S.F.
 Or **35.7 %**
 MAX. G.F.A. = 40% Or 4,493 s.f.

LOT COVERAGE


MAIN STRUCTURE ROOF AREA : 2898 S.F. (Includes All Attached Porches)
 VEHICULAR USE : 532 S.F.
 TOTAL COVERAGE : 3430 S.F.
 Or **30.5 %**
 MAX. G.F.A. = 40% Or 4,493 s.f.

LOT HARDSCAPE

WALKWAY : 100 S.F.
 BACK PATIO : 128 S.F.
 TOTAL HARDSCAPE : 228 S.F. Or **2.0 %**
 MAX. HARDSCAPE = 9% Or 1,010 s.f.

SITE NOTES

- PLACE COMPOST SOCKS, COMPOST BERMS, FILTER FABRIC FENCING, STRAW BAILS, STRAW WATTLES, OR OTHER APPROVED PERIMETER CONTROL BMP'S TO ELIMINATE CONSTRUCTION STORMWATER RUN-OFF.
- ELIMINATE UNCONTROLLED CONVEYANCE OF MUD & DIRT INTO THE RIGHT-OF-WAY (R.O.W.)
- COVER BARE SOILS WITH COMPOST BLANKETS, STRAW, MULCH, MATTING, OR OTHER APPROVED EQUAL TO CONTROL CONSTRUCTION STORMWATER RUN-OFF.
- COVER STOCKPILES OF BARE SLOPES WITH COMPOST BLANKETS, TARPS, MATTING OR OTHER APPROVED EQUAL TO CONTROL CONSTRUCTION STORMWATER RUN-OFF.
- MERCER ISLAND - MICC 19.02.030(F)(3)(d) ALL JAPANESE KNOTWEED, (POLYGONUM CUSPIDATUM), & REGULATED CLASS 'A', REGULATED CLASS 'B', REGULATED CLASS 'C' WEEDS, IDENTIFIED ON KING COUNTY NOXIOUS WEED LIST SHALL BE REMOVED FROM PROPERTY PURSUANT TO SUBSECTION 19.02.020(F)(3)(a).

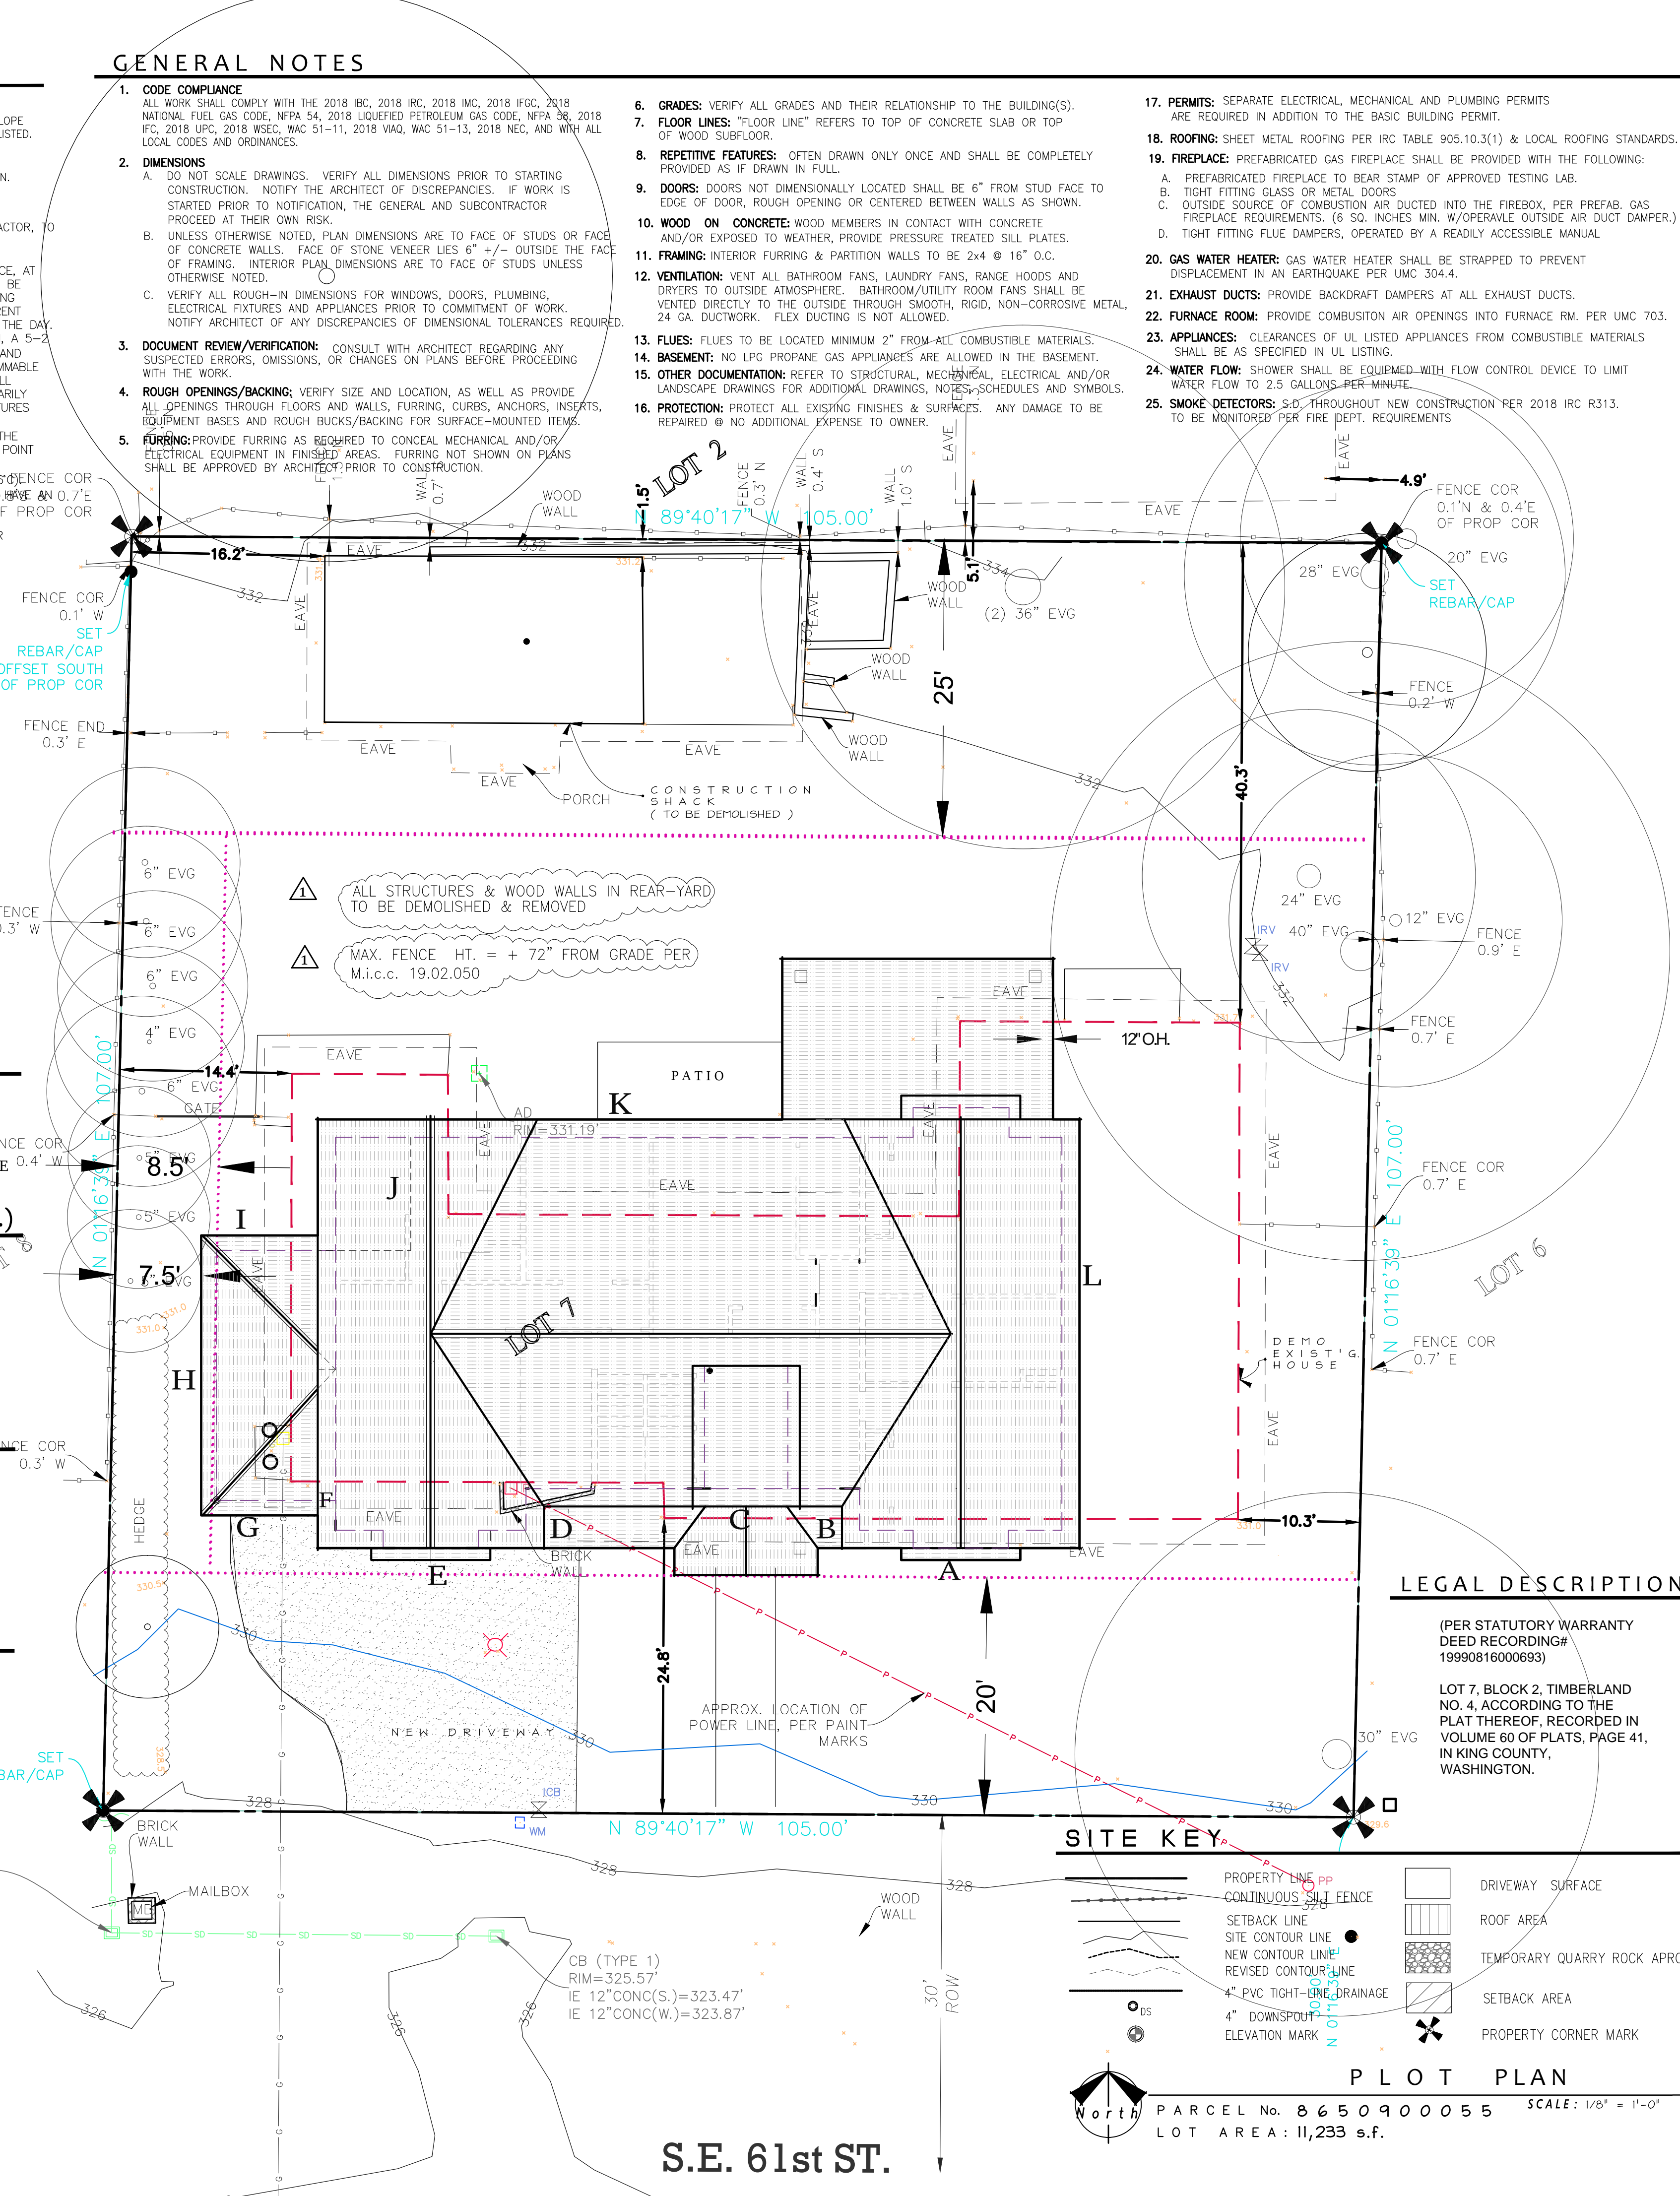

SITE KEY

- PROPERTY LINE
- CONTINUOUS SILT FENCE
- SETBACK LINE
- SITE CONTOUR LINE
- NEW CONTOUR LINE
- REVISED CONTOUR LINE
- 4" PVC TIGHT-LINE DRAINAGE
- 4" DOWNSPOUT
- ELEVATION MARK
- DRIVEWAY SURFACE
- ROOF AREA
- TEMPORARY QUARRY ROCK APRON
- SETBACK AREA
- PROPERTY CORNER MARK

PLOT PLAN
 PARCEL No. 8 6 5 0 9 0 0 0 5 5
 LOT AREA: 11,233 s.f.
 SCALE: 1/8" = 1'-0"

RFA ARCHITECTS
 RICHARD A FISHER ARCHITECTS
 8245 Northrup Pl. S.W.
 SEATTLE, WA 98136
 (206) 484-9963
 EMAIL: RAFISHER@RICHARDAFISHER.COM
 WEB: RICHARDAFISHER.COM
 WOLF CREEK RANCH
 WINTHROP, WASHINGTON 98862
 TEL.: (509) 996-2689

R K K Construction
LOT - 7
 PROJECT NAME: PROJECT ADDRESS:
 9026 S.E. 61st St.
 Mercer Is., WA 98040

SET TITLE:	PERMIT SET
SHEET TITLE:	GENERAL NOTES & SITE PLAN

STAMP:
 4884
 RICHARD A. FISHER
 STATE OF WASHINGTON

PROJECT #: **21020**
 DATE: **NOV. 8, 2021**
 DRAWN BY: N.F.W.
 REVISIONS:
 1. BLDG. DEPT. REVIEW - 2/22

SHEET No.:
A1.0

WINDOW SCHEDULE

TAG	DIMENSIONS (R.O. = w x h)	TYPE	NOTES
A	2'-0" X 6'-0"	SIDELITE	SAFETY GLAZE / (4) LITES Ea.
B	3'-0" X 3'-0"	CASEMENT	
C	(2) 2'-6" X 3'-6"	CSPMNT/CSPMNT	EGRESS / SAFETY GLAZE
D	2'-0" X 5'-0"	SIDELITE	SAFETY GLAZE
E	(2) 2'-6" X 5'-0"	CSPMNT/CSPMNT	SAFETY GLAZE
F	(2) 2'-6" X 3'-0"	CSPMNT/CSPMNT	SAFETY GLAZE
G	2'-6" X 3'-6"	CASEMENT	
H	2'-0" X 3'-0"	CASEMENT	(4) LITES
I	6'-0" X 3'-0"	PICTURE	(4) LITES
J	3'-0" X 4'-0"	CASEMENT	SAFETY GLAZE / (4) LITES Ea.
K	(2) 3'-0" X 4'-0"	CSPMNT/CSPMNT	SAFETY GLAZE / (4) LITES Ea.
L	(2) 2'-6" X 4'-0"	CSPMNT/CSPMNT	(4) LITES
M	(3) 2'-6" X 4'-0"	CASE/PIC/CASE	
N	(2) 2'-6" X 3'-6"	CSPMNT/CSPMNT	SAFETY GLAZE / (4) LITES Ea.
O	4'-0" X 2'-0"	SLIDER	SAFETY GLAZE / (2) LITES Ea.
P	(2) 2'-0" X 2'-0"	AWNING/AWING	SAFETY GLAZE
Q	Width below X 1'-6"	TRANSOM	

NOTES:
1. 'SG' = SAFETY GLAZING.
2. DOOR 'U-FACTOR' = 0.20
3. WINDOW 'U-FACTOR' = 0.28

DOOR SCHEDULE

TAG	DIMENSIONS (R.O. = w x h)	TYPE	NOTES
1	3'-0" X 6'-8"	ENTRY	SOLID WD./SAFETY GLAZE / LOCKSET
2	16'-0" X 8'-0"	GARAGE	'CARRIAGE STYLE'
3	8'-0" X 8'-0"	GARAGE	'CARRIAGE STYLE'
4	3'-0" X 6'-8"	GLASS	SAFETY GLAZE
5	5'-0" X 6'-8"	BARN SLIDER	EXPOSED HARDWARE
6	3'-0" X 6'-8"	SEPARATION	1-HR. FIRE RATED w/ INTEGRAL SMOKE GASKETS 'SELF-CLOSER' REQUIRED PER R302.5.1
7	2'-6" X 6'-8"	STND. WOOD	
8	(2) 3'-0" X 6'-8"	GLASS	SAFETY GLAZE
9	(2) 2'-6" X 6'-8"	GLASS	SAFETY GLAZE
10	(4) 3'-0" X 6'-8"	DBL.SLIDER	
11	2'-6" X 6'-8"	POCKET	POCKET HARDWARE
12	3'-0" X 6'-8"	STND. WOOD	
13	3'-0" X 6'-8"	SOLID WOOD	LOUVERED MECH. DOOR - SEE PLAN NOTE #8
14	2'-0" X 6'-8"	STND. WOOD	
15	(2) 3'-0" X 6'-8"	STND. WOOD	
16	(2) 2'-6" X 6'-8"	STND. WOOD	
17	(2) 2'-6" X 6'-8"	GLASS INTERIOR	
18	22.5" X 4'-0"	ATTIC ACCESS	DROP DOWN LADDER
19	22.5" X 3'-0"	GRAWL ACCESS	INSULATED / REMOVABLE PANEL



NOTES:
1. 'SG' = SAFETY GLAZING.
2. DOOR 'U-FACTOR' = 0.20
3. WINDOW 'U-FACTOR' = 0.28

PLAN NOTES

- WHOLE HOUSE VENTILATION TO BE PROVIDED BY FORCED AIR FURNACE WITH DIRECT OUTSIDE AIR.
- SMOKE DETECTORS SHALL BE HARD-WIRED & PROVIDED IN EXISTING SPACES WITH BATTERY BACK-UP PER IRC 313 & INSTALLED PER IRC 314.2.2
- STAIR HANDRAILS TO CONFORM TO I.R.C. SECT. 311.5.6. w/ 36" Ht. FROM TREAD AND NOSING, TYP.
- ALL OUTLETS @ COUNTER HEIGHT, (@BATHS, KITCHEN, LAUNDRY) SHALL BE G.F.C.I.
- DO NOT SCALE OFF DRAWINGS, NOTED DIMENSIONS SHALL @ ALL TIMES TAKE PRECEDENT. DIMS. ARE TO FACE OF FRAMING, TYP. -WDW. & DOOR DIMS. ARE TO ROUGH OPENING
- SEE SHEET A2.0 FOR DOOR & WINDOW SCHEDULES.
- CONTRACTOR SHALL VERIFY TO INSPECTOR ALL GUARDS & RAILINGS SHALL BE CAPABLE OF RESISTING 200 Lb.
- MECHANICAL RM. DOOR: PER IRC SECTION 303.3. ALL COMBUSTIBLE AIR MUST BE TAKEN FROM OUTDOORS IN ACCORDANCE WITH IMC CHAPTER 7. MECHANICAL RM. DOORS SHALL BE SOLID CORE WITH EXTERIOR WEATHER STRIPPING & APPROVED SELF-CLOSING DEVICE.

PLAN KEY


- 4" PARTITION WALL
- 6" EXTERIOR WALL
- STRUCTURE BELOW
- SITE SETBACK AREA
- MECHANICAL VENT FAN (CUBIC FEET PER MINUTE)
- ELEVATION MARKER
- CARBON MONOXIDE DETECTOR (APPROVED PER IRC315.1)
- CENTERLINE
- PROPERTY CORNER MARK
- SMOKE DETECTOR (PER R313 & R314.2.2)
- SAFETY-GLAZING
- HEAT DETECTOR (PER R314.2.3)

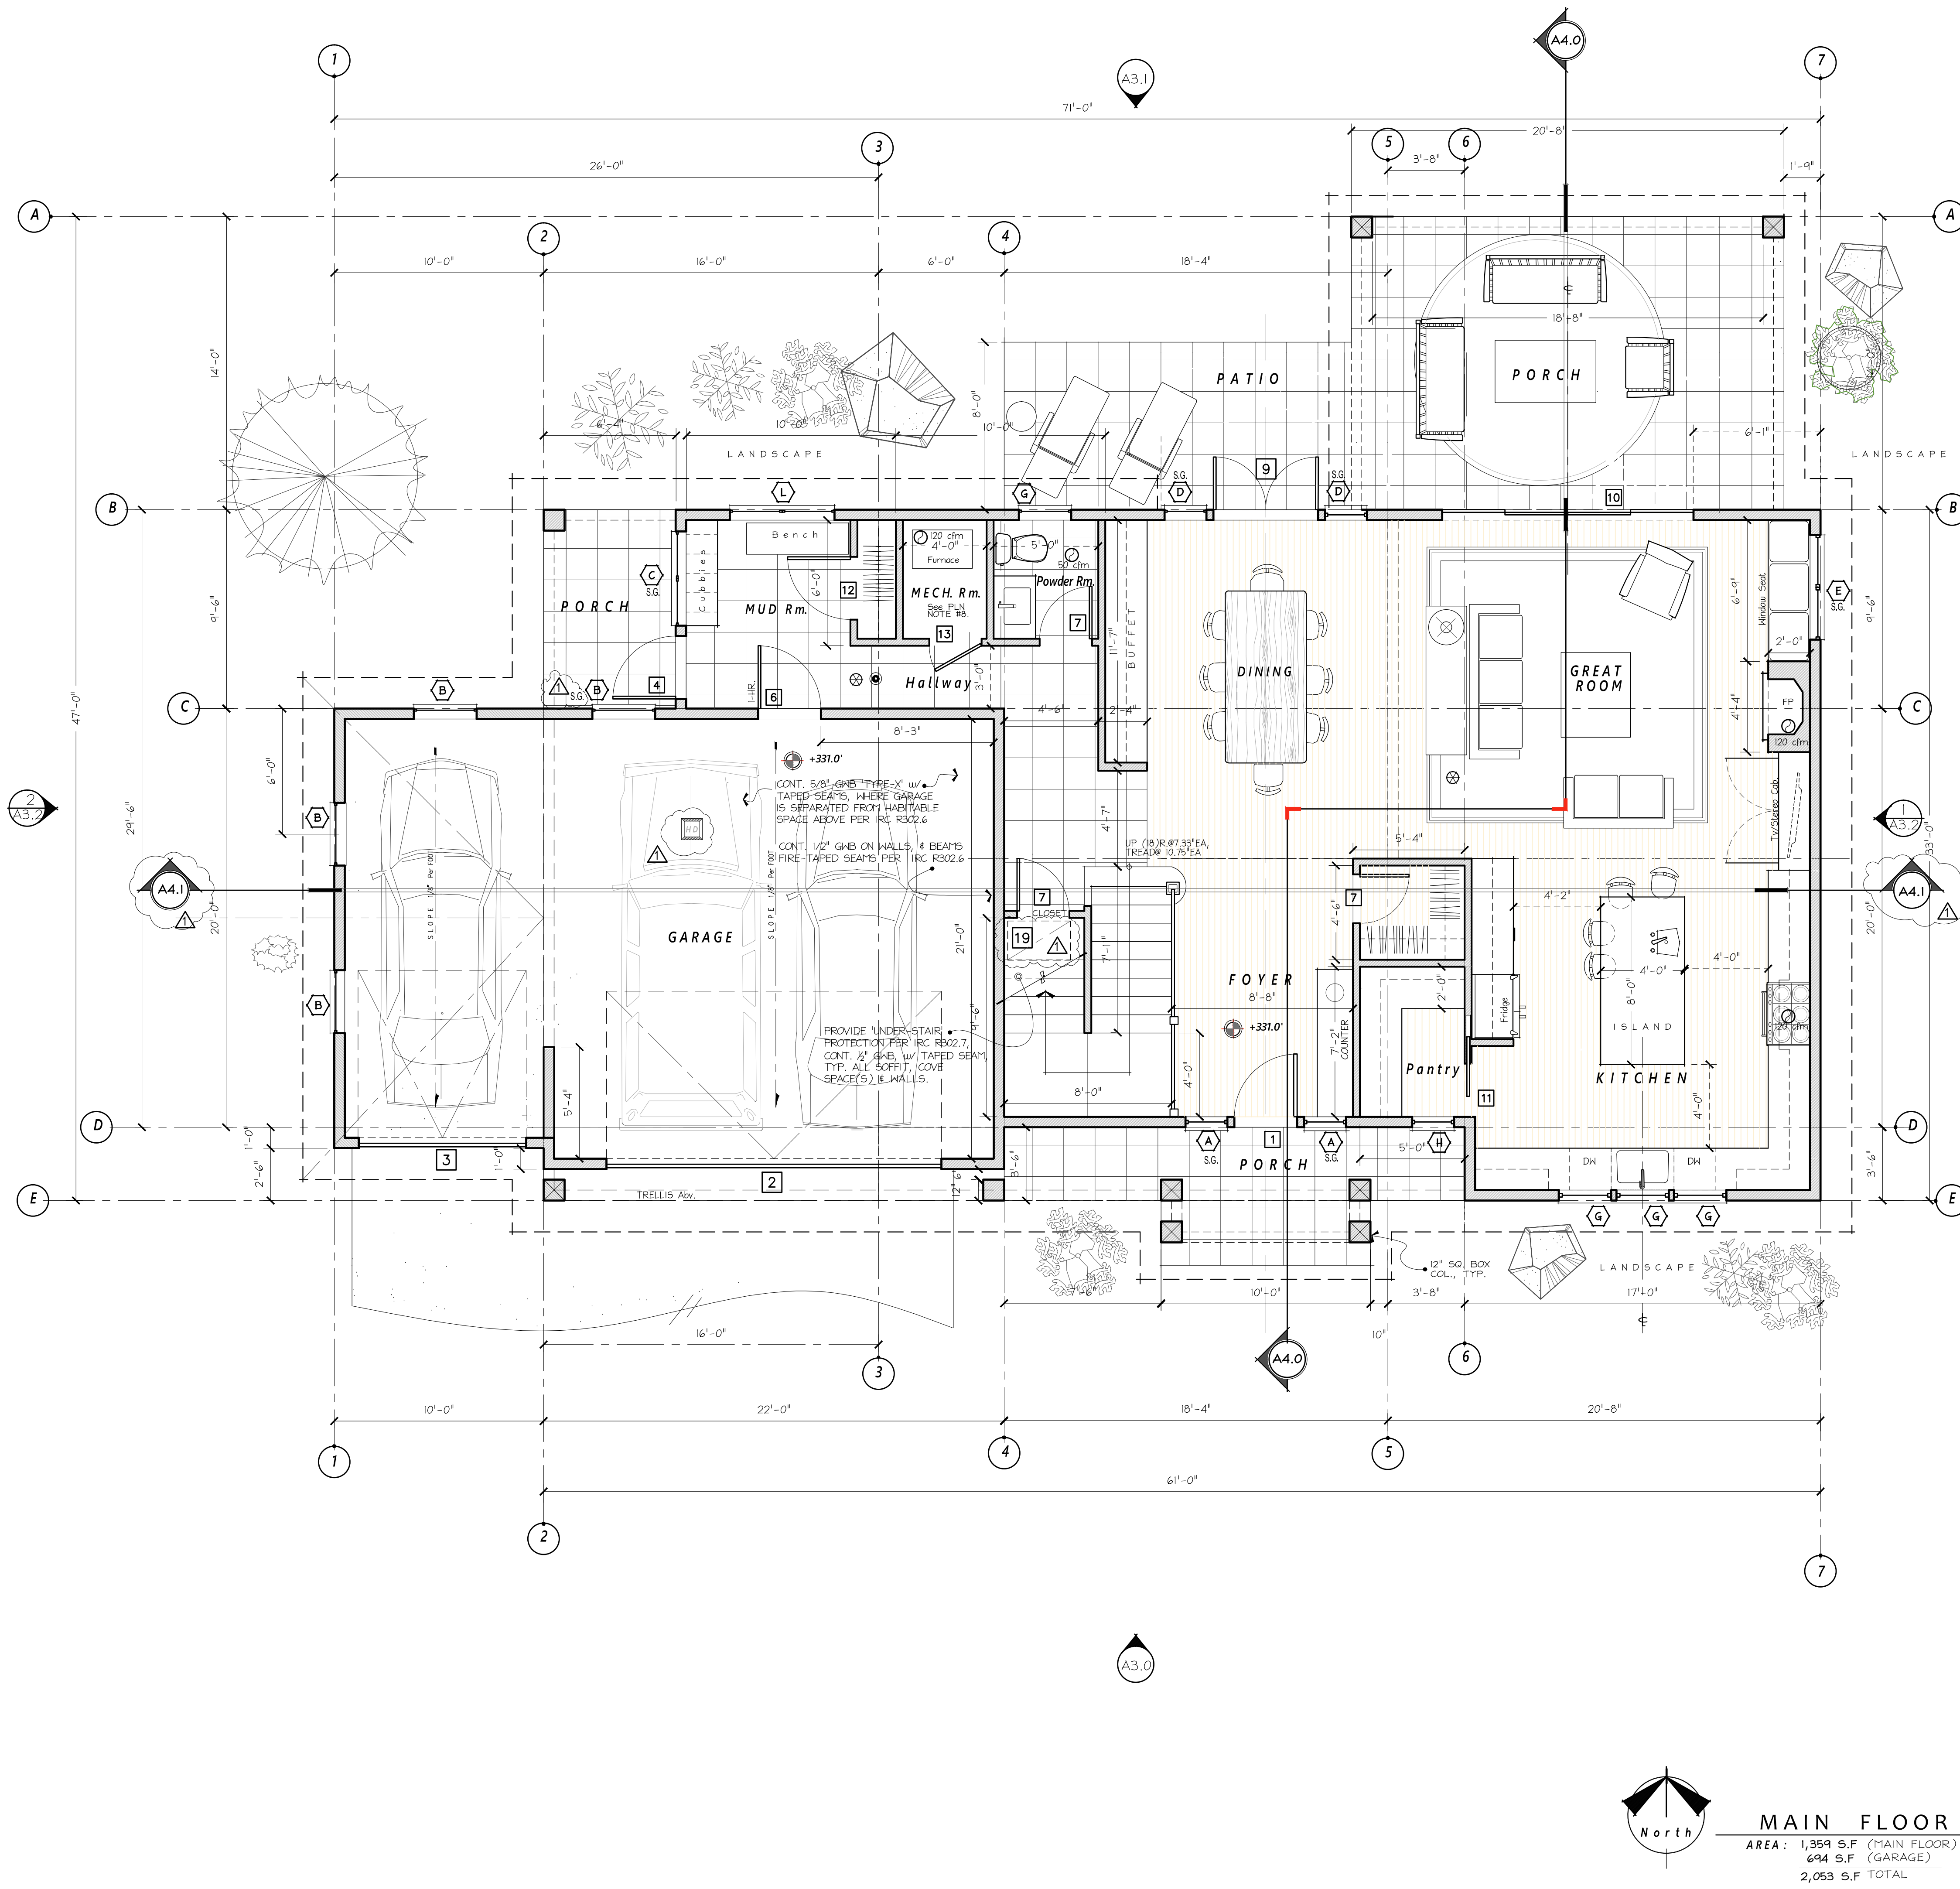

MAIN FLOOR PLAN

AREA: 1,359 S.F. (MAIN FLOOR)
694 S.F. (GARAGE)
2,053 S.F. TOTAL

SCALE: 1/4" = 1'-0"

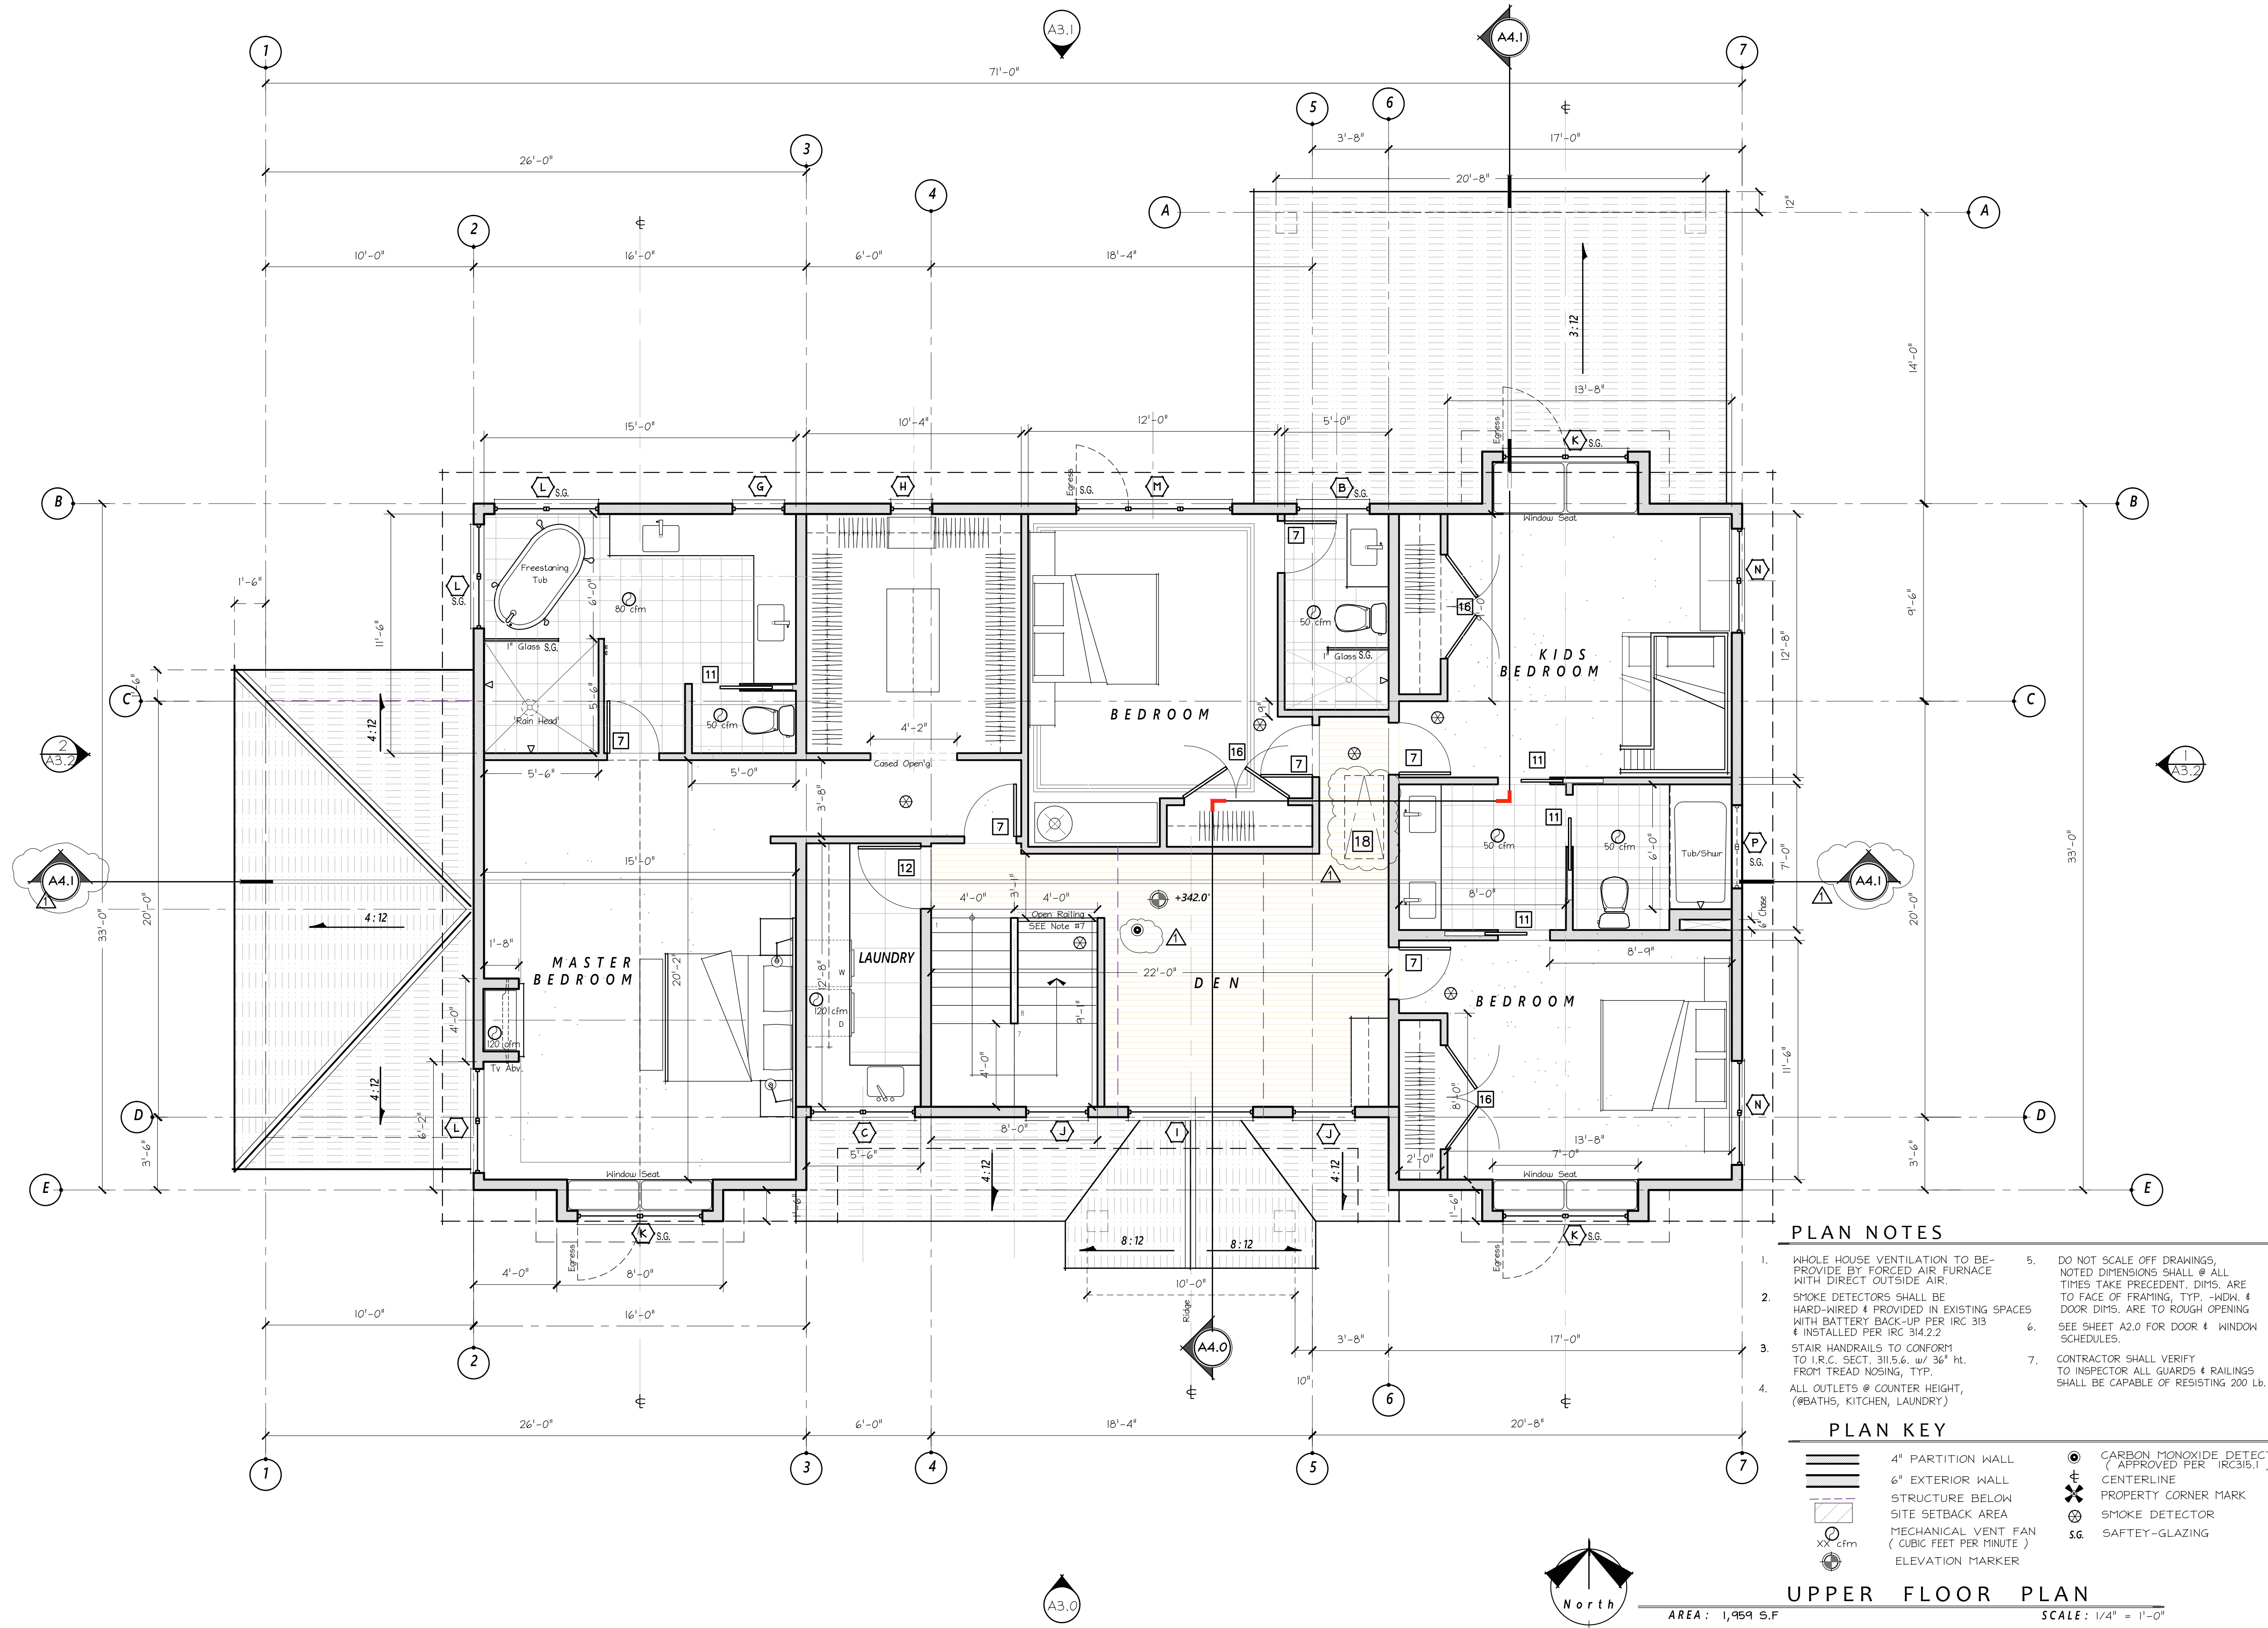

PLAN NOTES

- WHOLE HOUSE VENTILATION TO BE PROVIDED BY FORCED AIR FURNACE WITH DIRECT OUTSIDE AIR.
- SMOKE DETECTORS SHALL BE HARD-WIRED & PROVIDED IN EXISTING SPACES WITH BATTERY BACK-UP PER IRC 313 & INSTALLED PER IRC 314.2.2
- STAIR HANDRAILS TO CONFORM TO I.R.C. SECT. 311.5.6. w/ 36" ht. FROM TREAD NOSING, TYP.
- ALL OUTLETS @ COUNTER HEIGHT, (@BATHS, KITCHEN, LAUNDRY)
- DO NOT SCALE OFF DRAWINGS, NOTED DIMENSIONS SHALL @ ALL TIMES TAKE PRECEDENT. DIMS. ARE TO FACE OF FRAMING, TYP. -HDDW: & DOOR DIMS. ARE TO ROUGH OPENING SCHEDULES.
- SEE SHEET A2.0 FOR DOOR & WINDOW SCHEDULES.
- CONTRACTOR SHALL VERIFY TO INSPECTOR ALL GUARDS & RAILINGS SHALL BE CAPABLE OF RESISTING 200 LB.


PLAN KEY

- 4" PARTITION WALL
- 6" EXTERIOR WALL
- STRUCTURE BELOW
- SITE SETBACK AREA
- MECHANICAL VENT FAN (CUBIC FEET PER MINUTE)
- ELEVATION MARKER
- CARBON MONOXIDE DETECTOR (APPROVED PER IRC315.1)
- CENTERLINE
- PROPERTY CORNER MARK
- SMOKE DETECTOR
- SAFETY-GLAZING

UPPER FLOOR PLAN
AREA: 1,959 S.F. SCALE: 1/4" = 1'-0"

ATTIC VENTING

HOUSE AREA = 1,959 s.f.
 1959 / 300 = 6.53 s.f.
RIDGE VENT(S) PROVIDED: 94 L.F. X 16 sq.in. = 1504 sq.in.
SOFFIT VENT(S) PROVIDED: 120 L.F. X 24 sq.in. = 2280 sq.in.

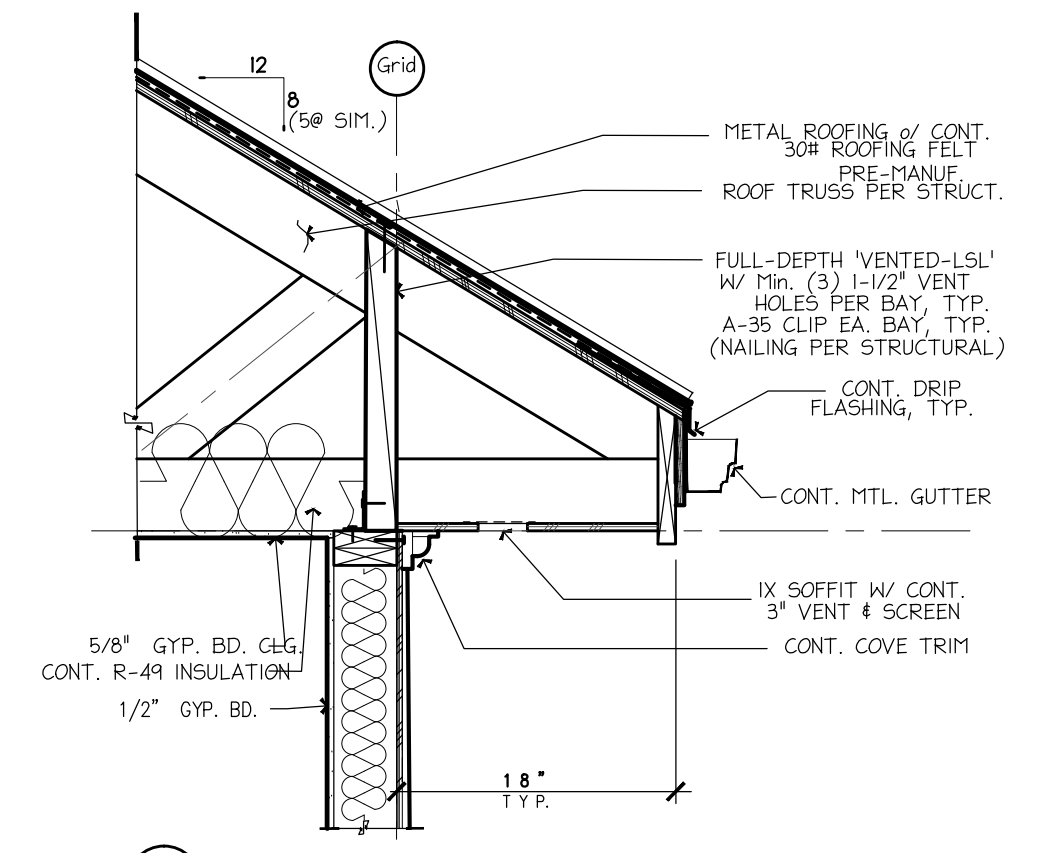

RFA ARCHITECTS
RICHARD A FISHER ARCHITECTS
 8245 Northrup Pl. S.W.
 SEATTLE, WA 98136
 (206) 484-9963
 EMAIL: RAFISHER@RICHARDAFISHER.COM
 WEB: RICHARDAFISHER.COM
 WOLF CREEK RANCH
 WINTHROP, WASHINGTON 98862
 TEL.: (509) 996-2689


PROJECT NAME: PROJECT ADDRESS:
R K K Construction
LOT . 7
 9026 S.E. 61st St.
 Mercer Is., WA 98040

SET TITLE:	PERMIT SET
SHEET TITLE:	ROOF PLAN

STAMP:
 4884
 RICHARD A. FISHER
 STATE OF WASHINGTON


PROJECT #:	21020
DATE:	NOV. 8, 2021
DRAWN BY:	N. F. W.
REVISIONS:	
Tag	Description

SHEET No.:
A2.2

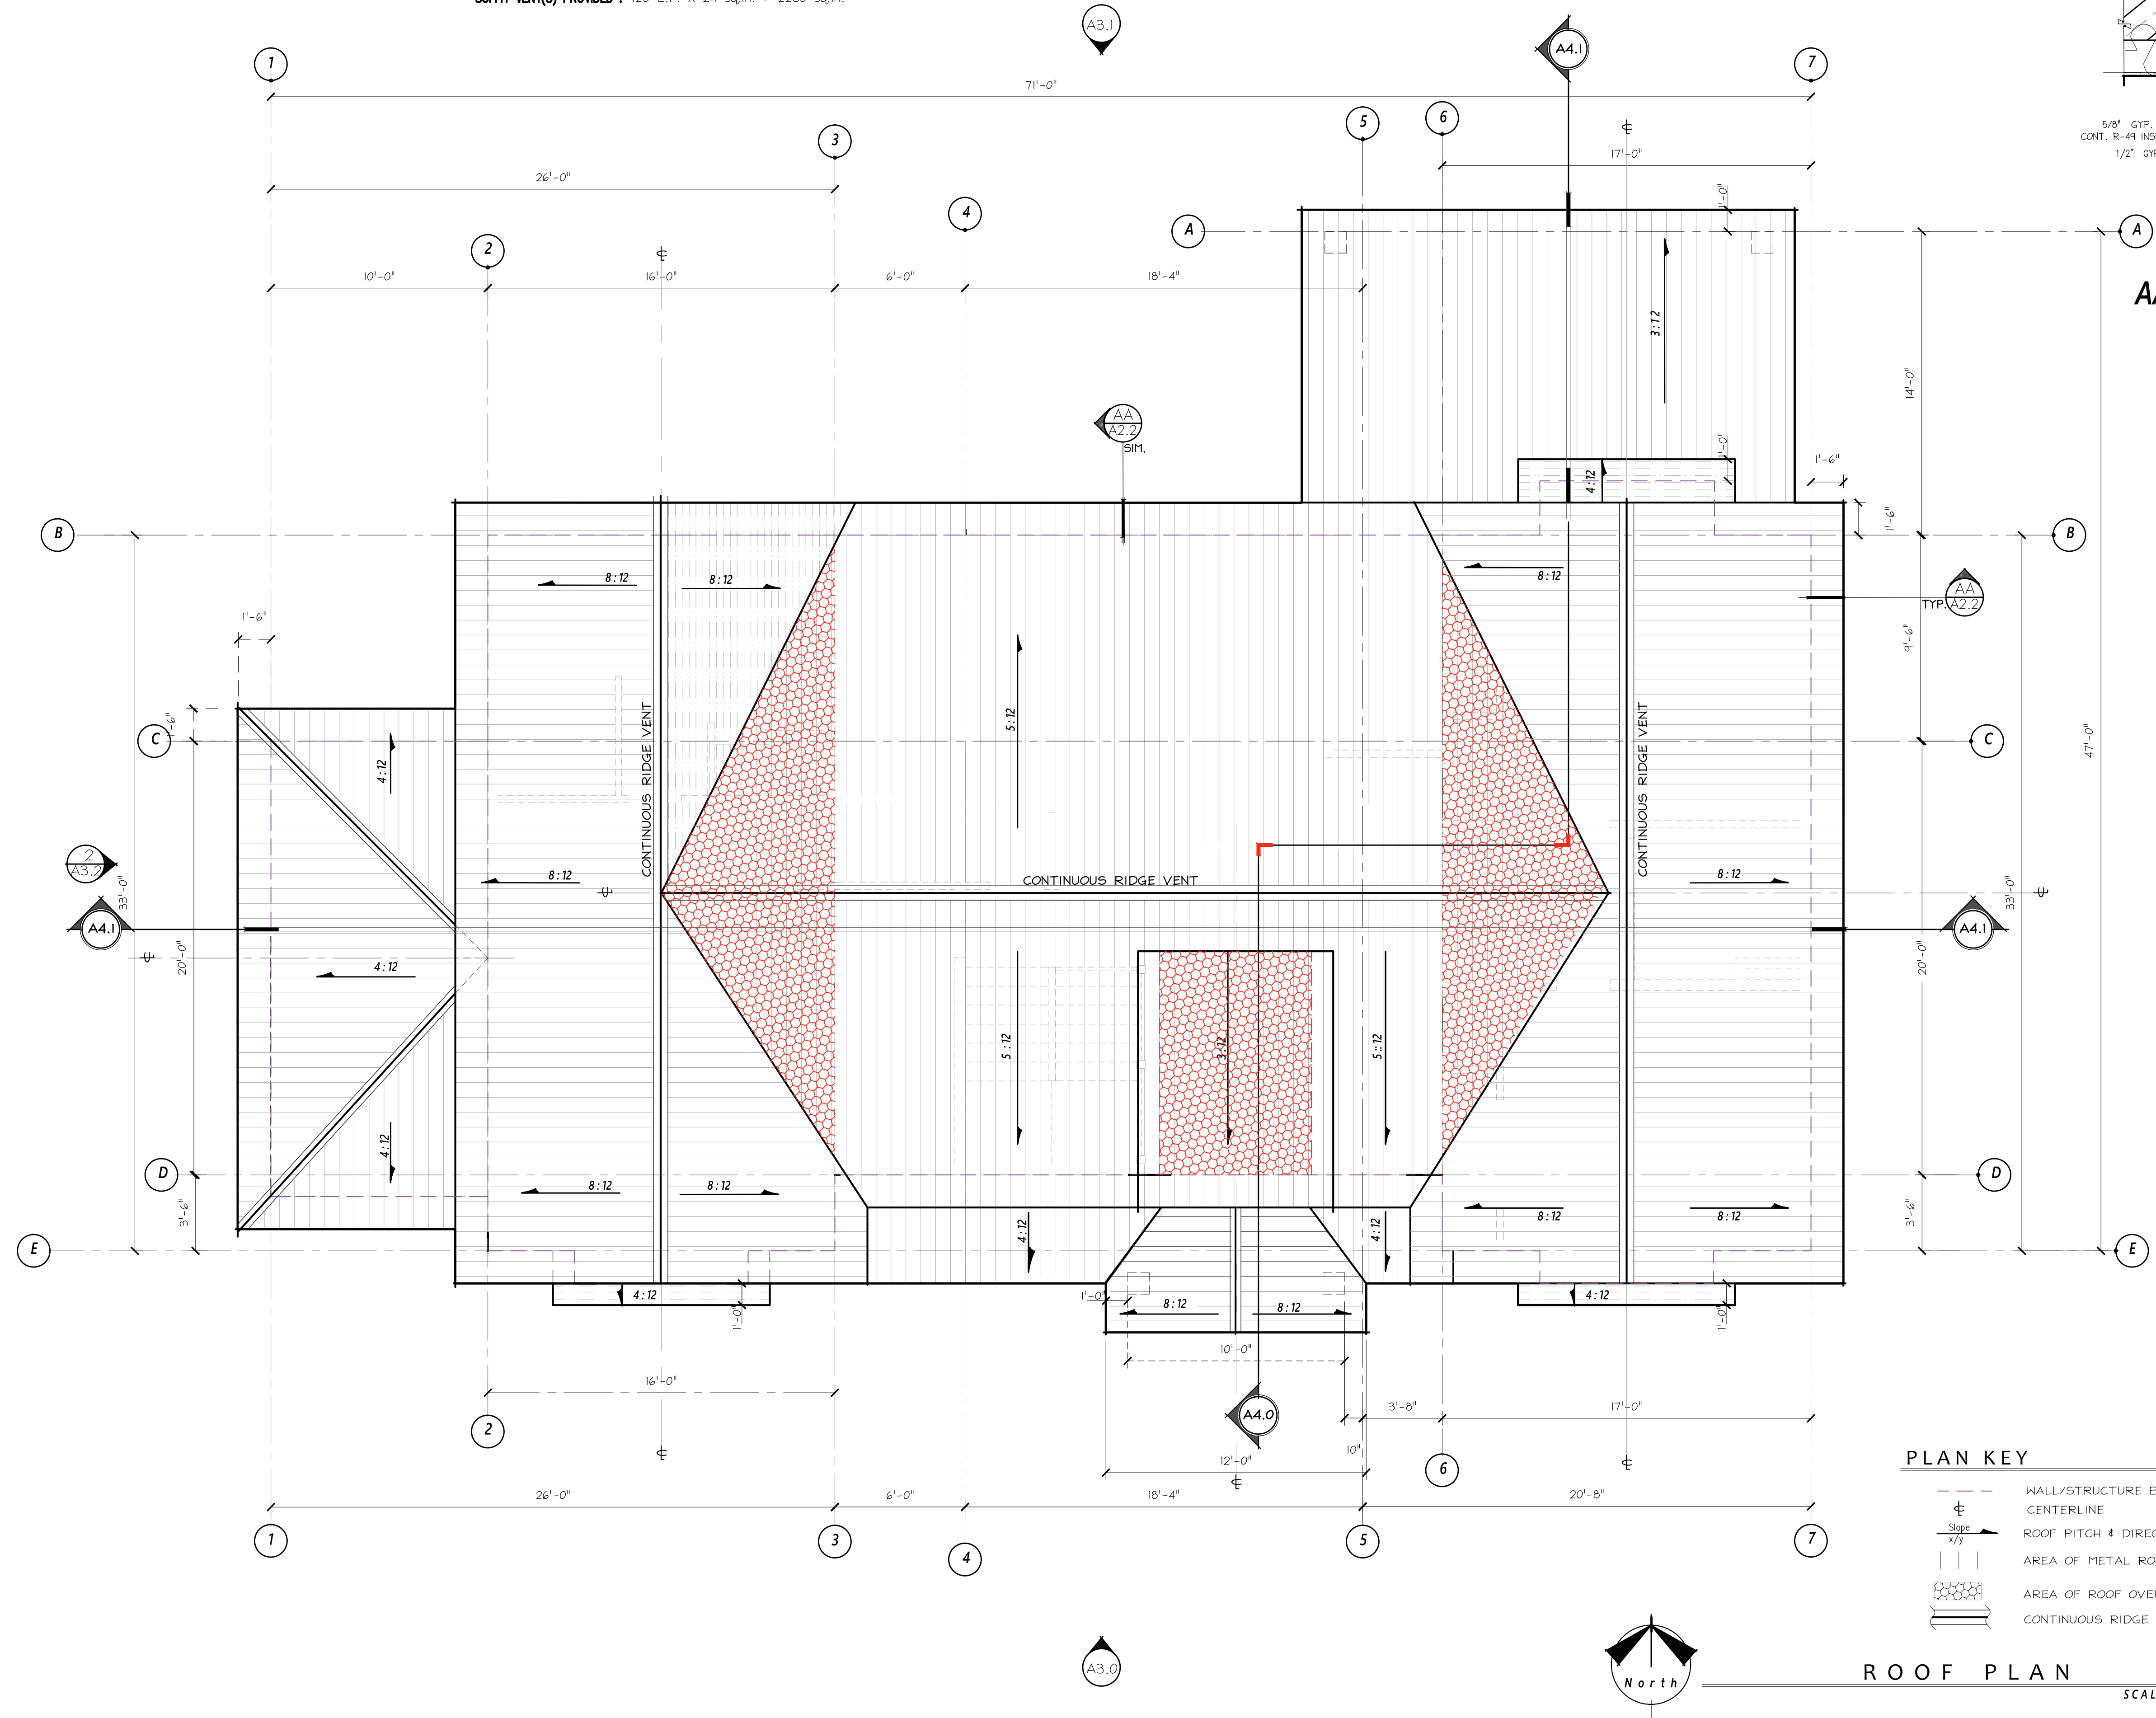

PLAN KEY

- WALL/STRUCTURE BELOW
- ⊕ CENTERLINE
- ↗ ROOF PITCH & DIRECTION
- ||| AREA OF METAL ROOFING
- ▨ AREA OF ROOF OVER-FRAMING
- ▬ CONTINUOUS RIDGE VENT



ROOF PLAN
 SCALE: 1/4" = 1'-0"



SOUTH ELEVATION

SCALE: 1/4" = 1'-0"

PROJECT NAME:	PROJECT ADDRESS:
R K K Construction	9026 S.E. 61st St.
LOT - 7	Mercer Is., WA 98040

SET TITLE:	PERMIT SET
SHEET TITLE:	ELEVATIONS

STAMP:

PROJECT #:	21020
DATE:	NOV. 8, 2021
DRAWN BY:	N. F. W.
REVISIONS:	
Tag	Description

SHEET No.:

A3.0



NORTH ELEVATION

SCALE: 1/4" = 1'-0"

PROJECT NAME:	PROJECT ADDRESS:
R K K Construction	9026 S.E. 61st St.
LOT - 7	Mercer Is., WA 98040

SET TITLE:	PERMIT SET
SHEET TITLE:	ELEVATIONS


STAMP:

RICHARD A. FISHER
STATE OF WASHINGTON


PROJECT #:	21020
DATE:	NOV. 8, 2021
DRAWN BY:	N. F. W.
REVISIONS:	
Tag	Description

SHEET No.:

A3.1

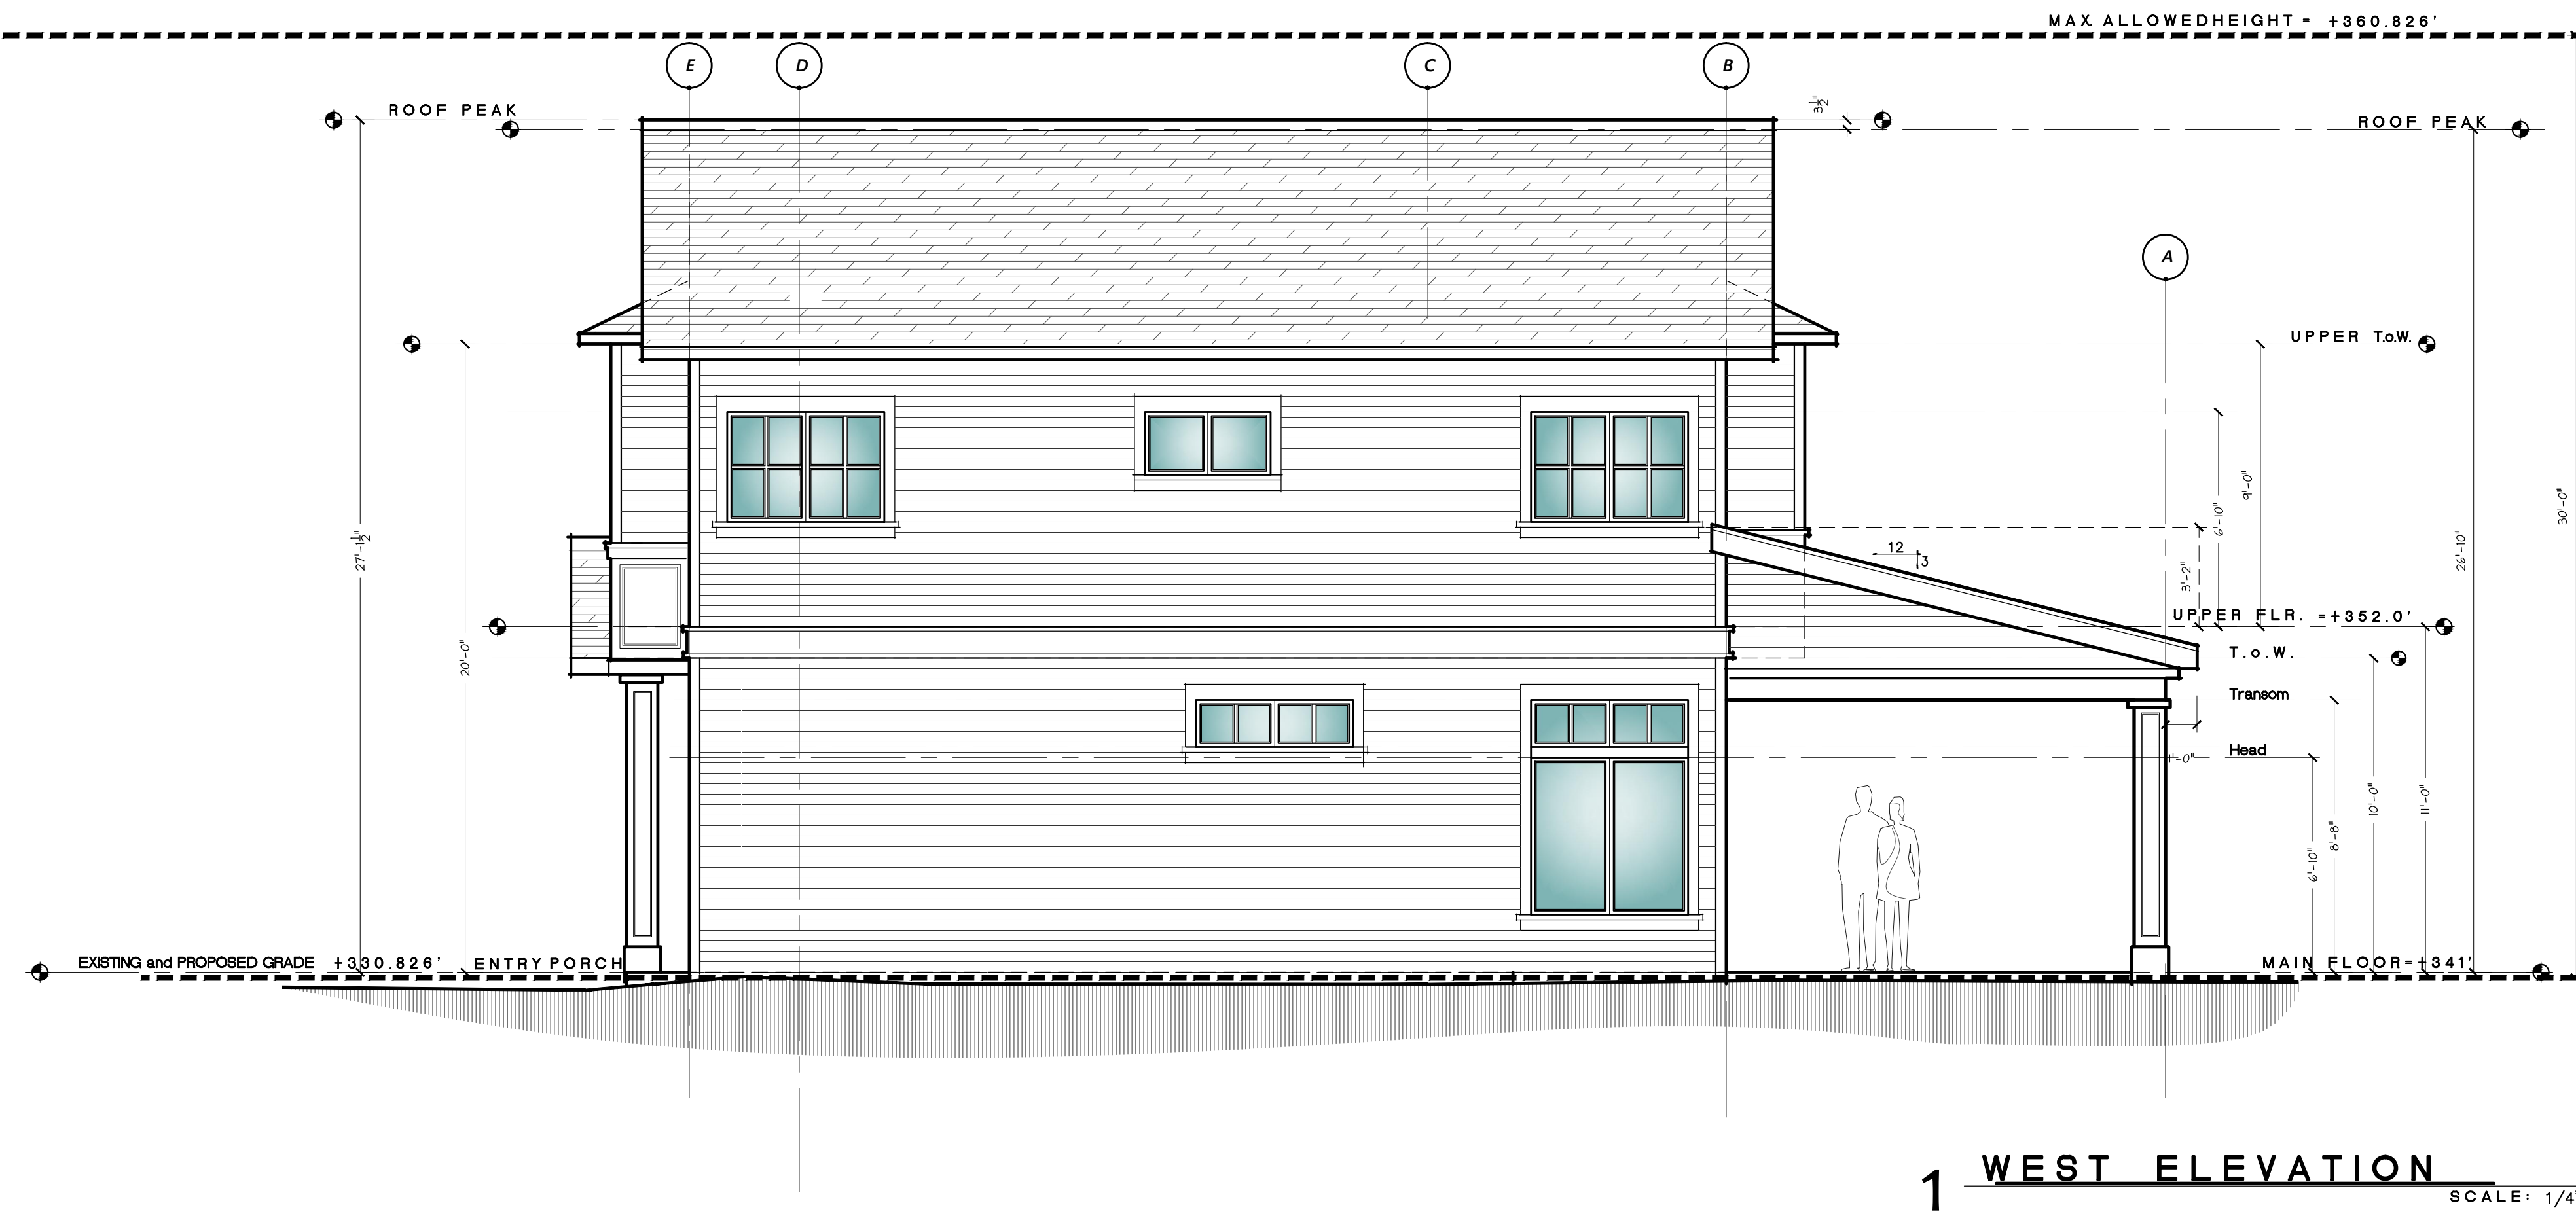


1 WEST ELEVATION
SCALE: 1/4" = 1'-0"

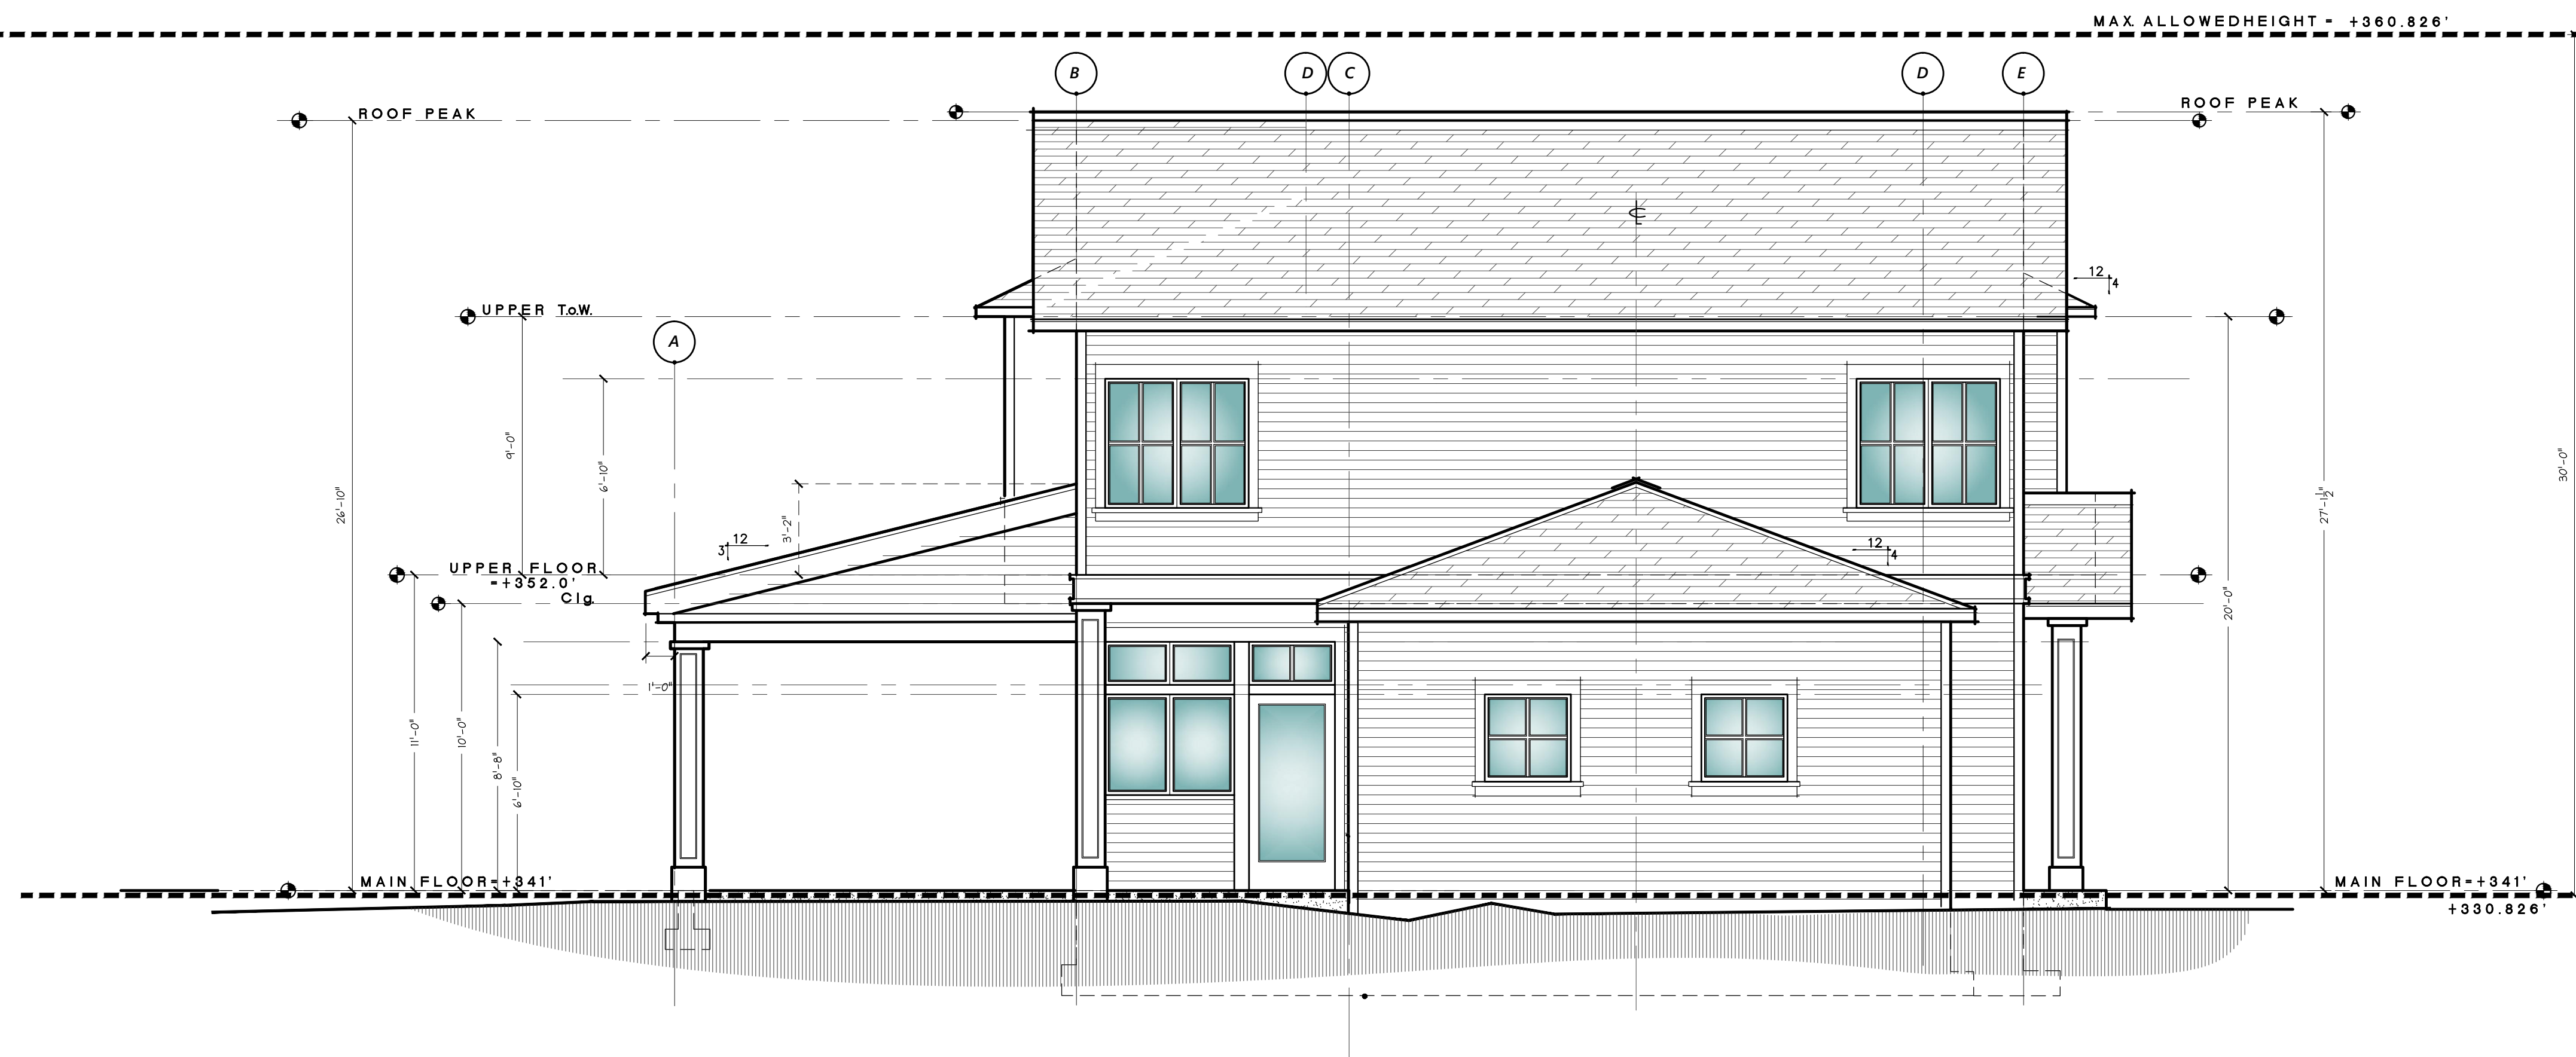

2 EAST ELEVATION
SCALE: 1/4" = 1'-0"


PROJECT NAME:	PROJECT ADDRESS:
R K K Construction	9026 S.E. 61st St.
LOT . 7	Mercer Is., WA 98040

SET TITLE:	PERMIT SET
SHEET TITLE:	ELEVATION

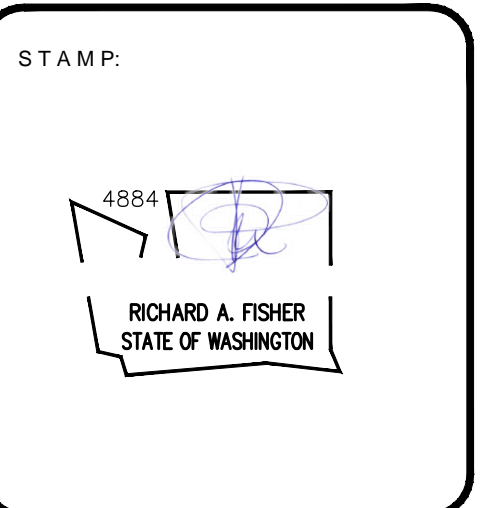

PROJECT #:	21020
DATE:	NOV. 8, 2021
DRAWN BY:	N. F. W.
REVISIONS:	
Tag	Description

SHEET No.:
A3.2

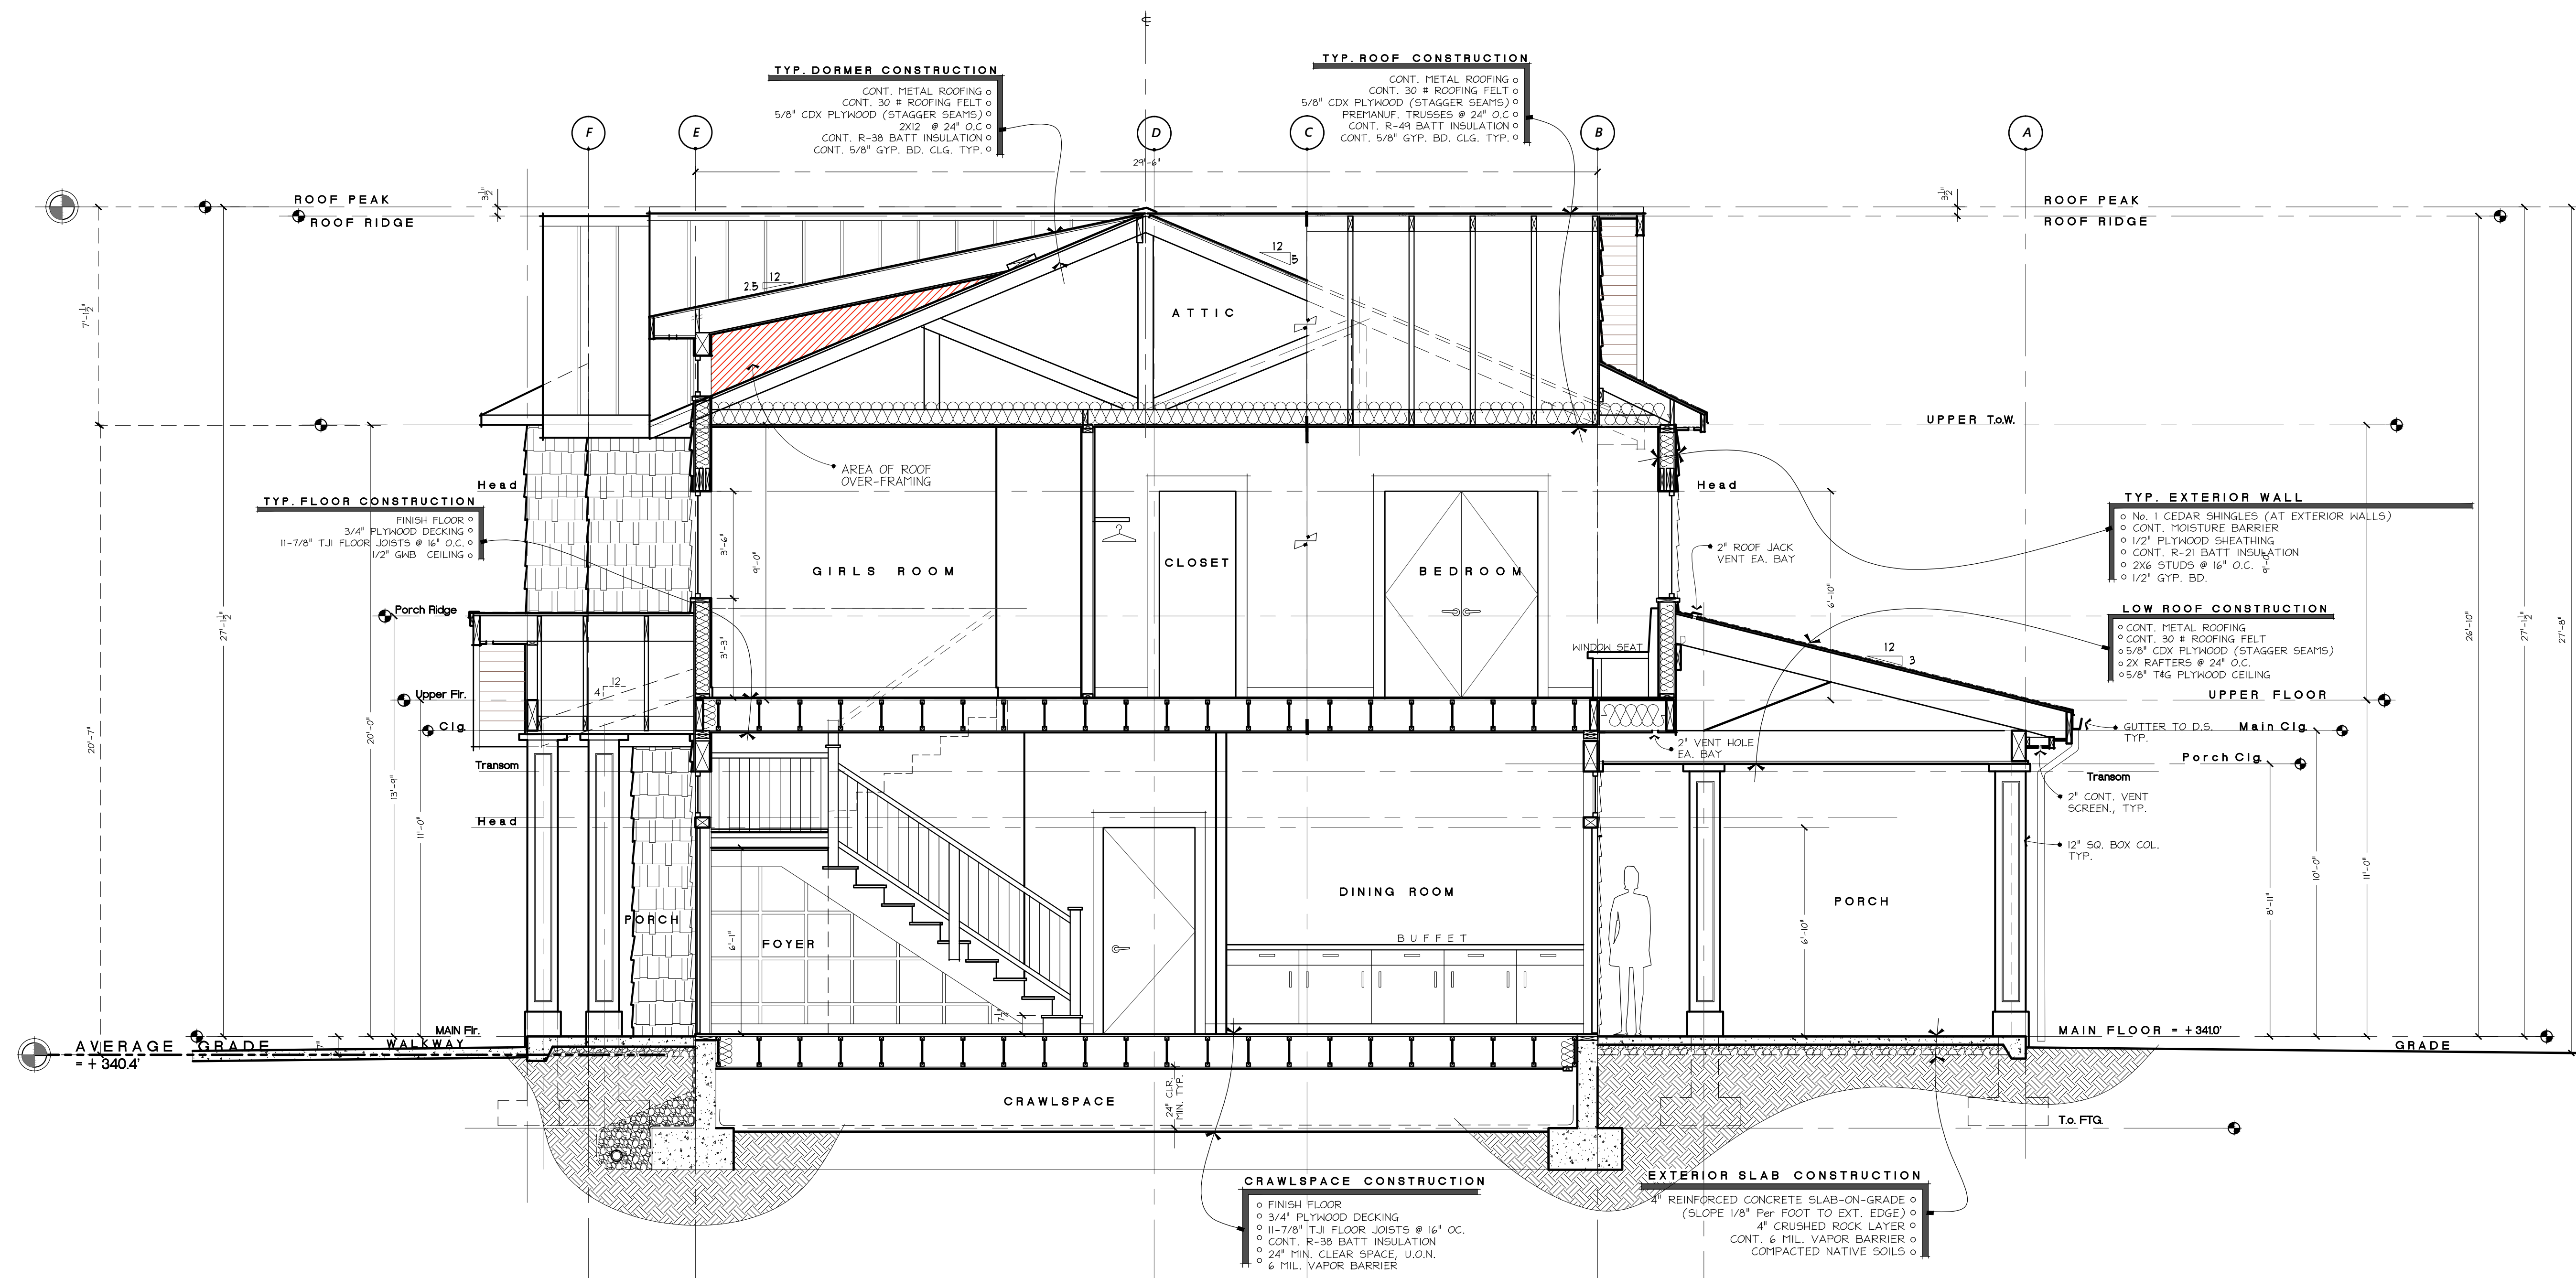

PROJECT NAME: PROJECT ADDRESS:
R K K Construction
LOT - 7
9026 S.E. 61st St.
Mercer Is., WA 98040

SET TITLE: PERMIT SET
SHEET TITLE: SECTION


STAMP:
4884
RICHARD A. FISHER
STATE OF WASHINGTON

PROJECT #: 21020
DATE: NOV. 8, 2021
DRAWN BY: N. F. W.
REVISIONS:

Tag	Description

SHEET No.:
A4.0

SECTION
SCALE: 3/8" = 1'-0"

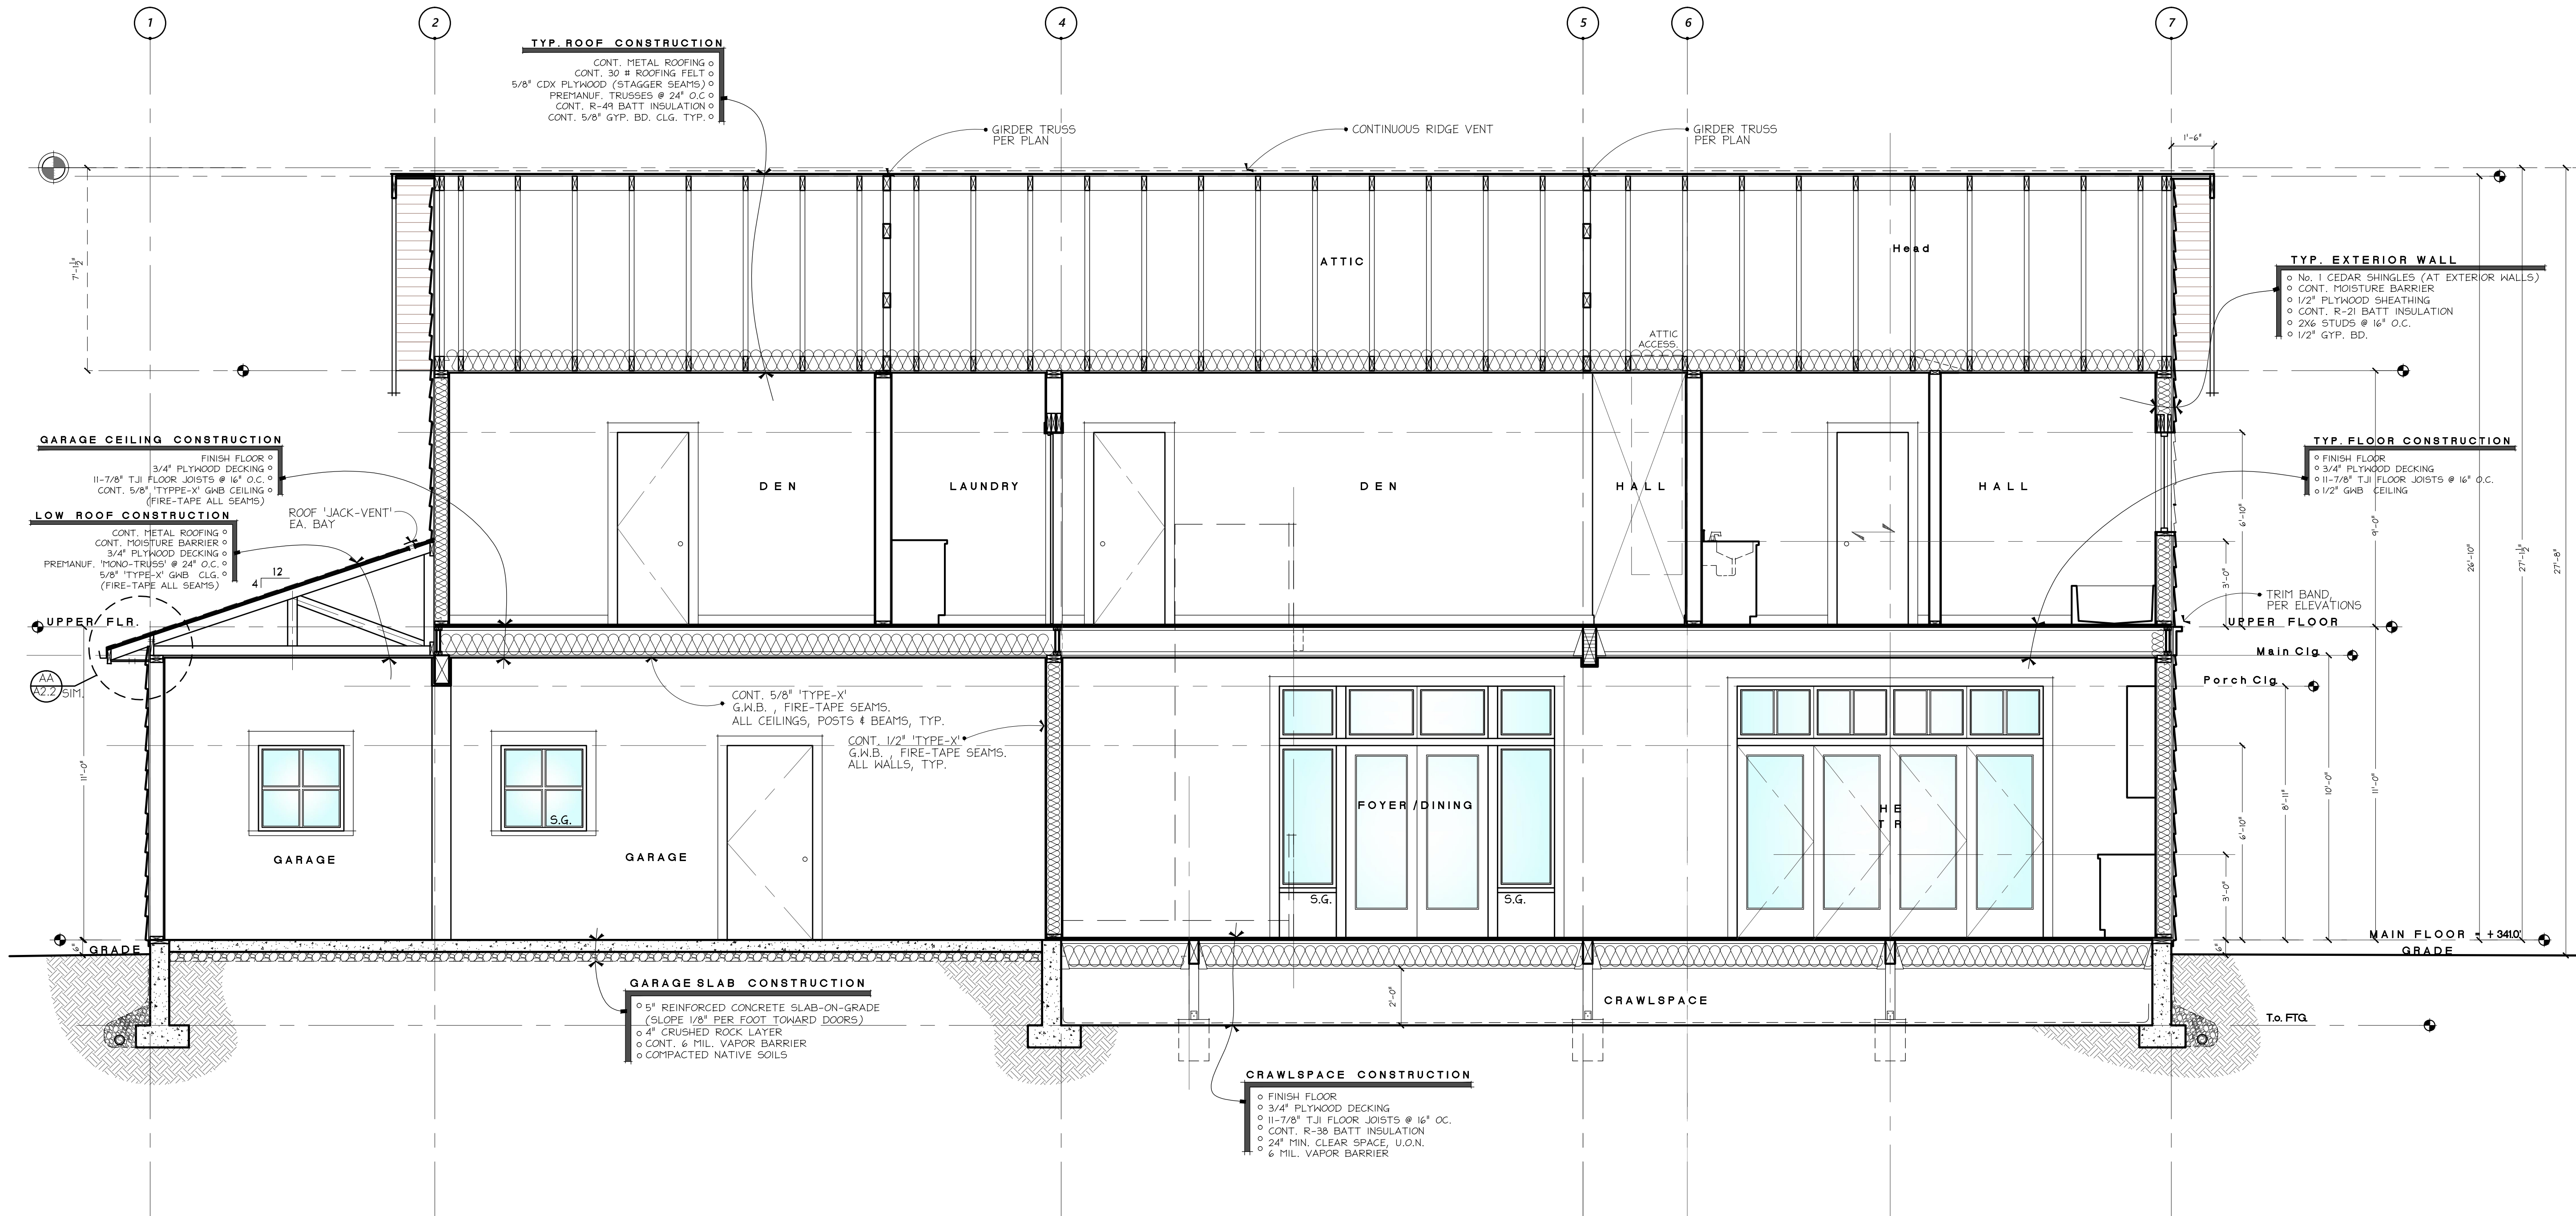

PROJECT NAME: **R K K Construction**
PROJECT ADDRESS: **LOT - 7**
9026 S.E. 61st St.
Mercer Is., WA 98040

SET TITLE: **PERMIT SET**
SHEET TITLE: **SECTION**

STAMP:
4884
RICHARD A. FISHER
STATE OF WASHINGTON

PROJECT #: **21020**
DATE: **NOV. 8, 2021**
DRAWN BY: **N.F.W.**
REVISIONS:
M.I. BLDG. DEPT REVIEW

SHEET No.: **A4.1**

SECTION SCALE: 3/8" = 1'-0"

TOPOGRAPHIC & BOUNDARY SURVEY

LEGAL DESCRIPTION

(PER STATUTORY WARRANTY DEED RECORDING# 19990816000693)
 LOT 7, BLOCK 2, TIMBERLAND NO. 4, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 60 OF PLATS, PAGE 41, IN KING COUNTY, WASHINGTON.

BASIS OF BEARINGS

N 89°30'25" W BETWEEN SURVEY MONUMENTS FOUND AND HELD AS SHOWN HEREON, ON THE CENTERLINE OF S.E. 60TH ST., AS CALCULATED PER TIMBERLAND NO. 2, NO. 4 & NO. 6.

REFERENCES

- R1 TIMBERLAND NO. 2, RECORDED IN VOLUME 58 OF PLATS, PAGE 27, RECORDS OF KING COUNTY, WASHINGTON.
- R2 TIMBERLAND NO. 4, RECORDED IN VOLUME 60 OF PLATS, PAGE 41, RECORDS OF KING COUNTY, WASHINGTON.
- R3 TIMBERLAND NO. 6, RECORDED IN VOLUME 68 OF PLATS, PAGE 15, RECORDS OF KING COUNTY, WASHINGTON.

VERTICAL DATUM

NAVD(88) PER CITY OF MERCER ISLAND BENCHMARK NO. 1064
 4" X 4" CONCRETE POST WITH BRASS NAIL IN CASE DOWN 1.0',
 NORTHERLY MOST OF 2 MONUMENTS IN CUL-DE-SAC OF S.E. 60TH ST.
 EL: 302.38'

SURVEYOR'S NOTES


1. THE TOPOGRAPHIC SURVEY SHOWN HEREON WAS PERFORMED IN APRIL OF 2021. THE FIELD DATA WAS COLLECTED AND RECORDED ON MAGNETIC MEDIA THROUGH AN ELECTRONIC THEODOLITE. THE DATA FILE IS ARCHIVED ON DISC OR CD. WRITTEN FIELD NOTES MAY NOT EXIST. CONTOURS ARE SHOWN FOR CONVENIENCE ONLY. DESIGN SHOULD RELY ON SPOT ELEVATIONS.
2. ALL MONUMENTS SHOWN HEREON WERE LOCATED DURING THE COURSE OF THIS SURVEY UNLESS OTHERWISE NOTED.
3. THE TYPES AND LOCATIONS OF ANY UTILITIES SHOWN ON THIS DRAWING ARE BASED ON INFORMATION PROVIDED TO US, BY OTHERS OR GENERAL INFORMATION READILY AVAILABLE IN THE PUBLIC DOMAIN INCLUDING, AS APPLICABLE, IDENTIFYING MARKINGS PLACED BY UTILITY LOCATE SERVICES AND OBSERVED BY TERRANE IN THE FIELD. AS SUCH, THE UTILITY INFORMATION SHOWN ON THESE DRAWINGS ARE FOR INFORMATIONAL PURPOSES ONLY AND SHOULD NOT BE RELIED ON FOR DESIGN OR CONSTRUCTION PURPOSES; TERRANE IS NOT RESPONSIBLE OR LIABLE FOR THE ACCURACY OR COMPLETENESS OF THIS UTILITY INFORMATION. FOR THE ACCURATE LOCATION AND TYPE OF UTILITIES NECESSARY FOR DESIGN AND CONSTRUCTION, PLEASE CONTACT THE SITE OWNER AND THE LOCAL UTILITY LOCATE SERVICE (800-424-5555).
4. SUBJECT PROPERTY TAX PARCEL NO. 865090-0055.
5. SUBJECT PROPERTY AREA PER THIS SURVEY IS 11,233 ±S.F. (0.26 ACRES)
6. THIS SURVEY WAS PERFORMED WITHOUT THE BENEFIT OF A TITLE REPORT. EASEMENTS AND OTHER ENCUMBRANCES MAY EXIST THAT ARE NOT SHOWN HEREON.
7. FIELD DATA FOR THIS SURVEY WAS OBTAINED BY DIRECT FIELD MEASUREMENTS WITH A CALIBRATED ELECTRONIC 5-SECOND TOTAL STATION AND/OR SURVEY GRADE GPS OBSERVATIONS. ALL ANGULAR AND LINEAR RELATIONSHIPS ARE ACCURATE AND MEET THE STANDARDS SET BY WAC 332-130-090.

LEGEND


	AREA DRAIN		MONUMENT (SURFACE, FOUND)
	ASPHALT SURFACE		POST
	BOLLARD		POWER METER
	BUILDING		POWER (OVERHEAD)
	CENTERLINE ROW		POWER POLE
	CONCRETE SURFACE		REBAR & CAP (SET)
	RETAINING WALL		SEWER LINE
	FENCE LINE (WOOD)		SEWER MANHOLE
	GAS LINE		STORM DRAIN LINE
	GAS METER		TELEPHONE (OVERHEAD)
	HEDGE FOLIAGE LINE		TREE (AS NOTED)
	INLET (TYPE 1)		TV LINE
	IRRIGATION CONTROL VALVE		WATER LINE
	MAILBOX (RESIDENTIAL)		WATER METER
	MONUMENT IN CASE (FOUND)		YARD LIGHT

VICINITY MAP

N.T.S.

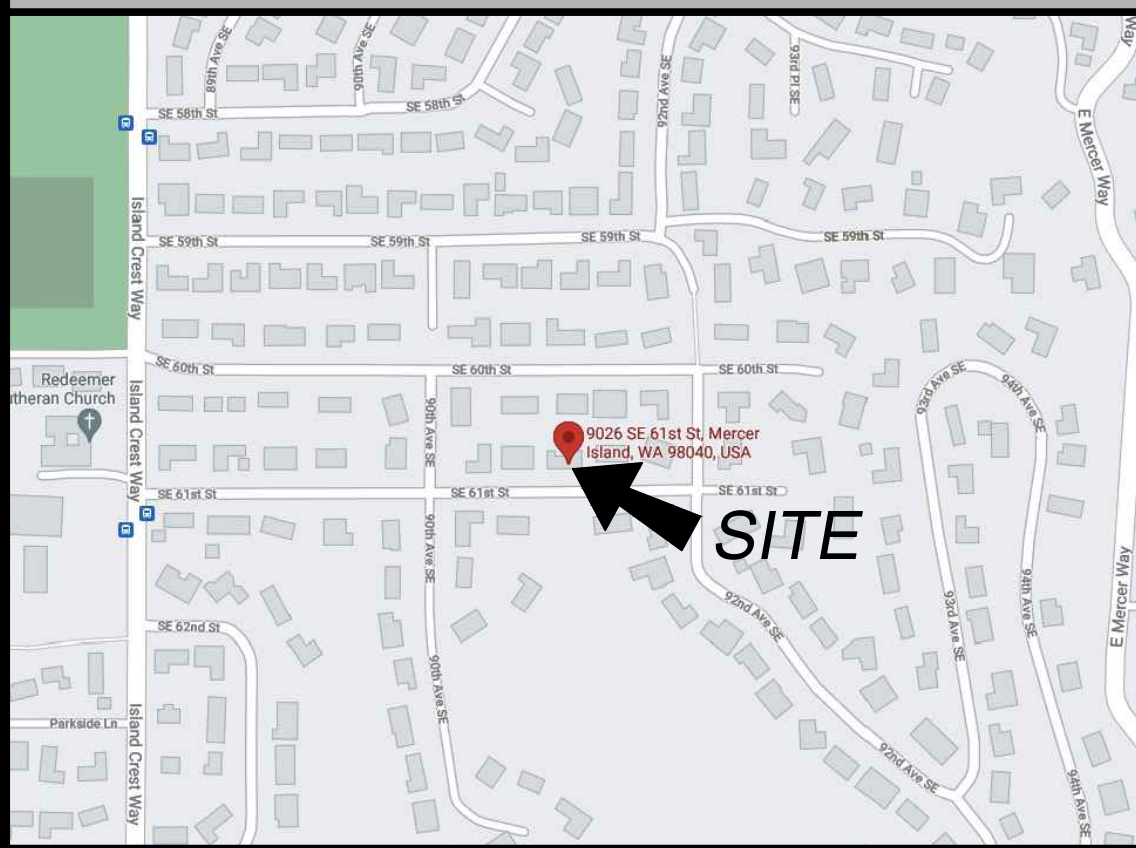


STEEP SLOPE/BUFFER DISCLAIMER:
 THE LOCATION AND EXTENT OF STEEP SLOPES SHOWN ON THIS DRAWING ARE FOR INFORMATIONAL PURPOSES ONLY AND CANNOT BE RELIED ON FOR DESIGN AND/OR CONSTRUCTION. THE PITCH, LOCATION, AND EXTENT ARE BASED SOLELY ON OUR GENERAL OBSERVATIONS ON SITE AND OUR CURSORY REVIEW OF READILY AVAILABLE PUBLIC DOCUMENTS; AS SUCH, TERRANE CANNOT BE LIABLE OR RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF ANY STEEP SLOPE INFORMATION. ULTIMATELY, THE LIMITS AND EXTENT OF ANY STEEP SLOPES ASSOCIATED WITH ANY SETBACKS OR OTHER DESIGN OR CONSTRUCTION PARAMETERS MUST BE DISCUSSED AND APPROVED BY THE REVIEWING AGENCY BEFORE ANY CONSTRUCTION CAN OCCUR.

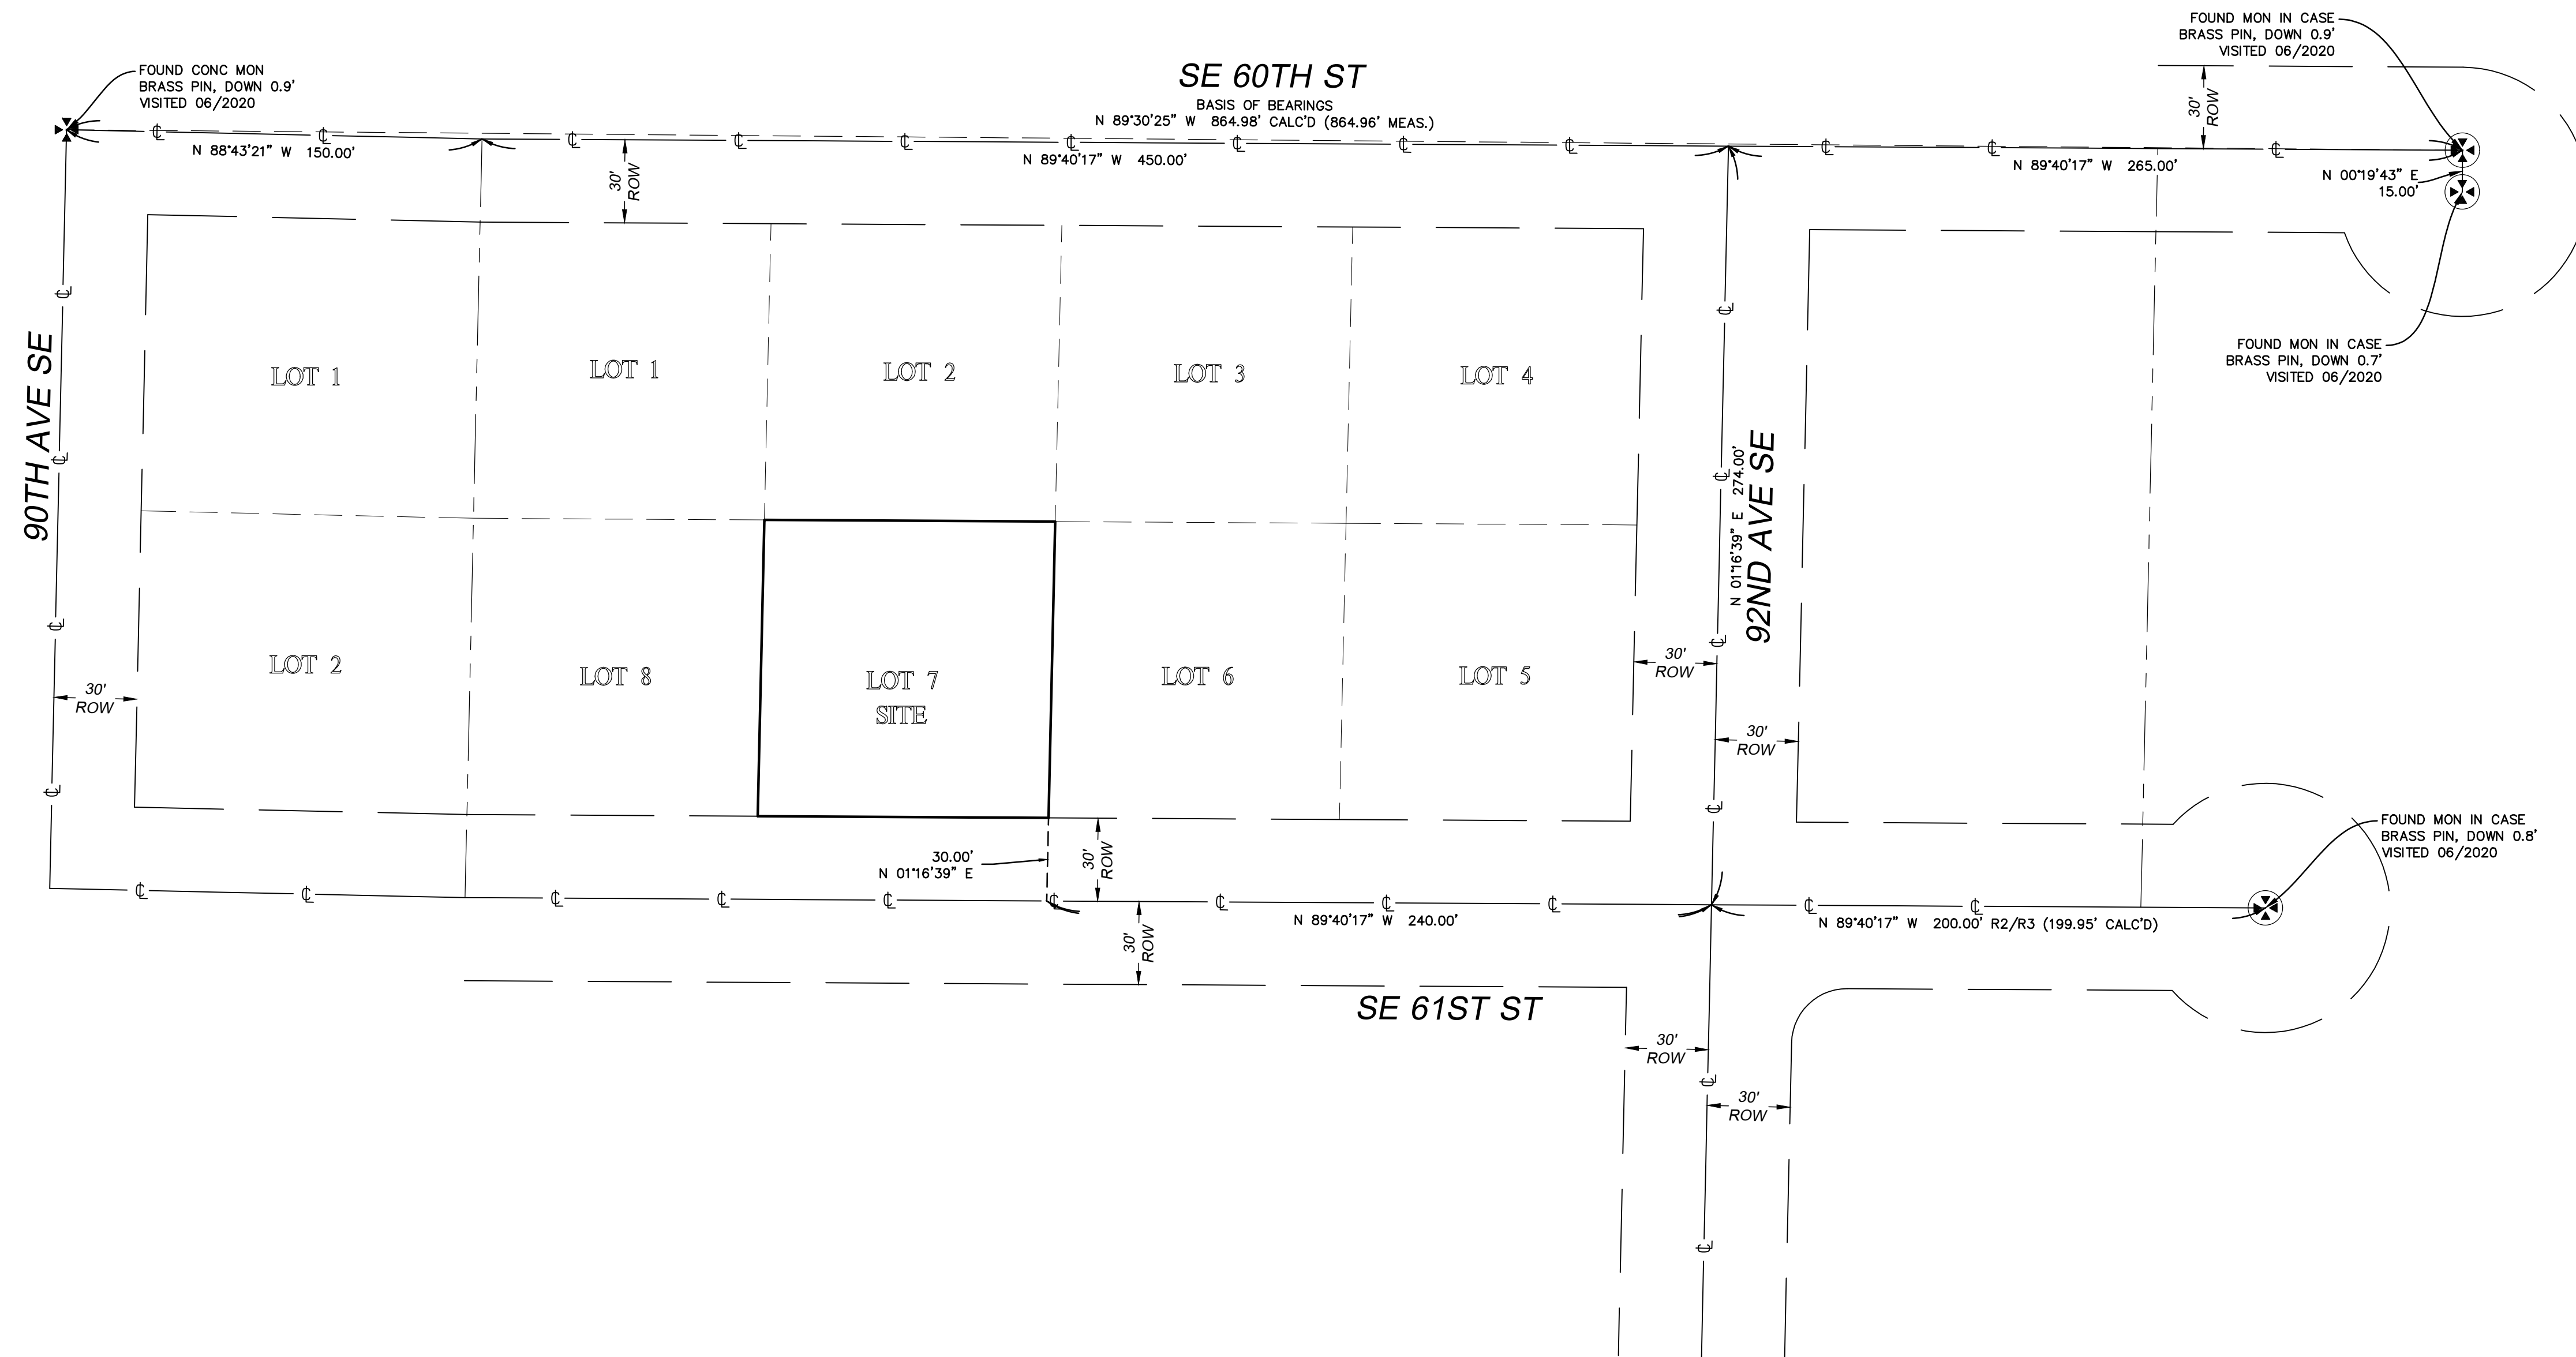

INDEXING INFORMATION	
	SE 1/4 SW 1/4
	SECTION: 19
	TOWNSHIP: 24N
	RANGE: 05E, W.M.
	COUNTY: KING

TOPOGRAPHIC & BOUNDARY SURVEY
 PARCEL NO. 8650900055

RKK CONSTRUCTION
 9026 SE 61ST STREET
 MERCER ISLAND, WA 98040

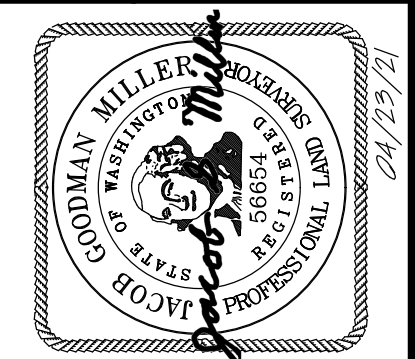

Terrane
 10801 Main Street, Suite 102, Bellevue, WA 98004
 phone 425.458.4488 support@terrane.net
 www.terrane.net

JOB NUMBER:	210621
DATE:	04/23/21
DRAFTED BY:	IDV / RPM
CHECKED BY:	TBR / JGM
SCALE:	N.T.S.

REVISION HISTORY	



SHEET NUMBER
1 OF 2

measure success

TOPOGRAPHIC & BOUNDARY SURVEY

LEGEND

	AREA DRAIN		MONUMENT (SURFACE, FOUND)
	ASPHALT SURFACE		POST
	BOLLARD		POWER METER
	BUILDING		POWER (OVERHEAD)
	CENTERLINE ROW		POWER POLE
	CONCRETE SURFACE		REBAR & CAP (SET)
	RETAINING WALL		SEWER LINE
	FENCE LINE (WOOD)		SEWER MANHOLE
	GAS LINE (WOOD)		STORM DRAIN LINE
	GAS METER		TELEPHONE (OVERHEAD)
	HEDGE FOLIAGE LINE		TREE (AS NOTED)
	INLET (TYPE 1)		TV LINE
	IRRIGATION CONTROL VALVE		WATER LINE
	MAILBOX (RESIDENTIAL)		WATER METER
	MONUMENT IN CASE (FOUND)		YARD LIGHT

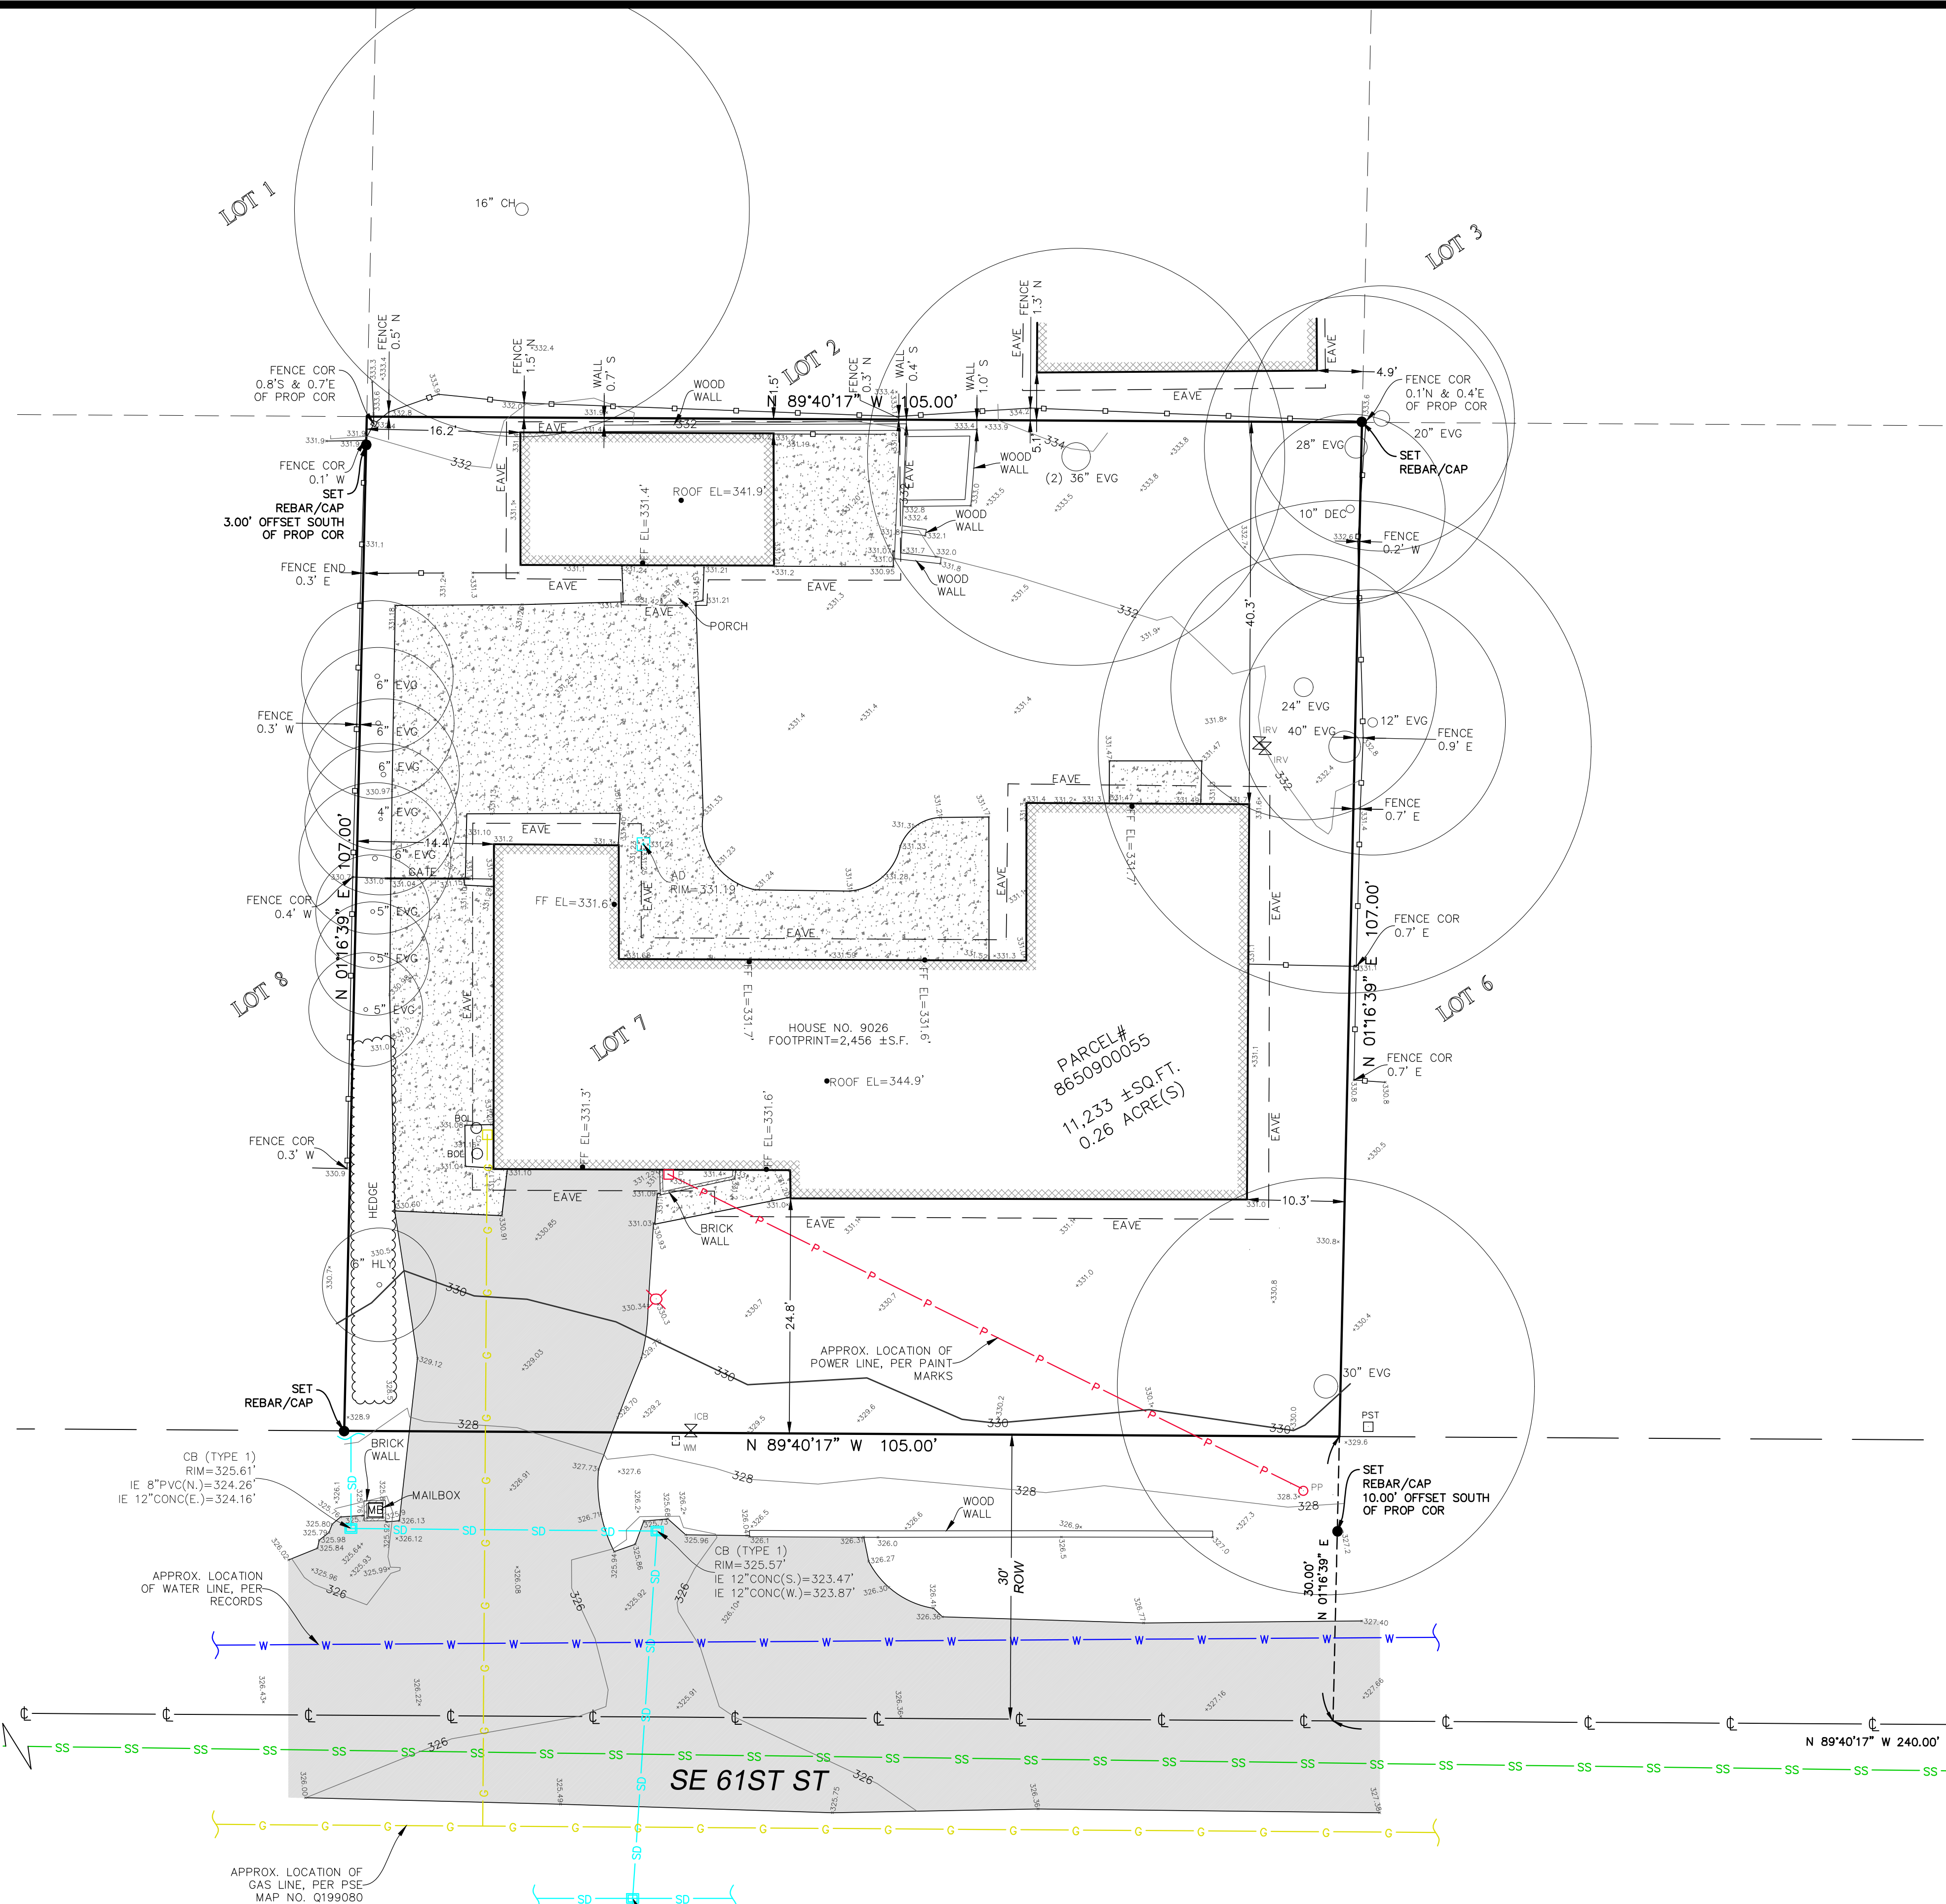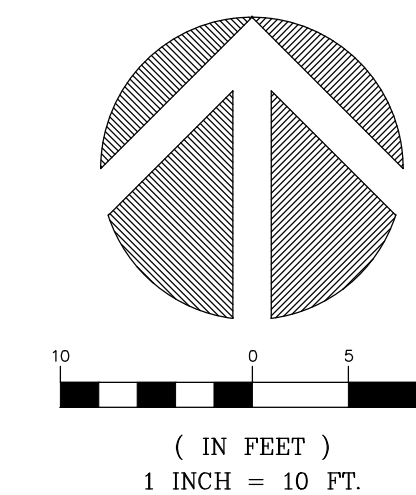

STEEP SLOPE/BUFFER DISCLAIMER:
 THE LOCATION AND EXTENT OF STEEP SLOPES SHOWN ON THIS DRAWING ARE FOR INFORMATIONAL PURPOSES ONLY AND CANNOT BE RELIED ON FOR DESIGN AND/OR CONSTRUCTION. THE PITCH, LOCATION, AND EXTENT ARE BASED SOLELY ON OUR GENERAL OBSERVATIONS ON SITE AND OUR CURSORY REVIEW OF READILY AVAILABLE PUBLIC DOCUMENTS; AS SUCH, TERRANE CANNOT BE LIABLE OR RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF ANY STEEP SLOPE INFORMATION. ULTIMATELY, THE LIMITS AND EXTENT OF ANY STEEP SLOPES ASSOCIATED WITH ANY SETBACKS OR OTHER DESIGN OR CONSTRUCTION PARAMETERS MUST BE DISCUSSED AND APPROVED BY THE REVIEWING AGENCY BEFORE ANY CONSTRUCTION CAN OCCUR.

INDEXING INFORMATION	
	SECTION: 19
	TOWNSHIP: 24N
	RANGE: 05E, W.M.
	COUNTY: KING

TOPOGRAPHIC & BOUNDARY SURVEY



Terrane
 10801 Main Street, Suite 102, Bellevue, WA 98004
 phone 425.458.4488 support@terrane.net
www.terrane.net

JOB NUMBER:	210621
DATE:	04/23/21
DRAFTED BY:	IDV / RPM
CHECKED BY:	TBR / JGM
SCALE:	1"=10'
REVISION HISTORY	
SHEET NUMBER	
2 OF 2	

measure success

RKK CONSTRUCTION
 9026 SE 61ST STREET
 MERCER ISLAND, WA 98040

ORGANIC SOIL REQUIREMENT

MINIMUM 10% ORGANIC MULCH & COMPOST SOIL REQUIRED

SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION. SEE DETAIL ON C3.5.

SOIL INSPECTION REQUIRED BY ENGINEER

A POST CONSTRUCTION INSPECTION & CERTIFICATION OF AMENDED SOILS IS REQUIRED BY A LICENSED CIVIL ENGINEER. THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.

TREE PROTECTION


TPCHAIN LINK FENCE REQ FOR TREE PROTECTION

EROSION CONTROL LEGEND

LIMITS OF DISTURBANCE	
FILTER FABRIC FENCE (SILT FENCE)	
STABILIZED CONSTRUCTION ENTRANCE	
CATCH BASIN INLET PROTECTION	
INTERCEPTOR SWALE SEE COR DWG 504. TYPE A TEMPORARY SWALE	
TREE PROTECTION FENCING	
CHECK DAM	
STRAW WATTLES	
	USE AS NEEDED

TREE PROTECTION NOTES (SOURCED FROM ARBORIST)


- (REF: SEATTLE TREE CONSULTING, DOUGLAS SMITH, CERTIFIED ARBORIST)
- FOR THE TREES BEING RETAINED, TREE PROTECTION FENCING SHOULD BE INSTALLED AT THE OUTER EDGE OF THE DRIP LINE OR AS CLOSE TO IT AS IS PRACTICALLY POSSIBLE.
- FENCING SHOULD BE INSTALLED PRIOR TO CONSTRUCTION ACTIVITIES AND REMAIN IN PLACE FOR THE DURATION OF THE PROJECT. FENCING SHOULD ONLY BE MOVED TEMPORARILY IF MINOR DISTURBANCES MUST OCCUR WITHIN THE DRIP LINE AND THE FENCING SHOULD BE REPLACED IMMEDIATELY ONCE THAT PORTION OF THE WORK IS COMPLETED.
- THE TREE PROTECTION AREA IS DESIGNATED TO BE AN AREA OF NO IMPACT, NO STORING OF MATERIALS, NO ENCROACHMENT AND NO STAGING OF DEBRIS.
- THE TREE PROTECTION FENCING SHOULD HAVE SIGNS EVERY 8' FACING ACCESS THAT INDICATE THE AREA IS A TREE PROTECTION ZONE.
- TRENCHING THROUGH THE CRZ FOR UTILITIES IS NOT PERMITTED (TUNNELING IS THE PREFERRED METHOD).
- GRADE CHANGES IN THE CRZ ARE NOT PERMITTED.
- VEHICLE MAINTENANCE AND WASHING OF EQUIPMENT (ESPECIALLY CONCRETE), IS NOT PERMITTED.
- NO ATTACHING ANYTHING TO THE TREE WITH CINCHING KNOTS OR HARDWARE.
- ROOT FLARE SHOULD BE PROTECTED WITH CHIPS SO THAT LAWN MAINTENANCE EQUIPMENT DOES NOT HAVE TO WORK CLOSE TO THE SYSTEM.
- PROPER CLEARANCES SHOULD BE MONITORED.
- THE CRZ OR CRITICAL ROOT ZONE NEEDS TO BE PROTECTED. THE INNER CRZ IS 50 % OF THE RADIUS OF THE CRZ AND THERE SHOULD BE ZERO DISTURBANCE IN THIS ZONE. A DISTURBANCE OF UP TO 33 % OF THE OUTER CRZ IS PERMISSIBLE PROVIDED THAT ANY HEAVY DIGGING EQUIPMENT WORKS TOWARD THE TREE, AND THAT ANY ROOTS ENCOUNTERED THAT ARE OVER 1" IN DIAMETER ARE EXCAVATED AROUND WITH HAND TOOLS AND CUT CLEAN WITH A SHARP SAW BEHIND THE EXCAVATION ZONE SO THAT THE ROOT CAN BIFURCATE AND CONTINUE TO GROW. IN SOME CASES, IF EXCESSIVE PRUNING HAS BEEN DONE, THE CRZ CAN BE LARGER THAN THE DRIP LINE RADIUS.

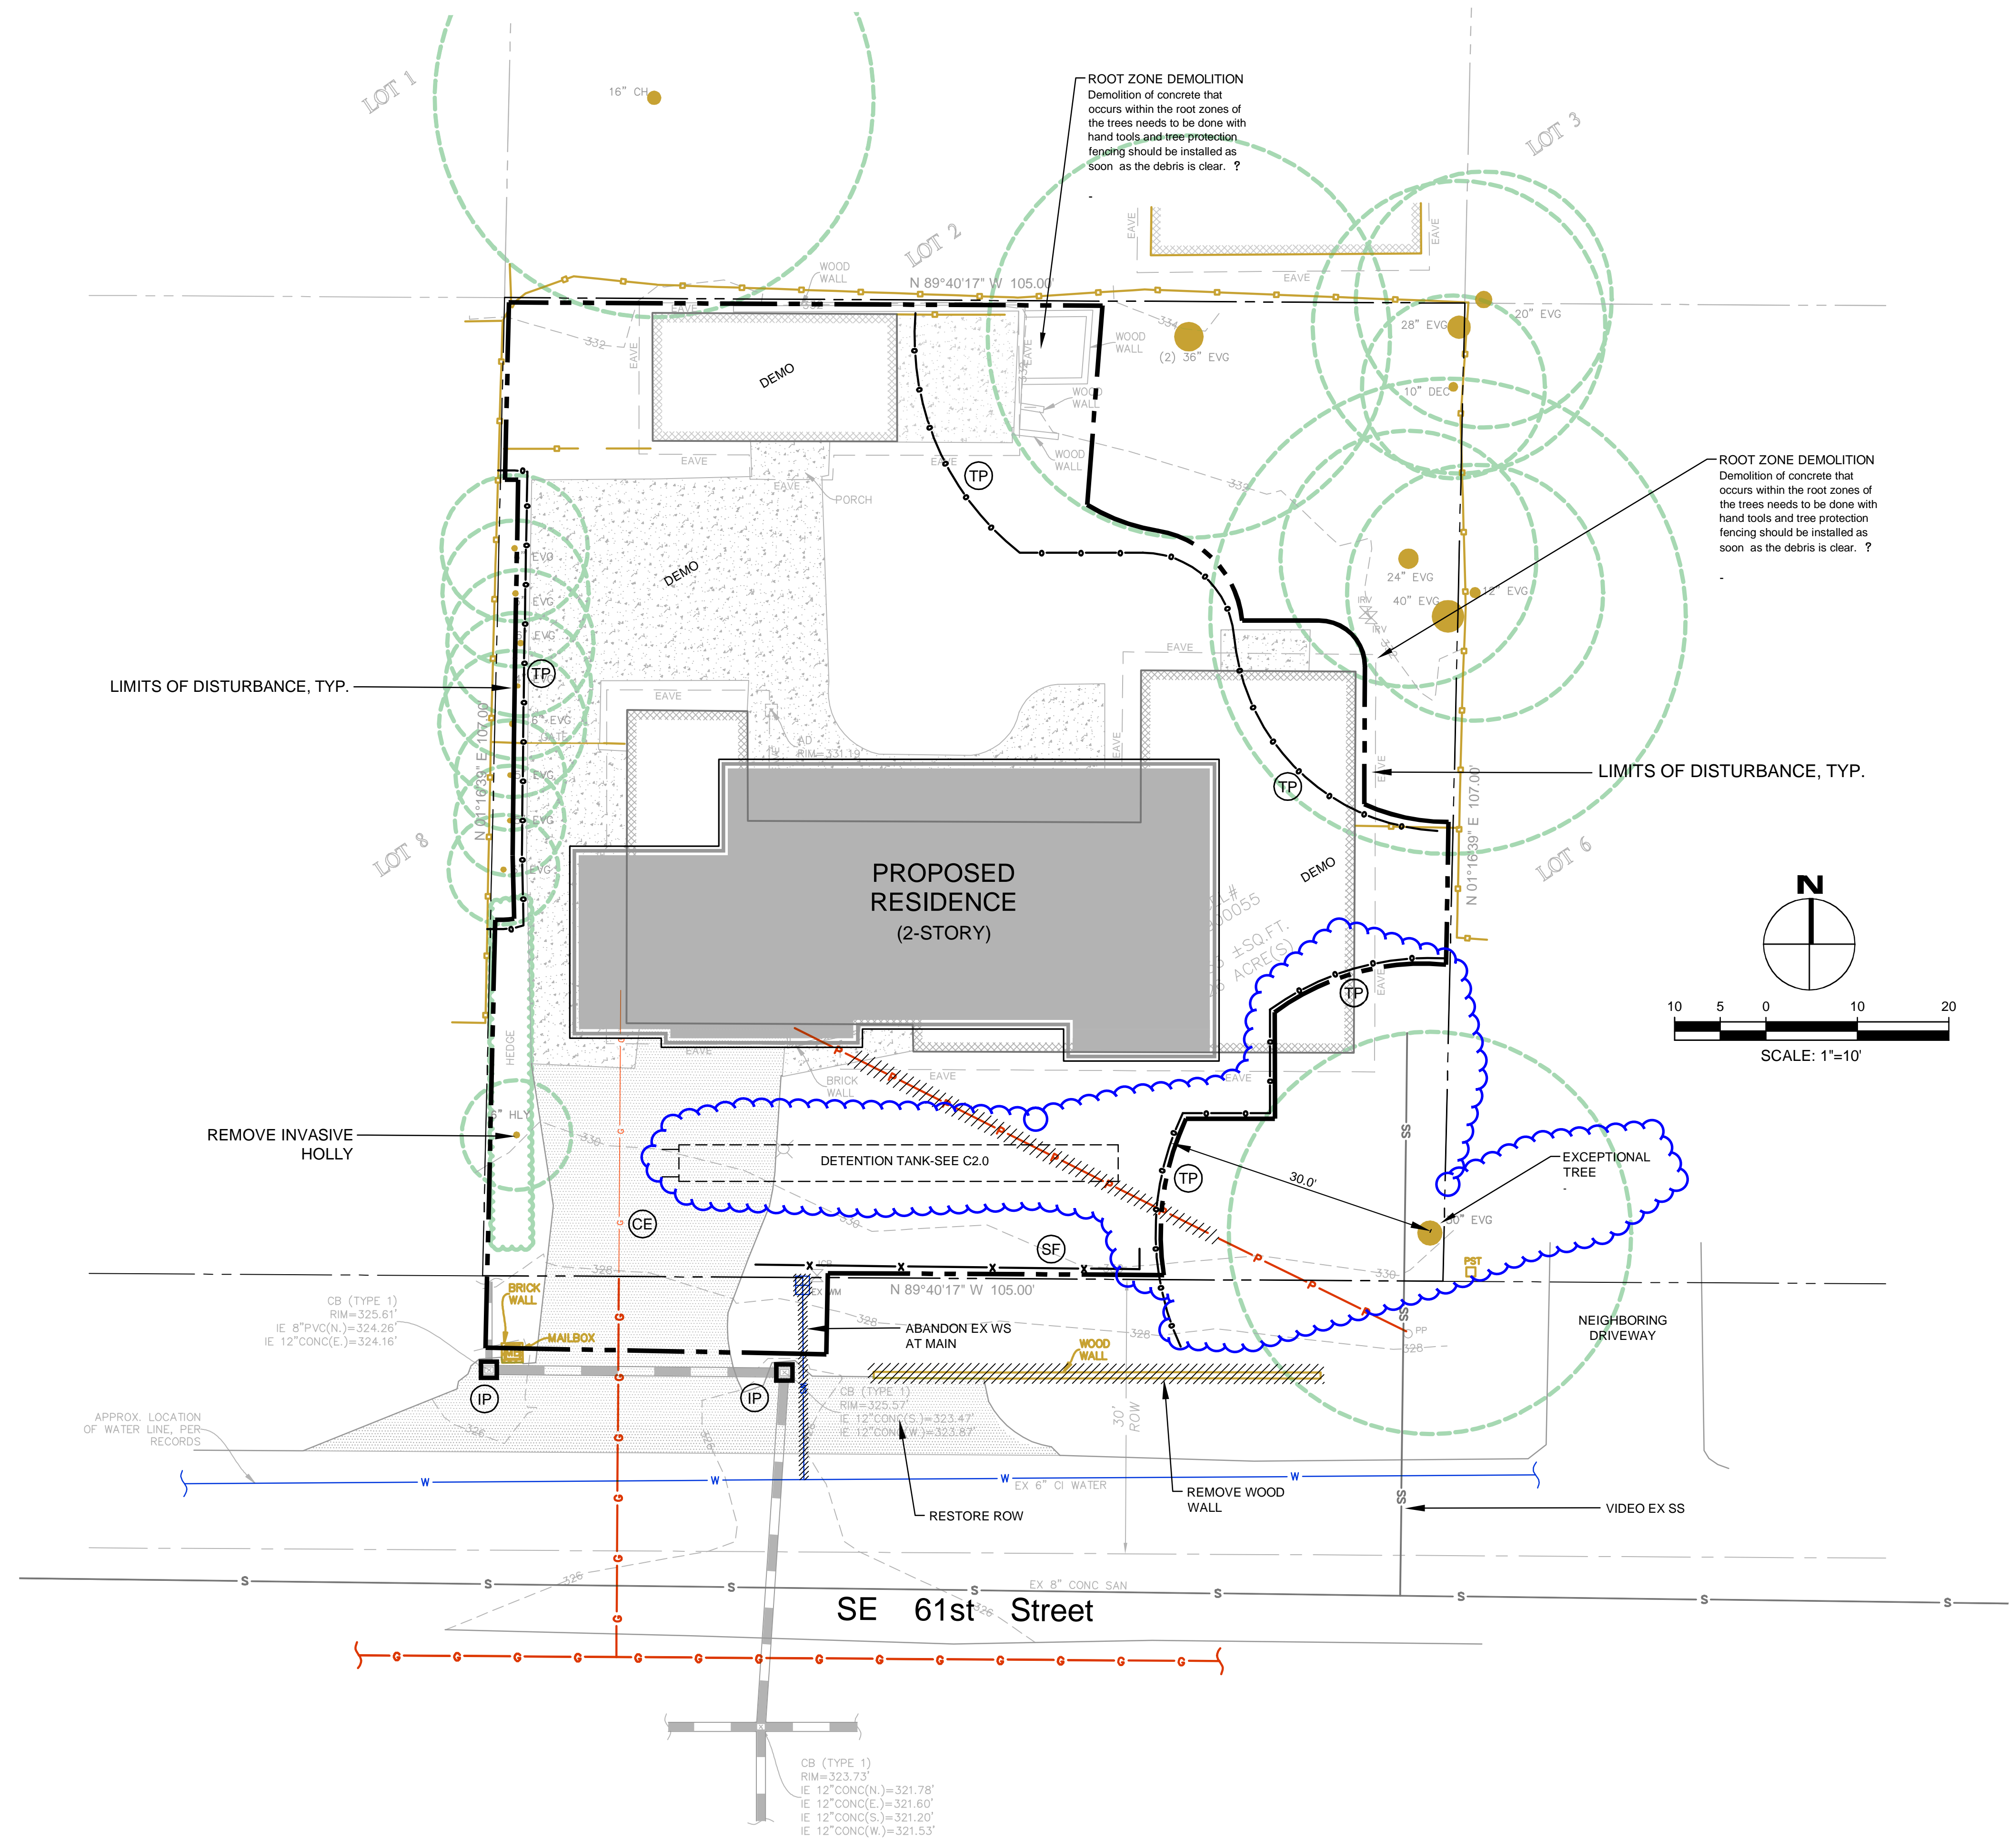

NO.	DATE	BY	REVISIONS

APPLICANT
JASON KOEHLER
RKK CONSTRUCTION

DATE: Apr 11, 2022
JOB# 1990
DRAFTED: SS DESIGN: SS
DIGITAL SIGNATURE

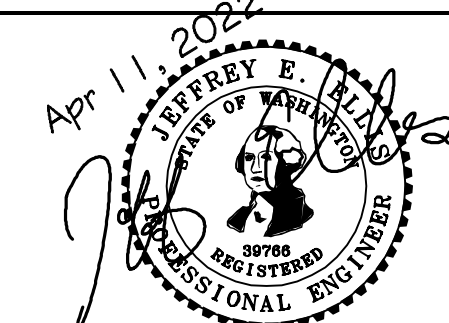

CIVIL ENGINEERING SOLUTIONS
102 NW CANAL STREET SEATTLE, WA 98107
PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US


TESC PLAN TREE RETENTION PLAN
PROPOSED RESIDENCE
9026 SE 61st STREET, MERCER ISLAND, WA 98040

DRAWING NO: **C1.0**
APN 865090-0055

SILT FENCE DETAIL

DOE

Figure II-3.22: Silt Fence

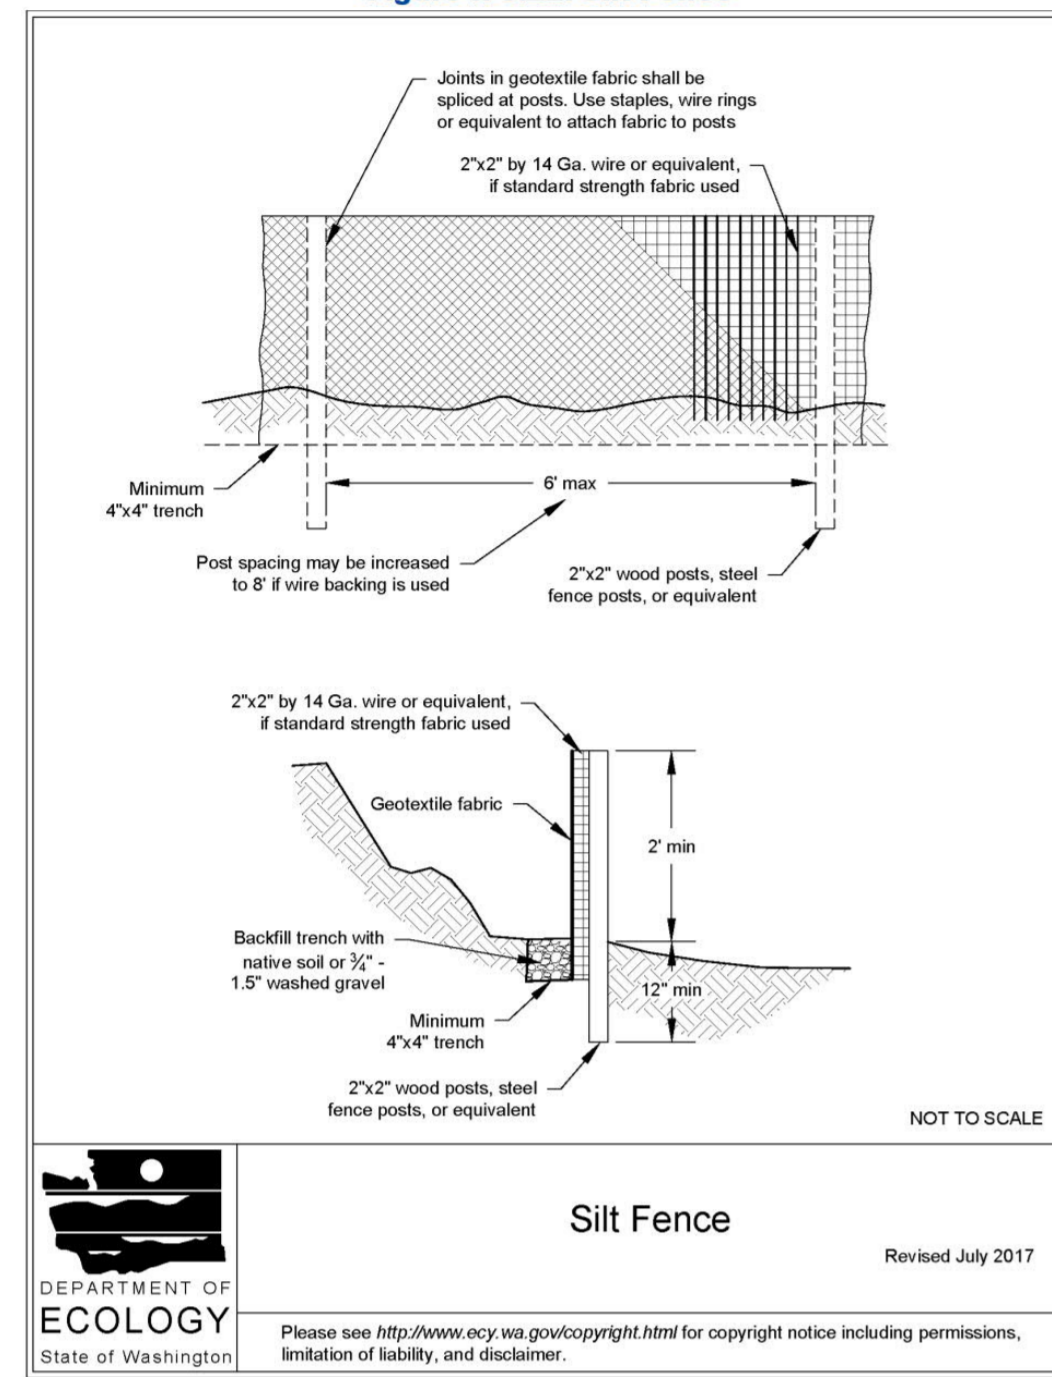

2019 Stormwater Management Manual for Western Washington
Volume II - Chapter 3 - Page 371

RECOMMENDED CONSTRUCTION SEQUENCE

A DETAILED CONSTRUCTION SEQUENCE IS NEEDED TO ENSURE THAT EROSION AND SEDIMENT CONTROL MEASURES ARE APPLIED AT THE APPROPRIATE TIMES. A RECOMMENDED CONSTRUCTION SEQUENCE IS PROVIDED BELOW.

- HOLD AN ONSITE PRE-CONSTRUCTION MEETING.
- POST SIGN WITH NAME AND PHONE NUMBER OF ESC SUPERVISOR (MAY BE CONSOLIDATED WITH THE REQUIRED NOTICE OF CONSTRUCTION SIGN).
- FLAG OR FENCE CLEARING LIMITS.
- INSTALL CATCH BASIN PROTECTION, IF REQUIRED.
- GRADE AND INSTALL CONSTRUCTION ENTRANCE(S).
- INSTALL PERIMETER PROTECTION (SILT FENCE, BRUSH BARRIER, ETC.).
- CONSTRUCT SEDIMENT PONDS AND TRAPS.
- GRADE AND STABILIZE CONSTRUCTION ROADS.
- CONSTRUCT SURFACE WATER CONTROLS (INTERCEPTOR DIKS, PIPE SLOPE DRAINS, ETC.) SIMULTANEOUSLY WITH CLEARING AND GRADING FOR PROJECT DEVELOPMENT.
- MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH CITY OF MERCER ISLAND STANDARDS AND MANUFACTURER'S RECOMMENDATIONS.
- RELOCATE SURFACE WATER CONTROLS OR TESC MEASURES, OR INSTALL NEW MEASURES SO THAT AS SITE CONDITIONS CHANGE, THE TESC IS ALWAYS IN ACCORDANCE WITH CITY OF MERCER ISLAND TESC REQUIREMENTS.
- COVER ALL AREAS THAT WILL BE UN-WORKED FOR MORE THAN SEVEN DAYS DURING THE DRY SEASON (MAY 1 TO SEPT 30) OR TWO DAYS DURING THE WET SEASON (OCT 1 TO APRIL 30) WITH STRAW, WOOD FIBER MULCH, COMPOST, PLASTIC SHEETING, OR EQUIVALENT.
- STABILIZE ALL AREAS WITHIN SEVEN DAYS OF REACHING FINAL GRADE.
- SEED, SOD, STABILIZE, OR COVER ANY AREAS TO REMAIN UNWORKED FOR MORE THAN 30 DAYS.
- UPON COMPLETION OF THE PROJECT, STABILIZE ALL DISTURBED AREAS AND REMOVE B MPS IF APPROPRIATE.

EROSION CONTROL NOTES

- D.8.2 STANDARD ESC PLAN NOTES
THE STANDARD ESC PLAN NOTES MUST BE INCLUDED ON ALL ESC PLANS. AT THE APPLICANT'S DISCRETION, NOTES THAT IN NO WAY APPLY TO THE PROJECT MAY BE OMITTED; HOWEVER, THE REMAINING NOTES MUST NOT BE RENUMBERED. FOR EXAMPLE, IF ESC NOTE #3 WERE OMITTED, THE REMAINING NOTES SHOULD BE NUMBERED 1, 2, 4, 5, 6, ETC.
- APPROVAL OF THIS EROSION AND SEDIMENTATION CONTROL (ESC) PLAN DOES NOT CONSTITUTE AN APPROVAL OF PERMANENT ROAD OR DRAINAGE DESIGN (E.G., SIZE AND LOCATION OF ROADS, PIPES, RESTRICTORS, CHANNELS, RETENTION FACILITIES, UTILITIES, ETC.).
 - THE IMPLEMENTATION OF THESE ESC PLANS AND THE CONSTRUCTION, MAINTENANCE, REPLACEMENT, AND UPGRADING OF THESE ESC FACILITIES IS THE RESPONSIBILITY OF THE APPLICANT/ESC SUPERVISOR UNTIL ALL CONSTRUCTION IS APPROVED.
 - THE BOUNDARIES OF THE CLEARING LIMITS SHOWN ON THIS PLAN SHALL BE CLEARLY FLAGGED BY SURVEY TAPE OR FENCING, IF REQUIRED, PRIOR TO CONSTRUCTION (SWDM APPENDIX D). DURING THE CONSTRUCTION PERIOD, NO DISTURBANCE BEYOND THE CLEARING LIMITS SHALL BE PERMITTED. THE CLEARING LIMITS SHALL BE MAINTAINED BY THE APPLICANT/ESC SUPERVISOR FOR THE DURATION OF CONSTRUCTION.
 - STABILIZED CONSTRUCTION ENTRANCES SHALL BE INSTALLED AT THE BEGINNING OF CONSTRUCTION AND MAINTAINED FOR THE DURATION OF THE PROJECT. ADDITIONAL MEASURES, SUCH AS CONSTRUCTED WHEEL WASH SYSTEMS OR WASH PADS, MAY BE REQUIRED TO ENSURE THAT ALL PAVED AREAS ARE KEPT CLEAN AND TRACK OUT TO ROAD RIGHT OF WAY DOES NOT OCCUR FOR THE DURATION OF THE PROJECT.
 - THE ESC FACILITIES SHOWN ON THIS PLAN MUST BE CONSTRUCTED PRIOR TO OR IN CONJUNCTION WITH ALL CLEARING AND GRADING SO AS TO ENSURE THAT THE TRANSPORT OF SEDIMENT TO SURFACE WATERS, DRAINAGE SYSTEMS, AND ADJACENT PROPERTIES IS MINIMIZED.
 - THE ESC FACILITIES SHOWN ON THIS PLAN ARE THE MINIMUM REQUIREMENTS FOR ANTICIPATED SITE CONDITIONS. DURING THE CONSTRUCTION PERIOD, THESE ESC FACILITIES SHALL BE UPGRADED AS NEEDED FOR UNEXPECTED STORM EVENTS AND MODIFIED TO ACCOUNT FOR CHANGING SITE CONDITIONS (E.G. ADDITIONAL COVER MEASURES, ADDITIONAL SUMP PUMPS, RELOCATION OF DITCHES AND SILT FENCES, PERIMETER PROTECTION ETC.) AS DIRECTED BY CITY OF MERCER ISLAND.
 - THE ESC FACILITIES SHALL BE INSPECTED DAILY BY THE APPLICANT/ESC SUPERVISOR AND MAINTAINED TO ENSURE CONTINUED PROPER FUNCTIONING. WRITTEN RECORDS SHALL BE KEPT OF WEEKLY REVIEWS OF THE ESC FACILITIES.
 - ANY AREAS OF EXPOSED SOILS, INCLUDING ROADWAY EMBANKMENTS, THAT WILL NOT BE DISTURBED FOR TWO CONSECUTIVE DAYS DURING THE WET SEASON OR SEVEN DAYS DURING THE DRY SEASON SHALL BE IMMEDIATELY STABILIZED WITH THE APPROVED ESC METHODS (E.G., SEEDING, MULCHING, PLASTIC COVERING, ETC.).
 - ANY AREA NEEDING ESC MEASURES THAT DO NOT REQUIRE IMMEDIATE ATTENTION SHALL BE ADDRESSED WITHIN SEVEN (7) DAYS.
 - THE ESC FACILITIES ON INACTIVE SITES SHALL BE INSPECTED AND MAINTAINED A MINIMUM OF ONCE A MONTH DURING THE DRY SEASON, BI-MONTHLY DURING THE WET SEASON, OR WITHIN TWENTY FOUR (24) HOURS FOLLOWING A STORM EVENT.
 - AT NO TIME SHALL MORE THAN ONE (1) FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE WITHIN A CATCH BASIN. ALL CATCH BASINS AND CONVEYANCE LINES SHALL BE CLEANED PRIOR TO PAVING. THE CLEANING OPERATION SHALL NOT FLUSH SEDIMENT-LADEN WATER INTO THE DOWNSTREAM SYSTEM.
 - ANY PERMANENT RETENTION/DETENTION FACILITY USED AS A TEMPORARY SETTLING BASIN SHALL BE MODIFIED WITH THE NECESSARY EROSION CONTROL MEASURES AND SHALL PROVIDE ADEQUATE STORAGE CAPACITY. IF THE FACILITY IS TO FUNCTION ULTIMATELY AS AN INFILTRATION SYSTEM, THE TEMPORARY FACILITY MUST BE ROUGH GRADED SO THAT THE BOTTOM AND SIDES ARE AT LEAST THREE FEET ABOVE THE FINAL GRADE OF THE PERMANENT FACILITY.
 - COVER MEASURES WILL BE APPLIED IN CONFORMANCE WITH APPENDIX D OF THE SURFACE WATER DESIGN MANUAL.
 - PRIOR TO THE BEGINNING OF THE WET SEASON (OCT. 1), ALL DISTURBED AREAS SHALL BE REVIEWED TO IDENTIFY WHICH ONES CAN BE SEEDED IN PREPARATION FOR THE WINTER RAINS. DISTURBED AREAS SHALL BE SEEDED WITHIN ONE WEEK OF THE BEGINNING OF THE WET SEASON.


CITY NOTES

- ANY CHANGES TO THE APPROVED PLANS REQUIRES CITY APPROVAL THROUGH A REVISION.
- APPLICANT IS RESPONSIBLE FOR ANY DAMAGES TO UNDERGROUND UTILITIES CAUSED FROM THIS CONSTRUCTION.
- CATCH BASIN FILTERS SHOULD BE PROVIDED FOR ALL STORM DRAIN CATCH BASINS/INLETS DOWNSLOPE AND WITHIN 500 FEET OF THE CONSTRUCTION AREA. CATCH BASIN FILTERS SHOULD BE DESIGNED BY THE MANUFACTURER FOR USE AT CONSTRUCTION SITES AND APPROVED BY THE CITY INSPECTOR. CATCH BASIN FILTERS SHOULD BE INSPECTED FREQUENTLY, ESPECIALLY AFTER STORM EVENTS. IF THE FILTER BECOMES CLOGGED, IT SHOULD BE CLEANED OR REPLACED.
- CONTRACTORS SHALL VERIFY LOCATIONS AND DEPTHS OF UTILITES.
- AT LEAST 48 HOURS PRIOR TO CONSTRUCTION, CALL "ONE CALL" AT 1.800.424.5555
- DO NOT BACKFILL WITH NATIVE MATERIAL ON PUBLIC RIGHT-OF-WAY. ALL MATERIAL MUST BE IMPORTED
- EROSION CONTROL: ALL "LAND DISTURBING ACTIVITY" IS SUBJECT TO PROVISIONS OF MERCER ISLAND ORDINANCE 95C-118 "STORM WATER MANAGEMENT." SPECIFIC ITEMS TO BE FOLLOWED AT YOUR SITE:
- PROTECT ADJACENT PROPERTIES FROM ANY INCREASED RUNOFF OR SEDIMENTATION DUE TO THE CONSTRUCTION PROJECT THROUGH THE USE OF APPROPRIATE "BEST MANAGEMENT PRACTICES" (BMP) EXAMPLES INCLUDE, BUT ARE NOT LIMITED TO, SEDIMENT TRAPS, SEDIMENT PONDS, FILTER FABRIC FENCES, VEGETATIVE BUFFER STRIPS OR BIOENGINEERED SWALES.
- CONSTRUCTION ACCESS TO THE SITE SHOULD BE LIMITED TO ONE ROUTE. STABILIZE ENTRANCE WITH QUARRY SPALLS TO PREVENT SEDIMENT FROM LEAVING THE SITE OR ENTERING THE STORM DRAINS.
- PREVENT SEDIMENT, CONSTRUCTION DEBRIS, PAINTS, SOLVENTS, ETC., OR OTHER TYPES OF POLLUTION FROM ENTERING PUBLIC STORM DRAINS. KEEP ALL POLLUTION ON YOUR SITE.
- ALL EXPOSED SOILS SHALL REMAIN DENUDED FOR NO LONGER THAN SEVEN (7) DAYS AND SHALL BE STABILIZED WITH MULCH, HAY, OR THE APPROPRIATE GROUND COVER. ALL EXPOSED SOILS SHALL BE COVERED IMMEDIATELY DURING ANY RAIN EVENT.
- INSTALLATION OF CONCRETE DRIVEWAYS, TREES, SHRUBS, IRRIGATION, BOULDERS, BERMS, WALLS, GATES, AND OTHER IMPROVEMENTS ARE NOT ALLOWED IN THE PUBLIC RIGHT-OF-WAY WITHOUT PRIOR APPROVAL AND AN ENCROACHMENT AGREEMENT AND RIGHT OF WAY PERMIT FROM THE SENIOR DEVELOPMENT ENGINEER.
- OWNER SHALL CONTROL DISCHARGE OF SURFACE DRAINAGE RUNOFF FROM EXISTING AND NEW IMPERVIOUS AREAS IN A RESPONSIBLE MANNER. CONSTRUCTION OF NEW GUTTERS AND DOWNSPOUTS, DRY WELLS, LEVEL SPREADERS OR DOWNSTREAM CONVEYANCE PIPE MAY BE NECESSARY TO MINIMIZE DRAINAGE IMPACT TO YOUR NEIGHBORS. CONSTRUCTION OF MINIMUM DRAINAGE IMPROVEMENTS SHOWN OR CALLED OUT ON THIS PLAN DOES NOT IMPLY RELIEF FROM CIVIL LIABILITY FOR YOUR DOWNSTREAM DRAINAGE.
- POT HOLING THE PUBLIC UTILITIES IS REQUIRED PRIOR TO ANY GRADING ACTIVITIES LESS THAN 6" OVER THE PUBLIC MAINS (WATER, SEWER AND STORM SYSTEMS). IF THERE IS A CONFLICT, THE APPLICANT IS REQUIRED TO SUBMIT A REVISION FOR APPROVAL PRIOR TO ANY GRADING ACTIVITIES OVER THE PUBLIC MAINS.
- REMEMBER: EROSION CONTROL IS YOUR FIRST INSPECTION.
- ROOF DRAINS MUST BE CONNECTED TO THE STORM DRAIN SYSTEM AND INSPECTED BY THE PUBLIC WORKS DEPARTMENT PRIOR TO ANY BACKFILLING OF PIPE.
- SILENT FENCE: CLEAN AND PROVIDE REGULAR MAINTENANCE OF THE SILT FENCE. THE FENCE IS TO REMAIN VERTICAL AND IS TO FUNCTION PROPERLY THROUGHOUT THE TERM OF THE PROJECT.
- WORK IN PUBLIC RIGHT OF WAY REQUIRES A RIGHT-OF-WAY USE PERMIT.
- REFER TO WATER SERVICE PERMIT FOR ACTUAL LOCATION OF NEW WATER METER AND SERVICE LINE DETERMINED BY MERCER ISLAND WATER DEPARTMENT.
- THE TV INSPECTION OF THE EXISTING SIDE SEWER TO THE CITY SEWER MAIN IS REQUIRED. IF THE RESULT OF THE TV INSPECTION IS NOT IN SATISFACTORY CONDITION, AS DETERMINED BY THE CITY OF MERCER ISLAND INSPECTOR, THE REPLACEMENT OF THE EXISTING SIDE SEWER IS REQUIRED. ALTERNATELY, A PRESSURE TEST OF THE SIDE SEWER, FROM SEWER MAIN TO POINT OF CONNECTION, MAY BE SUBSTITUTED FOR THE VIDEO INSPECTION.
- NEWLY INSTALLED SIDE SEWER REQUIRES A 4 P.S.I. AIR TEST OR PROVIDE 10' OF HYDROSTATIC HEAD TEST.
- POT HOLING THE PUBLIC UTILITIES IS REQUIRED PRIOR TO ANY GRADING ACTIVITIES LESS THAN 6" OVER THE PUBLIC MAINS (WATER, SEWER AND STORM SYSTEMS). IF THERE IS A CONFLICT, THE APPLICANT IS REQUIRED TO SUBMIT A REVISION FOR APPROVAL PRIOR TO ANY GRADING ACTIVITIES OVER THE PUBLIC MAINS.
- THE LIMITS AND EXTENDS OF THE PAVEMENT IN THE PUBLIC RIGHT OF WAY SHALL BE DETERMINED BY THE CITY ENGINEER PRIOR TO FINALIZE THE PROJECT.

CONSTRUCTION ENTRANCE

DOE

Figure II-3.1: Stabilized Construction Access

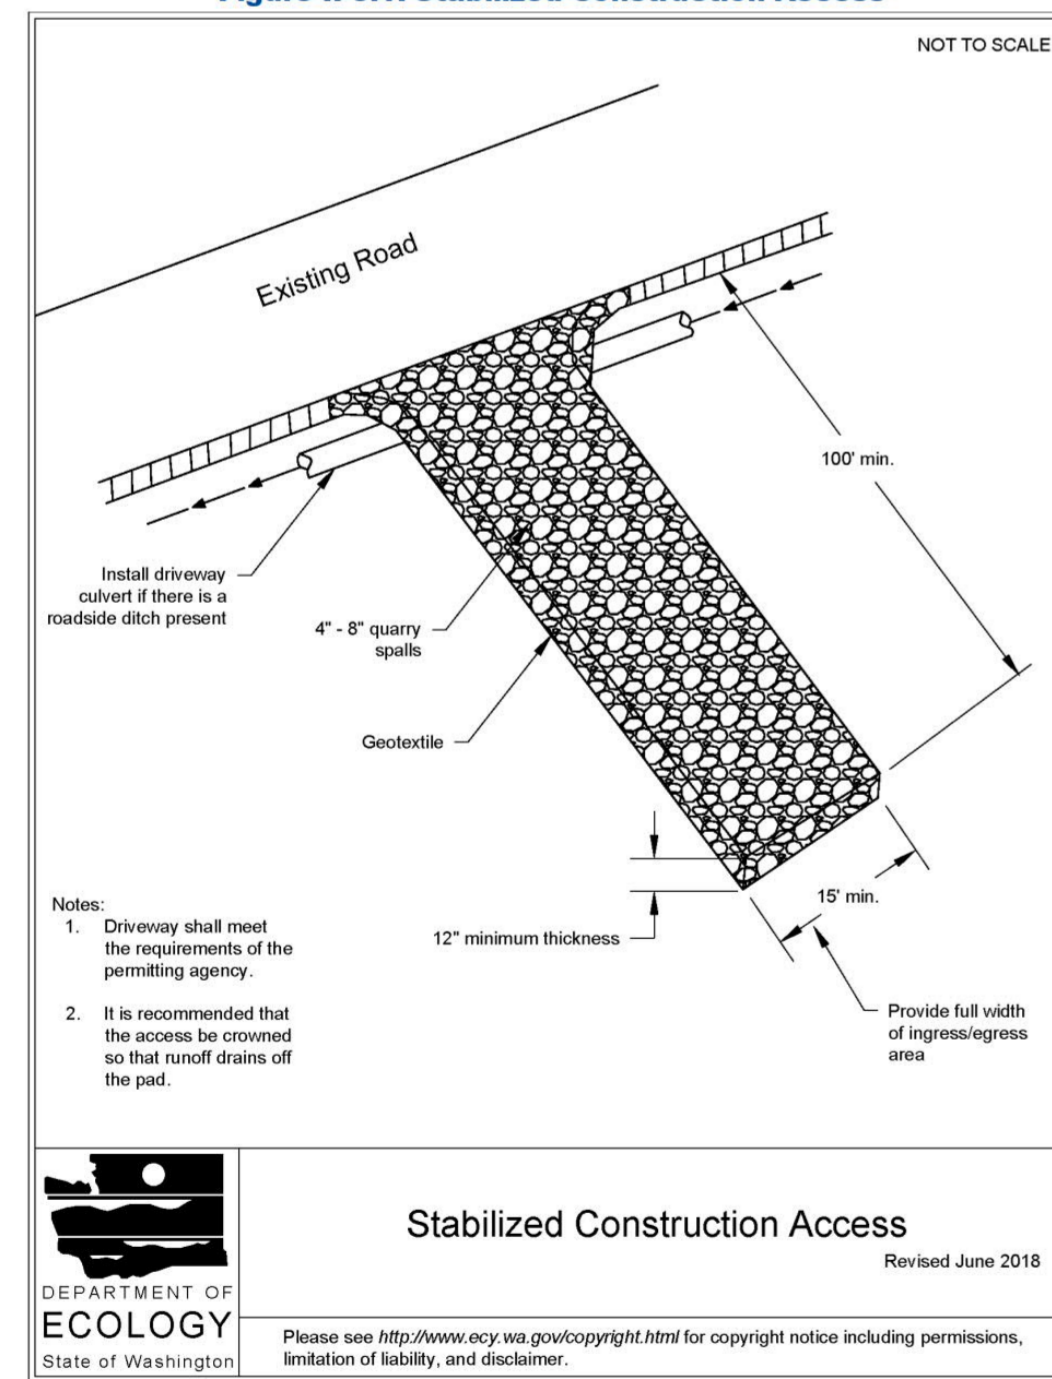

2019 Stormwater Management Manual for Western Washington
Volume II - Chapter 3 - Page 279

DENUDED AREAS REQUIREMENTS


APRIL 1 TO SEPT 30
ALL DENUDED AREAS MUST BE STABILIZED WITHIN 7 DAYS OF CONSTRUCTION. PLEASE READ ALL CITY TESC NOTES ON SHEET C1.2.

OCT 1 TO MARCH 31
ALL DENUDED AREAS MUST BE STABILIZED WITHIN 2 DAYS OF GRADING. IF AN EROSION PROBLEM ALREADY EXISTS ON THE SITE, OTHER COVER PROTECTION AND EROSION CONTROL WILL BE REQUIRED.

NO.	DATE	BY	REVISIONS

APPLICANT
JASON KOEHLER
RKK CONSTRUCTION

DATE: Mar 03, 2022
JOB#: 1990
DRAFTED: SS DESIGN: DE
DIGITAL SIGNATURE

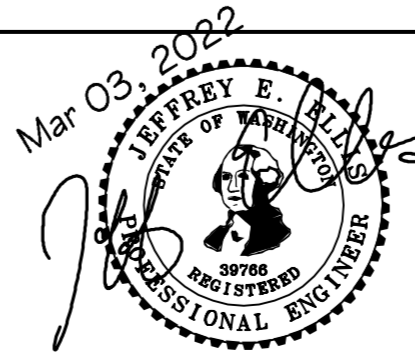

CIVIL ENGINEERING SOLUTIONS
102 NW CANAL STREET SEATTLE, WA 98107
PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

TESC & CITY NOTES
TESC DETAILS
PROPOSED RESIDENCE
9026 SE 61st STREET, MERCER ISLAND, WA 98040

DRAWING NO:
C1.2
APN 865090-0055

SANITARY SEWER IMPROVEMENTS

- ① -
- ② -SDR 35 PVC SANITARY SEWER(SS) @ MIN 1.0 %.
- ③ -
- ④ -
- ⑦ -

WATER IMPROVEMENTS

- ⑩ -1-1/2" WM & 2" WATER SERVICE. CONFIRM REQUIRED SIZE WITH BUILDING PERMIT REVIEW. INSTALL PER MERCER ISLAND DETAIL W-13, W-14, OR W-14A DEPENDING ON SIZE REQUIREMENT.
- ⑪ -MIN 1.5' (2" PREFERRED) 250 PSI PRIVATE HDPE WATER (ASTM D2239) FROM METER TO HOUSE. RECOMMENDED DEPTH=36". COORDINATE HOUSE ENTRY WITH BUILDER/OWNER.
- ⑫ -
- ⑭ -

STORM DRAIN

- ⑳ -4" STORM DRAIN (3034 PVC) @ MIN 2 % GRADE
- ㉑ -4" FOUNDATION DRAIN (3034 PVC) @ MIN 1 % GRADE
- ㉒ -6" STORM DRAIN (3034 PVC) @ MIN 2 % GRADE
- ㉓ -8" STORM DRAIN, (SDR 35 PVC OR EQUAL). SEE PROFILE FOR GRADE
- ㉔ -
- ㉕ -
- ㉖ -
- ㉘ -
- ㉙ -

STORM DRAIN STRUCTURES

- ③① -
- ③② -
- ③③ -
- ③④ -
- ③⑤ -
- ③⑥ -6" WIDE NDS DURASLOPE CHANNEL DRAIN KIT OR EQUAL. MINIMUM 6" CHANNEL. CLASS B VEHICLE RATED GRATE.
- ③⑨ -
- ④① -54" ID TYPE 2 MH CONTROL STRUCTURE WITH SOLID LID. SEE ALL DETAILS AND PROFILE C4.0.
- ④③ -
- ④⑥ -
- ④⑦ -DETENTION PIPE: ALUMINIZED CMP @ 0.5 % GRADE. SEE PLAN FOR SIZE AND CONFIGURATION. SEE PROFILE, NOTES, AND DETAILS ON C4.0.
- ④⑧ -

STORM BMP's

- ⑤① -COMPOST AMENDED SOIL TO ALL DISTURBED AREAS (SEE DETAIL SHEET C3.5). TILL 2-3" OF COMPOST INTO UPPER 8" OF SOIL. LOOSEN COMPACTED SUBSOIL, IF NEEDED BY RIPPING TO 12" DEPTH. MULCH LANDSCAPE BEDS AFTER PLANTING.
- ⑤② -
- ⑤③ -
- ⑤④ -
- ⑤⑤ -
- ⑤⑥ -
- ⑤⑦ -
- ⑤⑧ -

MINIMUM 10% ORGANIC MULCH & COMPOST SOIL REQUIRED

SURVEYOR

TOPOGRAPHIC & BOUNDARY SURVEY BY:
 TERRANE
 10801 MAIN STREET, SUITE 102
 BELLEVUE, WA 98004
 PHONE 425-458-4488
 www.terrane.net

VERTICAL DATUM

NAVD(88) PER CITY OF MERCER ISLAND BENCHMARK NO. 1064
 SEE SURVEY

LEGAL DESCRIPTION


(PER STATUTORY WARRANTY DEED RECORDING # 19990816000693)
 LOT 7, BLOCK 2, TIMBERLAND NO. 4, ACCORDING TO THE PLAT THEREOF,
 RECORDED IN VOLUME 60 OF PLATS, PAGE 41, IN KING COUNTY,
 WASHINGTON.

SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL
 LANDSCAPED AREAS AFTER CONSTRUCTION. SEE
 DETAIL ON C3.5.

SOIL INSPECTION REQUIRED BY ENGINEER


A POST CONSTRUCTION INSPECTION & CERTIFICATION OF AMENDED
 SOILS IS REQUIRED BY A LICENSED CIVIL ENGINEER.
 THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.

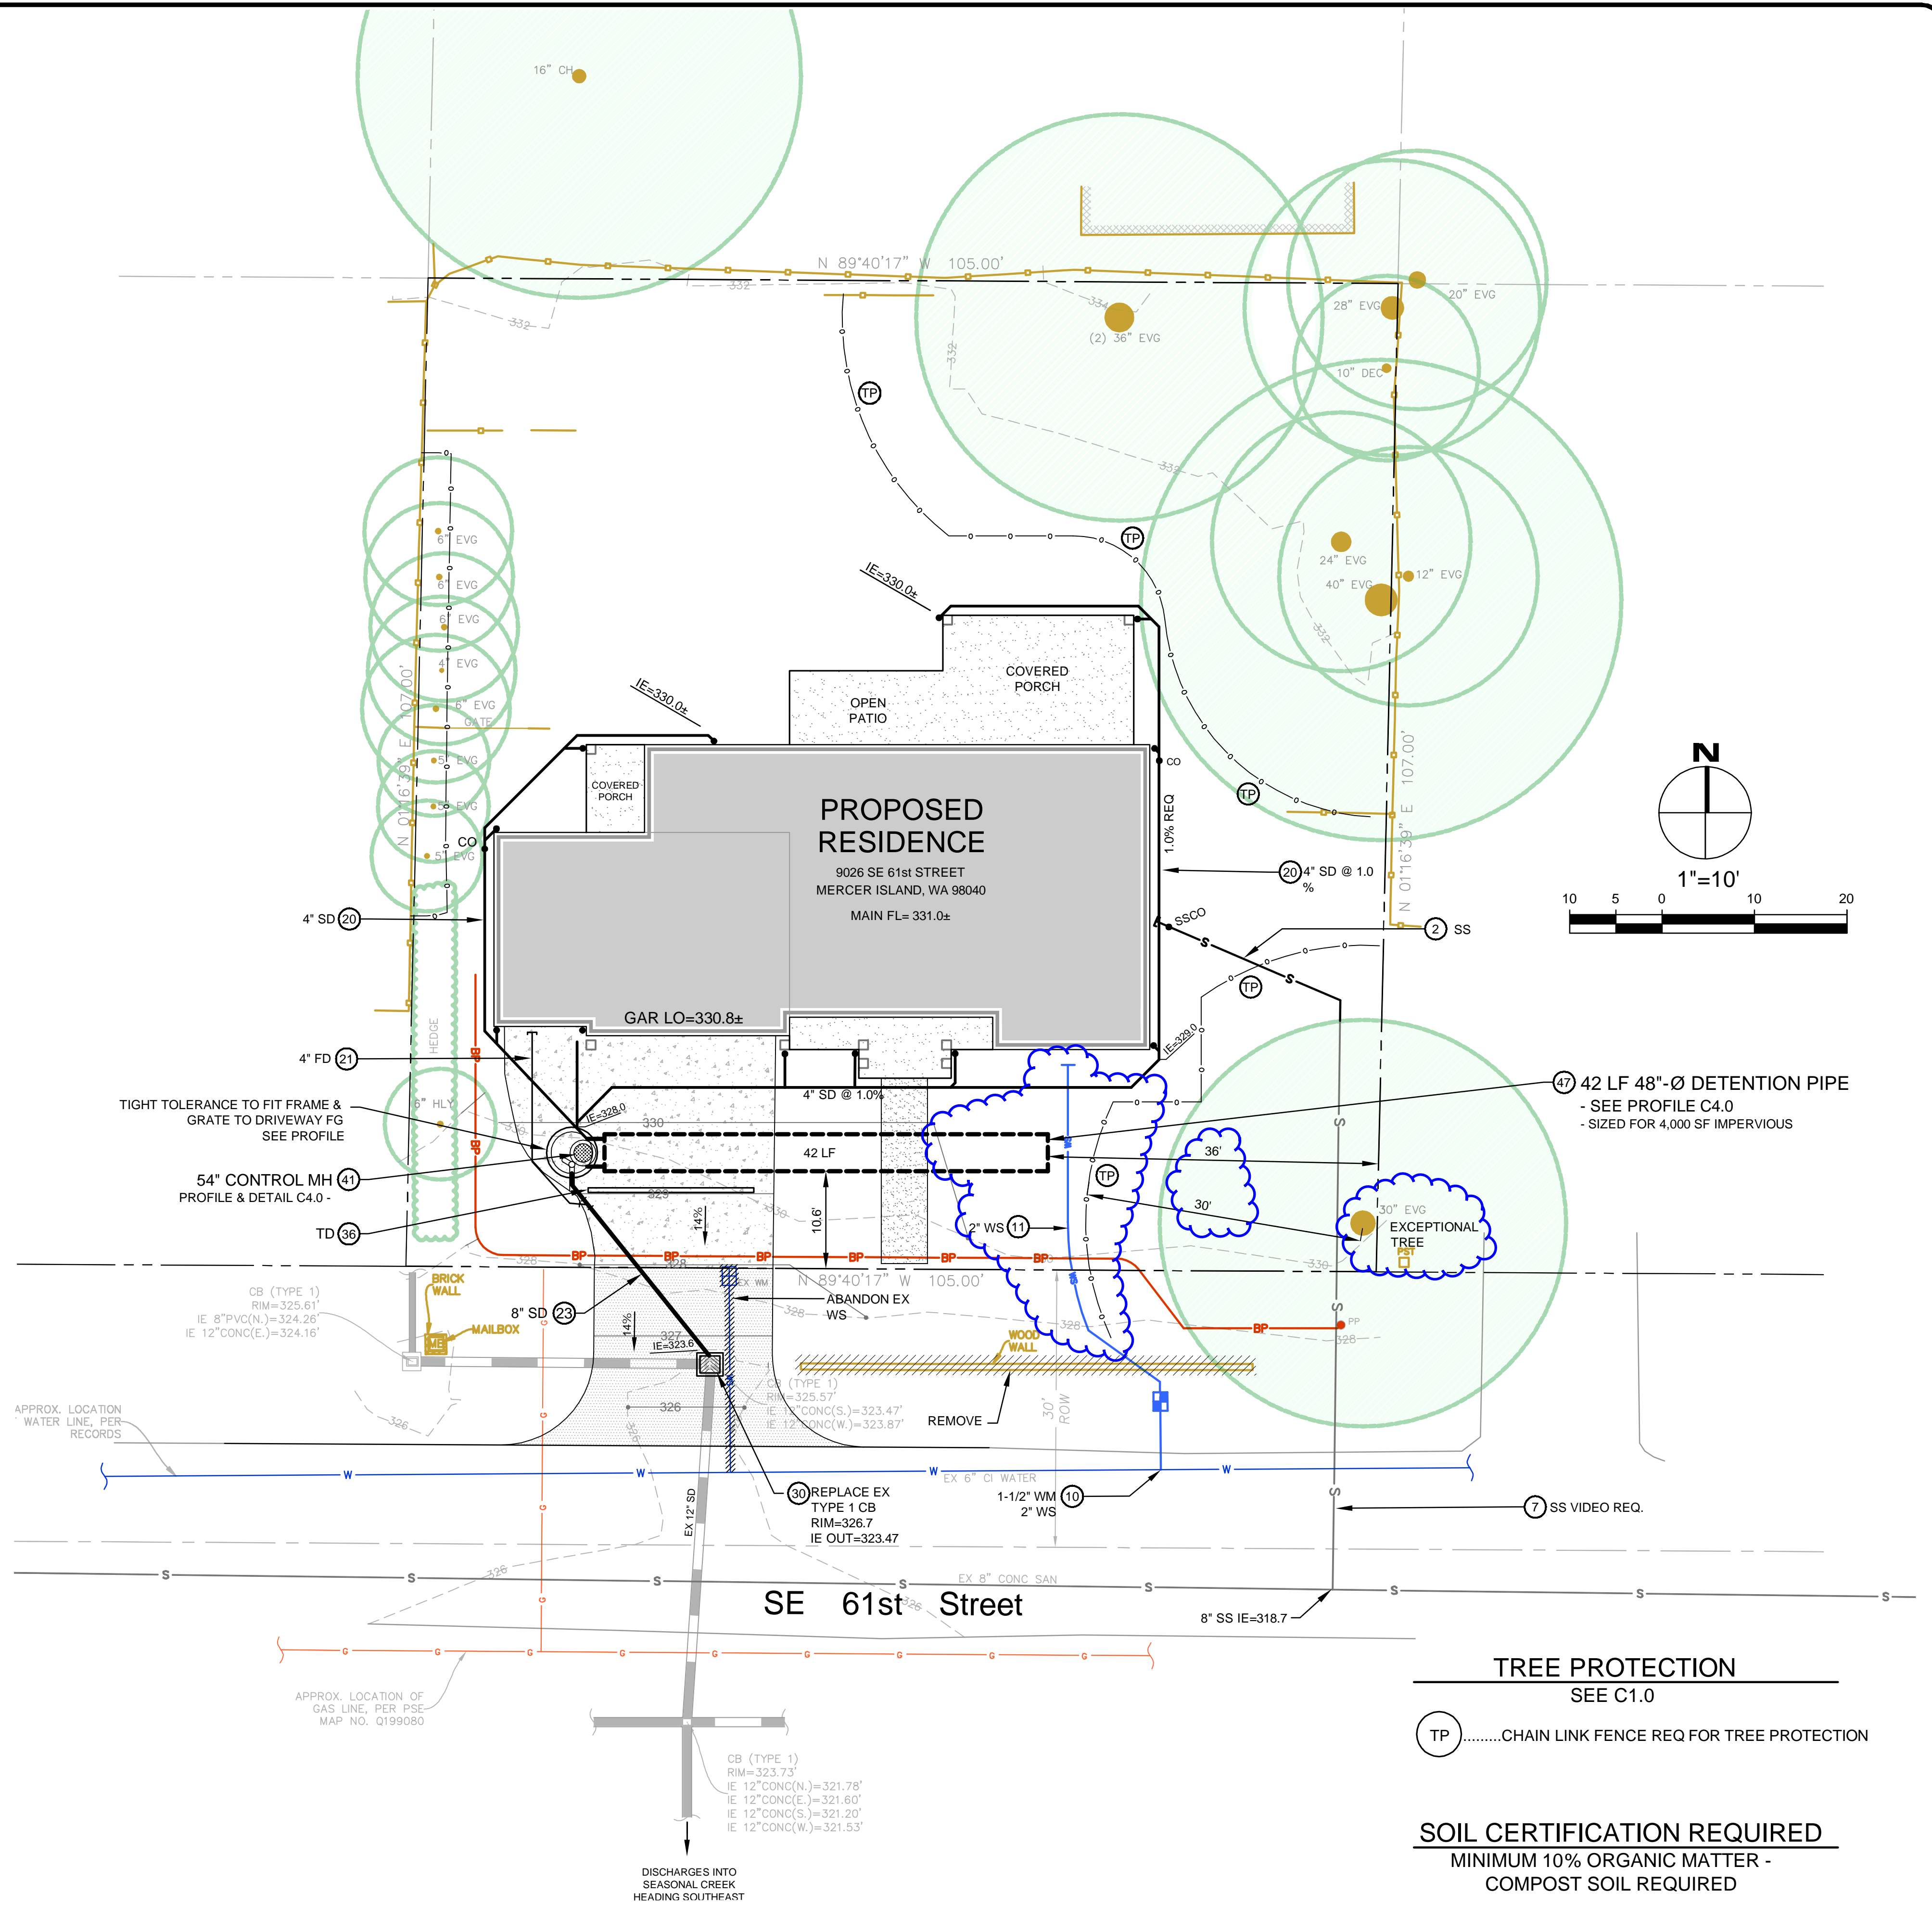

NO.	DATE	BY	REVISIONS

APPLICANT JASON KOEHLER RKK CONSTRUCTION	DATE: Apr 11, 2022
	JOB# 1990
	DRAFTED: DE DESIGN: DE
	DIGITAL SIGNATURE

--	--

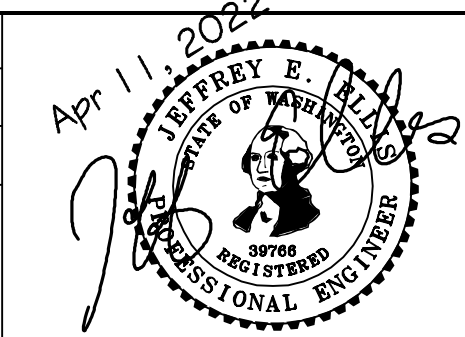

CIVIL ENGINEERING SOLUTIONS
 102 NW CANAL STREET SEATTLE, WA 98107
 PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

DRAINAGE / CIVIL PLAN
 PROPOSED RESIDENCE
 9026 SE 61st STREET, MERCER ISLAND, WA 98040

DRAWING NO: C2.0
APN 865090-0055

SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION. SEE DETAIL BELOW.

SOIL INSPECTION REQUIRED BY ENGINEER

A POST CONSTRUCTION INSPECTION & CERTIFICATION OF AMENDED SOILS IS REQUIRED BY A LICENSED CIVIL ENGINEER. THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.


SOIL CERTIFICATION REQ

MINIMUM 10% ORGANIC MATTER - COMPOST SOIL REQUIRED


GATHER ALL DELIVERY RECEIPTS & FORWARD TO ENGINEER

COMPOST AMENDED SOIL SPEC

AMENDMENT FOR LANDSCAPED AREAS

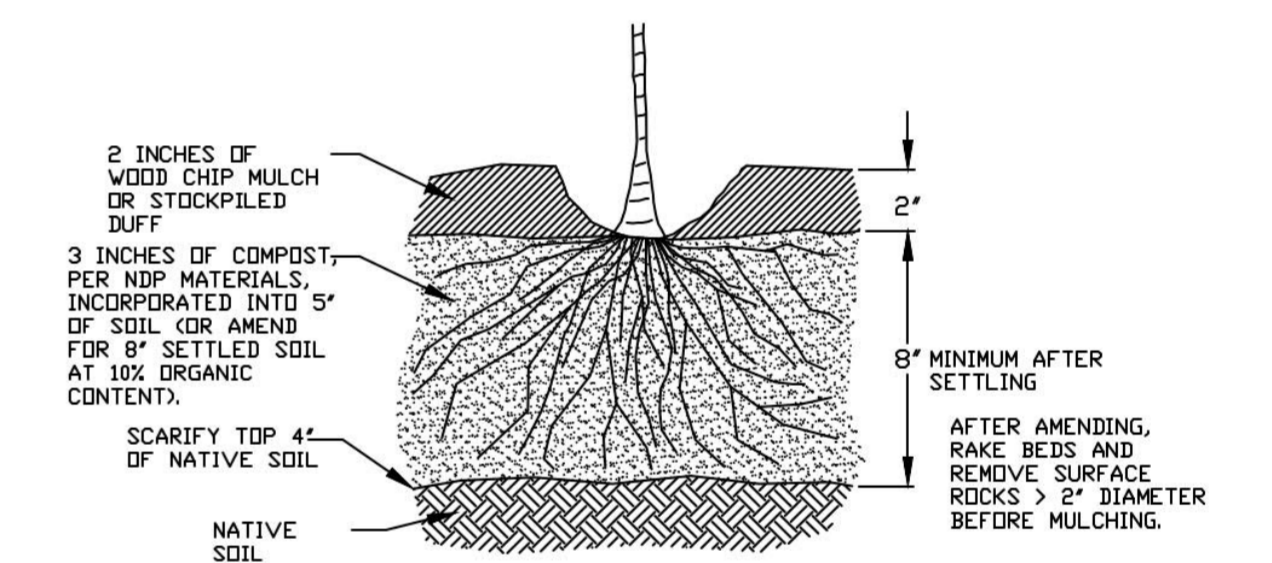

SOIL AMENDMENT FOR GRASS OR TURF AREAS

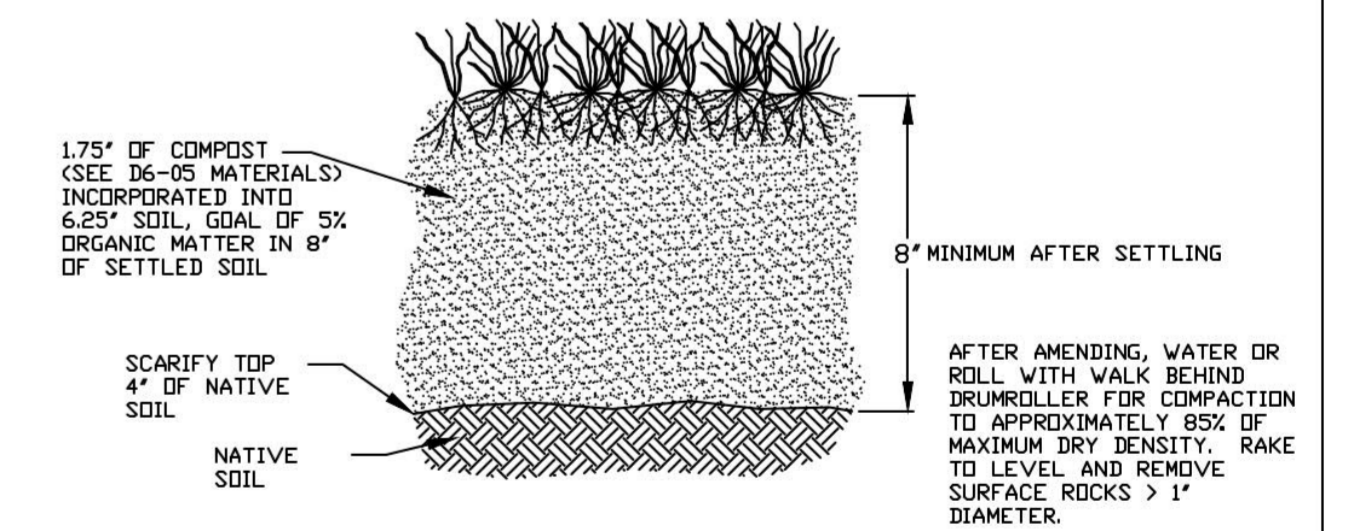

NOTES:

1. AMEND SOILS PER DOE MANUAL, VOL. V, 5.31, BMP TS13, (2012 OR CURRENT) OR WWW.SOILSFORSALMONIDRG.
2. DO NOT AMEND SOILS IN AREAS WITH UNDISTURBED SOIL AND NATIVE VEGETATION.
3. OPTIONAL ALTERNATIVE: STOCKPILE NATIVE TOPSOIL ONSITE, AMEND IF NEEDED, AND REPLACE BEFORE PLANTING.
4. OPTIONAL ALTERNATIVE: IMPORT TOPSOIL MIX OF SUFFICIENT ORGANIC CONTENT AND DEPTH TO MEET REQUIREMENTS.

City of Bellevue STORM AND SURFACE WATER UTILITY

TITLE AMENDED SOILS

JANUARY 2021


NO SCALE

NO. ADD-1

NO.	DATE	BY	REVISIONS

APPLICANT
JASON KOEHLER
RKK CONSTRUCTION

DATE: Mar 03, 2022
JOB# 1990
DRAFTED: SS DESIGN: SS
DIGITAL SIGNATURE

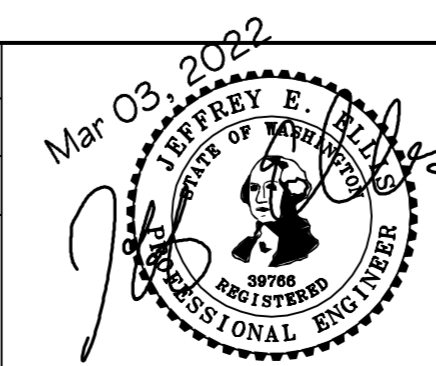

CIVIL ENGINEERING SOLUTIONS

102 NW CANAL STREET SEATTLE, WA 98107
PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

BMP DETAILS

PROPOSED RESIDENCE
9026 SE 61st STREET, MERCER ISLAND, WA 98040

DRAWING NO:

C3.5

APN 865090-0055

MERCER ISLAND DETENTION "TABLE 1"

Table 1
ON-SITE DETENTION DESIGN FOR PROJECTS BETWEEN 500 SF AND 9,500 SF NEW PLUS REPLACED IMPERVIOUS SURFACE AREA

New and Replaced Impervious Surface Area (sf)	Detention Pipe Diameter (in)	Detention Pipe Length (ft)		Lowest Orifice Diameter (in) ⁽¹⁾		Distance from Outlet Invert to Second Orifice (ft)		Second Orifice Diameter (in)	
		B soils	C soils	B soils	C soils	B soils	C soils	B soils	C soils
500 to 1,000 sf	36"	30	22	0.5	0.5	2.2	2.0	0.5	0.8
	48"	18	11	0.5	0.5	3.3	3.2	0.9	0.8
	60"	11	7	0.5	0.5	4.2	3.4	0.5	0.6
1,001 to 2,000 sf	36"	66	43	0.5	0.5	2.2	2.3	0.9	1.4
	48"	34	23	0.5	0.5	3.2	3.3	0.9	1.2
	60"	22	14	0.5	0.5	4.3	3.6	0.9	0.9
2,001 to 3,000 sf	36"	90	66	0.5	0.5	2.2	2.4	0.9	1.9
	48"	48	36	0.5	0.5	3.1	2.8	0.9	1.5
	60"	30	20	0.5	0.5	4.2	3.7	0.9	1.1
3,001 to 4,000 sf	36"	120	78	0.5	0.5	2.4	2.4	1.4	1.6
	48"	62	42	0.5	0.5	2.8	2.9	0.8	1.3
	60"	42	26	0.5	0.5	3.8	3.9	0.9	1.3
4,001 to 5,000 sf	36"	134	91	0.5	0.5	2.8	2.2	1.7	1.5
	48"	73	49	0.5	0.5	3.6	2.9	1.6	1.5
	60"	46	31	0.5	0.5	4.6	3.5	1.6	1.3
5,001 to 6,000 sf	36"	162	109	0.5	0.5	2.7	2.2	1.8	1.6
	48"	90	59	0.5	0.5	3.5	2.9	1.7	1.5
	60"	54	37	0.5	0.5	4.6	3.6	1.6	1.4
6,001 to 7,000 sf	36"	192	128	0.5	0.5	2.7	2.2	1.9	1.8
	48"	102	68	0.5	0.5	3.7	2.9	1.9	1.6
	60"	64	43	0.5	0.5	4.6	3.6	1.8	1.5
7,001 to 8,000 sf	36"	216	146	0.5	0.5	2.8	2.2	2.0	1.9
	48"	119	79	0.5	0.5	3.8	2.9	2.2	1.7
	60"	73	49	0.5	0.5	4.5	3.6	2.0	1.6
8,001 to 8,500 sf ⁽²⁾	36"	228	155	0.5	0.5	2.8	2.2	2.1	1.9
	48"	124	84	0.5	0.5	3.7	2.9	1.9	1.8
	60"	77	53	0.5	0.5	4.6	3.6	2.0	1.6
8,501 to 9,000 sf	36"	NA ⁽³⁾	164	0.5	0.5	NA ⁽³⁾	2.2	NA ⁽³⁾	1.9
	48"	NA ⁽³⁾	89	0.5	0.5	NA ⁽³⁾	2.9	NA ⁽³⁾	1.9
	60"	NA ⁽³⁾	55	0.5	0.5	NA ⁽³⁾	3.6	NA ⁽³⁾	1.7
9,001 to 9,500 sf ⁽²⁾	36"	NA ⁽³⁾	174	0.5	0.5	NA ⁽³⁾	2.2	NA ⁽³⁾	2.1
	48"	NA ⁽³⁾	94	0.5	0.5	NA ⁽³⁾	2.9	NA ⁽³⁾	2.0
	60"	NA ⁽³⁾	58	0.5	0.5	NA ⁽³⁾	3.7	NA ⁽³⁾	1.7

Notes:


- Minimum Requirement #7 (Flow Control) is required when the 100-year flow frequency causes a 0.15 cubic feet per second increase (when modeled in WWHM with a 15-minute timestep). Breakpoints shown in this table are based on a flat slope (0-5%). The 100-year flow frequency will need to be evaluated on a site-specific basis for projects on moderate (5-15%) or steep (>15%) slopes.
- Soil type to be determined by geotechnical analysis or soil map.
- Sizing includes a Volume Correction Factor of 120%.
- Upper bound contributing area used for sizing.
- On Type B soils, new plus replaced impervious surface areas exceeding 8,500 sf trigger Minimum Requirement #7 (Flow Control)
- On Type C soils, new plus replaced impervious surface areas exceeding 9,500 sf trigger Minimum Requirement #7 (Flow Control)
- Minimum orifice diameter = 0.5 inches
- in = inch
- ft = feet
- sf = square feet

Basin of Sizing Assumptions:
Sized per MR#5 in the Stormwater Management Manual for Puget Sound Basin (1992 Ecology Manual)
SBUH, Type 1A, 24-hour hydrograph
2-year, 24-hour storm = 2 in; 10-year, 24-hour storm = 3 in; 100-year, 24-hour storm = 4 in
Predeveloped = second growth forest (CN = 72 for Type B soils, CN = 81 for Type C soils)
Developed = impervious (CN = 98)
0.5 foot of sediment storage in detention pipe
Overland slope = 5%

IMPERVIOUS TABLE - STORMWATER

Impervious Area Spreadsheet
Proposed Residence - 9026 SE 61st Street, Mercer Island, WA 98040

Gross Site area	11,233 sf	0.258 acres
Existing Impervious Area to be demolished	5,833 sf	
Existing Impervious Area to remain	0 sf	
total existing impervious area =	5,833 sf	
total existing vegetated area =	5,400 sf	
Proposed Impervious Area (on-site)		
Roof	2,885 sf	
Exposed, on-site driveway	553 sf	
Exposed back patio	113 sf	
Proposed front walkway, on-site	97 sf	
total on-site proposed =	3,648 sf	
total new + replaced impervious =	(2,185) sf	
total proposed vegetated area =	7,585 sf	

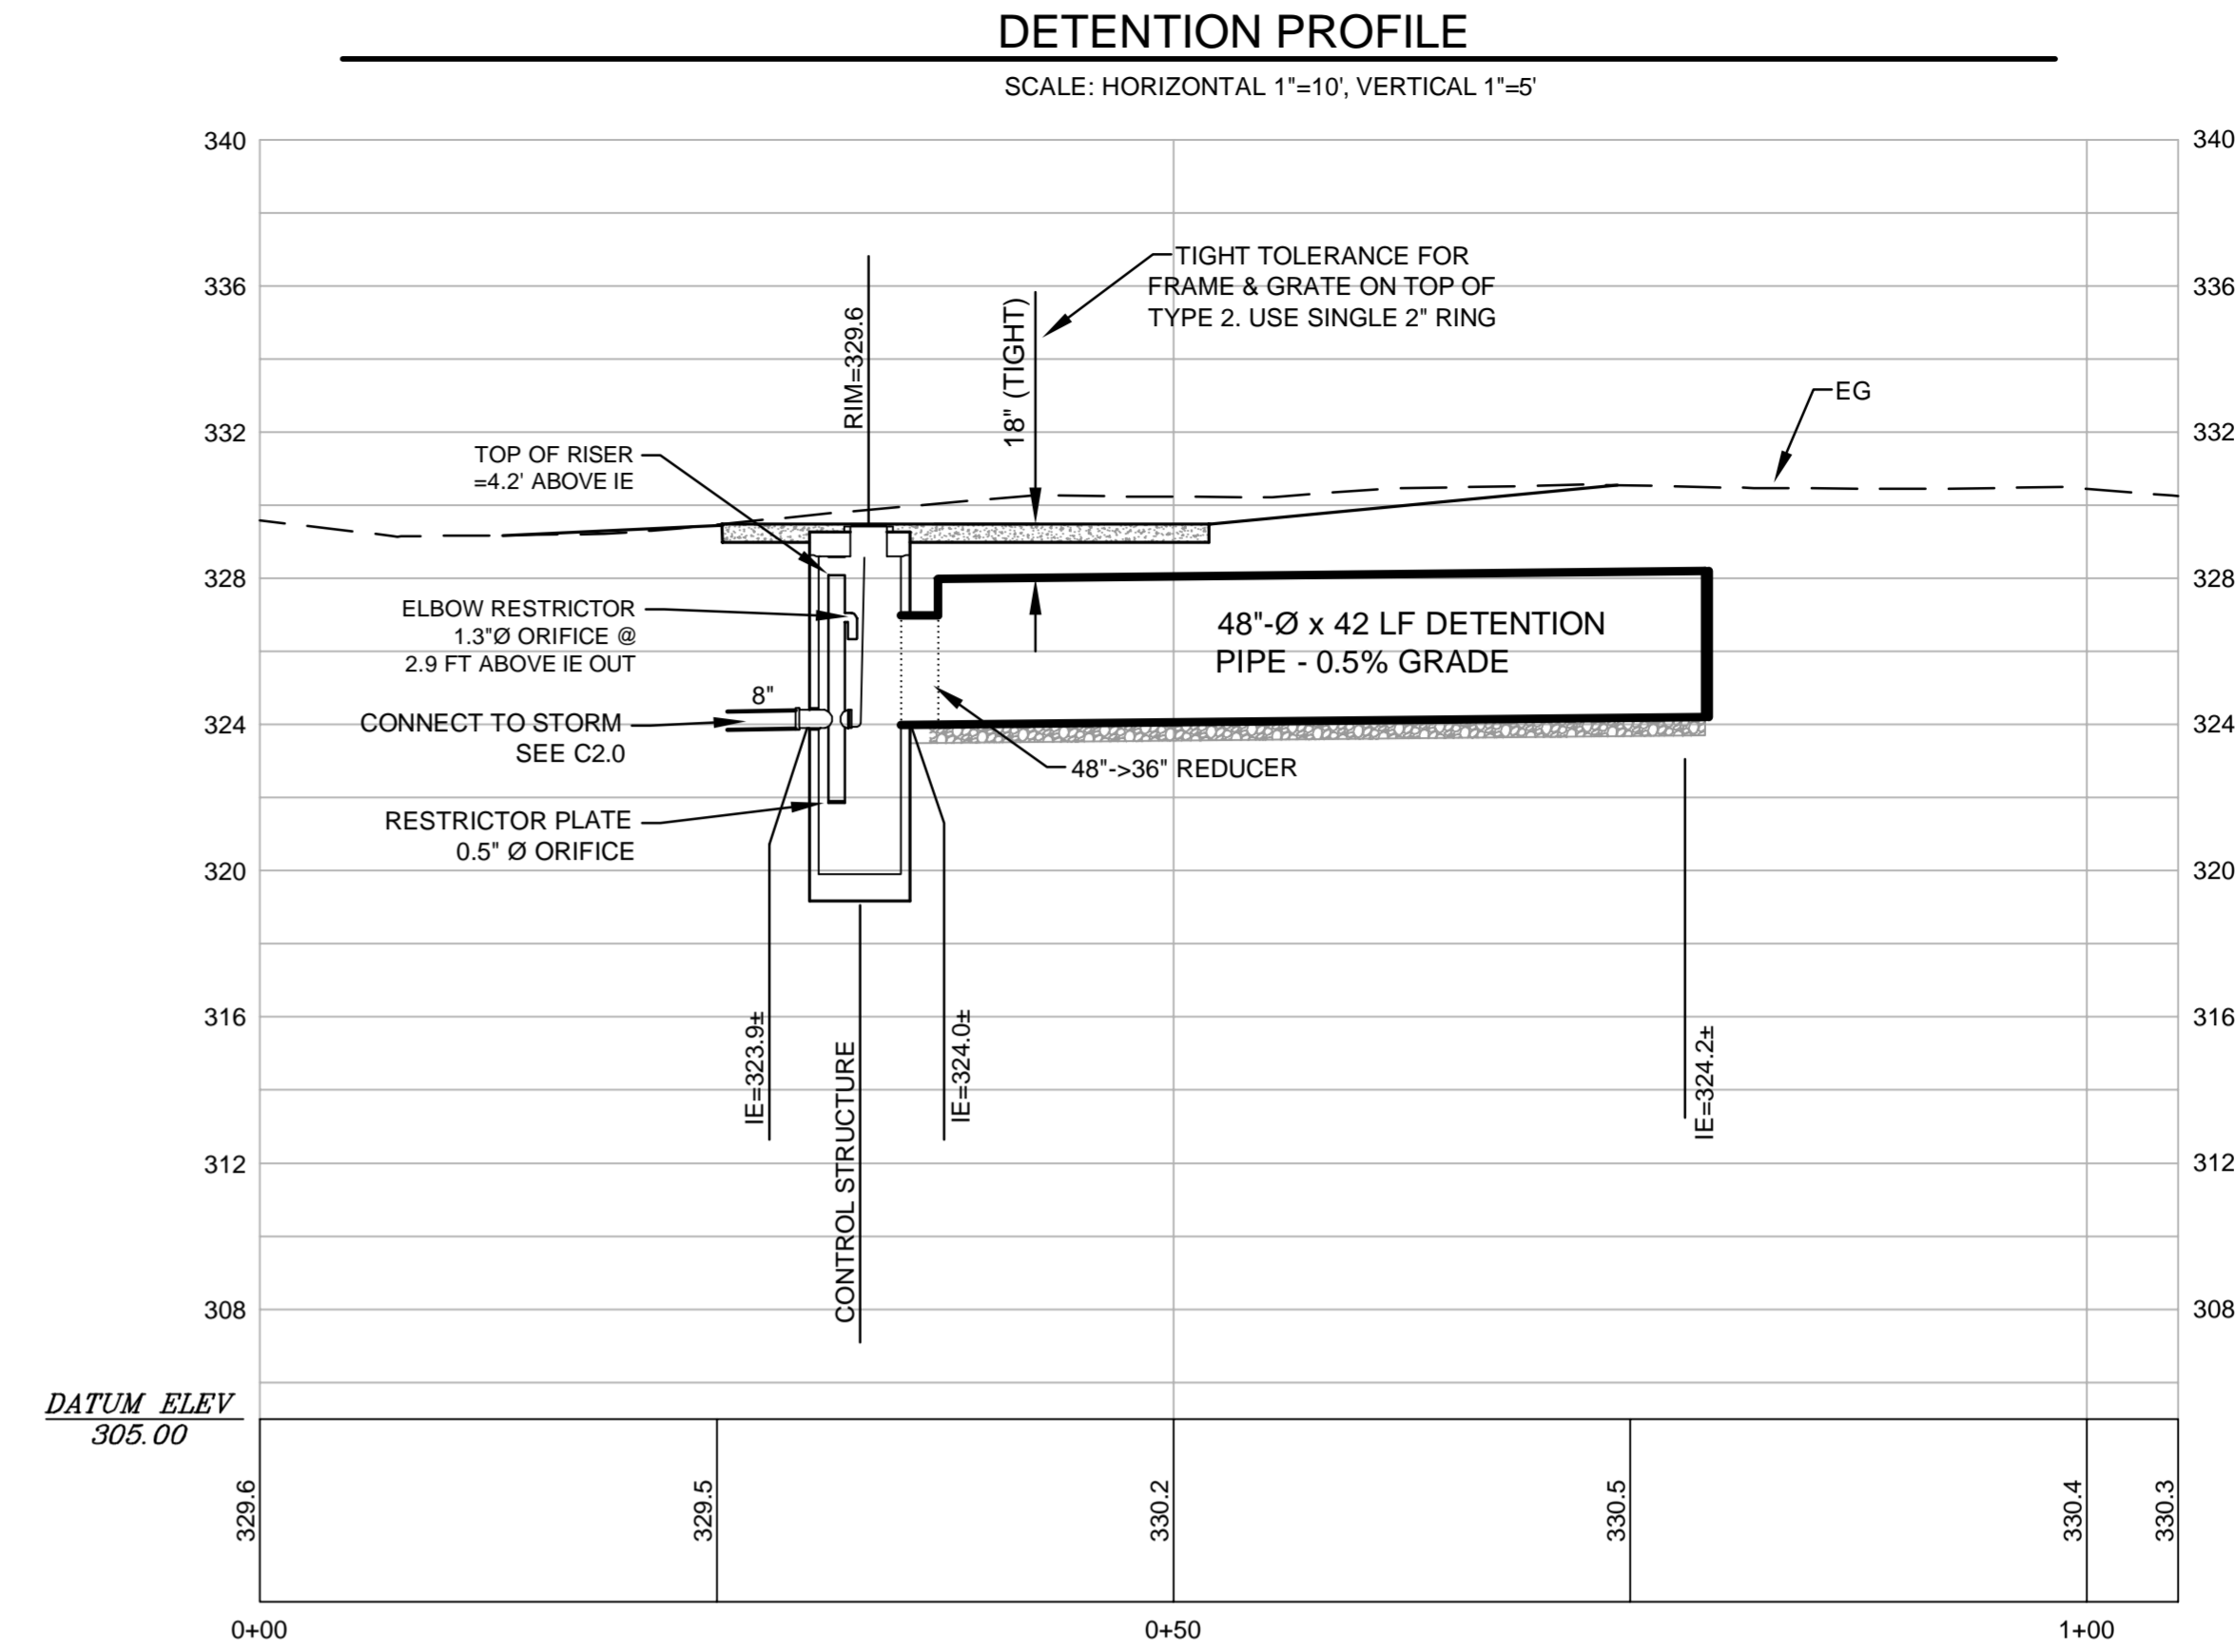

MERCER ISLAND DETENTION DETAIL

ATTACHMENT 1
CITY OF MERCER ISLAND
ON-SITE DETENTION SYSTEM WORKSHEET
(FOR NEW PLUS REPLACED IMPERVIOUS AREA OF 9,500 SF OR LESS)

OWNER: RKK CONSTRUCTION ADDRESS: 9026 SE 61st STREET PREPARED BY: DUFFY ELLIS, P.E.
PERMIT #: _____ Mercer Island, WA 98040 PHONE: 206.930.0342
DATE: NOV 2021

NEW PLUS REPLACED IMPERVIOUS SURFACE AREA (SF): 3,648 SF DETENTION PIPE DIA. (INCH): 48" DIA DETENTION PIPE LENGTH (FT): 42 LF ORIFICE #1 DIA. (INCH) ELEV. *
SOIL TYPE: Type C per Geologic Map of Mercer Island PIPE MATERIAL: CMP OR HDPE ORIFICE #2 DIA. (INCH) ELEV. *

*SEE TABLE 1, THIS SHEET

CONTROL STRUCTURE NOTES:

- USE A MINIMUM OF A 5/8 IN. DIA. TYPE 2 CATCH BASIN. THE ACTUAL SIZE IS DEPENDENT ON CONNECTING PIPE MATERIAL AND DIAMETER.
- OUTLET PIPE: MIN. 6 INCH.
- METAL PARTS: CORROSION RESISTANT, NON-GALVANIZED PARTS PREFERRED. GALVANIZED PIPE PARTS TO HAVE ASPHALT TREATMENT 1.
- FRAME AND LADDER OR STEPS OFFSET 50.
- CLEANOUT GATE IS VISIBLE FROM TOP.
- CLAMP-DOWN SPACE IS CLEAR OF RISER AND CLEANOUT GATE.
- FRAME IS CLEAR OF CURB.
- IF METAL OUTLET PIPE CONNECTS TO CEMENT CONCRETE PIPE, OUTLET PIPE TO HAVE SMOOTH O.D. EQUAL TO CONCRETE PIPE I.D. LESS 1/4 IN.
- PROVIDE AT LEAST ONE 3 X 0.090 GAUGE SUPPORT BRACKET ANCHORED TO CONCRETE WALL WITH 5/8 IN. STAINLESS STEEL EXPANSION BOLTS OR EMBEDDED SUPPORTS 2 IN. INTO CATCH BASIN WALL (MAXIMUM 3'-0" VERTICAL SPACING).
- THE SHEAR GATE SHALL BE MADE OF ALUMINUM ALLOY IN ACCORDANCE WITH ASTM B 264 AND ASTM B 275. DESIGNATION 2024A; OR CAST IRON IN ACCORDANCE WITH ASTM A 48, CLASS 30B. THE LEFT HANDLE SHALL BE MADE OF A SHARP METAL TO THE GATE TO PREVENT GALVANIC CORROSION. IT MAY BE OF SOLID ROD OR HOLLOW TUBING WITH ADJUSTABLE HOOK AS REQUIRED. A RESILIENT RUBBER GASKET IS REQUIRED BETWEEN THE RISER MOUNTING FLANGE AND THE GATE FLANGE. INSTALL THE GATE SO THAT THE LEVEL-LINE MARK IS LEVEL WHEN THE GATE IS CLOSED. THE MARKING SURFACES OF THE LID AND THE BODY SHALL BE MACHINED FOR PROPER FIT. ALL SHEAR GATE BOLTS SHALL BE STAINLESS STEEL.
- THE UPPER CATCH BASIN IS REQUIRED IF THE LENGTH OF THE DETENTION PIPE IS GREATER THAN 50 FT.

ON-SITE DETENTION SYSTEM NOTES:

- CALL DEVELOPMENT SERVICES (206-275-7600) 24 HOURS IN ADVANCE FOR A DETENTION SYSTEM INSPECTION BEFORE BACKFILLING AND FOR FINAL INSPECTIONS.
- RESPONSIBILITY FOR OPERATION AND MAINTENANCE OF DRAINAGE SYSTEMS ON PRIVATE PROPERTY IS RESPONSIBILITY OF THE PROPERTY OWNER. MATERIAL ACCUMULATED IN THE STORAGE PIPE MUST BE REMOVED FROM CATCH BASINS TO ALLOW PROPER OPERATION. THE OUTLET ORIFICE MUST BE KEPT OPEN AT ALL TIMES.
- PIPE MATERIAL, JOINT, AND PROTECTIVE TREATMENT SHALL BE IN ACCORDANCE WITH SECTION 7.24 AND 8.02 OF THE MOST RECENT SPECIFICATIONS FOR ROAD, BRIDGE, AND MUNICIPAL CONSTRUCTION, LATEST EDITION. SUCH MATERIALS INCLUDE THE FOLLOWING LISTED: CORRUGATED POLYETHYLENE PIPE (CPEP), ALUMINIZED TYPE 2 CORRUGATED STEEL PIPE AND PIPE JOINTS, ANCHOR DETENTIONING (ADA) AND ANCHOR CORRUGATED OR SPIRAL (AS) ALUMINUM PIPE, OR REINFORCED CONCRETE PIPE, CORRUGATED STEEL PIPE IS NOT ALLOWED.
- FOOTING DRAINS SHALL NOT BE CONNECTED TO THE DETENTION SYSTEM.

NO.	DATE	BY	REVISIONS

APPLICANT
JASON KOEHLER
RKK CONSTRUCTION

DATE: Mar 03, 2022
JOB#: 1990
DRAFTED: SS DESIGN: SS
DIGITAL SIGNATURE

Mar 03, 2022
JEFFREY E. DUFFY
PROFESSIONAL ENGINEER

CIVIL ENGINEERING SOLUTIONS
102 NW CANAL STREET SEATTLE, WA 98107
PHONE: 206.930.0342 DUFFY@CESOLUTIONS.US

DETENTION PROFILE AND DETAIL
PROPOSED RESIDENCE
9026 SE 61st STREET, MERCER ISLAND, WA 98040

DRAWING NO:
C4.0
APN 865090-0055

BUILDING CODE: 2018 EDITION OF THE INTERNATIONAL BUILDING CODE (IBC), AND BY REFERENCE, THE 2018 INTERNATIONAL RESIDENTIAL CODE (IRC) AS AMENDED BY LOCAL JURISDICTION.
ROOF LIVE LOAD = 25 PSF SNOW (GROUND SNOW = 30 PSF)
ROOF DEAD LOAD = 15 PSF
FLOOR LIVE LOAD = 40 PSF (30 PSF AT SLEEPING AREAS)
FLOOR DEAD LOAD = 15 PSF
BALCONIES & DECKS = 60 PSF (LIVE LOAD) + 10 PSF (DEAD LOAD)
WIND SPEED (NOMINAL 3 SEC GUST) = 100 MPH FOR RISK CATEGORY II, EXPOSURE 'B', Kzt=1.38
SOIL SITE CLASS 'D' - SEISMIC CATEGORY D1/D2, Ss=1.45S, Sds=1.164
OCCUPANCY GROUP: R-3 **CONSTRUCTION TYPE:** V-B

CONTRACTOR TO VERIFY ALL DIMENSIONS AND CONDITIONS OF PROJECT AND REPORT ANY OMISSIONS / DISCREPANCIES TO ARCHITECT AND/OR ENGINEER OF RECORD FOR RESOLUTION PRIOR TO COMMENCING WORK. WRITTEN DIMENSIONS TAKE PRECEDENCE OVER SCALED DRAWINGS. ARCHITECT AND/OR ENGINEER OF RECORD ARE NOT RESPONSIBLE FOR DISCREPANT CONDITIONS RESULTING FROM UNAUTHORIZED WORK PERFORMED BY THE CONTRACTOR.

DEFERRED SUBMITTAL ITEMS

THE FOLLOWING IS A LIST OF ITEMS THAT ARE NOT INCLUDED IN THIS PLAN AND SHOULD BE PROVIDED BY THE BUILDER AT THE TIME OF APPLICATION FOR PERMIT OR AS A DEFERRED SUBMITTAL ITEM:
 - ALTERNATIVE 1-JOIST/BEAM/ MANUFACTURER PLANS.
 - MANUFACTURED TRUSS DESIGNS AND LAYOUTS

GENERAL

FOUNDATION DESIGN IS BASED ON AN ALLOWABLE SOIL BEARING OF 1500 PSF. EXTERIOR FOOTINGS SHALL BEAR 18" (MINIMUM) BELOW FINISHED GRADE. ALL FOOTINGS TO BEAR ON FIRM UNDISTURBED EARTH BELOW ORGANIC SURFACE SOILS. BACKFILL TO BE THOROUGHLY COMPACTED.
 BOLT HEADS AND NUTS BEARING AGAINST WOOD TO BE PROVIDED WITH 0.229"x3"x3" PLATE WASHERS. WOOD BEARING ON OR INSTALLED WITHIN 1" OF MASONRY OR CONCRETE TO BE PRESSURE TREATED WITH AN APPROVED PRESERVATIVE.
 FOUNDATION SILL BOLTS (MIN. 1" EMBED.) TO BE 5/8" DIAMETER AT 6'-0" O.C. (4'-0" AT BUILDINGS OVER 2 STORIES) UNO. METAL FRAMING CONNECTORS TO BE SIMPSON STRONG-TIE OR USP STEEL CONNECTORS.

CONCRETE

MINIMUM COMPRESSIVE STRENGTH OF CONCRETE:

TYPE OR LOCATIONS OF CONCRETE CONSTRUCTION	MINIMUM COMPRESSIVE STRENGTH (F _C) AT 28 DAYS	MODERATE WEATHERING POTENTIAL
BASEMENT WALLS, FOUNDATION FOOTINGS, BASEMENT SLABS, 4 INTERIOR SLABS ON GRADE (EXCEPT GARAGE) NOT EXPOSED TO THE WEATHER	2500 psi	
BASEMENT WALLS, FOUNDATION WALLS, EXTERIOR WALLS, PORCHES, STEPS, GARAGE & CARPORT SLABS, 4 OTHER CONCRETE WORK EXPOSED TO THE WEATHER	3000 psi (6% air entrained v/v 1%)	

CONCRETE MIXTURE SHALL CONTAIN AT LEAST OF 5 1/2 SACKS OF CEMENT PER CUBIC YARD. CONCRETE "BATCH TICKET" SHALL BE AVAILABLE ON SITE FOR REVIEW BY BUILDING OFFICIAL. VERTICAL REINFORCING STEEL TO COMPLY WITH ASTM A615 GRADE 40 (GRADE 60 AT WALLS RETAINING MORE THAN 4FT OF SOIL).

CARPENTRY

GENERAL

ALL NAILING TO COMPLY WITH REQUIREMENTS OF IRC TABLE R602.3(1) AND/OR IBC TABLE 2304.10. ALL WOOD IN CONTACT WITH CONCRETE TO BE PRESSURE TREATED. FIELD CUT ENDS, NOTCHES, AND DRILLED HOLES OF PRESSURE TREATED LUMBER SHALL BE RETREATED IN THE FIELD IN ACCORDANCE WITH AWPA M4. PER IRC 319.3, FASTENERS FOR PRESSURE PRESERVATIVE AND FIRE RETARDANT TREATED WOOD SHALL BE OF HOT-DIPPED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE, OR COPPER.
 6" MIN. CLEARANCE BETWEEN WOOD AND EARTH.
 12" MIN. CLEARANCE BETWEEN FLOOR BEAMS AND EARTH.
 18" MIN. CLEARANCE BETWEEN FLOOR JOIST AND EARTH.

FASTENER DIMENSIONS

ALL NAILS SPECIFIED ON THIS PLAN SHALL BE OF THE DIAMETER AND LENGTH LISTED BELOW OR AS PER APPENDIX L OF THE NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION (NDS):
 8d COMMON (0.131" DIA, 2-1/2" LENGTH), 8d BOX (0.131" DIA, 2-1/2" LONG), 10d COMMON (0.148" DIA, 3" LONG), 10d BOX (0.148" DIA, 3" LONG), 16d COMMON (0.162" DIA, 3-1/2" LONG), 16d SINKER (0.148" DIA, 3-1/4" LONG), 5d COOLER (0.086" DIA, 1-5/8" LONG), 6d COOLER (0.092" DIA, 1-7/8" LONG).

LUMBER GRADES

FRAMING LUMBER SHALL COMPLY WITH THE LATEST EDITION OF THE GRADING RULES OF THE WESTERN PRODUCTS ASSOCIATION OR THE WEST COAST LUMBER INSPECTION BUREAU. ALL SAWN LUMBER SHALL BE STAMPED WITH THE GRADE MARK OF AN APPROVED LUMBER GRADING AGENCY AND SHALL HAVE THE FOLLOWING UNADJUSTED MINIMUM DESIGN PROPERTIES, UNLESS NOTED OTHERWISE.

JOISTS:	WOOD TYPE:
2x4 to 2x8	DF-L #2 - Fc=900 psi, Fv=180 psi, Fc=1350 psi, E=1600000psi
2x10 OR LARGER	DF-L #2 - Fc=900 psi, Fv=180 psi, Fc=1350 psi, E=1600000psi
BEAM	
4x	DF-L #2 - Fc=900 psi, Fv=180 psi, Fc=1350 psi, E=1600000psi
6x OR LARGER	DF-L #2 - Fc=875 psi, Fv=170 psi, Fc=600 psi, E=1300000psi
STUDS	
2x4 & 2x6	DF STUD - Fc=700 psi, Fv=180 psi, Fc=850 psi, E=1400000psi
2x8 OR LARGER	DF-L #2 - Fc=900 psi, Fv=180 psi, Fc=1350 psi, E=1600000psi
POSTS	
4x4	DF-L #2 - Fc=900 psi, Fv=180 psi, Fc=1350 psi, E=1600000psi
4x6	DF-L #2 - Fc=900 psi, Fv=180 psi, Fc=1350 psi, E=1600000psi
6x6 OR LARGER	DF-L #1 - Fc=1200 psi, Fv=170 psi, Fc=1000 psi, E=1600000psi

GLUED-LAMINATED BEAM (GLB)

SHALL BE 24F-V4 FOR SINGLE SPANS & 24F-V8 FOR CONTINUOUS OR CANTILEVER SPANS WITH THE FOLLOWING MINIMUM PROPERTIES:
 Fb = 2,400 PSI, Fv = 165 PSI, Fc = 650 PSI (PERPENDICULAR), E = 1,800,000 PSI.

ENGINEERED WOOD BEAMS AND I-JOIST

CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND SPECIFICATIONS FOR APPROVAL BY BUILDING OFFICIAL. DESIGN, FABRICATION AND ERECTION IN ACCORDANCE WITH THE LATEST ICC EVALUATION REPORT.

BEAMS DESIGNATED AS "L9L" SHALL HAVE THE MINIMUM PROPERTIES:
 Fb = 2,325 PSI, Fv = 310 PSI, Fc = 800 PSI (PERPENDICULAR), E = 1,550,000 PSI.

BEAMS DESIGNATED AS "LVL" SHALL HAVE THE MINIMUM PROPERTIES:
 Fb = 2,600 PSI, Fv = 285 PSI, Fc = 750 PSI (PERPENDICULAR), E = 1,900,000 PSI.

BEAMS DESIGNATED AS "PSL" SHALL HAVE THE MINIMUM PROPERTIES:
 Fb = 2,300 PSI, Fv = 230 PSI, Fc = 750 PSI (PERPENDICULAR), E = 2,000,000 PSI.

CALCULATIONS SHALL INCLUDE DEFLECTION AND CAMBER REQUIREMENTS. DEFLECTION SHALL BE LIMITED AS FOLLOWS:

FLOOR LIVE LOAD MAXIMUM = L/480, FLOOR TOTAL LOAD MAXIMUM = L/240.

PREFABRICATED WOOD TRUSSES


PRE-FABRICATED WOOD TRUSSES SHALL BE DESIGNED TO SUPPORT SELF WEIGHT PLUS LIVE LOADS & IMPOSED DEAD LOADS AS STATED IN THE GENERAL NOTES. TRUSSES SHALL BE DESIGNED & STAMPED BY A REGISTERED DESIGN PROFESSIONAL AND FABRICATED ONLY FROM THOSE DESIGNS. NON-BEARING WALLS SHALL BE HELD AWAY FROM THE TRUSS BOTTOM CHORD W/ AN APPROVED FASTENER (SUCH AS SIMPSON STC) TO ENSURE THAT THE TRUSS BOTTOM CHORD DOES NOT BEAR ON THE WALL. ALL PERMANENT TRUSS MEMBER BRACING SHALL BE INSTALLED PER THE TRUSS DESIGN DRAWINGS.

ROOF/WALL/FLOOR SHEATHING

ROOF SHEATHING SHALL BE MINIMUM 3/8" SHEATHING W/ 2 1/4" SPAN INDEX UNO. WALL SHEATHING, INCLUDING GABLES, SHALL BE 3/8" SHEATHING W/ 2 1/4" SPAN INDEX MINIMUM UNO. FLOOR SHEATHING SHALL BE MINIMUM 3/8" T&G SHEATHING W/ 40% SPAN INDEX MINIMUM UNO. MINIMUM NAILING SHALL BE 8d COMMON NAILS @ 6" O.C. @ PANEL EDGES & 12" O.C. IN PANEL FIELD UNO ON SHEAR WALL SCHEDULE. ROOF AND FLOOR SHEATHING SHALL BE LAID OUT W/ LONG DIMENSION PERPENDICULAR TO FRAMING MEMBERS W/ END LAPs STAGGERED. WALL SHEATHING, INCLUDING GABLES, SHALL BE FULLY BLOCKED & EDGE NAILED AT ALL UNSUPPORTED SHEATHING PANEL EDGES.

STAIR FRAMING


UNLESS NOTED OTHERWISE SPECIFIED, TYPICAL STAIR FRAMING SHALL CONSIST OF 2x12 STAIR STRINGERS SPACED AT NO MORE THAN 18" O.C. AND REINFORCED W/ 2x8 SCABS ATTACHED W/ 10d COMMON NAILS STAGGERED AT 8" O.C. STRINGERS SHALL BE SUPPORTED AT UPPER END BY BEARING ON TOP PLATE OF WALL OR APPROVED CONNECTOR TO FLOOR BEAM SUCH AS SIMPSON LRU OR LSC. LANDINGS SHALL CONSIST OF CONVENTIONAL PLATFORM FRAMING W/ MINIMUM 2x6 JOISTS @ 16" O.C.

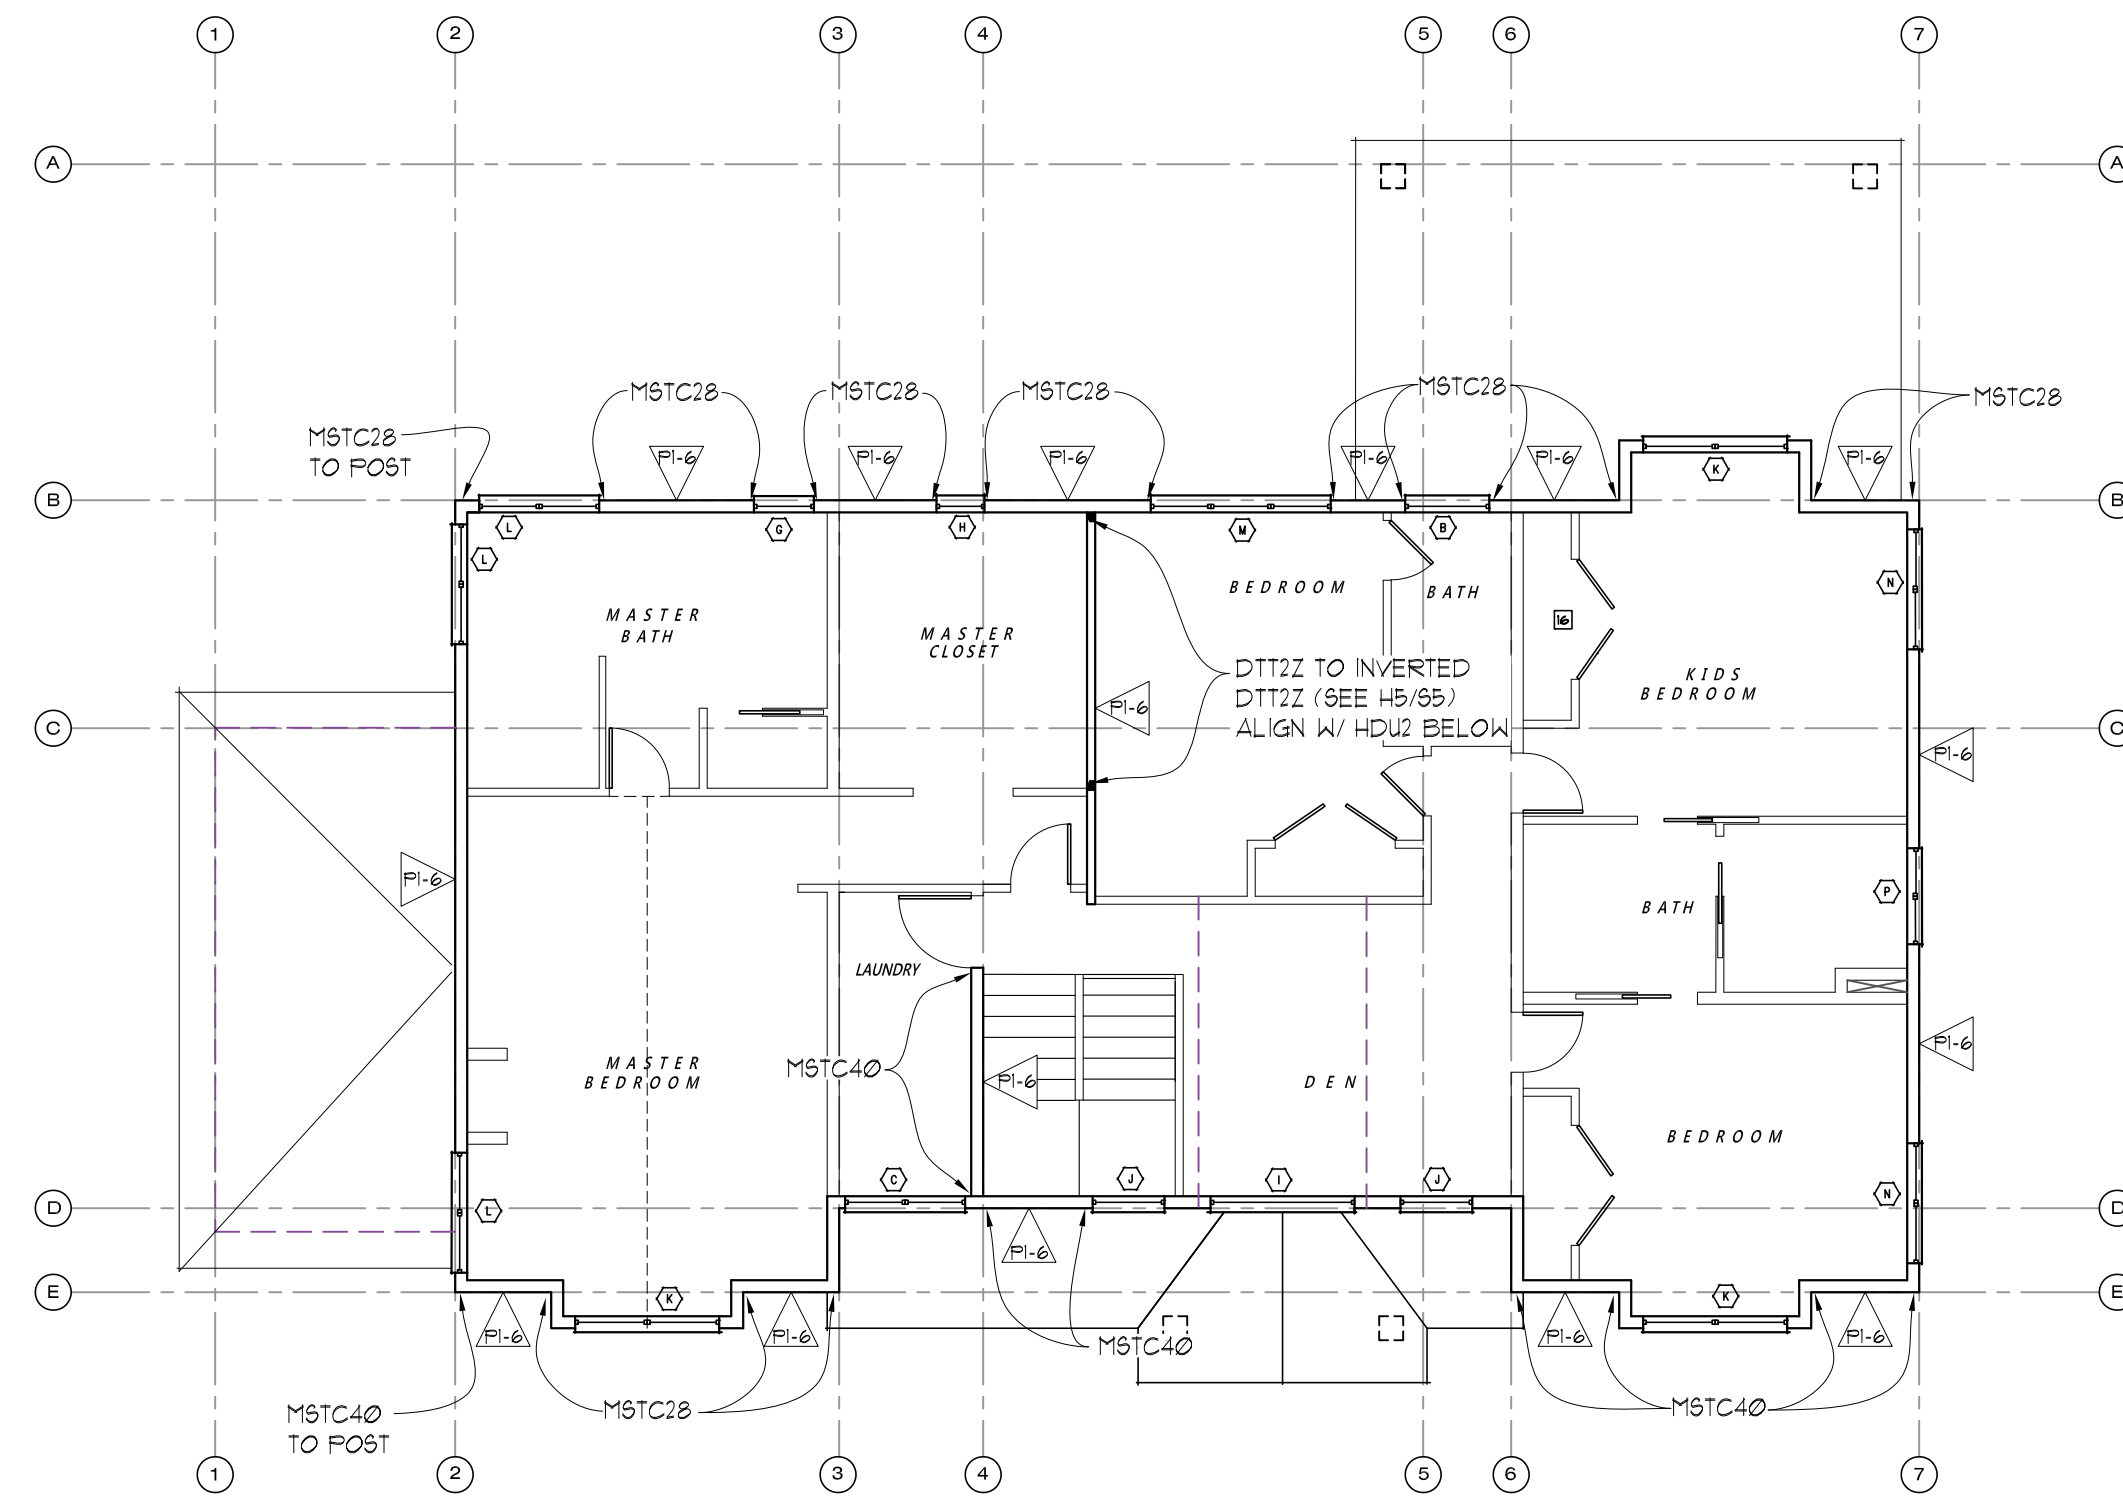

UPPER FLOOR SHEAR WALL KEY PLAN

SCALE: 1/8"=1'-0"


SEE SHEET S5 FOR TYPICAL INSTALLATION DETAILS FOR STRAPS & FOUNDATION ANCHORS



WALL MARK	SHEATHING THICKNESS	SIDES	SHEAR PANEL EDGE NAILING	FIELD NAILING	FRAMING @ ABUTTING PANEL EDGES	SOLE/BASE PLATE NAILING TO JOIST OR BLKG/RIM BELOW	ANCHOR BOLT DIA. & SPACING	SILL PLATE SIZE	POST AT ENDS OF SHEAR WALL/HOLD-DOWN UNO.
PI-6	7/16"	ONE	8d @ 6" O.C.	12" O.C.	2X	16d SINKER NAILS (0.148"x3 1/2") @ 6" O.C.	5/8" DIA. @ 12" O.C.	2X	(2) 2X POST (FACE NAIL W/ 10d (0.131"x3") NAILS @ 12" O.C. (STAGGER)
PI-4	7/16"	ONE	8d @ 4" O.C.	12" O.C.	2X	16d SINKER NAILS (0.148"x3 1/2") @ 6" O.C.	5/8" DIA. @ 48" O.C.	2X	(2) 2X POST (FACE NAIL W/ 10d (0.131"x3") NAILS @ 12" O.C. (STAGGER)
PI-2	7/16"	BOTH	8d @ 2" O.C.	12" O.C.	3X	NOT APPLICABLE	5/8" DIA. @ 16" O.C.	3X	4x6 DOUG-FIR

- FRAMING SHALL BE 2X DOUG-FIR @ 16" O.C. MAX UNLESS NOTED OTHERWISE IN SCHEDULE.
- SHEATHING PANELS MAY BE LAYED VERTICAL OR HORIZONTAL. BLOCK ALL HORIZONTAL EDGES W/ 2x OR 3x BLOCKING PER SCHEDULE (UNO.)
- ALL EXTERIOR WALLS NOT DESIGNATED AS SHEARWALLS SHALL RECEIVE APA RATED SHEATHING OR ALL VENEER PLYWOOD SIDING OF EQUIVALENT THICKNESS AT POINT OF FASTENING ON PANEL EDGES, FULLY BLOCKED WITH MINIMUM NAILING OF 8d @ 6" O.C. EDGE, 12" O.C. FIELD.
- NAILING APPLIES TO ALL STUDS, TOP AND BOTTOM PLATES, AND BLOCKING. PLYWOOD JOINT AND SILL PLATE NAILING SHALL BE STAGGERED
- ANCHOR BOLT SPACING IS 6'-0" O.C. (4'-0" AT BUILDINGS OVER 2 STORIES) UNLESS NOTED OTHERWISE IN SCHEDULE. MINIMUM OF 2 ANCHOR BOLTS PER PIECE OF FOUNDATION PLATE. ANCHOR BOLTS SPACED NO GREATER THAN 12" AND NO LESS THAN 1 TIME THE ANCHOR BOLT DIAMETER AT ENDS AND SPACES. PROVIDE 0.229"x3"x3" WASHERS AT ANCHOR BOLTS. PLATE WASHERS SHALL EXTEND TO WITHIN 1/2" OF THE SHEATHED EDGE OF THE SILL PLATE ON WALLS W/ EDGE NAILING AT 4" O.C. OR TIGHTER. DO NOT RECESS BOLTS.
- ALL NAILS FOR SHEAR WALLS SHALL BE COMMON OR GALVANIZED BOX NAILS (UNO.) ALL SPECIFIED NAILS SHALL HAVE THE FOLLOWING DIMENSIONS: 8d COMMON (0.131" DIA, 2 1/2" LONG); 8d BOX (0.131" DIA, 2 1/2" LONG); 10d COMMON (0.148" DIA, 3" LONG); 10d BOX (0.148" DIA, 3" LONG); 16d COMMON (0.162" DIA, 3 1/2" LONG); 16d SINKER (0.148" DIA, 3 1/4" LONG); 5d COOLER (0.086" DIA, 1 5/8" LONG); 6d COOLER (0.092" DIA, 1 7/8" LONG)
- 1 1/4" No. 6 DRYWALL SCREWS (TYPE W OR S) MAY BE SUBSTITUTED FOR NAILS LISTED AS 5d COOLER OR 6d COOLER FOR GYPSUM WALL BOARD SHEARWALLS
- IN LIEU OF 3x VERTICALS AND BLOCKING AT PANEL EDGES, 2-2x8 W/ 10d (0.131"x3") FACE NAILS STAGGERED AT THE SAME SPACING AS PANEL EDGE NAILING MAY BE SUBSTITUTED. PLYWOOD EDGES TO BE CENTERED BETWEEN THE 2-2x MEMBERS (THIS ALTERNATIVE DOES NOT APPLY TO FOUNDATION SILL PLATES OR TO WALLS WITH 8d EDGE NAILING AT 2" O.C. OR 10d EDGE NAILING AT 3" O.C. OR 2" O.C. OR WALLS SHEATHED ON BOTH SIDES)
- HOLDDOWNS AND STRAPS OF EQUIVALENT UPLIFT CAPACITY WITH CURRENT ICC EVALUATION REPORT OR SIMILAR MAY BE SUBSTITUTED FOR THOSE LISTED IN THE SHEARWALL SCHEDULE WITH PRIOR APPROVAL OF BUILDING OFFICIAL OR ENGINEER OF RECORD.
- SQUASH BLOCKS IN FLOOR JOIST CAVITY ARE REQUIRED AT ENDS OF SHEAR WALLS WHERE FULL BEARING IS NOT PROVIDED BY THE FRAMING BELOW.
- SIMPSON MASAP MUDSILL ANCHORS, MAY BE SUBSTITUTED (1) FOR (1) AT 2X SILL PLATES FOR THE 3/8" DIA. SILL PLATE ANCHOR BOLTS SPECIFIED.


ALL CRIPPLE WALLS SHALL BE FRAMED & SHEATHED AS PER "PI-4" SHEAR WALL

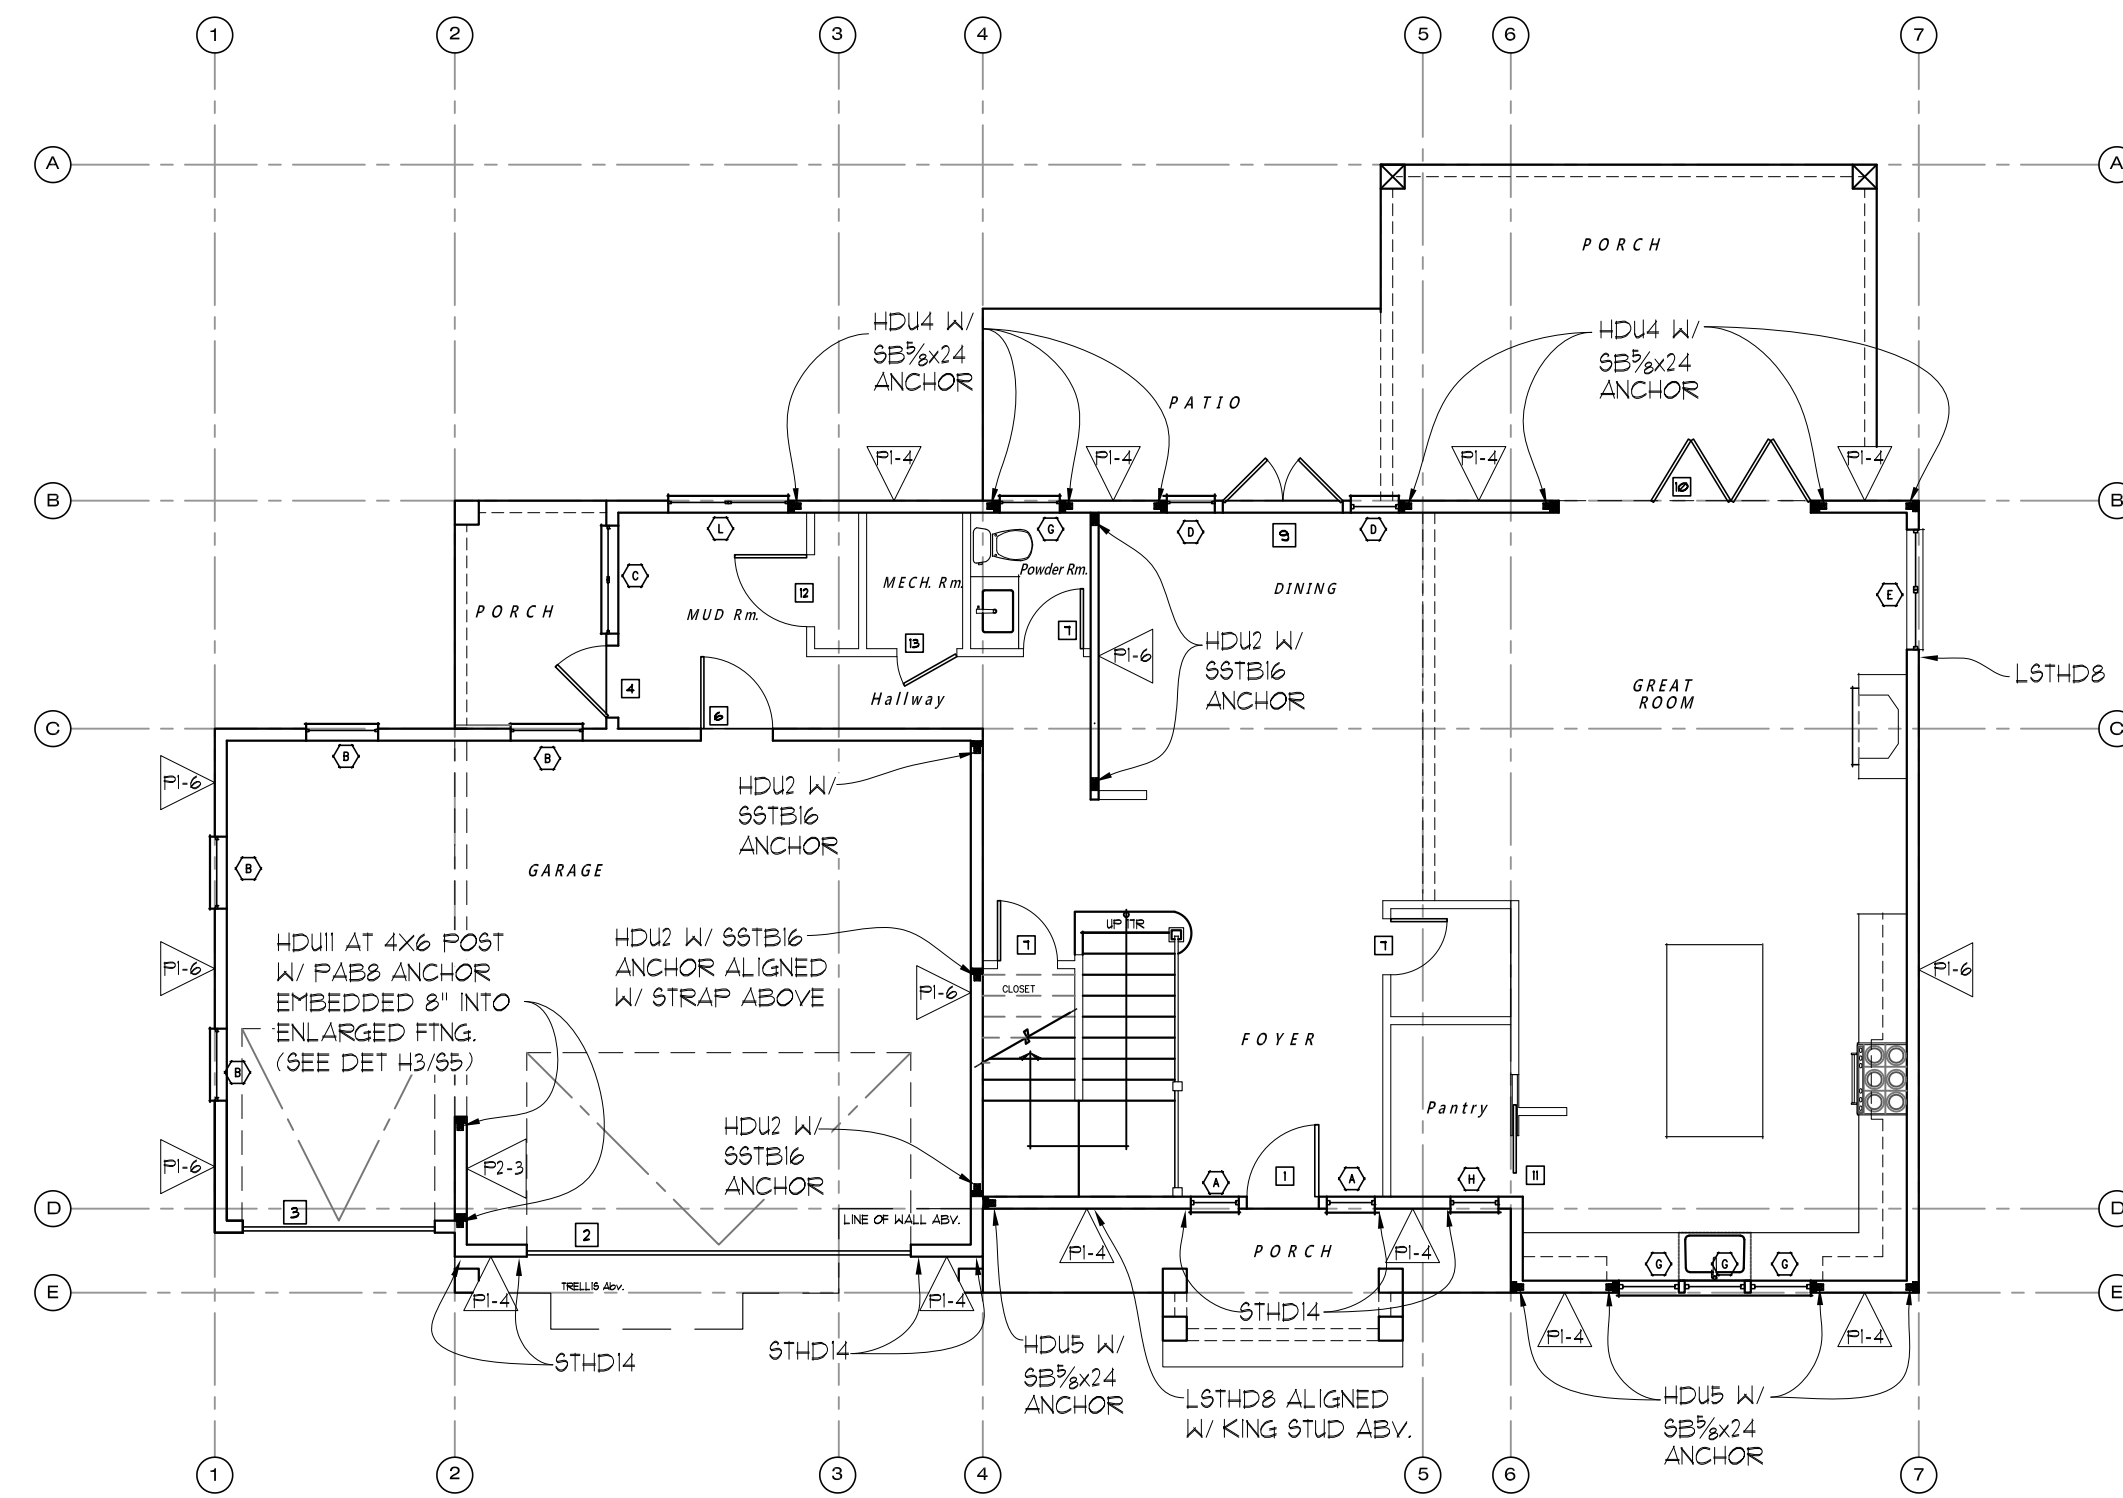

MAIN FLOOR SHEAR WALL KEY PLAN

SCALE: 1/8"=1'-0"

SEE SHEET S5 FOR TYPICAL INSTALLATION DETAILS FOR STRAPS & FOUNDATION ANCHORS



STRUCTURAL PLANS

RKK CONSTRUCTION
 9026 SE 61st STREET
 MERCER ISLAND, WA

Myers Engineering, LLC
 3206 50th Street Ct NW, Ste. 210-B
 Gig Harbor, WA 98335
 PH: 253-858-3248
 Email: myengineer@centurytel.net



Digitally signed by Mark Myers, PE
 Date: 2022.02.15 12:40:26 -0800

BUILDING DEPT. APPROVAL STAMPS:

REVISION:	INITI:	DATE:
PLAN REVIEW	MM	2-15-2022

S1

DATE: 10-2-2021
 INIT: MM
 PROJECT #: 2394

STRUCTURAL PLANS

RKK CONSTRUCTION
 9026 SE 61st STREET
 MERCER ISLAND, WA

Myers Engineering, LLC
 3206 50th Street Ct NW, Ste. 210-B
 Gig Harbor, WA 98335
 PH: 253-858-3248
 Email: myengineer@centurytel.net




Digitally signed by Mark Myers, PE
 Date: 2022.02.15 12:40:04 -08'00'

BUILDING DEPT. APPROVAL STAMPS:

REVISION:	INITI:	DATE:
PLAN REVIEW	MM	2-15-2022

S2	DATE:	10-2-2021
	INITI:	MM
PROJECT #:		2394

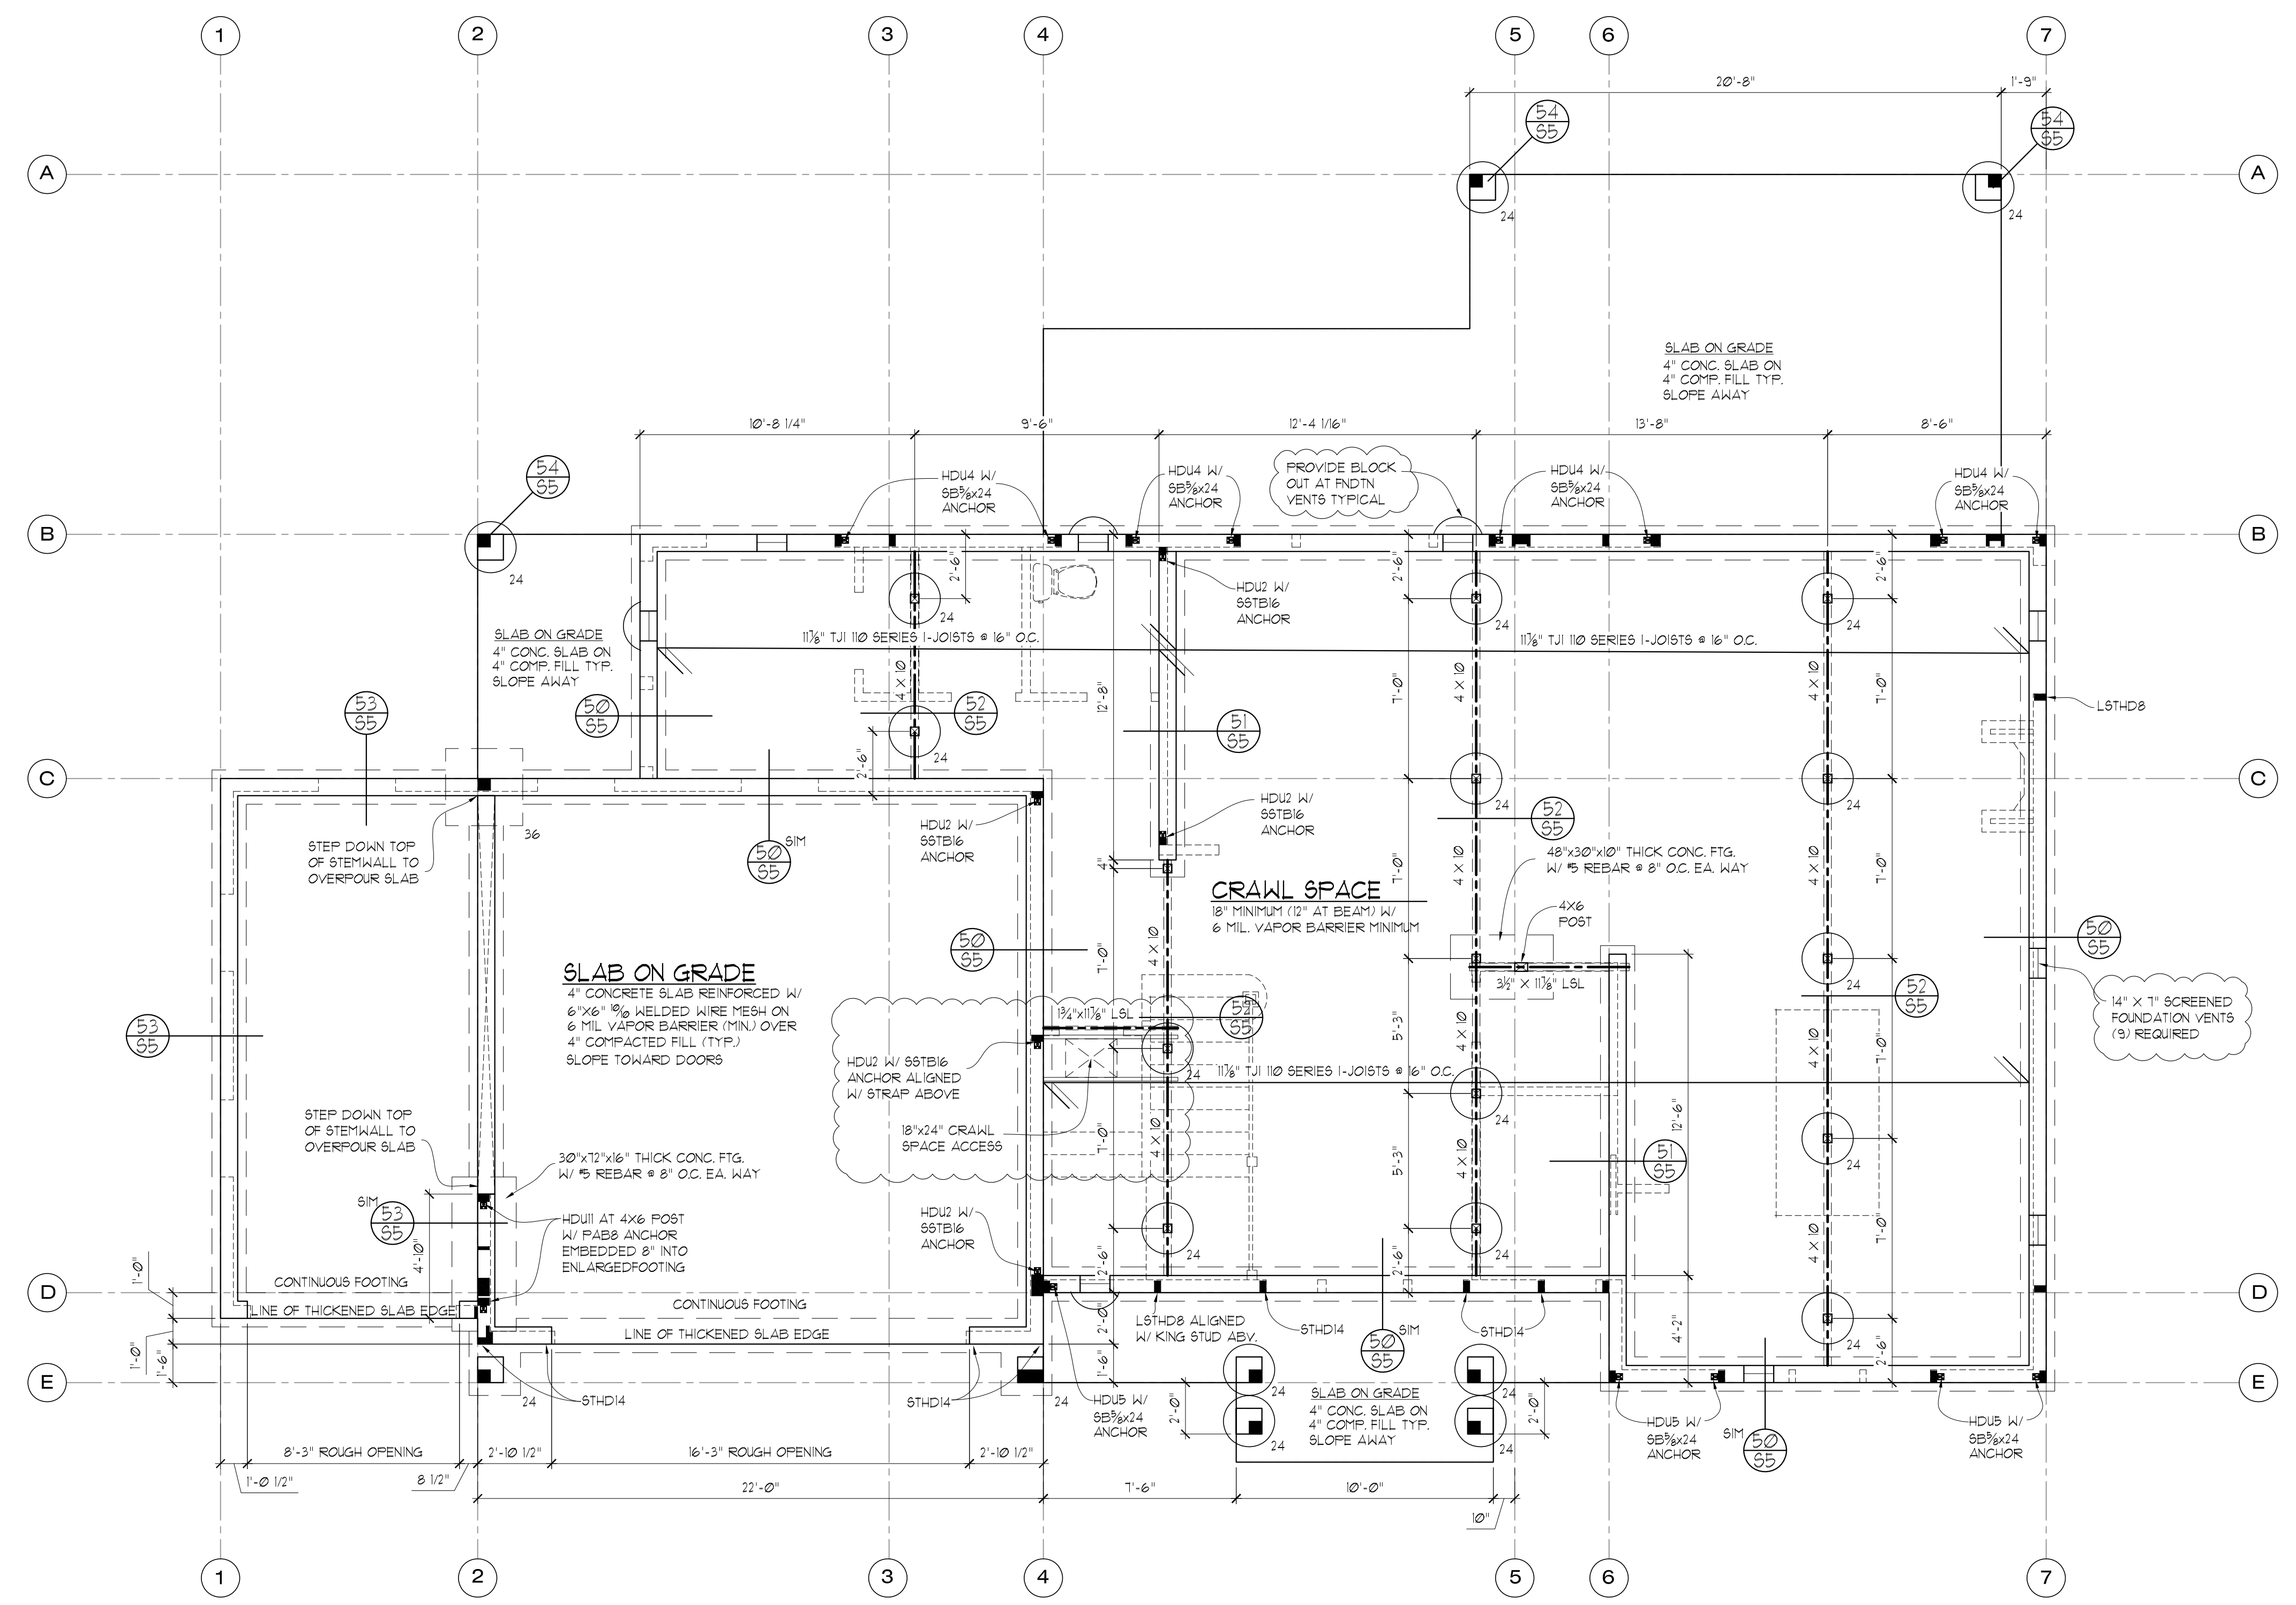

SEE SHEET S5 FOR TYPICAL INSTALLATION DETAILS FOR STRAPS & FOUNDATION ANCHORS

FOUNDATION/FLOOR FRAMING PLAN

SCALE: 1/4" = 1'-0"



- ALL WOOD IN CONTACT WITH CONCRETE TO BE PRESSURE TREATED
- SOFFIT, VENT, AND INSULATE ALL CANTILEVERED AREAS
- PROVIDE SOLID BLOCKING OVER SUPPORTS
- ALL FOOTINGS TO REST ON UNDISTURBED SOIL
- PROVIDE COPY OF CONCRETE "BATCH TICKET" ON SITE FOR REVIEW BY BUILDING OFFICIAL
- PROVIDE SOLID FRAMING EQUAL TO THE WIDTH OF THE MEMBER BEING SUPPORTED (U.N.O.)
- PROVIDE SUPPLEMENTAL BLOCKING IN FLOOR CAVITY BELOW SUPPORT POSTS FOR GIRDERS, BEAMS, AND END POSTS FOR SHEAR WALLS TO MATCH FULL WIDTH OF POSTS IN WALL ABV. W/ GRAIN ORIENTED VERTICALLY

FOOTING SCHEDULE

NOTE: USE MIN. 6" WIDE POST BELOW BEAM SPLICES
 USE P.T. 4 X 4 POSTS BELOW 4 X BEAMS U.N.O.
 USE P.T. 6 X 6 POST BELOW 6 X BEAMS U.N.O.


24	P.T. POST ON 24" DIA. X 10" THICK PLAIN CONC. FOOTING
24	P.T. POST ON 24" X 24" X 10" THICK CONC. FOOTING W/ 2- # 4 BARS EACH WAY
30	P.T. POST ON 30" X 30" X 12" THICK CONC. FOOTING W/ 3- # 5 BARS EACH WAY
36	P.T. POST ON 36" X 36" X 12" THICK CONC. FOOTING W/ 3- # 5 BARS EACH WAY
42	P.T. POST ON 42" X 42" X 12" THICK CONC. FOOTING W/ 4- # 5 BARS EACH WAY

FOOTING SIZES BASED ON 1500 PSF SOIL BEARING CAPACITY

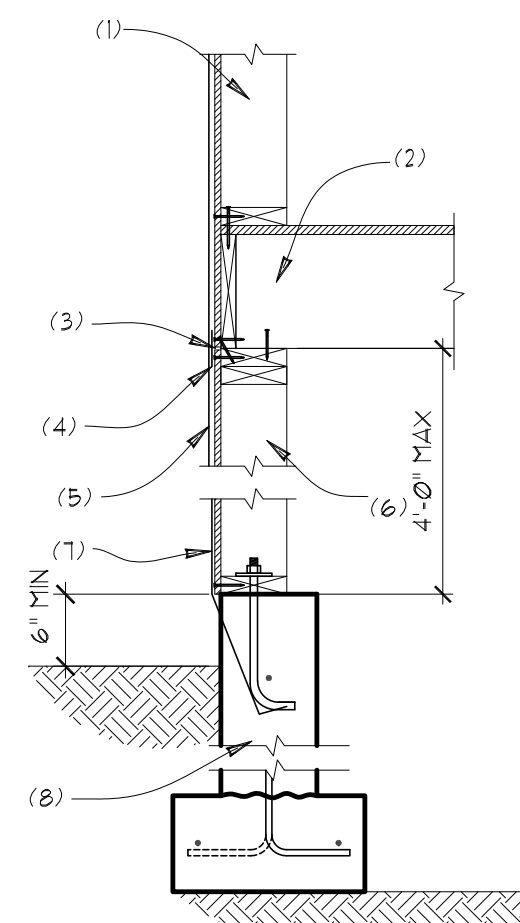

A1 CRIPPLE WALL FOR SLOPED LOTS
 SCALE: 3/4" = 1'

1. STUD WALL FRAMING PER PLAN
2. FLOOR JOISTS & RIM JOIST PER PLAN
3. WALL SHEATHING PANEL EDGE W/ EDGE NAILING PER SHEAR WALL SCHEDULE
4. SIMPSON LTP4 @ 48" O.C.
5. EXTEND 5THD STYLE ANCHOR STRAPS WITH OVERLAPPED CM9TC6 COILED STRAP TO GET FULL NAILING AT WALL FRAMING ABOVE (BOLT STYLE HOLD-DOWNS TO BE EXTENDED TO WALL ABOVE W/ COUPLER NUT AND ALL THREAD ROD)
6. 2x6 CRIPPLE WALL W/ STUDS @ 16" O.C. SHEATHED & NAILED PER WALL ABOVE W/ 4" O.C. @ COMMON EDGE NAILING MINIMUM
7. HOLD-DOWN PER PLAN
8. STEM WALL & FOOTING PER PLAN

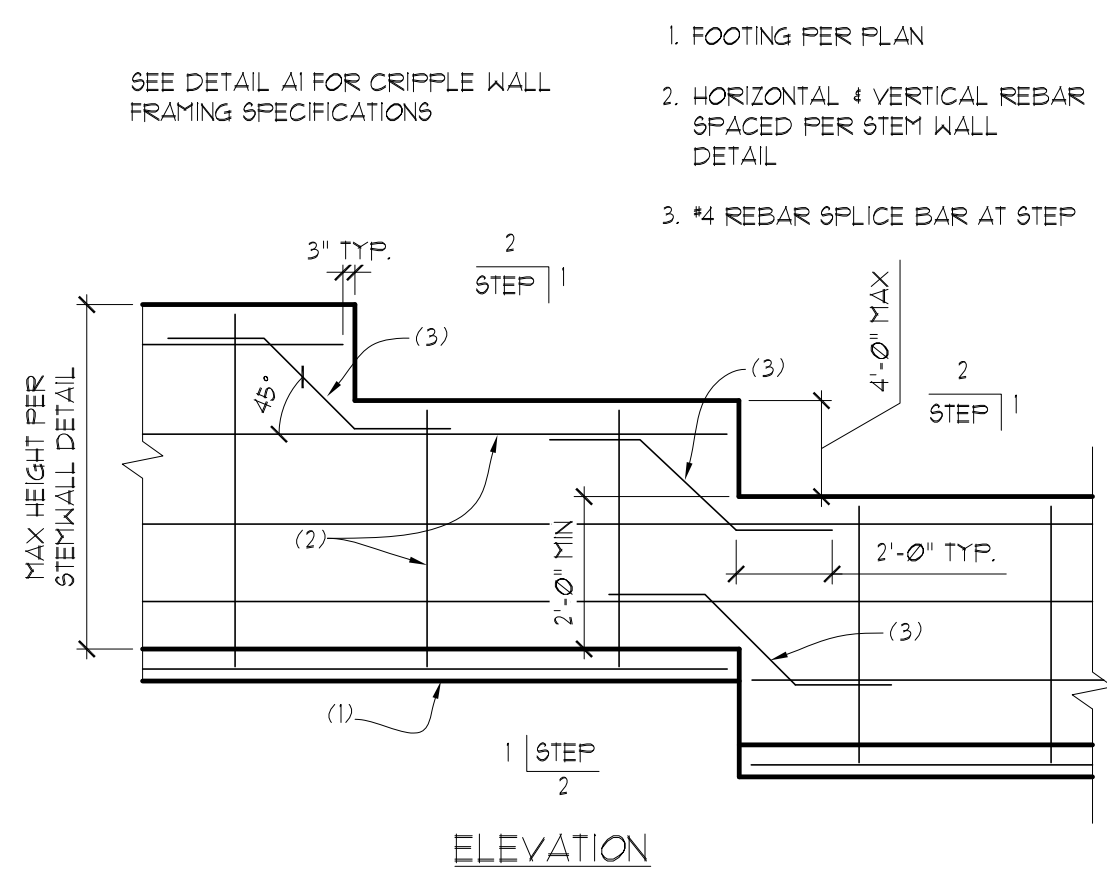

A2 STEPPED FOOTING AT SLOPED LOT
 SCALE: NTS

CRAWL SPACE VENTILATION	
CRAWL AREA	= NET VENT AREA REQ'D (N.V.A.) (ASSUMES CROSS VENTILATION)
1296	= 4.32 SQ. FT. N.V.A. REQUIRED
300	
USE 14" X 7" SCREENED FOUNDATION VENTS	
(1) VENT = 0.52 SQ. FT. NET FREE VENT AREA	
N.V.A.	= QTY. OF VENTS REQUIRED
4.32	= 8.31 (9) 14"X7" VENTS REQUIRED
0.52	

STRUCTURAL PLANS

RKK CONSTRUCTION
9026 SE 61st STREET
MERCER ISLAND, WA

Myers Engineering, LLC
3206 50th Street Ct NW, Ste. 210-B
Gig Harbor, WA 98335
PH: 253-858-3248
Email: myengineer@centurytel.net





Digitally signed by
Mark Myers, PE
Date: 2022.02.15
12:39:25 -0800

BUILDING DEPT. APPROVAL STAMPS:

REVISION:	INITI:	DATE:
PLAN REVIEW	MM	2-15-2022

S4	DATE:	10-2-2021
	INITI:	MM
PROJECT #:	2394	

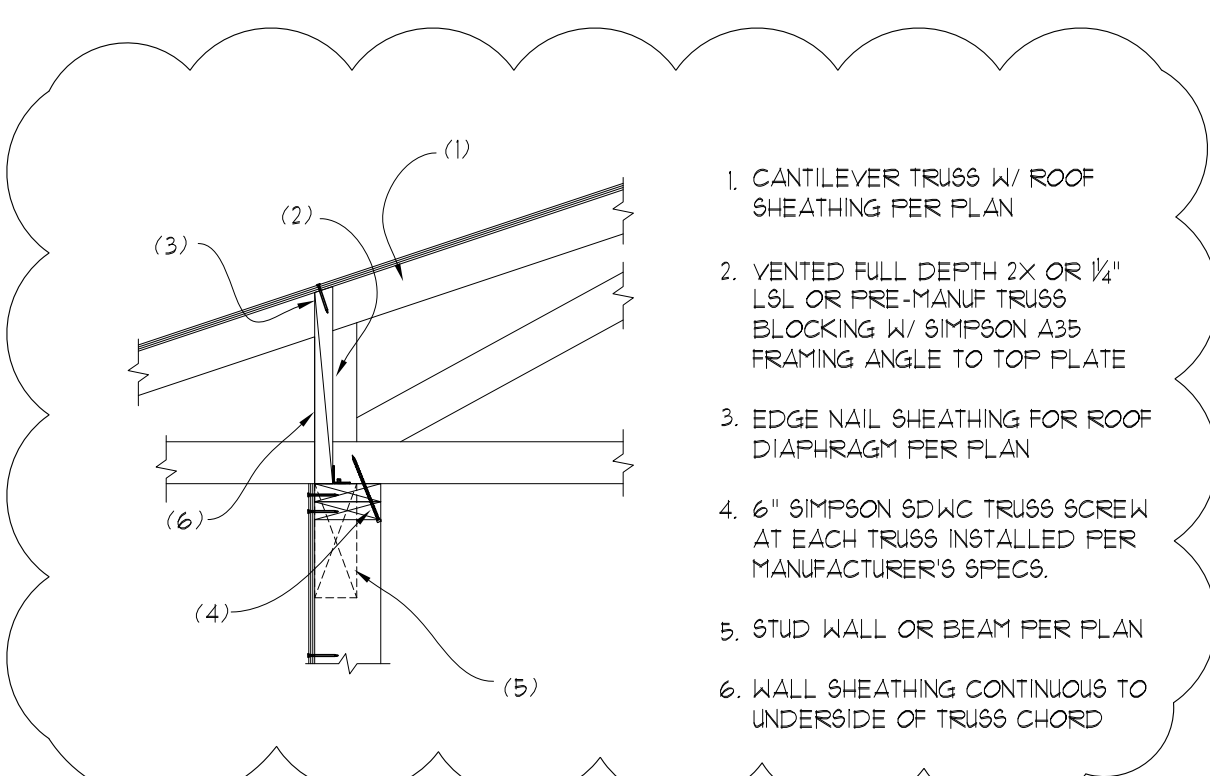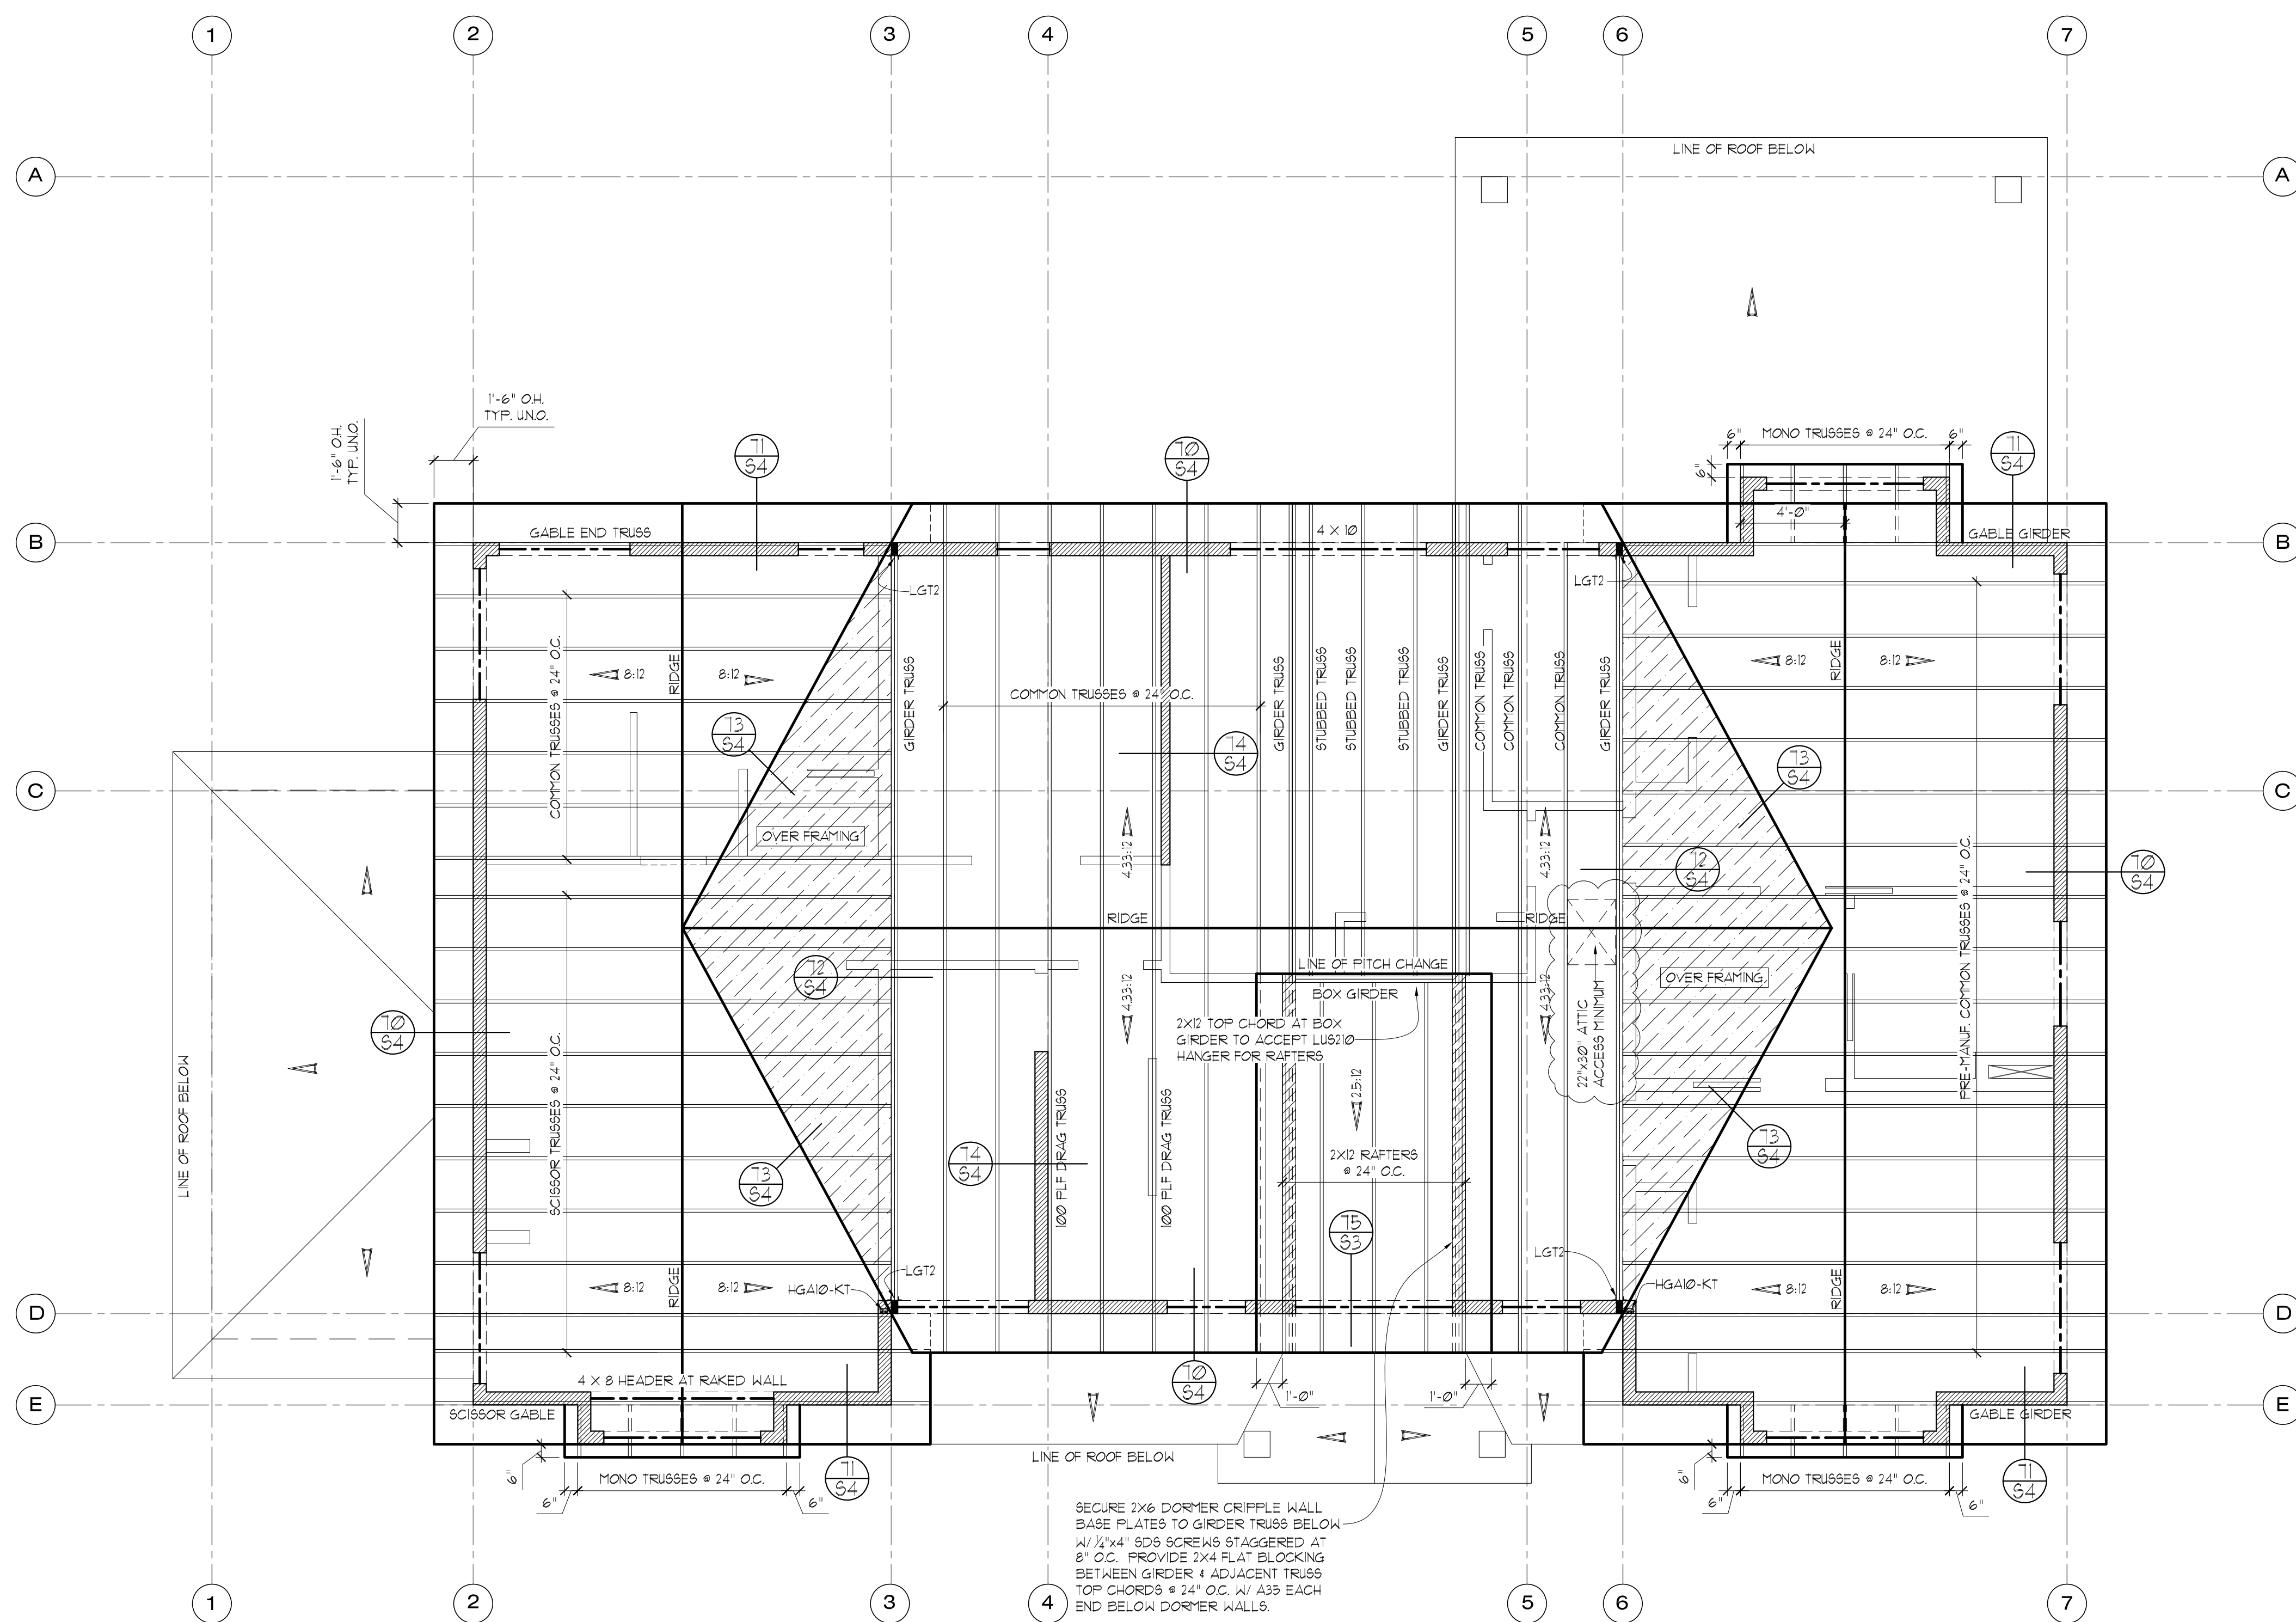

10 CANTILEVER HEEL OPTION AT BEARING
SCALE: 3/4"=1"

1. CANTILEVER TRUSS W/ ROOF SHEATHING PER PLAN
 2. VENTED FULL DEPTH 2x OR 1/4" LSL OR PRE-MANUF TRUSS BLOCKING W/ SIMPSON A35 FRAMING ANGLE TO TOP PLATE
 3. EDGE NAIL SHEATHING FOR ROOF DIAPHRAGM PER PLAN
 4. 6" SIMPSON SD14C TRUSS SCREW AT EACH TRUSS INSTALLED PER MANUFACTURER'S SPECS.
 5. STUD WALL OR BEAM PER PLAN
 6. WALL SHEATHING CONTINUOUS TO UNDERSIDE OF TRUSS CHORD
1. 2x4 OUTRIGGER @ 48" O.C. W/ FASCIA BOARD (1X MIN) SECURED TO ENDS W/ (2) 10d NAILS
 2. ROOF SHEATHING W/ DIAPHRAGM EDGE NAILING TO GABLE TRUSS
 3. SHEATHING SPLICE AT TOP PLATE OF WALL FULLY SHEATH GABLE END TRUSS W/ EXTERIOR WALL SHEATHING PER PLAN W/ EDGE NAILING AT TOP & BOTTOM CHORD
 4. 2x DIAGONAL BRACE @ 8FT O.C.
 5. SECURE BRACE AT 2x BLOCKING W/ (3) 10d NAILS
 6. SIMPSON A34 AT 2x BRACE
1. ATTACH GABLE TRUSS TO BACKER BOARD W/ 10d NAILS @ 6" O.C.
 - 2x6 CONTINUOUS BACKER BOARD SECURED TO TOP PLATE W/ 10d NAILS @ 6" O.C.
 3. GABLE END TRUSS W/ VERTS. @ 24" O.C. 4 TOP CHORD DESIGNED TO BE NOTCHED FOR OUTLOOKERS.
 4. ROOF TRUSSES @ 24" O.C. PER PLAN

11 GABLE END TRUSS
SCALE: 3/4"=1"

1. GIRDER TRUSS PER PLAN
2. VALLEY TRUSSES OR CONVENTIONAL OVER FRAMING WHERE VALLEY TRUSSES ARE USED SECURE VALLEY TRUSS TO SUPPORTING ROOF FRAMING W/ SIMPSON VTR CLIPS @ 48" O.C.
3. ROOF SHEATHING CONTINUOUS BELOW OVERFRAMING. TRUSS TOP CHORDS W/O SHEATHING SHALL BE BRACED W/ 2x4 @ 24" O.C. ATTACHED W/ (2) 10d NAILS PER TRUSS
4. ROOF TRUSS PER PLAN
5. SIMPSON HUS26 OR USP THD26 FACE MOUNT HANGER UNO. PER TRUSS MANUF.

12 GIRDER TRUSS AT OVERFRAMING
SCALE: 3/4"=1"

1. ROOF SHEATHING PER PLAN
 2. EDGE NAILING WHERE APPLIES
 3. ROOF TRUSSES PER PLAN
 4. 2x6 FLAT BLOCKING @ 12" O.C.
 5. SIMPSON A35 AT EACH BLOCK
 6. SIMPSON A35 @ 12" O.C.
 7. INTERIOR SHEAR WALL PER PLAN
1. CONVENTIONAL 2x OVER FRAMING @ 24" O.C. W/ (4) 16d TOE NAILS TO VALLEY PLATE (SEE BELOW FOR RECOMMENDED SIZES BASED ON SPAN)
 2. EDGE NAILING
 3. 2x VALLEY BOARD TO MATCH RAFTER W/ (2) 16d NAILS PER TRUSS
 4. ROOF TRUSS TOP CHORD OR RAFTER PER PLAN
 5. CONTINUOUS SHEATHING BENEATH OVERFRAMING OR 2x4 BRACING @ 24" O.C. W/ 2-16d NAILS PER TRUSS.

FOR RAFTER SPANS BELOW USE THE FOLLOWING SIZES:



0'-0" TO 6'-11"	2x4
6'-8" TO 9'-11"	2x6
9'-8" TO 12'-2"	2x8
12'-3" TO 14'-10"	2x10
14'-11" TO 17'-3"	2x12

(ASSUMES RAFTERS @ 24" O.C. LL+30PSF 4 CL+10PSF PER TABLE R802.3.1.3) FOR HF (2)

ROOF FRAMING PLAN


SCALE: 1/4" = 1'-0"

- PROVIDE VENTED BLOCKING AT REQUIRED TRUSS/RAFTER BAYS
- ALL MANUFACTURED TRUSSES:
 - * SHALL HAVE DESIGN DETAILS AND DRAWINGS ON SITE FOR FRAMING INSPECTION
 - * SHALL NOT BE FIELD ALTERED WITHOUT ENGINEER'S APPROVAL
 - * SHALL BE INSTALLED AND BRACED TO MANUFACTURER'S SPECIFICATION
 - * SHALL CARRY MANUFACTURER'S STAMP ON EACH TRUSS
- ALL BEAMS AND HEADERS AT THIS LEVEL TO BE 4x8 OF #2 AT BEARING WALLS, U.N.O., 6'-0" MAX. SPAN
- HEADERS 8FT OR LONGER SHALL BE PROVIDED W/ (2) TRIMMER (JACK) STUDS AT EACH END U.N.O.
- PROVIDE SOLID FRAMING EQUAL TO THE WIDTH OF THE MEMBER BEING SUPPORTED (U.N.O.)
- PROVIDE SUPPLEMENTAL BLOCKING IN FLOOR CAVITY BELOW SUPPORT POSTS FOR GIRDERS, BEAMS, AND END POSTS FOR SHEAR WALLS TO MATCH FULL WIDTH OF POSTS IN WALL ABV. W/ GRAIN ORIENTED VERTICALLY AND PROVIDE MATCHING POSTS IN WALL BELOW UNLESS LARGER POSTS ARE SPECIFIED ON PLAN

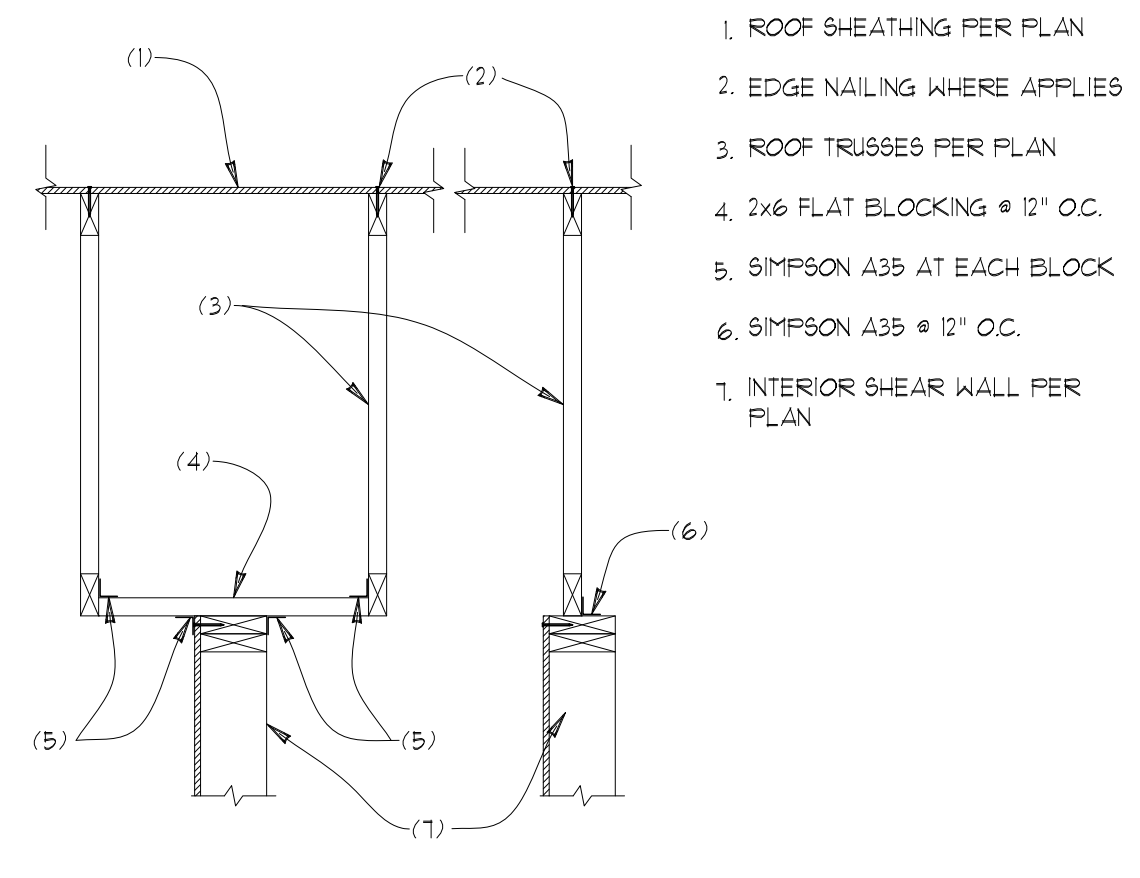

14 ROOF SHEAR TRANSFER @ INT. WALL
SCALE: 3/4"=1"


13 VALLEY FRAMING
SCALE: 3/4"=1"

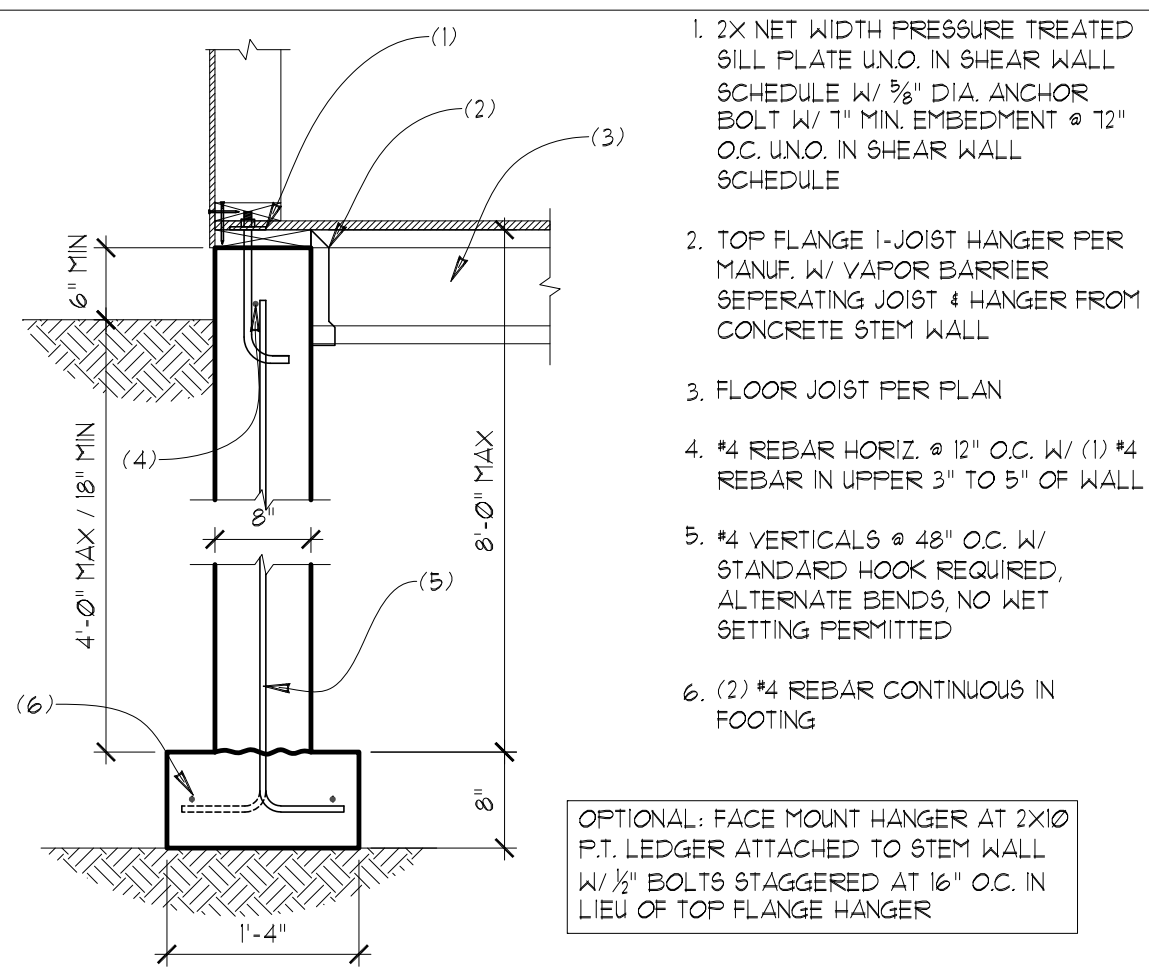

- 2x NET WIDTH PRESSURE TREATED SILL PLATE UNO. IN SHEAR WALL SCHEDULE W/ 3/8" DIA. ANCHOR BOLT W/ 1" MIN. EMBEDMENT @ 12" O.C. UNO. IN SHEAR WALL SCHEDULE
- TOP FLANGE I-JOIST HANGER PER MANUF. W/ VAPOR BARRIER SEPERATING JOIST & HANGER FROM CONCRETE STEM WALL
- FLOOR JOIST PER PLAN
- #4 REBAR HORIZ. @ 12" O.C. W/ (1) #4 REBAR IN UPPER 3" TO 5" OF WALL
- #4 VERTICALS @ 48" O.C. W/ STANDARD HOOK REQUIRED, ALTERNATE BENDS, NO WET SETTING PERMITTED
- (2) #4 REBAR CONTINUOUS IN FOOTING


OPTIONAL: FACE MOUNT HANGER AT 2X10 P.T. LEDGER ATTACHED TO STEM WALL W/ 3/8" BOLTS STAGGERED AT 16" O.C. IN LIEU OF TOP FLANGE HANGER

50 8" STEM WALL AT DROPPED JOISTS
SCALE: 3/4"=1"

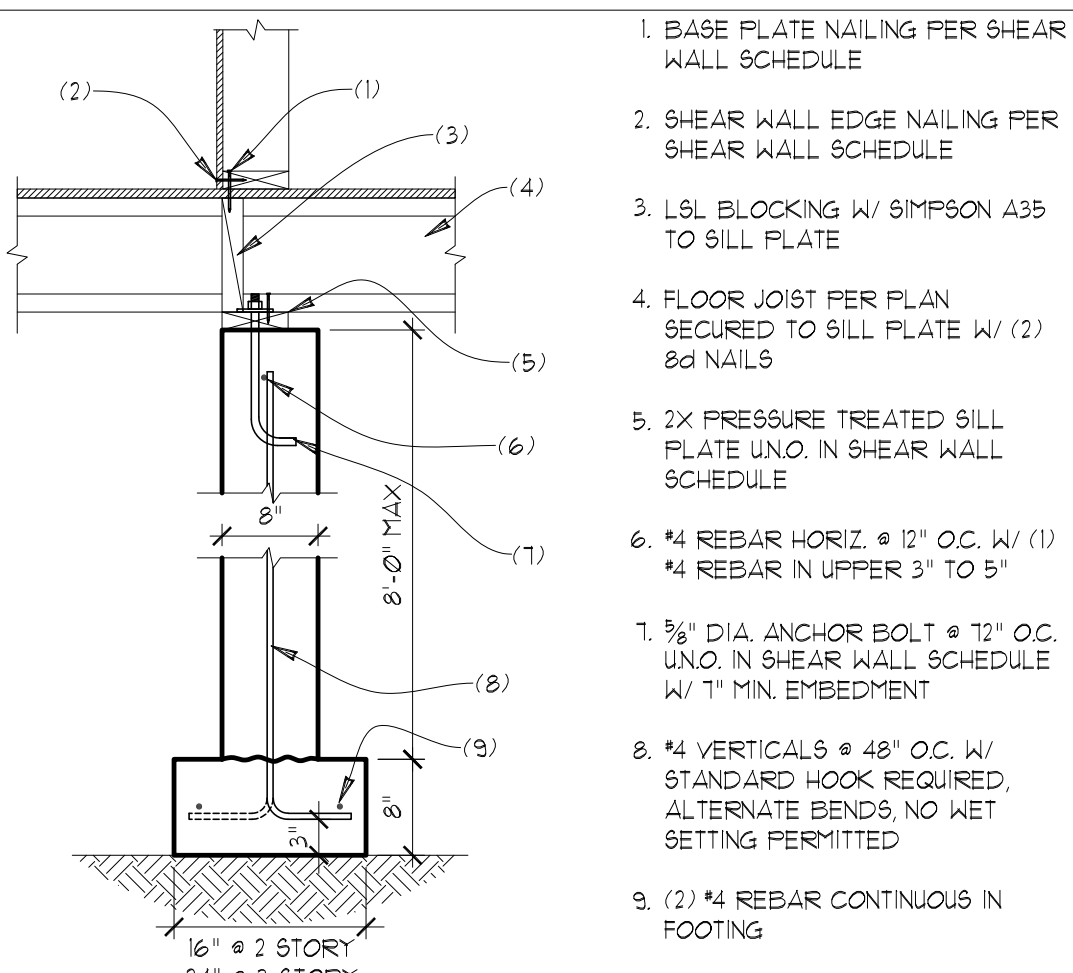


- BASE PLATE NAILING PER SHEAR WALL SCHEDULE
- SHEAR WALL EDGE NAILING PER SHEAR WALL SCHEDULE
- LSL BLOCKING W/ SIMPSON A35 TO SILL PLATE
- FLOOR JOIST PER PLAN SECURED TO SILL PLATE W/ (2) #4 NAILS
- 2x PRESSURE TREATED SILL PLATE UNO. IN SHEAR WALL SCHEDULE
- #4 REBAR HORIZ. @ 12" O.C. W/ (1) #4 REBAR IN UPPER 3" TO 5"
- 3/8" DIA. ANCHOR BOLT @ 12" O.C. UNO. IN SHEAR WALL SCHEDULE W/ 1" MIN. EMBEDMENT
- #4 VERTICALS @ 48" O.C. W/ STANDARD HOOK REQUIRED, ALTERNATE BENDS, NO WET SETTING PERMITTED
- (2) #4 REBAR CONTINUOUS IN FOOTING

51 8" INTERIOR STEM WALL
SCALE: 3/4"=1"

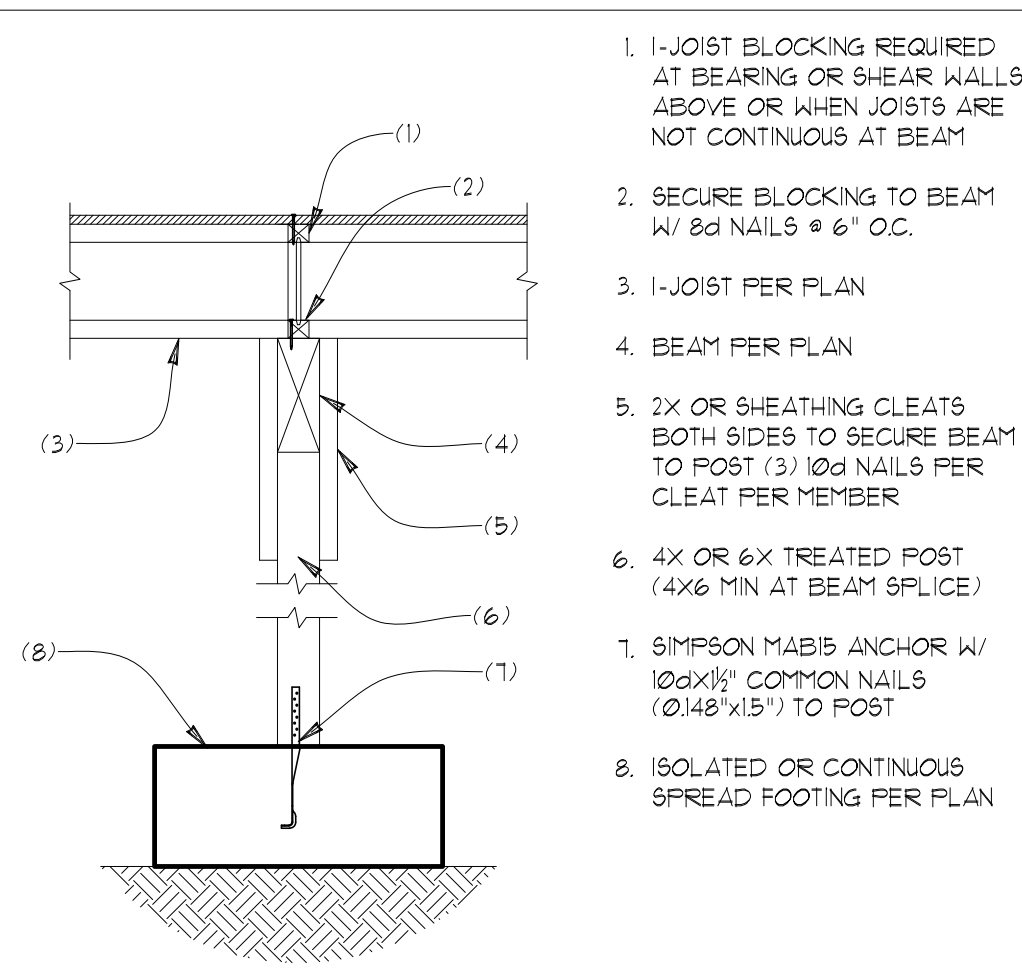


- I-JOIST BLOCKING REQUIRED AT BEARING OR SHEAR WALLS ABOVE OR WHEN JOISTS ARE NOT CONTINUOUS AT BEAM
- SECURE BLOCKING TO BEAM W/ #4 NAILS @ 6" O.C.
- I-JOIST PER PLAN
- BEAM PER PLAN
- 2x OR SHEATHING CLEATS BOTH SIDES TO SECURE BEAM TO POST (3) 10d NAILS PER CLEAT PER MEMBER
- 4x OR 6x TREATED POST (4x6 MIN AT BEAM SPLICE)
- SIMPSON MAB18 ANCHOR W/ 10dX1 1/2" COMMON NAILS (0.148"x3.5") TO POST
- ISOLATED OR CONTINUOUS SPREAD FOOTING PER PLAN

52 INTERIOR FOOTING @ BEAM LINE
SCALE: 3/4"=1"

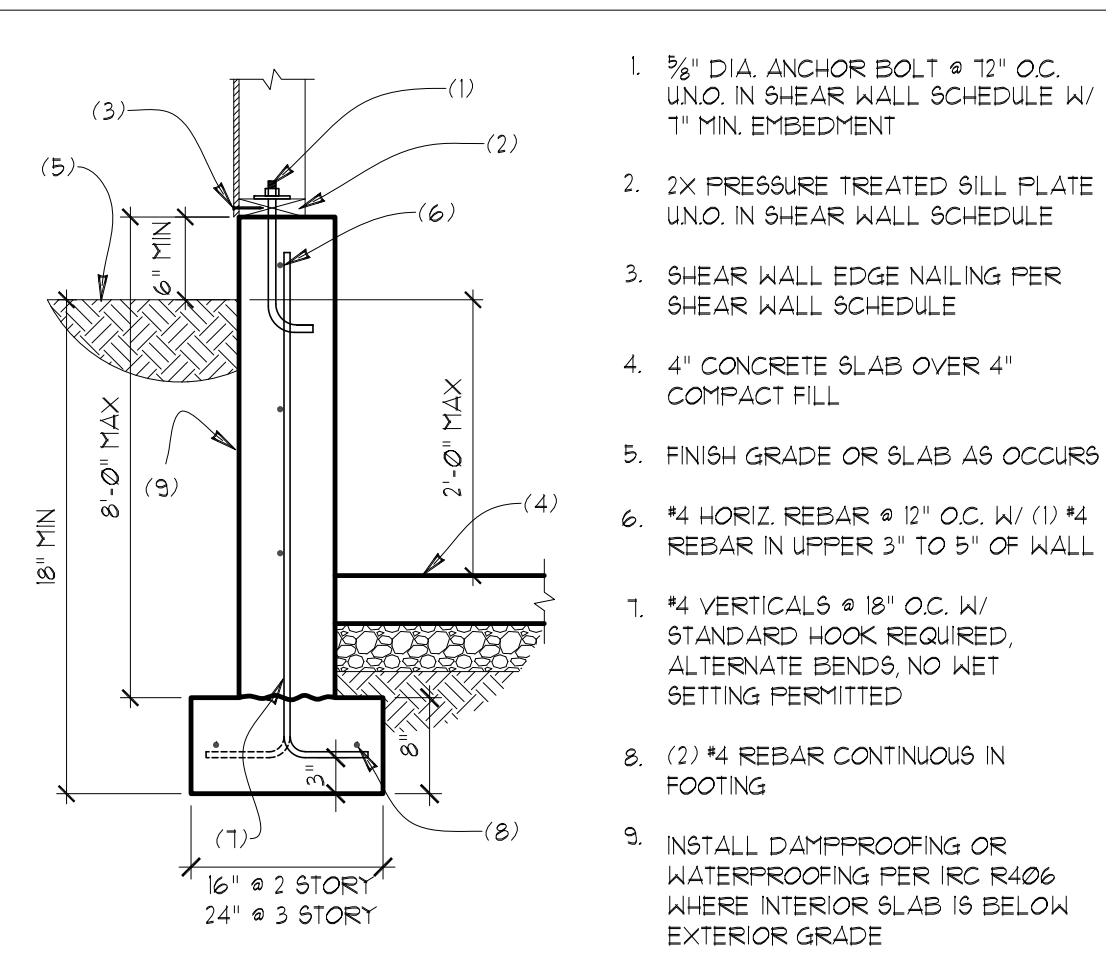


- 3/8" DIA. ANCHOR BOLT @ 12" O.C. UNO. IN SHEAR WALL SCHEDULE W/ 1" MIN. EMBEDMENT
- 2x PRESSURE TREATED SILL PLATE UNO. IN SHEAR WALL SCHEDULE
- SHEAR WALL EDGE NAILING PER SHEAR WALL SCHEDULE
- 4" CONCRETE SLAB OVER 4" COMPACT FILL
- FINISH GRADE OR SLAB AS OCCURS
- #4 HORIZ. REBAR @ 12" O.C. W/ (1) #4 REBAR IN UPPER 3" TO 5" OF WALL
- #4 VERTICALS @ 18" O.C. W/ STANDARD HOOK REQUIRED, ALTERNATE BENDS, NO WET SETTING PERMITTED
- (2) #4 REBAR CONTINUOUS IN FOOTING
- INSTALL DAMPPROOFING OR WATERPROOFING PER IRC R406 WHERE INTERIOR SLAB IS BELOW EXTERIOR GRADE

53 8" STEM WALL AT SLAB ON GRADE
SCALE: 3/4"=1"

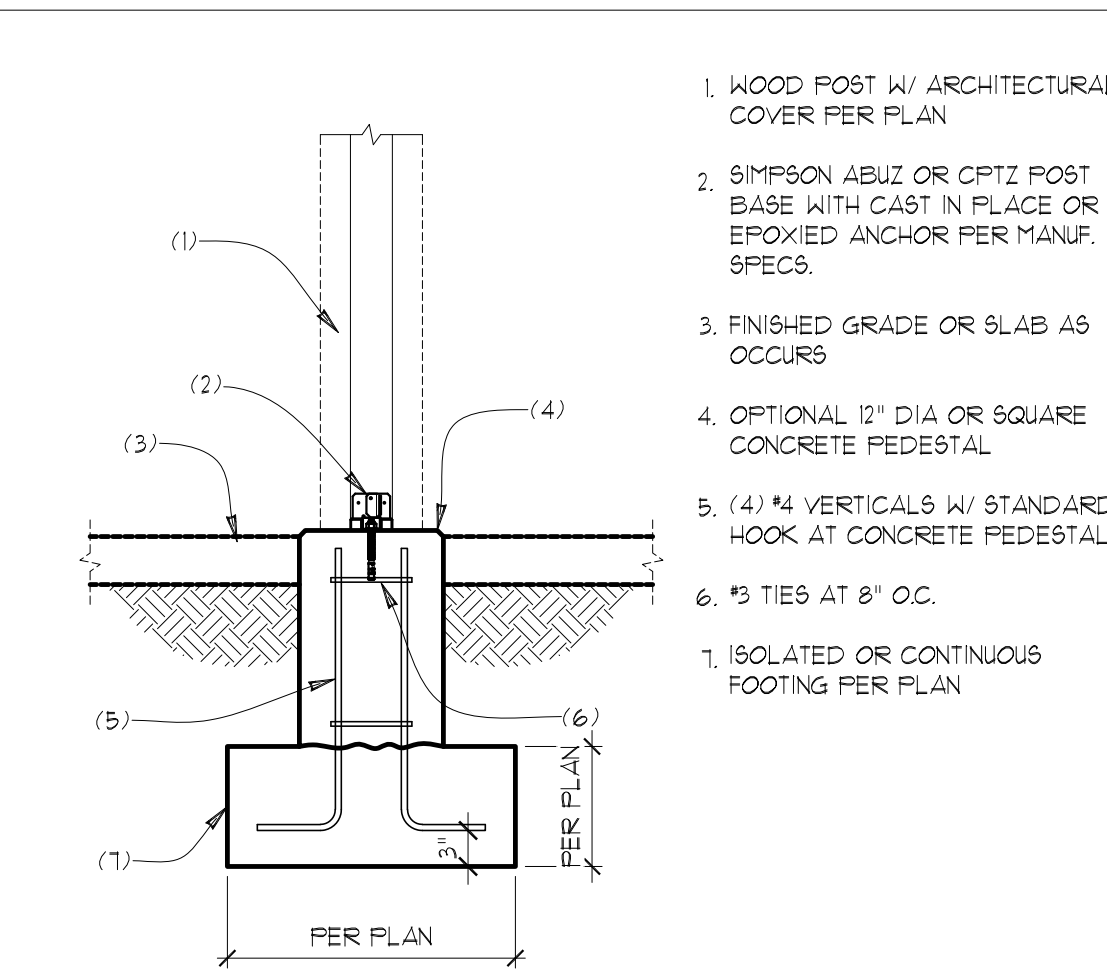

- WOOD POST W/ ARCHITECTURAL COVER PER PLAN
- SIMPSON ABUZ OR CPTZ POST BASE WITH CAST IN PLACE OR EPOXIED ANCHOR PER MANUF. SPECS.
- FINISHED GRADE OR SLAB AS OCCURS
- OPTIONAL 1 1/2" DIA OR SQUARE CONCRETE PEDESTAL
- (4) #4 VERTICALS W/ STANDARD HOOK AT CONCRETE PEDESTAL
- #3 TIES AT 8" O.C.
- ISOLATED OR CONTINUOUS FOOTING PER PLAN


54 FOOTING AT WOOD COLUMN
SCALE: 3/4"=1"

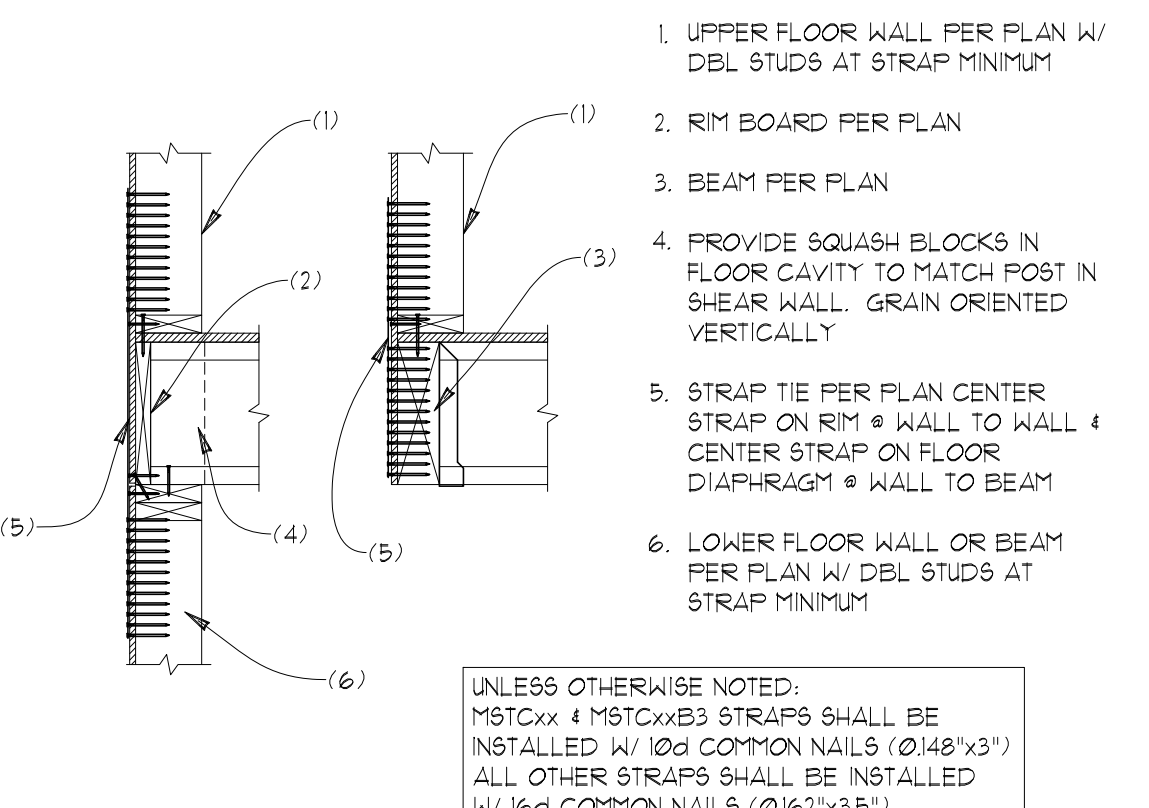

- UPPER FLOOR WALL PER PLAN W/ DBL STUDS AT STRAP MINIMUM
- RIM BOARD PER PLAN
- BEAM PER PLAN
- PROVIDE SQUASH BLOCKS IN FLOOR CAVITY TO MATCH POST IN SHEAR WALL. GRAIN ORIENTED VERTICALLY
- STRAP TIE PER PLAN CENTER STRAP ON RIM @ WALL TO WALL & CENTER STRAP ON FLOOR DIAPHRAGM @ WALL TO BEAM
- LOWER FLOOR WALL OR BEAM PER PLAN W/ DBL STUDS AT STRAP MINIMUM

UNLESS OTHERWISE NOTED: #130x4 #130x4.5 STRAPS SHALL BE INSTALLED W/ 10d COMMON NAILS (0.148"x3.5") ALL OTHER STRAPS SHALL BE INSTALLED W/ 16d COMMON NAILS (0.162"x3.5")


H1 TYPICAL STRAP TIE @ UPPER FLOORS
SCALE: 3/4"=1"

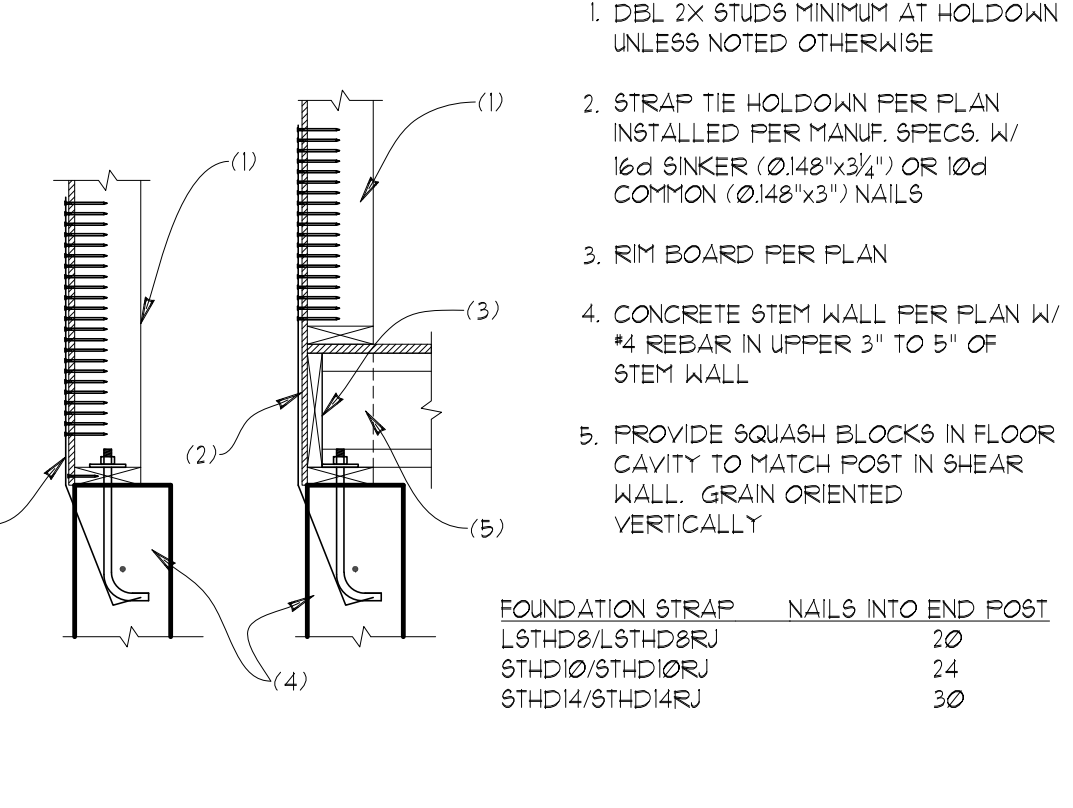

- DBL 2x STUDS MINIMUM AT HOLDOWN UNLESS NOTED OTHERWISE
- STRAP TIE HOLDOWN PER PLAN INSTALLED PER MANUF. SPECS. W/ 16d SINKER (0.148"x3.5") OR 10d COMMON (0.148"x3.5") NAILS
- RIM BOARD PER PLAN
- CONCRETE STEM WALL PER PLAN W/ #4 REBAR IN UPPER 3" TO 5" OF STEM WALL
- PROVIDE SQUASH BLOCKS IN FLOOR CAVITY TO MATCH POST IN SHEAR WALL. GRAIN ORIENTED VERTICALLY


FOUNDATION STRAP	NAILS INTO END POST
L5THD8/L5THD8RJ	20
5THD10/5THD10RJ	24
5THD14/5THD14RJ	30

H2 TYPICAL STRAP TIE HOLDDOWN
SCALE: 3/4"=1"

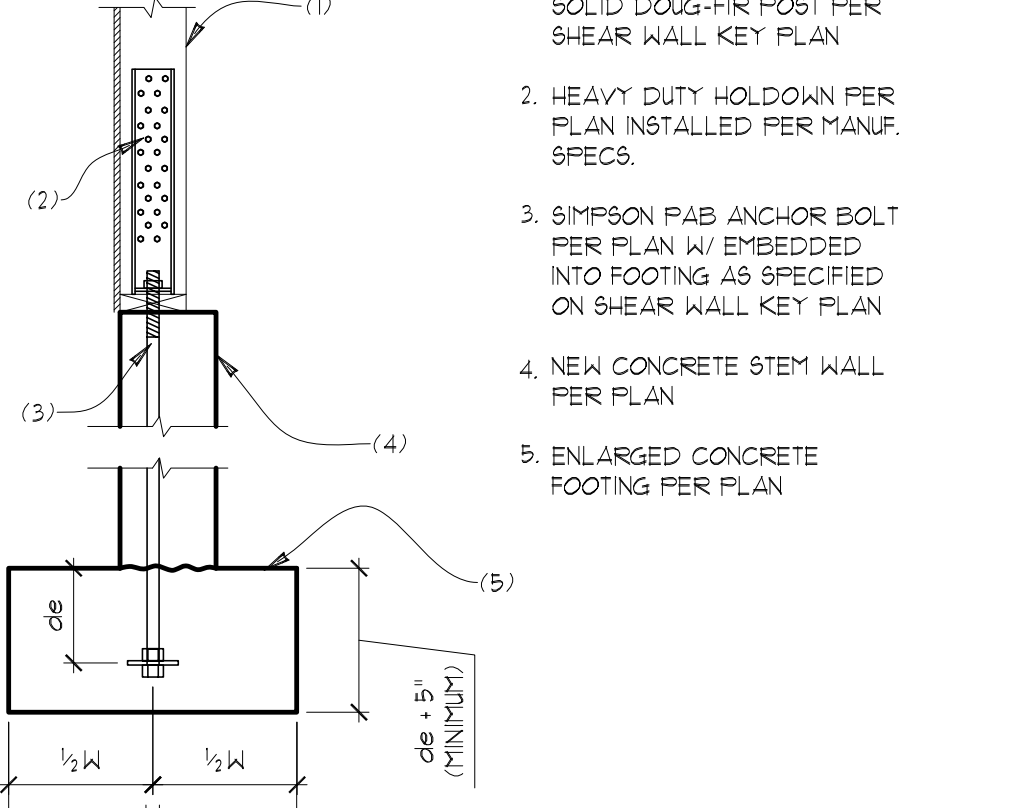

- SHEAR WALL PER PLAN W/ SOLID DOUG-FIR POST PER SHEAR WALL KEY PLAN
- HEAVY DUTY HOLDOWN PER PLAN INSTALLED PER MANUF. SPECS.
- SIMPSON PAB ANCHOR BOLT PER PLAN W/ EMBEDDED INTO FOOTING AS SPECIFIED ON SHEAR WALL KEY PLAN
- NEW CONCRETE STEM WALL PER PLAN
- ENLARGED CONCRETE FOOTING PER PLAN


H3 PAB ANCHOR BOLT AT HOLDDOWN
SCALE: 3/4"=1"

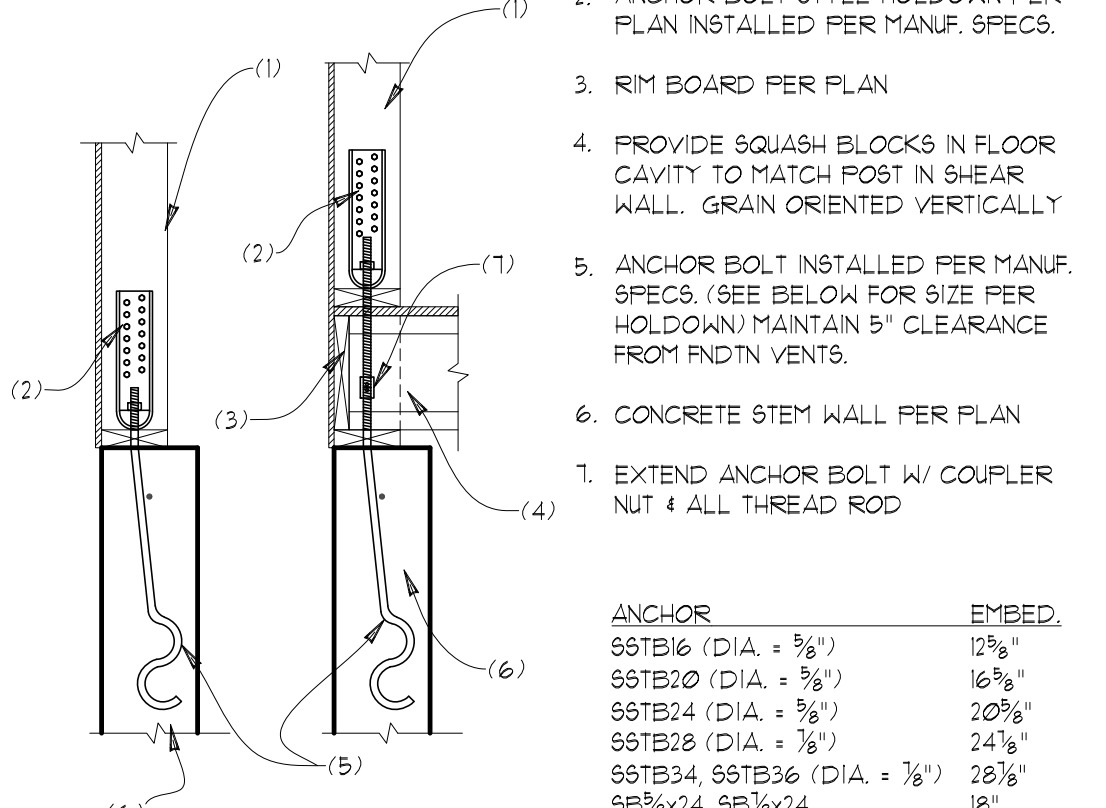

- DBL 2x STUDS MINIMUM AT HOLDOWN UNLESS NOTED OTHERWISE
- ANCHOR BOLT STYLE HOLDOWN PER PLAN INSTALLED PER MANUF. SPECS.
- RIM BOARD PER PLAN
- PROVIDE SQUASH BLOCKS IN FLOOR CAVITY TO MATCH POST IN SHEAR WALL. GRAIN ORIENTED VERTICALLY
- ANCHOR BOLT INSTALLED PER MANUF. SPECS. (SEE BELOW FOR SIZE PER HOLDOWN) MAINTAIN 5" CLEARANCE FROM FNDTN VENTS.
- CONCRETE STEM WALL PER PLAN
- EXTEND ANCHOR BOLT W/ COUPLER NUT & ALL THREAD ROD


ANCHOR	EMBED.
55TB16 (DIA. = 3/8")	17 3/4"
55TB20 (DIA. = 1/2")	16 3/8"
55TB24 (DIA. = 5/8")	20 3/8"
55TB28 (DIA. = 7/8")	24 3/8"
55TB34, 55TB36 (DIA. = 1 1/8")	28 3/8"
55TB42, 55TB44	18"
55TB50	24"

H4 TYPICAL ANCHOR BOLT HOLDDOWN
SCALE: 3/4"=1"

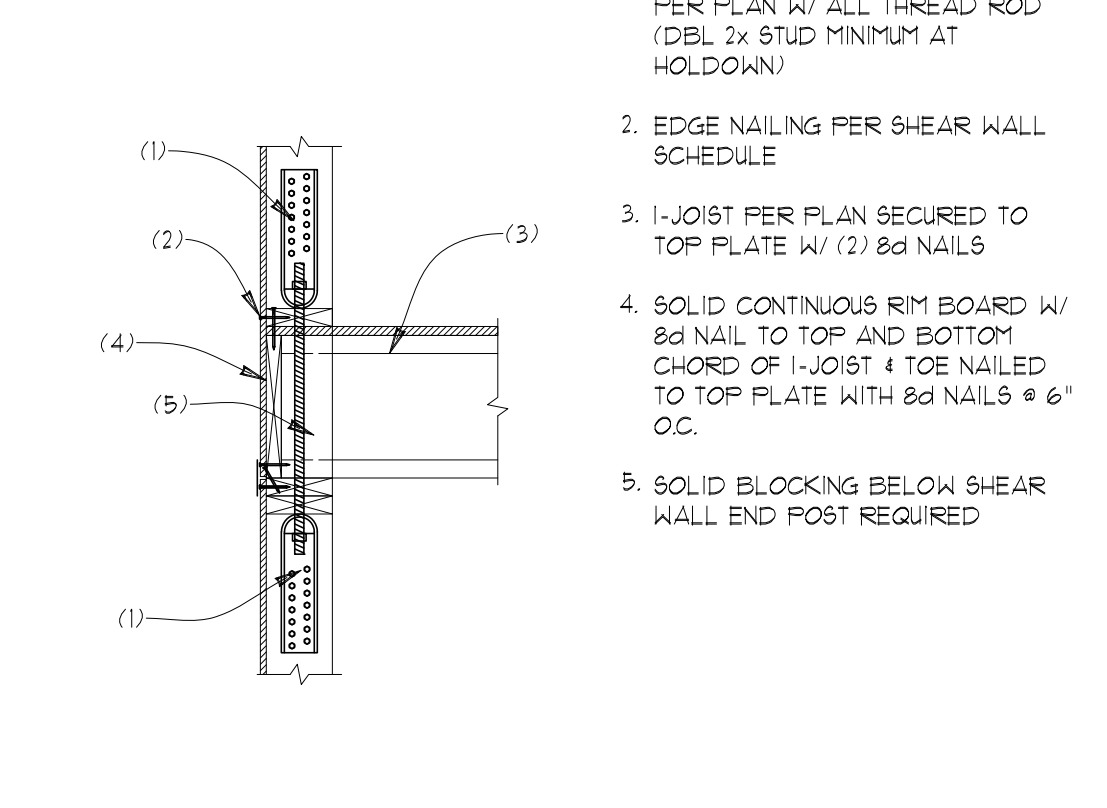

- ANCHOR BOLT STYLE HOLDOWNS PER PLAN W/ ALL THREAD ROD (DBL 2x STUD MINIMUM AT HOLDOWN)
- EDGE NAILING PER SHEAR WALL SCHEDULE
- I-JOIST PER PLAN SECURED TO TOP PLATE W/ (2) #4 NAILS
- SOLID CONTINUOUS RIM BOARD W/ #4 NAIL TO TOP AND BOTTOM CHORD OF I-JOIST & TOE NAILED TO TOP PLATE WITH #4 NAILS @ 6" O.C.
- SOLID BLOCKING BELOW SHEAR WALL END POST REQUIRED


H5 TYPICAL WALL TO WALL HOLDOWN CONNECTION BETWEEN FLOORS
SCALE: 3/4"=1"

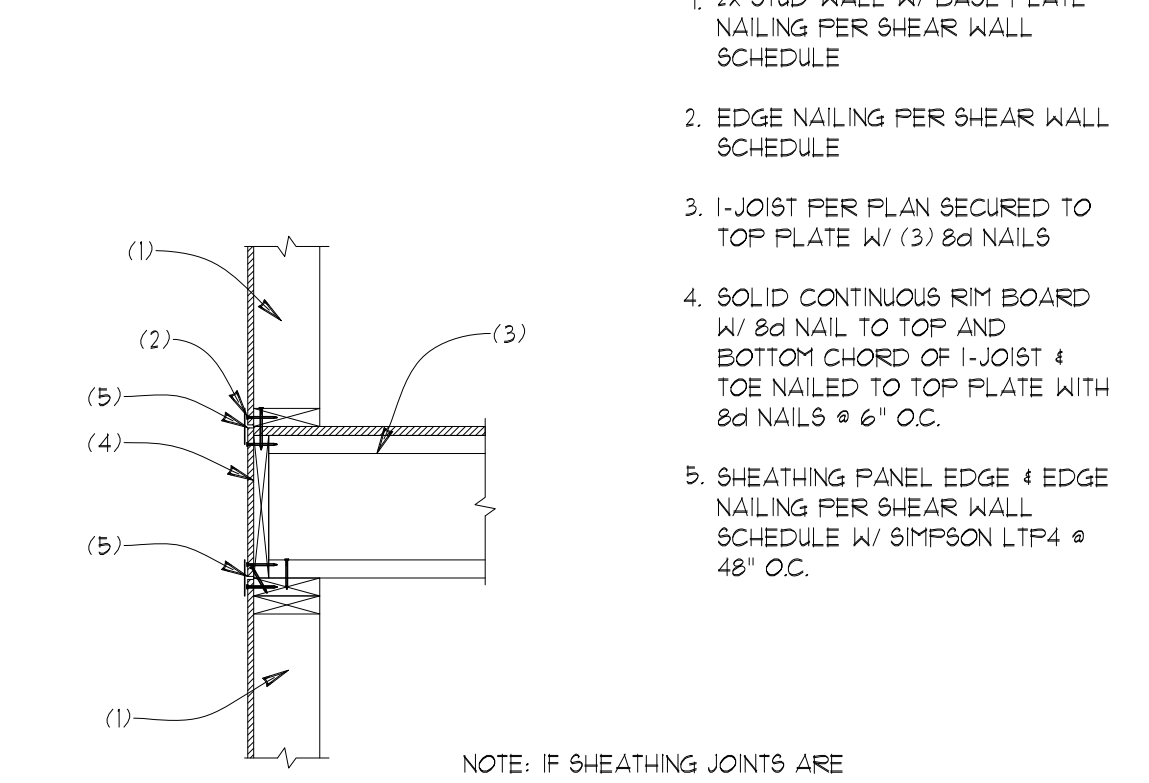

- 2x STUD WALL W/ BASE PLATE NAILING PER SHEAR WALL SCHEDULE
- EDGE NAILING PER SHEAR WALL SCHEDULE
- I-JOIST PER PLAN SECURED TO TOP PLATE W/ (3) #4 NAILS
- SOLID CONTINUOUS RIM BOARD W/ #4 NAIL TO TOP AND BOTTOM CHORD OF I-JOIST & TOE NAILED TO TOP PLATE WITH #4 NAILS @ 6" O.C.
- SHEATHING PANEL EDGE & EDGE NAILING PER SHEAR WALL SCHEDULE W/ SIMPSON LTP4 @ 48" O.C.

NOTE: IF SHEATHING JOINTS ARE RELOCATED TO OCCUR ON THE RIM, & SHEATHING IS EDGE NAILED AT RIM JOIST & WALL PLATES, THE SIMPSON LTP4 MAY BE ELIMINATED


60 FLOOR JOIST BEARING AT STUD WALL
SCALE: 3/4"=1"

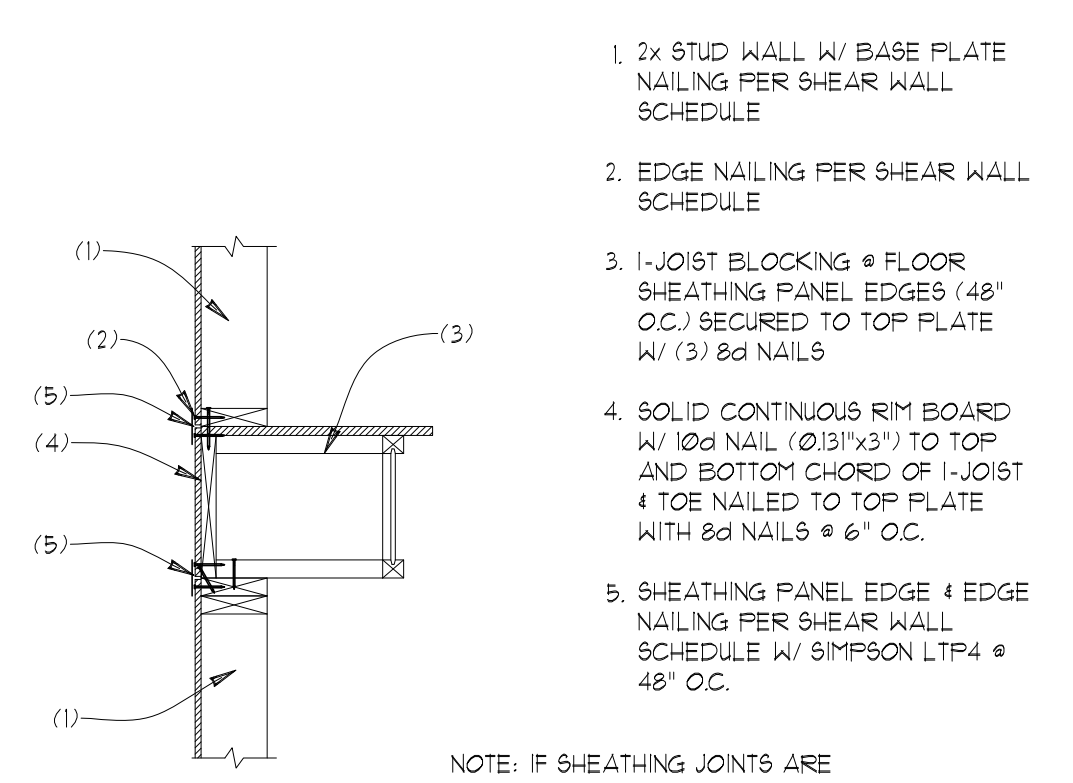

- 2x STUD WALL W/ BASE PLATE NAILING PER SHEAR WALL SCHEDULE
- EDGE NAILING PER SHEAR WALL SCHEDULE
- I-JOIST BLOCKING @ FLOOR SHEATHING PANEL EDGES (48" O.C.) SECURED TO TOP PLATE W/ (3) #4 NAILS
- SOLID CONTINUOUS RIM BOARD W/ #4 NAIL (0.131"x3.5") TO TOP AND BOTTOM CHORD OF I-JOIST & TOE NAILED TO TOP PLATE WITH #4 NAILS @ 6" O.C.
- SHEATHING PANEL EDGE & EDGE NAILING PER SHEAR WALL SCHEDULE W/ SIMPSON LTP4 @ 48" O.C.


NOTE: IF SHEATHING JOINTS ARE RELOCATED TO OCCUR ON THE RIM, & SHEATHING IS EDGE NAILED AT RIM JOIST & WALL PLATES, THE SIMPSON LTP4 MAY BE ELIMINATED

61 FLOOR JOIST PARALLEL TO STUD WALL
SCALE: 3/4"=1"

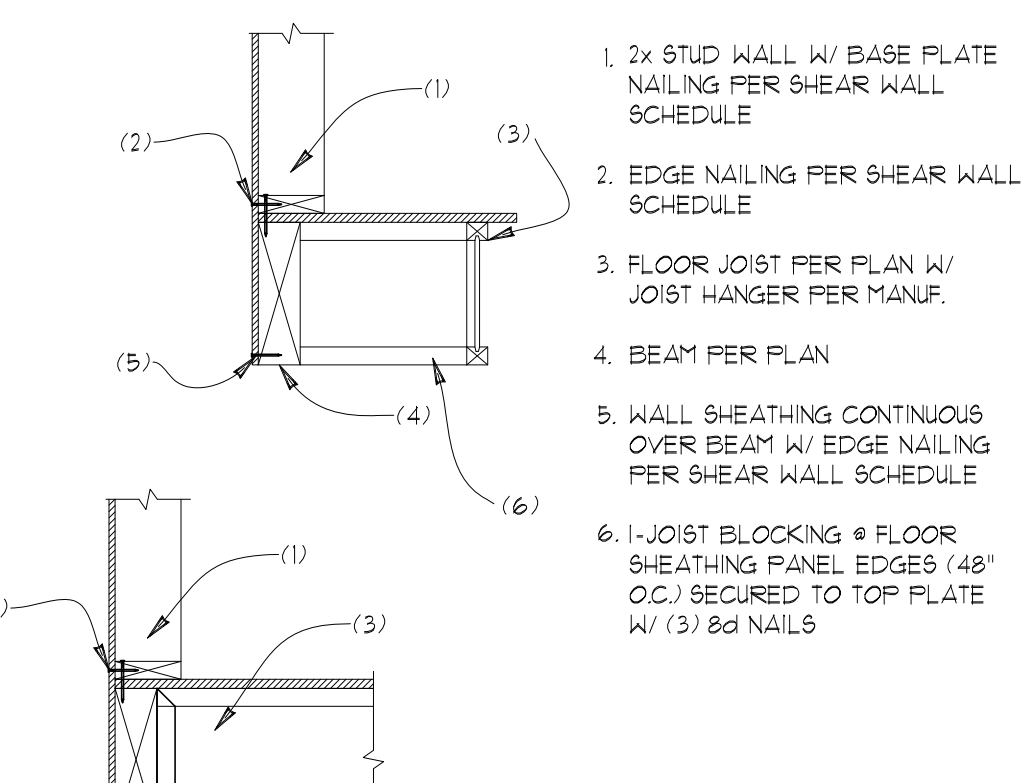


- 2x STUD WALL W/ BASE PLATE NAILING PER SHEAR WALL SCHEDULE
- EDGE NAILING PER SHEAR WALL SCHEDULE
- FLOOR JOIST PER PLAN W/ JOIST HANGER PER MANUF.
- BEAM PER PLAN
- WALL SHEATHING CONTINUOUS OVER BEAM W/ EDGE NAILING PER SHEAR WALL SCHEDULE
- I-JOIST BLOCKING @ FLOOR SHEATHING PANEL EDGES (48" O.C.) SECURED TO TOP PLATE W/ (3) #4 NAILS

62 FLOOR JOIST AT BEAM
SCALE: 3/4"=1"

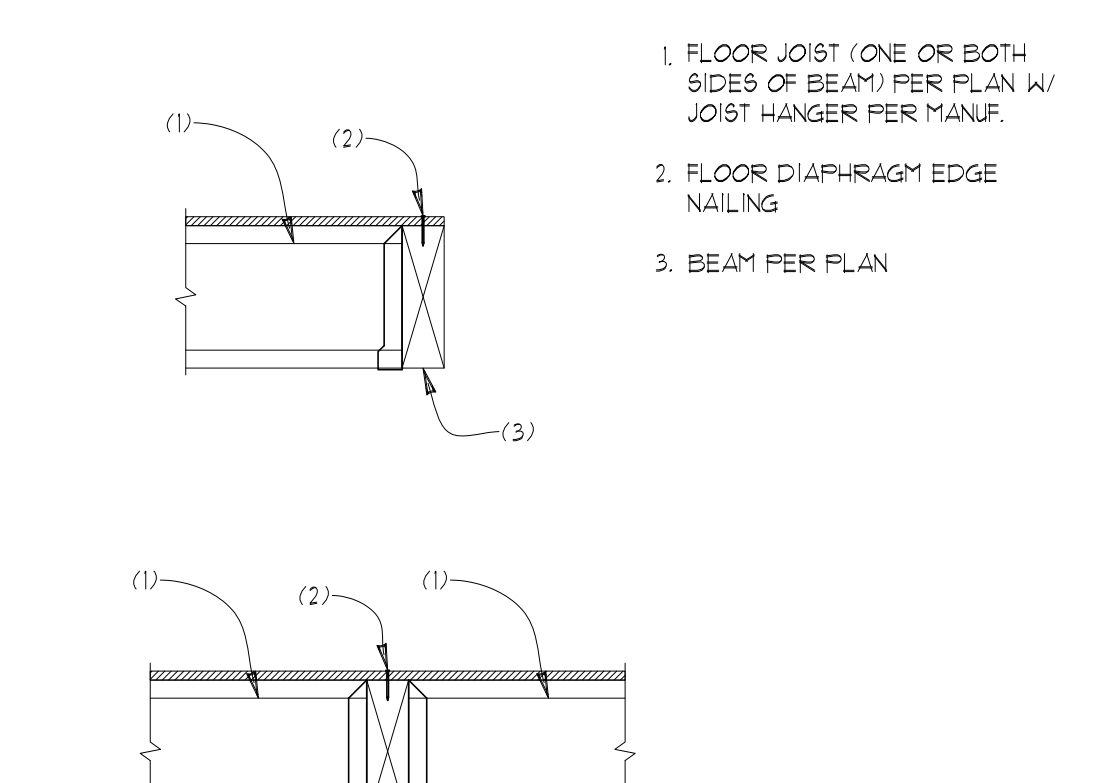


- FLOOR JOIST (ONE OR BOTH SIDES OF BEAM) PER PLAN W/ JOIST HANGER PER MANUF.
- FLOOR DIAPHRAGM EDGE NAILING
- BEAM PER PLAN

63 FLOOR JOIST AT BEAM
SCALE: 3/4"=1"

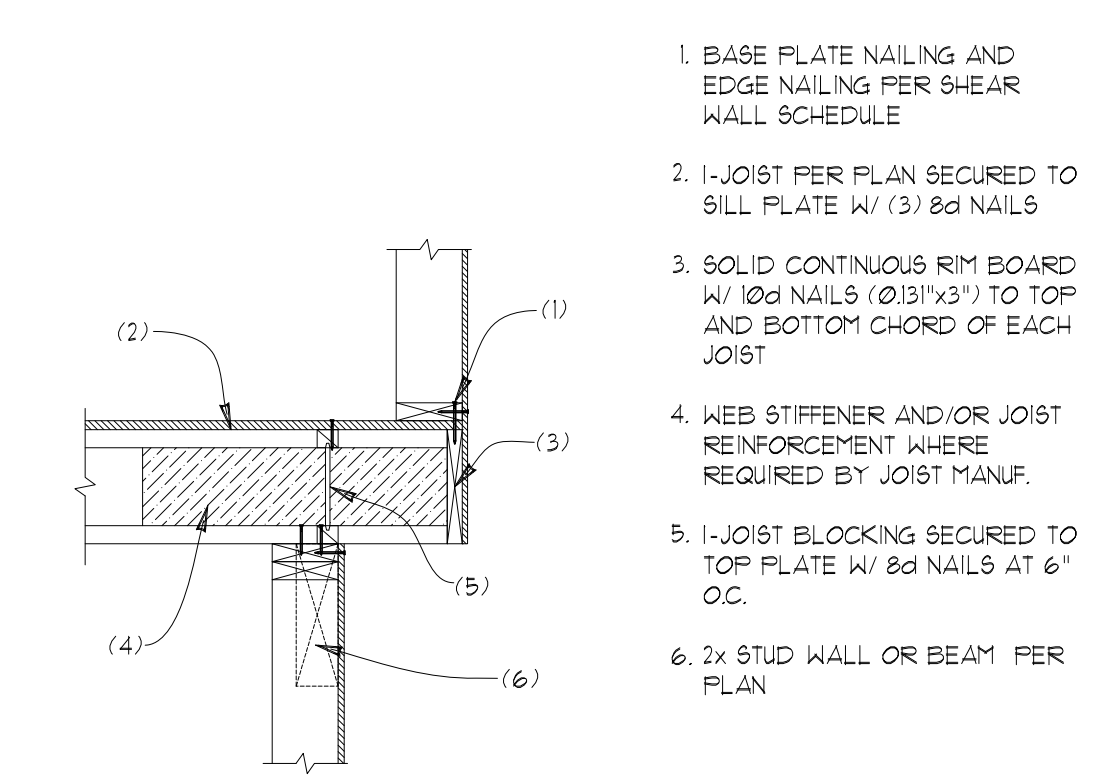


- BASE PLATE NAILING AND EDGE NAILING PER SHEAR WALL SCHEDULE
- I-JOIST PER PLAN SECURED TO SILL PLATE W/ (3) #4 NAILS
- SOLID CONTINUOUS RIM BOARD W/ #4 NAILS (0.131"x3.5") TO TOP AND BOTTOM CHORD OF EACH JOIST
- WEB STIFFENER AND/OR JOIST REINFORCEMENT WHERE REQUIRED BY JOIST MANUF.
- I-JOIST BLOCKING SECURED TO TOP PLATE W/ #4 NAILS AT 6" O.C.
- 2x STUD WALL OR BEAM PER PLAN

64 I-JOIST CANTILEVER
SCALE: 3/4"=1"

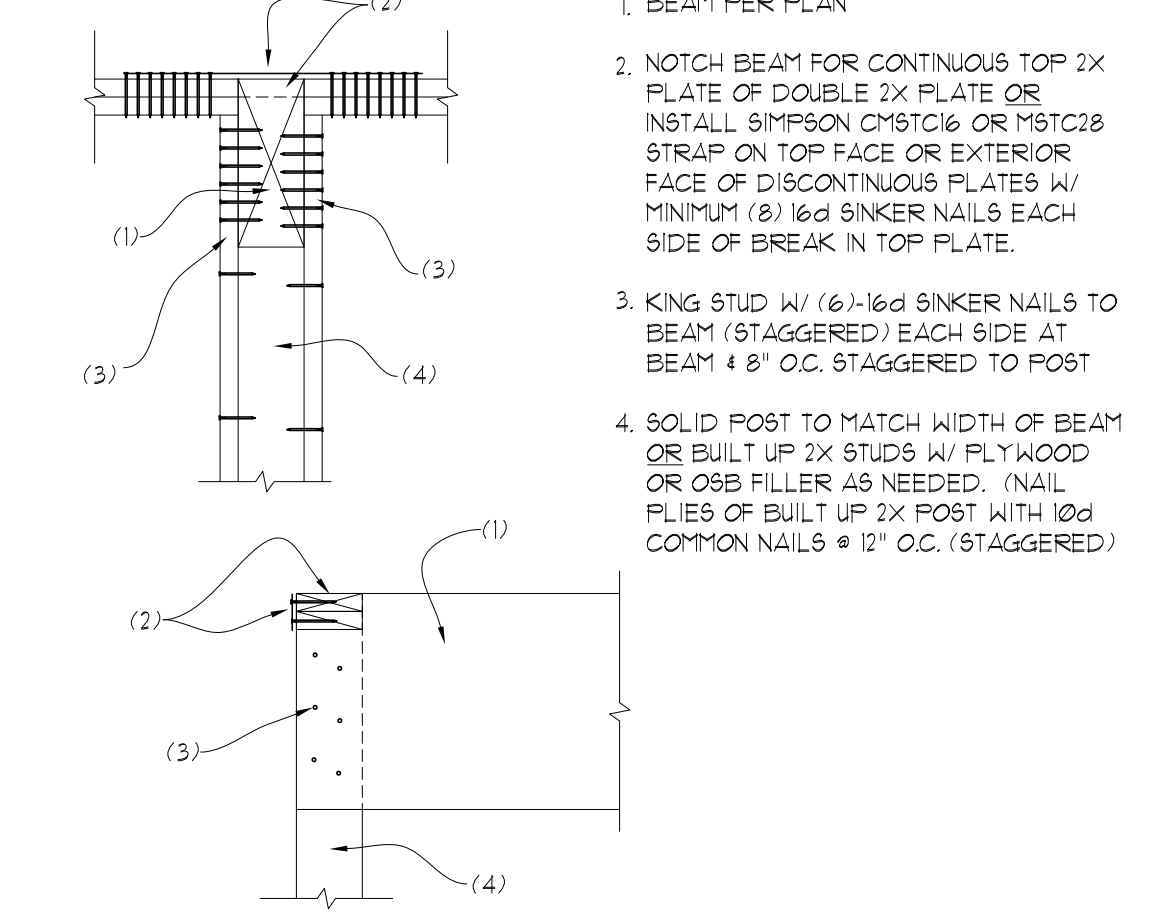

- BEAM PER PLAN
- NOTCH BEAM FOR CONTINUOUS TOP 2x PLATE OF DOUBLE 2x PLATE OR INSTALL SIMPSON CHSTC16 OR M5TC28 STRAP ON TOP FACE OR EXTERIOR FACE OF DISCONTINUOUS PLATES W/ MINIMUM (8) 16d SINKER NAILS EACH SIDE OF BREAK IN TOP PLATE.
- KING STUD W/ (6) 16d SINKER NAILS TO BEAM (STAGGERED) EACH SIDE AT BEAM & 8" O.C. STAGGERED TO POST
- SOLID POST TO MATCH WIDTH OF BEAM OR BUILT UP 2x STUDS W/ FLYWOOD OR OSB FILLER AS NEEDED. (NAIL FLIES OF BUILT UP 2x POST WITH 10d COMMON NAILS @ 12" O.C. (STAGGERED))


65 BEAM POCKET AT WALL
SCALE: 3/4"=1"

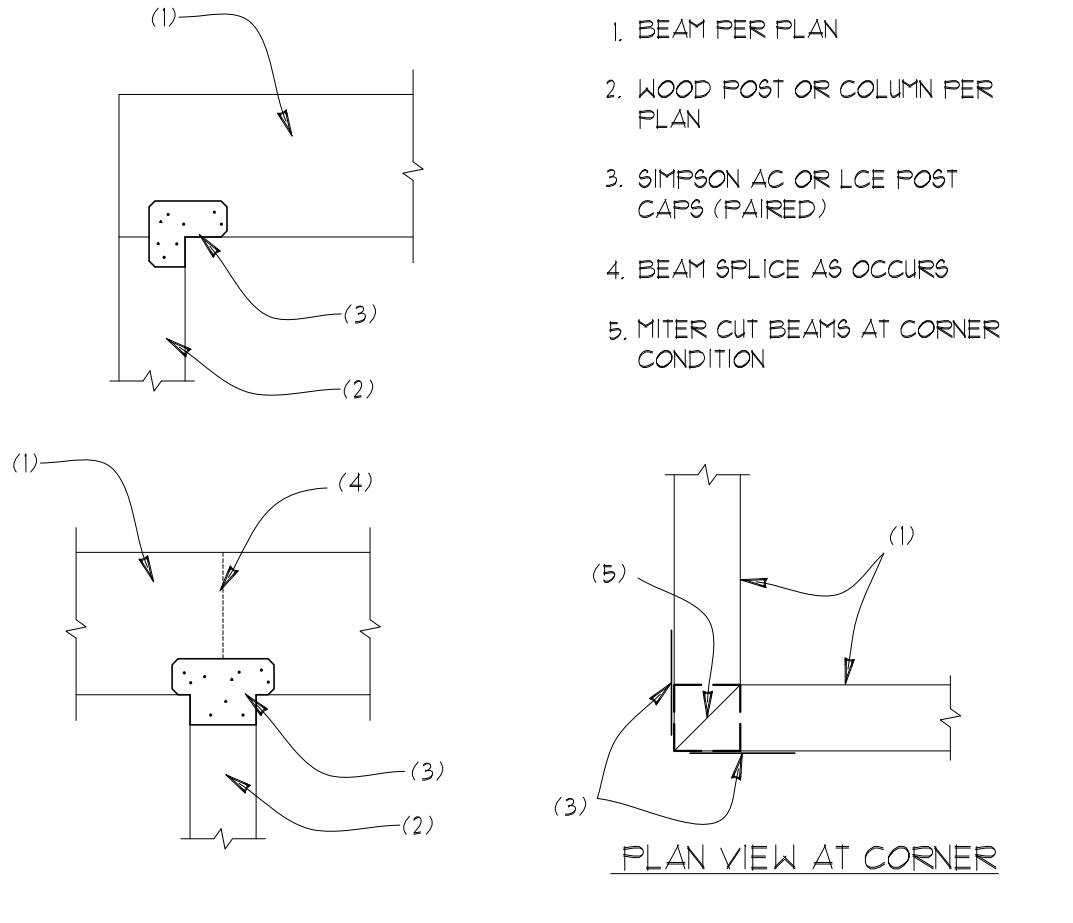

- BEAM PER PLAN
- WOOD POST OR COLUMN PER PLAN
- SIMPSON AC OR LCE POST CAPS (PAIRED)
- BEAM SPLICE AS OCCURS
- MITER CUT BEAMS AT CORNER CONDITION

PLAN VIEW AT CORNER

66 WOOD BEAM AT WOOD POST
SCALE: 3/4"=1"

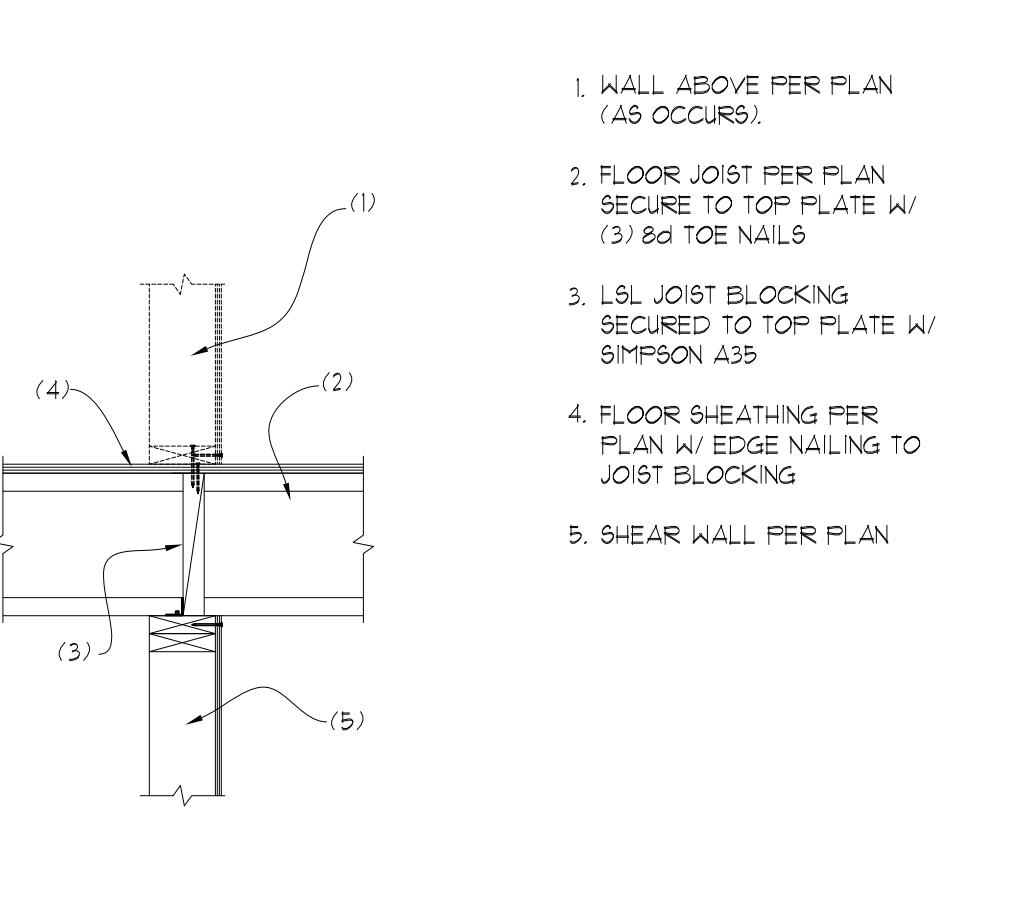


- WALL ABOVE PER PLAN (AS OCCURS)
- FLOOR JOIST PER PLAN SECURED TO TOP PLATE W/ (3) #4 TOE NAILS
- LSL JOIST BLOCKING SECURED TO TOP PLATE W/ SIMPSON A35
- FLOOR SHEATHING PER PLAN W/ EDGE NAILING TO JOIST BLOCKING
- SHEAR WALL PER PLAN

67 FLOOR JOIST AT INT. SHEAR WALL
SCALE: 3/4"=1"

STRUCTURAL PLANS

RKK CONSTRUCTION
9026 SE 61st STREET
MERCER ISLAND, WA

Myers Engineering, LLC
3206 50th Street Ct NW, Ste. 210-B
Gig Harbor, WA 98335
PH: 253-858-3248
Email: myengineer@centurytel.net

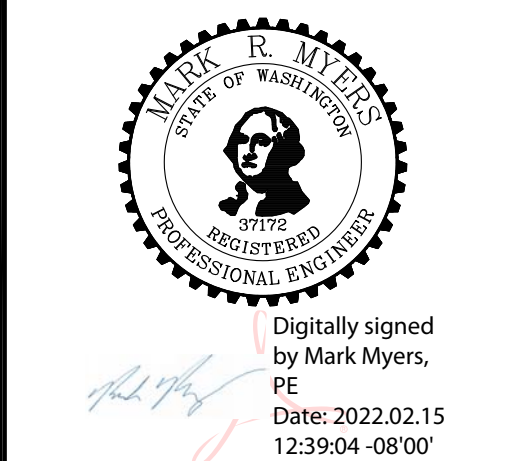

BUILDING DEPT. APPROVAL STAMPS:

REVISION:	INIT:	DATE:
PLAN REVIEW	MM	2-15-2022

S5	DATE:	10-1-2021
	INIT:	MM
	PROJECT #:	2394