


LOT COVERAGE:

LOT AREA: 9,630 SF
 ± 20' EASEMENT: 1,800 SF
 NET LOT AREA: 7,830 SF

MAX. LOT COVERAGE: 40%

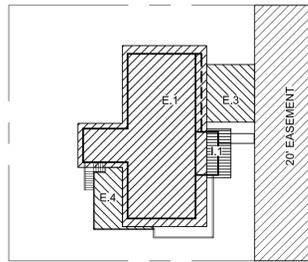


LOT AREA KEY

(Refer to Site Development Worksheet)

E.1	MAIN ROOF AREA	2,142 SF
E.3	VEHICULAR USE	344 SF
E.4	COVERED PATIO	227 SF
L1	NEW MAIN ROOF AREA	147 SF
TOTAL:		2,860 SF
2,860 / 7,830 = 36.5% PROPOSED LOT COVERAGE		

HARDSCAPE:

MAX. HARDSCAPE: 9%
 AREA BORROWED FROM LOT COVERAGE:
 40% - 36.5% = 3.5%
TOTAL HARDSCAPE: 9% + 3.5% = 12.5%

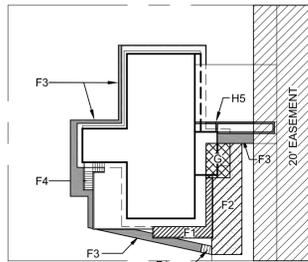


HARDSCAPE KEY

(Refer to Site Development Worksheet)


F.1	UNCOVERED DECKS	127 SF
F.2	UNCOVERED PATIOS	435 SF
F.3	WALKWAYS	278 SF
F.4	STAIRS	43 SF
G	AREA TO BE REMOVED	-103 SF
H.5	NEW RETAINING WALLS	9 SF
TOTAL:		789 SF
789 / 7,830 = 10% PROPOSED HARDSCAPE		

GROSS FLOOR AREA:


EXISTING BASEMENT

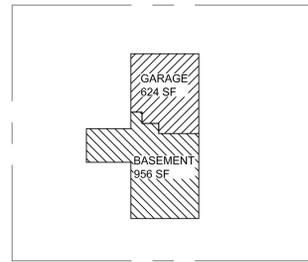


NEW BASEMENT

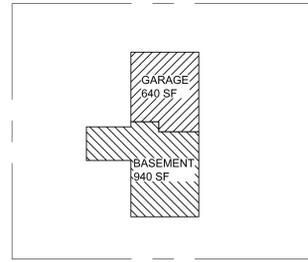

EXISTING 1ST FLOOR

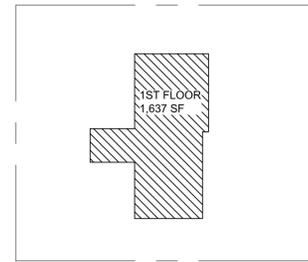

NEW 1ST FLOOR

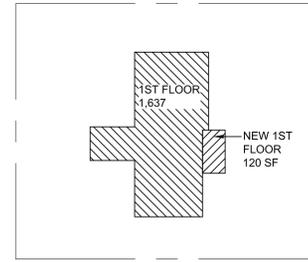

ABBREVIATIONS:

- ACH Air Changes per Hour
- ADJ Adjacent
- ADU Accessory Dwelling Unit
- BD Board
- BM Beam
- BOT Bottom
- BTWN Between
- CANT Cantilever
- CFM Cubic Feet per Minute
- CLNG Ceiling
- CONT Continuous
- D Deep
- DF Douglas Fir
- DN Down
- DW Dishwasher
- EA Each
- EF Exhaust Fan
- EG Egress
- (E) Existing
- EXT Exterior
- FRZR Freezer
- GWB Gypsum Wall Board
- H High
- HB Hose Bibb
- H.C. Hollow Core
- HDR Header
- HORIZ Horizontal
- HT Height
- IBC International Building Code
- INT DES Interior Design(er)
- IRC International Residential Code
- LIN Linen
- MAX Maximum
- MIN Minimum
- MTL Metal
- (N) New
- N/A Not Applicable
- O.C. On Center
- PR Pair
- PT Pressure Treated
- REF Refrigerator
- REQ'D Required
- S&R Shelf and Rod
- S.C. Solid Core
- SD Smoke Detector
- SECT Section
- SG Safety Glazing
- SIP Structural Insulated Panel
- STOR Storage
- STV Stove
- T.O.W. Top of Wall
- TYP Typical
- U U Value
- UNO Unless Noted Otherwise
- VERT Vertical
- VG Vertical Grain
- VTO Vent to Outside
- W Wide
- W/ With
- W/D Washer/Dryer
- WD Wood
- W.H. Water Heater
- # Pound

PROJECT INFORMATION:

Owner:
 GRETCHEN AND KEITH ANDERSON
 14 WEMBLEY LANE
 MERCER ISLAND, WA 98040

Project Address:
 14 WEMBLEY LANE
 MERCER ISLAND, WA 98040

Parcel:
 759810-0523

Legal:
 SCHMIDS VITUS E SEATTLE ACRE TRS S 30 FT OF
 W 107 FT OF 1 & N 60 FT OF W 107 FT OF 2
 Plat Block: 14
 Plat Lot: 1-2

Zoning:
 R-9.6

Project Description:
 Interior, structural remodel existing finished basement
 849 sf
 New Foyer Addition 120 sf
 New landscape walls along driveway

Codes:
 2018 International Residential Code
 2018 International Building Code
 2018 Washington State Amendments
 2018 Washington Energy Code
 Mercer Island City Code Title 19: Unified Development

PROJECT TEAM:

BUILDING DESIGNER:
 Katherine Zeim
 K Zeim Home Design
 1329 N 47th St. #31348
 Seattle, WA 98103
 kathy@kzeimdesign.com
 (206) 850-9323

STRUCTURAL ENGINEER:
 Pasko Kesovija, PE
 CK Engineering LLC
 19229 36th Pl NE
 Lake Forest Park, WA 98155
 pasko@ckengineeringllc.net
 (206) 417-0670

DRAWING INDEX:

- A1.1 COVERSHEET
- A2.1 PLANS
- A2.2 PLANS & SCHEDULES
- A3.1 EXTERIOR ELEVATIONS
- A4.1 SECTIONS & DETAILS
- S1.0 GENERAL STRUCTURAL NOTES, SCHED.
- S2.0 STRUCTURAL DETAILS

ENERGY CODE:

PRESCRIPTIVE ENERGY CODE COMPLIANCE

- FENESTRATION: U = 30 MAX.
- CEILING: R = 38 MIN., Advanced framed roof
- WOOD FRAME WALL: R = 21 int MIN.
- FLOOR: R = 30 MIN.
- BELOW GRADE WALL: R = 21 int MIN.

See Code text for footnotes.

Air Leakage 5 ACH max.

ENERGY CREDITS


ADDITION: 120 SF
 ADDITIONS < 500 SF: 1.5 CREDITS REQUIRED

FUEL NORMALIZATION CREDITS:
 System Type 2: Heat Pump meeting federal standards listed in Table C403.3.2(1)C or C403.3.2(2): 1 CREDIT

OPTION 3.2
 Air Sourced centrally ducted heat pump with minimum HSPF 9.5:
 1 CREDIT


1.5 CREDITS REQUIRED, 2 CREDITS PROVIDED

AVERAGE GRADE ELEVATION:

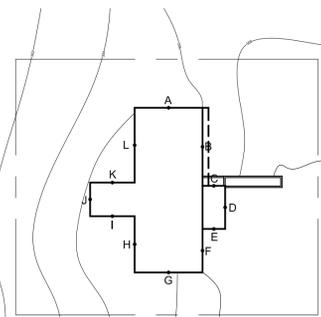

MIDPOINT ELEVATION	WALL SEGMENT LENGTH	SUBTOTAL
A 306.0'	24.0'	7,344.0
B 307.0'	27.5'	8,442.5
C 310.0'	8.0'	2,480.0
D 310.0'	15.2'	4,712.0
E 310.0'	8.0'	2,480.0
F 310.0'	15.3'	4,743.0
G 307.7'	24.0'	7,384.8
H 306.3'	19.8'	6,064.7
I 306.2'	15.8'	4,838.0
J 306.1'	11.9'	3,642.6
K 306.2'	15.8'	4,838.0
L 306.2'	26.3'	8,053.1
SUBTOTAL:	211.6'	65,022.7

65,022.7 / 211.6 = 307.3' AVERAGE GRADE ELEVATION

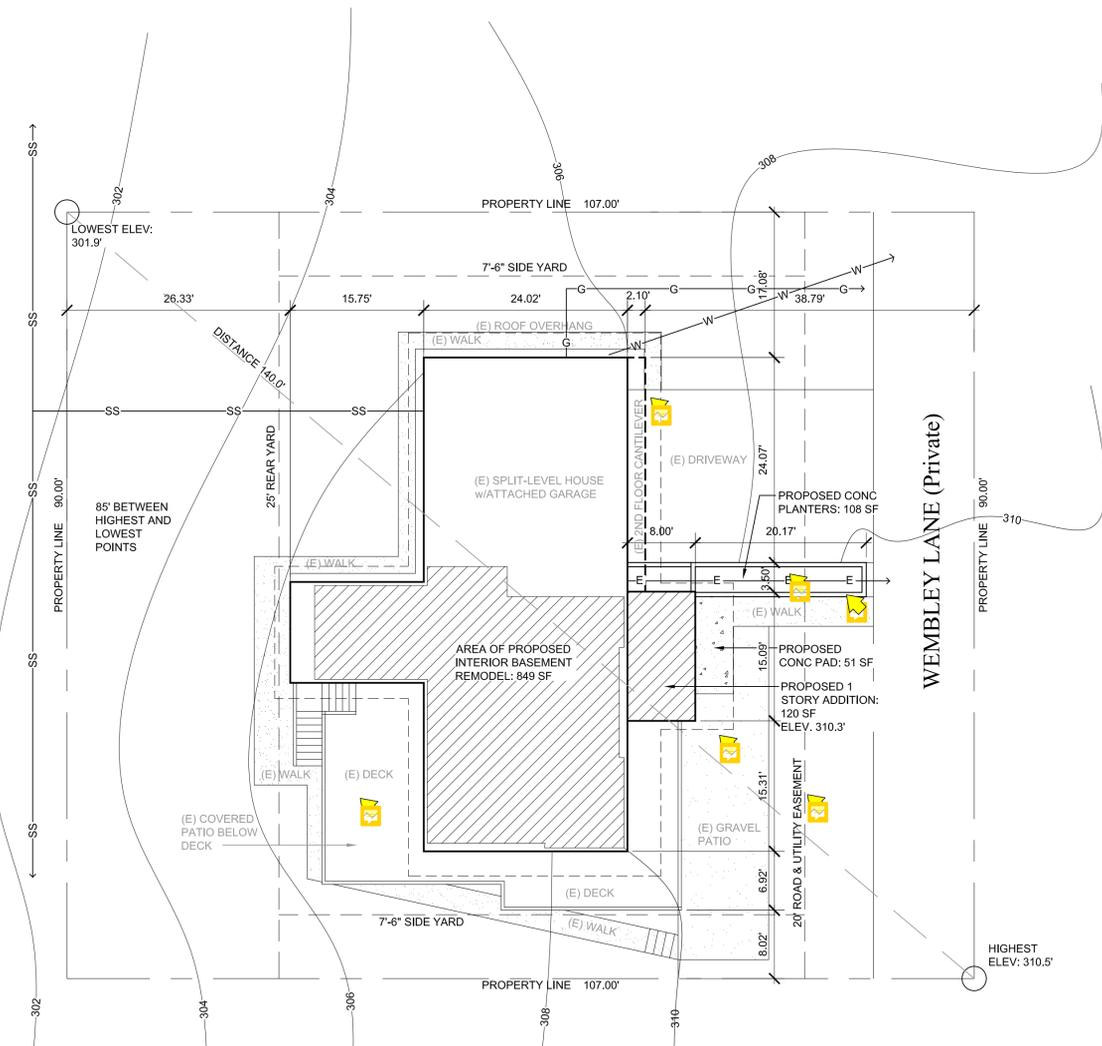

1 SITE PLAN
 SCALE: 1" = 10'



ANDERSON RESIDENCE
 14 WEMBLEY LANE
 MERCER ISLAND, WA 98040

PERMIT

REV #: DATE: DESCRIPTION:


COVERSHEET

A1.1

MARCH 2, 2022

K Zeim | Home Design

1329 N 47th Street, #31348
 Seattle, WA 98103
 (206) 850-9323
 kathy@kzeimdesign.com

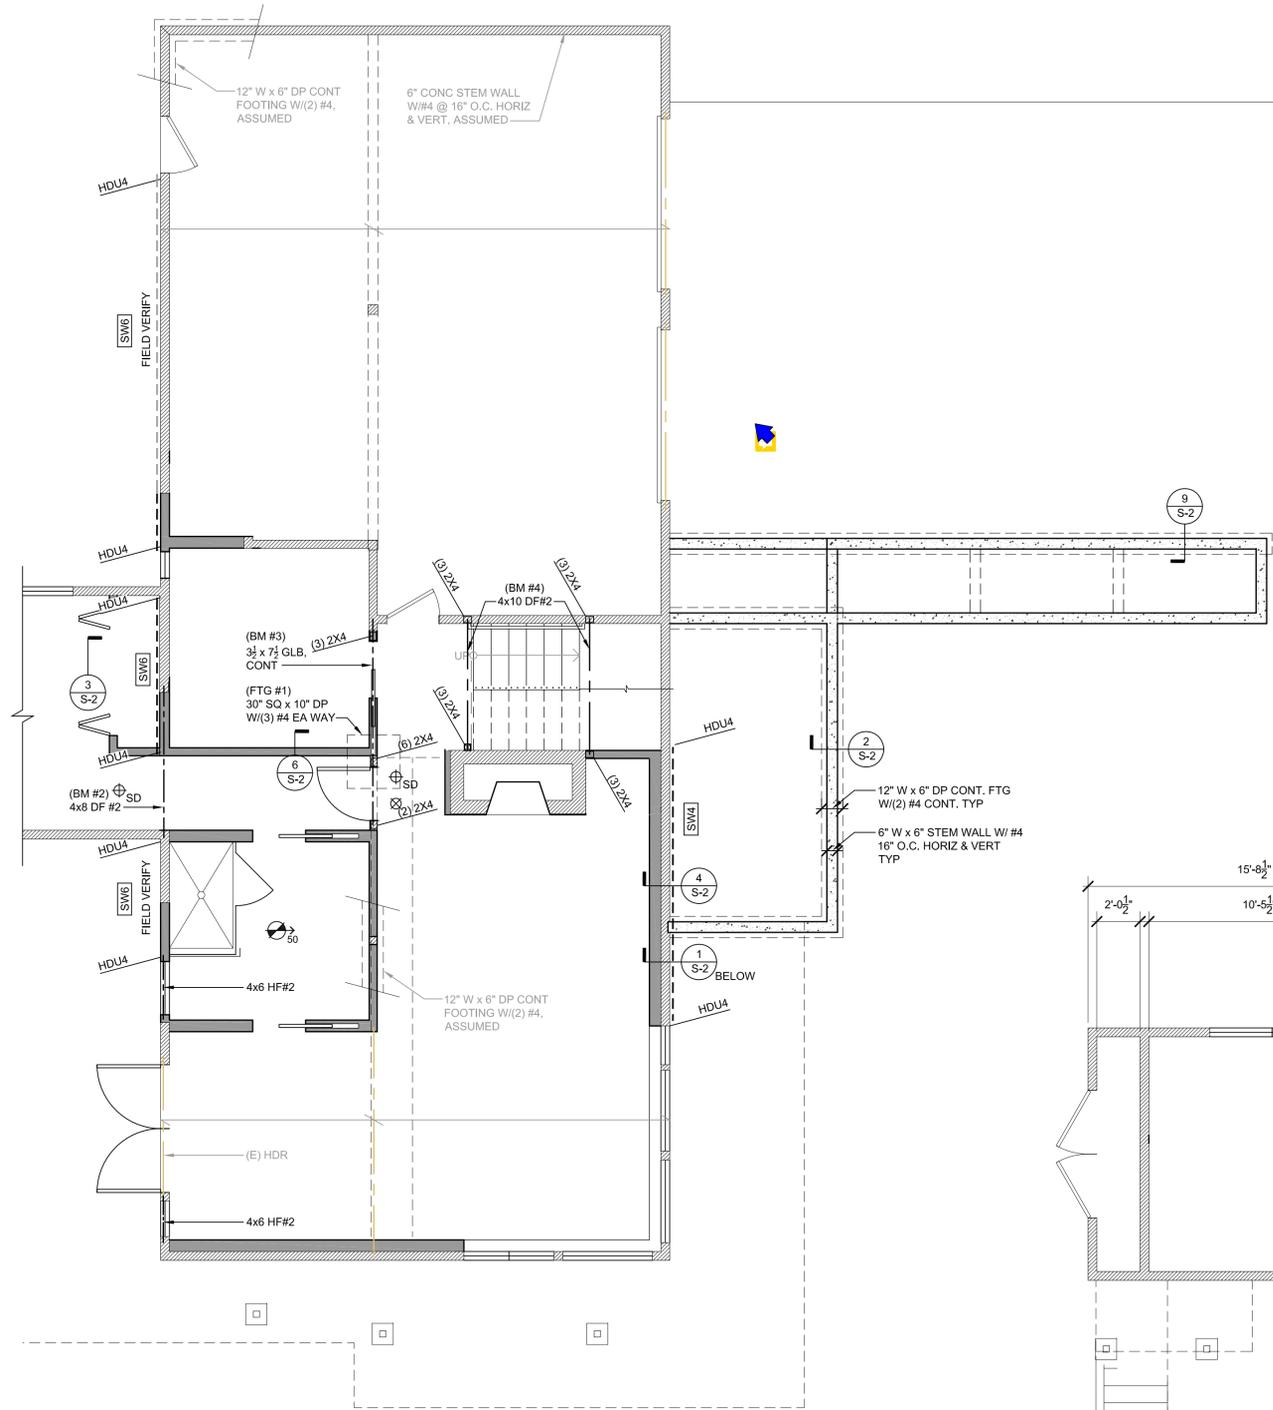

1 FOUNDATION & 1ST FLOOR FRAMING PLAN
SCALE: 1/4" = 1'-0"



SMOKE ALARMS:
VERIFY OR PROVIDE SMOKE ALARMS IN THE FOLLOWING LOCATIONS PER R314.3:
1. INSIDE EACH BEDROOM
2. OUTSIDE EACH SLEEPING AREA
3. ON EACH LEVEL OF THE HOUSE- SEE CODE FOR DETAILS ABOUT SPLIT LEVELS


INTERCONNECT WITH NEW SMOKE ALARMS IN ADDITION. INTERCONNECTION MAY BE WIRELESS PER R314.4 ALARMS MAY BE BATTERY OPERATED PER R314.2.2

CARBON MONOXIDE ALARMS:
VERIFY OR PROVIDE CARBON MONOXIDE ALARMS IN THE FOLLOWING LOCATIONS PER R315.3:
1. OUTSIDE EACH SLEEPING AREA
2. ON EACH LEVEL OF THE HOUSE

INTERCONNECT WITH NEW CM ALARMS IN ADDITION. INTERCONNECTION MAY BE WIRELESS PER R315.5 CARBON MONOXIDE ALARMS MAY BE COMBO UNITS WITH SMOKE DETECTORS ALARMS MAY BE BATTERY OPERATED PER R315.2.2

- SYMBOLS:**
- NEW WOOD STUD FRAMING:
2x4 @ 16" O.C. @ INTERIOR, UNO
2x6 @ 16" O.C. @ EXTERIOR, UNO
 - EXISTING WALL (2x4 STUD FRAMING OR 6" CONCRETE)
 - EXHAUST FAN (MIN. CFM, INTERMITTENT, UNO)
 - SMOKE DETECTOR - MATCH (E) "NEST" UN
 - CARBON MONOXIDE ALARM

- PLAN NOTES:**
1. Dimensions to face of stud @ (N) walls, face of finish @ (E) walls, face of concrete, or centerline of column, UNO.
 2. Contractor to notify building designer of any discrepancies in the drawings prior to proceeding with work in the affected area.
 3. Insulate existing exterior wall stud cavities exposed during construction w/R-15 batt insulation or to full depth of cavity.
 4. A minimum of 90% of permanently installed lamps in the lighting fixtures shall be high-efficacy lamps.
 5. All exhaust fans vent to outside. Exhaust fan terminations may must meet requirements of SRC 1506.2 and not terminate within 3' of property lines, operable or inoperable openings, or within 10' of mechanical air intakes except when the termination is 3' above the intake.
 6. Top of handrail shall be not less than 34" or more than 38" above the tread nosings. Handrails shall be continuous the full length of the flight. The hand grip portion shall not be less than 1-1/4" or more than 2" in cross-sectional dimension. Handrails adjacent to walls shall have min. 1-1/2" space between the wall & handrail.

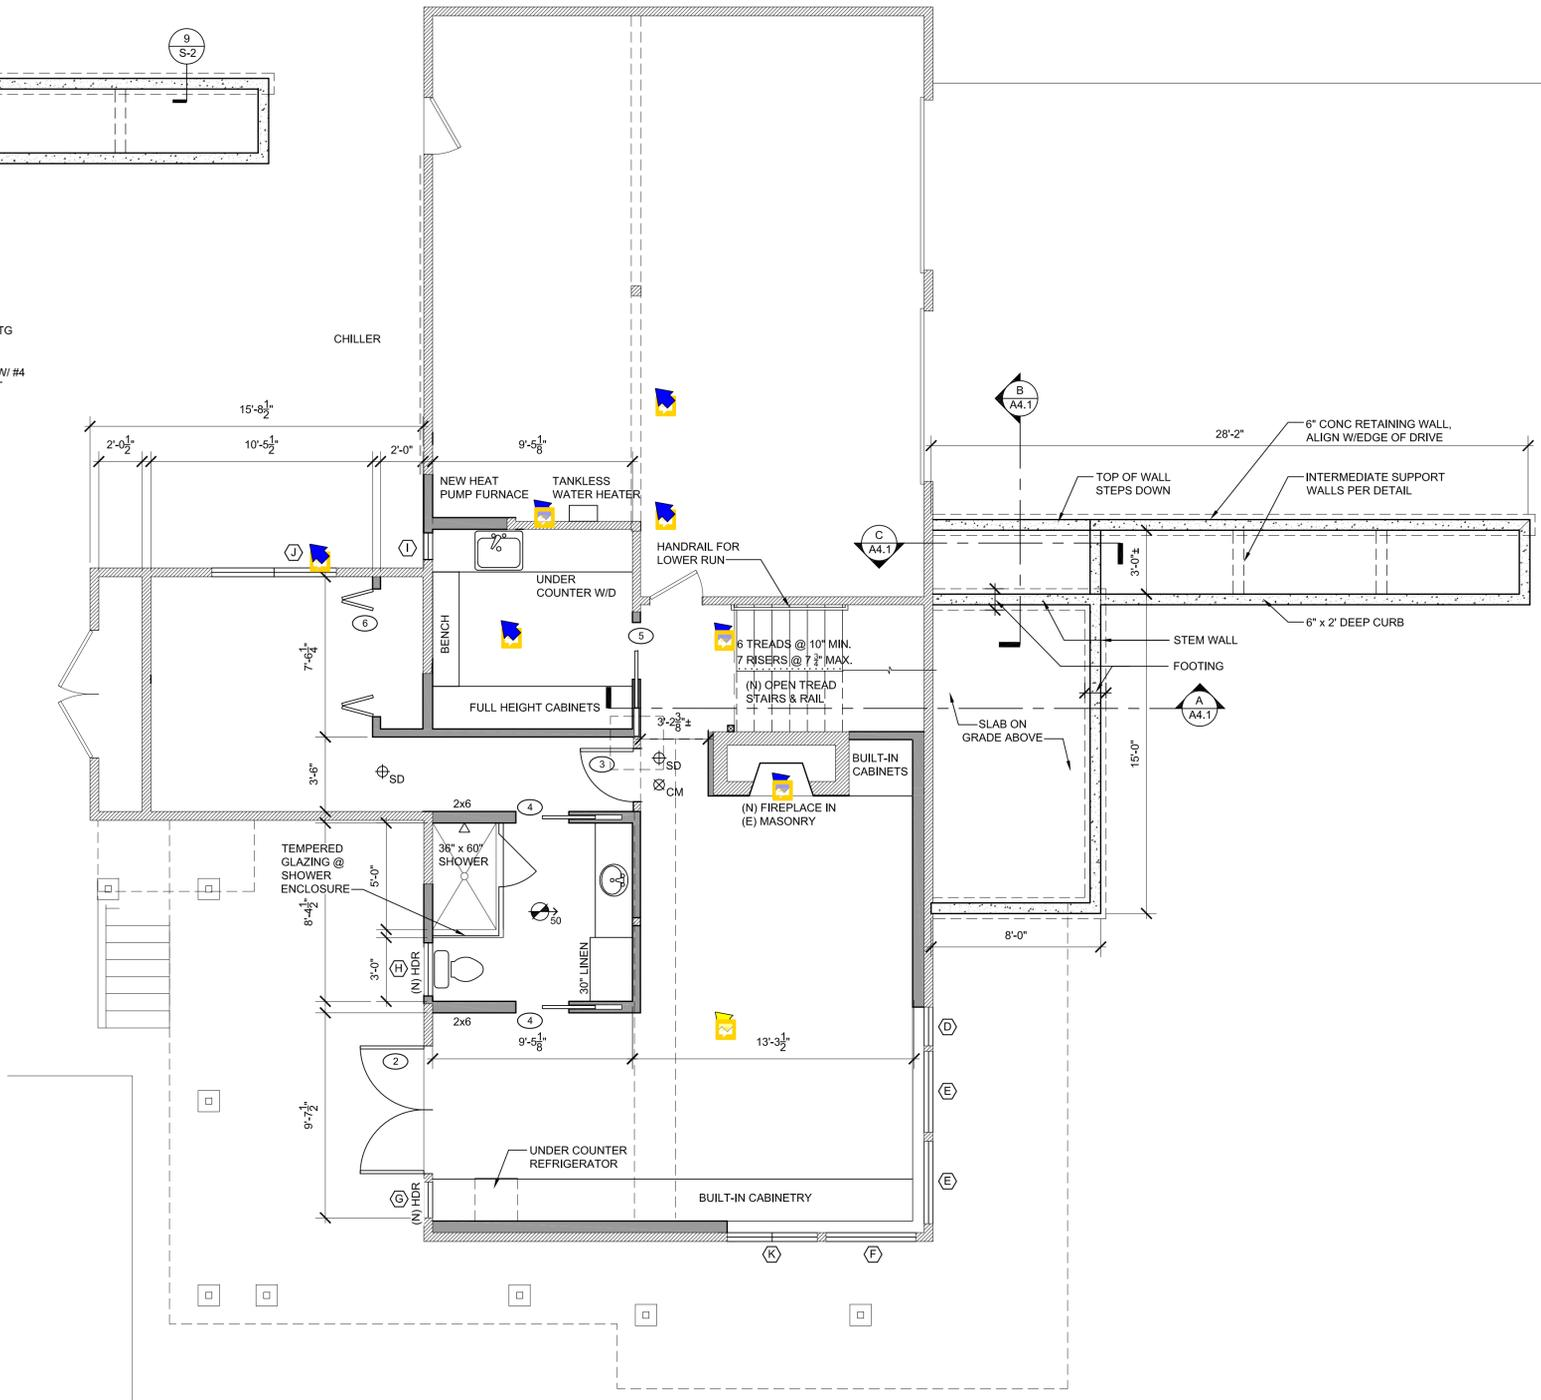

2 BASEMENT AND FOUNDATION PLAN
SCALE: 1/4" = 1'-0"



ANDERSON RESIDENCE
14 WEMBLEY LANE
MERCER ISLAND, WA 98040

PERMIT

REV #: DATE: DESCRIPTION:

PLANS

A2.1

MARCH 2, 2022

DOOR SCHEDULE										
MARK	QTY	WIDTH	HEIGHT	TYPE	MATERIAL	GLAZ	U-VALUE	MFR	LOCATION	NOTES
①	1	5'-4"	6'-8"	DBL SWING	TBD	FULL LITE	.30 MAX.	TBD	FOYER	1
②	1	6'-0"	6'-8"	DBL SWING	TBD	FULL LITE	.30 MAX.	TBD	REC ROOM	1, 2
③	1	2'-6"	6'-8"	SWING	S.C. WD	N/A	N/A	TBD	BEDROOM 4/ STUDY	-
④	2	2'-6"	6'-8"	POCKET	S.C. WD	N/A	N/A	TBD	BATH 3	-
⑤	1	2'-8"	6'-8"	POCKET	S.C. WD	N/A	N/A	TBD	LAUNDRY	-
⑥	1	6'-0"	6'-8"	BI-FOLD	H.C. WD	N/A	N/A	TBD	BEDROOM 4/ STUDY	-
⑦	1	6'-0"	6'-8"	DBL BI-FOLD	H.C. WD	N/A	N/A	TBD	FOYER	-

GENERAL NOTES
1. Contractor to verify hardware
2. Contractor to verify rough opening required.

KEY NOTES
1. SAFETY GLAZING
2. NEW DOOR IN EXISTING OPENING - VERIFY SIZE

WINDOW SCHEDULE							
MARK	QTY	WIDTH	HEIGHT	TYPE	U-VALUE	LOCATION	NOTES
A	2	2'-6"	6'-0"	PICTURE	.28 MAX.	FOYER	1
B	2	2'-6"	3'-3"	PICTURE	.28 MAX.	FOYER	-
C	1	5'-4"	3'-3"	PICTURE	.28 MAX.	FOYER	-
D	1	1'-10"	2'-6"	PICTURE	.28 MAX.	REC ROOM	2
E	2	3'-10"	2'-6"	PICTURE	.28 MAX.	REC ROOM	2
F	1	4'-3"	2'-6"	PICTURE	.28 MAX.	REC ROOM	2
G	1	1'-8"	3'-0"	PICTURE	.28 MAX.	REC ROOM	2
H	1	2'-6"	3'-0"	AWNING	.28 MAX.	BATH 3	3
I	1	1'-3"	3'-0"	AWNING	.28 MAX.	LAUNDRY	-
J	1	6'-0"	4'-0"	SLIDER	.28 MAX.	BEDROOM 4	1
K	1	4'-3"	2'-6"	SLIDER	.28 MAX.	REC ROOM	4

GENERAL NOTES
1. See elevations for operation & grids.
2. Field verify dimensions for new windows in existing openings.
3. Wall thicknesses vary, field verify prior to ordering
4. All windows to be "Marvin Modern" double glazed fiberglass windows with Low-e3 and argon gas.

KEY NOTES
1. SAFETY GLAZING
2. NEW WINDOW IN EXISTING OPENING, VERIFY DIMENSIONS
3. OPAQUE GLAZING
4. EGRESS


SYMBOLS:

- NEW WOOD STUD FRAMING:
2x4 @ 16" O.C. @ INTERIOR, UNO
2x6 @ 16" O.C. @ EXTERIOR, UNO
- EXISTING WALL (2x4 STUD FRAMING OR 6" CONCRETE)
- EXHAUST FAN (MIN. CFM, INTERMITTENT, UNO)
- SMOKE DETECTOR - MATCH (E) "NEST" UN
- CARBON MONOXIDE ALARM


PLAN NOTES:

1. Dimensions to face of stud @ (N) walls, face of finish @ (E) walls, face of concrete, or centerline of column, UNO.
2. Contractor to notify building designer of any discrepancies in the drawings prior to proceeding with work in the affected area.
3. Insulate existing exterior wall stud cavities exposed during construction w/R-15 batt insulation or to full depth of cavity.
4. A minimum of 90% of permanently-installed lamps in the lighting fixtures shall be high-efficacy lamps.
5. All exhaust fans vent to outside. Exhaust fan terminations may must meet requirements of SRC 1506.2 and not terminate within 3' of property lines, operable or inoperable openings, or within 10' of mechanical air intakes except when the termination is 3' above the intake.
6. Top of handrail shall be not less than 34" or more than 38" above the tread nosings. Handrails shall be continuous the full length of the flight. The hand grip portion shall not be less than 1-1/4" or more than 2" in cross-sectional dimension. Handrails adjacent to walls shall have min. 1-1/2" space between the wall & handrail.

K Zeim | Home Design
1329 N 47th Street, #31348
Seattle, WA 98103
(206) 850-9323
kathy@kzeimdesign.com

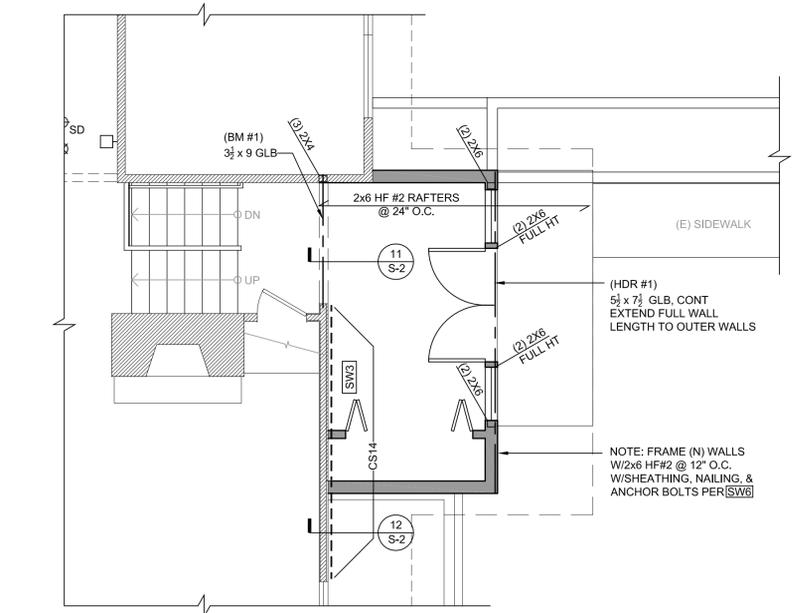

1 ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

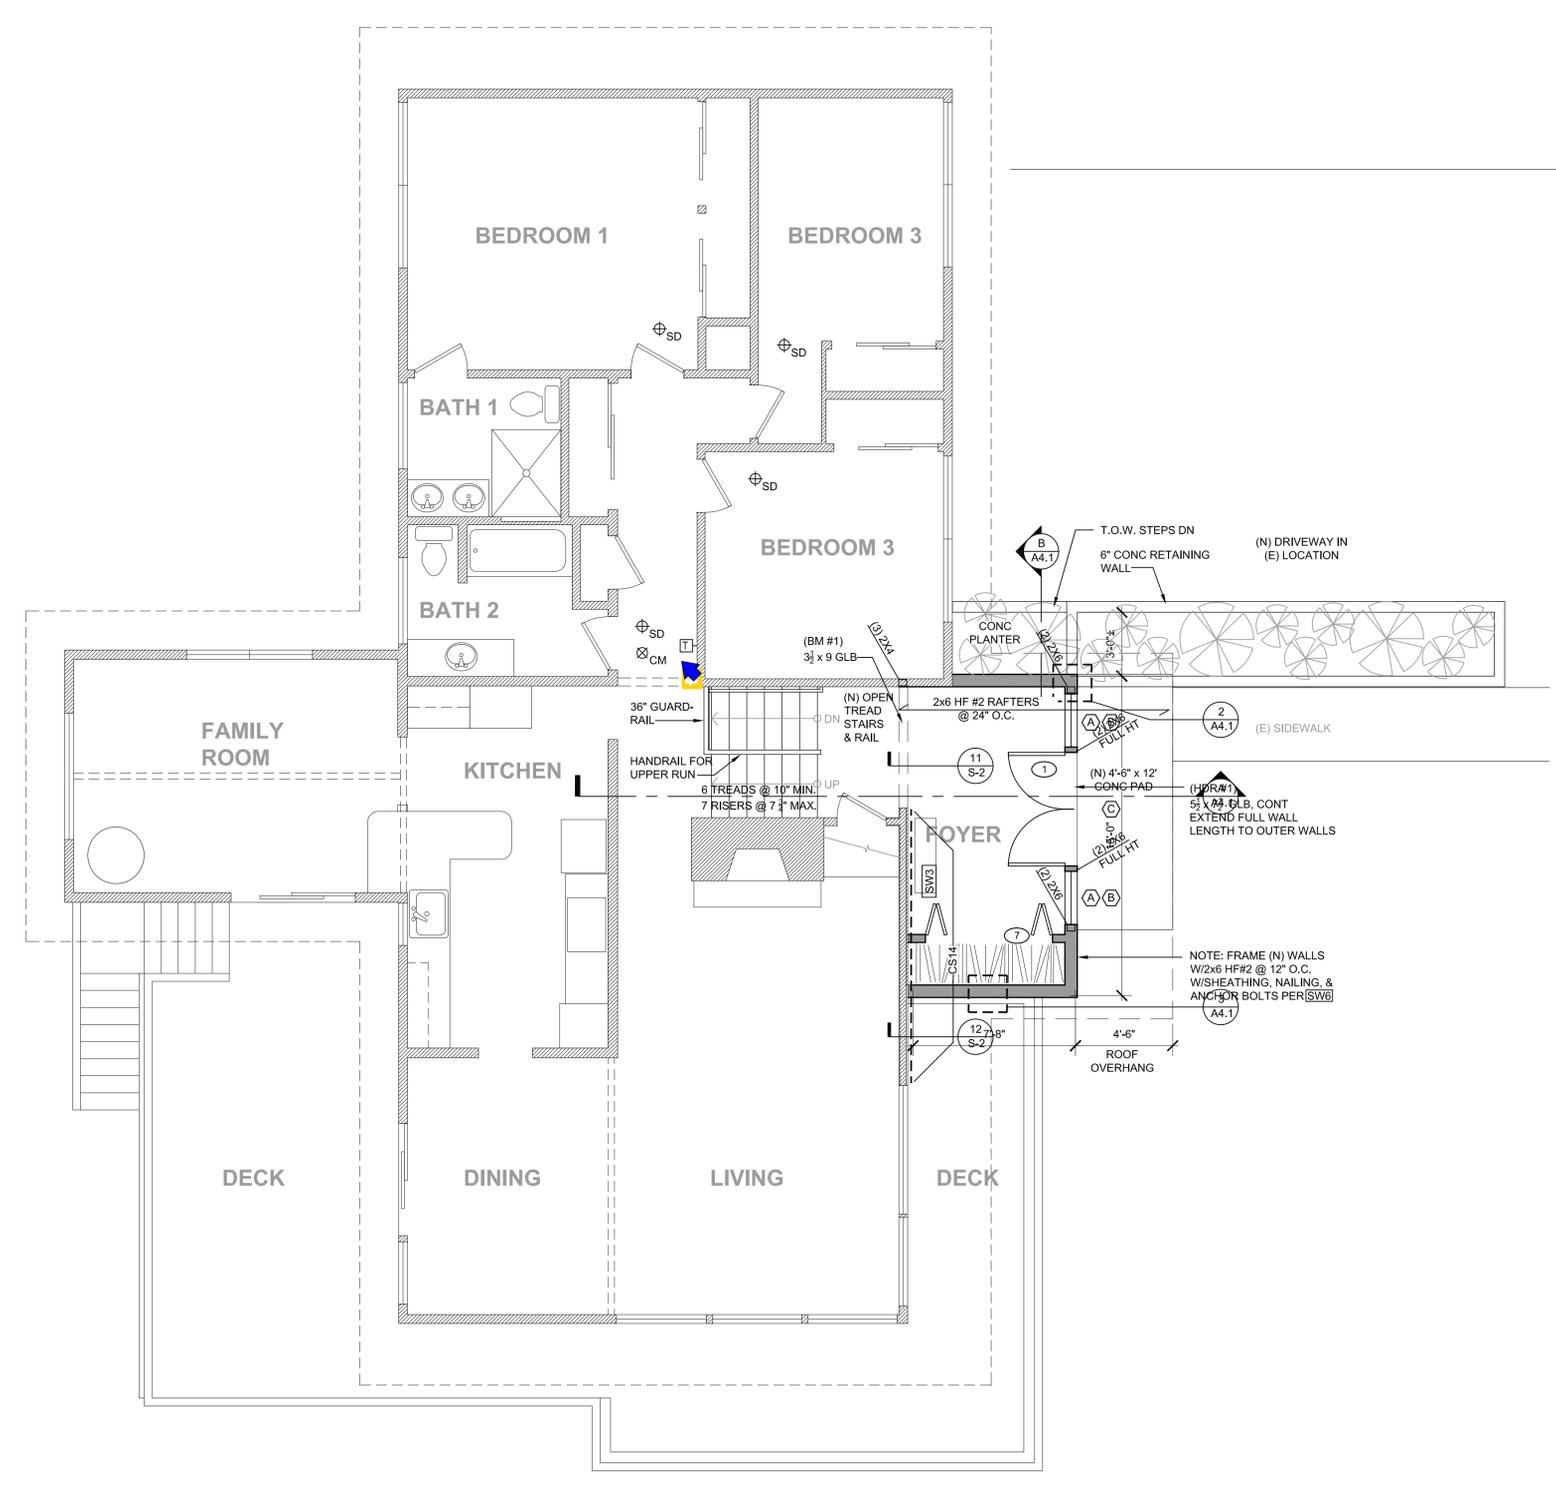

2 FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"

ANDERSON RESIDENCE
14 WEMBLEY LANE
MERCER ISLAND, WA 98040


PERMIT

REV #: DATE: DESCRIPTION:


PLANS & SCHEDULES

A2.2


MARCH 2, 2022

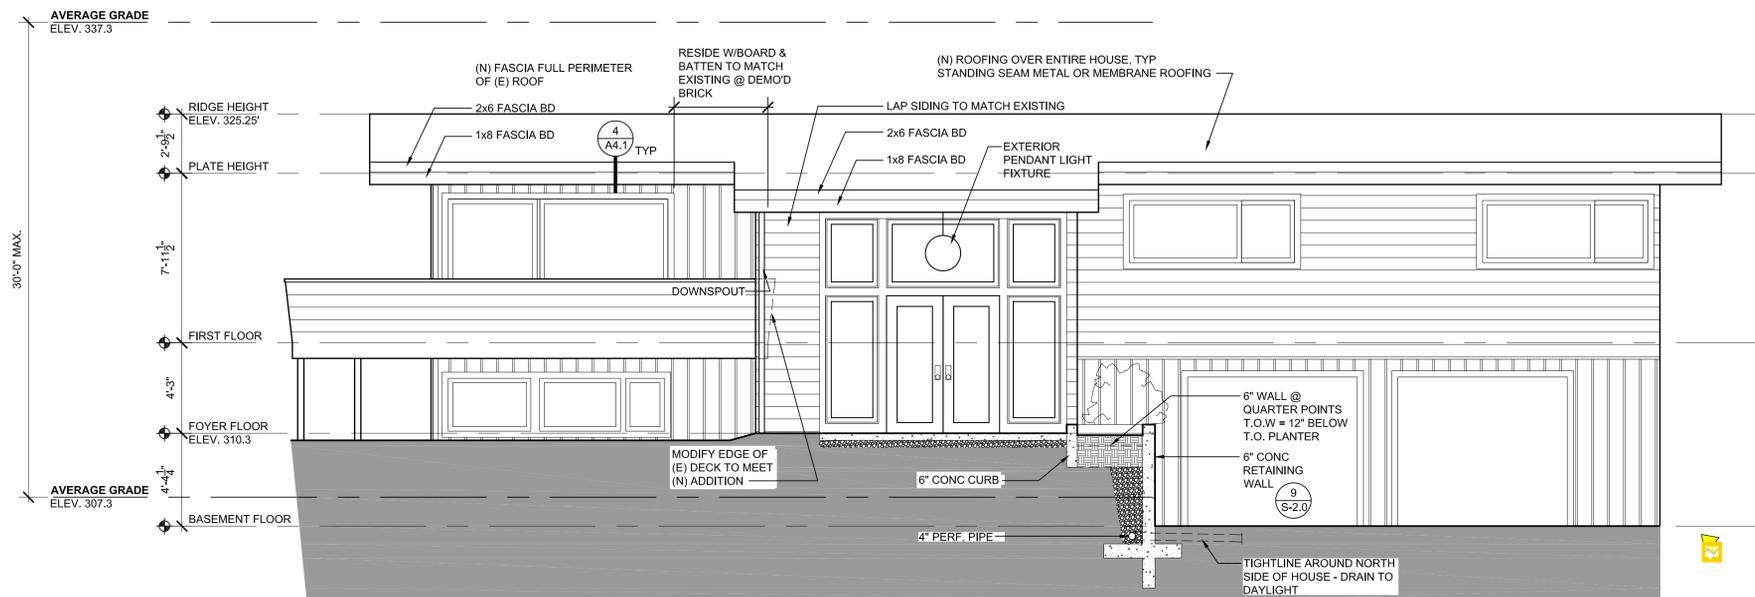

1 EAST ELEVATION
SCALE: 1/4" = 1'-0"

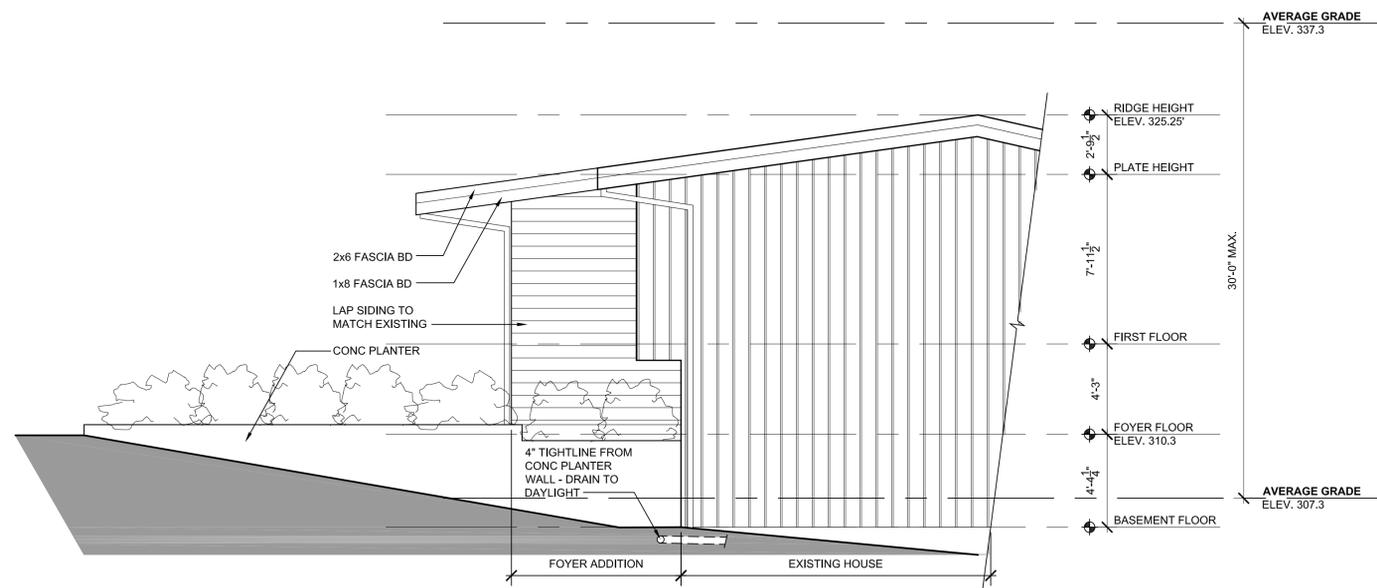

2 NORTH ELEVATION
SCALE: 1/4" = 1'-0"

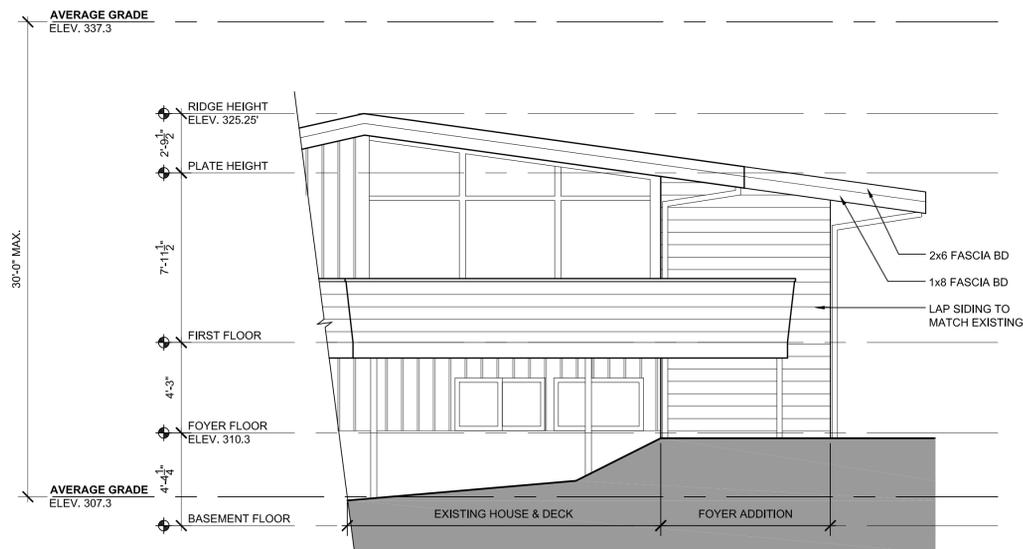

3 SOUTH ELEVATION
SCALE: 1/4" = 1'-0"



K Zeim | Home Design
1329 N 47th Street, #31348
Seattle, WA 98103
(206) 850-9323
kathy@kzeimdesign.com

ANDERSON RESIDENCE
14 WEMBLEY LANE
MERCER ISLAND, WA 98040

PERMIT

REV #: DATE: DESCRIPTION:

ELEVATIONS

A3.1

MARCH 2, 2022



K Zeim | Home Design
 1329 N 47th Street, #31348
 Seattle, WA 98103
 (206) 850-9323
 kathy@kzeimdesign.com

ANDERSON RESIDENCE
 14 WEMBLEY LANE
 MERCER ISLAND, WA 98040


PERMIT

REV #: DATE: DESCRIPTION:

SECTIONS & DETAILS


A4.1

MARCH 2, 2022

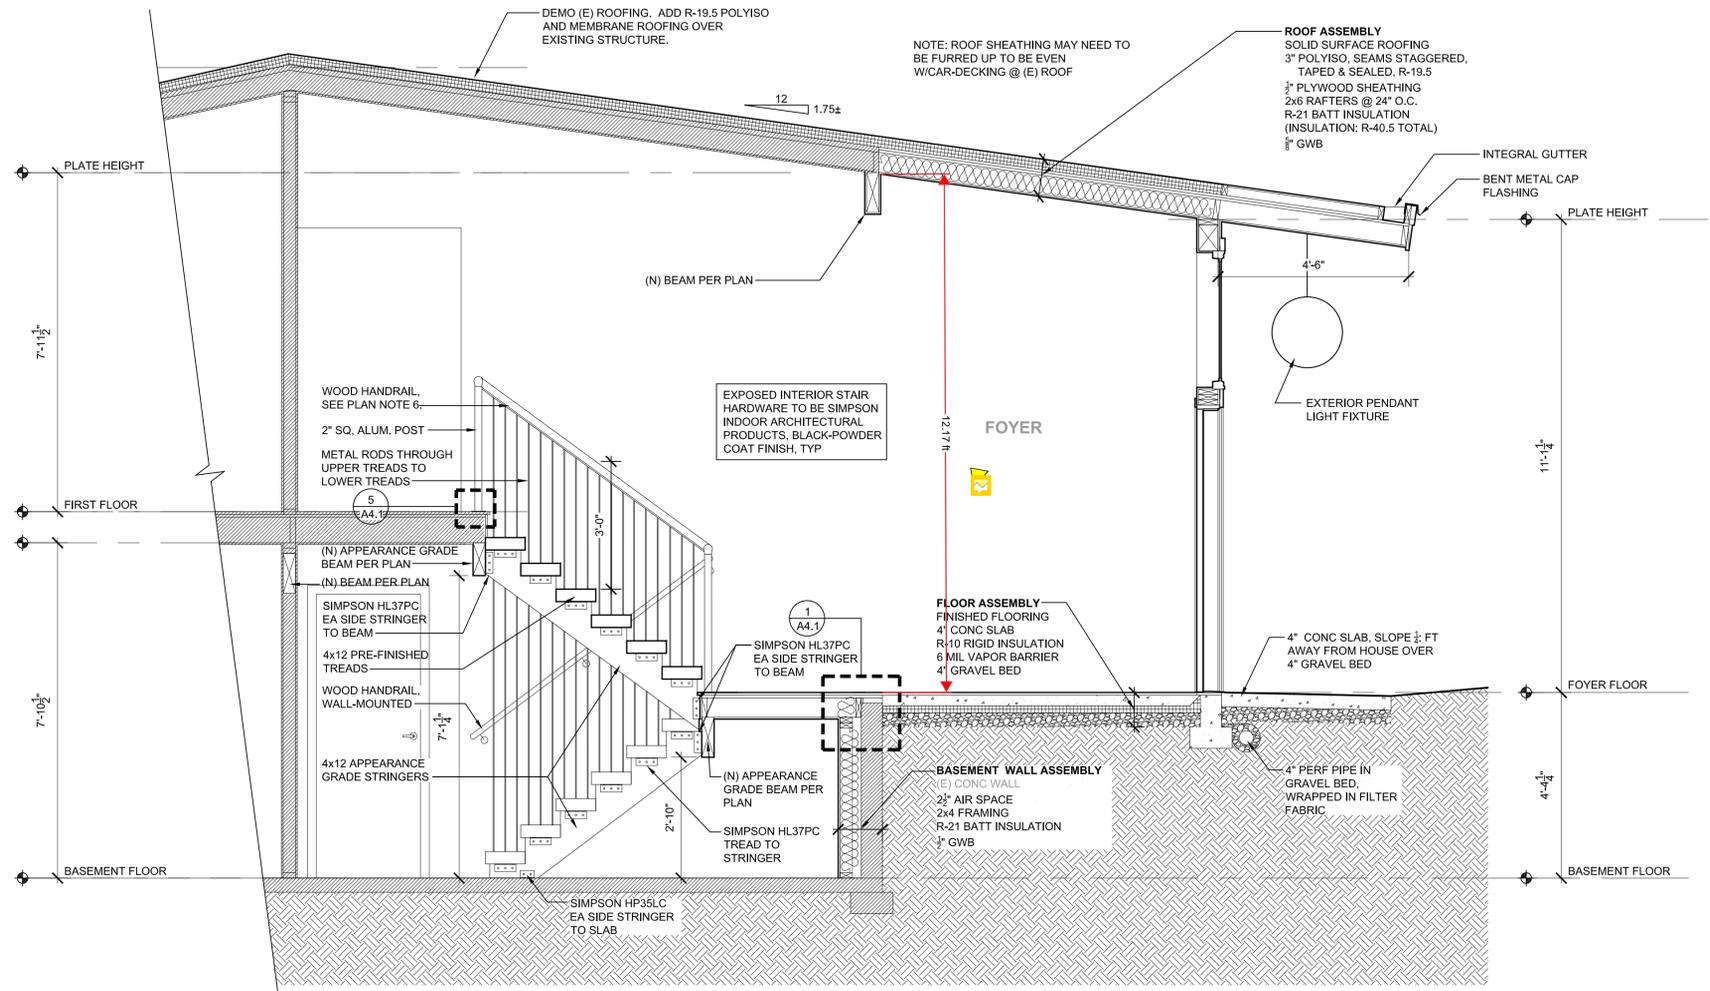


A EAST-WEST SECTION
 SCALE: 1/2" = 1'-0"


1 THRESHOLD DETAIL
 SCALE: 1" = 1'-0"

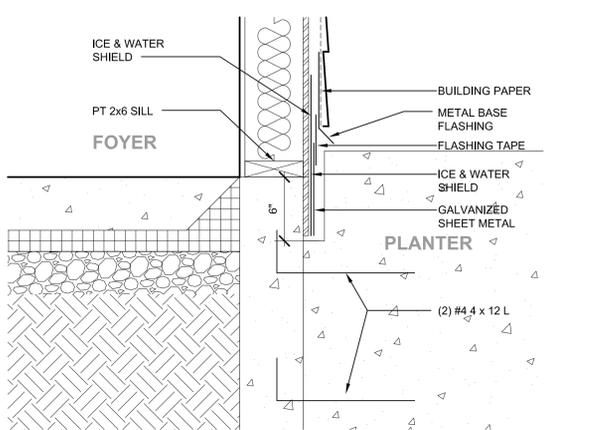


2 PLANTER FLASHING DETAIL
 SCALE: 1 1/2" = 1'-0"

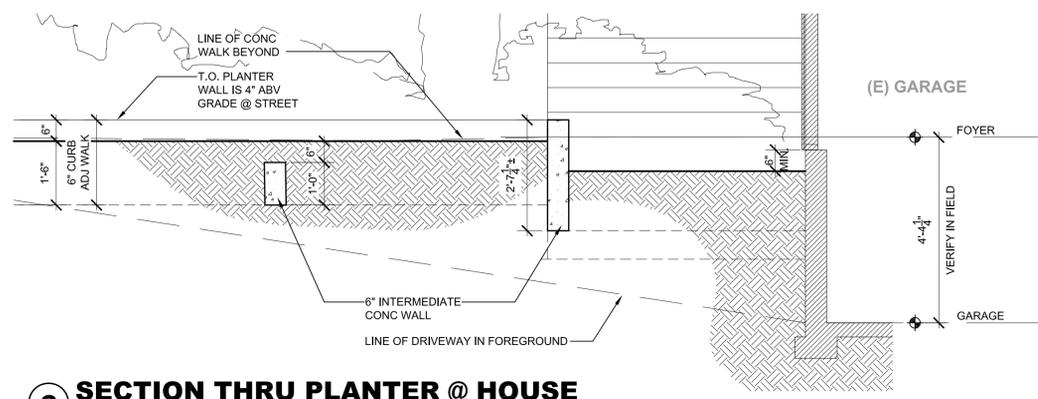


C SECTION THRU PLANTER @ HOUSE
 SCALE: 1/2" = 1'-0"

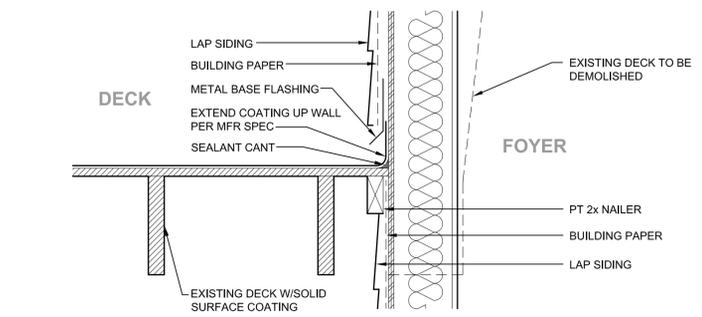


3 DECK TO WALL FLASHING DETAIL
 SCALE: 1 1/2" = 1'-0"

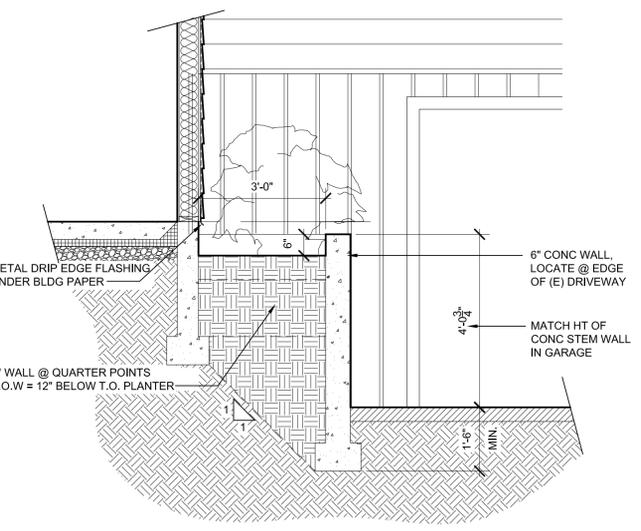

B SECTION THRU PLANTER @ FOYER
 SCALE: 1/2" = 1'-0"

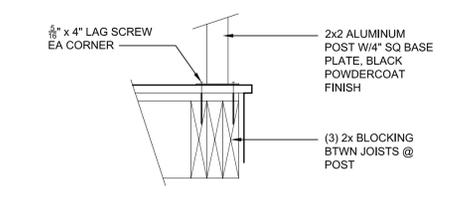

5 RAIL POST CONNECTION
 SCALE: 1 1/2" = 1'-0"

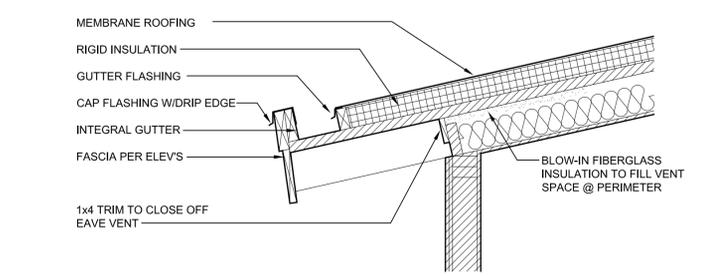

4 DECK TO WALL FLASHING DETAIL
 SCALE: 1 1/2" = 1'-0"

STRUCTURAL NOTES

GENERAL REQUIREMENTS & DESIGN CRITERIA

BUILDING CODE & REFERENCE STANDARDS: THE "INTERNATIONAL BUILDING CODE", 2018 EDITION, GOVERNS THE DESIGN AND CONSTRUCTION OF THIS PROJECT. REFERENCE TO A SPECIFIC SECTION IN THE CODE DOES NOT RELIEVE THE CONTRACTOR FROM COMPLIANCE WITH THE ENTIRE MATERIALS REFERENCE STANDARDS NOTED BELOW. THE LATEST EDITION OF THE MATERIALS REFERENCE STANDARDS SHALL BE USED.

ARCHITECTURAL DRAWINGS: REFER TO THE ARCHITECTURAL DRAWINGS FOR INFORMATION INCLUDING, BUT NOT LIMITED TO: DIMENSIONS, ELEVATIONS, SLOPES, DOOR AND WINDOW OPENINGS, NON-BEARING WALLS, STAIRS, CURBS, DRAINS, DEPRESSIONS, RAILINGS, WATERPROOFING, FINISHES AND OTHER NONSTRUCTURAL ITEMS.

STRUCTURAL RESPONSIBILITIES: THE PE IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE PRIMARY STRUCTURE IN ITS COMPLETED STATE.

CONTRACTOR RESPONSIBILITIES: THE CONTRACTOR IS RESPONSIBLE FOR THE MEANS AND METHODS OF CONSTRUCTION AND ALL JOB RELATED SAFETY STANDARDS SUCH AS OSHA AND WSHA. THE CONTRACTOR IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE STRUCTURE DURING CONSTRUCTION AND SHALL PROVIDE TEMPORARY SHORING, BRACING AND OTHER ELEMENTS REQUIRED TO MAINTAIN STABILITY UNTIL THE STRUCTURE IS COMPLETED. IT IS THE CONTRACTOR'S RESPONSIBILITY TO BE FAMILIAR WITH THE WORK REQUIRED IN THE CONSTRUCTION DOCUMENTS AND THE REQUIREMENTS FOR EXECUTING IT PROPERLY.

DISCREPANCIES: IN CASE OF DISCREPANCIES BETWEEN THESE GENERAL NOTES, THE CONTRACT DRAWINGS AND SPECIFICATIONS, AND/OR REFERENCE STANDARDS, THE ENGINEER SHALL DETERMINE WHICH SHALL GOVERN. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE PROCEEDING WITH THE WORK.

SITE VERIFICATION: THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE PRIOR TO FABRICATION AND/OR CONSTRUCTION. CONFLICTS BETWEEN THE DRAWINGS AND ACTUAL SITE CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER BEFORE PROCEEDING WITH THE WORK. ALL UNDERGROUND UTILITIES SHALL BE DETERMINED BY THE CONTRACTOR PRIOR TO EXCAVATION OR DRILLING.

WIND DESIGN: BASIC WIND SPEED (3-SECOND GUST), V = 85 MPH(ASD); WIND IMPORTANCE FACTOR, IW = 1.0; OCCUPANCY CATEGORY = II; EXPOSURE CATEGORY = B;

SEISMIC DESIGN: SEISMIC IMPORTANCE FACTOR IE = 1.0; OCCUPANCY CATEGORY = II; SS = 1.434G; S1 = 0.498G; SITE CLASS = D; SDS = 1.147G; SD1 = 0.498G; SEISMIC DESIGN CATEGORY = D; BASIC SEISMIC FORCE RESISTING SYSTEM = A-13 (BEARING WALL SYSTEMS) LIGHT-FRAMED WALLS WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR RESISTANCE; CS = 0.124; R = 6.5; ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE PER ASCE 7, SEC 12.8.

SNOW LOAD: GROUND SNOW LOAD, PG = 25 PSF; FLAT ROOF SNOW LOAD, PF = 25 PSF (DRIFT LOADS CONSIDERED PER ASCE 7 WHERE APPLICABLE); SNOW EXPOSURE FACTOR, CE = 1.0; SNOW IMPORTANCE FACTOR, IS = 1.0; THERMAL FACTOR, CT = 1.0.

LIVE LOADS:	ROOF (LIVE)	20 PSF
	ROOF (SNOW)	25 PSF
	RESIDENTIAL FLOOR	40 PSF
	RESIDENTIAL DECK	60 PSF

DEFERRED SUBMITTALS: ITEMS DESIGNED BY OTHERS SHALL INCLUDE CALCULATIONS, SHOP DRAWINGS AND PRODUCT DATA. DESIGN SHALL BE PREPARED BY THE SSE AND SUBMITTED TO THE ARCHITECT AND SER FOR REVIEW PRIOR TO SUBMISSION TO THE JURISDICTION FOR APPROVAL. THE SSE SHALL SUBMIT TO THE ENGINEER FOR REVIEW CALCULATIONS AND SHOP DRAWINGS THAT ARE STAMPED AND SIGNED BY THE SSE. REVIEW OF THE SSE'S SHOP DRAWINGS IS FOR GENERAL COMPLIANCE WITH DESIGN CRITERIA AND COMPATIBILITY WITH THE DESIGN OF THE PRIMARY STRUCTURE AND DOES NOT RELIEVE THE SSE OF RESPONSIBILITY FOR THAT DESIGN. ALL NECESSARY BRACING, TIES, ANCHORAGE, AND PROPRIETARY PRODUCTS SHALL BE FURNISHED AND INSTALLED PER MANUFACTURER'S INSTRUCTIONS OR THE SSE'S DESIGN DRAWINGS AND CALCULATIONS.

INSPECTIONS: ALL CONSTRUCTION IS SUBJECT TO INSPECTION BY THE BUILDING OFFICIAL IN ACCORDANCE WITH IBC SEC 109. THE CONTRACTOR SHALL COORDINATE ALL REQUIRED INSPECTIONS WITH THE BUILDING OFFICIAL. SUBMIT COPIES OF ALL INSPECTION REPORTS TO THE ENGINEER FOR REVIEW.

PREFABRICATED CONSTRUCTION: ALL PREFABRICATED CONSTRUCTION SHALL CONFORM TO IBC SEC 1703.6.

GEOTECHNICAL INSPECTION: THE GEOTECHNICAL ENGINEER OR BUILDING OFFICIAL SHALL INSPECT ALL PREPARED SOIL BEARING SURFACES PRIOR TO PLACEMENT OF CONCRETE AND REINFORCING STEEL AND PROVIDE A LETTER TO THE OWNER STATING THAT SOILS ARE ADEQUATE TO SUPPORT THE "ALLOWABLE FOUNDATION PRESSURE" SHOWN BELOW. SOIL VALUES SHALL BE FIELD VERIFIED BY THE BUILDING OFFICIAL OR THE GEOTECHNICAL ENGINEER PRIOR TO PLACING CONCRETE.

GEOTECHNICAL INSPECTION: THE GEOTECHNICAL ENGINEER OR BUILDING OFFICIAL SHALL INSPECT ALL PREPARED SOIL BEARING SURFACES PRIOR TO PLACEMENT OF CONCRETE AND REINFORCING STEEL AND PROVIDE A LETTER TO THE OWNER STATING THAT SOILS ARE ADEQUATE TO SUPPORT THE "ALLOWABLE FOUNDATION PRESSURE" SHOWN BELOW. SOIL VALUES SHALL BE FIELD VERIFIED BY THE BUILDING OFFICIAL OR THE GEOTECHNICAL ENGINEER PRIOR TO PLACING CONCRETE.

DESIGN SOIL VALUES:

ALLOWABLE BEARING PRESSURE (ASSUMED)	1500 PSF
PASSIVE LATERAL PRESSURE	150 PSF/FT
ACTIVE LATERAL PRESSURE (UNRESTRAINED)	35 PSF/FT
ACTIVE LATERAL PRESSURE (RESTRAINED)	50 PSF/FT
COEFFICIENT OF SLIDING FRICTION	0.25

SLABS-ON-GRADE & FOUNDATIONS: ALL FOUNDATIONS SHALL BEAR ON STRUCTURAL COMPACTED FILL OR COMPETENT NATIVE SOIL PER THE GEOTECHNICAL REPORT. ALL SLABS-ON-GRADE SHALL BE FOUNDED ON APPROPRIATE SUB-GRADE PREPARATION AS NOTED IN THE GEOTECHNICAL REPORT. EXTERIOR PERIMETER FOOTINGS SHALL BEAR NOT LESS THAN 18 INCHES BELOW FINISH GRADE, OR BY THE GEOTECHNICAL ENGINEER AND THE BUILDING OFFICIAL. INTERIOR FOOTINGS SHALL BEAR NOT LESS THAN 12 INCHES BELOW FINISH FLOOR.

COMPACTION: UNLESS OTHERWISE SPECIFIED BY A GEOTECHNICAL ENGINEER, FOOTINGS SHALL BE PLACED ON COMPACTED MATERIAL AND SHALL BE WELL-GRADED GRANULAR MATERIAL WITH NO MORE THAN 5% PASSING A #2 SIEVE. FILLS PLACED SHALL BE IN MAXIMUM 8" LIFTS AND ALL BEARING SOILS SHALL BE COMPACTED TO 95% MAXIMUM DENSITY AT OPTIMUM MOISTURE CONTENT USING THE MODIFIED PROCTOR TEST.

CAST-IN-PLACE CONCRETE & REINFORCEMENT

REFERENCE STANDARDS: CONFORM TO:
 (1) ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE AND COMMENTARY".
 (2) IBC CHAPTER 19.
 (3) ACI 301 "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE", SEC 3 "REINFORCEMENT AND REINFORCEMENT SUPPORTS."

FIELD REFERENCE: THE CONTRACTOR SHALL KEEP A COPY OF ACI FIELD REFERENCE MANUAL, SP-15, "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE (ACI 301) WITH SELECTED ACI AND ASTM REFERENCES."

CONCRETE MIXTURES: CONFORM TO ACI 318 CHAPTER 5 "CONCRETE QUALITY, MIXING, AND PLACING."

MATERIALS: CONFORM TO ACI 318 CHAPTER 3 "MATERIALS" FOR REQUIREMENTS FOR CEMENTITIOUS MATERIALS, AGGREGATES, MIXING WATER AND ADMIXTURES.
 REINFORCING BARS: ASTM A615, GRADE 60, DEFORMED BARS.
 DEFORMED WELDED WIRE FABRIC: ASTM A497
 BAR SUPPORTS: CRSI MSP-2, CHAPTER 3 "BAR SUPPORTS."
 TIE WIRE: 16.5 GAGE OR HEAVIER, BLACK ANNEALED.

MIX DESIGNS: PROVIDE A 5-SACK MINIMUM, 28-DAY COMPRESSIVE STRENGTH F'c = 2,500 PSI CONCRETE MIX WITH MAXIMUM 3/4" AGGREGATE AND 0.50 W/C RATIO FOR ALL ISOLATED POST AND CONTINUOUS WALL FOOTINGS, SLABS-ON-GRADE, AND BASEMENT WALLS EXENDING NO MORE THAN 8" ABOVE FINISH GRADE. ELEVATION. FOR BASEMENT WALLS EXTENDING MORE THAN 8" ABOVE FINISH GRADE AND ALL SITE WALLS, PROVIDE A 5-1/2 SACK MINIMUM F'c = 3,000 PSI CONCRETE MIX WITH MAXIMUM 3/4" AGGREGATE AND 0.50 W/C RATIO.

MIX DESIGN NOTES:

- W/C RATIO: WATER-CEMENTITIOUS MATERIAL RATIOS SHALL BE BASED ON THE TOTAL WEIGHT OF CEMENTITIOUS MATERIALS.
- CEMENTITIOUS CONTENT: THE USE OF FLY ASH, OTHER POZZOLANS, SILICA FUME, OR SLAG SHALL CONFORM TO ACI 301 SEC 4.2.2.8.2. MAXIMUM AMOUNT OF FLY ASH SHALL BE 20% OF TOTAL CEMENTITIOUS CONTENT UNLESS REVIEWED AND APPROVED OTHERWISE BY SER.
- AIR CONTENT: CONFORM TO ACI 301 SEC 4.2.2.4. HORIZONTAL EXTERIOR SURFACES IN CONTACT WITH THE SOIL REQUIRE ENTRAINED AIR. USE "MODERATE EXPOSURE". VERTICAL EXTERIOR SURFACES REQUIRE "MODERATE EXPOSURE". TOLERANCE IS +/- 1-1/2%. AIR CONTENT SHALL BE MEASURED AT POINT OF PLACEMENT.
- SLUMP: CONFORM TO ACI 301 SEC 4.2.2.2. SLUMP SHALL BE DETERMINED AT POINT OF PLACEMENT.
- NON-CHLORIDE ACCELERATOR: NON-CHLORIDE ACCELERATING ADMIXTURE MAY BE USED IN CONCRETE SLABS PLACED AT AMBIENT TEMPERATURES BELOW 50F AT THE CONTRACTOR'S OPTION.

FORMWORK: CONFORM TO ACI 301 SEC 2 "FORMWORK AND FORM ACCESSORIES." REMOVAL OF FORMS SHALL CONFORM TO SEC 2.3.2 EXCEPT STRENGTH INDICATED IN SEC 2.3.2.5 SHALL BE 0.75 F'C.

MEASURING, MIXING, AND DELIVERY: CONFORM TO ACI 301 SEC 4.3.

HANDLING, PLACING, CONSTRUCTING AND CURING: CONFORM TO ACI 301 SEC 5.

REBAR FABRICATION & PLACING: CONFORM TO ACI 301, SEC 3.2.2 "FABRICATION", AND ACI SP-66 "ACI DETAILING MANUAL." CONFORM TO ACI 301, SEC 3.3.2 "PLACEMENT." PLACING TOLERANCES SHALL CONFORM TO SEC 3.3.2.1 "TOLERANCES."

SPICES: CONFORM TO ACI 301, SEC 3.3.2.7. REFER TO PLANS FOR TYPICAL SPICES.

FIELD BENDING: CONFORM TO ACI 301 SEC 3.3.2.8. "FIELD BENDING OR STRAIGHTENING." BAR SIZES #3 THROUGH #5 MAY BE FIELD BENT COLD THE FIRST TIME. OTHER BARS REQUIRE PREHEATING. DO NOT TWIST BARS.

CORNERS BARS: PROVIDE MATCHING-SIZED "L" CORNER BARS FOR ALL HORIZONTAL WALL AND FOOTING BARS WITH THE APPROPRIATE SPICE LENGTH, UNO.

CONCRETE COVER: CONFORM TO THE FOLLOWING COVER REQUIREMENTS FROM ACI 301, TABLE 3.3.2.3:

CONCRETE CAST AGAINST EARTH	3"
CONCRETE EXPOSED TO EARTH OR WEATHER (#5 & SMALLER)	1-1/2"
BARS IN SLABS AND WALLS	3/4"

CONSTRUCTION JOINTS: CONFORM TO ACI 301 SEC 2.2.2.5, 5.1.2.3A, 5.2.2.1, AND 5.3.2.6. CONSTRUCTION JOINTS SHALL BE LOCATED AND DETAILED AS ON THE CONSTRUCTION DRAWINGS. USE OF AN ACCEPTABLE ADHESIVE, SURFACE RETARDER, PORTLAND CEMENT GROUT, OR ROUGHENING THE SURFACE IS NOT REQUIRED UNLESS SPECIFICALLY NOTED ON THE DRAWINGS. WHERE SHEAR BOND IS REQUIRED, ROUGHEN SURFACES TO 1/4" AMPLITUDE.

WOOD FRAMING

REFERENCE STANDARDS: CONFORM TO:

- IBC CHAPTER 23 "WOOD".
- NDS AND NDS SUPPLEMENT - "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION".
- ANSI/TPI 1 "NATIONAL DESIGN STANDARD FOR METAL-PLATE-CONNECTED WOOD TRUSS CONSTRUCTION".

DEFERRED SUBMITTALS: SUBMIT PRODUCT DATA AND PROOF OF ICC APPROVAL FOR FRAMING MEMBERS AND FASTENERS THAT HAVE BEEN DESIGNED BY OTHERS. SUBMIT CALCULATIONS PREPARED BY THE SSE IN THE STATE OF WASHINGTON FOR ALL MEMBERS AND CONNECTIONS DESIGNED BY OTHERS ALONG WITH SHOP DRAWINGS. ALL NECESSARY BRIDGING, BLOCKING, BLOCKING PANELS AND WEB STIFFENERS SHALL BE DETAILED AND FURNISHED BY THE SUPPLIER. TEMPORARY AND PERMANENT BRIDGING SHALL BE INSTALLED IN CONFORMANCE WITH THE MANUFACTURER'S SPECIFICATIONS. DEFLECTION LIMITS SHALL BE AS NOTED UNDER DESIGN LOADS SECTION.

IDENTIFICATION: ALL SAWN LUMBER AND PRE-MANUFACTURED WOOD PRODUCTS SHALL BE IDENTIFIED BY THE GRADE MARK OR A CERTIFICATE OF INSPECTION ISSUED BY THE CERTIFYING AGENCY.

MATERIALS:

- **SAWN LUMBER:** CONFORM TO GRADING RULES OF WMPA, WCLIB OR NLGA. FINGER JOINTED STUDS ACCEPTABLE AT INTERIOR WALLS ONLY.

MEMBER USE	SIZE	SPECIES	GRADE
STUDS & POSTS	2x, 4x	HEM-FIR	NO. 2
RAFTERS	2x4 - 2x10	HEM-FIR	NO. 2
BEAMS	4x8 - 4x12	HEM-FIR	NO. 2
BEAMS	6x8 - 6x12	HEM-FIR	NO. 2
POSTS & TIMBERS	6x, 8x	DOUG-FIR	NO. 2

- **GLUED LAMINATED TIMBER:** CONFORM TO AITC 117 "STANDARD SPECIFICATIONS FOR STRUCTURAL GLUE-LAMINATED TIMBER OF SOFTWOOD SPECIES, MANUFACTURING AND DESIGN" AND ANSI/AITC A190.1 "STRUCTURAL GLUED LAMINATED TIMBER." MEMBER ALL GLUED LAMINATED MEMBERS BEAMS TO 2000' RADIUS, UNLESS SHOWN OTHERWISE ON THE PLANS.

MEMBER USE	SIZES	SPECIES	STRESS CLASS	BEAMS
BEAMS	ALL	DF/DF	24F-1.8E	SIMPLE SPANS
	ALL	DF/DF	24F-1.8E [(--FB)=(+FB)]	CANTILEVER SPANS

- **METAL PLATE CONNECTED WOOD ROOF TRUSSES:** CONFORM TO IBC SEC 2303.4 "TRUSSES".

- **WOOD STRUCTURAL SHEATHING (PLYWOOD):** WOOD APA-RATED STRUCTURAL SHEATHING INCLUDES: ALL VENEER PLYWOOD, ORIENTED STRAND BOARD, WATERBOARD, PARTICLEBOARD, T1-11 SIDING, AND COMPOSITES OF VENEER AND WOOD BASED MATERIAL. CONFORM TO PRODUCT STANDARDS PS-1 AND PS-2 OF THE U.S. DEPT. OF COMMERCE AND THE AMERICAN PLYWOOD ASSOCIATION (APA).

LOCATION	THICKNESS	SPAN RATING	PLYWOOD GRADE	EXPOSURE
ROOF	15/32"	32/16	C-D	1
FLOOR	23/32" T&G	24 OC	STURD-I-FLOOR	1
WALLS	15/32"	32/16	C-D	1
WALLS(ALT)	7/16" OSB	24/16	C-D	1

- **JOIST HANGERS AND CONNECTORS:** SHALL BE "STRONG TIE" BY SIMPSON COMPANY OR USP EQUIVALENT AS SPECIFIED IN THEIR LATEST CATALOGS. ALTERNATE CONNECTORS BY OTHER MANUFACTURERS MAY BE SUBSTITUTED PROVIDED THEY HAVE CURRENT ICC APPROVAL FOR EQUIVALENT OR GREATER LOAD CAPACITIES AND ARE REVIEWED AND APPROVED BY THE SER PRIOR TO ORDERING. CONNECTORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTRUCTIONS. WHERE CONNECTOR STRAPS CONNECT TWO MEMBERS, PLACE 1/2 OF THE NAILS OR BOLTS IN EACH MEMBER. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD. UNLESS NOTED OTHERWISE ALL NAILS SHALL BE FULL LENGTH COMMON. NAIL STRAPS TO WOOD FRAMING AS LATE AS POSSIBLE IN THE FRAMING PROCESS TO ALLOW THE WOOD TO SHRINK AND THE BUILDING TO SETTLE.

- **NAILS AND STAPLES:** CONFORM TO IBC SEC 2303.6 "NAILS AND STAPLES." UNLESS NOTED ON PLANS, NAIL PER IBC TABLE 2304.9.1. UNLESS NOTED OTHERWISE ALL NAILS SHALL BE COMMON. NAIL SIZES SPECIFIED ON THE DRAWINGS ARE BASED ON THE FOLLOWING SPECIFICATIONS:

SIZE	LENGTH	DIAMETER
8d	2-1/2"	0.131"
10d	3"	0.148"
(8d & 10d ALTERNATIVE)	2-3/8"	0.113"
12d (16d SINKER)	3-1/4"	0.148"
16d	3-1/2"	0.162"

- **LAG BOLTS/BOLTS:** CONFORM TO ASTM A307.

NAILING REQUIREMENTS: PROVIDE MINIMUM NAILING IN ACCORDANCE WITH IBC TABLE 2304.9.1 "FASTENING SCHEDULE" EXCEPT AS NOTED ON THE DRAWINGS. NAILING FOR ROOF/FLOOR DIAPHRAGMS/SHEAR WALLS SHALL BE PER DRAWINGS. NAILS SHALL BE DRIVEN FLUSH AND SHALL NOT FRACTURE THE SURFACE OF SHEATHING.

STANDARD LIGHT-FRAME CONSTRUCTION: UNLESS NOTED ON THE PLANS, CONSTRUCTION SHALL CONFORM TO IBC SEC 2308 "CONVENTIONAL LIGHT-FRAME CONSTRUCTION" AND IBC SEC 2304 "GENERAL CONSTRUCTION REQUIREMENTS."


(1) **WALL FRAMING:** UNLESS OTHERWISE NOTED, ALL INTERIOR WALLS SHALL BE 2X4 @ 16"OC AND ALL EXTERIOR WALLS SHALL BE 2X6 @ 16"OC. PROVIDE (2)BUNDLED STUDS MIN AT WALL ENDS AND EACH SIDE OF ALL OPENINGS. UNO, ALL SOLID SAWN LUMBER HEADERS SHALL BE SUPPORTED BY A MINIMUM OF (1)TRIM AND (1)KING STUD AND ALL GLULAM OR ENGINEERED WOOD HEADERS BY (2)TRIM AND (2)KING STUDS. AT FRAMED WALLS, UNO, ALL SOLID SAWN LUMBER BEAMS SHALL BE SUPPORTED ON A MINIMUM OF (2) BUNDLED 2X STUDS AND ALL GLULAM OR ENGINEERED WOOD BEAMS ON A MINIMUM OF (3) BUNDLED 2X STUDS. STITCH-NAIL BUNDLED STUDS WITH (2)10 @ 12"OC, UNO, ALL INTERIOR AND EXTERIOR HEADERS SHALL BE 4X6. PROVIDE SOLID BLOCKING THRU FLOORS TO SUPPORTS BELOW FOR BEARING WALLS AND POSTS. UNO, ATTACH BOTTOM PLATES OF STUD WALLS TO WOOD FRAMING BELOW WITH 16 @ 12"OC OR TO CONCRETE WITH 5/8"-DIA. ANCHOR BOLTS X 7" EMBEDMENT AT 48"OC. REFER TO SHEAR WALL SCHEDULE FOR SPECIFIC SHEATHING, STUD, AND NAILING REQUIREMENTS AT SHEAR WALLS. UNO, PROVIDE GYPSUM SHEATHING ON INTERIOR SURFACES AND PLYWOOD SHEATHING ON EXTERIOR SURFACES.

(2) **ROOF/FLOOR FRAMING:** UNLESS OTHERWISE NOTED, PROVIDE DOUBLE JOISTS/RAFTERS UNDER ALL PARALLEL BEARING PARTITIONS AND SOLID BLOCKING AT ALL BEARING POINTS. PROVIDE DOUBLE JOISTS AROUND ALL ROOF/FLOOR OPENINGS. UNO, MULTI-JOISTS/RAFTERS SHALL BE STITCH-NAILED TOGETHER WITH (2)10 @ 12"OC. PROVIDE ROOF SHEATHING EDGE CLIPS CENTERED BETWEEN FRAMING AT UNBLOCKED PLYWOOD EDGES. ALL FLOOR SHEATHING SHALL HAVE TONGUE AND GROOVE JOINTS OR BE SUPPORTED BY SOLID BLOCKING. ALLOW 1/8" SPAACING AT ALL PANEL EDGES AND ENDS OF ROOF/FLOOR SHEATHING. ROOF/FLOOR SHEATHING SHALL BE LAID FACE GRAIN PERPENDICULAR TO FRAMING MEMBERS.


MOISTURE CONTENT: WOOD MATERIAL USED FOR THIS PROJECT SHALL HAVE MAXIMUM MOISTURE CONTENT OF 19% EXCEPT FOR THE PRESSURE-TREATED WOOD SILL PLATE.

PRESERVATIVE TREATMENT: WOOD MATERIALS ARE REQUIRED TO BE "TREATED WOOD" UNDER CERTAIN CONDITIONS IN ACCORDANCE WITH IBC SEC 2304.11 "PROTECTION AGAINST DECAY AND TERMITES". CONFORM TO THE APPROPRIATE STANDARDS OF THE AMERICAN WOOD-PRESERVERS ASSOCIATION (AWPA) FOR SAWN LUMBER, GLUED LAMINATED TIMBER, ROUND POLES, WOOD PILES AND MARINE PILES. FOLLOW AMERICAN LUMBER STANDARDS COMMITTEE (ALSC) QUALITY ASSURANCE PROCEDURES. PRODUCTS SHALL BEAR THE APPROPRIATE MARK.

METAL CONNECTORS/PT WOOD: CK ENGINEERING LLC RECOMMENDS THAT ALL METAL HARDWARE AND FASTENERS IN CONTACT WITH PRESSURE TREATED LUMBER BE STAINLESS STEEL TYPE 316L. AT THE OWNER'S RISK AND DISCRETION, HOT-DIPPED GALVANIZED METAL HARDWARE AND FASTENERS MAY BE INVESTIGATED FOR USE IN LIEU OF STAINLESS STEEL PROVIDED THAT THE FINISH HAS A MINIMUM ZINC CONTENT OF AT LEAST 1.85 OZ/SF AND ITS USE IS COORDINATED BY THE CONTRACTOR AND WOOD SUPPLIER FOR THE EXPECTED ENVIRONMENT AND MOISTURE EXPOSURE FOR APPROPRIATE USE BASED ON THE METHOD OF PRESERVATIVE TREATMENT OF THE WOOD.



DETAIL A

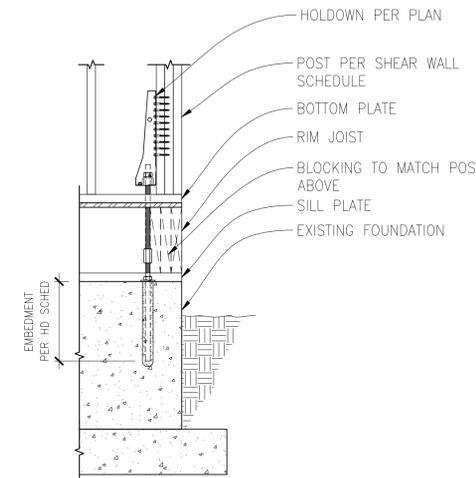

ALL-THREAD ROD INSTALLATION INTO EXISTING FOUNDATION

SCALE: N.T.S.

7

MODEL # (1)	ANCHORAGE TYPE (4,5,6)	FASTENERS	END STUD REQUIRED (2,5)	CAPACITY (LBS)	
				DOUG-FIR	HEM-FIR
CS14	FLR-TO-FLR STRAP (E.L.=19")	(30) 10d COMMON	2x STUD	2,490	2,490
HDU4	5/8" dia ALL-THREAD ROD W/ 10" EPOXY EMBED INTO CONC.	(10) 1/4"x2 1/2" SDS WOOD SCREWS	(2) 2x STUDS	3,285	3,285

NOTES:

- HOLDOWNS SPECIFIED ARE AS MANUFACTURED BY SIMPSON ANCHOR TIE DOWN CO., INC; ACCEPTABLE EQUIVALENT PRODUCT SUBSTITUTIONS ARE AVAILABLE FROM OTHER MANUFACTURERS WITH SER APPROVAL.
- LOCATE END HOLDOWNS AT ENDS OF ALL SHEAR WALLS & FASTEN TO BUNDLED END STUDS.
- BUNDLED END STUDS SHOULD BE STITCH-NAILED TOGETHER USING MINIMUM (2) 16 @ 10"OC, UNO.
- LOCATE "HDU4", "LSTD4" & "STD4" HOLDOWNS AT CONCRETE FOUNDATION LEVEL. (DETAIL B & C)
- LOCATE "CS#", "MST", "MSTC#" & "CMST#" STRAPS AT FLOOR-TO-FLOOR CONNECTIONS. (DETAIL A)
- ALL HOLDOWN ANCHOR BOLTS SHALL BE MIN 5" FROM CONCRETE WALL ENDS.
- USE "SSIB" FOR 2x SILL PLATES & "SSIBL" FOR 3x SILL PLATES.
- ADDITIONAL END STUD REQUIRED TO MEET MINIMUM 1 1/2" EDGE DISTANCE FROM CONCRETE CORNER TO "STD" STRAP. USE "TR" STYLE WITH "STD" WHERE RIM JOIST IS PRESENT.
- INSTALL ALL HOLDOWN HARDWARE PER MANUFACTURER'S INSTRUCTIONS & RECOMMENDATIONS.
- USE SIMPSON SET-XP EPOXY FOR ANCHOR BOLT TO EXISTING CONCRETE INSTALLATION

SCALE: N.T.S.

8

WOOD-FRAMED SHEAR WALL SCHEDULE

FOR HEM-FIR/DOUG-FIR STUD FRAMING

SW TYPE	SW SHEATHING APA-RATED [1, 2, 12]	NAIL SIZE & SPACING @ PANEL EDGES [4, 5, 6]	RIM JOIST OR BLOCKING ATTACHMENT TO TOP PLATE BELOW [8, 9]	BOTTOM PLATE & EDGE MEMBER REQUIREMENTS [3, 7, 13]		SILL PLATE REQUIREMENTS		SHEAR LOAD CAPACITY (PLF)
				SHEAR NAILING TO WOOD FRAMING BELOW	BOTTOM R AT FRAMING [15]	ANCHOR BOLT TO CONCRETE FOUNDATION [10]	SILL R AT FOUNDATION [11]	
SW-6	15/32" CD-EXT	0.131" x 2 1/2" @ 6"OC	CLIP @ 18"OC	0.148" x 3 1/4" @ 6"OC	2x	5/8" @ 48"OC	P.T. 2x	260
SW-4	15/32" CD-EXT	0.131" x 2 1/2" @ 4"OC	CLIP @ 14"OC	0.148" x 3 1/4" @ 4"OC	3x	5/8" @ 32"OC 5/8" @ 48"OC	P.T. 2x P.T. 3x [15]	380
SW-3	15/32" CD-EXT	0.131" x 2 1/2" @ 3"OC, STAGGERED	CLIP @ 12"OC	0.148" x 3 1/4" @ 4"OC & CLIP @ 18"OC	3x	5/8" @ 24"OC 5/8" @ 32"OC	P.T. 2x P.T. 3x [15]	490

NOTES:

- INSTALL PANELS EITHER HORIZONTALLY OR VERTICALLY
- WHERE SHEATHING IS APPLIED ON BOTH SIDES OF WALL, PANEL EDGE JOINTS ON 2x FRAMING SHALL BE STAGGERED SO THAT JOINTS ON OPPOSITE SIDES ARE NOT LOCATED ON THE SAME STUDS.
- BLOCKING IS REQUIRED AT ALL PANEL EDGES.
- PROVIDE SHEAR WALL SHEATHING AND NAILING FOR ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF FULL HEIGHT WALLS ARE DESIGNATED BY WINDOWS, OR DOORWAYS OR AS DESIGNATED ON PLANS. HOLDOWN REQUIREMENTS PER PLANS.
- SHEAR WALLS DESIGNATED AS PERFORATED SHEAR WALLS REQUIRE SHEATHING, SHEAR WALL NAILING, ETC. ABOVE AND BELOW ALL OPENINGS.
- SHEATHING EDGE NAILING IS REQUIRED AT ALL HOLDOWN POSTS. EDGE NAILING MAY ALSO BE REQUIRED TO EACH STUD USED IN BUILT-UP HOLDOWN POSTS. ADDITIONAL INFORMATION PER HOLDOWN SCHEDULE & DETAILS.
- INTERMEDIATE FRAMING TO BE 2x MINIMUM MEMBERS. ATTACH SHEATHING TO INTERMEDIATE FRAMING WITH 0.148" x 2 1/2" NAILS AT 12"OC WHERE STUDS ARE SPACED AT 16"OC AND 0.148" x 2 1/2" NAILS AT 6"OC WHERE STUDS ARE SPACED AT 24"OC.
- BASED ON 0.131" x 1 1/2" NAILS USED TO ATTACH FRAMING CLIPS DIRECTLY TO FRAMING. USE 0.131" x 2 1/2" NAILS WHERE INSTALLED OVER SHEATHING.
- FRAMING CLIPS: SIMPSON "A35" OR "LTP5" OR APPROVED EQUIVALENT.

WOOD-FRAMED SHEAR WALL SCHEDULE

SCALE: N.T.S.

12



CK ENGINEERING LLC
 PROFESSIONAL STRUCTURAL
 ENGINEERING SERVICES
 19105 36th Ave. W. Suite 205
 Lynnwood, WA 98036
 Phone: (206) 417-0670



3/2/2022


ANDERSON RESIDENCE

14 WEMBLEY LANE
 MERCER ISLAND, WA 98040

REVISION #	DATE	DESCRIPTION


Drawn By: PK
 Checked By: SC
 Date: 3-2-2022

CK JOB NO.
22-007

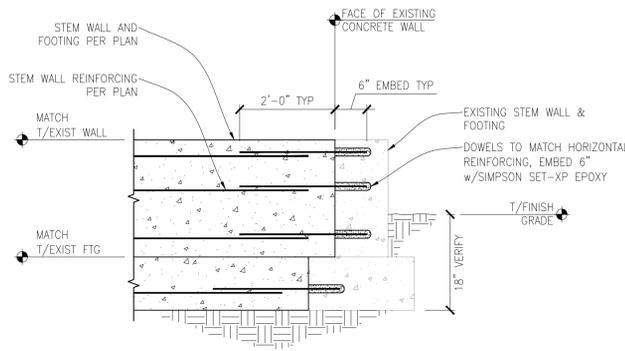


NEW FOUNDATION CONNECTION TO EXISTING

SCALE: 3/4" = 1'-0"

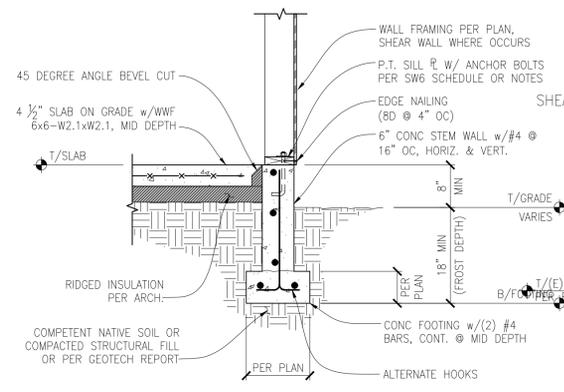


TYPICAL FOUNDATION FOOTING AND STEM WALL WITH SLAB ON GRADE

SCALE: 3/4" = 1'-0"

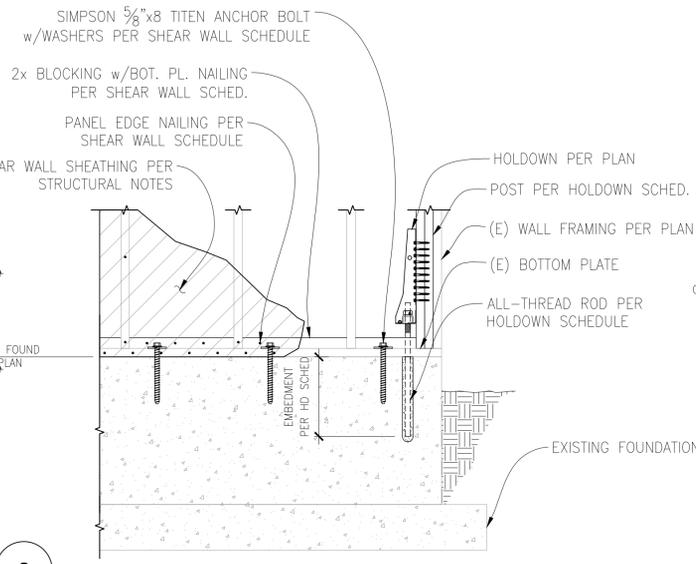


NEW SHEAR WALL TO EXISTING FOUNDATION CONNECTION

SCALE: N.T.S.

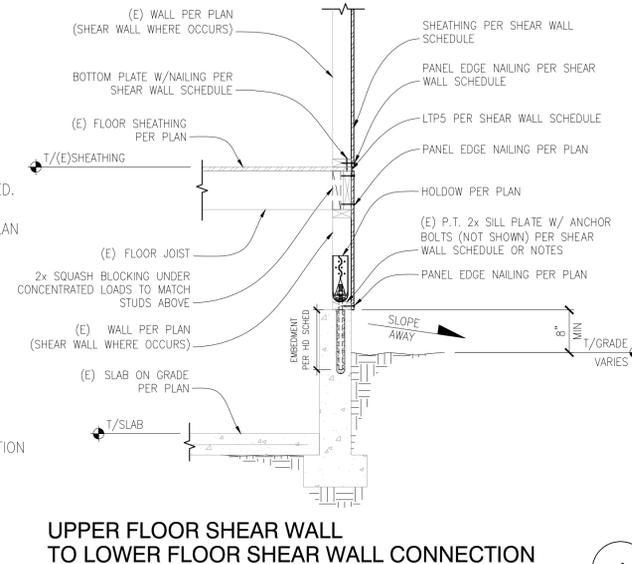

UPPER FLOOR SHEAR WALL TO LOWER FLOOR SHEAR WALL CONNECTION

SCALE: 3/4" = 1'-0"

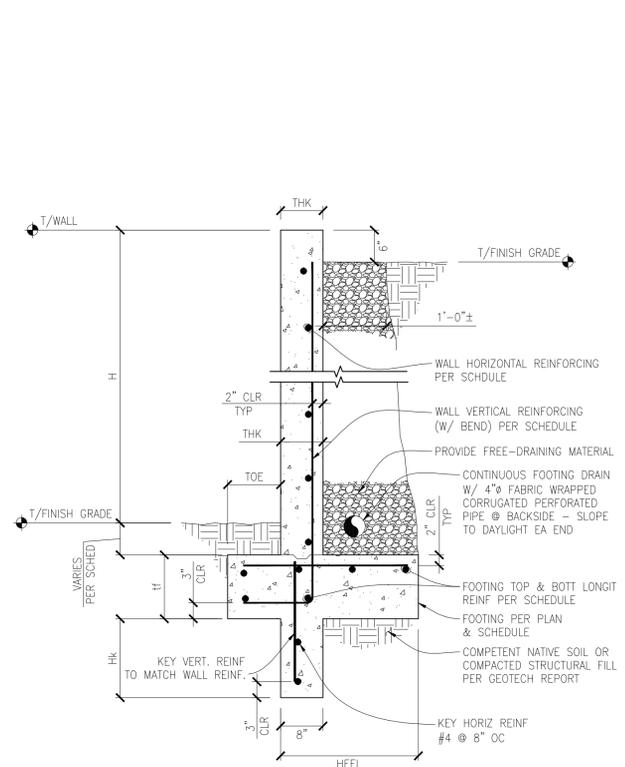


RETAINING WALL/FOOTING SCHEDULE

WALL		FOOTING								
SIZE	REINFORCEMENT	SIZE	REINFORCEMENT				HT			
HT (MAX)	THK	VERTICAL	HORIZONTAL	TOE	HEEL	DEPTH	TOP/TRANSV	TOP/LONGIT	BOTTOM/LONGIT	Hk
4'-0"	6"	#4 @ 12"OC	#4 @ 12"OC	1'-3"	1'-6"	10"	#4 @ 12"OC	(3) #4	(2) #4	17"
6'-0"	6"	#4 @ 8"OC	#4 @ 12"OC	2'-3"	1'-6"	10"	#4 @ 12"OC	(3) #4	(3) #4	33"


LANDSCAPE RETAINING WALL & SCHEDULE

SCALE: N.T.S.

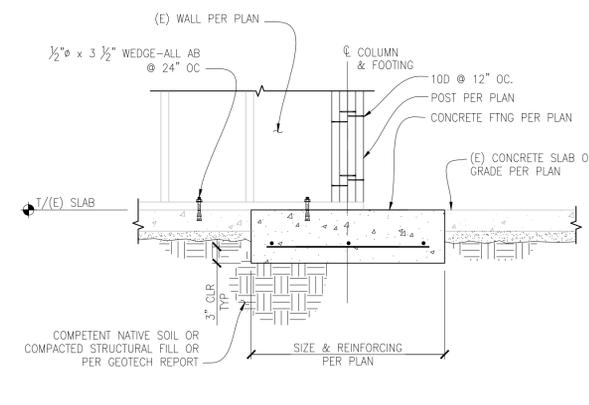

NEW FOOTING/POST CONNECTION


SCALE: 3/4" = 1'-0"

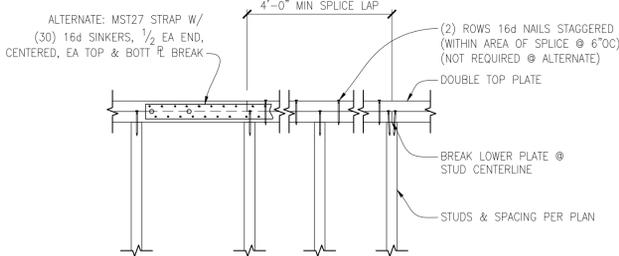

NOTE: FLOOR JOISTS NOT SHOWN FOR CLARITY.


TYPICAL PLATE SPLICE DETAIL

SCALE: N.T.S.

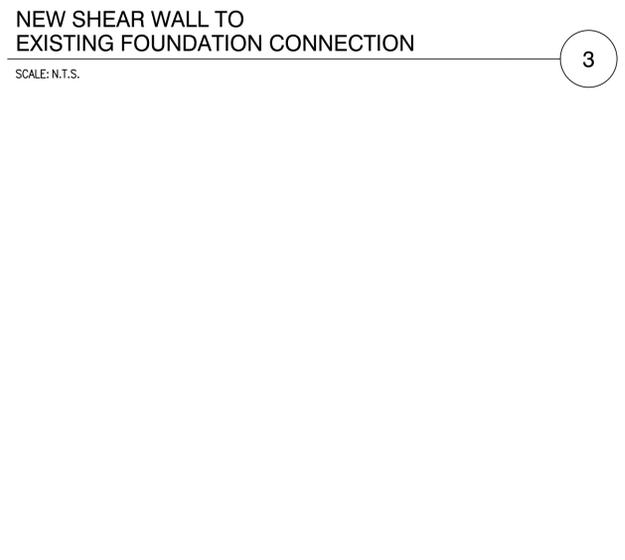


TYPICAL PLAN VIEW - SHEAR WALL HOLDOWNS & ANCHOR BOLTS

SCALE: 1" = 1'-0"

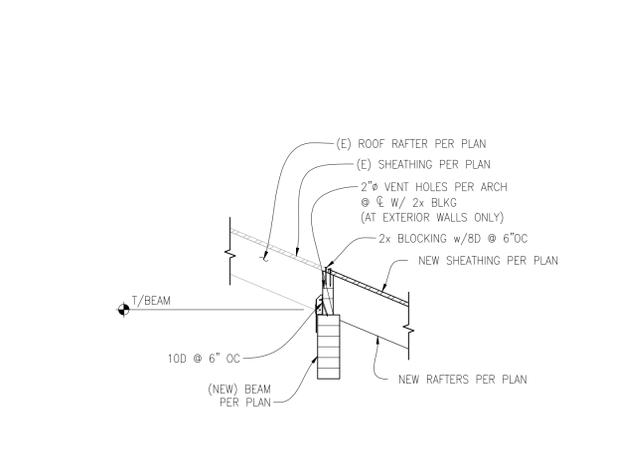

EXISTING/NEW RAFTER TO NEW BEAM CONNECTION

SCALE: 1" = 1'-0"

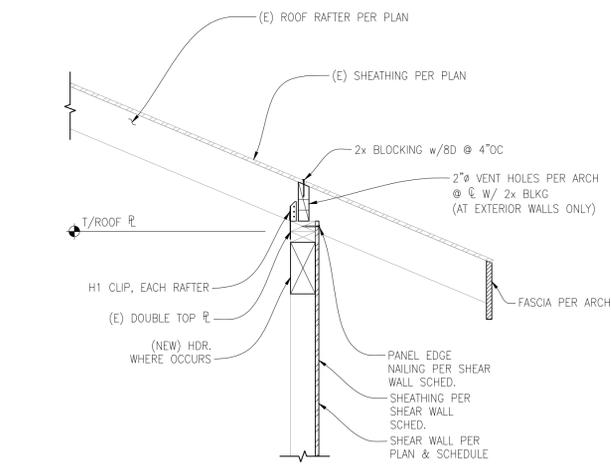

SHEAR WALL PERPENDICULAR TO ROOF RAFTER

SCALE: 1" = 1'-0"



CK ENGINEERING LLC
PROFESSIONAL STRUCTURAL ENGINEERING SERVICES
19105 36th Ave W, Suite 205
Lynnwood, WA 98036
Phone: (206) 417-0670



3/2/2022

ANDERSON RESIDENCE
14 WEMBLEY LANE
MERCER ISLAND, WA 98040

REVISION #	DATE	DESCRIPTION

Drawn By: PK
Checked By: SC
Date: 3-2-2022

CK JOB NO.
22-007

STRUCTURAL
DETAILS

S-2.0