

# Structural Calculations Cover Sheet

**Project Number:** 2022.033  
**Project Name:** Nguyen


**Date:** April 21, 2022  
**Architect:**

**Structural Design For:** Structural design for a remodel and new upper story for an existing residence.

**Construction Type:** Conventional wood framing with conventional concrete foundation.

## CODES

2018 International Building Code (IBC)  
2018 NDS  
ASCE 7-16

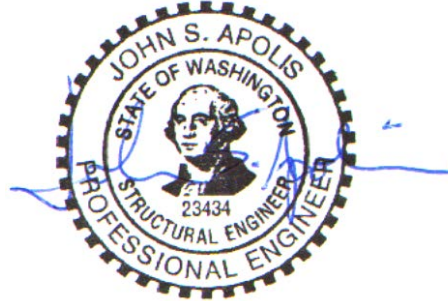

## LOADS

Dead Loads As required  
Floor Load 40 psf  
Wind 110 mph, Exposure B, Per ASCE 7-10 Section 28,  $K_{zt} = 1.38$   
Seismic Per ASCE 7-10 Section 12  
Peak Ground Accelerations (PGA) based on USGS Hazards Program 2003, by Lat/Lon.  
PGA 1 sec = .503    PGA .2 sec = 1.451    %V = .149 \* DL

## Material Design Values

Soils (assumed) Minimum 1,500 psf allowed bearing (subject to field verification)  
Concrete  $f_c = 2,500$  psi; 5-1/2 sack mix, or alternate mix pre-approved by bldg. dept.  
Reinforcing Grade 60;  $F_y = 60,000$  psi minimum  
Sawn Lumber Joists, Rafters: Hem-Fir #2 and better  
Beams, Posts: DF-L #2  
Studs & Plates: Hem-Fir Standard  
Glu-Lam Beams 24F-V4 for simple span beams, 24F-V8 for cantilevered beams  
Parallam Beams 2.2E PSL,  $F_b = 2,900$  psi,  $F_v = 290$  psi,  $E = 2.2 \times 10^6$  psi (minimum)  
Microllam Beams 1.9E LVL,  $F_b = 2,600$  psi,  $F_v = 285$  psi,  $E = 1.9 \times 10^6$  psi (minimum)  
Timberstrand Bms 1.7E LSL,  $F_b = 2,600$  psi,  $F_v = 400$  psi,  $E = 1.7 \times 10^6$  psi (minimum)  
Anchor Bolts F1554 Anchor Bolts, A307 other bolts

CONSULTING STRUCTURAL ENGINEERING SERVICES, INC.

6311 - 17th Avenue NE, Seattle WA 98115 (206) 527-1288 email john@cses-engineering.com  
Structural Engineering Consulting and Design

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 6-Apr-22

Architect:

Page number: R 1

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:**

Typical Roof Headers

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	6.67 ft	Tributary Width:	2 ft	P Location:	6.67 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:		Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	100 lbs	DL Reaction 2:	100 lbs	Note: Design automatically uses ASD load combinations
LL Reaction 1:	0 lbs	LL Reaction 2:	0 lbs	
SL Reaction 1:	167 lbs	SL Reaction 2:	167 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>267 lbs</b>	Total Reaction 2:	<b>267 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	1173 psi
Fv	150 psi	Fv'	173 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	360		
Max. allowed total defl:	0.33 in	Max LL defl:	0.22 in
Total defl. * I:	2.74 in^4	Required I:	8.22 in^4
LL defl. * I:	1.71 in^4	Required I:	7.7 in^4
Actual deflections: TOTAL:	0.03 in		0.02 in

**Force analysis:**

Max. moment:	445 ft-lb	Max Shear:	267 lbs
--------------	-----------	------------	---------

**Selected Member: (2) HF#2 1.5 x 7.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	95.27 in^4	8.22 in^4
Section Modulus:	26.28 in^3	4.55 in^3
Section Area:	21.75 in^2	2.32 in^2
Bearing Area:		0.66 in^2
Minimum bearing dimensions:	3. in x	0.22 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: R 2

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** West 6 ft Window Headers

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	6.67 ft	Tributary Width:	15 ft	P Location:	6.67 ft
Add'l uniform DL:		DL unit load:	20 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	20 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	1001 lbs	DL Reaction 2:	1001 lbs	Note: Design automatically uses ASD load combinations
LL Reaction 1:	1001 lbs	LL Reaction 2:	1001 lbs	
SL Reaction 1:	1251 lbs	SL Reaction 2:	1251 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>2689 lbs</b>	Total Reaction 2:	<b>2689 lbs</b>	

**Material Properties:**

E	1.8 msi	E'	1.8 msi
Fb	2400 psi	Fb'	2760 psi
Fv	265 psi	Fv'	305 psi
Fc perp	650 psi	Fc perp'	650 psi
Emin	0.95 msi	Emin'	0.95 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	360		
Max. allowed total defl:	0.33 in	Max LL defl:	0.22 in
Total defl. * I:	24.12 in^4	Required I:	72.33 in^4
LL defl. * I:	16.7 in^4	Required I:	75.11 in^4
Actual deflections:	TOTAL: 0.2 in		0.14 in

**Force analysis:**

Max. moment:	4484 ft-lb	Max Shear:	2689 lbs
--------------	------------	------------	----------

**Selected Member: (1) GLB 3.5 x 7.5**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	123.05 in^4	75.11 in^4
Section Modulus:	32.81 in^3	19.49 in^3
Section Area:	26.25 in^2	13.23 in^2
Bearing Area:		4.14 in^2
Minimum bearing dimensions:	3.5 in x	1.18 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 1

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** 9 ft French Door Header

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	9.5 ft	Tributary Width:	1.33 ft	P Location:	9.5 ft
Add'l uniform DL:	318.8 lbs/ft	DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:	531.3 lbs/ft	SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	1609 lbs	DL Reaction 2:	1609 lbs	Note: Design automatically uses ASD load combinations
LL Reaction 1:	253 lbs	LL Reaction 2:	253 lbs	
SL Reaction 1:	2523 lbs	SL Reaction 2:	2523 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>4132 lbs</b>	Total Reaction 2:	<b>4132 lbs</b>	

**Material Properties:**

E	1.8 msi	E'	1.8 msi
Fb	2400 psi	Fb'	2760 psi
Fv	265 psi	Fv'	305 psi
Fc perp	650 psi	Fc perp'	650 psi
Emin	0.95 msi	Emin'	0.95 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.48 in	Max LL defl:	0.24 in
Total defl. * I:	93.99 in^4	Required I:	197.87 in^4
LL defl. * I:	59.5 in^4	Required I:	250.55 in^4
Actual deflections:	TOTAL: 0.28 in		0.18 in

**Force analysis:**

Max. moment:	9814 ft-lb	Max Shear:	4132 lbs
--------------	------------	------------	----------

**Selected Member: (1) GLB 5.5 x 9**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	334.13 in^4	250.55 in^4
Section Modulus:	74.25 in^3	42.67 in^3
Section Area:	49.5 in^2	20.34 in^2
Bearing Area:		6.36 in^2
Minimum bearing dimensions:	5.5 in x	1.16 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 2

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** North Patio Beam

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:	1	Wet Use:	

**Geometry and Loads:**

Span:	12.5 ft	Tributary Width:	3.25 ft	P Location:	12.5 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:		Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	305 lbs	DL Reaction 2:	305 lbs	Note: Design automatically uses ASD load combinations
LL Reaction 1:	0 lbs	LL Reaction 2:	0 lbs	
SL Reaction 1:	508 lbs	SL Reaction 2:	508 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>813 lbs</b>	Total Reaction 2:	<b>813 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.235 msi
Fb	850 psi	Fb'	1017 psi
Fv	150 psi	Fv'	138 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.4465 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	360		
Max. allowed total defl:	0.63 in	Max LL defl:	0.42 in
Total defl. * I:	57.82 in^4	Required I:	92.52 in^4
LL defl. * I:	36.14 in^4	Required I:	86.73 in^4
Actual deflections: TOTAL:	0.52 in		0.33 in

**Force analysis:**

Max. moment:	2539 ft-lb	Max Shear:	813 lbs
--------------	------------	------------	---------

**Selected Member: (1) HF#2 3.5 x 7.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	111.15 in^4	92.52 in^4
Section Modulus:	30.66 in^3	29.97 in^3
Section Area:	25.38 in^2	8.83 in^2
Bearing Area:		2.01 in^2
Minimum bearing dimensions:	3.5 in x	0.57 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 3

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** North East 6ft Floor Beam

Fully Supported:	1	Snow Load:		Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	12.5 ft	Tributary Width:	11.5 ft	P Location:	12.5 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	1078 lbs	DL Reaction 2:	1078 lbs	Note: Design automatically uses
LL Reaction 1:	2875 lbs	LL Reaction 2:	2875 lbs	ASD load combinations
SL Reaction 1:	0 lbs	SL Reaction 2:	0 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>3953 lbs</b>	Total Reaction 2:	<b>3953 lbs</b>	

**Material Properties:**

E	2 msi	E'	2 msi
Fb	2900 psi	Fb'	2903 psi
Fv	290 psi	Fv'	290 psi
Fc perp	625 psi	Fc perp'	625 psi
Emin	0.914 msi	Emin'	0.914 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.63 in	Max LL defl:	0.31 in
Total defl. * I:	173.72 in^4	Required I:	277.95 in^4
LL defl. * I:	126.34 in^4	Required I:	404.3 in^4
Actual deflections: TOTAL:	0.36 in		0.26 in

**Force analysis:**

Max. moment:	12354 ft-lb	Max Shear:	3953 lbs
--------------	-------------	------------	----------

**Selected Member: (1) PSL 3.5 x 11.875**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	488.41 in^4	404.3 in^4
Section Modulus:	82.26 in^3	51.06 in^3
Section Area:	41.56 in^2	20.45 in^2
Bearing Area:		6.33 in^2
Minimum bearing dimensions:	3.5 in x	1.81 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 4

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:**

East Windows

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	6.5 ft	Tributary Width:	7.5 ft	P Location:	6.5 ft
Add'l uniform DL:	202.5 lbs/ft	DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:	337.5 lbs/ft	SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	1024 lbs	DL Reaction 2:	1024 lbs	Note: Design automatically uses
LL Reaction 1:	975 lbs	LL Reaction 2:	975 lbs	ASD load combinations
SL Reaction 1:	1097 lbs	SL Reaction 2:	1097 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>2578 lbs</b>	Total Reaction 2:	<b>2578 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	1173 psi
Fv	150 psi	Fv'	173 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.33 in	Max LL defl:	0.16 in
Total defl. * I:	29.43 in^4	Required I:	90.55 in^4
LL defl. * I:	19.7 in^4	Required I:	121.2 in^4
Actual deflections:	TOTAL: 0.13 in		0.09 in

**Force analysis:**

Max. moment:	4189 ft-lb	Max Shear:	2578 lbs
--------------	------------	------------	----------

**Selected Member: (1) HF#2 3.5 x 9.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	230.84 in^4	121.2 in^4
Section Modulus:	49.91 in^3	42.85 in^3
Section Area:	32.38 in^2	22.41 in^2
Bearing Area:		6.36 in^2
Minimum bearing dimensions:	3.5 in x	1.82 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 5

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:**

Typical Window Header

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	3.5 ft	Tributary Width:	1.33 ft	P Location:	3.5 ft
Add'l uniform DL:	225 lbs/ft	DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:	375 lbs/ft	SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	429 lbs	DL Reaction 2:	429 lbs	Note: Design automatically uses
LL Reaction 1:	93 lbs	LL Reaction 2:	93 lbs	ASD load combinations
SL Reaction 1:	656 lbs	SL Reaction 2:	656 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>1085 lbs</b>	Total Reaction 2:	<b>1085 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	1173 psi
Fv	150 psi	Fv'	173 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.18 in	Max LL defl:	0.09 in
Total defl. * I:	1.75 in^4	Required I:	9.99 in^4
LL defl. * I:	1.11 in^4	Required I:	12.71 in^4
Actual deflections:	TOTAL: 0.02 in		0.01 in

**Force analysis:**

Max. moment:	949 ft-lb	Max Shear:	1085 lbs
--------------	-----------	------------	----------

**Selected Member: (2) HF#2 1.5 x 7.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	95.27 in^4	12.71 in^4
Section Modulus:	26.28 in^3	9.71 in^3
Section Area:	21.75 in^2	9.43 in^2
Bearing Area:		2.68 in^2
Minimum bearing dimensions:	3. in x	0.89 in



John S. Apolis, P.E.

CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 6

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:**

Garage Header

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	17 ft	Tributary Width:	2 ft	P Location:	17 ft
Add'l uniform DL:		DL unit load:	20 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	20 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	340 lbs	DL Reaction 2:	340 lbs	Note: Design automatically uses
LL Reaction 1:	340 lbs	LL Reaction 2:	340 lbs	ASD load combinations
SL Reaction 1:	425 lbs	SL Reaction 2:	425 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>914 lbs</b>	Total Reaction 2:	<b>914 lbs</b>	

**Material Properties:**

E	1.6 msi	E'	1.6 msi
Fb	900 psi	Fb'	1242 psi
Fv	180 psi	Fv'	207 psi
Fc perp	625 psi	Fc perp'	625 psi
Emin	0.58 msi	Emin'	0.58 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	360		
Max. allowed total defl:	0.85 in	Max LL defl:	0.57 in
Total defl. * I:	152.69 in^4	Required I:	179.63 in^4
LL defl. * I:	105.71 in^4	Required I:	186.54 in^4
Actual deflections: TOTAL:	0.66 in		0.46 in

**Force analysis:**

Max. moment:	3883 ft-lb	Max Shear:	914 lbs
--------------	------------	------------	---------

**Selected Member: (1) DF#2 3.5 x 9.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	230.84 in^4	186.54 in^4
Section Modulus:	49.91 in^3	37.52 in^3
Section Area:	32.38 in^2	6.62 in^2
Bearing Area:		1.46 in^2
Minimum bearing dimensions:	3.5 in x	0.42 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 7

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** Mudroom Header

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	5.5 ft	Tributary Width:	10.33 ft	P Location:	5.5 ft
Add'l uniform DL:	178.8 lbs/ft	DL unit load:	20 psf	Concentrated DL:	
Add'l uniform LL:	410 lbs/ft	LL unit load:	20 psf	Concentrated LL:	
Add'l uniform SL:	50 lbs/ft	SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	1060 lbs	DL Reaction 2:	1060 lbs	Note: Design automatically uses
LL Reaction 1:	1696 lbs	LL Reaction 2:	1696 lbs	ASD load combinations
SL Reaction 1:	848 lbs	SL Reaction 2:	848 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>2967 lbs</b>	Total Reaction 2:	<b>2967 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	978 psi
Fv	150 psi	Fv'	173 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.28 in	Max LL defl:	0.14 in
Total defl. * I:	20.75 in^4	Required I:	75.46 in^4
LL defl. * I:	14.65 in^4	Required I:	106.53 in^4
Actual deflections: TOTAL:	0.06 in		0.04 in

**Force analysis:**

Max. moment:	4080 ft-lb	Max Shear:	2967 lbs
--------------	------------	------------	----------

**Selected Member: (2) HF#2 1.5 x 11.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	355.96 in^4	106.53 in^4
Section Modulus:	63.28 in^3	50.09 in^3
Section Area:	33.75 in^2	25.8 in^2
Bearing Area:		7.33 in^2
Minimum bearing dimensions:	3. in x	2.44 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 8

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** Foyer Header

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	6.5 ft	Tributary Width:	1.33 ft	P Location:	6.5 ft
Add'l uniform DL:	277.5 lbs/ft	DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:	462.5 lbs/ft	SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	967 lbs	DL Reaction 2:	967 lbs	Note: Design automatically uses
LL Reaction 1:	173 lbs	LL Reaction 2:	173 lbs	ASD load combinations
SL Reaction 1:	1503 lbs	SL Reaction 2:	1503 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>2470 lbs</b>	Total Reaction 2:	<b>2470 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	1173 psi
Fv	150 psi	Fv'	173 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.33 in	Max LL defl:	0.16 in
Total defl. * I:	25.12 in^4	Required I:	77.3 in^4
LL defl. * I:	15.93 in^4	Required I:	98.05 in^4
Actual deflections:	TOTAL: 0.11 in		0.07 in

**Force analysis:**

Max. moment:	4013 ft-lb	Max Shear:	2470 lbs
--------------	------------	------------	----------

**Selected Member: (1) HF#2 3.5 x 9.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	230.84 in^4	98.05 in^4
Section Modulus:	49.91 in^3	41.06 in^3
Section Area:	32.38 in^2	21.48 in^2
Bearing Area:		6.1 in^2
Minimum bearing dimensions:	3.5 in x	1.74 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 9

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:**

Stair Beam

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	7.5 ft	Tributary Width:	1.33 ft	P Location:	3.75 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	98.8125 lbs
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:		Concentrated SL:	164.0625 lbs
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	124 lbs	DL Reaction 2:	124 lbs	Note: Design automatically uses ASD load combinations
LL Reaction 1:	200 lbs	LL Reaction 2:	200 lbs	
SL Reaction 1:	82 lbs	SL Reaction 2:	82 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>335 lbs</b>	Total Reaction 2:	<b>335 lbs</b>	

**Material Properties:**

E	2 msi	E'	2 msi
Fb	2900 psi	Fb'	3339 psi
Fv	290 psi	Fv'	334 psi
Fc perp	625 psi	Fc perp'	625 psi
Emin	0.914 msi	Emin'	0.914 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.38 in	Max LL defl:	0.19 in
Total defl. * I:	4.6 in^4	Required I:	12.27 in^4
LL defl. * I:	3.14 in^4	Required I:	16.74 in^4
Actual deflections: TOTAL:	0.01 in		0.01 in

**Force analysis:**

Max. moment:	837 ft-lb	Max Shear:	335 lbs
--------------	-----------	------------	---------

**Selected Member: (1) PSL 3.5 x 11.875**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	488.41 in^4	16.74 in^4
Section Modulus:	82.26 in^3	3.01 in^3
Section Area:	41.56 in^2	1.51 in^2
Bearing Area:		0.54 in^2
Minimum bearing dimensions:	3.5 in x	0.15 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 10

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:**

Awning Joists

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:	1	P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	5.33 ft	Tributary Width:	2 ft	P Location:	5.33 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:		Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	80 lbs	DL Reaction 2:	80 lbs	Note: Design automatically uses
LL Reaction 1:	0 lbs	LL Reaction 2:	0 lbs	ASD load combinations
SL Reaction 1:	133 lbs	SL Reaction 2:	133 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>213 lbs</b>	Total Reaction 2:	<b>213 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	1686 psi
Fv	150 psi	Fv'	173 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.27 in	Max LL defl:	0.13 in
Total defl. * I:	1.12 in^4	Required I:	4.19 in^4
LL defl. * I:	0.7 in^4	Required I:	5.24 in^4
Actual deflections: TOTAL:	0.21 in		0.13 in

**Force analysis:**

Max. moment:	284 ft-lb	Max Shear:	213 lbs
--------------	-----------	------------	---------

**Selected Member: (1) HF#2 1.5 x 3.5**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	5.36 in^4	5.24 in^4
Section Modulus:	3.06 in^3	2.02 in^3
Section Area:	5.25 in^2	1.85 in^2
Bearing Area:		0.53 in^2
Minimum bearing dimensions:	1.5 in x	0.35 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 11

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** Awning Beam

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:	1	Wet Use:	

**Geometry and Loads:**

Span:	14.67 ft	Tributary Width:	2.25 ft	P Location:	14.67 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:		Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	248 lbs	DL Reaction 2:	248 lbs	Note: Design automatically uses
LL Reaction 1:	0 lbs	LL Reaction 2:	0 lbs	ASD load combinations
SL Reaction 1:	413 lbs	SL Reaction 2:	413 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>660 lbs</b>	Total Reaction 2:	<b>660 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.235 msi
Fb	850 psi	Fb'	1017 psi
Fv	150 psi	Fv'	138 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.4465 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	360		
Max. allowed total defl:	0.73 in	Max LL defl:	0.49 in
Total defl. * I:	75.94 in^4	Required I:	103.53 in^4
LL defl. * I:	47.46 in^4	Required I:	97.06 in^4
Actual deflections: TOTAL:	0.68 in		0.43 in

**Force analysis:**

Max. moment:	2421 ft-lb	Max Shear:	660 lbs
--------------	------------	------------	---------

**Selected Member: (1) HF#2 3.5 x 7.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	111.15 in^4	103.53 in^4
Section Modulus:	30.66 in^3	28.58 in^3
Section Area:	25.38 in^2	7.18 in^2
Bearing Area:		1.63 in^2
Minimum bearing dimensions:	3.5 in x	0.47 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 11-Apr-22

Architect:

Page number: U 12

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** 3 ft Window Under Girder Truss

Fully Supported:	1	Snow Load:	1	Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	3.5 ft	Tributary Width:	2 ft	P Location:	0.75 ft
Add'l uniform DL:		DL unit load:	15 psf	Concentrated DL:	3543.75 lbs
Add'l uniform LL:		LL unit load:		Concentrated LL:	
Add'l uniform SL:		SL unit load:	25 psf	Concentrated SL:	5906.25 lbs
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	2837 lbs	DL Reaction 2:	812 lbs	Note: Design automatically uses
LL Reaction 1:	0 lbs	LL Reaction 2:	0 lbs	ASD load combinations
SL Reaction 1:	4728 lbs	SL Reaction 2:	1353 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>7565 lbs</b>	Total Reaction 2:	<b>2165 lbs</b>	

**Material Properties:**

E	1.8 msi	E'	1.8 msi
Fb	2400 psi	Fb'	2760 psi
Fv	265 psi	Fv'	305 psi
Fc perp	650 psi	Fc perp'	650 psi
Emin	0.95 msi	Emin'	0.95 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.18 in	Max LL defl:	0.09 in
Total defl. * I:	5.13 in^4	Required I:	29.33 in^4
LL defl. * I:	3.21 in^4	Required I:	36.66 in^4
Actual deflections:	TOTAL: 0.02 in		0.01 in


**Force analysis:**

Max. moment:	5651 ft-lb	Max Shear:	7565 lbs
--------------	------------	------------	----------

**Selected Member: (1) GLB 5.5 x 9**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	334.13 in^4	36.66 in^4
Section Modulus:	74.25 in^3	24.57 in^3
Section Area:	49.5 in^2	37.24 in^2
Bearing Area:		11.64 in^2
Minimum bearing dimensions:	5.5 in x	2.12 in

Upper, Great Room Beams  
1 piece(s) 7" x 18" 2.2E Parallam® PSL

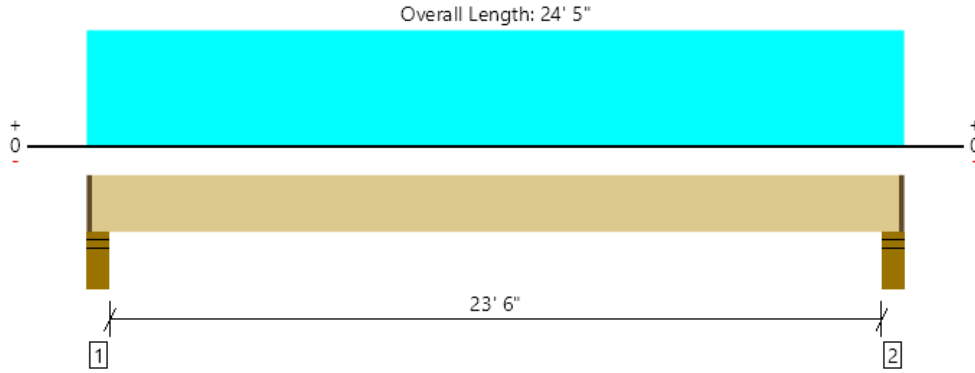

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	10130 @ 4"	12644 (4.25")	Passed (80%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	8578 @ 1' 11 1/2"	24360	Passed (35%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	59006 @ 12' 2 1/2"	87330	Passed (68%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.589 @ 12' 2 1/2"	0.594	Passed (L/484)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.850 @ 12' 2 1/2"	1.188	Passed (L/335)	--	1.0 D + 1.0 L (All Spans)

System : Floor  
Member Type : Flush Beam  
Building Use : Residential  
Building Code : IBC 2018  
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Member should be side-loaded from both sides of the member or braced to prevent rotation.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - SPF	5.50"	4.25"	3.40"	3132	7081	10213	1 1/4" Rim Board
2 - Stud wall - SPF	5.50"	4.25"	3.40"	3132	7081	10213	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	24' 3" o/c	
Bottom Edge (Lu)	24' 3" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	1 1/4" to 24' 3 3/4"	N/A	39.4	--	
1 - Uniform (PSF)	0 to 24' 5" (Front)	14' 6"	15.0	40.0	Default Load

**Weyerhaeuser Notes**

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to [www.weyerhaeuser.com/woodproducts/document-library](http://www.weyerhaeuser.com/woodproducts/document-library).


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Isabella Cabulos CSES Engineering (206) 291-7007 isabella@cse-engineering.com	





Upper, Upper Floor Joists  
1 piece(s) 11 7/8" TJI @ 110 @ 16" OC

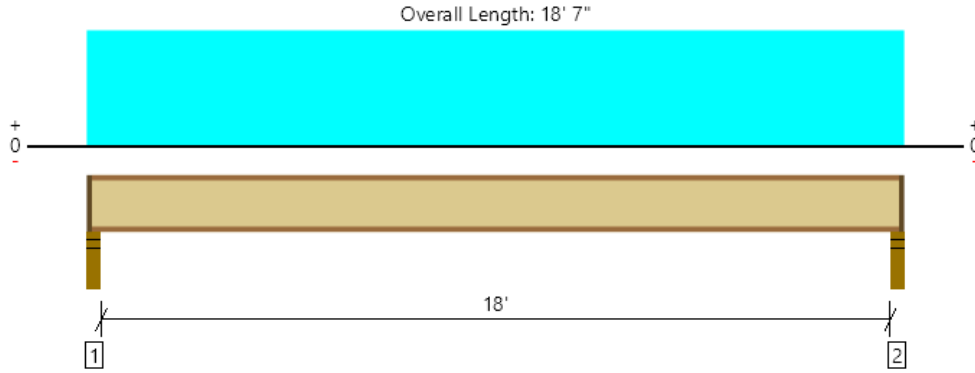

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	674 @ 2 1/2"	1041 (2.25")	Passed (65%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	660 @ 3 1/2"	1560	Passed (42%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	3025 @ 9' 3 1/2"	3160	Passed (96%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.429 @ 9' 3 1/2"	0.454	Passed (L/508)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.589 @ 9' 3 1/2"	0.908	Passed (L/370)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	34	Any	Passed	--	--

System : Floor  
Member Type : Joist  
Building Use : Residential  
Building Code : IBC 2018  
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - SPF	3.50"	2.25"	1.75"	186	496	682	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.75"	186	496	682	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 1" o/c	
Bottom Edge (Lu)	18' 5" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 18' 7"	16"	15.0	40.0	Upper Floor

**Weyerhaeuser Notes**


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to [www.weyerhaeuser.com/woodproducts/document-library](http://www.weyerhaeuser.com/woodproducts/document-library).

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Isabella Cabulos CSES Engineering (206) 291-7007 isabella@cse-engineering.com	



Upper, Cantilever Patio Roof Joists  
1 piece(s) 2 x 8 HF No.2 @ 24" OC

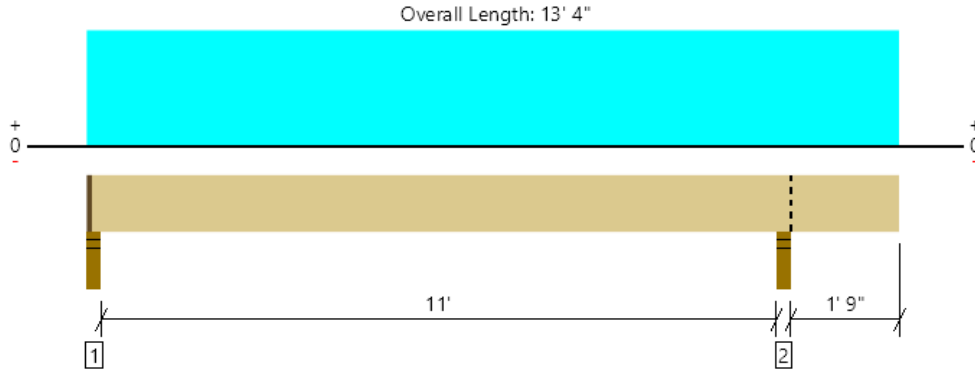

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	449 @ 2' 1/2"	1367 (2.25")	Passed (33%)	--	1.0 D + 1.0 S (Alt Spans)
Shear (lbs)	402 @ 10' 8 1/4"	1251	Passed (32%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	1212 @ 5' 8 9/16"	1477	Passed (82%)	1.15	1.0 D + 1.0 S (Alt Spans)
Live Load Defl. (in)	0.279 @ 5' 9 9/16"	0.374	Passed (L/483)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.440 @ 5' 9 7/16"	0.561	Passed (L/306)	--	1.0 D + 1.0 S (Alt Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor  
Member Type : Joist  
Building Use : Residential  
Building Code : IBC 2018  
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240). Upward deflection on right cantilever exceeds overhang deflection criteria.
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Stud wall - SPF	3.50"	2.25"	1.50"	170	287	457	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	3.50"	1.50"	230	384	614	Blocking

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	5' 6" o/c	
Bottom Edge (Lu)	13' 3" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 13' 4"	24"	15.0	25.0	Roof

**Weyerhaeuser Notes**


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to [www.weyerhaeuser.com/woodproducts/document-library](http://www.weyerhaeuser.com/woodproducts/document-library).

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Isabella Cabulos CSES Engineering (206) 291-7007 isabella@cse-engineering.com	



Upper, South Patio Beam  
1 piece(s) 5 1/2" x 12" 24F-V4 DF Glulam

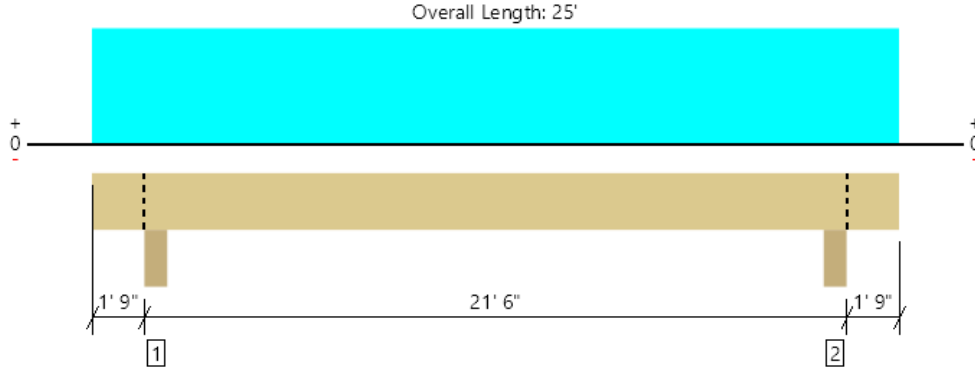

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3834 @ 1' 11 3/4"	19663 (5.50")	Passed (19%)	--	1.0 D + 1.0 S (Adj Spans)
Shear (lbs)	2852 @ 3' 2 1/2"	13409	Passed (21%)	1.15	1.0 D + 1.0 S (Adj Spans)
Pos Moment (Ft-lbs)	16516 @ 12' 6"	30178	Passed (55%)	1.15	1.0 D + 1.0 S (Alt Spans)
Neg Moment (Ft-lbs)	-599 @ 1' 11 3/4"	23403	Passed (3%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.549 @ 12' 6"	0.701	Passed (L/460)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.919 @ 12' 6"	1.052	Passed (L/275)	--	1.0 D + 1.0 S (Alt Spans)

System : Floor  
Member Type : Drop Beam  
Building Use : Residential  
Building Code : IBC 2018  
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240). Upward deflection on left and right cantilevers exceeds overhang deflection criteria.
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Critical positive moment adjusted by a volume factor of 0.99 that was calculated using length L = 20' 9 5/16".
- Critical negative moment adjusted by a volume factor of 1.00 that was calculated using length L = 2' 2".
- The effects of positive or negative camber have not been accounted for when calculating deflection.
- The specified glulam is assumed to have its strong laminations at the bottom of the beam. Install with proper side up as indicated by the manufacturer.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Column - SPF	5.50"	5.50"	1.50"	1560	2274	3834	Blocking
2 - Column - SPF	5.50"	5.50"	1.50"	1560	2274	3834	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	25' o/c	
Bottom Edge (Lu)	25' o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 25'	N/A	16.0	--	
1 - Uniform (PSF)	0 to 25' (Front)	7' 3"	15.0	25.0	Roof Load

**Weyerhaeuser Notes**


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to [www.weyerhaeuser.com/woodproducts/document-library](http://www.weyerhaeuser.com/woodproducts/document-library).

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Isabella Cabulos CSES Engineering (206) 291-7007 isabella@cse-engineering.com	



Upper, Living Room Beam  
1 piece(s) 3 1/2" x 11 7/8" 2.2E Parallam® PSL

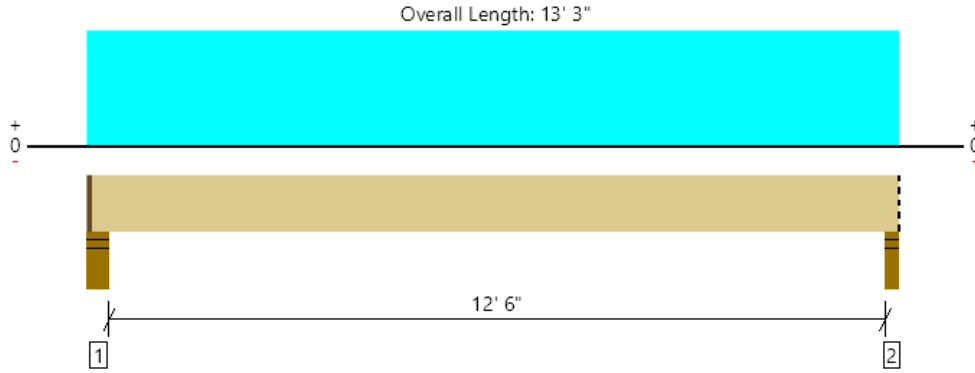

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	4223 @ 13' 1"	5206 (3.50")	Passed (81%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	3396 @ 1' 5 3/8"	8035	Passed (42%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	13117 @ 6' 8 1/2"	19902	Passed (66%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.278 @ 6' 8 1/2"	0.319	Passed (L/550)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.390 @ 6' 8 1/2"	0.637	Passed (L/392)	--	1.0 D + 1.0 L (All Spans)

System : Floor  
Member Type : Flush Beam  
Building Use : Residential  
Building Code : IBC 2018  
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - SPF	5.50"	4.25"	2.87"	1243	3086	4329	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	3.50"	2.84"	1213	3009	4222	Blocking

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	13' 2" o/c	
Bottom Edge (Lu)	13' 2" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	1 1/4" to 13' 3"	N/A	13.0	--	
1 - Uniform (PSF)	0 to 13' 3" (Front)	11' 6"	15.0	40.0	Upper Floor Load

**Weyerhaeuser Notes**

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to [www.weyerhaeuser.com/woodproducts/document-library](http://www.weyerhaeuser.com/woodproducts/document-library).

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Isabella Cabulos CSES Engineering (206) 291-7007 isabella@cse-engineering.com	



John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 12-Apr-22

Architect:

Page number: M 1

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description:** New Crawlspace Beams

Fully Supported:	1	Snow Load:		Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	4 ft	Tributary Width:	11.5 ft	P Location:	4 ft
Add'l uniform DL:	37.5 lbs/ft	DL unit load:	15 psf	Concentrated DL:	
Add'l uniform LL:	100 lbs/ft	LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	420 lbs	DL Reaction 2:	420 lbs	Note: Design automatically uses
LL Reaction 1:	1120 lbs	LL Reaction 2:	1120 lbs	ASD load combinations
SL Reaction 1:	0 lbs	SL Reaction 2:	0 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>1540 lbs</b>	Total Reaction 2:	<b>1540 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	850 psi	Fb'	1190 psi
Fv	150 psi	Fv'	150 psi
Fc perp	405 psi	Fc perp'	405 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.2 in	Max LL defl:	0.1 in
Total defl. * I:	3.41 in^4	Required I:	17.06 in^4
LL defl. * I:	2.48 in^4	Required I:	24.81 in^4
Actual deflections: TOTAL:	0.07 in		0.05 in

**Force analysis:**

Max. moment:	1540 ft-lb	Max Shear:	1540 lbs
--------------	------------	------------	----------

**Selected Member: (1) HF#2 3.5 x 5.5**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	48.53 in^4	24.81 in^4
Section Modulus:	17.65 in^3	15.53 in^3
Section Area:	19.25 in^2	15.4 in^2
Bearing Area:		3.8 in^2
Minimum bearing dimensions:	3.5 in x	1.09 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 13-Apr-22

Architect:

Page number: M2

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description: Foyer East-West Beam**

Fully Supported:	1	Snow Load:		Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	10 ft	Tributary Width:	1.33 ft	P Location:	10 ft
Add'l uniform DL:	80 lbs/ft	DL unit load:	12 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	480 lbs	DL Reaction 2:	480 lbs	Note: Design automatically uses
LL Reaction 1:	266 lbs	LL Reaction 2:	266 lbs	ASD load combinations
SL Reaction 1:	0 lbs	SL Reaction 2:	0 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>746 lbs</b>	Total Reaction 2:	<b>746 lbs</b>	

**Material Properties:**

E	1.6 msi	E'	1.6 msi
Fb	900 psi	Fb'	1170 psi
Fv	180 psi	Fv'	180 psi
Fc perp	625 psi	Fc perp'	625 psi
Emin	0.58 msi	Emin'	0.58 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.5 in	Max LL defl:	0.25 in
Total defl. * I:	20.98 in^4	Required I:	41.95 in^4
LL defl. * I:	7.48 in^4	Required I:	29.93 in^4
Actual deflections:	TOTAL: 0.19 in		0.07 in

**Force analysis:**

Max. moment:	1865 ft-lb	Max Shear:	746 lbs
--------------	------------	------------	---------

**Selected Member: (1) DF#2 3.5 x 7.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	111.15 in^4	41.95 in^4
Section Modulus:	30.66 in^3	19.12 in^3
Section Area:	25.38 in^2	6.22 in^2
Bearing Area:		1.19 in^2
Minimum bearing dimensions:	3.5 in x	0.34 in

John S. Apolis, P.E. CSES, Inc.

Job number: 2022.033

Project: Nguyen

Date: 13-Apr-22

Architect:

Page number: M3

**BEAM DESIGN (Uniform Load+Concentrated Load)**

2018 International Building Code (IBC)

2018 NDS

**Beam Description: Foyer North-South Beam**

Fully Supported:	1	Snow Load:		Wind Load:	
Repetitive Member:		P.T. Lumber:		Wet Use:	

**Geometry and Loads:**

Span:	5 ft	Tributary Width:	15 ft	P Location:	5 ft
Add'l uniform DL:	80 lbs/ft	DL unit load:	12 psf	Concentrated DL:	
Add'l uniform LL:		LL unit load:	40 psf	Concentrated LL:	
Add'l uniform SL:		SL unit load:		Concentrated SL:	
Add'l uniform WL:		WL unit load:		Concentrated WL:	

DL Reaction 1:	650 lbs	DL Reaction 2:	650 lbs	Note: Design automatically uses
LL Reaction 1:	1500 lbs	LL Reaction 2:	1500 lbs	ASD load combinations
SL Reaction 1:	0 lbs	SL Reaction 2:	0 lbs	
WL Reaction 1:	0 lbs	WL Reaction 2:	0 lbs	
Total Reaction 1:	<b>2150 lbs</b>	Total Reaction 2:	<b>2150 lbs</b>	

**Material Properties:**

E	1.3 msi	E'	1.3 msi
Fb	875 psi	Fb'	1138 psi
Fv	170 psi	Fv'	170 psi
Fc perp	625 psi	Fc perp'	625 psi
Emin	0.47 msi	Emin'	0.47 msi

**Deflection analysis:**

For total load: Allowed deflection criteria, span/	240		
For LL only: Allowed deflection criteria, span/	480		
Max. allowed total defl:	0.25 in	Max LL defl:	0.13 in
Total defl. * I:	9.3 in^4	Required I:	37.21 in^4
LL defl. * I:	6.49 in^4	Required I:	51.92 in^4
Actual deflections: TOTAL:	0.05 in		0.04 in

**Force analysis:**

Max. moment:	2688 ft-lb	Max Shear:	2150 lbs
--------------	------------	------------	----------

**Selected Member: (1) DF#2 5.5 x 7.25**

<b>Member properties:</b>	<b>Provided:</b>	<b>Required:</b>
Moment of inertia:	174.66 in^4	51.92 in^4
Section Modulus:	48.18 in^3	28.35 in^3
Section Area:	39.88 in^2	18.97 in^2
Bearing Area:		3.44 in^2
Minimum bearing dimensions:	5.5 in x	0.63 in

## North porch Footing:

$$\text{worst case point load} = 813 \text{ lb} \times 2 = 1,626 \text{ lb}$$

$$\frac{1,626 \text{ lb}}{1500 \text{ psf}} \approx 1.1 \text{ ft}^2 \quad \therefore 1.25' \times 1.25' \times 12" \text{ DEEP FOOTING}$$

$$\frac{1,626 \text{ lb} + 1.25^2 \times 150 \text{ psf}}{1500 \text{ psf}} = 1.24 \text{ ft}^2 < 1.56 \text{ ft}^2 \quad \checkmark$$

## SOUTH PORCH FOOTING

$$\text{worst case point load} = 3834 \text{ lb}$$

$$\frac{3834 \text{ lb}}{1500 \text{ psf}} \approx 2.556 \text{ ft}^2 \quad \therefore 2' \times 2' \times 12" \text{ DEEP FOOTING}$$

$$\frac{4 \times 150 \text{ psf} + 3834 \text{ lb}}{1500 \text{ psf}} = 2.96 \text{ ft}^2 < 4 \text{ ft}^2 \quad \checkmark$$

## CRAWLSPACE FOOTING

$$\text{Point load} = 2 \times 1540 \text{ lb} = 3080 \text{ lb}$$

$$\therefore 2' \times 2' \times 12" \text{ DEEP FOOTING}$$

### CONSULTING STRUCTURAL ENGINEERING SERVICES

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022.033 Date 4-12-22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page F1



**Search Information**

**Address:** 8937 SE 56th St, Mercer Island, WA 98040, USA

**Coordinates:** 47.5523167, -122.2187846

**Elevation:** 357 ft


**Timestamp:** 2022-04-08T17:23:26.448Z

**Hazard Type:** Seismic

**Reference Document:** ASCE7-16

**Risk Category:** II

**Site Class:** D

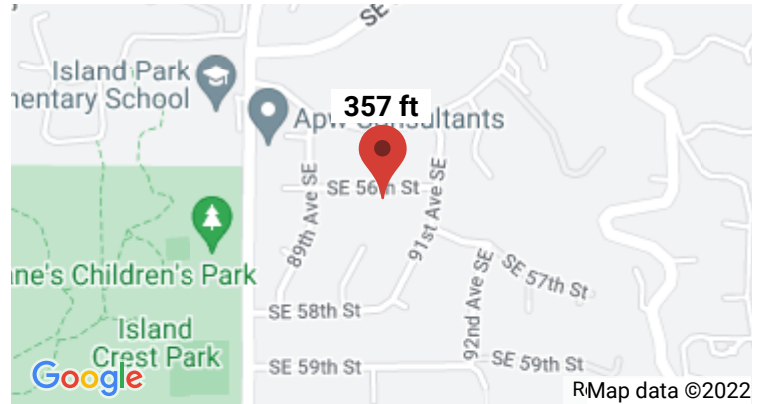

**Basic Parameters**

Name	Value	Description
S <sub>S</sub>	1.451	MCE <sub>R</sub> ground motion (period=0.2s)
S <sub>1</sub>	0.503	MCE <sub>R</sub> ground motion (period=1.0s)
S <sub>MS</sub>	1.451	Site-modified spectral acceleration value
S <sub>M1</sub>	* null	Site-modified spectral acceleration value
S <sub>DS</sub>	0.967	Numeric seismic design value at 0.2s SA
S <sub>D1</sub>	* null	Numeric seismic design value at 1.0s SA

\* See Section 11.4.8

**Additional Information**

Name	Value	Description
SDC	* null	Seismic design category
F <sub>a</sub>	1	Site amplification factor at 0.2s
F <sub>v</sub>	* null	Site amplification factor at 1.0s
CR <sub>S</sub>	0.902	Coefficient of risk (0.2s)
CR <sub>1</sub>	0.898	Coefficient of risk (1.0s)
PGA	0.621	MCE <sub>G</sub> peak ground acceleration
F <sub>PGA</sub>	1.1	Site amplification factor at PGA
PGA <sub>M</sub>	0.683	Site modified peak ground acceleration

$T_L$	6	Long-period transition period (s)
SsRT	1.451	Probabilistic risk-targeted ground motion (0.2s)
SsUH	1.609	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
SsD	4.2	Factored deterministic acceleration value (0.2s)
S1RT	0.503	Probabilistic risk-targeted ground motion (1.0s)
S1UH	0.56	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
S1D	1.625	Factored deterministic acceleration value (1.0s)
PGAd	1.404	Factored deterministic acceleration value (PGA)

\* See Section 11.4.8


*The results indicated here DO NOT reflect any state or local amendments to the values or any delineation lines made during the building code adoption process. Users should confirm any output obtained from this tool with the local Authority Having Jurisdiction before proceeding with design.*

## Disclaimer

Hazard loads are provided by the U.S. Geological Survey [Seismic Design Web Services](#).

While the information presented on this website is believed to be correct, ATC and its sponsors and contributors assume no responsibility or liability for its accuracy. The material presented in the report should not be used or relied upon for any specific application without competent examination and verification of its accuracy, suitability and applicability by engineers or other licensed professionals. ATC does not intend that the use of this information replace the sound judgment of such competent professionals, having experience and knowledge in the field of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the results of the report provided by this website. Users of the information from this website assume all liability arising from such use. Use of the output of this website does not imply approval by the governing building code bodies responsible for building code approval and interpretation for the building site described by latitude/longitude location in the report.

**ASCE7-05, 6.5.7 Topographic Effects**

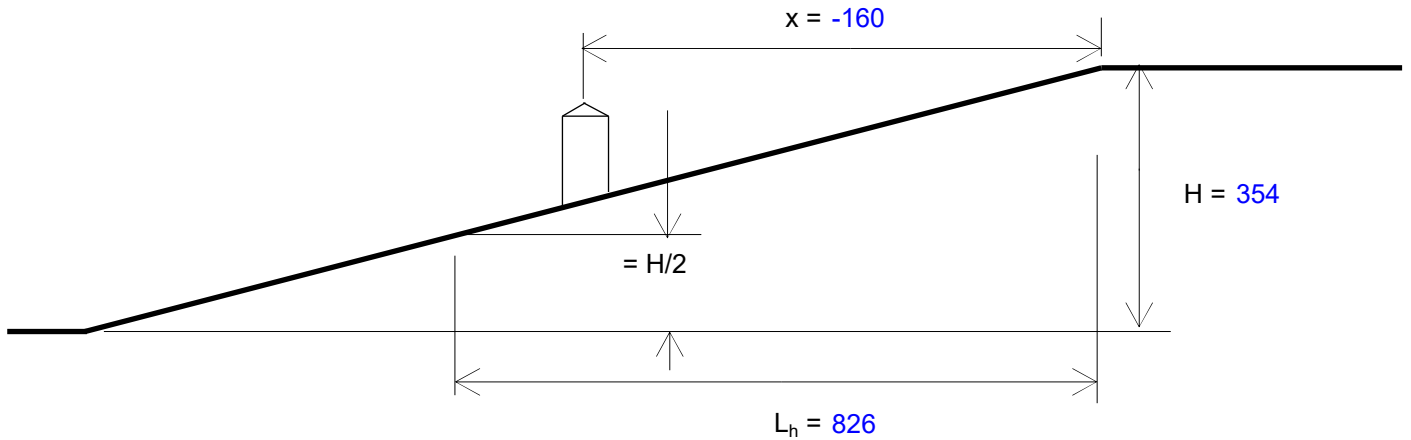

Height above local ground  $z = 28$  ft

Hill Shape 2-dimensional escarpments ▼

Direction Downwind of Crest ▼

Exposure **B**

Height of hill,  $H = 354$  ft

Distance upwind of crest to where the difference in ground elevation is half the height of hill,  $L_h = 826$  ft

$H/L_h = 0.43$

calculate  $K_1$  by using  $H/L_h = 0.43$

Distance from the crest to the building,  $x = -160$  ft

$x/L_h = -0.19$

Figure 6-4,  $K_1/(H/L_h) = 0.75$

$K_1 = 0.32$

calculate  $K_2, K_3$  by using  $L_h = 826$

$K_2 = 1 - x/\mu L_h$   $\mu = 4$

$K_2 = 0.95$

$K_3 = e^{-\gamma z/L_h}$   $\gamma = 2.5$

$K_3 = 0.92$

$K_{zt} = [1 + K_1 K_2 K_3]^2$

(6-3)

$K_{zt} = 1.64$

**Lateral Loads Design per ASCE 7-10, Wind: Section 28 Seismic: Section 12**

**(Simplified Envelope Procedure Part 2)**

2018 International Building Code (IBC)

**WIND LOADS** 110 mph Basic Wind Speed 2015 NDS  
 $P_s = \lambda * K_{zt} * P_s(30) * 0.6$  Exposure **B** Roof Slope: **9.00** : 12 = 36.9  
 Least Horizontal Dimension, feet: **36** Mean Roof Ht, feet: **30** (degrees)  
 $\lambda = 1.00$   $a = 3.6$  ft,  $2a = 7.2$  ft  
 $I_w = 1.00$   $K_{zT} = 1.64$

<u>Tabulated Ps(30):</u>	<u>Zone</u>	<u>Tabulated Wind Pressure</u>	<u>Calc'd Design Pressure</u>	<u>Min Design Pressure</u>	(Per section 28.6.4 minimum wind pressure is 16 PSF for zones A,C, and 8 PSF for zones B, D)
(Refer to ASCE 7-10, Figure 28.6-1)			(*lambda*KzT*0.6)		
(horizontal)	A	21.6	psf 21.3	21.3	
"	B	14.8	psf 14.6	14.6	
"	C	17.2	psf 16.9	16.9	
"	D	11.8	psf 11.6	11.6	
(vertical)	E	8.3	psf 8.2		
"	F	-13.1	psf -12.9		
"	G	7.2	psf 7.1		
"	H	-11.3	psf -11.1		
(uplift on overhangs)	E(oh)	-7.6	psf -7.5		
"	G(oh)	-8.7	psf -8.6		

**(Equivalent Lateral Force Procedure, Section 12.8)**

**SEISMIC LOADS**  $I_e = 1.0$   $R = 6.5$  ASCE 7-16, Table 12.2.1  
**Seismic Parameters** Group I Site Class: **D**  
 per ASCE 7-10) PGA (.2 sec) 1.451  $F_a = 1.00$  ASCE 7-16 Table 11.4-1  
 PGA (1 sec) 0.503  $F_v = 1.50$  ASCE 7-16 Table 11.4-2

**Seismic Design Categories per ASCE 7-16 Tables 11.6-1, 11.6-2**

Based on  $S_{ds}$ : **D** Based on  $S_{d1}$ : **D**

PGA's based on peak ground accelerations per latest USGS Hazards Program (based on lat/lon).

$S_s = 1.4510$   $S_{ms} = F_a * S_s = 1.45$  Equation 11.4-1  
 $S_1 = 0.5030$   $S_{m1} = F_v * S_1 = 0.75$  Equation 11.4-2

Equations 11.4-3, 11.4-4  $S_{ds} = 2/3 * S_{ms} = 0.97$   $S_{d1} = 2/3 * S_{m1} = 0.50$   
 Equation 12.14-11  $C_s$  (or %V) =  $(S_{ds} / (R/I)) = 0.149$  **Building period < 0.5 s per IBC eq 12.8-7**

**Base Shear = %V \* W \* 0.7 = 7.19 psf**, uniformly distributed over floor area  
 (0.7 reduction factor per ASCE 7-16, Section 2.4.1, Eq 5) (seismic vertical distribution per IBC eqs 12.8-11 & 12)

	<u>Roof or Floor Wall DL (psf)</u>	<u>Story Height</u>	<u>Lateral</u>
Base = top of footing	<u>DL (psf)</u>	<u>dist. over floor area</u>	<u>Load (psf)</u>
		<u>Above Base (ft)</u>	
Top Framing	15	6	4.07
Upper Floor	12	12	2.63
Main Floor	12	12	0.50
<b>Total Seismic DL:</b>	<b>69</b>	Sum	<b>7.19</b>

WEST SHEAR WALL, UPPER  $L = 29.75'$

$$P_w = 21.3 \text{ psf} (7.2' \times 7.9') + 14.6 \text{ psf} (7.2' \times 4.5') + 16.9 \text{ psf} (1.75' \times 11.4' + 10' \times 8.25' + 1.3' \times 4.5') + 11.6 \text{ psf} (\frac{1}{2} 1.75' \times 1.5' + \frac{1}{2} 10' \times 8' + 1.3' \times 8')$$
$$= \underline{4,115 \text{ lb}}$$

$$P_e = 4.07 \text{ psf} (\frac{1}{2} 29.75' \times 32.5') = 1,968 \text{ lb}$$

$$V = \frac{4,115 \text{ lb}}{29.75'} = 138 \text{ plf} < 230 \text{ plf} \therefore \text{SW1}$$

$$\text{Uplift} = 138 \text{ plf} \times 8.5' = 1,176 \text{ lb} < 1,705 \text{ lb} \therefore \text{CS16}$$
$$< 4,340 \text{ lb} \therefore \text{HDUS}$$

(GARAGE EAST WALL)

$$L = 16.75' + 4' = 20.75'$$

WEST SHEAR WALL, LOWER

$$P_w = 4,115 \text{ lb} + 16.9 \text{ psf} (10.25' \times 9.83' + 18.25' \times 9.75') + 11.6 \text{ psf} (0.5' \times 7' \times 9.25')$$
$$= \underline{9,200 \text{ lb}}$$

$$P_e = 1,968 \text{ lb} + 2.63 \text{ psf} (\frac{1}{2} 53' \times 35' + 5' \times 12.25') = 4,568 \text{ lb}$$

$$V = \frac{9,200 \text{ lb}}{20.75'} = 443 \text{ plf} < 550 \text{ plf} \therefore \text{SW3}$$

$$\text{Uplift} = 443 \text{ plf} \times 9.75' = 4,323 \text{ lb} < 4,340 \text{ lb} \therefore \text{HDUS}$$

CONSULTING STRUCTURAL ENGINEERING SERVICES

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022.033 Date 4-8-22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page L2

MASTER BEDROOM SHEAR WALL, UPPER  $L = 17.25'$

$$P_w = 16.9 \text{ psf} (20.25' \times 4.5' + \frac{1}{2} 9.33' \times 6.75' + 55' \times 8.75' + 4' \times 9.25') \\ + 11.6 \text{ psf} (16.07' \times 8') = 5,058 \text{ lb}$$

$$P_e = 4.07 \text{ psf} (17.5' \times 35') = 2,493 \text{ lb}$$

$$V = \frac{5,058 \text{ lb}}{17.25'} = 293 \text{ plf} < 350 \text{ plf} \therefore \text{SW2}$$

$$\text{Uplift} = 293 \text{ plf} \times 12' = 3,516 \text{ lb} < 4,690 \text{ lb} \therefore \text{CMSTC16} \\ < 4,340 \text{ lb} \therefore \text{HDUS}$$

GREAT ROOM EAST SHEAR WALL, LOWER  $L = 17.75' + \frac{9.33'}{27.08'}$

$$P_w = \left(\frac{19}{22.75}\right) \times 5,058 \text{ lb} + 16.9 \text{ psf} (18.25' \times 9.75' + 11.5' \times 9.75') = 9,126 \text{ lb}$$

$$P_e = \left(\frac{19}{22.75}\right) \times 2,493 \text{ lb} + 2.63 \text{ psf} (18.25' \times 47.5' + 11.5' \times 39') = 5,542 \text{ lb}$$

$$V = \frac{9,126 \text{ lb}}{27.08'} = 337 \text{ plf} < 350 \text{ plf} \therefore \text{SW2}$$

$$\text{Uplift} = 337 \text{ plf} \times 9.75' = 3,286 \text{ lb} < 4,340 \text{ plf} \therefore \text{HDUS}$$

**CONSULTING STRUCTURAL ENGINEERING SERVICES**

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022.033 Date 4/12/22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page L3

EAST SHEAR WALL, UPPER  $L = 4.75' + 7.5' = 12.25'$

$$P_w = 21.3 \text{ psf} (7.2' \times 7.875') + 16.9 \text{ psf} (2.3' \times 11.25') = \underline{1,645 \text{ lb}}$$

$$P_e = 4,107 \text{ psf} (9.5' \times 35') = 1,353 \text{ lb}$$

$$V = \frac{1,645 \text{ lb}}{12.25'} = 134 \text{ plf} < 230 \text{ plf} \therefore \underline{\text{SW 1}}$$

$$\text{Uplift} = 134 \text{ plf} \times 8.5' = 1,141 \text{ lb} < 1,705 \text{ lb} \therefore \text{CS16}$$
$$< 4,340 \text{ lb} \therefore \underline{\text{MDUS}}$$

EAST SHEAR WALL, LOWER  $L = 4.33' + 7.5' + 5' = 16.83'$

$$P_w = 21.3 \text{ psf} (7.2' \times 9.75') + 16.9 \text{ psf} (2.3' \times 9.75') + 1,645 \text{ lb}$$
$$+ \left(\frac{35'}{22.75'}\right) 5,058 \text{ lb} = \underline{4,297 \text{ lb}}$$

$$P_e = 263 \text{ psf} (9.5' \times 31' + 4' \times 8') + 1,353 \text{ lb} + \left(\frac{35'}{22.75'}\right) 2,493 \text{ lb}$$
$$= \underline{2,796 \text{ lb}}$$

$$V = \frac{4,297 \text{ lb}}{16.83'} = 255 \text{ plf} < 350 \text{ plf} \therefore \underline{\text{SW 2}}$$

$$\text{Uplift} = 255 \text{ plf} \times 9.75' + 1,141 \text{ lb} = 3,628 \text{ lb} < 4,340 \text{ lb} \therefore$$
$$\underline{\underline{\text{MDUS}}}$$

**CONSULTING STRUCTURAL ENGINEERING SERVICES**

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022.033 Date 4/12/22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page 4

South Shear wall, upper  $L = 5.33' + 4.5' + 5' = 14.83'$

$$P_w = 14.6 \text{ psf} (3.6' \times 15') + 16.9 \text{ psf} (2.67' \times 7.75' + 12.75' \times 5.415') + 11.6 \text{ psf} (15.5' \times 3.5' + 2.67' \times 3.875' + 12.75' \times 6.3') = \underline{3,986 \text{ lb}}$$

$$P_e = 4.07 \text{ psf} (32.5' \times 15' + 27' \times 17.5') = 3,907 \text{ lb}$$

$$V = \frac{3,986 \text{ lb}}{14.83'} = 269 \text{ plf} < 350 \text{ plf} \therefore \underline{\text{SW2}}$$

$$\text{Uplift} = 269 \text{ plf} \times 8.5' = 2,285 \text{ lb} < 4,690 \text{ lb} \therefore \text{CMST C16} \\ < 4,340 \text{ lb} \therefore \text{HDUS}$$

South Shear Wall, Lower  $L = 6.75' + 9' + 6.5' + 18' + 5.75' = 46'$

$$P_w = 3,986 \text{ lb} + 21.3 \text{ psf} (3.6' \times 3') + 14.6 \text{ psf} (3.6' \times 6.75') + 16.9 \text{ psf} (14' \times 3') + 11.6 \text{ psf} (14' \times 6.75' + 1.33' \times 6.75') = 6,481 \text{ lb}$$

$$P_e = 3,907 \text{ lb} + 2.63 \text{ psf} (35' \times \frac{1}{2} \times 80' + 25' \times 12.25') = \underline{8,395 \text{ lb}}$$

$$V = \frac{8,395 \text{ lb}}{46'} = 183 \text{ plf} < 230 \text{ plf} \therefore \underline{\text{SW1}}$$

$$\text{Uplift} = 183 \text{ plf} \times 10' + 2,285 \text{ lb} = 4,110 \text{ lb} < 4,340 \text{ lb} \\ \therefore \underline{\text{HDUS}}$$

**CONSULTING STRUCTURAL ENGINEERING SERVICES**

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022-033 Date 4-8-22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page LS



NORTH SHEAR WALL UPPER

$$L = 5.5' + 6' + 3.33' = 14.83'$$

$$P_w = 14.6 \text{ psf} (3.6' \times 15') + 16.9 \text{ psf} (11.25' \times 4.375') + 11.6 \text{ psf} (4' \times 15' + 11.25' \times 7.25' + 15.25' \times 3.5') = 3,881 \text{ lb}$$

$$P_e = 3,907 \text{ lb}$$

$$V = \frac{3,907 \text{ lb}}{14.83'} = 263 \text{ plf} < 350 \text{ plf} \left( 1.25 - 0.125 \times \frac{8.5'}{3.33'} \right) = 326 \text{ plf} \therefore \text{SW2}$$

$$Uplift = 263 \text{ plf} \times 8.5' = 2,239 \text{ lb} < \frac{4,340 \text{ lb}}{2} \therefore \text{HDUS} < 4,690 \text{ lb} \approx \text{CMS7C16}$$

NORTH GREAT ROOM SHEAR WALL LOWER

$$L = 18.33' - 6' = 12.33'$$

$$P_w = 3,881 \text{ lb} + 21.3 \text{ psf} (3.6' \times 3.67') + 14.6 \text{ psf} (3.6' \times 6.25') + 16.9 \text{ psf} (13.9' \times 3.67') + 11.6 \text{ psf} (13.9' \times 6.25' + 1.25' \times 6.75') = 6,459 \text{ lb}$$

$$P_e = 4,209 \text{ lb} + 2.63 \text{ psf} \left( \frac{1}{2} \times 33.5' \times 35' \right) = 6,671 \text{ lb}$$

$$V = \frac{6,671 \text{ lb}}{12.33'} = 541 \text{ plf} < 0.83 \times 710 \text{ plf} = 589 \text{ plf} \therefore \text{SW3X}$$

$$Uplift = \frac{6,671 \text{ lb}}{18.33'} \times 9.75' = 3,548 \text{ lb} < \frac{4,340 \text{ lb}}{2} \therefore \text{HDUS}$$

**CONSULTING STRUCTURAL ENGINEERING SERVICES**

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 20221033 Date 4-2-22Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page 16

NORTH SHEAR WALL (EAST BUMPOUT SECTION) LOWER  $L = 8.5'$

$+8.5'$   
 $= 17'$

$$P_w = 6,459 \text{ lb}$$

$$P_c = 2.63 \text{ psf} (27' \times \frac{1}{2} 35' + 4' \times 8' + 4' \times 14.67') = 1,481 \text{ lb}$$

$$V = \frac{6,459 \text{ lb}}{17'} = 380 \text{ plf} < 580 \text{ plf} \therefore \underline{\text{SW3}}$$

$$\text{Uplift} = 380 \text{ plf} \times 9.75' = 3,704 \text{ lb} < 4,340 \text{ lb} \therefore \underline{\text{HDS}}$$

GARAGE WEST SHEAR WALL, LOWER  $L = 17.75'$

$$P_w = 21.3' \times (7.2' \times 7.33') + 16.9 \text{ psf} (3' \times 11.67') = \underline{1,716 \text{ lb}}$$

$$P_c = 4.07 \text{ psf} (\frac{1}{2} 22.5' \times 35') = 1,603 \text{ lb}$$

$$V = \frac{1,716 \text{ lb}}{17.75'} = 97 \text{ plf} < 230 \text{ plf} \therefore \underline{\text{SW1}}$$

$$\text{Uplift} = 97 \text{ plf} \times 9' = 870 \text{ lb} < 4,340 \text{ lb} \therefore \underline{\text{HDS}}$$

**CONSULTING STRUCTURAL ENGINEERING SERVICES**

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022\_033 Date 4-12-22

Project Name NEWYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page 47

GIRTS ROOM EAST SHEAR WALL, CRAWLSPACE  $L=17.75' + 9.33' = 27.08'$

$$P_w = 9,126 \text{ lb} + 16.9 \text{ psf} (18.25' \times 5.5' + 11.5' \times 5.5') = 11,891 \text{ lb}$$

$$P_e = 5,542 \text{ lb} + 0.5 (16' \times 47.5' + \frac{1}{2} 27' \times 35') = 6,158 \text{ lb}$$

$$V = \frac{11,891 \text{ lb}}{27.08'} = 439 \text{ plf} < \text{SSD plf} \therefore \text{SW3}$$

$$\text{Uplift} = 439 \text{ plf} \times 1.5' + 3,286 \text{ lb} = 3,943 \text{ lb} < 4,340 \text{ lb} \therefore \text{HDU5}$$

WEST SHEAR WALL (GARAGE EAST WALL), CRAWLSPACE  $L=11.25'$

$$P_w = \frac{(6.25/20.75)}{20.75} 9,200 \text{ lb} + 16.9 \text{ psf} (10.25' \times 5.5' + 18.25' \times 5.5') = 5,420 \text{ lb}$$

$$P_e = \frac{(6.25/20.75)}{20.75} 1,568 \text{ lb} + 0.5 (10.25' \times 35' + 18.25' \times 30') = 1,829 \text{ lb}$$

$$V = \frac{5,420 \text{ lb}}{11.25'} = 482 \text{ plf} < \text{SSD plf} \therefore \text{SW3}$$

$$\text{Uplift} = 482 \text{ plf} \times 1.5' + 4,323 \text{ lb} = 5,046 \text{ lb} < 5,820 \text{ lb} \therefore \text{HDU8}$$

### CONSULTING STRUCTURAL ENGINEERING SERVICES

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com


Project No. 2022.033 Date 4-12-22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page L8

# AWNING CONNECTION CALCULATION

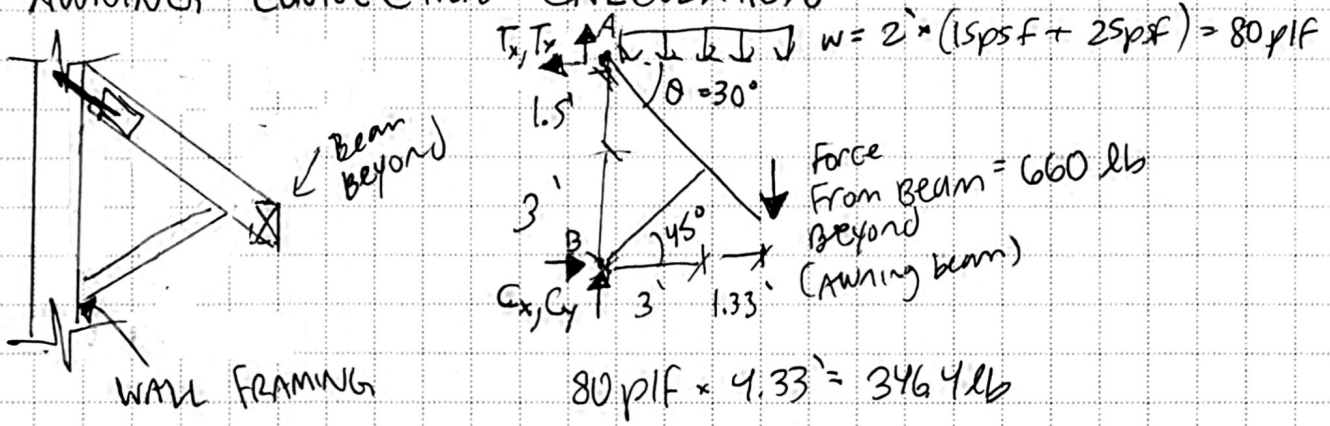

$$\sum M_A = 0 = -4.33' \times 660 \text{ lb} - 346.4 \text{ lb} \times \frac{4.33'}{2} + 4.5' \times C_x$$


$$C_x = T_x = 801.7 \text{ lb}$$

$$\tan 45 = \frac{C_x}{C_y}$$

$$C_y = 801.7 \text{ lb}$$

$$\sum F_y = T_y + C_y - 660 \text{ lb} - 346.4 \text{ lb} = 0$$

$$T_y = 204.7$$

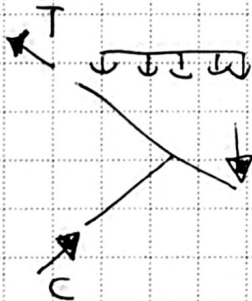

$$T = \sqrt{801.7^2 + 204.7^2} = 827 \text{ lb}$$

$$C = \sqrt{801.7^2 + 801.7^2} = 1,134 \text{ lb}$$

< 1,800 lb

$\therefore$  DTT22

## LAG SCREW PENETRATION:

$\frac{1}{2}$ "  $\varnothing$  screw,  $G = 0.5 \rightarrow$  NDS TABLE 12.2A,  $W = 378 \text{ lb/in}$

$$\frac{1,134 \text{ lb}}{378 \text{ lb/in}} = 3'' \therefore 3.5'' \text{ min.}$$

**CONSULTING STRUCTURAL ENGINEERING SERVICES**

Residential and Commercial Structural Design

6311 17th Avenue NE, Seattle, WA 98115

Phone: (206)527-1288 Email: john@cses-engineering.com

Project No. 2022.033 Date 4-11-22

Project Name NGUYEN

Comments \_\_\_\_\_

Revision \_\_\_\_\_ Page U