

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This tool will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

Please complete the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please contact the WSU Energy Program at energycode@energy.wsu.edu or (360) 956-2042 for assistance.

Project Information

Helix Design Build
 6922 SE 33rd Street
 Mercer island, WA 98040

Contact Information

Erin Jacobsen
 206.910.8758

Heating System Type:

All Other Systems Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions"

Design Temperature

[Instructions](#)

Mercer Island

Design Temperature Difference (ΔT)
 $\Delta T = \text{Indoor (70 degrees)} - \text{Outdoor Design Temp}$

45

Area of Building

Conditioned Floor Area

[Instructions](#)

Conditioned Floor Area (sq ft)

4,186

Average Ceiling Height

[Instructions](#)

Average Ceiling Height (ft)

9.6

Conditioned Volume

40,186

Glazing and Doors

[Instructions](#)

U-0.28

U-Factor X Area = UA
 0.280 X 563 = 157.64

Skylights

[Instructions](#)

U-Factor X Area = UA
 0.50 X 40 = 20.00

Insulation

Attic

[Instructions](#)

R-49

U-Factor X Area = UA
 0.026 X 4,259 = 110.73

Single Rafter or Joist Vaulted Ceilings

[Instructions](#)

No Vaulted Ceilings in this project.

U-Factor X Area = UA
 --- X 0 = ---

Above Grade Walls (see Figure 1)

[Instructions](#)

R-21 Intermediate

U-Factor X Area = UA
 0.056 X 1,737 = 97.27

Floors

[Instructions](#)

R-38

U-Factor X Area = UA
 0.025 X 670 = 16.75

Below Grade Walls (see Figure 1)

[Instructions](#)

R-21 Interior

U-Factor X Area = UA
 0.042 X 1,674 = 70.31

Slab Below Grade (see Figure 1)

[Instructions](#)

R-10 Fully insulated

F-Factor X Length = UA
 0.303 X 173 = 52.42

Slab on Grade (see Figure 1)

[Instructions](#)

R-10 Fully Insulated

F-Factor X Length = UA
 0.360 X 0 = ---


Location of Ducts

[Instructions](#)

Unconditioned Space

Duct Leakage Coefficient

1.10

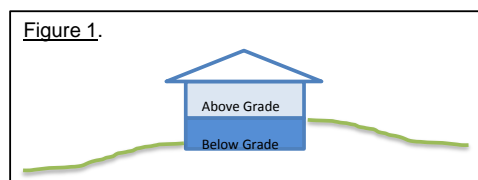

Sum of UA	525.12
Envelope Heat Load	23,631 Btu / Hour
<i>Sum of UA x ΔT</i>	
Air Leakage Heat Load	19,530 Btu / Hour
<i>Volume x 0.6 x ΔT x 0.018</i>	
Building Design Heat Load	43,161 Btu / Hour
<i>Air leakage + envelope heat loss</i>	
Building and Duct Heat Load	47,477 Btu / Hour
<i>Ducts in unconditioned space: sum of building heat loss x 1.10</i>	
<i>Ducts in conditioned space: sum of building heat loss x 1</i>	
Maximum Heat Equipment Output	59,346 Btu / Hour
<i>Building and duct heat loss x 1.40 for forced air furnace</i>	
<i>Building and duct heat loss x 1.25 for heat pump</i>	