
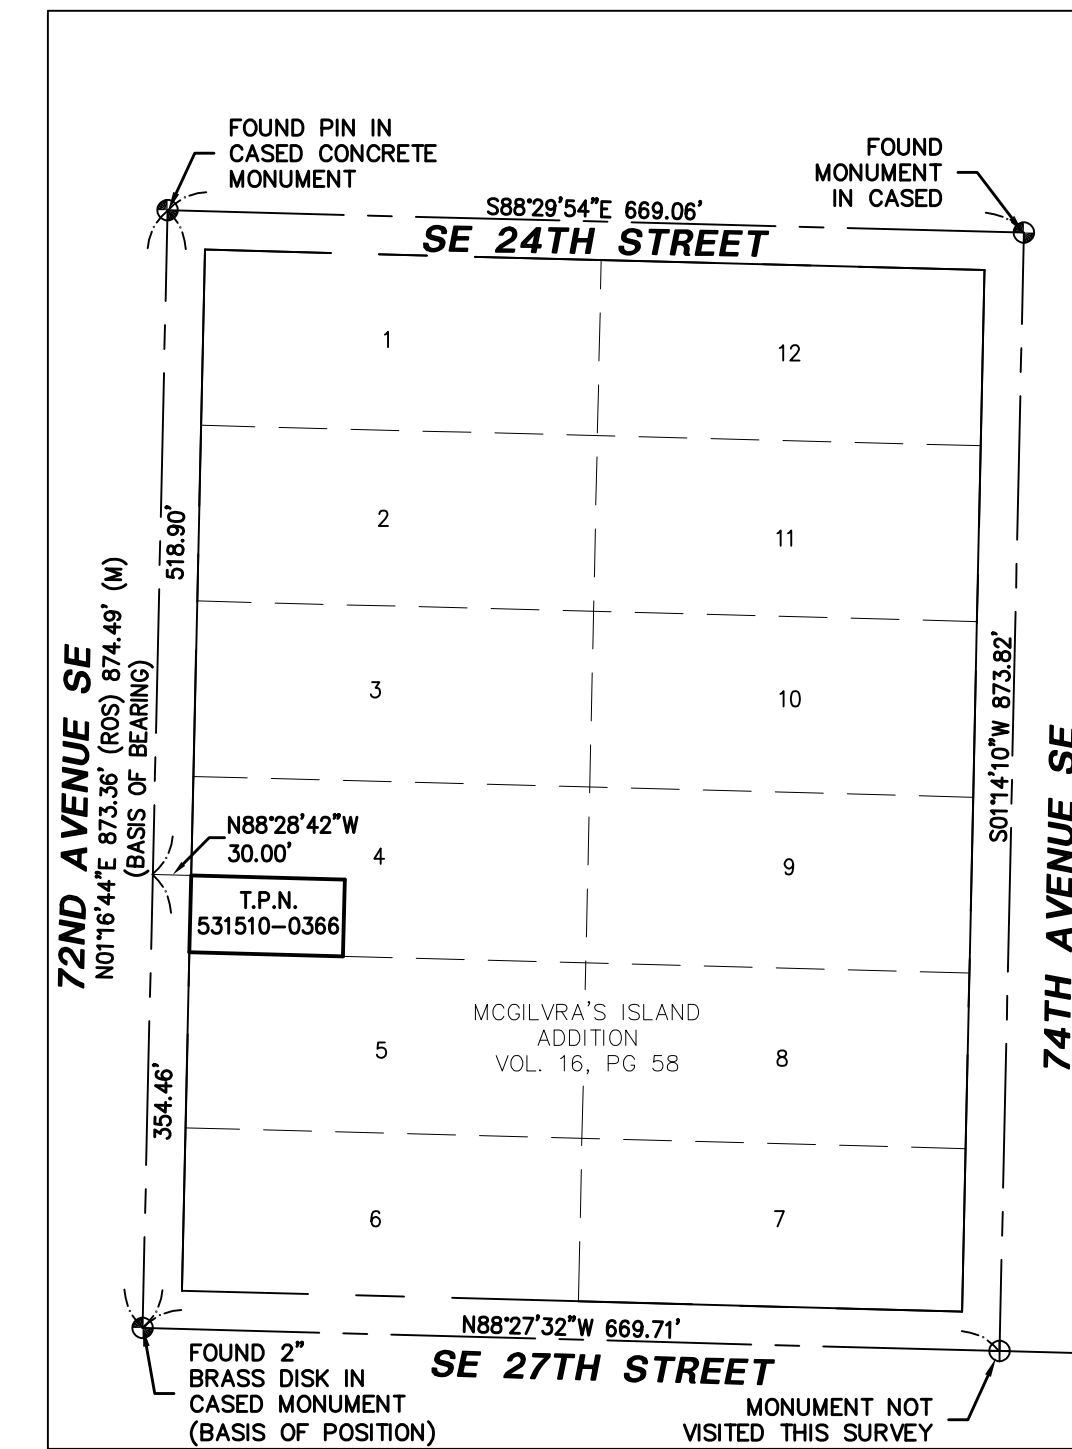
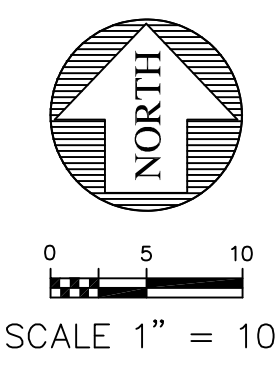


MU HU

A PORTION OF THE NE 1/4 OF THE NW 1/4 OF SEC. 12, T 24 N., R 04 W., W.M.
KING COUNTY, STATE OF WASHINGTON

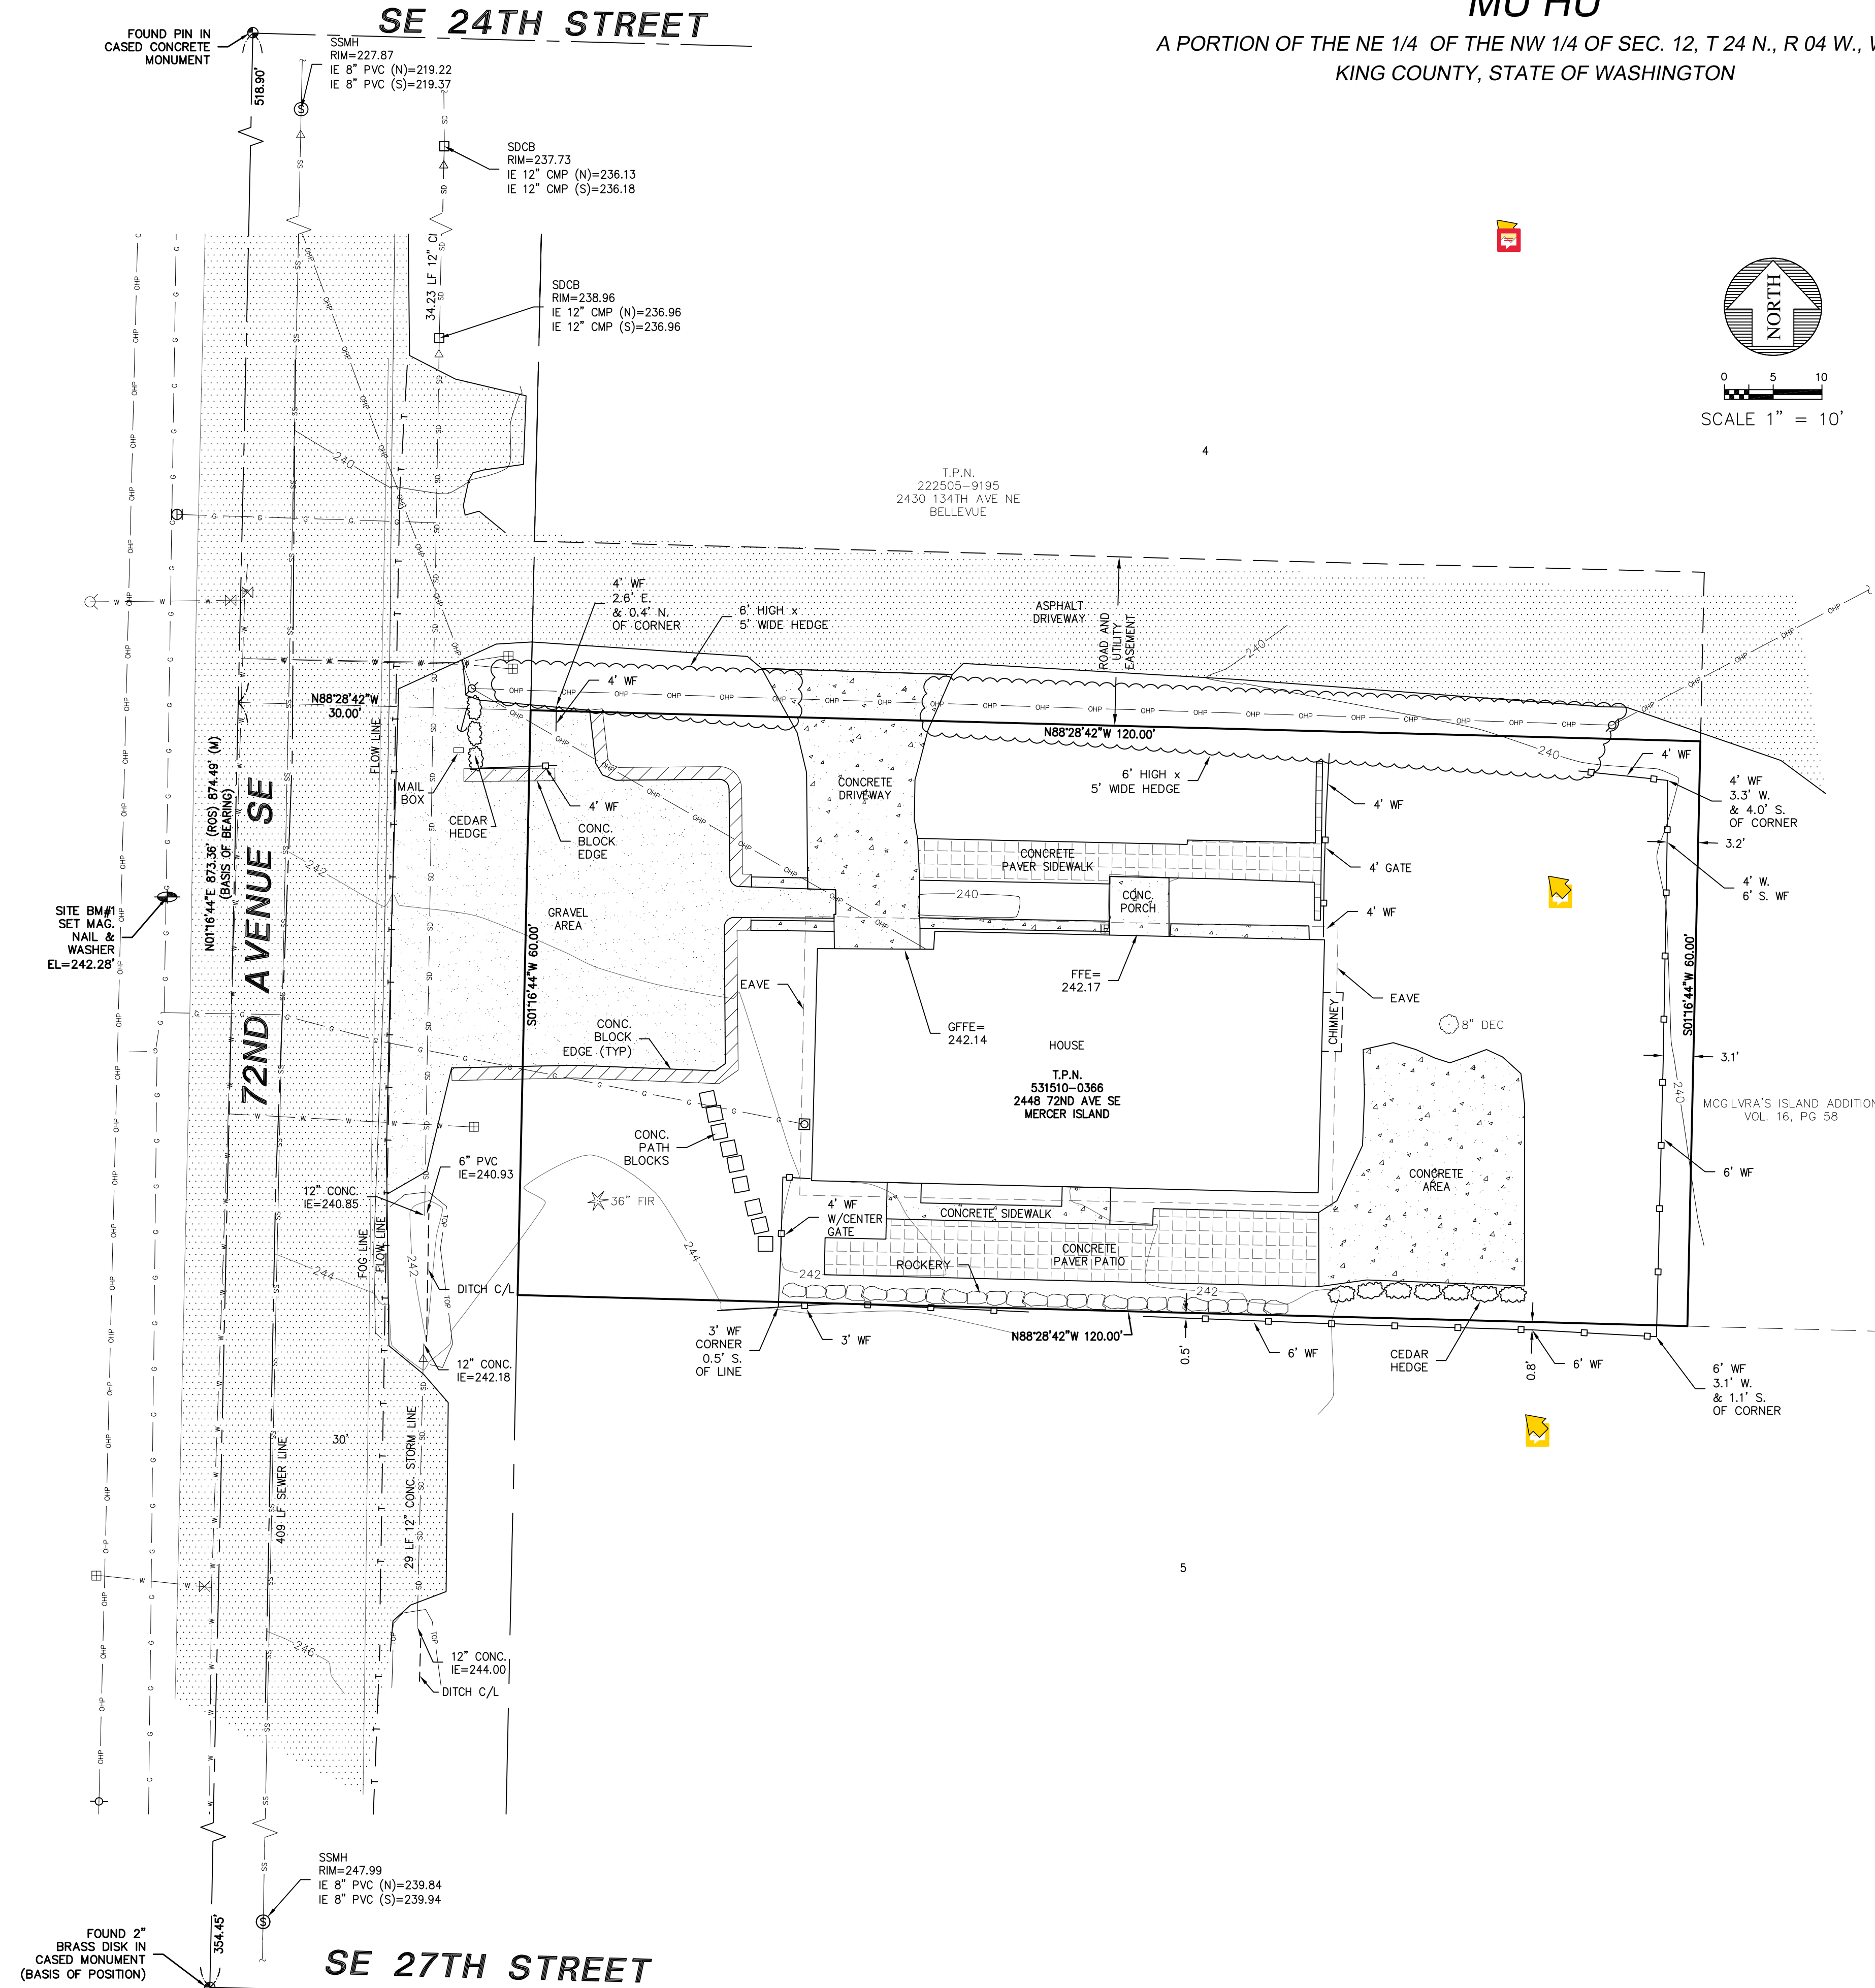

CONTROL DETAIL 1"=150'

LEGEND

- FOUND MONUMENT IN CASE
- MONUMENT NOT VISITED
- FOUND REBAR & CAP
- BENCHMARK
- RECORD OF SURVEY 449/13
- MEASURED
- WATER VALVE
- FIRE HYDRANT
- WATER METER
- IRRIGATION CONTROL VALVE
- SEWER MANHOLE
- CATCH BASIN
- GAS VALVE
- MAILBOX
- ROCKERY
- UTILITY POLE
- GUY ANCHOR
- GAS METER
- OVERHEAD POWER LINE
- FIBER OPTIC LINE
- WATER LINE
- STORM LINE
- SEWER LINE
- GAS LINE
- WOOD FENCE (WF)
- HEDGE LINE
- EVERGREEN TREE
- DECIDUOUS TREE
- CONCRETE
- ASPHALT
- GRAVEL


SURVEY NOTES:

1. HORIZONTAL DATUM: NAD83-2011 EPOCH 2010.00 ESTABLISHED BY OBSERVATIONS TO THE WASHINGTON STATE REFERENCE NETWORK.
2. BASIS OF POSITION: HELD THE FOUND CONCRETE MONUMENT WITH 2" BRASS DISK, IN CASE, AT THE CENTERLINE INTERSECTION OF SE 27TH STREET AND 72ND AVE SE. (SEE MAP FOR LOCATION)
3. BASIS OF BEARINGS: HELD THE BEARING OF N01°10'44"E BETWEEN THE ABOVE NOTED BASIS OF POSITION AND FOUND CONCRETE MONUMENT WITH BRASS PIN, IN CASE, AT THE CENTERLINE INTERSECTION OF SE 24TH ST AND 72ND AVE SE. (SEE MAP FOR LOCATION)
- THIS SURVEY HOLDS RECORD OF SURVEY RECORDED IN VOLUME 449 OF SURVEYS, PAGE 13, FOR THE BLOCK SHOWN HEREON.
- A ROTATION OF 00°00'10" WAS APPLIED TO THE SURVEY IN TO BE ON THE ABOVE NOTED DATUM
4. THE FOLLOWING INFORMATION WAS ALSO REFERENCED IN PREPARING THE BOUNDARY SHOWN HERE ON:
 - A) RECORD OF SURVEY AS RECORDED IN VOLUME 398 OF SURVEYS, PAGE 297, RECORDS OF KING COUNTY, WA.
 - B) MCGILVRA'S ISLAND ADDITION, ACCORDING TO THE PLAT THEREOF RECORDED IN VOLUME 16 OF PLATS, PAGE 58, RECORDS OF KING COUNTY, WASHINGTON.
 - A) KING COUNTY ASSESSOR'S MAP FOR THE NORTHWEST QUARTER OF SECTION 12, TOWNSHIP 24N, RANGE 4E, W.M.
5. VERTICAL DATUM: NAVD 88
- MASTER BENCHMARK: WASHINGTON STATE REFERENCE NETWORK, ELEVATION WAS DETERMINED BY GNSS OBSERVATIONS ON SITE BM #1.
- SITE BM #1: SET MAG NAIL WITH TAG IN ASPHALT 2.5 FEET WEST OF WEST FOG LINE ON 72ND AVE SE, 41-30' SOUTHEAST OF FIRE HYDRANT. ELEVATION= 242.28 FEET
6. TRAVERSING AND DATA COLLECTION WERE PERFORMED USING A SPECTRA AND/OR TRIMBLE 5 SECOND TOTAL STATION. ALL FIELD WORK WAS PERFORMED, AND EQUIPMENT MAINTAINED, IN COMPLIANCE WITH WAC 332-130.
- ADDITIONAL FIELD WORK WAS PERFORMED USING SPECTRA SP-80 GNSS POSITIONING SYSTEMS, THE WASHINGTON STATE REFERENCE NETWORK, AND/OR THE NATIONAL GEODETIC SURVEY'S ONLINE POSITIONING USER SERVICE (OPUS).
7. ALL DISTANCES SHOWN HEREON ARE GROUND DISTANCES UNLESS OTHERWISE NOTED.
8. MONUMENTS SHOWN AS FOUND AND TOPOGRAPHIC INFORMATION SHOWN HEREON ARE THE RESULT OF A SURVEY BY ENCOMPASS, COMPLETED IN JANUARY 2022.
9. THIS SURVEY WAS PERFORMED WITHOUT THE BENEFIT OF A TITLE REPORT. OTHER EASEMENTS AND ENCUMBRANCES MAY EXIST ON THIS PROPERTY THAT ARE NOT SHOWN HEREON.
10. THE LEGAL DESCRIPTION SHOWN HEREON IS PER STATUTORY WARRANTY DEED AS RECORDED UNDER RECORDING NO. 20161128002481, RECORDS OF PIERCE COUNTY, WASHINGTON.
11. THE SUBJECT PROPERTY CONTAINS 7,200 SQUARE FEET OR 0.165 ACRES MORE OR LESS.
12. THE PURPOSE OF THIS EXHIBIT IS TO SHOW EXISTING CONDITIONS ON THE SUBJECT PROPERTY.

LEGAL

THE SOUTH 60 FEET OF THE WEST 120 FEET OF LOT 4, BLOCK 5, MCGILVRA'S ISLAND ADDITION, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 16 OF PLATS, PAGE 58, IN KING COUNTY, WASHINGTON;
TOGETHER WITH AN EASEMENT FOR ROAD AND UTILITY PURPOSES OVER THE SOUTH 17.33 FEET OF THE NORTH 77.33 FEET OF THE WEST 120 FEET OF SAID LOT 4, BLOCK 5, MCGILVRA'S ISLAND ADDITION.

REVISIONS	DESCRIPTION	BY	DATE

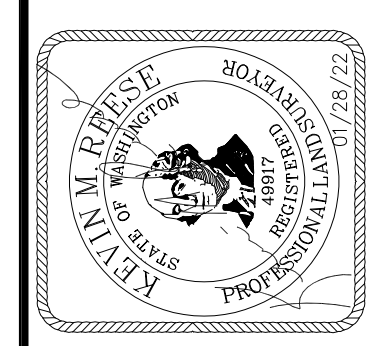



BOUNDARY TOPOGRAPHIC SURVEY FOR MU HU

Encompass
ENGINEERING & SURVEYING
Western Washington Division
165 NE Jumper Street, Suite 201 • Issaquah, WA 98027 • Phone: (425) 392-0250 • Fax: (425) 391-3055
407 Sylvanwater Blvd • Clk Elum, WA 98922 • Phone: (509) 674-7433 • Fax: (509) 674-7419

JOB NO.	21782
DATE	01/28/22
SCALE	1"=10'
DESIGNED	N/A
DRAWN	LFM
CHECKED	JLS
APPROVED	KMR
SHEET	1 OF 1

HU RESIDENCE

SE 1/4 OF SE 1/4 OF SECTION 12, T. 24 N., R. 04 E., W.M.
CITY OF MERCER ISLAND, KING COUNTY, STATE OF WASHINGTON

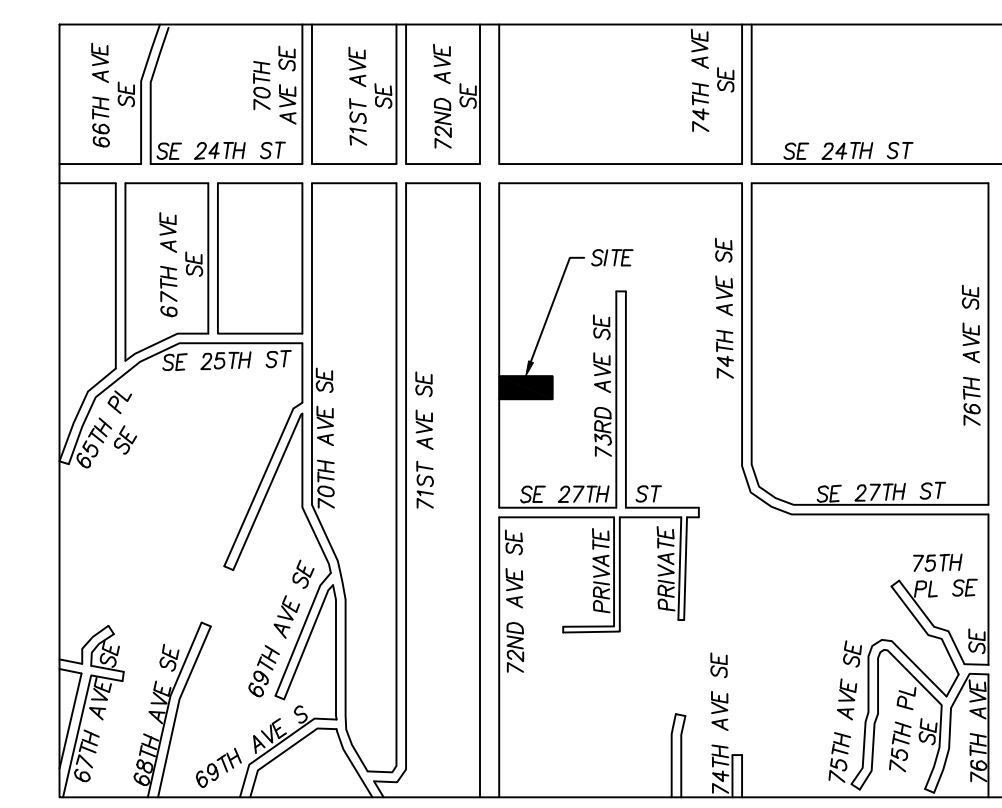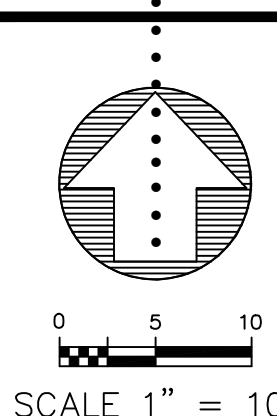

REVISIONS	DESCRIPTION	BY	DATE



06/10/2022

HU RESIDENCE
2448 72ND AVE SE - MERCER ISLAND, WA 98040
COVER SHEET & SITE PLAN

Encompass
ENGINEERING & SURVEYING

Western Washington Division
165 NE Juniper Street, Suite 201 • Issaquah, WA 98027 • Phone: (425) 392-0250
Eastern Washington Division
407 Swiftwater Blvd. • Cle Elum, WA 98922 • Phone: (509) 674-7433

JOB NO.	21782
DATE	06/10/2022
SCALE	1"=10'
DESIGNED	BLB
DRAWN	PMS
CHECKED	CP
APPROVED	CP

SHEET **1 of 5**



PROJECT TEAM:

OWNER: HU MU
2448 72ND AVE SE
MERCER ISLAND, WA 98040
(469) 396-6167

CIVIL ENGINEER/SURVEYOR: BRIANA BENNINGTON, PE / KEVIN REESE, PLS
ENCOMPASS ENGINEERING & SURVEYING
165 N.E. JUNIPER STREET, SUITE 201
ISSAQUAH, WA 98027
(425) 392-0250

ARCHITECT: PAUL MONSEF, RA
ATERA DESIGN STUDIO, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA 98059
(425) 306-2758

GEOTECHNICAL ENGINEER: MARC MCGINNIS, PE
GEOTECH CONSULTANTS, INC.
2401 10TH AVE E
SEATTLE, WA 98102
(425) 747-5618

SITE DATA:

SITE ADDRESS: 2448 72ND AVE SE
MERCER ISLAND, WA 98040

SITE AREA: 7,200 SF (0.165 AC) - AS SURVEYED

TAX PARCEL: 531510-0366

UTILITY DISTRICT INFORMATION:

WATER/SEWER: CITY OF MERCER ISLAND (206) 275-7608

FIRE DISTRICT: MERCER ISLAND FIRE DEPARTMENT (206) 275-7607

CABLE TV: COMCAST (800) 934-6489

GAS/ELECTRIC: PUGET SOUND ENERGY (888) 321-7779

ZONING INFORMATION:

ZONING: R-9.6

FRONT YARD SETBACK: 20'

SIDE YARD SETBACK: 7.5' (15' TOTAL)

REAR YARD SETBACK: 25'

ON-SITE IMPERVIOUS COVERAGE:

HOUSE (ROOF): 2,383 SF

UNCOVERED CONCRETE WALKWAY: 45 SF

UNCOVERED CONCRETE DRIVEWAY (ON-SITE): 444 SF

TOTAL: 2,872 SF (39.89%)

*NOTE: AN ADDITIONAL 312 SF OF PROPOSED DRIVEWAY IS LOCATED OFF-SITE IN THE PUBLIC ROW.

LEGAL DESCRIPTION:

THE SOUTH 60 FEET OF THE WEST 120 FEET OF LOT 4, BLOCK 5, MCGILVRA'S ISLAND ADDITION, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 16 OF PLATS, PAGE 58, IN KING COUNTY, WASHINGTON;

TOGETHER WITH AN EASEMENT FOR ROAD AND UTILITY PURPOSES OVER THE SOUTH 17.33 FEET OF THE NORTH 77.33 FEET OF THE WEST 120 FEET OF SAID LOT 4, BLOCK 5, MCGILVRA'S ISLAND ADDITION.

EXISTING UTILITY NOTE:


ALL LOCATIONS OF EXISTING UTILITIES SHOWN HEREON HAVE BEEN ESTABLISHED BY FIELD SURVEY OR OBTAINED FROM AVAILABLE RECORDS AND SHOULD THEREFORE BE CONSIDERED APPROXIMATE ONLY AND NOT NECESSARILY COMPLETE. IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO INDEPENDENTLY VERIFY THE ACCURACY OF ALL UTILITY LOCATIONS SHOWN AND TO FURTHER DISCOVER AND AVOID ANY OTHER UTILITIES NOT SHOWN HEREON WHICH MAY BE AFFECTED BY THE IMPLEMENTATION OF THIS PLAN.

CONTRACTOR RESPONSIBILITY:

CONTRACTOR AGREES THAT HE SHALL ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS, INCLUDING THE SAFETY OF ALL PERSONS AND PROPERTY DURING THE COURSE OF CONSTRUCTION OF THIS PROJECT, AND THAT THIS REQUIREMENT SHALL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS. THE CONTRACTOR SHALL DEFEND, INDEMNIFY AND HOLD THE OWNER AND THE ENGINEER HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING FOR LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE OWNER OR THE ENGINEER.

DISCREPANCIES:

IF THERE ARE ANY DISCREPANCIES BETWEEN DIMENSIONS IN DRAWINGS AND EXISTING CONDITIONS WHICH WILL AFFECT THE WORK, THE CONTRACTOR SHALL BRING SUCH DISCREPANCIES TO THE ATTENTION OF THE ENGINEER FOR ADJUSTMENT BEFORE PROCEEDING WITH THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER FITTING OF ALL WORK AND FOR THE COORDINATION OF ALL TRADES, SUBCONTRACTORS, AND PERSONS ENGAGED UPON THIS CONTRACT.

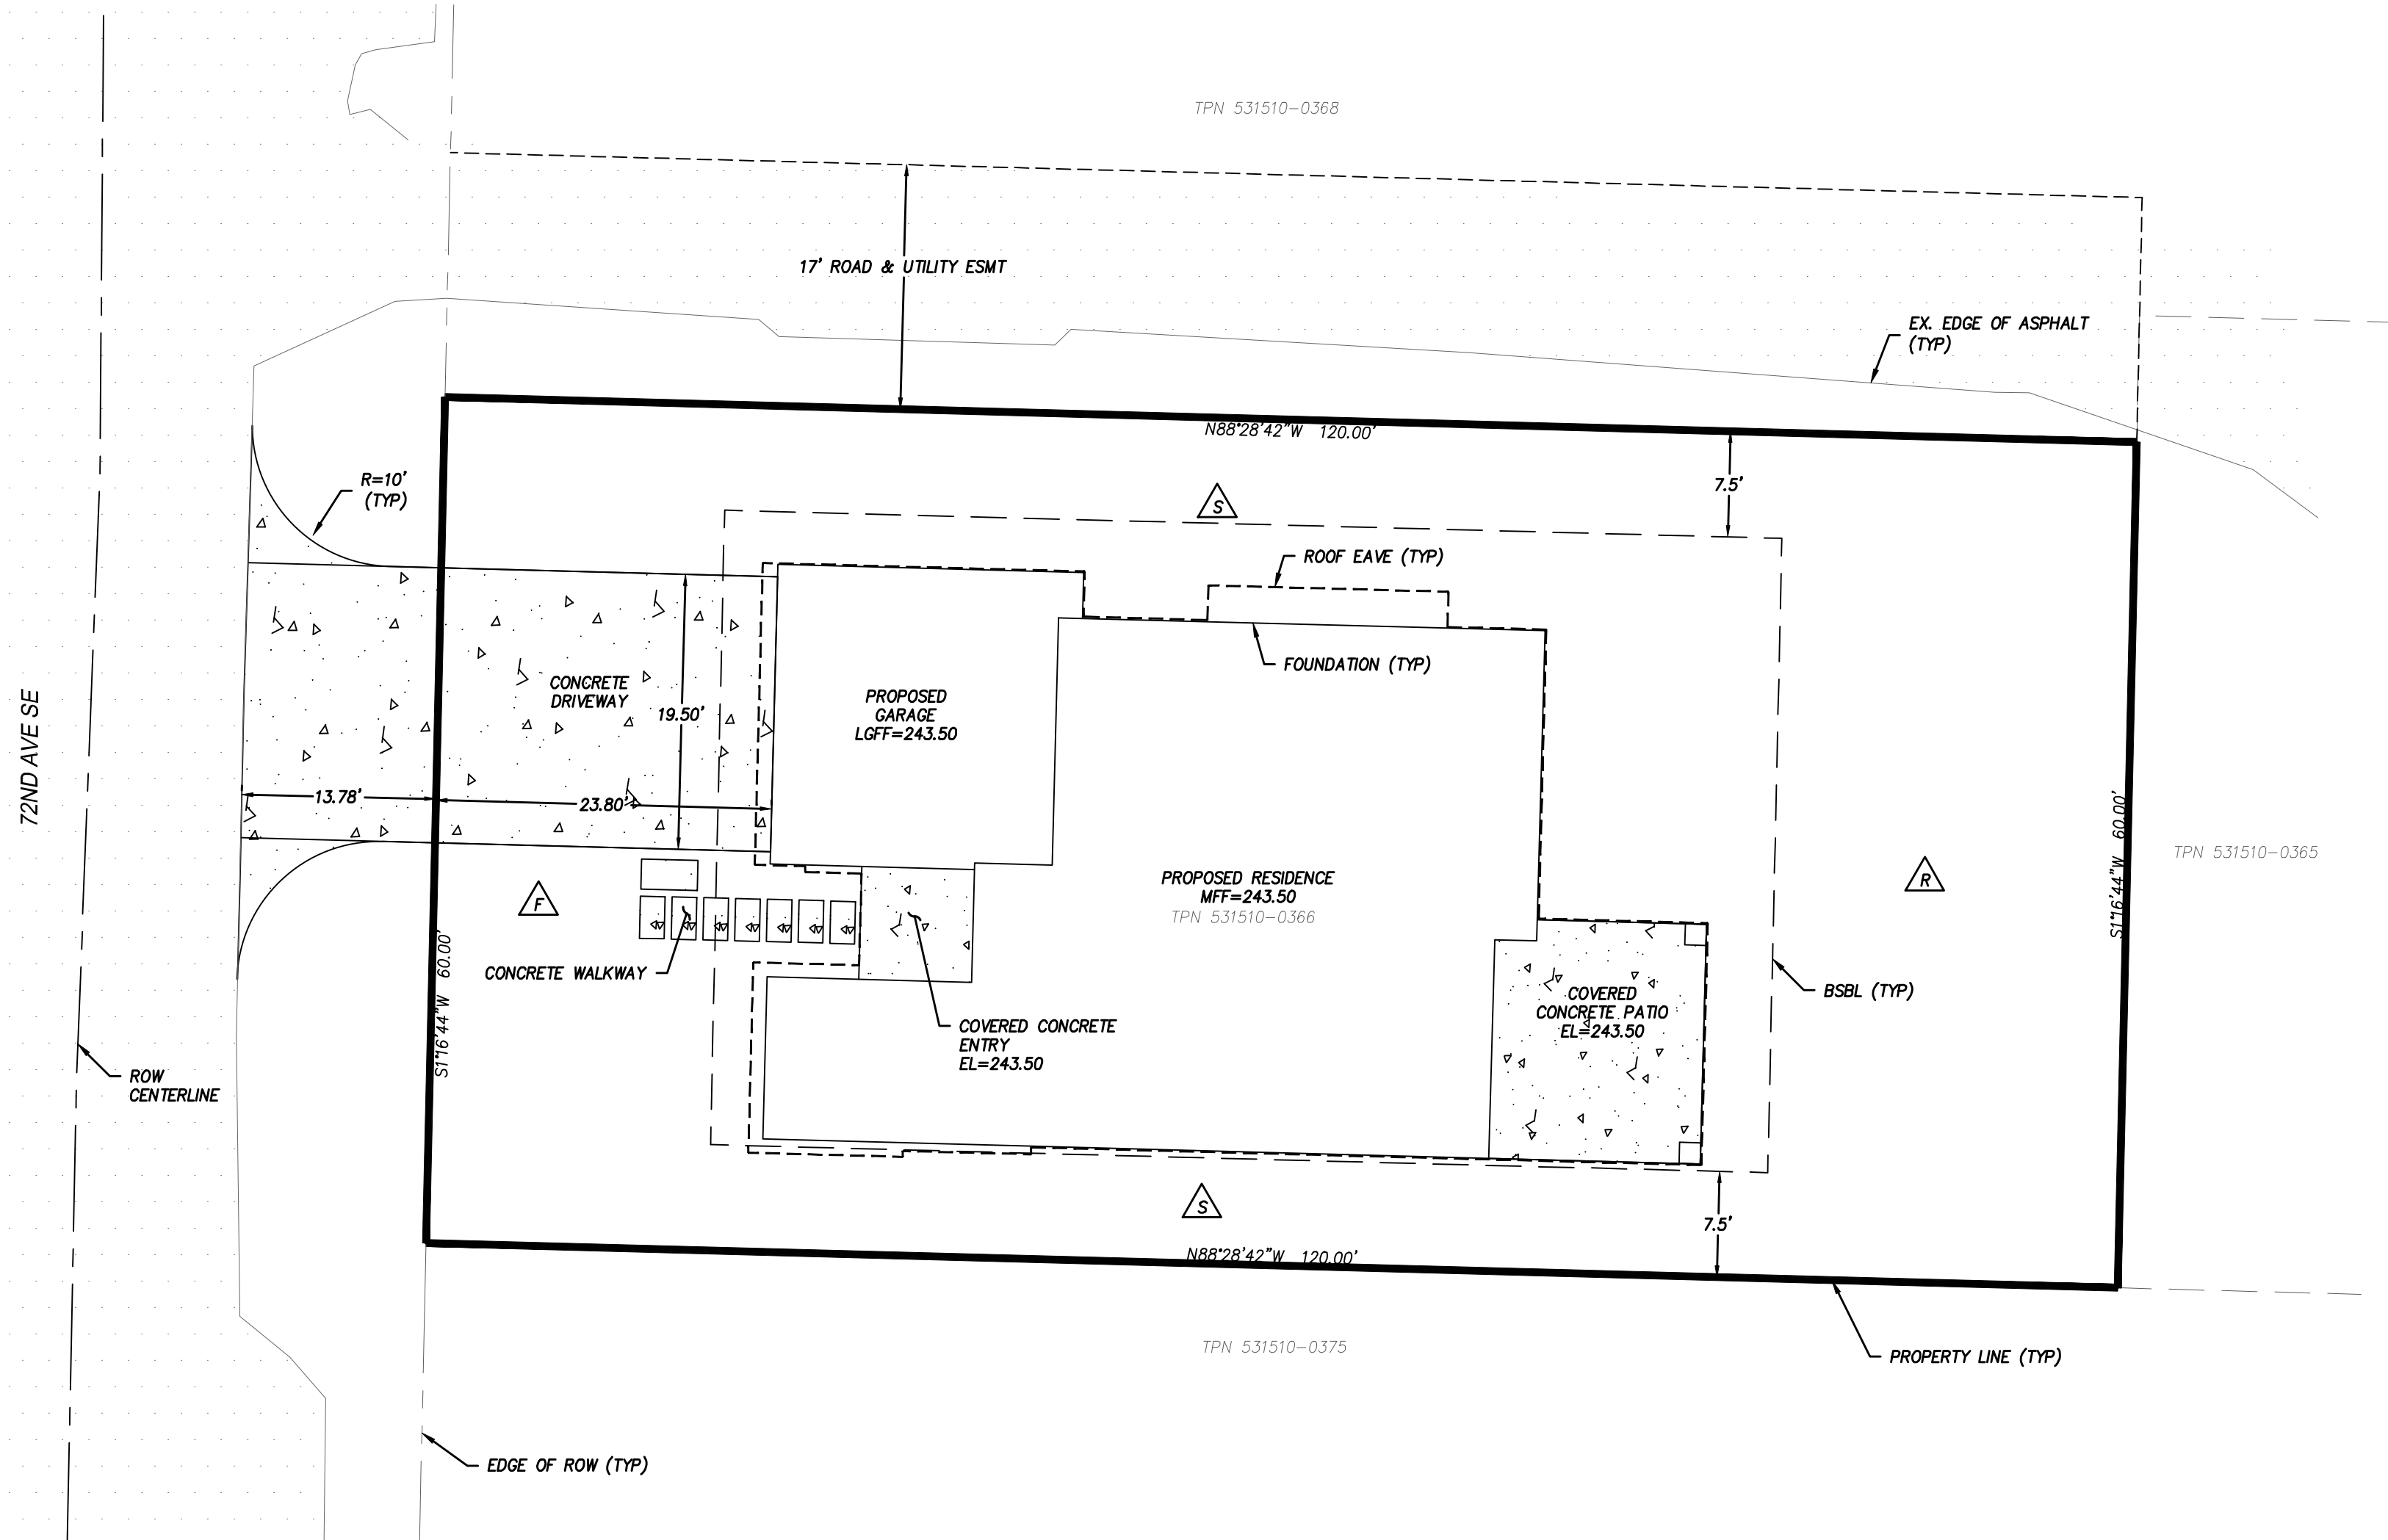

SHEET INDEX:

TITLE	NO.
COVER SHEET & SITE PLAN	1
TESC PLAN	2
TESC DETAILS	3
GRADING & UTILITY PLAN	4
CONSTRUCTION DETAILS	5

FILENAME: J:\21\21782 - HU HU\ENGINEERING\PLAN SHEETS\1 - COVER.DWG

HU RESIDENCE

SE 1/4 OF SE 1/4 OF SECTION 12, T. 24 N., R. 04 E., W.M.
CITY OF MERCER ISLAND, KING COUNTY, STATE OF WASHINGTON

EROSION & SEDIMENT CONTROL NOTES:

- APPROVAL OF THIS EROSION/SEDIMENTATION CONTROL (ESC) PLAN DOES NOT CONSTITUTE AN APPROVAL OF PERMANENT ROAD OR DRAINAGE DESIGN (E.G., SIZE AND LOCATION OF ROADS, PIPES, RESTRICTORS, CHANNELS, RETENTION FACILITIES, UTILITIES, ETC.).
- THE IMPLEMENTATION OF THIS ESC PLAN AND THE CONSTRUCTION, MAINTENANCE, REPLACEMENT, AND UPGRADING OF THESE ESC FACILITIES IS THE RESPONSIBILITY OF THE PERMITTEE/CONTRACTOR UNTIL ALL CONSTRUCTION IS APPROVED.
- THE BOUNDARIES OF THE CLEARING LIMITS SHOWN ON THIS PLAN SHALL BE SET BY SURVEY AND CLEARLY FLAGGED IN THE FIELD BY A CLEARING CONTROL FENCE PRIOR TO CONSTRUCTION. DURING THE CONSTRUCTION PERIOD, NO DISTURBANCE OR REMOVAL OF ANY GROUND COVER BEYOND THE FLAGGED CLEARING LIMITS SHALL BE PERMITTED. THE FLAGGING SHALL BE MAINTAINED BY THE PERMITTEE/CONTRACTOR FOR THE DURATION OF CONSTRUCTION.
- THE ESC FACILITIES SHOWN ON THIS PLAN MUST BE CONSTRUCTED PRIOR TO OR IN CONJUNCTION WITH ALL CLEARING AND GRADING ACTIVITIES IN SUCH A MANNER AS TO ENSURE THAT SEDIMENT-LADEN WATER DOES NOT ENTER THE DRAINAGE SYSTEM OR VIOLATE APPLICABLE WATER STANDARDS. WHEREVER POSSIBLE, MAINTAIN NATURAL VEGETATION FOR SILT CONTROL.
- THE ESC FACILITIES SHOWN ON THIS PLAN ARE THE MINIMUM REQUIREMENTS FOR ANTICIPATED SITE CONDITIONS. DURING THE CONSTRUCTION PERIOD, THESE ESC FACILITIES SHALL BE UPGRADED (E.G., ADDITIONAL SUMPS, RELOCATION OF DITCHES AND SILT FENCES, ETC.) AS NEEDED FOR UNEXPECTED STORM EVENTS. ADDITIONALLY, MORE ESC FACILITIES MAY BE REQUIRED TO ENSURE COMPLETE SILTATION CONTROL. THEREFORE, DURING THE COURSE OF CONSTRUCTION IT SHALL BE THE OBLIGATION AND RESPONSIBILITY OF THE CONTRACTOR TO ADDRESS ANY NEW CONDITIONS THAT MAY BE CREATED BY HIS ACTIVITIES AND TO PROVIDE ADDITIONAL FACILITIES OVER AND ABOVE THE MINIMUM REQUIREMENTS AS MAY BE NEEDED.
- THE ESC FACILITIES SHALL BE INSPECTED BY THE PERMITTEE/CONTRACTOR DAILY DURING NON-RAINFALL PERIODS, EVERY HOUR (DAYLIGHT) DURING A RAINFALL EVENT, AND AT THE END OF EVERY RAINFALL, AND MAINTAINED AS NECESSARY TO ENSURE THEIR CONTINUED FUNCTIONING. IN ADDITION, TEMPORARY SILTATION PONDS AND ALL TEMPORARY SILTATION CONTROLS SHALL BE MAINTAINED IN A SATISFACTORY CONDITION UNTIL SUCH TIME THAT CLEARING AND/OR CONSTRUCTION IS COMPLETED, PERMANENT DRAINAGE FACILITIES ARE OPERATIONAL, AND THE POTENTIAL FOR EROSION HAS PASSED. WRITTEN RECORDS SHALL BE KEPT DOCUMENTING THE REVIEWS OF THE ESC FACILITIES.
- THE ESC FACILITIES ON INACTIVE SITES SHALL BE INSPECTED AND MAINTAINED A MINIMUM OF ONCE A MONTH OR WITHIN 48 HOURS FOLLOWING A STORM EVENT.
- ALL DENUDED SOILS MUST BE STABILIZED WITH AN APPROVED TESC METHOD (E.G. SEEDING, MULCHING, PLASTIC COVERING, CRUSHED ROCK) WITHIN THE FOLLOWING TIMELINES:
 - APRIL 1 TO OCTOBER 31 - SOILS MUST BE STABILIZED WITHIN 7 DAYS OF GRADING.
 - NOVEMBER 1 TO MARCH 31 - SOILS MUST BE STABILIZED WITHIN 2 DAYS OF GRADING.
- AT NO TIME SHALL MORE THAN 1' OF SEDIMENT BE ALLOWED TO ACCUMULATE WITHIN A CATCH BASIN. ALL CATCH BASINS AND CONVEYANCE LINES SHALL BE CLEANED PRIOR TO PAVING. THE CLEANING OPERATION SHALL NOT FLUSH SEDIMENT-LADEN WATER INTO THE DOWNSTREAM SYSTEM.
- STABILIZED CONSTRUCTION ENTRANCES SHALL BE INSTALLED AT THE BEGINNING OF CONSTRUCTION AND MAINTAINED FOR THE DURATION OF THE PROJECT. ADDITIONAL MEASURES, SUCH AS WASH PADS, MAY BE REQUIRED TO ENSURE THAT ALL PAVED AREAS ARE KEPT CLEAN FOR THE DURATION OF THE PROJECT.
- ANY PERMANENT RETENTION/DETENTION FACILITY USED AS A TEMPORARY SETTLING BASIN SHALL BE MODIFIED WITH THE NECESSARY EROSION CONTROL MEASURES AND SHALL PROVIDE ADEQUATE STORAGE CAPACITY. IF THE PERMANENT FACILITY IS TO FUNCTION ULTIMATELY AS AN INFILTRATION OR DISPERSION SYSTEM, THE FACILITY SHALL NOT BE USED AS A TEMPORARY SETTLING BASIN, NO UNDERGROUND DETENTION TANK, DETENTION VAULT, OR SYSTEM WHICH BACKS UNDER OR INTO A POND SHALL BE USED AS A TEMPORARY SETTLING BASIN.
- WHERE SEEDING FOR TEMPORARY EROSION CONTROL IS REQUIRED, FAST GERMINATING GRASSES SHALL BE APPLIED AT AN APPROPRIATE RATE (EXAMPLE: ANNUAL OR PERENNIAL RYE APPLIED AT APPROXIMATELY 80 POUNDS PER ACRE).
- WHERE STRAW MULCH IS REQUIRED FOR TEMPORARY EROSION CONTROL, IT SHALL BE APPLIED AT A MINIMUM THICKNESS OF 2".
- ALL EROSION/SEDIMENTATION CONTROL PONDS WITH A DEAD STORAGE DEPTH EXCEEDING 6" MUST HAVE A PERIMETER FENCE WITH A MINIMUM HEIGHT OF 3'.
- ALL WORK AND MATERIALS SHALL BE IN ACCORDANCE WITH CITY OF MERCER ISLAND STANDARDS AND SPECIFICATIONS.
- THE ESC FACILITIES SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE DETAILS ON THE APPROVED PLANS. LOCATIONS MAY BE MOVED TO SUIT FIELD CONDITIONS, SUBJECT TO APPROVAL BY THE ENGINEER AND THE CITY OF MERCER ISLAND INSPECTOR.
- A COPY OF THE APPROVED EROSION CONTROL PLANS MUST BE ON THE JOB SITE WHENEVER CONSTRUCTION IS IN PROGRESS.
- ALL LOTS ADJOINING OR HAVING ANY NATIVE GROWTH PROTECTION EASEMENTS (NGPE) SHALL HAVE A 4' HIGH TEMPORARY CONSTRUCTION FENCE (CYCLONE OR PLASTIC MESH) SEPARATING THE LOT (OR BUILDABLE PORTIONS OF THE LOT) FROM THE AREA RESTRICTED BY THE NGPE AND SHALL BE INSTALLED PRIOR TO ANY GRADING OR CLEARING AND REMAIN IN PLACE UNTIL A DWELLING IS CONSTRUCTED AND OWNERSHIP TRANSFERRED TO THE FIRST OWNER/OCCUPANT.
- CLEARING LIMITS SHALL BE DELINEATED WITH A CLEARING CONTROL FENCE. THE CLEARING CONTROL FENCE SHALL CONSIST OF A 6-FT. HIGH CHAIN LINK FENCE ADJACENT TO THE DRAIN LINE OF TREES TO BE SAVED, WETLAND OR STREAM BUFFERS, AND SENSITIVE SLOPES. CLEARING CONTROL FENCES ALONG WETLAND OR STREAM BUFFERS OR SLOPES SHALL BE ACCOMPANIED BY AN EROSION CONTROL FENCE. IF APPROVED BY THE CITY, A FOUR-FOOT HIGH ORANGE MESH CLEARING CONTROL FENCE MAY BE USED TO DELINEATE CLEARING LIMITS IN ALL OTHER AREAS.
- OFF-SITE STREETS MUST BE KEPT CLEAN AT ALL TIMES. IF DIRT IS DEPOSITED ON THE PUBLIC STREET SYSTEM, THE STREET SHALL BE IMMEDIATELY CLEANED WITH POWER SWEEPER OR OTHER EQUIPMENT. ALL VEHICLES SHALL LEAVE THE SITE BY WAY OF THE CONSTRUCTION ENTRANCE AND SHALL BE CLEANED OF ALL DIRT THAT WOULD BE DEPOSITED ON THE PUBLIC STREETS.
- ANY CATCH BASINS COLLECTING RUNOFF FROM THE SITE, WHETHER THEY ARE ON OR OFF THE SITE, SHALL HAVE THEIR GRATES COVERED WITH FILTER FABRIC DURING CONSTRUCTION. CATCH BASINS DIRECTLY DOWNSTREAM OF THE CONSTRUCTION ENTRANCE OR ANY OTHER CATCH BASIN AS DETERMINED BY THE CITY INSPECTOR SHALL BE PROTECTED WITH A "FILTER FABRIC SOCK" OR EQUIVALENT.
- THE WASHED GRAVEL BACKFILL ADJACENT TO THE FILTER FABRIC FENCE SHALL BE REPLACED AND THE FILTER FABRIC CLEANED IF IT IS NONFUNCTIONAL BY EXCESSIVE SILT ACCUMULATION AS DETERMINED BY THE CITY OF KIRKLAND. ALSO, ALL INTERCEPTOR SWALES SHALL BE CLEANED IF SILT ACCUMULATION EXCEEDS ONE-QUARTER DEPTH.
- ROCK FOR EROSION PROTECTION OF ROADWAY DITCHES, WHERE REQUIRED, MUST BE OF SOUND QUARRY ROCK, PLACED TO A DEPTH OF 1' AND MUST MEET THE FOLLOWING SPECIFICATIONS: 4"-8" ROCK/40 % -70 % PASSING; 2"-4" ROCK/30 % -40 % PASSING; AND 1"-2" ROCK/10 % -20 % PASSING.
- IF ANY PART(S) OF THE CLEARING LIMIT BOUNDARY OR TEMPORARY EROSION/SEDIMENTATION CONTROL PLAN IS/ARE DAMAGED, IT SHALL BE REPAIRED IMMEDIATELY.
- ALL PROPERTIES ADJACENT TO THE PROJECT SITE SHALL BE PROTECTED FROM SEDIMENT DEPOSITION AND RUNOFF.
- DO NOT FLUSH CONCRETE BY-PRODUCTS OR TRUCKS NEAR OR INTO THE STORM DRAINAGE SYSTEM. IF EXPOSED AGGREGATE IS FLUSHED INTO THE STORM SYSTEM, IT COULD MEAN RE-CLEANING THE ENTIRE DOWNSTREAM STORM SYSTEM, OR POSSIBLY RE-LAYING THE STORM LINE.
- PRIOR TO OCTOBER 1 OF EACH YEAR (THE BEGINNING OF THE WET SEASON), ALL DISTURBED AREAS SHALL BE REVIEWED TO IDENTIFY WHICH ONES CAN BE SEEDED IN PREPARATION FOR THE WINTER RAINS. THE IDENTIFIED DISTURBED AREA SHALL BE SEEDED WITHIN ONE WEEK AFTER OCTOBER 1. A SITE PLAN DEPICTING THE AREAS TO BE SEEDED AND THE AREAS TO REMAIN UNCOVERED SHALL BE SUBMITTED TO THE PUBLIC WORKS CONSTRUCTION INSPECTOR. THE INSPECTOR CAN REQUIRE SEEDING OF ADDITIONAL AREAS IN ORDER TO PROTECT SURFACE WATERS, ADJACENT PROPERTIES, OR DRAINAGE FACILITIES.
- IF A SEDIMENT POND IS NOT PROPOSED, A BAKER TANK OR OTHER TEMPORARY GROUND AND/OR SURFACE WATER STORAGE TANK MAY BE REQUIRED DURING CONSTRUCTION, DEPENDING ON WEATHER CONDITIONS.
- ANY AREA TO BE USED FOR INFILTRATION OR PERVIOUS PAVEMENT (INCLUDING A 5-FOOT BUFFER) MUST BE SURROUNDED BY SILT FENCE PRIOR TO CONSTRUCTION AND UNTIL FINAL STABILIZATION OF THE SITE TO PREVENT SOIL COMPACTION AND SILTATION BY CONSTRUCTION ACTIVITIES.

TREE PROTECTION MEASURES

TREE PROTECTION FENCING FOR DEMOLITION:

- TREE PROTECTION FENCES WILL NEED TO BE PLACED AROUND EACH TREE OR GROUP OF TREES TO BE RETAINED.
- TREE PROTECTION FENCES ARE TO BE PLACED ACCORDING TO THE ATTACHED DRAWINGS.
- TREE PROTECTION FENCES MUST BE INSPECTED AND APPROVED BY THE CITY PRIOR TO THE BEGINNING OF ANY DEMOLITION OR CONSTRUCTION WORK ACTIVITIES.
- NOTHING MUST BE PARKED OR STORED WITHIN THE TREE PROTECTION FENCES—NO EQUIPMENT, VEHICLES, SOIL, DEBRIS, OR CONSTRUCTION SUPPLIES OF ANY SORTS.
- THE AREA OUTSIDE THE TREE PROTECTION FENCES IS THE WORK/DEVELOPMENT ZONE.
- THE AREA INSIDE THE TREE PROTECTION FENCES IS THE TREE PROTECTION ZONE.
- FENCES SHALL BE ANCHORED SO THEY CAN NOT BE MOVED.

SONGS:

- THE TREE PROTECTION FENCES NEED TO BE CLEARLY MARKED WITH THE FOLLOWING OR SIMILAR TEXT IN FOUR INCH OR LARGER LETTERS:
 - TREE PROTECTION FENCE
 - DO NOT ENTER THIS AREA
 - DO NOT PARK OR STORE MATERIALS WITHIN THE PROTECTION AREA

- ANY QUESTIONS, CONTACT MERCER ISLAND CODE COMPLIANCE: (206) 275-7712 CODECOMPLIANCE@MERCERGOV.ORG
- TREE PROTECTION FENCES MUST BE INSPECTED AND APPROVED BY THE CITY PRIOR TO ANY DEMOLITION OR CLEAN-UP WORK BEGINNING.
- ANY EXCAVATION, INCLUDING FOUNDATION, NEAR TREES 451, 453 OR 455 SHALL HAVE ARBORIST SUPERVISION
- MINIMIZE OVER EXCAVATION FOR FOUNDATIONS
- THE ARBORIST SHALL SUPERVISE TREE/SHRUB REMOVAL—AVOID ALL DAMAGE TO EXCEPTIONAL AND CITY TREE ROOTS

MULCH:

- THE AREA WITHIN THE TREE PROTECTION FENCING MUST BE COVERED WITH WOOD CHIPS, HOG FUEL, OR SIMILAR MATERIALS TO A DEPTH OF 6 TO 8 INCHES. THE MATERIALS SHOULD BE PLACED PRIOR TO BEGINNING CONSTRUCTION AND REMAIN UNTIL THE TREE PROTECTION FENCING IS TAKEN DOWN.

CANOPY PRUNING:

- THE CANOPIES OF SOME OF THE TREES MAY NEED TO PROPERLY PRUNED TO ALLOW FOR EQUIPMENT, BUILDING, AND CONSTRUCTION CLEARANCE. THE PRUNING MUST BE DONE BY AN INTERNATIONAL SOCIETY OF ARBORICULTURE (ISA) CERTIFIED ARBORIST USING CURRENT INDUSTRY STANDARD PRUNING TECHNIQUES. (ANSI A300 PRUNING STANDARDS AND ANSI Z13.1 SAFETY STANDARDS AS WELL AS ALL OSHA, WSHA, AND LOCAL STANDARDS MUST BE FOLLOWED.)
- PLANT DEBRIS CAN BE CHIPPED AND UTILIZED ON SITE FOR THE MULCH UNDER THE TREES.

DEMOLITION AND REMOVAL OF THE EXISTING IMPROVEMENTS:

- WHEN DEMOLITION OCCURS, CONSTRUCTION EQUIPMENT MUST BE KEPT OUTSIDE THE TREE PROTECTION ZONE.
- DEMOLITION MUST BE FOLLOW THIS PROCESS TO PROTECT THE LONG TERM SURVIVABILITY OF THE TREES:
 - ANY EXCAVATION, INCLUDING FOUNDATION, NEAR TREES 451, 453 OR 455 SHALL HAVE ARBORIST SUPERVISION
 - THE INTERNATIONAL SOCIETY OF ARBORICULTURE (ISA) CERTIFIED ARBORIST MUST BE WORKING WITH AND IN CONTROL OF ALL EQUIPMENT OPERATORS.
 - THE CERTIFIED ARBORIST SHOULD BE OUTFITTED WITH A SHOVEL, HAND PRUNERS, A PAIR OF LOPPERS, A HANDSAW, AND A POWER SAW (A RECIPROCATING SAW, SUCH AS A "SAWSALL" IS RECOMMENDED).

SOIL MANAGEMENT AREAS:

- (A) STOCKPILE EXISTING TOP SOIL (3,076 SF), REPLACE AND AMEND AS NEEDED
- (B) UNDISTURBED EXISTING SOIL (1,715 SF)

POST-CONSTRUCTION SOIL MANAGEMENT

THE LAWN AND LANDSCAPE AREAS ARE REQUIRED TO PROVIDE POST-CONSTRUCTION SOIL QUALITY AND DEPTH IN ACCORDANCE WITH BMP 15.13. THE PROJECT CIVIL ENGINEER MUST PROVIDE A LETTER OF CERTIFICATION TO ENSURE THAT THE LAWN AND LANDSCAPE AREAS ARE MEETING THE POST-CONSTRUCTION SOIL QUALITY AND DEPTH REQUIREMENTS SPECIFIED ON THE APPROVED PLAN SET PRIOR TO FINAL INSPECTION OF THE PROJECT.

BMP 15.13: POST-CONSTRUCTION SOIL QUALITY AND DEPTH (FROM 2014 DEPT. OF ECOLOGY SWMMWW)
NATURALLY OCCURRING (UNDISTURBED) SOIL AND VEGETATION PROVIDE IMPORTANT STORMWATER FUNCTIONS INCLUDING: WATER INFILTRATION; NUTRIENT, SEDIMENT, AND POLLUTANT ADSORPTION; SEDIMENT AND POLLUTANT BIOFILTRATION; WATER INTERFLOW STORAGE AND TRANSMISSION; AND POLLUTANT DECOMPOSITION. THESE FUNCTIONS ARE LARGELY LOST WHEN DEVELOPMENT STRIPS AWAY NATIVE SOIL AND VEGETATION AND REPLACES IT WITH MINIMAL TOPSOIL AND SOIL. NOT ONLY ARE THESE IMPORTANT STORMWATER FUNCTIONS LOST, BUT SUCH LANDSCAPES THEMSELVES BECOME POLLUTION GENERATING PERVIOUS SURFACES DUE TO INCREASED USE OF PESTICIDES, FERTILIZERS AND OTHER LANDSCAPING AND HOUSEHOLD/INDUSTRIAL CHEMICALS, THE CONCENTRATION OF PET WASTES, AND POLLUTANTS THAT ACCOMPANY ROADSIDE LITTER.

ESTABLISHING SOIL QUALITY AND DEPTH REGAINS GREATER STORMWATER FUNCTIONS IN THE POST DEVELOPMENT LANDSCAPE, PROVIDES INCREASED TREATMENT OF POLLUTANTS AND SEDIMENTS THAT RESULT FROM DEVELOPMENT AND HABITATION, AND MINIMIZES THE NEED FOR SOME LANDSCAPING CHEMICALS, THUS REDUCING POLLUTION THROUGH PREVENTION.



ESTABLISHING A MINIMUM SOIL QUALITY AND DEPTH IS NOT THE SAME AS PRESERVATION OF NATURALLY OCCURRING SOIL AND VEGETATION. HOWEVER, ESTABLISHING A MINIMUM SOIL QUALITY AND DEPTH WILL PROVIDE IMPROVED ON-SITE MANAGEMENT OF STORMWATER FLOW AND WATER QUALITY.

SOIL ORGANIC MATTER CAN BE ATTAINED THROUGH NUMEROUS MATERIALS SUCH AS COMPOST, COMPOSTED WOODY MATERIAL, BIOSOLIDS, AND FOREST PRODUCT RESIDUALS. IT IS IMPORTANT THAT THE MATERIALS USED TO MEET THE SOIL QUALITY AND DEPTH BMP BE APPROPRIATE AND BENEFICIAL TO THE PLANT COVER TO BE ESTABLISHED. LIKEWISE, IT IS IMPORTANT THAT IMPORTED TOPSOILS IMPROVE SOIL CONDITIONS AND DO NOT HAVE AN EXCESSIVE PERCENT OF CLAY FINES.

STEP 1
IDENTIFY AREAS OF THE SITE THAT WILL NOT BE DISTURBED DURING CONSTRUCTION (CLEARED, GRADED, OR DRIVEN ON). FENCE THOSE AREAS TO PREVENT IMPACTS DURING CONSTRUCTION. IF NEITHER SOILS NOR VEGETATION ARE DISTURBED, THESE AREAS DO NOT REQUIRE AMENDMENT.

STEP 2
IN DISTURBED AREAS (COMPACTED BY CONSTRUCTION TRAFFIC):
- SCARIFY THE TOP 4 INCHES OF SUBSOIL
- USE A CAT-MOUNTED RIPPER, TRACTOR-MOUNTED DISC, OR TILLER TO MIX THE FIRST LIFT OF TOPSOIL INTO THE SUBSOIL (KNOWN AS SCARIFYING, RIPPING, OR TILLING)
- USE THE EQUIPMENT LISTED IN THE PREVIOUS BULLET TO SCARIFY (TILL OR RIP) SOILS TO A DEPTH OF 12 INCHES BEFORE TILLING IN AT LEAST 8 INCHES OF COMPOST

STEP 3
THREE OPTIONS TO RESTORE DISTURBED SOILS INCLUDE:
OPTION 1: TILL COMPOST (1.75 INCHES FOR TURF AREAS; 3 INCHES FOR PLANTING BEDS) INTO EXISTING SOIL, OR
OPTION 2: STOCKPILE AND REUSE EXISTING TOPSOIL (AMEND IF NEEDED TO MEET 5% ORGANIC MATTER CONTENT FOR TURF AREAS; 10% ORGANIC MATTER CONTENT FOR PLANTING BEDS), OR
OPTION 3: IMPORT 6 INCHES OF COMPOST-AMENDED TOPSOIL (25% COMPOST FOR TURF AREAS; 40% COMPOST FOR PLANTING BEDS) AND SCARIFY (TILL OR RIP) INTO EXISTING SOIL IN TWO 3-INCH LIFTS

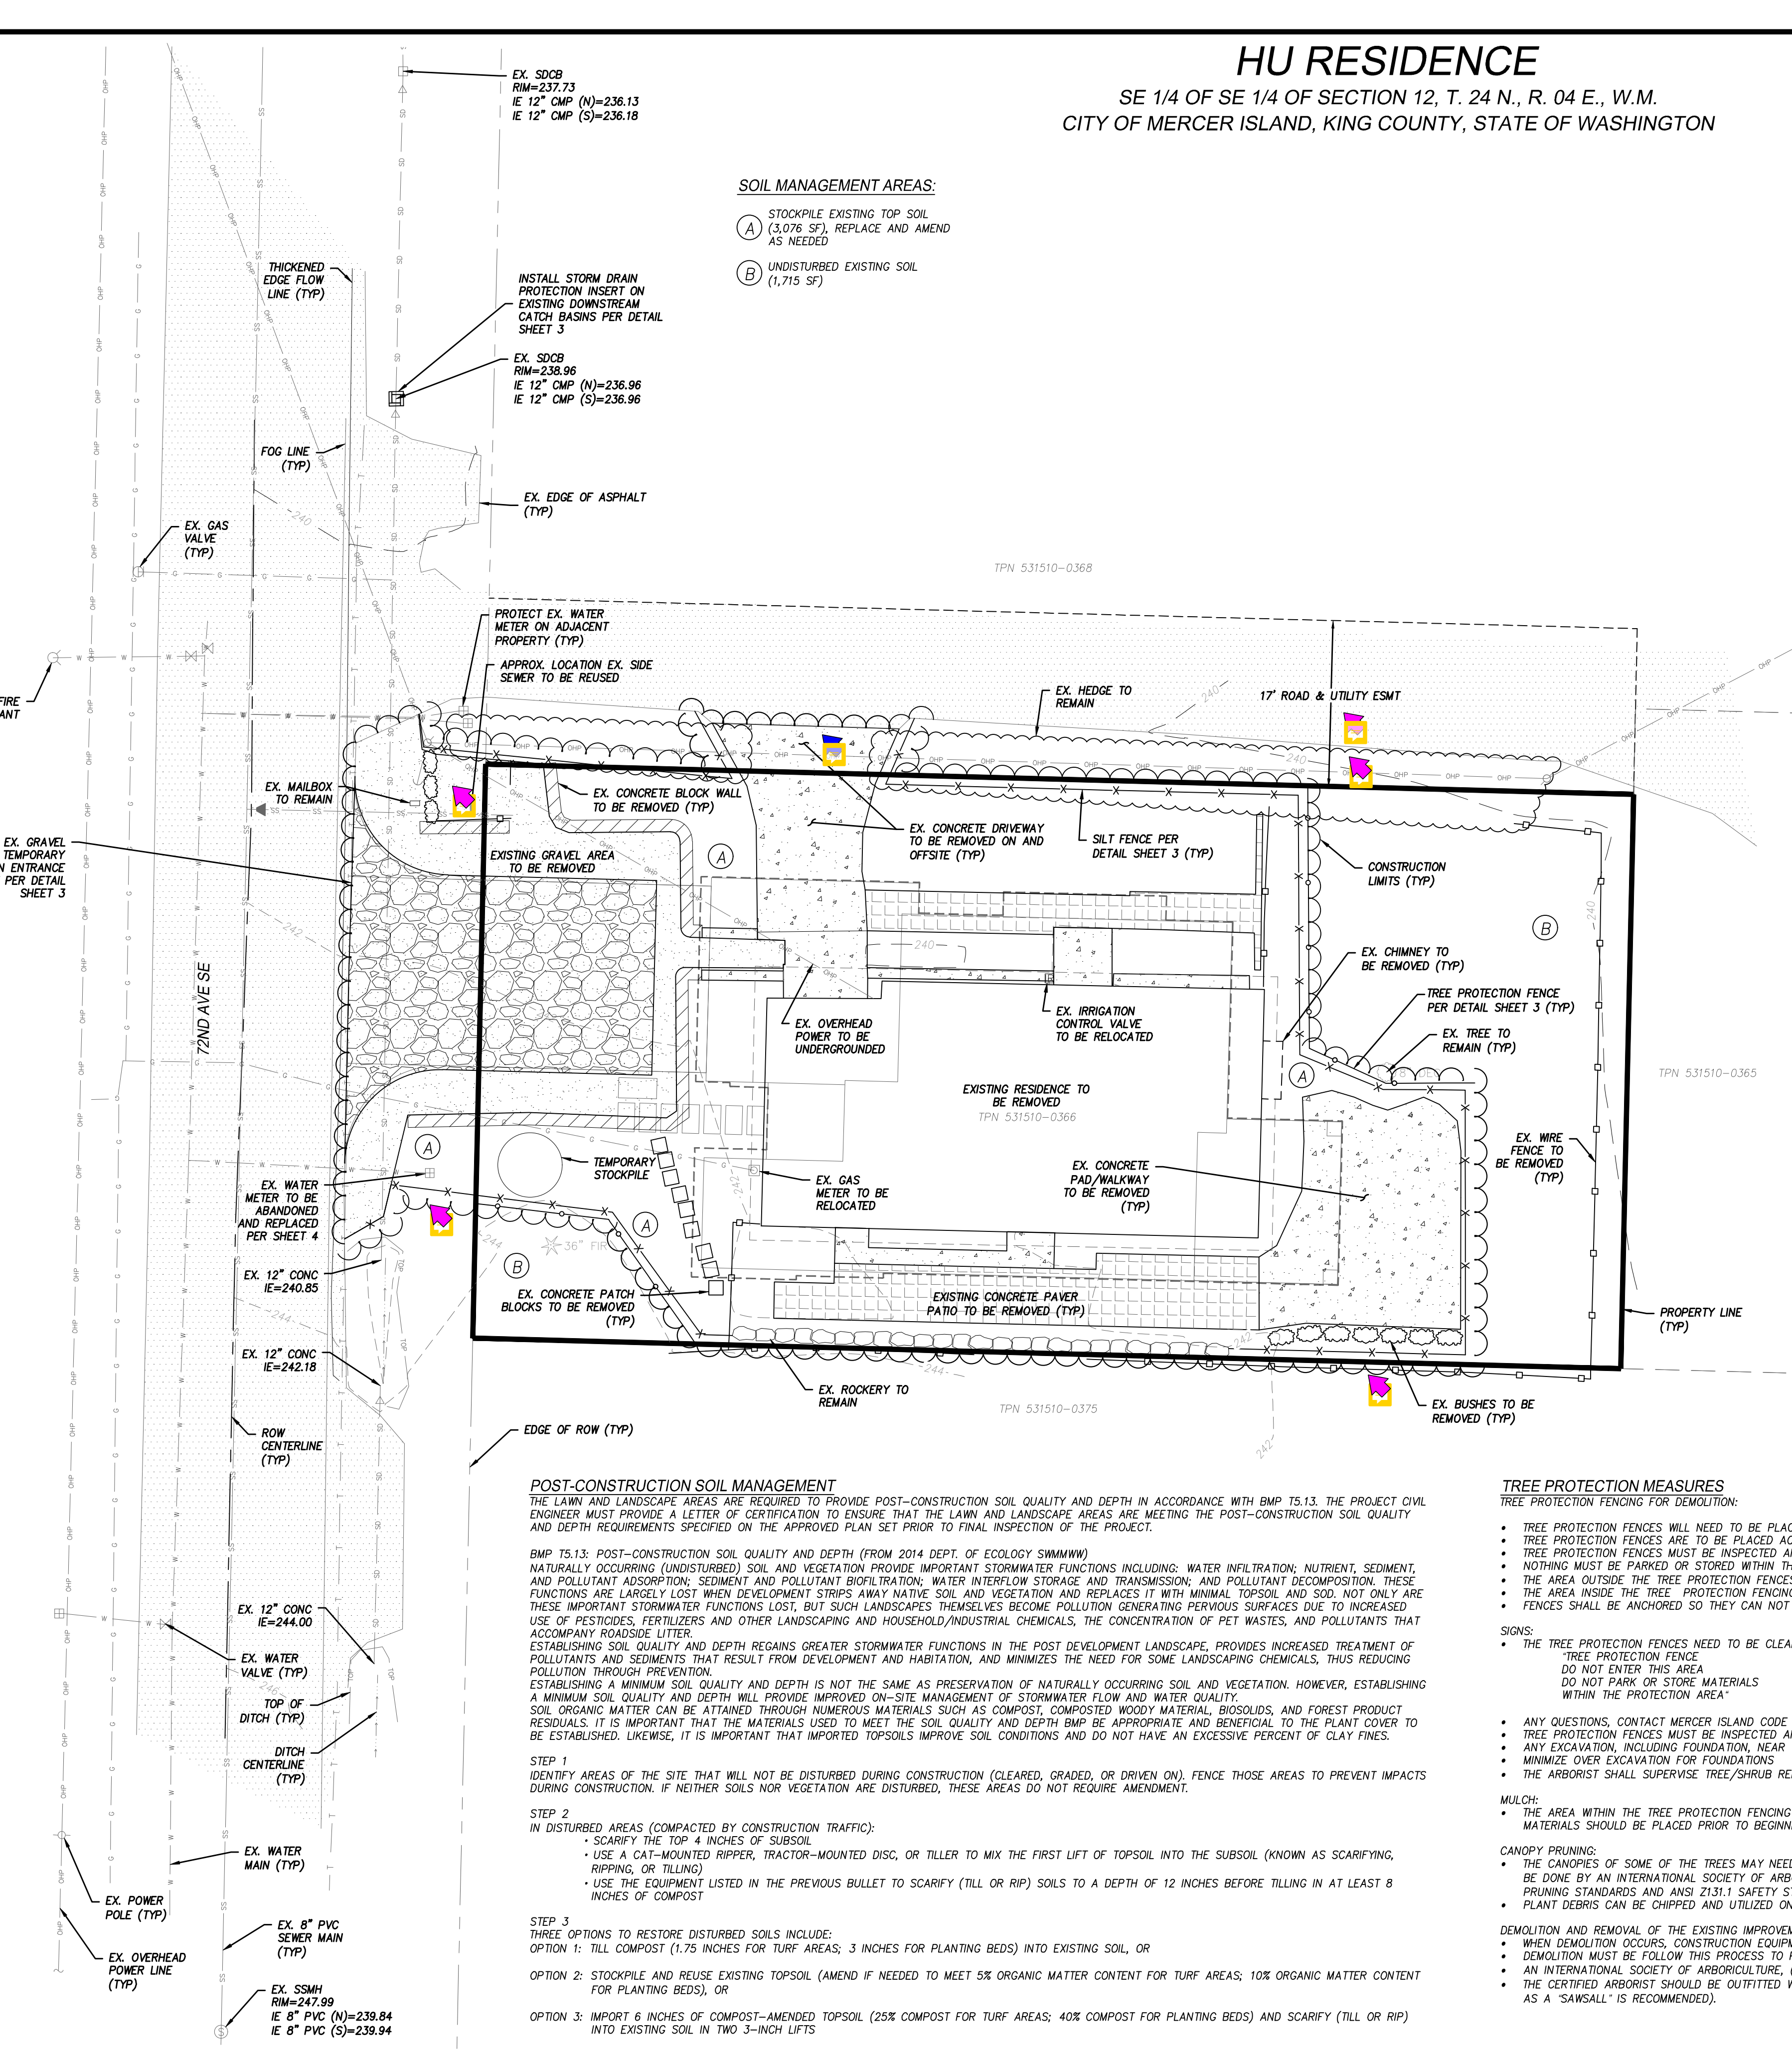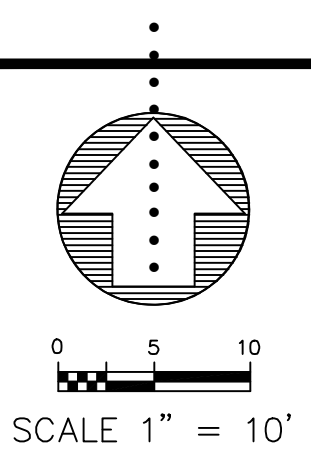

REVISIONS	BY	DATE

06/10/2022

ENCOMPASS ENGINEERING & SURVEYING
Western Washington Division
165 NE Juniper Street, Suite 201 • Bellingham, WA 98221 • Phone: (425) 392-0250
Eastern Washington Division
407 Swilwater Blvd. • Cle Elum, WA 98922 • Phone: (509) 674-7433

811
Know what's below.
Call before you dig.

JOB NO. 21782
DATE 06/10/2022
SCALE 1"=10'
DESIGNED BLB
DRAWN PMS
CHECKED CP
APPROVED CP


SHEET 2 of 5

HU RESIDENCE

ABBREVIATIONS

A.C.T.	ACOUSTICAL CLG TILE	REFER	REFRIGERATOR
BLK'G	BLOCKING	R.A.	RETURN AIR
		R.O.	ROUGH OPENING
		R&S	ROD AND SHELF
CD	CARBON MONOXIDE DETECTOR	S.A.	SUPPLY AIR
CLG	CEILING	SCHD	SCHEDULE
C.T.	COMMON TRUSS	SD	SMOKE DETECTOR
CLR	CLEAR	SH	SHELVES
COMP	COMPOSITION	SHT	SHEET
CONC	CONCRETE	SHWR	SHOWER
		SIM	SIMILAR
DBL	DOUBLE	S.S.	STAINLESS STEEL
DIA	DIAMETER	STOR	STORAGE
		SUSP	SUSPENDED
F.D.	FLOOR DRAIN	TEL	TELEPHONE
F.E.	FIRE EXTINGUISHER	THERM	THERMOSTAT
F.E.C.	FIRE EXTINGUISHER CABINET	TYP	TYPICAL
F.F.	FINISH FLOOR	U.C.L.	UNDERCABINET LIGHTS
FLR	FLOOR	U.N.O.	UNLESS NOTED OTHERWISE
FRM'G	FRAMING	V	VINYL
		VB	VAPOR BARRIER
G.T.	GIRDER TRUSS	V.C.T.	VINYL COMPOSITION TILE
G.W.B.	GYP SUM WALL BOARD	VTOS	VENT TO OUTSIDE
GYP	GYP SUM	W.C.	WATER CLOSET
		W.P.	WATER PROOF
HDWD	HARDWOOD	w/	WITH
HDWR	HARDWARE	w/o	WITHOUT
HT	HEIGHT	WD	WOOD
H.M.	HIP MASTER	W/D	WASHER AND DRYER
MFR	MANUFACTURER		
MIL	MILLIMETERS		
N.I.C.	NOT IN CONTRACT		
N.T.S.	NOT TO SCALE		
O.C.	ON CENTER		
PLYW'D	PLYWOOD		
P.T.	PRESSURE TREATED		

VICINITY MAP

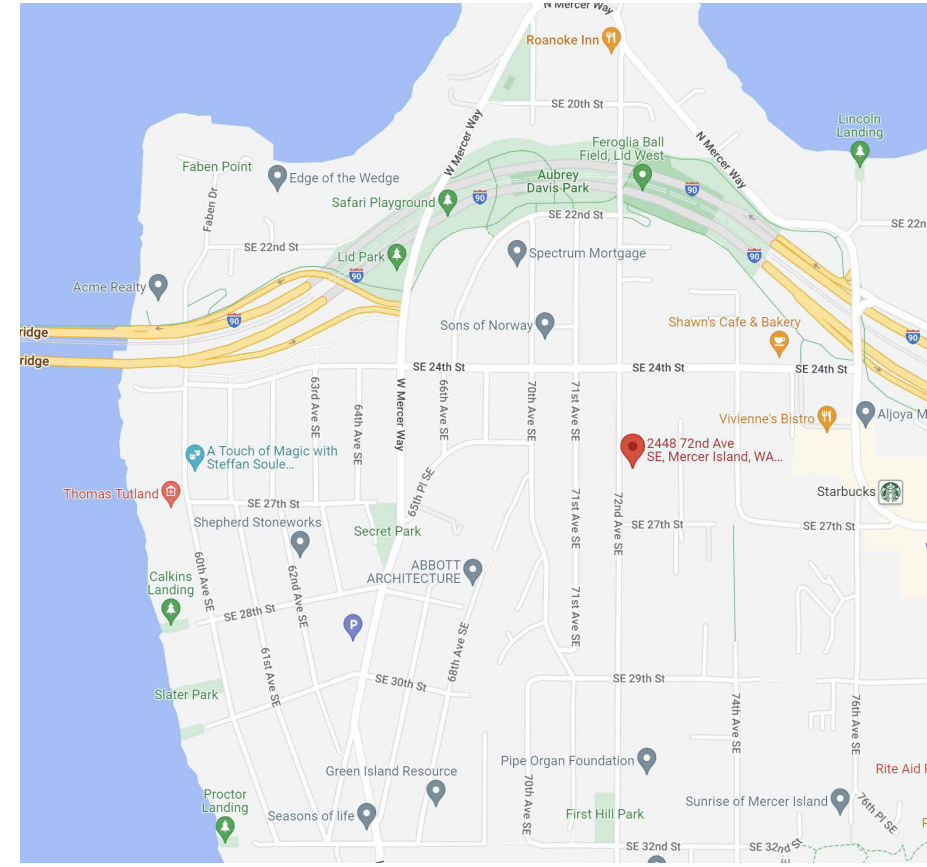

PROJECT INFO

PROJECT ADDRESS:

2448 72ND AVENUE SOUTHEAST
MERCER ISLAND, WA, 98040

BUILDER:

ATERA HOMES, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA, 98059

CONTACT: MILTON ORELLANA
PHONE: (425) 306-2758
EMAIL: build@aterahomes.com

DESIGNER:

ATERA DESIGN STUDIO, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA 98059

CONTACT: MILTON ORELLANA
PHONE: (425) 306-2758
EMAIL: studio@aterahomes.com

ENGINEER:

L2 ENGINEERS, LLC
17848 NE 198TH PLACE
WOODINWILLE, WA 98072

CONTACT: BRIAN LOSBOUGH, P.E.
PHONE: (206) 251-2346
EMAIL: BRIAN@L2ENGINEERS.COM

SCOPE OF WORK:

CONSTRUCT A NEW 2,996 SQ FT SINGLE FAMILY RESIDENCE.

BIDDER DESIGN:

ELECTRICAL, MECHANICAL, PLUMBING, MFR TRUSS CONNECTIONS, EXTERIOR CLADDING TO BE BIDDER DESIGNED/DEFERRED SUBMITTAL (PER 106.3.4.2)

LEGAL DESCRIPTION:

THE SOUTH 60 FEET OF THE WEST 120 FEET OF LOT 4, BLOCK 5, MCGILVRA'S ISLAND ADDITION, ACCORDING TO THE PLAT THEREOF, RECORDED IN VOLUME 16 OF PLATS, PAGE 58, IN KING COUNTY, WASHINGTON; TOGETHER WITH AN EASEMENT FOR ROAD AND UTILITY PURPOSES OVER THE SOUTH 17.33 FEET OF THE NORTH 77.33 FEET OF THE WEST 120 FEET OF SAID LOT 4, BLOCK 5, MCGILVRA'S ISLAND ADDITION.

CODE INFORMATION:

GENERAL INFORMATION:

BUILDING AREAS: SEE SQUARE FOOTAGE SCHED. THIS SHEET.
CODE COMPLIANCE: 2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL RESIDENTIAL CODE
2018 UNIFORM PLUMBING CODE
2018 WASHINGTON STATE ENERGY CODE
2018 WASHINGTON STATE AMENDMENTS
CONTR. CLASS: TYPE VB CONSTRUCTION
GLAZING: SEE ENERGY CODE NOTES SHT A000
PARCEL #: 531510-0366
ZONE: R9.6

PARCEL DESCRIPTION:

PROPERTY TYPE: R - RESIDENTIAL SINGLE
PRESENT USE: FAMILY RES USE ZONE
LOT AREA: 7,200 SF

AREA, SQUARE FOOTAGE...

Name	Area
Garage	435 SF
Main Floor	1539 SF
Upper Floor	1022 SF
Gross Building Area: 3	2996 SF
Cov'd Patio	246 SF
Cov'd Porch	61 SF
Exterior Area: 2	308 SF
Grand total: 5	3303 SF

ENERGY CODE NOTES

ENERGY COMPLIANCE

PROPOSED RESIDENCE TO COMPLY WITH THE PRESCRIPTIVE REQUIREMENTS OF THE 2018 W.S.E.C. - SEE WSEC FORM/REQUIREMENTS ON SHEET A002.

MECHANICAL VENTILATION REQUIREMENTS

PROPOSED RESIDENCE TO COMPLY WITH THE PRESCRIPTIVE VENTILATION REQUIREMENTS OF SECTION M1507 OF THE IRC.

AN INTERMITTENT WHOLE HOUSE VENTILATION SYSTEM INTEGRATED WITHIN THE FORCED AIR SYSTEM

**SEE THE MECHANICAL VENTILATION M1507 OF THE WA STATE RESIDENTIAL CODE SECTION ON SHEET A002

[HEATING OPTION #2] HEAT PUMP

[1.3] EFFICIENT BUILDING ENVELOPE:
PRESCRIPTIVE COMPLIANCE IS BASED ON TABLE R402.1.1 WITH THE FOLLOWING MODIFICATIONS:

- FENESTRATION U_t = 0.28
- FLOOR R-38
- SLAB ON GRADE R-10 PERIMETER AND UNDER ENTIRE
- SLAB BELOW GRADE SLAB R-10 PERIMETER AND UNDER ENTIRE SLAB

[3.5] HIGH EFFICIENCY HVAC EQUIPMENT:
AIR-SOURCE, CENTRALLY DUCTED HEAT PUMP WITH MINIMUM HSPF OF 11.0.
PROPOSED MODEL:

- HITACHI MINI VRF 208/230V HEAT PUMP SYSTEM
- EFFICIENCY: 11.0 HSPF

HEAT PUMP SUPPLEMENTARY HEAT, IF PROVIDED, SHALL BE PER R403.1.2.

- AT FINAL INSPECTION THE AUXILIARY HEAT LOCK OUT CONTROL SHALL BE SET TO 35°F OR LESS.

[4.2] HIGH EFFICIENCY HVAC DISTRIBUTION:
HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) INSTALLATION SHALL COMPLY WITH THE REQUIREMENTS OF SECTION R403.3.7.

- LOCATING SYSTEM COMPONENTS IN CONDITIONED CRAWL SPACES IS NOT PERMITTED UNDER THIS OPTION.
- ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION.
- DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.

THE MINIMUM FLOOR/CEILING INSULATION MAY BE INSTALLED TO THE NON CONDITIONED SIDE, WITH DUCT WORK ABOVE WITHIN THE AIR CAVITY, PROVIDED THAT CONTINUOUS INSULATION IS INSTALLED TOP OF THE CEILING BELOW AND IS COMBINED WITH PERIMETER INSULATION THAT MEETS OR EXCEEDS THE R-VALUE REQUIREMENTS FOR WALLS. PER STATE BUILDING CODE INTERPRETATION NO.16-08; R402.2.7, FLOORS: AS REQUESTED BY THE CITY OF NORTH BEND.

TO QUALIFY TO CLAIM THIS CREDIT, THE BUILDING PERMIT DRAWINGS SHALL SPECIFY THE OPTION BEING SELECTED AND SHALL SPECIFY THE HEATING EQUIPMENT TYPE AND SHALL SHOW THE LOCATION OF THE HEATING AND COOLING EQUIPMENT AND ALL THE DUCTWORK.

[5.5] EFFICIENT WATER HEATING SC:
THE PROPOSED WATER HEATING SYSTEM SHALL INCLUDE A HIGH EFFICIENCY WATER HEATER WITH A MINIMUM EF OF 0.91.

PROPOSED MODEL:

- RUIDP HYBRID BUILDER RESIDENTIAL ELECTRIC WATER HEATER, MODEL PRO H80 T2RU310BM
- UNIFORM ENERGY FACTOR: 3.5

NOTE:

- FIELD INSPECTOR TO VERIFY RECEIPT OF BLOWER DOOR TEST
- FIELD INSPECTOR TO VERIFY RECEIPT OF DUCT LEAKAGE TEST

DRAWING INDEX

NUMBER	SHEET NAME	REV. ID	REV. DATE
A000	COVER SHEET		
A001	CODE NOTES		
A002	ENERGY NOTES		
A003	ENERGY/VENTING CALCULATIONS		
A100	SURVEY		
A101	SITE PLAN & AREA/HT CALCULATIONS		
A301	MAIN FLOOR		
A401	UPPER FLOOR		
A501	ROOF PLAN		
A601	ELEVATIONS		
A701	SECTIONS		
A702	SECTIONS		
A703	SECTIONS		
A704	SECTIONS		
ARCHITECTURAL 'A': 14			
S001	STRUCTURAL NOTES & DETAILS		
S002	STRUCTURAL NOTES		
S101	FOUNDATION/MAIN FLOOR FRAMING PLAN		
S102	UPPER FLOOR/MAIN ROOF FRAMING PLAN		
S103	ROOF FRAMING PLAN		
S201	FOUNDATION HOLDDOWNS		
S202	MAIN FLOOR SHEARWALLS & UPPER FLOOR HOLDDOWNS		
S203	UPPER FLOOR SHEARWALLS		
S301	SIMPSON HOLDDOWN & TENSION TIES STANDARD DTLS		
S302	SIMPSON HOLDDOWN & TENSION TIES STANDARD DTLS		
S303	SIMPSON HOLDDOWN & TENSION TIES STANDARD DTLS		
STRUCTURAL 'S': 11			
D101	FOUNDATION & FRAM'G DETAILS		
D102	FRAMING DETAILS		
D201	STAIR & RAILING DETAILS		
D301	ROOF DETAILS		
DETAIL 'D': 4			

SYMBOLS & LEGEND:

	NEW WALL: INFILL PHASE		EXISTING WALL: SHELL / CORE PHASE
	GRID LINES		SHEET LAYOUT DESIGNATION: VIEW # / SHEET #
	EXIST. CONTOURS		ELEVATION DESIGNATION: VIEW # / SHEET #
	NEW CONTOURS		DOOR TAG: -SEE DOOR SCHEDULE.
	WINDOW TAG: -SEE WINDOW SCHEDULE		SHEARWALL TAG: SEE SHEARWALL SCHEDULE
	EXHAUST FAN PER M1507: -50 CFM MIN., TYP. U.N.O. -100 CFM MIN. @ KITCH.		INDICATES STRUCTURAL KEYNOTE WITH INDEXED NUMBER. SEE STRUCTURAL KEYNOTE SCHEDULE.
	WHOLE HOUSE EXHAUST FAN: -SEE MECHANICAL VENTILATION REQUIREMENTS UNDER THE ENERGY CODE NOTES ON SHT A000 FOR THE PROPOSED VENTILATION RATE. -MAX SOUND RATING 1.0 SONE -MIN. SOUND RATING 0.1IN W.C. -SEE M1505.4 ON SHT A002		110V SMOKE DETECTOR PER R314: -W/ DISCONNECTION SWITCH & BATTERY BACKUP & INTERCONNECTIVITY PER R314.4.
	THERMOSTAT: -PROVIDE 2x8 BLK'G AT 1" A.F.F.		CARBON MONOXIDE DETECTOR PER R315: W/ INTERCONNECTIVITY PER R315.5
	24HR TIMER TO W.H. FAN -SEE M1505.4.2 ON SHT A002		HEAT DETECTOR PER IRC314.2.3 w/ INTERCONNECTIVITY PER R314.4.1
			FURNACE/WATER HEATER: -PROVIDE COMBUSTIONABLE AIR FROM OUTSIDE. -PROVIDE PRESSURE RELIEF LINE TO OUTSIDE. -SECURE WATER HEATER TOP & BOTTOM.

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

Description

Date

No.

ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, WA 98059



HU RESIDENCE
2448 72nd AVE SE, Mercer Island

PERMIT SET

COVER SHEET

PROJECT NO: 21014
ISSUE DATE: 2022/08/29
DRAWN BY: SPM

A000

SCALE 24X36: 1 : 1
*NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.




CHAPTER 1: ADMINISTRATION**R101 TITLE, SCOPE AND PURPOSE**

- THIS COVERSHEET HAS BEEN PREPARED IN A GENERIC OUTLINE FORM FOLLOWING THE STANDARDS SET BY THE INTERNATIONAL RESIDENTIAL CODE (IRC). NOT ALL ITEMS ARE NECESSARILY REQUIRED TO COMPLETE THIS SPECIFIC PROJECT, COORDINATE PLANS WITH IRC. THIS SET OF WORKING DRAWINGS IS CONSIDERED A "BUILDER SET" AND DOES NOT INCLUDE SPECIFICATIONS OR BUILDING MATERIALS LIST. THEREFORE IT IS THE CONTRACTOR/OWNER RESPONSIBILITY TO PROVIDE AND COORDINATE SPECIFICATIONS, INCLUDING PRODUCT SELECTION AND INSTALLATION OR ASSEMBLY. ITEMS CALLED OUT ARE DONE SO FOR CONVENIENCE ONLY.
- DO NOT SCALE THESE DRAWINGS FOR CRITICAL DIMENSIONS. VERIFY ALL DIMENSIONS AND DATUM'S BEFORE COMMENCING WORK AND BE RESPONSIBLE FOR THEIR ACCURACY AND REPORT DISCREPANCIES / OMISSIONS TO THE DESIGNER IMMEDIATELY.

CHAPTER 3: BUILDING PLANNING**R301 DESIGN CRITERIA**

[B] **R301.2 CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA.** BUILDINGS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS SET FORTH IN THE IRC. ADDITIONAL CRITERIA SHALL BE ESTABLISHED BY THE LOCAL JURISDICTION AND SET FORTH IN **TABLE R301.2(1)** CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA.

GROUND SNOW LOAD:	25
WIND SPEED:	PER STRUCT SHEETS
SEISMIC DESIGN CATEGORY:	
SUBJECT TO DAMAGE FROM:	
WEATHERING:	MODERATE
FROST LINE DEPTH:	18"
TERMITE:	MODERATE
WINTER DESIGN TEMP:	26
ICE SHIELD UNDERLAYMENT REQUIRED:	NO
FLOOD HAZARDS:	
AIR FREEZING INDEX:	175
MEAN ANNUAL TEMP:	50.5

R301.4 DEAD LOAD.

THE ACTUAL WEIGHTS OF MATERIALS AND CONSTRUCTION SHALL BE USED FOR DETERMINING DEAD LOAD. DEAD LOADS USED FOR THIS PROJECT ARE AS FOLLOWS:

FLOOR:	15 PSF
ROOF:	12 PSF
WALLS:	10 PSF

R301.5 LIVE LOAD.

THE MINIMUM UNIFORMLY DISTRIBUTED LIVE LOAD SHALL BE AS PROVIDED IN

TABLE R301.5.

TABLE R301.5 MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS

ATTICS WITH STORAGE:	20 PSF
WITHOUT STORAGE:	10 PSF
DECKS:	40 PSF
EXTERIOR BALCONIES:	60 PSF
FIRE ESCAPES:	40 PSF
GUARDRAILS AND HANDRAILS:	200 PLF
GUARDRAIL IN-FILL COMPONENTS:	200 PLF
PASSENGER VEHICLE GARAGES:	200 PSF
ROOMS OTHER THAN SLEEPING ROOMS:	40 PSF
SLEEPING ROOMS:	30 PSF
STAIRS:	40 PSF

R301.6 ROOF LOAD.

ROOF SHALL BE DESIGNED FOR THE LIVE LOAD INDICATED IN **TABLE R301.6** THE SNOW LOAD INDICATED IN **TABLE R301.2(1)**, WHICHEVER IS GREATER.

TABLE R301.6

MINIMUM ROOF LIVE LOADS IN POUNDS-FORCE PER SQUARE

ROOF SLOPE:	TRIBUTARY LOADED AREA IN S.F. FOR ANY STRUCTURAL MEMBER		
	0 to 200	2001 to 600	Over 600
FLAT OR RISE LESS THAN 4" PER FOOT (1:3).	20	16	12
RISE LESS 4" PER FOOT (1:3) TO 12" PER FOOT (1:1).	16	14	12
RISE 12" PER FOOT (1:1) AND GREATER.	12	12	12

R301.8 NOMINAL SIZES.

...WHERE DIMENSIONS OF LUMBER ARE SPECIFIED, THEY SHALL BE DEEMED TO BE NOMINAL DIMENSIONS UNLESS SPECIFICALLY DESIGNATED AS ACTUAL DIMENSIONS.

R317 PROTECTION AGAINST DECAY**317.1 LOCATION REQUIRED.**

IN AREAS SUBJECT TO DECAY DAMAGE AS ESTABLISHED BY **TABLE R301.2(1)** LOCATIONS REQUIRED BY **SECTION R317.1** SHALL BE PRESERVATIVE-TREATED IN ACCORDANCE WITH AWPA U1 FOR THE SPECIES, PRODUCT, PRESERVATIVE AND END USE. PRESERVATIVES SHALL BE LISTED IN SECTION 4 OF AWPA U1

317.1.1 FIELD TREATMENT

FIELD-CUT ENDS, NOTCHES AND DRILLED HOLES OF PRESERVATIVE-TREATED WOOD SHALL BE TREATED IN THE FIELD IN ACCORDANCE WITH AWPA M4.

6.1 GENERAL

- ALL CUTS, HOLES AND INJURIES SUCH AS ABRASIONS OR HOLES FROM REMOVAL OF NAILS AND SPIKES WHICH MAY PENETRATE THE TREATED ZONE SHALL BE FIELD TREATED. AN AWPA ACCEPTED PRESERVATIVE SYSTEM, DETERMINED APPROPRIATE IN ACCORDANCE WITH AWPA M4 SECTION 7, SHALL BE USED FOR FIELD TREATMENT.
- APPLY PRESERVATIVES IN ACCORDANCE WITH THE PRODUCT LABEL.
- COAT ANY SURFACE THAT IS EXPOSED BY DAMAGE OR FIELD FABRICATION WHILE NOT USING EXCESS PRESERVATIVE.
- ANY EXCESS PRESERVATIVE NOT ABSORBED BY THE WOOD PRODUCT SHALL BE CLEANED FROM THE SURFACE PRIOR TO THE USE OF THE PRODUCT.
- BORED HOLES FOR CONNECTORS OR BOLTS MAY BE TREATED BY PUMPING COAL-TAR ROOFING CEMENT MEETING ASTM D5643 INTO HOLES USING A GREASE GUN OR SIMILAR DEVICE.
- CAREFUL ATTENTION SHOULD BE GIVEN TO MATERIALS PLACED INTO WET ENVIRONMENTS.
- AREA TO BE TREATED SHALL BE CLEAN, DRY AND FREE OF EXCESS PRESERVATIVE.

7.1 PRESERVATIVES

- THE PRESERVATIVE SYSTEM FOR FIELD TREATMENT SHALL BE DETERMINED BY THE TYPE OF PRESERVATIVE ORIGINALLY USED TO PROTECT THE PRODUCT.
- THE PRESERVATIVES DESIGNATED IN AWPA M4 SECTIONS 7.1.1, AND 7.1.2 ARE SUITABLE ALTERNATIVES WHEN NO MATCH CAN BE FOUND.

317.1.2 GROUND CONTACT.

ALL WOOD IN CONTACT WITH THE GROUND SHALL BE APPROVED PRESSURE-PRESERVATIVE-TREATED WOOD SUITABLE FOR GROUND CONTACT USE

317.3 FASTENERS.

FASTENERS FOR PRESSURE PRESERVATIVE AND FIRE-RETARDANT-TREATED WOOD SHALL BE OF HOT-DIPPED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER.

EXCEPTION:

- ONE-HALF-INCH DIAMETER OR GREATER STEEL BOLTS.
- FASTENERS OTHER THAN NAILS AND TIMBER RIVETS SHALL BE PERMITTED TO BE OF MECHANICALLY DEPOSITED ZINC COATED STEEL WITH COATING WEIGHTS IN ACCORDANCE WITH ASTM B 695, CLASS 55 MINIMUM

CHAPTER 4: FOUNDATIONS**R401 GENERAL****401.1 APPLICATION.**

THE PROVISIONS SET FORTH IN CHAPTER 4 OF THE IRC SHALL CONTROL THE DESIGN AND CONSTRUCTION OF THE FOUNDATION AND FOUNDATION SPACES FOR ALL BUILDINGS. IN ADDITION TO THE PROVISIONS OF THIS CHAPTER, THE DESIGN AND CONSTRUCTION OF FOUNDATIONS IN AREAS PRONE TO FLOODING AS ESTABLISHED BY **TABLE R301.2(1)** SHALL MEET THE PROVISIONS OF SECTION R322.

401.4 SOIL TESTS.

IN AREAS LIKELY TO HAVE EXPANSIVE, COMPRESSIBLE, SHIFTING OR OTHER UNKNOWN SOIL CHARACTERISTICS, THE BUILDING OFFICIAL SHALL DETERMINE WHETHER TO REQUIRE A SOIL TEST TO DETERMINE THE SOIL'S CHARACTERISTICS AT A PARTICULAR LOCATION, **401.4.1 GEOTECHNICAL EVALUATION.**

SEE SECTION SOILS AND FOUNDATION ON SHEET S001 FOR PRESUMED LOADING

R402 MATERIALS**402.2 CONCRETE.**

CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH AS SHOWN IN **TABLE R402.2**. CONCRETE SUBJECT TO WEATHERING AS INDICATED IN **TABLE R301.2(1)**, SHALL BE AIR ENTRAINED AS SPECIFIED IN **TABLE R402.2**

TABLE R402.2

MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF CONCRETE

TYPE OF LOCATIONS OF CONC. CONSTRUCTION	TRIBUTARY LOADED AREA IN SQUARE FEET FOR ANY STRUCTURAL MEMBER		
	NEGIGIBLE	MODERATE	SEVERE
BASEMENT WALLS, FNDN'S EXPOSED TO WEATHER.	2,500 psi	2,500 psi	2,500 psi
BASEMENT SLABS & INTERIOR SLABS ON GRADE, EXCEPT GAR. FLOOR SLABS.	2,500 psi	2,500 psi	2,500 psi
BASEMENT WALLS, FNDN WALLS, EXTERIOR WALLS EXPOSED TO WEATHER.	2,500 psi	3,000 psi	3,000 psi
PORCHES, CARPORT SLABS & STEPS EXPOSED TO WEATHER & GARAGE FLOOR SLABS.	2,500 psi	3,000 psi	3,500 psi

R403 FOOTINGS**403.1 GENERAL.**

ALL EXTERIOR WALLS SHALL BE SUPPORTED ON CONTINUOUS SOLID OR FULLY GROUTED MASONRY OR CONCRETE FOOTINGS, WOOD FOUNDATIONS, OR OTHER APPROVED STRUCTURAL SYSTEMS, WHICH SHALL BE OF SUFFICIENT DESIGN TO ACCOMMODATE ALL LOADS ACCORDING TO **SECTION R301** AND BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF **SECTION R403**, OF THE IRC. FOOTINGS SHALL BE SUPPORTED ON UNDISTURBED NATURAL SOILS OR ENGINEERED FILL.

403.1.4.1 FROST PROTECTION.

FOUNDATION WALLS, PIERS AND OTHER PERMANENT SUPPORTS OF BUILDINGS AND STRUCTURES SHALL BE PROTECTED FROM FROST BY EXTENDING FOOTINGS BELOW THE FROST LINE AS SPECIFIED IN **TABLE R301.2(1)**...

EXCEPTION: DECKS NOT SUPPORTED BY A DWELLING NEED NOT BE PROVIDED WITH FOOTINGS THAT EXTEND BELOW THE FROST LINE.

403.1.6 FOUNDATION ANCHORAGE.

WHEN BRACED WALL PANELS ARE SUPPORTED DIRECTLY ON CONTINUOUS FOUNDATIONS, THE WALL WOOD SILL PLATE SHALL BE ANCHORED TO THE FOUNDATION IN ACCORDANCE WITH **SECTION 403.1.6**, OF THE IRC.

- SILL PLATE SHALL BE ANCHORED TO THE FOUNDATION WITH ANCHOR BOLTS SPACED A MAXIMUM OF 6 FEET ON CENTER. THERE SHALL BE A MINIMUM OF TWO BOLTS PER PLATE SECTION WITH ONE BOLT LOCATED NOT MORE THAN 12 INCHES FROM EACH END OF THE PLATE SECTION.
 - BOLTS SHALL BE AT LEAST 1/2 INCH IN DIAMETER AND SHALL EXTEND A MINIMUM OF 7 INCHES INTO MASONRY OR CONCRETE.
 - SILLS AND SOLE PLATES SHALL BE PROTECTED AGAINST DECAY AND TERMITES WHERE REQUIRED BY SECTIONS R318 AND R319, OF THE IRC.
- EXCEPTION:** FOUNDATION ANCHOR STRAPS, SPACED AS REQUIRED TO PROVIDE EQUIVALENT ANCHORAGE TO 1/2-INCH-DIAMETER ANCHOR BOLTS.

403.1.6.1 FOUNDATION ANCHORAGE IN SEISMIC DESIGN CATEGORIES D0, D1, D2, AND E.

IN ADDITION TO THE REQUIREMENTS OF **SECTION R403.1.6**, THE FOLLOWING REQUIREMENTS SHALL APPLY TO WOOD LIGHT-FRAME STRUCTURES IN SEISMIC DESIGN CATEGORIES D1 AND D2.

- 1/4" X 3" X 3" PLATE WASHERS CONFORMING TO **SECTION R602.11.1** SHALL BE USED ON EACH BOLT.
- INTERIOR BRACED WALL PLATES SHALL HAVE ANCHOR BOLTS SPACED AT NOT MORE THAN 6 FEET ON CENTER AND LOCATED WITHIN 12 INCHES FROM THE ENDS OF EACH PLATE SECTION WHEN SUPPORTED ON A CONTINUOUS FOUNDATION.
- INTERIOR BEARING WALL SOLE PLATES SHALL HAVE ANCHOR BOLTS SPACED AT NOT MORE THAN 6 FEET ON CENTER AND LOCATED WITHIN 12 INCHES FROM THE ENDS OF EACH PLATE SECTION WHEN SUPPORTED ON A CONTINUOUS FOUNDATION.
- THE MAXIMUM ANCHOR BOLT SPACING SHALL BE 4 FEET FOR BUILDINGS OVER TWO STORIES IN HEIGHT.
- STEPPED CRIPPLE WALLS SHALL CONFORM TO **SECTION R602.11.3**.

R404 FOUNDATION WALLS

404.1 CONCRETE AND MASONRY FOUNDATION WALLS. CONCRETE AND MASONRY FOUNDATION WALLS SHALL BE SELECTED AND CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF **SECTION R404.1.3** OF THE IRC OR IN ACCORDANCE WITH ACI 318, NCM A TR68-A OR ACI 530/ASCE 5/TMS 402 OR OTHER APPROVED STRUCTURAL STANDARDS.

404.3 WOOD SILL PLATES.

WOOD SILL PLATES SHALL BE A MINIMUM OF 2-INCH BY 4-INCH NOMINAL LUMBER. SILL PLATE ANCHORAGE SHALL BE IN ACCORDANCE WITH **SECTIONS R403.1.6** AND **R602.11**.

CHAPTER 5: FLOORS**R501 GENERAL****501.1 APPLICATION.**

FLOOR CONSTRUCTION SHALL BE IN ACCORDANCE TO THE PROVISIONS SET FORTH IN **CHAPTER 5** OF THE IRC.

501.2 REQUIREMENTS.

FOR FLOOR CONSTRUCTION LOADING, SEE **SECTION R301**.

CHAPTER 6: WALL CONSTRUCTION**R601 GENERAL****R601.1 APPLICATION.**

WALL CONSTRUCTION SHALL BE IN ACCORDANCE TO THE PROVISIONS SET FORTH IN **CHAPTER 6** OF THE IRC.

R601.2 REQUIREMENTS.

FOR WALL CONSTRUCTION LOADING, SEE **SECTION R301**.

R602.3. DESIGN & CONSTRUCTION

SEE **TABLE R602.3(1)** ON THIS SHEET FOR FASTENER / NAILING SCHEDULE

R613 EXTERIOR WINDOWS AND GLASS DOORS**613.1 GENERAL.**

THE PROVISIONS SET FORTH IN **SECTION 613**, OF THE IRC, SHALL CONTROL THE PERFORMANCE AND CONSTRUCTION REQUIREMENTS FOR EXTERIOR WINDOW SYSTEMS INSTALLED IN WALL SYSTEMS. WATERPROOFING, SEALING AND FLASHING SYSTEMS ARE NOT INCLUDED IN THE SCOPE OF THIS SECTION.

613.2 PERFORMANCE.

EXTERIOR WINDOWS AND DOORS SHALL BE DESIGNED TO RESIST THE DESIGN WIND LOADS SPECIFIED IN **TABLE R301.2(2)**, ADJUSTED FOR HEIGHT AND EXPOSURE PER **TABLE R301.2(3)**.

CHAPTER 7: WALL COVERING**R701 GENERAL****701.1 APPLICATION.**

THE PROVISIONS SET FORTH IN **CHAPTER 7** OF THE IRC, SHALL CONTROL THE DESIGN AND CONSTRUCTION OF THE INTERIOR AND EXTERIOR WALL COVERING FOR ALL BUILDINGS.

701.2 INSTALLATION.

PRODUCTS SENSITIVE TO ADVERSE WEATHER SHALL NOT BE INSTALLED UNTIL ADEQUATE WEATHER PROTECTION FOR THE INSTALLATION IS PROVIDED. EXTERIOR SHEATHING SHALL BE DRY BEFORE APPLYING EXTERIOR COVER.

CHAPTER 8: ROOF-CEILING CONSTRUCTION**R801 GENERAL****801.1 APPLICATION.**

THE PROVISIONS SET FORTH IN **CHAPTER 8** OF THE IRC, SHALL CONTROL THE DESIGN AND CONSTRUCTION OF THE ROOF-CEILING SYSTEM FOR ALL BUILDINGS.

801.2 REQUIREMENTS.

ROOF AND CEILING CONSTRUCTION SHALL BE CAPABLE OF ACCOMMODATING ALL LOADS IMPOSED ACCORDING TO SECTION R301 AND OF TRANSMITTING THE RESULTING LOADS TO THE SUPPORTING STRUCTURAL ELEMENTS.

801.3 ROOF DRAINAGE.

IN AREAS WHERE EXPANSIVE OR COLLAPSIBLE SOILS ARE KNOWN TO EXIST, ALL DWELLINGS SHALL HAVE A CONTROLLED METHOD OF WATER DISPOSAL FROM ROOFS THAT WILL COLLECT AND DISCHARGE ALL ROOF DRAINAGE TO THE GROUND SURFACE AT LEAST 5 FEET FROM FOUNDATION WALLS OR TO AN APPROVED DRAINAGE SYSTEM.

CHAPTER 9: ROOF ASSEMBLIES**R901 GENERAL****901.1 SCOPE.**

THE PROVISIONS SET FORTH IN **CHAPTER 9** OF THE IRC, SHALL GOVERN THE DESIGN, MATERIALS, CONSTRUCTION AND QUALITY OF ROOF ASSEMBLIES.

UNIFORM PLUMBING CODE**PROTECTION OF PIPING, MATERIALS, AND STRUCTURES****SECTION 313.12 RATPROOFING**

- STRAINER PLATES ON DRAIN INLETS SHALL HAVE 3/4-INCH OPENINGS MAX.
- METER BOXES SHALL BE CONSTRUCTED IN SUCH A MANNER THAT RATS CANNOT ENTER A BLDG BY FOLLOWING THE SERVICE PIPES FROM THE BOX INTO THE BLDG.
- WHERE OPENINGS HAVE BEEN MADE IN WALLS, FLOORS, OR CLGS FOR THE PASSAGE OF PIPES, SUCH OPENINGS SHALL BE CLOSED AND PROTECTED BY THE INSTALLATION OF APPROVED METAL COLLARS SECURELY FASTENED TO THE ADJOINING STRUCTURE.
- TUB WASTE OPENINGS IN FRAMED CONSTRUCTION TO CRAWL SPACES AT OR BELOW THE FIRST FLOOR SHALL BE PROTECTED BY THE INSTALLATION OF APPROVED METAL COLLARS OR METAL SCREEN, WITH 3/4-INCH OPENINGS MAX, AND SECURELY FASTENED TO THE ADJOINING STRUCTURE.

GENERAL CONSTRUCTION SPECS. AND CODE COMPLIANCE (2018 IRC, UPC & 2018 W.S.E.C.)

Description

Date

No.

ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, WA 98059



HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET

CODE NOTES

PROJECT NO: 21014
ISSUE DATE: 2022/08/29
DRAWN BY: SPM

A001

SCALE 24X36:
*NOTE: 11X17 SETS ARE
REDUCED 50% SCALE
DRAWINGS ACCORDINGLY.



(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

Window, Skylight and Door Schedule

Project Information: HU RESIDENCE, 2448 72ND AVE SE, MERCER ISLAND. Contact Information: ATERA DESIGN STUDIO, 451 DUVAL AV NE STE 115, RENTON.

Table with columns: Exempt Swinging Door, Exempt Glazed Fenestration, Ref, U-factor, Qt, Feet, Width, Height, Area, UA.

Table with columns: Component, Description, Ref, U-factor, Qt, Feet, Width, Height, Area, UA. Lists items like DBL CASEMENT + PICTURE, CASEMENT, etc.

Summary table for Vertical Fenestration Area and UA, showing total area and weighted UA/UA area.

Table for Overhead Glazing (Skylights) with columns: Component, Description, Ref, U-factor, Qt, Feet, Width, Height, Area, UA.

Summary table for Overhead Glazing Area and UA, showing total area and weighted UA/UA area.

Total Sum of Fenestration Area and UA (for heating system sizing calculations).

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manuals J and S.

Interactive heating system sizing calculator interface with various input fields and a summary table at the bottom.

2018 Washington State Energy Code - Residential Prescriptive Energy Code Compliance for All Climate Zones in Washington Single Family - New & Additions (effective February 1, 2021)

These requirements apply to all IRC building types, including detached one- and two-family dwellings and multiple single-family dwellings (townhouses).

Project Information and Contact Information table for HU RESIDENCE and PAUL MONSEF.

Instructions: This single-family project will use the requirements of the Prescriptive Path below and incorporate the minimum values listed.

Authorized Representative and Date table.

All Climate Zones (Table R402.1.1) table with columns: Fenestration U-Factor, Skylight U-Factor, Glazed Fenestration SHGC, etc.

R-values are minimums. U-factors and SHGC are maximums. When insulation is installed in a cavity that is less than the label or design thickness of the insulation, the compressed R-value of the insulation from Appendix Table A101.4 shall not be less than the R-value specified in the table.

2018 Washington State Energy Code - Residential Prescriptive Energy Code Compliance for All Climate Zones in Washington Single Family - New & Additions (effective February 1, 2021)

Each dwelling unit in a residential building shall comply with sufficient options from Table R406.2 (fuel normalization credits) and Table 406.3 (energy credits) to achieve the following minimum number of credits.

- 1. Small Dwelling Unit: 3 credits
2. Medium Dwelling Unit: 6 credits
3. Large Dwelling Unit: 7 credits
4. Additional less than 500 square feet: 1.5 credits

Before selecting your credits on this Summary Table, review the details in Table 406.3 (Single Family), on page 4.

Summary of Table R406.2 table with columns: Heating Options, Fuel Normalization Descriptions, Credits - select ONE heating option, User Notes.

Summary of Table R406.2 table with columns: Energy Options, Energy Credit Option Descriptions, Credits - select ONE energy option from each category, User Notes.

2018 WASHINGTON STATE / IRC EXHAUST SYSTEM REQUIREMENTS

M1505 MECHANICAL VENTILATION

M1505.1 SOURCE SPECIFIC VENTILATION WHERE LOCAL EXHAUST OR WHOLE-HOUSE MECHANICAL VENTILATION IS PROVIDED, THE EQUIPMENT SHALL BE DESIGNED IN ACCORDANCE SECTION M1505.

M1505.2 RECIRCULATION OF AIR. EXHAUST AIR FROM BATHROOMS AND TOILET ROOMS SHALL NOT BE RECIRCULATED WITHIN A RESIDENCE OR CIRCULATED TO ANOTHER DWELLING UNIT AND SHALL BE EXHAUSTED DIRECTLY TO THE OUTDOORS.

M1505.3 EXHAUST EQUIPMENT. EXHAUST EQUIPMENT SERVING SINGLE DWELLING UNITS SHALL BE LISTED AND LABELED AS PROVIDING THE MINIMUM REQUIRED AIRFLOW IN ACCORDANCE WITH ANSI/AMCA 210-ANSI/ASHRAE 51.

M1505.4 WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM WHOLE-HOUSE MECHANICAL VENTILATION SYSTEMS SHALL BE DESIGNED IN ACCORDANCE WITH SECTIONS M1505.4.1 THROUGH M1505.4.4.

M1601 DUCT CONSTRUCTION

M1601.1 DESIGN DUCT SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH THE PROVISIONS OF THIS SECTION AND ACCA MANUAL D, THE APPLIANCE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR OTHER APPROVED METHODS.

- M1601.1.1 ABOVE GROUND DUCTS
a. DISCHARGE TEMP LIMIT OF 250 DEGREES FAHRENHEIT
b. LABEL WITH UL 181 AND INSTALLED TO MANUF. SPECS
c. FIELD-FABRICATED, SHOP-FABRICATED, AND FLEXIBLE DUCT CONSTRUCTION SHALL CONFORM TO SMACNA HVAC DUCT CONSTRUCTION STANDARDS - METAL AND FLEXIBLE EXCEPT AS ALLOWED BY TABLE M1601.1.1.

M1601.2 VIBRATION ISOLATORS VIBRATION ISOLATORS INSTALLED BETWEEN MECHANICAL EQUIPMENT AND DUCTS SHALL BE FABRICATED FROM APPROVED MATERIALS LIST AND SHALL NOT EXCEED 10" IN LENGTH.

M1601.3 DUCT INSULATION MATERIALS DUCT INSULATION MATERIALS TO CONFORM TO THE FOLLOWING:
1. DUCT COVERS AND LININGS TO MEET ASTM E 84 OR UL 723, AND ASTM E 2231
2. DUCT COVERINGS AND LININGS SHALL MEET ASTM C 411
3. REFLECTIVE DUCT INSULATION SHALL BE VISIBLE AT INTERVALS NO GREATER 36". R-VALUE IS DETERMINED IN ACCORDANCE WITH ASTM C 1668

M1601.4 INSTALLATION DUCT INSTALLATION SHALL COMPLY WITH SECTIONS M1601.1.1 THROUGH M1601.4.10

M1701 COMBUSTION AIR

M1701.1 SCOPE SOLID FUEL-BURNING APPLIANCES SHALL BE PROVIDED WITH COMBUSTION AIR IN ACCORDANCE WITH THE APPLIANCE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

2018 Washington State Energy Code - Residential Prescriptive Energy Code Compliance for All Climate Zones in Washington Single Family - New & Additions (effective February 1, 2021)

Summary of Table R406.2 (cont.) table with columns: Energy Options, Energy Credit Option Descriptions (cont.), Credits - select ONE energy option from each category, User Notes.

- a. An alternative heating source sized at a maximum of 0.5 W/sf (equivalent) of heated floor area or 500 W, whichever is bigger, may be installed in the dwelling unit.
b. Equipment listed in Table C403.3.2(a) or C403.3.2(b)
c. Equipment listed in Table C403.3.2(c) or C403.3.2(d)
d. You cannot select more than one option from any category EXCEPT in category 5. Option 5.1 may be combined with options 5.2 through 5.6. See Table 406.3.
e. 1.0 credit for each 1,200 kWh of electrical generation provided annually, up to 3 credits max.

Please print only pages 1 through 3 of this worksheet for submission to your building official.

2018 WASHINGTON STATE ENERGY REQUIREMENTS

CHAPTER 3 GENERAL REQUIREMENTS R301 CLIMATE ZONES CLIMATE ZONES FROM TABLE R301.1 SHALL BE USED IN DETERMINING THE APPLICABLE REQUIREMENTS FROM CHAPTER 4. KING, SNOHOMISH & PIERCE COUNTY - 4C (MARINE)

R302 DESIGN CONDITIONS THE INTERIOR DESIGN TEMPERATURES USED FOR HEATING AND COOLING LOAD CALCULATIONS SHALL BE A MAXIMUM OF 72°F FOR HEATING AND MINIMUM OF 75°F FOR COOLING. THE HEATING OR COOLING OUTDOOR DESIGN TEMPERATURES SHALL BE SELECTED FROM APPENDIX RC.

CHAPTER 4 RESIDENTIAL ENERGY EFFICIENCY R401 GENERAL

A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL PER WSEC R401.3. THE CERTIFICATE SHALL LIST THE PREDOMINANT R-VALUES OF INSULATION INSTALLED IN OR ON CEILING/ROOF, WALLS, FOUNDATION (SLAB, BASEMENT WALL, CRAWLSPACE WALL AND/OR FLOOR), AND DUCTS OUTSIDE THE CONDITIONED SPACES; U-FACTORS FOR FENESTRATION; AND THE SOLAR HEAT GAIN COEFFICIENT (SHGC) OF FENESTRATION. THE CERTIFICATE SHALL ALSO LIST THE TYPE AND EFFICIENCY OF HEATING, COOLING, AND SERVICE WATER HEATING EQUIPMENT.

R402 BUILDING THERMAL ENVELOPE THE BUILDING THERMAL ENVELOPE WILL MEET THE REQUIREMENTS OF SECTIONS R402.1.1 THROUGH R402.1.6

Table with columns: VERTICAL U-FACTOR, SKYLIGHT U-FACTOR, CEILING R-VALUE, WOOD FRAME WALL, FLOOR, BELOW GRADE WALL, SLAB ON GRADE.

R402.2.1 CEILINGS WITH ATTIC SPACES WHERE SECTION R402.1.1 WOULD REQUIRE R-49 IN THE CEILING, INSTALLING R-38 OVER 100 PERCENT OF THE CEILING AREA REQUIRING INSULATION SHALL BE DEEMED TO SATISFY THE REQUIREMENT FOR R-49 WHEREVER THE FULL HEIGHT OF UNCOMPRESSED R-38 INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES. THIS REDUCTION SHALL NOT APPLY TO THE U-FACTOR ALTERNATIVE APPROACH IN SECTION R402.1.3 AND THE TOTAL UA ALTERNATIVE IN SECTION R402.1.4.

R402.2.1.1 LOOSE INSULATION IN ATTIC SPACES OPEN-BLOWN OR POURED LOOSE FILL INSULATION MAY BE USED IN ATTIC SPACES WHERE THE SLOPE OF THE CEILING IS NOT MORE THAN 3 FEET IN 12 AND THERE IS AT LEAST 30 INCHES OF CLEAR DISTANCE FROM THE TOP OF THE BOTTOM CHORD OF THE TRUSS OR CEILING JOIST TO THE UNDERSIDE OF THE SHEATHING AT THE ROOF EDGE.

R402.2.3 EAVE Baffle FOR AIR PERMEABLE INSULATIONS IN VENTED ATTICS, A Baffle SHALL BE INSTALLED ADJACENT TO SOFFIT AND EAVE VENTS. Baffles SHALL MAINTAIN AN OPENING EQUAL OR GREATER THAN THE SIZE OF THE VENT. THE Baffle SHALL EXTEND OVER THE TOP OF THE ATTIC INSULATION. THE Baffle SHALL BE PERMITTED TO BE ANY SOLID MATERIAL. R402.2.4 ACCESS HATCHES AND DOORS ACCESS DOORS FROM CONDITIONED SPACES TO UNCONDITIONED SPACES (E.G., ATTICS AND CRAWL SPACES) SHALL BE WEATHERSTRIPPED AND INSULATED TO A LEVEL EQUIVALENT TO THE INSULATION ON THE SURROUNDING SURFACES.

R402.2.7 FLOORS FLOOR INSULATION SHALL BE INSTALLED TO MAINTAIN PERMANENT CONTACT WITH THE UNDERSIDE OF THE SUBFLOOR DECKING. INSULATION SUPPORTS SHALL BE INSTALLED SO SPACING IS NO MORE THAN 24-INCHES ON CENTER. FOUNDATION VENTS SHALL BE PLACED SO THAT THE TOP OF THE VENT IS BELOW THE LOWER SURFACE OF THE FLOOR INSULATION.

R402.2.8 BELOW-GRADE WALLS EXTERIOR WALL INSULATION USED ON THE EXTERIOR (COLD) SIDE OF THE WALL SHALL EXTEND FROM THE TOP OF THE BELOW-GRADE WALL TO THE TOP OF THE FOOTING AND SHALL BE APPROVED FOR BELOW-GRADE USE. ABOVE-GRADE INSULATION SHALL BE PROTECTED. INSULATION USED ON THE INTERIOR (WARM) SIDE OF THE WALL SHALL EXTEND FROM THE TOP OF THE BELOW-GRADE WALL TO THE BELOW-GRADE FLOOR LEVEL AND SHALL INCLUDE R-5 RIGID BOARD PROVIDING A THERMAL BREAK BETWEEN THE CONCRETE WALL AND THE SLAB.

R402.4 AIR LEAKAGE ABOVE GRADE WALLS: PROVIDE FACE STAPLED BATTS TO AVOID COMPRESSION. PROVIDE MIN R-10 INSULATION AT WALL HEADER. (R402.1.1*) R402.4 AIR LEAKAGE THE BUILDING THERMAL ENVELOPE SHALL BE CONSTRUCTED TO LIMIT AIR LEAKAGE IN ACCORDANCE WITH THE REQUIREMENTS OF SECTIONS R402.4.1 THROUGH R402.4.4. PROVIDE AN AIR BARRIER AND INSULATION INSTALLATION PER TABLE R402.1.1

R402.4.1 THE BUILDING THERMAL ENVELOPE SHALL COMPLY WITH SECTIONS R402.4.1.1 AND R402.4.1.2 PER R402.4.1 THE SEALING METHODS BETWEEN DISSIMILAR MATERIALS SHALL ALLOW FOR DIFFERENTIAL EXPANSION AND CONTRACTION. R402.4.2 THE COMPONENTS OF THE BUILDING THERMAL ENVELOPE AS LISTED IN TABLE R402.4.1.1 SHALL BE INSTALLED PER R402.4.1. WHERE REQUIRED BY THE CODE OFFICIAL, AN APPROVED THIRD PARTY SHALL INSPECT ALL COMPONENTS AND VERIFY COMPLIANCE. R402.4.3 THE BUILDING OR DWELLING UNIT SHALL BE TESTED PER R402.4.1.2 AND VERIFIED AS HAVING AN AIR LEAKAGE RATE OF NOT EXCEEDING 5.0 AIR CHANGES PER HOUR. TESTING SHALL BE CONDUCTED WITH A BLOWER DOOR AT A PRESSURE OF 0.2 INCHES W.G. R402.4.4 NEW WOOD-BURNING FIREPLACES SHALL HAVE TIGHT-FITTING FLUE DAMPERS AND OUTDOOR COMBUSTION AIR PER R402.4.2

R402.4.5 WINDOWS, SKYLIGHTS AND SLIDING GLASS DOORS SHALL HAVE AN AIR INFILTRATION RATE PER R402.4.2 RECESSED LUMINARIES INSTALLED IN THE BUILDING THERMAL ENVELOPE SHALL BE TYPE IC-RATED AND CERTIFIED UNDER ASTM E283 AS HAVING AN AIR LEAKAGE RATE PER R402.4.4

R403 SYSTEMS R403.1 AT LEAST ONE THERMOSTAT SHALL BE PROVIDED FOR EACH SEPARATE HEATING AND COOLING SYSTEM.

R403.2 DUCTS AND AIR HANDLERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTIONS R403.2.1 THROUGH R403.2.3. R403.3 DUCTS SHALL BE INSULATED TO A MINIMUM OF R-8 PER R403.3.1 R403.4 AIR HANDLERS SHALL HAVE A MANUFACTURER'S DESIGNATION FOR AN AIR LEAKAGE IN ACCORDANCE WITH ASHRAE 193 PER R403.3.2.1 PER R403.3.5, BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS. INSTALLATION OF DUCTS IN EXTERIOR WALLS, FLOORS OR CEILINGS SHALL NOT DISPLACE REQUIRED ENVELOPE INSULATION. R403.4 MECHANICAL SYSTEM PIPING CAPABLE OF CARRYING FLUIDS ABOVE 105°F OR BELOW 55°F SHALL BE INSULATED TO A MINIMUM OF R-6.

R403.5 ENERGY CONSERVATION MEASURES FOR SERVICE HOT WATER SYSTEMS SHALL BE IN ACCORDANCE WITH SECTIONS R403.5.1 THROUGH R403.5.5

R404 POWER AND LIGHTING SYSTEMS R404.1 A MINIMUM OF 75 PERCENT OF PERMANENTLY INSTALLED LAMPS IN LIGHTING FIXTURES SHALL BE HIGH-EFFICACY LAMPS. R405 SIMULATED PERFORMANCE CRITERIA FOR COMPLIANCE USING SIMULATED ENERGY PERFORMANCE ANALYSIS SHALL MEET THE REQUIREMENTS OF SECTION R401.2. SUCH ANALYSIS SHALL INCLUDE HEATING, COOLING, AND SERVICE WATER HEATING ENERGY ONLY.

GENERAL CONSTRUCTION SPECS. AND CODE COMPLIANCE (2018 IRC, UPC & 2018 W.S.E.C.)

Description

Date

No.

ATERA DESIGN STUDIO 451 DUVAL AVE NE, RENTON, WA 98059



HU RESIDENCE 2448 72nd Ave SE, Mercer Island

PERMIT SET

ENERGY NOTES

PROJECT NO: 21014 ISSUE DATE: 2022/08/29 DRAWN BY: SPM

A002

SCALE 24X36: 1:1X17 SETS ARE REDUCED 50%; SCALE DRAWINGS ACCORDINGLY.



Area Schedule (Energy/Venting Calculations)				
Name	Area	Perimeter	Level	
FLOOR INSUL	1541 SF	180'-0"	Level 1	
CLG - FLAT	507 SF	118'-0"	Level 2	
CLG - FLAT	126 SF	39'-6"	Level 2	
CLG - FLAT	53 SF	25'-6"	Level 2	
FLOOR INSUL	42 SF	33'-0"	Level 2	
FLOOR INSUL	199 SF	64'-0"	Level 2	
CLG - FLAT	482 SF	97'-0"	T.O. PL Lvl2	
CLG - VAULT	383 SF	76'-0"	T.O. PL Lvl2	
CLG - VAULT	167 SF	48'-0"	T.O. PL Lvl2	
CLG - VAULT	103 SF	36'-6"	T.O. PL Lvl2	

CRAWL SPACE VENTING									
NAME	AREA	PERIMETER	AREA CALCULATIONS			VENTS REQUIRED		VENTING PROVIDED	
			NET AREA	NET FREE AREA	VENTING REQUIRED	VENT SIZE: 14" x 8" VENT AT .75 EFF	TOTAL VENTS REQUIRED	TOTAL VENTS SHOWN	TOTAL VENTING AREA PROVIDED
1	1404 SF	178'-8"	1404 SF	300	4.68 SF	0.583	8.03	16	9 SF

ROOF VENTING SCHEDULE											
NAME	GROSS AREA	AREA CALCULATIONS			EAVE/PARAPET VENTING			ROOF JACKS			NOTES
		NET VENTABLE AREA	REQUIRED VENTING	% AT EAVES	REQUIRED EAVE	CALCULATIONS		REQUIRED JACKS	CALCULATIONS		
						LF OF VENT	PROVIDED		# OF JACKS	AREA PROVIDED	
1A	437 SF	0 SF	0.00 SF	0%	0.00 SF	0	0.00 SF	0.00 SF	0	0.00 SF	SPRAY FOAM PER PLANS
1B	38 SF	0 SF	0.00 SF	0%	0.00 SF	0	0.00 SF	0.00 SF	0	0.00 SF	SPRAY FOAM PER PLANS
1C	97 SF	0 SF	0.00 SF	0%	0.00 SF	0	0.00 SF	0.00 SF	0	0.00 SF	SPRAY FOAM PER PLANS
2A	1013 SF	0 SF	0.00 SF	0%	0.00 SF	0	0.00 SF	0.00 SF	0	0.00 SF	SPRAY FOAM PER PLANS

SPRAY FOAM NOTES:


- WHERE SPRAY FOAM IS NOTED ON THE PLANS, NO VENTING IS REQUIRED: PROVIDE MIN 2" CLOSED CELL SPRAY FOAM INSULATION DIRECTLY TO THE UNDERSIDE OF THE ROOF/FLOOR SHEATHING.
- PROVIDE SOLID EAVE BLOCKING, TYP
- A COPY OF THE ICC-ES REPORT FOR THE INSULATION PRODUCT MUST BE PROVIDED ON SITE FOR THE FIELD INSPECTOR. THE APPLIED SPRAY FOAM MUST BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS BY A CERTIFIED INSTALLER

CRAWL SPACE VENTING NOTES:


- THE UNCONDITIONED, UNDER-FLOOR, SPACE BETWEEN THE BOTTOM OF THE FLOOR JOISTS AND THE EARTH UNDER ANY BUILDING SHALL HAVE VENTILATION OPENINGS THROUGH FOUNDATION WALLS OR EXTERIOR WALLS.
- A GROUND COVER OF SIX MIL (0.006 INCH THICK BLACK POLYETHYLENE OR APPROVED EQUAL SHALL BE LAID OVER THE GROUND WITHIN CRAWL SPACES. THE GROUND COVER SHALL BE OVERLAPPED SIX INCHES MINIMUM AT THE JOINTS AND SHALL EXTEND TO THE FOUNDATION WALL.
- THE MINIMUM NET AREA OF VENTILATION OPENINGS SHALL NOT BE LESS THAN 1 SQUARE FOOT FOR EACH 300 SQUARE FEET OF UNDER-FLOOR AREA. REQUIRED OPENINGS SHALL BE EVENLY PLACED TO PROVIDE CROSS VENTILATION OF THE SPACE EXCEPT ONE SIDE OF THE BUILDING SHALL BE PERMITTED TO HAVE NO VENTILATION OPENINGS.
- VENTILATION OPENINGS SHALL BE COVERED FOR THEIR HEIGHT AND WIDTH WITH ANY OF THE FOLLOWING MATERIALS PROVIDED THAT THE LEAST DIMENSION OF THE COVERING SHALL NOT EXCEED 1/4 INCH:
 - PERFORATED SHEET METAL PLATES NOT LESS THAN 0.070 INCH THICK.
 - EXPANDED SHEET METAL PLATES NOT LESS THAN 0.047 INCH THICK.
 - CAST-IRON GRILL OR GRATING.
 - EXTRUDED LOAD-BEARING BRICK VENTS.
 - HARDWARE CLOTH OF 0.035 INCH (0.89 MM) WIRE OR HEAVIER.
 - CORROSION-RESISTANT WIRE MESH, WITH THE LEAST DIMENSION BEING 1/8 INCH

AREA SCHEDULE ...	
NAME	AREA
Garage	435 SF
Main Floor	1539 SF
Upper Floor	1022 SF
Covr'd Patio	246 SF
Covr'd Porch	61 SF
	308 SF
	3303 SF


F.A.R. COVERAGE CALCULATIONS:
 SITE AREA: 7,200.06 SF
 MAX LOT COVERAGE: 45% OF NET LOT AREA, OR 3,000 SF, WHICHEVER IS LESS, 19.02.020, D.3.A.
 PROPOSED FLOOR AREA: 2,996 SF
 PROPOSED F.A.R.: 41.6%

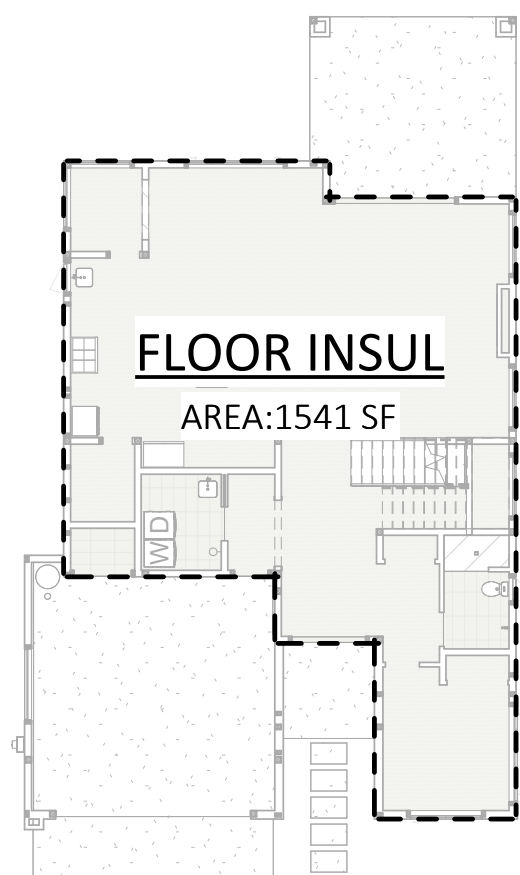

5 WSEC ENERGY CALCS - MAIN
 SCALE: 1/16" = 1'-0"

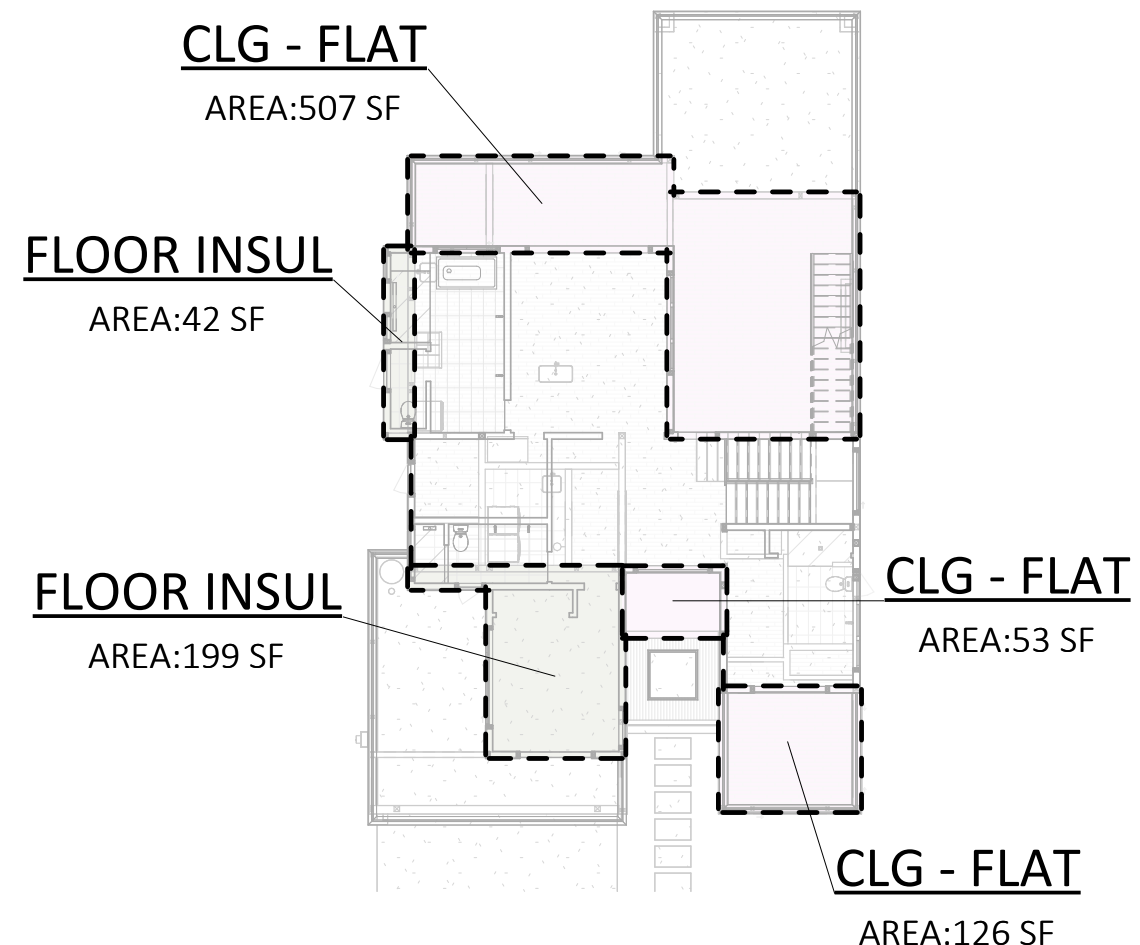


4 WSEC ENERGY CALCS - UPPER
 SCALE: 1/16" = 1'-0"


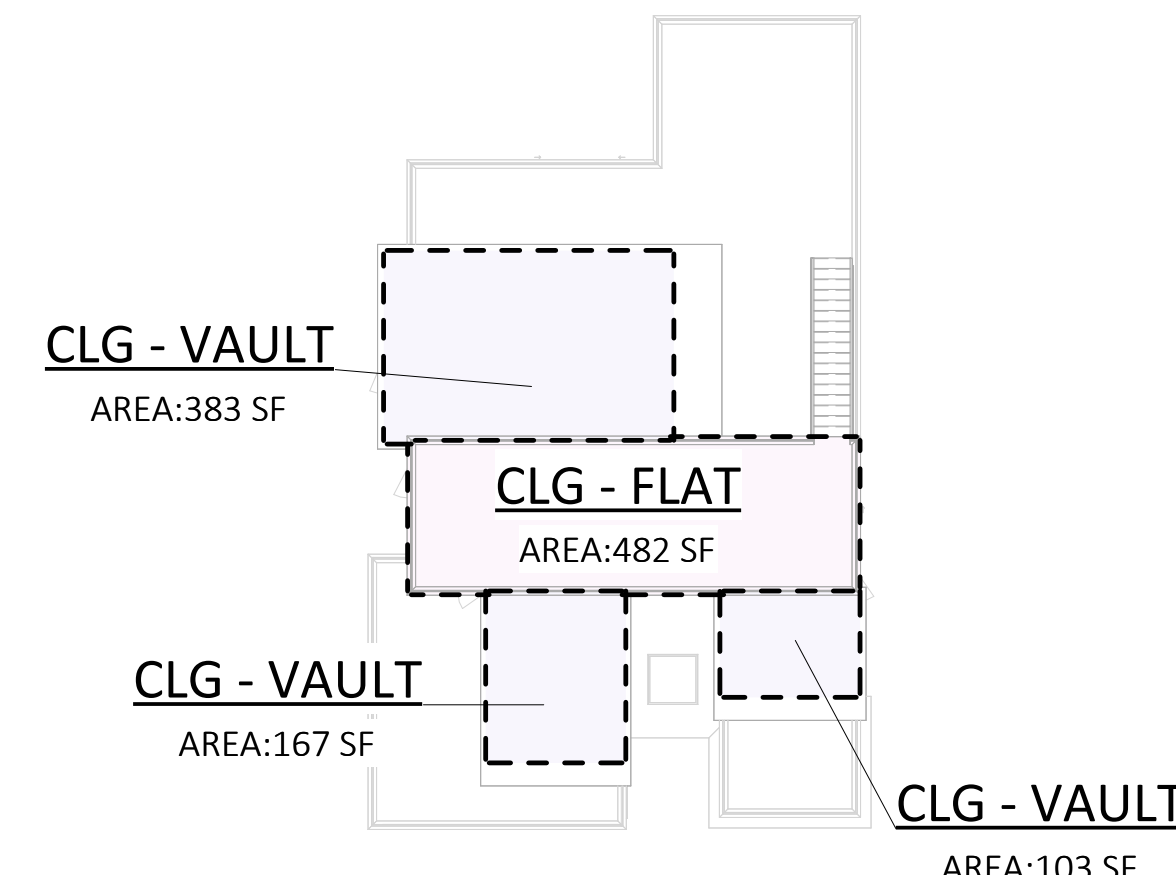


3 WSEC ENERGY CALCS - ROOF
 SCALE: 1/16" = 1'-0"


2 GROSS AREA PLAN - UPPER
 SCALE: 1/16" = 1'-0"

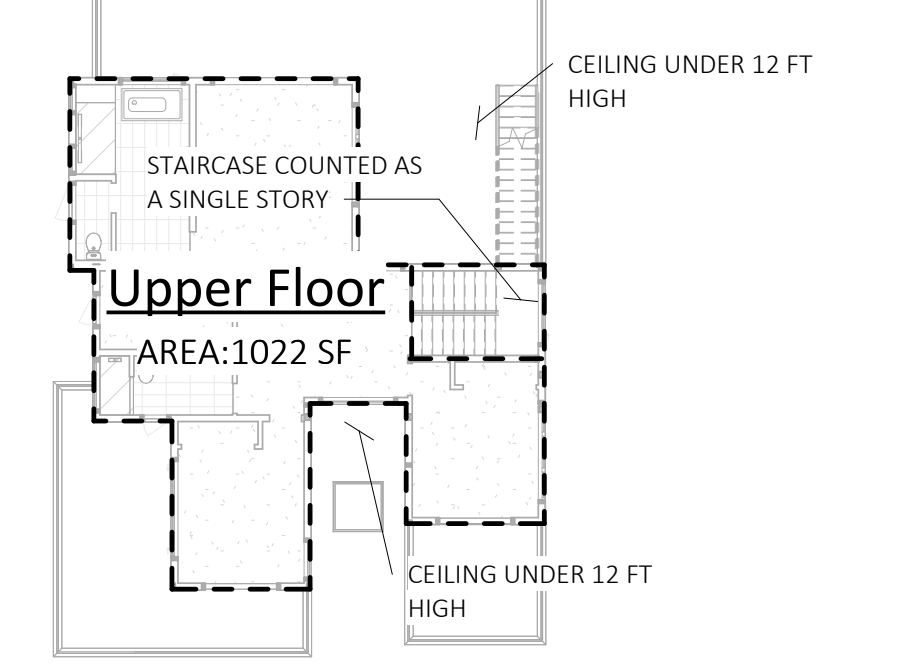


1 GROSS AREA PLAN - MAIN
 SCALE: 1/16" = 1'-0"

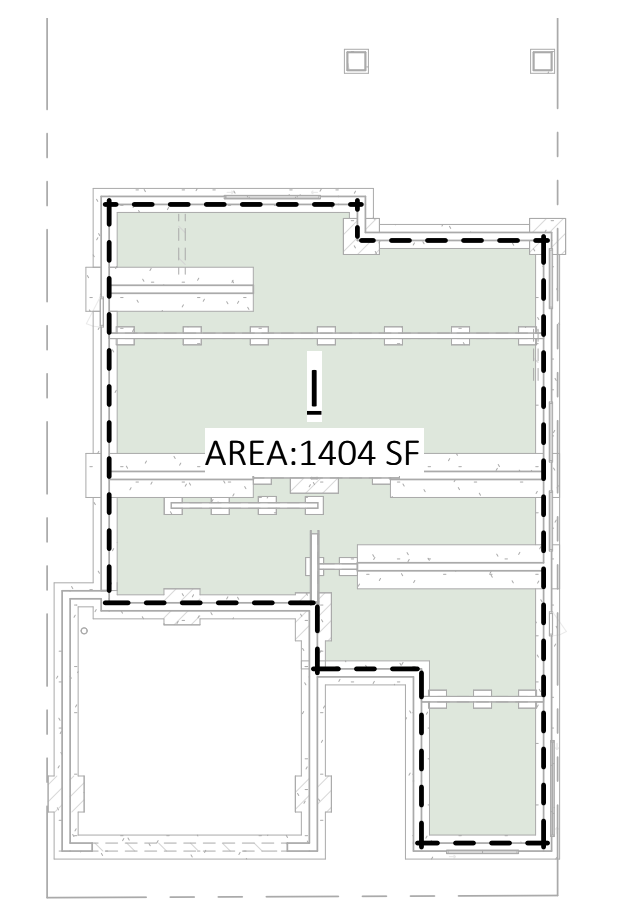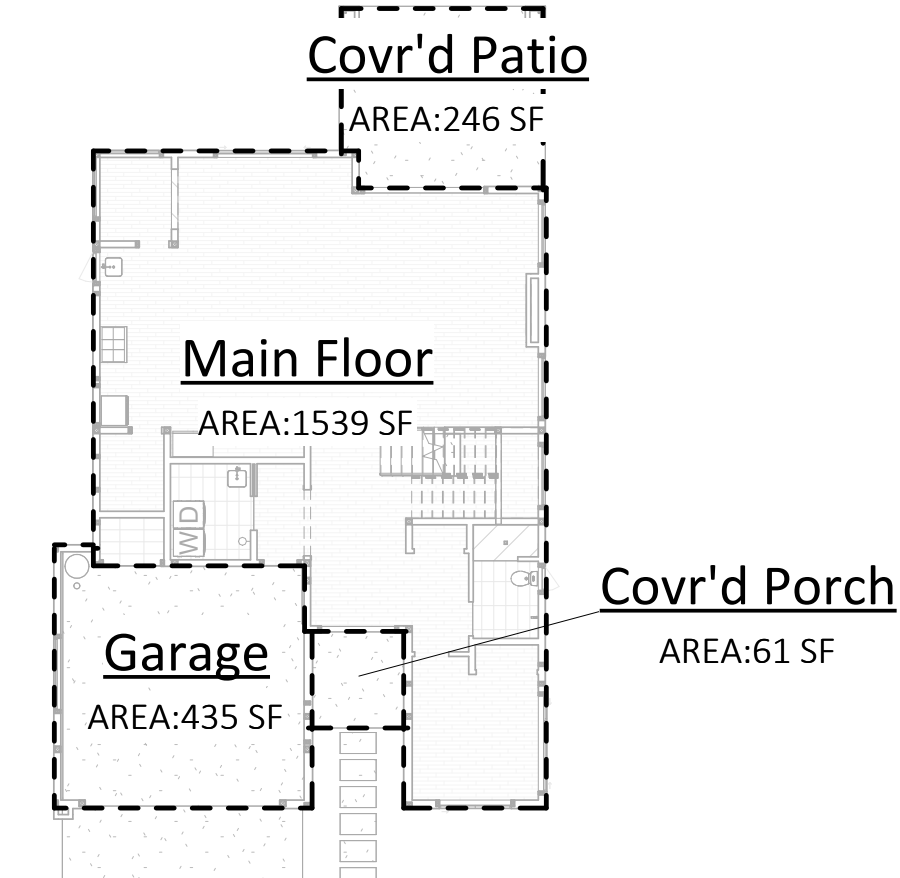

8 CRAWL SPACE VENTING CALCS
 SCALE: 1/16" = 1'-0"

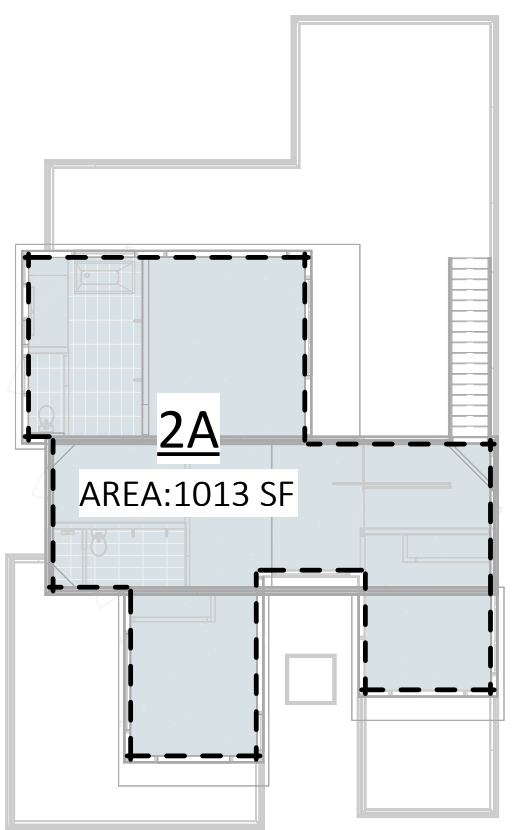

6 ROOF VENTING - UPPER
 SCALE: 1/16" = 1'-0"

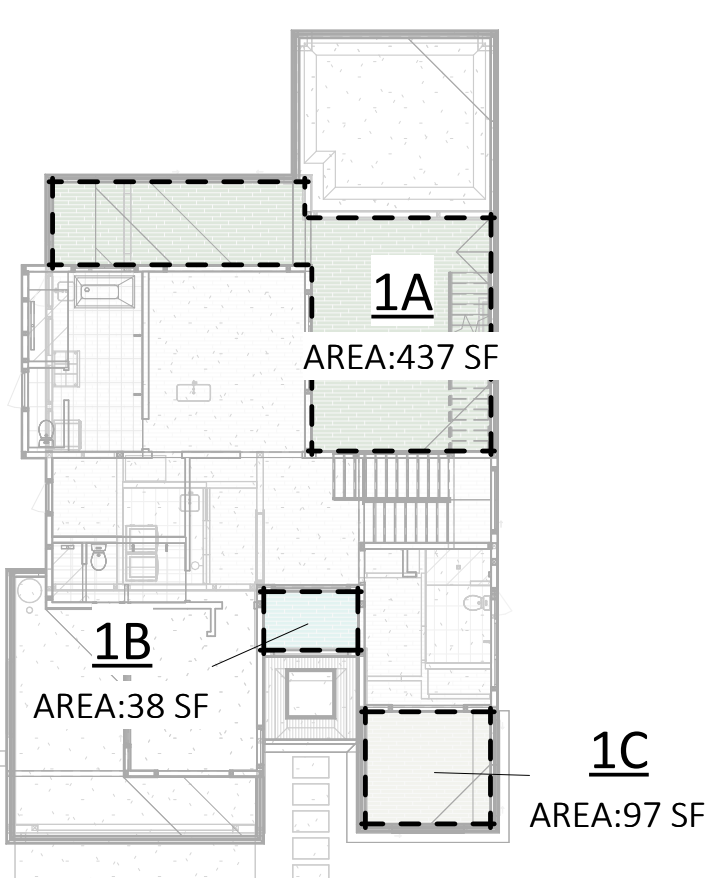

7 ROOF VENTING - MAIN
 SCALE: 1/16" = 1'-0"



8 CRAWL SPACE VENTING CALCS
 SCALE: 1/16" = 1'-0"

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, WA 98059

ATERA HOMES

HU RESIDENCE
 2448 72nd AVE SE, Mercer Island


PERMIT SET

ENERGY/VENTING CALCULATIONS

PROJECT NO: 21014
 ISSUE DATE: 2022/08/29
 DRAWN BY: SPM

A003
 SCALE 24X36: 1/16" = 1'-0"
 *NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.


6/27/2022 10:03:55 AM Autodesk Docs://21014 Hu Residence, Mercer Island/21014.05CD_Hu Residence, Mercer Island.rvt

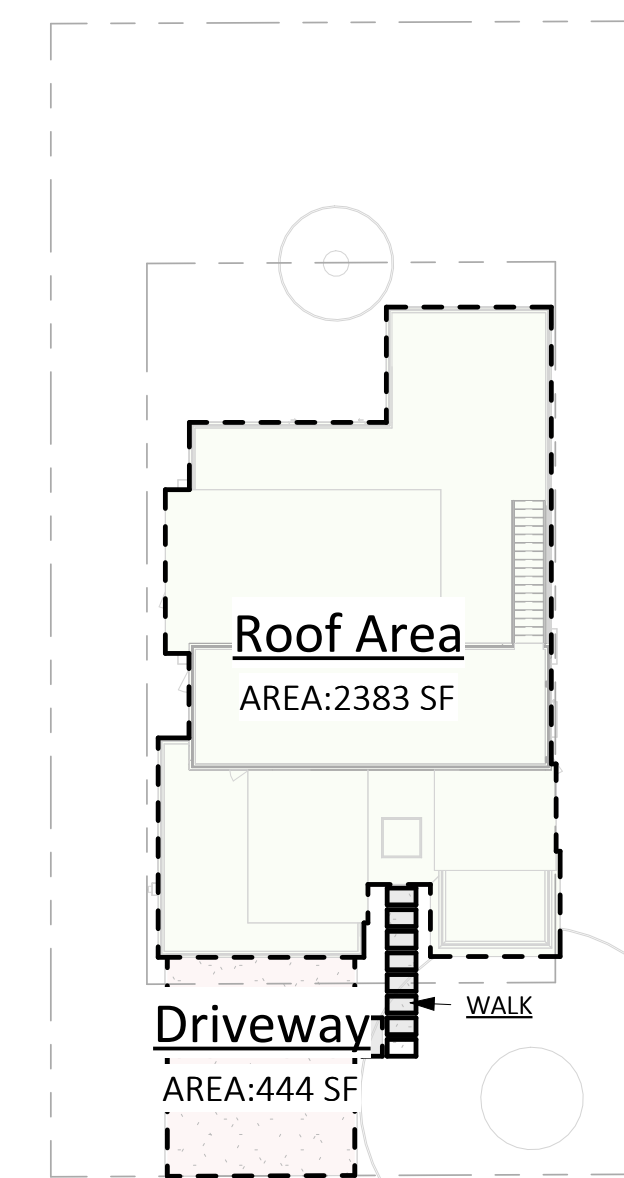

LOT COVERAGE CALCULATIONS:
 SITE AREA: 7,200.06 SF
 LOT SLOPE: 0-15%
 MAX HARDSCAPES: 9% (648 SF)
 MAX LOT COVERAGE: 40% (2,880 SF)
PROPOSED COVERAGES:
 PROPOSED IMPERVIOUS: 2,872 SF
 % OF LOT AREA: 39.89%
PROPOSED HARDSCAPES: 489 SF
 % OF LOT AREA: 6.79%

Area Schedule - Lot...

Name	Area
Driveway	444 SF
Roof Area	2383 SF
Walk	45 SF
Grand total: 12	2871 SF

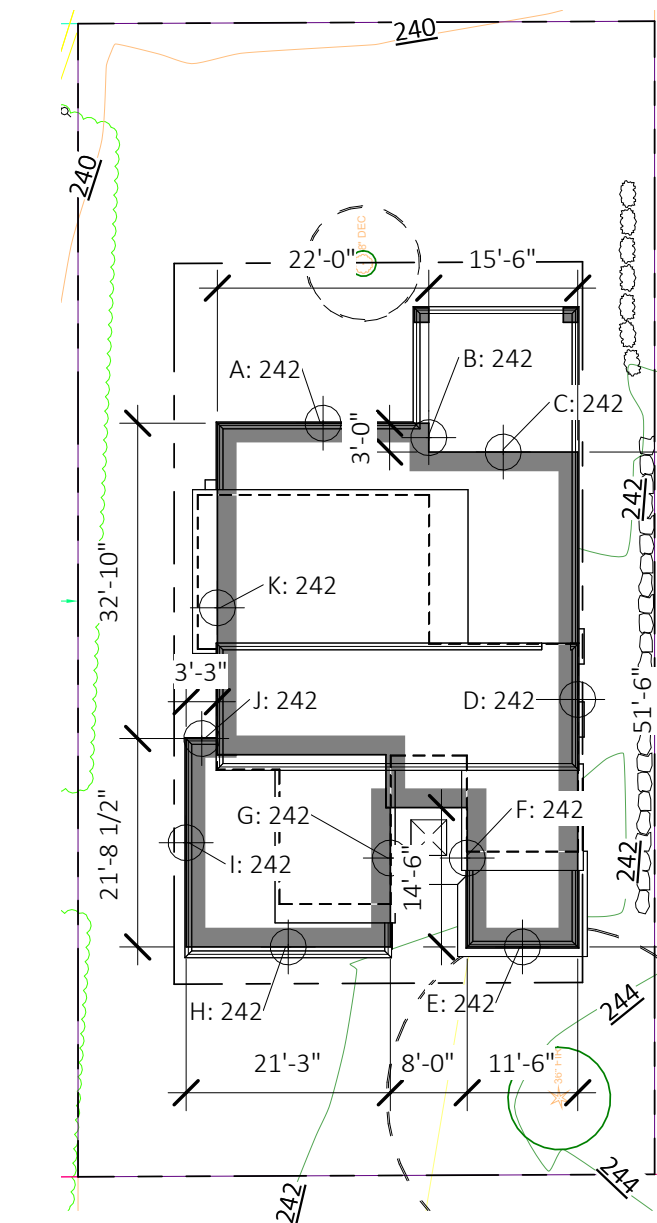

A.B.E. CHART

A.B.E. ID	A.B.E.	SEGMENT LENGTH	A.B.E. * LENGTH
A	242	22	5324
B	242	3	726
C	242	15.5	3751
D	242	51.5	12463
E	242	11.5	2783
F	242	14.5	3509
G	242	14.5	3509
H	242	21.25	5142.5
I	242	21.9	5299.8
J	242	3.25	786.5
K	242	32.9	7961.8
Grand total: 11	211.8	51255.6	

AVERAGE BLDG ELEVATION CALCULATIONS:
 51,255.6 / 211.8 = 242 A.B.E.


TREE RETENTION SCHEDULE

MARK	RETAINED	DIAMETER AT BREADTH HEIGHT		TYPE SPECIES
		EXISTING D.B.H.	RETAINED D.B.H.	
A	Yes	32"	32"	DOUGLAS FIR
B	Yes	8"	8"	JAPANESE MAPLE
2		40"	40"	



TREE RETENTION CALCS
 TOTAL TREES RETAINED: 40"
 TOTAL TREES TO BE REMOVED: 0"
 PROPOSED TREE RETENTION %: 100%

2 LOT COVERAGE CALCS
 SCALE: 1" = 20'-0"

1 AVERAGE BLDG HT CALCULATIONS
 SCALE: 1" = 20'-0"

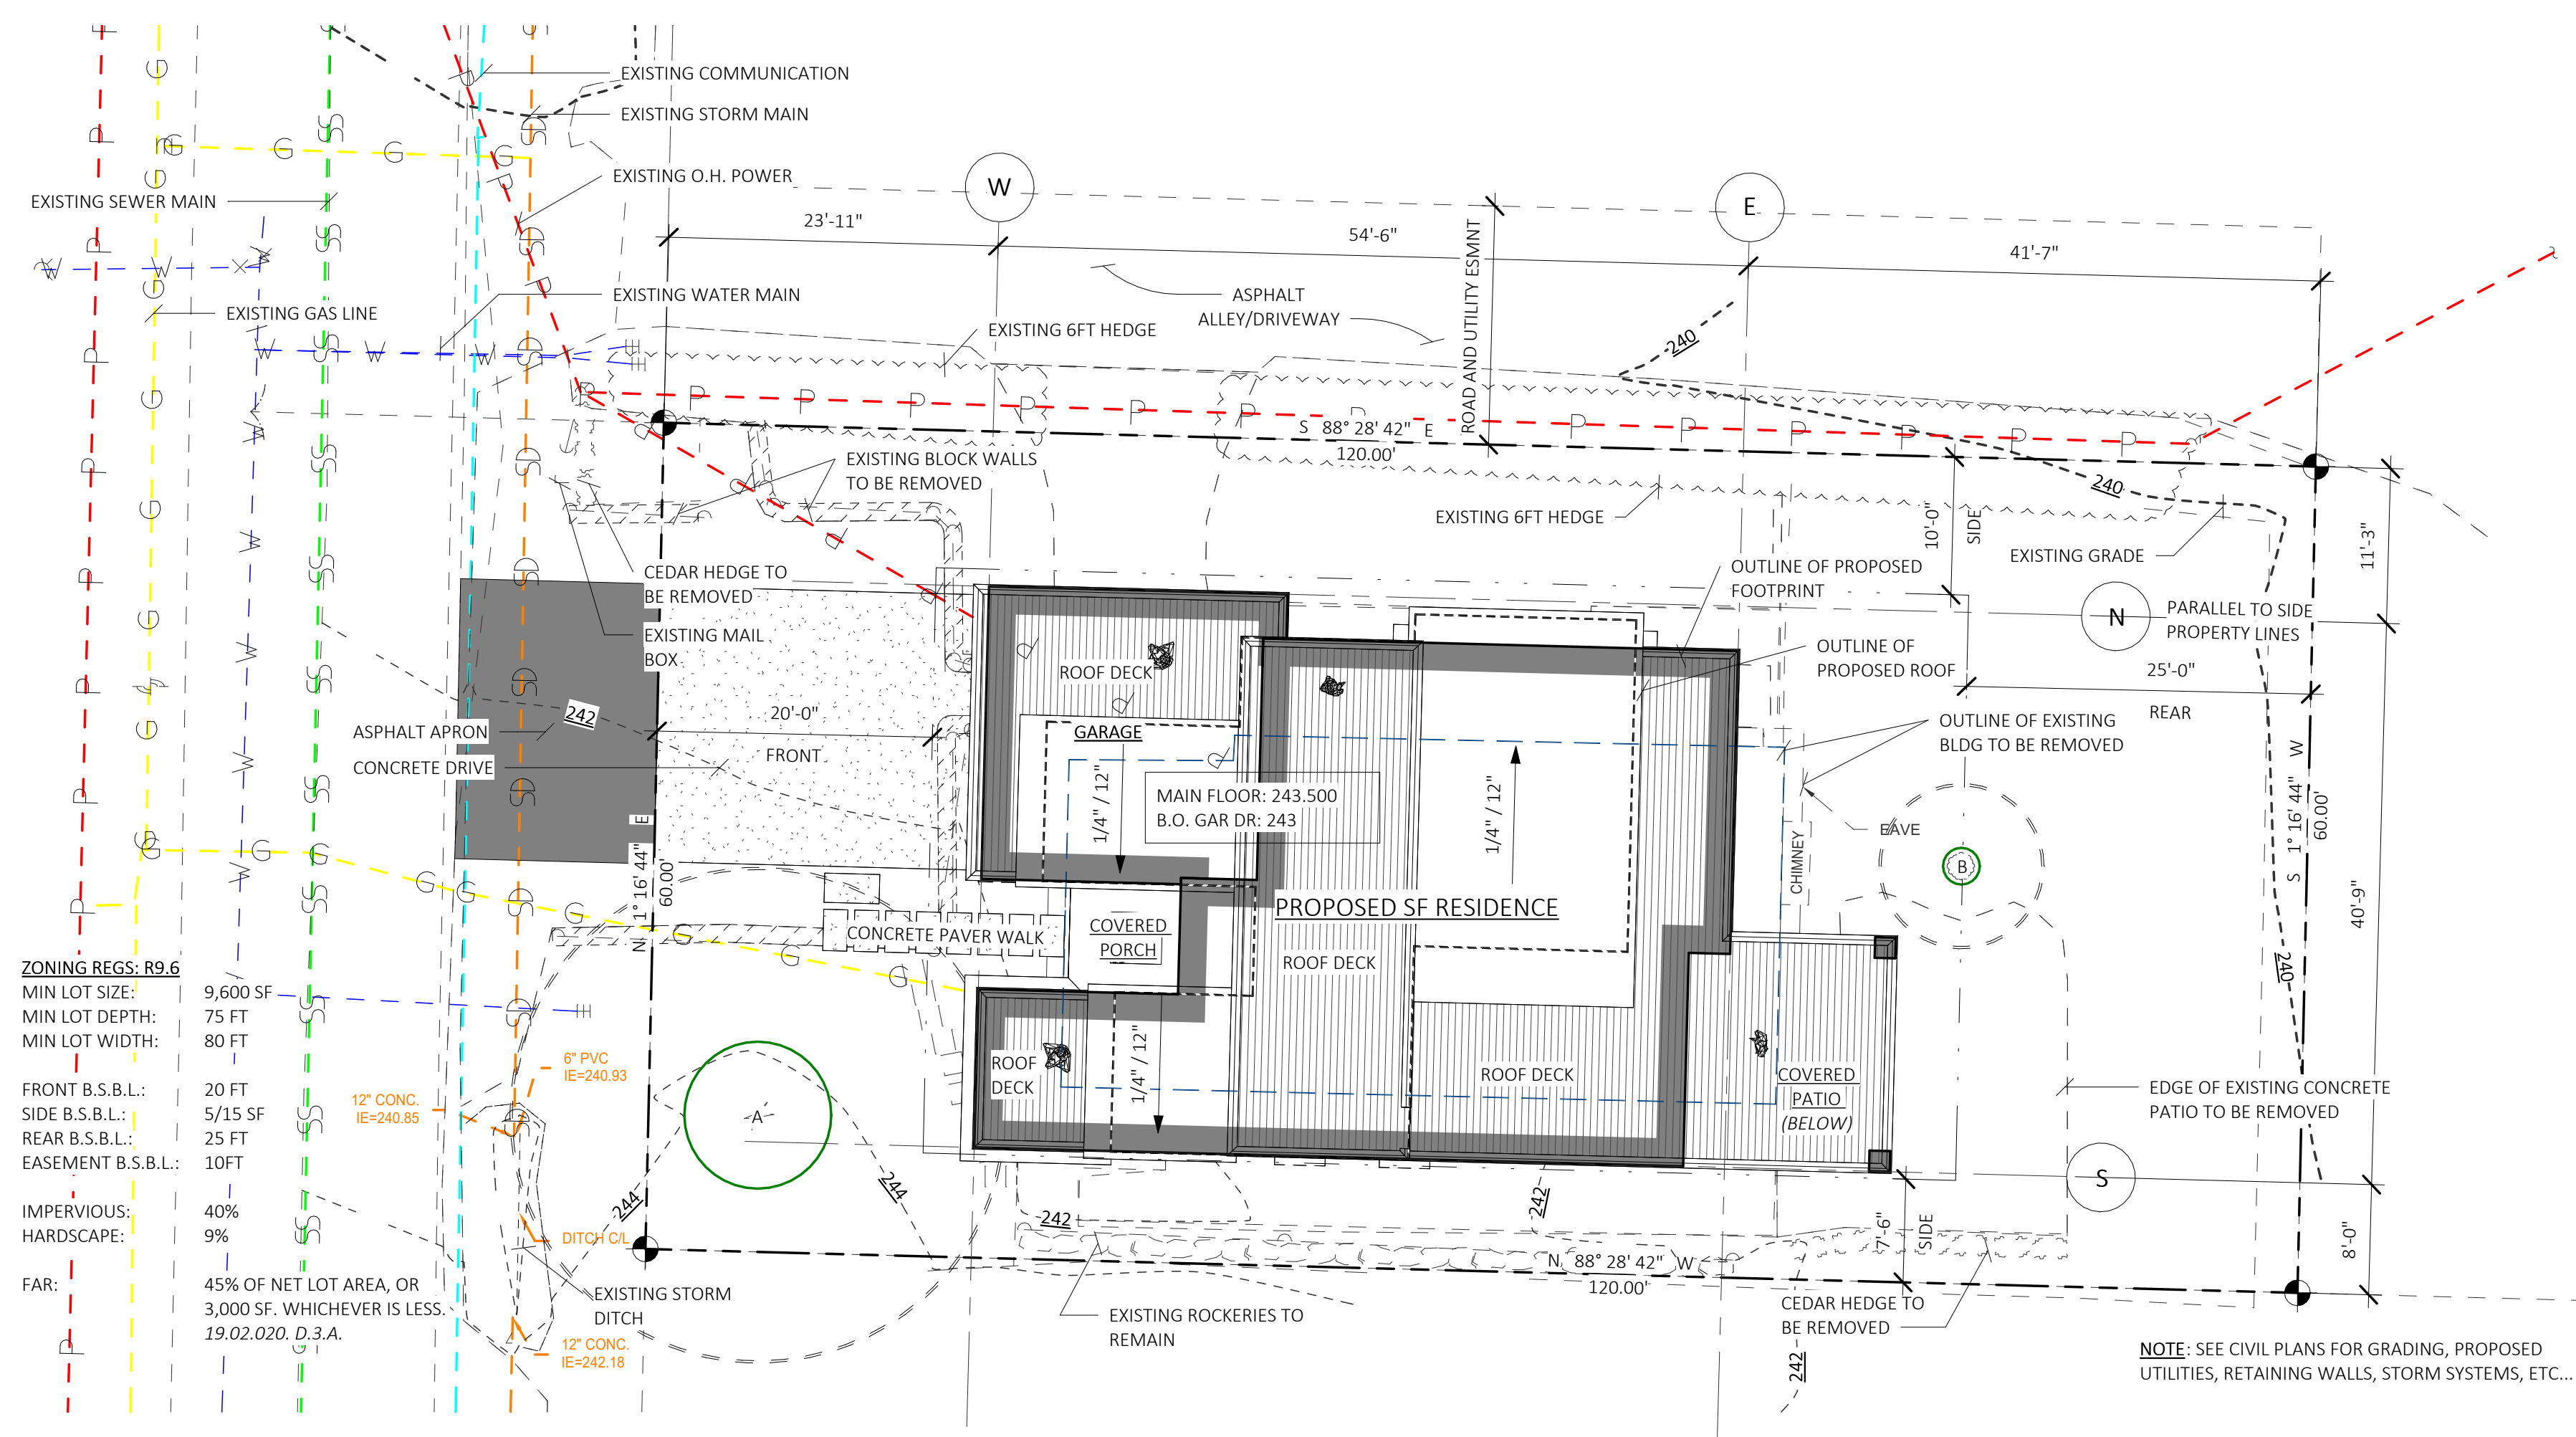

SEE SHEET A002 FOR F.A.R. CALCULATIONS

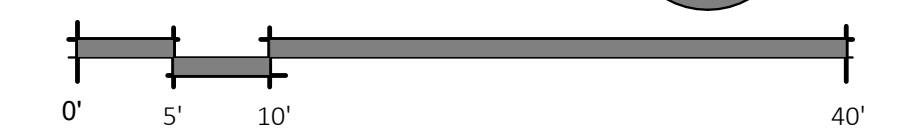

SCALE 24X36: As indicated
 *NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, WA 98059



HU RESIDENCE
 2448 72nd AVE SE, Mercer Island

PERMIT SET

SITE PLAN & AREA/HT CALCULATIONS

PROJECT NO: 21014
 ISSUE DATE: 2022/08/29
 DRAWN BY: SPM

A101

Description


No.

Date

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

DOOR SCHEDULE						
TYPE MARK	DESCRIPTION	SIZE		COUNT	DOOR PANEL	
		WIDTH	HT		CONSTRUCTION	GLAZING AREA
10	HINGED DOUBLE EXTERIOR - ENTRY	6'-0"	8'-0"	1	S.C.	0 SF
20	HINGED DOUBLE INTERIOR PANEL	4'-0"	8'-0"	1	S.C.	0 SF
21	HINGED DOUBLE INTERIOR PANEL	4'-8"	8'-0"	1	S.C.	0 SF
22	HINGED DOUBLE INTERIOR PANEL	5'-0"	8'-0"	1	S.C.	0 SF
30	HINGED - SINGLE - EXTERIOR - FULL LITE	3'-0"	8'-0"	1	S.C.	0 SF
40	HINGED - SINGLE - INTERIOR - FULL LITE	2'-4"	7'-0"	1	S.C.	0 SF
41	HINGED - SINGLE - INTERIOR - FULL LITE	2'-4"	8'-0"	1	S.C.	0 SF
42	HINGED - SINGLE - INTERIOR	2'-4"	8'-0"	4	S.C.	0 SF
43	HINGED - SINGLE - INTERIOR	2'-6"	8'-0"	2	S.C.	0 SF
44	HINGED - SINGLE - INTERIOR	2'-8"	8'-0"	3	S.C.	0 SF
50	LA CANTINA FOLDING DOOR	10'-0"	9'-11 1/2"	1		0 SF
60	2-PANEL SLIDING GLASS DOOR	6'-0"	8'-0"	2	VINYL	96 SF
61	3-PANEL SLIDING GLASS DOOR	10'-0"	7'-10"	1	VINYL	78 SF
70	OVERHEAD GARAGE DOOR	16'-0"	9'-0"	1		0 SF
80	SLIDING CLOSET - BI-PASS	5'-0"	8'-0"	1	H.C.	0 SF
81	SLIDING CLOSET - BI-PASS	6'-0"	8'-0"	2	H.C.	0 SF
90	SLIDING INTERIOR POCKET	2'-8"	8'-0"	1	S.C.	0 SF
Grand total: 25						174 SF

WINDOW SCHEDULE						
TYPE MARK	STYLE	SIZE			COUNT	IS EGRESS
		WIDTH	HT	AREA		
10	Double Casement + Picture	8'-0"	6'-0"	96 SF	2	No
20	Casement	2'-0"	4'-6"	18 SF	2	No
21	Casement	2'-6"	4'-6"	11 SF	1	Yes
22	Casement	2'-6"	6'-0"	15 SF	1	Yes
23	Casement	3'-0"	4'-6"	14 SF	1	Yes
30	Horz Sliding Dbl-Vent	8'-0"	5'-0"	80 SF	2	Yes
31	Horz Sliding Dbl-Vent	8'-0"	6'-0"	48 SF	1	Yes
32	Horz Sliding Half-Vent	5'-0"	5'-0"	25 SF	1	Yes
33	Horz Sliding Half-Vent	5'-0"	6'-0"	30 SF	1	Yes
34	Horz Sliding Half-Vent	6'-0"	5'-0"	30 SF	1	Yes
40	Picture	2'-0"	2'-0"	8 SF	2	No
41	Picture	2'-6"	1'-6"	8 SF	2	No
42	Picture	3'-0"	1'-6"	14 SF	3	No
43	Picture	3'-0"	5'-0"	15 SF	1	No
44	Picture	4'-0"	2'-0"	8 SF	1	No
45	Picture	5'-0"	1'-6"	30 SF	4	No
46	Picture	5'-0"	4'-0"	60 SF	3	No
47	Picture	5'-0"	6'-0"	90 SF	3	No
48	Picture	6'-0"	1'-6"	18 SF	2	No
49	Picture	6'-0"	4'-0"	24 SF	1	No
50	Picture	6'-0"	6'-0"	36 SF	1	No
51	Picture	6'-2"	1'-6"	9 SF	1	No
52	Picture	8'-0"	1'-6"	24 SF	2	No
80	Skylight	4'-0"	4'-0"	16 SF	1	
Grand total: 40						726 SF

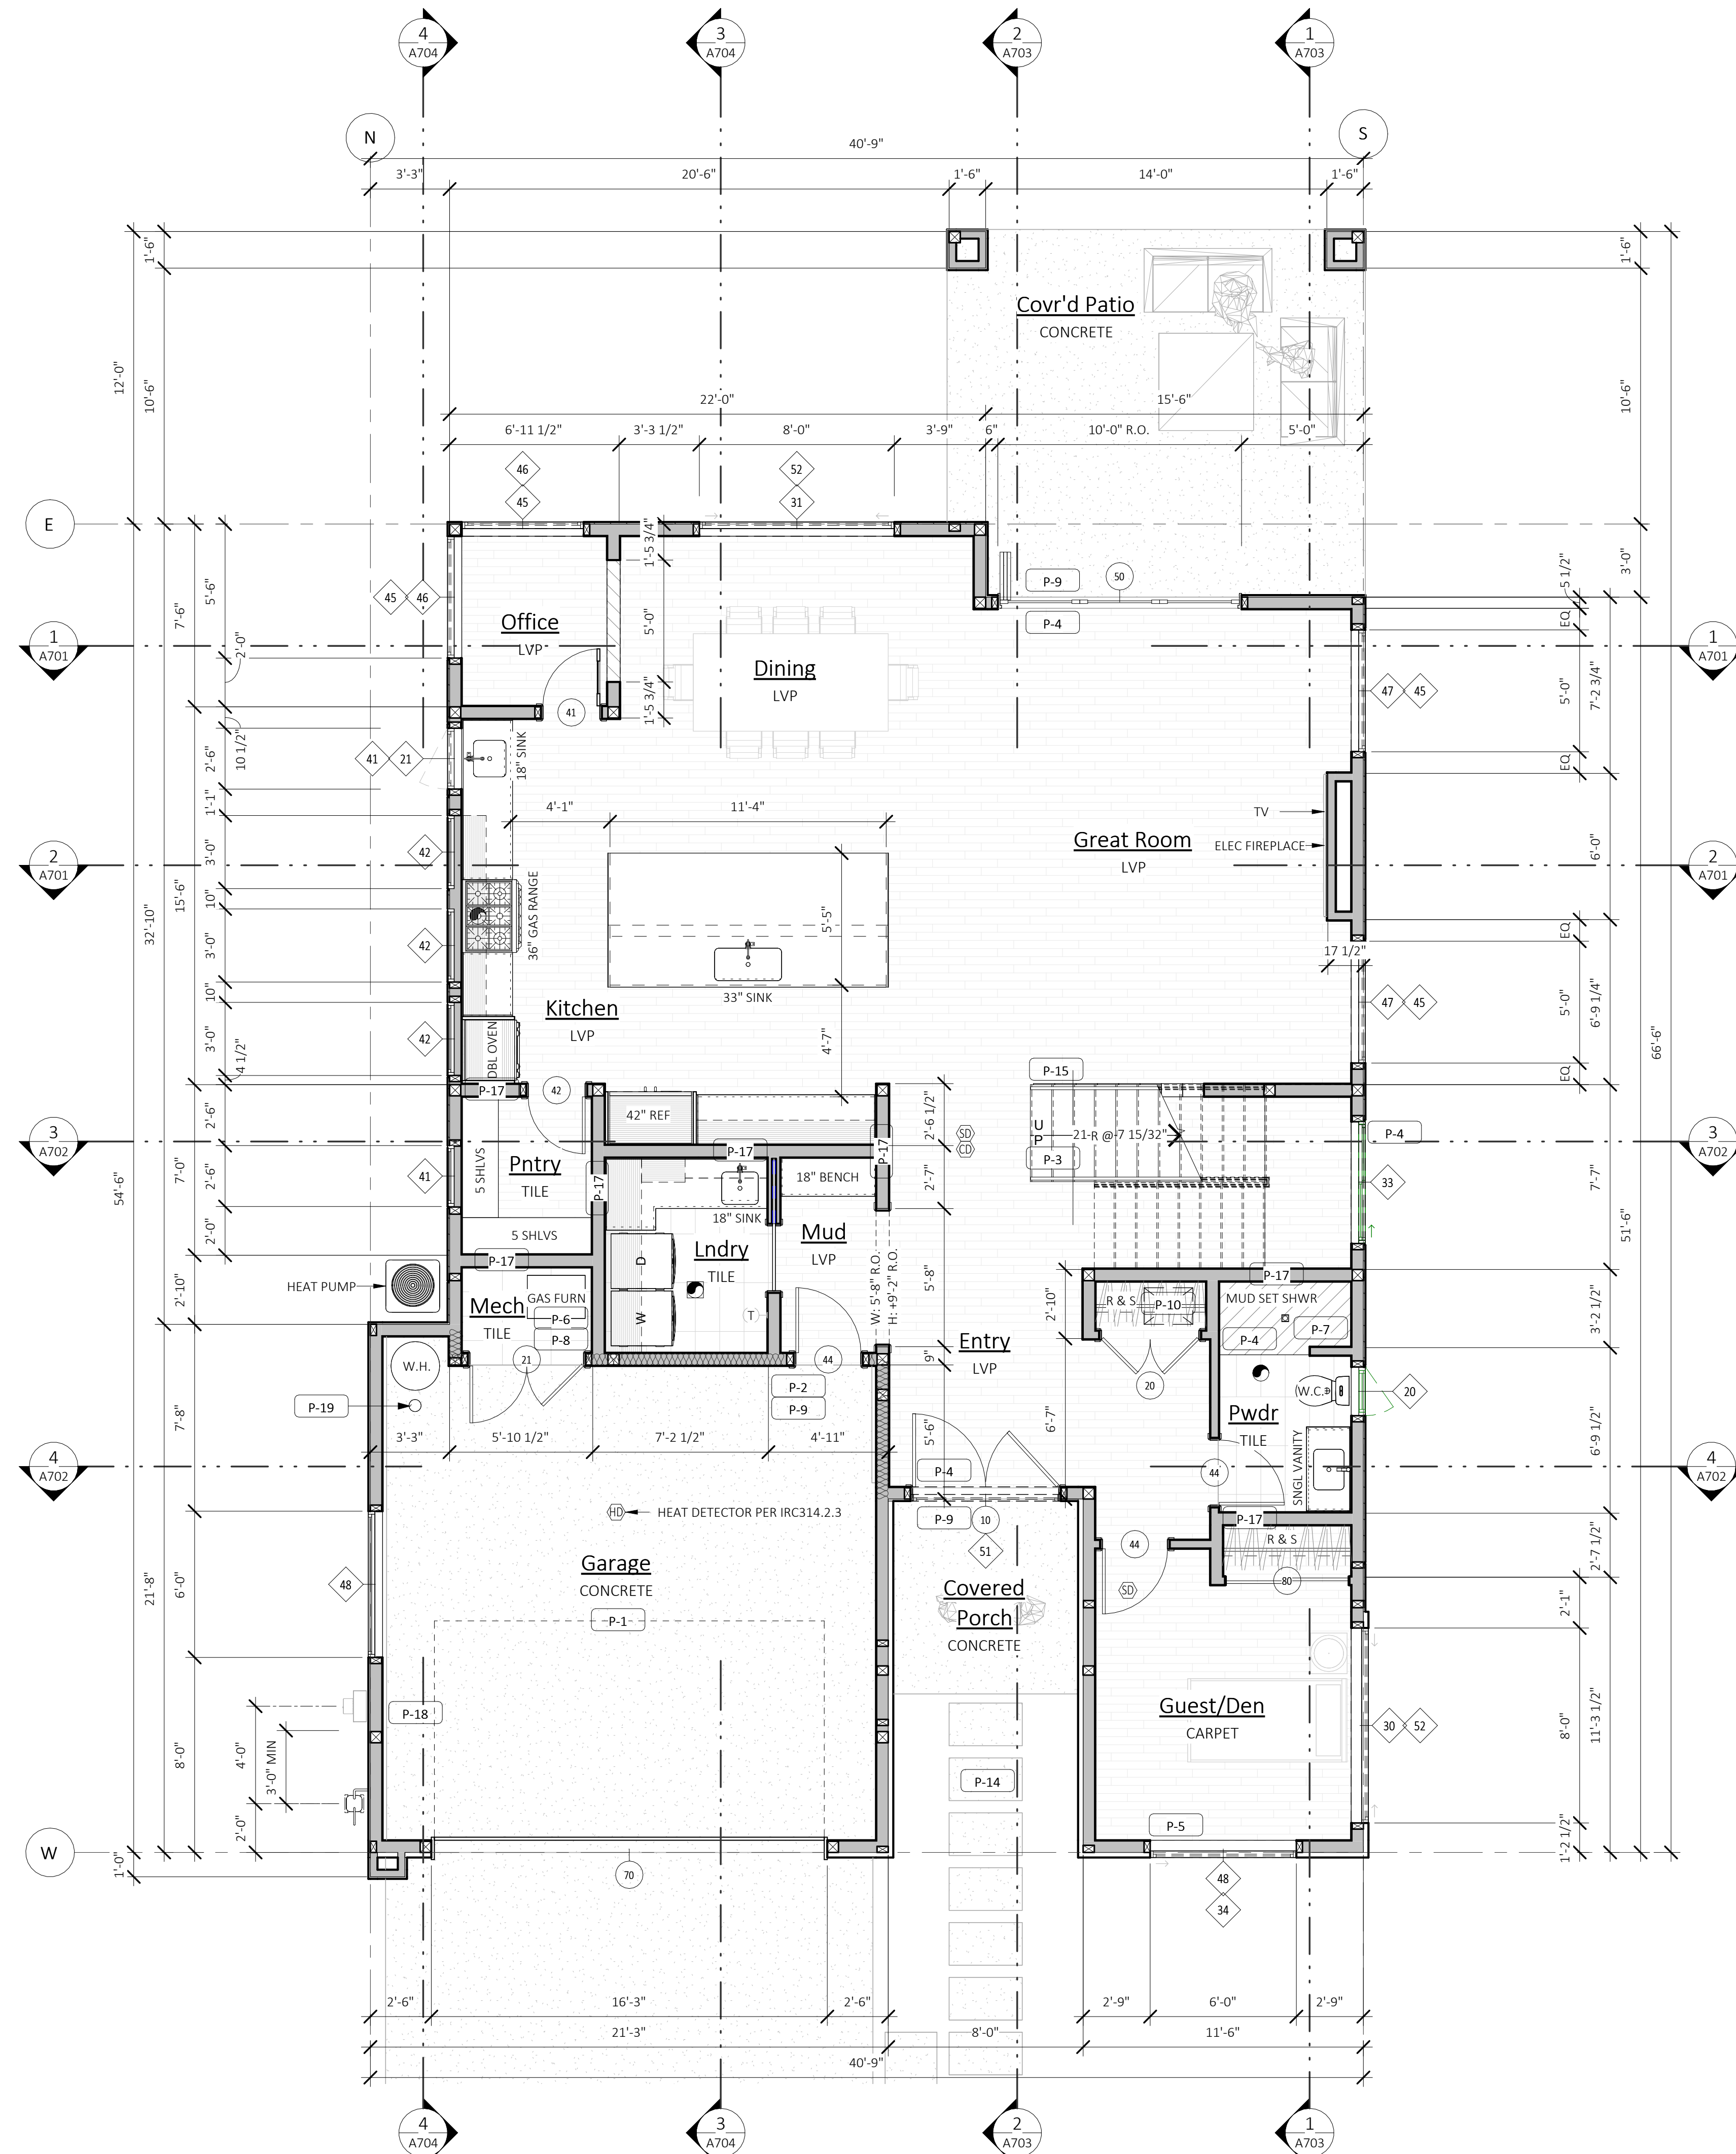

GENERAL PLAN NOTES:

- SEE SHEET A001 FOR GENERAL CONSTRUCTION SPECIFICATIONS.
- SEE BUILDING ELEVATIONS FOR WINDOW OPERATION.
- SEE "TYPICAL BUILDING MATERIALS" LIST ON THE ELEVATION SHEET(S).
- FOR THE SYMBOLS & LEGEND SEE SHEET A000.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLDDOWNS AND SHEET(S) S201-S203 FOR SHEARWALL DETAILS/SCHEDULE.
- SEE SHEET A201-A301 FOR WINDOWS SCHEDULE. SEE SHEET A201-A301 FOR DOOR SCHEDULE. SEE ELEVATIONS SHEETS FOR WINDOW OPERATION.
- WINDOW DIMENSIONS SHOWN ARE SUGGESTED NOMINAL/ROUGH OPENINGS, NET DIMENSIONS TO BE PER MANUFACTURER.

KEYNOTES - FLOORPLAN	
ID	DESCRIPTION
P-1	GARAGE/HOUSE OCCUPANCY SEPARATION. PER IRC R302.6 a) 1/2" GYP. AT GARAGE SIDE BETWEEN RESIDENCE AND ATTIC. b) 5/8" TYPE "X" GYP SEPARATING HABITABLE ROOMS ABOVE. c) 1/2" GYP. AT WALLS SUPPORTING HABITABLE ROOMS ABOVE."
P-2	DOOR BETWEEN GARAGE AND HOUSE SHALL BE EQUIPPED WITH A SELF-CLOSING DEVICE, AND BE A MIN 1 3/8" THICK SOLID WOOD DOOR OR 20 MIN. F.R. DOOR. PER IRC SECTION R302.5.1
P-3	STAIR ASSEMBLY: PER IRC SECTION R311.7.7 a) WIDTH 36" MIN., HEADROOM 6'-8" MIN. b) RISER 7-3/4" MAX.; TREAD 10" MIN. c) TOP OF HANDRAIL AT 34" MIN. AND 38" MAX ABOVE TREAD NOSING d) HANDRAIL WIDTH 1-1/4" MIN. AND 2" MAX. e) INSTALL FIRE BLOCKING IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. f) COVER USABLE SPACE UNDER STAIR WITH 1/2" GYP."
P-4	SAFETY GLAZING PER IRC SECTION R308.4
P-5	EGRESS WINDOW PER IRC SECTION R310. PROVIDE MIN NET CLEARANCE OF 5 SF AT GRADE FLOOR OPENINGS AND 5.7 SF ABOVE. MIN SILL HEIGHT TO BE 44" A.F.F.
P-6	IGNITERS: A) FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN ABOVE TOP OF SLAB. PROVIDE (2) LAYERS OF FLOOR SHEATHING OVER FRAMING. PER IRC SECTION G2408. B) HEAT-PRODUCING EQUIPMENT AND APPLIANCES SHALL BE INSTALLED TO MAINTAIN THE REQUIRED CLEARANCES TO COMBUSTIBLE CONSTRUCTION AS SPECIFIED IN THE LISTING AND MANUFACTURER'S INSTRUCTIONS. PER IRC G2408.5
P-7	COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NONABSORBENT MATERIAL TO 72" ABOVE DRAIN INLETS. PER IRC SECTION R307.2. FOR GROUND FLR WASTE OPENING REQ SEE UPC NOTES ON SHT A001
P-8	HIGH EFFICIENCY GAS FURNACE. SIZE PER WSEC PRESCRIPTIVE ENERGY CODE COMPLIANCE FORMS. a) PROVIDE DUCT LEAKAGE, SEALING & TESTING PER WSEC 502 & 503. b) THERMOSTAT PER WSEC 503.8. c) SEE WSEC NOTES ON SHEET A001
P-9	7-3/4" MAX. RISER WITH 10" MIN. TREAD DEPTH. IF MORE THAN (4) RISERS HANDRAIL REQUIRED PER IRC SECTION R311.7.7. a) PROVIDE 36"x36" MIN. LANDING AT EXTERIOR DOORS PER IRC SECTION R311.3
P-10	PROVIDE CRAWL SPACE ACCESS. MIN. 18" X 24" UNOBSTRUCTED ACCESS. PER IRC SECTION R408.4
P-14	SEE SITE PLAN FOR EXTENT OF WALKS AND DRIVEWAYS.
P-15	36" MIN. GUARDRAIL. AT STAIRS SLOPES AT 36" ABOVE STAIR NOSINGS. PER SEE IRC SECTION 312
P-17	2x6 WALL FOR PLUMBING / HVAC.
P-18	A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL. SEE SECTION M1505.4 ON SHEET A002 THE MAIN ELECTRICAL PANEL SHALL HAVE A RESERVED SPACE FOR FUTURE SOLAR ELECTRIC INSTALLATION PER IRC T103.9. A PERMANENT CERTIFICATE FOR SOLAR-READY ZONE IS TO BE POSTED PER IRC T103.10.
P-19	3" DIA GALV BOLLARD OR EQ PER G2408.3 & M1307.3.1

AREA SCHEDULE ...

NAME	AREA
Garage	435 SF
Main Floor	1539 SF
Upper Floor	1022 SF
	2996 SF
Cov'd Patio	246 SF
Cov'd Porch	61 SF
	308 SF
	3303 SF

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, WA 98059

HU RESIDENCE
 2448 72nd AVE SE, Mercer Island


PERMIT SET
 MAIN FLOOR

PROJECT NO: 21014
 ISSUE DATE: 2022/08/29
 DRAWN BY: SPM

A301

SCALE 24X36: 1/4" = 1'-0"
 *NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



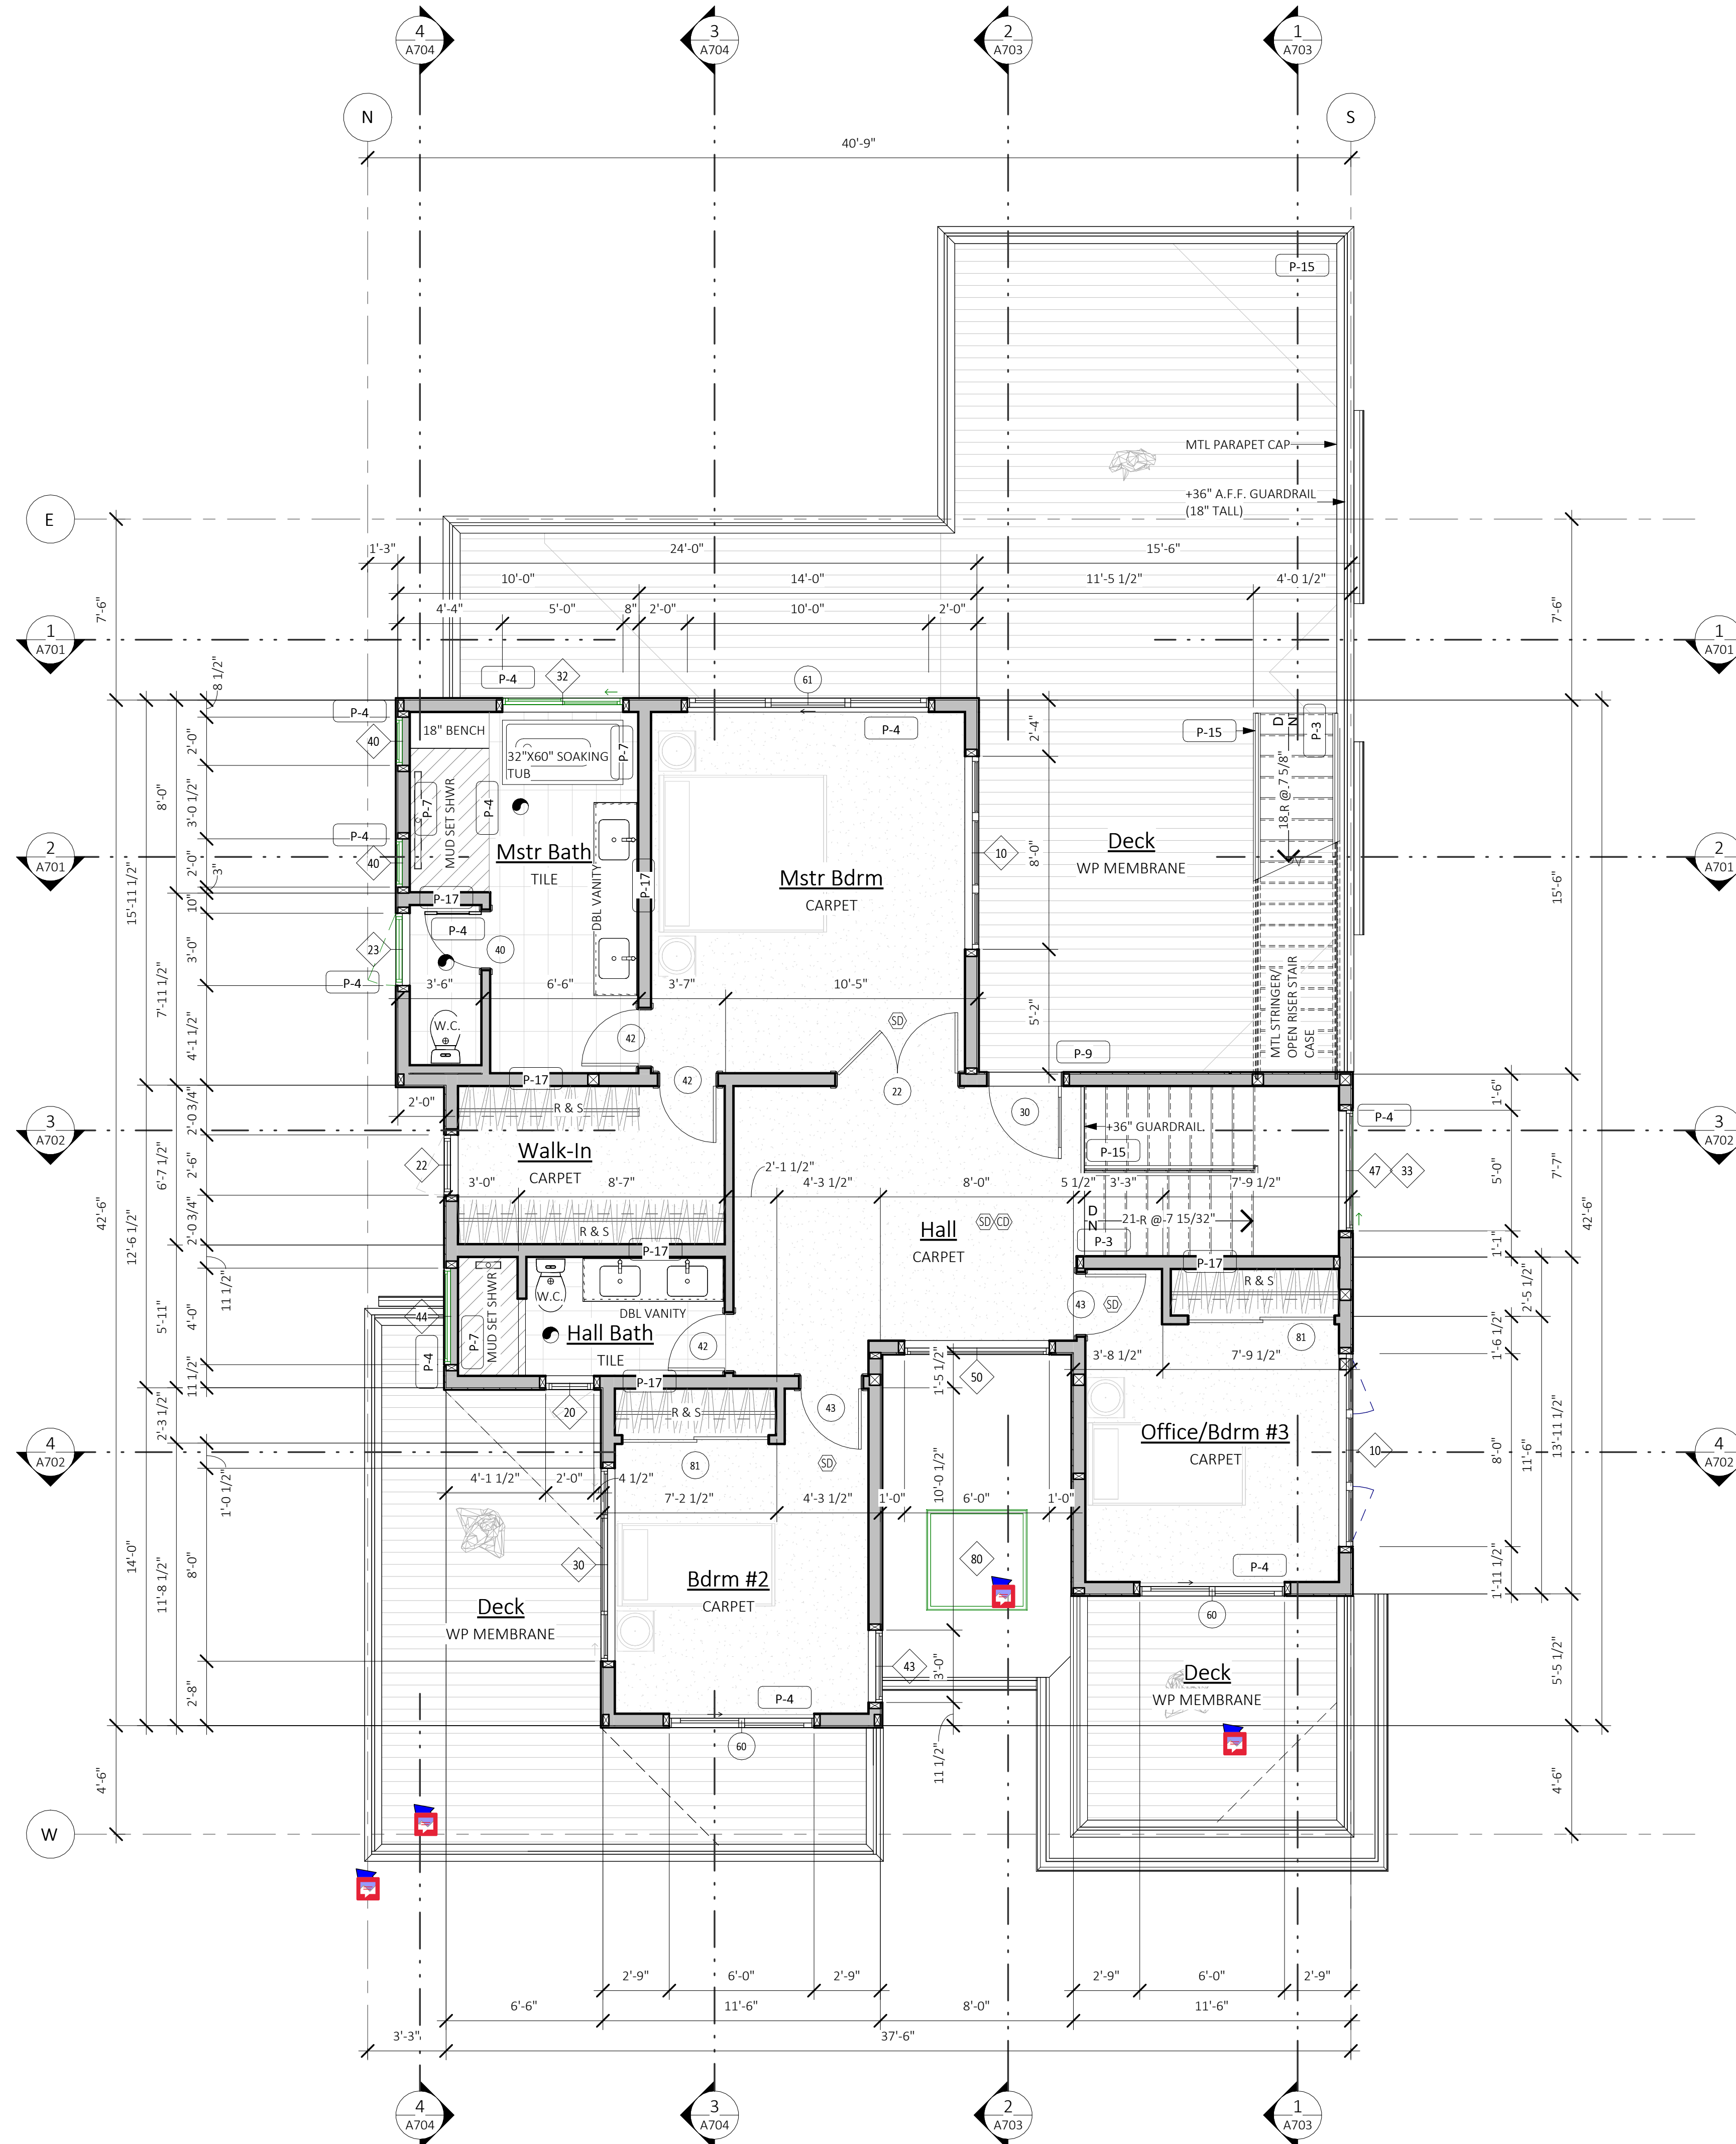

GENERAL PLAN NOTES:

- SEE SHEET A001 FOR GENERAL CONSTRUCTION SPECIFICATIONS.
- SEE BUILDING ELEVATIONS FOR WINDOW OPERATION.
- SEE "TYPICAL BUILDING MATERIALS" LIST ON THE ELEVATION SHEET(S).
- FOR THE SYMBOLS & LEGEND SEE SHEET A000.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLDDOWNS AND SHEET(S) S201-S203 FOR SHEARWALL DETAILS/ SCHEDULE.
- SEE SHEET A201-A301 FOR WINDOWS SCHEDULE. SEE SHEET A201-A301 FOR DOOR SCHEDULE. SEE ELEVATIONS SHEETS FOR WINDOW OPERATION.
- WINDOW DIMENSIONS SHOWN ARE SUGGESTED NOMINAL/ROUGH OPENINGS, NET DIMENSIONS TO BE PER MANUFACTURER.

KEYNOTES - FLOORPLAN


ID	DESCRIPTION
P-1	GARAGE/HOUSE OCCUPANCY SEPARATION. PER IRC R302.6 a) 1/2" GYP. AT GARAGE SIDE BETWEEN RESIDENCE AND ATTIC. b) 5/8" TYPE 'X' GYP SEPARATING HABITABLE ROOMS ABOVE. c) 1/2" GYP. AT WALLS SUPPORTING HABITABLE ROOMS ABOVE."
P-2	DOOR BETWEEN GARAGE AND HOUSE SHALL BE EQUIPED WITH A SELF-CLOSING DEVICE, AND BE A MIN 1 3/8" THICK SOLID WOOD DOOR OR 20 MIN. F.R. DOOR. PER IRC SECTION R302.5.1
P-3	STAIR ASSEMBLY. PER IRC SECTION R311.7.3 a) WIDTH 36" MIN.; HEADROOM 6'-8" MIN. b) RISER 7-3/4" MAX.; TREAD 10" MIN. c) TOP OF HANDRAIL AT 34" MIN. AND 38" MAX ABOVE TREAD NOSING d) HANDRAIL WIDTH 1-1/4" MIN. AND 2" MAX. e) INSTALL FIRE BLOCKING IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. f) COVER USABLE SPACE UNDER STAIR WITH 1/2" GYP."
P-4	SAFETY GLAZING PER IRC SECTION R308.4
P-5	EGRESS WINDOW PER IRC SECTION R310. PROVIDE MIN NET CLEARANCE OF 5.5 FT AT GRADE FLOOR OPENINGS AND 5.7.5 FT ABOVE. MIN SILL HEIGHT TO BE 44" A.F.F.
P-6	IGNITERS: A) FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN ABOVE TOP OF SLAB, PROVIDE (2) LAYERS OF FLOOR SHEATHING OVER FRAMING. PER IRC SECTION G2408. B) HEAT-PRODUCING EQUIPMENT AND APPLIANCES SHALL BE INSTALLED TO MAINTAIN THE REQUIRED CLEARANCES TO COMBUSTIBLE CONSTRUCTION AS SPECIFIED IN THE LISTING AND MANUFACTURER'S INSTRUCTIONS. PER IRC G2408.5
P-7	COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NONABSORBENT MATERIAL TO 72" ABOVE DRAIN INLETS. PER IRC SECTION R307.2. FOR GROUND FLR WASTE OPENING REQ SEE UPC NOTES ON SHT A001
P-8	HIGH EFFICIENCY GAS FURNACE, SIZE PER WSEC PRESCRIPTIVE ENERGY CODE COMPLIANCE FORMS. a) PROVIDE DUCT LEAKAGE, SEALING & TESTING PER WSEC 502 & 503. b) THERMOSTAT PER WSEC 503.8. c) SEE WSEC NOTES ON SHEET A001
P-9	7-3/4 MAX. RISER WITH 10" MIN. TREAD DEPTH. IF MORE THAN (4) RISERS. HANDRAIL REQUIRED PER IRC SECTION R311.7.7. a) PROVIDE 36"x36" MIN. LANDING AT EXTERIOR DOORS PER IRC SECTION R311.3
P-10	PROVIDE CRAWL SPACE ACCESS, MIN. 18" X 24" UNOBSTRUCTED ACCESS. PER IRC SECTION R408.4
P-14	SEE SITE PLAN FOR EXTENT OF WALKS AND DRIVEWAYS.
P-15	36" MIN. GUARDRAIL. AT STAIRS SLOPES AT 36" ABOVE STAIR NOSINGS. PER SEE IRC SECTION 312
P-17	2x6 WALL FOR PLUMBING / HVAC.
P-18	A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL. SEE SECTION M1505.4 ON SHEET A002 THE MAIN ELECTRICAL PANEL SHALL HAVE A RESERVED SPACE FOR FUTURE SOLAR ELECTRIC INSTALLATION PER IRC T103.9. A PERMANENT CERTIFICATE FOR SOLAR-READY ZONE IS TO BE POSTED PER IRC T103.10.
P-19	3" DIA GALV BOLLARD OR EQ PER G2408.3 & M1307.3.1

AREA SCHEDULE ...

NAME	AREA
Garage	435 SF
Main Floor	1539 SF
Upper Floor	1022 SF
	2996 SF
Covr'd Patio	246 SF
Covr'd Porch	61 SF
	308 SF
	3303 SF

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

Description
 No
 Date
ATERA DESIGN STUDIO
 451 DUVALL AVE NE.
 RENTON, WA 98059



HU RESIDENCE
 2448 72nd AVE SE, Mercer Island


PERMIT SET
 UPPER FLOOR

PROJECT NO: 21014
 ISSUE DATE: 2022/08/29
 DRAWN BY: SPM

A401

SCALE 24X36: 1/4" = 1'-0"
 *NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



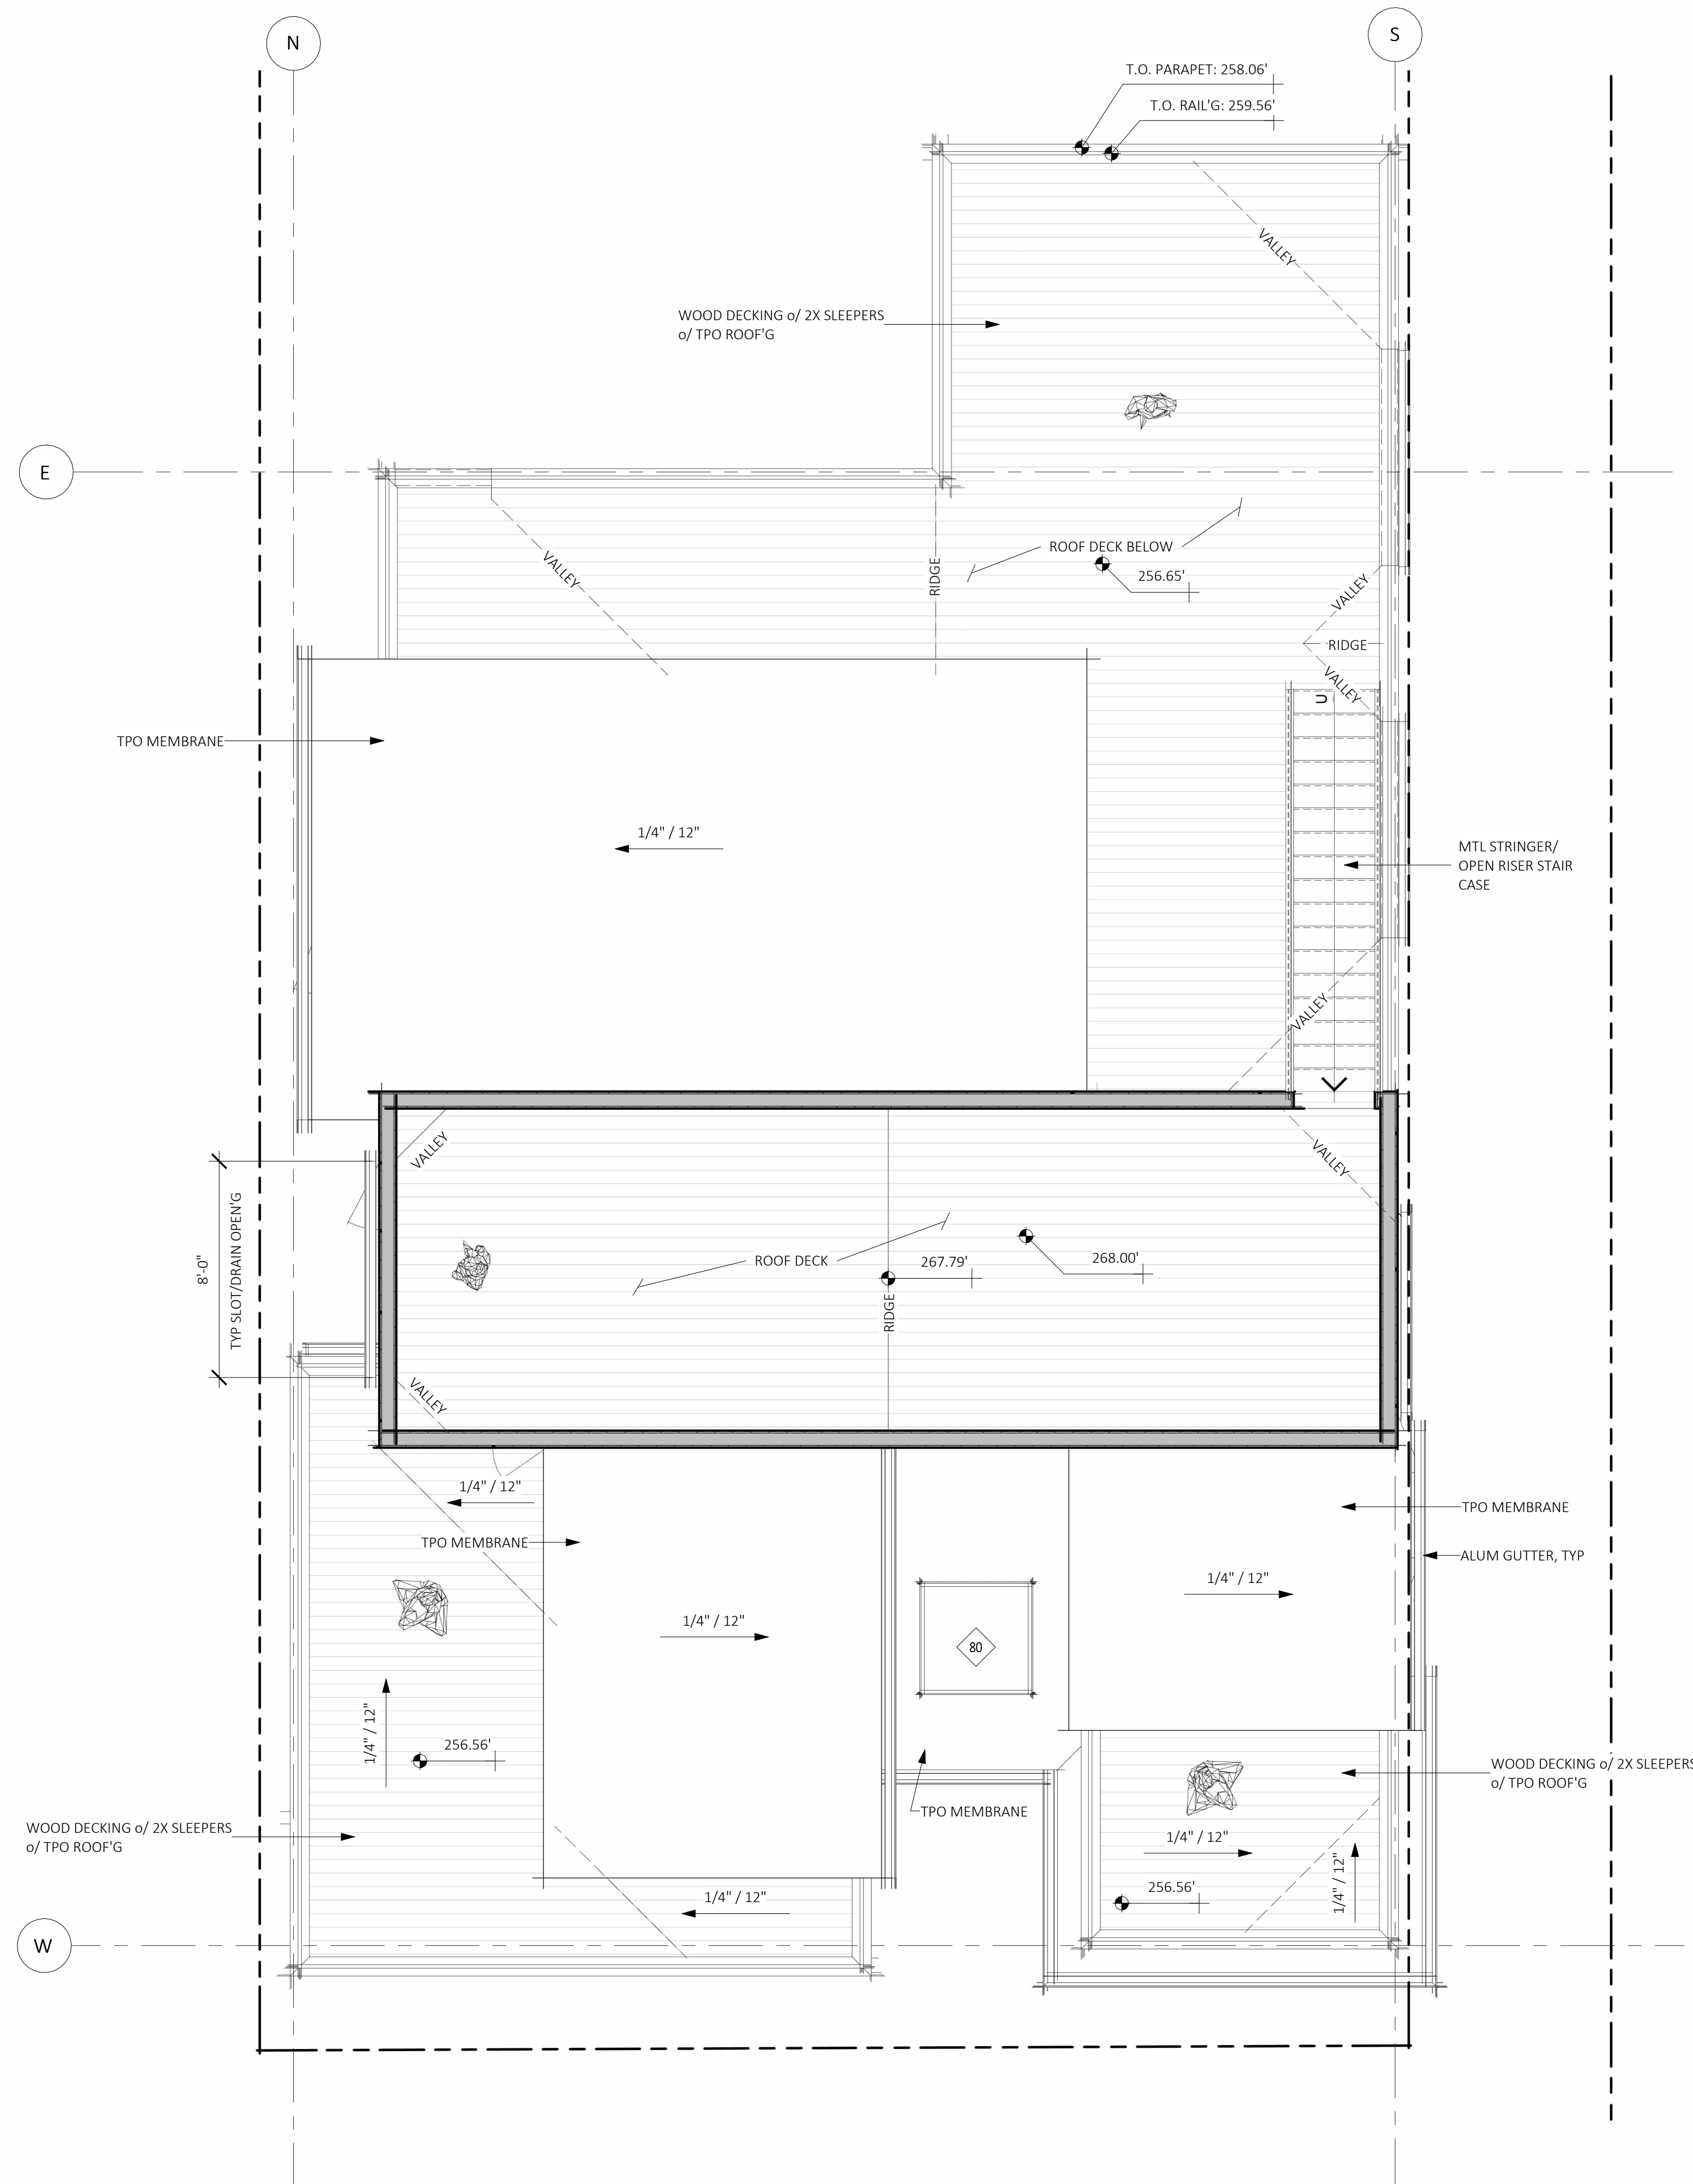

GENERAL FRAMING NOTES:

- SEE SECTION R301, SHEET A001 FOR GENERAL DESIGN CRITERIA.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLDDOWNS AND SHEET(S) **S201-S203** FOR SHEARWALL DESIGNATIONS/ SCHEDULE.
- TRUSS DESIGN BY MANUFACTURER. TRUSS DESIGN DRAWINGS SHALL BE PREPARED PER IRC SECTION R802.10.1 AND SHALL BE PROVIDED TO THE BUILDING OFFICIAL AND APPROVED PRIOR TO INSTALLATION.
 - * TRUSS DESIGN PER IRC SECTION R802.10.2
 - * FIELD ALTERATIONS MUST BE DESIGNED BY MFR. PER IRC SECTION R802.10.4
 - * SEE STRUCTURAL PLANS FOR DESIGN LOADS.
 - * TRUSS MFR TO PROVIDE ADEQUATE BEARING AREA TO RESOLVE REACTION (PERPENDICULAR TO GRAIN) AT ALL HIGHLY LOADED GIRDER TRUSSES.
- PROVIDE 2x4 RAFTER/TRUSS TAIL - TYP. U.N.O.
- ROOF PITCH: EXTERIOR PER ELEVATIONS & INTERIOR PER SECTIONS.
- ROOF FRAMING SPACING, 24" o.c. U.N.O.
- SEE ELEVATIONS AND/OR SECTIONS FOR ROOF PITCH, PLATE HEIGHT AND HEADER HEIGHT.
- FASTENERS: ALL FRAMING SHALL BE NAILED IN ACCORDANCE WITH THE STRUCTURAL DRAWINGS. POSITIVE CONNECTIONS SHALL BE PROVIDED WHERE POSTS AND BEAM OR GIRDER CONSTRUCTION IS USED TO SUPPORT FLOOR FRAMING.
- INSTALL 2X FIREBLOCKING PER R302.11 AS FOLLOWS:
 - a) IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS, VERT AT THE CLG AND FLR LEVELS AND HORZ AT INTERVALS NOT EXCEEDING 10 FEET.
 - b) AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERT AND HORZ SPACES SUCH AS OCCUR AT SOFFITS, DROP CLGS AND COVE CLGS.
 - c) IN CONCEALED SPACES BTWN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
 - d) AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E 136 REQUIREMENTS. THE INTEGRITY OF ALL FIREBLOCKS SHALL BE MAINTAINED.
- SEE SHT **A003** FOR ROOF & CRAWL SPACE AREA VENTILATION CALCULATIONS

SPRAY FOAM NOTES:

- WHERE SPRAY FOAM IS NOTED ON THE PLANS, NO VENTING IS REQUIRED: PROVIDE MIN 2" CLOSED CELL SPRAY FOAM INSULATION DIRECTLY TO THE UNDERSIDE OF THE ROOF/FLOOR SHEATHING.
- PROVIDE SOLID EAVE BLOCKING, TYP
- A COPY OF THE ICC-ES REPORT FOR THE INSULATION PRODUCT MUST BE PROVIDED ON SITE FOR THE FIELD INSPECTOR.
- THE APPLIED SPRAY FOAM MUST BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS BY A CERTIFIED INSTALLER

ROOF VENTING NOTES:


- (4) 2" DIA EAVE VENTS PER BLOCK= 5.024 SQ. IN. / L.F. (80% NET FREE AREA)
- ROOF JACKS - 50 SQ. IN. EACH
- INSTALL ONE LOW ROOF JACK, WITHIN 36" OF EAVE, FOR EVERY 12 LF OF EAVE WITHIN 60" OF PROPERTY LINE
- MINIMUM NET AREA SHALL BE NOT LESS THAN 1 S.F. PER 150 S.F. OF ATTIC AREA OR 1 S.F. PER 300 S.F. OF ATTIC AREA IF NOT LESS THAN 40 PERCENT, BUT NOT MORE THAN 50 PERCENT, OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED NOT MORE THAN 3 FEET BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY.
 - A. THE BALANCE OF THE REQUIRED VENTILATION PROVIDED SHALL BE LOCATED IN THE BOTTOM ONE-THIRD OF THE ATTIC SPACE.
- AS AN ALTERNATIVE, THE NET FREE CROSS-VENTILATION AREA MAY BE REDUCED TO 1/300 WHEN A CLASS I OR II VAPOR BARRIER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.

KEYNOTES - FRAMING

ID	DESCRIPTION
FR-4	UPSET - BOTTOM OF BEAM EVEN w/ BOTTOM OF JOISTS. TOP OF BEAM EXTENDS ABOVE JOISTS.
FR-5	TOP OF BEAM IS FLUSH w/ BOTTOM OF JOISTS w/ NO TOP PLATE. CUT ADJACENT FRAMING MEMBERS INTO BEAM FOR ADEQUATE SUPPORT.
FR-9	TOP OF BEAM 5" BELOW TOP OF JOISTS TO ALLOW FOR HVAC.

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, WA 98059



HU RESIDENCE
 2448 72nd AVE SE, Mercer Island

PERMIT SET


ROOF PLAN

PROJECT NO: 21014
 ISSUE DATE: 2022/06/29
 DRAWN BY: SPM


A501

SCALE 24X36: 1/4" = 1'-0"
 *NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.




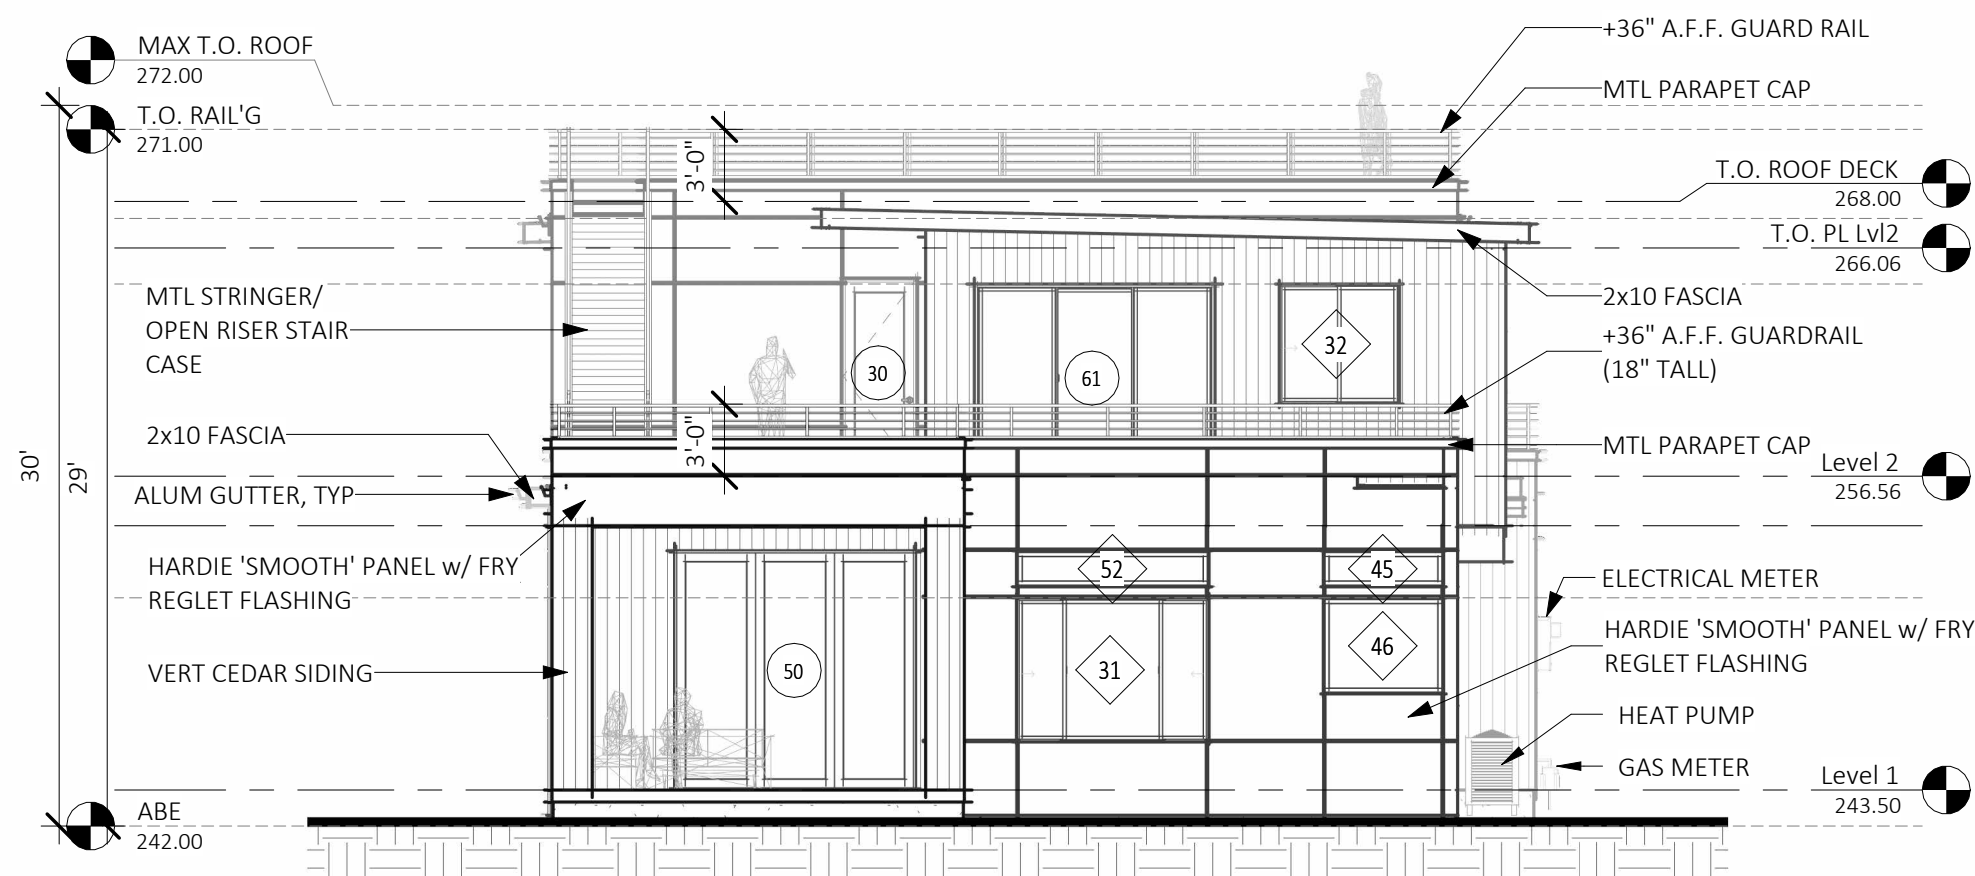

2 EAST ELEVATION
SCALE: 1/8" = 1'-0"

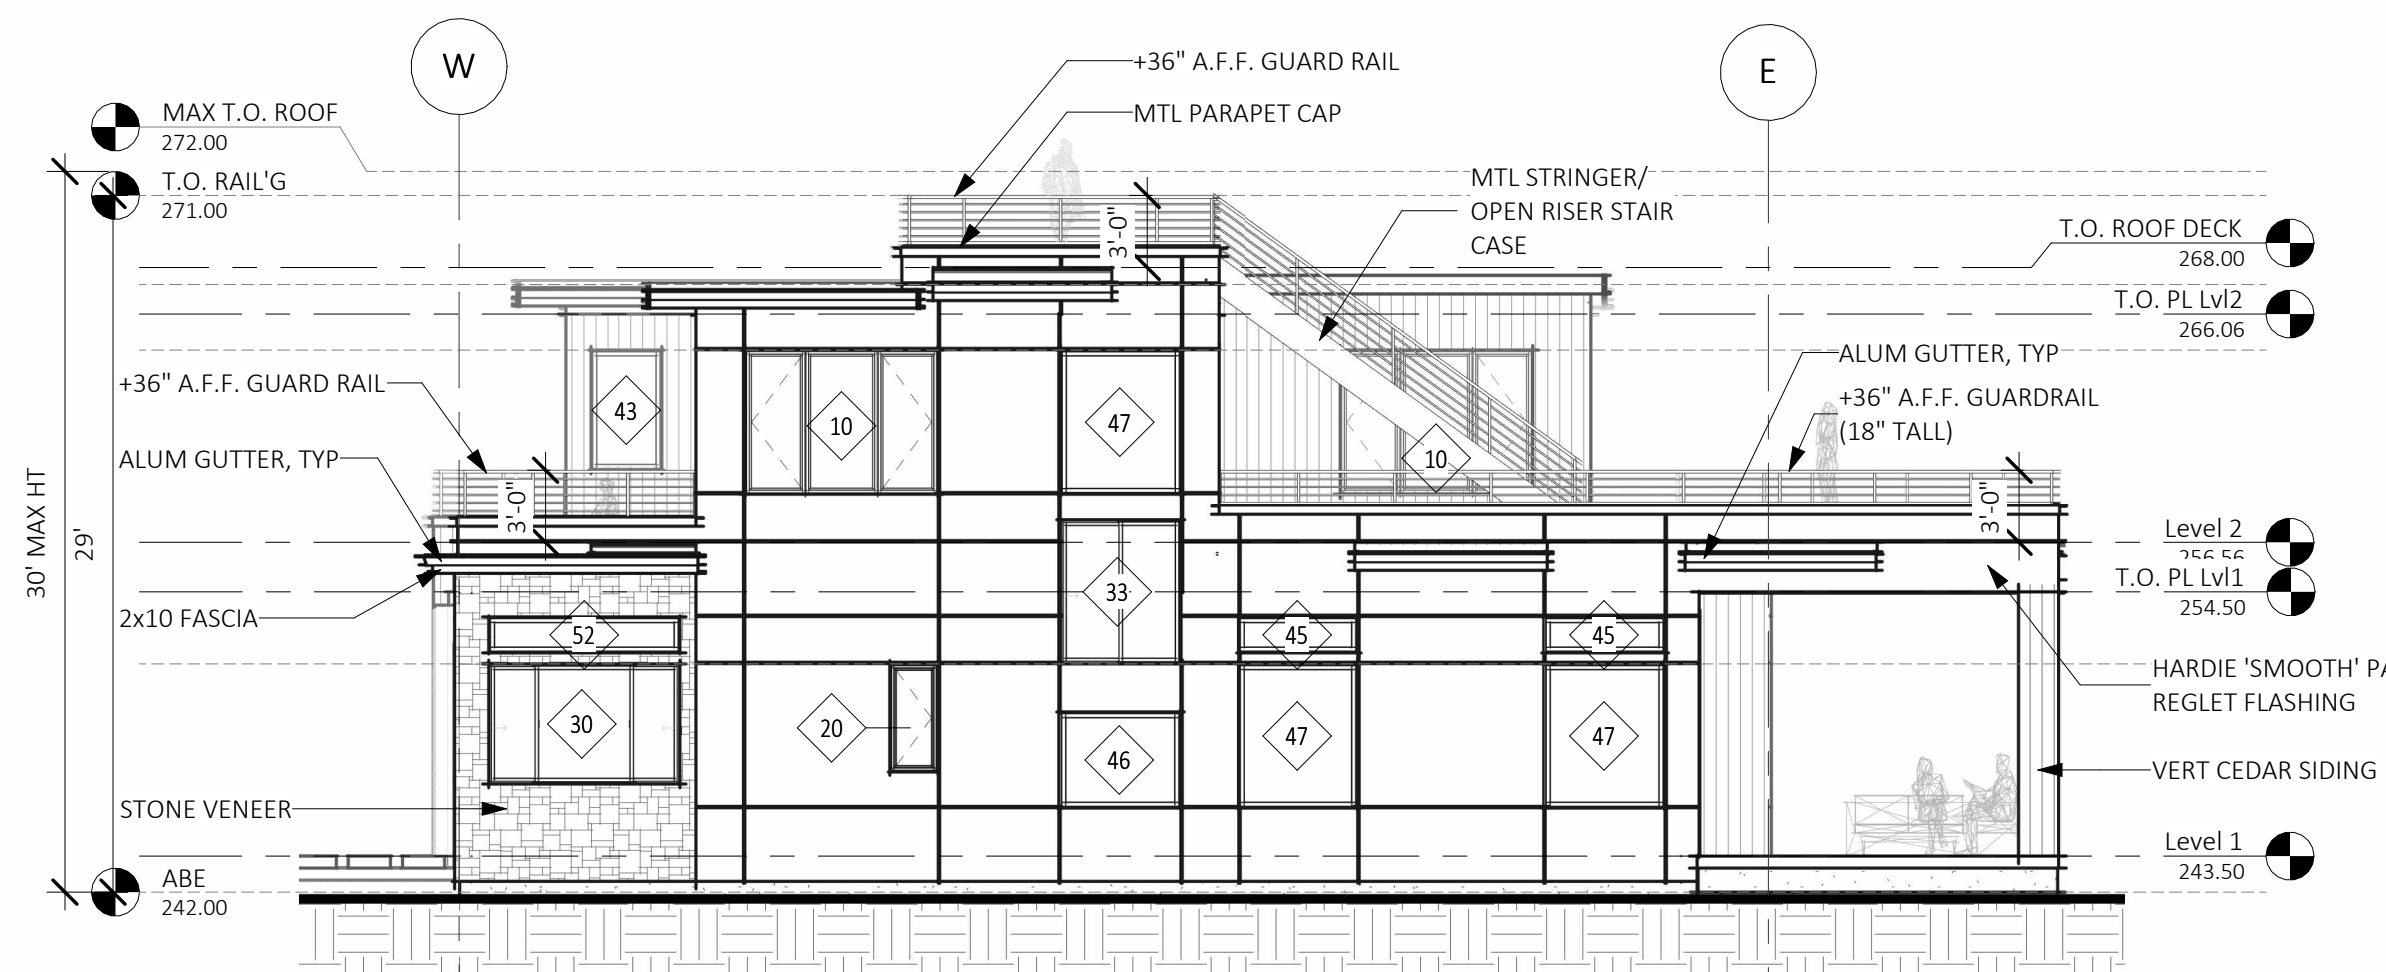

4 SOUTH ELEVATION
SCALE: 1/8" = 1'-0"

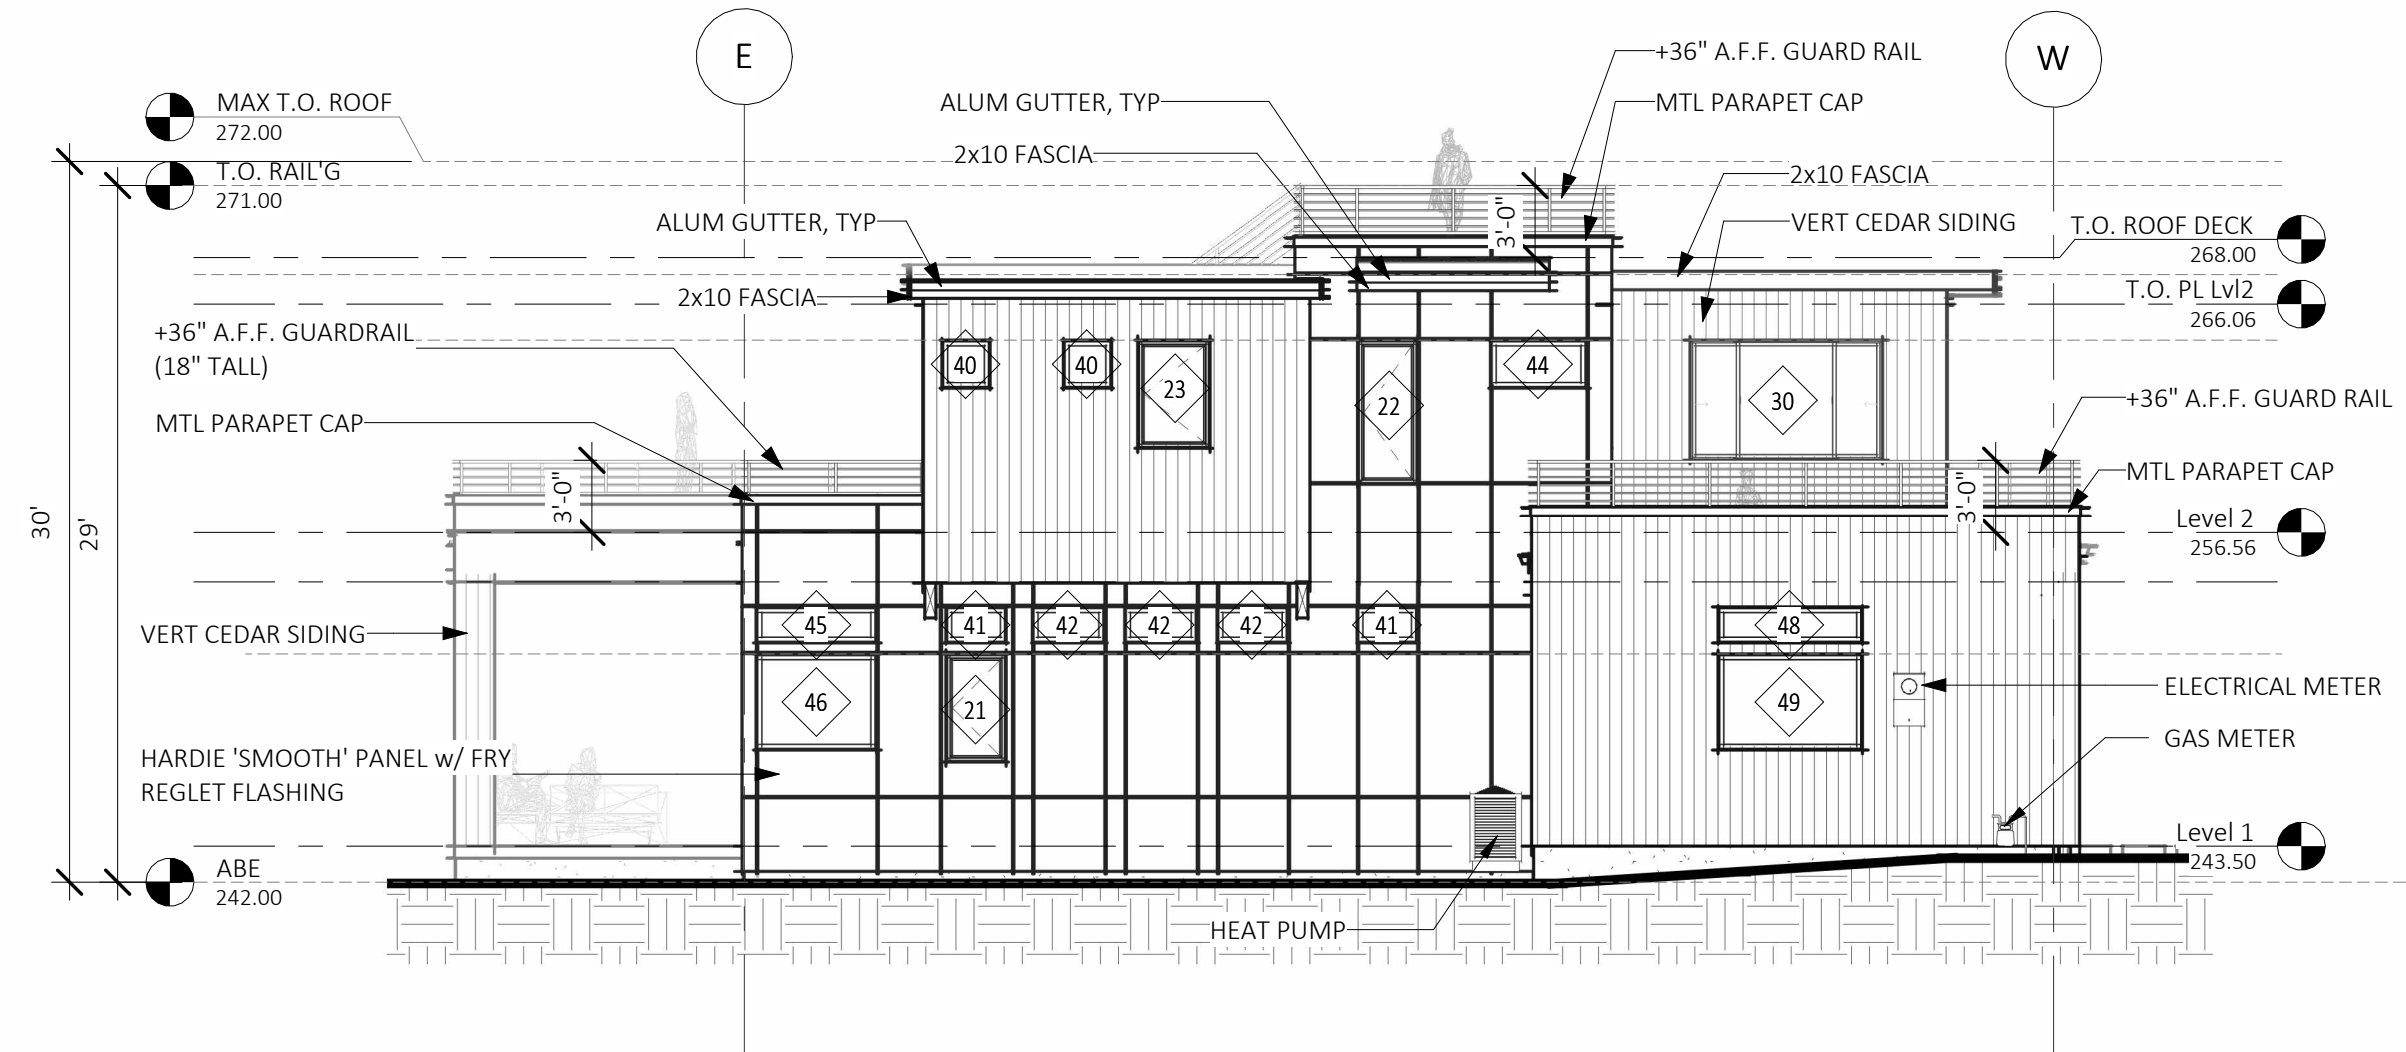

3 NORTH ELEVATION
SCALE: 1/8" = 1'-0"



1 WEST ELEVATION
SCALE: 1/4" = 1'-0"

TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING: TPO MEMBRANE
BUILDING PAPER: PER MFR
SHEATHING: PER SHEARWALL SCHEDULE
FRAMING: PER PLANS
INSULATION: R-38 VAULTED
SOFFIT: T&G WHERE NOTED
GWB: 5/8" GWB

FLOOR CONSTRUCTION

FLOORING: FINISH PER PLANS
SUBFLOOR: 3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
FRAMING: PER PLANS
INSULATION: R-38 BATT
SOFFIT: HARDIA PANEL WHERE NOTED

EXTERIOR WALL CONSTRUCTION

SIDING MATERIAL: PER ELEVATIONS
BUILDING PAPER: 15# BUILDING PAPER
SHEATHING: PER SHEARWALL SCHEDULE
FRAMING: 2x6 STUDS AT 16" oc U.N.O.
INSULATION: R-21 BATT w/ INTEGRAL VAPOR BARRIER
GWB: 1/2" GWB
TRIM
WINDOW: (WITH NO BRICK MOLD) 1/2" FLASHING
CORNER BOARDS: INSIDE: 2x2
OUTSIDE: 'X' FLASHING
FASCIA: 2x8 (PER DETAILS) U.N.O.

ELEVATION NOTES:

- INSTALL APPROVED CORROSION-RESISTANT FLASHING, TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS PER R708.3. SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH AAMA 711. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED CORROSION-RESISTANT FLASHINGS SHALL BE INSTALLED AT ALL OF THE FOLLOWING LOCATIONS:
 - EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE.
 - AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
 - UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
 - CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
 - WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
 - AT WALL AND ROOF INTERSECTIONS.
 - AT BUILT-IN GUTTERS.
- PER IRC R703.12.1, ADHERED MASONRY VENEER IS REQUIRED TO HAVE THE FOLLOWING CLEARANCES:
 - 4" MINIMUM ABOVE THE EARTH
 - 2" MINIMUM ABOVE PAVED AREAS, AND
 - 1/2" MINIMUM ABOVE EXTERIOR WALKING SURFACES WHICH ARE SUPPORTED BY THE SAME FOUNDATION THAT SUPPORTS THE EXTERIOR WALL.

Description No. Date

ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, WA 98059

HU RESIDENCE
2448 72nd AVE SE, Mercer Island

PERMIT SET


ELEVATIONS

PROJECT NO: 21014
ISSUE DATE: 2022/08/29
DRAWN BY: SPM


A601

SCALE 24X36: As indicated
*NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



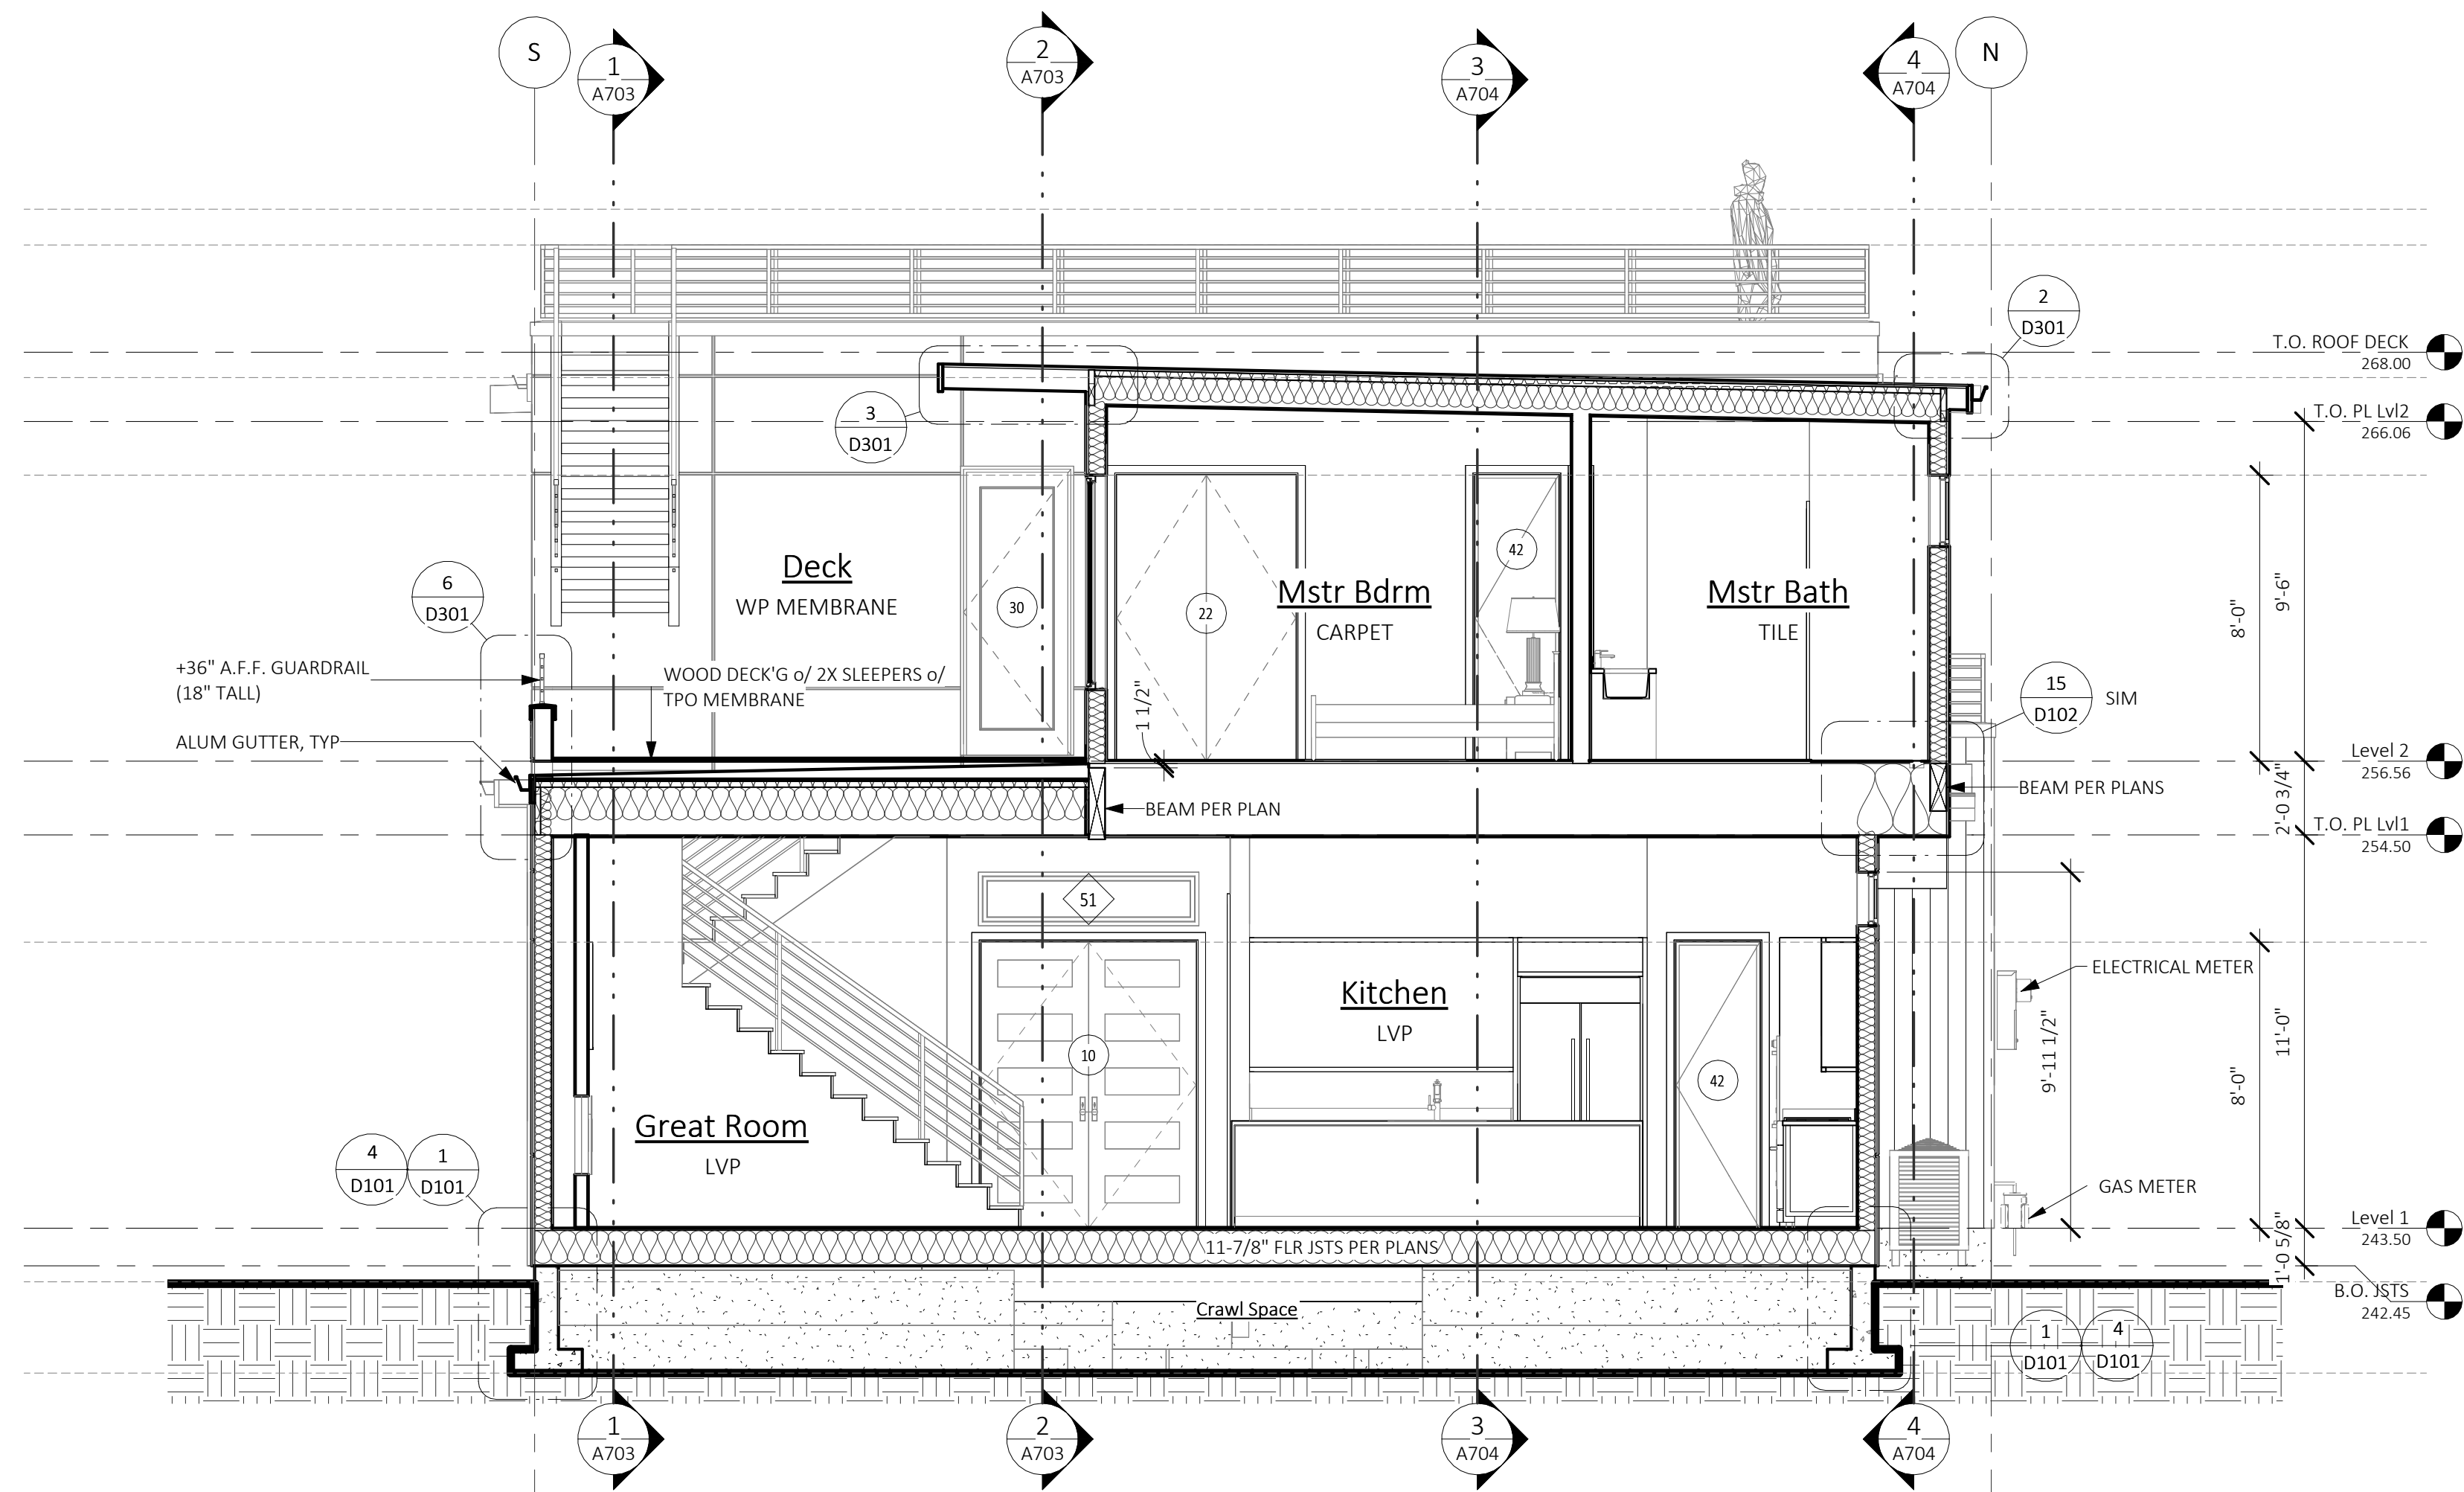

2 Section E/W 2
SCALE: 1/4" = 1'-0"

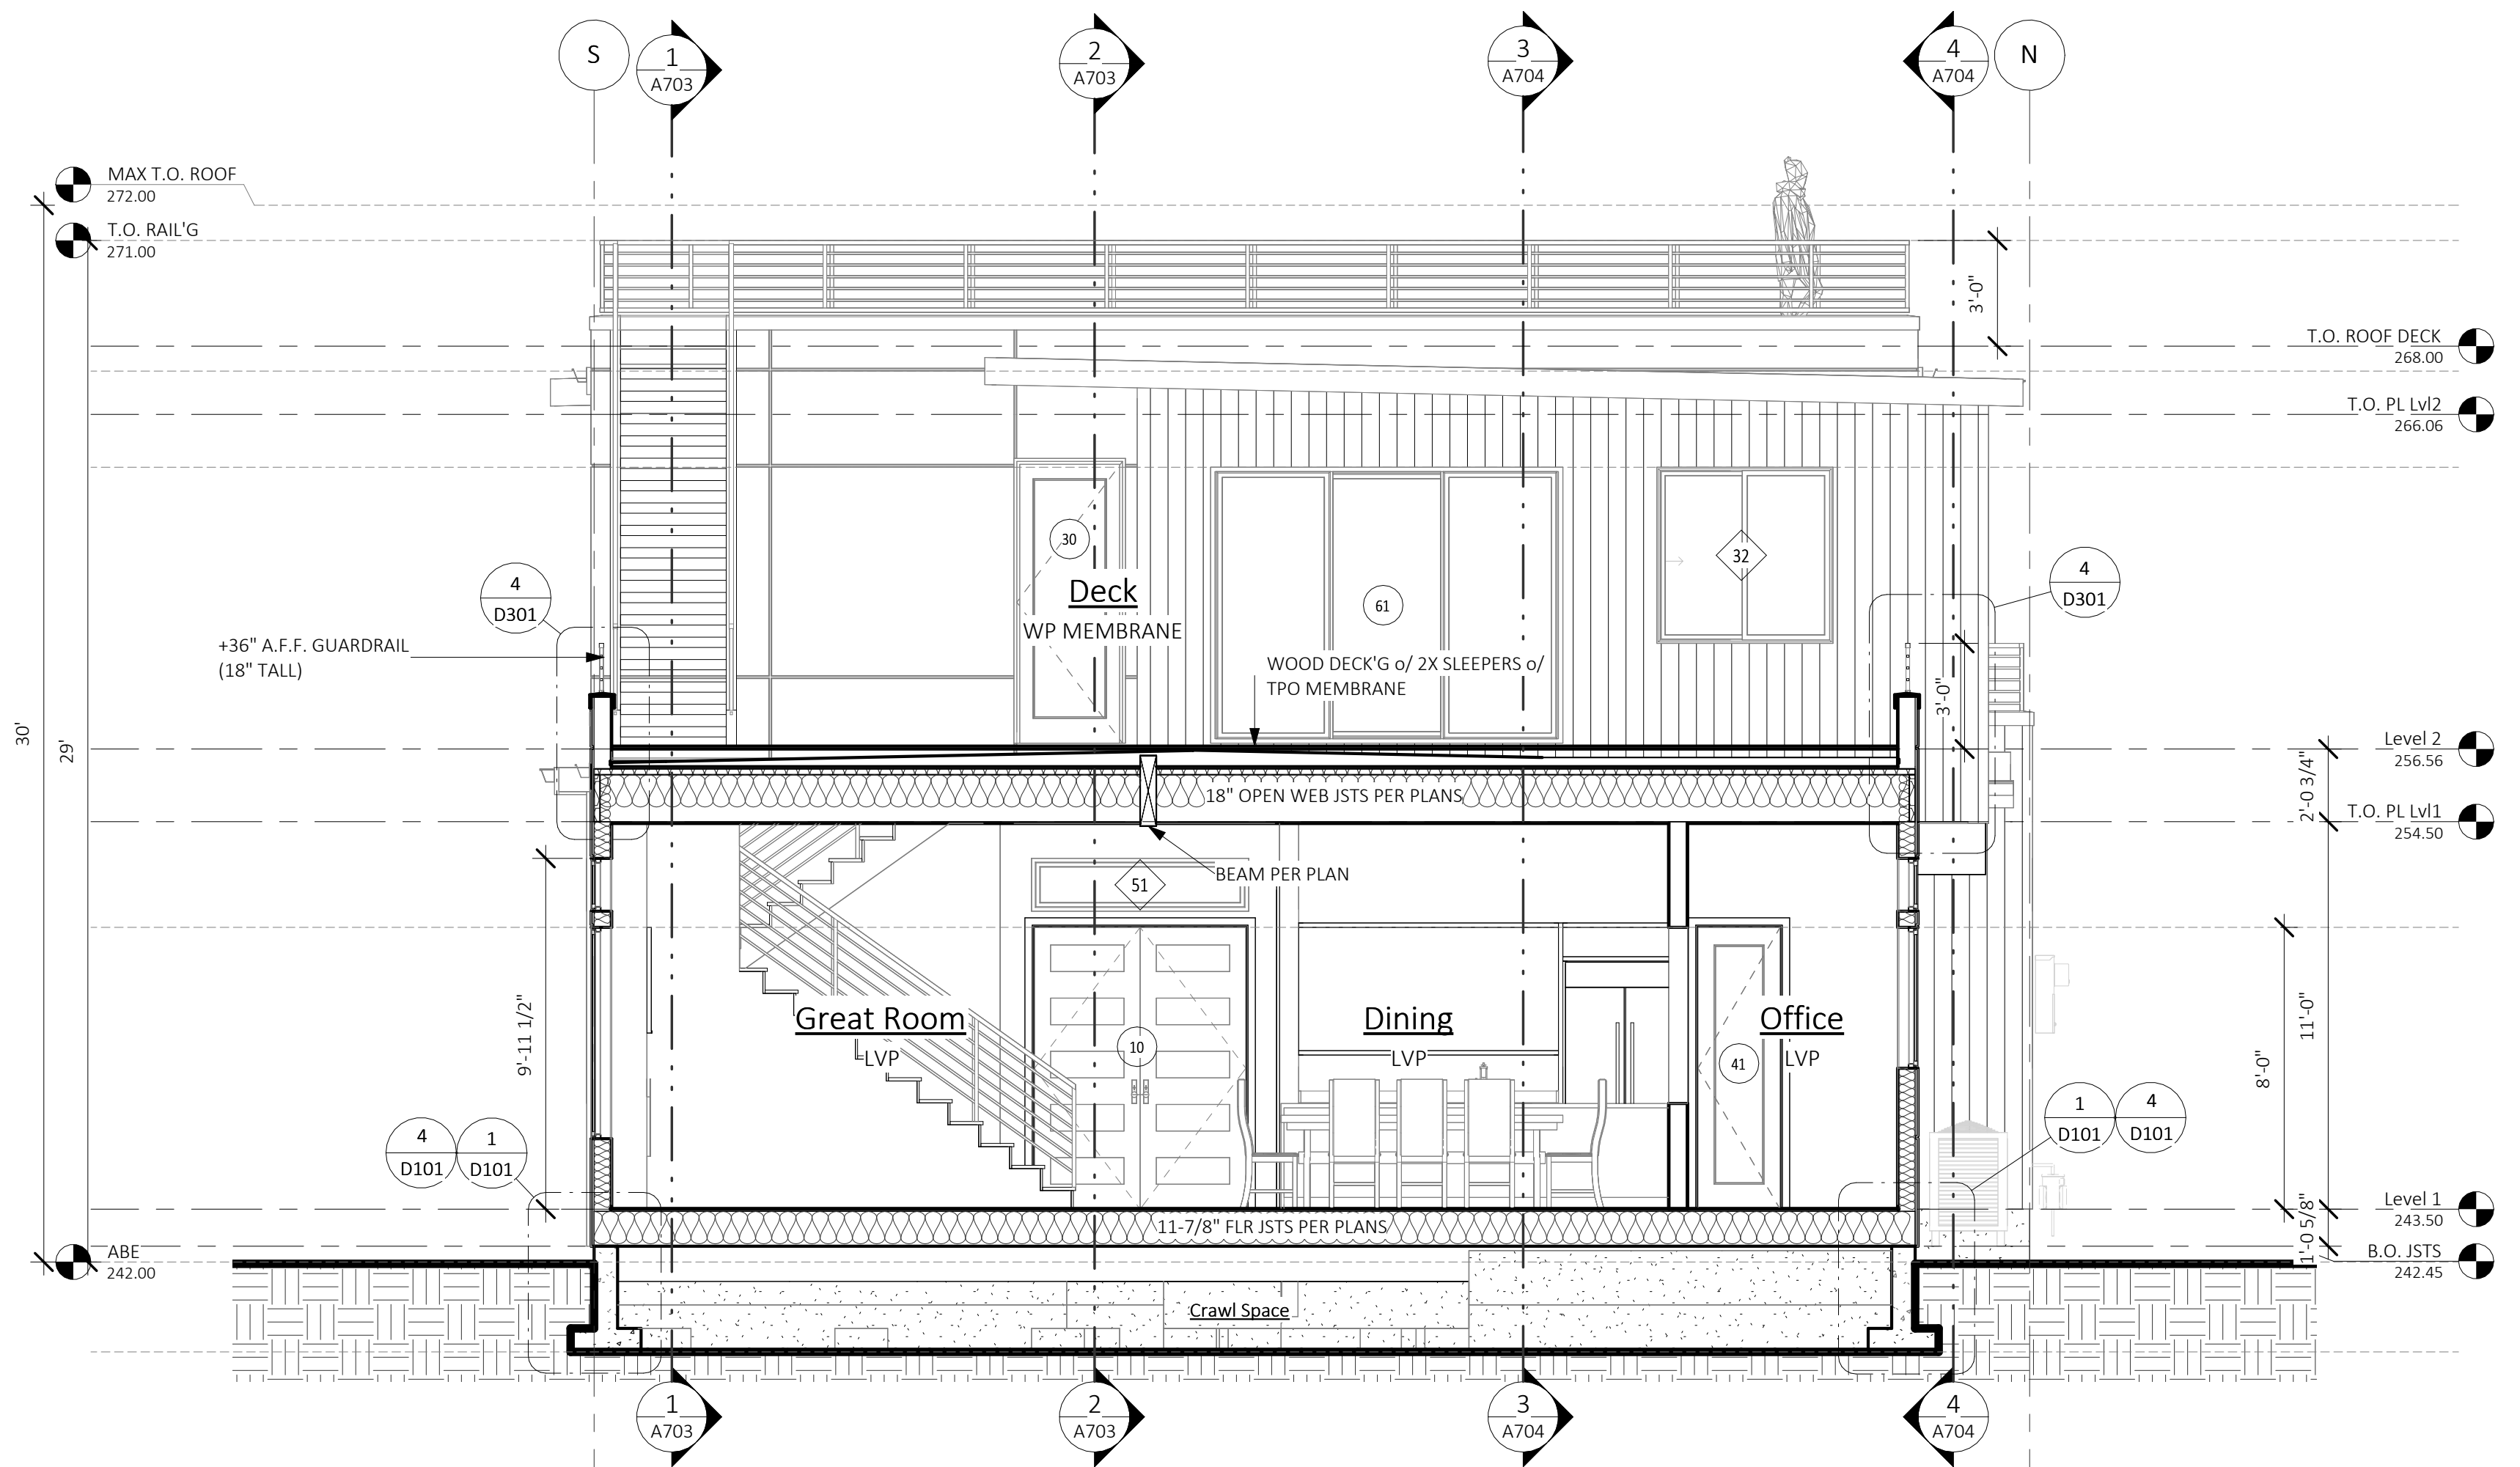

1 Section E/W 1
SCALE: 1/4" = 1'-0"

TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING:	TPO MEMBRANE
BUILDING PAPER:	PER MFR
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	PER PLANS
INSULATION:	R-38 VAULTED
SOFFIT:	T&G WHERE NOTED
GWBS:	5/8" GWB

FLOOR CONSTRUCTION

FLOORING:	FINISH PER PLANS
SUBFLOOR:	3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
FRAMING:	PER PLANS
INSULATION:	R-38 BATT
SOFFIT:	HARDIA PANEL WHERE NOTED

EXTERIOR WALL CONSTRUCTION

SIDING MATERIAL:	PER ELEVATIONS
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	2x6 STUDS AT 16" oc U.N.O.
INSULATION:	R-21 BATT w/ INTEGRAL VAPOR BARRIER
GWBS:	1/2" GWB
TRIM	
WINDOW:	'Z' FLASHING
(WITH NO BRICK MOLD)	
CORNER BOARDS:	INSIDE: 2x2 OUTSIDE: 'X' FLASHING
FASCIA:	2x8 (PER DETAILS) U.N.O.

Description

Date

No.

ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, WA 98059

HU RESIDENCE
2448 72nd AVE SE, Mercer Island

PERMIT SET

SECTIONS


PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

A701


SCALE 24X36: 1/4" = 1'-0"
*NOTE: 11X17 SETS ARE
REDUCED 50% SCALE
DRAWINGS ACCORDINGLY.

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.



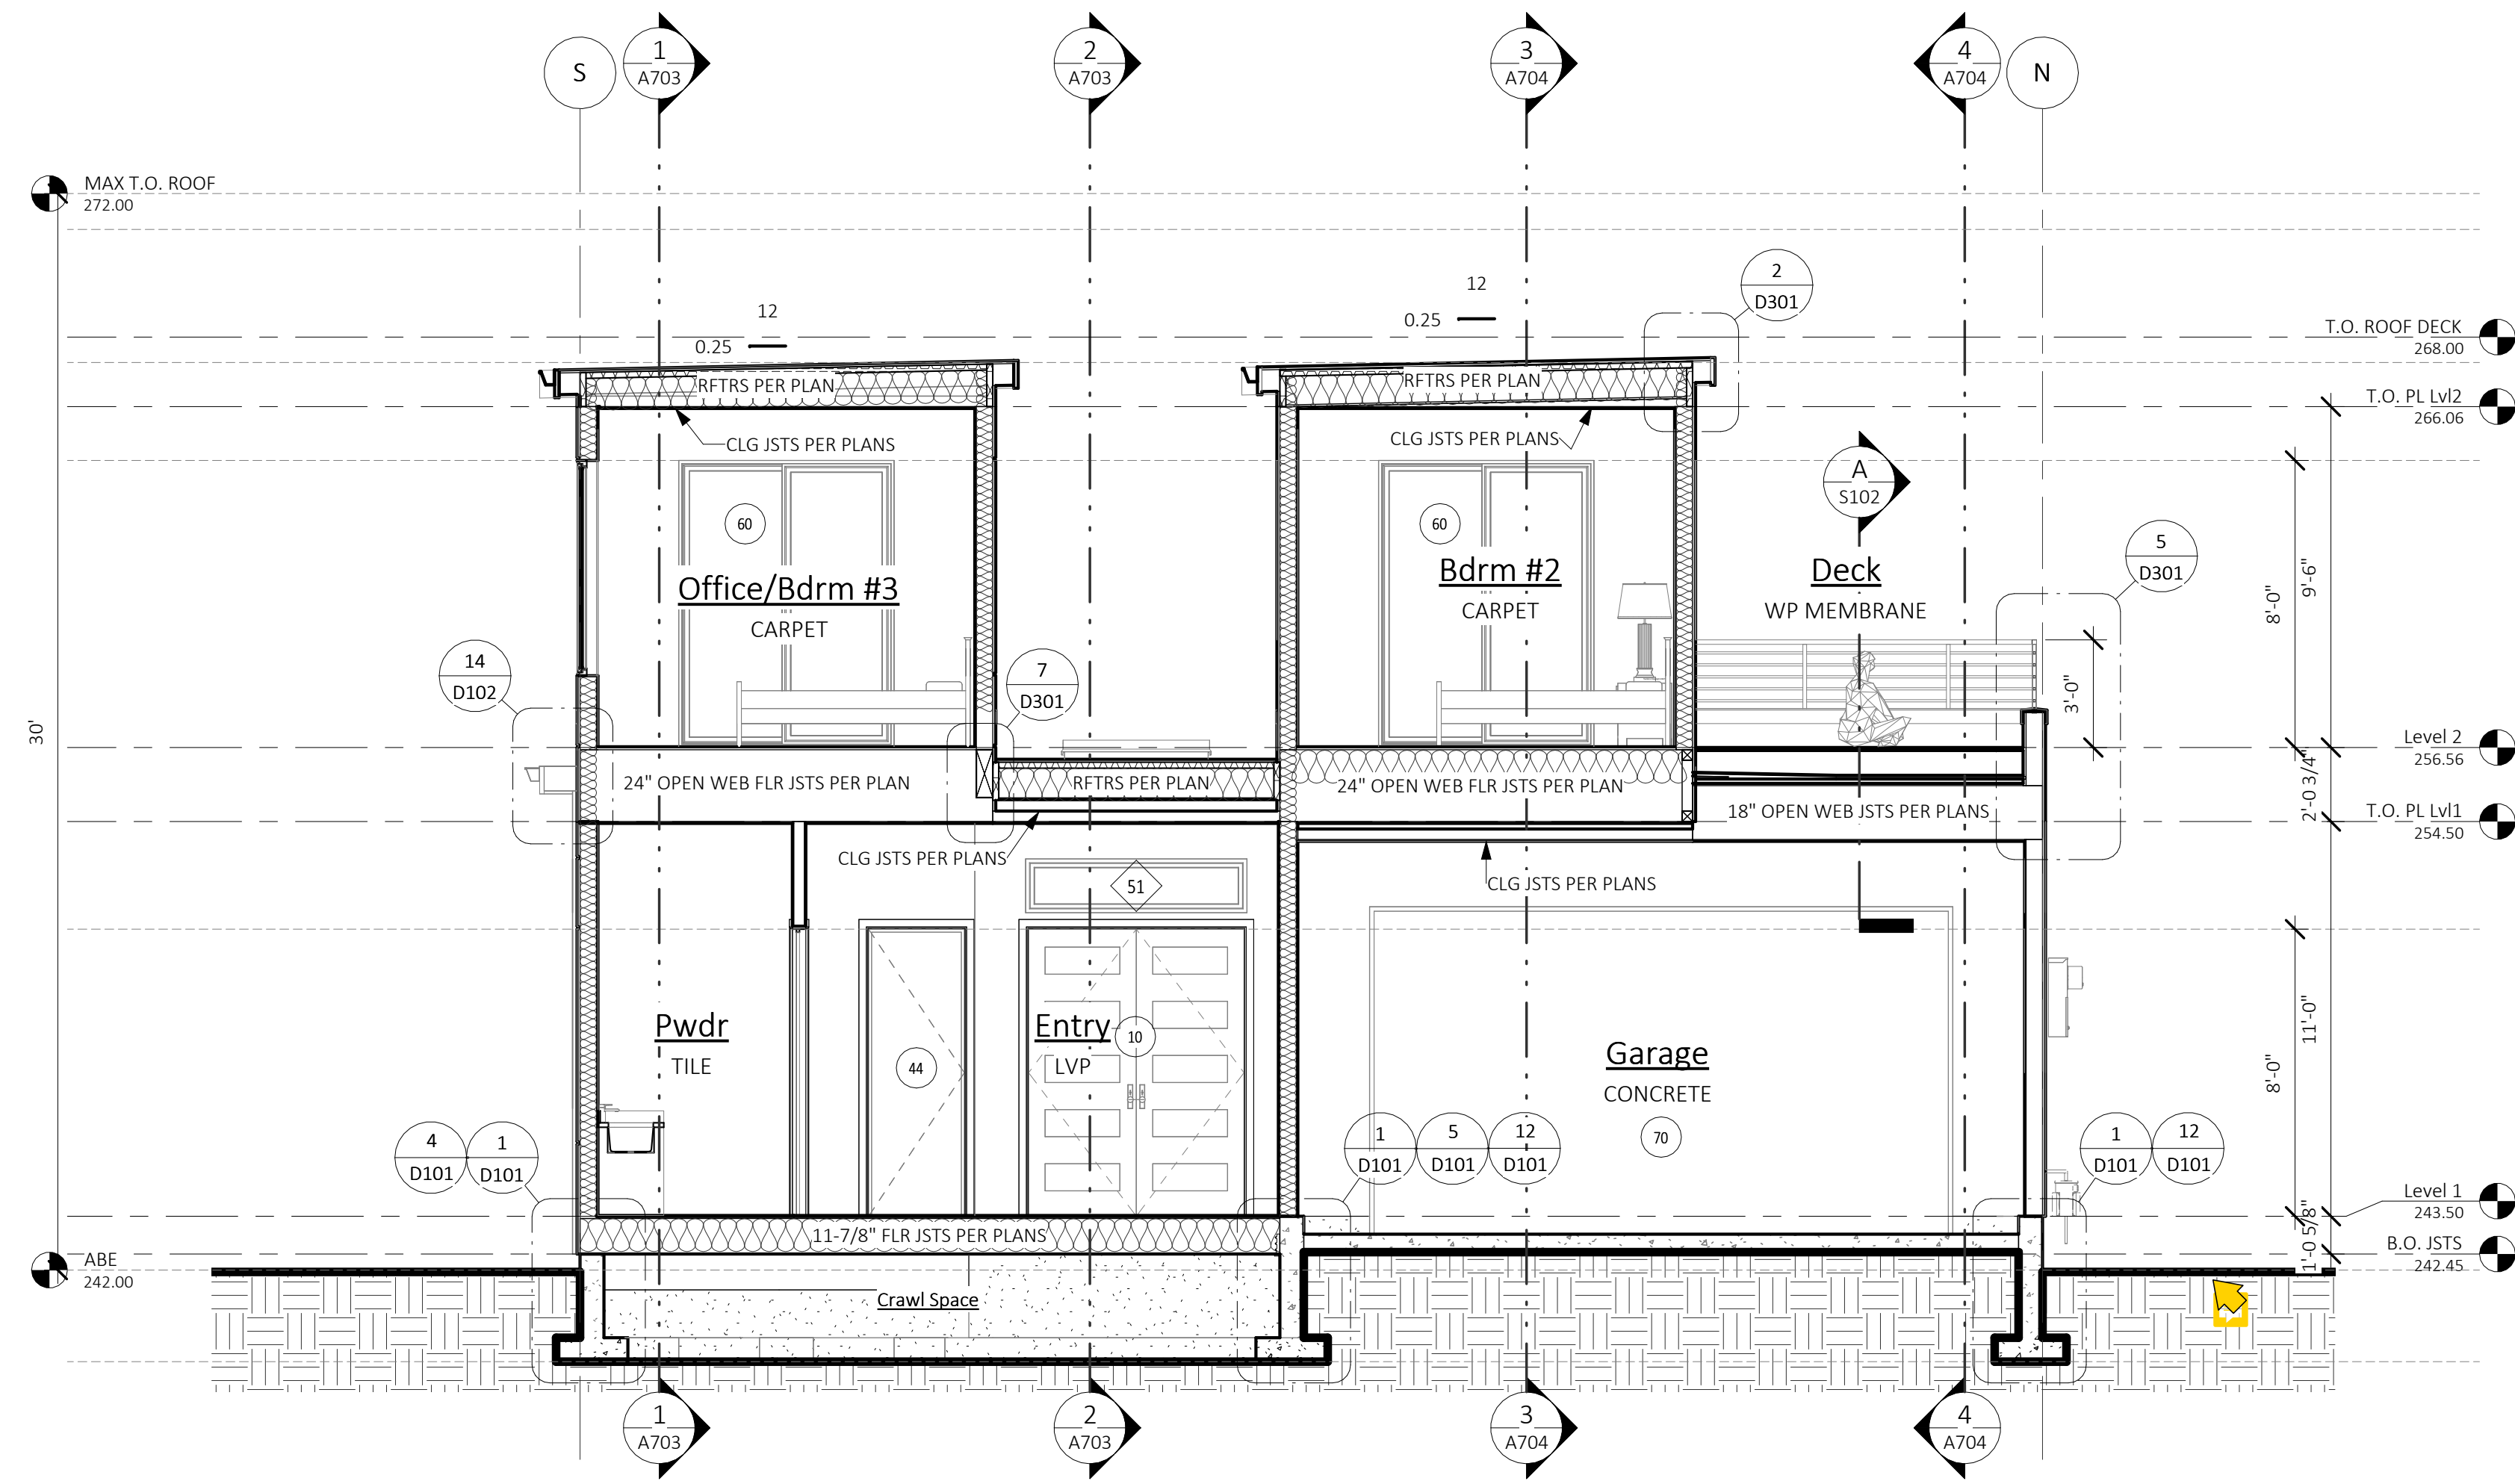

4 Section E/W 4
SCALE: 1/4" = 1'-0"

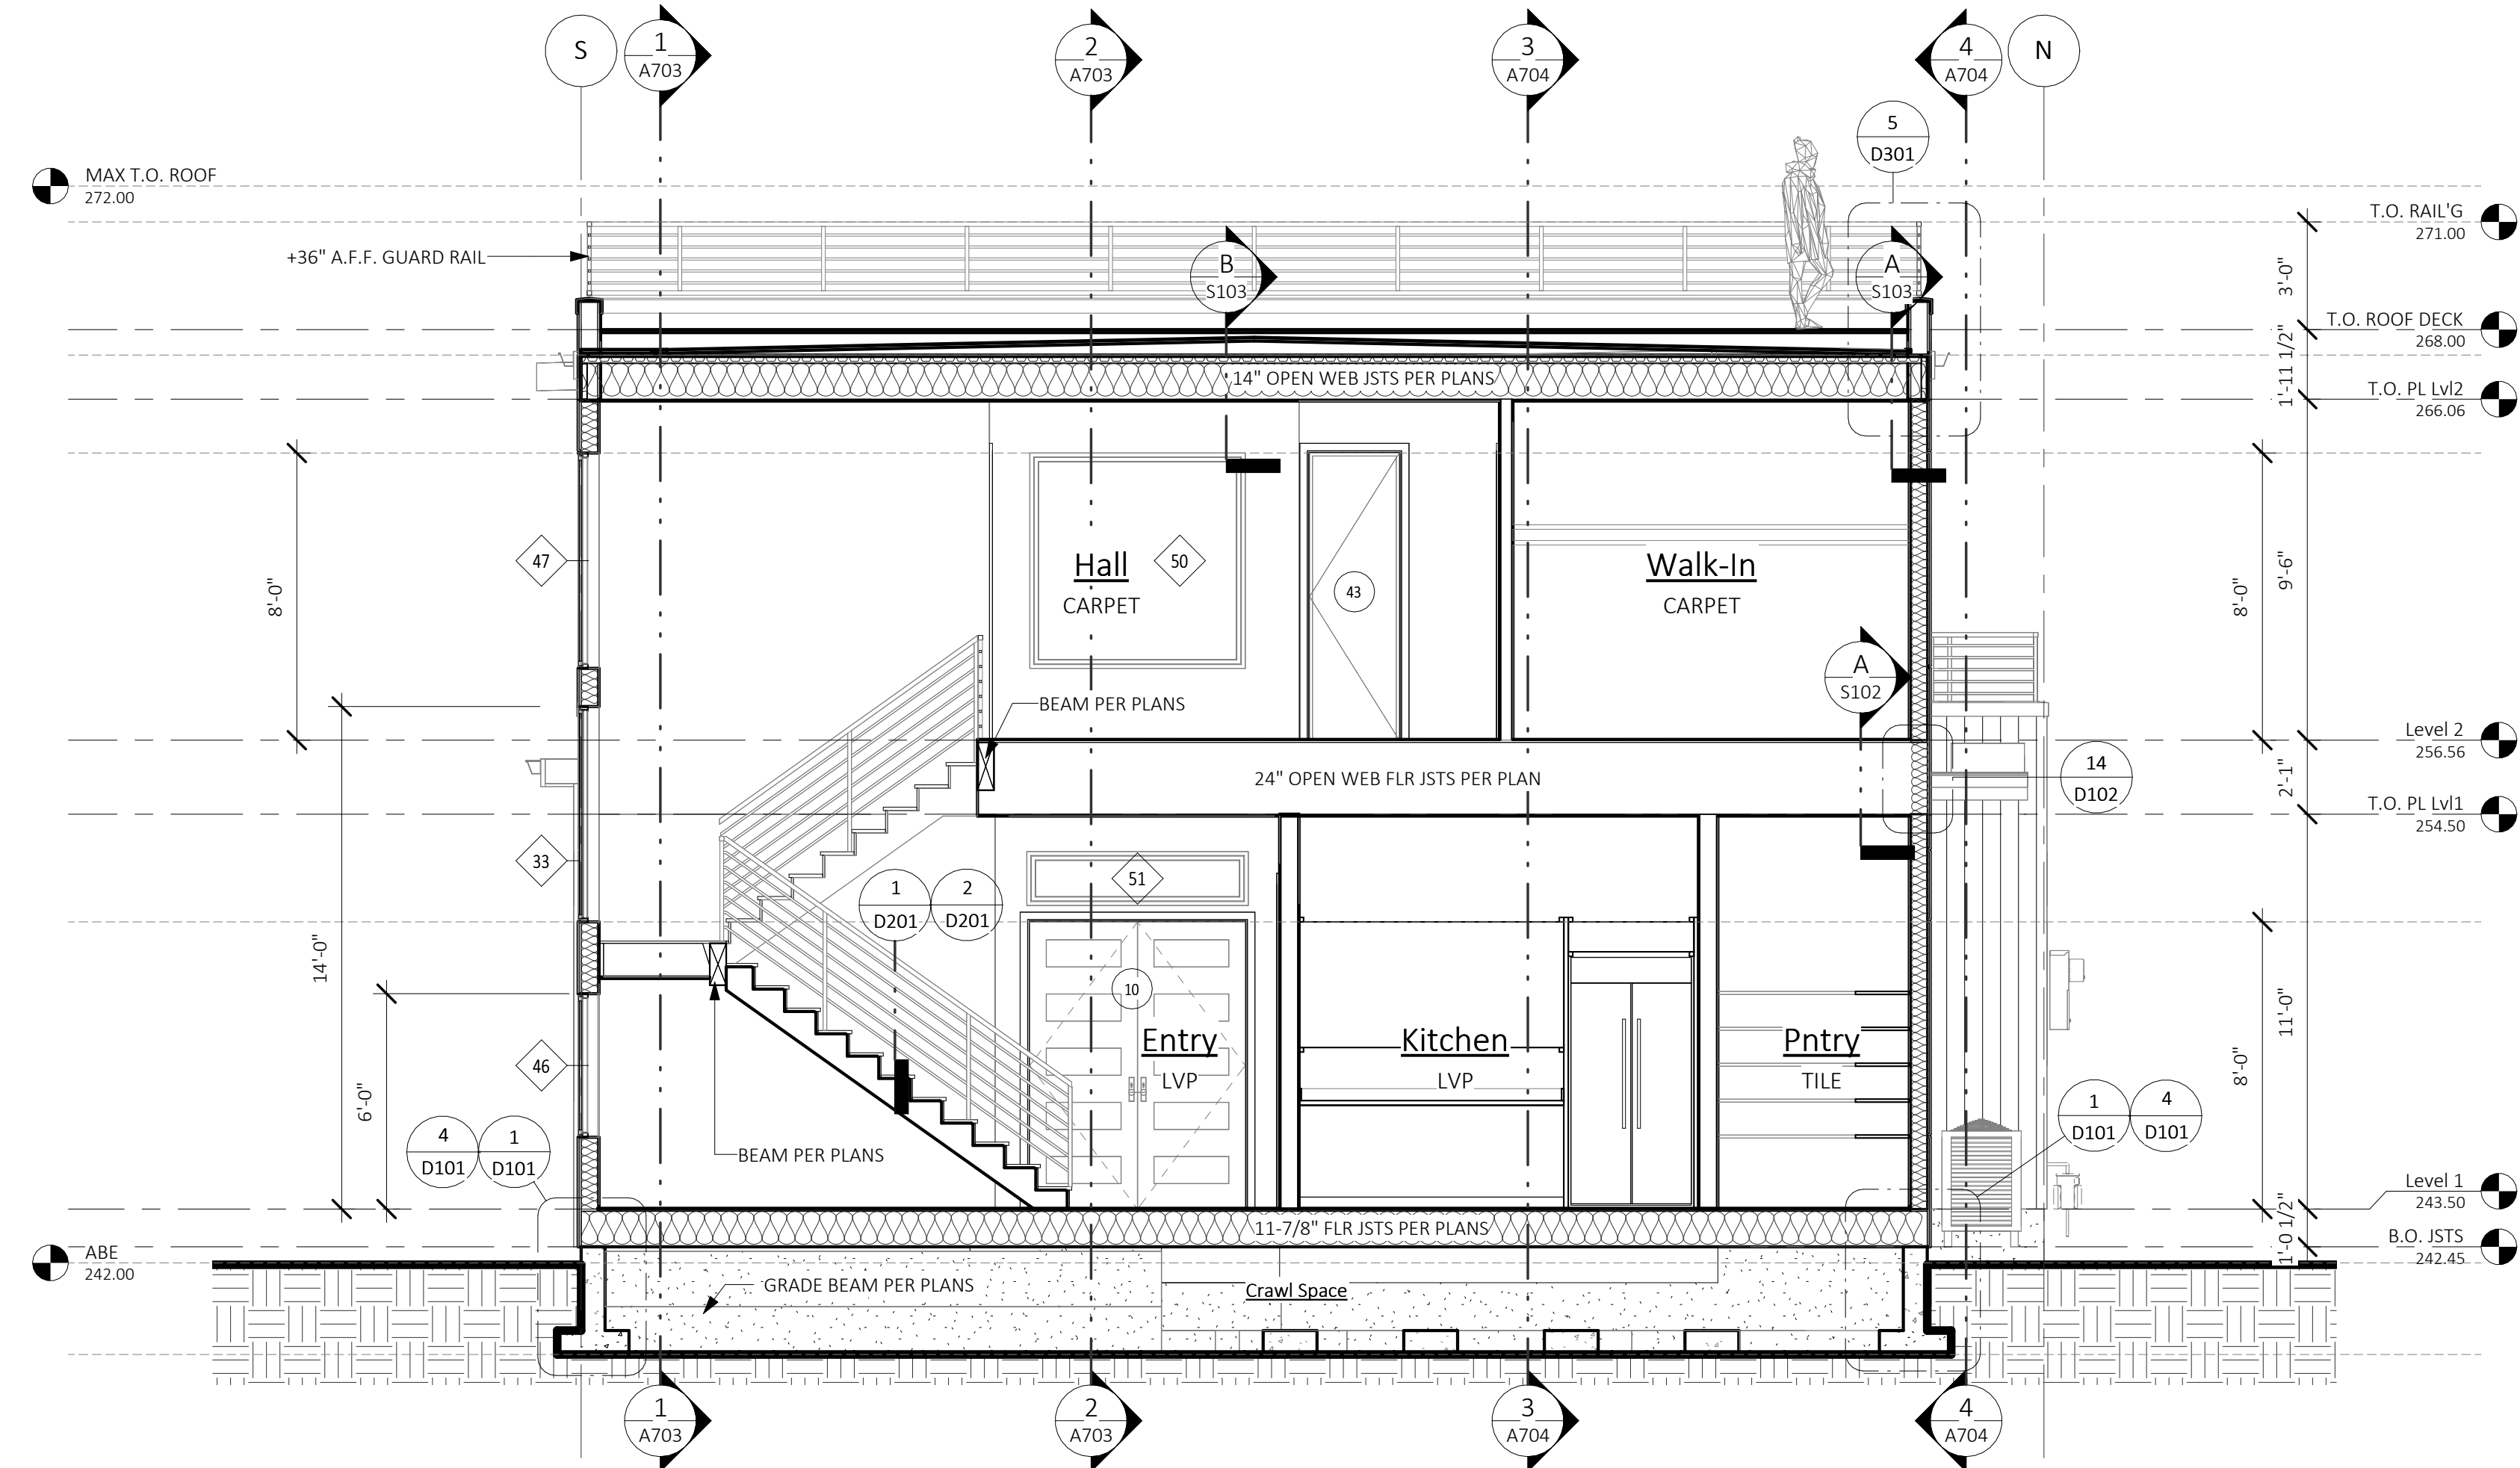

3 Section E/W 3
SCALE: 1/4" = 1'-0"

TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING:	TPO MEMBRANE
BUILDING PAPER:	PER MFR
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	PER PLANS
INSULATION:	R-38 VAULTED
SOFFIT:	T&G WHERE NOTED
GWB:	5/8" GWB

FLOOR CONSTRUCTION

FLOORING:	FINISH PER PLANS
SUBFLOOR:	3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
FRAMING:	PER PLANS
INSULATION:	R-38 BATT
SOFFIT:	HARDIA PANEL WHERE NOTED

EXTERIOR WALL CONSTRUCTION

SIDING MATERIAL:	PER ELEVATIONS
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	2x6 STUDS AT 16" oc U.N.O.
INSULATION:	R-21 BATT w/ INTEGRAL VAPOR BARRIER
GWB:	1/2" GWB

TRIM

WINDOW:	'Z' FLASHING
(WITH NO BRICK MOLD)	
CORNER BOARDS:	INSIDE: 2x2
	OUTSIDE: 'X' FLASHING
FASCIA:	2x8 (PER DETAILS) U.N.O.

Description

Date

No.



HU RESIDENCE
2448 72nd AVE SE, Mercer Island

PERMIT SET

SECTIONS

PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

A702

SCALE 24X36: 1/4" = 1'-0"
*NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

© ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.



TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING:	TPO MEMBRANE
BUILDING PAPER:	PER MFR
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	PER PLANS
INSULATION:	R-38 VAULTED
SOFFIT:	T&G WHERE NOTED
GWB:	5/8" GWB

FLOOR CONSTRUCTION


FLOORING:	FINISH PER PLANS
SUBFLOOR:	3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
FRAMING:	PER PLANS
INSULATION:	R-38 BATT
SOFFIT:	HARDIA PANEL WHERE NOTED

EXTERIOR WALL CONSTRUCTION


SIDING MATERIAL:	PER ELEVATIONS
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	2x6 STUDS AT 16" oc U.N.O.
INSULATION:	R-21 BATT w/ INTEGRAL VAPOR BARRIER
GWB:	1/2" GWB

TRIM

WINDOW:	'Z' FLASHING
(WITH NO BRICK MOLD)	
CORNER BOARDS:	INSIDE: 2x2
	OUTSIDE: 'X' FLASHING
FASCIA:	2x8 (PER DETAILS) U.N.O.

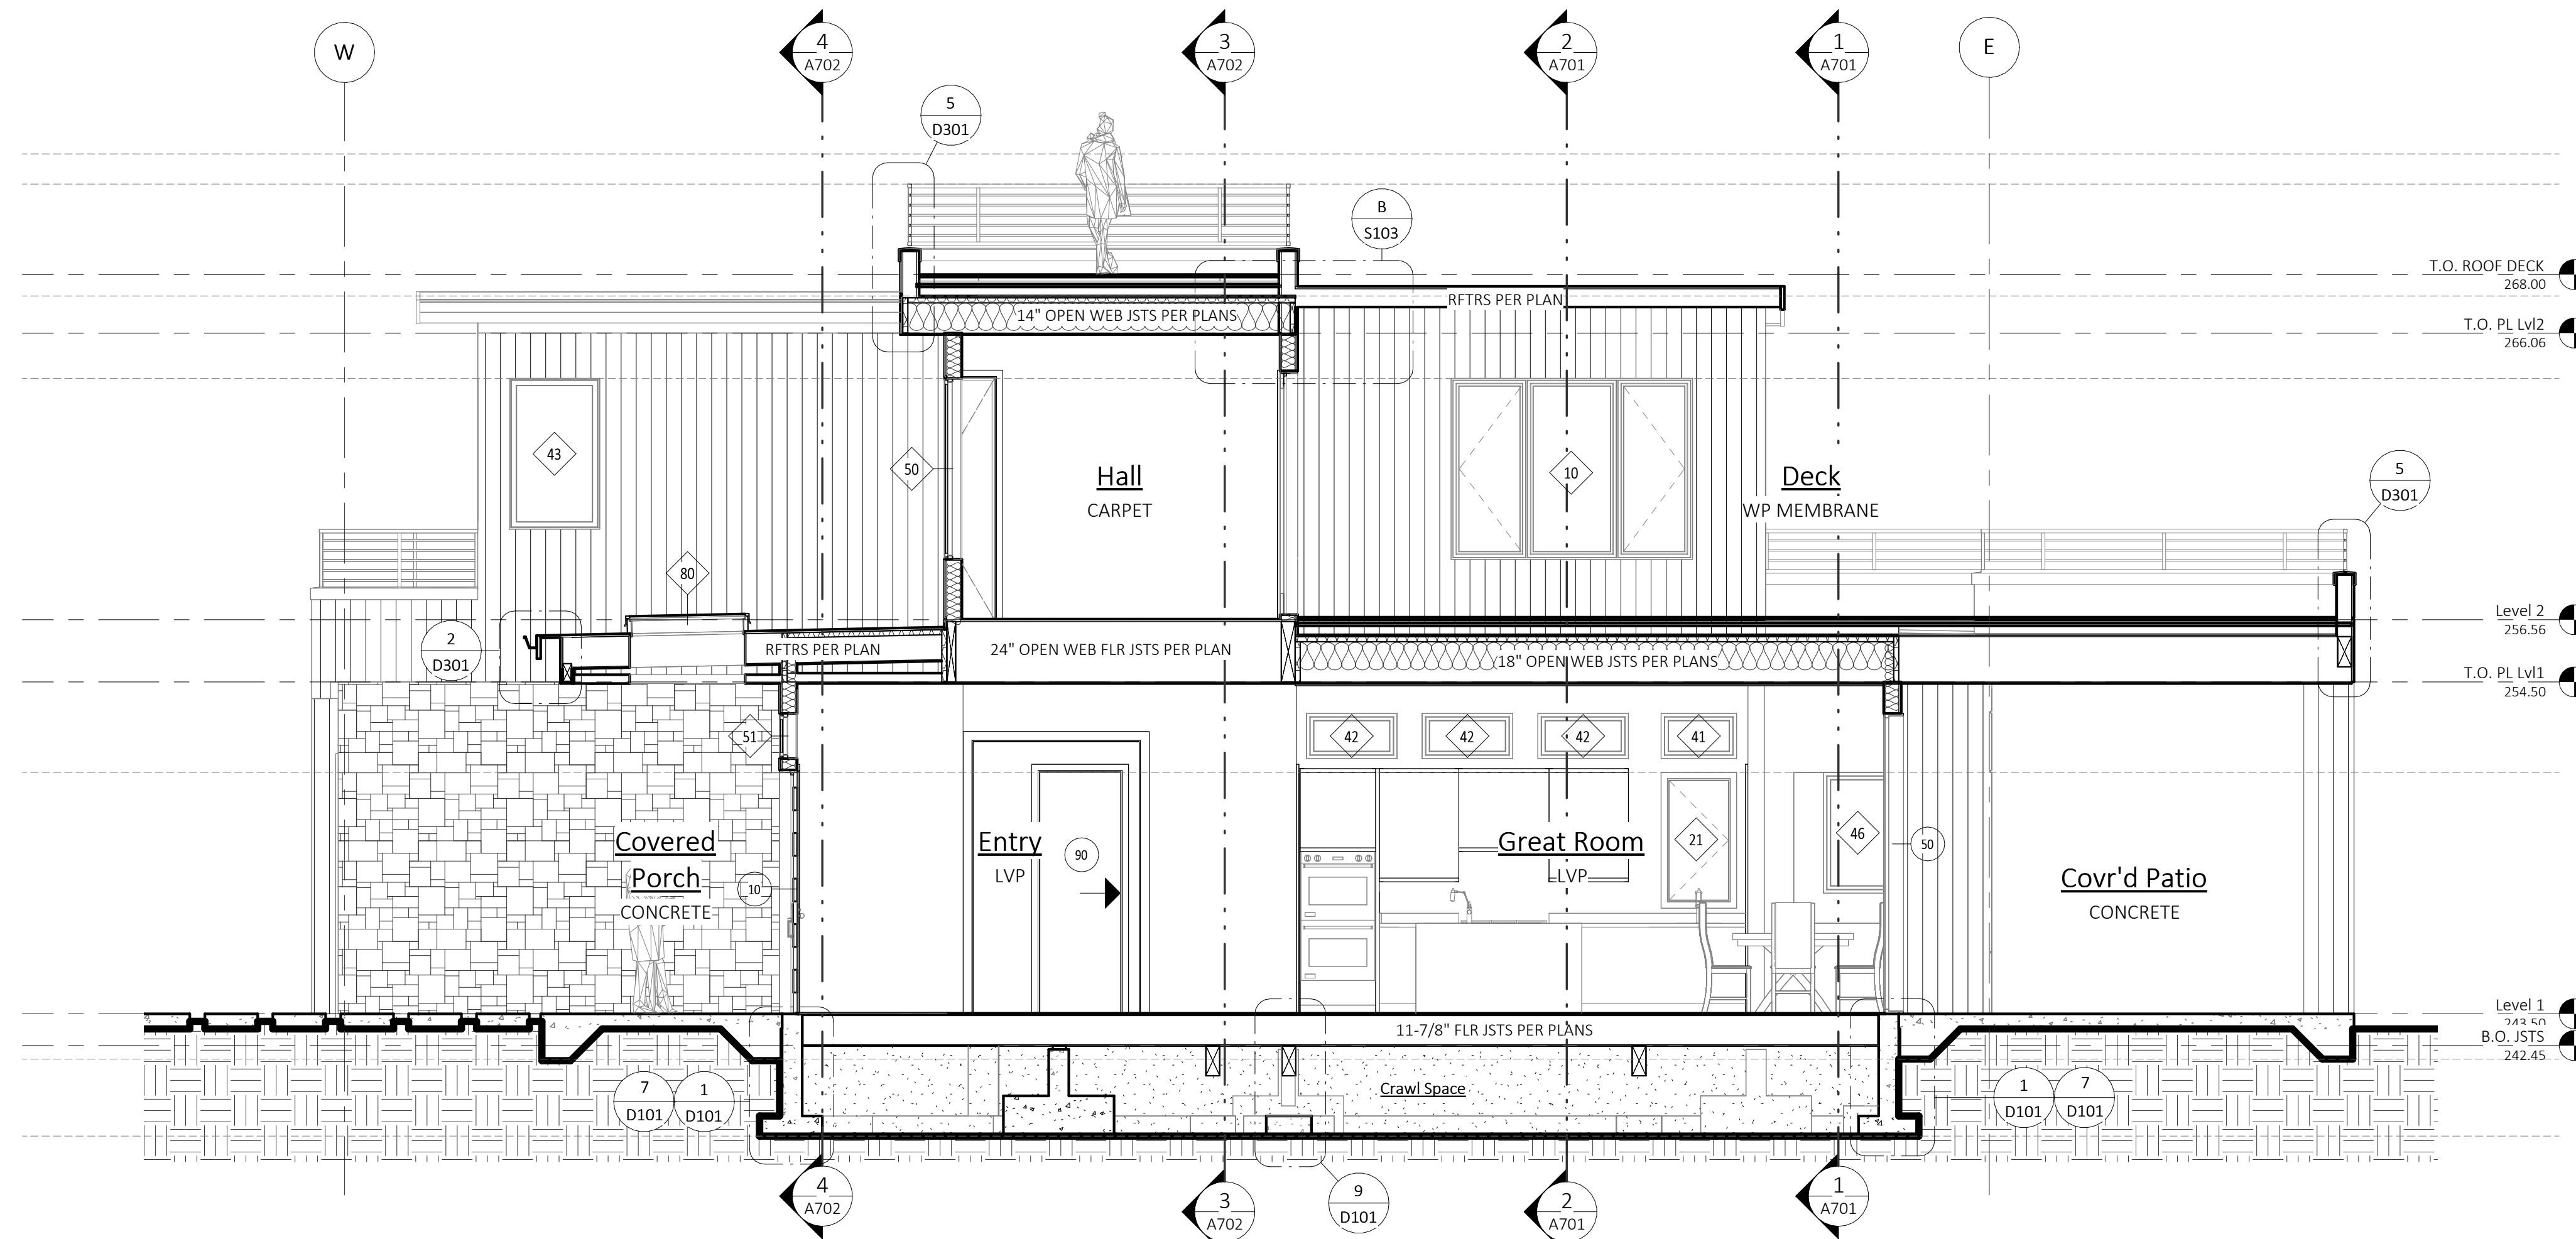

2 Section N/S 2
SCALE: 1/4" = 1'-0"

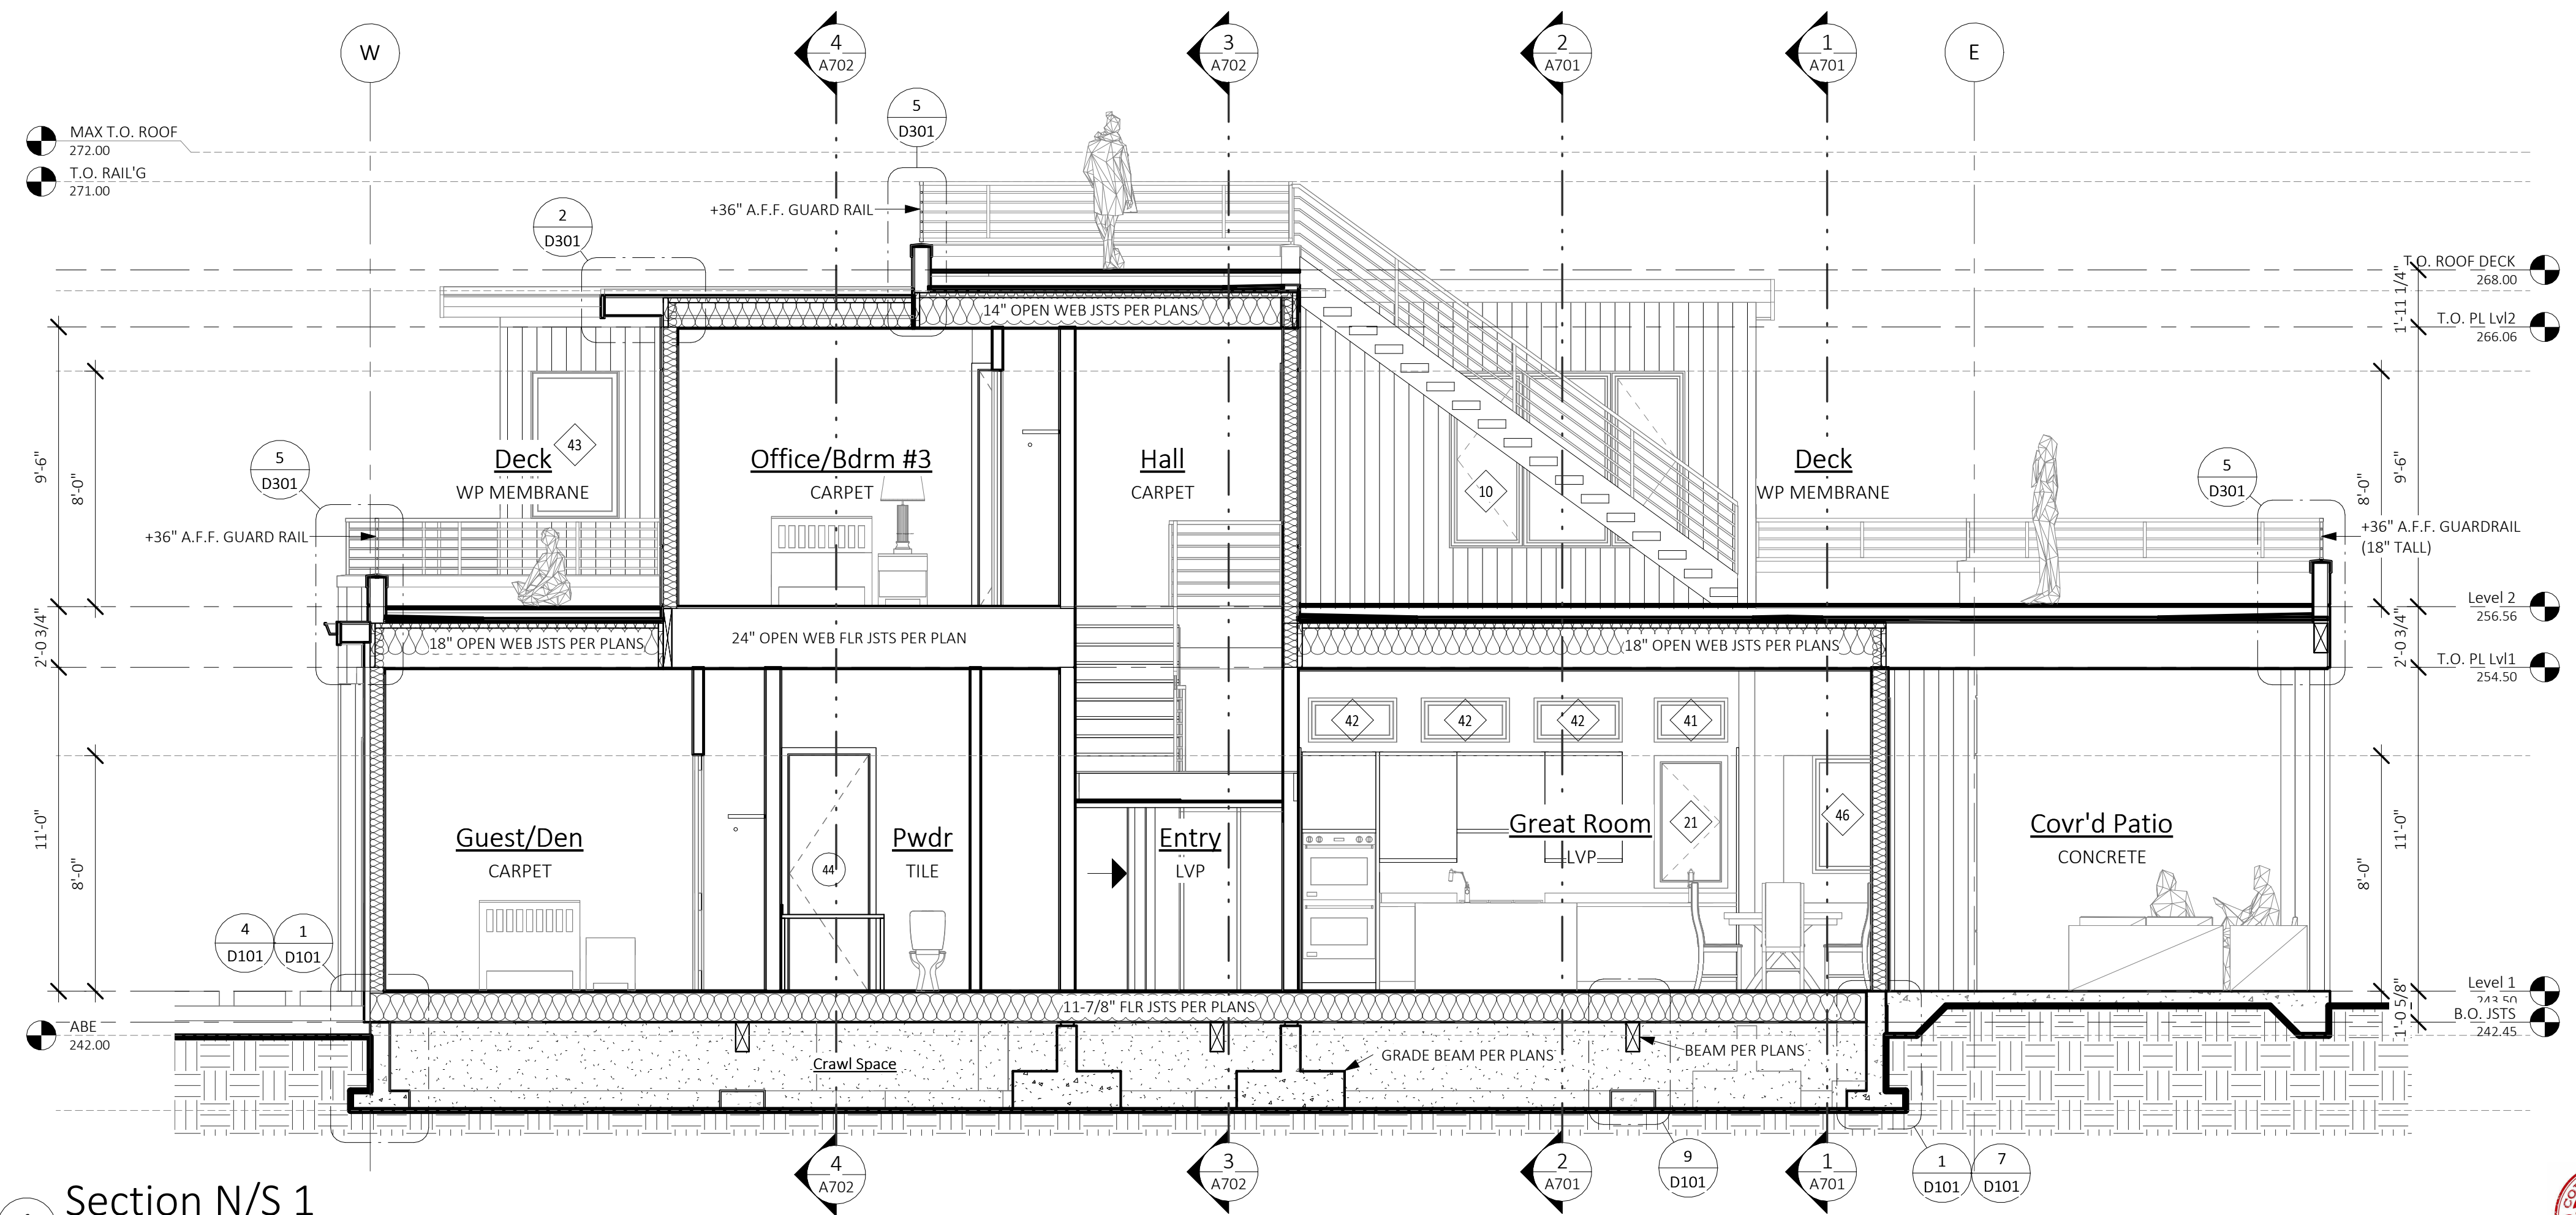

1 Section N/S 1
SCALE: 1/4" = 1'-0"

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

No.	Date	Description

ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, WA 98059

HU RESIDENCE
 2448 72nd AVE SE, Mercer Island

PROJECT NO:	21014
ISSUE DATE:	2022/08/29
DRAWN BY:	SPM

A703
 SCALE 24X36: 1/4" = 1'-0"
 *NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

6/27/2022 10:04:11 AM Autodesk Docs://21014 Hu Residence, Mercer Island/21014_05CD_Hu Residence, Mercer Island.rvt



TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING: TPO MEMBRANE
 BUILDING PAPER: PER MFR
 SHEATHING: PER SHEARWALL SCHEDULE
 FRAMING: PER PLANS
 INSULATION: R-38 VAULTED
 SOFFIT: T&G WHERE NOTED
 GWB: 5/8" GWB

FLOOR CONSTRUCTION


FLOORING: FINISH PER PLANS
 SUBFLOOR: 3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
 FRAMING: PER PLANS
 INSULATION: R-38 BATT
 SOFFIT: HARDIA PANEL WHERE NOTED

EXTERIOR WALL CONSTRUCTION


SIDING MATERIAL: PER ELEVATIONS
 BUILDING PAPER: 15# BUILDING PAPER
 SHEATHING: PER SHEARWALL SCHEDULE
 FRAMING: 2x6 STUDS AT 16" oc U.N.O.
 INSULATION: R-21 BATT w/ INTEGRAL VAPOR BARRIER
 GWB: 1/2" GWB

TRIM

WINDOW: (WITH NO BRICK MOLD) 'Z' FLASHING
 CORNER BOARDS: INSIDE: 2x2
 OUTSIDE: 'X' FLASHING
 FASCIA: 2x8 (PER DETAILS) U.N.O.

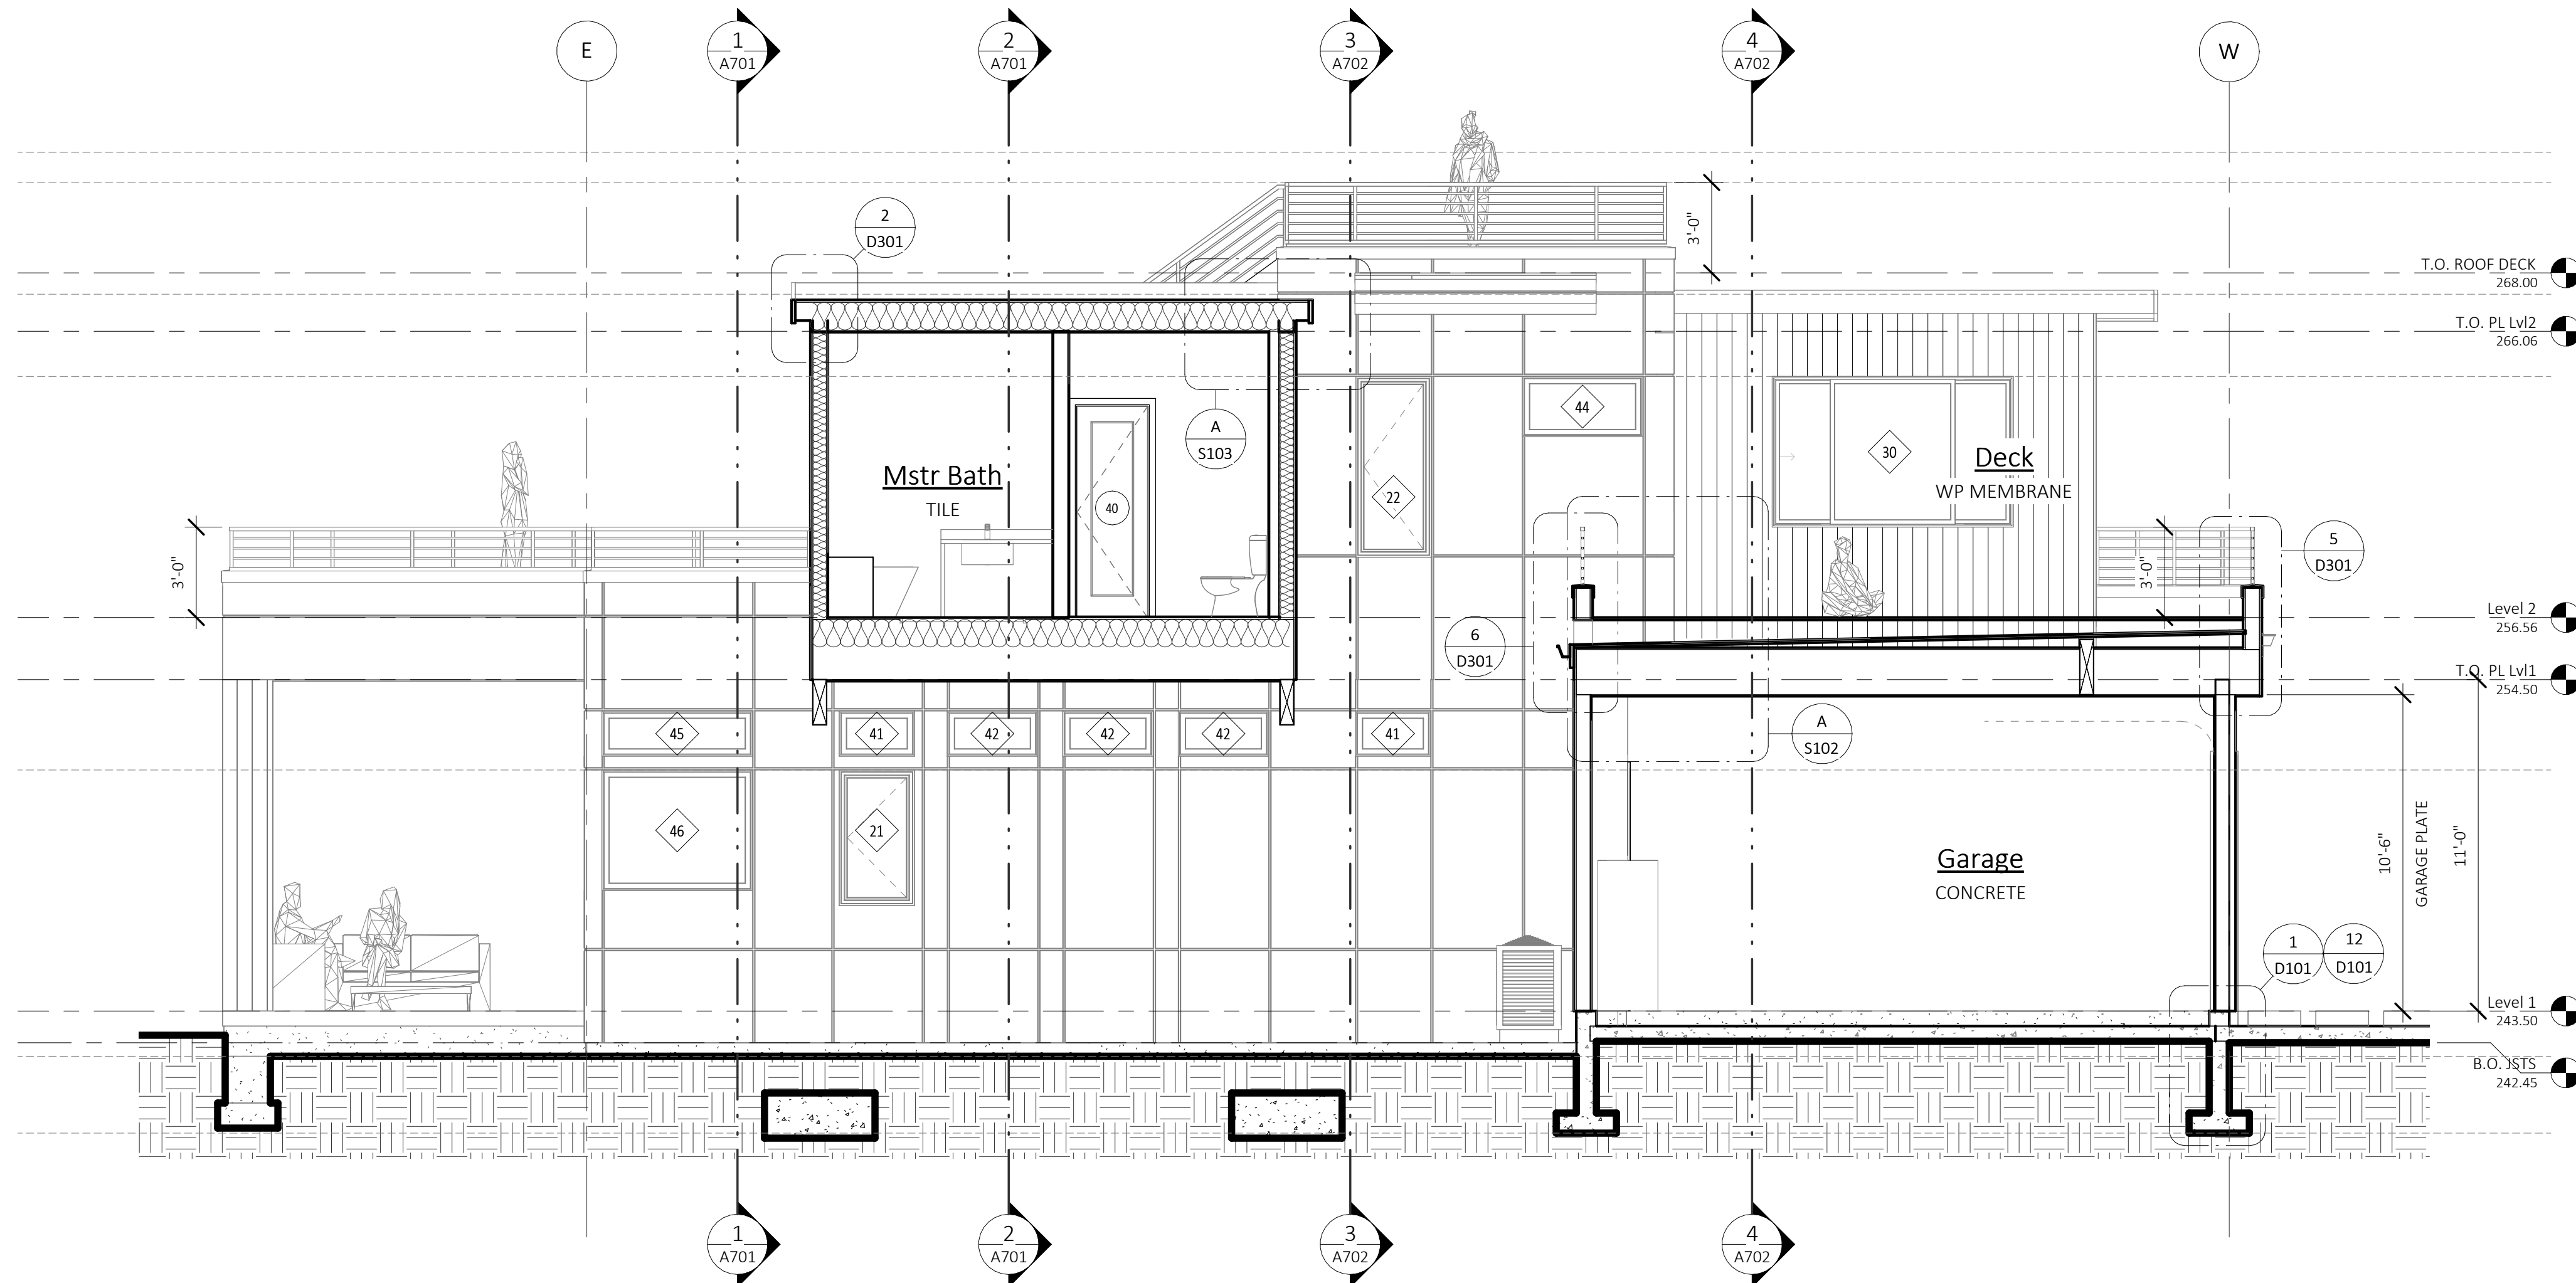

4 Section N/S 4
 SCALE: 1/4" = 1'-0"

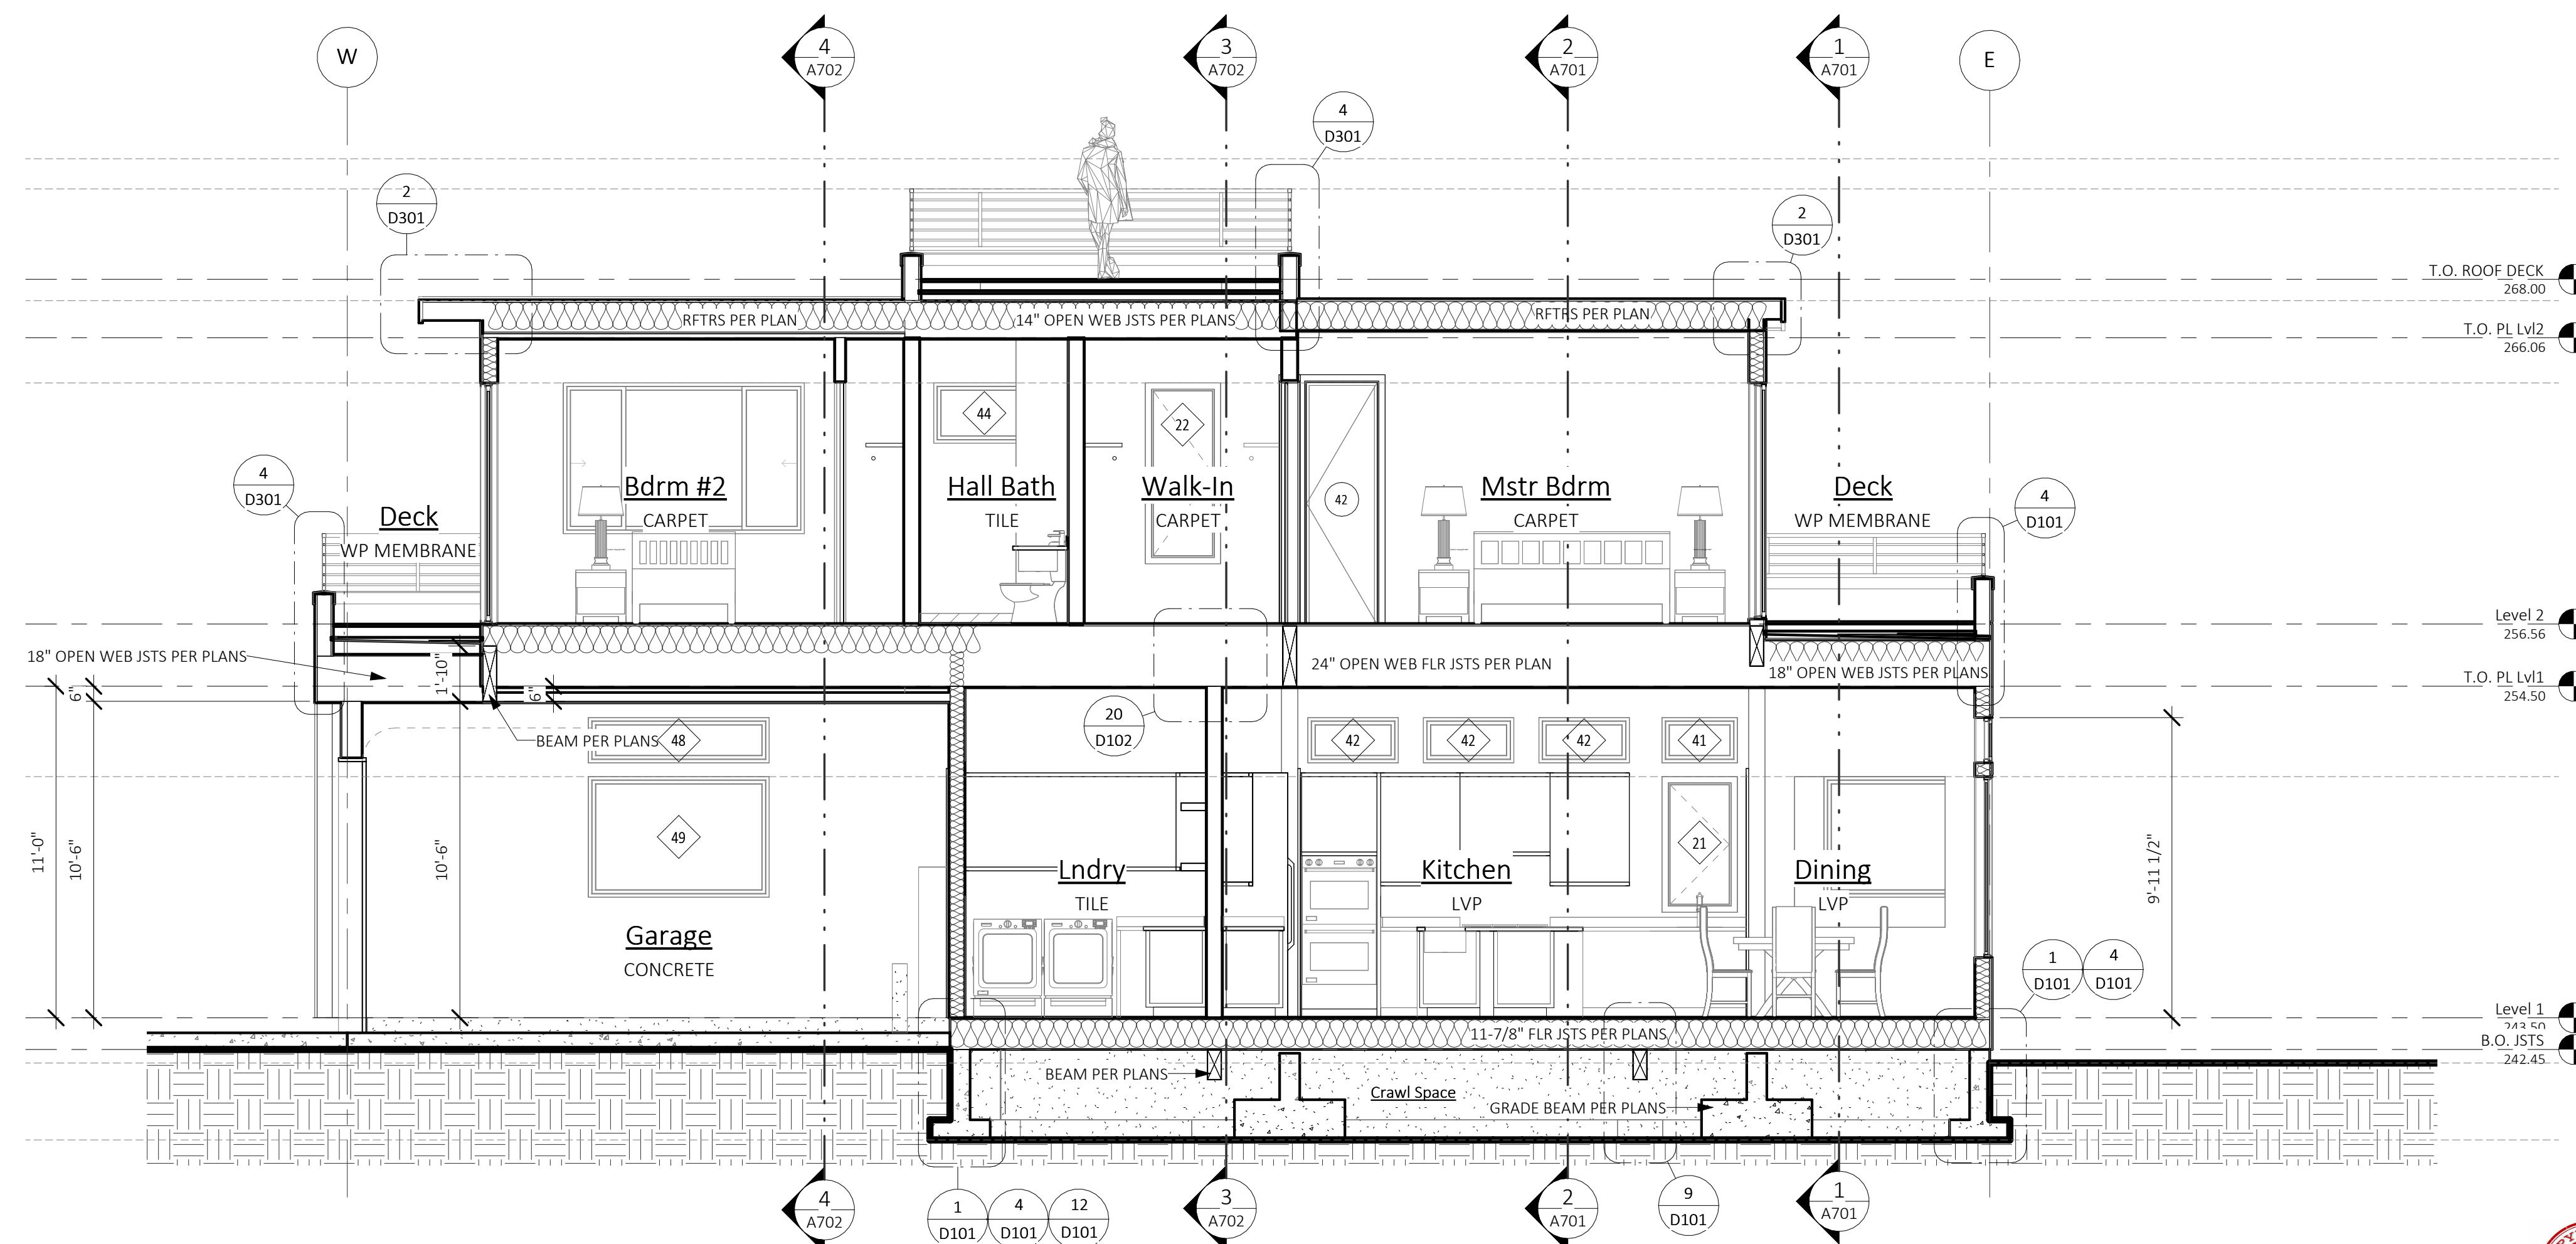

3 Section N/S 3
 SCALE: 1/4" = 1'-0"

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

Description

Date

No.

ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, WA 98059


HU RESIDENCE
 2448 72nd AVE SE, Mercer Island

PERMIT SET

SECTIONS


PROJECT NO: 21014
 ISSUE DATE: 2022/08/29
 DRAWN BY: SPM

A704


SCALE 24X36: 1/4" = 1'-0"
 *NOTE: 11X17 SETS ARE
 REDUCED 50% SCALE
 DRAWINGS ACCORDINGLY.




Autodesk Docs//71014 Hu Residence, Mercer Island//21014.05CD, Hu Residence, Mercer Island.rvt
6/27/2022 10:04:25 AM

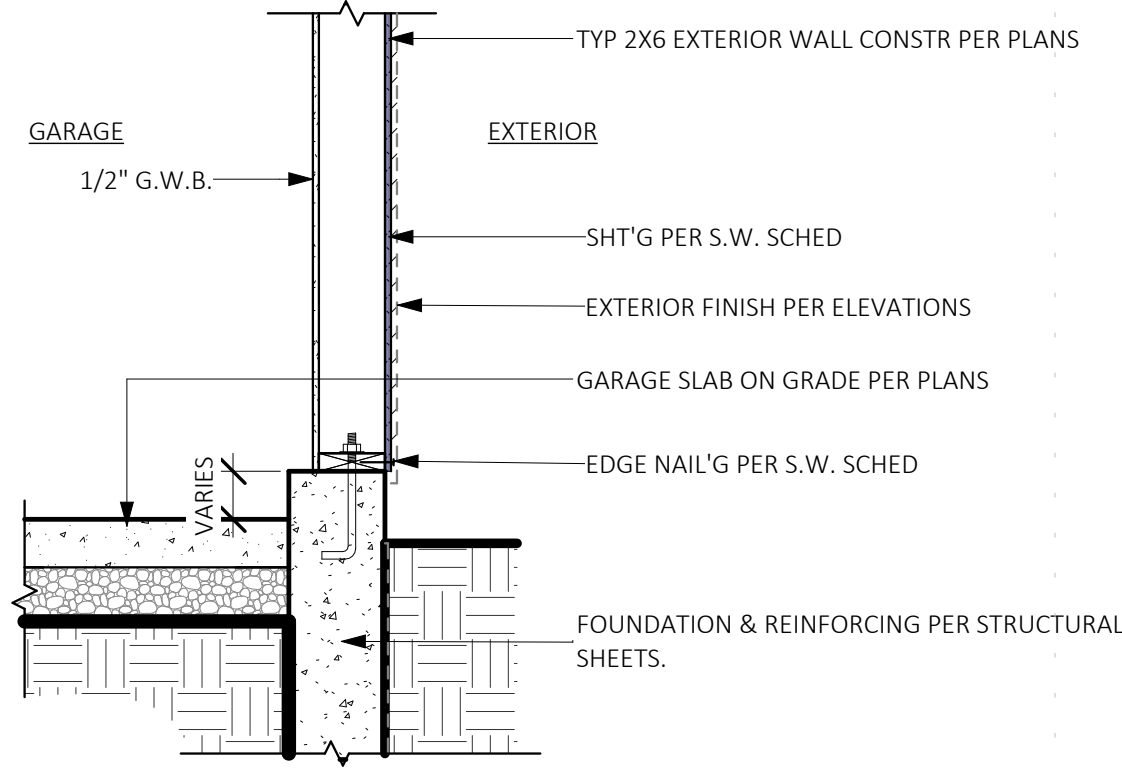


12 SLAB AT STEM WALL
SCALE: 3/4" = 1'-0"

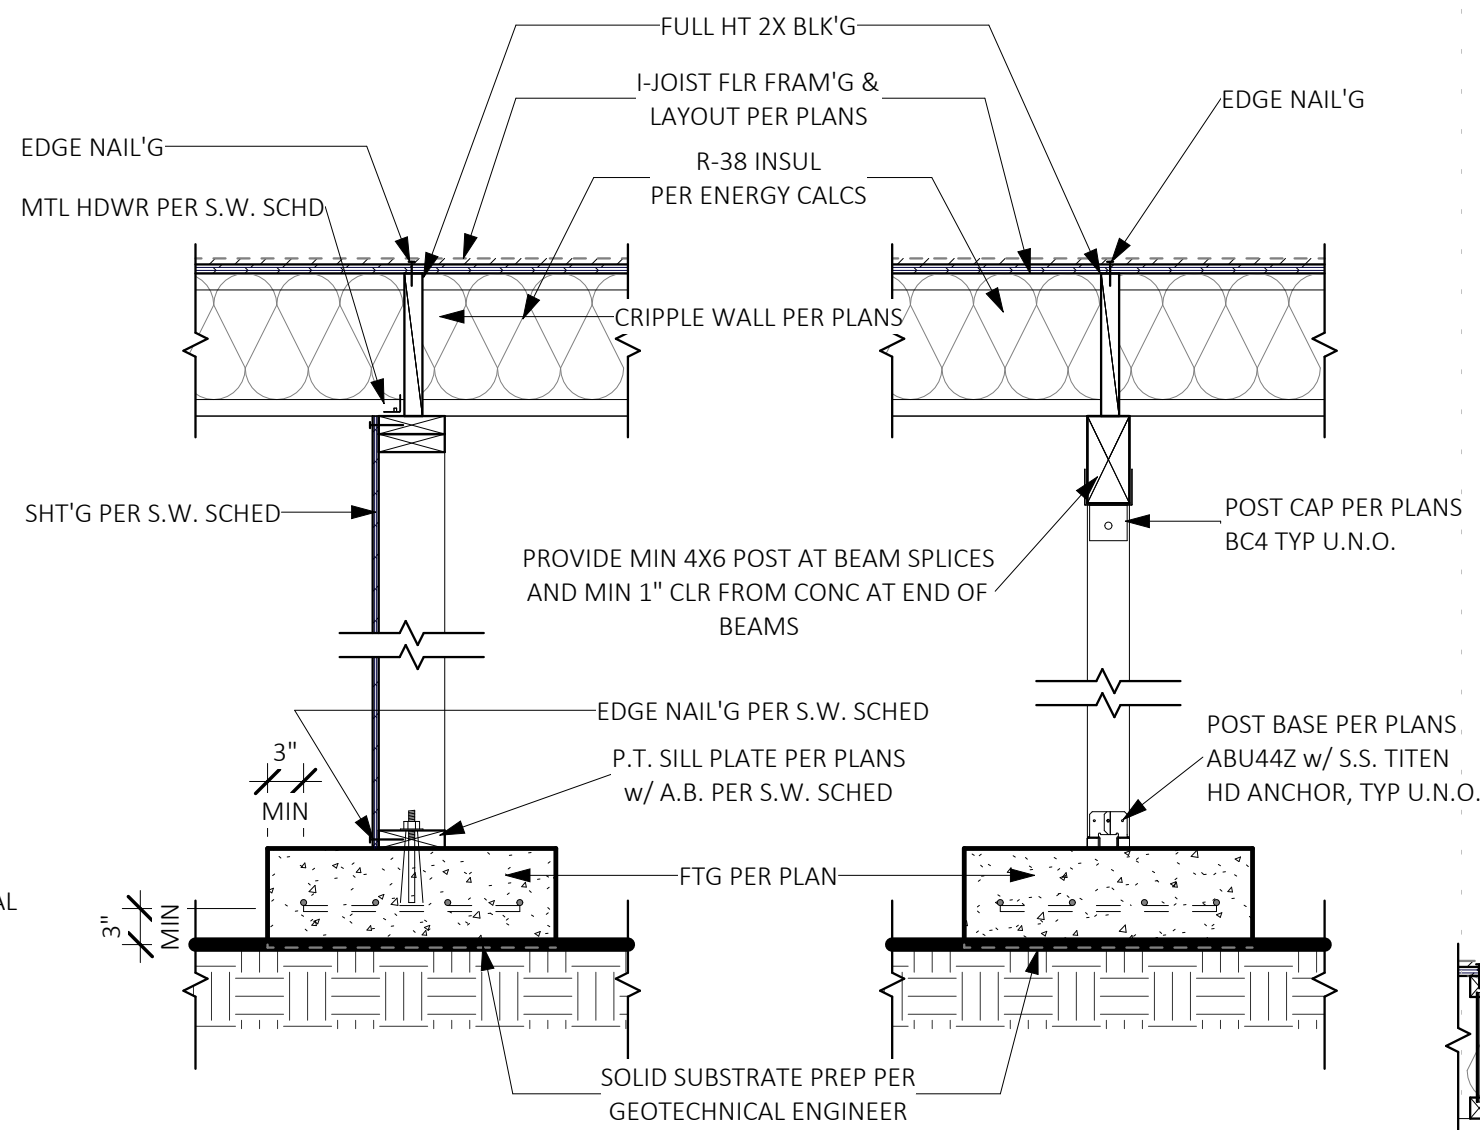


9 FRAM'G / FNDN - JOIST OVER
SCALE: 3/4" = 1'-0"

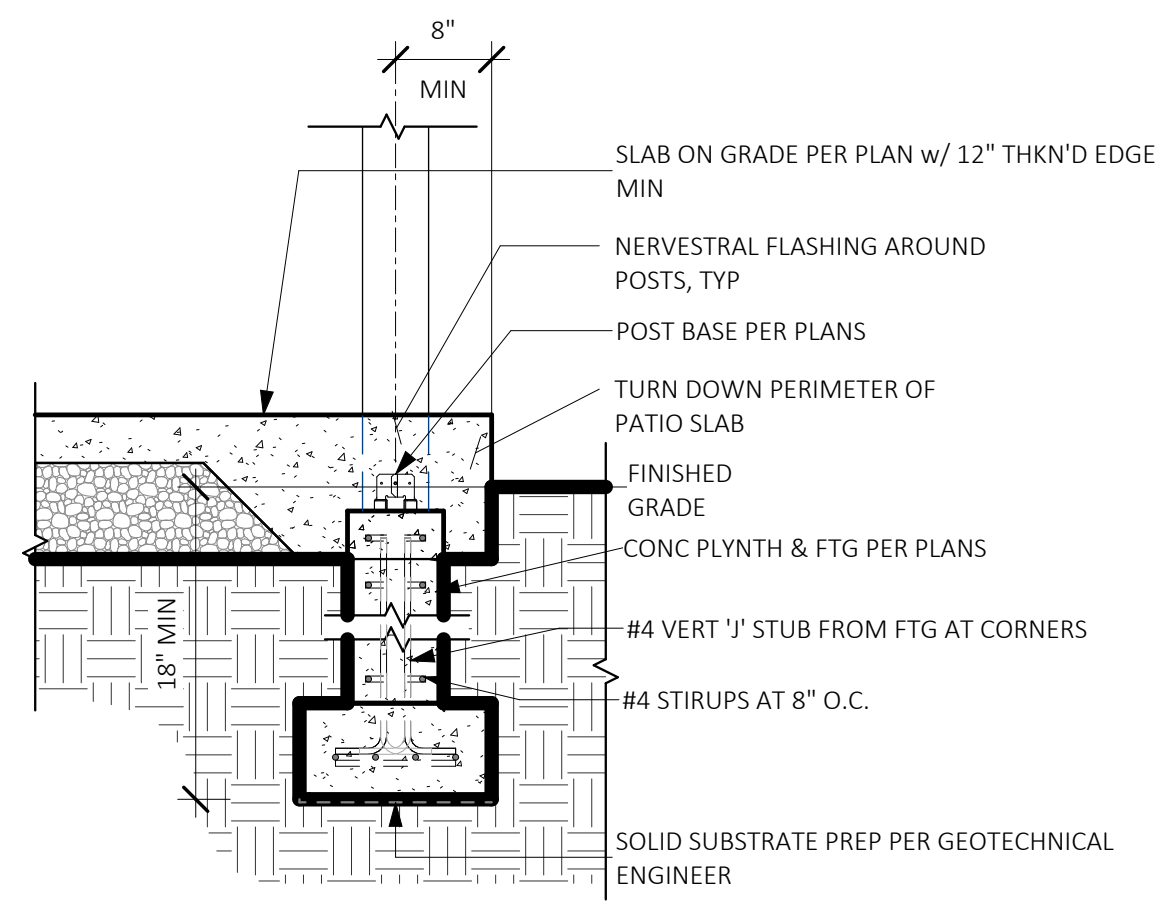


11 FRAM'G / FNDN - JOIST OVER
SCALE: 3/4" = 1'-0"

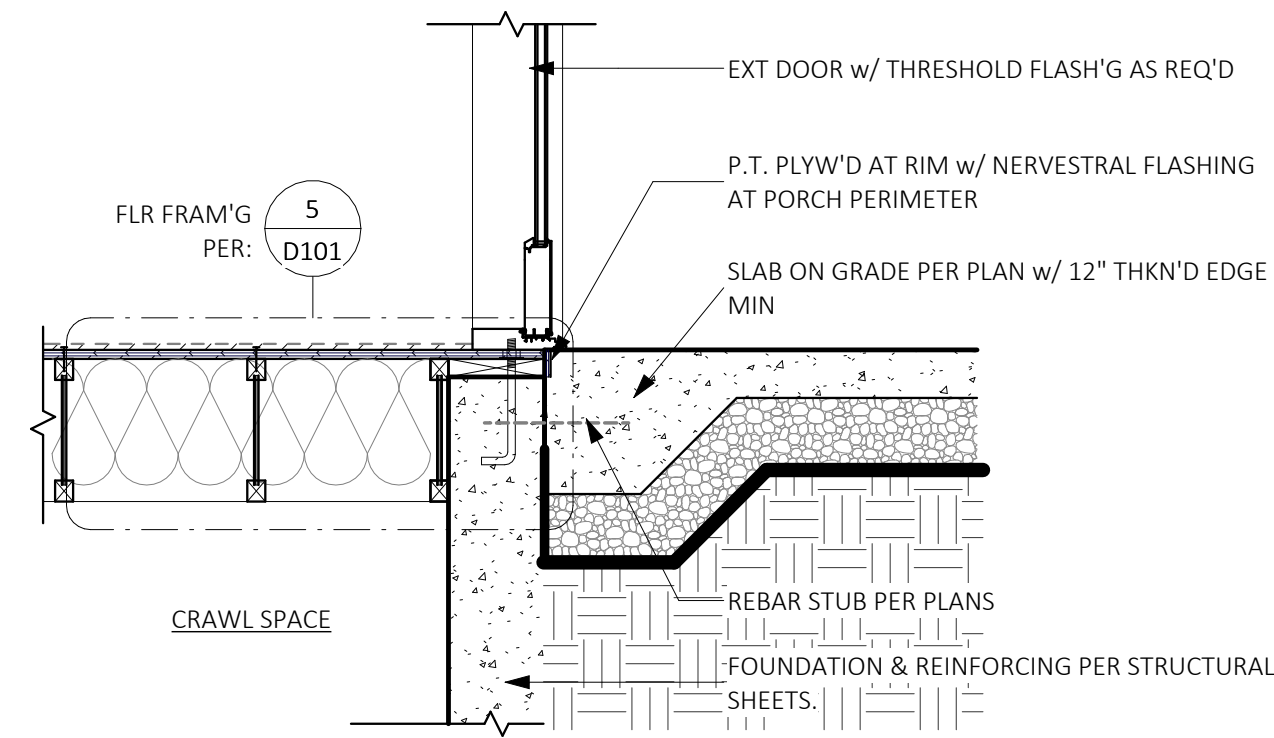


7 FRAM'G / FNDN - DROPPED JOISTS
SCALE: 3/4" = 1'-0"

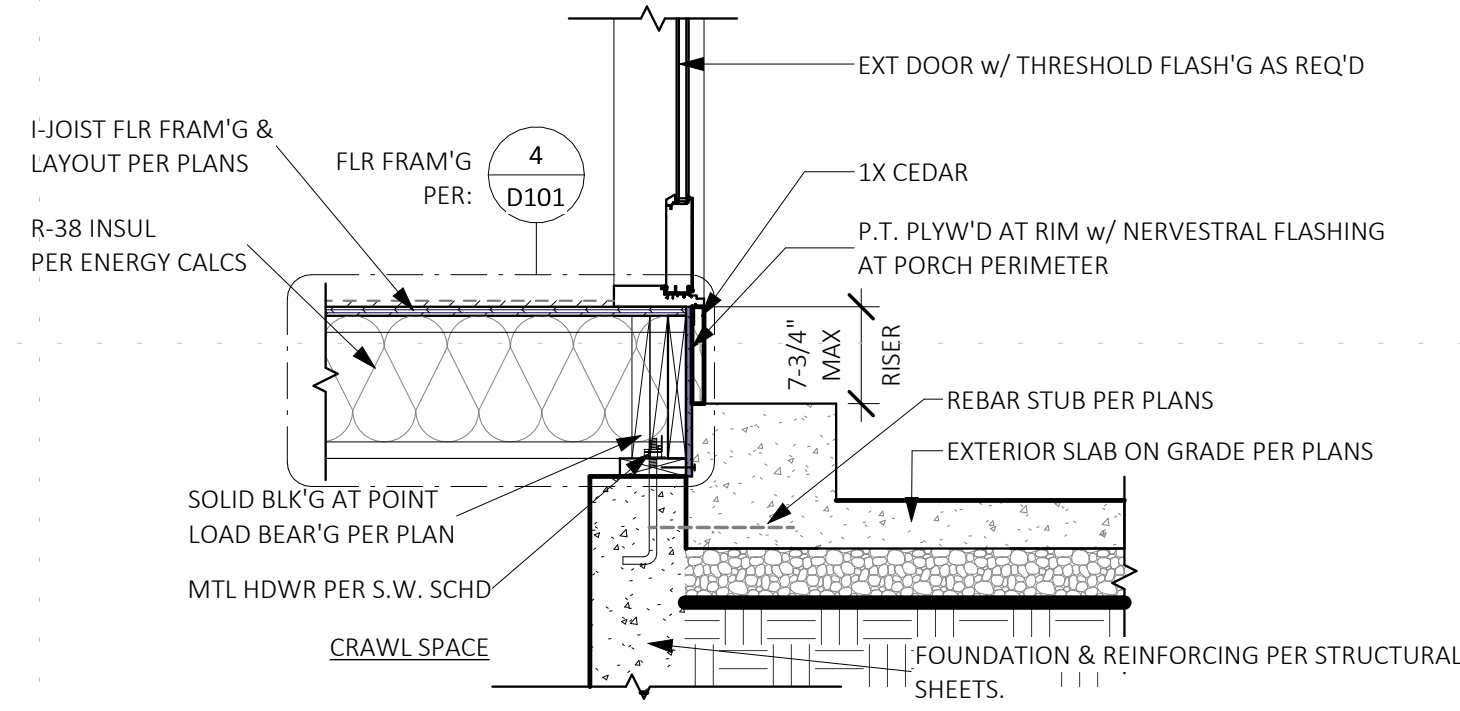

6 FRAM'G / FNDN - JOIST OVER
SCALE: 3/4" = 1'-0"

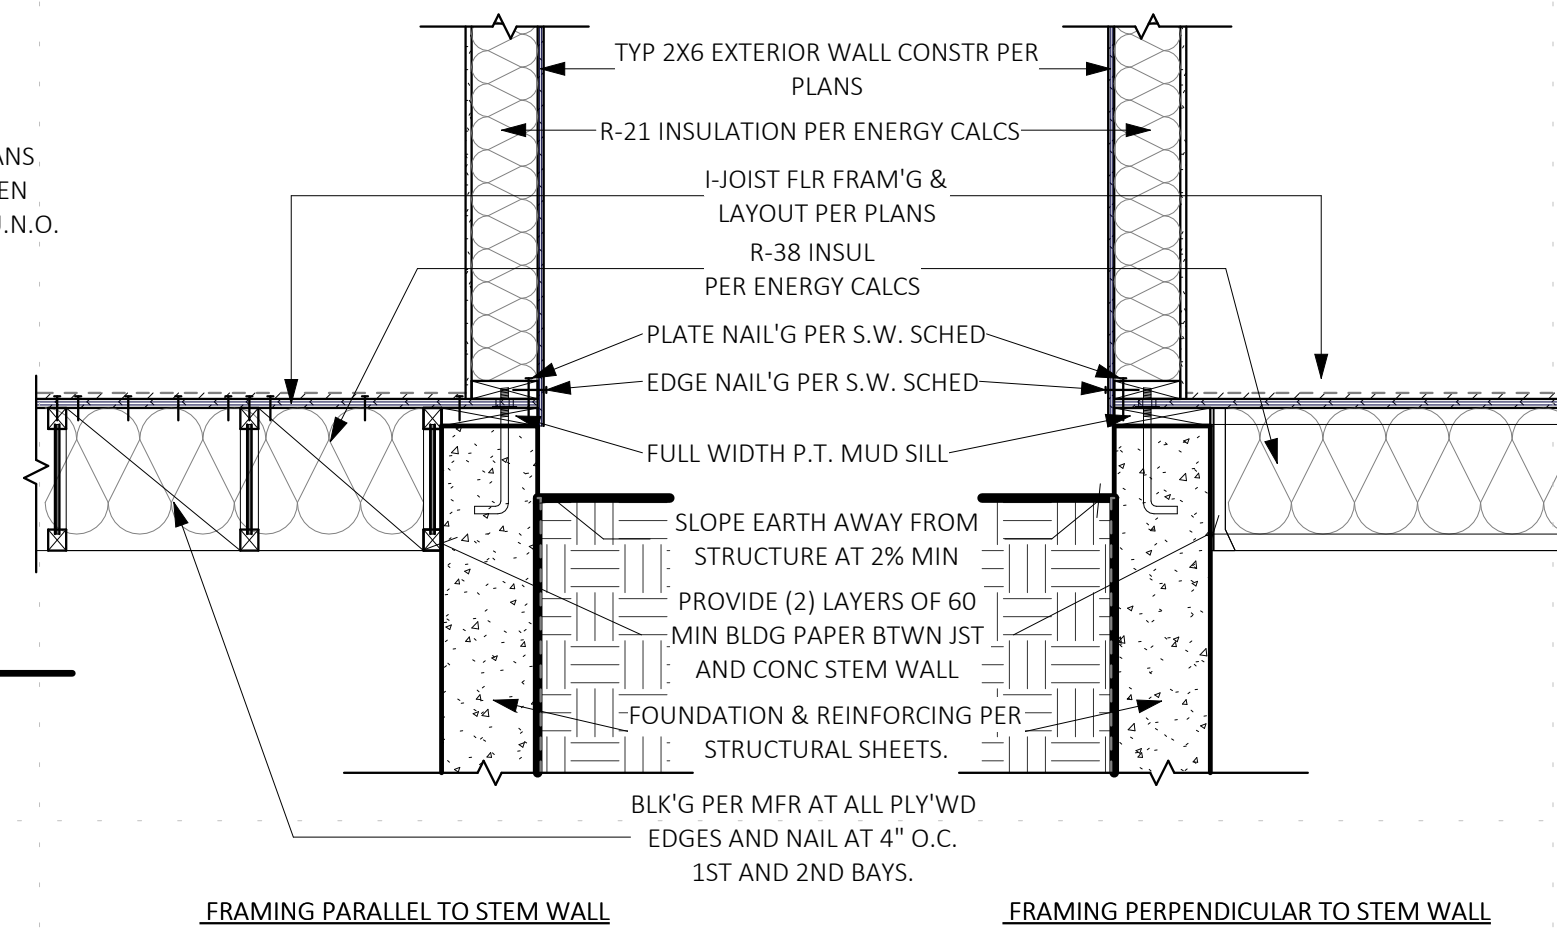


5 FRAM'G / FNDN - DROPPED JOISTS
SCALE: 3/4" = 1'-0"

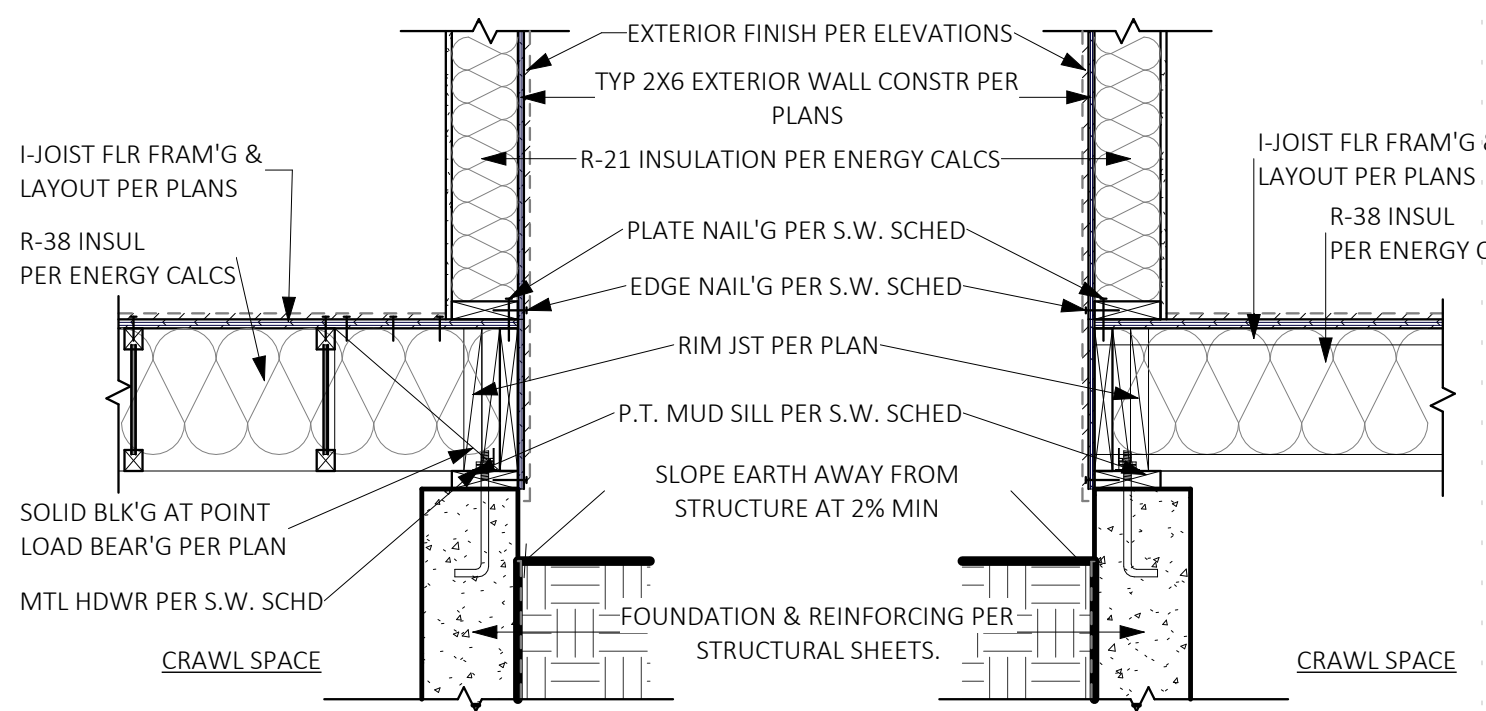

4 FRAM'G / FNDN - JOIST OVER
SCALE: 3/4" = 1'-0"

FNDN SCHEDULE - TYP									
MAX UNBAL FILL	FOOTING				STEM WALL				
	DEPTH	WIDT H	TOE	HEEL	LONGITUDINAL BAR	TRANSVERSE BAR	WIDTH	HORIZONTAL REINFORCING	VERTICAL REINFORCING
2'-6"	8"	1'-6"	5"	5"	(3) #4 BAR CONT BOT	#4 AT 8" O.C.	8"	#4 HORZ BAR CENTERED AT 12" O.C.	#4 VERT BAR CENTERED AT 12" O.C.
4'-0"	11"	2'-8"	8"	1'-4"	(2) #4 BAR CONT TOP & BOT	PER DETAILS	8"	#4 HORZ BAR CENTERED AT 12" O.C.	#4 VERT BAR CENTERED AT 12" O.C.

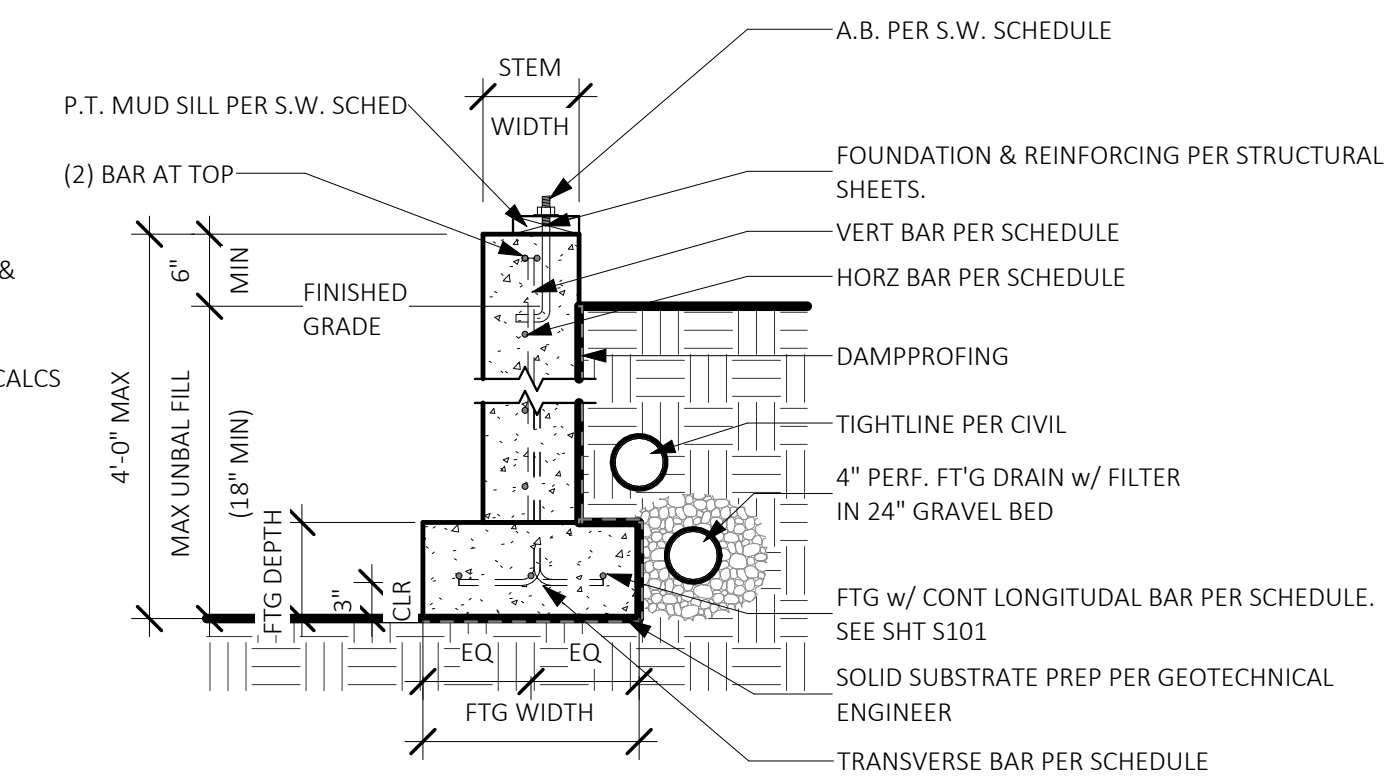

1 FOUNDATION DETAIL - TYP
SCALE: 3/4" = 1'-0"

NOTE: ALL REINFORCEMENT SHALL BE ACCURATELY PLACED AND ADEQUATELY SUPPORTED PRIOR TO CONCRETE INSPECTION. SEE SHEET A001

NOTE: THIS IS A STANDARD DETAILS SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.



L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072
ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, WA 98059

HU RESIDENCE
2448 72nd AVE SE, Mercer Island

STANDARD DETAIL SHEET
FOUNDATION & FRAM'G DETAILS

PERMIT SET
PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

D101
SCALE 24X36: 3/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.


No. _____ Date _____ Description _____



Autodesk Docs//71014 Hu Residence, Mercer Island//21014.05CD, Hu Residence, Mercer Island.rvt
6/27/2022 10:04:26 AM


23

FORCE TRANSFER AT OPENING
SCALE: 3/4" = 1'-0"

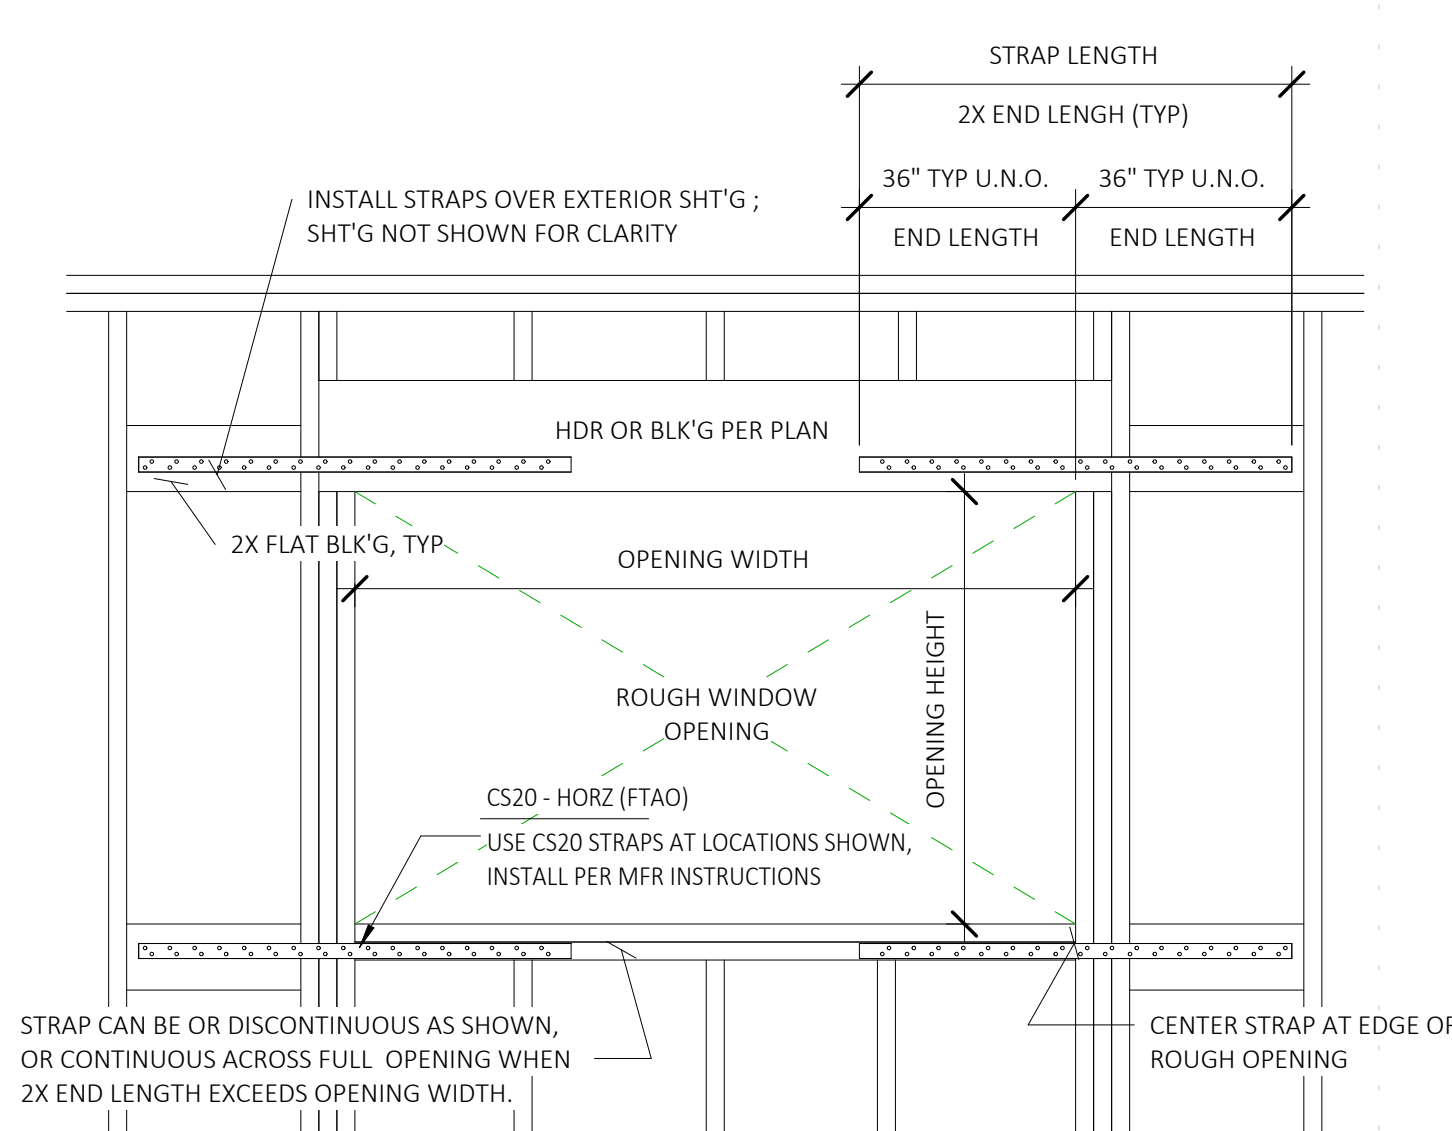


22

INT/EXT WALL FRAMING DETAIL
SCALE: 3/4" = 1'-0"

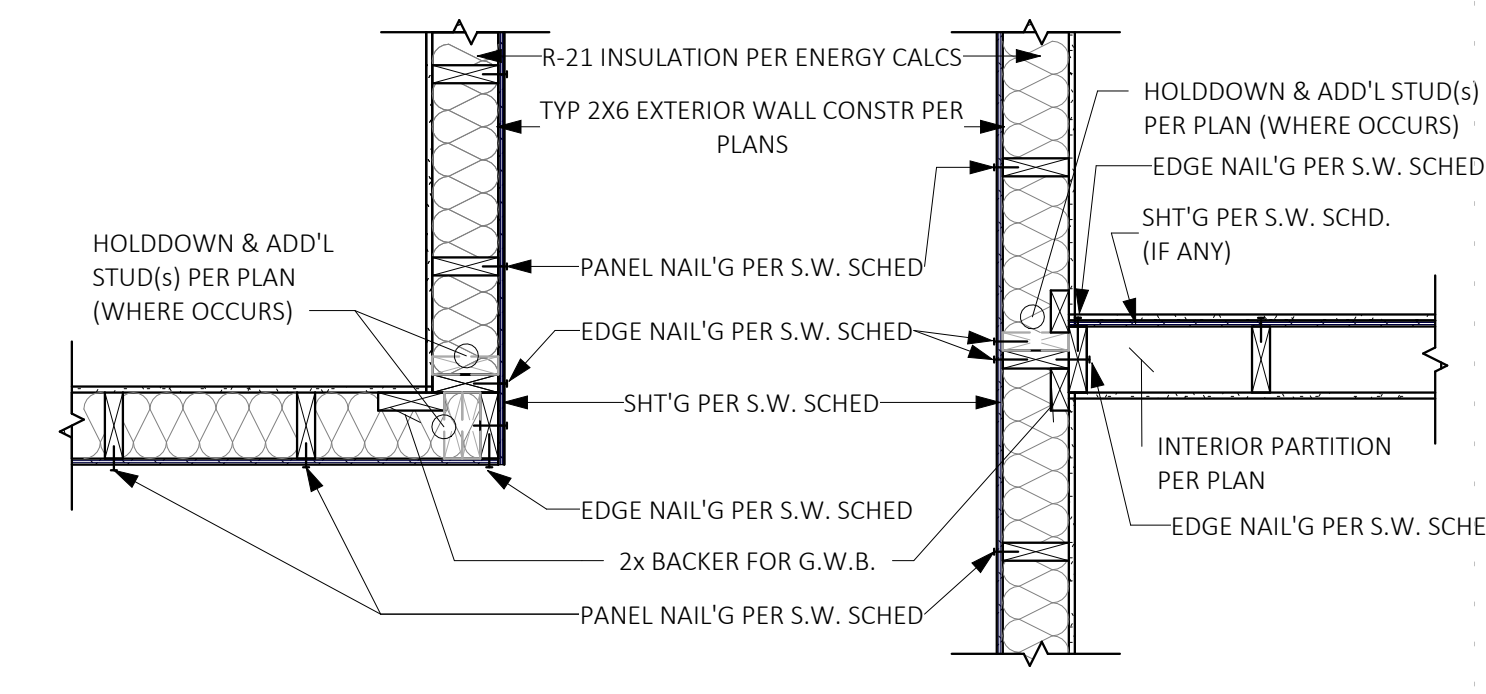


17

INTERIOR WALL/FLOOR JOISTS - STACKED
SCALE: 3/4" = 1'-0"

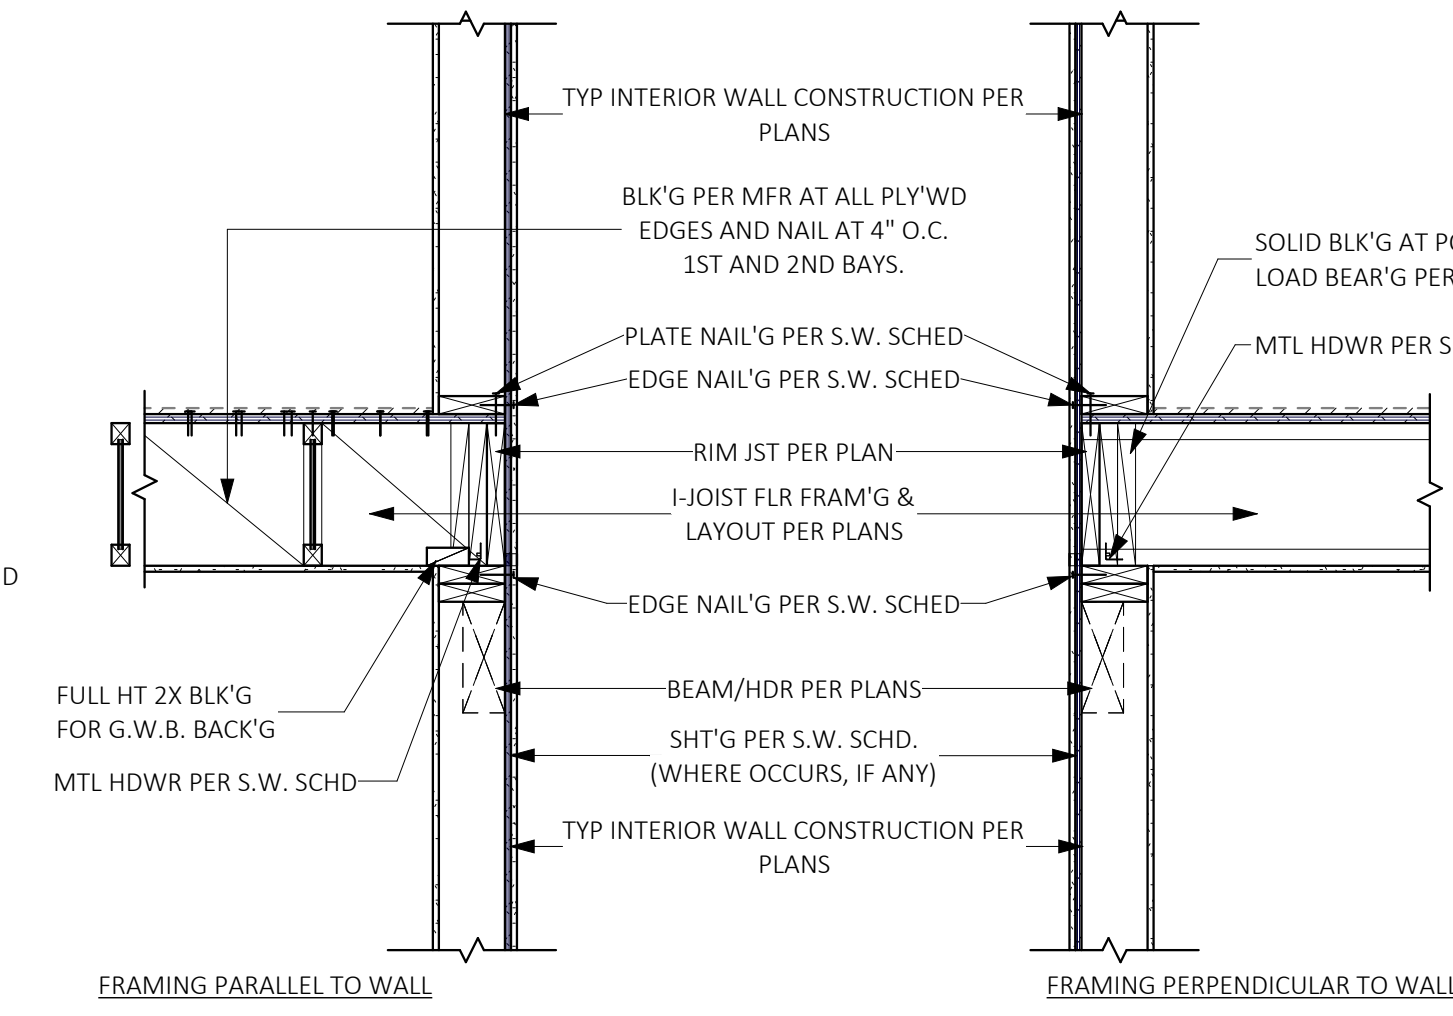


14

EXTERIOR WALL TO FLOOR JOISTS
SCALE: 3/4" = 1'-0"

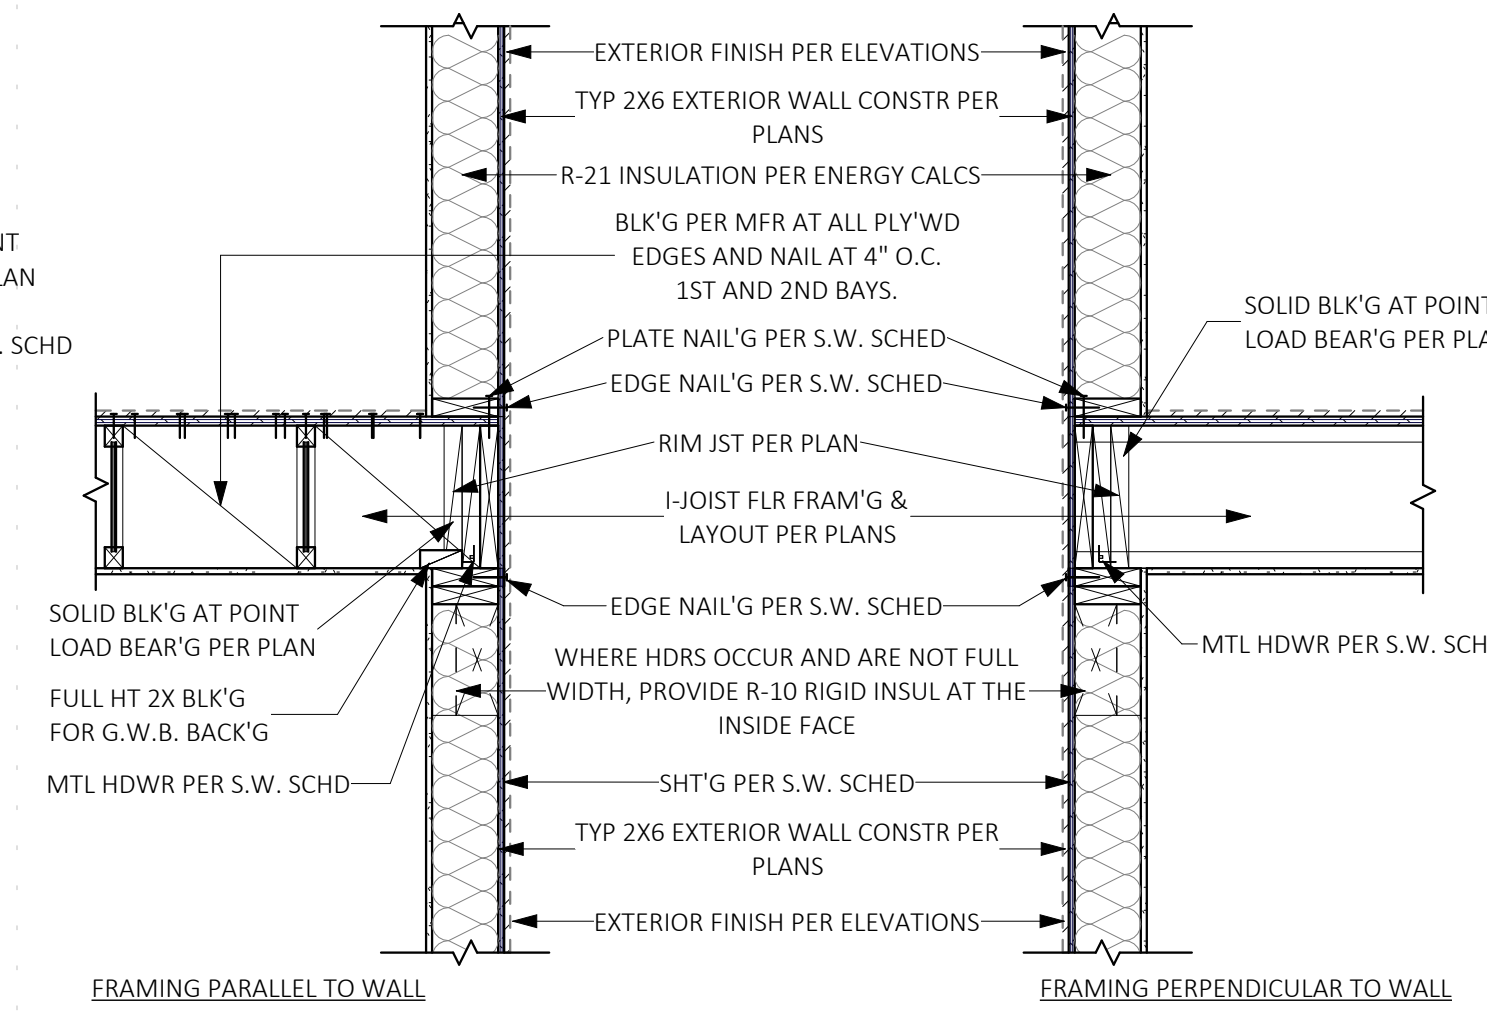

15

CANTILEVERED FRM'G AT EXT WALL
SCALE: 3/4" = 1'-0"

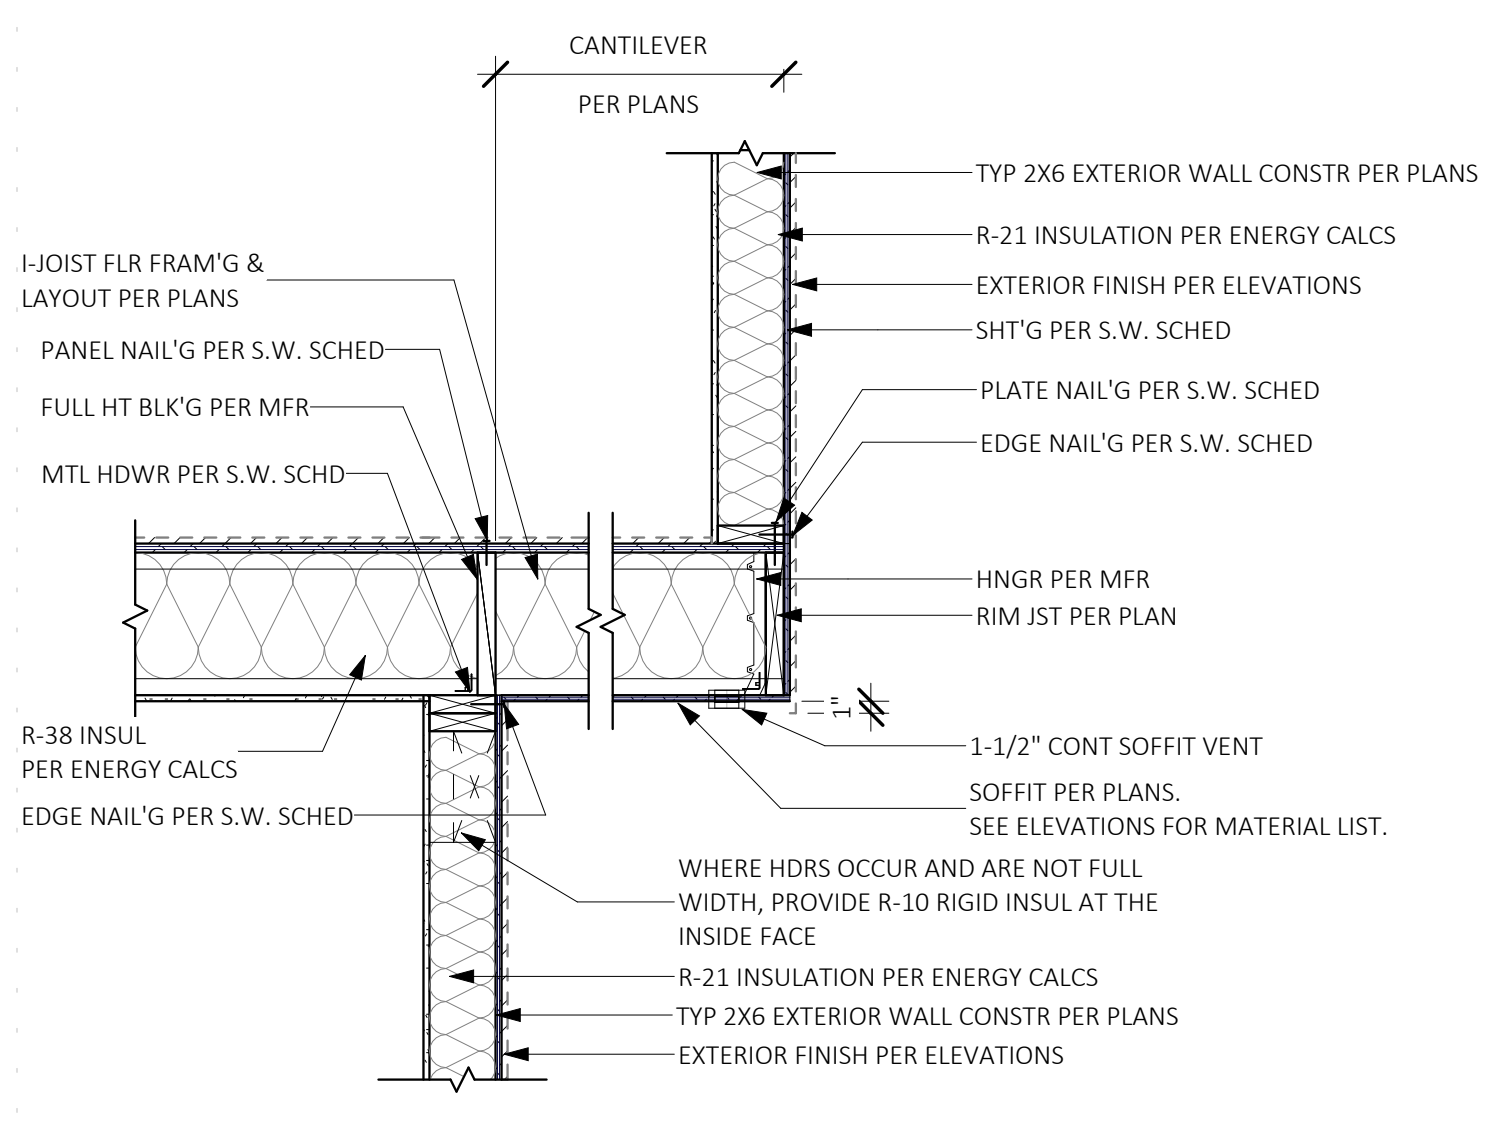

NOTE: THIS IS A STANDARD DETAILS SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

STANDARD DETAIL SHEET



PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

D102

FRAMING DETAILS

PERMIT SET

HU RESIDENCE
2448 72nd AVE SE, Mercer Island


L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072
ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, W A 98059



No. _____
Date _____
Description _____


2 TYP RAILING/GRAB BAR DETAIL

SCALE: 3/4" = 1'-0"

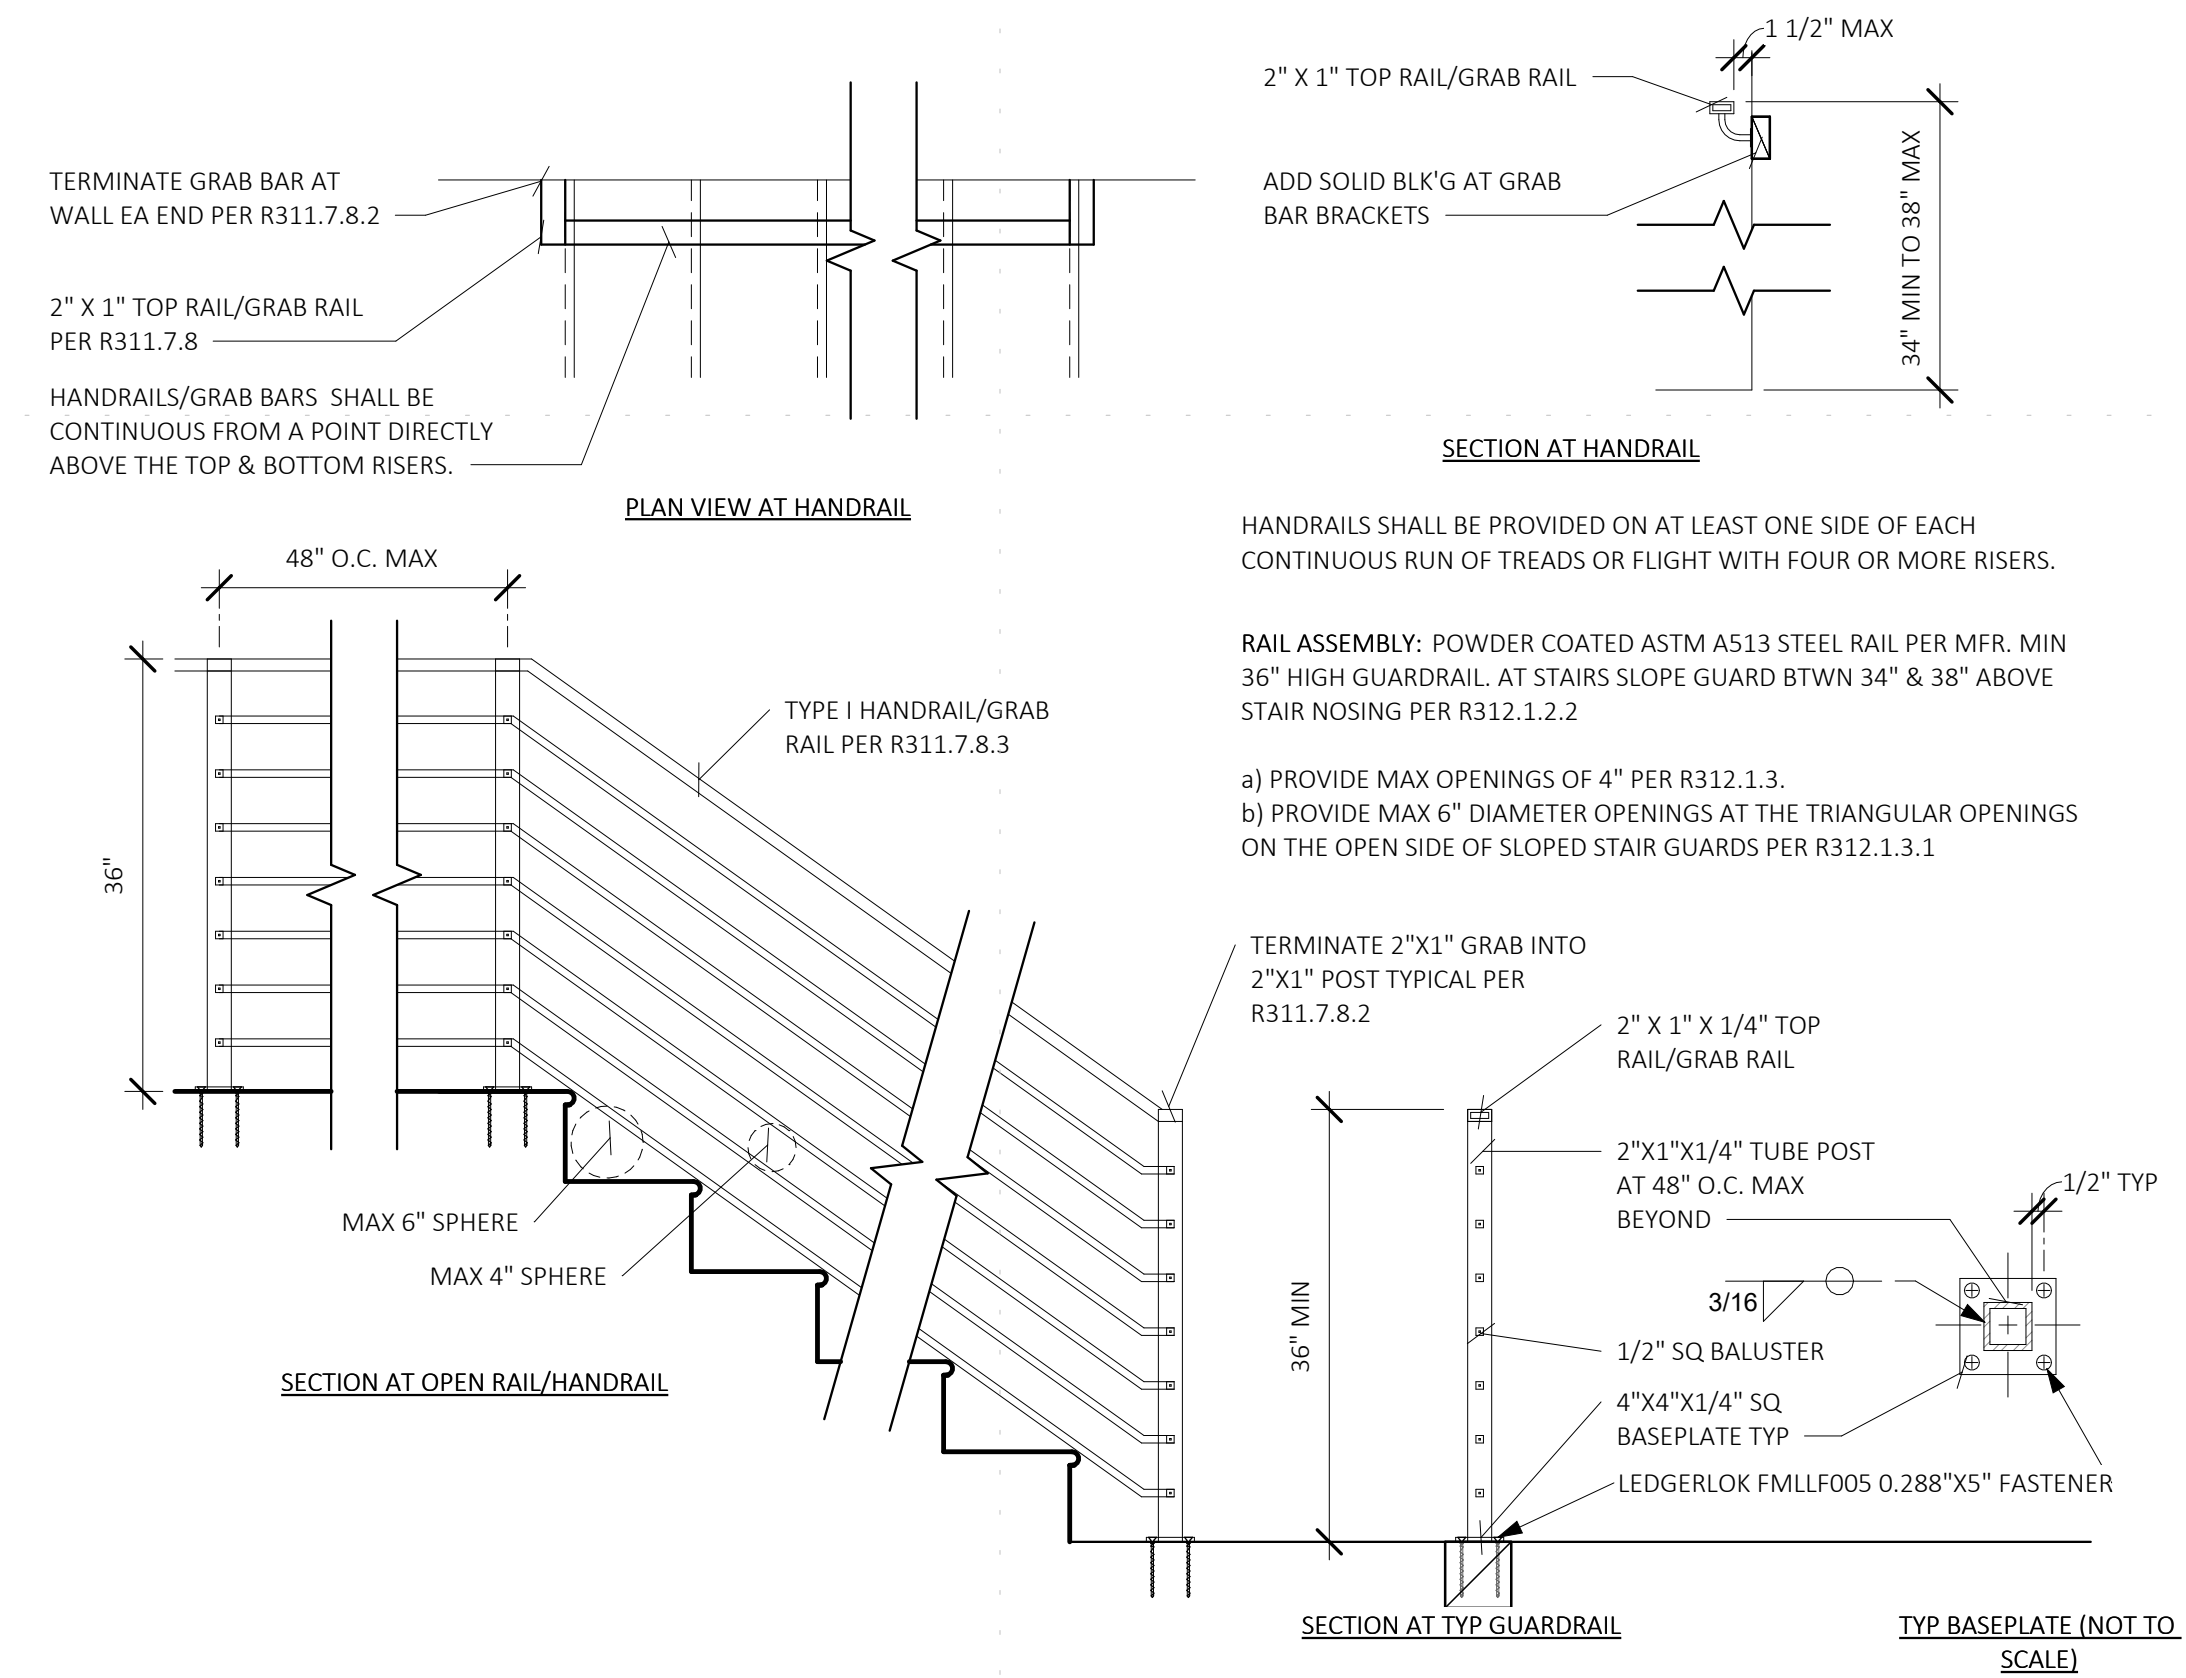

1 STAIR SECTION DETAIL

SCALE: 3/4" = 1'-0"

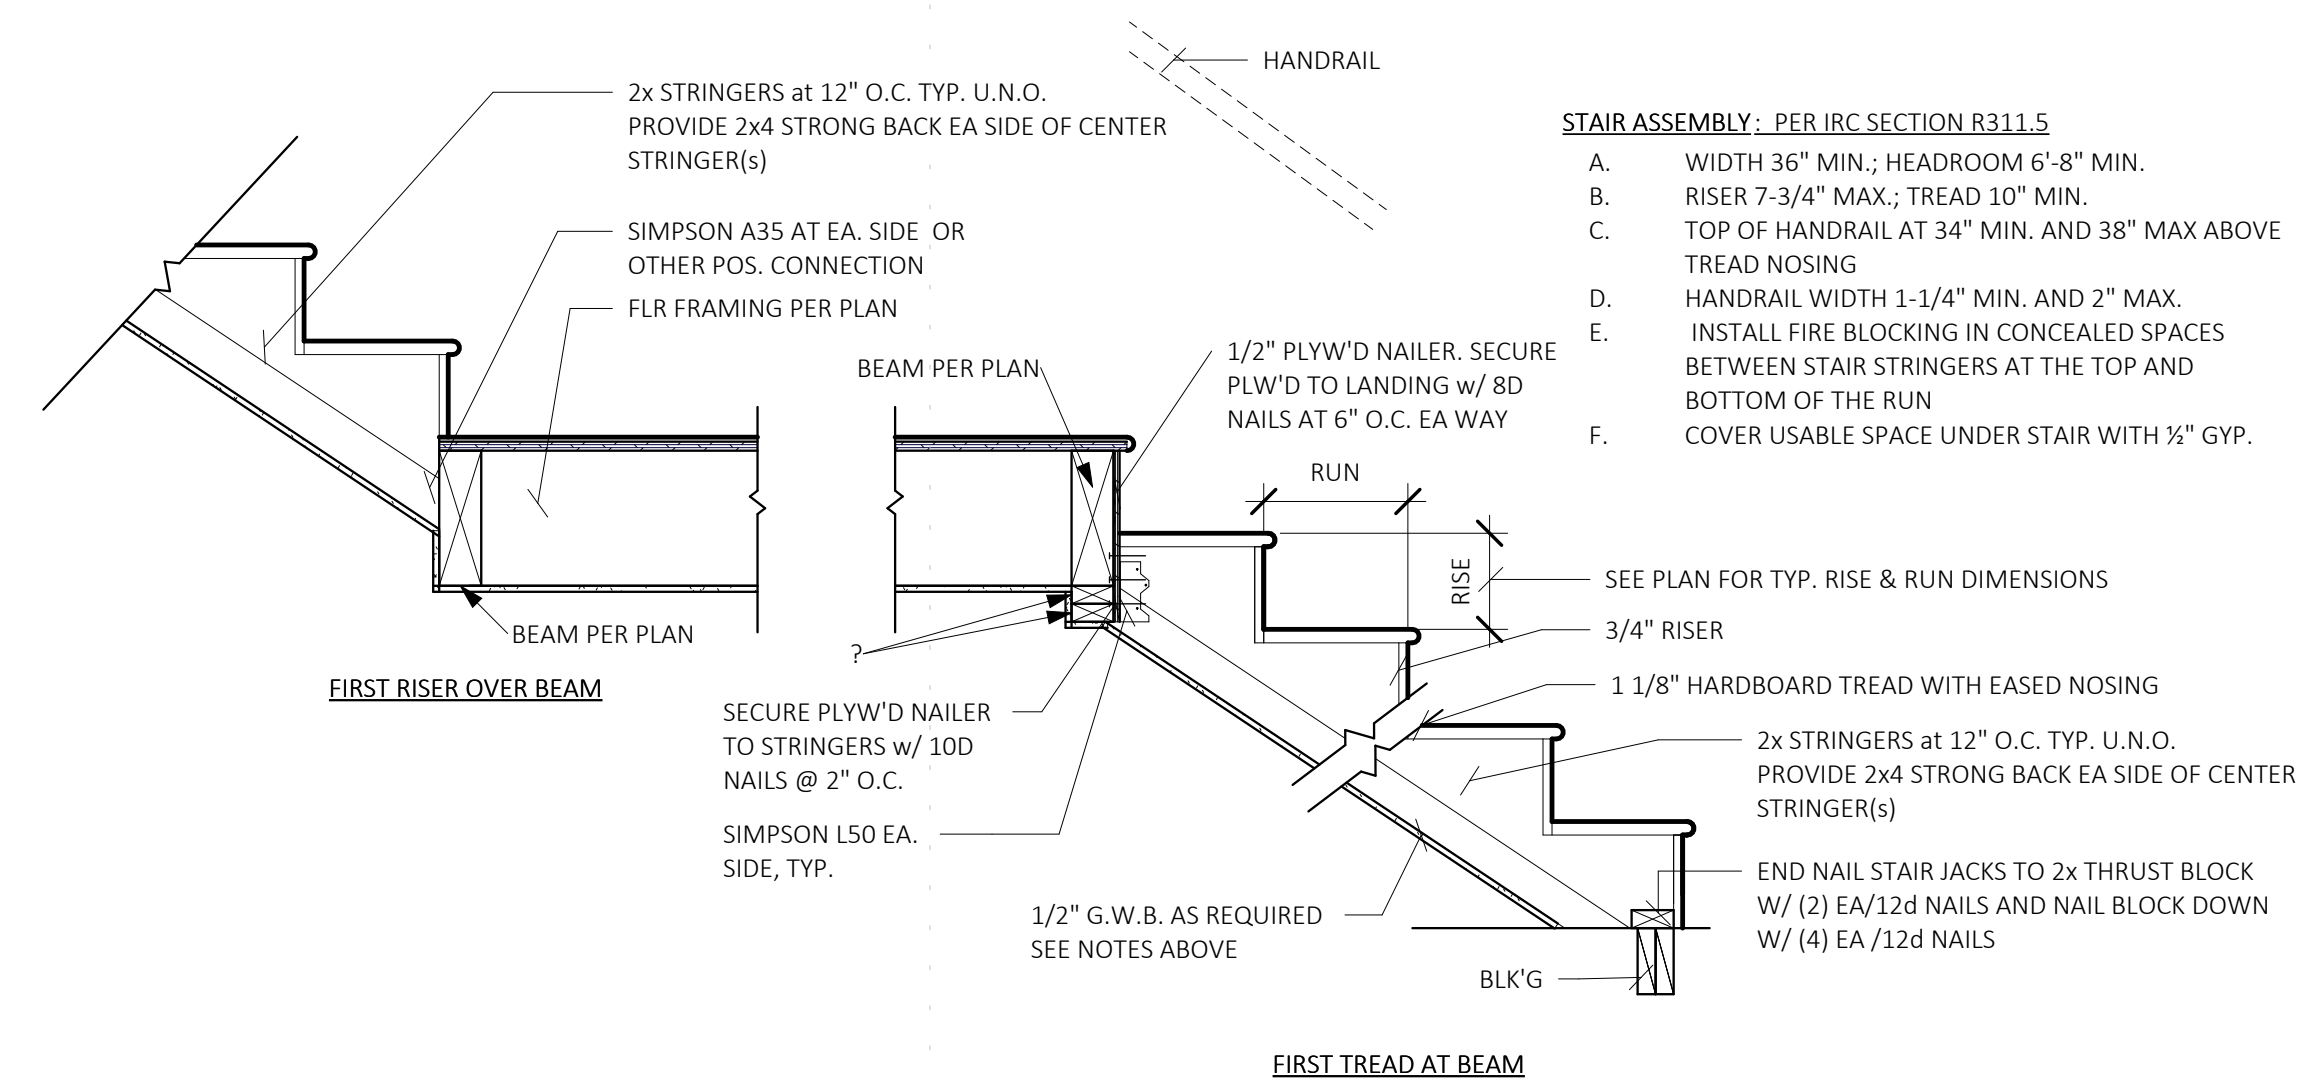

STANDARD DETAIL SHEET

NOTE: THIS IS A STANDARD DETAIL SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.


(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

No. _____ Date _____



L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072

ATERA DESIGN STUDIO
451 DUVALL AVE. NE,
RENTON, WA 98059

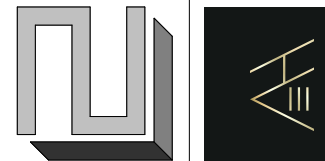

HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET


STAIR & RAILING
DETAILS

PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM


D201

SCALE 24X36: 3/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



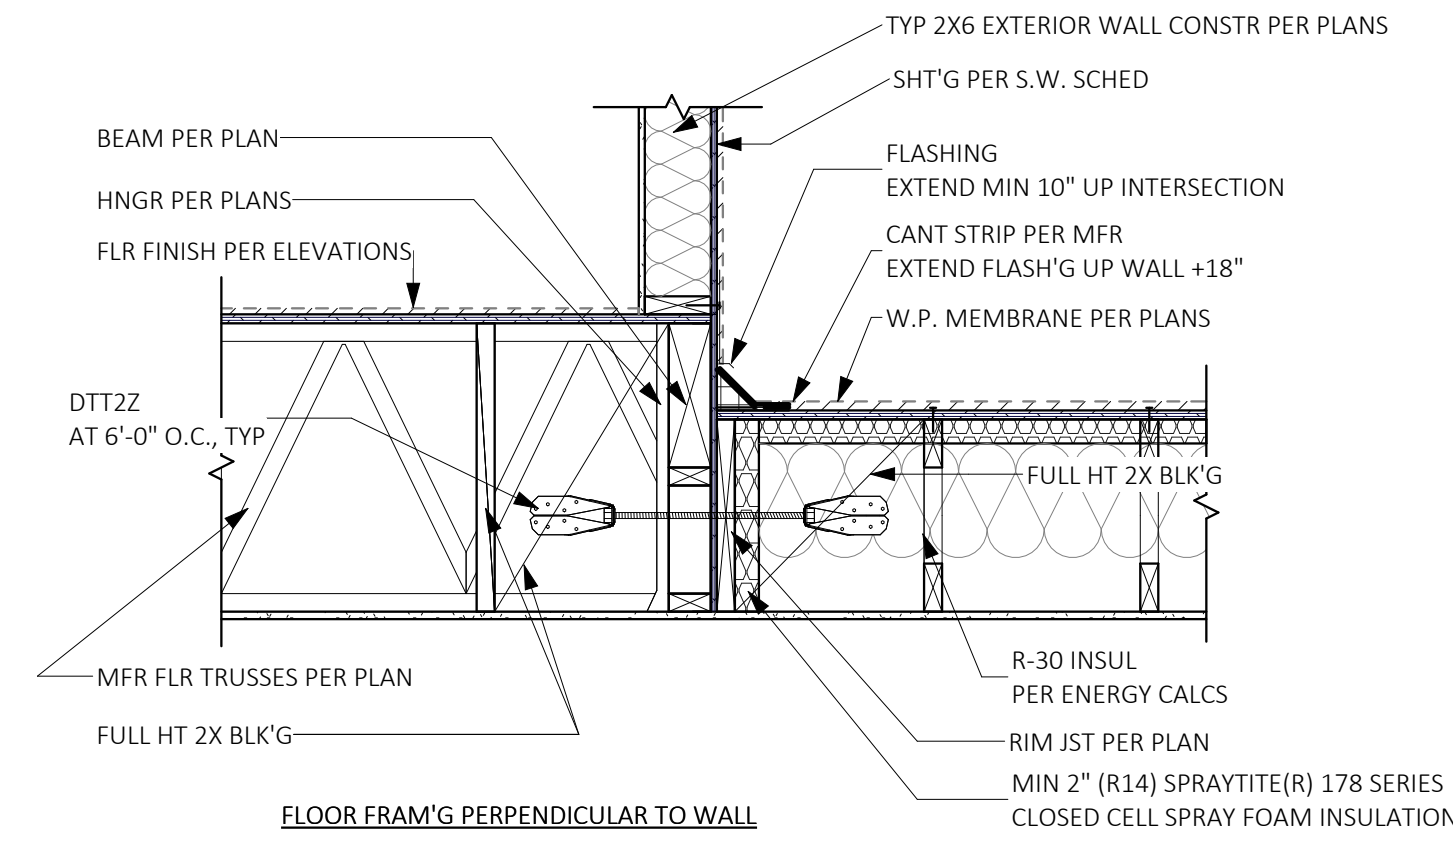


FLOOR FRAM'G PERPENDICULAR TO WALL

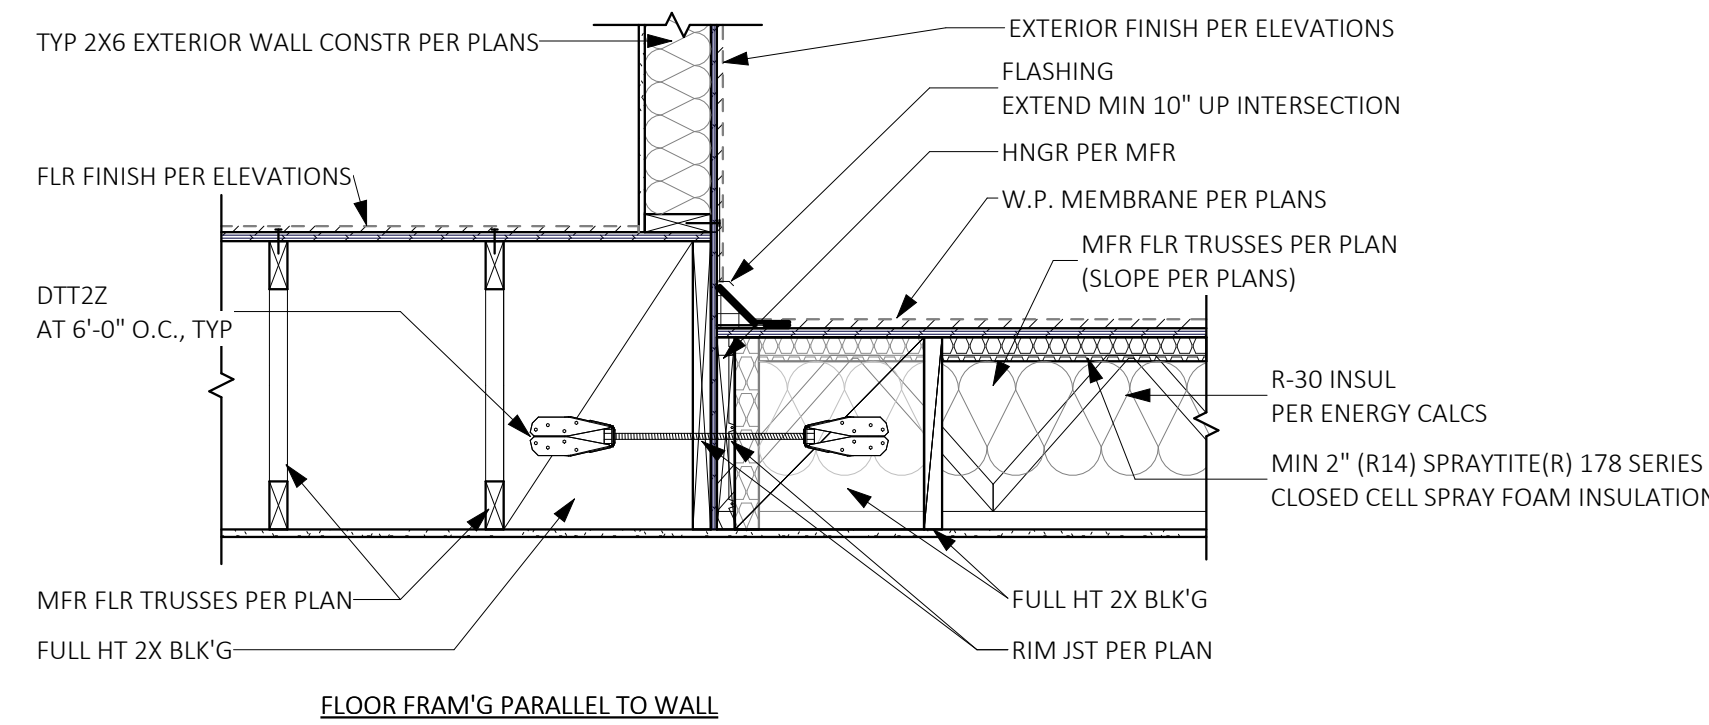

FLOOR FRAM'G PARALLEL TO WALL

7 BALCONY/WALL CONNECTION


SCALE: 3/4" = 1'-0"

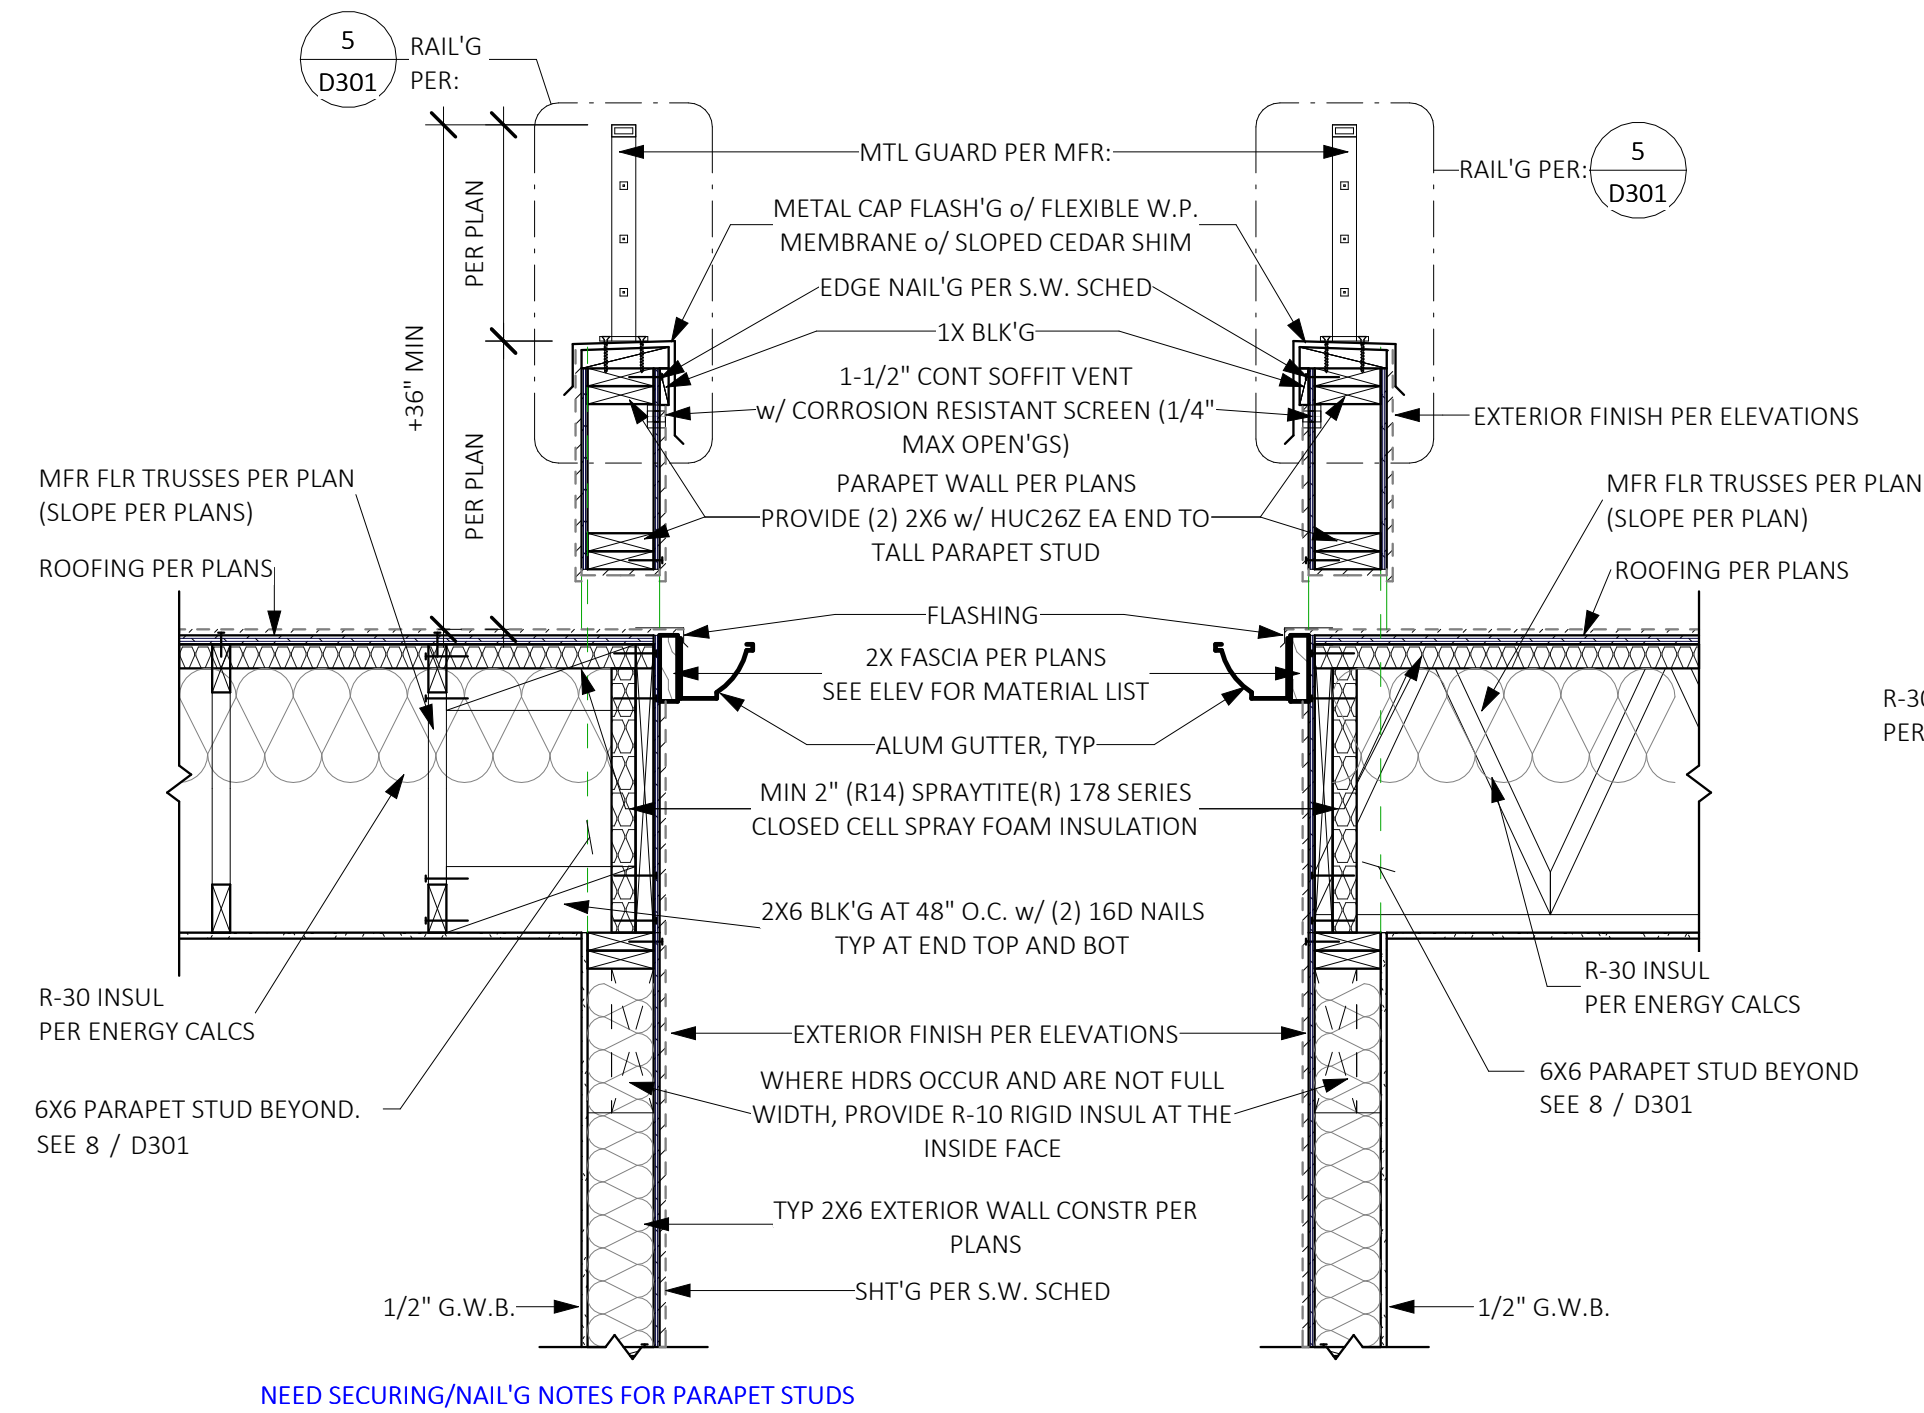

NEED SECURING/NAIL'G NOTES FOR PARAPET STUDS


6 PARAPET DETAIL w/ GUTTER

SCALE: 3/4" = 1'-0"

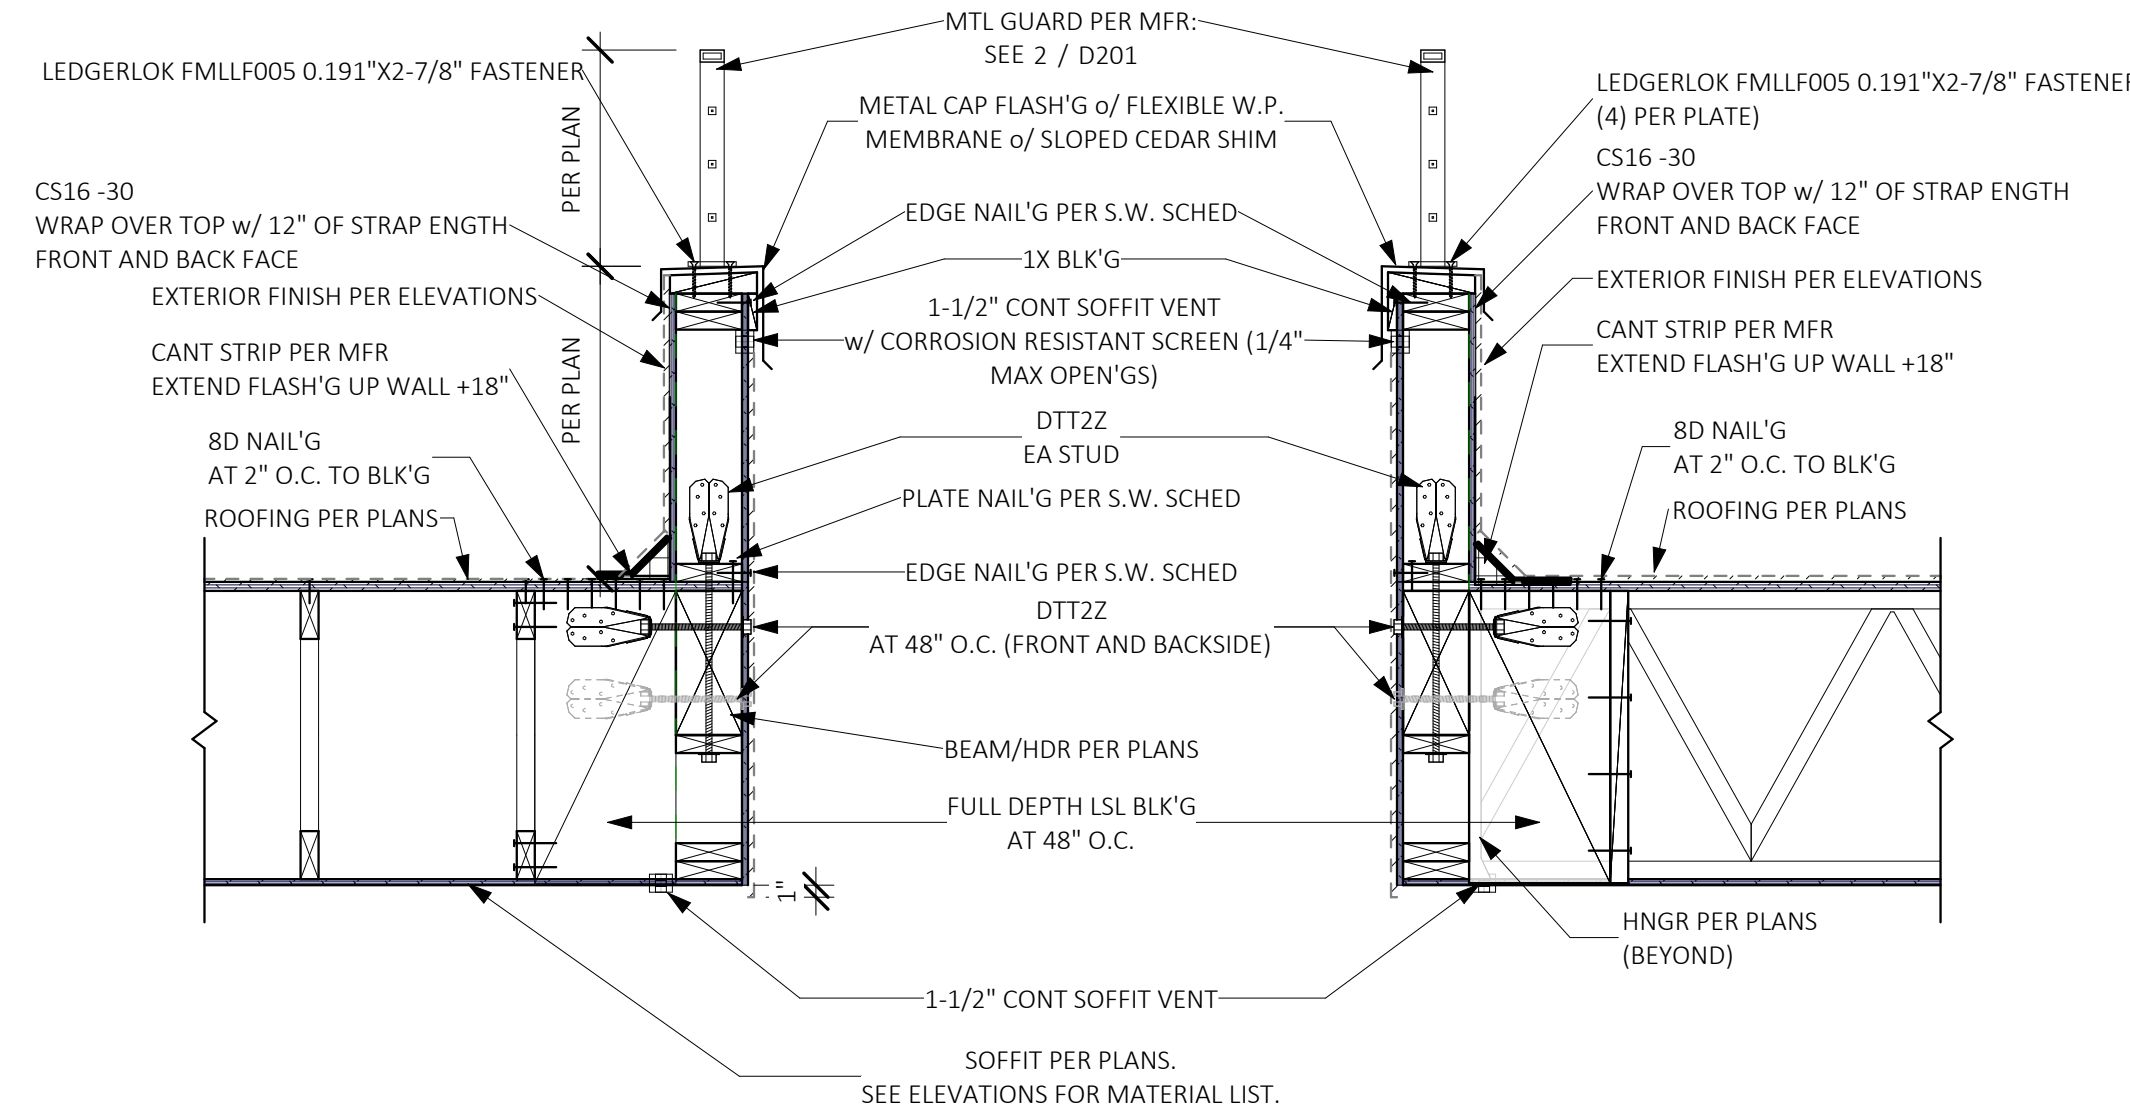

5 PARAPET DETAIL AT PORCH

SCALE: 3/4" = 1'-0"

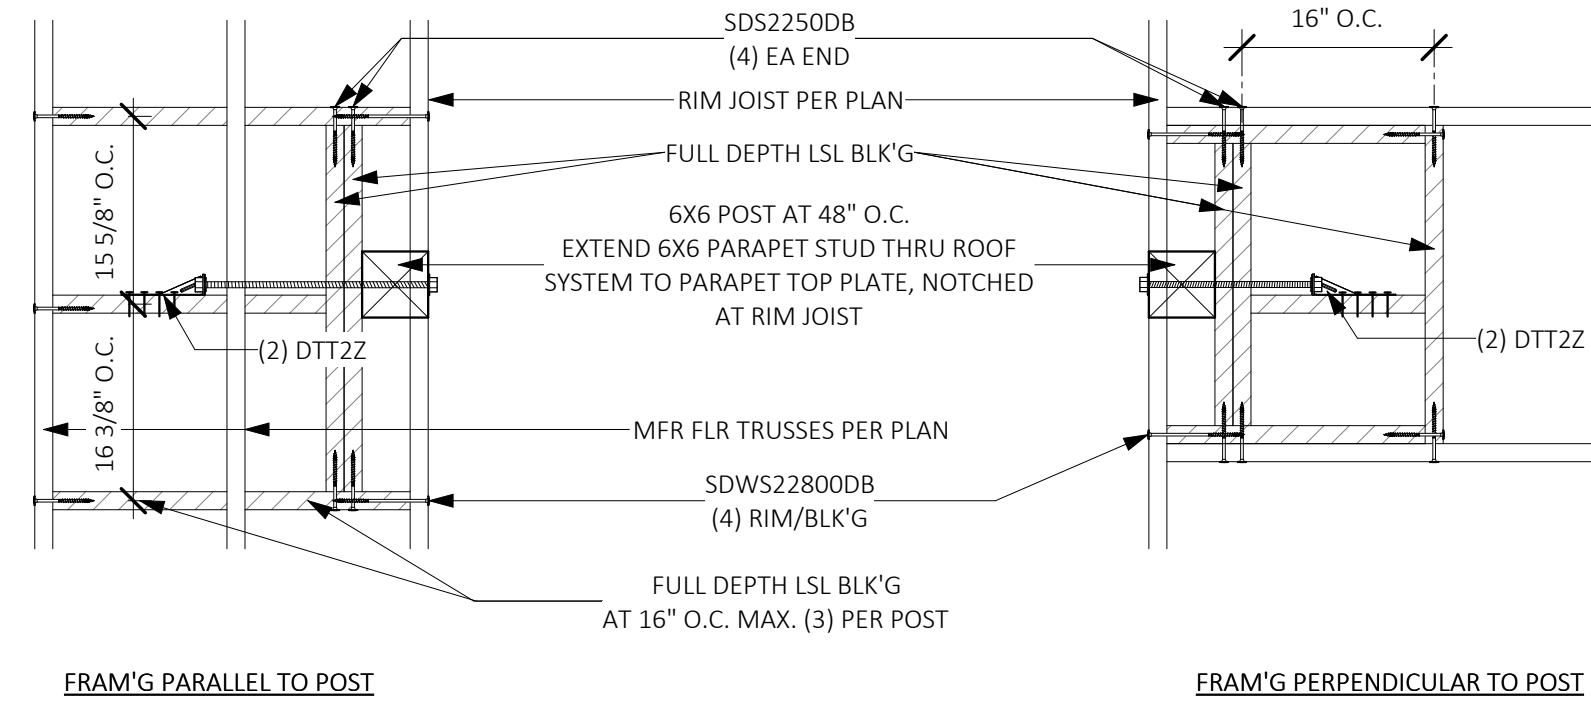


FRAM'G PARALLEL TO POST

FRAM'G PERPENDICULAR TO POST

8 PLAN VIEW AT PARAPET STUD

SCALE: 3/4" = 1'-0"

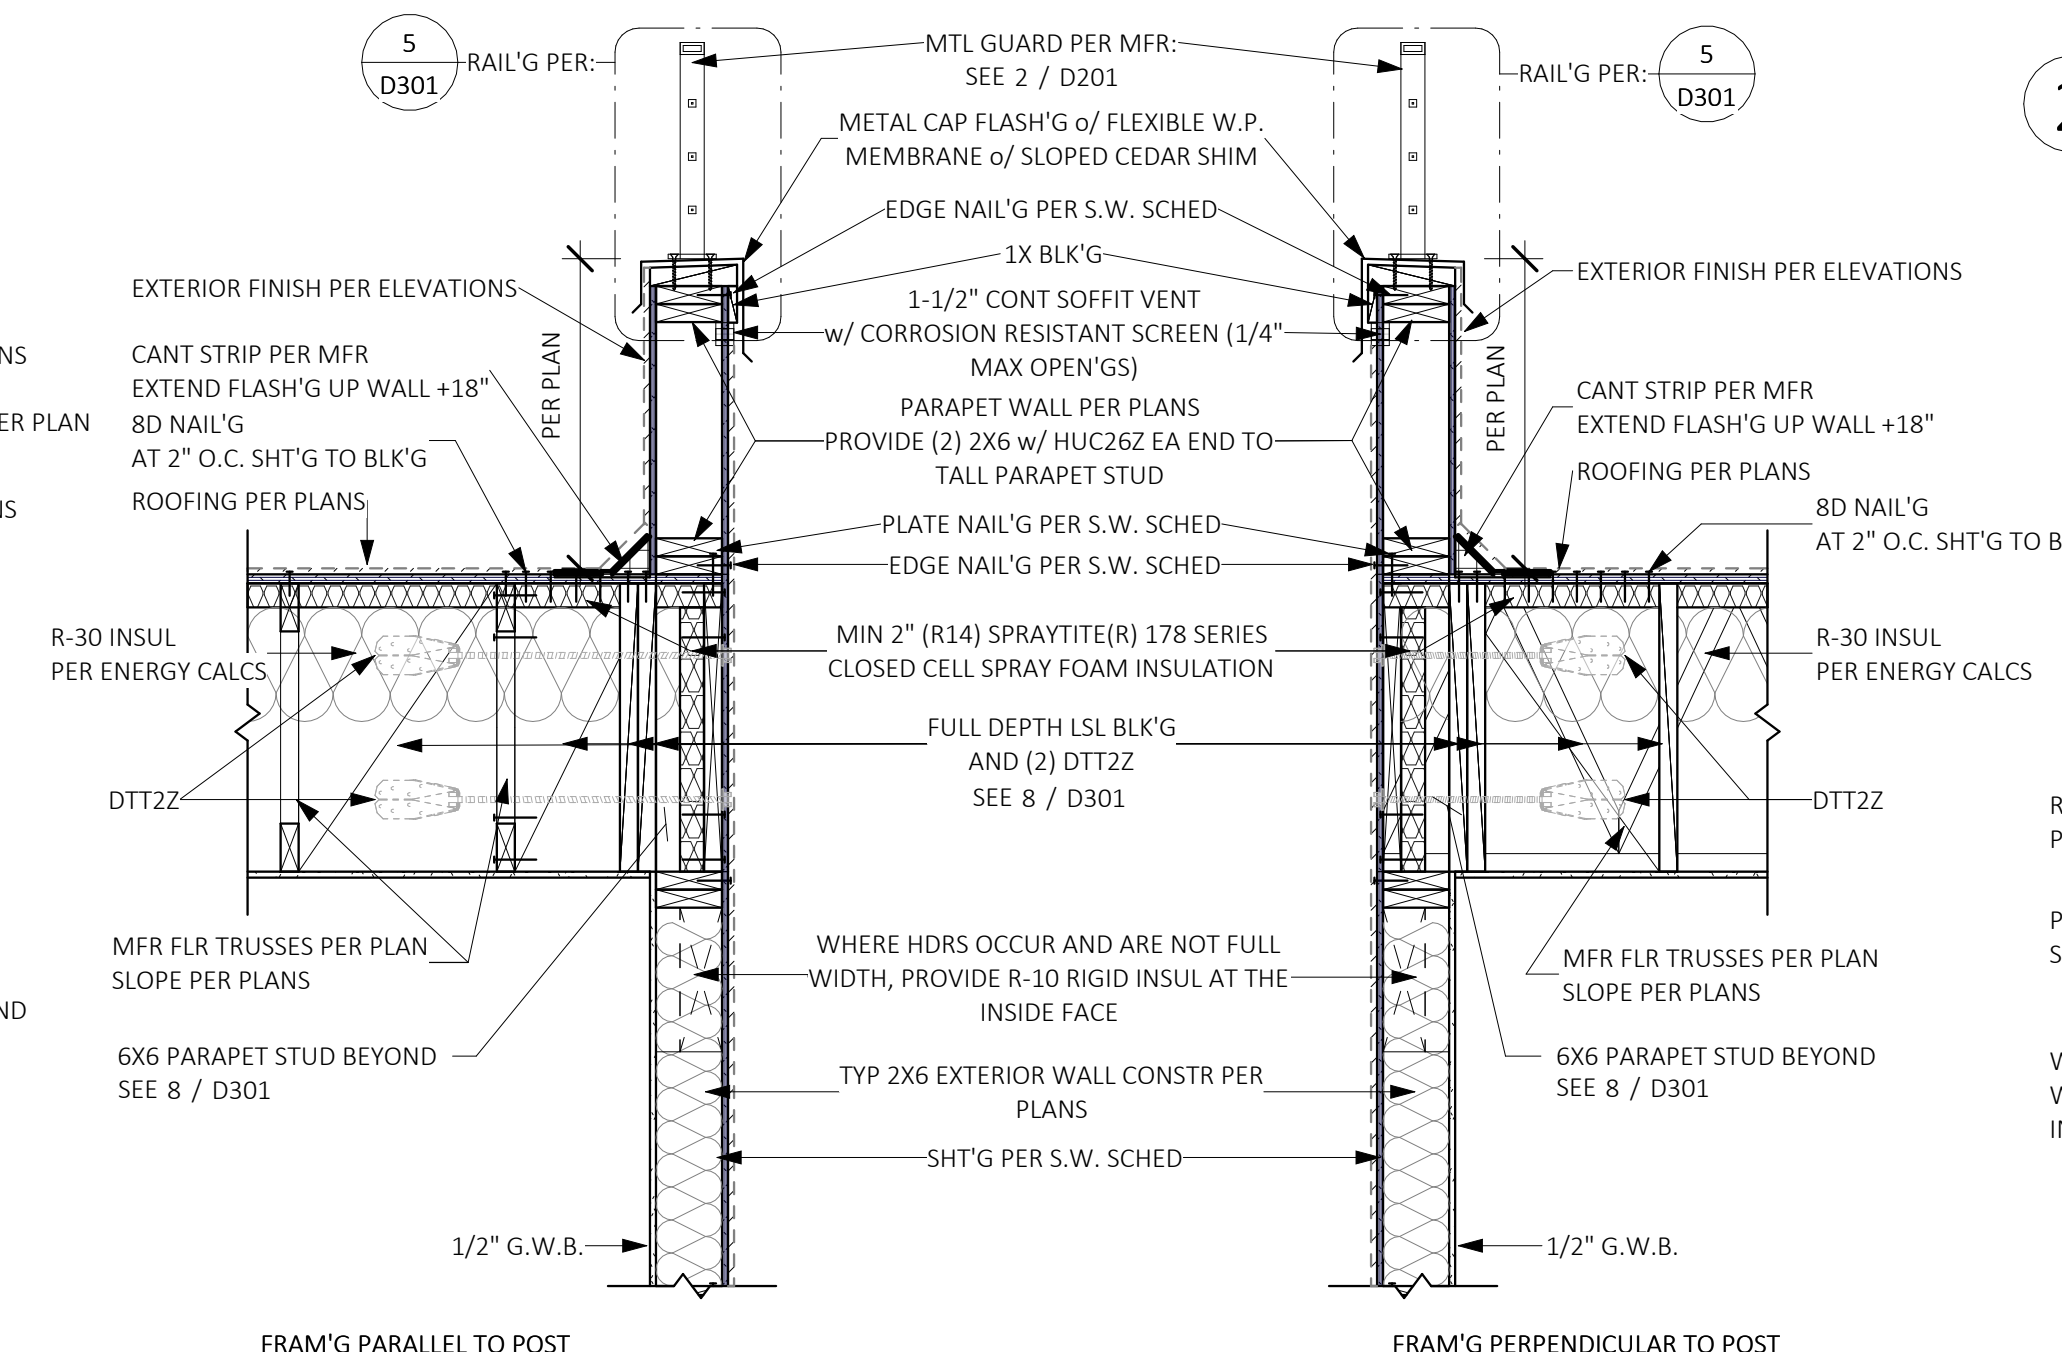


FRAM'G PARALLEL TO POST

FRAM'G PERPENDICULAR TO POST


4 PARAPET DETAIL

SCALE: 3/4" = 1'-0"

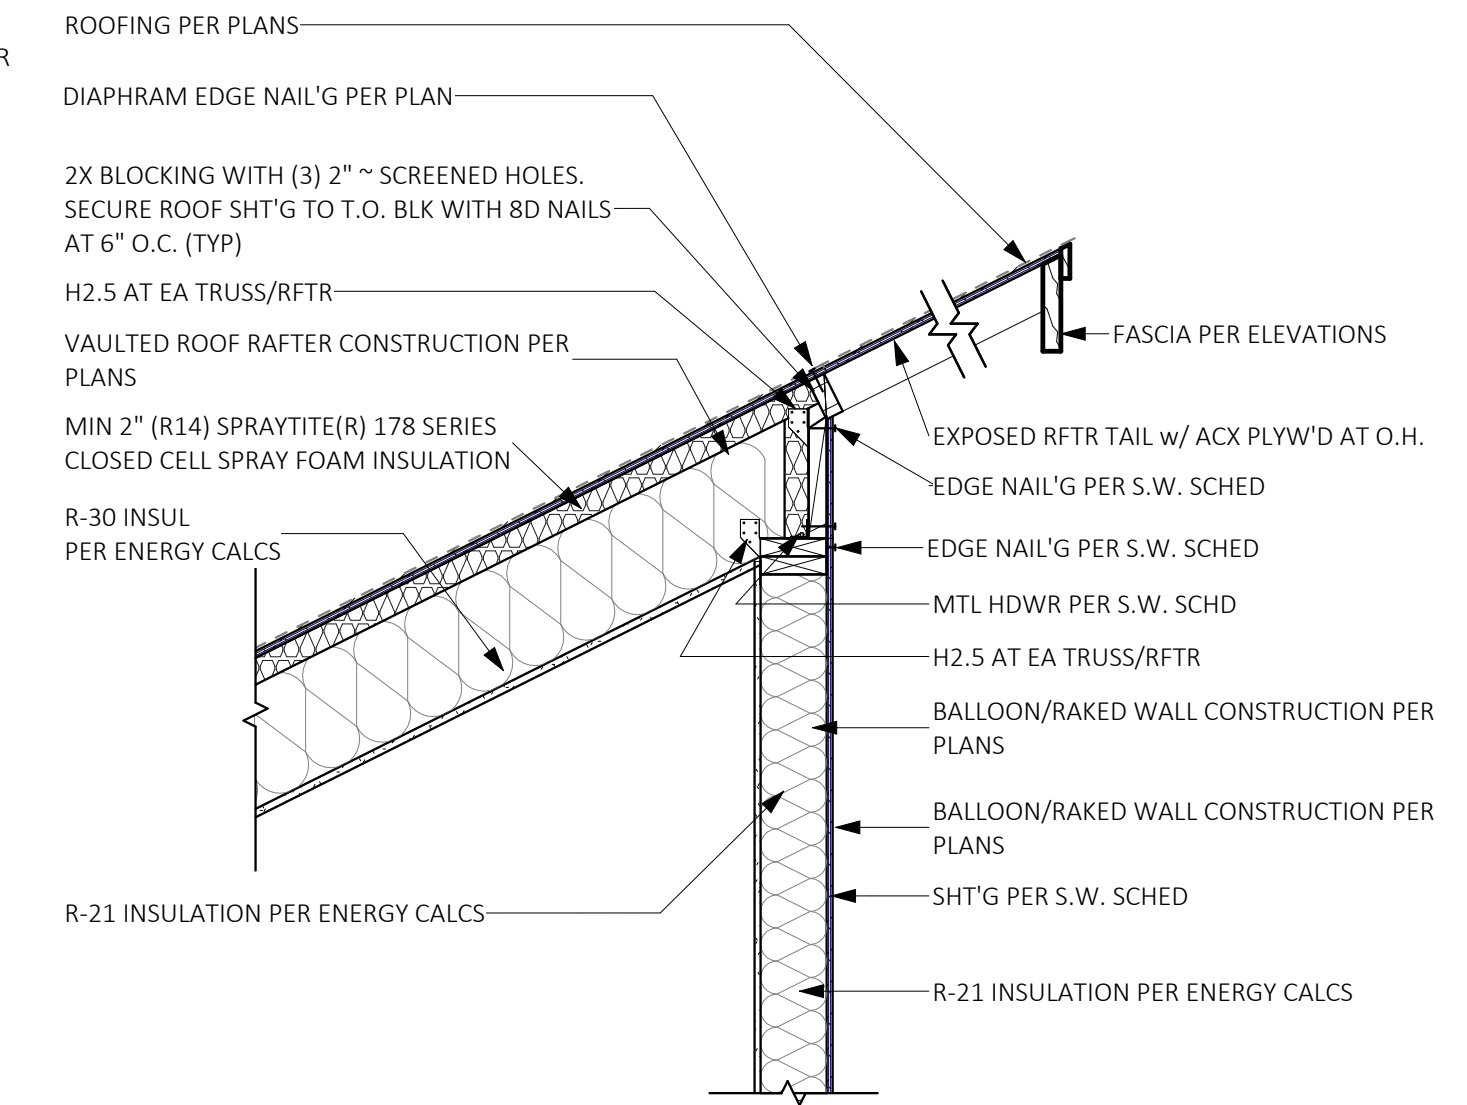


3 EAVE DETAIL - RAFTER

SCALE: 3/4" = 1'-0"

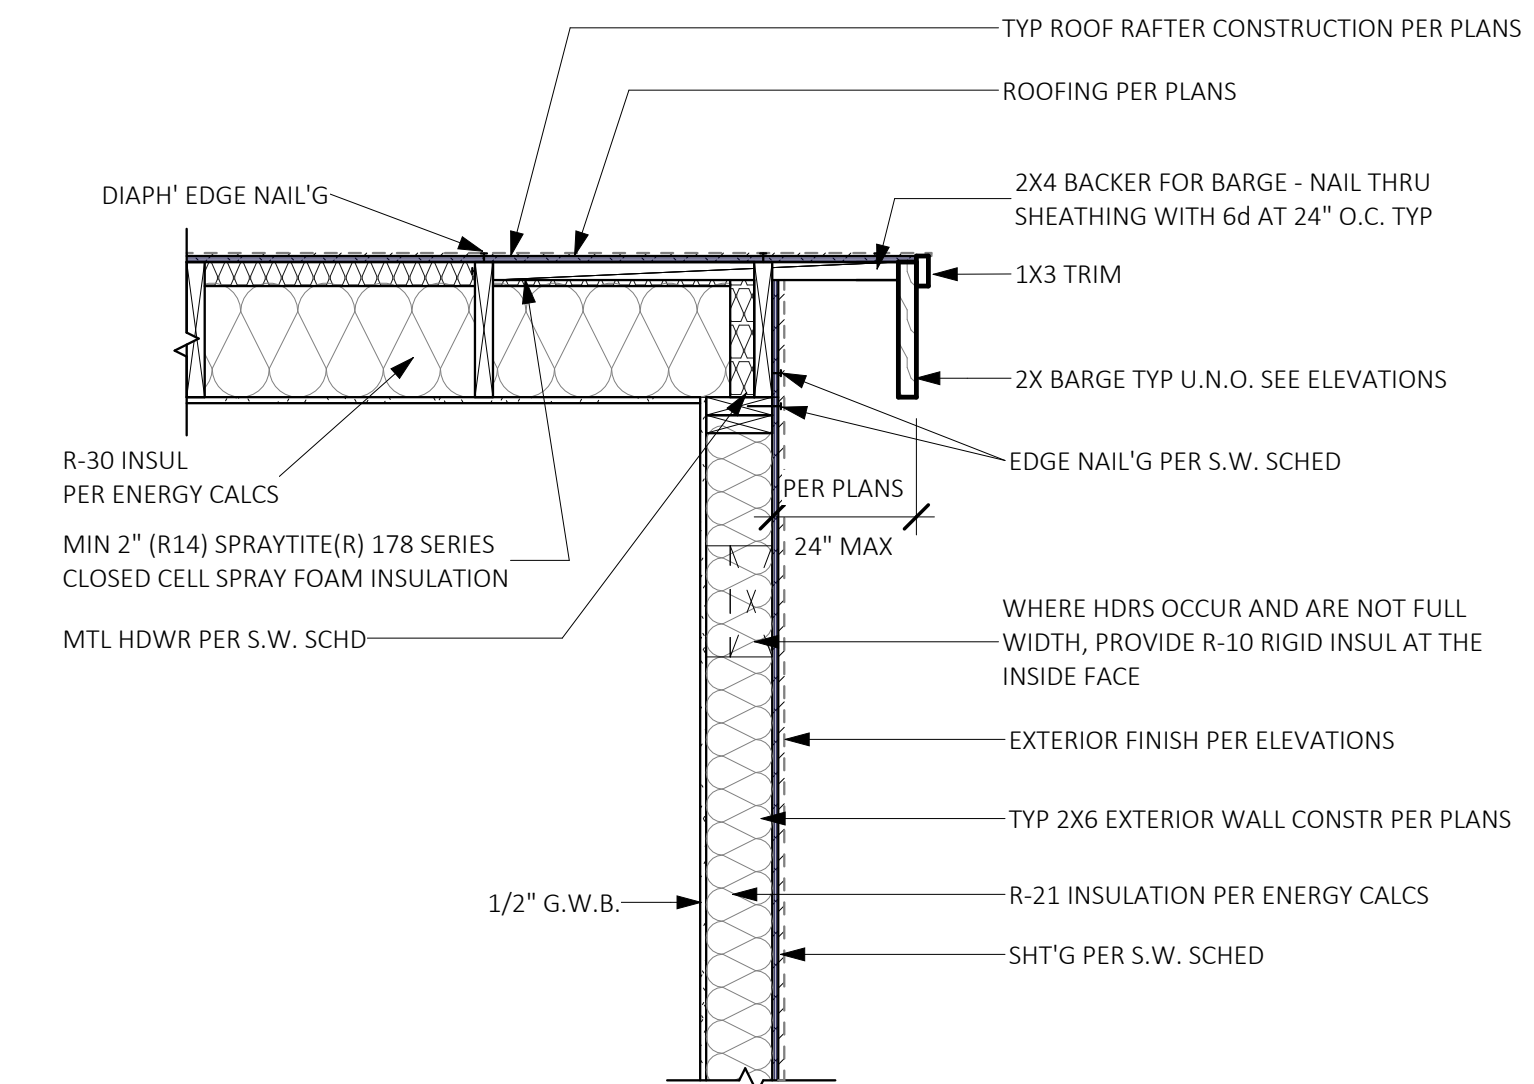

2 GABLE END DETAIL- VAULT'D RFTR

SCALE: 3/4" = 1'-0"

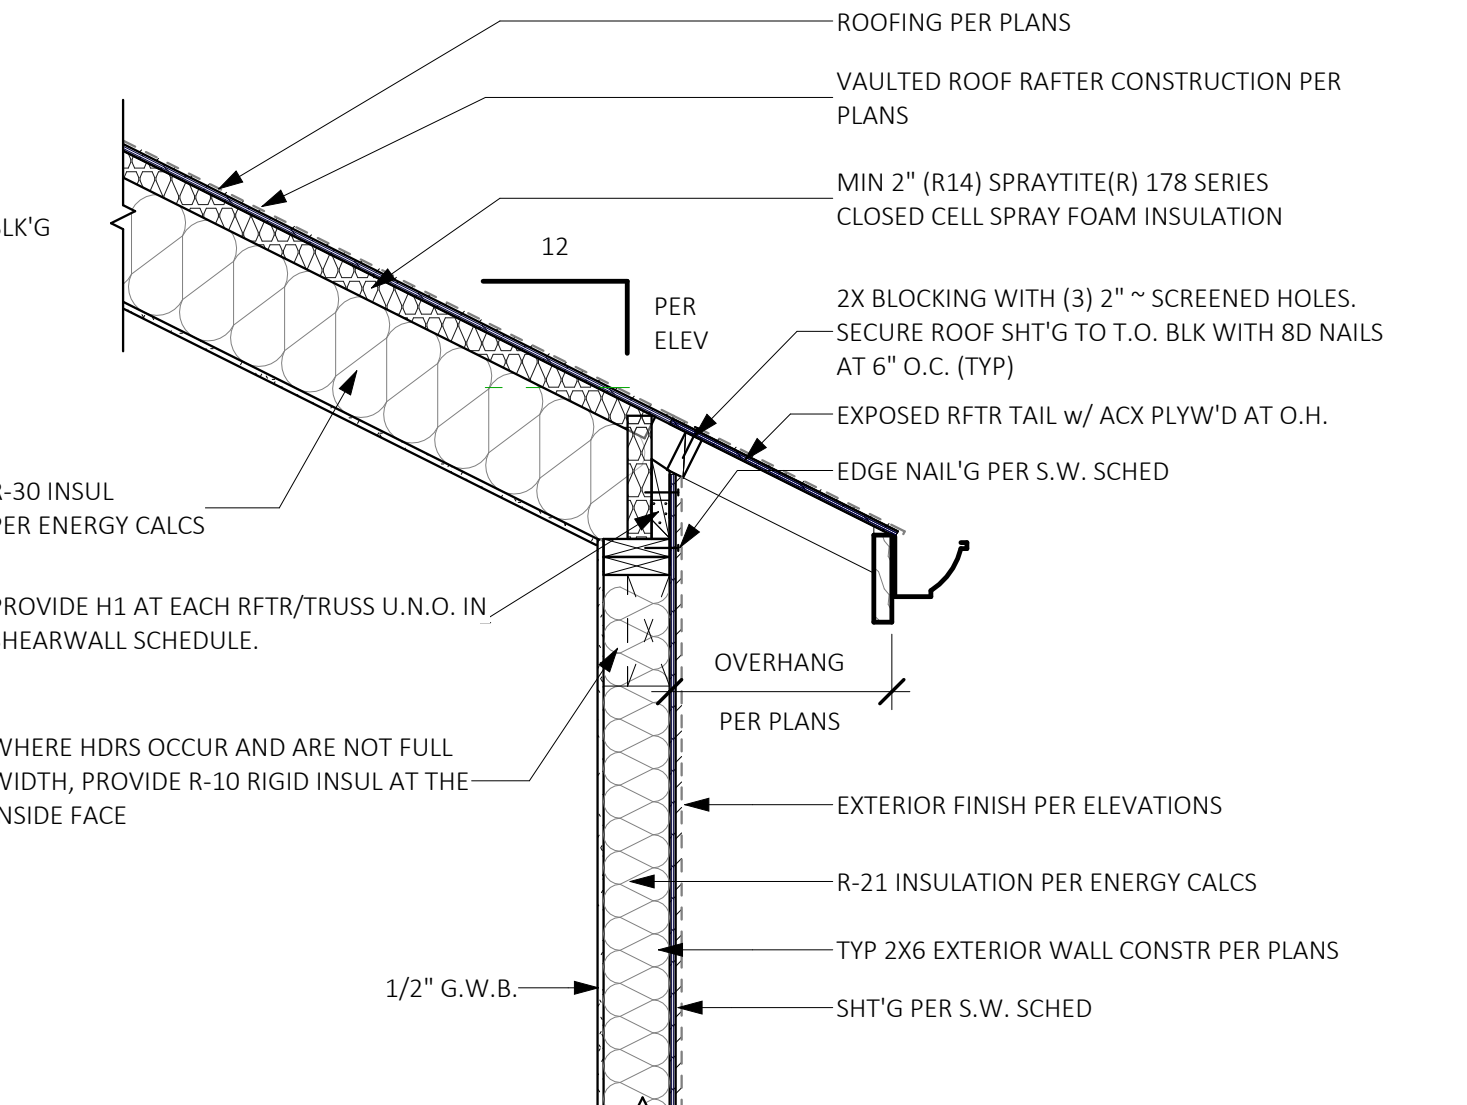

1 EAVE DETAIL - VAULTED RAFTER

SCALE: 3/4" = 1'-0"

Autodesk Docs/7/21014 Hu Residence, Mercer Island/21014.05CD, Hu Residence, Mercer Island.rvt 6/27/2022 10:04:27 AM

NOTE: THIS IS A STANDARD DETAILS SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

STANDARD DETAIL SHEET

COPYRIGHT

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

HU RESIDENCE
 2448 72nd AVE SE, Mercer Island

L2 ENGINEERS
 17848 NE 198TH PLAVE
 WOODINVILLE, WA 98072
 ATERA DESIGN STUDIO
 451 DUVAL AVE NE,
 RENTON, WA 98059

PROJECT NO: 21014
 ISSUE DATE: 2022/06/29
 DRAWN BY: SPM

D301
 SCALE 24X36: 3/4" = 1'-0"
 * NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

Description	Date	No.

STRUCTURAL NOTES

GENERAL REQUIREMENTS

BUILDING CODE & REFERENCE STANDARDS:

THE "INTERNATIONAL BUILDING CODE" (IBC), 2018 EDITION, AS ADOPTED AND MODIFIED BY THE CITY OF CITY, GOVERNS THE DESIGN AND CONSTRUCTION OF THIS PROJECT. REFERENCE TO A SPECIFIC SECTION IN THE CODE DOES NOT RELIEVE THE CONTRACTOR FROM COMPLIANCE WITH THE ENTIRE MATERIALS REFERENCE STANDARDS NOTED BELOW. THE LATEST EDITION OF THE MATERIALS REFERENCE STANDARDS SHALL BE USED.

SCOPE OF STRUCTURAL WORK:

STRUCTURAL DESIGN OF A NEW HOUSE.

DEFINITIONS:

THE FOLLOWING DEFINITIONS APPLY TO THESE GENERAL NOTES:

- "STRUCTURAL ENGINEER OF RECORD" (EOR) - THE STRUCTURAL ENGINEER WHO IS LEGALLY RESPONSIBLE FOR STAMPING & SIGNING THE STRUCTURAL DOCUMENTS FOR THE PROJECT. THE EOR IS RESPONSIBLE FOR THE DESIGN OF THE PRIMARY STRUCTURAL SYSTEM.
- "SPECIALTY STRUCTURAL ENGINEER" (SSE) - A LICENSED PROFESSIONAL ENGINEER, NOT THE EOR, WHO PERFORMS SPECIALTY STRUCTURAL ENGINEERING SERVICES NECESSARY TO COMPLETE THE STRUCTURE, WHO HAS EXPERIENCE AND TRAINING IN THE SPECIFIC SPECIALTY. THE GENERAL CONTRACTOR, SUBCONTRACTOR, OR SUPPLIER WHO IS RESPONSIBLE FOR THE DESIGN, FABRICATION AND INSTALLATION OF SPECIALTY-ENGINEERED ELEMENTS SHALL RETAIN THE SSE. SUBMITTALS SHALL BE STAMPED AND SIGNED BY THE SSE. DOCUMENTS STAMPED AND SIGNED BY THE SSE SHALL BE COMPLETED BY OR UNDER THE DIRECT SUPERVISION OF THE SSE WITH A PE OR SE LICENSE ISSUED BY THE STATE OF WASHINGTON.
- "DEFERRED SUBMITTALS - DEFERRED SUBMITTAL IS ENGINEERING WORK TO BE DESIGNED-BY-OTHERS OR BIDDER-DESIGNED.

NOTE PRIORITIES:

NOTES ON THE INDIVIDUAL DRAWINGS SHALL GOVERN OVER THESE GENERAL NOTES.

SPECIFICATIONS:

REFER TO THESE NOTES, STRUCTURAL DRAWINGS, AND ARCHITECTURAL DRAWINGS WHICH SERVE AS SPECIFICATIONS FOR THIS PROJECT.

STRUCTURAL DETAILS:

THE STRUCTURAL DRAWINGS ARE INTENDED TO SHOW THE GENERAL CHARACTER AND EXTENT OF THE PROJECT AND ARE NOT INTENDED TO SHOW ALL DETAILS OF THE WORK.

ARCHITECTURAL DRAWINGS:

REFER TO THE ARCHITECTURAL DRAWINGS FOR INFORMATION INCLUDING, BUT NOT LIMITED TO: DIMENSIONS, ELEVATIONS, SLOPES, DOOR AND WINDOW OPENINGS, NON-BEARING WALLS, CURTAIN WALLS, STAIRS, ELEVATORS, CURBS, DRAINS, DEPRESSIONS, RAILINGS, WATERPROOFING, FINISHES AND OTHER NONSTRUCTURAL ITEMS.

STRUCTURAL RESPONSIBILITIES:

THE EOR IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE PRIMARY STRUCTURE IN ITS COMPLETED STATE.

CONTRACTOR RESPONSIBILITIES:

THE CONTRACTOR IS RESPONSIBLE FOR THE MEANS AND METHODS OF CONSTRUCTION AND ALL JOB RELATED SAFETY STANDARDS SUCH AS OSHA AND WSHA. THE CONTRACTOR IS RESPONSIBLE FOR THE STRENGTH AND STABILITY OF THE STRUCTURE DURING CONSTRUCTION AND SHALL PROVIDE TEMPORARY SHORING, BRACING AND OTHER ELEMENTS REQUIRED TO MAINTAIN STABILITY UNTIL THE STRUCTURE IS COMPLETED. IT IS THE CONTRACTOR'S RESPONSIBILITY TO BE FAMILIAR WITH THE WORK REQUIRED IN THE CONSTRUCTION DOCUMENTS AND THE REQUIREMENTS FOR EXECUTING IT PROPERLY.

THE CONTRACTOR SHALL SUBMIT PLANS SHOWING THE LOCATION, WEIGHT, SIZE AND ANCHORAGE OF ALL HANGERS SUPPORTING ALL MECHANICAL, ELECTRICAL, PLUMBING OR SPRINKLER LOADS IN EXCESS OF 50 POUNDS. ALL ROOF-MOUNTED EQUIPMENT SHALL BE INCLUDED ON THESE PLANS AND SHALL SHOW THE WEIGHTS, SIZES, MOUNTING/ATTACHMENT DETAILS, AND LOCATIONS. SUBMIT PLANS TO THE EOR FOR REVIEW PRIOR TO INSTALLATION.

DISCREPANCIES:

IN CASE OF DISCREPANCIES BETWEEN THESE GENERAL NOTES, THE CONTRACT DRAWINGS AND SPECIFICATIONS, AND/OR REFERENCE STANDARDS, THE EOR SHALL DETERMINE WHICH SHALL GOVERN. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE EOR BEFORE PROCEEDING WITH THE WORK. ACCORDINGLY, ANY CONFLICT IN OR BETWEEN THE CONTRACT DOCUMENTS SHALL NOT BE A BASIS FOR ADJUSTMENT IN THE CONTRACT PRICE.

SITE VERIFICATION:

THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE PRIOR TO FABRICATION AND/OR CONSTRUCTION. CONFLICTS BETWEEN THE DRAWINGS AND ACTUAL SITE CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF THE EOR BEFORE PROCEEDING WITH THE WORK. ALL UNDERGROUND UTILITIES SHALL BE DETERMINED BY THE CONTRACTOR PRIOR TO EXCAVATION OR DRILLING.

ADJACENT UTILITIES:

THE CONTRACTOR SHALL DETERMINE THE LOCATIONS OF ALL ADJACENT UNDERGROUND UTILITIES PRIOR TO EXCAVATION. ANY UTILITY INFORMATION SHOWN ON THE DRAWINGS AND DETAILS IS APPROXIMATE AND NOT NECESSARILY COMPLETE.

DESIGN CRITERIA

CONSTRUCTION LOADS:

LOADS ON THE STRUCTURE DURING CONSTRUCTION SHALL NOT EXCEED THE DESIGN LOADS OR THE CAPACITY OF THE PARTIALLY COMPLETED CONSTRUCTION.

SNOW LOAD:

THE ROOF SNOW LOAD IS DETERMINED BY USING CHAPTER 7 OF ASCE 7-16 IN ACCORDANCE WITH IBC SECTION 1608 AND WITH THE FOLLOWING FACTORS:

MINIMUM ROOF DESIGN LOAD: **25 PSF WITHOUT DRIFT**
 GROUND SNOW LOAD, PG: **20 PSF**
 IMPORTANCE FACTOR, IS: **1.0**
 FLAT ROOF SNOW LOAD, PF: **25 PSF**
 THERMAL FACTOR, CT: **1.0**

WIND DESIGN:

WIND LOAD IS DETERMINED USING CHAPTER 28 OF ASCE 7-16 IN ACCORDANCE WITH IBC SECTION 1609 WITH THE FOLLOWING FACTORS:

BASIC WIND SPEED V = **97 MPH**
 WIND IMPORTANCE FACTOR IW = **1.0**
 EXPOSURE CATEGORY = **B**
 RISK CATEGORY = **II**
 KZT = **1.6**

SEISMIC DESIGN:

EARTHQUAKE DESIGN IS DETERMINED USING CHAPTER 12 ASCE 7-16 IN ACCORDANCE WITH IBC CHAPTER 16 WITH THE FOLLOWING FACTORS:

IMPORTANCE FACTOR IE = **1.0**
 RISK CATEGORY = **II**
 SS = **1.395 G**
 SI = **0.486 G**
 SITE CLASS = **D**
 SDS = **1.116 G**
 SDI = **0.590 G**
 SEISMIC DESIGN CATEGORY = **D**

WOOD STRUCTURE (SUPER-STRUCTURE):

BASIC SEISMIC FORCE RESISTING SYSTEM: A-15 (BEARING WALL SYSTEMS) LIGHT-FRAMED WALLS WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR RESISTANCE

ANALYSIS PROCEDURE: EQUIVALENT LATERAL FORCE PROCEDURE, PER ASCE 7-10, SECTION 12.8

R = **6.5**
 CS = **0.172**
 CD = **4**
 W = **122K**
 Q = **2.5+**
 P = **1.3**

DESIGN BASE SHEAR:

DESIGN BASE SHEAR (WIND GOVERNED), V(LULT) = **15.86 (N/S)**, V(ASD) = **6.4 (E/W)**

DEFLECTIONS:

FLOOR TOTAL LOAD DEFLECTION LIMIT: **1/360**
 FLOOR LIVE LOAD DEFLECTION LIMIT: **1/480**
 ROOF TOTAL LOAD DEFLECTION LIMIT: **1/240**
 ROOF LIVE LOAD DEFLECTION LIMIT: **1/360**

LIVE LOADS: (HOUSE)

ROOF (LIVE): **20 PSF**
 ROOF (SNOW): **25 PSF**
 BALCONIES AND DECKS: **1.5X OCCUPANCY SERVED**
 RESIDENTIAL FLOOR: **40 PSF**
 RESIDENTIAL GARAGE: **40 PSF**
 STAIRS & LANDINGS: **40 PSF OR 300LB (4"x4" SQB)**
 GUARD RAILS: **50 PLF**

DEFERRED SUBMITTAL LOADS:

ALL PRE-ENGINEERED, PRE-FABRICATED, PRE-MANUFACTURED, OR OTHER PRODUCTS DESIGNED BY OTHERS SHALL BE DESIGNED FOR THE TRIBUTARY DEAD AND LIVE LOADS PLUS WIND, EARTHQUAKE, AND COMPONENT, AND CLADDING LOADS WHEN APPLICABLE. DESIGN SHALL CONFORM TO THE PROJECT DRAWINGS AND SPECIFICATIONS, REFERENCE STANDARDS, AND GOVERNING.

ROOF DEAD LOAD: **15 PSF**
 ROOF SNOW LOAD: **25 PSF**
 FLOOR DEAD LOAD: **15 PSF**
 FLOOR LIVE LOAD: **40 PSF**
 STAIRS & LANDINGS: **40 PSF OR 300LB (4"x4" SQB)**
 GUARD RAILS: **50 PLF OR 200 LB POINT LOAD**

SUBMITTALS

SHOP DRAWINGS SHALL BE SUBMITTED TO THE DESIGNER/EOR PRIOR TO ANY FABRICATION OR CONSTRUCTION FOR ALL STRUCTURAL ITEMS AS NOTED BELOW. THE CONTRACTOR SHALL REVIEW AND PLACE A SHOP DRAWINGS STAMP ON THE SUBMITTAL BEFORE FORWARDING TO THE EOR. SUBMITTALS SHALL BE MADE IN TIME TO PROVIDE A MINIMUM OF ONE WEEK FOR REVIEW BY THE EOR. ADDITIONAL SUBMITTALS REQUIRED FOR THIS PROJECT ARE SPECIFIED IN THE SPECIFIC SECTIONS BELOW.

REFERENCE THE INDIVIDUAL MATERIAL SECTION FOR SPECIFIC INFORMATION TO BE INCLUDED IN THE SUBMITTAL. IF THE SHOP DRAWINGS DIFFER FROM OR ADD TO THE DESIGN OF THE STRUCTURAL DRAWINGS, THEY SHALL BEAR THE SEAL AND SIGNATURE OF THE WASHINGTON STATE REGISTERED PROFESSIONAL ENGINEER WHO IS RESPONSIBLE FOR THE DESIGN.

- CONCRETE REINFORCING
- EMBEDDED STEEL ITEMS
- GLULAM BEAMS
- TJI'S

ALTERNATES:

PRODUCT OR MANUFACTURER COMPONENTS SPECIFIED IN THESE DRAWINGS ARE USED AS THE BASIS OF DESIGN FOR THIS PROJECT. ALTERNATES FOR SPECIFIED ITEMS MAY BE SUBMITTED TO THE EOR FOR REVIEW. HOWEVER, CONTRACTOR SHALL SUBMIT A CURRENT ICC-ESR/IAPMO-ER REPORT IDENTIFYING THAT AN ALTERNATIVE COMPONENT HAS THE SAME OR GREATER LOAD CAPACITY THAN THE SPECIFIED ITEM.

SHOP DRAWING REVIEW:

REVIEW BY THE DESIGNER/EOR IS FOR GENERAL COMPLIANCE WITH THE DESIGN CONCEPT AND THE CONTRACT DOCUMENTS. DIMENSIONS AND QUANTITIES ARE NOT REVIEWED BY THE EOR, AND THEREFORE, MUST BE VERIFIED BY THE GENERAL CONTRACTOR. MARKINGS OR COMMENTS SHALL NOT BE CONSTRUED AS RELIEVING THE CONTRACTOR FROM COMPLIANCE WITH THE PROJECT PLANS AND SPECIFICATIONS, NOR DEPARTURES THEREFROM.

THE CONTRACTOR REMAINS RESPONSIBLE FOR DETAILS AND ACCURACY; FOR CONFIRMING AND CORRELATING ALL QUANTITIES AND DIMENSIONS; FOR SELECTING FABRICATION PROCESSES; FOR TECHNIQUES OF ASSEMBLY; AND FOR PERFORMING WORK IN A SECURE MANNER. WHEN SHOP DRAWINGS (COMPONENT DESIGN DRAWINGS) DIFFER FROM OR ADD TO THE REQUIREMENTS OF THE STRUCTURAL DRAWINGS THEY SHALL BE DESIGNED AND STAMPED BY THE RESPONSIBLE SSE. ALLOW ONE WEEK FOR EOR REVIEW TIME.

DEFERRED SUBMITTALS:

PER IBC SECTION 107.3.4.1, DRAWINGS, CALCULATIONS, AND PRODUCT DATA FOR THE DESIGN AND FABRICATION OF ITEMS THAT ARE DESIGNED-BY-OTHERS SHALL BEAR THE SEAL AND SIGNATURE OF THE WASHINGTON STATE REGISTERED PROFESSIONAL ENGINEER (SSE) WHO IS RESPONSIBLE FOR THE DESIGN AND SHALL BE SUBMITTED TO THE ARCHITECT/EOR AND THE BUILDING DEPARTMENT FOR REVIEW PRIOR TO FABRICATION. ALLOW ONE WEEK FOR EOR REVIEW TIME.

THE SSE SHALL SUBMIT STAMPED AND SIGNED CALCULATIONS AND SHOP DRAWINGS TO THE EOR FOR REVIEW. REVIEW OF THE SSE'S SHOP DRAWINGS IS FOR GENERAL COMPLIANCE WITH DESIGN CRITERIA AND COMPATIBILITY WITH THE DESIGN OF THE PRIMARY STRUCTURE AND DOES NOT RELIEVE THE SSE OF RESPONSIBILITY FOR THAT DESIGN. ALL NECESSARY BRACING, TIES, ANCHORAGE, AND PROPRIETARY PRODUCTS SHALL BE FURNISHED AND INSTALLED PER MANUFACTURER'S INSTRUCTIONS OR THE SSE'S DESIGN DRAWINGS AND CALCULATIONS. SUBMITTED DRAWINGS SHALL INDICATE ALL REACTION FORCES IMPARTED TO THE PRIMARY STRUCTURE. THE DESIGN OF THE CONNECTION TO THE PRIMARY STRUCTURE IS THE RESPONSIBILITY OF THE SUPPLIER AND SSE. SUBSEQUENT TO EOR REVIEW, EOR WILL FORWARD DEFERRED SUBMITTAL DOCUMENTS TO THE BUILDING OFFICIAL WITH NOTATION INDICATING THAT THE DOCUMENTS HAVE BEEN FOUND TO BE IN GENERAL CONFORMANCE TO THE DESIGN OF THE BUILDING.

DEFERRED SUBMITTALS INCLUDE THE FOLLOWING:

- HANDRAILS & GUARDRAILS
- PREFABRICATED WOOD TRUSSES
- PREFABRICATED METAL STAIRS
- OPEN WEB WOOD JOISTS

COMPONENTS:

ACCORDANCE WITH ASCE 7-10, CHAPTER 13 AND THE PROJECT SPECIFICATIONS. NONSTRUCTURAL COMPONENTS DESIGNED BY OTHERS SHALL NOT INDUCE TORSIONAL LOADING INTO SUPPORTING STEEL STRUCTURAL MEMBERS WITHOUT ADDITIONAL BRACING OF THOSE MEMBERS TO ELIMINATE TORSIONAL FORCES. TORSIONAL BRACING SHALL BE DESIGNED BY THE STRUCTURAL COMPONENT DESIGNER AND APPROVED BY THE EOR. ANCHORAGE TO THE PRIMARY STRUCTURE IS PER THE BIDDER-DESIGN CONTRACTOR OR SUPPLIER.

TESTS & INSPECTIONS INSPECTIONS:

ALL CONSTRUCTION IS SUBJECT TO INSPECTION BY THE BUILDING OFFICIAL IN ACCORDANCE WITH IBC SEC 110. THE CONTRACTOR SHALL COORDINATE ALL REQUIRED INSPECTIONS WITH THE BUILDING OFFICIAL. SUBMIT COPIES OF ALL INSPECTION REPORTS TO THE ARCHITECT/EOR FOR REVIEW. THE BUILDING OFFICIAL MAY ACCEPT INSPECTION OF AND REPORTS BY APPROVED INSPECTION AGENCIES IN LIEU OF BUILDING OFFICIAL'S INSPECTIONS. THE CONTRACTOR SHALL OBTAIN APPROVAL OF BUILDING OFFICIAL TO USE THE THIRD-PARTY INSPECTION AGENCY AND CONTRACTOR SHALL ALERT THE ARCHITECT/EOR AS SUCH.

SOILS AND FOUNDATIONS

REFERENCE STANDARDS:

CONFORM TO IBC CHAPTER 18 "SOILS AND FOUNDATIONS."

GEOTECHNICAL REPORT:

RECOMMENDATIONS CONTAINED IN:

- GEOTECHNICAL ENGINEERING STUDY BY: GEOTECH CONSULTANTS, INC. MEMO "FOUNDATION AND CRITICAL AREA CONSIDERATIONS, AND INFILTRATION FEASIBILITY ASSESSMENT" PROPOSED NEW RESIDENCE 2448 - 72ND AVE SE, MERCER ISLAND, WASHINGTON, DATED JANUARY 12, 2022

GEOTECHNICAL INSPECTION:

SITE SOIL CONDITIONS, FILL PLACEMENT, AND LOAD-BEARING REQUIREMENTS SHALL BE AS REQUIRED BY SECTION 1705.6 AND TABLE 1705.6. ASSUMED VALUES SHALL BE FIELD VERIFIED BY THE BUILDING OFFICIAL PRIOR TO PLACING CONCRETE. THE BUILDING OFFICIAL SHALL BE PERMITTED TO WAIVE THE REQUIREMENT FOR A GEOTECHNICAL INVESTIGATION WHERE SATISFACTORY DATA FROM ADJACENT AREA IS AVAILABLE THAT DEMONSTRATES AN INVESTIGATION IS NOT NECESSARY FOR ANY OF THE CONDITIONS IN SECTIONS 1803.5.1 - 1803.5.6 AND SECTIONS 1803.5.10 - 1803.5.11.

DESIGN SOIL VALUES:

ALLOWABLE SOIL BEARING PRESSURE

2,500 PSF DL + LL
3,332 PSF DL + LL + SEISMIC/WIND

PASSIVE PRESSURE: **250 PCF**

ACTIVE PRESSURE: **35 PCF**

COEFFICIENT OF FRICTION: **0.4**

SLABS ON-GRADE & FOUNDATIONS:

ALL SLABS-ON-GRADE AND FOUNDATIONS SHALL BEAR ON STRUCTURAL COMPACTED FILL OR COMPETENT NATIVE SOIL PER THE GEOTECHNICAL REPORT OR AS NOTED IN THESE DOCUMENTS. EXTERIOR PERIMETER FOOTINGS SHALL BEAR NOT LESS THAN 18 INCHES BELOW FINISH GRADE, OR AS REQUIRED BY THE GEOTECHNICAL ENGINEER AND THE BUILDING OFFICIAL. INTERIOR FOOTINGS SHALL BEAR NOT LESS THAN 12 INCHES BELOW FINISH FLOOR.

FOUNDATION STEM WALLS:

UNLESS OTHERWISE NOTED ON THE DRAWINGS, THE MAXIMUM UNBALANCED SOIL CONDITION FOR ALL FOUNDATION STEM WALLS (DIFFERENCE IN ELEVATION BETWEEN INTERIOR AND EXTERIOR SOIL GRADES) SHALL BE 2'-6". MAINTAIN A MINIMUM 8" SEPARATION BETWEEN FINISH GRADE AND UNTREATED WOOD FRAMING.

BACKFILLING:

BACKFILL BEHIND RETAINING AND FOUNDATION WALLS SHALL BE OF FREE-DRAINING MATERIAL PLACED IN MAXIMUM LOOSE LIFTS OF 12" OR AS DIRECTED BY THE GEOTECHNICAL REPORT. BACKFILL BEHIND WALLS SHALL NOT BE PLACED BEFORE THE WALL IS PROPERLY SUPPORTED BY THE FLOOR SLAB OR TEMPORARY BRACING. BACKFILL SHALL BE COMPACTED USING HAND-OPERATED EQUIPMENT ONLY. THE CONTRACTOR SHALL REFRAIN FROM OPERATING HEAVY EQUIPMENT BEHIND RETAINING AND FOUNDATION WALLS WITHIN A DISTANCE EQUAL TO OR GREATER THAN THE HEIGHT OF THE WALL, UNLESS OTHERWISE APPROVED BY THE EOR. ALL TOPSOIL ORGANICS AND LOOSE SURFACE SOIL SHALL BE REMOVED FROM BENEATH FILL SUPPORTING CONCRETE SLAB OR PAVING.

CAST-IN-PLACE CONCRETE REFERENCE STANDARDS:

CONFORMS TO THE LATEST EDITIONS OF THE FOLLOWING: (1) ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE AND COMMENTARY". (2) IBC CHAPTER 19.

FIELD REFERENCE:

THE CONTRACTOR SHALL KEEP A COPY OF ACI FIELD REFERENCE MANUAL, SP-15, "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE (ACI 301) WITH SELECTED ACI AND ASTM REFERENCES."

CONCRETE MIXTURES:

CONFORM TO ACI 318 CHAPTER 19 " CONCRETE: DESIGN AND DURABILITY REQUIREMENTS. "

MATERIALS:

CONFORM TO ACI 318 CHAPTERS 19 & 20.

SUBMITTALS:

PROVIDE ALL SUBMITTALS REQUIRED BY ACI 301 SEC 4.1.2. SUBMIT MIX DESIGNS FOR EACH MIX IN THE TABLE BELOW.

SPECIAL INSPECTIONS:

IN ADDITION TO THE INSPECTIONS REQUIRED BY IBC SEC 110, A SPECIAL INSPECTOR SHALL BE HIRED BY THE OWNER AS AN INDEPENDENT THIRD-PARTY INSPECTOR TO PERFORM THE SPECIAL INSPECTIONS PER IBC CH. 17. SPECIAL INSPECTIONS SHALL BE PERFORMED BY AN APPROVED TESTING AGENCY AS OUTLINED IN THE SPECIAL INSPECTION SCHEDULE, THE CONTRACT DOCUMENTS, AND/OR THE PROJECT SPECIFICATION. SPECIAL INSPECTIONS SHALL MEET THE REQUIREMENTS OUTLINES IN THE SPECIFIC MATERIALS SECTIONS OF IBC SEC 1705. THE CONTRACTOR IS RESPONSIBLE FOR SCHEDULING THE INSPECTIONS, PER THE CITY/BUILDING OFFICIAL.

PREFABRICATED CONSTRUCTION:


ALL PREFABRICATED CONSTRUCTION SHALL CONFORM TO THE INSPECTION REQUIREMENTS OF THE SAME MATERIAL OR CONSTRUCTION TYPE USED FOR THIS PROJECT.

SPECIAL INSPECTIONS SHALL BE PERFORMED PER THE STRUCTURAL INSPECTION SCHEDULE:					
ITEM	CI	PI	REFERENCE STANDARD	IBC REFERENCE	REMARKS
CONCRETE					
1. INSPECT REINFORCEMENT, INCLUDING PRESTRESSING TENDONS, AND VERIFY PLACEMENT.		X	ACI 318 CH 20, 25.2, 25.3, 26.6.1-26.6.3	1908.4	
2. REINFORCING BAR WELDING					
A. VERIFY WELDABILITY OF REINFORCING BARS OTHER THAN ASTM A706:		X	AWS D1.4, ACI 318: 26.6.4		
B. INSPECT SINGLE-PASS FILLET WELDS, MAXIMUM 5/16"; AND		X			
C. INSPECT ALL OTHER WELDS.		X			
3. INSPECT ANCHORS CAST IN CONCRETE.		X	ACI 318: 17.8.2		
4. INSPECT ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS					
A. ADHESIVE ANCHORS INSTALLED IN HORIZONTALLY OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED		X	ACI 318:17.8.2.4		
B. MECHANICAL ANCHORS AND ADHESIVE ANCHORS NOT DEFINED IN 4.A.		X	ACI 318: 17.8.2		
5. VERIFY USE OF REQUIRED DESIGN MIX.		X	ACI 318: CH 19, 26.4.3, 26.4.4	1904.1, 1904.2, 1908.2, 1908.3	
6. PRIOR TO CONCRETE PLACEMENT, FABRICATE SPECIMENS FOR STRENGTH TESTS, PERFORM SLUMP AND AIR CONTENT TESTS.		X	ASTM C172, ASTM C31, ACI 318: 26.4, 26.12	1908.10	
7. INSPECT CONCRETE AND SHOTCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES.		X	ACI 318: 26.5	1908.6, 1908.7, 1908.8	
8. VERIFY MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.		X	ACI: 26.5.3-26.5.5	1908.9	
9. INSPECT FORMWORK FOR SHAPE, LOCATION, AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.		X	ACI 318: 26.11.1.2(B)		
SOILS					
1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.		X			ADDITIONAL REQUIREMENTS PER SOILS REPORT AND AS REQUIRED BY GEOTECHNICAL ENGINEER OF RECORD
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.		X			
3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS.		X			
4. VERIFY USE OF PROPER MATERIALS, DENSITIES, AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF		X			
5. PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED		X			
WOOD					
1. FABRICATION OF HIGH-LOAD DIAPHRAGMS.					1705.5.1
A. VERIFY STRUCTURAL PANEL GRADE AND THICKNESS		X			
B. VERIFY NOMINAL SIZE OF FRAMING MEMBERS AT ADJOINING PANEL EDGES.		X			
C. VERIFY NAIL OR STAPLE DIAMETER AND LENGTH, NUMBER OF FASTENER LINES, AND SPACING BETWEEN		X			
2. SCREW ATTACHMENT, BOLTING, ANCHORING, AND OTHER FASTENING OF COMPONENTS WITHIN THE MAIN LATERAL		X			ONLY APPLIES TO GLUING OPERATIONS
3. FIELD GLUING OPERATIONS OF ELEMENTS OF THE MAIN LATERAL RESISTING SYSTEMS.		X			
SCHEDULE NOTES:					
1. ITEMS MARKED WITH AN 'X' REQUIRE INSPECTION BY A SPECIAL INSPECTOR APPROVED BY THE BUILDING OFFICIAL.					
2. CI: CONTINUOUS INSPECTION DURING PROGRESS OF WORK BY SPECIAL INSPECTOR.					
3. PI: PERIODIC INSPECTION BY SPECIAL INSPECTOR AS REQUIRED FOR CONFORMANCE OF WORK.					
4. TESTING AND INSPECTION REPORTS SHALL BE SUBMITTED TO THE OWNER, BUILDING OFFICIAL, AND CONTRACTOR.					



06/29/2022

L2 ENGINEERS
 17848 NE 198TH PLAVE
 WOODINVILLE, WA 98072



ATERA DESIGN STUDIO
 451 DUVALL AVE NE,
 RENTON, W A 98059

HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET

STRUCTURAL NOTES & DETAILS

PROJECT NO: 21014
 ISSUE DATE: 2022/06/29
 DRAWN BY: SPM

S001

SCALE 24X36:
 * NOTE: 11X17 SETS ARE REDUCED 50%; SCALE DRAWINGS ACCORDINGLY.



TABLE OF MIX DESIGN REQUIREMENTS

MEMBER TYPE/LOCATION	STRENGTH	TEST AGE	MAXIMUM AGGREGATE	EXPOSURE CLASSIFICATION	MAXIMUM W/C RATIO	MINIMUM AIR CONTENT
FOUNDATIONS, RETAINING WALLS, AND THEIR FOOTINGS:	4,500 PSI	28	1"	F2, C0	0.45	4.5%
EXTERIOR SLABS-ON-GRADE:	5,000 PSI	28	1"	F3, C2	0.40	6.0%

MIX DESIGN NOTES:

- W/C RATIO:** WATER-CEMENTITIOUS MATERIAL RATIOS SHALL BE BASED ON THE TOTAL WEIGHT OF CEMENTITIOUS MATERIALS. RATIOS NOT SHOWN IN THE TABLE ABOVE ARE CONTROLLED BY STRENGTH REQUIREMENTS.
- CEMENTITIOUS CONTENT:**
 - THE USE OF FLY ASH, OTHER POZZOLANS, SILICA FUME, OR SLAG SHALL CONFORM TO ACI 301 SEC 4.2.2.2. MAXIMUM AMOUNT OF FLY ASH SHALL BE 20% OF TOTAL CEMENTITIOUS CONTENT UNLESS REVIEWED AND APPROVED OTHERWISE BY EOR.
- AIR CONTENT:** CONFORM TO ACI 301 SEC 4.2.2.4. HORIZONTAL EXTERIOR SURFACES IN CONTACT WITH THE SOIL REQUIRE ENTRAINED AIR. USE EXPOSURE CATEGORY F0, S0, W0, AND C0 UNLESS NOTED OTHERWISE. TOLERANCE IS +/- 1.5%. AIR CONTENT SHALL BE MEASURED AT POINT OF PLACEMENT.
- EXPOSURE CLASSIFICATION:** THE MIX DESIGN PROVIDED SHALL MEET THE REQUIREMENTS OF ACI 318 CHAPTER 19, BASED ON THE EXPOSURE CLASSIFICATION INDICATED IN THE TABLE ABOVE.
- SLUMP:** UNLESS OTHERWISE SPECIFIED OR PERMITTED, CONCRETE SHALL HAVE AT THE POINT OF DELIVERY, A SLUMP OF 4" +/- 1". FOR ADDITIONAL CRITERIA, REFERENCE ACI 301 SEC 4.2.2.2.
- NON-CHLORIDE ACCELERATOR:** NON-CHLORIDE ACCELERATING ADMIXTURE MAY BE USED IN CONCRETE SLABS PLACED AT AMBIENT TEMPERATURES BELOW 50F AT THE CONTRACTOR'S OPTION.

FORMWORK:
CONFORM TO ACI 301 SEC 2 "FORMWORK AND FORM ACCESSORIES." REMOVAL OF FORMS SHALL CONFORM TO SEC 2.3.2 EXCEPT STRENGTH INDICATED IN SEC 2.3.2.5 SHALL BE 0.75 F'C.

MEASURING, MIXING, AND DELIVERY:
CONFORM TO ACI 301 SEC 4.3.

HANDLING, PLACING, CONSTRUCTING, AND CURING:
CONFORM TO ACI 301 SEC 5.

EMBEDDED ITEMS:
POSITION AND SECURE IN PLACE EXPANSION JOINT MATERIAL, ANCHORS AND OTHER STRUCTURAL AND NON-STRUCTURAL EMBEDDED ITEMS BEFORE PLACING CONCRETE. CONTRACTOR SHALL REFER TO MECHANICAL, ELECTRICAL, PLUMBING, AND ARCHITECTURAL DRAWINGS AND COORDINATE ALL OTHER EMBEDDED ITEMS.

TESTING AND ACCEPTANCE:
TESTING: OBTAIN SAMPLES AND CONDUCT TESTS IN ACCORDANCE WITH ACI 301 SEC 1.6.4.2. ADDITIONAL SAMPLES MAY BE REQUIRED TO OBTAIN CONCRETE STRENGTHS AT ALTERNATE INTERVALS THAN SHOWN BELOW.

- CURE 4 CYLINDERS FOR 28-DAY TEST. TEST 1 CYLINDER AT 7 DAYS, TEST 2 CYLINDERS AT 28 DAYS, AND HOLD 1 CYLINDER IN RESERVE FOR USE AS THE EOR DIRECTS. AFTER 56 DAYS, UNLESS NOTIFIED BY THE EOR TO THE CONTRARY, THE RESERVE CYLINDER MAY BE DISCARDED WITHOUT BEING TESTED FOR SPECIMENS MEETING 28-DAY STRENGTH REQUIREMENTS.

ACCEPTANCE: STRENGTH IS SATISFACTORY WHEN:

- THE AVERAGES OF ALL SETS OF 3 CONSECUTIVE TESTS EQUAL OR EXCEED THE SPECIFIED STRENGTH. NO INDIVIDUAL TEST FALLS BELOW THE SPECIFIED STRENGTH BY MORE THAN 500 PSI. A "TEST" FOR ACCEPTANCE IS THE AVERAGE STRENGTH OF THE TWO CYLINDERS TESTED AT THE SPECIFIED TEST AGE.

CONCRETE REINFORCEMENT:

- REFERENCE STANDARDS: CONFORM TO:**
- ACI 301 "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE. " SEC 3 " REINFORCEMENT, AND REINFORCEMENT SUPPORTS."
 - IBC CHAPTER 19, CONCRETE.
 - ACI 318 AND ACI 318R.
 - ACI SP-66 "ACI DETAILING MANUAL" INCLUDING ACI 315 "DETAILS AND DETAILING OF CONCRETE REINFORCEMENT."
 - CRSI MSP-2 "MANUAL OF STANDARD PRACTICE."
 - ANSI/AWS D1.4 "STRUCTURAL WELDING CODE - REINFORCING STEEL."

SUBMITTALS:
CONFORM TO ACI 301 SEC 3.1.1 "SUBMITTALS, DATA, AND DRAWINGS." SUBMIT PLACING DRAWINGS SHOWING FABRICATION DIMENSIONS AND LOCATIONS FOR PLACEMENT OF REINFORCEMENT AND REINFORCEMENT SUPPORTS.

MATERIALS:
REINFORCING BARS: ASTM A615, GRADE 60, DEFORMED BARS.
SMOOTH WELDED WIRE FABRIC: ASTM A185
DEFORMED WELDED WIRE FABRIC: ASTM A497
BAR SUPPORTS: CRSI MSP-2, CHAPTER 3 "BAR SUPPORTS."
TIE WIRE: 16.5 GAGE OR HEAVIER, BLACK ANNEALED.

WELDING:
BARS SHALL NOT BE WELDED UNLESS AUTHORIZED. WHEN AUTHORIZED, CONFORM TO ACI 301, SEC 3.2.2.2. "WELDING" AND PROVIDE ASTM A706, GRADE 60 REINFORCEMENT.

PLACING:
CONFORM TO ACI 301, SEC 3.3.2 "PLACEMENT." PLACING TOLERANCES SHALL CONFORM TO SEC 3.3.2.1 "TOLERANCES."

- CONCRETE COVER:**
CONFORM TO THE FOLLOWING COVER REQUIREMENTS FROM ACI 301, TABLE 3.3.2.3
- CONCRETE CAST AGAINST EARTH: 3"
 - CONCRETE EXPOSED TO EARTH OR WEATHER (#5 & SMALLER): 1-1/2"
 - CONCRETE EXPOSED TO EARTH OR WEATHER (#6 & LARGER): 2"
 - BARS IN SLABS AND WALLS: 3/4"

SPICES & DEVELOPMENT LENGTH:

CONFORM TO ACI 301, SEC 3.3.2.7. LAP ALL CONTINUOUS REINFORCEMENT AND CORNER BARS PER SCHEDULE. THE SPICES AND DEVELOPMENT LENGTHS INDICATED ON INDIVIDUAL SHEETS CONTROL OVER THE SCHEDULE.

USE CLASS B SPICES UNLESS OTHERWISE NOTED. MECHANICAL CONNECTIONS MAY BE USED WHEN APPROVED BY THE EOR.
*WWF TO BE LAPPED A MINIMUM 8" ON ALL SIDES AND EDGES.

REINFORCING BAR CHART			
BAR SIZE	TOP BARS	OTHER BARS	DEVELOPMENT LENGTH, Ld
#4	33"	25"	19"
#5	41"	31"	24"
#6	48"	37"	29"
#7	70"	54"	41"
#8	80"	62"	47"
#9	90"	70"	53"
#10	100"	78"	59"
#11	110"	85"	65"

SCHEDULE NOTES:

- ALL LENGTHS ARE IN INCHES AND FOR F'c= 4,000 PSI.
- "TOP BARS" ARE HORIZONTAL REINFORCEMENT SO PLACED THAT MORE THAN 12" OF CONC IS CAST IN THE MEMBER BELOW THE BAR.
- FOR F'c = 5,000 PSI USE 90% OF LENGTH.
- FOR F'c = 3,000 PSI USE 115% OF LENGTH.

FIELD BENDING:

CONFORM TO ACI 301 SEC 3.3.2.8. "FIELD BENDING OR STRAIGHTENING." BAR SIZES #3 THROUGH #5 MAY BE FIELD BENT COLD THE FIRST TIME. OTHER BARS REQUIRE PREHEATING. DO NOT TWIST BARS.

CORNER BARS:

PROVIDE MATCHING-SIZED "L" CORNER BARS FOR ALL HORIZONTAL WALL AND FOOTING BARS WITH THE APPROPRIATE SPLICE LENGTH, UNO.

TYPICAL CONCRETE REINFORCEMENT:

UNLESS NOTED ON THE PLANS, CONCRETE WALLS SHALL HAVE THE FOLLOWING MINIMUM REINFORCEMENT. CONTRACTOR SHALL CONFIRM MINIMUM REINFORCEMENT OF WALLS WITH EOR PRIOR TO REBAR FABRICATION.

WOOD FRAMING REFERENCE STANDARDS:

- CONFORM TO:
- IBC CHAPTER 23 "WOOD."
 - NDS AND NDS SUPPLEMENT - "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION."
 - ANSI/TPI 1 "NATIONAL DESIGN STANDARD FOR METAL-PLATE-CONNECTED WOOD TRUSS CONSTRUCTION."
 - BCSI 2013 "BUILDING COMPONENT SAFETY INFORMATION."

IDENTIFICATION:

ALL SAWN LUMBER AND PRE-MANUFACTURED WOOD PRODUCTS SHALL BE IDENTIFIED BY THE GRADE MARK OR A CERTIFICATE OF INSPECTION ISSUED BY THE CERTIFYING AGENCY.

MATERIALS:

SAWN LUMBER:
CONFORM TO GRADING RULES OF WWPA, WCLIB, OR NLGA. FINGER JOINTED STUDS ACCEPTABLE AT INTERIOR NON-STRUCTURAL WALLS ONLY.

MEMBER USE	SIZE	SPECIES GRADE	
STUDS & PLATES	2X4,3X4,2X6,3X6	DF	NO. 2
POSTS	4X4, 4X6, 4X8	DF	NO. 2
BEAMS	4X8 -- 4X12	DF	NO. 2
BEAMS	6X8 -- 6X12	DF	NO. 2
POSTS	6X	DF	NO. 2
P.T. FRAMING	ALL	HF	NO. 2

GLUED LAMINATED TIMBER:

CONFORM TO AITC 117 "STANDARD SPECIFICATIONS FOR STRUCTURAL GLUED LAMINATED TIMBER OF SOFTWOOD SPECIES, MANUFACTURING AND DESIGN" AND ANSI/AITC A190.1 "STRUCTURAL GLUED LAMINATED TIMBER." GLUED LAMINATED MEMBER BEAMS SHALL NOT BE CAMBERED, UNLESS SHOWN OTHERWISE ON THE PLANS OR SPECIFICATIONS.

MEMBER USE	SIZES	SPECIES	STRESS CLASS	USES
BEAMS ALL	DF/DF	24F-V4		ALL SPANS

WOOD STRUCTURAL SHEATHING (PLYWOOD):

WOOD APA-RATED STRUCTURAL SHEATHING INCLUDES: ALL VENEER PLYWOOD, ORIENTED STRAND BOARD, WAFFERBOARD, PARTICLEBOARD, T1-T1 SIDING, AND COMPOSITES OF VENEER AND WOOD BASED MATERIAL. CONFORM TO PRODUCT STANDARDS PS-1-95 AND PS-2-92 OF THE U.S. DEPT. OF COMMERCE AND THE AMERICAN PLYWOOD ASSOCIATION (APA)

MINIMUM APA RATING				
LOCATION	THICKNESS	SPAN RATING	PLYWOOD GRADE	EXPOSURE
ROOF	19/32"	40/20	C-D	1
FLOOR	23/32" T&G	24 OC	STURD-I-FLOOR	1
WALLS	15/32"	32/16	C-D	1

JOIST HANGERS AND CONNECTORS:

SIMPSON STRONG-TIE COMPANY INC. AS SPECIFIED IN THEIR LATEST CATALOGS WAS USED AS THE BASIS OF DESIGN FOR THIS PROJECT. ALTERNATE CONNECTORS BY OTHER MANUFACTURERS MAY BE SUBSTITUTED PROVIDED THEY HAVE CURRENT ICC-ESR/IAPMO-ER APPROVAL FOR EQUIVALENT OR GREATER LOAD CAPACITIES AND ARE REVIEWED AND APPROVED BY THE EOR PRIOR TO ORDERING.

CONNECTORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTRUCTIONS. WHERE CONNECTOR STRAPS CONNECT TWO MEMBERS, PLACE 1/2 OF THE NAILS OR BOLTS IN EACH MEMBER. UNLESS NOTED OTHERWISE ALL NAILS SHALL BE FULL LENGTH COMMON. NAIL STRAPS TO WOOD FRAMING AS LATE AS POSSIBLE IN THE FRAMING PROCESS TO ALLOW THE WOOD TO SHRINK AND THE BUILDING TO SETTLE.

NAILS AND STAPLES:

CONFORM TO IBC SEC 2303.6 "NAILS AND STAPLES." UNLESS NOTED ON PLANS, NAIL PER IBC TABLE 2304.10.1. UNLESS NOTED OTHERWISE ALL NAILS SHALL BE COMMON. NAIL SIZES SPECIFIED ON THE DRAWINGS ARE BASED ON THE FOLLOWING SPECIFICATIONS:

COMMON NAILS

SIZE	LENGTH	DIAMETER
8D	2-1/2"	0.131"
10D	3"	0.148"
16D	3-1/2"	0.162"
16D SINKER	3-1/4"	0.148"

LAG BOLTS/BOLTS:

CONFORM TO ASTM A307. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD.

WOOD HOLDOWNS:

HOLDOWNS SPECIFIED ARE AS MANUFACTURED BY SIMPSON STRONG-TIE COMPANY INC. ADDITIONAL FRAMING MEMBERS SHALL BE PROVIDED PER THE MANUFACTURER'S REQUIREMENTS. ACCEPTABLE EQUIVALENT PRODUCT SUBSTITUTIONS ARE AVAILABLE FROM OTHER MANUFACTURERS WITH EOR APPROVAL. DO NOT COUNTERSINK HOLDOWN BOLTS.

ENGINEERED WOOD PRODUCTS (EWP):

THE FOLLOWING MATERIALS ARE BASED ON LUMBER MANUFACTURED BY TRUSJOIST BY WEYERHAEUSER. TRUS-JOIST BY WEYERHAEUSER WAS USED AS THE BASIS OF DESIGN FOR THIS PROJECT. ALTERNATE PRODUCTS BY OTHER MANUFACTURERS MAY BE SUBSTITUTED PROVIDED THEY HAVE CURRENT ICC-ESR/IAPMO-ER APPROVAL FOR EQUIVALENT OR GREATER LOAD AND STIFFNESS PROPERTIES AND ARE REVIEWED AND APPROVED BY THE EOR. A HUD MATERIAL RELEASE FORM IS REQUIRED FOR ALL MANUFACTURED WOOD PRODUCTS LISTED BELOW.

- PARALLEL STRAND LUMBER (PSL):** CONFORM TO ICC ES REPORT NO. ESR-1387, CCMC REPORT NO. 11161-R, OR NES REPORT NO. NER-481. USE 2.2E UNLESS NOTED OTHERWISE.
- LAMINATED STRAND LUMBER (LSL):** CONFORM TO ICC ES REPORT NO. ESR-1387, CCMC REPORT NO. 12627-R, OR NES REPORT NO. NER - 481.
- JOISTS:** CONFORM TO ICC ES REPORT NO. ER-1153. PRODUCTS SHALL BE TESTED AND EVALUATED IN ACCORDANCE WITH ASTM D5055. THE MANUFACTURER SHALL DESIGN THE JOISTS FOR THE SPANS AND CONDITIONS SHOWN ON THE PLANS. JOISTS SHALL HAVE WOOD CHORDS AND SOLID WOOD WEBS.
- OPEN WEB WOOD JOISTS (OWWJ):** CONFORM TO ICC ES REPORT NO. [PFC-4354/ESR-1774] OR NES REPORT NO. NER-148. THE MANUFACTURER SHALL DESIGN THE JOISTS FOR THE SPANS AND CONDITIONS SHOWN ON THE PLANS. JOISTS SHALL HAVE WOOD CHORDS AND EITHER WOOD OR METAL WEBS.

NAILING REQUIREMENTS:

PROVIDE MINIMUM NAILING IN ACCORDANCE WITH IBC TABLE 2304.10.1 "FASTENING SCHEDULE" EXCEPT AS NOTED ON THE DRAWINGS. NAILING FOR ROOF/FLOOR DIAPHRAGMS/SHEAR WALLS SHALL BE PER DRAWINGS. NAILS SHALL BE DRIVEN FLUSH AND SHALL NOT FRACTURE THE SURFACE OF SHEATHING.

STANDARD LIGHT-FRAME CONSTRUCTION:

UNLESS NOTED ON THE DRAWINGS, CONSTRUCTION SHALL CONFORM TO IBC SEC 2308 "CONVENTIONAL LIGHT-FRAME CONSTRUCTION" AND IBC SEC 2304 "GENERAL CONSTRUCTION REQUIREMENTS."

- WALL FRAMING:** (UNLESS NOTED OTHERWISE ON PLANS AND DETAILS) ALL INTERIOR WALLS SHALL BE 2X4 @ 16"OC AND ALL EXTERIOR WALLS SHALL BE 2X6 @ 16"OC. PROVIDE (2) BUNDLED STUDS MIN AT WALL ENDS AND EACH SIDE OF ALL OPENINGS. ALL SOLID SAWN LUMBER BEAMS AND HEADERS SHALL BE SUPPORTED BY A MINIMUM OF (2) TRIM AND (1) KING STUD AND ALL GLULAM OR ENGINEERED WOOD BEAMS AND HEADERS BY (2) TRIM AND (2) KING STUDS. PROVIDE MINIMUM (2) 2X8 HEADERS AT ALL INTERIOR AND EXTERIOR WALL OPENINGS. STITCH-NAIL BUNDLED STUDS WITH (2) 10D @ 12"OC. PROVIDE SOLID BLOCKING THRU STUDS TO SUPPORTS BELOW FOR BEARING WALLS AND POSTS. ATTACH BOTTOM PLATES OF STUD WALLS TO WOOD FRAMING BELOW WITH 16D @ 12"OC OR TO CONCRETE WITH 5/8" DIA. ANCHOR BOLTS X 7" EMBEDMENT AT 48"OC. REFER TO SHEAR WALL SCHEDULE FOR SPECIFIC SHEATHING, STUD, AND NAILING REQUIREMENTS AT SHEAR WALLS. PROVIDE GYPSUM SHEATHING ON INTERIOR SURFACES AND PLYWOOD SHEATHING ON EXTERIOR SURFACES.
- ROOF/FLOOR FRAMING:** (UNLESS NOTED OTHERWISE ON PLANS AND DETAILS) PROVIDE DOUBLE JOISTS/RAFTERS UNDER ALL PARALLEL BEARING PARTITIONS AND SOLID BLOCKING AT ALL BEARING POINTS. PROVIDE DOUBLE JOISTS AROUND ALL ROOF/FLOOR OPENINGS. MULTI-JOISTS/RAFTERS SHALL BE STITCH-NAILED TOGETHER WITH (2)10D @ 12"OC. PROVIDE ROOF SHEATHING EDGE CLIPS CENTERED BETWEEN FRAMING AT UNBLOCKED PLYWOOD EDGES. ALL FLOOR SHEATHING SHALL HAVE TONGUE AND GROOVE JOINTS OR BE SUPPORTED BY SOLID BLOCKING. ALLOW 1/8" SPACING AT ALL PANEL EDGES AND ENDS OF ROOF/FLOOR SHEATHING. ROOF/FLOOR SHEATHING SHALL BE LAID FACE GRAIN PERPENDICULAR TO FRAMING MEMBERS.

MOISTURE CONTENT:

WOOD MATERIAL USED FOR THIS PROJECT SHALL HAVE MAXIMUM MOISTURE CONTENT OF 19% EXCEPT FOR THE PRESSURE-TREATED WOOD SILL PLATE. REFER TO TESTING & INSPECTIONS FOR THE VERIFICATION OF THESE LIMITS. THE MAXIMUM MOISTURE CONTENT REQUIRED MAY BE LESS THAN 19% WHEN BASED ON A PARTICULAR CLADDING/INSULATION SYSTEM. REFER TO THE ARCHITECT'S DRAWINGS, AND PROJECT SPECIFICATIONS, OR WITH CLADDING INSTALLER FOR MAXIMUM RECOMMENDED MOISTURE CONTENT.

CLADDING COMPATIBILITY:

THE ARCHITECT/OWNER SHALL REVIEW THE CLADDING AND INSULATION SYSTEMS PROPOSED FOR THE PROJECT WITH RESPECT TO THEIR PERFORMANCE OVER WOOD STUDS WITH MOISTURE CONTENTS GREATER THAN 19%. EIFS SYSTEMS SHOULD BE AVOIDED ON WOOD-FRAMED PROJECTS DUE TO PROBLEMS WITH MOISTURE-PROOFING.


PRESERVATIVE TREATMENT:

WOOD MATERIALS ARE REQUIRED TO BE "TREATED WOOD" UNDER CERTAIN CONDITIONS IN ACCORDANCE WITH IBC SEC 2304.12 "PROTECTION AGAINST DECAY AND TERMITES." CONFORM TO THE APPROPRIATE STANDARDS OF THE AMERICAN WOOD-PRESERVERS ASSOCIATION (AWPA) FOR SAWN LUMBER, GLUED LAMINATED TIMBER, ROUND POLES, WOOD PILES, AND MARINE PILES. FOLLOW AMERICAN LUMBER STANDARDS COMMITTEE (ALSC) QUALITY ASSURANCE PROCEDURES. PRODUCTS SHALL BEAR THE APPROPRIATE MARK.

METAL CONNECTORS/PT WOOD:


ALL METAL HARDWARE AND FASTENERS IN CONTACT WITH PRESSURE TREATED LUMBER SHALL BE STAINLESS STEEL TYPE 316L. AT THE OWNER'S RISK AND DISCRETION, HOT-DIPPED GALVANIZED METAL HARDWARE AND FASTENERS MAY BE INVESTIGATED FOR USE IN LIEU OF STAINLESS STEEL PROVIDED THAT THE FINISH HAS A MINIMUM ZINC CONTENT OF AT LEAST 1.85 OZ./SF AND ITS USE IS COORDINATED BY THE CONTRACTOR AND WOOD SUPPLIER FOR THE EXPECTED ENVIRONMENT AND MOISTURE EXPOSURE FOR APPROPRIATE USE BASED ON THE METHOD OF PRESERVATIVE TREATMENT OF THE WOOD.

Description
Date
No.



L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072

ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, W A 98059



HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET

STRUCTURAL NOTES

PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

S002




SCALE 24X36:
* NOTE: 11X17 SETS ARE REDUCED 50%; SCALE DRAWINGS ACCORDINGLY.



COPYRIGHTED BY ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

FOOTING SCHEDULE			
MARK	SIZE	REINFORCING	DETAIL
181810	18" X 18" X 10" THK	(3) #4 BOT BAR EA WAY	DTL 9/D101
363612	36" X 36" X 12" THK	(4) #4 BAR EA WAY TOP & BOT	DTL 9/D101
364812	36" X 48" X 12" THK	#4 BAR AT 10" O.C. EA WAY TOP & BOT	DTL 9/D101
Footing-MAT-Rectangular: 25			
242410-18X18	24" X 24" X 10" THK	(3) #4 BAR EA WAY TOP & BOT. PROVIDE 18" SQ PLYNTH w/ (4) #4 BAR VERT	DTL 11/D101
Footing-MAT-Rectangular w Plynth: 2			

BEAM SCHEDULE - MAIN...	
ID	SIZE
1.1	4x8, TYP
1.3	5-1/2"x9-1/4" PSL

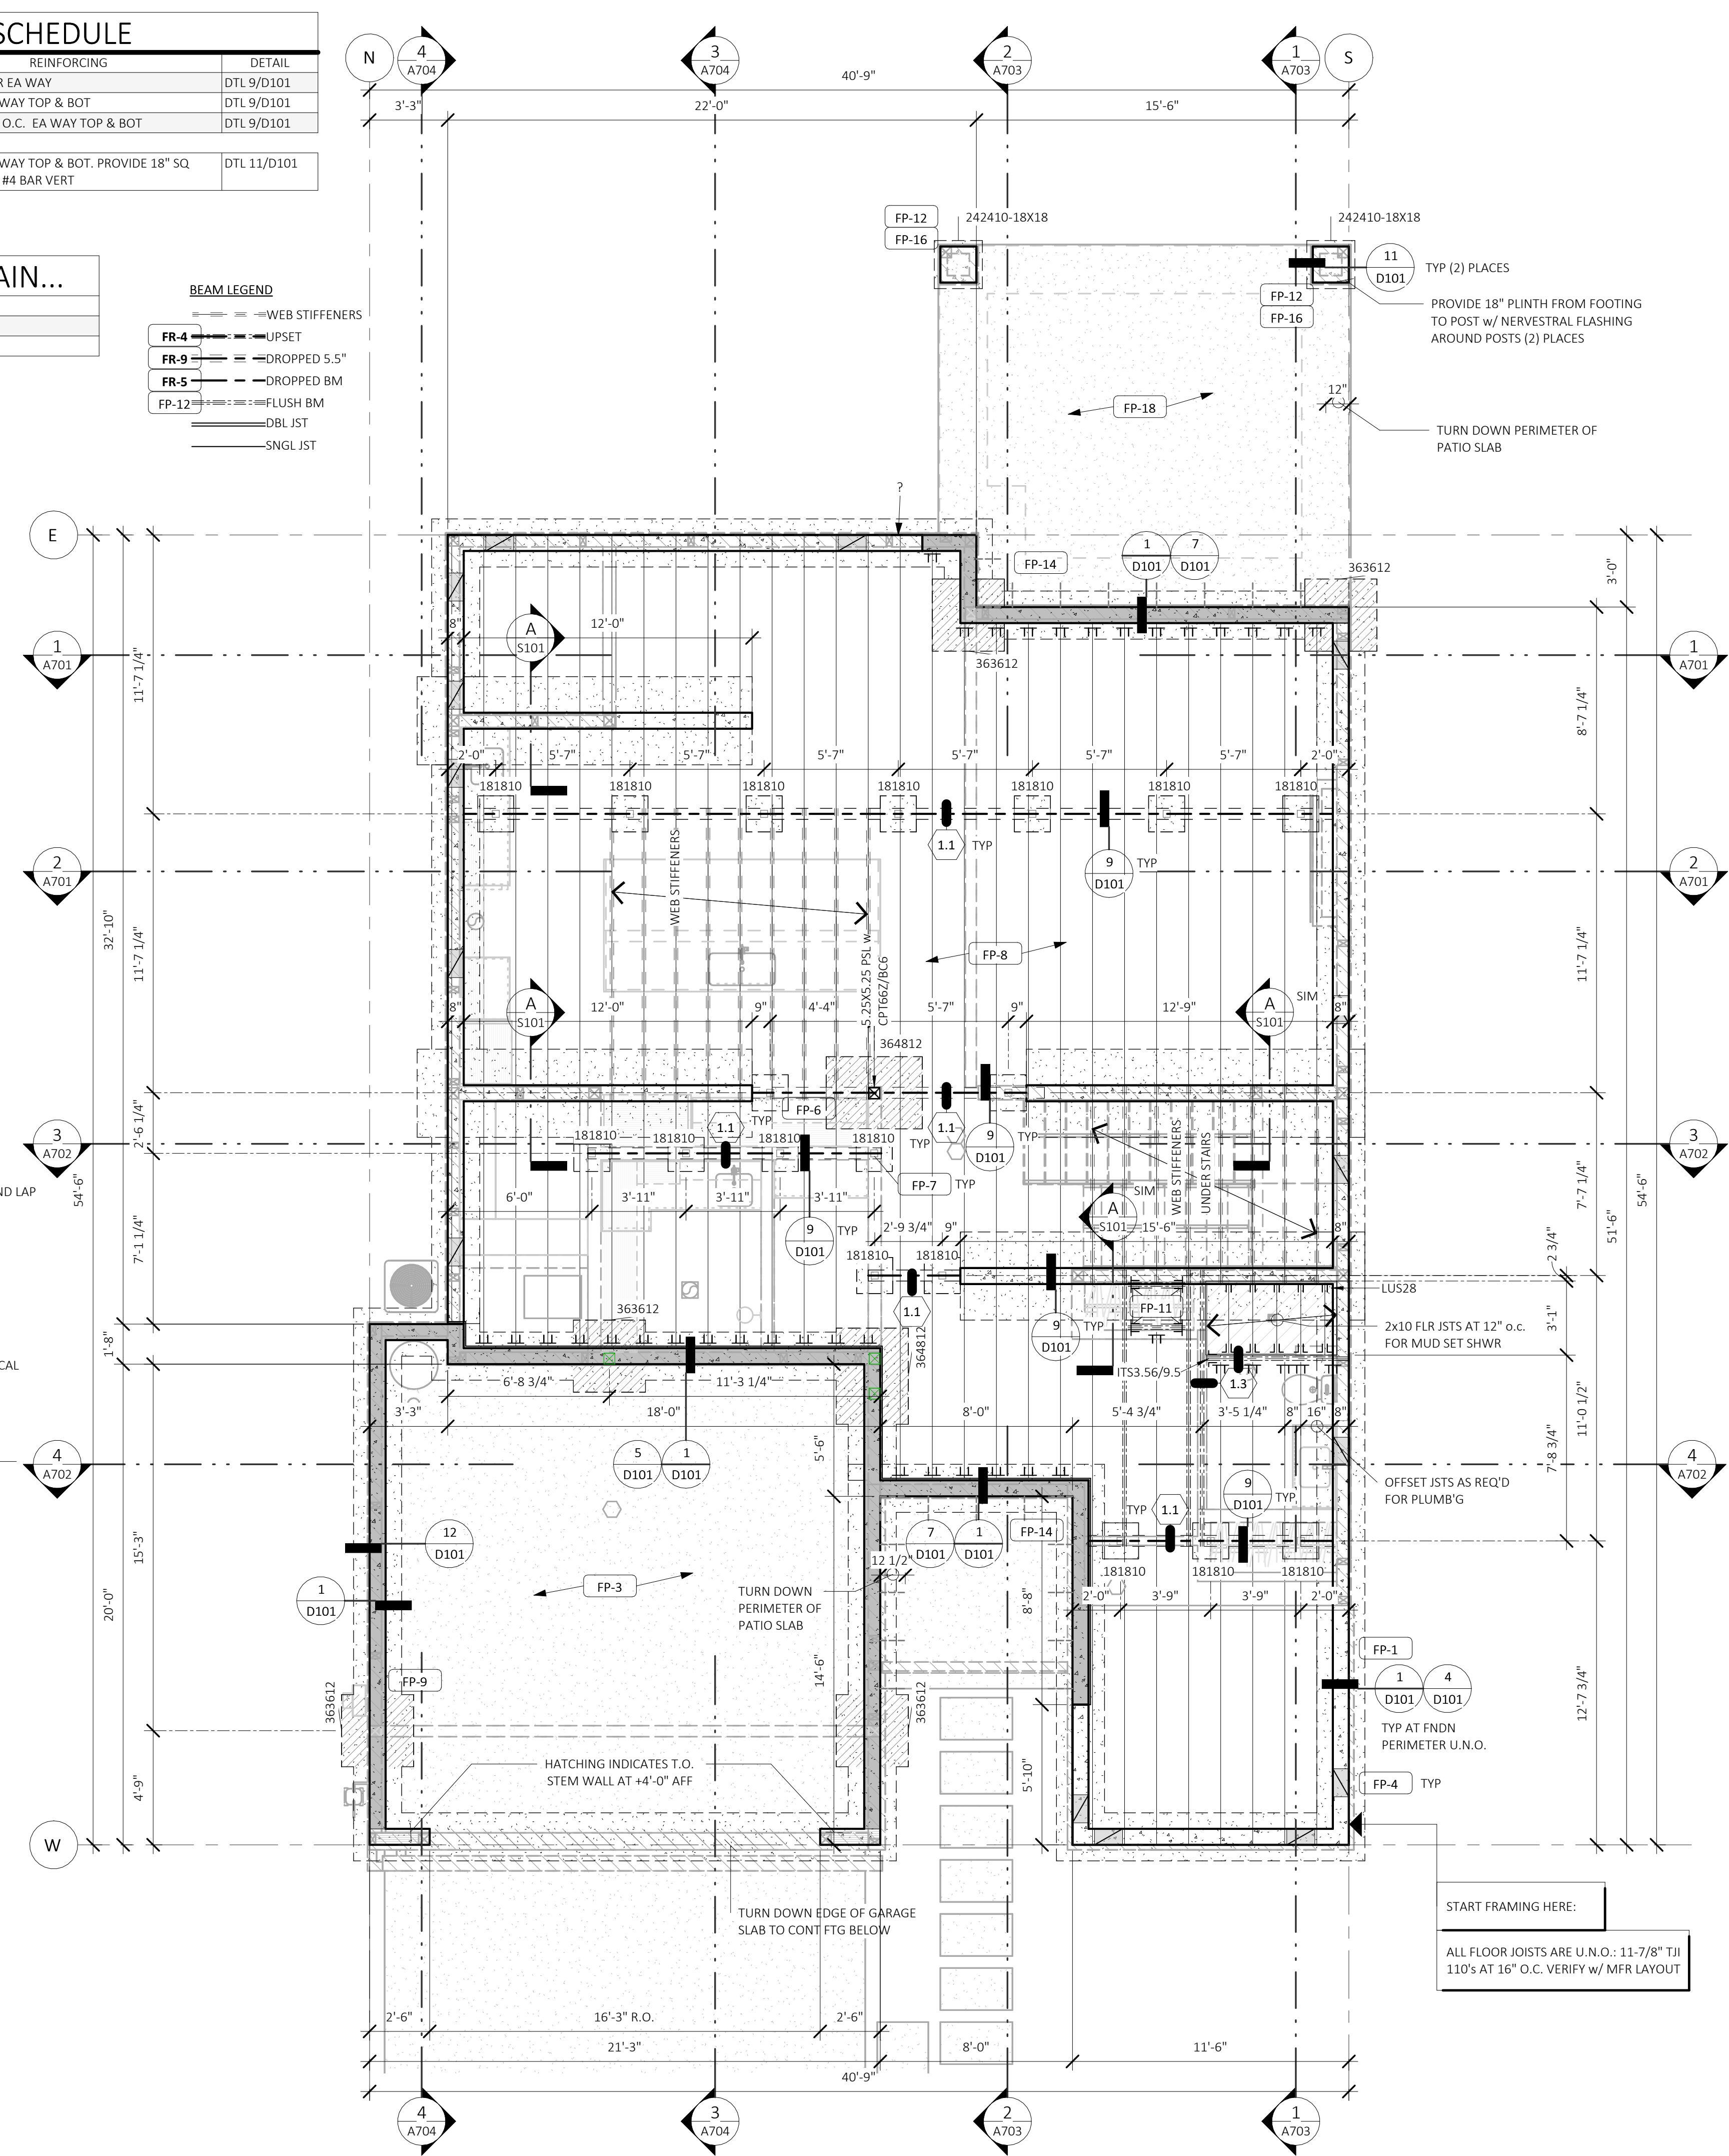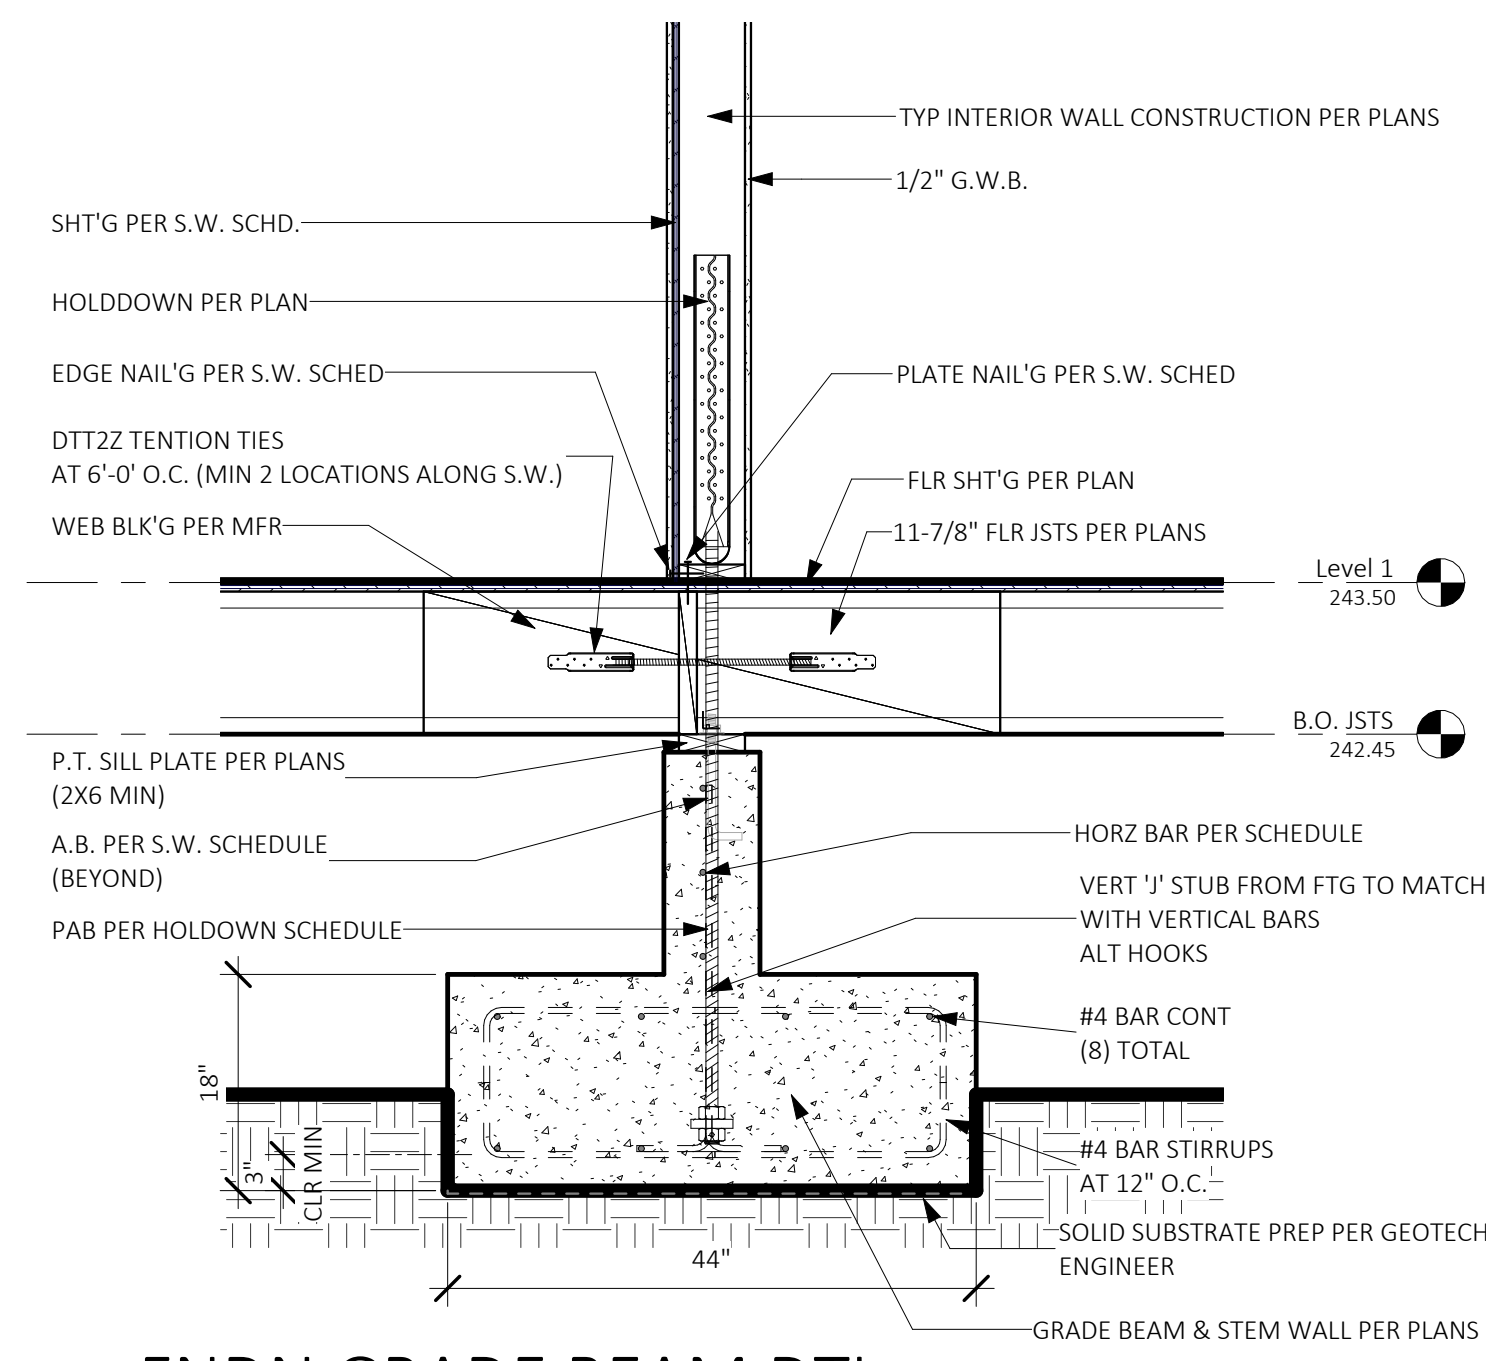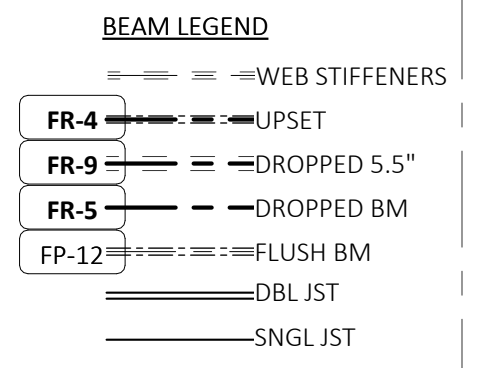

- SYMBOLS & LEGEND:**
- POINT LOAD FROM ABOVE. PROVIDE SOLID BLK'G THROUGH JOIST SYSTEM
 - (1) 2x STUD
 - (2) 2x STUD, TYP. LARGER MEMBERS AS NOTED ON PLANS
 - SIMPSON OR OTHER APPROVED ALTERNATE HANGER. USE ALL REQUIRED FASTENERS
 - INDICATES BEAM CALCULATION WITH INDEXED NUMBER
 - WALL ABOVE
 - BEARING WALL BELOW
 - NON BEARING WALL
 - SHEARWALL BELOW
 - BEARING WALL ABOVE

- GENERAL FRAMING NOTES:**
- SEE SHEET S001 FOR GENERAL DESIGN CRITERIA.
 - SEE SHEET(S) S201-203 FOR SHEARWALL DESIGNATIONS, HOLDDOWNS, AND SHEARWALL SCHEDULE.
 - U.N.O. ALL HEADERS ARE: 4x8 DF #2 (UP TO 8' SPAN) TRIMMER STUD UP TO 6'-0" SPAN AND PROVIDE (2) TRIMMER STUDS OVER 6'-0" U.N.O.
 - TRUSS DESIGN BY MANUFACTURER. TRUSS DESIGN DRAWINGS SHALL BE PREPARED PER IRC SECTION R802.10.1 AND SHALL BE PROVIDED TO THE BUILDING OFFICIAL AND APPROVED PRIOR TO INSTALLATION.
 - * TRUSS DESIGN PER IRC SECTION R802.10.2
 - * FIELD ALTERATIONS MUST BE DESIGNED BY MFR. PER IRC SECTION R802.10.4
 - * SEE SHEET(S) S001 FOR DESIGN LOADS.
 - * TRUSS MFR TO PROVIDE ADEQUATE BEARING AREA TO RESOLVE REACTION (PERPENDICULAR TO GRAIN) AT ALL HIGHLY LOADED GIRDER TRUSSES.
 - PROVIDE 2x4 RAFTER/TRUSS TAIL - TYP. U.N.O.
 - ROOF PITCH: EXTERIOR PER ELEVATIONS & INTERIOR PER SECTIONS.
 - ROOF FRAMING SPACING, 24" o.c. U.N.O.
 - SEE ELEVATIONS AND/OR SECTIONS FOR ROOF PITCH, PLATE HEIGHT AND HEADER HEIGHT.
 - FRAMING LUMBER: FRAMING LUMBER SHALL BE MARKED IN ACCORDANCE TO W.C.L.B. STANDARD GRADING RULES FOR WEST COAST LUMBER #16, LATEST EDITION. ALL KILN DRIED MIN. 19.
 - a) JOIST AND RAFTERS: SEE SHT S002
 - b) BEAMS AND STRINGERS: SEE SHT S002
 - c) POST AND TIMBERS: SEE SHT S002
 - d) STUDS, PLATES, AND MISC. LIGHT FRAMING: SEE SHT S002
 - e) TJS AND MICROLUMS: PER MANUFACTURER.
 - f) GLUE LAMINATED TIMBER: SEE SHT S002
 - g) ALL OTHER LUMBER: HEM-FIR STANDARD OR BETTER.
 - h) PLYWOOD/ORIENTED STRAND BOARD (OSB): SEE SHT S002
 - i) WALL SHEATHING: SEE SHT S002
 - j) FLOOR SHEATHING: 23/32" APA RATED STRUCTURAL SHT'G FACE GRAIN PERP TO FLR FRAM'G W/ 10d @ 6" OC PANEL EDGES, & 12" O.C. FIELD, UNBLOCKED, TYP. U.N.O.
 - k) ROOF SHEATHING: 15/32" APA RATED STRUCTURAL SHT'G FACE GRAIN PERP TO FLR FRAM'G W/ 10d @ 6" OC PANEL EDGES, & 12" O.C. FIELD, UNBLOCKED, TYP.
 - l) OTHER: AS NOTED ON DRAWINGS. SEE SHT S002
 - FASTENERS: ALL FRAMING SHALL BE NAILED IN ACCORDANCE WITH TABLE R602.3.1(3) OF THE IRC. SEE SHEET A001
 - * POSITIVE CONNECTIONS SHALL BE PROVIDED WHERE POSTS AND BEAM OR GIRDER CONSTRUCTION IS USED TO SUPPORT FLOOR FRAMING.
 - INSTALL 2X FIRELOCKING PER R302.11 AS FOLLOWS:
 - a) IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS, VERT AT THE CLG AND FLR LEVELS AND HORZ AT INTERVALS NOT EXCEEDING 10 FEET.
 - b) AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERT AND HORZ SPACES SUCH AS OCCUR AT SOFFITS, DROP CLGS AND COVE CLGS.
 - c) IN CONCEALED SPACES BTWN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
 - d) AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E 136 REQUIREMENTS.
 - THE INTEGRITY OF ALL FIREBLOCKS SHALL BE MAINTAINED.
 - SEE SHT A002 FOR ROOF & CRAWL SPACE AREA VENTILATION CALCULATIONS

KEYNOTES - FOUNDATION	
ID	DESCRIPTION
FP-1	CONCRETE STEM WALL 8" WIDE w/ FTG PER DETAILS.
FP-3	CONCRETE SLAB ON GRADE SHALL BE 4" THICK STEEL TROWLED FINISH w/ W1.4xW1.4 WWF ON 4" GRANULAR FILL. SLOPE TO AND PROVIDE THICKENED EDGE AT O.H. GAR DOOR. PER IRC SECTION R506
FP-4	14"x8" CRAWL SPACE VENT INSTALLED IN RIM JOIST. SEE CRAWL SPACE CALCULATIONS ON SHEET A003.
FP-6	BEAM LINE PER PLAN w/ SOLID BLK'G OVER. PROVIDE MIN 1" CLEARANCE FROM CONCRETE AT ENDS OF BEAM.
FP-7	4x4 POST - TYP. U.N.O. PROVIDE 4x6 AT BEAM SPLICES AND PROVIDE POSITIVE CONNECTION PER IRC SECTION R407.3
FP-8	6 MIL BLACK POLYETHYLENE GROUND COVER OR APPROVED EQ. OVERLAP EDGES 12" MIN AT JOINTS AND EXTEND UP FOUNDATION WALL. PER WSEC 502.1.6.7.
FP-9	ELECTRICAL SERVICE: VERIFY LOCATION WITH SITE CONDITIONS
FP-11	PROVIDE CRAWL SPACE ACCESS, MINIMUM 18" X 24" UNOBSTRUCTED ACCESS PER IRC SECTION R408.3. INSULATE AND WEATHER-STRIP PER ENERGY REQUIREMENTS (WSEC 502.1.4.4). ALLOW 18" MINIMUM SPACE UNDER WOOD JOISTS AND 12" MINIMUM SPACE UNDER WOOD GIRDERS.
FP-12	MAT FOOTING PER FTG SCHEDULE. SEE DETAILS FOR ADDITIONAL INFORMATION.
FP-14	#4 REBAR STUB-OUT AT 24" O.C. AROUND PERIMETER OF CONC. PORCH/PATIO.
FP-16	EXTEND PIER MIN. 18" BELOW SURROUNDING GRADE. PER IRC TABLE R301.2.
FP-18	CONCRETE SLAB ON GRADE SHALL BE 4" THICK STEEL BRUSHED FINISH w/ W1.4xW1.4 WWF ON 4" GRANULAR FILL. AT EXTERIOR PATIOS, SLOPE AWAY FROM BLDG 2% MIN. PER IRC SECTION R506.

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.



L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072

ATERA DESIGN STUDIO
451 DUVAL AVE NE
RENTON, WA 98059



HU RESIDENCE
2448 72nd AVE SE, Mercer Island

PERMIT SET

FOUNDATION/MAIN FLOOR FRAMING PLAN

PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

S101

SCALE 24X36: As indicated
* NOTE: 11x17 SETS ARE REDUCED 50%; SCALE DRAWINGS ACCORDINGLY.






BEAM SCHEDULE - UPPER ROOF

ID	SIZE
3.1	4X8
3.2	5-1/2" X 7-1/2" GLB

BEAM LEGEND

---	WEB STIFFENERS
FR-4	UPSET
FR-9	DROPPED 5.5"
FR-5	DROPPED BM
FP-12	FLUSH BM
---	DBL IST
---	SINGL IST

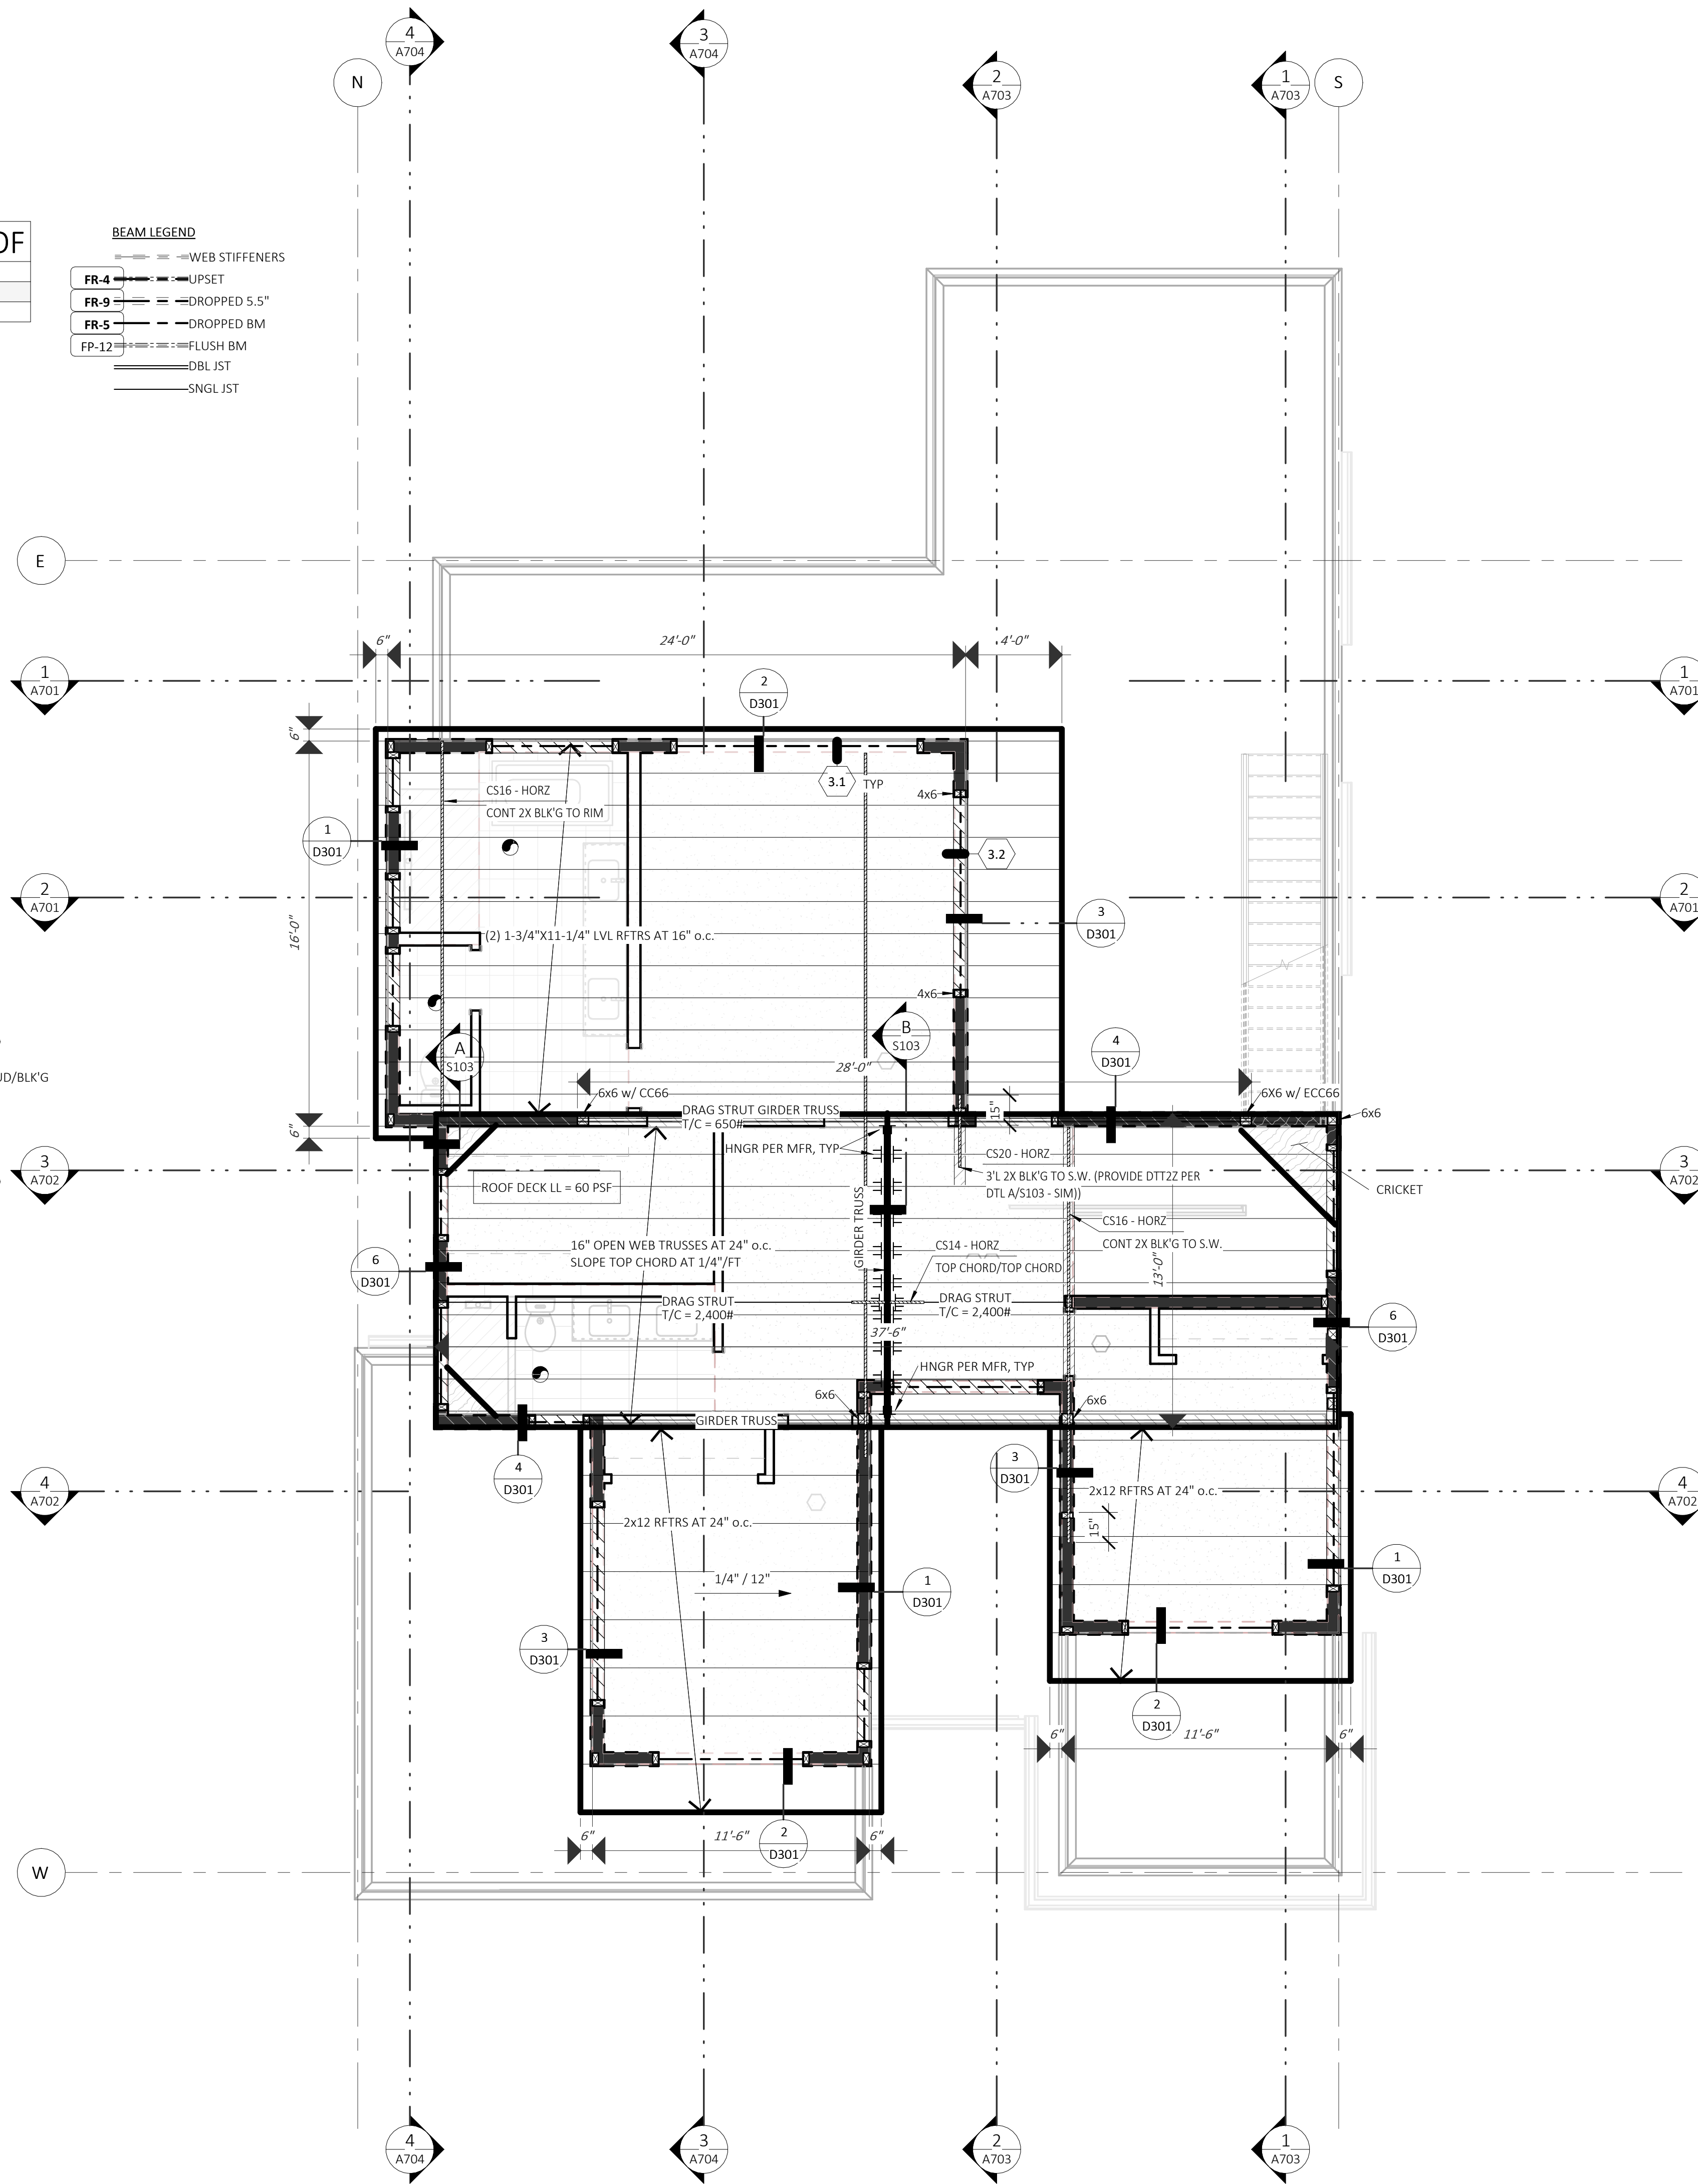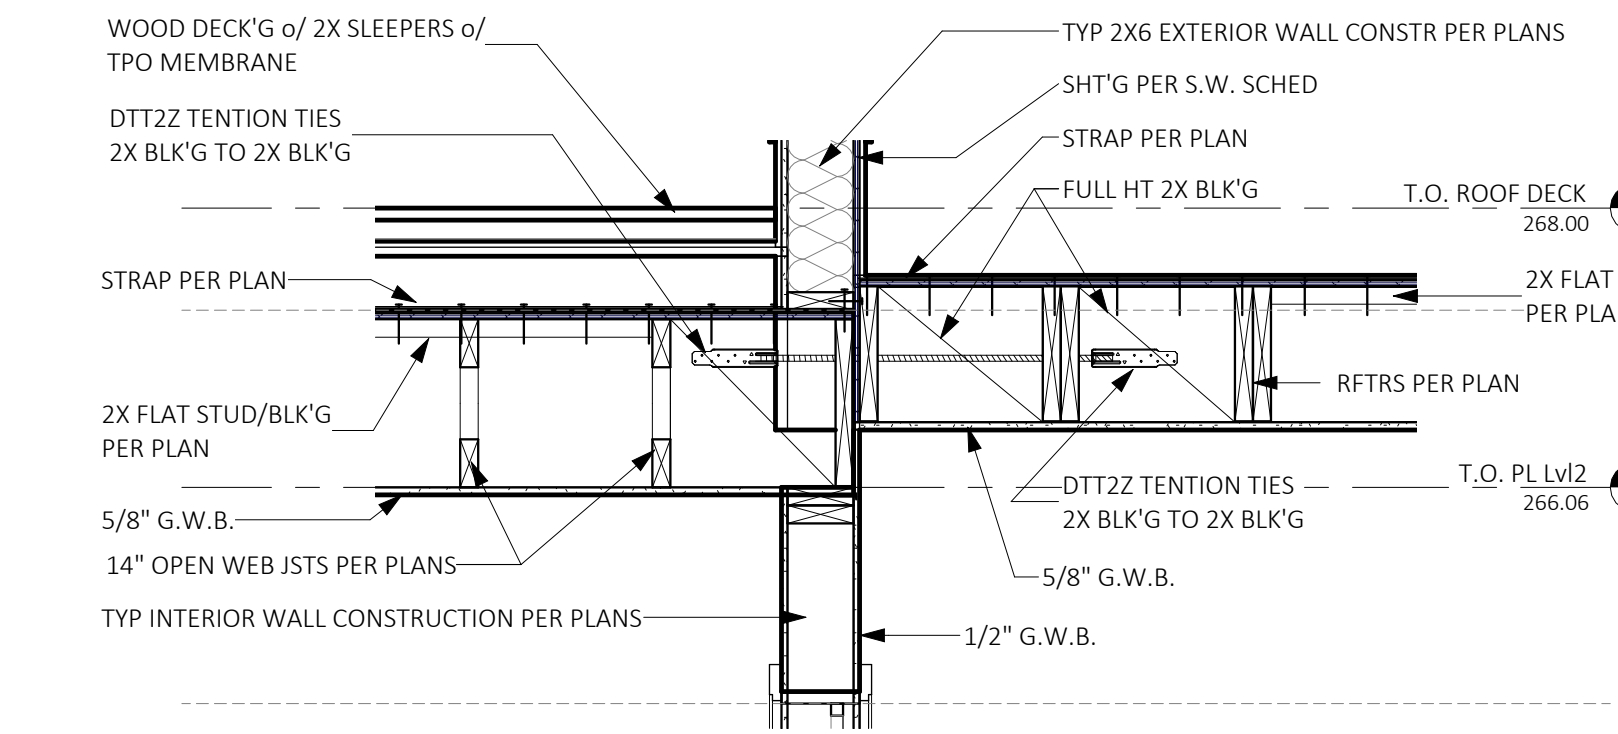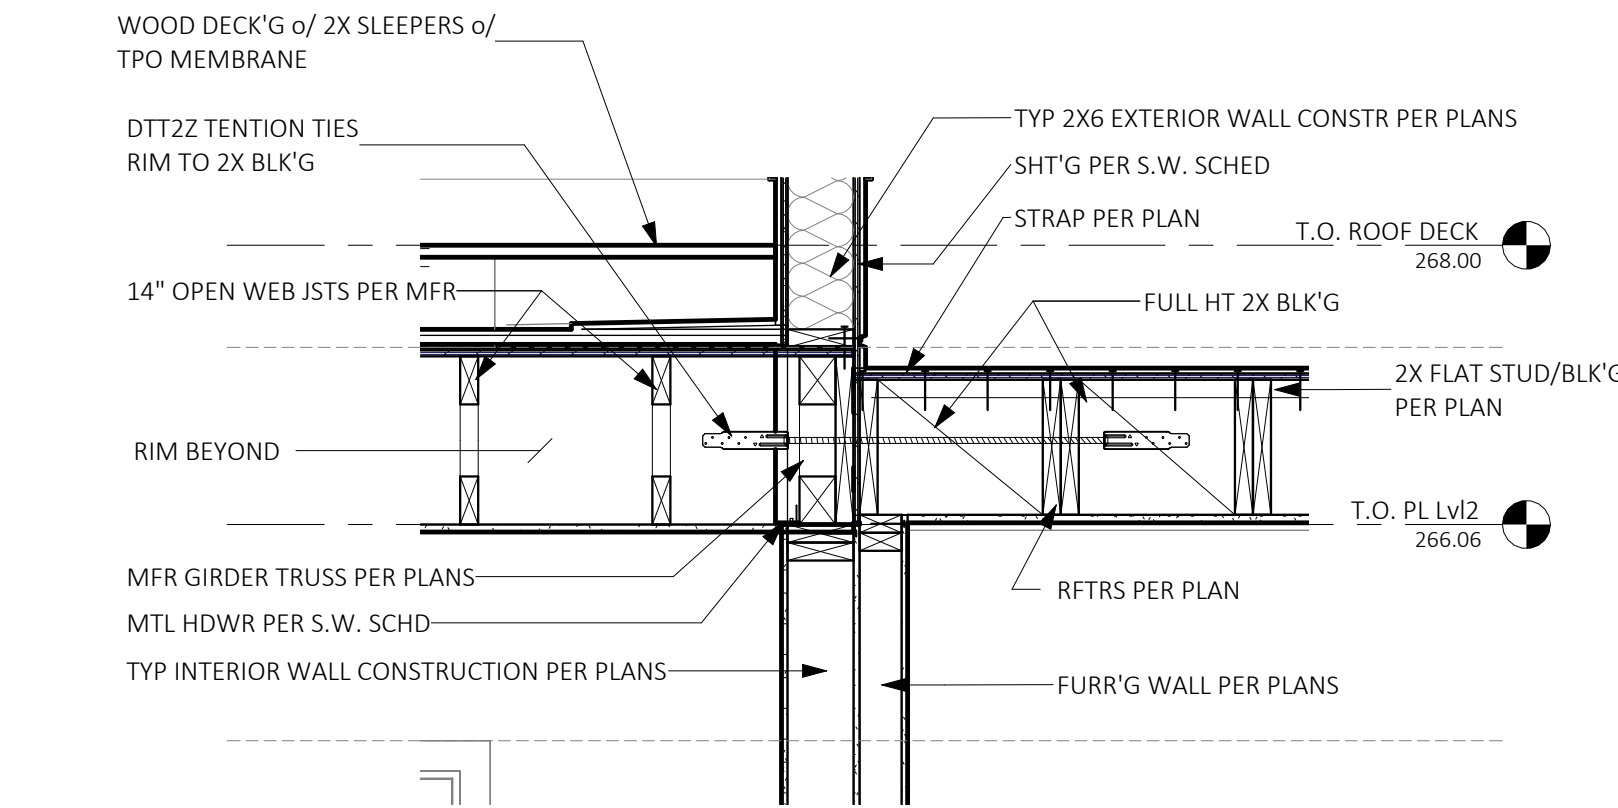

SYMBOLS & LEGEND:

- POINT LOAD FROM ABOVE. PROVIDE SOLID BLK'G THROUGH JOIST SYSTEM
(1) 2x STUD
- ▨ (2) 2x STUD, TYP. LARGER MEMBERS AS NOTED ON PLANS
- TL SIMPSON OR OTHER APPROVED ALTERNATE HANGER. USE ALL REQUIRED FASTENERS
- ⊕ INDICATES BEAM CALCULATION WITH INDEXED NUMBER
- WALL ABOVE
- BEARING WALL BELOW
- NON BEARING WALL BELOW
- SHEARWALL BELOW
- BEARING WALL ABOVE

GENERAL FRAMING NOTES:

- SEE SHEET S001 FOR GENERAL DESIGN CRITERIA.
- SEE SHEET(S) S201-203 FOR SHEARWALL DESIGNATIONS, HOLDDOWNS, AND SHEARWALL SCHEDULE.
- U.N.O. ALL HEADERS ARE: **4x8 DF #2 (UP TO 8' SPAN)** TRIMMER STUD UP TO 6'-0" SPAN AND PROVIDE (2) TRIMMER STUDS OVER 6'-0" U.N.O.
- TRUSS DESIGN BY MANUFACTURER. TRUSS DESIGN DRAWINGS SHALL BE PREPARED PER IRC SECTION R802.10.1 AND SHALL BE PROVIDED TO THE BUILDING OFFICIAL AND APPROVED PRIOR TO INSTALLATION.
 - * TRUSS DESIGN PER IRC SECTION R802.10.2
 - * FIELD ALTERATIONS MUST BE DESIGNED BY MFR. PER IRC SECTION R802.10.4
 - * SEE SHEET(S) S001 FOR DESIGN LOADS.
 - * TRUSS MFR TO PROVIDE ADEQUATE BEARING AREA TO RESOLVE REACTION (PERPENDICULAR TO GRAIN) AT ALL HIGHLY LOADED GIRDER TRUSSES.
- PROVIDE 2x4 RAFTER/TRUSS TAIL - TYP. U.N.O.
- ROOF PITCH: EXTERIOR PER ELEVATIONS & INTERIOR PER SECTIONS.
- ROOF FRAMING SPACING, 24" o.c. U.N.O.
- SEE ELEVATIONS AND/OR SECTIONS FOR ROOF PITCH, PLATE HEIGHT AND HEADER HEIGHT.
- FRAMING LUMBER: FRAMING LUMBER SHALL BE MARKED IN ACCORDANCE TO W.C.L.B. STANDARD GRADING RULES FOR WEST COAST LUMBER #16, LATEST EDITION. ALL KILN DRIED MIN. 19.
 - a) JOIST AND RAFTERS: SEE SHT S002
 - b) BEAMS AND STRINGERS: SEE SHT S002
 - c) POST AND TIMBERS: SEE SHT S002
 - d) STUDS, PLATES, AND MISC. LIGHT FRAMING: SEE SHT S002
 - e) TJI'S AND MICROLAMS: PER MANUFACTURER
 - f) GLUE LAMINATED TIMBER: SEE SHT S002
 - g) ALL OTHER LUMBER: **HEM-FIR STANDARD OR BETTER**
 - h) PLYWOOD/ORIENTED STRAND BOARD (OSB): SEE SHT S002
 - i) WALL SHEATHING: SEE SHT S002
 - j) FLOOR SHEATHING: 23/32" APA RATED STRUCTURAL SHT'G FACE GRAIN PERP TO FLR FRAM'G W/ 10d @ 6" OC PANEL EDGES, & 12" O.C. FIELD, UNBLOCKED, TYP U.N.O.
 - k) ROOF SHEATHING: 15/32" APA RATED STRUCTURAL SHT'G FACE GRAIN PERP TO FLR FRAM'G W/ 10d @ 6" OC PANEL EDGES, & 12" O.C. FIELD, UNBLOCKED, TYP.
 - l) OTHER: AS NOTED ON DRAWINGS. SEE SHT S002
- FASTENERS: ALL FRAMING SHALL BE NAILED IN ACCORDANCE WITH TABLE R602.3(1) OF THE IRC. SEE SHEET A001
 - * POSITIVE CONNECTIONS SHALL BE PROVIDED WHERE POSTS AND BEAM OR GIRDER CONSTRUCTION IS USED TO SUPPORT FLOOR FRAMING.
- INSTALL 2x FIREBLOCKING PER R302.11 AS FOLLOWS:
 - a) IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS, VERT AT THE CLG AND FLR LEVELS AND HORZ AT INTERVALS NOT EXCEEDING 10 FEET.
 - b) AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERT AND HORZ SPACES SUCH AS OCCUR AT SOFFITS, DROP CLGS AND COVE CLGS.
 - c) IN CONCEALED SPACES BTWN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
 - d) AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E 136 REQUIREMENTS. THE INTEGRITY OF ALL FIREBLOCKS SHALL BE MAINTAINED.
- SEE SHT A002 FOR ROOF & CRAWL SPACE AREA VENTILATION CALCULATIONS

KEYNOTES - FRAMING


ID	DESCRIPTION
FR-4	UPSET - BOTTOM OF BEAM EVEN W/ BOTTOM OF JOISTS. TOP OF BEAM EXTENDS ABOVE JOISTS.
FR-5	TOP OF BEAM IS FLUSH W/ BOTTOM OF JOISTS w/ NO TOP PLATE. CUT ADJACENT FRAMING MEMBERS INTO BEAM FOR ADEQUATE SUPPORT.
FR-9	TOP OF BEAM 5" BELOW TOP OF JOISTS TO ALLOW FOR HVAC.

(C) ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

Description: No. Date:



L2 ENGINEERS
 17848 NE 198TH PLAVE
 WOODINVILLE, WA 98072
ATERA DESIGN STUDIO
 451 DUVAL AVE NE,
 RENTON, WA 98059



HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET

ROOF FRAMING PLAN

PROJECT NO: 21014
 ISSUE DATE: 2022/06/29
 DRAWN BY: SPM

S103

SCALE 24X36: As indicated
 * NOTE: 11x17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



Holdowns and Tension Tie SCHEDULE

TYPE	MIN END STUD	FASTENERS			DETAIL	Count	Manufacturer	ALLOWABLE UPLIFT (DF / HF)
		ANCHOR BOLT	NAILS/SCREWS	CONCRETE ANCHOR				
CS16-11"			(22) 10d		DTL 272/S303	4	Simpson Strong Tie or EQ.	1705 / --
CS14-15"			(30) 10d		DTL 272/S303	2	Simpson Strong Tie or EQ.	2490 / --
CMSTC16-20"			(58) 16d SINKER		DTL 272/S303	8	Simpson Strong Tie or EQ.	4960 / --
(2) HDU11-SDS2.5 2	4X	1"	(30) SDS 1/4"x2 1/2"		DTL 52/S302	2	Simpson Strong Tie or EQ.	9535 / --
FLOOR TO FLOOR								
LSTHD8/LSTHD8RJ	(2) 2X		(20) 0.148 X 3-1/4"		DTL 58/S301	6	Simpson Strong Tie or EQ.	1610 / --
STHD10/STHD10RJ	(2) 2X		(28) 0.148 X 3-1/4"		DTL 58/S301	2	Simpson Strong Tie or EQ.	2175 / --
STHD14/STHD14RJ	(2) 2X		(30) 0.148 X 3-1/4"		DTL 58/S301	5	Simpson Strong Tie or EQ.	3500 / --
HDU8-SDS2.5	4X6	7/8"	(20) SDS 1/4"x2 1/2"	PAB6	DTL 52/S302	8	Simpson Strong Tie or EQ.	7870 / 6580
HDU11-SDS2.5	4X8	1"	(30) SDS 1/4"x2 1/2"	PAB7	DTL 52/S302	11	Simpson Strong Tie or EQ.	11175 / 9610
HDU14-SDS2.5	6X6	1"	(36) SDS 1/4"x2 1/2"	PAB8	DTL 52/S302	3	Simpson Strong Tie or EQ.	14445 / 12425
HD19	6X6	1-1/4"	(5) 1" BOLTS	PAB10	DTL 56/S301	2	Simpson Strong Tie or EQ.	19070 / 16210
HOLDDOWN								
MSTC48B3	(2) 2X		REF DETAIL		DTL 269/S303	9	Simpson Strong Tie or EQ.	3795 / 3900
MSTC68B3Z	4X		REF DETAIL		DTL 269/S303	1	Simpson Strong Tie or EQ.	4490 / --
OVERHANG								

WOOD FRAMED SHEARWALL SCHEDULE


SHEARWALL TYPE	WALL SHT'G APA RATED	EDGE NAIL'G	BOT PLATE CONNECTION	FRAM'G CONNECTION AT WALL BELOW	MIN RIM THICKNESS	FRAM'G AT PANEL EDGES	BLK'G AT PANEL EDGES	P.T. 2X SILL		P.T. 3X SILL	
								ANCHOR BOLT	SHEAR CAPACITY (WIND/SEISMIC)	ANCHOR BOLT	SHEAR CAPACITY (WIND/SEISMIC)
sw6	15/32"	8D AT 6" O.C.	(2) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 18" O.C.	1-1/4"	2X	2X	5/8" DIA AT 48" O.C.	242 / 339	5/8" DIA AT 60" O.C.	242 / 339
sw4	15/32"	8D AT 4" O.C.	(2) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 12" O.C.	1-3/4"	3X OR (2) 2X	3X OR FLAT 2X	5/8" DIA AT 32" O.C.	353/495	5/8" DIA AT 40" O.C.	353/495
sw3	15/32"	8D AT 3" O.C.	(2) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 10" O.C.	1-3/4"	3X OR (2) 2X	3X OR FLAT 2X	5/8" DIA AT 24" O.C.	456 / 637	5/8" DIA AT 32" O.C.	456 / 637
sw2	15/32"	8D AT 2" O.C.	(2) ROWS 16D COMMON AT 4" O.C. STAGGERED	LPTS'S AT 6" O.C.	3-1/2"	3X OR (2) 2X	3X OR FLAT 2X	5/8" DIA AT 18" O.C.	595 / 832	5/8" DIA AT 24" O.C.	595 / 832
2sw4	15/32" BOTH SIDES	8D AT 4" O.C.	(3) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 5" O.C.	3-1/2"	3X	3X			5/8" DIA AT 24" O.C.	707 / 990
2sw3	15/32" BOTH SIDES	8D AT 3" O.C.	(3) ROWS 16D COMMON AT 4" O.C. STAGGERED	LPTS'S AT 8" O.C. AND A35 AT 8" O.C.	3-1/2"	3X	3X			5/8" DIA AT 16" O.C.	911 / 1274
2sw2	15/32" BOTH SIDES	8D AT 2" O.C.	(3) ROWS 16D COMMON AT 4" O.C. STAGGERED	LPTS'S AT 6" O.C. AND A35 AT 6" O.C.	3-1/2"	3X	3X			5/8" DIA AT 12" O.C.	1190 / 1469

SHEARWALL LEGEND:

- # SHEARWALL TAG: SEE SHEARWALL SCHEDULE AND STRUCTURAL NOTES ON THIS SHEET.
- ALL EXTERIOR WALLS TO BE SW6 SHEAR WALLS U.N.O.
- FOR WALL CONSTRUCTION FOR WALLS THAT EXTEND THRU WINDOWS SHEATH ABV AND BELOW WINDOW & STRAP PER DETAIL ON SHEET D101
- HDN INDICATES STRUCTURAL KEYNOTE FOR HOLDOWN WITH INDEXED NUMBER. SEE STRUCTURAL KEYNOTE SCHEDULE THIS SHEET. SEE STRUCTURAL NOTES ON SHEET S101
- - - EXTENT OF SHEARWALL
- - - SHEARWALL BELOW

SHEAR WALL NOTES

1. ALL NAILS ARE COMMON. UNO. REFERENCE GENERAL STRUCTURAL NOTES FOR NAIL DIAMETER AND LENGTH. REFERENCE SHEAR WALL KEY DETAIL FOR DESCRIPTION OF TERMS.
2. PROVIDE SHEAR WALL SHEATHING AND NAILING FOR ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF SHEAR WALLS ARE TYPICALLY AT WINDOWS, DOORWAYS OR AS SHOWN ON PLAN.
3. EDGE NAILING IS REQUIRED AT ALL HOLDDOWN POS. EDGE NAILING IS REQUIRED TO EACH STUD USED IN BUILT-UP HOLDDOWN POS. REFERENCE HOLDDOWN SCHEDULE & DETAILS FOR ADDITIONAL INFORMATION.
4. INTERMEDIATE FRAMING TO BE 2x MINIMUM MEMBERS UNO IN SCHEDULE. ATTACH SHEATHING TO INTERMEDIATE FRAMING WITH EDGE NAILING AT 12"OC WHERE STUDS ARE SPACED AT 16"OC AND EDGE NAILING AT 6"OC WHERE STUDS ARE SPACED AT 24"
5. SIMPSON STRONG-TIE "A35" MAY BE USED IN LIEU OF "LTP5." "LTP2" CLIPS SHALL BE ORIENTED LENGTHWISE 1 (HORIZONTAL) AT PLATE TO RIM. USE 0.131" x1 NAILS WHERE CLIPS ARE ATTACHED DIRECTLY TO FRAMING. USE Ø 2 1 0.131" x2 WHERE CLIPS ARE INSTALLED OVER SHEATHING. Ø 2
6. 2x STUDS NAILED TOGETHER MAY BE USED IN PLACE OF SINGLE 3x STUD. DOUBLE 2x STUDS SHALL BE SECURED TOGETHER WITH FASTENERS OF THE SAME DIAMETER AND SPACING AS THE BOTTOM PLATE ATTACHMENT PER SCHEDULE. WHERE SHEATHING IS APPLIED ON BOTH SIDES OF A SHEAR WALL AND NAIL SPACING IS LESS THAN 6"OC ON EITHER SIDE, THE WIDTH OF THE NAILED FACE OF THE FRAMING MEMBER SHALL BE 3" NOMINAL OR GREATER AT ADJOINING PANEL EDGES AND NAILS AT ALL PANEL EDGES SHALL BE STAGGERED. ALTERNATIVELY, PANELS SHALL BE STAGGERED SO THAT EDGE JOINTS ON OPPOSITE SIDES ARE NOT LOCATED ON THE SAME STUD.
7. ANCHOR BOLTS SHALL BE PROVIDED WITH MINIMUM 0.229"x 3"x 3" HOT-DIPPED GALVANIZED STEEL PLATE WASHERS PER DETAILS ON DRAWINGS. EMBED ANCHOR BOLTS 7" MINIMUM INTO THE CONCRETE PROVIDE AN ANCHOR BOLT AT EACH END OF EACH PLATE AND SHALL BE AT LEAST 7 TIMES THE ANCHOR BOLT DIAMETER FROM THE ENDS OF THE PLATE, BUT NOT MORE THAN 1 THE TABULATED ANCHOR BOLT SPACING OR 12", WHICHEVER IS LESS. SEE ANCHOR BOLT DETAIL FOR PLATE 2 5 WASHER REQUIREMENTS. [ALT: " 8 Øx8" TITEN HD ANCHOR SCREWS MAY BE USED IN LIEU OF ANCHOR BOLTS AT EXISTING CONCRETE, WITH PLATE WASHER & SPACING REQUIREMENTS PER SCHEDULE.]
8. PROVIDE HOT-DIPPED GALVANIZED NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) AT ALL PRESSURE TREATED LUMBER. REFERENCE GENERAL STRUCTURAL NOTES FOR ADDITIONAL INFORMATION.
9. PANELS MAY BE INSTALLED HORIZONTALLY IF STUDS ARE SPACED AT 16"OC MAX.
10. STAGGER EDGE NAILING.
11. THE TOP EDGE OF THE WOOD STRUCTURAL PANEL SHALL BE ATTACHED TO THE UPPER TOP PLATE. ROOF OR UPPER LEVEL UPLIFT CONNECTORS SHALL BE ON THE SAME SIDE OF THE WALL AS THE SHEATHING.
12. THE BOTTOM EDGE OF THE WOOD STRUCTURAL PANEL SHALL EXTEND TO AND BE ATTACHED TO THE BOTTOM OR SILL PLATE. REFERENCE DETAIL BELOW FOR STAGGERED NAIL AND SCREW SPACING AT RIM BOARDS.
13. WALL TYPE ACCEPTABLE WITH TRUSJOIST AND BOISE CASCADE RIM JOIST AND BLOCKING.

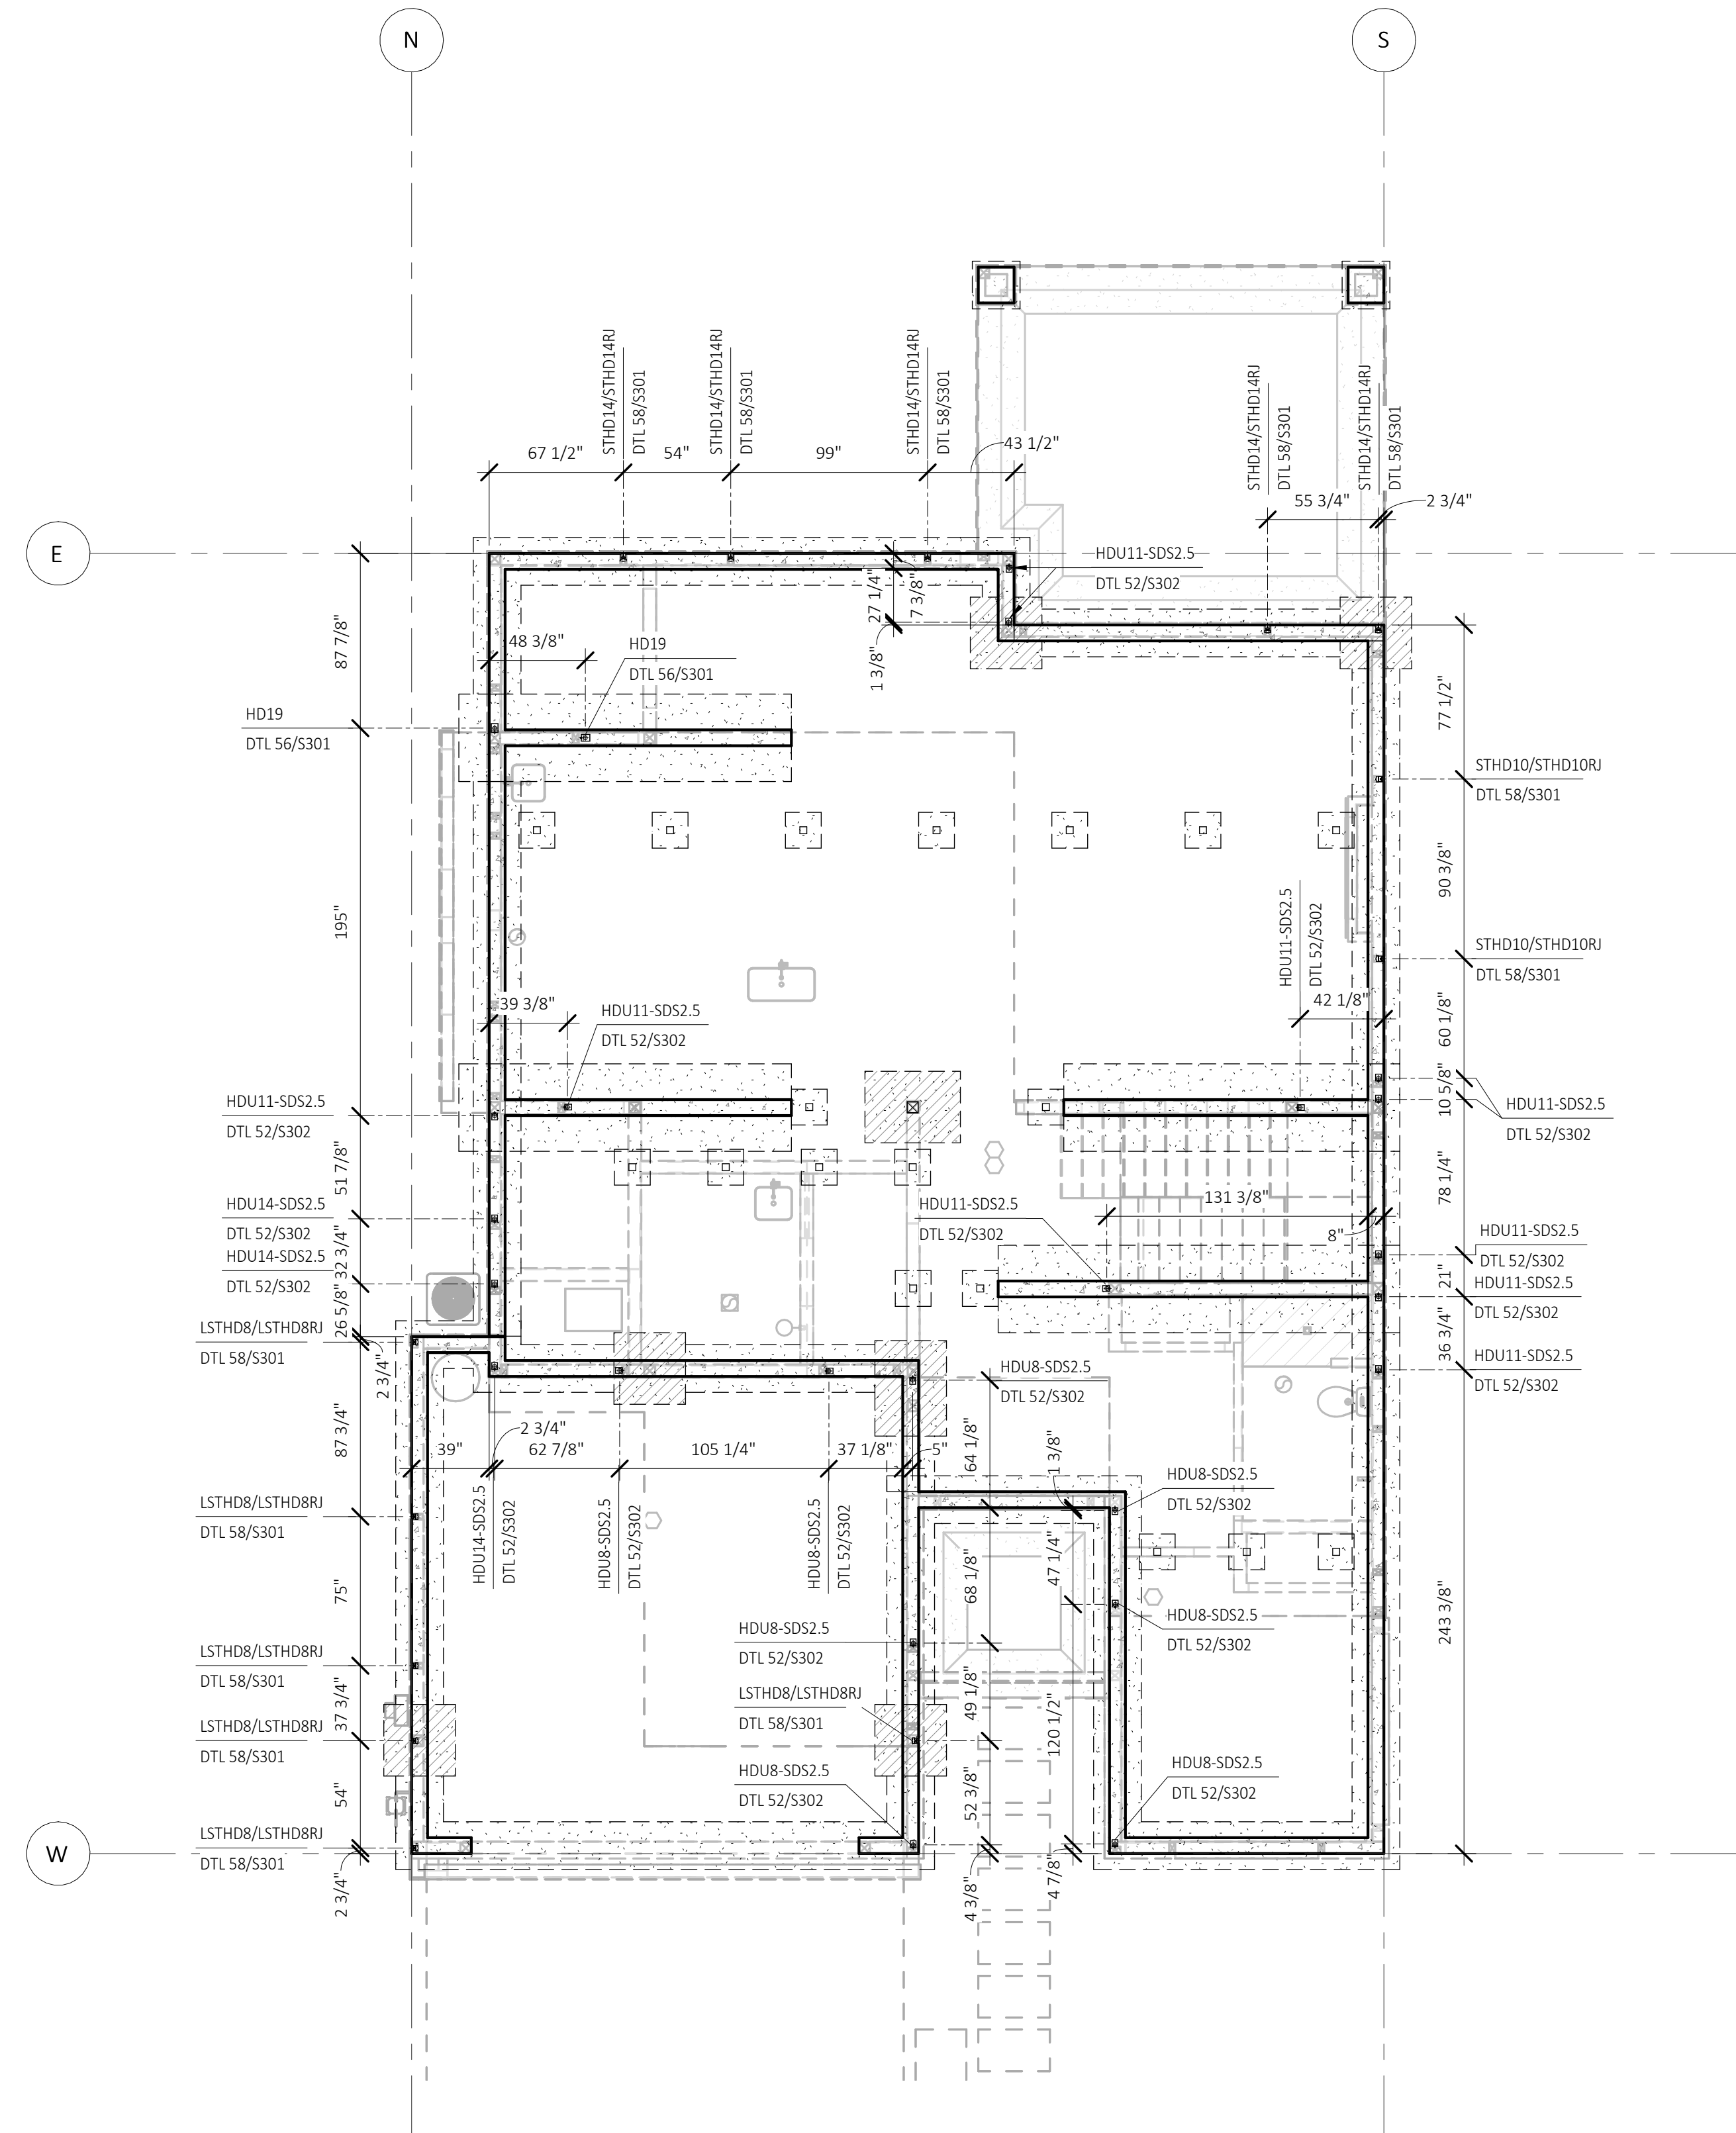


Description

Date

No.



L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072



ATERA DESIGN STUDIO
451 DUVAL AVE NE,
RENTON, W A 98059

HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET

FOUNDATION
HOLDDOWNS

PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

S201

SCALE 24X36: 3/16" = 1'-0"
* NOTE: 11X17 SETS ARE
REDUCED 50%; SCALE
DRAWINGS ACCORDINGLY.



© ATERA DESIGN STUDIO LLC. PLANS AND DESIGNS (DRAWINGS) FORTHWITH REMAIN THE PROPERTY OF ATERA DESIGN STUDIO. REPRODUCTION WITHOUT PERMISSION IS PROHIBITED.

Holdowns and Tension Tie SCHEDULE

TYPE	MIN END STUD	FASTENERS			DETAIL	Count	Manufacturer	ALLOWABLE UPLIFT (DF / HF)
		ANCHOR BOLT	NAILS/SCREWS	CONCRETE ANCHOR				
CS16-11"			(22) 10d		DTL 272/S303	4	Simpson Strong Tie or EQ.	1705 / --
CS14-15"			(30) 10d		DTL 272/S303	2	Simpson Strong Tie or EQ.	2490 / --
CMSTC16-20"			(58) 16d SINKER		DTL 272/S303	8	Simpson Strong Tie or EQ.	4960 / --
(2) HDU11-SDS2.5 2	4X	1"	(30) SDS 1/4"x2 1/2"		DTL 52/S302	2	Simpson Strong Tie or EQ.	9535 / --
FLOOR TO FLOOR								
LSTHD8/LSTHD8RJ	(2) 2X		(20) 0.148 X 3-1/4"		DTL 58/S301	6	Simpson Strong Tie or EQ.	1610 / --
STHD10/STHD10RJ	(2) 2X		(28) 0.148 X 3-1/4"		DTL 58/S301	2	Simpson Strong Tie or EQ.	2175 / --
STHD14/STHD14RJ	(2) 2X		(30) 0.148 X 3-1/4"		DTL 58/S301	5	Simpson Strong Tie or EQ.	3500 / --
HDU8-SDS2.5	4X6	7/8"	(20) SDS 1/4"x2 1/2"	PAB6	DTL 52/S302	8	Simpson Strong Tie or EQ.	7870 / 6580
HDU11-SDS2.5	4X8	1"	(30) SDS 1/4"x2 1/2"	PAB7	DTL 52/S302	11	Simpson Strong Tie or EQ.	11175 / 9610
HDU14-SDS2.5	6X6	1"	(36) SDS 1/4"x2 1/2"	PAB8	DTL 52/S302	3	Simpson Strong Tie or EQ.	14445 / 12425
HD19	6X6	1-1/4"	(5) 1" BOLTS	PAB10	DTL 56/S301	2	Simpson Strong Tie or EQ.	19070 / 16210
HOLDDOWN								
MSTC48B3	(2) 2X		REF DETAIL		DTL 269/S303	9	Simpson Strong Tie or EQ.	3795 / 3900
MSTC68B3Z	4X		REF DETAIL		DTL 269/S303	1	Simpson Strong Tie or EQ.	4490 / --
OVERHANG								

WOOD FRAMED SHEARWALL SCHEDULE


SHEARWALL TYPE	WALL SHT'G APA RATED	EDGE NAIL'G	BOT PLATE CONNECTION	FRAM'G CONNECTION AT WALL BELOW	MIN RIM THICKNESS	FRAM'G AT PANEL EDGES	BLK'G AT PANEL EDGES	P.T. 2X SILL		P.T. 3X SILL	
								ANCHOR BOLT	SHEAR CAPACITY (WIND/SEISMIC)	ANCHOR BOLT	SHEAR CAPACITY (WIND/SEISMIC)
sw6	15/32"	8D AT 6" O.C.	(2) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 18" O.C.	1-1/4"	2X	2X	5/8" DIA AT 48" O.C.	242 / 339	5/8" DIA AT 60" O.C.	242 / 339
sw4	15/32"	8D AT 4" O.C.	(2) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 12" O.C.	1-3/4"	3X OR (2) 2X	3X OR FLAT 2X	5/8" DIA AT 32" O.C.	353/495	5/8" DIA AT 40" O.C.	353/495
sw3	15/32"	8D AT 3" O.C.	(2) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 10" O.C.	1-3/4"	3X OR (2) 2X	3X OR FLAT 2X	5/8" DIA AT 24" O.C.	456 / 637	5/8" DIA AT 32" O.C.	456 / 637
sw2	15/32"	8D AT 2" O.C.	(2) ROWS 16D COMMON AT 4" O.C. STAGGERED	LPTS'S AT 6" O.C.	3-1/2"	3X OR (2) 2X	3X OR FLAT 2X	5/8" DIA AT 18" O.C.	595 / 832	5/8" DIA AT 24" O.C.	595 / 832
2sw4	15/32" BOTH SIDES	8D AT 4" O.C.	(3) ROWS 16D COMMON AT 6" O.C. STAGGERED	LPTS'S AT 5" O.C.	3-1/2"	3X	3X	5/8" DIA AT 24" O.C.	707 / 990	5/8" DIA AT 32" O.C.	707 / 990
2sw3	15/32" BOTH SIDES	8D AT 3" O.C.	(3) ROWS 16D COMMON AT 4" O.C. STAGGERED	LPTS'S AT 8" O.C. AND A35 AT 8" O.C.	3-1/2"	3X	3X	5/8" DIA AT 16" O.C.	911 / 1274	5/8" DIA AT 24" O.C.	911 / 1274
2sw2	15/32" BOTH SIDES	8D AT 2" O.C.	(3) ROWS 16D COMMON AT 4" O.C. STAGGERED	LPTS'S AT 6" O.C. AND A35 AT 6" O.C.	3-1/2"	3X	3X	5/8" DIA AT 12" O.C.	1190 / 1469	5/8" DIA AT 16" O.C.	1190 / 1469

SHEARWALL LEGEND:

- # SHEARWALL TAG: SEE SHEARWALL SCHEDULE AND STRUCTURAL NOTES ON THIS SHEET.
- ALL EXTERIOR WALLS TO BE sw6 SHEAR WALLS U.N.O.
- FOR WALL CONSTRUCTION FOR WALLS THAT EXTEND THRU WINDOWS SHEATH ABV AND BELOW WINDOW & STRAP PER DETAIL ON SHEET D101
- HHDN INDICATES STRUCTURAL KEYNOTE FOR HOLDDOWN WITH INDEXED NUMBER. SEE STRUCTURAL KEYNOTE SCHEDULE THIS SHEET. SEE STRUCTURAL NOTES ON SHEET S101
- DET #/# EXTENT OF SHEARWALL
- - - SHEARWALL BELOW

SHEAR WALL NOTES

- ALL NAILS ARE COMMON. UNO. REFERENCE GENERAL STRUCTURAL NOTES FOR NAIL DIAMETER AND LENGTH. REFERENCE SHEAR WALL KEY DETAIL FOR DESCRIPTION OF TERMS.
- PROVIDE SHEAR WALL SHEATHING AND NAILING FOR ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF SHEAR WALLS ARE TYPICALLY AT WINDOWS, DOORWAYS OR AS SHOWN ON PLAN.
- EDGE NAILING IS REQUIRED AT ALL HOLDDOWN POSTS. EDGE NAILING IS REQUIRED TO EACH STUD USED IN BUILT-UP HOLDDOWN POSTS. REFERENCE HOLDDOWN SCHEDULE & DETAILS FOR ADDITIONAL INFORMATION.
- INTERMEDIATE FRAMING TO BE 2x MINIMUM MEMBERS UNO IN SCHEDULE. ATTACH SHEATHING TO INTERMEDIATE FRAMING WITH EDGE NAILING AT 12"OC WHERE STUDS ARE SPACED AT 16"OC AND EDGE NAILING AT 6"OC WHERE STUDS ARE SPACED AT 24"
- SIMPSON STRONG-TIE "A35" MAY BE USED IN LIEU OF "LTP5." "LTP5" CLIPS SHALL BE ORIENTED LENGTHWISE 1 (HORIZONTAL) AT PLATE TO RIM. USE 0.131" x 1" NAILS WHERE CLIPS ARE ATTACHED DIRECTLY TO FRAMING. USE Ø 2 1/2 0.131" x 2 WHERE CLIPS ARE INSTALLED OVER SHEATHING. Ø 2
- (2) 2x STUDS NAILED TOGETHER MAY BE USED IN PLACE OF SINGLE 3x STUD. DOUBLE 2x STUDS SHALL BE SECURED TOGETHER WITH FASTENERS OF THE SAME DIAMETER AND SPACING AS THE BOTTOM PLATE ATTACHMENT PER SCHEDULE.
- WHERE SHEATHING IS APPLIED ON BOTH SIDES OF A SHEAR WALL AND NAIL SPACING IS LESS THAN 6"OC ON EITHER SIDE, THE WIDTH OF THE NAILED FACE OF THE FRAMING MEMBER SHALL BE 3" NOMINAL OR GREATER AT ADJOINING PANEL EDGES AND NAILS AT ALL PANEL EDGES SHALL BE STAGGERED. ALTERNATIVELY, PANELS SHALL BE STAGGERED SO THAT EDGE JOINTS ON OPPOSITE SIDES ARE NOT LOCATED ON THE SAME STUD.
- ANCHOR BOLTS SHALL BE PROVIDED WITH MINIMUM 0.229" x 3" x 3" HOT-DIPPED GALVANIZED STEEL PLATE WASHERS PER DETAILS ON DRAWINGS. EMBED ANCHOR BOLTS 7" MINIMUM INTO THE CONCRETE PROVIDE AN ANCHOR BOLT AT EACH END OF EACH PLATE AND SHALL BE AT LEAST 7 TIMES THE ANCHOR BOLT DIAMETER FROM THE ENDS OF THE PLATE, BUT NOT MORE THAN 1 THE TABULATED ANCHOR BOLT SPACING OR 12", WHICHEVER IS LESS. SEE ANCHOR BOLT DETAIL FOR PLATE 2 5 WASHER REQUIREMENTS. [ALT: " 8 ØX8" TITEN HD ANCHOR SCREWS MAY BE USED IN LIEU OF ANCHOR BOLTS AT EXISTING CONCRETE, WITH PLATE WASHER & SPACING REQUIREMENTS PER SCHEDULE.]
- PROVIDE HOT-DIPPED GALVANIZED NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) AT ALL PRESSURE TREATED LUMBER. REFERENCE GENERAL STRUCTURAL NOTES FOR ADDITIONAL INFORMATION.
- PANELS MAY BE INSTALLED HORIZONTALLY IF STUDS ARE SPACED AT 16"OC MAX.
- STAGGER EDGE NAILING.
- THE TOP EDGE OF THE WOOD STRUCTURAL PANEL SHALL BE ATTACHED TO THE UPPER TOP PLATE. ROOF OR UPPER LEVEL UPLIFT CONNECTORS SHALL BE ON THE SAME SIDE OF THE WALL AS THE SHEATHING.
- THE BOTTOM EDGE OF THE WOOD STRUCTURAL PANEL SHALL EXTEND TO AND BE ATTACHED TO THE BOTTOM OR SILL PLATE. REFERENCE DETAIL BELOW FOR STAGGERED NAIL AND SCREW SPACING AT RIM BOARDS.
- WALL TYPE ACCEPTABLE WITH TRUSJOIST AND BOISE CASCADE RIM JOIST AND BLOCKING.

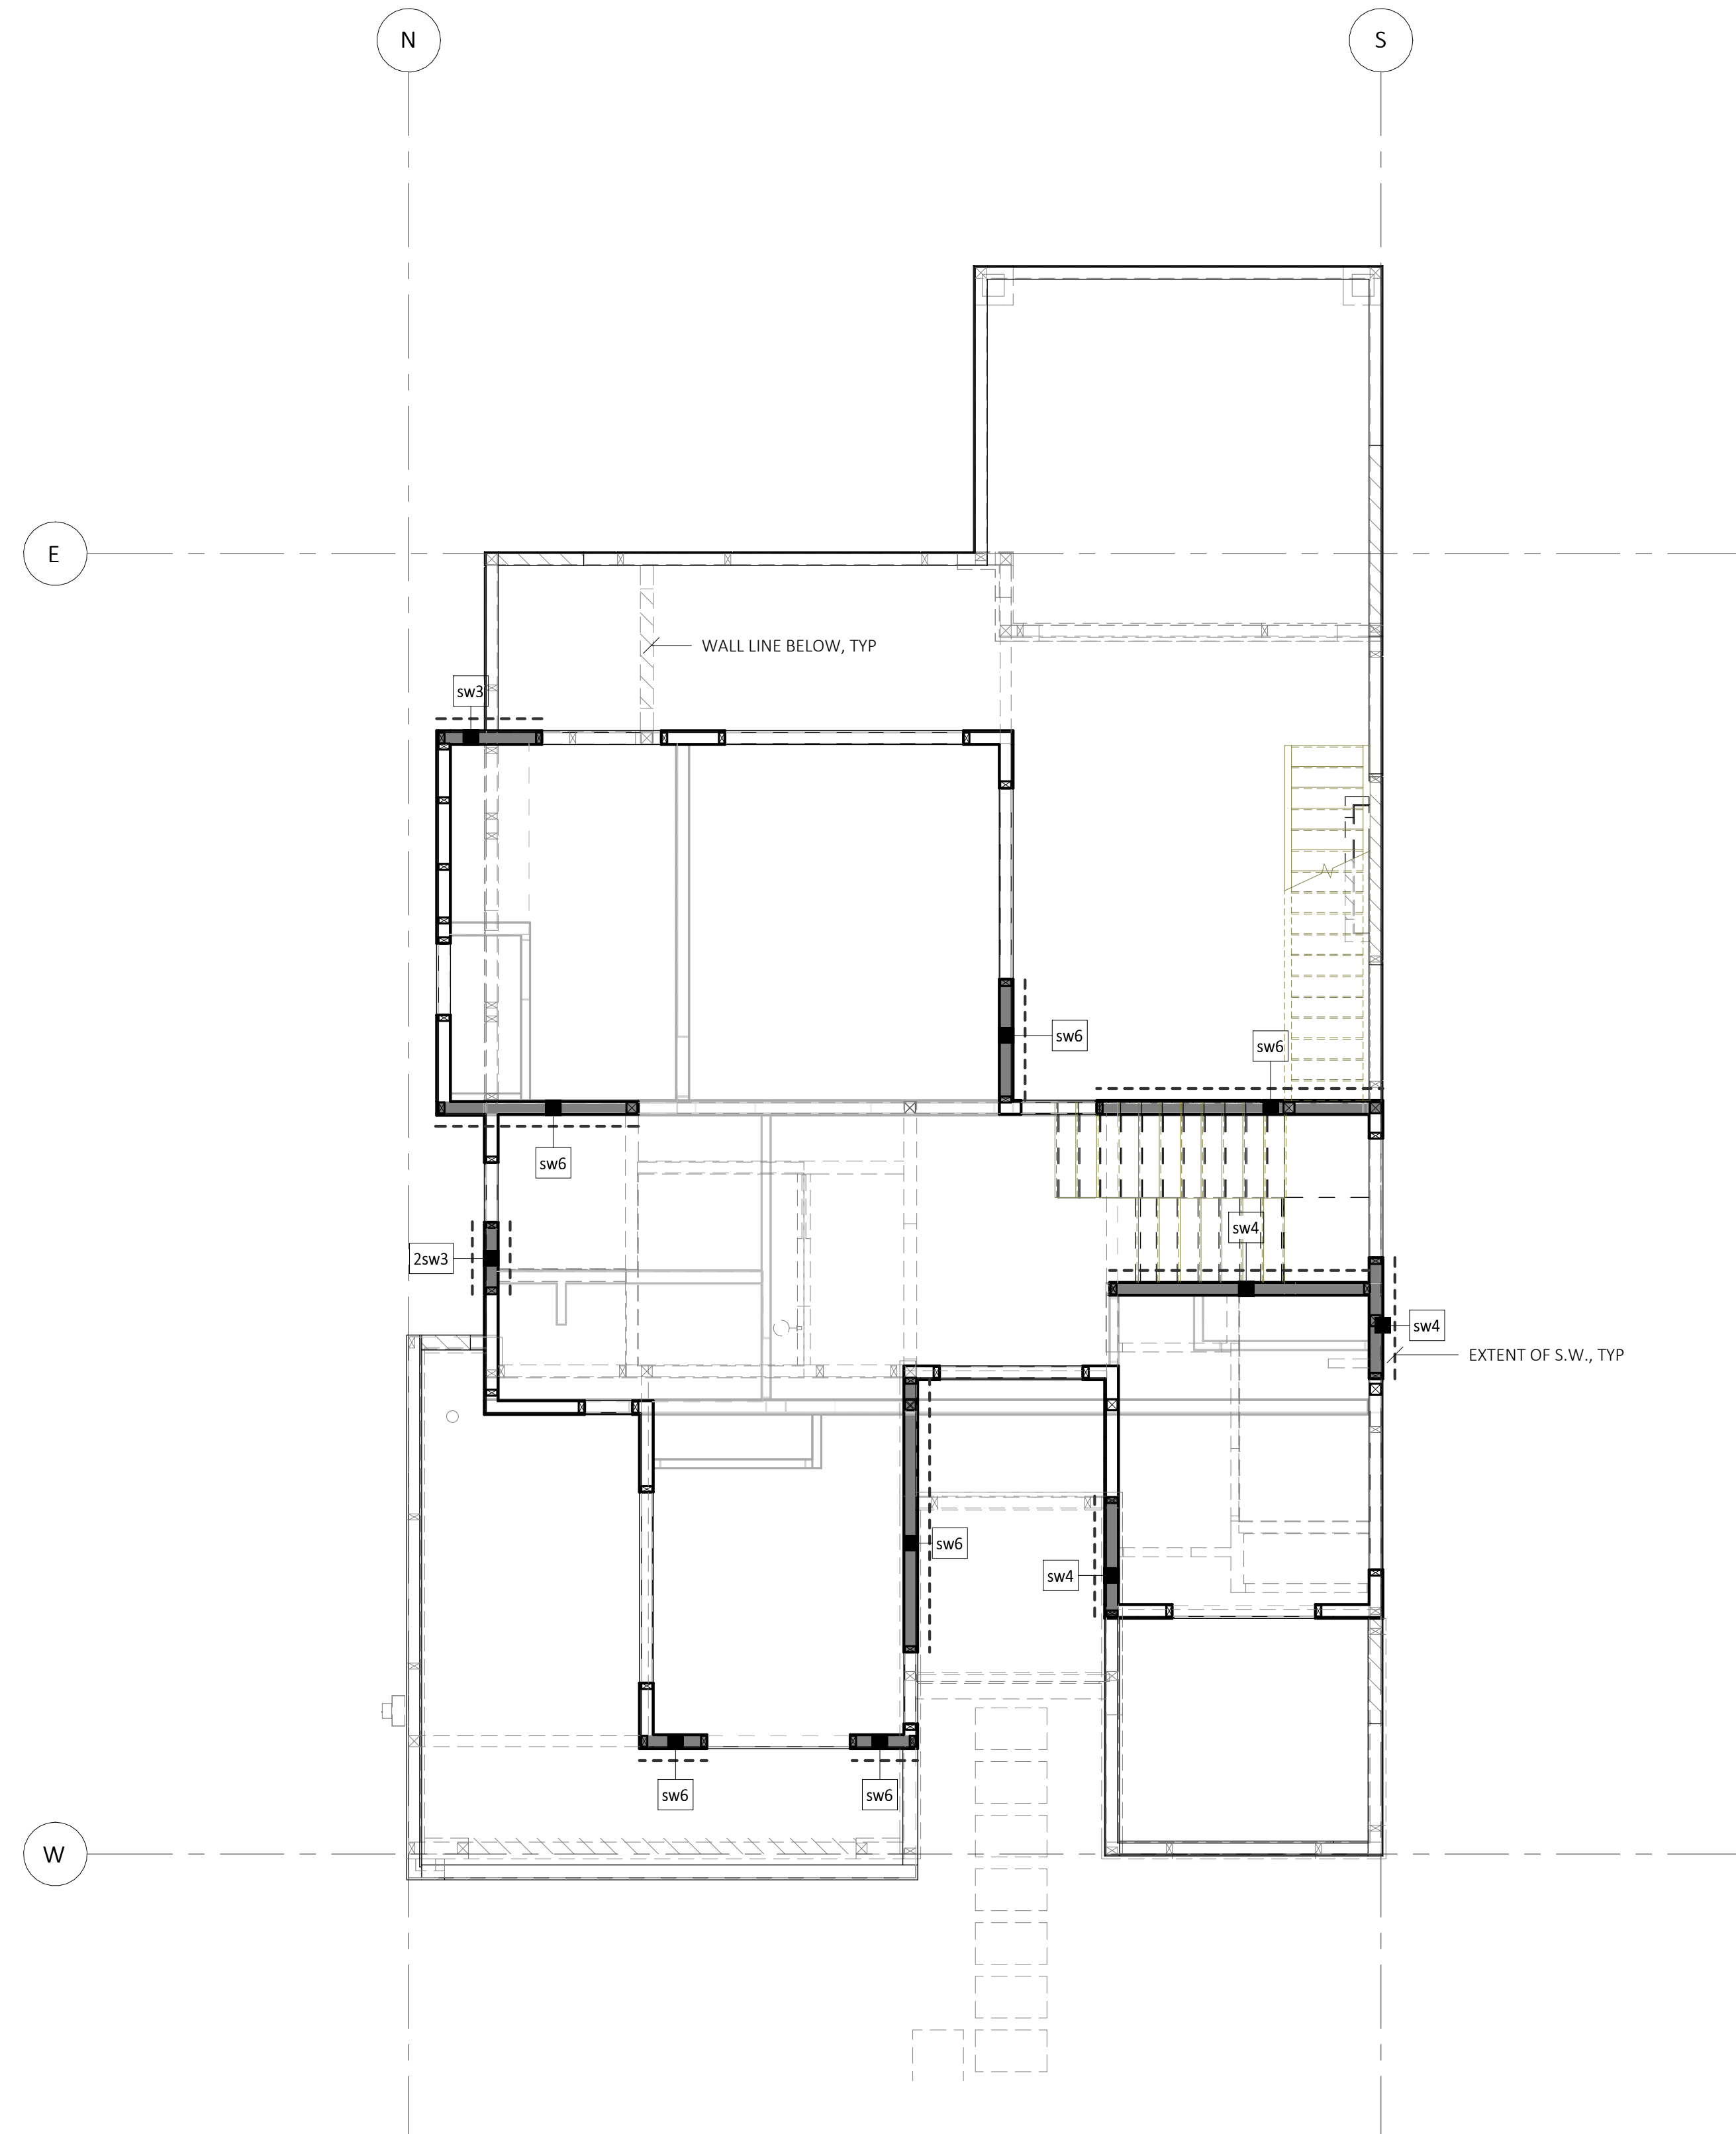

Description


Date

No.



L2 ENGINEERS
17848 NE 198TH PLAVE
WOODINVILLE, WA 98072

ATERA DESIGN STUDIO
451 DUVALL AVE NE,
RENTON, WA 98059

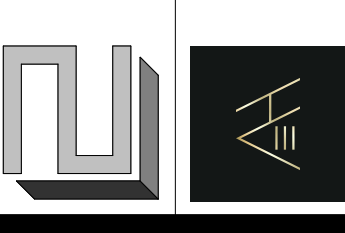

HU RESIDENCE

2448 72nd AVE SE, Mercer Island

PERMIT SET

UPPER FLOOR
SHEARWALLS

PROJECT NO: 21014
ISSUE DATE: 2022/06/29
DRAWN BY: SPM

S203

SCALE 24X36: 3/16" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



Simpson Strong-Tie® Wood Construction Connectors
CBTZ

Concealed Beam Tie

CBTZ is part of the concealed structural connector line that combines structural strength with invisibility. Designed to connect horizontal beams atop a vertical post, the CBTZ continues the structural load path into the foundation through the CPTZ. The simple cylindrical design allows installations with a common drill bit, eliminating challenging hole cuts. The CBTZ is available in two models designed to connect beams and posts of a variety of sizes. It is part of a concealed connector system that includes the CPTZ and C-TZ.

Features:

- Flattened sides assist installer while using the CBTZ as a template
- Locator tabs provide proper dimensional layout
- Required dowel pins included
- Orientation markings distinguish which end installs into the post and which end goes into the beam


Material: 12 gauge

Finish: CBT - ZMAX® coating; the 1/2" diameter drift dowels are mechanically galvanized in accordance with ASTM B685, Class 55.

Installation:

- Use all specified fasteners; see General Notes
- 1/2" dowels included
- CBTZ requires a minimum 6" deep normal beam
- For step-by-step installation instructions, see technical bulletin T-C-CBTZINS or view our video on strongtie.com

Codes: See p. 11 for Code Reference Key Chart

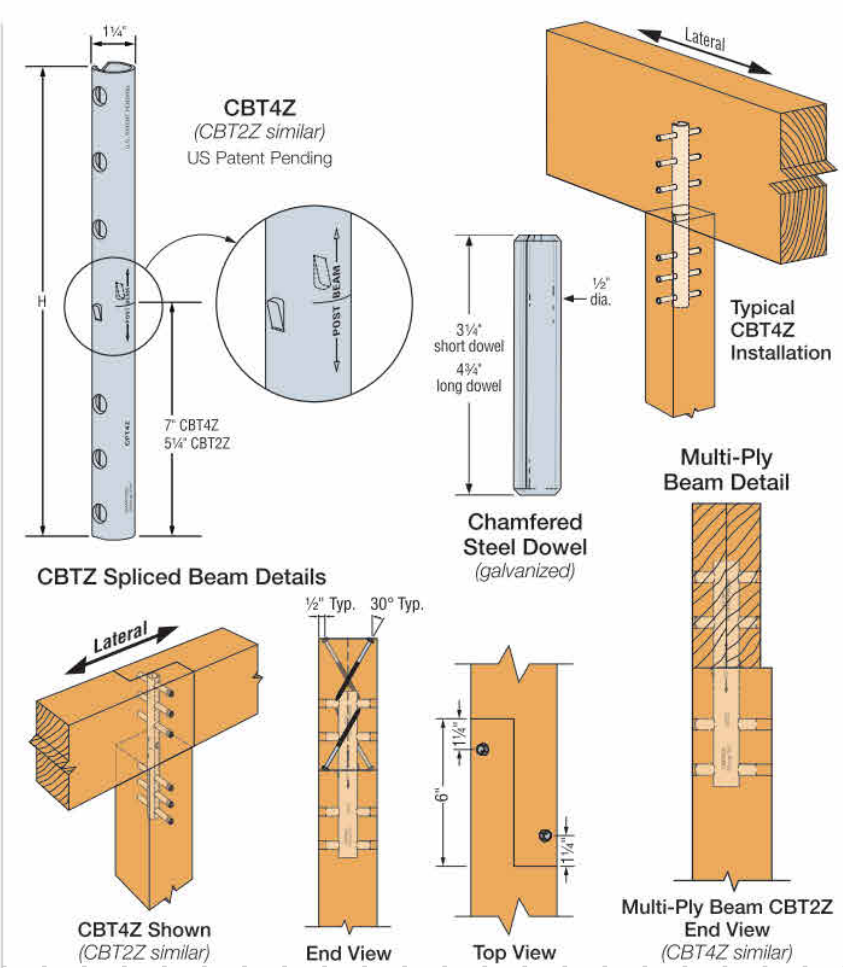

These products are available with additional corrosion protection. For more information, see p. 14.

Model No.	Post (Min.)	Beam (Min.)	Dimensions (in.)		CBTZ Fasteners		Splice Fasteners		Allowable Loads (DF/SP)				Code Ref.	
			W	H	Post	Beam	Quantity	Type	Continuous Beam Uplift (160)	End of Beam Uplift (160)	Uplift (160)	Down (160)		
Standard Installation														
CBTZ2	4x4	4x6	1 1/4	10	2	2	1/2" x 3 1/4" dowel	2,020	750	6,880	1,585	550	6,880	IBC, FL, LA
CBTZ4	6x6	6x8	1 1/4	14	3	3	1/2" x 4 1/4" dowel	4,215	1,655	10,140	3,685	1,055	10,140	IBC, FL, LA
Alternate Installation - Multi-Ply Beam														
CBTZ2	4x4	2x6	1 1/4	10	2	2	1/2" x 2 1/4" dowel	1,015	550	5,275	1,015	550	5,275	IBC, FL, LA
CBTZ4	6x6	3x8	1 1/4	14	3	3	1/2" x 3 1/4" dowel	2,240	1,055	14,700	2,240	1,055	14,700	IBC, FL, LA
Alternate Installation - Spliced Beam														
CBTZ2	4x4	4x6	1 1/4	10	2	2	1/2" x 3 1/4" dowel	2,020	750	6,880	1,585	550	6,880	IBC, FL, LA
CBTZ4	6x6	6x8	1 1/4	14	3	3	1/2" x 4 1/4" dowel	4,215	1,655	10,140	3,685	1,055	10,140	IBC, FL, LA

- Uplift and lateral loads have been increased for earthquake or wind loading with no further increase allowed. Reduce where other loads govern.
- Downloads shall be reduced where limited by capacity of the post.
- CPTZ concealed post ties are supplied with 1/2" diameter dowel pins. Alternative 1/2" diameter hex- or square-head machine bolts may be used for loads tested.
- Lag screws or carriage bolts are not permitted.
- Structural composite lumber columns have sides that show either the wide face or the edges of the lumber strands/veneers. Values in the tables reflect dowel or bolt installation into the wide face.
- See figure for placement of the additional SDS fasteners required for the splice connector.
- Dowels included in CBTZ kits do not match required lengths for the multi-ply application. The sizes shown in the table above need to be ordered separately or trimmed in the field.
- Build-up (multiple members) must be fastened together to act as one to resist the applied load (including the connector fasteners). This must be determined by the designer.
- Center CBTZ on built-up beam. Loads are applicable to beam installation flush to one side of post or beam centered on post.

Simpson Strong-Tie® Wood Construction Connectors
CPTZ

Concealed Post Tie

The CPTZ concealed post base provides a clean, concealed look while providing a 1" standoff height above concrete. The 1" standoff reduces the potential for decay at the post end and satisfies code requirements for posts that are exposed to weather, water splash or in basements. It is part of a system of concealed connectors that includes the CBTZ and C-TZ.

Features:

- The CPTZ is tested and load-rated for uplift, downward and lateral load.
- Simpson Strong-Tie saves installers time by providing all the necessary components to make the post connection in one box (anchors not included).
- There are two anchorage solutions available. See tables for information.
- Solutions have been calculated per ACI 318 to determine their allowable load in different concrete configurations.


Material: See table below

Finish: Knife plate, washers and standoff base are ZMAX®, galvanized steel. The standoff base has an additional textured, flat black powder-coat finish for aesthetic purposes. The 1/2" diameter drift dowels are mechanically galvanized in accordance with ASTM B685, Class 55. If substituting 1/2" diameter bolts, a hot-dip galvanized finish is recommended. Some available in stainless steel (see table).

Installation:

- Use all specified fasteners; see General Notes
- More extensive installation instructions are available through our Literature Library app or by visiting strongtie.com
- Post bases do not provide adequate resistance to prevent members from rotating about the base and therefore are not recommended for non-braced, or non-top-supported installations

Codes: See p. 11 for Code Reference Key Chart

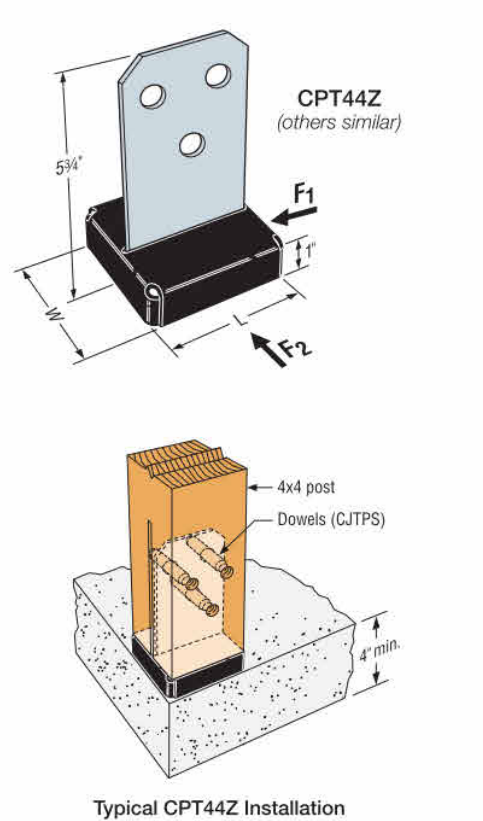

These products are available with additional corrosion protection. For more information, see p. 14. For stainless-steel fasteners, see p. 21.

Model No.	Nominal/Post Size	Beam (Min.)	Dimensions (in.)	Anchor	Fasteners	Allowable Loads (DF/SP)				Code Ref.		
						Uplift (160)	Down (100)	F ₁ (160)	F ₂ (160)			
CP144Z	4x4	12	10	3/4	2	1/2	3	3,035	11,455	600	605	IBC, FL, LA
CP166Z	6x6	12	10	5/8	2	1/2	3	4,855	20,130	655	1,025	IBC, FL, LA
CP188Z	8x8	12	10	7/8	2	1/2	3	4,315	22,805	740	1,080	IBC, FL, LA

- Uplift loads have been increased for earthquake or wind loading with no further increase allowed. Reduce where other loads govern.
- Downloads shall be reduced where limited by capacity of the post.
- CPTZ concealed post ties are supplied with 1/2" diameter dowel pins. Alternative 1/2" diameter hex- or square-head machine bolts may be used for loads tested.
- Lag screws or carriage bolts are not permitted.
- Structural composite lumber columns have sides that show either the wide face or the edges of the lumber strands/veneers. For SCL columns, the fasteners for these products should always be installed in the wide face. See technical bulletin T-C-SCL-CM for more information.
- Uplift loads have been increased for earthquake or wind loading with no further increase allowed. Reduce where other loads govern.
- Specifier is to design concrete and anchorage for uplift capacity.
- Beam depth must be a minimum of 7 1/2".
- Shims are required for double 2x11 shims and triple 2x11 shims installations as shown in the illustration. Additional fasteners of shims to beam is not required.
- Fasteners: Nail dimensions are listed diameter by length. See pp. 21-22 for fastener information.

Simpson Strong-Tie® Wood Construction Connectors
ABA/ABU/ABW

Adjustable and Standoff Post Bases

Additional standoff bases are on p. 331.

The ABA Series of retrofit adjustable post bases provide a 1" standoff for the post, are slotted for adjustability and can be installed with nails, Strong-Drive® SD Connector screws or bolts (ABU). Depending on the application needs, these adjustable standoff post bases are designed for versatility, cost-effectiveness and maximum uplift performance.

Features:


- The slot in the base enables flexible positioning around the anchor bolt, making precise post placement easier.
- The 1" standoff helps prevent rot at the end of the post and meets code requirements for structural posts installed in basements or exposed to weather or water splash.

Material: Varies (see table)

Finish: ZMAX® and some in stainless steel; see Corrosion Information, pp. 12-15

Installation:

- Use all specified fasteners; see General Notes
- See our Anchoring, Fastening, Restoration and Strengthening Systems for Concrete and Masonry catalog, or visit strongtie.com for retrofit anchor options, such as Titan HD®, Stainless Steel Titan HD or SET-3G™.
- Post bases do not provide adequate resistance to prevent members from rotating about the base and therefore are not recommended for non-top-supported installations (such as fences or unbraced carports).
- Place the base, cut washers (or load transfer plate) and nuts on the anchor bolts. Make any necessary adjustments to post placement and tighten the nut securely on the anchor bolt.
- See strongtie.com for information on hollow column installation.

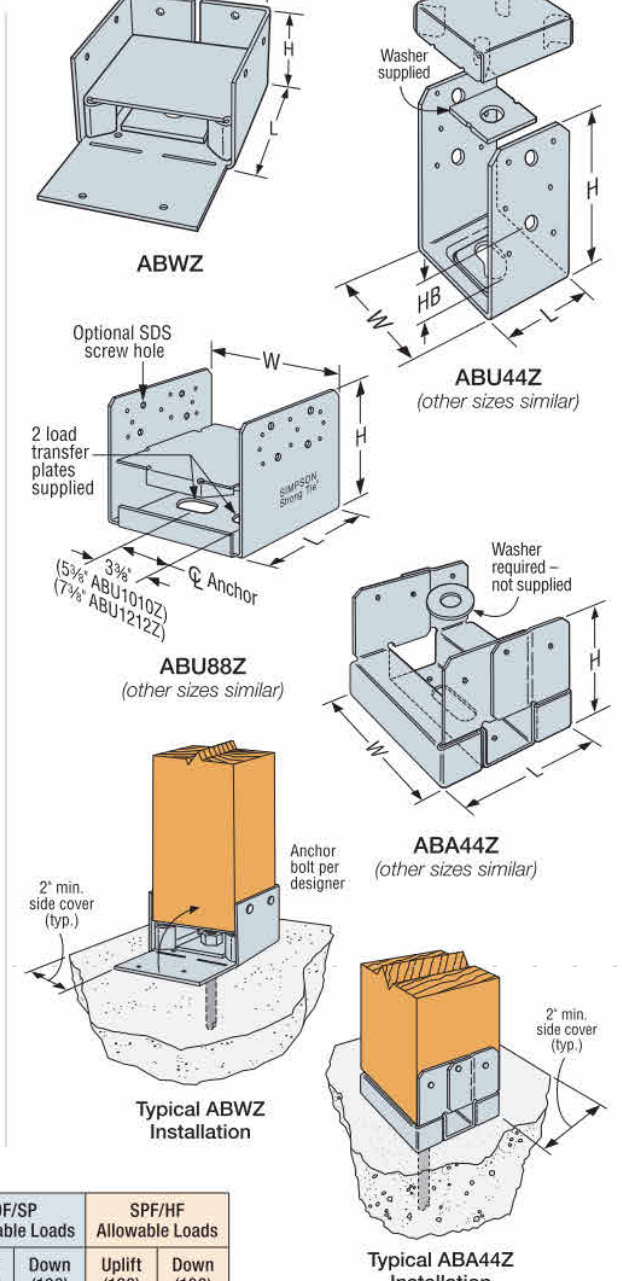

These products are available with additional corrosion protection. For more information, see p. 14. For stainless-steel fasteners, see p. 21.

Model No.	Nominal Beam Size	Material (ksi)	Dimensions (in.)	Fasteners (in.)	DF/SP Allowable Loads				Code Ref.				
					Uplift (160)	Down (100)	F ₁ (160)	F ₂ (160)					
ABA18Z	Double 2x12	12	12	3/4	5	7	1/2	(12) 0.162 x 3 1/2	2,030	6,475	1,820	6,075	IBC, FL, LA
ABA4Z	4x4	12	12	3/4	5	7	1/2	(12) 0.162 x 3 1/2	2,355	3,890	1,850	7,095	IBC, FL, LA
ABA4RZ	Rough 4x4	12	12	3/4	5	7	1/2	(12) 0.162 x 3 1/2	2,155	3,890	1,850	7,095	IBC, FL, LA
ABA6Z	6x6	12	12	5/8	5	7	1/2	(12) 0.162 x 3 1/2	1,405	12,715	1,165	8,115	IBC, FL, LA
ABA6RZ	Rough 6x6	12	12	5/8	5	7	1/2	(12) 0.162 x 3 1/2	1,905	12,920	1,640	11,110	IBC, FL, LA
ABA6ZZ	Rough 6x6	12	12	5/8	5	7	1/2	(12) 0.162 x 3 1/2	1,905	12,920	1,640	11,110	IBC, FL, LA

Simpson Strong-Tie® Wood Construction Connectors
HDU/DTT

Holdowns

HDU holdowns are pre-deflected during the manufacturing process, virtually eliminating deflection under load due to material stretch. They use Strong-Drive® SDS Heavy-Duty Connector screws which install easily, reduce fastener slip and provide a greater net section when compared to bolts.

The DTT tension ties are designed for lighter-duty holdown applications on single 2x posts. The DTT is installed with nails or Strong-Drive SD Connector screws and the DTT2 installs easily with the Strong-Drive SDS Heavy-Duty Connector screws (included). The DTT2 holdowns have been tested for use in designed shearwalls and prescriptive braced wall panels as well as prescriptive wood-deck applications (see p. 295 for deck applications).

For more information on holdown options, contact Simpson Strong-Tie.

HDU Features:

- Uses Strong-Drive SDS Heavy-Duty Connector screws which install easily, reduce fastener slip and provide a greater net section area of the post compared to bolts
- Strong-Drive SDS Heavy-Duty Connector screws are supplied with the holdowns to ensure proper fasteners are used
- No stud bolts to countersink at openings


Material: See table

Finish: HDU - galvanized; DTT1Z and DTT2Z - ZMAX® (ABU/BSZ, ABU1010Z, ABU1212Z - SS optional)

Installation:

- See Hold-down and Tension Tie General Notes on pp. 40-50.
- The HDU requires no additional washer; the DTT requires a standard-out washer (included) be installed between the nut and the seat.
- Strong-Drive SDS Heavy-Duty Connector screws install best with a low-speed high-torque drill with a 1/2" hex-head driver.
- Fasteners and crescent washer are included with the holdowns. For replacements, order part no. SDSS212-HDU (Fit in the size needed, e.g., HDU2.)

Codes: See p. 11 for Code Reference Key Chart

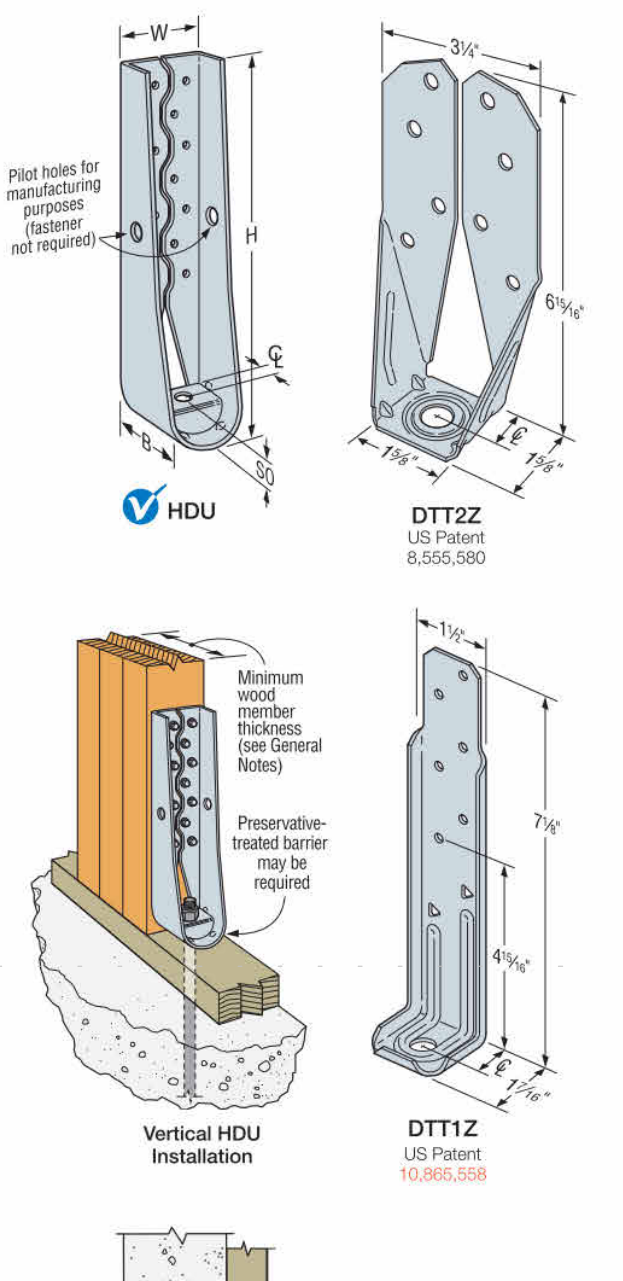

These products are available with additional corrosion protection. For more information, see p. 14. For stainless-steel fasteners, see p. 21. Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 348-352 for more information.

Model No.	Ga.	Dimensions (in.)					Fasteners (in.)	Minimum Wood Member Size (in.)	Allowable Tension Loads (lb)			Code Ref.
		W	H	B	CL	SO			DF/SP	SP/FH	Deflection at Allowable Load (in.)	
DTT1Z	14	1 1/2	7 1/4	1 1/4	1 1/4	1/4	1/4	1 1/2	840	840	0.17	IBC, FL, LA
DTT2Z	14	3 1/4	6 1/4	1 1/4	1 1/4	1/4	1/4	1 1/2	910	850	0.167	IBC, FL, LA
HDU1-SDS2.5	14	3	8 1/4	3/4	1 1/4	1 1/4	1/4	1 1/2	3,075	2,215	0.088	IBC, FL, LA
HDU4-SDS2.5	14	3	10 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	4,665	3,285	0.114	IBC, FL, LA
HDU8-SDS2.5	14	3	13 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	5,645	4,340	0.115	IBC, FL, LA
HDU11-SDS2.5	14	3	16 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	6,765	5,820	0.111	IBC, FL, LA
HDU14-SDS2.5	14	3	19 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	7,870	6,580	0.113	IBC, FL, LA
HDU17-SDS2.5	14	3	22 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	9,335	8,030	0.137	IBC, FL, LA
HDU20-SDS2.5	14	3	25 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	11,175	9,610	0.137	IBC, FL, LA
HDU23-SDS2.5	14	3	28 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	13,015	11,275	0.177	IBC, FL, LA
HDU26-SDS2.5	14	3	31 3/4	3/4	1 1/4	1 1/4	1/4	1 1/2	14,855	12,425	0.172	IBC, FL, LA

Simpson Strong-Tie® Wood Construction Connectors
ABA/ABU/ABW

Adjustable and Standoff Post Bases (cont.)

Additional standoff bases are on p. 331.

The ABA Series of retrofit adjustable post bases provide a 1" standoff for the post, are slotted for adjustability and can be installed with nails, Strong-Drive® SD Connector screws or bolts (ABU). Depending on the application needs, these adjustable standoff post bases are designed for versatility, cost-effectiveness and maximum uplift performance.

Features:


- The slot in the base enables flexible positioning around the anchor bolt, making precise post placement easier.
- The 1" standoff helps prevent rot at the end of the post and meets code requirements for structural posts installed in basements or exposed to weather or water splash.

Material: Varies (see table)

Finish: ZMAX® and some in stainless steel; see Corrosion Information, pp. 12-15

Installation:

- Use all specified fasteners; see General Notes
- See our Anchoring, Fastening, Restoration and Strengthening Systems for Concrete and Masonry catalog, or visit strongtie.com for retrofit anchor options, such as Titan HD®, Stainless Steel Titan HD or SET-3G™.
- Post bases do not provide adequate resistance to prevent members from rotating about the base and therefore are not recommended for non-top-supported installations (such as fences or unbraced carports).
- Place the base, cut washers (or load transfer plate) and nuts on the anchor bolts. Make any necessary adjustments to post placement and tighten the nut securely on the anchor bolt.
- See strongtie.com for information on hollow column installation.

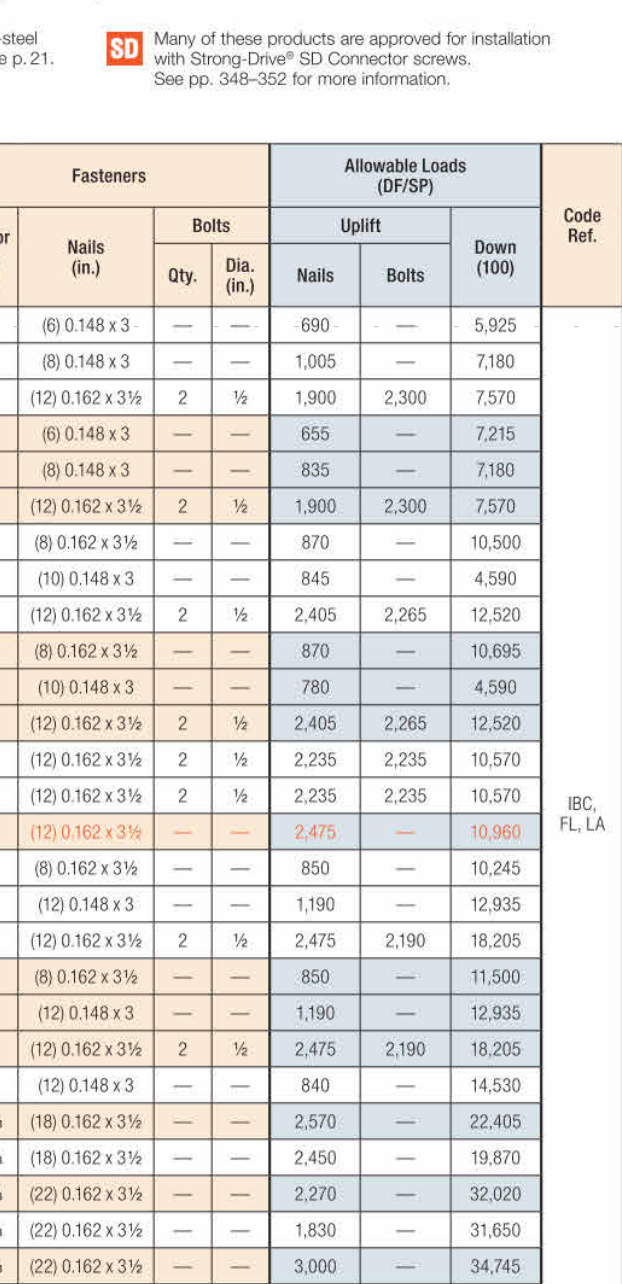

These products are available with additional corrosion protection. For more information, see p. 14. For stainless-steel fasteners, see p. 21. Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 348-352 for more information.

Model No.	Nominal Beam Size	Material (ksi)	Dimensions (in.)	Fasteners (in.)	DF/SP Allowable Loads				Code Ref.			
					Uplift (160)	Down (100)	F ₁ (160)	F ₂ (160)				
ABA4Z	4x4	16	16	3/4	3 1/4	3 1/4	1/2	(8) 0.148 x 3	690	5,925	710	IBC, FL, LA
ABA4RZ	Rough 4x4	16	16	3/4	3 1/4	3 1/4	1/2	(8) 0.148 x 3	690	5,925	710	IBC, FL, LA
ABA4Z	4x4	16	12	3/4	3 1/4	3 1/4	1/2	(8) 0.148 x 3 1/2	1,900	2,300	7,570	IBC, FL, LA
ABA4RZ	Rough 4x4	16	12	3/4	3 1/4	3 1/4	1/2	(8) 0.148 x 3 1/2	1,900	2,300	7,570	IBC, FL, LA
ABA4RZ	Rough 4x4	16	16	4 1/4	3 1/4	2 1/4	1/2	(8) 0.148 x 3	655	7,215	710	IBC, FL, LA
ABA4RZ	Rough 4x4	16	16	4 1/4	3 1/4	2 1/4	1/2	(8) 0.148 x 3	655	7,215	710	IBC, FL, LA
ABA4RZ	Rough 4x4	16	12	4 1/4	3 1/4	3 1/4	1/2	(12) 0.162 x 3 1/2	1,900	2,300	7,570	IBC, FL, LA
ABA6RZ	4x6	14	14	3/4	5 1/4	3 1/4	1/2	(8) 0.162 x 3 1/2	870	10,500	4,500	IBC, FL, LA
ABA6RZ	4x6	12	12	3/4	5 1/4	3 1/4	1/2	(10) 0.148 x 3	845	4,500	4,500	IBC, FL, LA
ABA6RZ	4x6	12	12	3/4	5 1/4	3 1/4	1/2	(12) 0.162 x 3 1/2	2,465	2,265	12,520	IBC, FL, LA
ABA6RZ	Rough 4x6	14	14	4 1/4	5 1/4	2 1/4	1/2	(8) 0.162 x 3 1/2	870	10,695	4,500	IBC, FL, LA
ABA6RZ	Rough 4x6	12	12	4 1/4	5 1/4	2 1/4	1/2	(10) 0.148 x 3	780	4,500	4,500	IBC, FL, LA
ABA6RZ	Rough 4x6	12	12	4 1/4	5 1/4	2 1/4	1/2	(12) 0.162 x 3 1/2	2,465	2,265	12,520	IBC, FL, LA
ABU5-5Z	5 1/4 x 5 1/2	12	10	5/8	5	6 1/4	1 1/4	(12) 0.162 x 3 1/2	2,235	2,235	10,570	IBC, FL, LA
ABU5-6Z	5 1/4 x 6	12	10	5/8	5	6 1/4	1 1/4	(12) 0.162 x 3 1/2	2,235	2,235	10,570	IBC, FL, LA
ABU5Z	5 1/4 x 5 1/2	12	10	5/8	5	6 1/4	1 1/4	(12) 0.162 x 3 1/2	2,475	10,860	10,860	IBC, FL, LA
ABU6Z	6x6	14	14	5/8	5 1/4	3 1/4	1/2	(8) 0.162 x 3 1/2	850	10,245	10,245	IBC, FL, LA
ABU6Z	6x6	12	12	5/8	5 1/4	3 1/4	1/2	(12) 0.148 x 3	1,190	12,935	12,935	IBC, FL, LA
ABU6Z	6x6	12	10	5/								

Simpson Strong-Tie® Wood Construction Connectors
CS/CMST/CMSTC/CSHP




Coiled Straps (cont.)

- These products are available with additional corrosion protection. For more information, see p. 14.
- For stainless-steel fasteners, see p. 21.
- Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 348-352 for more information.

Model No.	Total L.	Ga.	DF/SP		SP/FF		Allowable Tension Loads (160)	Code Ref.
			Fasteners (in.)	End Length (in.)	Fasteners (in.)	End Length (in.)		
CMST12	40'	12	(74) 0.162 x 2 1/2	33	(84) 0.162 x 2 1/2	38	9,215	IBC, FL, LA
			(86) 0.148 x 2 1/2	39	(96) 0.148 x 2 1/2	44	9,215	
CMST14	52 1/2'	14	(56) 0.162 x 2 1/2	26	(66) 0.162 x 2 1/2	30	6,475	IBC, FL, LA
			(66) 0.148 x 2 1/2	30	(76) 0.148 x 2 1/2	34	6,475	
CMST16	54'	16	(50) 0.148 x 3/4	20	(58) 0.148 x 3/4	25	4,690	IBC, FL, LA
			(26) 0.148 x 2 1/2	15	(33) 0.148 x 2 1/2	16	2,490	
CS14	100'	14	(30) 0.131 x 2 1/2	16	(36) 0.131 x 2 1/2	19	2,490	IBC, FL, LA
			(23) 0.148 x 2 1/2	11	(22) 0.148 x 2 1/2	13	1,705	
CS16	150'	16	(20) 0.131 x 2 1/2	13	(26) 0.131 x 2 1/2	15	1,705	IBC, FL, LA
			(12) 0.148 x 2 1/2	7	(14) 0.148 x 2 1/2	9	1,030	
CS20	250'	20	(14) 0.131 x 2 1/2	9	(16) 0.131 x 2 1/2	9	1,030	IBC, FL, LA
			(4) 0.148 x 2 1/2	9	(6) 0.148 x 2 1/2	10	1,540	
CSHP18	75'	18	(16) 0.131 x 2 1/2	10	(18) 0.131 x 2 1/2	11	1,540	IBC, FL, LA
			(12) 0.148 x 2 1/2	8	(12) 0.148 x 2 1/2	8	1,160	
CSHP20	75'	20	(12) 0.131 x 2 1/2	8	(14) 0.131 x 2 1/2	9	1,160	IBC, FL, LA
			(10) 0.148 x 2 1/2	8	(10) 0.148 x 2 1/2	8	1,160	

- See pp. 266-267 for Straps and Ties General Notes.
- Calculate the connector value for a reduced number of nails as follows:
Allowable Load = No. of Nails Used x Table Load
No. of Nails in Table
Example: CMST12 in strap with 40 nails total. (Half of the nails in each member being connected)
Allowable Load = 40 Nails (Total) x 234 lb/ft = 9,360 lb
- See p. 274 for alternate nailing and lap splice information.
- Fasteners: Nail dimensions are listed diameter by length. See pp. 21-22 for fastener information.

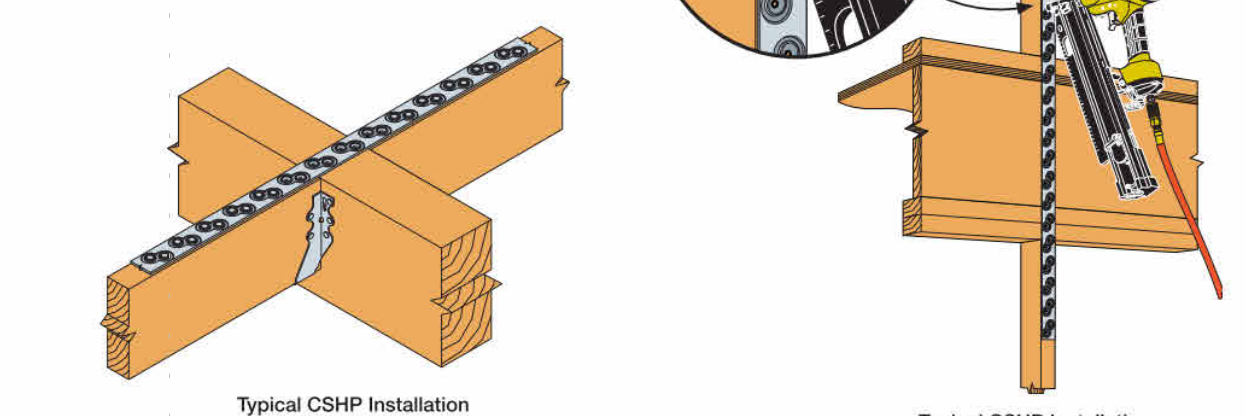

Simpson Strong-Tie® Wood Construction Connectors
CS/CMST/CMSTC/CSHP




Coiled Straps (cont.)

Lap splicing of coiled straps can be used to extend standard strap lengths for oblique continuous drag elements and diagonal chord members. The Strap Lap Splices table provides the minimum splice length (L_{sp}) and fasteners, within the splice length, to achieve the highest allowable capacity of the strap.

The Allowable Loads for Alternative Nailing table provides information for coiled straps when installed with different nailing schedules. The highest allowable load given for each model is limited by the steel capacity.

The Engineer/Designer of Record must evaluate and determine the adequacy of the coiled strap's lap splice and alternate nailing applications to meet their design loads.

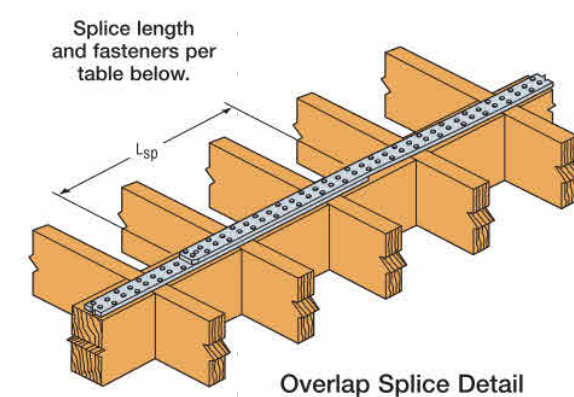

Model No.	Ga.	Strap Lap Splice	
		Minimum Fasteners per Splice	Min. Splice Length, L _{sp} (in.)
CMST12	12	(18) 0.162 x 2 1/2	15
		(12) 0.148 x 2 1/2	21
CMST14	14	(15) 0.148 x 2 1/2	15
		(11) 0.162 x 2 1/2	10
CMST16	16	(11) 0.148 x 2 1/2	10
		(7) 0.131 x 2 1/2	9
CS14	14	(11) 0.148 x 2 1/2	10
		(7) 0.131 x 2 1/2	9
CS16	16	(8) 0.148 x 2 1/2	8
		(6) 0.131 x 2 1/2	9
CS20	20	(8) 0.148 x 2 1/2	8
		(5) 0.131 x 2 1/2	9
CSHP18	18	(7) 0.148 x 2 1/2	9
		(7) 0.131 x 2 1/2	9
CSHP20	20	(8) 0.148 x 2 1/2	8
		(7) 0.131 x 2 1/2	9

- See pp. 266-267 for Straps and Ties General Notes.
- 0.148" x 2 1/2" nails can be replaced by 0.148" x 3 1/2" nails.
- No other nail substitution is allowed for lap splices.
- Refer to the applicable code for minimum edge distance and minimum end distance.
- No strap modification is allowed and the splice must meet both the minimum number of fasteners and the minimum splice length.

Simpson Strong-Tie® Wood Construction Connectors
MST/MSTA/MSTC



Strap Ties (cont.)

- These products are available with additional corrosion protection. For more information, see p. 14.
- Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 348-352 for more information.

Model No.	Clear Span (in.)	Allowable Tension Loads (DF/SP)		Allowable Tension Loads (SP/FF)	
		Fasteners (in.)	End Length (in.)	Fasteners (in.)	End Length (in.)
MST49	18	(26) 0.148 x 2 1/2	2,020	2,020	2,020
		(26) 0.148 x 2 1/2	2,020	2,020	2,020
MST28	18	(12) 0.148 x 3 1/2	1,350	995	995
		(16) 0.148 x 2 1/2	1,535	1,330	1,330
MST40	18	(26) 0.148 x 3 1/2	1,920	1,660	1,660
		(26) 0.148 x 3 1/2	2,690	2,325	2,325
MST32	18	(32) 0.148 x 3 1/2	3,070	2,655	2,655
		(36) 0.148 x 3 1/2	3,455	2,990	2,990
MST32S	18	(44) 0.148 x 3 1/2	4,225	3,650	3,650
		(48) 0.148 x 3 1/2	4,610	3,985	3,985
MST66	18	(48) 0.148 x 3 1/2	4,775	4,150	4,150
		(24) 0.148 x 3 1/2	5,375	4,645	4,645
MST78	24	(72) 0.148 x 3 1/2	5,850	5,850	5,850
		(72) 0.148 x 3 1/2	4,605	3,995	3,995
MST137	18	(20) 0.162 x 2 1/2	2,460	2,140	2,140
		(22) 0.162 x 2 1/2	2,705	2,355	2,355
MST148	18	(32) 0.162 x 2 1/2	3,210	2,780	2,780
		(32) 0.162 x 2 1/2	3,950	3,425	3,425
MST172	18	(34) 0.162 x 2 1/2	4,200	3,640	3,640
		(34) 0.162 x 2 1/2	4,805	3,995	3,995
MST160	24	(48) 0.162 x 2 1/2	5,240	4,700	4,700
		(48) 0.162 x 2 1/2	6,235	5,405	5,405
MST172	30	(48) 0.162 x 2 1/2	6,505	5,640	5,640
		(24) 0.162 x 2 1/2	6,730	6,345	6,345
MST172	24	(62) 0.162 x 2 1/2	6,730	6,475	6,475
		(62) 0.162 x 2 1/2	6,730	6,475	6,475


- See pp. 266-267 for Straps and Ties General Notes.
- Install slots or nails as specified by designer. Slot and nail values may not be combined.
- Allowable loads are based on parallel-to-grain loading and minimum member thickness: MSTC—2 1/2".
- Splitting may be a problem with installations on lumber smaller than 3 1/2", either fill every nail hole with 0.148" x 1 1/2" nails or fill every other hole with 0.162" x 2 1/2" nails. Reduce the allowable load based on the size and quantity of fasteners used.
- Fasteners: Nail dimensions are listed diameter by length. See pp. 21-22 for fastener information.

Simpson Strong-Tie® Wood Construction Connectors
HRS/ST/HTP/LSTA/LSTI/MST/MSTA/MSTC/MSTI



Strap Ties

Straps are designed to transfer tension loads in a wide variety of applications. HRS — Heavy strap designed for installation on the edge of 2x members. The HRS416Z installs with Strong-Drive® SDS Heavy-Duty Connector screws. HTP — Heavy tie plate designed for installation on the side of 2x4 or larger members. LSTA and MSTI — Light and medium straps that are suitable where pneumatic-nailing is necessary through diaphragm decking and wood chord on-web trusses. MST — High-capacity strap that can be installed with either nails or bolts. Suitable for double 2x member connections or greater. MSTC — High-capacity strap that utilizes a staggered nail pattern to help minimize wood splitting. Nail slots have been countersunk to provide a lower nail head profile.

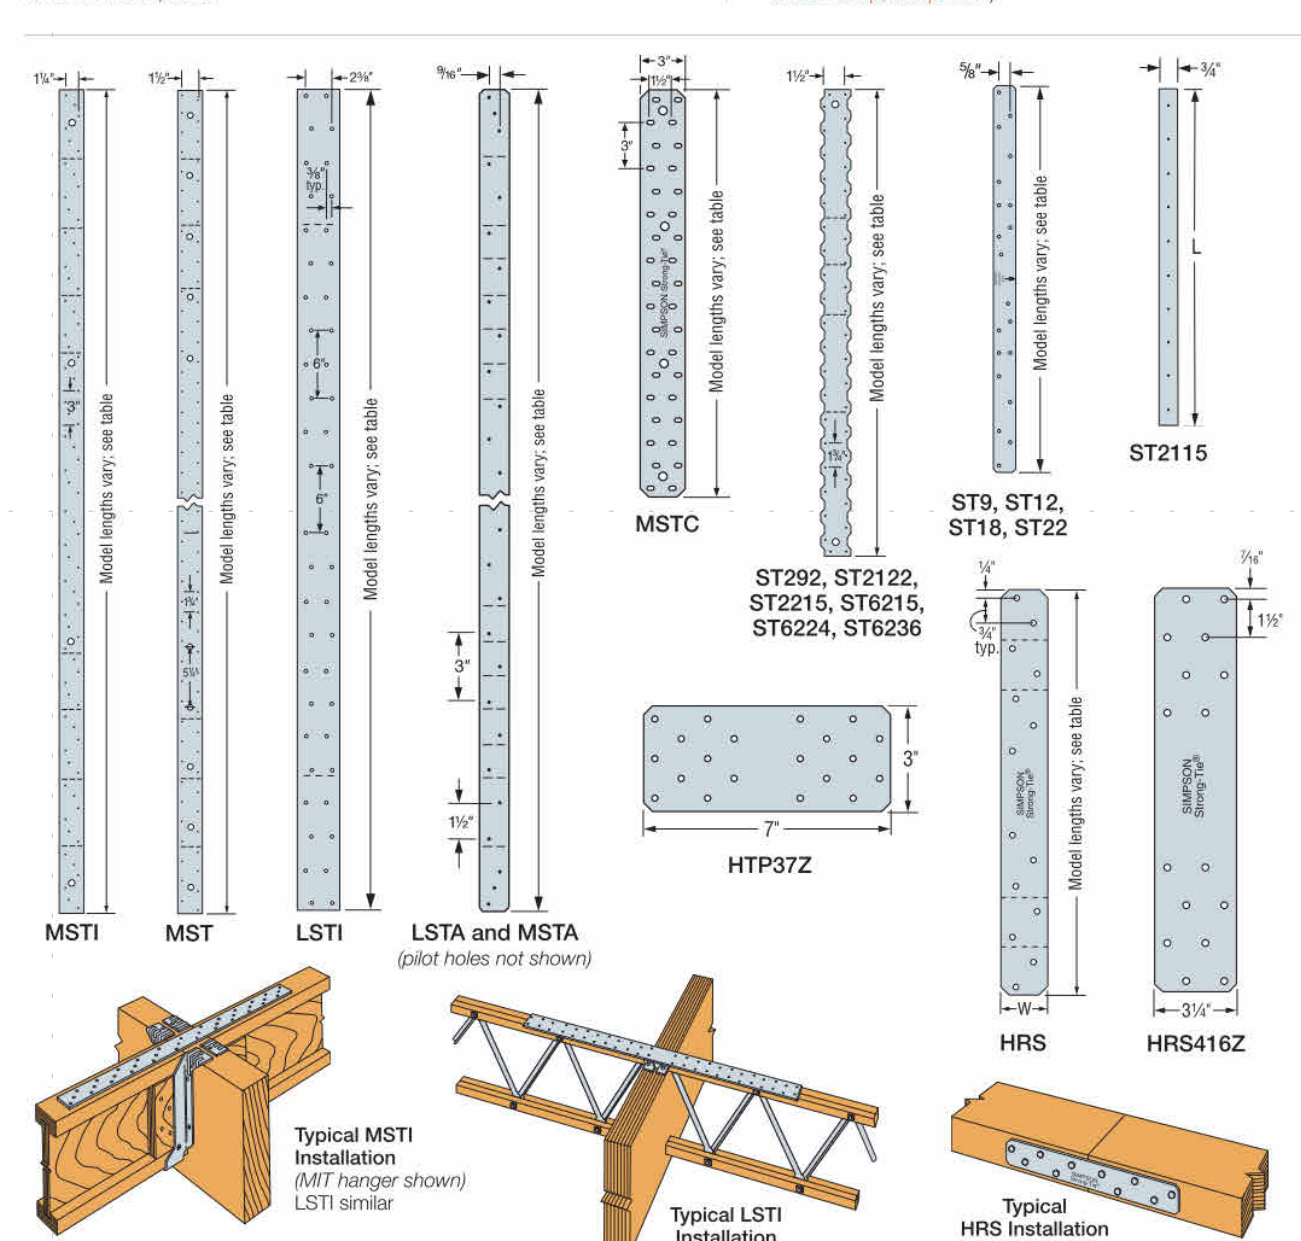

Simpson Strong-Tie® Wood Construction Connectors
Straps and Ties General Notes



- These general notes are provided to ensure proper installation of Simpson Strong-Tie straps and ties.
- The (160) loads have been increased for wind or earthquake loading, with no further increase allowed. Reduce where other loads govern.
 - When installing strap over wood structural panel sheathing, use 2 1/2" long nails minimum.
 - SD screws are Simpson Strong-Tie® Strong-Drive® SD Connector screws. See pp. 21-22 for additional fastener information.
 - For straight straps in tension, use half of the fasteners in each member being connected to achieve the listed loads.
 - Tension loads apply for uplift when installed vertically.
 - Field-bending straps is not recommended unless otherwise noted.
 - If wood splitting is a concern, consider spacing the nails at every other location.
 - The cut length of coil strap shall be equal to twice the "end length" noted in the tables plus the clear-span dimension.
 - Straps 16 ga. and heavier can be field welded to structural steel members. The designer shall specify the weld size and length. Welding and application shall be in compliance with the current American Welding Society AWS/AISC D1.3, Structural Welding Code — Steel Deck.

Load Adjustment Factors for Optional Fasteners Used with Straight Straps

Connector Table Nail	Replacement Fastener	Allowable Load Adjustment Factor
0.131" x 1 1/2"	#9 x 1 1/2" SD Connector screw	1.00
0.131" x 2 1/2"	0.131" x 1 1/2"	1.00
0.148" x 1 1/2"	#9 x 1 1/2" SD Connector screw	1.00
0.148" x 1 1/2"	0.131" x 1 1/2"	0.83
0.148" x 1 1/2"	0.131" x 2 1/2"	0.83
0.148" x 2 1/2"	0.148" x 1 1/2"	1.00*
0.148" x 2 1/2"	0.148" x 2 1/2"	1.00*
0.148" x 3 1/2"	0.148" x 3 1/2"	1.00
0.162" x 2 1/2"	#9 x 1 1/2" SD Connector screw	1.00
0.162" x 2 1/2"	#9 x 2 1/2" SD Connector screw	1.00
0.162" x 2 1/2"	0.148" x 1 1/2"	0.84*
0.162" x 2 1/2"	0.148" x 2 1/2"	0.84
0.162" x 2 1/2"	0.148" x 3"	0.84
0.162" x 2 1/2"	0.148" x 3 1/2"	0.84
0.162" x 2 1/2"	#10 x 1 1/2" SD Connector screw	1.00
0.162" x 2 1/2"	#10 x 2 1/2" SD Connector screw	1.00

* For more information on or to access, go to strongtie.com/webapps.

Simpson Strong-Tie® Wood Construction Connectors
CS/CMST/CMSTC/CSHP




Coiled Straps

Coiled straps are continuous utility straps which can be cut to length at the jobsite. The patent-pending CSHP high-performance coil strap features a raised embossment that makes it easy to install with a power framing nailer. This tested feature provides improved performance — resulting in fewer nails, shorter straps and overall lower installed cost. CMSTC provides countersunk nail slots for lower profile when installed with 0.148" x 3 1/2" sinkers.

Material: See table

Installation:

- Use all specified fasteners; see General Notes.
- Wood shrinkage after strap installation across horizontal wood members may cause strap to buckle outward.
- Refer to the applicable code for minimum nail penetration and minimum wood edge and end distances.
- The table shows the maximum allowable loads and the nails required to obtain them. Fewer nails may be used; reduce the allowable load as shown in the table notes or in the Straps and Ties General Notes on pp. 266-267.
- For lap splices and alternate nailing information, refer to p. 274.
- The cut length of the strap shall be equal to twice the "End Length" noted in the table plus the clear span dimension.
- CS/CSHP straps are available in 25' lengths (add -R to model no.).

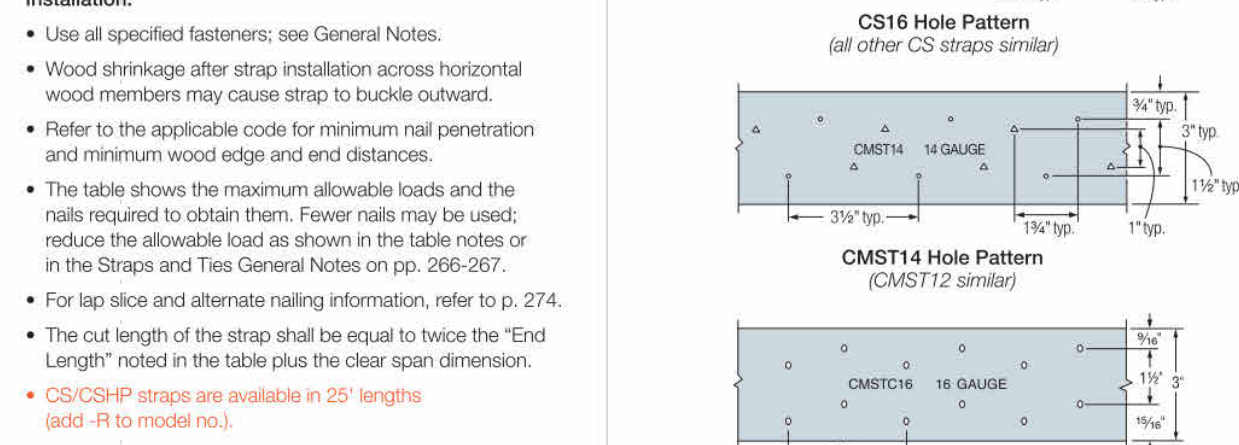

- CSHP:
- The colored dot must be installed facing out.
 - Designed to be installed with a power framing nailer using concentric, full round-head nails.
- CMST:
- Use every other round hole if the wood tends to split.
 - Use round and triangle holes for comparable MST loads, providing wood does not tend to split.
- Codes: See p. 11 for Code Reference Key Chart
- Typical Horizontal CS/CMST/CSHP Installation

Simpson Strong-Tie® Wood Construction Connectors
HRS/ST/HTP/LSTA/LSTI/MST/MSTA/MSTC/MSTI



Strap Ties (cont.)

- These products are available with additional corrosion protection. For more information, see p. 14.
- For stainless-steel fasteners, see p. 21.
- Many of these products are approved for installation with Strong-Drive® SD Connector screws. See pp. 348-352 for more information.

Model No.	Ga.	Dimensions (in.)		Fasteners (Total)	Allowable Tension Loads (DF/SP)	Allowable Tension Loads (SP/FF)	Code Ref.
		W	L				
ST2115	1/4	16 1/2	10 1/2	(16) 0.162 x 2 1/2	660	660	IBC, FL, LA
LSTA9	1 1/4	9	9	(8) 0.148 x 2 1/2	740	635	
LSTA12	1 1/4	12	12	(10) 0.148 x 2 1/2	925	795	IBC, FL, LA
LSTA15	1 1/4	15	15	(12) 0.148 x 2 1/2	1,110	965	
LSTA18	1 1/4	18	18	(14) 0.148 x 2 1/2	1,235	1,115	IBC, FL, LA
LSTA21	1 1/4	21	21	(16) 0.148 x 2 1/2	1,235	1,235	
LSTA24	1 1/4	24	24	(18) 0.148 x 2 1/2	1,235	1,235	IBC, FL, LA
LSTA30	1 1/4	30	30	(22) 0.148 x 2 1/2	1,640	1,640	
LSTA36	1 1/4	36	36	(26) 0.148 x 2 1/2	1,640	1,640	IBC, FL, LA
MST60	1 1/4	9	9	(8) 0.148 x 2 1/2	750	665	
MSTA12	1 1/4	12	12	(10) 0.148 x 2 1/2	940	810	IBC, FL, LA
MSTA15	1 1/4	15	15	(12) 0.148 x 2 1/2	1,130	970	
MSTA18	1 1/4	18	18	(14) 0.148 x 2 1/2	1,315	1,135	IBC, FL, LA
MSTA21	1 1/4	21	21	(16) 0.148 x 2 1/2	1,505	1,295	
MSTA24	1 1/4	24	24	(18) 0.148 x 2 1/2	1,640	1,460	IBC, FL, LA
MSTA30	1 1/4	30	30	(22) 0.148 x 2 1/2	2,050	1,825	
MSTA36	1 1/4	36	36	(26) 0.148 x 2 1/2	2,050	2,050	IBC, FL, LA
MSTA49	1 1/4	49	49	(26) 0.148 x 2 1/2	2,020	2,020	
ST9	1 1/4	9	9	(8) 0.162 x 2 1/2	885	765	IBC, FL, LA
ST12	1 1/4	12	12	(10) 0.162 x 2 1/2	1,105	955	
ST18	1 1/4	18	18	(14) 0.162 x 2 1/2	1,420	1,335	IBC, FL, LA
ST22	1 1/4	22	22	(18) 0.162 x 2 1/2	1,420	1,420	
HRS6	1 1/4	6	6	(8) 0.148 x 2 1/2	605	520	IBC, FL, LA
HRS8	1 1/4	8	8	(10) 0.148 x 2 1/2	815	690	
HRS12	1 1/4	12	12	(14) 0.148 x 2 1/2	1,145	1,230	IBC, FL, LA
ST292	2 1/2	9 1/2	9 1/2	(12) 0.162 x 2 1/2	1,260	1,120	
ST2122	2 1/2	12 1/2	12 1/2	(16) 0.162 x 2 1/2			