

STRUCTURAL CALCULATIONS - PERMIT REVISIONS


PROJECT:

Sam + June Mercer Island
3064 68th Avenue SE
Mercer Island, WA


PREPARED BY:

Julie Smith Lubke
julie@smithlubke.com

Smith Lubke Structural Design
P.O. Box 30954, Seattle, WA 98113
206.852.1536

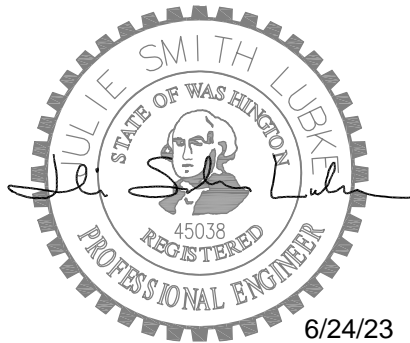

UPPER FLOOR FRAMING KEY
(EXPOSED LUMBER OVER GREAT
ROOM)

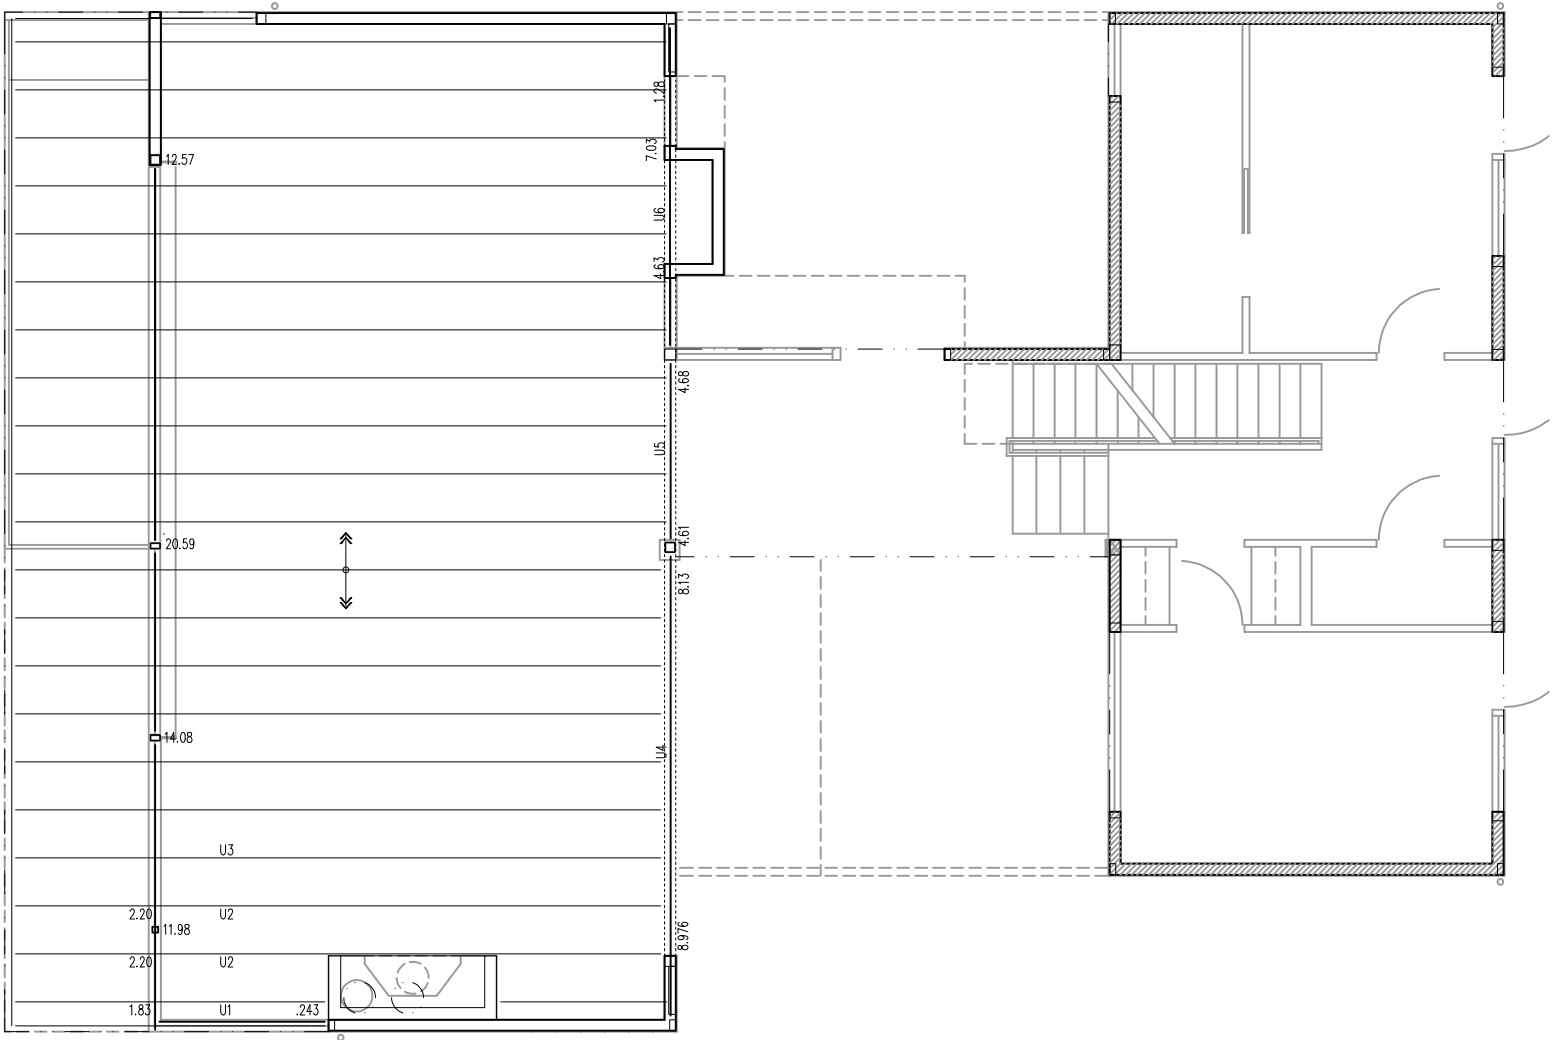

Roof			
Member Name	Results	Current Solution	Comments
R1	Passed	1 piece(s) 2 x 10 DF No.1 @ 24" OC	
R1_to eave	Failed	1 piece(s) 2 x 10 DF No.1 @ 24" OC	SHOWN AS 3x10 ON PLANS
R2	Passed	1 piece(s) 2 x 12 DF No.2 @ 24" OC	
R3	Passed	1 piece(s) 2 x 12 HF No.2 @ 16" OC	
15' header	Passed	1 piece(s) 7" x 9 1/4" 2.0E Parallam® PSL	
R4	Passed	2 piece(s) 2 x 6 HF No.2	
R5	Passed	1 piece(s) 3 1/2" x 11 1/4" 2.0E Parallam® PSL	
R5_pickup_south	Passed	1 piece(s) 3 1/2" x 9 1/4" 2.0E Parallam® PSL	
R5_pickup_north	Passed	1 piece(s) 5 1/4" x 9 1/4" 2.0E Parallam® PSL	
R6	Passed	2 piece(s) 2 x 8 HF No.2	
R7	Passed	2 piece(s) 2 x 4 HF No.2	
R8	Passed	2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL	
R9	Passed	2 piece(s) 2 x 4 HF No.2	
R10	Passed	2 piece(s) 2 x 4 HF No.2	
R11	Passed	2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL	
R12	Passed	2 piece(s) 2 x 4 HF No.2	
Upper Floor			
Member Name	Results	Current Solution	Comments
K1	Passed	1 piece(s) 14" TJI® 360 @ 16" OC	Cantilever Reinforcement (PB1) Required
K2	Passed	1 piece(s) 14" TJI® 360 @ 16" OC	Web Stiffeners Required
K3	Passed	2 piece(s) 2 x 8 HF No.2	
K4	Passed	2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL	
K5	Passed	2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL	
K6	Passed	1 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K7	Failed	2 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	An excessive uplift of -1154 lbs at support located at 1 1/4" failed this product.
K8	Passed	1 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K9	Passed	1 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K10	Passed	2 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K11	Passed	2 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K12	Passed	1 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K13	Passed	2 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
K14	Passed	2 piece(s) 1 3/4" x 16" 2.0E Microllam® LVL	
U1	Passed	1 piece(s) 4 x 16 DF No.1 @ 24" OC	
U2	Passed	1 piece(s) 4 x 16 DF No.1 @ 24" OC	SHOWN AS 4x18 ON PLANS
U3	Passed	1 piece(s) 4 x 16 DF No.1 @ 24" OC	
U3 - hot tub	Passed	1 piece(s) 4 x 16 DF No.1 @ 24" OC	
U3 - south wall	Failed	1 piece(s) 4 x 16 DF No.1 @ 24" OC	
U3 - north point load	Passed	1 piece(s) 4 x 16 DF No.1 @ 24" OC	
U4 - no steel	Passed	1 piece(s) 5 1/4" x 18" 2.0E Parallam® PSL	
U5	Passed	2 piece(s) 1 3/4" x 18" 2.0E Microllam® LVL	
U6	Passed	1 piece(s) 3 1/2" x 9 1/4" 2.0E Parallam® PSL	

ForteWEB Software Operator Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	Job Notes
--	-----------




Main Floor			
Member Name	Results	Current Solution	Comments
M1	Passed	1 piece(s) 14" TJI® 560 @ 16" OC	
M1a	Passed	1 piece(s) 16" TJI® 560 @ 16" OC	
M2	Passed	1 piece(s) 2 x 8 HF No.2 @ 16" OC	
M3	Passed	1 piece(s) 14" TJI® 560 @ 12" OC	
M4	Passed	1 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
M6	Passed	2 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
M7	Passed	1 piece(s) W10X30 (A992) ASTM Steel	
M8	Passed	2 piece(s) 2 x 10 HF No.1	
M9	Passed	2 piece(s) 1 3/4" x 14" 2.0E Microllam® LVL	
LOADING AT NORTH END	Passed	2 piece(s) 2 x 4 DF No.1	
m10	Passed	1 piece(s) 11 7/8" TJI® 110 @ 16" OC	
M11	Passed	1 piece(s) 11 7/8" TJI® 110 @ 16" OC	Cantilever Reinforcement (PB1) Required

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R1
1 piece(s) 2 x 10 DF No.1 @ 24" OC

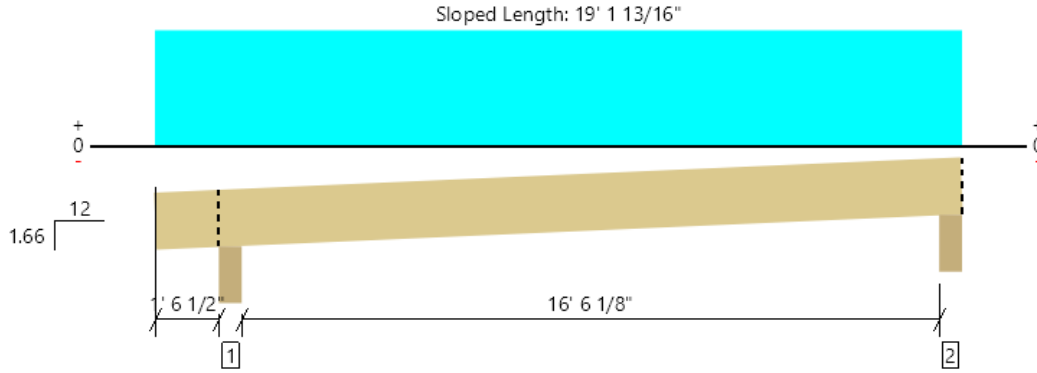

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Member Length : 19' 3 1/16"

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	763 @ 1' 9 1/4"	3540 (5.50")	Passed (22%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	558 @ 2' 9 3/16"	1915	Passed (29%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	2587 @ 10' 2 15/16"	2593	Passed (100%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.539 @ 10' 2 3/8"	0.849	Passed (L/378)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.796 @ 10' 2 7/16"	1.132	Passed (L/256)	--	1.0 D + 1.0 S (All Spans)

System : Roof
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 1.66/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Overhang deflection criteria: LL (2L/240) and TL (2L/180).
- Upward deflection on left cantilever exceeds overhang deflection criteria.
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Beveled Plate - SPF	5.50"	5.50"	1.50"	249	514	763	Blocking
2 - Beveled Plate - SPF	5.50"	5.50"	1.50"	211	437	648	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	6" o/c	
Bottom Edge (Lu)	19' 2" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 18' 11 5/8"	24"	12.0	25.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R1_to eave
1 piece(s) 2 x 10 DF No.1 @ 24" OC

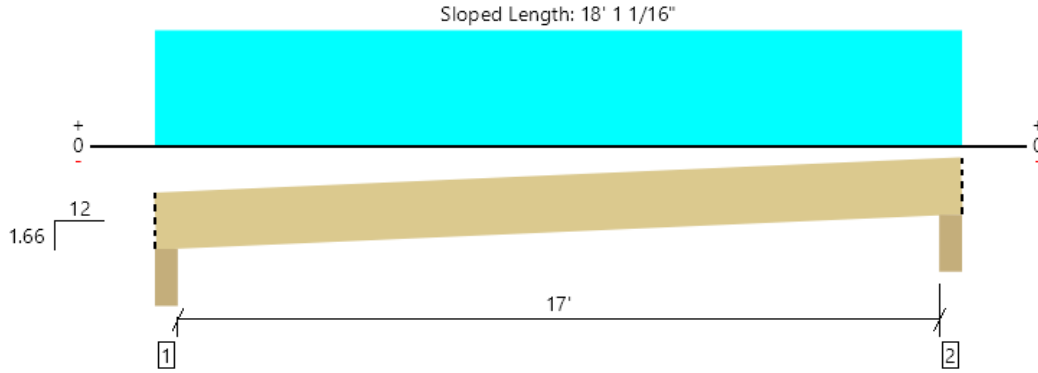

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Member Length : 18' 2 5/16"

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	665 @ 4 1/2"	3506 (5.50")	Passed (19%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	574 @ 1' 2 11/16"	1915	Passed (30%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	2734 @ 8' 11 1/2"	2593	Failed (105%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.592 @ 8' 11 1/2"	0.867	Passed (L/351)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.879 @ 8' 11 1/2"	1.155	Passed (L/237)	--	1.0 D + 1.0 S (All Spans)

System : Roof
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 1.66/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Beveled Plate - SPF	5.50"	5.50"	1.50"	217	448	665	Blocking
2 - Beveled Plate - SPF	5.50"	5.50"	1.50"	217	448	665	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	6" o/c	
Bottom Edge (Lu)	18' 1" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 17' 11"	24"	12.0	25.0	Default Load

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R2

1 piece(s) 2 x 12 DF No.2 @ 24" OC

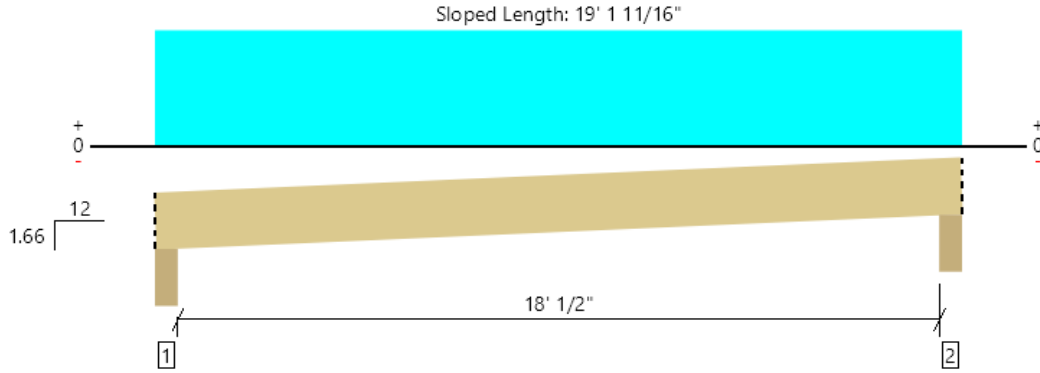

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Member Length : 19' 3 1/4"

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	704 @ 4 1/2"	3506 (5.50")	Passed (20%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	601 @ 1' 4 5/8"	2329	Passed (26%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	3076 @ 9' 5 3/4"	3138	Passed (98%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.443 @ 9' 5 3/4"	0.919	Passed (L/498)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.657 @ 9' 5 3/4"	1.225	Passed (L/336)	--	1.0 D + 1.0 S (All Spans)

System : Roof
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD
 Member Pitch : 1.66/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Beveled Plate - SPF	5.50"	5.50"	1.50"	230	474	704	Blocking
2 - Beveled Plate - SPF	5.50"	5.50"	1.50"	230	474	704	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	1' 5" o/c	
Bottom Edge (Lu)	19' 2" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 18' 11 1/2"	24"	12.0	25.0	Default Load


Weyerhaeuser Notes
 Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.
 The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R3

1 piece(s) 2 x 12 HF No.2 @ 16" OC

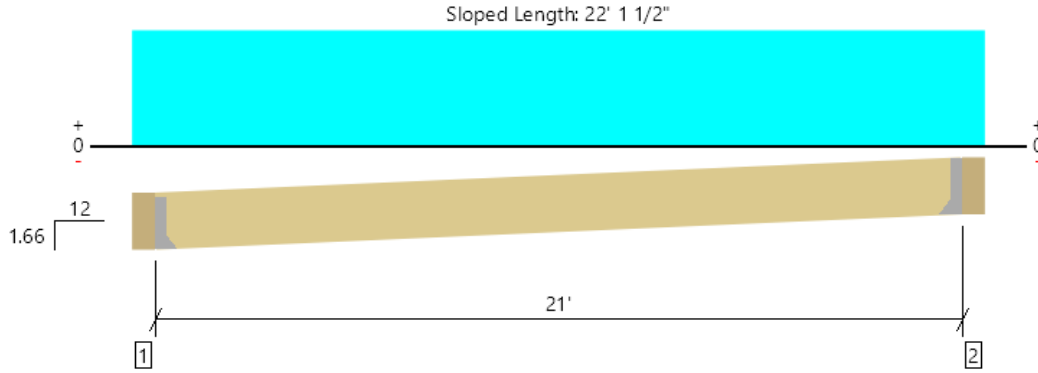

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Member Length : 21' 3 15/16"

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	520 @ 5 1/2"	911 (1.50")	Passed (57%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	474 @ 1' 4 5/8"	1941	Passed (24%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	2728 @ 10' 11 1/2"	2964	Passed (92%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.642 @ 10' 11 1/2"	1.060	Passed (L/396)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.954 @ 10' 11 1/2"	1.413	Passed (L/267)	--	1.0 D + 1.0 S (All Spans)

System : Roof
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD
 Member Pitch : 1.66/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Hanger on 11 1/4" SPF beam	5.50"	Hanger ¹	1.50"	177	365	542	See note ¹
2 - Hanger on 11 1/4" SPF beam	5.50"	Hanger ¹	1.50"	177	365	542	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	2' 10" o/c	
Bottom Edge (Lu)	21' 2" o/c	

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie							
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories	
1 - Face Mount Hanger	LRU28Z	1.94"	N/A	6-10dx1.5	5-10d		
2 - Face Mount Hanger	LRU28Z	1.94"	N/A	6-10dx1.5	5-10d		

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 21' 11"	16"	12.0	25.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, 15' header
1 piece(s) 7" x 9 1/4" 2.OE Parallam® PSL

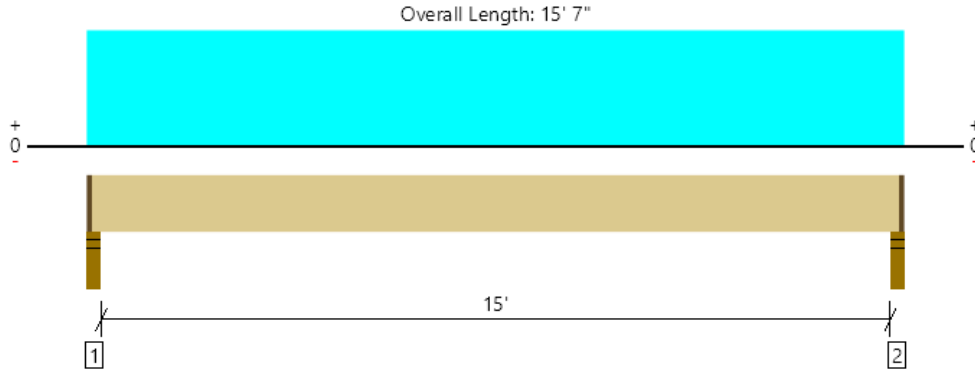

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3089 @ 2"	6694 (2.25")	Passed (46%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	2704 @ 1' 3/4"	14396	Passed (19%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	11680 @ 7' 9 1/2"	28556	Passed (41%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.352 @ 7' 9 1/2"	0.762	Passed (L/520)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.550 @ 7' 9 1/2"	1.017	Passed (L/333)	--	1.0 D + 1.0 S (All Spans)

System : Roof
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 0/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Member should be side-loaded from both sides of the member or braced to prevent rotation.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.50"	1126	2002	3128	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.50"	1126	2002	3128	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	15' 5" o/c	
Bottom Edge (Lu)	15' 5" o/c	

•Maximum allowable bracing intervals based on applied load.


Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	1 1/4" to 15' 5 3/4"	N/A	20.3	--	
1 - Uniform (PLF)	0 to 15' 7" (Front)	N/A	124.5	257.0	Linked from: Roof: Joist, Support 1

Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R4
2 piece(s) 2 x 6 HF No.2

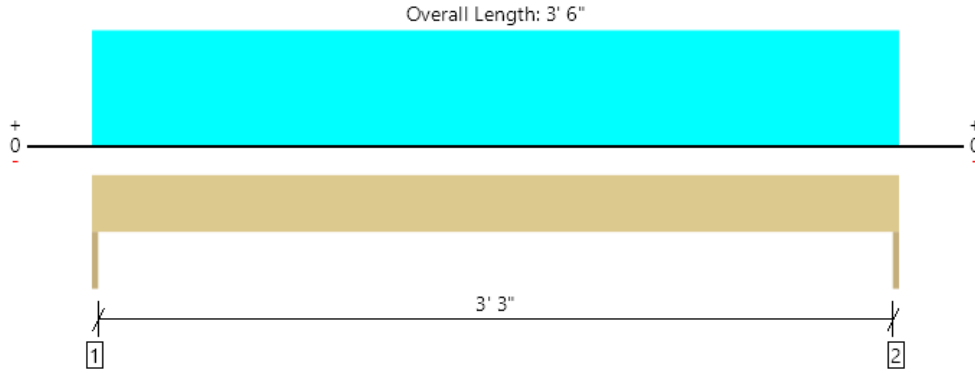

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	675 @ 0	1823 (1.50")	Passed (37%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	450 @ 7"	1898	Passed (24%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	591 @ 1' 9"	1602	Passed (37%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.016 @ 1' 9"	0.117	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.024 @ 1' 9"	0.175	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	1.50"	1.50"	1.50"	225	450	675	None
2 - Trimmer - SPF	1.50"	1.50"	1.50"	225	450	675	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 6" o/c	
Bottom Edge (Lu)	3' 6" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 3' 6"	N/A	4.2	--	
1 - Uniform (PLF)	0 to 3' 6"	N/A	124.5	257.0	Linked from: R1, Support 1

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R5

1 piece(s) 3 1/2" x 11 1/4" 2.0E Parallam® PSL

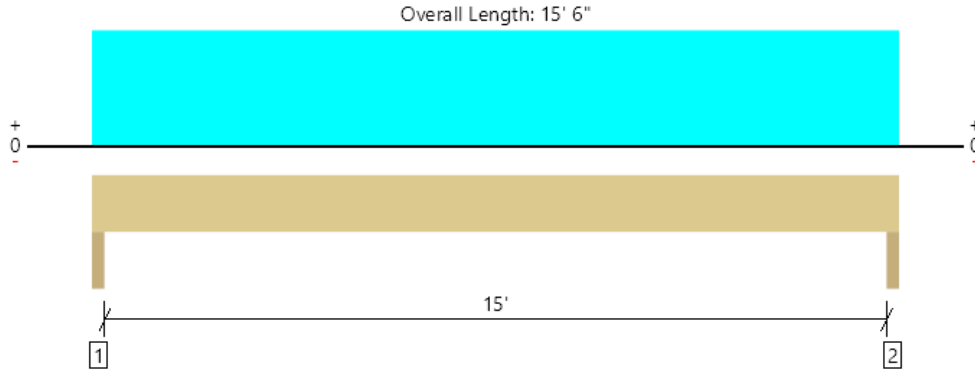

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2672 @ 1 1/2"	6563 (3.00")	Passed (41%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	2263 @ 1' 2 1/4"	8754	Passed (26%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	10023 @ 7' 9"	20666	Passed (49%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.347 @ 7' 9"	0.508	Passed (L/527)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.534 @ 7' 9"	0.762	Passed (L/342)	--	1.0 D + 1.0 S (All Spans)

System : Wall
 Member Type : Header
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	936	1736	2672	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	936	1736	2672	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	15' 6" o/c	
Bottom Edge (Lu)	15' 6" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 15' 6"	N/A	12.3	--	
1 - Uniform (PLF)	0 to 15' 6"	N/A	108.5	224.0	Linked from: R1_to eave, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R5_pickup_south
1 piece(s) 3 1/2" x 9 1/4" 2.0E Parallam® PSL

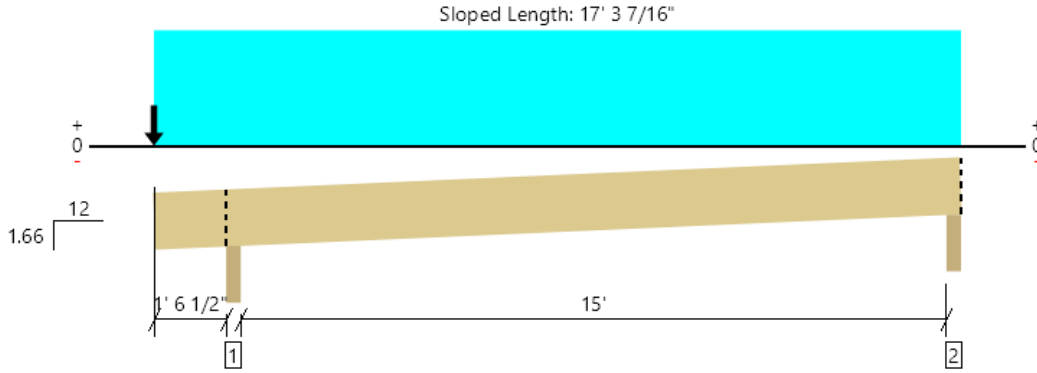

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Member Length : 17' 4 3/4"

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3413 @ 1' 8 1/4"	5256 (3.50")	Passed (65%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	2709 @ 9 5/16"	7198	Passed (38%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	-4576 @ 1' 8 1/4"	14278	Passed (32%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.106 @ 0	0.200	Passed (2L/384)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.149 @ 0	0.227	Passed (2L/274)	--	1.0 D + 1.0 S (Alt Spans)

System : Roof
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 1.66/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Overhang deflection criteria: LL (0.2") and TL (2L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Beveled Plate - SPF	3.50"	3.50"	2.27"	1249	2163	3413	Blocking
2 - Beveled Plate - SPF	3.50"	3.50"	1.50"	69	98/-97	167/-28	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	17' 3" o/c	
Bottom Edge (Lu)	17' 3" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 17' 1 1/2"	N/A	10.1	--	
1 - Uniform (PSF)	0 to 17' 1 1/2"	1'	12.0	25.0	Default Load
2 - Point (lb)	0	N/A	936	1736	Linked from: R5, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R5_pickup_north
1 piece(s) 5 1/4" x 9 1/4" 2.0E Parallam® PSL

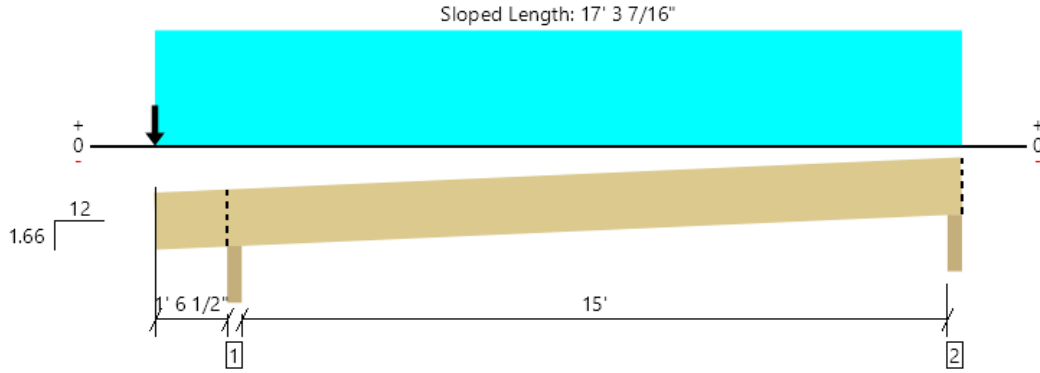

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Member Length : 17' 4 3/4"

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	4858 @ 1' 8 1/4"	7884 (3.50")	Passed (62%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	3971 @ 9 5/16"	10797	Passed (37%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	-6707 @ 1' 8 1/4"	21417	Passed (31%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.109 @ 0	0.200	Passed (2L/376)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.153 @ 0	0.227	Passed (2L/268)	--	1.0 D + 1.0 S (Alt Spans)

System : Roof
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD
Member Pitch : 1.66/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Overhang deflection criteria: LL (0.2") and TL (2L/180).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Beveled Plate - SPF	3.50"	3.50"	2.16"	1768	3091	4858	Blocking
2 - Beveled Plate - SPF	3.50"	3.50"	1.50"	61	52/-189	113/-128	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	17' 3" o/c	
Bottom Edge (Lu)	17' 3" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 17' 1 1/2"	N/A	15.2	--	
1 - Uniform (PSF)	0 to 17' 1 1/2"	1'	12.0	25.0	Default Load
2 - Point (lb)	0	N/A	423	835	Linked from: R6, Support 1
3 - Point (lb)	0	N/A	936	1736	Linked from: R5, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R6
2 piece(s) 2 x 8 HF No.2

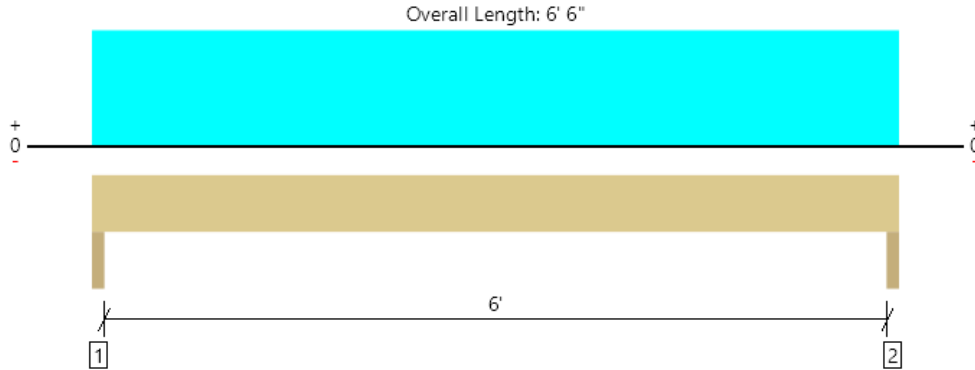

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1258 @ 1 1/2"	3645 (3.00")	Passed (35%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	927 @ 10 1/4"	2501	Passed (37%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	1890 @ 3' 3"	2569	Passed (74%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.071 @ 3' 3"	0.208	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.107 @ 3' 3"	0.313	Passed (L/699)	--	1.0 D + 1.0 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	423	835	1258	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	423	835	1258	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	6' 6" o/c	
Bottom Edge (Lu)	6' 6" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 6' 6"	N/A	5.5	--	
1 - Uniform (PLF)	0 to 6' 6"	N/A	124.5	257.0	Linked from: R1, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R7
2 piece(s) 2 x 4 HF No.2

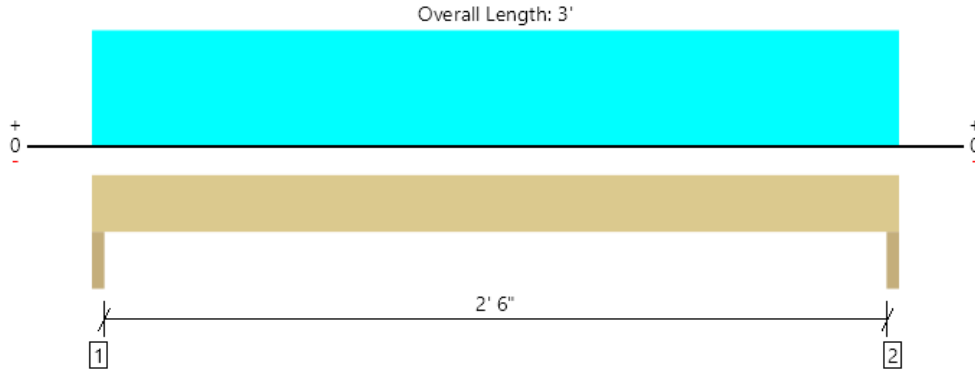

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	490 @ 1' 1/2"	3645 (3.00")	Passed (13%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	313 @ 6 1/2"	1208	Passed (26%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	309 @ 1' 6"	748	Passed (41%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.020 @ 1' 6"	0.092	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.030 @ 1' 6"	0.138	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	162	328	490	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	162	328	490	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' o/c	
Bottom Edge (Lu)	3' o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 3'	N/A	2.7	--	
1 - Uniform (PLF)	0 to 3'	N/A	105.5	218.5	Linked from: R1, Support 2

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woody.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R8

2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL

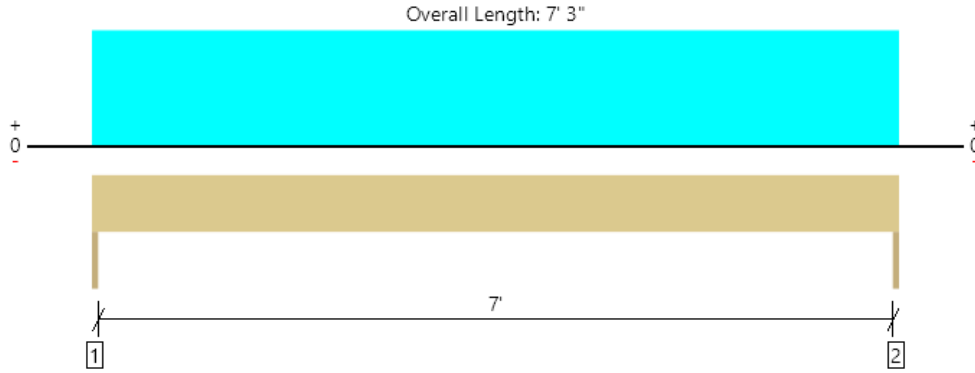

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2492 @ 0	3806 (1.50")	Passed (65%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	1762 @ 1' 3/4"	8603	Passed (20%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	4517 @ 3' 7 1/2"	18558	Passed (24%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.043 @ 3' 7 1/2"	0.242	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.065 @ 3' 7 1/2"	0.363	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

System : Wall
 Member Type : Header
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	1.50"	1.50"	1.50"	841	1651	2492	None
2 - Trimmer - SPF	1.50"	1.50"	1.50"	841	1651	2492	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	7' 3" o/c	
Bottom Edge (Lu)	7' 3" o/c	

•Maximum allowable bracing intervals based on applied load.


Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 7' 3"	N/A	11.5	--	
1 - Uniform (PLF)	0 to 7' 3"	N/A	105.5	218.5	Linked from: R1, Support 2
2 - Uniform (PLF)	0 to 7' 3"	N/A	115.0	237.0	Linked from: R2, Support 1

Weyerhaeuser Notes
 Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
 The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R9
2 piece(s) 2 x 4 HF No.2

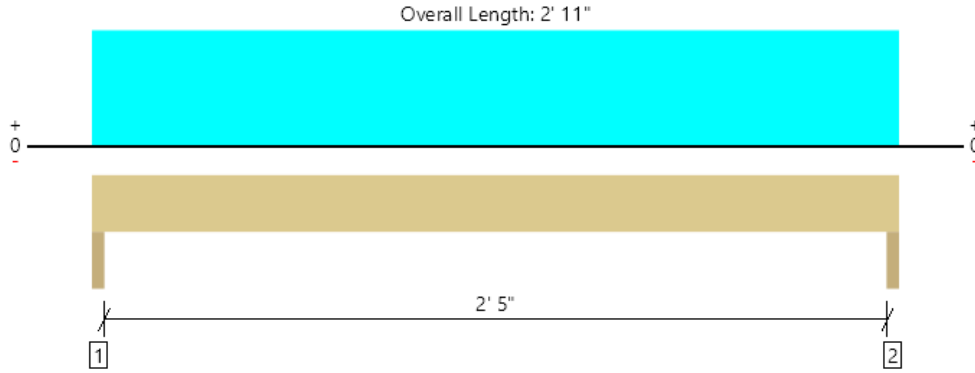

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	476 @ 1' 1/2"	3645 (3.00")	Passed (13%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	299 @ 6 1/2"	1208	Passed (25%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	290 @ 1' 5 1/2"	748	Passed (39%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.018 @ 1' 5 1/2"	0.089	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.027 @ 1' 5 1/2"	0.133	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	158	319	476	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	158	319	476	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	2' 11" o/c	
Bottom Edge (Lu)	2' 11" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 2' 11"	N/A	2.7	--	
1 - Uniform (PLF)	0 to 2' 11"	N/A	105.5	218.5	Linked from: R1, Support 2

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R10
2 piece(s) 2 x 4 HF No.2

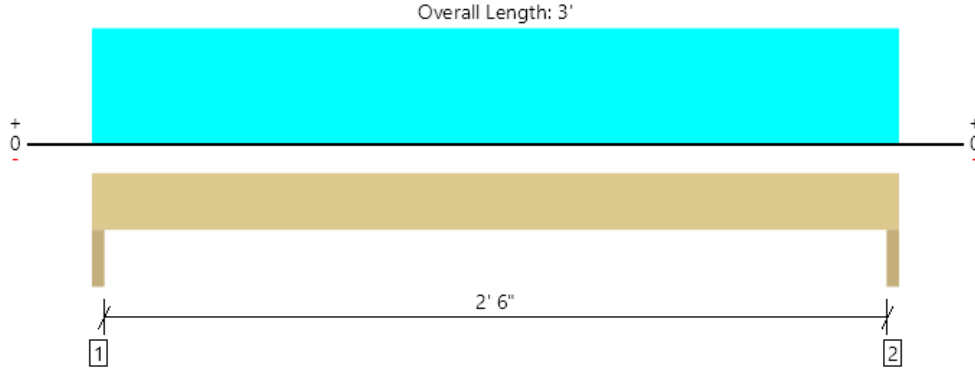

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	614 @ 1' 1/2"	3645 (3.00")	Passed (17%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	392 @ 6 1/2"	1208	Passed (32%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	387 @ 1' 6"	748	Passed (52%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.025 @ 1' 6"	0.092	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.038 @ 1' 6"	0.138	Passed (L/873)	--	1.0 D + 1.0 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	203	411	614	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	203	411	614	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' o/c	
Bottom Edge (Lu)	3' o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 3'	N/A	2.7	--	
1 - Uniform (PLF)	0 to 3'	N/A	132.8	273.8	Linked from: R3, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R11
2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL

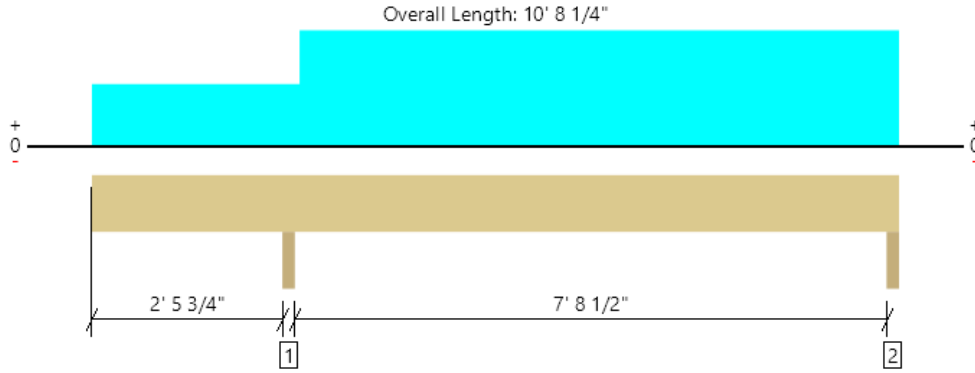

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	4280 @ 2' 7 1/4"	7613 (3.00")	Passed (56%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	2424 @ 3' 8"	8603	Passed (28%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	5627 @ 6' 8 7/8"	18558	Passed (30%)	1.15	1.0 D + 1.0 S (Alt Spans)
Live Load Defl. (in)	0.063 @ 6' 7 7/16"	0.265	Passed (L/999+)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.094 @ 6' 7 5/8"	0.398	Passed (L/999+)	--	1.0 D + 1.0 S (Alt Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.69"	1452	2828	4280	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	1002	2038	3040	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	10' 8" o/c	
Bottom Edge (Lu)	10' 8" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 10' 8 1/4"	N/A	11.5	--	
1 - Uniform (PLF)	2' 9" to 10' 8 1/4"	N/A	115.0	237.0	Linked from: R2, Support 2
2 - Uniform (PLF)	0 to 10' 8 1/4"	N/A	132.8	273.8	Linked from: R3, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Roof, R12
2 piece(s) 2 x 4 HF No.2

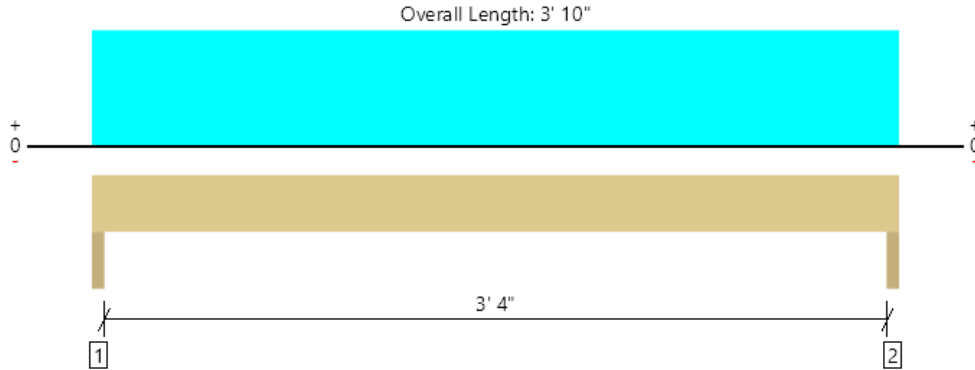

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	784 @ 1' 1/2"	3645 (3.00")	Passed (22%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	563 @ 6 1/2"	1208	Passed (47%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	657 @ 1' 11"	748	Passed (88%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.073 @ 1' 11"	0.119	Passed (L/590)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.109 @ 1' 11"	0.179	Passed (L/395)	--	1.0 D + 1.0 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	260	525	784	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	260	525	784	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 10" o/c	
Bottom Edge (Lu)	3' 10" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 3' 10"	N/A	2.7	--	
1 - Uniform (PLF)	0 to 3' 10"	N/A	132.8	273.8	Linked from: R3, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K1
1 piece(s) 14" TJI® 360 @ 16" OC

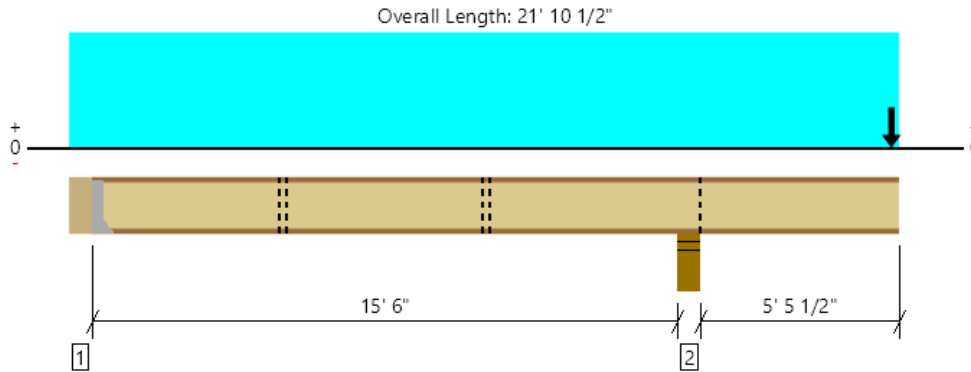

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1915 @ 16' 2 1/4"	3000 (5.25")	Passed (64%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	938 @ 15' 11 1/2"	1955	Passed (48%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	-4645 @ 16' 2 1/4"	6326	Passed (73%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Live Load Defl. (in)	0.237 @ 21' 10 1/2"	0.284	Passed (2L/576)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Total Load Defl. (in)	0.404 @ 21' 10 1/2"	0.569	Passed (2L/338)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
TJ-Pro™ Rating	53	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Moment capacity over cantilever support 2 has been reduced by 25% to lessen the effects of buckling.
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.
- Permanent bracing at third points in the back span or a direct applied ceiling over the entire back span length is required at the right span of the member. See literature detail (PB1) For clarification.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Hanger on 14" SPF beam	5.50"	Hanger ¹	1.75" / - ²	252	444/-30	-127	696	See note ¹
2 - Stud wall - SPF	5.50"	5.50"	3.50"	1138	778	492	2090	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.
- ² Required Bearing Length / Required Bearing Length with Web Stiffeners

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	7' 4" o/c	
Bottom Edge (Lu)	4' 9" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie						
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Face Mount Hanger	IUS2.37/14	2.00"	N/A	12-10dx1.5	2-Strong-Grip	

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Loads	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 21' 10 1/2"	16"	37.0	40.0	-	Default Load
2 - Point (PLF)	21' 8"	16"	100.0	-	-	
3 - Point (PLF)	21' 8"	16"	132.8	-	273.8	Linked from: R3, Support 2

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

25 of 144
File Name: Sam + June_revised 03_2023

Page 20 / 60

Upper Floor, K2
1 piece(s) 14" TJI® 360 @ 16" OC

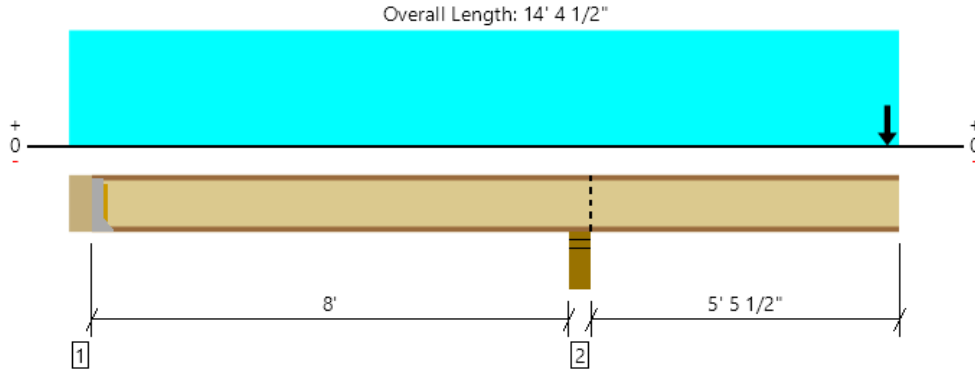

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2024 @ 8' 8 1/4"	3450 (5.25")	Passed (59%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Shear (lbs)	1072 @ 8' 11"	2248	Passed (48%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Moment (Ft-lbs)	-4645 @ 8' 8 1/4"	8435	Passed (55%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Live Load Defl. (in)	0.164 @ 14' 4 1/2"	0.284	Passed (2L/832)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.339 @ 14' 4 1/2"	0.569	Passed (2L/404)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
TJ-Pro™ Rating	66	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Right cantilever length exceeds 1/3 member length or 1/2 back span length. Additional bracing should be considered.
- Allowed moment does not reflect the adjustment for the beam stability factor.
- -321 lbs uplift at support located at 5 1/2". Strapping or other restraint may be required.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Hanger on 14" SPF beam	5.50"	Hanger ¹	1.75" / - ²	-78	244/-80	-243	166/-321	See note ¹
2 - Stud wall - SPF	5.50"	5.50"	3.50"	1097	628	608	2024	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.
- ² Required Bearing Length / Required Bearing Length with Web Stiffeners

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	9' 7" o/c	
Bottom Edge (Lu)	4' 9" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie						
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Face Mount Hanger	U3516/20	2.00"	N/A	16-10dx1.5	6-10dx1.5	Web Stiffeners

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Loads	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 14' 4 1/2"	16"	37.0	40.0	-	Default Load
2 - Point (PLF)	14' 2"	16"	100.0	-	-	
3 - Point (PLF)	14' 2"	16"	132.8	-	273.8	Linked from: R3, Support 2

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

27 of 144
File Name: Sam + June_revised 03_2023

Page 22 / 60

Upper Floor, K3
2 piece(s) 2 x 8 HF No.2

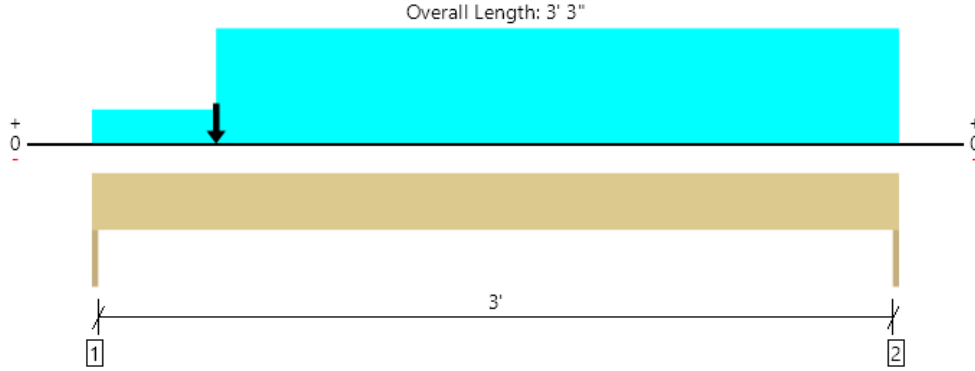

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	1715 @ 0	1823 (1.50")	Passed (94%)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Shear (lbs)	1045 @ 8 3/4"	2501	Passed (42%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Moment (Ft-lbs)	1061 @ 1' 6 15/16"	2234	Passed (48%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Live Load Defl. (in)	0.009 @ 1' 6 7/8"	0.108	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Total Load Defl. (in)	0.019 @ 1' 6 7/8"	0.162	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Trimmer - SPF	1.50"	1.50"	1.50"	853	541/-37	608	1715	None
2 - Trimmer - SPF	1.50"	1.50"	1.50"	729	541/-37	360	1405	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 3" o/c	
Bottom Edge (Lu)	3' 3" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 3' 3"	N/A	5.5	--	--	
1 - Uniform (PLF)	0 to 3' 3"	N/A	100.0	-	-	
2 - Uniform (PLF)	6" to 3' 3"	N/A	132.8	-	273.8	Linked from: R3, Support 1
3 - Point (lb)	6"	N/A	260	-	525	Linked from: R12, Support 2
4 - Uniform (PLF)	0 to 3' 3"	N/A	189.0	333.0/-22.5	-95.3	Linked from: K1, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K4
2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL

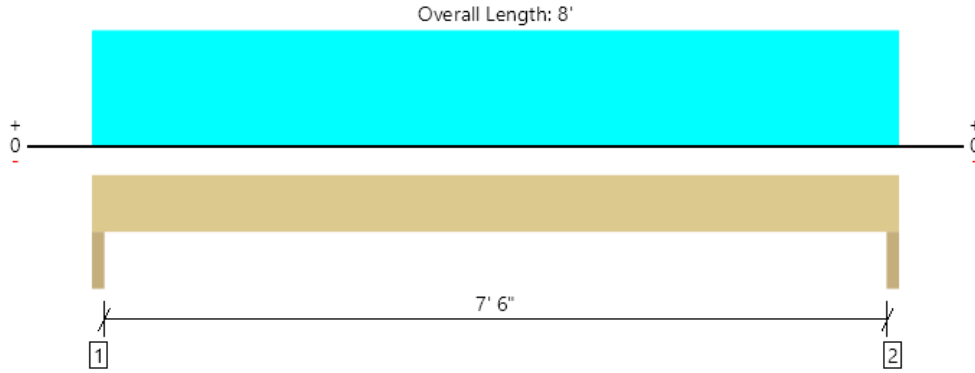

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	6317 @ 1' 1/2"	7613 (3.00")	Passed (83%)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Shear (lbs)	4074 @ 1' 2 1/4"	7481	Passed (54%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	10875 @ 4'	16137	Passed (67%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.086 @ 4'	0.258	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Total Load Defl. (in)	0.189 @ 4'	0.387	Passed (L/492)	--	1.0 D + 0.75 L + 0.75 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	2.49"	3460	2334	1476	6317	None
2 - Trimmer - SPF	3.00"	3.00"	2.49"	3460	2334	1476	6317	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	8' o/c	
Bottom Edge (Lu)	8' o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 8'	N/A	11.5	--	--	
1 - Uniform (PLF)	0 to 8'	N/A	853.5	583.5	369.0	Linked from: K1, Support 2

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K5
2 piece(s) 1 3/4" x 11 1/4" 2.0E Microllam® LVL

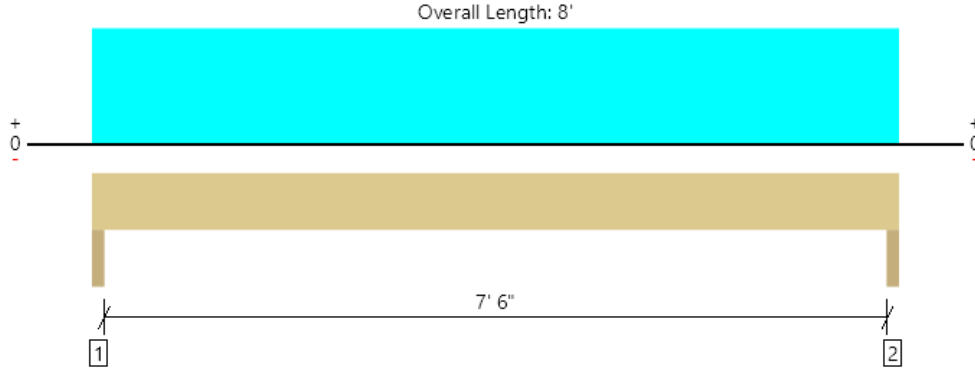

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	6118 @ 1' 1/2"	7613 (3.00")	Passed (80%)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Shear (lbs)	4302 @ 1' 2 1/4"	8603	Passed (50%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Moment (Ft-lbs)	11483 @ 4'	18558	Passed (62%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Live Load Defl. (in)	0.083 @ 4'	0.258	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Total Load Defl. (in)	0.183 @ 4'	0.387	Passed (L/508)	--	1.0 D + 0.75 L + 0.75 S (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	2.41"	3337	1884	1824	6118	None
2 - Trimmer - SPF	3.00"	3.00"	2.41"	3337	1884	1824	6118	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	8' o/c	
Bottom Edge (Lu)	8' o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 8'	N/A	11.5	--	--	
1 - Uniform (PLF)	0 to 8'	N/A	822.8	471.0	456.0	Linked from: K2, Support 2

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K6
1 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

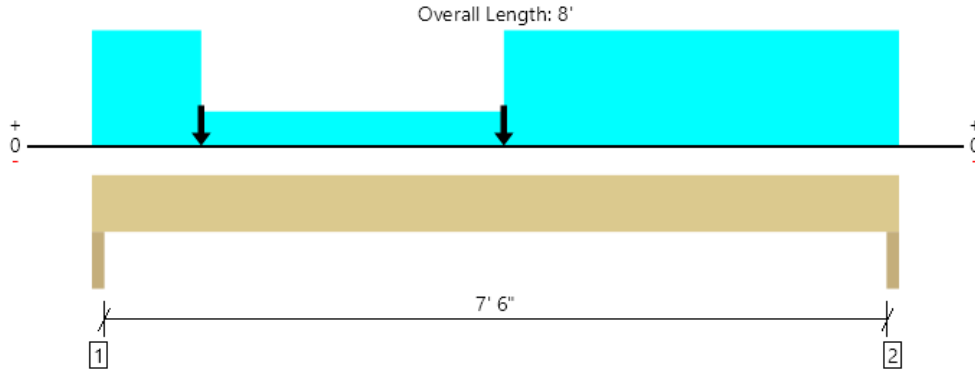

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	3256 @ 1 1/2"	3806 (3.00")	Passed (86%)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Shear (lbs)	1971 @ 6' 7"	4655	Passed (42%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Moment (Ft-lbs)	5727 @ 4' 1"	12129	Passed (47%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Live Load Defl. (in)	0.051 @ 4' 1"	0.258	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Total Load Defl. (in)	0.109 @ 4' 1"	0.387	Passed (L/851)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Trimmer - SPF	3.00"	3.00"	2.57"	1721	1332/-90	715	3256	None
2 - Trimmer - SPF	3.00"	3.00"	2.56"	1718	1332/-90	714	3253	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	7' 11" o/c	
Bottom Edge (Lu)	8' o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 8'	N/A	7.2	--	--	
1 - Uniform (PLF)	0 to 8'	N/A	100.0	-	-	WALL LOAD
2 - Uniform (PLF)	0 to 1' 1"	N/A	132.8	-	273.8	Linked from: R3, Support 1
3 - Uniform (PLF)	4' 1" to 8'	N/A	132.8	-	273.8	Linked from: R3, Support 1
4 - Point (lb)	1' 1"	N/A	203	-	411	Linked from: R10, Support 1
5 - Point (lb)	4' 1"	N/A	203	-	411	Linked from: R10, Support 2
6 - Uniform (PLF)	0 to 8'	N/A	189.0	333.0/-22.5	-95.3	Linked from: K1, Support 1

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K7
2 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

An excessive uplift of -1154 lbs at support located at 1 1/4" failed this product.

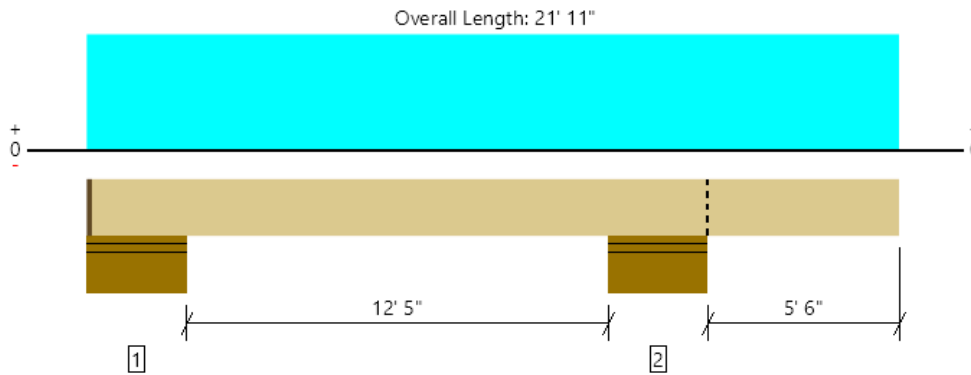

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load: Combination (Pattern)
Member Reaction (lbs)	2779 @ 1' 10 1/2"	20825 (14.00")	Passed (13%)	--	1.0 D + 0.75 L + 0.75 S (Adj Spans)
Shear (lbs)	924 @ 3' 2"	9310	Passed (10%)	1.00	1.0 D + 1.0 L (Adj Spans)
Moment (Ft-lbs)	-2826 @ 21' 3 1/2"	24258	Passed (12%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.010 @ 21' 11"	0.281	Passed (2L/999+)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.047 @ 21' 11"	0.563	Passed (2L/999+)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Stud wall - SPF	24.00"	22.75"	22.75"	2214/-962	412/-192	364/-169	2779	1 1/4" Rim Board
2 - Stud wall - SPF	24.00"	24.00"	24.00"	2063	812/-403	550/-57	3085	Blocking

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	21' 10" o/c	
Bottom Edge (Lu)	21' 10" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	1 1/4" to 21' 11"	N/A	14.3	--	--	
1 - Uniform (PSF)	0 to 21' 11" (Front)	8"	37.0	40.0	-	Default Load
2 - Uniform (PLF)	0 to 21' 11" (Front)	N/A	100.0	-	-	
3 - Uniform (PSF)	0 to 21' 11" (Front)	1'	13.0	-	25.0	

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K8
1 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

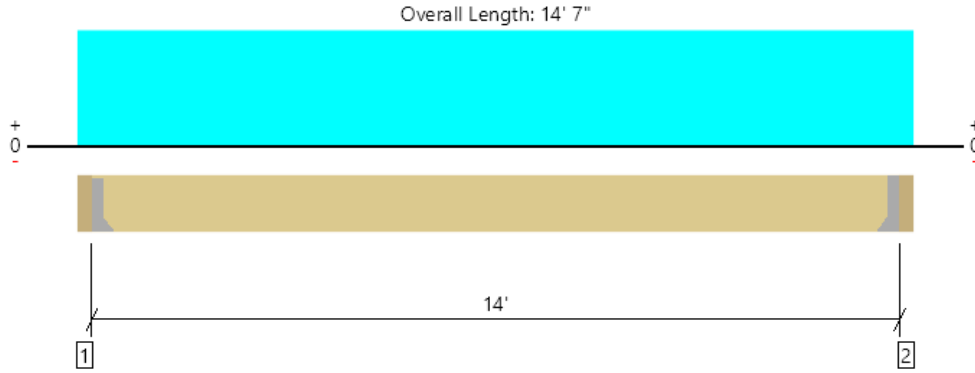

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2206 @ 3 1/2"	2206 (1.68")	Passed (100%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	1838 @ 1' 5 1/2"	4655	Passed (39%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	7721 @ 7' 3 1/2"	12129	Passed (64%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.191 @ 7' 3 1/2"	0.350	Passed (L/879)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.377 @ 7' 3 1/2"	0.700	Passed (L/446)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Hanger on 14" SPF beam	3.50"	Hanger ¹	1.68"	1129	1167	2296	See note ¹
2 - Hanger on 14" SPF beam	3.50"	Hanger ¹	1.68"	1129	1167	2296	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	6' o/c	
Bottom Edge (Lu)	14' o/c	

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie						
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Face Mount Hanger	HUS1.81/10	3.00"	N/A	30-10dx1.5	10-10d	
2 - Face Mount Hanger	HUS1.81/10	3.00"	N/A	30-10dx1.5	10-10d	

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	3 1/2" to 14' 3 1/2"	N/A	7.2	--	
1 - Uniform (PSF)	0 to 14' 7" (Front)	4'	37.0	40.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K9
 1 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

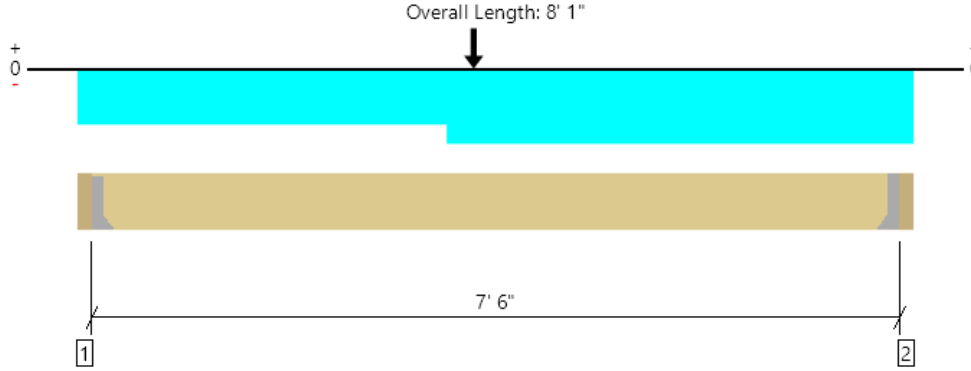

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	1903 @ 3' 1/2"	1969 (1.50")	Passed (97%)	--	1.0 D + 1.0 L (All Spans) [1]
Shear (lbs)	1660 @ 1' 5 1/2"	4655	Passed (36%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Moment (Ft-lbs)	5435 @ 3' 10"	12129	Passed (45%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Live Load Defl. (in)	0.057 @ 3' 10"	0.188	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans) [1]
Total Load Defl. (in)	0.083 @ 3' 10"	0.375	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans) [1]

System : Floor
 Member Type : Flush Beam
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- -245 lbs uplift at support located at 3' 1/2". Strapping or other restraint may be required.
- -386 lbs uplift at support located at 7' 9 1/2". Strapping or other restraint may be required.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Hanger on 14" SPF beam	3.50"	Hanger ¹	1.50"	492	1470	-737	1962/-245	See note ¹
2 - Hanger on 14" SPF beam	3.50"	Hanger ¹	1.50"	350	1320	-737	1670/-386	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	7' 6" o/c	
Bottom Edge (Lu)	7' 6" o/c	

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie						
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Face Mount Hanger	HUS1.81/10	3.00"	N/A	30-10dx1.5	10-10d	
2 - Face Mount Hanger	U14	2.00"	N/A	14-16d	6-10dx1.5	

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	3' 1/2" to 7' 9 1/2"	N/A	7.2	--	--	
1 - Uniform (PSF)	0 to 3' 7" (Front)	1'	37.0	40.0	-	
2 - Uniform (PLF)	0 to 8' 1" (Front)	N/A	-58.5	183.0/-60.0	-182.3	Linked from: K2, Support 1
3 - Point (lb)	3' 10" (Front)	N/A	1129	1167	-	Linked from: K8, Support 1

ForTEWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

35 of 144
File Name: Sam + June_revised 03_2023

Page 30 / 60

Upper Floor, K10
2 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

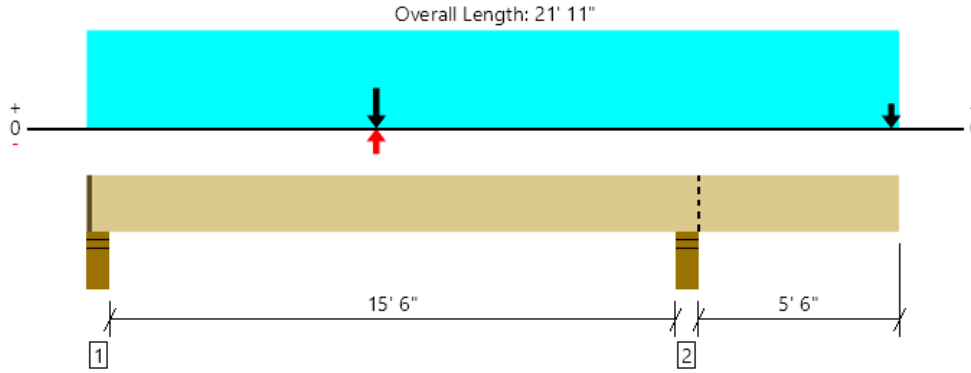

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2925 @ 16' 2 1/4"	8181 (5.50")	Passed (36%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	1781 @ 14' 9 1/2"	9310	Passed (19%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	8958 @ 7' 9 3/4"	24258	Passed (37%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.164 @ 21' 11"	0.286	Passed (2L/838)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.191 @ 21' 11"	0.573	Passed (2L/718)	--	1.0 D + 1.0 S (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Stud wall - SPF	5.50"	4.25"	1.50"	535	1138/-50	-516	1673	1 1/4" Rim Board
2 - Stud wall - SPF	5.50"	5.50"	1.97"	1519	1406	318/-102	2925	Blocking

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	19' 5" o/c	
Bottom Edge (Lu)	21' 10" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	1 1/4" to 21' 11"	N/A	14.3	--	--	
1 - Uniform (PSF)	0 to 21' 11" (Front)	1' 4"	37.0	40.0	-	Default Load
2 - Point (lb)	21' 8 1/2" (Front)	N/A	134	-	-	
3 - Point (lb)	21' 8 1/2" (Front)	N/A	177	-	365	Linked from: R3, Support 2
4 - Point (lb)	7' 9 3/4" (Front)	N/A	350	1320	-737	Linked from: K9, Support 2

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K11
2 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

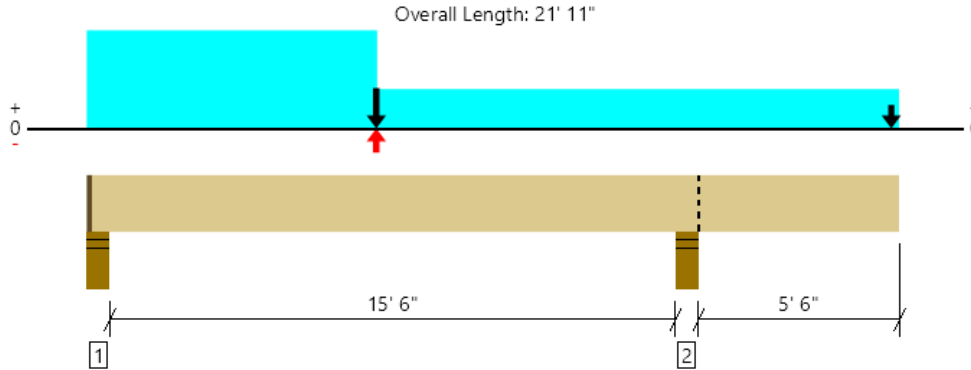

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2732 @ 4"	6322 (4.25")	Passed (43%)	--	1.0 D + 1.0 L (Alt Spans)
Shear (lbs)	2320 @ 1' 7 1/2"	9310	Passed (25%)	1.00	1.0 D + 1.0 L (Alt Spans)
Moment (Ft-lbs)	12387 @ 7' 9 3/4"	24258	Passed (51%)	1.00	1.0 D + 1.0 L (Alt Spans)
Live Load Defl. (in)	0.231 @ 7' 9 3/4"	0.396	Passed (L/823)	--	1.0 D + 1.0 L (Alt Spans)
Total Load Defl. (in)	0.327 @ 7' 9 3/4"	0.793	Passed (L/581)	--	1.0 D + 1.0 L (Alt Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Stud wall - SPF	5.50"	4.25"	1.84"	1057	1701/-41	-516	2758	1 1/4" Rim Board
2 - Stud wall - SPF	5.50"	5.50"	2.24"	1717	1618	318/-102	3335	Blocking

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	13' 4" o/c	
Bottom Edge (Lu)	21' 10" o/c	

- Maximum allowable bracing intervals based on applied load.


Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	1 1/4" to 21' 11"	N/A	14.3	--	--	
1 - Uniform (PSF)	0 to 21' 11" (Front)	1' 4"	37.0	40.0	-	Default Load
2 - Point (lb)	21' 8 1/2" (Front)	N/A	134	-	-	
3 - Uniform (PSF)	0 to 7' 10" (Front)	2'	37.0	40.0	-	
4 - Point (lb)	21' 8 1/2" (Front)	N/A	177	-	365	Linked from: R3, Support 2
5 - Point (lb)	7' 9 3/4" (Front)	N/A	492	1470	-737	Linked from: K9, Support 1

Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K12
 1 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

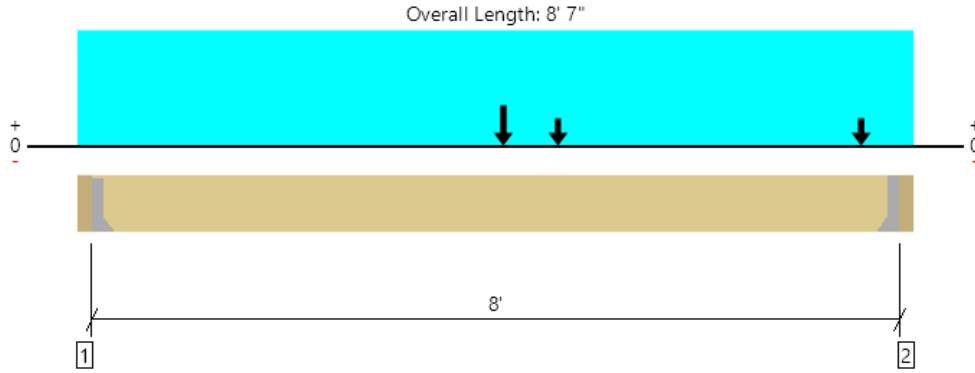

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3648 @ 8' 3 1/2"	3648 (2.78")	Passed (100%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	2648 @ 7' 1 1/2"	4655	Passed (57%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	8168 @ 4' 4 1/2"	12129	Passed (67%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.080 @ 4' 4 1/2"	0.200	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.140 @ 4' 4 1/2"	0.400	Passed (L/684)	--	1.0 D + 1.0 L (All Spans)

System : Floor
 Member Type : Flush Beam
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Hanger on 14" SPF beam	3.50"	Hanger ¹	1.77"	1052	1322	2374	See note ¹
2 - Hanger on 14" SPF beam	3.50"	Hanger ¹	2.78"	1422	2271	3693	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	5' 7" o/c	
Bottom Edge (Lu)	8' o/c	

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie						
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Face Mount Hanger	HUS1.81/10	3.00"	N/A	30-10dx1.5	10-10d	
2 - Face Mount Hanger	HUS1.81/10	3.00"	N/A	30-10d	10-10d	

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.


Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	3 1/2" to 8' 3 1/2"	N/A	7.2	--	
1 - Uniform (PSF)	0 to 8' 7" (Front)	2'	37.0	40.0	
2 - Point (lb)	7' 11" (Front)	N/A	326	870	
3 - Point (lb)	4' 11" (Front)	N/A	326	870	
4 - Point (lb)	4' 4 1/2" (Front)	N/A	1129	1167	Linked from: K8, Support 1

Weyerhaeuser Notes
 Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.
 The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K13
2 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

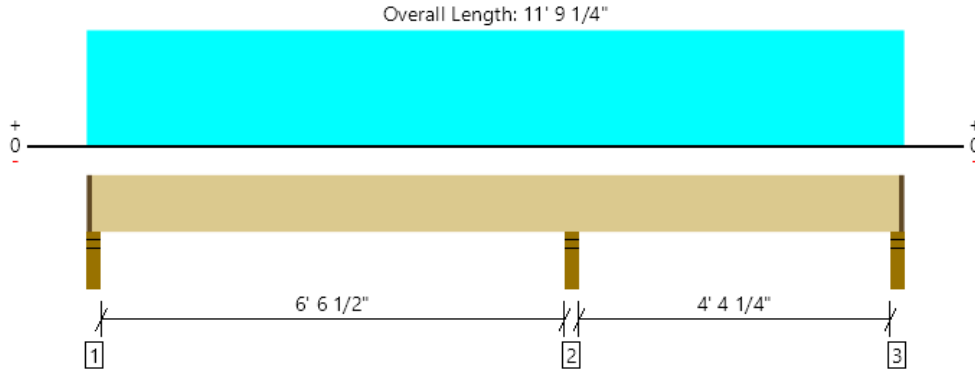

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	4069 @ 6' 11 3/4"	5206 (3.50")	Passed (78%)	--	1.0 D + 0.75 L + 0.75 S (All Spans)
Shear (lbs)	1433 @ 5' 8"	9310	Passed (15%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	-2355 @ 6' 11 3/4"	24258	Passed (10%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.007 @ 3' 3 11/16"	0.170	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.017 @ 3' 3"	0.341	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.50"	1023	511/-9	299	1630	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	3.50"	2.74"	2596	1228	737	4069	None
3 - Stud wall - SPF	3.50"	2.25"	1.50"	527	374/-107	187	948	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	11' 7" o/c	
Bottom Edge (Lu)	11' 7" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	1 1/4" to 11' 8"	N/A	14.3	--	--	
1 - Uniform (PSF)	0 to 11' 9 1/4" (Front)	4' 2"	37.0	40.0	-	Default Load
2 - Uniform (PLF)	0 to 11' 9 1/4" (Front)	N/A	100.0	-	-	
3 - Uniform (PSF)	0 to 11' 9 1/4" (Front)	4'	21.0	-	25.0	awning

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, K14
2 piece(s) 1 3/4" x 16" 2.OE Microllam® LVL

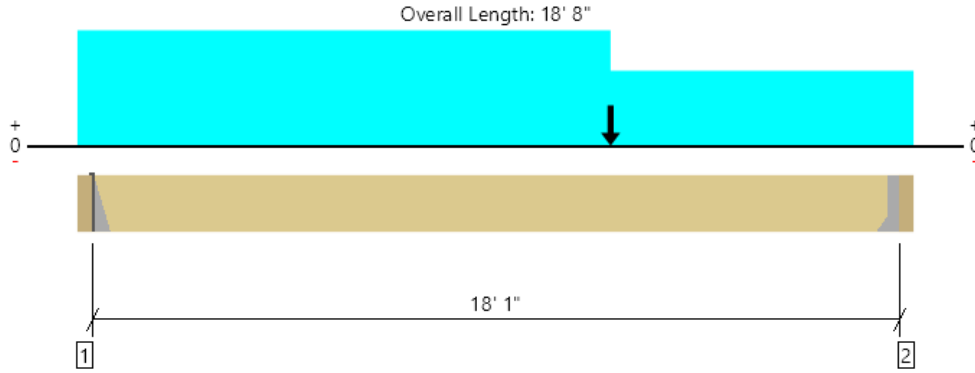

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	4696 @ 18' 4 1/2"	4696 (1.79")	Passed (100%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	4310 @ 17' 1/2"	10640	Passed (41%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	24522 @ 10' 10 5/8"	31114	Passed (79%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.272 @ 9' 6 1/2"	0.452	Passed (L/797)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.636 @ 9' 5 7/8"	0.904	Passed (L/341)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Hanger on 16" SPF beam	3.50"	Hanger ¹	1.76"	2814	1939	4753	See note ¹
2 - Hanger on 16" SPF beam	3.50"	Hanger ¹	1.79"	2799	1976	4776	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	6' 2" o/c	
Bottom Edge (Lu)	18' 1" o/c	

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie						
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Top Mount Hanger	HWP3.56/16	3.25"	4-16d	8-16d	12-10dx1.5	
2 - Face Mount Hanger	HGUS412	4.00"	N/A	56-10d	20-10d	

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	3 1/2" to 18' 4 1/2"	N/A	16.3	--	
1 - Uniform (PSF)	0 to 11' 11" (Front)	4' 2"	37.0	40.0	Default Load
2 - Uniform (PLF)	0 to 18' 8" (Front)	N/A	100.0	-	
3 - Uniform (PSF)	11' 11" to 18' 8" (Front)	2' 3"	37.0	40.0	
4 - Point (lb)	11' 11" (Front)	N/A	1052	1322	Linked from: K12, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U1
1 piece(s) 4 x 16 DF No.1 @ 24" OC

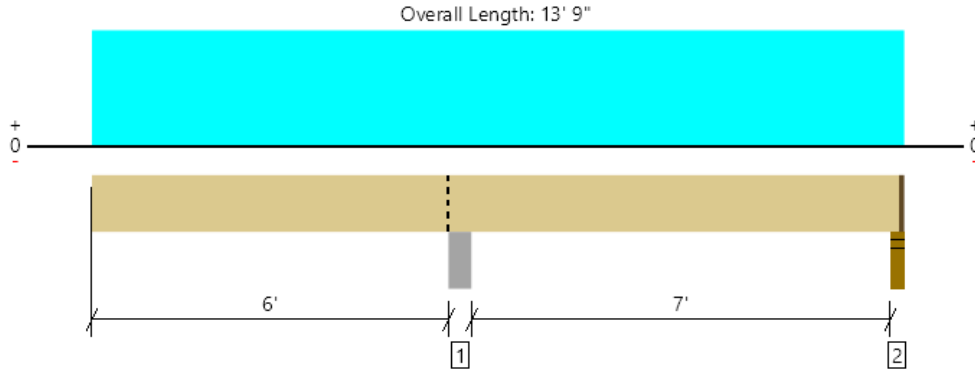

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1630 @ 6' 2 3/4"	12031 (5.50")	Passed (14%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	625 @ 7' 8 3/4"	7366	Passed (8%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	-2522 @ 6' 2 3/4"	14951	Passed (17%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.021 @ 0	0.415	Passed (2L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.051 @ 0	0.623	Passed (2L/999+)	--	1.0 D + 1.0 S (All Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Left cantilever length exceeds 1/3 member length or 1/2 back span length. Additional bracing should be considered.
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Plate - steel	5.50"	5.50"	1.50"	1003	627	1630	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.50"	97	127/-33	224	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- Steel plate supports are only used to determine the bearing length for supported member(s). Additional consideration is required to determine steel plate specifications.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	13' 8" o/c	
Bottom Edge (Lu)	13' 8" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 13' 9"	24"	40.0	25.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U2
1 piece(s) 4 x 16 DF No.1 @ 24" OC

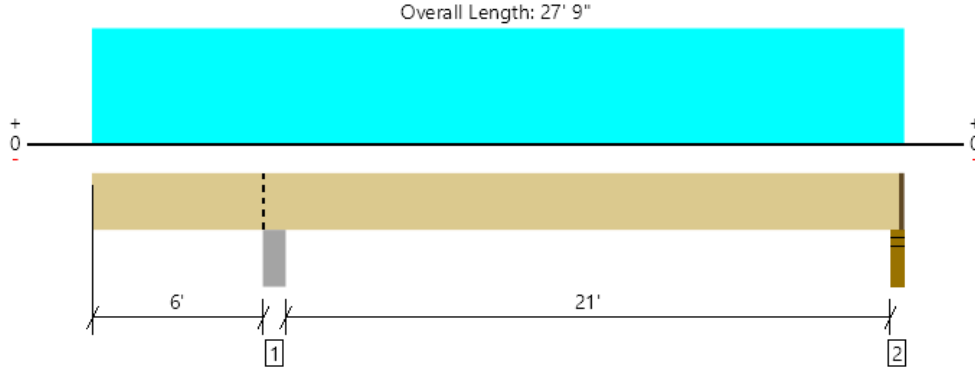

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1303 @ 27' 6 1/2"	3347 (2.25")	Passed (39%)	--	1.0 D + 1.0 S (Alt Spans)
Shear (lbs)	1309 @ 7' 8 3/4"	7366	Passed (18%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	6398 @ 17' 7 7/16"	14951	Passed (43%)	1.15	1.0 D + 1.0 S (Alt Spans)
Live Load Defl. (in)	0.118 @ 17' 5/8"	0.710	Passed (L/999+)	--	1.0 D + 1.0 S (Alt Spans)
Total Load Defl. (in)	0.287 @ 17' 2"	1.066	Passed (L/892)	--	1.0 D + 1.0 S (Alt Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Factored	
1 - Plate - steel	5.50"	5.50"	1.50"	1424	890	2313	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.50"	796	520	1317	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- Steel plate supports are only used to determine the bearing length for supported member(s). Additional consideration is required to determine steel plate specifications.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	27' 8" o/c	
Bottom Edge (Lu)	27' 8" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location (Side)	Spacing	Dead (0.90)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 27' 9"	24"	40.0	25.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U3
1 piece(s) 4 x 16 DF No.1 @ 24" OC

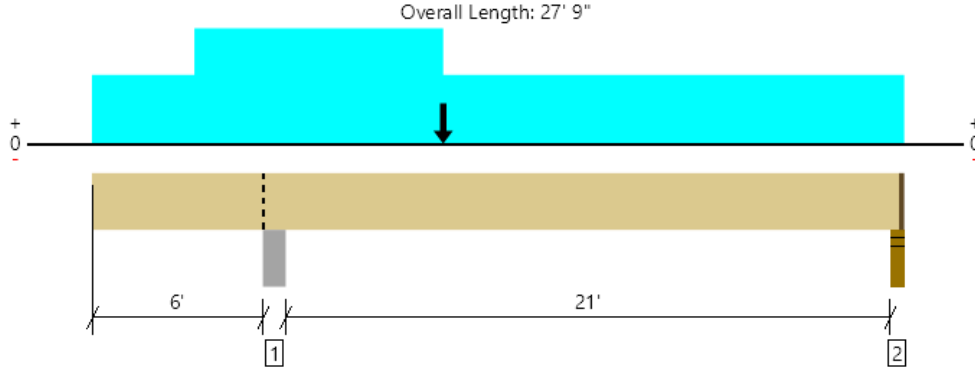

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1415 @ 27' 6 1/2"	3347 (2.25")	Passed (42%)	--	1.0 D + 1.0 L (Alt Spans)
Shear (lbs)	1557 @ 7' 8 3/4"	6405	Passed (24%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	7559 @ 16' 9 1/16"	13001	Passed (58%)	1.00	1.0 D + 1.0 L (Alt Spans)
Live Load Defl. (in)	0.229 @ 16' 9 3/8"	0.710	Passed (L/999+)	--	1.0 D + 1.0 L (Alt Spans)
Total Load Defl. (in)	0.349 @ 16' 10 3/4"	1.066	Passed (L/733)	--	1.0 D + 1.0 L (Alt Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Plate - steel	5.50"	5.50"	1.50"	1147	1401	606	2652	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.50"	529	900/-13	16/-26	1429	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- Steel plate supports are only used to determine the bearing length for supported member(s). Additional consideration is required to determine steel plate specifications.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	27' 8" o/c	
Bottom Edge (Lu)	27' 8" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 3' 6"	24"	40.0	-	25.0	Default Load
2 - Uniform (PSF)	3' 6" to 12'	24"	24.0	60.0	25.0	
3 - Uniform (PSF)	12' to 27' 9"	24"	25.0	40.0	-	
4 - Point (PLF)	12'	24"	100.0	-	-	

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woodyhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U3 - hot tub
1 piece(s) 4 x 16 DF No.1 @ 24" OC

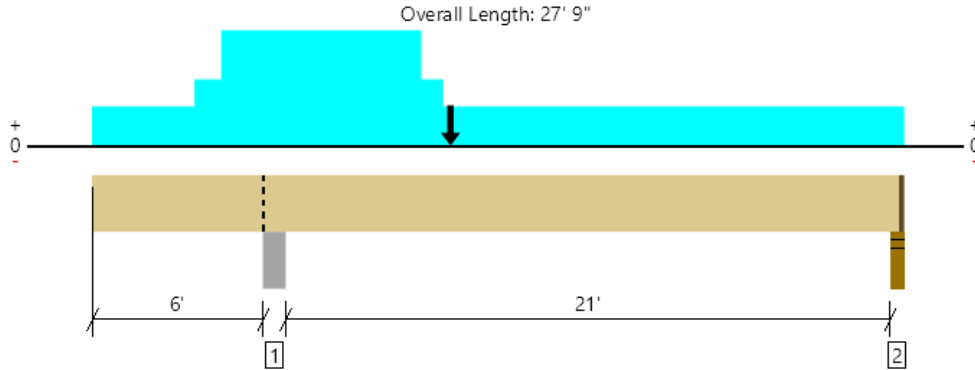

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1652 @ 27' 6 1/2"	3347 (2.25")	Passed (49%)	--	1.0 D + 1.0 L (Alt Spans)
Shear (lbs)	2393 @ 7' 8 3/4"	6405	Passed (37%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	10320 @ 14' 11 5/16"	13001	Passed (79%)	1.00	1.0 D + 1.0 L (Alt Spans)
Live Load Defl. (in)	0.327 @ 16' 3 1/8"	0.710	Passed (L/781)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.523 @ 16' 4 11/16"	1.066	Passed (L/489)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Upward deflection on left cantilever exceeds 0.4".
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Plate - steel	5.50"	5.50"	1.96"	1508	2412	1291	4285	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.50"	670	995/-25	286	1665	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- Steel plate supports are only used to determine the bearing length for supported member(s). Additional consideration is required to determine steel plate specifications.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	22' o/c	
Bottom Edge (Lu)	27' 8" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 3' 6"	24"	40.0	-	25.0	Default Load
2 - Uniform (PSF)	3' 6" to 4' 5"	24"	24.0	60.0	25.0	
3 - Uniform (PSF)	4' 5" to 11' 3"	24"	25.0	140.0	25.0	
4 - Uniform (PSF)	11' 3" to 12'	24"	24.0	60.0	25.0	
5 - Uniform (PSF)	12' to 27' 9"	24"	25.0	40.0	-	
6 - Point (PLF)	12' 3"	24"	100.0	-	-	
7 - Point (lb)	12' 3"	N/A	240	-	440	
8 - Point (PLF)	12' 3"	24"	124.5	-	257.0	Linked from: R1, Support 1

Forteweb Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

45 of 144
File Name: Sam + June_revised 03_2023

Page 40 / 60

Upper Floor, U3 - south wall
1 piece(s) 4 x 16 DF No.1 @ 24" OC

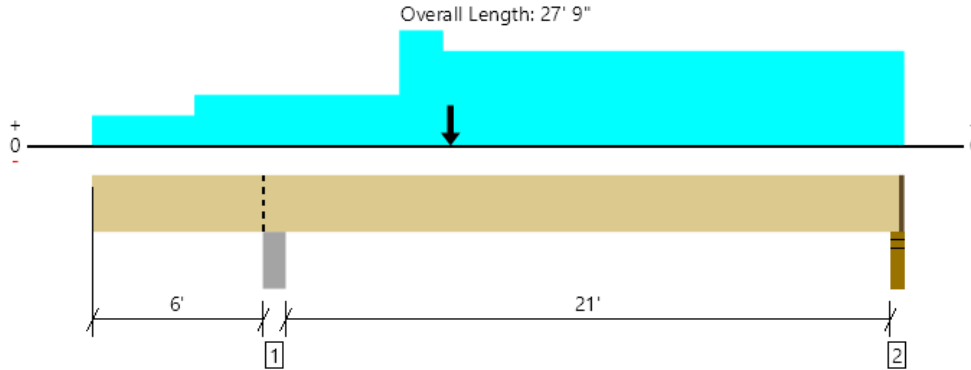

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2701 @ 27' 6 1/2"	3347 (2.25")	Passed (81%)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Shear (lbs)	2366 @ 7' 8 3/4"	6405	Passed (37%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	13684 @ 16' 11 7/16"	13001	Failed (105%)	1.00	1.0 D + 1.0 L (Alt Spans)
Live Load Defl. (in)	0.281 @ 16' 7 1/16"	0.710	Passed (L/910)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.682 @ 16' 10 3/16"	1.066	Passed (L/375)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Upward deflection on left cantilever exceeds 0.4".
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Plate - steel	5.50"	5.50"	1.77"	1956	1401	1146	3866	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.82"	1735	900/-13	422	2727	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- Steel plate supports are only used to determine the bearing length for supported member(s). Additional consideration is required to determine steel plate specifications.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 11" o/c	
Bottom Edge (Lu)	27' 8" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 3' 6"	24"	40.0	-	25.0	Default Load
2 - Uniform (PSF)	3' 6" to 12'	24"	24.0	60.0	25.0	
3 - Uniform (PSF)	12' to 27' 9"	24"	25.0	40.0	-	
4 - Uniform (PLF)	10' 6" to 27' 9"	N/A	114.0	-	25.0	
5 - Point (PLF)	12' 3"	24"	124.5	-	257.0	Linked from: R1, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U3 - north point load
1 piece(s) 4 x 16 DF No.1 @ 24" OC

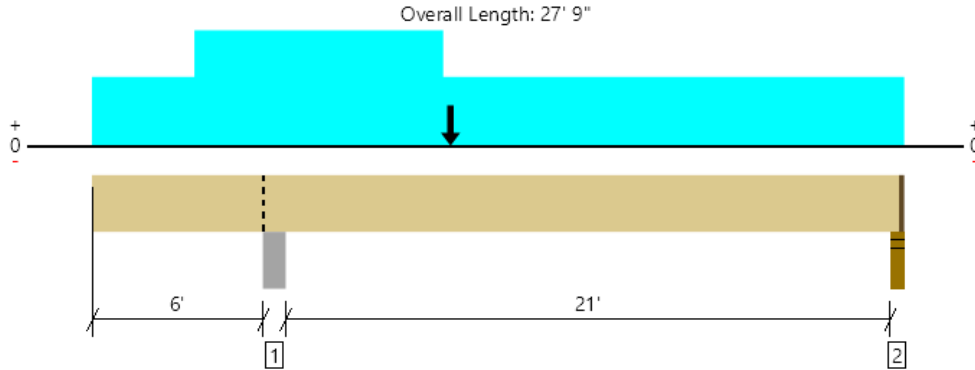

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1718 @ 27' 6 1/2"	3347 (2.25")	Passed (51%)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Shear (lbs)	2795 @ 7' 8 3/4"	7366	Passed (38%)	1.15	1.0 D + 0.75 L + 0.75 S (All Spans)
Moment (Ft-lbs)	13238 @ 12' 3"	14951	Passed (89%)	1.15	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Live Load Defl. (in)	0.339 @ 16' 3 3/8"	0.710	Passed (L/755)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
Total Load Defl. (in)	0.573 @ 16' 4 5/16"	1.066	Passed (L/447)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Overhang deflection criteria: LL (2L/360) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Upward deflection on left cantilever exceeds 0.4".
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Plate - steel	5.50"	5.50"	1.80"	1682	1401	1621	3948	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.50"	743	900/-13	416	1730	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.
- Steel plate supports are only used to determine the bearing length for supported member(s). Additional consideration is required to determine steel plate specifications.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	16' 6" o/c	
Bottom Edge (Lu)	27' 8" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
1 - Uniform (PSF)	0 to 3' 6"	24"	40.0	-	25.0	Default Load
2 - Uniform (PSF)	3' 6" to 12'	24"	24.0	60.0	25.0	
3 - Uniform (PSF)	12' to 27' 9"	24"	25.0	40.0	-	
4 - Point (PLF)	12' 3"	24"	100.0	-	-	
5 - Point (lb)	12' 3"	N/A	749	-	1414	half of R5 and half of R6, psl at base of wall will distribute load

ForteWEB Software Operator Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	Job Notes
--	-----------



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

48 of 144
File Name: Sam + June_revised 03_2023

Page 43 / 60

Upper Floor, U4 - no steel
 1 piece(s) 5 1/4" x 18" 2.0E Parallam® PSL

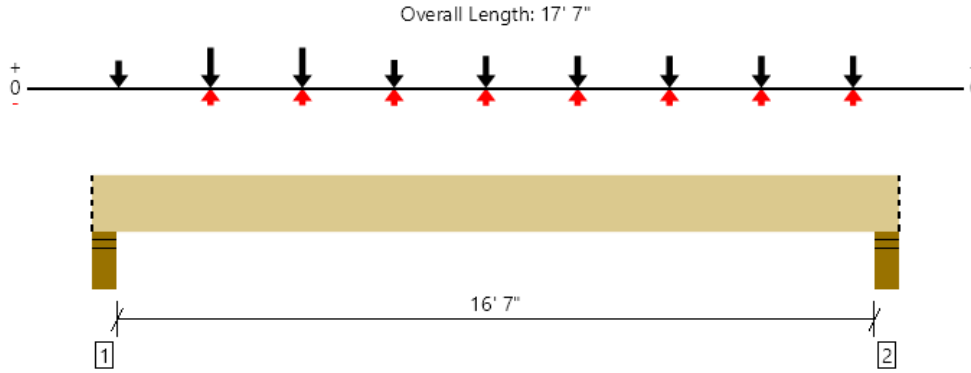

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	8853 @ 4 1/2"	13388 (6.00")	Passed (66%)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Shear (lbs)	7690 @ 2'	18270	Passed (42%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Moment (Ft-lbs)	33115 @ 8' 7"	65497	Passed (51%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Live Load Defl. (in)	0.189 @ 8' 10 1/16"	0.421	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans) [1]
Total Load Defl. (in)	0.372 @ 8' 7"	0.842	Passed (L/543)	--	1.0 D + 1.0 L (All Spans) [1]

System : Floor
 Member Type : Flush Beam
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Stud wall - SPF	6.00"	6.00"	3.97"	5109	3392/-64	1600	8853	Blocking
2 - Stud wall - SPF	6.00"	6.00"	3.51"	3556	4283/-100	1210	7839	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	17' 7" o/c	
Bottom Edge (Lu)	17' 7" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 17' 7"	N/A	29.5	--	--	
1 - Point (lb)	7" (Front)	N/A	796	-	520	Linked from: U2, Support 2
2 - Point (lb)	8' 7" (Front)	N/A	670	995/-25	286	Linked from: U3 - hot tub, Support 2
3 - Point (lb)	10' 7" (Front)	N/A	670	995/-25	286	Linked from: U3 - hot tub, Support 2
4 - Point (lb)	12' 7" (Front)	N/A	670	995/-25	286	Linked from: U3 - hot tub, Support 2
5 - Point (lb)	14' 7" (Front)	N/A	670	995/-25	286	Linked from: U3 - hot tub, Support 2
6 - Point (lb)	16' 7" (Front)	N/A	670	995/-25	286	Linked from: U3 - hot tub, Support 2
7 - Point (lb)	6' 7" (Front)	N/A	529	900/-13	16/-26	Linked from: U3, Support 2
8 - Point (lb)	2' 7" (Front)	N/A	1735	900/-13	422	Linked from: U3 - south wall, Support 2
9 - Point (lb)	4' 7" (Front)	N/A	1735	900/-13	422	Linked from: U3 - south wall, Support 2

ForteWEB Software Operator Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	Job Notes
--	-----------



Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U5
2 piece(s) 1 3/4" x 18" 2.OE Microllam® LVL

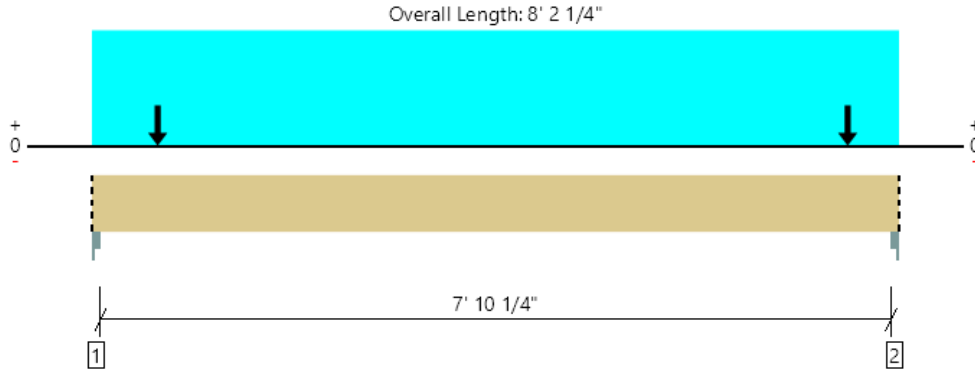

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	4906 @ 8' 1 3/4"	5250 (2.00")	Passed (93%)	--	1.0 D + 0.75 L + 0.75 S (All Spans) [1]
Shear (lbs)	2202 @ 1' 8"	11970	Passed (18%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Moment (Ft-lbs)	7015 @ 4' 7/8"	38753	Passed (18%)	1.00	1.0 D + 1.0 L (All Spans) [1]
Live Load Defl. (in)	0.021 @ 4' 1 1/16"	0.203	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans) [1]
Total Load Defl. (in)	0.038 @ 4' 1"	0.405	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans) [1]

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Column Cap - steel	2.00"	2.00"	1.84"	2086	2006	1654	4831	Blocking
2 - Column Cap - steel	2.00"	2.00"	1.87"	2116	2006	1713	4906	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	8' 2" o/c	
Bottom Edge (Lu)	8' 2" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 8' 2 1/4"	N/A	18.4	--	--	
1 - Uniform (PSF)	0 to 8' 2 1/4" (Front)	1'	25.0	40.0	-	
2 - Point (lb)	8" (Front)	N/A	841	-	1651	Linked from: R8, Support 1
3 - Point (lb)	7' 8" (Front)	N/A	841	-	1651	Linked from: R8, Support 1
4 - Uniform (PLF)	0 to 8' 2 1/4" (Front)	N/A	264.5	450.0/-6.5	8.0/-13.0	Linked from: U3, Support 2

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.woyehaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Upper Floor, U6
1 piece(s) 3 1/2" x 9 1/4" 2.0E Parallam® PSL

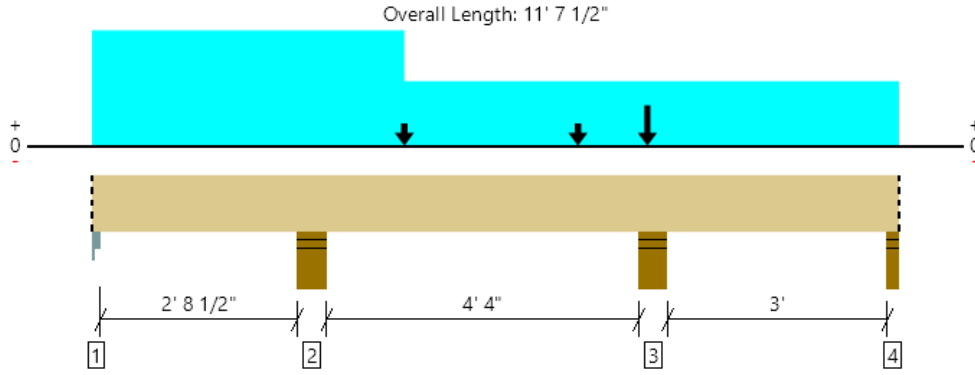

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern) [Group]
Member Reaction (lbs)	6303 @ 8' 1"	10413 (7.00")	Passed (61%)	--	1.0 D + 0.75 L + 0.75 S (Adj Spans) [1]
Shear (lbs)	1499 @ 7' 1/4"	6259	Passed (24%)	1.00	1.0 D + 1.0 L (Adj Spans) [1]
Moment (Ft-lbs)	-1854 @ 3' 2"	12416	Passed (15%)	1.00	1.0 D + 1.0 L (Adj Spans) [1]
Live Load Defl. (in)	0.012 @ 5' 7 5/16"	0.123	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans) [1]
Total Load Defl. (in)	0.021 @ 5' 7 1/4"	0.246	Passed (L/999+)	--	1.0 D + 0.75 L + 0.75 S (Alt Spans) [1]

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Column Cap - steel	2.00"	2.00"	1.50"	523	736/-224	278	1284	Blocking
2 - Stud wall - SPF	7.00"	7.00"	3.32"	2345	2351	1112	4941	None
3 - Stud wall - SPF	7.00"	7.00"	4.24"	3412	2582	1274	6303	None
4 - Stud wall - SPF	3.00"	3.00"	1.50"	485	826/-195	-80	1312	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	11' 8" o/c	
Bottom Edge (Lu)	11' 8" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 to 11' 7 1/2"	N/A	10.1	--	--	
1 - Uniform (PSF)	0 to 11' 7 1/2" (Front)	1'	25.0	40.0	-	
2 - Uniform (PLF)	0 to 11' 7 1/2" (Front)	N/A	100.0	-	-	
3 - Uniform (PLF)	0 to 4' 6" (Front)	N/A	105.5	-	218.5	Linked from: R1, Support 2
4 - Point (lb)	4' 6" (Front)	N/A	162	-	328	Linked from: R7, Support 1
5 - Uniform (PLF)	0 to 11' 7 1/2" (Front)	N/A	264.5	450.0/-6.5	8.0/-13.0	Linked from: U3, Support 2
6 - Point (lb)	7' (Front)	N/A	162	-	328	Linked from: R7, Support 1
7 - Point (lb)	8' (Front)	N/A	1321	172	813	Linked from: P11 - no floor load, Support 2

Forteweb Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

53 of 144
File Name: Sam + June_revised 03_2023

Page 48 / 60

Main Floor, M1
1 piece(s) 14" TJI® 560 @ 16" OC

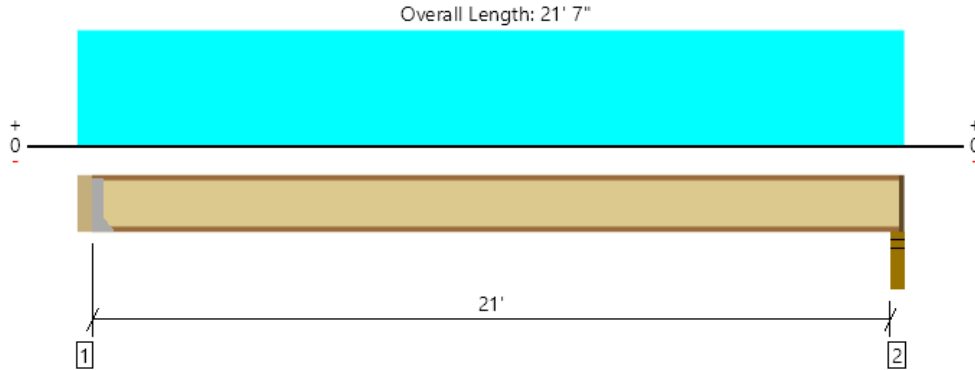

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1377 @ 3 1/2"	1377 (2.18")	Passed (100%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	1377 @ 3 1/2"	2390	Passed (58%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	7260 @ 10' 10"	11275	Passed (64%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.266 @ 10' 10"	0.527	Passed (L/951)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.652 @ 10' 10"	1.054	Passed (L/388)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	47	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Hanger on 14" SPF beam	3.50"	Hanger ¹	2.18" / - ²	838	578	1416	See note ¹
2 - Stud wall - SPF	3.50"	2.25"	2.23"	831	573	1405	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.
- ² Required Bearing Length / Required Bearing Length with Web Stiffeners

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	7' o/c	
Bottom Edge (Lu)	21' 2" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie

Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories
1 - Face Mount Hanger	MIU3.56/14	2.50"	N/A	22-10dx1.5	2-10dx1.5	

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 21' 7"	16"	58.0	40.0	Default Load

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.


The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M1a
1 piece(s) 16" TJI® 560 @ 16" OC

Overall Length: 27' 7"

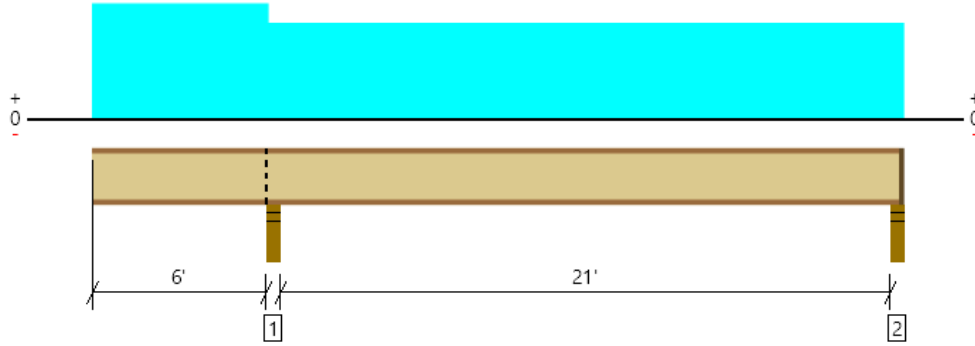

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1332 @ 27' 4 1/2"	1396 (2.25")	Passed (95%)	1.00	1.0 D + 1.0 L (Alt Spans)
Shear (lbs)	1407 @ 6' 3 1/2"	2710	Passed (52%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	6649 @ 17' 3 7/16"	12925	Passed (51%)	1.00	1.0 D + 1.0 L (Alt Spans)
Live Load Defl. (in)	0.208 @ 16' 9 1/8"	0.531	Passed (L/999+)	--	1.0 D + 1.0 L (Alt Spans)
Total Load Defl. (in)	0.459 @ 16' 11 7/16"	1.061	Passed (L/555)	--	1.0 D + 1.0 L (Alt Spans)
TJ-Pro™ Rating	50	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	3.50"	3.50"	3.50"	1365	1125	2490	Blocking
2 - Stud wall - SPF	3.50"	2.25"	2.00"	768	577/-66	1345	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	8' 1" o/c	
Bottom Edge (Lu)	12' 4" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	6' to 27' 7"	16"	58.0	40.0	Default Load
2 - Uniform (PSF)	0 to 6'	16"	58.0	60.0	

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M2
1 piece(s) 2 x 8 HF No.2 @ 16" OC

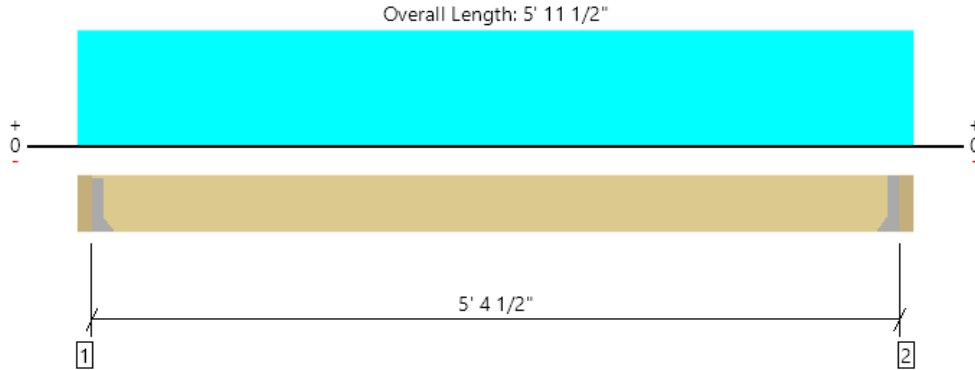

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	455 @ 3 1/2"	911 (1.50")	Passed (50%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	353 @ 10 3/4"	1088	Passed (32%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	612 @ 2' 11 3/4"	1284	Passed (48%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.024 @ 2' 11 3/4"	0.134	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.051 @ 2' 11 3/4"	0.269	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	N/A	N/A	N/A	--	N/A

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A 15% increase in the moment capacity has been added to account for repetitive member usage.
- Applicable calculations are based on NDS.
- No composite action between deck and joist was considered in analysis.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Hanger on 7 1/4" SPF beam	3.50"	Hanger ¹	1.50"	266	238	504	See note ¹
2 - Hanger on 7 1/4" SPF beam	3.50"	Hanger ¹	1.50"	266	238	504	See note ¹

- At hanger supports, the Total Bearing dimension is equal to the width of the material that is supporting the hanger
- ¹ See Connector grid below for additional information and/or requirements.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	5' 5" o/c	
Bottom Edge (Lu)	5' 5" o/c	

- Maximum allowable bracing intervals based on applied load.

Connector: Simpson Strong-Tie							
Support	Model	Seat Length	Top Fasteners	Face Fasteners	Member Fasteners	Accessories	
1 - Face Mount Hanger	LU28	1.50"	N/A	8-10dx1.5	6-10dx1.5		
2 - Face Mount Hanger	LU26	1.50"	N/A	6-10dx1.5	4-10dx1.5		

- Refer to manufacturer notes and instructions for proper installation and use of all connectors.


Vertical Load	Location (Side)	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 5' 11 1/2"	16"	67.0	60.0	Default Load

Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.
The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M3
1 piece(s) 14" TJI® 560 @ 12" OC

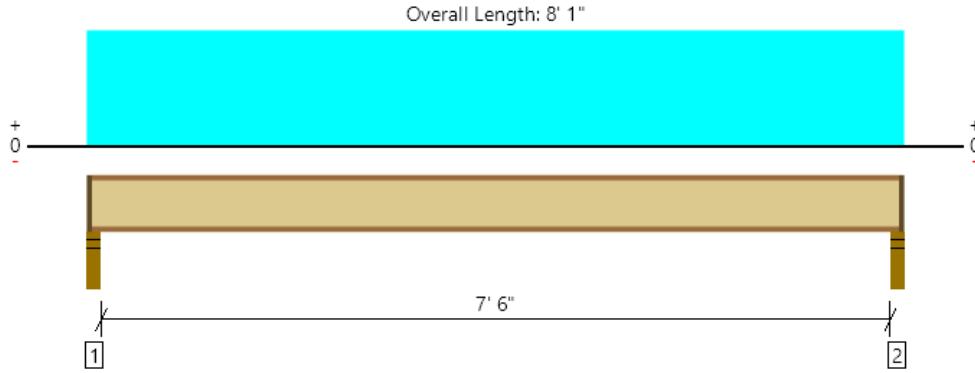

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	386 @ 2 1/2"	1396 (2.25")	Passed (28%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	368 @ 3 1/2"	2390	Passed (15%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	720 @ 4' 1/2"	11275	Passed (6%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.007 @ 4' 1/2"	0.192	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.017 @ 4' 1/2"	0.383	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	72	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.75"	234	162	396	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.75"	234	162	396	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	7' 11" o/c	
Bottom Edge (Lu)	7' 11" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 8' 1"	12"	58.0	40.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M4
1 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

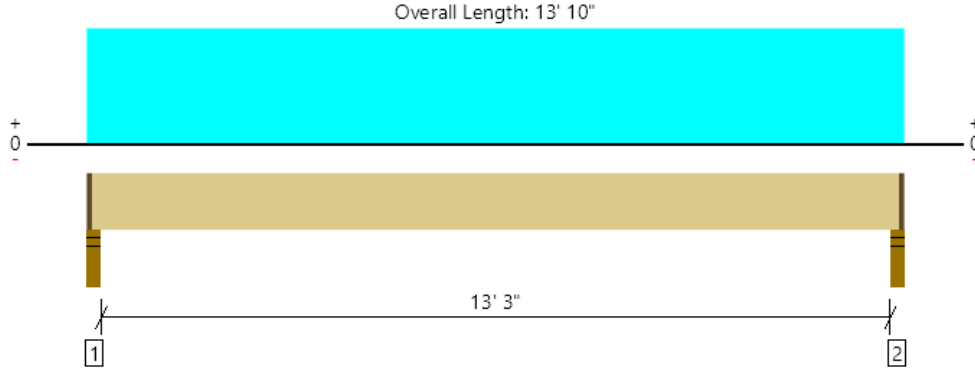

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1384 @ 2"	1673 (2.25")	Passed (83%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	1109 @ 1' 5 1/2"	4655	Passed (24%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	4628 @ 6' 11"	12129	Passed (38%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.083 @ 6' 11"	0.338	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.211 @ 6' 11"	0.675	Passed (L/766)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.86"	851	553	1404	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.86"	851	553	1404	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	11' 2" o/c	
Bottom Edge (Lu)	13' 8" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	1 1/4" to 13' 8 3/4"	N/A	7.2	--	
1 - Uniform (PSF)	0 to 13' 10" (Front)	2'	58.0	40.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M6
2 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

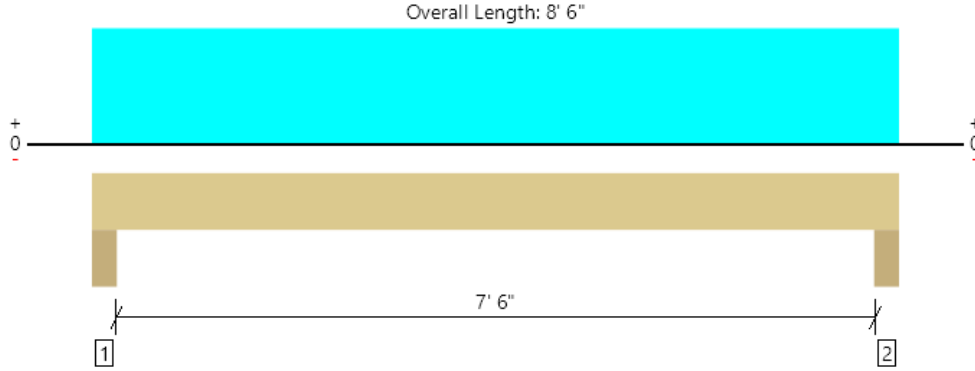

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	4574 @ 4' 1/2"	15225 (6.00")	Passed (30%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	2780 @ 1' 8"	9310	Passed (30%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	8081 @ 4' 3"	24258	Passed (33%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.030 @ 4' 3"	0.258	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.074 @ 4' 3"	0.387	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)

System : Wall
Member Type : Header
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Trimmer - SPF	6.00"	6.00"	1.80"	2732	1842	4574	None
2 - Trimmer - SPF	6.00"	6.00"	1.80"	2732	1842	4574	None

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	8' 6" o/c	
Bottom Edge (Lu)	8' 6" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	0 to 8' 6"	N/A	14.3	--	
1 - Uniform (PLF)	0 to 8' 6"	N/A	628.5	433.5	Linked from: M1, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M7
1 piece(s) W10X30 (A992) ASTM Steel

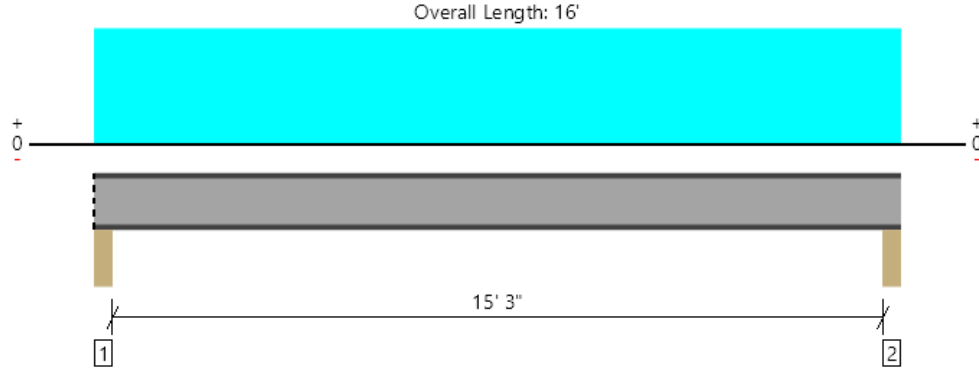

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	15180 @ 3"	18955 (4.50")	Passed (80%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	14468 @ 4 1/2"	63000	Passed (23%)	--	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	56984 @ 8'	91317	Passed (62%)	--	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.222 @ 8'	0.517	Passed (L/837)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.500 @ 8'	0.775	Passed (L/372)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Drop Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Applicable calculations are based on ANSI/AISC 360-16.
- A lateral-torsional buckling factor (C_b) of 1.0 has been assumed.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Column - SPF	4.50"	4.50"	4.50"	8430	6750	15180	Blocking
2 - Column - SPF	4.50"	4.50"	4.50"	8430	6750	15180	None

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	Continuous	
Bottom Edge (Lu)	Continuous	

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	0 to 16'	N/A	30.0	--	
1 - Uniform (PLF)	0 to 16'	N/A	1023.8	843.8	Linked from: M1a, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M8
2 piece(s) 2 x 10 HF No.1

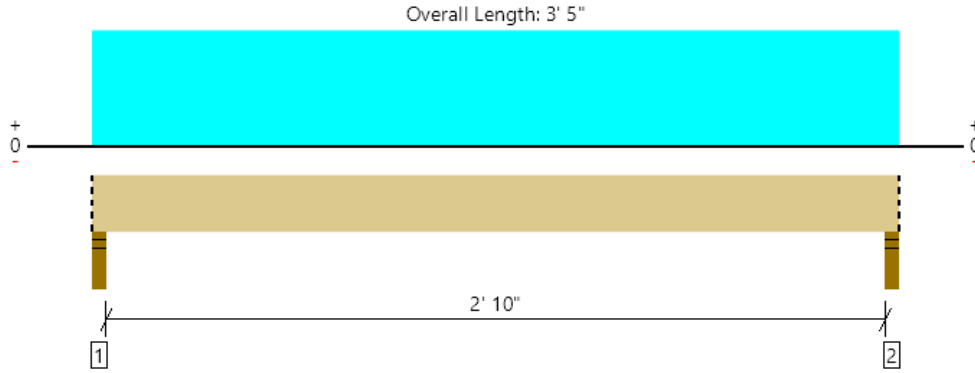

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2643 @ 2"	4253 (3.50")	Passed (62%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	999 @ 1' 3/4"	2775	Passed (36%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	1838 @ 1' 8 1/2"	3824	Passed (48%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.004 @ 1' 8 1/2"	0.077	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.011 @ 1' 8 1/2"	0.154	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	3.50"	3.50"	2.18"	1597	1046	2643	Blocking
2 - Stud wall - SPF	3.50"	3.50"	2.18"	1597	1046	2643	Blocking

• Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 5" o/c	
Bottom Edge (Lu)	3' 5" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	0 to 3' 5"	N/A	7.0	--	
1 - Uniform (PLF)	0 to 3' 5" (Front)	N/A	100.0	-	Default Load
2 - Uniform (PLF)	0 to 3' 5" (Front)	N/A	628.5	433.5	Linked from: M1, Support 1
3 - Uniform (PLF)	0 to 3' 5" (Front)	N/A	199.5	178.5	Linked from: M2, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M9
2 piece(s) 1 3/4" x 14" 2.OE Microllam® LVL

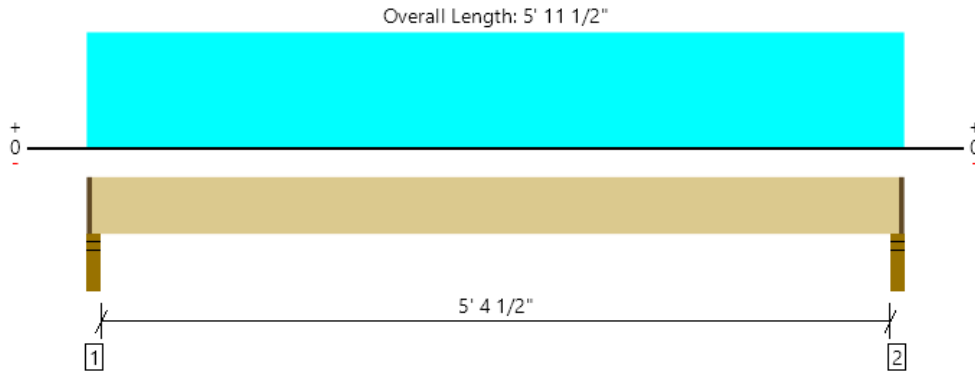

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	1832 @ 2"	3347 (2.25")	Passed (55%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	969 @ 1' 5 1/2"	9310	Passed (10%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	2521 @ 2' 11 3/4"	24258	Passed (10%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.005 @ 2' 11 3/4"	0.141	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.015 @ 2' 11 3/4"	0.281	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.50"	1236	661	1897	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.50"	1236	661	1897	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	5' 9" o/c	
Bottom Edge (Lu)	5' 9" o/c	

- Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Comments
0 - Self Weight (PLF)	1 1/4" to 5' 10 1/4"	N/A	14.3	--	
1 - Uniform (PLF)	0 to 5' 11 1/2" (Front)	N/A	100.0	-	Default Load
2 - Uniform (PSF)	0 to 5' 11 1/2" (Front)	1'	67.0	60.0	
3 - Uniform (PLF)	0 to 5' 11 1/2" (Front)	N/A	234.0	162.0	Linked from: M3, Support 1

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.eyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, LOADING AT NORTH END
2 piece(s) 2 x 4 DF No.1

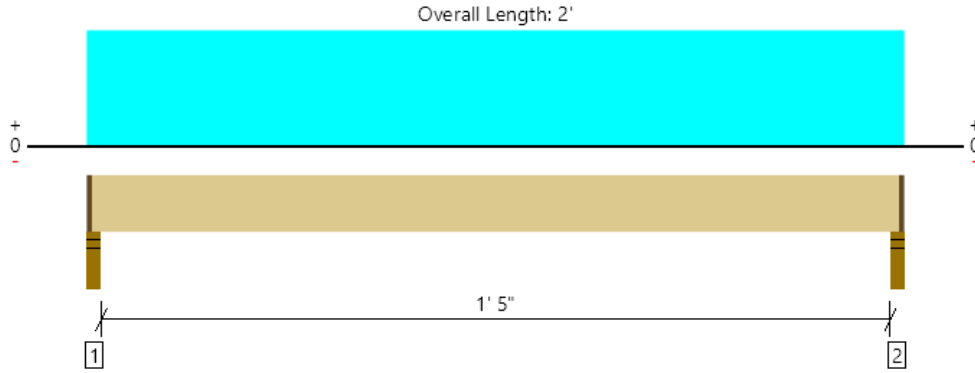

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	427 @ 2"	2869 (2.25")	Passed (15%)	--	1.0 D + 1.0 L (All Spans)
Shear (lbs)	199 @ 7"	1260	Passed (16%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	165 @ 1'	766	Passed (22%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.001 @ 1'	0.042	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.005 @ 1'	0.083	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)

System : Floor
Member Type : Flush Beam
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- Applicable calculations are based on NDS.

Supports	Bearing Length			Loads to Supports (lbs)				Accessories
	Total	Available	Required	Dead	Floor Live	Snow	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.50"	330	147	25	476	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.50"	330	147	25	476	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	1' 10" o/c	
Bottom Edge (Lu)	1' 10" o/c	

•Maximum allowable bracing intervals based on applied load.

Vertical Loads	Location (Side)	Tributary Width	Dead (0.90)	Floor Live (1.00)	Snow (1.15)	Comments
0 - Self Weight (PLF)	1 1/4" to 1' 10 3/4"	N/A	2.7	--	--	
1 - Uniform (PSF)	0 to 2' (Front)	8"	58.0	40.0	-	Default Load
2 - Uniform (PLF)	0 to 2' (Front)	N/A	200.0	-	-	
3 - Uniform (PSF)	0 to 2' (Front)	3'	25.0	40.0	-	
4 - Uniform (PSF)	0 to 2' (Front)	1'	13.5	-	25.0	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	




6/26/2023 10:37:46 PM UTC

ForteWEB v3.5, Engine: V8.2.5.1, Data: V8.1.3.6

63 of 144
File Name: Sam + June_revised 03_2023

Main Floor, m10
1 piece(s) 11 7/8" TJI @ 110 @ 16" OC

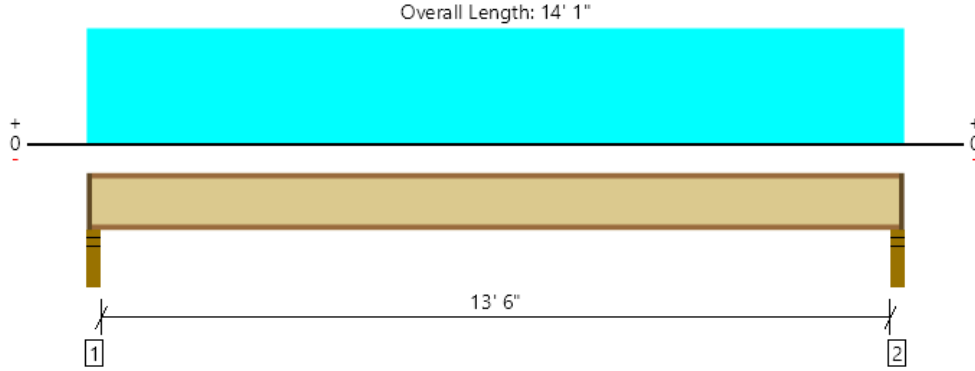

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	907 @ 2 1/2"	1041 (2.25")	Passed (87%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	882 @ 3 1/2"	1560	Passed (57%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	3051 @ 7' 1/2"	3160	Passed (97%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.147 @ 7' 1/2"	0.342	Passed (L/999+)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.360 @ 7' 1/2"	0.683	Passed (L/455)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	50	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	3.50"	2.25"	1.75"	545	376	920	1 1/4" Rim Board
2 - Stud wall - SPF	3.50"	2.25"	1.75"	545	376	920	1 1/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 1" o/c	
Bottom Edge (Lu)	13' 11" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 14' 1"	16"	58.0	40.0	Default Load

Weyerhaeuser Notes


Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



Main Floor, M11
1 piece(s) 11 7/8" TJI @ 110 @ 16" OC

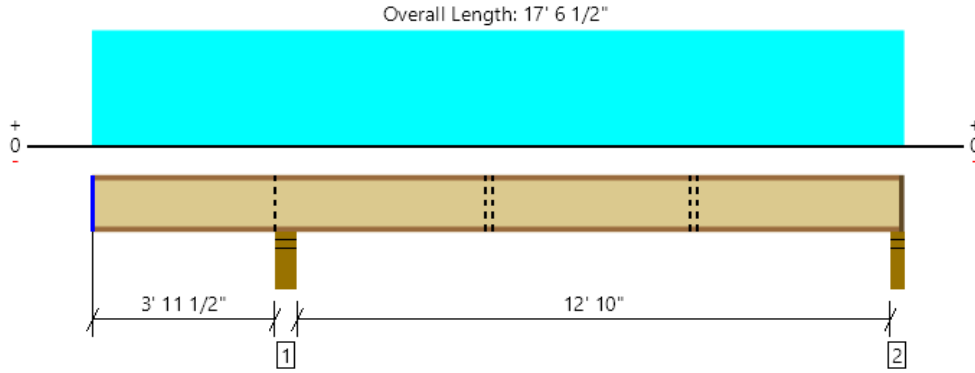

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	821 @ 17' 4"	1041 (2.25")	Passed (79%)	1.00	1.0 D + 1.0 L (Alt Spans)
Shear (lbs)	796 @ 17' 3"	1560	Passed (51%)	1.00	1.0 D + 1.0 L (Alt Spans)
Moment (Ft-lbs)	2494 @ 11' 1 7/8"	3160	Passed (79%)	1.00	1.0 D + 1.0 L (Alt Spans)
Live Load Defl. (in)	0.127 @ 10' 9 1/8"	0.329	Passed (L/999+)	--	1.0 D + 1.0 L (Alt Spans)
Total Load Defl. (in)	0.275 @ 10' 10 15/16"	0.657	Passed (L/574)	--	1.0 D + 1.0 L (Alt Spans)
TJ-Pro™ Rating	52	40	Passed	--	--

System : Floor
Member Type : Joist
Building Use : Residential
Building Code : IBC 2018
Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Overhang deflection criteria: LL (2L/480) and TL (2L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.
- Permanent bracing at third points in the back span or a direct applied ceiling over the entire back span length is required at the left span of the member. See literature detail (PB1) For clarification.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Factored	
1 - Stud wall - SPF	5.50"	5.50"	3.50"	884	609	1493	Blocking
2 - Stud wall - SPF	3.50"	2.25"	1.75"	473	362/-30	835	1 1/4" Rim Board

- Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.
- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	3' 6" o/c	
Bottom Edge (Lu)	5' 4" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 17' 6 1/2"	16"	58.0	40.0	Default Load

Location Analysis	Shear (lbs)			Moment (Ft-lbs)			Deflection (in)		Comments
	Actual	Allowed	LDF	Actual	Allowed	LDF	Live Load	Total	
1 - 0	0	1560	1.00	0	2844	0.90	-0.109	-0.175	

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Julie Smith Lubke Smith Lubke Structural Design (206) 852-1536 julie@smithlubke.com	



WOOD COMBINED AXIAL AND FLEXURAL STRESSES

L =	6.00 ft	d =	17.25 in
F _c =	1.700 ksi	b =	3.5 in (braced dimension for le/d)
F _b =	1.350 ksi	I =	1497.11 in ⁴
E =	1.90E+06 psi	A =	60.375 in ²
E _{min} =	6.90E+05 psi	S =	173.58 in ³

Bending

C _d =	1.00		
C _m =	1.00		
C _t =	1.00		
C _f =	1.00		
C _{fu} =	1.00		
C _r =	1.15		
C _i =	1.00		
F _b * =	1.553	(w/out CL)	
l _u =	6.00 ft	laterally unbraced	
l _u /d =	4.17		
l _e =	95.76	see table 3.3.3	
R _b	11.612		
F _{be}	16908		
F _{be} /F _b * =	10.891		
CL =	0.995		
F _b =	1.545 ksi		
M _a =	22.344 k-ft		
F _c E ₁ =	50680		
M =	13.52 k-ft		
f _b =	0.93 ksi		
f _b /F _b	0.61		
f _c /F _c e ₁ =	0.00		
Bend SR	0.61	NDS equation 3.9-3	
Total S.R.	0.61		

compare EI of 4x16 DF#1 to 4x18 select structural

	EI	
4x16 DF #1	1757800	
4x18 Select Struct.	2844300	
stiffness increase	162%	



Code Check

- No Calc
- > 1.0
- 90-1.0
- 75-90
- 50-75
- 0-.50



Envelope Only Solution

		SK - 1
		Jan 17, 2023 at 11:07 AM
	steel beam line, west side below upper floor	all window beams.r2d



Company :
 Designer :
 Job Number :
 Model Name :

Jan 17, 2023

Checked By: _____

Member Primary Data

	Label	I Joint	J Joint	Rotate(d...	Section/Sh...	Type	Design List	Material	Design Ru...
1	M1	N1	N2		W8x67	Beam	Wide Flange	A572 Gr.50	Typical
2	M2	N2	N3		W8x67	Beam	Wide Flange	A572 Gr.50	Typical
3	M3	N3	N4		W10x77	Beam	Wide Flange	A572 Gr.50	Typical
4	M4	N4	N5		W10x77	Beam	Wide Flange	A572 Gr.50	Typical
5	M5	N5	N6		W10x77	Beam	Wide Flange	A572 Gr.50	Typical

Member Point Loads (BLC 1 : dead)

	Member Label	Direction	Magnitude[k,k-ft]	Location[ft. %]
1	M1	Y	-1.003	1.25
2	M1	Y	-1.424	3.25
3	M2	Y	-1.851	1
4	M2	Y	-1.851	3
5	M2	Y	-1.152	5
6	M2	Y	-1.47	7
7	M3	Y	-1.47	1
8	M3	Y	-1.47	3
9	M3	Y	-1.47	5
10	M3	Y	-1.47	7
11	M4	Y	-1.47	1
12	M4	Y	-1.152	3
13	M4	Y	-1.152	5
14	M4	Y	-1.152	7
15	M5	Y	-1.152	1.25
16	M5	Y	-1.152	3.25
17	M5	Y	-1.593	5.25
18	M5	Y	-1.593	7.25

Member Point Loads (BLC 2 : live)

	Member Label	Direction	Magnitude[k,k-ft]	Location[ft. %]
1	M1	Y	-1.362	1
2	M2	Y	-1.362	3
3	M2	Y	-1.362	5
4	M2	Y	-2.335	7
5	M3	Y	-2.335	1
6	M3	Y	-2.335	3
7	M3	Y	-2.335	5
8	M3	Y	-2.335	7
9	M4	Y	-2.335	1
10	M4	Y	-1.362	3
11	M4	Y	-1.362	5
12	M4	Y	-1.362	7
13	M5	Y	-1.362	1.25
14	M5	Y	-1.362	3.25
15	M5	Y	-1.362	5.25
16	M5	Y	-1.362	7.25

Member Point Loads (BLC 3 : snow)

	Member Label	Direction	Magnitude[k,k-ft]	Location[ft. %]
1	M1	Y	-.627	1.25
2	M1	Y	-.89	3.25
3	M2	Y	-1.094	1
4	M2	Y	-1.094	3
5	M2	Y	-.642	5



Company :
 Designer :
 Job Number :
 Model Name :

Jan 17, 2023

Checked By: _____

Member Point Loads (BLC 3 : snow) (Continued)

	Member Label	Direction	Magnitude[k,k-ft]	Location[ft, %]
6	M2	Y	-1.238	7
7	M3	Y	-1.238	1
8	M3	Y	-1.238	3
9	M3	Y	-1.238	5
10	M3	Y	-1.238	7
11	M4	Y	-1.238	1
12	M4	Y	-.642	3
13	M4	Y	-.642	5
14	M4	Y	-.642	7
15	M5	Y	-.642	1.25
16	M5	Y	-.642	3.25
17	M5	Y	-1.47	5.25
18	M5	Y	-1.47	7.25

Envelope Member Section Forces

	Member	Sec		Axial[k]	LC	Shear[k]	LC	Moment[k-ft]	LC
1	M1	1	max	0	1	0	1	0	1
2			min	0	1	0	1	0	1
3		2	max	0	1	0	1	.085	30
4			min	0	1	-1.362	2	0	1
5		3	max	0	1	-.602	25	2.438	7
6			min	0	1	-2.495	7	.527	25
7		4	max	0	1	-.602	25	5.089	7
8			min	0	1	-2.495	7	1.166	25
9		5	max	0	1	-1.362	30	9.831	7
10			min	0	1	-4.586	7	2.66	25
11	M2	1	max	0	1	7.389	7	9.831	7
12			min	0	1	2.207	30	2.66	25
13		2	max	0	1	4.717	7	.012	30
14			min	0	1	1.257	25	-2.509	4
15		3	max	0	1	1.09	2	-2.369	25
16			min	0	1	.147	25	-8.017	7
17		4	max	0	1	-.447	29	-1.971	25
18			min	0	1	-1.631	7	-7.411	7
19		5	max	0	1	-1.427	25	0	1
20			min	0	1	-5.78	7	0	1
21	M3	1	max	0	1	8.3	7	0	1
22			min	0	1	1.764	25	0	1
23		2	max	0	1	4.15	7	-2.646	25
24			min	0	1	.882	25	-12.449	7
25		3	max	0	1	0	1	-3.528	25
26			min	0	1	0	1	-16.599	7
27		4	max	0	1	-.882	25	-2.646	25
28			min	0	1	-4.15	7	-12.449	7
29		5	max	0	1	-1.764	25	0	1
30			min	0	1	-8.3	7	0	1
31	M4	1	max	0	1	12.287	7	0	1
32			min	0	1	3.01	25	0	1
33		2	max	0	1	8.137	7	-5.005	25
34			min	0	1	2.096	29	-19.915	7
35		3	max	0	1	5.482	7	-8.523	25
36			min	0	1	1.437	25	-33.358	7
37		4	max	0	1	2.827	7	-10.744	25
38			min	0	1	.745	25	-41.822	7
39		5	max	0	1	.26	4	-11.67	25

Envelope Member Section Forces (Continued)

Member	Sec		Axial[k]	LC	Shear[k]	LC	Moment[k-ft]	LC
40		min	0	1	-0.061	30	-45.308	7
41	M5	max	0	1	.26	4	-11.67	25
42		min	0	1	-.061	30	-45.308	7
43		max	0	1	-.472	29	-11.22	25
44		min	0	1	-2.484	2	-43.506	7
45		max	0	1	-1.114	29	-9.302	25
46		min	0	1	-5.138	7	-36.062	7
47		max	0	1	-2.284	25	-5.666	25
48		min	0	1	-8.855	7	-21.98	7
49		max	0	1	-3.24	25	0	1
50		min	0	1	-12.572	7	0	1

Envelope Member Section Deflections

Member	Sec		x [in]	LC	y [in]	LC	L/y Ratio	LC
1	M1	max	0	1	0	1	NC	1
2		min	0	1	-.007	30	7685.876	30
3		max	0	1	0	4	NC	4
4		min	0	1	-.004	30	NC	30
5		max	0	1	0	4	NC	4
6		min	0	1	-.002	30	NC	30
7		max	0	1	.001	4	NC	4
8		min	0	1	0	30	NC	30
9		max	0	1	0	1	NC	1
10		min	0	1	0	1	NC	1
11	M2	max	0	1	0	1	NC	1
12		min	0	1	0	1	NC	1
13		max	0	1	-.002	30	NC	30
14		min	0	1	-.008	7	NC	7
15		max	0	1	-.004	25	NC	25
16		min	0	1	-.013	7	7113.266	7
17		max	0	1	-.003	25	NC	25
18		min	0	1	-.011	7	9012.912	7
19		max	0	1	0	1	NC	1
20		min	0	1	0	1	NC	1
21	M3	max	0	1	0	1	NC	1
22		min	0	1	0	1	NC	1
23		max	0	1	-.003	25	NC	25
24		min	0	1	-.013	7	7247.201	7
25		max	0	1	-.004	25	NC	25
26		min	0	1	-.019	7	5170.26	7
27		max	0	1	-.003	25	NC	25
28		min	0	1	-.013	7	7247.201	7
29		max	0	1	0	1	NC	1
30		min	0	1	0	1	NC	1
31	M4	max	0	1	0	1	NC	1
32		min	0	1	0	1	NC	1
33		max	0	1	-.02	25	NC	25
34		min	0	1	-.079	7	3627.804	7
35		max	0	1	-.037	25	9292.906	25
36		min	0	1	-.145	7	2372.795	7
37		max	0	1	-.049	25	NC	25
38		min	0	1	-.192	7	2872.115	7
39		max	0	1	-.055	25	NC	25
40		min	0	1	-.212	7	NC	7
41	M5	max	0	1	-.055	25	NC	25

Envelope Member Section Deflections (Continued)

Member	Sec		x [in]	LC	y [in]	LC	L/y Ratio	LC
42		min	0	1	-0.212	7	NC	7
43	2	max	0	1	-0.051	25	9894.186	25
44		min	0	1	-0.198	7	2551.679	7
45	3	max	0	1	-0.04	25	8083.118	25
46		min	0	1	-0.154	7	2084.641	7
47	4	max	0	1	-0.022	25	NC	25
48		min	0	1	-0.084	7	3165.441	7
49	5	max	0	1	0	1	NC	1
50		min	0	1	0	1	NC	1

Envelope Joint Reactions



	Joint		X [k]	LC	Y [k]	LC	Moment [k-ft]	LC
1	N2	max	0	1	11.975	7	0	1
2		min	0	1	3.569	30	0	1
3	N3	max	0	1	14.08	7	0	1
4		min	0	1	3.191	25	0	1
5	N4	max	0	1	20.586	7	0	1
6		min	0	1	4.774	25	0	1
7	N6	max	0	1	12.572	7	0	1
8		min	0	1	3.24	25	0	1
9	Totals:	max	0	1	59.213	7		
10		min	0	1	15.028	25		

ASCE 7 Hazards Report

Address:
3064 68th Ave SE
Mercer Island, Washington
98040

Standard: ASCE/SEI 7-16
Risk Category: II
Soil Class: D - Stiff Soil

Elevation: 135.67 ft (NAVD 88)
Latitude: 47.582269
Longitude: -122.247248

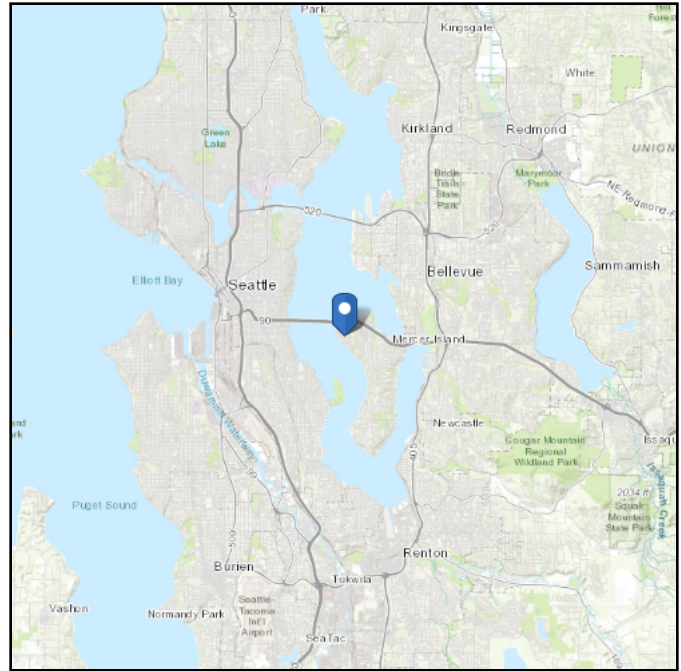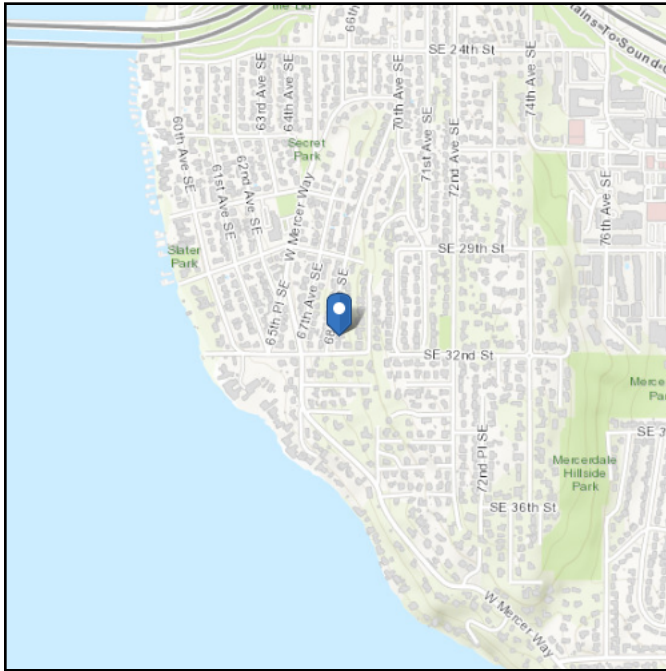

Wind

Results:

Wind Speed	98 Vmph
10-year MRI	67 Vmph
25-year MRI	74 Vmph
50-year MRI	78 Vmph
100-year MRI	83 Vmph

Data Source: ASCE/SEI 7-16, Fig. 26.5-1B and Figs. CC.2-1–CC.2-4, and Section 26.5.2
Date Accessed: Tue Nov 01 2022

Value provided is 3-second gust wind speeds at 33 ft above ground for Exposure C Category, based on linear interpolation between contours. Wind speeds are interpolated in accordance with the 7-16 Standard. Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (annual exceedance probability = 0.00143, MRI = 700 years).

Site is not in a hurricane-prone region as defined in ASCE/SEI 7-16 Section 26.2.

Site Soil Class: D - Stiff Soil

Results:

S_s :	1.408	S_{D1} :	N/A
S_1 :	0.49	T_L :	6
F_a :	1	PGA :	0.603
F_v :	N/A	PGA _M :	0.663
S_{MS} :	1.408	F_{PGA} :	1.1
S_{M1} :	N/A	I_e :	1
S_{DS} :	0.939	C_v :	1.382

Ground motion hazard analysis may be required. See ASCE/SEI 7-16 Section 11.4.8.

Data Accessed: Tue Nov 01 2022

Date Source: [USGS Seismic Design Maps](#)

The ASCE 7 Hazard Tool is provided for your convenience, for informational purposes only, and is provided “as is” and without warranties of any kind. The location data included herein has been obtained from information developed, produced, and maintained by third party providers; or has been extrapolated from maps incorporated in the ASCE 7 standard. While ASCE has made every effort to use data obtained from reliable sources or methodologies, ASCE does not make any representations or warranties as to the accuracy, completeness, reliability, currency, or quality of any data provided herein. Any third-party links provided by this Tool should not be construed as an endorsement, affiliation, relationship, or sponsorship of such third-party content by or from ASCE.

ASCE does not intend, nor should anyone interpret, the results provided by this Tool to replace the sound judgment of a competent professional, having knowledge and experience in the appropriate field(s) of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the contents of this Tool or the ASCE 7 standard.

In using this Tool, you expressly assume all risks associated with your use. Under no circumstances shall ASCE or its officers, directors, employees, members, affiliates, or agents be liable to you or any other person for any direct, indirect, special, incidental, or consequential damages arising from or related to your use of, or reliance on, the Tool or any information obtained therein. To the fullest extent permitted by law, you agree to release and hold harmless ASCE from any and all liability of any nature arising out of or resulting from any use of data provided by the ASCE 7 Hazard Tool.

SEISMIC DESIGN

ASCE 7-16

Equivalent Lateral Force Procedure

Risk Category	II	Table 1.5-1
Seismic Design Category	D	More severe, Table 11.6-1 or Table 11.6-2*
Importance Factor	1.00	Table 1.5-2
Site Class	D	Table 20.3-1
S _s	140.80 %g	(from USGS Seismic Hazard Curves)
S ₁	49.00 %g	(from USGS Seismic Hazard Curves)
F _a	1.00	Table 11.4-1
F _v	1.80	Table 11.4-2
C _t	0.02	Table 12.8-2
X	0.75	Table 12.8-2
h _n	30.10 feet	(height to highest level)
S _{M5} = F _a *S _s	1.4080	Eq. 11.4-1
S _{M1} = F _v *S ₁	0.8820	Eq. 11.4-2
S _{DS} = (2/3)*S _{M5}	0.9387 g	Eq. 11.4-3
S _{D1} = (2/3)*S _{M1}	0.5880 g	Eq. 11.4-4
Period T _a = C _t *h _n ^{0.75}	0.2570 s	Eq. 12.8-7
T _o	0.1253 s	Eq. 11.4-5
T _s	0.6264 s	Eq. 11.4-6
1.5T _s	0.9396	
T _L	6.0000	per figure 22-14
S _a	0.9387 g	Eq. 11.4-7
R	6.5	Table 12.2-1
Ω _o	3	Table 12.2-1
C _d	4	Table 12.2-1
Section 12.6 ok?	Yes	Table 12.6-1

Site Class	D
Is T <= 1.5T _s	yes - use eq. 12.8-2
Ground Motion Hazard Analysis Required?	no, exception 2 section 11.4.8

Equivalent Lateral Force Procedure (section 12.8)

C _s	0.1444	Eq. 12.8-2
W, weight	218,767 lb	per table below
Q _E	31,592 lb	Eq. 12.8-1

Vertical Force Distribution (section 12.8.3)

k = 1.00

Level	Hx (ft)	Floor Area (ft ²)	Floor Wt. (psf)	Floor Wt. (k)	Wall Length (ft)	Wall Wt. (k)	Total Wt. (k)	WxHx (k-ft)	Cvx (%)	(LRFD) Q _E (k)	(ASD) 0.7Q _E (k)
roof west	33.00	593	13.5	8.0	102	5.1	13.1	432.5	13.1	4.15	2.91
roof bridge	28.58	153	13.5	2.1	36	1.8	3.9	110.5	3.4	1.06	0.74
roof east	24.33	792	13.5	10.7	116	5.8	16.5	401.3	12.2	3.85	2.70
upper west floor	21.33	805	40	32.2	129	19.4	51.6	1101.2	33.5	10.58	7.40
upper bridge	15.75	157	25	3.9	36	4.5	8.4	132.7	4.0	1.27	0.89
upper east	11.83	794	25	19.9	116	14.5	34.4	406.4	12.4	3.90	2.73
west main	7.75	1288	58	74.7	128	16.2	90.9	704.5	21.4	6.77	4.74
							218.8	3288.9	100.0	31.59	22.11

Wind Design

Asce7-16

Envelope Procedure, Part 2: Enclosed Simple Diaphragm Low Rise Buildings

$$p_s = \lambda K_{zt} p_{s30}$$

Risk Category = **II**
 ATC Council Wind Load = **98**
 Exposure (26.7) = **C**
 λ (adjustment factor) = **1.40**
 K_{zt} (topographic factor) = **1.00**

$$p_s = \mathbf{1.40} p_{s30}$$

Partial Figure 28.6-1

Adjustment Factor for Building Height and Exposure, λ

Mean Roof	Exposure		
	B	C	D
15	1.00	1.21	1.47
20	1.00	1.29	1.55
25	1.00	1.35	1.61
30	1.00	1.40	1.66
35	1.00	1.45	1.70

Partial Figure 28.6-1

Simplified Design Wind Pressure, p_{s30} (psf)

Basic Wind Speed	Roof Angle	Roof Pitch	Horizontal Pressures			
			A (end wall)	B (end roof)	C (wall)	D (roof)
98	0 to 5	flat	14.9	-7.7	9.9	-4.6
	10	2	16.8	-7.0	11.2	-4.1
	15	3	18.8	-6.2	12.5	-3.6
	20	4	20.7	-5.4	13.8	-3.0
	25	6	18.8	3.0	13.6	3.1
	30 to 45	7 to 12	16.8	11.5	13.4	9.2

ASD Design Wind Pressures, p_s

Basic Wind Speed	Roof Angle	Roof Pitch	Horizontal Pressures			
			A (end wall)	B (end roof)	C (wall)	D (roof)
98	0 to 5	flat	12.5	-6.5	8.3	-3.9
	10	0	14.1	-5.9	9.4	-3.4
	15	3	15.8	-5.2	10.5	-3.0
	20	4	17.4	-4.5	11.6	-2.5
	25	6	15.8	2.5	11.4	2.6
	30 to 45	7 to 12	14.1	9.7	11.3	7.7

<= Use this row

End Zone Computation (Figure 28.6-1, footnote 9)

Least horizontal dimension (W_L)= **36.0** ft


Mean roof height (H) = **30.0** ft

a => 0.1 W_L 3.60
 0.4H 12.00
 0.04 W_L 1.44
 >= 3' 3.00

a = 3.6 ft
 End Zone (2a) = **7.2** ft

WIND TRIB: 7.5'

SAM + JUNE
LATERAL DISTRIBUTION
LOWER FLOOR

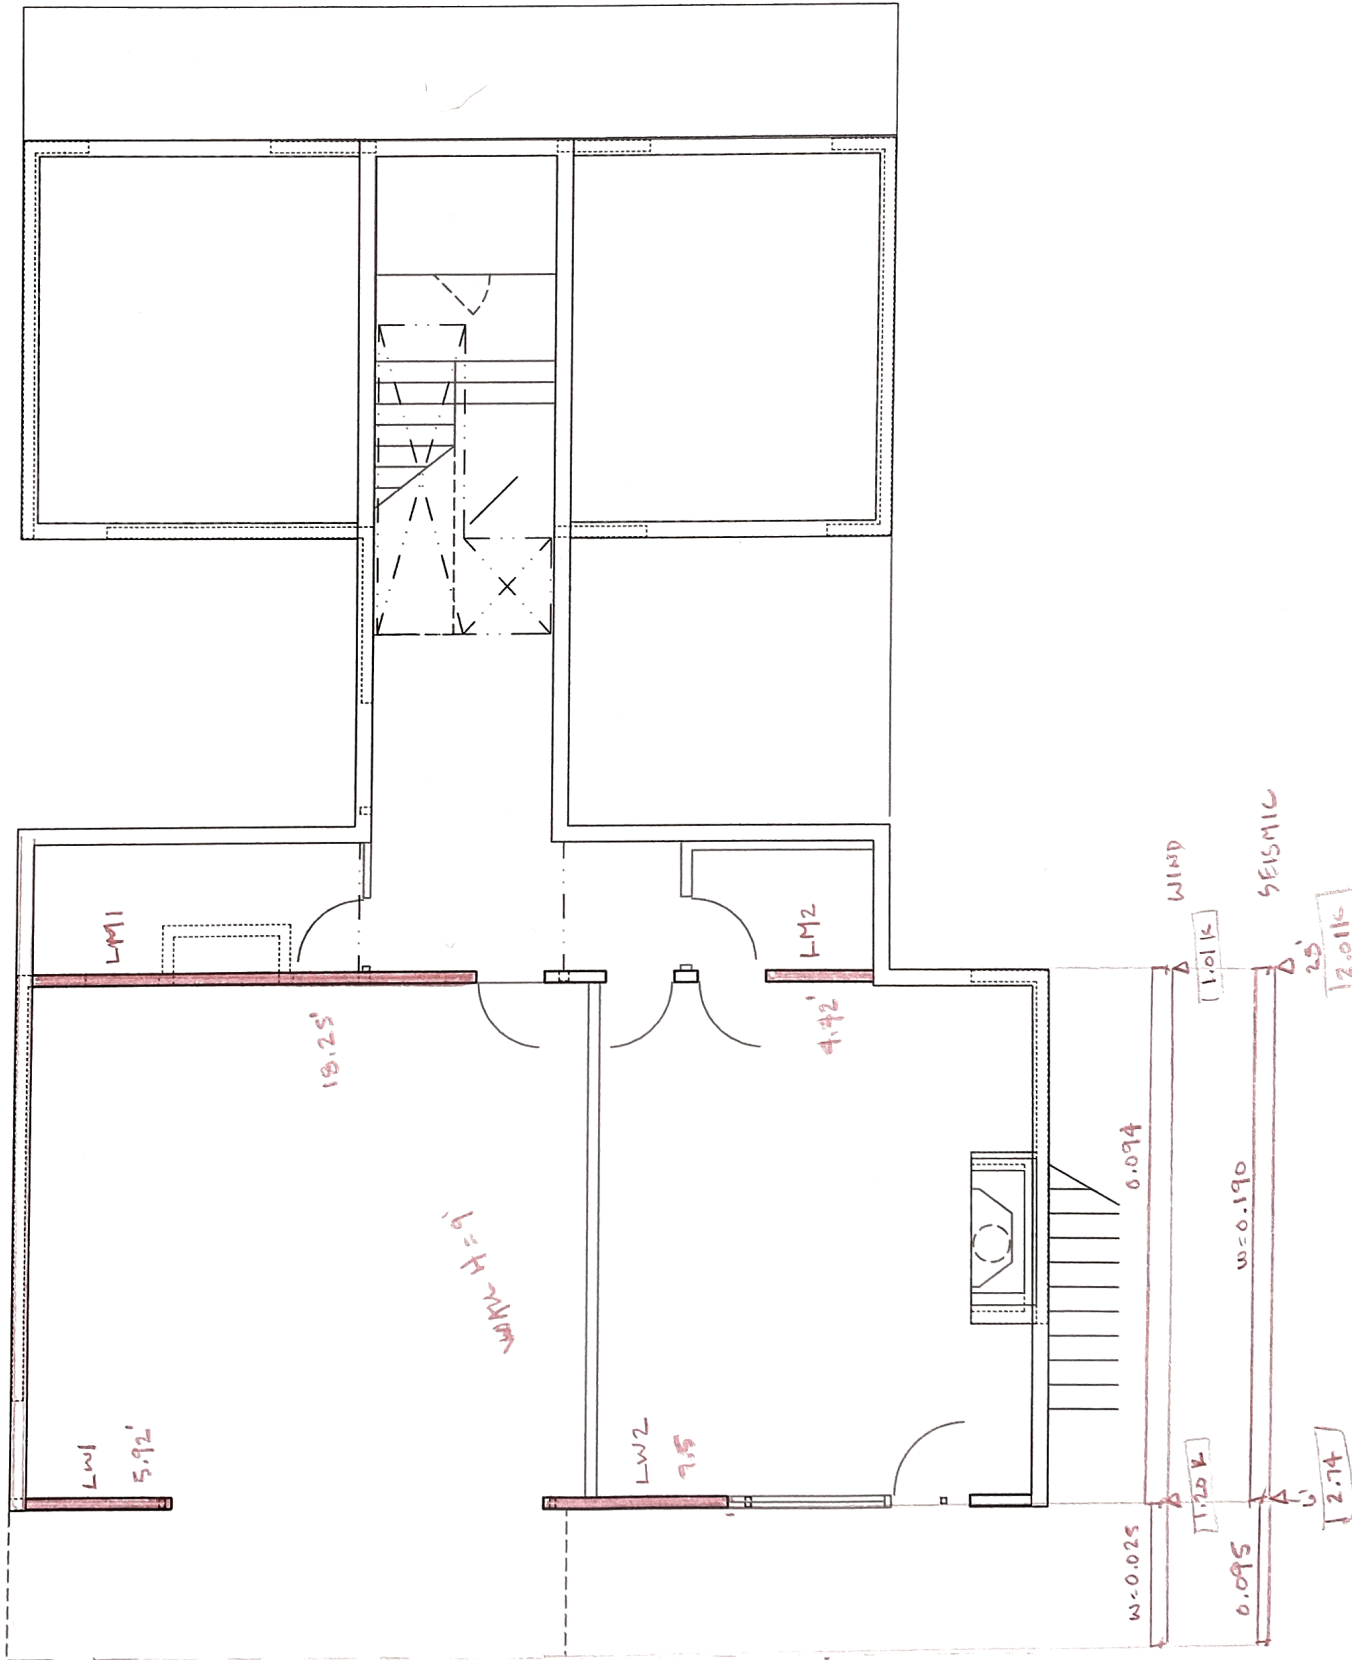

Sam + June - lateral force distribution
SEISMIC (governs)

max shearwall aspect ratio w/out reduction = 2.0
max shearwall aspect ratio with reduction = 3.5

Shearwall Schedule

SW1	241 lbs/ft	(CDX-HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 6"OC)
SW2	353 lbs/ft	(CDX-HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 4"OC)
SW3	595 lbs/ft	(CDX-HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 2"OC)
SW4	1190 lbs/ft	(DOUBLE SIDED CDX-HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 2"OC)

WALLS BELOW ROOF

	E (lb)	V (above)	V (total)	V (ft)	L (ft)	h (ft)	Aspect ratio	Aspect reduct.	rho	(rho)/V (plf)	SW	M.of (lbf)	M.of (above)	M.of (total)	OT (lb)	TL1 (lb)	TL2 (lb)	I1 (lb)	I2 (lb)	HD1/HD2	C1 (lb)	C2 (lb)	POST
UN1	1830	0	1830	16.50	10.00	10.00	0.61	1.00	1.00	111	SW1	18300	0	18300	1109	0	890	547	360	NONE	1109	1999	(2)2x6
UN2	1720	0	1720	21.83	10.00	10.00	0.46	1.00	1.00	79	SW1	17200	0	17200	788	0	0	45	45	NONE	788	788	(2)2x6
US1	1010	0	1010	8.00	10.00	10.00	1.25	1.00	1.00	126	SW1	10097	0	10097	1262	0	0	990	990	CSHP20	1262	1262	(2)2x6
US2	820	0	820	6.50	10.00	10.00	1.54	1.00	1.00	126	SW1	8203	0	8203	1262	0	0	1041	1041	CSHP20	1262	1262	(2)2x6
US3	1720	0	1720	21.92	10.00	10.00	0.46	1.00	1.00	78	SW1	17200	0	17200	785	0	0	38	38	NONE	785	785	(2)2x6
UW1	1460	0	1460	8.83	10.00	10.00	1.13	1.00	1.00	165	SW1	14600	0	14600	1653	520	2720	970	507	SHP20/NONE	2173	4373	(2)2x6
UM1	716	0	716	4.50	10.00	10.00	2.22	0.90	1.00	159	SW1	7161	0	7161	1591	2330	890	893	1196	CSHP20	3921	2481	(2)2x6
UM2	1114	0	1114	7.00	10.00	10.00	1.43	1.00	1.00	159	SW1	11139	0	11139	1591	490	2330	1165	778	SHP20/NONE	2081	3921	(2)2x6
UM3	654	0	654	3.58	10.00	10.00	2.79	0.72	1.00	183	SW1	6544	0	6544	1828	3080	790	1058	1540	CS16	4908	2618	(2)2x6
UM4	1066	0	1066	5.83	10.00	10.00	1.72	1.00	1.00	183	SW1	10656	0	10656	1828	720	3080	1478	981	CS16	2548	4908	(2)2x6
UE1	809	0	809	13.83	10.00	10.00	0.72	1.00	1.00	58	SW1	8089	0	8089	585	0	0	-418	-418	NONE	585	585	(2)2x6
UE2	541	0	541	9.25	10.00	10.00	1.08	1.00	2.00	58	SW2	5411	1	5412	585	0	0	-86	-86	NONE	585	585	(2)2x7

Sam + June - lateral force distribution
SEISMIC (governs)

max shearwall aspect ratio w/out reduction = 2.0
max shearwall aspect ratio with reduction = 3.5
WALLS BELOW UPPER FLOOR

Shearwall Schedule

SW1 241 lbs/ft (CDX,HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 6"OC)
SW2 353 lbs/ft (CDX,HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 4"OC)

	$\frac{F}{(lb)}$	$\frac{V}{(above)}$	$\frac{V}{(total)}$	$\frac{L}{(ft)}$	$\frac{h}{(ft)}$	Aspect ratio	Aspect reduct.	ρ	$\frac{\rho}{(plf)}$	SW	$\frac{M_{ot}}{(lbft)}$	$\frac{M_{ot}}{(above)}$	$\frac{M_{ot}}{(total)}$	OT (lb)	$\frac{TL_1}{(lb)}$	$\frac{TL_2}{(lb)}$	$\frac{I_1}{(lb)}$	$\frac{I_2}{(lb)}$	HD1/HD2	$\frac{C_1}{(lb)}$	$\frac{C_2}{(lb)}$	POST
MIN1	3980	1830	5810	17.42	12.50	0.72	1.00	1.00	334	SW2	72625	18300	90925	5220	670	690	3776	3771	HDU5	5890	5910	(3)/2x6
MIN2	1370	1720	3090	16.42	9.50	0.58	1.00	1.00	188	SW1	29355	#REF!	#REF!	#REF!	1400	3090	#REF!	#REF!	DTTZZ	#REF!	#REF!	(2)/2x6
MS1	5250	0	5250	14.42	12.00	0.83	1.00	1.00	364	SW3	63000	0	63000	4369	243	0	3373	3417	HDU5	4612	4369	(2)/2x6
MS2	1370	1720	3090	16.33	9.50	0.58	1.00	1.00	189	SW1	29355	17200	46555	2851	0	0	1870	1870	DTTZZ	2851	2851	(2)/2x6
MW1	5820	0	5820	6.33	12.50	1.97	1.00	1.30	1195	SW4	94575	0	94575	14941	11950	1160	10404	13524	STL COL	26891	16101	STL COL
MM1	2660	0	2660	2.00	12.50	6.25	N.G.	1.30	1729	SW4	43225	0	43225	21613	0	0	21538	21538	STL COL	21613	21613	STL COL
MM1	2660	0	2660	2.00	12.50	6.25	N.G.	1.30	1729	SW4	43225	0	43225	21613	0	0	21538	21538	STL COL	21613	21613	STL COL
MM2	740	1260	2000	10.50	9.50	0.90	1.00	1.00	191	SW1	19003	6544	25547	2433	4720	2500	676	1083	DTTZZ	7153	4933	(3)/(2)x6
MM3	270	460	730	3.83	9.50	2.48	0.81	1.00	191	SW1	6932	10656	17588	4592	3440	10600	3636	2324	HDU5	8032	15192	(3)/(5)2x6
ME1	1863	0	1863	4.33	9.50	2.19	0.91	1.30	559	SW3	23002	0	23002	5312	9150	6320	1102	1102	DTTZZ	14462	11632	(3) LSL 1-3/4x5.5
ME2	1647	0	1647	3.83	9.50	2.48	0.81	1.30	559	SW3	20346	0	20346	5312	6320	9560	1245	1245	DTTZZ	11632	14872	(3) LSL 1-3/4x5.5

WALLS BELOW MAIN FLOOR

	$\frac{F}{(lb)}$	$\frac{V}{(above)}$	$\frac{V}{(total)}$	$\frac{L}{(ft)}$	$\frac{h}{(ft)}$	Aspect ratio	Aspect reduct.	ρ	$\frac{\rho}{(plf)}$	SW	$\frac{M_{ot}}{(lbft)}$	$\frac{M_{ot}}{(above)}$	$\frac{M_{ot}}{(total)}$	OT (lb)	$\frac{TL_1}{(lb)}$	$\frac{TL_2}{(lb)}$	$\frac{I_1}{(lb)}$	$\frac{I_2}{(lb)}$	HD1/HD2	$\frac{C_1}{(lb)}$	$\frac{C_2}{(lb)}$	POST
LW1	1209	2567	3776	5.92	9.00	1.52	1.00	1.00	638	SW4	33985	94575	128560	21716	27130	0	11347	19738	STL COL	48846	21716	STL COL
LW2	1531	3253	4784	7.50	9.00	1.20	1.00	1.00	638	SW4	43055	0	43055	5741	17300	44630	-1697	-7956	NONE	23041	50371	STL COL
LM1	1618	4283	5901	18.25	9.00	0.49	1.00	1.00	323	SW4	53108	0	53108	2910	2640	0	-1220	-736	NONE	5550	2910	(2)/2x6
LM2	392	1037	1429	4.42	9.00	2.04	0.98	1.00	323	SW4	12862	0	12862	2910	0	2640	2027	1543	HDU5	2910	5550	(2)/2x6

Sam + June - lateral force distribution

wind

max shearwall aspect ratio w/out reduction = 3.5
 max shearwall aspect ratio with reduction = na

Shearwall Schedule

SW1 241 lbs/ft (CDX,HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 6"OC)
 SW2 353 lbs/ft (CDX,HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 4"OC)

WALLS BELOW ROOF

	$\frac{F}{(lb)}$	$\frac{V}{(above)}$	$\frac{V}{(total)}$	$\frac{L}{(ft)}$	$\frac{h}{(ft)}$	Aspect ratio	Aspect reduct.	$\frac{(rho)V}{(pif)}$	SW	$\frac{M.ot}{(lbft)}$	$\frac{M.ot}{(above)}$	$\frac{M.ot}{(total)}$	$\frac{O.T}{(lb)}$	$\frac{TL1}{(lb)}$	$\frac{TL2}{(lb)}$	$\frac{I1}{(lb)}$	$\frac{I2}{(lb)}$	HD1/HD2	$\frac{C1}{(lb)}$	$\frac{C2}{(lb)}$	POST
UN1	1350	0	1350	16.50	10.00	0.61	1.00	82	SW1	13500	0	13500	818	0	890	256	69		818	1708	(2)2x6
UN2	1350	0	1350	21.83	10.00	0.46	1.00	62	SW1	13500	0	13500	618	0	0	-125	-125		618	618	(2)2x6
US1	745	0	745	8.00	10.00	1.25	1.00	93	SW1	7448	0	7448	931	0	0	659	659		931	931	(2)2x6
US2	605	0	605	6.50	10.00	1.54	1.00	93	SW1	6052	0	6052	931	0	0	710	710		931	931	(2)2x6
US3	1350	0	1350	21.92	10.00	0.46	1.00	62	SW1	13500	0	13500	616	0	0	-131	-131		616	616	(2)2x6
UW1	780	0	780	8.83	10.00	1.13	1.00	88	SW1	7800	0	7800	883	520	2720	200	-263		1403	3603	(2)2x6
UM1	520	0	520	4.50	10.00	2.22	1.00	116	SW1	5204	0	5204	1157	2330	890	458	761		3487	2047	(2)2x6
UM2	810	0	810	7.00	10.00	1.43	1.00	116	SW1	8096	0	8096	1157	490	2330	730	343		1647	3487	(2)2x6
UM3	559	0	559	3.58	10.00	2.79	1.00	156	SW1	5593	0	5593	1562	3080	790	792	1274		4642	2352	(2)2x6
UM4	911	0	911	5.83	10.00	1.72	1.00	156	SW1	9107	0	9107	1562	720	3080	1212	716		2282	4642	(2)2x6
UE1	910	0	910	13.83	10.00	0.72	1.00	66	SW1	9100	0	9100	658	0	0	-345	-345		658	658	(2)2x6

Sam + June - lateral force distribution

wind

max shearwall aspect ratio w/out reduction = 3.5

max shearwall aspect ratio with reduction = na

Shearwall Schedule

SW1 241 lbs/ft (CDX,HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 6"OC)
SW2 353 lbs/ft (CDX,HEM-FIR,15/32" SHEATHING, 1-1/2" NAIL PEN., 8D @ 4"OC)

	E (lb)	V (above)	V (total)	L (ft)	h (ft)	h aspect ratio	Aspect reduct.	(rho)/v (pif)	SW	M _{ot} (lbft)	M _{ot} (above)	M _{ot} (total)	OI (lb)	IL1 (lb)	IL2 (lb)	I1 (lb)	I2 (lb)	HD1/HD2	C1 (lb)	C2 POST (lb)
MN1	2790	1350	4140	17.42	12.00	0.69	1.00	238	SW1	49680	13500	63180	3627	670	690	2209	2205		4297	4317 (3)2x6
MN2	2790	1350	4140	16.42	9.50	0.58	1.00	252	SW1	39330	#REF!	#REF!	#REF!	1400	3090	#REF!	#REF!		#REF!	#REF! (2)2x6
MS1	3430	0	3430	14.42	12.00	0.83	1.00	238	SW1	41160	0	41160	2854	243	0	1858	1903		3097	2854 (2)2x6
MS2	2790	1350	4140	16.33	9.50	0.58	1.00	254	SW1	39330	13500	52830	3235	0	0	2255	2255		3235	3235 (2)2x6
MW1	2220	0	2220	6.33	12.50	1.97	1.00	351	SW2	27750	0	27750	4384	11950	1160	-153	2967		16334	5544 (2)2x6
MM1	3830	0	3830	5.25	12.50	2.38	1.00	730	SW2	47875	0	47875	9119	0	0	8922	8922		9119	9119 (2)2x6
MM2	1348	1077	2425	10.50	9.50	0.90	1.00	231	SW1	23041	5593	28633	2727	2500	4720	1377	970		5227	7447 (2)2x6
MM3	492	393	885	3.83	9.50	2.48	1.00	231	SW1	8404	9107	17512	4572	3440	10600	3616	2304		8012	15172 (2)2x6
ME1	1518	990	2508	4.33	9.50	2.19	1.00	579	SW1	23822	0	23822	5502	9150	6320	1292	1292		14652	11822 (2)2x6
ME2	1342	990	2332	3.83	9.50	2.48	1.00	609	SW1	22158	0	22158	5785	6320	9560	1718	1718		12105	15345 (2)2x6

WALLS BELOW MAIN FLOOR

	E (lb)	V (above)	V (total)	L (ft)	h (ft)	h aspect ratio	Aspect reduct.	(rho)/v (pif)	SW	M _{ot} (lbft)	M _{ot} (above)	M _{ot} (total)	OI (lb)	IL1 (lb)	IL2 (lb)	I1 (lb)	I2 (lb)	HD1/HD2	C1 (lb)	C2 POST (lb)
LW1	529	980	1510	5.92	9.00	1.52	1.00	255	SW1	13586	27750	41336	6982	27130	0	-3387	5004		34112	6982 (3)2x6
LW2	671	1242	1912	7.50	9.00	1.20	1.00	255	SW1	17212	0	17212	2295	17300	44630	-5143	-11402		19595	46925 (3)2x6
LM1	813	3083	3896	18.25	9.00	0.49	1.00	213	SW1	35067	0	35067	1921	2640	0	-2209	-1725		4561	1921 (2)2x6
LM2	197	747	944	4.42	9.00	2.04	1.00	213	SW1	8493	0	8493	1921	0	2640	1038	554		1921	4561 (2)2x6

SAM + JUNE


PARAPET

C+G, ZONE S $A_{eff} = 10$; $P_{net} 30 = 24.1$

$$\lambda = 1.40$$

$$P_{net} = 24.1 \cdot 1.40 = 33.74$$

$$ASD \ P_{net} = 0.6 \cdot 33.74 = 20.24$$

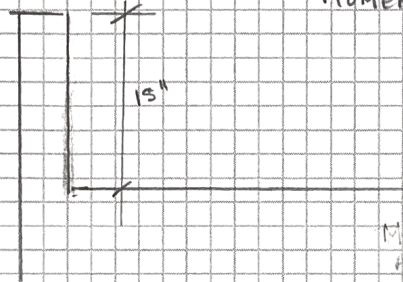

PARAPET
MOMENT $(20.24 \text{ PSF} \cdot 15/12) \cdot 15/2/12 =$

$$= 25.3 \text{ PLF} \cdot 7.5/12$$

$$= 15.81 \text{ KFE/ft}$$

$$31.63 \text{ KFE} / 2 \text{ FE}$$

MOMENT
ARM $126.5 \text{ KFE} / 8 \text{ FE}$

MOMENT
ARM $12'' \cdot 126.5 / 8 \text{ FE}$

$$T = C \ 126.5 \text{ K}$$

Project Title:
Engineer:
Project ID:
Project Descr:

Building Code Information

Project File: SamJuneWalls.ec6

LIC# : KW-06018769, Build:20.22.12.28

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2022

Governing Code : IBC 2018, ASCE 7-16, CBC 2019, AISC 360-16, NDS 2018, ACI 318-14, TMS 402-16

City Jurisdiction : Mercer Island

Contact Name : Julie Lubke

Alternate Contact :

Building Official :

Address : , , ;

Phone : 206-852-1536

Fax :

eMail : julie@smithlubke.com

Notes :

Project Title: Sam + June Residence
Engineer:
Project ID:
Project Descr:

Project Information

Project File: SamJuneWalls.ec6

LIC# : KW-06018769, Build:20.22.12.28

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2022

Project Title : Sam + June Residence

Description :

I.D. :

Address : , ,

Project Leader :

Phone :

Fax :

eMail :

Project Notes

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	9.50 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

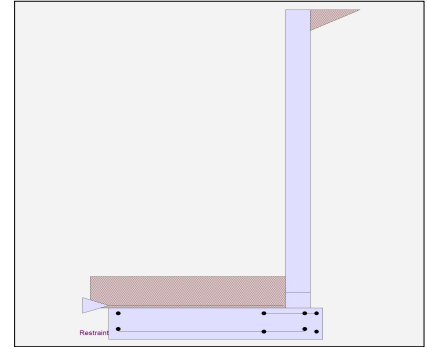

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0 psf
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	0.0 lbs
Axial Live Load	=	0.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

Design Summary

Wall Stability Ratios

Overturning	=	1.59	OK
Slab Resists All Sliding !			
Global Stability	=	1.11	
Total Bearing Load	=	2,731 lbs	
...resultant ecc.	=	16.89 in	
Eccentricity outside middle third			
Soil Pressure @ Toe	=	1,241 psf	OK
Soil Pressure @ Heel	=	0 psf	OK
Allowable	=	3,000 psf	
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	1,737 psf	
ACI Factored @ Heel	=	0 psf	
Footing Shear @ Toe	=	22.2 psi	OK
Footing Shear @ Heel	=	4.7 psi	OK
Allowable	=	82.2 psi	

Sliding Calcs

Lateral Sliding Force	=	1,929.4 lbs
-----------------------	---	-------------

Vertical component of active lateral soil pressure IS
 NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

		2nd	Bottom			
Design Height Above Ftg	ft =	Stem OK	Ratio > 1.0			
Wall Material Above "Ht"	=	Concrete	Concrete			
Design Method	=	SD	SD	SD	SD	SD
Thickness	=	8.00	8.00			
Rebar Size	=	# 4	# 4			
Rebar Spacing	=	9.00	9.00			
Rebar Placed at	=	Edge	Edge			
Design Data						
fb/FB + fa/Fa	=	0.946	1.113			
Total Force @ Section						
Service Level	lbs =					
Strength Level	lbs =	2,268.0	2,527.0			
Moment....Actual						
Service Level	ft-# =					
Strength Level	ft-# =	6,804.0	8,002.2			
Moment.....Allowable	ft-# =	7,185.3	7,185.3			
Shear.....Actual						
Service Level	psi =					
Strength Level	psi =	30.2	33.7			
Shear.....Allowable	psi =	82.2	82.2			
Anet (Masonry)	in2 =					
Wall Weight	psf =	100.0	100.0			
Rebar Depth 'd'	in =	6.25	6.25			

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0	3,000.0
Fy	psi =	60,000.0	60,000.0

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC#: KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
2nd Stem		
As (based on applied moment) :	0.2549 in2/ft	
(4/3) * As :	0.3399 in2/ft	Min Stem T&S Reinf Area 1.728 in2
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.2549 in2/ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.2667 in2/ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in #6@ 55.00 in

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
Bottom Stem		
As (based on applied moment) :	0.2998 in2/ft	
(4/3) * As :	0.3997 in2/ft	Min Stem T&S Reinf Area 0.096 in2
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.2998 in2/ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.2667 in2/ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in #6@ 55.00 in

Footing Data

Toe Width	=	4.75 ft
Heel Width	=	1.00
Total Footing Width	=	5.75
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c =	3,000 psi	Fy = 60,000 psi
Footing Concrete Density	=	150.00 pcf
Min. As %	=	0.0018
Cover @ Top	2.00	@ Btm = 3.00 in

Footing Design Results

	<u>Toe</u>	<u>Heel</u>	
Factored Pressure	=	1,737	0 psf
Mu' : Upward	=	12,550	0 ft-#
Mu' : Downward	=	3,723	89 ft-#
Mu: Design	=	8,827 OK	89 ft-# OK
phiMn	=	30,739	24,231 ft-#
Actual 1-Way Shear	=	22.17	4.69 psi
Allow 1-Way Shear	=	82.16	82.16 psi
Toe Reinforcing	=	# 6 @ 6.00 in	
Heel Reinforcing	=	# 7 @ 12.00 in	
Key Reinforcing	=	None Spec'd	
Footing Torsion, Tu	=		0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=		0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 7.50 in, #5@ 11.63 in, #6@ 16.51 in, #7@ 22.52 in, #8@ 29.65 in, #9@ 37.53 in, #10@ 47.67 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area 1.49 in2
 Min footing T&S reinf Area per foot 0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	1,929.4	3.50	6,752.8	Soil Over HL (ab. water tbl)	395.8	5.58	2,210.1
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		5.58	2,210.1
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =			
Added Lateral Load =				* Axial Live Load on Stem =			
Load @ Stem Above Soil =				Soil Over Toe =	522.5	2.38	1,240.9
				Surcharge Over Toe =			
				Stem Weight(s) =	950.0	5.08	4,829.2
				Earth @ Stem Transitions =			
Total	= 1,929.4	O.T.M.	= 6,752.8	Footing Weight =	862.5	2.88	2,479.7
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		=	1.59	Total =	2,730.8 lbs	R.M.=	10,759.9
Vertical Loads used for Soil Pressure =		2,730.8	lbs	* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.057 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

Rebar Lap & Embedment Lengths Information

Stem Design Segment: 2nd

Stem Design Height: 0.50 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in
Development length for #4 bar specified in this stem design segment = 13.15 in

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in
Development length for #4 bar specified in this stem design segment = 13.15 in

Hooked embedment length into footing for #4 bar specified in this stem design segment = 7.67 in
As Provided = 0.2667 in²/ft
As Required = 0.2998 in²/ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

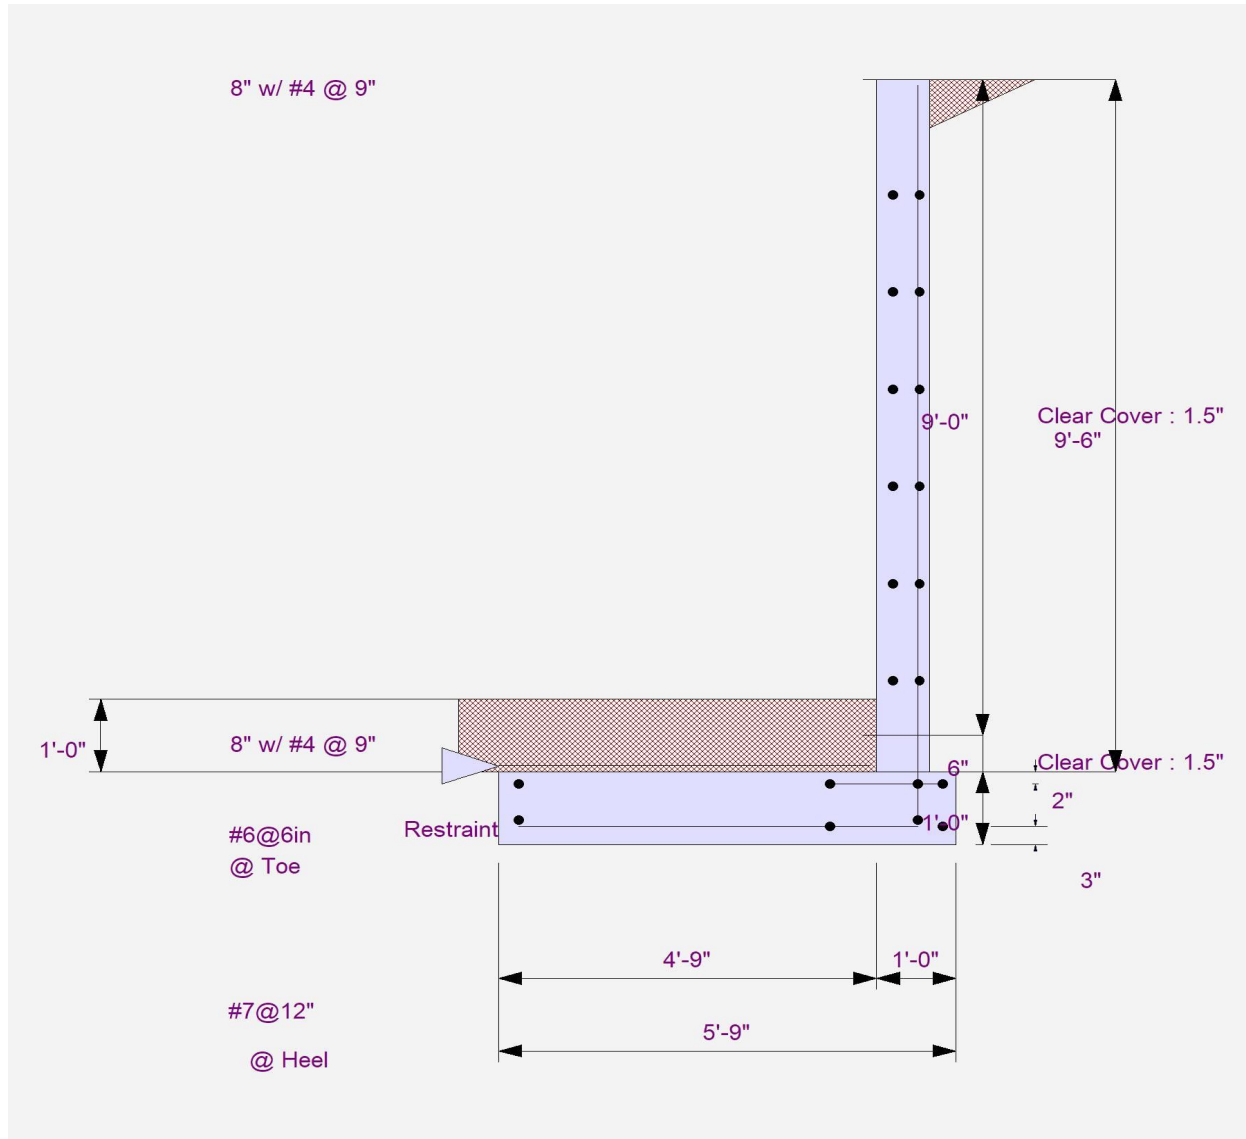

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 9.5 CANT (11/S3.0)

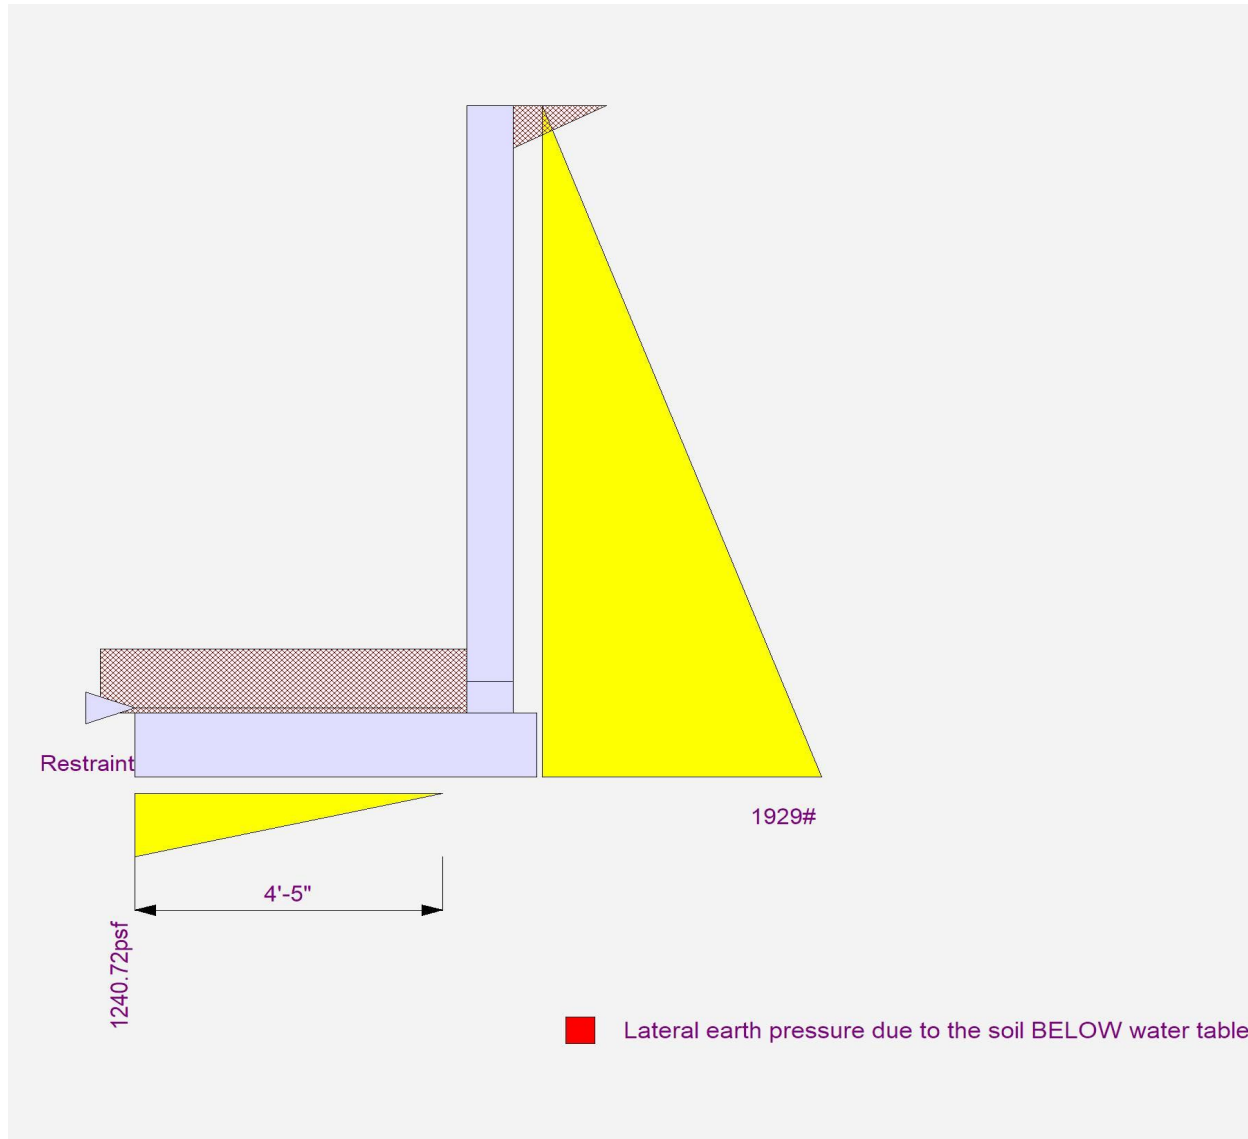

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	11.00 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

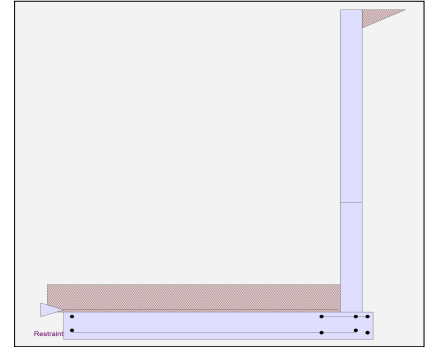

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0 psf
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	500.0 lbs
Axial Live Load	=	0.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

Design Summary

Wall Stability Ratios

Overturning	=	2.89	OK
Slab Resists All Sliding !			
Global Stability	=	15.85	
Total Bearing Load = 4,418 lbs			
...resultant ecc.	=	5.20 in	
Eccentricity within middle third			
Soil Pressure @ Toe	=	592 psf	OK
Soil Pressure @ Heel	=	338 psf	OK
Allowable	=	3,000 psf	
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	829 psf	
ACI Factored @ Heel	=	473 psf	
Footing Shear @ Toe	=	23.2 psi	OK
Footing Shear @ Heel	=	3.9 psi	OK
Allowable	=	82.2 psi	

Sliding Calcs

Lateral Sliding Force	=	2,520.0 lbs
-----------------------	---	-------------

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

		2nd	Bottom			
Design Height Above Ftg	ft =	Stem OK	Stem OK			
Wall Material Above "Ht"	=	4.00	0.00			
Design Method	=	Concrete	Concrete			
Thickness	=	SD	SD	SD	SD	SD
Rebar Size	=	8.00	8.00			
Rebar Spacing	=	# 4	# 6			
Rebar Placed at	=	12.00	9.00			
	=	Edge	Edge			
Design Data						
fb/FB + fa/Fa	=	0.587	0.953			
Total Force @ Section						
Service Level	lbs =					
Strength Level	lbs =	1,372.0	3,388.0			
Moment....Actual						
Service Level	ft-# =					
Strength Level	ft-# =	3,201.3	12,422.7			
Moment.....Allowable	ft-# =	5,448.0	13,022.4			
Shear.....Actual						
Service Level	psi =					
Strength Level	psi =	18.3	50.2			
Shear.....Allowable	psi =	82.2	75.0			
Anet (Masonry)	in2 =					
Wall Weight	psf =	100.0	100.0			
Rebar Depth 'd'	in =	6.25	5.63			

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0	2,500.0
Fy	psi =	60,000.0	60,000.0

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC#: KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
2nd Stem		
As (based on applied moment) :	0.1199 in2/ft	
(4/3) * As :	0.1599 in2/ft	Min Stem T&S Reinf Area 1.344 in2
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.1728 in2/ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.2 in2/ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in #6@ 55.00 in

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
Bottom Stem		
As (based on applied moment) :	0.5203 in2/ft	
(4/3) * As :	0.6937 in2/ft	Min Stem T&S Reinf Area 0.768 in2
200bd/fy : 200(12)(5.625)/60000 :	0.225 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.5203 in2/ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.5867 in2/ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	0.762 in2/ft	#6@ 27.50 in #6@ 55.00 in

Footing Data

Toe Width	=	8.50 ft
Heel Width	=	1.00
Total Footing Width	=	9.50
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c =	3,000 psi	Fy = 60,000 psi
Footing Concrete Density	=	150.00 pcf
Min. As %	=	0.0018
Cover @ Top	2.00	@ Btm = 3.00 in

Footing Design Results

	<u>Toe</u>	<u>Heel</u>	
Factored Pressure	=	829	473 psf
Mu' : Upward	=	26,118	27 ft-#
Mu' : Downward	=	11,921	102 ft-#
Mu: Design	=	14,197 OK	75 ft-# OK
phiMn	=	30,739	24,231 ft-#
Actual 1-Way Shear	=	23.16	3.95 psi
Allow 1-Way Shear	=	82.16	82.16 psi
Toe Reinforcing	=	# 6 @ 6.00 in	
Heel Reinforcing	=	# 7 @ 12.00 in	
Key Reinforcing	=	None Spec'd	
Footing Torsion, Tu	=		0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=		0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 6.22 in, #5@ 9.64 in, #6@ 13.69 in, #7@ 18.67 in, #8@ 24.58 in, #9@ 31.11 in, #10@ 39.52 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area 2.46 in2
 Min footing T&S reinf Area per foot 0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	2,520.0	4.00	10,080.0	Soil Over HL (ab. water tbl)	458.3	9.33	4,277.8
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		9.33	4,277.8
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	500.0	8.83	4,416.7
Added Lateral Load =				* Axial Live Load on Stem =			
Load @ Stem Above Soil =				Soil Over Toe =	935.0	4.25	3,973.8
				Surcharge Over Toe =			
				Stem Weight(s) =	1,100.0	8.83	9,716.7
				Earth @ Stem Transitions =			
Total	= 2,520.0	O.T.M. =	10,080.0	Footing Weight =	1,425.0	4.75	6,768.8
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		= 2.89		Total =	4,418.3 lbs	R.M.=	29,153.6
Vertical Loads used for Soil Pressure =		4,418.3 lbs		* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.019 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

Rebar Lap & Embedment Lengths Information

Stem Design Segment: 2nd

Stem Design Height: 4.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in
Development length for #4 bar specified in this stem design segment = 13.15 in

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #6 bar specified in this stem design segment (25.4.2.3a) = 28.08 in
Development length for #6 bar specified in this stem design segment = 21.60 in

Hooked embedment length into footing for #6 bar specified in this stem design segment = 10.20 in
As Provided = 0.5867 in²/ft
As Required = 0.5203 in²/ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

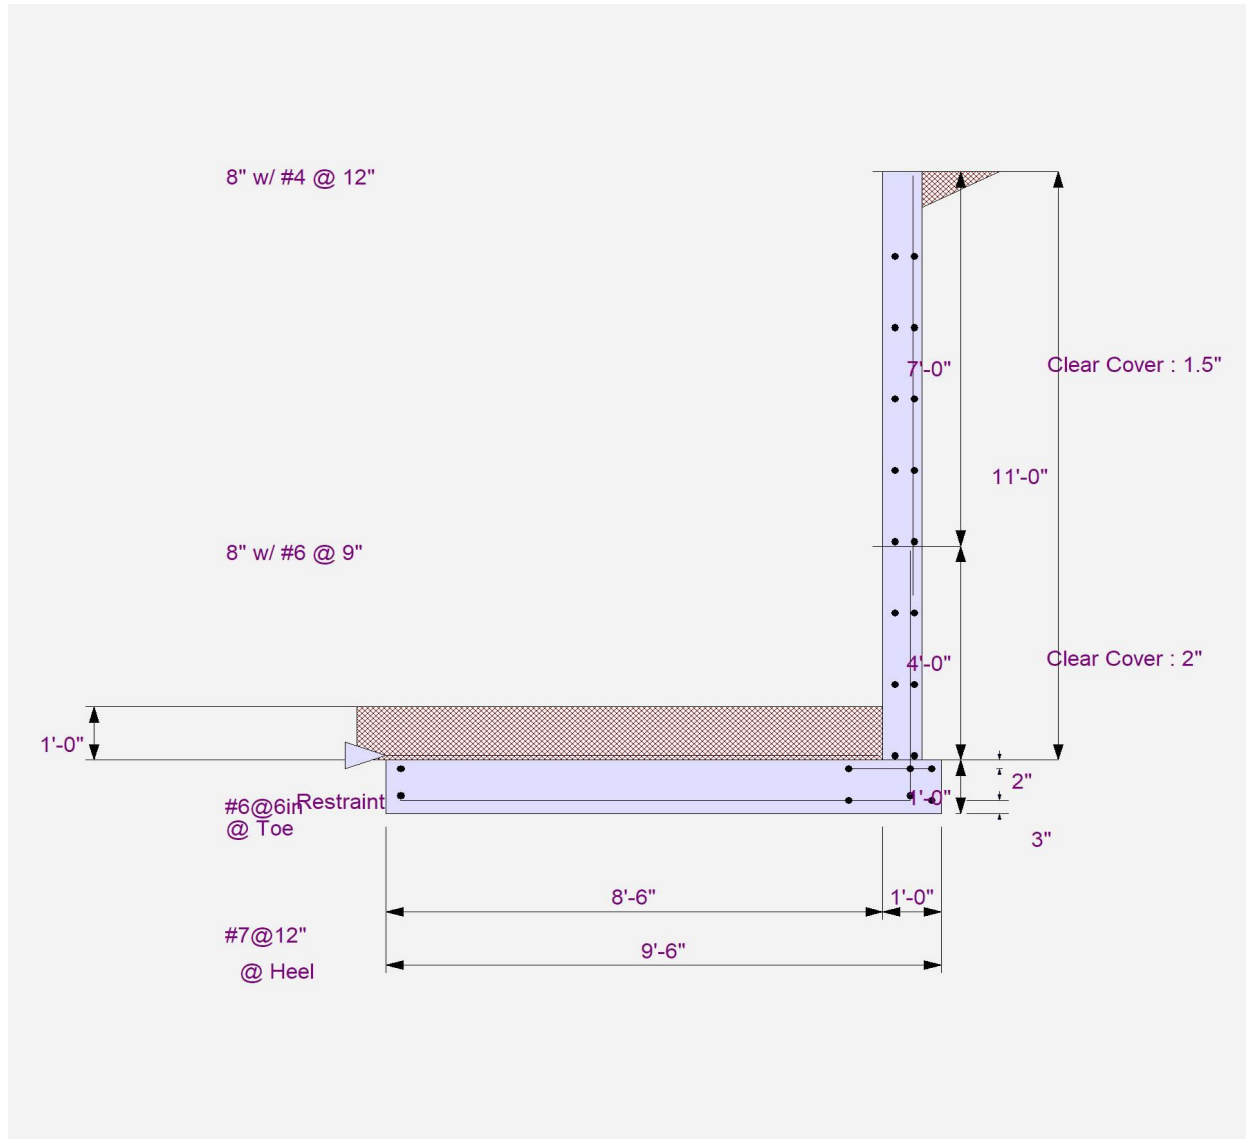

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - AT TUNNEL

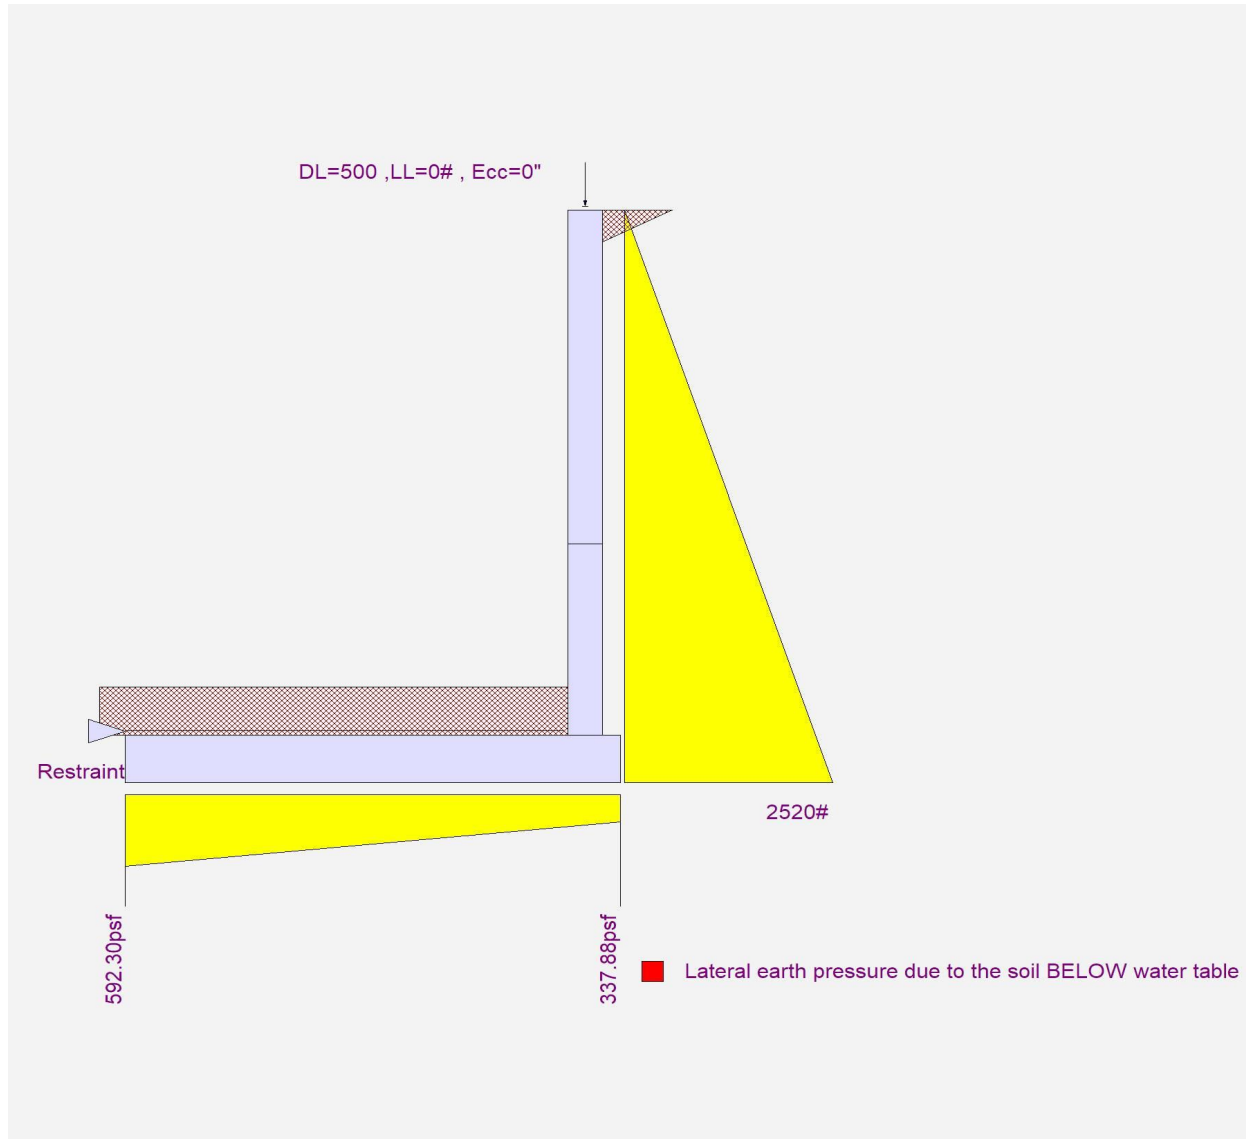

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	6.00 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

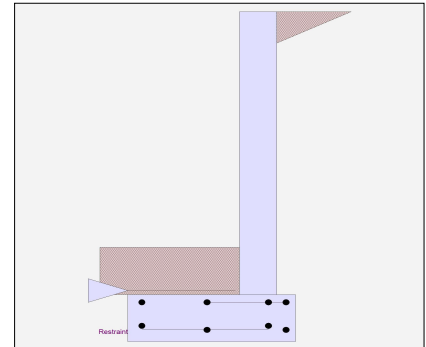

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	409.0 lbs
Axial Live Load	=	282.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

Design Summary

Wall Stability Ratios

Overturning	=	1.98	OK
Slab Resists All Sliding !			
Global Stability	=	1.83	
Total Bearing Load	=	2,211 lbs	
...resultant ecc.	=	3.81 in	
Eccentricity within middle third			
Soil Pressure @ Toe	=	1,205 psf	OK
Soil Pressure @ Heel	=	269 psf	OK
Allowable	=	3,000 psf	
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	1,687 psf	
ACI Factored @ Heel	=	377 psf	
Footing Shear @ Toe	=	13.0 psi	OK
Footing Shear @ Heel	=	1.8 psi	OK
Allowable	=	82.2 psi	

Sliding Calcs

Lateral Sliding Force	=	857.5 lbs
-----------------------	---	-----------

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

Design Height Above Ftg

ft =	Stem OK	0.00
Wall Material Above "Ht"	=	Concrete
Design Method	=	SD
Thickness	=	8.00
Rebar Size	=	# 4
Rebar Spacing	=	12.00
Rebar Placed at	=	Edge

Design Data

fb/FB + fa/Fa	=	0.370
---------------	---	-------

Total Force @ Section

Service Level	lbs =	
Strength Level	lbs =	1,008.0

Moment....Actual

Service Level	ft-# =	
Strength Level	ft-# =	2,016.0

Moment.....Allowable	=	5,448.0
----------------------	---	---------

Shear.....Actual

Service Level	psi =	
Strength Level	psi =	13.4

Shear.....Allowable	psi =	82.2
---------------------	-------	------

Anet (Masonry)	in2 =	
----------------	-------	--

Wall Weight	psf =	100.0
-------------	-------	-------

Rebar Depth 'd'	in =	6.25
-----------------	------	------

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0
Fy	psi =	60,000.0

Bottom

SD SD SD SD SD

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>	
Bottom Stem			
As (based on applied moment) :	0.0755 in2/ft		
(4/3) * As :	0.1007 in2/ft	Min Stem T&S Reinf Area 1.152 in2	
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft	
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :	
	=====	<u>One layer of :</u> <u>Two layers of :</u>	
Required Area :	0.1728 in2/ft	#4@ 12.50 in	#4@ 25.00 in
Provided Area :	0.2 in2/ft	#5@ 19.38 in	#5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in	#6@ 55.00 in

Footing Data

Toe Width	=	2.00 ft
Heel Width	=	1.00
Total Footing Width	=	3.00
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c = 3,000 psi	Fy = 60,000 psi	
Footing Concrete Density = 150.00 pcf		
Min. As % = 0.0018		
Cover @ Top 2.00	@ Btm= 3.00 in	

Footing Design Results

	<u>Toe</u>	<u>Heel</u>	
Factored Pressure	= 1,687	377 psf	
Mu' : Upward	= 2,791	24 ft-#	
Mu' : Downward	= 660	60 ft-#	
Mu: Design	= 2,131 OK	36 ft-#	OK
phiMn	= 30,739	24,231 ft-#	
Actual 1-Way Shear	= 12.98	1.84 psi	
Allow 1-Way Shear	= 82.16	82.16 psi	
Toe Reinforcing	= # 6 @ 6.00 in		
Heel Reinforcing	= # 7 @ 12.00 in		
Key Reinforcing	= None Spec'd		
Footing Torsion, Tu	=	0.00 ft-lbs	
Footing Allow. Torsion, phi Tu	=	0.00 ft-lbs	

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area	0.78 in2
Min footing T&S reinf Area per foot	0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	857.5	2.33	2,000.8	Soil Over HL (ab. water tbl)	250.0	2.83	708.3
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		2.83	708.3
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	409.0	2.33	954.3
Added Lateral Load =				* Axial Live Load on Stem =	282.0	2.33	658.0
Load @ Stem Above Soil =				Soil Over Toe =	220.0	1.00	220.0
				Surcharge Over Toe =			
				Stem Weight(s) =	600.0	2.33	1,400.0
				Earth @ Stem Transitions =			
Total	= 857.5	O.T.M.	= 2,000.8	Footing Weight =	450.0	1.50	675.0
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		=	1.98	Total =	1,929.0 lbs	R.M.=	3,957.7
Vertical Loads used for Soil Pressure =		2,211.0	lbs	* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.067 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

Rebar Lap & Embedment Lengths Information

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in

Development length for #4 bar specified in this stem design segment = 13.15 in

Hooked embedment length into footing for #4 bar specified in this stem design segment = 6.63 in

As Provided = 0.2000 in²/ft

As Required = 0.1728 in²/ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

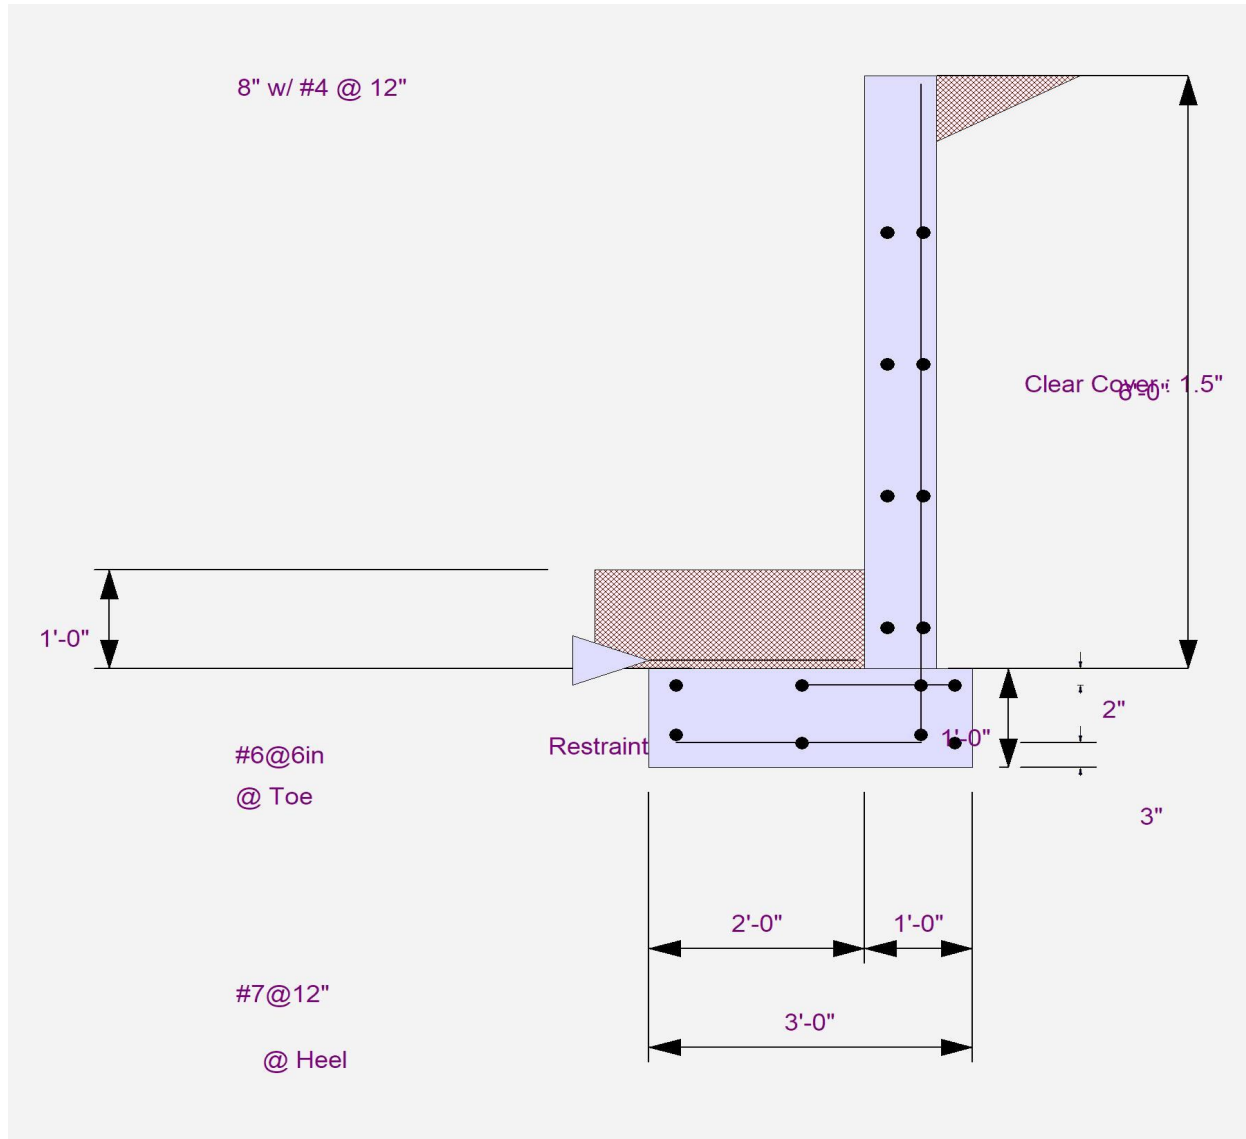

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 6.0' CANT

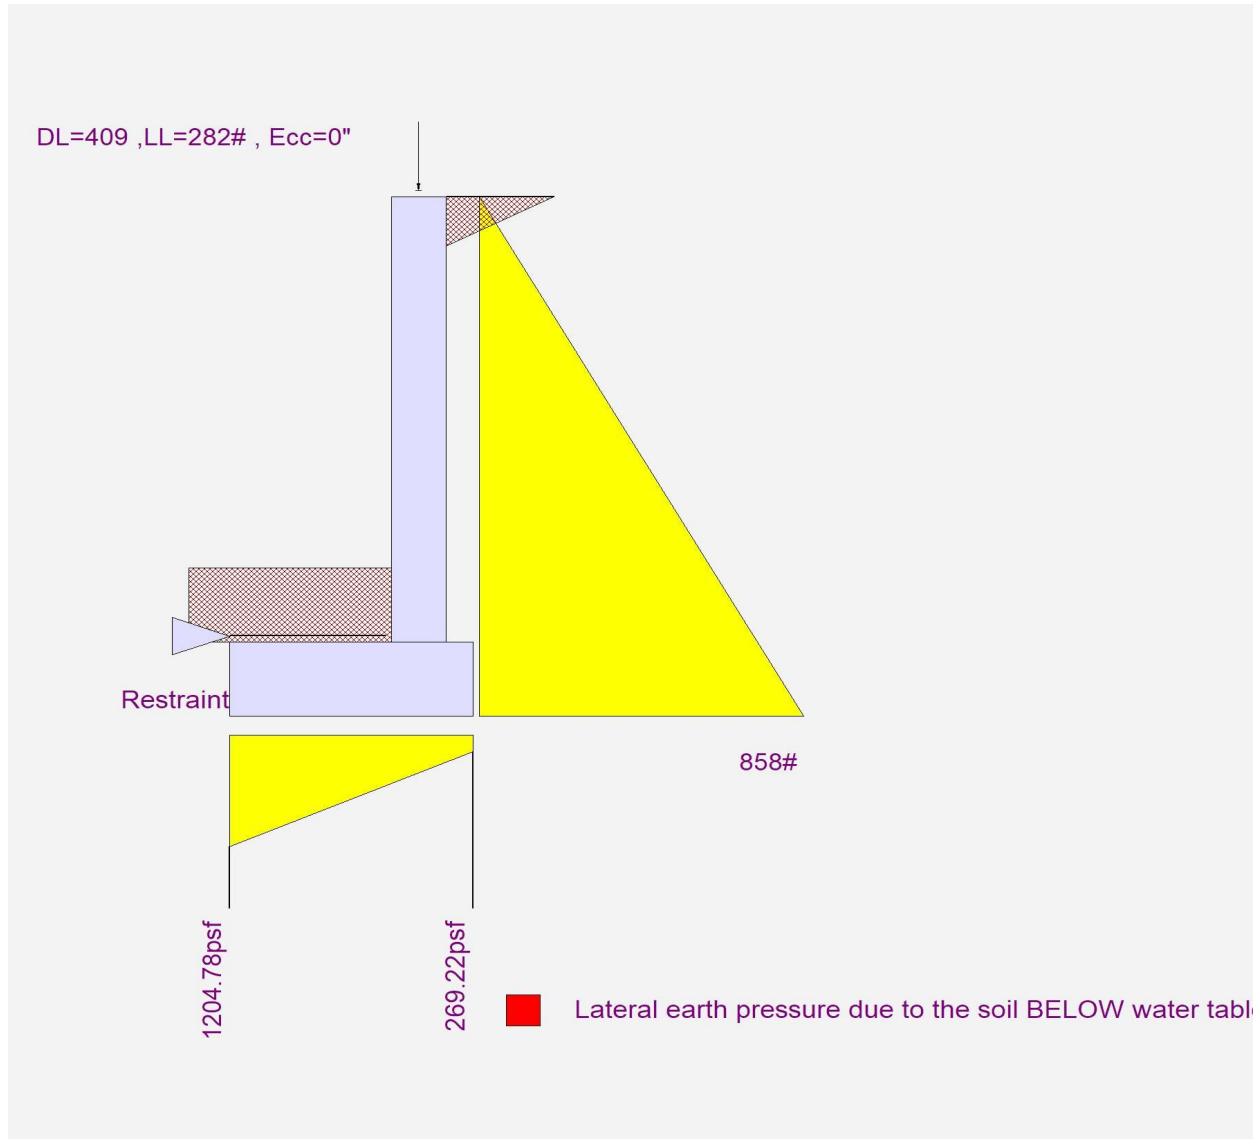

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	11.00 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.350
Soil height to ignore for passive pressure	=	12.00 in

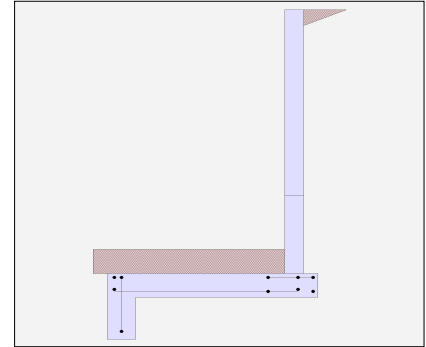

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0 psf
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	266.0 lbs
Axial Live Load	=	238.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

Design Summary

Wall Stability Ratios

Overtuning	=	2.02	OK
Sliding	=	1.48	Ratio < 1.5!
Global Stability	=	1.05	
Total Bearing Load = 4,355 lbs			
...resultant ecc.	=	11.94	in
Eccentricity within middle third			
Soil Pressure @ Toe	=	1,060	psf OK
Soil Pressure @ Heel	=	115	psf OK
Allowable	=	3,000	psf
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	1,484	psf
ACI Factored @ Heel	=	160	psf
Footing Shear @ Toe	=	33.1	psi OK
Footing Shear @ Heel	=	7.1	psi OK
Allowable	=	82.2	psi

Sliding Calcs

Lateral Sliding Force	=	2,520.0	lbs
less 100% Passive Force	=	2,285.9	lbs
less 100% Friction Force	=	1,440.8	lbs
Added Force Req'd	=	0.0	lbs OK
...for 1.5 Stability	=	53.3	lbs NG

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

Design Height Above Ftg

ft =

Wall Material Above "Ht" =

Design Method =

Thickness =

Rebar Size =

Rebar Spacing =

Rebar Placed at =

Design Data

fb/FB + fa/Fa =

Total Force @ Section

Service Level lbs =

Strength Level lbs =

Moment....Actual

Service Level ft-# =

Strength Level ft-# =

Moment.....Allowable ft-# =

Shear.....Actual

Service Level psi =

Strength Level psi =

Shear.....Allowable psi =

Anet (Masonry) in2 =

Wall Weight psf =

Rebar Depth 'd' in =

Masonry Data

f'm psi =

Fs psi =

Solid Grouting =

Modular Ratio 'n' =

Equiv. Solid Thick. =

Masonry Block Type =

Masonry Design Method = ASD

Concrete Data

f'c psi =

Fy psi =

2nd

Stem OK

ft = 3.25

Concrete

SD

8.00

4

12.00

Edge

0.797

0.659

lbs =

1,681.8

3,388.0

ft-# =

4,344.5

12,422.7

ft-# =

5,448.0

18,848.3

psi =

22.4

50.2

psi =

82.2

82.2

in2 =

100.0

100.0

in =

6.25

5.63

psi =

3,000.0

3,000.0

psi =

60,000.0

60,000.0

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
2nd Stem		
As (based on applied moment) :	0.1628 in ² /ft	
(4/3) * As :	0.217 in ² /ft	Min Stem T&S Reinf Area 1.488 in ²
200bd/fy : 200(12)(6.25)/60000 :	0.25 in ² /ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in ² /ft
0.0018bh : 0.0018(12)(8) :	0.1728 in ² /ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.217 in ² /ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.2 in ² /ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	1.016 in ² /ft	#6@ 27.50 in #6@ 55.00 in

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
Bottom Stem		
As (based on applied moment) :	0.5203 in ² /ft	
(4/3) * As :	0.6937 in ² /ft	Min Stem T&S Reinf Area 0.624 in ²
200bd/fy : 200(12)(5.625)/60000 :	0.225 in ² /ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in ² /ft
0.0018bh : 0.0018(12)(8) :	0.1728 in ² /ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.5203 in ² /ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.88 in ² /ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	0.9144 in ² /ft	#6@ 27.50 in #6@ 55.00 in

Footing Data

Toe Width	=	6.25 ft
Heel Width	=	1.17
Total Footing Width	=	7.42
Footing Thickness	=	12.00 in
Key Width	=	12.00 in
Key Depth	=	21.00 in
Key Distance from Toe	=	0.00 ft
f'c =	3,000 psi	Fy = 60,000 psi
Footing Concrete Density	=	150.00 pcf
Min. As %	=	0.0018
Cover @ Top	2.00	@ Btm = 3.00 in

Footing Design Results

	<u>Toe</u>	<u>Heel</u>	
Factored Pressure	=	1,484	160 psf
Mu' : Upward	=	21,716	24 ft-#
Mu' : Downward	=	6,445	229 ft-#
Mu: Design	=	15,271 OK	205 ft-# OK
phiMn	=	30,739	24,231 ft-#
Actual 1-Way Shear	=	33.10	7.13 psi
Allow 1-Way Shear	=	82.16	82.16 psi
Toe Reinforcing	=	# 6 @ 6.00 in	
Heel Reinforcing	=	# 7 @ 12.00 in	
Key Reinforcing	=	# 4 @ 9.26 in	
Footing Torsion, Tu	=		0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=		0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 5.78 in, #5@ 8.96 in, #6@ 12.72 in, #7@ 17.35 in, #8@ 22.85 in, #9@ 28.92 in, #10@ 36.74 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: #4@ 9.25 in, #5@ 14.35 in, #6@ 18 in, #7@ 18

Min footing T&S reinf Area 1.92 in²
 Min footing T&S reinf Area per foot 0.26 in²/ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....			RESISTING.....		
	Force lbs	Distance ft	Moment ft-#		Force lbs	Distance ft	Moment ft-#
HL Act Pres (ab water tbl)	2,520.0	4.00	10,080.0	Soil Over HL (ab. water tbl)	688.0	7.17	4,930.5
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		7.17	4,930.5
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	266.0	6.58	1,751.2
Added Lateral Load =				* Axial Live Load on Stem =	238.0	6.58	1,566.8
Load @ Stem Above Soil =				Soil Over Toe =	687.5	3.13	2,148.4
				Surcharge Over Toe =			
				Stem Weight(s) =	1,100.0	6.58	7,241.7
				Earth @ Stem Transitions =			
Total	= 2,520.0	O.T.M.	= 10,080.0	Footing Weight =	1,112.6	3.71	4,125.9
				Key Weight =	262.5	0.50	131.3
				Vert. Component =			
Resisting/Overturning Ratio		=	2.02	Total =	4,116.5 lbs	R.M.=	20,328.9
Vertical Loads used for Soil Pressure =		4,354.5 lbs		* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.044 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

Rebar Lap & Embedment Lengths Information

Stem Design Segment: 2nd

Stem Design Height: 3.25 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in
Development length for #4 bar specified in this stem design segment = 13.15 in

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #6 bar specified in this stem design segment (25.4.2.3a) = 25.63 in
Development length for #6 bar specified in this stem design segment = 19.72 in

Hooked embedment length into footing for #6 bar specified in this stem design segment = 6.80 in
As Provided = 0.8800 in²/ft
As Required = 0.5203 in²/ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

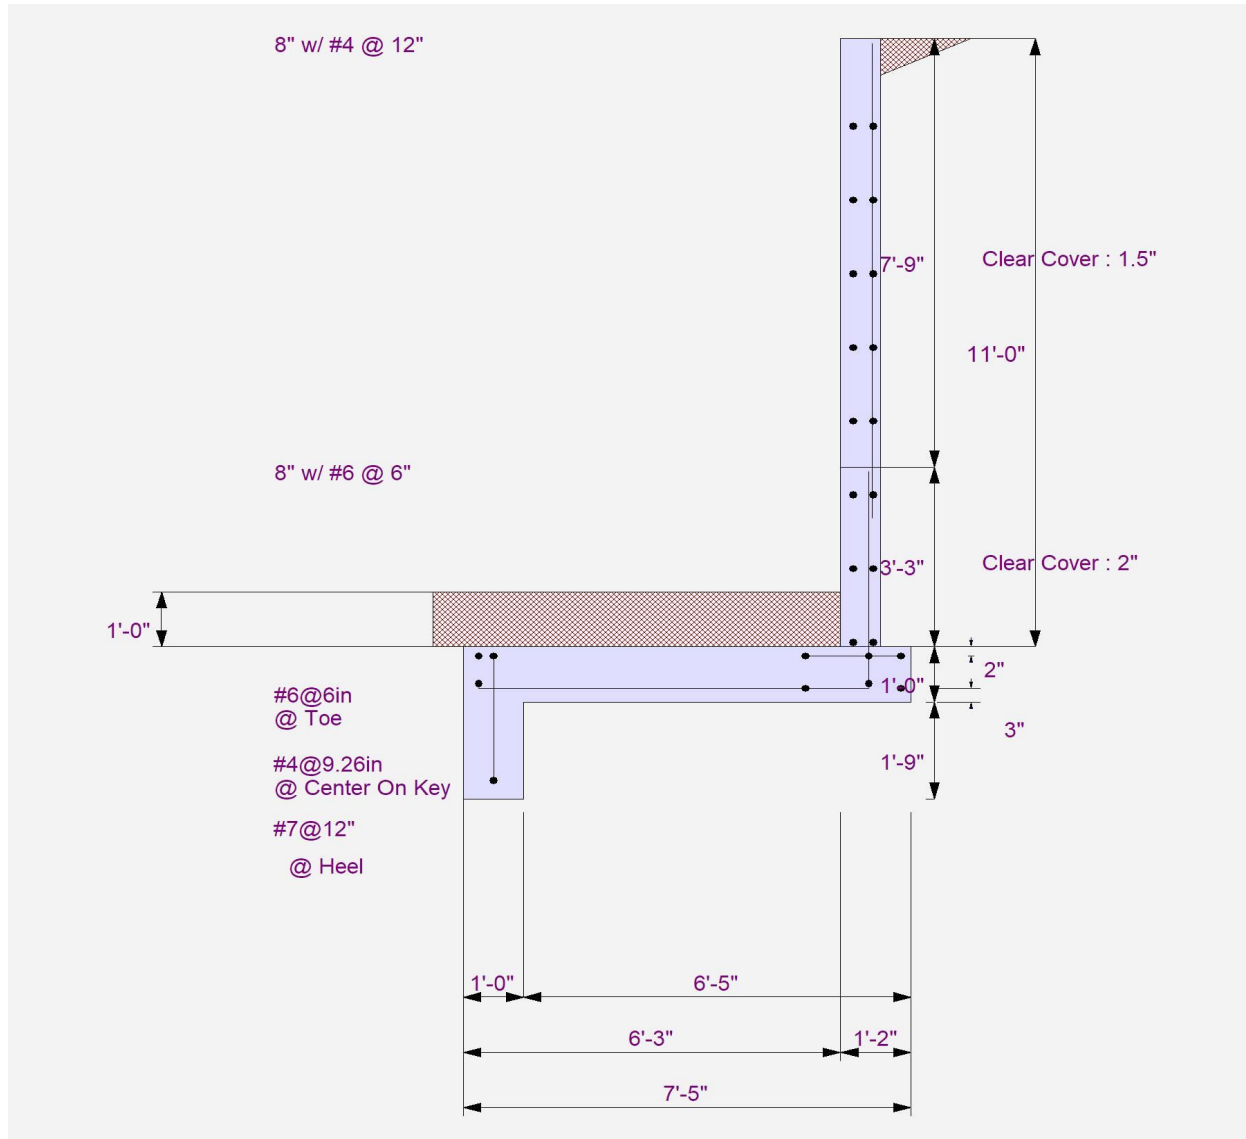

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 11.5' CANT - WEST

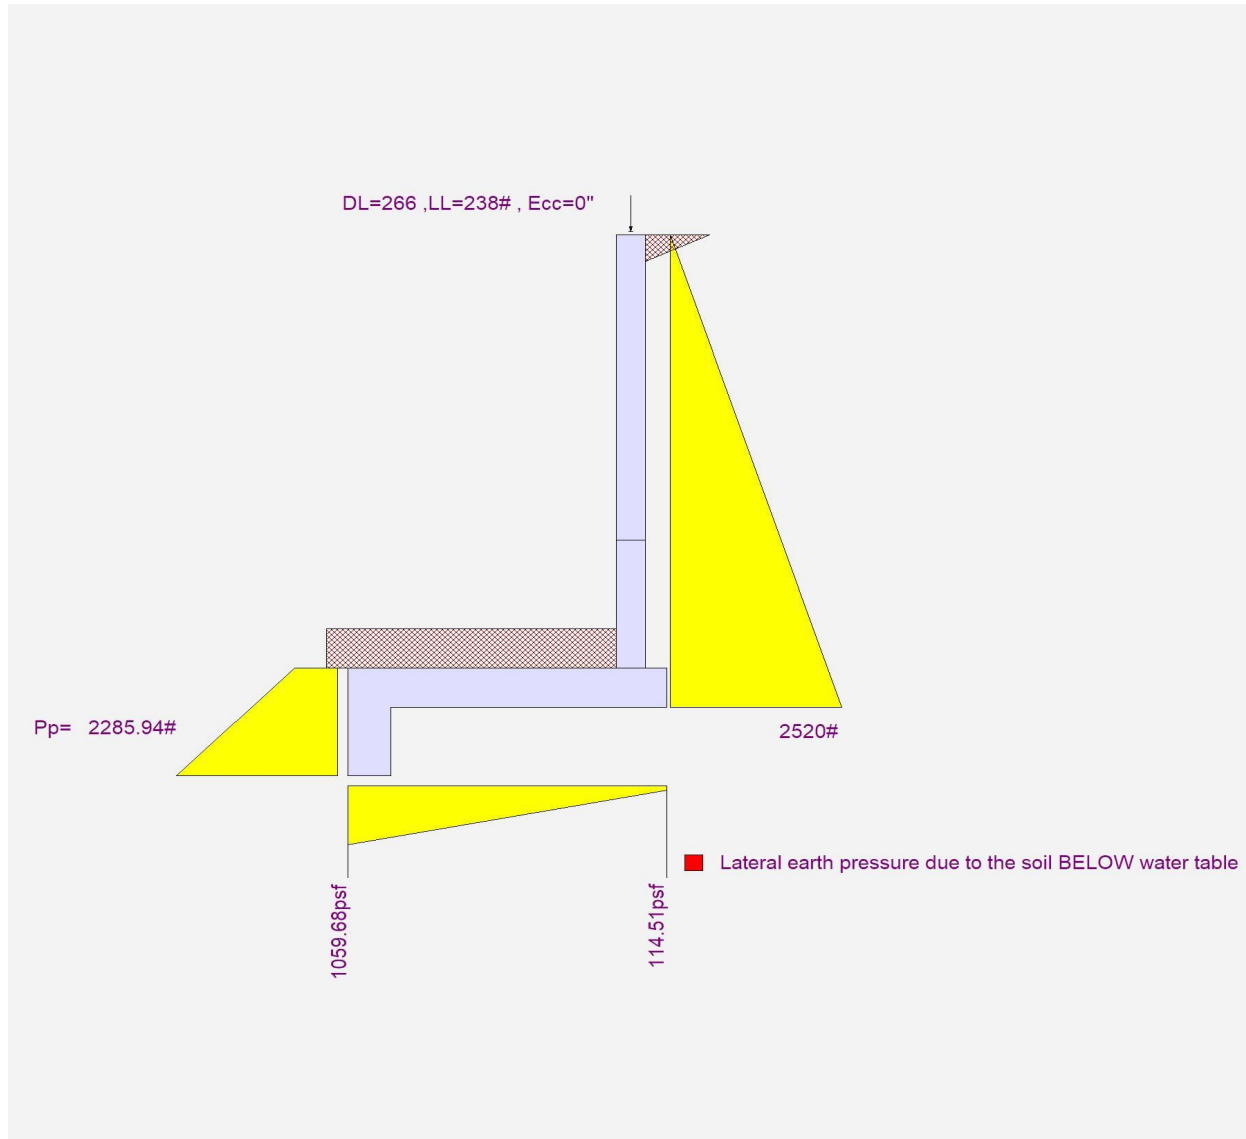

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 10' RETAINING

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	10.00 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

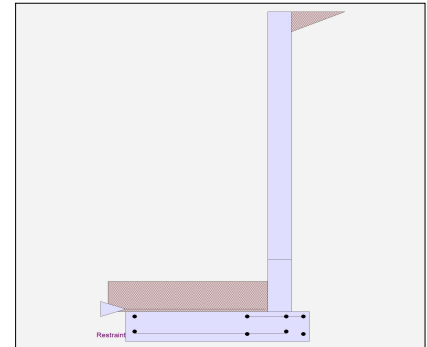

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0 psf
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	330.0 lbs
Axial Live Load	=	172.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 10' RETAINING

Design Summary

Wall Stability Ratios

Overturning	=	1.51	OK
Slab Resists All Sliding !			
Global Stability	=	1.16	
Total Bearing Load	=	3,342 lbs	
...resultant ecc.	=	14.12 in	
Eccentricity outside middle third			
Soil Pressure @ Toe	=	1,584 psf	OK
Soil Pressure @ Heel	=	0 psf	OK
Allowable	=	3,000 psf	
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	2,218 psf	
ACI Factored @ Heel	=	0 psf	
Footing Shear @ Toe	=	31.4 psi	OK
Footing Shear @ Heel	=	7.4 psi	OK
Allowable	=	82.2 psi	

Sliding Calcs

Lateral Sliding Force	=	2,117.5 lbs
-----------------------	---	-------------

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

		2nd	Bottom			
Design Height Above Ftg	ft =	Stem OK 1.75	Stem OK 0.00			
Wall Material Above "Ht"	=	Concrete	Concrete			
Design Method	=	SD	SD	SD	SD	SD
Thickness	=	8.00	8.00			
Rebar Size	=	# 4	# 4			
Rebar Spacing	=	12.00	6.00			
Rebar Placed at	=	Edge	Edge			
Design Data						
fb/FB + fa/Fa	=	0.961	0.885			
Total Force @ Section						
Service Level	lbs =					
Strength Level	lbs =	1,905.8	2,800.0			
Moment....Actual						
Service Level	ft-# =					
Strength Level	ft-# =	5,240.8	9,333.3			
Moment.....Allowable	ft-# =	5,448.0	10,542.0			
Shear.....Actual						
Service Level	psi =					
Strength Level	psi =	25.4	37.3			
Shear.....Allowable	psi =	82.2	82.2			
Anet (Masonry)	in2 =					
Wall Weight	psf =	100.0	100.0			
Rebar Depth 'd'	in =	6.25	6.25			

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0	3,000.0
Fy	psi =	60,000.0	60,000.0

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 10' RETAINING

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
2nd Stem		
As (based on applied moment) :	0.1964 in2/ft	
(4/3) * As :	0.2618 in2/ft	Min Stem T&S Reinf Area 1.584 in2
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.25 in2/ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.2 in2/ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in #6@ 55.00 in

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>
Bottom Stem		
As (based on applied moment) :	0.3497 in2/ft	
(4/3) * As :	0.4662 in2/ft	Min Stem T&S Reinf Area 0.336 in2
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :
	=====	<u>One layer of :</u> <u>Two layers of :</u>
Required Area :	0.3497 in2/ft	#4@ 12.50 in #4@ 25.00 in
Provided Area :	0.4 in2/ft	#5@ 19.38 in #5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in #6@ 55.00 in

Footing Data

Toe Width	=	4.00 ft
Heel Width	=	1.17
Total Footing Width	=	5.17
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c =	3,000 psi	Fy = 60,000 psi
Footing Concrete Density	=	150.00 pcf
Min. As %	=	0.0018
Cover @ Top	2.00	@ Btm = 3.00 in

Footing Design Results

	<u>Toe</u>	<u>Heel</u>	
Factored Pressure	=	2,218	0 psf
Mu' : Upward	=	12,136	0 ft-#
Mu' : Downward	=	2,640	210 ft-#
Mu: Design	=	9,496 OK	210 ft-# OK
phiMn	=	30,739	24,231 ft-#
Actual 1-Way Shear	=	31.39	7.37 psi
Allow 1-Way Shear	=	82.16	82.16 psi
Toe Reinforcing	=	# 6 @ 6.00 in	
Heel Reinforcing	=	# 7 @ 12.00 in	
Key Reinforcing	=	None Spec'd	
Footing Torsion, Tu	=		0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=		0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 7.05 in, #5@ 10.94 in, #6@ 15.52 in, #7@ 21.17 in, #8@ 27.88 in, #9@ 35.29 in, #10@ 44.82 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area 1.34 in2
 Min footing T&S reinf Area per foot 0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 10' RETAINING

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	2,117.5	3.67	7,764.2	Soil Over HL (ab. water tbl)	625.4	4.92	3,075.1
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		4.92	3,075.1
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	330.0	4.33	1,430.0
Added Lateral Load =				* Axial Live Load on Stem =	172.0	4.33	745.3
Load @ Stem Above Soil =				Soil Over Toe =	440.0	2.00	880.0
				Surcharge Over Toe =			
				Stem Weight(s) =	1,000.0	4.33	4,333.3
				Earth @ Stem Transitions =			
Total	= 2,117.5	O.T.M.	= 7,764.2	Footing Weight =	775.1	2.58	2,002.3
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		=	1.51	Total =	3,170.5 lbs	R.M.=	11,720.7
Vertical Loads used for Soil Pressure =		3,342.5 lbs		* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.085 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 10' RETAINING

Rebar Lap & Embedment Lengths Information

Stem Design Segment: 2nd

Stem Design Height: 1.75 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in
Development length for #4 bar specified in this stem design segment = 13.15 in

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) = 17.09 in
Development length for #4 bar specified in this stem design segment = 13.15 in

Hooked embedment length into footing for #4 bar specified in this stem design segment = 6.70 in
As Provided = 0.4000 in²/ft
As Required = 0.3497 in²/ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 10' RETAINING

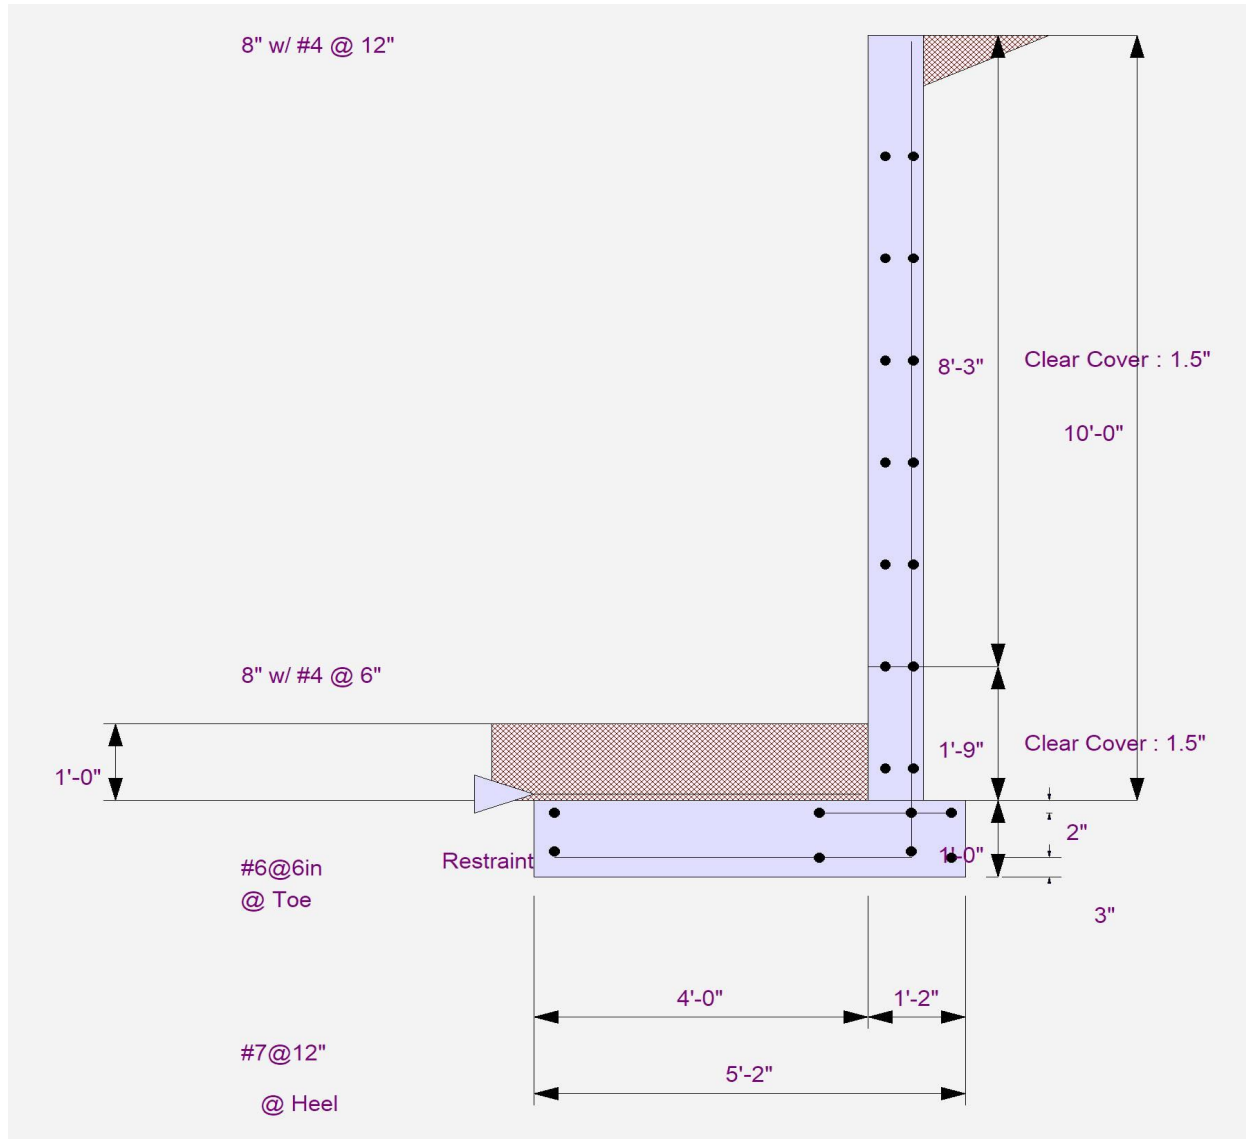

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	4.00 ft
Wall height above soil	=	1.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

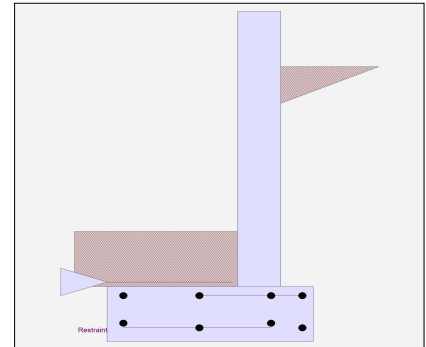

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	330.0 lbs
Axial Live Load	=	172.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

Design Summary

Wall Stability Ratios

Overturning	=	4.99	OK
Slab Resists All Sliding !			
Global Stability	=	2.87	
Total Bearing Load	=	1,947 lbs	
...resultant ecc.	=	1.40 in	
Eccentricity within middle third			
Soil Pressure @ Toe	=	479 psf	OK
Soil Pressure @ Heel	=	751 psf	OK
Allowable	=	3,000 psf	
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	670 psf	
ACI Factored @ Heel	=	1,051 psf	
Footing Shear @ Toe	=	4.7 psi	OK
Footing Shear @ Heel	=	1.1 psi	OK
Allowable	=	82.2 psi	

Sliding Calcs

Lateral Sliding Force	=	437.5 lbs
-----------------------	---	-----------

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

Design Height Above Ftg

ft =	Stem OK	0.00
Wall Material Above "Ht"	=	Concrete
Design Method	=	SD
Thickness	=	8.00
Rebar Size	=	# 4
Rebar Spacing	=	18.00
Rebar Placed at	=	Edge

Design Data

fb/FB + fa/Fa	=	0.162
---------------	---	-------

Total Force @ Section

Service Level	lbs =	
Strength Level	lbs =	448.0

Moment....Actual

Service Level	ft-# =	
Strength Level	ft-# =	597.3

Moment.....Allowable	=	3,671.3
----------------------	---	---------

Shear.....Actual

Service Level	psi =	
Strength Level	psi =	6.0

Shear.....Allowable	psi =	82.2
---------------------	-------	------

Anet (Masonry)	in2 =	
----------------	-------	--

Wall Weight	psf =	100.0
-------------	-------	-------

Rebar Depth 'd'	in =	6.25
-----------------	------	------

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0
Fy	psi =	60,000.0

Bottom

SD SD SD SD SD

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>	
Bottom Stem			
As (based on applied moment) :	0.0224 in2/ft		
(4/3) * As :	0.0298 in2/ft	Min Stem T&S Reinf Area 0.960 in2	
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft	
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :	
	=====	<u>One layer of :</u>	<u>Two layers of :</u>
Required Area :	0.1728 in2/ft	#4@ 12.50 in	#4@ 25.00 in
Provided Area :	0.1333 in2/ft	#5@ 19.38 in	#5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in	#6@ 55.00 in

Footing Data

Toe Width	=	2.00 ft
Heel Width	=	1.17
Total Footing Width	=	3.17
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c = 3,000 psi	Fy = 60,000 psi	
Footing Concrete Density = 150.00 pcf		
Min. As % = 0.0018		
Cover @ Top 2.00	@ Btm= 3.00 in	

Footing Design Results

	<u>Toe</u>	<u>Heel</u>
Factored Pressure	= 670	1,051 psf
Mu' : Upward	= 1,501	144 ft-#
Mu' : Downward	= 660	98 ft-#
Mu: Design	= 841 OK	-46 ft-#
phiMn	= 15,044	24,231 ft-#
Actual 1-Way Shear	= 4.66	1.06 psi
Allow 1-Way Shear	= 82.16	82.16 psi
Toe Reinforcing	= # 4 @ 6.00 in	
Heel Reinforcing	= # 7 @ 12.00 in	
Key Reinforcing	= None Spec'd	
Footing Torsion, Tu	=	0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=	0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area	0.82 in2
Min footing T&S reinf Area per foot	0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	437.5	1.67	729.2	Soil Over HL (ab. water tbl)	250.2	2.92	729.7
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		2.92	729.7
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	330.0	2.33	770.0
Added Lateral Load =				* Axial Live Load on Stem =	172.0	2.33	401.3
Load @ Stem Above Soil =				Soil Over Toe =	220.0	1.00	220.0
				Surcharge Over Toe =			
				Stem Weight(s) =	500.0	2.33	1,166.7
				Earth @ Stem Transitions =			
Total	= 437.5	O.T.M.	= 729.2	Footing Weight =	475.1	1.58	752.2
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		=	4.99	Total =	1,775.2 lbs	R.M.=	3,638.6
Vertical Loads used for Soil Pressure =		1,947.2 lbs		* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.000 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

Rebar Lap & Embedment Lengths Information

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) =	17.09 in
Development length for #4 bar specified in this stem design segment =	13.15 in
Hooked embedment length into footing for #4 bar specified in this stem design segment =	7.67 in
As Provided =	0.1333 in/ft
As Required =	0.1728 in/ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

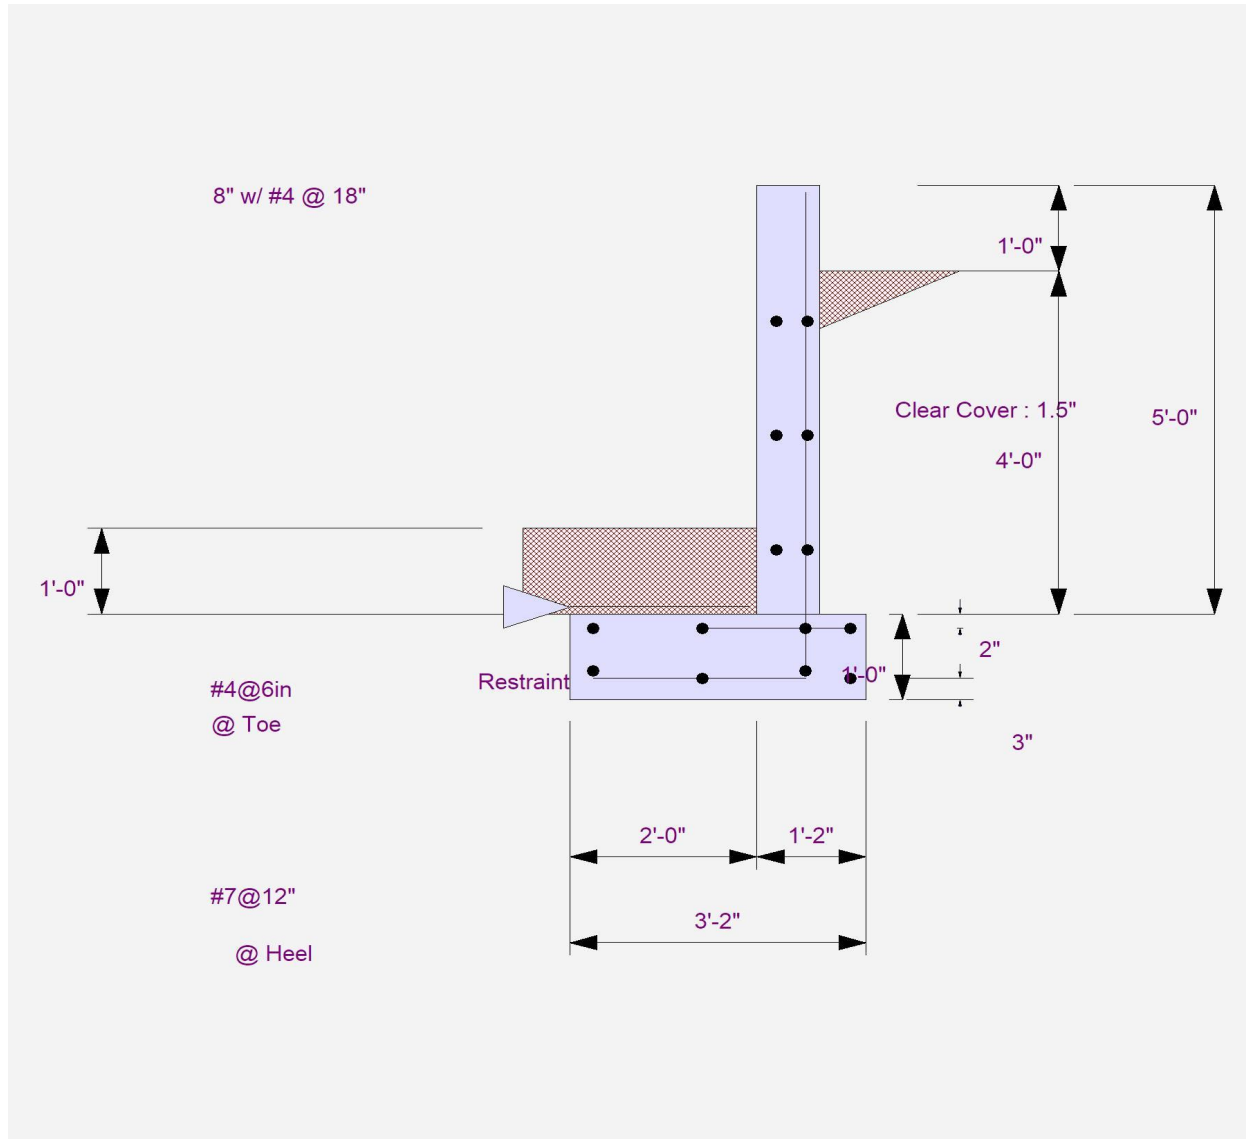

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING W/ TALL CONCRETE WALL

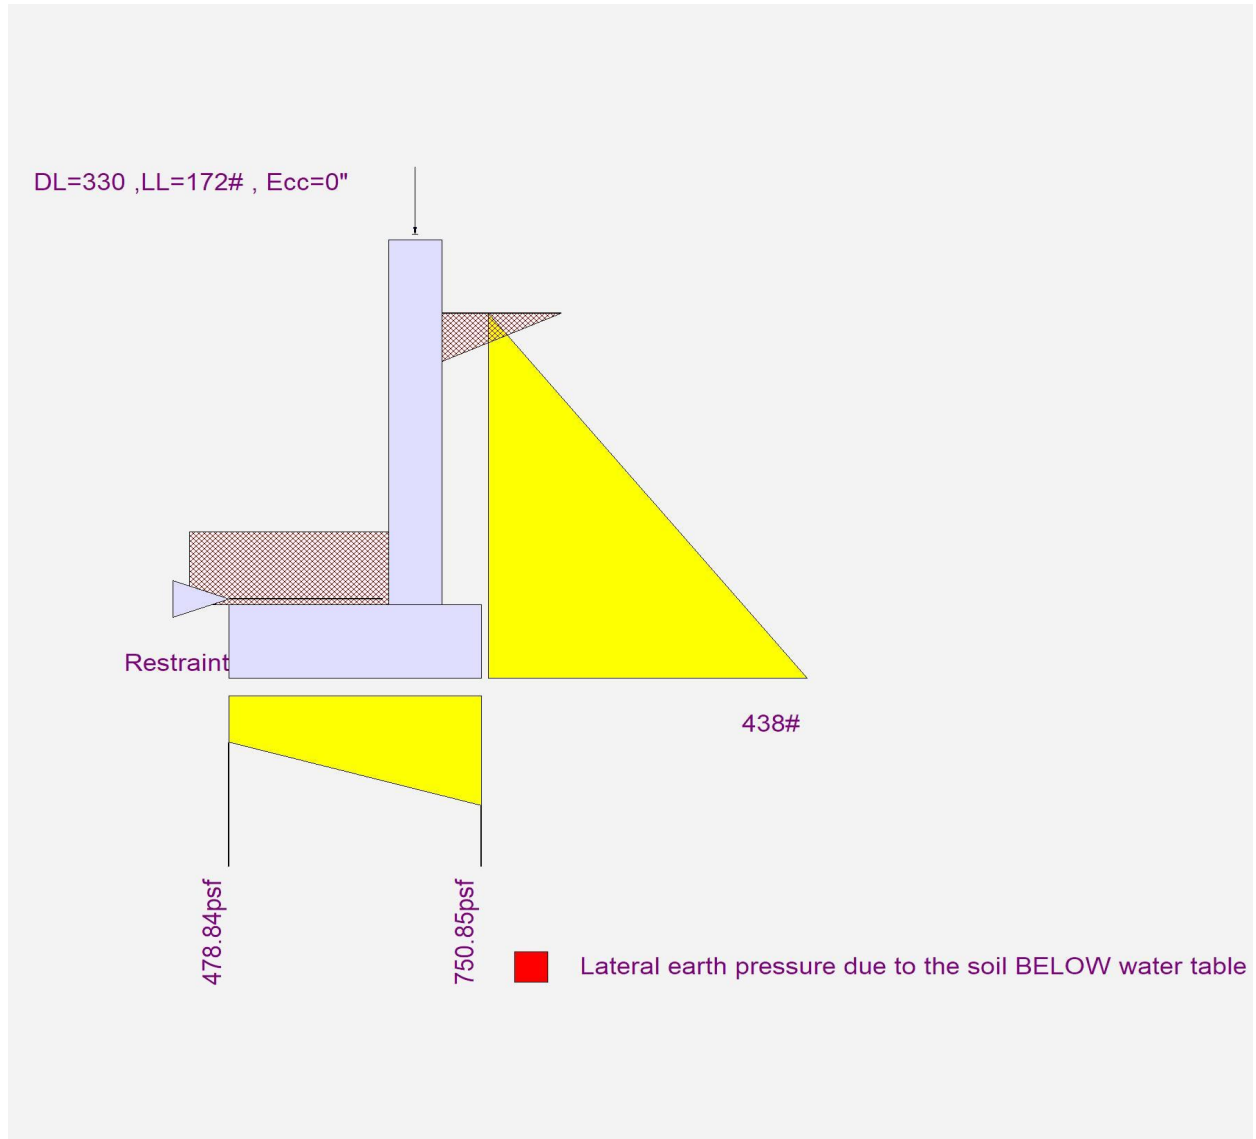

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	4.00 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	12.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

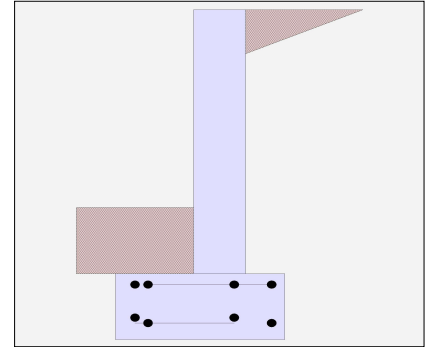

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	330.0 lbs
Axial Live Load	=	172.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

Design Summary

Wall Stability Ratios

Overtuning	=	2.55	OK
Sliding	=	2.49	OK
Global Stability	=	2.95	

Total Bearing Load	=	1,587	lbs
...resultant ecc.	=	2.72	in

Eccentricity within middle third

Soil Pressure @ Toe	=	1,192	psf	OK
Soil Pressure @ Heel	=	273	psf	OK
Allowable	=	3,000	psf	

Soil Pressure Less Than Allowable

ACI Factored @ Toe	=	1,669	psf	
ACI Factored @ Heel	=	382	psf	
Footing Shear @ Toe	=	3.4	psi	OK
Footing Shear @ Heel	=	1.1	psi	OK
Allowable	=	82.2	psi	

Sliding Calcs

Lateral Sliding Force	=	437.5	lbs	
less 100% Passive Force	=	525.0	lbs	
less 100% Friction Force	=	566.1	lbs	
Added Force Req'd	=	0.0	lbs	OK
...for 1.5 Stability	=	0.0	lbs	OK

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

Design Height Above Ftg

ft =	Stem OK	0.00
Wall Material Above "Ht"	=	Concrete
Design Method	=	SD
Thickness	=	8.00
Rebar Size	=	# 4
Rebar Spacing	=	18.00
Rebar Placed at	=	Edge

Design Data

fb/FB + fa/Fa	=	0.162
---------------	---	-------

Total Force @ Section

Service Level	lbs =	
Strength Level	lbs =	448.0

Moment....Actual

Service Level	ft-# =	
Strength Level	ft-# =	597.3

Moment.....Allowable	=	3,671.3
----------------------	---	---------

Shear.....Actual

Service Level	psi =	
Strength Level	psi =	6.0

Shear.....Allowable	psi =	82.2
---------------------	-------	------

Anet (Masonry)	in2 =	
----------------	-------	--

Wall Weight	psf =	100.0
-------------	-------	-------

Rebar Depth 'd'	in =	6.25
-----------------	------	------

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0
Fy	psi =	60,000.0

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

Concrete Stem Rebar Area Details

	Vertical Reinforcing	Horizontal Reinforcing	
Bottom Stem			
As (based on applied moment) :	0.0224 in2/ft		
(4/3) * As :	0.0298 in2/ft	Min Stem T&S Reinf Area 0.768 in2	
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft	
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :	
	=====	<u>One layer of :</u> <u>Two layers of :</u>	
Required Area :	0.1728 in2/ft	#4@ 12.50 in	#4@ 25.00 in
Provided Area :	0.1333 in2/ft	#5@ 19.38 in	#5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in	#6@ 55.00 in

Footing Data

Toe Width	=	1.00 ft
Heel Width	=	1.17
Total Footing Width	=	2.17
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c = 3,000 psi	Fy = 60,000 psi	
Footing Concrete Density = 150.00 pcf		
Min. As % = 0.0018		
Cover @ Top 2.00	@ Btm = 3.00 in	

Footing Design Results

	Toe	Heel
Factored Pressure	= 1,669	382 psf
Mu' : Upward	= 735	60 ft-#
Mu' : Downward	= 165	98 ft-#
Mu: Design	= 570 OK	37 ft-# OK
phiMn	= 15,044	24,231 ft-#
Actual 1-Way Shear	= 3.44	1.09 psi
Allow 1-Way Shear	= 82.16	82.16 psi
Toe Reinforcing	= # 4 @ 6.00 in	
Heel Reinforcing	= # 7 @ 12.00 in	
Key Reinforcing	= None Spec'd	
Footing Torsion, Tu	=	0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=	0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area	0.56 in2
Min footing T&S reinf Area per foot	0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	437.5	1.67	729.2	Soil Over HL (ab. water tbl)	250.2	1.92	479.5
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		1.92	479.5
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	330.0	1.33	440.0
Added Lateral Load =				* Axial Live Load on Stem =	172.0	1.33	229.3
Load @ Stem Above Soil =				Soil Over Toe =	110.0	0.50	55.0
				Surcharge Over Toe =			
				Stem Weight(s) =	400.0	1.33	533.3
				Earth @ Stem Transitions =			
Total	= 437.5	O.T.M. =	729.2	Footing Weight =	325.1	1.08	352.2
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		= 2.55		Total =	1,415.2 lbs	R.M.=	1,860.1
Vertical Loads used for Soil Pressure =		1,587.2 lbs		* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.061 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

Rebar Lap & Embedment Lengths Information

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) =	17.09 in
Development length for #4 bar specified in this stem design segment =	13.15 in
Hooked embedment length into footing for #4 bar specified in this stem design segment =	7.67 in
As Provided =	0.1333 in ² /ft
As Required =	0.1728 in ² /ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

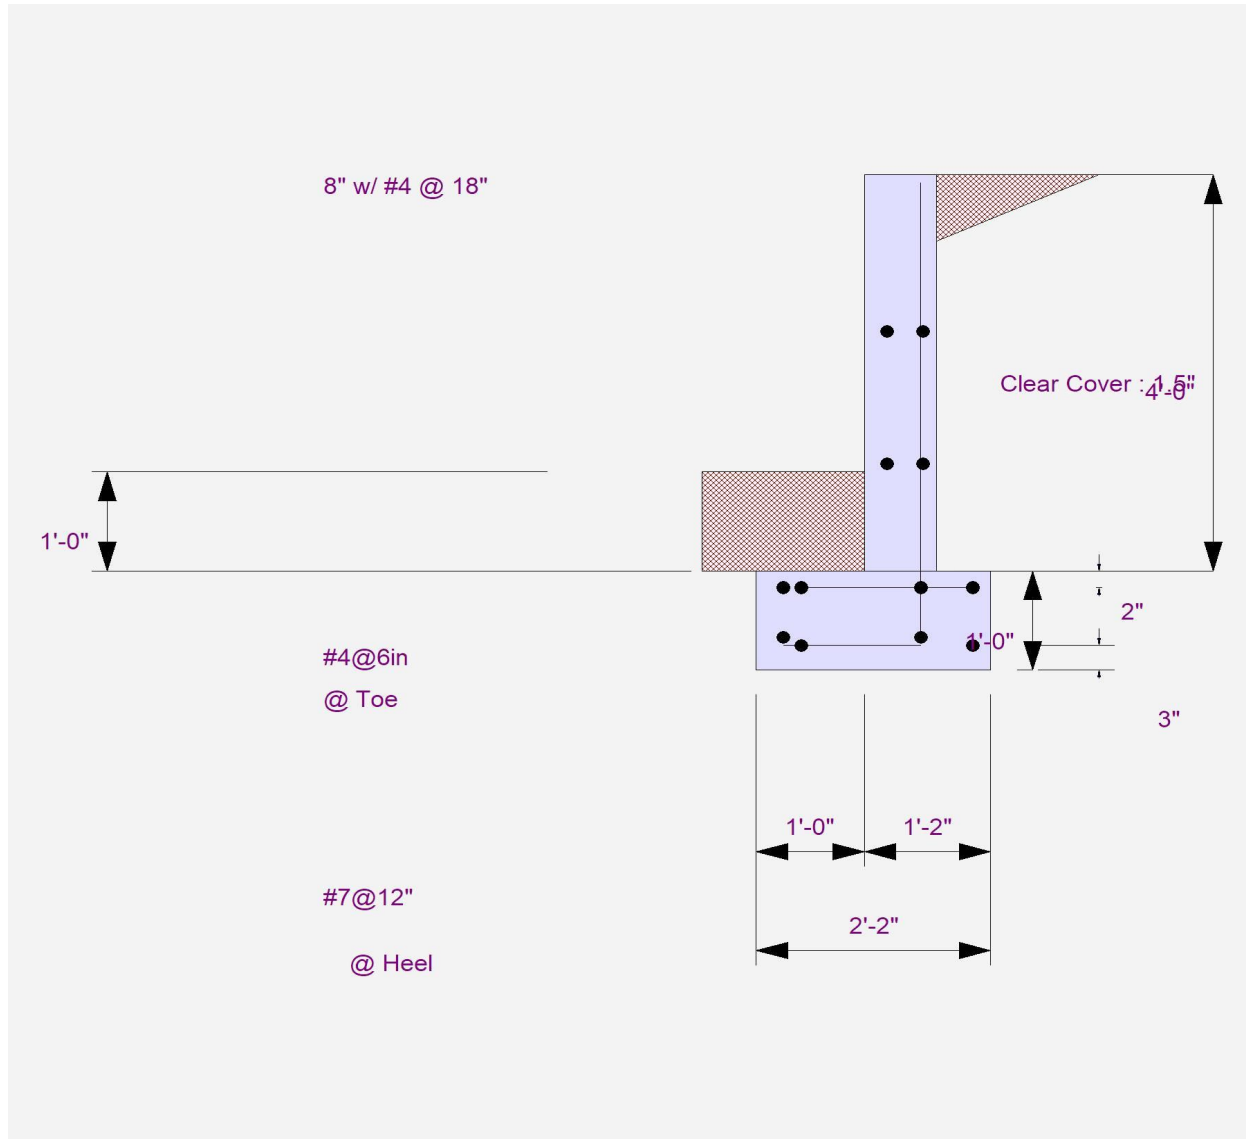

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING

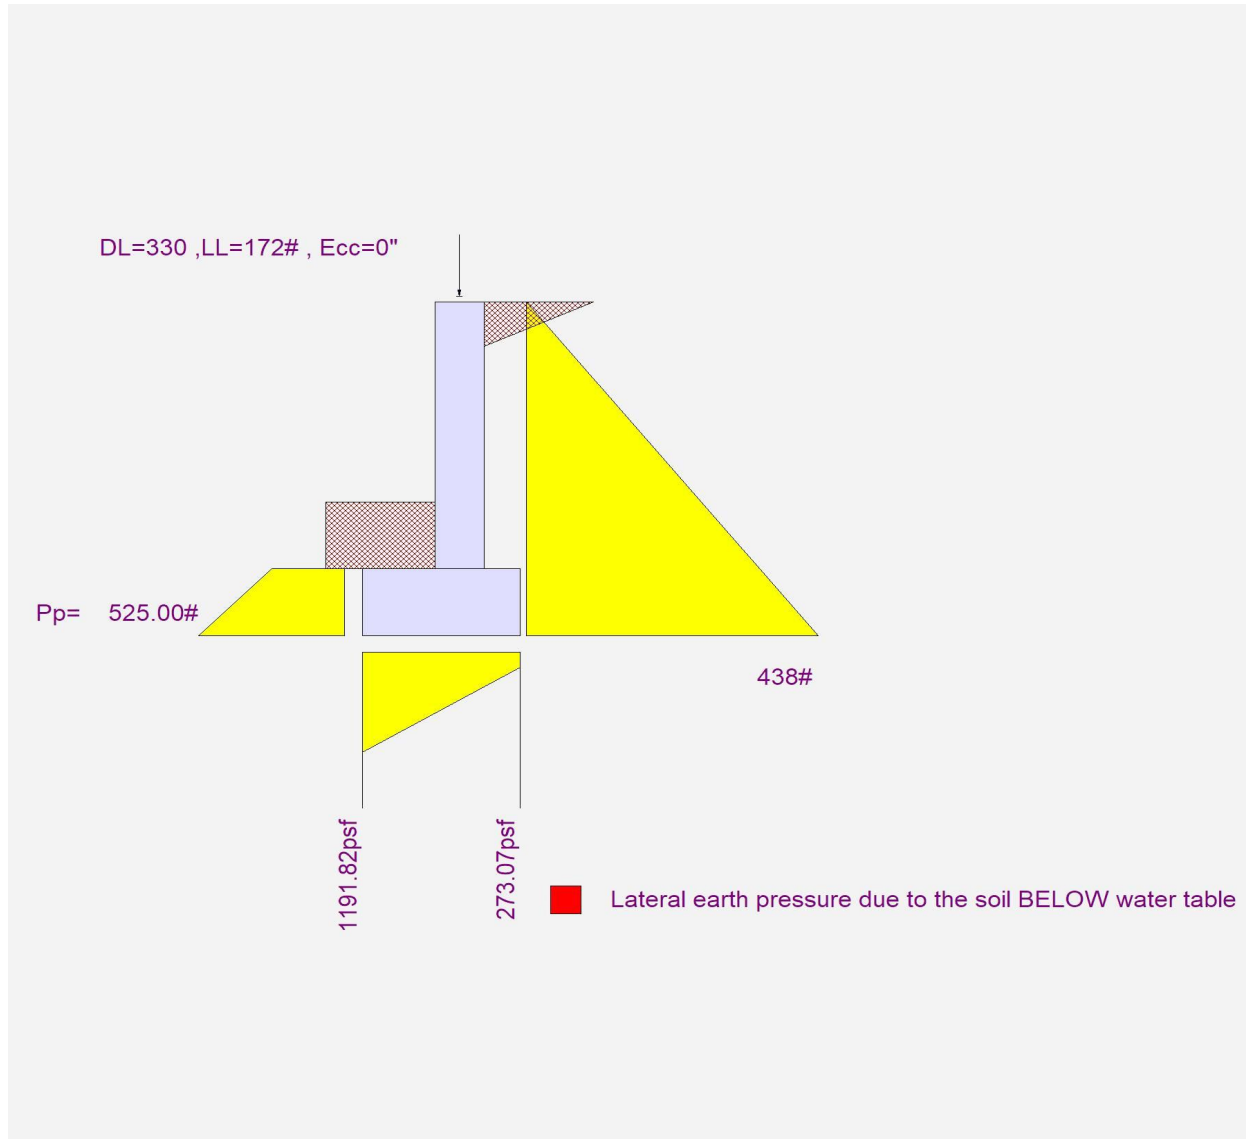

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

Code Reference


Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Criteria

Retained Height	=	4.00 ft
Wall height above soil	=	0.00 ft
Slope Behind Wall	=	0.00
Height of Soil over Toe	=	0.00 in
Water table above bottom of footing	=	0.0 ft

Soil Data

Allow Soil Bearing	=	3,000.0 psf
Equivalent Fluid Pressure Method		
Active Heel Pressure	=	35.0 psf/ft
	=	
Passive Pressure	=	350.0 psf/ft
Soil Density, Heel	=	125.00 pcf
Soil Density, Toe	=	110.00 pcf
Footing Soil Friction	=	0.400
Soil height to ignore for passive pressure	=	12.00 in

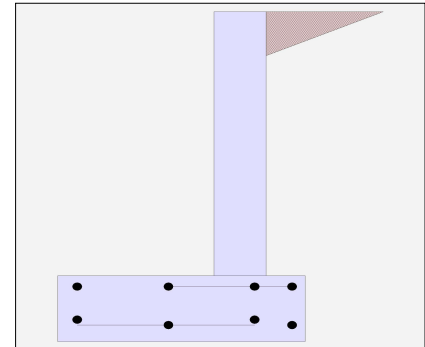

Surcharge Loads

Surcharge Over Heel	=	0.0 psf
Used To Resist Sliding & Overturning		
Surcharge Over Toe	=	0.0
Used for Sliding & Overturning		

Axial Load Applied to Stem

Axial Dead Load	=	1,276.0 lbs
Axial Live Load	=	0.0 lbs
Axial Load Eccentricity	=	0.0 in

Lateral Load Applied to Stem

Lateral Load	=	0.0 #/ft
...Height to Top	=	0.00 ft
...Height to Bottom	=	0.00 ft
Load Type	=	Wind (W) (Service Level)
Wind on Exposed Stem	=	0.0 psf (Strength Level)

Adjacent Footing Load

Adjacent Footing Load	=	0.0 lbs
Footing Width	=	0.00 ft
Eccentricity	=	0.00 in
Wall to Ftg CL Dist	=	0.00 ft
Footing Type	=	Spread Footing
Base Above/Below Soil at Back of Wall	=	0.0 ft
Poisson's Ratio	=	0.300

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

Design Summary

Wall Stability Ratios

Overturning	=	7.40	OK
Sliding	=	2.20	OK
Global Stability	=	2.07	
Total Bearing Load	=	2,401 lbs	
...resultant ecc.	=	4.30 in	
Eccentricity within middle third			
Soil Pressure @ Toe	=	243 psf	OK
Soil Pressure @ Heel	=	1,273 psf	OK
Allowable	=	3,000 psf	
Soil Pressure Less Than Allowable			
ACI Factored @ Toe	=	340 psf	
ACI Factored @ Heel	=	1,783 psf	
Footing Shear @ Toe	=	5.8 psi	OK
Footing Shear @ Heel	=	3.9 psi	OK
Allowable	=	82.2 psi	

Sliding Calcs

Lateral Sliding Force	=	437.5 lbs	
less 100% Passive Force	=	0.0 lbs	
less 100% Friction Force	=	960.5 lbs	
Added Force Req'd	=	0.0 lbs	OK
...for 1.5 Stability	=	0.0 lbs	OK

Vertical component of active lateral soil pressure IS NOT considered in the calculation of soil bearing

Load Factors

Building Code	
Dead Load	1.200
Live Load	1.600
Earth, H	1.600
Wind, W	1.600
Seismic, E	1.000

Stem Construction

Design Height Above Ftg

ft =	Stem OK	0.00
Wall Material Above "Ht"	=	Concrete
Design Method	=	SD
Thickness	=	8.00
Rebar Size	=	# 4
Rebar Spacing	=	18.00
Rebar Placed at	=	Edge

Design Data

fb/FB + fa/Fa	=	0.162
---------------	---	-------

Total Force @ Section

Service Level	lbs =	
Strength Level	lbs =	448.0

Moment....Actual

Service Level	ft-# =	
Strength Level	ft-# =	597.3

Moment.....Allowable	=	3,671.3
----------------------	---	---------

Shear.....Actual

Service Level	psi =	
Strength Level	psi =	6.0

Shear.....Allowable	psi =	82.2
---------------------	-------	------

Anet (Masonry)	in2 =	
----------------	-------	--

Wall Weight	psf =	100.0
-------------	-------	-------

Rebar Depth 'd'	in =	6.25
-----------------	------	------

Masonry Data

f'm	psi =	
Fs	psi =	
Solid Grouting	=	
Modular Ratio 'n'	=	
Equiv. Solid Thick.	=	
Masonry Block Type	=	
Masonry Design Method	=	ASD

Concrete Data

f'c	psi =	3,000.0
Fy	psi =	60,000.0

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

Concrete Stem Rebar Area Details

	<u>Vertical Reinforcing</u>	<u>Horizontal Reinforcing</u>	
Bottom Stem			
As (based on applied moment) :	0.0224 in2/ft		
(4/3) * As :	0.0298 in2/ft	Min Stem T&S Reinf Area 0.768 in2	
200bd/fy : 200(12)(6.25)/60000 :	0.25 in2/ft	Min Stem T&S Reinf Area per ft of stem Height : 0.192 in2/ft	
0.0018bh : 0.0018(12)(8) :	0.1728 in2/ft	Horizontal Reinforcing Options :	
	=====	<u>One layer of :</u>	<u>Two layers of :</u>
Required Area :	0.1728 in2/ft	#4@ 12.50 in	#4@ 25.00 in
Provided Area :	0.1333 in2/ft	#5@ 19.38 in	#5@ 38.75 in
Maximum Area :	1.016 in2/ft	#6@ 27.50 in	#6@ 55.00 in

Footing Data

Toe Width	=	2.00 ft
Heel Width	=	1.17
Total Footing Width	=	3.17
Footing Thickness	=	12.00 in
Key Width	=	0.00 in
Key Depth	=	0.00 in
Key Distance from Toe	=	0.00 ft
f'c = 3,000 psi	Fy = 60,000 psi	
Footing Concrete Density = 150.00 pcf		
Min. As % = 0.0018		
Cover @ Top 2.00	@ Btm= 3.00 in	

Footing Design Results

	<u>Toe</u>	<u>Heel</u>
Factored Pressure	= 340	1,783 psf
Mu' : Upward	= 1,288	271 ft-#
Mu' : Downward	= 360	98 ft-#
Mu: Design	= 928 OK	-173 ft-#
phiMn	= 15,044	24,231 ft-#
Actual 1-Way Shear	= 5.75	3.90 psi
Allow 1-Way Shear	= 82.16	82.16 psi
Toe Reinforcing	= # 4 @ 6.00 in	
Heel Reinforcing	= # 7 @ 12.00 in	
Key Reinforcing	= None Spec'd	
Footing Torsion, Tu	=	0.00 ft-lbs
Footing Allow. Torsion, phi Tu	=	0.00 ft-lbs

If torsion exceeds allowable, provide supplemental design for footing torsion.

Other Acceptable Sizes & Spacings

Toe: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Heel: #4@ 9.25 in, #5@ 14.35 in, #6@ 20.37 in, #7@ 27.77 in, #8@ 36.57 in, #9@ 46.29 in, #10@ 58.79 in

Key: No key defined

Min footing T&S reinf Area	0.82 in2
Min footing T&S reinf Area per foot	0.26 in2 /ft

If one layer of horizontal bars:

#4@ 9.26 in
 #5@ 14.35 in
 #6@ 20.37 in

If two layers of horizontal bars:

#4@ 18.52 in
 #5@ 28.70 in
 #6@ 40.74 in

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

Summary of Overturning & Resisting Forces & Moments

ItemOVERTURNING.....		RESISTING.....			
	Force lbs	Distance ft	Moment ft-#	Force lbs	Distance ft	Moment ft-#	
HL Act Pres (ab water tbl)	437.5	1.67	729.2	Soil Over HL (ab. water tbl)	250.2	2.92	729.7
HL Act Pres (be water tbl)				Soil Over HL (bel. water tbl)		2.92	729.7
Hydrostatic Force				Water Table			
Buoyant Force =				Sloped Soil Over Heel =			
Surcharge over Heel =				Surcharge Over Heel =			
Surcharge Over Toe =				Adjacent Footing Load =			
Adjacent Footing Load =				Axial Dead Load on Stem =	1,276.0	2.33	2,977.3
Added Lateral Load =				* Axial Live Load on Stem =			
Load @ Stem Above Soil =				Soil Over Toe =			
				Surcharge Over Toe =			
				Stem Weight(s) =	400.0	2.33	933.3
				Earth @ Stem Transitions =			
Total	= 437.5	O.T.M. =	729.2	Footing Weight =	475.1	1.58	752.2
				Key Weight =			
				Vert. Component =			
Resisting/Overturning Ratio		= 7.40		Total =	2,401.2 lbs	R.M.=	5,392.6
Vertical Loads used for Soil Pressure =		2,401.2 lbs		* Axial live load NOT included in total displayed, or used for overturning resistance, but is included for soil pressure calculation.			

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Sliding Resistance.

Vertical component of active lateral soil pressure IS NOT considered in the calculation of Overturning Resistance.

Tilt

Horizontal Deflection at Top of Wall due to settlement of soil

(Deflection due to wall bending not considered)

Soil Spring Reaction Modulus 250.0 pci
 Horizontal Defl @ Top of Wall (approximate only) 0.000 in

The above calculation is not valid if the heel soil bearing pressure exceeds that of the toe, because the wall would then tend to rotate into the retained soil.

Cantilevered Retaining Wall

Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

Rebar Lap & Embedment Lengths Information

Stem Design Segment: Bottom

Stem Design Height: 0.00 ft above top of footing

Lap Splice length for #4 bar specified in this stem design segment (25.4.2.3a) =	17.09 in
Development length for #4 bar specified in this stem design segment =	13.15 in
Hooked embedment length into footing for #4 bar specified in this stem design segment =	7.67 in
As Provided =	0.1333 in ² /ft
As Required =	0.1728 in ² /ft

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design

(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

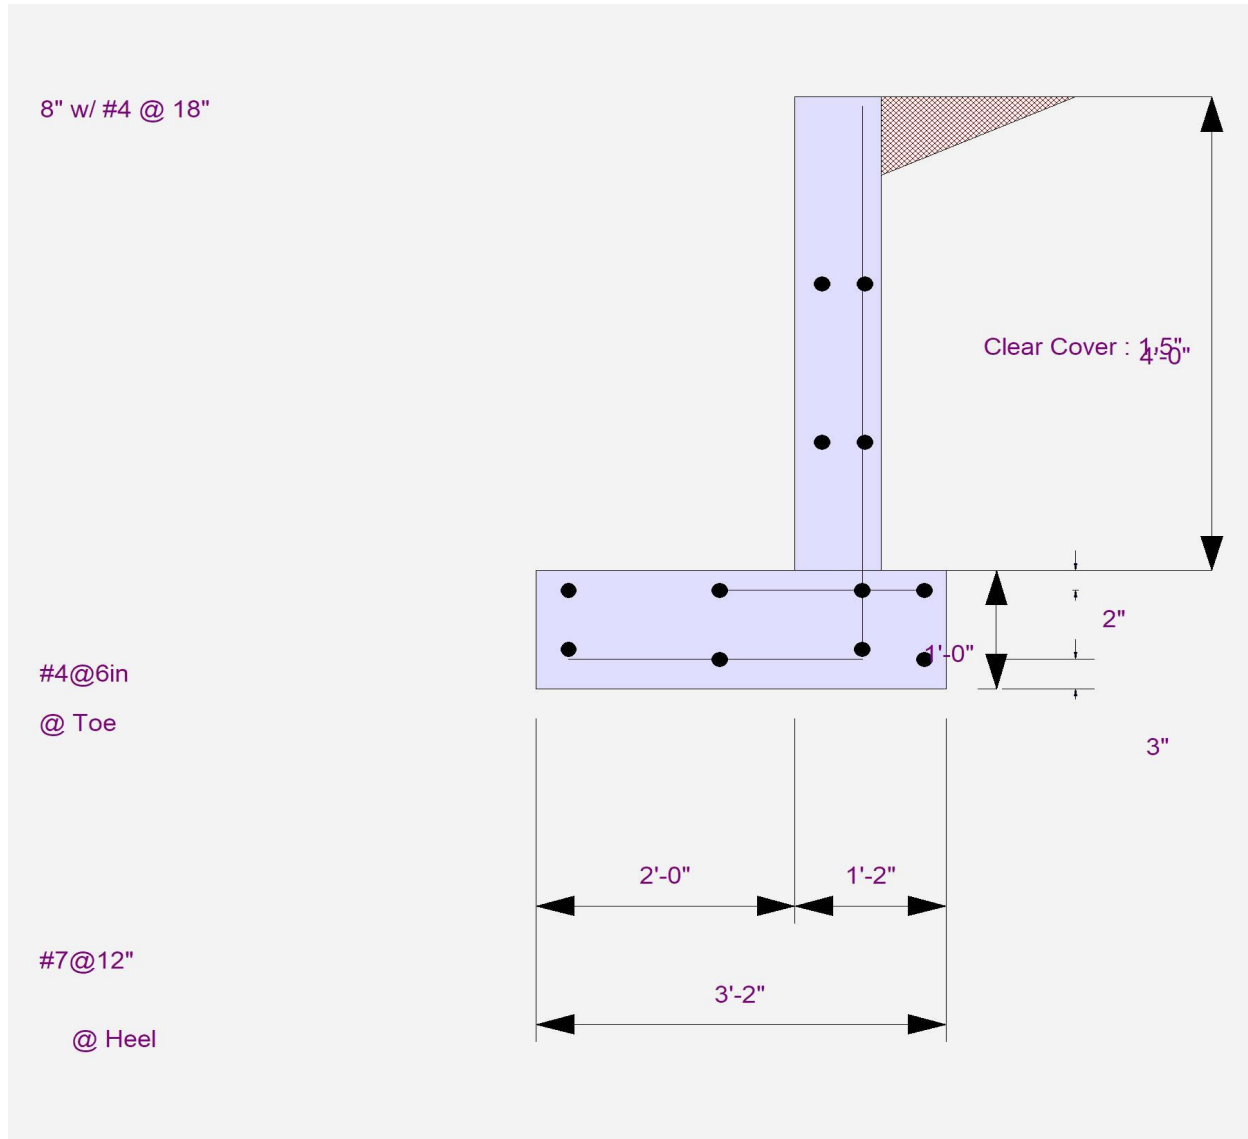

Cantilevered Retaining Wall


Project File: samjunewalls_UPDATED 062323.ec6

LIC# : KW-06018769, Build:20.23.05.25

Smith Lubke Structural Design


(c) ENERCALC INC 1983-2023

DESCRIPTION: 4" RETAINING AT CRAWL

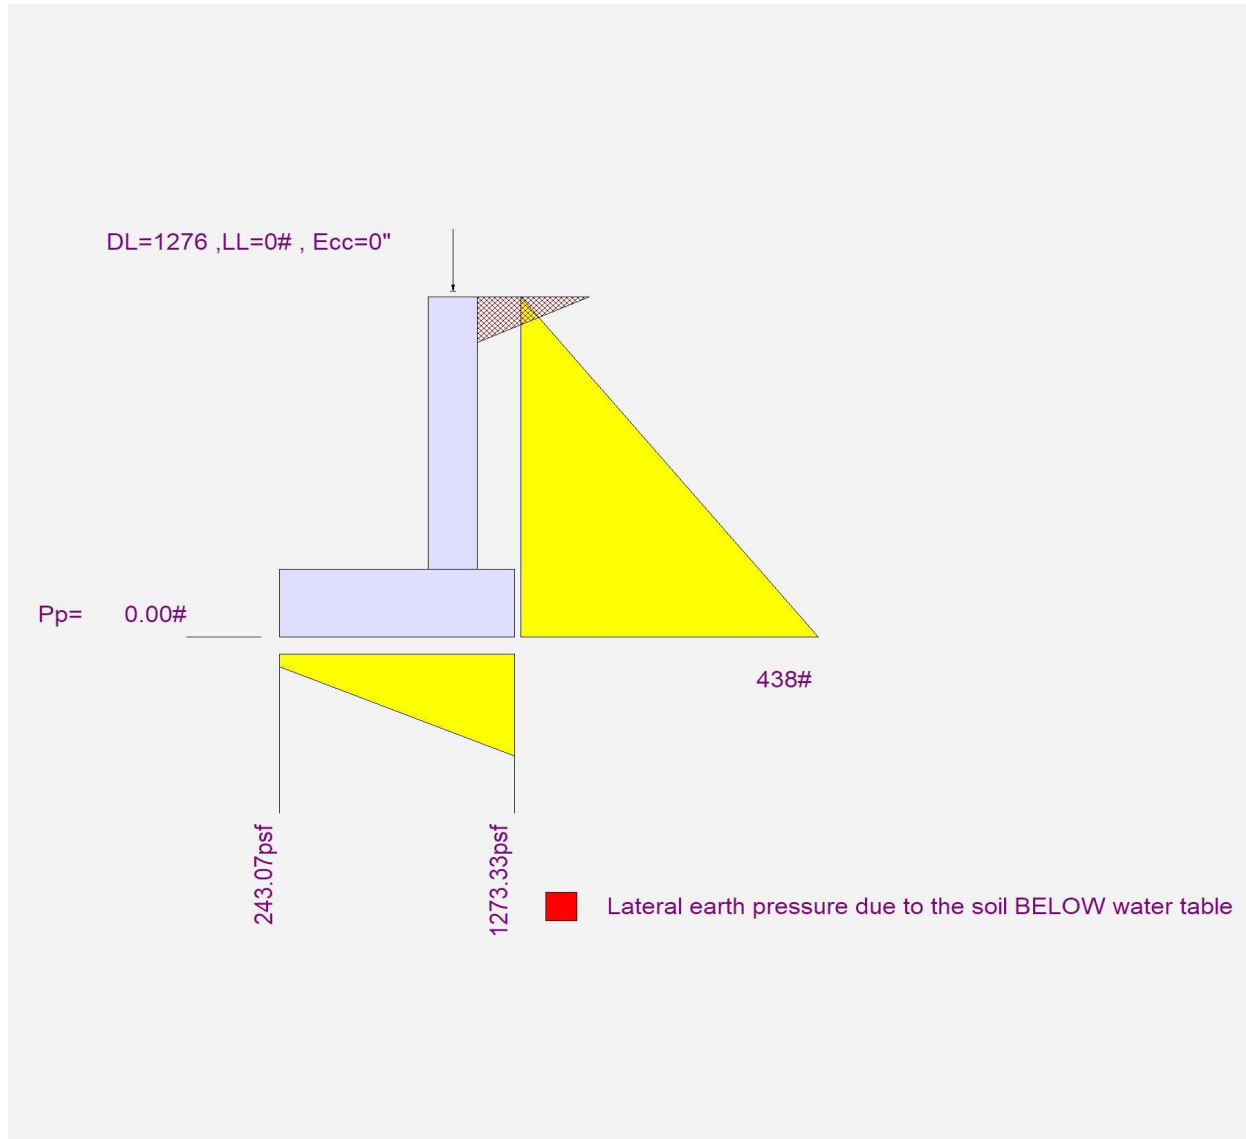

SAM + JUNE

EAST RETAINING WALLS

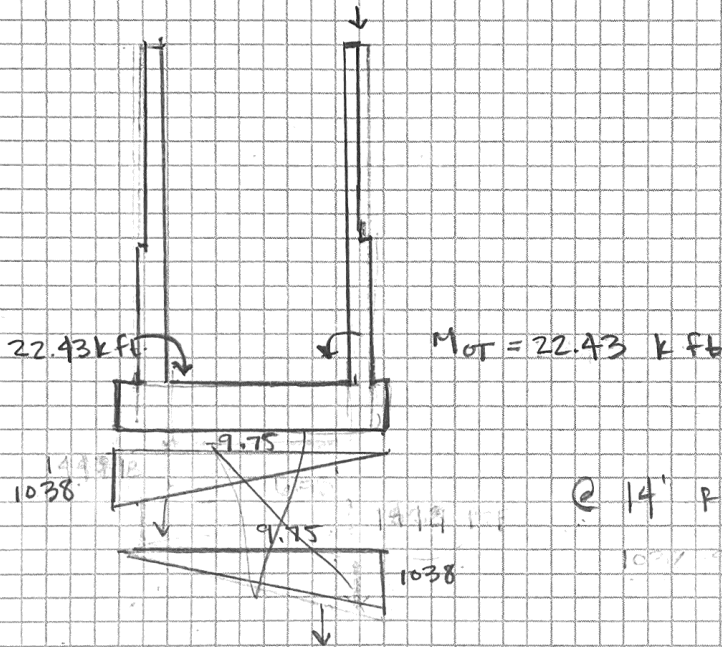

@ 14' RETAINING

$1038 \times 9.75 = 3230 \text{ lbs/ft}$

2" ϕ @ 12" oc

2"

EACH SIDE

@ 11.5' RETAINING

2875 lbs/ft

2" ϕ PINS - 6000 lbs/pin

11.5 FOOTING @ BACK OF BASEMENT

11"

M @ BASE = 19,149 lb ft.

MOMENT ARM = 5' 11"

T & C = 3234 lbs/ft

LOAD ABOVE. $w = 1540 \text{ lbs/ft}$

4774 lbs/ft

6000 lb/pin

@ 15" oc

@ SOUTH END

9.1K POINT LOAD ABOVE

@ 3320 lbs/ft @ DWALL

+ 3320 lbs/ft @ TOE

10' RETAINING WALL

W/OUT ADDITIONAL LOAD

2957 lbs/ft

@ TOE

@ 1'-4" FROM
EDGE OF TOE

@ NORTH END W/
LOADS ABOVE

3448.5

@ 1.83' FROM
EDGE

USE 2"φ @ 18"

@ 1'-4" FROM EDGE.

@ 4' RETAINING

W/ NO ADD'L LOAD

TOE HAS 874 lbs/ft.

PILES @ 6.86' oc

W/ ADD'L LOAD

HEEL HAS 1553 lbs/ft

@ 3.86' oc