

# Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This tool will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

Please complete the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please contact the WSU Energy Program at energycode@energy.wsu.edu or (360) 956-2042 for assistance.

### Project Information

Litchfield Residence  
 9001 SE 50th ST  
 Mercer island, WA 98040

### Contact Information

Brad Sturman - Sturman Architects  
 9 103rd Ave NE Suite 203  
 Bellevue, WA 98004

### Heating System Type:

All Other Systems  Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions"

### Design Temperature

[Instructions](#)

Bellevue

Design Temperature Difference ( $\Delta T$ )  
 $\Delta T = \text{Indoor (70 degrees)} - \text{Outdoor Design Temp}$

46

### Area of Building

#### Conditioned Floor Area

[Instructions](#)

Conditioned Floor Area (sq ft)

1,437

#### Average Ceiling Height

[Instructions](#)

Average Ceiling Height (ft)

8.4

Conditioned Volume  
 12,039

### Glazing and Doors

[Instructions](#)

U-0.28

**U-Factor X Area = UA**  
 0.280 X 196 = 54.88

### Skylights

[Instructions](#)

**U-Factor X Area = UA**  
 0.50 X [ ] = ---

### Insulation

#### Attic

[Instructions](#)

R-49

**U-Factor X Area = UA**  
 0.026 X 733 = 19.07

#### Single Rafter or Joist Vaulted Ceilings

[Instructions](#)

R-38 Vented

**U-Factor X Area = UA**  
 0.027 X 64 = 1.74

#### Above Grade Walls (see Figure 1)

[Instructions](#)

R-21 Intermediate

**U-Factor X Area = UA**  
 0.056 X 1,845 = 103.33

#### Floors

[Instructions](#)

R-38

**U-Factor X Area = UA**  
 0.025 X 567 = 14.17

#### Below Grade Walls (see Figure 1)

[Instructions](#)

Select R-value

**U-Factor X Area = UA**  
 No selection [ ] = ---

#### Slab Below Grade (see Figure 1)

[Instructions](#)

Select conditioning

**F-Factor X Length = UA**  
 No selection [ ] = ---

#### Slab on Grade (see Figure 1)

[Instructions](#)

R-10 Fully Insulated


**F-Factor X Length = UA**  
 0.360 X 120 = 43.20

### Location of Ducts

[Instructions](#)

Conditioned Space

**Duct Leakage Coefficient**  
 1.00

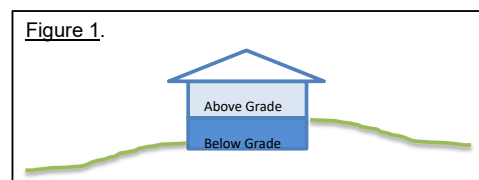

<b>Sum of UA</b>	236.39
<b>Envelope Heat Load</b>	10,874 Btu / Hour
<i>Sum of UA x <math>\Delta T</math></i>	
<b>Air Leakage Heat Load</b>	5,981 Btu / Hour
<i>Volume x 0.6 x <math>\Delta T</math> x 0.018</i>	
<b>Building Design Heat Load</b>	16,855 Btu / Hour
<i>Air leakage + envelope heat loss</i>	
<b>Building and Duct Heat Load</b>	16,855 Btu / Hour
<i>Ducts in unconditioned space: sum of building heat loss x 1.10</i>	
<i>Ducts in conditioned space: sum of building heat loss x 1</i>	
<b>Maximum Heat Equipment Output</b>	21,068 Btu / Hour
<i>Building and duct heat loss x 1.40 for forced air furnace</i>	
<i>Building and duct heat loss x 1.25 for heat pump</i>	