


STRUCTURAL CALCULATIONS FOR:

LABAN REMODEL

10 BROOK BAY RD
MERCER ISLAND, WA

ARCHITECT: FLOISAND ARCHITECT

APRIL 14, 2023



**MALSAM
TSANG**
STRUCTURAL
ENGINEERING

DESIGN CRITERIA IBC 2018

DEAD LOADS

FLAT ROOF		FLOOR		DECK FRAMING		MISC. LOADS	
Mbrne+Rig. Insul	2 psf	1/2" Flr Tile Fin.	7.0 psf	3/4" Porcel. Slab	10 psf		
3/4" Plywood	2.4 psf	1 1/4" Gypcrete	13 psf	3/4" Plywood	2.4 psf		
Truss @ 24" o.c.	3.0 psf	w/ hydro. tubing	-	2x @ 16" o.c	2.9 psf		
Gyp Board (5/8")	2.8 psf	3/4" Plywood	2.4 psf	Gyp Board (5/8")	2.8 psf		
MEP	1.5 psf	TJI @ 16" o.c.	2.3 psf	MEP	1.5 psf		
2x Slat Clg or	7.5 psf	Gyp Board (5/8")	2.8 psf				
Solar pan. (5psf)	-	MEP	1.5 psf				
(where occurs)							
Total	19.2 psf	Total	29.0 psf	Total	19.6 psf		
Use	20.0 psf (Typ. roof)	Use	30.0 psf	Use	20.0 psf		
Use	25.0 psf(w/ solar pan.)	Use	15.0 psf (for floor w/ no gypcrete topping)				

LIVE LOADS/OCCUPANCY

Risk Category	II	ROOF SNOW	FLOOR LIVE	DECK LIVE
Roof Deck	No	Snow+Rain surc= 30 psf	Occupancy = 40 psf	Occupancy = 60 psf
Common Access	No	Note: 5 psf rain on snow surc. added for 5deg or less	Stair/Corridor = 40 psf	

SEISMIC CRITERIA ASCE 7-16 Ch. 11 & Ch. 12

Imp. Factor = 1.00 Seismic Ht, hn= 22 ft
 Site Class = F T, Building= 0.2
 R Value = 6.5 Ts=

T = 0.2 < 0.5, Site resp. analysis not required

Geo. Ground Hazard? **Yes.**

S_s = 1.461 F_a = 1.000 Table 11.4-1
 S₁ = 0.507 F_v = NULL Table 11.4-2
 S_{ms} = 1.461 x 2/3 = S_{ds} = 0.974 Eqn. 11.4-3
 S_{m1} = NULL x 2/3 = S_{d1} = NULL Eqn. 11.4-4

C_{SULT} = 0.150
 C_{SALL} = 0.105

T/Ts= #####

SEISMIC WEIGHT ASCE 7-16 12.7.2

Partitions = 15 psf
 *Roof weight = 1/2 Partition + Roof DL
 *Floor weight = Full Partition + Floor DL

FLAT ROOF 27.0 psf
 FLOOR 44.0 psf

SEISMIC DESIGN CATEGORY IBC 1613.2.5

Seismic DC = D See IBC 1613.2.2

WIND CRITERIA ASCE 7-16 Ch. 27 Directional Procedure

V = 97 mph K_d = 0.85
 Exposure = C G = 0.85
 h = 28 ft K_{zt} = 1.00

Roof Slope = FLAT : 12 = 0°

PRESSURE COEFFICIENTS (Cp)

Windward Wall = 0.8 Windward Roof = N/A
 Leeward Wall = -0.5 Leeward Roof = N/A

PRESSURE (PSF) q = 0.00256K _z K _{zt} K _d V ²								
Ht	K _z	q _z	0.6xq _z ¹	q _h	P _{WW}	P _{LW}	P _{WALL}	P _{ROOF}
0-15	0.85	17.4	10.4		7.1	5.1	12.2	
15-20	0.90	18.4	11.1		7.5	5.1	12.6	
20-25	0.94	19.2	11.5		7.9	5.1	13.0	
25-30	0.98	20.1	12.0	12.0	8.2	5.1	13.3	N/A
30-35	1.02	20.9	12.5		8.5	5.1	13.6	
35-40	1.04	21.3	12.8		8.7	5.1	13.8	
40-45	1.07	21.9	13.1		8.9	5.1	14.1	
45-50	1.09	22.3	13.4		9.1	5.1	14.2	

¹ Per IBC 2018 1605.3.1 Basic Load Combinations



122 South Jackson
 Suite 210
 Seattle, WA 98104
 t 206.789.6038
 f 206.789.6042

LABAN REMODEL
 Project
 10 BROOK BAY RD
 MERCER ISLAND, WA


4/12/2023
 Date
 0189-2022-03-01
 Proj. No.
 JCM
 Design
 DC1
 Sheet



Laban Remodel

10 Brook Bay Rd, Mercer Island, WA 98040, USA

Latitude, Longitude: 47.5525473, -122.2319333

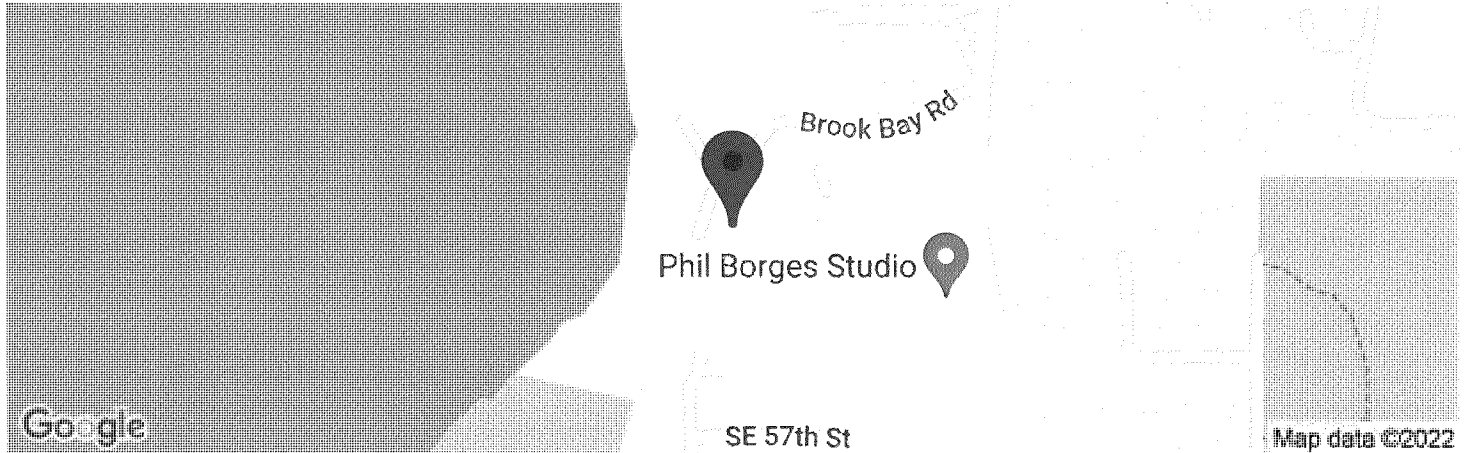


Date	4/6/2022, 3:41:10 PM
Design Code Reference Document	ASCE7-16
Risk Category	II
Site Class	D - Default (See Section 11.4.3)

Type	Value	Description
S _S	1.461	MCE _R ground motion. (for 0.2 second period)
S ₁	0.507	MCE _R ground motion. (for 1.0s period)
S _{MS}	1.753	Site-modified spectral acceleration value
S _{M1}	null -See Section 11.4.8	Site-modified spectral acceleration value
S _{DS}	1.169	Numeric seismic design value at 0.2 second SA
S _{D1}	null -See Section 11.4.8	Numeric seismic design value at 1.0 second SA

Type	Value	Description
SDC	null -See Section 11.4.8	Seismic design category
F _a	1.2	Site amplification factor at 0.2 second
F _v	null -See Section 11.4.8	Site amplification factor at 1.0 second
PGA	0.626	MCE _G peak ground acceleration
F _{PGA}	1.2	Site amplification factor at PGA
PGA _M	0.751	Site modified peak ground acceleration
T _L	6	Long-period transition period in seconds
SsRT	1.461	Probabilistic risk-targeted ground motion. (0.2 second)
SsUH	1.62	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration
SsD	4.172	Factored deterministic acceleration value. (0.2 second)
S1RT	0.507	Probabilistic risk-targeted ground motion. (1.0 second)
S1UH	0.564	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration.
S1D	1.621	Factored deterministic acceleration value. (1.0 second)
PGAd	1.398	Factored deterministic acceleration value. (Peak Ground Acceleration)
C _{RS}	0.902	Mapped value of the risk coefficient at short periods
C _{R1}	0.898	Mapped value of the risk coefficient at a period of 1 s

Search Information

Address: Mercer Island, WA 98040, USA
Coordinates: 47.5706548, -122.2220673
Elevation: 339 ft
Timestamp: 2022-04-06T22:52:03.332Z
Hazard Type: Wind

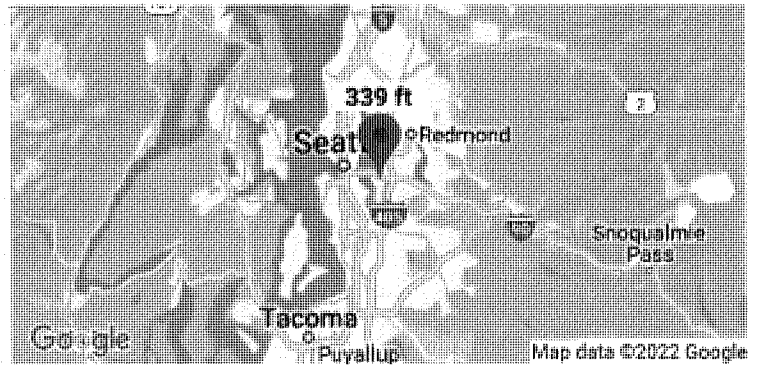

ASCE 7-16

MRI 10-Year 67 mph
 MRI 25-Year 73 mph
 MRI 50-Year 78 mph
 MRI 100-Year 83 mph
 Risk Category I 92 mph
 Risk Category II 97 mph
 Risk Category III 104 mph
 Risk Category IV 108 mph

ASCE 7-10

MRI 10-Year 72 mph
 MRI 25-Year 79 mph
 MRI 50-Year 85 mph
 MRI 100-Year 91 mph
 Risk Category I 100 mph
 Risk Category II 110 mph
 Risk Category III-IV 115 mph

ASCE 7-05

ASCE 7-05 Wind Speed 85 mph

The results indicated here DO NOT reflect any state or local amendments to the values or any delineation lines made during the building code adoption process. Users should confirm any output obtained from this tool with the local Authority Having Jurisdiction before proceeding with design.

Disclaimer



Hazard loads are interpolated from data provided in ASCE 7 and rounded up to the nearest whole integer. Per ASCE 7, islands and coastal areas outside the last contour should use the last wind speed contour of the coastal area – in some cases, this website will extrapolate past the last wind speed contour and therefore, provide a wind speed that is slightly higher. NOTE: For queries near wind-borne debris region boundaries, the resulting determination is sensitive to rounding which may affect whether or not it is considered to be within a wind-borne debris region.

Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind conditions.

While the information presented on this website is believed to be correct, ATC and its sponsors and contributors assume no responsibility or liability for its accuracy. The material presented in the report should not be used or relied upon for any specific application without competent examination and verification of its accuracy, suitability and applicability by engineers or other licensed professionals. ATC does not intend that the use of this information replace the sound judgment of such competent professionals, having experience and knowledge in the field of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the results of the report provided by this website. Users of the information from this website assume all liability arising from such use. Use of the output of this website does not imply approval by the governing building code bodies responsible for building code approval and interpretation for the building site described by latitude/longitude location in the report.

Mercer Island Wind Exposure and Wind Speed-Up (Topographic Effect)

by Development Services Group (DSG), City of Mercer Island
April 2009

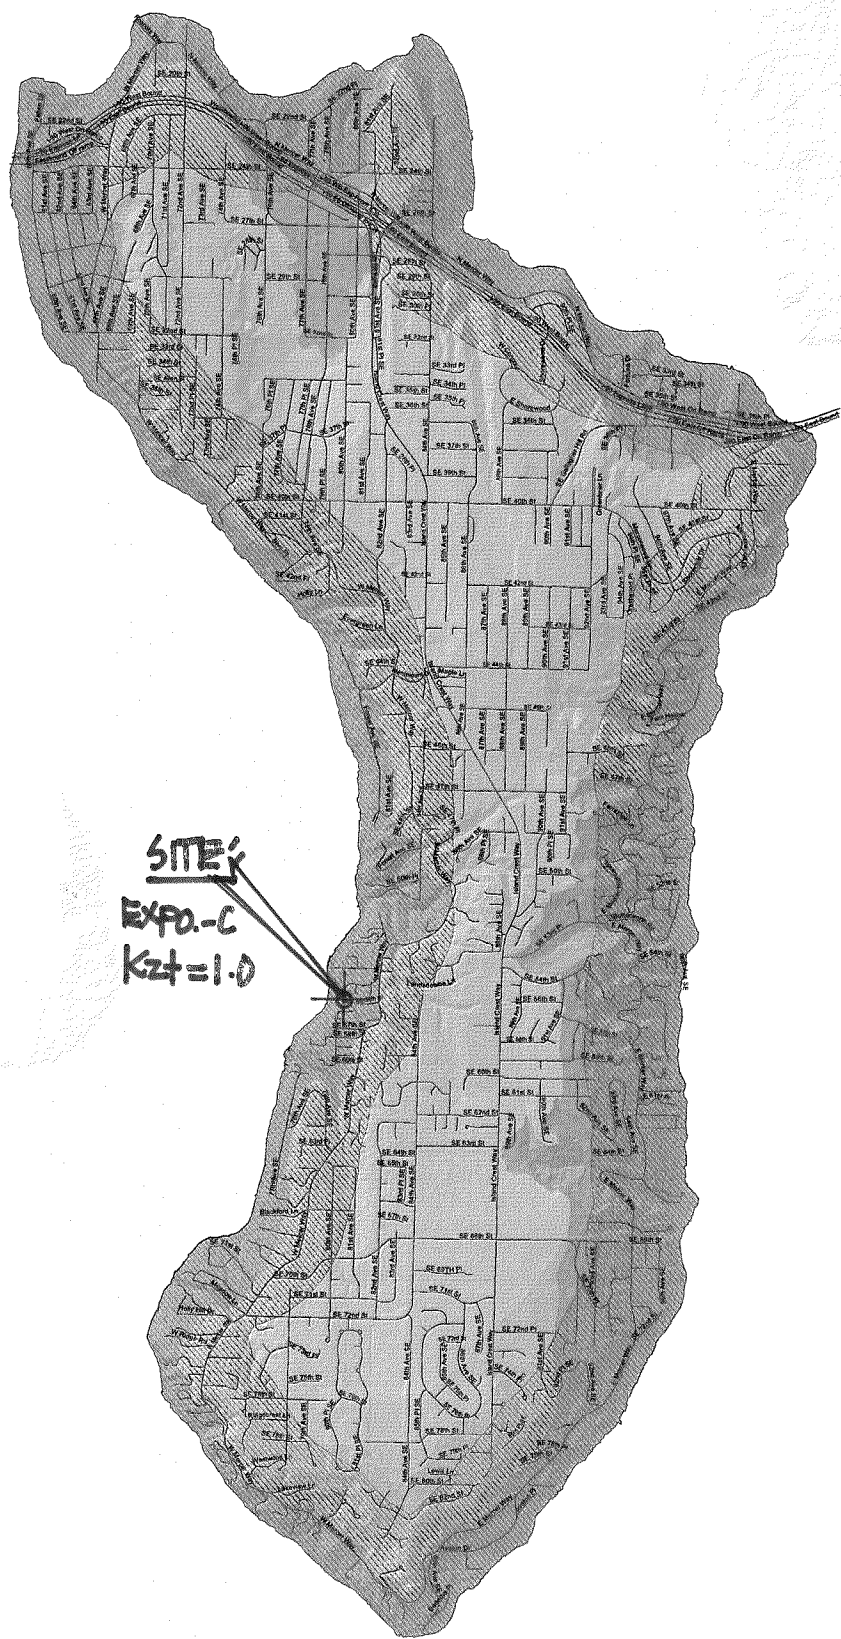

WIND EXPOSURE CATEGORIES & WIND SPEED-UP FACTORS (ICC Section 1609 & ASCE 7-05 Chapter 6)

It is the responsibility of the Owner (or their Design Professional) to review site conditions and determine the Kzt factor to be utilized for each specific project. The Kzt factors and wind exposure categories indicated on this map are the minimum values accepted by the City of Mercer Island without requiring the design professional to submit additional calculations and supporting topographic documentation (to verify the values utilized in their wind load determination).

Please note - The Kzt values indicated on this map are approximations based upon periodic calculations of representative samplings around Mercer Island. These values are intended for City of Mercer Island's plan review purposes only.

WIND EXPOSURE CATEGORIES:

Wind Exposure Category		Exposure 'C' (1500 feet from Lake)
		Exposure 'B' (all other areas)

WIND SPEED-UP (TOPOGRAPHIC EFFECT) - Kzt Factor:

Kzt Factor		Kzt = 1.0
		Kzt = 1.3
		Kzt = 1.6
		Kzt = 1.9

GENERAL NOTES FOR WIND EXPOSURE AND WIND SPEED-UP MAP

The map is the Wind Exposure Category and Wind Speed-up (Topographic Effects) Map for the City of Mercer Island. The map shows the minimum wind exposure category and the minimum wind speed-up, "Kzt" factor, which will be accepted without site specific documentation and calculation.

Other wind speed phenomena may occur on Mercer Island that is not specifically identified on this map. It is the responsibility of the Owner (or their Design Professional) to review site conditions and determine the appropriate design wind speed and exposure category for their specific project and location.

The map is for the sole use of the staff of the City of Mercer Island's Development Services Group (DSG) for the purposes of permit application evaluation. This map provides DSG staff a general assessment of Wind Exposure Category and Wind Speed-up (Topographic Effects). All areas have not been specifically evaluated and there may be locations that are not correctly represented on this map. It is the responsibility of individual property owners and map users to evaluate risk associated with their proposed development. No site-specific assessment of risk is implied or otherwise indicated by the City of Mercer Island with this map.

Information about data used for the map, references, and data limitation are all described in the associated "Read Me" document. The digital version of this map is accompanied by a meta data file containing pertinent information about map construction. This data map is available on the City of Mercer Island website.

The City of Mercer Island is using guidance provided within ICC Section 1609 & ASCE 7-05 Chapter 6 regarding definitions used when creating this map.


DEFINITIONS:

Kzt factor: The topographic effect of wind speed-up at isolated hills, ridges, and escarpments constituting abrupt changes in the general topography, located in any exposure category, that meet all of the conditions noted in ASCE 7-05 Minimum Design Loads for Buildings and Other Structures, Section 6.5.7.

Exposure B: The wind exposure category that applies where the site in question is located a minimum of 1500 feet from the shoreline and the mean roof height is less than or equal to 30 feet per IBC 2006 section 1609.4.3.

Exposure C: The wind exposure category that applies where the site in question is located within 1500 feet from the shoreline per IBC 2006 section 1609.4.3.


Wind Speed: Minimum 65 mph 3-second gust per IRC Figure R301.2(4)

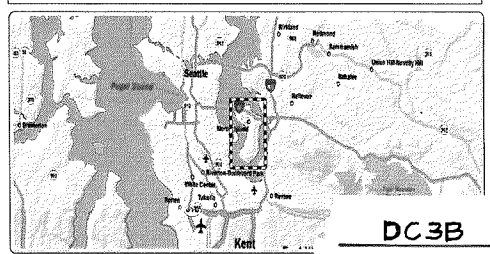


TYPICAL BEAM CASES

*ASSUME CASE 1 FOR ALL BEAMS U.N.O.


CASE #1: (C1)

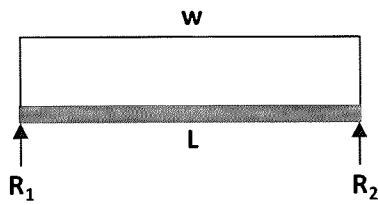


CASE #5: (C5)

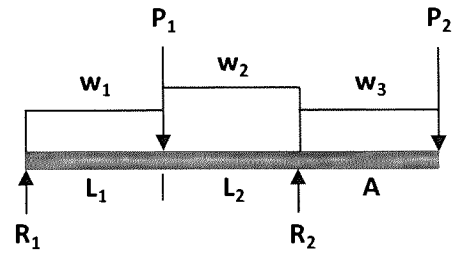


CASE #2: (C2)

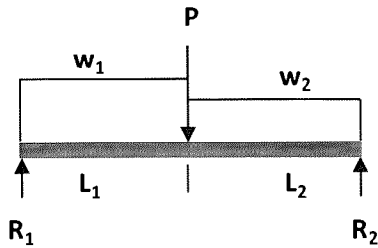


CASE #6: (C6)

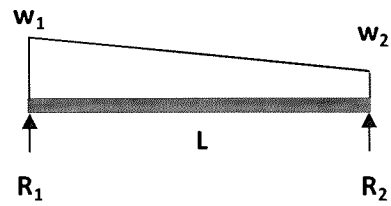


CASE #3: (C3)

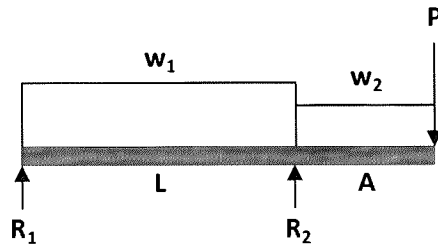

CASE #7: (C7)

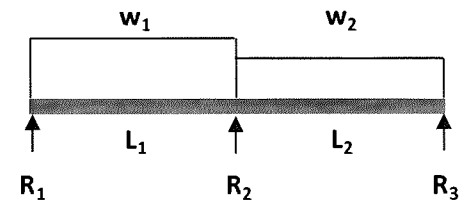

CASE #4: (C4)

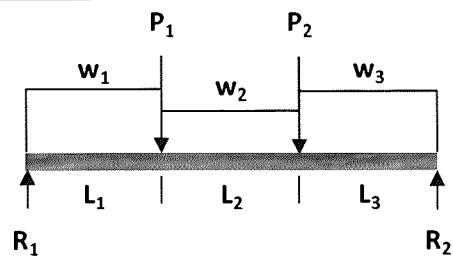

122 South Jackson
Suite 210
Seattle, WA 98104
t 206.789.6038
f 206.789.6042

LABAN REMODEL

Project

10 BROOK BAY RD

MERCER ISLAND, WA

4/7/2022

Date

0189-2022-03-01

Proj. No.

JCM

Design

DC4

Sheet

LATERAL ANALYSIS AND DESIGN :

0. WIND ANALYSIS ; BOTH DIRECTIONS:

LEVEL	TRIB. HT. (FT.)	V _{WIND LOAD - FULL (ALLOW)}	V _{WINDWARD LOAD (ALLOW)}
ROOF DIAP.	$\sim 4 + 11/2 = 9.5'$	$= 13.0 \times 5' + 12.6 \times 4.5' = 122\%$	$= 7.9 \times 5' + 7.5 \times 4.5' = 73.50\%$
UPPER FLOOR DIAP.	$11/2 + 1 + 9/2 = 11.0'$	$= 12.6 \times 0.5' + 12.2 \times 10.5' = 134.5\%$	

↓ PULL WIND ABV. MAIN FLR
 WINDWARD C BSMT WALL
 $= 12.6 \times 0.5' + 12.2 \times 5' + 7.1 \times 5.5' = 106.4\%$

0 SEISMIC ANALYSIS :

LEVEL	AREA (SQ)	WT. (K)	HT. (FT.)	W _i H _i (K-FT)	DISTRIB.	PER 12.13 E.I.F.D V DIAP. FORCE ALLOW	INERTIAL DIAP. FORCE PER 12.10; ER. 12.10-2 F _x = 0.25 S _v I _e × W _i = 0.139 W _i F _x
ROOF DIAP.	2420	64.0	19	1215	0.59	9.70	8.90
MAIN FLOOR DIAP.	1885 × 43.5 + 545 × 20.0	82 + 10.9 = 92.9	9	835	0.41	6.80	11.4 + 1.5 = 12.9
		Σ WT = 156.9	Σ = 2050				

$$V_{Sx \text{ ULTIM.}} = 0.150 (156.9) = 23.50 \text{ KIPS}$$

$$V_{Sx \text{ ALLOW.}} = 0.105 (156.9) = 16.50 \text{ KIPS}$$



122 SOUTH JACKSON ST
SUITE 210
SEATTLE, WA 98104
T 206.789.6038
MALSAM-TSANG.COM

LABAN REMODEL

PROJECT

4/18/22

DATE

0189-2022-03

PROJECT NO

JCM

DESIGN

L-1

SHEET


② LATERAL DESIGN :

1 NORTH-SOUTH (FRONT-BACK) DIREC.; SEISMIC LOAD IN PARENTHESIS :

ROOF DIAP. / MAIN FLR. SW; (S1.3) :

IT = 11'


R (K) :
 l (ft) :
 V (RF) :
 SW :
 DT (K) :
 HD :
 H/L :

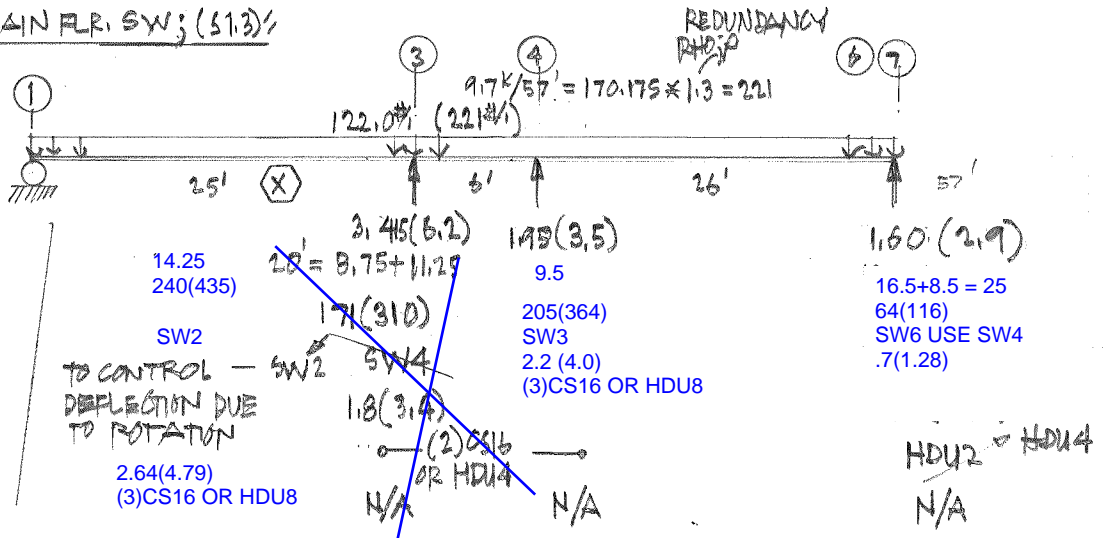

MAIN FLR. DIAP. / LOWER FLR. SW; (S1.2) :

IT = 9'

R :
 l :
 V :
 SW :
 DT :
 HD :
 H/L :

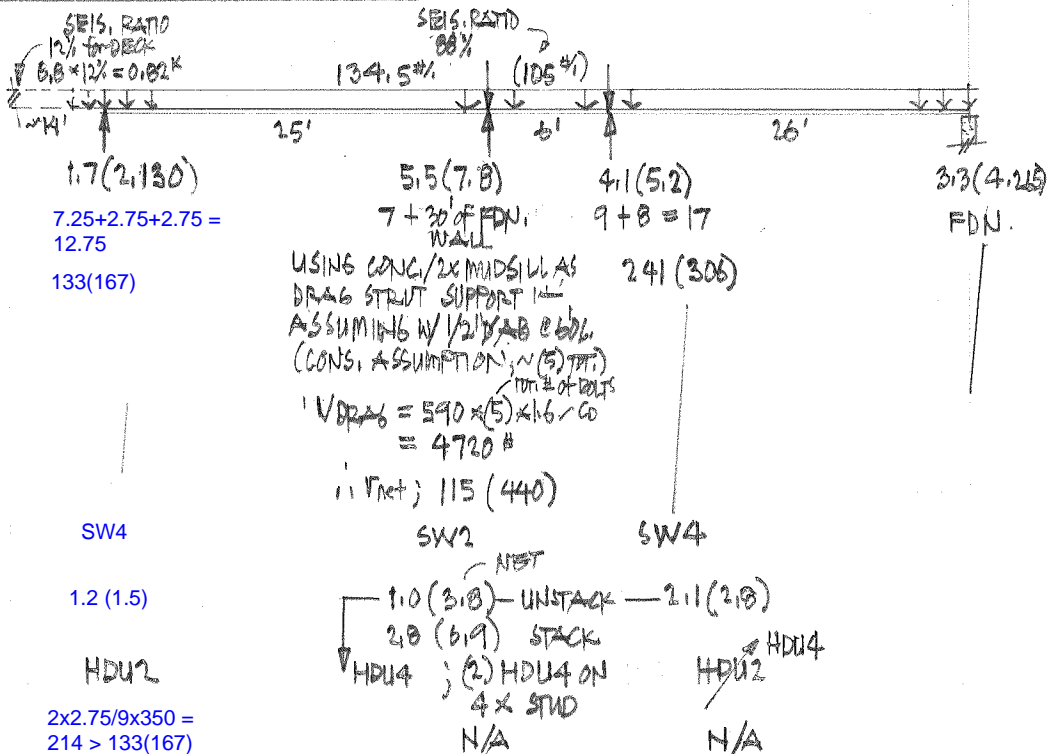

(X) CHORD FORCE CHK. DUE TO ROTATION (OPEN FRONT) :

$$C/T = 221.0 \text{ k} \times 25^2 / 2 \div 50' \times 1.25 \text{ } 25\% \text{ INCR.}$$

$$= 1725 \text{ k} \leftarrow \text{TO GRIDLINE-A/E} \text{ --- SHOULD BE COMPARED TO EAST/WEST DIRECTION LOADING.}$$



122 SOUTH JACKSON ST
 SUITE 210
 SEATTLE, WA 98104
 T. 206.789.6038
 MALSAM-TSANG.COM

PROJECT LABAN REMODEL


DATE 4/18/22
 PROJECT NO 0129-2022-03
 DESIGN JCM
 SHEET L-2

EAST - WEST (SIDE-SIDE) DIRECTION:


NOTE: $P = 1.0$ THIS ORTHO. DIRECTION

ROOF DIAP./ MAIN FLR. SW (S1.3):

$FE = 11'$

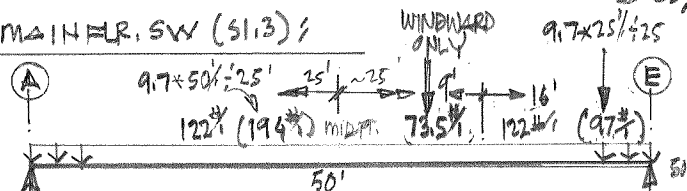


R :	3.05 (4.85)	NOTE: $2425^{\#} > 1725^{\#}$ (FRONT SHED)	2.615 (2.425)
L :	$7.5 + 4.75 + 9.25 = 21.5'$	NOT CRIT. ?	17
V :	142 (226)	FROM LOAD DUE TO ROTATION	143 (154)
SW :	SW3	SW4 OK USE SW3	SW3
DT :	1.56 (2.48)		1.57 (1.7)
HD :	(2) C616 OR MSTC4B33		HDU2 #DU4
H/L :	$2 \times 4.75/11 \times 350 = 302 > 142(226)$		N/A

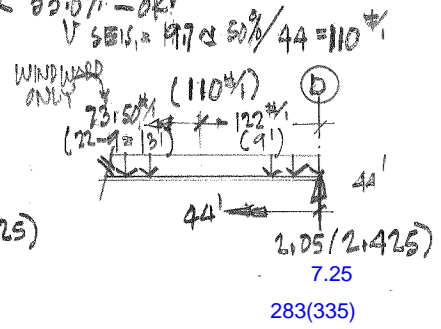


MAIN FLR. DIAP./ LOWER FLR. SW (S1.2):

$FE = 9'$


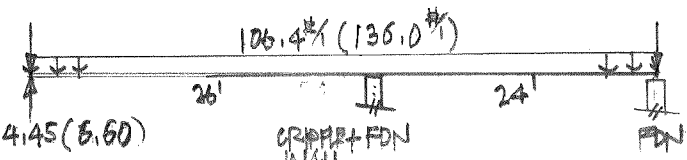


R :	4.45 (6.60)	
L :	$7.83 + 4 = 11.83$	CRIPPLE FDN WALL
V :	376 (559)	
SW :	SW3-2	HDU5 @ GAR FRONT SW CORNER - GRID-A/4
DT :	UNSTACK: 3.3 (5.0)	5.4 (8.3); STACK
HD :	HDU/4	NET UPLIFT - GAR, FRONT SW AT DOOR EDGE: $3.3 - 1.9 (5 - 2.85)$ $1.4 (2.15) - \text{STACK}$
H/L :	$(450 \times 2) 2 \times 4/9 = 800^{\#} > 559^{\#} - \text{OK?}$	NET UPLIFT - DEN NORTH SW AT WINDOW EDGE (STACK): $3.3 + 1.05 (5 + 1/3)$ $4.35 (6.3) - \text{STACK}$

ANAL. OF SW SEG. ALONG GAR FRONT'S

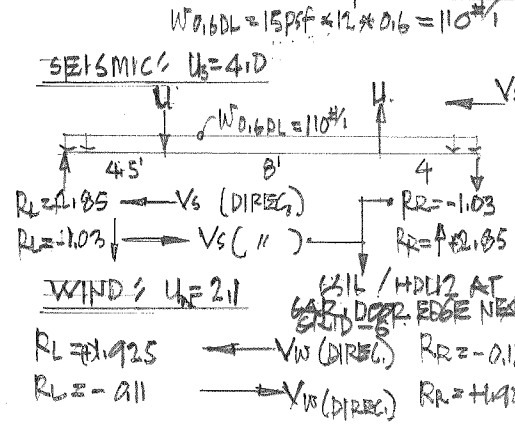

ANAL. OF SWI SEG. ALONG DEN NO. WALL'S

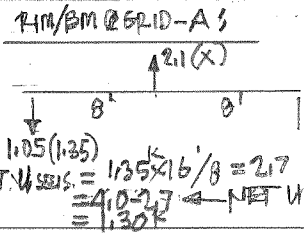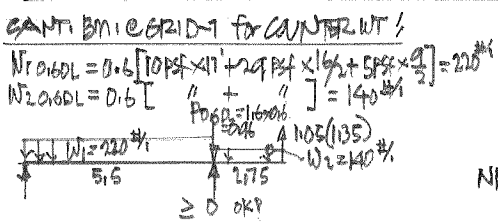

122 SOUTH JACKSON ST
SUITE 210
SEATTLE, WA 98104
T 206.789.6038
MALSAM-TSANG.COM

LABAN REMODEL

PROJECT

DATE: 4/18/22
PROJECT NO: 0109-2022-03
DESIGN: JCM
SHEET: L-3

VERTICAL ANALYSISROOF FRAMING (S.I.3)

DL = 25 PSF LL = 30 PSF

#301 - CHECK "B3" - PSL 5 1/4 x 11 7/8

L = 3.5'

W = 18/2 x .055 = .495 k

R = 0.87 k

M = 0.76 k-ft

$f_b = 1.07 \text{ ksi}$

$f_v = 9 \text{ psi}$

$\Delta = 4/1000 +$

#302 - CHECK CANT. "B3" BM (C3)

L = 12'

A = 2.5'

W₁ = W₂ = .055 k

P = 2.23 k

R₁ = 0

R₂ = 3.18 k

M = -5.75 k-ft

$f_b = -.53 \text{ ksi}$

$f_v = 53 \text{ psi}$

A = .074'

= 4807

#303 - CHECK BM AT SKYLIGHT "B3"

L = 14.75'

W = 15/2 x .055 = .413 k

R = 3.0 k

M = 11.23 k-ft

$f_b = 1.04 \text{ ksi}$

$f_v = 60 \text{ psi}$

A = .318'

= 4556

#304 - CHECK CANTILEVER GLB 5 1/2 x 19 1/2 (C3)

L = 8' A = 3.5'

W₁ = 22 1/2 x .055 = .605 k

W₂ = 16 1/2 x .055 = .44 k

P = 1.0 k

R₁ = 1.6 k

R₂ = 5.7 k

M = -6.24 k-ft

$f_b = 7.21 \text{ ksi}$

$f_v = 31 \text{ psi}$

$\Delta = 4/1000 +$

#305 - CHECK "B2" RIM/BM

L = 3.75'

W = 30.5/2 x .055 = .839 k

R = 1.57 k

M = 1.47 k-ft

$f_b = .2 \text{ ksi}$

$f_v = 27 \text{ psi}$

$\Delta = 4/1000 +$

#306 - CHECK "B3" BM/RIM (C2)

L₁ = 6.25

L₂ = 7.25

W₁ = W₂ = (10/2 + 1) x .055 = .335 k

P = 3.35 k

R₁ = 4.03 k

R₂ = 3.78 k

M = 18.72 k-ft

$f_b = 1.82 \text{ ksi}$

$f_v = 89 \text{ psi}$

A = .37'

= 4439

#307 - CHECK 5 1/2 x 15 BM

L = 15.75'

W = 31.25/2 x .055 = .86 k

R = 6.77 k

M = 26.67 k-ft

$f_b = 1.55$

$f_v = 103$

A = .428'

= 4442

**MALSAM
TSANG**
STRUCTURAL
ENGINEERING122 SOUTH JACKSON ST
SUITE 210
SEATTLE, WA 98104
T 206.789.6038
MALSAM-TSANG.COM

LABAN REMODEL

PROJECT

10 BROOK BAY

DATE

0189.2022.03

PROJECT NO

JRF

DESIGN

VI

SHEET

VERTICAL ANALYSIS

#308 - TRELLIS BEAM C9x20

$L = 14.75'$	$f_b = 10.3 \text{ ksi}$
$W = (10/2 + 2.75) \times .055 = .426$	$f_v = 0.78 \text{ ksi}$
$R = 3.14''$	$A = .257$
$M = 11.59 \text{ k}\cdot\text{ft}$	$= 4689$

#309 - GL 5 1/2 x 18 @ GR101

$L = 16'$	$f_b = 0.87$
$W = 24.5/2 \times .055 = .674''$	$f_v = .66$
$R = 5.39''$	$A = 0.21''$
$M = 21.57 \text{ k}\cdot\text{ft}$	$= 4930$

#310 - WEST TRELLIS BM C15x33.9

$L = 15.5'$	$f_b = 3.54 \text{ ksi}$
$W = 15/2 \times .055 = .413''$	$f_v = .53 \text{ ksi}$
$R = 3.2''$	$A = .06''$
$M = 12.4 \text{ k}\cdot\text{ft}$	$= 43170$

CHECK TRELLIS FRAMING

(WEST)

$L = 14'$	$f_b = 0.91 \text{ ksi}$
$W = 0.114''$	$f_v = 44 \text{ psi}$
$R = 0.77''$	$A = 0.36''$
$M = 2.7 \text{ k}\cdot\text{ft}$	$= 4466$

3x10 DF #1

(SOUTH)

$L = 10'$	$f_b = 0.75 \text{ ksi}$
$W = 0.114''$	$f_v = 40 \text{ psi}$
$R = 0.55''$	$A = 0.19''$
$M = 1.38 \text{ k}\cdot\text{ft}$	$= 4615$

3x8 DF #1



122 SOUTH JACKSON ST
SUITE 210
SEATTLE, WA 98104
T 206.789.6038
MALSAM-TSANG.COM

LABAN REMODEL

PROJECT

10 BROOK BAY

DATE

01/29/2022.03

PROJECT NO

JRF

DESIGN

V2

SHEET

(sheet V3 not used)

○ MAIN FLOOR FRMS, ; (S1.2) — #200's!

201 & #202 — 14' TJI F.J. E16" C

↳ DL = 30 PSF ; LL = 40 PSF
SEE FORTR WEB OUTPUT

203 — RIM/BEAM o/ GAR. DOOR : (C-4)

$\lambda_1 = 4.5$; $\lambda_2 = 7.5$; $\lambda_3 = 4.5$
 $W_1 = 15 \text{ PSF} \times 15' = 0.1225$
 $P_1 = P_2 = U_w \text{ OR } U_{WS}$; $U_w = 2.1$ ASCE 21.4.5
 $= 7.85$ Eqn-9
 $U_{WS} = 4.0 \times R_0$
 $= 4.0 (0.625 \times 2.5 \times 1.4)$
 $= 7.35$ — governs
 $R_1 = 5.2$
 $R_2 = -1.48$
 $M = 2.11$
 $F_v = 101$
 $F_b = 1.477$ — OK, B3-PSL 5/4 x 14

204A — B2 FB UNDER STAIR LANDING :

$\lambda = 9'$; $W = (30+40) 15/2 = 0.525 \text{ K/1}$
 $R = 2.36$ < MBMU CAP. = 4.1 K — OK
 $M = 5.32$
 $F_v = 54$
 $F_b = 0.156$
 $\Delta T_L = 0.061'' \sim \lambda / 1728$ — OK

205 — CANT. B3 BM. o/ ENTRY GRID-3 :

$\lambda_1 = 6$; $\lambda_2 = 2$; $A = 3'$ (C-5)
 $P_1 = 15 \times 15 \times 6/2 = 0.68$
 $P_2 = 15 \times 15 \times 9/2 = 1.10$
 $W_1 \pm W_2 = (30+40) 9/2 + 15 \times 11 = 480 \text{ #/1}$
 $W_3 = (70) \times 9/2 + 15 \times 11 + (25 \times 25) 2 1/2 = 1105 \text{ #/1}$
 NOTE : d eff. used c cant. $\approx 11.25''$ — OK
 $R_1 = 1.05$; $R_2 = 7.9$
 $M_+ = 1.16$; $M_- = -8.3$
 $F_v = 86$
 $F_b = -0.90$
 $\Delta T_L \text{ END} = 0.068'' \sim 2A/1051$ — OK

206 — LAUNDRY RM. HDR :

$\lambda = 4.25$; $W = (30+40) 25/2 = 875 \text{ #/1}$
 $R = 1.97$ NOT USED
 $M = 2.2$
 $F_v = 85$
 $F_b = 0.87$
 $\Delta T_L = 0.045'' \sim \lambda / 1190$ — OK, 4x8

207 — B3 BEAM o/ OPENING BTWN ROOMS :

$L = 12'$
 $W = 25/2 \times .07 = .875$
 $R = 5.25$
 $M = 15.75$
 $F_b = 1.46$
 $F_v = 101$
 $\text{DEFL} = .3'' = L/487$

208 — B3 FB o/ BATH RM. 106 :

$L = 8.75'$; $W = 25/2 \times .07 = .875$
 $R = 3.83$; $M = 8.37$
 $F_b = 1.22$
 $F_v = 107$
 $\text{DEFL} = .15'' = L/689$

209 — CHK W 8 x 21 o/ ENTRY :

(C-2) $I_x = 75.3$; $d = 8 1/4''$
 $S_x = 18.2$; $bf = 5 1/4''$
 $\lambda_1 = 9$; $\lambda_2 = 6$; $P = 0$
 $W_1 = (40) 3/2 = 60 \approx 100$ NOT USED
 $W_2 = (40) 8/2 = 160$
 $R_1 = 0.82$; $R_2 = 1.04$
 $M = 3.4 \times 12 = 40.8$
 $S_x \text{ REQD} = 114$ — N/CRT
 $\Delta T_L = 0.062'' \sim \lambda / 2861$ — OK

204B — B3 FB TO REPLACE BM/POST/STAIR FB :

$\lambda = 9'$; $W = (30+40) 25/2 = 875 \text{ #/1}$
 $R = 3.94$
 $M = 8.85$
 $F_v = 60$
 $F_b = 0.62$
 $\Delta T_L = 0.05'' \sim \lambda / 2007$ — OK



122 SOUTH JACKSON ST
 SUITE 210
 SEATTLE, WA 98104
 T 206.789.6038
 MALSAM-TSANG.COM

LABAN REMODEL

PROJECT


DATE 4/10/22

PROJECT NO 0189-2022-03

DESIGN JCM

SHEET V-4A

Floor, #201 Floor Joist
1 piece(s) 14" TJI@ 230 @ 16" OC

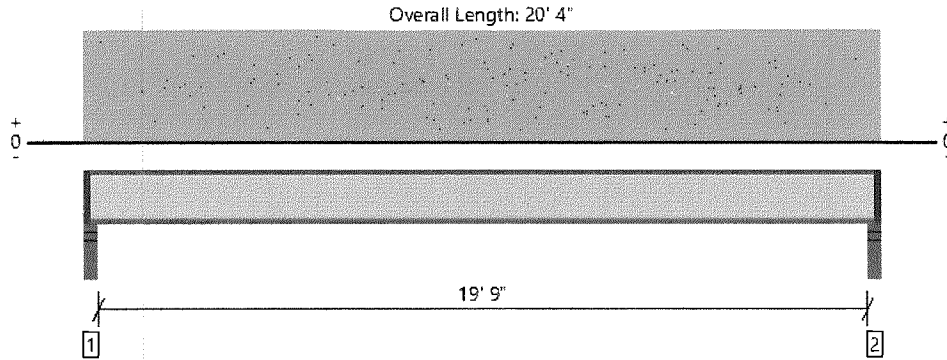

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load: Combination (Pattern)
Member Reaction (lbs)	935 @ 2 1/2"	1060 (1.75")	Passed (88%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	922 @ 3 1/2"	1945	Passed (47%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	4628 @ 10' 2"	4990	Passed (93%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.349 @ 10' 2"	0.498	Passed (L/685)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.611 @ 10' 2"	0.996	Passed (L/391)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	41	40	Passed	--	--

System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - DF	3.50"	1.75"	1.75"	407	542	949	1 3/4" Rim Board
2 - Stud wall - DF	3.50"	1.75"	1.75"	407	542	949	1 3/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	4' 2" o/c	
Bottom Edge (Lu)	20' 1" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 20' 4"	16"	30.0	40.0	Default Load

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator


ForteWEB Software Operator	Job Notes
Joseph Marquez Malsam-Tsang Engineering (206) 602-5122 JosephM@malsam-tsang.com	



4/18/2022 4:34:05 AM UTC
 ForteWEB v3.2, Engine: V8.2.0.17, Data: V8.1.0.16

File Name: Joist

Floor, #202 Floor Joist
1 piece(s) 14" TJI@ 210 @ 16" OC

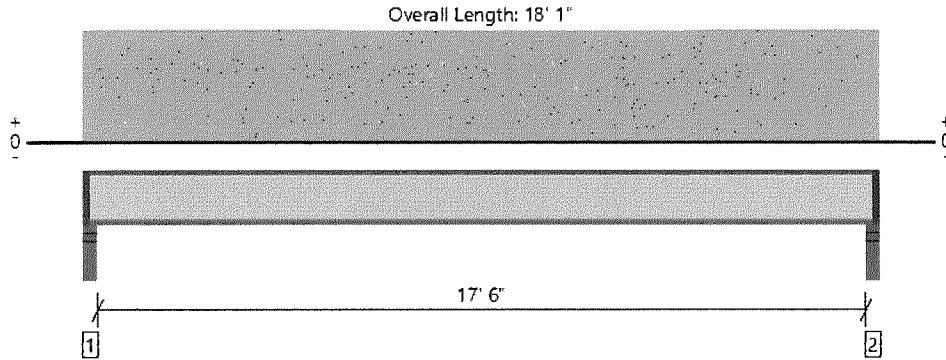

All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.

Design Results	Actual @ Location	Allowed	Result	LDf	Load: Combination (Pattern)
Member Reaction (lbs)	830 @ 2 1/2"	1005 (1.75")	Passed (83%)	1.00	1.0 D + 1.0 L (All Spans)
Shear (lbs)	817 @ 3 1/2"	1945	Passed (42%)	1.00	1.0 D + 1.0 L (All Spans)
Moment (Ft-lbs)	3641 @ 9' 1/2"	4490	Passed (81%)	1.00	1.0 D + 1.0 L (All Spans)
Live Load Defl. (in)	0.240 @ 9' 1/2"	0.442	Passed (L/884)	--	1.0 D + 1.0 L (All Spans)
Total Load Defl. (in)	0.419 @ 9' 1/2"	0.883	Passed (L/505)	--	1.0 D + 1.0 L (All Spans)
TJ-Pro™ Rating	48	40	Passed	--	--

System : Floor
 Member Type : Joist
 Building Use : Residential
 Building Code : IBC 2018
 Design Methodology : ASD

- Deflection criteria: LL (L/480) and TL (L/240).
- Allowed moment does not reflect the adjustment for the beam stability factor.
- A structural analysis of the deck has not been performed.
- Deflection analysis is based on composite action with a single layer of 23/32" Weyerhaeuser Edge™ Panel (24" Span Rating) that is glued and nailed down.
- Additional considerations for the TJ-Pro™ Rating include: None.

Supports	Bearing Length			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Floor Live	Total	
1 - Stud wall - DF	3.50"	1.75"	1.75"	362	482	844	1 3/4" Rim Board
2 - Stud wall - DF	3.50"	1.75"	1.75"	362	482	844	1 3/4" Rim Board

• Rim Board is assumed to carry all loads applied directly above it, bypassing the member being designed.

Lateral Bracing	Bracing Intervals	Comments
Top Edge (Lu)	4' 1" o/c	
Bottom Edge (Lu)	17' 10" o/c	

- TJI joists are only analyzed using Maximum Allowable bracing solutions.
- Maximum allowable bracing intervals based on applied load.

Vertical Load	Location	Spacing	Dead (0.90)	Floor Live (1.00)	Comments
1 - Uniform (PSF)	0 to 18' 1"	16"	30.0	40.0	Default Load

Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC-ES under evaluation reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports, Weyerhaeuser product literature and installation details refer to www.weyerhaeuser.com/woodproducts/document-library.

The product application, input design loads, dimensions and support information have been provided by ForteWEB Software Operator

ForteWEB Software Operator	Job Notes
Joseph Marquez Malsam-Tsang Engineering (206) 602-5122 JosephM@malsam-tsang.com	



4/18/2022 4:36:21 AM UTC
 ForteWEB v3.2, Engine: V8.2.0.17, Data: V8.1.0.16

File Name: Joist

CONT. \ MAIN FLOOR FRM G. (S1.2):

210 - CANT. B3 @ GRID-T ; (C-3):

$\lambda = 5.5 ; A = 3 ; P = 15 \times 15 \times 8 / 2 = 0.1$
 $W_1 = (60+20) \times 15 / 2 + 15 \times 11 + (30+40) \times 16 / 2$
 $= 1.105 \text{ k/ft}$

$W_2 = 15 \times 11 + (70) \times 16 / 2 = 0.725$

$R_1 = 1.95$

$R_2 = 7.20 ; R_{TOT} = 7.2 + 3.84 = 1.00^k$

$M_+ = 1.73$

$M_- = -5.96$

$F_v = 58$

$F_b = 0.918'' \sim \frac{2A}{2160} - \text{OK?}$

211 - 2x12 DF#1 AT 12" OC TAPERED TO 1/4" PER 1'-0" TO 3" MIN. DEPT

$\lambda = 13' ; W = (20+60) \times 12 / 2 = 0.08$
 $d_{eff} \approx 8.5''$

$R = 0.52$

USE (2) 2x12's AT 16" OC

$M = 1.69$

$F_v = 58$

$F_b = 1.12 < 110 \text{ ksi} \times 1.15 = 1.15 - \text{OK?}$

$\Delta_{TL} = 0.39'' \sim \lambda / 396$

212A - C15x33.9 DECK RIM

$\lambda_1 = 15.5$

$W_s = 14/2 \times 0.08 = 0.56$

$=$

$R_1 = 4.34$

$M = 16.82$

$F_b = 4.81$

$F_v = 0.72$

$DEFL = .08 =$

$L/1000+$

212B - W14x22 DECK RIM ;

$\lambda = 10 ; W = 0.56$ NOW C15x33.9

$R = 2.80$

$M = 7.10 - \text{OK?}$

213 - W8x28 BEAM @ CONCEALED ENTERT

$\lambda = 21 ; W = (20+60) \times 14 / 2 = 0.56$

W8x28 ; $I_x = 98 ; d = 8''$
 $S_x = 24.3 ; b_f = 6 1/2''$

$R = 5.88$

$M = 30.1 \times 12 = 371 ; S_x \text{ READ} = 12.4 - \text{OK?}$

$\Delta_{TL} = 0.86'' \sim \lambda / 292 > \lambda / 240 - \text{OK?}$

214 - CANT. STEEL BEAM ALONG GRID-C

$\lambda_1 = 0.75 ; \lambda_2 = 8.5 ; A = 5$ (C-5)

$R_1 = R_{\#213} + 0.56 \times 10 / 2 = 5.88 + 2.8 = 8.68$

$R_2 = R_{\#212A} + R_{\#212B} + P_{ABU}$
 $= 7.4 + 2.8 + 3.05 = 13.25$

$W_s \approx 0$

$R_1 = 0.814$

$R_2 = 2.11$

$M_+ = 0.61$

$M_- = -6.25 \times 12 = 75 ; S_x \text{ READ} = 27 - \text{OK?}$

W8x48 ; $I_x = 184 ; d = 8 1/2''$
 $S_x = 43.2 ; b_f = 8 1/8''$

$\Delta_{TL \text{ @ END}} = 0.49'' \sim 2A / 243 - \text{OK?}$

215 - CANT. STL. BM. DECK AT GRID-D:

$\lambda_1 = 0.75 ; \lambda_2 = 8.5 ; A = 5$ (C-5)

$R_1 = 2.8 ; R_2 = 2.8 + 1.55 = 4.35$

$W = \sim 0.107$

$R_1 = 0.45$

$R_2 = 7.70$

$M_- = -22.675 \times 12 =$

NOT USED

$\Delta_{TL \text{ @ END}} = 0.123'' \sim 2A / 971 - \text{OK?}$

W14x26 ; $I_x = 245 ; d = 13 7/8''$
 $S_x = 35.3 ; b_f = 5''$



122 SOUTH JACKSON ST
 SUITE 210
 SEATTLE, WA 98104
 T 206.789.8038
 MALSAM-TSANG.COM

LABAN REMODEL

PROJECT

4/18/22

DATE

0189-2022-03

PROJECT NO

JCM

DESIGN

V-5

SHEET

CONT. MAIN FLR. FRMG ; (S1.2) :

216 - DECK RIM :

$l = 10.5 ; W = (20+60) \frac{1}{2} = 260$

$R = 1.1$

$M = 5.0$

NOT USED

$\Delta T = 0.017 \sim 2/7305 - OK?$

$W 14 \times 22 ; I_x = 191 ; d = 13-3/4$
 $S_x = 29 ; bf = 5"$

217 - CANT STUB BM @ DECK GRID-B.1 :

$l_1 = 0.75 ; l_2 = 0.15 ; A = 5$

(L-5)

$P_1 = 5.88 ; P_2 = R \cdot 2.2A + P_{ADV}$
 $= 7.4 + 1.55 = 8.95$

$W_1 = W_2 = 0 ; W'_3 = 0.043$

$R_1 = 0.15$

NOT USED

$R_2 = 14.55$

$M = 0.38$

$M = 45.3$
 $= 54.4$

$S_{XREAD} = 10.2$

$\Delta T_{LEND} = 0.025 \sim \frac{2A}{474} - OK?$

$W 14 \times 26 ;$
 $I_x = 245 ; d = 13-7/8$
 $S_x = 35.3 ; bf = 5"$

218 - B2 RIM AT FRONT - GRID-2 :

$l = 8' ; W = (30+40) 2.5/2 = 87.5$

$R = 3.15$

$M = 7.0$

$f_v = 76$

$f_b = 0.735$

$\Delta T = 0.065 \sim 2/1477$

CRAWLSPACE FRAMING ; (S1.1) :

NEW CRAWL SPACE BEAM/HDR,
SUPPORTING BRG. WALL LINE :

$W = W \# 206 / \# 207 + 12 PPF \times 9' =$
 $= 875 + 105 = 980 \# /$

$R_{MAX} = 5.5'$

$R = 2.14$

$M = 3.13$

$f_v = 119$

$f_b = 1.355$

$\Delta T = 0.10 \sim 2/724 - OK?$
GL 3'1/8" x 7.5



122 SOUTH JACKSON ST
 SUITE 210
 SEATTLE, WA 98104
 T 206.789.6038
 MALSAM-TSANG.COM

LABAN REMODEL

PROJECT

DATE 4/10/22

PROJECT NO 0189-2022-03

DESIGN JCM

SHEET V-6

WELDING CONNECTIONS AND SHEAR CAPACITY CHECKS:

① "W" - FILLET WELD; VCAP:

$$F_{EXX} = 70 \text{ KSI}$$

$$\Omega = 2.0$$

$$W = 3/16" ; W = 1/4"$$

$$V_{CAP} = \frac{0.6 F_{EXX} \times 0.707 \times W}{\Omega}$$

$$V_{CAP, W=3/16"} = 2.794 \frac{K}{IN} ; V_{CAP, W=1/4"} = 3.712 \frac{K}{IN}$$

② "t" # SHEAR YIELDING; VCAP:

$$V_{CAP} = \frac{0.60 F_y \times t}{\Omega} ; F_y = 36 \text{ KSI}$$

$$\Omega = 1.5$$

$$t_{3/16"} = 2.170 \frac{K}{IN} ; t_{1/4"} = 3.160 \frac{K}{IN}$$

③ "t" # SHEAR RUPTURE; VCAP:

$$V_{CAP} = \frac{0.60 F_u \times t}{\Omega} ; F_u = 58 \text{ KSI}$$

$$\Omega = 1.5$$

$$t_{3/16"} = 4.35 \frac{K}{IN} ; t_{1/4"} = 5.80 \frac{K}{IN}$$

CHK W5 X 19 COL. SUPPORTING DECK;

COL. SUPPORTING BEAMS # 216 & # 217

$$P_{OT} = P_{DU} + R_{216} + R_{217}$$

$$= 232 + 1190 + 1455$$

$$= 1877 \text{ K} \approx 19.0 \text{ MIPs}$$

FOR W5 X 19:

$$A = 5.56 \text{ IN}^2$$

$$I_x = 26.3 \text{ IN}^4 ; I_y = 9.13 \text{ IN}^4$$

$$r_x = 2.17 \text{ IN} ; r_y = 1.28 \text{ IN}$$

$$E = 29,000 \text{ KSI}$$

Worst Case

$$F_y = 50 \text{ KSI}$$

$$\Omega_c = 1.67$$

$$K = 0.80$$

$$\frac{P_n}{\Omega_c} = \frac{F_{cr} \times A_g}{\Omega_c} ; \text{WHERE: } \frac{K \lambda}{r_y} = \frac{0.80 (9 \times 12")}{1.28}$$

$$= 67.5$$

$$\text{IF: } \frac{K \lambda}{r} \leq 4.71 \sqrt{\frac{E}{F_y}}$$

$$67.5 \leq 113.43$$


$$\text{THEN: } F_{cr} = \left[0.658 \times \frac{F_y}{F_e} \right] F_y$$

$$= 26.18 \approx 26.2$$

$$\text{WHERE: } F_e = \frac{\pi^2 E}{(K \lambda / r)^2} = 62.82$$

$$\text{SO: } \frac{P_n}{\Omega_c} = \frac{26.2 \times 5.56}{1.67}$$

$$= 87.2 \text{ K} >> 19.0 \text{ K} \quad \underline{\underline{-OK!}}$$



**MALSAM
TSANG**
STRUCTURAL
ENGINEERING

122 SOUTH JACKSON ST
SUITE 210
SEATTLE, WA 98104
T 206.789.6038
MALSAM-TSANG.COM

LABAH REMODEL

PROJECT

DATE

4/19/22

0109-2022-03

PROJECT NO

DESIGN


JCM

SHEET

V-7

SHORING CALCULATIONS


10 BROOK BAY RD
MERCER ISLAND, WA



**MALSAM
TSANG**
STRUCTURAL
ENGINEERING

SHORING DESIGN

DRIVEN PILES - PERMANENT

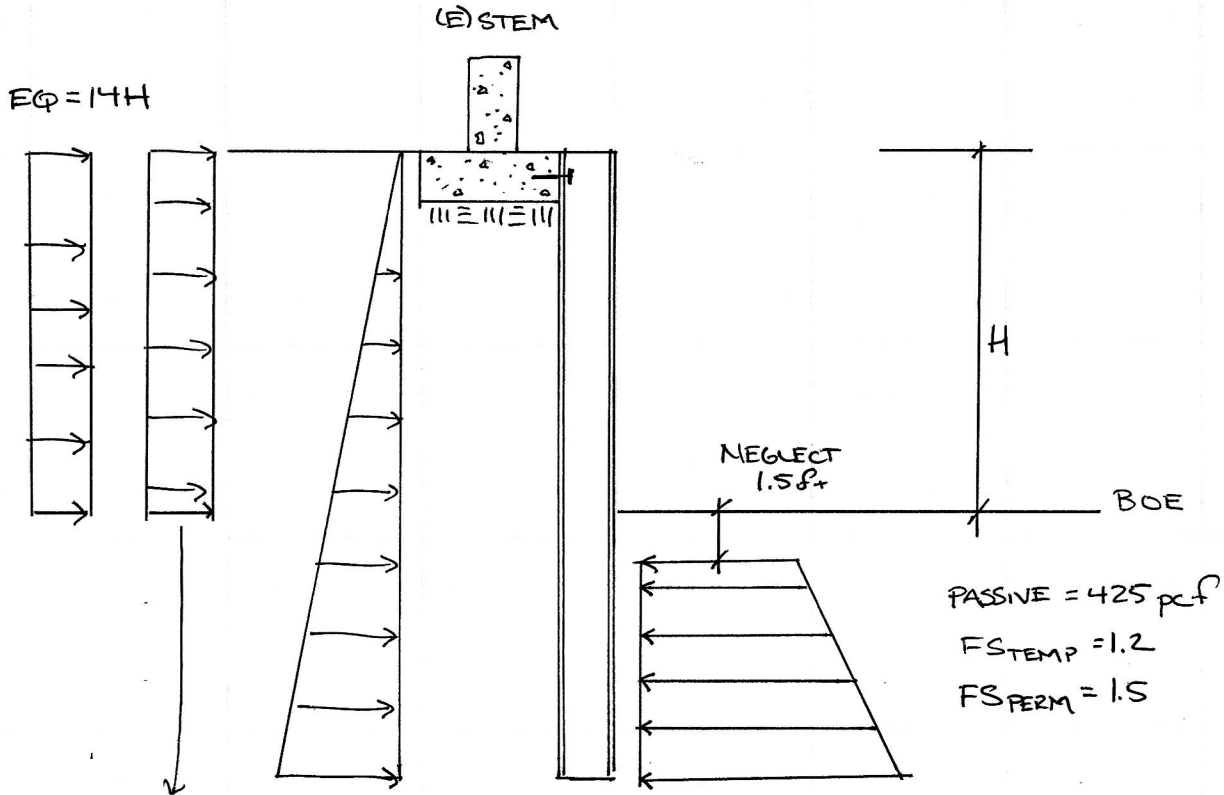

SURCHARGE
PER FIG. 3 OF
GEO REPORT
UNIFORM LOAD
DISTRIBUTION

ACTIVE
= 35 pcf

PASSIVE = 425 pcf
F_{TEMP} = 1.2
F_{PERM} = 1.5

$$K_a = \tan^2(45 - \phi/2) \times q' \quad \#/\text{SF}$$

$\phi = 34$

$$K_a = \tan^2(45 - 34/2) \times .657 \#/\text{SF}$$

= 186 #/

$$q = 17/2 \times .055 + .135 + 17/2 \times .045 = .985 \#/\text{ft}$$

$$.985 \#/\text{ft} / 1.5' = 0.657 \#/\text{SF}$$

CHECK LAGGING

TEMP

L = 4.25'

W = (10 x .035) 50% = .175'

R = .37"

M = .4" ²

f_b = .28 ksi

f_v = 15 psi

PT (2) 2x12 [024x12]

PERM

L = 4.25

W = (65 x .035 + .186) 50% = .207' (+EQ = 14H)

R = .44" (.63")

M = .47" ² (.67")

f_b = .33 ksi (.48)

f_v = 17 psi (25)

PT (2) 2x12



**MALSAM
TSANG**
STRUCTURAL
ENGINEERING

122 SOUTH JACKSON ST
SUITE 210
SEATTLE, WA 98104
T 206.789.6038
MALSAM-TSANG.COM

LABAN REMODEL
PROJECT

DATE

0189.2022.03

PROJECT NO

JRF


DESIGN

SHI

SHEET

10 Brook Bay - Laban

10ft tall shoring

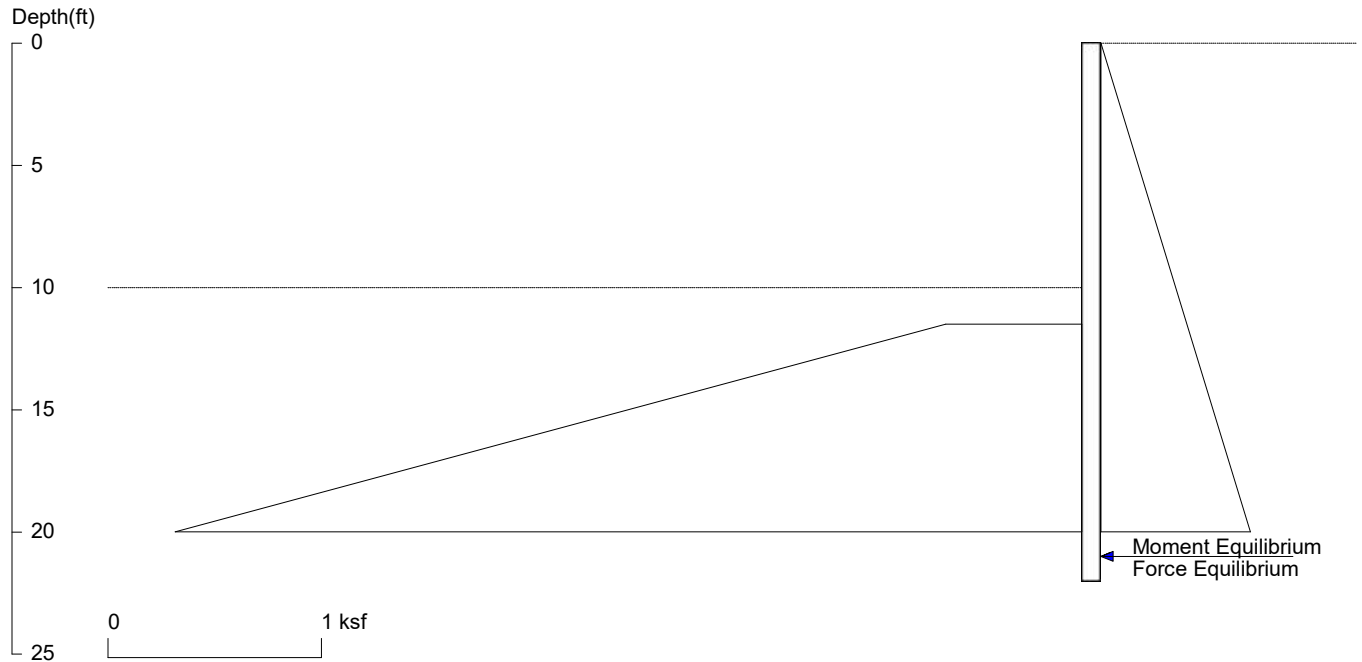

<ShoringSuite> CIVILTECH SOFTWARE USA www.civiltech.com

Licensed to 4324324234 3424343

Date: 4/14/2023

File: P:\MT Project Folder\0189-2022-03-01 10 Brook Bay (Laban)\Calculations\Shoring Design\10ft shoring.sh8

Wall Height=10.0 Pile Diameter=0.5 Pile Spacing=4.3 Wall Type: 3. Soldier Pile, Driving

PILE LENGTH: Min. Embedment=12.00 Min. Pile Length=22.00

MOMENT IN PILE: Max. Moment=52.99 per Pile Spacing=4.3 at Depth=15.15

PILE SELECTION:

Request Min. Section Modulus = 21.2 in³/pile=347.34 cm³/pile, F_y= 50 ksi = 345 MPa, F_b/F_y=0.6

W8X48 has Section Modulus = 43.2 in³/pile=707.92 cm³/pile. It is greater than Min. Requirements!

Top Deflection = 0.75(in) based on E (ksi)=29000.00 and I (in⁴)/pile=184.0

DRIVING PRESSURES (ACTIVE, WATER, & SURCHARGE):

Z1	P1	Z2	P2	Slope
0	0	100	3.500	.035

PASSIVE PRESSURES: Pressures below will be divided by a Factor of Safety =1.2

Z1	P1	Z2	P2	Slope
11.5	.638	109	42.07	.425

ACTIVE SPACING:



No.	Z depth	Spacing
1	0.00	4.25
2	10.00	0.50

PASSIVE SPACING:

No.	Z depth	Spacing
1	10.00	2.00

UNITS: Width, Spacing, Diameter, Length, and Depth - ft; Force - kip; Moment - kip-ft
Friction, Bearing, and Pressure - ksf; Pres. Slope - kip/ft³; Deflection - in

10 Brook Bay - Laban 10ft tall shoring

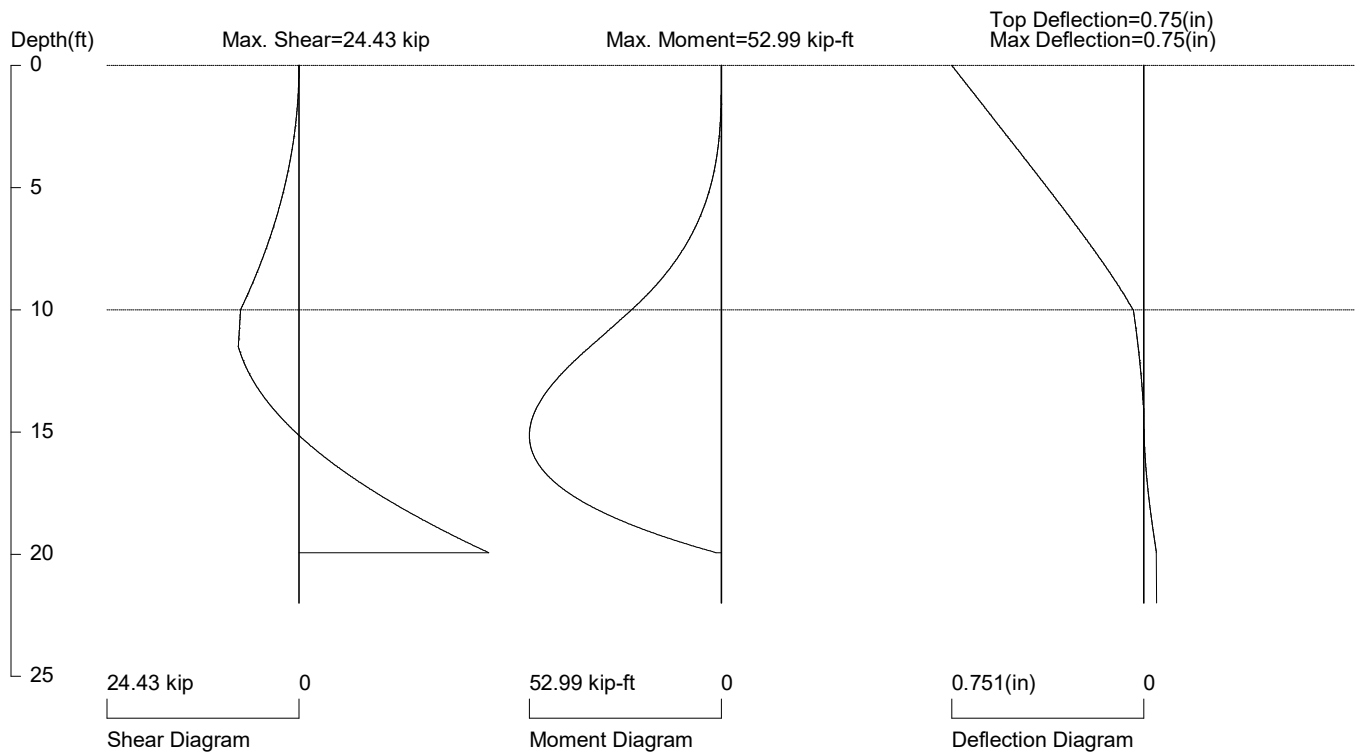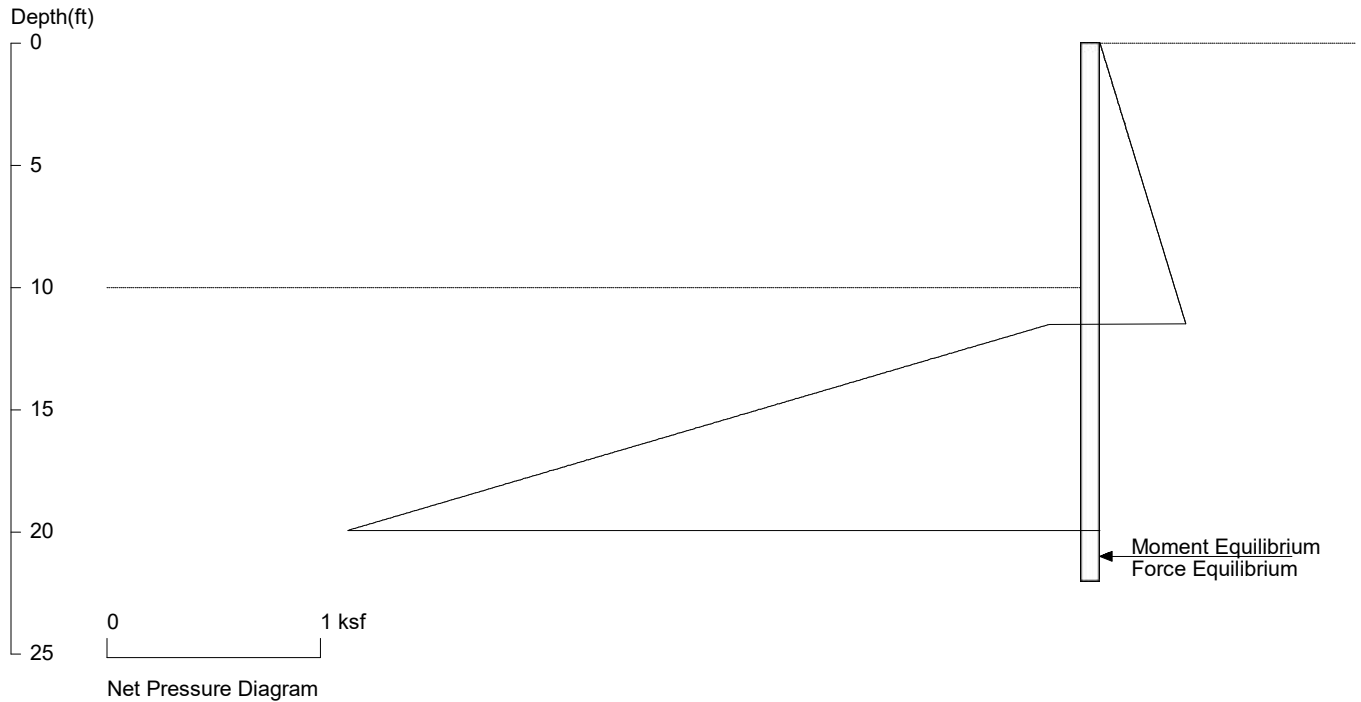

PRESSURE, SHEAR, MOMENT, AND DEFLECTION DIAGRAMS

Based on pile spacing: 4.3 foot or meter

User Input Pile, W8x48: E (ksi)=29000.0, I (in⁴)/pile=184.0


File: P:\MT Project Folder\0189-2022-03-01 10 Brook Bay (Laban)\Calculations\Shoring Design\10ft shoring.sh8

<ShoringSuite> CIVILTECH SOFTWARE USA www.civiltech.com

Licensed to 4324324234 3424343

10 Brook Bay - Laban

6.5ft Shoring w_building surcharge

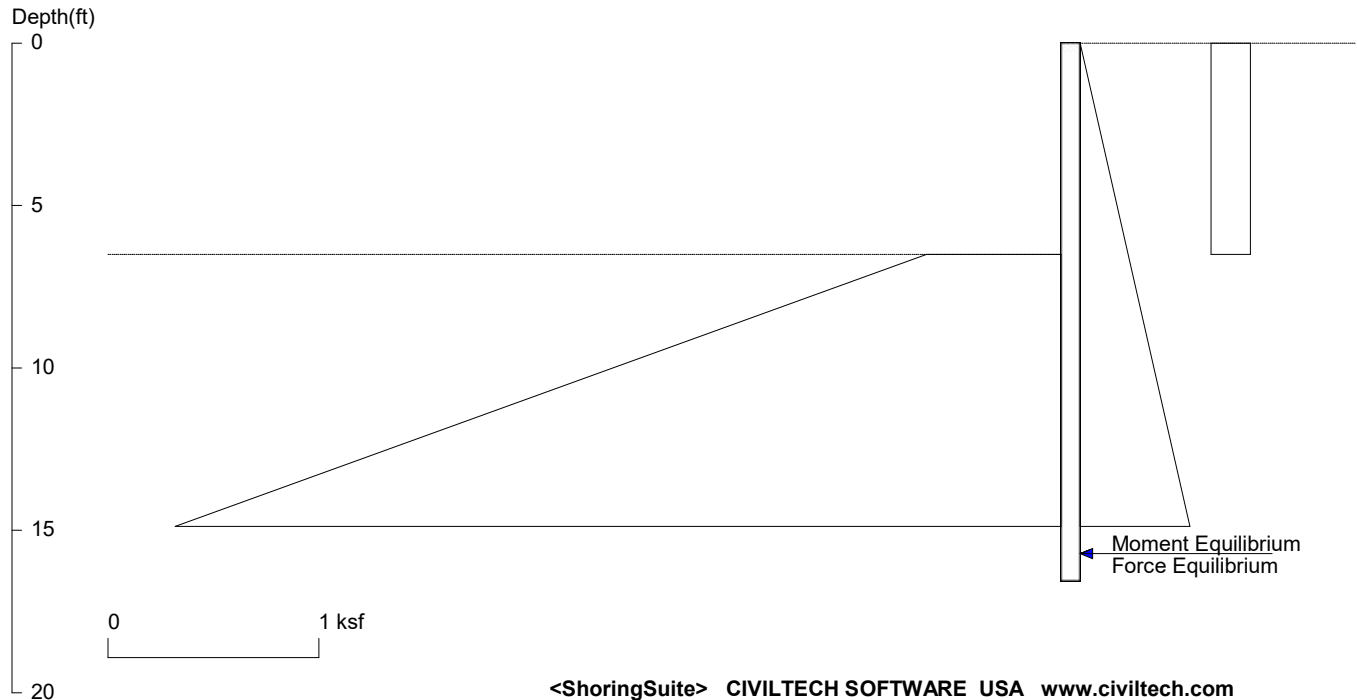

Licensed to 4324324234 3424343

Date: 4/14/2023

File: P:\MT Project Folder\0189-2022-03-01 10 Brook Bay (Laban)\Calculations\Shoring Design\Shoring w_Surcharge.sh8

Wall Height=6.5 Pile Diameter=0.5 Pile Spacing=4.3 Wall Type: 3. Soldier Pile, Driving

PILE LENGTH: Min. Embedment=10.06 Min. Pile Length=16.56

MOMENT IN PILE: Max. Moment=38.26 per Pile Spacing=4.3 at Depth=10.31

PILE SELECTION:

Request Min. Section Modulus = 15.3 in³/pile=250.77 cm³/pile, Fy= 50 ksi = 345 MPa, Fb/Fy=0.6

W8X48 has Section Modulus = 43.2 in³/pile=707.92 cm³/pile. It is greater than Min. Requirements!

Top Deflection = 0.34(in) based on E (ksi)=29000.00 and I (in⁴)/pile=184.0

DRIVING PRESSURES (ACTIVE, WATER, & SURCHARGE):

Z1	P1	Z2	P2	Slope
0	0	100	3.500	.035
0	.186	6.5	0.186	0

PASSIVE PRESSURES: Pressures below will be divided by a Factor of Safety =1.5

Z1	P1	Z2	P2	Slope
6.5	.638	107	43.351	.425

ACTIVE SPACING:

No.	Z depth	Spacing
1	0.00	4.25
2	5.50	0.50



PASSIVE SPACING:

No.	Z depth	Spacing
1	5.50	2.00

UNITS: Width, Spacing, Diameter, Length, and Depth - ft; Force - kip; Moment - kip-ft
Friction, Bearing, and Pressure - ksf; Pres. Slope - kip/ft³; Deflection - in

10 Brook Bay - Laban

6.5ft Shoring w_building surcharge

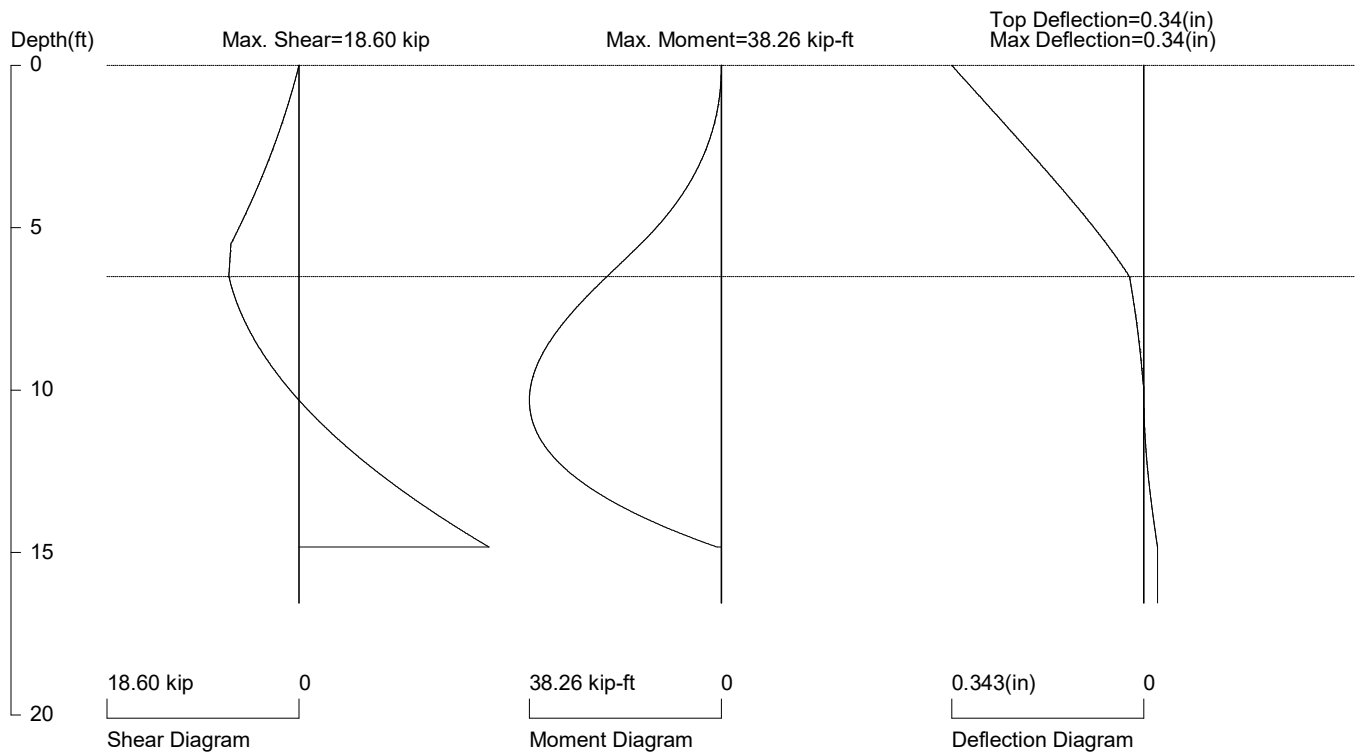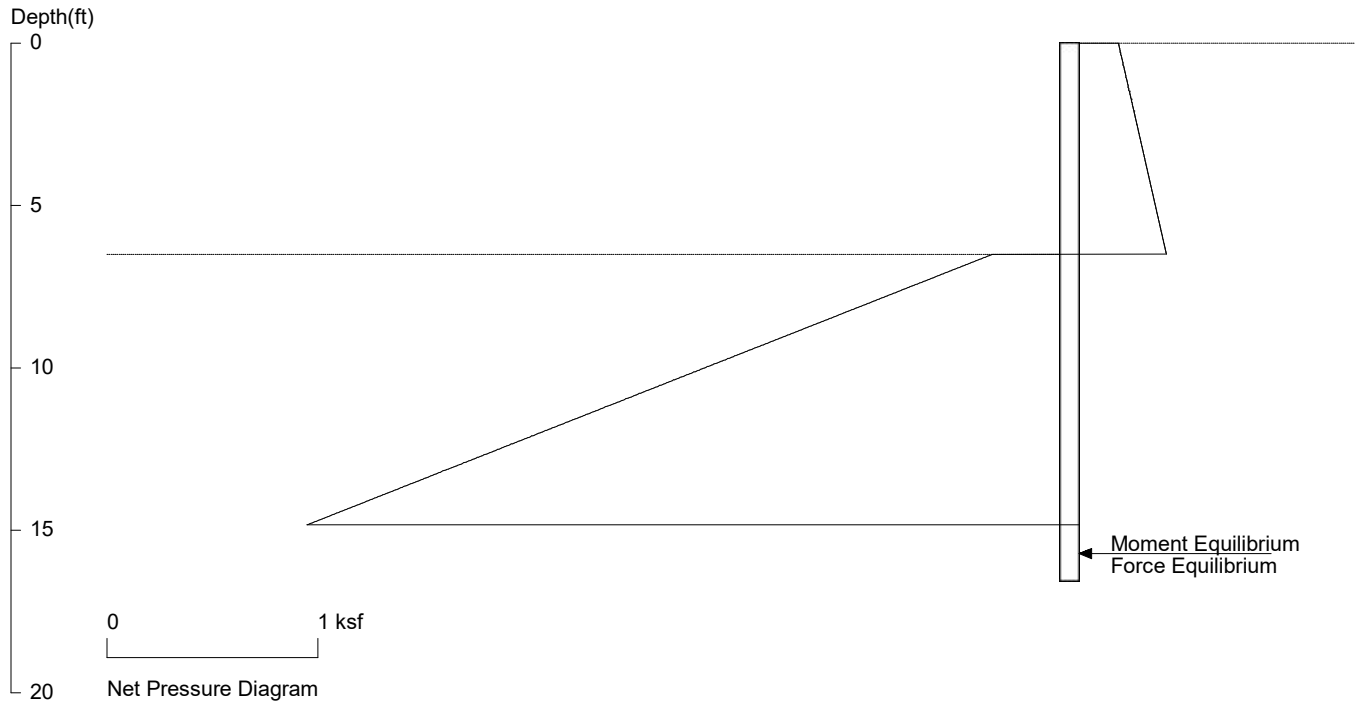

PRESSURE, SHEAR, MOMENT, AND DEFLECTION DIAGRAMS



Based on pile spacing: 4.3 foot or meter

User Input Pile, W8x48: E (ksi)=29000.0, I (in⁴)/pile=184.0

File: P:\MT Project Folder\0189-2022-03-01 10 Brook Bay (Laban)\Calculations\Shoring Design\Shoring w_Surcharge.sh8

10 Brook Bay - Laban

6.5ft Shoring w_EQ

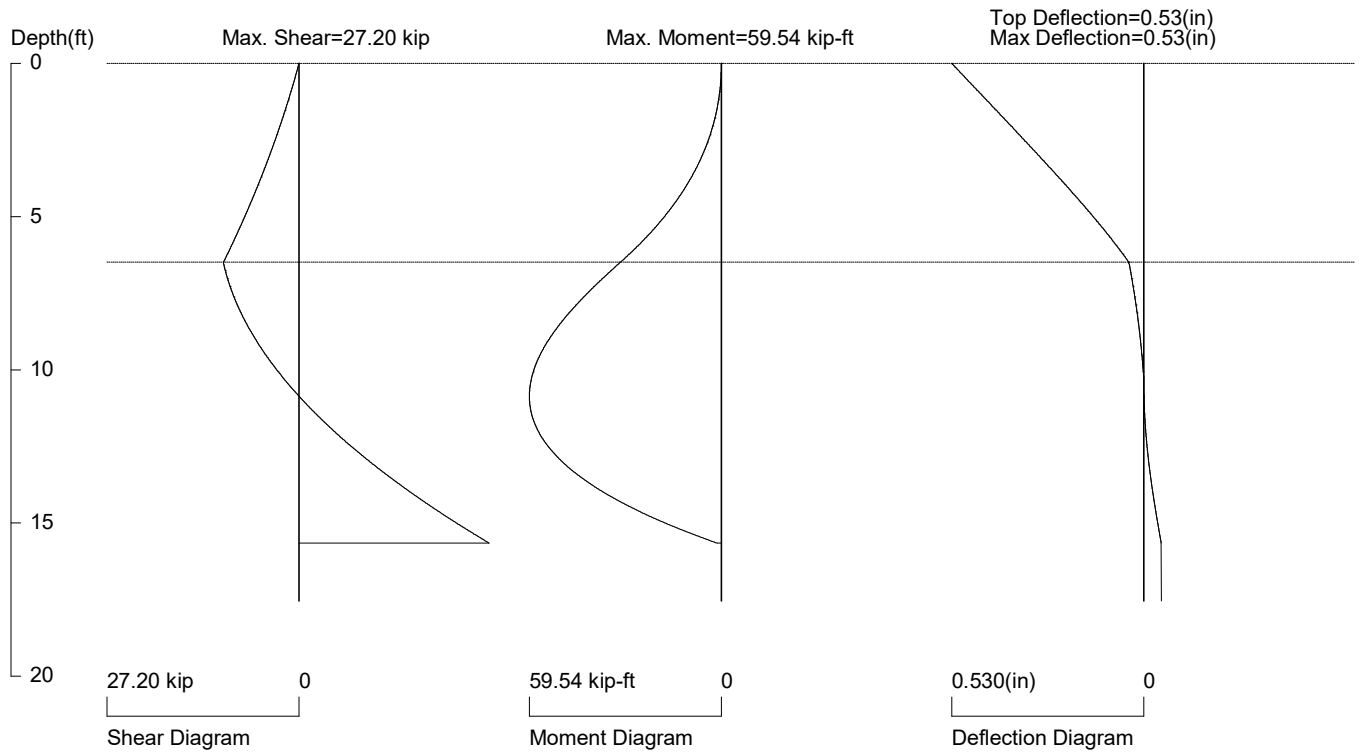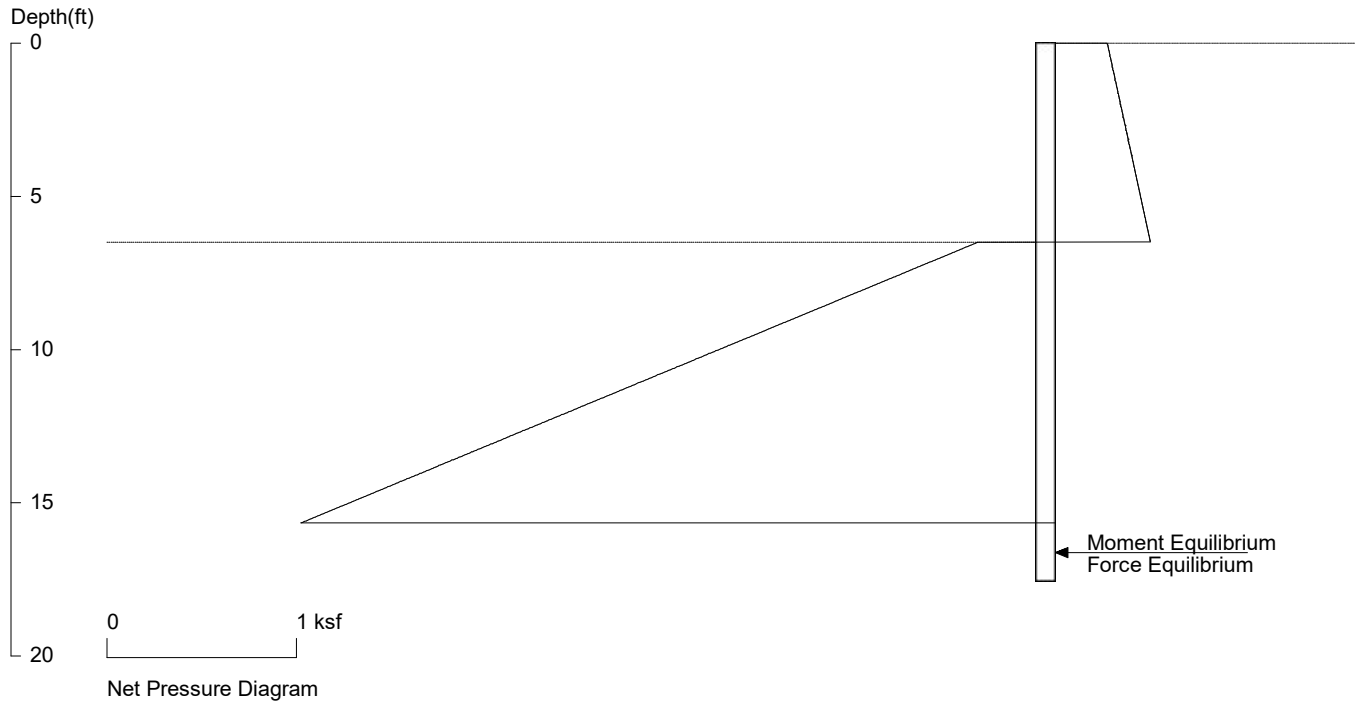

PRESSURE, SHEAR, MOMENT, AND DEFLECTION DIAGRAMS

Based on pile spacing: 4.3 foot or meter

User Input Pile, W8x48: E (ksi)=29000.0, I (in⁴)/pile=184.0

File: P:\MT Project Folder\0189-2022-03-01 10 Brook Bay (Laban)\Calculations\Shoring Design\Shoring w_Surcharge_EQ.sh8