



 HATCH REPRESENTS
 A.D.U. UNIT AND
 LOCATION TO
 BUILDING ENVELOPE

LOWER FLOOR PLAN

1/4" = 1'-0"

| Issue Description | Issue Date | By |
|-------------------|------------|----|
| | | |
| | | |
| | | |
| | | |

8434 SE 39th ST.
Mercer Island, WA.
 Job Number: JMC025

plan name: - -
 marketing name: - -
 plan number: - -
 mark sys. number: - -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
 Submittal Date

Sheet Title/Description
 JAYMARC HOMES
 Design Firm



R.K.N.
 Drawn by:

Checked by:

Primary Scale

A1.1
 of .

Sheet Title/Description

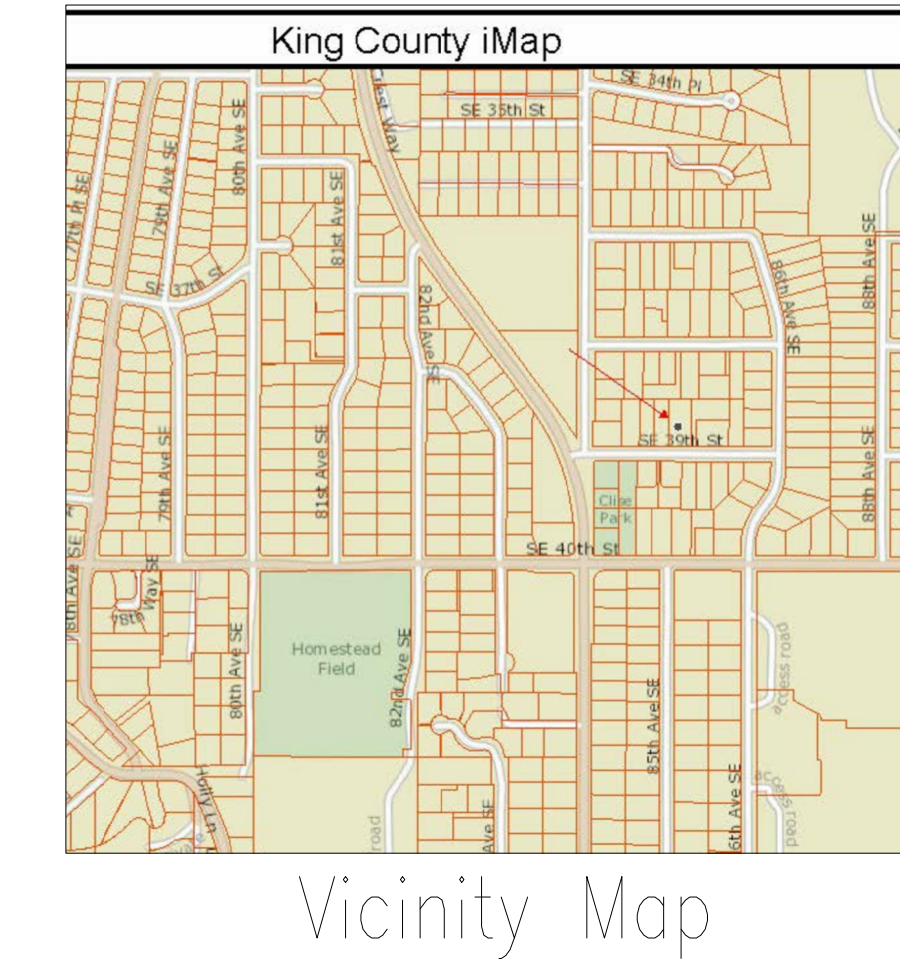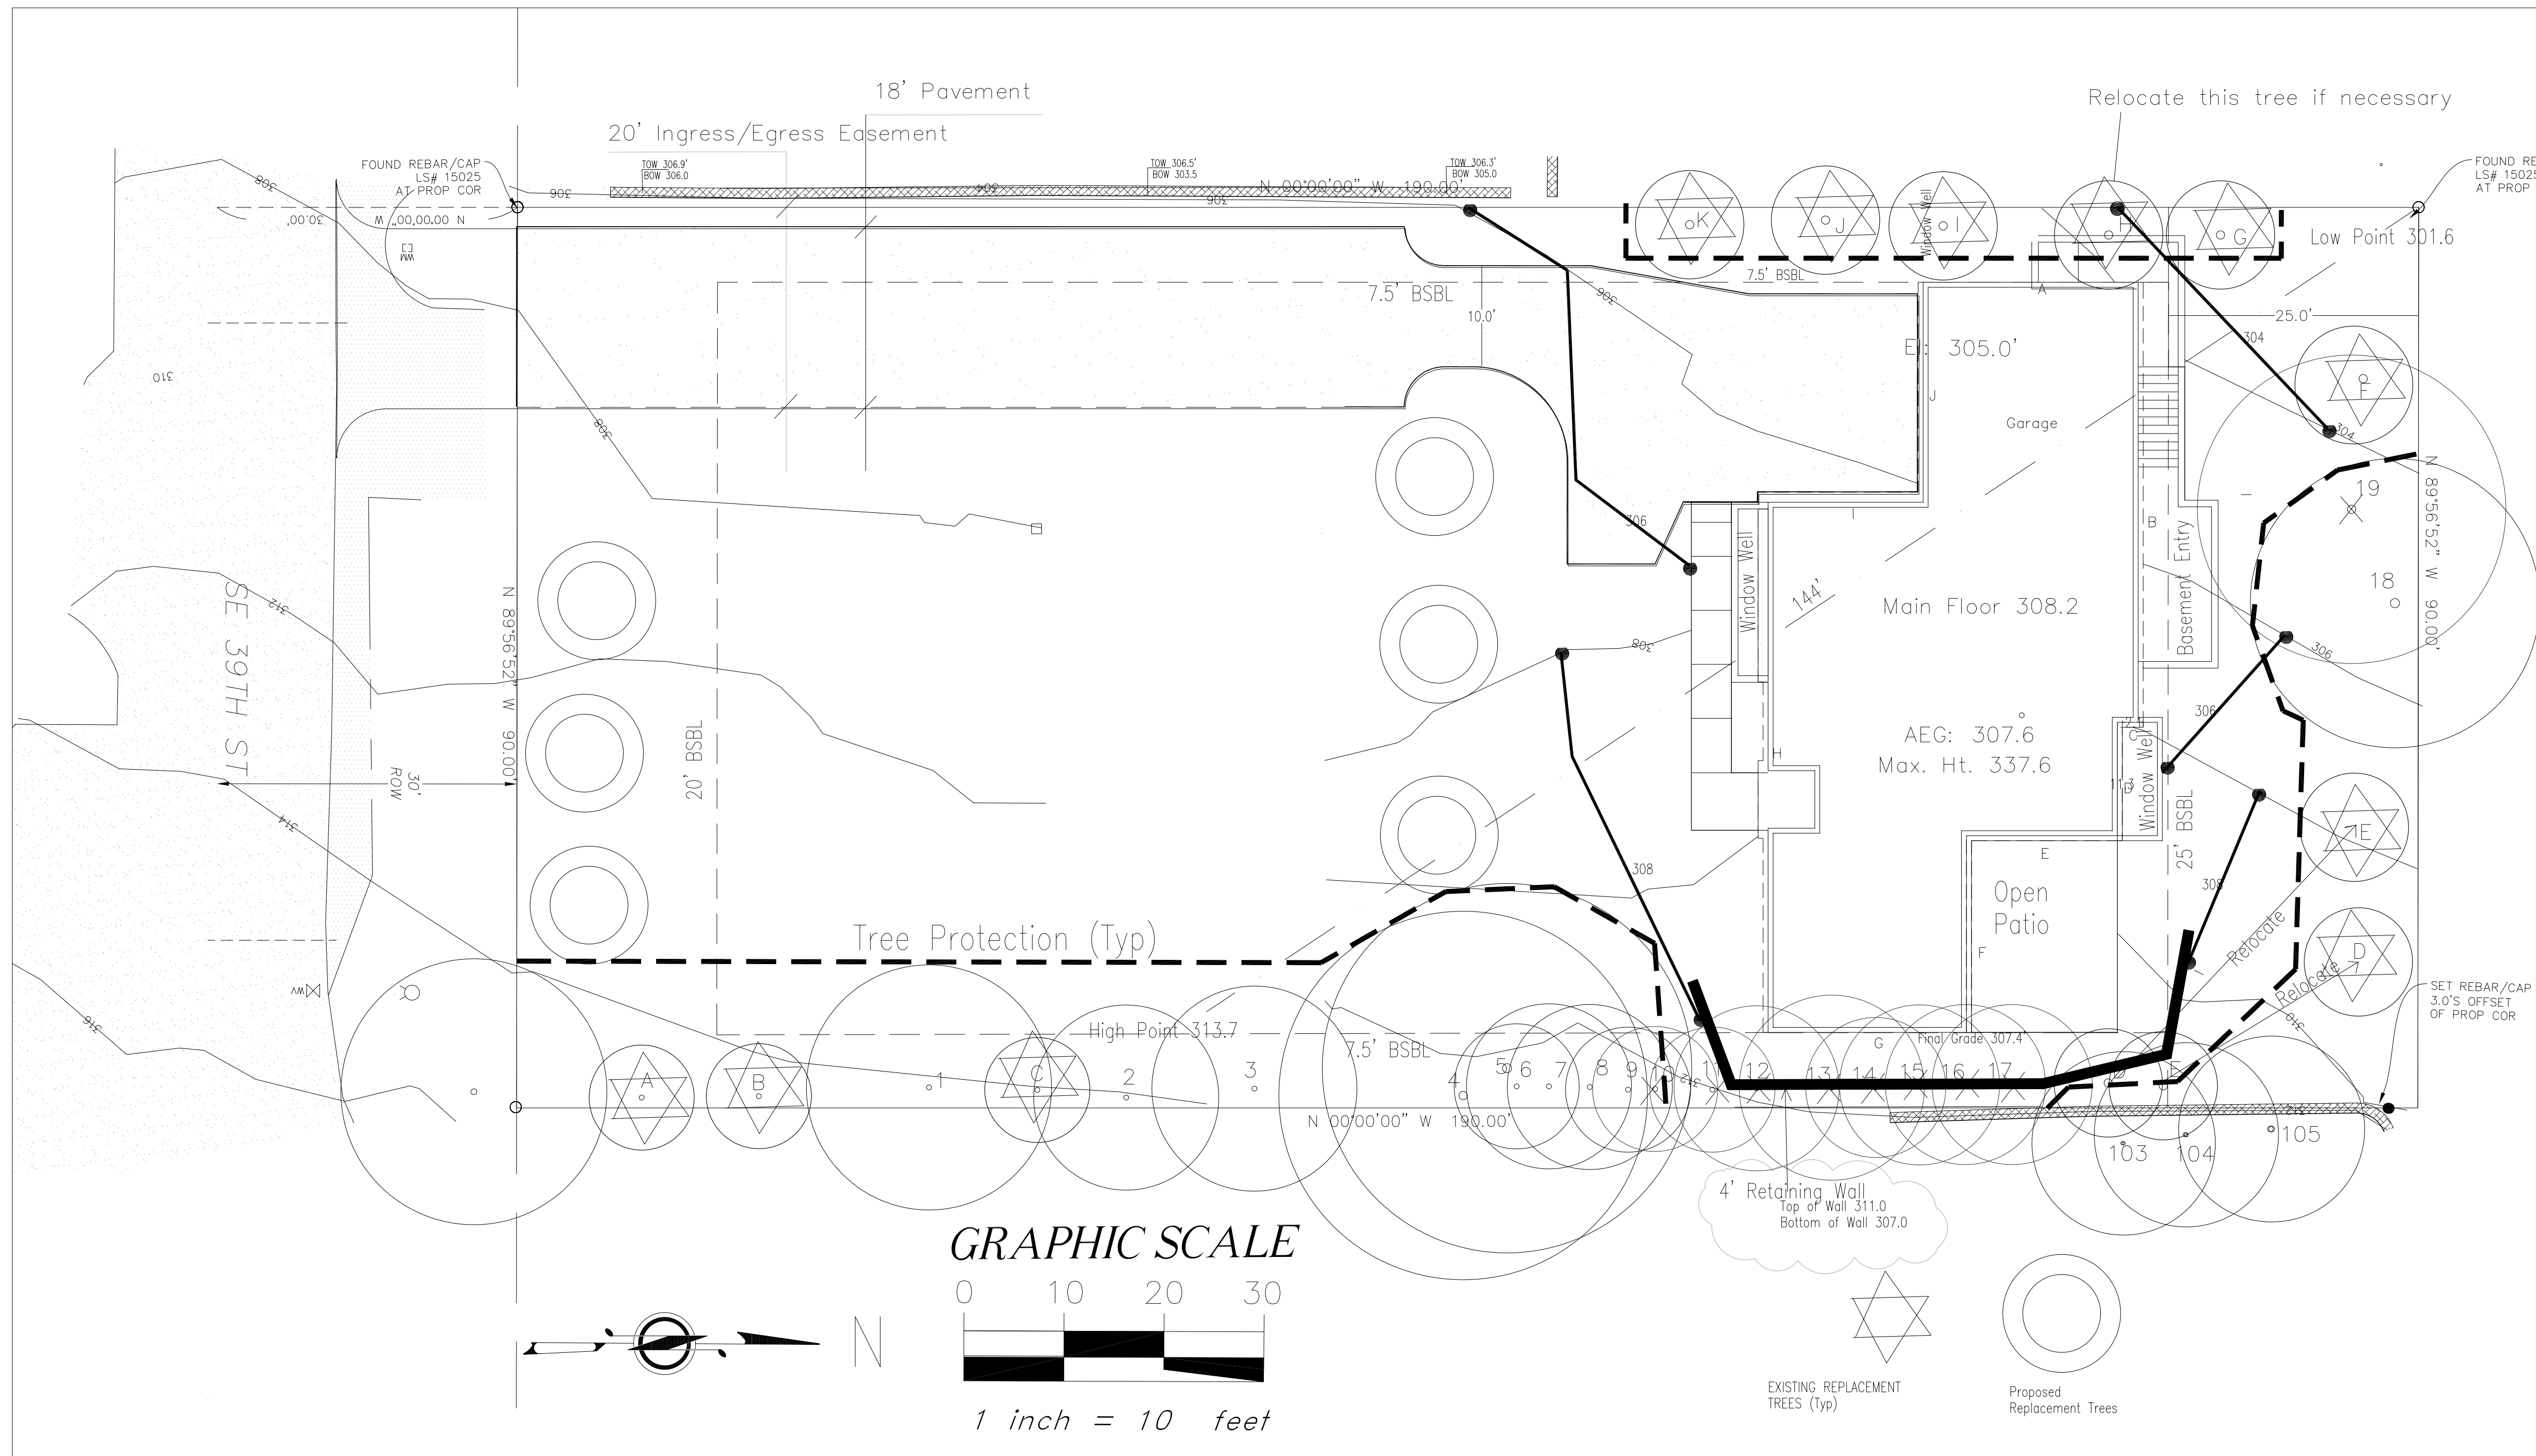

PROPERTY OWNER
Chinmay Dubey & Namrata Dwivedi
STREET ADDRESS
8434 SE 39th, Mercer Island, WA 98040
PARCEL #
5021900691
LEGAL DESCRIPTION
The West Half of Lot 17 and all of Lot 18, Block 6.
Madrona Crest Addition. Vol 42, Page 12.
BOOK OF PLATS, KING COUNTY, WA
ZONE: R-8.4
SETBACKS:
Front Yard - 20'
Rear Yard - 25'
Side Yards - 7.5'/15'
HEIGHT LIMIT; 30' above ABE to roof peak
MAXIMUM LOT COVERAGE: 40%
MAXIMUM HARDSCAPE: 9%
MAXIMUM FAR: 40%
PARKING SPACES PROVIDED: 2 GARAGE 2 DRIVEWAY

8434 SE 29th Tree Table

| Tree ID | Common Name | DBH | Multi | Health | Structural Condition | Dripline | Tree Size Category | Retain? |
|---------------|-----------------|------|-------|--------|----------------------|----------|--------------------|---------|
| 1 | Crabapple | 11.7 | Yes | 1 | 1 | 12.0 | Sig | Yes |
| 2 | Fruiting Pear | 5 | | 1 | 2 | 9.0 | Small | Yes |
| 3 | Crabapple | 8 | | 1 | 2 | 10.0 | Sig | Yes |
| 4 | Pacific Dogwood | 10.5 | | 2 | 1 | 18.0 | Exc | Yes |
| 5 | Pacific Dogwood | 11.5 | | 2 | 1 | 18.0 | Exc | Yes |
| 6 | Japanese Cedar | 7.8 | Yes | 1 | 2 | 6.0 | Small | Yes |
| 7 | Japanese Cedar | 7.6 | Yes | 1 | 2 | 8.0 | Small | Yes |
| 8 | Japanese Cedar | 7 | Yes | 1 | 2 | 7.0 | Small | Yes |
| 9 | Japanese Cedar | 6.7 | Yes | 1 | 2 | 6.0 | Small | Yes |
| 10 | Japanese Cedar | 8.9 | Yes | 1 | 2 | 6.0 | Small | No |
| 11 | Japanese Cedar | 11.3 | Yes | 1 | 2 | 6.0 | Sig | No |
| 12 | Japanese Cedar | 7 | Yes | 1 | 2 | 7.0 | Small | No |
| 13 | Japanese Cedar | 10.4 | Yes | 1 | 2 | 8.0 | Sig | No |
| 14 | Japanese Cedar | 10.3 | Yes | 1 | 2 | 8.0 | Sig | No |
| 15 | Japanese Cedar | 12.6 | Yes | 1 | 2 | 8.0 | Sig | No |
| 16 | Japanese Cedar | 8.5 | Yes | 1 | 2 | 9.0 | No | No |
| 17 | Japanese Cedar | 10 | Yes | 1 | 2 | 9.0 | Sig | No |
| 18 | Mountain Ash | 14 | Yes | 1 | 2 | 14.0 | Sig | Yes |
| 19 | Red maple | 17.4 | | 1 | 1 | 15.0 | Sig | No |
| TOTALS | | | | | | | | |

OFFSITE

| ID | Common Name | DBH | ROW | Structural Condition | Dripline | Tree Size Category | Retain? |
|-----|-----------------|------------|-----|----------------------|----------|--------------------|---------|
| 101 | Common Hawthorn | 8.5 | ROW | | 13.0 | Sig | Yes |
| 102 | Common Hawthorn | NOT MAPPED | ROW | | 13.0 | Sig | Yes |
| 103 | Bitter Cherry | ? | | OH 14 | | Sig | Yes |
| 104 | Bitter Cherry | ? | | OH 14 | | Sig | Yes |
| 105 | Bitter Cherry | ? | | OH 14 | | Sig | Yes |

Previous Replacement Trees

| Id | Common Name | DBH | Multi | Health | Structural Condition | Dripline | Tree Size Category | Retain? |
|----|--------------------|-----|-------|--------|----------------------|----------|--------------------|---------|
| A | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes |
| B | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes |
| C | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes |
| D | Himalayan cedar | 1.5 | | | | 5.0 | | Yes |
| E | Himalayan cedar | 1.5 | | | | 5.0 | | Yes |
| F | Himalayan cedar | 1.5 | | | | 5.0 | | Yes |
| G | Thunder Cloud Plum | 2 | | | | 5.0 | | Yes |
| H | Himalayan cedar | 2.5 | | | | 5.0 | | Yes |
| I | Himalayan cedar | 2 | | | | 5.0 | | Yes |
| J | Himalayan cedar | 2 | | | | 5.0 | | Yes |
| K | Himalayan cedar | 2 | | | | 5.0 | | Yes |
| L | Thunder Cloud Plum | 2 | | | | 7.0 | | Yes |

"Development proposals for a new single-family home shall remove Japanese knotweed (Polygonum cuspidatum) and Regulated Class A, Regulated Class B, and Regulated Class C weeds identified on the King County Noxious Weed list, as amended, from required landscaping areas established pursuant to subsection 19.02.020(F)(3)(a). New landscaping associated with new single-family home shall not incorporate any weeds identified on the King County Noxious Weed list, as amended. Provided, that removal shall not be required if the removal will result in increased slope instability or risk of landslide or erosion."

LOT COVERAGE

| | |
|------------|--------|
| Lot Area | 17,100 |
| Allowed | 40% |
| Allowed sf | 6,840 |

New

| | |
|--------------------------|-------|
| Main Structure Roof Area | 2,183 |
| Driveway | 2,590 |
| New sf | 4,773 |

Existing

| | |
|--------------------------|-------|
| Main Structure Roof Area | 2,098 |
| Driveway | 1,004 |
| Auxillary Bldg | 48 |
| Total Existing | 3,150 |
| Existing Removed | 3,150 |
| Total New and Existing | 4,773 |
| % | 27.9% |

8434 SE 39th St Height Table

| Wall Segment | Midpoint Elevation | Length | Product |
|----------------------|--------------------|--------|-----------------|
| A | 304.5 | 24 | 7,308.0 |
| B | 305.5 | 44 | 13,442.0 |
| C | 306.5 | 2 | 613.0 |
| D | 306.5 | 11.3 | 3,463.5 |
| E | 307.5 | 17.5 | 5,381.3 |
| F | 307.5 | 19.5 | 5,996.3 |
| G | 307.5 | 20.4 | 6,273.0 |
| H | 307.5 | 53.2 | 16,359.0 |
| I | 305.5 | 16 | 4,888.0 |
| J | 305.5 | 21.8 | 6,659.9 |
| Sub Totals | | | 70,383.9 |
| ABE | | | 306.4 |
| Max Height | | | 30.0 |
| Max Elevation | | | 336.42 |

PARKING

| | |
|----------|-------|
| Covered | 2 ea |
| Driveway | 2 ea. |

GROSS FLOOR AREA

| | |
|-------------------------|-----------------|
| Lot Size | 17,100 |
| Basement | 1096 sf |
| Less Basement Exclusion | -1006 sf |
| Main Floor Living | 1,573 sf |
| Garage | 475 sf |
| Second Floor Living | 1,621 sf |
| Stair Credit | -208 |
| Total | 3,551 sf |
| Proposed | 20.8% |
| Max Allowed: 40% | 6,840 sf |
| Plus ADU | 394 sf |
| Total | 7,234 |

Lot Slope Calculations

| | |
|----------------------|----------|
| High Point | 313.7 ft |
| Low Point | 301.6 ft |
| Elevation Difference | 12.1 ft |
| Distance | 144 ft |
| Slope% | 8.4% |

Hardscape

| | |
|-------------------------|----------|
| Lot Size | 17,100 |
| EXISTING | |
| Uncovered Patio | 540 sf |
| Walkways | 104 sf |
| Stairs | 0 sf |
| Rookery/Retaining Walls | 56 sf |
| Total Existing | 700 sf |
| Existing Removed | 700 sf |
| Net Existing Retained | 0 sf |
| NEW | |
| Uncovered Patio | 279.5 sf |
| Walk | 152 sf |
| Rookery/Retaining Walls | 40 sf |
| Window and Stairwells | 288 sf |
| Total New | 759.5 sf |
| Total Project | 759.5 sf |
| Project % | 4.44% |

JayMarc Homes, LLC
 7525 SE 24th St, #487
 Mercer Island, WA 98040
 425 281 2706





Dubay/Dwivedi Residence
 8434 SE 39th St, Mercer Island
 SITE PLAN

Drawn by
 GU

6/2/23

9/12/23

A2.0

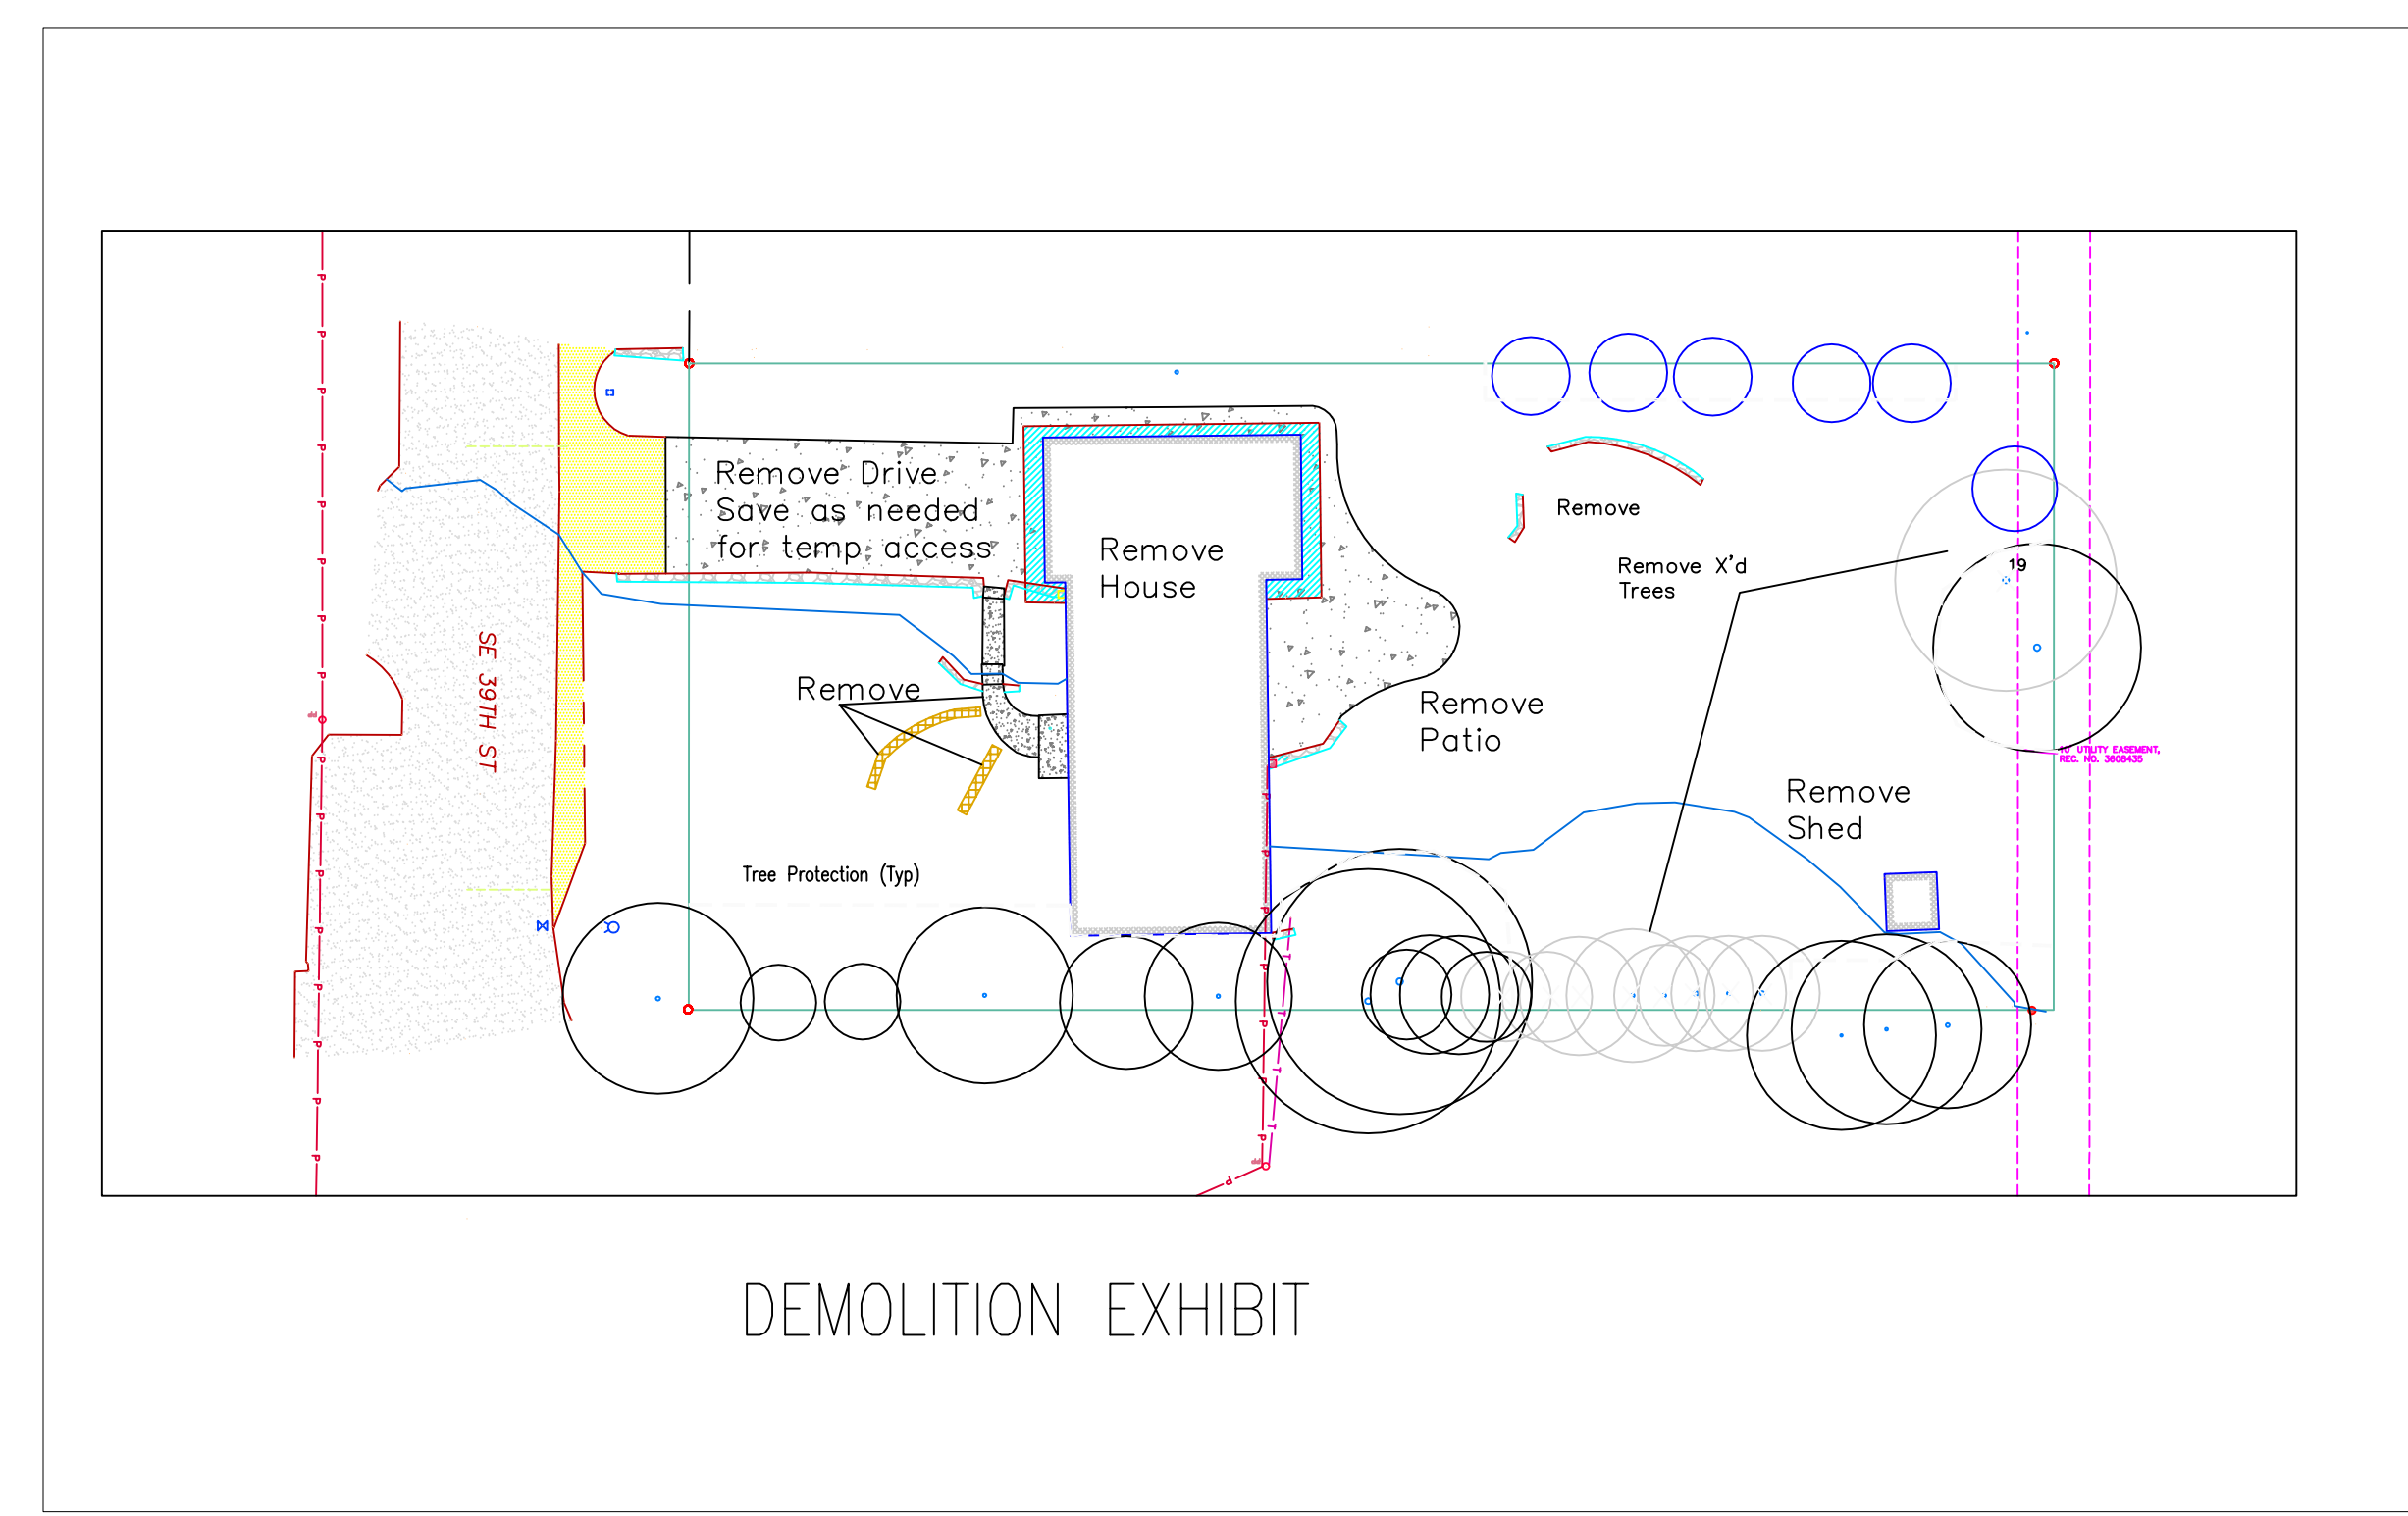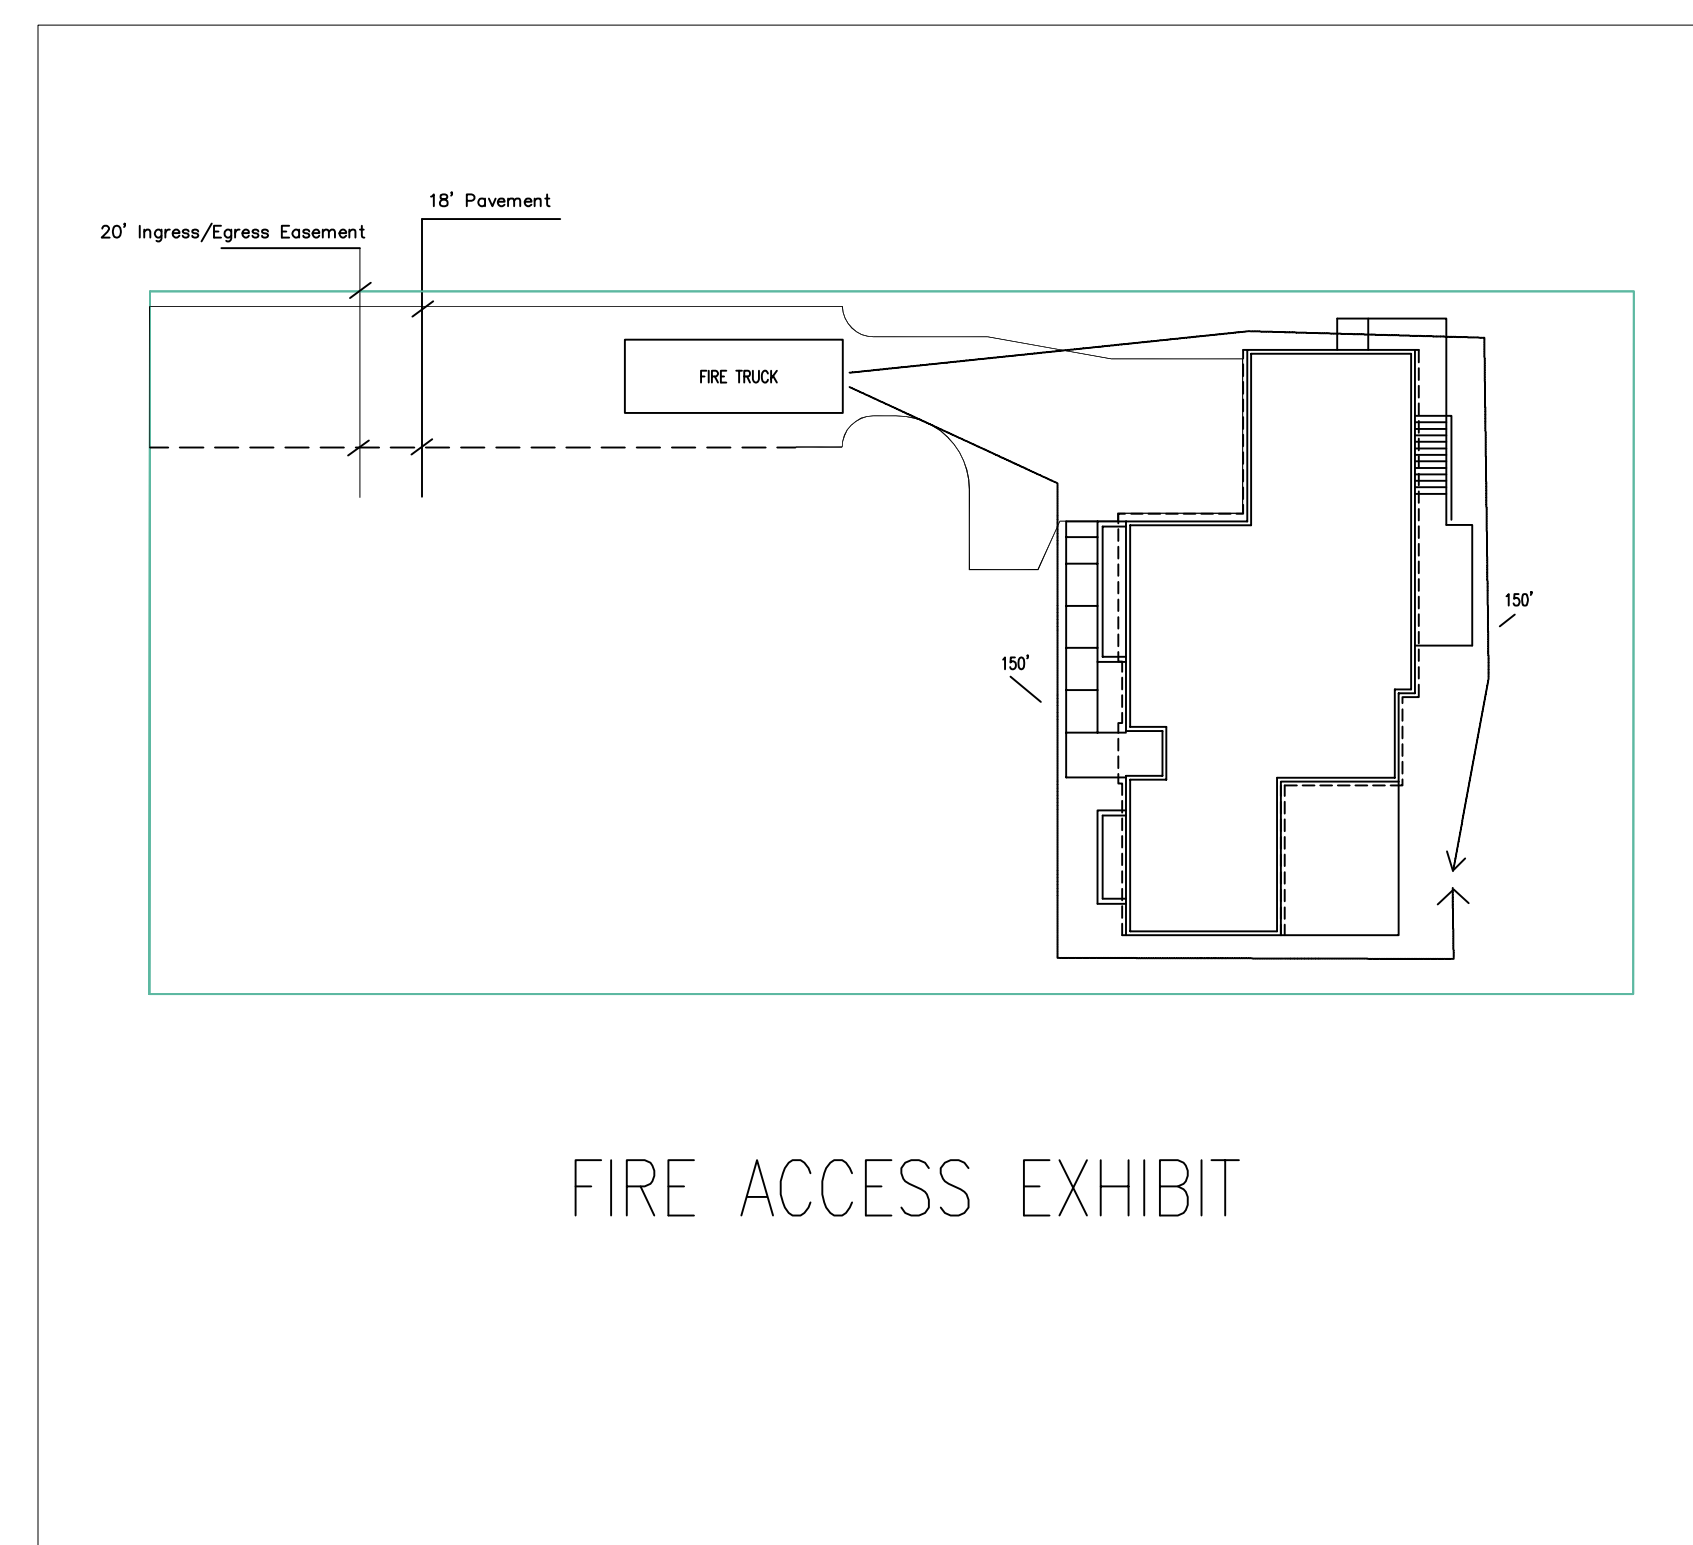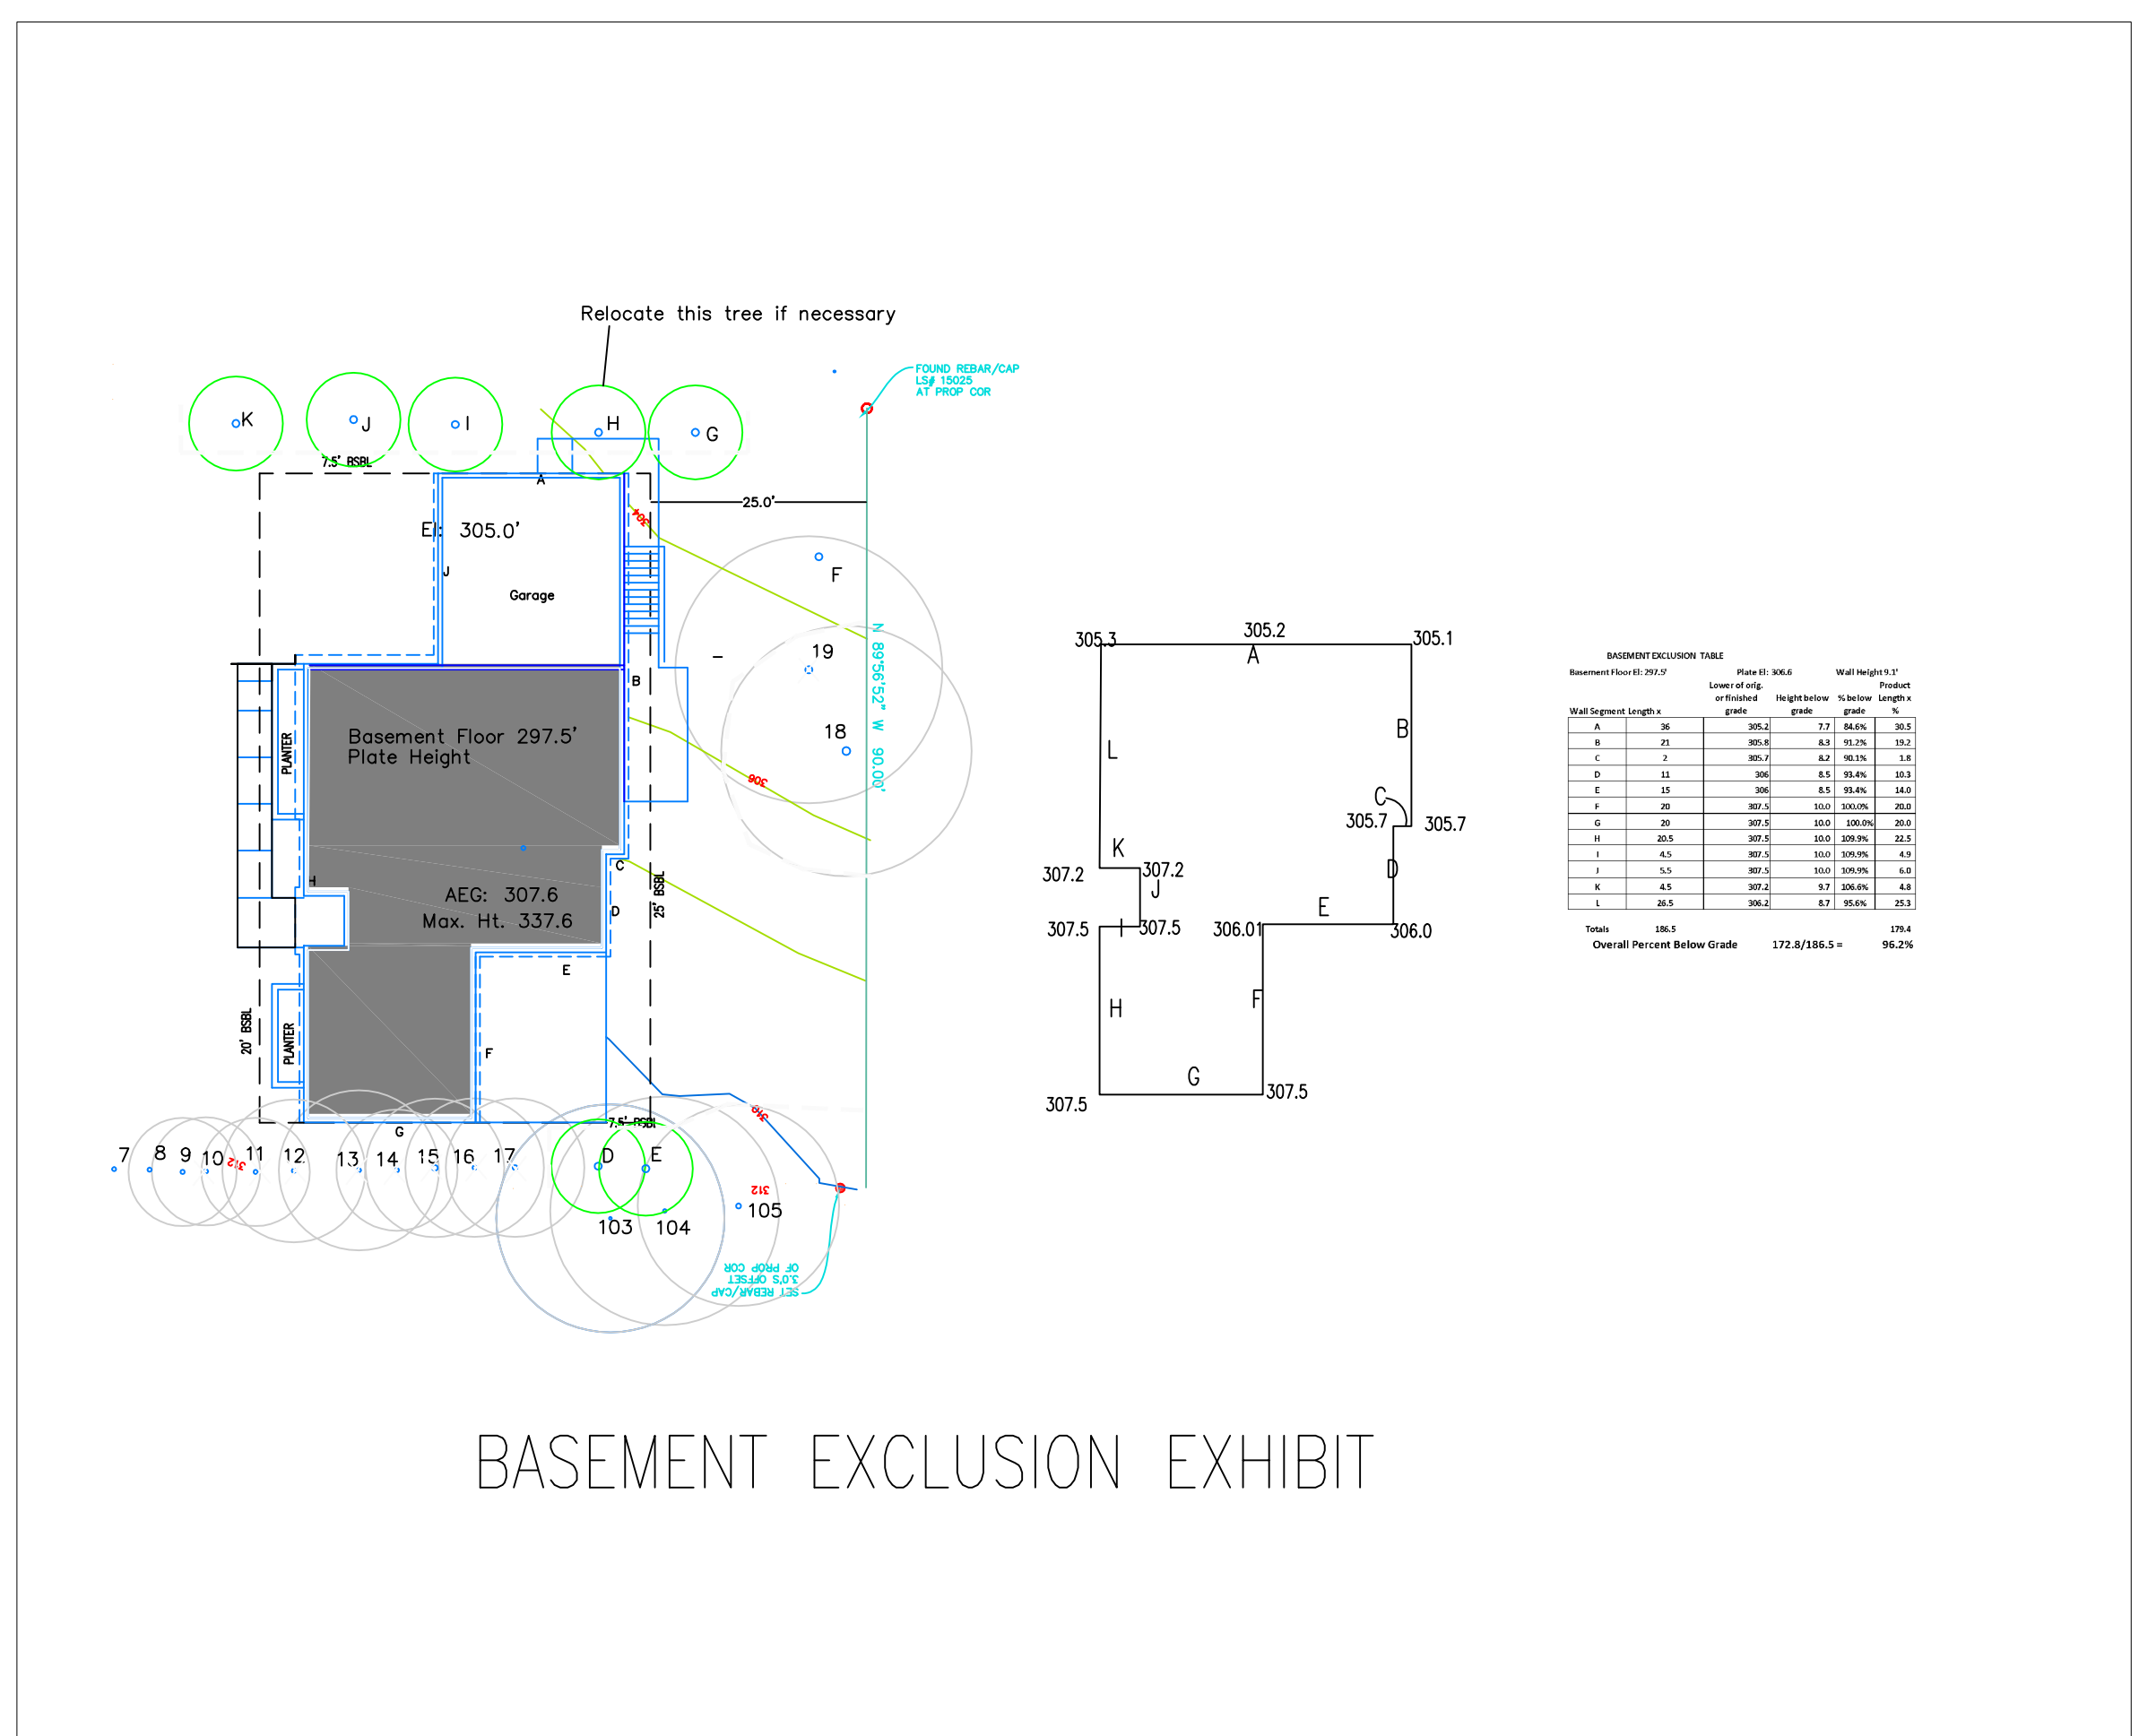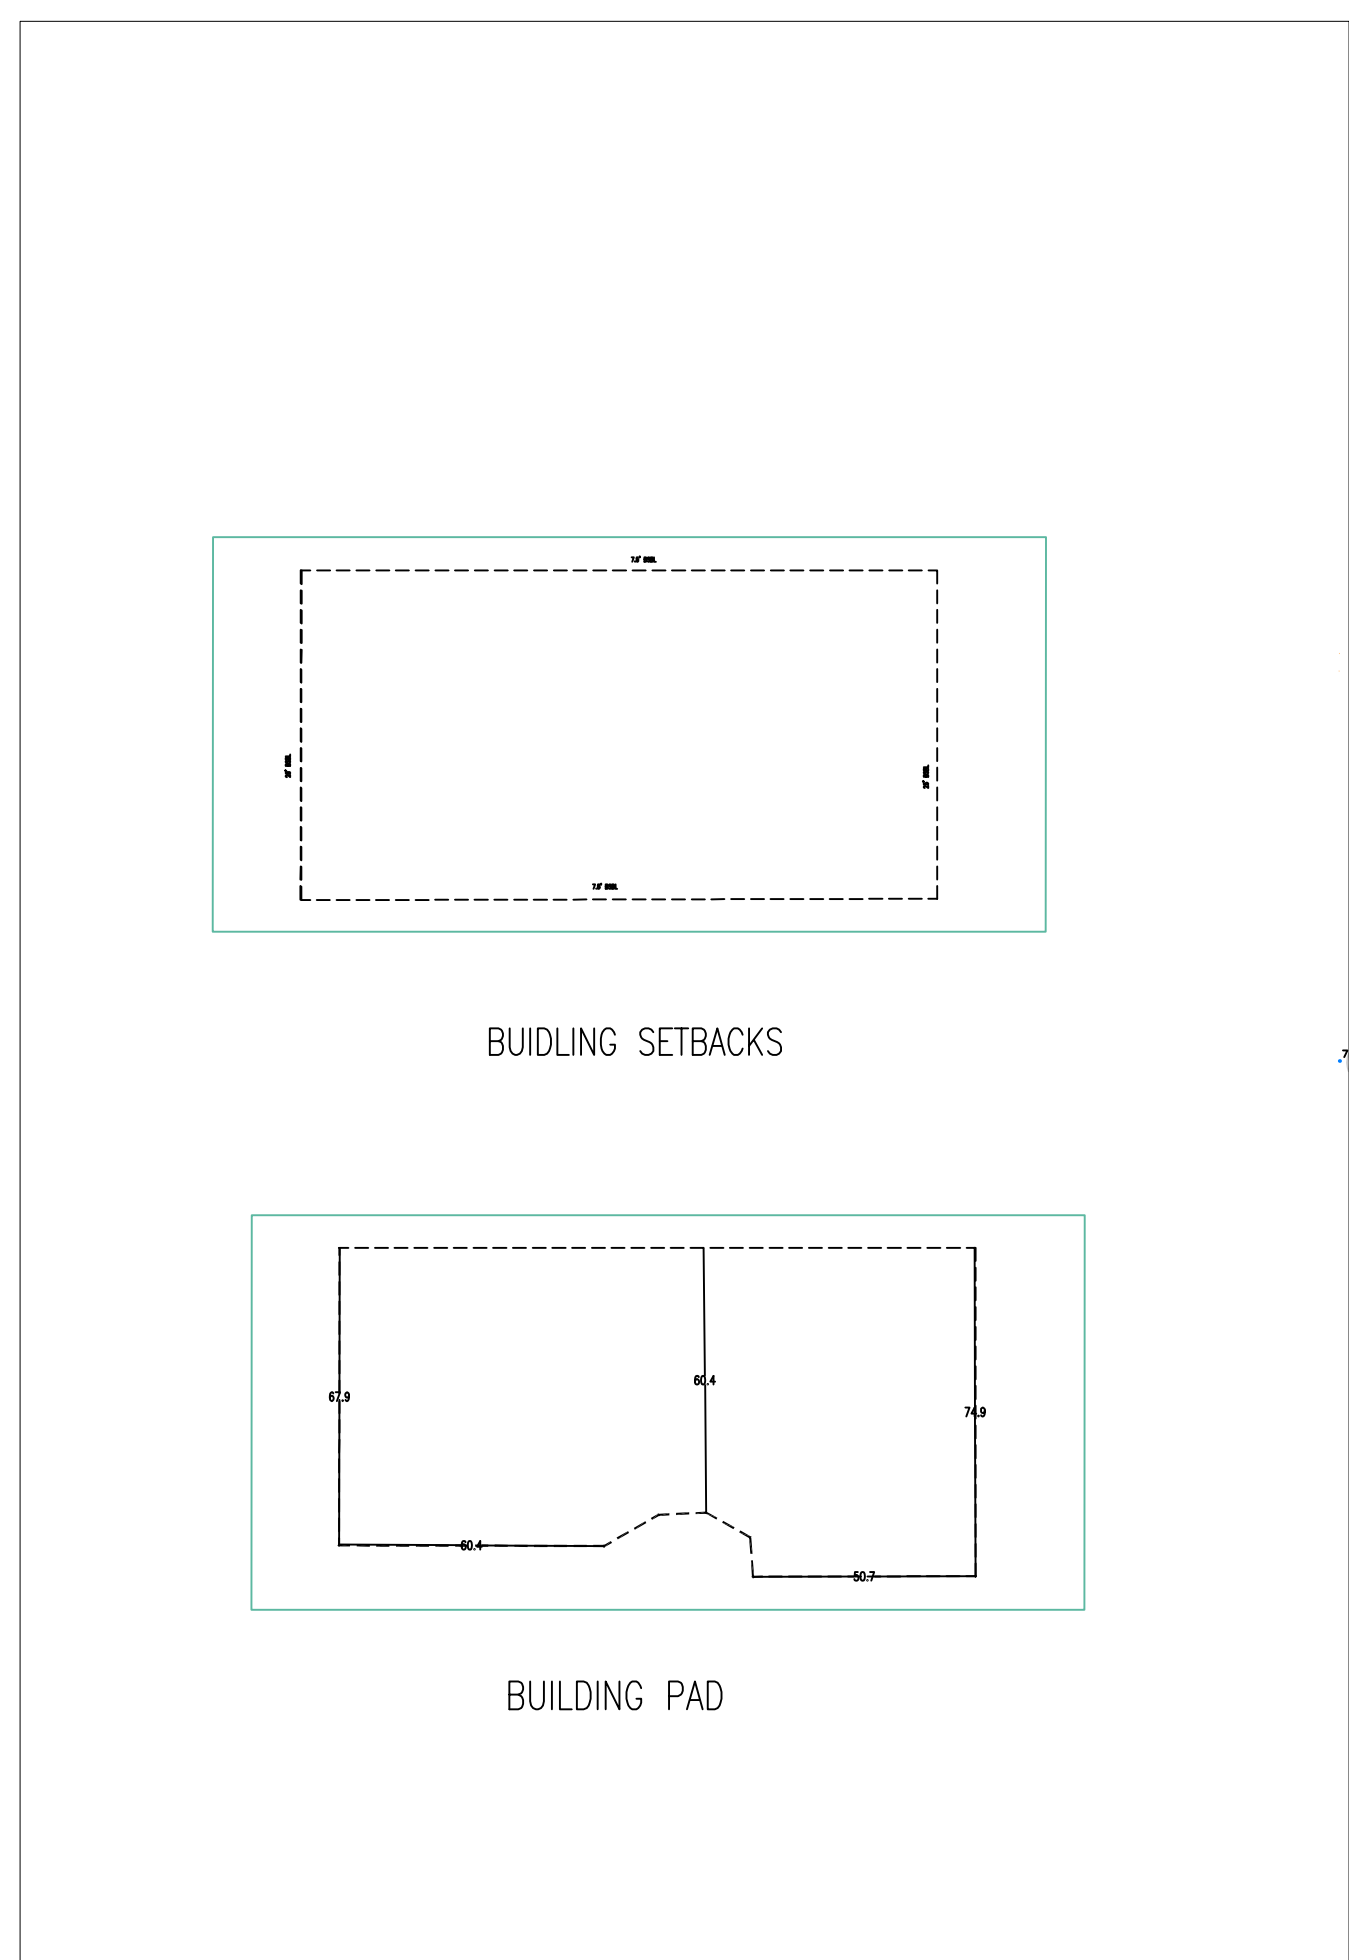


JayMarc Homes, LLC
 7525 SE 24th St, #487
 Mercer Island, WA 98040
 425 281 2706

Dubay/Dwivedi Residence
 8434 SE 39th St, Mercer Island
 SITE PLAN DETAILS

Drawn by
 GU

6/2/23

A2.1

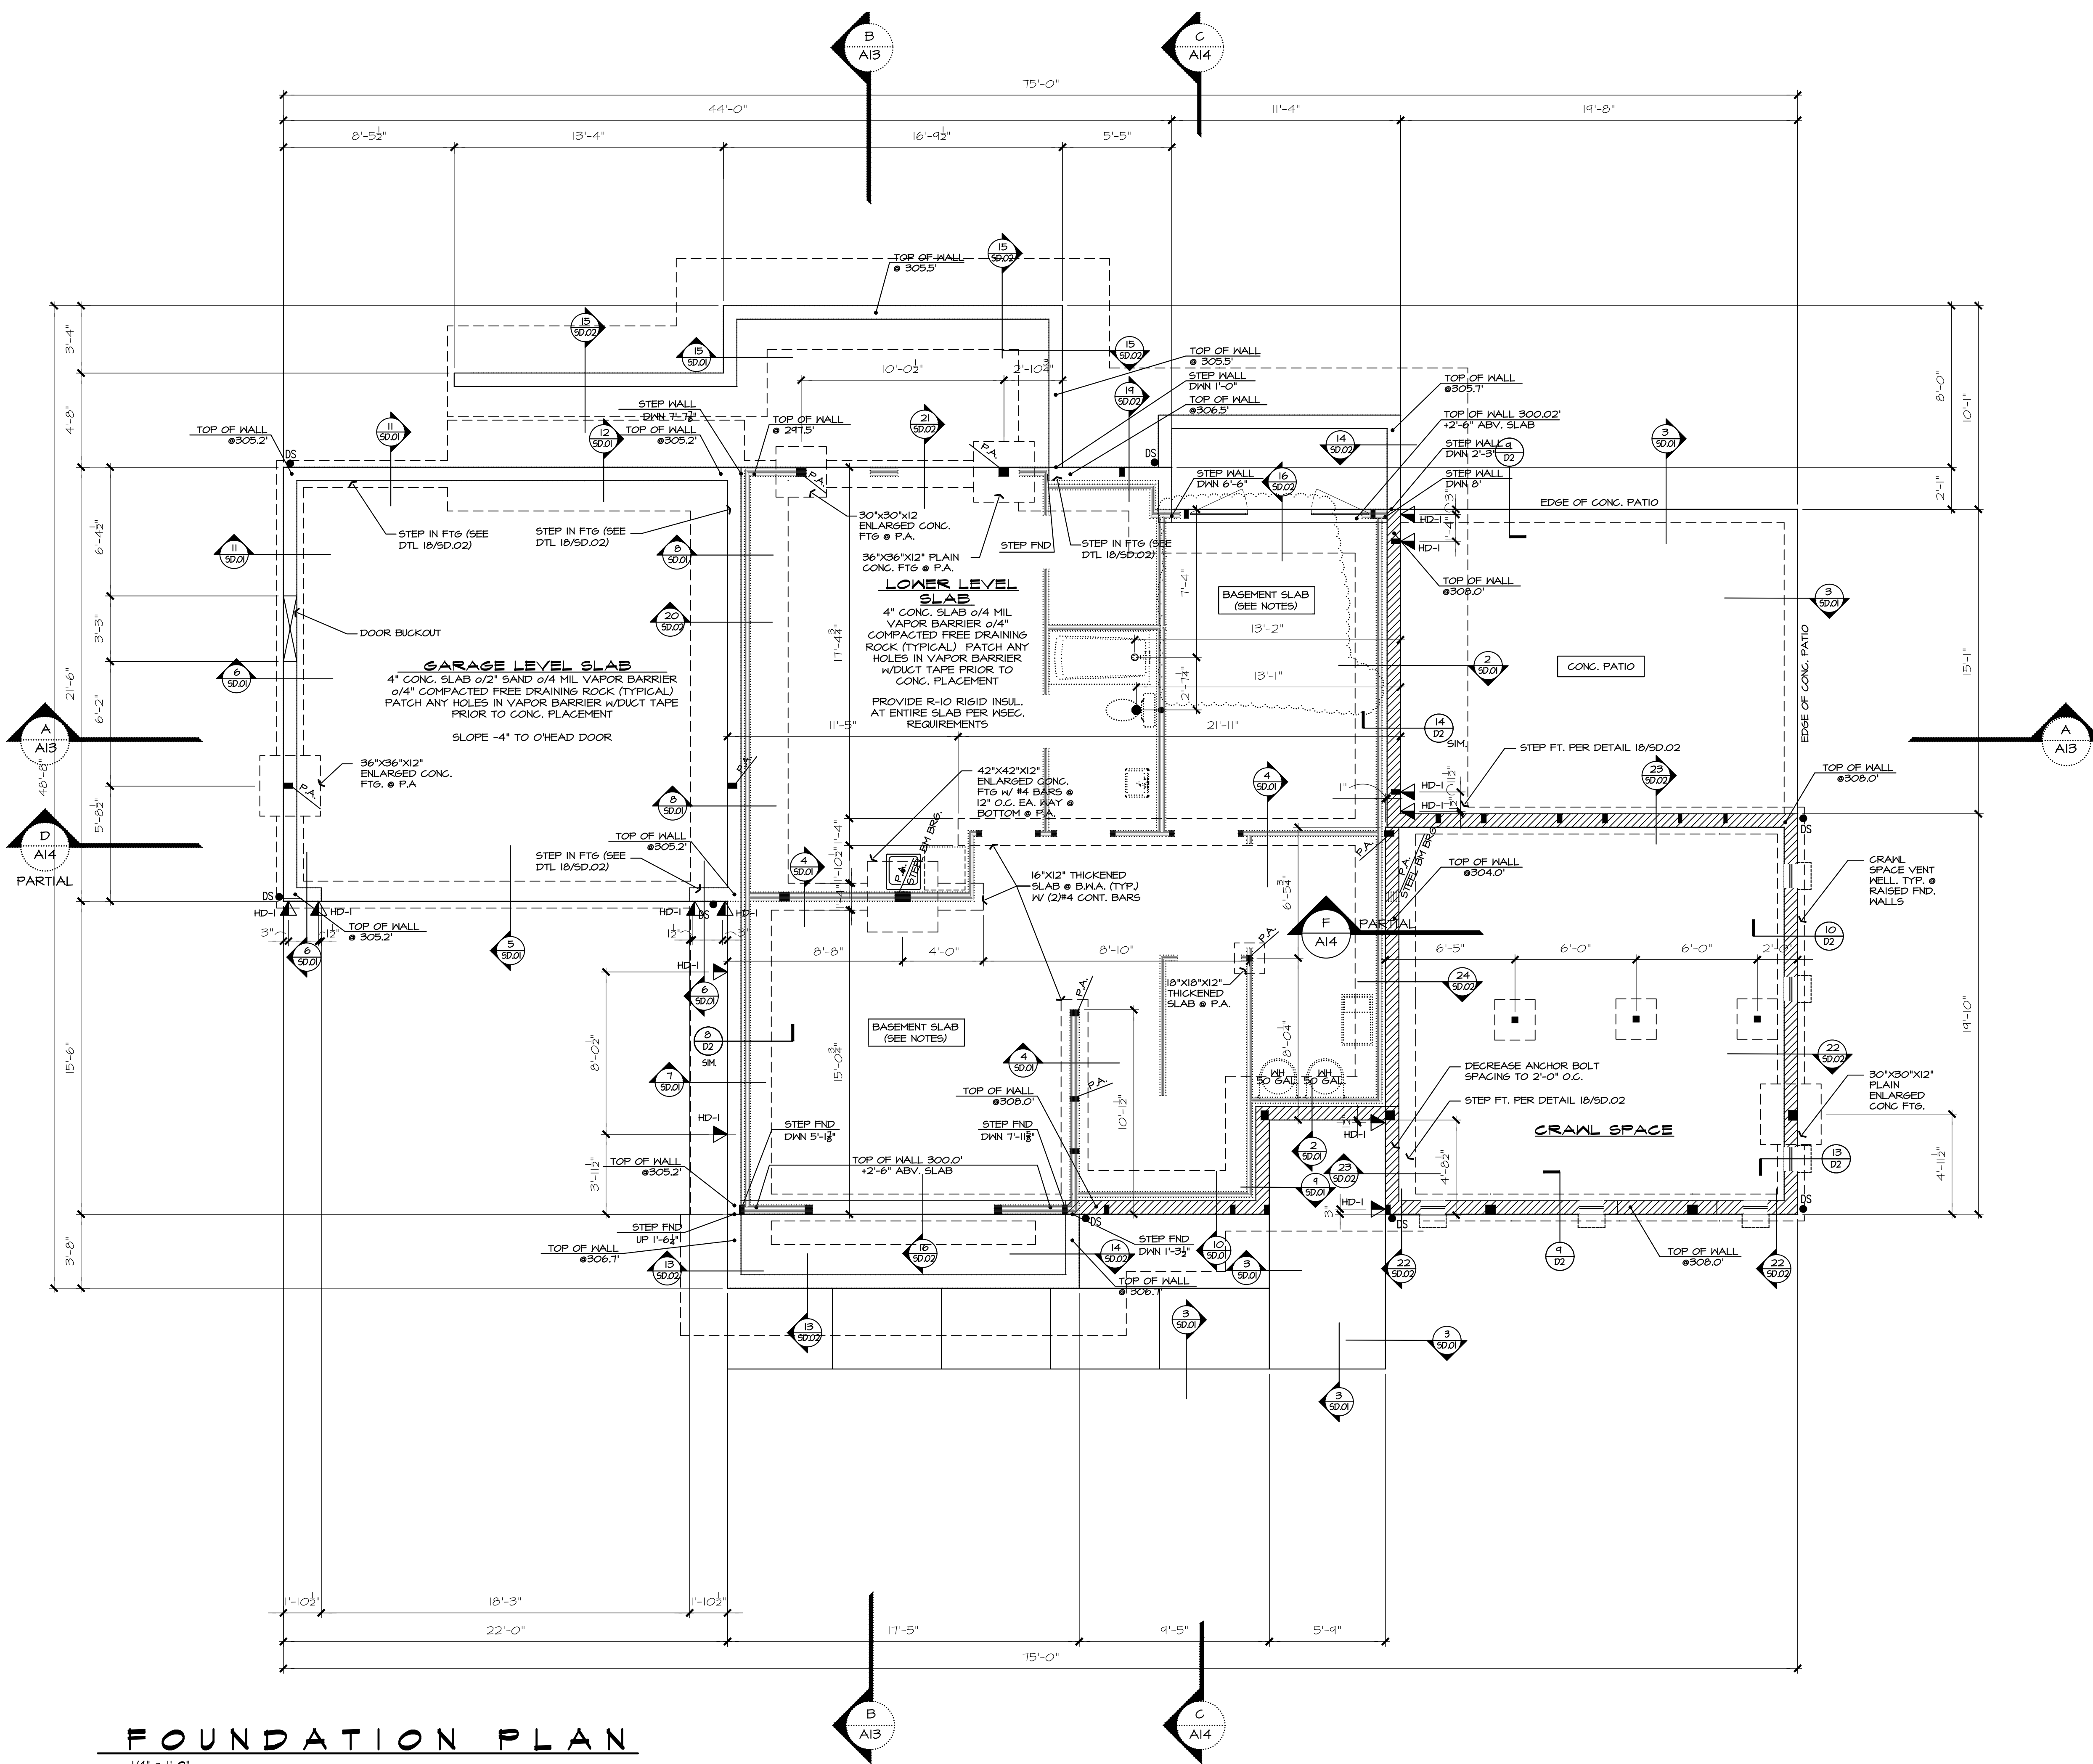

NOTES:

| HOLD-DOWN SCHEDULE | |
|--------------------|---|
| SYMBOL | SPECIFICATION |
| HD-1 | SIMPSON 5THD14 (R.J) HOLD-DOWN |
| HD-5 | SIMPSON CSI6 STRAP TIE (14" END LENGTH) |
| HD-6 | SIMPSON MSTC40 STRAP TIE (12" END LENGTH) |
| HD-7 | SIMPSON MSTC66 STRAP TIE (24" END LENGTH) |

| LEGEND | |
|--------|--|
| | INTERIOR BEARING WALL |
| | EXTERIOR WALL ABOVE |
| | J.L. METAL HANGER |
| | * INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE. |
| | INDICATES HOLD-DOWN. |

REFER TO S-O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES



7525 SE 24th St., 487
Mercer Island, WA
98040
425.266.9100

| Issue | Issue Date | By | Description |
|-------|------------|----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JMC025

plan name: - -
marketing name: - -
plan number: - -
mark sys. number: - -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submission Date

Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

.....
Checked by:

Primary Scale

A3
of .

Sheet Title/Description

LOWER FLOOR PLAN NOTES

PLAN SPECIFIC 2018 INSEC. SECTION R06
 R406.2 ADDITIONAL ENERGY EFFICIENCY REQUIREMENTS (MANDATORY). THIS RESIDENTIAL DWELLING SHALL COMPLY w/SUFFICIENT OPTIONS FROM TABLE R406.2 TO ACHIEVE THE FOLLOWING MIN. NUMBER OF CREDITS:
 6 FOR a 1500sf to 4999sf HOME.
 CREDITS PROVIDED IN THIS HOME AS FOLLOWS:
EFFICIENT BUILDING ENVELOPE OPT. 1.3: 0.5 CREDITS
 PRESCRIPTIVE COMPLIANCE IS BASED ON TABLE R402.1.1 WITH FOLLOWING MODIFICATIONS:
 VERTICAL FENESTRATION U = 0.28 WINDOWS
 FLOORS TO BE R-38 and SLAB ON GRADE TO BE R-10 PERIMETER and UNDER ENTIRE SLAB BELOW GRADE.
AIRLEAKAGE & EFFICIENT VENTILATION OPT. 2.1: 0.5 CREDITS
 REDUCE THE TESTED AIR LEAKAGE TO 3.0 AIR CHANGES PER HOUR MAXIMUM @ 50 Pascals AND ALL WHOLE HOUSE VENTILATION REQUIREMENTS AS DETERMINED BY SECTION M501.3 OF THE IRC, OR SECTION 404.8 OF THE I.M.C SHALL BE MET WITH A HIGH EFFICIENCY FAN(S) (MAXIMUM) OF 0.35 WATTS/ CFM, NOT INTERLOCKED WITH THE FURNACE FAN (IF PRESENT). VENTILATION SYSTEMS USING A FURNACE INCLUDING AN EMG MOTOR ARE ALLOWED, PROVIDED THAT THEY ARE CONTROLLED TO OPERATE AT LOW SPEED IN THE VENTILATION ONLY MODE.
HIGH EFFICIENCY HVAC EQUIPMENT OPT. 3.5g: 1.5 CREDITS
 HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) INSTALLATION SHALL COMPLY WITH THE REQUIREMENTS OF SECTION R403.3.7. LOCATING SYSTEM COMPONENTS IN CONDITIONED CRAWL SPACE IS NOT PERMITTED UNDER THIS OPTION. ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION. DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.
HIGH EFFICIENCY HVAC DISTRIBUTION OPT. 4.2: 1.0 CREDITS
 HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) SHALL COMPLY WITH THE REQUIREMENTS OF SECT R403.3.7. LOCATING SYSTEM COMPONENTS IN CONDITIONED CRAWL SPACES IS NOT PERMITTED UNDER THIS OPTION. ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION. DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.
EFFICIENT WATER HEATING 5.4: 1.5 CREDITS
 WATER HEATING SYSTEM SHALL INCLUDE ONE OF THE FOLLOWING:
 ELECTRIC HEAT PUMP WATER HEATER MEETING THE STANDARDS FOR Tier 1 of NEEA'S ADVANCED WATER HEATING SPECIFICATION. IF ONE WATER IS SERVING MORE THAN ONE DWELLING UNIT, ALL HOT WATER SUPPLY AND RECIRCULATION PIPING SHALL BE INSULATED WITH R-8 MINIMUM PIPE INSULATION.

WHOLE HOUSE VENTILATION

PROVIDE WHOLE HOUSE VENTILATION per 2018 IRC, M501 and IMC R403.8 USING LAUNDRY ROOM EXHAUST FAN INTEGRATED INTO FORCED AIR SYSTEM (FAU). PROVIDE OUTDOOR FRESH AIR W/DUCTS CONNECTED TO THE RETURN SIDE OF THE AIR HANDLER.

| SYMBOL | LOCATION | MIN. FAN REQUIREMENTS (ALL FANS VENT TO OUTSIDE) |
|--------|--------------------------------------|---|
| | BATH & POWDER | Min. 50cfm. INTERMITTENT at .025mg per TABLE M501.4 |
| | KITCHEN | Min. 100cfm. INTERMITTENT at .025mg per TBL. M501.4 |
| | RANGE HOOD or DOWN DRAFT EXHAUST FAN | RATED at min. 100cfm. at 0.10mg may be used FOR EXHAUST FAN REGR. EXHAUST HOODS IN EXCESS OF 400cfm SHALL BE INTERLOCKED AND PROVIDE MAKE UP AIR per w/M503.4 |
| | LAUNDRY ROOM | MIN. 360cfm. INTERMITTENT at .025mg to FUNCTION AS WHOLE HOUSE FAN (WHF.) |

MECHANICAL CONTRACTOR TO SIZE WHF, FAN and SET OPERATING TIMER per TABLE M501.3(3) (1) FOR A 3,001-4,500sf. DWELLING w/4-5 BEDRMS. TO OPERATE INTERMITTENTLY and CONTINUOUSLY per TABLE M501.3(3)(2)
 PROVIDE CONTROLS FOR WHF per M501.3.2 AFFIX LABEL TO CONTROLS THAT READS "WHOLE HOUSE VENTILATION - SEE OPERATING INSTRUCTIONS"

| | |
|-------------------|---|
| plan name: | - |
| marketing name: | - |
| plan number: | - |
| mark sys. number: | - |

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
 Submittal Date

Sheet Title/Description

JAYMARC HOMES
 Design Firm

R.K.N.
 Drawn by:


Checked by:

Primary Scale

A4
 of .

| | |
|--|-------------|
| TOTAL MAIN FLOOR | 2,640 S.F. |
| UPPER FLOOR AREA | 1,621 S.F. |
| TOTAL NET AREA | 3,154 S.F. |
| STAIR DEDUCTIONS | -208 S.F. |
| TOTAL FAR PROPOSED | 3521 S.F. |
| MAXIMUM FAR, LOT AREA | 17,100 S.F. |
| MAXIMUM FAR, 40% + ADU = 6,840 + 394 = | 7,234 S.F. |
| COVD PORCH | 27 |

Updated: 12.03.20
 Method for Calculating Square Footage - ANSI Z765-2013 except; no separate distinction of above-grade or below-grade areas and each level is measured to the outside of studs not the exterior finished surface.
 Square footage calculations for this house were made based on plan dimensions only and may vary from the finished square footage of the house on built.
 See Sheet "CODES" for additional Zoning required Area Calculations

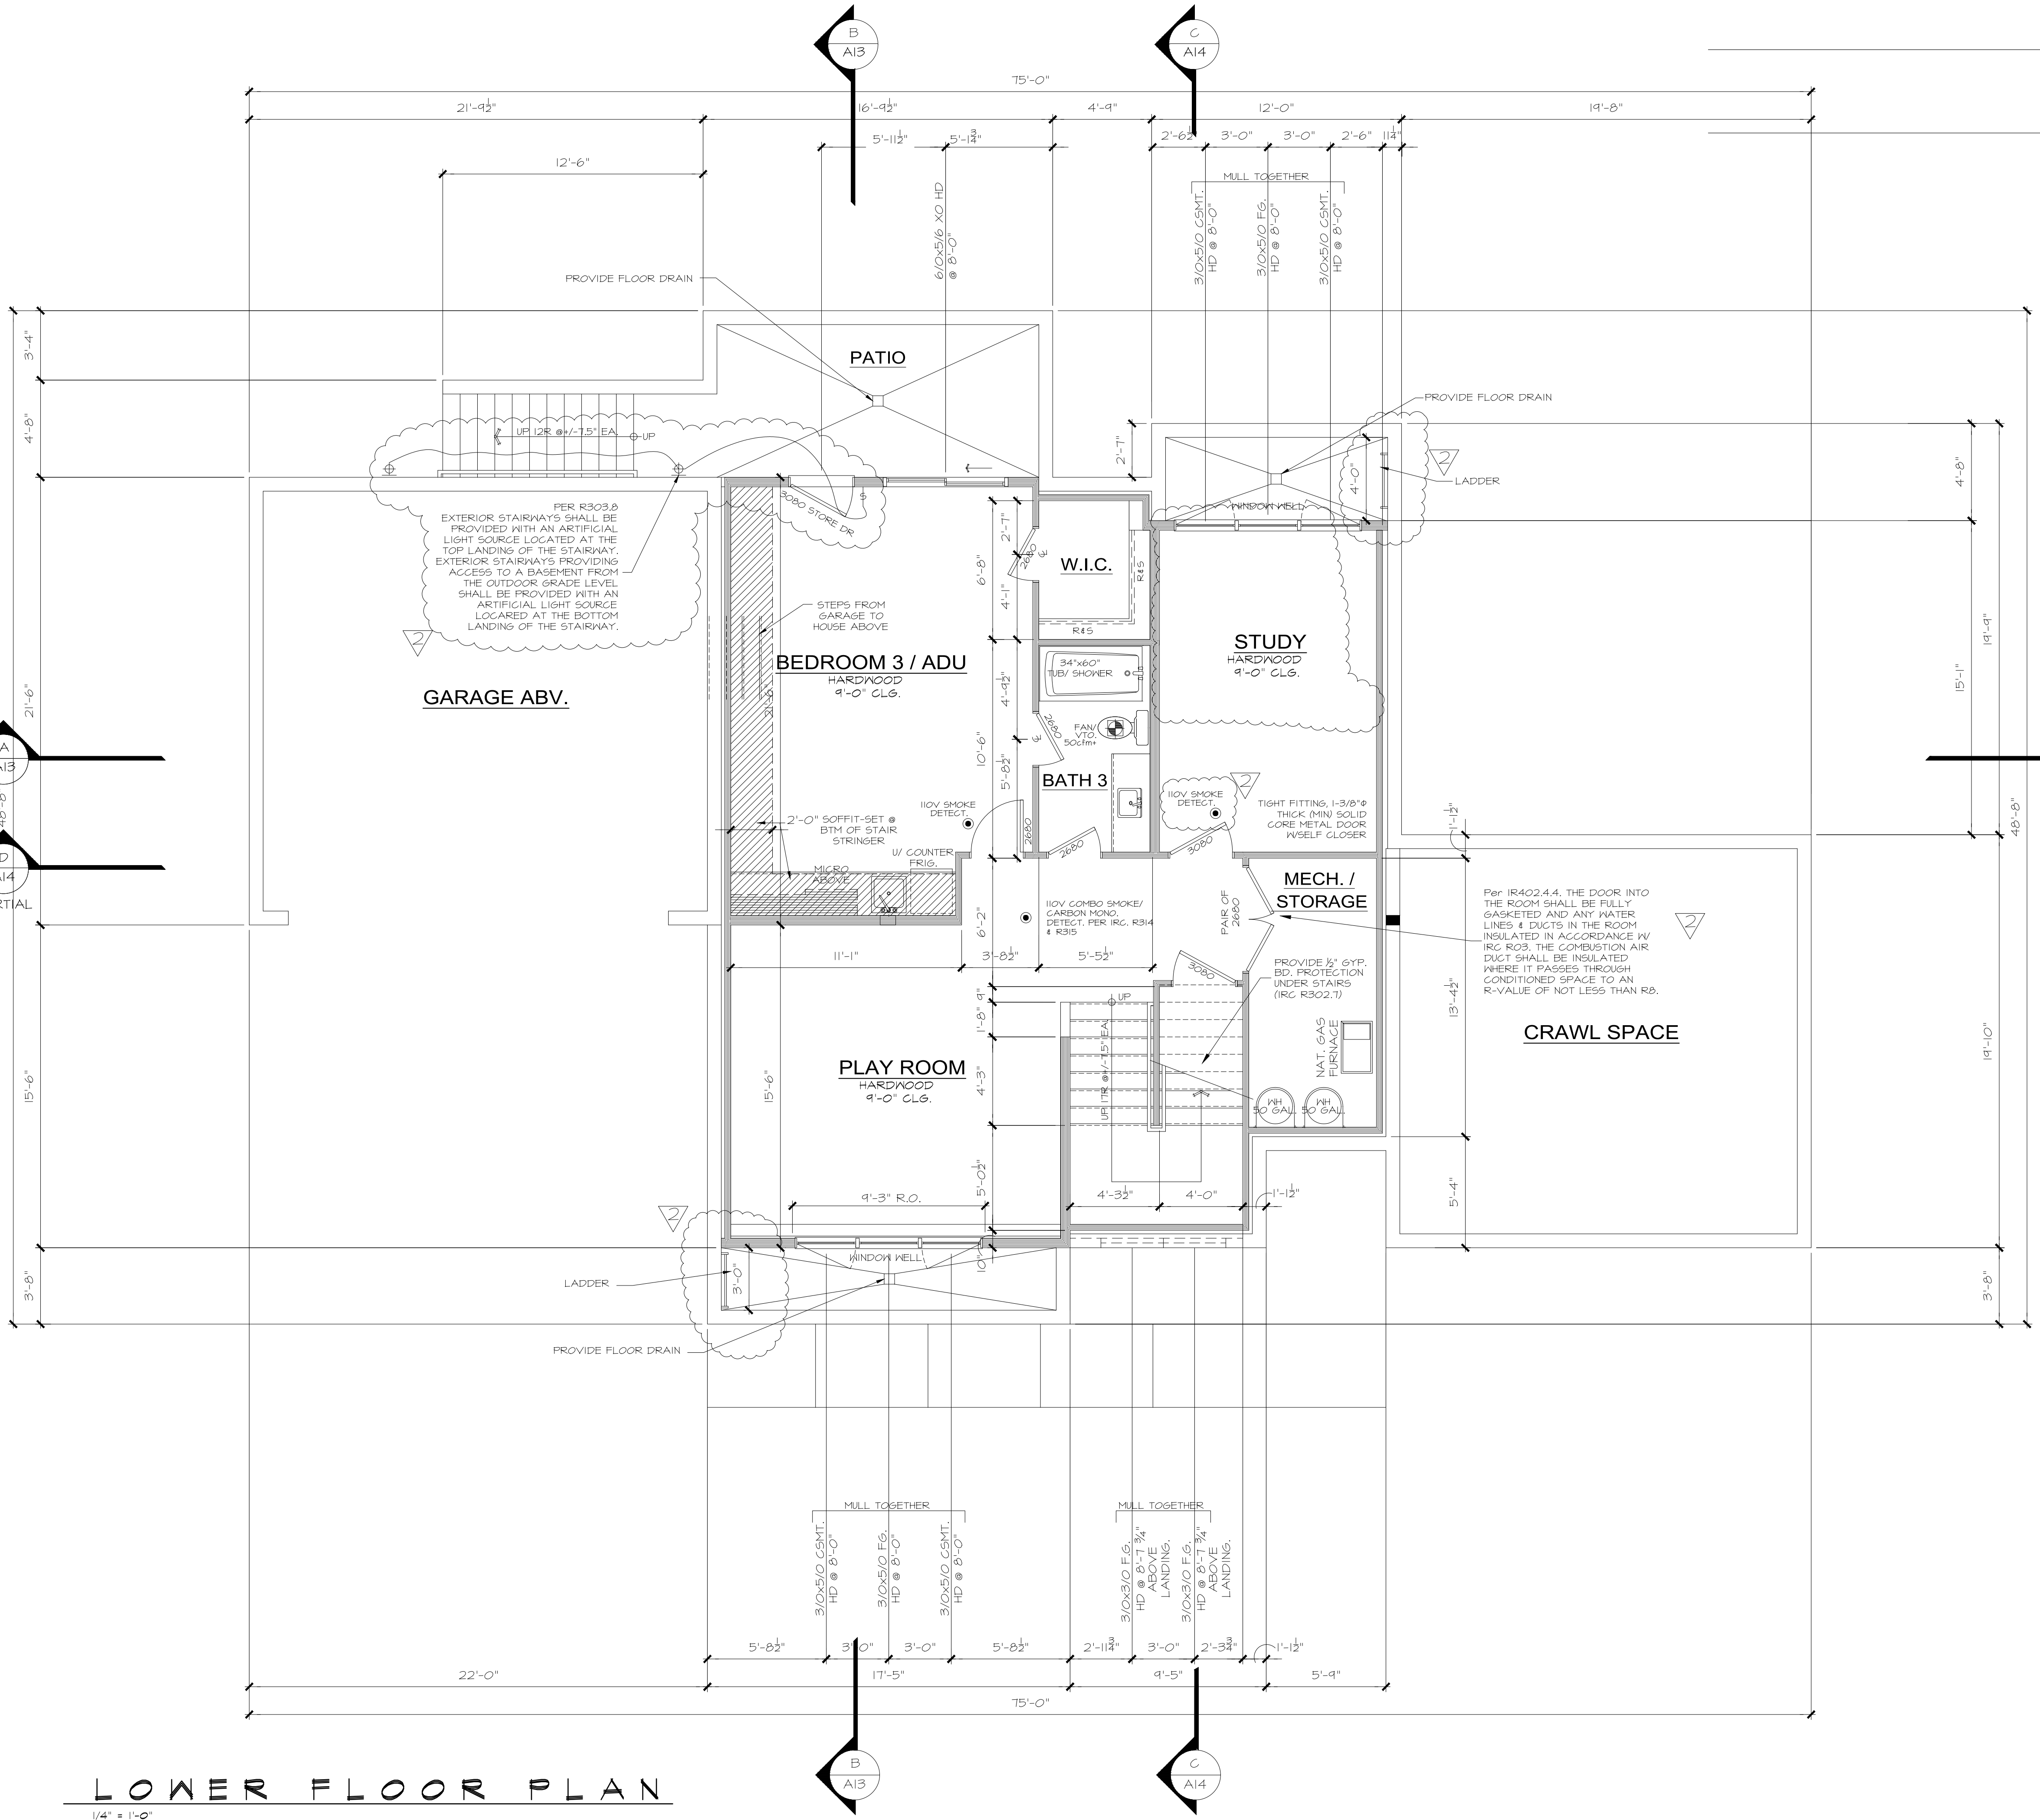

Sheet Title/Description

| HOLD-DOWN SCHEDULE | |
|--------------------|---|
| SYMBOL | SPECIFICATION |
| HD-1 | SIMPSON 5THD14 (R.J.) HOLD-DOWN |
| HD-5 | SIMPSON C516 STRAP TIE (14" END LENGTH) |
| HD-6 | SIMPSON MSTC40 STRAP TIE (12" END LENGTH) |
| HD-7 | SIMPSON MSTC66 STRAP TIE (24" END LENGTH) |

| LEGEND | |
|--------|--|
| JL | METAL HANGER |
| * | INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE. |
| ▲ | INDICATES HOLD-DOWN. |

INDICATES 11-7/8" TJI FLOOR JOISTS @ 19.2" O.C. (TYP. U.N.O.)

REFER TO S-O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

4X10 DROPPED CONT. BEAM (TYP. U.N.O.)

NOTE #1:
 PROVIDE 1/8" OSB/PLYWOOD SHTG. + FASTEN PER TYP. WALL SHTG. SPECS. (SEE NOTES)

| Issue Description | Issue Date | By |
|-------------------|------------|----|
| | | |
| | | |
| | | |
| | | |

8434 SE 39th ST.
 Mercer Island, WA.
 Job Number: JMC025

plan name: :
 marketing name: :
 plan number: :
 mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC. All rights reserved.

12.13.23
 Submittal Date

Sheet Title/Description
 JAYMARC HOMES
 Design Firm


R.K.N.
 Drawn by:

Checked by:

Primary Scale

A5
 of .

Sheet Title/Description

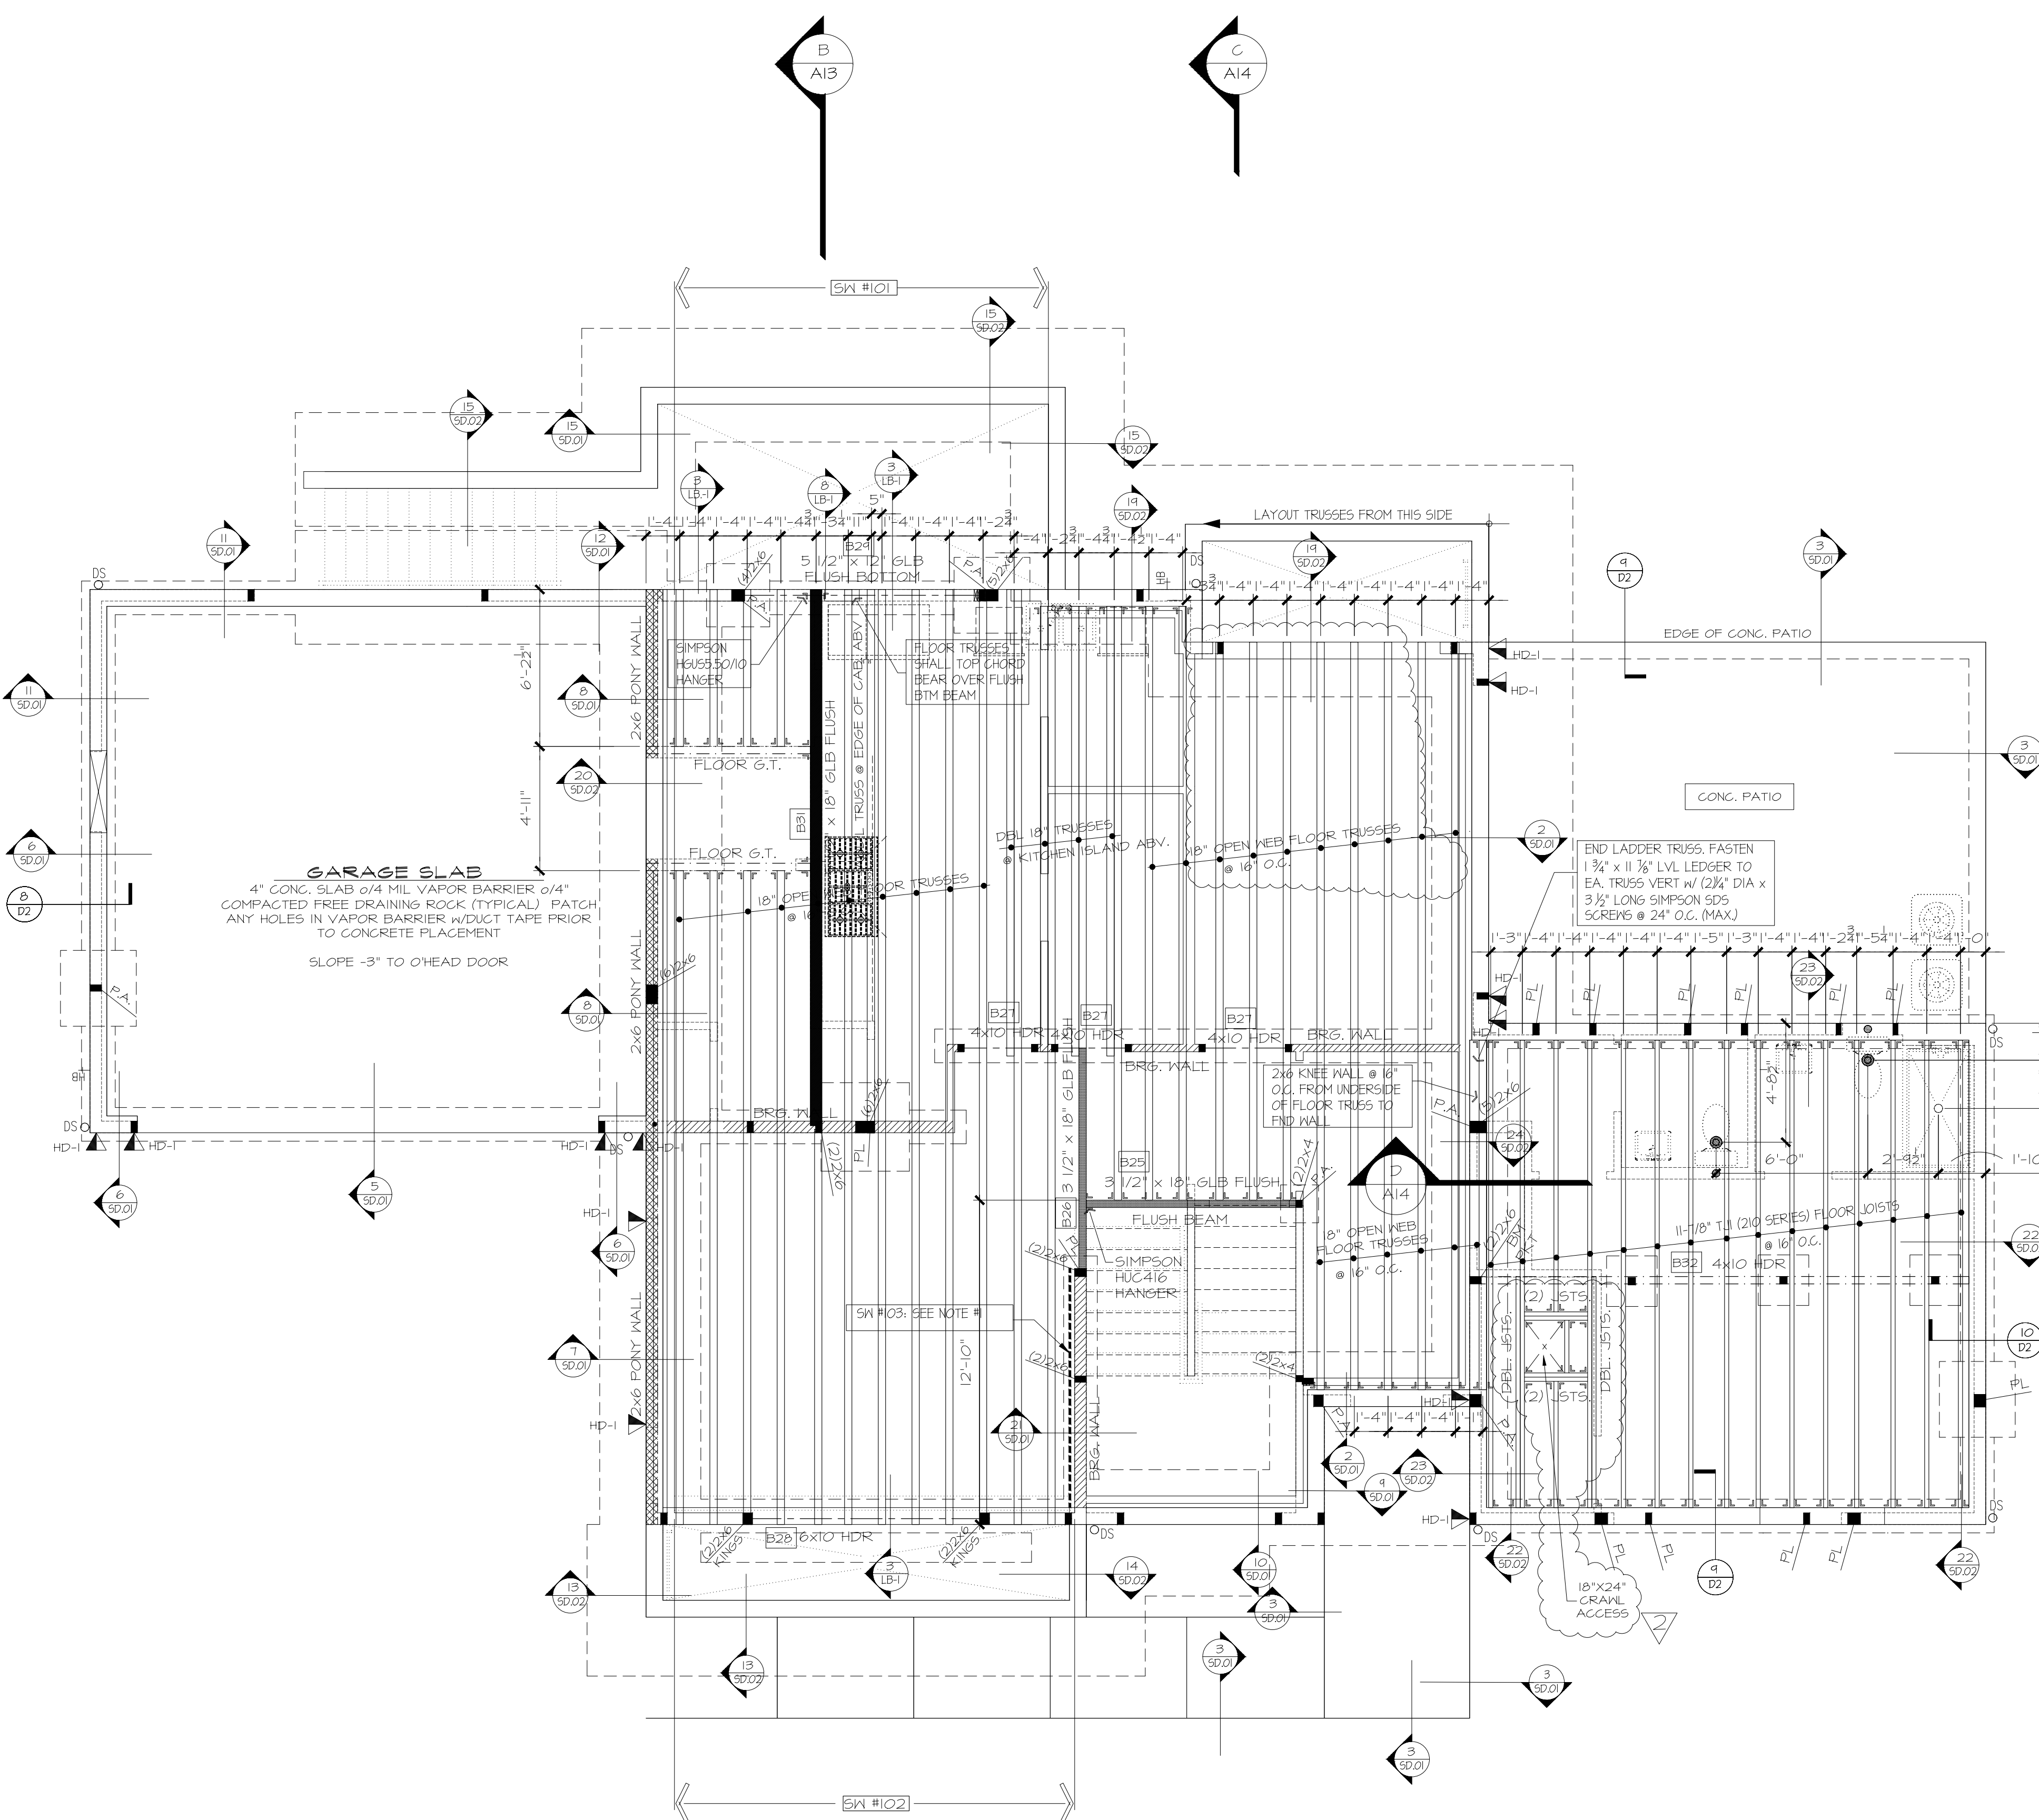

MAIN FLOOR FRAMING PLAN

1/4" = 1'-0"

| SQUARE FOOTAGE SUMMARY | |
|------------------------|------------|
| CEMENT FLOOR AREA | 1,111 S.F. |
| FIN FLOOR AREA | 1,513 S.F. |
| PER FLOOR AREA | 1,621 S.F. |
| TOTAL CONDITIONED AREA | 4,305 S.F. |
| CAR GARAGE | 475 S.F. |
| 1/2 PATIO | 0 S.F. |
| 1/2 PORCH | 27 S.F. |
| TOTAL AREA UNDER ROOF | 4806 S.F. |
| OVERALL WIDTH | 75'-0" |

MAIN FLOOR PLAN NOTES

PLAN SPECIFIC 2018 WSEC SECTION R02

R402.2 ADDITIONAL ENERGY EFFICIENCY REQUIREMENTS (MANDATORY). THIS RESIDENTIAL DWELLING SHALL COMPLY W/SUFFICIENT OPTIONS FROM TABLE R402.2 TO ACHIEVE THE FOLLOWING MIN. NUMBER OF CREDITS: 6 FOR A 1501sf to 4,999sf HOME.

CREDITS PROVIDED IN THIS HOME AS FOLLOWS:
EFFICIENT BUILDING ENVELOPE OPT. 1.3: 0.5 CREDITS

PRESCRIPTIVE COMPLIANCE IS BASED ON TABLE R402.11 WITH FOLLOWING MODIFICATIONS:
VERTICAL FENESTRATION U = 0.28 WINDOWS
FLOORS TO BE R-38 and SLAB ON GRADE TO BE R-10 PERIMETER and UNDER ENTIRE SLAB BELOW GRADE.

AIRLEAKAGE & EFFICIENT VENTILATION OPT. 2.1: 0.5 CREDITS

REDUCE THE TESTED AIR LEAKAGE TO 3.0 AIR CHANGES PER HOUR MAXIMUM @ 50 PASCALS AND ALL WHOLE HOUSE VENTILATION REQUIREMENTS AS DETERMINED BY SECTION M507.3 OF THE IRC, OR SECTION 404.5 OF THE IMC SHALL BE MET WITH A HIGH EFFICIENCY FAN(S) (MAXIMUM OF 0.35 WATTS/CFM), NOT INTERLOCKED WITH THE FURNACE FAN (IF PRESENT). VENTILATION SYSTEMS USING A FURNACE INCLUDING AN EMC MOTOR ARE ALLOWED PROVIDED THAT THEY ARE CONTROLLED TO OPERATE AT LOW SPEED IN THE VENTILATION ONLY MODE.

HIGH EFFICIENCY HVAC EQUIPMENT OPT. 3.5a: 1.5 CREDITS

HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) INSTALLATION SHALL COMPLY WITH THE REQUIREMENTS OF SECTION R403.3.1. LOCATING SYSTEM COMPONENTS IN CONDITIONED CRAWL SPACE IS NOT PERMITTED UNDER THIS OPTION. ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION. DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.

HIGH EFFICIENCY HVAC DISTRIBUTION OPT. 4.2: 1.0 CREDITS

HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) SHALL COMPLY WITH THE REQUIREMENTS OF SECT R403.3.1. LOCATING SYSTEM COMPONENTS IN UNCONDITIONED CRAWL SPACES IS NOT PERMITTED UNDER THIS OPTION. ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION. DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.

EFFICIENT WATER HEATING 5.4: 1.5 CREDITS

WATER HEATING SYSTEM SHALL INCLUDE ONE OF THE FOLLOWING: ELECTRIC HEAT PUMP WATER HEATER MEETING THE STANDARDS FOR Tier 1 of NEEA'S ADVANCED WATER HEATING SPECIFICATION. IF ONE WATER IS SERVING MORE THAN ONE DWELLING UNIT, ALL HOT WATER SUPPLY AND RECIRCULATION PIPING SHALL BE INSULATED WITH R-8 MINIMUM PIPE INSULATION.

WHOLE HOUSE VENTILATION

PROVIDE WHOLE HOUSE VENTILATION per 2018 IRC, M507 and IMC R403.8 USING LAUNDRY ROOM EXHAUST FAN INTEGRATED INTO FORCED AIR SYSTEM (FAU) PROVIDE OUTDOOR FRESH AIR W/DUCTS CONNECTED TO THE RETURN SIDE OF THE AIR HANDLER.

| SYMBOL | LOCATION | MIN. FAN REQUIREMENTS (ALL FANS VENT TO OUTSIDE) |
|--------|---------------|--|
| | BATH 4 PONDYR | Min. 50cfm, INTERMITTENT at .025mg per TABLE M507.4 |
| | KITCHEN | Min. 100cfm, INTERMITTENT at .025mg per TBL. M507.4 |
| | LAUNDRY ROOM | Min. 360cfm, INTERMITTENT at .025mg to FUNCTION AS WHOLE HOUSE FAN (WHF) |

MECHANICAL CONTRACTOR TO SIZE WHF, FAN and SET OPERATING TIMER per TABLE M507.3(1) FOR A 3,001-4,500sf DWELLING w/4-5 BEDRMS. TO OPERATE INTERMITTENTLY and CONTINUOUSLY per TABLE M507.3(2)
PROVIDE CONTROLS FOR WHF, per M507.3.2. AFFIX LABEL TO CONTROLS THAT READS "WHOLE HOUSE VENTILATION - SEE OPERATING INSTRUCTIONS"



7525 SE 24th St. 487
Mercer Island, WA
98040
425.266.9100

Issue Issue Date By Description

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JMC025

plan name: --
marketing name: --
plan number: --
mark sys. number: --

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submission Date

Sheet Title/Description


JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

Checked by:

Primary Scale

A6
of .

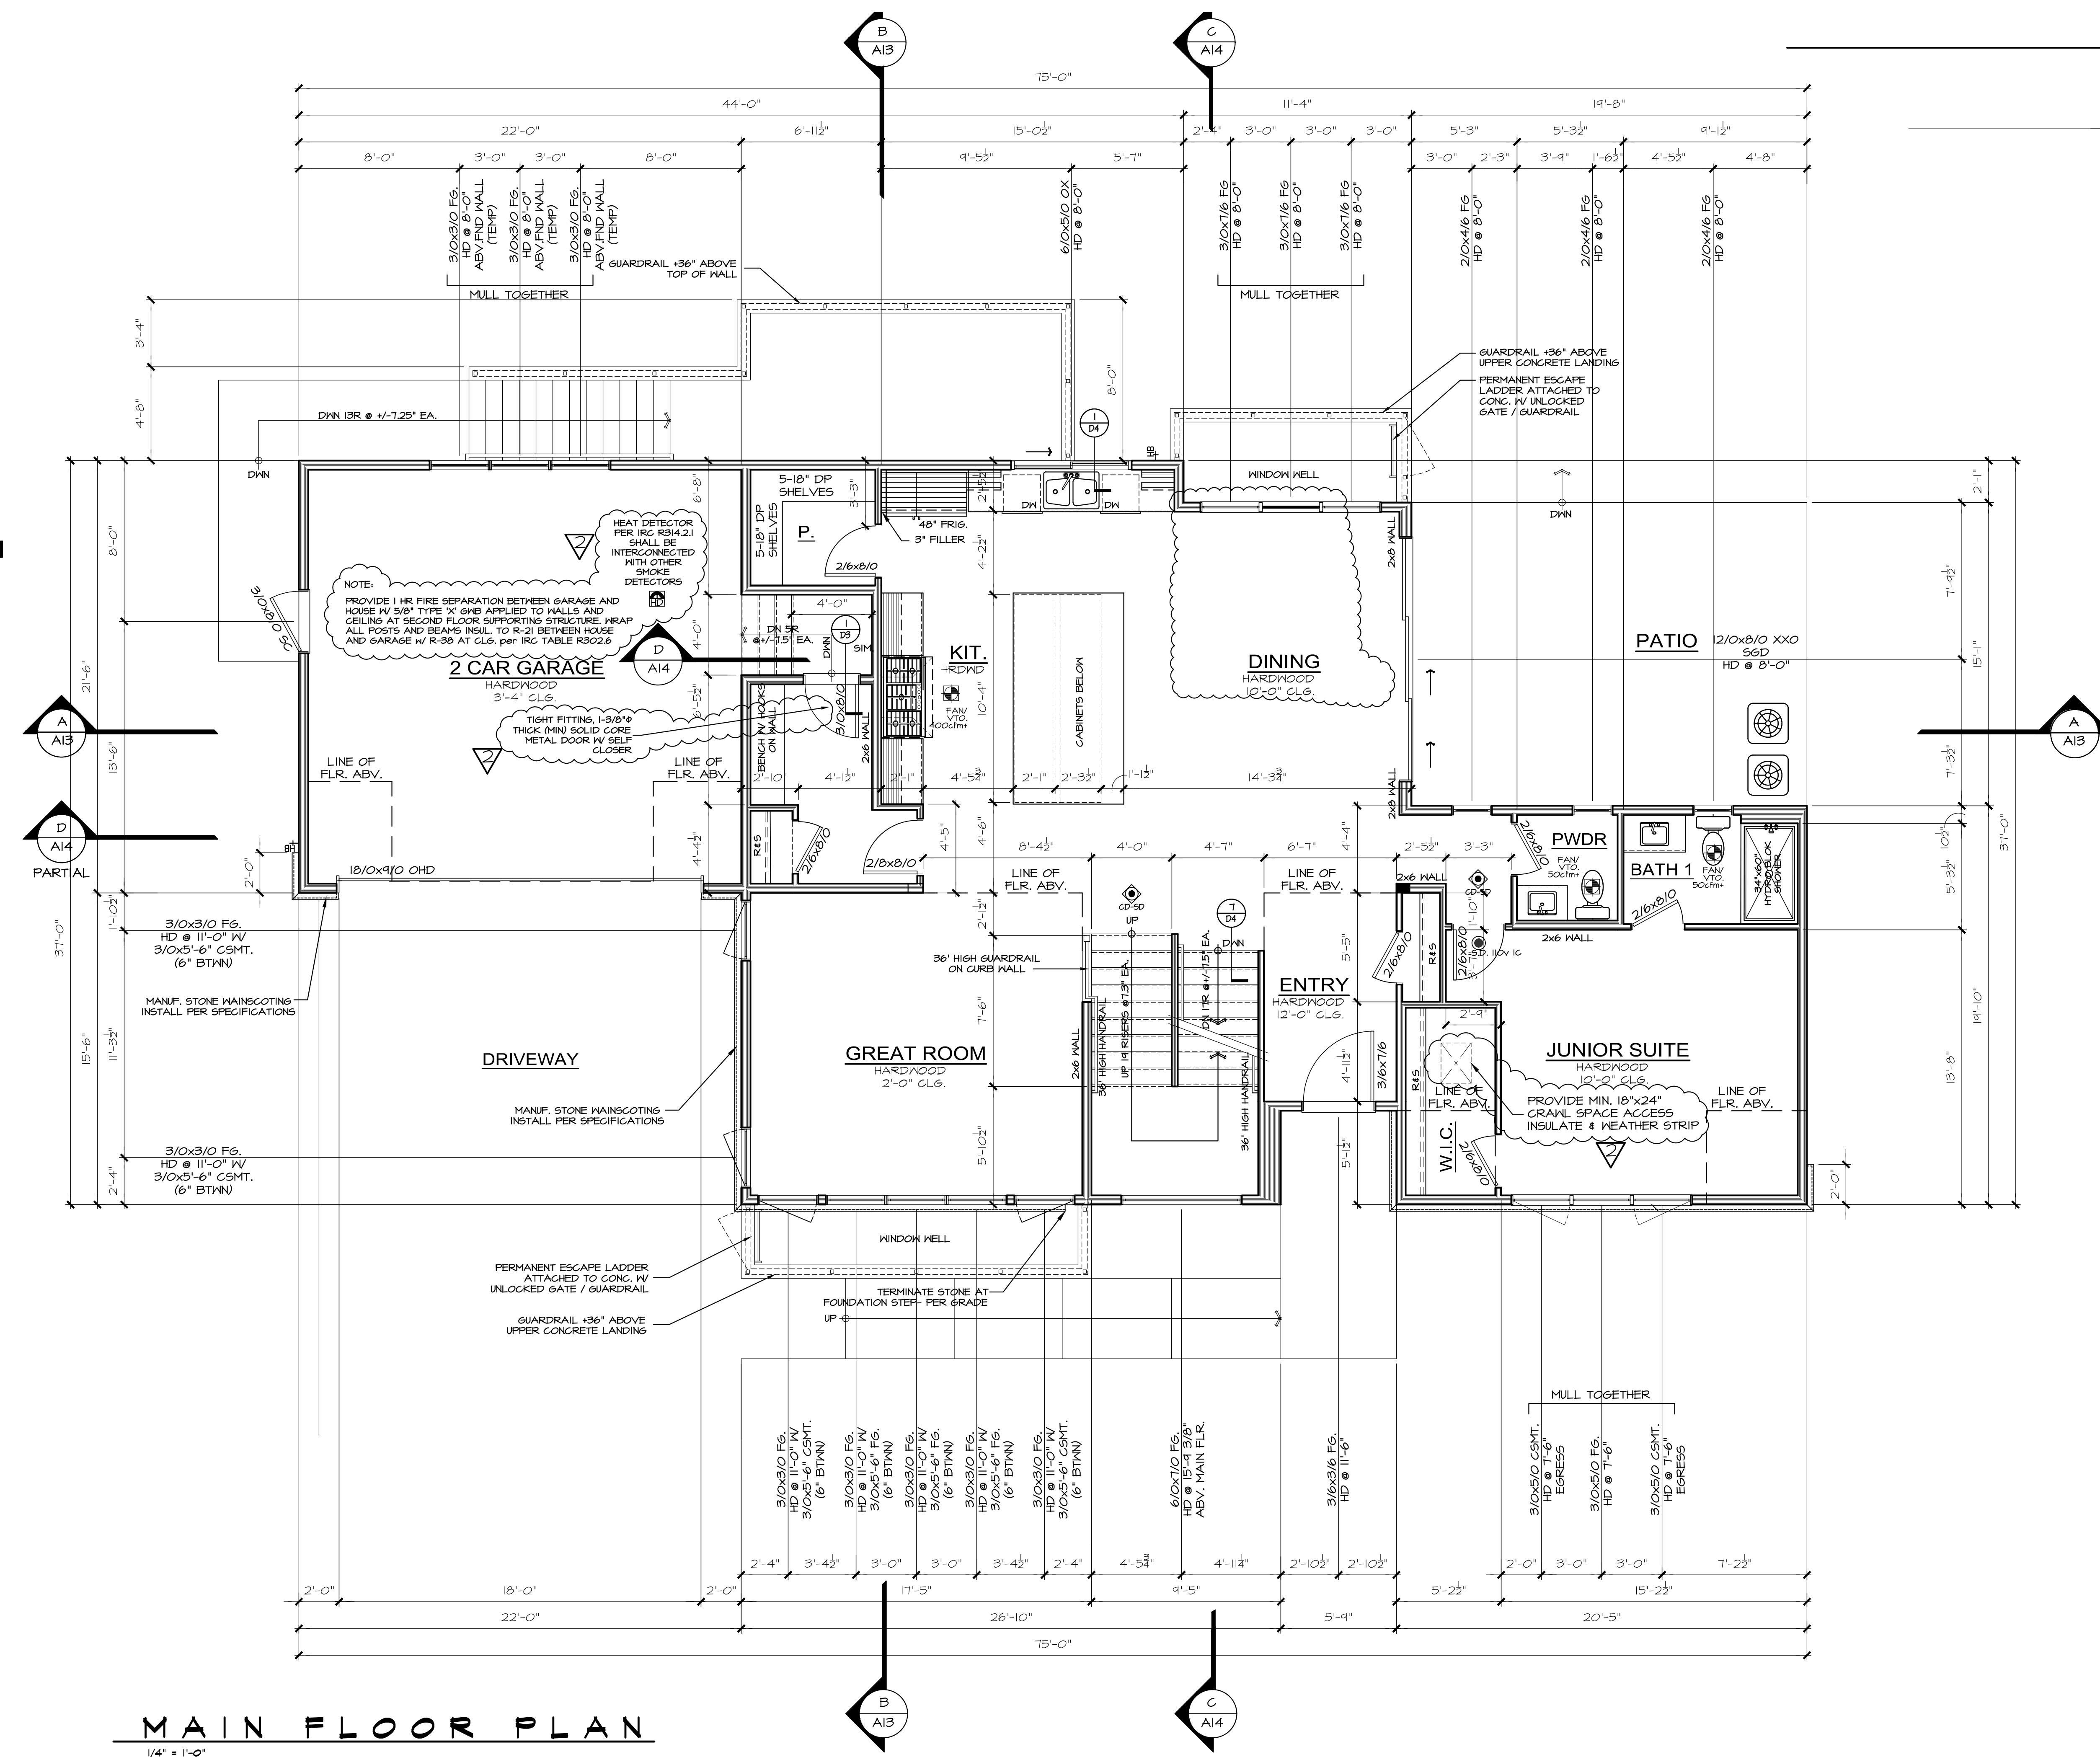

MAIN FLOOR PLAN
1/4" = 1'-0"

Sheet Title/Description



7525 SE 24th St, 487
Mercer Island, WA
98040
425.266.9100

| HOLD-DOWN SCHEDULE | |
|--------------------|---|
| SYMBOL | SPECIFICATION |
| HD-1 | SIMPSON 5THD14 (R.L.) HOLD-DOWN |
| HD-5 | SIMPSON CS16 STRAP TIE (14" END LENGTH) |
| HD-6 | SIMPSON MSTC40 STRAP TIE (12" END LENGTH) |
| HD-7 | SIMPSON MSTC66 STRAP TIE (24" END LENGTH) |

| LEGEND | |
|--------|--|
| | INTERIOR BEARING WALL |
| | BEAM / HEADER |
| | 18" FLOOR TRUSS @ 24" O.C. (U.N.O.) |
| | INTERIOR SHEAR WALL PANEL OR EXTERIOR SHEAR WALL w/ 3" o.c. EDGE NAILING |
| | J.L. METAL HANGER |
| | * INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE. |
| | ◀ INDICATES HOLD-DOWN. |

REFER TO S-O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

4x10 HDR @ ALL EXT. [B]
WINDOWS/DOORS (TYP. U.N.O.)

NOTE #1:
PROVIDE 3/16" OSB/PLYWOOD SHTG. + FASTEN PER TYP. WALL SHTG. SPECS. (SEE NOTES)

NOTE #2:
ALL WALLS 12' OR TALLER SHALL BE HF #2 GRADE OR BETTER @ 16" O.C.

| Issue | Issue Date | By | Description |
|-------|------------|----|-------------|
| | | | |
| | | | |
| | | | |

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JMC025

plan name: - -
marketing name: - -
plan number: - -
mark sys. number: - -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC), or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submittal Date


Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

.....
Checked by:

Primary Scale


A7
of .

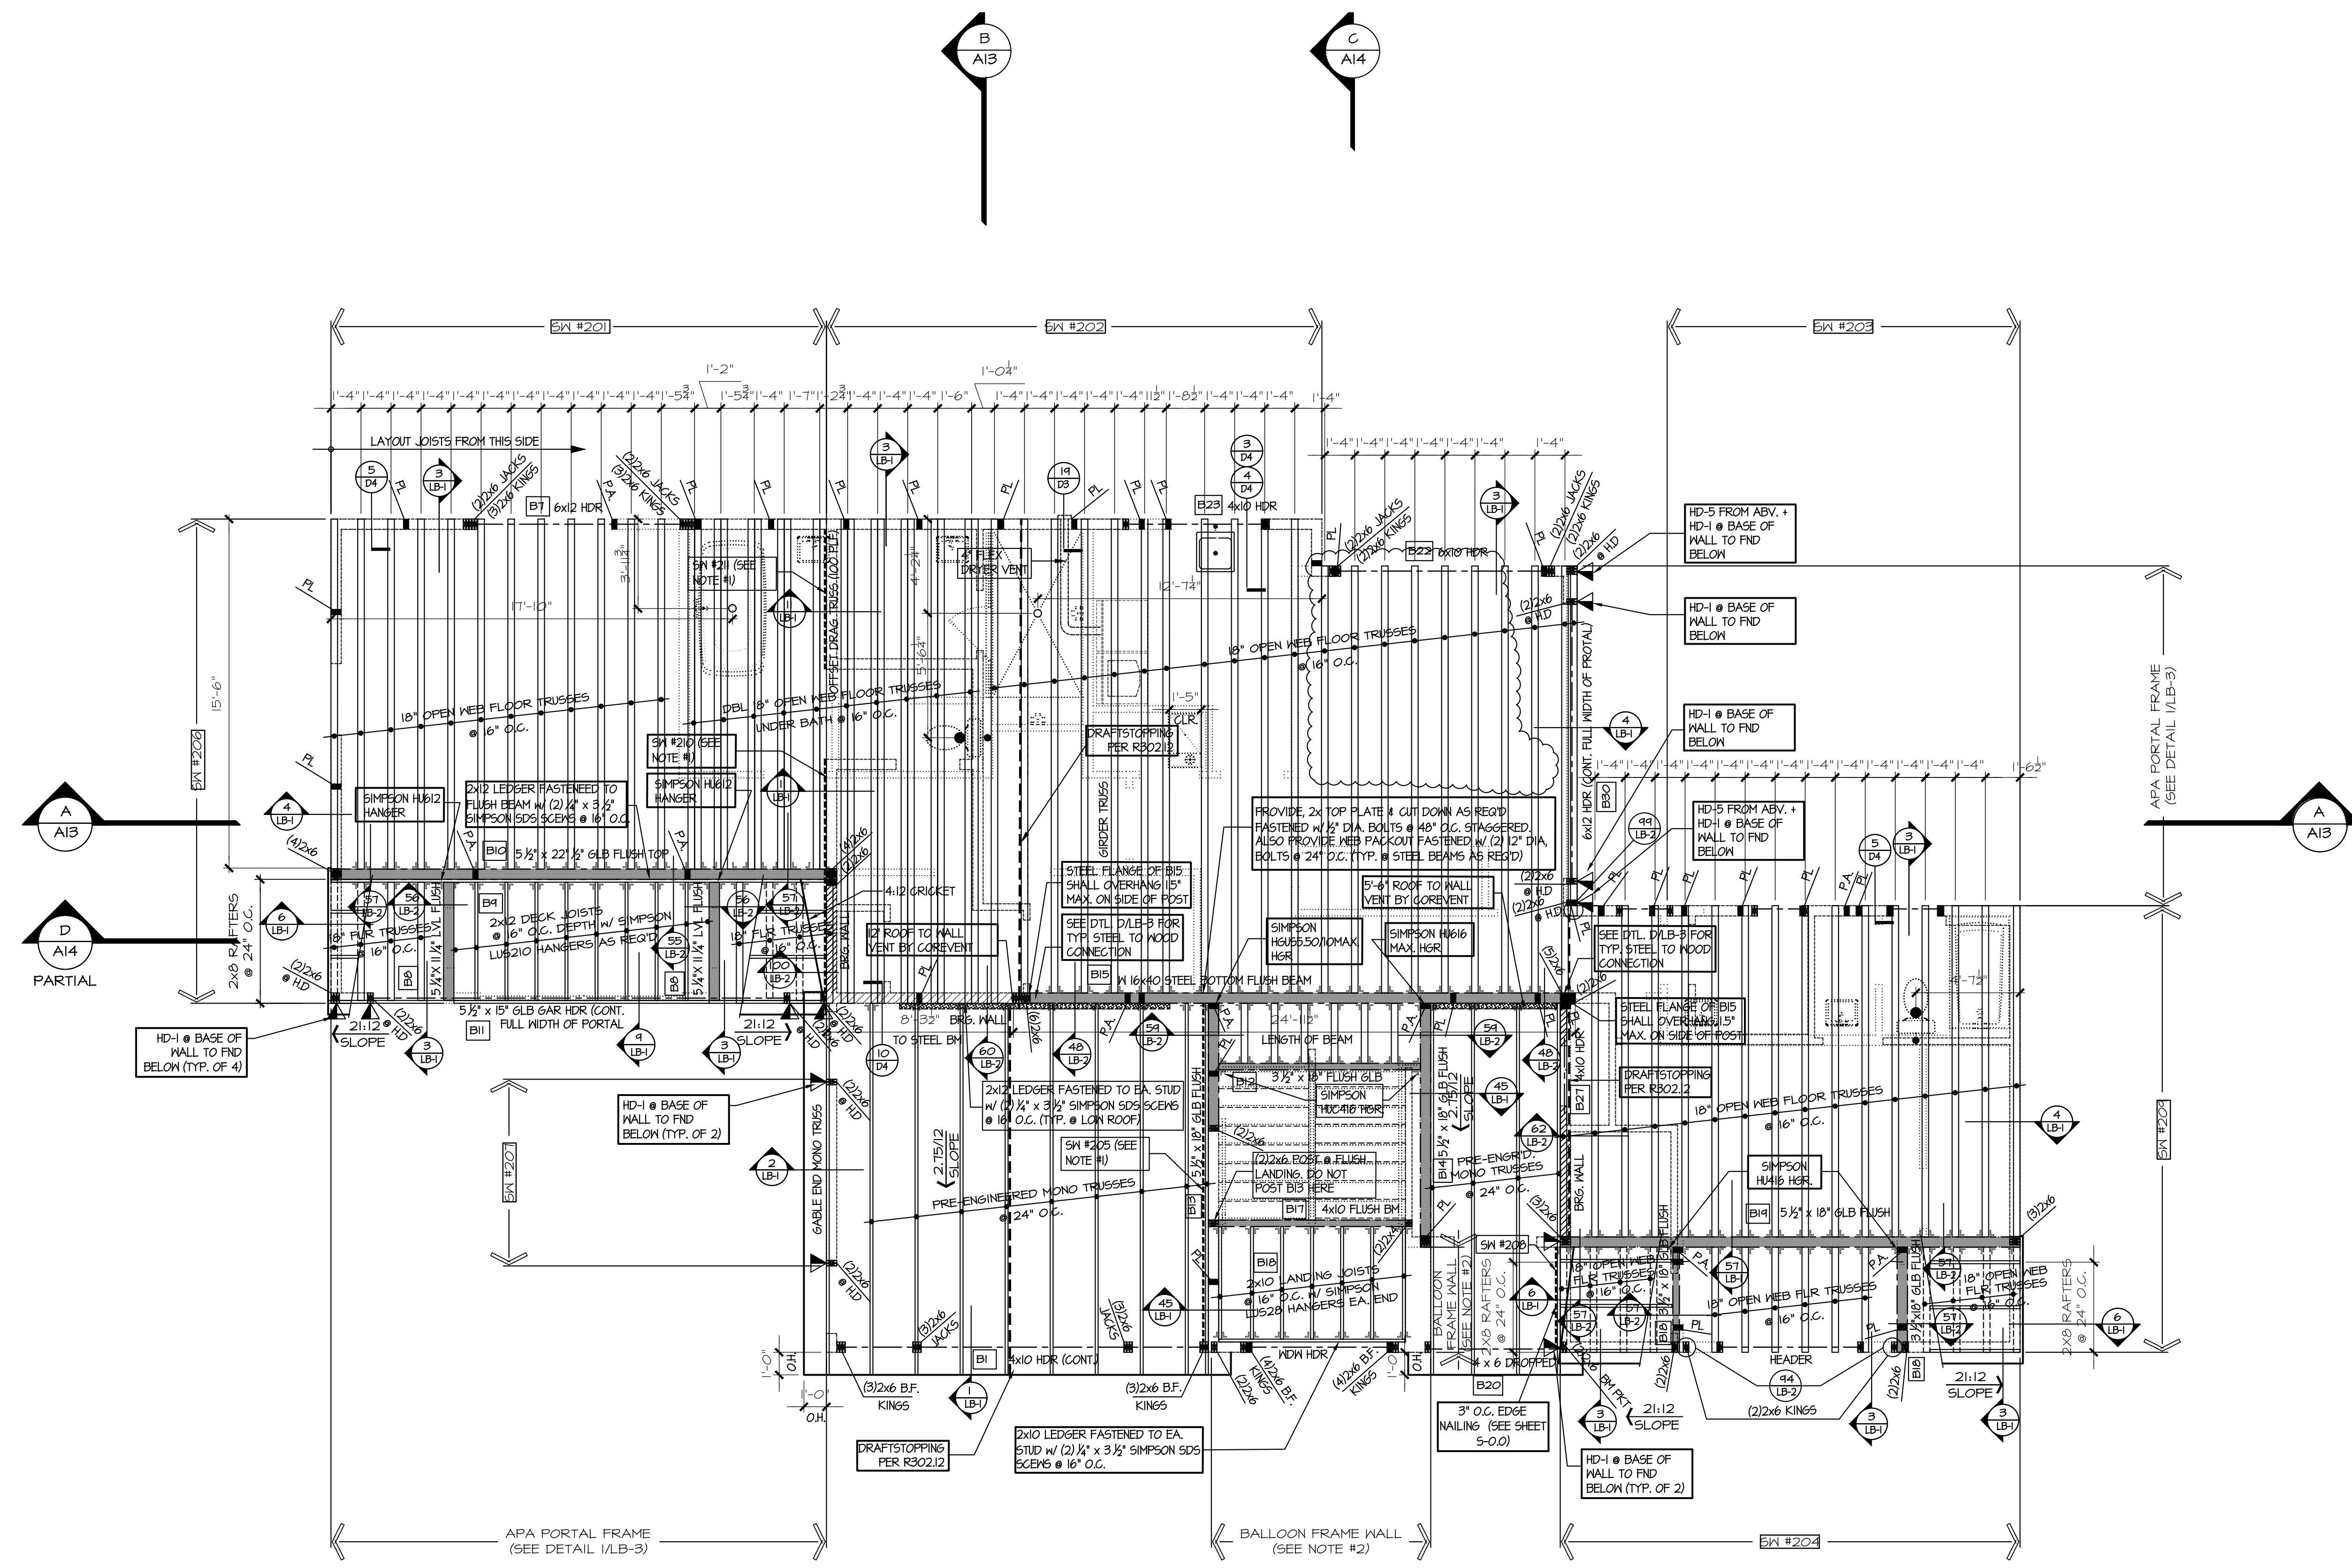

UPPER FLOOR & LOWER ROOF FRAMING PLAN

1/4" = 1'-0"

Sheet Title/Description

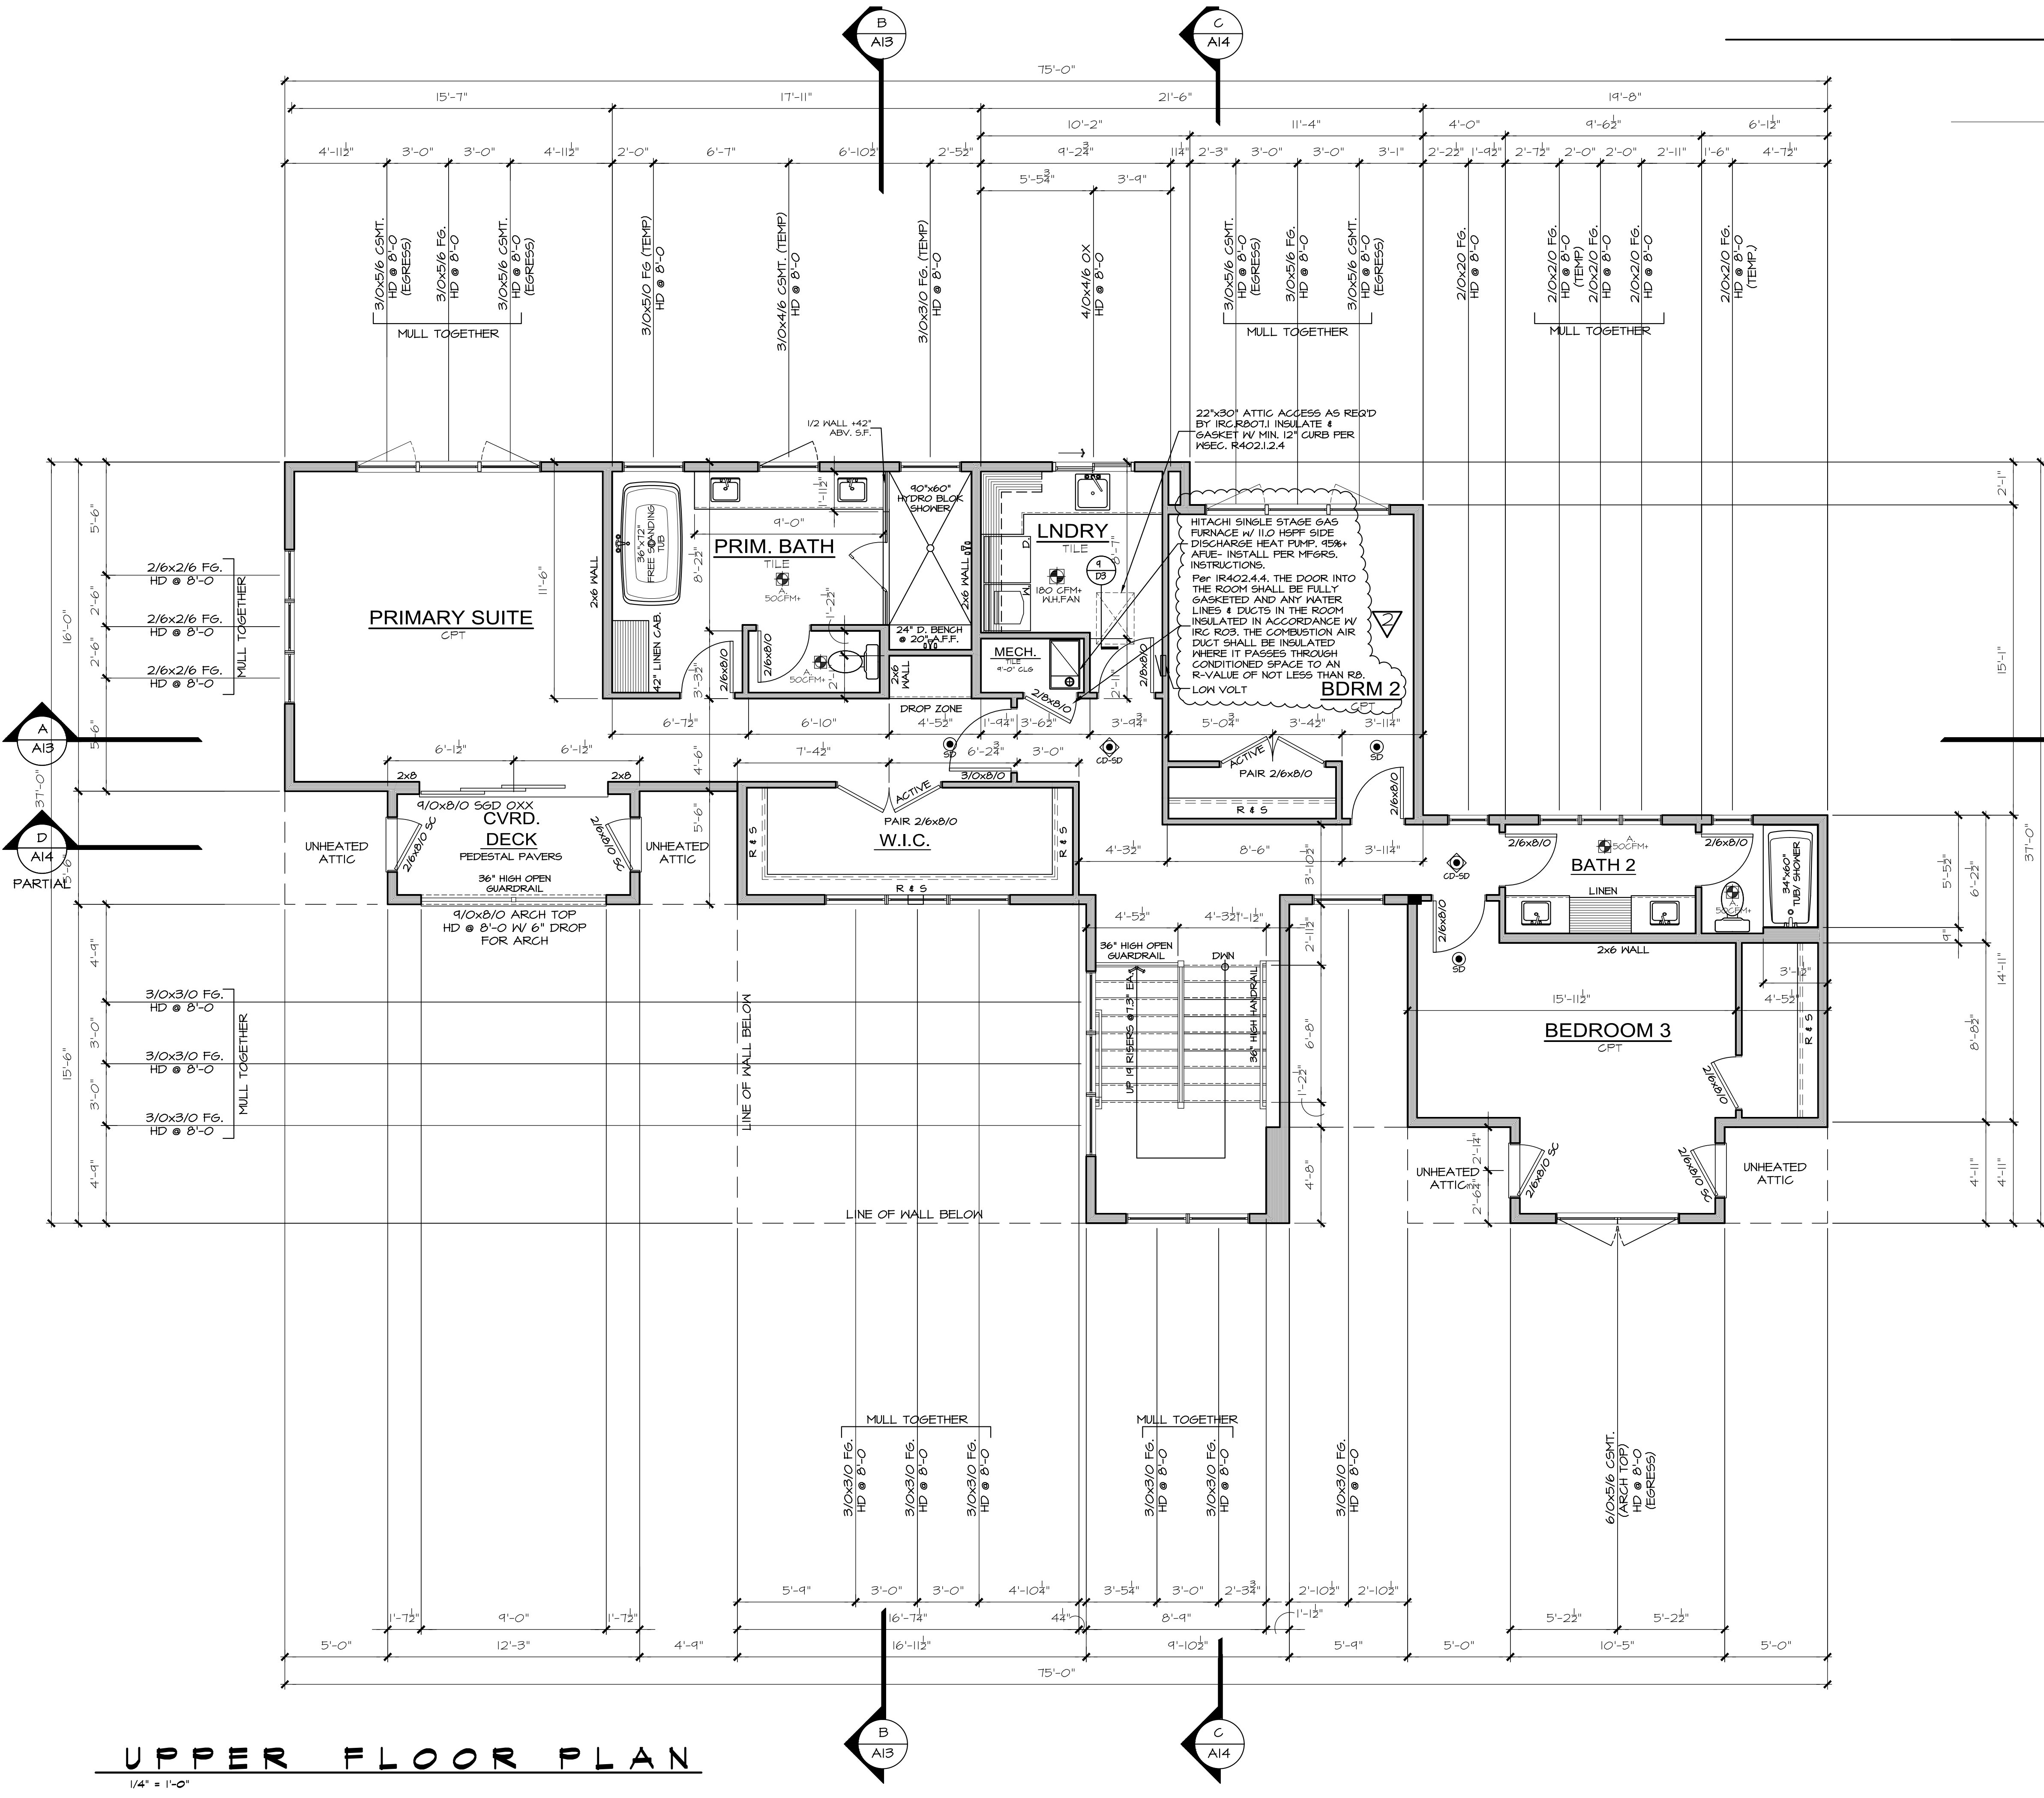

UPPER FLOOR PLAN NOTES:

PLAN SPECIFIC 2018 WSEC. SECTION R406.2
 R406.2 ADDITIONAL ENERGY EFFICIENCY REQUIREMENTS (MANDATORY). THIS RESIDENTIAL DWELLING SHALL COMPLY W/SUFFICIENT OPTIONS FROM TABLE R406.2 TO ACHIEVE THE FOLLOWING MIN. NUMBER OF CREDITS: 6 FOR 0.150W to 0.199W HOME. CREDITS PROVIDED IN THIS HOME AS FOLLOWS:
EFFICIENT BUILDING ENVELOPE OPT. 1.3: 0.5 CREDITS
 PRESCRIPTIVE COMPLIANCE IS BASED ON TABLE R402.1.1 WITH FOLLOWING MODIFICATIONS:
 VERTICAL FENESTRATION U = 0.28 WINDOWS
 FLOORS TO BE R-39 AND SLAB ON GRADE TO BE R-10 PERIMETER AND UNDER ENTIRE SLAB BELOW GRADE.
AIR LEAKAGE & EFFICIENT VENTILATION OPT. 2.1: 0.5 CREDITS
 REDUCE THE TESTED AIR LEAKAGE TO 3.0 AIR CHANGES PER HOUR MAXIMUM @ 50 PASCALS AND ALL WHOLE HOUSE VENTILATION REQUIREMENTS AS DETERMINED BY SECTION M507.3 OF THE IRC, OR SECTION 404.9 OF THE IMC SHALL BE MET WITH A HIGH EFFICIENCY FAN(S) (MAXIMUM OF 0.35 WATTS/CFM), NOT INTERLOCKED WITH THE FURNACE FAN (IF PRESENT). VENTILATION SYSTEMS USING A FURNACE INCLUDING AN EMC MOTOR ARE ALLOWED PROVIDED THAT THEY ARE CONTROLLED TO OPERATE AT LOW SPEED IN THE VENTILATION ONLY MODE.
HIGH EFFICIENCY HVAC EQUIPMENT OPT. 3.5a: 1.5 CREDITS
 HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) INSTALLATION SHALL COMPLY WITH THE REQUIREMENTS OF SECTION R403.3.1. LOCATING SYSTEM COMPONENTS IN CONDITIONED CRAWL SPACE IS NOT PERMITTED UNDER THIS OPTION. ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION. DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.
HIGH EFFICIENCY HVAC DISTRIBUTION OPT. 4.2: 1.0 CREDITS
 HVAC EQUIPMENT AND ASSOCIATED DUCT SYSTEM(S) SHALL COMPLY WITH THE REQUIREMENTS OF SECT R403.3.1. LOCATING SYSTEM COMPONENTS IN CONDITIONED CRAWL SPACES IS NOT PERMITTED UNDER THIS OPTION. ELECTRIC RESISTANCE HEAT AND DUCTLESS HEAT PUMPS ARE NOT PERMITTED UNDER THIS OPTION. DIRECT COMBUSTION HEATING EQUIPMENT WITH AFUE LESS THAN 80% IS NOT PERMITTED UNDER THIS OPTION.
EFFICIENT WATER HEATING 5.4: 1.5 CREDITS
 WATER HEATING SYSTEM SHALL INCLUDE ONE OF THE FOLLOWING: ELECTRIC HEAT PUMP WATER HEATER MEETING THE STANDARDS FOR Tier 1 of NEEA'S ADVANCED WATER HEATING SPECIFICATION. IF ONE WATER IS SERVING MORE THAN ONE DWELLING UNIT, ALL HOT WATER SUPPLY AND REGULATION PIPING SHALL BE INSULATED WITH R-8 MINIMUM PIPE INSULATION.

WHOLE HOUSE VENTILATION
 PROVIDE WHOLE HOUSE VENTILATION per 2018 IRC, M507 and IMC R403.8 USING LAUNDRY ROOM EXHAUST FAN INTEGRATED INTO FORCED AIR SYSTEM (FAU) PROVIDE OUTDOOR FRESH AIR W/DUCTS CONNECTED TO THE RETURN SIDE OF THE AIR HANDLER.

| SYMBOL | LOCATION | MIN. FAN REQUIREMENTS (ALL FANS VENT TO OUTSIDE) |
|--------|---------------|--|
| | BATH # FINDER | Min. 50cfm. INTERMITTENT at .025mg per TABLE M507.4 |
| | KITCHEN | Min. 100cfm. INTERMITTENT at .025mg per TBL. M507.4 |
| | LAUNDRY ROOM | MIN. 360cfm. INTERMITTENT at .025mg TO FUNCTION AS WHOLE HOUSE FAN (HWF) |

RANGE HOOD 2" DOWN DRAFT EXHAUST FAN RATED at min. 100cfm. at 0.10w/m MAY BE USED FOR EXHAUST FAN REQUIR. EXHAUST HOODS IN EXCESS OF 400cfm SHALL BE INTERLOCKED AND PROVIDE MAKE UP AIR per W503.4
 MECHANICAL CONTRACTOR TO SIZE HWF, FAN and SET OPERATING TIMER per TABLE M507.3(2) FOR A 3001-4500sf. DWELLING w/4-5 BEDROOMS TO OPERATE INTERMITTENTLY and CONTINUOUSLY per TABLE M507.3(2)
 PROVIDE CONTROLS FOR HWF per M507.3.2 AFFIX LABEL TO CONTROLS THAT READS "WHOLE HOUSE VENTILATION - SEE OPERATING INSTRUCTIONS"

UPPER FLOOR PLAN

1/4" = 1'-0"

7525 SE 24th St., 487
 Mercer Island, WA
 98040
 425.266.9100

Issue Issue Date By Description

| | | | |
|--|--|--|--|
| | | | |
| | | | |
| | | | |

8434 SE 39th ST.
 Mercer Island, WA.
 Job Number: JWC025

plan name: -
 marketing name: -
 plan number: -
 mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC), or those of the local municipality then the current standards and requirements of each respectively shall govern.
 The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.
 © 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
 Submittal Date

Sheet Title/Description
 JAYMARC HOMES
 Design Firm

R.K.N.
 Drawn by:

Checked by:

Primary Scale

A8
 of .

| | |
|---------------------------------------|-------------|
| TOTAL FINISH FLOOR | 2,076 S.F. |
| UPPER FLOOR AREA | 1,621 S.F. |
| TOTAL NET AREA | 3,754 S.F. |
| STAIR DEDUCTIONS | -208 S.F. |
| TOTAL FAR PROPOSED | 3,521 S.F. |
| MAXIMUM FAR, LOT AREA | 17,100 S.F. |
| MAXIMUM FAR 40% + ADU = 6,840 + 344 = | 7,234 S.F. |
| COVD' PORCH | 27 |

Updated: 12.03.20
 Method for Calculating Square Footage - ANSI Z165-2013 except, no separate...

Sheet Title/Description



7525 SE 24th St., 487
Mercer Island, WA
98040
425.266.9100

| Issue | Issue Date | By | Description |
|-------|------------|----|-------------|
| △ | | | |
| △ | | | |
| △ | | | |
| △ | | | |

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JMC025

plan name: -
marketing name: -
plan number: -
mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submittal Date








Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

.....
Checked by:

Primary Scale

A9
of .

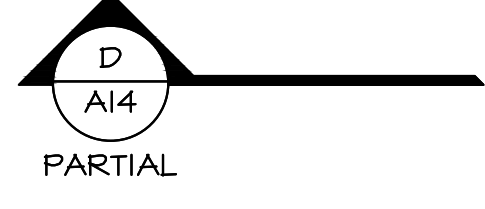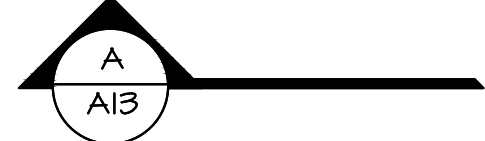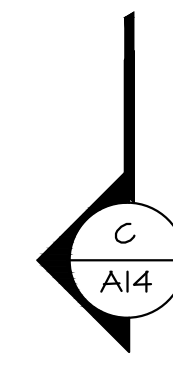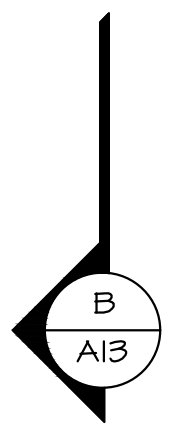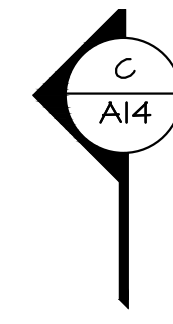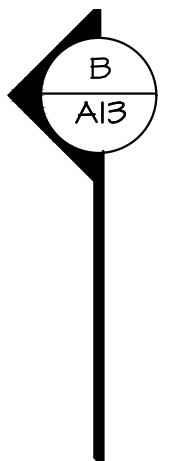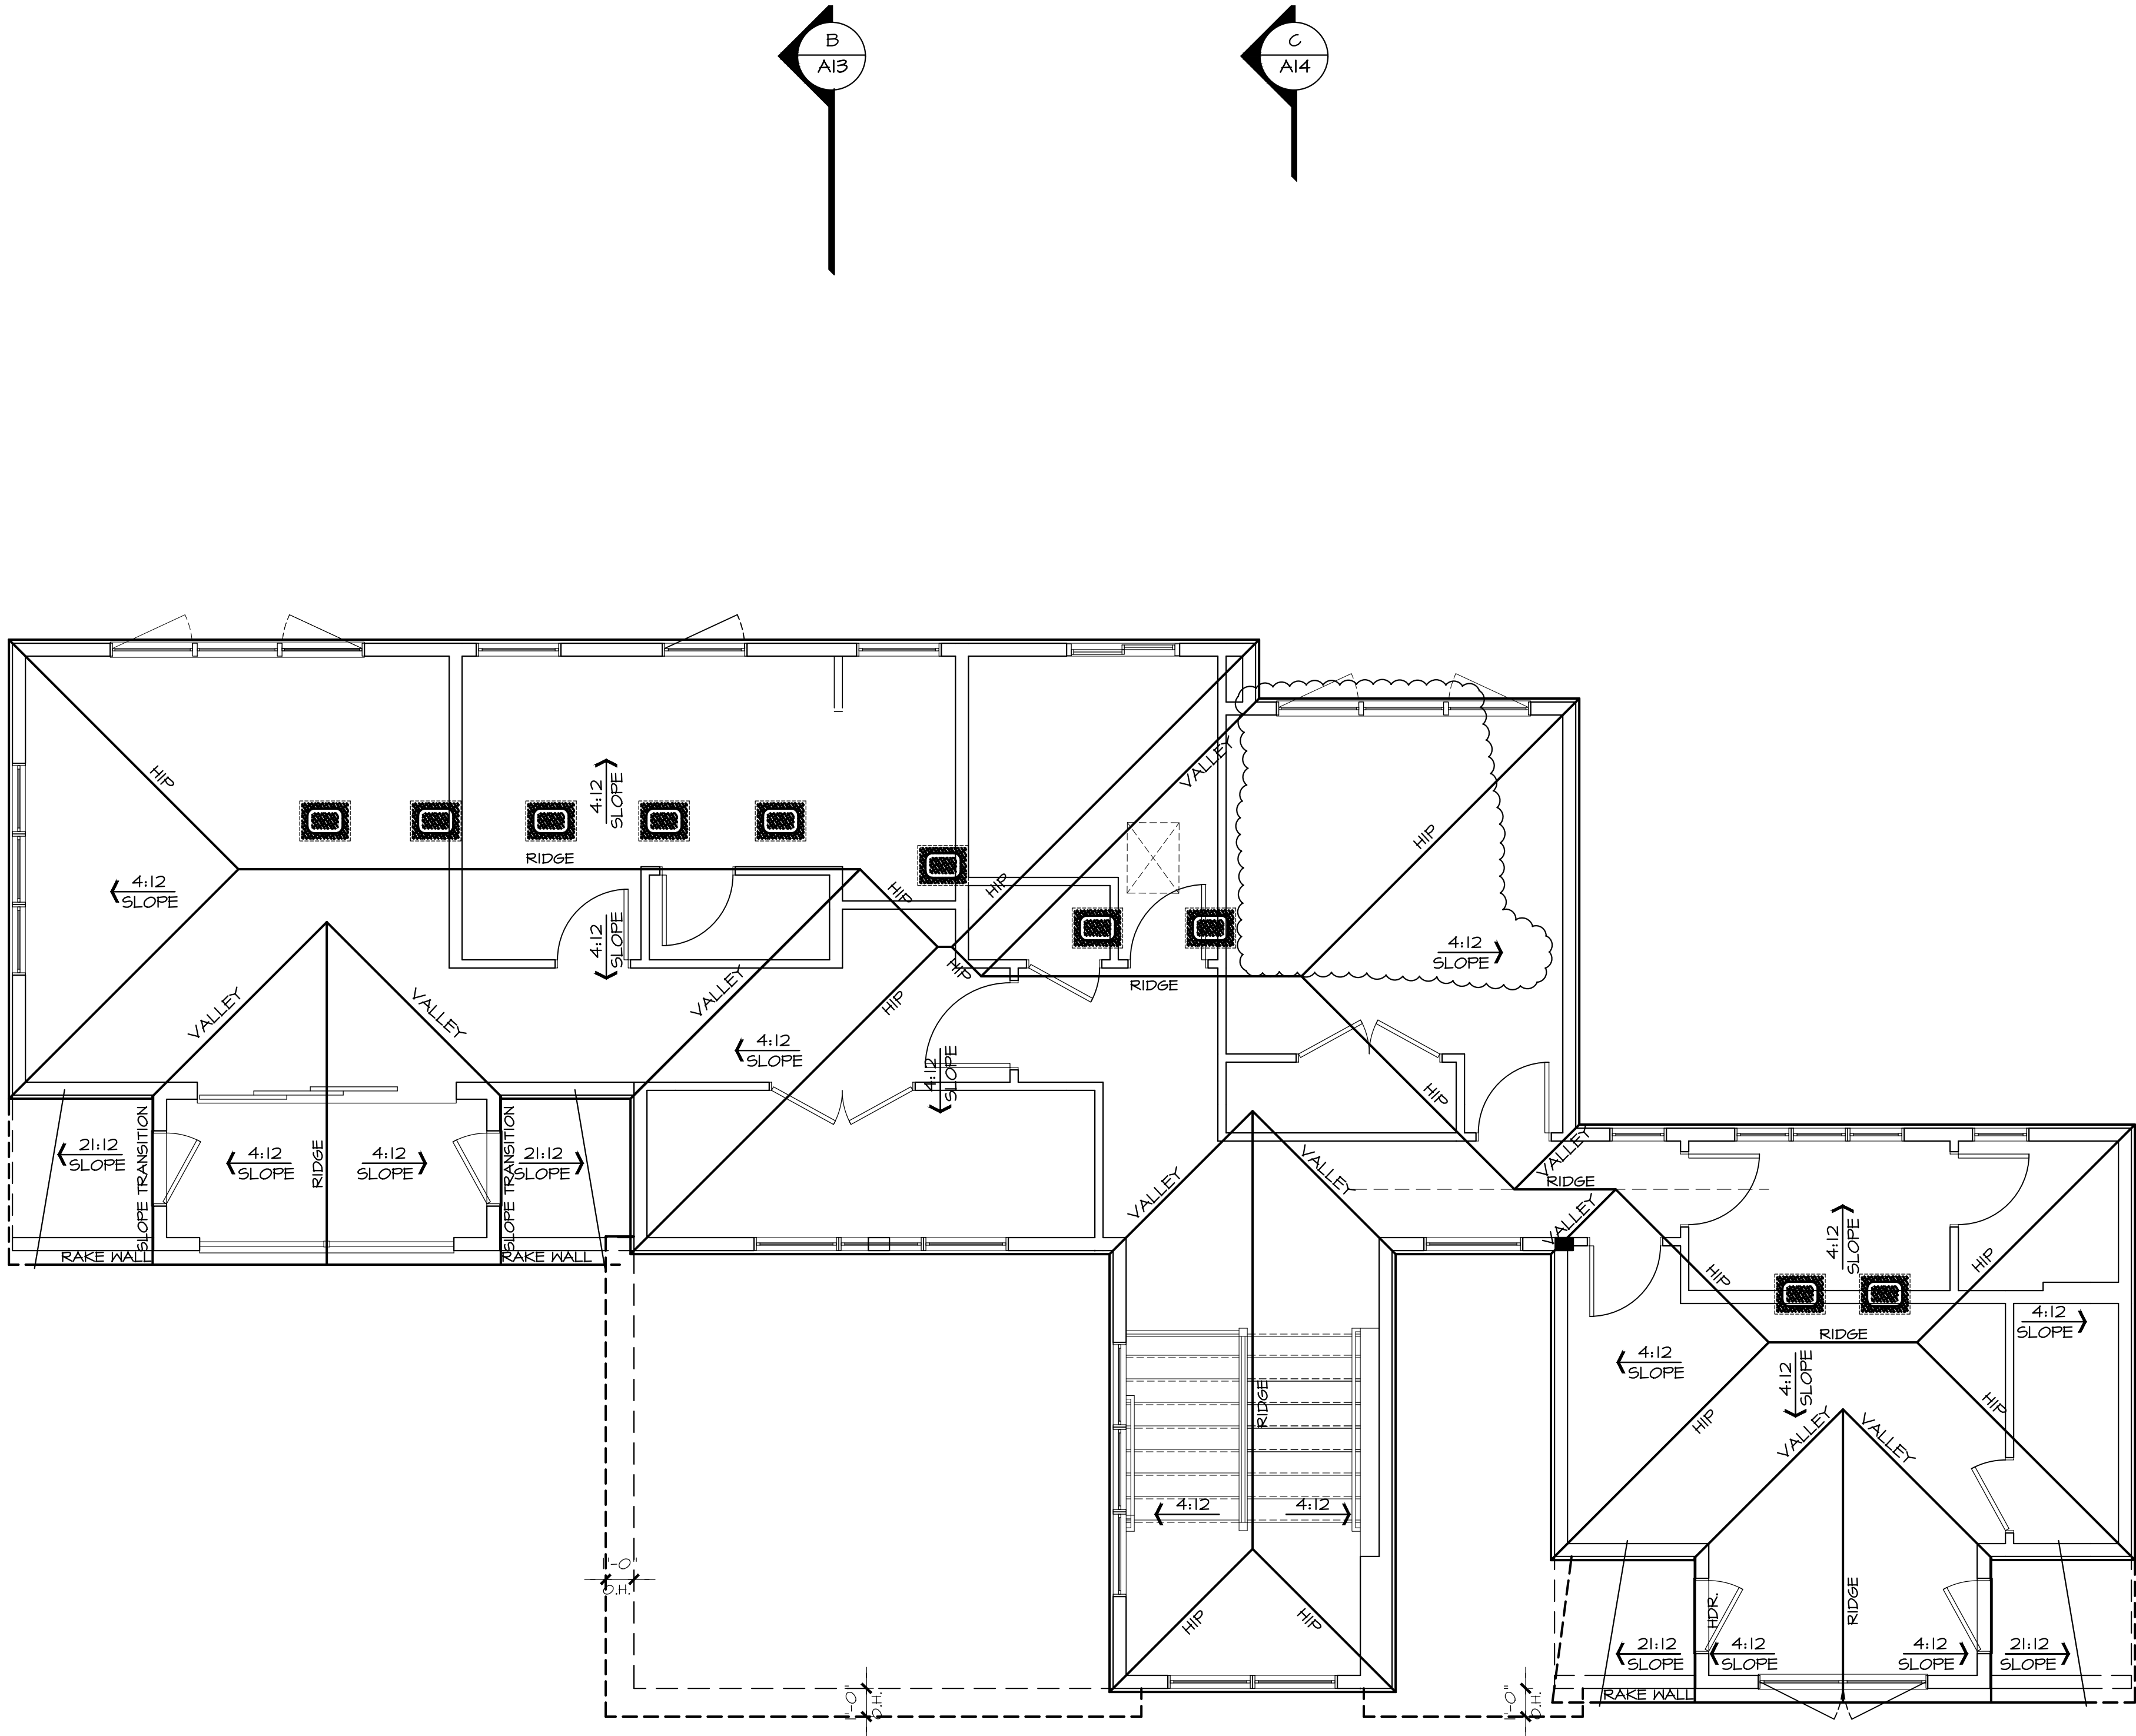

ROOF PLAN

1/4" = 1'-0"

Sheet Title/Description

LEGEND

- ▨ INTERIOR BEARING WALL
- ▬ BEAM / HEADER
- ▬ ROOF TRUSS @ 24" O.C. (U.N.O.)
- ▬ GIRDER TRUSS
- ▬ INTERIOR SHEAR WALL PANEL OR EXTERIOR SHEAR WALL w/ 3" o.c. EDGE NAILING
- J.L. METAL HANGER
- ▨ INDICATES OVER FRAMED TRUSS AREA

REFER TO S-O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

4x10 HDR @ ALL EXT. (B1) WINDOWS/DOORS (TYP. U.N.O.)

PROVIDE CONT. EXT. SHEATHING BEHIND LOW TRUSSES DOWN TO SECOND FLOOR SOLE PLATE (TYP. @ LOW ROOF)

NOTE #1:
PROVIDE 3/8" OSB/PLYWOOD SHTG. + FASTEN PER TYP. WALL SHTG. SPECS. (SEE NOTES)

NOTE #2:
ALL WALLS 12' OR TALLER SHALL BE HF #2 GRADE OR BETTER @ 16" O.C.

| Upper Roof Ventilation: as needed to achieve 50% of ventilation | |
|---|---|
| Standard Truss / Scissor Truss Roof Framing Assembly: ZONE 1 | |
| Ridge Ventilation: 50% of ventilation | 50.16 |
| Continuous Ridge Vent = | 18.00 s.i. per l.f. |
| Upper Ventilation MIN. Req'd = | 412.08 s.i. x 0.4 / s.i. per linear foot = 19.1 f. |
| Upper Ventilation MAX. Req'd = | 412.08 s.i. x 0.5 / s.i. per linear foot = 22.1 f. |
| Provide: | 0 f. ridge vent. Ventilation = 0.00 s.i. |
| Ventilation area remainder for AF50 vents = | 50.16 s.i. |
| Upper Roof Ventilation: as needed to achieve 50% of ventilation | |
| AF50 Roof Jack (10' x 7') = | 50.00 s.i. each |
| Upper Ventilation Req'd TO GET 50% = 50.16 s.i. / s.i. of each vent = | 2 vents |
| Provide: | 10 - 10'x7' roof jacks. Ventilation = 500.00 s.i. |
| Eave Ventilation: | |
| Birdblocking (3/2" dia holes per bay = | 4.71 s.i. / l.f. - 25% reduction = 3.53 s.i. / l.f. |
| Eave Ventilation Req'd = | 412.08 s.i. / s.i. per l.f. = 191.70 f. |
| Provide Minimum: | 412.08 s.i. |
| Minimum Ventilation Provided = | 998.08 s.i. IS GREATER THAN 824.16 s.i. Req'd |

| Upper Roof Ventilation: as needed to achieve 50% of ventilation | |
|---|---|
| Standard Truss / Scissor Truss Roof Framing Assembly: GREAT ROOM | |
| Ridge Ventilation: 50% of ventilation | 50.16 |
| Continuous Ridge Vent = | 18.00 s.i. per l.f. |
| Upper Ventilation MIN. Req'd = | 71.28 s.i. x 0.4 / s.i. per linear foot = 4.1 f. |
| Upper Ventilation MAX. Req'd = | 71.28 s.i. x 0.5 / s.i. per linear foot = 3.1 f. |
| Provide: | 0 f. ridge vent. Ventilation = 0.00 s.i. |
| Ventilation area remainder for AF50 vents = | 50.16 s.i. |
| Upper Roof Ventilation: as needed to achieve 50% of ventilation | |
| Corevent Invert Product Supplies 8.75 sq. in. if not free per linear foot | |
| Upper Ventilation Req'd TO GET 50% = 71.28 s.i. | |
| Provide: 12 linear feet of Corevent product at roof to wall = | 81.00 s.i. |
| Eave Ventilation: | |
| Birdblocking (3/2" dia holes per bay = | 4.71 s.i. / l.f. - 25% reduction = 3.53 s.i. / l.f. |
| Eave Ventilation Req'd = | 71.28 s.i. / s.i. per l.f. = 73.09 f. |
| Provide Minimum: | 24.1 f. birdblocking. Ventilation = 84.78 s.i. |
| Minimum Ventilation Provided = | 165.78 s.i. IS GREATER THAN 142.56 s.i. Req'd |

| Lower Roof Ventilation: as needed to achieve 50% of ventilation | |
|---|---|
| Standard Truss / Scissor Truss Roof Framing Assembly: ENTRY | |
| Ridge Ventilation: 50% of ventilation | 50.16 |
| Continuous Ridge Vent = | 18.00 s.i. per l.f. |
| Upper Ventilation MIN. Req'd = | 22.8 s.i. x 0.4 / s.i. per linear foot = 2.1 f. |
| Upper Ventilation MAX. Req'd = | 22.8 s.i. x 0.5 / s.i. per linear foot = 1.1 f. |
| Provide: | 0 f. ridge vent. Ventilation = 0.00 s.i. |
| Ventilation area remainder for AF50 vents = | 50.16 s.i. |
| Upper Roof Ventilation: as needed to achieve 50% of ventilation | |
| Corevent Invert Product Supplies 8.75 sq. in. if not free per linear foot | |
| Upper Ventilation Req'd TO GET 50% = 22.8 s.i. | |
| Provide: 4 linear feet of Corevent product at roof to wall = | 27.00 s.i. |
| Eave Ventilation: | |
| Birdblocking (3/2" dia holes per bay = | 4.71 s.i. / l.f. - 25% reduction = 3.53 s.i. / l.f. |
| Eave Ventilation Req'd = | 22.80 s.i. / s.i. per l.f. = 57.80 f. |
| Provide Minimum: | 6.1 f. birdblocking. Ventilation = 21.20 s.i. |
| Minimum Ventilation Provided = | 48.28 s.i. IS GREATER THAN 45.6 s.i. Req'd |

| Issue | Issue Date | By | Description |
|-------|------------|----|-------------|
| | | | |
| | | | |

plan name: -
marketing name: -
plan number: -
mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC), or those of the local municipality and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submittal Date


Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

Checked by:

Primary Scale

A10
of .

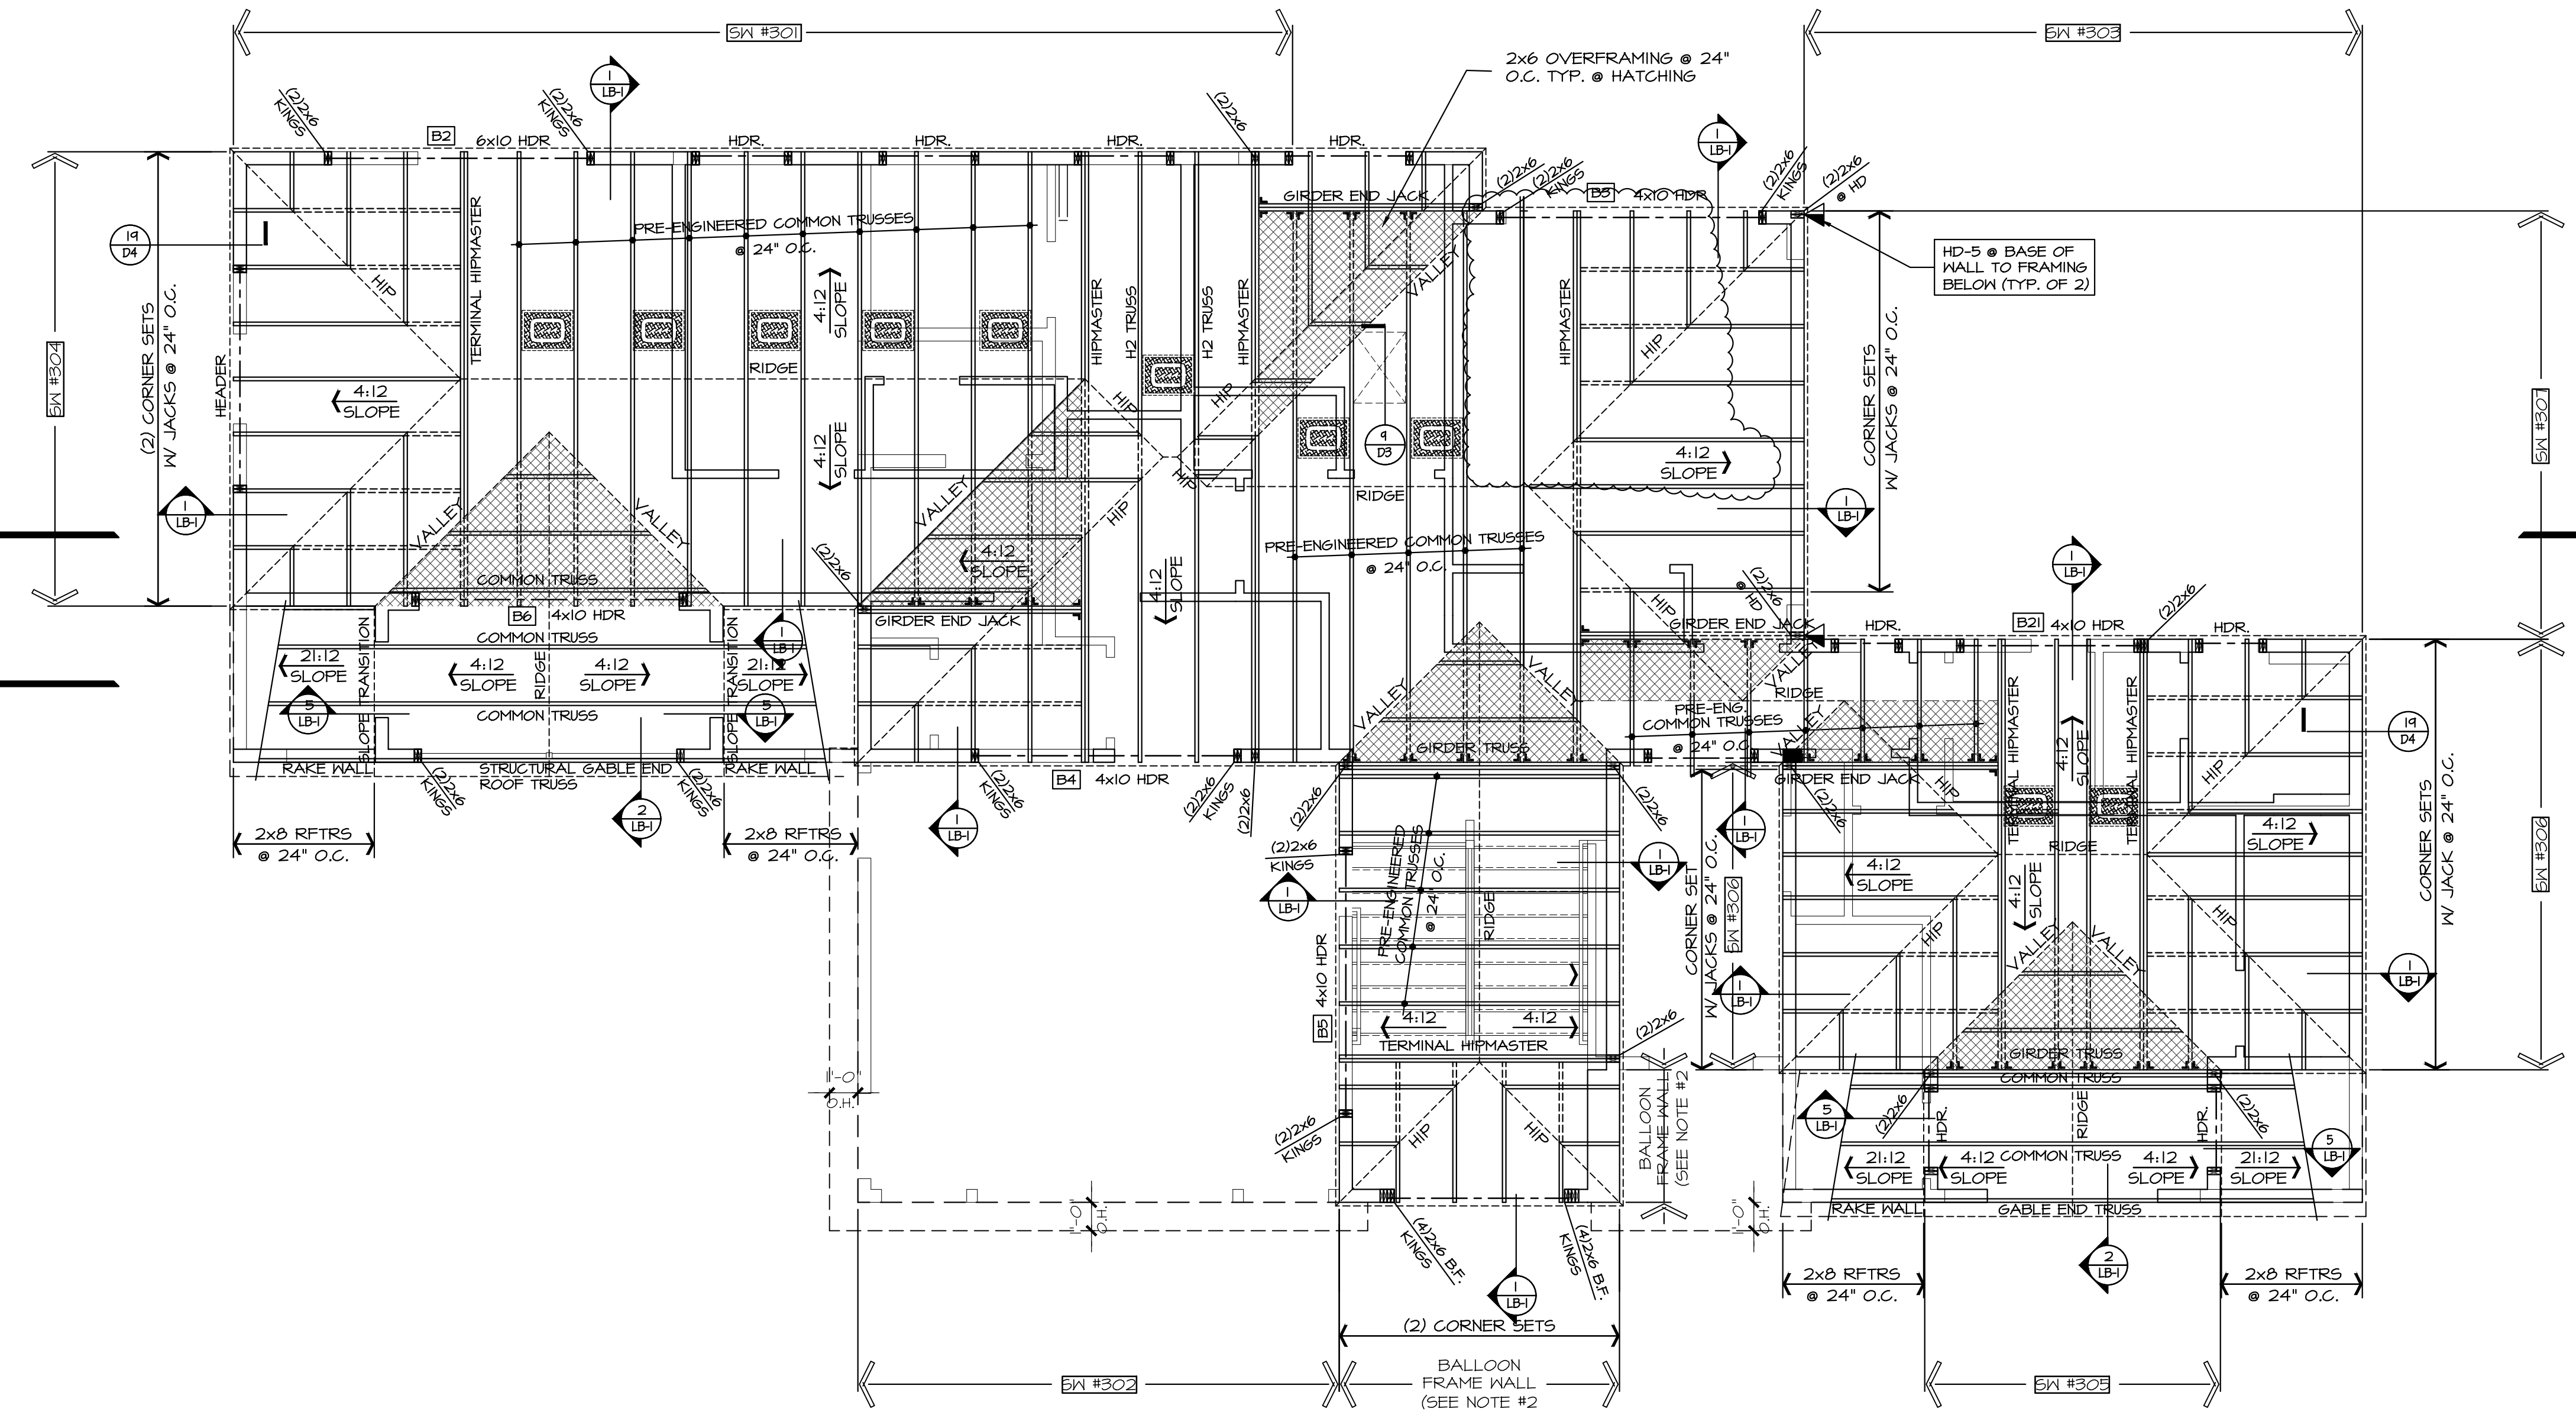

ROOF FRAMING PLAN

1/4" = 1'-0"

Sheet Title/Description
Sheet Title/Description

Issue Issue Date By
Description

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JMC025

plan name: -
marketing name: -
plan number: -
mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC. All rights reserved.

12.13.23
Submittal Date


Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

Checked by:

Primary Scale

A11
of .

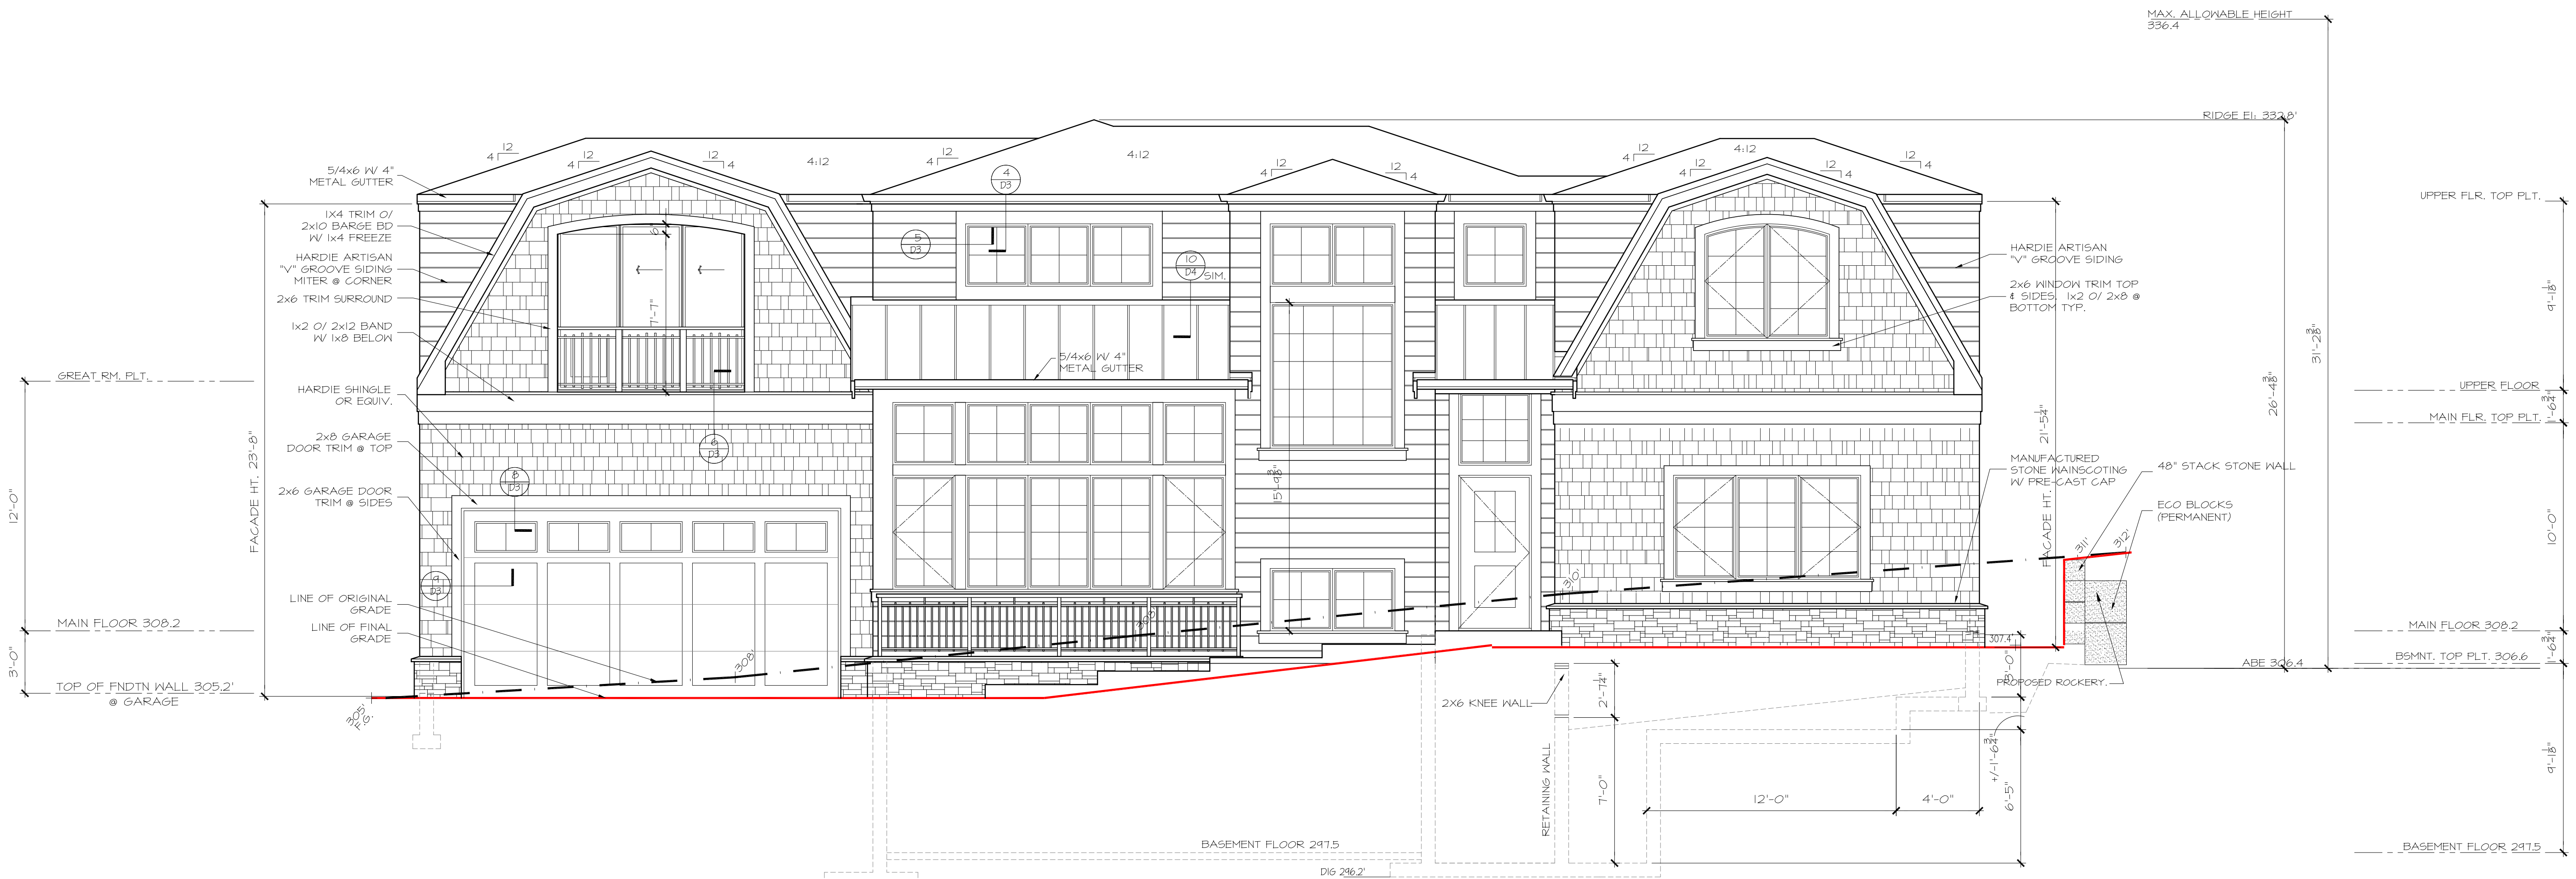

FRONT ELEVATION

1/4" = 1'-0"



LEFT ELEVATION

1/4" = 1'-0"

Sheet Title/Description



7525 SE 24th St., 487
Mercer Island, WA
98040
425.266.9100

| Issue | Issue Date | By | Description |
|-------|------------|----|-------------|
| △ | | | |

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JIMC025

plan name: . . .
marketing name: . . .
plan number: . . .
mark sys. number: . . .

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submittal Date


Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:


Checked by:

Primary Scale

A12
of .

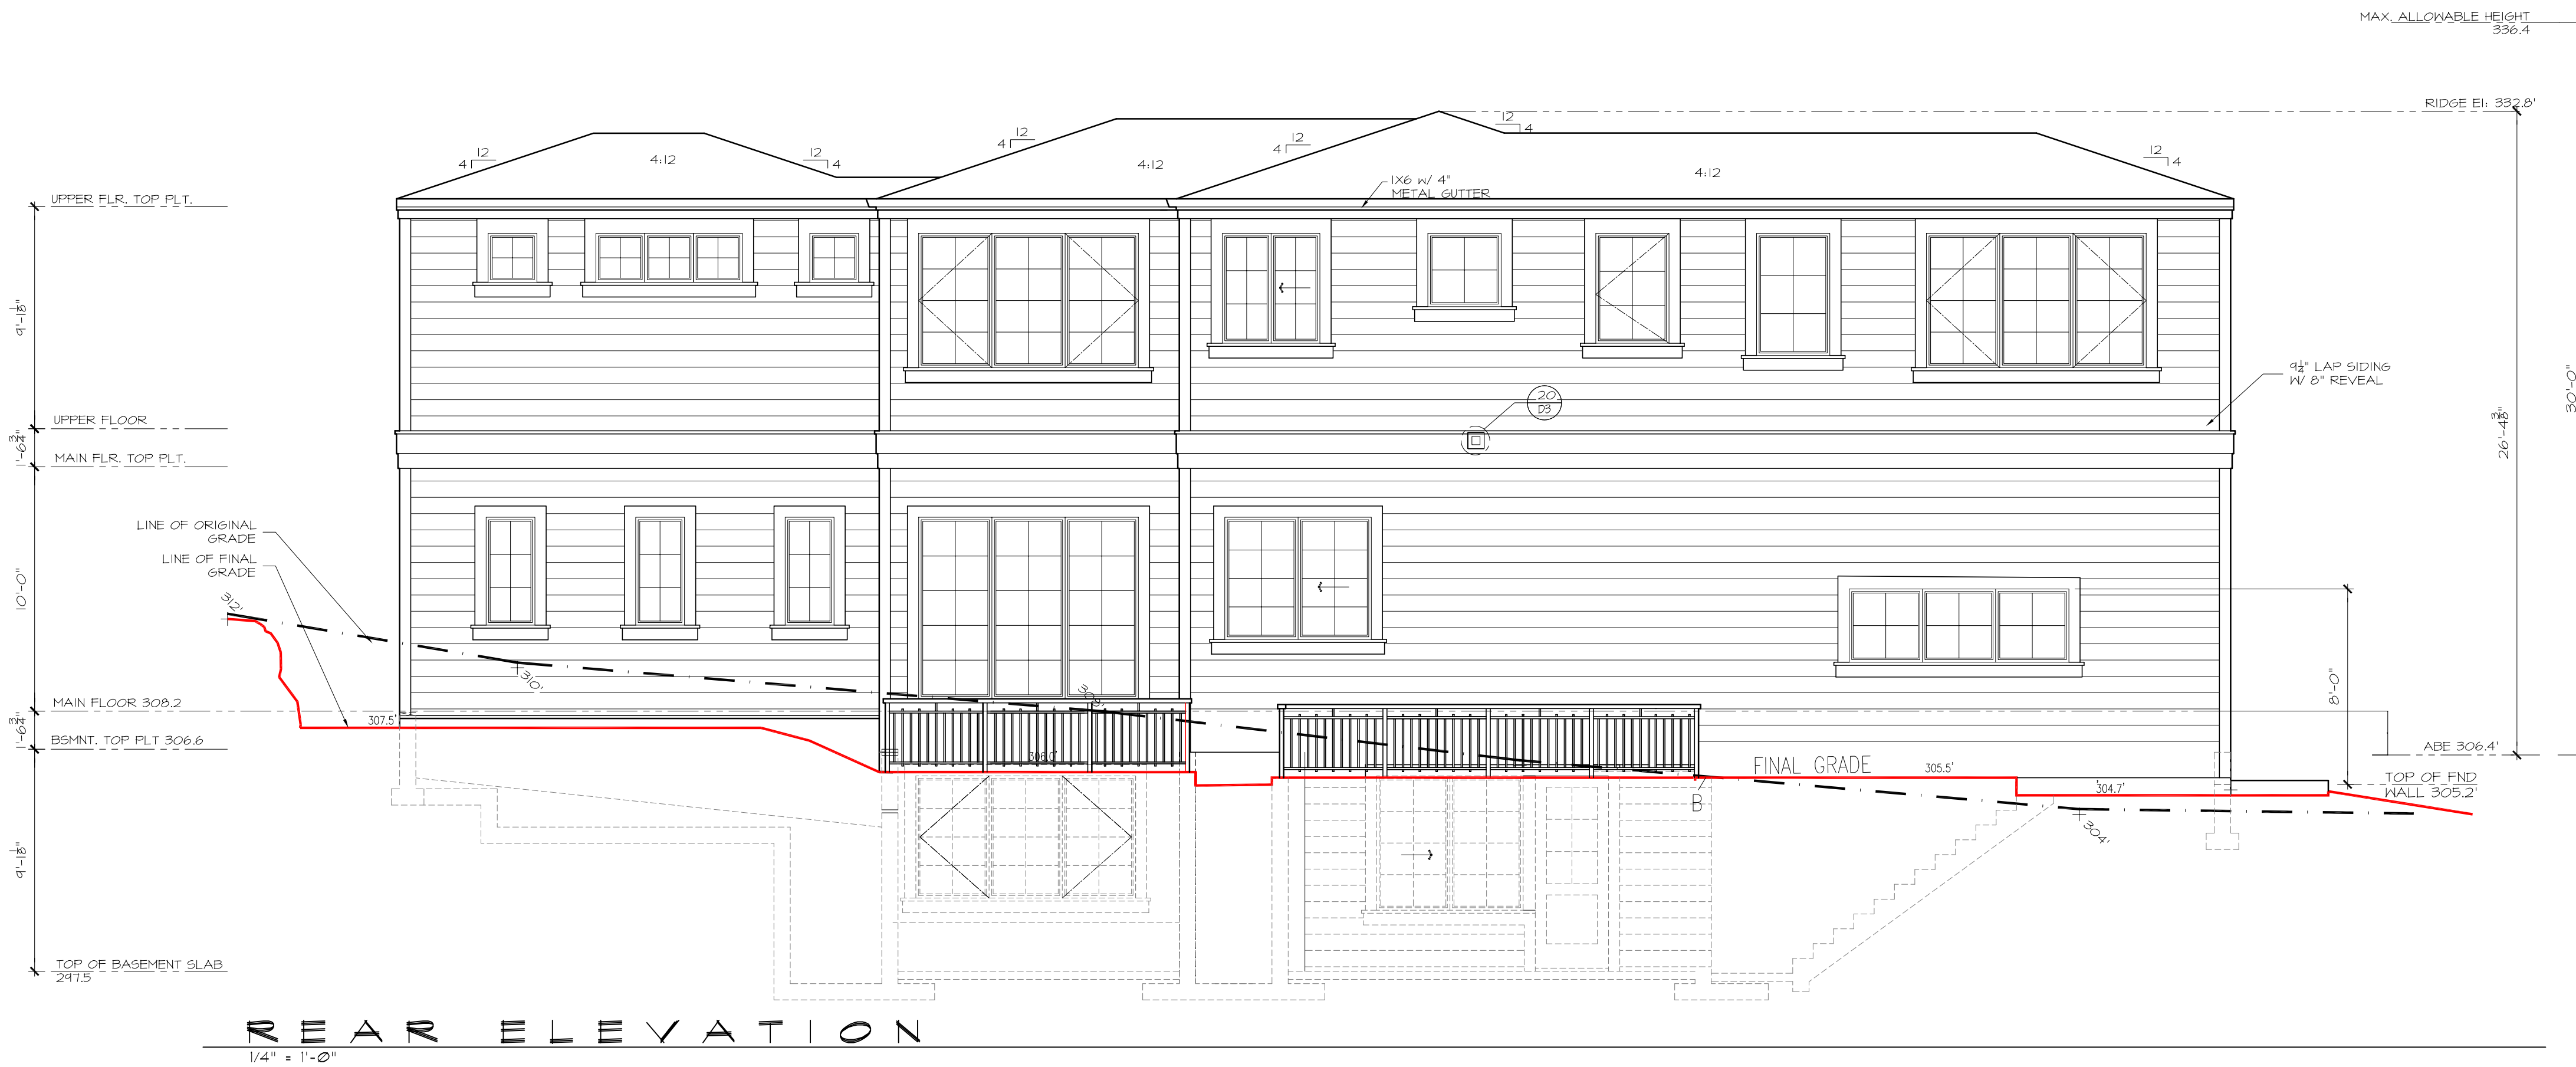

NEAR ELEVATION
1/4" = 1'-0"

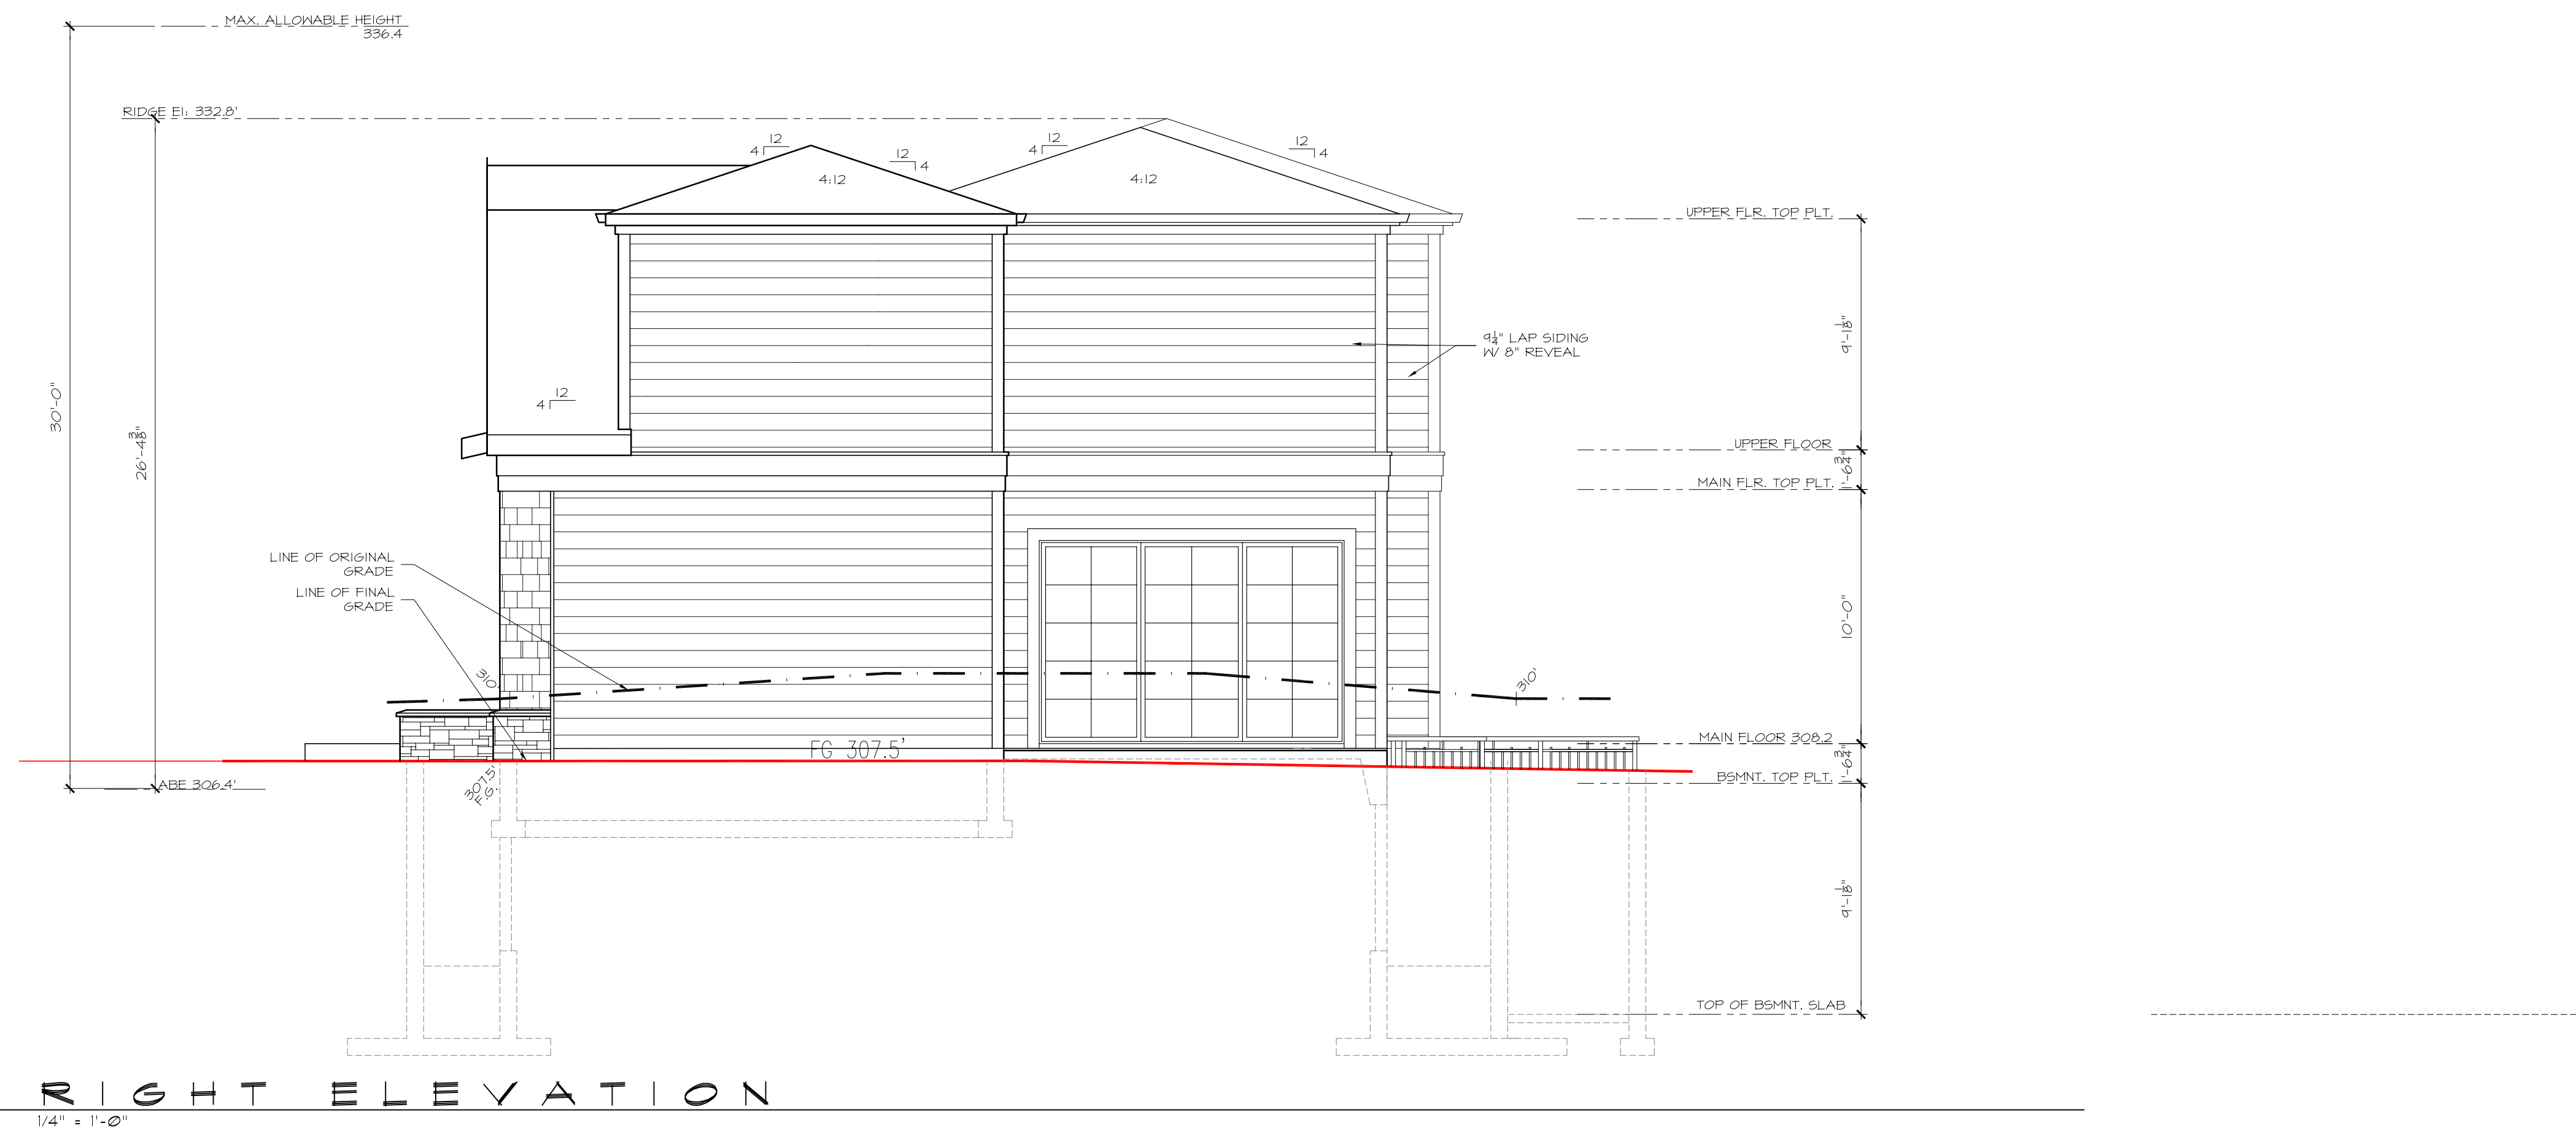


RIGHT ELEVATION
1/4" = 1'-0"

Sheet Title/Description


NOTES:

PER R302.11 FIRE BLOCKING SHALL BE PROVIDED TO CUT OFF ALL CONGEALED DRAFT OPENINGS (BOTH VERTICAL & HORIZONTAL) AND A FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, & BETWEEN A TOP STORY & THE ROOF SPACE.

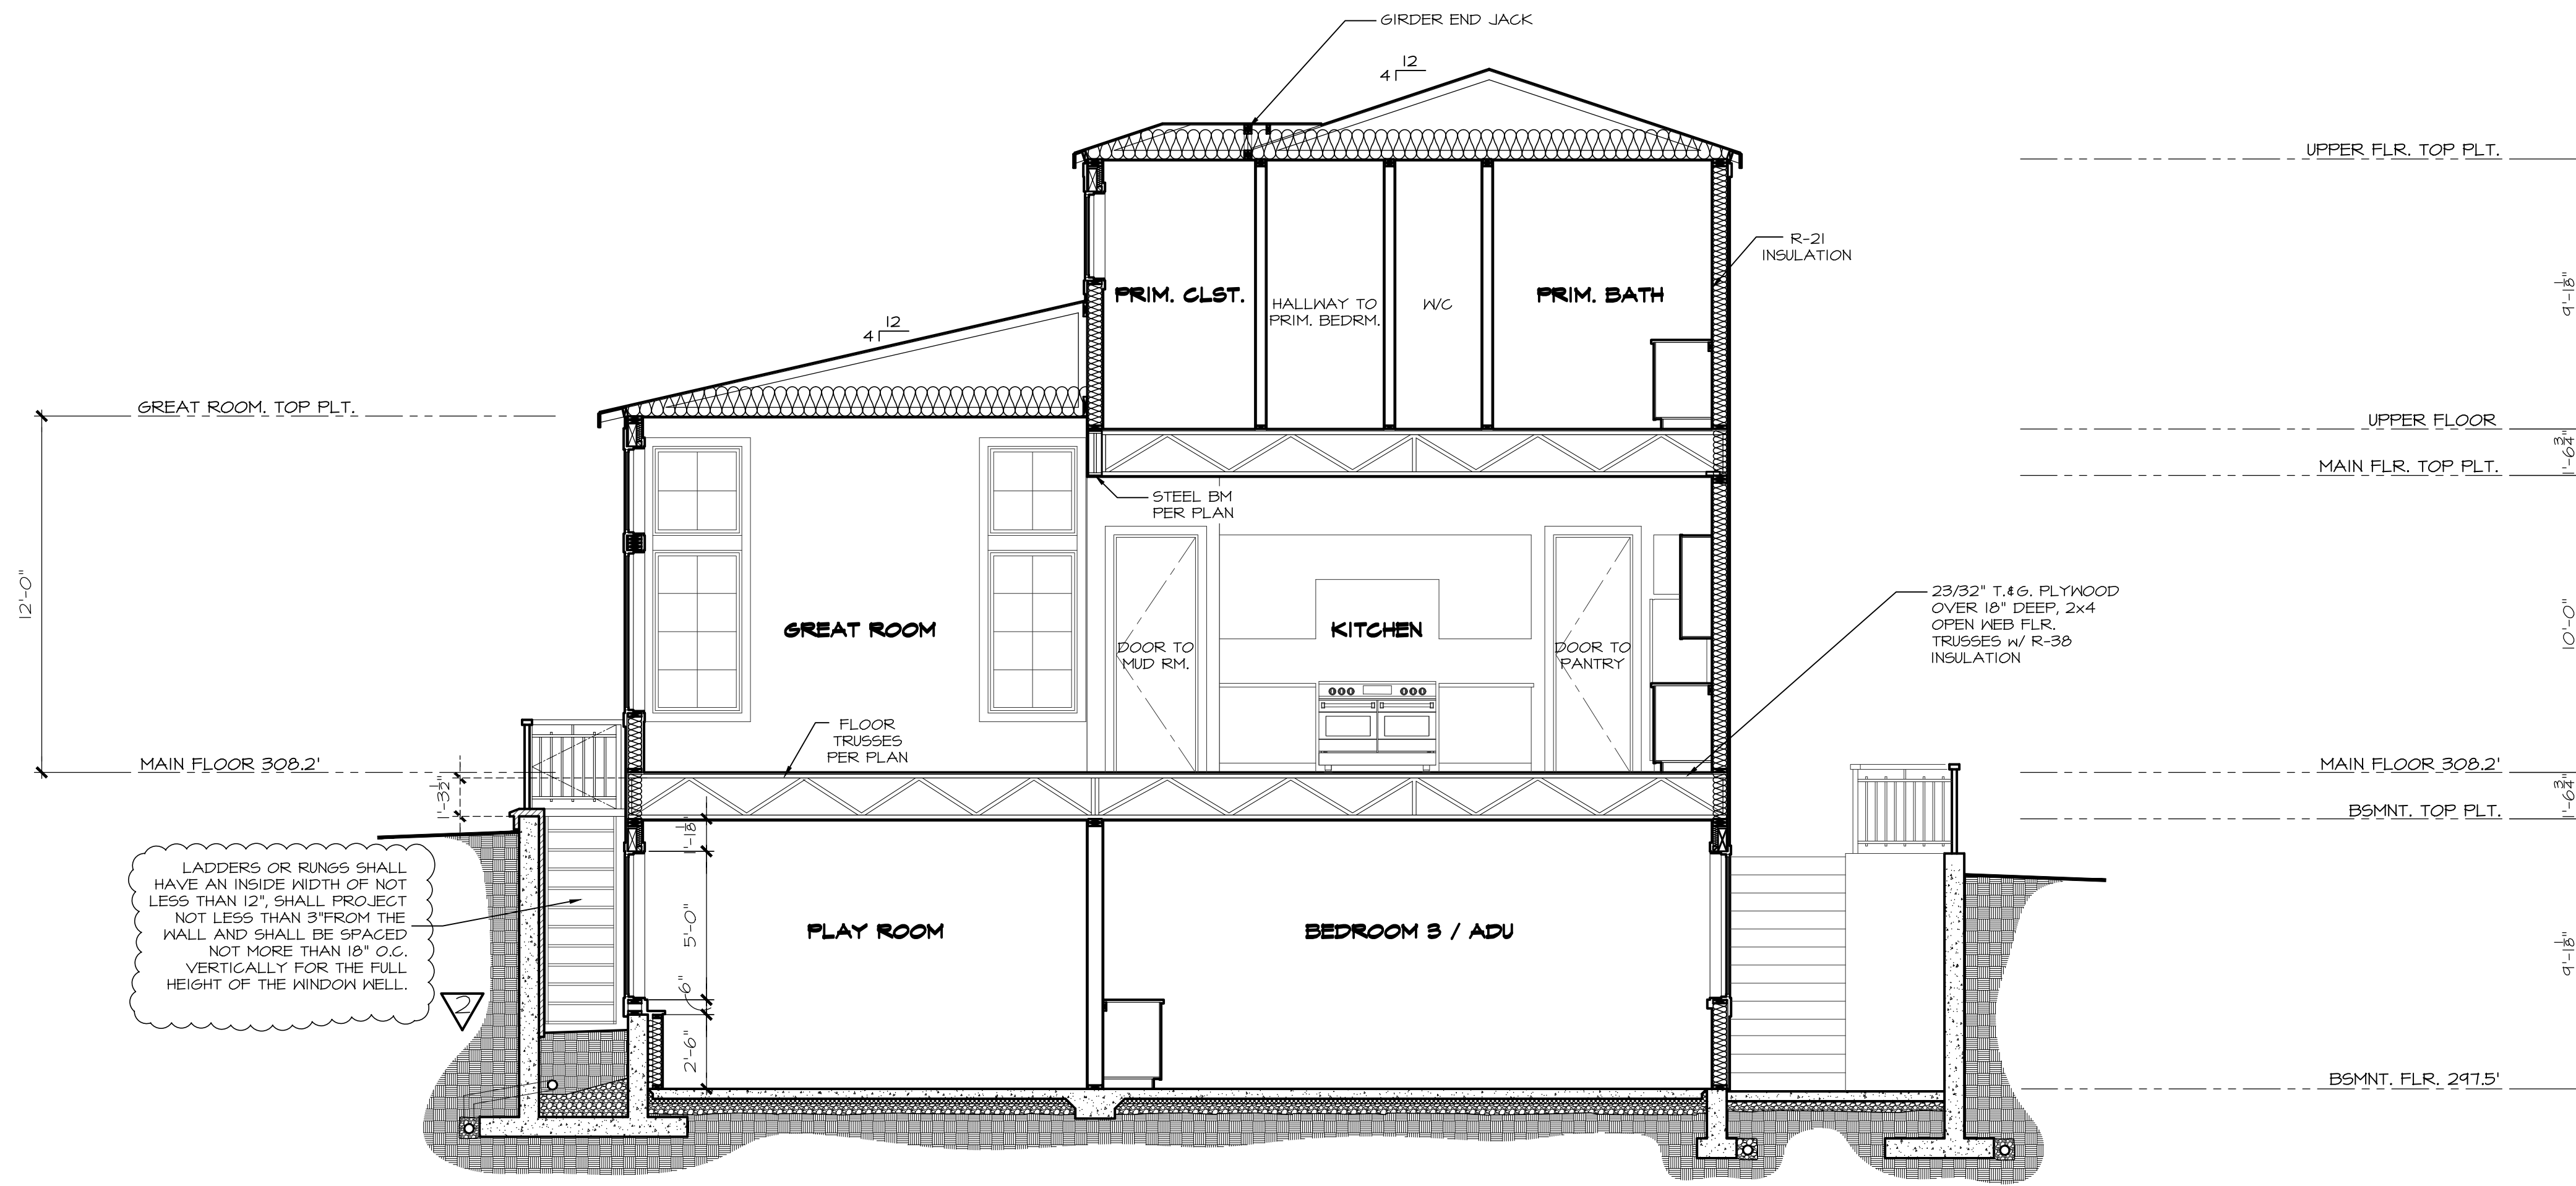


LADDERS OR RUNGS SHALL HAVE AN INSIDE WIDTH OF NOT LESS THAN 12", SHALL PROJECT NOT LESS THAN 3" FROM THE WALL AND SHALL BE SPACED NOT MORE THAN 18" O.C. VERTICALLY FOR THE FULL HEIGHT OF THE WINDOW WELL.

B BUILDING SECTION
1/4" = 1'-0"

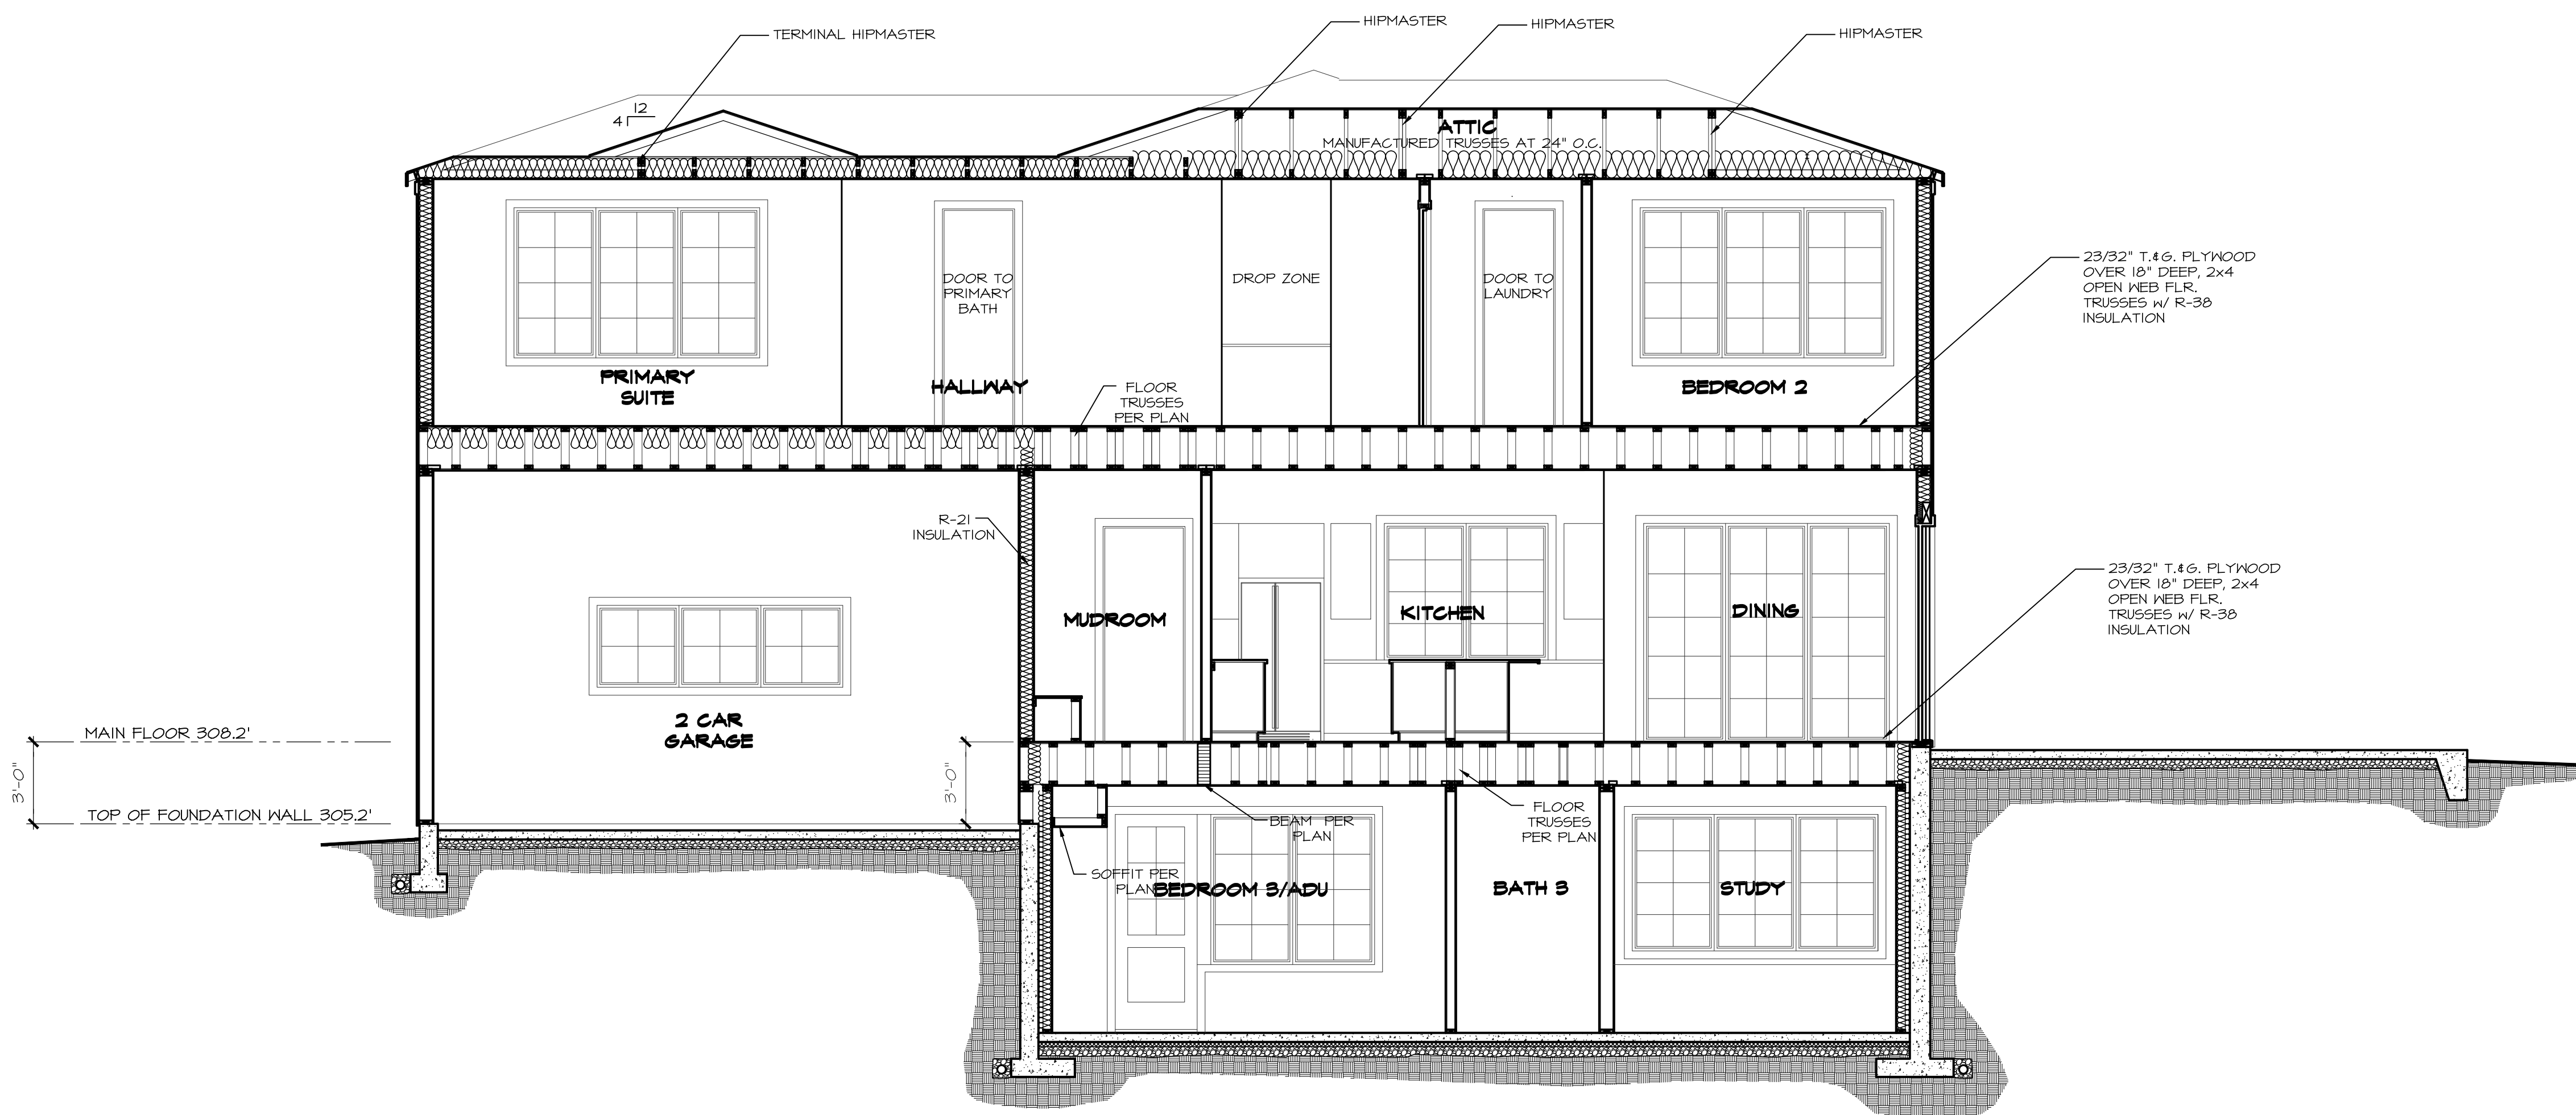

A BUILDING SECTION
1/4" = 1'-0"

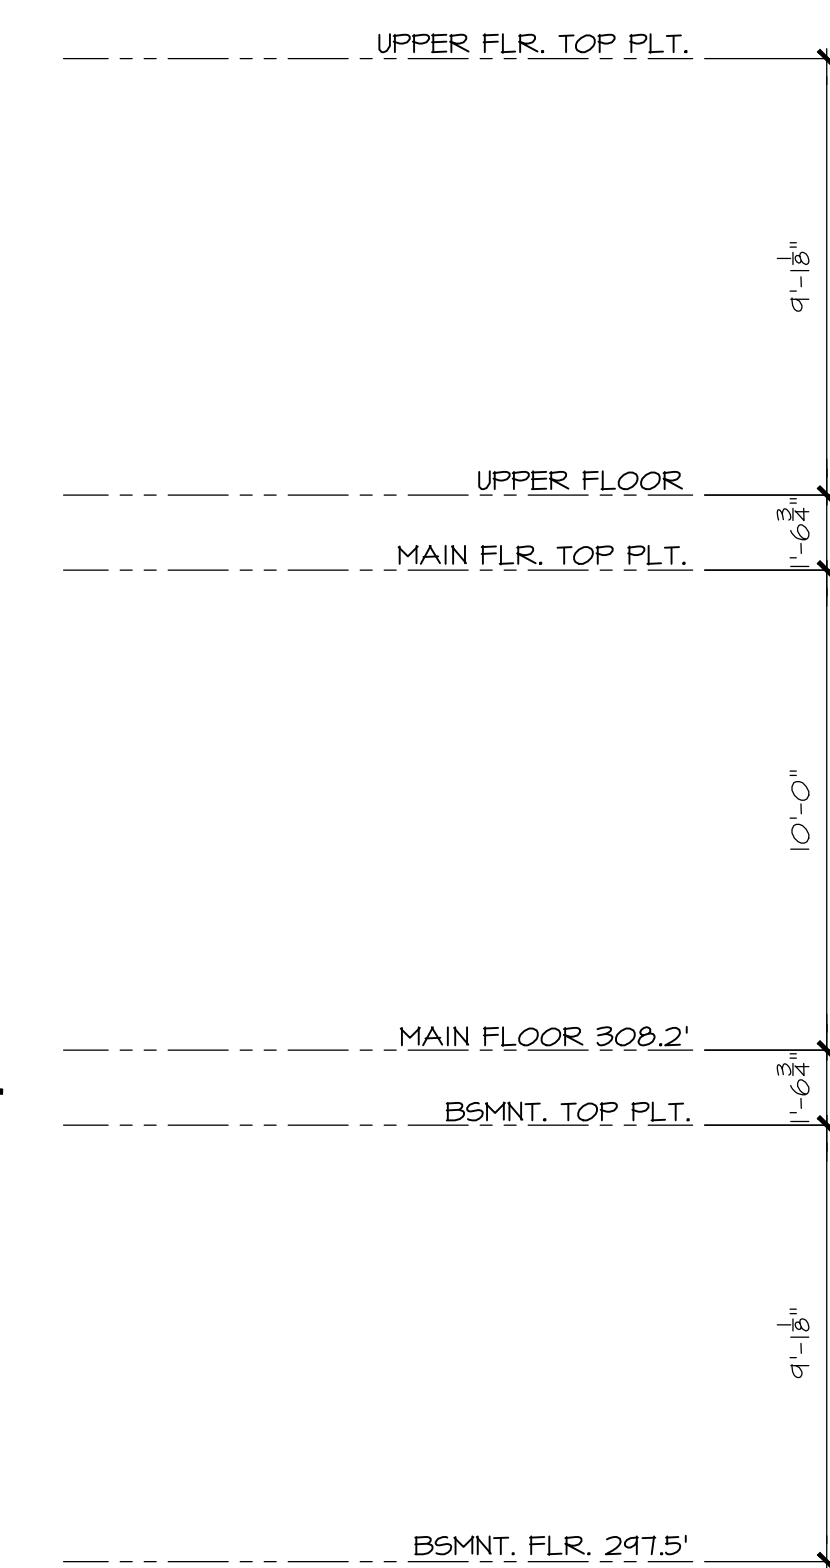

| Issue | Issue Date | By | Description |
|-------|------------|----|-------------|
| △ | | | |

8434 SE 39th ST.
Mercer Island, WA
Job Number: JMC025

plan name: -
marketing name: -
plan number: -
mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current international Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submittal Date

Sheet Title/Description

JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:



.....
Checked by:

Primary Scale

A13
of .


Sheet Title/Description

NOTES:

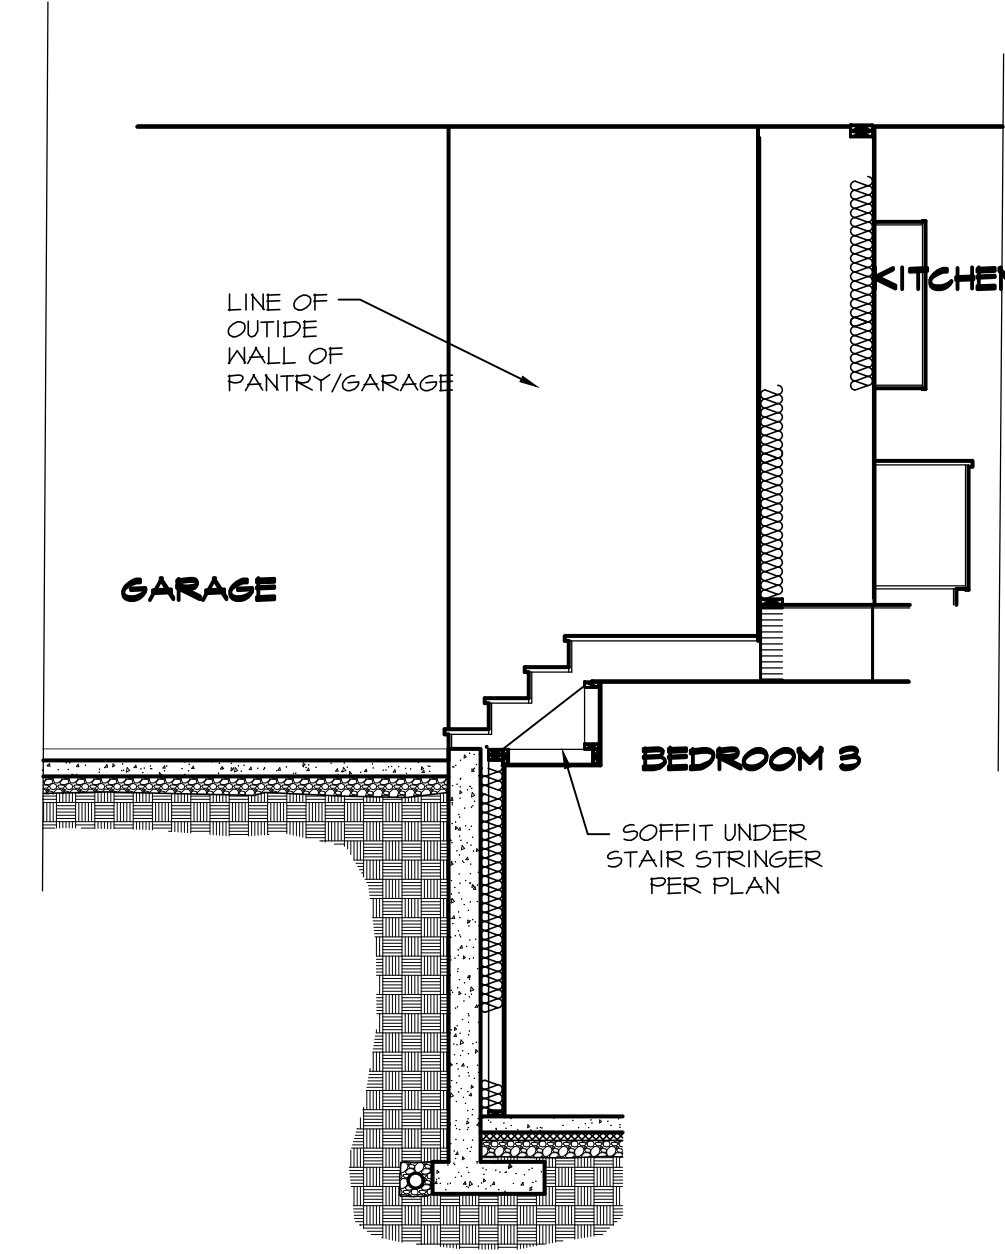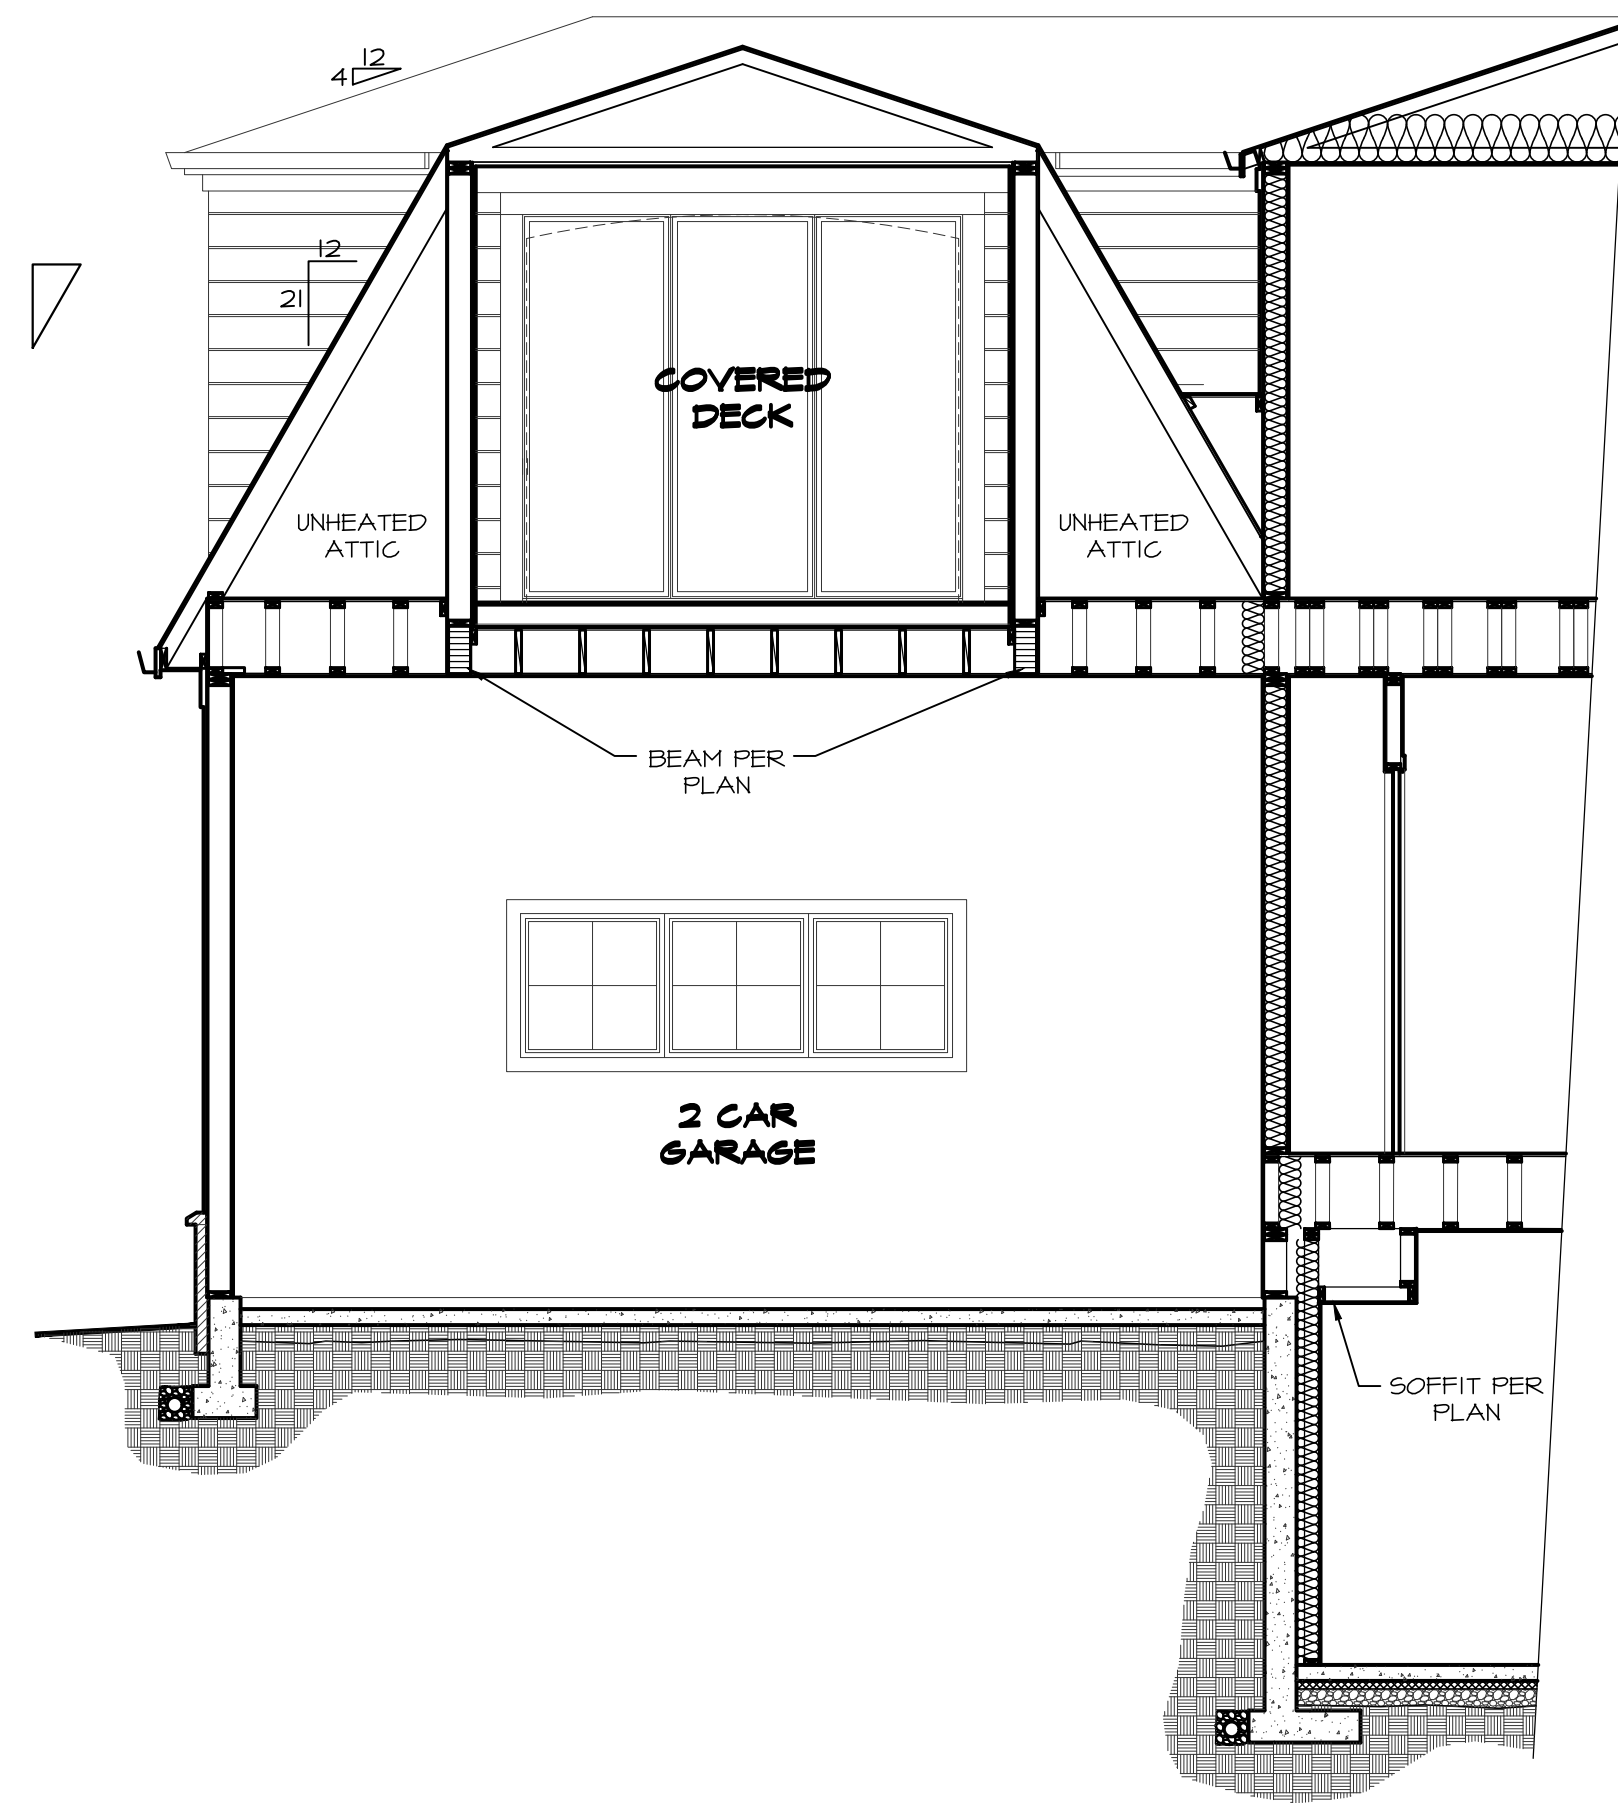


D PARTIAL BUILDING SECTION
1/4" = 1'-0"

E GARAGE TO HOUSE SECTION AT STEPS
1/4" = 1'-0"

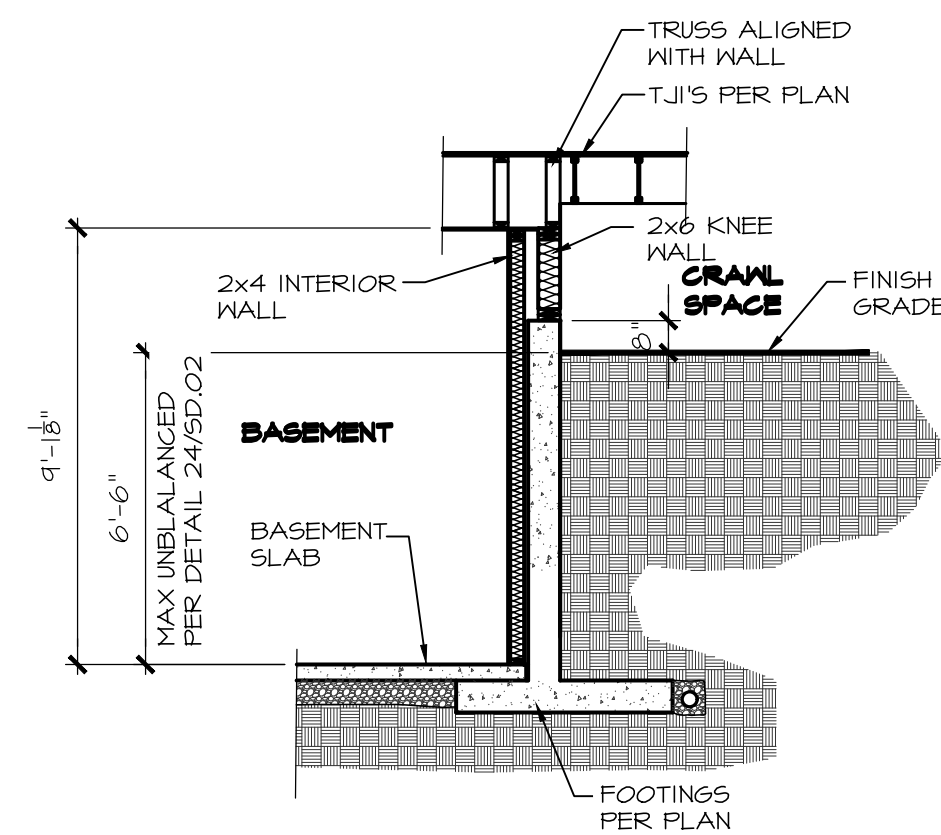

F PARTIAL SECTION
1/4" = 1'-0"
© CRAWLSPACE/BASEMENT

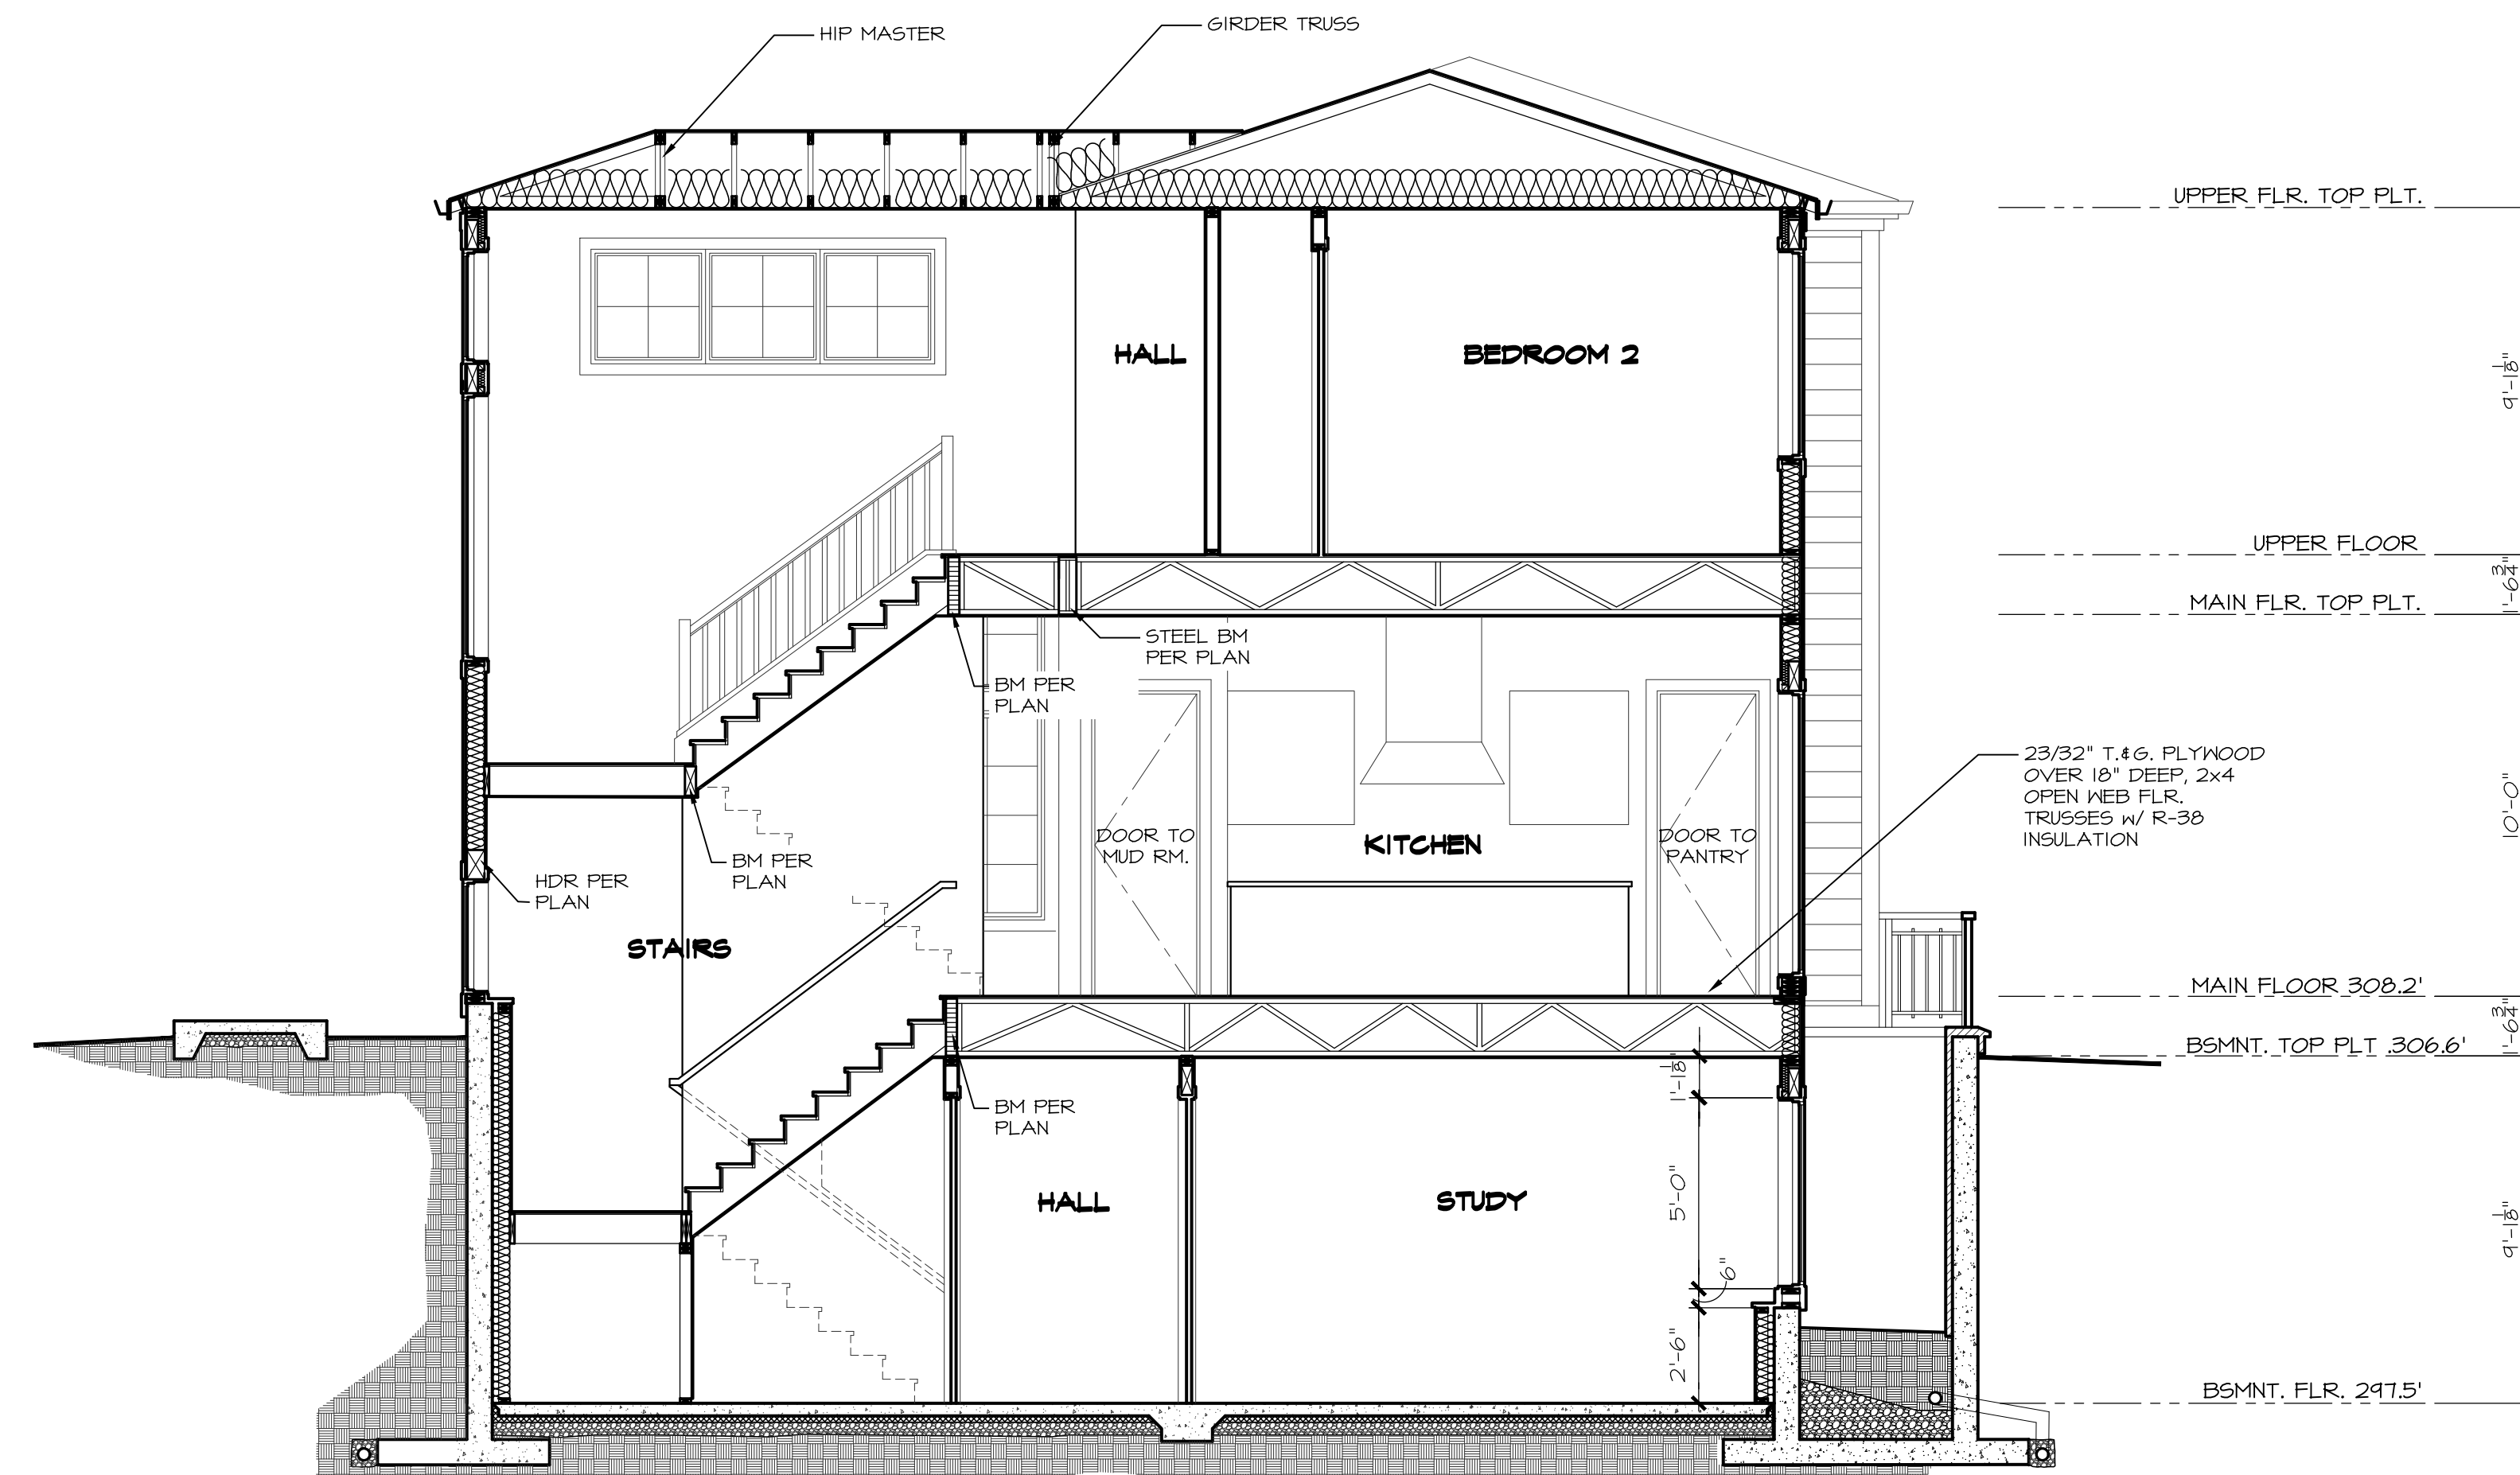

C BUILDING SECTION
1/4" = 1'-0"



7525 SE 24th St., 487
Mercer Island, WA
98040
425.266.9100

| Issue Description | Issue Date | By |
|-------------------|------------|----|
| | | |
| | | |
| | | |
| | | |

8434 SE 39th ST.
Mercer Island, WA
Job Number: JMC025

plan name: -
marketing name: -
plan number: -
mark sys. number: -

Conditions not specifically represented graphically or in writing or which conflict with the current international Residential Code (IRC.) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

12.13.23
Submittal Date

Sheet Title/Description

JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

Checked by:

Primary Scale

A14
of .

Sheet Title/Description

New SFR
8446 SE 37th St.
MERCER ISLAND, WA 98040

JayMarc Homes
7525 SE 24th St. #520
Mercer Island, WA 98040

| | | | | | | | |
|------|------|---|---|---|---|--|--|
| WSEC | 0.25 | 1 | 3 | 0 | 8 | | |
| | | | | | | | |
| | | | | | | | |

| Room | WSEC | 0.25 | 1 | 3 | 0 | 8 | | |
|------------------------|------|------|---|----|---|---|--|--|
| Bedroom 3/ADU-Store Dr | WSEC | 0.28 | 1 | 3 | 0 | 8 | | |
| Bedroom 3/ADU | WSEC | 0.28 | 1 | 6 | 0 | 5 | | |
| Playroom | WSEC | 0.28 | 3 | 3 | 0 | 5 | | |
| Stairs | WSEC | 0.28 | 2 | 3 | 0 | 3 | | |
| Study | WSEC | 0.28 | 3 | 3 | 0 | 5 | | |
| Kitchen | WSEC | 0.28 | 1 | 6 | 0 | 5 | | |
| Dining | WSEC | 0.28 | 1 | 12 | 0 | | | |
| Hall, Pwdr, & Bath 1 | WSEC | 0.28 | 3 | 2 | 0 | 4 | | |
| Junior Suite | WSEC | 0.28 | 3 | 3 | 0 | 5 | | |
| Entry | WSEC | 0.28 | 1 | 3 | 6 | 3 | | |
| Stairs | WSEC | 0.28 | 1 | 6 | 0 | 7 | | |
| Great Room | WSEC | 0.28 | 7 | 3 | 0 | 3 | | |
| Great Room | WSEC | 0.28 | 7 | 3 | 0 | 5 | | |
| Primary Suite W.I.C. | WSEC | 0.28 | 3 | 3 | 0 | 3 | | |
| Primary Suite-SGD | WSEC | 0.28 | 1 | 9 | 0 | 8 | | |
| Primary Suite | WSEC | 0.28 | 3 | 2 | 6 | 2 | | |
| Primary Suite | WSEC | 0.28 | 3 | 3 | 0 | 5 | | |
| Primary Bath @ Tub | WSEC | 0.28 | 1 | 3 | 0 | 5 | | |
| Primary Bath @ vanity | WSEC | 0.28 | 1 | 3 | 0 | 4 | | |
| Primary Bath @ shower | WSEC | 0.28 | 1 | 3 | 0 | 3 | | |
| Laundry | WSEC | 0.28 | 1 | 4 | 0 | 4 | | |
| Bedroom 2 | WSEC | 0.28 | 3 | 3 | 0 | 5 | | |
| Hall & Bath 2 | WSEC | 0.28 | 5 | 2 | 0 | 2 | | |
| Bedroom 3 | WSEC | 0.28 | 1 | 6 | 0 | 5 | | |
| Hall abv. Entry dr | WSEC | 0.28 | 1 | 3 | 0 | 3 | | |
| Stairs | WSEC | 0.28 | 5 | 3 | 0 | 3 | | |

Simple Heating System Size: Washington State
This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manual J and S. This calculator will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

Please fill out all of the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please call the WSU Energy Extension Program at (360) 956-2042 for assistance.

| Project Information | Contact Information |
|---|---|
| New SFR 8446 SE 37th St. Mercer Way MERCER ISLAND, WA 98040 | JayMarc Homes 7525 SE 24th St. #520 MERCER ISLAND, WA 98040 |

Heating System Type: All Other Systems Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions".

| Design Temperature | Design Temperature Difference (ΔT) | 45 |
|---|------------------------------------|--------|
| Area of Building | Conditioned Floor Area (sq ft) | 4,432 |
| Average Ceiling Height | Average Ceiling Height (ft) | 9.5 |
| Glazing and Doors | U-Factor X Area | 283.08 |
| Skylights | U-Factor X Area | 0 |
| Insulation | U-Factor X Area | 54.83 |
| Single Rafter or Joist Vaulted Ceilings | U-Factor X Area | 0 |
| Above Grade Walls (see Figure 1) | U-Factor X Area | 228.98 |
| Floors | U-Factor X Area | 55.80 |
| Below Grade Walls (see Figure 1) | U-Factor X Area | 33.04 |
| Slab Below Grade (see Figure 1) | F-Factor X Length | 5.15 |
| Slab on Grade (see Figure 1) | F-Factor X Length | 57.96 |

Location of Ducts

Duct Leakage Coefficient: 1.00

Sum of UA: 718.85

Envelope Heat Load: 32,348 Btu / Hour

Air Leakage Heat Load: 20,463 Btu / Hour

Building Design Heat Load: 52,811 Btu / Hour

Building and Duct Heat Load: 52,811 Btu / Hour

Maximum Heat Equipment Output: 73,935 Btu / Hour

2018 Washington State Energy Code - Residential
Prescriptive Energy Code Compliance for All Climate Zones in Washington
Single Family - New & Additions (effective February 1, 2021) Version 1.0

These requirements apply to all IRC building types, including detached one- and two-family dwellings and multiple single-family dwellings (townhouses).

| Project Information | Contact Information |
|---|--|
| Dubuy Residence 8446 SE 37th St, Mercer Island, WA | Mark Shanabarger - JayMarc Homes 7525 SE 24th St, Mercer Island, WA 98040 |

Instructions: This single-family project will use the requirements of the Prescriptive Path below and incorporate the minimum values listed. Based on the size of the structure, the appropriate number of additional credits are checked as chosen by the permit applicant.

Provide all information from the following tables as building permit drawings: Table R402.1 - Insulation and Fenestration Requirements by Component, Table R406.2 - Fuel Normalization Credits and 406.3 - Energy Credits.

| Authorized Representative | Digitally signed by Ryan Redman | Date |
|---------------------------|---------------------------------|------------|
| Ryan Redman | 2021.03.24 12:42:38 -0700 | 03/24/2021 |

| All Climate Zones (Table R402.1.1) | | |
|---|-------------------|-----------------------|
| Fenestration U-Factor ^b | R-Value | U-Factor ^a |
| Skylight U-Factor ^b | n/a | 0.30 |
| Glazed Fenestration SHGC ^{b,c} | n/a | n/a |
| Ceiling ^e | 49 | 0.026 |
| Wood Frame Wall ^{d,h} | 21 int. | 0.056 |
| Floor | 30 | 0.029 |
| Below Grade Wall ^{e,h} | 10/15/21 int + TB | 0.042 |
| Slab ^{d,f} R-Value & Depth | 10, 2 ft | n/a |

R-values are minimums. U-factors and SHGC are maximums. When insulation is installed in a cavity that is less than the label or design thickness of the insulation, the compressed R-value of the insulation from Appendix Table A101.4 shall not be less than the R-value specified in the table.

a. The fenestration U-factor column excludes skylights.

b. "10/15/21 +5TB" means R-10 continuous insulation on the exterior of the wall, or R-15 continuous insulation on the interior of the wall, or R-21 cavity insulation plus a thermal break between the slab and the basement wall at the interior of the basement wall. "10/15/21 +5TB" shall be permitted to be met with R-13 cavity insulation on the interior of the basement wall plus R-5 continuous insulation on the interior or exterior of the wall. "5TB" means R-5 thermal break between floor slab and basement wall.

c. R-10 continuous insulation is required under heated slab on grade floors. See Section R402.2.9.1.

d. For single rafter- or joist-vaulted ceilings, the insulation may be reduced to R-38 if the full insulation depth extends over the top plate of the exterior wall.

e. R-2.5 continuous insulation installed over an existing slab is deemed to be equivalent to the required perimeter slab insulation when applied to existing slabs complying with Section R503.1.1. If foam plastic is used, it shall meet the requirements for thermal barriers protecting foam plastics.

f. For log structures developed in compliance with Standard ICC 400, log walls shall meet the requirements for climate zone 5 of ICC 400.

g. int. (intermediate framing) denotes framing and insulation as described in Section A103.2.2, including standard framing 16 inches on center, 78% of the wall cavity insulated and headers insulated with a minimum of R-10 insulation.

h. ins. (intermediate framing) denotes framing and insulation as described in Section A103.2.2, including standard framing 16 inches on center, 78% of the wall cavity insulated and headers insulated with a minimum of R-10 insulation.

2018 Washington State Energy Code - Residential
Prescriptive Energy Code Compliance for All Climate Zones in Washington
Single Family - New & Additions (effective February 1, 2021)

| Energy Options | Energy Credit Option Descriptions (cont.) | Credits - select ONE energy option from each category ¹ | User Notes |
|----------------------|---|--|------------|
| 5.1 ^d | Efficient Water Heating | 0.5 | |
| 5.2 | Efficient Water Heating | 0.5 | |
| 5.3 | Efficient Water Heating | 1.0 | |
| 5.4 | Efficient Water Heating | 1.5 | |
| 5.5 | Efficient Water Heating | 2.0 | |
| 5.6 | Efficient Water Heating | 2.5 | |
| 6.1 ^e | Renewable Electric Energy (3 credits max) | 1.0 | |
| 7.1 | Appliance Package | 0.5 | |
| Total Credits | | 6.0 | |

a. An alternative heating source sized at a maximum of 0.5 W/sf (equivalent) of heated floor area or 500 W, whichever is bigger, may be installed in the dwelling unit.

b. Equipment listed in Table C403.3.2(4) or C403.3.2(5).

c. Equipment listed in Table C403.3.2(1) or C403.3.2(2).

d. You cannot select more than one option from any category EXCEPT in category 5. Option 5.1 may be combined with options 5.2 through 5.6. See Table 406.3.

e. 3.0 credit for each 1,200 kWh of electrical generation provided annually, up to 3 credits max. See the complete Table R406.2 for all requirements and option descriptions.

f. Use the single radiobutton in the upper right of the second column to deselect radiobuttons in that group.

JAYMARC HOMES
7525 SE 24th St., 487
Mercer Island, WA 98040
425.266.9100

| Issue | Issue Date By | Description |
|-------|---------------|-------------|
|-------|---------------|-------------|

8434 SE 39th ST.
Mercer Island, WA.
Job Number: JMC025

plan name: _____
marketing name: _____
plan number: _____
mark sys. number: _____

Conditions not specifically represented graphically or in writing or which conflict with the current international Residential Code (IRC) or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

05.18.23
Submittal Date

Sheet Title/Description
JAYMARC HOMES
Design Firm

R.K.N.
Drawn by:

Checked by:

Primary Scale

EN1
of .

ENERGY SHEET

Sheet Title/Description



Vertical wall Installation


Install TYPAR® HouseWrap over an approved exterior sheathing after the framing is complete and before the windows and doors have been installed. Plastic capped fasteners should be used and spaced at 32" OC (vertically and horizontally) when being applied over 7/16" OSB or 15/32" plywood. When installing over metal framing use screws with washers. If the windows and doors have already been installed, trim the TYPAR WRB close to the window frame and flash according to the TYPAR Flashing instructions.

STEP 1

Start at the bottom of one end of the wall with the printed side facing out. When starting at a corner, overlap by a minimum of 12".

Place the housewrap roll horizontally and roll out the first course evenly, covering rough window and door openings. A minimum of a 1" (25.4 mm) overlap on the sill plate is required; however, for maximum protection, a 2-4" (51-102 mm) overlap on the sill plate is recommended.

Pull the TYPAR snug and avoid wrinkles and creases. Ensure that the product is level.

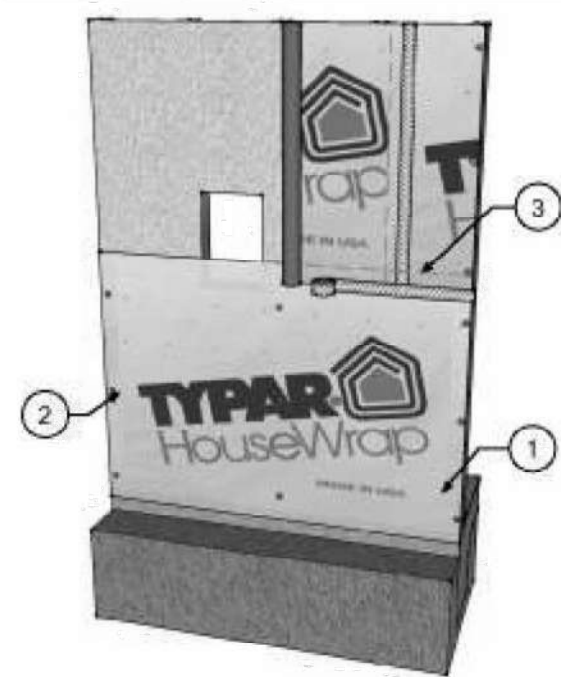

STEP 2

Fasten the TYPAR to the stud using plastic capped nails or plastic capped staples at 32" O.C. both horizontally and vertically.



STEP 3

The upper layer of TYPAR housewrap should overlap the bottom layer by a minimum of 6" (152 mm) vertically and horizontally. Ensure proper shingling throughout the installation to properly shed water. Once the structure is completely covered, tape all seams and penetrations using TYPAR® construction tape. (Please refer to the TYPAR® flashing instructions for more detailed instruction on penetrations and window flashing installation).

STEP 4

After the installation complete and before the exterior cladding is installed, inspect the TYPAR® for tears. Repair the issues with TYPAR Construction tape or TYPAR Flashing.



Window and Door Preparation

Preparing for Window Installation

STEP 1

After wrapping the structure and covering all rough openings. Cut a horizontal line across the top of the window opening. The cut should not extend past the rough opening.

STEP 2

Start at the top center and make a vertical cut running two-thirds of the way down the opening.

STEP 3


From that stopping point, cut diagonally to both lower left and right corners of the opening.

STEP 4

Pull each of the flaps tightly inside the rough opening and attach them to the frame with nails, staples, or tape.

STEP 5

At the window header, make a 6" diagonal cut at a 45 degree angle on both corners. Fold the material up exposing the sheathing. Now install the window or door according to the manufacturer instructions. The final step is to flash all seams and flanges securely (refer to TYPAR® Flashing instructions). TYPAR® flashing should also be installed in accordance with window manufacturer instructions and according to the ASTM 2112 standard.

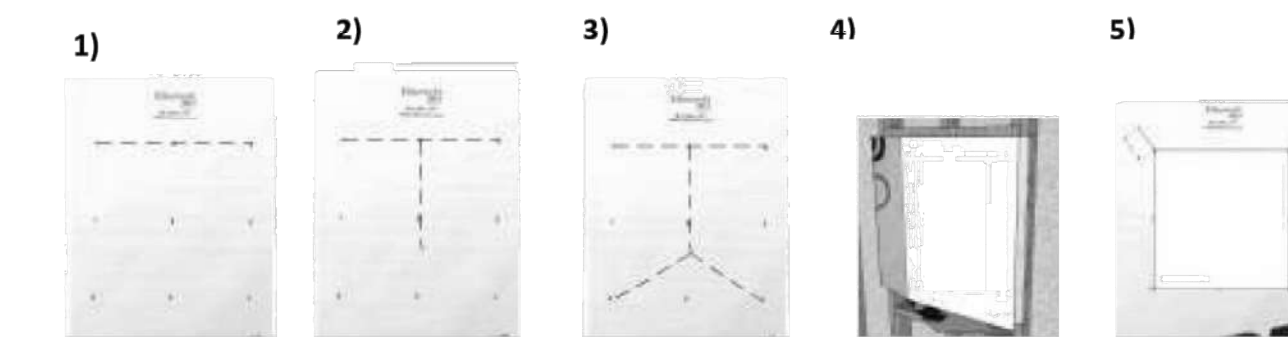

Typical Window Flashing

STEP 1

Install the window sill pan according to the manufacturer's instructions. Alternatively, you can create a sill pan using TYPAR Flashing Flex. Cut a piece that is 12" longer than the length of the rough opening window sill.

Carefully pull off the release liner. Center the Flashing in the center of the rough opening and work you way toward the corners and then up the sides. Note: the flex flashing should overlap to the outside of the wall by 2-3". Only stretch the flashing in the corners.

Alternatively to above, you can create a sill pan by installing TYPAR Straight Flashing along the bottom sill and installing TYPAR Flashing Flex on the corners only.

If needed, secure the fanned edges of the TYPAR Flashing Flex with a plastic capped nail/ plastic capped staple.

STEP 2

Apply a continuous bead of sealant to the back of the window or on the wall. Do not apply the sealant across the bottom of the sill or on the bottom of the window. This area is left open to allow for proper drainage.

Install the window according to the manufacturer's installation instructions.


STEP 3

Cut two pieces of TYPAR Flashing long enough to extend 1" above the window head flange and 1" below the window sill flange. Carefully peel off the release liner and apply the flashing on both sides of the window. Make sure to cover the entire window flange, press firmly either by hand or using a J-roller. Ensure there are no wrinkles or bubbles.

Cut a piece of TYPAR Flashing for the head flashing. Ensure that the piece is long enough to extend by 1" on both sides of the jamb flashing. Remove the release liner and carefully install the flashing. Cover the window flange and press firmly by hand or using a J-roller.

STEP 4

Release the upper flap of the WRB that you cut earlier. Tape the 45 degree cuts using TYPAR Construction Tape or TYPAR Flashing. DO NOT tape the WRB along the top of the window flange.

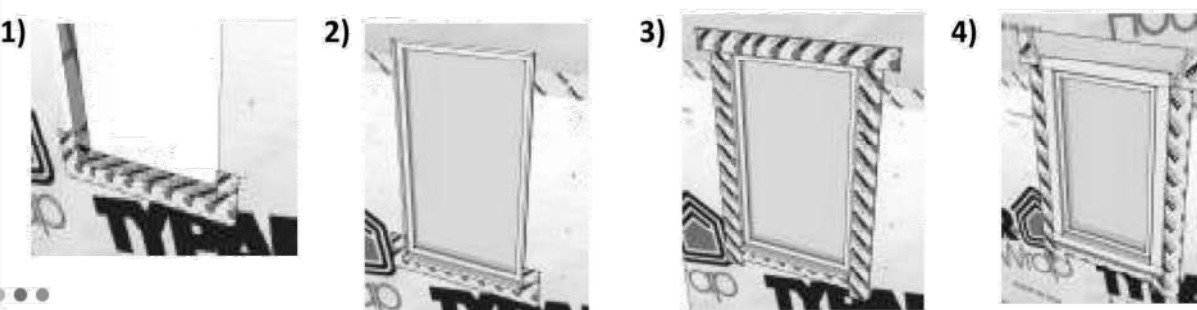


Flashing Penetrations

Penetrations such as exhaust fans, exterior electrical outlets, dryer vents, exterior lights, and gas outlets are a common entrance for bulk water into the wall cavity. Using TYPAR flashing will ensure proper water hold out and maintain the integrity of the structure.


The method is similar to the flashing a window. Start by flashing the bottom of the penetration. Ensure to shingle the upper tape over the bottom tape.

Some penetrations have flanges, such as dryer vents. These penetrations should be flashed according to the details below.


1)

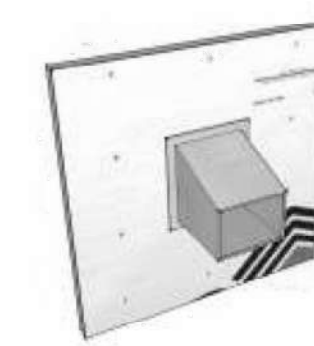

2)

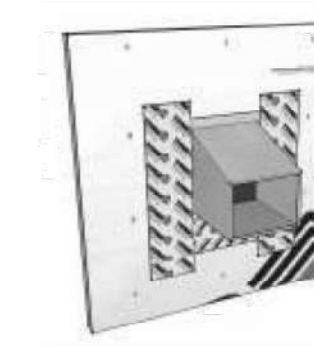

3)

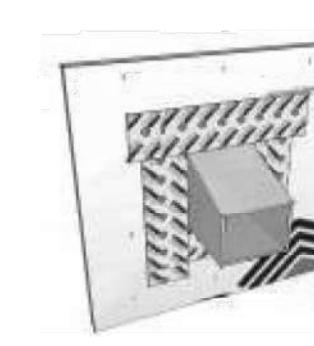

STEP 1

Install the vent according to the manufacturer's recommendations. Trim the housewrap as close as possible around the perimeter of the vent.

STEP 2

Flash the vent using the same method as windows. Starting at the bottom flange; cut the flashing so that it extends past the flanges by 1" on both sides. Now apply the flashing to the sides of the vent. Remember to extend the flashing 1" on both top and bottom. Make sure to smooth out wrinkles and air bubbles. The use of a J-roller is optional.

STEP 3

The Final step is to install the flashing across the top. Extend the flashing out at least 1" on both sides.

Note: This type of installation is suitable for several different penetrations. Always use the shingling method and ensure a tight seal around the flange/penetration.

TYPAR® HouseWrap is part of a complete Weather Protection System, which also includes TYPAR® Metro Wrap, TYPAR® Flashings and Construction tape

For more information, visit www.Typar.com



MADE IN USA. ICC #ESR-1404 • CCMC #12884-R • CCMC #12892-R
Please visit typar.com for installation instructions and warranty information



7525 SE 24th St., 487
Mercer Island, WA
98040
425.266.9100

| Issue Description | Issue Date | By |
|-------------------|------------|----|
| | | |
| | | |
| | | |
| | | |

Job Number:

| | |
|-------------------|----|
| plan name: | -- |
| marketing name: | -- |
| plan number: | -- |
| mark sys. number: | -- |

Conditions not specifically represented graphically or in writing or which conflict with the current International Residential Code (IRC), or those of the local municipality then the current standards and requirements of each respectively shall govern.

The drawings in this set are instruments of service and shall remain the property of JayMarc Homes, LLC.

© 2017 JayMarc Homes, LLC; All rights reserved.

Submittal Date

Sheet Title/Description

Design Firm


Drawn by:

Checked by:

Primary Scale

D1 of .

Sheet Title/Description

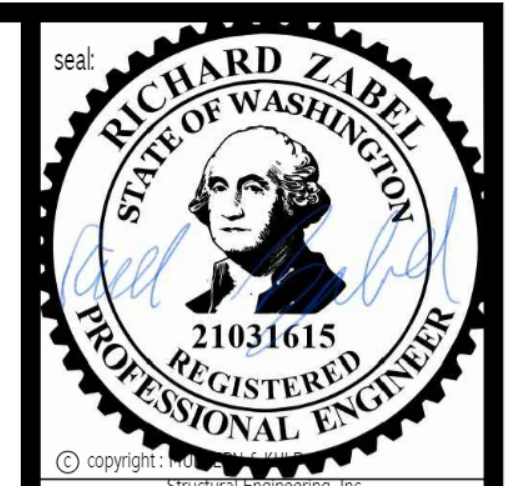

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Brookside Ave. Building 4 - Ambler, PA 19002
p. 215-646-8001 • mulhernkulp.com



M&K project number: 154-23001

project mgr: RJC
drawn by: AJC
issue date: 5-05-23

REVISIONS:


| date | initial |
|------|---------|
| | |




STRUCTURAL DETAILS
DUBEY RESIDENCE
8434 SE 39TH ST
MERCER ISLAND, WASHINGTON

sheet:


LB-1

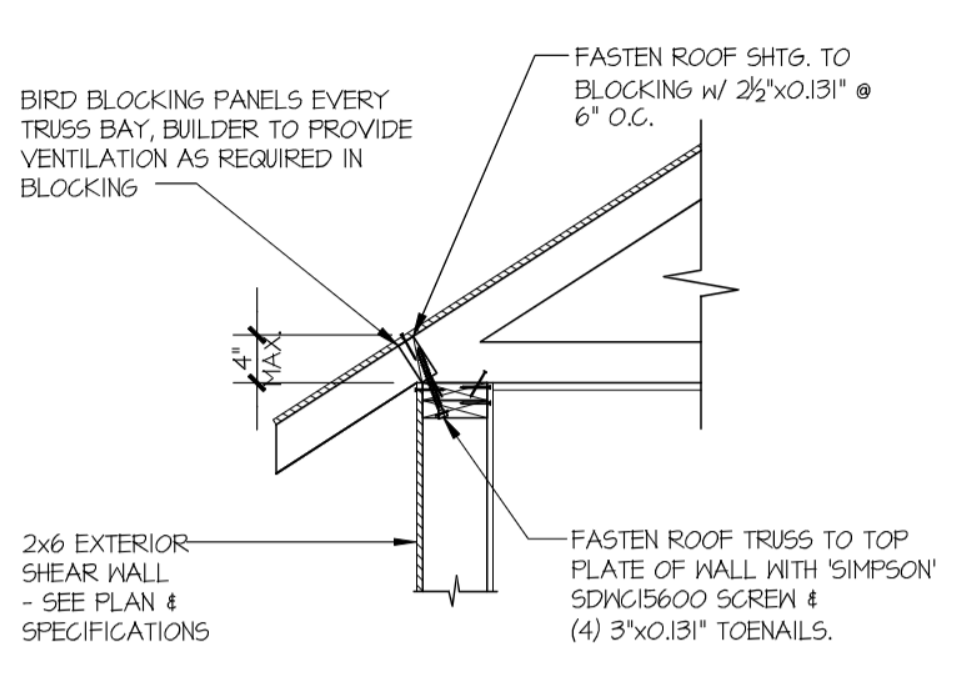


1 TYPICAL SHEAR TRANSFER DETAIL @ ROOF
SCALE: 3/4"=1'-0" HEEL HEIGHT LESS THAN 4"

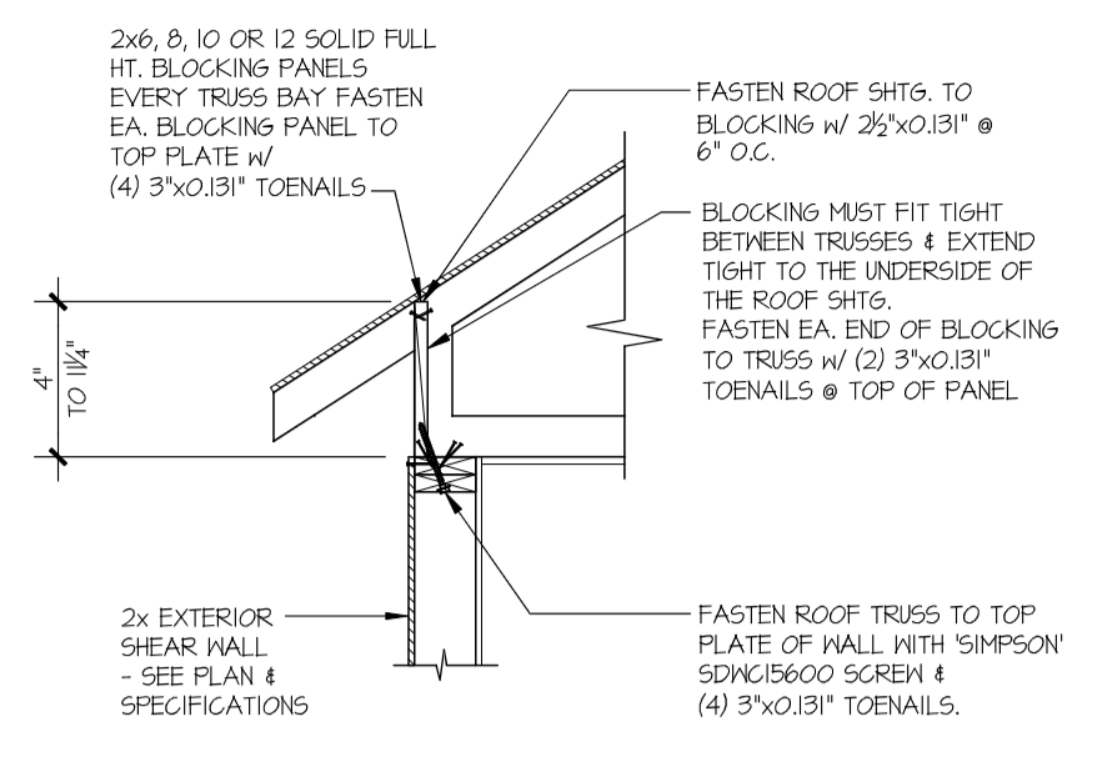


1 TYPICAL SHEAR TRANSFER DETAIL @ ROOF
SCALE: 3/4"=1'-0" HEEL HEIGHT BETWEEN 4" - 1/4"

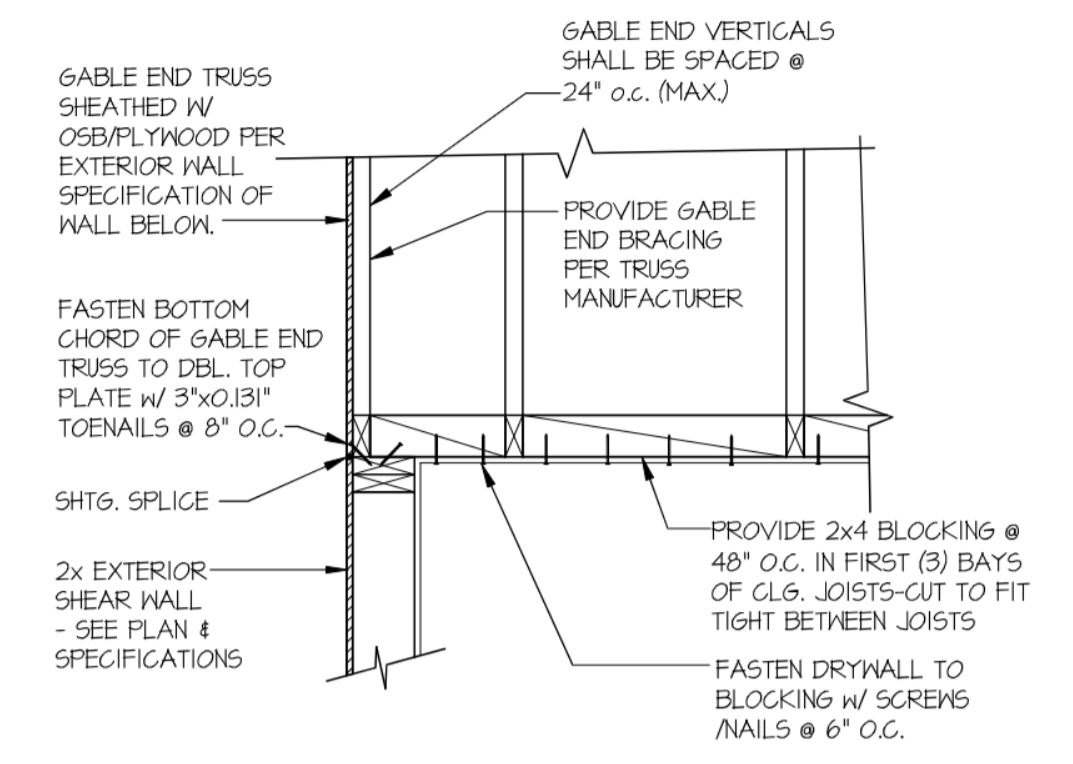


2 TYPICAL GABLE END DETAIL
SCALE: 3/4"=1'-0"

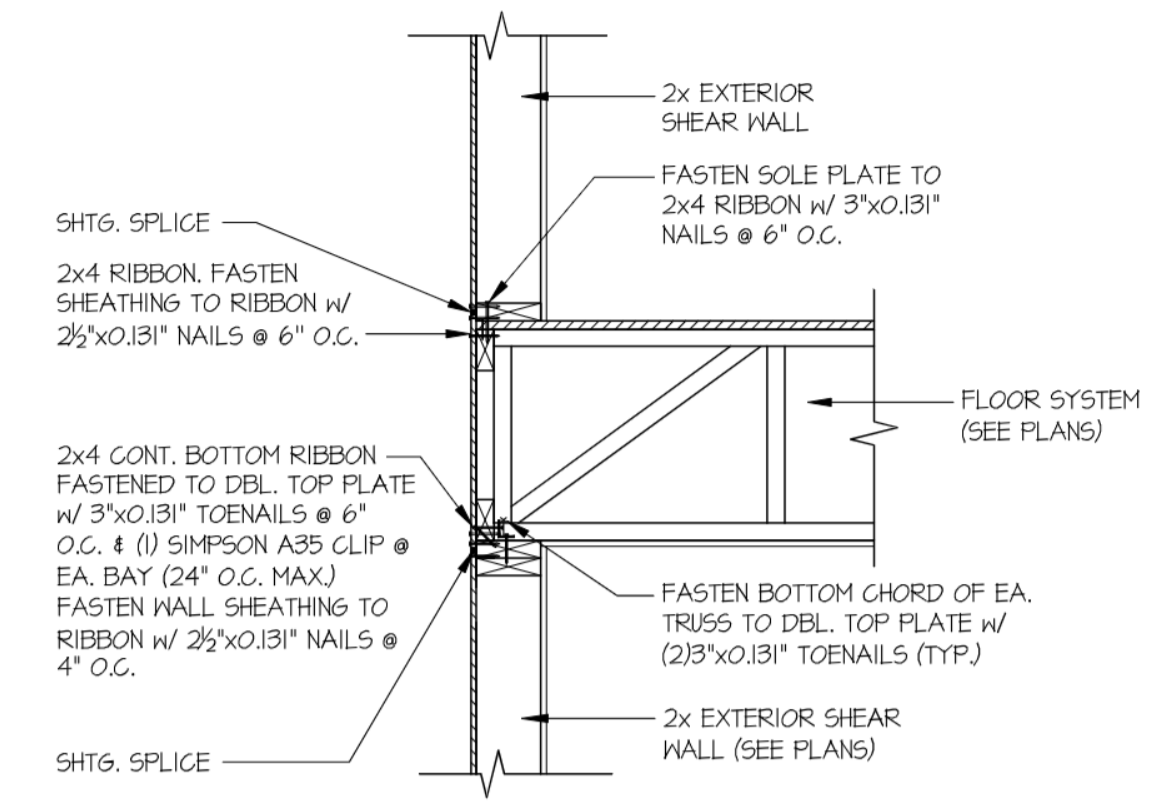


3 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ EXTERIOR WALL
SCALE: 3/4"=1'-0" PERPENDICULAR FRAMING

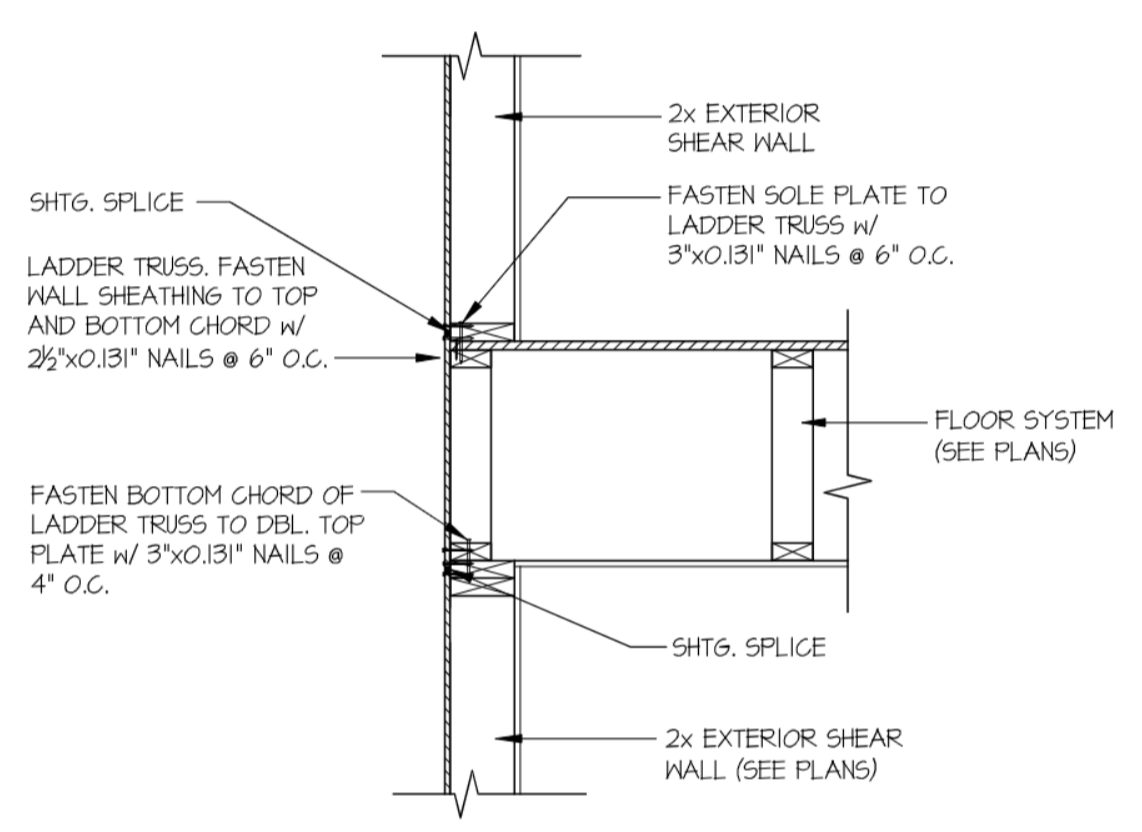


4 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ EXTERIOR WALL
SCALE: 3/4"=1'-0" PARALLEL FRAMING

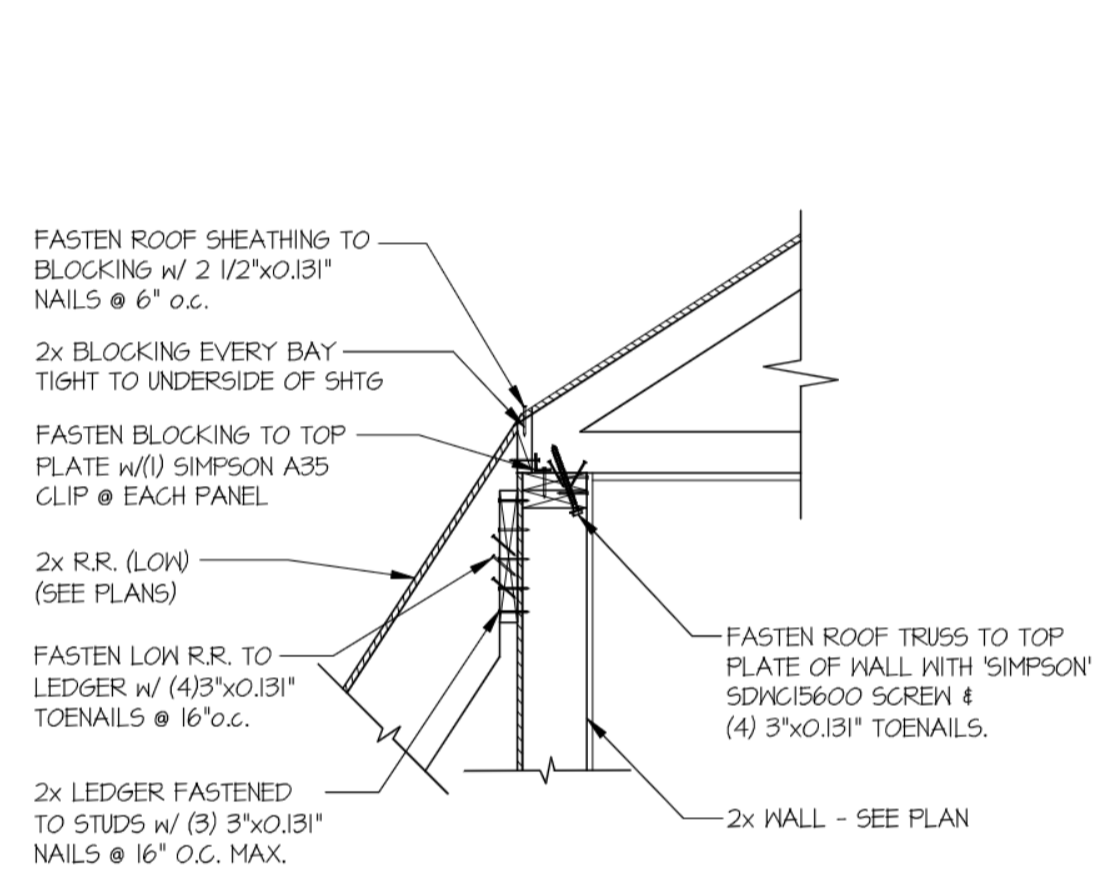


5 SECTION
SCALE: 3/4"=1'-0"

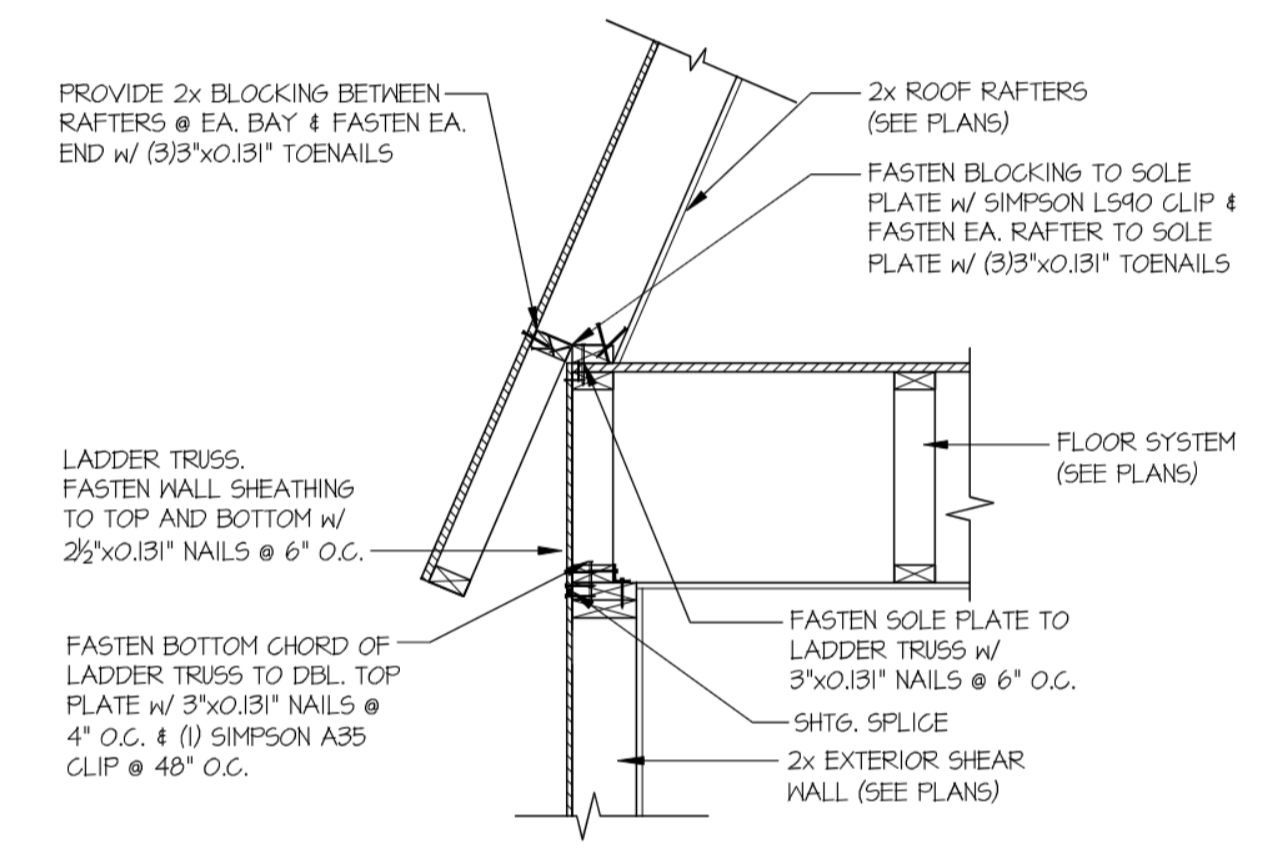


6 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ EXTERIOR WALL
SCALE: 3/4"=1'-0" PARALLEL FRAMING

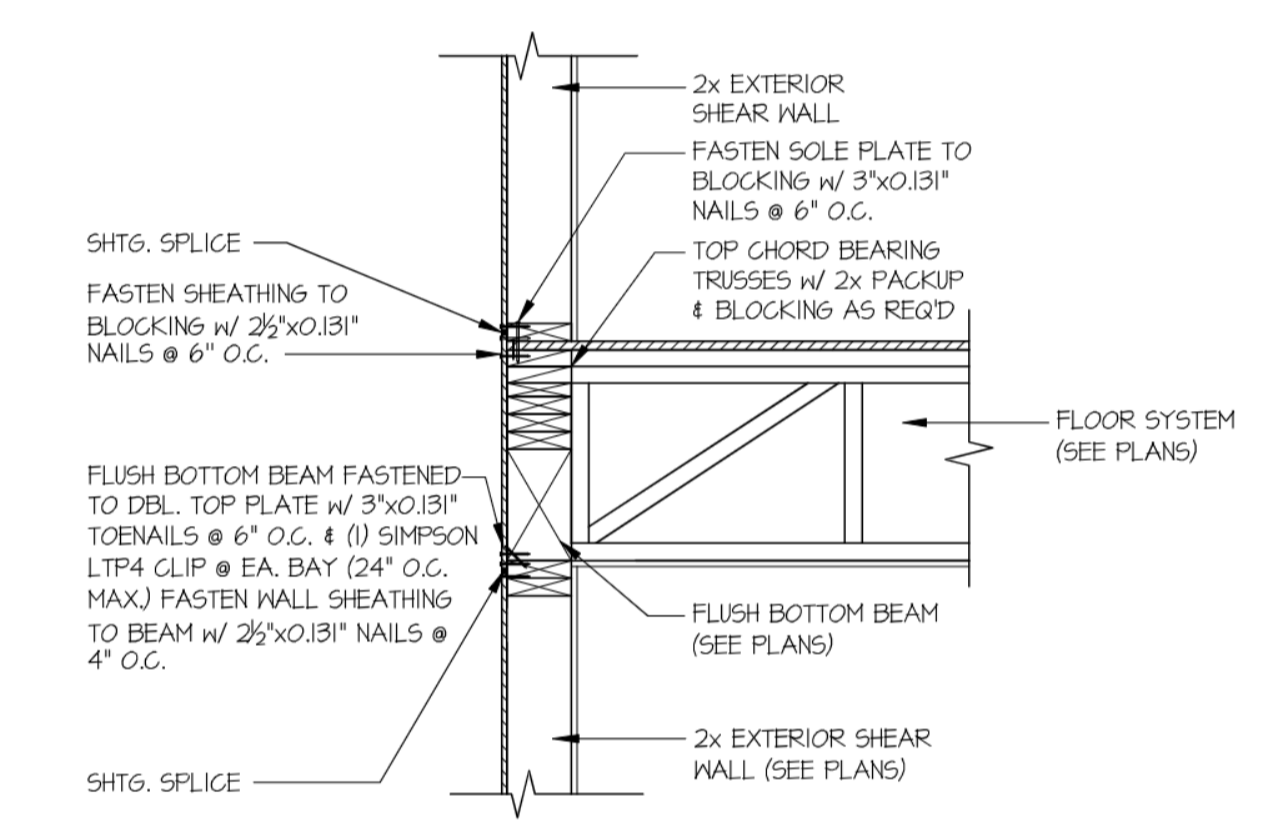


8 SECTION
SCALE: 3/4"=1'-0" PARALLEL FRAMING

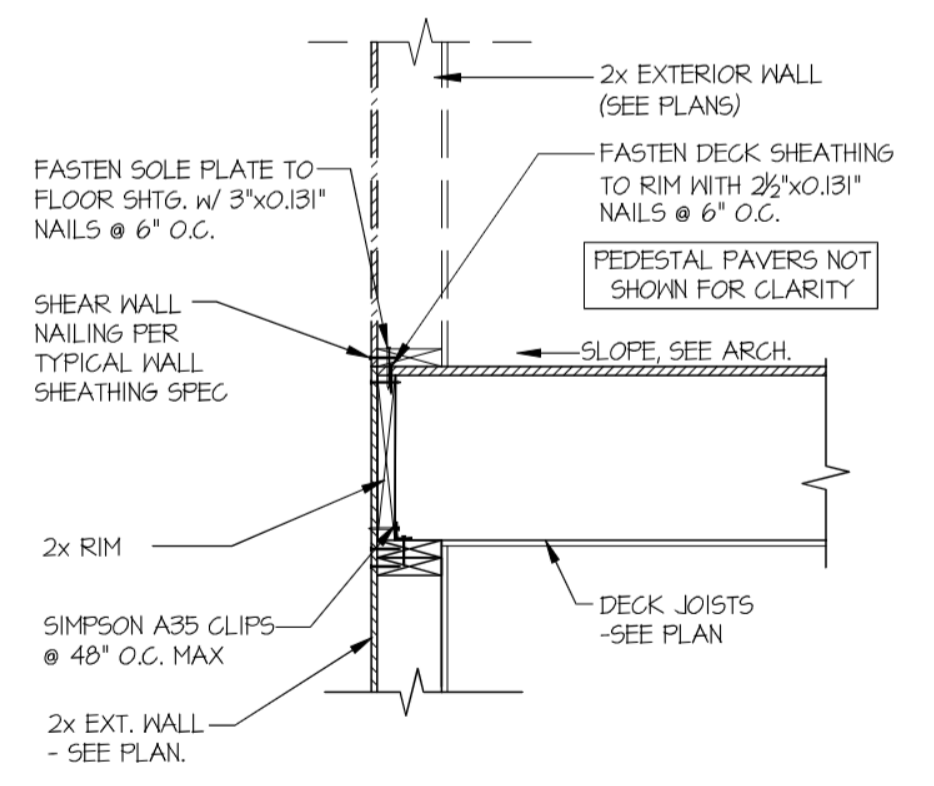


9 TYPICAL SHEAR TRANSFER DETAIL @ ROOF RAFTERS
SCALE: 3/4"=1'-0"

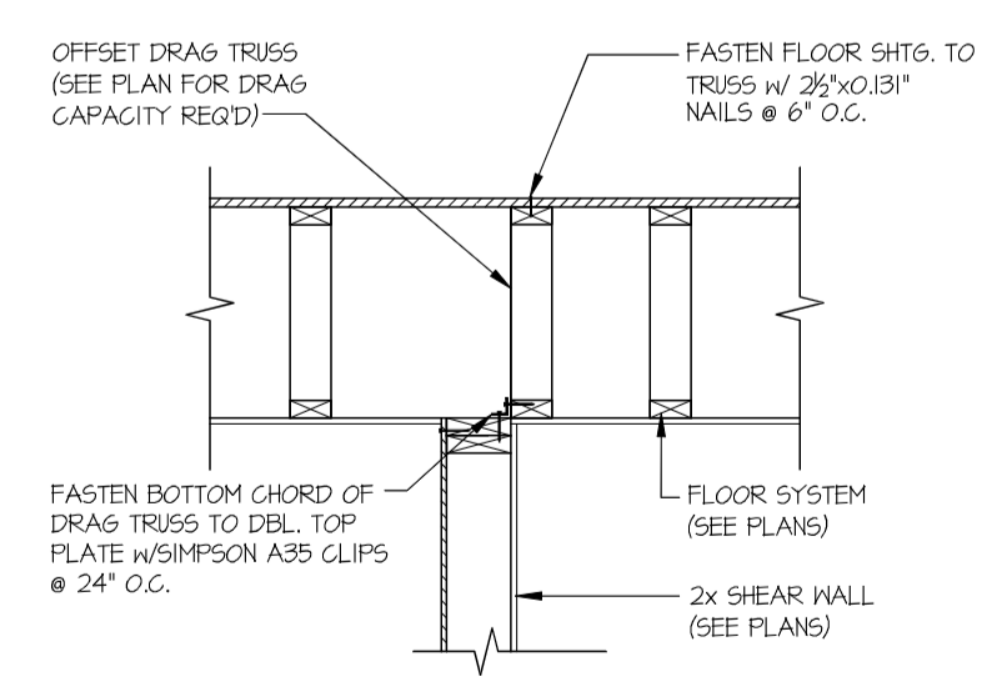

11 SHEAR TRANSFER DETAIL @ SHEAR WALL BELOW
SCALE: 3/4"=1'-0"

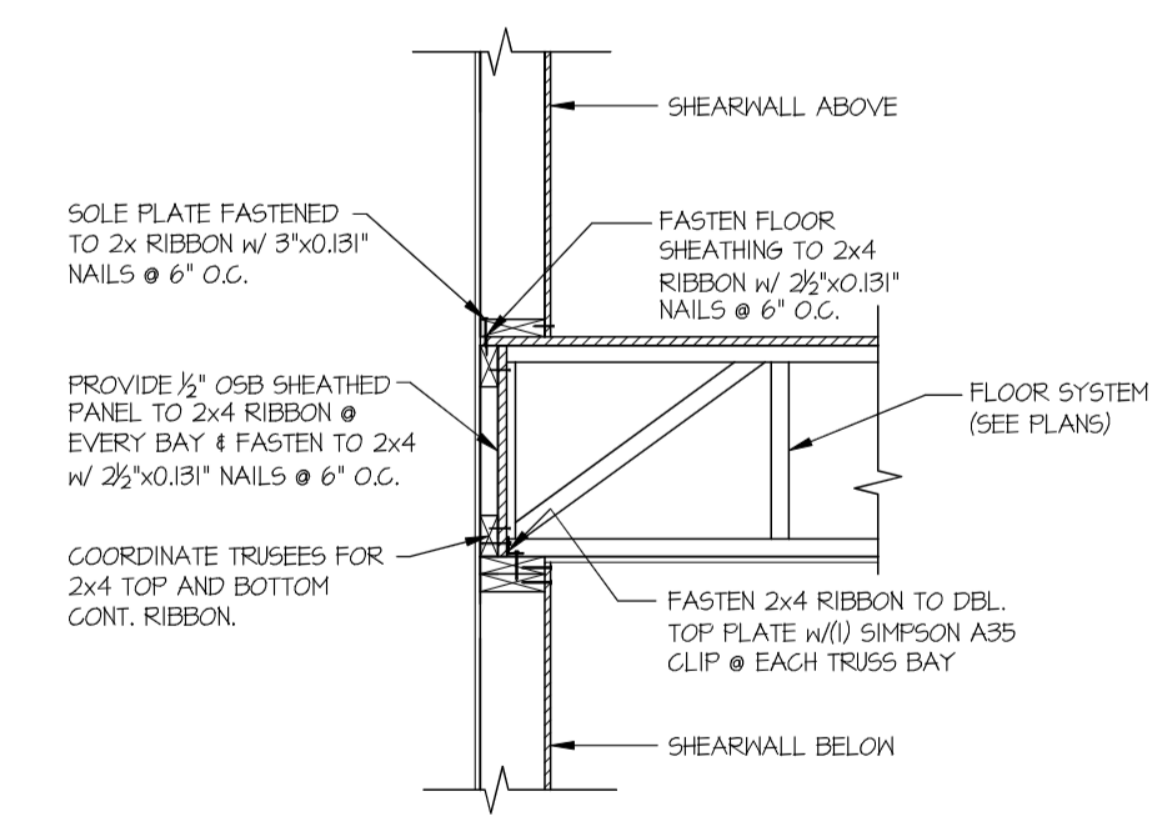

21 SHEAR TRANSFER DETAIL @ INTERIOR SHEAR WALL
SCALE: 3/4"=1'-0"

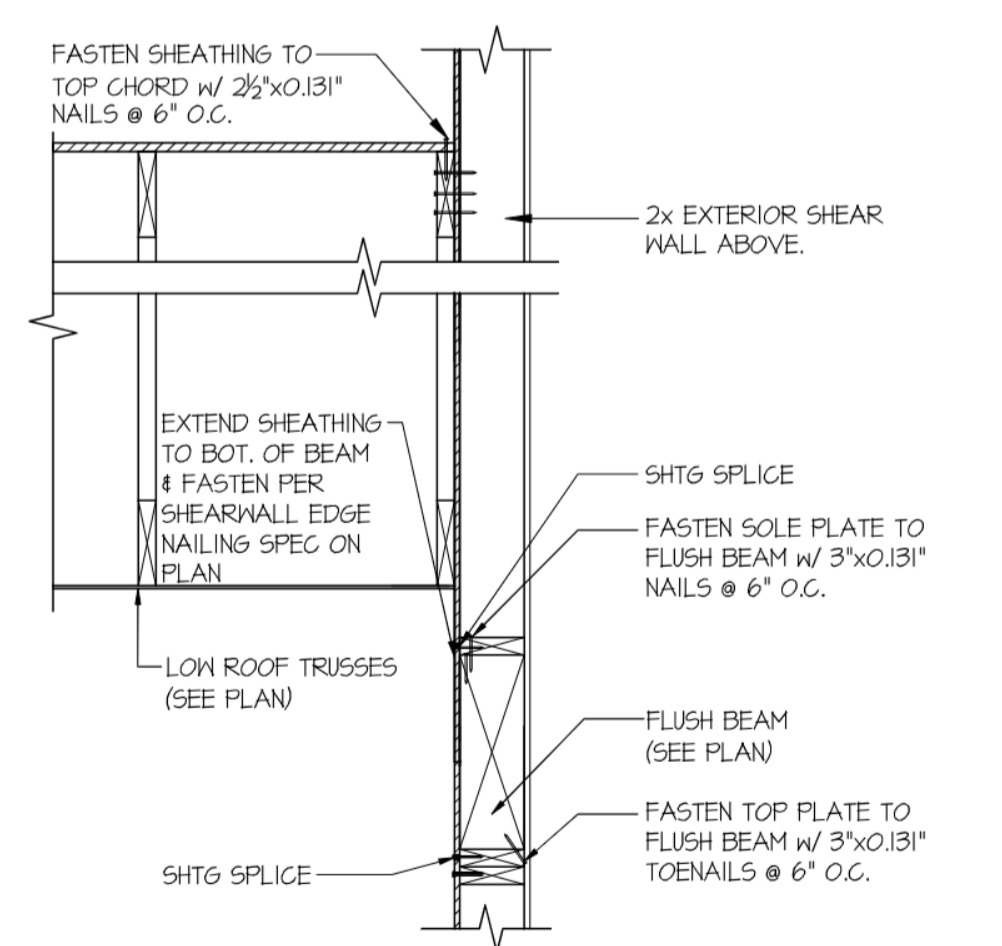

45 TYPICAL SHEAR TRANSFER DETAIL @ EXTERIOR WALL ABOVE FLUSH WIND BEAM
SCALE: 3/4"=1'-0"



MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Brookside Ave. Building 4 - Ambler, PA 19002
p. 215-646-8001 • mulhernkulp.com



M&K project number:
154-23001

project mgr: RJC
drawn by: AJC
issue date: 5-05-23


REVISIONS:
date: initial:




STRUCTURAL DETAILS
DUBEY RESIDENCE
8434 SE 39TH ST
MERCER ISLAND, WASHINGTON

sheet


LB-2

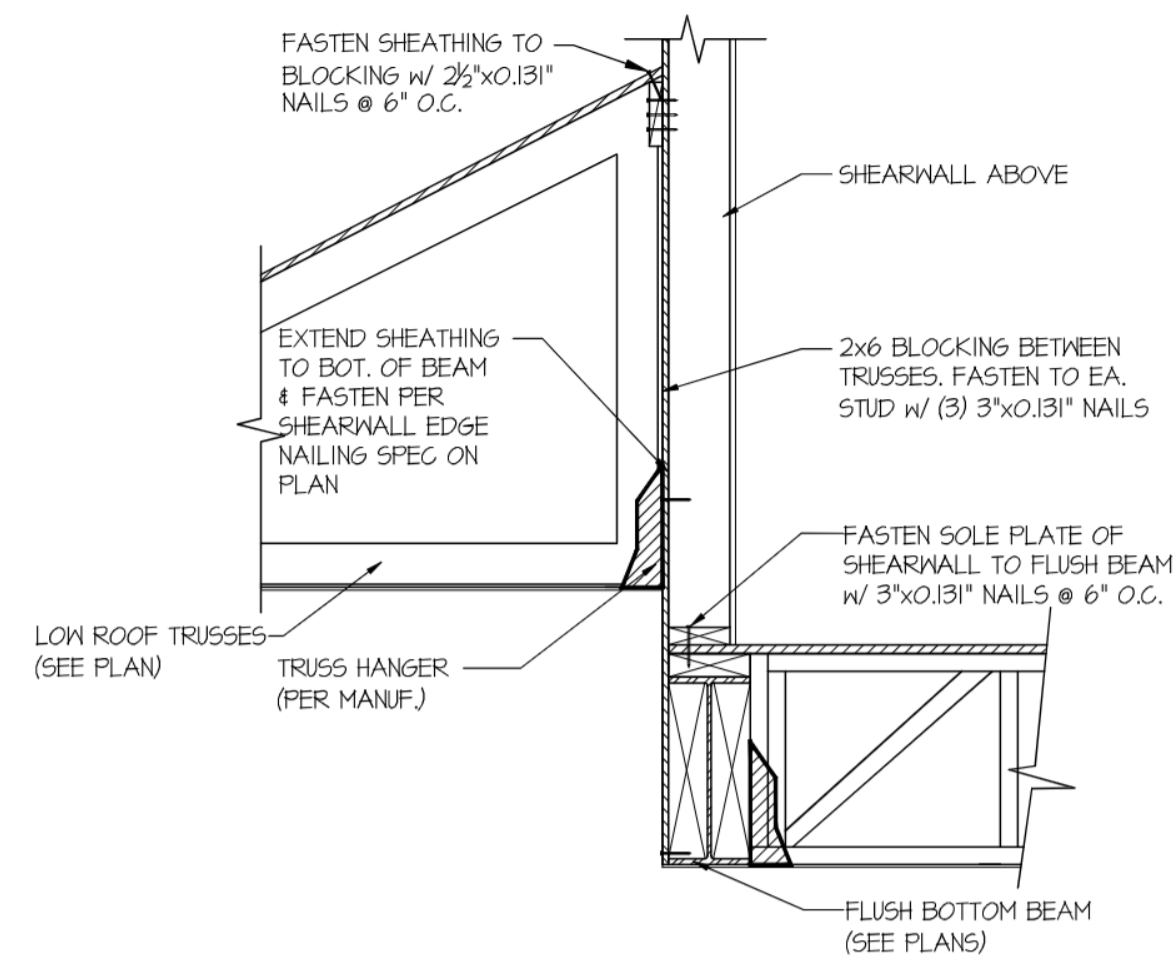


48 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

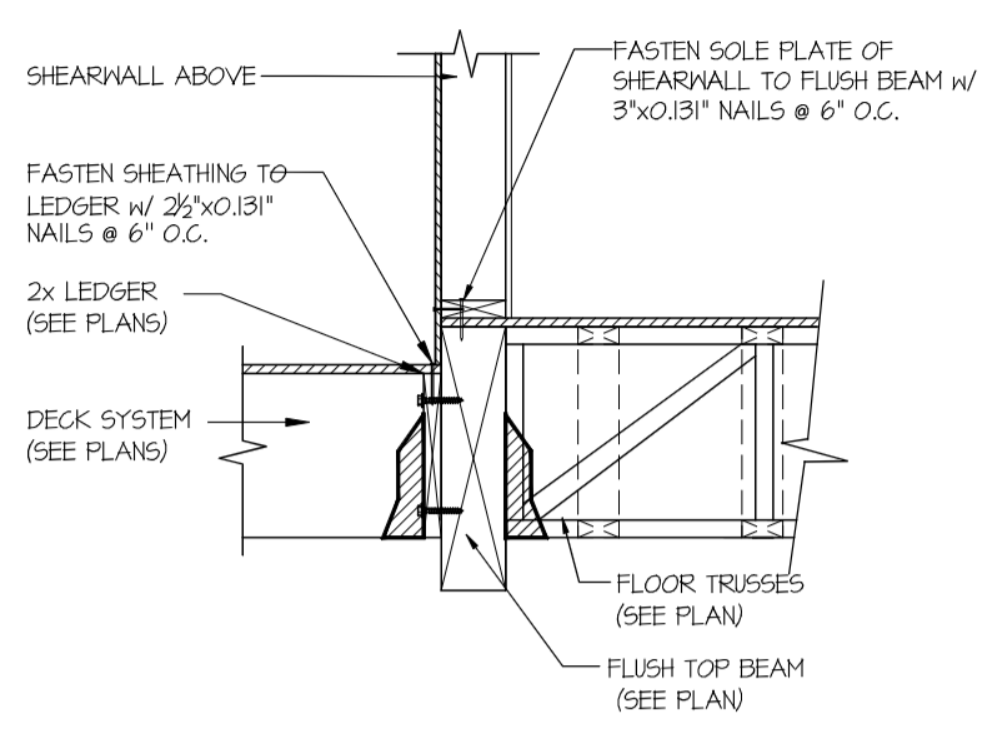


55 SECTION
SCALE: 3/4"=1'-0"

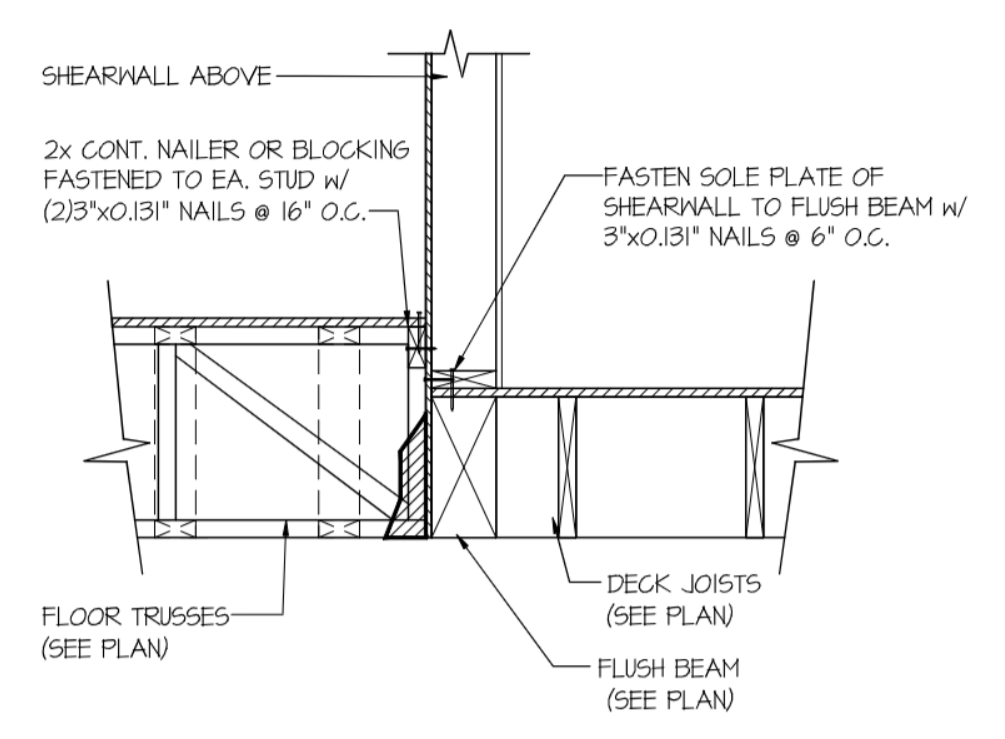


56 SECTION
SCALE: 3/4"=1'-0"

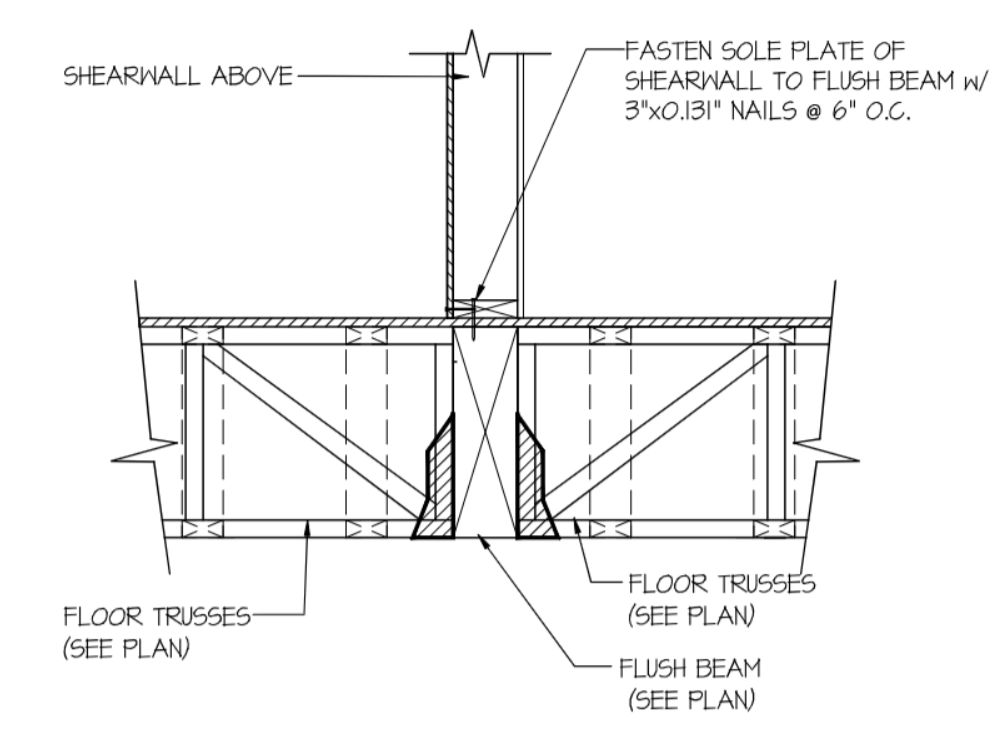


57 SECTION
SCALE: 3/4"=1'-0"

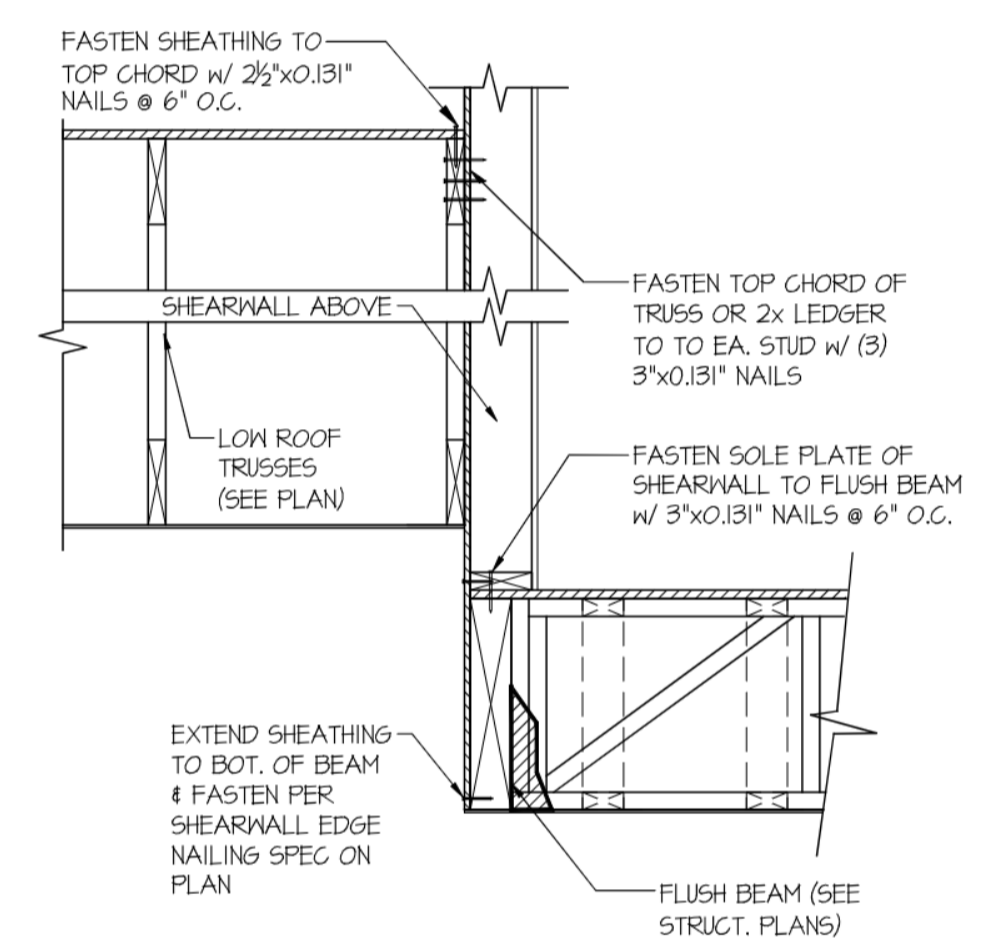


59 SHEAR TRANSFER DETAIL @ EXTERIOR SHEARWALL ABOVE
SCALE: 3/4"=1'-0"

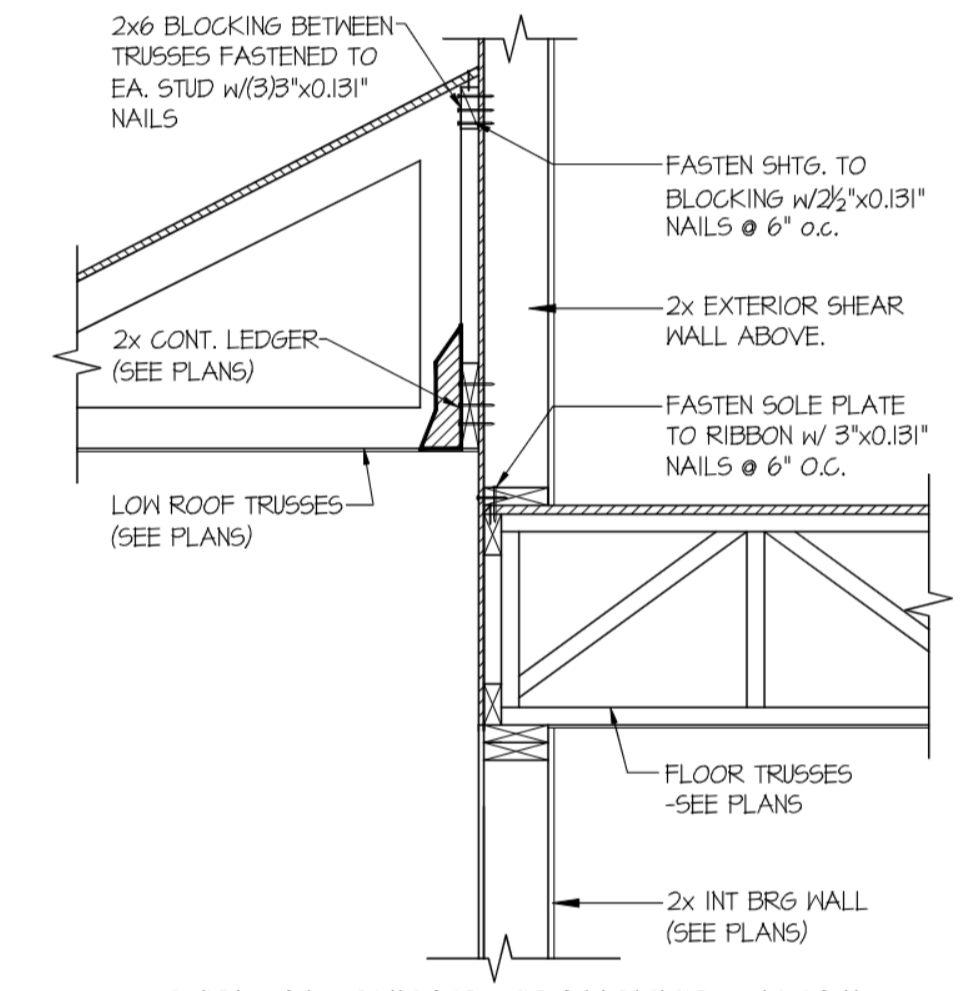


60 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS
SCALE: 3/4"=1'-0" PERPENDICULAR FRAMING

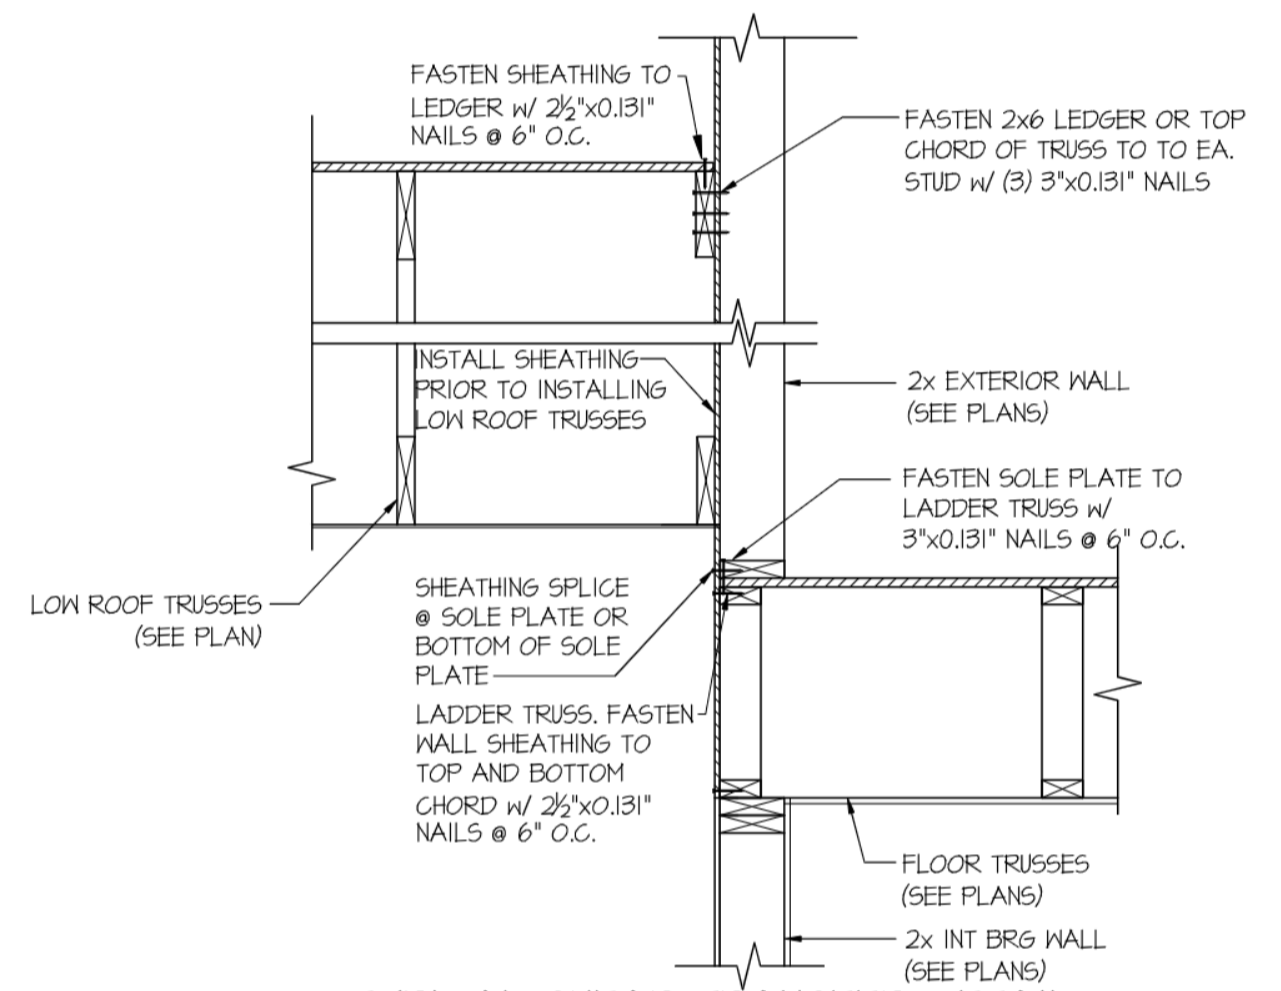


62 TYPICAL SHEAR TRANSFER DETAIL BETWEEN FLOORS @ INTERIOR WALL
SCALE: 3/4"=1'-0"

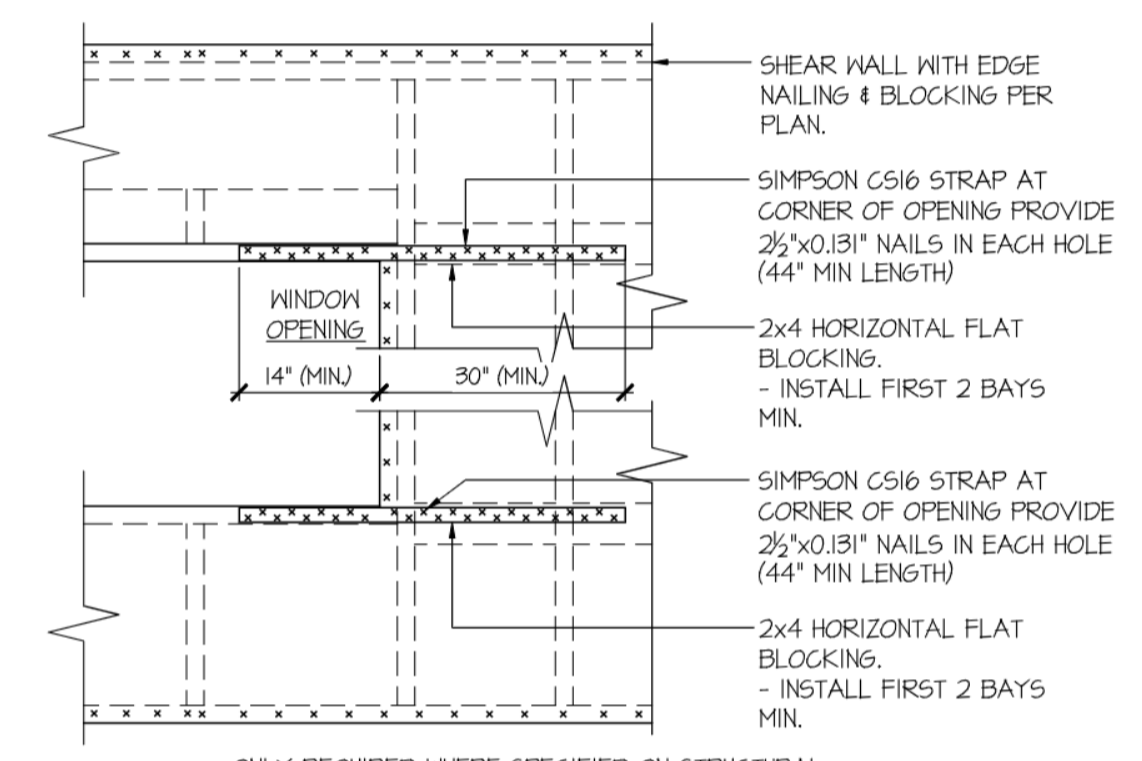

94 EXT. WALL & INT. SHEARWALL OPENING ELEVATION
SCALE: NTS

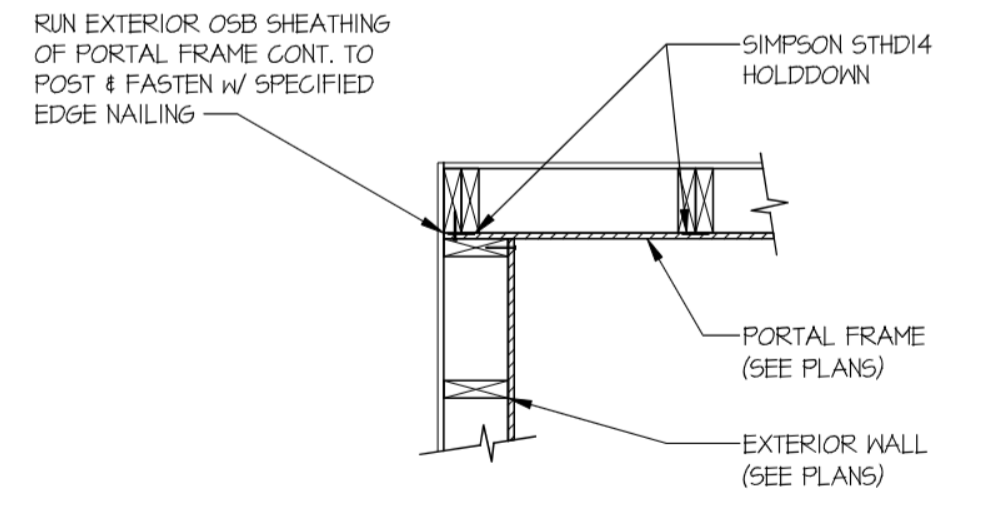

99 SHEAR TRANSFER DETAIL @ INTERSECTING INT. SHEARWALL
SCALE: 3/4"=1'-0" SHTG. OPPOSITE FACES

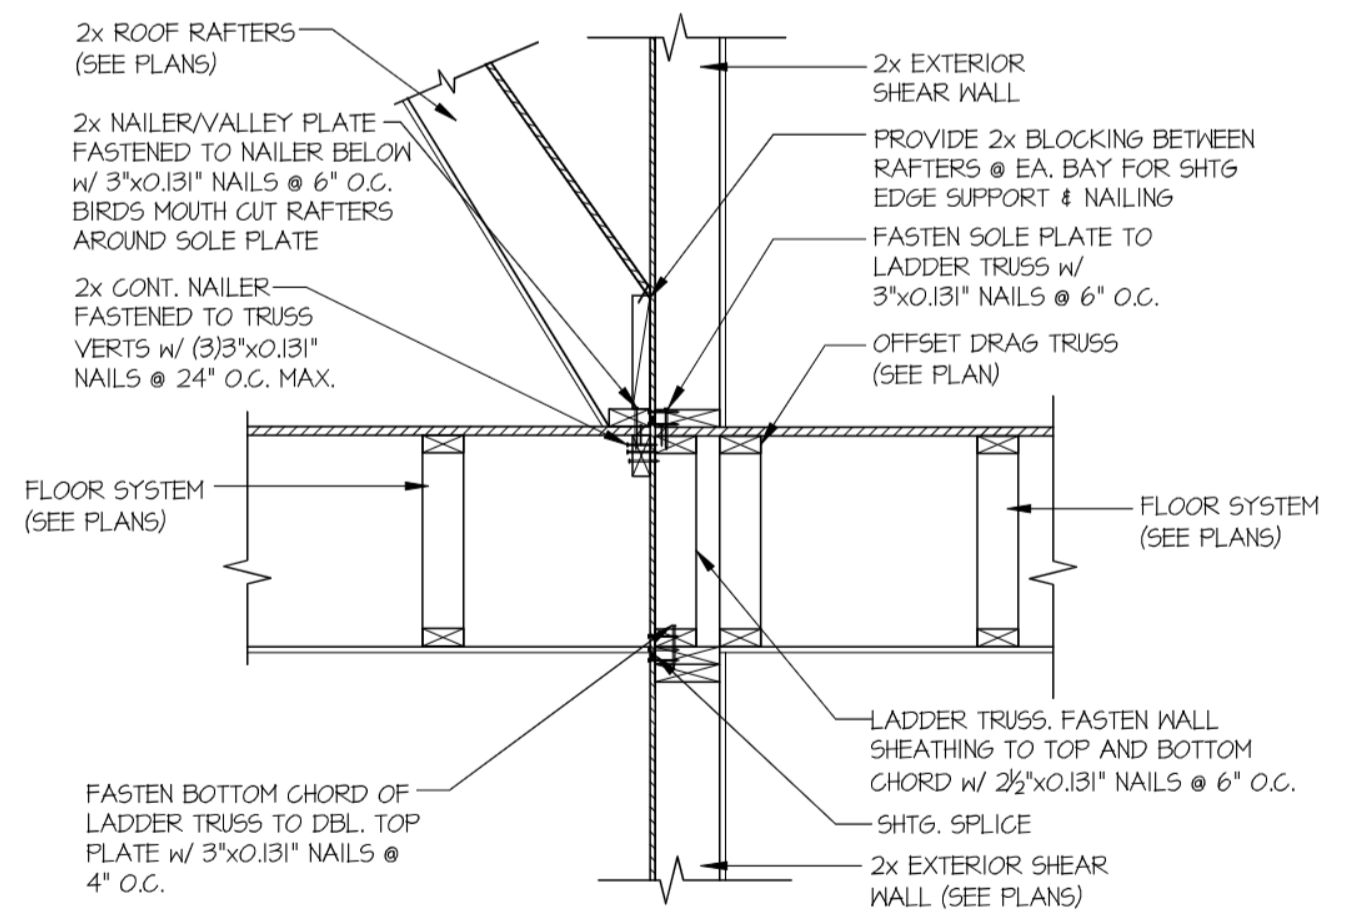

100 SECTION
SCALE: 3/4"=1'-0"



MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Brookside Ave. Building 4 • Ambler, PA 19002
p. 215-646-8001 • mulhernkulp.com

M&K project number:
154-23001




project mgr: **RJZ**
drawn by: **AJC**
issue date: **5-05-23**

REVISIONS:
date: _____ initial: _____




STRUCTURAL DETAILS
DUBEY RESIDENCE
8434 SE 39TH ST
MERCER ISLAND, WASHINGTON




sheet:
LB-3

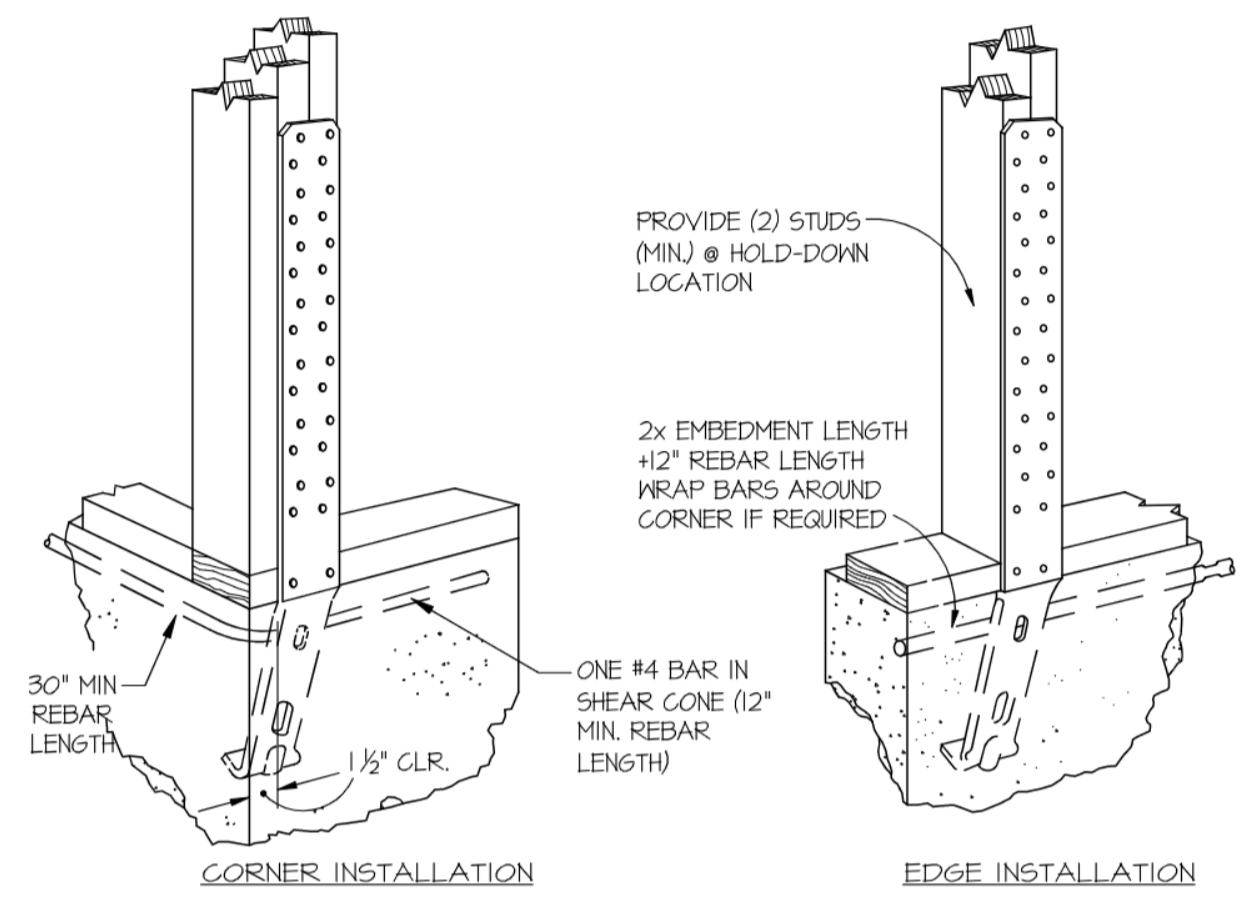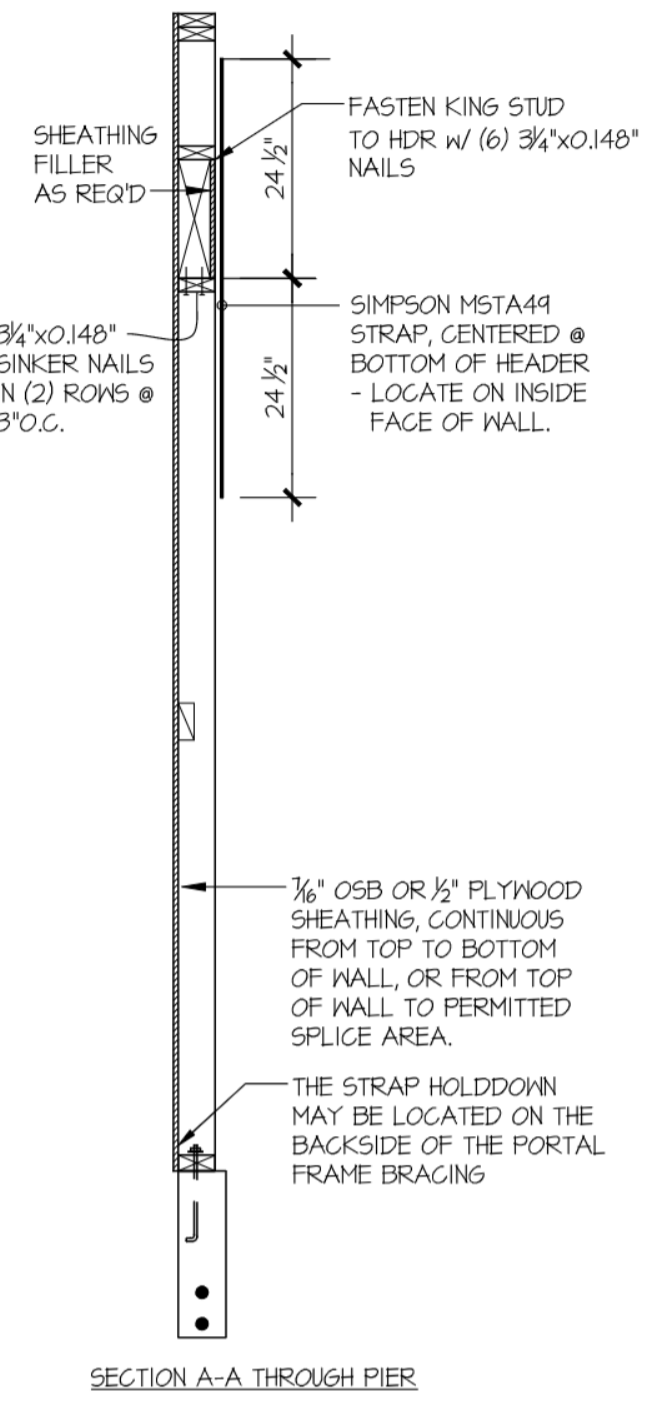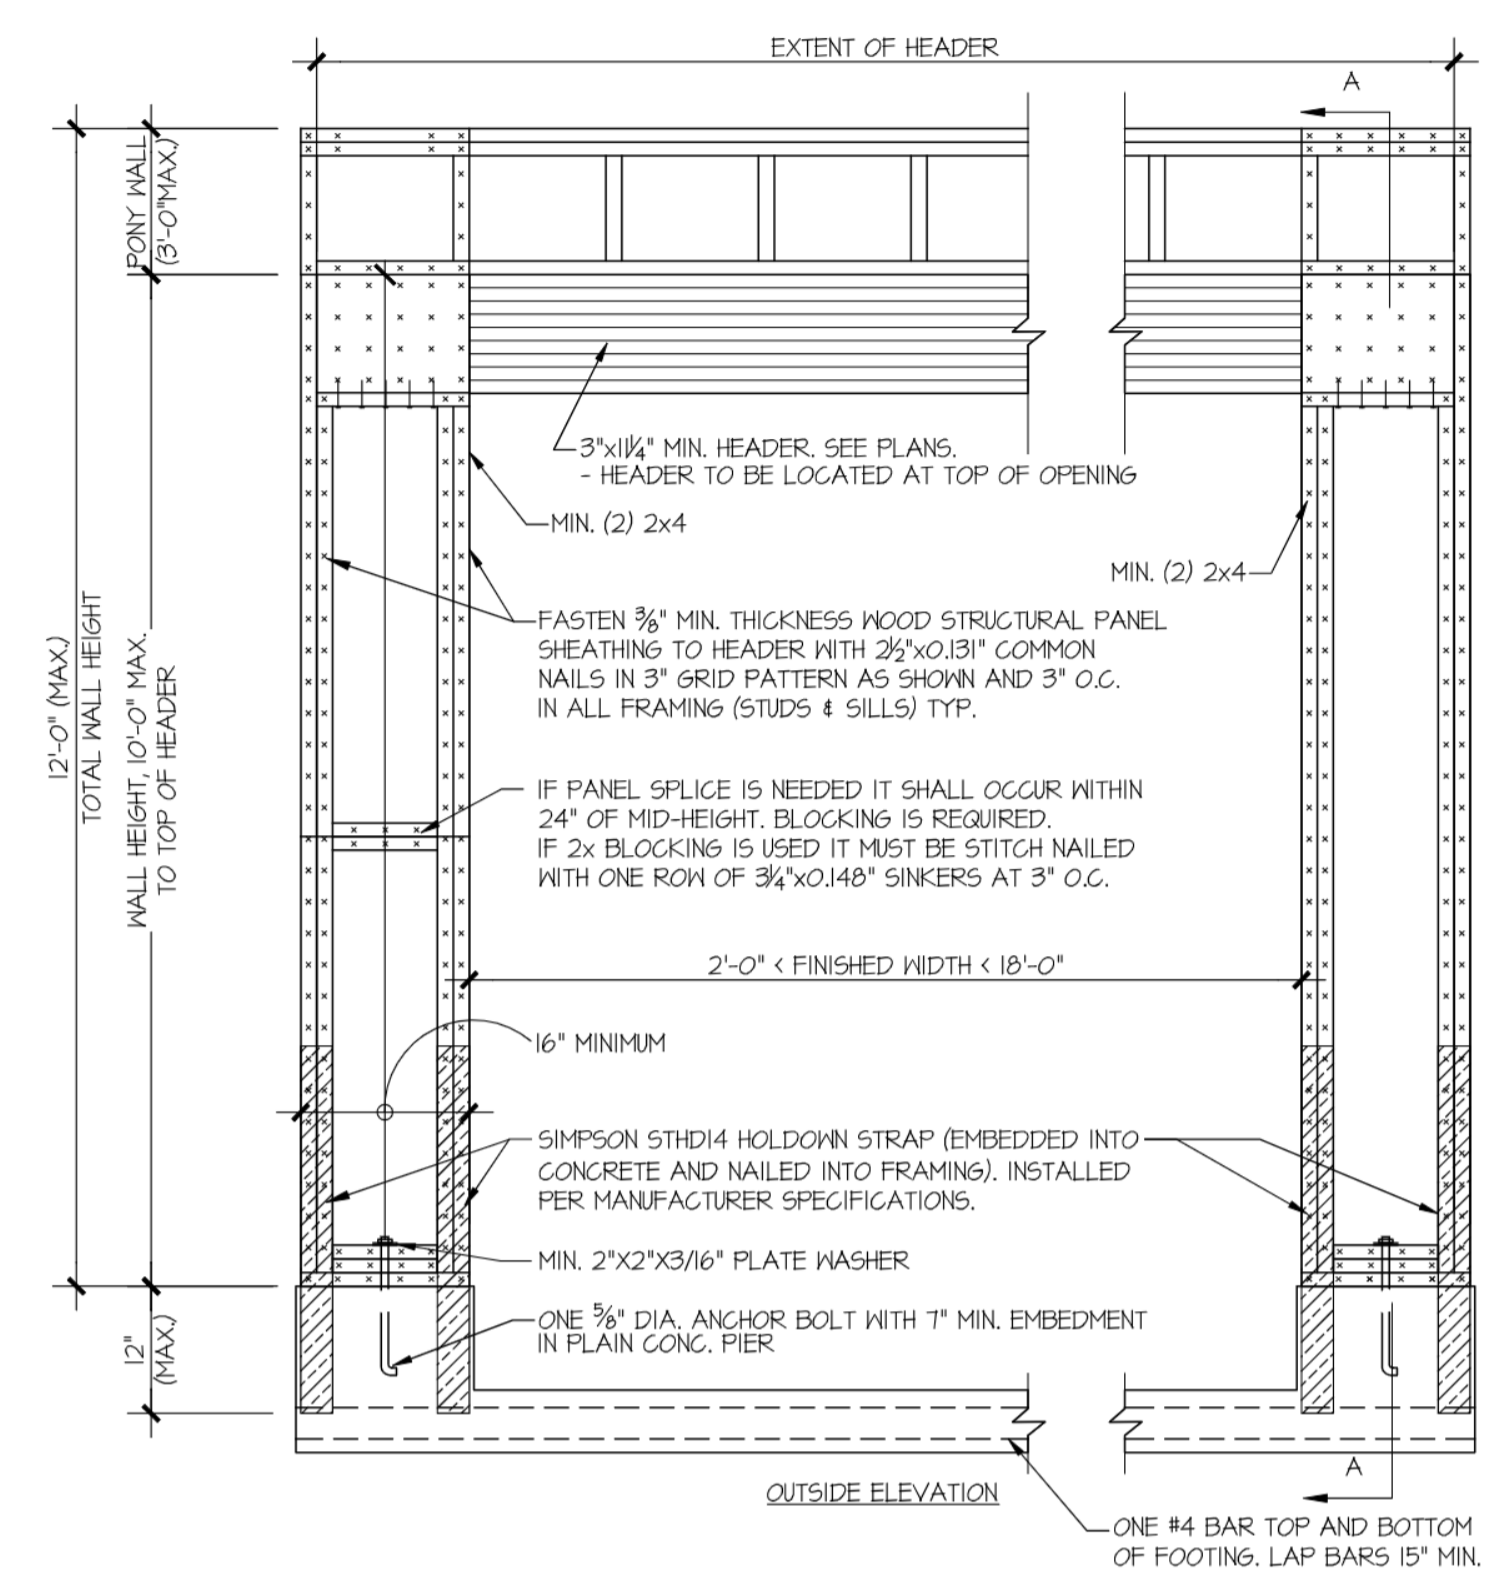


A TYPICAL HOLD-DOWN INSTALLATION
NOT TO SCALE
SIMPSON 5THD HD @ FOUNDATION

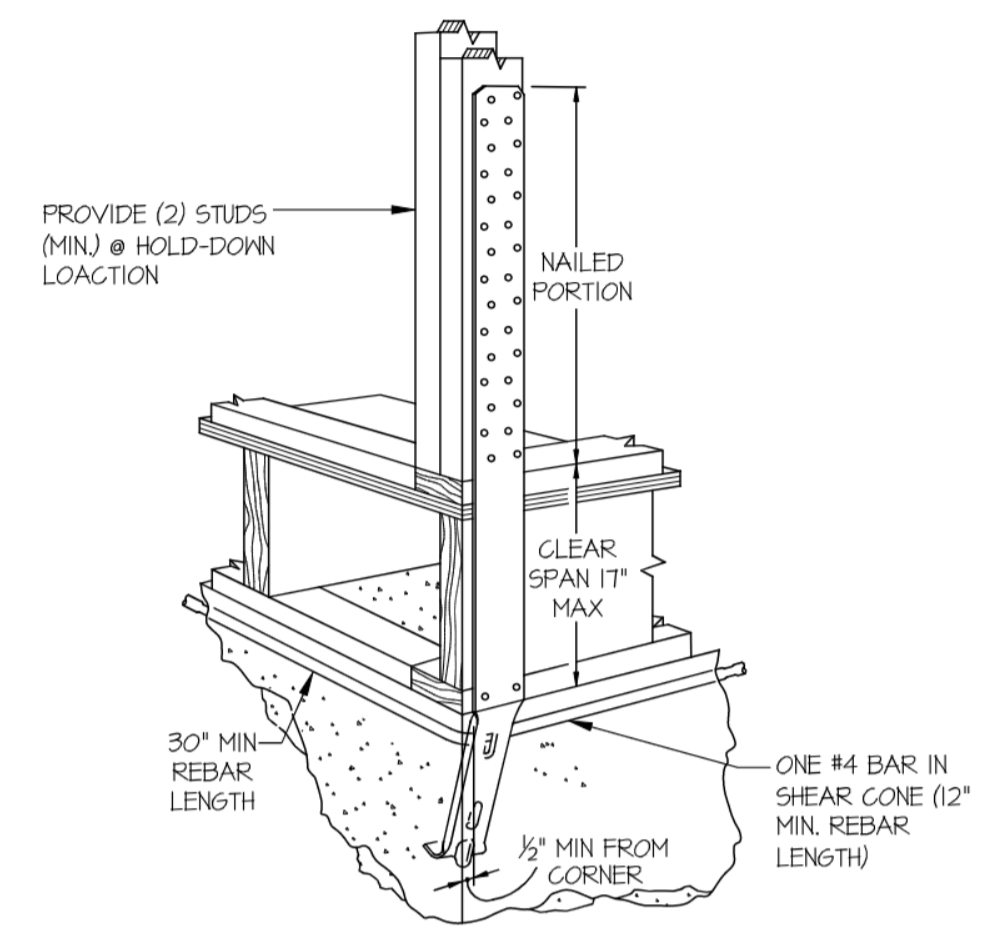

B TYPICAL HOLD-DOWN INSTALLATION
NOT TO SCALE
SIMPSON 5THD HD @ FLOOR FRAMING

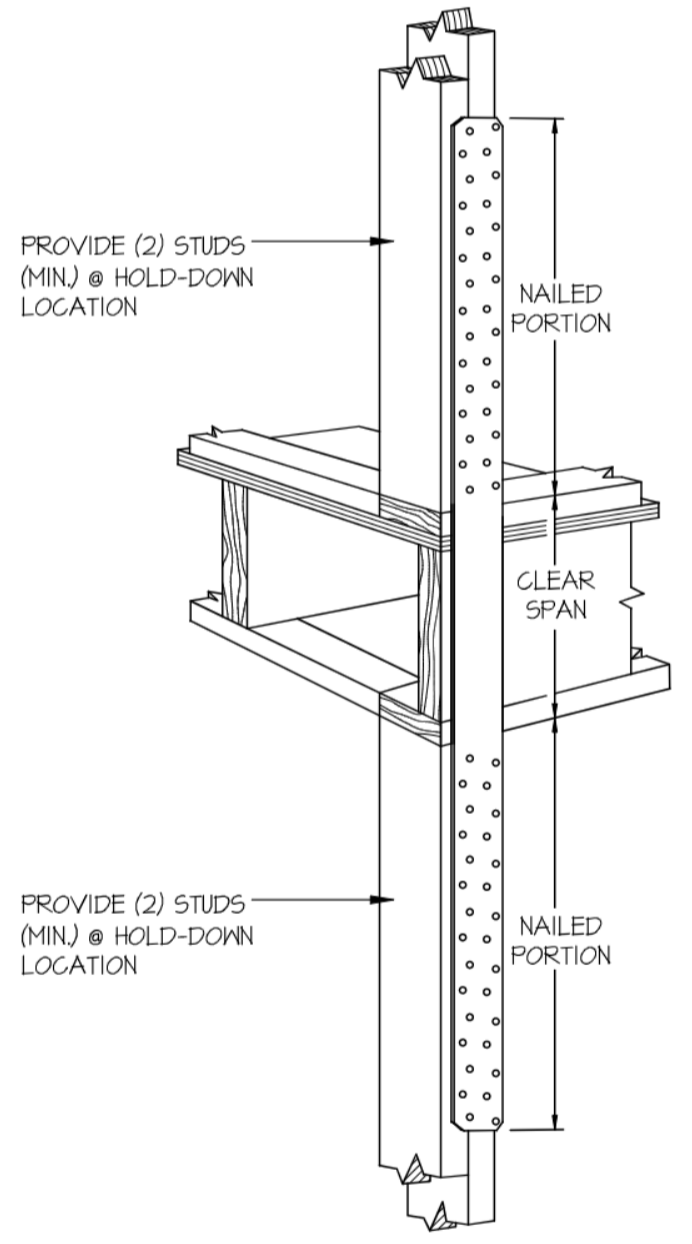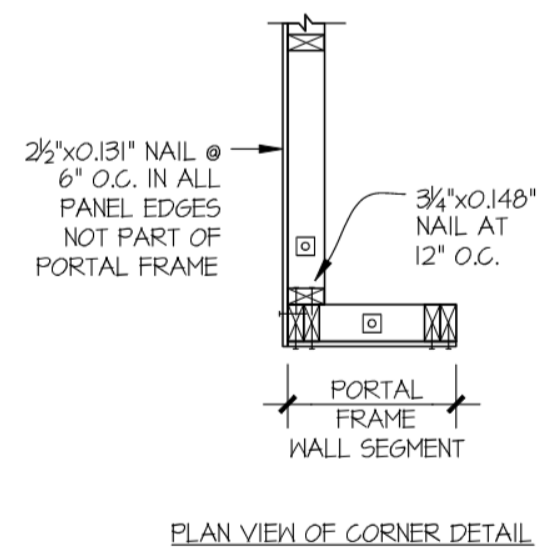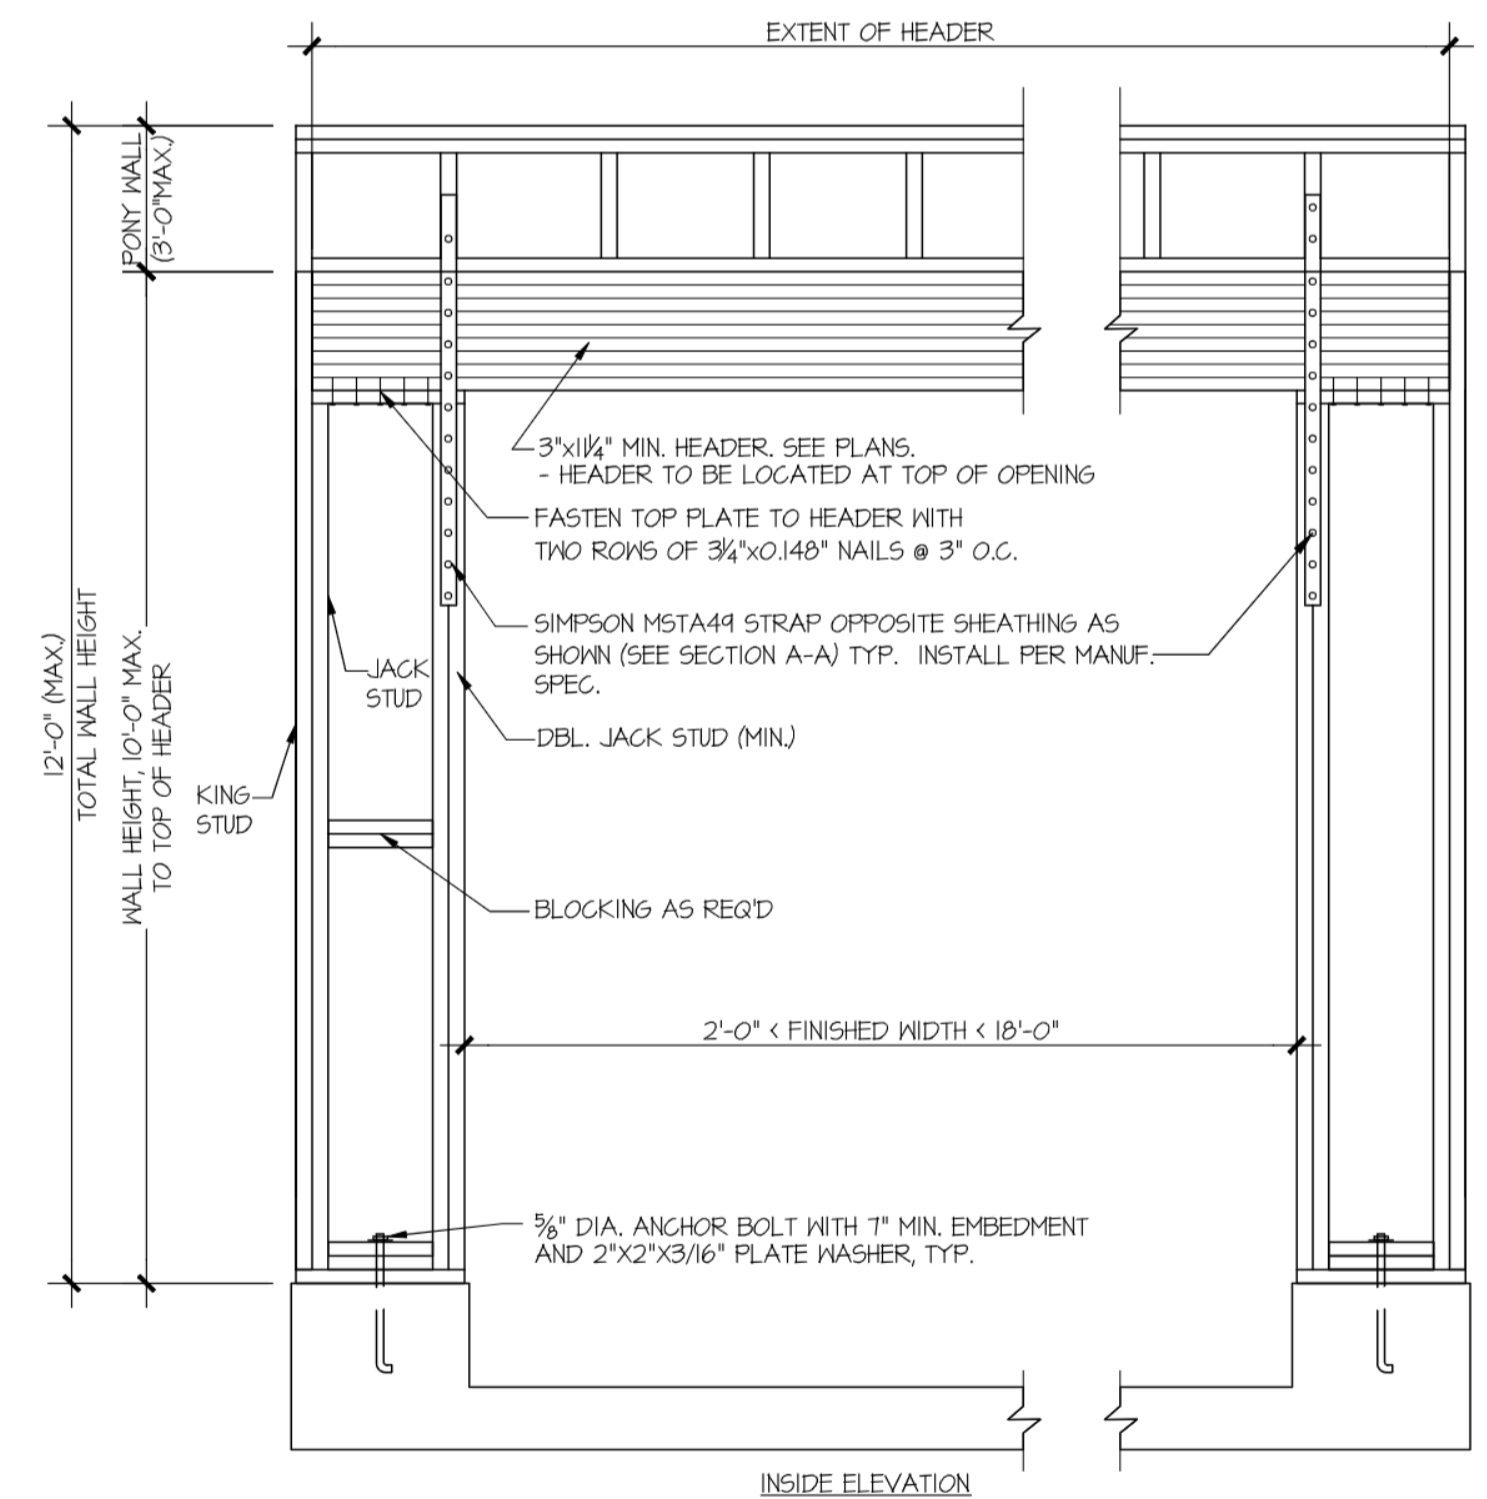


C TYPICAL HOLD-DOWN INSTALLATION
NOT TO SCALE
SIMPSON STRAP HD @ FLOOR FRAMING

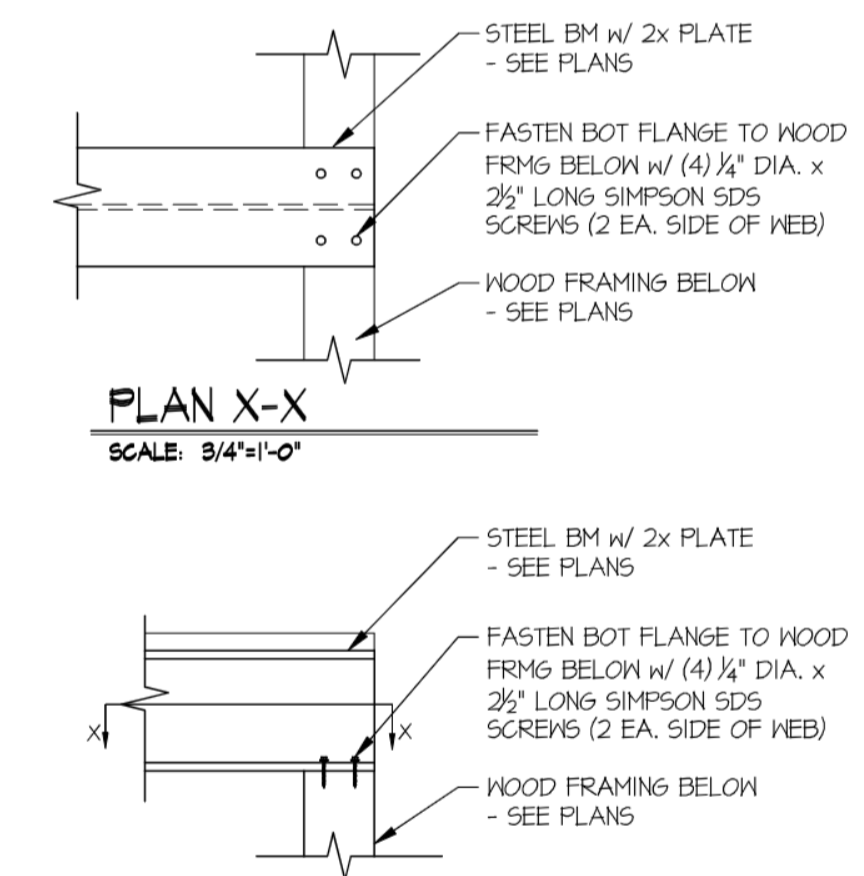

D STL BM TO WOOD FRMG CONNECTION
SCALE: 3/4"=1'-0"

APA PORTAL FRAME DETAIL WITH HOLDDOWNS
SCALE: N.T.S.

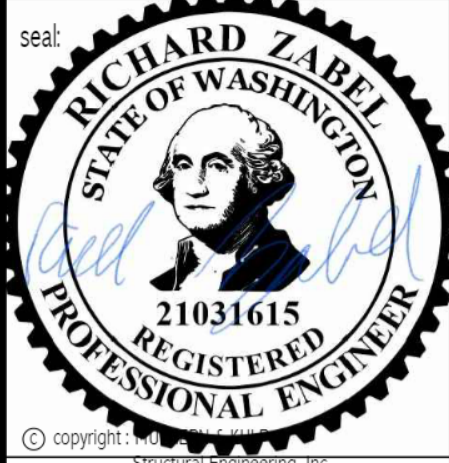

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Brookside Ave. Building 4 • Ambler, PA 19002
p 215-646-8001 • mulhernkulp.com




M&K project number:
154-23001
project mgr: **RJZ**
drawn by: **AJC**
issue date: **5-05-23**
REVISIONS:
date: initial




STRUCTURAL DETAILS
DUBEY RESIDENCE
8434 SE 39TH ST
MERCER ISLAND, WASHINGTON

sheet:


SD.01

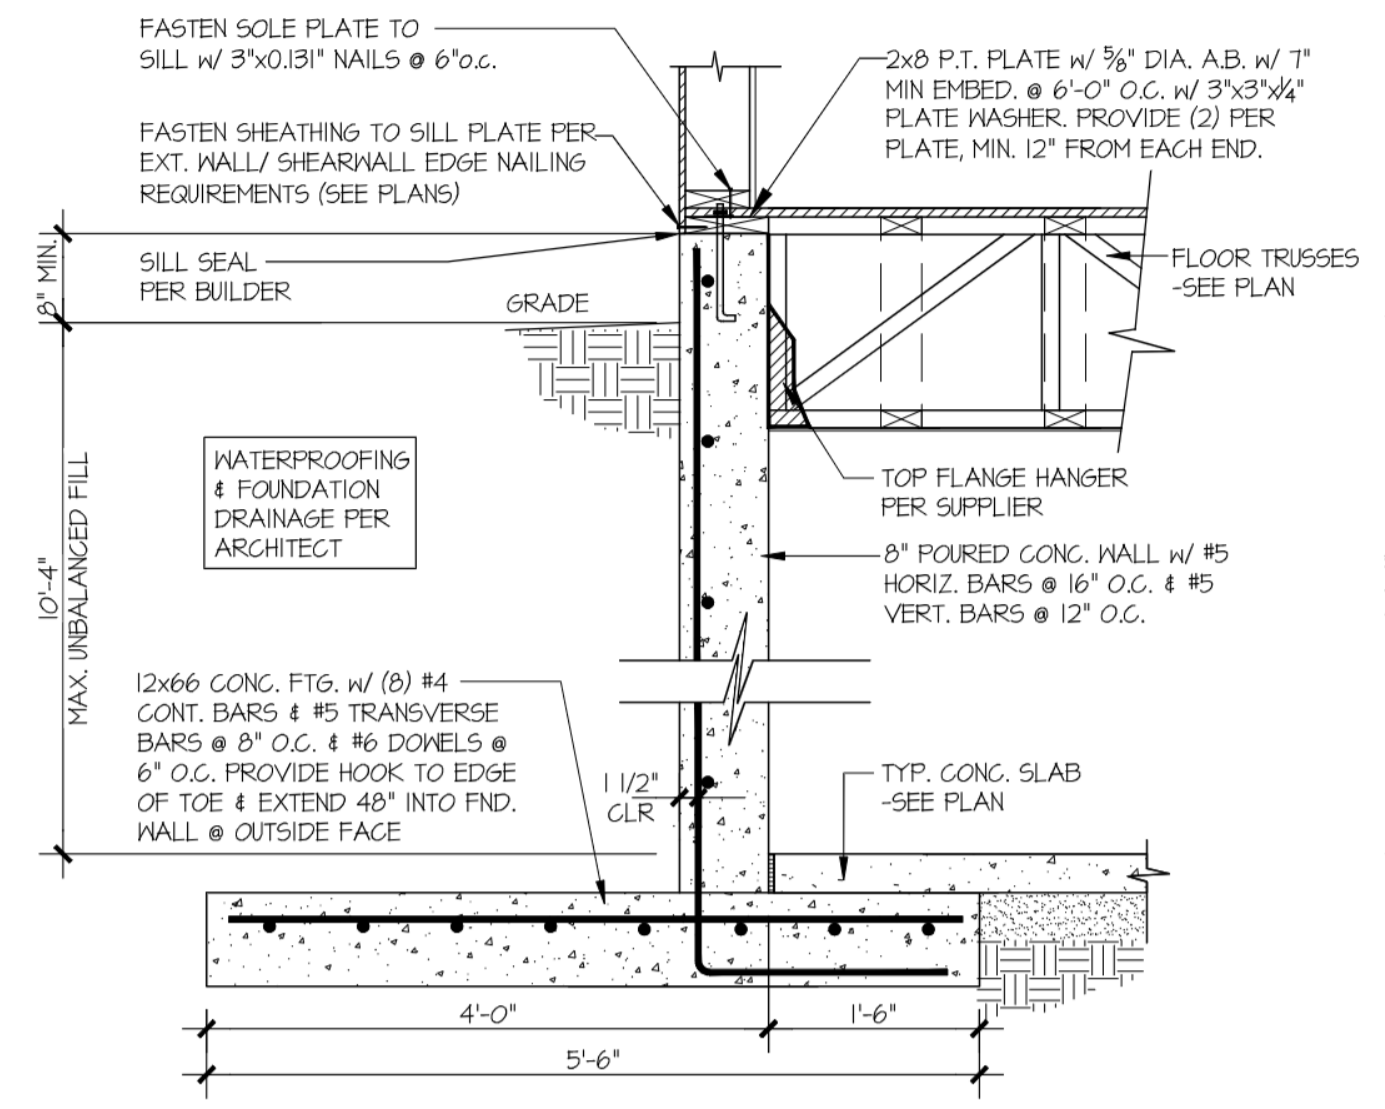


1 TYPICAL BASEMENT WALL @ GRADE
SCALE: 3/4"=1'-0"

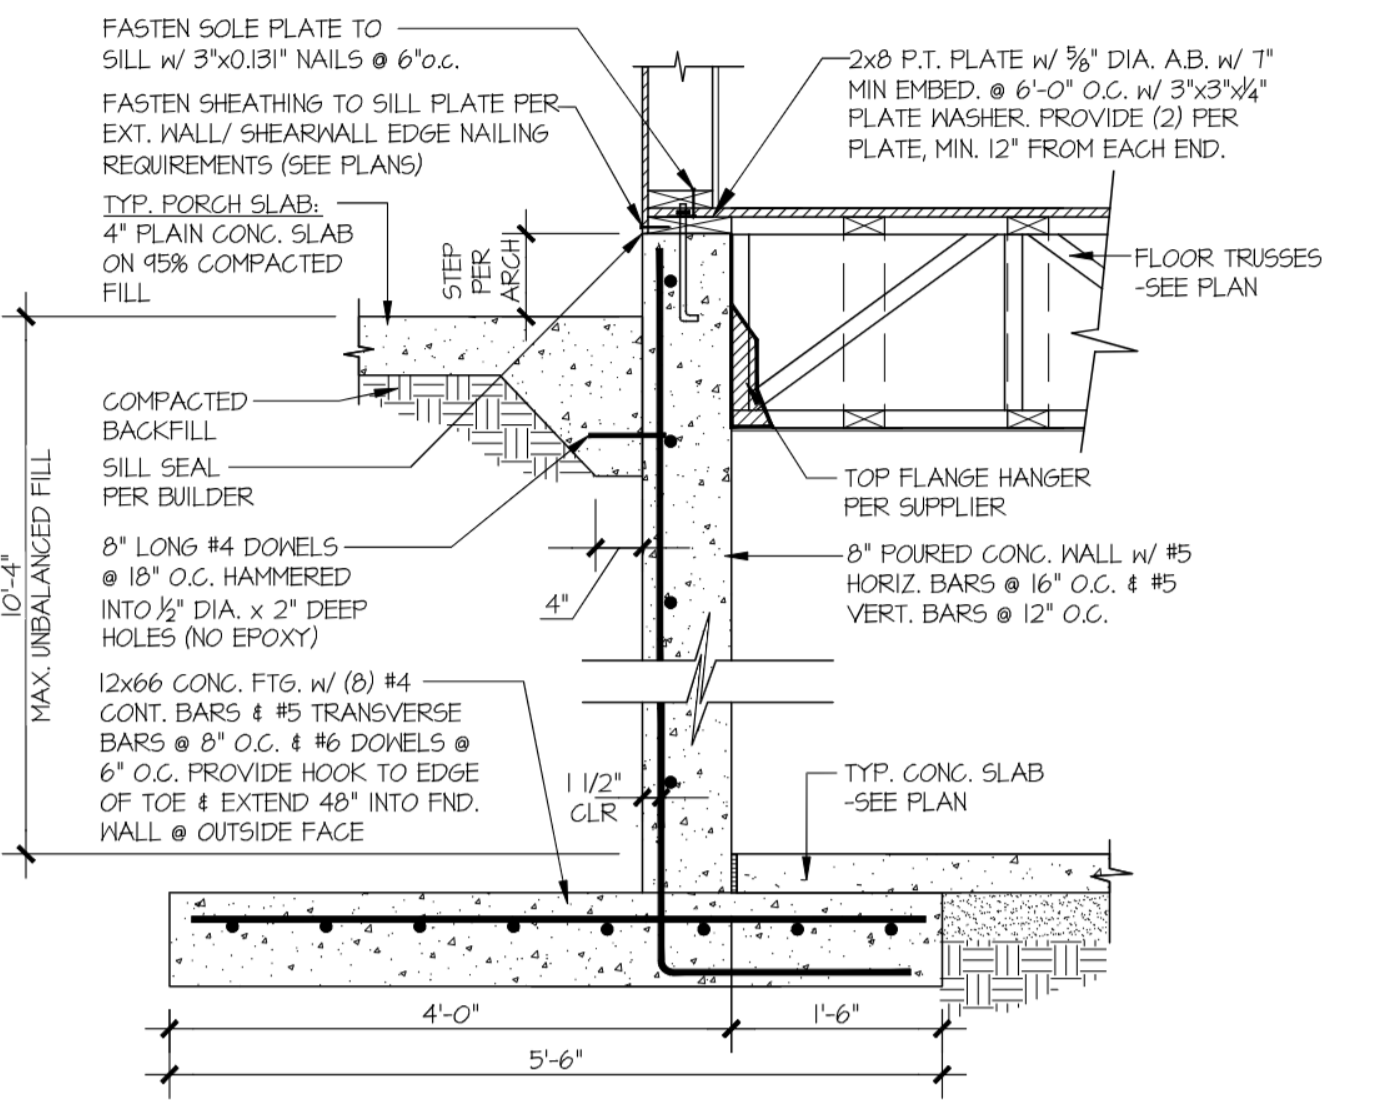


2 TYPICAL BASEMENT WALL @ PORCH
SCALE: 3/4"=1'-0"

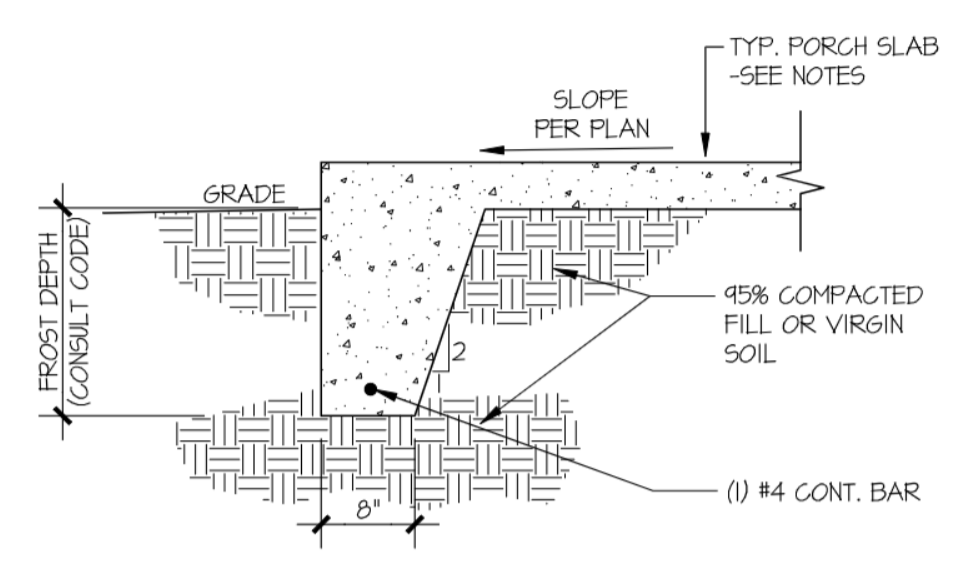


3 TYPICAL FOOTING @ PORCH SLAB
SCALE: 3/4"=1'-0"

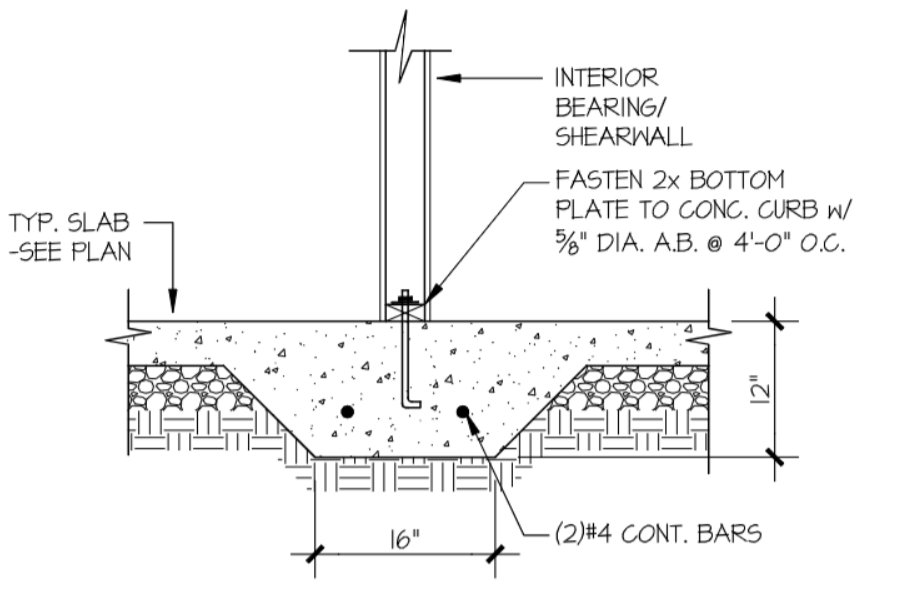


4 TYPICAL THICKENED SLAB @ INTERIOR BEARING WALL
SCALE: 3/4"=1'-0"

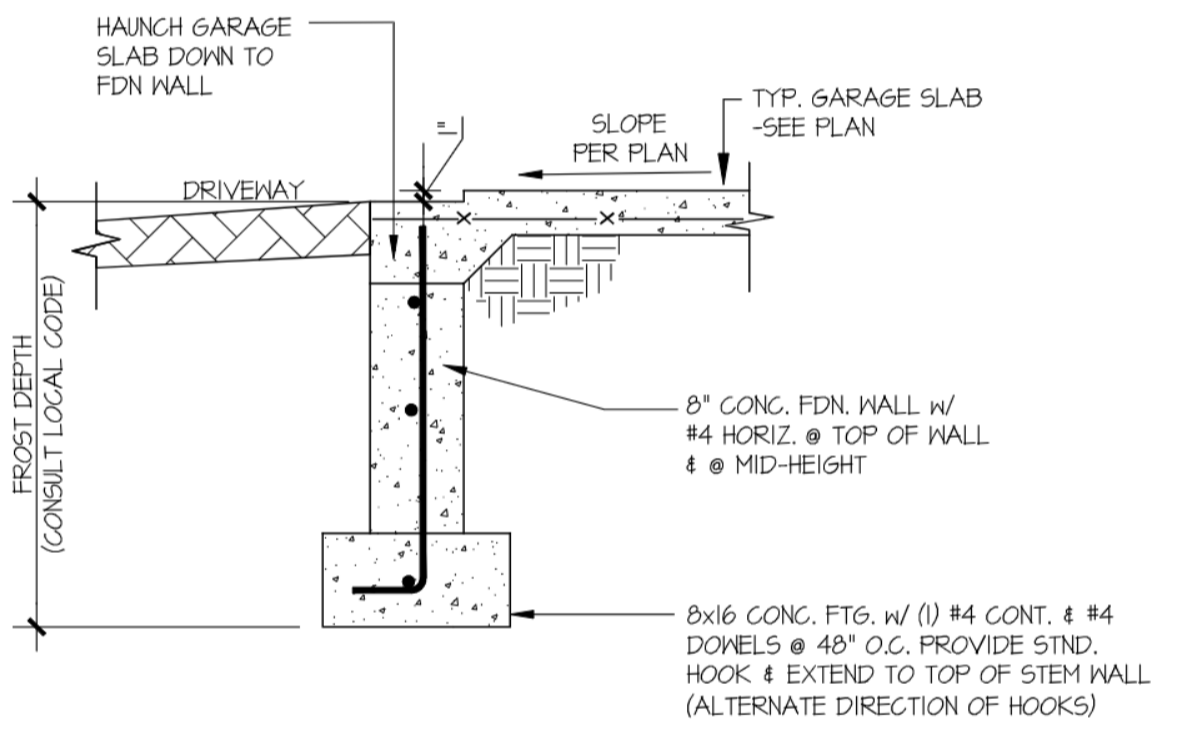


5 TYPICAL CONCRETE FOOTING @ GARAGE DOOR OPENING
SCALE: 3/4"=1'-0"

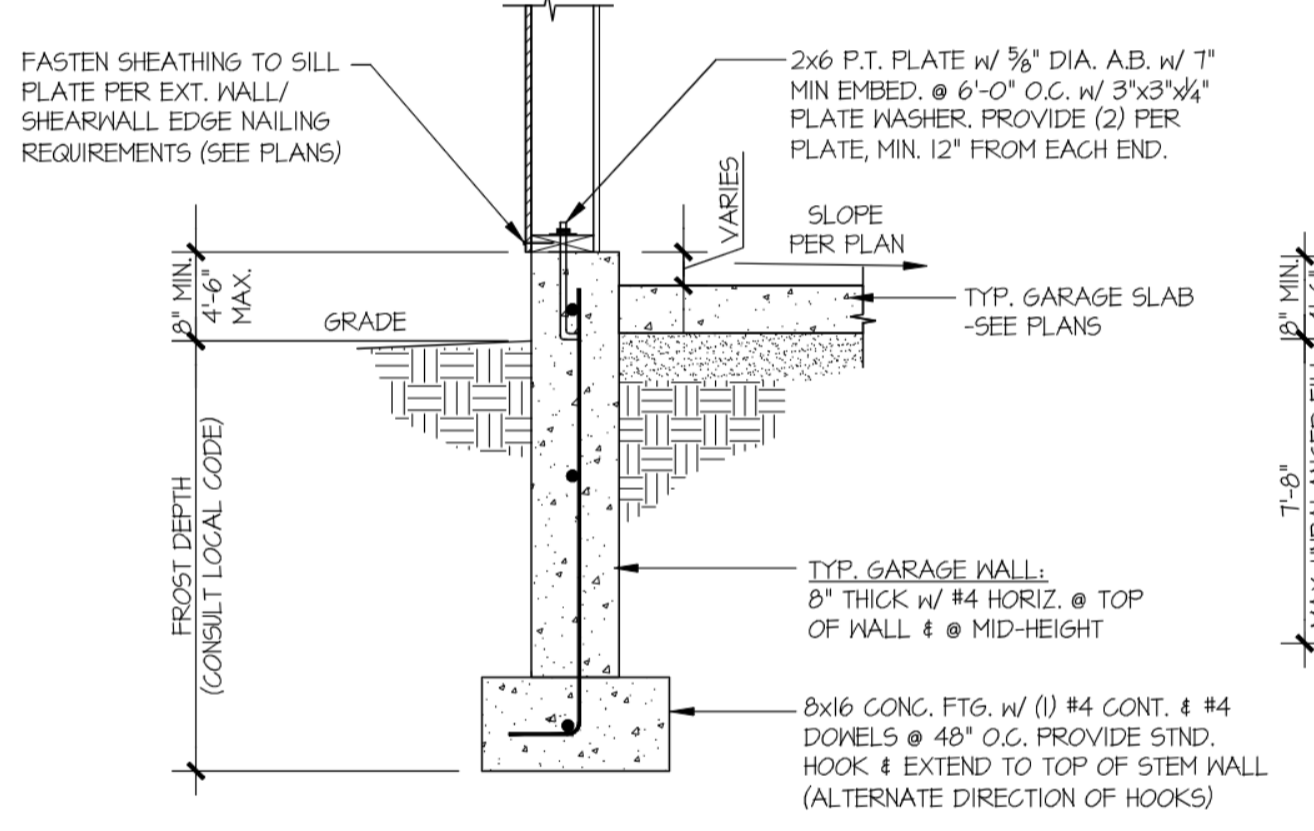


6 TYPICAL EXT. GARAGE FOUNDATION
SCALE: 3/4"=1'-0"

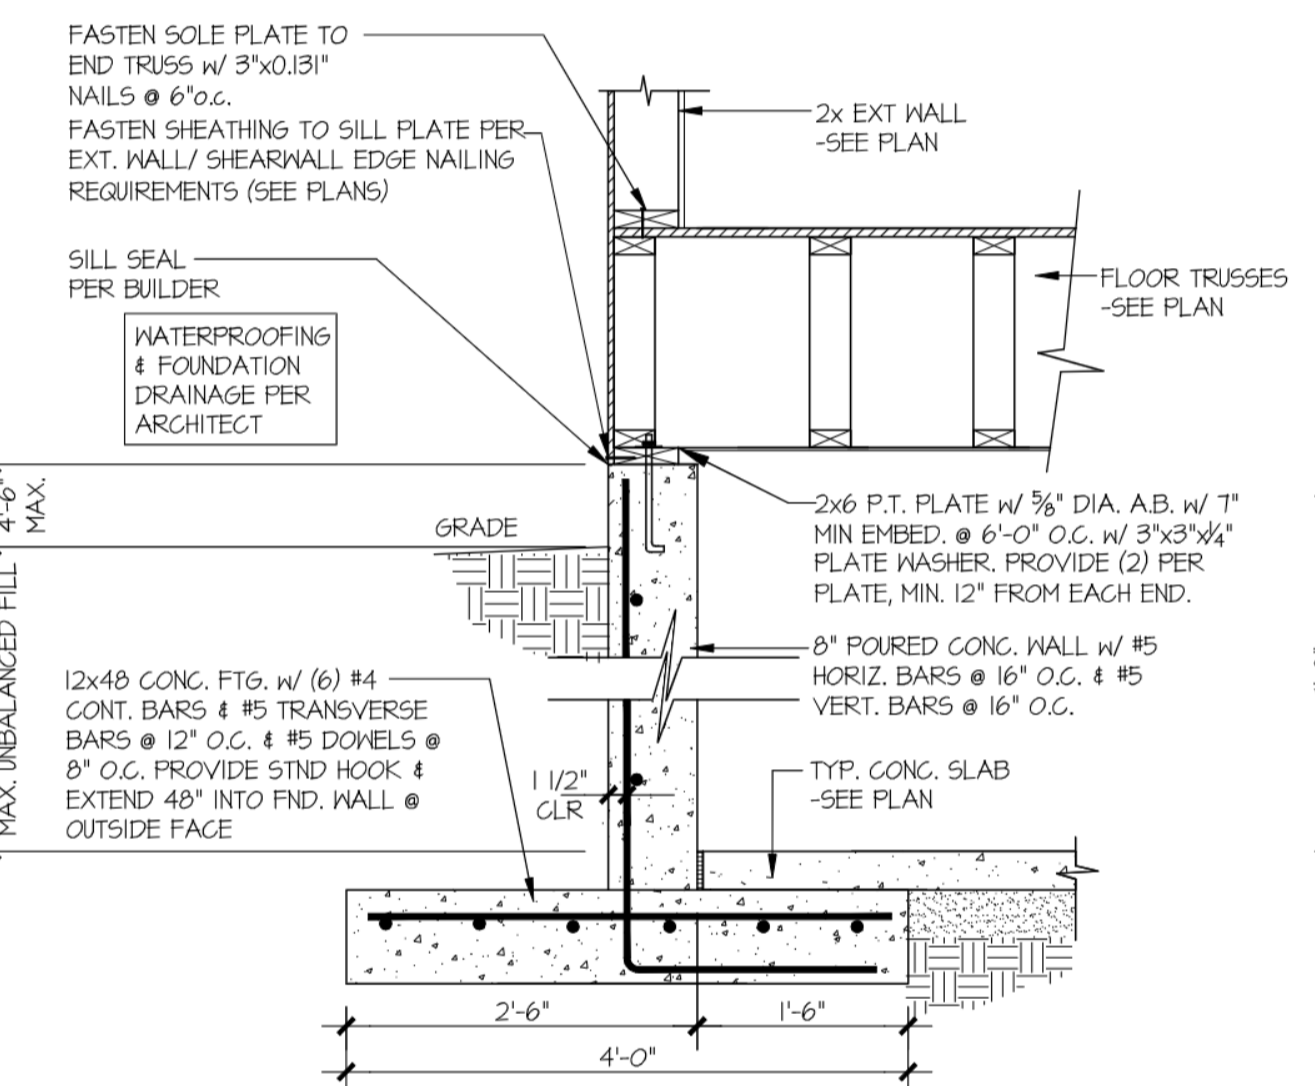


7 TYPICAL BASEMENT WALL @ DRIVEWAY
SCALE: 3/4"=1'-0"

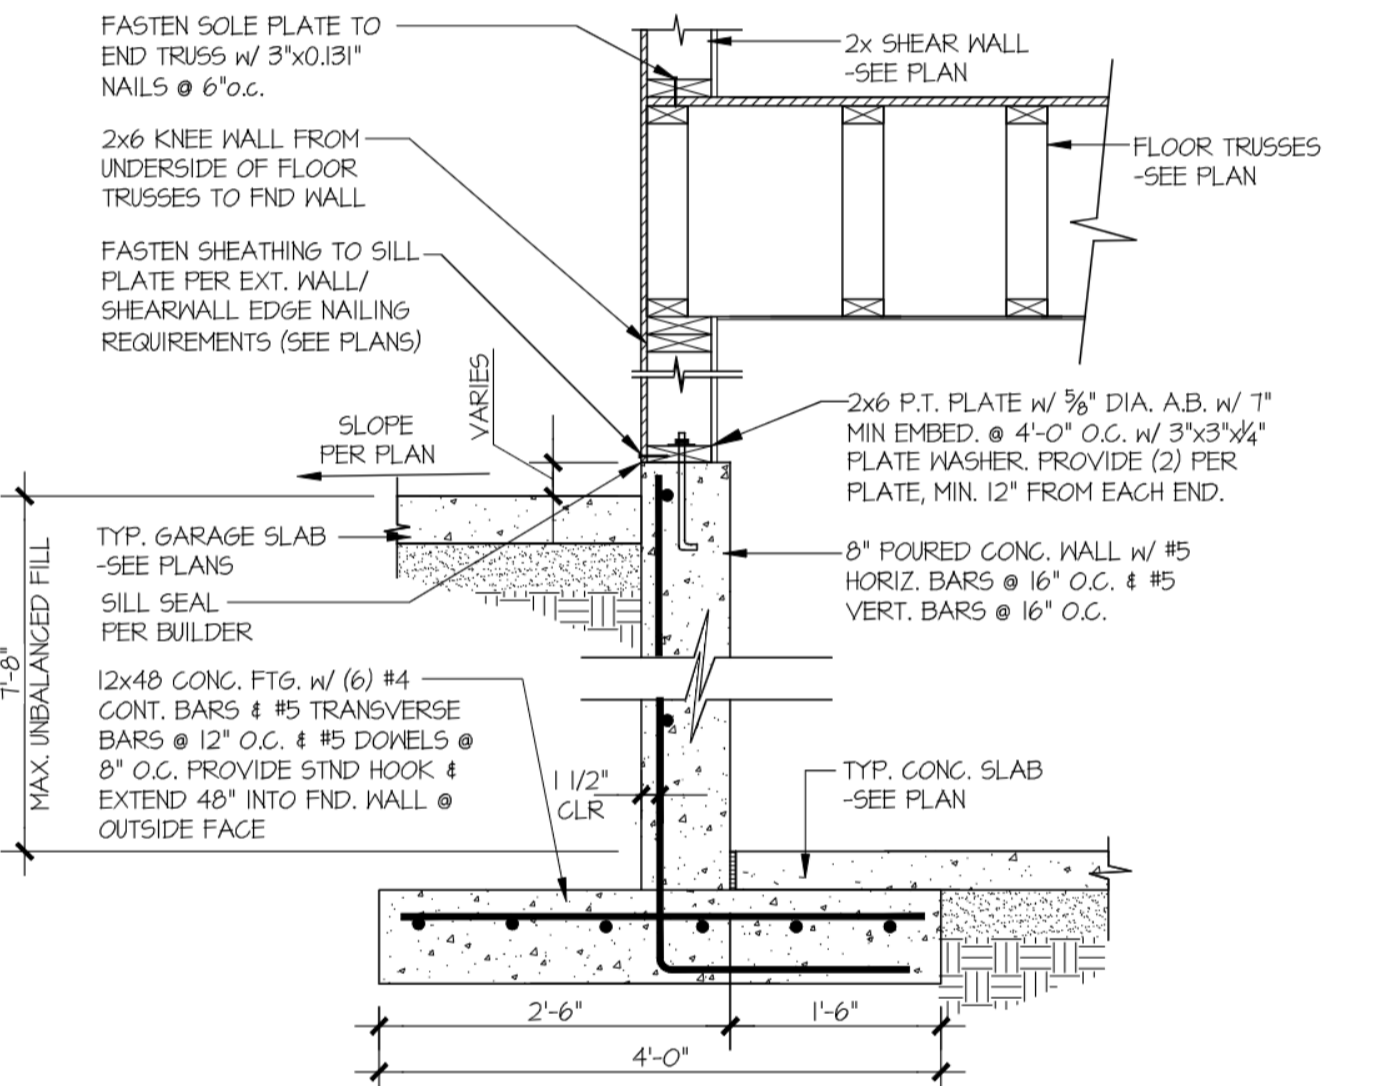


8 TYPICAL BASEMENT WALL @ GARAGE
SCALE: 3/4"=1'-0"

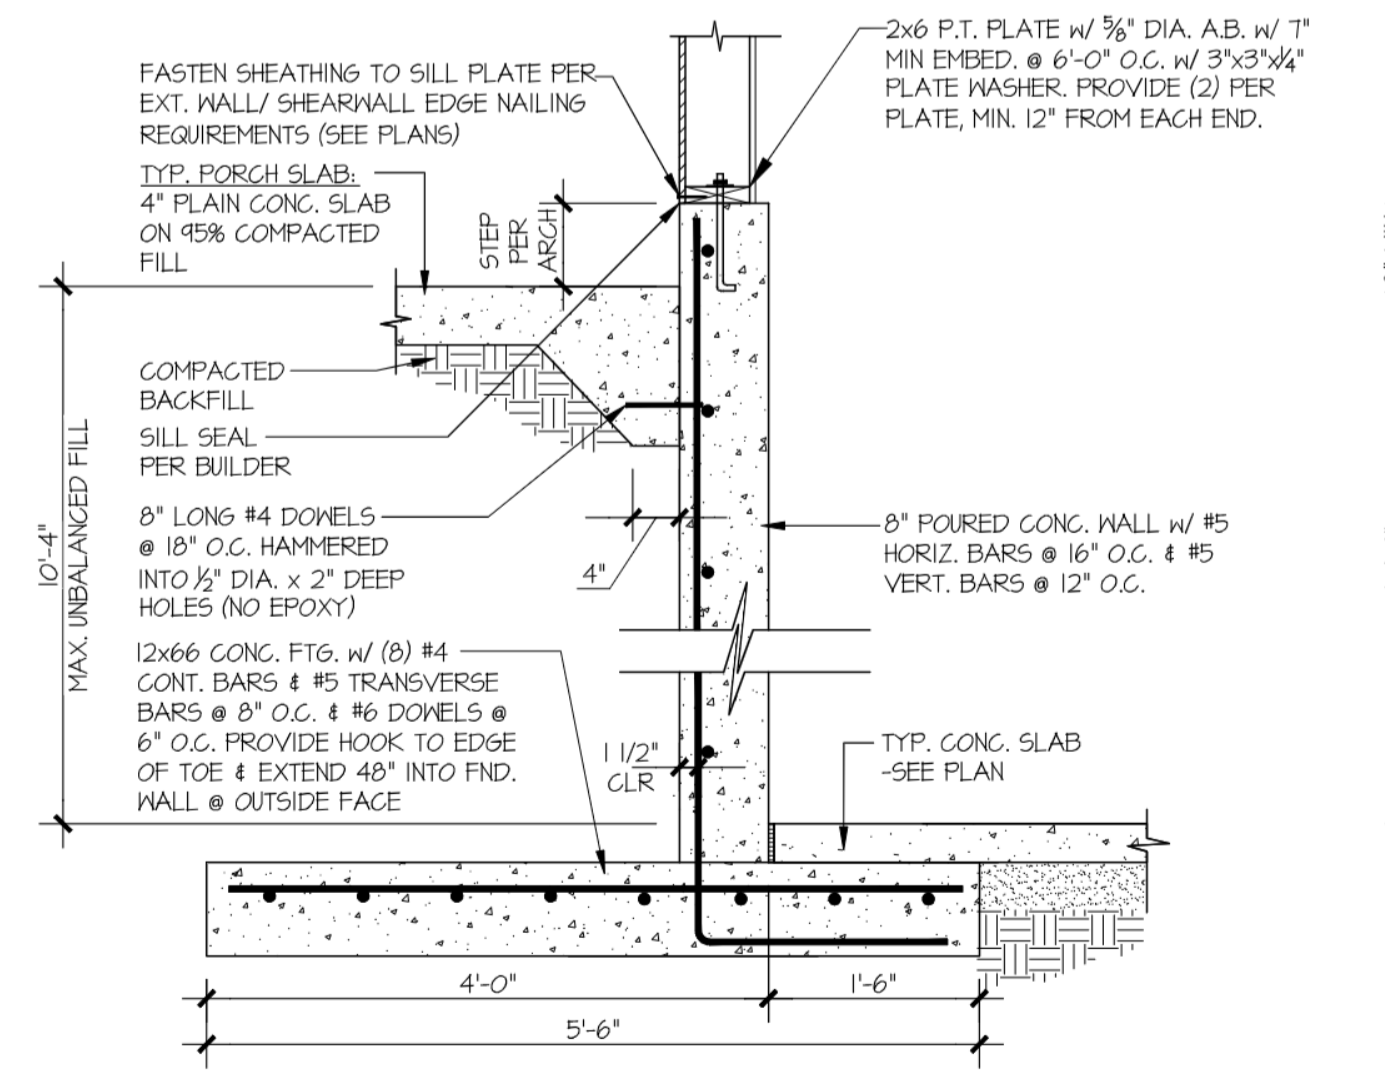


9 BASEMENT STAIR WALL @ PORCH
SCALE: 3/4"=1'-0"

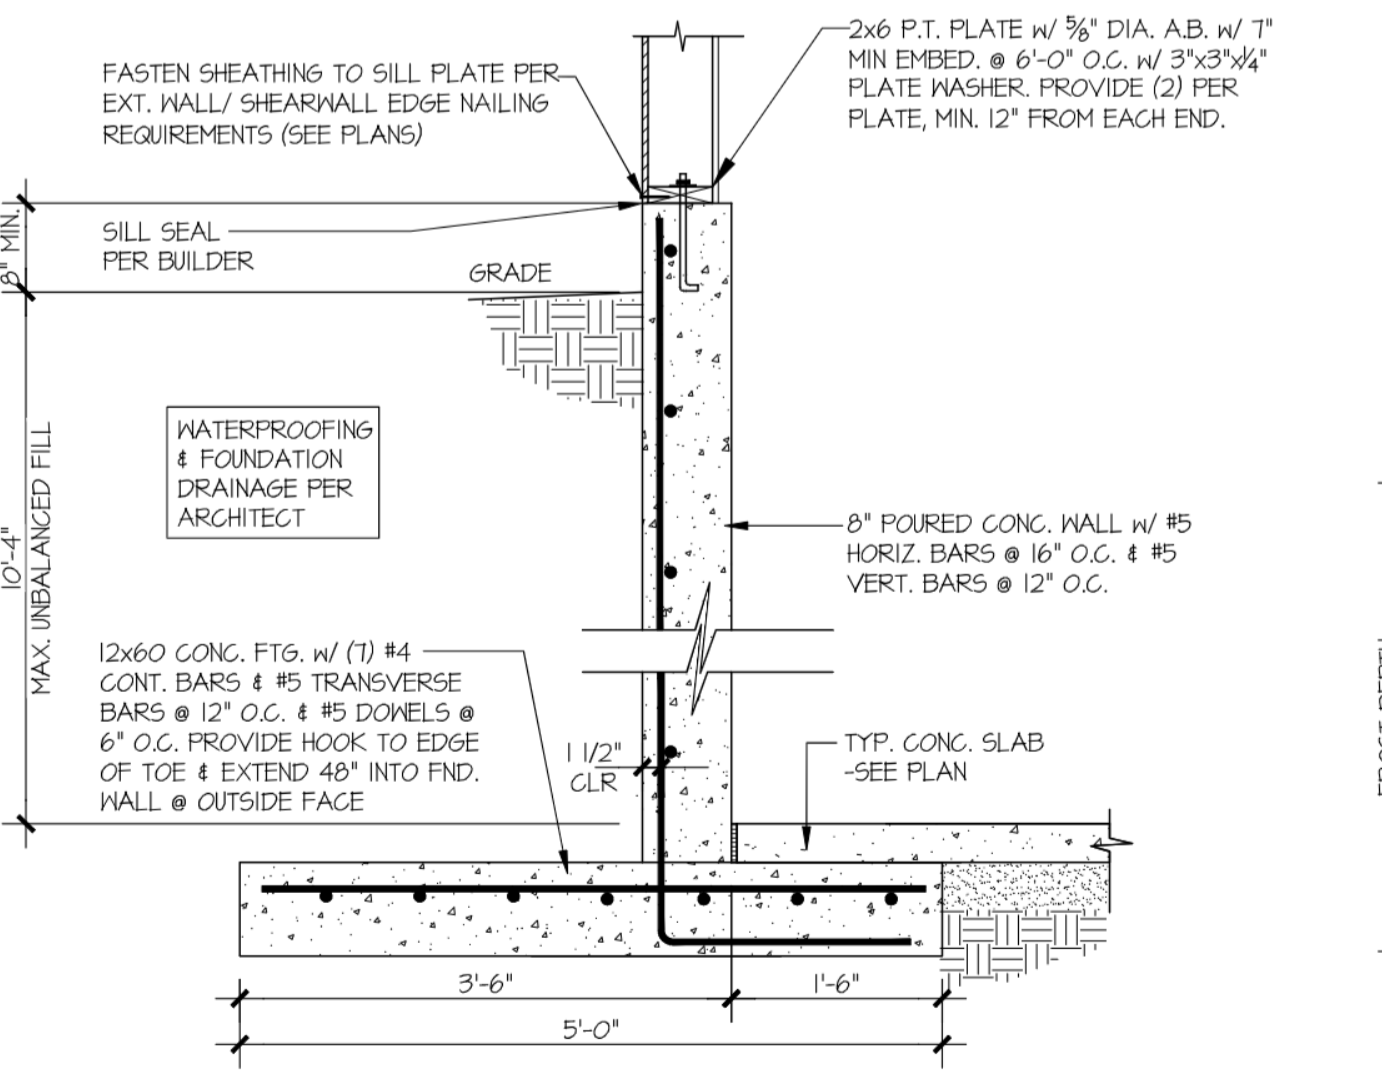


10 BASEMENT STAIR WALL @ GRADE
SCALE: 3/4"=1'-0"

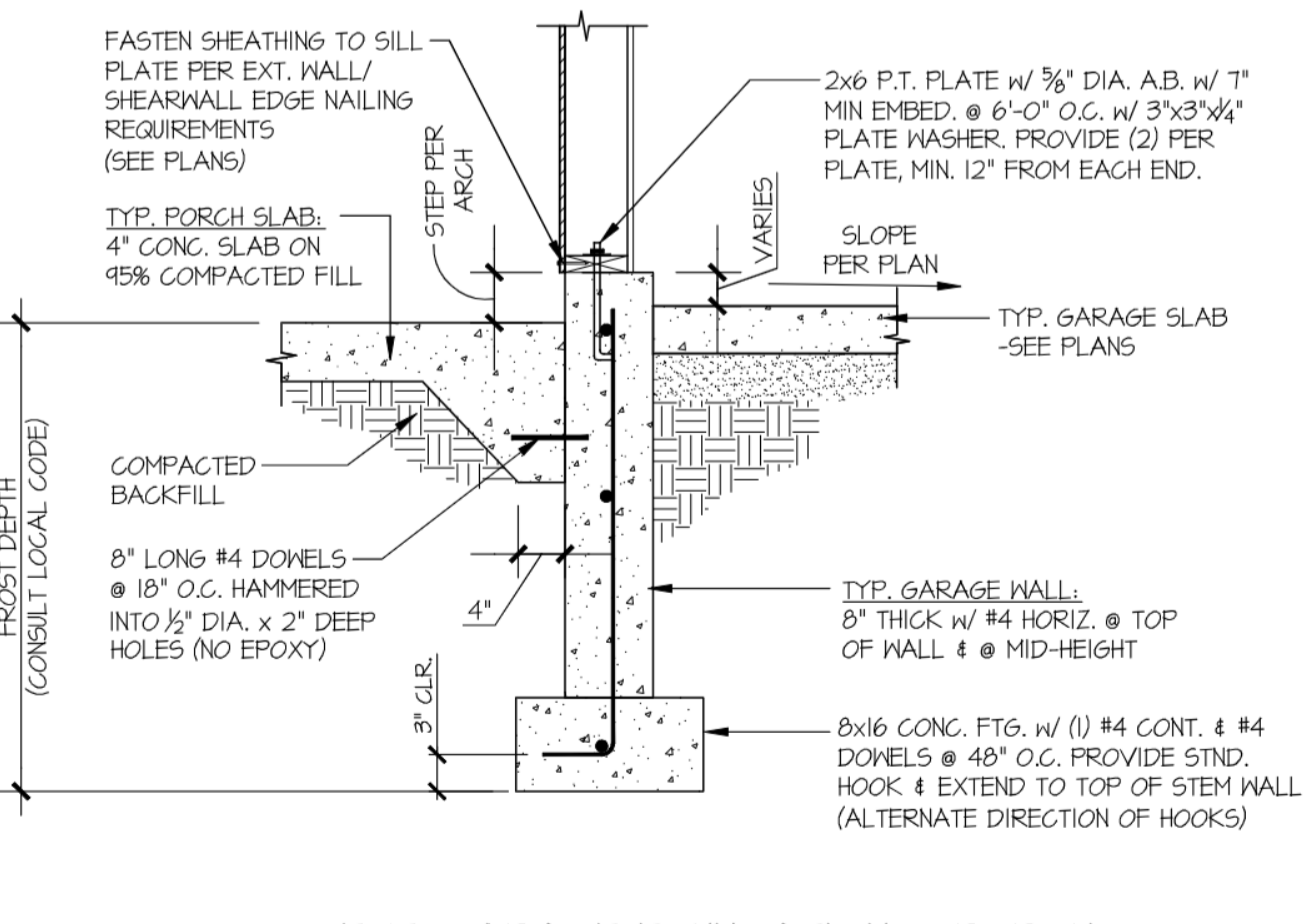


11 EXT. GARAGE FOUNDATION @ PORCH
SCALE: 3/4"=1'-0"

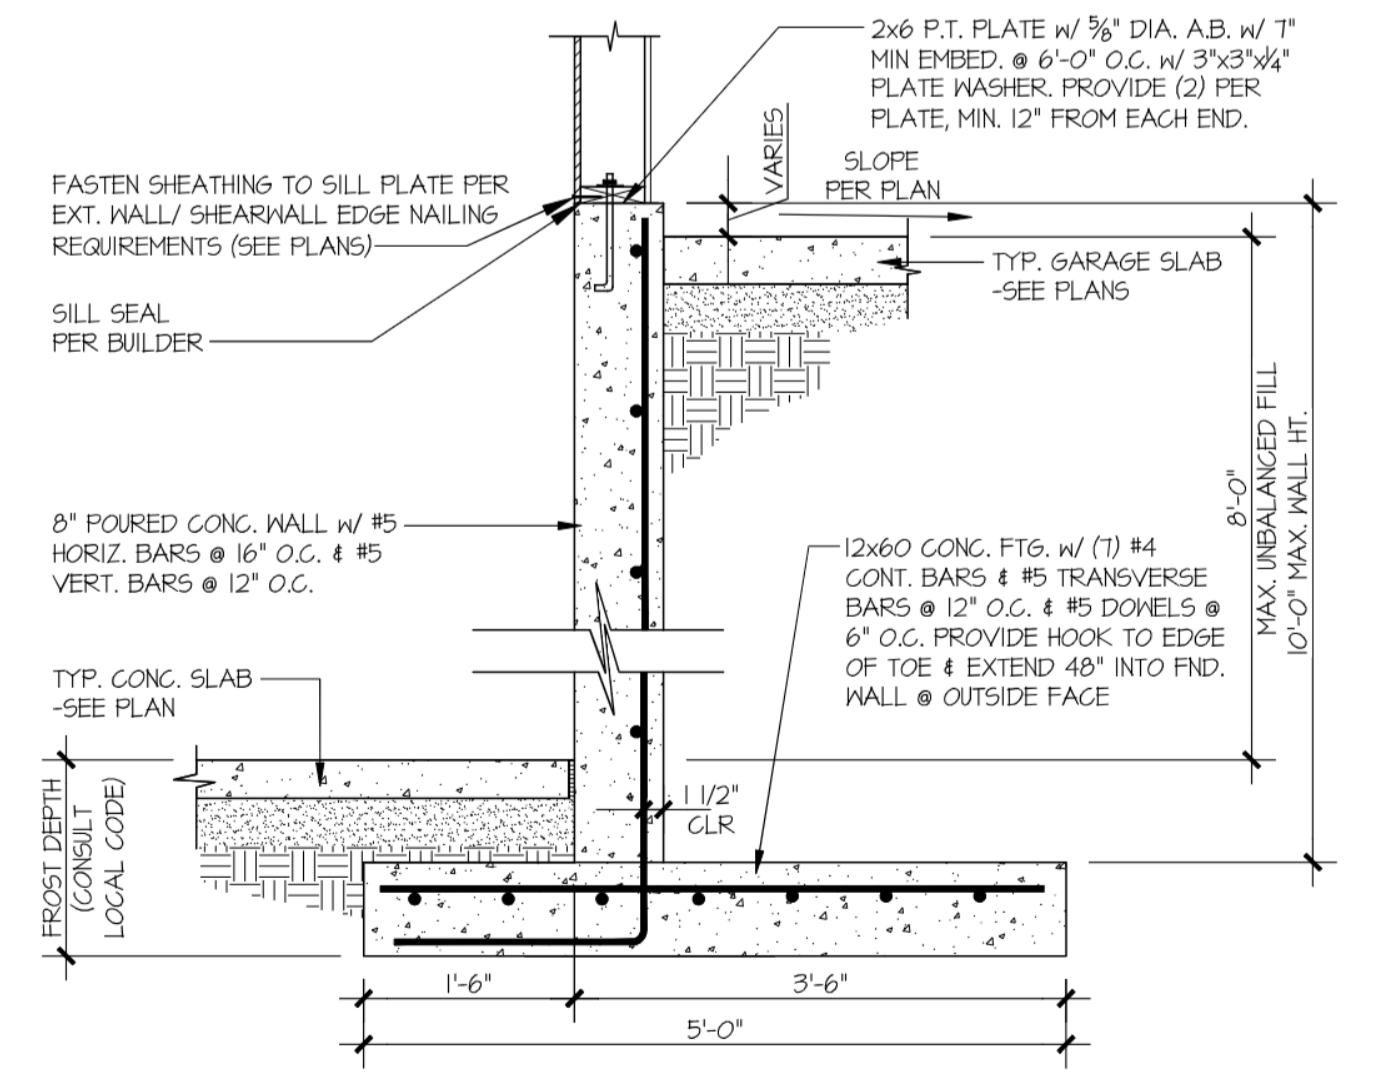


12 REVERSE RETAINING @ GARAGE
SCALE: 3/4"=1'-0"

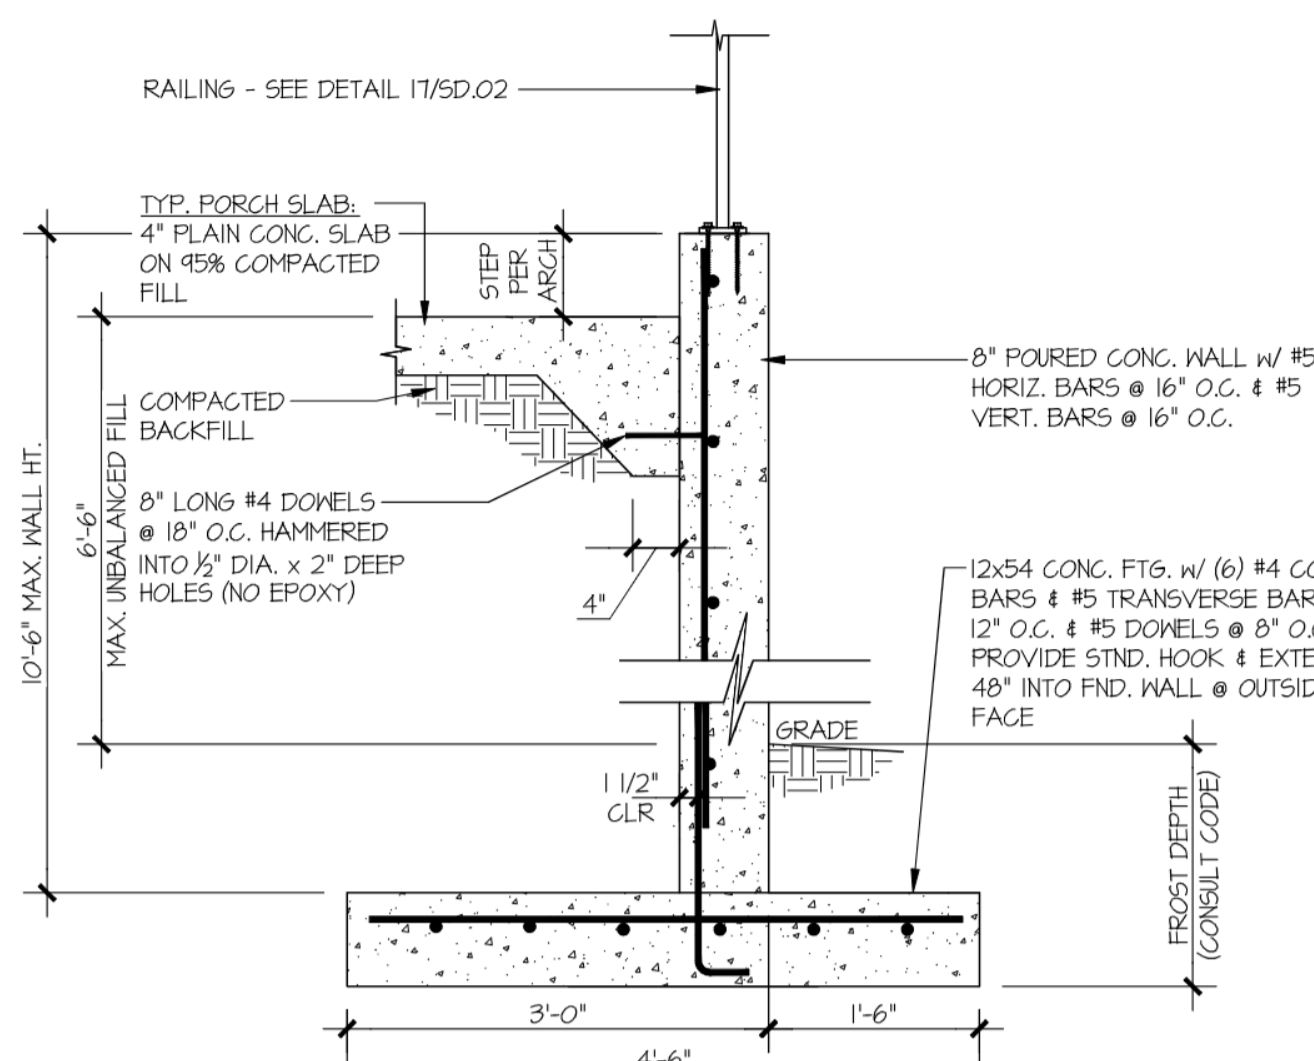


13 SITE RETAINING WALL @ PORCH
SCALE: 3/4"=1'-0"

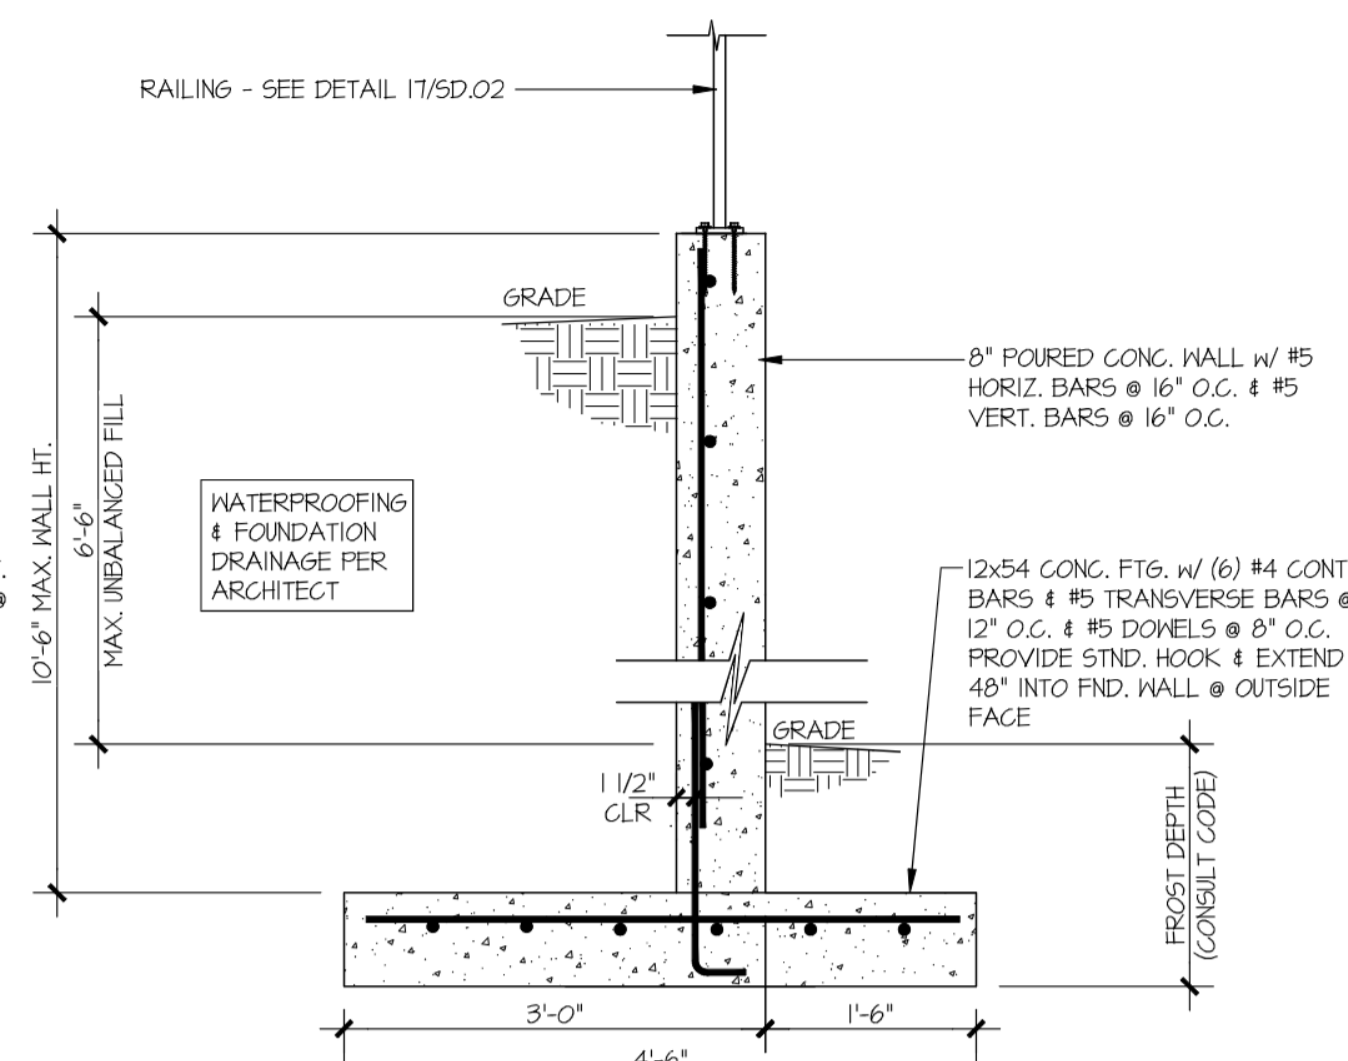


14 SITE RETAINING WALL @ GRADE
SCALE: 3/4"=1'-0"

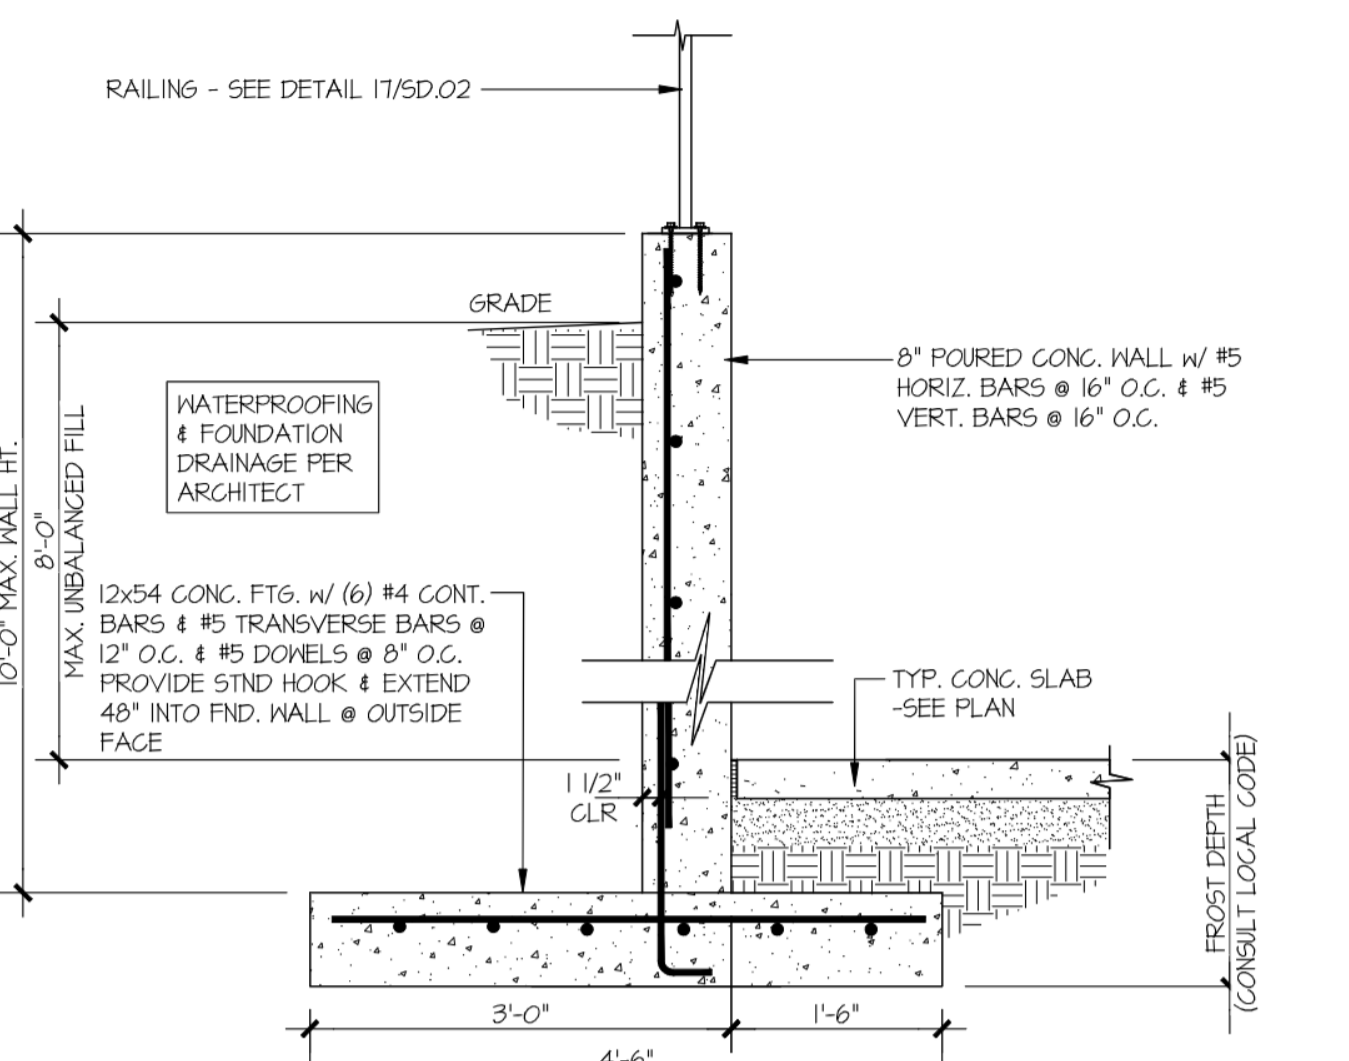


15 SITE RETAINING WALL @ LOW PATIO
SCALE: 3/4"=1'-0"

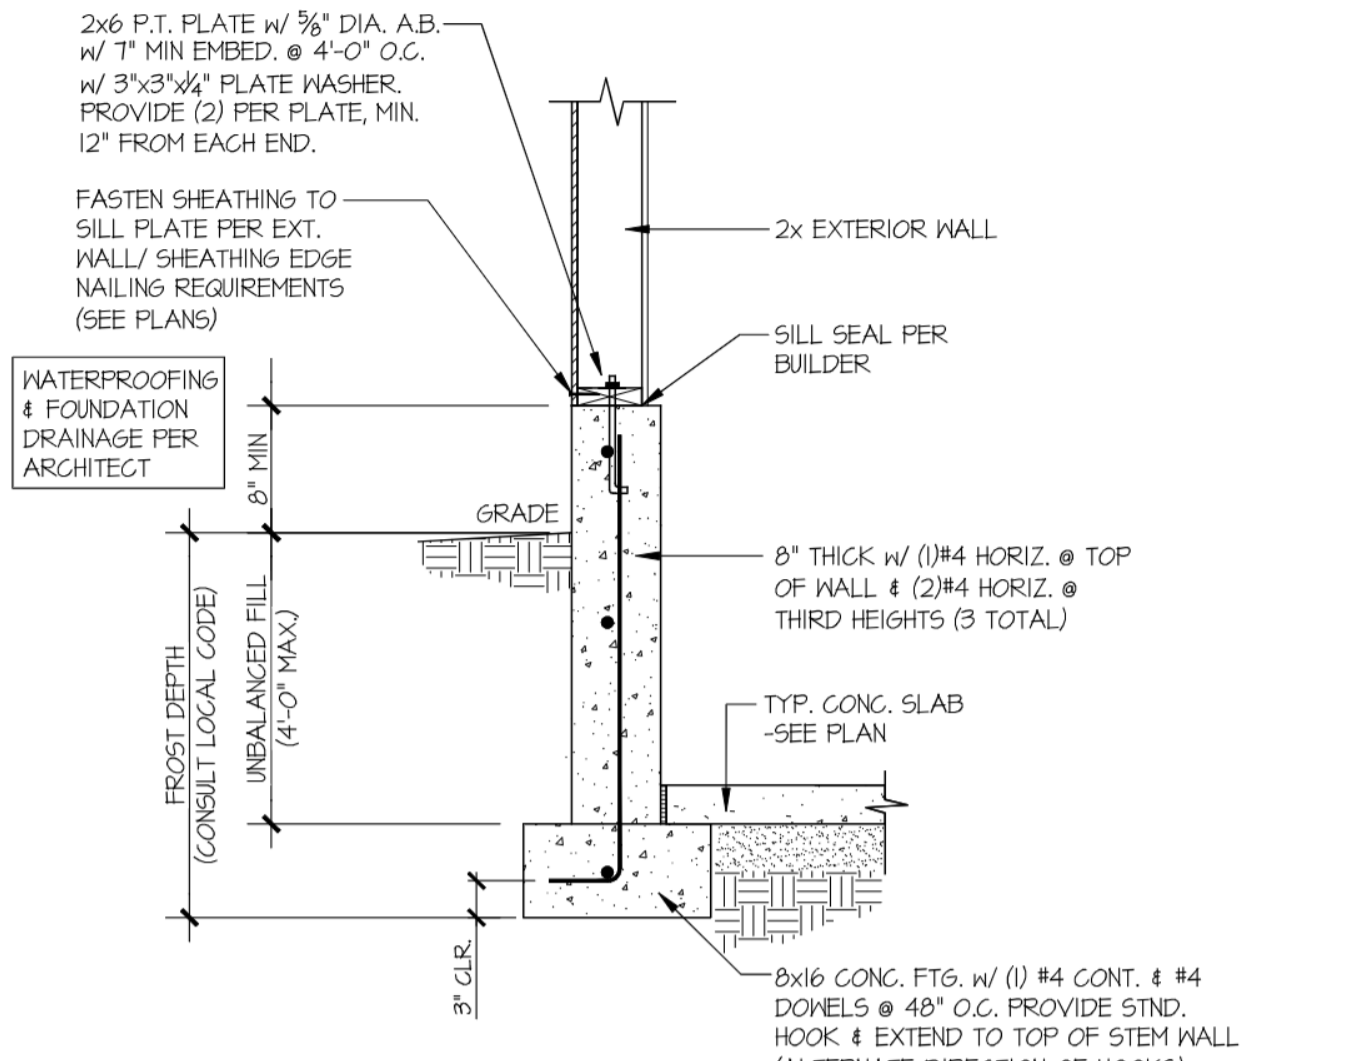


16 LOW BASEMENT FOUNDATION WALL
SCALE: 3/4"=1'-0"

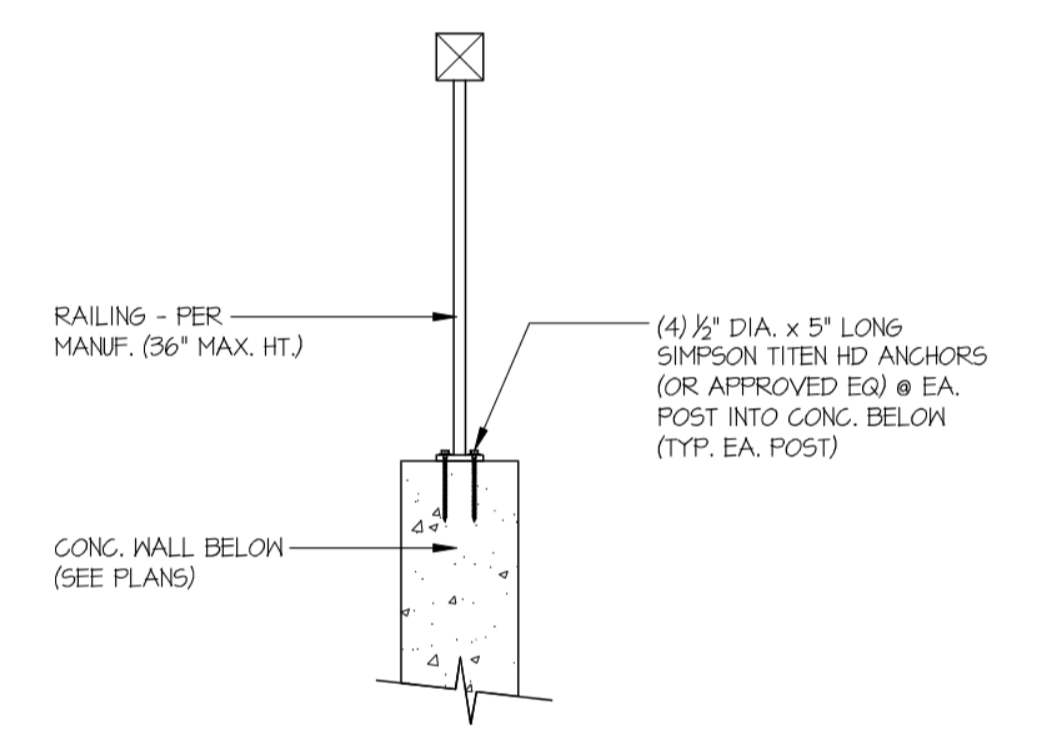


17 TYP. RAILING CONNECTION
SCALE: 3/4"=1'-0" CONG. WALL BELOW

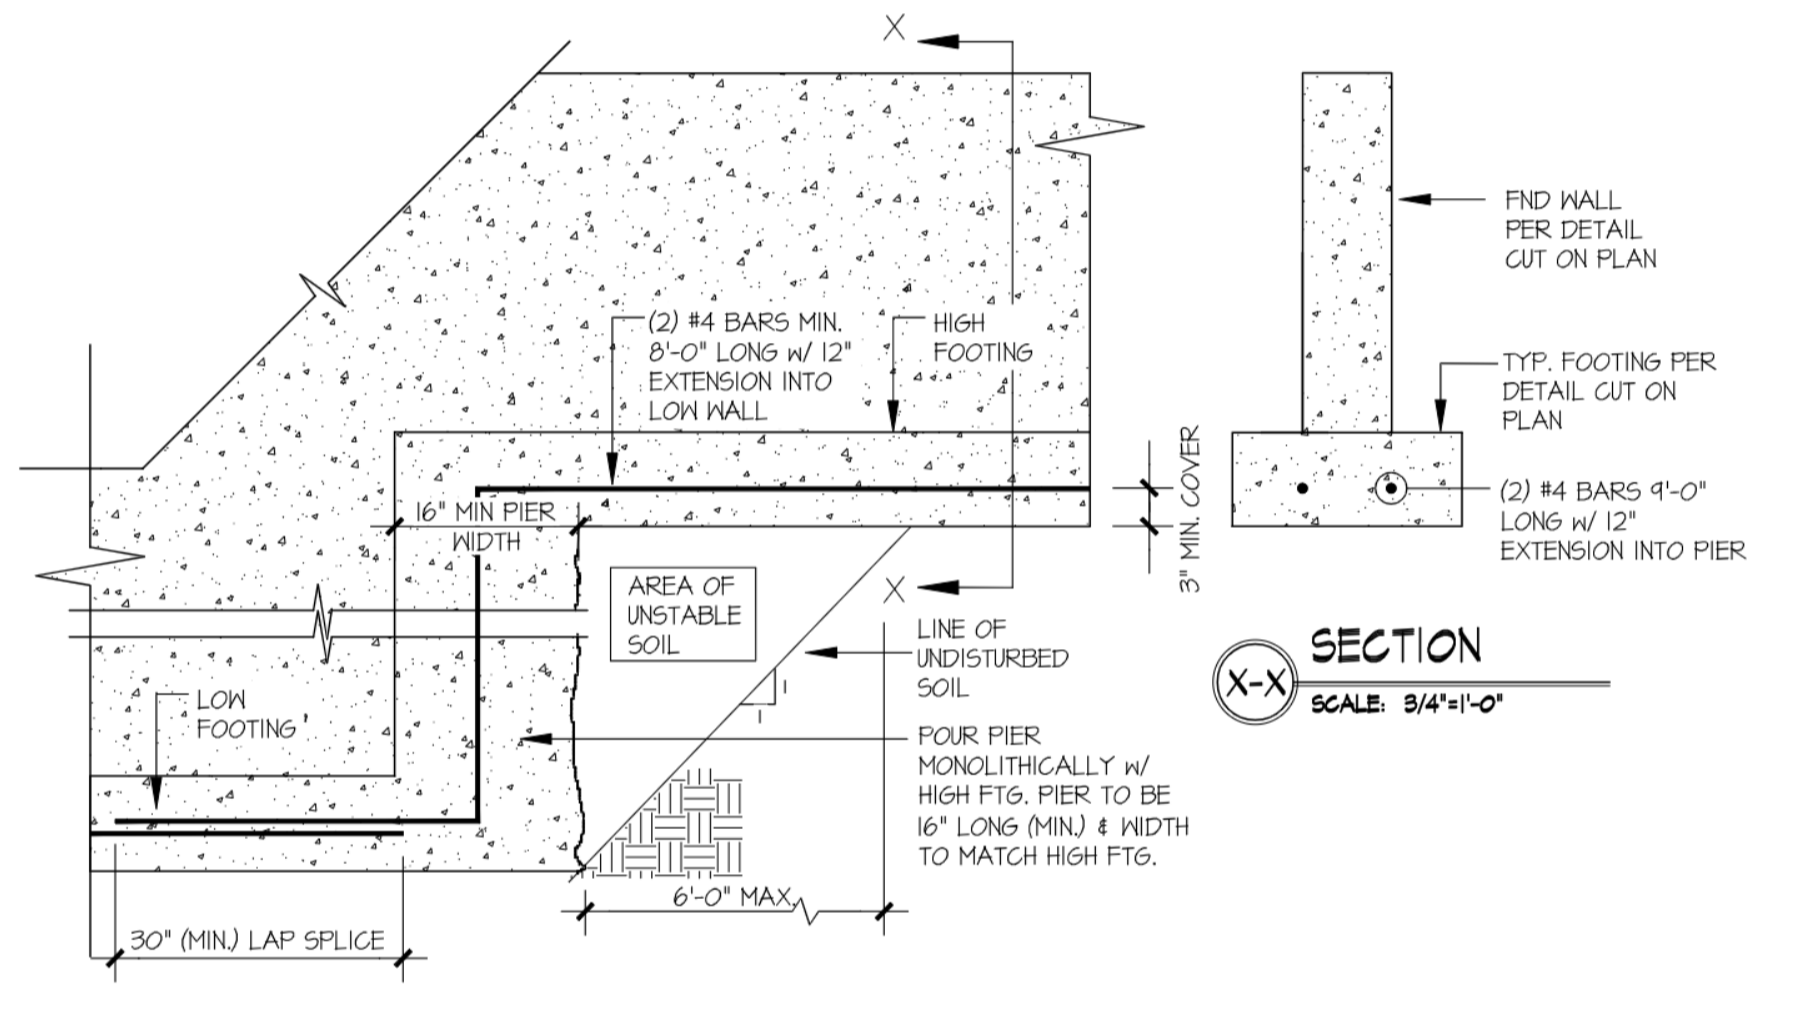


18 TYPICAL STEPPED FOOTING
SCALE: 3/4"=1'-0"

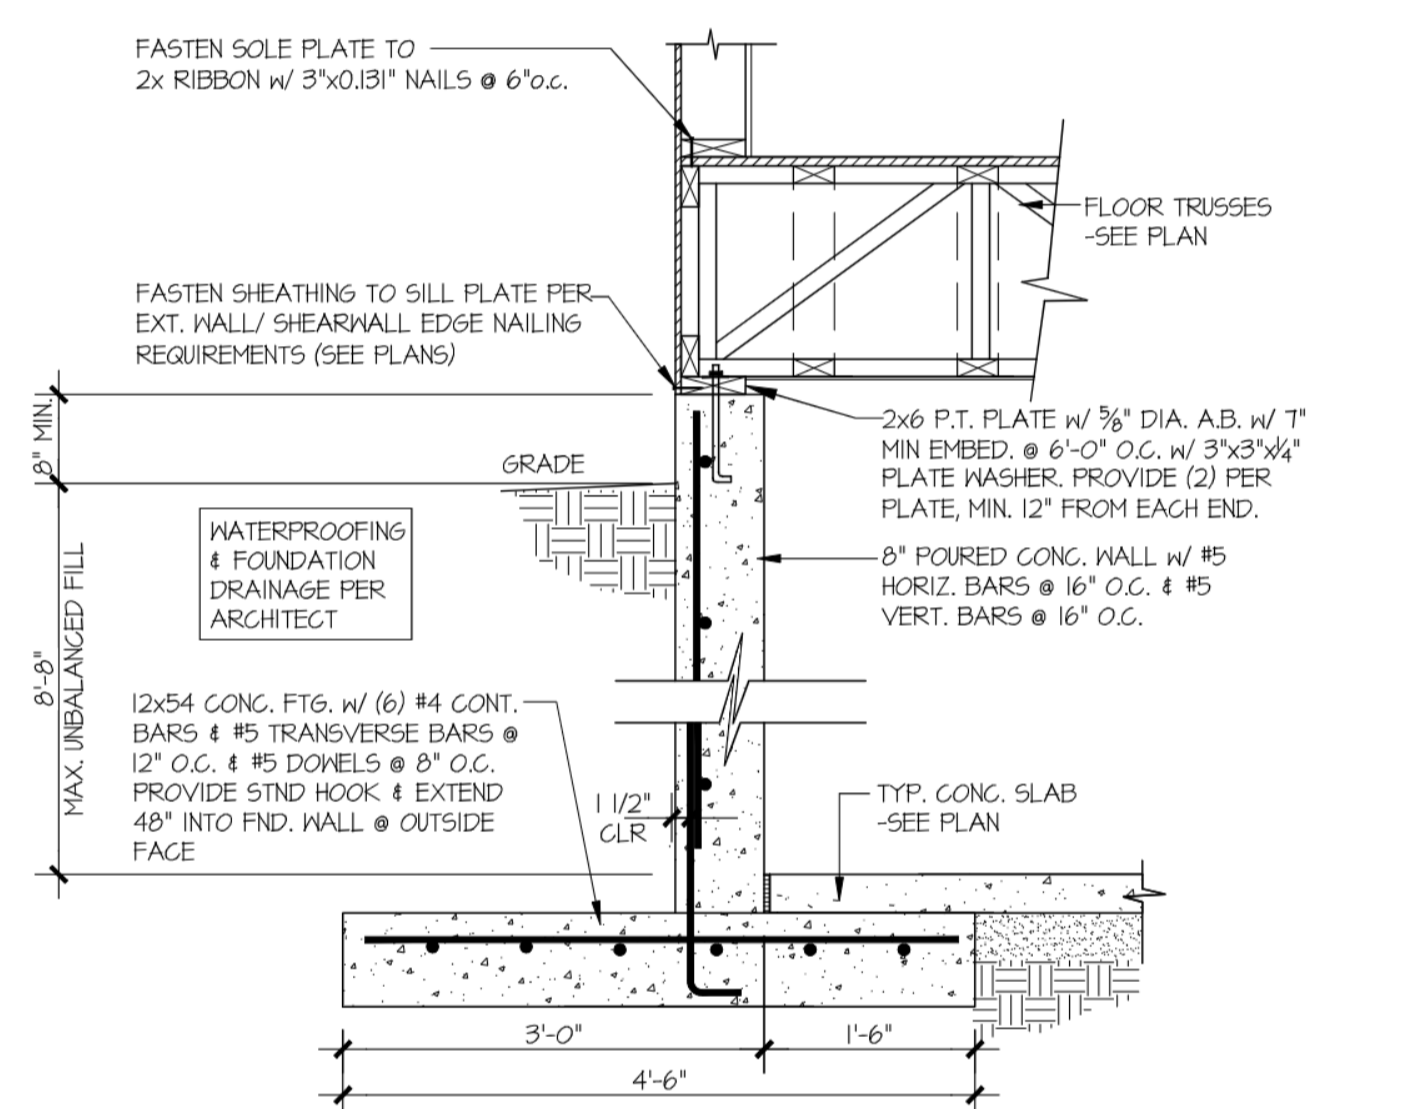


19 TYPICAL BASEMENT WALL @ GRADE
SCALE: 3/4"=1'-0"

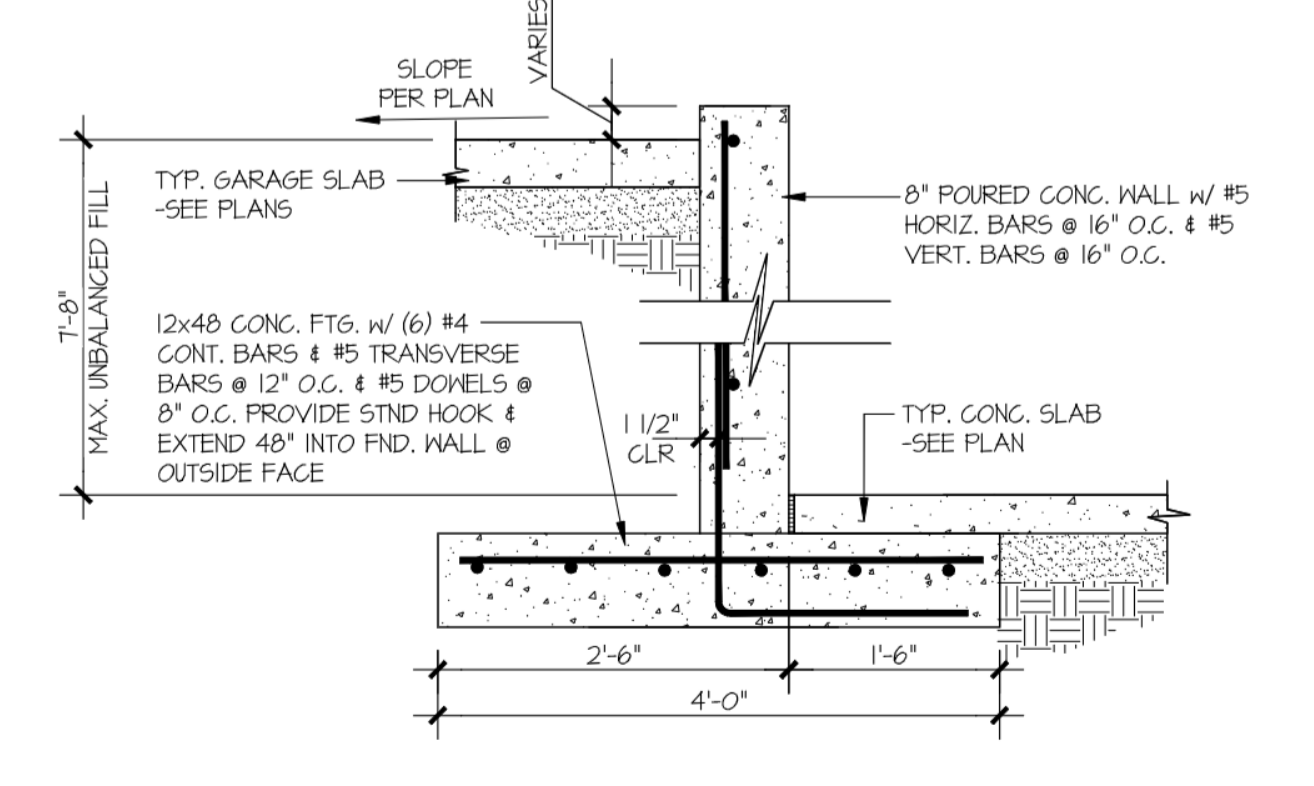

20 BASEMENT WALL @ GARAGE STAIRS
SCALE: 3/4"=1'-0"

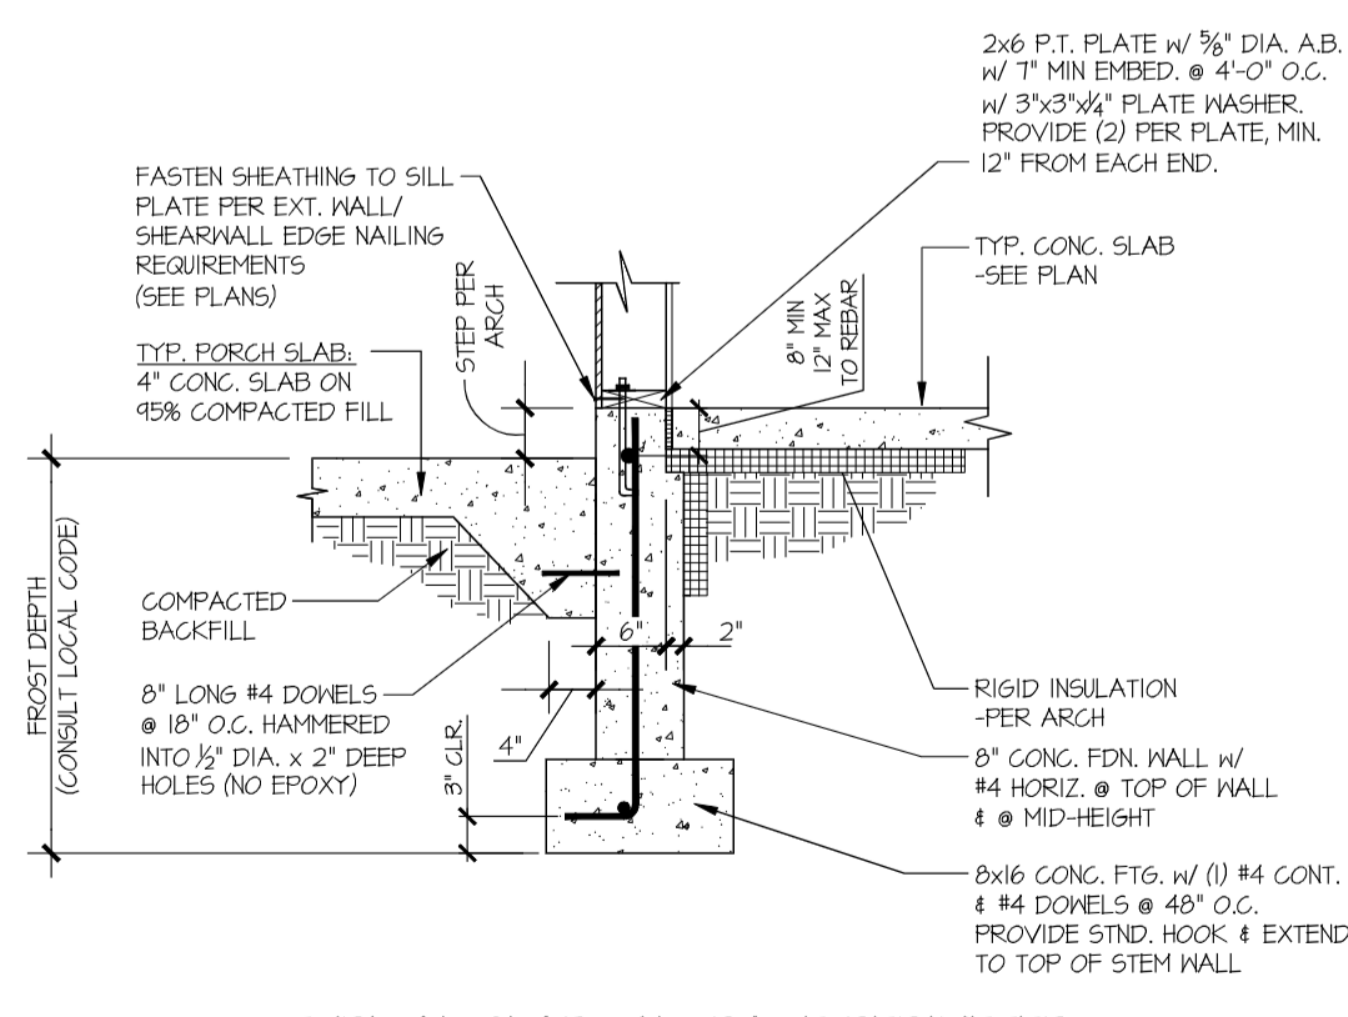

21 TYPICAL SLAB ON GRADE PERIMETER FOOTING
SCALE: 3/4"=1'-0" PORCH SLAB

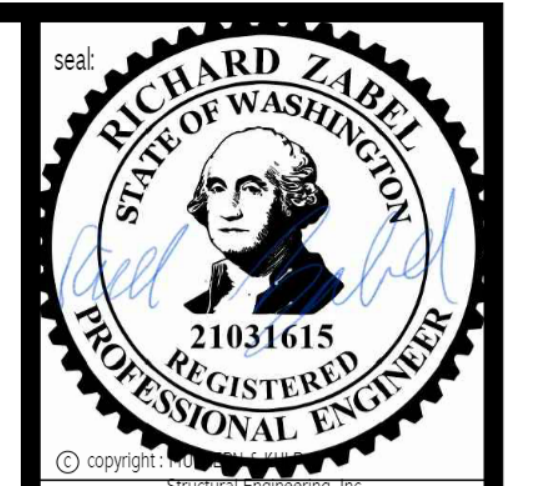

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
300 Brookside Ave. Building 4 - Ambler, PA 19002
p. 215-646-8001 • mulhernkulp.com

M&K project number: 154-23001

project mgr: RJC
drawn by: AJC
issue date: 5-05-23

REVISIONS:

date: initial



STRUCTURAL DETAILS
DUBEY RESIDENCE
8434 SE 39TH ST
MERCER ISLAND, WASHINGTON



sheet: SD.02

EXISTING UTILITY LOCATIONS SHOWN HEREON ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT VERTICAL AND HORIZONTAL LOCATION OF ALL EXISTING UNDERGROUND UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES

CALL BEFORE YOU DIG: 811

LEGEND

- | | | | |
|--|-------------------------|-----------|--------------------------|
| | ASPHALT SURFACE | | EXISTING SPOT ELEVATIONS |
| | BRICK SURFACE | | MONUMENT IN CASE (FOUND) |
| | BUILDING | | POWER METER |
| | CENTERLINE ROW | | POWER (OVERHEAD) |
| | CLEANOUT | | POWER POLE |
| | CULVERT PIPE | | REBAR AS NOTED (FOUND) |
| | CONCRETE SURFACE | | REBAR & CAP (SET) |
| | RETAINING WALL | | ROCKERY |
| | DECK | | SEWER LINE |
| | FENCE LINE (CHAIN LINK) | | SEWER MANHOLE |
| | FENCE LINE (WOOD) | | STORM DRAIN LINE |
| | GAS METER | | TELEPHONE (OVERHEAD) |
| | GRAVEL SURFACE | | TELEPHONE SENTRY |
| | HEDGE FOLIAGE LINE | | WATER METER |
| | INLET (TYPE 1) | | POWER TRANSFORMER POLE |
| | MAILBOX (RESIDENTIAL) | | TREE (AS NOTED) |
| | | SIZE TYPE | |

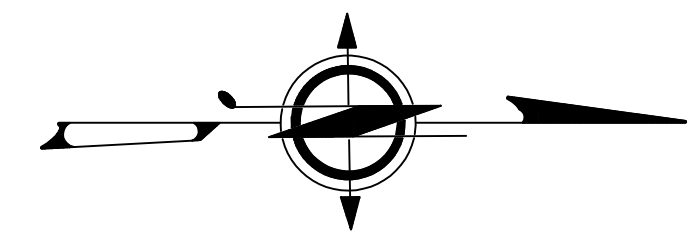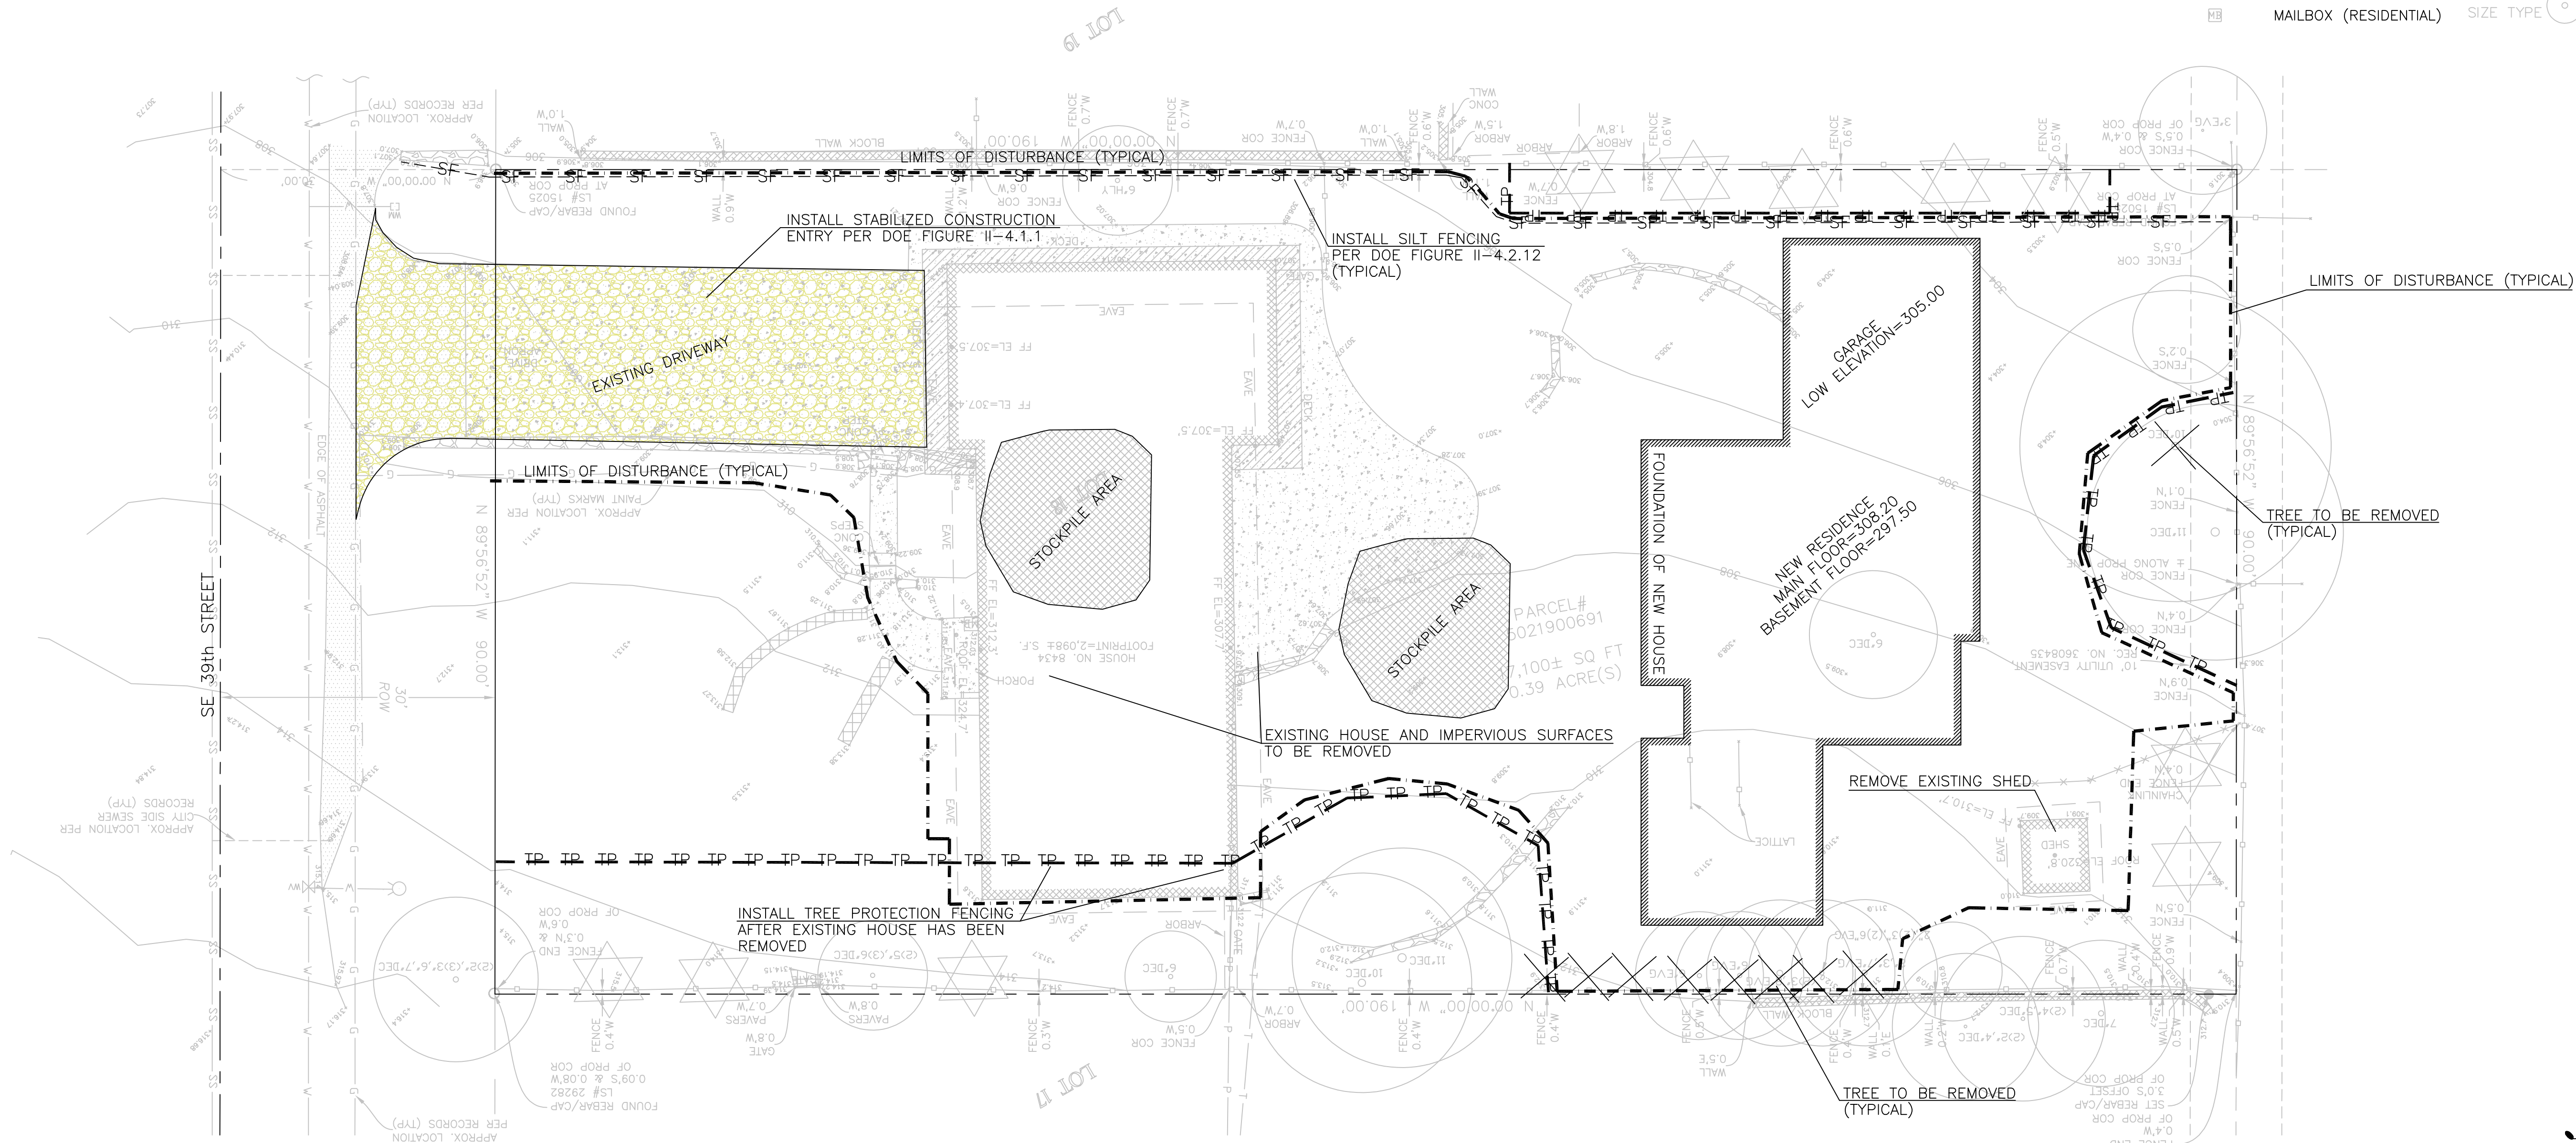

GRAPHIC SCALE


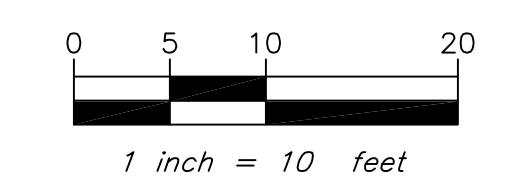


TABLE OF CONTENT

| SHEET # | DESCRIPTION |
|---------|---------------------|
| 1 | TESC PLAN |
| 2 | UTILITY & TREE PLAN |
| 3 | UTILITY DETAILS |
| 4 | AMENDED SOILS PLAN |


PERMIT #: 2306-157

OFFE ENGINEERS
 13902 SOUTHEAST 159TH PLACE
 RENTON, WASHINGTON 98058
 PHONE: 425-260-3412
 CONTACT: DARRELL OFFE, P.E.

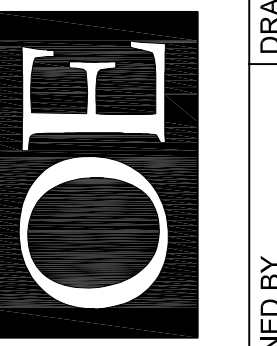

8434 SE 39th Street
JayMarc Custom Homes - Dubey Residence
Temp. Erosion & Sedimentation Control Plan

| | |
|---------------|--|
| PROJECT | 8434 SE 39th Street |
| CLIENT | JayMarc Custom Homes - Dubey Residence |
| SHEET CONTENT | Temp. Erosion & Sedimentation Control Plan |
| DATE | 12/14/2023 |
| JOB NO. | |
| DWG NO. | |
| SHEET | 1 |
| OF | 4 |

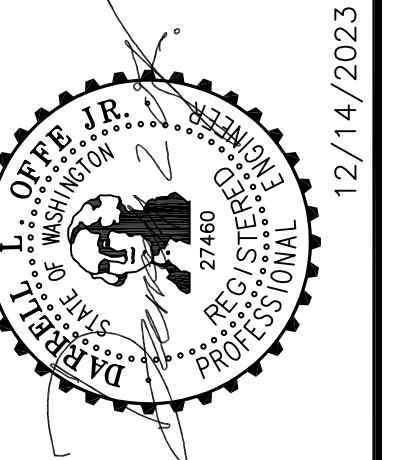

| | |
|-------------|------------|
| DESIGNED BY | DLO |
| DRAWN BY | SLM |
| CHECKED BY | DLO |
| DATE | 12/14/2023 |
| REV. NO. | |
| DESCRIPTION | |

NOTE: THE LAWN AND LANDSCAPE AREAS ARE REQUIRED TO PROVIDE POST-CONSTRUCTION SOIL QUALITY AND DEPTH IN ACCORDANCE WITH BMP T5.13. THE PROJECT CIVIL ENGINEER MUST PROVIDE A LETTER OF CERTIFICATION TO ENSURE THAT THE LAWN AND LANDSCAPE AREAS ARE MEETING THE POST-CONSTRUCTION SOIL QUALITY AND DEPTH REQUIREMENTS SPECIFIED ON THE APPROVED PLAN SET PRIOR TO FINAL INSPECTION OF THE PROJECT.

STORM PIPE TABLE

- ① 42LF., 10" PVC SDR-35 @ S=2.00%
- ② 12LF., 8" PVC SDR-35 @ S=2.00%
- ③ 119LF., 48" CMP @ S=0.00%
TOP OF PIPE=303.00
BOTTOM OF PIPE=299.00
- ④ NOT USED
- ⑤ 49LF., 6" PVC SDR-35 @ S=1.69%
- ⑥ 2LF., 6" SD @ S=58.2%
- ⑦ 6LF., 6" PVC SDR-35 @ S=5.00%
- ⑧ NOT USED
- ⑨ 22LF., 4" PVC SDR-35 @ S=2.00%
- ⑩ 59LF., 4" PVC SDR-35 @ S=2.00%
- ⑪ 19LF., 4" PVC SDR-35 @ S=2.00%
- ⑫ 21LF., 4" PVC SDR-35 @ S=2.00%
- ⑬ 20LF., 4" PVC SDR-35 @ S=2.00%
- ⑭ 34LF., 4" PVC SDR-35 @ S=5.65%
- ⑮ 22LF., 4" PVC SDR-35 @ S=2.00%

DOWNSPOUT TABLE

- DS#1 GROUND=304.50
DOWNSPOUT LINE=302.64, 4"
- DS#2 CONCRETE=304.50
DOWNSPOUT LINE=303.10, 4"
- DS#3 GROUND=306.00
DOWNSPOUT LINE=304.30, 4"
- DS#4 GROUND=307.00
DOWNSPOUT LINE=306.40, 4"
- DS#5 GROUND=307.00
DOWNSPOUT LINE=306.05, 4"
- DS#6 CONCRETE=308.00
DOWNSPOUT LINE=305.60, 4"
- DS#7 GROUND=307.00
DOWNSPOUT LINE=305.00, 4"
- DS#8 CONCRETE=304.90
DOWNSPOUT LINE=303.10, 4"


STORM PIPE PVC SHALL BE SDR-35 PVC AT SLOPE=2.00% MINIMUM (TYPICAL) UNLESS OTHERWISE NOTED

EXISTING UTILITY LOCATIONS SHOWN HEREON ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT VERTICAL AND HORIZONTAL LOCATION OF ALL EXISTING UNDERGROUND UTILITIES PRIOR TO COMMENCING CONSTRUCTION. NO REPRESENTATION IS MADE THAT ALL EXISTING UTILITIES ARE SHOWN HEREON. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR UTILITIES NOT SHOWN OR UTILITIES

CALL BEFORE YOU DIG: 811

LEGEND

- ASPHALT SURFACE
- BRICK SURFACE
- BUILDING
- CENTERLINE ROW
- CLEANOUT
- CULVERT PIPE
- CONCRETE SURFACE
- RETAINING WALL
- DECK
- FENCE LINE (CHAIN LINK)
- FENCE LINE (WOOD)
- GAS METER
- GRAVEL SURFACE
- HEDGE FOLIAGE LINE
- INLET (TYPE 1)
- MAILBOX (RESIDENTIAL)
- EXISTING SPOT ELEVATIONS
- MONUMENT IN CASE (FOUND)
- POWER METER
- POWER (OVERHEAD)
- POWER POLE
- REBAR AS NOTED (FOUND)
- REBAR & CAP (SET)
- ROCKERY
- SEWER LINE
- SEWER MANHOLE
- STORM DRAIN LINE
- TELEPHONE (OVERHEAD)
- TELEPHONE SENTRY
- WATER METER
- POWER TRANSFORMER POLE
- TREE (AS NOTED)

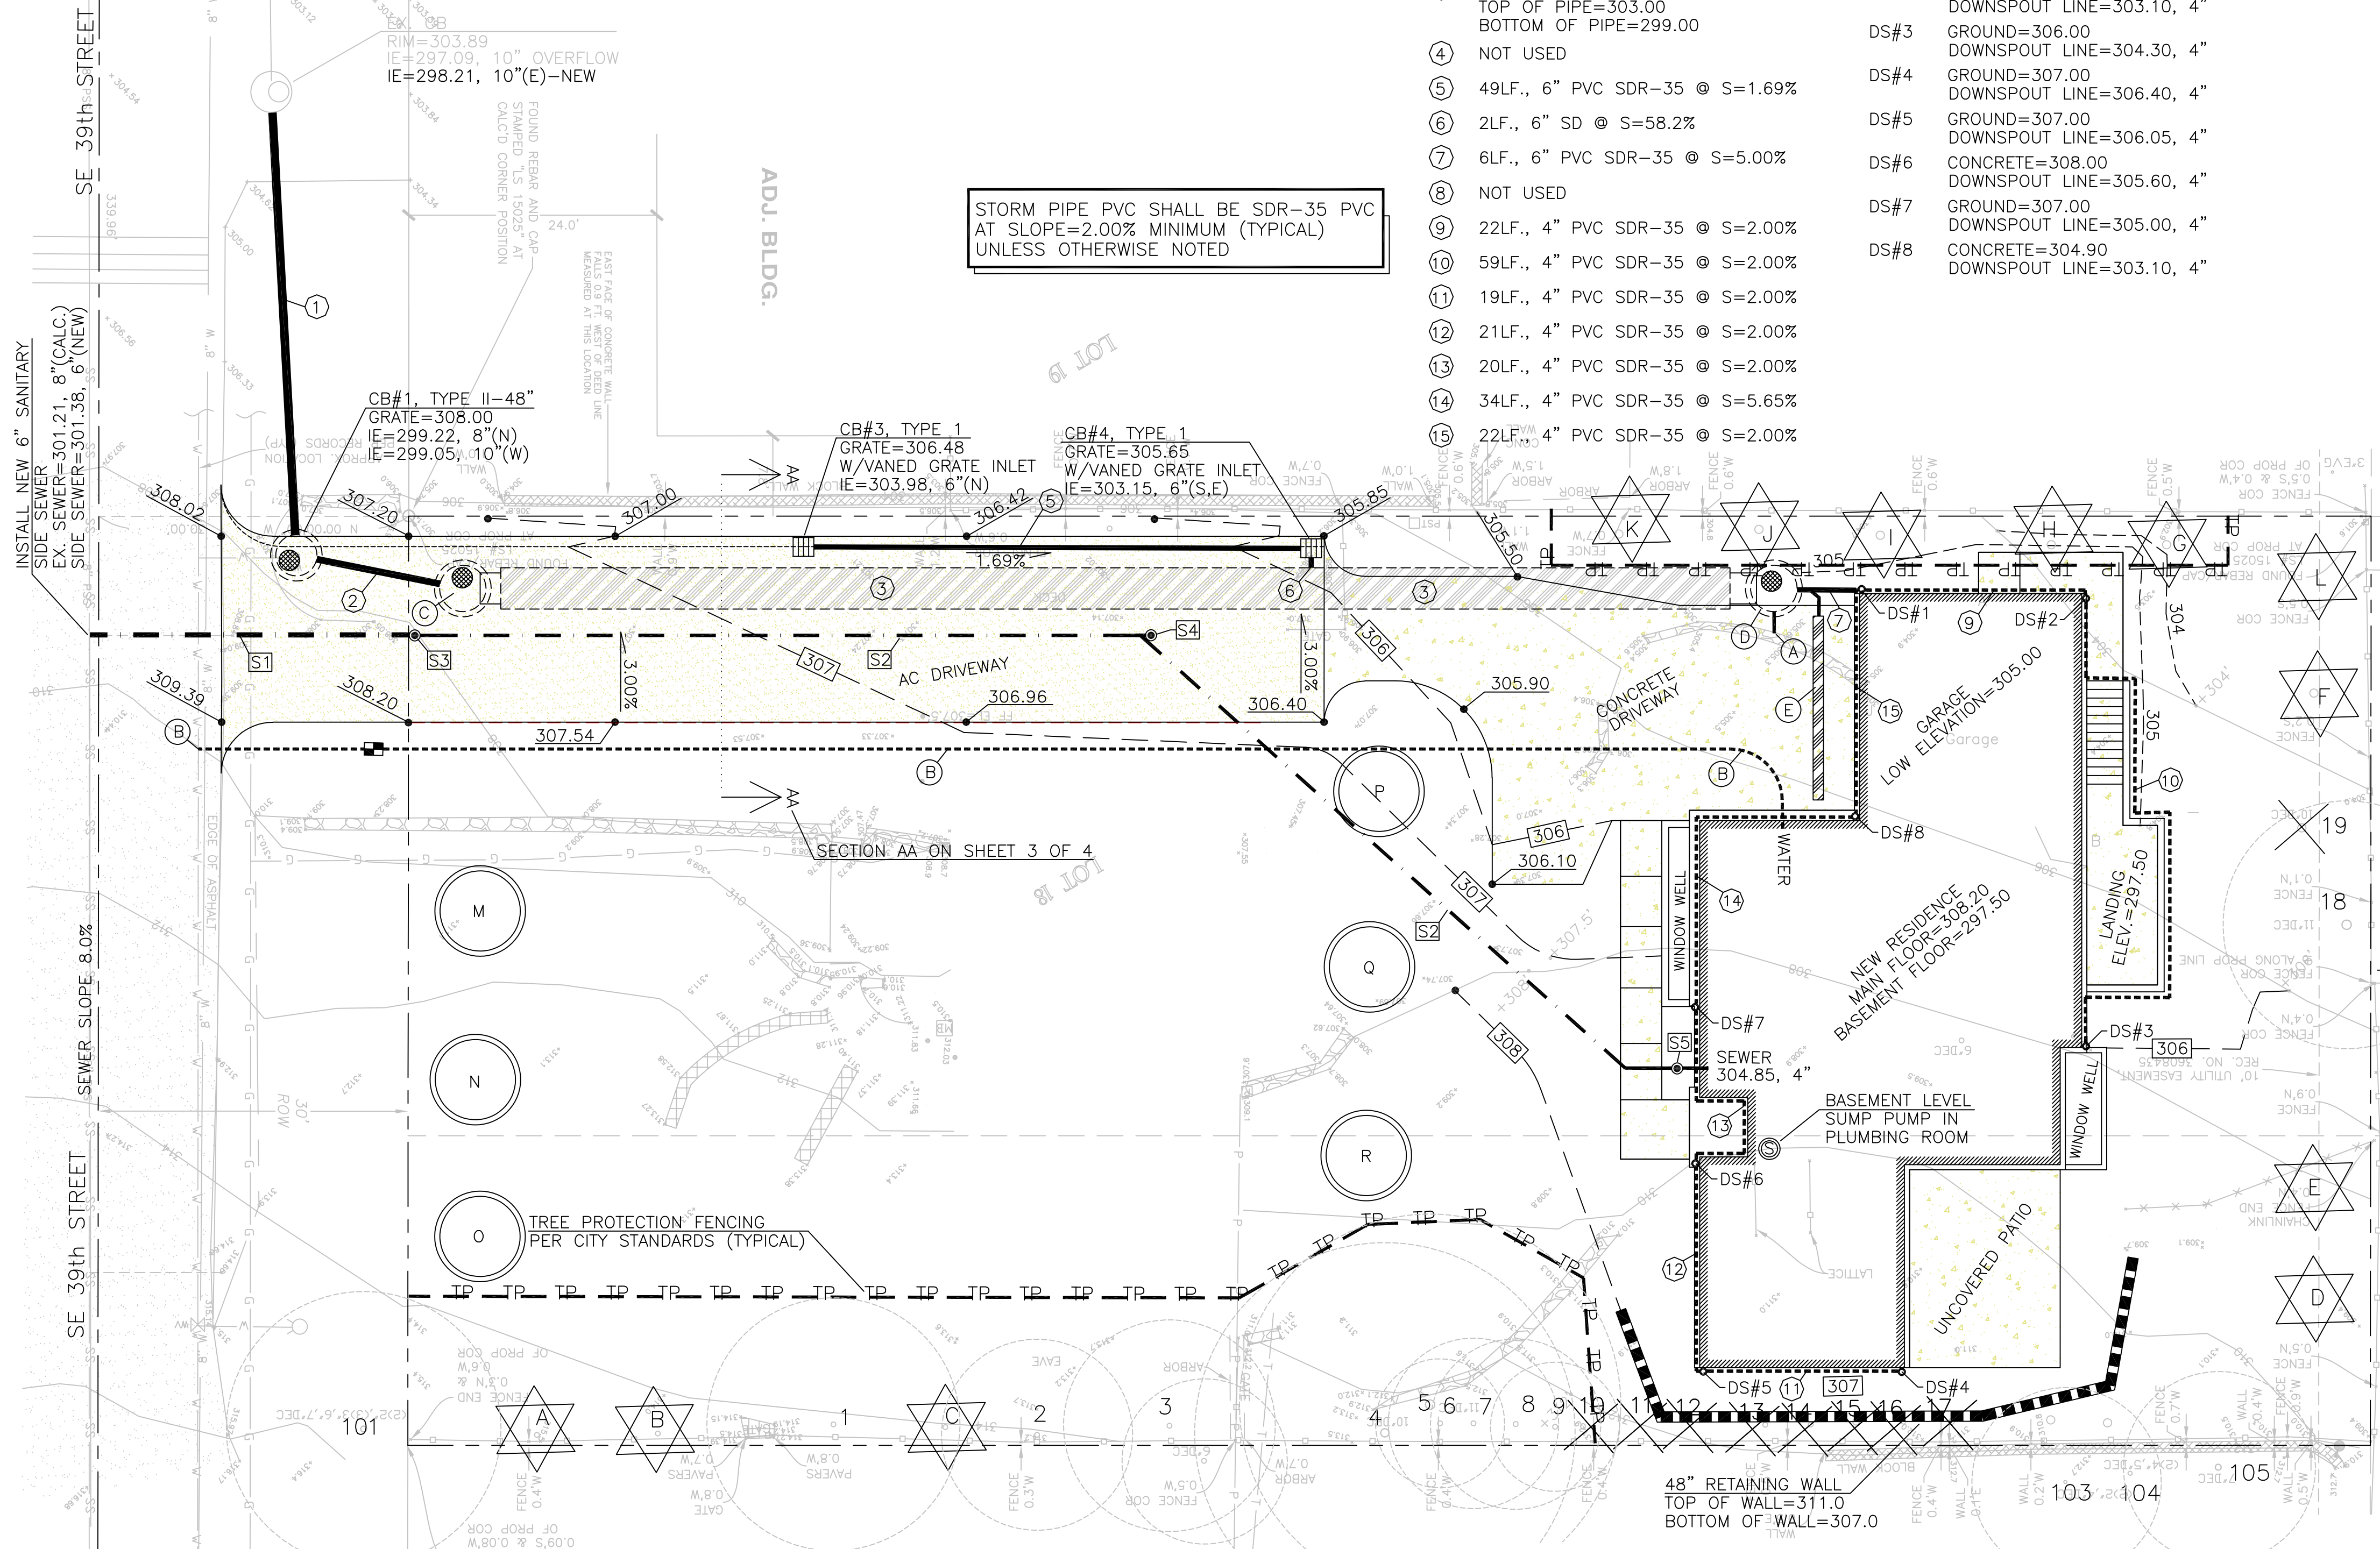

8434 SE 39th Tree Table

| Tree ID | Common Name | DBH | Multi | Health | Condition | Drigline | Category | Retain? |
|---------|-----------------|------|-------|--------|-----------|----------|----------|---------|
| 1 | Crabapple | 11.7 | Yes | 1 | 1 | 12.0 | Sig | Yes |
| 2 | Fruiting Pear | 5 | | 1 | 2 | 9.0 | Small | Yes |
| 3 | Crabapple | 8 | | 1 | 2 | 10.0 | Sig | Yes |
| 4 | Pacific Dogwood | 10.5 | | 2 | 1 | 18.0 | Exc | Yes |
| 5 | Pacific Dogwood | 11.5 | | 2 | 1 | 18.0 | Exc | Yes |
| 6 | Japanese Cedar | 7.8 | Yes | 1 | 2 | 6.0 | Small | Yes |
| 7 | Japanese Cedar | 7.6 | Yes | 1 | 2 | 8.0 | Small | Yes |
| 8 | Japanese Cedar | 7 | Yes | 1 | 2 | 7.0 | Small | Yes |
| 9 | Japanese Cedar | 6.7 | Yes | 1 | 2 | 6.0 | Small | Yes |
| 10 | Japanese Cedar | 8.9 | Yes | 1 | 2 | 6.0 | Small | No |
| 11 | Japanese Cedar | 11.3 | Yes | 1 | 2 | 6.0 | Sig | No |
| 12 | Japanese Cedar | 7 | Yes | 1 | 2 | 7.0 | Small | No |
| 13 | Japanese Cedar | 10.4 | Yes | 1 | 2 | 8.0 | Sig | No |
| 14 | Japanese Cedar | 10.3 | Yes | 1 | 2 | 8.0 | Sig | No |
| 15 | Japanese Cedar | 12.6 | Yes | 1 | 2 | 8.0 | Sig | No |
| 16 | Japanese Cedar | 8.5 | Yes | 1 | 2 | 9.0 | Sig | No |
| 17 | Japanese Cedar | 10 | Yes | 1 | 2 | 9.0 | Sig | No |
| 18 | Mountain Ash | 14 | Yes | 1 | 2 | 14.0 | Sig | Yes |
| 19 | Red maple | 17.4 | | 1 | 1 | 15.0 | Sig | No |
| TOTALS | | | | | | | | |

OFFSITE

| Tree ID | Common Name | DBH | ROW | Category | Retain? |
|---------|-----------------|------------|-----|----------|---------|
| 101 | Common Hawthorn | 8.5 | ROW | 13.0 | Sig Yes |
| 102 | Common Hawthorn | NOT MAPPED | ROW | 13.0 | Sig Yes |
| 103 | Bitter Cherry | ? | | OH 14 | Sig Yes |
| 104 | Bitter Cherry | ? | | OH 14 | Sig Yes |
| 105 | Bitter Cherry | ? | | OH 14 | Sig Yes |

| ID | Common Name | DBH | Multi | Health | Structural Condition | Tree Size | Category | Retain? | Replacements |
|----|--------------------|-----|-------|--------|----------------------|-----------|----------|---------|-------------------|
| A | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes | |
| B | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes | |
| C | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes | |
| D | Himalayan cedar | 1.5 | | | | 5.0 | | no | Vine Maple |
| E | Himalayan cedar | 1.5 | | | | 5.0 | | no | Vine Maple |
| F | Thunder Cloud Plum | 2 | | | | 5.0 | | Yes | |
| G | Himalayan cedar | 1.5 | | | | 5.0 | | no | Pacific Crabapple |
| H | Thunder Cloud Plum | 2 | | | | 5.0 | | Yes | |
| I | Himalayan cedar | 2.5 | | | | 5.0 | | no | Bitter Cherry |
| J | Himalayan cedar | 2 | | | | 5.0 | | Yes | |
| K | Himalayan cedar | 2 | | | | 5.0 | | Yes | |
| L | Thunder Cloud Plum | 1 | | | | 7.0 | | no | Cereus |

New Replacement Trees

| Tree ID | Common Name | DBH | Multi | Health | Structural Condition | Tree Size | Category | Retain? | Replacements |
|---------|-------------------|-----|-------|--------|----------------------|-----------|----------|---------|--------------|
| M | Pacific Crabapple | 1.5 | | | | 5.0 | | Yes | |
| N | Bitter Cherry | 1.5 | | | | 5.0 | | Yes | |
| O | Vine Maple | 1.5 | | | | 5.0 | | Yes | |
| P | Pacific Crabapple | 1.5 | | | | 5.0 | | Yes | |
| Q | Vine Maple | 1.5 | | | | 5.0 | | Yes | |
| R | Vine Maple | 1.5 | | | | 5.0 | | Yes | |

4" FOUNDATION DRAIN REQUIRED BUT NOT SHOWN, GRAVITY FOUNDATION DRAIN AT 303.75 AND ABOVE CAN CONNECT AT POINT A; ANY DRAIN OR FOUNDATION DRAIN BELOW 303.50 WILL NEED TO BE PUMPED TO GRAVITY DOWNSPOUT LINE. BASEMENT LEVEL SUMP SHOWN ON PLAN.

- NOTES:**
- (A) 4" FOUNDATION DRAIN
 - (B) INSTALL 1" METER AND 1-1/2" SERVICE LINE PER CITY OF MERCER ISLAND STANDARD PLAN W-14.
NOTE (A): CONTRACTOR TO COORDINATE FINAL LOCATION OF NEW METER WITH CITY OF MERCER ISLAND INSPECTOR AT TIME OF CONSTRUCTION
NOTE (B): FINAL METER SIZE AND SERVICE LINE SIZE TO BE DETERMINED BY MECHANICAL CONTRACTOR INSTALLING FIRE SPRINKLER SYSTEM
 - (C) CB#2, CONTROL STRUCTURE, TYPE II-54"Ø ((SEE DETAIL ON SHEET 3 OF 4))
W/SOLID LOCKING LID
RIM=307.57
OVERFLOW=303.00, 8"(TOP OF TEE)
IE=302.00, 6"(E) - FUTURE LOT 1 CONNECTION
IE=299.50, 8"(SW), 36"(N)
ELEV.=297.50, 8"(BOTTOM OF TEE)
INSIDE BOTTOM=295.50
 - (D) CB#5, TYPE II-54"Ø
W/SOLID LOCKING LID
RIM=305.00
IE=302.30, 6"(N), 4"(S)
IE=299.50, 36"(S)
 - (E) 18' SLOT DRAIN
GRATE=304.90
IE=303.75, 4"(W)


- SIDE SEWER NOTES**
- S1 INSTALL 32LF., 6" PVC SIDE SEWER @ S=2.00%
 - S2 INSTALL 137LF., 4" PVC SIDE SEWER @ S=2.00%
 - S3 SANITARY SEWER CLEANOUT W/TRAFFIC BEARING FRAME AND LID LID=307.75 IE=302.02, 6"
 - S4 SANITARY SEWER CLEANOUT W/TRAFFIC BEARING FRAME AND LID LID=306.45 IE=303.42, 4"
 - S5 SANITARY SEWER CLEANOUT LID=307.00 IE=304.75, 4"

DETENTION TANK IMPERVIOUS SURFACES
LOT 1 (FUTURE LOT - FRONT)
ADDITIONAL IMPERVIOUS AREA=2,230 SQ. FT.

THIS BUILDING PERMIT IMPERVIOUS AREAS = 5,769 SQ. FT.
TOTAL PROPOSED IMPERVIOUS 7,999 SQ. FT. ON ENTIRE PROPERTY
DETENTION TANK SIZED FOR: 8,000 SQ. FT.

IMPERVIOUS SURFACES:
ROOF AREA (UNDER EAVES): 2,184 SQ. FEET
UNCOVERED DRIVEWAY: 2,928 SQ. FEET
UNCOVERED PATIO: 279 SQ. FEET
UNCOVERED WALKWAY: 378 SQ. FEET
TOTAL IMPERVIOUS AREAS = 5,769 SQ. FEET

LANDSCAPE AREAS NOTE:
DISTURBED LANDSCAPE AREAS SHALL BE TREATED AS AMENDED SOILS PER DOE FIGURE V-5.3.3, TYPICAL

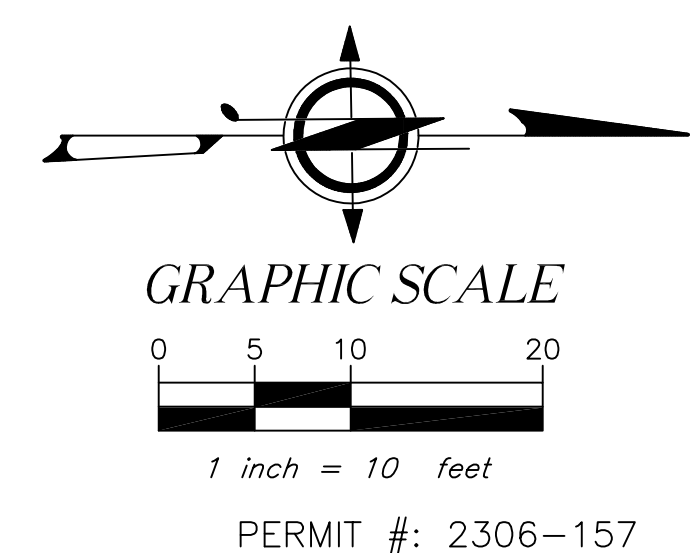

OFFICE ENGINEERS
13902 SOUTHEAST 159TH PLACE
RENTON, WASHINGTON 98058
PHONE: 425-260-3412
CONTACT: DARRELL OFFER, P.E.

JayMarc Custom Homes - Dubey Residence
Utility & Tree Plan

PROJECT: 8434 SE 39th Street
CLIENT: JayMarc Custom Homes - Dubey Residence
SHEET CONTENT: Utility & Tree Plan


DATE: 12/14/2023
JOB NO.:
DWG NO.: 2 OF 4

DESIGNED BY: DLO
DRAWN BY: SLS
CHECKED BY: DLO

REVISIONS:

| REV. NO. | DATE | DESCRIPTION |
|----------|------------|---|
| 1 | 12/14/2023 | REVISED PER CITY COMMENTS 2306-157-SUB1 |

PERMIT #: 2306-157

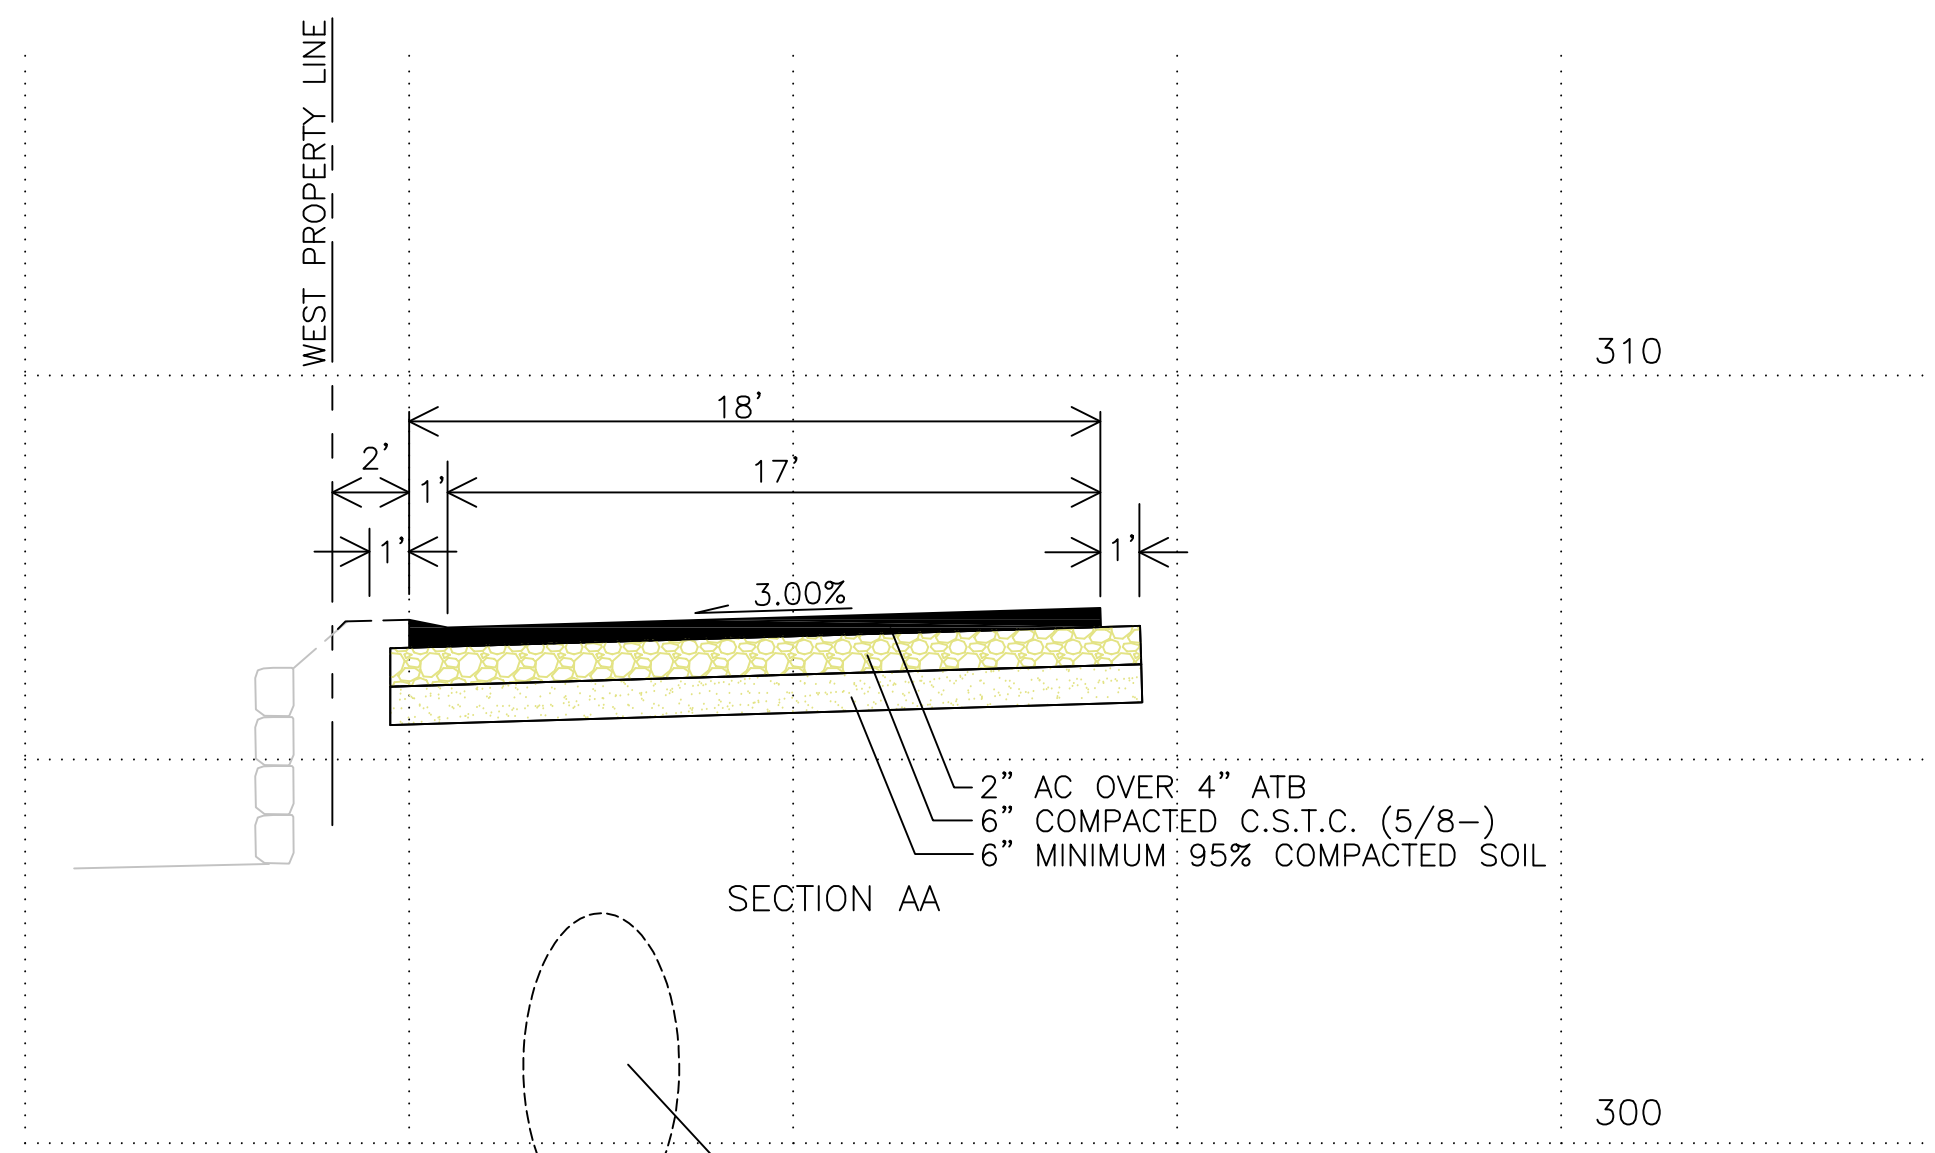

SECTION AA
SCALE:
VERTICAL: 1" = 5'
HORIZONTAL: 1" = 10'

DRAWN BY: FERN LIDDELL

| PIPE ALLOWANCES | |
|--|----------------------------------|
| PIPE MATERIAL | MAXIMUM INSIDE DIAMETER (INCHES) |
| REINFORCED OR PLAIN CONCRETE | 12" |
| ALL METAL PIPE | 15" |
| CPISP * (STD. SPEC. SECT. 9-06.20) | 12" |
| SOLID WALL PVC (STD. SPEC. SECT. 9-06.12(1)) | 15" |
| PROFILE WALL PVC (STD. SPEC. SECT. 9-06.12(2)) | 15" |

* CORRUGATED POLYETHYLENE STORM SEWER PIPE

NOTES

- As acceptable alternatives to the rebar shown in the PRECAST BASE SECTION, fibers (placed according to the Standard Specifications) or wire mesh having a minimum area of 0.12 square inches per foot shall be used with the minimum required rebar shown in the ALTERNATIVE PRECAST BASE SECTION. Wire mesh shall not be placed in the knockouts.
- The knockout diameter shall not be greater than 20" (in). Knockouts shall have a wall thickness of 2" (in) minimum to 2.5" (in) maximum. Provide a 1.5" (in) minimum gap between the knockout wall and the outside of the pipe. After the pipe is installed, fill the gap with joint mortar in accordance with Standard Specification Section 9-04.3.
- The maximum depth from the finished grade to the lowest pipe invert shall be 5' (ft).
- The frame and grate may be installed with the flange down, or integrally cast into the adjustment section with flange up.
- The Precast Base Section may have a rounded floor, and the walls may be sloped at a rate of 1 : 24 or steeper.
- The opening shall be measured at the top of the Precast Base Section.
- All pickup holes shall be grouted full after the basin has been placed.

Professional Engineer Seal: Julie Holman, No. 27480, State of Washington, License No. 2020.09.01.07.52.50 - 0700.

CATCH BASIN TYPE 1
STANDARD PLAN B-5.20-03
SHEET 1 OF 1 SHEET
APPROVED FOR PUBLICATION
Roark, Steve
Washington State Department of Transportation

Attachment 1
CITY OF MERCER ISLAND
STANDARD DETENTION SYSTEM WORKSHEET
(FOR IMPERVIOUS AREA OF 5,000 SF OR LESS)

OWNER: _____ ADDRESS: _____ PREPARED BY: _____
 PERMIT #: _____ PHONE: _____ DATE: _____
 IMPERVIOUS SURFACE AREA (SF): _____ DETENTION PIPE DIA. (INCH): _____ DETENTION PIPE LENGTH (FT): _____ OFFICE #1 DIA. _____ NOCK. ELEV. _____
 PIPE MATERIAL: _____ PIPE LENGTH (FT): _____ OFFICE #2 DIA. _____ NOCK. ELEV. _____

RESTRICTOR CATCH BASIN NOTES:

- USE A MINIMUM OF A 1/2" DIA. TYPE 2 CATCH BASIN WHEN CONNECTING PIPE MATERIALS. CONCRETE OR LOPE, A 3/4" DIA. TYPE 2 CATCH BASIN MAY BE USED FOR OTHER CIRCULAR SINGLE WALL PIPE (DIPAS AS CORROSION RESISTANT PIPE).
- OUTLET PIPE: MIN. 6 INCH.
- METAL PARTS: CORROSION RESISTANT. NON-GALVANIZED PARTS PREFERRED. GALVANIZED PIPE PARTS TO HAVE ZINC RICH LACER OR STEPS OFFSET SO:
- FRAME AND LACER OR STEPS OFFSET SO:
 - CLEANOUT GATE IS VISIBLE FROM TOP.
 - SLUMP-DOWN SPACE IS CLEAR OF RISER AND CLEANOUT GATE.
 - FRAME IS CLEAR OF CURB.
- IF METAL, OUTLET PIPE CONNECTS TO CONCRETE CONCRETE PIPE, OUTLET PIPE TO HAVE SMOOTH O.D. EQUAL TO CONCRETE PIPE I.D. LESS 1/4 IN.
- PROVIDE AT LEAST ONE 3 x 3 O.D. GAGE SUPPORT BRACKET ANCHORED TO CONCRETE WALL WITH 5/8 IN. STAINLESS STEEL EXPOSURE BOLTS OR SCHEDULED SUPPORTS 2 IN. INTO CURB WITH MIN. 1/2" VERTICAL SPACING.
- THE SHEAR GATE SHALL BE MADE OF ALUMINUM ALLOY IN ACCORDANCE WITH ASTM B 208 AND ASTM B 275. CLEANOUT GATE OR GATE BOX IN ACCORDANCE WITH ASTM A 48. CLASS ONE. THE LET FRINGE SHALL BE MADE OF ALUMINUM METAL TO THE GATE TO PREVENT GALVANIC CORROSION. IF MADE OF SOLID ROD OR HOLLOW TUBING WITH ALUMINUM HOOD AS REQUIRED. A RESTRICTOR GATE IS REQUIRED BETWEEN THE SHEAR AND FRAME AND THE GATE FLANGE. INSTALL THE GATE SO THAT THE LEVEL-LINE MARK IS LEVEL WHEN THE GATE IS CLOSED. THE MOUNTING SURFACE OF THE LET AND THE BODY SHALL BE FINISHED FOR PROPER FIT. ALL SHEAR GATE BOLTS SHALL BE STAINLESS STEEL.

STANDARD DETENTION SYSTEM NOTES:

- CALL DEVELOPMENT SERVICES (206-275-7000) 24 HOURS IN ADVANCE FOR A DETENTION SYSTEM INSPECTION BEFORE BACKFILLING AND FOR FINAL INSPECTIONS.
- RESPONSIBILITY FOR OPERATION AND MAINTENANCE OF DRAINAGE SYSTEMS OR PRIVATE PROPERTY IS RESPONSIBILITY OF THE PROPERTY OWNER. MATERIALS ACCUMULATED IN THE STORAGE PIPE MUST BE REMOVED FROM CATCH BASIN TO ALLOW PROPER OPERATION. THE VISIT CONTROL OFFICE MUST BE KEPT OPEN AT ALL TIMES.
- PIPE MATERIAL, JOINT, AND PROTECTIVE TREATMENT SHALL BE IN ACCORDANCE WITH SECTION 2.04 AND 2.05 OF THE WASHINGTON STANDARD SPECIFICATIONS FOR ROAD, BRIDGE, AND AIRPORT CONSTRUCTION, LATEST VERSION. SUCH MATERIALS INCLUDE THE FOLLOWING: LINED CORRUGATED POLYETHYLENE PIPE (DIPAS), ALUMINUM TYPE 2 CORRUGATED STEEL PIPE AND PIPE JOINTS MEETING REQUIREMENTS FOR METAL AND WELD, CORRUGATED OR SPIRAL REINFORCED ALUMINUM PIPE, OR REINFORCED CONCRETE CONCRETE CORRUGATED STEEL PIPE IS NOT ALLOWED.

RESTRICTOR CATCH BASIN DETAIL: RIM=305.00, RIM=307.57, 48" DETENTION PIPE, 2" AIR VENT, 2" INLET PIPE, 36" DIA. PIPE, IE=299.50, 36", IE=302.80, IE=299.50, 8", IE=297.50, 1/2" DIA. OFFICE DIA., INSIDE BOTTOM=295.50

CB#5, TYPE II-54" W/SOLID LOCKING LID
RIM=305.00
IE=302.30, 6"(N), 4"(S)
IE=299.50, 36"(S)

CB#2, CONTROL STRUCTURE, TYPE II-54"φ

RESTRICTOR CATCH BASIN DETAIL: RIM=305.00, RIM=307.57, 48" DETENTION PIPE, 2" AIR VENT, 2" INLET PIPE, 36" DIA. PIPE, IE=299.50, 36", IE=302.80, IE=299.50, 8", IE=297.50, 1/2" DIA. OFFICE DIA., INSIDE BOTTOM=295.50

PROJECT: 8434 SE 39th Street
 CLIENT: JayMarc Custom Homes - Dubey Residence
 SHEET CONTENT: Utility Details
 DATE: 12/14/2023
 JOB NO.:
 DWG NO.: 3 OF 4
 PERMIT #: 2306-157

DESIGNED BY: DLO
 DRAWN BY: SLS
 CHECKED BY: DLO
 REV. NO.: 12/14/2023
 DATE: 12/14/2023
 DESCRIPTION:

Professional Engineer Seal: Darrell Offe, No. 27480, State of Washington, License No. 2020.09.01.07.52.50 - 0700.


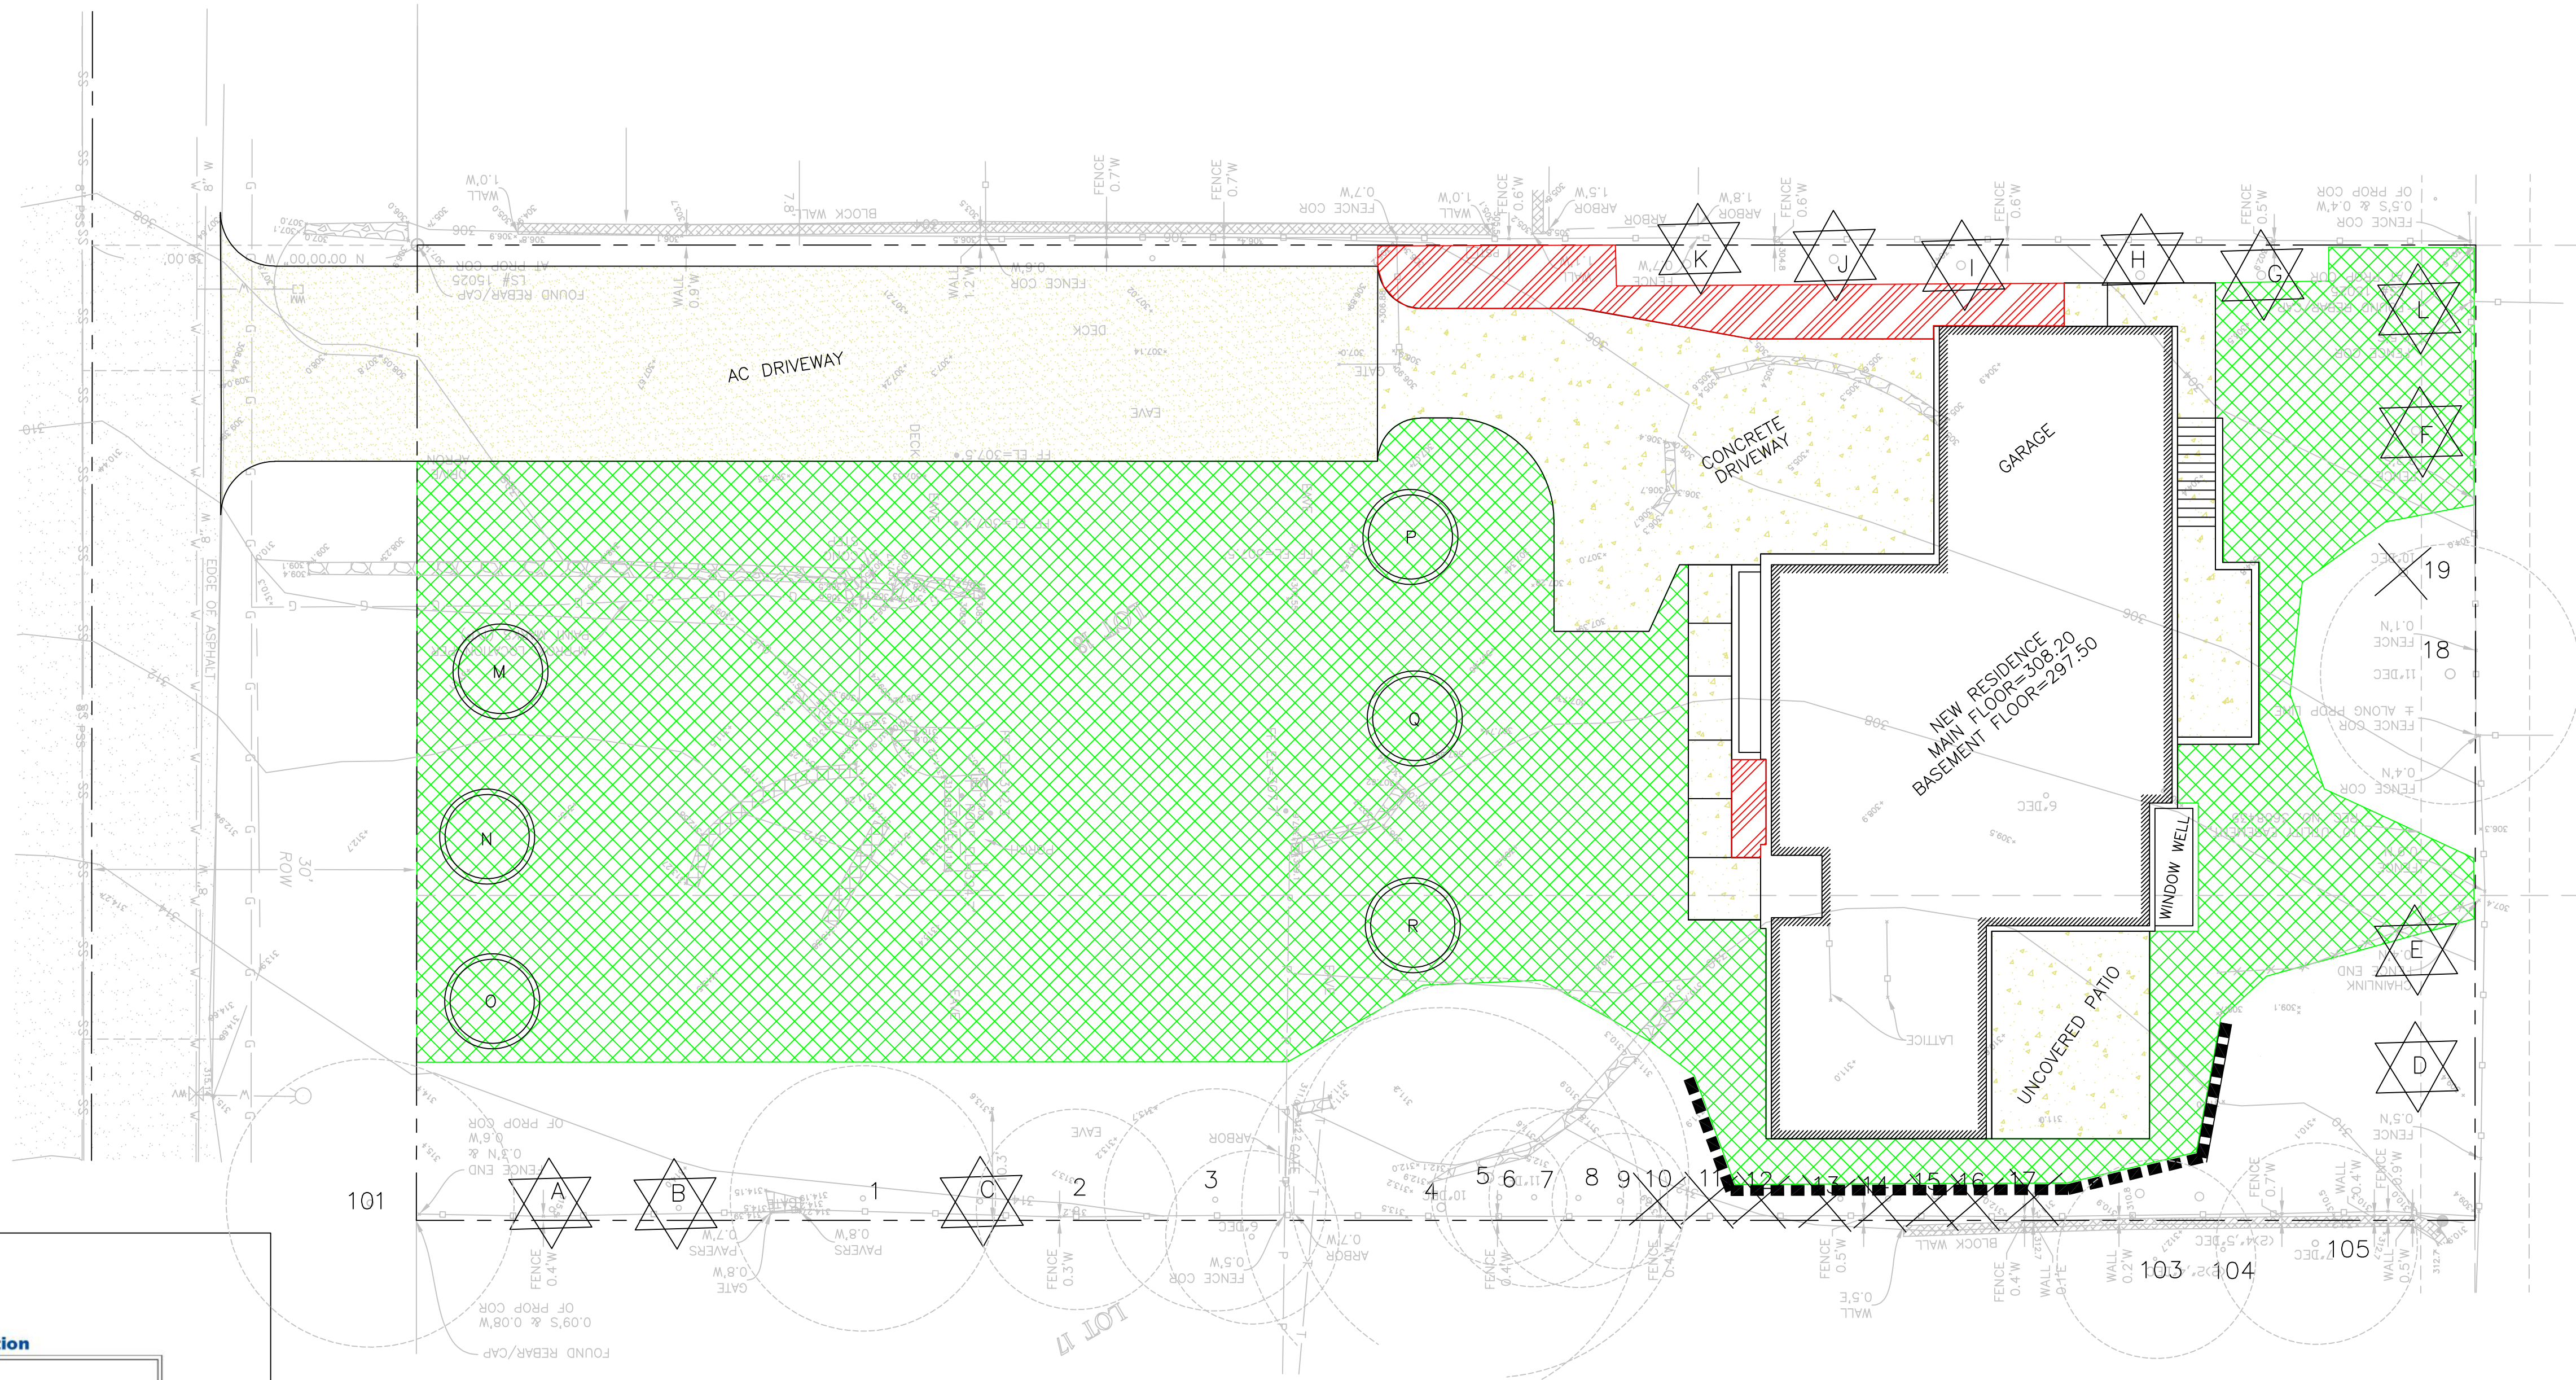


Figure V-11.1: Planting Bed Cross-Section

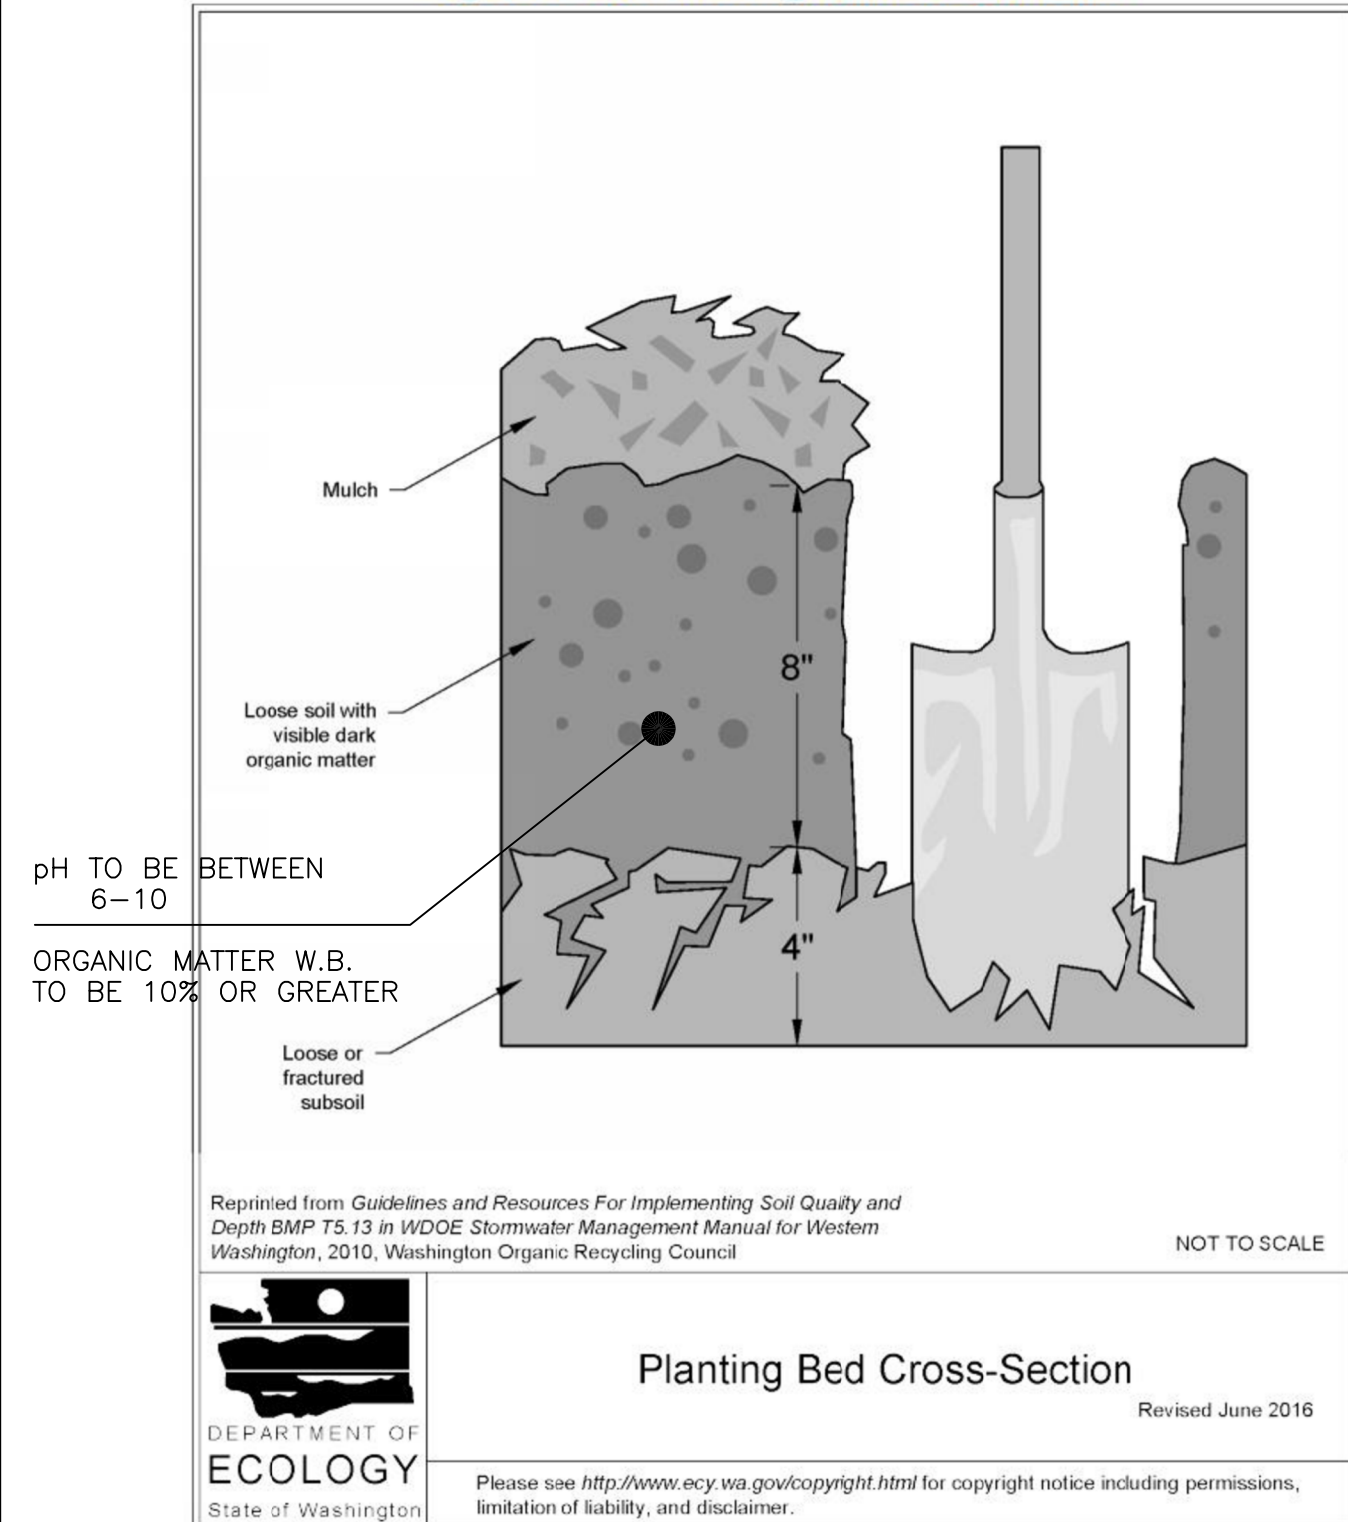

Planting Bed Cross-Section

Reprinted from Guidelines and Resources For Implementing Soil Quality and Depth BMP TS 13 in WDOE Stormwater Management Manual for Western Washington, 2010, Washington Organic Recycling Council

NOT TO SCALE



Please see <http://www.ecy.wa.gov/copyright.html> for copyright notice including permissions, limitation of liability, and disclaimer.


| 8434 SE 39th Tree Table | | | | | | | | | |
|-------------------------|-----------------|------|-------|--------|-----------|----------|----------|---------|--|
| Tree ID | Common Name | DBH | Multi | Health | Condition | Dripline | Category | Retain? | |
| 1 | Crabapple | 11.7 | Yes | 1 | 1 | 12.0 | Sig | Yes | |
| 2 | Fruiting Pear | 5 | | 1 | 2 | 9.0 | Small | Yes | |
| 3 | Crabapple | 8 | | 1 | 2 | 10.0 | Sig | Yes | |
| 4 | Pacific Dogwood | 10.5 | | 2 | 1 | 18.0 | Exc | Yes | |
| 5 | Pacific Dogwood | 11.5 | | 2 | 1 | 18.0 | Exc | Yes | |
| 6 | Japanese Cedar | 7.8 | Yes | 1 | 2 | 6.0 | Small | Yes | |
| 7 | Japanese Cedar | 7.6 | Yes | 1 | 2 | 8.0 | Small | Yes | |
| 8 | Japanese Cedar | 7 | Yes | 1 | 2 | 7.0 | Small | Yes | |
| 9 | Japanese Cedar | 6.7 | Yes | 1 | 2 | 6.0 | Small | Yes | |
| 10 | Japanese Cedar | 8.9 | Yes | 1 | 2 | 6.0 | Small | No | |
| 11 | Japanese Cedar | 11.3 | Yes | 1 | 2 | 6.0 | Sig | No | |
| 12 | Japanese Cedar | 7 | Yes | 1 | 2 | 7.0 | Small | No | |
| 13 | Japanese Cedar | 10.4 | Yes | 1 | 2 | 8.0 | Sig | No | |
| 14 | Japanese Cedar | 10.3 | Yes | 1 | 2 | 8.0 | Sig | No | |
| 15 | Japanese Cedar | 12.6 | Yes | 1 | 2 | 8.0 | Sig | No | |
| 16 | Japanese Cedar | 8.5 | Yes | 1 | 2 | 9.0 | | No | |
| 17 | Japanese Cedar | 10 | Yes | 1 | 2 | 9.0 | Sig | No | |
| 18 | Mountain Ash | 14 | Yes | 1 | 2 | 14.0 | Sig | Yes | |
| 19 | Red maple | 17.4 | | 1 | 1 | 15.0 | Sig | No | |
| TOTALS | | | | | | | | | |

| OFFSITE | | | | | | | | | |
|---------|-----------------|------------|-------|--------|-----------|----------|----------|---------|--|
| Tree ID | Common Name | DBH | Multi | Health | Condition | Dripline | Category | Retain? | |
| 101 | Common Hawthorn | 8.5 | | | | 13.0 | Sig | Yes | |
| 102 | Common Hawthorn | NOT MAPPED | | | | 13.0 | Sig | Yes | |
| 103 | Bitter Cherry | ? | | | | OH 14 | Sig | Yes | |
| 104 | Bitter Cherry | ? | | | | OH 14 | Sig | Yes | |
| 105 | Bitter Cherry | ? | | | | OH 14 | Sig | Yes | |


| Previous Replacement Trees | | | | | | | | | |
|----------------------------|--------------------|-----|-------|--------|----------------------|----------|--------------------|---------|-------------------|
| Id | Common Name | DBH | Multi | Health | Structural Condition | Dripline | Tree Size Category | Retain? | Replacements |
| A | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes | |
| B | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes | |
| C | Thunder Cloud Plum | 1.5 | | | | 5.0 | | Yes | |
| D | Himalayan cedar | 1.5 | | | | 5.0 | | no | Vine Maple |
| E | Himalayan cedar | 1.5 | | | | 5.0 | | no | Vine Maple |
| G | Himalayan cedar | 1.5 | | | | 5.0 | | no | Pacific Crabapple |
| F | Thunder Cloud Plum | 2 | | | | 5.0 | | Yes | |
| H | Himalayan cedar | 2.5 | | | | 5.0 | | no | Bitter Cherry |
| I | Himalayan cedar | 2 | | | | 5.0 | | no | Vine Maple |
| J | Himalayan cedar | 2 | | | | 5.0 | | Yes | |
| K | Himalayan cedar | 2 | | | | 5.0 | | Yes | |
| L | Thunder Cloud Plum | 2 | | | | 7.0 | | no | Cascara |
| 12 Trees | | | | | | | | | |

| New Replacement Trees | |
|-----------------------|-------------------|
| Tree ID | Common Name |
| M | Pacific Crabapple |
| N | Bitter Cherry |
| O | Vine Maple |
| P | Pacific Crabapple |
| Q | Vine Maple |
| R | Vine Maple |


Twelve Trees are Required
Only room for six
Will need to pay fee for the remainder

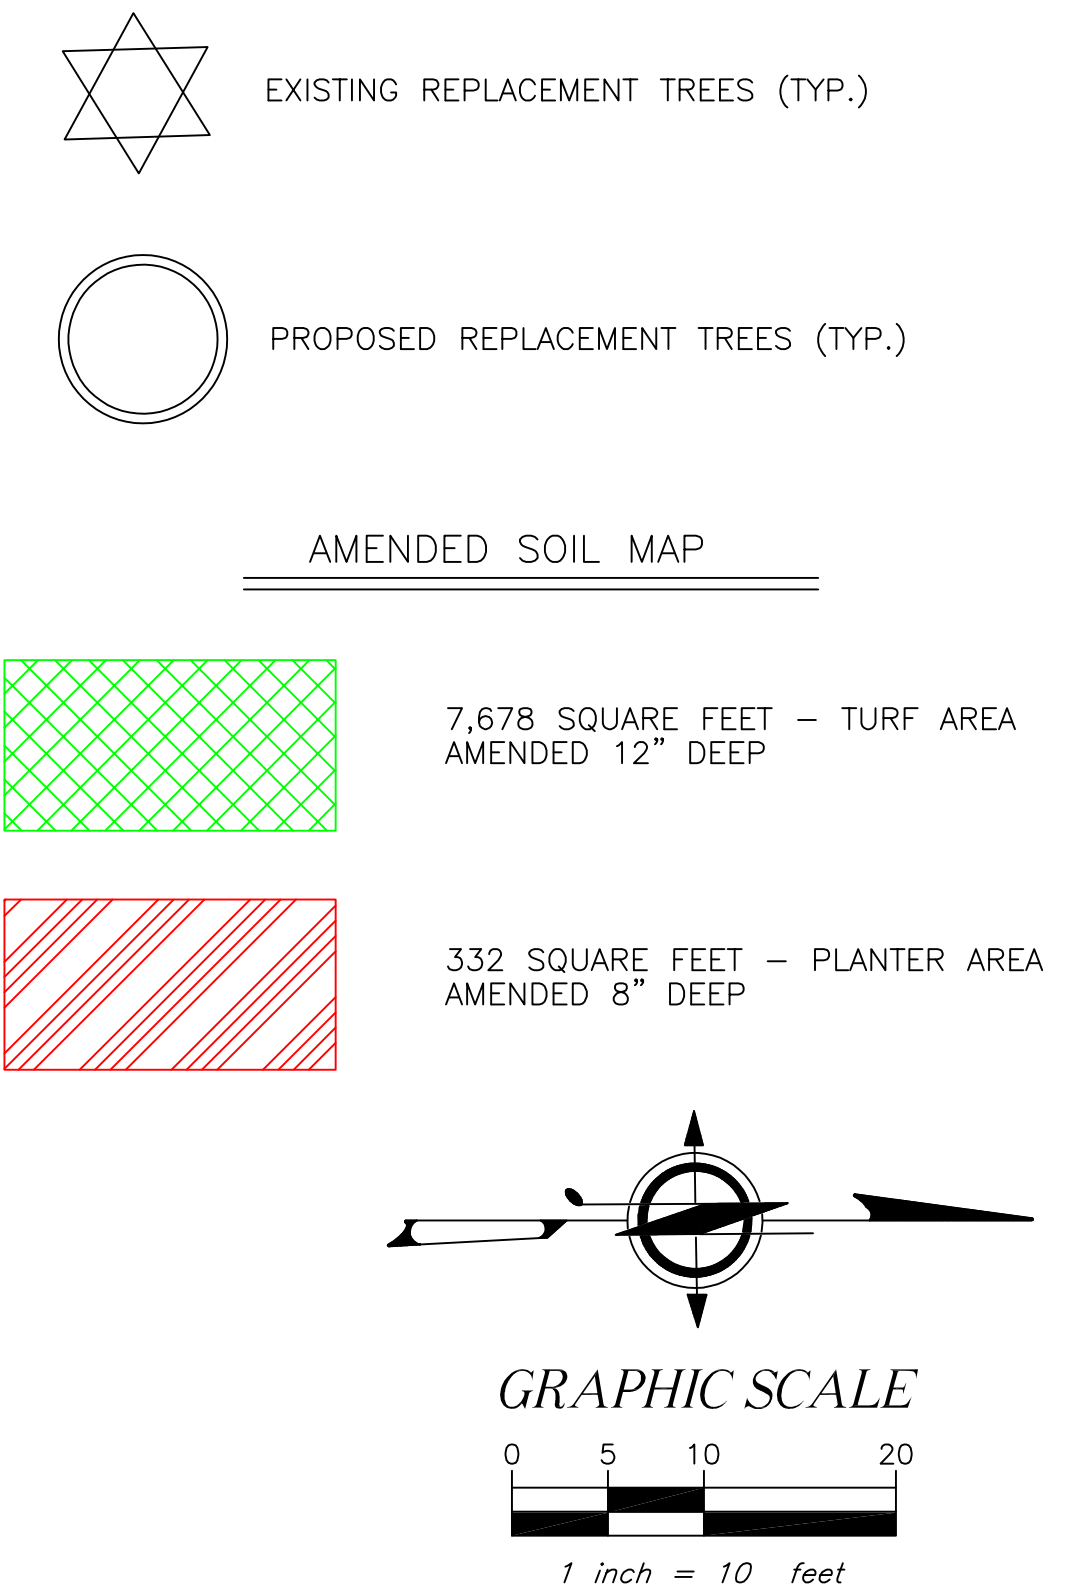

| | | | |
|---------------|---------------------------|----------|--|
| PROJECT | 8434 SE 39th Street | CLIENT | JayMarc Custom Homes - Dubey Residence |
| SHEET CONTENT | Amended Soil Map & Detail | | |
| DATE | 12/14/2023 | JOB NO. | |
| DWG NO. | 4 | SHEET | 4 |
| DESIGNED BY | DLO | DRAWN BY | SLS |
| CHECKED BY | DLO | DATE | 12/14/2023 |
| DESCRIPTION | | | |

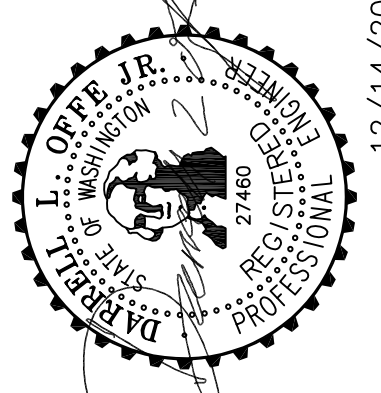

OFFE ENGINEERS
13902 SOUTHEAST 19TH PLACE
RENTON, WASHINGTON 98058
PHONE: 425-260-3412
CONTACT: DARRELL OFFE, P.E.

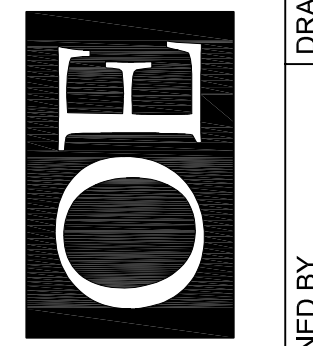

TOPOGRAPHIC & BOUNDARY SURVEY

LEGAL DESCRIPTION

THE WEST HALF OF LOT 17 AND ALL OF LOT 18, BLOCK 6, MADRONA CREST ADDITION, ACCORDING TO THE PLAT THEREOF RECORDED IN VOLUME 42 OF PLATS, PAGE 12, RECORDS OF KING COUNTY, WASHINGTON.

SITUATE IN THE COUNTY OF KING, STATE OF WASHINGTON.

BASIS OF BEARINGS

HELD A BEARING OF NORTH BETWEEN FOUND CENTERLINE MONUMENTATION ALONG 84TH AVE SE PER PLAT

REFERENCES

R1. MERCER ISLAND SHORT PLAT 97-1066, VOL. 118, PG. 135, RECORDS OF KING COUNTY, WASHINGTON.

VERTICAL DATUM

NAVD88 PER CITY OF MERCER ISLAND BENCHMARK #2150 ELEV: 325.72'

SURVEYOR'S NOTES

- THE TOPOGRAPHIC SURVEY SHOWN HEREON WAS PERFORMED IN MARCH OF 2021. THE FIELD DATA WAS COLLECTED AND RECORDED ON MAGNETIC MEDIA THROUGH AN ELECTRONIC THEODOLITE. THE DATA FILE IS ARCHIVED ON DISC OR CD. WRITTEN FIELD NOTES MAY NOT EXIST. CONTOURS ARE SHOWN FOR CONVENIENCE ONLY. DESIGN SHOULD RELY ON SPOT ELEVATIONS.
- ALL MONUMENTS SHOWN HEREON WERE LOCATED DURING THE COURSE OF THIS SURVEY UNLESS OTHERWISE NOTED.
- THE TYPES AND LOCATIONS OF ANY UTILITIES SHOWN ON THIS DRAWING ARE BASED ON INFORMATION PROVIDED TO US, BY OTHERS OR GENERAL INFORMATION READILY AVAILABLE IN THE PUBLIC DOMAIN INCLUDING, AS APPLICABLE, IDENTIFYING MARKINGS PLACED BY UTILITY LOCATE SERVICES AND OBSERVED BY TERRANE IN THE FIELD. AS SUCH, THE UTILITY INFORMATION SHOWN ON THESE DRAWINGS ARE FOR INFORMATIONAL PURPOSES ONLY AND SHOULD NOT BE RELIED ON FOR DESIGN OR CONSTRUCTION PURPOSES; TERRANE IS NOT RESPONSIBLE OR LIABLE FOR THE ACCURACY OR COMPLETENESS OF THIS UTILITY INFORMATION. FOR THE ACCURATE LOCATION AND TYPE OF UTILITIES NECESSARY FOR DESIGN AND CONSTRUCTION, PLEASE CONTACT THE SITE OWNER AND THE LOCAL UTILITY LOCATE SERVICE (800-424-5555).
- SUBJECT PROPERTY TAX PARCEL NO. 5021900691.
- SUBJECT PROPERTY AREA PER THIS SURVEY IS 17,100± S.F. (0.39 ACRES)
- THE PROPERTY DESCRIBED HEREON IS THE SAME AS THE PROPERTY DESCRIBED IN CHICAGO TITLE COMPANY OF WASHINGTON COMMITMENT NO. 0202451-ETU, WITH AN EFFECTIVE DATE OF FEBRUARY 4, 2021 AND THAT ALL EASEMENTS, COVENANTS, AND RESTRICTIONS REFERENCED IN SAID TITLE COMMITMENT OR APPARENT FROM A PHYSICAL INSPECTION OF THE PROPERTY OR OTHERWISE KNOWN TO ME HAVE BEEN PLOTTED HEREON OR OTHERWISE NOTED AS TO THEIR EFFECT ON THE PROPERTY.
- FIELD DATA FOR THIS SURVEY WAS OBTAINED BY DIRECT FIELD MEASUREMENTS WITH A CALIBRATED ELECTRONIC 5-SECOND TOTAL STATION AND/OR SURVEY GRADE GPS OBSERVATIONS. ALL ANGULAR AND LINEAR RELATIONSHIPS ARE ACCURATE AND MEET THE STANDARDS SET BY WAC 332-130-090.

LEGEND

| | | | |
|--|--------------------------|--|------------------------|
| | ASPHALT SURFACE | | PAVER SURFACE |
| | BUILDING | | POST |
| | CENTERLINE ROW | | POWER METER |
| | CONCRETE SURFACE | | POWER (OVERHEAD) |
| | RETAINING WALL | | POWER POLE |
| | EASEMENT AREA | | REBAR AS NOTED (FOUND) |
| | DECK | | REBAR & CAP (SET) |
| | FENCE LINE (WIRE) | | ROCKERY |
| | FENCE LINE (WOOD) | | SEWER LINE |
| | FIRE HYDRANT | | SEWER MANHOLE |
| | GAS LINE | | TELEPHONE (OVERHEAD) |
| | GAS METER | | TREE (AS NOTED) |
| | GRAVEL SURFACE | | WATER LINE |
| | MAILBOX (RESIDENTIAL) | | WATER METER |
| | MONUMENT IN CASE (FOUND) | | WATER VALVE |

VICINITY MAP

N.T.S.




SCHEDULE B ITEMS

- COVENANTS, CONDITIONS, RESTRICTIONS, RECITALS, RESERVATIONS, EASEMENTS, EASEMENT PROVISIONS, DEDICATIONS, BUILDING SETBACK LINES, NOTES, STATEMENTS, AND OTHER MATTERS, IF ANY, INCLUDING BUT NOT LIMITED TO THOSE BASED UPON RACE, COLOR, RELIGION, SEX, SEXUAL ORIENTATION, FAMILIAL STATUS, MARITAL STATUS, DISABILITY, HANDICAP, NATIONAL ORIGIN, ANCESTRY, OR SOURCE OF INCOME, AS SET FORTH IN APPLICABLE STATE OR FEDERAL LAWS, EXCEPT TO THE EXTENT THAT SAID COVENANT OR RESTRICTION IS PERMITTED BY APPLICABLE LAW, AS SET FORTH ON MADRONA CREST ADDITION; RECORDING NO: 3601309 (BLANKET IN NATURE)
- COVENANTS, CONDITIONS, RESTRICTIONS AND EASEMENTS BUT OMITTING ANY COVENANTS OR RESTRICTIONS, IF ANY, INCLUDING BUT NOT LIMITED TO THOSE BASED UPON RACE, COLOR, RELIGION, SEX, SEXUAL ORIENTATION, FAMILIAL STATUS, MARITAL STATUS, DISABILITY, HANDICAP, NATIONAL ORIGIN, ANCESTRY, SOURCE OF INCOME, GENDER, GENDER IDENTITY, GENDER EXPRESSION, MEDICAL CONDITION OR GENETIC INFORMATION, AS SET FORTH IN APPLICABLE STATE OR FEDERAL LAWS, EXCEPT TO THE EXTENT THAT SAID COVENANT OR RESTRICTION IS PERMITTED BY APPLICABLE LAW, AS SET FORTH IN THE DOCUMENT RECORDING DATE: SEPTEMBER 17, 1948 RECORDING NO: 3608435 (SETBACKS AND EASEMENT PLOTTED- OTHER RESTRICTIONS APPLY)
- NOTICE OF ADDITIONAL TAP OR CONNECTION CHARGES AND THE TERMS AND CONDITIONS THEREOF: RECORDING DATE: DECEMBER 6, 1977 RECORDING NO: 7712060812 (BLANKET IN NATURE)
- COVENANTS, CONDITIONS, RESTRICTIONS, RECITALS, RESERVATIONS, EASEMENTS, EASEMENT PROVISIONS, DEDICATIONS, BUILDING SETBACK LINES, NOTES, STATEMENTS, AND OTHER MATTERS, IF ANY, INCLUDING BUT NOT LIMITED TO THOSE BASED UPON RACE, COLOR, RELIGION, SEX, SEXUAL ORIENTATION, FAMILIAL STATUS, MARITAL STATUS, DISABILITY, HANDICAP, NATIONAL ORIGIN, ANCESTRY, OR SOURCE OF INCOME, AS SET FORTH IN APPLICABLE STATE OR FEDERAL LAWS, EXCEPT TO THE EXTENT THAT SAID COVENANT OR RESTRICTION IS PERMITTED BY APPLICABLE LAW, AS SET FORTH ON SURVEY; RECORDING NO: 9711199012 (CURRENT CONDITIONS SHOWN HEREON)
- COVENANTS, CONDITIONS, RESTRICTIONS, RECITALS, RESERVATIONS, EASEMENTS, EASEMENT PROVISIONS, DEDICATIONS, BUILDING SETBACK LINES, NOTES, STATEMENTS, AND OTHER MATTERS, IF ANY, INCLUDING BUT NOT LIMITED TO THOSE BASED UPON RACE, COLOR, RELIGION, SEX, SEXUAL ORIENTATION, FAMILIAL STATUS, MARITAL STATUS, DISABILITY, HANDICAP, NATIONAL ORIGIN, ANCESTRY, OR SOURCE OF INCOME, AS SET FORTH IN APPLICABLE STATE OR FEDERAL LAWS, EXCEPT TO THE EXTENT THAT SAID COVENANT OR RESTRICTION IS PERMITTED BY APPLICABLE LAW, AS SET FORTH ON SURVEY; RECORDING NO: 20040623900006 (CURRENT CONDITIONS SHOWN HEREON)

STEEP SLOPE/BUFFER DISCLAIMER:

THE LOCATION AND EXTENT OF STEEP SLOPES SHOWN ON THIS DRAWING ARE FOR INFORMATIONAL PURPOSES ONLY AND CANNOT BE RELIED ON FOR DESIGN AND/OR CONSTRUCTION. THE PITCH, LOCATION, AND EXTENT ARE BASED SOLELY ON OUR GENERAL OBSERVATIONS ON SITE AND OUR CURSORY REVIEW OF READILY AVAILABLE PUBLIC DOCUMENTS, AS SUCH, TERRANE CANNOT BE LIABLE OR RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF ANY STEEP SLOPE INFORMATION. ULTIMATELY, THE LIMITS AND EXTENT OF ANY STEEP SLOPES ASSOCIATED WITH ANY SETBACKS OR OTHER DESIGN OR CONSTRUCTION PARAMETERS MUST BE DISCUSSED AND APPROVED BY THE REVIEWING AGENCY BEFORE ANY CONSTRUCTION CAN OCCUR.

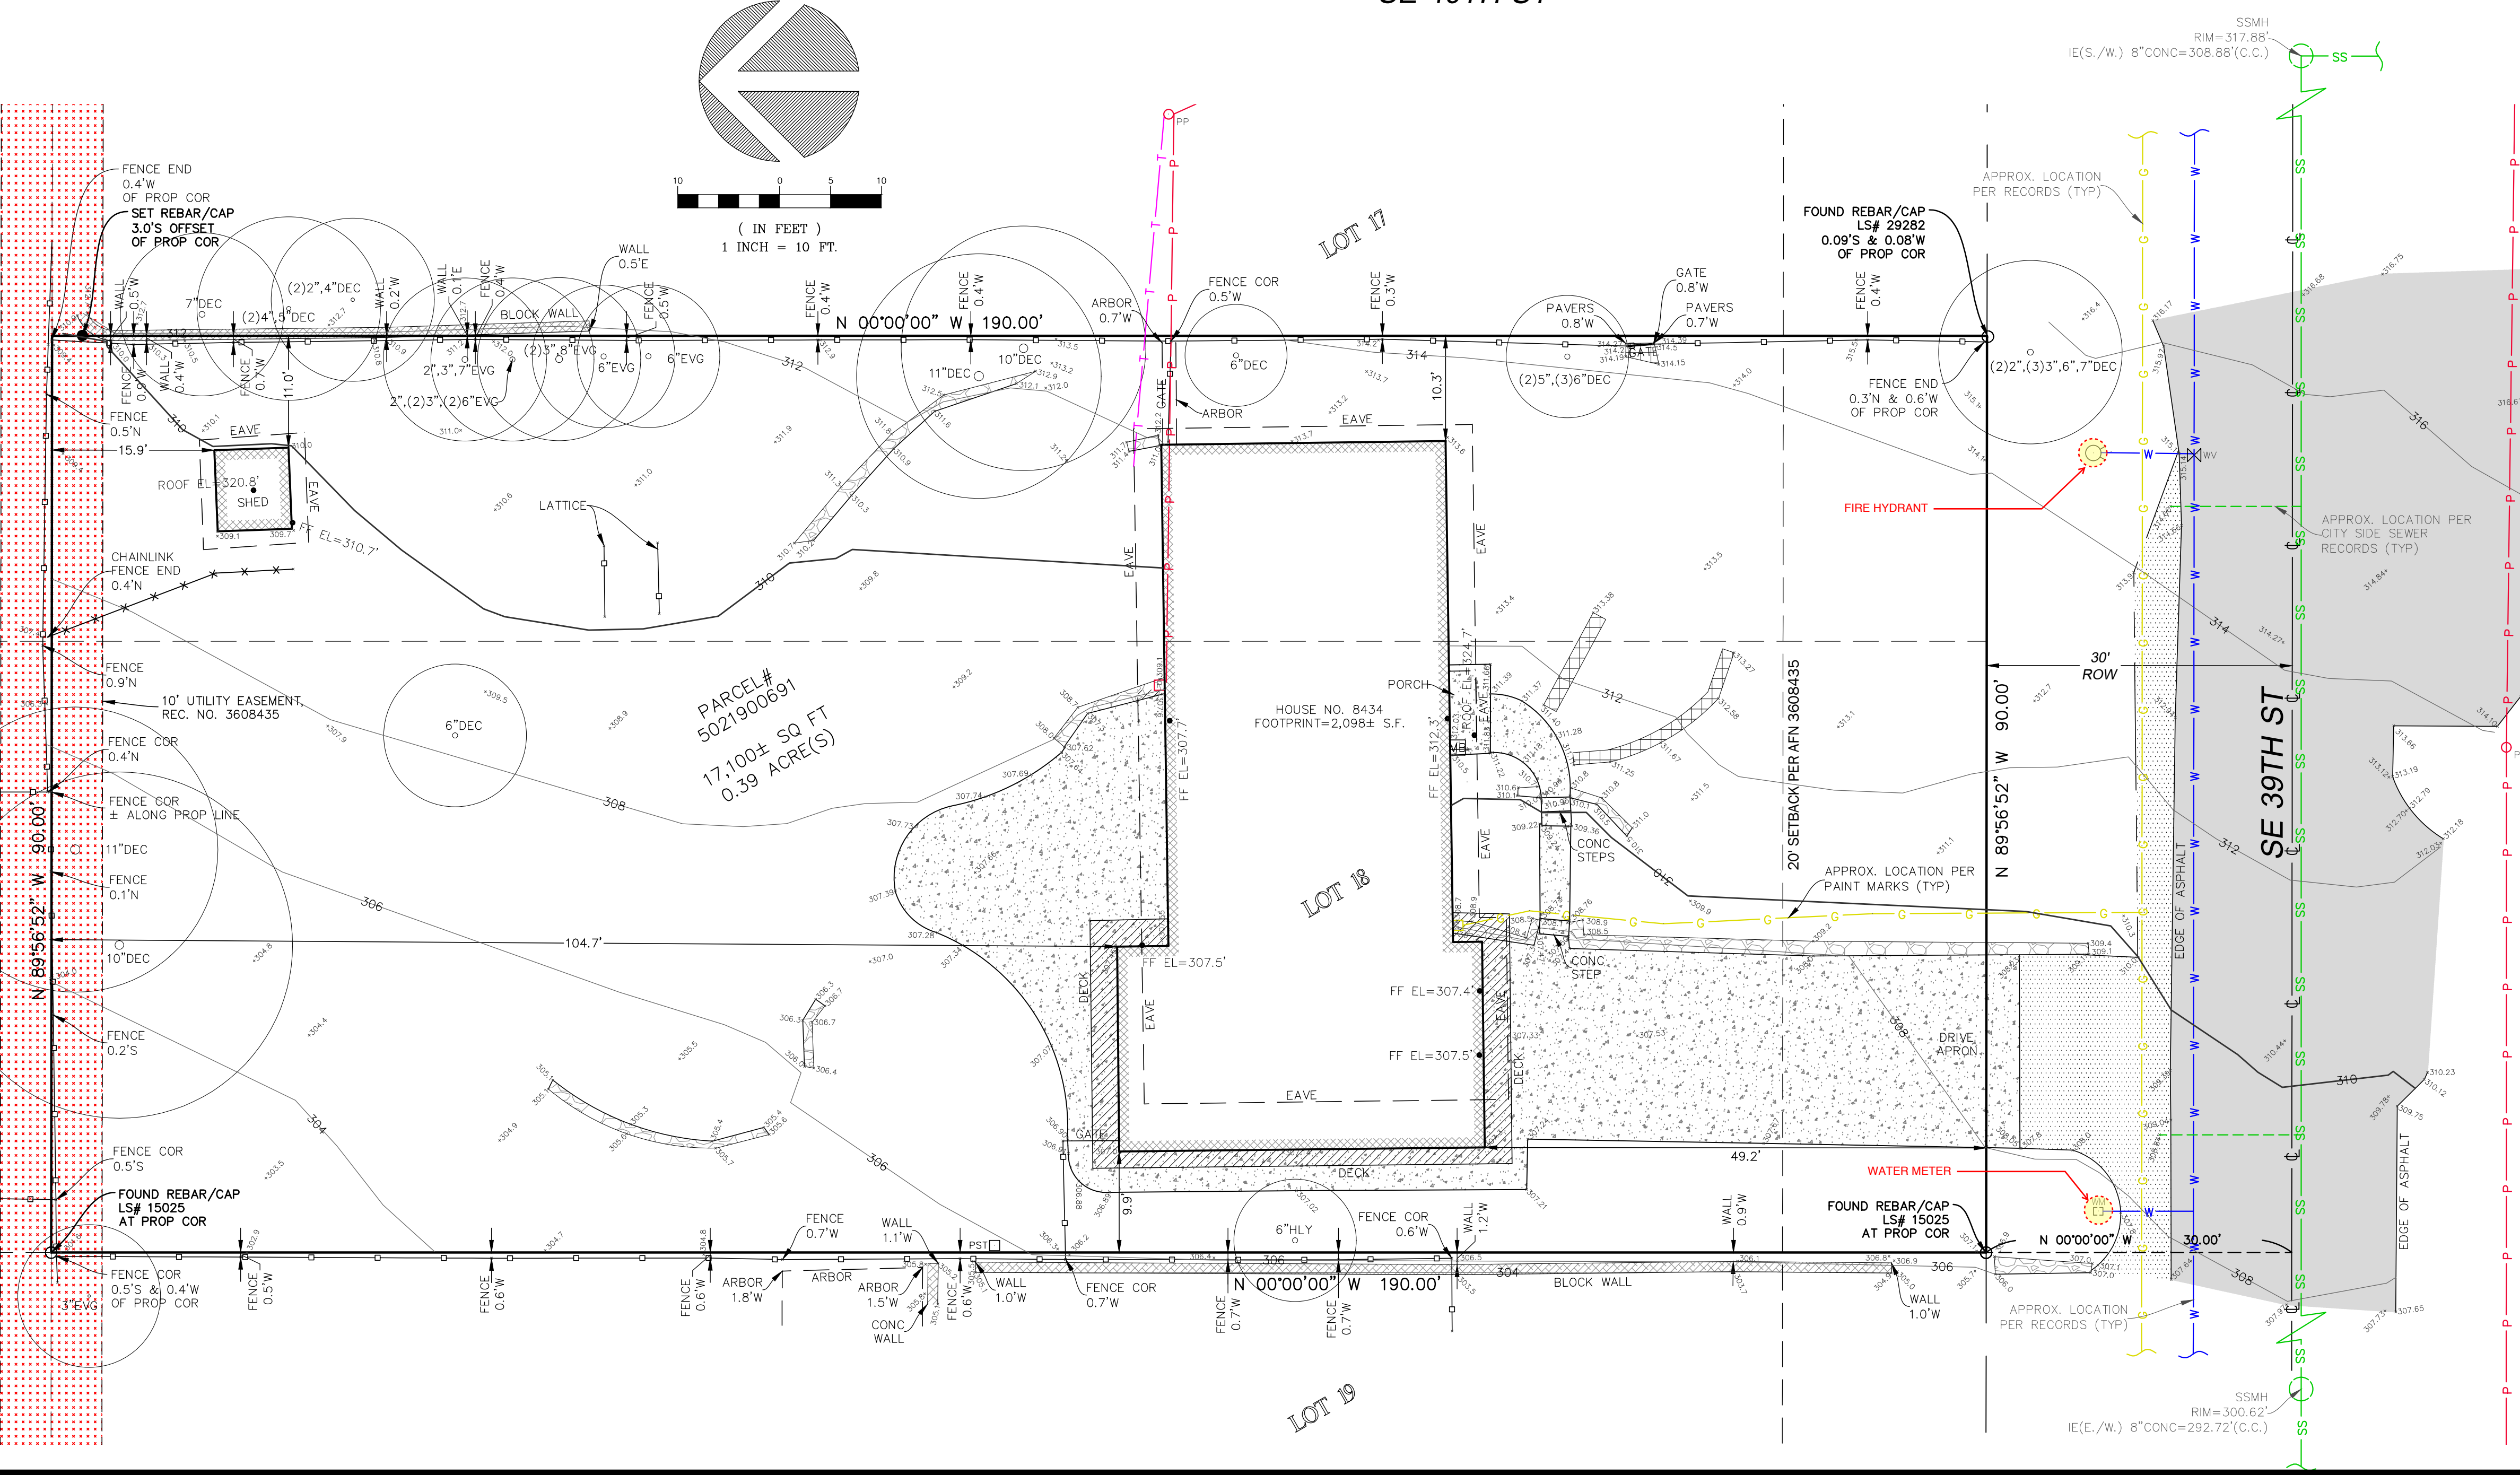


INDEXING INFORMATION

| | |
|--------|--------|
| SW 1/4 | SE 1/4 |
| NW 1/4 | NE 1/4 |
| SW 1/4 | SE 1/4 |
| NW 1/4 | NE 1/4 |

SECTION: 07
TOWNSHIP: 24N
RANGE: 05E, W.M.
COUNTY: KING

TOPOGRAPHIC & BOUNDARY SURVEY
PARCEL NO. 5021900691

DUBEY RESIDENCE
8434 SE 39TH ST
MERCER ISLAND, WA 98040

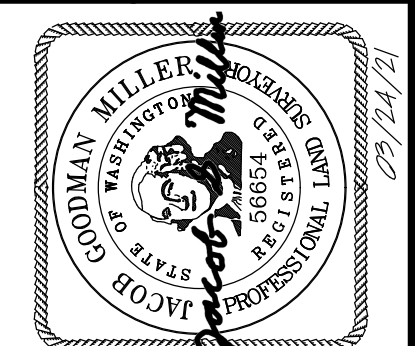

Terrane

10801 Main Street, Suite 102, Bellevue, WA 98004
phone 425.458.4488 support@terrane.net
www.terrane.net

| | |
|------------------|----------|
| JOB NUMBER: | 210366 |
| DATE: | 03/24/21 |
| DRAFTED BY: | RSN |
| CHECKED BY: | JGM/CSP |
| SCALE: | 1" = 10' |
| REVISION HISTORY | |
| | |
| SHEET NUMBER | |
| 1 OF 1 | |

measure success