
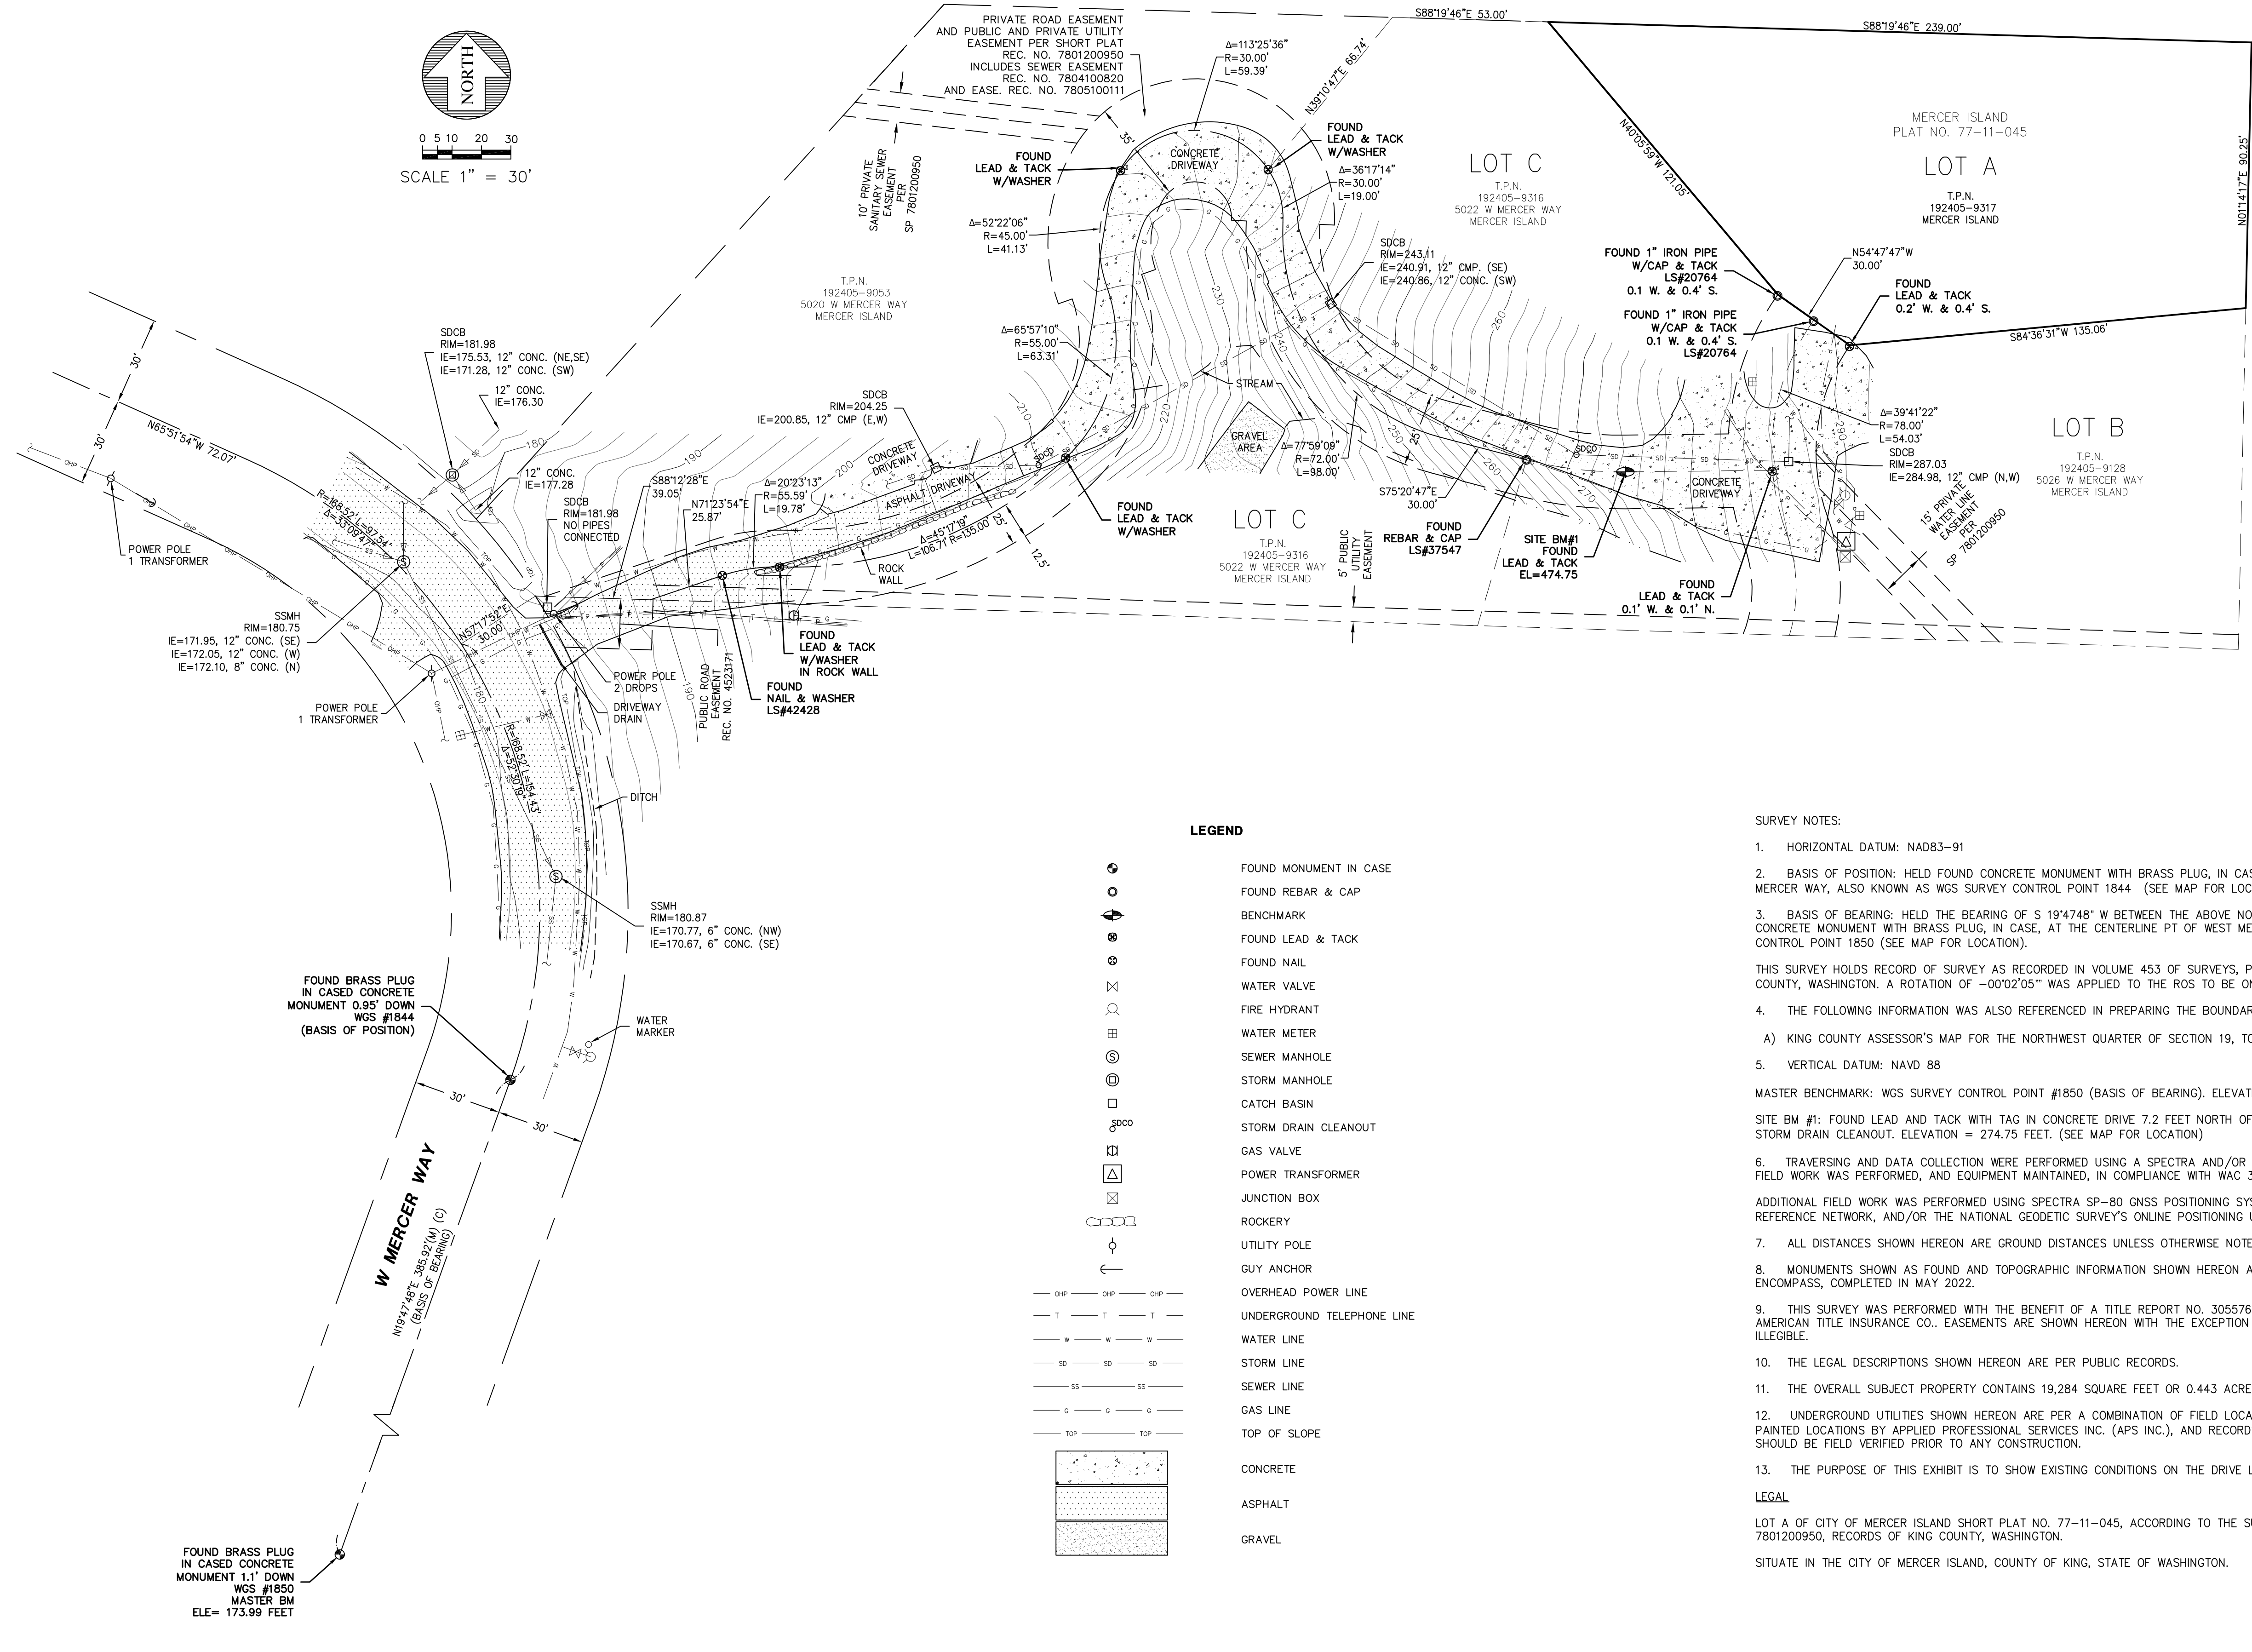


HARVEY CHEN

A PORTION OF THE NW 1/4 OF THE NW 1/4 OF SEC. 19, T 24 N., R 05 E., W.M.
KING COUNTY, STATE OF WASHINGTON

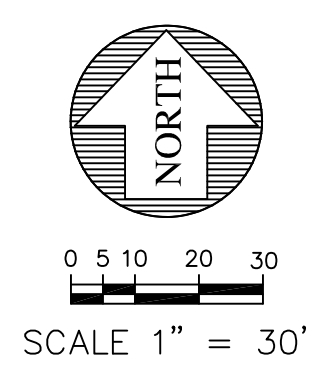

LEGEND

- FOUND MONUMENT IN CASE
- FOUND REBAR & CAP
- BENCHMARK
- FOUND LEAD & TACK
- FOUND NAIL
- WATER VALVE
- FIRE HYDRANT
- WATER METER
- SEWER MANHOLE
- STORM MANHOLE
- CATCH BASIN
- STORM DRAIN CLEANOUT
- GAS VALVE
- POWER TRANSFORMER
- JUNCTION BOX
- ROCKERY
- UTILITY POLE
- GUY ANCHOR
- OVERHEAD POWER LINE
- UNDERGROUND TELEPHONE LINE
- WATER LINE
- STORM LINE
- SEWER LINE
- GAS LINE
- TOP OF SLOPE
- CONCRETE
- ASPHALT
- GRAVEL


SURVEY NOTES:

1. HORIZONTAL DATUM: NAD83-91
 2. BASIS OF POSITION: HELD FOUND CONCRETE MONUMENT WITH BRASS PLUG, IN CASE, AT THE CENTERLINE PC OF WEST MERCER WAY, ALSO KNOWN AS WGS SURVEY CONTROL POINT 1844 (SEE MAP FOR LOCATION).
 3. BASIS OF BEARING: HELD THE BEARING OF S 19°47'48" W BETWEEN THE ABOVE NOTED BASIS OF POSITION AND THE FOUND CONCRETE MONUMENT WITH BRASS PLUG, IN CASE, AT THE CENTERLINE PT OF WEST MERCER WAY, ALSO KNOWN AS WGS SURVEY CONTROL POINT 1850 (SEE MAP FOR LOCATION).
- THIS SURVEY HOLDS RECORD OF SURVEY AS RECORDED IN VOLUME 453 OF SURVEYS, PAGE 132, RECORDS OF KING COUNTY, WASHINGTON. A ROTATION OF -00°02'05" WAS APPLIED TO THE ROS TO BE ON THE ABOVE NOTED DATUM.
4. THE FOLLOWING INFORMATION WAS ALSO REFERENCED IN PREPARING THE BOUNDARY SHOWN HERE ON:
 - A) KING COUNTY ASSESSOR'S MAP FOR THE NORTHWEST QUARTER OF SECTION 19, TOWNSHIP 24N, RANGE 5E, W.M.
 5. VERTICAL DATUM: NAVD 88
- MASTER BENCHMARK: WGS SURVEY CONTROL POINT #1850 (BASIS OF BEARING). ELEVATION = 173.99 FEET.
- SITE BM #1: FOUND LEAD AND TACK WITH TAG IN CONCRETE DRIVE 7.2 FEET NORTH OF SOUTH EDGE AND 18.5 FEET EAST OF STORM DRAIN CLEANOUT. ELEVATION = 274.75 FEET. (SEE MAP FOR LOCATION)
6. TRAVERSING AND DATA COLLECTION WERE PERFORMED USING A SPECTRA AND/OR TRIMBLE 5 SECOND TOTAL STATION. ALL FIELD WORK WAS PERFORMED, AND EQUIPMENT MAINTAINED, IN COMPLIANCE WITH WAC 332-130.
 7. ALL DISTANCES SHOWN HEREON ARE GROUND DISTANCES UNLESS OTHERWISE NOTED.
 8. MONUMENTS SHOWN AS FOUND AND TOPOGRAPHIC INFORMATION SHOWN HEREON ARE THE RESULT OF A SURVEY BY ENCOMPASS, COMPLETED IN MAY 2022.
 9. THIS SURVEY WAS PERFORMED WITH THE BENEFIT OF A TITLE REPORT NO. 3055767 DATED JUNE 11, 2018 BY FIRST AMERICAN TITLE INSURANCE CO. EASEMENTS ARE SHOWN HEREON WITH THE EXCEPTION OF EASEMENT NO. 5990949, WHICH WAS ILLEGIBLE.
 10. THE LEGAL DESCRIPTIONS SHOWN HEREON ARE PER PUBLIC RECORDS.
 11. THE OVERALL SUBJECT PROPERTY CONTAINS 19,284 SQUARE FEET OR 0.443 ACRES MORE OR LESS.
 12. UNDERGROUND UTILITIES SHOWN HEREON ARE PER A COMBINATION OF FIELD LOCATED SURFACE OBSERVABLE FEATURES, PAINTED LOCATIONS BY APPLIED PROFESSIONAL SERVICES INC. (APS INC.), AND RECORDS OF THE APPLICABLE UTILITIES AND SHOULD BE FIELD VERIFIED PRIOR TO ANY CONSTRUCTION.
 13. THE PURPOSE OF THIS EXHIBIT IS TO SHOW EXISTING CONDITIONS ON THE DRIVE LEADING TO THE SUBJECT PROPERTY.

LEGAL

LOT A OF CITY OF MERCER ISLAND SHORT PLAT NO. 77-11-045, ACCORDING TO THE SURVEY RECORDED UNDER RECORDING NO. 7801200950, RECORDS OF KING COUNTY, WASHINGTON.
SITUATE IN THE CITY OF MERCER ISLAND, COUNTY OF KING, STATE OF WASHINGTON.


REVISIONS	DESCRIPTION	BY	DATE

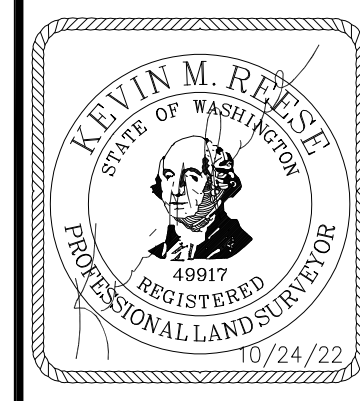

BOUNDARY TOPOGRAPHIC SURVEY
FOR
HARVEY CHEN

Encompass
 ENGINEERING & SURVEYING
 Western Washington Division
 165 NE Juniper Street, Suite 700 • Phone: (425) 392-0250
 Eastern Washington Division
 407 Southwater Blvd. • Clk. Elem. WA 98922 • Phone: (509) 674-7433

JOB NO.	22576
DATE	10/24/22
SCALE	1" = 30'
DESIGNED	N/A
DRAWN	LFM
CHECKED	JLS
APPROVED	KMR
SHEET	1 OF 1

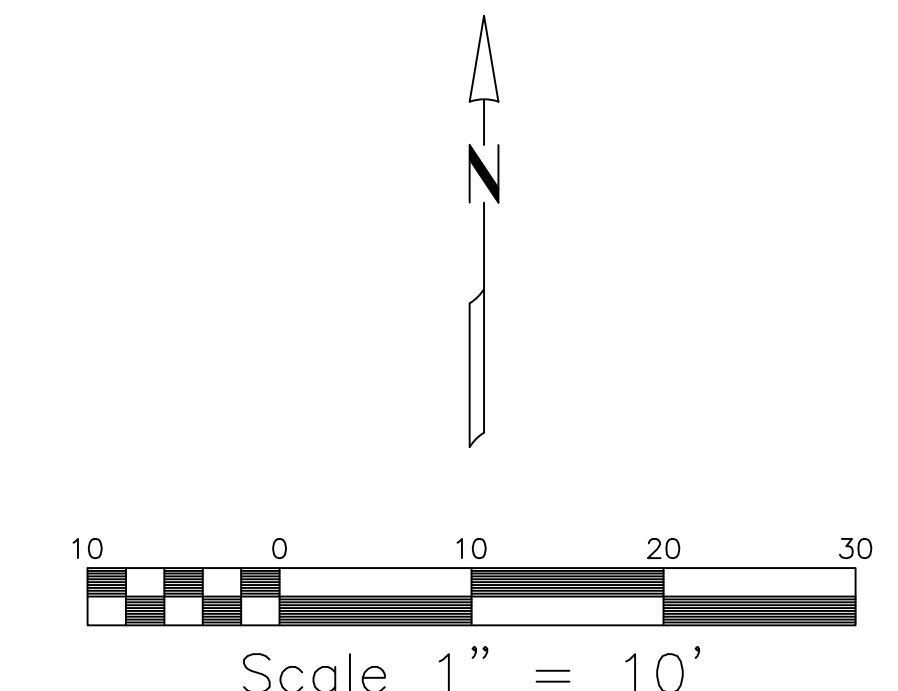

MERIDIAN
ASSUMED

DATUM
NAVD 88

CONTOUR INTERVAL = 2'
1' CONTOUR AREA AS SHOWN

LEGAL DESCRIPTION

THAT PORTION OF THE S 1/2 OF THE NW 1/4 OF THE NW 1/4 OF SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON DESCRIBED AS FOLLOWS: COMMENCING AT THE SOUTHWEST CORNER OF SAID SUBDIVISION; THENCE N 01°16'04" E ALONG THE EASTERLY LINE THEREOF, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 200.00 FEET; THENCE N 01°16'04" E, A DISTANCE OF 116.00 FEET TO THE TRUE POINT OF BEGINNING; THENCE S 84°38'18" W, A DISTANCE OF 135.06 FEET; THENCE N 54°46'00" W, A DISTANCE OF 30.00 FEET; THENCE N 40°04'12" W, A DISTANCE OF 121.05 FEET TO THE SOUTHERLY BOUNDARY OF MERHAVEN DIVISION NO. 3, AS RECORDED IN VOLUME 68 OF PLATS, PAGES 7 AND 8, RECORDS OF KING COUNTY, WASHINGTON; THENCE 86°17'59" E ALONG SAID SOUTHERLY BOUNDARY LINE, A DISTANCE OF 239.00 FEET; THENCE S 01°16'04" W, A DISTANCE OF 90.25 FEET TO THE TRUE POINT OF BEGINNING.

TOGETHER WITH AND SUBJECT TO A PRIVATE ROAD EASEMENT AND PUBLIC AND PRIVATE UTILITY EASEMENT OVER AND ACROSS THE FOLLOWING DESCRIBED PROPERTY: A STRIP OF LAND 25 FEET WIDE LYING 12.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: THAT PORTION OF THE S 1/2 OF THE NW 1/4 OF THE NW 1/4 OF SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS: COMMENCING AT THE SOUTHWEST CORNER OF SAID SUBDIVISION; THENCE N 01°16'04" E ALONG THE EASTERLY LINE THEREOF, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 739.80 FEET TO THE TRUE POINT OF BEGINNING; THENCE N 71°25'41" E, A DISTANCE OF 25.87 FEET TO A TANGENT CURVE TO THE RIGHT HAVING A RADIUS OF 55.59 FEET; THENCE EASTERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 20°23'38", AN ARC DISTANCE OF 19.79 FEET TO A REVERSE CURVE HAVING A RADIUS OF 135.00 FEET; THENCE NORTHEASTERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 45°17'19", AN ARC DISTANCE OF 106.71 FEET TO A COMPOUND CURVE HAVING A RADIUS OF 55.00 FEET; THENCE NORTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 65°57'00", AN ARC DISTANCE OF 63.31 FEET TO A POINT HERINAFTER DESCRIBED AS POINT "A" AND TERMINUS OF SAID 25-FOOT STRIP OF LAND.

TOGETHER WITH A STRIP OF LAND 35 FEET WIDE LYING 17.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: BEGINNING AT AFOREMENTIONED POINT "A", SAID POINT LYING ON A CURVE HAVING A RADIUS OF 45.00 FEET AND HAVING A RADIAL BEARING OF N 70°55'00" E; THENCE NORTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 52°22'00", AN ARC DISTANCE OF 41.13 FEET TO A COMPOUND CURVE HAVING A RADIUS OF 50.00 FEET; THENCE EASTERLY AND SOUTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 149°43'00", AN ARC DISTANCE OF 78.39 FEET TO A POINT HERINAFTER DESCRIBED AS POINT "B", SAID POINT BEING THE TERMINUS OF SAID 35-FOOT STRIP OF LAND.


TOGETHER WITH A STRIP OF LAND 25 FEET WIDE LYING 12.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: BEGINNING AT AFOREMENTIONED POINT "B", SAID POINT LYING ON A CURVE HAVING A RADIUS OF 72.00 FEET AND HAVING A RADIAL BEARING OF S 87°20'00" E; THENCE SOUTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 77°59'00", AN ARC DISTANCE OF 98.00 FEET; THENCE S 75°19'00" E, A DISTANCE OF 30.00 FEET TO A TANGENT CURVE TO THE LEFT HAVING A RADIUS OF 127.00 FEET; THENCE EASTERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 15°19'00", AN ARC DISTANCE OF 33.95 FEET; THENCE N 89°22'00" E, A DISTANCE OF 50.02 FEET TO A POINT HERINAFTER DESCRIBED AS POINT "C", SAID POINT BEING THE TERMINUS OF SAID 25-FOOT STRIP OF LAND.

TOGETHER WITH A STRIP OF LAND 30 FEET WIDE LYING 15 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: BEGINNING AT AFOREMENTIONED POINT "C", SAID POINT LYING ON A CURVE HAVING A RADIUS OF 78.00 FEET AND HAVING A RADIAL BEARING OF N 85°33'01" E; THENCE NORTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 55°22'00", AN ARC DISTANCE OF 75.46 FEET TO A REVERSE CURVE HAVING A RADIUS OF 56.00 FEET; THENCE SOUTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 36°42'00", AN ARC DISTANCE OF 55.85 FEET TO A POINT ON THE NORTHERLY LINE OF WESTAIR ESTATES, AS RECORDED IN VOLUME 104 OF PLATS, PAGES 18 AND 19, RECORDS OF KING COUNTY, WASHINGTON, SAID POINT BEING THE TERMINUS OF SAID EASEMENT.

TOGETHER WITH A PRIVATE AND PUBLIC ROAD EASEMENT AND PRIVATE AND PUBLIC UTILITY EASEMENT AS GRANTED BY INSTRUMENT RECORDED IN DECEMBER 29, 1954, UNDER AUDITOR'S FILE NUMBER 4523171 AND RESERVED BY INSTRUMENT RECORDED AUGUST 28, 1957, UNDER AUDITOR'S FILE NO. 4828502.

TOGETHER WITH A PUBLIC AND PRIVATE SANITARY SEWER EASEMENT OVER AND ACROSS THE FOLLOWING DESCRIBED PROPERTY: A STRIP OF LAND 10 FEET WIDE LYING 5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: COMMENCING AT THE SOUTHWEST CORNER OF LOT 9, MERHAVEN DIVISION NO. 2, AS RECORDED IN VOLUME 67 OF PLATS, PAGES 27 AND 28, RECORDS OF KING COUNTY, WASHINGTON; THENCE N 88°17'59" W, A DISTANCE OF 0.08 FEET; THENCE S 42°17'56" W, A DISTANCE OF 45.00 FEET TO THE TRUE POINT OF BEGINNING; THENCE S 83°17'59" E, A DISTANCE OF 78.34 FEET, MORE OR LESS, TO THE WEST LINE OF THE PREVIOUSLY DESCRIBED 35-FOOT WIDE STRIP OF LAND.

TOGETHER WITH A PRIVATE WATER LINE EASEMENT OVER AND ACROSS THE FOLLOWING DESCRIBED PROPERTY: A STRIP OF LAND 15 FEET WIDE LYING 7.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: THAT PORTION OF THE S 1/2 OF THE NW 1/4 OF THE NW 1/4 OF SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS: COMMENCING AT THE SOUTH EAST CORNER OF SAID SUBDIVISION; THENCE N 01°16'04" E ALONG THE EASTERLY LINE THEREOF, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 292.00 FEET TO THE TRUE POINT OF BEGINNING; THENCE N 44°11'00" W, A DISTANCE OF 72.12 FEET TO THE EASTERLY LINE OF THE PREVIOUSLY DESCRIBED 30-FOOT STRIP OF LAND.

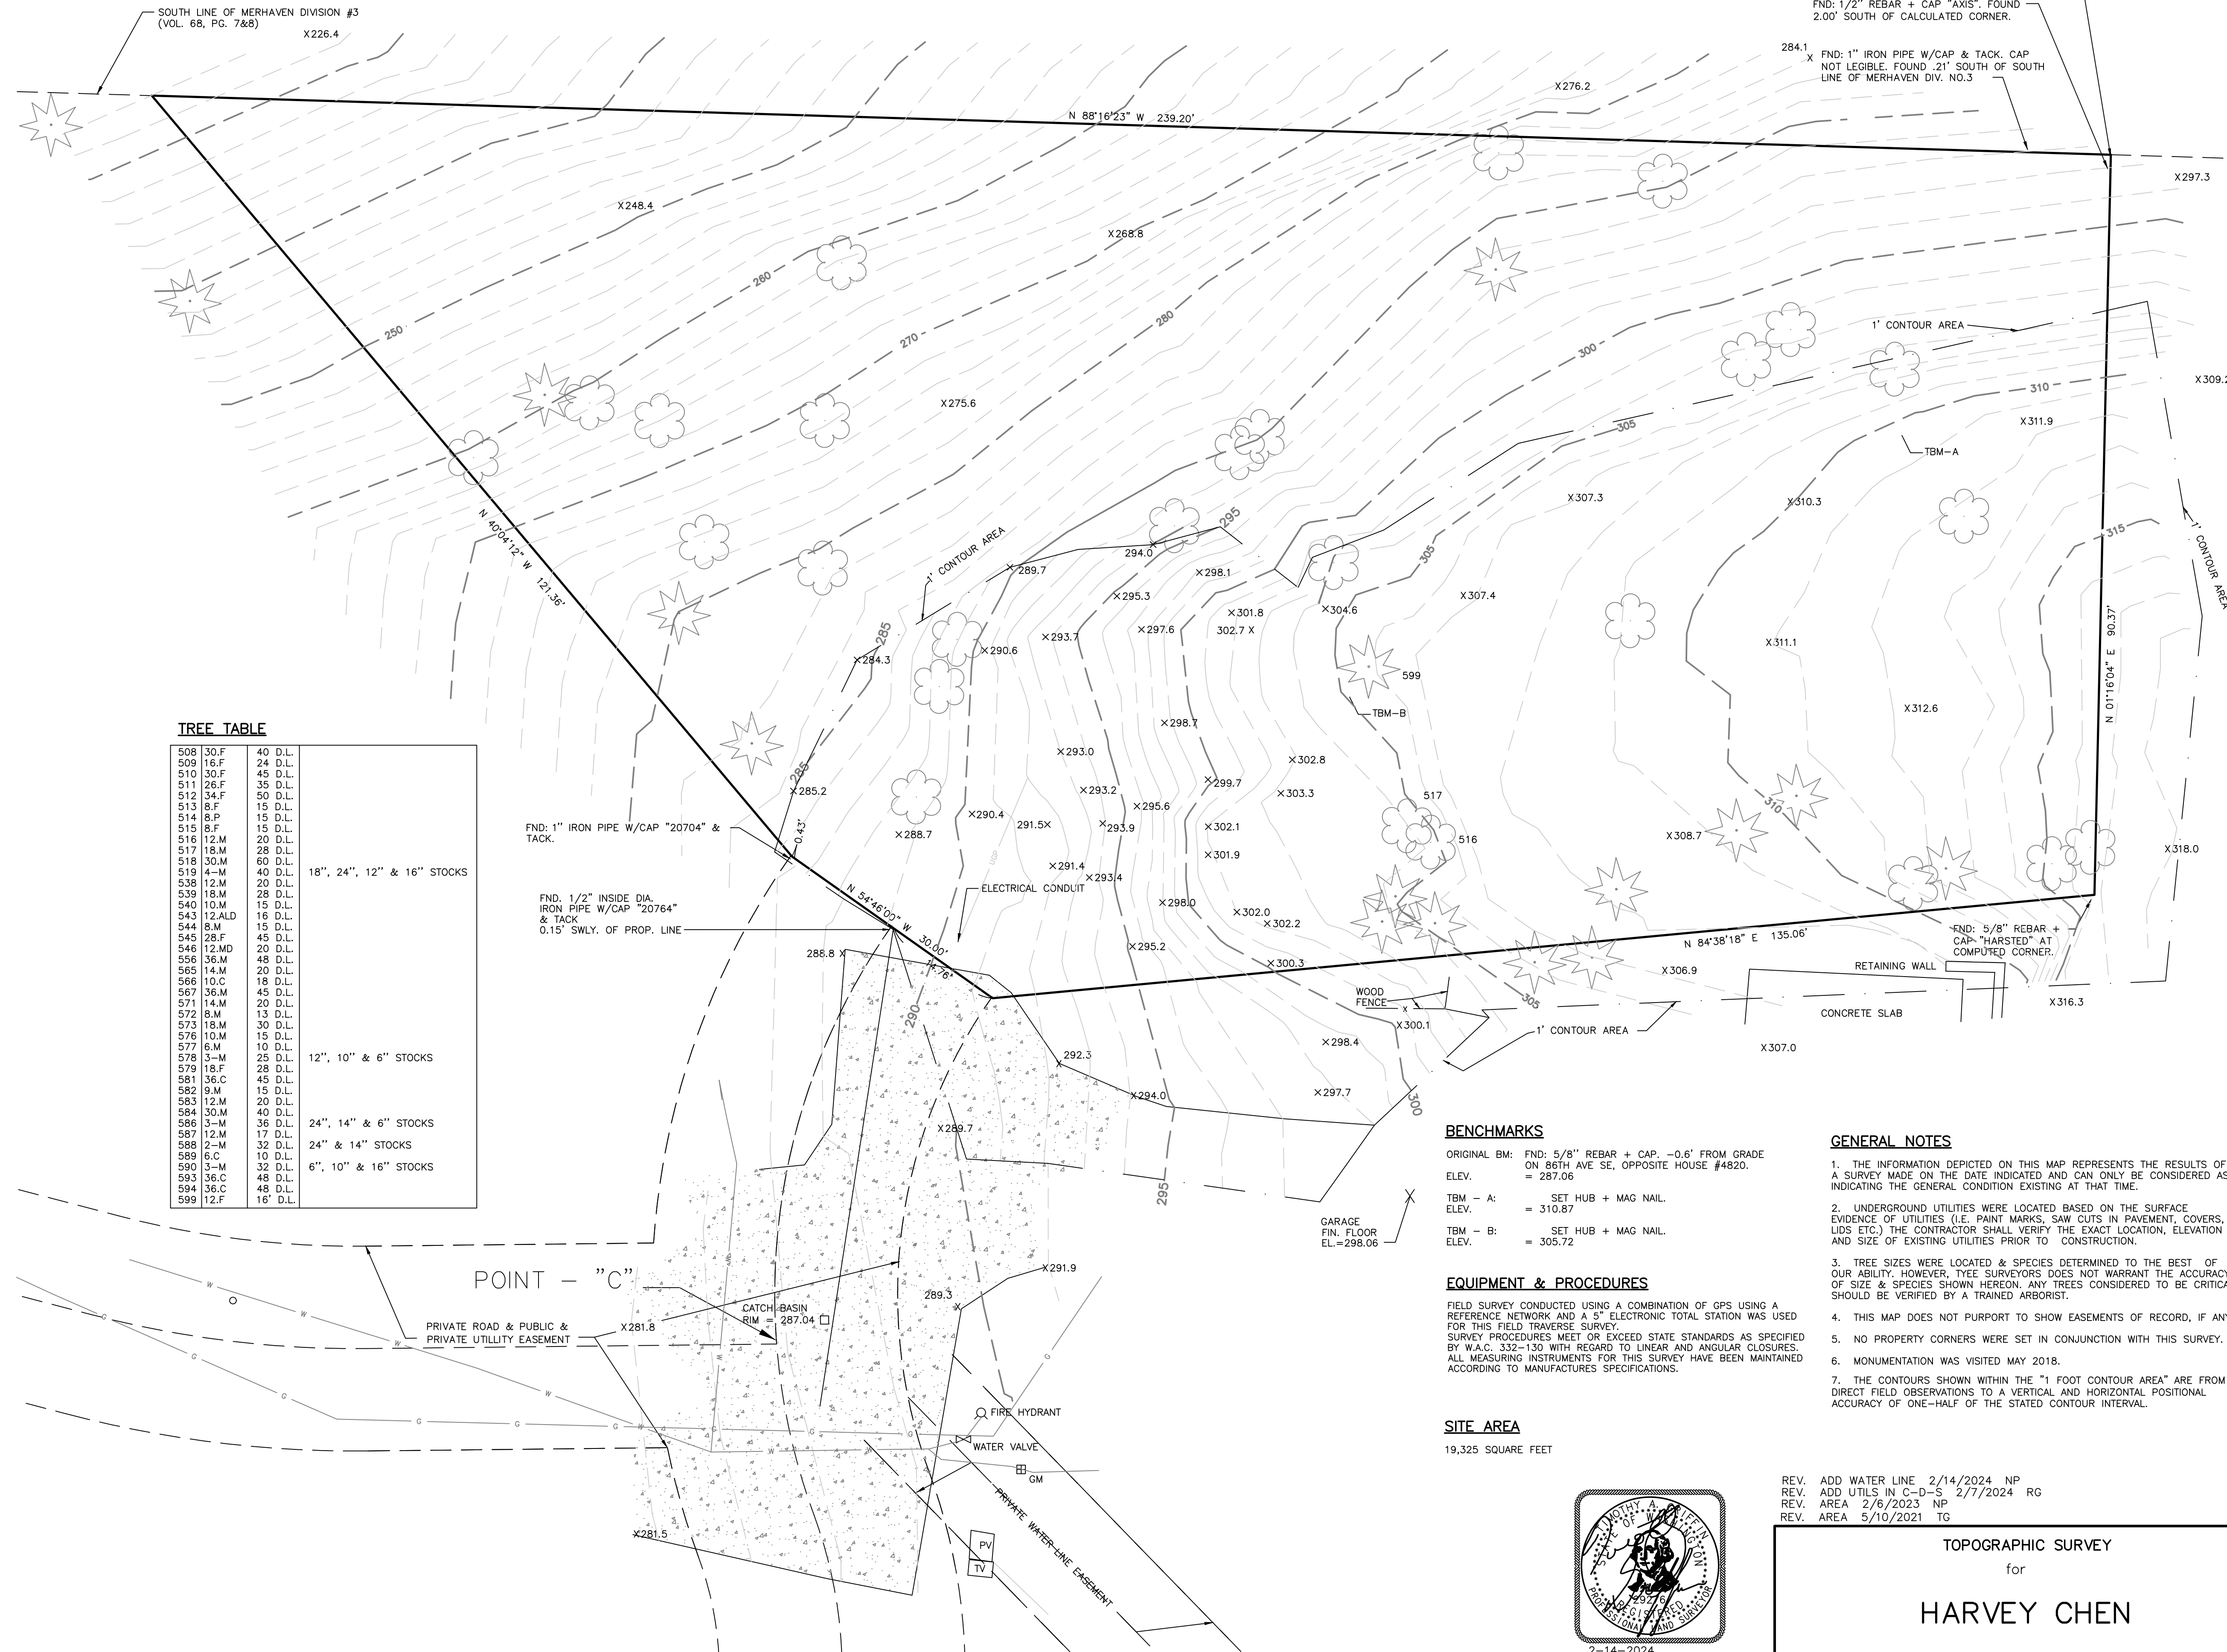

TREE TABLE

508 30.F	40 D.L.	18", 24", 12" & 16" STOCKS
509 15.F	24 D.L.	
510 30.F	45 D.L.	
511 26.F	35 D.L.	
512 34.F	50 D.L.	
513 8.F	15 D.L.	
514 8.P	15 D.L.	
515 8.F	15 D.L.	
516 12.M	20 D.L.	
517 18.M	28 D.L.	
518 30.M	60 D.L.	12", 10" & 6" STOCKS
519 4-M	40 D.L.	
520 12.M	20 D.L.	
539 18.M	28 D.L.	
540 10.M	15 D.L.	
543 12.ALD	16 D.L.	
544 8.M	15 D.L.	
545 28.F	45 D.L.	
546 12.MD	20 D.L.	
556 36.M	48 D.L.	
565 14.M	20 D.L.	24", 14" & 6" STOCKS
566 10.C	18 D.L.	
567 36.M	45 D.L.	
571 14.M	20 D.L.	
572 8.M	13 D.L.	
573 18.M	30 D.L.	
576 10.M	15 D.L.	
577 6.M	10 D.L.	
578 3-M	25 D.L.	
579 18.F	28 D.L.	
581 36.C	45 D.L.	6", 10" & 16" STOCKS
582 9.M	15 D.L.	
583 12.M	20 D.L.	
584 30.M	40 D.L.	
586 3-M	36 D.L.	
587 12.M	17 D.L.	
588 2-M	32 D.L.	
589 6.C	10 D.L.	
590 3-M	32 D.L.	
593 36.C	48 D.L.	
594 36.C	48 D.L.	
599 12.F	16" D.L.	

BENCHMARKS

ORIGINAL BM: FND: 5/8" REBAR + CAP, -0.6' FROM GRADE ON 86TH AVE SE, OPPOSITE HOUSE #4820. ELEV. = 287.06

TBM - A: SET HUB + MAG NAIL. ELEV. = 310.87

TBM - B: SET HUB + MAG NAIL. ELEV. = 305.72

EQUIPMENT & PROCEDURES

FIELD SURVEY CONDUCTED USING A COMBINATION OF GPS USING A REFERENCE NETWORK AND A 5" ELECTRONIC TOTAL STATION WAS USED FOR THIS FIELD TRAVERSE SURVEY.

SURVEY PROCEDURES MEET OR EXCEED STATE STANDARDS AS SPECIFIED BY W.A.C. 332-130 WITH REGARD TO LINEAR AND ANGULAR CLOSURES. ALL MEASURING INSTRUMENTS FOR THIS SURVEY HAVE BEEN MAINTAINED ACCORDING TO MANUFACTURERS SPECIFICATIONS.

SITE AREA

19,325 SQUARE FEET

GENERAL NOTES

- THE INFORMATION DEPICTED ON THIS MAP REPRESENTS THE RESULTS OF A SURVEY MADE ON THE DATE INDICATED AND CAN ONLY BE CONSIDERED AS INDICATING THE GENERAL CONDITION EXISTING AT THAT TIME.
- UNDERGROUND UTILITIES WERE LOCATED BASED ON THE SURFACE EVIDENCE OF UTILITIES (I.E. PAINT MARKS, SAW CUTS IN PAVEMENT, COVERS, LIDS ETC.) THE CONTRACTOR SHALL VERIFY THE EXACT LOCATION, ELEVATION AND SIZE OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.
- TREE SIZES WERE LOCATED & SPECIES DETERMINED TO THE BEST OF OUR ABILITY. HOWEVER, TREE SURVEYORS DOES NOT WARRANT THE ACCURACY OF SIZE & SPECIES SHOWN HEREON. ANY TREES CONSIDERED TO BE CRITICAL SHOULD BE VERIFIED BY A TRAINED ARBORIST.
- THIS MAP DOES NOT PURPORT TO SHOW EASEMENTS OF RECORD, IF ANY.
- NO PROPERTY CORNERS WERE SET IN CONJUNCTION WITH THIS SURVEY.
- MONUMENTATION WAS VISITED MAY 2018.
- THE CONTOURS SHOWN WITHIN THE "1 FOOT CONTOUR AREA" ARE FROM DIRECT FIELD OBSERVATIONS TO A VERTICAL AND HORIZONTAL POSITIONAL ACCURACY OF ONE-HALF OF THE STATED CONTOUR INTERVAL.

REV. ADD WATER LINE 2/14/2024 NP
REV. ADD UTILS IN C-D-S 2/7/2024 RG
REV. AREA 2/6/2023 NP
REV. AREA 5/10/2021 TG

PARCEL # 1924059317
SW1/4, SW1/4, SEC. 20, T. 26 N., R. 5 E., W.M.
MERCER ISLAND, WASHINGTON

TOPOGRAPHIC SURVEY
for
HARVEY CHEN

1542 24TH AVE NE ISSAQUAH WA, 98029

DATE: 5-29-18

SCALE: 1" = 10'

SHEET: 1 OF 1


JOB NO.: 18080

SHEET: 1 OF 1




CHEN RESIDENCE

TPN: 1924059317

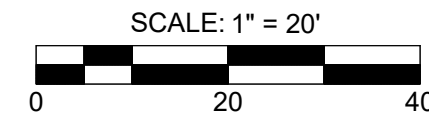

VICINITY MAP
NTS

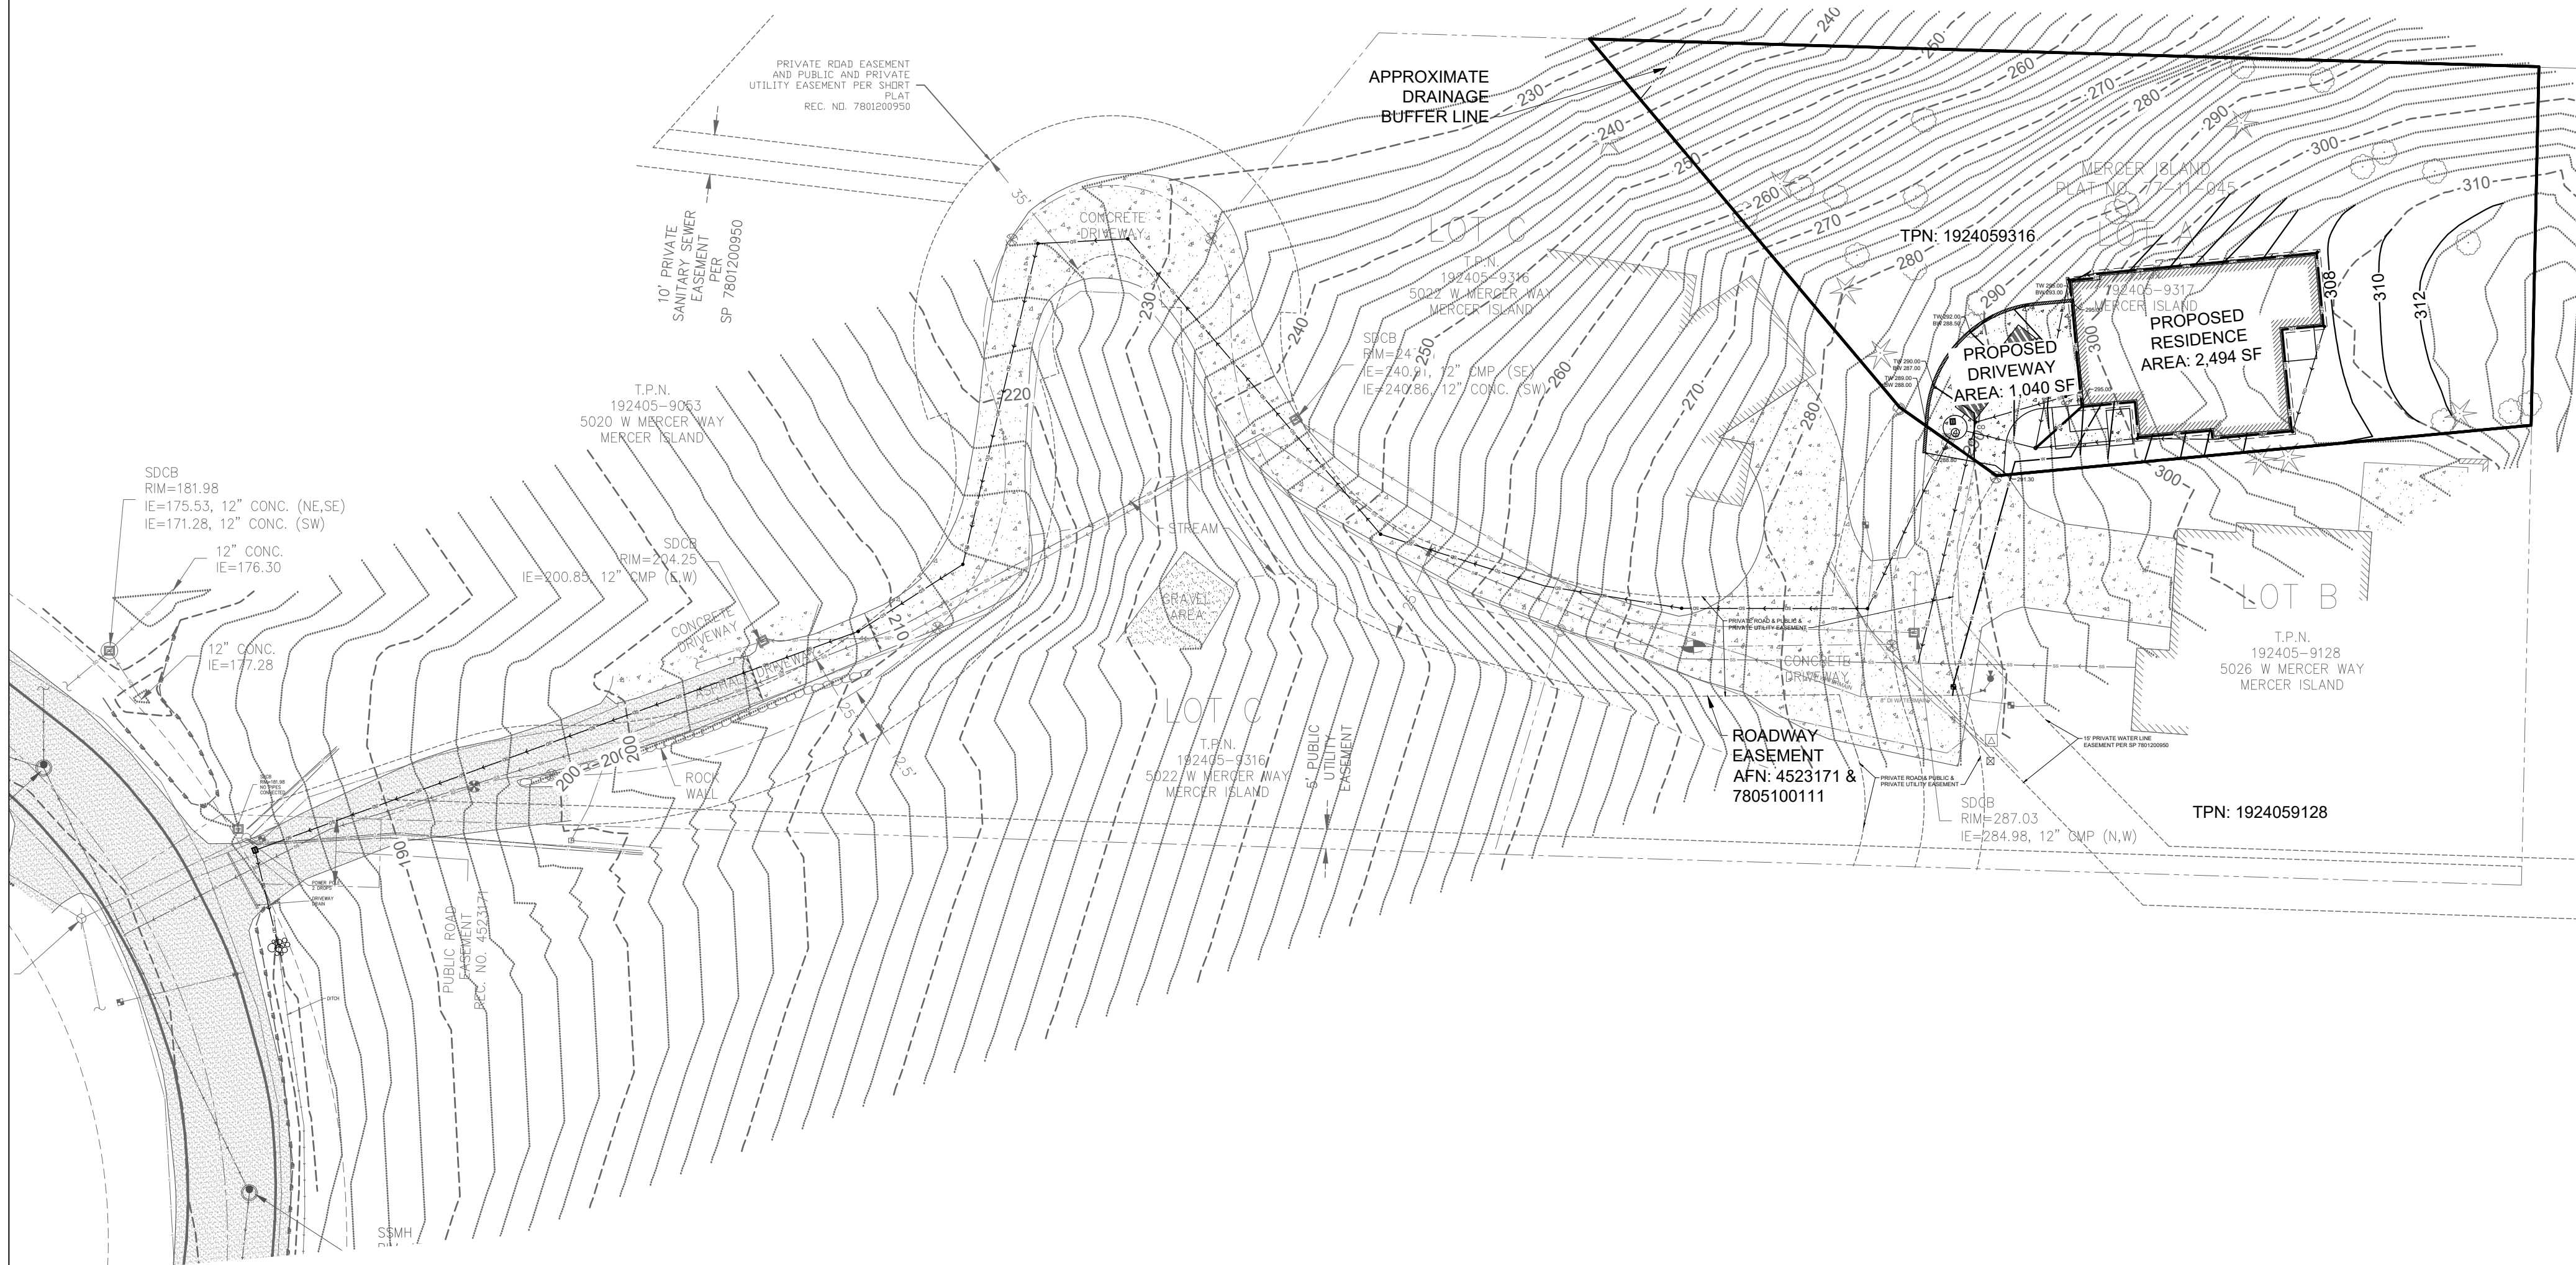

PROJECT INFO

OWNER:
ATERA HOMES, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA 98059

VERTICAL DATUM

NAVD-88

PARCEL NUMBER

TPN: 1924059317

BUILDING AREA

LOT SIZE:	19,325 SF
FOOTPRINT:	2,188 SF
ROOF:	2,566 SF
DRIVEWAY/ PARKING:	1,108 SF
SIDEWALK/PORCH:	INCL. IN OTHER NUMBERS
TOTAL COVERAGE:	3,674 SF
MAX ALLOW COVERAGE:	OR 19% 5,797.5 OR 30%

LEGAL DESCRIPTION

THAT PORTION OF THE S 1/2 OF THE NW 1/4 OF THE NW 1/4 OF SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS: COMMENCING AT THE SOUTHEAST CORNER OF SAID SUBDIVISION; THENCE N 01°16'04" E ALONG THE EASTERLY LINE THEREOF, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 200.00 FEET; THENCE N 01°16'04" E, A DISTANCE OF 116.00 FEET TO THE TRUE POINT OF BEGINNING; THENCE S 84°38'18" W A DISTANCE OF 135.06 FEET; THENCE N 54°46'00" W, A DISTANCE OF 30.00 FEET; THENCE N 40°04'12" W, A DISTANCE OF 121.05 FEET TO THE SOUTHERLY BOUNDARY OF MERHAVEN DIVISION NO. 3, AS RECORDED IN VOLUME 68 OF PLATS, PAGES 7 AND 8, RECORDS OF KING COUNTY, WASHINGTON; THENCE 86°17'59" E ALONG SAID SOUTHERLY BOUNDARY LINE, A DISTANCE OF 239.00 FEET; THENCE S 01°16'04" W, A DISTANCE OF 90.25 FEET TO THE TRUE POINT OF BEGINNING.

TOGETHER WITH AND SUBJECT TO A PRIVATE ROAD EASEMENT AND PUBLIC AND PRIVATE UTILITY EASEMENT OVER AND ACROSS THE FOLLOWING DESCRIBED PROPERTY: A STRIP OF LAND 25 FEET WIDE LYING 12.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: THAT PORTION OF THE S 1/2 OF THE NW 1/4 OF THE NW 1/4 OF SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS: COMMENCING AT THE SOUTHEAST CORNER OF SAID SUBDIVISION; THENCE N 01°16'04" E ALONG THE EASTERLY LINE THEREOF, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 739.80 FEET TO THE TRUE POINT OF BEGINNING; THENCE N 71°25'41" E, A DISTANCE OF 25.87 FEET TO A TANGENT CURVE TO THE RIGHT HAVING A RADIUS OF 55.59 FEET; THENCE EASTERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 20°23'38", AN ARC DISTANCE OF 19.79 FEET TO A REVERSE CURVE HAVING A RADIUS OF 135.00 FEET; THENCE NORTHEASTERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 45°17'19", AN ARC DISTANCE OF 106.71 FEET TO A COMPOUND CURVE HAVING A RADIUS OF 55.00 FEET; THENCE NORTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 65°57'00", AN ARC DISTANCE OF 63.31 FEET TO A POINT HEREINAFTER DESCRIBED AS POINT "A" AND TERMINUS OF SAID 25-FOOT STRIP OF LAND.

TOGETHER WITH A STRIP OF LAND 35 FEET WIDE LYING 17.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: BEGINNING AT FOREMENTIONED POINT "A", SAID POINT LYING ON A CURVE HAVING A RADIUS OF 45.00 FEET AND HAVING A RADIAL BEARING OF N 70°35'00" E; THENCE NORTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 52°22'00", AN ARC DISTANCE OF 41.13 FEET TO A COMPOUND CURVE HAVING A RADIUS OF 30.00 FEET; THENCE EASTERLY AND SOUTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 149°43'00", AN ARC DISTANCE OF 78.39 FEET TO A POINT HEREINAFTER DESCRIBED AS POINT "B", SAID POINT BEING THE TERMINUS OF SAID 35-FOOT STRIP OF LAND.

TOGETHER WITH A STRIP OF LAND 25 FEET WIDE LYING 12.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: BEGINNING AT FOREMENTIONED POINT "B", SAID POINT LYING ON A CURVE HAVING A RADIUS OF 72.00 FEET AND HAVING A RADIAL BEARING OF S 87°20'00" E; THENCE SOUTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 77°59'00", AN ARC DISTANCE OF 98.00 FEET; THENCE S 75°19'00" E, A DISTANCE OF 30.00 FEET TO A TANGENT CURVE TO THE LEFT HAVING A RADIUS OF 127.00 FEET; THENCE EASTERLY ALONG SAID CURVE THROUGH A CENTER ANGLE OF 15°19'00", AN ARC DISTANCE OF 33.95 FEET; THENCE N 89°22'00" E, A DISTANCE OF 50.02 FEET TO A POINT HEREINAFTER DESCRIBED AS POINT "C", SAID POINT BEING THE TERMINUS OF SAID 25-FOOT STRIP OF LAND.

LEGAL DESCRIPTION CONTINUED

TOGETHER WITH A STRIP OF LAND 30 FEET WIDE LYING 15 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED CENTER LINE: BEGINNING AT FOREMENTIONED POINT "C", SAID POINT LYING ON A CURVE HAVING A RADIUS OF 78.00 FEET AND HAVING A RADIAL BEARING OF N 85°33'01" E; THENCE NORTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 55°26'00", AN ARC DISTANCE OF 75.46 FEET TO A REVERSE CURVE HAVING A RADIUS OF 56.00 FEET; THENCE SOUTHERLY ALONG SAID CURVE THROUGH A CENTRAL ANGLE OF 36°40'43", AN ARC DISTANCE OF 35.85 FEET TO A POINT ON THE NORTHERLY LINE OF WESTAIR ESTATES, AS RECORDED IN VOLUME 104 OF PLATS, PAGES 18 AND 19, RECORDS OF KING COUNTY, WASHINGTON, SAID POINT BEING THE TERMINUS OF SAID EASEMENT.

TOGETHER WITH A PRIVATE AND PUBLIC ROAD EASEMENT AND PRIVATE AND PUBLIC UTILITY EASEMENT AS GRANTED BY INSTRUMENT RECORDED IN DECEMBER 29, 1954, UNDER AUDITOR'S FILE NUMBER 4523171 AND RESERVED BY INSTRUMENT RECORDED AUGUST 28, 1957, UNDER AUDITOR'S FILE NO. 4828502.

TOGETHER WITH A PUBLIC AND PRIVATE SANITARY SEWER EASEMENT OVER, UNDER AND ACROSS THE FOLLOWING DESCRIBED PROPERTY: A STRIP OF LAND 10 FEET WIDE LYING 5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED PROPERTY: COMMENCING AT THE SOUTHEAST CORNER OF LOT 9 MERHAVEN DIVISION NO. 2, AS RECORDED IN VOLUME 67 OF PLATS, PAGES 27 AND 28, RECORDS OF KING COUNTY, WASHINGTON; THENCE N 88°17'59" W, A DISTANCE OF 0.08 FEET, THENCE S 42°17'56" W, A DISTANCE OF 45.00 FEET TO THE TRUE POINT OF BEGINNING; THENCE S 83°17'59" E, A DISTANCE OF 79.34 FEET, MORE OR LESS, TO THE WEST LINE OF THE PREVIOUSLY DESCRIBED 35-FOOT WIDE STRIP OF LAND.

TOGETHER WITH A PRIVATE WATER LINE EASEMENT OVER AND ACROSS THE FOLLOWING DESCRIBED PROPERTY: A STRIP OF LAND 15 FEET WIDE LYING 7.5 FEET ON EACH SIDE OF THE FOLLOWING DESCRIBED PROPERTY: THAT PORTION OF THE S 1/2 OF THE NW 1/4 OF THE NW 1/4 OF SECTION 19, TOWNSHIP 24 NORTH, RANGE 5 EAST, W.M., IN KING COUNTY, WASHINGTON, DESCRIBED AS FOLLOWS: COMMENCING AT THE SOUTH EAST CORNER OF SDI SUBDIVISION; THENCE N 01°16'04" E ALONG THE EASTERLY LINE THEREOF, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 450.00 FEET; THENCE N 88°10'41" W, A DISTANCE OF 292.00 FEET TO THE TRUE POINT OF BEGINNING; THENCE N 44°11'00" W, A DISTANCE OF 72.12 FEET TO THE EASTERLY LINE OF THE PREVIOUSLY DESCRIBED 30-FOOT STRIP OF LAND.

CONTRACTOR AS-BUILT:

THE CONTRACTOR SHALL MAINTAIN ONE SET OF THE CONTRACT DRAWINGS THAT SHALL INCLUDE, CLEARLY AND LEGIBLY MARKED, ANY ALTERATIONS OR LOCATIONS OF UNDERGROUND UTILITIES ENCOUNTERED DURING PROGRESS OF THIS PROJECT, AND ANY ALTERATIONS MADE TO THE FACILITIES BEING INSTALLED. SAID DRAWINGS SHALL BE MARKED "AS-BUILT" AND SHALL BE SUBMITTED TO THE PROJECT ENGINEER UPON COMPLETION OF THE PROJECT.

CONSTRUCTION STAKING:

THIS PROJECT MUST BE STAKED PRIOR TO CONSTRUCTION BY THE DESIGN ENGINEER OR BY A LICENSED LAND SURVEYOR.

THIS DRAWING DOES NOT REPRESENT A RECORD DOCUMENT UNLESS CERTIFIED BY THE LAND DEVELOPER'S INC.

ANY ALTERATIONS TO THE DESIGN SHOWN HERON MUST BE REVIEWED AND APPROVED BY THE LAND DEVELOPER'S, INC

TOPOGRAPHIC NOTE:

THE EXISTING TOPOGRAPHIC DATA SHOWN ON THESE DRAWINGS HAS BEEN PREPARED, IN PART, BASED UPON INFORMATION FURNISHED BY OTHERS. WHILE THIS INFORMATION IS BELIEVED TO BE RELIABLE, THE LAND DEVELOPER'S, INC. CANNOT ENSURE ITS ACCURACY AND THIS IS NOT RESPONSIBLE FOR THE ACCURACY OF THAT INFORMATION OR FOR ANY ERRORS OR OMISSIONS WHICH MAY BE INCORPORATED INTO THESE DRAWINGS AS A RESULT.

NOTE:


THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR THE LOCATION AND PROTECTION OF ALL EXISTING UTILITIES. THE CONTRACTOR SHALL VERIFY ALL UTILITY LOCATIONS PRIOR TO CONSTRUCTION BY CALLING THE UNDERGROUND LOCATE LINE AT 800-824-5555 A MINIMUM OF 48 HOURS PRIOR TO ANY EXCAVATION



LEGEND

	EXISTING	PROPOSED
SUBJECT PROPERTY LINE	---	---
ADJACENT LOT LINE	---	---
HABITAT BUFFER LINE	---	---
WETLAND BUFFER LINE	---	---
EASEMENT LINE	---	---
RIGHT-OF-WAY LINE	---	---
CENTER LINE	---	---
CONTOUR, MAJOR	-160-	160
CONTOUR, MINOR158.....	158
CONIFEROUS TREE		
DECIDUOUS TREE		
STREET SIGN		
POWER LINE		
OVERHEAD POWER LINE		
POWER POLE		
GUY WIRE		
POWER VAULT		
STREET LIGHT		
NATURAL GAS LINE		
TELEPHONE LINE		
TELEPHONE MANHOLE		
TELEPHONE PEDESTAL		
CABLE LINE		
CABLE PEDESTAL		
STORM MAIN LINE		
FOOTING DRAIN LINE		
ROOF DRAIN LINE		
CATCH BASIN		
TYPE I CATCH BASIN		
YARD DRAIN		
DOWNSPOUT		
WATER MAIN LINE		
WATER METER		
BLOWOFF VALVE FIRE HYDRANT		
GATE VALVE		
SEWER MANHOLE		
CLEANOUT		
SEWER MAIN LINE		
CONCRETE		
ASPHALT PAVEMENT		
POROUS ASPHALT		
LANDSCAPING		
GRAVEL		

THE LAND DEVELOPER'S ENGINEERED SOLUTION
an affiliate of THE LAND DEVELOPER, LLC
5737 LINDERSON WAY SW,
TUMWATER, WA, 98501
PO BOX 4420, TUMWATER, WA, 98501
(360) 890-4806
E-MAIL: erik@thelanddeveloper.com

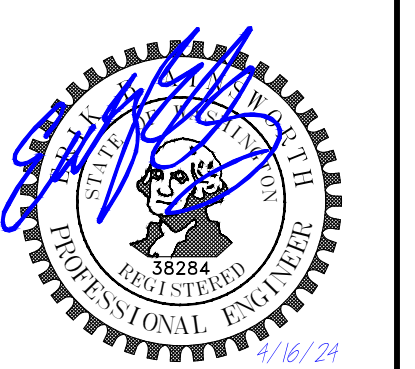


DATE:	
REVISIONS:	

CHEN RESIDENCE

COVER SHEET

PROJECT:
CHEN RESIDENCE
W MERCER WAY
MERCER ISLAND, WA 98040
CLIENT:
ATERA HOMES, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA 98059


DRAWN BY: EBA
DATE: 4/16/24
AGENCY NO:
SHEET: 1 OF 6
JOB NO: 20-122

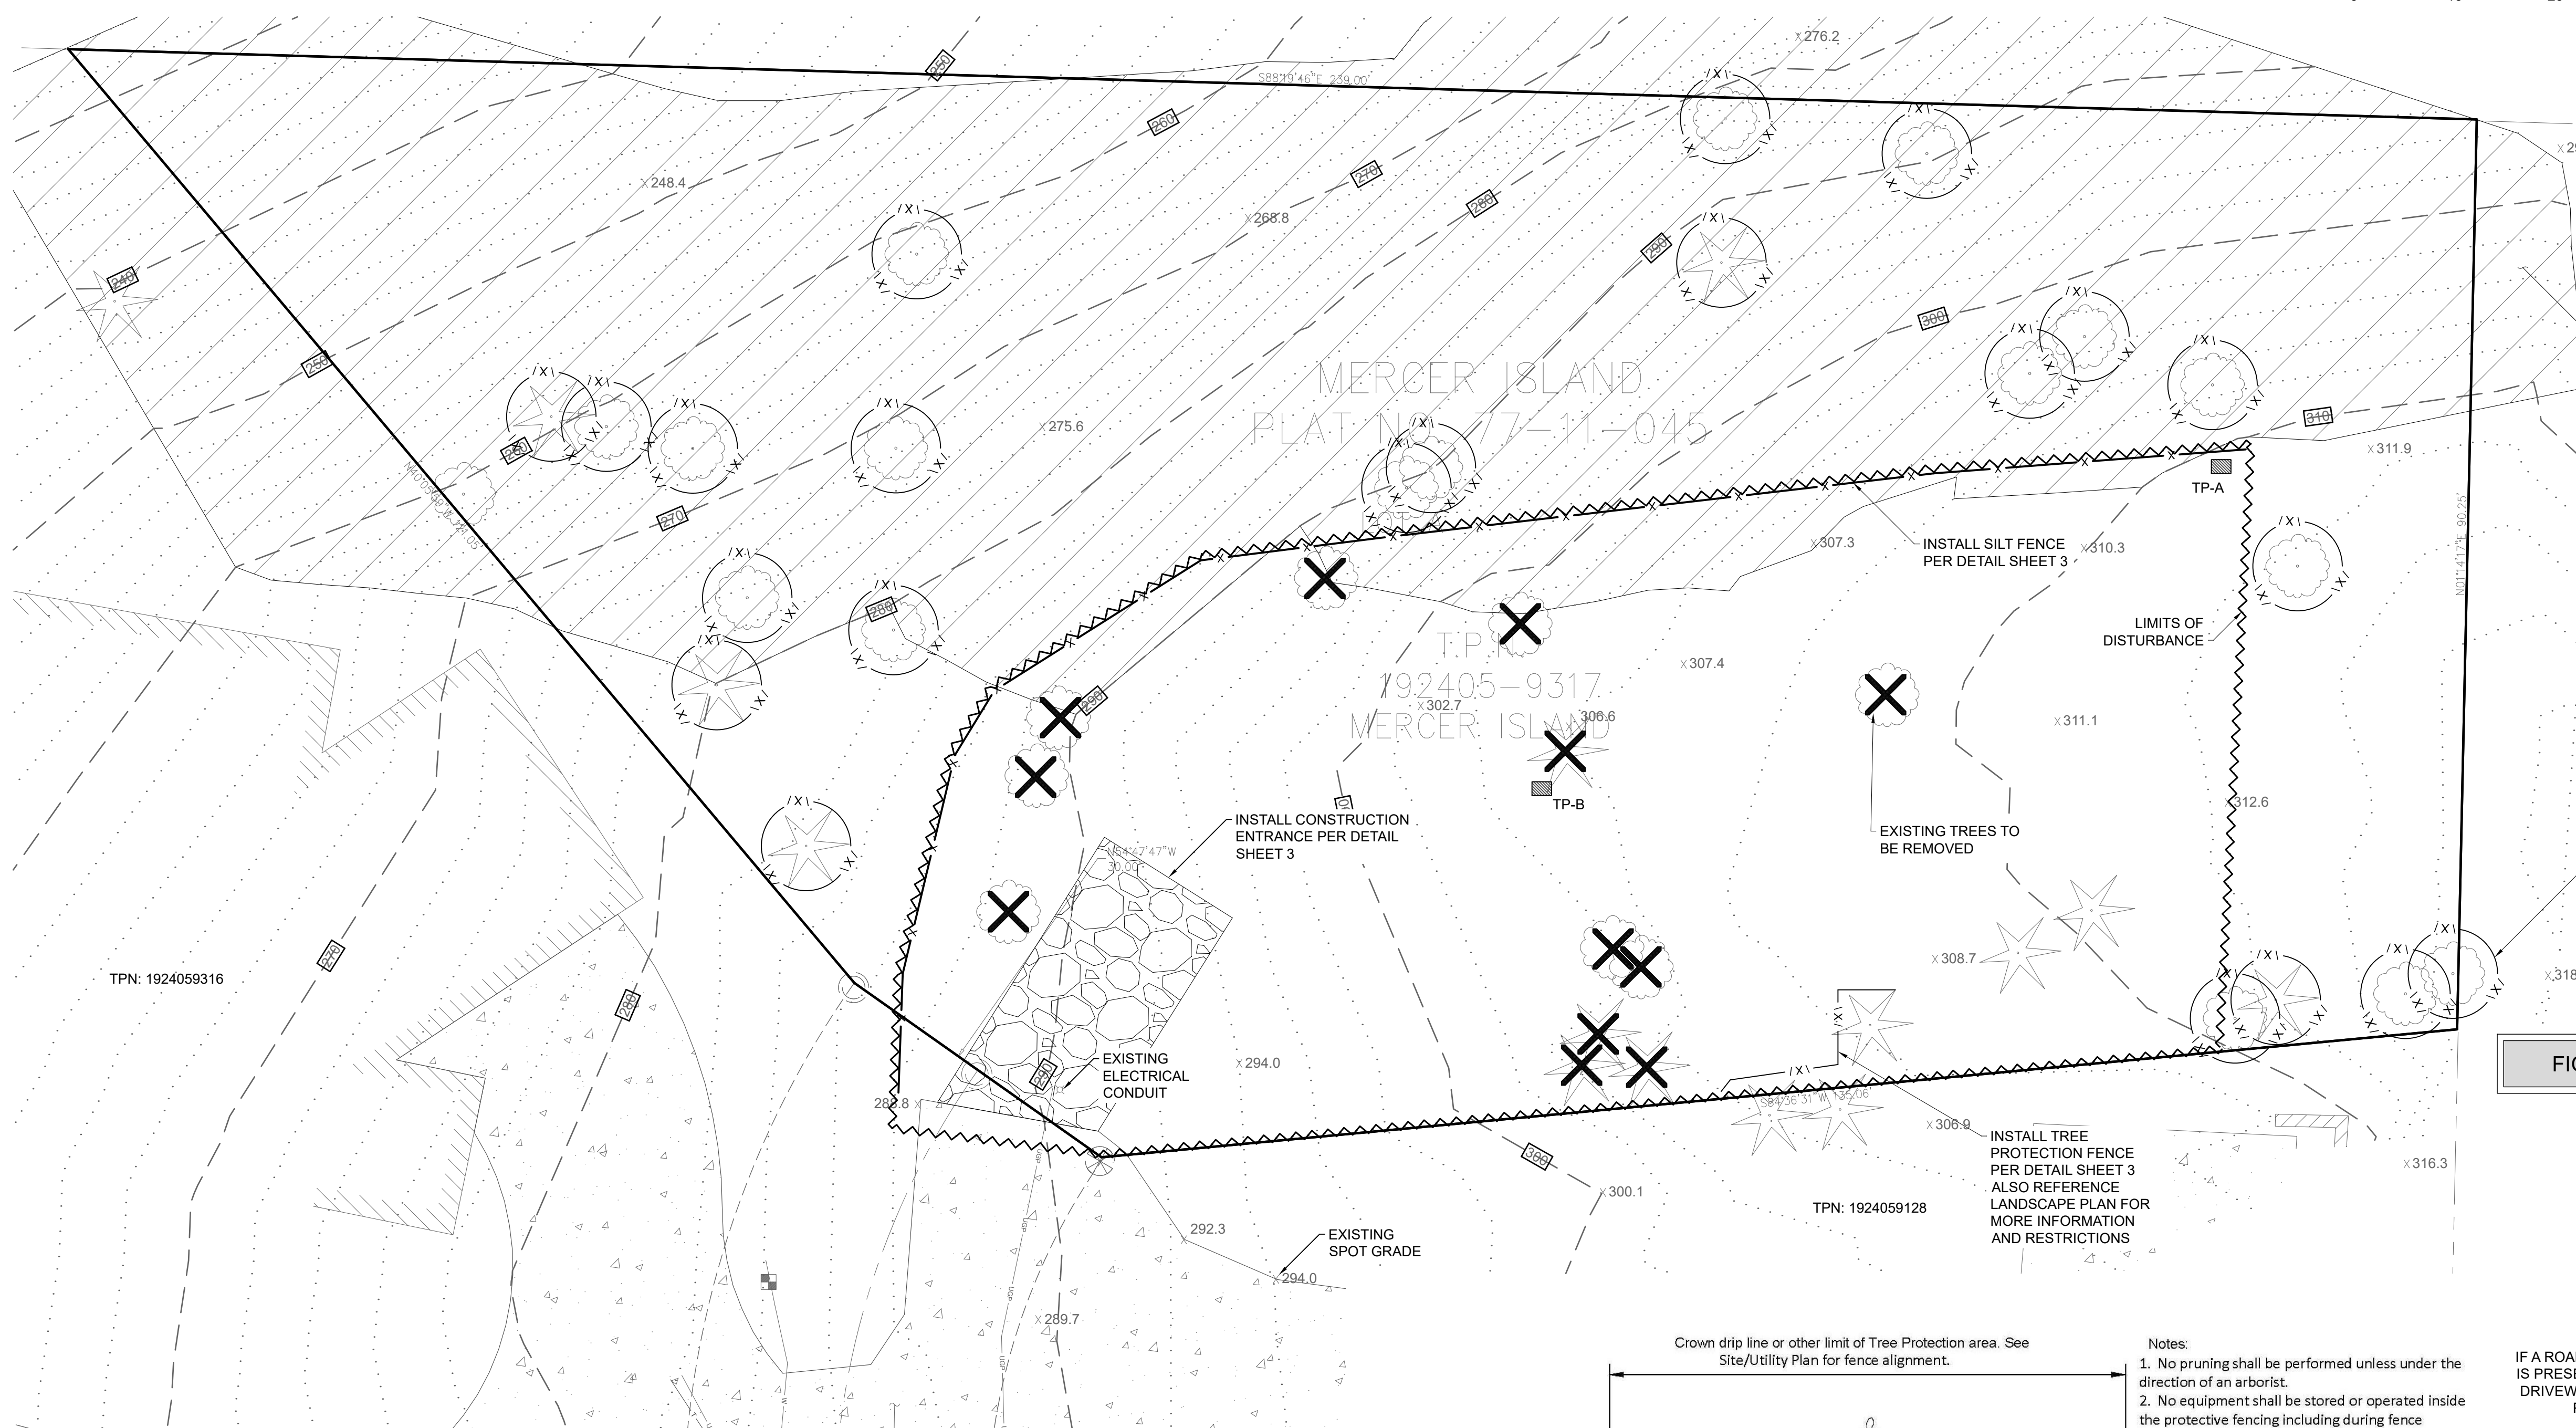

HATCHING INDICATES POSSIBLE AREAS OF 40% OR GREATER SLOPES



INDICATES TREES TO BE PROTECTED PER FENCE PER DETAIL SHEET 3

FIGURE D.2.1.4.A STABILIZED CONSTRUCTION ENTRANCE

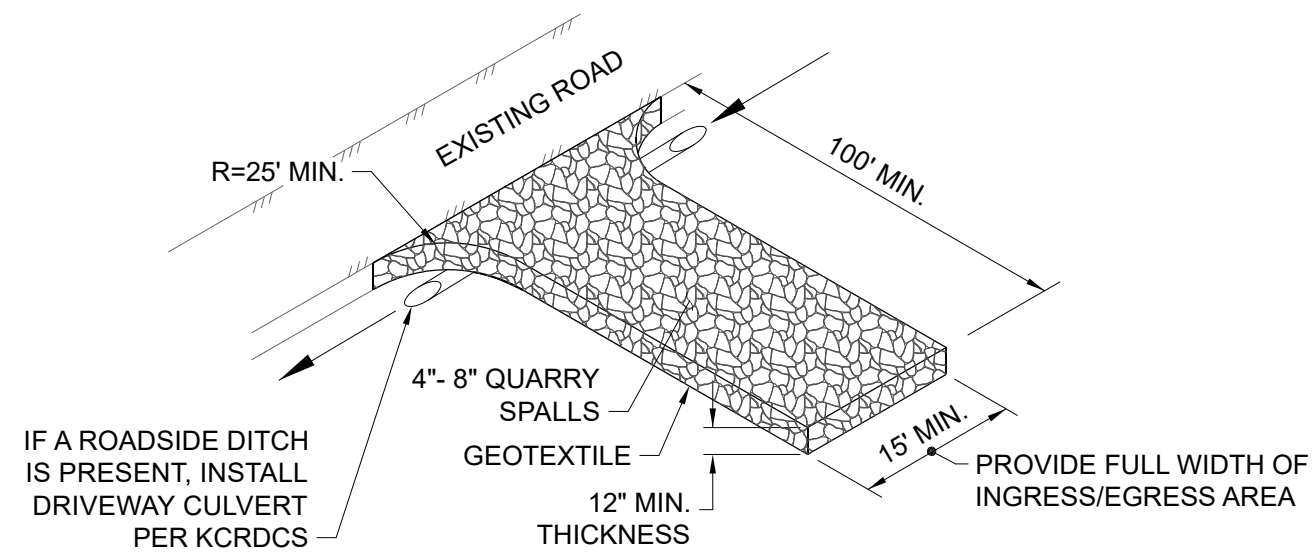


- NOTES:**
- PER KING COUNTY ROAD DESIGN AND CONSTRUCTION STANDARDS (KCRDCS), DRIVEWAYS SHALL BE PAVED TO EDGE OF R-O-W PRIOR TO INSTALLATION OF THE CONSTRUCTION ENTRANCE TO AVOID DAMAGING OF THE ROADWAY.
 - IT IS RECOMMENDED THAT THE ENTRANCE BE CROWNED SO THAT RUNOFF DRAINS OFF THE PAD.

FIGURE D.2.1.3.A SILT FENCE

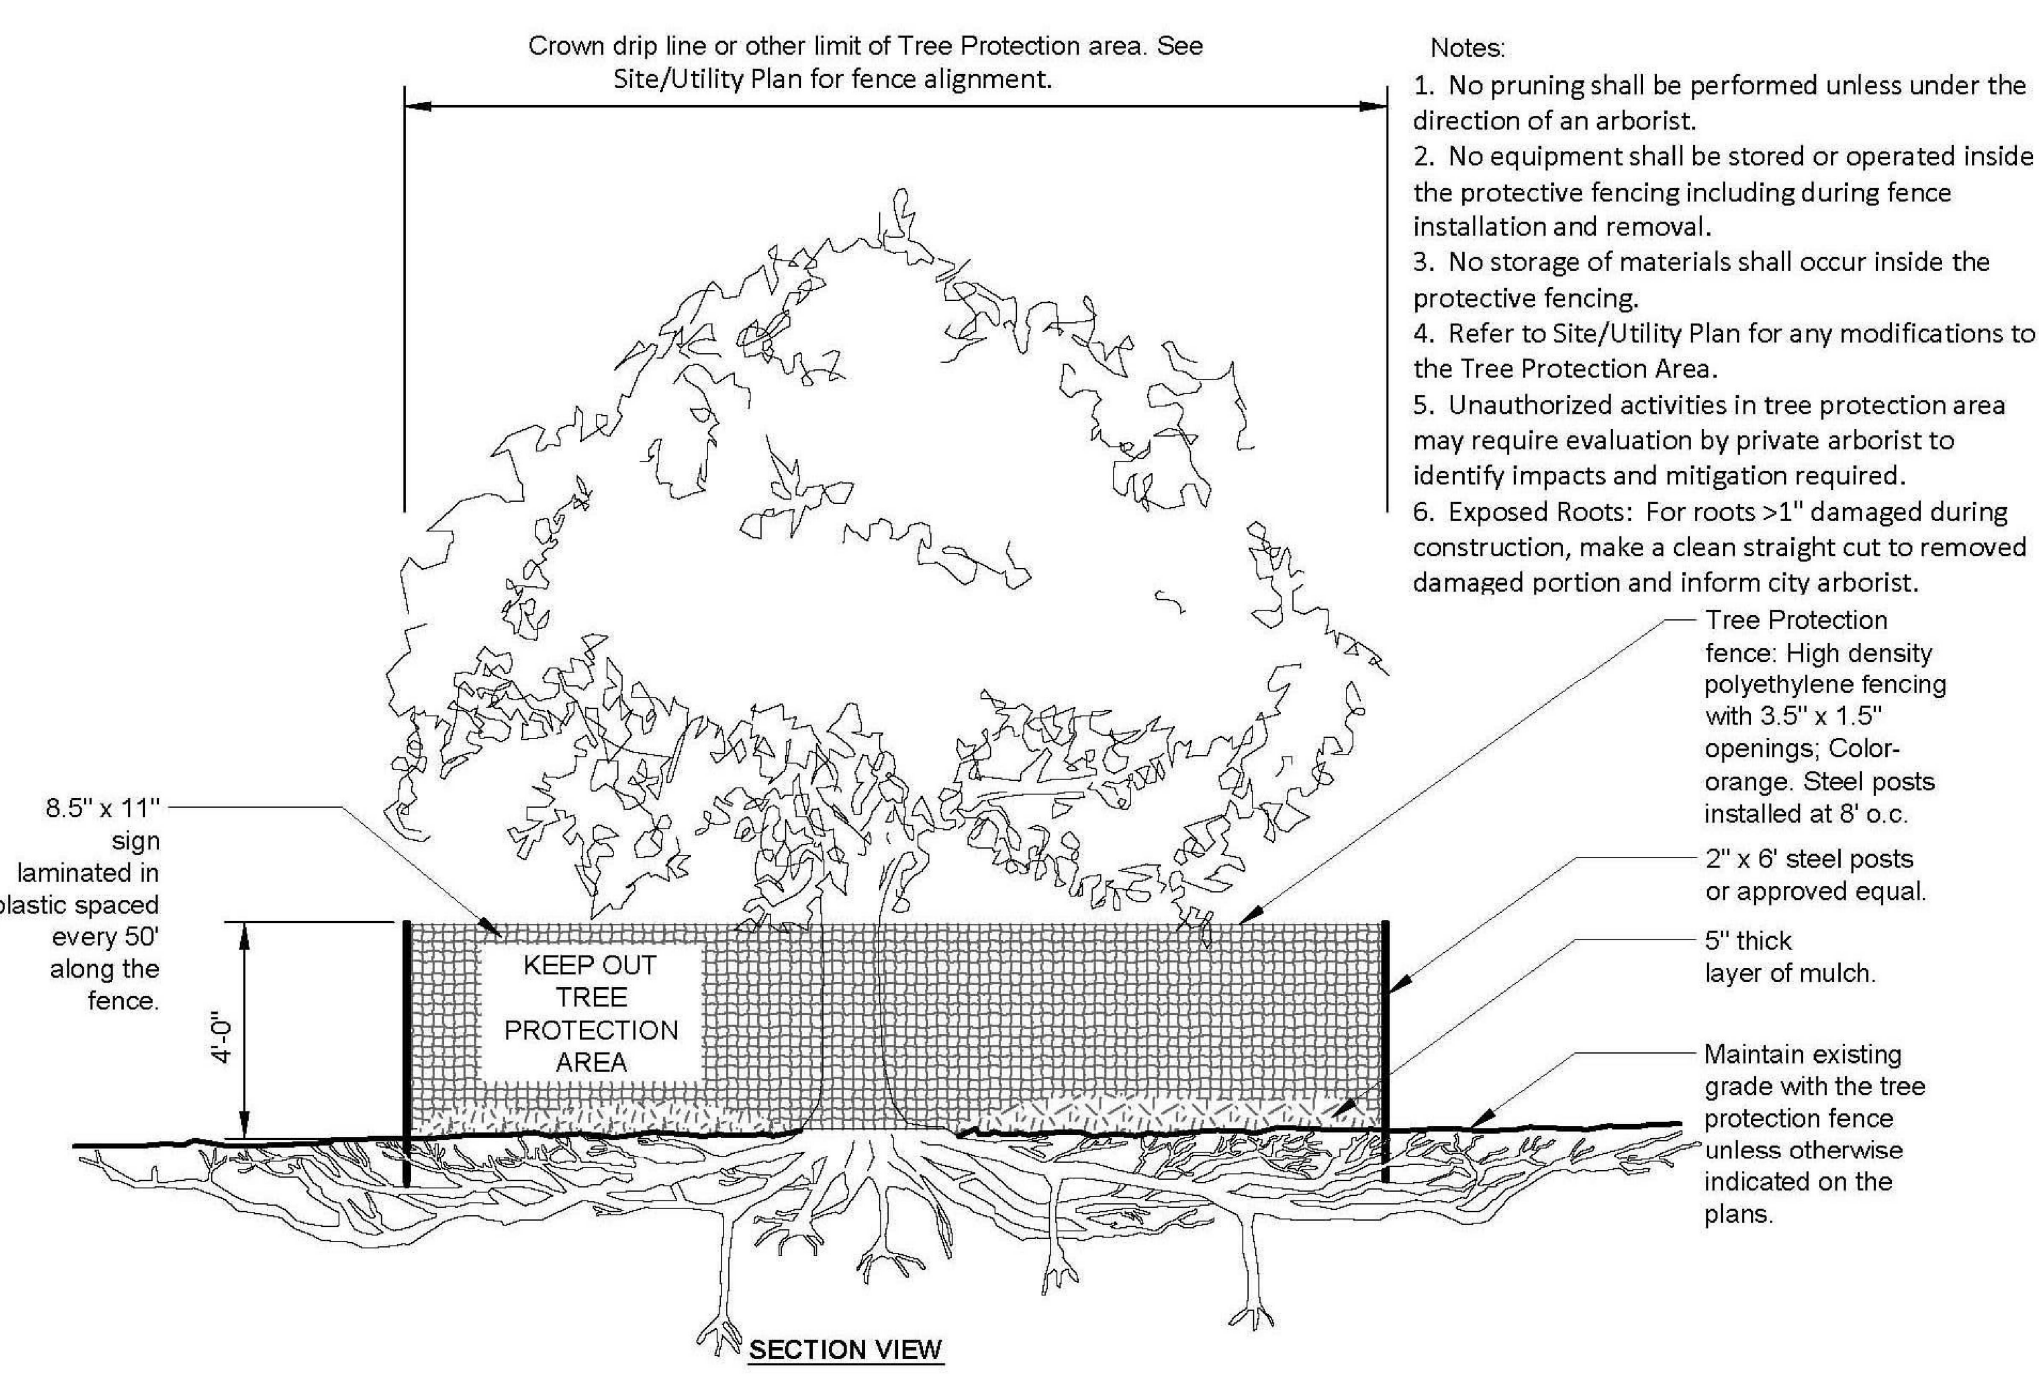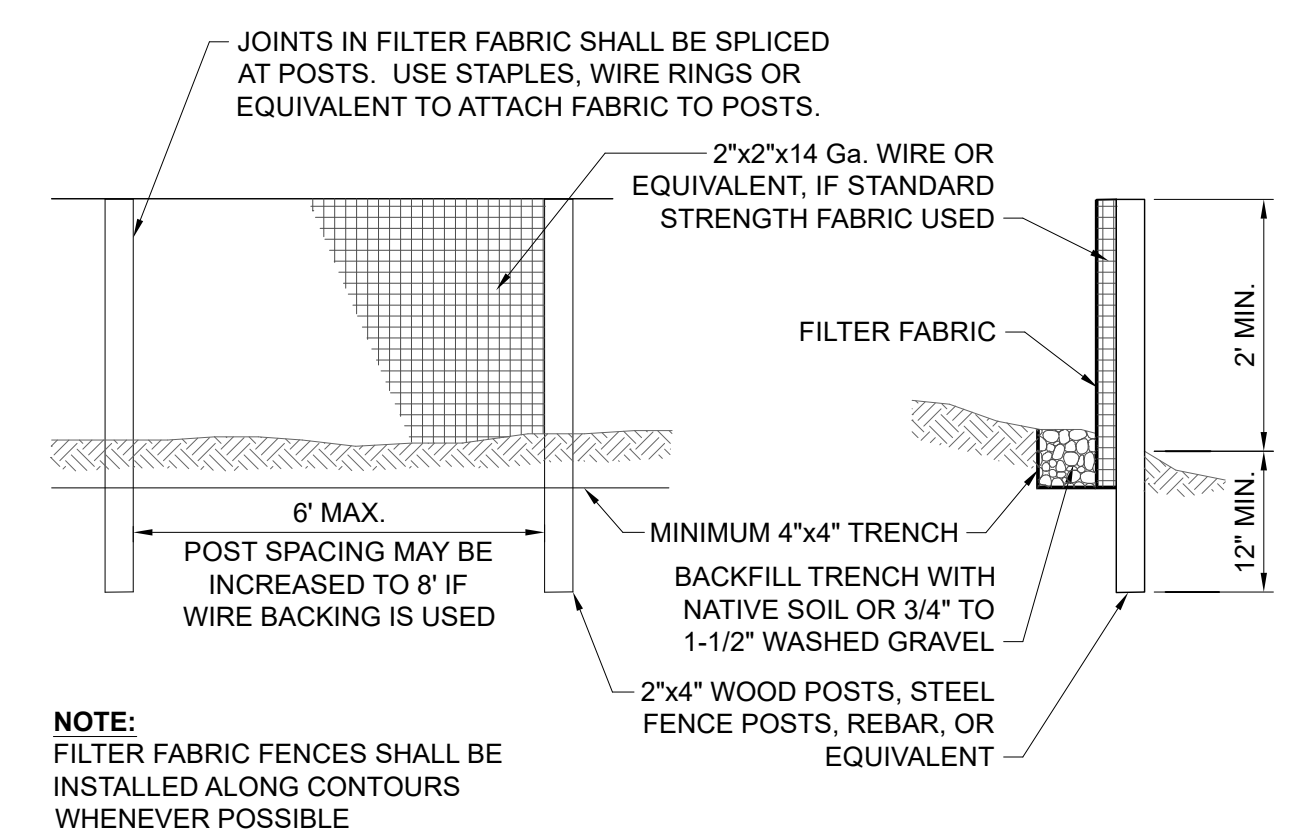

TREE PROTECTION DETAIL

THE LAND DEVELOPER'S ENGINEERED SOLUTION
 a division of THE LAND DEVELOPER, LLC
 5737 LINDERSON WAY SW.
 TUMWATER, WA. 98501
 PO BOX 4420, TUMWATER, WA. 98501
 (360) 890-4806
 E-MAIL: erik@thelanddeveloper.com

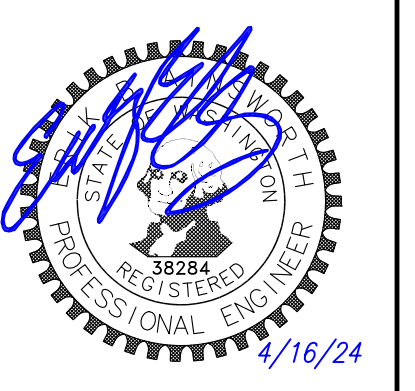


DATE:	
REVISIONS:	

CHEN RESIDENCE
 TESC AND DEMO PLAN


PROJECT: CHEN RESIDENCE W MERCER WAY W MERCER ISLAND, WA 98040
 CLIENT: ATERA HOMES, LLC 451 DUNNALLAVE NE, SUITE 155 RENTON, WA 98059
 DRAWN BY: EBA
 DATE: 4/16/24
 AGENCY NO:
 SHEET: 2 OF 6
 JOB NO: 20-122

SE 1/4, SECTION 20, TOWNSHIP 26 N., RANGE 5 E., W.M.

SCALE: 1" = 10'

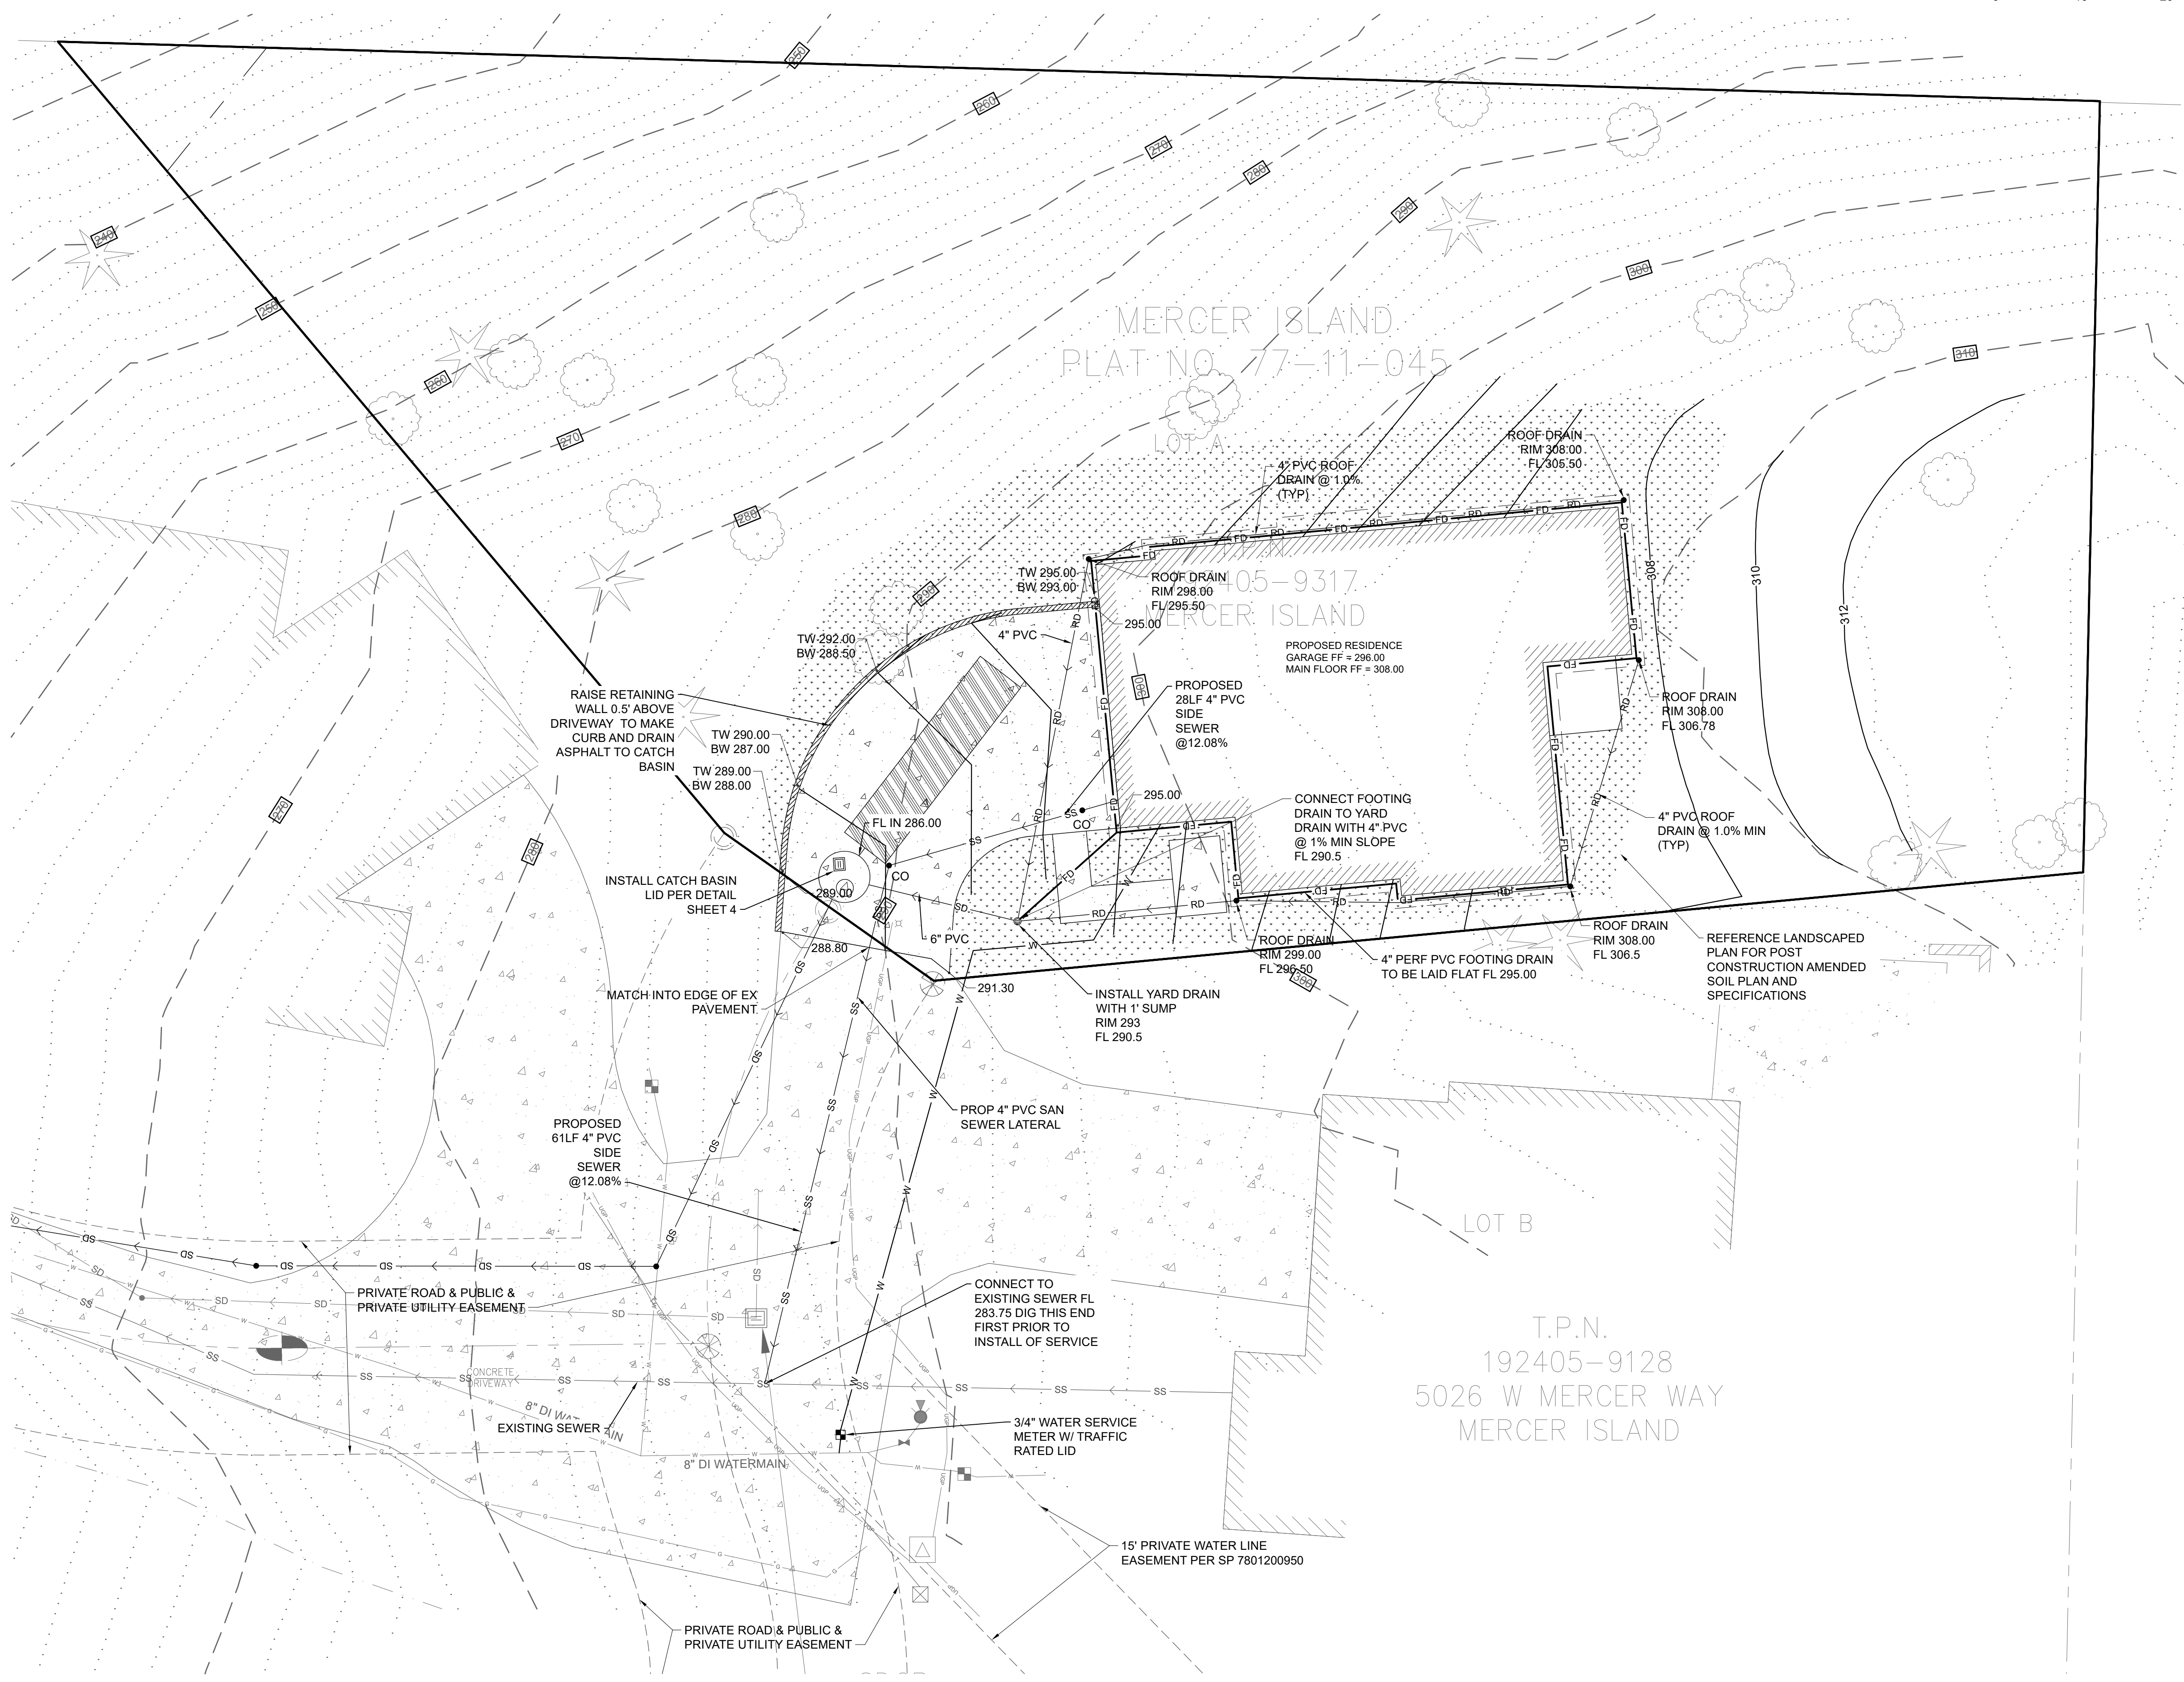

THE LAND DEVELOPER'S ENGINEERED SOLUTION
 a division of THE LAND DEVELOPER, LLC
 5737 LINDERSON WAY SW.
 TUMWATER, WA 98501
 PO BOX 4420, TUMWATER, WA 98501
 (360) 890-4806
 E-MAIL: erik@thelanddeveloper.com

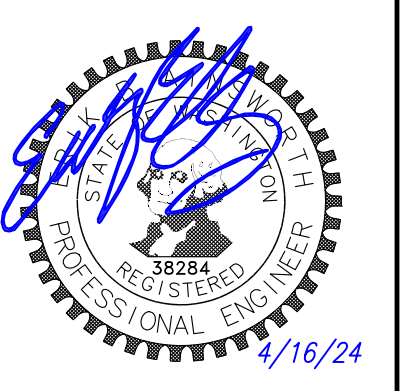

DATE:	
REVISIONS:	

CHEN RESIDENCE
SITE, LANDSCAPE & DRAINAGE PLAN

PROJECT:
 CHEN RESIDENCE
 W MERCER WAY
 MERCER ISLAND, WA 98040

CLIENT:
 ATERA HOMES, LLC
 451 DUVALL AVE NE, SUITE 155
 RENTON, WA 98059

DRAWN BY: EBA
 DATE: 4/16/24
 AGENCY NO:
 SHEET: 3 OF 6
 JOB NO: 20-122

TABLE 2 - STANDARD DETENTION PIPE DESIGN FOR PROJECTS BETWEEN 500 SF AND 5,000 SF IMPERVIOUS AREA (WITH 120% CORRECTION FACTOR)

Soil Type*	New Impervious Area (sf)														
	500 to 1,000 sf			1,001 to 2,000 sf			2,001 to 3,000 sf			3,001 to 4,000 sf			4,001 to 5,000 sf		
	Detention Pipe Size (in.) and Length (ft)			Detention Pipe Size (in.) and Length (ft)			Detention Pipe Size (in.) and Length (ft)			Detention Pipe Size (in.) and Length (ft)			Detention Pipe Size (in.) and Length (ft)		
B	36"	48"	60"	36"	48"	60"	36"	48"	60"	36"	48"	60"	36"	48"	60"
C	30"	18"	11"	36"	34"	22"	30"	48"	30"	120"	62"	42"	186"	90"	48"
	22"	11"	7"	43"	23"	14"	46"	36"	29"	78"	42"	28"	132"	60"	37"

Detention Pipe Size (in.)	Outlet Orifice Size and Design Height for Type B Soils Only					
	Lowest Orifice Diameter (inches)	Distance from Outlet to Second Orifice (feet)	Second Orifice Diameter (inches)	Lowest Orifice Diameter (inches)	Distance from Outlet to Second Orifice (feet)	Second Orifice Diameter (inches)
36"	0.5	2.2	0.5	0.5	2.2	0.94
48"	0.5	3.3	0.94	0.5	3.2	0.9
60"	0.5	4.15	0.47	0.5	4.3	0.94

Detention Pipe Size (in.)	Outlet Orifice Size and Design Height for Type C Soils Only					
	Lowest Orifice Diameter (inches)	Distance from Outlet to Second Orifice (feet)	Second Orifice Diameter (inches)	Lowest Orifice Diameter (inches)	Distance from Outlet to Second Orifice (feet)	Second Orifice Diameter (inches)
36"	0.5	2	0.8	0.5	2.3	1.41
48"	0.5	3.2	0.8	0.5	3.3	1.17
60"	0.5	3.4	0.8	0.5	3.6	0.89

*Minimum diameter = 0.5 inches
 *Geotechnical Analysis or Soil Map Required
 Basis of Sizing Assumptions:
 -Based on the Stormwater Management Manual for Puget Sound Basin (1992 Manual)
 -Converting 2" growth forest to impervious
 -Assumes 0.5 foot sediment storage in detention pipe
 -Moderate slope
 -Include Volume Correction Factor, assuming 120% safety factor

Attachment 1 CITY OF MERCER ISLAND STANDARD DETENTION SYSTEM WORKSHEET (FOR IMPERVIOUS AREA OF 5,000 SF OR LESS)

PLAN VIEW

SECTION A-A

OWNER: CHEN
 ADDRESS: XXX West Mercer Way, Mercer Island, WA
 PERMIT #: _____
 IMPERVIOUS SURFACE AREA (SF): 3704
 PIPE DIA (INCH): 60
 PIPE MATERIAL: CORR ALUM

PREPARED BY: THE LAND DEVELOPER, INC.
 PHONE: 360-890-4806
 DATE: 5/11/21
 DETENTION PIPE LENGTH (FT): 26
 DETENTION PIPE LENGTH (FT): 26
 ORIFICE #1 DIA: 0.5 INCH, ELEV: 280.50
 ORIFICE #2 DIA: 1.28 INCH, ELEV: 286.40

STANDARD PIPE DETENTION SYSTEM
NOT TO SCALE (ENGINEER TO FILL IN BLANKS)

54 IN DIA TYPE 2 CATCH BASIN

RESTRICTOR CATCH BASIN NOTES:

- USE A MINIMUM OF A 7/8 IN. DIA. TYPE 2 CATCH BASIN WHEN CONNECTING PIPE MATERIAL IS CONCRETE OR LIME A 3/4 IN. DIA. TYPE 2 CATCH BASIN MAY BE USED FOR OTHER CIRCULAR SINGLE WALL PIPE (SUCH AS CORRUGATED ALUMINUM PIPE).
- OUTLET PIPE: MIN. 6 INCH.
- METAL PARTS: CORROSION RESISTANT; NON-GALVANIZED PARTS PREFERRED. GALVANIZED PIPE PARTS TO HAVE ASPHALT TREATMENT 1.
- FRAME AND LADDER OR STEPS OFFSET SO:
 - A. CLEANOUT GATE IS VISIBLE FROM TOP;
 - B. CLIMB-DOWN SPACE IS CLEAR OF RISER AND CLEANOUT GATE;
 - C. FRAME IS CLEAR OF CURB.
- IF METAL OUTLET PIPE CONNECTS TO CEMENT CONCRETE PIPE, OUTLET PIPE TO HAVE SMOOTH O.D. EQUAL TO CONCRETE PIPE I.D. LESS 1/4 IN.
- PROVIDE AT LEAST ONE 3 X 0.090 GAUGE SUPPORT BRACKET ANCHORED TO CONCRETE WALL WITH 5/8 IN. STAINLESS STEEL EXPANSION BOLTS OR BRIDGED SUPPORTS 2 IN. INTO CATCH BASIN WALL, MAXIMUM 3'-0" VERTICAL SPACING.
- THE SHEAR GATE SHALL BE MADE OF ALUMINUM ALLOY IN ACCORDANCE WITH ASTM B 28M AND ASTM B 275, DESIGNATION Z525A; OR CAST IRON IN ACCORDANCE WITH ASTM A 48, CLASS 30B. THE LEFT HANDLE SHALL BE MADE OF A SIMILAR METAL TO THE GATE TO PREVENT GALVANIC CORROSION. IT MAY BE OF SOLID ROD OR HOLLOW TUBING WITH ADJUSTABLE HOOK AS REQUIRED. A RESILIENT RUBBER GASKET IS REQUIRED BETWEEN THE RISER MOUNTING FLANGE AND THE GATE FLANGE. INSTALL THE GATE SO THAT THE LEVEL-LINE MARK IS LEVEL WHEN THE GATE IS CLOSED. THE MOUNTING SURFACES OF THE LD AND THE BODY SHALL BE MACHINED FOR PROPER FIT. ALL SHEAR GATE BOLTS SHALL BE STAINLESS STEEL.

STANDARD DETENTION SYSTEM NOTES:

- CALL DEVELOPMENT SERVICES (206-275-7605) 24 HOURS IN ADVANCE FOR A DETENTION SYSTEM INSPECTION BEFORE BACKFILLING AND FOR FINAL INSPECTIONS.
- RESPONSIBILITY FOR OPERATION AND MAINTENANCE OF DRAINAGE SYSTEMS ON PRIVATE PROPERTY IS RESPONSIBILITY OF THE PROPERTY OWNER. MATERIAL ACCUMULATED IN THE STORAGE PIPE MUST BE REMOVED FROM CATCH BASIN TO ALLOW PROPER OPERATION. THE OUTLET CONTROL ORIFICE MUST BE KEPT OPEN AT ALL TIMES.
- PIPE MATERIAL, JOINT, AND PROTECTIVE TREATMENT SHALL BE IN ACCORDANCE WITH SECTION 7.04 AND 8.06 OF THE WSDOT STANDARD SPECIFICATION FOR ROAD, BRIDGE, AND MINORIAL CONSTRUCTION, LATEST VERSION. SUCH MATERIALS INCLUDE THE FOLLOWING: UNID CORRUGATED POLYETHYLENE PIPE (LOPER, ALUMINUM TYPE 2, CORRUGATED STEEL PIPE AND PIPE ARCH (MEETS ASHRAE RESISTANCES M274 AND M26), CORRUGATED OR SPIRAL RE ALUMINUM PIPE, OR REINFORCED CONCRETE PIPE. CORRUGATED STEEL PIPE IS NOT ALLOWED.

DRAWN BY: USA CYFORD

RECTANGULAR ADJUSTMENT SECTION

PIPE ALLOWANCES	
PIPE MATERIAL	MAXIMUM INSIDE DIAMETER (INCHES)
REINFORCED OR PLAIN CONCRETE	12"
ALL METAL PIPE	15"
CPSSP * (STD. SPEC. SECT. 9-05.20)	12"
SOLID WALL PVC (STD. SPEC. SECT. 9-05.12(1))	15"
PROFILE WALL PVC (STD. SPEC. SECT. 9-05.12(2))	15"

* CORRUGATED POLYETHYLENE STORM SEWER PIPE

PRECAST BASE SECTION

ALTERNATIVE PRECAST BASE SECTION

- NOTES**
- As acceptable alternatives to the rebar shown in the **PRECAST BASE SECTION**, fibers (placed according to the Standard Specifications), or wire mesh having a minimum area of 0.12 square inches per foot shall be used with the minimum required rebar shown in the **ALTERNATIVE PRECAST BASE SECTION**. Wire mesh shall not be placed in the knockouts.
 - The knockout diameter shall not be greater than 20" (in). Knockouts shall have a wall thickness of 2" (in) minimum to 2.5" (in) maximum. Provide a 1.5" (in) minimum gap between the knockout wall and the outside of the pipe. After the pipe is installed, fill the gap with joint mortar in accordance with **Standard Specification Section 9-04.3**.
 - The maximum depth from the finished grade to the lowest pipe invert shall be 5' (ft).
 - The frame and grate may be installed with the flange down, or integrally cast into the adjustment section with flange up.
 - The Precast Base Section may have a rounded floor, and the walls may be sloped at a rate of 1 : 24 or steeper.
 - The opening shall be measured at the top of the **Precast Base Section**.
 - All pickup holes shall be grouted full after the basin has been placed.

Heilman, Julie
Jan 25 2017 2:53 PM

CATCH BASIN TYPE 1

STANDARD PLAN B-5.20-02

SHEET 1 OF 1 SHEET

APPROVED FOR PUBLICATION
Carpenter, Jeff
Jan 26 2017 1:48 AM

STATE DESIGN ENGINEER
Washington State Department of Transportation

THE LAND DEVELOPER'S ENGINEERED SOLUTION
a division of
THE LAND DEVELOPER, LLC

5737 LINDERSON WAY SW,
TUMWATER, WA 98501
PO BOX 4420, TUMWATER, WA 98501
(360) 890-4806
E-MAIL: erl@thelanddeveloper.com

DATE: _____

REVISIONS: _____

CHEN RESIDENCE

PROJECT:
CHEN RESIDENCE
W MERCER WAY
MERCER ISLAND, WA 98040

CLIENT:
ATERA HOMES, LLC
451 DUVALL AVE NE, SUITE 155
RENTON, WA 98059

DETAILS

DRAWN BY: EBA

DATE: 4/16/24


AGENCY NO: _____

SHEET: 4 OF 6


JOB NO: 20-122

SE 1/4, SECTION 20, TOWNSHIP 26 N., RANGE 5 E., W.M.

SCALE: 1" = 10'

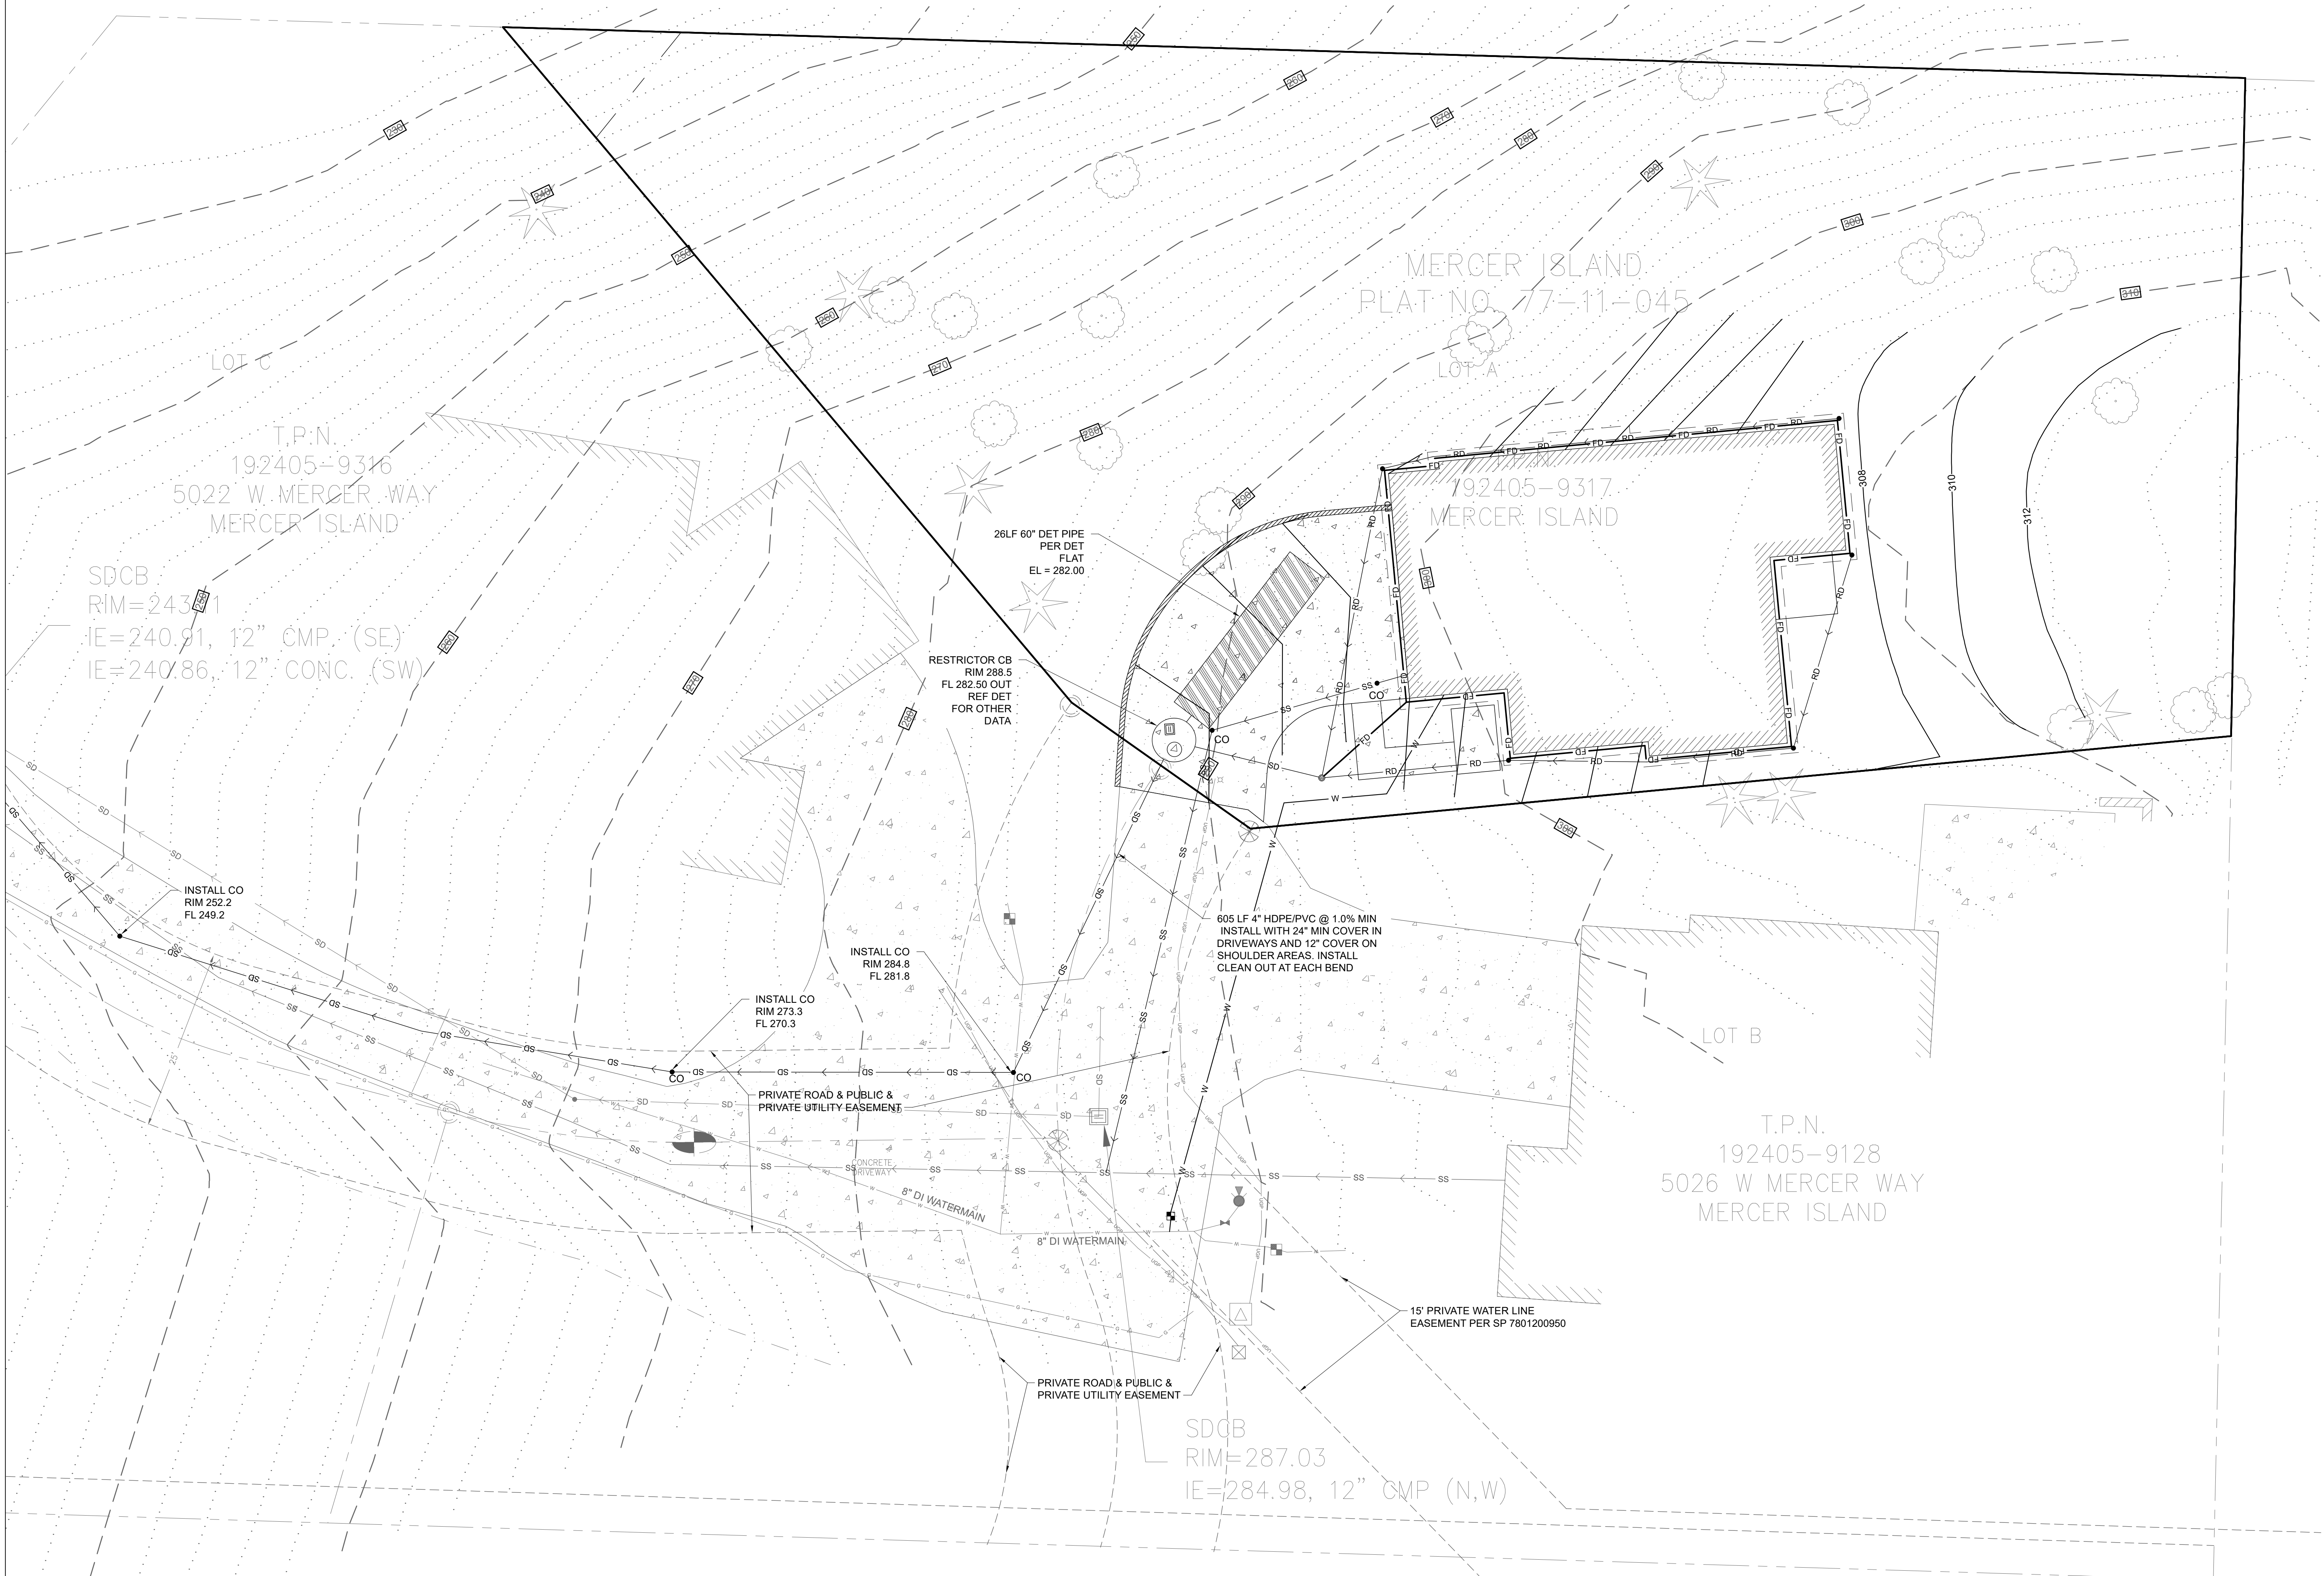

THE LAND DEVELOPER'S ENGINEERED SOLUTION
a division of THE LAND DEVELOPER, LLC
 5737 LINDERSON WAY SW.
 TUMWATER, WA 98501
 PO BOX 4420, TUMWATER, WA 98501
 (360) 890-4806
 E-MAIL: erik@thelanddeveloper.com

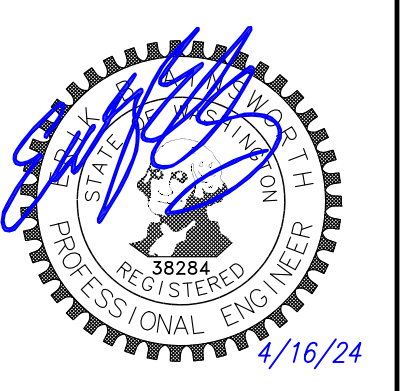

DATE:	
REVISIONS:	

CHEN RESIDENCE
OFFSITE DRAINAGE PLAN


PROJECT:
 CHEN RESIDENCE
 W MERCER WAY
 MERCER ISLAND, WA 98040

CLIENT:
 ATERA HOMES, LLC
 451 DUVALL AVE NE, SUITE 155
 RENTON, WA 98059


DRAWN BY: EBA
 DATE: 4/16/24
 AGENCY NO:
 SHEET: 5 OF 6
 JOB NO: 20-122

SE 1/4, SECTION 20, TOWNSHIP 26 N., RANGE 5 E., W.M.

SCALE: 1" = 10'

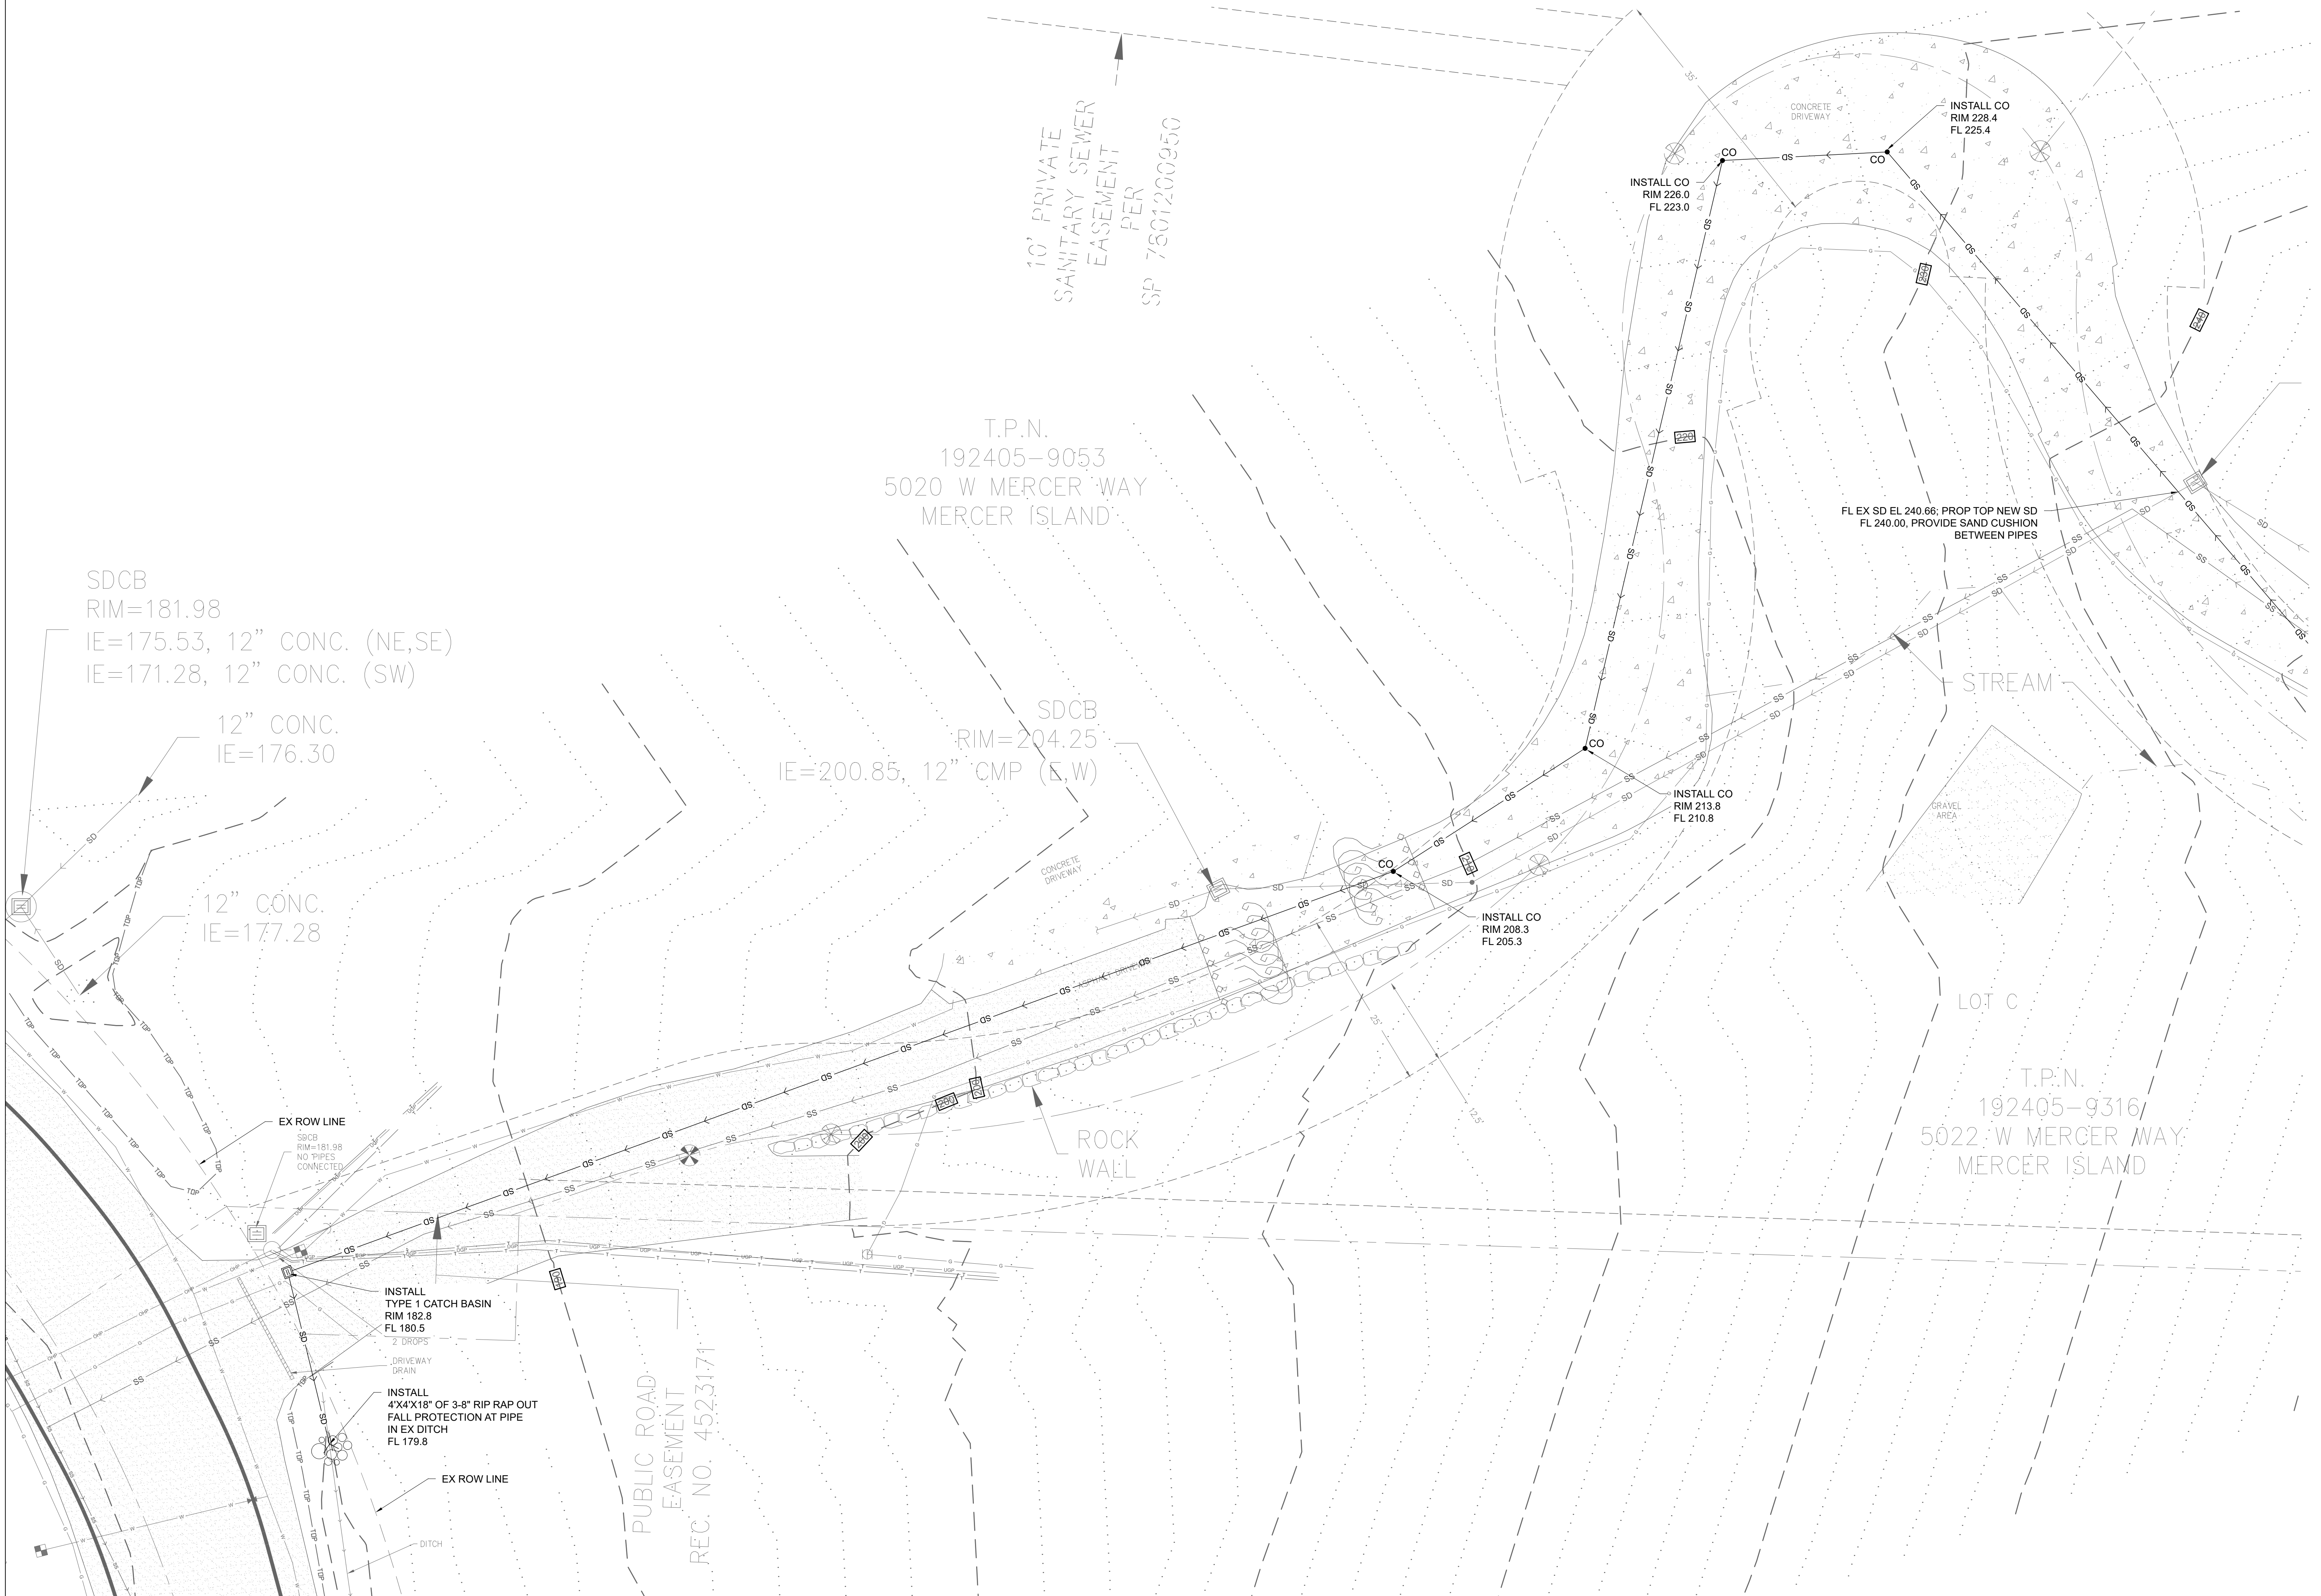

THE LAND DEVELOPERS ENGINEERED SOLUTION
a division of THE LAND DEVELOPER, LLC
 5737 LINDERSON WAY SW.
 TUMWATER, WA. 98501
 PO BOX 4420, TUMWATER, WA. 98501
 (360) 890-4806
 E-MAIL: erik@thelanddeveloper.com

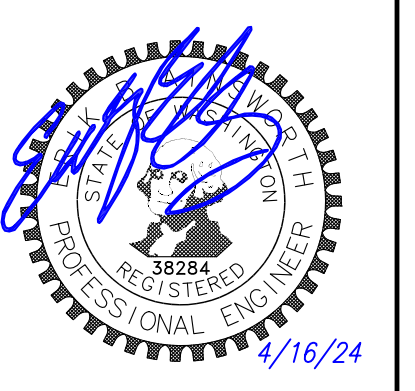


DATE:	
REVISIONS:	

CHEN RESIDENCE
DRAINAGE PLAN

PROJECT:
 CHEN RESIDENCE
 W MERCER WAY
 MERCER ISLAND, WA 98040
 CLIENT:
 ATERA HOMES, LLC
 451 DUVALL AVE NE, SUITE 155
 RENTON, WA 98059

DRAWN BY: EBA
 DATE: 4/16/24
 AGENCY NO:
 SHEET: 6 OF 6
 JOB NO: 20-122

PREPARED BY:
NEAL BAKER
ARBORISTS NW.COM
ISA CERT. PN1075A
TRAQ ISA (TREE RISK ASSESSMENT QUALIFIED)
MEMBER AREA & SOCA
PH: 206 779 2579

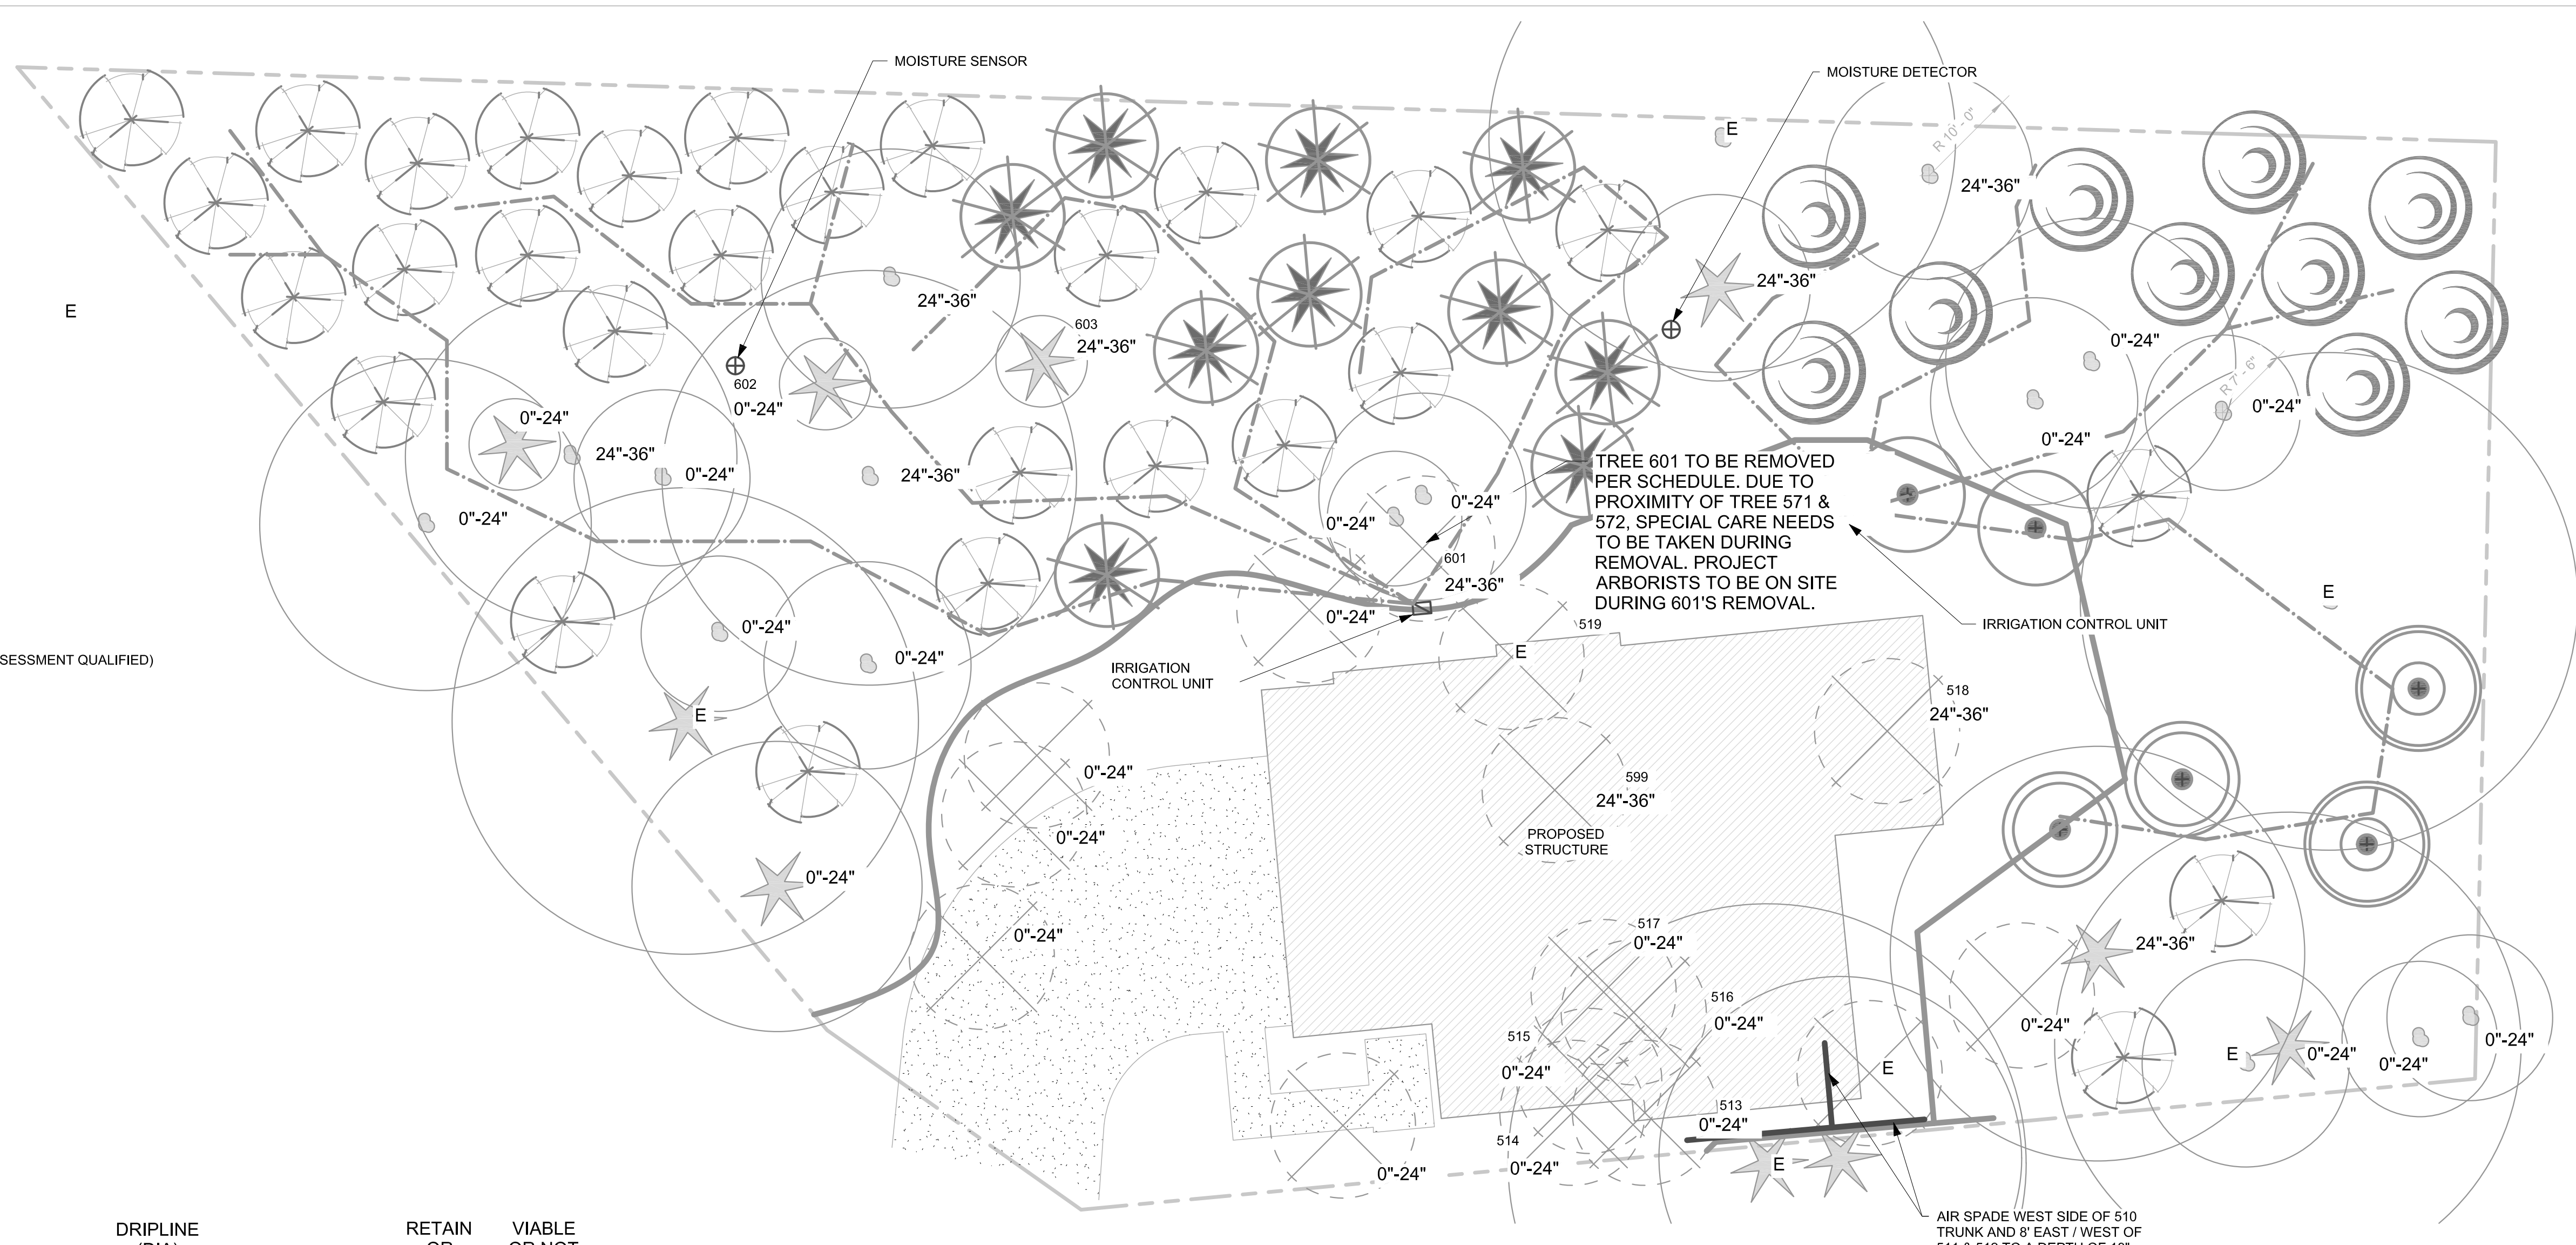

Arborists NW is a full spectrum arboricultural, consulting and landscape design and installation provider. When you think tree and landscape services, think Arborists NW.
ONLINE: <https://arboristsnw.com/>
PHONE: 206-779-2579
EMAIL: neal@arboristsnw.com

No.	Description	Date

TREE #	TREE TYPE	DBH	DRIPLINE (DIA) CRZ/LOD	CONDITION	RETAIN OR REMOVE	VIABLE OR NOT VIABLE	NOTES
508.	DOUGLAS FIR (Pseudotsuga menziesii)	30"	40'	FAIR/GOOD	RETAIN	VIABLE	ARBORISTS SITE PLAN 1" = 10'-0"
509	DOUGLAS FIR (Pseudotsuga menziesii)	16"	24'	FAIR/GOOD	REMOVE	VIABLE	
510	DOUGLAS FIR (Pseudotsuga menziesii)	36.5"	45'	POOR	REMOVE	NOT VIABLE	
511	DOUGLAS FIR (Pseudotsuga menziesii)	28"	35'	FAIR/GOOD	RETAIN	VIABLE	
512	DOUGLAS FIR (Pseudotsuga menziesii)	36"	50'	FAIR/GOOD	RETAIN	VIABLE	
513	DOUGLAS FIR (Pseudotsuga menziesii)	8"	15'	FAIR/GOOD	REMOVE	VIABLE	
514	BLACK PINE (Pinus thunbergia)	8"	15'	FAIR/GOOD	REMOVE	VIABLE	
515	DOUGLAS FIR (Pseudotsuga menziesii)	8"	15'	FAIR/GOOD	REMOVE	VIABLE	
516	BIG LEAF MAPLE (Acer macrophyllum)	12"	20'	FAIR/GOOD	REMOVE	VIABLE	
517	BIG LEAF MAPLE (Acer macrophyllum)	18"	28'	FAIR/GOOD	REMOVE	VIABLE	
518	BIG LEAF MAPLE (Acer macrophyllum)	30"	60'	EXC. LEAN	REMOVE	NOT VIABLE	
519	BIG LEAF MAPLE (Acer macrophyllum)	36"	40'	FAIR/GOOD	REMOVE	NOT VIABLE	
538	BIG LEAF MAPLE (Acer macrophyllum)	12"	20'	FAIR/GOOD	RETAIN	VIABLE	
539	BIG LEAF MAPLE (Acer macrophyllum)	18"	28'	FAIR/GOOD	RETAIN	VIABLE	
540	BIG LEAF MAPLE (Acer macrophyllum)	7"	15'	FAIR/GOOD	RETAIN	VIABLE	
543	RED ALDER (Alnus rubra)	12"	16'	POOR	RETAIN	NOT VIABLE	
544	BIG LEAF MAPLE (Acer macrophyllum)	8"	15'	FAIR/GOOD	RETAIN	VIABLE	
545	DOUGLAS FIR (Pseudotsuga menziesii)	28"	45'	FAIR/GOOD	RETAIN	VIABLE	
546	MADRONA (Arbutus menziesii)	12"	20'	FAIR/GOOD	RETAIN	VIABLE	
556	BIG LEAF MAPLE (Acer macrophyllum)	36"	48'	POOR	RETAIN	NOT VIABLE	
565	BIG LEAF MAPLE (Acer macrophyllum)	14"	20'	FAIR/GOOD	RETAIN	VIABLE	
566	WESTERN RED CEDAR (Thuja plicata)	10"	18'	FAIR/GOOD	RETAIN	VIABLE	
567	BIG LEAF MAPLE (Acer macrophyllum)	36"	45'	FAIR/GOOD	RETAIN	VIABLE	
571	BIG LEAF MAPLE (Acer macrophyllum)	14"	20'	FAIR/GOOD	RETAIN	VIABLE	
572	BIG LEAF MAPLE (Acer macrophyllum)	8"	13'	FAIR/GOOD	RETAIN	VIABLE	
573	BIG LEAF MAPLE (Acer macrophyllum)	18"	30'	FAIR/GOOD	REMOVE	VIABLE	
576	BIG LEAF MAPLE (Acer macrophyllum)	11"	15'	FAIR/GOOD	REMOVE	VIABLE	
577	BIG LEAF MAPLE (Acer macrophyllum)	6"	10'	FAIR/GOOD	REMOVE	VIABLE	
578	BIG LEAF MAPLE (Acer macrophyllum)	16.7"	25'	FAIR/GOOD	REMOVE	VIABLE	
579	DOUGLAS FIR (Pseudotsuga menziesii)	18"	28'	FAIR/GOOD	RETAIN	VIABLE	
581	WESTERN RED CEDAR (Thuja plicata)	36"	45'	FAIR/GOOD	RETAIN	VIABLE	
582	BIG LEAF MAPLE (Acer macrophyllum)	9"	15'	FAIR/GOOD	RETAIN	VIABLE	
583	BIG LEAF MAPLE (Acer macrophyllum)	12"	20'	FAIR/GOOD	RETAIN	VIABLE	
584	BIG LEAF MAPLE (Acer macrophyllum)	30"	40'	FAIR/GOOD	RETAIN	VIABLE	
586	BIG LEAF MAPLE (Acer macrophyllum)	28.4"	25'	FAIR/GOOD	RETAIN	VIABLE	
587	BIG LEAF MAPLE (Acer macrophyllum)	12"	17'	FAIR/GOOD	RETAIN	VIABLE	
588	BIG LEAF MAPLE (Acer macrophyllum)	27.7"	32'	FAIR/GOOD	RETAIN	VIABLE	
589	WESTERN RED CEDAR (Thuja plicata)	6"	10'	FAIR/GOOD	RETAIN	VIABLE	
590	BIG LEAF MAPLE (Acer macrophyllum)	19.7"	32'	FAIR/GOOD	RETAIN	VIABLE	
593	WESTERN RED CEDAR (Thuja plicata)	36"	48'	FAIR/GOOD	RETAIN	VIABLE	
594	WESTERN RED CEDAR (Thuja plicata)	36"	48'	FAIR/GOOD	RETAIN	VIABLE	
599	NORWAY SPRUCE (Picea abies)	11"	14'	GOOD	REMOVE	VIABLE	
600	PORTUGUESE LAUREL (Prunus lusitanica)	10.6"	14'	FAIR/GOOD	RETAIN	VIABLE	
601	BIG LEAF MAPLE (Acer macrophyllum)	28"	32'	DEAD	REMOVE	NOT VIABLE	
602	DOUGLAS FIR (Pseudotsuga menziesii)	22"	28'	DEAD	RETAIN	NOT VIABLE	
603	WESTERN RED CEDAR (Thuja plicata)	30"	STUB	DEAD	RETAIN	NOT VIABLE	

	TREE DRIP LINE		DOUGLAS FIR	10
	EVERGREEN TREE		WESTER RED CEDAR	10
	DECIDUOUS TREE		VINE MAPLE	29
	TREE TO BE REMOVED		Fuyu persimmon	2
	TREE PROTECTION FENCING MUST BE PLACED PRIOR TO CONSTRUCTION ACTIVITY		Magnolia	2
	"E" REPRESENTS EXCEPTIONAL TREES. IN EXCESS OF 36" DBH		Flowering dogwoods	2

TROLMASTER IRRIGATION SYSTEM:

AQUATEX NFS-1 CONTROL UNIT	2	
WD-1 DETECTION UNIT	2	
IRRIGATION DRIPLINE	8	

REPLANTING PLAN:
WESTERN RED CEDAR *Thuja plicata*
VINE MAPLE *Acer circinatum*
DOUGLAS FIR *Pseudotsuga menziesii*
Conifers at least six feet tall and deciduous at least one and one-half inches in diameter at base.

NOTE: RANGE FINDER WAS USED TO DETERMIN DRIPLINE/CRZ/LOD

CHEN RESIDENCE
50XX W MERCER WAY, MERCER ISLAND 98040

CHEN RESIDENCE
ARBORIST TREE PLAN

Project number
Date
Drawn by CW
Checked by NB

A102

Scale As indicated

TREE PROTECTION

CHAIN LINK FENCE REQUIRED FOR TREE PROTECTION

TREE PROTECTION

CHAIN LINK FENCE REQUIRED FOR TREE PROTECTION

SOIL INSPECTION
REQUIRED BY ENGINEER

MINIMUM 10% ORGANIC
MULCH AND COMPOST
SOIL REQUIRED


SOIL AMENDMENT REQUIRED

COMPOST AMENDED SOIL REQUIRED ON ALL LANDSCAPED AREAS AFTER CONSTRUCTION.
SEE DETAIL.


SOIL INSPECTION REQUIRED BY ENGINEER

A POST CONSTRUCTION INSPECTION AND CERTIFICATION OF AMENDED SOILS IS REQUIRED BY
A LICENSED CIVIL ENGINEER. THIS IS REQUIRED BEFORE FINAL SIGN-OFF BY CITY.

COMPOST AMENDED SOIL SPEC

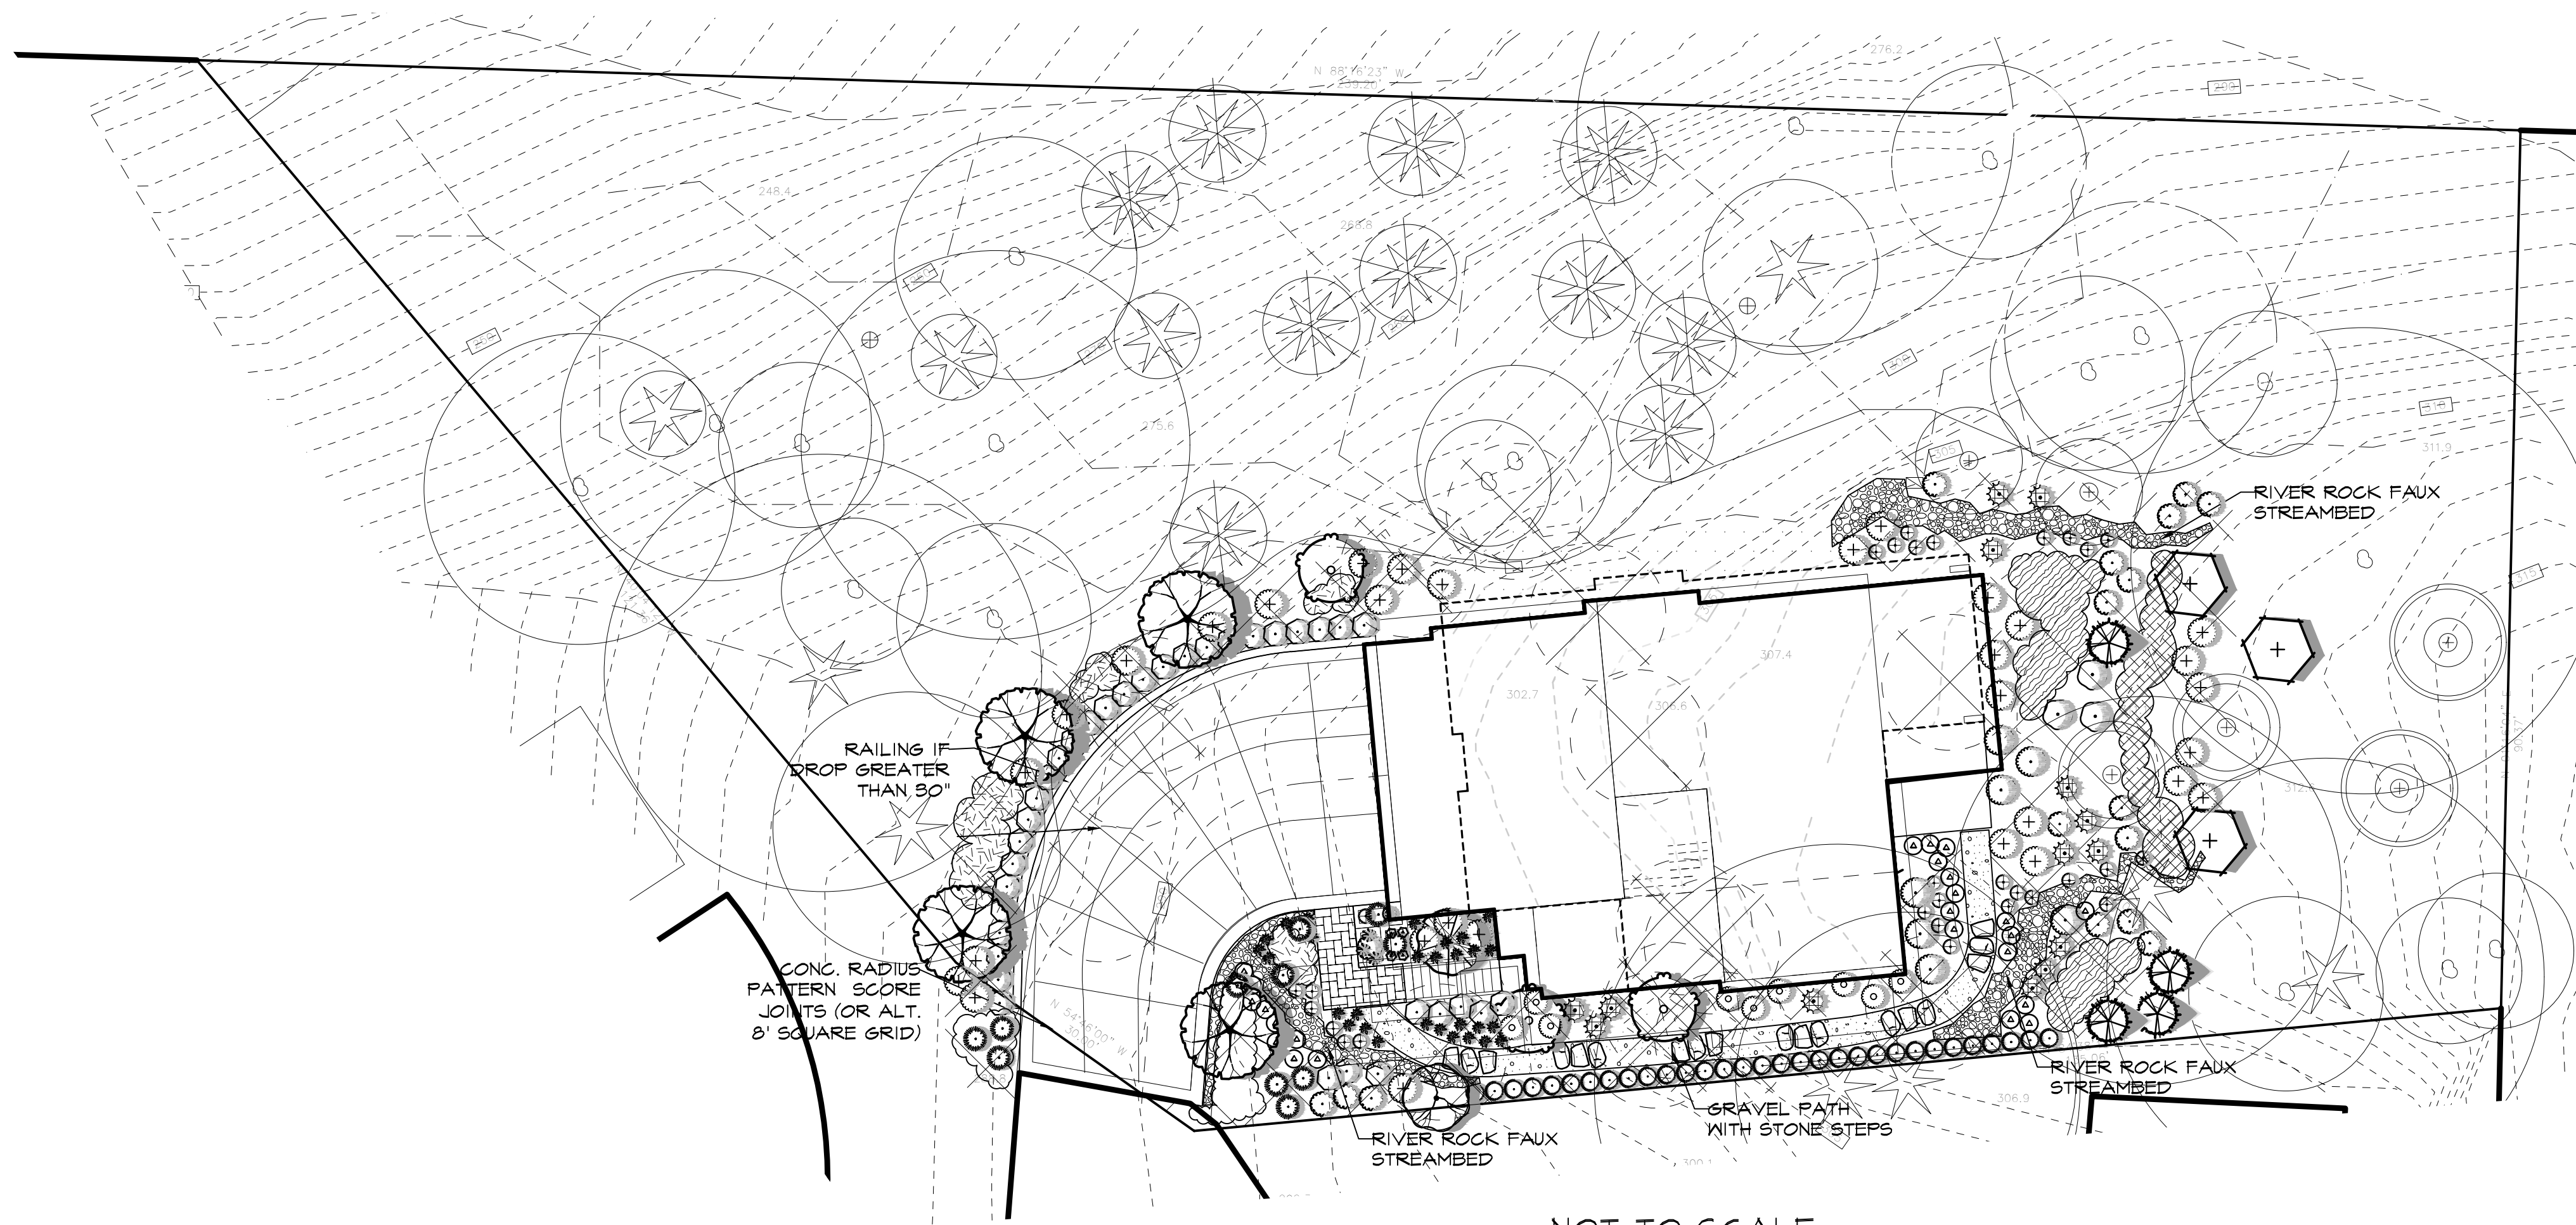

NOT TO SCALE

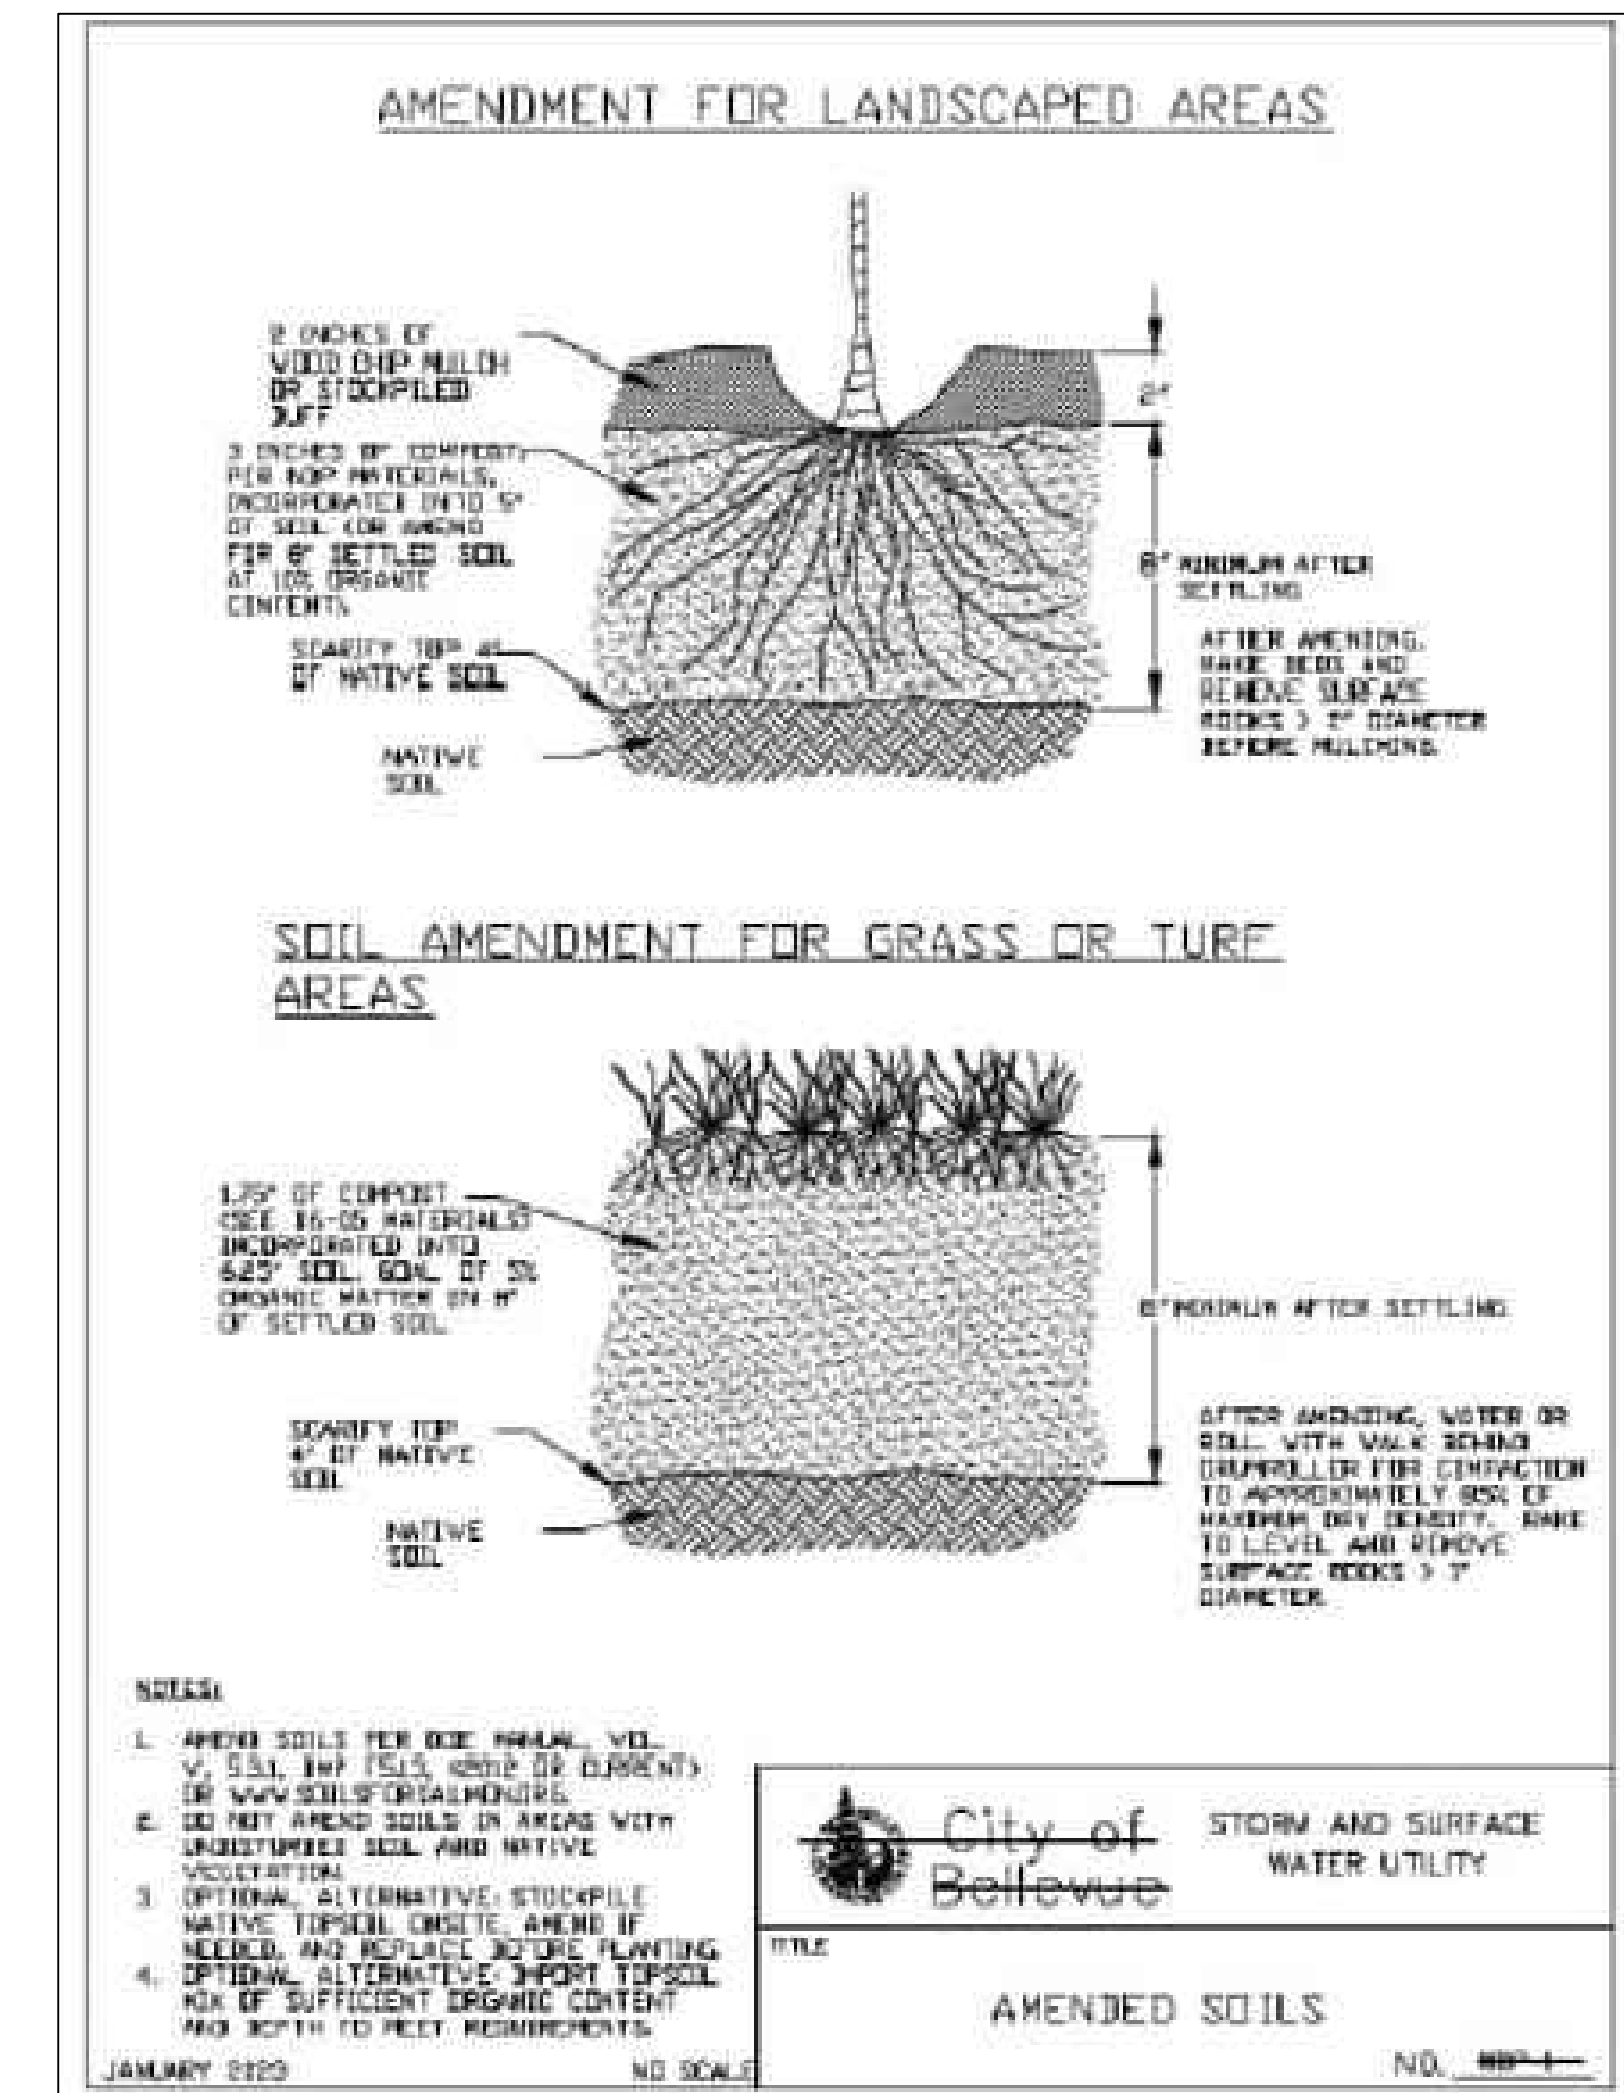


Created: 12-28-23 PRELIMINARY PLAN
 L: 4-26-24 REVISED TO ADD TREES AND SOIL REQUIREMENTS
 Drawn: REB
 GCA

CRAMER DESIGN CONSULTANTS, INC.
 LANDSCAPE ARCHITECT
 1909 242ND STREET SE
 BOTHELL, WA 98021
 425-241-6258

STATE OF WASHINGTON
 REGISTERED
 LANDSCAPE ARCHITECT
Rayl Cramer
 RAYL L. CRAMER
 CERTIFICATE NO. 6334

CHEN RESIDENCE
 5024 N. MERCER WAY, MERCER ISLAND, WA

SHEET
L-01
 OF 2 SHEETS

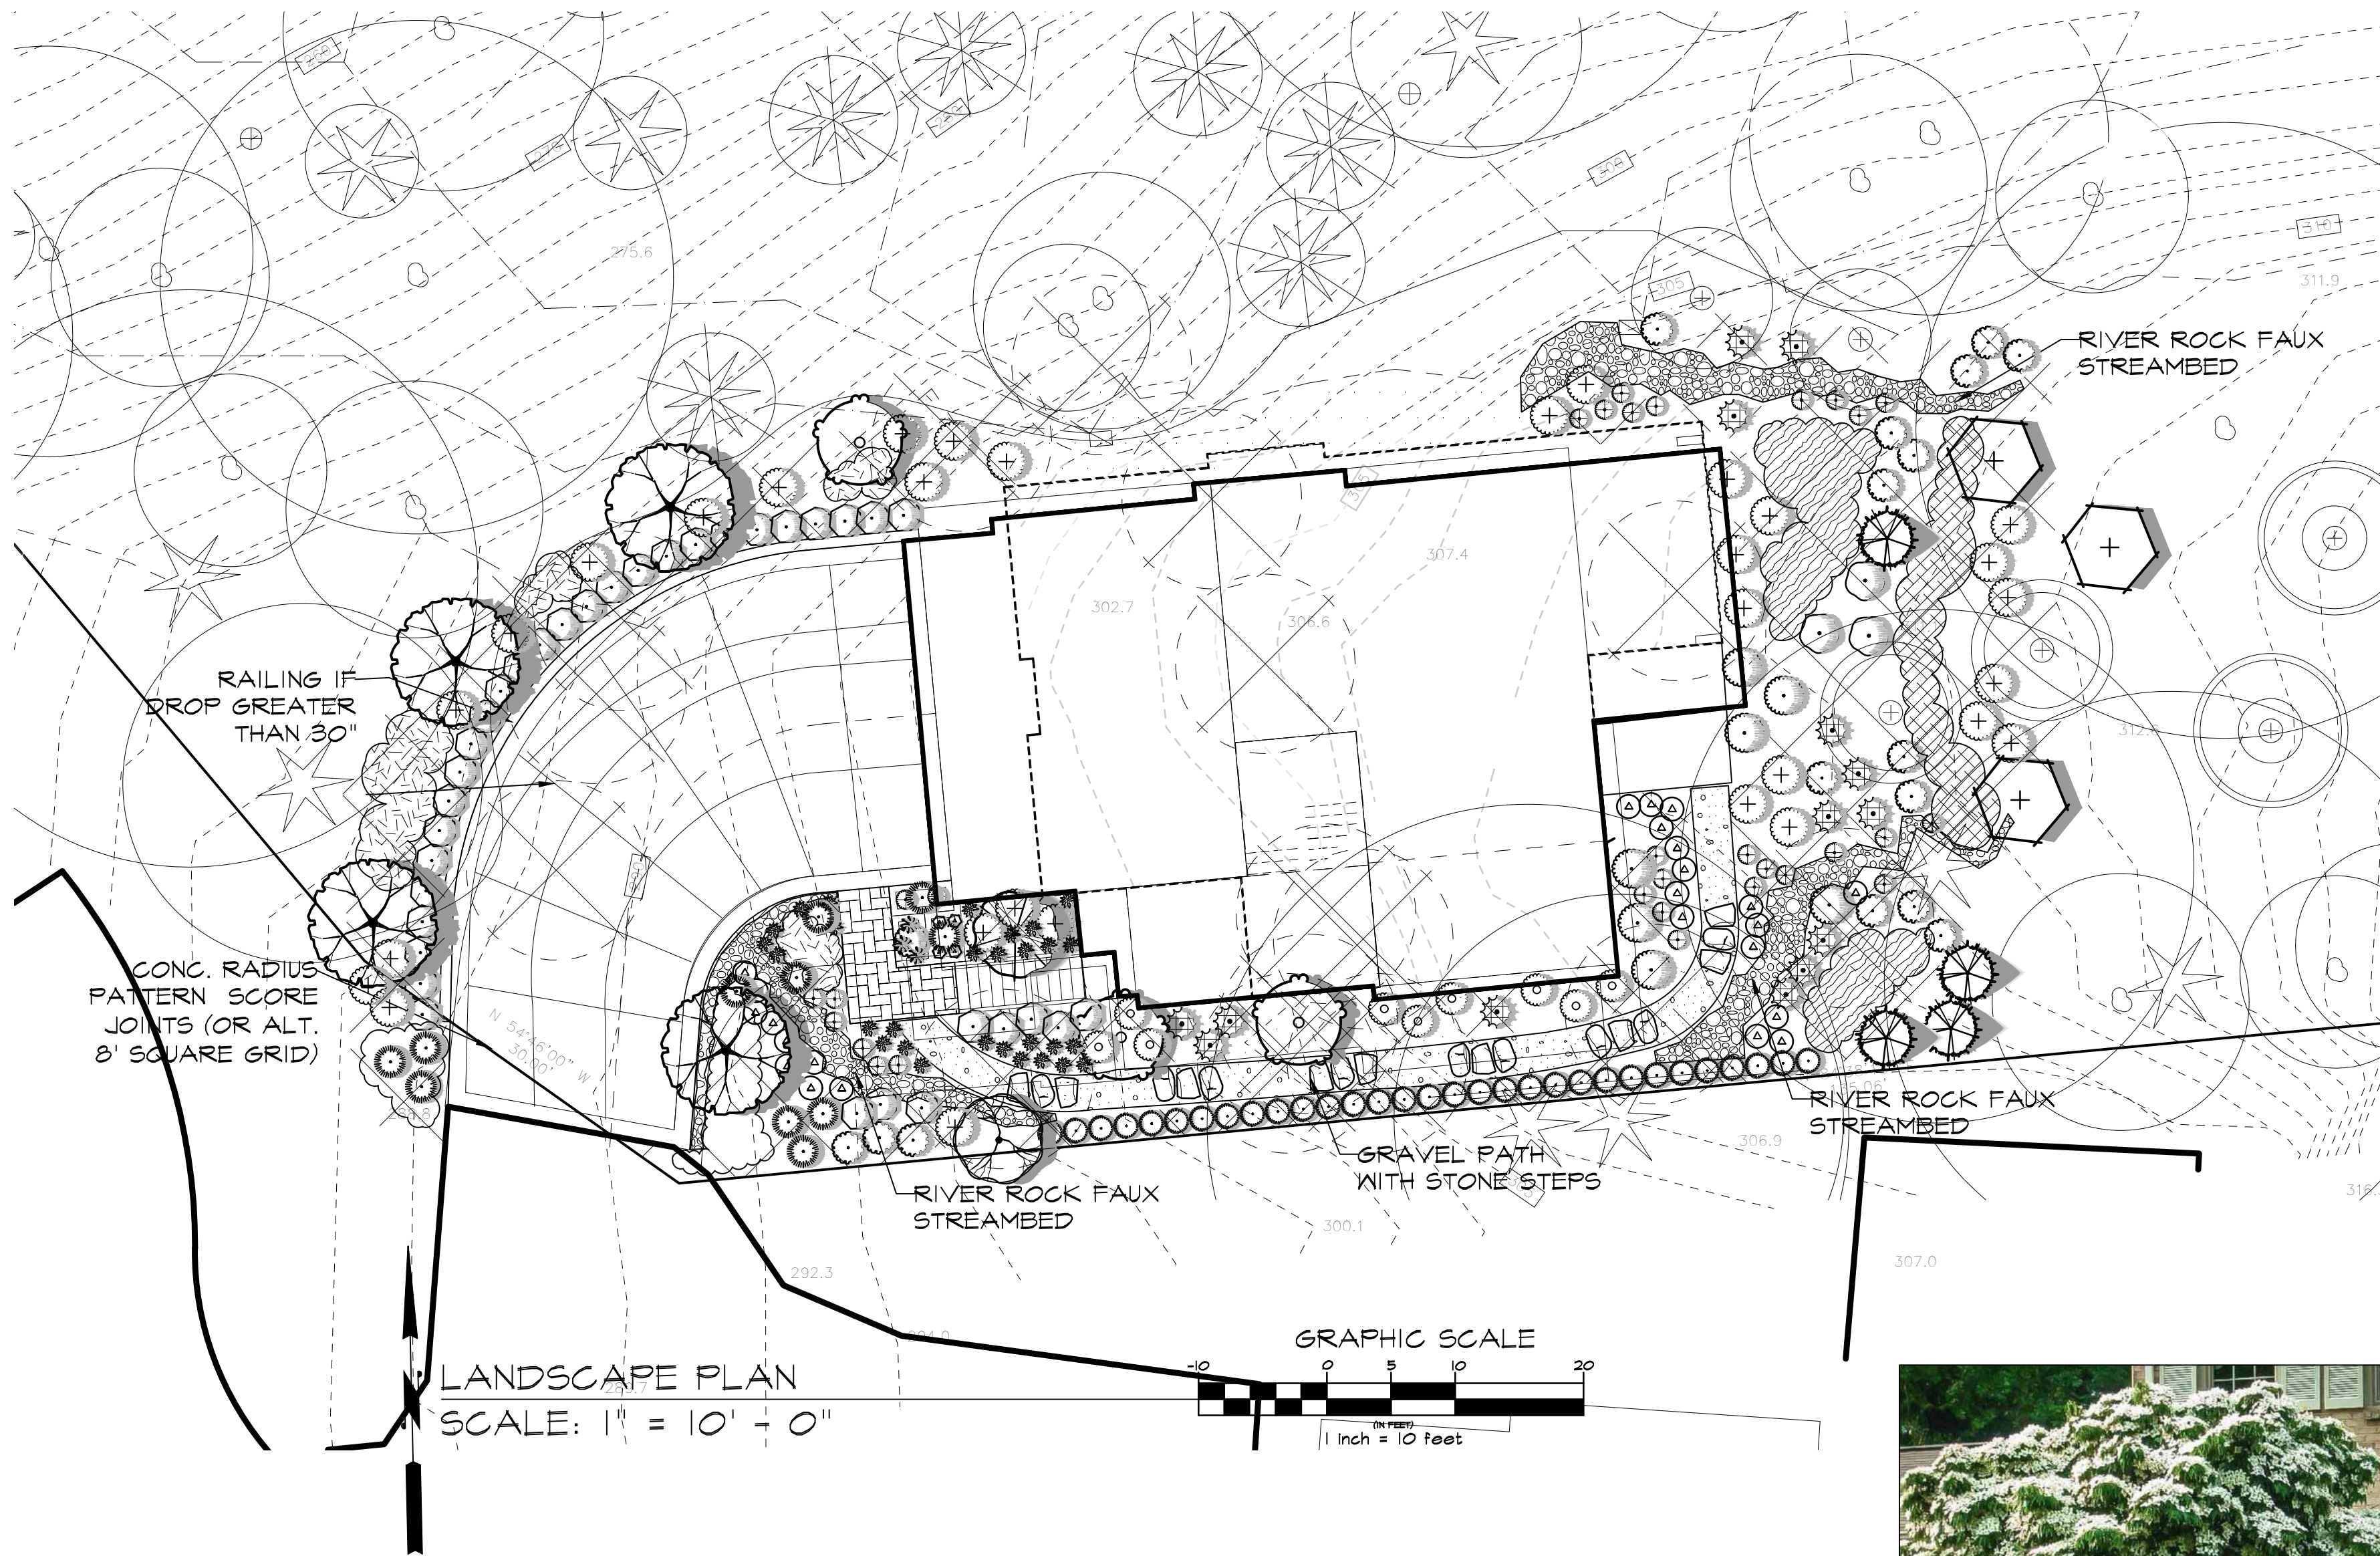


LANDSCAPE PLAN
SCALE: 1" = 10' - 0"

	TREE DRIP LINE		DOUGLAS FIR	10
	EVERGREEN TREE		WESTER RED CEDAR	10
	DECIDUOUS TREE		VINE MAPLE	29
	TREE TO BE REMOVED		Fuyu persimmon	2
	TREE PROTECTION FENCING MUST BE PLACED PRIOR TO CONSTRUCTION ACTIVITY		Magnolia	2
	"E" REPRESENTS EXCEPTIONAL TREES. IN EXCESS OF 36" DBH		Flowering dogwoods	2



PLANT SCHEDULE


SYMBOL	BOTANICAL / COMMON NAME	SIZE	SPACING	QTY
DECIDUOUS TREES				
	Acer palmatum 'Sango Kaku' / Coral Bark Maple or similar small specimen tree	6'-7' Ht.		1
	Carpinus betulus 'Columnaris' / Columnar European Hornbeam	2' Cal		3
REPLACEMENT TREES				
	Acer circinatum / Vine Maple	2' Cal		3
	Acer palmatum 'Bloodgood' / Bloodgood Japanese Maple	6'-7' Ht		1
	Cornus kousa / Kousa Dogwood	6'-7' Ht		4
	Tsuga mertensiana / Mountain Hemlock	4'-6' Ht		4
SHRUBS				
	Azalea x 'Hino-crimson' / Hino-crimson Kurume Azalea	2 gal		30
	Choisya ternata 'Sundance' / Golden Mexican Mock Orange	5 gal		14
	Euonymus japonicus 'Silver King' / Silver King Euonymus	5 gal		1
	Hydrangea macrophylla 'Coerulea Lace' / Blue Lacecap Hydrangea	24/30"		3
	Hydrangea quercifolia / Oakleaf Hydrangea	5 gal		7
	Ilex crenata 'Green Lustre' / Green Luster Japanese Holly	3 gal		24
	Pieris japonica / Lily of the Valley Bush	24/30"		9
	Prunus laurocerasus 'Otto Luyken' / Otto Luyken Laurel	24/30"		35
	Rhododendron var. / Rhododendron	5 gal		31
	Rhododendron x 'Scarlet Wonder' / Scarlet Wonder Dwarf Rhododendron	5 gal		16
	Thuja occidentalis / Emerald Green thuja Match Existing	5'-6" Ht		31
GRASSES				
	Carex oshimensis 'Evergold' / Variegated Japanese Sedge	1 gal		29
	Helictotrichon sempervirens / Blue Oat Grass	1 gal		3
	Miscanthus sinensis 'Morning Light' / Eulalia Grass	5 gal		11
ANNUALS/PERENNIALS				
	Bergenia x 'Morning Red' / Bergenia	1 gal		4
GROUND COVERS				
	Arctostaphylos uva-ursi 'Emerald Carpet' / Emerald Carpet Manzanita	1 gal	30" o.c.	28
	Liriope muscari / Lily Turf	1 gal	36" o.c.	26
	Ophiopogon planiscapus 'Nigrescens' / Black Mondo Grass	4" pot	12" o.c.	127
SITE WORK				
	BARK 2" Depth	None		225 sf
	PLANTING BEDS 2" Bark, 6" Soil	None		2,789 sf
	RIVER ROCK	None		260 sf

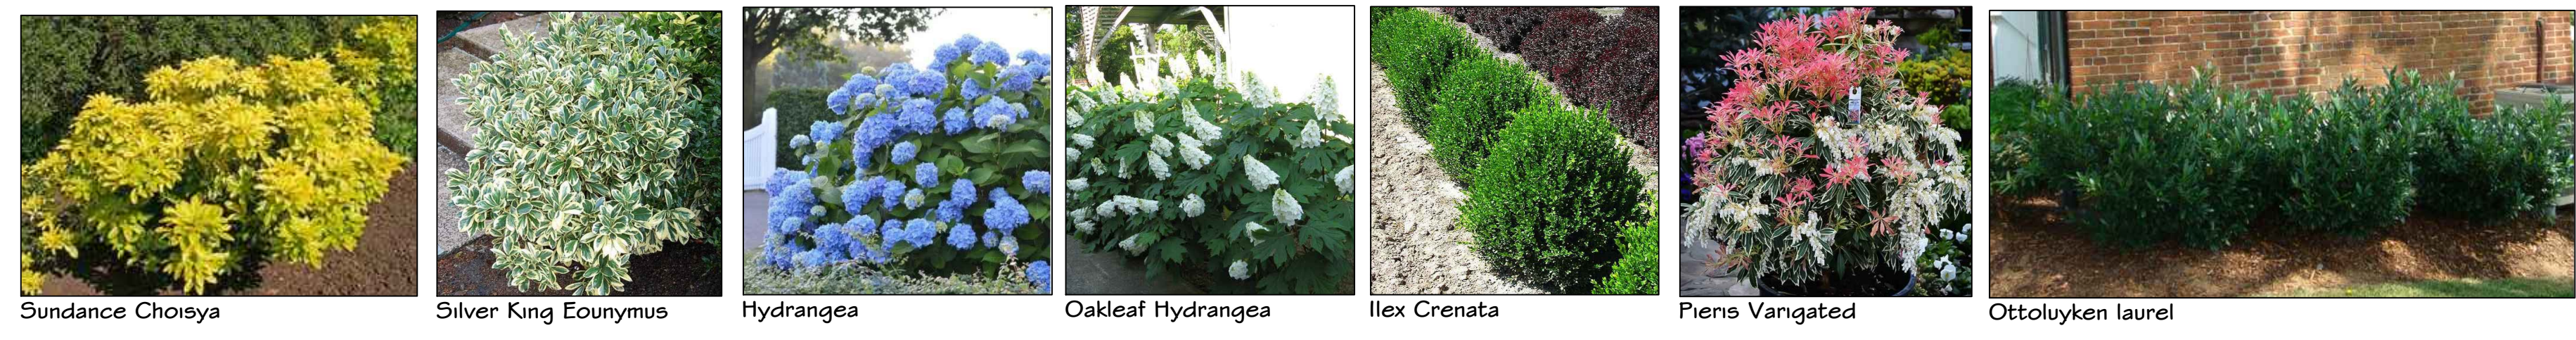

NOTES:
NO LAWN IS PROPOSED
ALL LANDSCAPING IS IN PLANTING BEDS
TOTAL PLANTING AREAS = 2789 SF
TOTAL MULCH/ BARK AREAS = 225 SF

Drawn: REB
 Checked: 12-8-23 PRELIMINARY PLAN
 1. 4-3-24 changed lawn to planting beds and added plants removed walls
 2. 4-26-24 added ex trees and replacement trees
 GCA
 GCA

CRAMER DESIGN CONSULTANTS, INC.
 LANDSCAPE ARCHITECT
 1909 242ND STREET SE
 BOTHELL, WA 98021
 425-241-6258

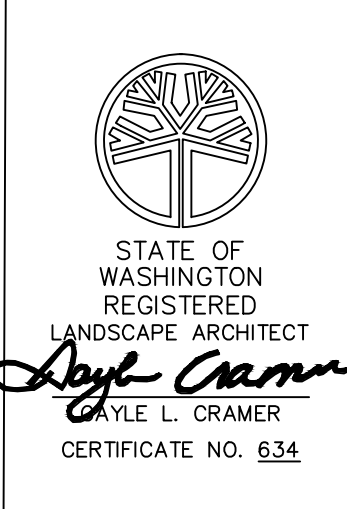

CHEN RESIDENCE
 5024 W. MERCER WAY, MERCER ISLAND, WA

Chen Residence

ABBREVIATIONS

A.C.T.	ACOUSTICAL CLG TILE	REFER	REFRIGERATOR
CD	CARBON MONOXIDE DETECTOR	R.A.	RETURN AIR
CLG	CEILING	R.O.	ROUGH OPENING
C.T.	COMMON TRUSS	R&S	ROD AND SHELF
CLR	CLEAR	S.A.	SUPPLY AIR
COMP	COMPOSITION	SCHED	SCHEDULE
CONC	CONCRETE	SD	SMOKE DETECTOR
DBL	DOUBLE	SH	SHELVES
DIA	DIAMETER	SHT	SHEET
F.F.	FINISH FLOOR	SHWR	SHOWER
F.E.	FIRE EXTINGUISHER	SIM	SIMILAR
F.E.C.	FIRE EXTINGUISHER CABINET	S.S.	STAINLESS STEEL
F.D.	FLOOR DRAIN	STOR	STORAGE
FLR	FLOOR	SUSP	SUSPENDED
G.T.	GIRDER TRUSS	TEL	TELEPHONE
GWB	GYPSPUM WALL BOARD	THERM	THERMOSTAT
GYP	GYPSPUM	TYP	TYPICAL
HDWD	HARDWOOD	U.C.L.	UNDERCABINET LIGHTS
HGT	HEIGHT	U.N.O.	UNLESS NOTED OTHERWISE
H.M.	HIP MASTER	V	VINYL
MFR	MANUFACTURER	VB	VAPOR BARRIER
MIL	MILLIMETERS	V.C.T.	VINYL COMPOSITION TILE
N.I.C.	NOT IN CONTRACT	VTOS	VENT TO OUTSIDE
N.T.S.	NOT TO SCALE	W.C.	WATER CLOSET
O.C.	ON CENTER	W.P.	WATER PROOF
PLYWD	PLYWOOD	w/	WITH
P.T.	PRESSURE TREATED	w/o	WITHOUT
		WD	WOOD
		W/D	WASHER AND DRYER


TYP WINDOW NOTES:

- SEE ARCHITECTURAL FLOOR PLANS FOR WINDOW LOCATIONS AND DESIGNATIONS. SEE ELEVATIONS & BUILDING SECTIONS FOR WINDOW HEAD/SILL LOCATIONS.
- ALL RESIDENTIAL WINDOWS ARE BASED UPON MILGARD VINYL WINDOWS OR EQ U.N.O.
- ALL WINDOWS TO BE FIXED UNLESS SHOWN/NOTED OTHERWISE.
- PROVIDE SAFETY GLAZING PER KEYNOTE P-4 AS LOCATED ON FLOOR PLANS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002

TYP DOOR NOTES:

- ALL RESIDENTIAL SLIDING GLASS DOORS ARE BASED ON MILGARD SERIES VINYL SLIDING DOORS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002.
- PROVIDE SAFETY GLAZING PER GENERAL NOTES.
- NOT USED.
- PROVIDE MIN 0.20 U-VALUE AT SOLID CORE FLUSH DOORS WHERE EXPOSED TO AMBIENT TEMPERATURE.

VICINITY MAP

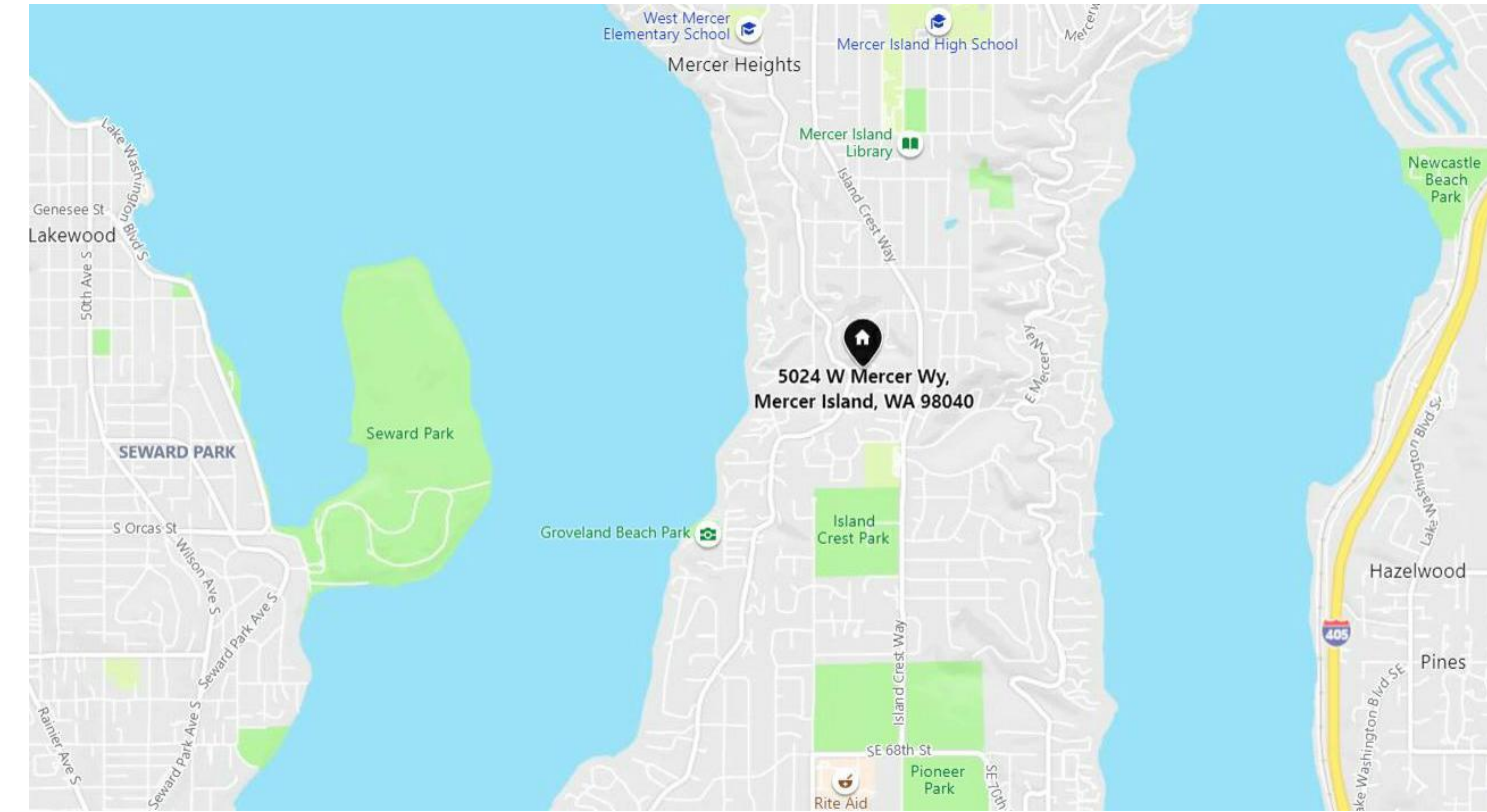

PROJECT INFO

PROJECT ADDRESS:

5024 W MERCER WAY,
MERCER ISLAND, 98040

BUILDER:

ATERA HOMES, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA, 98059

CONTACT: PAUL MONSEF
PHONE: (206) 612-8647
EMAIL: paul@monsefdesign.com

DESIGNER:

MONSEF DESIGN STUDIO, LLC
451 DUVALL AVE NE, SUITE 115
RENTON, WA 98059

CONTACT: MILTON ORELLANA
PHONE: (425) 306-2758
EMAIL: Milton@aterahomes.com

ENGINEER:

L2 ENGINEERS, LLC
17848 NE 198TH PLACE
WOODINVILLE, WA 98072

CONTACT: BRIAN LOSHBROUGH, P.E.
PHONE: (206) 251-2346
EMAIL: BRIAN@L2ENGINEERS.COM

SCOPE OF WORK:

CONSTRUCT A NEW 3234 SQ FT SINGLE FAMILY RESIDENCE.

BIDDER DESIGN:

ELECTRICAL, MECHANICAL, PLUMBING, MFR TRUSS CONNECTIONS, EXTERIOR CLADDING TO BE BIDDER DESIGNED/DEFERRED SUBMITTAL (PER 106.3.4.2)

LEGAL DESCRIPTION:

PARCEL A CITY OF MERCER ISLAND SP MI 77-11-045 REC AF NO 7801200950 SD PLAT DAF - THAT POR OF S 1/2 OF NW 1/4 OF NW 1/4 DAF - BEG AT SE COR OF SD SUBD TH N 01-16-04 E ALG ELY LN TH OF A DIST OF 450 FT TH N 88-10-41 W A DIST OF 200 FT TO TPOB TH CONTG N 88-10-41 W A DIST OF 578.85 FT TAP ON NELV MGN OF W MERCER WAY SD PT LY ON A CRV HAVING A RAD OF 198.52 FT & HAVING A RAD BRG OF S 57-19-36 W TH NWLY ALG SD CRV THRU A C/A OF 09-31-54 AN ARC DIST OF 33.03 FT TH N 42-17-56 E A DIST OF 236.31 FT TO SLY BDRY OF MERHAVEN DIV 2 TH S 88-17-59 E ALG SLY BDRY OF MERHAVEN DIV 2 & CONTG ALG SLY BDRY OF MERHAVEN DIV 3 A DIST OF 444.33 FT TH S 01-16-04 W A DIST OF 206.25 FT TO TPOB

CODE INFORMATION:

GENERAL INFORMATION:
BUILDING AREAS: SEE SQUARE FOOTAGE SCHED. THIS SHEET.
CODE COMPLIANCE: 2018 IBC with statewide and City amendments
CONTR. CLASS: TYPE Vb CONSTRUCTION
GLAZING: SEE ENERGY CODE NOTES SHT A000
PARCEL #: 192405-9317
ZONE: R-15
PARCEL DESCRIPTION:
PROPERTY TYPE: R - RESIDENTIAL SINGLE FAMILY (RES USE/ZONE)
PRESENT USE: VACANT (SINGLE-FAMILY)
LOT AREA: 19,325 SF
PLAT BLOCK: --
PLAT LOT: --
O-S-T-R: NW-19-24-5

AREA, SQUARE...

Name	Area
Foyer	119 SF
Lower Entry	122 SF
Lower Stairs	67 SF
Main Floor	1490 SF
Main Floor (+20ft Clg)	68 SF
Main Stairs	109 SF
Main Floor (+20ft Clg)	70 SF
Upper Floor	1469 SF
Gross Building Area: 8	3514 SF
Garage	671 SF
Exterior Area: 1	671 SF
Grand total: 9	4185 SF

FIRE PROTECTION MEASURES:

- NFPA 13R-PLUS FIRE SPRINKLER SYSTEM REQUIRED
- NFPA 72 HOUSEHOLD FIRE ALARM SYSTEM SYSTEM
- MONITORED LOW VOLT SMOKE & CO DETECTORS
- SOLID CORE AND OR FIRE RATED DOORS THROUGHOUT
- 1-HR RATED GYPSUM WALL BOARD, ALL AREAS

DRAWING INDEX

NUMBER	SHEET NAME	REV. ID	REV. DATE
A000	COVER SHEET	1	TBD
A001	CODE NOTES		
A002	ENERGY NOTES	1	TBD
A003	ENERGY/VENTING CALCULATIONS	1	TBD
A100	SURVEY		
A101	SITE PLAN & AREA/HT CALCULATIONS	1	TBD
A102	TEMPORARY EXCAVATION PLAN & SITE SECTIONS		
A104	PROPOSED GRADING PLAN	1	TBD
A110	ARBORIST TREE PLAN		
A201	LOWER FLOOR	1	TBD
A301	MAIN FLOOR	1	TBD
A401	UPPER FLOOR		
A501	ROOF PLAN	1	TBD
A601	ELEVATIONS	1	TBD
A701	BUILDING SECTIONS		
A702	BUILDING SECTIONS		
A703	BUILDING SECTIONS		
ARCHITECTURAL 'A': 17			
D101	FOUNDATION & FRAMING DETAILS		
D102	FRAMING DETAILS	1	TBD
D201	BASEMENT DETAILS	1	TBD
D301	ROOF DETAILS		
D401	DECK DETAILS		
ARCHITECTURAL DETAIL 'D': 5			
C1	COVERSHEET		
C2	TESC AND DEMO PLAN		
C2.2	C2 - TESC DETAILS		
C3	SITE, LANDSCAPE & DRAINAGE PLAN		
C4	DETAILS		
C4.4	DRAINAGE PLAN		
C5	OFF SITE STROM/WATER PLAN		
CIVIL 'C': 7			
S100	GENERAL STRUCTURAL NOTES		
S101	GENERAL STRUCTURAL NOTES		
S102	NOTES & SCHEDULE		
S200	FOUNDATION PLAN		
S201	MAIN FLOOR FRAMING PLAN		
S202	UPPER FLOOR FRAMING PLAN		
S203	ROOF FRAMING PLAN		
S300	STRUCTURAL DETAILS		
S301	STRUCTURAL DETAILS		
S302	STRUCTURAL DETAILS		
STRUCTURAL 'S': 10			

SYMBOLS & LEGEND:

	NEW WALL: INFILL PHASE		EXISTING WALL: SHELL / CORE PHASE
	GRID		SIM SHEET LAYOUT DESIGNATION: VIEW # / SHEET #
	GRID LINES		SHT ELEVATION DESIGNATION: VIEW # / SHEET #
	EXIST. CONTOURS		DOOR TAG: -SEE DOOR SCHEDULE.
	NEW CONTOURS		SHEARWALL TAG: SEE SHEARWALL SCHEDULE
	WINDOW TAG: -SEE WINDOW SCHEDULE		INDICATES STRUCTURAL KEYNOTE WITH INDEXED NUMBER. SEE STRUCTURAL KEYNOTE SCHEDULE.
	EXHAUST FAN PER M1507.3: -50 CFM MIN., TYP. U.N.O. -100 CFM MIN. @ KITCH.		110V OR LOW VOLT SMOKE DETECTOR PER R314: -W/ DISCONNECT SWITCH & BATTERY BACKUP
	WHOLE HOUSE EXHAUST FAN: -150 CFM MIN. -SEE M1508 ON SHT A002		CARBON MONOXIDE DETECTOR PER R315: W/ INTERCONNECTIVITY PER R315.5
	THERMOSTAT: -PROVIDE 2x8 BLK/G AT 51" A.F.F.		HEAT DETECTOR PER IRC314.2.3 W/ INTERCONNECTIVITY PER R314.4.1
	24HR TIMER TO W.H. FAN -SEE M1508 ON SHT A002		FURNACE/WATER HEATER: -PROVIDE COMBUSTIONABLE AIR FROM OUTSIDE WHEN REQ'D
			-PROVIDE PRESSURE RELIEF LINE TO OUTSIDE. -SECURE WATER HEATER TOP & BOTTOM.

Description
CITY COMMENTS

Date
TBD

No.



MONSEF DESIGN
STUDIO

451 DUVALL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET

COVER SHEET

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2023/06/20
DRAWN BY: SPM

A000

SCALE 24X36: 1 : 1
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

CHAPTER 1: ADMINISTRATION

R101 TITLE, SCOPE AND PURPOSE

- 1. THIS COVERSHEET HAS BEEN PREPARED IN A GENERIC OUTLINE FORM FOLLOWING THE STANDARDS SET BY THE INTERNATIONAL RESIDENTIAL CODE (IRC), NOT ALL ITEMS ARE NECESSARILY REQUIRED TO COMPLETE THIS SPECIFIC PROJECT, COORDINATE PLANS WITH IRC.
2. THIS SET OF WORKING DRAWINGS IS CONSIDERED A "BUILDER SET" AND DOES NOT INCLUDE SPECIFICATIONS OR BUILDING MATERIALS LIST. THEREFORE IT IS THE CONTRACTOR/OWNER RESPONSIBILITY TO PROVIDE AND COORDINATE SPECIFICATIONS, INCLUDING PRODUCT SELECTION AND INSTALLATION OR ASSEMBLY. ITEMS CALLED OUT ARE DONE SO FOR CONVENIENCE ONLY.
3. DO NOT SCALE THESE DRAWINGS FOR CRITICAL DIMENSIONS. VERIFY ALL DIMENSIONS AND DATUMS BEFORE COMMENCING WORK AND BE RESPONSIBLE FOR THEIR ACCURACY AND REPORT DISCREPANCIES / OMISSIONS TO THE ARCHITECT IMMEDIATELY.

CHAPTER 3: BUILDING PLANNING

DESIGN CRITERIA

[B] R301.2 CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA. BUILDINGS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS SET FORTH IN THE IRC. ADDITIONAL CRITERIA SHALL BE ESTABLISHED BY THE LOCAL JURISDICTION AND SET FORTH IN TABLE R301.2(1) CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA.

Table with 2 columns: Design Criteria and Value. Includes items like GROUND SNOW LOAD (25), WIND SPEED (PER STRUCT), SEISMIC DESIGN CATEGORY (18"), WEATHERING (MODERATE), FROST LINE DEPTH (18"), WINTER DESIGN TEMP (26), ICE SHIELD UNDERLAYMENT REQUIRED (NO), FLOOD HAZARDS (175), AIR FREEZING INDEX (50.5), MEAN ANNUAL TEMP (50.5).

301.4 DEAD LOAD. THE ACTUAL WEIGHTS OF MATERIALS AND CONSTRUCTION SHALL BE USED FOR DETERMINING DEAD LOAD. DEAD LOADS USED FOR THIS PROJECT ARE AS FOLLOWS:

Table with 2 columns: Load Type and Value. Includes items like 15 PSF, 12 PSF, 10 PSF.

301.5 LIVE LOAD. THE MINIMUM UNIFORMLY DISTRIBUTED LIVE LOAD SHALL BE AS PROVIDED IN

TABLE R301.5. MINIMUM UNIFORMLY DISTRIBUTED LIVE LOADS

Table with 2 columns: Location/Condition and Load Value. Includes ATTICS WITH STORAGE (20 PSF), EXTERIOR BALCONIES (60 PSF), FIRE ESCAPES (40 PSF), GUARDRAILS AND HANDRAILS (200 PLF), PASSENGER VEHICLE GARAGES (200 PSF), ROOMS OTHER THAN SLEEPING ROOMS (40 PSF), SLEEPING ROOMS (30 PSF).

301.6 ROOF LOAD. ROOF SHALL BE DESIGNED FOR THE LIVE LOAD INDICATED IN TABLE R301.6 THE SNOW LOAD INDICATED IN TABLE R301.2(1), WHICHEVER IS GREATER.

TABLE R301.6. MINIMUM ROOF LIVE LOADS IN POUNDS-FORCE PER SQUARE

Table with 4 columns: Roof Slope and Tributary Loaded Area (0 to 200, 2001 to 600, Over 600). Includes rows for FLAT OR RISE LESS THAN 4" PER FOOT (1:3), RISE LESS 4" PER FLOOR (1:3) TO 12" PER FOOT (1:1), RISE 12" PER FOOT (1:1) AND GREATER.

301.8 NOMINAL SIZES. WHERE DIMENSIONS OF LUMBER ARE SPECIFIED, THEY SHALL BE DEEMED TO BE NOMINAL DIMENSIONS UNLESS SPECIFICALLY DESIGNATED AS ACTUAL DIMENSIONS.

R317 PROTECTION AGAINST DECAY

317.1 LOCATION REQUIRED. IN AREAS SUBJECT TO DECAY DAMAGE AS ESTABLISHED BY TABLE R301.2(1) LOCATIONS REQUIRED BY SECTION R317.1, SHALL BE PRESERVATIVE-TREATED IN ACCORDANCE WITH AWPA U1 FOR THE SPECIES, PRODUCT, PRESERVATIVE AND END USE. PRESERVATIVES SHALL BE LISTED IN SECTION 4 OF AWPA U1

317.1.1 FIELD TREATMENT. FIELD-CUT ENDS, NOTCHES AND DRILLED HOLES OF PRESERVATIVE-TREATED WOOD SHALL BE TREATED IN THE FIELD IN ACCORDANCE WITH AWPA M4.

- 6.1 GENERAL
• ALL CUTS, HOLES AND INJURIES SUCH AS ABRASIONS OR HOLES FROM REMOVAL OF NAILS AND SPIKES WHICH MAY PENETRATE THE TREATED ZONE SHALL BE FIELD TREATED. AN AWPA ACCEPTED PRESERVATIVE SYSTEM, DETERMINED APPROPRIATE IN ACCORDANCE WITH AWPA M4 SECTION 7, SHALL BE USED FOR FIELD TREATMENT.
• APPLY PRESERVATIVES IN ACCORDANCE WITH THE PRODUCT LABEL.
• COAT ANY SURFACE THAT IS EXPOSED BY DAMAGE OR FIELD FABRICATION WHILE NOT USING EXCESS PRESERVATIVE.
• ANY EXCESS PRESERVATIVE NOT ABSORBED BY THE WOOD PRODUCT SHALL BE CLEANED FROM THE SURFACE PRIOR TO THE USE OF THE PRODUCT.
• BORED HOLES FOR CONNECTORS OR BOLTS MAY BE TREATED BY PUMPING COAL-TAR ROOFING CEMENT MEETING ASTM D5643 INTO HOLES USING A GREASE GUN OR SIMILAR DEVICE.
• CAREFUL ATTENTION SHOULD BE GIVEN TO MATERIALS PLACED INTO WET ENVIRONMENTS.
• AREA TO BE TREATED SHALL BE CLEAN, DRY AND FREE OF EXCESS PRESERVATIVE.

- 7.1 PRESERVATIVES
• THE PRESERVATIVE SYSTEM FOR FIELD TREATMENT SHALL BE DETERMINED BY THE TYPE OF PRESERVATIVE ORIGINALLY USED TO PROTECT THE PRODUCT.
• THE PRESERVATIVES DESIGNATED IN AWPA M4 SECTIONS 7.1.1, AND 7.1.2 ARE SUITABLE ALTERNATIVES WHEN NO MATCH CAN BE FOUND.

317.1.2 GROUND CONTACT. ALL WOOD IN CONTACT WITH THE GROUND SHALL BE APPROVED PRESSURE-PRESERVATIVE-TREATED WOOD SUITABLE FOR GROUND CONTACT USE

317.3 FASTENERS. FASTENERS FOR PRESSURE PRESERVATIVE AND FIRE-RETARDANT-TREATED WOOD SHALL BE OF HOT-DIPPED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER. EXCEPTION:
1. ONE-HALF-INCH DIAMETER OR GREATER STEEL BOLTS.
2. FASTENERS OTHER THAN NAILS AND TIMBER RIVETS SHALL BE PERMITTED TO BE OF MECHANICALLY DEPOSITED ZINC COATED STEEL WITH COATING WEIGHTS IN ACCORDANCE WITH ASTM B 695, CLASS 55 MINIMUM

CHAPTER 4: FOUNDATIONS

R401 GENERAL
401.1 APPLICATION. THE PROVISIONS SET FORTH IN CHAPTER 4 OF THE IRC SHALL CONTROL THE DESIGN AND CONSTRUCTION OF THE FOUNDATION AND FOUNDATION SPACES FOR ALL BUILDINGS. IN ADDITION TO THE PROVISIONS OF THIS CHAPTER, THE DESIGN AND CONSTRUCTION OF FOUNDATIONS IN AREAS PRONE TO FLOODING AS ESTABLISHED BY TABLE R301.2(1) SHALL MEET THE PROVISIONS OF SECTION R322.

401.4 SOIL TESTS. IN AREAS LIKELY TO HAVE EXPANSIVE, COMPRESSIBLE, SHIFTING OR OTHER UNKNOWN SOIL CHARACTERISTICS, THE BUILDING OFFICIAL SHALL DETERMINE WHETHER TO REQUIRE A SOIL TEST TO DETERMINE THE SOIL'S CHARACTERISTICS AT A PARTICULAR LOCATION. 401.4.1 GEOTECHNICAL EVALUATION. IN LIEU OF A COMPLETE GEOTECHNICAL EVALUATION, THE LOAD-BEARING VALUES IN TABLE R401.4.1 SHALL BE USED. TABLE R401.4.1 PRESUMPTIVE LOAD-BEARING VALUES OF FOUNDATIONS MATERIALS

Table with 2 columns: CLASS OF MATERIAL and LOAD BEARING PRESSURE (PSF). Includes CRYSTALLINE BEDROCK (12,000), SEDIMENTARY AND FOLIATED ROCK (4,000), SANDY GRAVEL AND/OR GRAVEL (3,000), SAND, SILTY SAND, CLAYEY SAND, SILTY GRAVEL AND CLAYEY GRAVEL (2,000***), CLAY, SANDY CLAY, SILTY CLAY, CLAYEY SILT, SILT AND SANDY SILT (1,500).

***U.N.O. 2,000 PSF SOIL BEARING IS ASSUMED FOR THIS PROJECT. VERIFY WITH STRUCTURAL NOTES

R402 MATERIALS
402.2 CONCRETE. CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH AS SHOWN IN TABLE R402.2. CONCRETE SUBJECT TO WEATHERING AS INDICATED IN TABLE R301.2(1), SHALL BE AIR ENTRAINED AS SPECIFIED IN TABLE R402.2

TABLE R402.2. MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF CONCRETE

Table with 4 columns: TYPE OF LOCATIONS OF CONC. CONSTRUCTION, TRIBUTARY LOADED AREA IN SQUARE FEET FOR ANY STRUCTURAL MEMBER (NEGIGIBLE, MODERATE, SEVERE). Includes BASEMENT WALLS, FNDN'S EXPOSED TO WEATHER, BASEMENT SLABS & INTERIOR SLABS ON GRADE, EXCEPT GAR. FLOOR SLABS, BASEMENT WALLS, FNDN WALLS, EXTERIOR WALLS EXPOSED TO WEATHER, PORCHES, CARPORT SLABS & STEPS EXPOSED TO WEATHER & GARAGE FLOOR SLABS.

R403 GENERAL
403.1 EXTERIOR WALLS SHALL BE SUPPORTED ON CONTINUOUS SOLID OR FULLY GROUTED MASONRY OR CONCRETE FOOTINGS, WOOD FOUNDATIONS, OR OTHER APPROVED STRUCTURAL SYSTEMS, WHICH SHALL BE OF SUFFICIENT DESIGN TO ACCOMMODATE ALL LOADS ACCORDING TO SECTION R301 AND BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION R403. OF THE IRC. FOOTINGS SHALL BE SUPPORTED ON UNDISTURBED NATURAL SOILS OR ENGINEERED FILL.

403.1.4.1 FROST PROTECTION. FOUNDATION WALLS, PIERS AND OTHER PERMANENT SUPPORTS OF BUILDINGS AND STRUCTURES SHALL BE PROTECTED FROM FROST BY EXTENDING FOOTINGS BELOW THE FROST LINE AS SPECIFIED IN TABLE R301.2(1).... EXCEPTION: DECKS NOT SUPPORTED BY A DWELLING NEED NOT BE PROVIDED WITH FOOTINGS THAT EXTEND BELOW THE FROST LINE.

403.1.6 FOUNDATION ANCHORAGE. WHEN BRACED WALL PANELS ARE SUPPORTED DIRECTLY ON CONTINUOUS FOUNDATIONS, THE WALL WOOD SILL PLATE SHALL BE ANCHORED TO THE FOUNDATION IN ACCORDANCE WITH SECTION 403.1.6, OF THE IRC.
• SILL PLATE SHALL BE ANCHORED TO THE FOUNDATION WITH ANCHOR BOLTS SPACED A MAXIMUM OF 6 FEET ON CENTER. THERE SHALL BE A MINIMUM OF TWO BOLTS PER PLATE SECTION WITH ONE BOLT LOCATED NOT MORE THAN 12 INCHES FROM EACH END OF THE PLATE SECTION.
• BOLTS SHALL BE AT LEAST 1/2 INCH IN DIAMETER AND SHALL EXTEND A MINIMUM OF 7 INCHES INTO MASONRY OR CONCRETE.
• SILLS AND SOLE PLATES SHALL BE PROTECTED AGAINST DECAY AND TERMITES WHERE REQUIRED BY SECTIONS R318 AND R319, OF THE IRC.
EXCEPTION: FOUNDATION ANCHOR STRAPS, SPACED AS REQUIRED TO PROVIDE EQUIVALENT ANCHORAGE TO 1/2-INCH-DIAMETER ANCHOR BOLTS.

403.1.6.1 FOUNDATION ANCHORAGE IN SEISMIC DESIGN CATEGORIES D0, D1, D2, AND E.

- IN ADDITION TO THE REQUIREMENTS OF SECTION R403.1.6., THE FOLLOWING REQUIREMENTS SHALL APPLY TO WOOD LIGHT-FRAME STRUCTURES IN SEISMIC DESIGN CATEGORIES D1 AND D2.
• 1/4" X 3" X 3" PLATE WASHERS CONFORMING TO SECTION R602.11.1 SHALL BE USED ON EACH BOLT.
• INTERIOR BRACED WALL PLATES SHALL HAVE ANCHOR BOLTS SPACED AT NOT MORE THAN 6 FEET ON CENTER AND LOCATED WITHIN 12 INCHES FROM THE ENDS OF EACH PLATE SECTION WHEN SUPPORTED ON A CONTINUOUS FOUNDATION.
• INTERIOR BEARING WALL SOLE PLATES SHALL HAVE ANCHOR BOLTS SPACED AT NOT MORE THAN 6 FEET ON CENTER AND LOCATED WITHIN 12 INCHES FROM THE ENDS OF EACH PLATE SECTION WHEN SUPPORTED ON A CONTINUOUS FOUNDATION.
• THE MAXIMUM ANCHOR BOLT SPACING SHALL BE 4 FEET FOR BUILDINGS OVER TWO STORIES IN HEIGHT.
• STEPPED CRIPPLE WALLS SHALL CONFORM TO SECTION R602.11.3.

R404 FOUNDATION WALLS

404.1 CONCRETE AND MASONRY FOUNDATION WALLS. CONCRETE AND MASONRY FOUNDATION WALLS SHALL BE SELECTED AND CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION R404.1.3 OF THE IRC OR IN ACCORDANCE WITH ACI 318, NCMA TR68-A OR ACI 530/ASCE 5/TMS 402 OR OTHER APPROVED STRUCTURAL STANDARDS.

404.3 WOOD SILL PLATES. WOOD SILL PLATES SHALL BE A MINIMUM OF 2-INCH BY 4-INCH NOMINAL LUMBER. SILL PLATE ANCHORAGE SHALL BE IN ACCORDANCE WITH SECTIONS R403.1.6 AND R602.11.

CHAPTER 5: FLOORS

R501 GENERAL
501.1 APPLICATION. FLOOR CONSTRUCTION SHALL BE IN ACCORDANCE TO THE PROVISIONS SET FORTH IN CHAPTER 5 OF THE IRC.

501.2 REQUIREMENTS. FOR FLOOR CONSTRUCTION LOADING, SEE SECTION R301.

CHAPTER 6: WALL CONSTRUCTION

R601 GENERAL
R601.1 APPLICATION. WALL CONSTRUCTION SHALL BE IN ACCORDANCE TO THE PROVISIONS SET FORTH IN CHAPTER 6 OF THE IRC.

R601.2 REQUIREMENTS. FOR WALL CONSTRUCTION LOADING, SEE SECTION R301.

R602.3 DESIGN & CONSTRUCTION. SEE TABLE R602.3(1) ON THIS SHEET FOR FASTENER / NAILING SCHEDULE

R613 EXTERIOR WINDOWS AND GLASS DOORS

613.1 GENERAL. THE PROVISIONS SET FORTH IN SECTION 613 OF THE IRC, SHALL CONTROL THE PERFORMANCE AND CONSTRUCTION REQUIREMENTS FOR EXTERIOR WINDOW SYSTEMS INSTALLED IN WALL SYSTEMS. WATERPROOFING, SEALING AND FLASHING SYSTEMS ARE NOT INCLUDED IN THE SCOPE OF THIS SECTION.

613.2 PERFORMANCE. EXTERIOR WINDOWS AND DOORS SHALL BE DESIGNED TO RESIST THE DESIGN WIND LOADS SPECIFIED IN TABLE R301.2(2), ADJUSTED FOR HEIGHT AND EXPOSURE PER TABLE R301.2(3).

CHAPTER 7: WALL COVERING

R701 GENERAL

701.1 APPLICATION. THE PROVISIONS SET FORTH IN CHAPTER 7 OF THE IRC, SHALL CONTROL THE DESIGN AND CONSTRUCTION OF THE INTERIOR AND EXTERIOR WALL COVERING FOR ALL BUILDINGS.

701.2 INSTALLATION. PRODUCTS SENSITIVE TO ADVERSE WEATHER SHALL NOT BE INSTALLED UNTIL ADEQUATE WEATHER PROTECTION FOR THE INSTALLATION IS PROVIDED. EXTERIOR SHEATHING SHALL BE DRY BEFORE APPLYING EXTERIOR COVER.

CHAPTER 8: ROOF-CEILING CONSTRUCTION

R801 GENERAL
801.1 APPLICATION. THE PROVISIONS SET FORTH IN CHAPTER 8 OF THE IRC, SHALL CONTROL THE DESIGN AND CONSTRUCTION OF THE ROOF-CEILING SYSTEM FOR ALL BUILDINGS.

801.2 REQUIREMENTS. ROOF AND CEILING CONSTRUCTION SHALL BE CAPABLE OF ACCOMMODATING ALL LOADS IMPOSED ACCORDING TO SECTION R301 AND OF TRANSMITTING THE RESULTING LOADS TO THE SUPPORTING STRUCTURAL ELEMENTS.

801.3 ROOF DRAINAGE. IN AREAS WHERE EXPANSIVE OR COLLAPSIBLE SOILS ARE KNOWN TO EXIST, ALL DWELLINGS SHALL HAVE A CONTROLLED METHOD OF WATER DISPOSAL FROM ROOFS THAT WILL COLLECT AND DISCHARGE ALL ROOF DRAINAGE TO THE GROUND SURFACE AT LEAST 5 FEET FROM FOUNDATION WALLS OR TO AN APPROVED DRAINAGE SYSTEM.

CHAPTER 9: ROOF ASSEMBLIES

R901 GENERAL


901.1 SCOPE. THE PROVISIONS SET FORTH IN CHAPTER 9 OF THE IRC, SHALL GOVERN THE DESIGN, MATERIALS, CONSTRUCTION AND QUALITY OF ROOF ASSEMBLIES.

2015 UNIFORM PLUMBING CODE

313 PROTECTION OF PIPING, MATERIALS, AND STRUCTURES
SECTION 313.12 RATPROOFING
a. STRAINER PLATES ON DRAIN INLETS SHALL HAVE 1/2-INCH OPENINGS MAX.
b. METER BOXES SHALL BE CONSTRUCTED IN SUCH A MANNER THAT RATS CANNOT ENTER A BLDG BY FOLLOWING THE SERVICE PIPES FROM THE BOX INTO THE BLDG.
c. WHERE OPENINGS HAVE BEEN MADE IN WALLS, FLOORS, OR CLGS FOR THE PASSAGE OF PIPES, SUCH OPENINGS SHALL BE CLOSED AND PROTECTED BY THE INSTALLATION OF APPROVED METAL COLLARS SECURELY FASTENED TO THE ADJOINING STRUCTURE.
d. TUB WASTE OPENINGS IN FRAMED CONSTRUCTION TO CRAWL SPACES AT OR BELOW THE FIRST FLOOR SHALL BE PROTECTED BY THE INSTALLATION OF APPROVED METAL COLLARS OR METAL SCREEN, WITH 1/2-INCH OPENINGS MAX, AND SECURELY FASTENED TO THE ADJOINING STRUCTURE.

GENERAL CONSTRUCTION SPECS. AND CODE COMPLIANCE (2018 IRC, UPC & 2018 W.S.E.C.)

Description Date No.

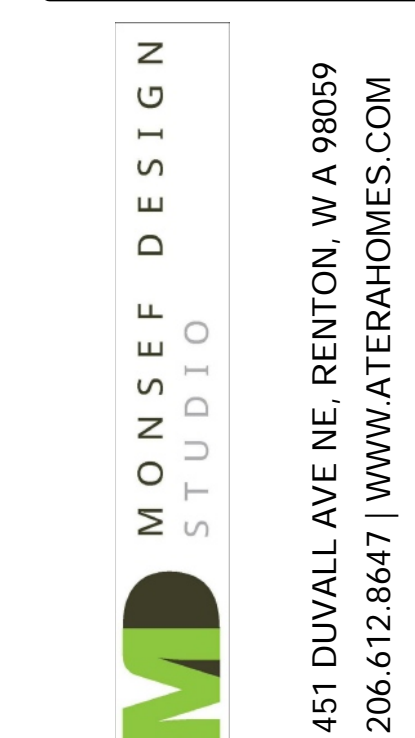

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET
CODE NOTES

Table with 2 columns: Field and Value. Includes PROJECT NO: 20008, ISSUE DATE: 2023/08/01, SHT ISSUE DATE: 2021/01/08, DRAWN BY: SPM

A001

SCALE 24X36:
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

Window, Skylight and Door Schedule

Table with Project Information (CHEN RESIDENCE, 5024 W. MERCER WAY, MERCER ISLAND, WA 98040) and Contact Information (MILTON ORELLANA, 451 DUVALL AVE NE, SUITE 115, RENTON, WA 98059).

Table for Vertical Fenestration (Windows and doors) with columns for Component, Description, Ref., U-factor, Width, Height, Area, and UA.

Summary table for Vertical Fenestration Area and UA, showing a total Area of 801.5 and UA of 224.42.

Table for Overhead Glazing (Skylights) with columns for Component, Description, Ref., U-factor, Width, Height, Area, and UA.


Summary table for Overhead Glazing Area and UA, showing a total Area of 16.0 and UA of 0.50.

Total Sum of Fenestration Area and UA (for heating system sizing calculations), showing a total Area of 856.5 and UA of 241.57.

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2018 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This tool will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

Interactive form for heating system size calculation. Includes sections for Project Information, Heating System Type, Design Temperature, Area of Building, Glazing and Doors, Skylights, Insulation, Single Rafter or Joist Vaulted Ceilings, Above Grade Walls, Floors, Below Grade Walls, Slab Below Grade, Slab on Grade, and Location of Ducts.

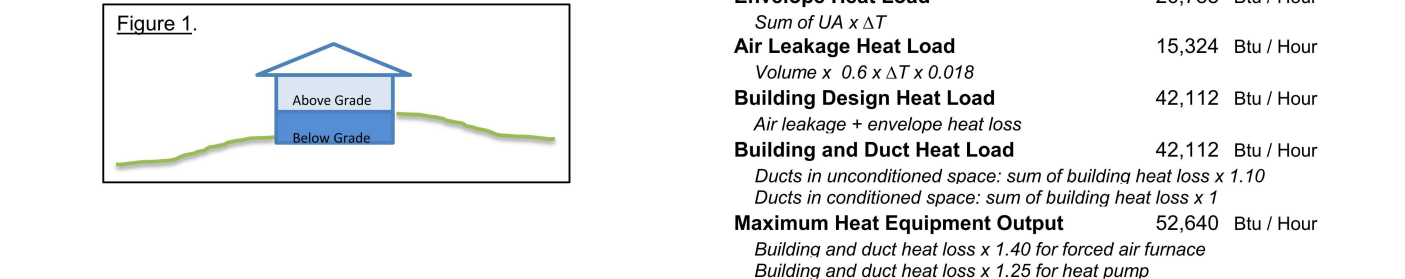

Summary table for heating system size calculation, showing Sum of UA, Envelope Heat Load, Air Leakage Heat Load, Building Design Heat Load, Building and Duct Heat Load, and Maximum Heat Equipment Output.

2018 WASHINGTON STATE / IRC EXHAUST SYSTEM REQUIREMENTS

M1503.6 MAKEUP AIR REQUIRED: WHERE ONE OR MORE GAS, LIQUID OR SOLID FUEL-BURNING APPLIANCE THAT IS NEITHER DIRECT-VENT NOR USES A MECHANICAL DRAFT VENTING SYSTEM IS LOCATED WITHIN A DWELLING UNIT'S AIR BARRIER...

M1505 MECHANICAL VENTILATION: M1505.1 SOURCE SPECIFIC VENTILATION: WHERE LOCAL EXHAUST OR WHOLE-HOUSE MECHANICAL VENTILATION IS PROVIDED, THE EQUIPMENT SHALL BE DESIGNED IN ACCORDANCE WITH SECTION M1505.

M1505.2 RECIRCULATION OF AIR: EXHAUST AIR FROM BATHROOMS AND TOILET ROOMS SHALL NOT BE RECIRCULATED WITHIN THE RESIDENCE OR CIRCULATED TO ANOTHER DWELLING UNIT AND SHALL BE EXHAUSTED DIRECTLY TO THE OUTDOORS.

M1505.3 EXHAUST EQUIPMENT: EXHAUST EQUIPMENT SERVING SINGLE DWELLING UNITS SHALL BE LISTED AND LABELED AS PROVIDING THE MINIMUM REQUIRED AIRFLOW IN ACCORDANCE WITH ANSI/AMCA 210-ANSI/ASHRAE 51.

M1505.4 WHOLE-HOUSE MECHANICAL VENTILATION SYSTEM: WHOLE-HOUSE MECHANICAL VENTILATION SYSTEMS SHALL BE DESIGNED IN ACCORDANCE WITH SECTIONS M1505.4.1 THROUGH M1505.4.4.

M1601 DUCT CONSTRUCTION: M1601.1 DESIGN: DUCT SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH THE PROVISION OF THIS SECTION AND ACCA MANUAL D, THE APPLIANCE MANUFACTURER'S INSTALLATION INSTRUCTIONS, OR OTHER APPROVED METHODS.

M1601.1.1 ABOVE GROUND DUCTS: a. DISCHARGE TEMP LIMIT OF 250 DEGREES FAHRENHEIT LABEL WITH UL 181 AND INSTALLED TO MANUF. SPECS. b. FIELD FABRICATED, SHOP FABRICATED, AND FLEXIBLE DUCT CONSTRUCTION SHALL CONFORM TO SMACNA HVAC DUCT CONSTRUCTION STANDARDS - METAL AND FLEXIBLE EXCEPT AS ALLOWED BY TABLE M1601.1.1 GALVANIZED STEEL SHALL CONFORM TO ASTM A 653.

M1601.2 VIBRATION ISOLATORS: VIBRATION ISOLATORS INSTALLED BETWEEN MECHANICAL EQUIPMENT AND DUCTS SHALL BE FABRICATED FROM APPROVED MATERIALS LIST AND SHALL NOT EXCEED 10" IN LENGTH.

M1601.3 DUCT INSULATION MATERIALS: DUCT INSULATION MATERIALS TO CONFORM TO THE FOLLOWING: 1. DUCT COVERS AND LININGS TO MEET ASTM E 84 OR UL 723, AND ASTM E 2231. 2. DUCT COVERS AND LININGS SHALL MEET ASTM C 411. 3. REFLECTIVE DUCT INSULATION SHALL BE VISIBLE AT INTERVALS NO GREATER 36". R-VALUE IS DETERMINED IN ACCORDANCE WITH ASTM C 1668.

M1601.4 INSTALLATION: DUCT INSTALLATION SHALL COMPLY WITH SECTIONS M1601.1.1 THROUGH M1601.4.10.

M1701 COMBUSTION AIR: M1701.1 SCOPE: SOLID FUEL-BURNING APPLIANCES SHALL BE PROVIDED WITH COMBUSTION AIR IN ACCORDANCE WITH THE APPLIANCE MANUFACTURER'S INSTALLATION INSTRUCTIONS. METHODS OF PROVIDING COMBUSTION AIR IN THIS CHAPTER DO NOT APPLY TO FIREPLACES, FIREPLACE STOVES AND DIRECT-VENT APPLIANCES.

2018 Washington State Energy Code - Residential Prescriptive Energy Code Compliance for All Climate Zones in Washington Single Family - New & Additions (effective February 1, 2021)

Summary of Table R406.2 (cont.) table showing Energy Options, Energy Credit Option Descriptions, Credits, and User Notes.

- a. An alternative heating source sized at a maximum of 0.5 W/sf (equivalent) of heated floor area or 500 W, whichever is bigger, may be installed in the dwelling unit.
b. Equipment listed in Table C403.3.2(4) or C403.3.2(5)
c. Equipment listed in Table C403.3.2(1) or C403.3.2(2)
d. You cannot select more than one option from any category EXCEPT in category 5. Option 5.1 may be combined with options 5.2 through 5.6. See Table 406.3.
e. 1.0 credit for each 1,200 kWh of electrical generation provided annually, up to 3 credits max. See the complete Table R406.2 for all requirements and option descriptions.
f. Use the single radio button in the upper right of the second column to deselect radio buttons in that group.

2018 WASHINGTON STATE ENERGY REQUIREMENTS

CHAPTER 3 GENERAL REQUIREMENTS: R301 CLIMATE ZONES: CLIMATE ZONES FROM TABLE R301.1 SHALL BE USED IN DETERMINING THE APPLICABLE REQUIREMENTS FROM CHAPTER 4. KING, SNOHOMISH & PIERCE COUNTY - 4C (MARINE). R302 DESIGN CONDITIONS: THE INTERIOR DESIGN TEMPERATURES USED FOR HEATING AND COOLING LOAD CALCULATIONS SHALL BE A MAXIMUM OF 72°F FOR HEATING AND MINIMUM OF 75°F FOR COOLING.

CHAPTER 4 RESIDENTIAL ENERGY EFFICIENCY: R401 GENERAL: A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL PER WSEC R401.3. THE CERTIFICATE SHALL LIST THE PREDOMINANT R-VALUES OF INSULATION INSTALLED IN OR ON CEILING/ROOF, WALLS, FOUNDATION (SLAB, BASEMENT WALL, CRAWLSPACE WALL AND/OR FLOOR), AND DUCTS OUTSIDE THE CONDITIONED SPACES.

Table for R402 BUILDING THERMAL ENVELOPE showing VERTICAL U-FACTOR, SKYLIGHT U-FACTOR, CEILING R-VALUE, WOOD FRAME WALL, FLOOR, and BELOW GRADE WALL.

R402.2.1 CEILINGS WITH ATTIC SPACES: WHERE SECTION R402.1.1 WOULD REQUIRE R-49 IN THE CEILING, INSTALLING R-38 OVER 100 PERCENT OF THE CEILING AREA REQUIRING INSULATION SHALL BE DEEMED TO SATISFY THE REQUIREMENT FOR R-49 WHEREVER THE FULL HEIGHT OF UNCOMPRESSED R-38 INSULATION EXTENDS OVER THE WALL TOP PLATE AT THE EAVES.

R402.2.1.1 LOOSE INSULATION IN ATTIC SPACES: OPEN-BLOWN OR POURED LOOSE FILL INSULATION MAY BE USED IN ATTIC SPACES WHERE THE SLOPE OF THE CEILING IS NOT MORE THAN 3 FEET IN 12 AND THERE IS AT LEAST 30 INCHES OF CLEAR DISTANCE FROM THE TOP OF THE BOTTOM CHORD OF THE TRUSS OR CEILING JOIST TO THE UNDERSIDE OF THE SHEATHING AT THE ROOF EDGE.

R402.2.3 EAVE Baffle: FOR AIR PERMEABLE INSULATIONS IN VENTED ATTICS, A Baffle SHALL BE INSTALLED ADJACENT TO SOFFIT AND EAVE ENDS. Baffles SHALL MAINTAIN AN OPENING EQUAL OR GREATER THAN THE SIZE OF THE VENT.

R402.2.4 ACCESS HATCHES AND DOORS: ACCESS DOORS FROM CONDITIONED SPACES TO UNCONDITIONED SPACES (E.G., ATTICS AND CRAWL SPACES) SHALL BE WEATHERSTRIPPED AND INSULATED TO A LEVEL EQUIVALENT TO THE INSULATION ON THE SURROUNDING SURFACES.

R402.2.7 FLOORS: FLOOR INSULATION SHALL BE INSTALLED TO MAINTAIN PERMANENT CONTACT WITH THE UNDERSIDE OF THE SUBFLOOR DECKING. INSULATION SUPPORTS SHALL BE INSTALLED SO SPACING IS NO MORE THAN 24-INCHES ON CENTER. FOUNDATION VENTS SHALL BE PLACED SO THAT THE TOP OF THE VENT IS BELOW THE LOWER SURFACE OF THE FLOOR INSULATION.

R402.2.8 BELOW-GRADE WALLS: EXTERIOR WALL INSULATION USED ON THE EXTERIOR (COLD) SIDE OF THE WALL SHALL EXTEND FROM THE TOP OF THE BELOW-GRADE WALL TO THE TOP OF THE FOOTING AND SHALL BE APPROVED FOR BELOW-GRADE USE.

R402.4 AIR LEAKAGE: THE BUILDING THERMAL ENVELOPE SHALL BE CONSTRUCTED TO LIMIT AIR LEAKAGE IN ACCORDANCE WITH THE REQUIREMENTS OF SECTIONS R402.4.1 THROUGH R402.4.4. PROVIDE AN AIR BARRIER AND INSULATION INSTALLATION PER TABLE R402.1.1.

R403 SYSTEMS: R403.1 AT LEAST ONE THERMOSTAT SHALL BE PROVIDED FOR EACH SEPARATE HEATING AND COOLING SYSTEM. a. WHERE THE PRIMARY HEATING SYSTEM IS A FORCED-AIR FURNACE, AT LEAST ONE PROGRAMMABLE THERMOSTAT PER DWELLING UNIT SHALL BE INSTALLED PER R403.1.1. b. UNITARY AIR COOLED HEAT PUMPS SHALL INCLUDE CONTROLS PER R403.1.2. R403.3 DUCTS AND AIR HANDLERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTIONS R403.2.1 THROUGH R403.2.3.

R403.3.5 BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS. INSTALLATION OF DUCTS IN EXTERIOR WALLS, FLOORS OR CEILINGS SHALL NOT DISPLACE REQUIRED ENVELOPE INSULATION. DUCTS SHALL BE LEAK TESTED IN ACCORDANCE WITH WSU RS-33, USING THE MAXIMUM DUCT LEAKAGE SPECIFIED PER R403.3.3.

R404 MECHANICAL SYSTEM PIPING CAPABLE OF CARRYING FLUIDS ABOVE 105°F OR BELOW 55°F SHALL BE INSULATED TO A MINIMUM OF R-6. a. PIPING INSULATION EXPOSED TO WEATHER SHALL BE PROTECTED FROM DAMAGE PER R404.1. R404.5 ENERGY CONSERVATION MEASURES FOR SERVICE HOT WATER SYSTEMS SHALL BE IN ACCORDANCE WITH SECTIONS R403.5.1 THROUGH R403.5.5.

R404 POWER AND LIGHTING SYSTEMS: R404.1 A MINIMUM OF 90 PERCENT OF PERMANENTLY INSTALLED LAMPS IN LIGHTING FIXTURES SHALL BE HIGH-EFFICIENCY LAMPS. a. PER R404.1.1 FUEL GAS LIGHTING SYSTEMS SHALL NOT HAVE CONTINUOUSLY BURNING PILOT LIGHTS.

4/17/2024 12:31:30 PM Autodesk Docs://20008 Chen Residence, Mercer Island/20008-05 Chen Residence, MI - SUBJ2.vrt

GENERAL CONSTRUCTION SPECS, AND CODE COMPLIANCE (2018 IRC, UPC & 2018 W.S.E.C.)

Description CITY COMMENTS No. Date TBD



MONSEF DESIGN STUDIO 451 DUVALL AVE NE, RENTON, WA 98059 206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence 5024 W Mercer Way, Mercer Island

PERMIT SET

ENERGY NOTES

PROJECT NO: 20008 ISSUE DATE: 2023/08/01 SHT ISSUE DATE: 2021/01/08 DRAWN BY: SPM

A002

SCALE 24X36: NOTE: 1/1X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

Area Schedule (Energy/Venting Calculations)

Name	Area	Perimeter	Level
SLAB ON GRADE	162 SF	48'-0"	Level 0
FLOOR INSUL	1518 SF	165'-6"	Level 1
FLOOR INSUL	156 SF	48'-6"	Level 1
CEILING - FLAT	73 SF	30'-0"	Level 2
FLOOR INSUL	290 SF	165'-6"	Level 2
FLOOR INSUL	39 SF	27'-0"	Level 2
CEILING - FLAT	1798 SF	194'-6"	T.O. PL Lvl2
CEILING - VAULT	91 SF	35'-0"	T.O. PL Lvl2

ROOF VENTING SCHEDULE

NAME	GROSS AREA	AREA CALCULATIONS				EAVE/PARAPET VENTING CALCULATIONS			ROOF JACKS CALCULATIONS		
		REQ'D VENT AREA	NET AREA	REQUIRED VENTING	% AT EAVES	REQUIRED EAVE	LF OF VENT	PROVIDED	REQUIRED JACKS	# OF JACKS	AREA PROVIDED
1A	71 SF	150	71 SF	0.47 SF	50%	0.24 SF	18	0.44 SF	0.24 SF	1	0.35 SF
1B	54 SF	150	54 SF	0.36 SF	50%	0.18 SF	16	0.39 SF	0.18 SF	1	0.35 SF
2A	1695 SF	300	1695 SF	5.65 SF	40%	2.26 SF	194	4.76 SF	3.39 SF	10	3.47 SF
2B	80 SF	150	80 SF	0.53 SF	100%	0.53 SF	18	0.44 SF	0.00 SF	0	0.00 SF

CRAWL SPACE VENTING

NAME	AREA	PERIMETER	AREA CALCULATIONS			VENTS REQUIRED		VENTING PROVIDED		
			NET AREA	NET FREE AREA	VENTING REQUIRED	VENT SIZE: 14" x 8" VENT AT .75 EFF	TOTAL VENTS REQUIRED	TOTAL SHOWN	TOTAL VENTING AREA PROVIDED	
I	823 SF	132'-6"	825 SF	300	2.75 SF	0.583	4.72	9	5 SF	
II	138 SF	49'-5"	138 SF	300	0.46 SF	0.583	0.79	6	3 SF	

ROOF VENTING NOTES:

- (4) 2" DIA EAVE VENTS PER BLOCK = 5.024 SQ. IN. / L.F. (80% NET FREE AREA)
- ROOF JACKS = 50 SQ. IN. EACH
- INSTALL ONE LOW ROOF JACK, WITHIN 36" OF EAVE, FOR EVERY 12 LF OF EAVE WITHIN 60" OF PROPERTY LINE. MINIMUM NET AREA SHALL BE NOT LESS THAN 1 S.F. PER 150 S.F. OF ATTIC AREA OR 1 S.F. PER 300 S.F. OF ATTIC AREA IF 80% IS IN THE SOFFIT AND 20% IS AT LEAST 3' ABOVE THE PLATE LINE PER IRC SECTION R806.2 AND ENERGY REQUIREMENTS.
- AS AN ALTERNATIVE, THE NET FREE CROSS-VENTILATION AREA MAY BE REDUCED TO 1/300 WHEN A CLASS I OR II VAPOR BARRIER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.

CRAWL SPACE VENTING NOTES:

- THE UNCONDITIONED, UNDER-FLOOR, SPACE BETWEEN THE BOTTOM OF THE FLOOR JOISTS AND THE EARTH UNDER ANY BUILDING SHALL HAVE VENTILATION OPENINGS THROUGH FOUNDATION WALLS OR EXTERIOR WALLS.
- A GROUND COVER OF SIX MIL (0.006 INCH THICK BLACK POLYETHYLENE OR APPROVED EQUAL SHALL BE LAID OVER THE GROUND WITHIN CRAWL SPACES. THE GROUND COVER SHALL BE OVERLAPPED SIX INCHES MINIMUM AT THE JOINTS AND SHALL EXTEND TO THE FOUNDATION WALL.
- ***THE GROUND COVER MAY BE OMITTED IN CRAWL SPACES IF THE CRAWL SPACE HAS A CONCRETE SLAB FLOOR WITH A MINIMUM THICKNESS OF TWO INCHES***
- THE MINIMUM NET AREA OF VENTILATION OPENINGS SHALL NOT BE LESS THAN 1 SQUARE FOOT FOR EACH 300 SQUARE FEET OF UNDER-FLOOR AREA. REQUIRED OPENINGS SHALL BE EVENLY PLACED TO PROVIDE CROSS VENTILATION OF THE SPACE EXCEPT ONE SIDE OF THE BUILDING SHALL BE PERMITTED TO HAVE NO VENTILATION OPENINGS.
- VENTILATION OPENINGS SHALL BE COVERED FOR THEIR HEIGHT AND WIDTH WITH ANY OF THE FOLLOWING MATERIALS PROVIDED THAT THE LEAST DIMENSION OF THE COVERING SHALL NOT EXCEED 1/4 INCH:
 - PERFORATED SHEET METAL PLATES NOT LESS THAN 0.070 INCH THICK.
 - EXPANDED SHEET METAL PLATES NOT LESS THAN 0.047 INCH THICK.
 - CAST-IRON GRILL OR GRATING.
 - EXTRUDED LOAD-BEARING BRICK VENTS.
 - HARDWARE CLOTH OF 0.035 INCH (0.89 MM) WIRE OR HEAVIER.
 - CORROSION-RESISTANT WIRE MESH, WITH THE LEAST DIMENSION BEING 1/8 INCH

Area Schedule (F.A.R.)

Name	Area
RETAINING WALLS	51 SF
STAIRS	139 SF
	190 SF
Garage	658 SF
Lower Floor	217 SF
Lower Stairs	57 SF
	933 SF
Main Floor	1433 SF
Main Flr (+20ft Clg)	59 SF
Main Stairs	102 SF
	1593 SF
Main Floor +20ft Clg	59 SF
Upper Floor	1398 SF
Upper Flr (+20ft Clg)	303 SF
	1760 SF
	4475 SF

F.A.R. COVERAGE CALCULATIONS:


SITE AREA:	19,325 SF
MAX COVERAGE:	40%
PROPOSED AREA:	4,285 SF
PROPOSED COVERAGE:	22.17%

GROSS FLOOR AREA CALCULATIONS:

SITE AREA:	19,325 SF
MAX COVERAGE:	40% (7,730)
PROPOSED AREA:	4,185 SF
PROPOSED COVERAGE:	21.65%


AREA SCHEDULE - GROSS

NAME	AREA
Foyer	119 SF
Lower Entry	122 SF
Lower Stairs	67 SF
Main Floor	1490 SF
Main Floor (+20ft Clg)	138 SF
Main Stairs	109 SF
Upper Floor	1469 SF
	3514 SF
Garage	671 SF
	671 SF
	4185 SF

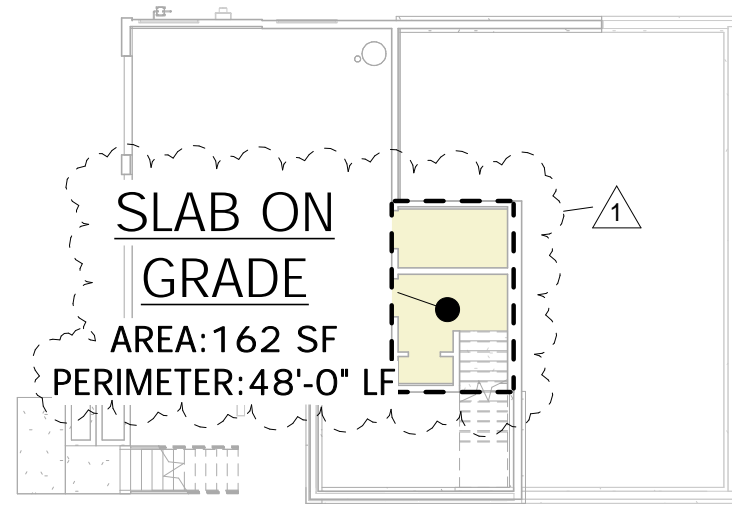


10 WSEC ENERGY CALCS - LOWER FLR

SCALE: 1/16" = 1'-0"

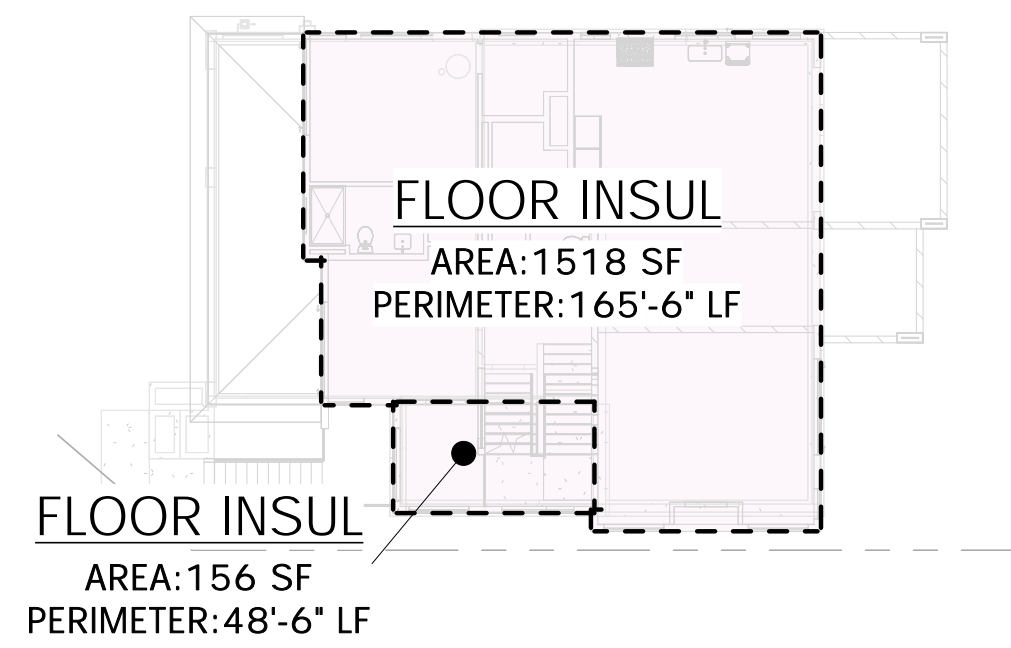


6 ROOF VENTING - UPPER

SCALE: 1/16" = 1'-0"

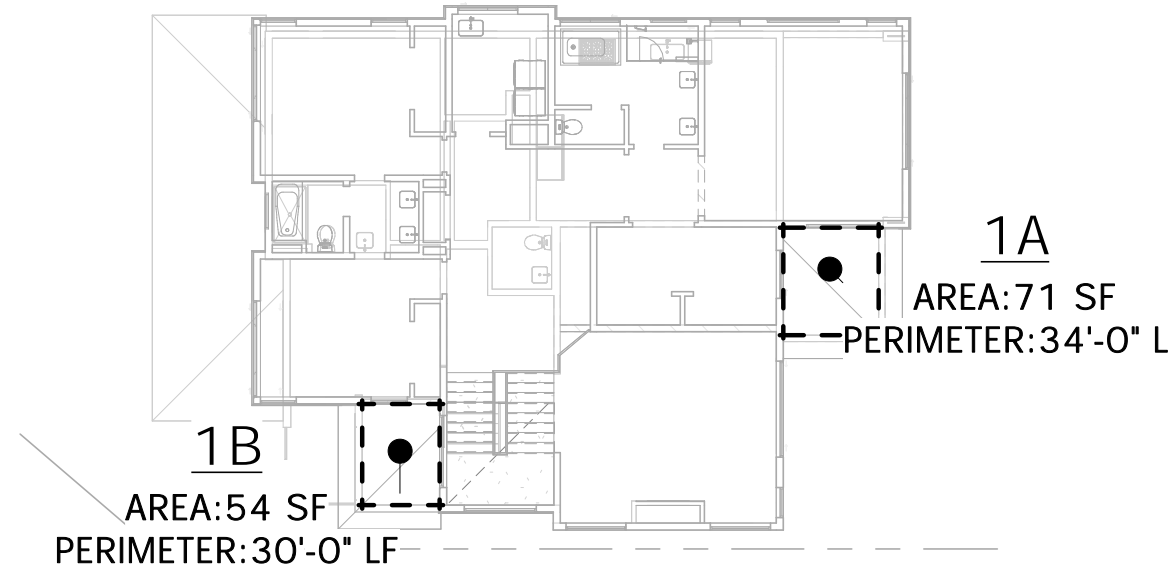


1 Lower Floor F.A.R.

SCALE: 1/16" = 1'-0"

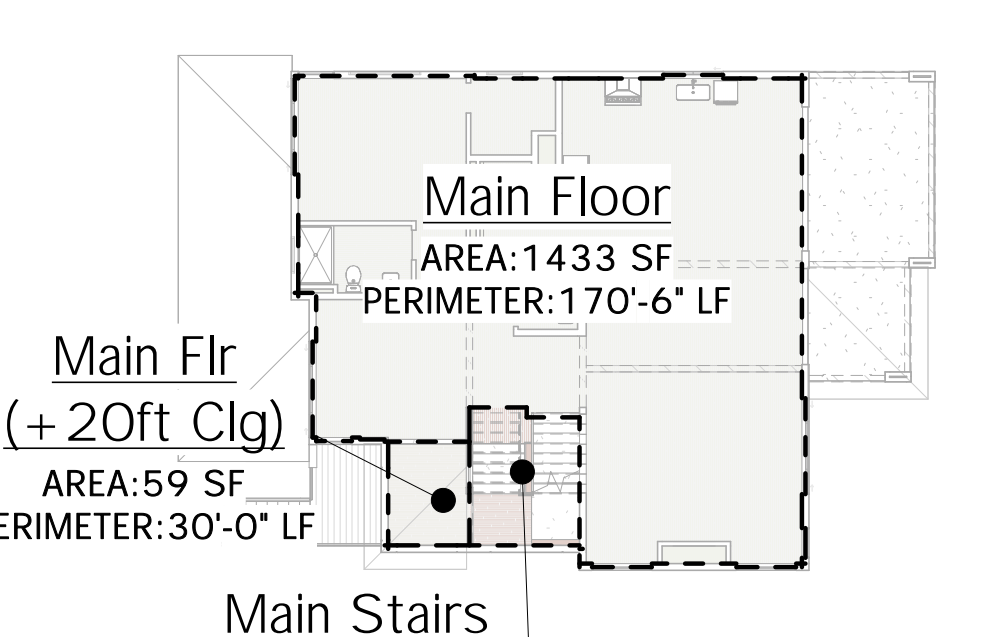


13 GROSS FLOOR AREA - UPPER FLR

SCALE: 1/16" = 1'-0"

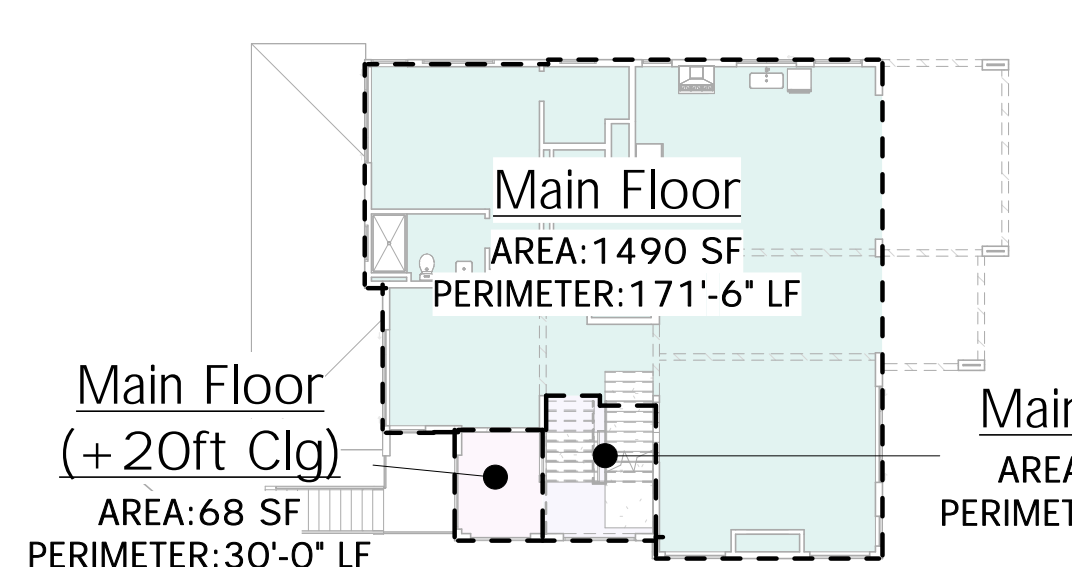


9 WSEC ENERGY CALCS - MAIN FLR

SCALE: 1/16" = 1'-0"

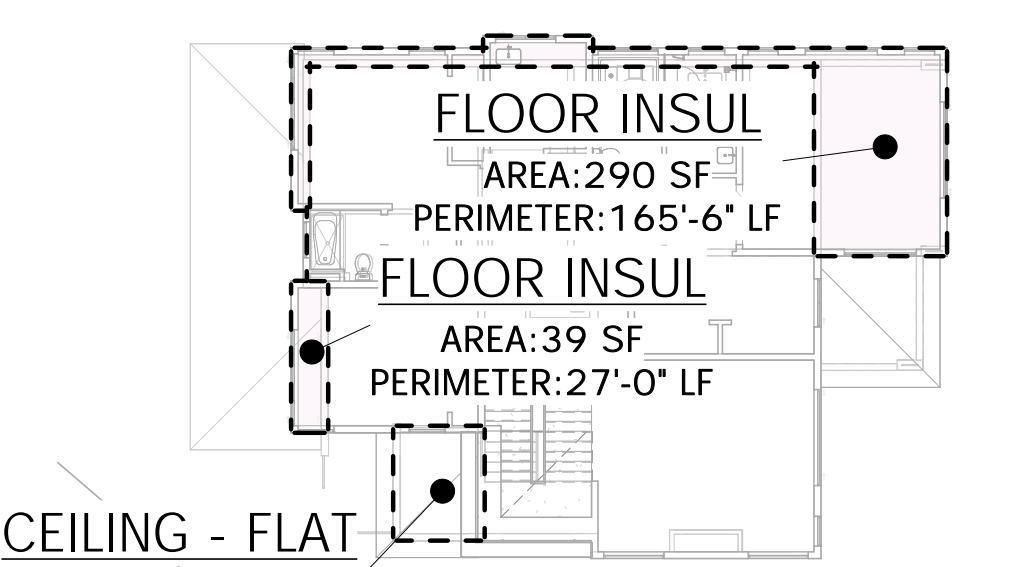


5 ROOF VENTING - MAIN

SCALE: 1/16" = 1'-0"

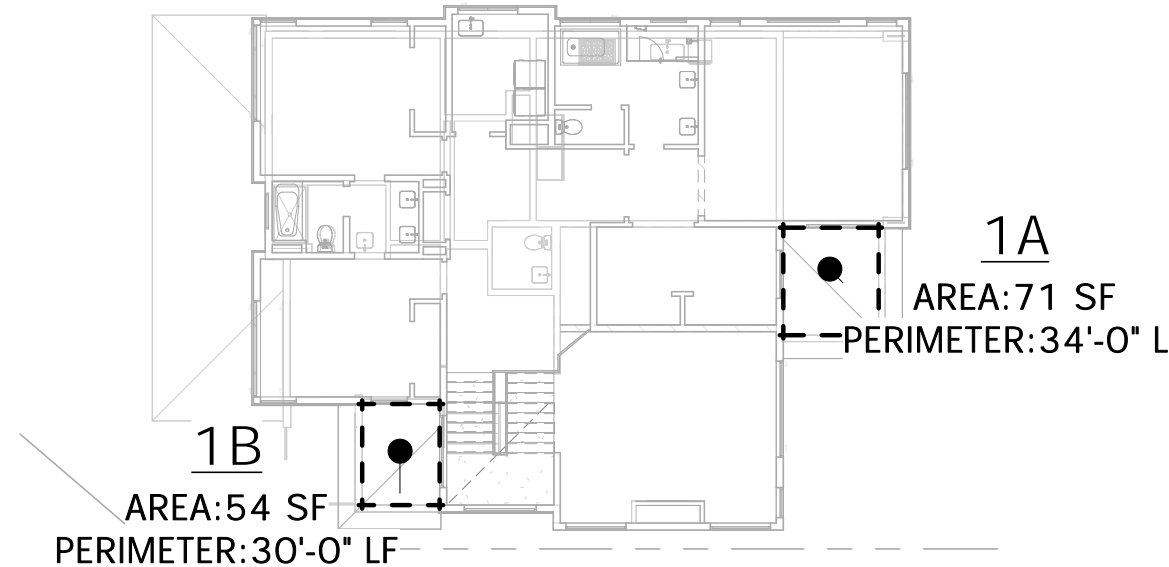


2 Main Floor F.A.R.

SCALE: 1/16" = 1'-0"

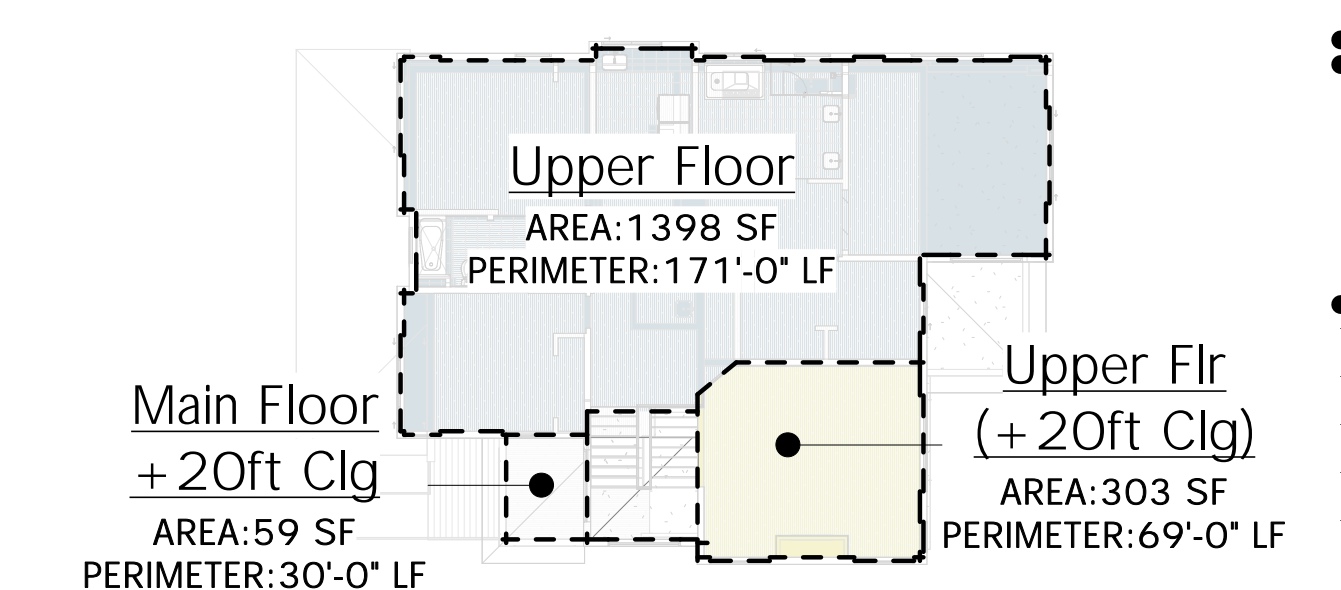


12 GROSS FLOOR AREA - MAIN FLR

SCALE: 1/16" = 1'-0"

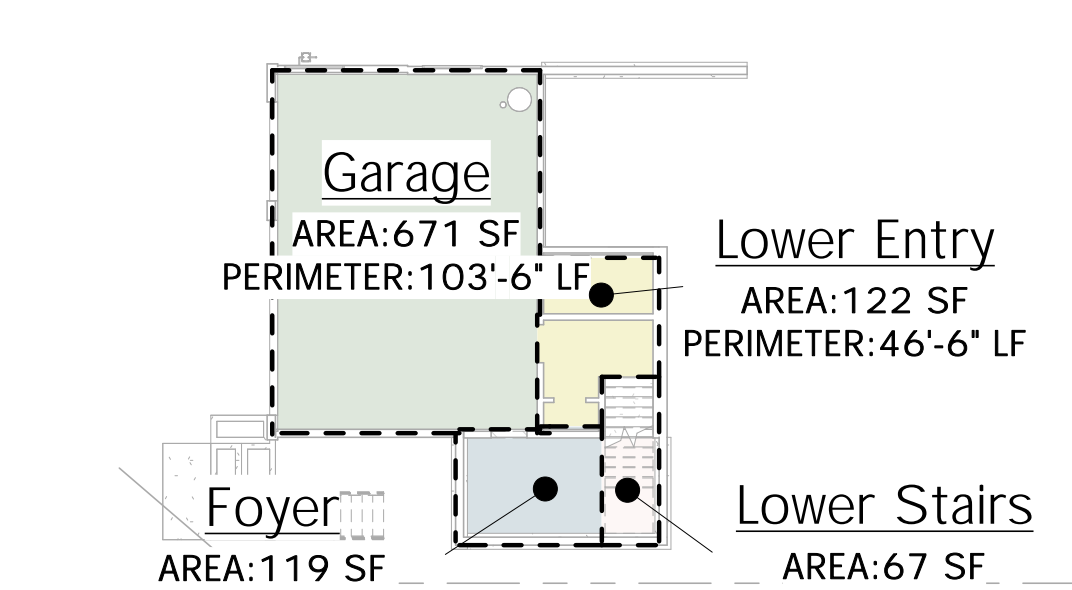

8 WSEC ENERGY CALCS - UPPER FLR

SCALE: 1/16" = 1'-0"

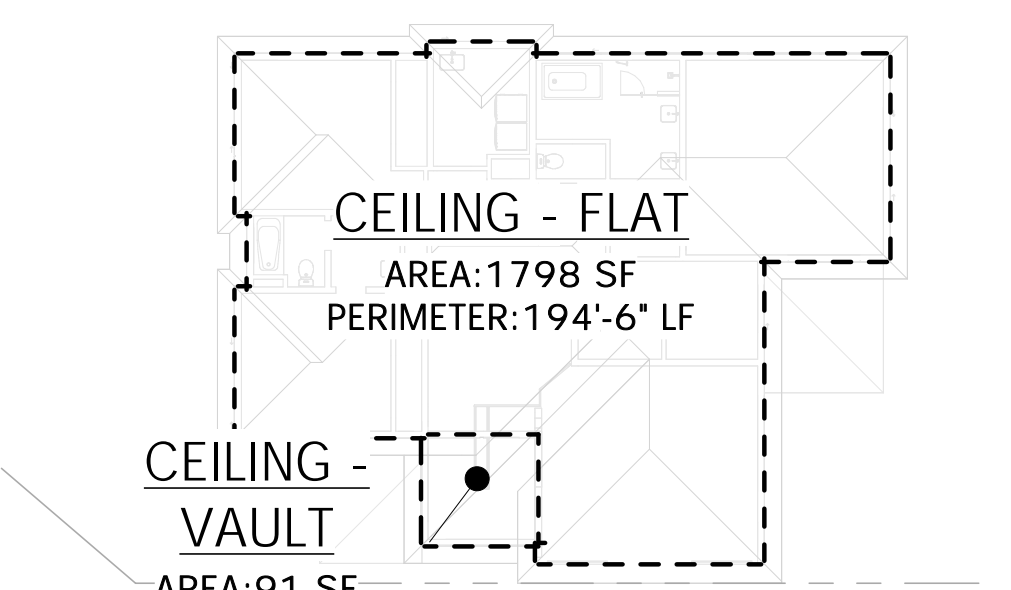

4 CRAWL SPACE VENTING

SCALE: 1/16" = 1'-0"



3 Upper Floor F.A.R.

SCALE: 1/16" = 1'-0"



11 GROSS FLOOR AREA - LOWER FLR

SCALE: 1/16" = 1'-0"



7 WSEC ENERGY CALCS - ROOF

SCALE: 1/16" = 1'-0"



Description
Date
No.



MONSEF DESIGN STUDIO
451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island


PERMIT SET

ENERGY/VENTING CALCULATIONS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2023/06/20
DRAWN BY: SPM


A003

SCALE 24X36: 1/16" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

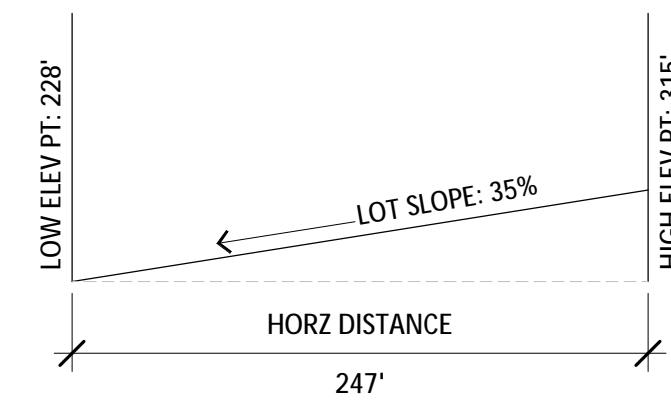


LOT SLOPE CALCULATIONS:
 HT ELEV POINT: 315 FT
 LW ELEV POINT: 228 FT
 ELEV DIFFERENCE: 87 FT
 HORZ DISTANCE: 247 FT
 LOT SLOPE: $(87/247) \times 100 = 35\%$

6 Lot Slope
 SCALE: 1/8" = 1'-0"

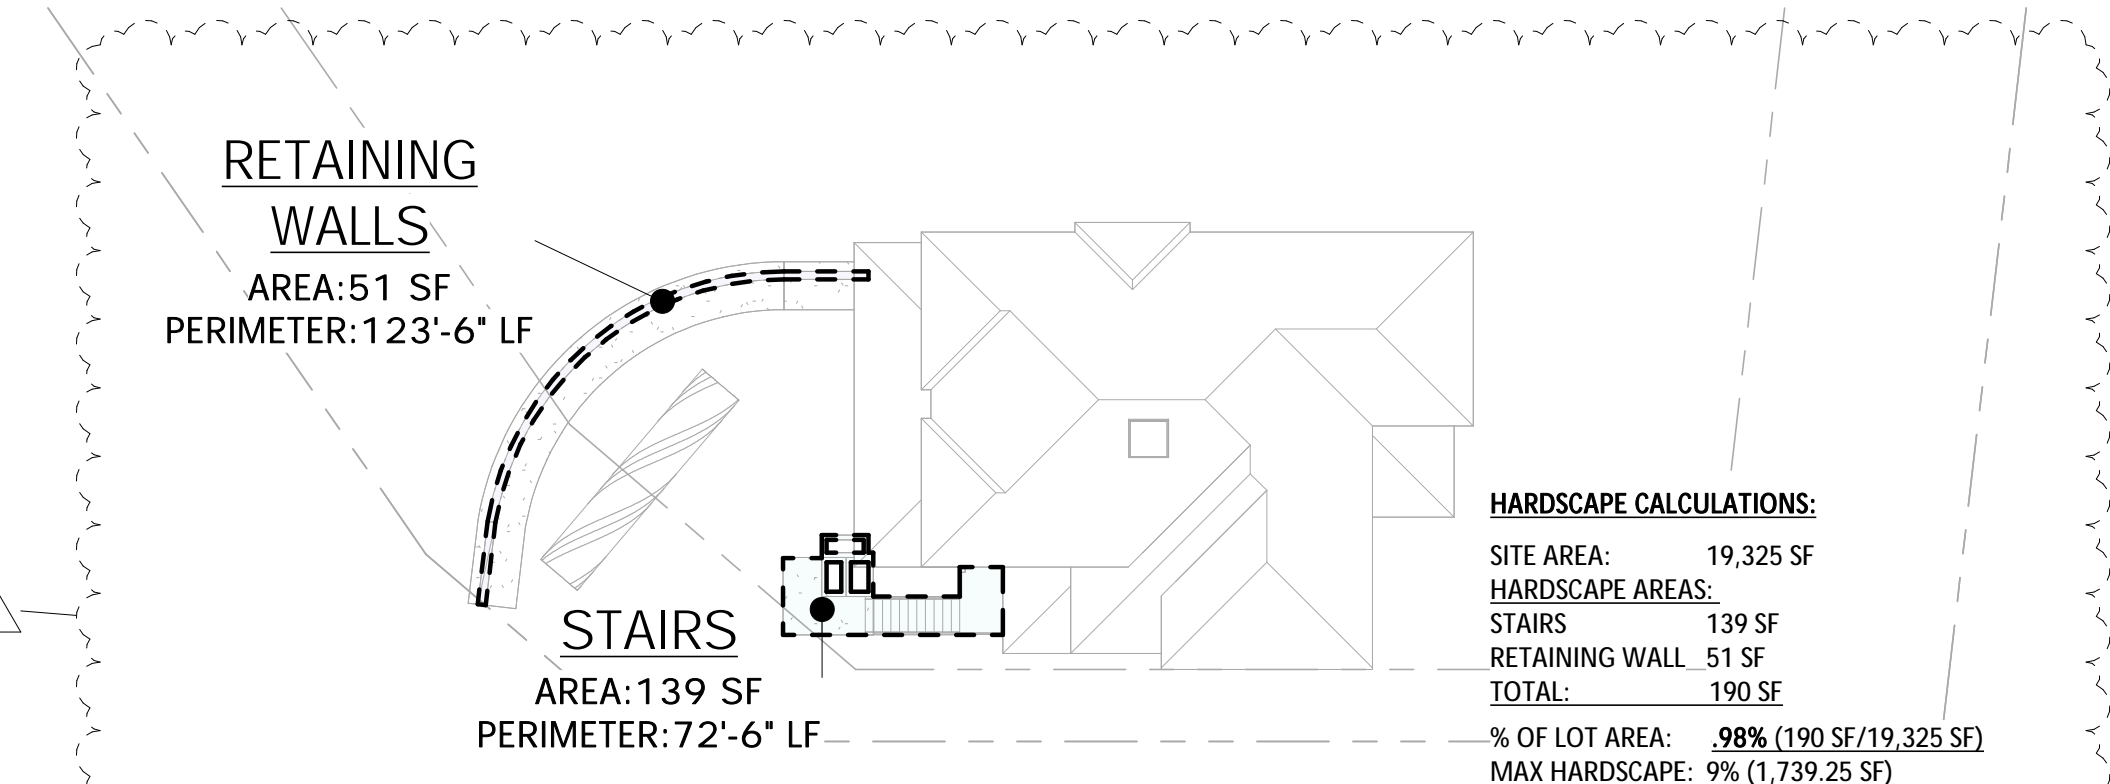

5 Hardscape Calculations
 SCALE: 1" = 20'-0"

HARDSCAPE CALCULATIONS:
 SITE AREA: 19,325 SF
 HARDSCAPE AREAS:
 STAIRS: 139 SF
 RETAINING WALL: 51 SF
 TOTAL: 190 SF
 % OF LOT AREA: $98\% (190 SF / 19,325 SF)$
 MAX HARDSCAPE: $9\% (1,739.25 SF)$

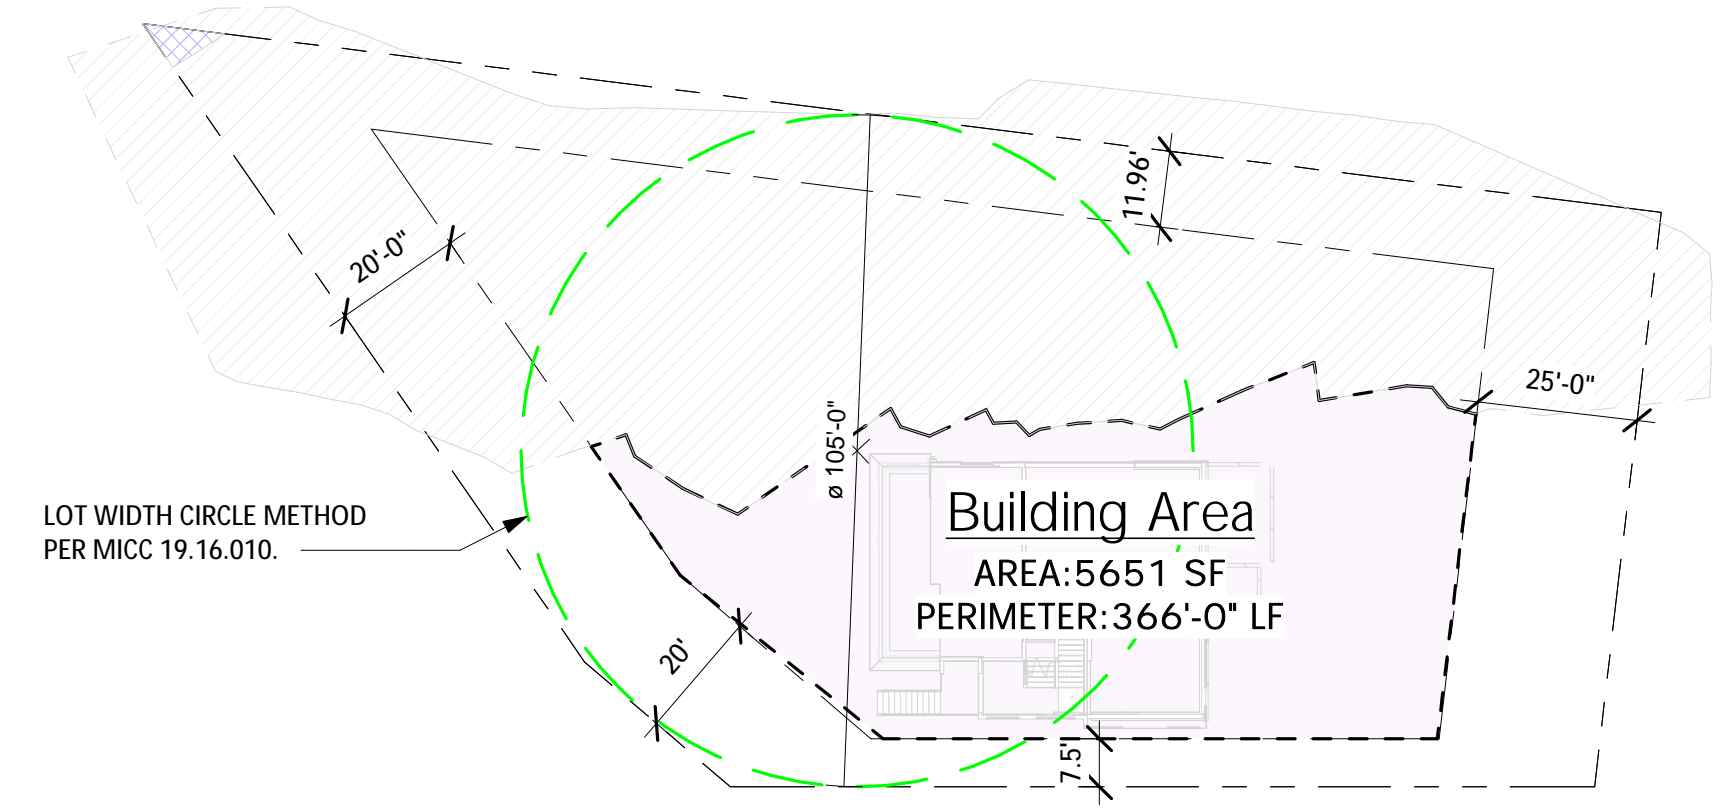

4 Allowable Building Pad - MICC 19.02.020(j)
 SCALE: 1" = 30'-0"


YARDS: 19.02.020(C)
 FRONT: 20 FT MIN
 REAR: 25 FT MIN
 SIDES: 10.35 FT MIN
 SIDES: 7.5 FT MIN
 LOT WIDTH: 105'
 17% OF LOT WIDTH = 17.85'
 33% OF TOTAL SIDE YARD SETBACK = 5.82' MIN

GFA CALCULATIONS
 SITE AREA: 19,325 SF
 ALLOWED GFA: 7,730 SF (40%)
 PROPOSED GFA: 4,185 SF (21.65%)

TREE RETENTION CALCULATIONS: (19.10.010)
 REQUIRED: 30 PERCENT OF THE TREES WILL NEED TO BE RETAINED. TREES THAT ARE EXCEPTIONAL, ARE LARGE, AND HAVE A HIGH LIKELIHOOD FOR LONG-TERM SURVIVAL ARE PRIORITIZED FOR RETENTION
 PROPOSED:
 EXISTING D.B.H.: 875.6" (576.4 / 875.6 = 65.8% RETAINED)
 RETAINED D.B.H.: 576.4"
 REMOVED D.B.H.: 299.2"


NOTE:
 PER MICC 19.02.020(F)(3)(D)
 DEVELOPMENT PROPOSALS FOR A NEW SINGLE-FAMILY HOME SHALL REMOVE JAPANESE KNOTWEED (POLYGONUM CUSPIDATUM) AND REGULATED CLASS A, REGULATED CLASS B, AND REGULATED CLASS C WEEDS IDENTIFIED ON THE KING COUNTY NOXIOUS WEED LIST, AS AMENDED, FROM REQUIRED LANDSCAPING AREAS ESTABLISHED PURSUANT TO SUBSECTION (F)(3)(A) OF THIS SECTION. NEW LANDSCAPING ASSOCIATED WITH NEW SINGLE-FAMILY HOME SHALL NOT INCORPORATE ANY WEEDS IDENTIFIED ON THE KING COUNTY NOXIOUS WEED LIST, AS AMENDED. PROVIDED, THAT REMOVAL SHALL NOT BE REQUIRED IF THE REMOVAL WILL RESULT IN INCREASED SLOPE INSTABILITY OR RISK OF LANDSLIDE OR EROSION.

LOT SLOPE 30-50%
 HARDSCAPES: 9%
 LOT COVERAGE: 30%
 LOT AREA = $19,325 \times 30\% = \text{MAX COVERAGE OF } 5,797.5 \text{ SF}$
 MAX HARDSCAPE OF 1,739.25 SF

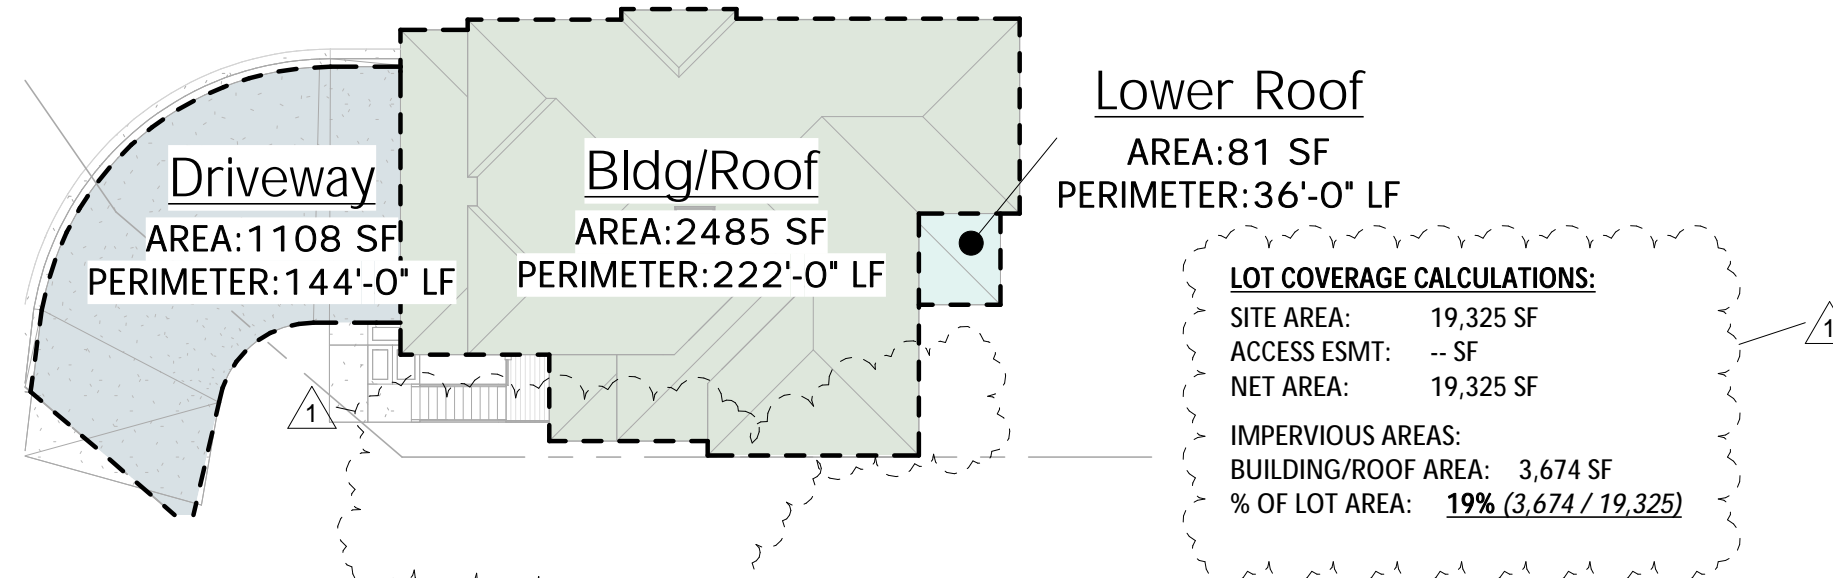


2 LOT COVERAGE CALCULATIONS
 SCALE: 1" = 20'-0"

LOT COVERAGE CALCULATIONS:
 SITE AREA: 19,325 SF
 ACCESS ESMT: -- SF
 NET AREA: 19,325 SF
 IMPERVIOUS AREAS:
 BUILDING/ROOF AREA: 3,674 SF
 % OF LOT AREA: $19\% (3,674 / 19,325)$

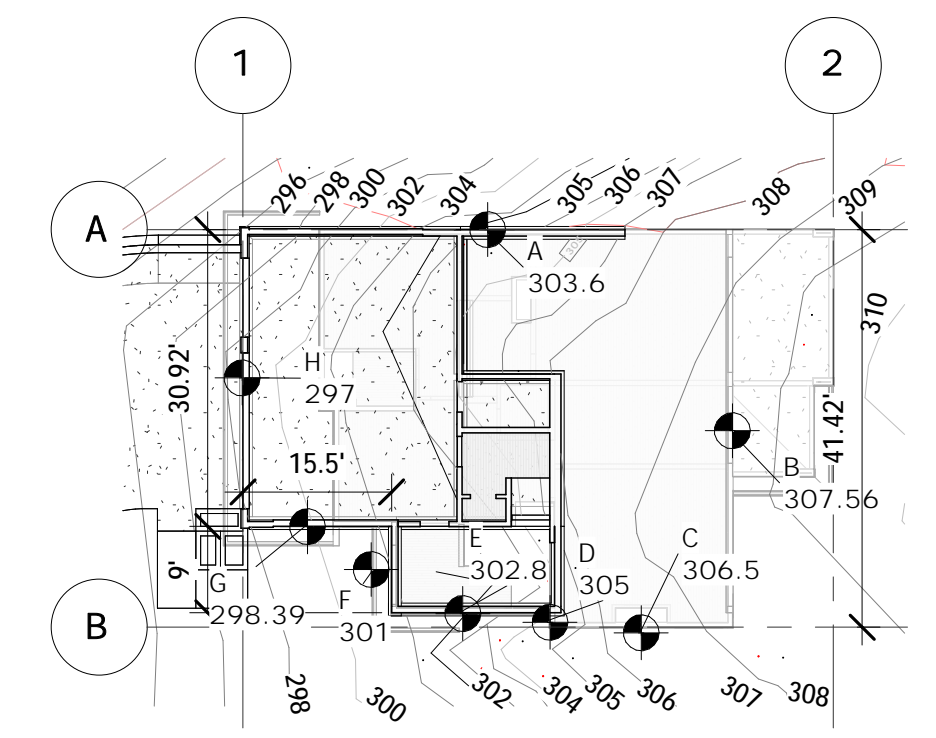

3 AVERAGE BLDG HT CALCULATIONS
 SCALE: 1" = 20'-0"

A.B.E. CHART		
MARK	A.B.E. DATA	A.B.E. CALCULATIONS (ELEV * LENGTH)
A	303.6 51	15483.6
B	307.56 41.92	12892.9152
C	306.5 19	5823.5
D	305 2	610
E	302.8 18.54	5613.912
F	301 9	2709
G	298.39 13.46	4016.3294
H	297 30.92	9183.24
AVERAGE BUILDING ELEVATION (A.B.E.) CALCULATIONS:		
$\frac{56,332.4966}{185.84} = 303.12$		303.12 AVERAGE BUILDING ELEVATION (A.B.E.)

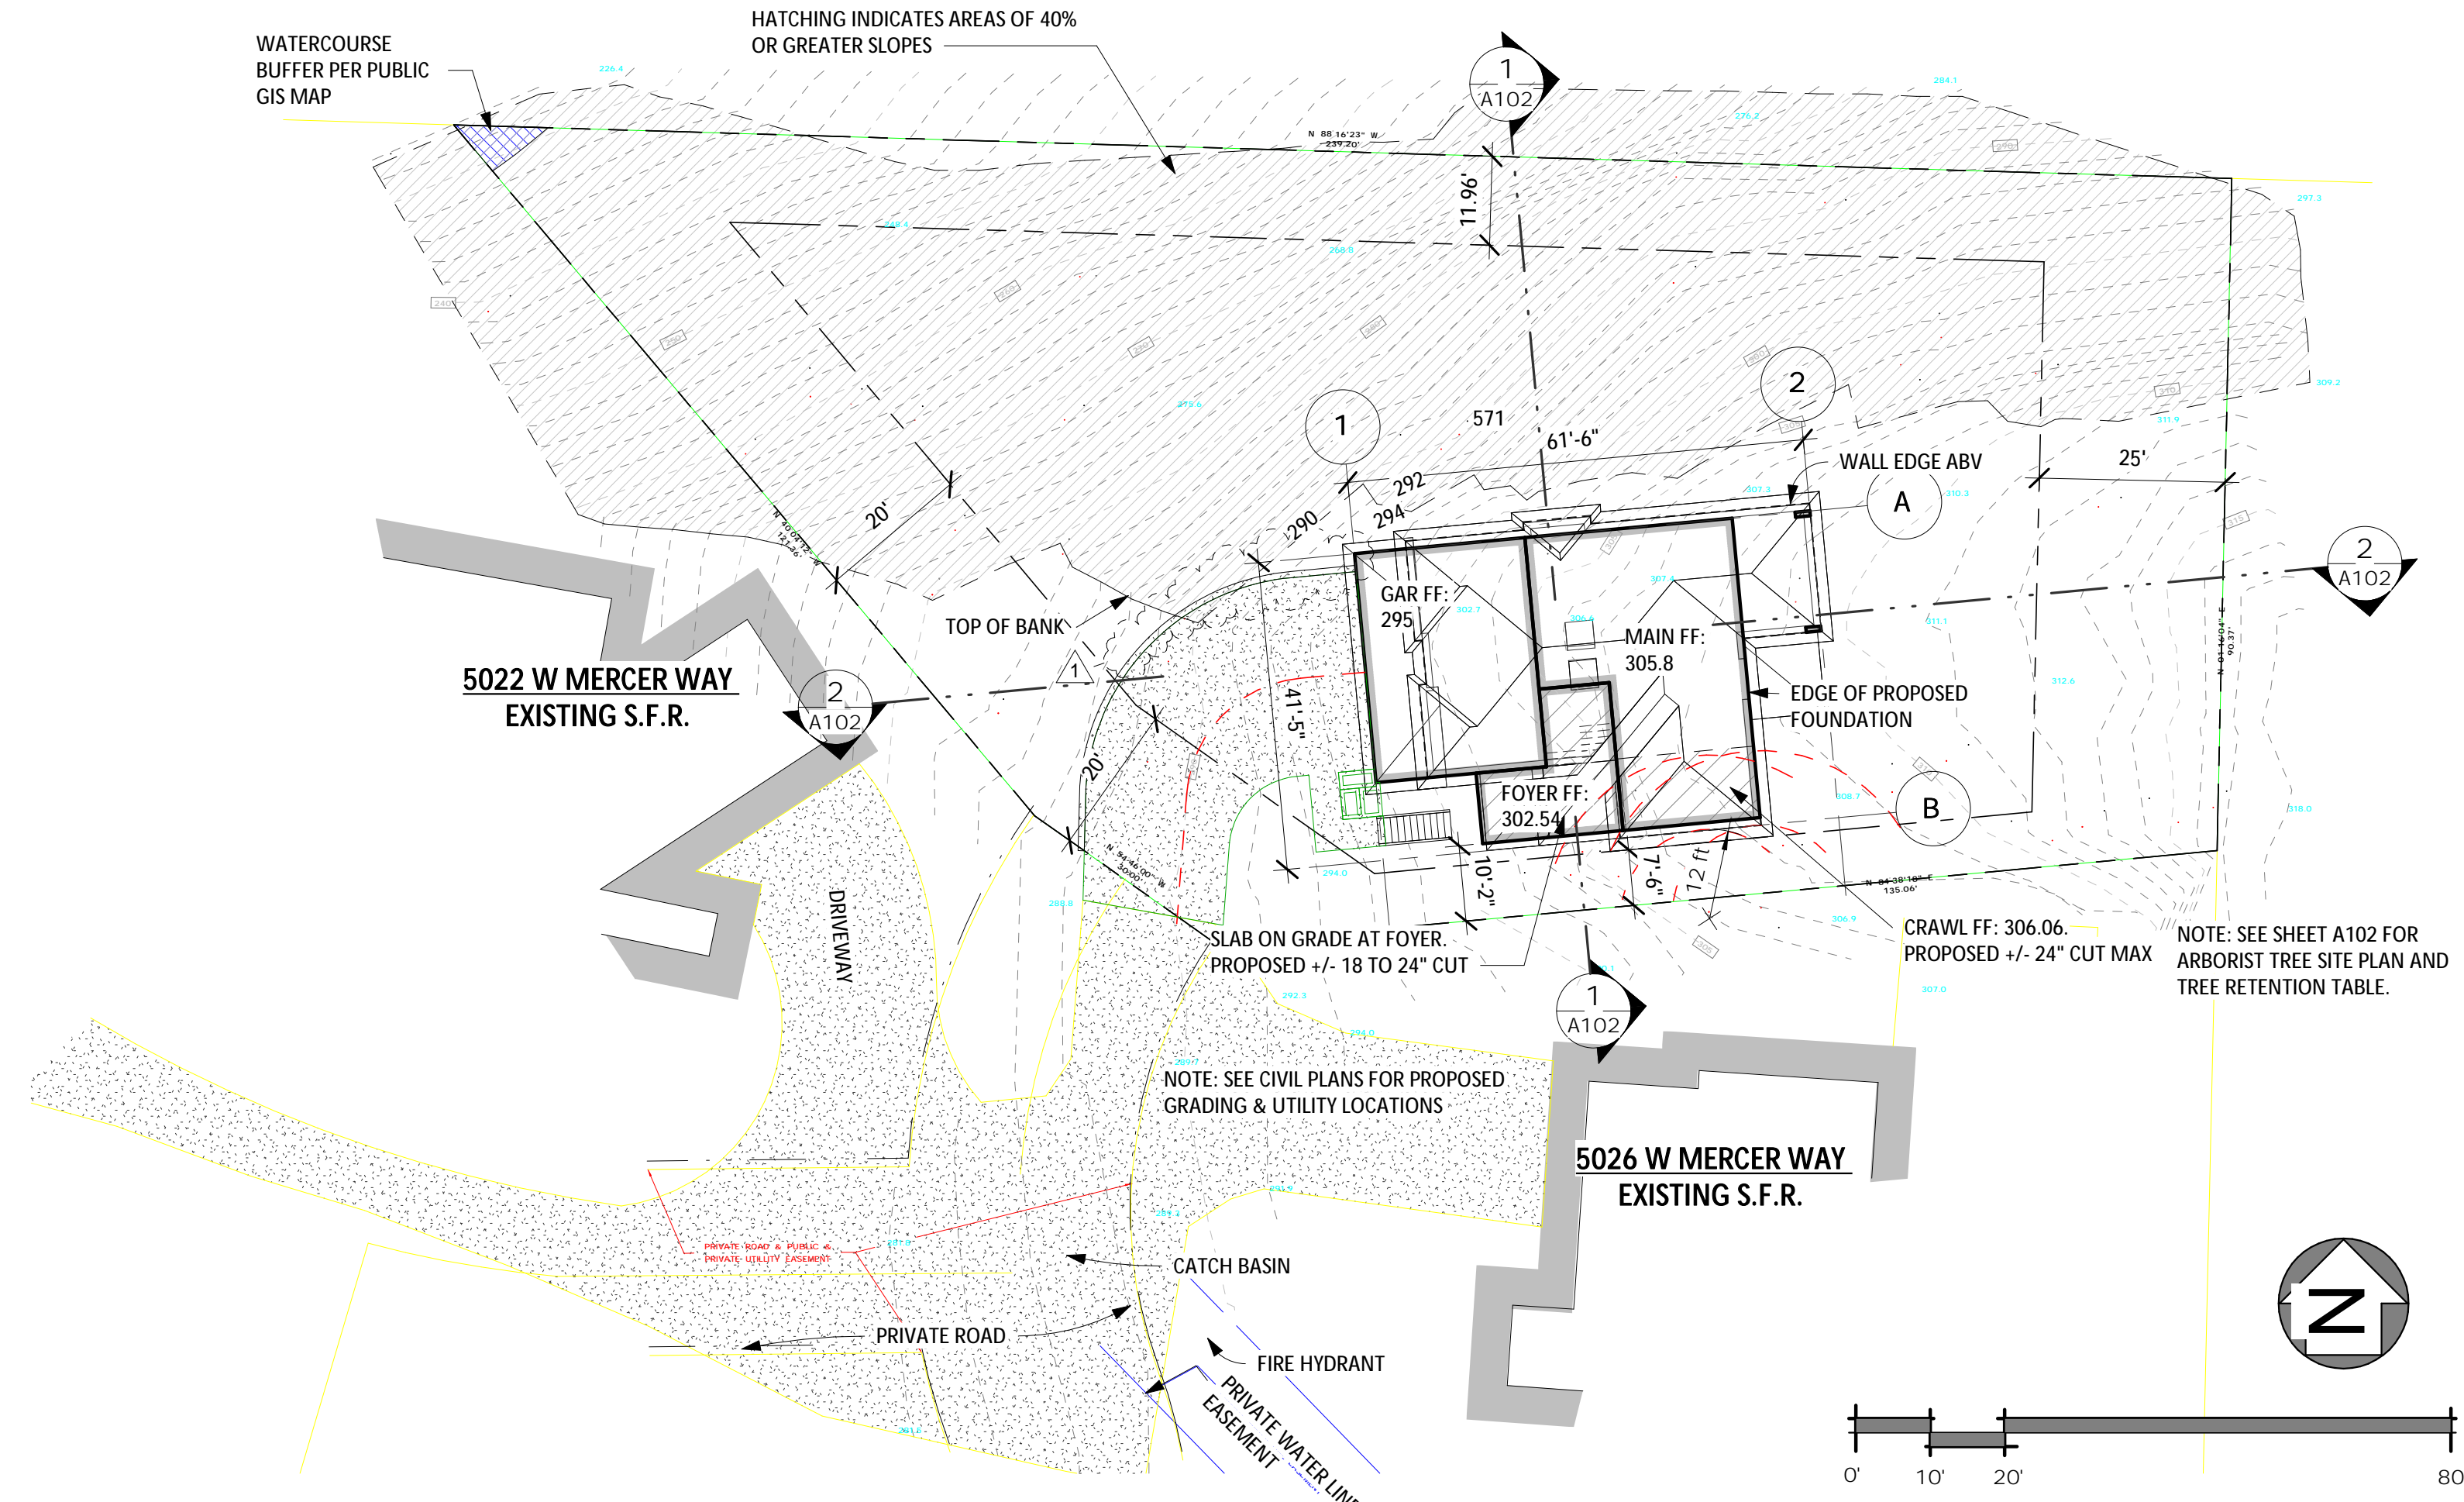

1 SITE PLAN
 SCALE: 1" = 20'-0"

Description
 CITY COMMENTS
 Date
 TBD
 No.



MONSEF DESIGN
 STUDIO

451 DUVAL AVENUE NE, RENTON, WA 98059
 206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
 5024 W Mercer Way, Mercer Island


PERMIT SET

SITE PLAN &
 AREA/HT
 CALCULATIONS


PROJECT NO: 20008
 ISSUE DATE: 2023/08/01
 SHT ISSUE DATE: 2021/01/08
 DRAWN BY: SPM

A101


SCALE 24X36: As indicated
 * NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

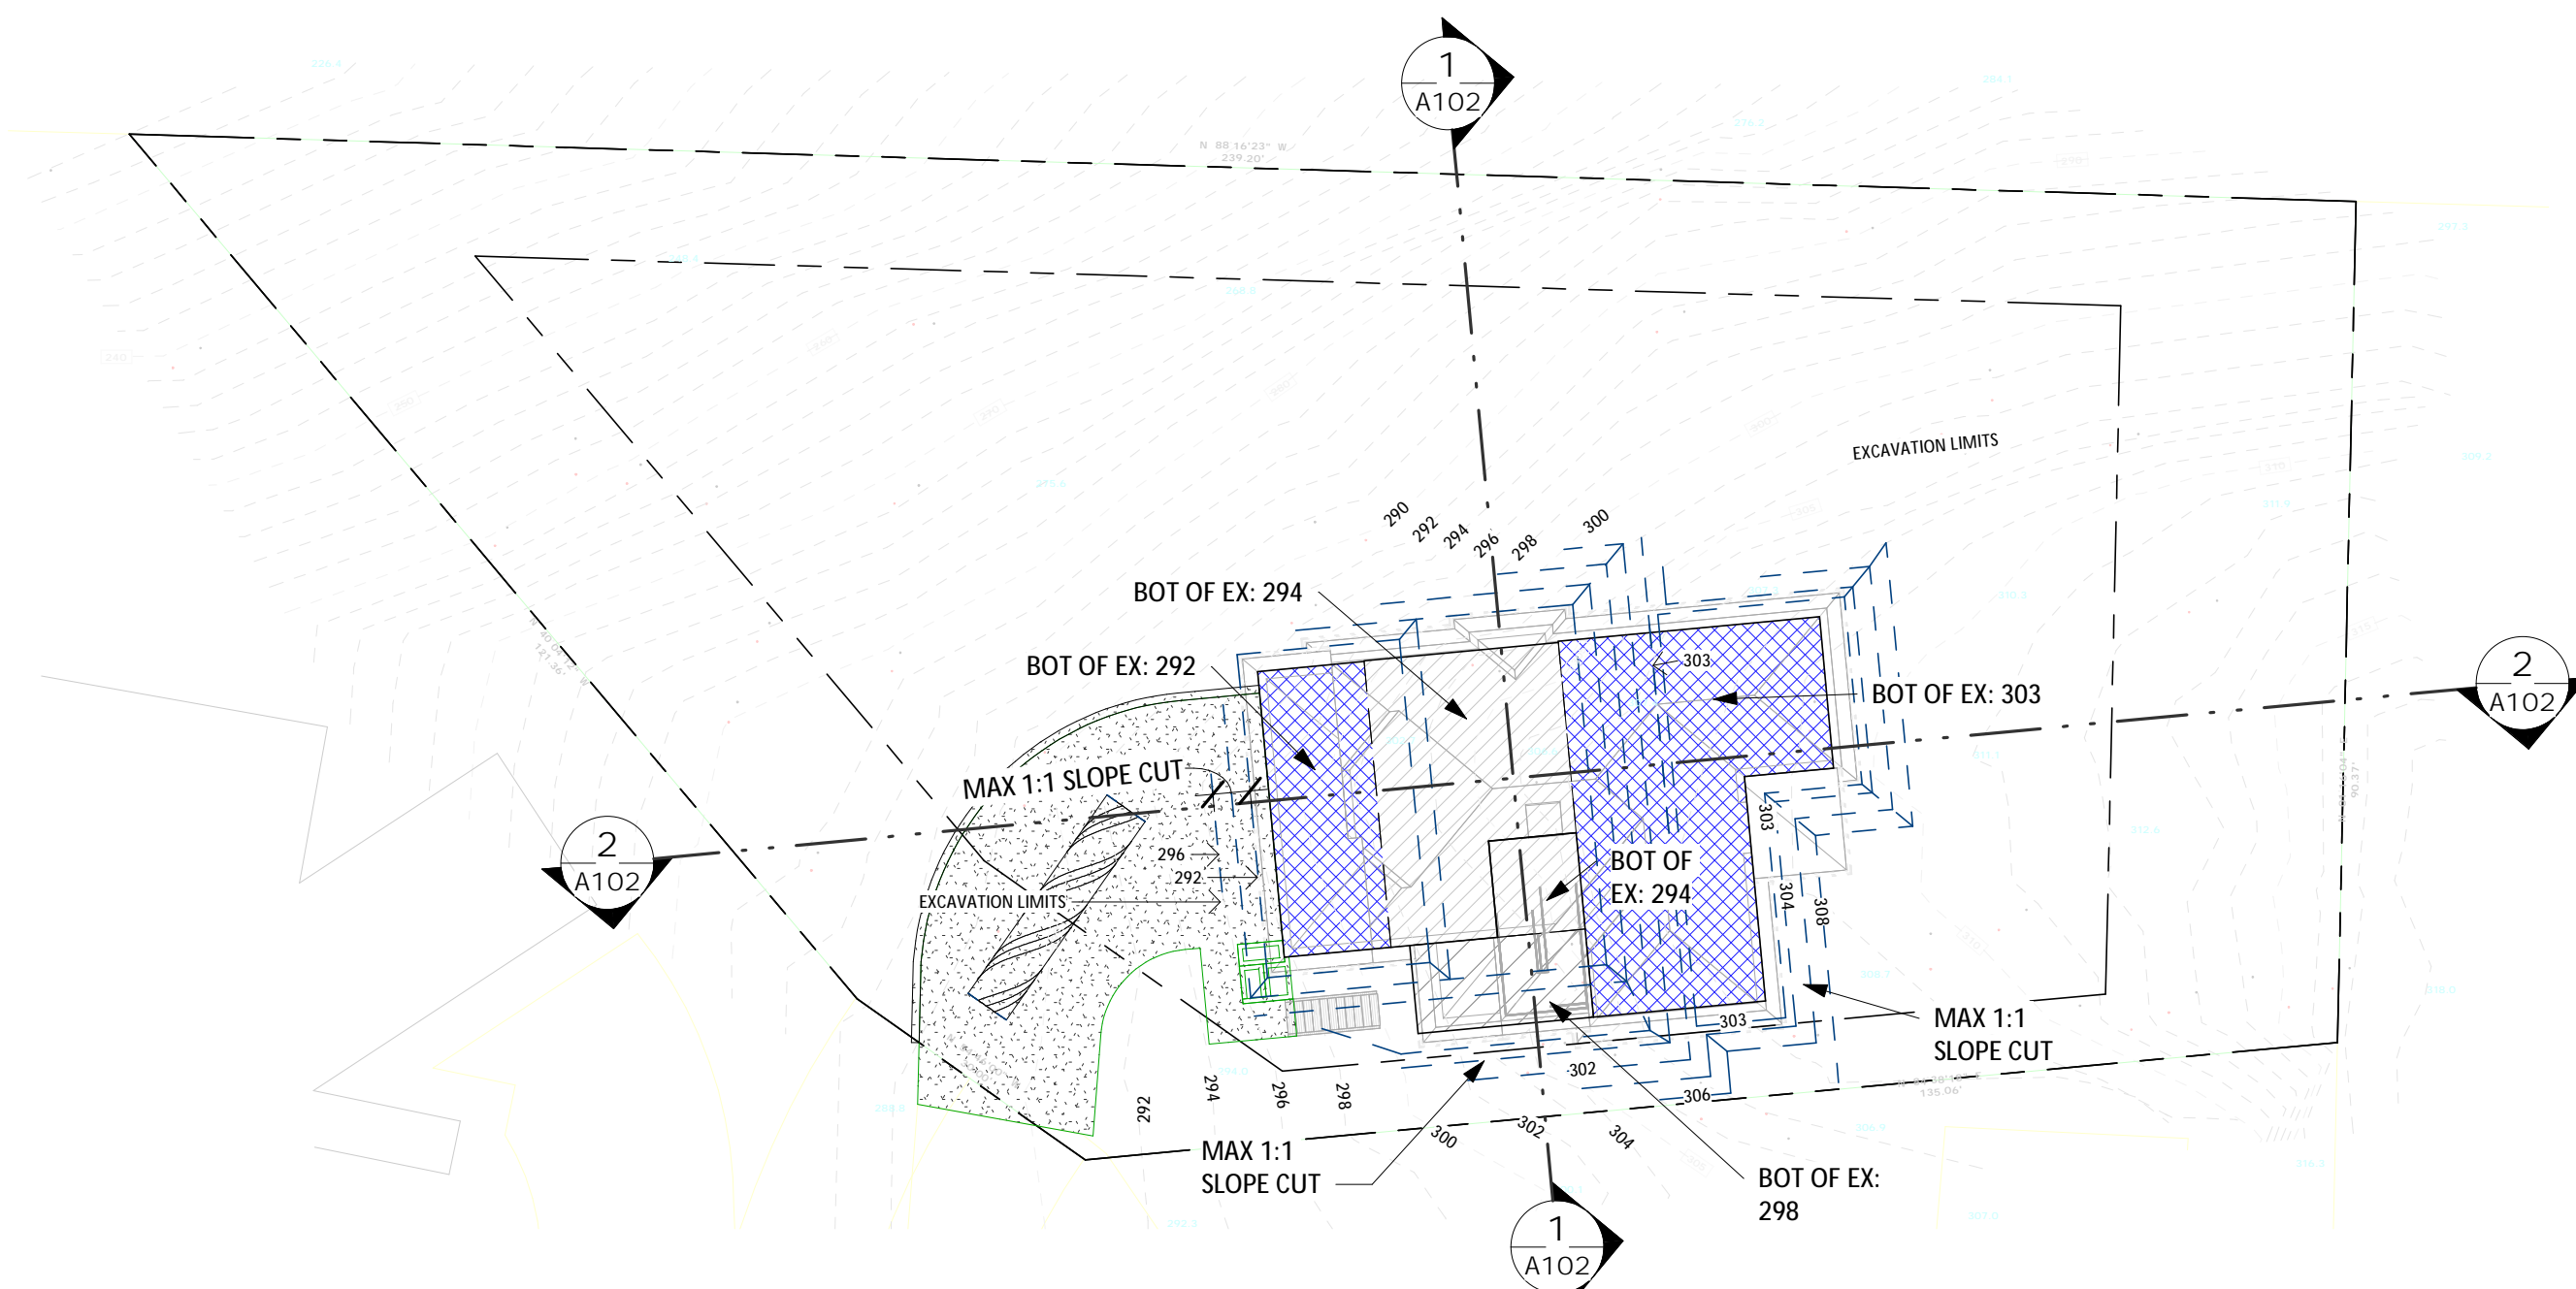

3 TEMP EXCAVATION PLAN
SCALE: 1" = 20'-0"

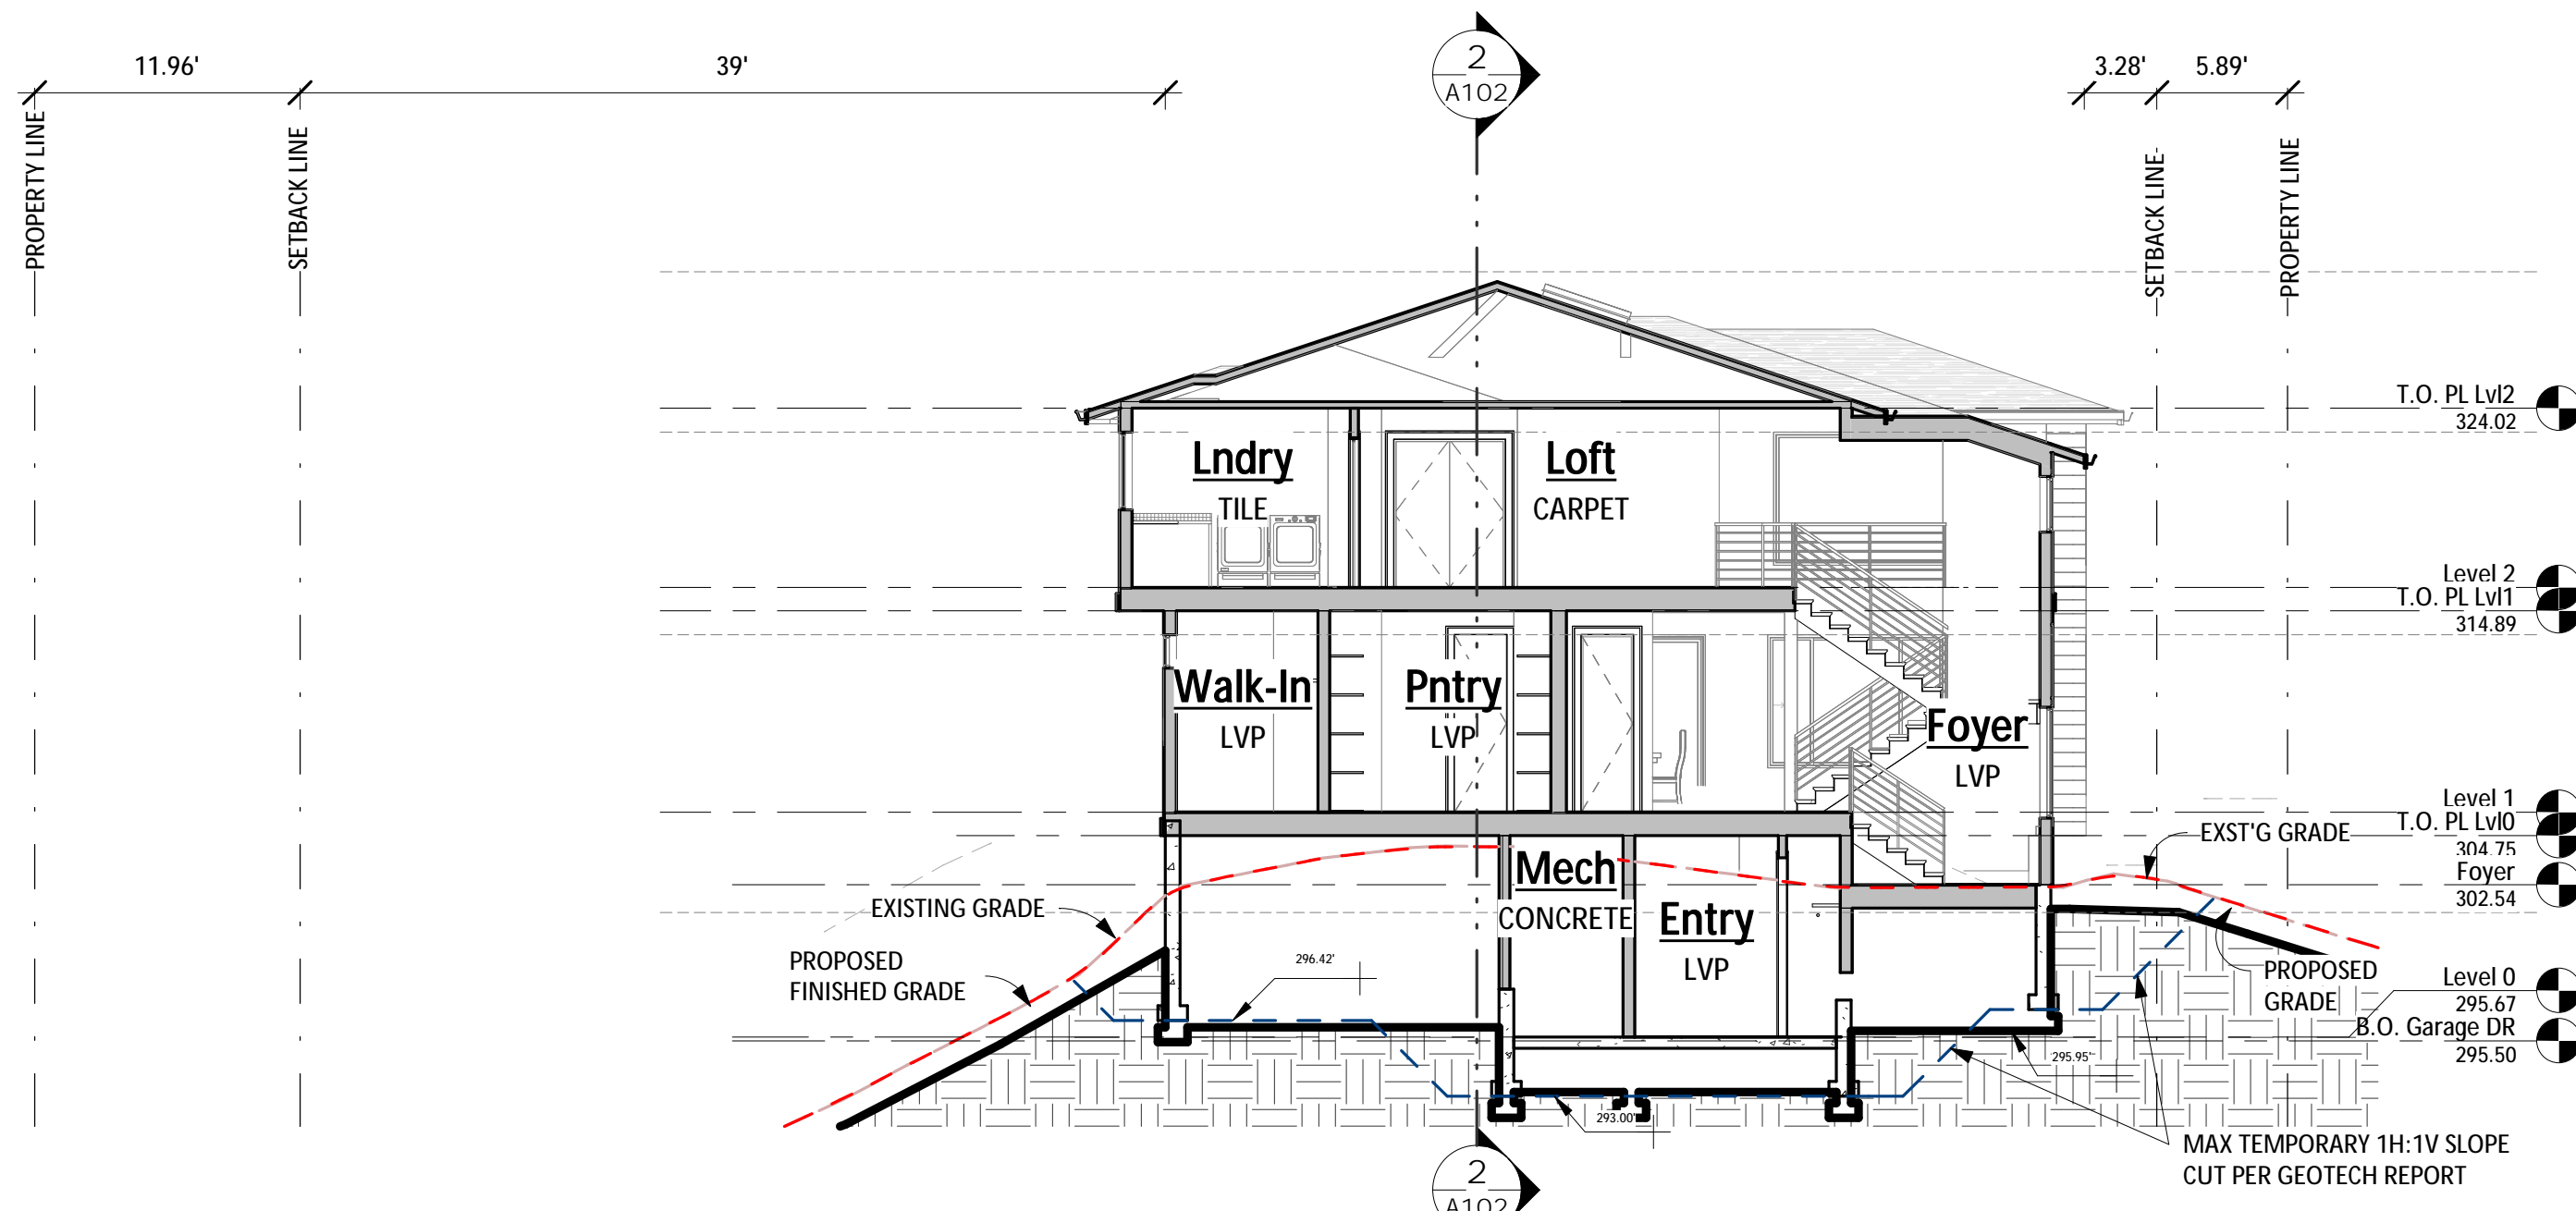

1 SITE SECTION E/W
SCALE: 1/8" = 1'-0"

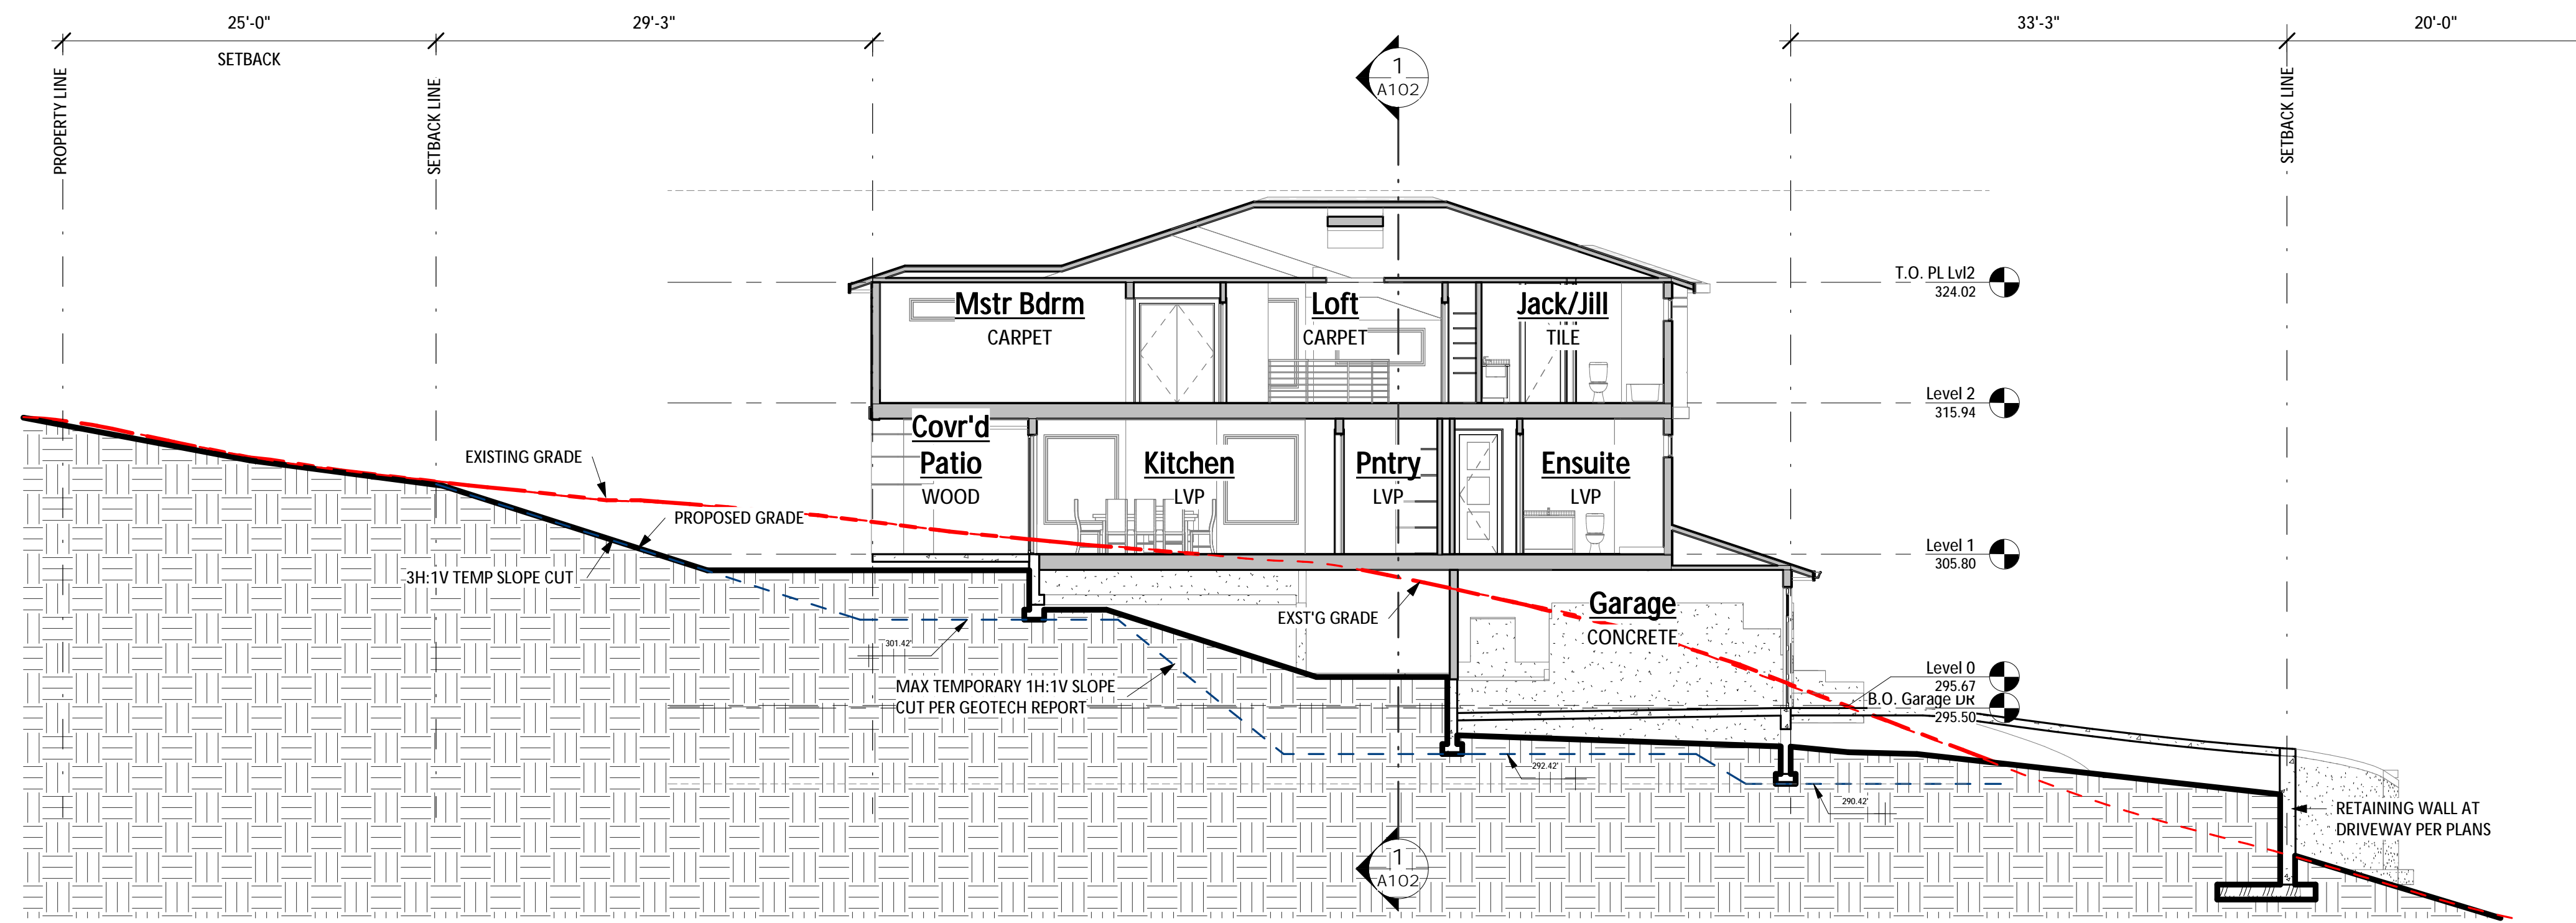

2 SITE SECTION N/S
SCALE: 1/8" = 1'-0"

Description
Date
No.

MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET


TEMPORARY
EXCAVATION
PLAN & SITE
SECTIONS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 03/02/23
DRAWN BY: Author


A102

SCALE 24X36: As indicated
* NOTE: 11X17 SETS ARE
REDUCED 50% SCALE
DRAWINGS ACCORDINGLY.

4/17/2024 12:32:08 PM Autodesk Docs://20008 Chen Residence, Mercer Island/20008-05 Chen Residence, MI - SUB2.rvt

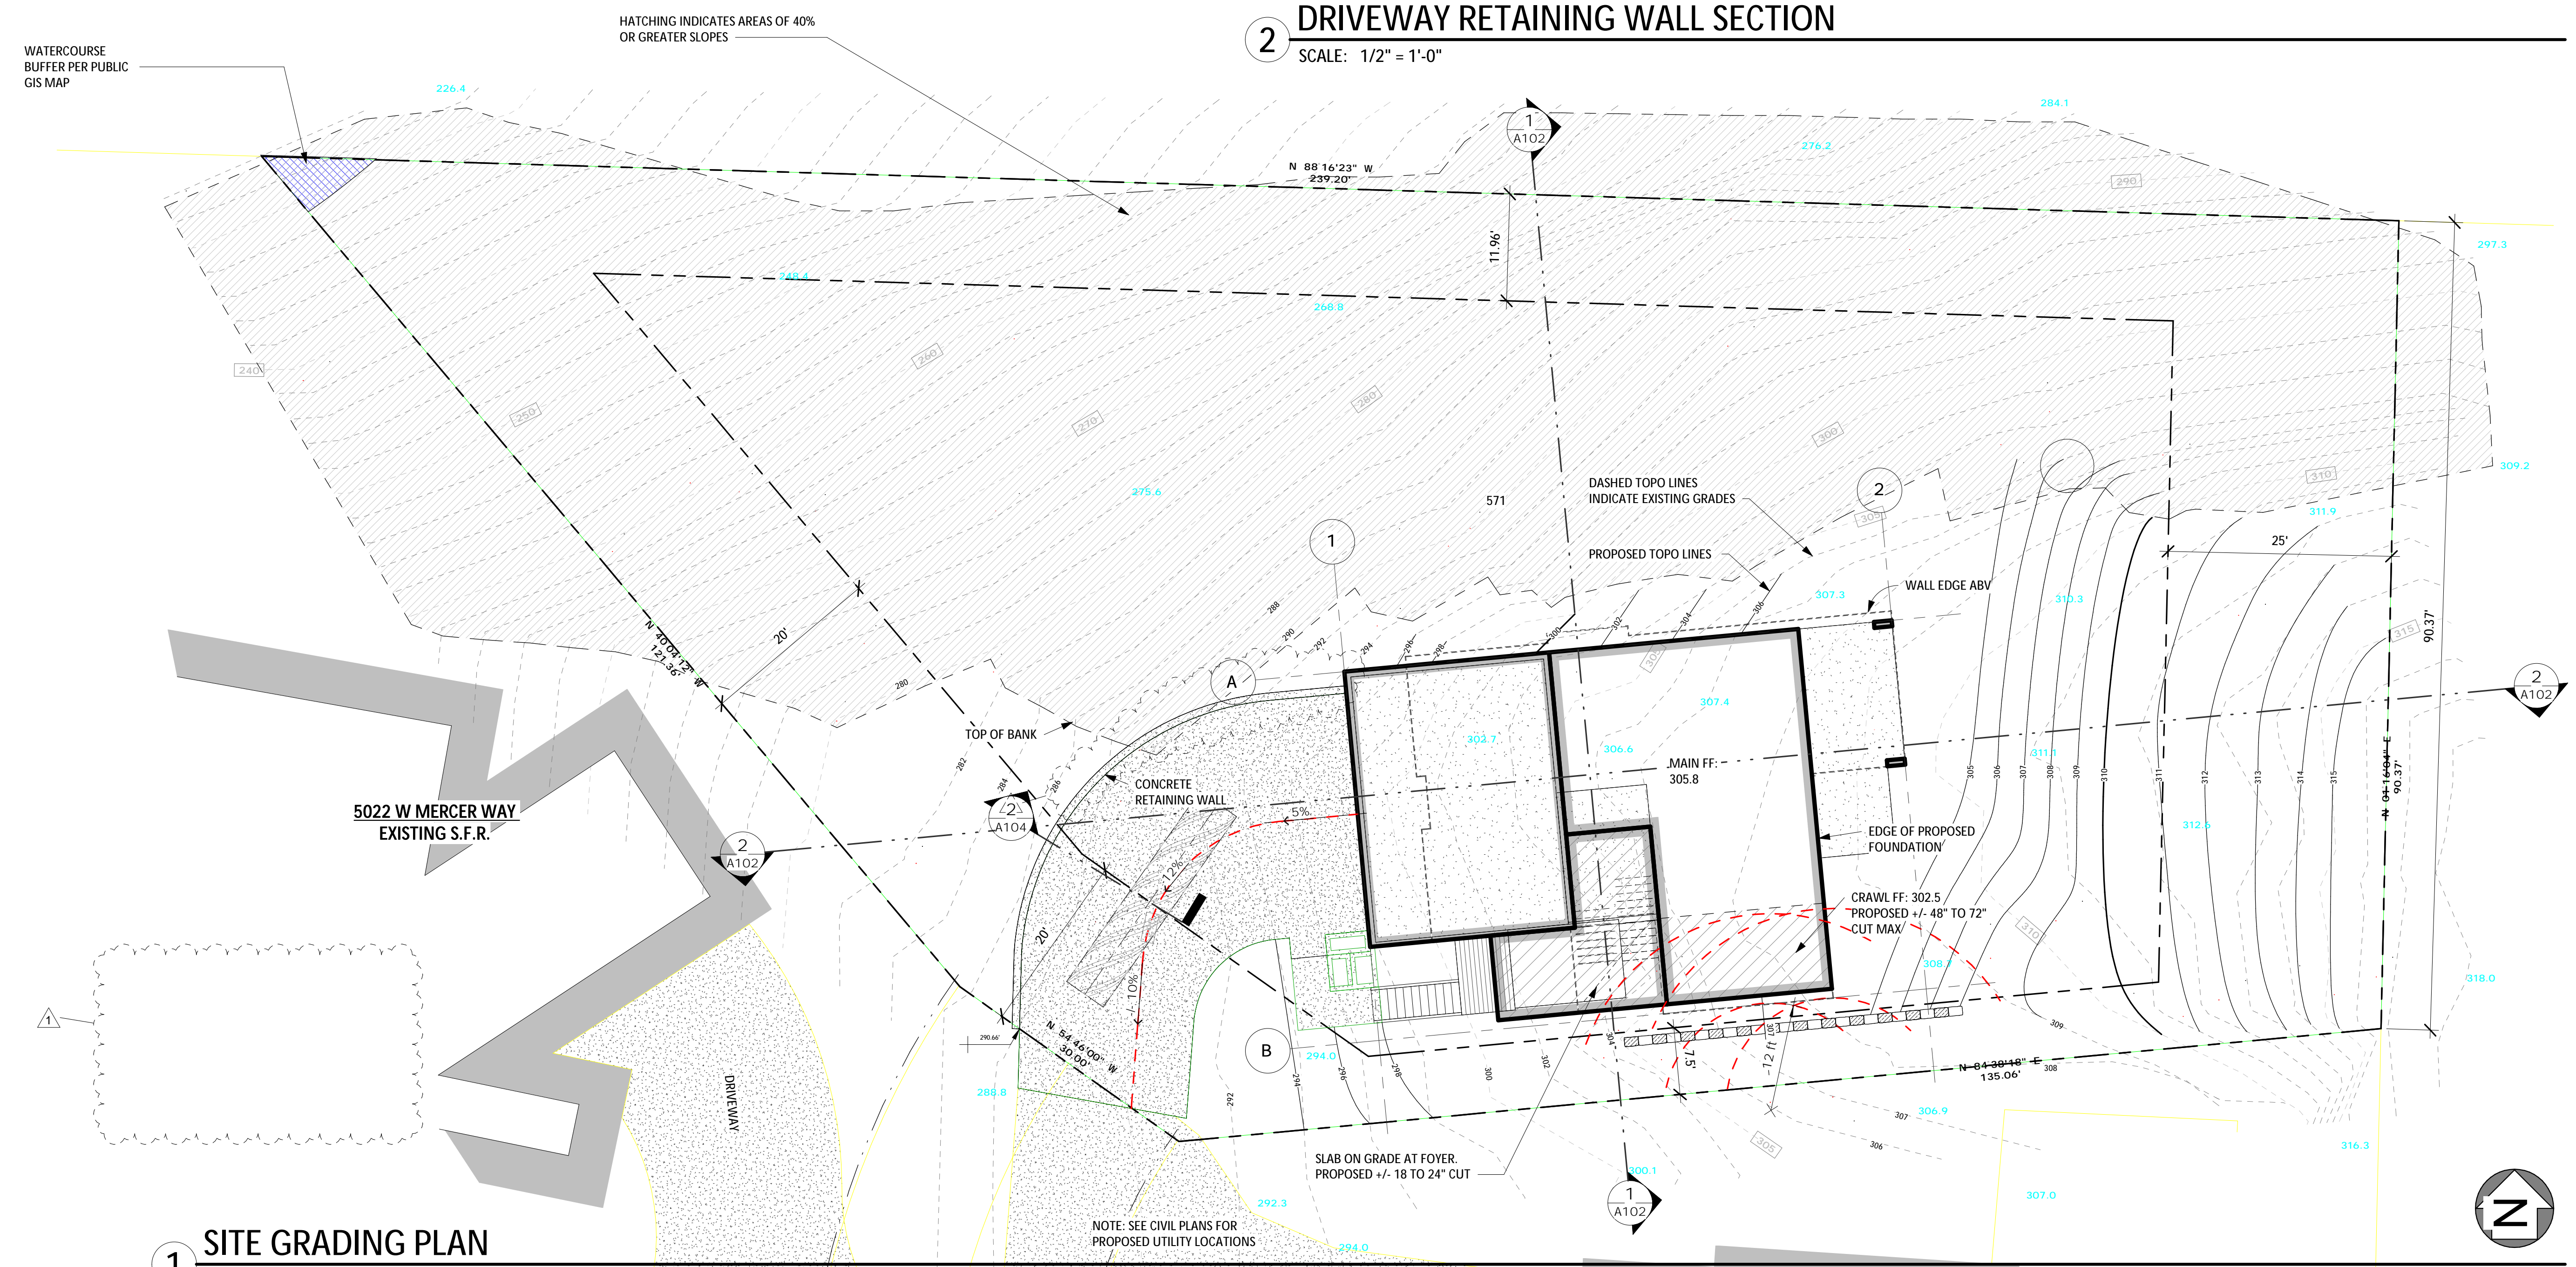

1 SITE GRADING PLAN
SCALE: 1" = 10'-0"

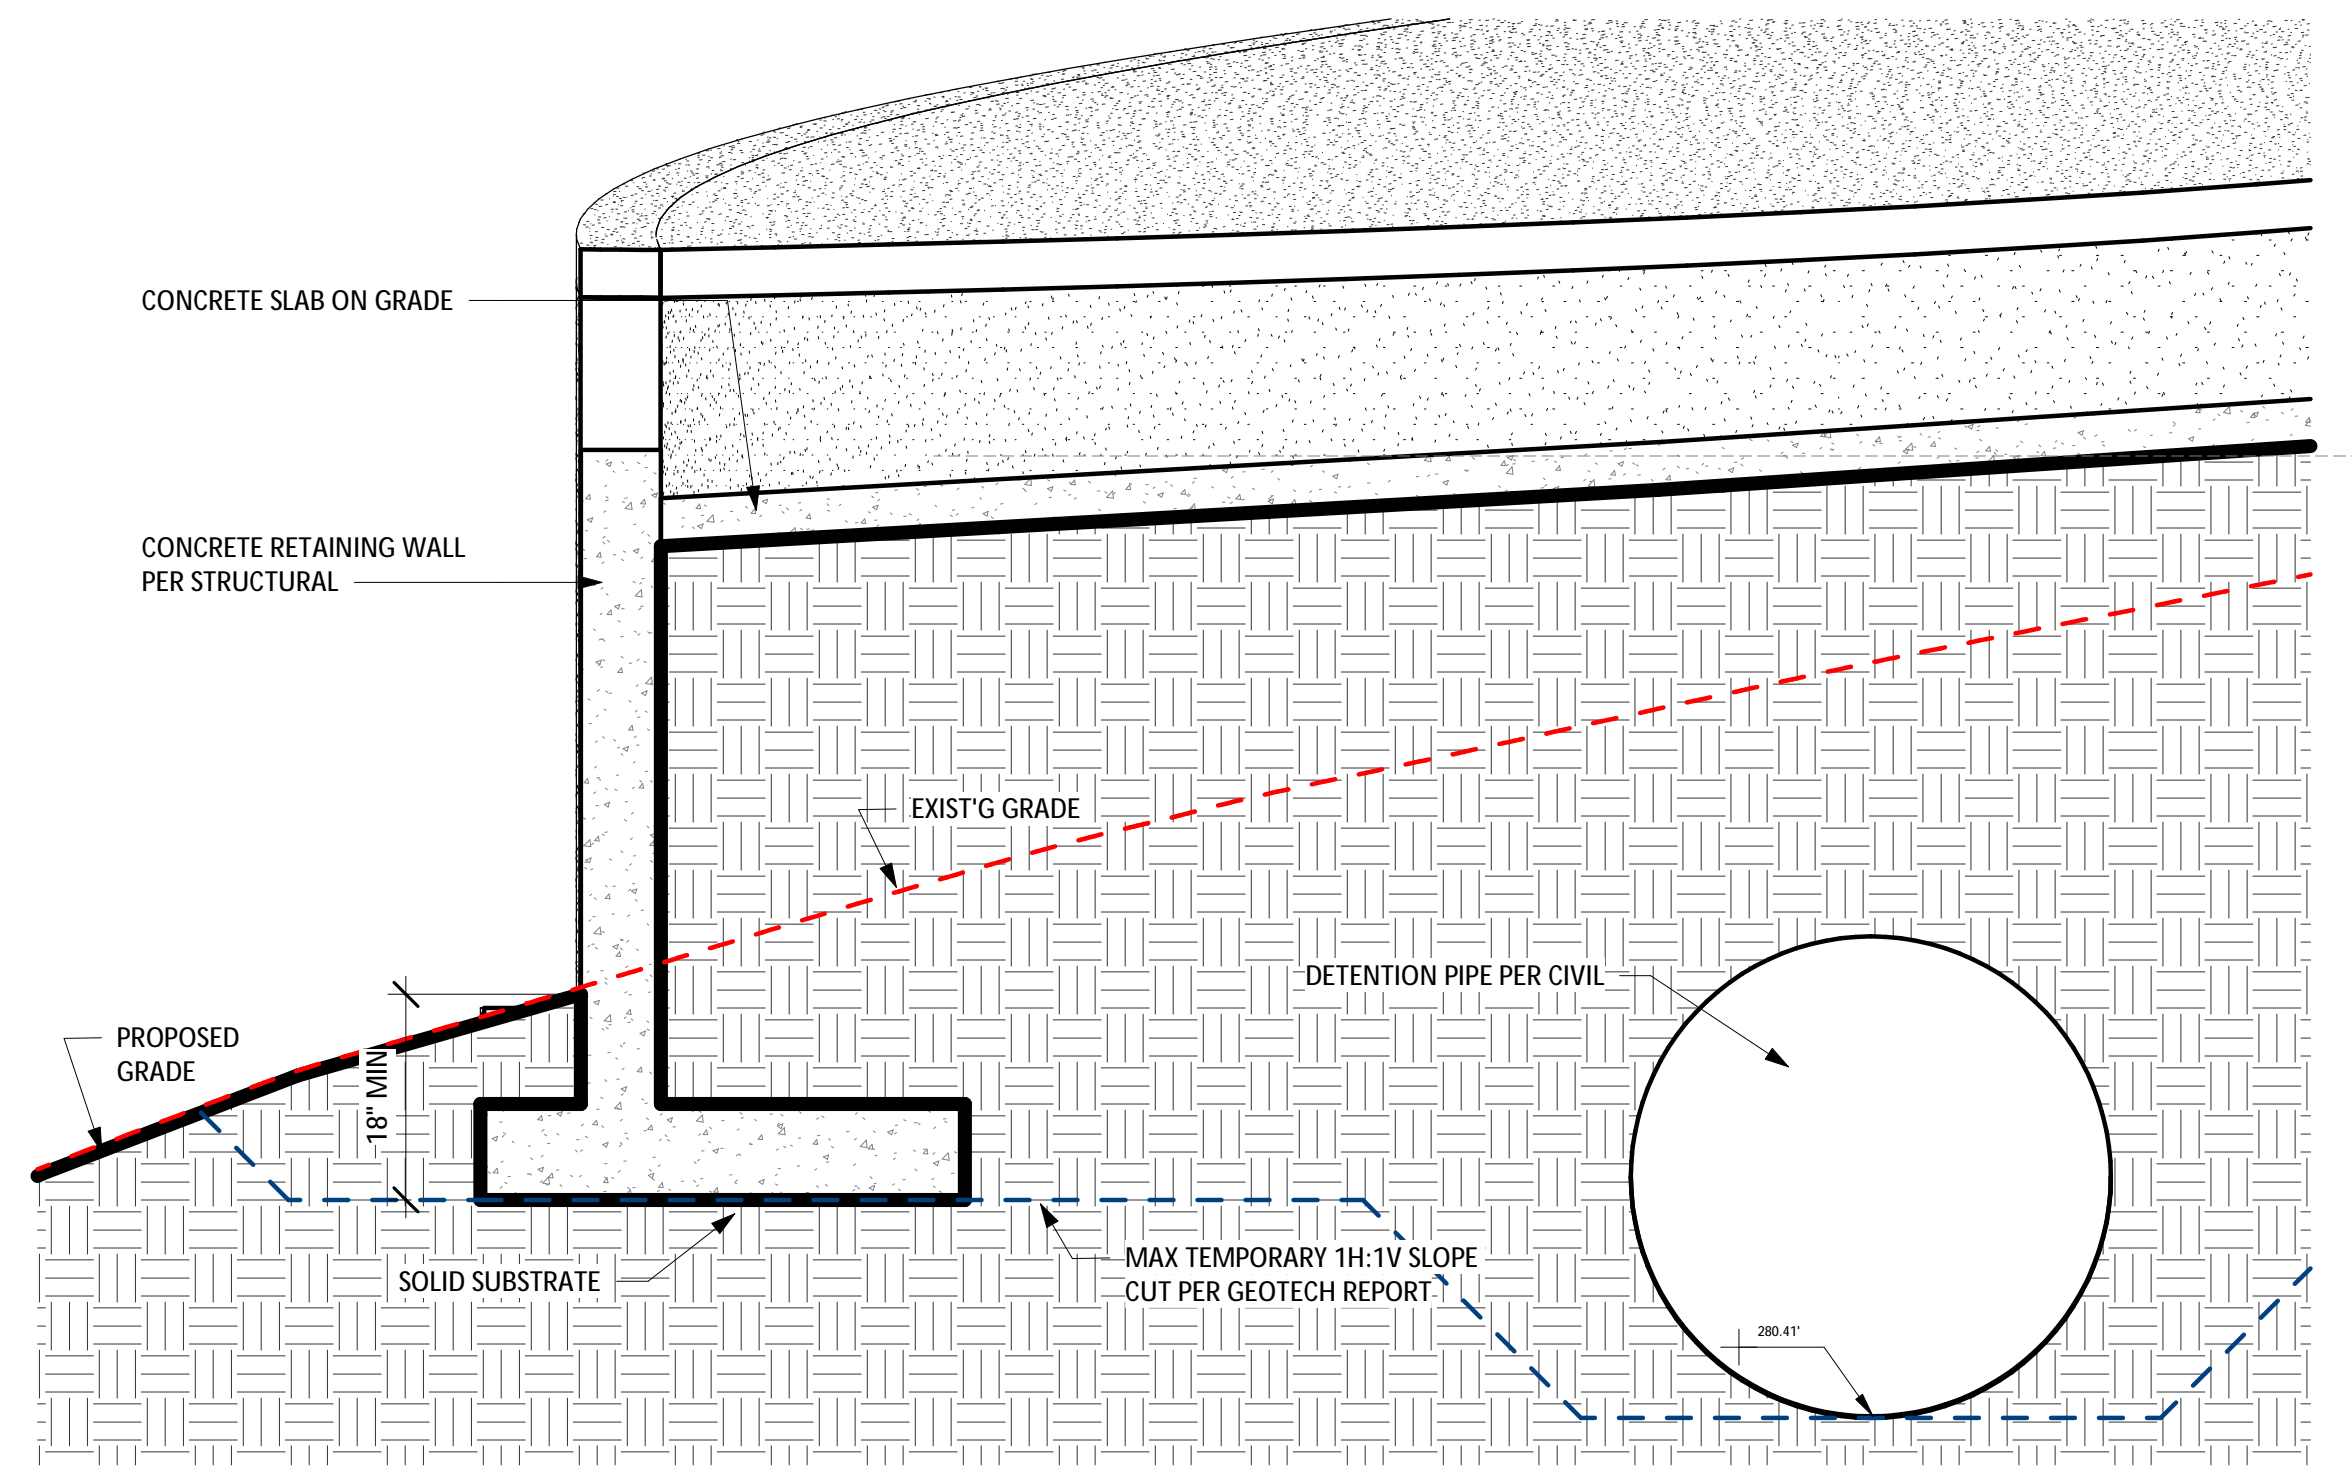

2 DRIVEWAY RETAINING WALL SECTION
SCALE: 1/2" = 1'-0"

WATERCOURSE BUFFER PER PUBLIC GIS MAP
HATCHING INDICATES AREAS OF 40% OR GREATER SLOPES

No.	Date	Description
TBD	TBD	CITY COMMENTS



MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island


PERMIT SET

PROPOSED
GRADING PLAN

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 04/04/23
DRAWN BY: SPM

A104

SCALE 24X36: As indicated
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.



Door Schedule					
TYPE MARK	DOOR STYLE	COMMENTS	SIZE		DOOR PANEL CONSTRUCTION
			WIDTH	HT	
10	Hinged-Double-Exterior-Entrance, InSwing		6'-0"	8'-0"	1 S.C.
20	Hinged-Double-Interior-Panel		3'-6"	6'-8"	1 H.C.
21	Hinged-Double-Interior-Panel		5'-0"	6'-8"	4 H.C.
30	Hinged-Double-Exterior-Panel, InSwing		3'-0"	8'-0"	2 S.C.
40	Hinged-Double-Interior-Panel		2'-4"	8'-0"	7 S.C.
41	Hinged-Double-Interior-Panel		2'-4"	6'-8"	1 H.C.
42	Hinged-Double-Interior-Panel		2'-4"	6'-8"	1 H.C.
43	Hinged-Double-Interior-Panel		2'-6"	8'-0"	1 S.C.
44	Hinged-Double-Interior-Panel		2'-6"	6'-8"	2 H.C.
45	Hinged-Double-Interior-Panel		2'-6"	8'-0"	1 S.C.
46	Hinged-Double-Interior-Panel		2'-8"	6'-8"	1 H.C.
50	Milgard-Sliding-2 Panel	Sliding Door, Two Panels	8'-0"	8'-0"	1 VINYL
60	Milgard-Sliding-4 Panel	Sliding Door, Four Panels	12'-0"	8'-0"	1 VINYL
70	Overhead_Door 2 Panel		8'-0"	8'-0"	1
71	Overhead_Door 4 Panel		16'-0"	8'-0"	1

Grand total: 26

Window Schedule						
Type Mark	STYLE	SIZE		COUNT	DESCRIPTION	IS EGRESS
		WIDTH	HT			
100	Horz Sliding Dbl-Vent	8'-0"	5'-0"	5	Vinyl	Yes
101	Horz Sliding Dbl-Vent	8'-0"	6'-0"	1	Vinyl	Yes
110	Horz Sliding Half-Vent	4'-0"	4'-0"	1	Vinyl	Yes
111	Horz Sliding Half-Vent	5'-0"	3'-6"	1	Vinyl	No
112	Horz Sliding Half-Vent	5'-0"	4'-0"	1	Vinyl	Yes
113	Horz Sliding Half-Vent	5'-0"	5'-0"	1	Vinyl	Yes
120	Picture	2'-6"	1'-0"	1	Vinyl	No
121	Picture	2'-6"	5'-0"	2	Vinyl	No
122	Picture	2'-6"	6'-0"	2	Vinyl	No
123	Picture	3'-0"	1'-6"	4	Vinyl	No
124	Picture	3'-0"	3'-0"	2	Vinyl	No
125	Picture	3'-0"	5'-0"	4	Vinyl	No
126	Picture	4'-0"	1'-0"	1	Vinyl	No
127	Picture	5'-0"	2'-6"	3	Vinyl	No
128	Picture	5'-0"	5'-0"	1	Vinyl	No
129	Picture	5'-0"	6'-0"	4	Vinyl	No
130	Picture	6'-0"	1'-6"	3	Vinyl	No
131	Picture	6'-0"	2'-6"	3	Vinyl	No
132	Picture	6'-0"	5'-0"	1	Vinyl	No
133	Picture	8'-0"	6'-0"	1	Vinyl	No
150	Skylight	4'-0"	4'-0"	1	SKYLIGHT	

Grand total: 43

TYP WINDOW NOTES:

- SEE ARCHITECTURAL FLOOR PLANS FOR WINDOW LOCATIONS AND DESIGNATIONS. SEE ELEVATIONS & BUILDING SECTIONS FOR WINDOW HEAD/SILL LOCATIONS.
- ALL RESIDENTIAL WINDOWS ARE BASED UPON MILGARD VINYL WINDOWS. EXCEPT AS NOTED.
- ALL WINDOWS SHALL HAVE THROUGH-WINDOW AIR INLETS AS PER WASHINGTON STATE VENTILATION CODE.
- NOT USED.
- ALL WINDOWS TO BE FIXED UNLESS SHOWN/NOTED OTHERWISE.
- PROVIDE SAFETY GLAZING PER KEYNOTE P-4 AS LOCATED ON FLOOR PLANS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002

TYP DOOR NOTES:

- ALL RESIDENTIAL SLIDING GLASS DOORS ARE BASED ON MILGARD SERIES VINYL SLIDING DOORS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002.
- PROVIDE SAFETY GLAZING PER GENERAL NOTES.
- NOT USED.
- PROVIDE MIN 0.20 U-VALUE AT SOLID CORE FLUSH DOORS WHERE EXPOSED TO AMBIENT TEMPERATURE.

GENERAL PLAN NOTES:

- SEE SHEET _A001_ FOR GENERAL CONSTRUCTION SPECIFICATIONS.
- SEE BUILDING ELEVATIONS FOR WINDOW OPERATION.
- SEE "TYPICAL BUILDING MATERIALS" LIST ON THE ELEVATION SHEETS(S).
- FOR THE SYMBOLS & LEGEND SEE SHEET _A000_.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLD-DOWNS AND SHEET _S100_ FOR SHEARWALL DETAILS/ SCHEDULE.

KEYNOTES - FLOORPLAN



ID	DESCRIPTION
P-1	GARAGE/HOUSE OCCUPANCY SEPARATION. PER IRC R302.6 a) 1/2" GYP. AT GARAGE SIDE BETWEEN RESIDENCE AND ATTIC. b) 5/8" TYPE 'X' GYP IS REQUIRED WHERE THERE IS LIVING SPACE ABOVE. c) 1/2" GYP AT SUPPORTING COLUMNS, WALLS AND BEAMS ABOVE."
P-2	DOOR BETWEEN GARAGE AND HOUSE SHALL BE EQUIPPED WITH A SELF-CLOSING DEVICE, AND BE A MIN 1 3/8" THICK SOLID WOOD DOOR OR 20 MIN. F.R. DOOR. PER IRC SECTION R302.5.1
P-3	STAIR ASSEMBLY: PER IRC SECTION R311.7.1 a) WIDTH 36" MIN.; HEADROOM 6'-8" MIN. b) RISER 7-3/4" MAX.; TREAD 10" MIN. c) TOP OF HANDRAIL AT 34" MIN. AND 38" MAX ABOVE TREAD NOSING d) HANDRAIL WIDTH 1-1/4" MIN. AND 2" MAX. e) INSTALL FIRE BLOCKING IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. f) COVER USABLE SPACE UNDER STAIR WITH 1/2" GYP."
P-4	SAFETY GLAZING PER IRC SECTION R308.4
P-5	EGRESS WINDOW PER IRC SECTION R310. PROVIDE MIN NET CLEARANCE OF 5 SF AT GRADE FLOOR OPENINGS AND 5.7 SF ABOVE. MIN SILL HEIGHT TO BE 44" A.F.F.
P-6	IGNITERS: A) FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN ABOVE TOP OF SLAB, PROVIDE (2) LAYERS OF FLOOR SHEATHING OVER FRAMING. PER IRC SECTION G2408. B) HEAT-PRODUCING EQUIPMENT AND APPLIANCES SHALL BE INSTALLED TO MAINTAIN THE REQUIRED CLEARANCES TO COMBUSTIBLE CONSTRUCTION AS SPECIFIED IN THE LISTING AND MANUFACTURER'S INSTRUCTIONS. PER IRC G2408.5
P-7	COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NONABSORBENT MATERIAL TO 72" ABOVE DRAIN INLETS. PER IRC SECTION R307.2. FOR GROUND FLR WASTE OPENING REQ SEE UPC NOTES ON SHT A001
P-8	HIGH EFFICIENCY GAS FURNACE. SIZE PER WSEC PRESCRIPTIVE ENERGY CODE COMPLIANCE FORMS. a) PROVIDE DUCT LEAKAGE, SEALING & TESTING PER WSEC 502 & 503. b) THERMOSTAT PER WSEC 503.8. c) SEE WSEC NOTES ON SHEET A001
P-9	7-3/4" MAX. RISER WITH 10" MIN. TREAD DEPTH. IF MORE THAN (4) RISERS HANDRAIL REQUIRED PER IRC SECTION R311.7.1. a) PROVIDE 36"x36" MIN. LANDING AT EXTERIOR DOORS PER IRC SECTION R311.3
P-10	PROVIDE CRAWL SPACE ACCESS, MIN. 18" X 24" UNOBSTRUCTED ACCESS. PER IRC SECTION R408.4
P-11	PROVIDE ATTIC ACCESS, MIN. 22" X 30" WITH 30" MIN. HEADROOM AT UNOBSTRUCTED READILY ACCESSIBLE OPENING. PER IRC SECTION R807.1
P-13	FIREPLACE ASSEMBLY. PER IRC CHAPTER 10. a) FACTORY-BUILT FIREPLACES TO BE INSTALLED PER MFR. PER IRC SECTION R1004. b) INSTALL MASONRY FIREPLACES PER IRC SECTION R1003. c) HEARTH SHALL CONFORM TO IRC REQUIREMENTS.
P-15	36" MIN. GUARDRAIL. AT STAIRS SLOPES AT 36" ABOVE STAIR NOSINGS. PER SEE IRC SECTION 312
P-16	8" VENT FOR MECHANICAL. 1" CLEARANCE ALL SIDES.
P-17	2x6 WALL FOR PLUMBING / HVAC.
P-18	A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL. SEE WSEC SECTION 105 ON SHEET A001
P-19	3" DIA GALV BOLLARD OR EQ PER G2408.3 & M1307.3.1

KEYNOTES - FOUNDATION

ID	DESCRIPTION
FP-3	CONCRETE SLAB ON GRADE SHALL BE 4" THICK STEEL TROWLED FINISH W/ W1.4xW1.4 WWF ON 4" GRANULAR FILL. SLOPE TO AND PROVIDE THICKENED EDGE AT O.H. GAR DOOR. PER IRC SECTION R506
FP-4	14"x8" CRAWL SPACE VENT INSTALLED IN RIM JOIST. SEE CRAWL SPACE CALCULATIONS THIS SHEET.
FP-5	CRIPPLE WALL w/ 2x6 OR 3x4 STUDS @ 16" O.C. U.N.O. PER IRC SECTION R602.9.
FP-8	6 MIL BLACK POLYETHYLENE GROUND COVER OR APPROVED EQ. OVERLAP EDGES 12" MIN AT JOINTS AND EXTEND UP FOUNDATION WALL. PER WSEC 502.1.6.7.
FP-12	MAT FOOTING PER FTG STRUCTURAL. SEE DETAILS FOR ADDITIONAL INFORMATION.
FP-16	EXTEND PIER MIN. 18" BELOW SURROUNDING GRADE. PER IRC TABLE R301.2.

AREA SCHEDULE - GROSS

NAME	AREA
Foyer	119 SF
Lower Entry	122 SF
Lower Stairs	67 SF
Main Floor	1490 SF
Main Floor (+20ft Clg)	138 SF
Main Stairs	109 SF
Upper Floor	1469 SF
	3514 SF
Garage	671 SF
	4185 SF

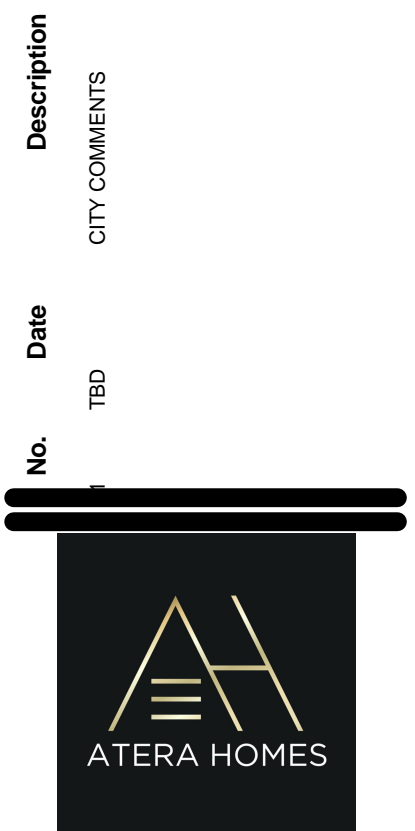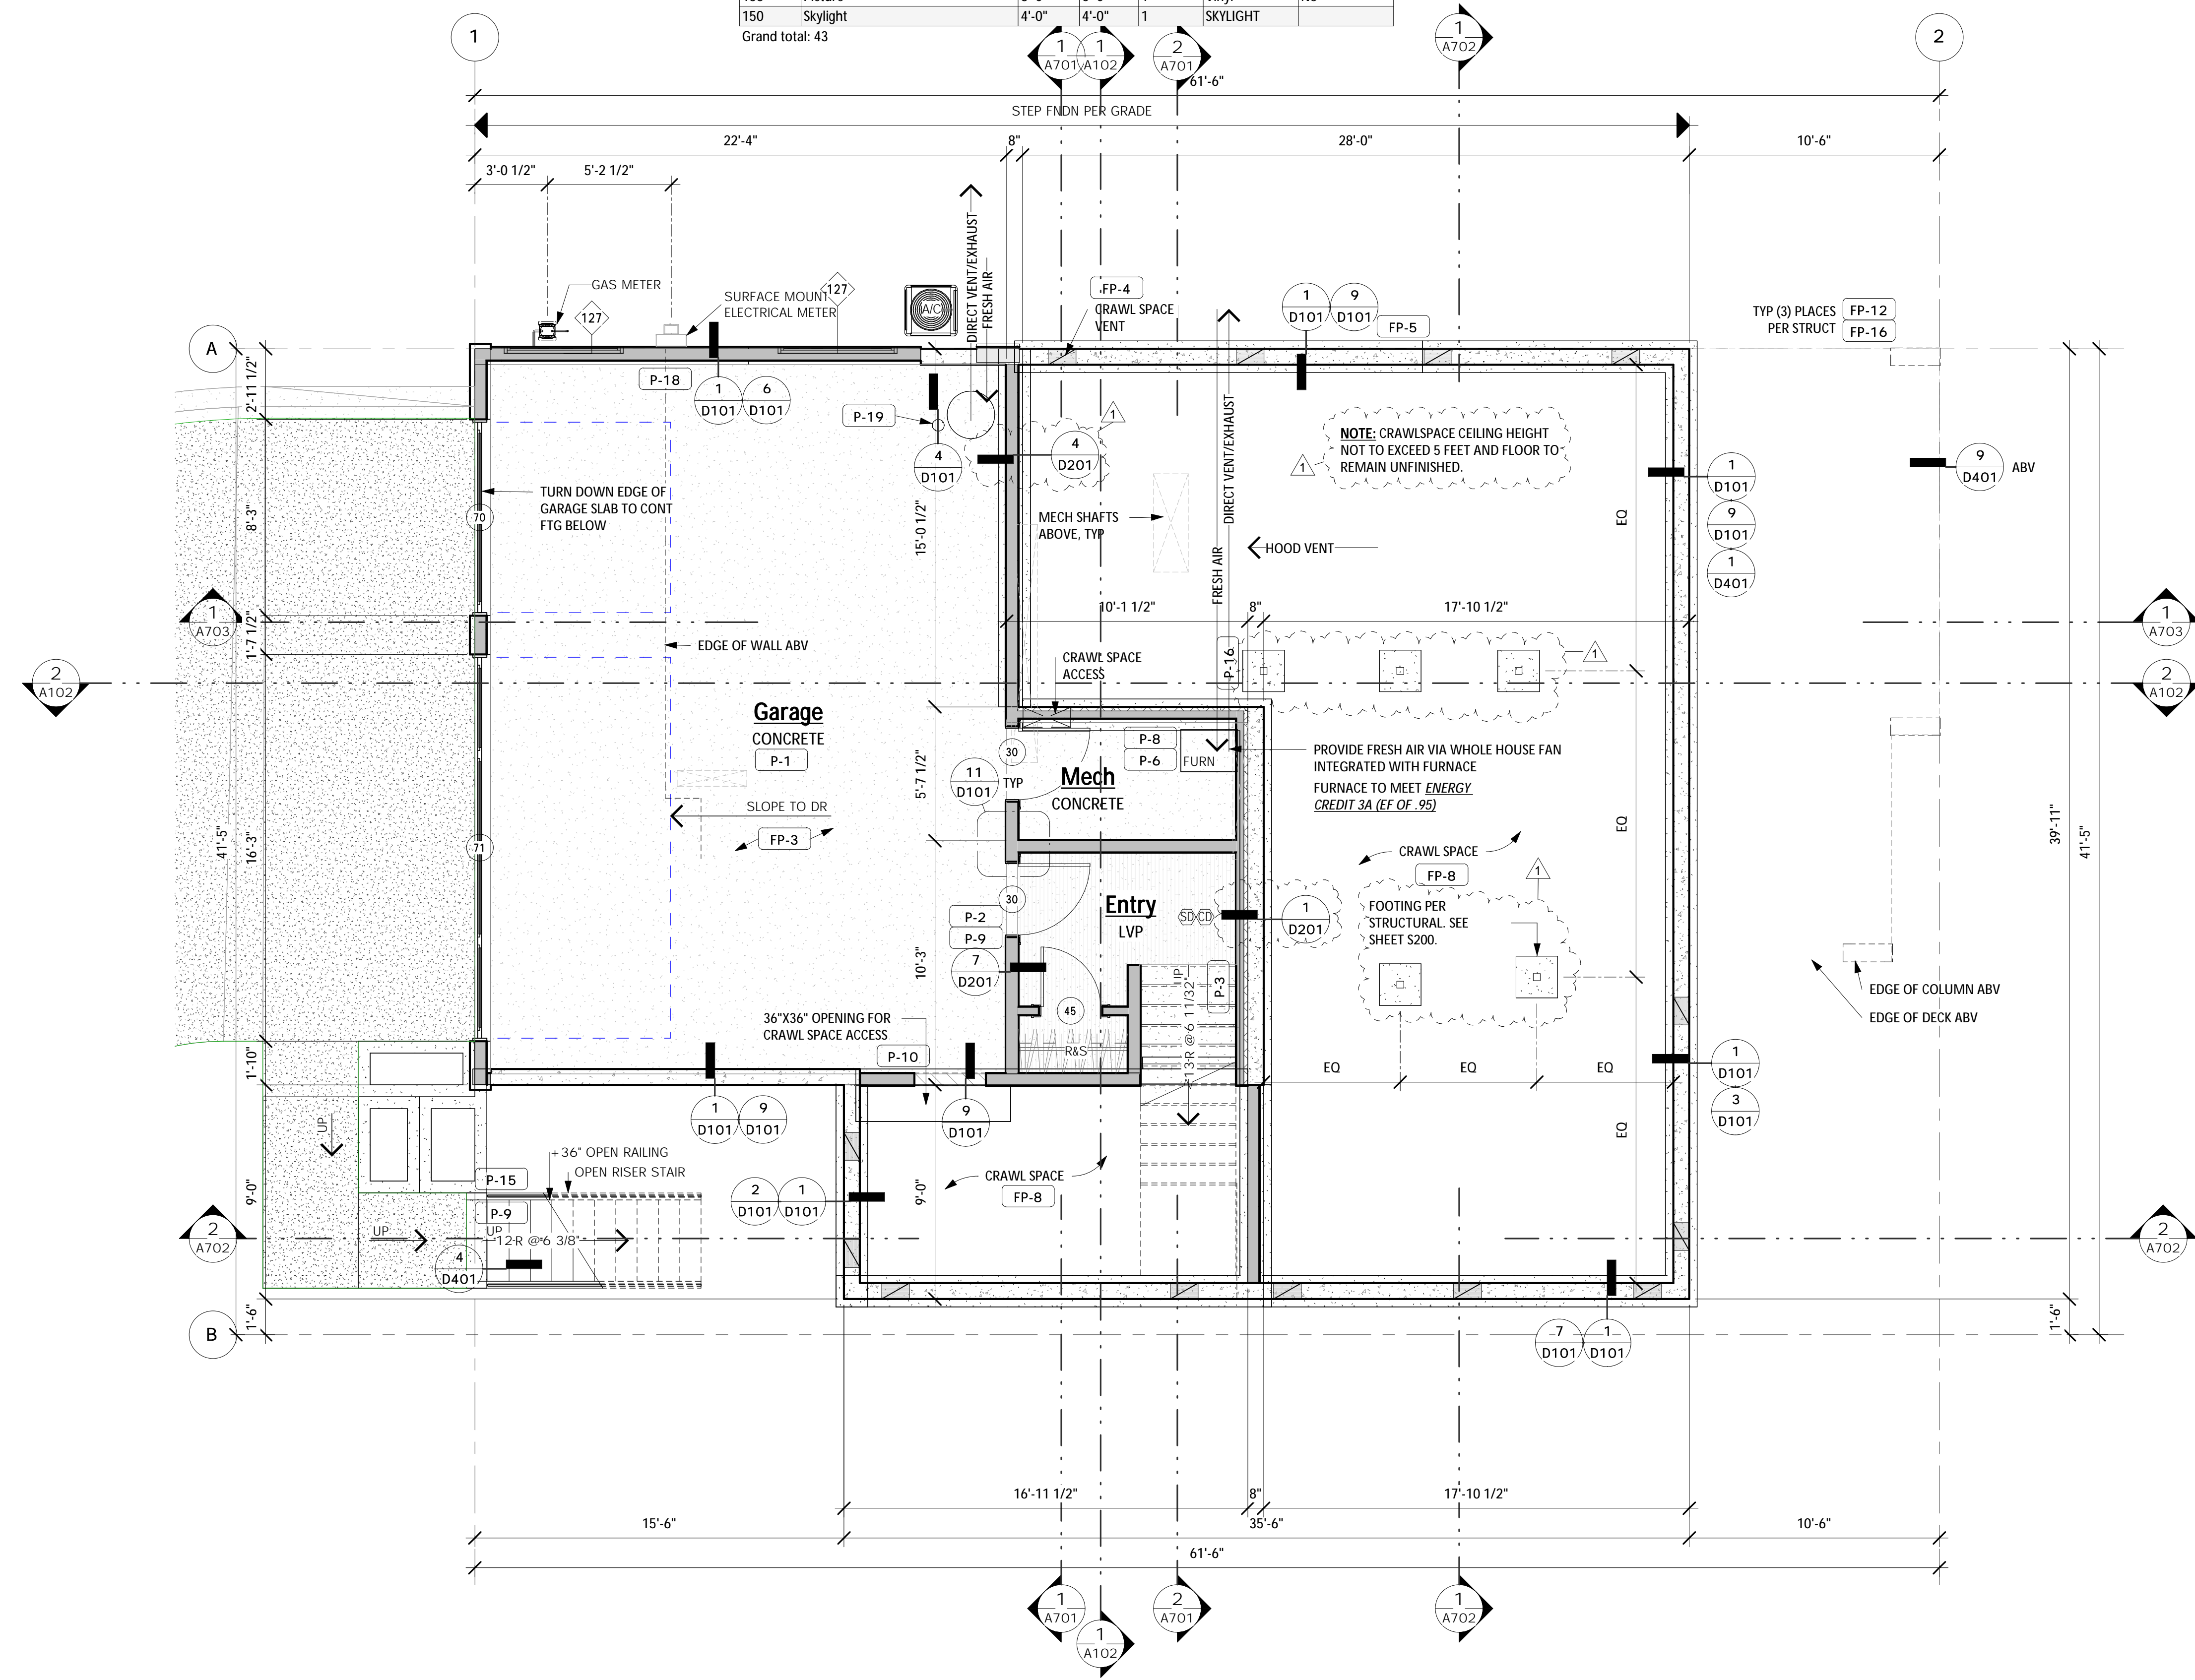

MONSEF DESIGN STUDIO
 451 DUVAL AVE NE, RENTON, WA 98059
 206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
 5024 W Mercer Way, Mercer Island

PERMIT SET
 LOWER FLOOR

PROJECT NO: 20008
 ISSUE DATE: 2023/08/01
 SHT ISSUE DATE: 2021/01/08
 DRAWN BY: SPM
A201
 SCALE 24X36: 1/4" = 1'-0"
 * NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

Door Schedule					
TYPE MARK	DOOR STYLE	COMMENTS	SIZE		DOOR PANEL CONSTRUCTION
			WIDTH	HT	
10	Hinged-Double-Exterior-Entrance, InSwing		6'-0"	8'-0"	1 S.C.
20	Hinged-Double-Interior-Panel		3'-6"	6'-8"	1 H.C.
21	Hinged-Double-Interior-Panel		5'-0"	6'-8"	4 H.C.
30	Hinged-Single-Exterior-Panel, InSwing		3'-0"	8'-0"	2 S.C.
40	Hinged-Single-Interior-Panel		2'-4"	8'-0"	7 S.C.
41	Hinged-Single-Interior-Panel		2'-4"	6'-8"	1 H.C.
42	Hinged-Single-Interior-Panel		2'-4"	6'-8"	1 H.C.
43	Hinged-Single-Interior-Panel		2'-6"	8'-0"	1 S.C.
44	Hinged-Single-Interior-Panel		2'-6"	6'-8"	2 H.C.
45	Hinged-Single-Interior-Panel		2'-6"	8'-0"	1 S.C.
46	Hinged-Single-Interior-Panel		2'-8"	6'-8"	1 H.C.
50	Milgard-Sliding-2 Panel	Sliding Door, Two Panels	8'-0"	8'-0"	1 VINYL
60	Milgard-Sliding-4 Panel	Sliding Door, Four Panels	12'-0"	8'-0"	1 VINYL
70	Overhead_Door 2 Panel		8'-0"	8'-0"	1
71	Overhead_Door 4 Panel		16'-0"	8'-0"	1
Grand total: 26					

Window Schedule						
Type Mark	STYLE	SIZE		COUNT	DESCRIPTION	IS EGRESS
		WIDTH	HT			
100	Horz Sliding Dbl-Vent	8'-0"	5'-0"	5	Vinyl	Yes
101	Horz Sliding Dbl-Vent	8'-0"	6'-0"	1	Vinyl	Yes
110	Horz Sliding Half-Vent	4'-0"	4'-0"	1	Vinyl	Yes
111	Horz Sliding Half-Vent	5'-0"	3'-6"	1	Vinyl	No
112	Horz Sliding Half-Vent	5'-0"	4'-0"	1	Vinyl	Yes
113	Horz Sliding Half-Vent	5'-0"	5'-0"	1	Vinyl	Yes
120	Picture	2'-6"	1'-0"	1	Vinyl	No
121	Picture	2'-6"	5'-0"	2	Vinyl	No
122	Picture	2'-6"	6'-0"	2	Vinyl	No
123	Picture	3'-0"	1'-6"	4	Vinyl	No
124	Picture	3'-0"	3'-0"	2	Vinyl	No
125	Picture	3'-0"	5'-0"	4	Vinyl	No
126	Picture	4'-0"	1'-0"	1	Vinyl	No
127	Picture	5'-0"	2'-6"	3	Vinyl	No
128	Picture	5'-0"	5'-0"	1	Vinyl	No
129	Picture	5'-0"	6'-0"	4	Vinyl	No
130	Picture	6'-0"	1'-6"	3	Vinyl	No
131	Picture	6'-0"	2'-6"	3	Vinyl	No
132	Picture	6'-0"	5'-0"	1	Vinyl	No
133	Picture	8'-0"	6'-0"	1	Vinyl	No
150	Skylight	4'-0"	4'-0"	1	SKYLIGHT	
Grand total: 43						

TYP WINDOW NOTES:

- SEE ARCHITECTURAL FLOOR PLANS FOR WINDOW LOCATIONS AND DESIGNATIONS. SEE ELEVATIONS & BUILDING SECTIONS FOR WINDOW HEAD/SILL LOCATIONS.
- ALL RESIDENTIAL WINDOWS ARE BASED UPON MILGARD VINYL WINDOWS. EXCEPT AS NOTED.
- ALL WINDOWS SHALL HAVE THROUGH-WINDOW AIR INLETS AS PER WASHINGTON STATE VENTILATION CODE.
- NOT USED.
- ALL WINDOWS TO BE FIXED UNLESS SHOWN/NOTED OTHERWISE.
- PROVIDE SAFETY GLAZING PER KEYNOTE P-4 AS LOCATED ON FLOOR PLANS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002

TYP DOOR NOTES:



- ALL RESIDENTIAL SLIDING GLASS DOORS ARE BASED ON MILGARD SERIES VINYL SLIDING DOORS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002.
- PROVIDE SAFETY GLAZING PER GENERAL NOTES.
- NOT USED.
- PROVIDE MIN 0.20 U-VALUE AT SOLID CORE FLUSH DOORS WHERE EXPOSED TO AMBIENT TEMPERATURE.

GENERAL PLAN NOTES:

- SEE SHEET _A001_ FOR GENERAL CONSTRUCTION SPECIFICATIONS.
- SEE BUILDING ELEVATIONS FOR WINDOW OPERATION.
- SEE "TYPICAL BUILDING MATERIALS" LIST ON THE ELEVATION SHEET(S).
- FOR THE SYMBOLS & LEGEND SEE SHEET _A000_.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLDDOWNS AND SHEET _S100_ FOR SHEARWALL DETAILS/ SCHEDULE.

KEYNOTES - FLOORPLAN

ID	DESCRIPTION
P-1	GARAGE/HOUSE OCCUPANCY SEPARATION. PER IRC R302.6 a) 1/2" GYP. AT GARAGE SIDE BETWEEN RESIDENCE AND ATTIC. b) 5/8" TYPE 'X' GYP IS REQUIRED WHERE THERE IS LIVING SPACE ABOVE. c) 1/2" GYP. AT SUPPORTING COLUMNS, WALLS AND BEAMS ABOVE."
P-2	DOOR BETWEEN GARAGE AND HOUSE SHALL BE EQUIPPED WITH A SELF-CLOSING DEVICE, AND BE A MIN 1 3/8" THICK SOLID WOOD DOOR OR 20 MIN. F.R. DOOR. PER IRC SECTION R302.5.1
P-3	STAIR ASSEMBLY. PER IRC SECTION R311.7.1 a) WIDTH 36" MIN. HEADROOM 6'-8" MIN. b) RISER 7-3/4" MAX.; TREAD 10" MIN. c) TOP OF HANDRAIL AT 34" MIN. AND 38" MAX ABOVE TREAD NOSING d) HANDRAIL WIDTH 1-1/4" MIN. AND 2" MAX. e) INSTALL FIRE BLOCKING IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. f) COVER USABLE SPACE UNDER STAIR WITH 1/2" GYP."
P-4	SAFETY GLAZING PER IRC SECTION R308.4
P-5	EGRESS WINDOW PER IRC SECTION R310. PROVIDE MIN NET CLEARANCE OF 5 SF AT GRADE FLOOR OPENINGS AND 5.7 SF ABOVE. MIN SILL HEIGHT TO BE 44" A.F.F.
P-6	IGNITERS: a) FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN ABOVE TOP OF SLAB. PROVIDE (2) LAYERS OF FLOOR SHEATHING OVER FRAMING. PER IRC SECTION G2408. b) HEAT-PRODUCING EQUIPMENT AND APPLIANCES SHALL BE INSTALLED TO MAINTAIN THE REQUIRED CLEARANCES TO COMBUSTIBLE CONSTRUCTION AS SPECIFIED IN THE LISTING AND MANUFACTURER'S INSTRUCTIONS. PER IRC G2408.5
P-7	COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NONABSORBENT MATERIAL TO 72" ABOVE DRAIN INLETS. PER IRC SECTION R307.2. FOR GROUND FLR WASTE OPENING REQ SEE UPC NOTES ON SHT A001
P-8	HIGH EFFICIENCY GAS FURNACE. SIZE PER WSEC PRESCRIPTIVE ENERGY CODE COMPLIANCE FORMS. a) PROVIDE DUCT LEAKAGE, SEALING & TESTING PER WSEC 502 & 503. b) THERMOSTAT PER WSEC 503.8. c) SEE WSEC NOTES ON SHEET A001
P-9	7-3/4" MAX. RISER WITH 10" MIN. TREAD DEPTH. IF MORE THAN (4) RISERS HANDRAIL REQUIRED PER IRC SECTION R311.7.7. a) PROVIDE 36"x36" MIN. LANDING AT EXTERIOR DOORS PER IRC SECTION R311.3
P-10	PROVIDE CRAWL SPACE ACCESS, MIN. 18" X 24" UNOBSTRUCTED ACCESS. PER IRC SECTION R408.4
P-11	PROVIDE ATTIC ACCESS, MIN. 22" X 30" WITH 30" MIN. HEADROOM AT UNOBSTRUCTED READILY ACCESSIBLE OPENING. PER IRC SECTION R807.1
P-13	FIREPLACE ASSEMBLY. PER IRC CHAPTER 10. a) FACTORY-BUILT FIREPLACES TO BE INSTALLED PER MFR. PER IRC SECTION R1004. b) INSTALL MASONRY FIREPLACES PER IRC SECTION R1003. c) HEARTH SHALL CONFORM TO IRC REQUIREMENTS.
P-15	36" MIN. GUARDRAIL. AT STAIRS SLOPES AT 36" ABOVE STAIR NOSINGS. PER SEE IRC SECTION 312
P-16	B' VENT FOR MECHANICAL. 1" CLEARANCE ALL SIDES.
P-17	2x6 WALL FOR PLUMBING / HVAC.
P-18	A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL. SEE WSEC SECTION 105 ON SHEET A001
P-19	3" DIA GALV BOLLARD OR EQ PER G2408.3 & M1307.3.1

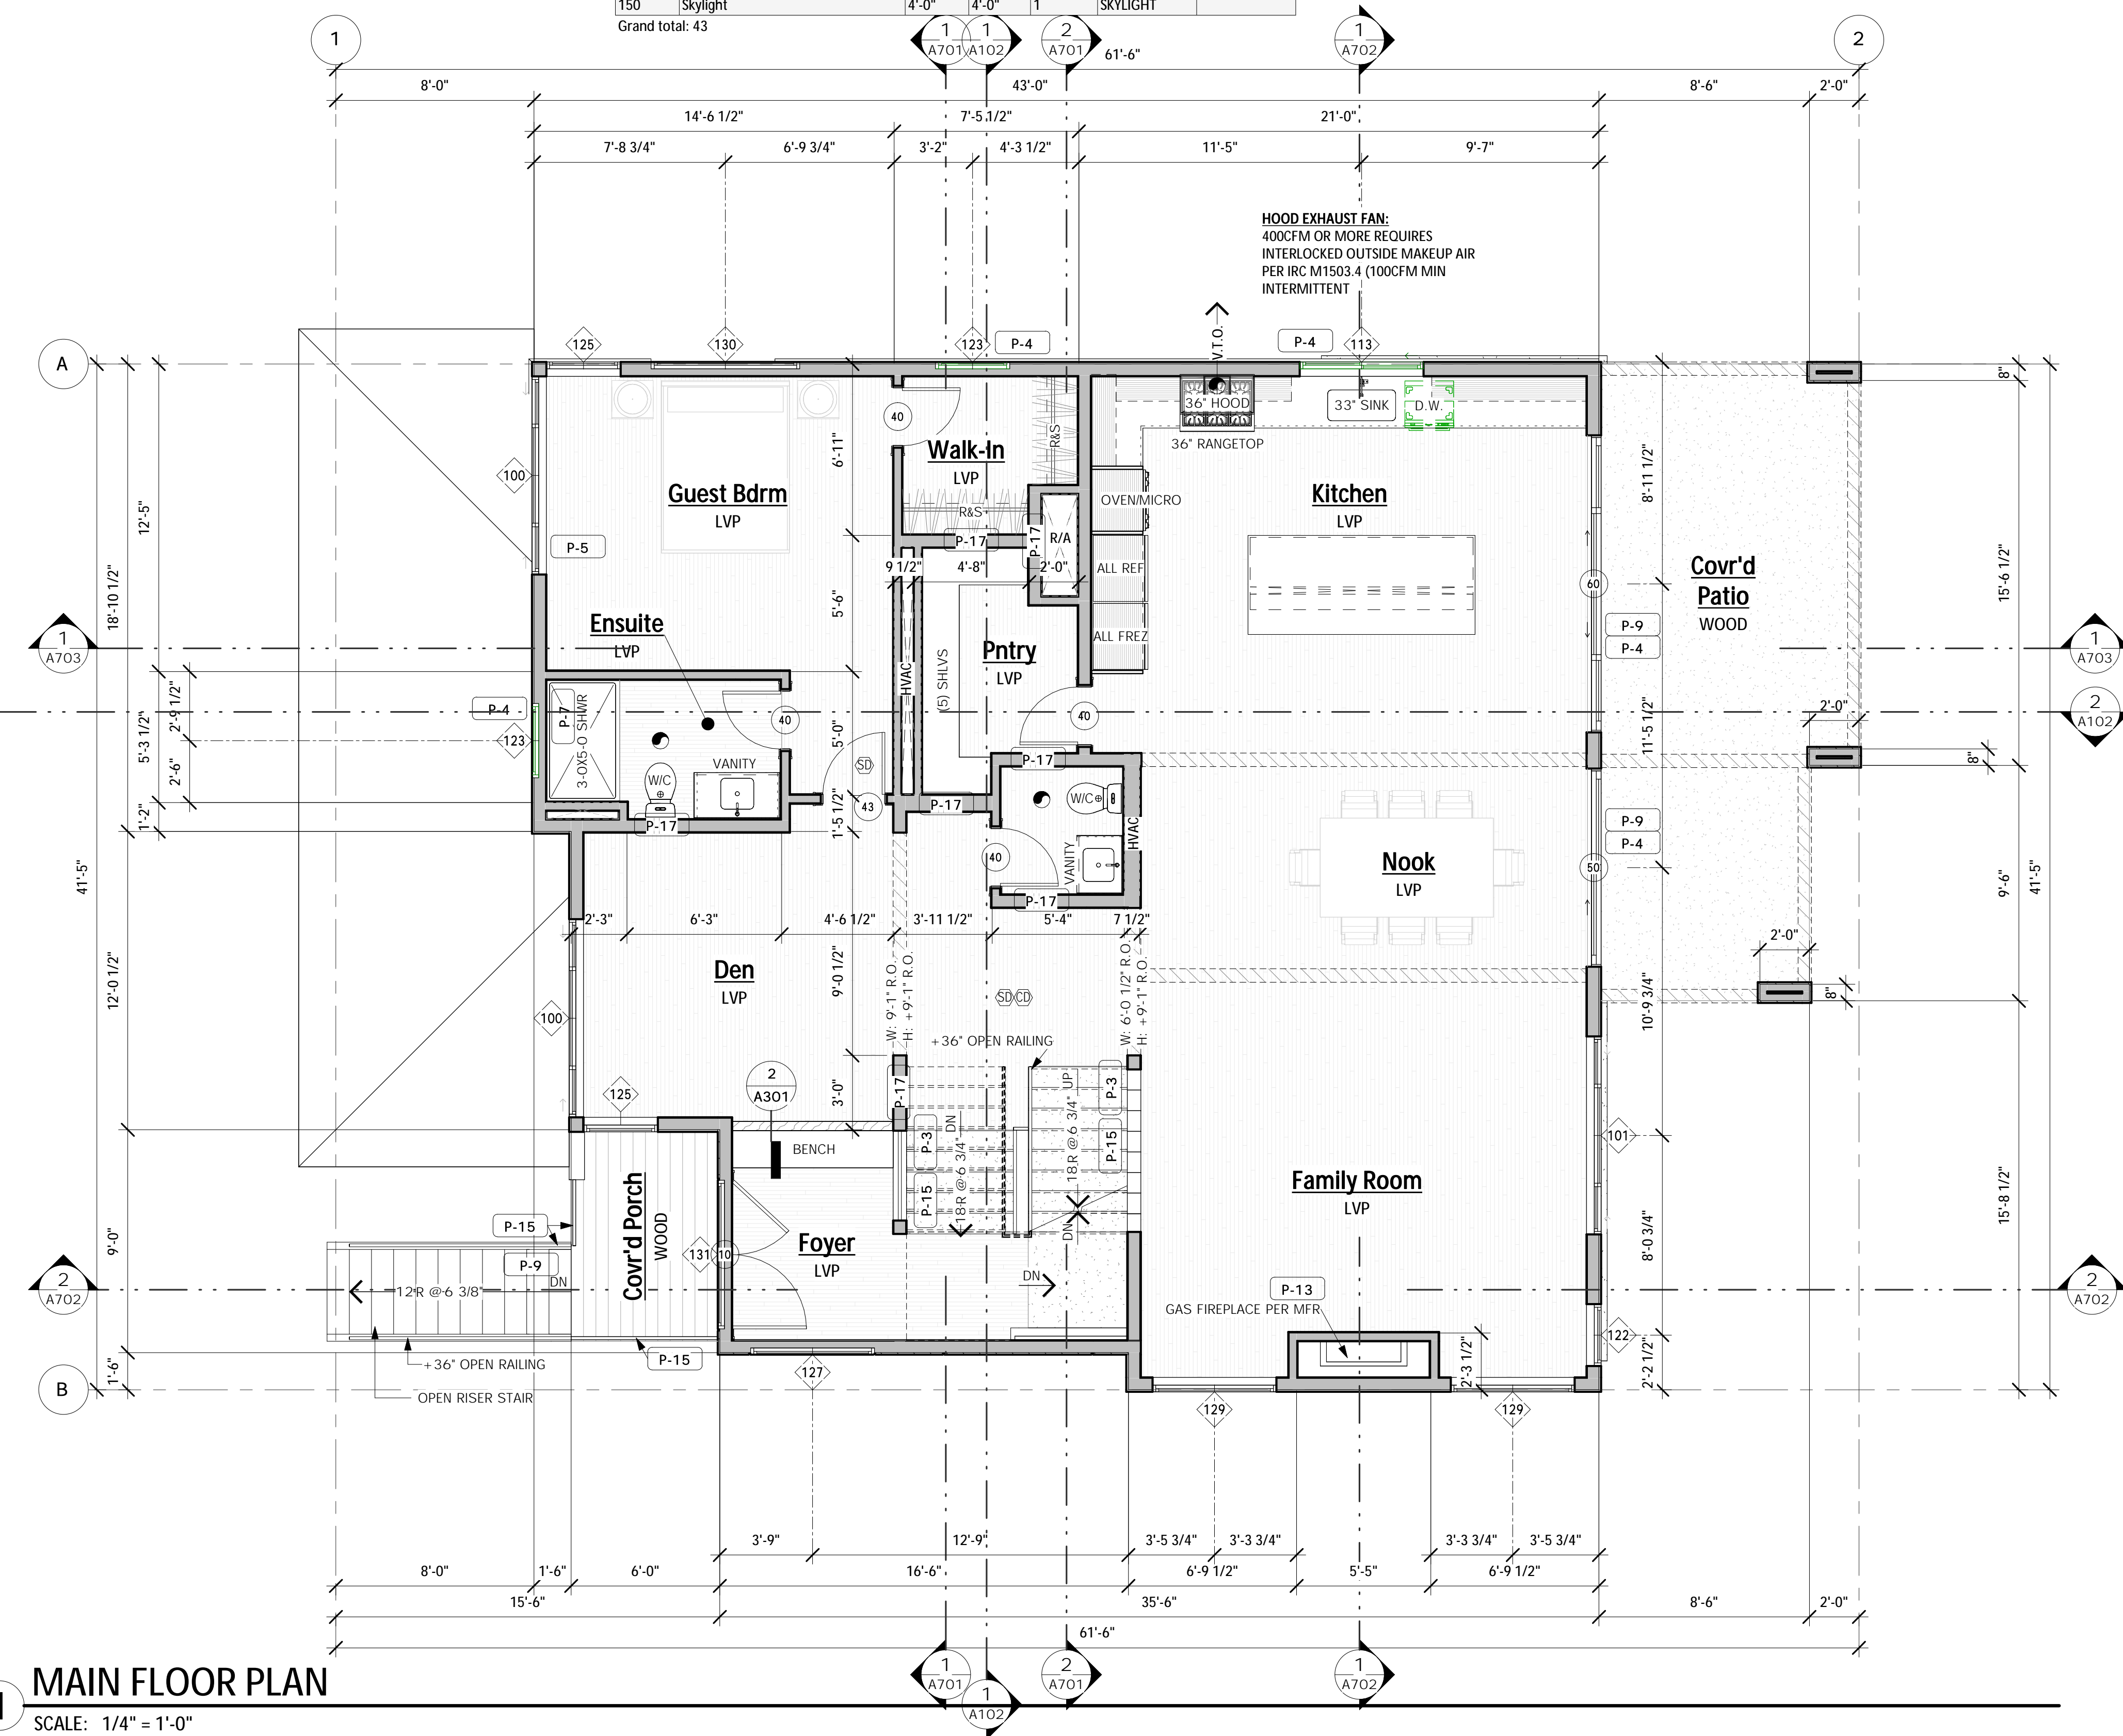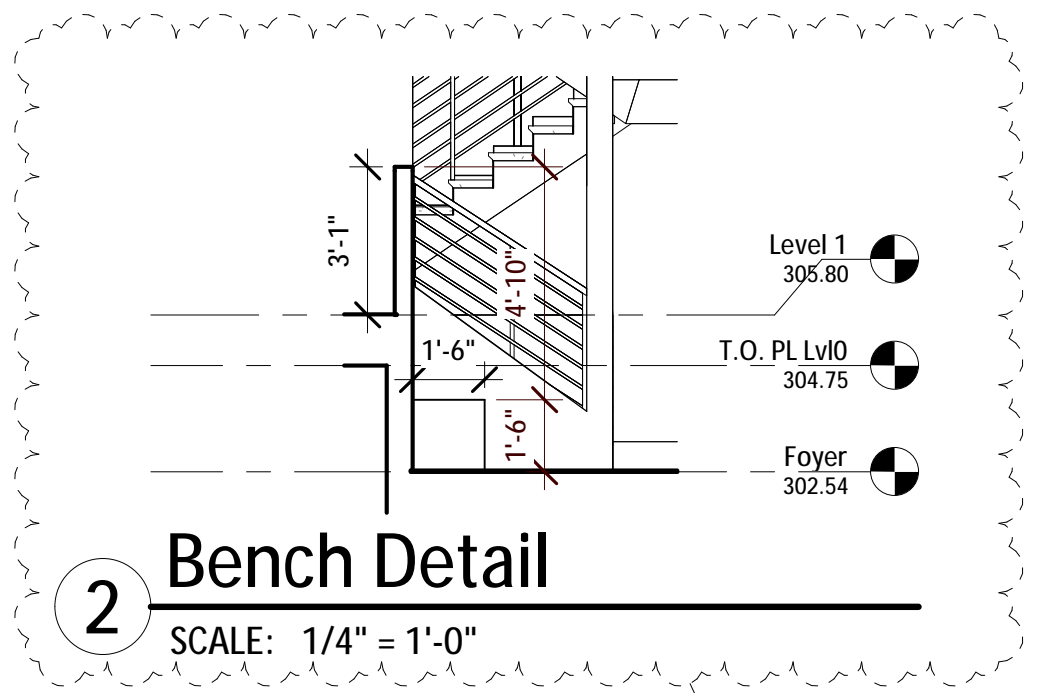

1 MAIN FLOOR PLAN
SCALE: 1/4" = 1'-0"

AREA SCHEDULE - GROSS	
NAME	AREA
Foyer	119 SF
Lower Entry	122 SF
Lower Stairs	67 SF
Main Floor	1490 SF
Main Floor (+20ft Clg)	138 SF
Main Stairs	109 SF
Upper Floor	1469 SF
	3514 SF
Garage	671 SF
	671 SF
	4185 SF

Description
CITY COMMENTS

Date
TBD

No.

ATERA HOMES

MONSEF DESIGN
STUDIO

451 DUVALL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET

MAIN FLOOR

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM

A301

SCALE 24X36: 1/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

Door Schedule					
TYPE MARK	DOOR STYLE	COMMENTS	SIZE		DOOR PANEL CONSTRUCTION
			WIDTH	HT	
10	Hinged-Double-Exterior-Entrance, InSwing		6'-0"	8'-0"	1 S.C.
20	Hinged-Double-Interior-Panel		3'-6"	6'-8"	1 H.C.
21	Hinged-Double-Interior-Panel		5'-0"	6'-8"	4 H.C.
30	Hinged-Single-Exterior-Panel, InSwing		3'-0"	8'-0"	2 S.C.
40	Hinged-Single-Interior-Panel		2'-4"	8'-0"	7 S.C.
41	Hinged-Single-Interior-Panel		2'-4"	6'-8"	1 H.C.
42	Hinged-Single-Interior-Panel		2'-4"	6'-8"	1 H.C.
43	Hinged-Single-Interior-Panel		2'-6"	8'-0"	1 S.C.
44	Hinged-Single-Interior-Panel		2'-6"	6'-8"	2 H.C.
45	Hinged-Single-Interior-Panel		2'-6"	8'-0"	1 S.C.
46	Hinged-Single-Interior-Panel		2'-8"	6'-8"	1 H.C.
50	Milgard-Sliding-2 Panel	Sliding Door, Two Panels	8'-0"	8'-0"	1 VINYL
60	Milgard-Sliding-4 Panel	Sliding Door, Four Panels	12'-0"	8'-0"	1 VINYL
70	Overhead_Door 2 Panel		8'-0"	8'-0"	1
71	Overhead_Door 4 Panel		16'-0"	8'-0"	1
Grand total: 26					

Window Schedule						
Type Mark	STYLE	SIZE		COUNT	DESCRIPTION	IS EGRESS
		WIDTH	HT			
100	Horz Sliding Dbl-Vent	8'-0"	5'-0"	5	Vinyl	Yes
101	Horz Sliding Dbl-Vent	8'-0"	6'-0"	1	Vinyl	Yes
110	Horz Sliding Half-Vent	4'-0"	4'-0"	1	Vinyl	Yes
111	Horz Sliding Half-Vent	5'-0"	3'-6"	1	Vinyl	No
112	Horz Sliding Half-Vent	5'-0"	4'-0"	1	Vinyl	Yes
113	Horz Sliding Half-Vent	5'-0"	5'-0"	1	Vinyl	Yes
120	Picture	2'-6"	1'-0"	1	Vinyl	No
121	Picture	2'-6"	5'-0"	2	Vinyl	No
122	Picture	2'-6"	6'-0"	2	Vinyl	No
123	Picture	3'-0"	1'-6"	4	Vinyl	No
124	Picture	3'-0"	3'-0"	2	Vinyl	No
125	Picture	3'-0"	5'-0"	4	Vinyl	No
126	Picture	4'-0"	1'-0"	1	Vinyl	No
127	Picture	5'-0"	2'-6"	3	Vinyl	No
128	Picture	5'-0"	5'-0"	1	Vinyl	No
129	Picture	5'-0"	6'-0"	4	Vinyl	No
130	Picture	6'-0"	1'-6"	3	Vinyl	No
131	Picture	6'-0"	2'-6"	3	Vinyl	No
132	Picture	6'-0"	5'-0"	1	Vinyl	No
133	Picture	8'-0"	6'-0"	1	Vinyl	No
150	Skylight	4'-0"	4'-0"	1	SKYLIGHT	
Grand total: 43						

TYP WINDOW NOTES:

- SEE ARCHITECTURAL FLOOR PLANS FOR WINDOW LOCATIONS AND DESIGNATIONS. SEE ELEVATIONS & BUILDING SECTIONS FOR WINDOW HEAD/SILL LOCATIONS.
- ALL RESIDENTIAL WINDOWS ARE BASED UPON MILGARD VINYL WINDOWS. EXCEPT AS NOTED.
- ALL WINDOWS SHALL HAVE THROUGH-WINDOW AIR INLETS AS PER WASHINGTON STATE VENTILATION CODE.
- NOT USED.
- ALL WINDOWS TO BE FIXED UNLESS SHOWN/NOTED OTHERWISE.
- PROVIDE SAFETY GLAZING PER KEYNOTE P-4 AS LOCATED ON FLOOR PLANS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002

TYP DOOR NOTES:


- ALL RESIDENTIAL SLIDING GLASS DOORS ARE BASED ON MILGARD SERIES VINYL SLIDING DOORS.
- GLAZING TO BE PER ENERGY COMPLIANCE NOTES. SEE SHEETS A000 - A002.
- PROVIDE SAFETY GLAZING PER GENERAL NOTES.
- NOT USED.
- PROVIDE MIN 0.20 U-VALUE AT SOLID CORE FLUSH DOORS WHERE EXPOSED TO AMBIENT TEMPERATURE.

GENERAL PLAN NOTES:

- SEE SHEET _A001_ FOR GENERAL CONSTRUCTION SPECIFICATIONS.
- SEE BUILDING ELEVATIONS FOR WINDOW OPERATION.
- SEE TYPICAL BUILDING MATERIALS' LIST ON THE ELEVATION SHEETS(S).
- FOR THE SYMBOLS & LEGEND SEE SHEET A000.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLDDOWNS AND SHEET S100 FOR SHEARWALL DETAILS/ SCHEDULE.

KEYNOTES - FLOORPLAN

ID	DESCRIPTION
P-1	GARAGE/HOUSE OCCUPANCY SEPARATION. PER IRC R302.6 a) 1/2" GYP. AT GARAGE SIDE BETWEEN RESIDENCE AND ATTIC. b) 5/8" TYPE 'X' GYP IS REQUIRED WHERE THERE IS LIVING SPACE ABOVE. c) 1/2" GYP. AT SUPPORTING COLUMNS, WALLS AND BEAMS ABOVE.
P-2	DOOR BETWEEN GARAGE AND HOUSE SHALL BE EQUIPPED WITH A SELF-CLOSING DEVICE, AND BE A MIN 1 3/8" THICK SOLID WOOD DOOR OR 20 MIN. F.R. DOOR. PER IRC SECTION R302.5.1
P-3	STAIR ASSEMBLY: PER IRC SECTION R311.7. a) WIDTH 36" MIN.; HEADROOM 6'-8" MIN. b) RISER 7-3/4" MAX.; TREAD 10" MIN. c) TOP OF HANDRAIL AT 34" MIN. AND 38" MAX ABOVE TREAD NOSING d) HANDRAIL WIDTH 1-1/4" MIN. AND 2" MAX. e) INSTALL FIRE BLOCKING IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. f) COVER USABLE SPACE UNDER STAIR WITH 1/2" GYP.
P-4	SAFETY GLAZING PER IRC SECTION R308.4
P-5	EGRESS WINDOW PER IRC SECTION R310. PROVIDE MIN NET CLEARANCE OF 5 SF AT GRADE FLOOR OPENINGS AND 5.7 SF ABOVE. MIN SILL HEIGHT TO BE 44" A.F.F.
P-6	IGNITERS: A) FOR GAS FIRED APPLIANCES IN GARAGE TO BE 18" MIN ABOVE TOP OF SLAB. PROVIDE (2) LAYERS OF FLOOR SHEATHING OVER FRAMING. PER IRC SECTION G2408. B) HEAT-PRODUCING EQUIPMENT AND APPLIANCES SHALL BE INSTALLED TO MAINTAIN THE REQUIRED CLEARANCES TO COMBUSTIBLE CONSTRUCTION AS SPECIFIED IN THE LISTING AND MANUFACTURER'S INSTRUCTIONS. PER IRC G2408.5
P-7	COVER WALLS ADJACENT TO TUBS AND SHOWERS WITH NONABSORBENT MATERIAL TO 72" ABOVE DRAIN INLETS. PER IRC SECTION R307.2. FOR GROUND FLR WASTE OPENING REQ SEE UPC NOTES ON SHT A001
P-8	HIGH EFFICIENCY GAS FURNACE. SIZE PER WSEC PRESCRIPTIVE ENERGY CODE COMPLIANCE FORMS. a) PROVIDE DUCT LEAKAGE, SEALING & TESTING PER WSEC 502 & 503. b) THERMOSTAT PER WSEC 503.8. c) SEE WSEC NOTES ON SHEET A001
P-9	7-3/4" MAX. RISER WITH 10" MIN. TREAD DEPTH. IF MORE THAN (4) RISERS HANDRAIL REQUIRED PER IRC SECTION R311.7.7. a) PROVIDE 36"x36" MIN. LANDING AT EXTERIOR DOORS PER IRC SECTION R311.3
P-10	PROVIDE CRAWL SPACE ACCESS. MIN. 18" X 24" UNOBSTRUCTED ACCESS. PER IRC SECTION R408.4
P-11	PROVIDE ATTIC ACCESS. MIN. 22" X 30" WITH 30" MIN. HEADROOM AT UNOBSTRUCTED READILY ACCESSIBLE OPENING. PER IRC SECTION R807.1
P-13	FIREPLACE ASSEMBLY. PER IRC CHAPTER 10. a) FACTORY-BUILT FIREPLACES TO BE INSTALLED PER MFR. PER IRC SECTION R1004. b) INSTALL MASONRY FIREPLACES PER IRC SECTION R1003. c). HEARTH SHALL CONFORM TO IRC REQUIREMENTS.
P-15	36" MIN. GUARDRAIL. AT STAIRS SLOPES AT 36" ABOVE STAIR NOSINGS. PER SEE IRC SECTION 312
P-16	B' VENT FOR MECHANICAL. 1" CLEARANCE ALL SIDES.
P-17	2x6 WALL FOR PLUMBING / HVAC.
P-18	A PERMANENT CERTIFICATE SHALL BE POSTED WITHIN 36" OF THE ELECTRICAL DISTRIBUTION PANEL. SEE WSEC SECTION 105 ON SHEET A001
P-19	3" DIA GALV BOLLARD OR EQ PER G2408.3 & M1307.3.1

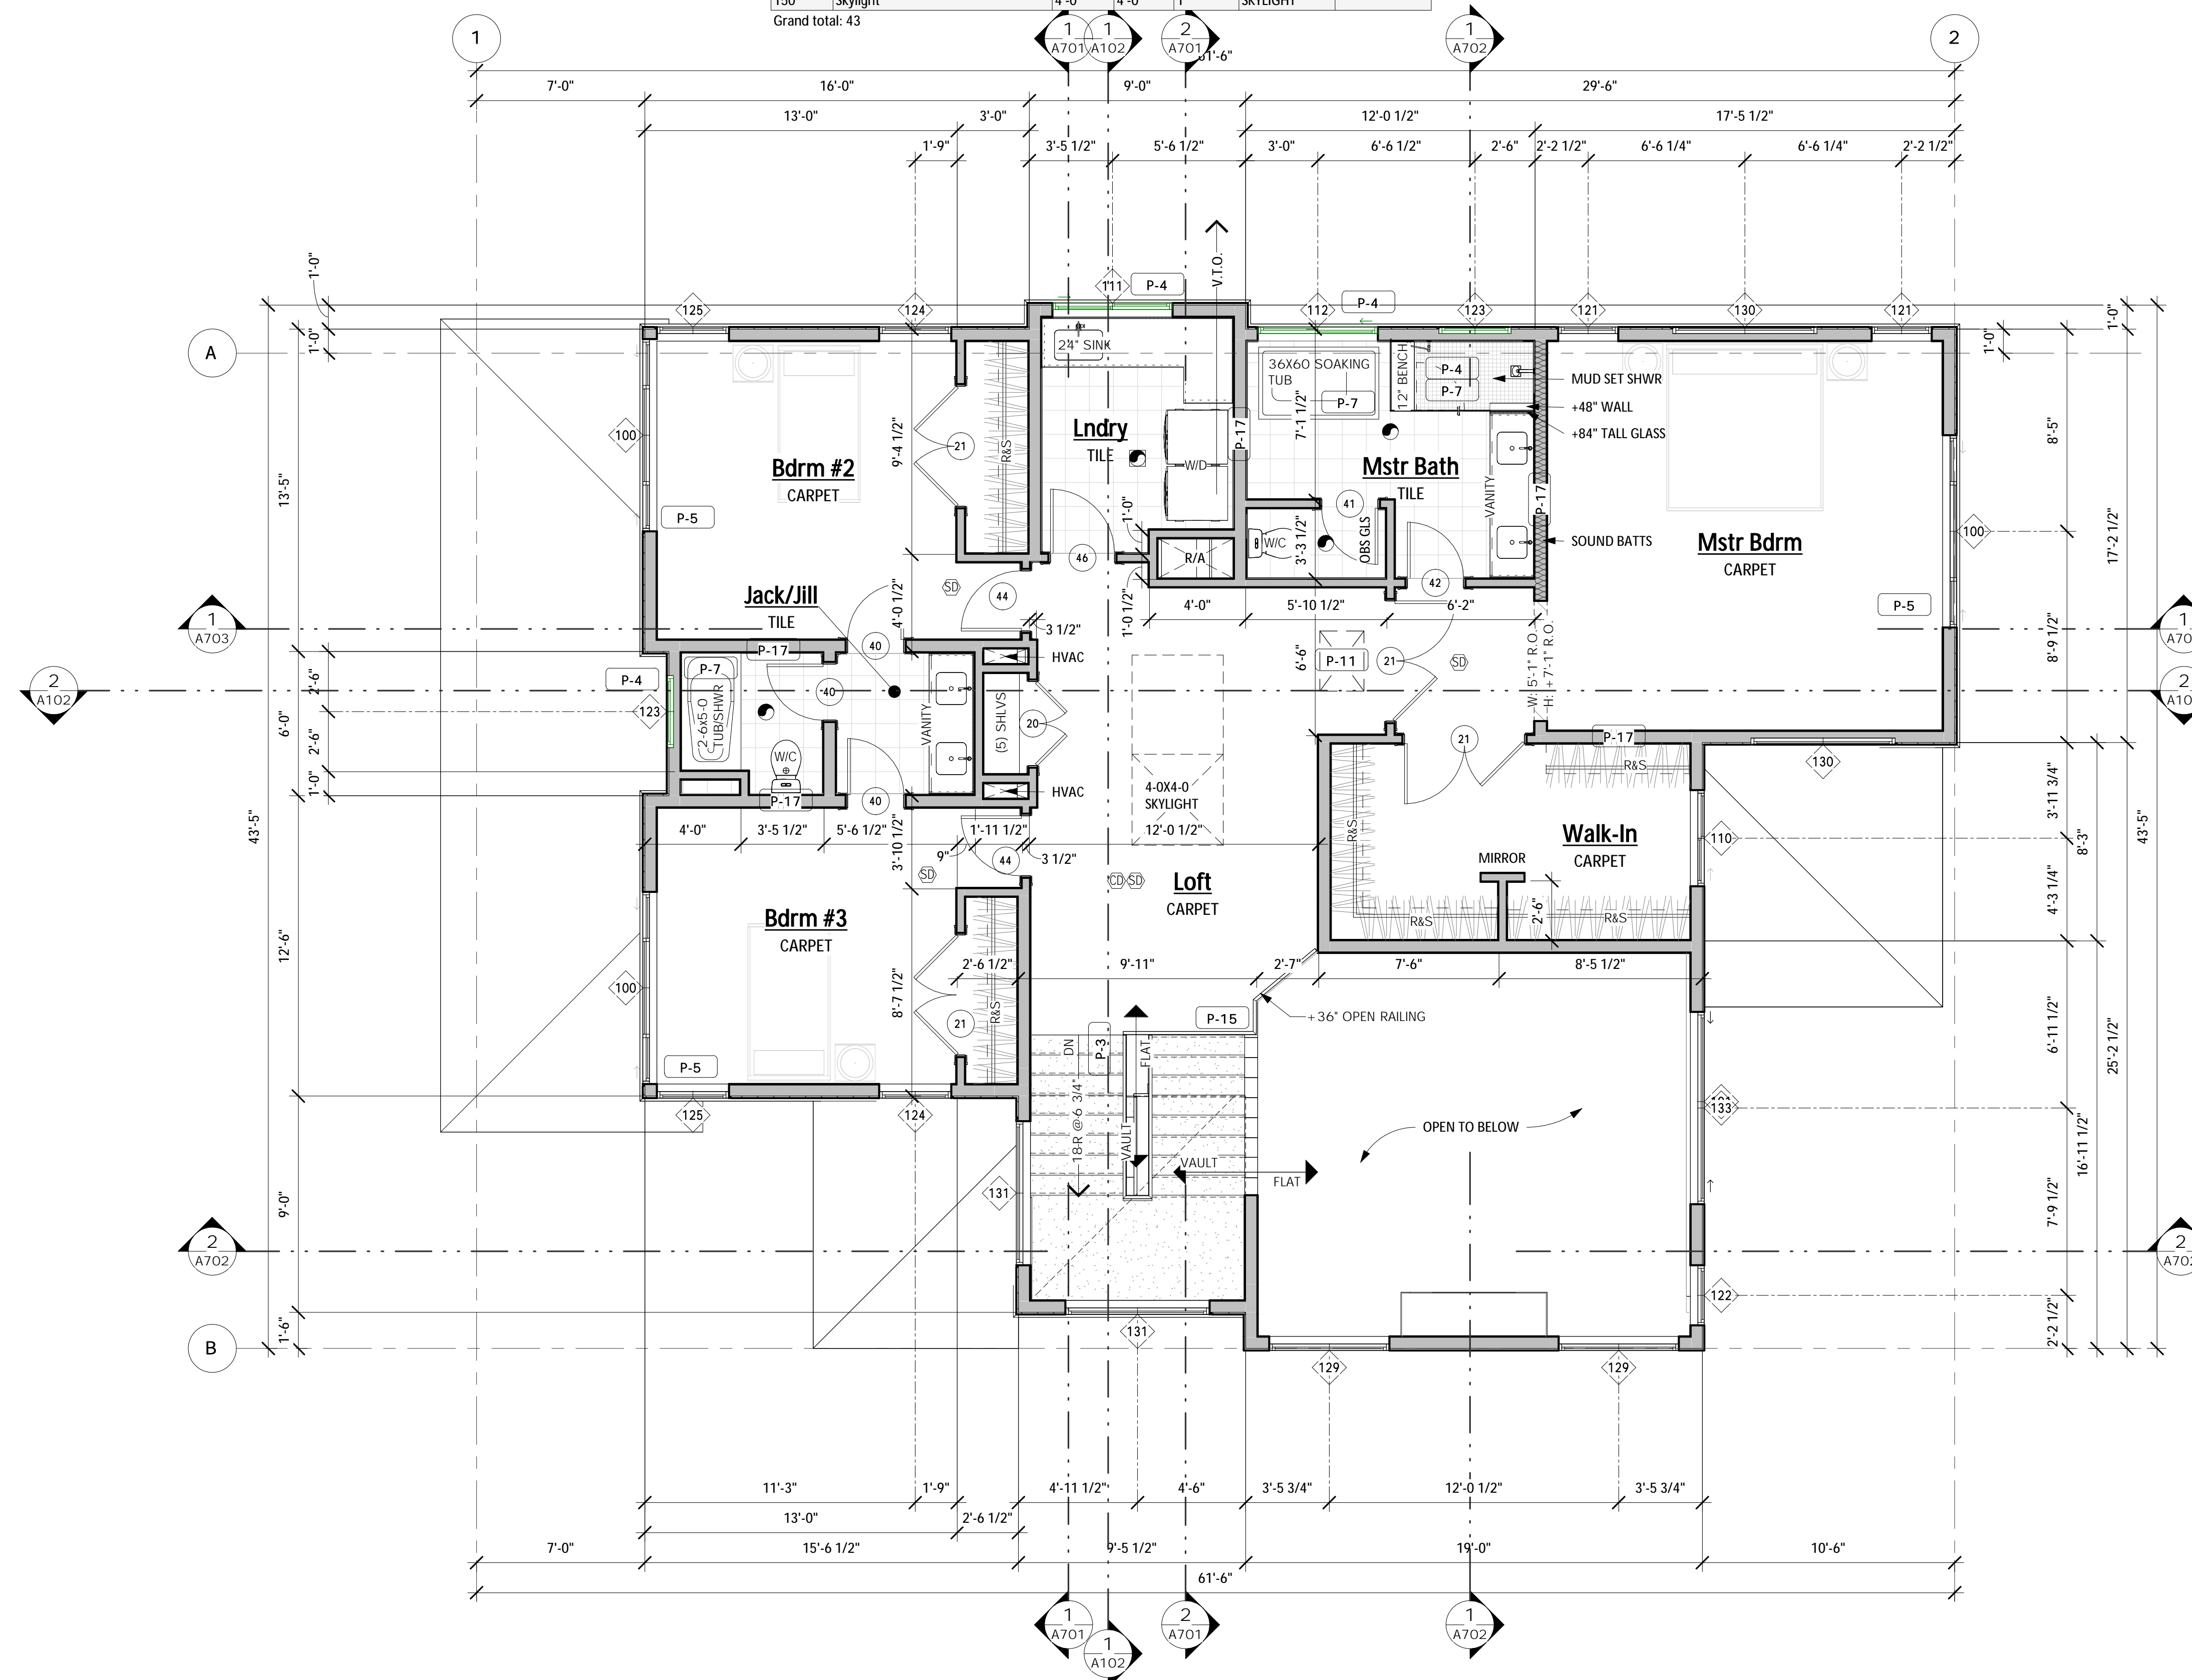

AREA SCHEDULE - GROSS

NAME	AREA
Foyer	119 SF
Lower Entry	122 SF
Lower Stairs	67 SF
Main Floor	1490 SF
Main Floor (+20ft Clg)	138 SF
Main Stairs	109 SF
Upper Floor	1469 SF
	3514 SF
Garage	671 SF
	671 SF
	4185 SF

Description
Date
No.



MONSEF DESIGN
STUDIO
451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET

UPPER FLOOR

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM

A401


SCALE 24X36: 1/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

GENERAL FRAMING NOTES:

- SEE SECTION R301, SHEET A001 FOR GENERAL DESIGN CRITERIA.
- SEE STRUCTURAL SHEETS FOR SHEARWALL DESIGNATIONS & HOLDDOWNS AND SHEET \$100 FOR SHEARWALL DETAILS/ SCHEDULE.
- TRUSS DESIGN BY MANUFACTURER. TRUSS DESIGN DRAWINGS SHALL BE PREPARED PER IRC SECTION R802.10.1 AND SHALL BE PROVIDED TO THE BUILDING OFFICIAL AND APPROVED PRIOR TO INSTALLATION.
 - * TRUSS DESIGN PER IRC SECTION R802.10.2
 - * FIELD ALTERATIONS MUST BE DESIGNED BY MFR. PER IRC SECTION R802.10.4
 - * SEE STRUCTURAL PLANS FOR DESIGN LOADS.
 - * TRUSS MFR TO PROVIDE ADEQUATE BEARING AREA TO RESOLVE REACTION (PERPENDICULAR TO GRAIN) AT ALL HIGHLY LOADED GIRDER TRUSSES.
- PROVIDE 2x4 RAFTER/TRUSS TAIL - TYP. U.N.O.
- ROOF PITCH: EXTERIOR PER ELEVATIONS & INTERIOR PER SECTIONS.
- ROOF FRAMING SPACING, 24" o.c. U.N.O.
- SEE ELEVATIONS AND/OR SECTIONS FOR ROOF PITCH, PLATE HEIGHT AND HEADER HEIGHT.
- FASTENERS: ALL FRAMING SHALL BE NAILED IN ACCORDANCE WITH THE STRUCTURAL DRAWINGS. POSITIVE CONNECTIONS SHALL BE PROVIDED WHERE POSTS AND BEAM OR GIRDER CONSTRUCTION IS USED TO SUPPORT FLR FRAMG.
- INSTALL 2X FIREBLOCKING PER R302.11 AS FOLLOWS:
 - a) IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS, VERT AT THE CLG AND FLR LEVELS AND HORZ AT INTERVALS NOT EXCEEDING 10 FEET.
 - b) AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERT AND HORZ SPACES SUCH AS OCCUR AT SOFFITS, DROP CLGS AND COVE CLGS.
 - c) IN CONCEALED SPACES BTWN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
 - d) AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E 136 REQUIREMENTS.
- SEE SHT A003 FOR ROOF & CRAWL SPACE AREA VENTILATION CALCULATIONS

KEYNOTES - FRAMING

ID	DESCRIPTION
FR-6	ATTIC SPACE VENT PER IRC R806. SEE ROOF VENT CALCULATIONS ON SHEET A003.
FR-8	HIGH EFFICIENCY GAS FURNACE, SIZE PER WSEC PRESCRIPTIVE ENERGY CODE COMPLIANCE FORMS. a) PROVIDE DUCT LEAKAGE, SEALING & TESTING PER WSEC 502 & 503. b) THERMOSTAT PER WSEC 503.8. c) SEE WSEC NOTES ON SHEET A001
FR-13	SEE ELEVATIONS AND SECTIONS FOR PLATE HEIGHT.

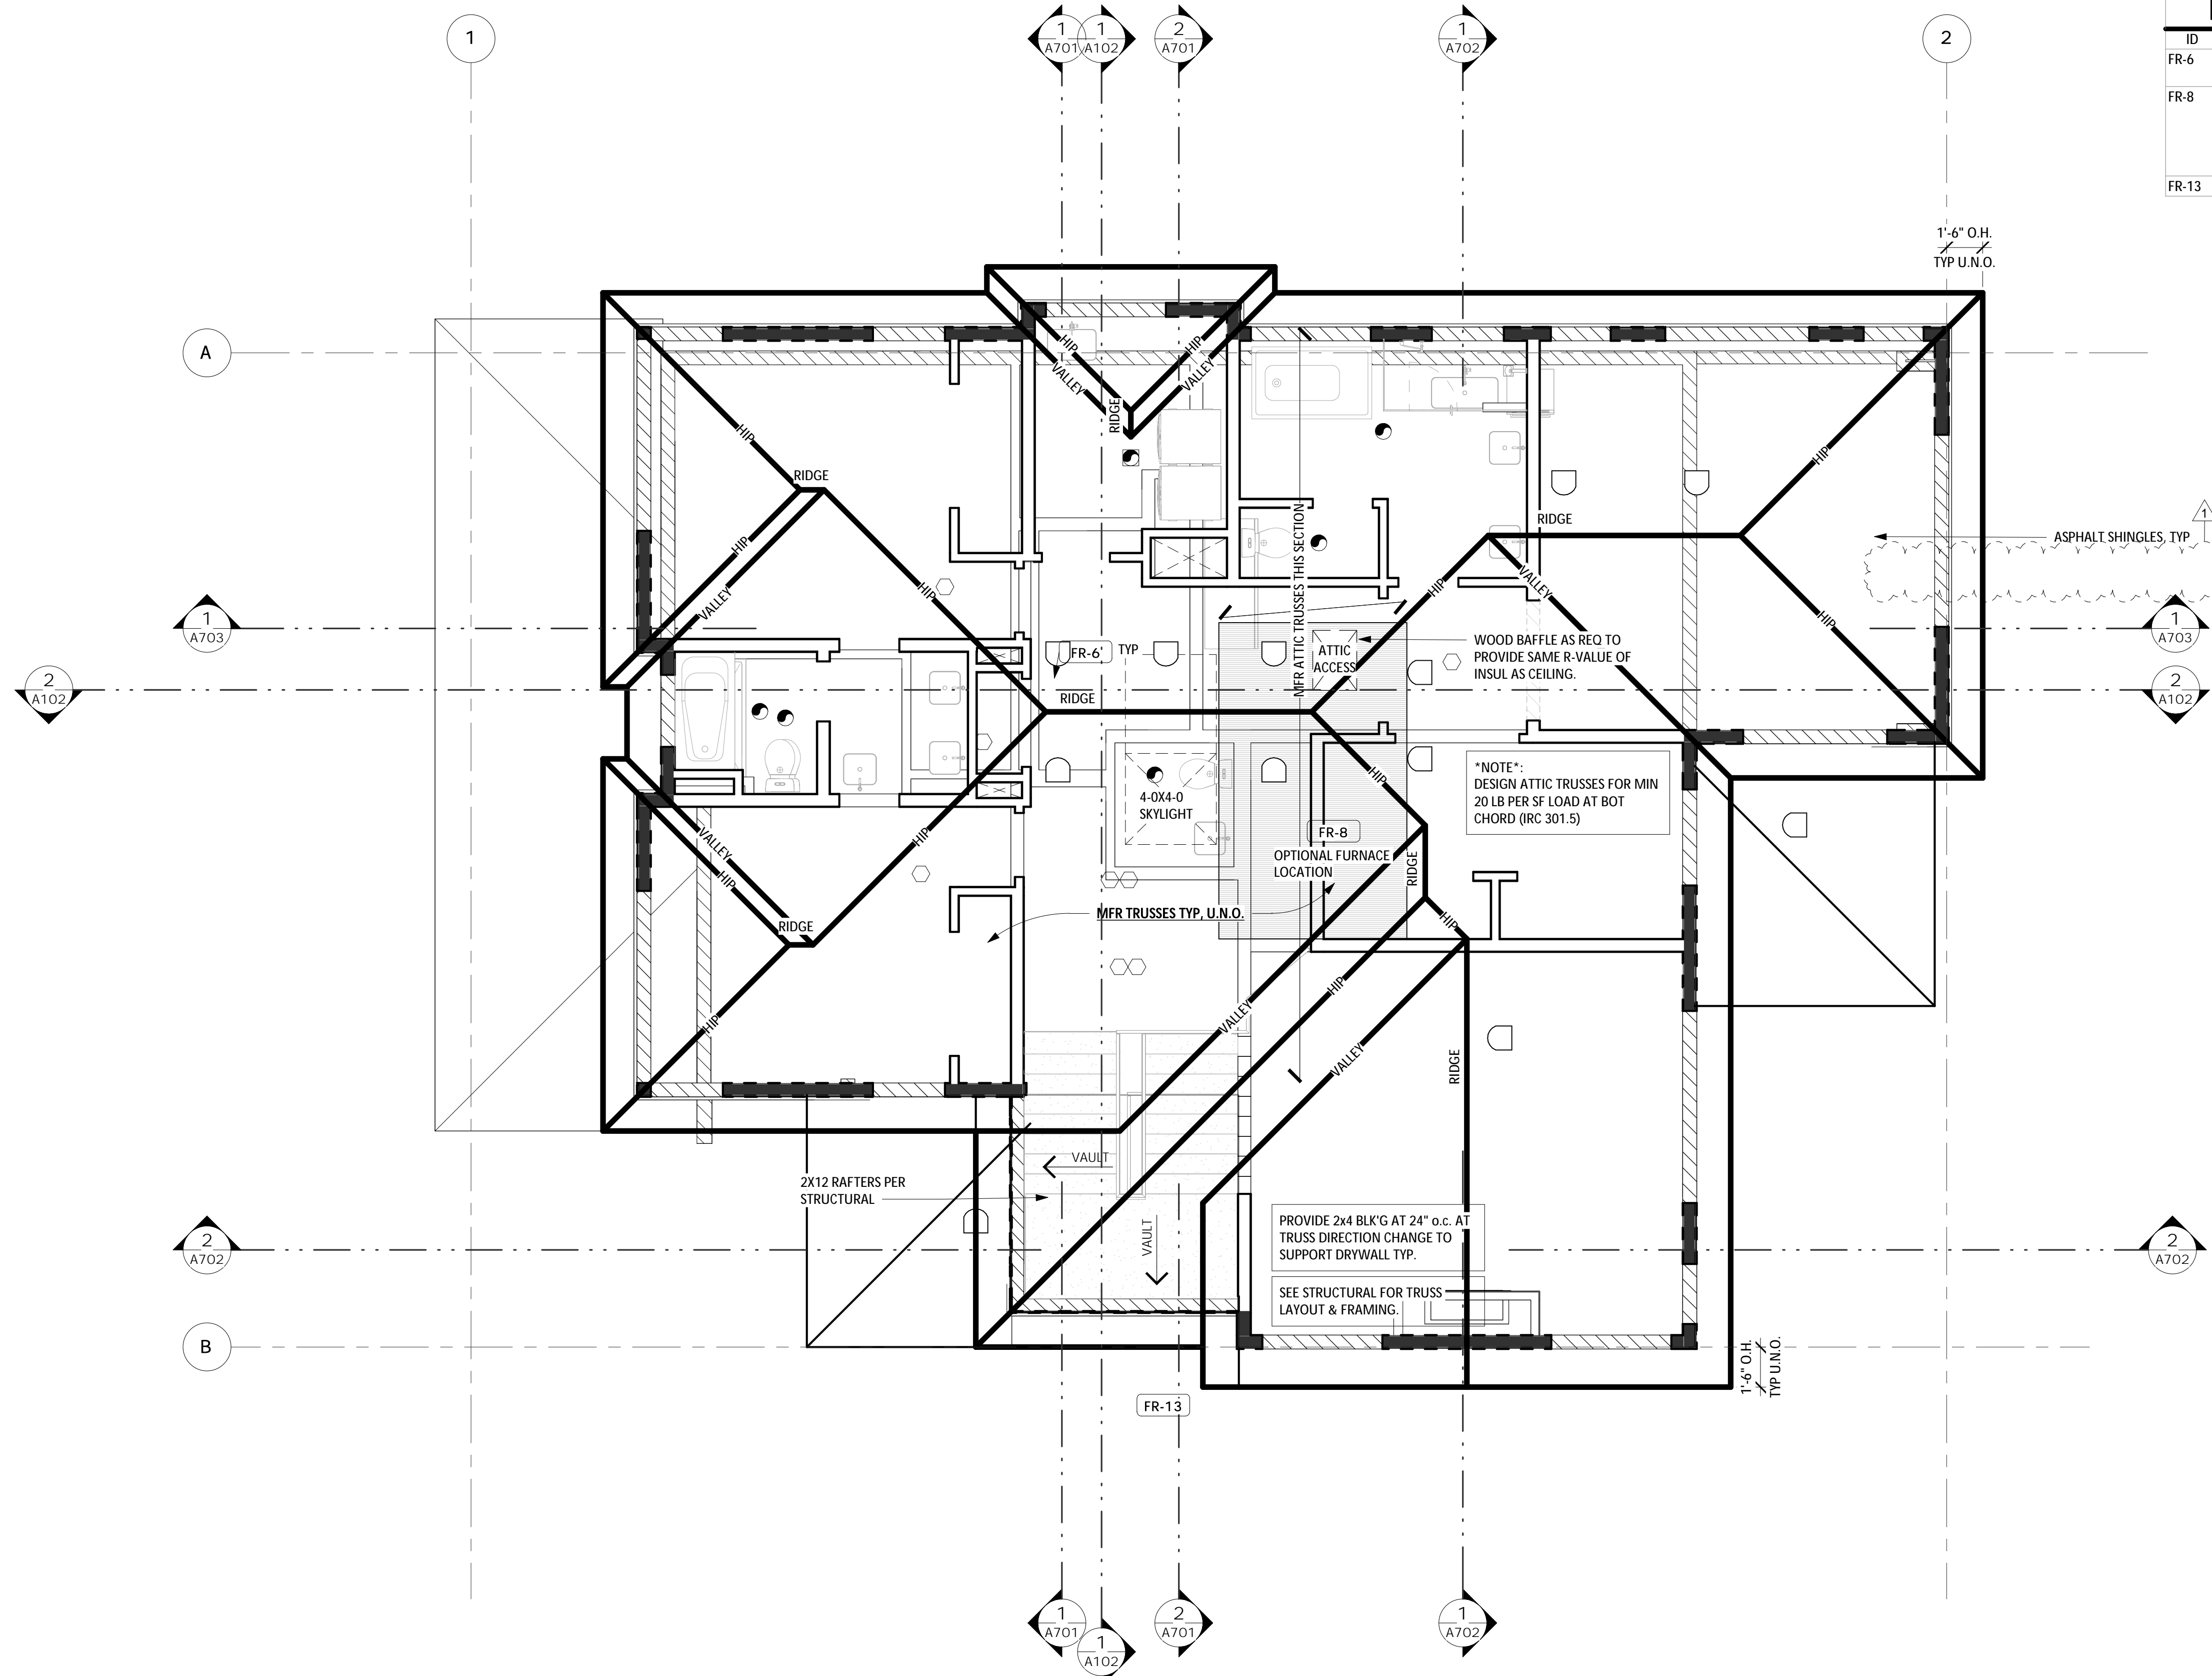

Description
CITY COMMENTS

Date
TBD

No.



MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET


ROOF PLAN

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM


A501

SCALE 24X36: 1/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.


4/17/2024 12:32:38 PM Autodesk Docs://20008 Chen Residence, Mercer Island/20008-05 Chen Residence, MI - SUB2.rvt

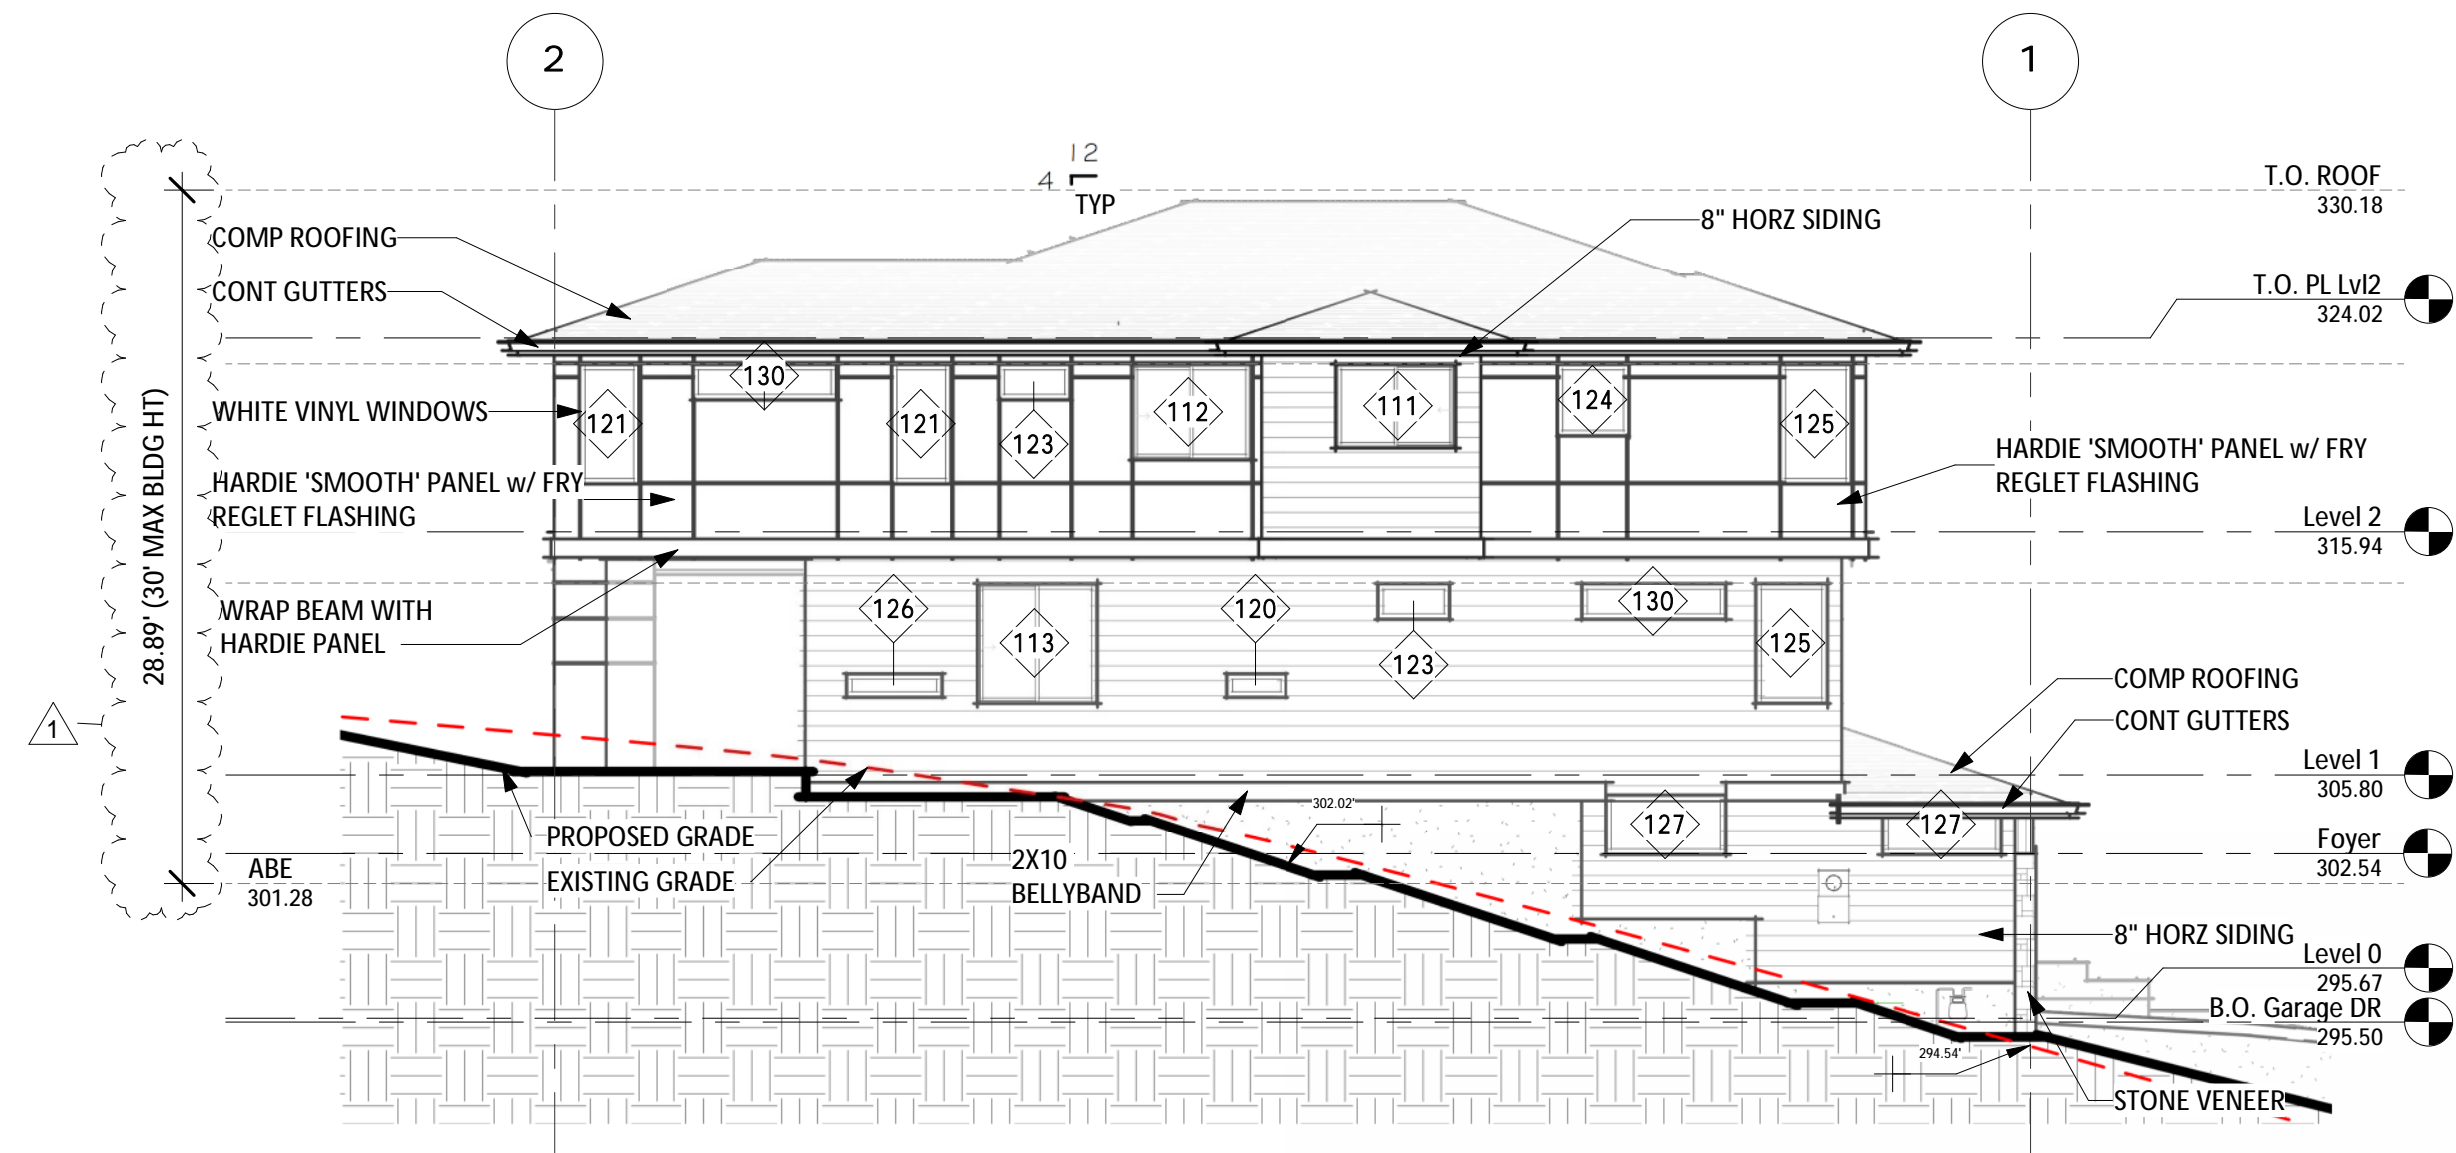

3 NORTH ELEVATION
SCALE: 1/8" = 1'-0"

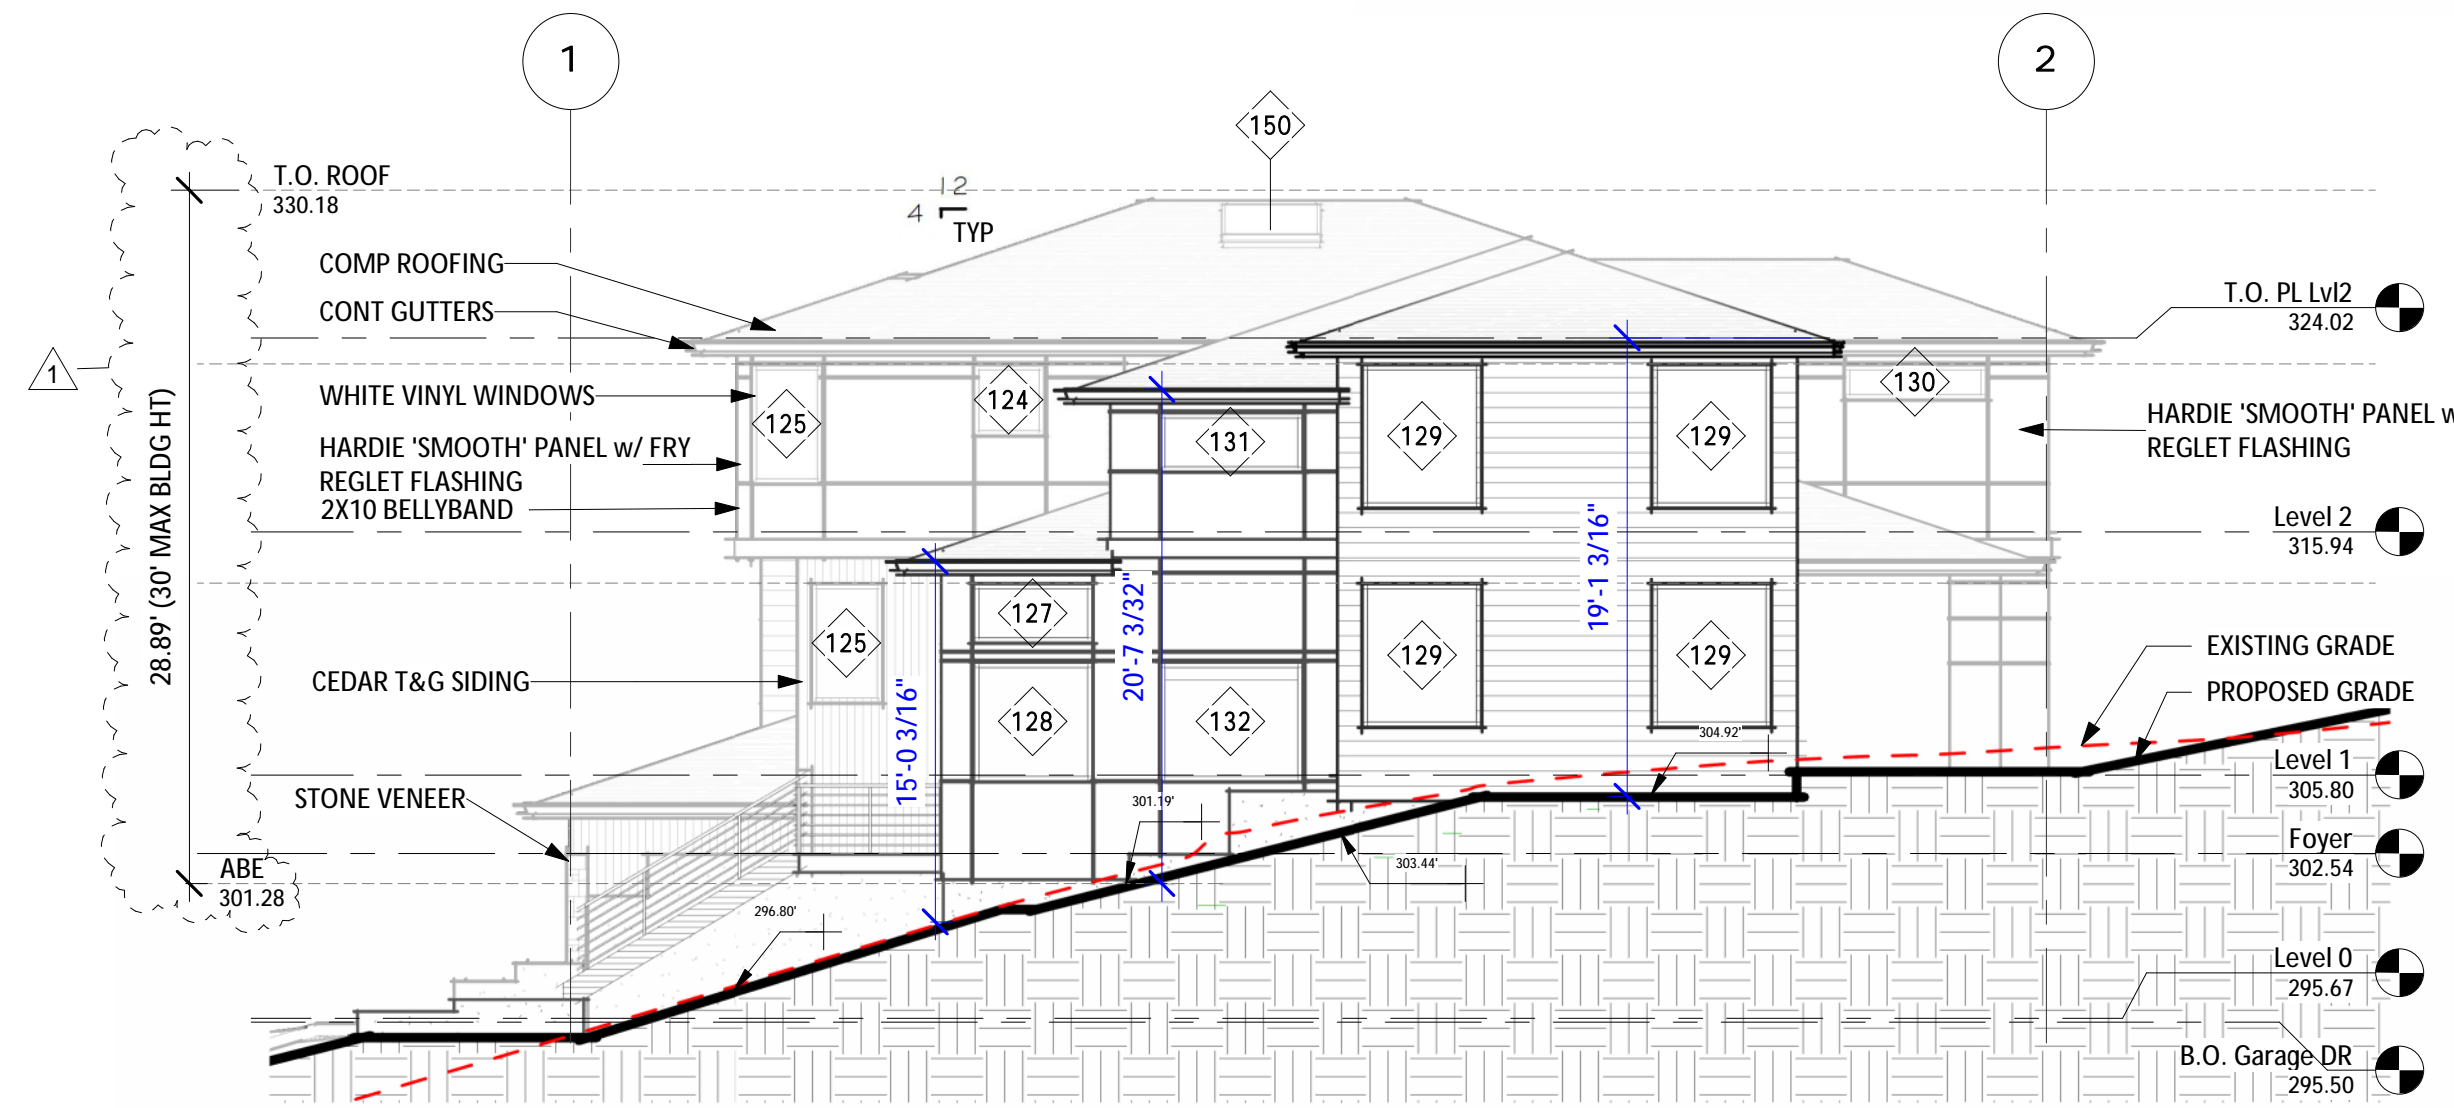

4 SOUTH ELEVATION
SCALE: 1/8" = 1'-0"

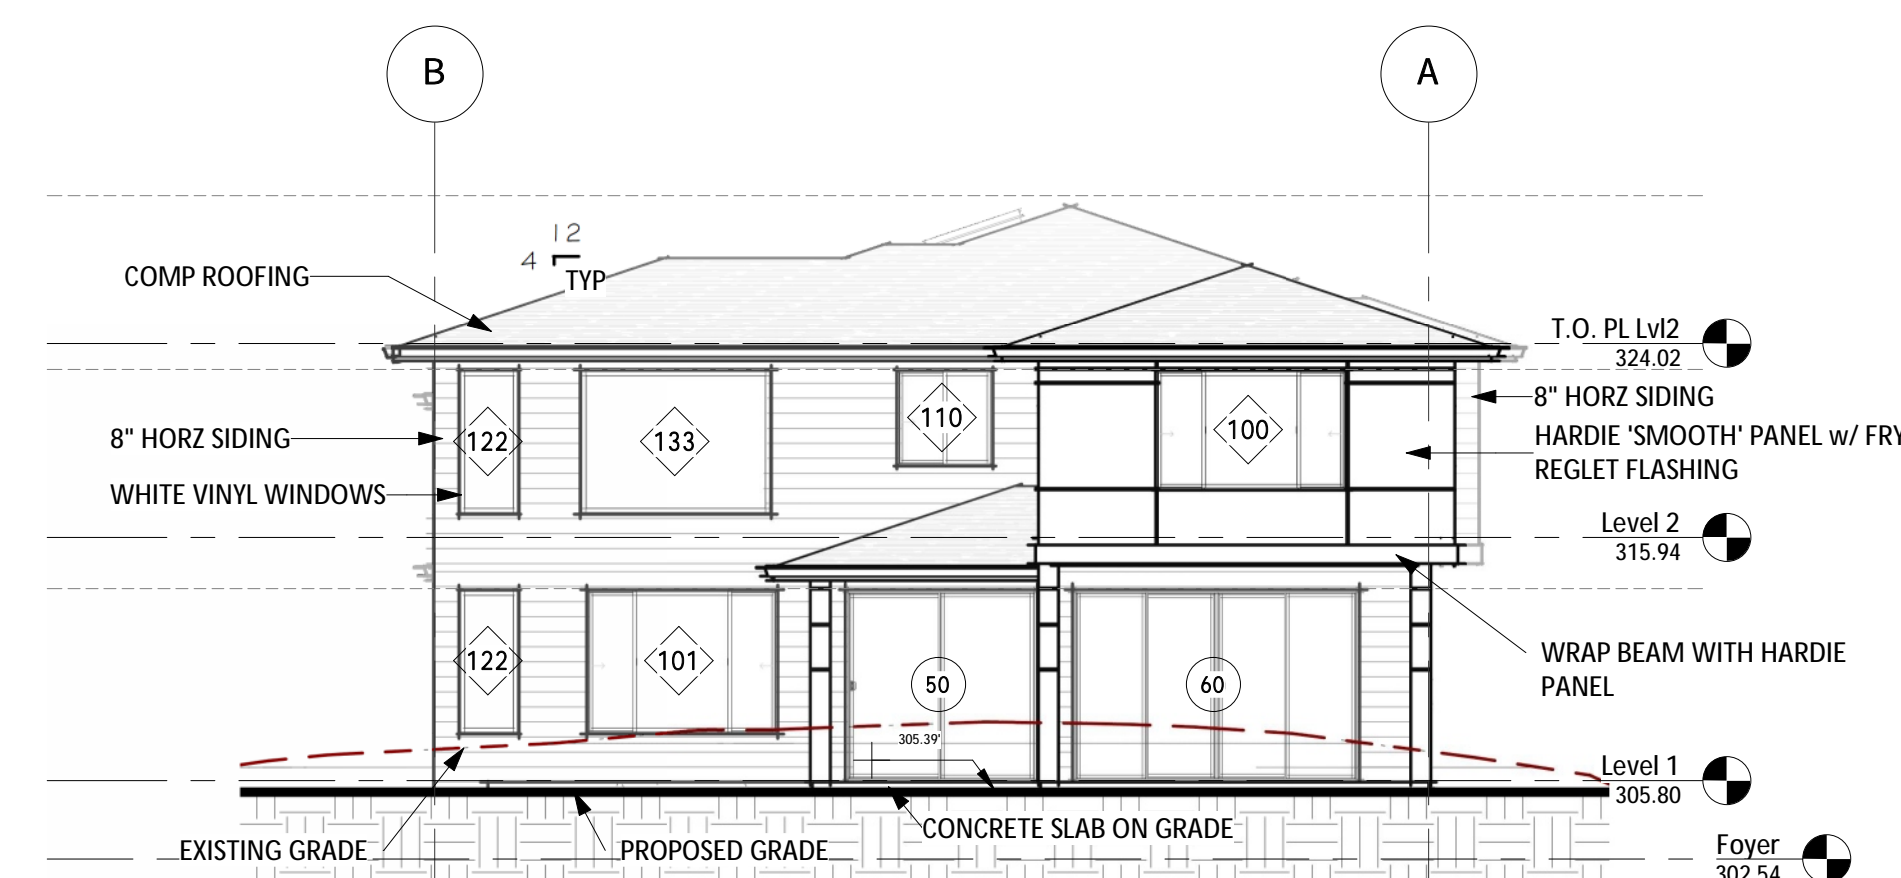

2 EAST ELEVATION
SCALE: 1/8" = 1'-0"



1 WEST ELEVATION
SCALE: 1/4" = 1'-0"

TYPICAL BUILDING MATERIALS:

- ROOF CONSTRUCTION**
- ROOFING: ASPHALT SHINGLES
 - BUILDING PAPER: 15# BUILDING PAPER
 - SHEATHING: PER SHEARWALL SCHEDULE
 - FRAMING: PER PLANS
 - INSULATION: R-49 BLOWN-IN (R-38 VAULTED)
 - SOFFIT: HARDIE PANEL SOFFIT
 - GWB: 5/8" GWB
- FLOOR CONSTRUCTION**
- FLOORING: FINISH PER PLANS
 - SUBFLOOR: 3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
 - FRAMING: PER PLANS
 - INSULATION: R-38 BATT
 - SOFFIT: HARDIE PANEL SOFFIT
- EXTERIOR WALL CONSTRUCTION**
- SIDING MATERIAL: PER ELEVATIONS
 - BUILDING PAPER: 15# BUILDING PAPER
 - SHEATHING: PER SHEARWALL SCHEDULE
 - FRAMING: 2x6 STUDS AT 16" oc U.N.O.
 - INSULATION: R-21 BATT w/ INTEGRAL VAPOR BARRIER
 - GWB: 1/2" GWB
- TRIM**
- WINDOW: (WITH NO BRICK MOLD) 5/4x4 WRAP
 - CORNER BOARDS: INSIDE: 2x2
OUTSIDE: MTL 'X' FLASHING
 - FASCIA: 2x8 w/ 2x3 (PER DETAILS) U.N.O.

ELEVATION NOTES:

- INSTALL APPROVED CORROSION-RESISTANT FLASHING, TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS PER R708.3. SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH ANMA 711. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED CORROSION-RESISTANT FLASHINGS SHALL BE INSTALLED AT ALL OF THE FOLLOWING LOCATIONS:
 - EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE.
 - AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
 - UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
 - CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
 - WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
 - AT WALL AND ROOF INTERSECTIONS.
 - AT BUILT-IN GUTTERS.

No. Description
Date CITY COMMENTS
TBD



MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET

ELEVATIONS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2023/08/01
DRAWN BY: SPM

A601

SCALE 24X36: As indicated
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING: ASPHALT SHINGLES
 BUILDING PAPER: 15# BUILDING PAPER
 SHEATHING: PER SHEARWALL SCHEDULE
 FRAMING: PER PLANS
 INSULATION: R-49 BLOWN-IN (R-38 VAULTED)
 SOFFIT: HARDIE PANEL SOFFIT
 GWB: 5/8" GWB

FLOOR CONSTRUCTION


FLOORING: FINISH PER PLANS
 SUBFLOOR: 3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
 FRAMING: PER PLANS
 INSULATION: R-38 BATT
 SOFFIT: HARDIE PANEL SOFFIT

EXTERIOR WALL CONSTRUCTION

SIDING MATERIAL: PER ELEVATIONS
 BUILDING PAPER: 15# BUILDING PAPER
 SHEATHING: PER SHEARWALL SCHEDULE
 FRAMING: 2x6 STUDS AT 16" oc U.N.O.
 INSULATION: R-21 BATT w/ INTEGRAL VAPOR BARRIER
 GWB: 1/2" GWB

TRIM

WINDOW: (WITH NO BRICK MOLD) 5/4x4 WRAP
 CORNER BOARDS: INSIDE: 2x2
 OUTSIDE: MTL 'X' FLASHING
 FASCIA: 2x8 w/ 2x3 (PER DETAILS) U.N.O.

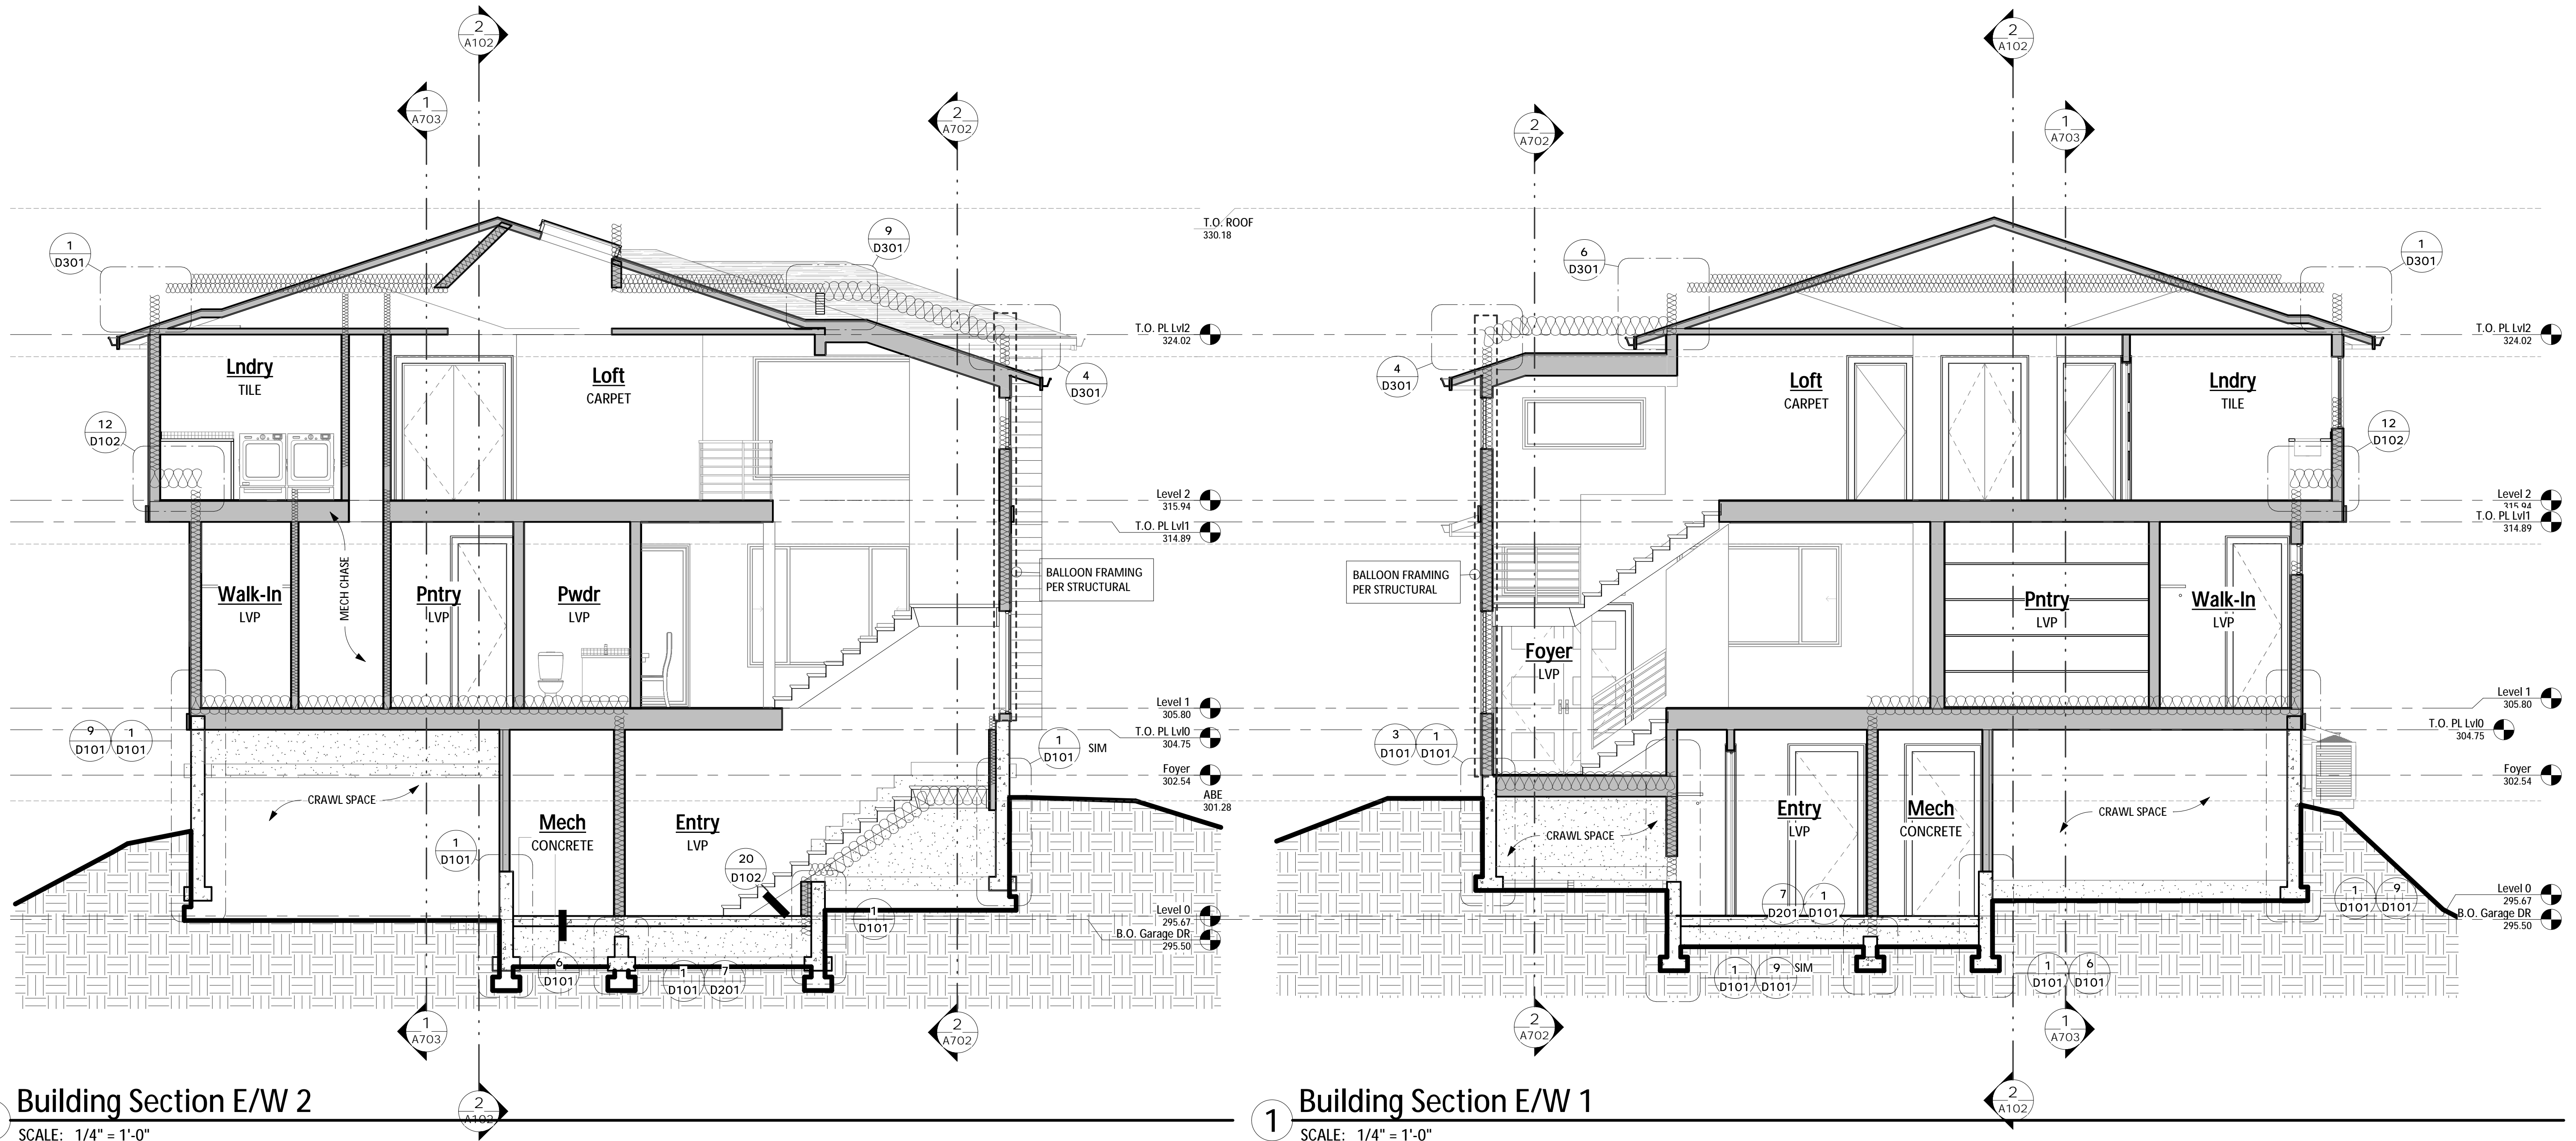

2 Building Section E/W 2
 SCALE: 1/4" = 1'-0"

1 Building Section E/W 1
 SCALE: 1/4" = 1'-0"

Description
Date
No.



MONSEF DESIGN
 STUDIO
 451 DUVAL AVE NE, RENTON, WA 98059
 206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
 5024 W Mercer Way, Mercer Island

PERMIT SET

BUILDING SECTIONS


PROJECT NO: 20008
 ISSUE DATE: 2023/08/01
 SHT ISSUE DATE: 2021/01/08
 DRAWN BY: SPM

A701

SCALE 24X36: 1/4" = 1'-0"
 * NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

4/17/2024 12:32:43 PM Autodesk Docs://20008 Chen Residence, Mercer Island/20008-05 Chen Residence, MI - SUB2.rvt


4/17/2024 12:32:49 PM Autodesk Docs://20008 Chen Residence, Mercer Island/20008-05 Chen Residence, MI - SUB2.rvt

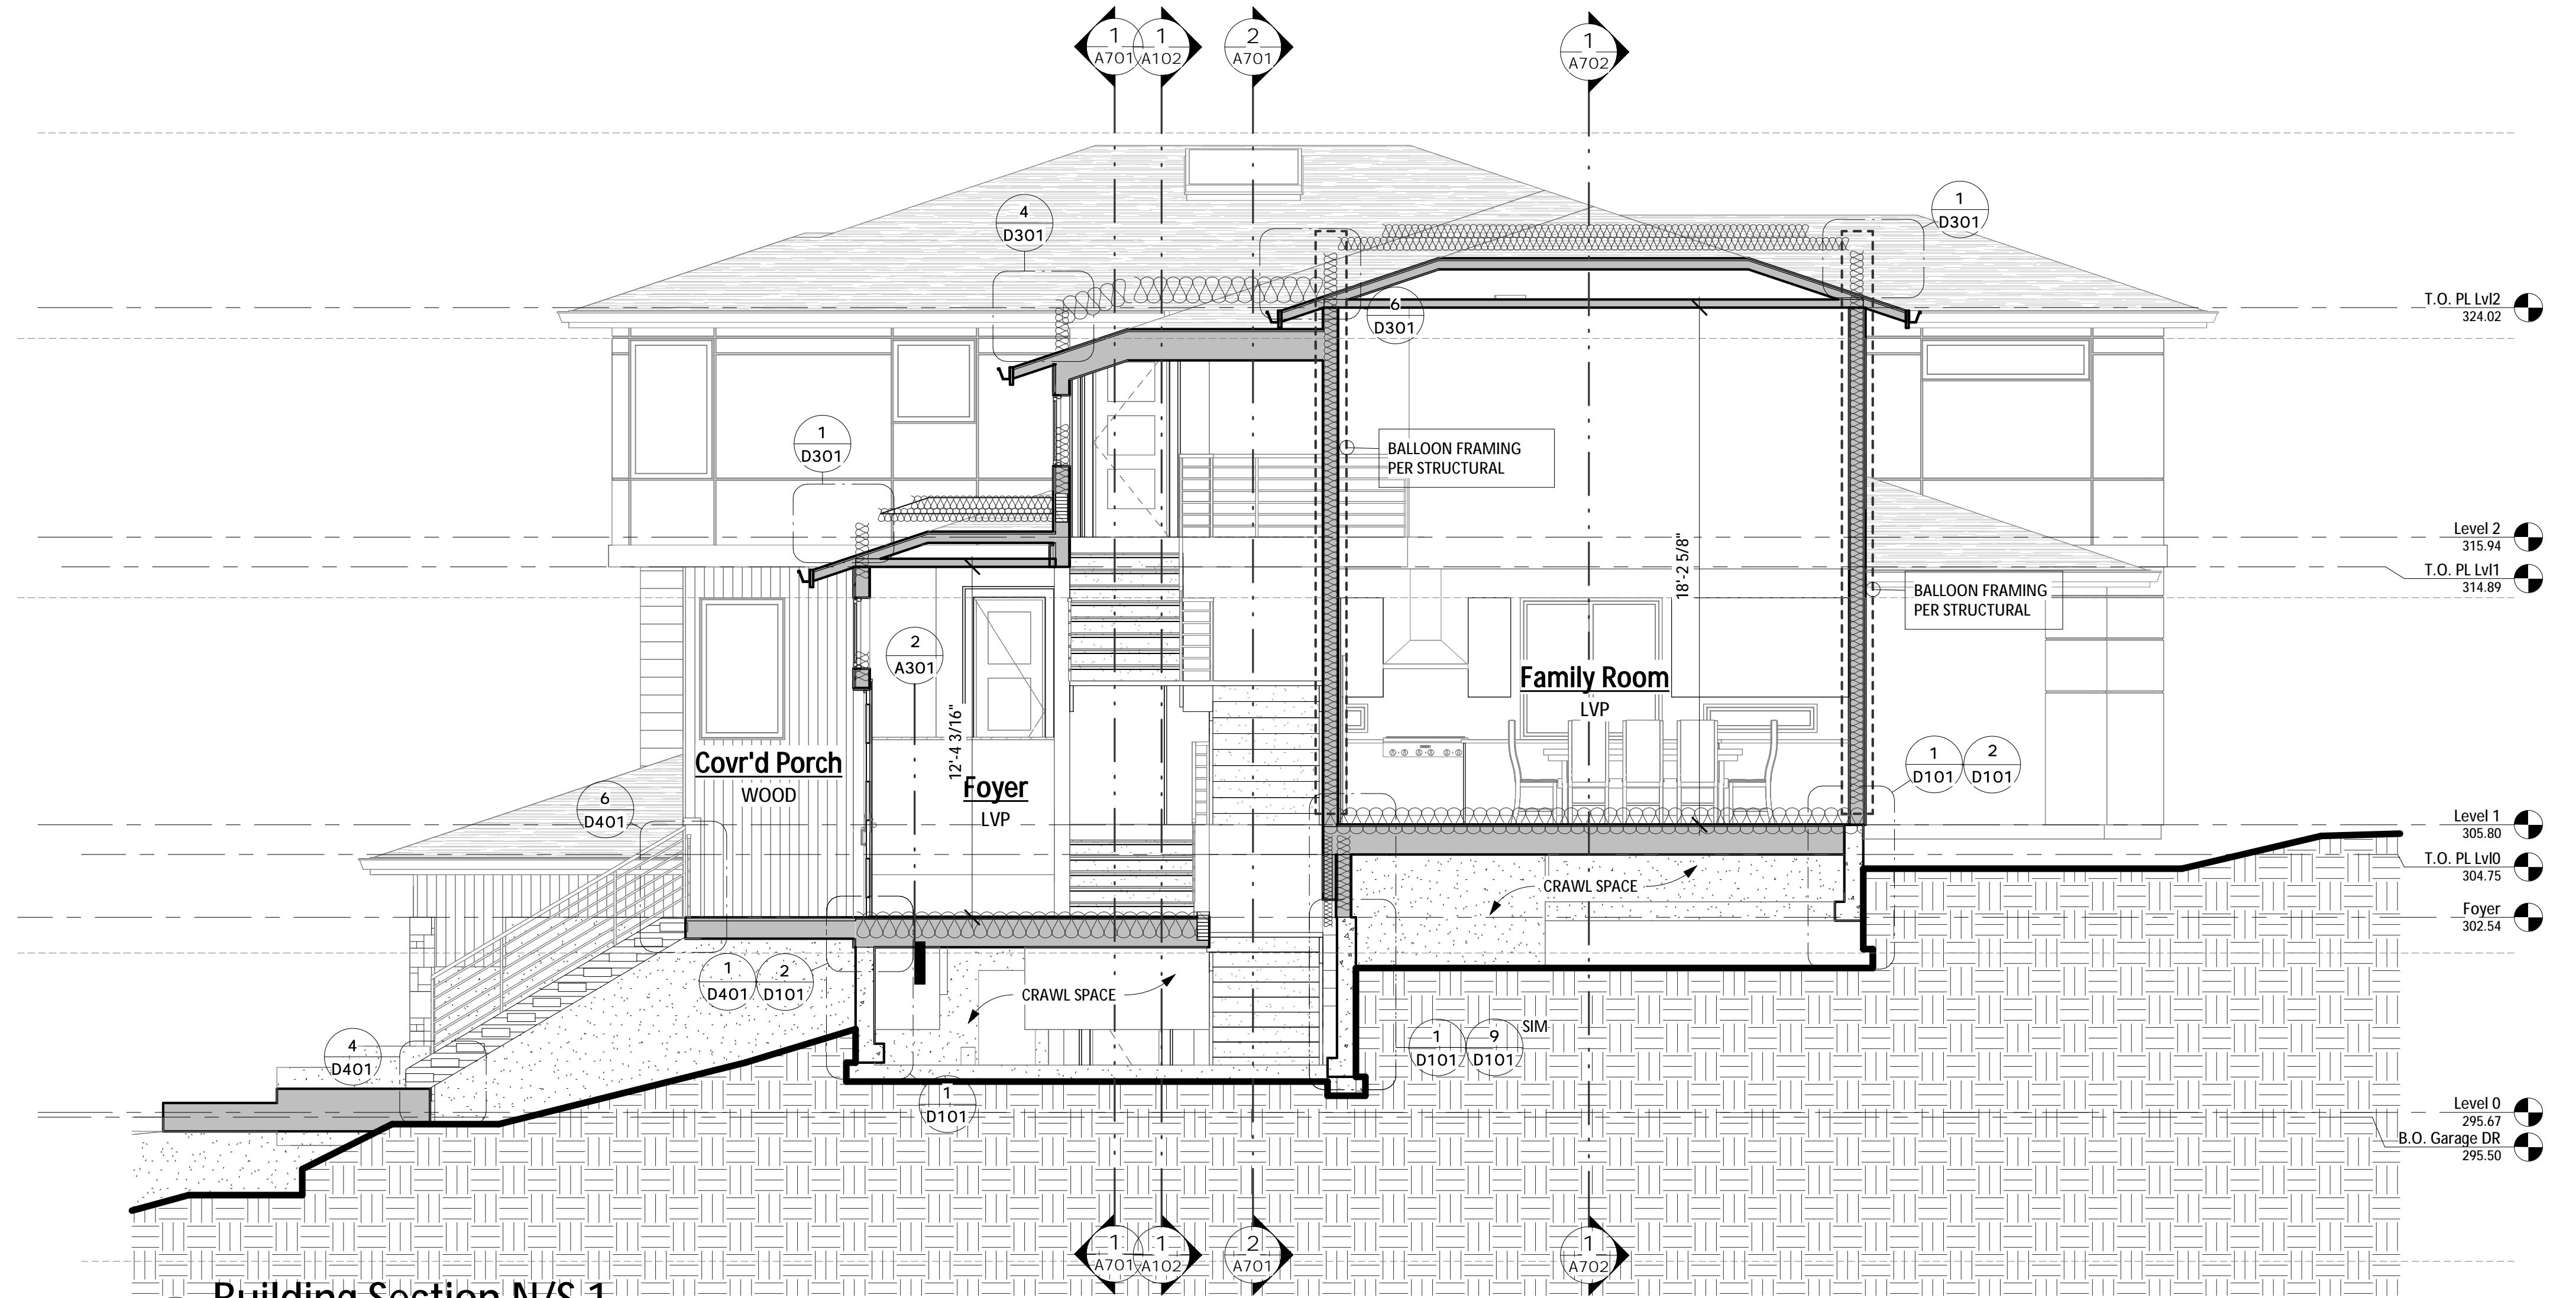

2 Building Section N/S 1
SCALE: 1/4" = 1'-0"

TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION	
ROOFING:	ASPHALT SHINGLES
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	PER PLANS
INSULATION:	R-49 BLOWN-IN (R-38 VAULTED)
SOFFIT:	HARDIE PANEL SOFFIT
GWB:	5/8" GWB
FLOOR CONSTRUCTION	
FLOORING:	FINISH PER PLANS
SUBFLOOR:	3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
FRAMING:	PER PLANS
INSULATION:	R-38 BATT
SOFFIT:	HARDIE PANEL SOFFIT
EXTERIOR WALL CONSTRUCTION	
SIDING MATERIAL:	PER ELEVATIONS
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	2x6 STUDS AT 16" oc U.N.O.
INSULATION:	R-21 BATT w/ INTEGRAL VAPOR BARRIER
GWB:	1/2" GWB
TRIM	
WINDOW: (WITH NO BRICK MOLD)	5/4x4 WRAP
CORNER BOARDS:	INSIDE: 2x2 OUTSIDE: MTL X FLASHING
FASCIA:	2x8 w/ 2x3 (PER DETAILS) U.N.O.

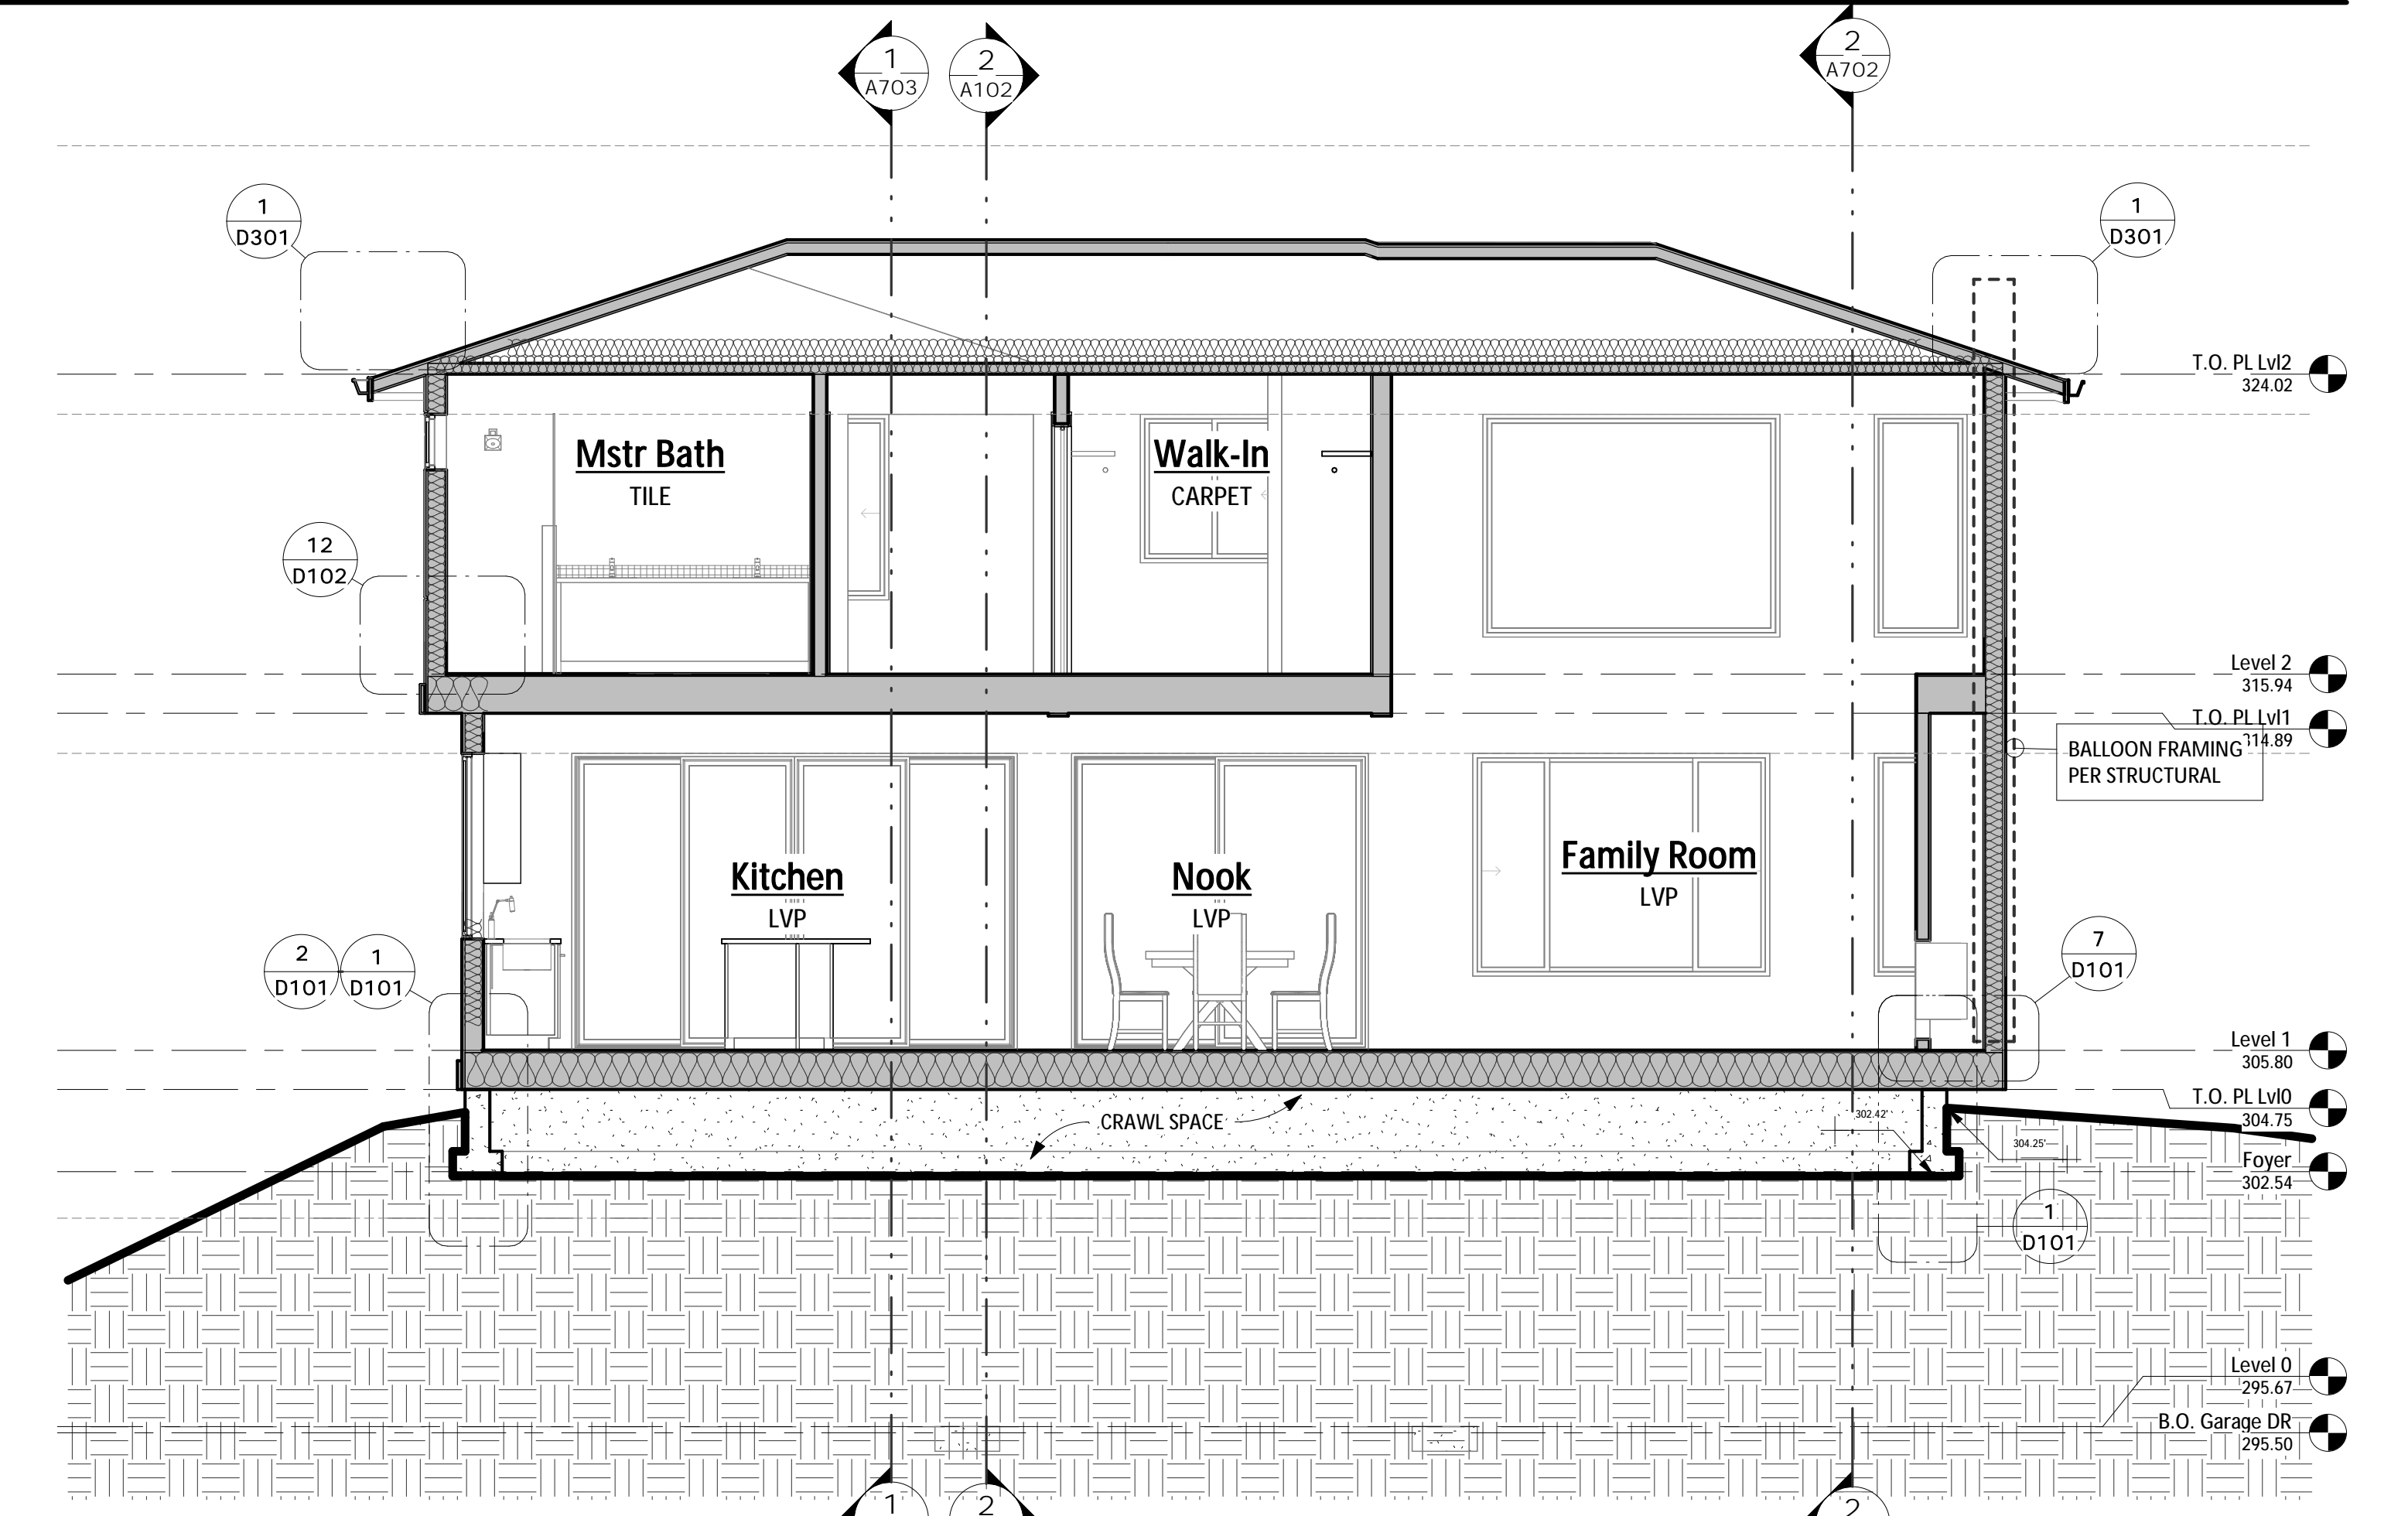

1 Building Section E/W 3
SCALE: 1/4" = 1'-0"

Description
Date
No.



MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET

BUILDING SECTIONS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM

A702

SCALE 24X36: 1/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

TYPICAL BUILDING MATERIALS:

ROOF CONSTRUCTION

ROOFING:	ASPHALT SHINGLES
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	PER PLANS
INSULATION:	R-49 BLOWN-IN (R-38 VAULTED)
SOFFIT:	HARDIE PANEL SOFFIT
GWB:	5/8" GWB

FLOOR CONSTRUCTION


FLOORING:	FINISH PER PLANS
SUBFLOOR:	3/4" T&G (PLYWOOD, COMPLY OR EQUAL)
FRAMING:	PER PLANS
INSULATION:	R-38 BATT
SOFFIT:	HARDIE PANEL SOFFIT

EXTERIOR WALL CONSTRUCTION

SIDING MATERIAL:	PER ELEVATIONS
BUILDING PAPER:	15# BUILDING PAPER
SHEATHING:	PER SHEARWALL SCHEDULE
FRAMING:	2x6 STUDS AT 16" oc U.N.O.
INSULATION:	R-21 BATT w/ INTEGRAL VAPOR BARRIER
GWB:	1/2" GWB

TRIM

WINDOW: (WITH NO BRICK MOLD)	5/4x4 WRAP
CORNER BOARDS:	INSIDE: 2x2 OUTSIDE: MTL 'X' FLASHING
FASCIA:	2x8 w/ 2x3 (PER DETAILS) U.N.O.

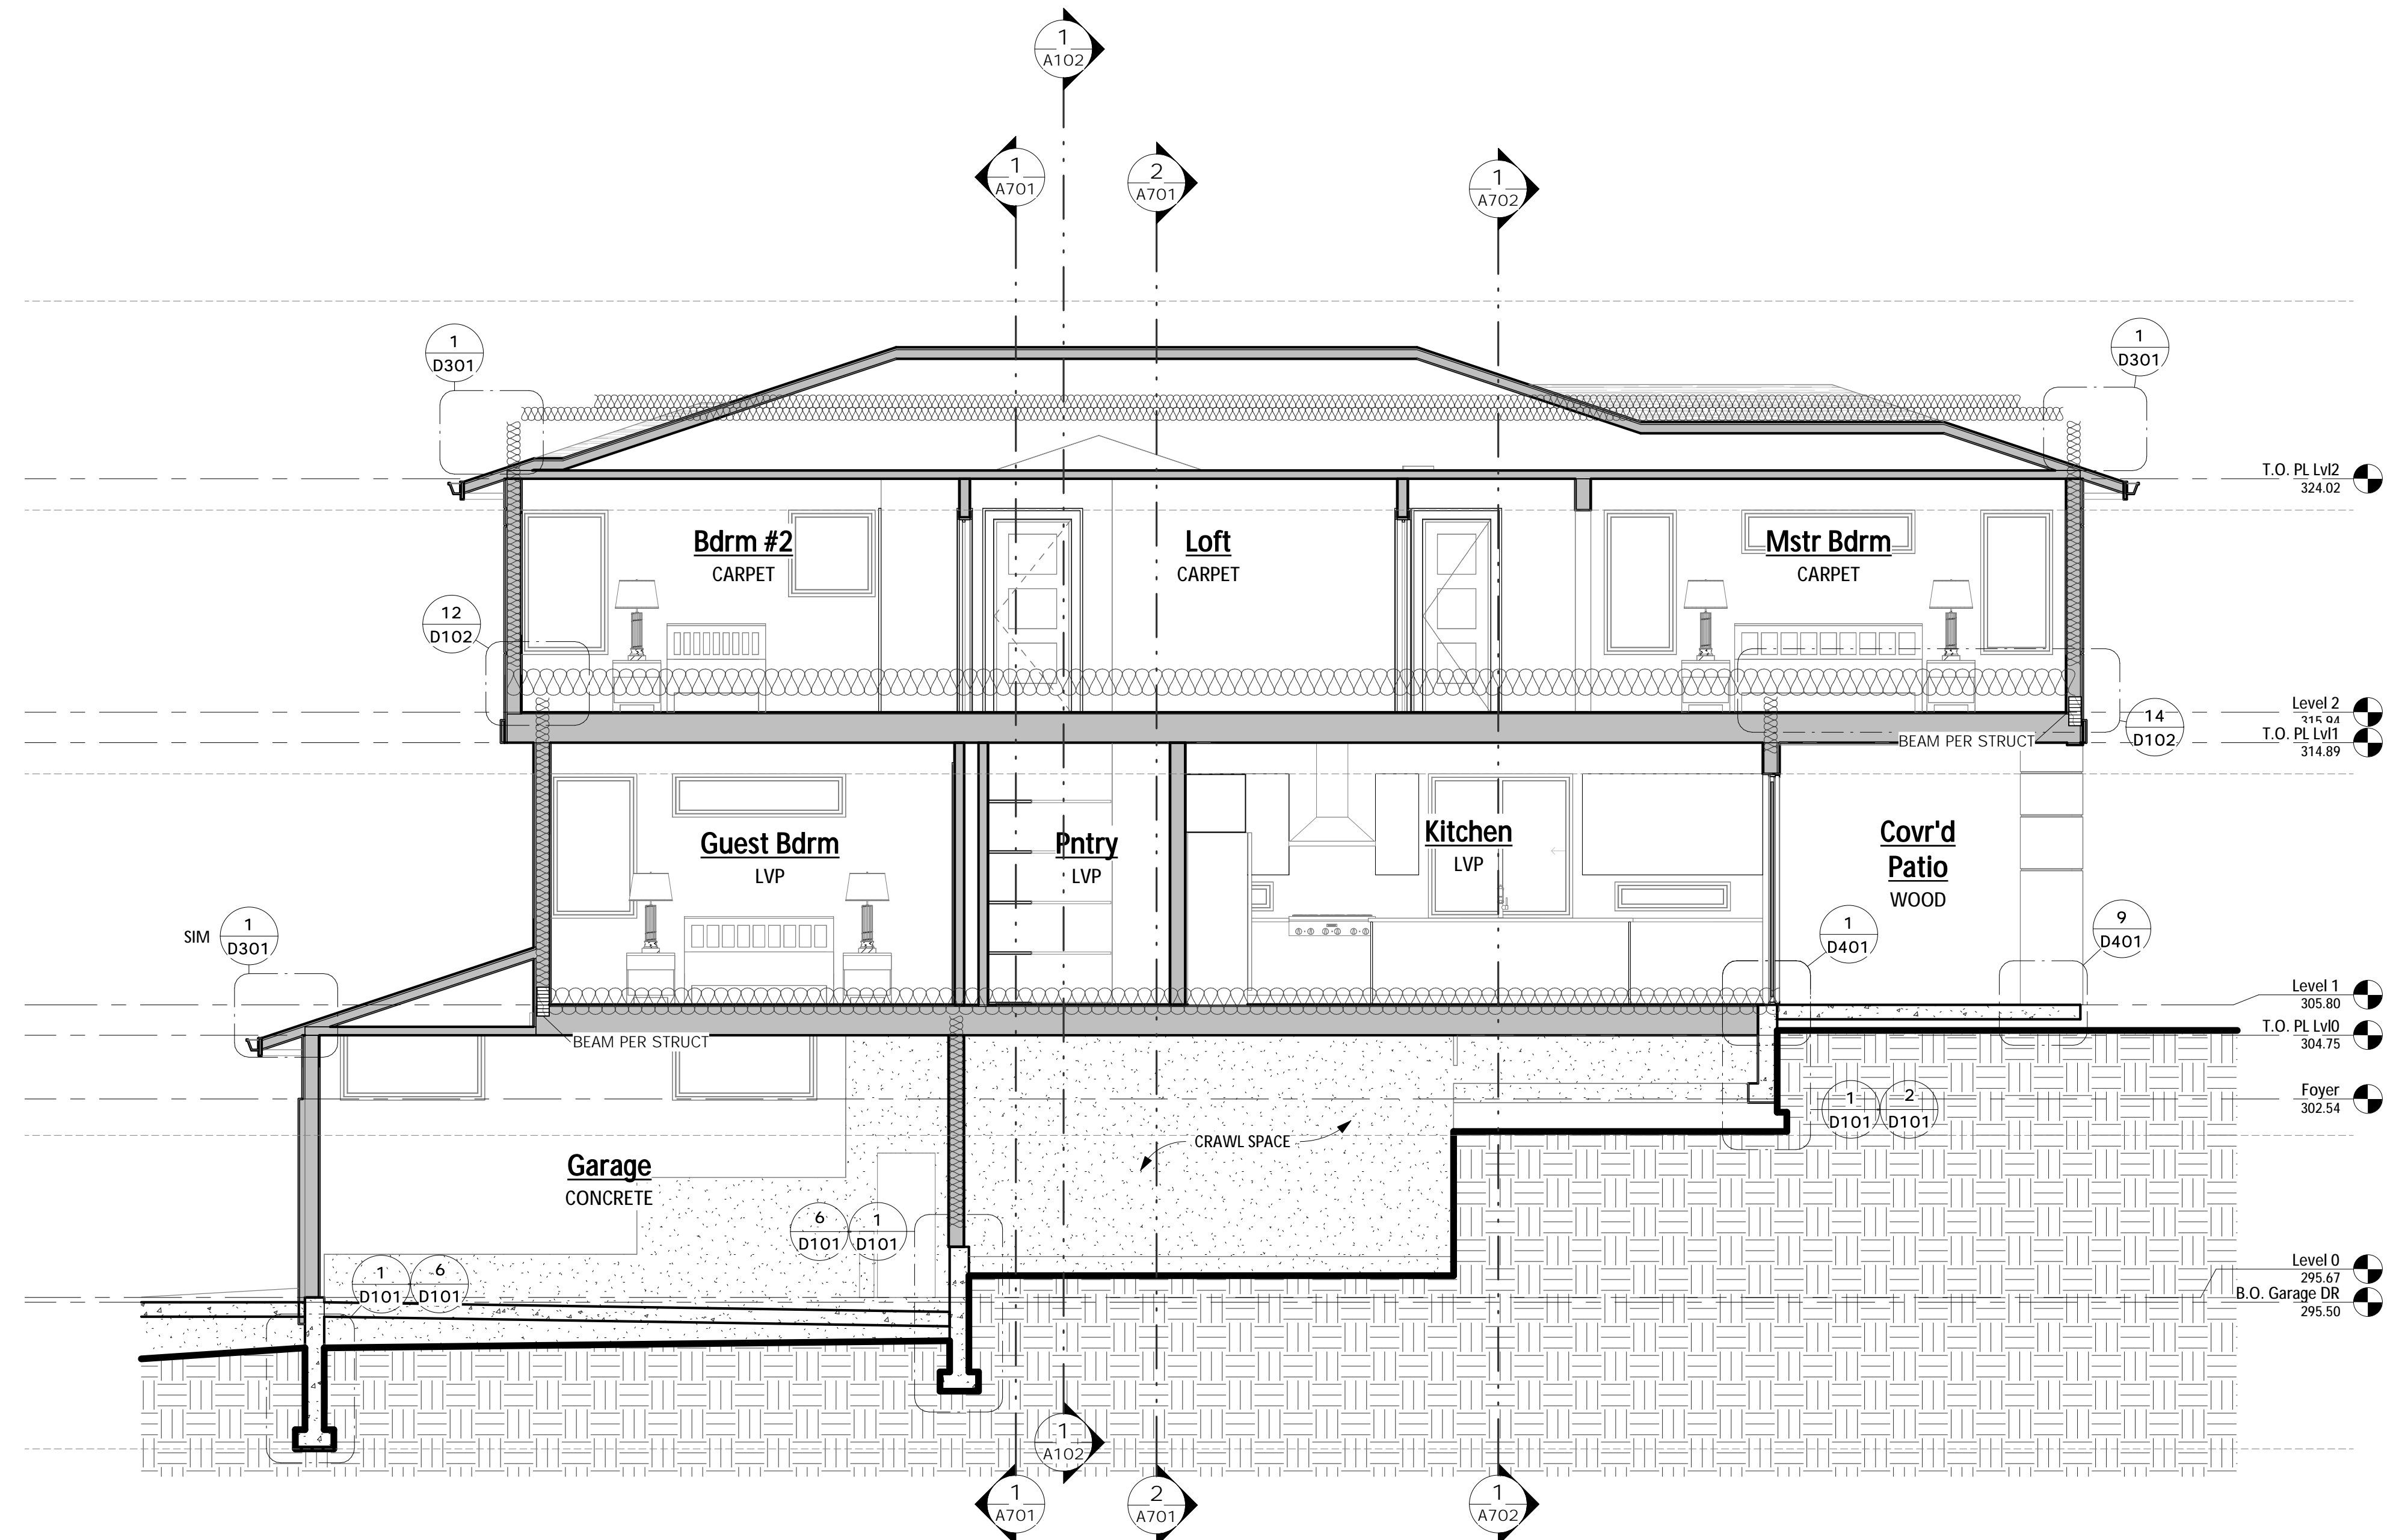

Description

Date

No.



MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET


BUILDING SECTIONS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM


A703

SCALE 24X36: 1/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.


11 INT/EXT WALL FRAMING DETAIL
SCALE: 3/4" = 1'-0"

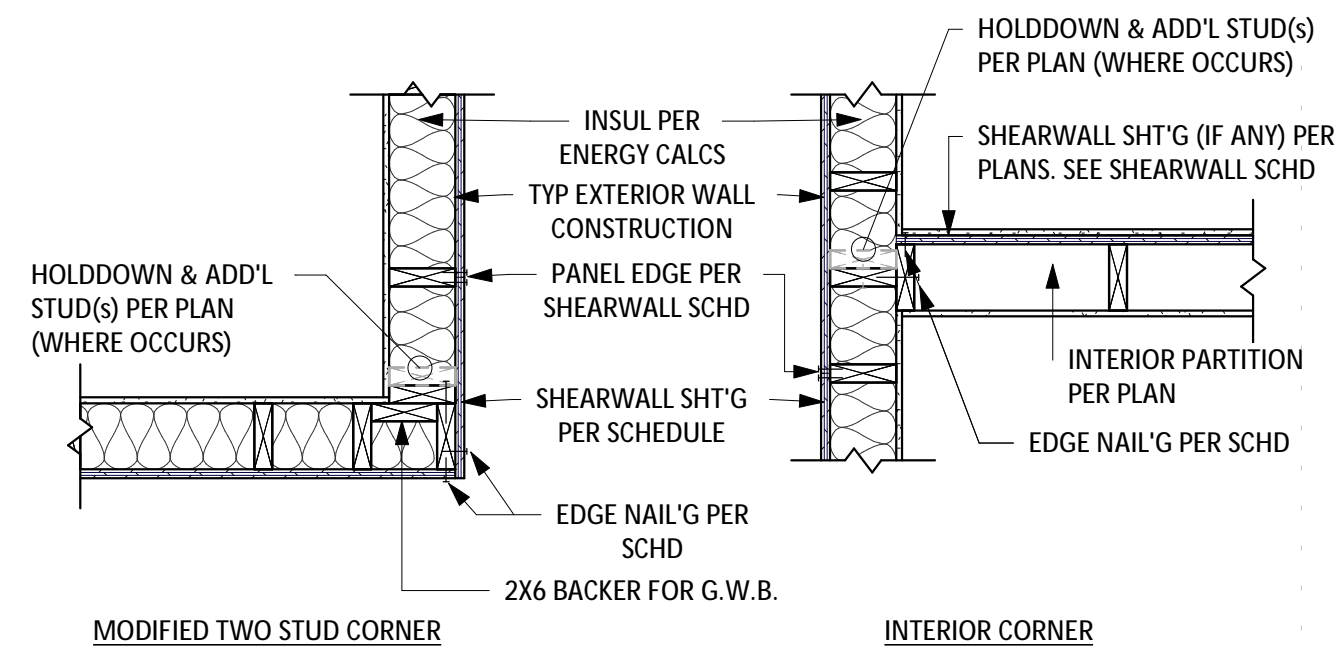


9 CRIPPLE WALL AT FOUNDATION
SCALE: 3/4" = 1'-0"

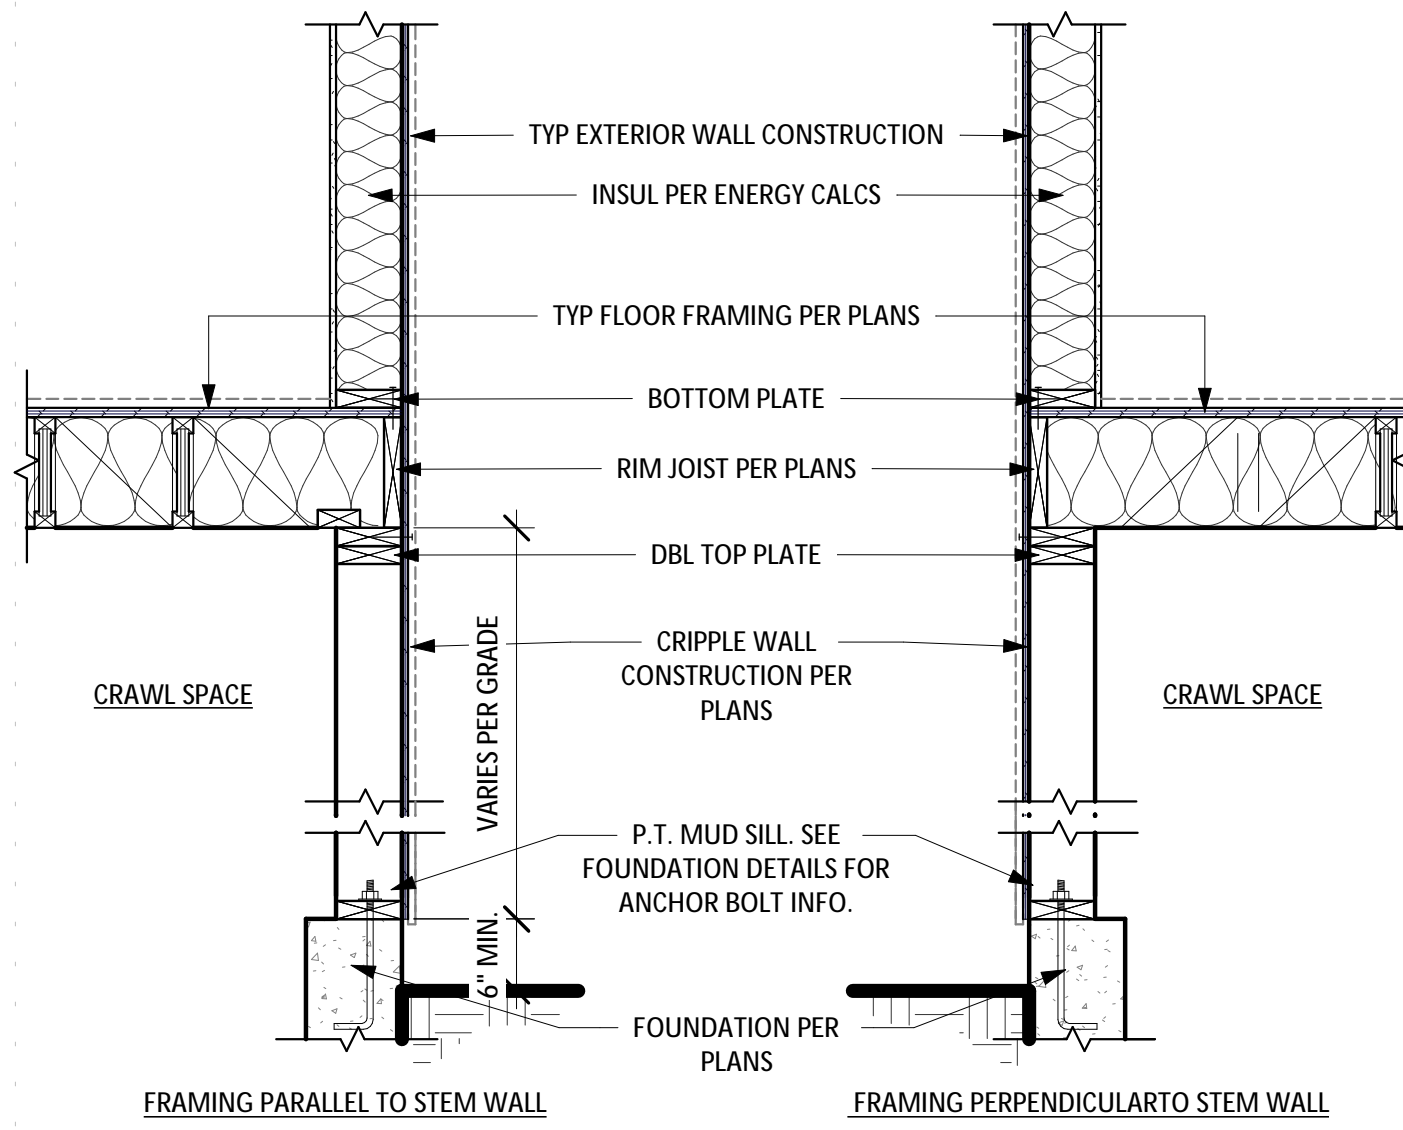


8 POST / FTG CONNECTION
SCALE: 3/4" = 1'-0"

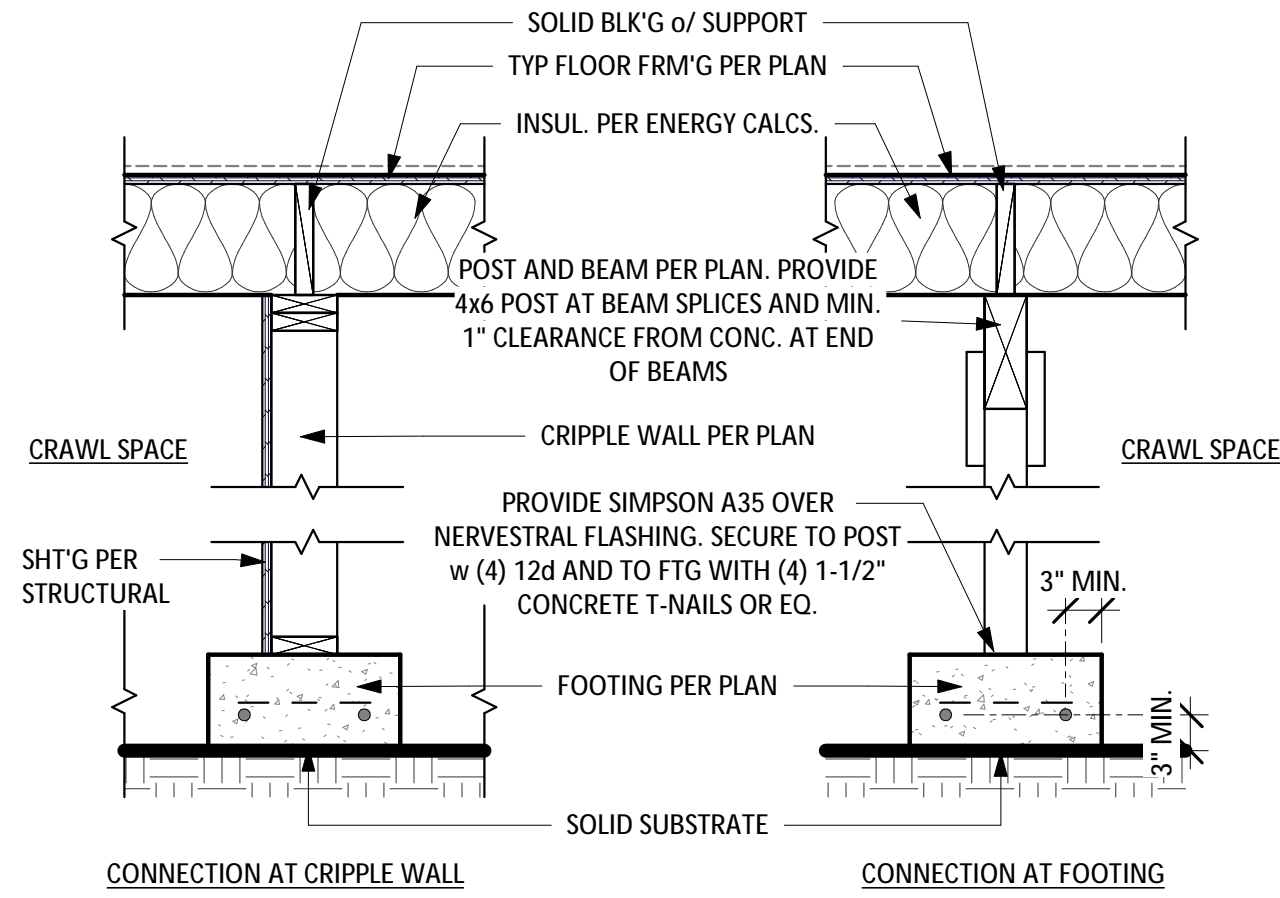


7 CANTILEVER FRM'G AT FNDN.
SCALE: 3/4" = 1'-0"

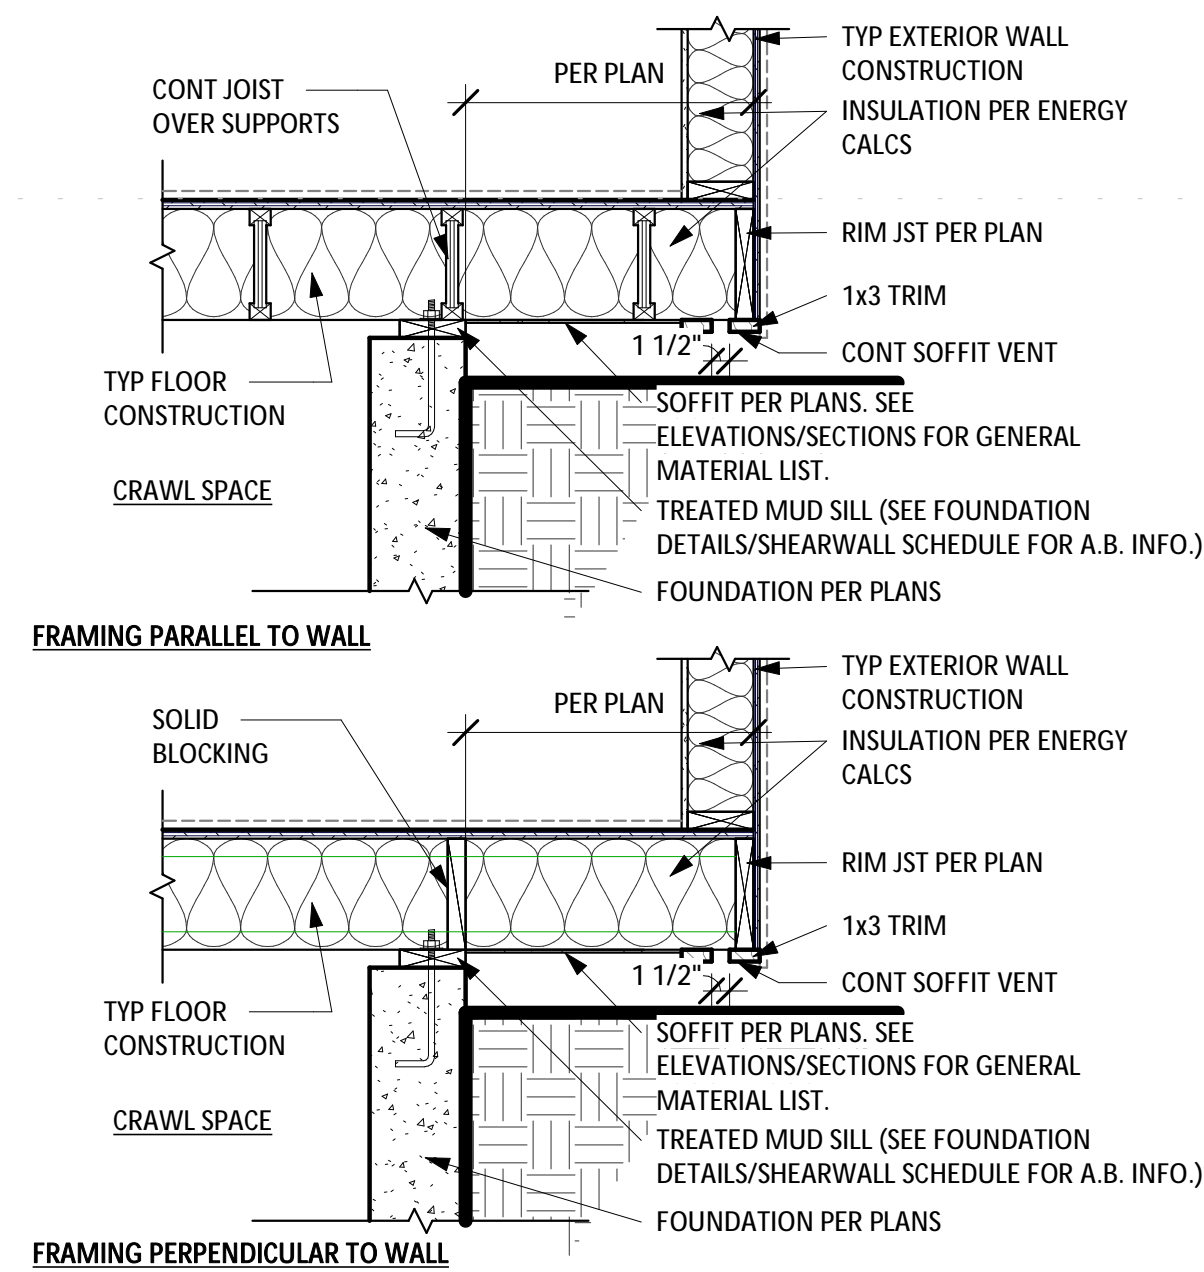


6 SLAB AT STEM WALL
SCALE: 3/4" = 1'-0"

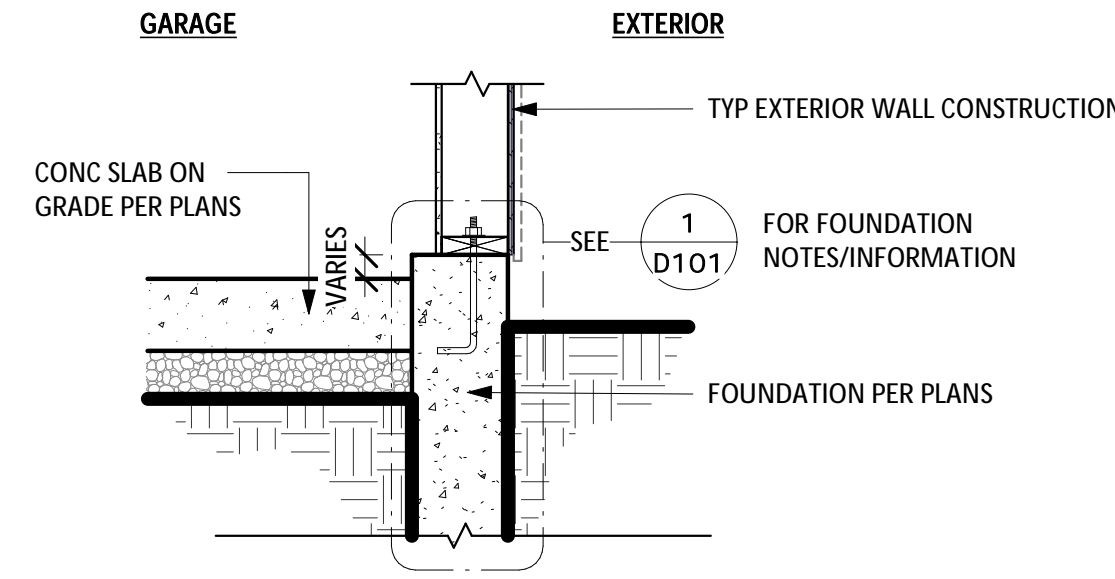


4 BOLLARD DETAIL
SCALE: 1 1/2" = 1'-0"

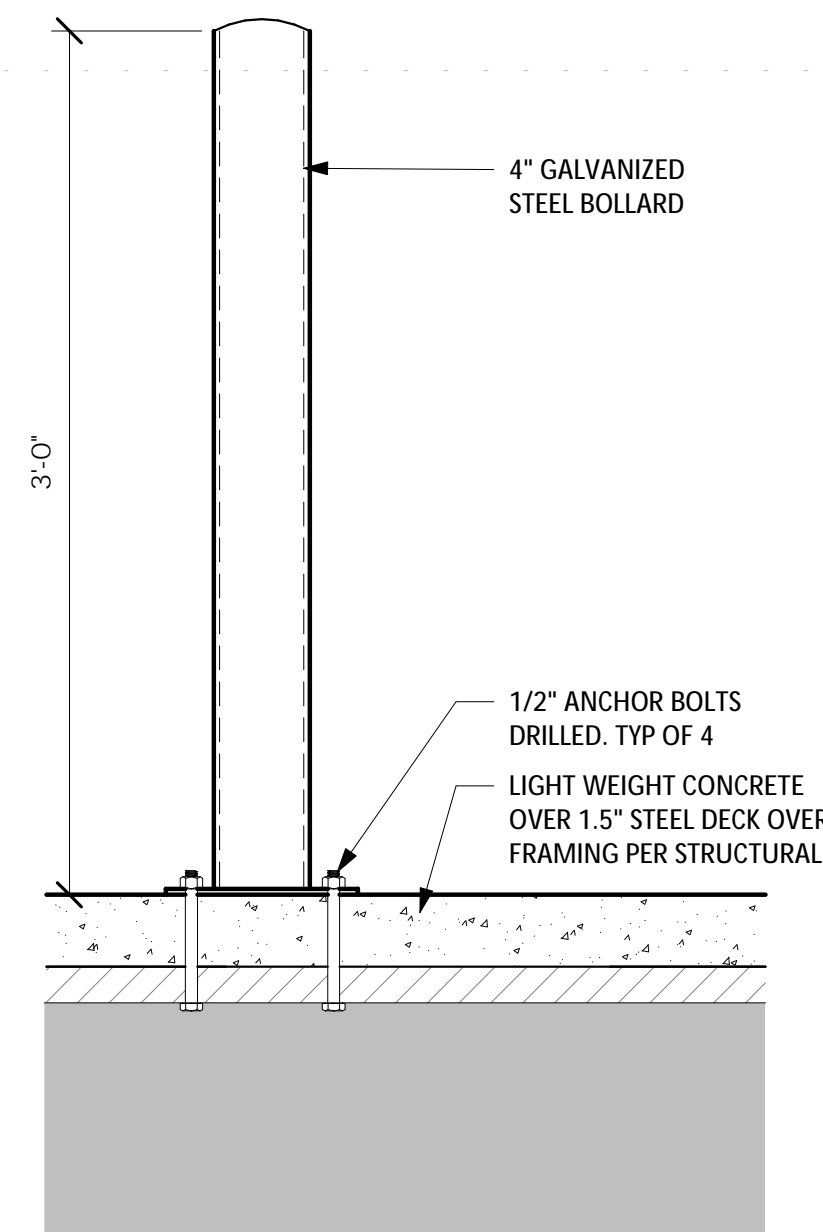


2 FRAMING / FNDN. CONNECTION
SCALE: 3/4" = 1'-0"

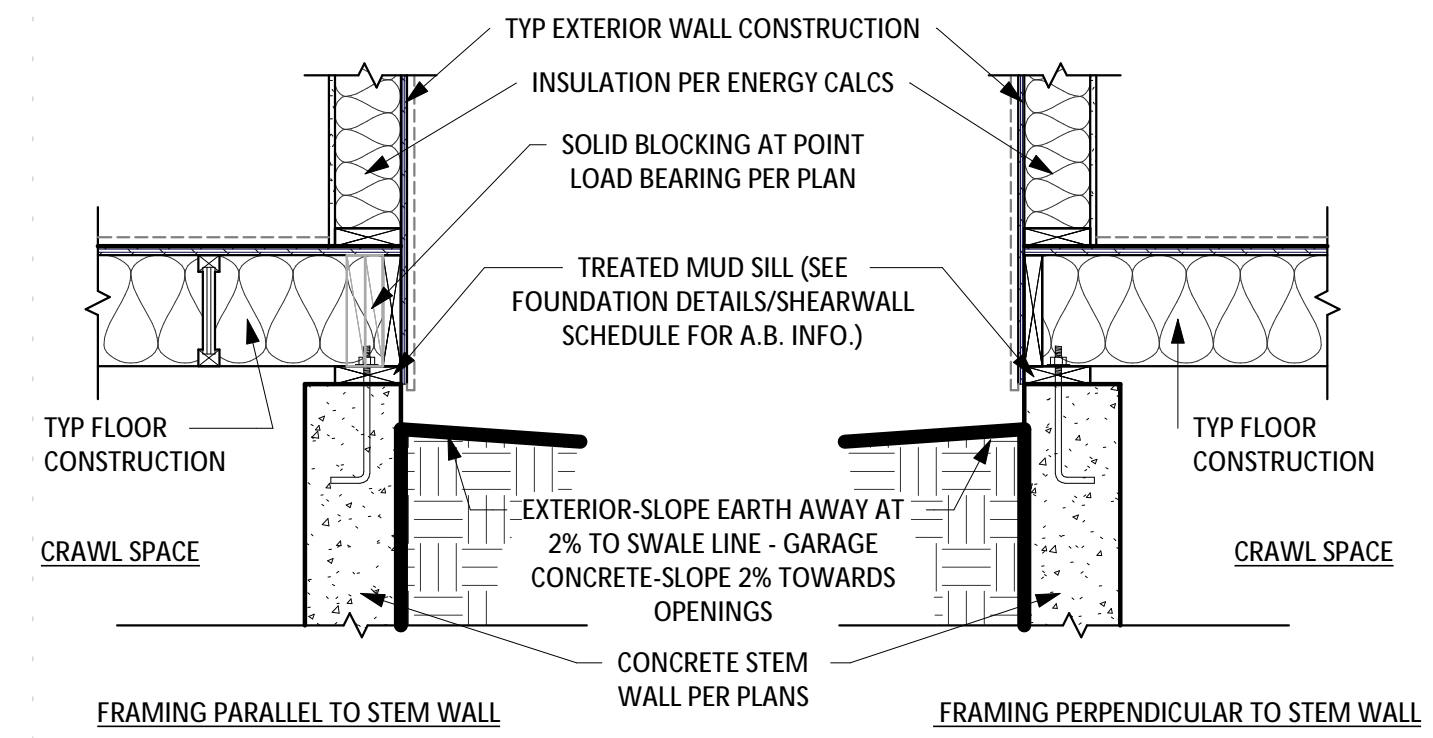

1 FOUNDATION DETAIL
SCALE: 3/4" = 1'-0"

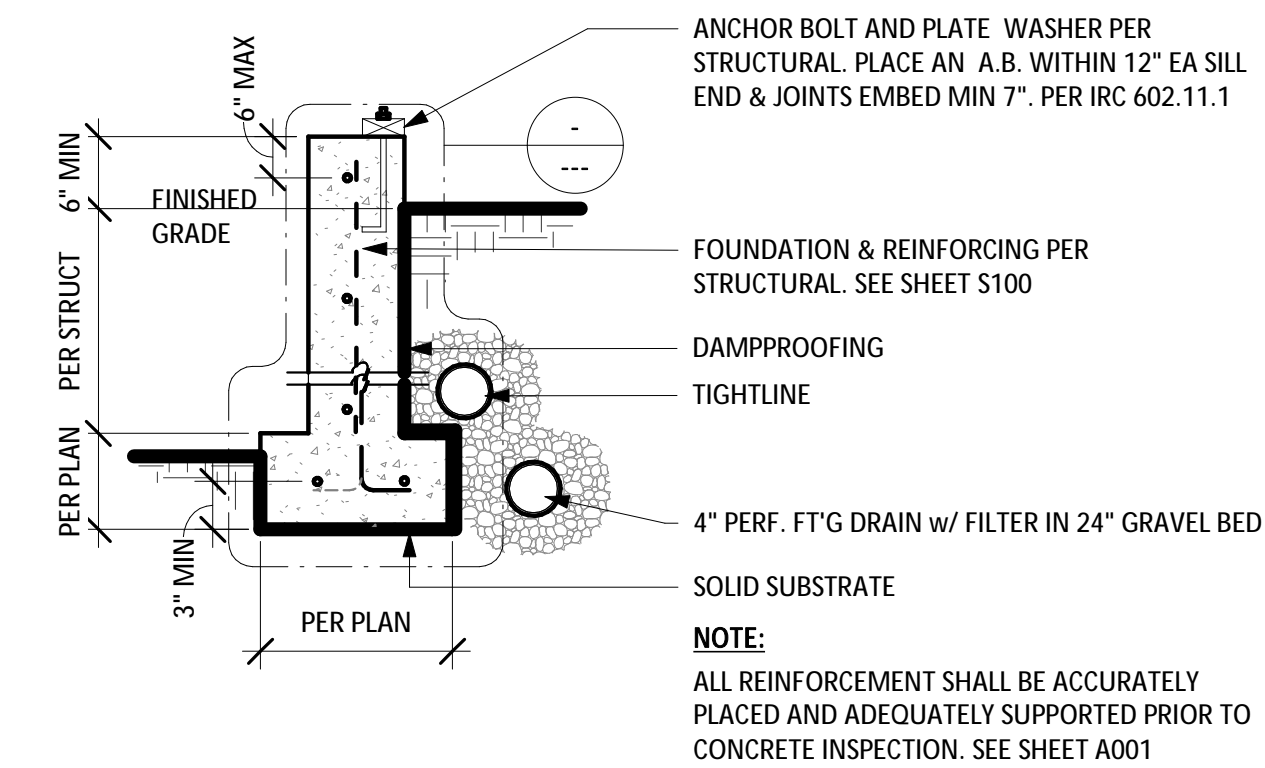

3 FRAMING / FNDN. CONNECTION
SCALE: 3/4" = 1'-0"

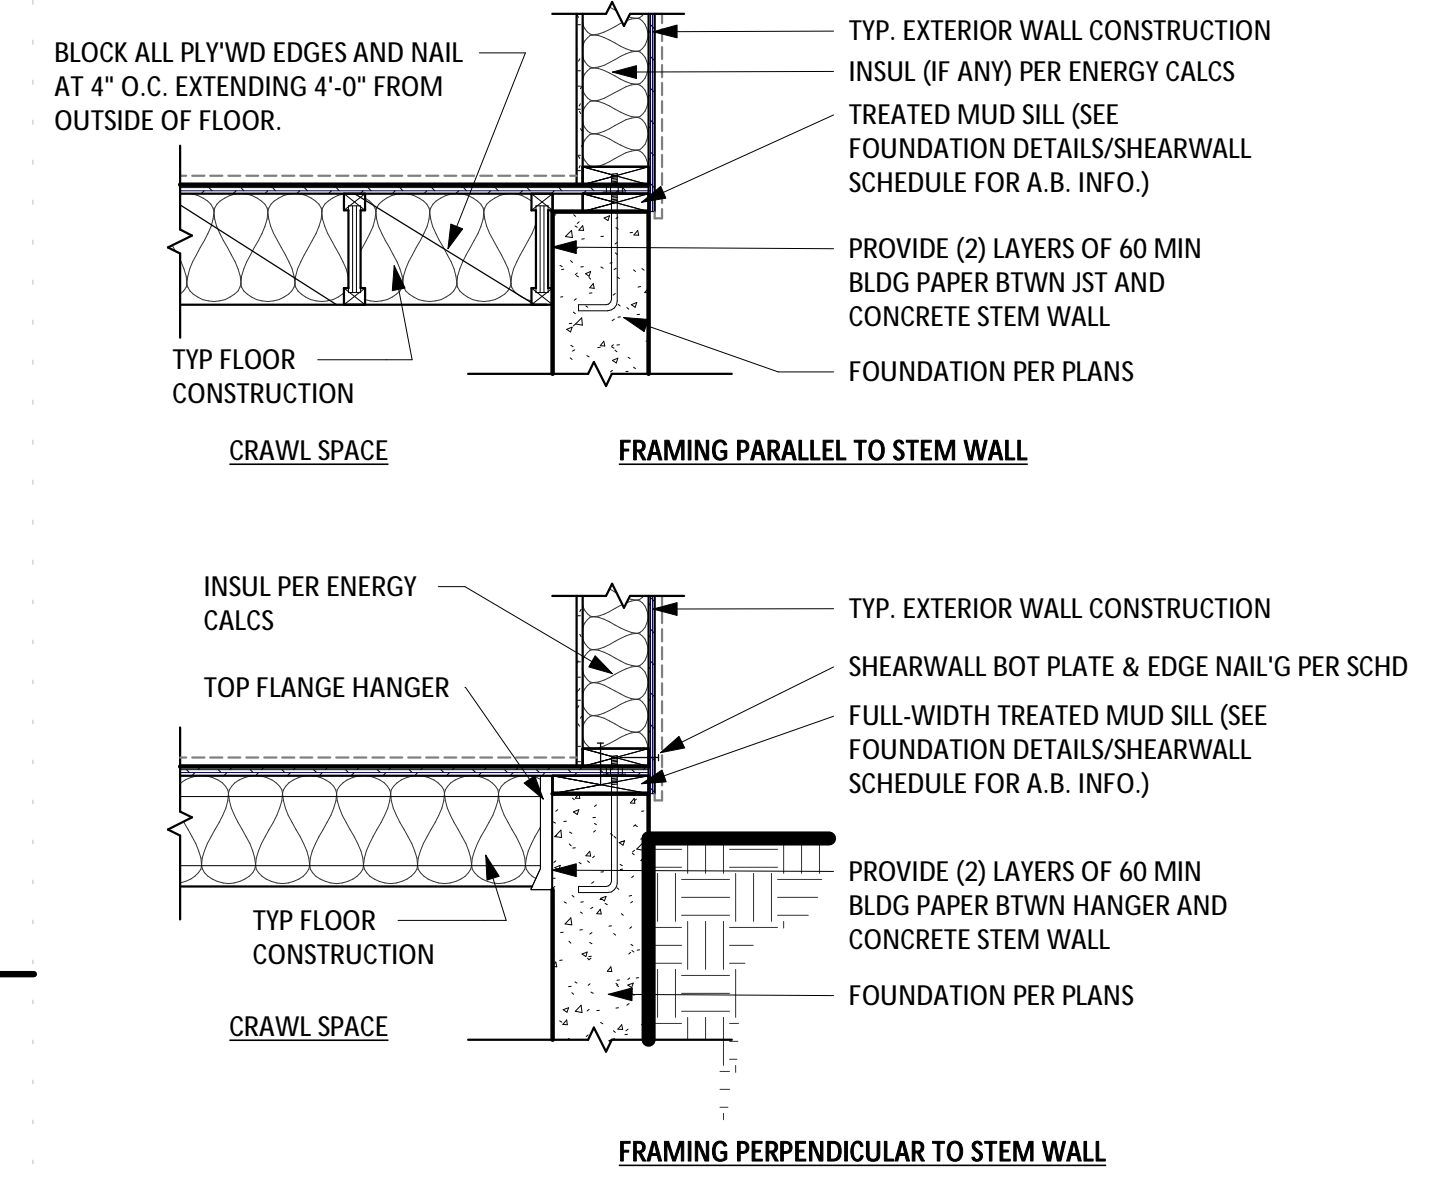

STANDARD DETAIL SHEET

NOTE: THIS IS A STANDARD DETAIL SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET

FOUNDATION & FRAMING DETAILS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM


D101

SCALE 24X36: As indicated
NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.


MONSEF DESIGN STUDIO
451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM




Description
Date
No.

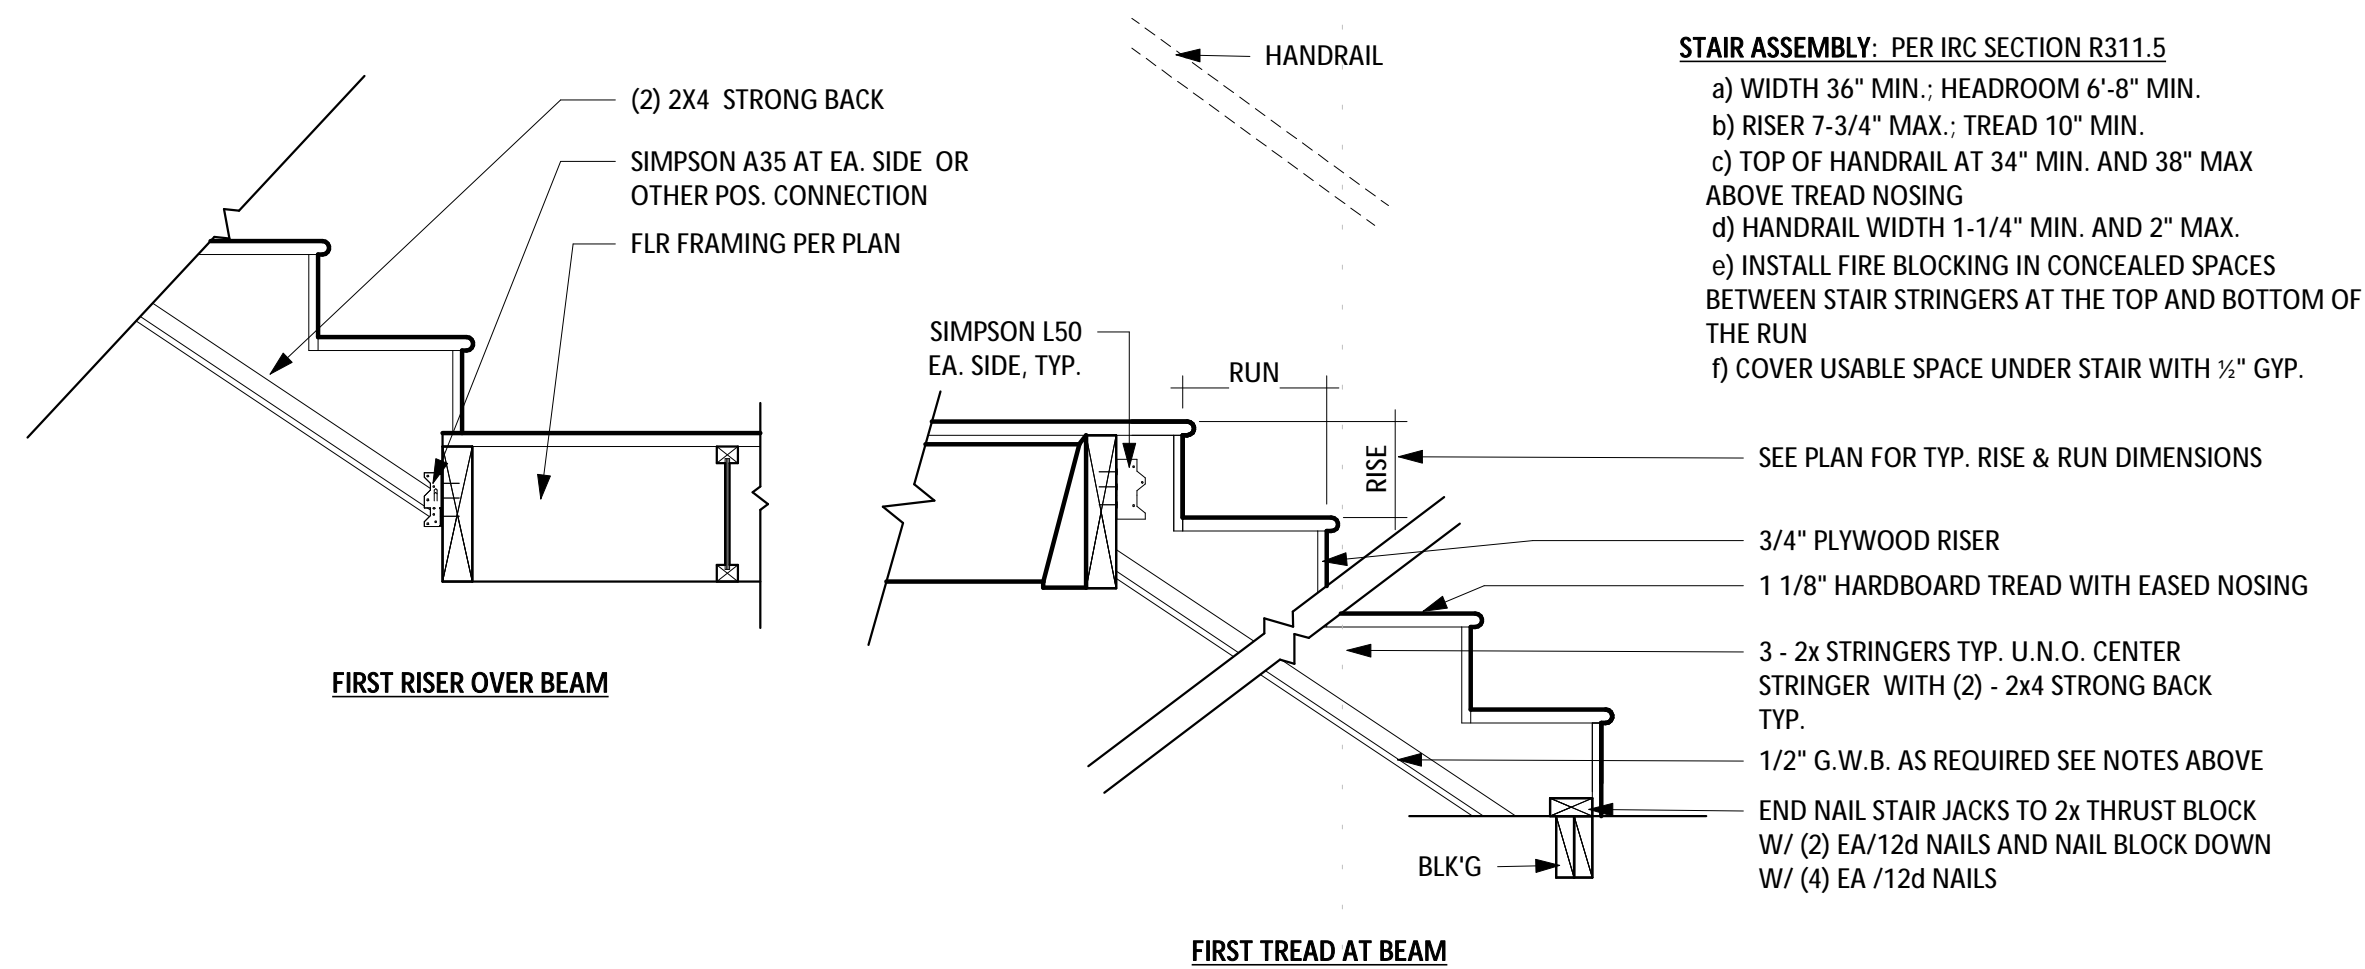


20 STAIR SECTION DETAIL
SCALE: 3/4" = 1'-0"

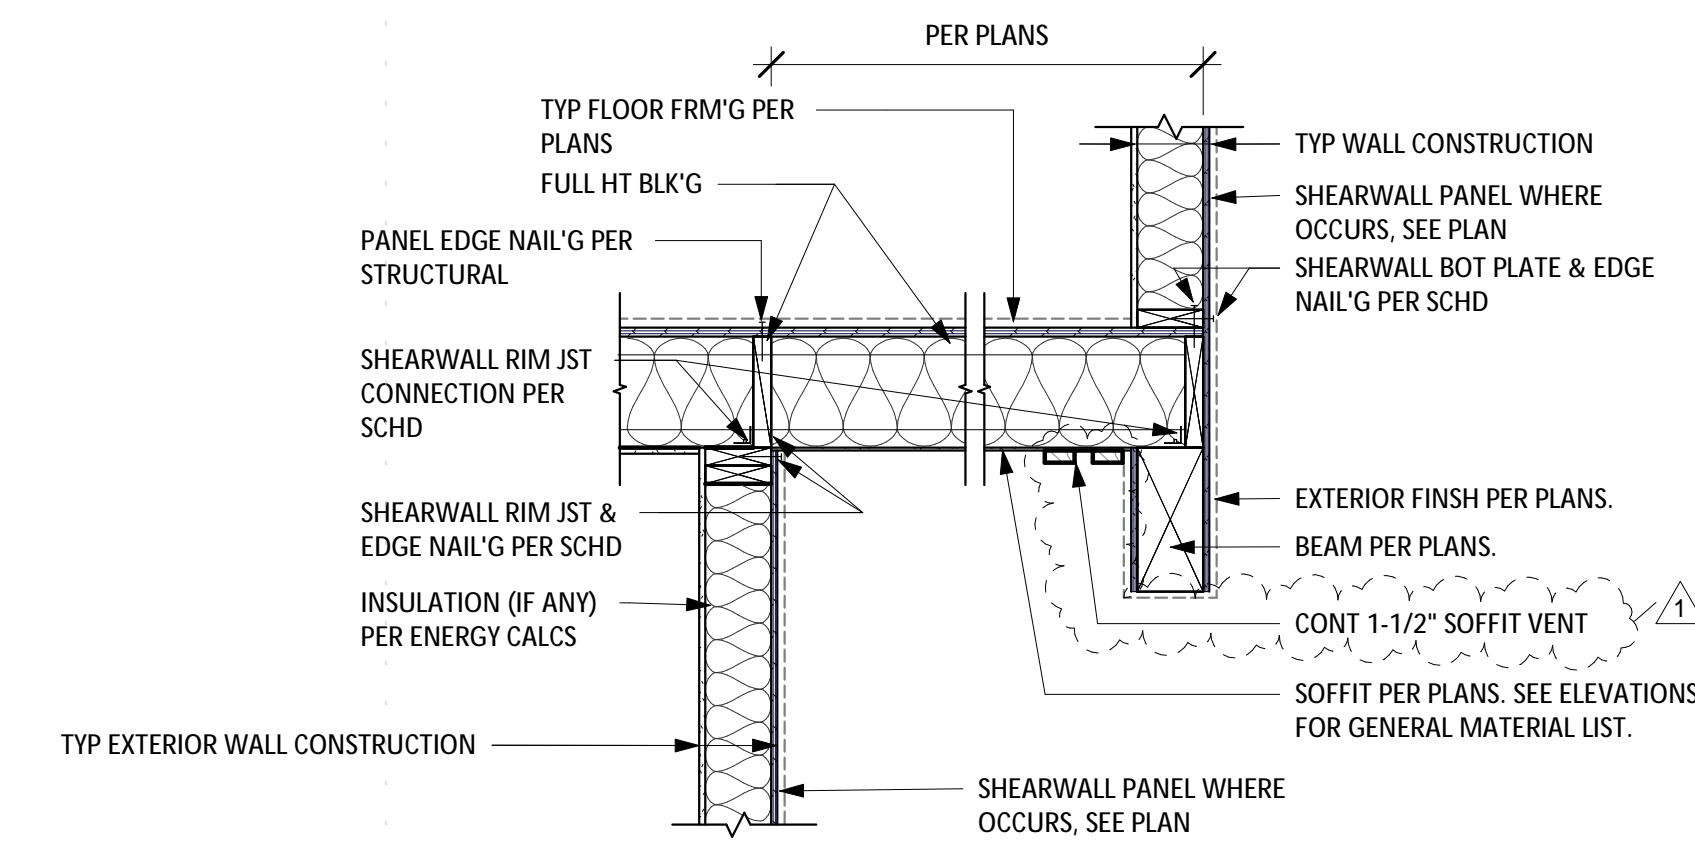

14 CANTILEVER FRM'G AT EXT. WALL
SCALE: 3/4" = 1'-0"

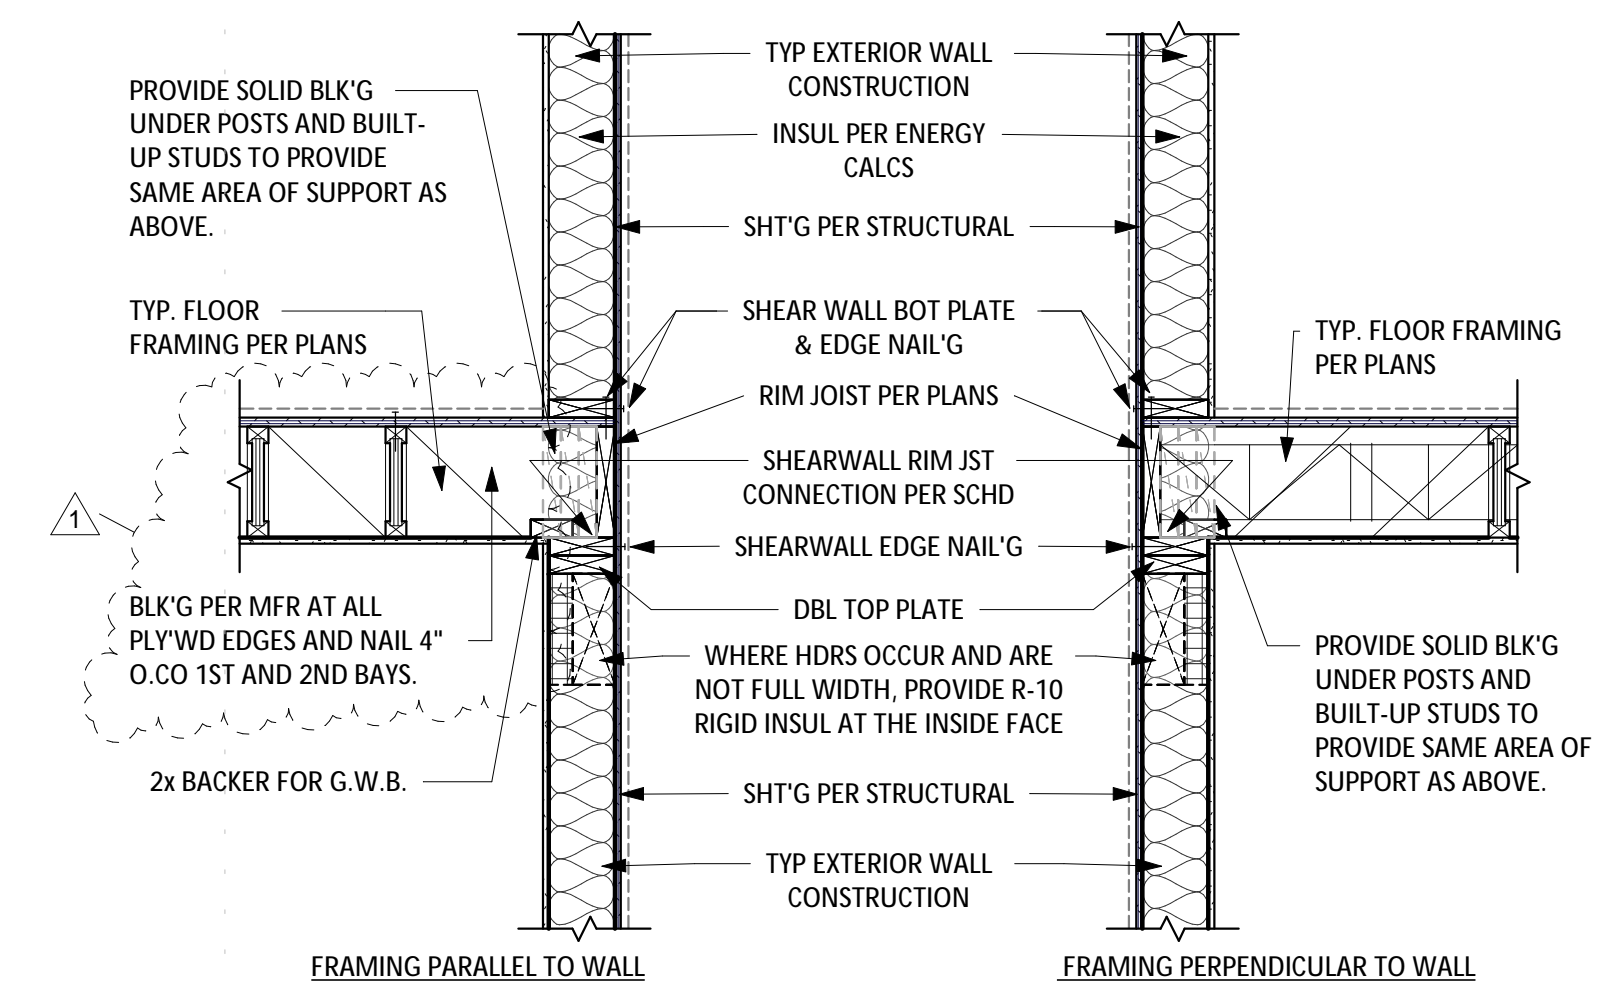

13 EXTERIOR WALL TO FLOOR JOISTS
SCALE: 3/4" = 1'-0"

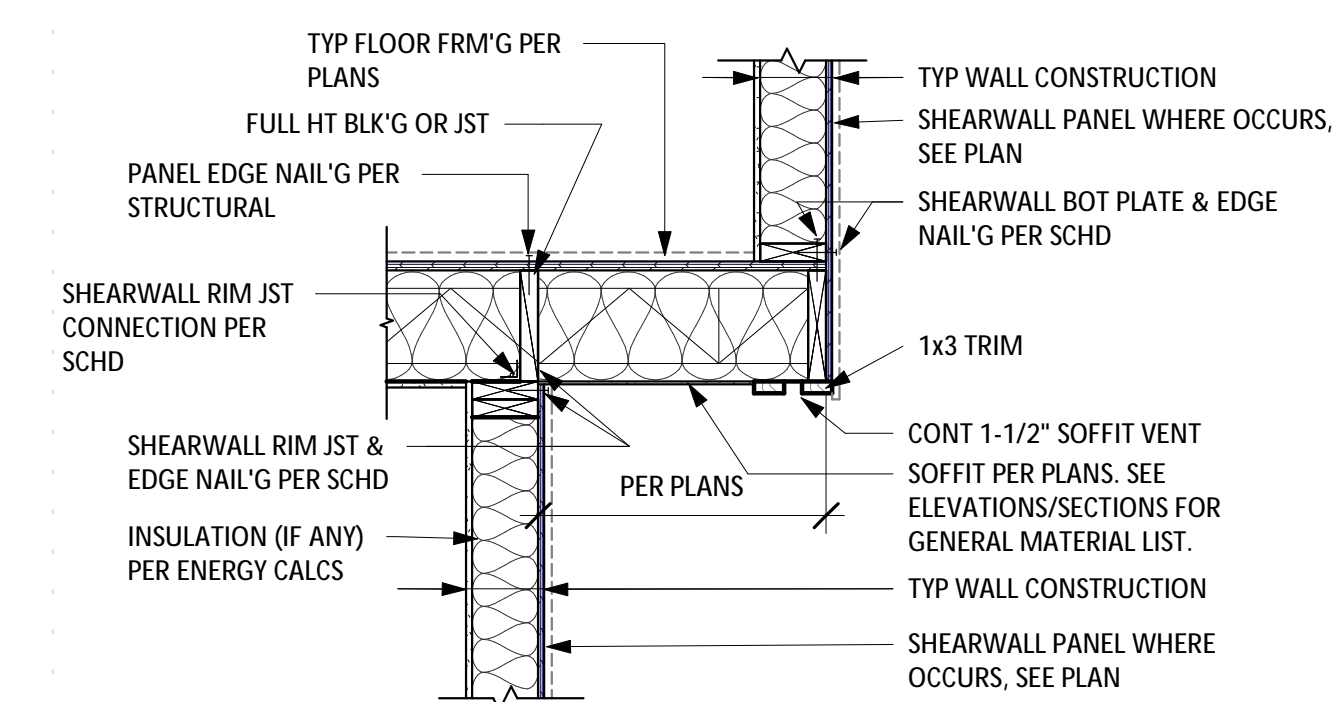

12 CANTILEVER FRM'G AT EXT. WALL
SCALE: 3/4" = 1'-0"

STANDARD DETAIL SHEET

NOTE: THIS IS A STANDARD DETAIL SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

No.	Date	Description
TBD		CITY COMMENTS



MONSEF DESIGN STUDIO
451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET


FRAMING DETAILS

PROJECT NO:	20008
ISSUE DATE:	2023/08/01
SHT ISSUE DATE:	2021/01/08
DRAWN BY:	SPM


D102

SCALE 24X36: 3/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.


4/17/2024 12:32:58 PM Autodesk Docs://20008 Chen Residence, Mercer Island/20008-05 Chen Residence, MI - SUB2.rvt

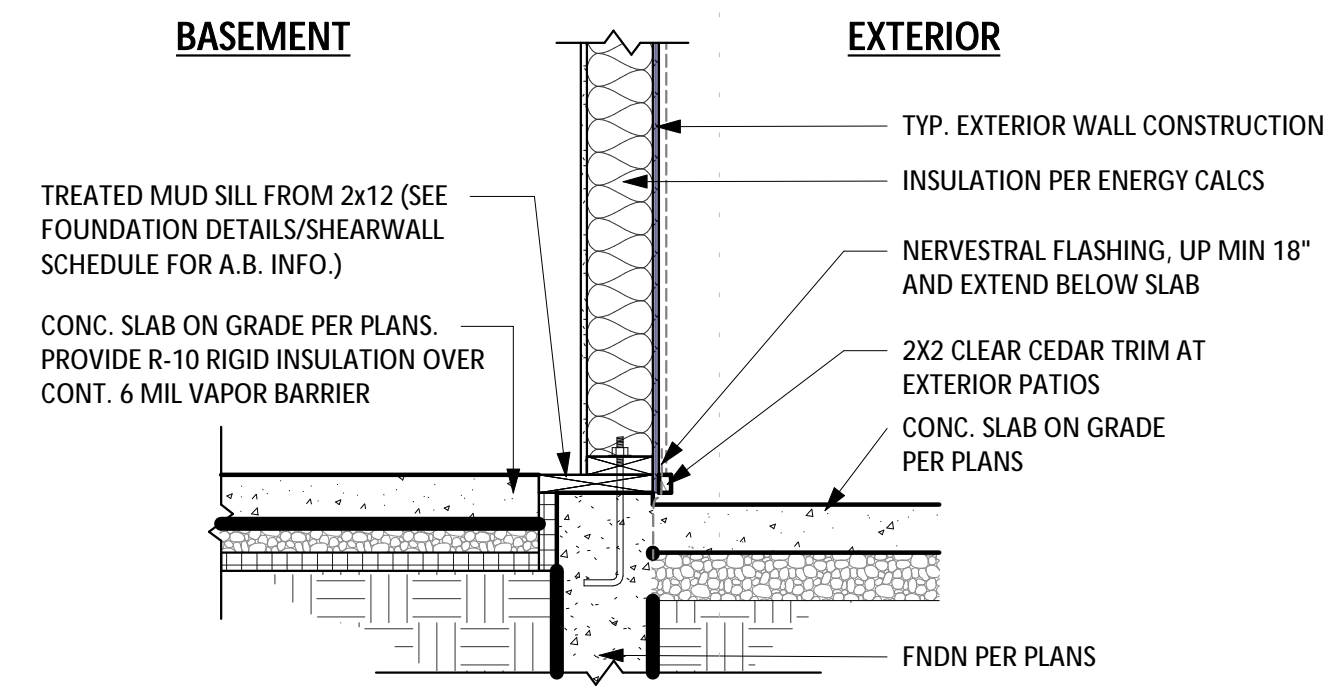


7 FRAMING/FNDN. AT INT SLAB
SCALE: 3/4" = 1'-0"

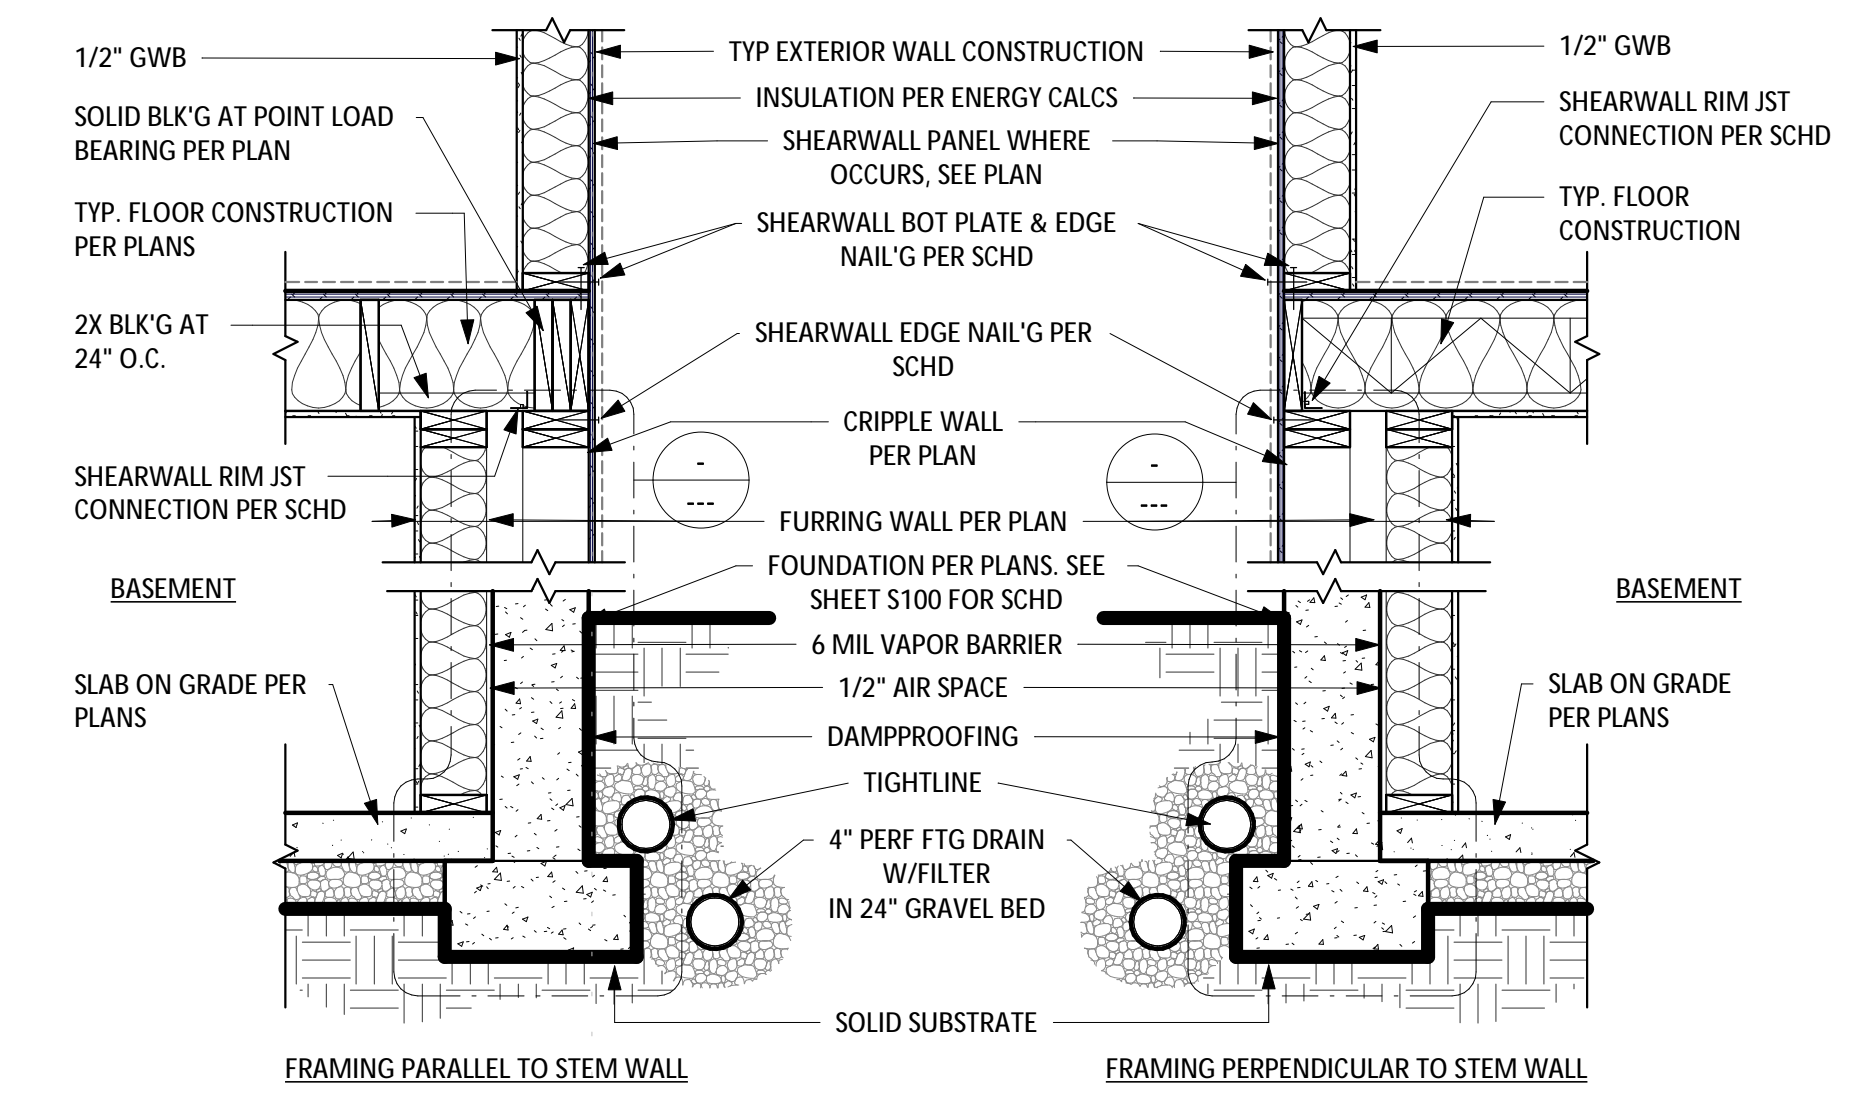

4 FRAMING / FNDN. - CRIPPLE WALL
SCALE: 3/4" = 1'-0"

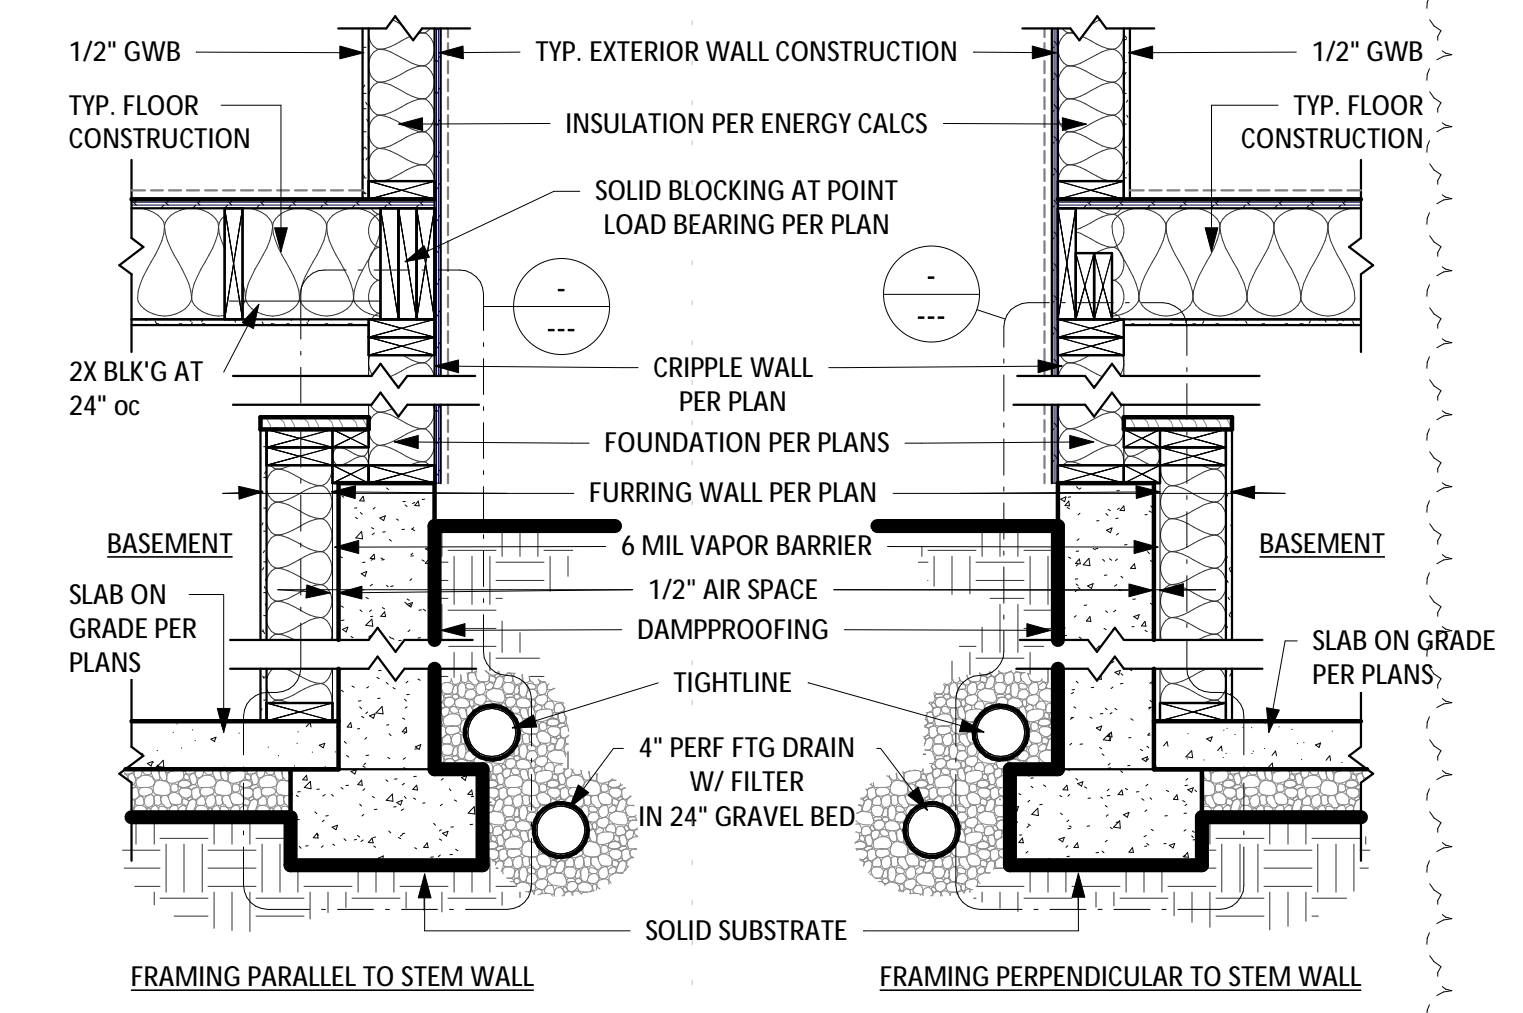

5 FRAMING / FNDN. CONNECTION
SCALE: 3/4" = 1'-0"

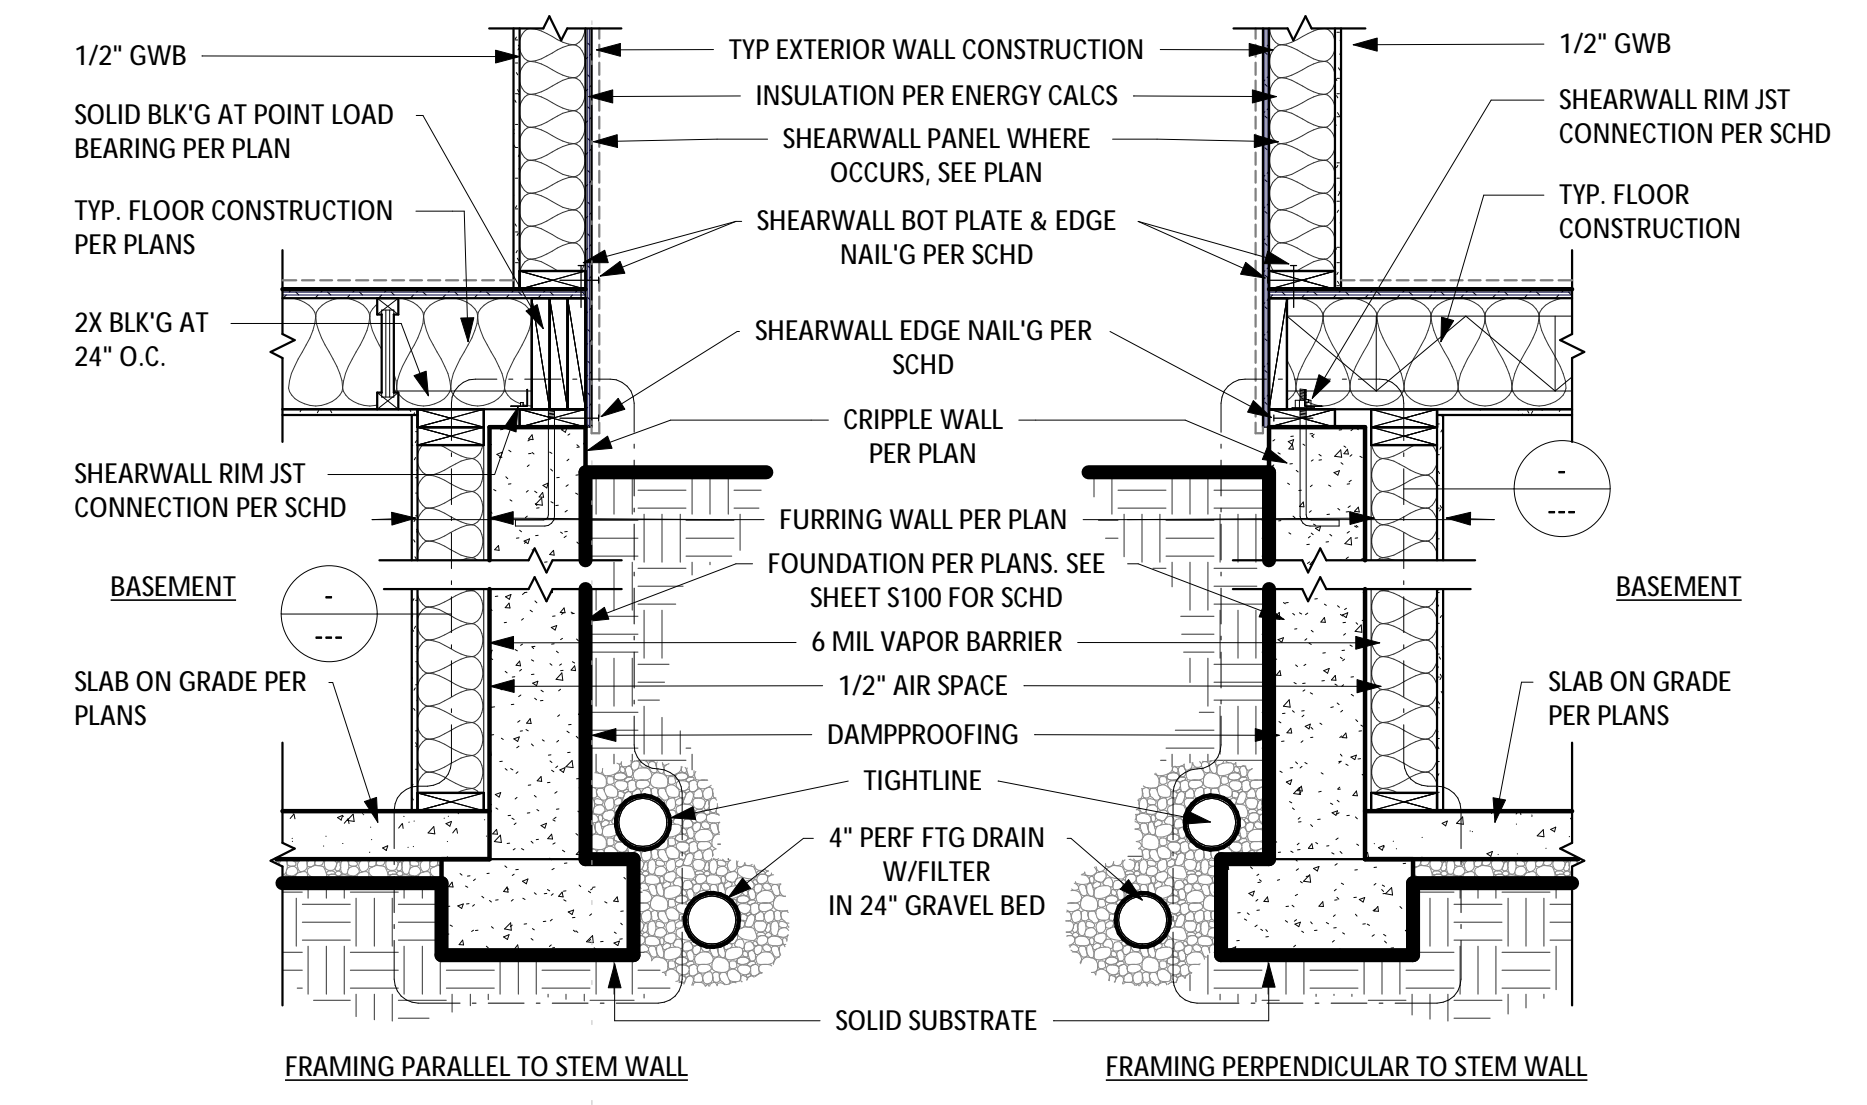

1 FRAMING / FNDN. - FULL HT, JSTS OVER
SCALE: 3/4" = 1'-0"

STANDARD DETAIL SHEET

NOTE: THIS IS A STANDARD DETAIL SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

No.	Date	Description
TBD		CITY COMMENTS



MONSEF DESIGN
STUDIO

451 DUVAL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island


PERMIT SET

BASEMENT
DETAILS


PROJECT NO:	20008
ISSUE DATE:	2023/08/01
SHT ISSUE DATE:	2021/01/08
DRAWN BY:	SPM

D201


SCALE 24X36: 3/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

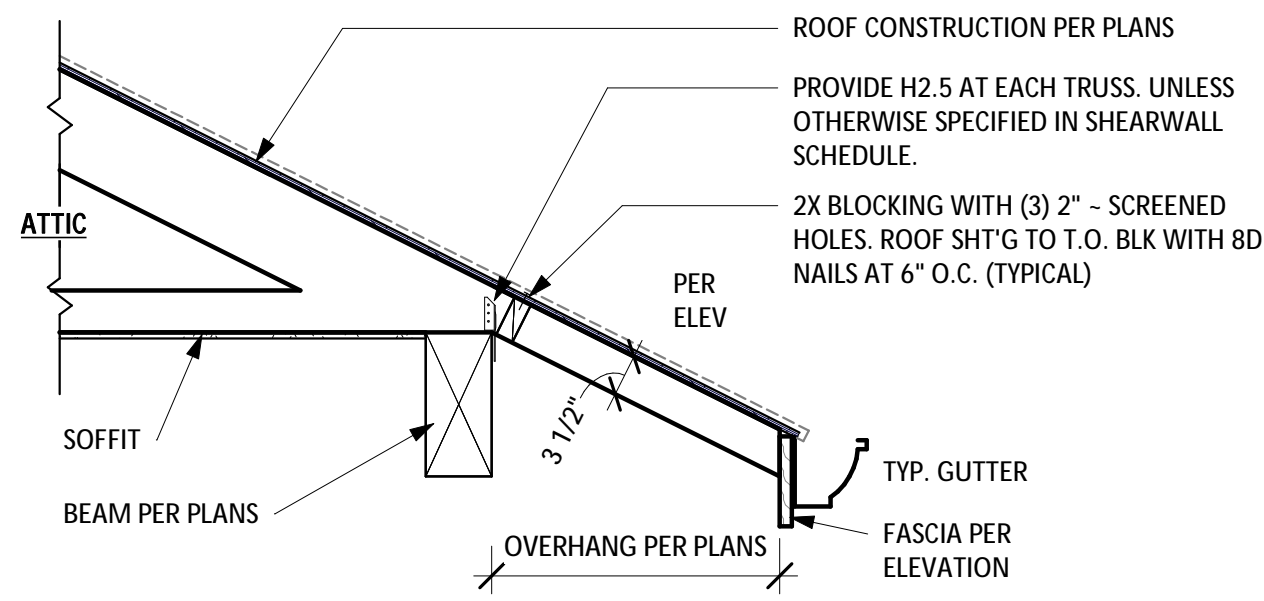


10 EAVE DETAIL - RAFTER
 SCALE: 3/4" = 1'-0"

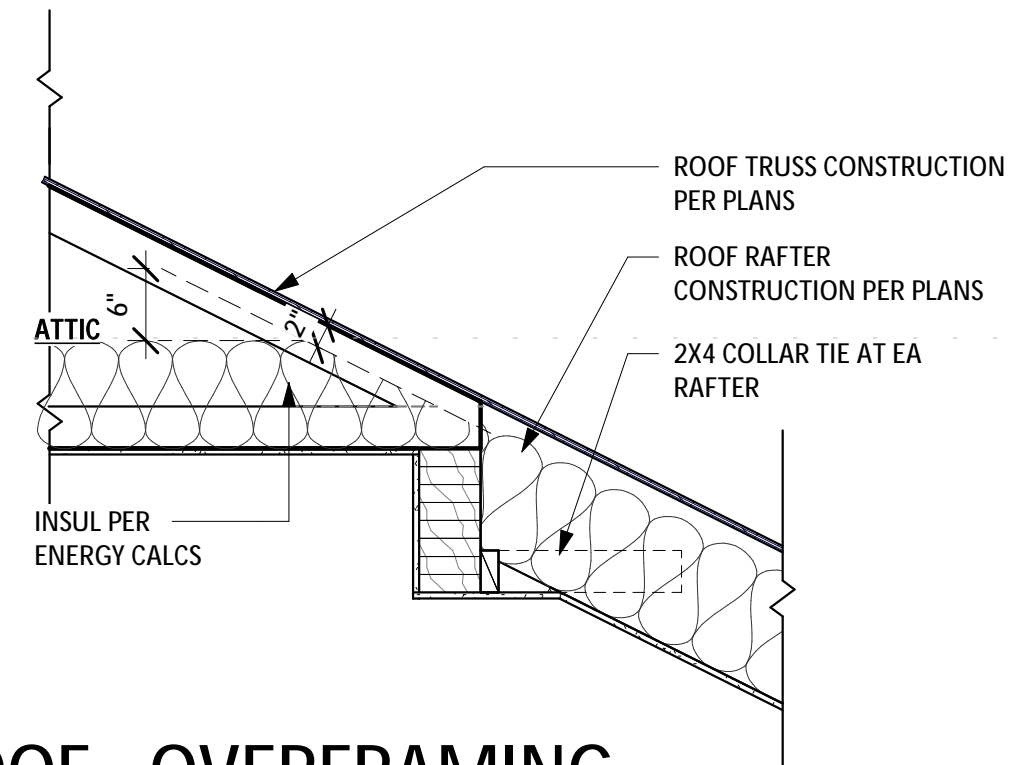


9 ROOF - OVERFRAMING
 SCALE: 3/4" = 1'-0"

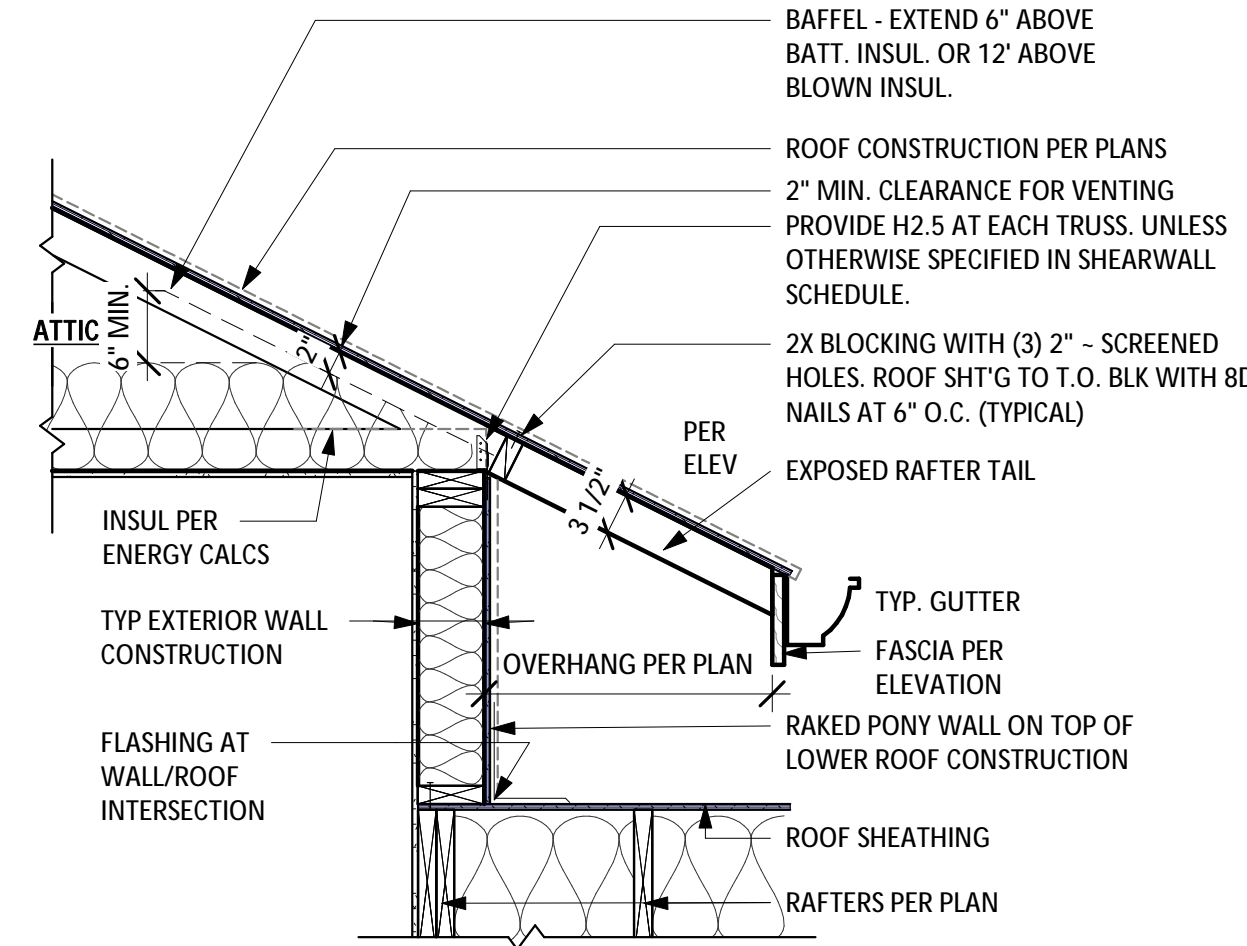

6 EAVE DETAIL OVER PONY WALL
 SCALE: 3/4" = 1'-0"

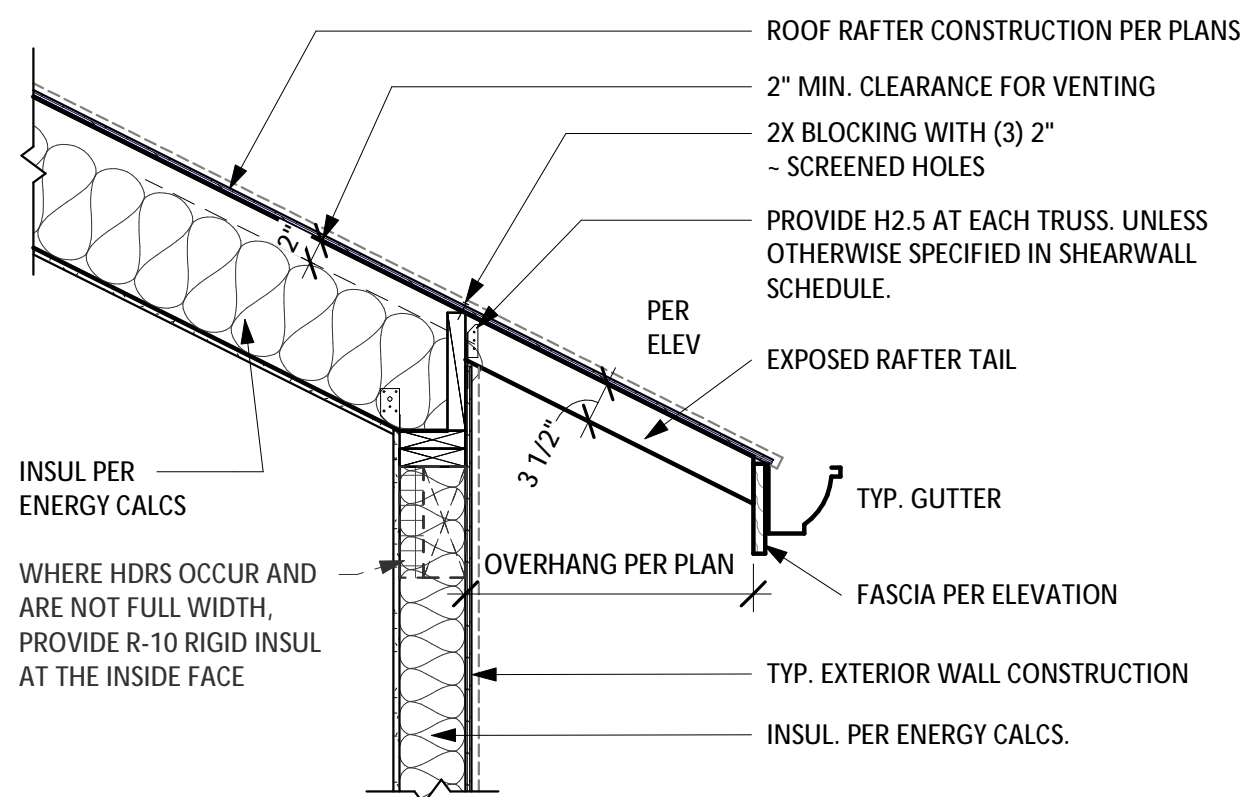

4 EAVE DETAIL - RAFTER
 SCALE: 3/4" = 1'-0"

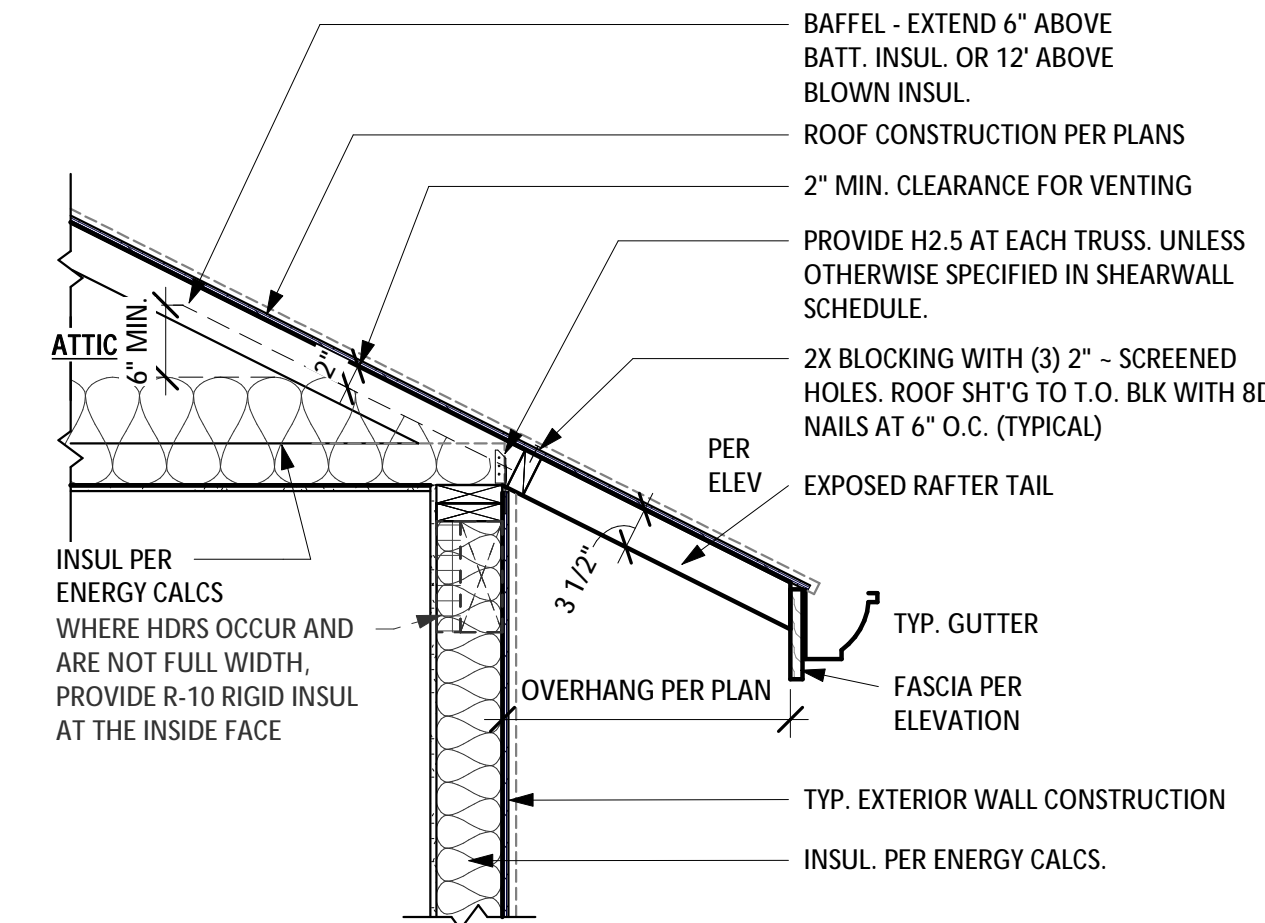

1 EAVE DETAIL - TRUSS
 SCALE: 3/4" = 1'-0"

STANDARD DETAIL SHEET

NOTE: THIS IS A STANDARD DETAIL SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

No. _____
 Date _____
 Description _____



MONSEF DESIGN
 STUDIO
 451 DUVAL AVE NE, RENTON, WA 98059
 206.612.8647 | WWW.ATERAHOMES.COM


Chen Residence
 5024 W Mercer Way, Mercer Island

PERMIT SET
 ROOF DETAILS


PROJECT NO: 20008
 ISSUE DATE: 2023/08/01
 SHT ISSUE DATE: 2021/01/08
 DRAWN BY: SPM

D301


SCALE 24X36: 3/4" = 1'-0"
 * NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

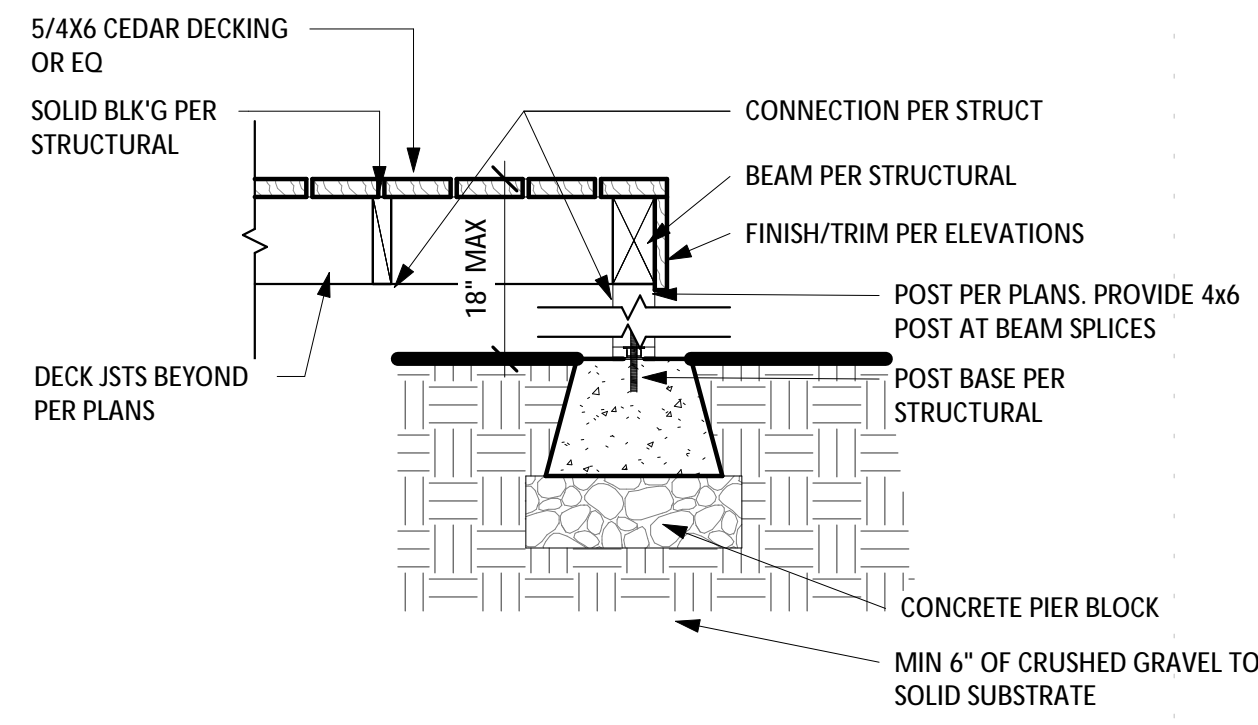


9 FRM'G CONNECTION @ DECK
SCALE: 3/4" = 1'-0"

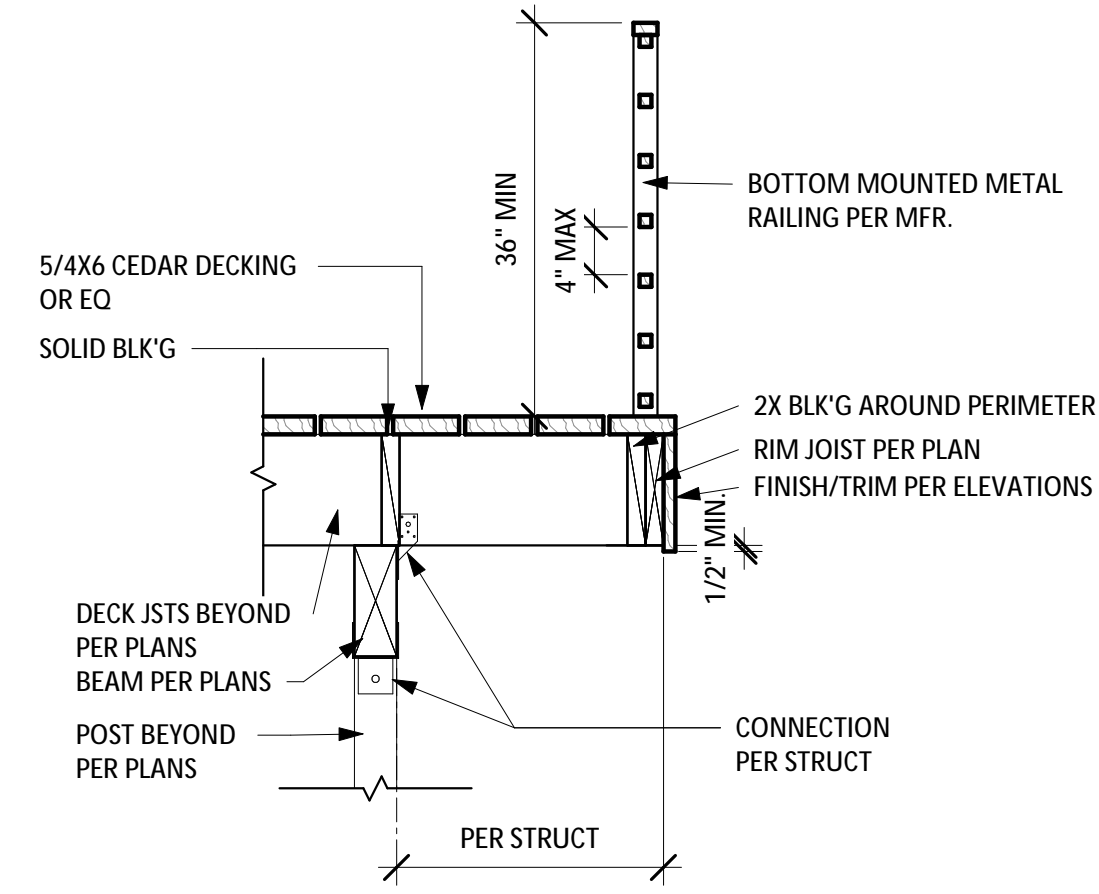


6 FRM'G CONNECTION @ DECK RAILING
SCALE: 3/4" = 1'-0"

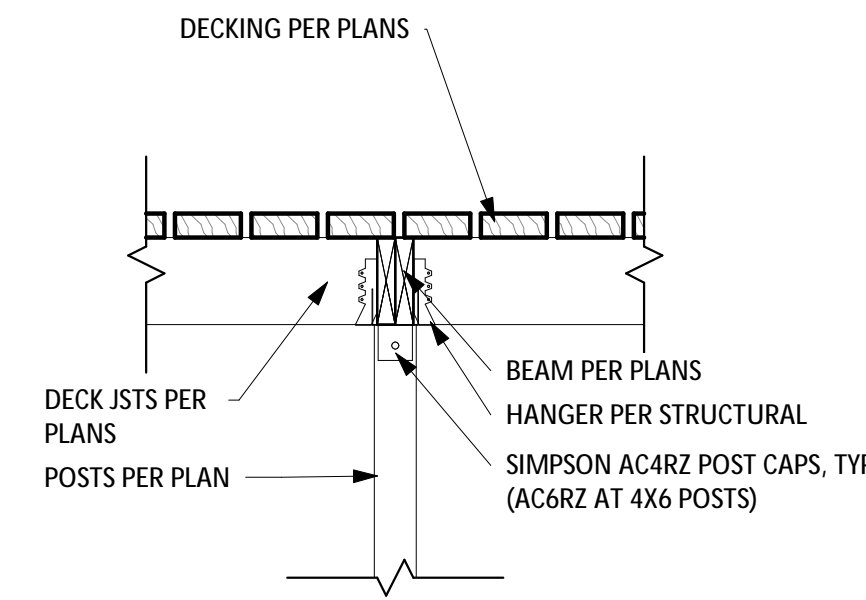


5 FRM'G CONNECTION @ DECK POST
SCALE: 3/4" = 1'-0"

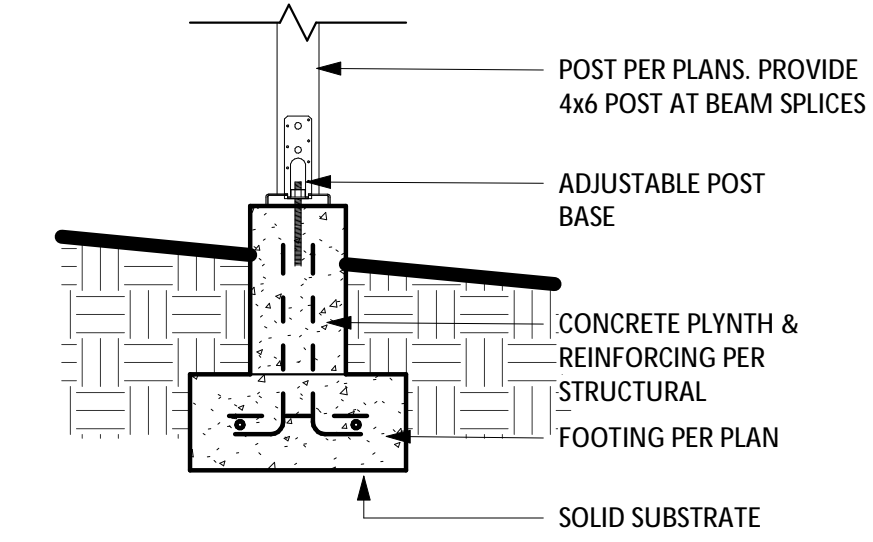

2 FRM'G CONNECTION @ DECK POST
SCALE: 3/4" = 1'-0"

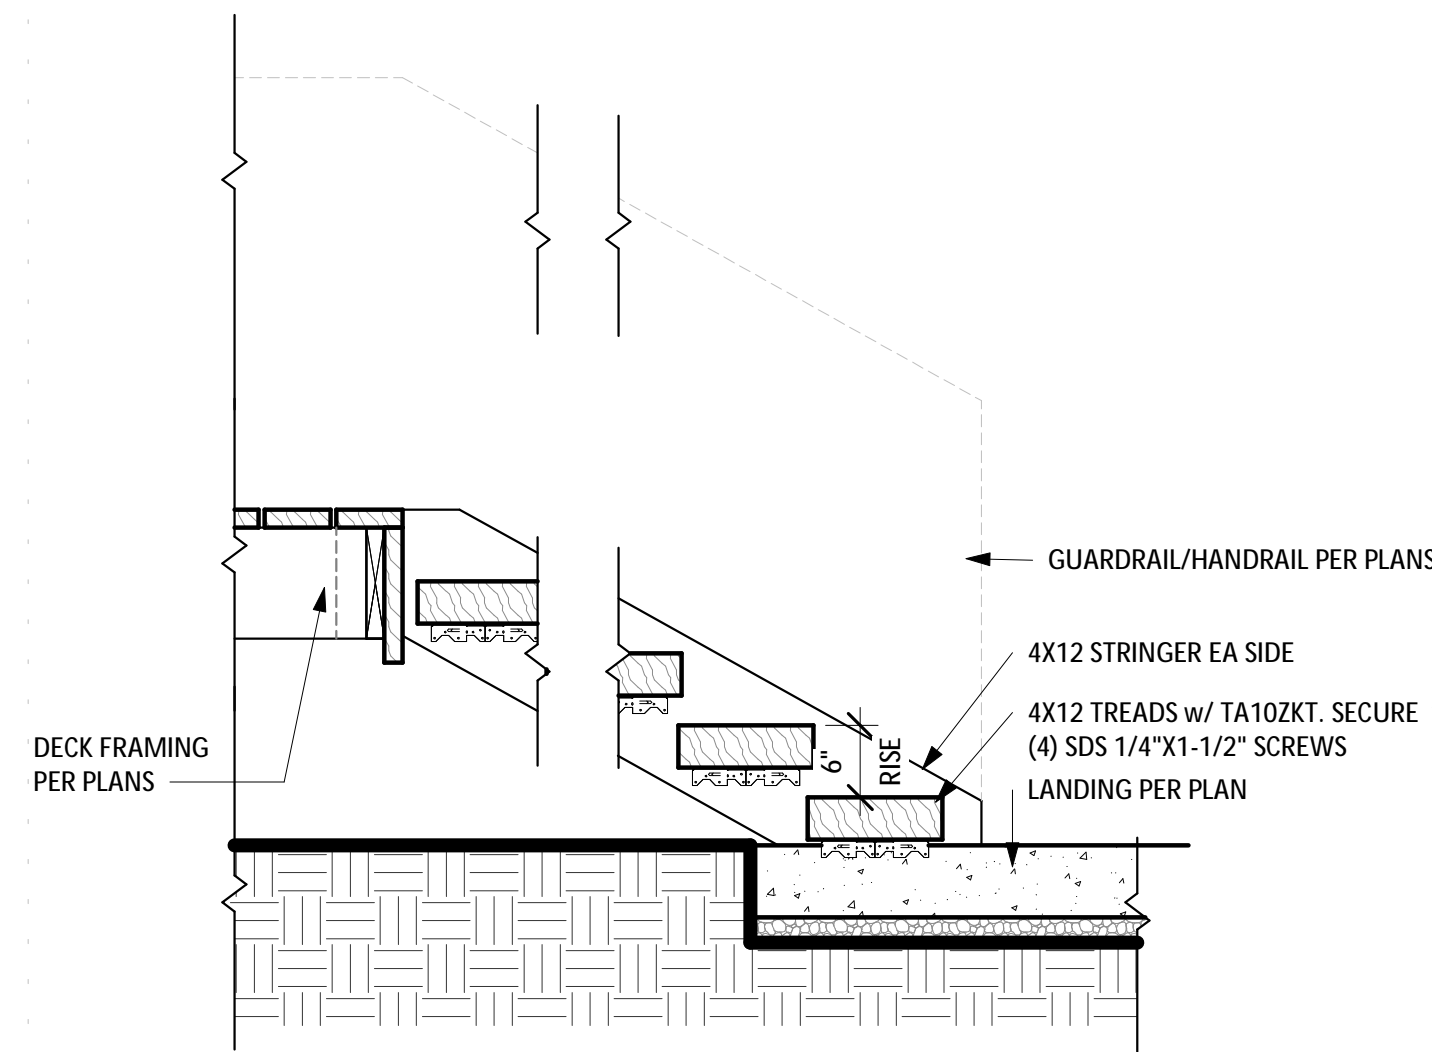

4 STAIR SECTION DETAIL
SCALE: 3/4" = 1'-0"

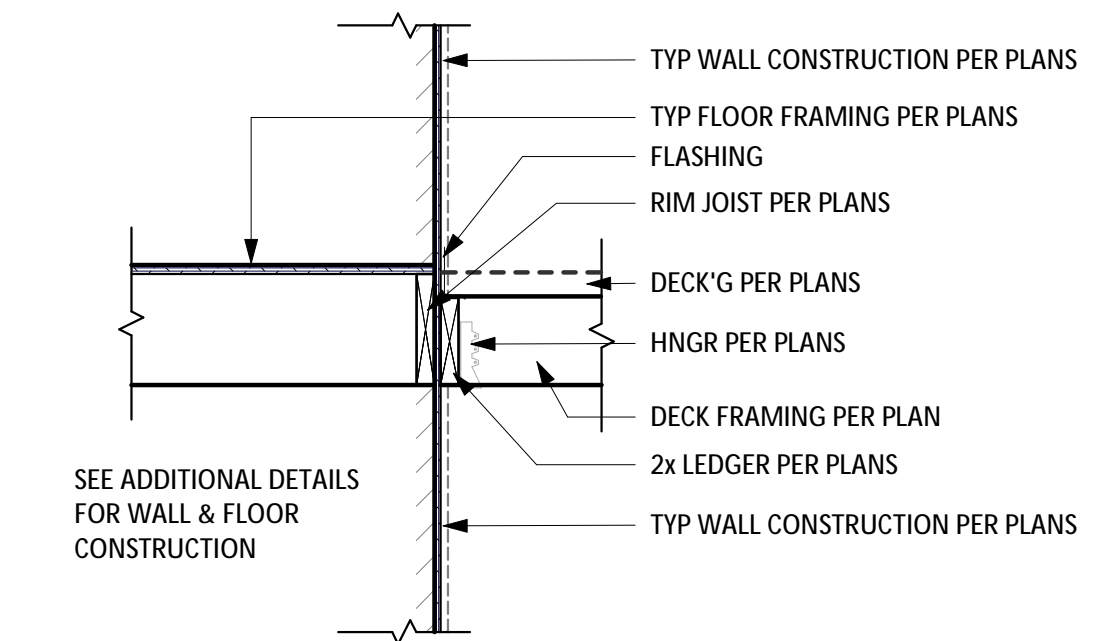

1 EXTERIOR WALL FRM'G CONNECTION
SCALE: 3/4" = 1'-0"

STANDARD DETAIL SHEET

NOTE: THIS IS A STANDARD DETAIL SHEET PREPARED FOR SINGLE FAMILY HOUSING TYPE V NONRATED CONSTRUCTION. THESE DETAILS HAVE BEEN PREPARED TO COVER GENERAL CONSTRUCTION CONDITIONS. NOT ALL DETAILS ON THIS SHEET ARE NECESSARILY INCORPORATED INTO THIS PROJECT. COORDINATE WITH PLANS.

Description

Date

No.



MONSEF DESIGN
STUDIO

451 DUVALL AVE NE, RENTON, WA 98059
206.612.8647 | WWW.ATERAHOMES.COM

Chen Residence
5024 W Mercer Way, Mercer Island

PERMIT SET


DECK DETAILS

PROJECT NO: 20008
ISSUE DATE: 2023/08/01
SHT ISSUE DATE: 2021/01/08
DRAWN BY: SPM

D401


SCALE 24X36: 3/4" = 1'-0"
* NOTE: 11X17 SETS ARE REDUCED 50% SCALE DRAWINGS ACCORDINGLY.

STRUCTURAL ABBREVIATIONS			
&	AND	IF	INSIDE FACE
@	AT	IN	INCH
#	NUMBER	INT	INTERIOR
AB	ANCHOR BOLT	INV	INVERT
ABV	ABOVE	KIP, K	1,000 POUNDS
ADD'L	ADDITIONAL	KSI	KIPS PER SQUARE INCH
ADJ	ADJACENT	LB	POUND
ALT	ALTERNATE	Ld	DEVELOPMENT LENGTH
APPROX	APPROXIMATE(LY)	LL	LIVE LOAD
ARCH	ARCHITECT(URAL)	LLH	LONG LEG HORIZONTAL
ATR	ALL-THREADED ROD	LLV	LONG LEG VERTICAL
B/	BOTTOM OF	LONGT	LONGITUDINAL
BN	BOUNDARY NAILING	Ls	LAP SPLICE LENGTH
BLDG	BUILDING	LSL	LAMINATED STRAND LUMBER
BLKG	BLOCKING	LVL	LAMINATED VENEER LUMBER
BM	BEAM	MAX	MAXIMUM
BOTT	BOTTOM OF	MECH	MECHANICAL
BR	BRACE	MFR	MANUFACTURER
BRG	BEARING	MIN	MINIMUM
BTWN	BETWEEN	MISC	MISCELLANEOUS
C	STANDARD CHANNEL	MTL	METAL
CC	CENTER TO CENTER	(N)	NEW
CDF	CONTROLLED DENSITY FILL	NIC	NOT IN CONTRACT
CP	CAST IN PLACE	NOM	NOMINAL
CJ	CONSTRUCTION OR CONTROL JOINT	NTE	NOT TO EXCEED
CJP	COMPLETE JOINT PENETRATION	NTS	NOT TO SCALE
CL	CENTERLINE	OC	ON CENTER
CLR	CLEAR(ANCE)	OD	OUTSIDE DIAMETER
CMU	CONCRETE MASONRY UNIT	OPNG	OPENING
COL	COLLUMN	OPP	OPPOSITE
CONC	CONCRETE	OSB	ORIENTED STRAND BOARD
CONN	CONNECTION	OWSJ	OPEN WEB STEEL JOIST
CONST	CONSTRUCTION	OWWJ	OPEN WEB WOOD JOIST
CONT	CONTINUOUS	PC	PRECAST
CTRD	CENTERED	PCF	POUNDS PER CUBIC FOOT
CTSK	COUNTERSINK	PL	PLATE
d	PENNY (NAILS)	PERP	PERPENDICULAR
DBL	DOUBLE	PLY	PLYWOOD
DEMO	DEMOLITION	PRE-MFR	PRE-MANUFACTURED
DET	DETAIL	PS	PRESTRESSED
DF	DOUGLAS FIR	PSI	POUNDS PER SQUARE INCH
DIA	DIAMETER	PSL	PARALLEL STRANDED LUMBER
DIAG	DIAGONAL	PT	PRESSURE TREATED
DL	DEAD LOAD	R	RADIUS
DN	DOWN	REF	REFERENCE
DP	DEPTH	REINF	REINFORCING
DWG(S)	DRAWING(S)	REQ'D	REQUIRED
DWL(S)	DOWEL(S)	RET	RETAINING
EA	EACH	RJ	ROOF JOIST
EF	EACH FACE	RT	ROOF TRUSS
EN	EDGE NAILING	REV	REVISION
EL	ELEVATION	SCHED	SCHEDULE
EMBED	EMBEDMENT	SECT	SECTION
ENGR	ENGINEER	SHTG	SHEATHING
EQ	EQUAL(LY)	SIM	SIMILAR
EW	EACH WAY	SOG	SLAB ON GRADE
EXIST. (E)	EXISTING	SPEC	SPECIFICATION
EXP	EXPANSION	SQ	SQUARE
EXT	EXTERIOR	SS	STAINLESS STEEL
FB	FLAT BAR	STD	STANDARD
FD	FLOOR DRAIN	STIFF	STIFFENER
FIN	FINISH	STL	STEEL
FJ	FLOOR JOIST	STRUCT	STRUCTURAL
FLR	FLOOR	SW	SHEAR WALL
FDN	FOUNDATION	SYM	SYMMETRICAL
FT	FOOT, FEET	T/	TOP OF
FTG	FOOTING	T&B	TOP AND BOTTOM
GA	GAUGE	T&G	TONGUE AND GROOVE
GALV	GALVANIZED	THK	THICK
GB	GRADE BEAM	THRU	THROUGH
GEN	GENERAL	T.JI	TRUSS JOIST
GEOTECH	GEOTECHNICAL	TOW	TOP OF WALL
GLB	GLUE LAMINATED BEAM	TRANSV	TRANSVERSE
GRG	GRATING	TYP	TYPICAL
GT	ORDER TRUSS	UNO	UNLESS NOTED OTHERWISE
HD	HOLDOWN	VERT	VERTICAL
HDR	HEADER	W	WIDE FLANGE, WIDE
HF	HEM FIR	W/	WITH
HORIZ	HORIZONTAL	W/O	WITHOUT
HSS	HOLLOW STRUCTURAL SECTION	WFW	WELDED WIRE FABRIC
HT	HEIGHT	X-STR	EXTRA STRONG
ID	INSIDE DIAMETER	XX-STR	DOUBLE EXTRA STRONG

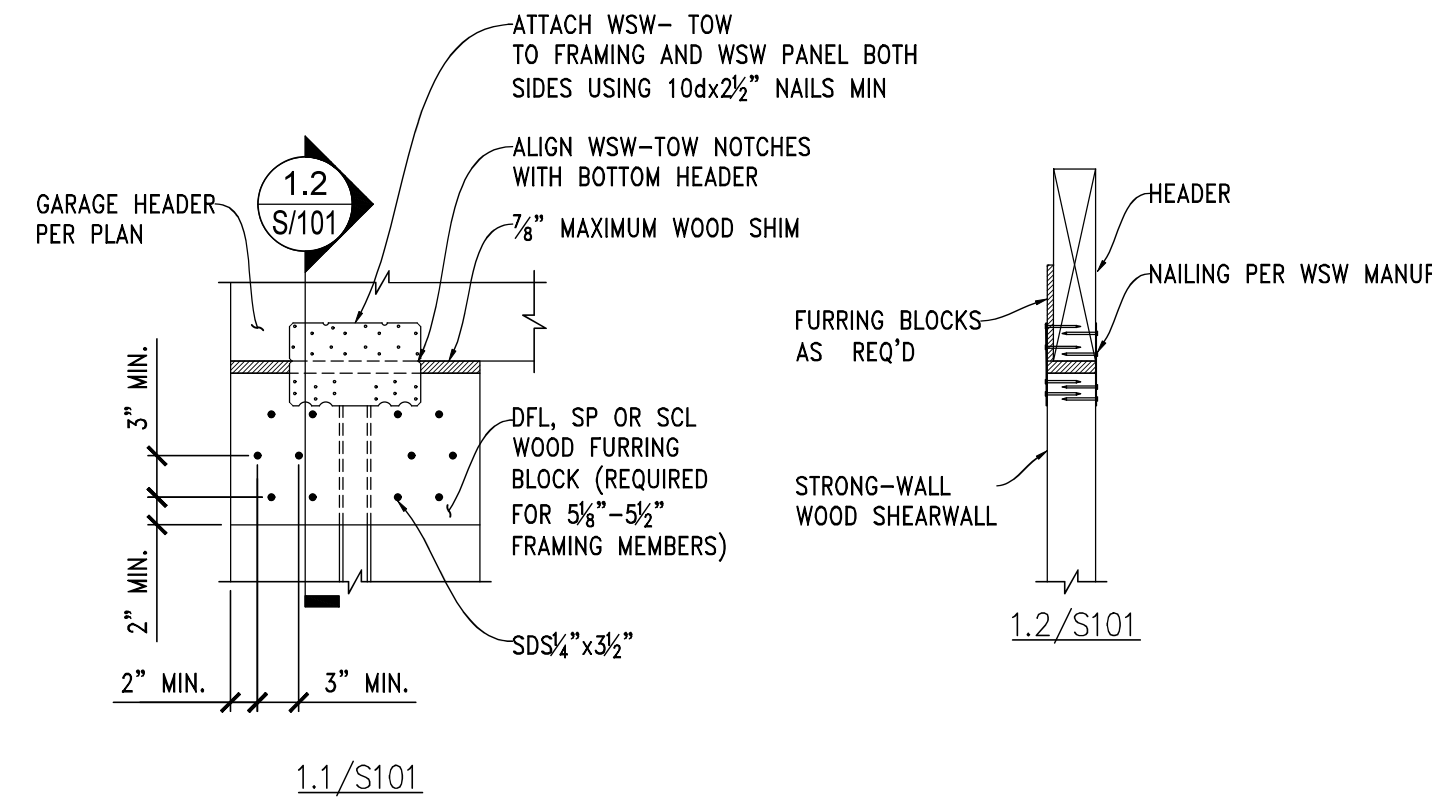


NOTES
MATCH PLATE FROM HEADER TO T/ PLATE

1 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL STRONG WALL TOP CONNECTION - HEADER

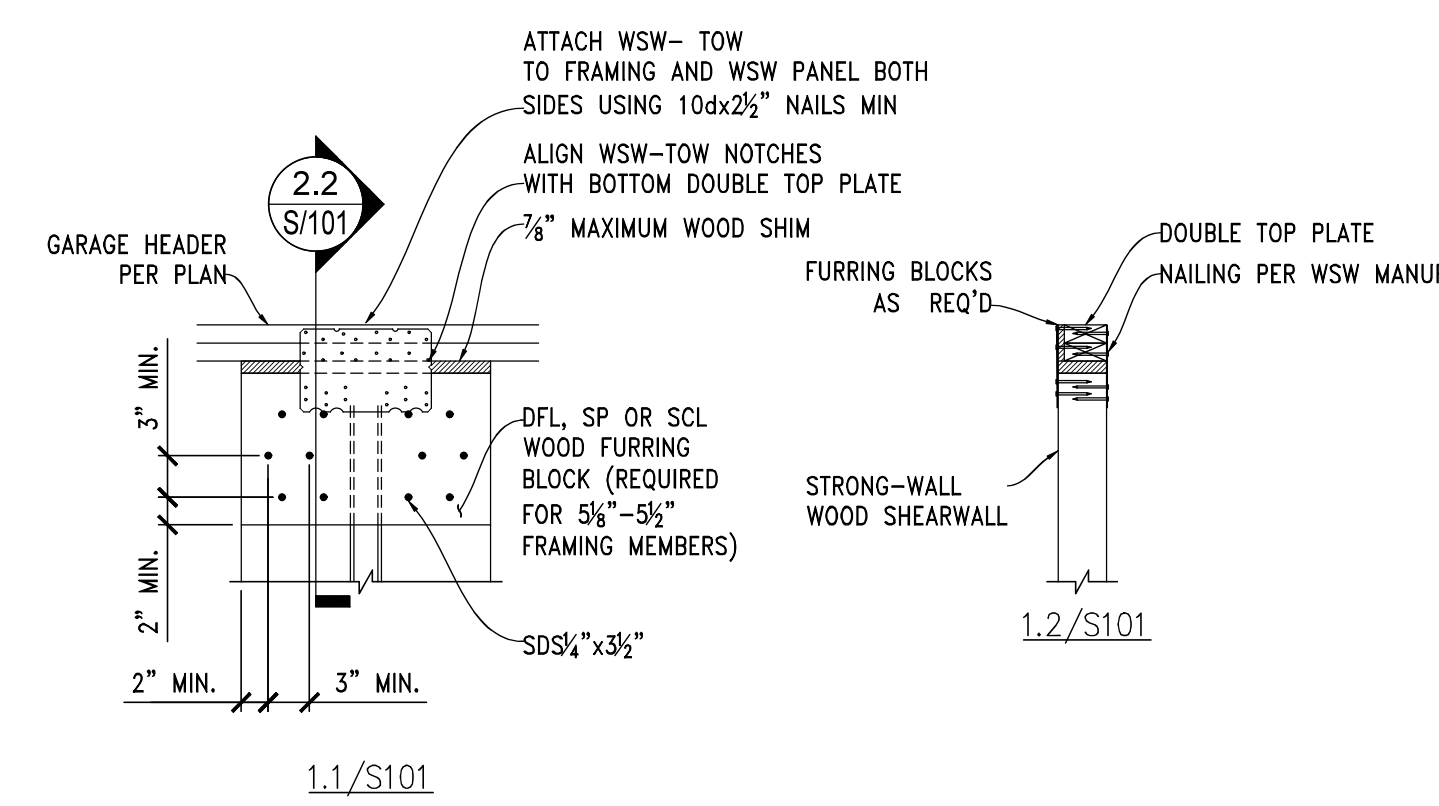


NOTES
MATCH PLATE FROM HEADER TO T/ PLATE

2 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL STRONG WALL TOP CONNECTION - TOP PLATE

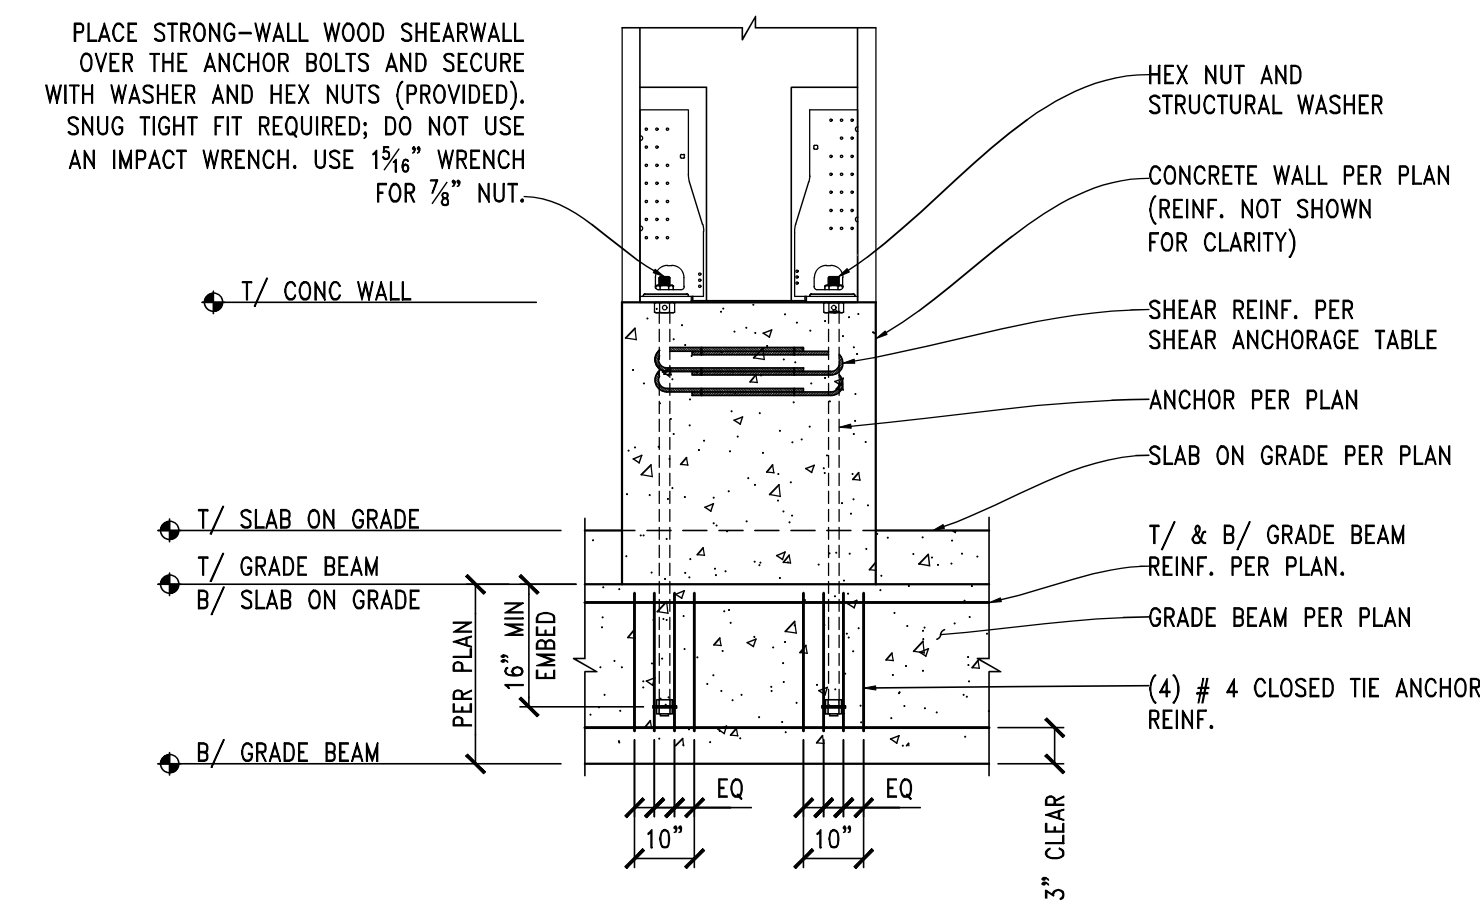

3 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL STRONG WALL ANCHORAGE - ELEVATION

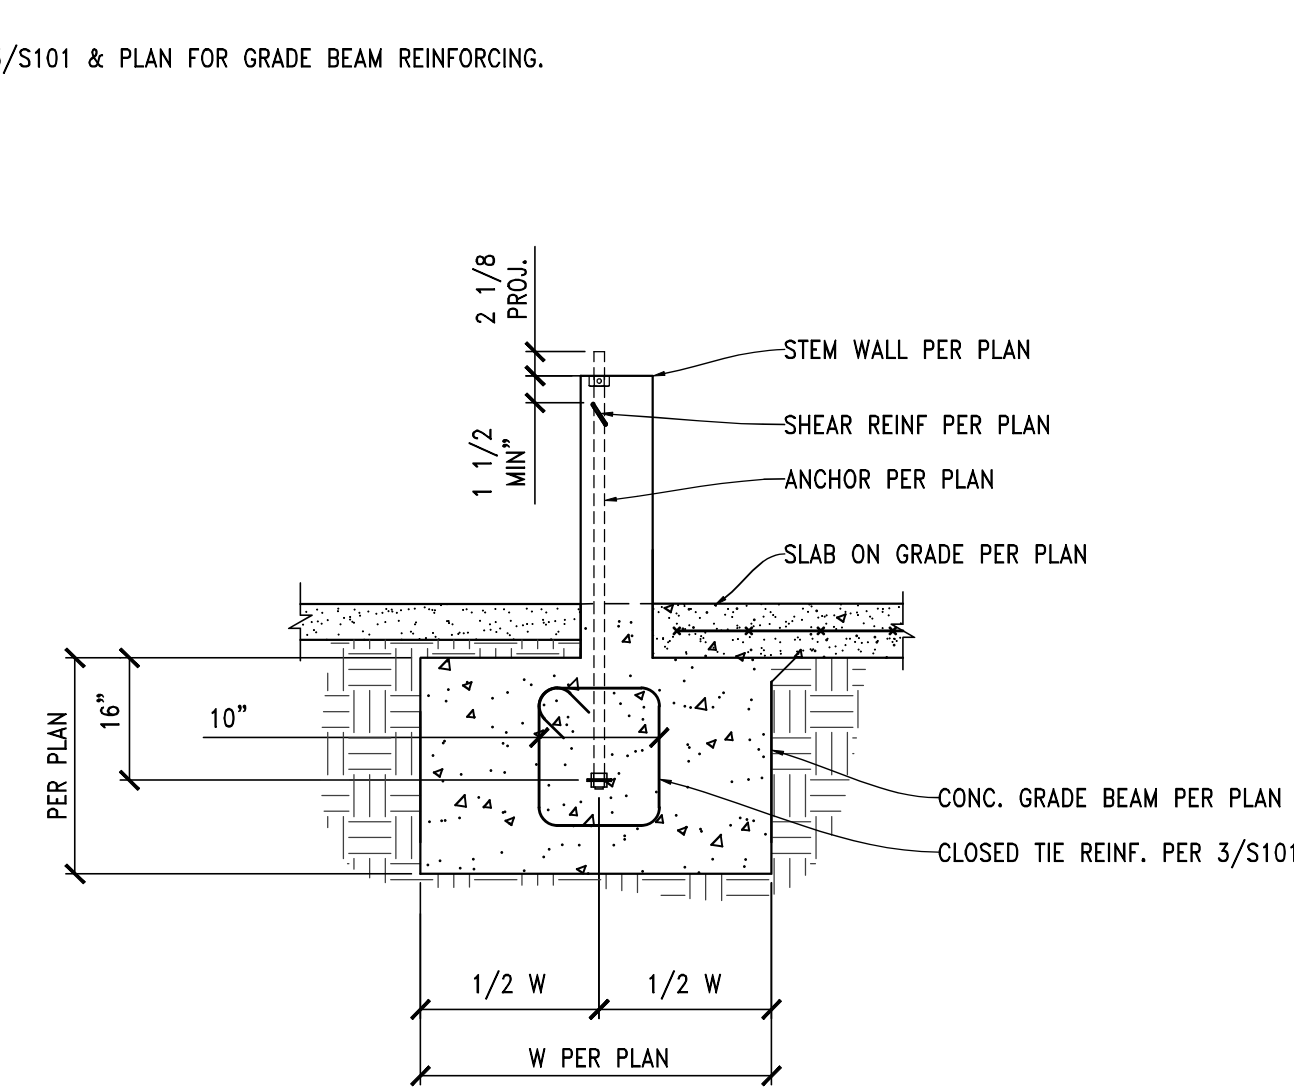


NOTE
REF. 3/S101 & PLAN FOR GRADE BEAM REINFORCING.


4 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL STRONGWALL ANCHORAGE - SECTION

STRONG-WALL WOOD SHEARWALL SHEAR ANCHORAGE					
MODEL	L _s (in.)	SEISMIC ³		ASD ALLOWABLE SHEAR LOAD, V (k) ⁴	
		SHEAR REINFORCEMENT	MINIMUM CURRB ¹ STEMWALL WIDTH (in.)	UNCRACKED	CRACKED
WSW12	10 1/4	(1) #3 HAIRPIN ⁵	8	1,035	740
WSW18	15	(1) #3 HAIRPIN ⁵	8	HAIRPIN REINFORCEMENT ACHIEVES MAXIMUM ALLOWABLE SHEAR LOAD OF THE WSW	
WSW24	19	(2) #3 HAIRPIN ⁵	8	HAIRPIN REINFORCEMENT ACHIEVES MAXIMUM ALLOWABLE SHEAR LOAD OF THE WSW	

NOTES:
1. SHEAR ANCHORAGE DESIGNS CONFORM TO ACI 318-11 AND ACI 318-14 AND ASSUME MINIMUM 2,500 PSI CONCRETE.
2. SHEAR REINFORCEMENT IS NOT REQUIRED FOR INTERIOR FOUNDATION APPLICATIONS (PANEL INSTALLED AWAY FROM EDGE OF CONCRETE), OR BRACED WALL PANEL APPLICATIONS.
3. SEISMIC INDICATES SEISMIC DESIGN CATEGORY C THROUGH F. DETACHED 1 AND 2 FAMILY DWELLINGS IN SDC C MAY USE WIND ANCHORAGE SOLUTIONS.
4. USE (1) #3 TIE FOR WSW12 WHEN PANEL DESIGN SHEAR FORCE EXCEEDS TABULATED ANCHORAGE ALLOWABLE SHEAR LOAD.
5. 60 KSI REINFORCING SHALL BE USED.

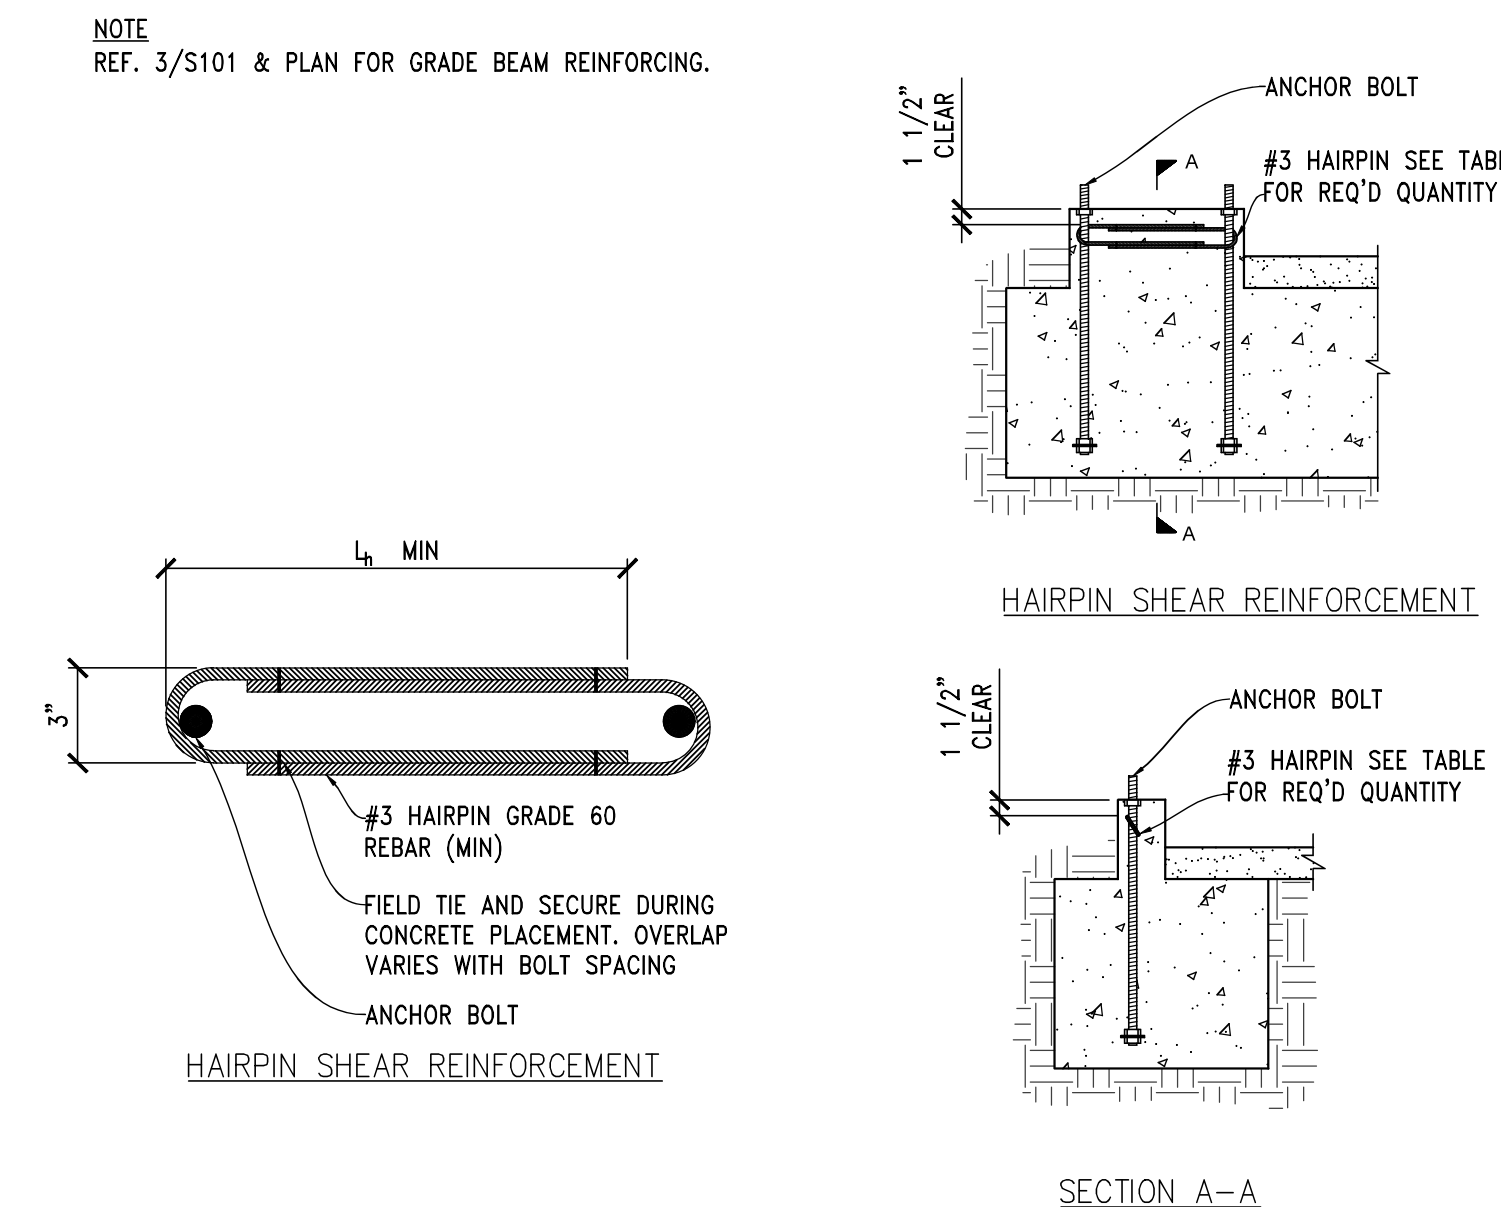


5 DETAIL
SCALE: 3/4"=1'-0"
STRONG WALL ANCHORAGE SCHEDULE

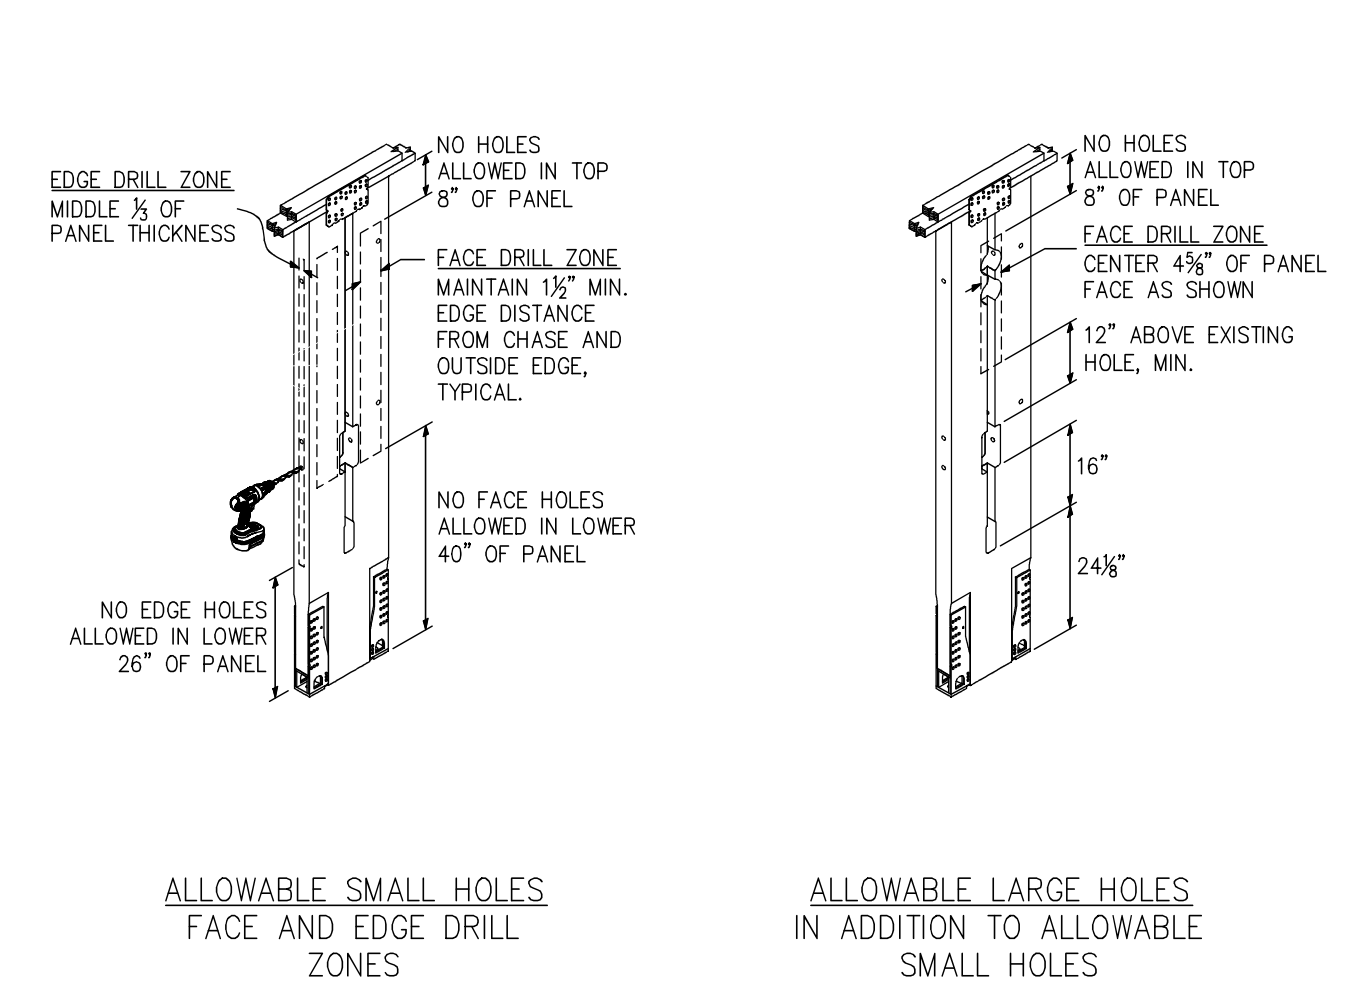


6 DETAIL
SCALE: 3/4"=1'-0"
STRONG WALL ANCHORAGE SHEAR REINFORCEMENT

7 DETAIL
SCALE: 3/4"=1'-0"
ALLOWABLE STRONG WALL HOLES

CHECK SET - NOT FOR CONSTRUCTION

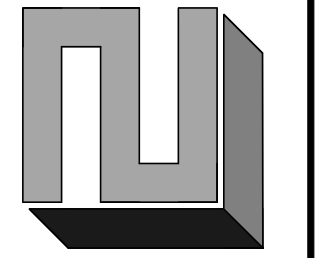

REVISION

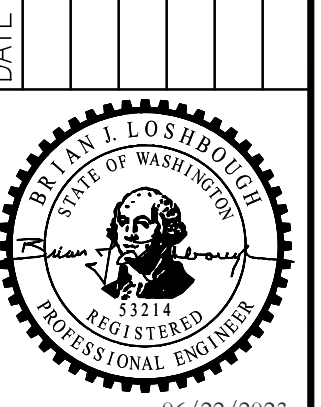

CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
STRUCTURAL ABBREVIATIONS
& STRONG WALL DETAILS / SCHEDULES

CHK BY: L2E
DRW BY: TNT

SCALE: AS SHOWN
BAR = 1" FULL SIZE

DATE: 06/22/2023

JOB NO: 20-084

SHEET: 2 OF 10

DWG NO: S101

WOOD-FRAMED SHEAR WALL SCHEDULE										
FOR HEM-FIR FRAMING W/ 8d COMMON NAILS (2015 IBC)										
SW TYPE	WALL SHEATHING APA RATED	EDGE NAILING	BOTTOM PLATE ATTACHMENT	FRAMING CLIP TO WALL BELOW	MINIMUM RIM BOARD THICKNESS	FRAMING AT PANEL EDGES	BLOCKING AT ALL PANEL EDGES	ANCHOR BOLT TO CONCRETE FOUNDATION	SILL PLATE AT FOUNDATION	ALLOWABLE SHEAR WALL CAPACITY (PLF)
SW6	15/32"	8d @ 6" OC	16d COMMON @ 5" OC	LTP5 @ 18" OC	1 1/4"	2X	2X	5/8" DIA @ 48" OC 5/8" DIA @ 60" OC	PT 2X PT 3X	242 339
SW4	15/32"	8d @ 4" OC	(2) ROWS 16d COMMON @ 6" OC, STAGGERED	LTP5 @ 12" OC	1 3/4"	2X	2X	5/8" DIA @ 32" OC 5/8" DIA @ 40" OC	PT 2X PT 3X	353 495
SW3	15/32"	8d @ 3" OC	(2) ROWS 16d COMMON @ 6" OC, STAGGERED	LTP5 @ 10" OC	1 3/4"	2X	2X	5/8" DIA @ 24" OC 5/8" DIA @ 32" OC	PT 2X PT 3X	456 637
SW2	15/32"	8d @ 2" OC	(2) ROWS 16d COMMON @ 4" OC, STAGGERED	LTP5 @ 6" OC	3 1/2"	3X	3X OR FLAT 2X	5/8" DIA @ 18" OC 5/8" DIA @ 24" OC	PT 2X PT 3X	595 832
2SW4	15/32" BOTH SIDES	8d @ 4" OC	(3) ROWS 16d COMMON @ 6" OC, STAGGERED	LTP5 @ 6" OC	3 1/2"	3X	3X	5/8" DIA @ 24" OC	PT 3X	707 990
2SW3	15/32" BOTH SIDES	8d @ 3" OC	(3) ROWS 16d COMMON @ 4" OC, STAGGERED	LTP5 @ 8" OC & A35 @ 8" OC	3 1/2"	3X	3X	5/8" DIA @ 16" OC	PT 3X	911 1274
2SW2	15/32" BOTH SIDES	8d @ 2" OC	(3) ROWS 16d COMMON @ 4" OC, STAGGERED	LTP5 @ 6" OC & A35 @ 6" OC	3 1/2"	3X	3X	5/8" DIA @ 12" OC	PT 3X	1190 1469


SHEAR WALL SCHEDULE NOTES:

- ALL NAILS ARE COMMON, UNO. REFERENCE GENERAL STRUCTURAL NOTES FOR NAIL DIAMETER AND LENGTH.
- REFERENCE SHEAR WALL KEY DETAIL FOR DESCRIPTION OF TERMS.
- PROVIDE SHEAR WALL SHEATHING AND NAILING FOR ENTIRE LENGTH OF THE WALLS INDICATED ON THE PLANS. ENDS OF SHEAR WALLS ARE TYPICALLY AT WINDOWS, DOORWAYS OR AS SHOWN ON PLAN.
- EDGE NAILING IS REQUIRED AT ALL HOLDDOWN POSTS. EDGE NAILING IS REQUIRED TO EACH STUD USED IN BUILT-UP HOLDDOWN POSTS. REFERENCE HOLDDOWN SCHEDULE & DETAILS FOR ADDITIONAL INFORMATION.
- INTERMEDIATE FRAMING TO BE 2x MINIMUM MEMBERS UNO IN SCHEDULE. ATTACH SHEATHING TO INTERMEDIATE FRAMING WITH EDGE NAILING AT 12" OC WHERE STUDS ARE SPACED AT 16" OC AND EDGE NAILING AT 6" OC WHERE STUDS ARE SPACED AT 24"
- SIMPSON STRONG-TIE "A35" MAY BE USED IN LIEU OF "LTP5." "LTP5" CLIPS SHALL BE ORIENTED LENGTHWISE (HORIZONTAL) AT PLATE TO RIM. USE 0.131"x0.1x1/2" NAILS WHERE "LTP" TYPE CLIPS ARE ATTACHED DIRECTLY TO FRAMING AS OPPOSED TO OVER SHEATHING. USE 0.131"x0.2x1/2" NAILS WHERE "LTP" TYPE CLIPS ARE INSTALLED OVER SHEATHING. REFERENCE DETAIL 2/S102 FOR CLARIFICATION.
- (2) 2x STUDS NAILED TOGETHER MAY BE USED IN PLACE OF SINGLE 3x STUD. DOUBLE 2x STUDS SHALL BE SECURED TOGETHER WITH FASTENERS OF THE SAME DIAMETER AND SPACING AS THE BOTTOM PLATE ATTACHMENT PER SCHEDULE.
- WHERE SHEATHING IS APPLIED ON BOTH SIDES OF A SHEAR WALL AND NAIL SPACING IS LESS THAN 6" OC ON EITHER SIDE, THE WIDTH OF THE NAILED FACE OF THE FRAMING MEMBER SHALL BE 3" NOMINAL OR GREATER AT ADJOINING PANEL EDGES AND NAILS AT ALL PANEL EDGES SHALL BE STAGGERED. ALTERNATIVELY, PANELS SHALL BE STAGGERED SO THAT EDGE JOINTS ON OPPOSITE SIDES ARE NOT LOCATED ON THE SAME STUD.
- ANCHOR BOLTS SHALL BE PROVIDED WITH HOT-DIPPED GALVANIZED STEEL PLATE WASHERS PER DETAILS ON DRAWINGS. EMBED ANCHOR BOLTS 7" MINIMUM INTO THE CONCRETE. PROVIDE AN ANCHOR BOLT AT EACH END OF EACH PLATE AND SHALL BE AT LEAST 7 TIMES THE ANCHOR BOLT DIAMETER FROM THE ENDS OF THE PLATE, BUT NOT MORE THAN 1/2 THE TABULATED ANCHOR BOLT SPACING OR 12", WHICHEVER IS LESS. SEE ANCHOR BOLT DETAIL FOR PLATE WASHER REQUIREMENTS. [ALT: 3/8"x8" TITEN HD ANCHOR SCREWS MAY BE USED IN LIEU OF ANCHOR BOLTS AT EXISTING CONCRETE, WITH PLATE WASHER & SPACING REQUIREMENTS PER SCHEDULE.]
- PROVIDE HOT-DIPPED GALVANIZED NAILS AND CONNECTOR PLATES (FRAMING ANGLES, ETC.) AT ALL PRESSURE TREATED LUMBER. REFERENCE GENERAL STRUCTURAL NOTES FOR ADDITIONAL INFORMATION.
- PANELS MAY BE INSTALLED HORIZONTALLY IF STUDS ARE SPACED AT 16" OC MAX.
- STAGGER EDGE NAILING.
- THE TOP EDGE OF THE WOOD STRUCTURAL PANEL SHALL BE ATTACHED TO THE UPPER TOP PLATE. ROOF OR UPPER LEVEL UPLIFT CONNECTORS SHALL BE ON THE SAME SIDE OF THE WALL AS THE SHEATHING.
- THE BOTTOM EDGE OF THE WOOD STRUCTURAL PANEL SHALL EXTEND TO AND BE ATTACHED TO THE BOTTOM OR SILL PLATE.
- REFERENCE DETAIL BELOW FOR STAGGERED NAIL AND SCREW SPACING AT RIM BOARDS.
- WALL TYPE ACCEPTABLE WITH TRUSSJOIST AND BOISE CASCADE RIM JOIST AND BLOCKING.
- PROVIDE PLATE WASHERS AT EACH ANCHOR BOLT THAT IS NOT LESS THAN 0.229" X 3" X 3".
- FOR SW2, 3x FRAMING MEMBERS AND BLOCKING MUST BE PROVIDED AT ADJOINING PANEL EDGES, AND NAILS MUST BE STAGGERED AT PANEL EDGES.


HOLDDOWN SCHEDULE (HF)							
MARK	MODEL #	ALLOWABLE UPLIFT			MIN END STUDS	STUD FASTENERS	CONCRETE ANCHOR
		MID WALL	CORNER	END WALL			
HDU2	HDU2-SDS2.5	2,215			(2) 2X	(6) 1/4X2 1/2 SDS	SSTB16
HDU4	HDU4-SDS2.5	3,285			(2) 2X	(10) 1/4X2 1/2 SDS	SSTB16
HDU5	HDU5-SDS2.5	4,340			(2) 2X	(14) 1/4X2 1/2 SDS	SSTB20
HDU8	HDU8-SDS2.5	5,820			(2) 2X	(20) 1/4X2 1/2 SDS	SSTB
HDU11	HDU11-SDS2.5	8,030			4X6	(30) 1/4X2 1/2 SDS	PAB8
HDU14	HDU14-SDS2.5	9,260			4X6	(36) 1/4X2 1/2 SDS	PAB8

HOLDDOWN SCHEDULE NOTES:


- REFERENCE FOUNDATION PLAN NOTE 1 FOR HOLDDOWNS AT EXISTING FOUNDATION LOCATIONS
- HOLDDOWNS SPECIFIED ARE BY SIMPSON STRONGTIE
- REFERENCE PLANS FOR ADDITIONAL STUD REQUIREMENTS WHERE OCCUR
- PROVIDE 1/4" X 3" SQ PLATE WASHER BETWEEN STANDARD DOUBLE NUTS. EMBED LENGTH EQUAL TO TOP OF CONCRETE DOWN TO TOP OF PLATE WASHER
- INCREASE FOOTING DEPTH LOCALLY AS REQUIRED TO ACHIEVE REQUIRED EMBEDMENT DEPTH AS SPECIFIED BY HOLDDOWN MANUFACTURER
- REF. 7/S102 FOR PAB ANCHOR DETAIL
- REF. 1/S102 & 2/S102 FOR STD ANCHOR DETAIL
- INCREASE FOOTING WIDTH AND DEPTH AS REQUIRED @ PAB ANCHORS

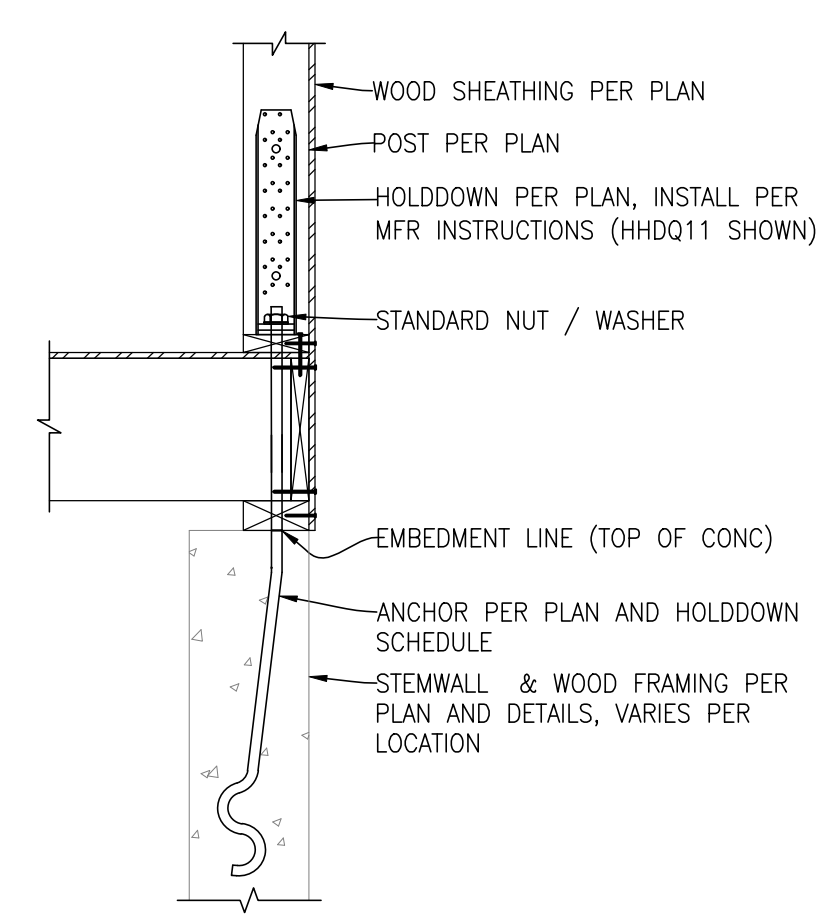

1 DETAIL
SCALE: NTS
TYPICAL HDU TYPE HOLDDOWN

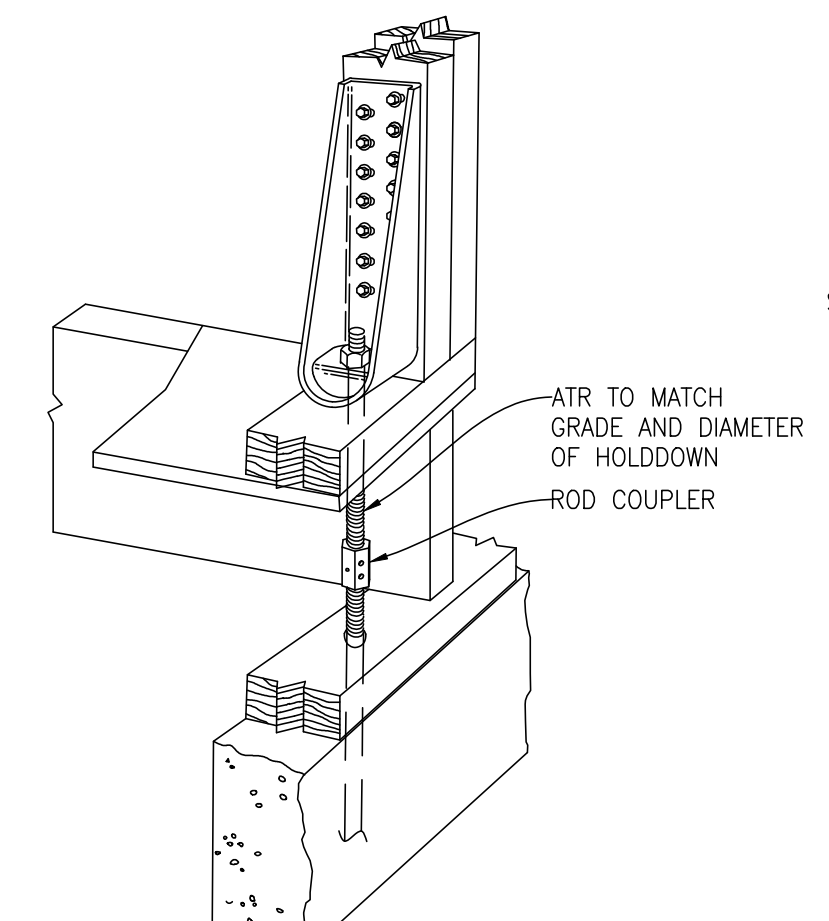

2 DETAIL
SCALE: NTS
TYPICAL HDU TYPE HOLDDOWN ISOMETRIC

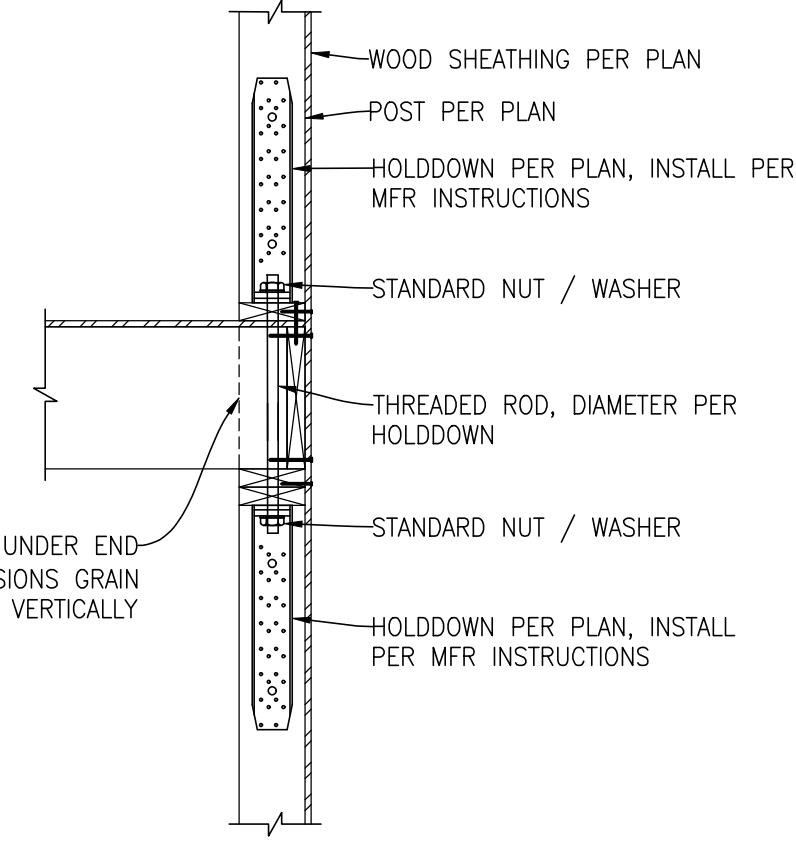


3 DETAIL
SCALE: NTS
THRU FLOOR HOLDDOWN W/ HDU

NOTE
1) FULL DEPTH COMPRESSION BLOCKING MATCHING STUD / POST WIDTH (GRAIN ORIENTED VERTICALLY) SHALL BE REQUIRED IN FLOOR INTERSTITIAL SPACE UNDER COLUMNS, STUD PACKS, AND HOLDDOWNS.
2) RIM & COMPRESSION BLOCKING NOT SHOWN FOR CLARITY.


TIEDOWN STRAP SCHEDULE			
STRAP	MINIMUM END LENGTH	NAILING REQ'D AT EA END LENGTH	ALLOWABLE UPLIFT (LBS)
CS20	9"	(16) 0.131 x 2 1/2"	1,030
CS16	15"	(26) 0.131 x 2 1/2"	1,370
CS14	19"	(36) 0.131 x 2 1/2"	2,490
CMSTC16	25"	(56) 0.148 x 3"	4,585
CMST14	34"	(76) 0.148 x 3"	6,490
CMST12	44"	(98) 0.148 x 3"	9,215

TIE DOWN STRAP SCHEDULE NOTES:

- FOLLOW ALL SIMPSON STRONG-TIE GUIDELINES NECESSARY TO ACHIEVE FULL ICC DESIGN VALUES.
- STRAP MAY BE INSTALLED OVER OR UNDER PLYWOOD.
- EDGE NAIL PLYWOOD TO STRAPPED POST.
- WHERE STRAPS OCCUR OVER FLOOR BEAM, REFER STRUCTURAL DRAWINGS FOR ADD'L DETAIL.
- ADDED BLKG MAY BE ELIMINATED WHERE FLOOR FRAMING IS DIRECTLY BETWEEN POST.
- NAILS NOT REQUIRED IN CLEAR SPAN.

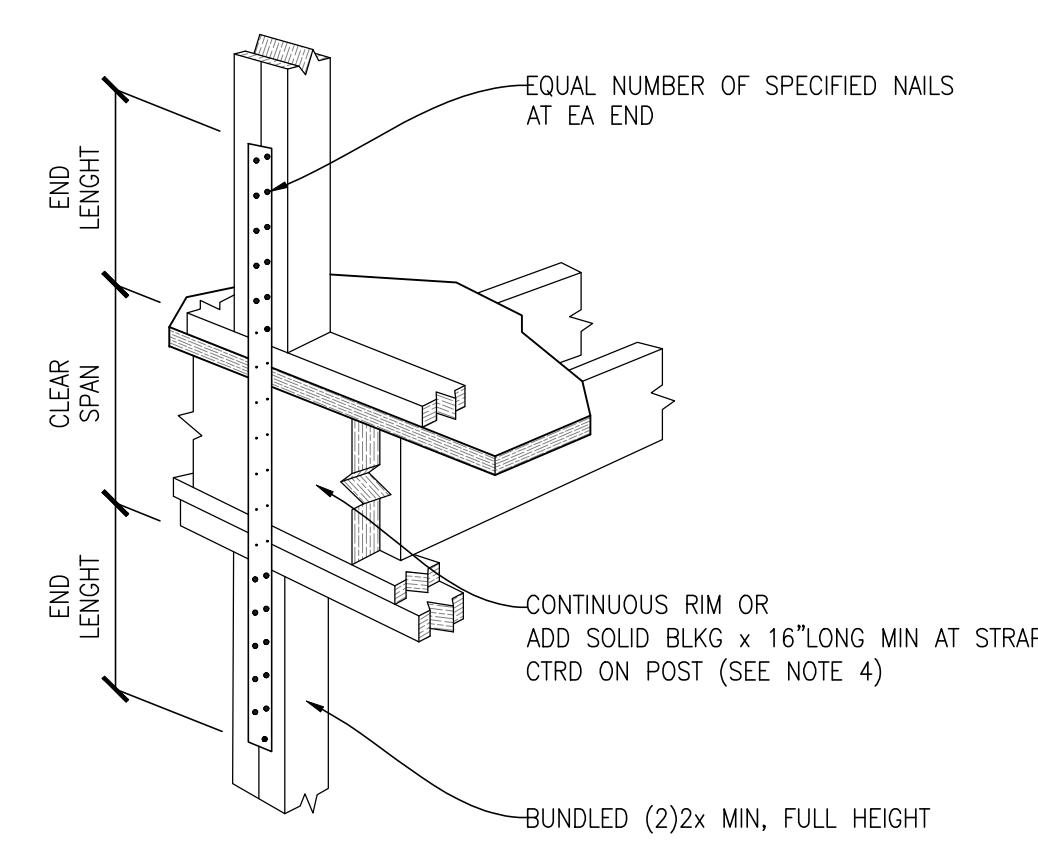


7 DETAIL
SCALE: 1"=1'-0"
PAB ANCHOR

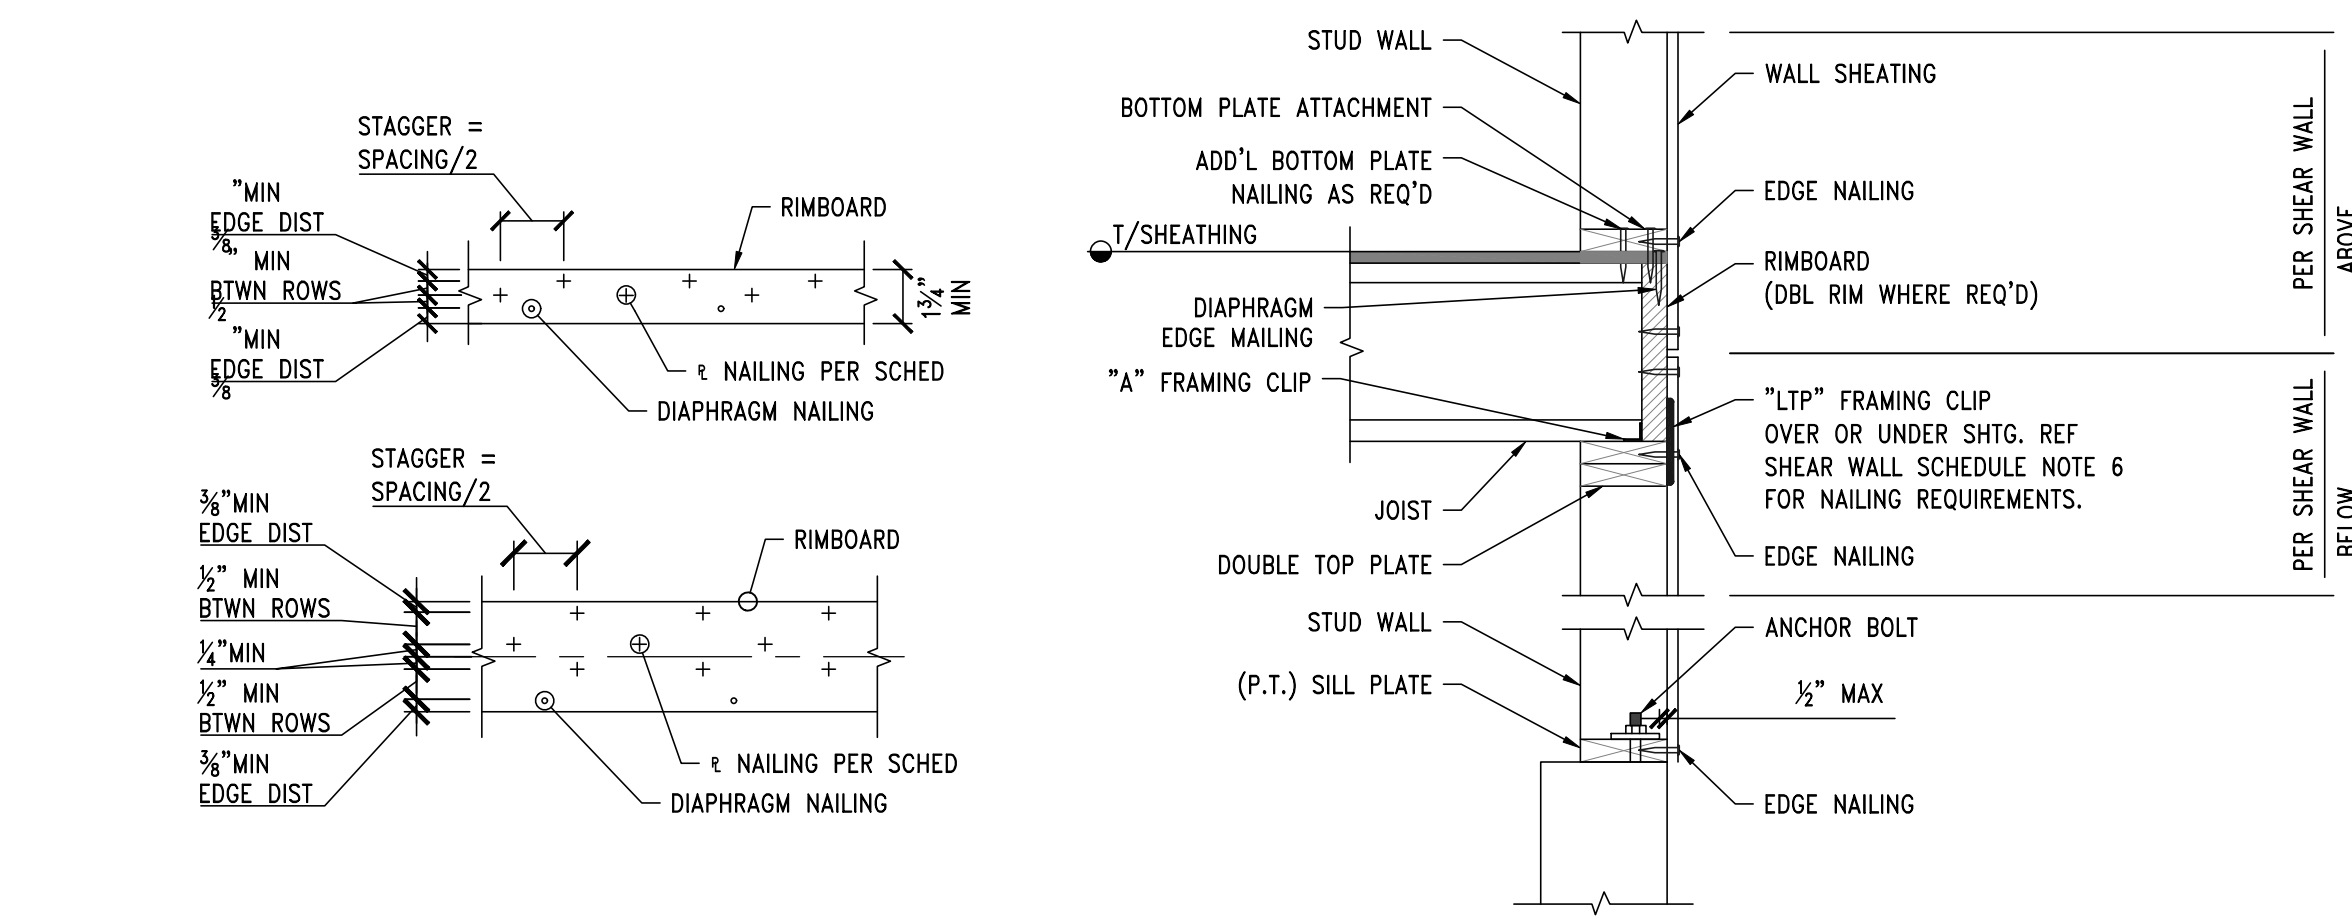


4 DETAIL
SCALE: NTS
TYPICAL RIM NAILING


5 DETAIL
SCALE: NTS
TYPICAL SHEAR WALL SECTION

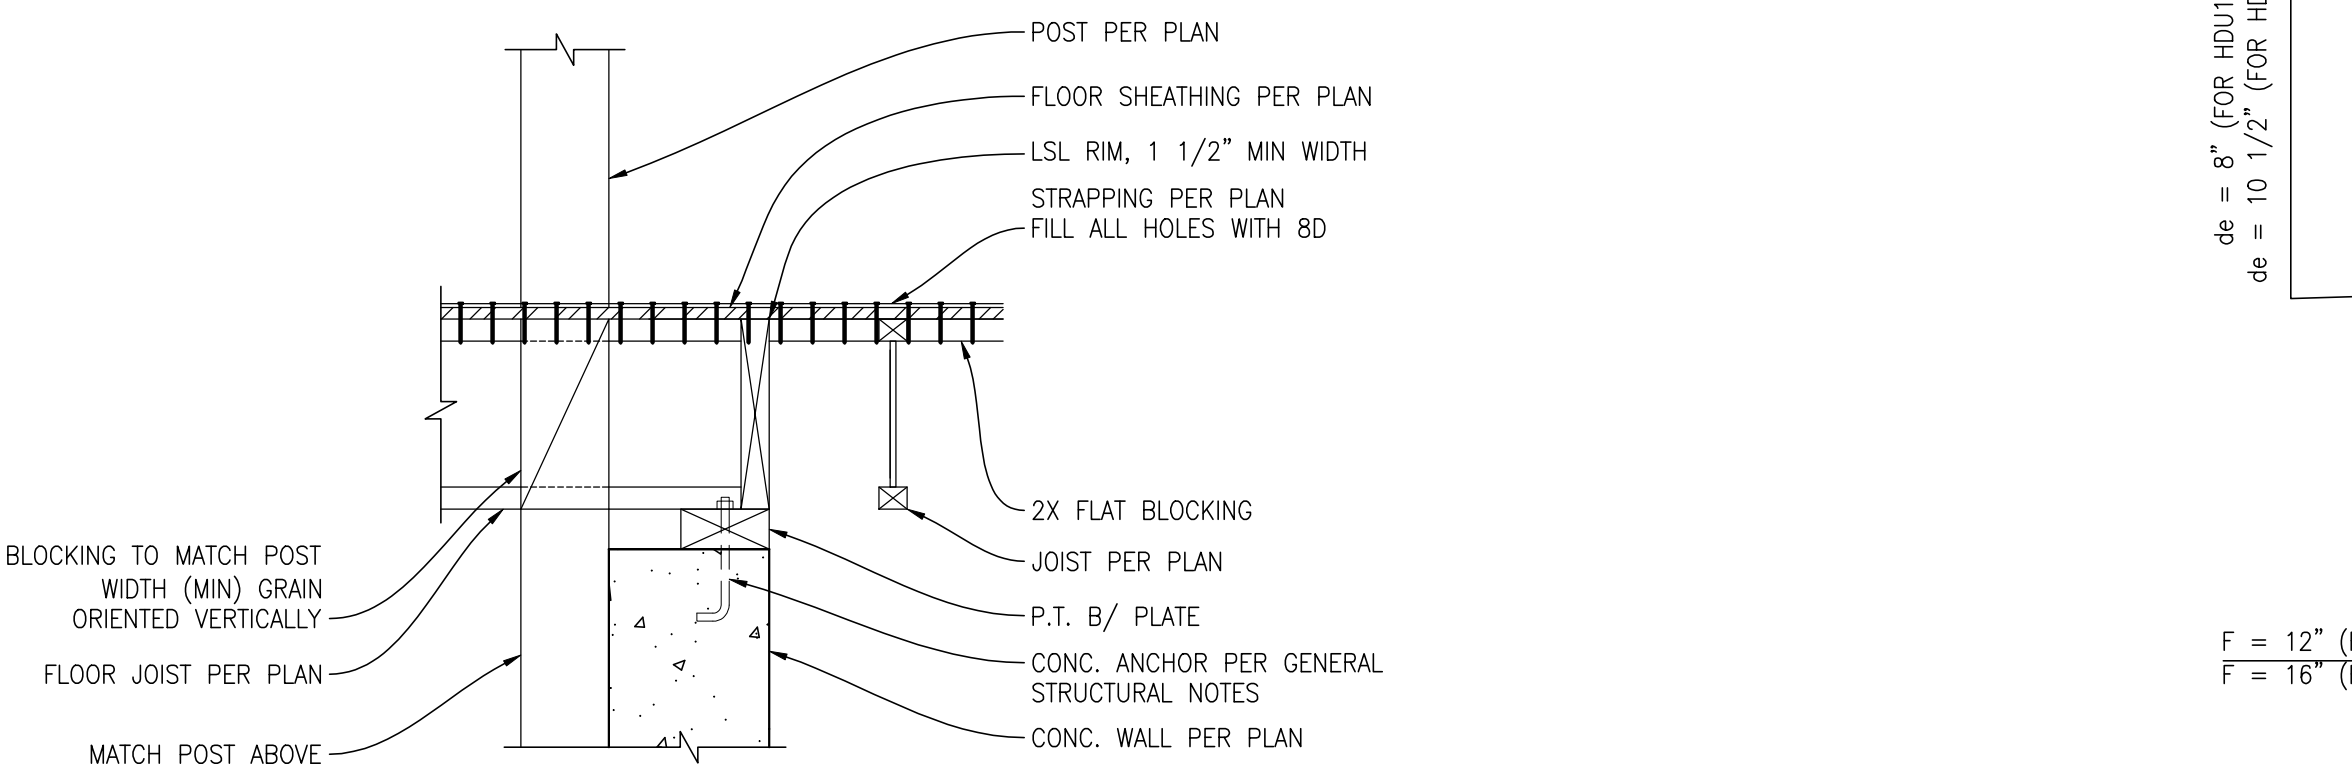

6 DETAIL
SCALE: 1"=1'-0"
DIAPHRAGM STRAPPING

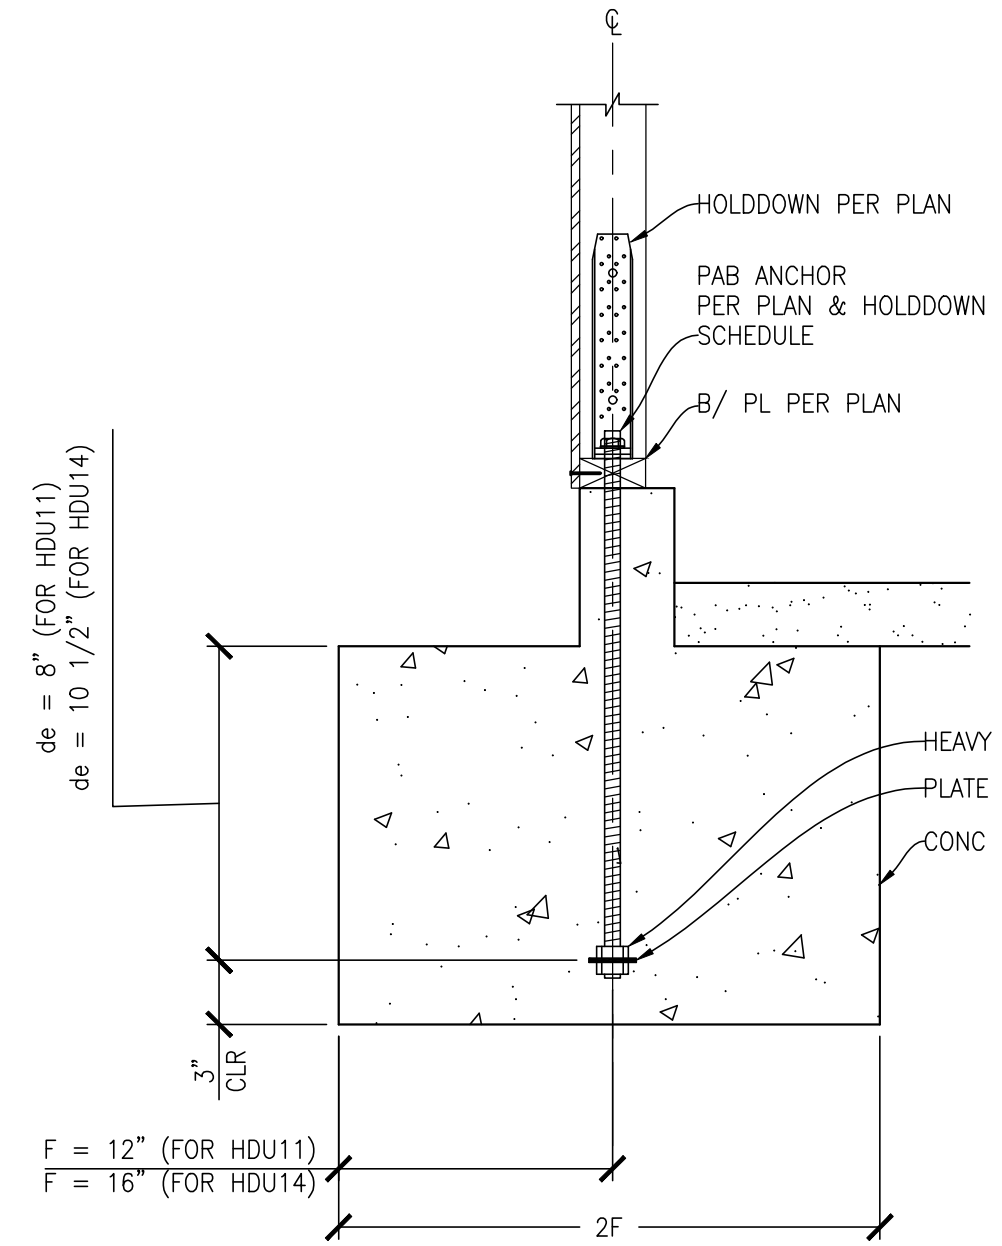


8 DETAIL
SCALE: NTS
TYPICAL FLOOR TO FLOOR STRAP

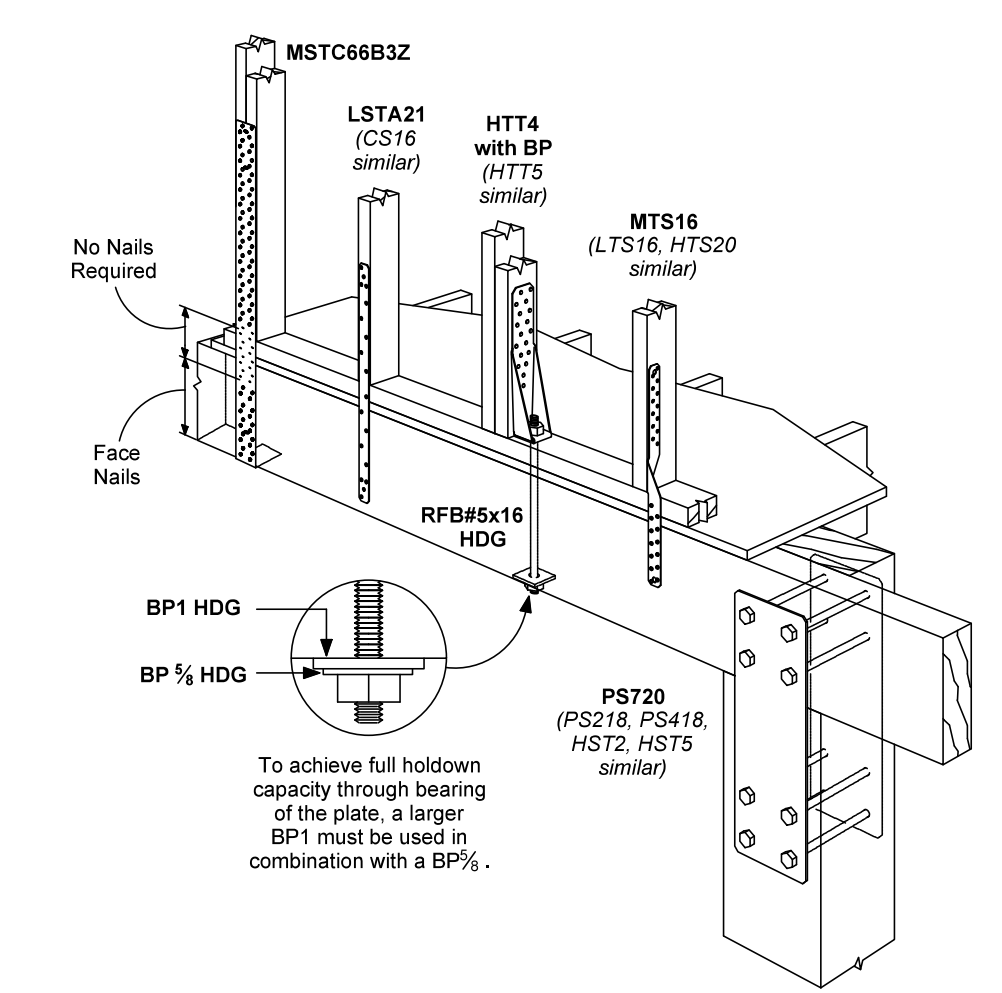


9 DETAIL
SCALE: NTS
FLOOR TO BEAM / RIM HOLDDOWNS


CHECK SET - NOT FOR CONSTRUCTION

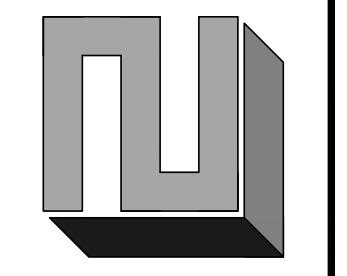


DATE	REVISION

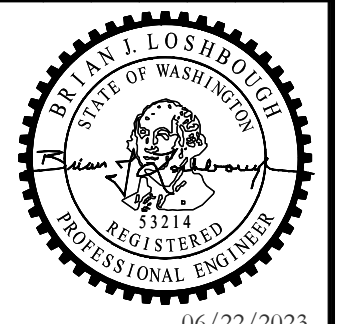

CHECK SET - NOT FOR CONSTRUCTION

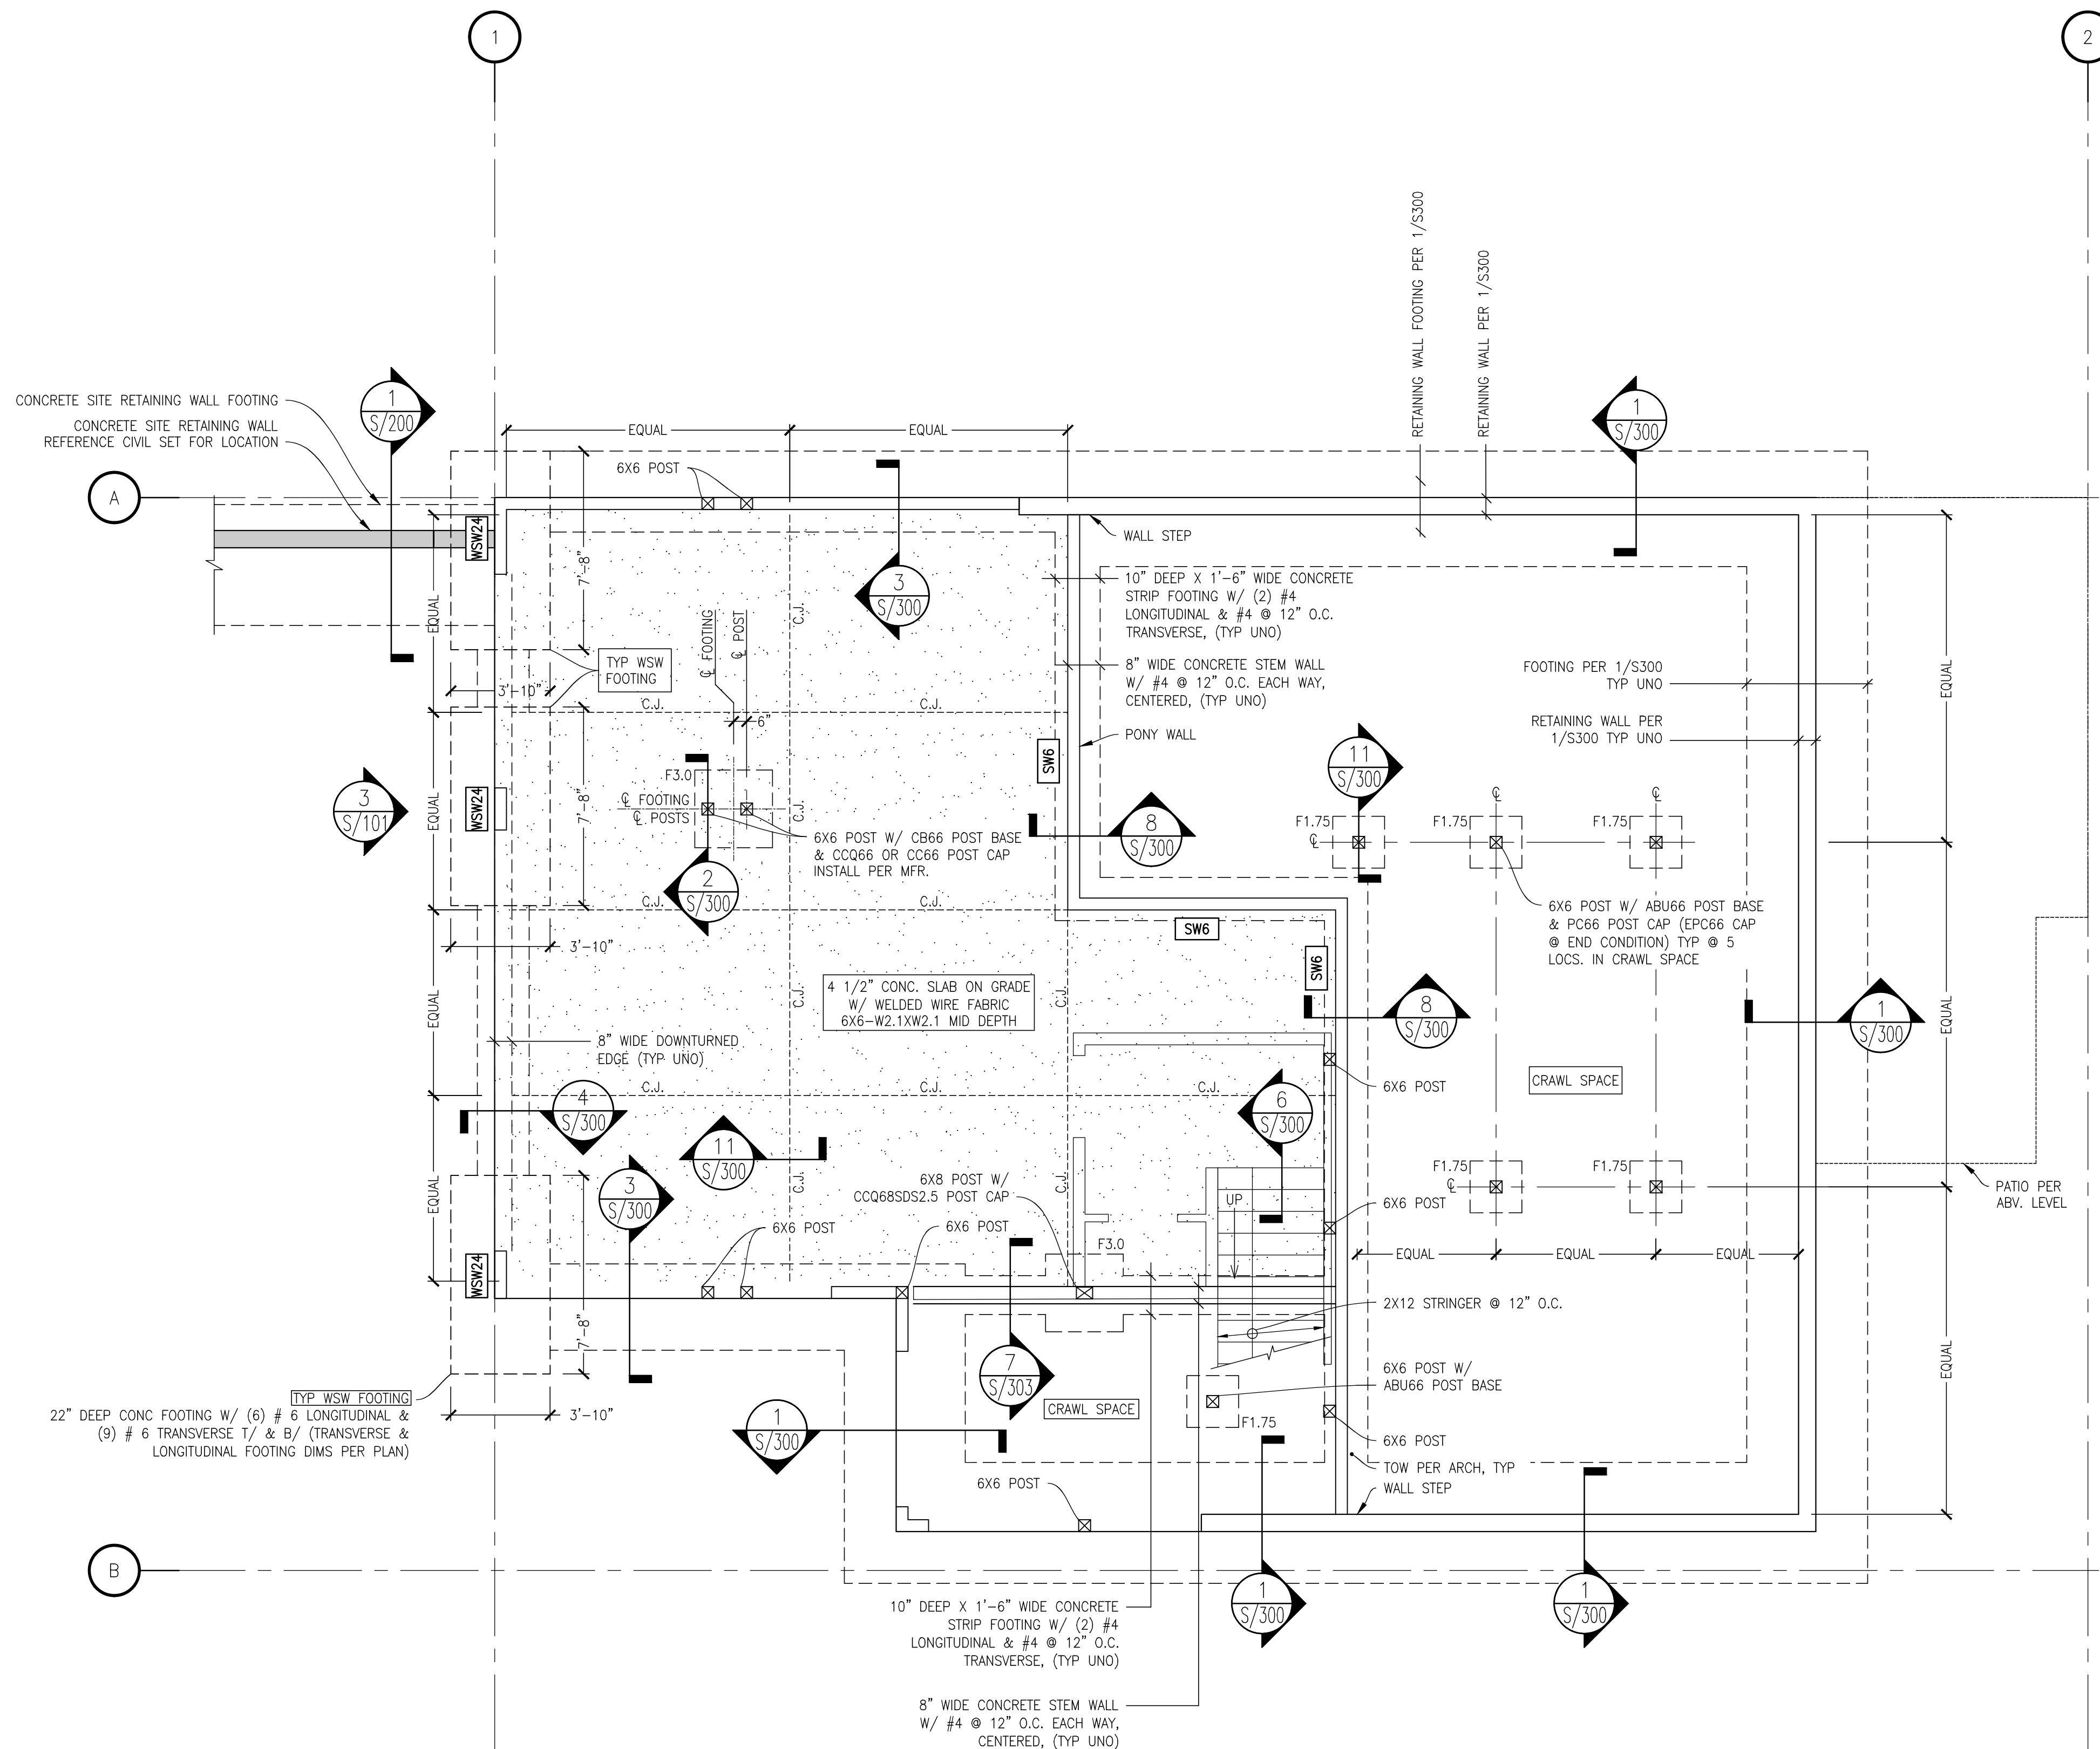

FOUNDATION PLAN
SCALE: 1/4"=1'-0"



- PLAN NOTES**
1. REFERENCE ROOF FRAMING PLAN FOR APPLICABLE FRAMING PLAN NOTES.
 2. REFERENCE S1.0 FOR GENERAL STRUCTURAL NOTES AND OTHER DESIGN CRITERIA.
 3. CONTRACTOR TO COORDINATE CURBS AND ELECTRICAL AND MECHANICAL FLOOR OPENINGS AND PENETRATIONS WITH ARCHITECTURAL DRAWINGS.
 4. THE BOTTOM OF ALL PERIMETER FOOTINGS SHALL BE A MINIMUM OF 18" BELOW GRADE AND BEAR UPON FIRM UNDISTURBED SOIL.
 5. ALL WOOD IN CONTACT WITH WEATHER, EXPOSED CONCRETE, OR WITHIN 8" OF FINISHED GRADE SHALL BE PRESSURE-TREATED.
 6. USE HOT DIPPED GALVANIZED FASTENERS AND ZMAX HARDWARE AT CONNECTIONS TO PRESSURE TREATED LUMBER.
 7. SLAB ON GRADE SHALL BE 4 1/2" THICK WITH WWF 6X6-W2.1X2.1 MID DEPTH TYP. CRACK CONTROL JOINT PLACEMENT PER CONTRACTOR / ARCH.
 8. TYPICAL STEM WALL PER 5/S300
 9. REFERENCE ARCHITECTURAL ELEVATIONS & SECTIONS FOR TOP OF WALL ELEVATIONS.


FOOTING SCHEDULE

F1.75	1'-9" X 1'-9" X 8" DEEP CONC. FOOTING W/ (2) # 4 EACH WAY ON BOTTOM
F3.0	3'-0" X 3'-0" X 12" DEEP THICKENED SLAB W/ (4) # 4 EACH WAY IN BOTTOM

- KEY**
- CIP CONCRETE STEM WALL
 - CONCRETE SPREAD FOOTING
 - WALL
 - SHEAR WALL INDICATOR (REF. SHEAR WALL SCHEDULE)
 - HOLDDOWN
 - POST

WALL SECTION GENERAL NOTES:

1. ROOF AND SURFACE RUNOFF SHOULD NOT DISCHARGE INTO THE FOOTING DRAIN SYSTEM.
2. DRAINAGE LAYER & FOOTING DRAINS PER CIVIL / ARCHITECT
3. SHORING WHERE REQUIRED PER OTHERS
4. NO HEAVY EQUIPMENT SURCHARGE PERMITTED NEAR WALL, COMPACT BACKFILL WITH HAND TOOLS.
5. PLACE BACKFILL IN LOOSE LIFTS NOT TO EXCEED 8" DEPTH AND COMPACT TO 90% OF ASTM D-1557. HIGHER DEGREE OF COMPACTION IS NOT RECOMMENDED AS THIS WILL INCREASE THE PRESSURE ACTING ON THE WALL.
6. HAND RAIL ONLY REQUIRED WHEN SOIL IMBALANCE IS GREATER THAN 30". ALTERNATELY, VEHICLE BARRIER MAY BE EXTENDED TO 3'-0" AND HAND RAIL OMITTED. ALTERNATE HAND RAIL CONFIGURATION ALSO PERMISSIBLE. TO BE REVIEWED AS DEFERRED SUBMITTAL BY EOR.
7. VEHICLE BARRIER SHALL BE 6" WHERE SOIL IMBALANCE IS LESS THAN 30", AND 27" WHERE SOIL IMBALANCE IS GREATER THAN 30".

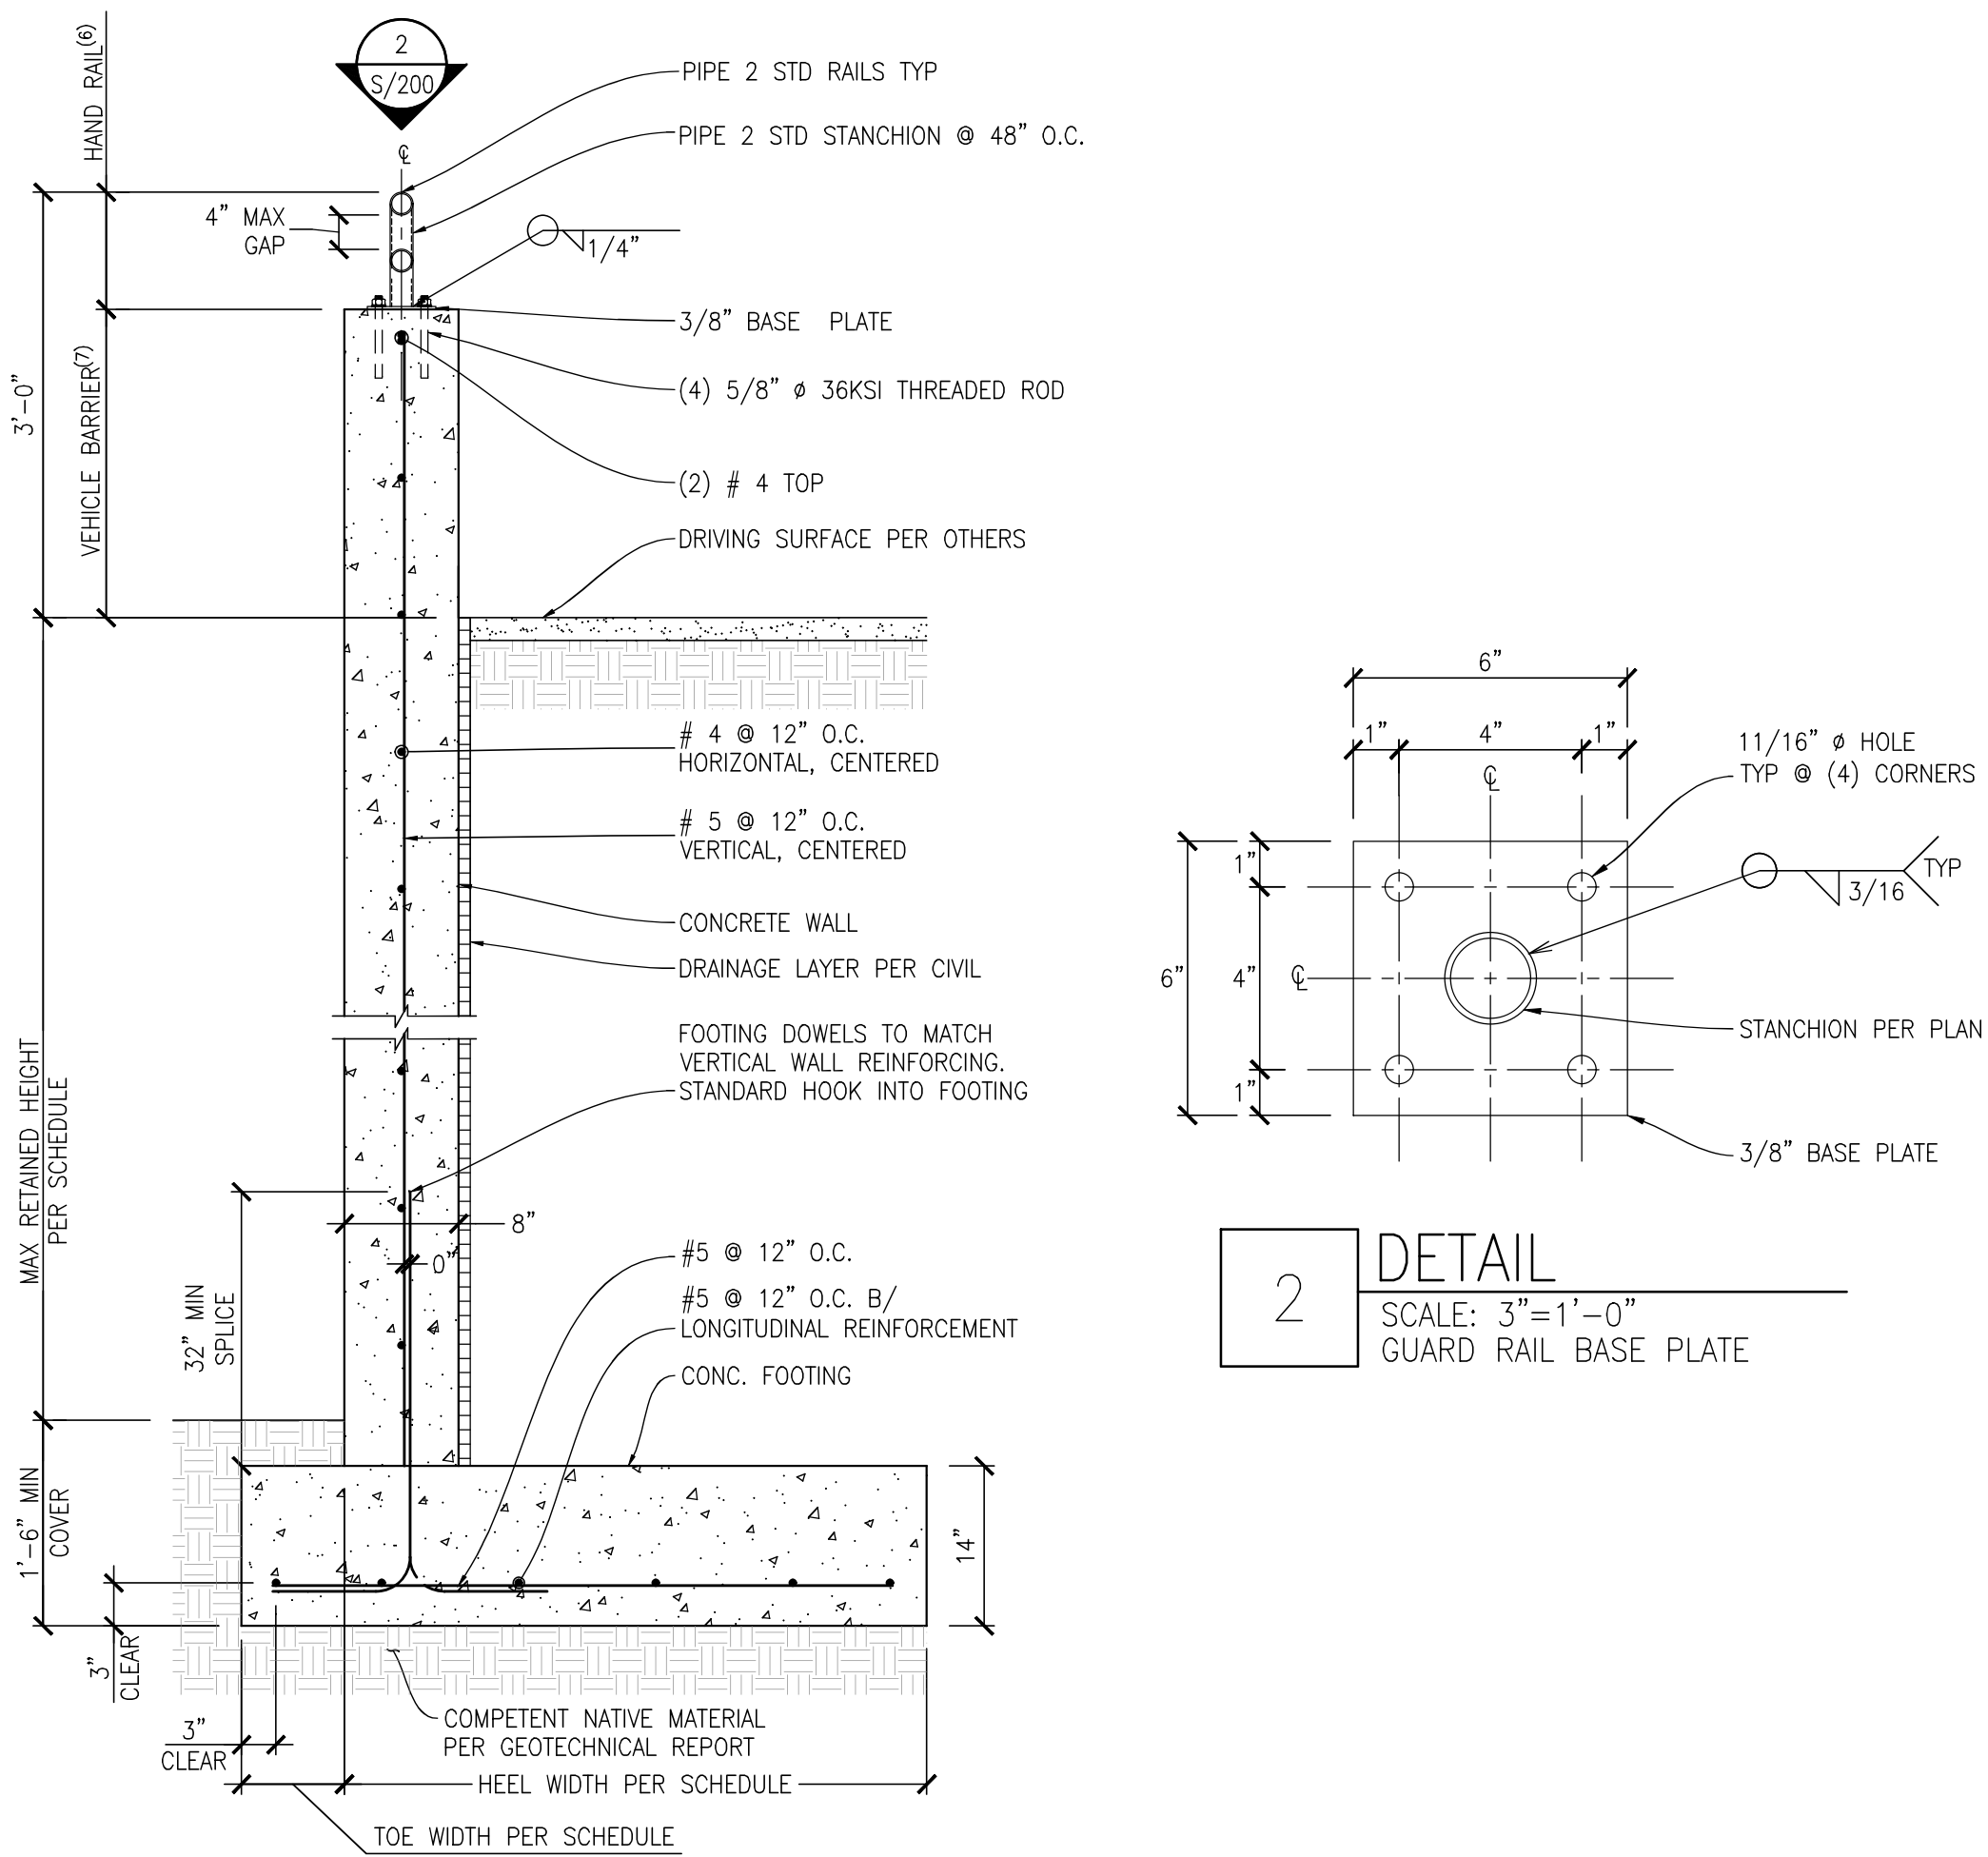


2 DETAIL
SCALE: 3/4"=1'-0"
GUARD RAIL BASE PLATE

RETAINING WALL SCHEDULE (3,500 PSI)

MAX RETAINED HEIGHT	TOE WIDTH	HEEL WIDTH
2'-0" & LESS	1'-0"	2'-9"
4'-0"	1'-0"	3'-3"
6'-0"	1'-0"	3'-9"

1 DETAIL
SCALE: 3/4"=1'-0"
REINFORCED CONCRETE SITE WALL

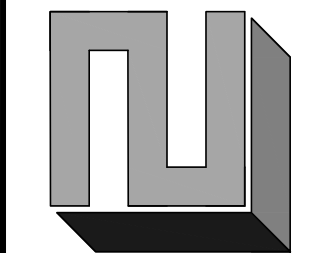

REVISION

DATE



CHK BY: L2E
DRW BY: TNT

SCALE: AS SHOWN
BAR = 1" FULL SIZE


DATE: 06/22/2023

JOB NO: 20-084

SHEET: 4 OF 10

DWG NO: S200

CHECK SET - NOT FOR CONSTRUCTION

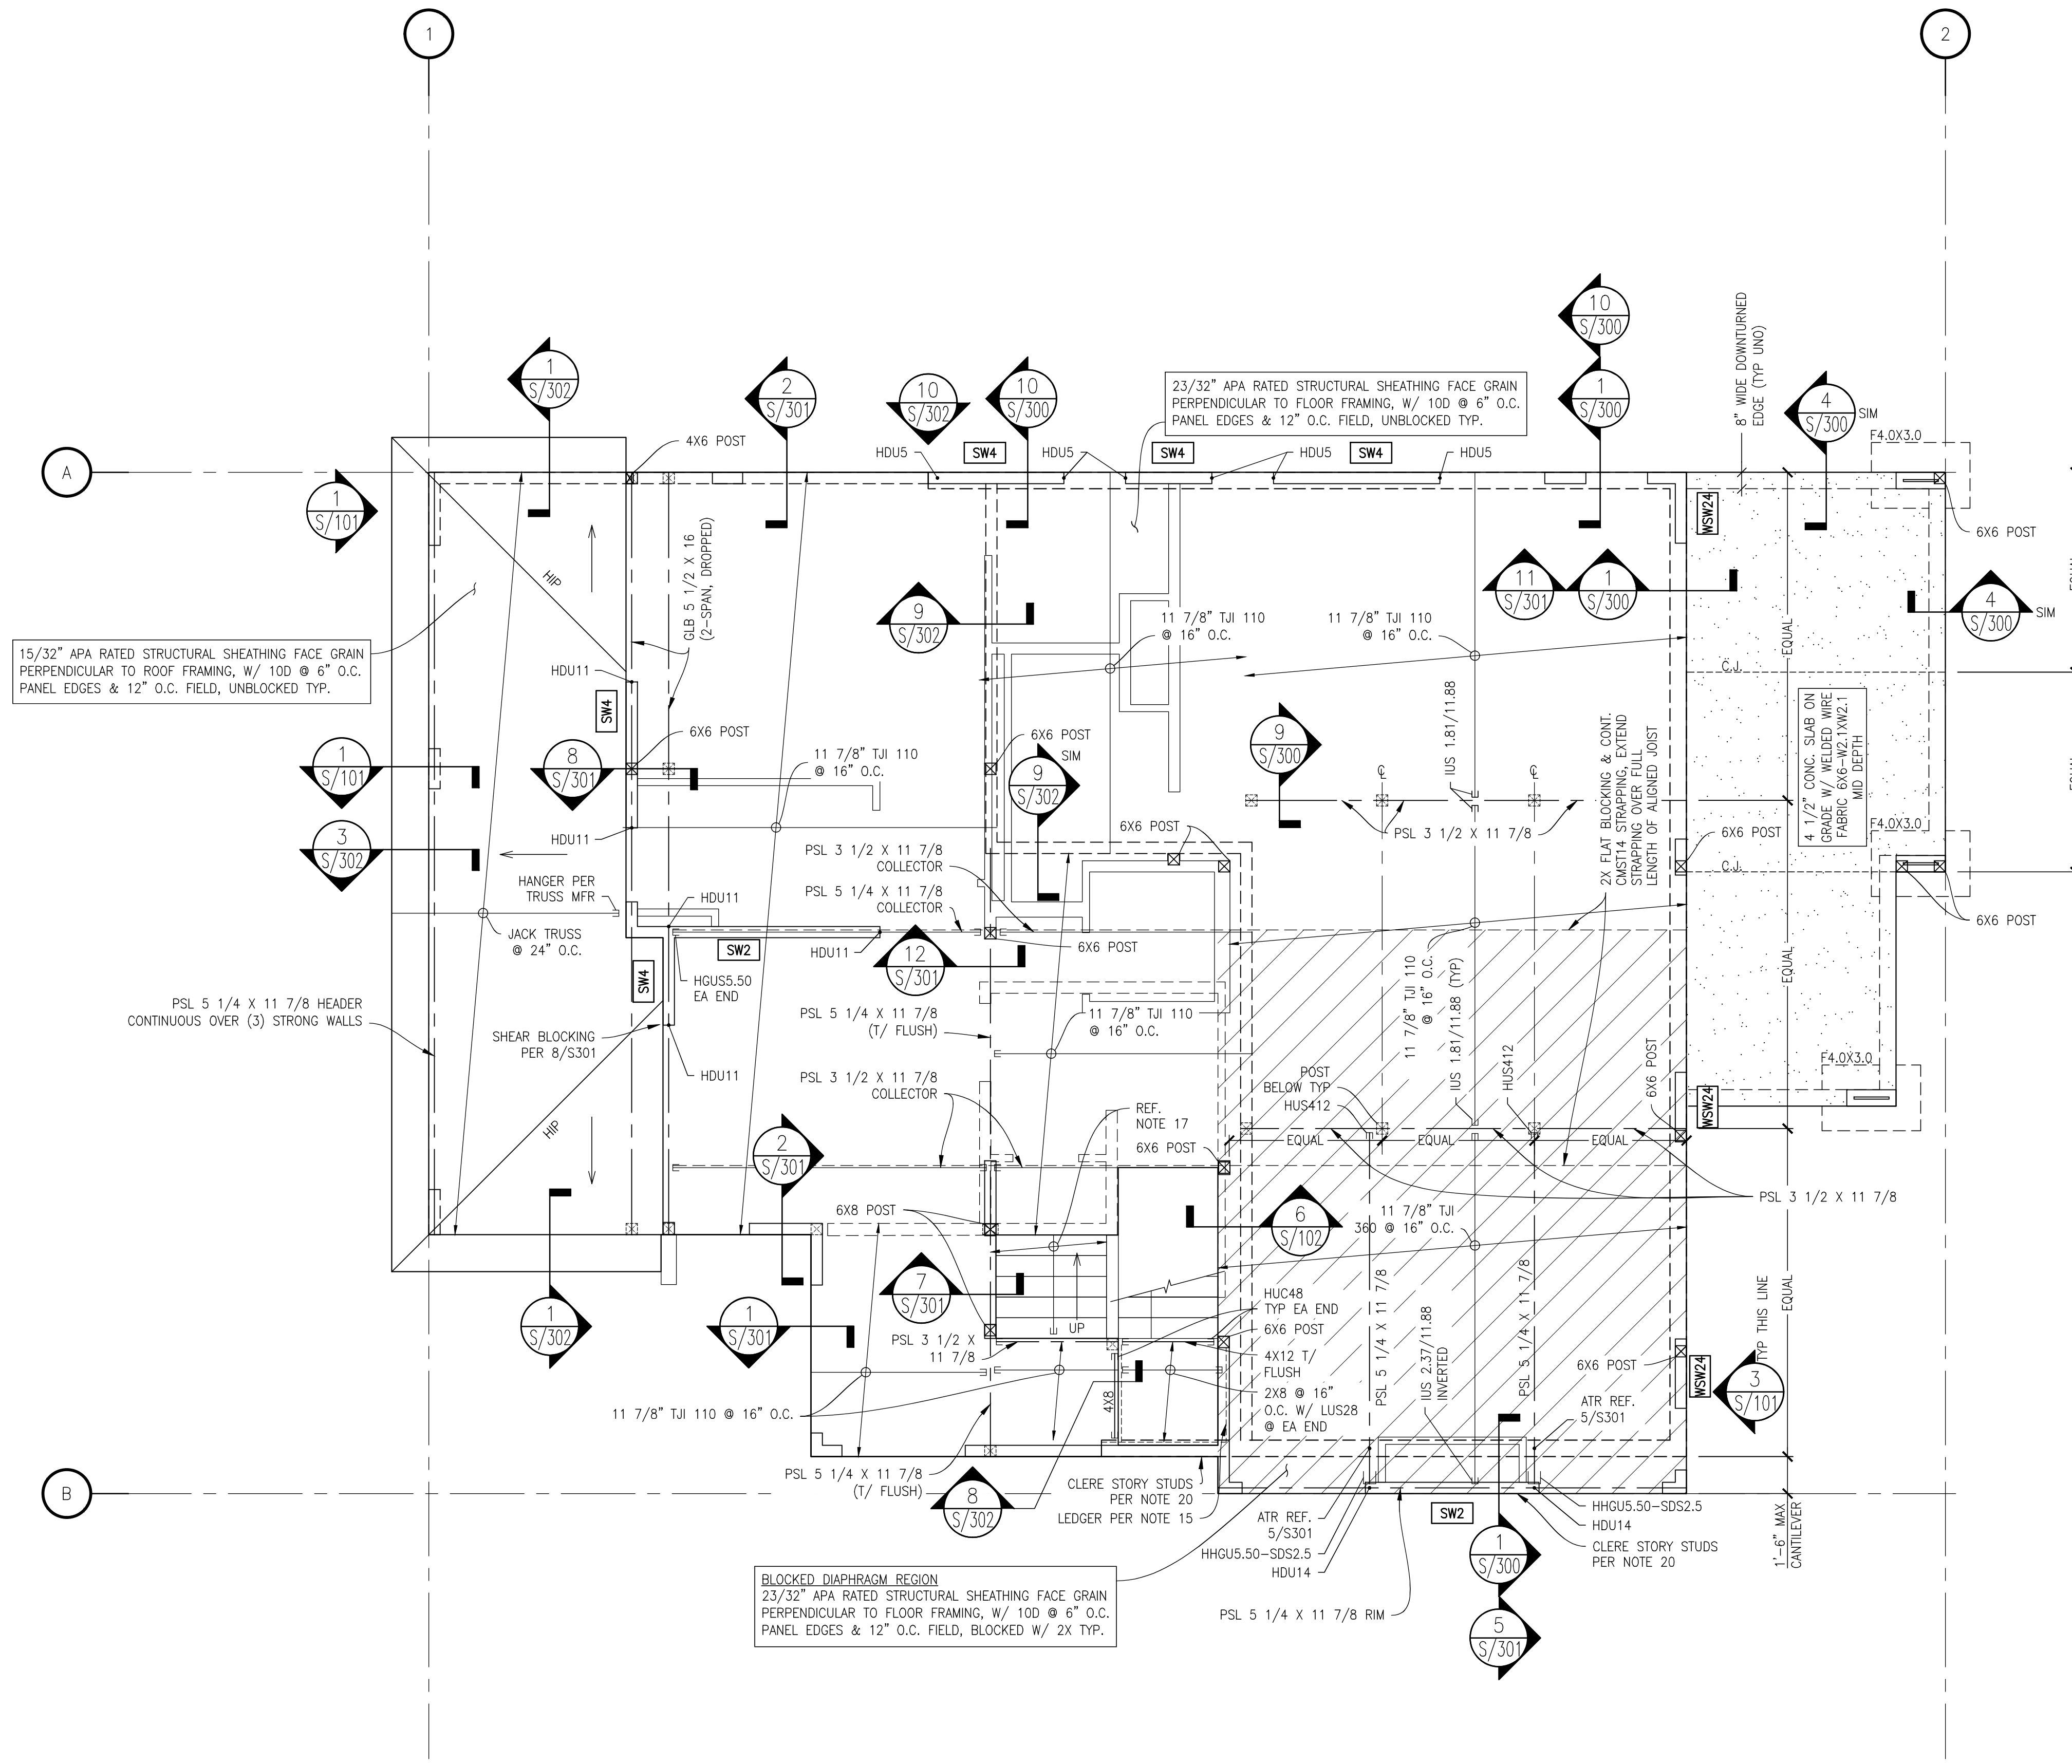


MAIN FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0"

- PLAN NOTES**
- DIMENSIONS: VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
 - ALL RIMS SHALL BE 1-3/4" LSL TYP, U.N.O.
 - TYP MATCH BUNDLED STUDS FROM ABOVE TYP, U.N.O.
 - FLOOR SHEATHING SHALL BE 23/32" APA-RATED STURD-I-FLOOR T&G SHEATHING FACE GRAIN PERPENDICULAR TO FLOOR FRAMING, GLUE & NAIL W/ 10D @ 6" OC EDGES, 10D @ FIELD (UNBLOCKED), TYP.
 - FULLY BLOCK ALL REPETITIVE MEMBERS AT BEARING CONDITIONS, TYP.
 - ALL EXTERIOR WALLS SHALL BE SW-6, UNO ON PLAN.
 - PANEL EDGE NAIL SHEATHING TO FRAMING MEMBERS ALIGNED OVER SHEAR WALLS, TYP.
 - AT ALL WOOD-FRAMED, BEARING AND SHEAR WALLS, REFERENCE STUD GRADE, SIZES AND SPACING PER GENERAL NOTES.
 - ALL EXTERIOR WALLS SHALL BE FRAMED WITH 2X6 STUDS AT 16" ON CENTER, TYP, U.N.O.
 - PROVIDE LUS SERIES HANGERS AT ALL FLUSH FRAMED JOIST CONDITIONS, TYP, U.N.O.
 - ENGINEERED JOIST BRACING PER JOIST MANUFACTURER, TYP.
 - FULLY BLOCK FLOOR CAVITY AT ALL POINT LOADS. VERIFY POINT LOADS ARE SUPPORTED CONTINUOUSLY THROUGH FLOORS TO THE FOUNDATION.
 - ALL HEADERS TO BE 4x10 MINIMUM. HEADERS SHALL BE SUPPORTED BY (2) 2X STUDS MINIMUM, UNO ON PLAN.
 - 2X8 LEDGER WITH (2) 5/8" DIAMETER X 5" LONG TITAN HD @ 16" O.C. (CTR'D BETWEEN JOISTS)
 - SUPPORT BEAMS WITH (3) 2X STUDS MINIMUM, UNO ON PLAN.
 - TYP STAIR STRINGERS - 2X12 @ 12" O.C. W/ LSC ADJUSTABLE STRINGER CONNECTOR AT ENDS.
 - ROOF SHEATHING SHALL BE 15/32" APA-RATED PLYWOOD STRUCTURAL SHEATHING FACE GRAIN PERPENDICULAR TO ROOF FRAMING, NAIL W/ 8D @ 6" OC EDGES, 8D @ 12" O.C. FIELD, UNBLOCKED, TYP.
 - OFFSET JOISTS AS REQUIRED TO AVOID PLUMBING FIXTURES
 - CLERESTORY STUDS SHALL BE LSL 1 3/4 X 5 1/2 @ 12" O.C. FASTEN TOP AND BOTTOM W/ (1) A35 FRAMING CLIP.


FOOTING SCHEDULE
F4.0X3.0 4'-0" X 3'-0" X 12" DEEP CONC. FOOTING
W/ # 4 @ 12" O.C. EACH WAY IN BOTTOM

- KEY**
- CIP CONCRETE STEM WALL
 - - - CONCRETE SPREAD FOOTING
 - == WALL BELOW
 - WALL
 - SW# SHEAR WALL INDICATOR (REF. SHEAR WALL SCHEDULE)
 - XX HOLDDOWN
 - ⊠ POST
 - ⊠ POST BELOW
 - HANGER

L2 ENGINEERS
DESIGN AND PLANNING
17848 NE 198TH PLACE
WOODINVILLE, WA 98072

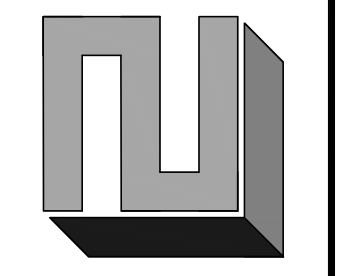


REVISION	DATE

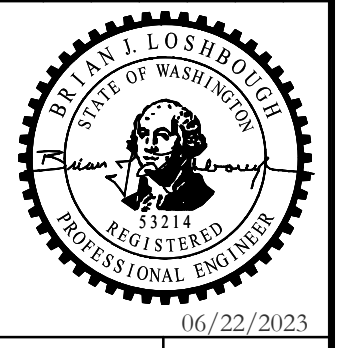

CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
MAIN FLOOR FRAMING PLAN

CHK BY: LZE	DRW BY: TNT
SCALE: AS SHOWN BAR = 1" FULL SIZE	
DATE: 06/22/2023	
JOB NO: 20-084	
SHEET: 5 OF 10	
DWG NO: S201	



CHECK SET - NOT FOR CONSTRUCTION

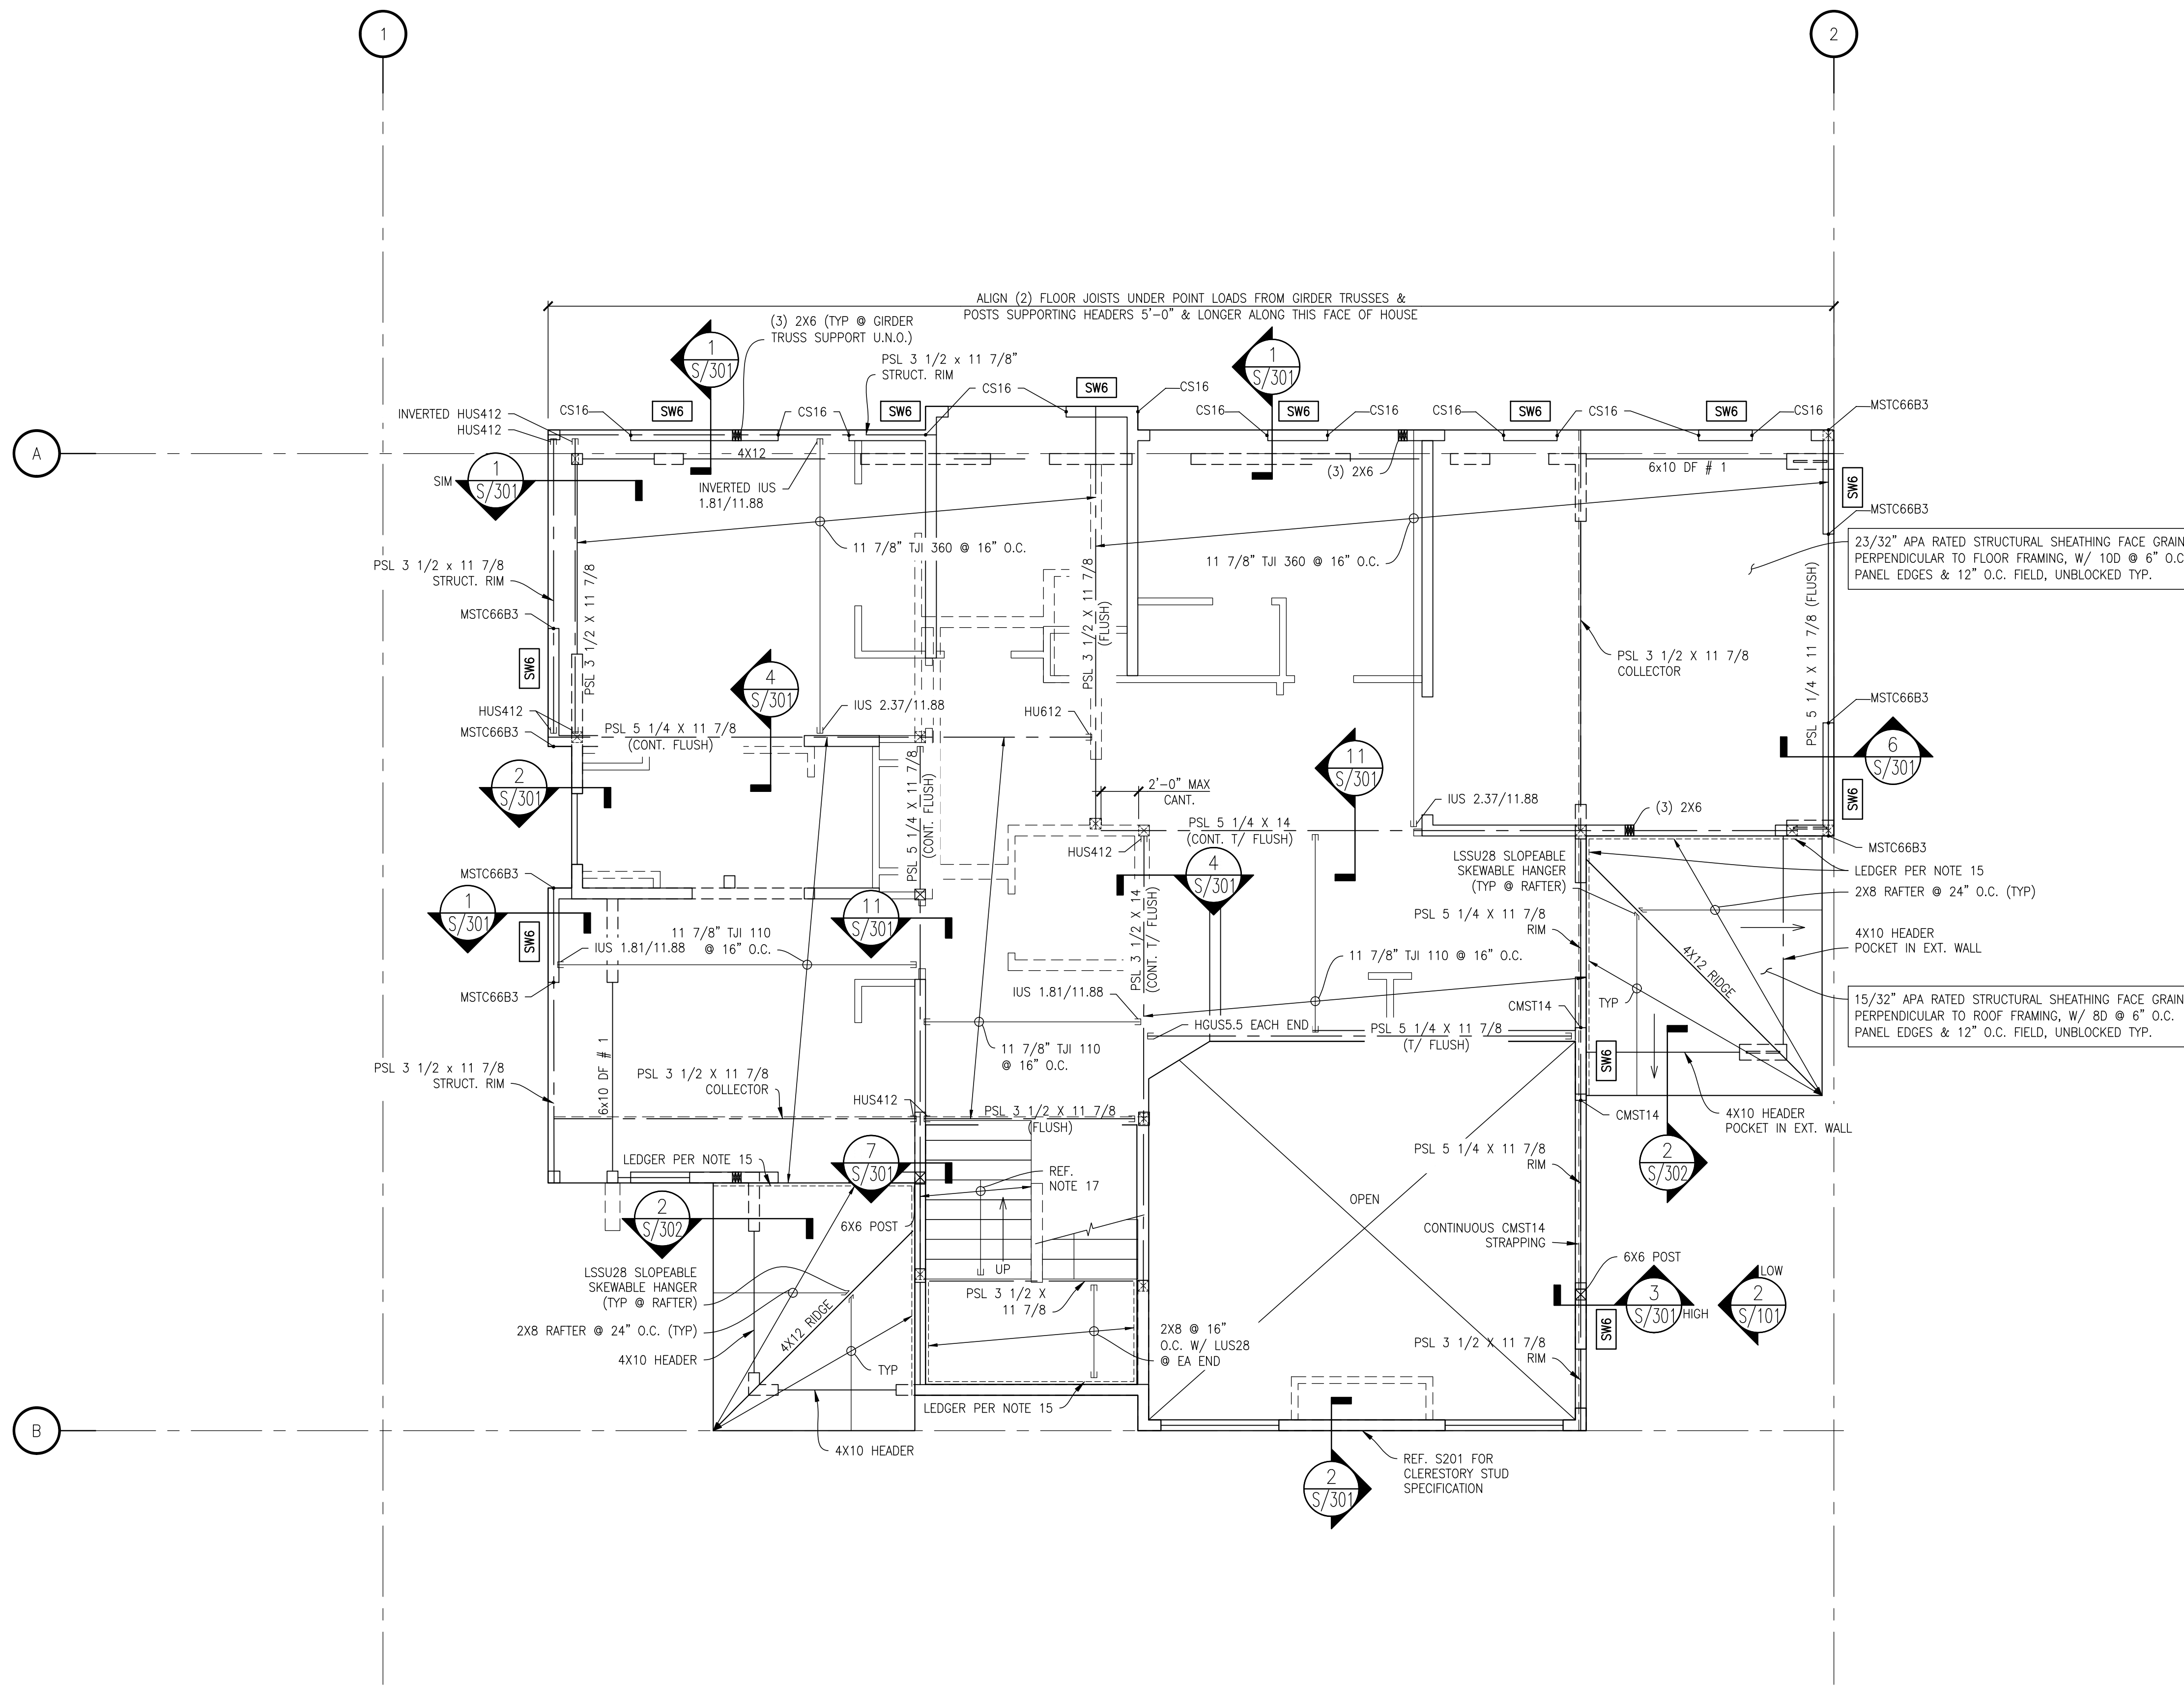


- PLAN NOTES**
- DIMENSIONS: VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
 - ALL RIMS SHALL BE 1-3/4" LSL TYP. U.N.O.
 - MATCH BUNDLED STUDS FROM ABOVE TYP. U.N.O.
 - FLOOR SHEATHING SHALL BE 23/32" APA-RATED STURD-I-FLOOR T&G SHEATHING FACE GRAIN PERPENDICULAR TO FLOOR FRAMING, GLUE & NAIL W/ 10D @ 6" OC EDGES, 10D @ FIELD (UNBLOCKED), TYP.
 - FULLY BLOCK ALL REPETITIVE MEMBERS AT BEARING CONDITIONS, TYP.
 - ALL EXTERIOR WALLS SHALL BE SW-6, UNO ON PLAN.
 - PANEL EDGE NAIL SHEATHING TO FRAMING MEMBERS ALIGNED OVER SHEAR WALLS, TYP.
 - AT ALL WOOD-FRAMED, BEARING AND SHEAR WALLS, REFERENCE STUD GRADE, SIZES AND SPACING PER GENERAL NOTES.
 - ALL EXTERIOR WALLS SHALL BE FRAMED WITH 2X6 STUDS AT 16" ON CENTER, TYP. U.N.O.
 - PROVIDE LUS SERIES HANGERS AT ALL FLUSH FRAMED JOIST CONDITIONS, TYP. U.N.O.
 - PROVIDE ITS SERIES HANGERS AT ALL FLUSH FRAMED JOIST CONDITIONS, TYP. U.N.O.
 - ENGINEERED JOIST BRACING PER JOIST MANUFACTURER, TYP.
 - FULLY BLOCK FLOOR CAVITY AT ALL POINT LOADS. VERIFY POINT LOADS ARE SUPPORTED CONTINUOUSLY THROUGH FLOORS TO THE FOUNDATION.
 - ALL HEADERS TO BE 4X10 MINIMUM. HEADERS SHALL BE SUPPORTED BY (2) 2X STUDS MINIMUM, UNO ON PLAN.
 - 2X8 LEDGER FASTEN TO WOOD FRAMING W/ (2) 1/4" Ø X 4 1/2 SDS @ 24" O.C.
 - SUPPORT BEAMS WITH (3) 2X STUDS MINIMUM, UNO ON PLAN.
 - TYP STAIR STRINGERS - 2X12 @ 12" O.C. W/ LSC ADJUSTABLE STRINGER CONNECTOR AT ENDS.
 - OFFSET JOISTS AS REQUIRED TO AVOID PLUMBING FIXTURES

- KEY**
- WALL BELOW
 - ==== WALL
 - SW# SHEAR WALL INDICATOR (REF. SHEAR WALL SCHEDULE)
 - XX HOLDDOWN
 - ⊠ POST
 - ⊠ POST BELOW
 - HANGER

UPPER FLOOR FRAMING PLAN
SCALE: 1/4"=1'-0"

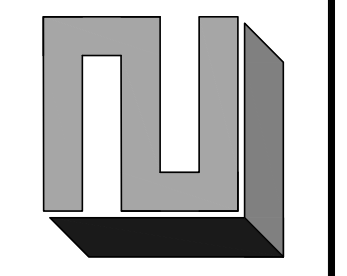

DATE	REVISION

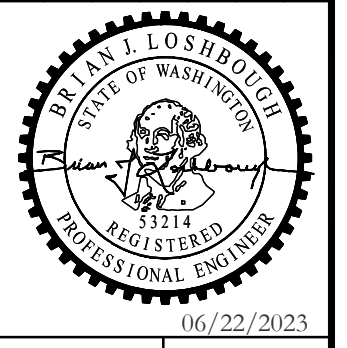

CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
UPPER FLOOR FRAMING PLAN

CHK BY: LZE
DRW BY: TNT

SCALE: AS SHOWN
BAR = 1"
FULL SIZE


DATE: 06/22/2023

JOB NO: 20-084


SHEET: 6 OF 10

DWG NO: S202

CHECK SET - NOT FOR CONSTRUCTION

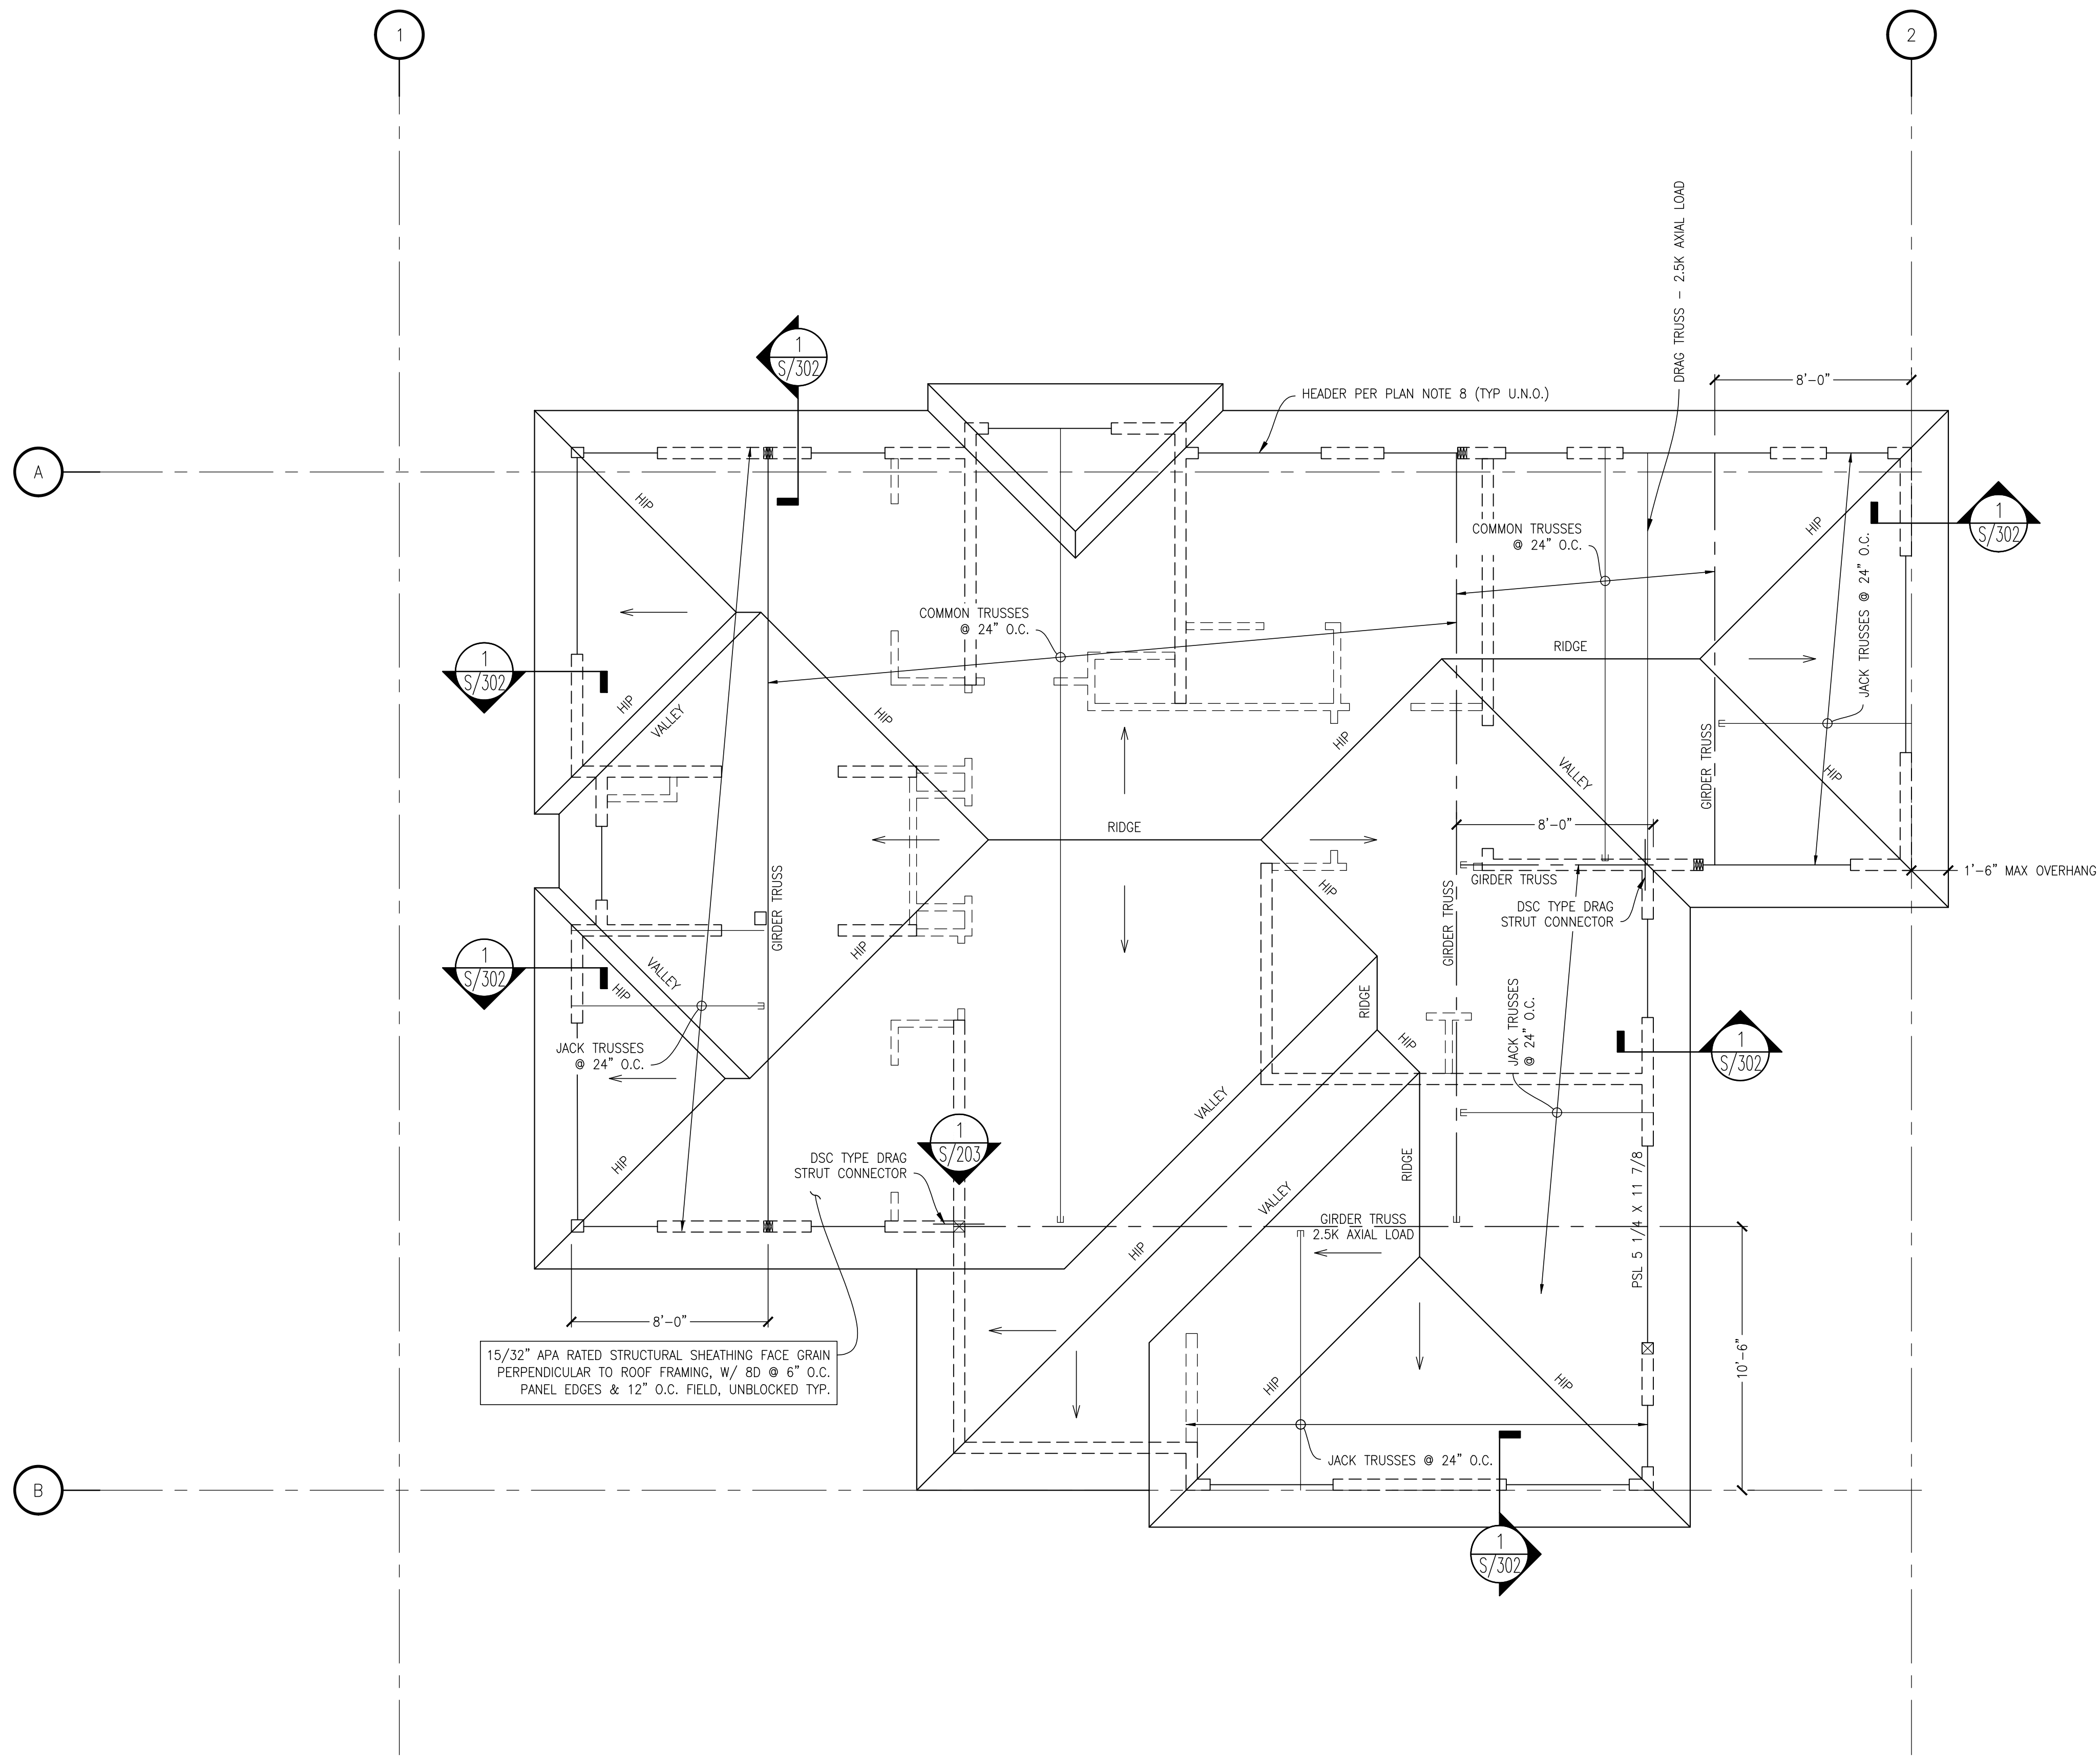


ROOF FRAMING PLAN
SCALE: 1/4"=1'-0"




- PLAN NOTES**
- DIMENSIONS: VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS.
 - ROOF SHEATHING SHALL BE 15/32" APA-RATED PLYWOOD STRUCTURAL SHEATHING FACE GRAIN PERPENDICULAR TO ROOF FRAMING, NAIL W/ 8D @ 6" OC EDGES, 8D @ 12" O.C. FIELD, UNBLOCKED, TYP.
 - FULLY BLOCK ALL REPETITIVE MEMBERS AT BEARING CONDITIONS, TYP.
 - PROVIDE SIMPSON H1 AT ALL ROOF FRAMING TO EXTERIOR WALLS.
 - PANEL EDGE NAIL SHEATHING TO FRAMING MEMBERS ALIGNED OVER SHEAR WALLS, TYP.
 - TRUSS BRACING PER TRUSS MANUFACTURER, TYP.
 - SUPPORT GIRDER/MASTER TRUSSES WITH (3) 2X STUDS MINIMUM, TYP, U.N.O.
 - ALL EXTERIOR WALLS SHALL BE FRAMED WITH 2X6 STUDS AT 16" ON CENTER, TYP, U.N.O.
 - ALL EXTERIOR WALLS SHALL BE SW6, U.N.O.
 - AT ALL WOOD-FRAMED, BEARING AND SHEAR WALLS, REFERENCE STUD GRADE, SIZES AND SPACING PER GENERAL NOTES.
 - AT SHEAR WALLS PARALLEL TO FRAMING, ALIGN RAFTER OR BEAM PER PLAN OVER AND UNDER ALL SHEAR WALLS AND BEARING WALLS.
 - ALL HEADERS TO BE 4X8 MINIMUM. HEADERS SHALL BE SUPPORTED BY (2) 2X STUDS MINIMUM, UNO ON PLAN.
 - TYPICAL LEDGER SHALL BE 2X12 WITH (2) 1/4" DIAMETER X 5" LONG SDS SCREW CTR'D IN EACH STUD (STUDS @ 16" O.C.).
 - SUPPORT BEAMS WITH (3) 2X STUDS MINIMUM, UNO ON PLAN.
 - TYP STAIR STRINGERS - 2X12 @ 12" O.C. W/ LSC ADJUSTABLE STRINGER CONNECTOR AT ENDS
 - OPEN WEB WOOD TRUSS (OWWT) LOADING:**
TRUSS SELF WEIGHT IS NOT INCLUDED IN DEAD LOADS. SELF WEIGHT SHALL BE DETERMINED BY TRUSS MANUFACTURER AND INCLUDED IN TRUSS CALCULATIONS.
TOP CHORD: DEAD LOAD: 10 PSF
LIVE LOAD: 20 PSF
SNOW LOAD: 25 PSF
BOTTOM CHORD: DEAD LOAD: 5 PSF


- KEY**
- WALL BELOW
 - POST BELOW
 - HANGER

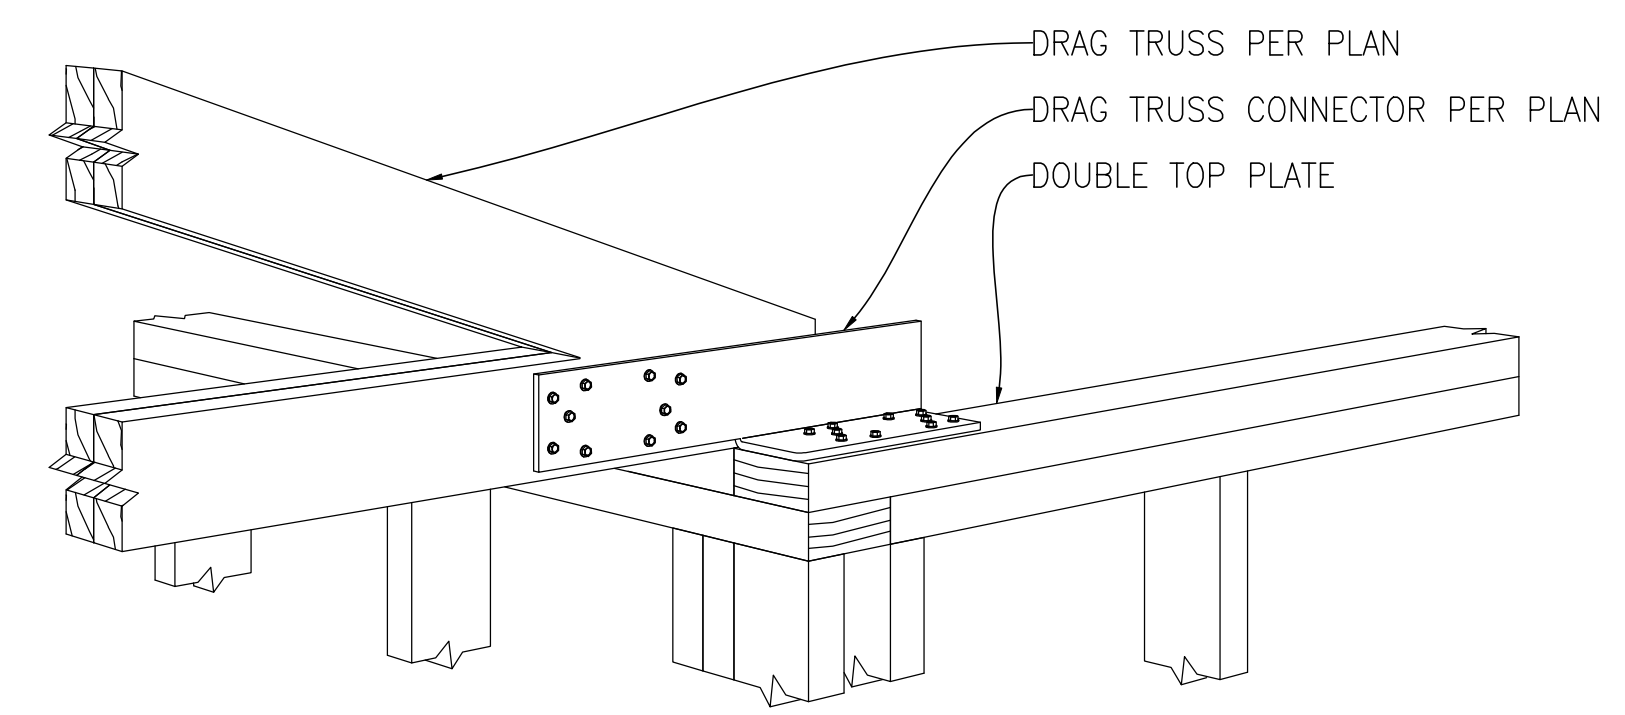

1 DETAIL
NTS
DRAG STRUT CONNECTOR

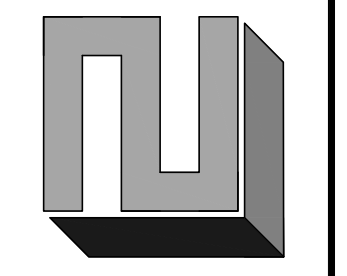

DATE	REVISION

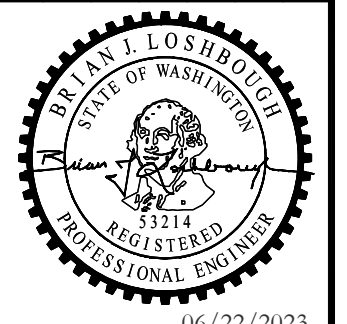

CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
ROOF FRAMING PLAN


CHK BY: LZE
DRW BY: TNT

SCALE: AS SHOWN
BAR = 1"
FULL SIZE


DATE: 06/22/2023
JOB NO: 20-084
SHEET: 7 OF 10
DWG NO: S203

WALL SECTION GENERAL NOTES:


- 4" PERFORATED PVC FOOTING DRAIN WRAPPED IN FILTER FABRIC.
- APPLY PRE-FABRICATED DRAINAGE PANEL (MIRADRAIN 6000 OR EQUIVALENT) TO ALL PERIMETER RETAINING WALLS. EXTEND DRAINAGE PANEL OVER THE FULL HEIGHT OF THE WALL. A 12" THICK LAYER OF FREE-DRAINING GRANULAR FILL MAY BE USED IN LIEU OF THE DRAINAGE PANEL.
- ROOF AND SURFACE RUNOFF SHOULD NOT DISCHARGE INTO THE FOOTING DRAIN SYSTEM.
- SHORING WHERE REQUIRED PER OTHERS
- HEEL AND TOE NOT TO SCALE, BUILD ACCORDING TO DETAIL DIMENSIONS.
- HEAVY EQUIPMENT SURCHARGE NOT PERMITTED ADJACENT TO RETAINING WALL, HEEL SIDE.

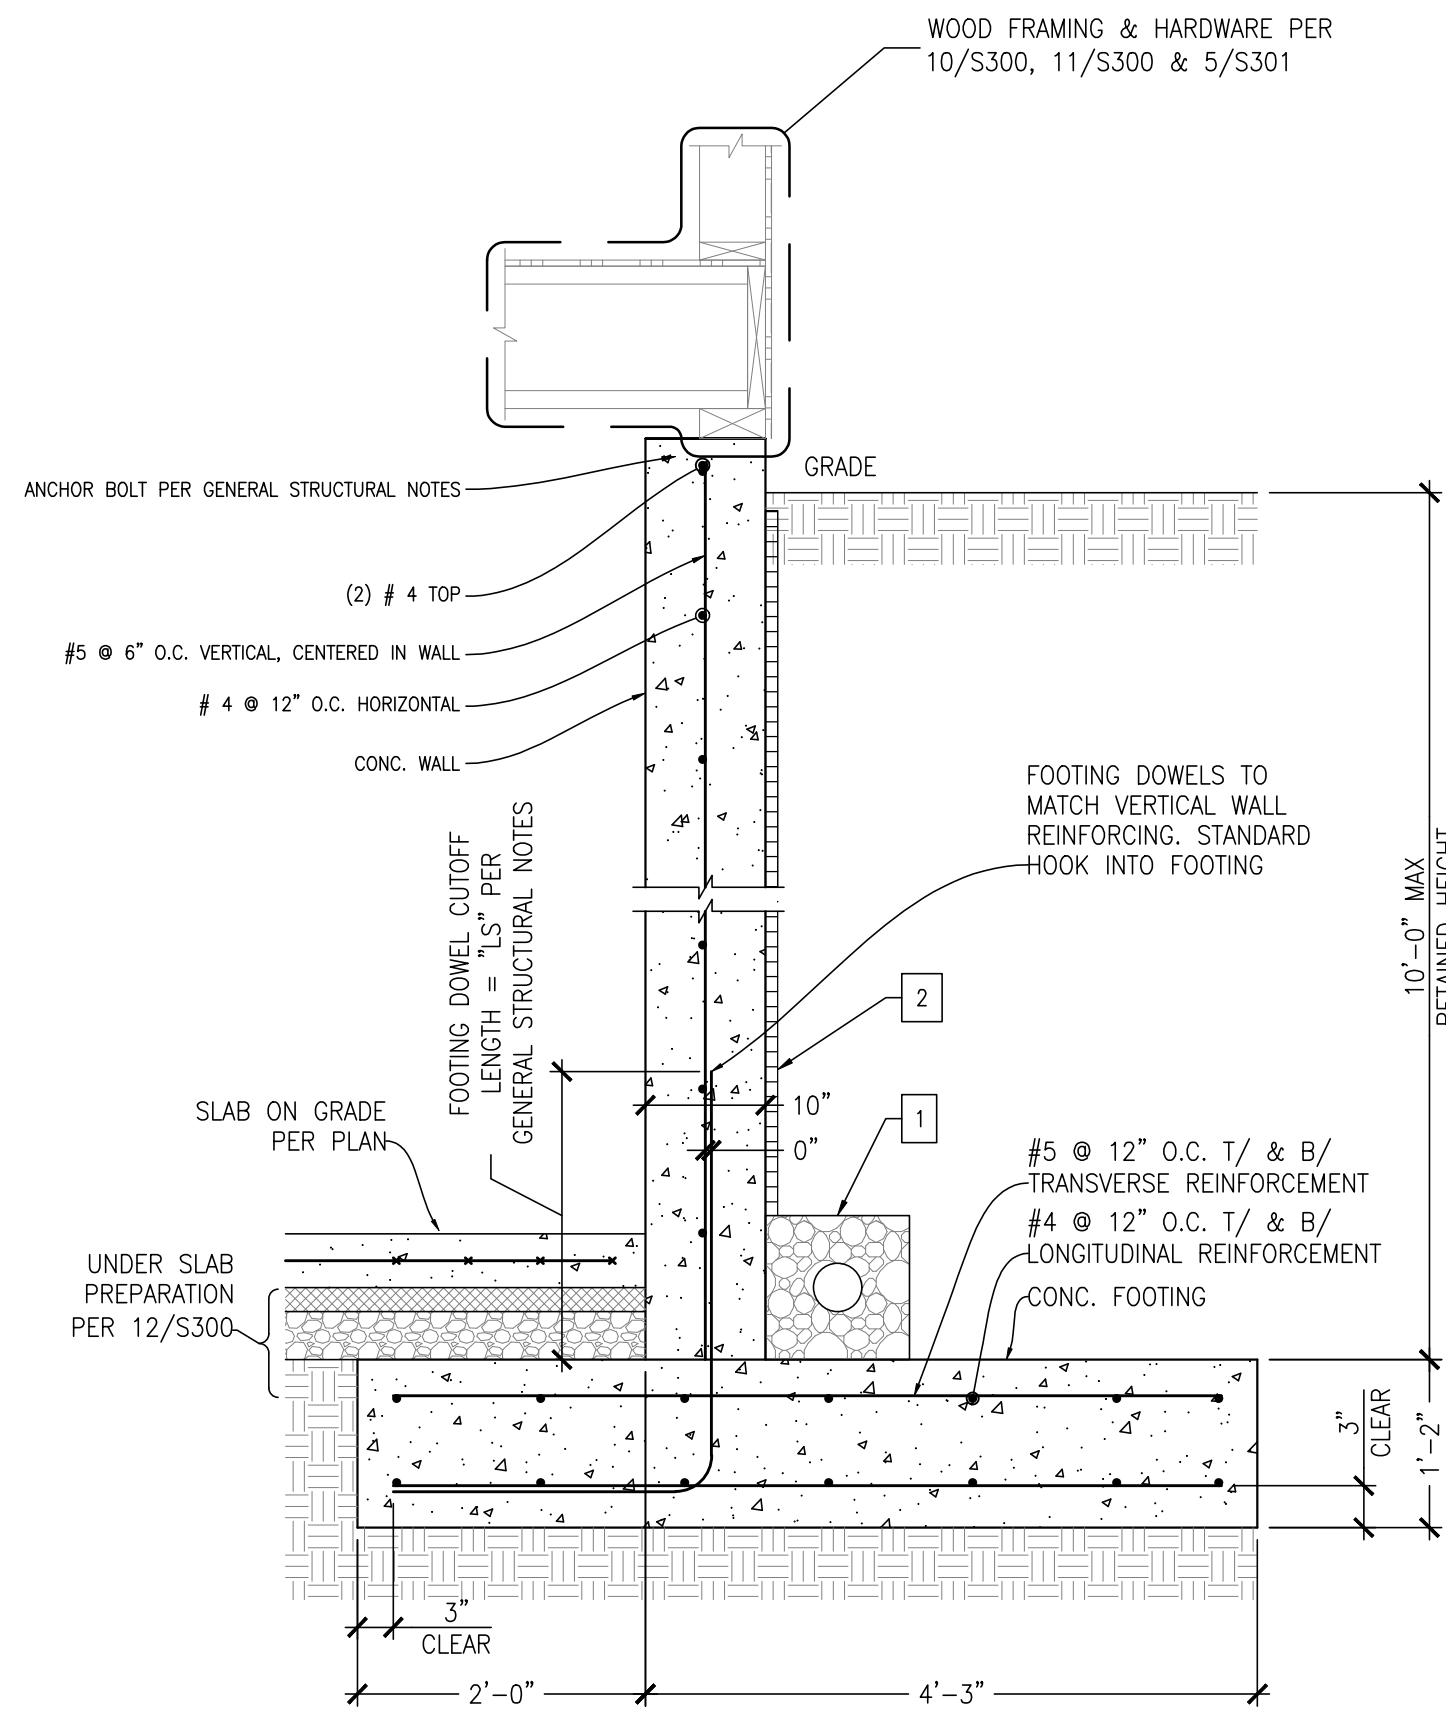


1 DETAIL
SCALE: 3/4"=1'-0"
EXTERIOR RETAINING WALL

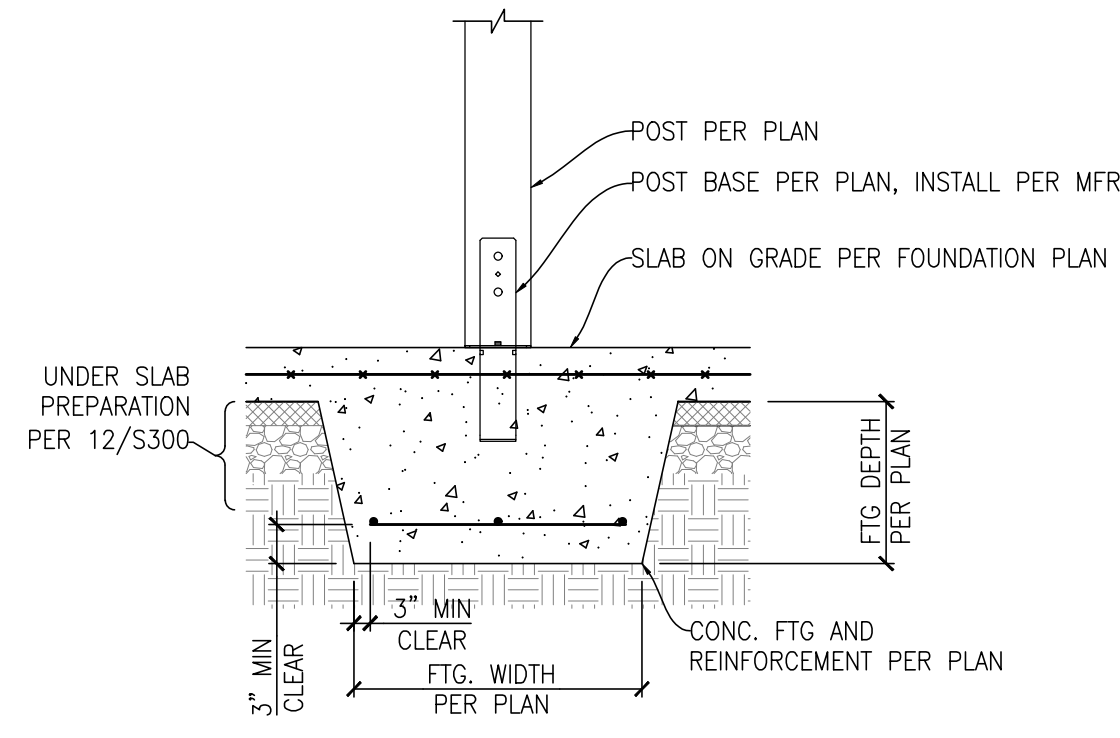

2 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL THICKENED SLAB

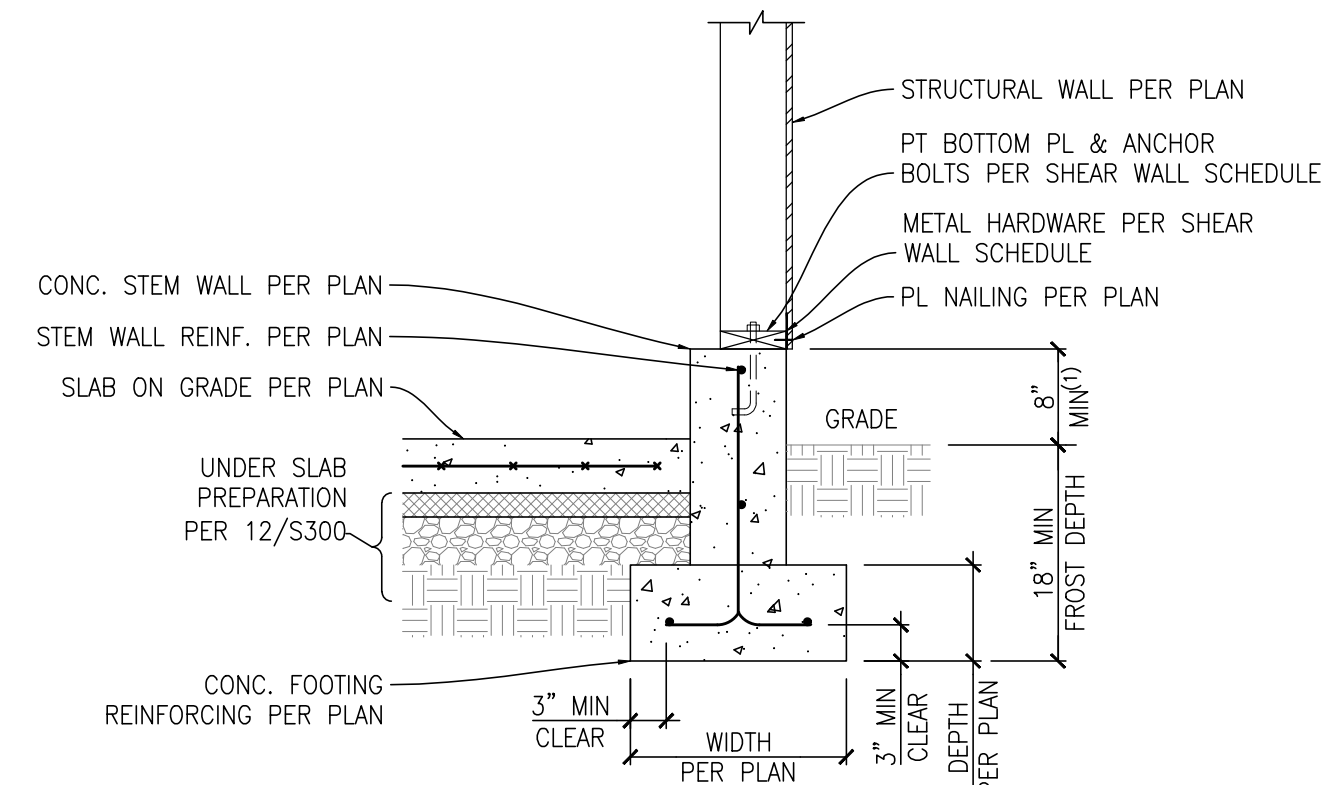


3 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL EXTERIOR STRIP FOOTING

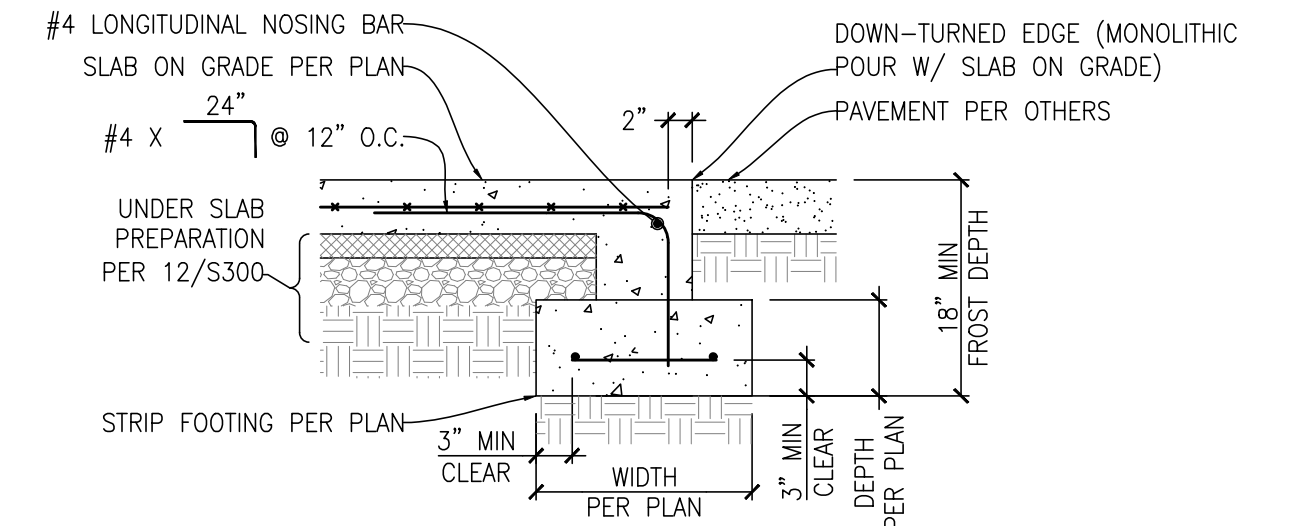


4 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL DOWNTURNED EDGE

NOTE
1) 2'-6" MAXIMUM SOIL IMBALANCE, ELSE USE DETAIL 1/S300


NOTE
NO STRIP FOOTING AT "SIM" CONDITION, EXTEND DOWNTURNED EDGE TO FROST DEPTH.

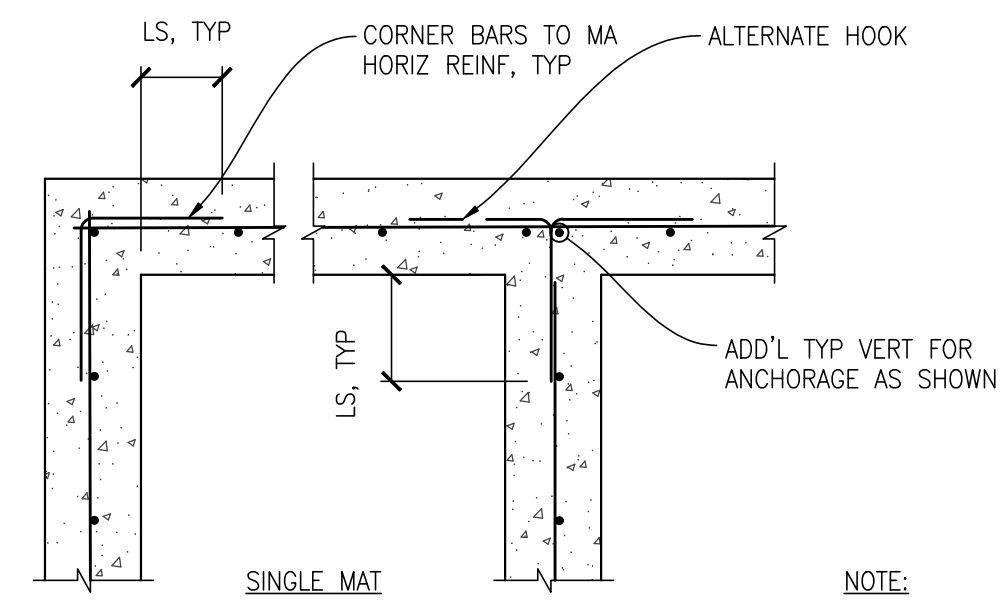

5 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL CORNER REINFORCING

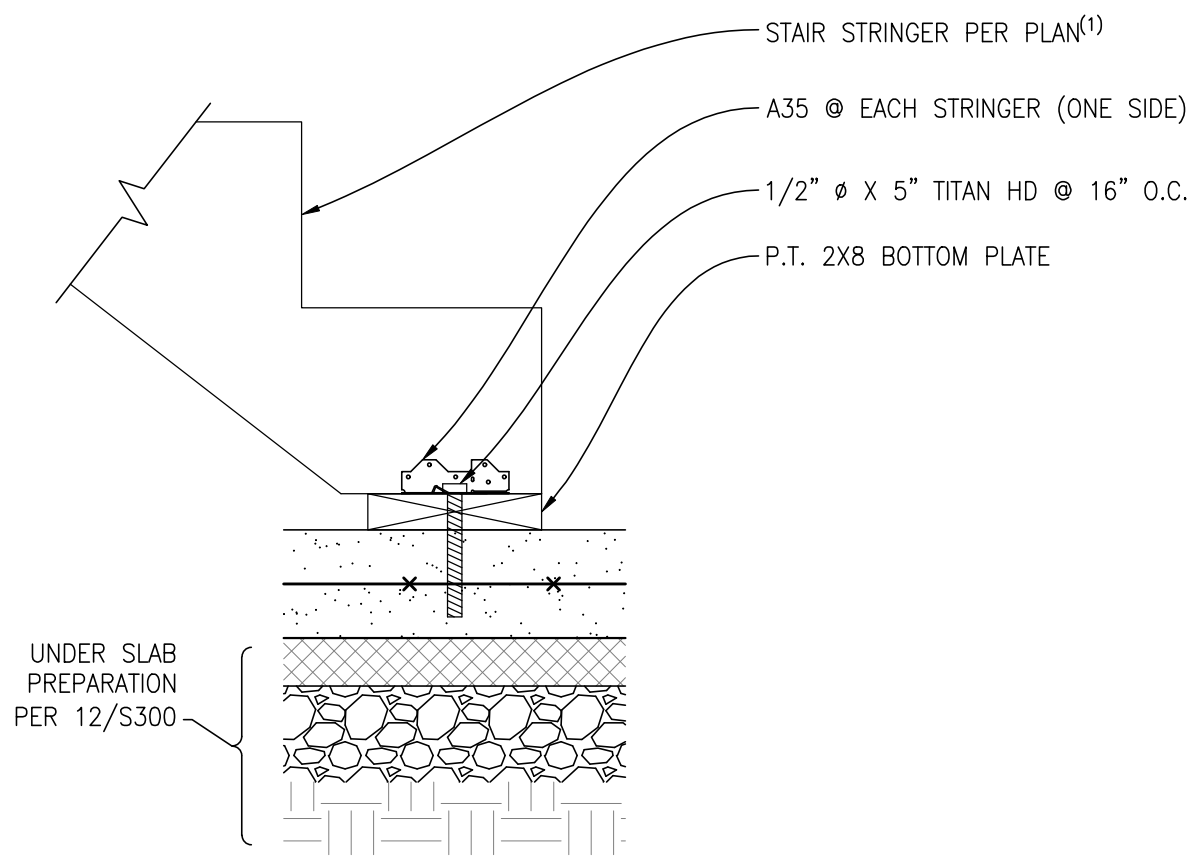


6 DETAIL
SCALE: 1 1/2"=1'-0"
WOOD STRINGER TO SOG

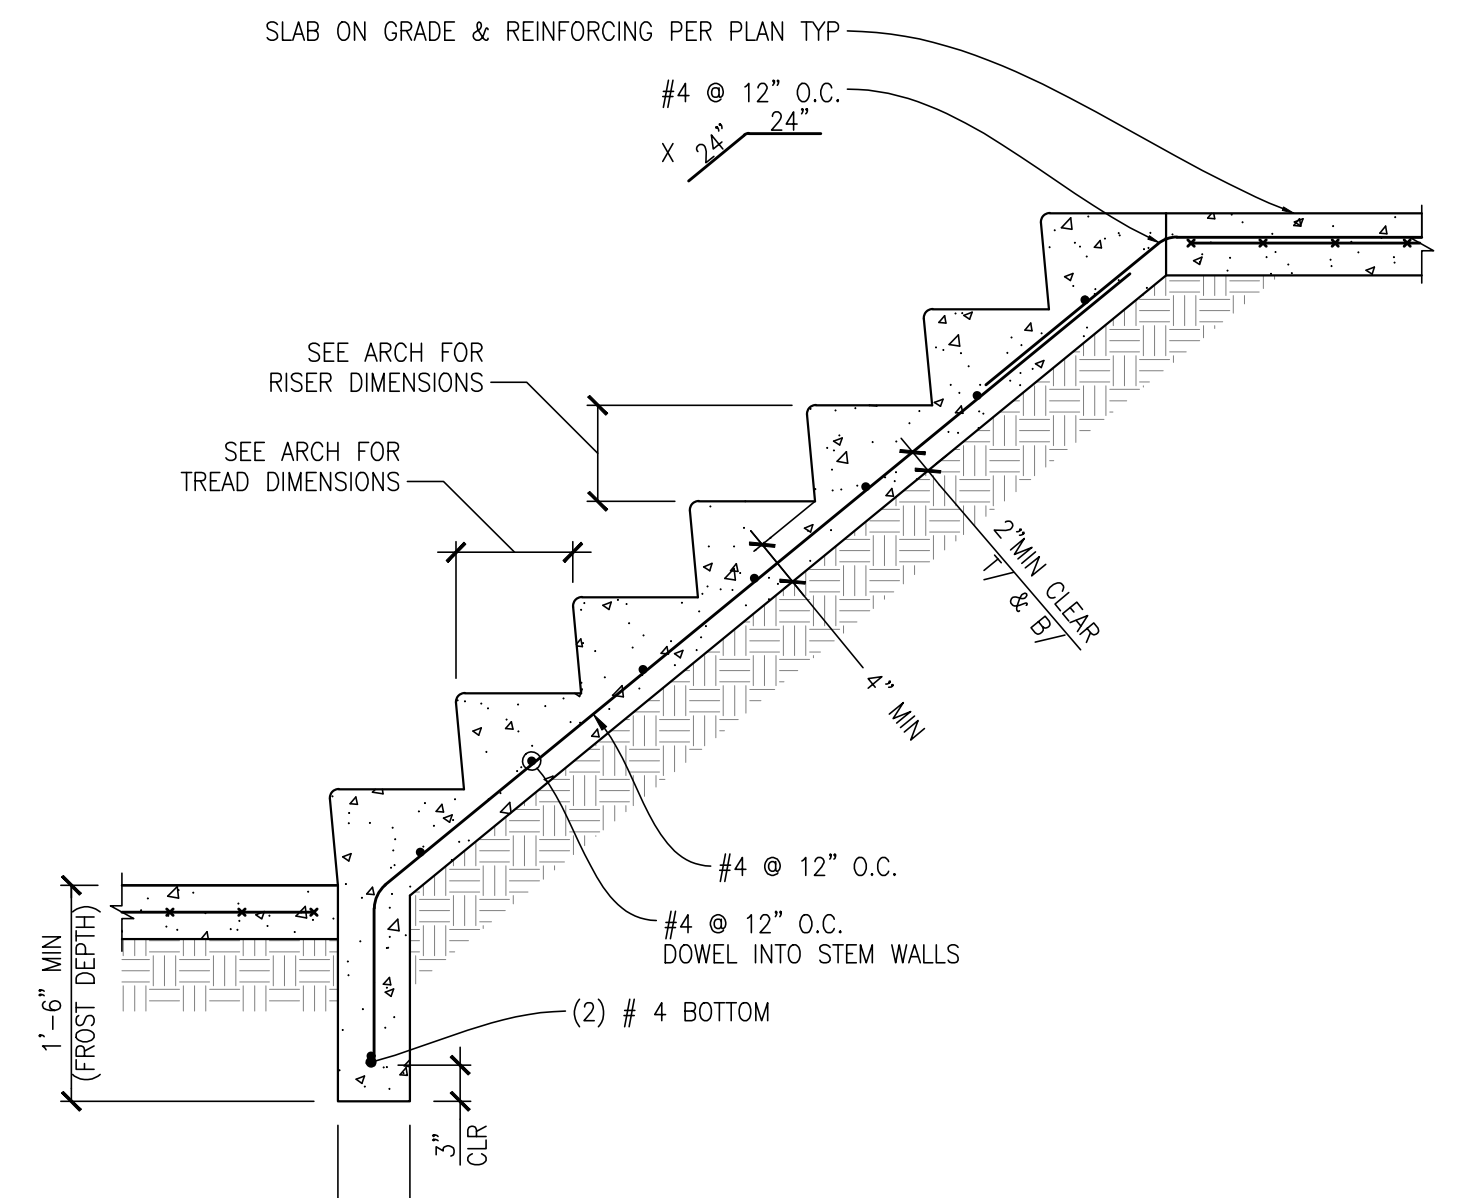


7 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL CONC. STAIR ON GRADE


- NOTES
- UNDER FOOTING PREPARATION PER GEOTECHNICAL ENGINEER
 - FOOTING WIDTH AS NOTED ON PLAN CORRESPONDS TO 2'-6" MAX SOIL IMBALANCE
 - EXTEND HEEL ADDITIONAL 8" FOR SOIL IMBALANCES BETWEEN 2'-6" & 4'-0" EXTEND HEEL REINFORCING A CORRESPONDING AMOUNT

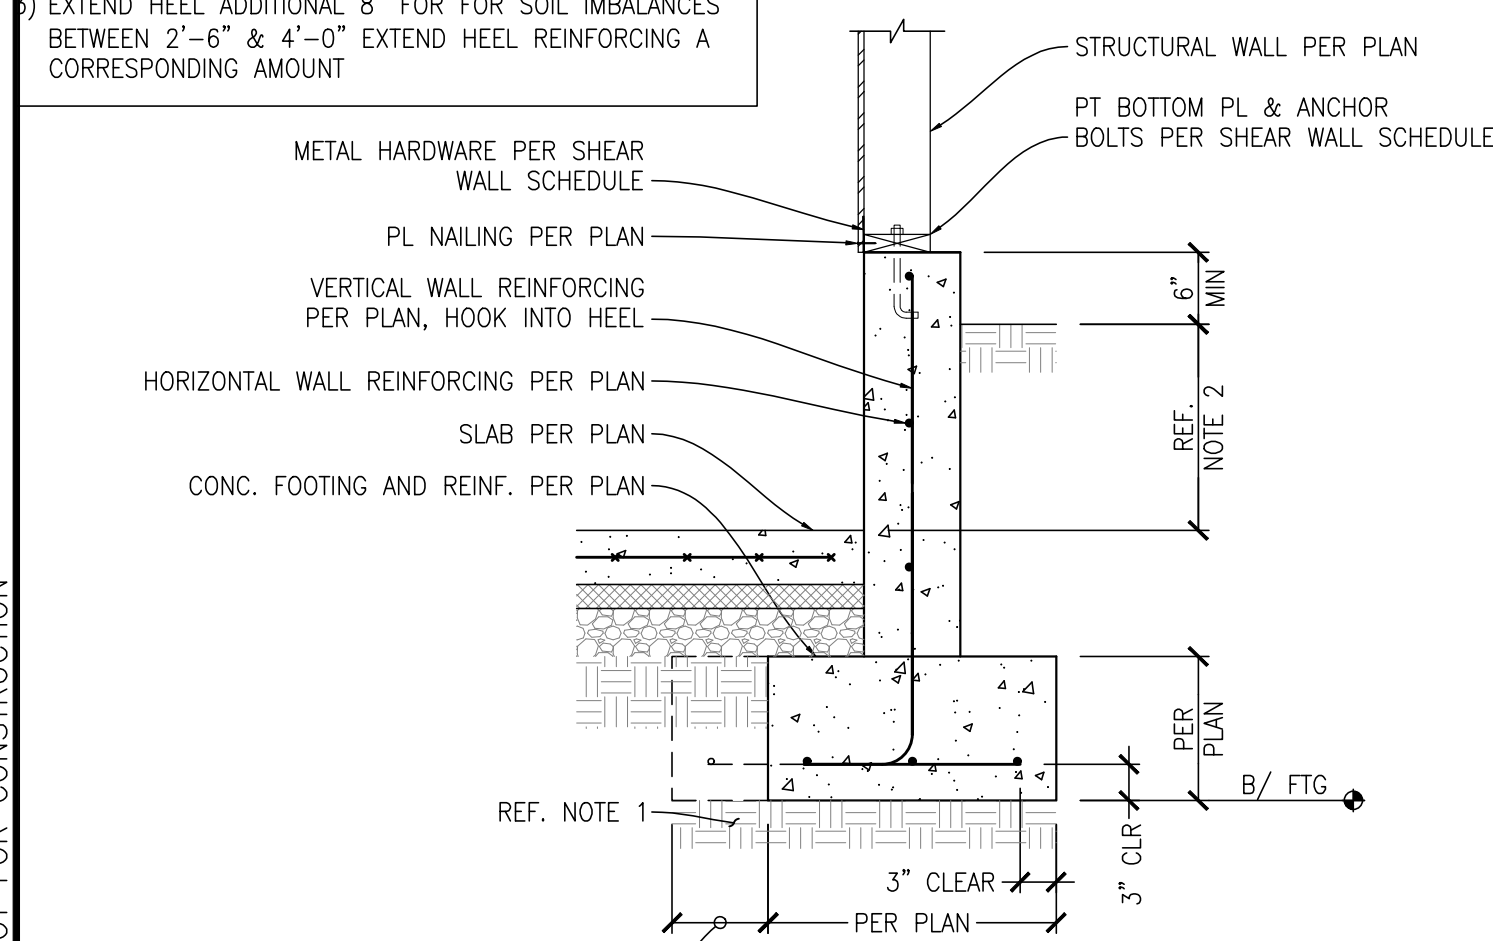


8 DETAIL
SCALE: 3/4"=1'-0"
INTERIOR RETAINING WALL

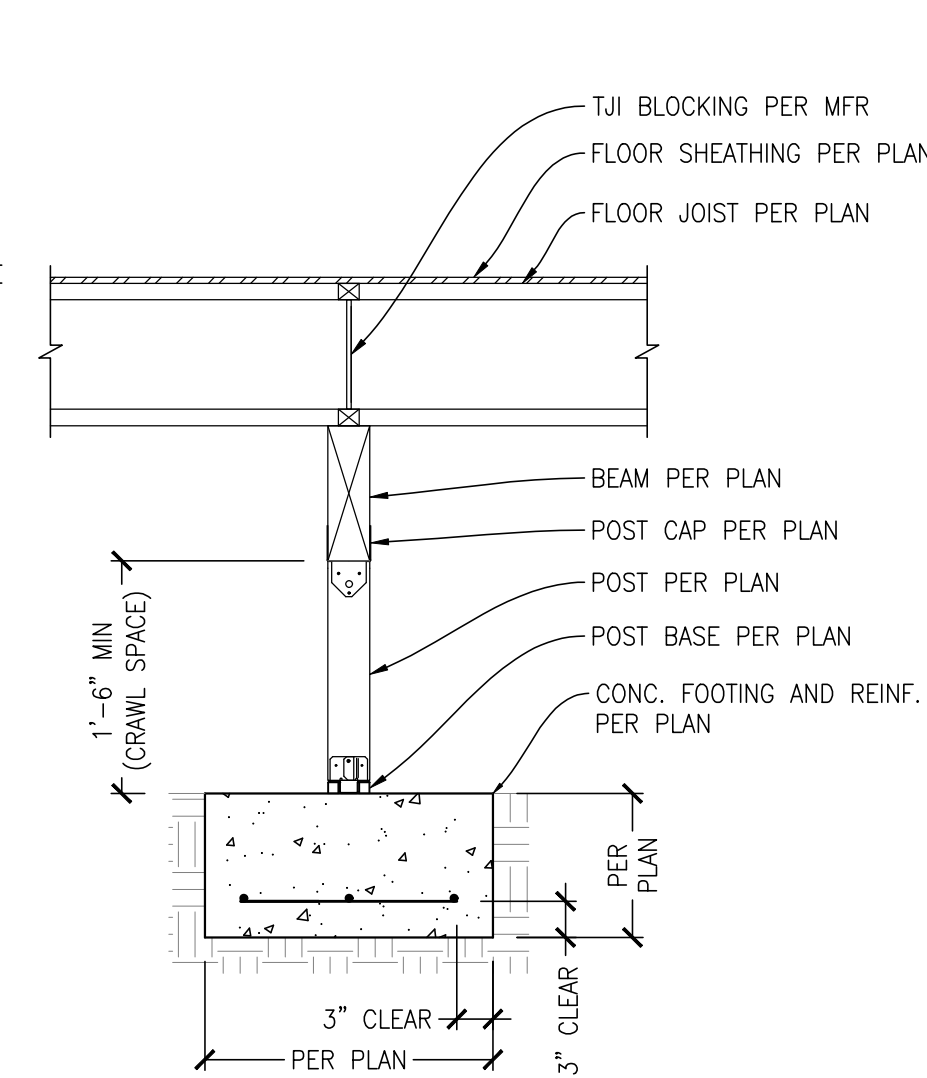


9 DETAIL
SCALE: 3/4"=1'-0"
ISOLATED POST BASE

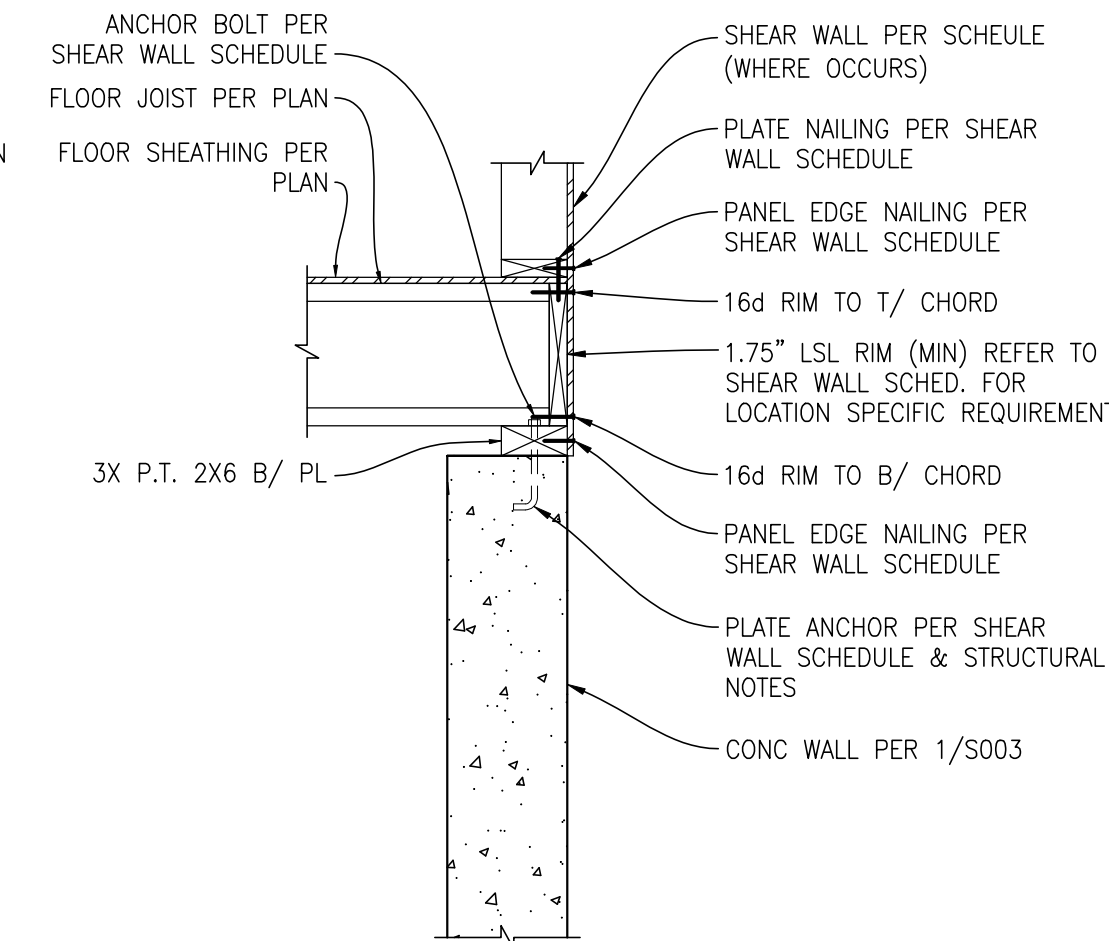

10 DETAIL
SCALE: 3/4"=1'-0"
TJI PERP. TO CONC. WALL

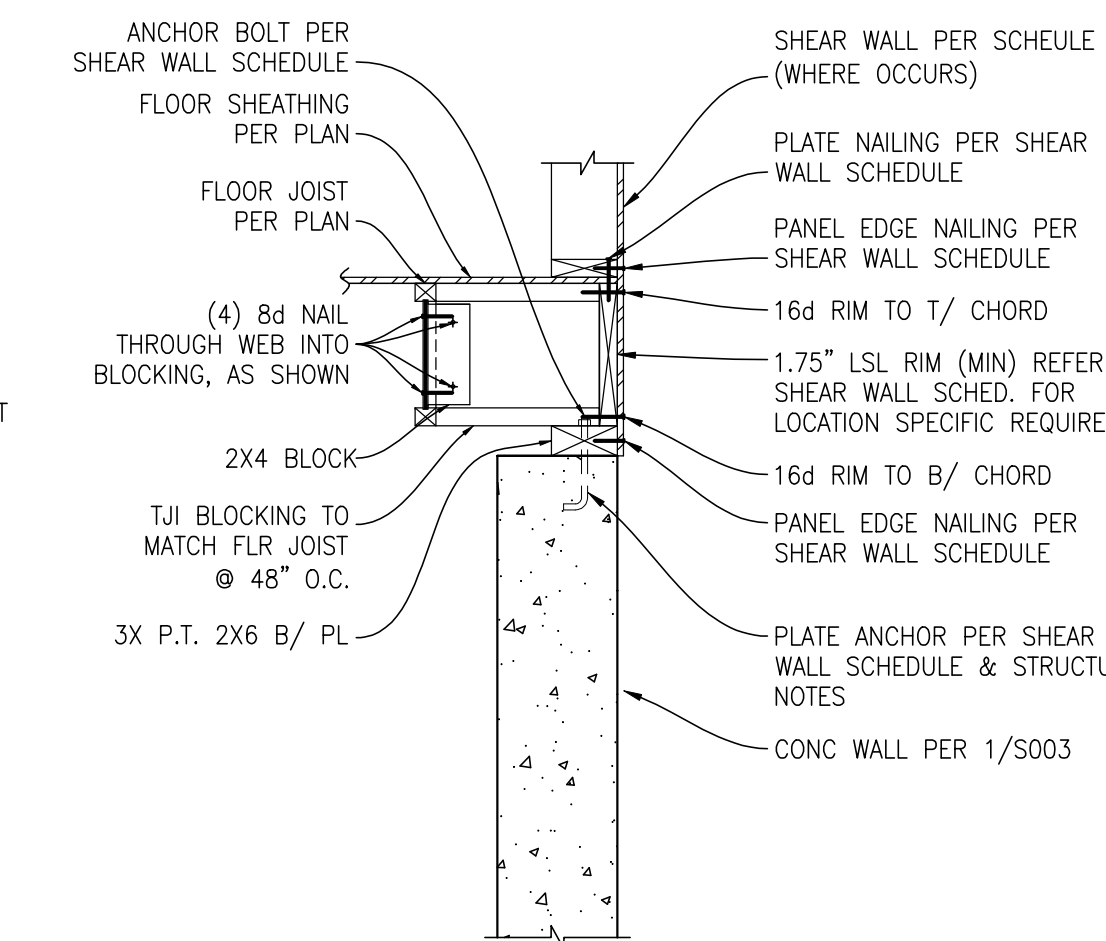


11 DETAIL
SCALE: 3/4"=1'-0"
TJI PARALLEL TO CONC. WALL

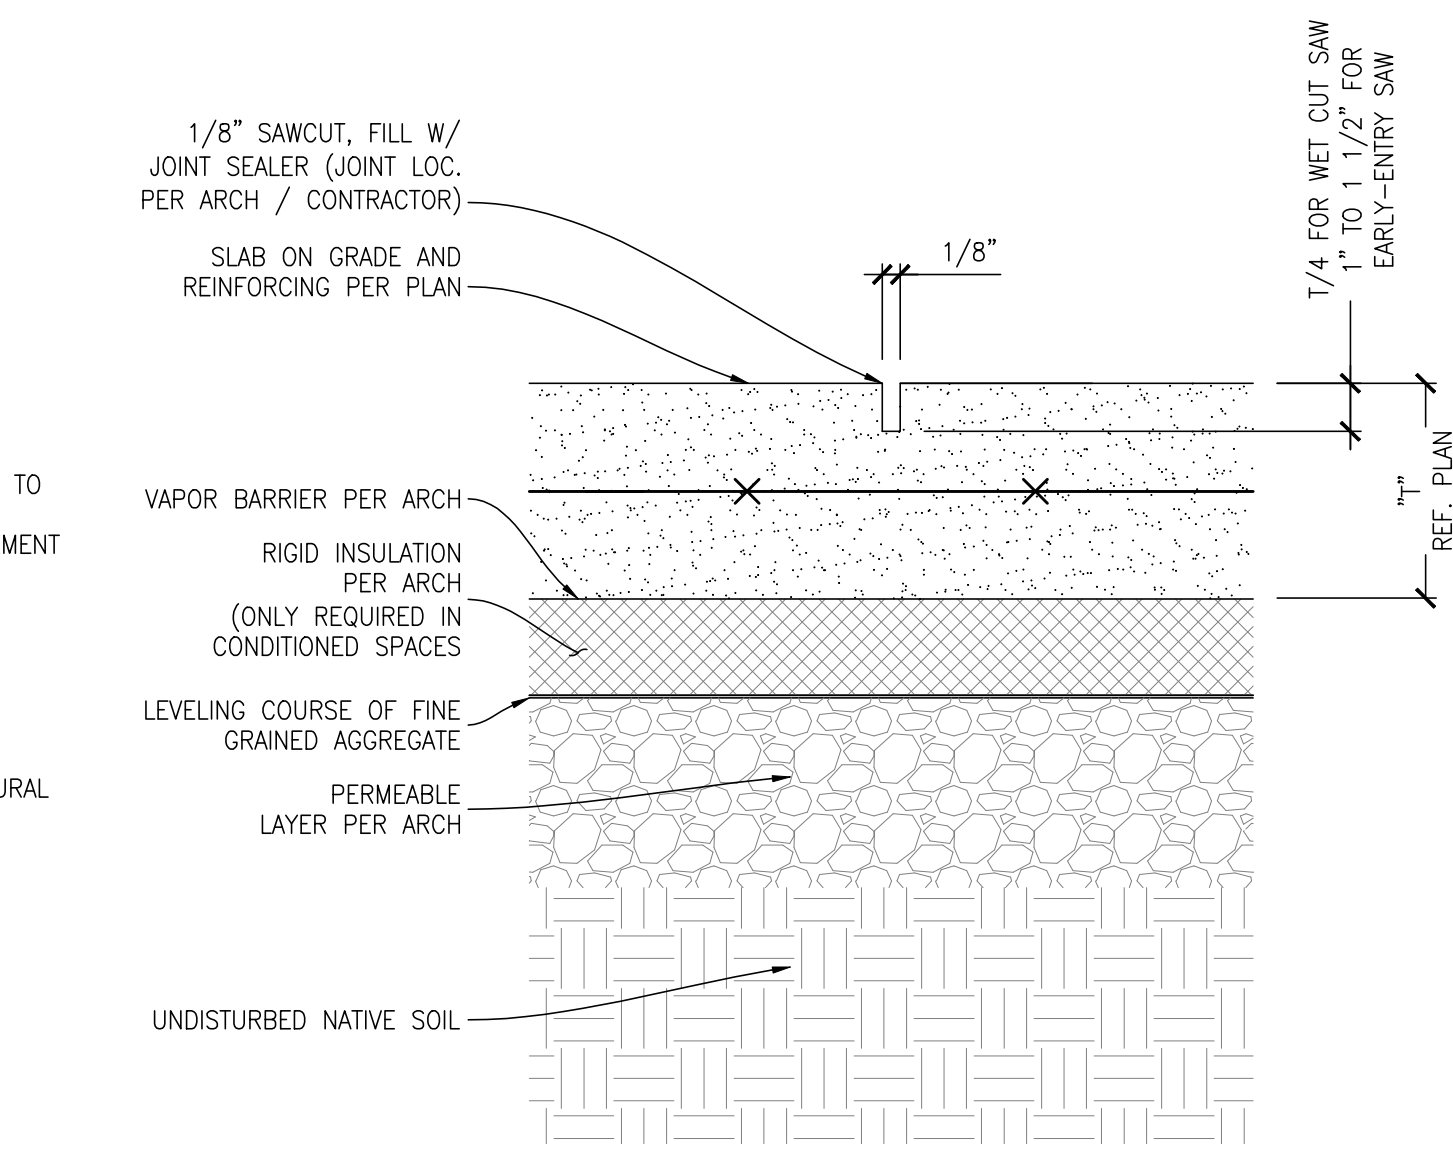


12 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL SAW CUT JOINT

CHECK SET - NOT FOR CONSTRUCTION

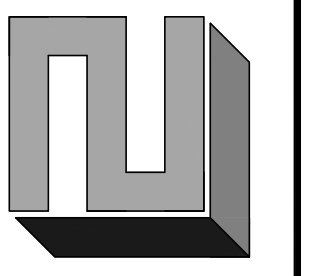


REVISION	DATE

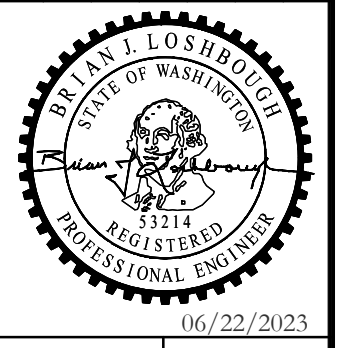


06/22/2023

CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
STRUCTURAL DETAILS


CHK BY: L2E	DRW BY: TNT
SCALE: AS SHOWN BAR = 1" FULL SIZE	
DATE: 06/22/2023	
JOB NO: 20-084	
SHEET: 8 OF 10	
DWG NO: S300	

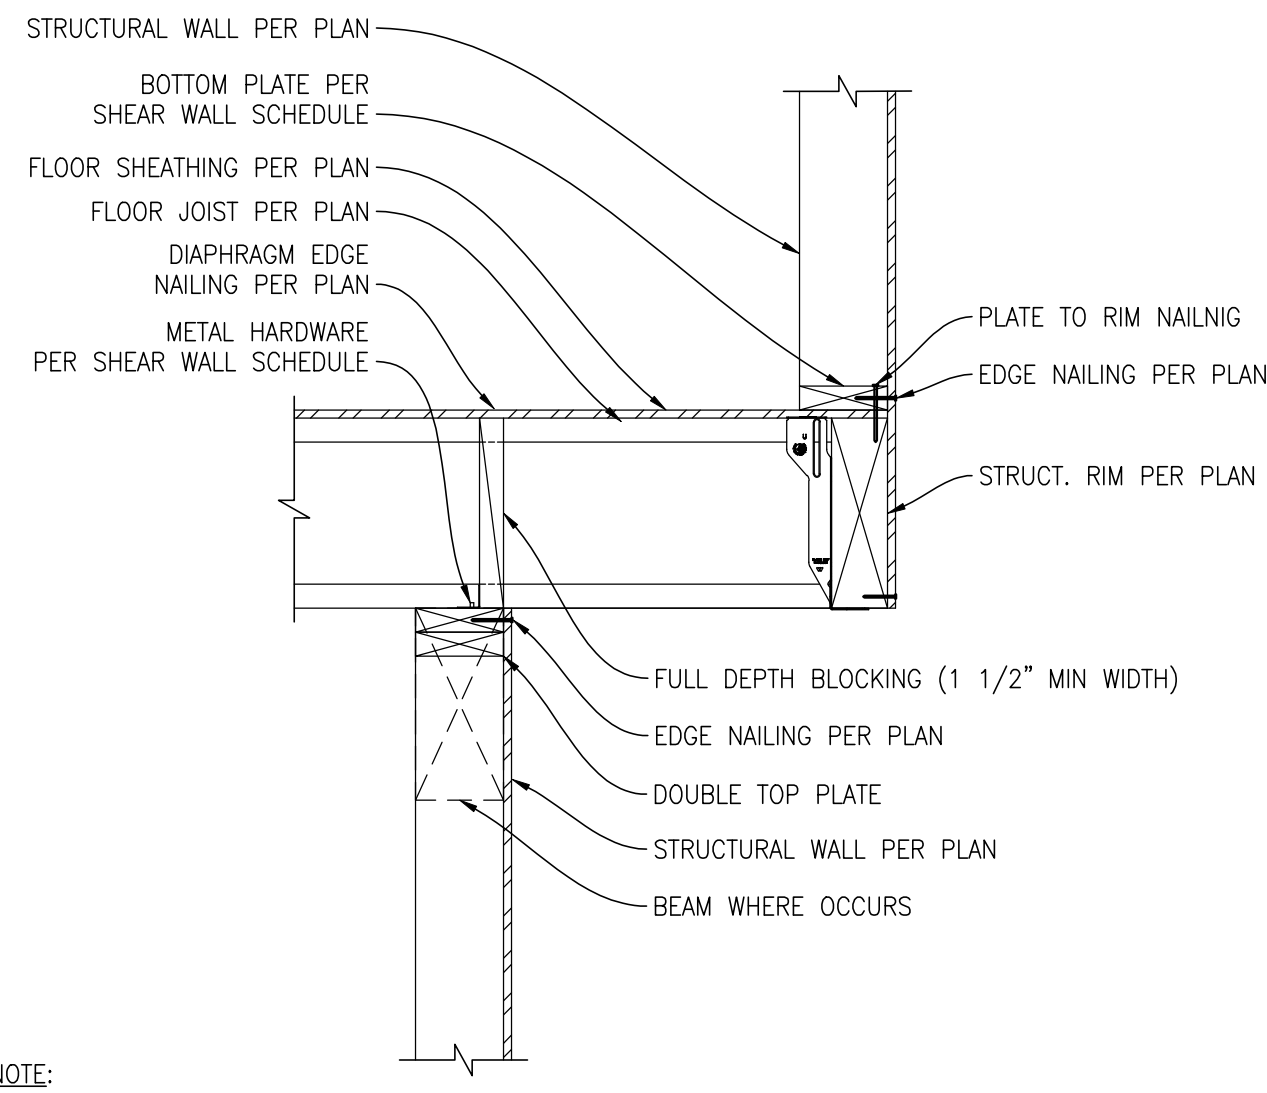


1 DETAIL
SCALE: 3/4"=1'-0"
CANTILEVERED FLOOR

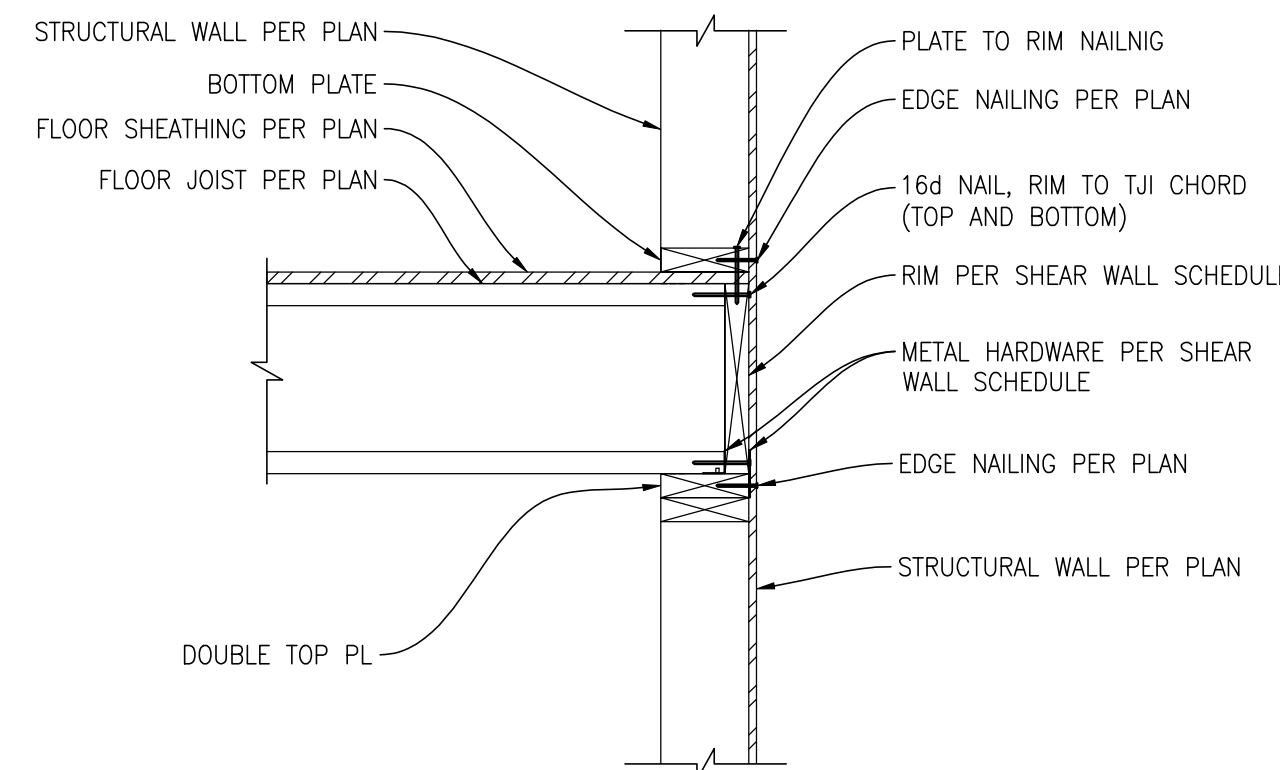


2 DETAIL
SCALE: 3/4"=1'-0"
TJI PERP TO WALL

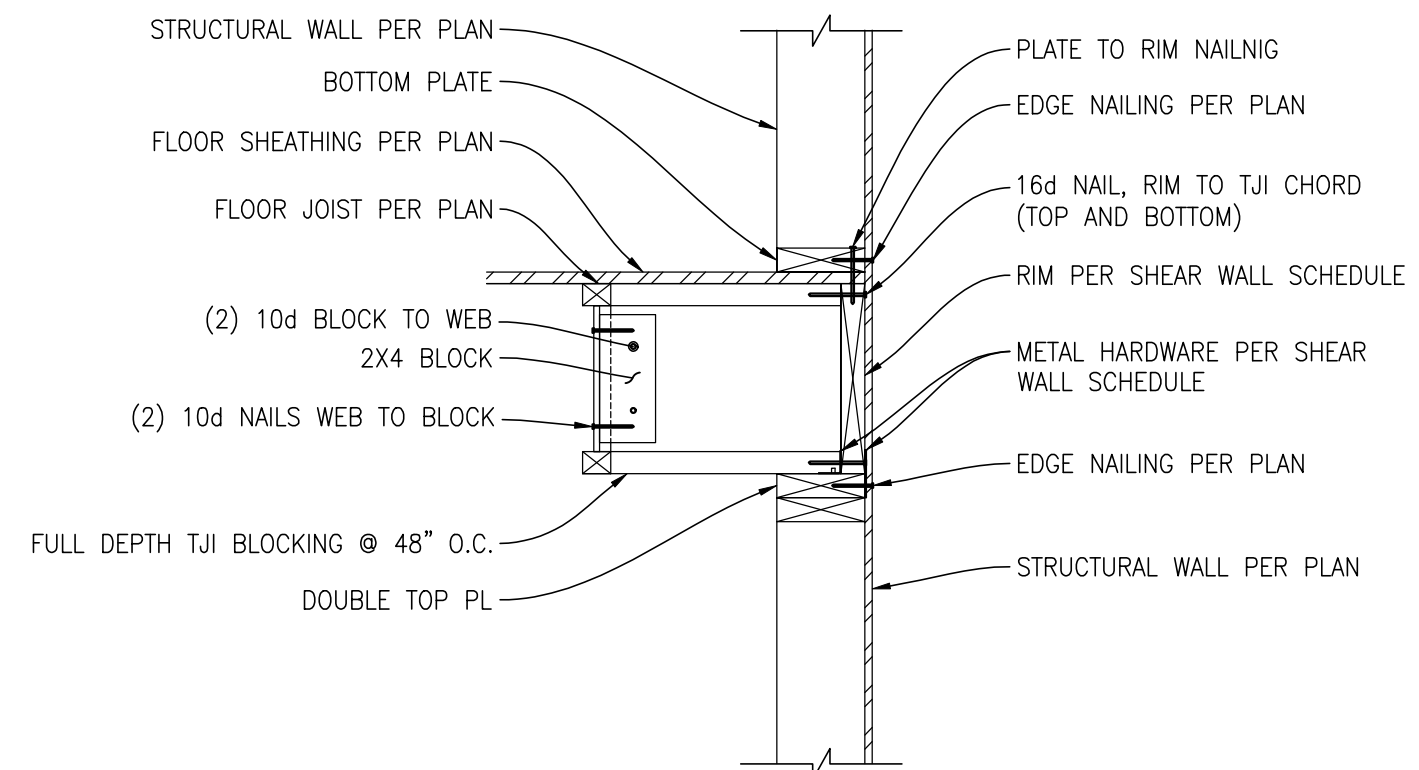


3 DETAIL
SCALE: 3/4"=1'-0"
TJI PARALLEL TO WALL

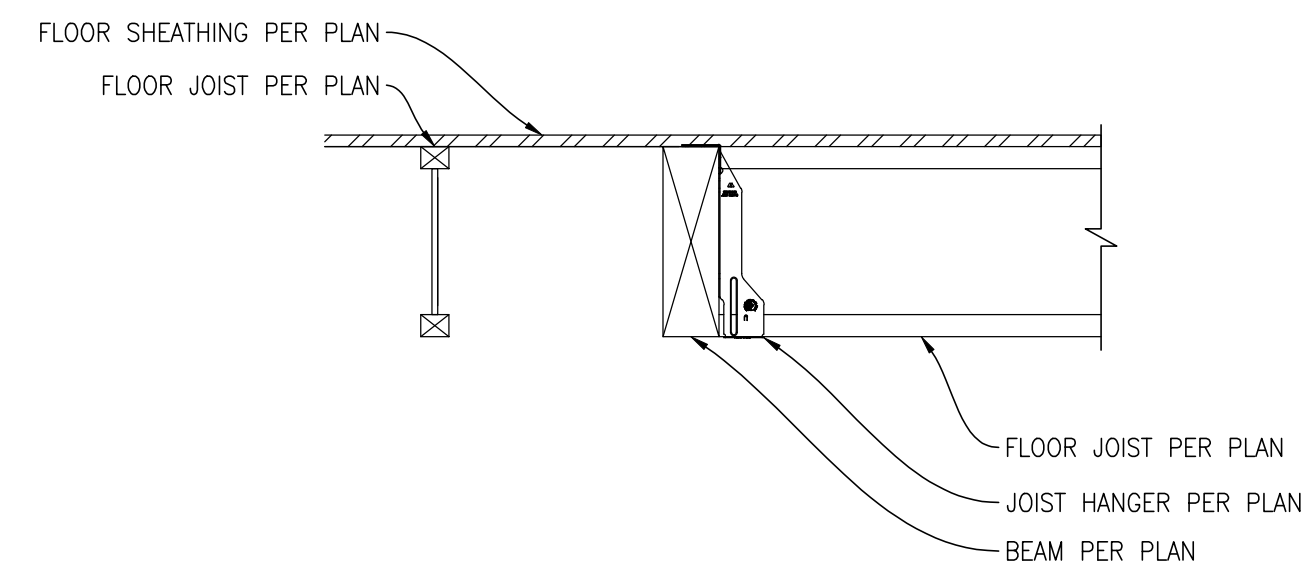


4 DETAIL
SCALE: 3/4"=1'-0"
JOIST TO BEAM

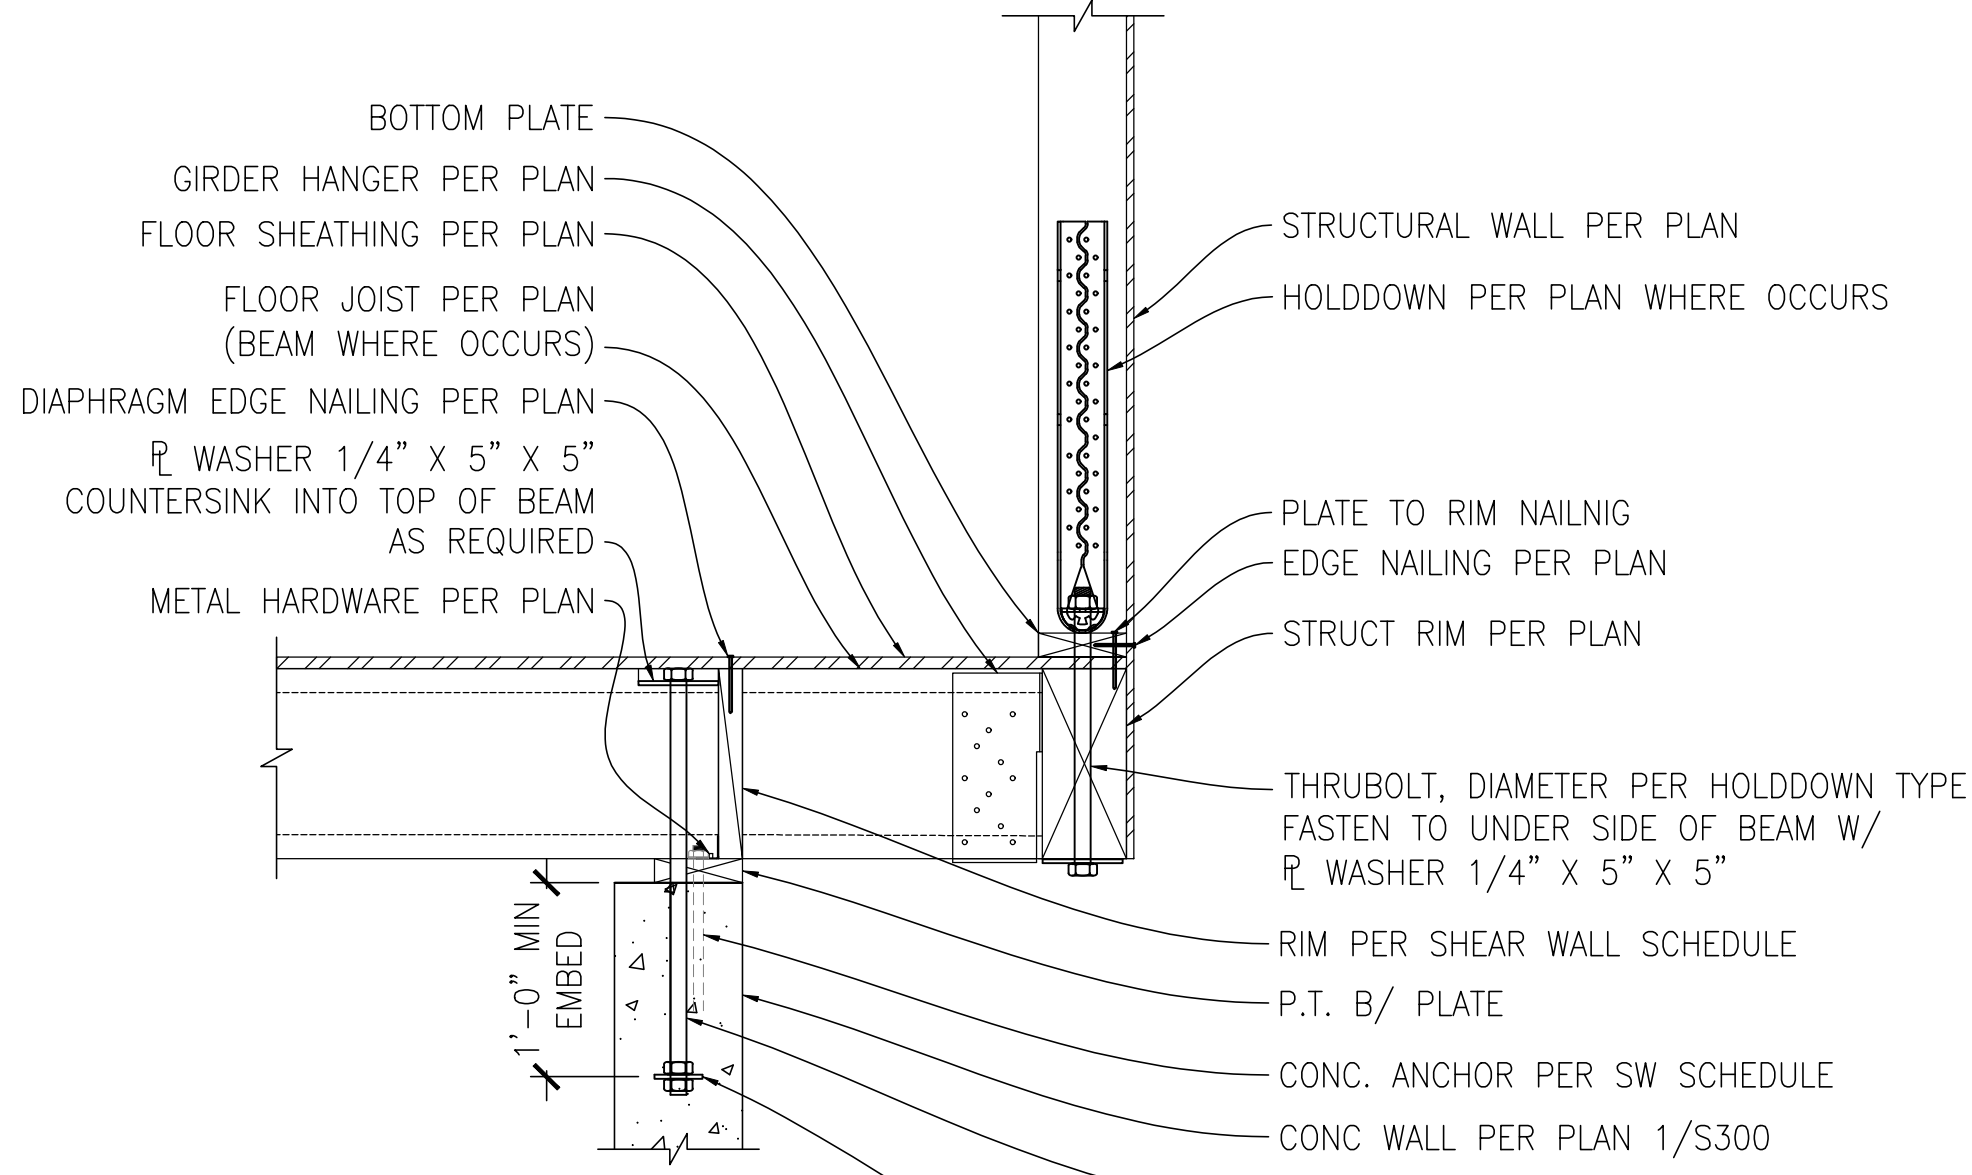


5 DETAIL
SCALE: 3/4"=1'-0"
UPLIFT TRANSFER BEAM

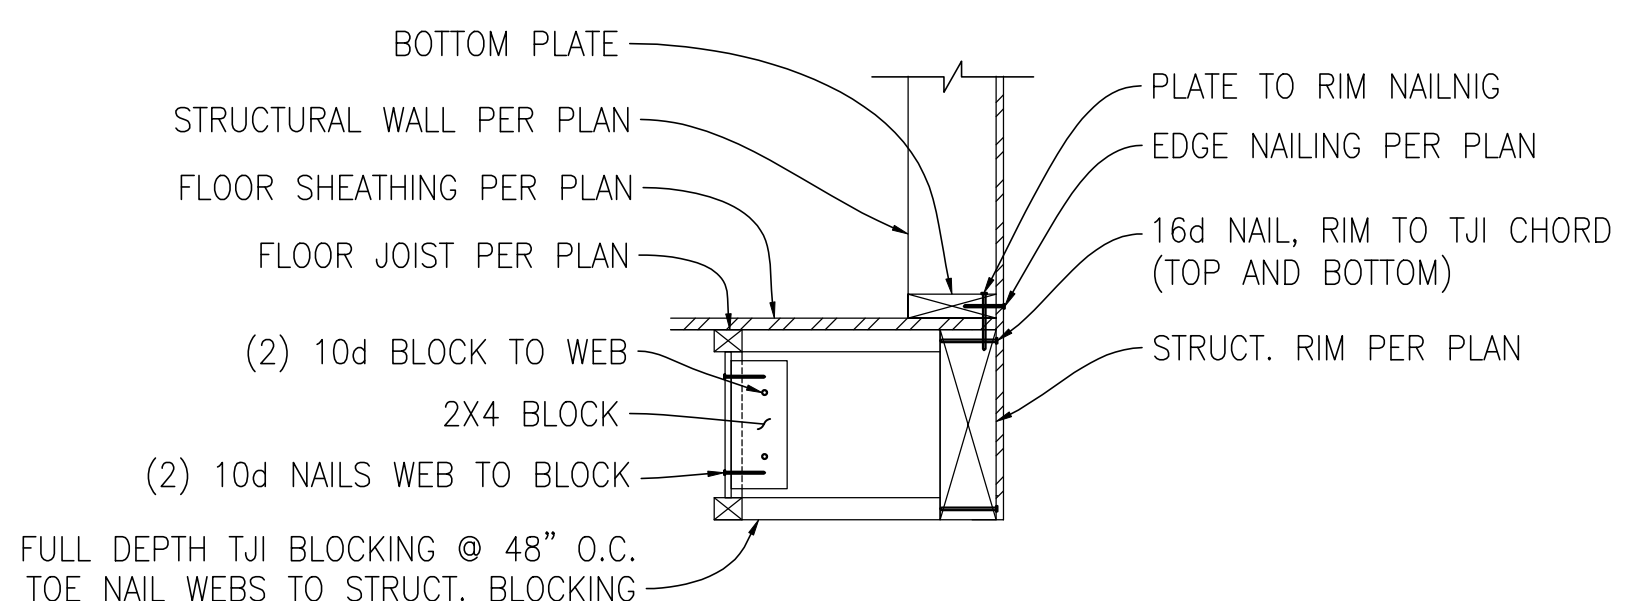


6 DETAIL
SCALE: 3/4"=1'-0"
TJI PARALLEL TO BEAM

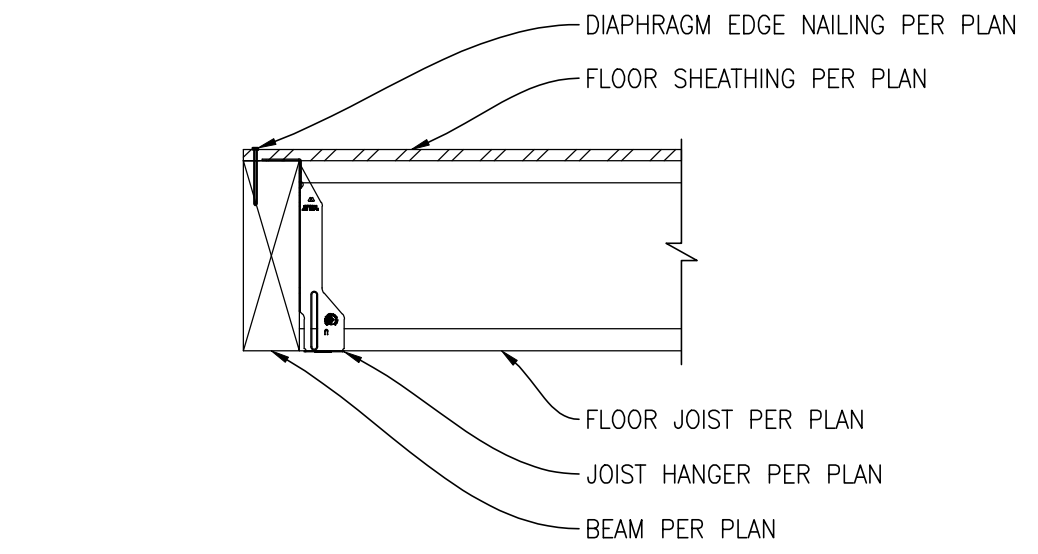


7 DETAIL
SCALE: 3/4"=1'-0"
TJI PERP. TO BEAM (ONE SIDE)

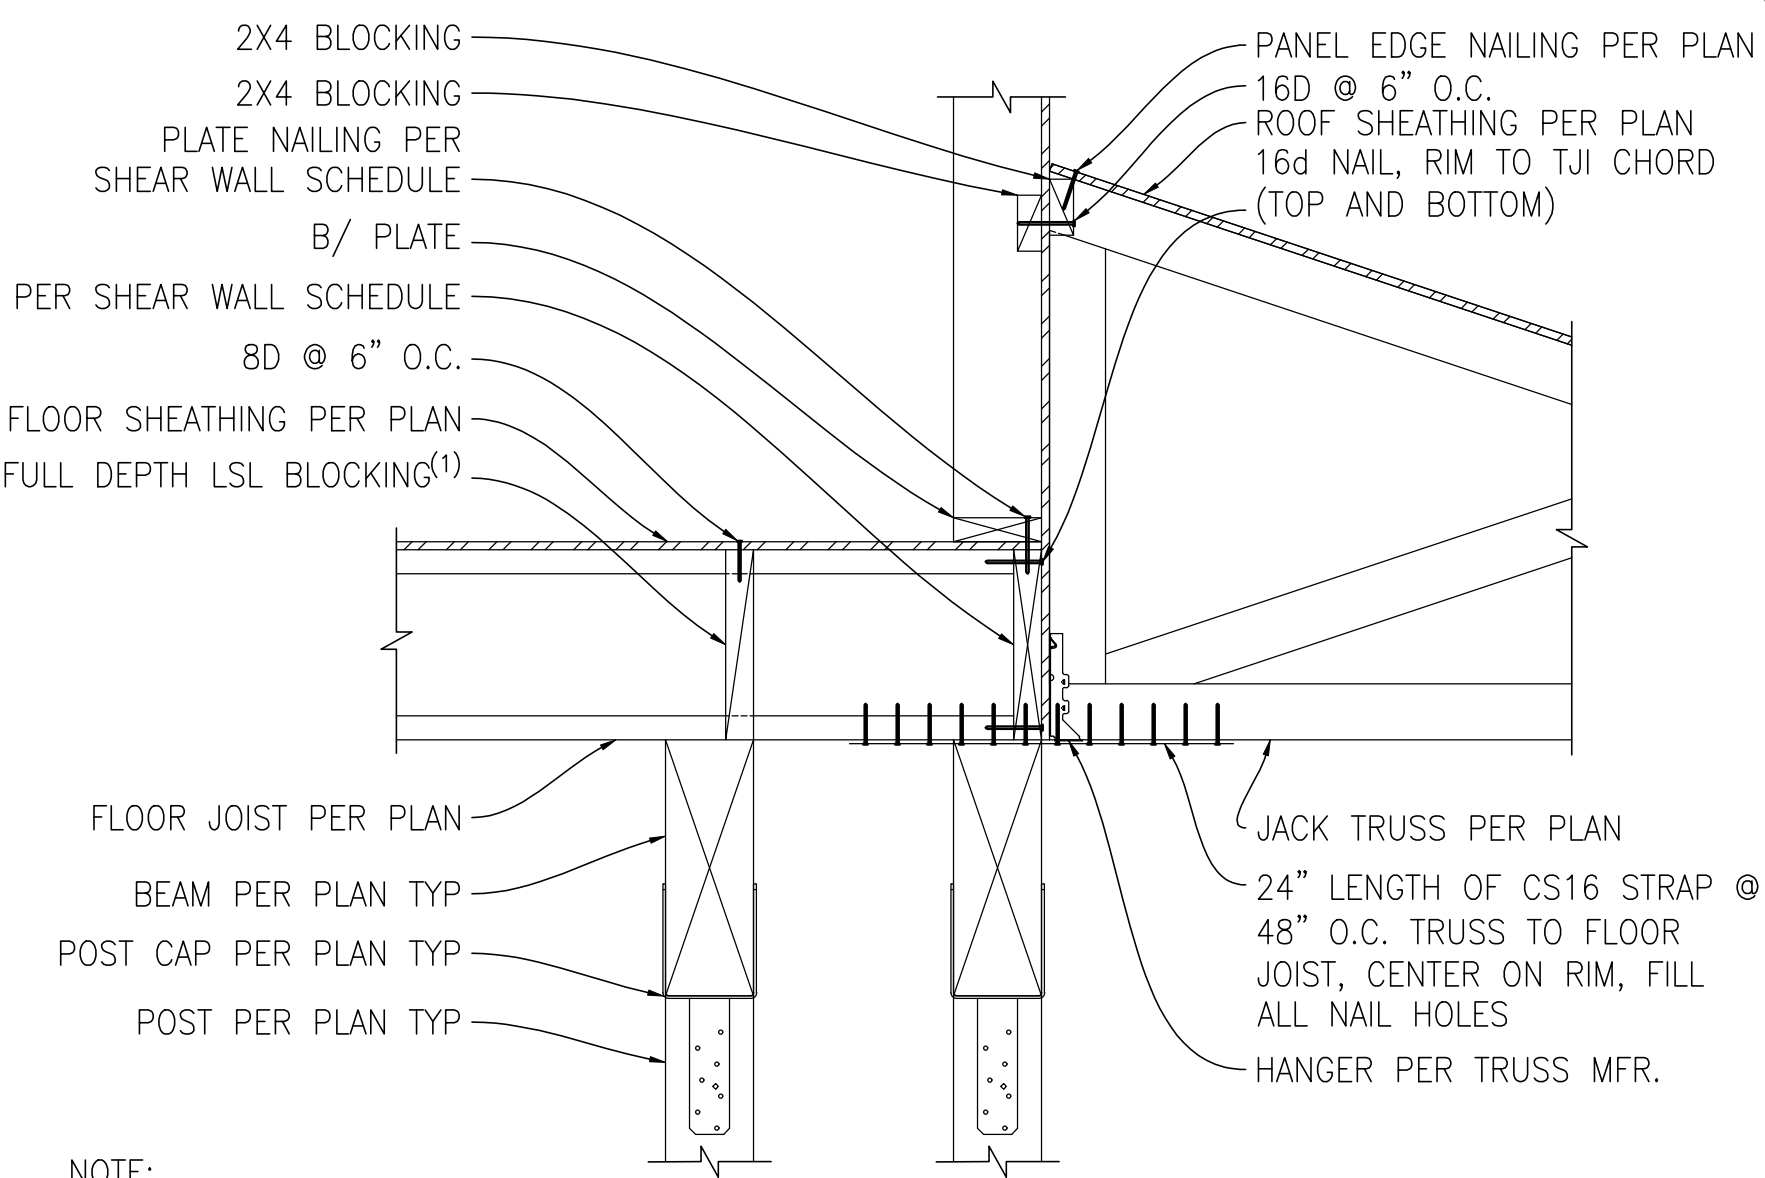

8 DETAIL
SCALE: 3/4"=1'-0"
EXTERIOR WALL TO JACK TRUSS CONNECTION

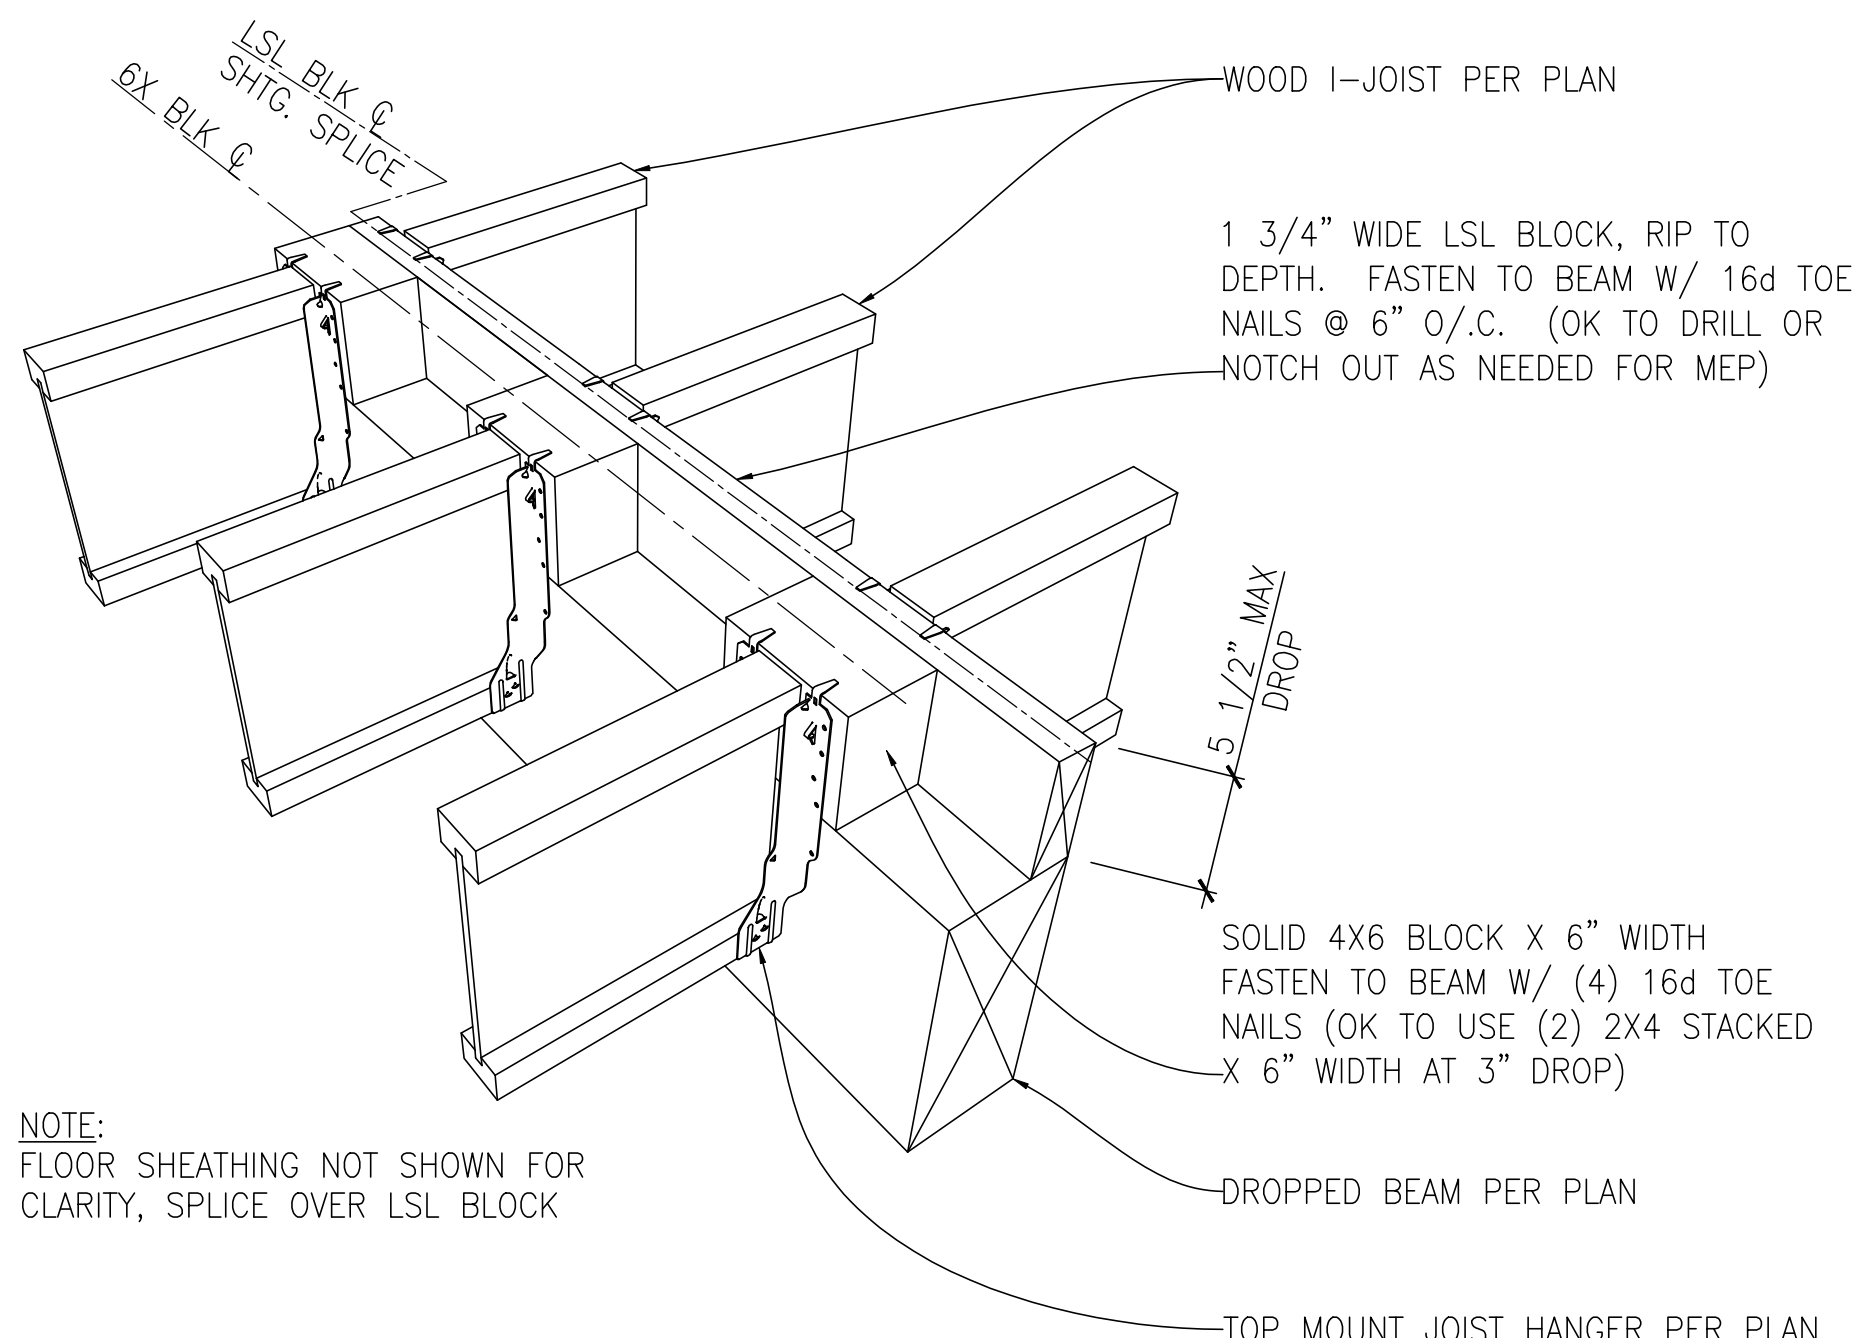

10 DETAIL
SCALE: NTS
JOIST TO BEAM / PARTIALLY DROPPED VARIANT

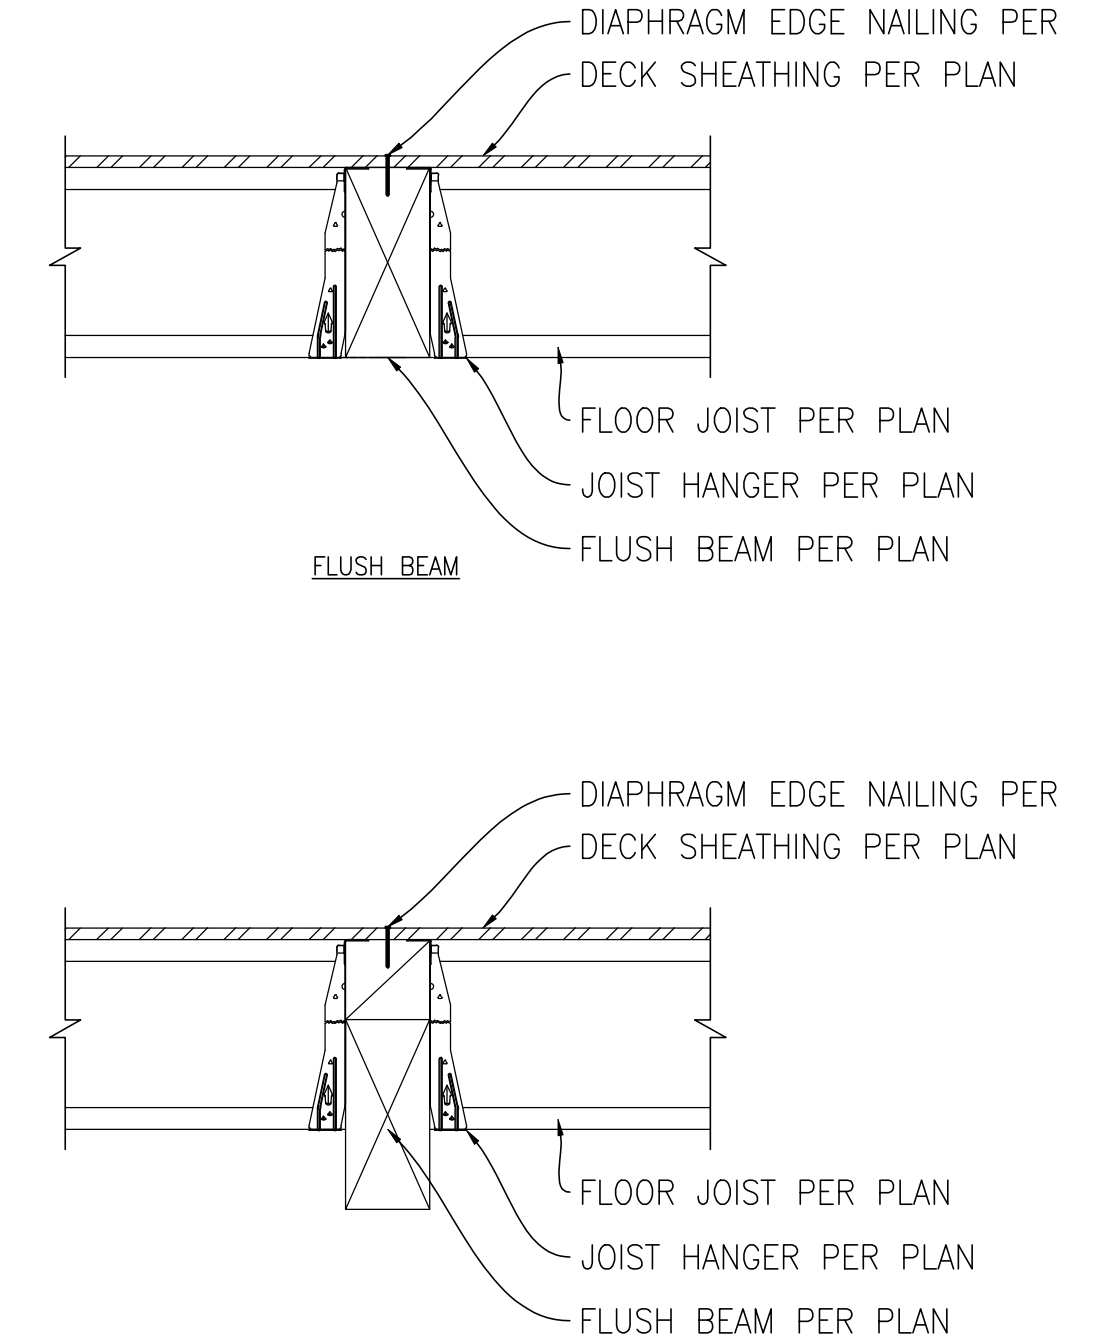


11 DETAIL
SCALE: 3/4"=1'-0"
TJI PERP. TO BEAM (BOTH SIDES)

NOTE:
1. JOISTS PARALLEL TO WALL AT "SIM" CONDITION


NOTE:
1. FASTEN RIM TO BEAM W/ A34 @ 48" O.C.

NOTE:
FLOOR SHEATHING NOT SHOWN FOR CLARITY, SPLICE OVER LSL BLOCK

CHECK SET - NOT FOR CONSTRUCTION

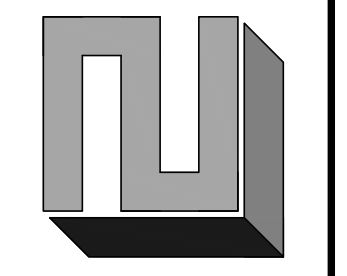


REVISION	DATE

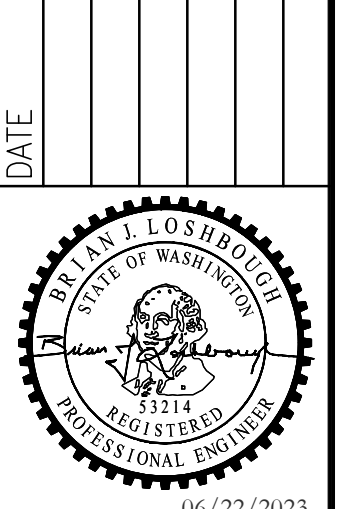


CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
STRUCTURAL DETAILS


CHK BY: LZE	DRW BY: TNT
SCALE: AS SHOWN BAR = 1" FULL SIZE	
DATE: 06/22/2023	
JOB NO: 20-084	
SHEET: 9 OF 10	
DWG NO: S301	

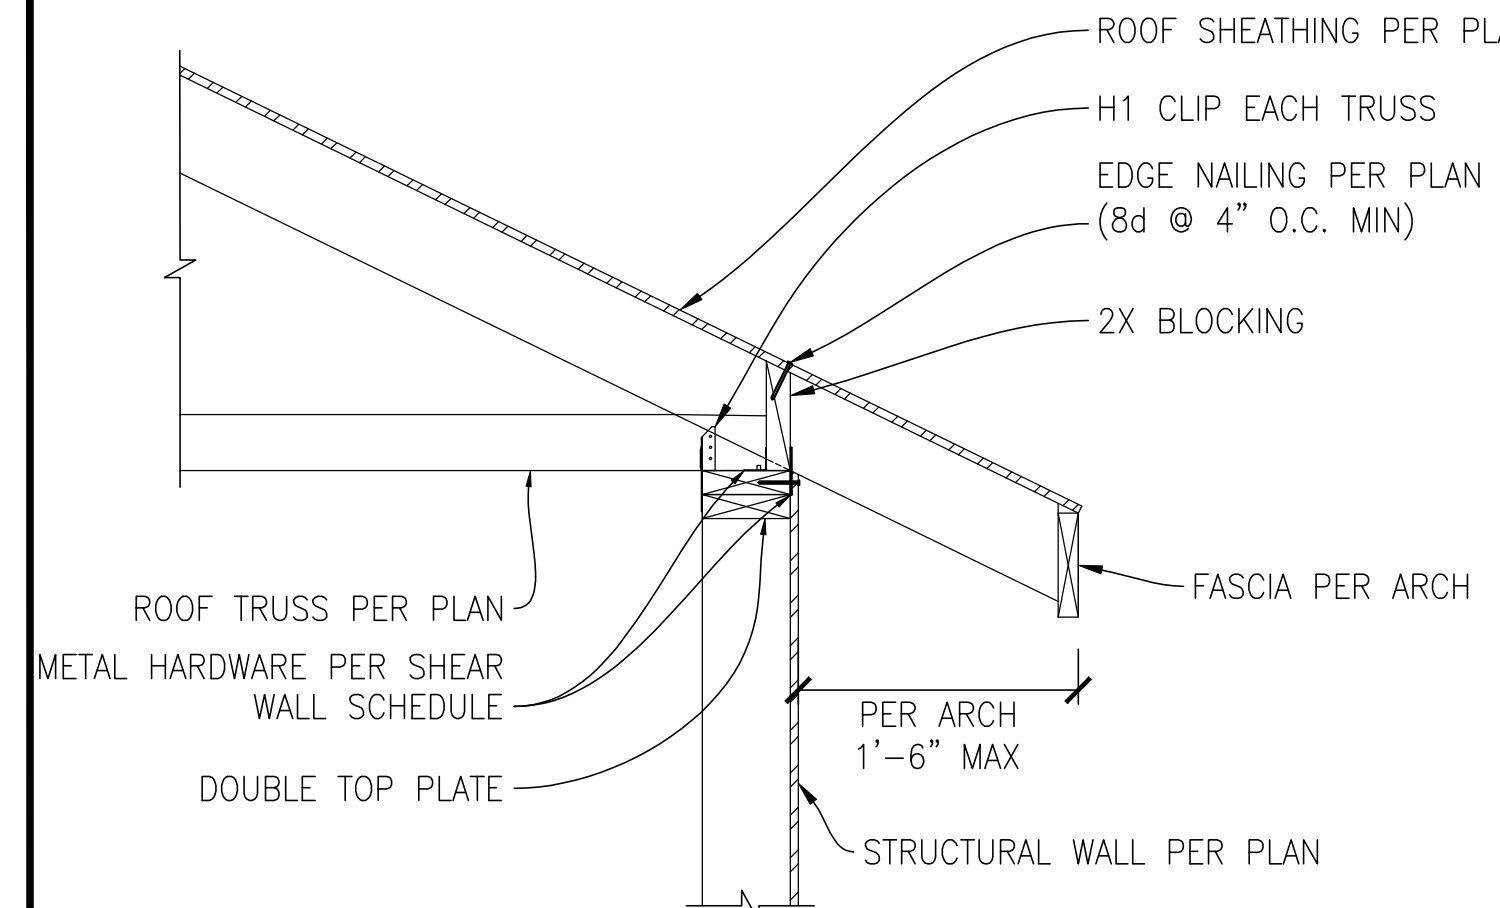


1 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL ROOF TRUSS PERP TO WALL

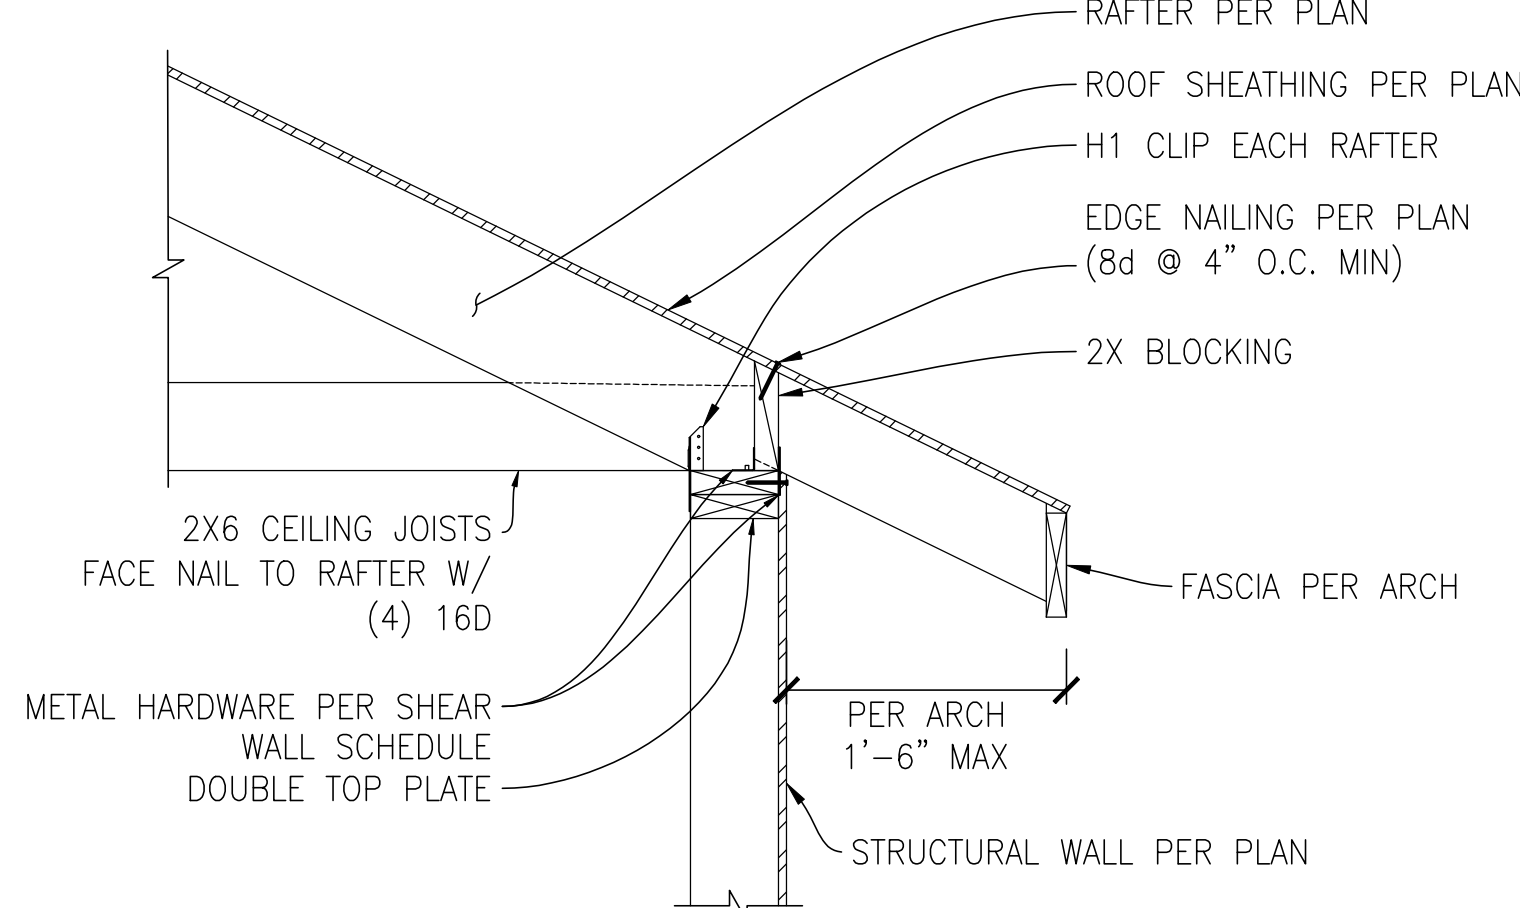

2 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL RAFTER PER TO WALL

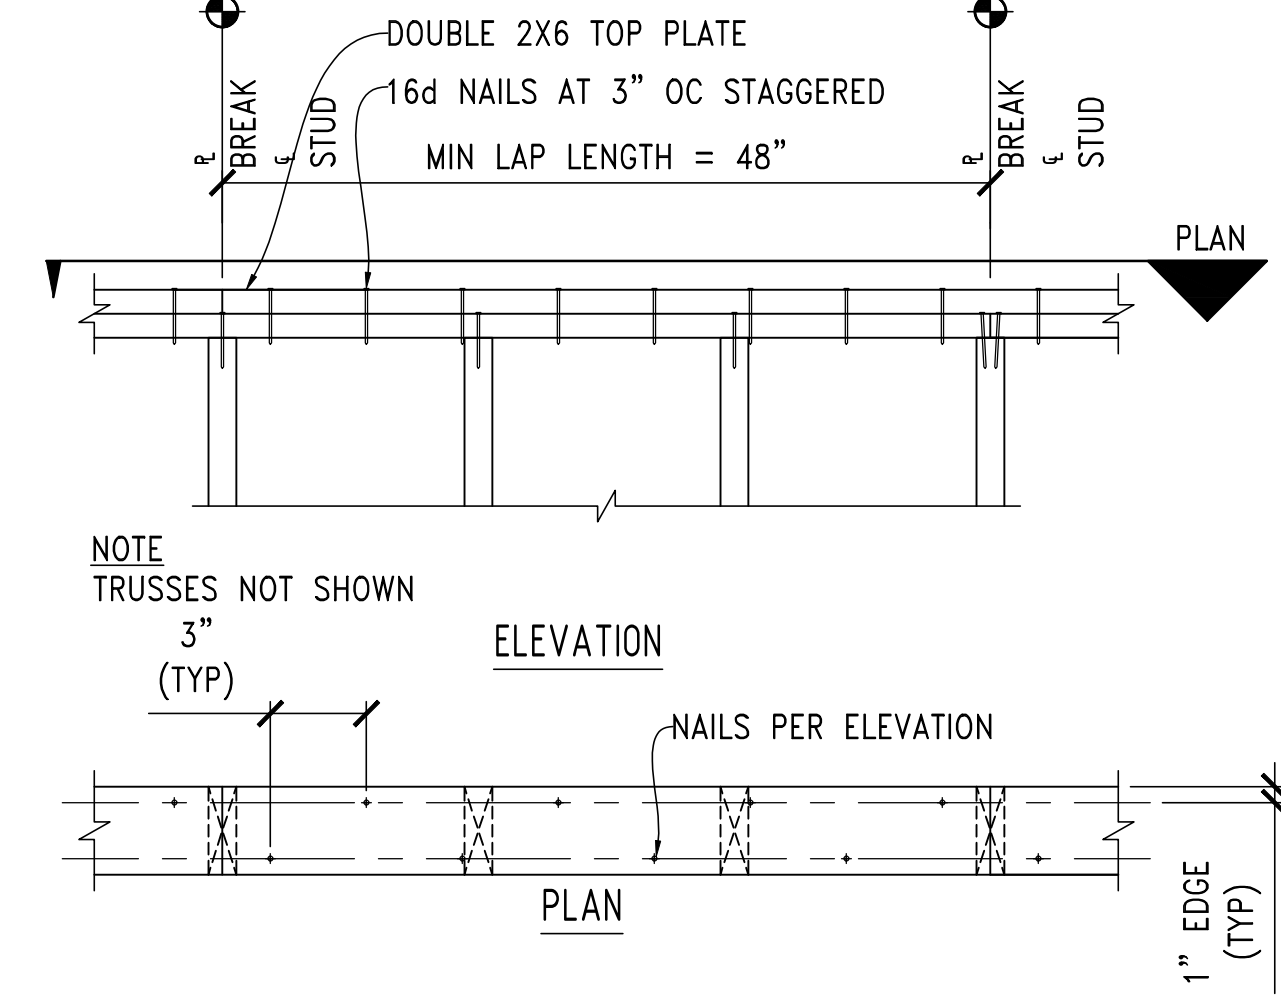


3 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL PLATE SPLICE

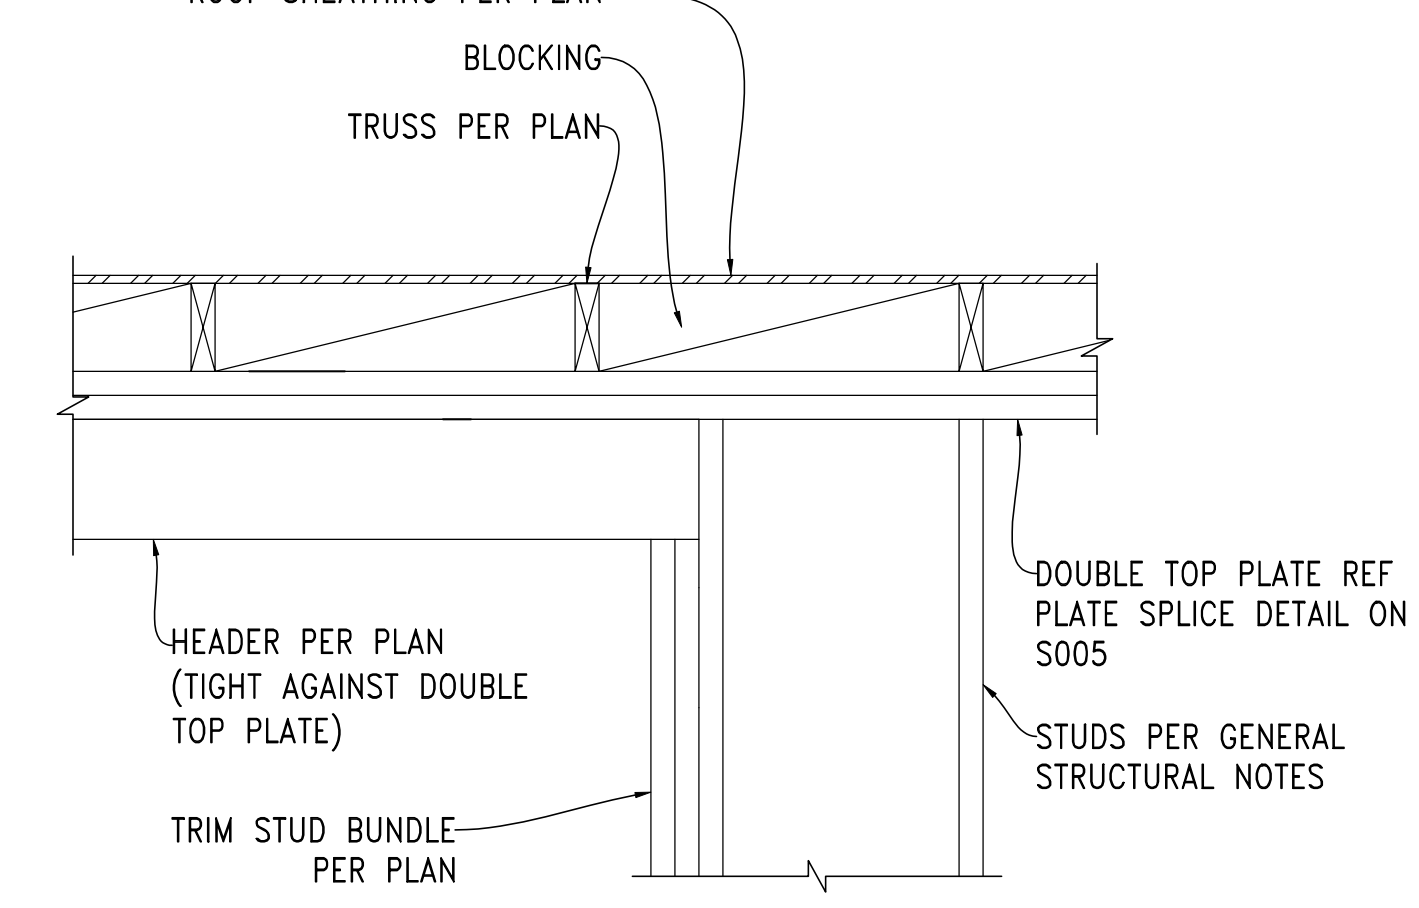


4 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL HEADER


- STAIR / LANDING FRAMING NOTES**
- RISE / RUN PER ARCHITECT
 - TREAD AND RISER PER ARCHITECT
 - CENTER LEDGER SCREWS IN PERIMETER WALLS IN LSL STUDS. POSITION SCREWS 1 1/2" MIN FROM T/ & B/ OF LEDGER RESPECTIVELY.
 - STAIR FRAMING SHOWS WOOD STRINGERS OPTION. STEEL STAIR FRAMING OR OTHER IS ACCEPTABLE, DESIGN PER OTHERS.

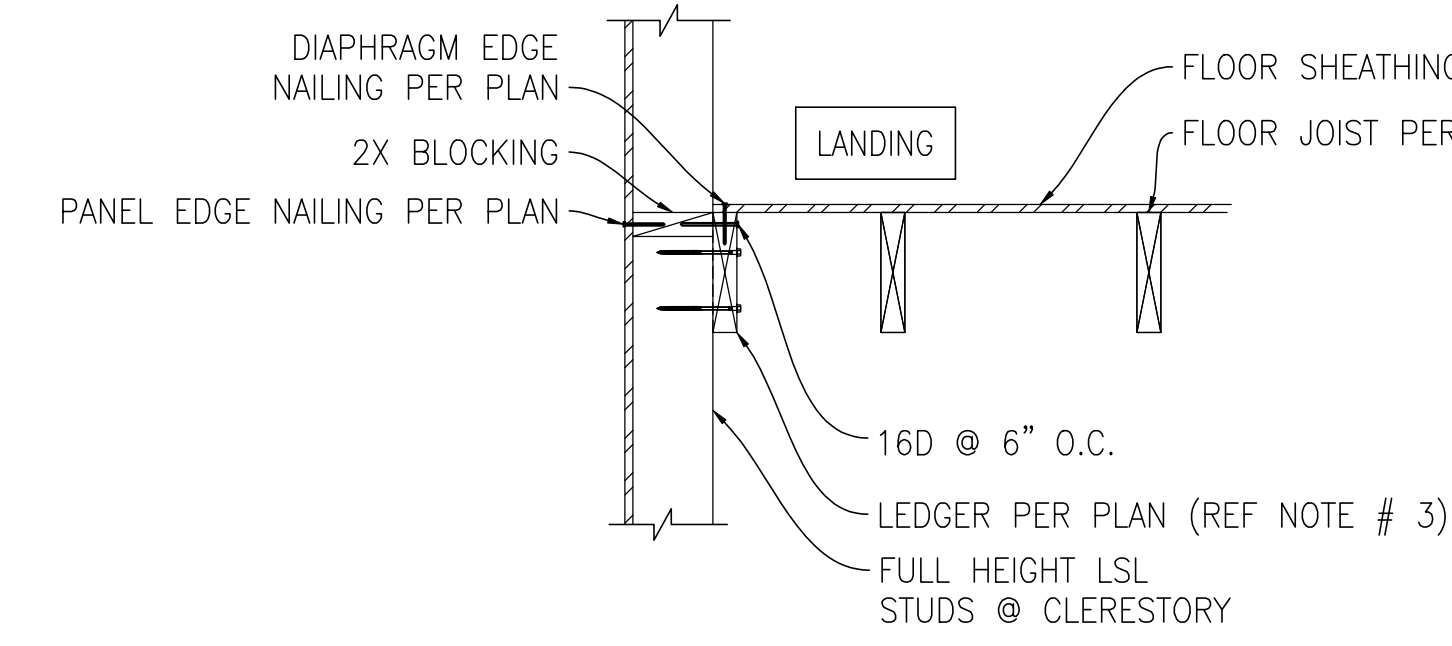


5 DETAIL
SCALE: 3/4"=1'-0"
TYPICAL LANDING FRAMING

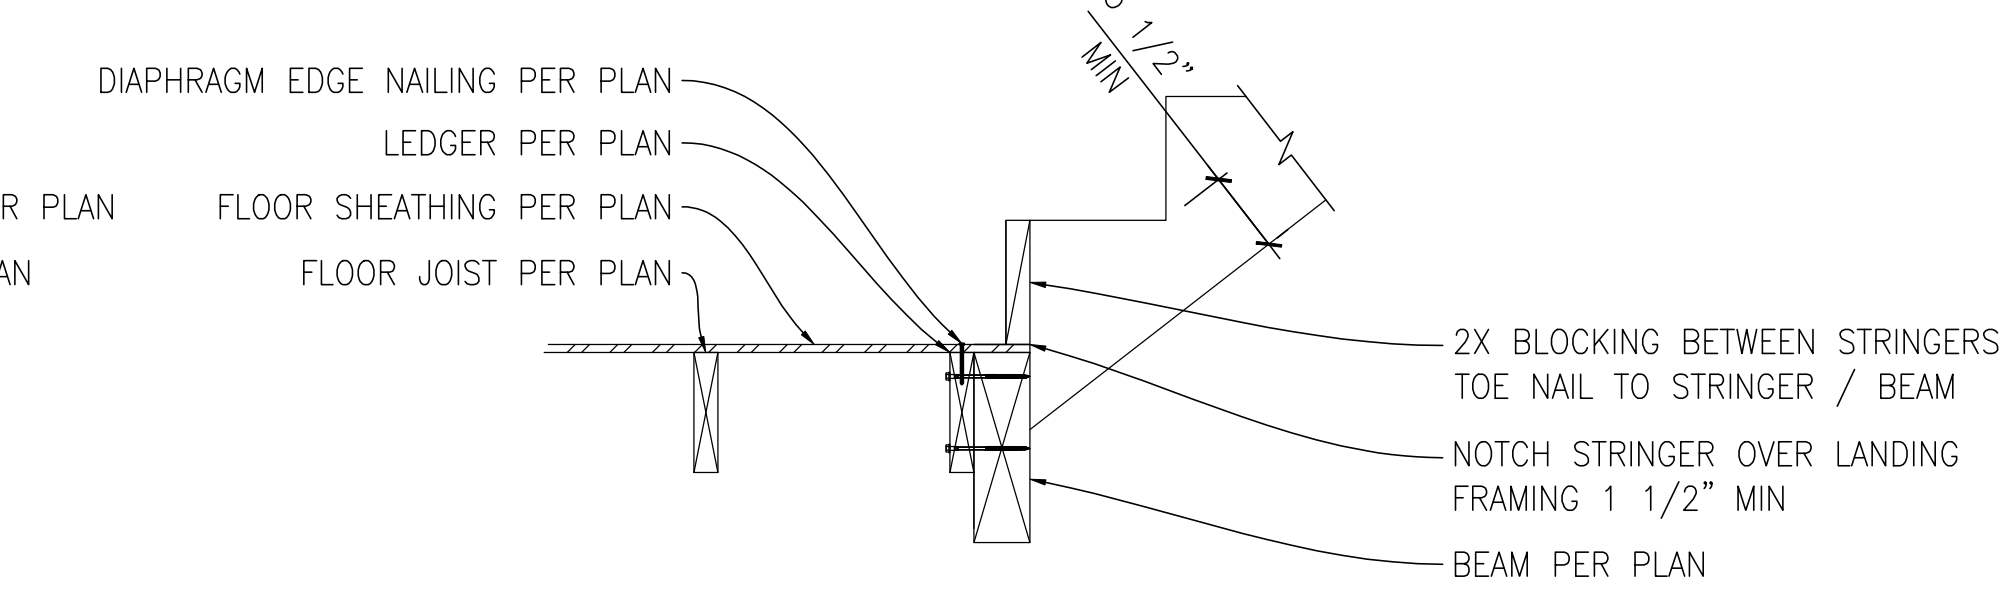


6 DETAIL
SCALE: 3/4" = 1'-0"
TYPICAL STRINGER FRAMING

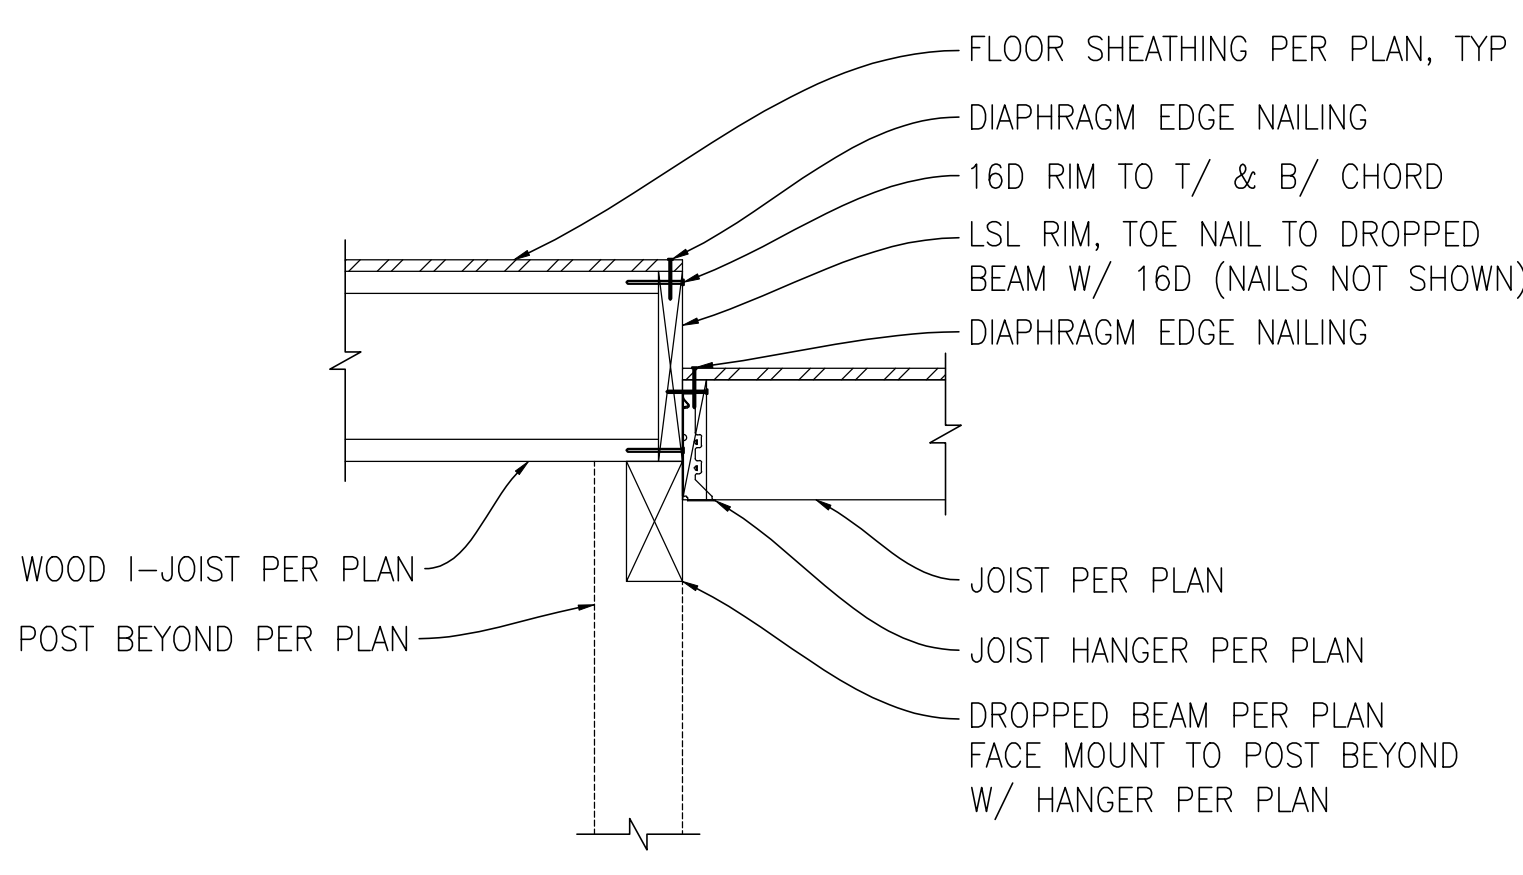

8 DETAIL
SCALE: 1"=1'-0"
FRAMING @ DROPPED LANDING

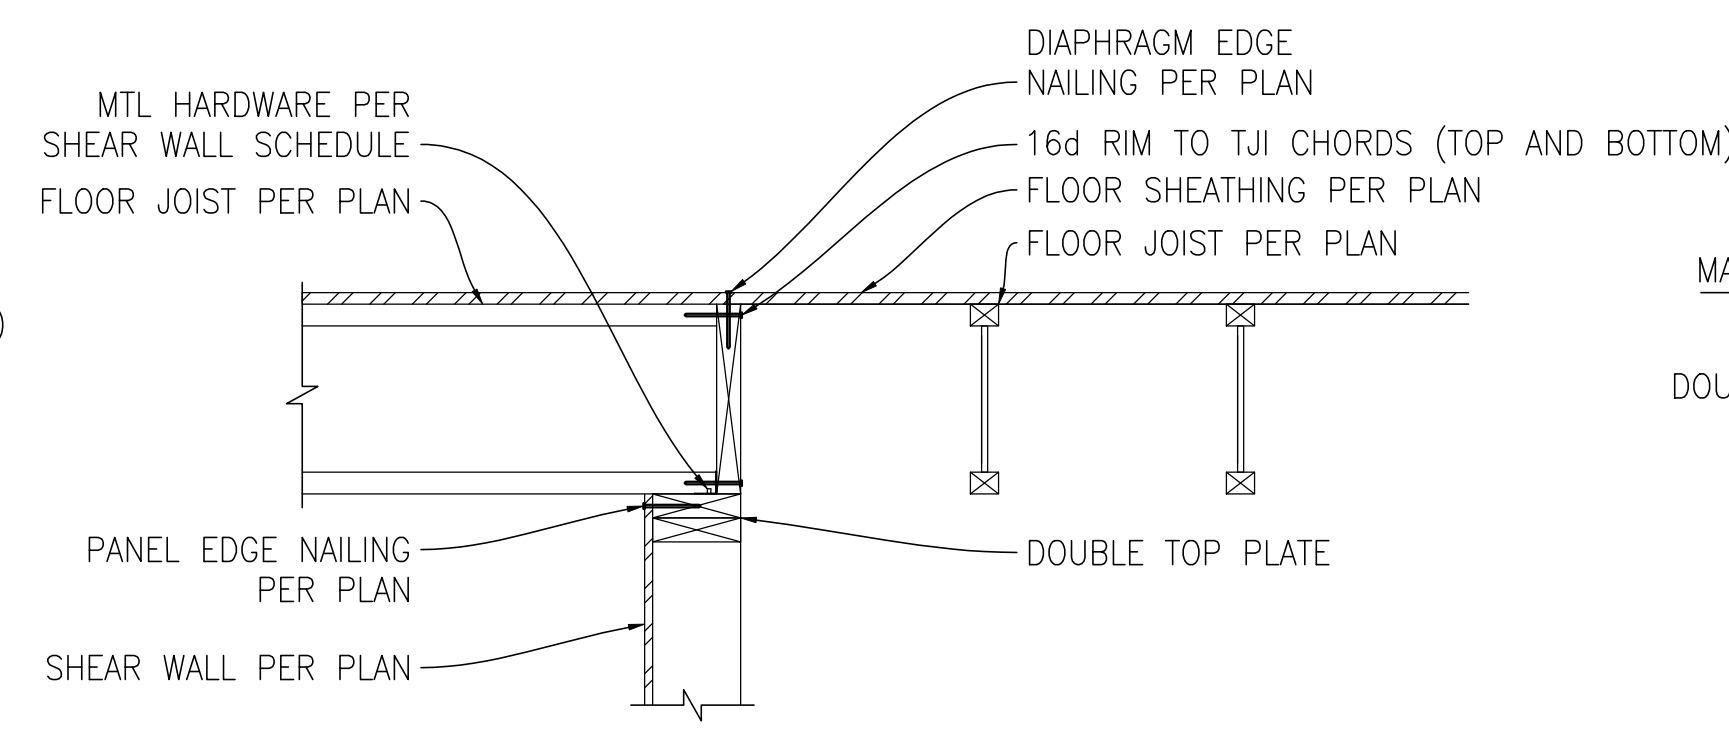


9 DETAIL
SCALE: 1"=1'-0"
INT SHEAR WALL

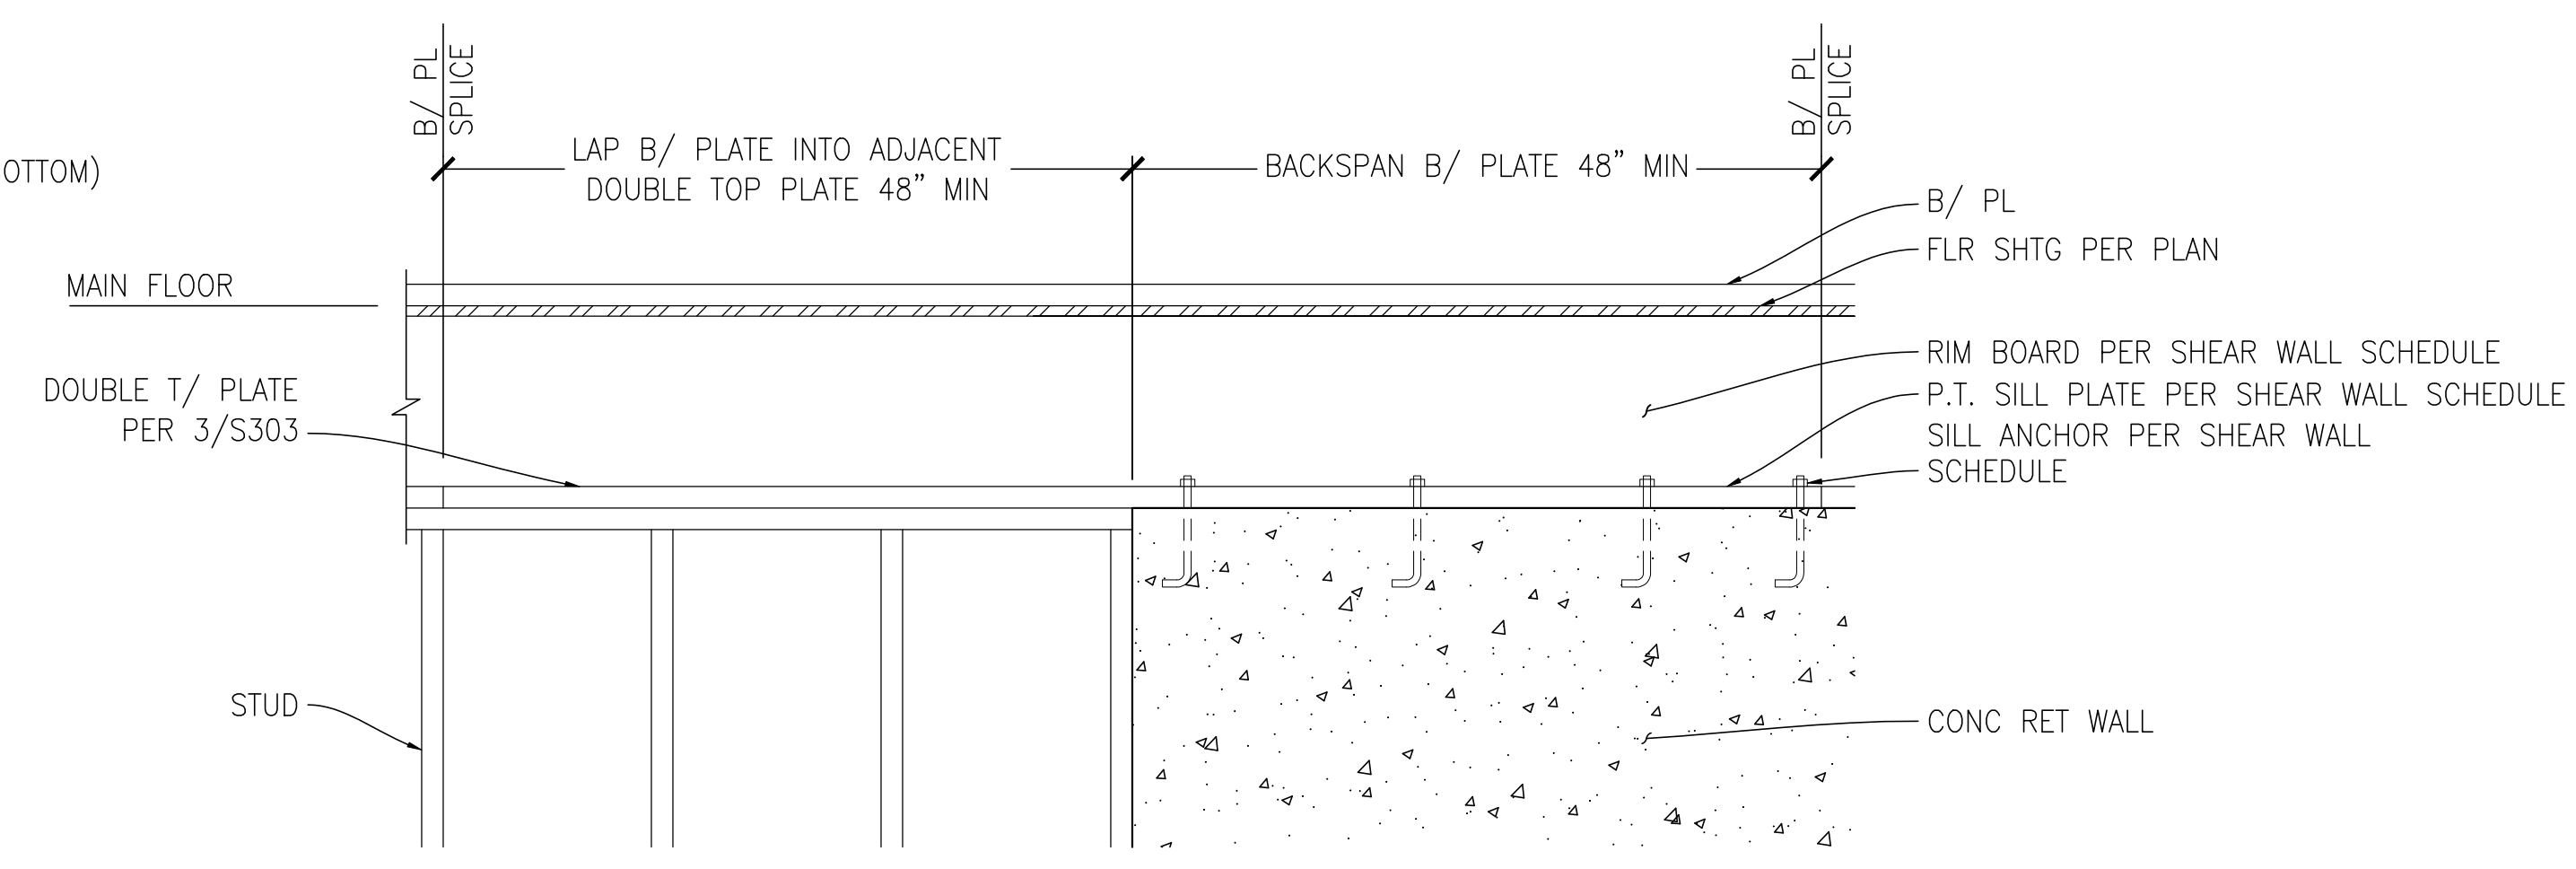


10 DETAIL
SCALE: 1"=1'-0"
B/ PLATE TO T/ PLATE SPLICE

CHECK SET - NOT FOR CONSTRUCTION

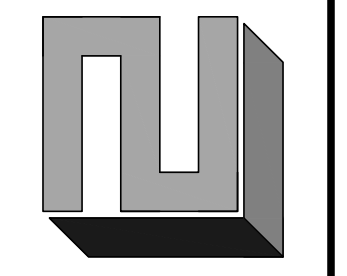

REVISION	DATE

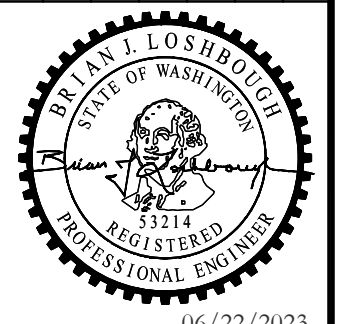

CHEN RESIDENCE
5024 MERCER WAY, MERCER ISLAND, WA 98040
STRUCTURAL DETAILS

CHK BY: LZE	DRW BY: TNT
SCALE: AS SHOWN BAR = 1" FULL SIZE	
DATE: 06/22/2023	
JOB NO: 20-084	
SHEET: 10 OF 10	
DWG NO: S302	