

April 16, 2019
File No. 19-062.100

Mr. Benjamin C. Altman, Exe.,
The Estate of James Altman, Sr.
Attn: George Steirer, Plan to Permit, LLC.
10365 El Honcho Place
San Diego, CA 92124-1219

**Subject: Geotechnical Engineering Study
Proposed Development
6423 East Mercer Way
Mercer Island, WA**

Dear Mr. Altman,

As requested, PanGEO, Inc. has completed a geotechnical engineering study to assist you and your project team with the design and construction of your proposed Development at the above-address. This study was performed in general accordance with our mutually agreed scope of work outlined in our proposal dated February 8, 2019, which you subsequently authorized on February 16, 2019. Our service scope included reviewing readily-available geology maps for the project vicinity, reviewing preliminary design plans, drilling eight test borings, conducting a site reconnaissance, and developing the conclusions and recommendations presented in this report.

SITE AND PROJECT DESCRIPTION

For reference, the address of 6423 East Mercer Way is used. The site at this address is currently developed with a single-family residence built in 1968. The properties for the proposed development are located on separate and individual lots around the reference property, and have a combined area of 35,522 square feet (see Figures 1 and 2). All properties are owned by the estate of James Altman, Sr. The ground surface in the vicinity of all the lots generally slopes down to the east and south with up to 60 feet of elevation relief. The south facing slope descends to E. Mercer Way and is especially steep.

The easternmost, 15,812 sq. ft. parcel (302405-9151) is located above the 90-degree bend in E. Mercer Way (see Figures 2 and 3a). Moderately steep slopes surround the property to the south and west, forming a semi-open bowl with about 30 feet of total relief. The surface within the bowl is relatively level, and the near 90-degree angle between the south and west slopes suggest the site has been excavated. Preliminary plans call for developing the bowl portion of the property (see Figure 2).

Parcel 302405-9001 (see Figures 2 and 3b) is located north of the property at 6423 E. Mercer Way, between the reference property and SE 64th Street. The site slopes generally steeply to the east and south, and the southwestern portion of the property is traversed by a moderately sloping, east facing ridge. A prominent drainage swale occupies the northeastern part of the site. A steep slope, up to 1H:1V, divides SE 64th Street from the main level of the property. Preliminary plans call for the development of the ridge crest and upper swale portion of the property (see Fig. 2).

The parcel (#302405-9213) located at 9167 SE 64th Street is also irregularly shaped, undeveloped, and 18,635 sq. feet in size (see Figures 2 and 3c). The property slopes moderately to steeply to the south, with nearly 60 feet of relief down to East Mercer Way. There is a moderately sloping bench area at about elevation 170 feet, which is about 20 feet below SE 64th Street. Preliminary plans call for the development of the area above the bench (see Figure 2).

All the properties are mapped within a landslide hazard area by the City of Mercer island. As such, any development will need to consider the steep slopes and landslide hazards. We understand that while plans are conceptual in nature, but that you wish a “comprehensive” geotechnical study to consider the issues of geological hazards, and to support permitting efforts going forward for all parcels.

The conclusions and recommendations outlined in this report are based on our understanding of the proposed development, which is in turn based on the project information provided. If the above project description is incorrect, or the project information changes, we should be consulted to review the recommendations contained in this study and make modifications, if needed.

SUBSURFACE EXPLORATIONS

Subsurface conditions at the site were explored with eight borings (PG-1 to PG-8) which were drilled at the locations shown on Figure 1. Three of the new borings were drilled on Parcel

302405-9151, and four of the new borings were drilled on Parcel 302405-9001. No previous exploration had been done on these two parcels. One new boring was drilled on parcel 3024059213 to supplement existing subsurface information from previously drilled borings on the property (AMEC Earth & Environmental, Inc., 2001). The new explorations were advanced on March 7, 19 and 21, 2019, using an EC-95 track mounted drill and a hand-operated portable Acker drill rig, both owned and operated by Borettec, Inc., of Spangle, Washington. The new borings were drilled to depths of 11.5 to 41.5 feet below the existing ground surface.

Soil samples were obtained from the borings at 2½-foot and 5-foot depth intervals in general accordance with Standard Penetration Test (SPT) sampling methods (ASTM test method D-1586) in which the samples were obtained using a 2-inch outside diameter split-spoon sampler. The sampler was driven 18-inches into the soil using a 140-pound weight freely falling a distance of 30 inches. The number of blows required for each 6-inch increment of sampler penetration was recorded. The number of blows required to achieve the last 12 inches of sample penetration is defined as the SPT N-value. The N-value provides an empirical measure of the relative density of cohesionless soil, or the relative consistency of fine-grained soils.

A geologist from our office was present to observe the drilling, assist in sampling, and to describe and document the soil samples obtained from the borings. The soil samples were described and field classified in general accordance with ASTM D 2488-00, following the guidelines of the Unified Soil Classification System. Summary logs of the new borings are included in Appendix A. The logs of two borings by AMEC used in this study are also included in Appendix A.

SITE GEOLOGY AND SUBSURFACE CONDITIONS

SITE GEOLOGY

Based on the Geologic Map of Mercer Island (Troost and Wisher, 2006), the predominant near surface soil unit on the property consists of mass wasting deposits from past slope movements. The mass wasting deposits are described as loose to dense or soft to stiff, colluvium, landslide debris and soil with indistinct morphology. Locally, organic material may be found in the mass wasting deposits. The surficial mass wasting deposits between SE 64th Street and East Mercer Way are mapped as underlain mainly by Lawton Clay Deposits (Qvlc), with some Pre-Olympia Nonglacial Deposits (Qpon) near East Mercer Way. Lawton Clay deposits are described as very

stiff to hard silt, silty clay and clayey silt, laminated to massive. Pre-Olympia Nonglacial deposits are described as very dense or hard, sand, gravel, silt, clay and organic beds.

SUBSURFACE SOIL AND GROUNDWATER CONDITIONS

The soils observed in the borings consisted of interbedded sand and silty clay deposits, with silty clay occurring near the top of the slope and sand underneath the clay and lower down on the slope. Most of the borings encountered colluvium near the surface, consisting of locally derived native material that has been disturbed by slope or mass wasting processes. Fill was found only in PG-2 near the foot of the slope. In general, the deposits found on the site do not resemble Lawton Clay deposits as mapped, and in our opinion the project area is underlain almost entirely by pre-Olympia strata.

The following describes the soils encountered in the borings. Please refer to the boring logs (Figures 4 to 11) for more detailed descriptions:

UNIT 1: Fill– Fill was observed in PG-2 on off the main driveway access to the homes just off East Mercer Way. The fill consisted of 5½ feet of loose, brown, silty, fine SAND. The fill contained occasional organics and exhibited a mixed texture. As indicated above, the hollow on Parcel 302405-9151 appears to have been excavated, and we anticipate that this was the source of the fill, which was used to fill a shallow stream drainage to provide access to the house at 6423 E Mercer Way and one other house. The fill soil in PG-1 was underlain by 4 feet of red brown, silty, fine SAND, which was lumped in with the fill based on N-value, but which may be alluvial in nature.

UNIT 2: Colluvium – The borings near the top of the slope, PG-6, PG-7 and PG-8 encountered a layer of disturbed soil at the surface. The colluvium was identified by low N-values and mixed textures. In PG-6 on Parcel 302405-9001, sited just below SE 64th Street, the colluvium consisted of two layers, a three-foot thick layer of loose, brown, silty, fine to coarse SAND at the surface, underlain by a 2½-foot thick layer of loose, brown, clayey SILT with fine sand. Both layers contained occasional gravel. PG-8 was located below PG-6 near the top of the east facing drainage swale on Parcel 302405-9001. This boring encountered a 4½ feet of loose or stiff, brown, silty CLAY to clayey SILT. The soil is slightly to low plastic, with some layers showing rapid dilatancy. In PG-7 on the property at 9167 SE 64th Street, the colluvium consisted of 4½ feet of loose,

yellow brown SILT with fine sand, underlain by 4½ feet of medium dense, silty, fine SAND to sandy SILT on this property. This lower unit may be a bed of advanced outwash, but was interpreted as colluvium based on the low N-values. The AMEC borings (B-4 and B-5) also encountered colluvium consisting of soft to medium stiff clayey SILT to sandy SILT, to a depth of roughly 15 and 11 feet, respectively.

UNIT 3: *pre-Olympia Silty Clay Deposits* – Beds consisting mainly of silty, lean CLAY, with beds of non-plastic to slightly plastic clayey SILT, were found from the surface in PG-3, PG-4 and PG-5, and beneath the colluvium in PG-6 to PG-8. PG-3 was drilled just below the driveway to 6423 E Mercer Way, and penetrated 8 feet of medium dense, non-plastic, brown gray SILT. PG-4 and PG-5 on Parcel 302405-9151, both penetrated 9 ½ feet very stiff to hard, brown gray, low plastic, silty, lean CLAY. The clay was laminated and the strata appeared to be dipping at angles of 5 to 25 degrees. In PG-4 the thick silty clay was underlain by 2½ feet of thinly interbedded clayey silt and silty, fine sand, possibly a transitional unit. Below the colluvium in PG-6 the boring encountered 5 feet of dense, brown, slightly plastic, clayey SILT with some fine sand, followed by 10 feet of very stiff to hard, brown, low plastic, silty, lean CLAY. PG-8 penetrated interbedded stiff to hard brown to brown gray, low plastic, silty, lean CLAY and slightly plastic, medium dense to very dense, clayey SILT with fine sand. At depth in PG-7 we found stiff to very stiff, gray, silty, lean CLAY.

UNIT 4: *pre-Olympia Sand Deposits* – Sand beds were encountered at the ground surface (PG-1) or at depth in all borings except PG-7 and PG-8. Where encountered at depth (PG-4 to PG-6), the sand strata consisted of beds of medium dense to very dense, brown to brown gray, silty, fine SAND or fine to medium SAND.

Groundwater was encountered in PG-2, PG-7 and PG-8. Groundwater was not found in PG-1, PG-3, or PG-4 to PG-6. The groundwater in PG-1 is presumed to be flow along the filled in drainage swale. In PG 7 and PG-8 the groundwater is perched in the shallow colluvial deposits above less permeable clay deposits. Borings B-4 and B-5 encountered groundwater at 9 and 8 feet below surface, respectively. Groundwater elevations and seepage rates are likely to vary depending on the season, local subsurface conditions, and other factors. Groundwater levels and seepage rates are normally highest during the winter and early spring.

GEOLOGY HAZARDS ASSESSMENT

Landslide Hazards and Steep Slopes

According to the City of Mercer Island's Geologic Hazards Map, the site lies within a potential landslide hazard area where landslides have occurred in the past. **Based on our field observations and the results of our field exploration, it is our opinion that the site is globally stable in its current configuration. It is also our opinion that the planned constructions will not adversely impact the overall stability of the subject and surrounding properties, provided that the recommendations presented in this report are properly incorporated into the design and construction of the project.**

Erosion Hazards

The site also lies within a mapped potential erosion hazard area. Based on the results of our test borings, the silty and clayey site soils of upper portion of the site are anticipated to exhibit moderate to low erosion potential. The sand soils may pose a moderate to high risk of erosion,. **In our opinion, the erosion hazard at the site can be effectively mitigated with the best management practice during construction and with properly designed and implemented landscaping for permanent erosion control.** During construction, the temporary erosion hazard can be effectively managed with an appropriate erosion and sediment control plan, including but not limited to installing silt fencing at the construction perimeter, limiting removal of vegetation from the construction area, placing rocks or hay bales at the disturbed/traffic areas and on the downhill side of the project, covering all stockpiled soil or cut slopes with plastic sheets, constructing a temporary drainage pond to control surface runoff and sediment traps if needed, placing rocks at the construction entrance, etc. Permanent erosion control measures should include establishing vegetation, landscape plants, and hardscape established at the end of project.

Seismic Hazards

The site also lies with a mapped potential seismic hazard area, which may be susceptible to risk of damage from earthquake-induced ground shaking, slope failure, soil liquefaction, or surface faulting. While the site is contained within the area mapped as having a known or suspected seismic hazard, the relative lack of groundwater and the cohesive soils in the two eastern parcels suggest the hazard is not high or moderate. The parcel at 9167 SE 64th Street may have

a moderate potential for liquefaction, which may be by supporting any structure on driven pin pile foundations. Potential remedial measures are subsequently discussed in the engineering design recommendations.

GEOTECHNICAL DESIGN RECOMMENDATIONS

SEISMIC DESIGN PARAMETERS

The following provides seismic design parameters for the site that are in conformance with the 2012 International Building Code (IBC), which specifies a design earthquake having a 2% probability of occurrence in 50 years (return interval of 2,475 years), and the 2008 USGS seismic hazard maps:

Site Class	Spectral Acceleration at 0.2 sec. (g)	Spectral Acceleration at 1.0 sec. (g)	Site Coefficients		Design Spectral Response Parameters	
	S _s	S ₁	F _a	F _v	S _{DS}	S _{D1}
D	1.449	0.554	1.0	1.5	0.996	0.554

HOUSE FOUNDATIONS

In general, the houses may be supported on conventional spread footings and/or driven pin piles. Parcel 302405-9151 may be supported on spread footings where located over dense sand in hillside cuts, but the loose sand fill area will require pin piles. Parcel 302405-9001 may be founded on spread footings in the ridge area around PG-4 and PG-5, but may require pin piles if the house extends into the swale around PG-8. Pin pile foundations should be used to support the house at 9167 SE 64th Street to mitigate potential settlement due to the loose surficial soils. The following presents our recommendations for spread footings and pin pile foundations.

Conventional Foundations

Based on results of our test borings, dense soil is anticipated to be present at the foundation level in portions of parcels 302405-9151 and 302405-9001. How much of any proposed structures may be placed on spread footings depends on the final footprint and location of the structure on the property.

Allowable Bearing Pressure

We recommend using an allowable soil bearing pressure of 3,000 pounds per square feet (psf) be used for footings bearing on dense to very dense, native pre-Olympia sand or clay deposits, or compacted fill. The recommended allowable bearing pressures are for dead plus live loads. For allowable stress design, the recommended bearing pressure may be increased by one-third for transient loading, such as wind or seismic forces. Continuous and individual spread footings should have minimum widths of 18 and 24 inches, respectively. Footings should be placed at least 18 inches below final exterior grade. Interior footings should be placed at least 12 inches below the top of slab.

Foundation Performance

Total and differential settlements are anticipated to be within tolerable limits for foundation designed and constructed as discussed above. Conventional footings bearing on competent native soil and structural fill may experience static settlement of less one inch and differential settlement between adjacent columns should be less than about ½ inch. Most settlement should occur during construction as loads are applied.

Lateral Resistance

Lateral forces from wind or seismic loading may be resisted by a combination of passive earth pressures acting against the embedded portions of the foundations and walls, and by friction acting on the base of the foundations. Passive resistance values may be determined using an equivalent fluid weight of 300 pounds per cubic foot (pcf). This value includes a factor safety of at least 1.5 assuming that densely compacted structural fill will be placed adjacent to the sides of the foundation. A friction coefficient of 0.4 may be used to determine the frictional resistance at the base of the foundation. This coefficient includes a factor of safety of approximate 1.5. Unless covered by pavements or slabs, the passive resistance in the upper 12 inches of soil should be neglected.

Footing Subgrade Preparation

All footing subgrades should be carefully prepared. The adequacy of footing subgrade should be verified by a representative of PanGEO, prior to placing forms or rebar. The footing subgrade should be in a dense condition prior to concrete pour. Any footing over-excavations should be backfilled with Seattle Type 2 or 17 material, which should be placed in 8-inch thick lifts and

compacted to a dense condition. Footing excavations should be observed by PanGEO to confirm that the exposed footing subgrade is consistent with the expected conditions and adequate to support the design bearing pressure.

It should be noted that site soils are highly moisture sensitive and can be easily disturbed when exposed to moisture. If footings are constructed during wet weather, the exposed footing subgrade should be adequately protected to prevent disturbance. The footing subgrade may be protected with at least 3 inches of lean-mix concrete, or 4 to 6 inches of compacted crushed surfacing base course (CSBC).

Pin Pile Foundations

We recommend pin pile foundation support for any structure constructed on the 9167 SE 64th Street parcel, and for portions of the other two parcels including the fill area of parcel 302405-9151 and the upper swale area of 302405-9001. Pile parameters are as follows:

Pin Pile Sizes - In our opinion, 3-, 4-, or 6-inch diameter, Schedule 40, galvanized, steel pipes (pin piles) may be used to support the new structure. Three, four, and six-inch diameter pin piles are typically installed using small hammers mounted on a small excavator.

Pin Pile Capacity - The number of piles required depends on the magnitude of the design load. Allowable axial compression capacities of 6, 10, and 15 tons may be used for the 3-, 4-, and 6-inch diameter pin piles, respectively, with an approximate factor of safety of 2 for piles driven to refusal. Penetration resistance required to achieve the (refusal) capacities will be determined based on the hammer used to install the pile. Tensile capacity of pin piles should be ignored in design calculations.

It is our experience that the driven pipe pile foundations should provide adequate support with total settlements on the order of ½-inch or less.

The criterion for driving refusal is defined as the minimum amount of time (in seconds) required to achieve one inch of penetration, and it varies with the size of hammer used for pile driving. For 3-, 4-, and 6-inch pin piles, the following table is a summary of driving refusal criteria for different hammer sizes that are commonly used:

**Summary of Commonly-Accepted Driving Criteria for 3-, 4-, and 6-inch Pin Pile
 with a 6, 10, and 15-ton Allowable Axial Compression Load**

Hammer Model	Hammer Weight (lb) / Blows per minute	3" Pile Refusal Criteria (seconds per inch of penetration)	4" Pile Refusal Criteria (seconds per inch of penetration)	6" Pile Refusal Criteria (seconds per inch of penetration)
Hydraulic TB 325	850 / 900	10	16	
Hydraulic TB 425	1,100 / 900	6	10	20
Hydraulic TB 725X	2,000 / 600	3	4	10
Hydraulic TB 830X	3,000 / 500			6

Please note that these refusal criteria were established empirically based on previous load tests on 3-, 4-, and 6-inch pin piles. Contractors may select a different hammer for driving these piles, and propose a different driving criterion. In this case, it is the contractor’s responsibility to demonstrate to the Engineer’s satisfaction that the design load can be achieved based on their selected equipment and driving criteria.

Pin Pile Specifications - We recommend that the following specifications be included on the foundation plan:

1. All piles should consist of galvanized Schedule-40, ASTM A-53 Grade “A” pipe.
2. All piles shall be driven to refusal (see above table).
3. Piles shall be driven in nominal sections and connected with compression fitted sleeve couplers (i.e. no welding of pipe segments).
4. The geotechnical engineer of record or his/her representative shall observe pin pile installation.

The quality of a pin pile foundation is dependent, in part, on the experience and professionalism of the installation company. We recommend that a company with experienced personnel be selected to install the piles.

Lateral Forces - The capacity of pin pipes to resist lateral loads is very limited and should not be used in design. Therefore, lateral forces from wind or seismic loading should be resisted by the passive earth pressures acting against the pile caps and below-grade walls or from battered piles (batter no steeper than 3(H):12(V)). ***Friction at the base of pile-supported concrete grade beam should be ignored in the design calculations.*** Passive resistance values may be determined using an equivalent fluid weight of 400 pounds per cubic foot (pcf). This value includes a safety factor of about 1.5 assuming that properly compacted granular fill will be placed adjacent to and surrounding the pile caps and grade beams.

Grade Beam/Pile Cap Embedment - We recommend that the base of perimeter grade beams extend at least 18 inches below the adjacent exterior ground surface and that the base of interior grade beams extend at least 12 inches below interior floor slabs.

Estimated Pile Length – The subsurface conditions at the site will likely vary substantially across the site. Based on the soil conditions at the site and our experience in the project area, for planning and cost estimating purposes, we estimate that pile length may range from about 10 to 20 feet.

PERIMETER FOOTING DRAIN AND INTERCEPTOR TRENCH DRAIN

Perimeter drains should be installed around buildings at or just below the invert of the footing or pile caps. Under no circumstances should roof downspout drain lines be connected to the footing drain systems. Roof downspouts must be separately tightlined to appropriate discharge locations. Cleanouts should be installed at strategic locations to allow for periodic maintenance of the footing drain and downspout tightline systems.

CONCRETE SLAB-ON-GRADE

In our opinion, conventional slab-on-grade construction may be utilized for the floor slabs. All soil beneath the floor slabs should be compacted to a dense and unyielding condition prior to placing capillary break material for the floor slabs. On-site soils that cannot be compacted to a dense and unyielding condition should be removed and replaced with compacted structural fill.

Slab-on-grade floors should be underlain by a capillary break consisting of at least of 4 inches of ¾-inch, clean crushed rock (less than 3 percent fines) compacted to a firm and unyielding condition. The capillary break should be placed on subgrade that has been compacted to a dense and unyielding condition. The capillary break should be placed on a suitable subgrade as confirmed by PanGEO. A 10-mil polyethylene vapor barrier should also be placed directly below the slab. We also recommend that control joints be incorporated into the floor slab to control cracking.

RETAINING AND BASEMENT WALL DESIGN PARAMETERS

Retaining and basement walls should be properly designed to resist the lateral earth pressures exerted by the soils behind the wall. Proper drainage provisions should also be provided behind the walls to intercept and remove groundwater that may be present behind the wall. Our geotechnical recommendations for the design and construction of the retaining/below-grade walls are presented below.

Lateral Earth Pressures

Concrete cantilever walls should be designed for an active pressure of 35 pcf for level backfills behind the walls assuming the walls are free to rotate or for an equivalent fluid weight of 50 pcf for rigid or unyielding walls. Walls with a 1(H):1(V) backslope should be designed for an active equivalent fluid weight of 45 pcf. Permanent walls should be designed for an additional uniform lateral pressure of 6H psf for seismic loading, where H corresponds to the buried depth of the wall. These recommendations assume that the wall backfill will consist of a free draining and properly compacted fill with adequate drainage provisions.

Surcharge

Surcharge loads, where present, should also be included in the design of retaining walls. We recommend that a lateral load coefficient of 0.3 be used to compute the lateral pressure on the wall face resulting from surcharge loads located within a horizontal distance of one-half wall height.

Lateral Resistance

Lateral forces from seismic loading and unbalanced lateral earth pressures may be resisted by a combination of passive earth pressures acting against the embedded portions of the foundations

and by friction acting on the base of the footings. Passive resistance values may be determined using an equivalent fluid weight of 400 pcf. This value includes a factor of safety of 1.5, assuming the footing is poured against dense native sand, re-compacted on-site sandy soil or properly compacted structural fill adjacent to the sides of footing. A friction coefficient of 0.5 may be used to determine the frictional resistance at the base of the footings. The coefficient includes a factor safety of 1.5.

Wall Drainage

Provisions for wall drainage should consist of a 4-inch diameter perforated drainpipe behind and at the base of the wall footings, embedded in 12 to 18 inches of clean crushed rock and pea gravel wrapped with a layer of filter fabric. We recommend a composite drainage material, such as Miradrain 6000, be used for drainage on exterior walls. The drainpipe at the base of the wall should be graded to direct water to a suitable outlet.

Wall Backfill

In our opinion, imported structural fill should be used for wall backfill, and should consist of granular material, such as WSDOT Gravel Borrow or approved equivalent. In areas where the space is limited between the wall and the face of excavation clean crushed rock may be used as backfill without compaction.

Wall backfill should be moisture conditioned to within about 3 percent of optimum moisture content, placed in loose, horizontal lifts less than 8 inches in thickness, and systematically compacted to a dense and relatively unyielding condition and to at least 95 percent of the maximum dry density, as determined using test method ASTM D 1557. Within 5 feet of the wall, the backfill should be compacted with hand-operated equipment to at least 90 percent of the maximum dry density.

PARCEL 30214059001 ACCESS

Preliminary concept for driveway access to the parcel 30214059001 indicates a plan to construct a driveway from SE64th Street, as shown on Figure 2. This would require traversing a slope that is up to 1H:1V in places, especially at the top, and the slope is designated a steep slope hazard by the City of Mercer Island. In our opinion, the proposed driveway would require a soldier pile wall for support, would have a gradient of some 25 percent, and have poor sight distances with

SE64th Street. Construction would require an easement from the New Hope Church to cross a portion of their property, and also an easement from the City of Mercer Island. Existing overhead utilities would have to be temporarily relocated.

Alternatively, a partially developed pathway may be used for access along the north property line of the house at 6423 E Mercer Way and enters the property along the ridgeline from the southeast. This alignment could be developed into a driveway relatively easily and would have a gradient of roughly 10 to 12 percent.

From above, a driveway access could be developed beginning at the northwest corner of the property at 9185 SE 64th Street and trending east across the slope to enter the subject property at the northwest corner. This alignment would require permanent easements from the New Hope Church and from property owner of 9185 SE 64th Street. However, the driveway cut starts 10 to 12 feet below the start elevation of the preliminary alignment, and construction could take advantage of a naturally occurring bench on the hillside.

CONSTRUCTION CONSIDERATIONS

SITE PREPARATION

Site preparation for the proposed project mainly includes site clearing and excavations to the design subgrade. All debris resulted from site clearing should be hauled away from the site. The stripped surface soil materials should be properly disposed off-site or be “wasted” on site in non-structural landscaping areas.

Following site clearing and excavations, the adequacy of the subgrade should be verified by a representative of PanGEO. Areas of weak soil may require over-excavation and replacement with compacted structural fill or lean-mix concrete.

TEMPORARY EXCAVATIONS

Planning for the individual sites is not well advanced, so the depth of excavations, if any, is currently unknown. We anticipate most excavations will mainly encounter loose to medium dense silty sand and soft silt and/or clay. All temporary excavations should be performed in accordance with Part N of WAC (Washington Administrative Code) 296-155. The contractor is responsible for maintaining safe excavation slopes and/or shoring.

Based on anticipated soil conditions temporary excavations may be sloped at 1(H):1(V). However, the temporary excavations and cut slopes should be re-evaluated in the field during construction and may require modifications in the wet season. The cut slopes should be covered with plastic sheets in the wet season. We also recommend that heavy construction equipment, building materials, excavated soil, and vehicular traffic should not be allowed within a distance equal to 1/3 the slope height from the top of any excavation.

PERMANENT CUT AND FILL SLOPES

Based on the soil conditions underlying the site, we recommend permanent cut and fill slopes be constructed no steeper than 2(H):1(V).

MATERIAL REUSE

In the context of this report, structural fill is defined as compacted fill placed under footings, concrete stairs and landings, and slabs, or other load-bearing areas. In our opinion, the on-site soil is not suitable as structural fill. The structural fill should consist of imported, well-graded, granular material, such as WSDOT Gravel Borrow (WSDOT 9-03.14(1)) or approved equivalent. The on-site fill may be used as general fill in the non-structural and landscaping areas. If use of the on-site soil is planned, the excavated soil should be stockpiled and protected with plastic sheeting to prevent softening from rainfall in the wet season.

STRUCTURAL FILL PLACEMENT AND COMPACTION

Structural fill should be moisture conditioned to within about 3 percent of optimum moisture content, placed in loose, horizontal lifts less than 8 inches in thickness, and systematically compacted to a dense and relatively unyielding condition and to at least 95 percent of the maximum dry density, as determined using test method ASTM D 1557.

Depending on the type of compaction equipment used and depending on the type of fill material, it may be necessary to decrease the thickness of each lift to achieve adequate compaction. PanGEO can provide additional recommendations regarding structural fill and compaction during construction.

WET WEATHER EARTHWORK

In our opinion, the construction at the proposed sites may be accomplished during wet weather without adversely affecting the site stability. However, earthwork construction performed during the drier summer months will likely be more economical. The properties underlain by pre-Olympia fines grained deposits could become especially difficult should the clay soils become disturbed and saturated. Winter construction will require the implementation of best management erosion and sedimentation control practices to reduce the risk of off-site sediment transport. Most of the site soils within the anticipated depth of excavation contain a high percentage of fines and are moisture sensitive. Any footing subgrade soils that become softened either by disturbance, groundwater or rainfall should be removed and replaced with structural fill, Controlled Density Fill (CDF), or lean-mix concrete.

General recommendations relative to earthwork performed in wet conditions are presented below:

- Site stripping, excavation and subgrade preparation should be followed promptly by the placement and compaction of clean structural fill or CDF;
- The size and type of construction equipment used may have to be limited to prevent soil disturbance;
- The ground surface within the construction area should be graded to promote run-off of surface water and to prevent the ponding of water;
- Geotextile silt fences and bales of straw should be strategically located to control erosion and the movement of soil;
- Structural fill should consist of less than 5% fines; and
- Excavation slopes should be covered with plastic sheets.

SURFACE DRAINAGE CONSIDERATIONS

Surface runoff can be controlled during construction by careful grading practices. Typically, this includes the construction of shallow, upgrade perimeter ditches or low earthen berms in conjunction with silt fences to collect runoff and prevent water from entering excavations or to prevent runoff from the construction area from leaving the immediate work site.

Permanent control of surface water should be incorporated in the final grading design. Adequate surface gradients and drainage systems should be incorporated into the design such that surface runoff is directed away from slopes and structures. Water from roof drains and other impervious areas should be properly collected and discharged into a storm drain system, and should not be discharged on to the slope areas.

ADDITIONAL SERVICES

To confirm that our recommendations are properly incorporated into the design and construction of the proposed development, PanGEO should be retained to conduct a review of the final project plans and specifications, and to monitor the construction of geotechnical elements. The City of Mercer Island, as part of the permitting process, will also require geotechnical construction inspection services. PanGEO can provide you a cost estimate for construction monitoring services at a later date.

We anticipate that the following additional services will be required:

- Review final project plans and specifications
- Verify implementation of erosion control measures;
- Verify adequacy of footing subgrade;
- Monitor pin pile installation;
- Monitor temporary excavation;
- Monitor the installation of temporary and permanent soldier pile walls
- Verify the adequacy of subsurface drainage installation;
- Confirm the adequacy of the compaction of structural backfill; and
- Other consultation as may be required during construction

Modifications to our recommendations presented in this report may be necessary, based on the actual conditions encountered during construction.

CLOSURE

We have prepared this report for Benjamin C. Altman, Exe., George Steirer and the project design team. Recommendations contained in this report are based on a site reconnaissance, a subsurface exploration program, review of pertinent subsurface information, and our understanding of the project. The study was performed using a mutually agreed-upon scope of work.

Variations in soil conditions may exist between the locations of the explorations and the actual conditions underlying the site. The nature and extent of soil variations may not be evident until construction occurs. If any soil conditions are encountered at the site that are different from those described in this report, we should be notified immediately to review the applicability of our recommendations. Additionally, we should also be notified to review the applicability of our recommendations if there are any changes in the project scope.

The scope of our work does not include services related to construction safety precautions. Our recommendations are not intended to direct the contractors' methods, techniques, sequences or procedures, except as specifically described in our report for consideration in design. Additionally, the scope of our work specifically excludes the assessment of environmental characteristics, particularly those involving hazardous substances. We are not mold consultants nor are our recommendations to be interpreted as being preventative of mold development. A mold specialist should be consulted for all mold-related issues.

This report has been prepared for planning and design purposes for specific application to the proposed project in accordance with the generally accepted standards of local practice at the time this report was written. No warranty, express or implied, is made.

This report may be used only by the client and for the purposes stated, within a reasonable time from its issuance. Land use, site conditions (both off and on-site), or other factors including advances in our understanding of applied science, may change over time and could materially affect our findings. Therefore, this report should not be relied upon after 24 months from its issuance. PanGEO should be notified if the project is delayed by more than 24 months from the date of this report so that we may review the applicability of our conclusions considering the time lapse.

It is the client's responsibility to see that all parties to this project, including the designer, contractor, subcontractors, etc., are made aware of this report in its entirety. The use of information contained in this report for bidding purposes should be done at the contractor's option and risk. Any party other than the client who wishes to use this report shall notify PanGEO of such intended use and for permission to copy this report. Based on the intended use of the report, PanGEO may require that additional work be performed and that an updated report be reissued. Noncompliance with any of these requirements will release PanGEO from any liability resulting from the use this report.


We appreciate the opportunity to be of service.

Sincerely,



Stephen H. Evans

Stephen H. Evans, L.E.G.
Senior Engineering Geologist

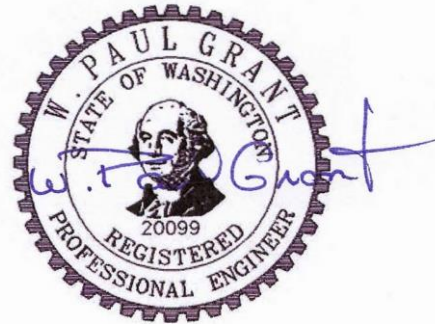

W. Paul Grant, P.E.
Principal Geotechnical Engineer

Enclosures:

Figure 1: Vicinity Map

Figure 2: Project Overview and Boring Locations

Figure 3a: Site and Exploration Plan, Lot 302405-9151

Figure 3b: Site and Exploration Plan, Lot 302405-9001

Figure 3c: Site and Exploration Plan, Lot 302405-9213 (9167 SE 64th Street)

Appendix A: PanGEO and AMEC Boring Logs


REFERENCES

AMEC Earth & Environmental, July 3, 2001, *Geotechnical Engineering Report, Proposed Single Family Residence, 46xx S.E. 64th Street, Mercer Island, Washington*, a report for JDW Homes, LLC, 4740 E. Mercer Way, Mercer Island, Washington.

International Code Council, 2015, *International Building Code (IBC)*.

Troost, K.G., and Wisher, A. P, 2006. *Geologic Map of Mercer Island, Washington, scale 1:24,000*.

WSDOT, 2018, *Standard Specifications for Road, Bridge and Municipal Construction, M 41-10*.

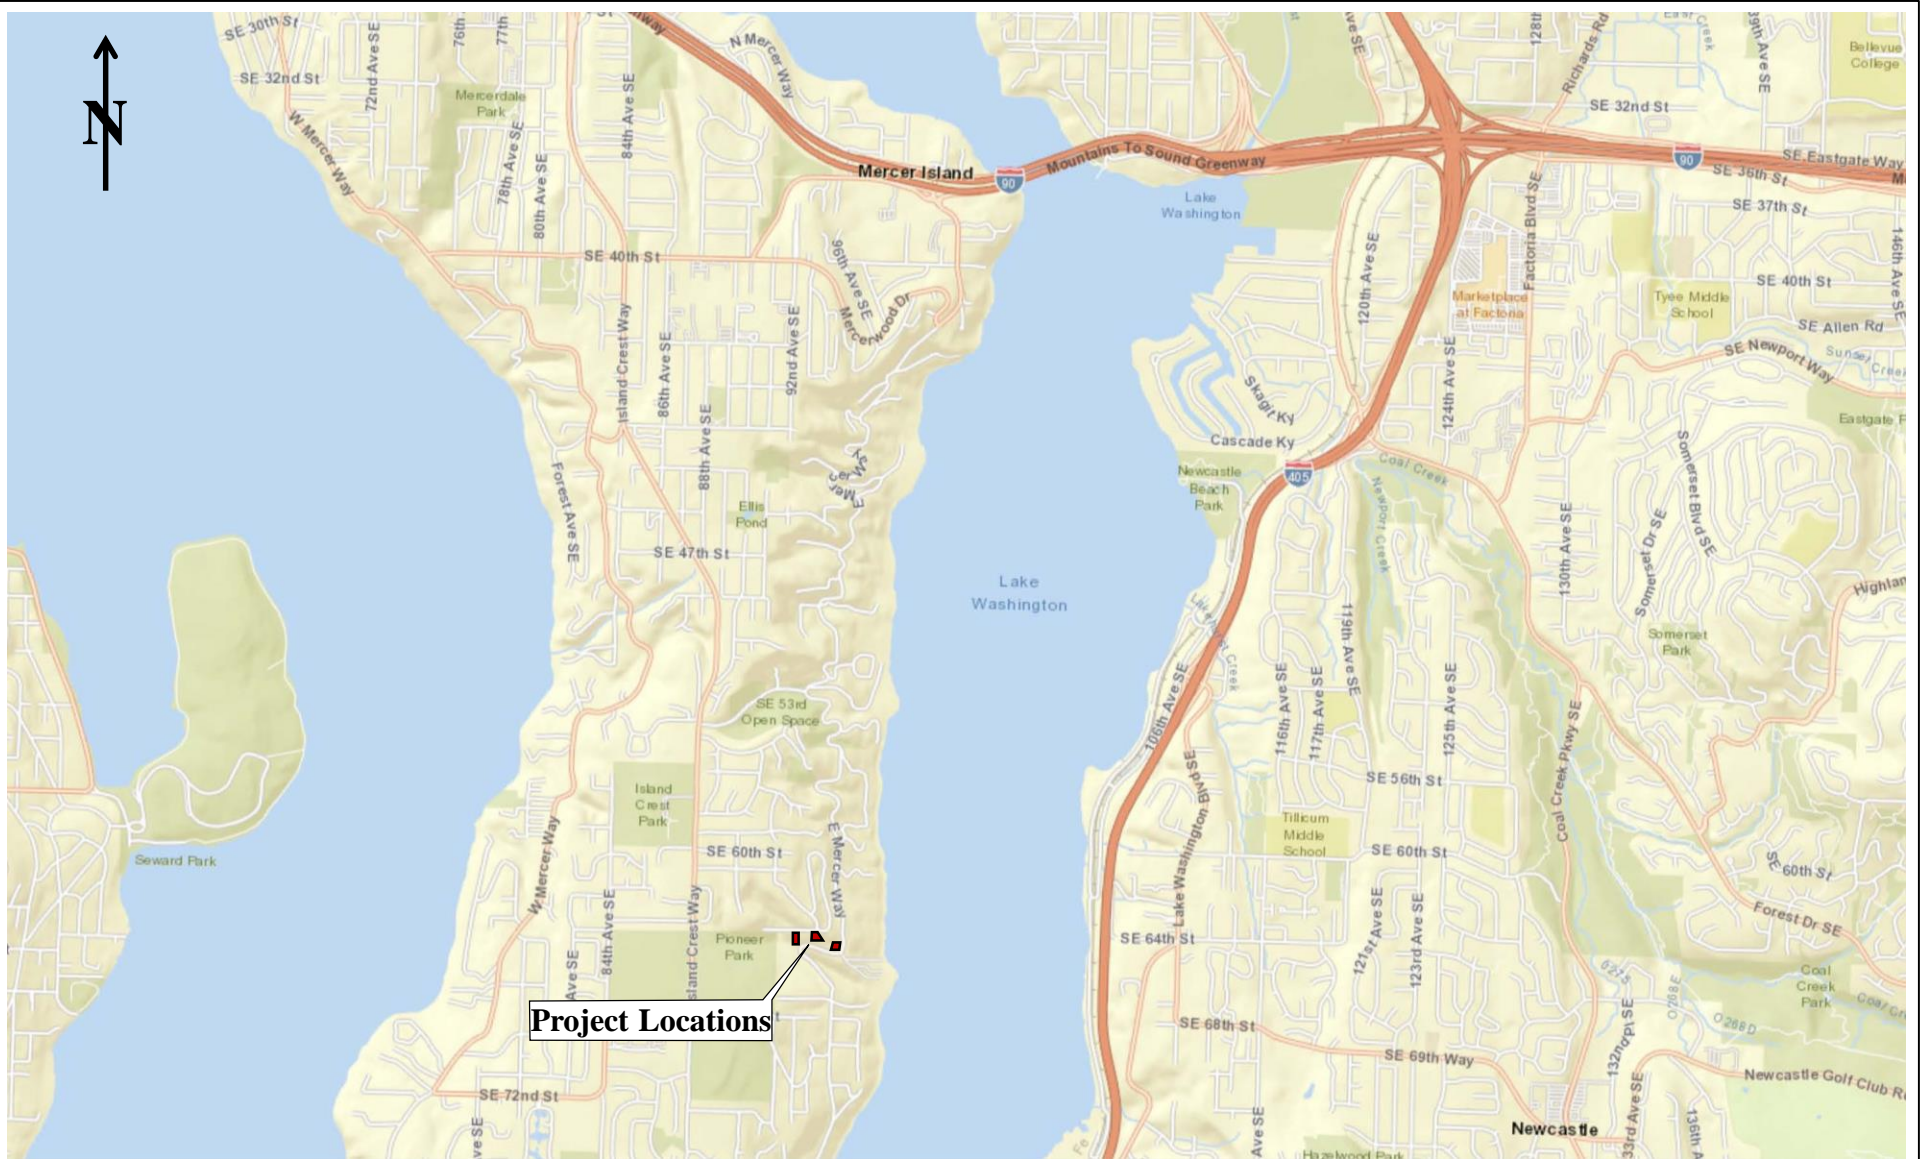

Map not to Scale
 Base Map from
 Dept of Natural
 Resources Geological
 Information Portal



**Proposed Development
 6423 East Mercer Way
 Mercer Island, WA**


VICINITY MAP

Project No.



19-062

Figure No.

1

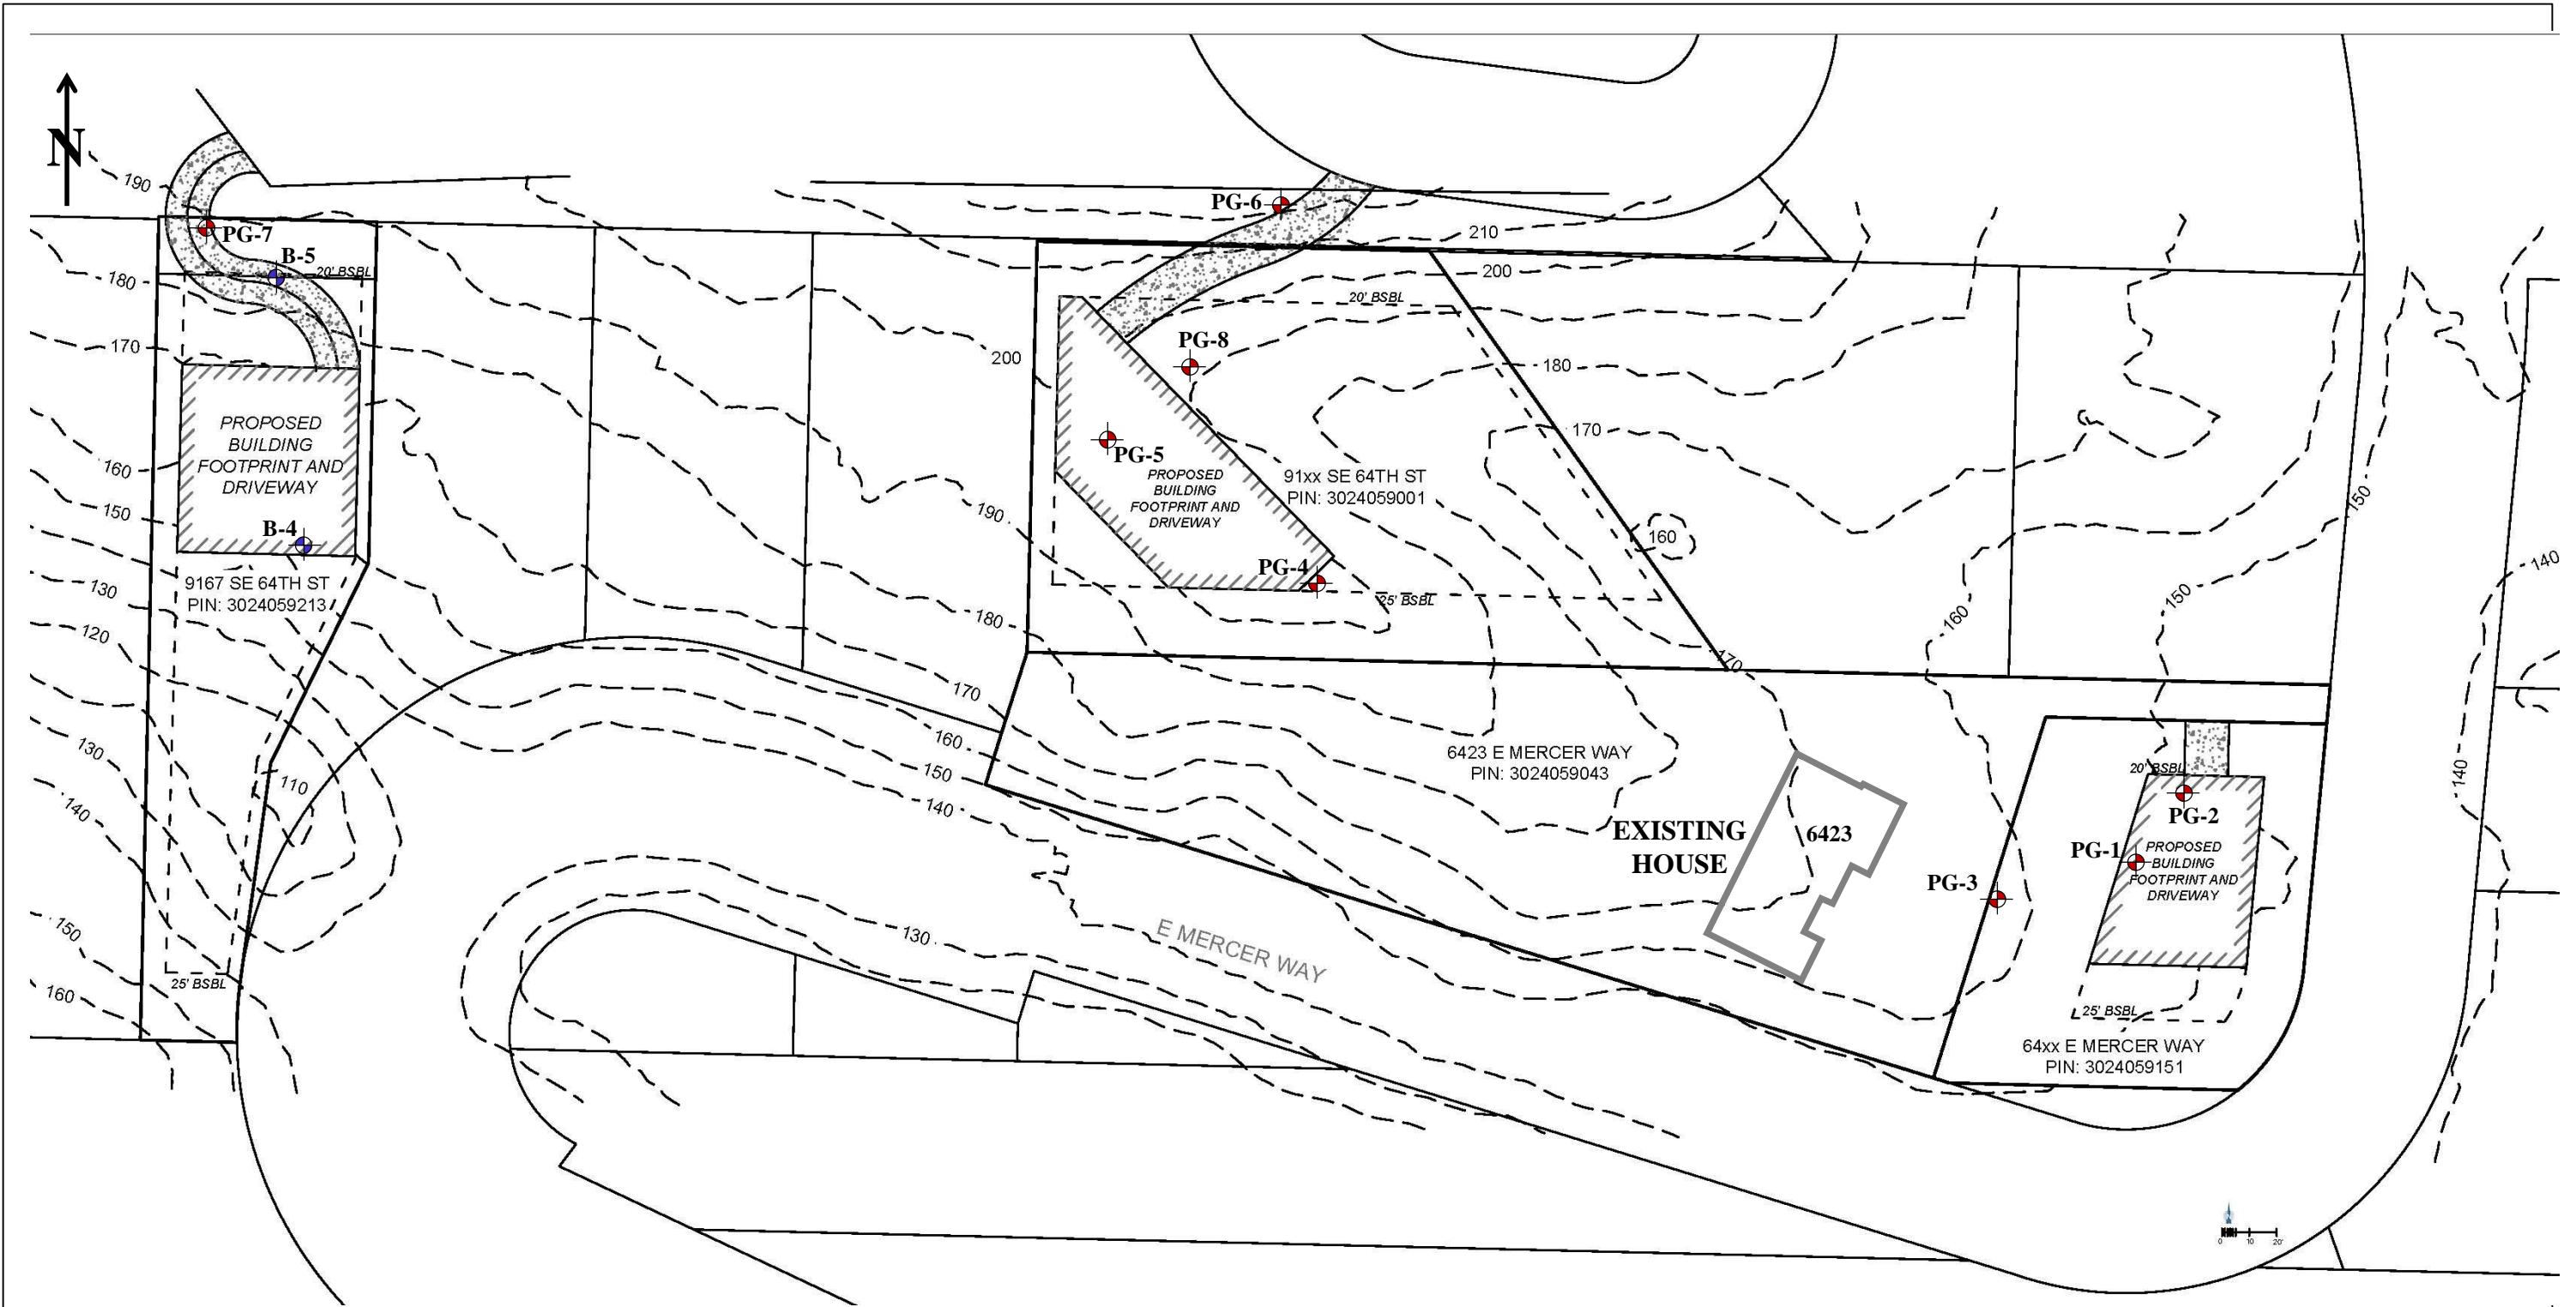


Not to Scale

- Legend:**
-  PanGEO Boring
 -  AMEC Boring

	Proposed Development 6423 E Mercer Way Mercer Island, WA		PROJECT OVERVIEW AND BORING LOCATIONS	
	Project No. 19-062			Figure No. 2

DRAWN BY: SHE CHECKED BY: WPG DATE: 05.09.19 Z:/Projects/2019 Projects/19-062/Exploration/Plant-190204_19-2-25_2013

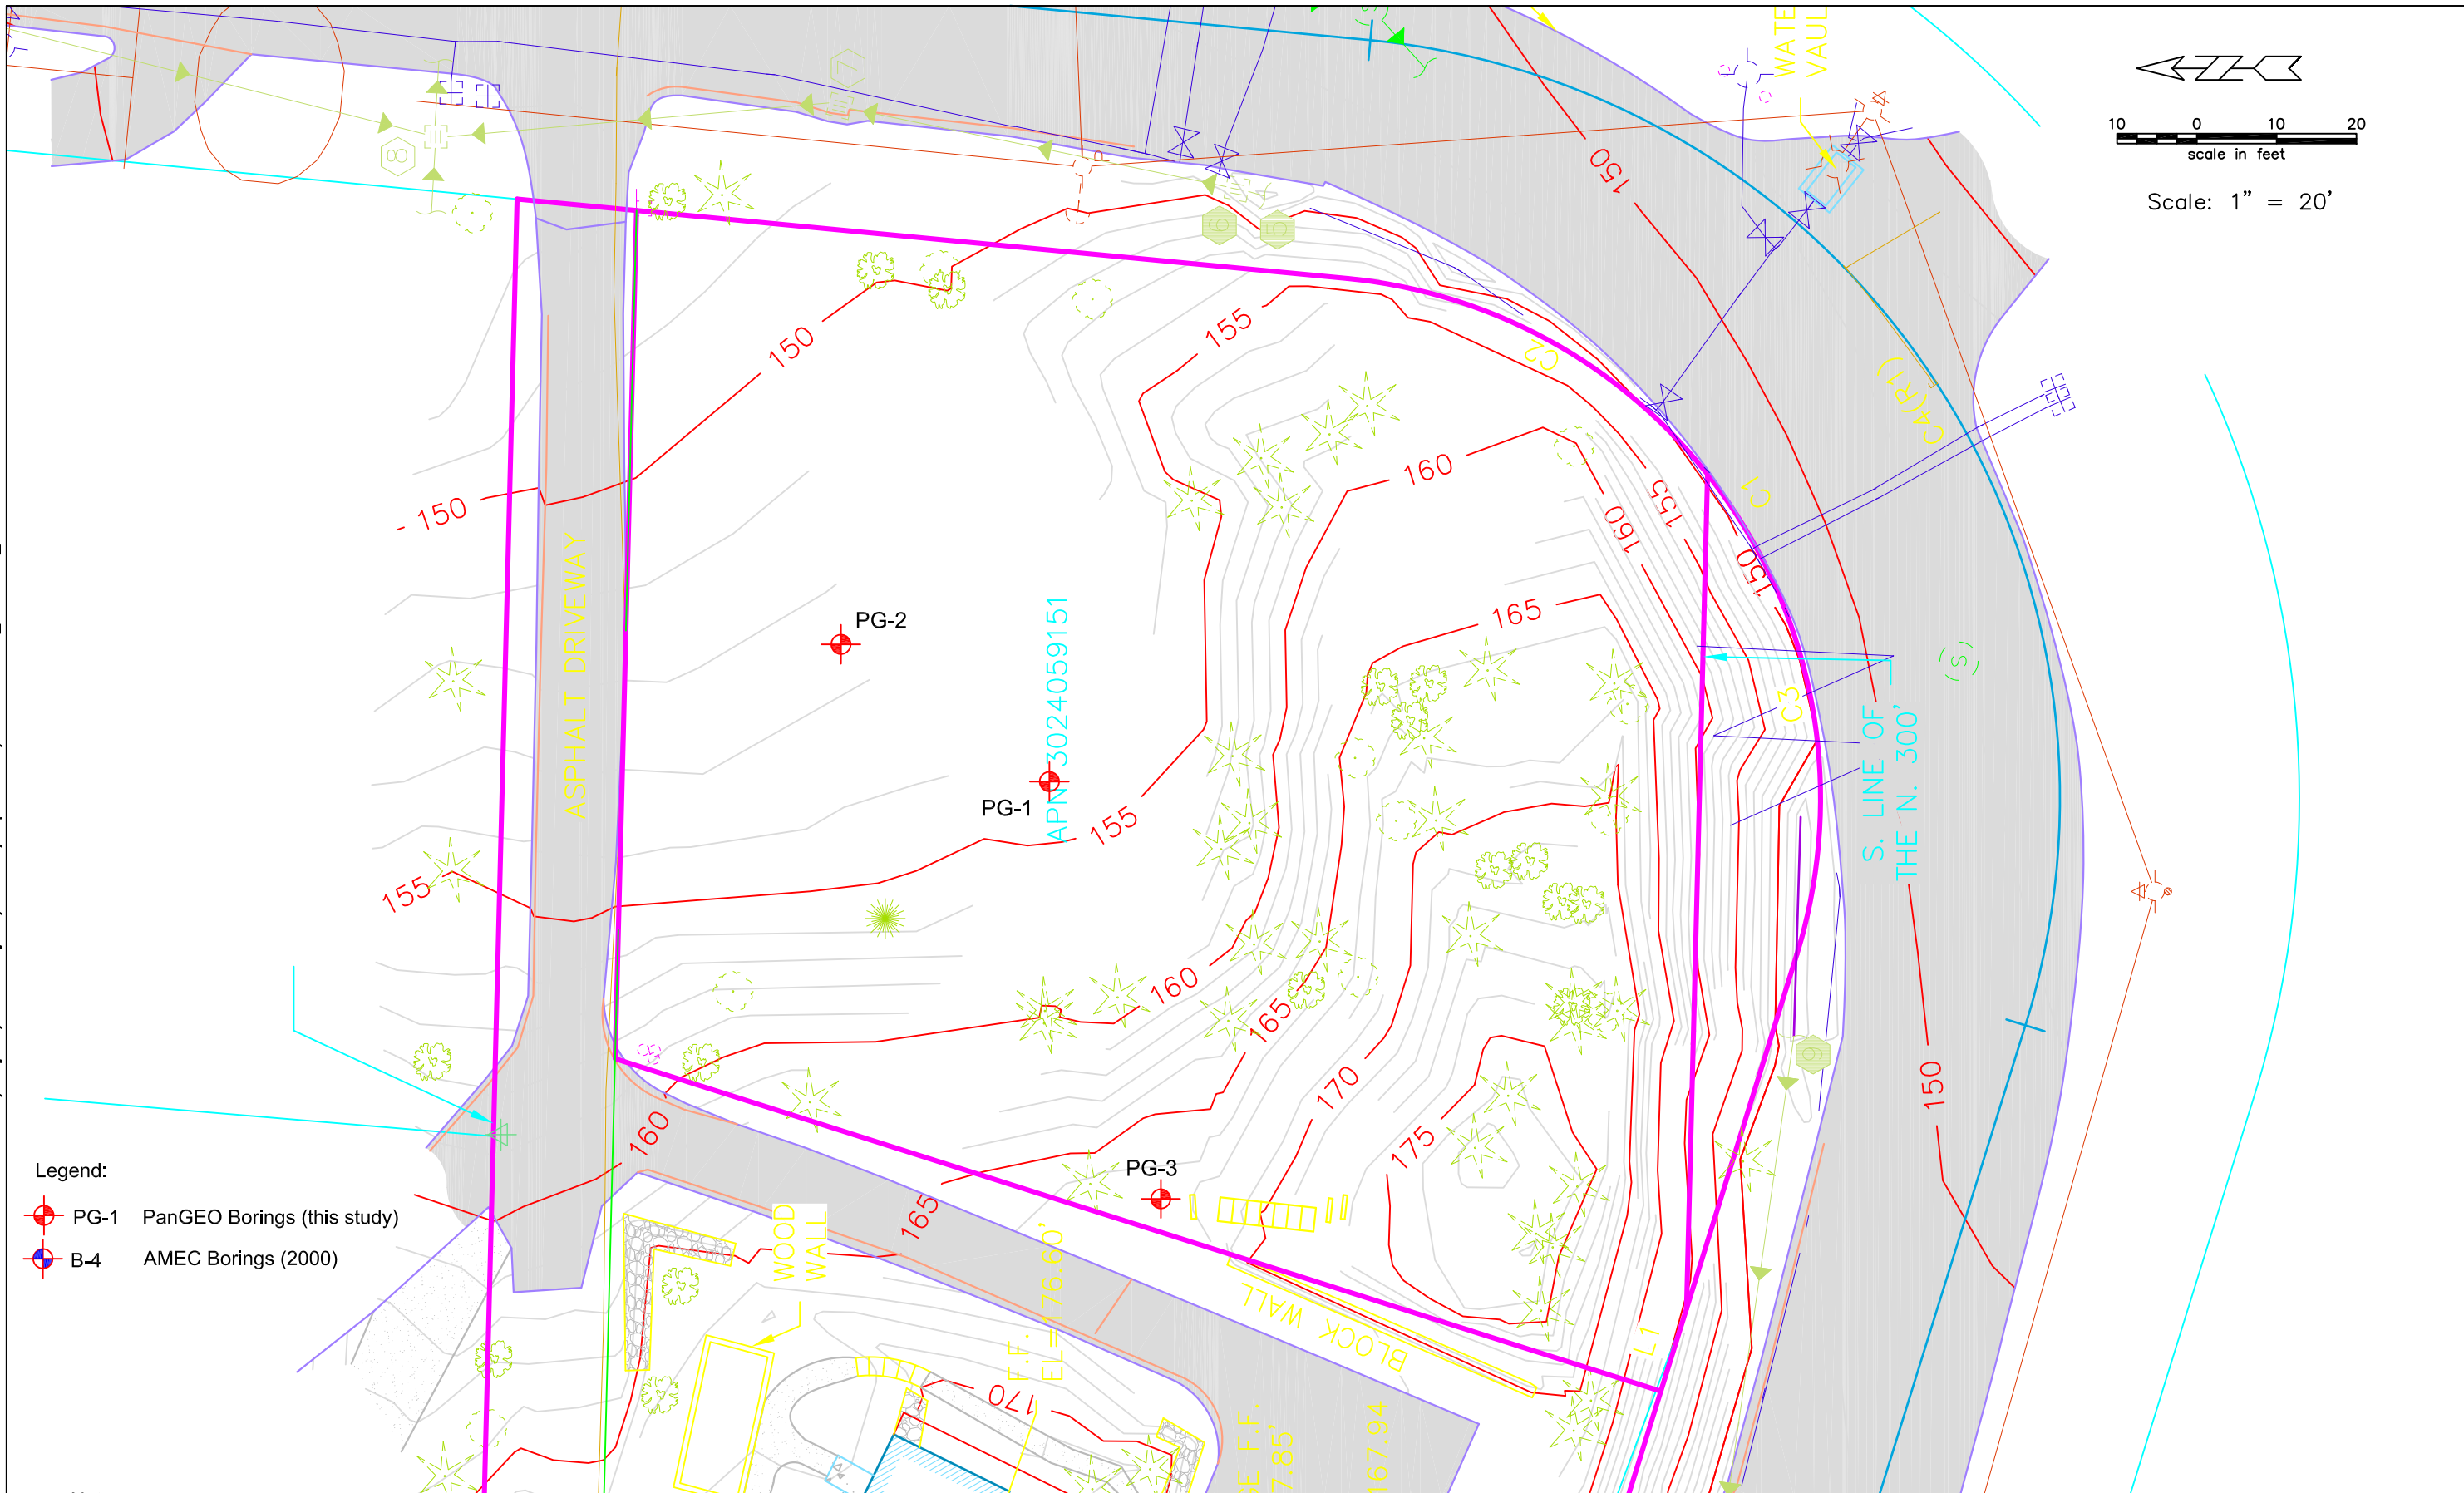

- Legend:
- PG-1 PanGEO Borings (this study)
 - B-4 AMEC Borings (2000)

- Notes:
1. Base map provided by Plan to Permit, May, 2019. Elevations are based on the NAVD88 datum.
 2. Boring logs for PanGEO borings PG-1 through PG-8 are located in Appendix A. Locations for these borings are approximate and based on the relative locations of known site features.
 3. Boring logs for historic investigations are located in Appendix B.




Proposed 3-Lot Development
6423 East Mercer Way
Mercer Island, Washington

SITE AND EXPLORATION PLAN
LOT 3024059151

PROJECT NO. 19-063

FIGURE NO. 3a

DRAWN BY: SHE
CHECKED BY: WPG
DATE: 05.09.19
Z:/Projects/2019 Projects/19-062/Exploration/Plant-190204_19-2-25_2013

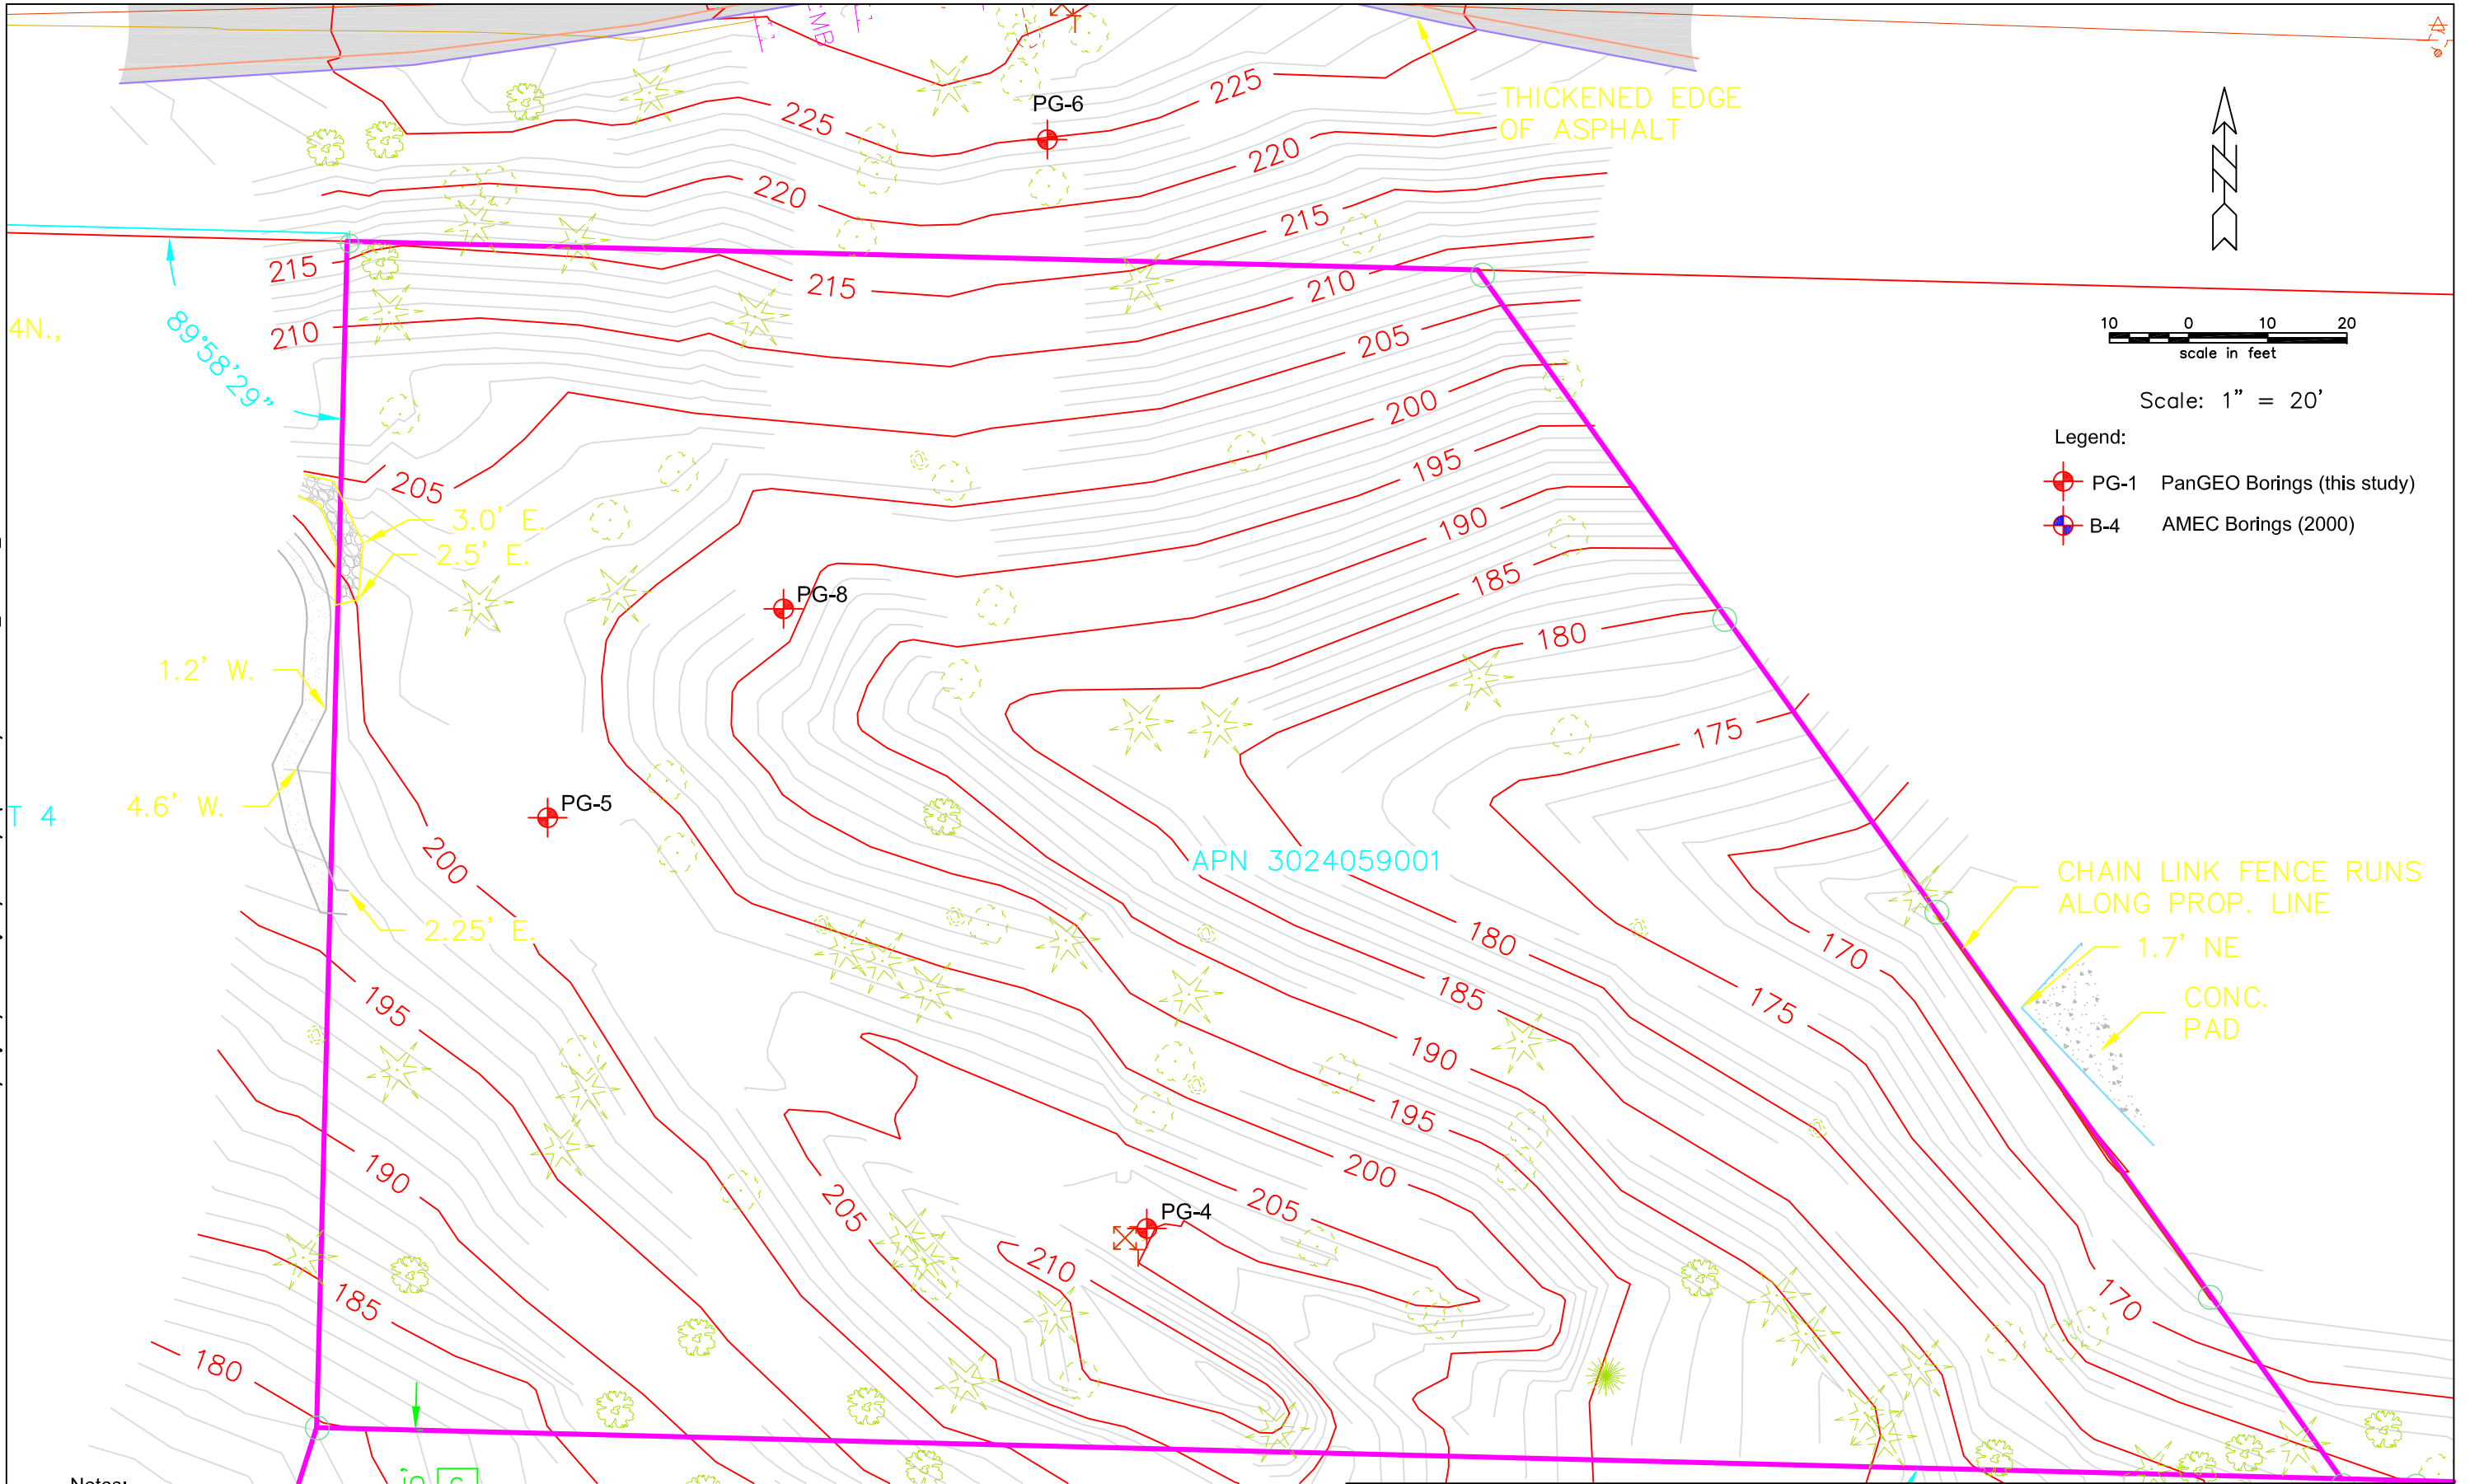

Notes:

1. Base map provided by Plan to Permit, May, 2019. Elevations are based on the NAVD88 datum.
2. Boring logs for PanGEO borings PG-1 through PG-8 are located in Appendix A. Locations for these borings are approximate and based on the relative locations of known site features.
3. Boring logs for historic investigations are located in Appendix B.



Proposed 3-Lot Development
6423 East Mercer Way
Mercer Island, Washington

SITE AND EXPLORATION PLAN
LOT 3024059001

PROJECT NO.
19-063

FIGURE NO.
3b

APPENDIX A

SUMMARY TEST BORING LOGS

RELATIVE DENSITY / CONSISTENCY

SAND / GRAVEL			SILT / CLAY		
Density	SPT N-values	Approx. Relative Density (%)	Consistency	SPT N-values	Approx. Undrained Shear Strength (psf)
Very Loose	<4	<15	Very Soft	<2	<250
Loose	4 to 10	15 - 35	Soft	2 to 4	250 - 500
Med. Dense	10 to 30	35 - 65	Med. Stiff	4 to 8	500 - 1000
Dense	30 to 50	65 - 85	Stiff	8 to 15	1000 - 2000
Very Dense	>50	85 - 100	Very Stiff	15 to 30	2000 - 4000
			Hard	>30	>4000

UNIFIED SOIL CLASSIFICATION SYSTEM

MAJOR DIVISIONS		GROUP DESCRIPTIONS	
Gravel 50% or more of the coarse fraction retained on the #4 sieve. Use dual symbols (eg. GP-GM) for 5% to 12% fines.	GRAVEL (<5% fines)		GW: Well-graded GRAVEL
	GRAVEL (>12% fines)		GP: Poorly-graded GRAVEL
Sand 50% or more of the coarse fraction passing the #4 sieve. Use dual symbols (eg. SP-SM) for 5% to 12% fines.	SAND (<5% fines)		GM: Silty GRAVEL
			GC: Clayey GRAVEL
	SAND (>12% fines)		SW: Well-graded SAND
			SP: Poorly-graded SAND
Silt and Clay 50% or more passing #200 sieve	Liquid Limit < 50		SM: Silty SAND
			SC: Clayey SAND
			ML: SILT
	Liquid Limit > 50		CL: Lean CLAY
			OL: Organic SILT or CLAY
			MH: Elastic SILT
Highly Organic Soils			CH: Fat CLAY
			OH: Organic SILT or CLAY
			PT: PEAT

TEST SYMBOLS

for In Situ and Laboratory Tests listed in "Other Tests" column.

- ATT Atterberg Limit Test
- Comp Compaction Tests
- Con Consolidation
- DD Dry Density
- DS Direct Shear
- %F Fines Content
- GS Grain Size
- Perm Permeability
- PP Pocket Penetrometer
- R R-value
- SG Specific Gravity
- TV Torvane
- TXC Triaxial Compression
- UCC Unconfined Compression

SYMBOLS

Sample/In Situ test types and intervals

- 2-inch OD Split Spoon, SPT (140-lb. hammer, 30" drop)
- 3.25-inch OD Split Spoon (300-lb hammer, 30" drop)
- Non-standard penetration test (see boring log for details)
- Thin wall (Shelby) tube
- Grab
- Rock core
- Vane Shear

- Notes:**
- Soil exploration logs contain material descriptions based on visual observation and field tests using a system modified from the Uniform Soil Classification System (USCS). Where necessary laboratory tests have been conducted (as noted in the "Other Tests" column), unit descriptions may include a classification. Please refer to the discussions in the report text for a more complete description of the subsurface conditions.
 - The graphic symbols given above are not inclusive of all symbols that may appear on the borehole logs. Other symbols may be used where field observations indicated mixed soil constituents or dual constituent materials.

DESCRIPTIONS OF SOIL STRUCTURES

Layered: Units of material distinguished by color and/or composition from material units above and below	Fissured: Breaks along defined planes
Laminated: Layers of soil typically 0.05 to 1mm thick, max. 1 cm	Slickensided: Fracture planes that are polished or glossy
Lens: Layer of soil that pinches out laterally	Blocky: Angular soil lumps that resist breakdown
Interlayered: Alternating layers of differing soil material	Disrupted: Soil that is broken and mixed
Pocket: Erratic, discontinuous deposit of limited extent	Scattered: Less than one per foot
Homogeneous: Soil with uniform color and composition throughout	Numerous: More than one per foot
	BCN: Angle between bedding plane and a plane normal to core axis

COMPONENT DEFINITIONS

COMPONENT	SIZE / SIEVE RANGE	COMPONENT	SIZE / SIEVE RANGE
Boulder:	> 12 inches	Sand	
Cobbles:	3 to 12 inches	Coarse Sand:	#4 to #10 sieve (4.5 to 2.0 mm)
Gravel	3 to 3/4 inches	Medium Sand:	#10 to #40 sieve (2.0 to 0.42 mm)
		Fine Sand:	#40 to #200 sieve (0.42 to 0.074 mm)
Coarse Gravel:	3 to 3/4 inches	Silt	0.074 to 0.002 mm
Fine Gravel:	3/4 inches to #4 sieve	Clay	<0.002 mm


MONITORING WELL

- Groundwater Level at time of drilling (ATD)
- Static Groundwater Level
- Cement / Concrete Seal
- Bentonite grout / seal
- Silica sand backfill
- Slotted tip
- Slough
- Bottom of Boring

MOISTURE CONTENT


Dry	Dusty, dry to the touch
Moist	Damp but no visible water
Wet	Visible free water

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

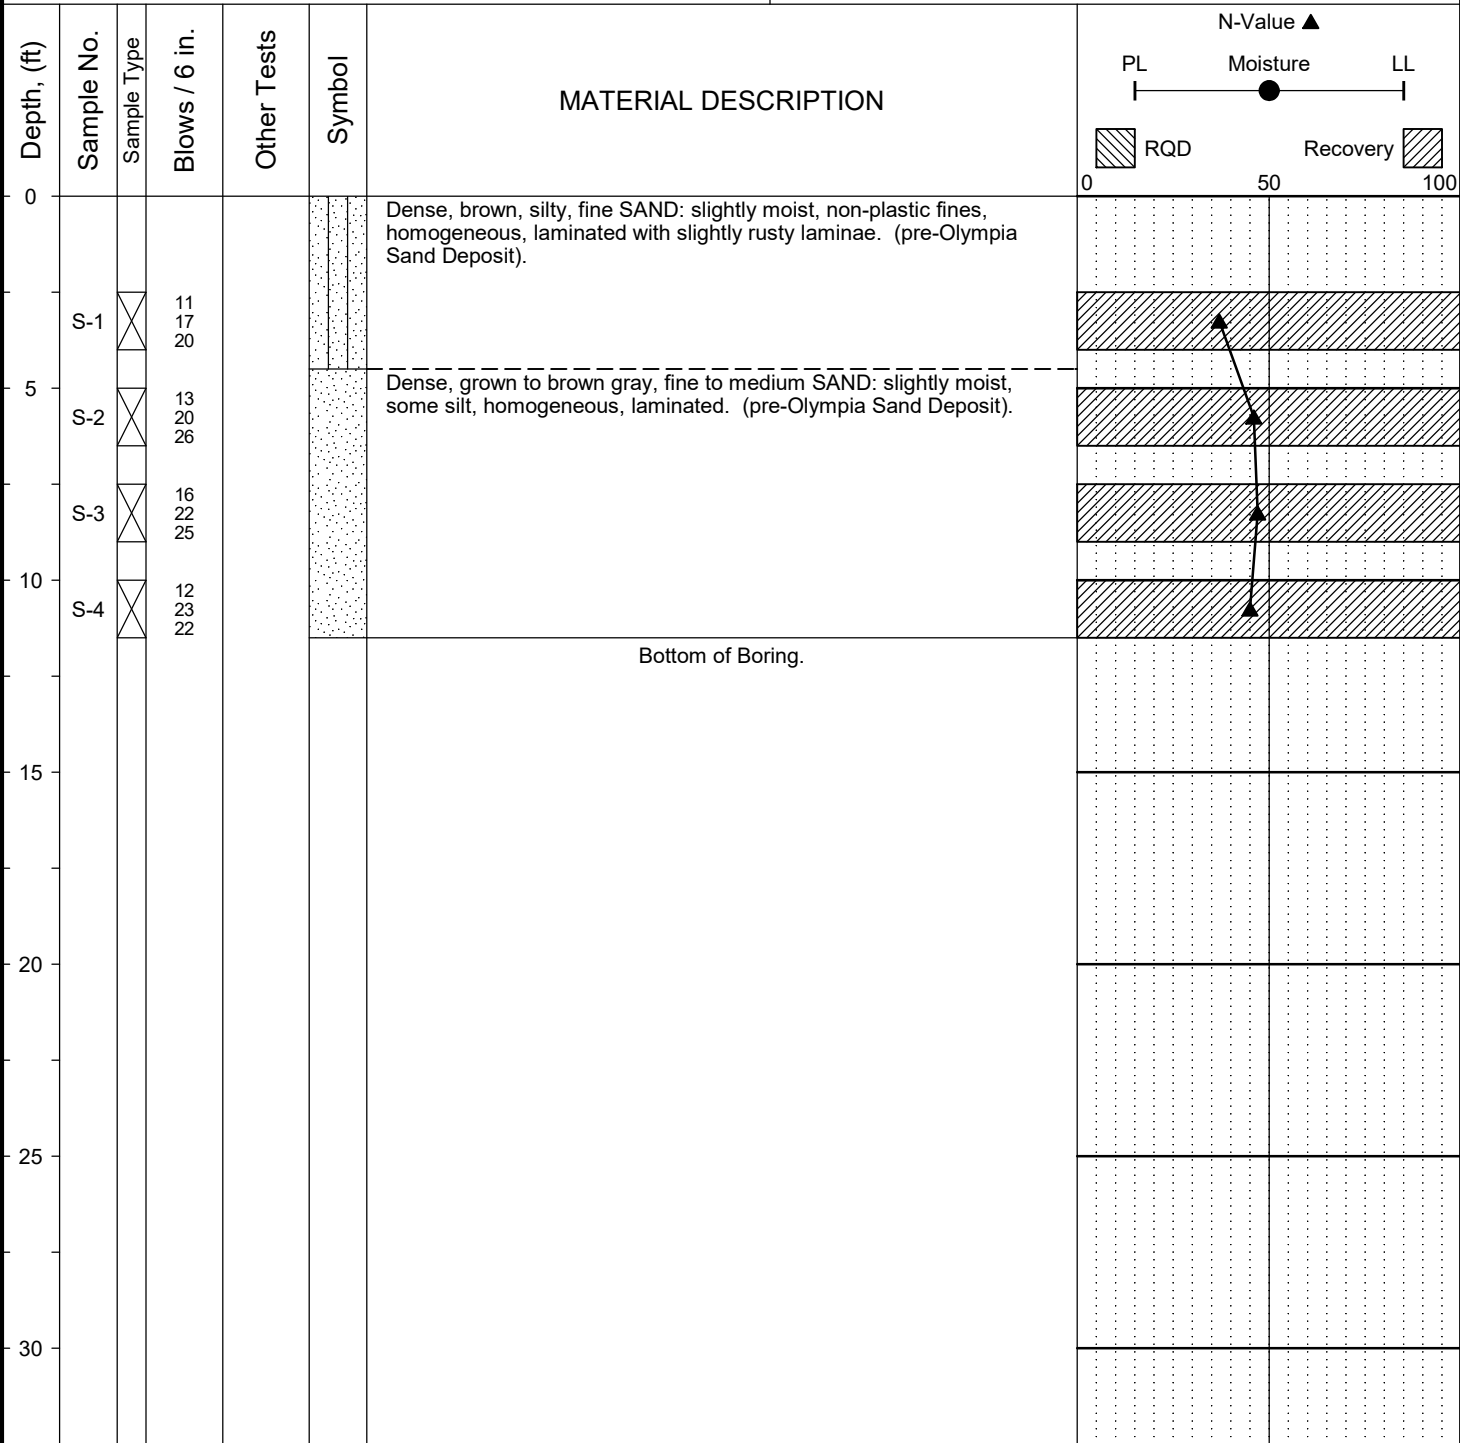


Completion Depth: 11.5ft Date Borehole Started: 3/7/19 Date Borehole Completed: 3/7/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: No groundwater encountered during drilling.
---	--

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

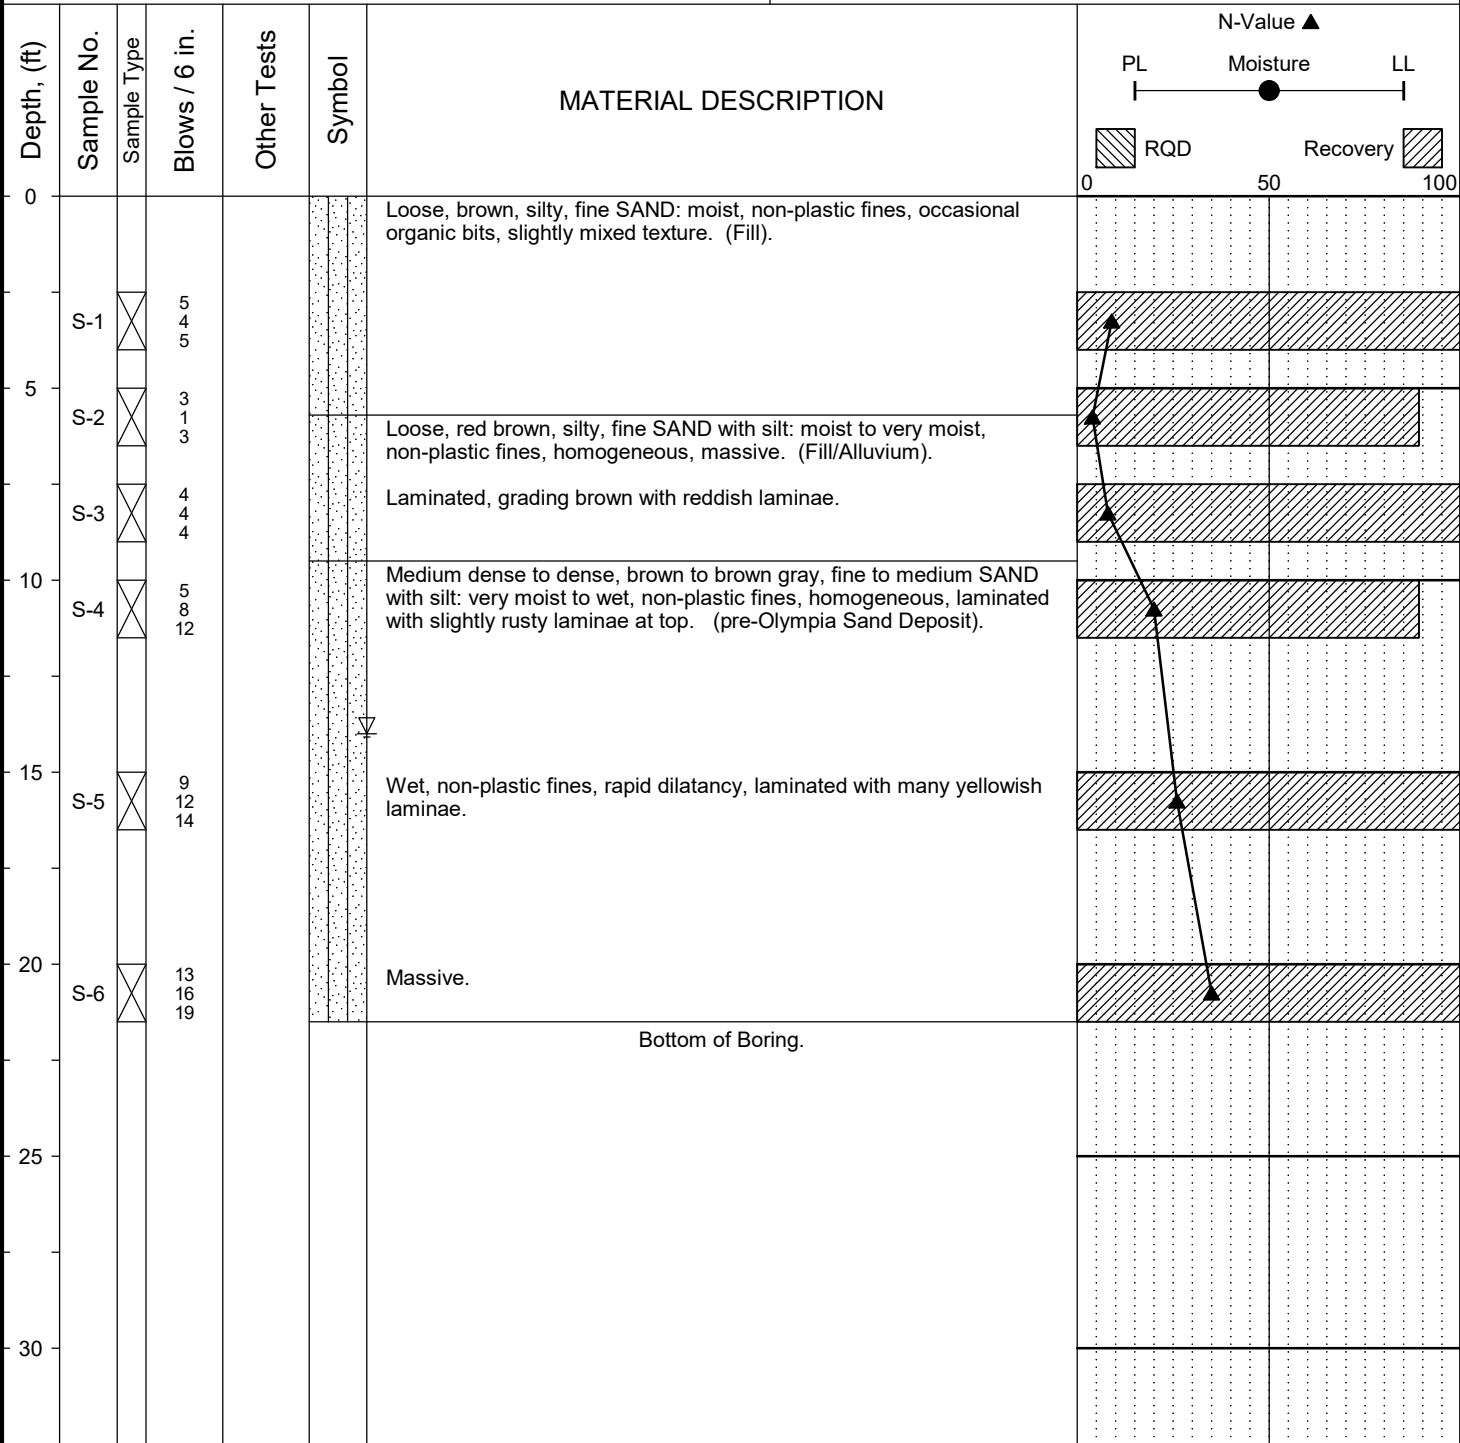


Completion Depth: 21.5ft Date Borehole Started: 3/7/19 Date Borehole Completed: 3/7/19 Logged By: S. Evans Drilling Company: Boretect, Inc	Remarks: Groundwater level estimated based on wetness of soil sample and water on the sampling rods.
--	--

Project:	Proposed Lot Development	Surface Elevation:	
Job Number:	19-062	Top of Casing Elev.:	
Location:	6423 East Mercer Way, Mercer Island, WA	Drilling Method:	HSA
Coordinates:	Northing: , Easting:	Sampling Method:	SPT

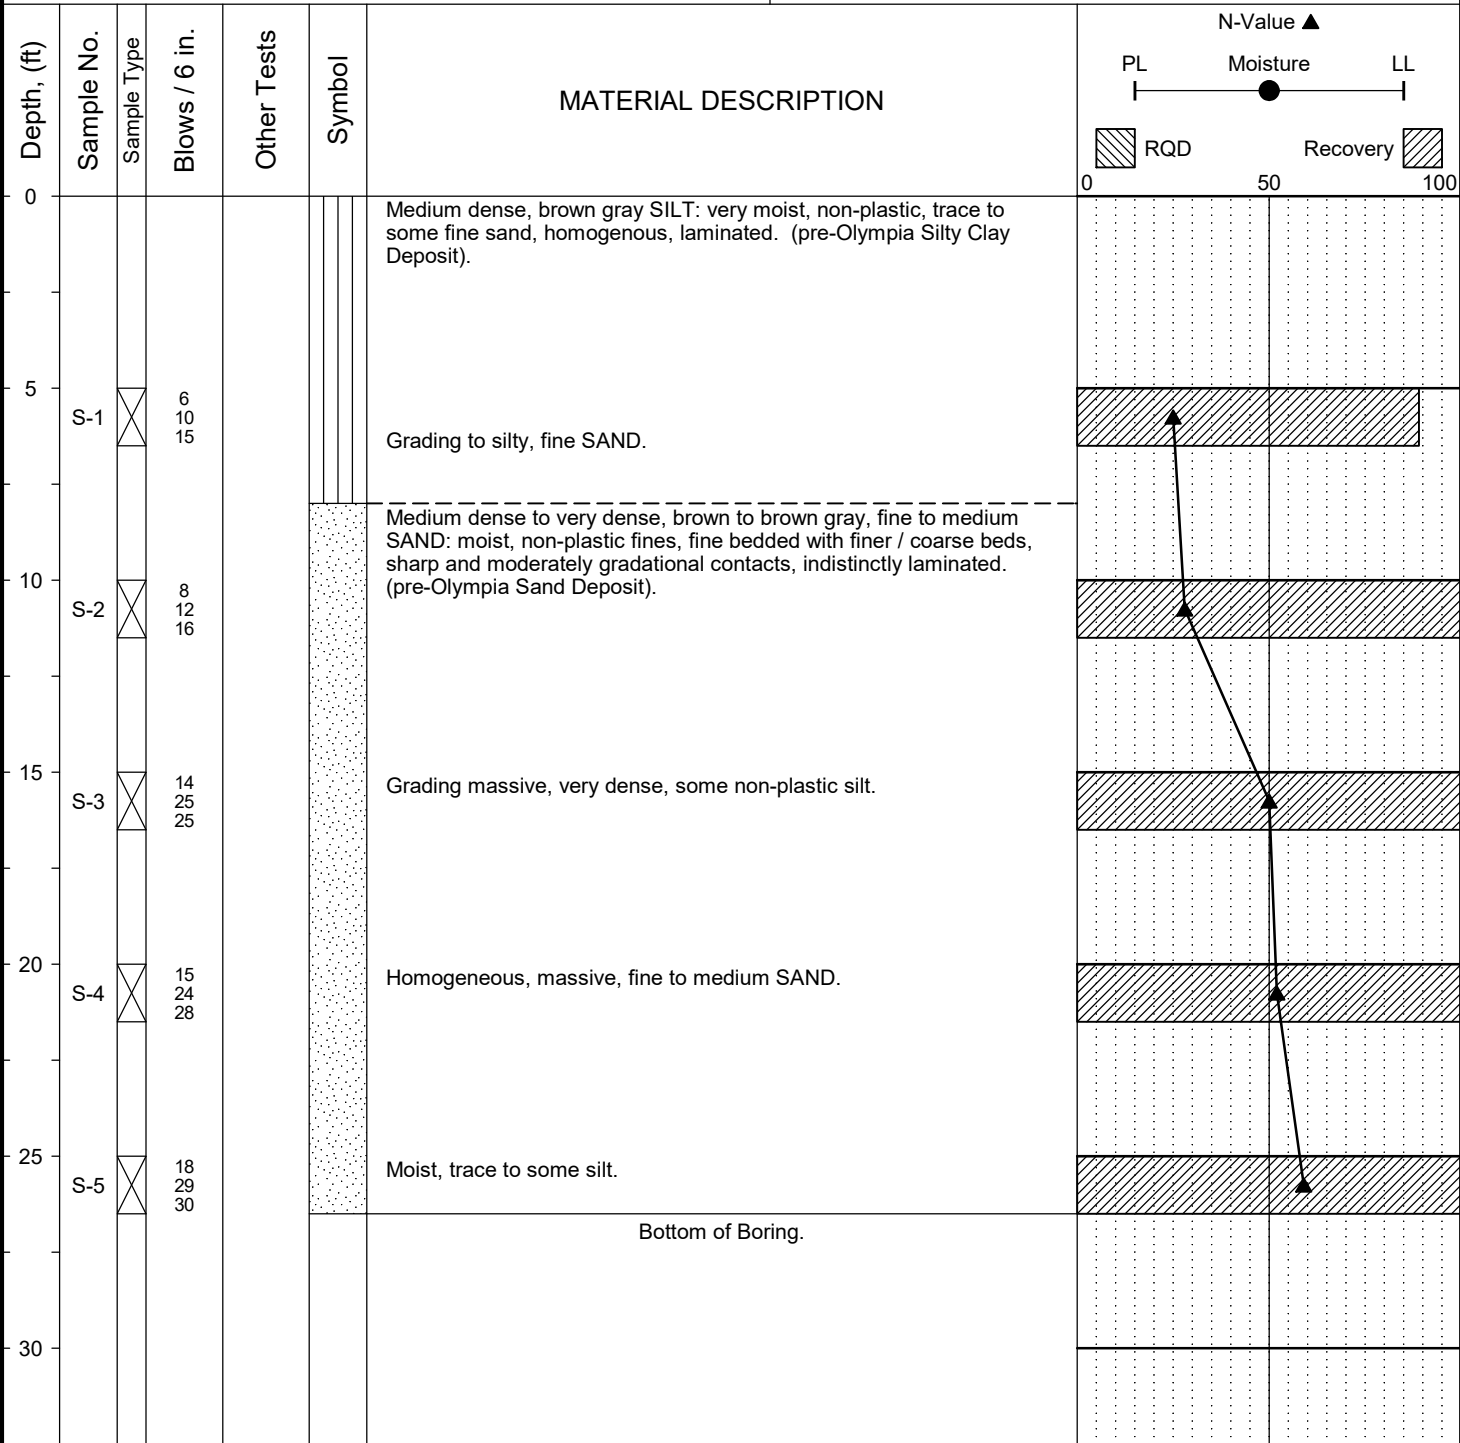


Completion Depth:	26.5ft	Remarks: No groundwater encountered during drilling.
Date Borehole Started:	3/7/19	
Date Borehole Completed:	3/7/19	
Logged By:	S. Evans	
Drilling Company:	Boretac, Inc	

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

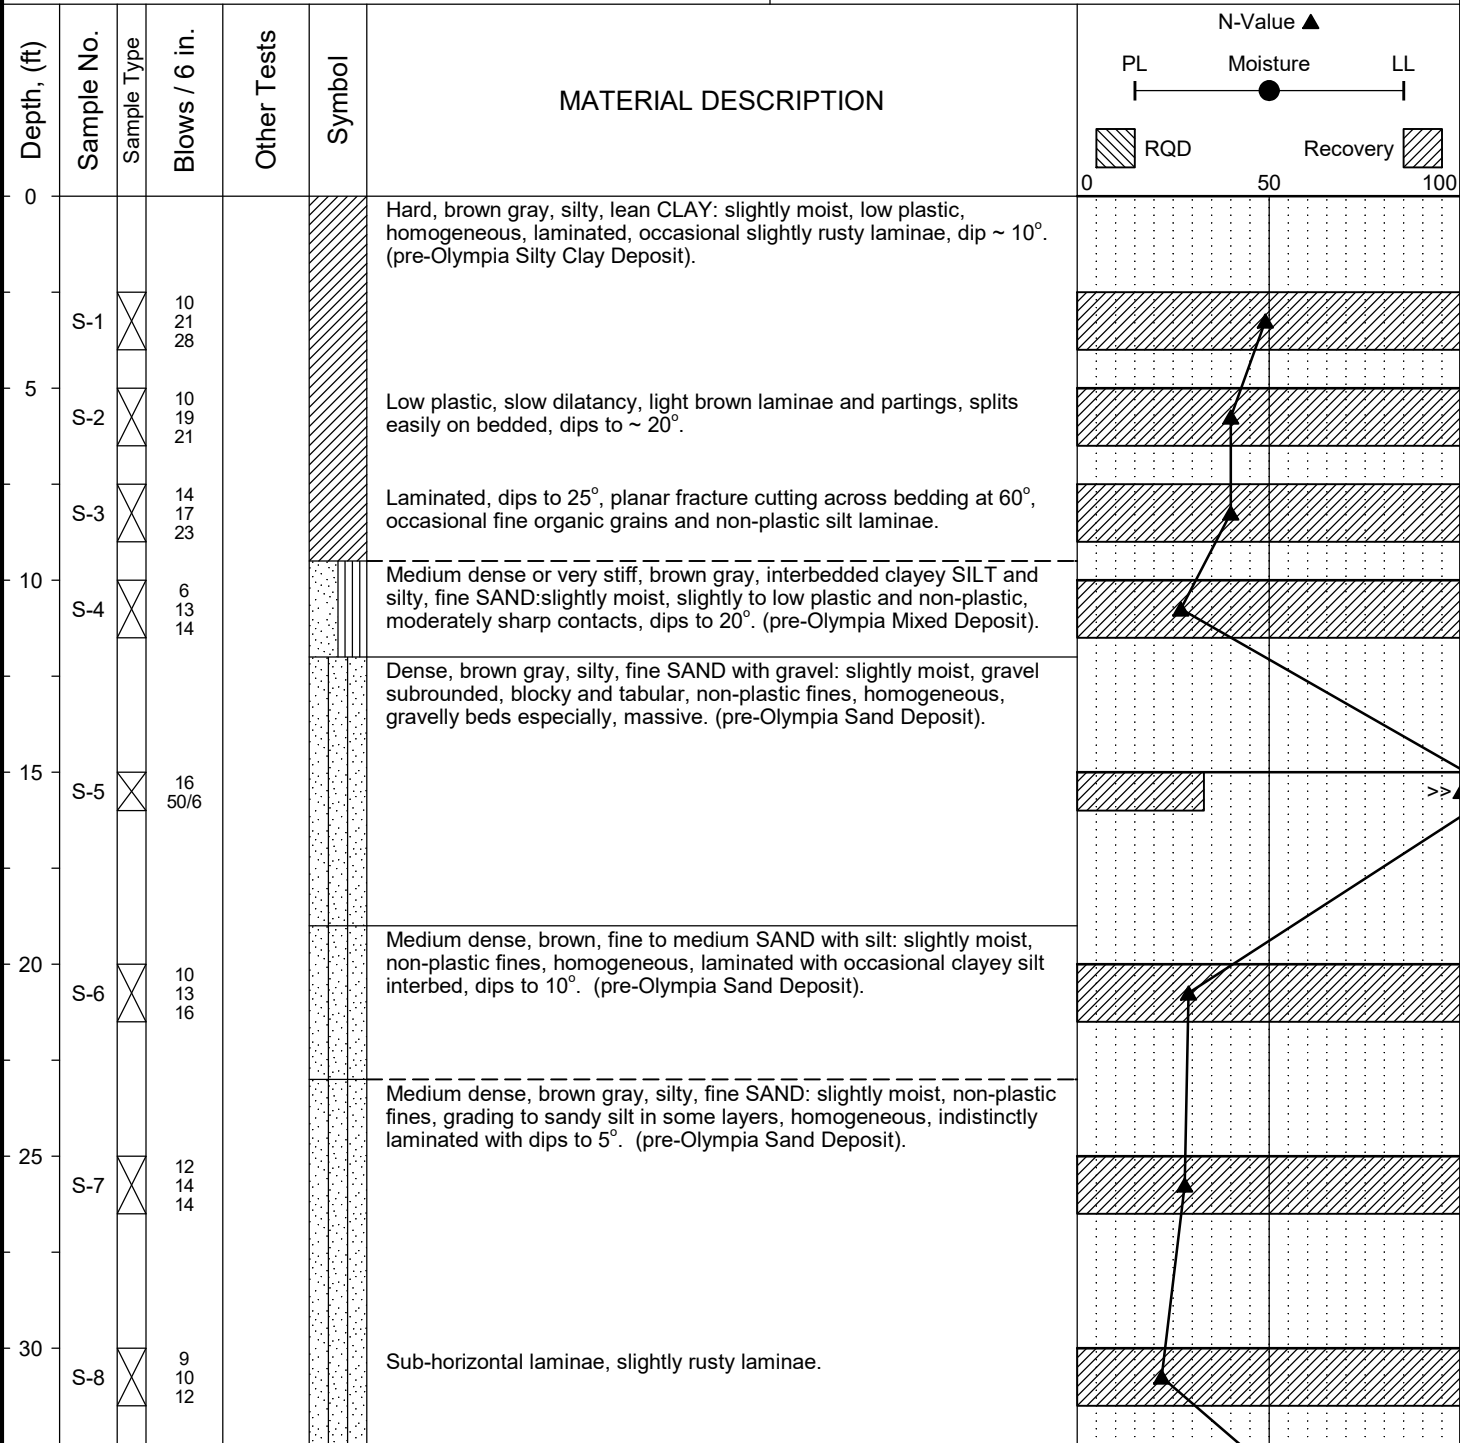


Completion Depth: 41.5ft Date Borehole Started: 3/7/19 Date Borehole Completed: 3/7/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: No groundwater encountered during drilling.
---	--

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

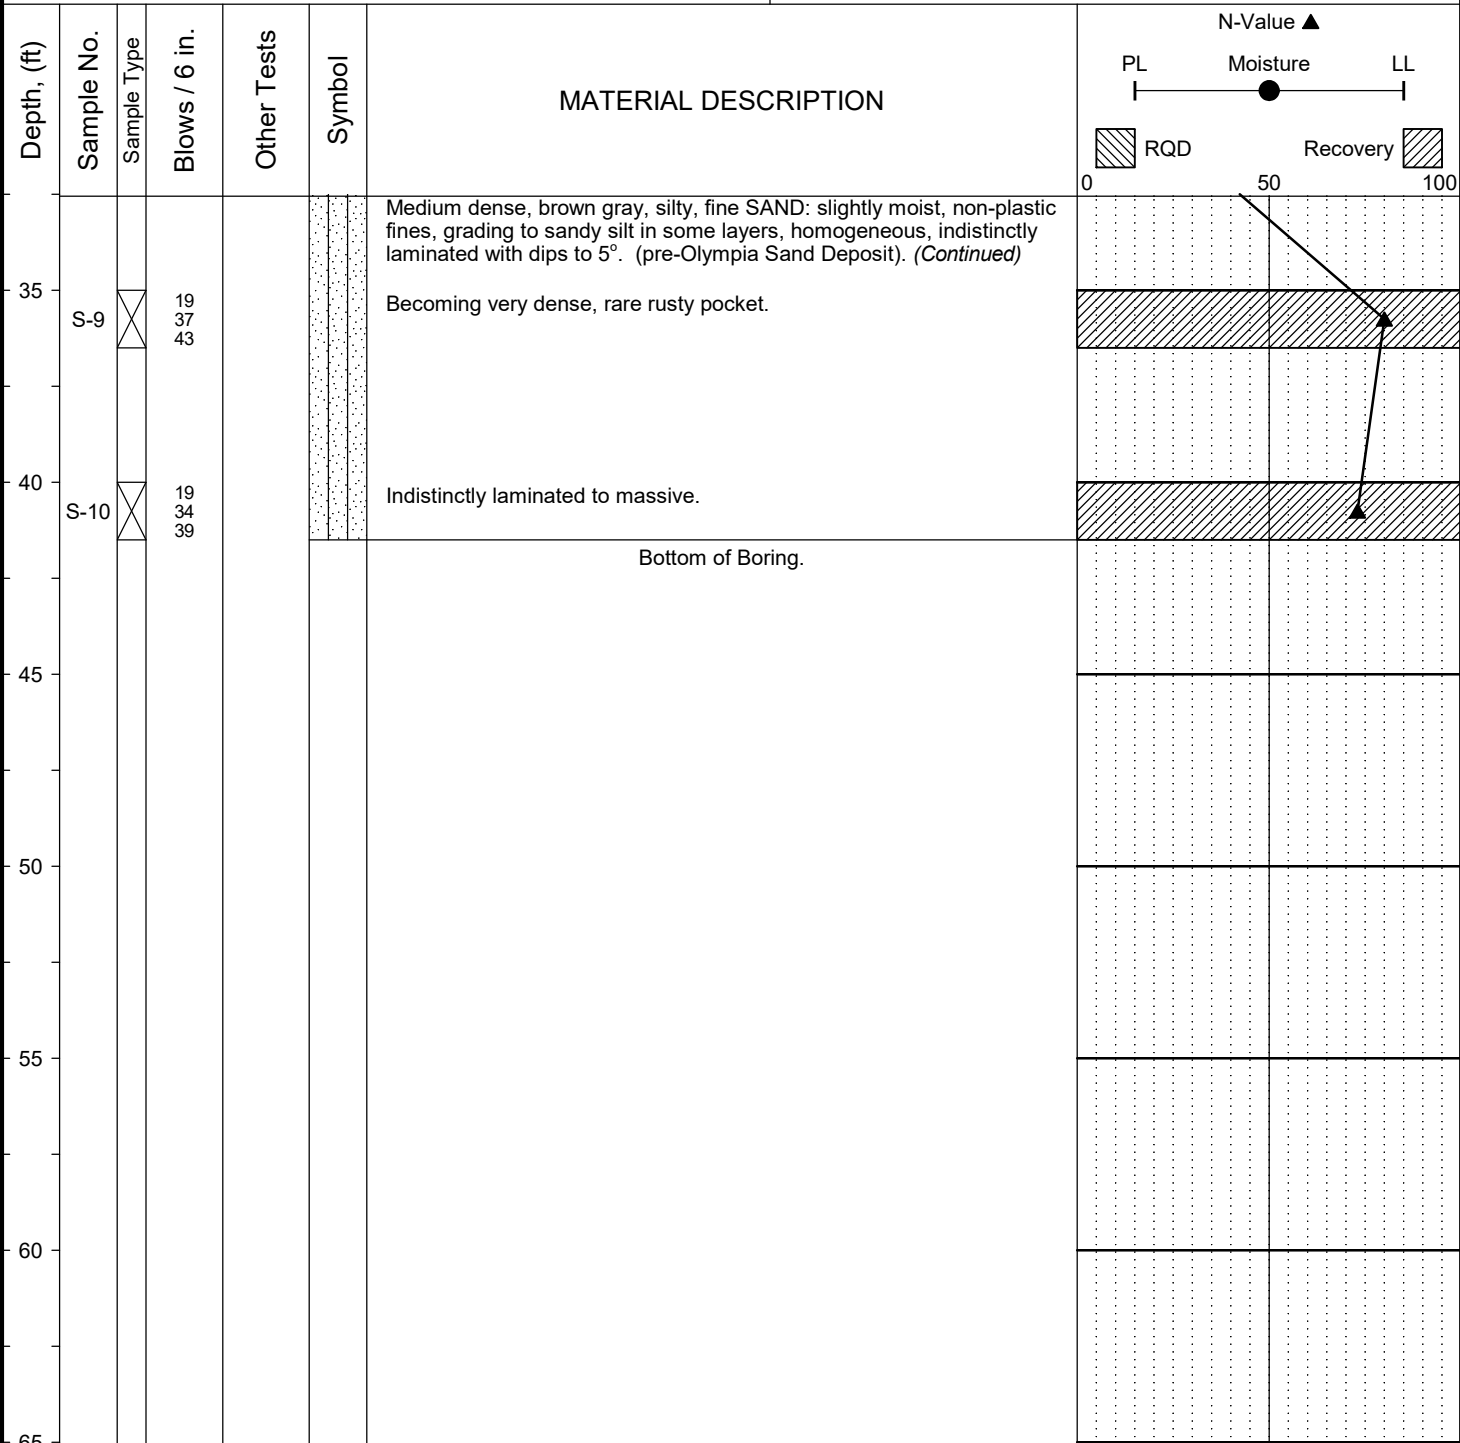


Completion Depth: 41.5ft Date Borehole Started: 3/7/19 Date Borehole Completed: 3/7/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: No groundwater encountered during drilling.
---	--

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

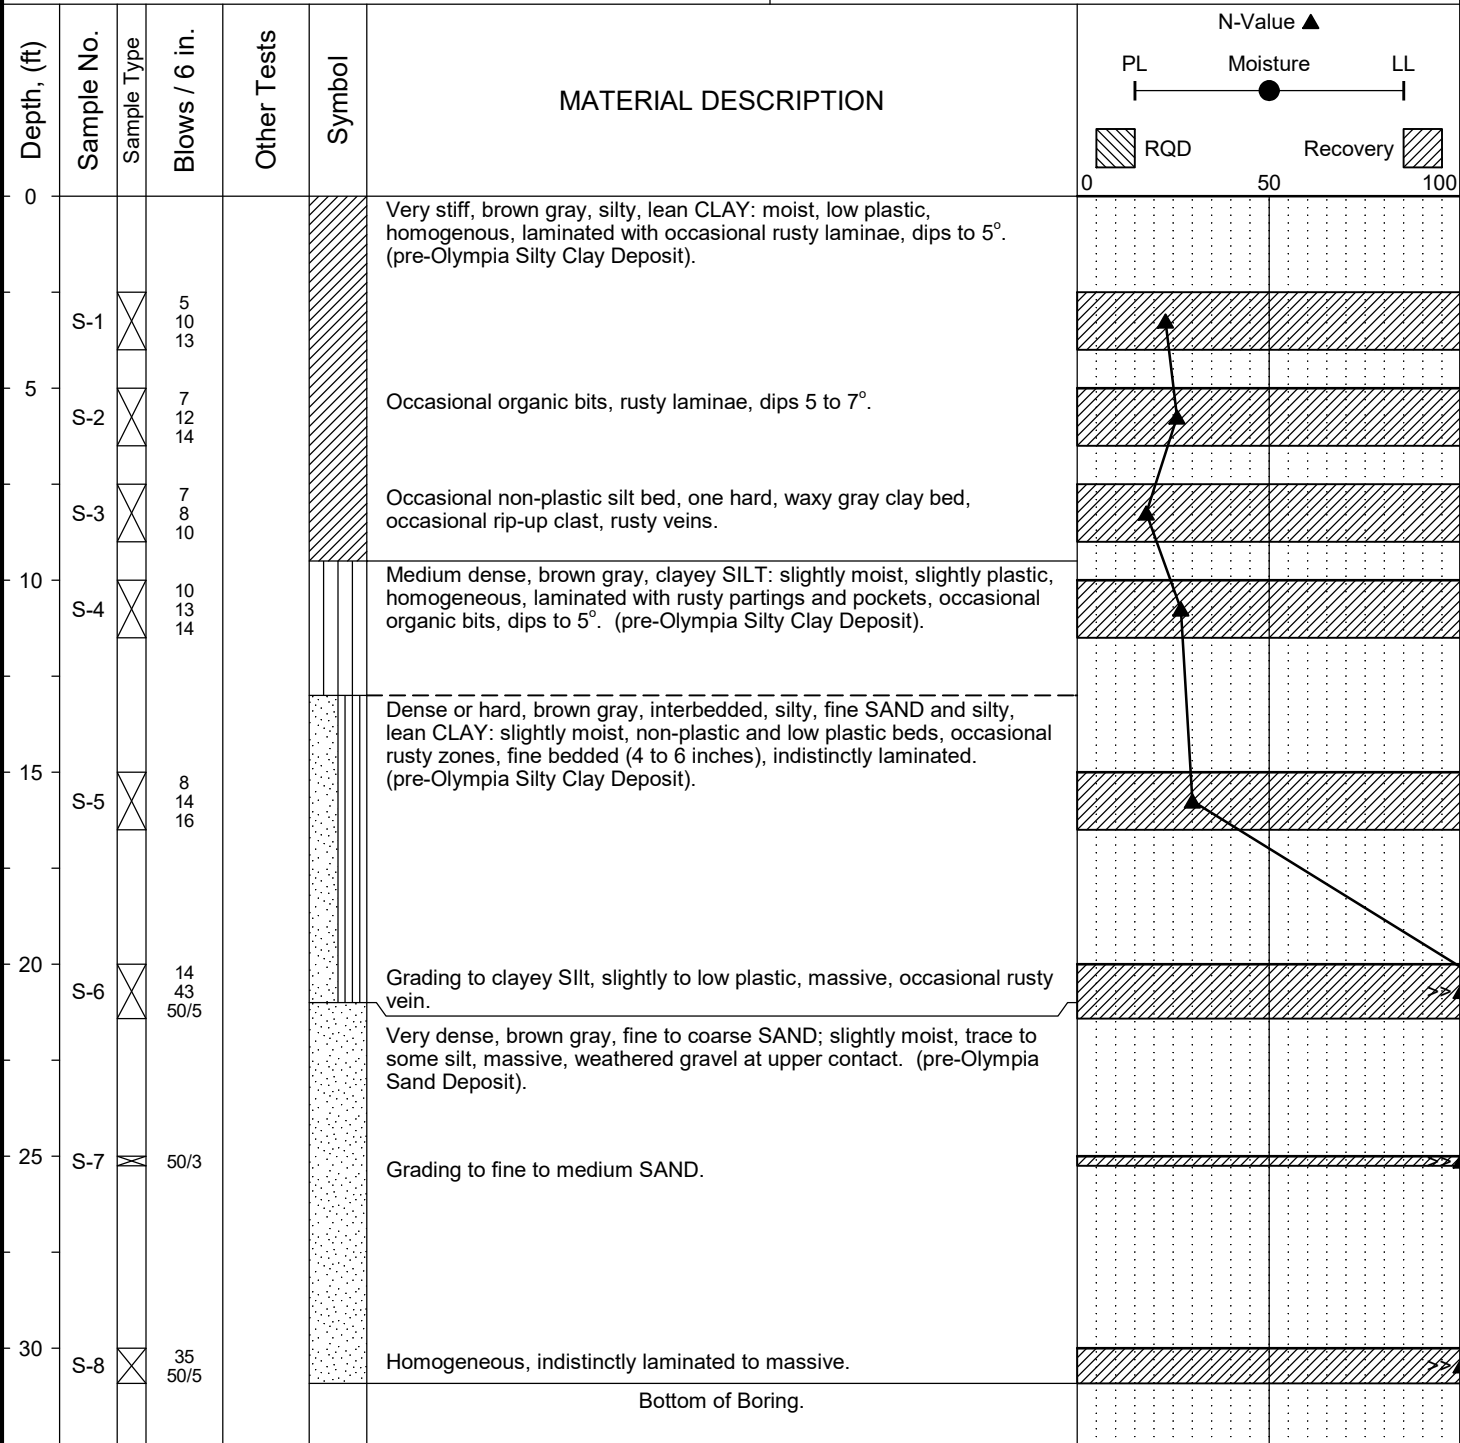


Completion Depth: 30.9ft Date Borehole Started: 3/7/19 Date Borehole Completed: 3/7/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: No groundwater encountered during drilling.
---	--

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

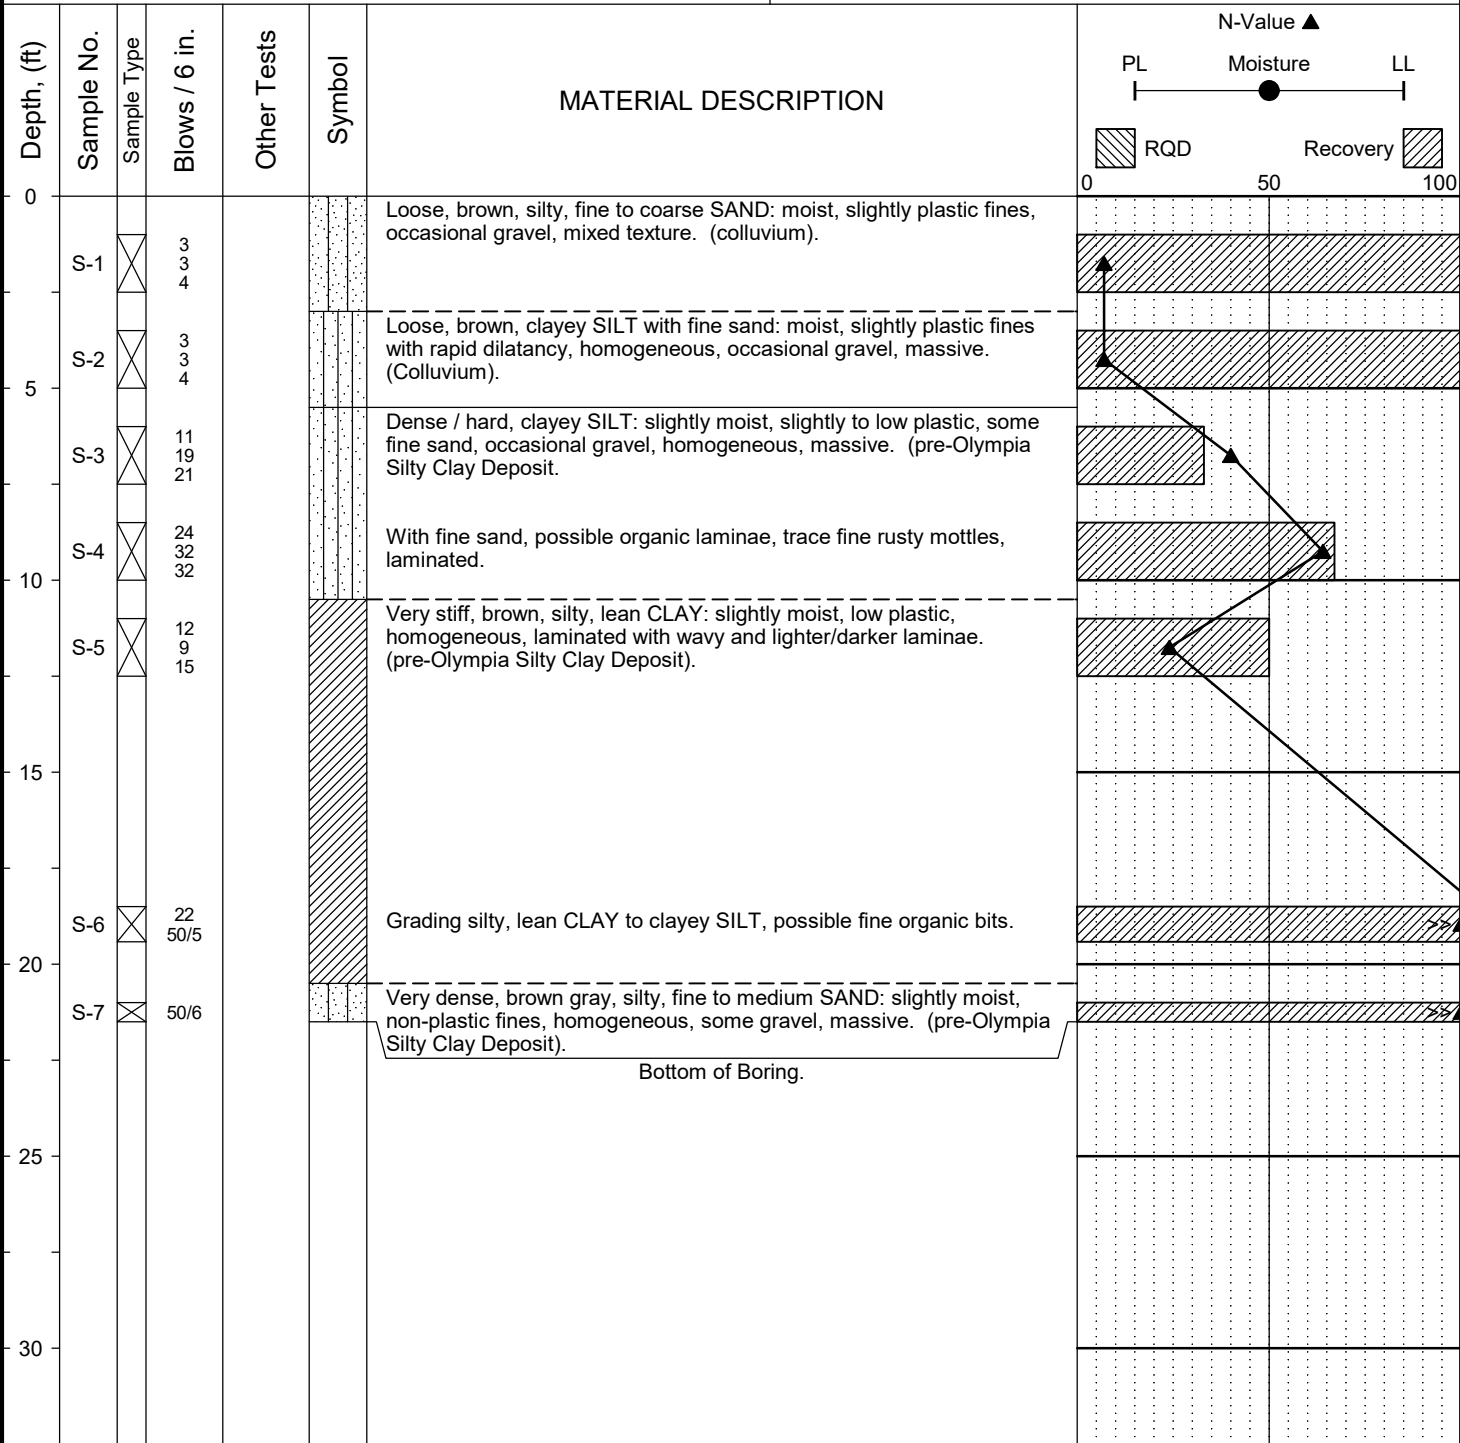


Completion Depth: 21.5ft Date Borehole Started: 3/19/19 Date Borehole Completed: 3/21/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: No groundwater encountered during drilling.
---	--

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

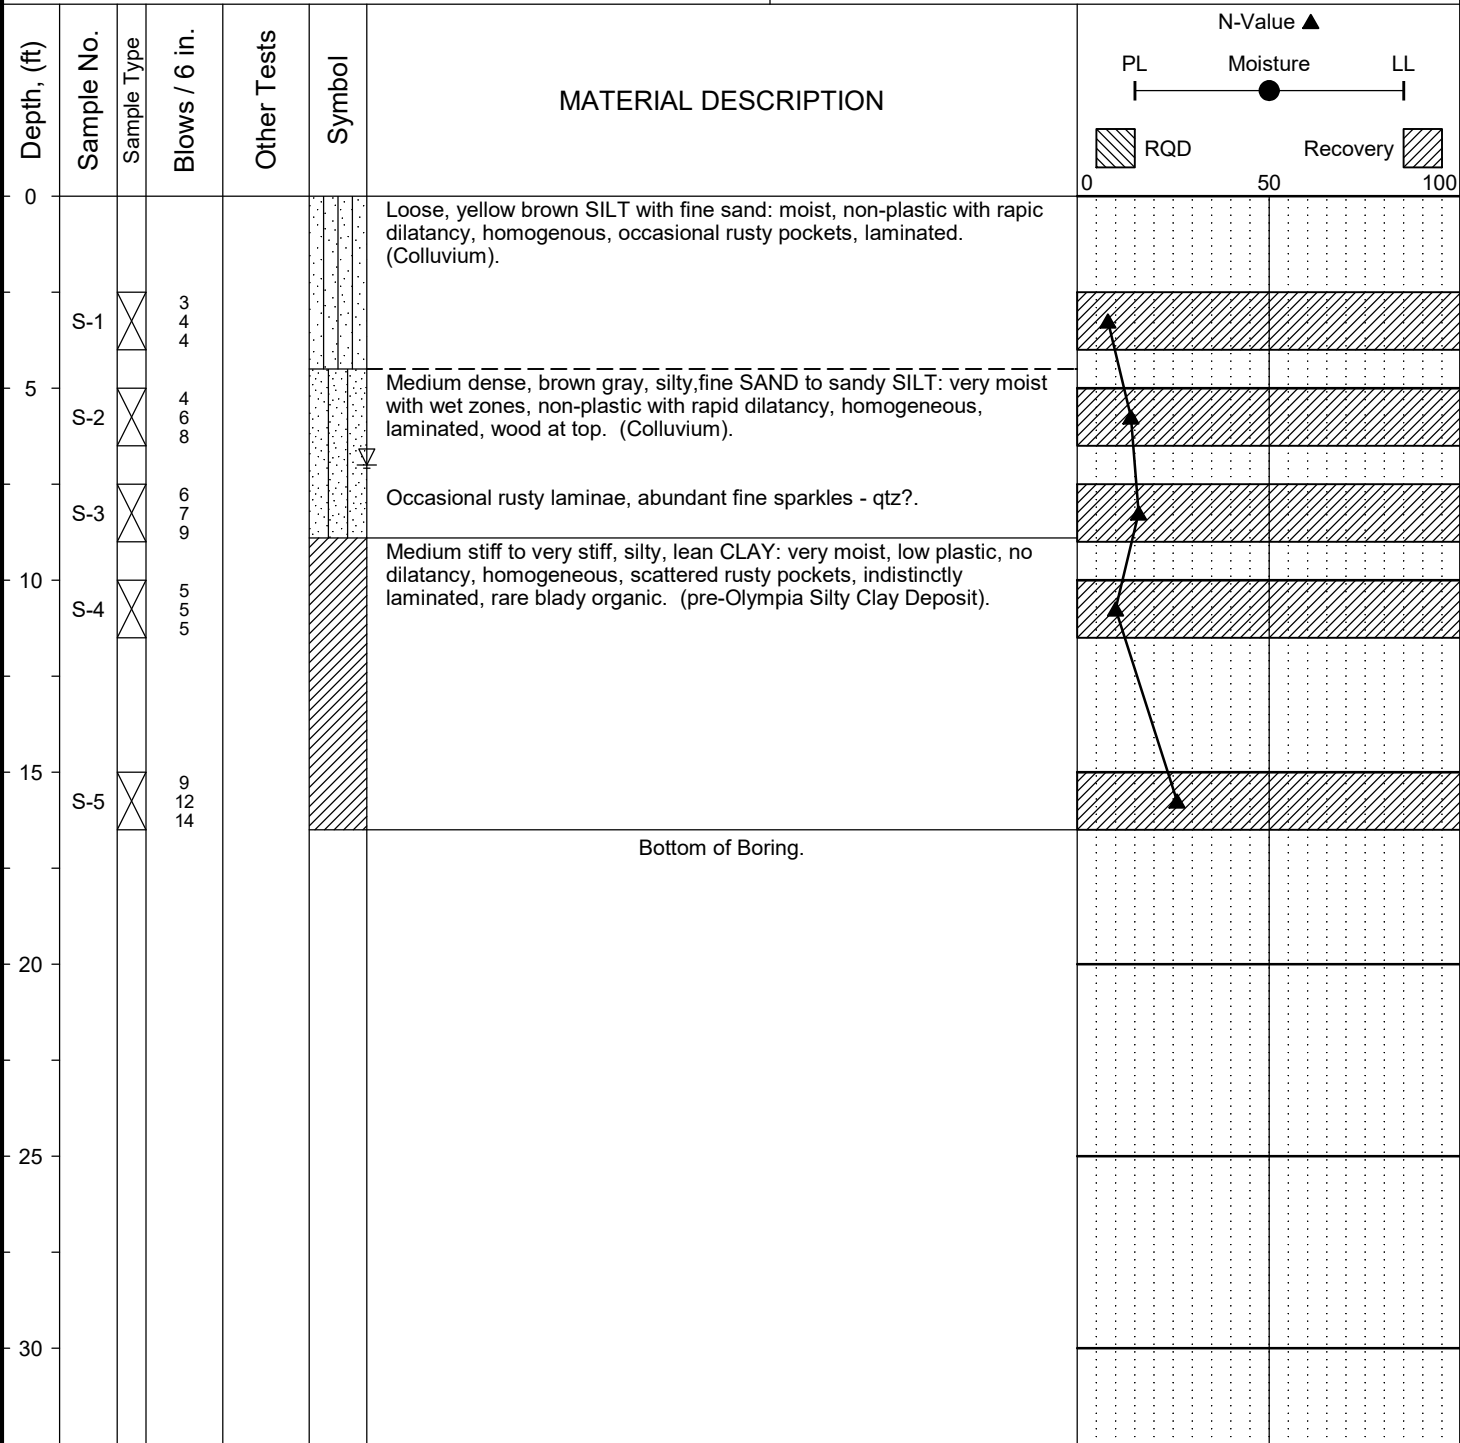



Completion Depth: 16.5ft Date Borehole Started: 3/21/19 Date Borehole Completed: 3/21/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: Groundwater level estimated based on wetness of soil sample and water on the sampling rods.
---	--

Project: Proposed Lot Development Job Number: 19-062 Location: 6423 East Mercer Way, Mercer Island, WA Coordinates: Northing: , Easting:	Surface Elevation: Top of Casing Elev.: Drilling Method: HSA Sampling Method: SPT
---	--

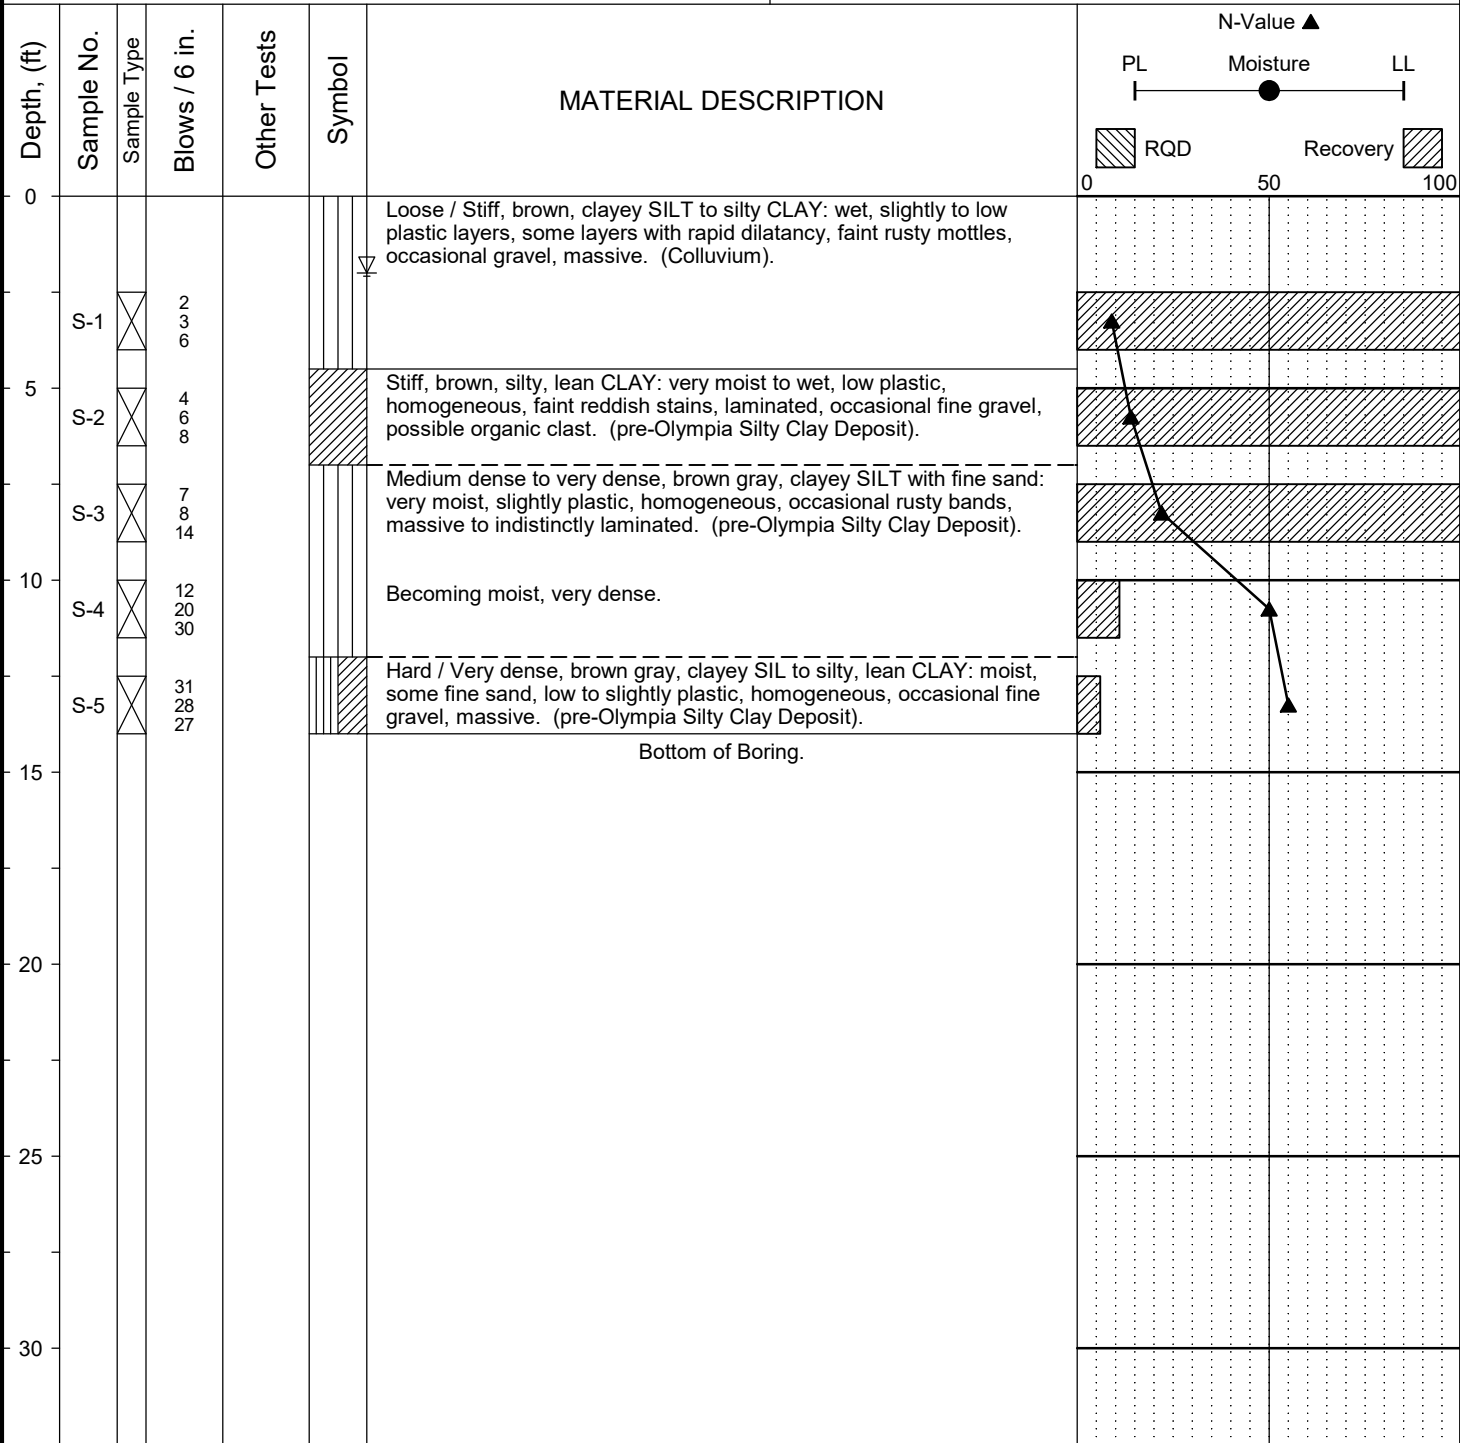

Completion Depth: 14.0ft Date Borehole Started: 3/21/19 Date Borehole Completed: 3/21/19 Logged By: S. Evans Drilling Company: Boretac, Inc	Remarks: Groundwater level estimated based on wetness of soil sample and water on the sampling rods.
---	--

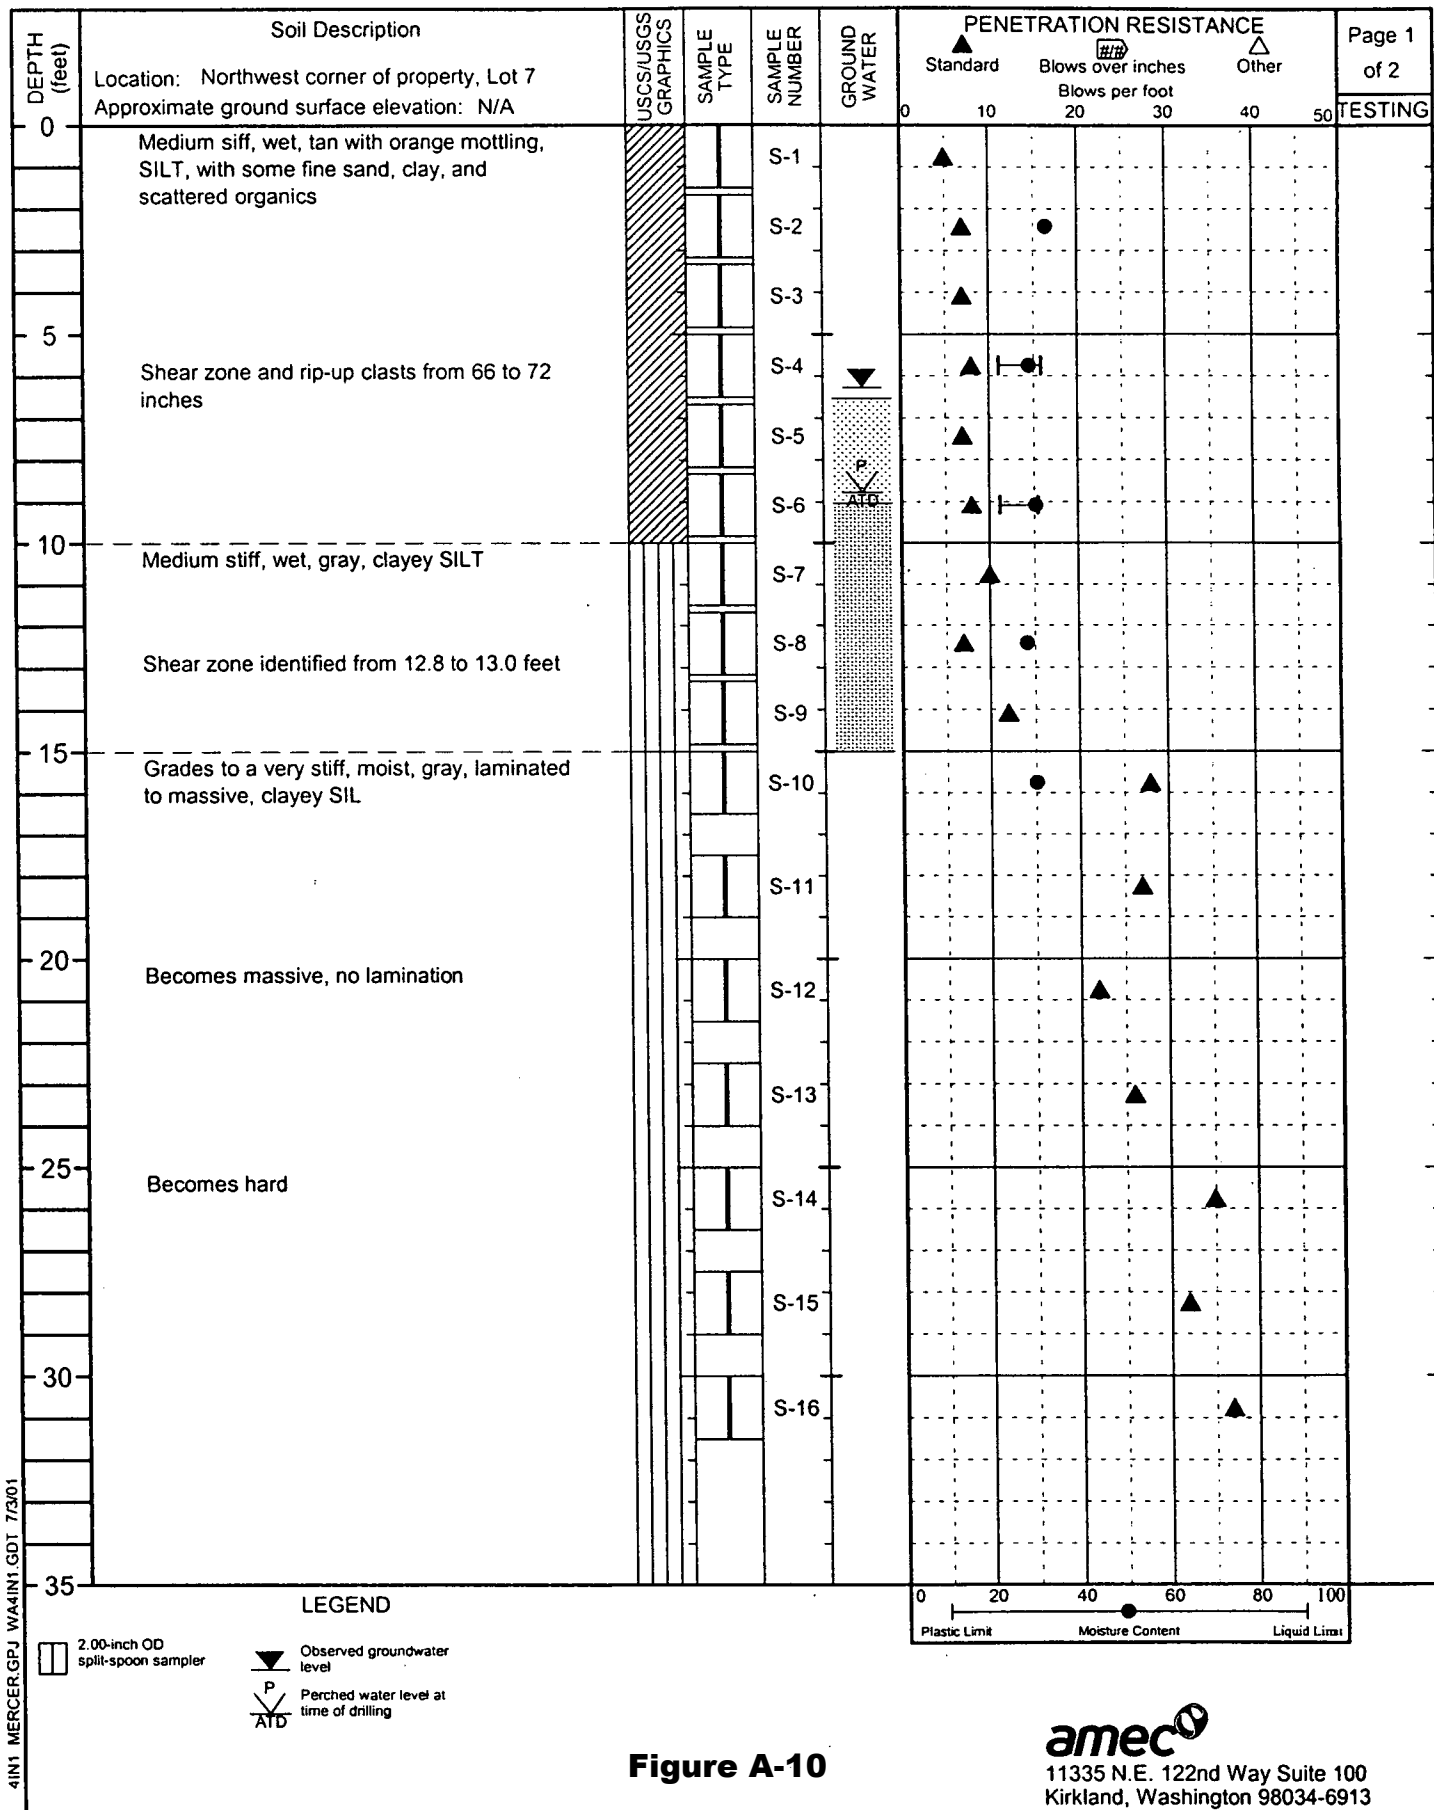

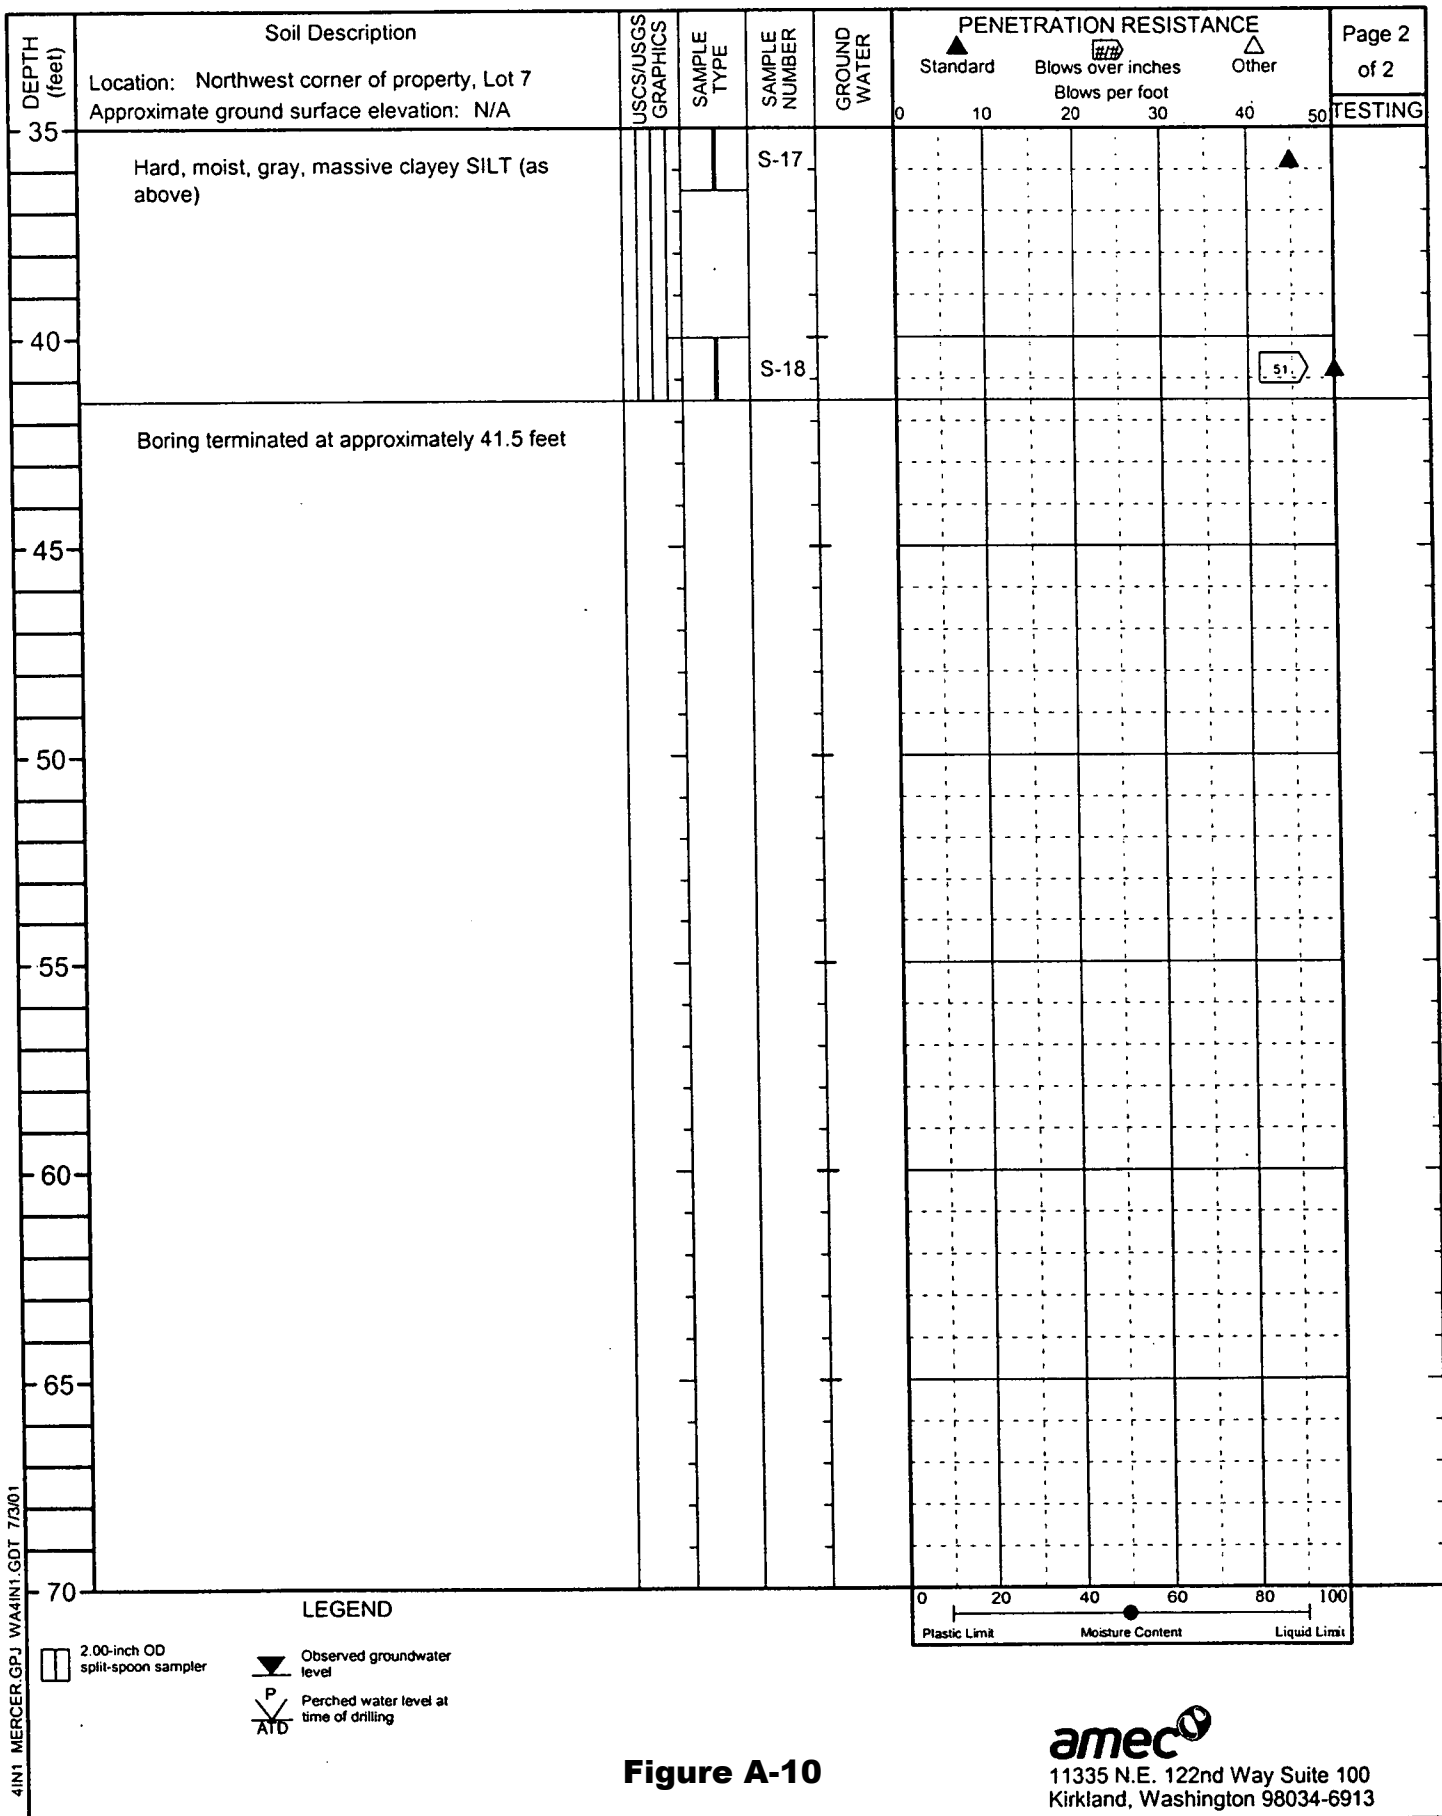

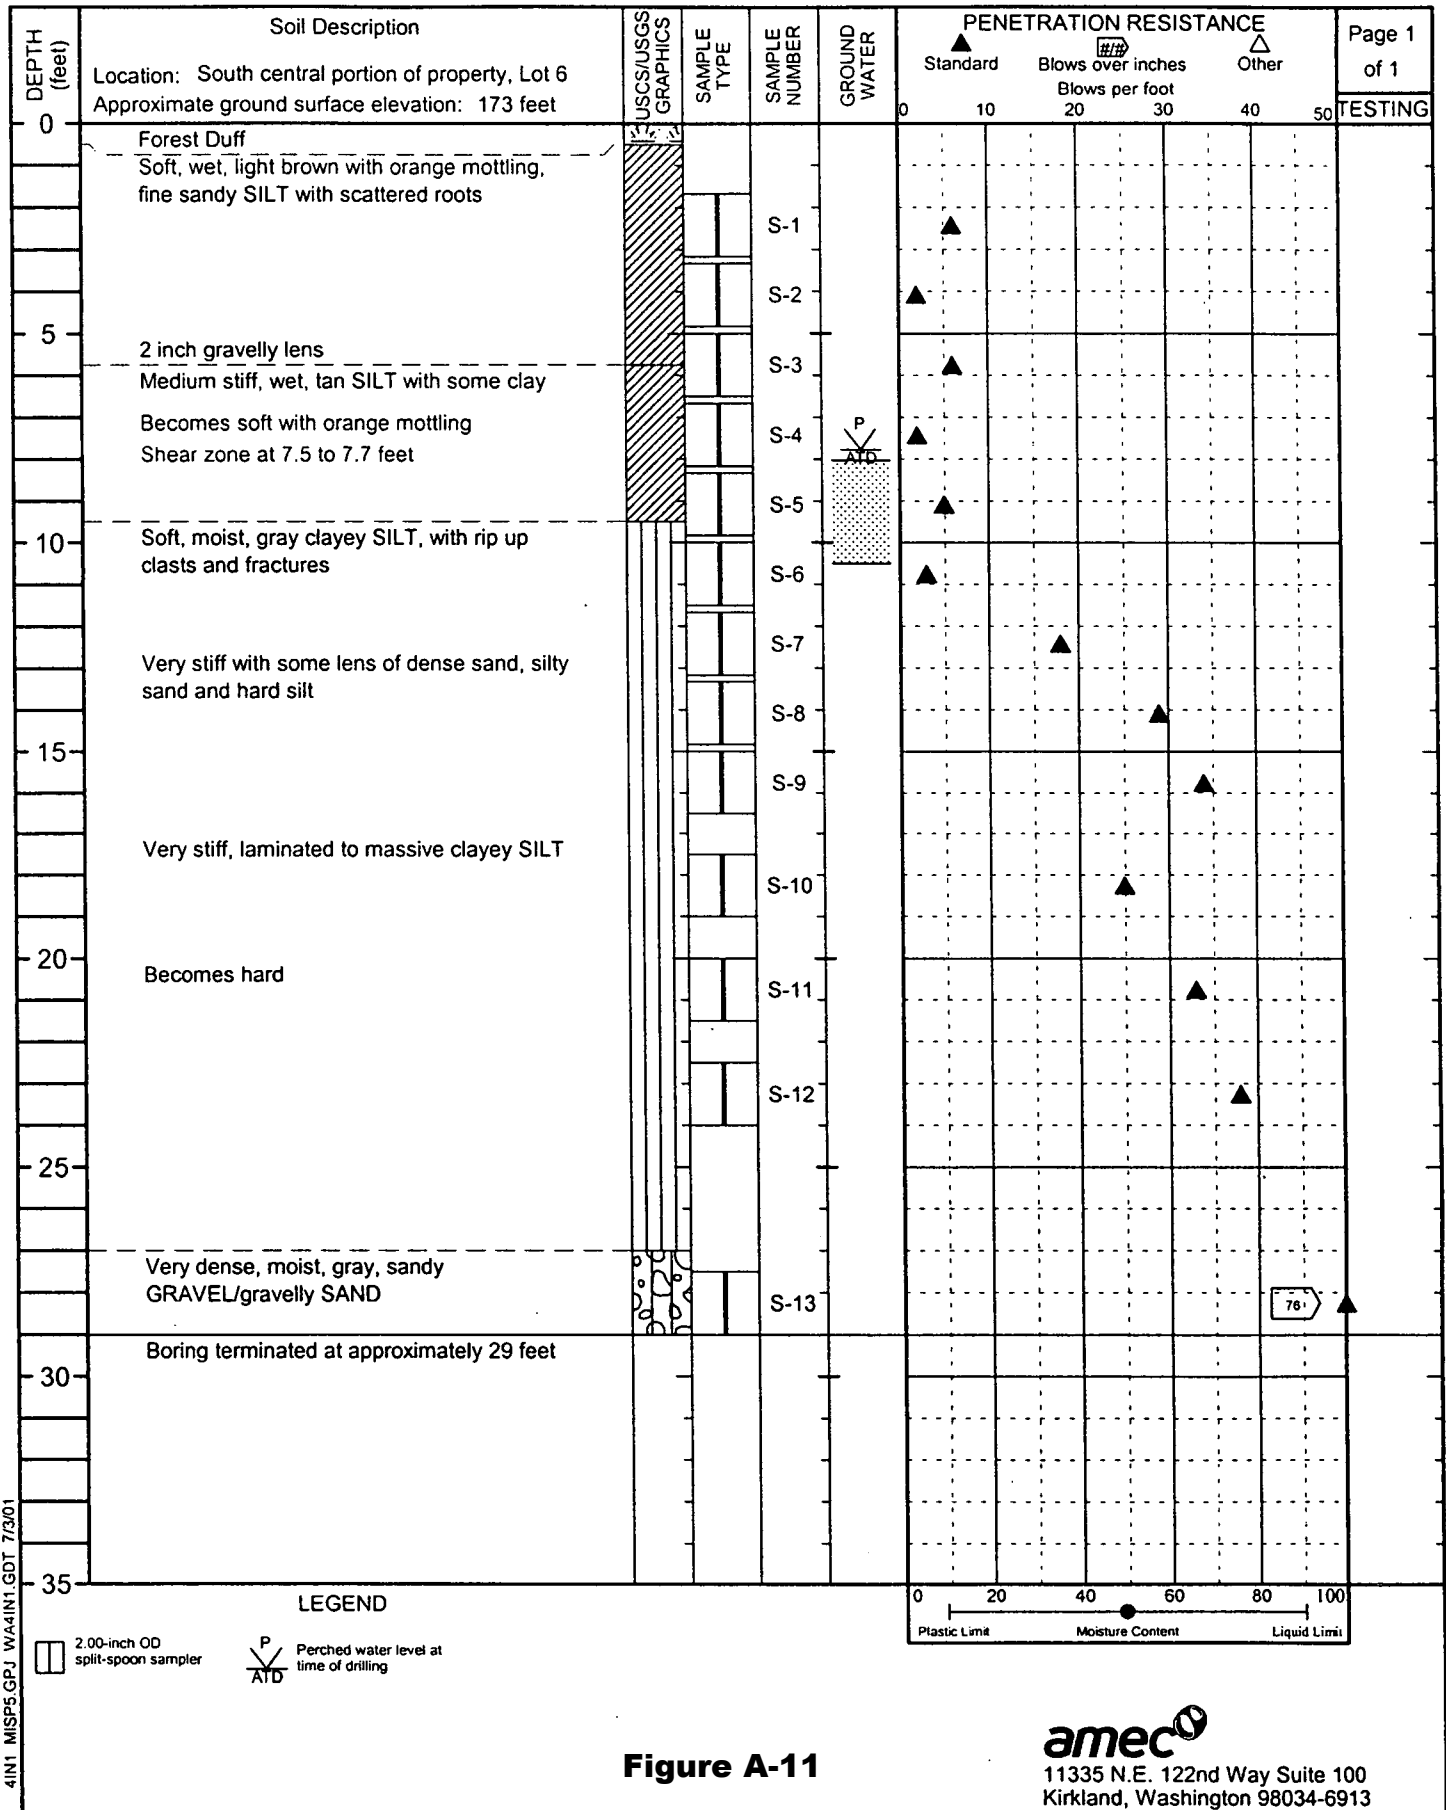


Figure A-11

amec
 11335 N.E. 122nd Way Suite 100
 Kirkland, Washington 98034-6913

4IN1 MISPE.GPJ WA4IN1.GDT 7/3/01