

ABBREVIATIONS:

ABV ABOVE
AFF ABOVE FINISHED FLOOR
BLW BELOW
BOT BOTTOM
BOW BOTTOM OF WALL
CAB CABINET
CL CENTERLINE
CONC CONCRETE
CONT CONTINUOUS
CP CENTERPOINT
DET DETAIL
DIM DIMENSION
DR DOOR
DS DOWNSPOUT
D/W DISHWASHER
EA EACH
EK EXISTING
EXT EXTERIOR
FOC FACE OF CONCRETE
FOW FACE OF WALL
FN GRDE FINISHED GRADE
FNDN FOUNDATION
FLR FLOOR
FR FIREPLACE
GA GAUGE
GWB GYPSUM WALL BOARD
HB HOSE BIBB
HGT HEIGHT
INFO INFORMATION
INSUL INSULATION
INT INTERIOR
LV LOW VOLTAGE
MTL METAL
MFR MANUFACTURER
N/A NOT APPLICABLE
NIC NOT IN CONTRACT
NFC NOT FOR CONSTRUCTION
OC ON CENTER
PL PROPERTY LINE
RAD RADIUS
RE REFER TO
SIM SIMILAR
TBD TO BE DETERMINED
TG TEMPERED GLASS
T&G TONGUE & GROOVE
TOW TOP OF WALL
TYP TYPICAL
UNO UNLESS NOTED OTHERWISE
VFI VERIFY IN FIELD
WD WOOD
WDW WINDOW

DUTY OF COOPERATION:


RELEASE + ACCEPTANCE OF THESE DOCUMENTS INDICATES COOPERATION AMONG THE OWNER, THE CONTRACTOR, + JEFFREY ALMETER. ANY ERRORS, OMISSIONS, OR DISCREPANCIES DISCOVERED BY THE USE OF THESE DOCUMENTS SHALL BE REPORTED IMMEDIATELY TO JEFFREY ALMETER. FAILURE TO DO SO SHALL RELIEVE JEFFREY ALMETER FROM ANY RESPONSIBILITY OF THE CONSEQUENCES.

ANY DEVIATIONS FROM THESE DOCUMENTS WITHOUT THE CONSENT OF JEFFREY ALMETER IS UNAUTHORIZED. FAILURE TO OBSERVE THESE PROCEDURES SHALL RELIEVE JEFFREY ALMETER OF RESPONSIBILITY FOR ALL CONSEQUENCES ARISING OUT OF SUCH ACTIONS.

NOTE: NATIVE PLANTING OPTIONS LISTED BELOW ARE FROM A LIST GENERATED BY PROTECT MERCER ISLAND PARKS' WEBSITE. CONSULTATION FOR BEST SPECIES AT THIS LOCATION AND INSTALLATION OF ALL NATIVE PLANTINGS SHALL BE BY A LOCAL LANDSCAPE INSTALLER.

- Baldhip rose
Beaked hazelnut/Filbert
Big leaf maple
Birch
Black cottonwood
Bracken fern
Douglas Or
False Solomon's seal
Grand Or
Horsetail
Indian plum
Large-leaved avens
Low Oregon grape
Nootka rose
Orange trumpet honeysuckle
Oregon ash
Red alder
Red towering currant
Red twig dogwood
Rush
Salal
Salmonberry
Shore pine
Siberian miner's lettuce
Snowberry
Sword fern
Tall Oregon grape
Thimbleberry
Trailing blackberry
Trillium
Vine maple
Western red cedar
Willow


PLAN LEGEND:

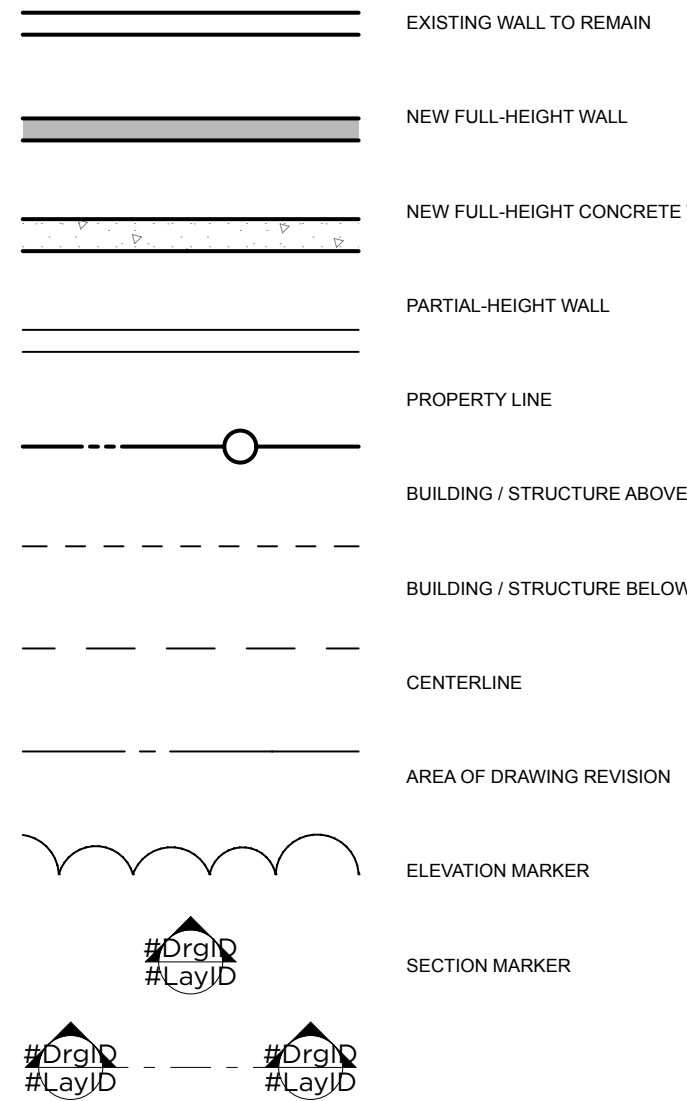

GENERAL NOTES:

- 1. DO NOT SCALE DRAWINGS.
2. THIS PROJECT SHALL COMPLY WITH ALL GOVERNING REGULATIONS, ORDINANCES, BUILDING CODES, OR COVENANTS OF THE AREA IN WHICH IT IS BUILT.
3. APPROVAL BY AN INSPECTOR DOES NOT CONSTITUTE AUTHORITY TO DEVIATE FROM THE DRAWINGS OR SPECIFICATIONS.
4. THE CONTRACTOR SHALL SCHEDULE WALK-THROUGHS AT EACH OF BELOW NOTED INTERVALS.
A. PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
B. PRIOR TO THE COMMENCEMENT OF ALL MECHANICAL + ELECTRICAL WORK.
5. PROVIDE ALL NECESSARY BARRICADES, WARNING SIGNS, + DEVICES TO PROTECT PUBLIC + CONSTRUCTION PERSONNEL DURING CONSTRUCTION.
6. MAINTAIN ALL REQUIRED ACCESS + EGRESS DURING CONSTRUCTION.

MERCER RESIDENCE
6950 SE MAKER ST, MERCER ISLAND, WA 98040

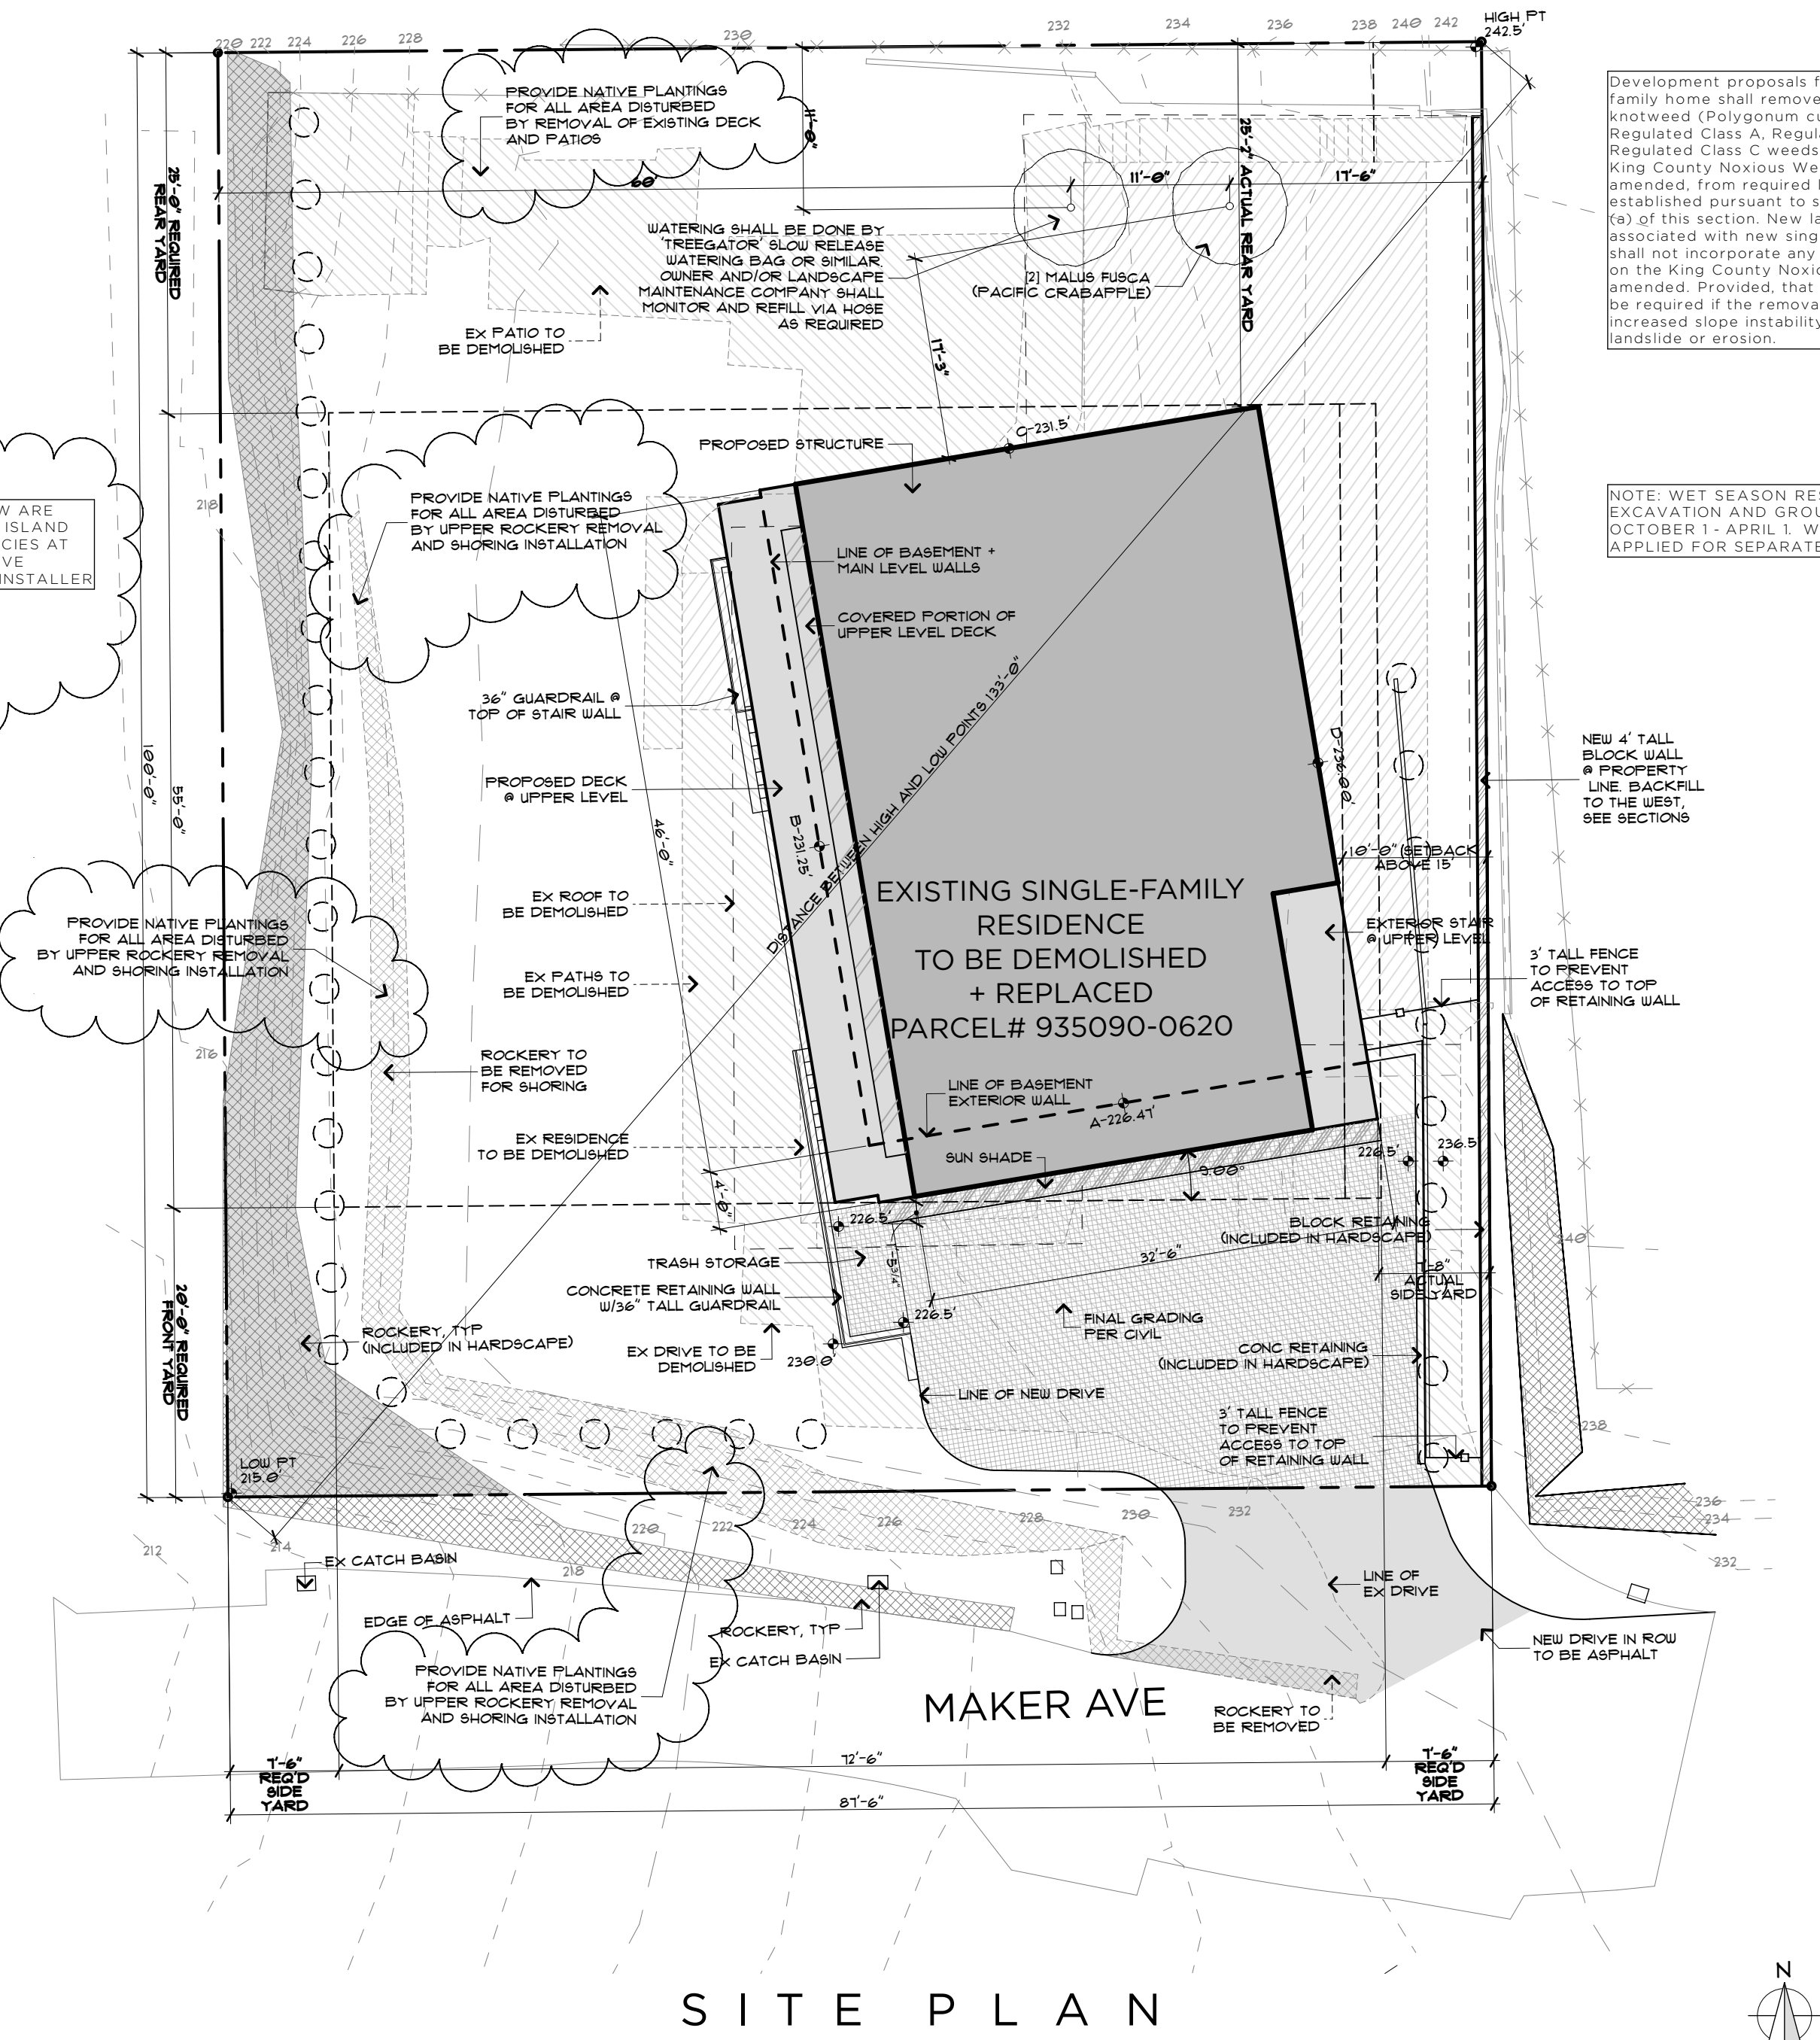

Development proposals for a new single-family home shall remove Japanese knotweed (Polygonum cuspidatum) and Regulated Class A, Regulated Class B, and Regulated Class C weeds identified on the King County Noxious Weed list, as amended. From required landscaping areas established pursuant to subsection (F)(5) (a) of this section, New landscaping associated with new single-family home shall not incorporate any weeds identified on the King County Noxious Weed list, as amended. Provided that removal shall not be required if the removal will result in increased slope instability or risk of landslide or erosion.

NOTE: WET SEASON RESTRICTIONS ON EXCAVATION AND GROUNDWORK FROM OCTOBER 1 - APRIL 1. WAIVER MUST BE APPLIED FOR SEPARATELY

LOT COVERAGE / IMPERVIOUS CALCS:

LOT AREA: 8,750 FT²
MAXIMUM ALLOWABLE IMPERVIOUS COVERAGE: (35%) 3,062.50 FT²
LOT SLOPE CALCULATION: HIGH POINT 242.5, LOW POINT 215.0, HORIZONTAL DISTANCE 133'

EXISTING ROOF IMPERVIOUS SURFACE: 3,010 FT²
EXISTING DRIVES + WALKS IMPERVIOUS SURFACE: 1,970 FT²
EXISTING IMPERVIOUS: 4,980 FT²
EXISTING IMPERVIOUS TO BE REMOVED: 4,980 FT²
EXISTING IMPERVIOUS SURFACE TO REMAIN: 0 FT²

HARDSCAPE CALCULATIONS:

LOT AREA: 8,750 FT²
MAXIMUM ALLOWABLE HARDSCAPE AREA: (9%) 787.5 FT²
EXISTING ROCKERY AT WESTERN PROPERTY: 496 FT²
PROPOSED TRASH AREA, STEPS ON GRADE AT SW CORNER, STEPS ON GRADE AT NW CORNER, PATH BETWEEN STEPS (INCLUDING RETAINING WALLS): 91 FT²
PROPOSED CONCRETE RETAINING AT DRIVEWAY: 17 FT²
PROPOSED BLOCK WALL AT EAST PROPERTY: 63 FT²
TOTAL PROPOSED HARDSCAPE: (7.6%) 667 FT²

FLOOR AREAS:

LOT AREA: 8,750 FT²
MAXIMUM ALLOWABLE GFA: (40%) 3,500 FT²
ADDITIONAL GFA FOR ADU: (5%) 437.5 FT²
TOTAL ALLOWABLE GFA W/ ADU: (45%) 3,937.5 FT
MAIN RESIDENCE BASEMENT GFA: (INCLUDES STAIRS TO MAIN LEVEL; 81 FT²) (528 FT²)
ELEVATOR SHAFT @ BASEMENT ONLY: (20 FT²)
GARAGE GFA: (476 FT²)
BASEMENT ADU GFA: (586 FT²)
BASEMENT SUBTOTAL: (1,610 FT²)
(937.5 FT² EXCLUDED SEE BELOW)
FIRST FLOOR GFA: (1,649 FT²)
(EXCLUDE STAIR PER 19.02.020.D.2.c)
(EXCLUDE ELEVATOR SHAFT): (20 FT²)
SECOND FLOOR GFA: (1,529 FT²)
(EXCLUDE ELEVATOR SHAFT): (20 FT²)
SECOND FLOOR COVERED DECK GFA: (66 FT²)
TOTAL GROSS FLOOR AREA: (44,790) 3,916 FT²

BASEMENT FLOOR EXCLUSION CALCS:

Table with 4 columns: WALL SEGMENT, LENGTH, COVERAGE %, RESULT. Rows A, B, C, D, and TOTALS.

AVERAGE BUILDING ELEVATION CALCS:

SEGMENT 'A' ELEVATION: 226.47'
SEGMENT 'A' LENGTH: 35'
SEGMENT 'A' ELEVATION x LENGTH: 7,926.45 FT²
SEGMENT 'B' ELEVATION: 231.25'
SEGMENT 'B' LENGTH: 46'
SEGMENT 'B' ELEVATION x LENGTH: 10,637.5 FT²
SEGMENT 'C' ELEVATION: 231.50'
SEGMENT 'C' LENGTH: 35'
SEGMENT 'C' ELEVATION x LENGTH: 8,102.50 FT²
SEGMENT 'D' ELEVATION: 236.00'
SEGMENT 'D' LENGTH: 46'
SEGMENT 'D' ELEVATION x LENGTH: 10,856.00 FT²
TOTAL OF AGGREGATE ELEVATION: 37,522.45'
TOTAL OF SEGMENT LENGTHS: 162'

AVERAGE BUILDING ELEVATION: 231.62'

PROJECT INFO:

PROJECT ADDRESS: 6950 SE MAKER ST, MERCER ISLAND, WA 98040
SCOPE OF WORK: NEW SINGLE FAMILY RESIDENCE
ZONE: R-8.4

LEGAL DESCRIPTION: WHITE BROS 1ST TO EAST SEATTLE 46-47-48 & W/ 42 OF 49, BLOCK 3, LOT 46 TO 49
ACCESSOR'S PARCEL NUMBER: 935090-0620
BUILDING CODE + OCCUPANCY: 2018 IRC, IBC, IFBC, WSEC, 2018 IMC, IFGC, UPC WILL BE DEFERRED PERMITS BY INDIVIDUAL TRADES
R-3 SINGLE FAMILY RESIDENTIAL (RESIDENCE)
U STORAGE (GARAGE, STORAGE)
TYPE OF CONSTRUCTION: TYPE-VB SPRINKLERED - NFPA 13D
PROVIDE MONITORED 'CHAPER 29' NFPA 72 FIRE ALARM SYSTEM

VICINITY MAP:




PROJECT TEAM:

CLIENT: MERCER RESIDENCE, 6950 SE MAKER ST, MERCER ISLAND, WA 98040
ARCHITECT / APPLICANT: JEFFREY ALMETER, 9506 13TH AVE NW, SEATTLE, WA 98117, 303.903.7883
SURVEYOR: TERRANE, 10801 MAIN STREET SUITE 102, BELLEVUE, WA 98004, 425.458.4488
GEOTECHNICAL ENGINEER: GEOTECH CONSULTANTS - ADAM MOYER, 2401 10TH AVE E, SEATTLE, WA 98102, 425.747.5618
CIVIL ENGINEER: GOLDSMITH ENGINEERING - MARK BARBER, 11400 SE 8TH ST, SUITE 450, BELLEVUE, WA 98004, 425.462.1080

STRUCTURAL ENGINEER: DS ENGINEERING - DON SHIN, 3101 14TH PLACE SE, MILL CREEK, WA 98012, 425.338.4776
CONTRACTOR: TBD

SHEET INDEX:

- A10 PROJECT INFORMATION
A11 ENERGY FORMS SURVEY
S11 SHORING PLAN AND SECTIONS
S12 SHORING NOTES + DETAILS
S13 PERMANENT SHORING PLAN
C-1 TESC PLAN
C-2 GRADING + DRAINAGE - UTILITY PLAN
C-3 PROFILES AND SECTIONS
C-4 DETAILS AND NOTES
A2.0 BASEMENT FLOOR PLAN
A2.1 FIRST FLOOR PLAN
A2.2 SECOND FLOOR PLAN
A2.3 ROOF PLAN
A3.1 BUILDING ELEVATIONS
A3.2 BUILDING SECTIONS
S10 GENERAL STRUCTURAL NOTES + DETAILS
S11 SECTIONS + DETAILS
S12 SECTIONS + DETAILS (1)
S2.0 FOUNDATION + FIRST FLOOR FRAMING PLANS
S2.2 SECOND FLOOR + ROOF FRAMING PLANS

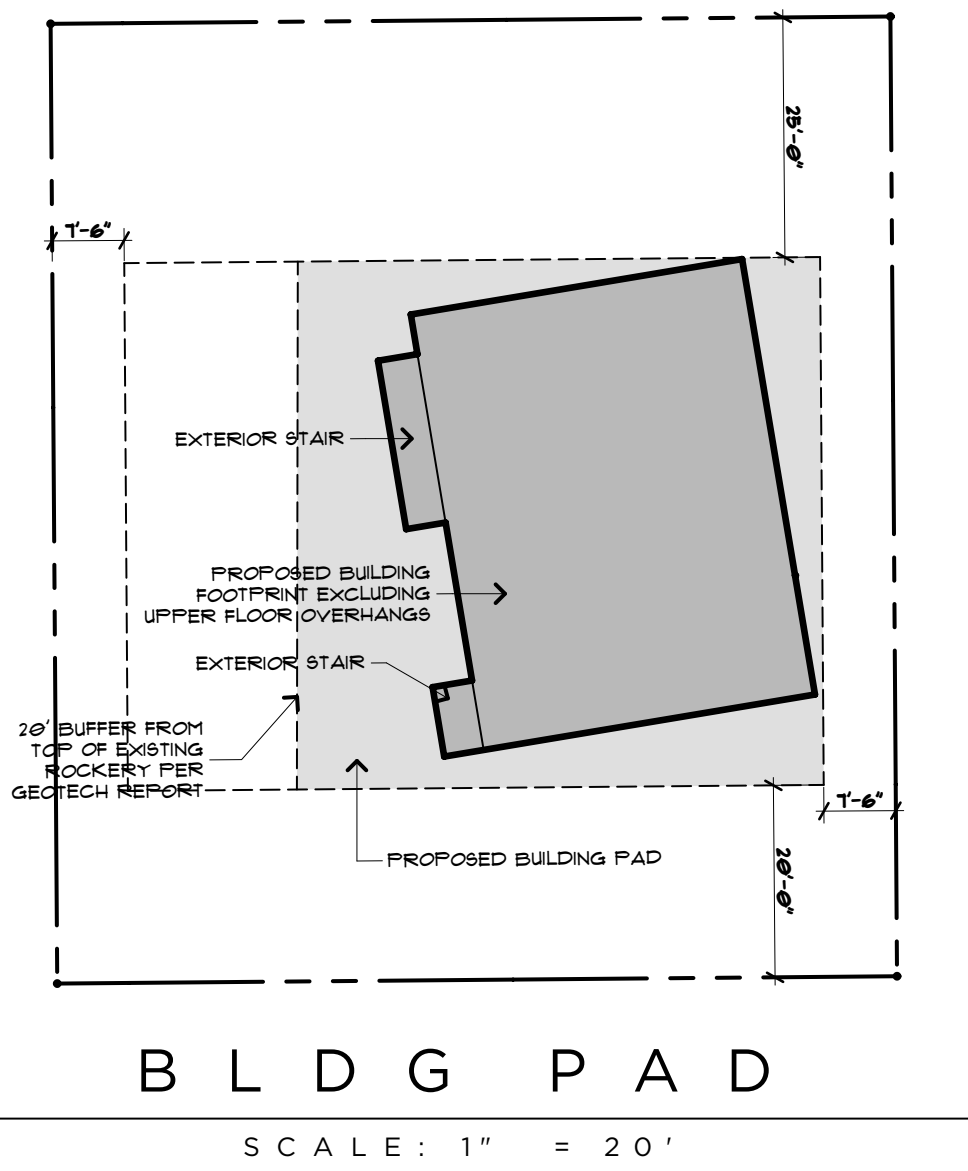

MERCER RESIDENCE
6950 SE MAKER ST MERCER ISLAND, WA

PROJECTION INFORMATION

RELEASE
21 MARCH 2022
PERMIT CORRECTIONS
20 FEBRUARY 2023
PERMIT CORRECTIONS
2 JUNE 2023

LEGAL DESCRIPTION

(PER PERSONAL REPRESENTATIVE DEED RECORDING# 20210415002461)
 LOTS 46, 47, 48 AND THE WEST ONE-HALF OF LOT 49 IN BLOCK 3 OF WHITE BROTHERS FIRST ADDITION TO EAST SEATTLE, AS PER PLAT RECORDED IN VOLUME 4 OF PLATS, PAGE 100, RECORDS OF KING COUNTY AUDITOR;
 SITUATE IN THE CITY OF MERCER ISLAND, COUNTY OF KING, STATE OF WASHINGTON.

BASIS OF BEARINGS

HELD N 88°48'41" W BETWEEN MONUMENTS FOUND ON THE CENTERLINE OF SE 32ND ST PER GPS OBSERVATIONS, NAD83/2011 WASHINGTON STATE PLANE, NORTH ZONE.

REFERENCES

R1. RECORD OF SURVEY, VOL. 133, PG. 28.
 R2. RECORD OF SURVEY, VOL. 7, PG. 171.
 R3. PLAT OF WHITE & NOBLES FIRST ADD., REC. NO. 1889050232489, RECORDS OF KING COUNTY, WASHINGTON.

VERTICAL DATUM

NAVD88, PER GPS OBSERVATIONS.

SURVEYOR'S NOTES

1. THE TOPOGRAPHIC SURVEY SHOWN HEREON WAS PERFORMED IN MAY OF 2021. THE FIELD DATA WAS COLLECTED AND RECORDED ON MAGNETIC MEDIA THROUGH AN ELECTRONIC THEODOLITE. THE DATA FILE IS ARCHIVED ON DISC OR CD. WRITTEN FIELD NOTES MAY NOT EXIST. CONTOURS ARE SHOWN FOR CONVENIENCE ONLY. DESIGN SHOULD RELY ON SPOT ELEVATIONS.
2. ALL MONUMENTS SHOWN HEREON WERE LOCATED DURING THE COURSE OF THIS SURVEY UNLESS OTHERWISE NOTED.
3. THE TYPES AND LOCATIONS OF ANY UTILITIES SHOWN ON THIS DRAWING ARE BASED ON INFORMATION PROVIDED TO US, BY OTHERS OR GENERAL INFORMATION READILY AVAILABLE IN THE PUBLIC DOMAIN INCLUDING, AS APPLICABLE, IDENTIFYING MARKINGS PLACED BY UTILITY LOCATE SERVICES AND OBSERVED BY TERRANE IN THE FIELD. AS SUCH, THE UTILITY INFORMATION SHOWN ON THESE DRAWINGS ARE FOR INFORMATIONAL PURPOSES ONLY AND SHOULD NOT BE RELIED ON FOR DESIGN OR CONSTRUCTION PURPOSES; TERRANE IS NOT RESPONSIBLE OR LIABLE FOR THE ACCURACY OR COMPLETENESS OF THIS UTILITY INFORMATION. FOR THE ACCURATE LOCATION AND TYPE OF UTILITIES NECESSARY FOR DESIGN AND CONSTRUCTION, PLEASE CONTACT THE SITE OWNER AND THE LOCAL UTILITY LOCATE SERVICE (800-424-5555).
4. SUBJECT PROPERTY TAX PARCEL NO. 9350900620.
5. SUBJECT PROPERTY AREA PER THIS SURVEY IS 8,750± S.F. (0.20 ACRES)
6. THIS SURVEY WAS PERFORMED WITHOUT THE BENEFIT OF A TITLE REPORT, EASEMENTS AND OTHER ENCUMBRANCES MAY EXIST THAT ARE NOT SHOWN HEREON.
7. FIELD DATA FOR THIS SURVEY WAS OBTAINED BY DIRECT FIELD MEASUREMENTS WITH A CALIBRATED ELECTRONIC 5-SECOND TOTAL STATION AND/OR SURVEY GRADE GPS OBSERVATIONS. ALL ANGULAR AND LINEAR RELATIONSHIPS ARE ACCURATE AND MEET THE STANDARDS SET BY WAC 332-130-090.

LEGEND




	AREA DRAIN		NAIL AS NOTED
	ASPHALT SURFACE		PAVER SURFACE
	BUILDING		POWER METER
	CENTERLINE ROW		POWER (OVERHEAD)
	COLUMN		ROCKERY
	CONCRETE SURFACE		SEWER LINE
	RETAINING WALL		SEWER MANHOLE
	DECK		STORM DRAIN LINE
	FENCE LINE (WOOD)		SEWER CLEANOUT
	GAS METER		TREE (AS NOTED)
	INLET (TYPE 1)		WATER LINE
	MONUMENT IN CASE (FOUND)		WATER METER
	MONUMENT (SURFACE, FOUND)		WATER VALVE

VICINITY MAP
N.T.S.



TOPOGRAPHIC & BOUNDARY SURVEY

STEEP SLOPE/BUFFER DISCLAIMER:
 THE LOCATION AND EXTENT OF STEEP SLOPES SHOWN ON THIS DRAWING ARE FOR INFORMATIONAL PURPOSES ONLY AND CANNOT BE RELIED ON FOR DESIGN AND/OR CONSTRUCTION. THE PITCH, LOCATION, AND EXTENT ARE BASED SOLELY ON OUR GENERAL OBSERVATIONS ON SITE AND OUR CURSORY REVIEW OF READILY AVAILABLE PUBLIC DOCUMENTS; AS SUCH, TERRANE CANNOT BE LIABLE OR RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF ANY STEEP SLOPE INFORMATION. ULTIMATELY, THE LIMITS AND EXTENT OF ANY STEEP SLOPES ASSOCIATED WITH ANY SETBACKS OR OTHER DESIGN OR CONSTRUCTION PARAMETERS MUST BE DISCUSSED AND APPROVED BY THE REVIEWING AGENCY BEFORE ANY CONSTRUCTION CAN OCCUR.

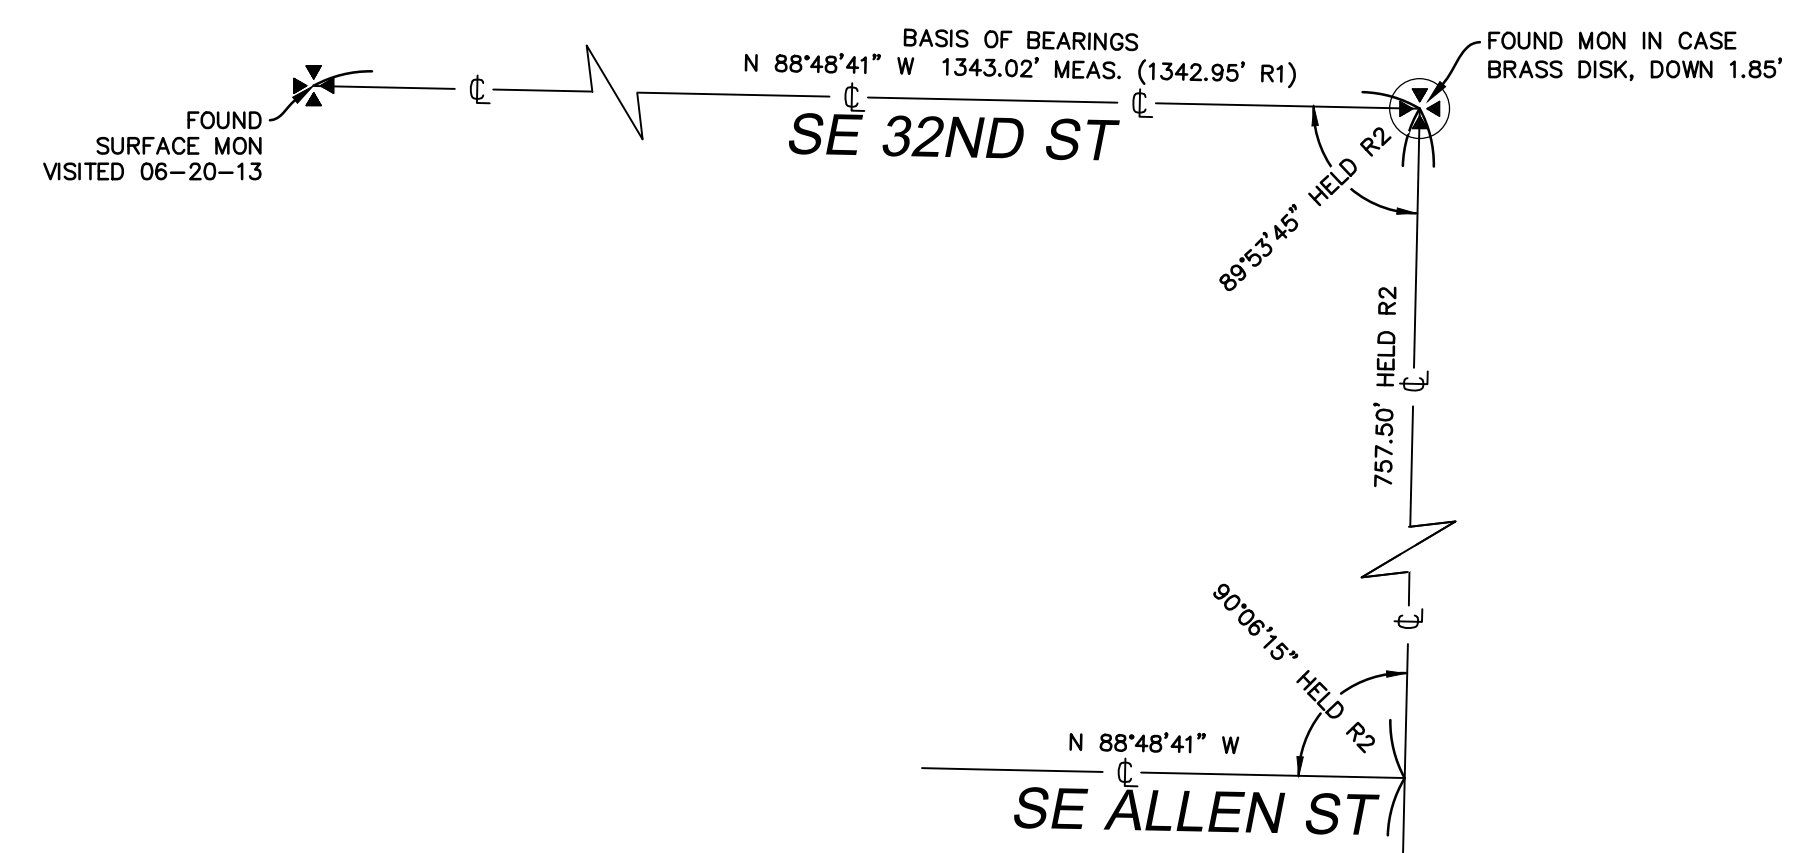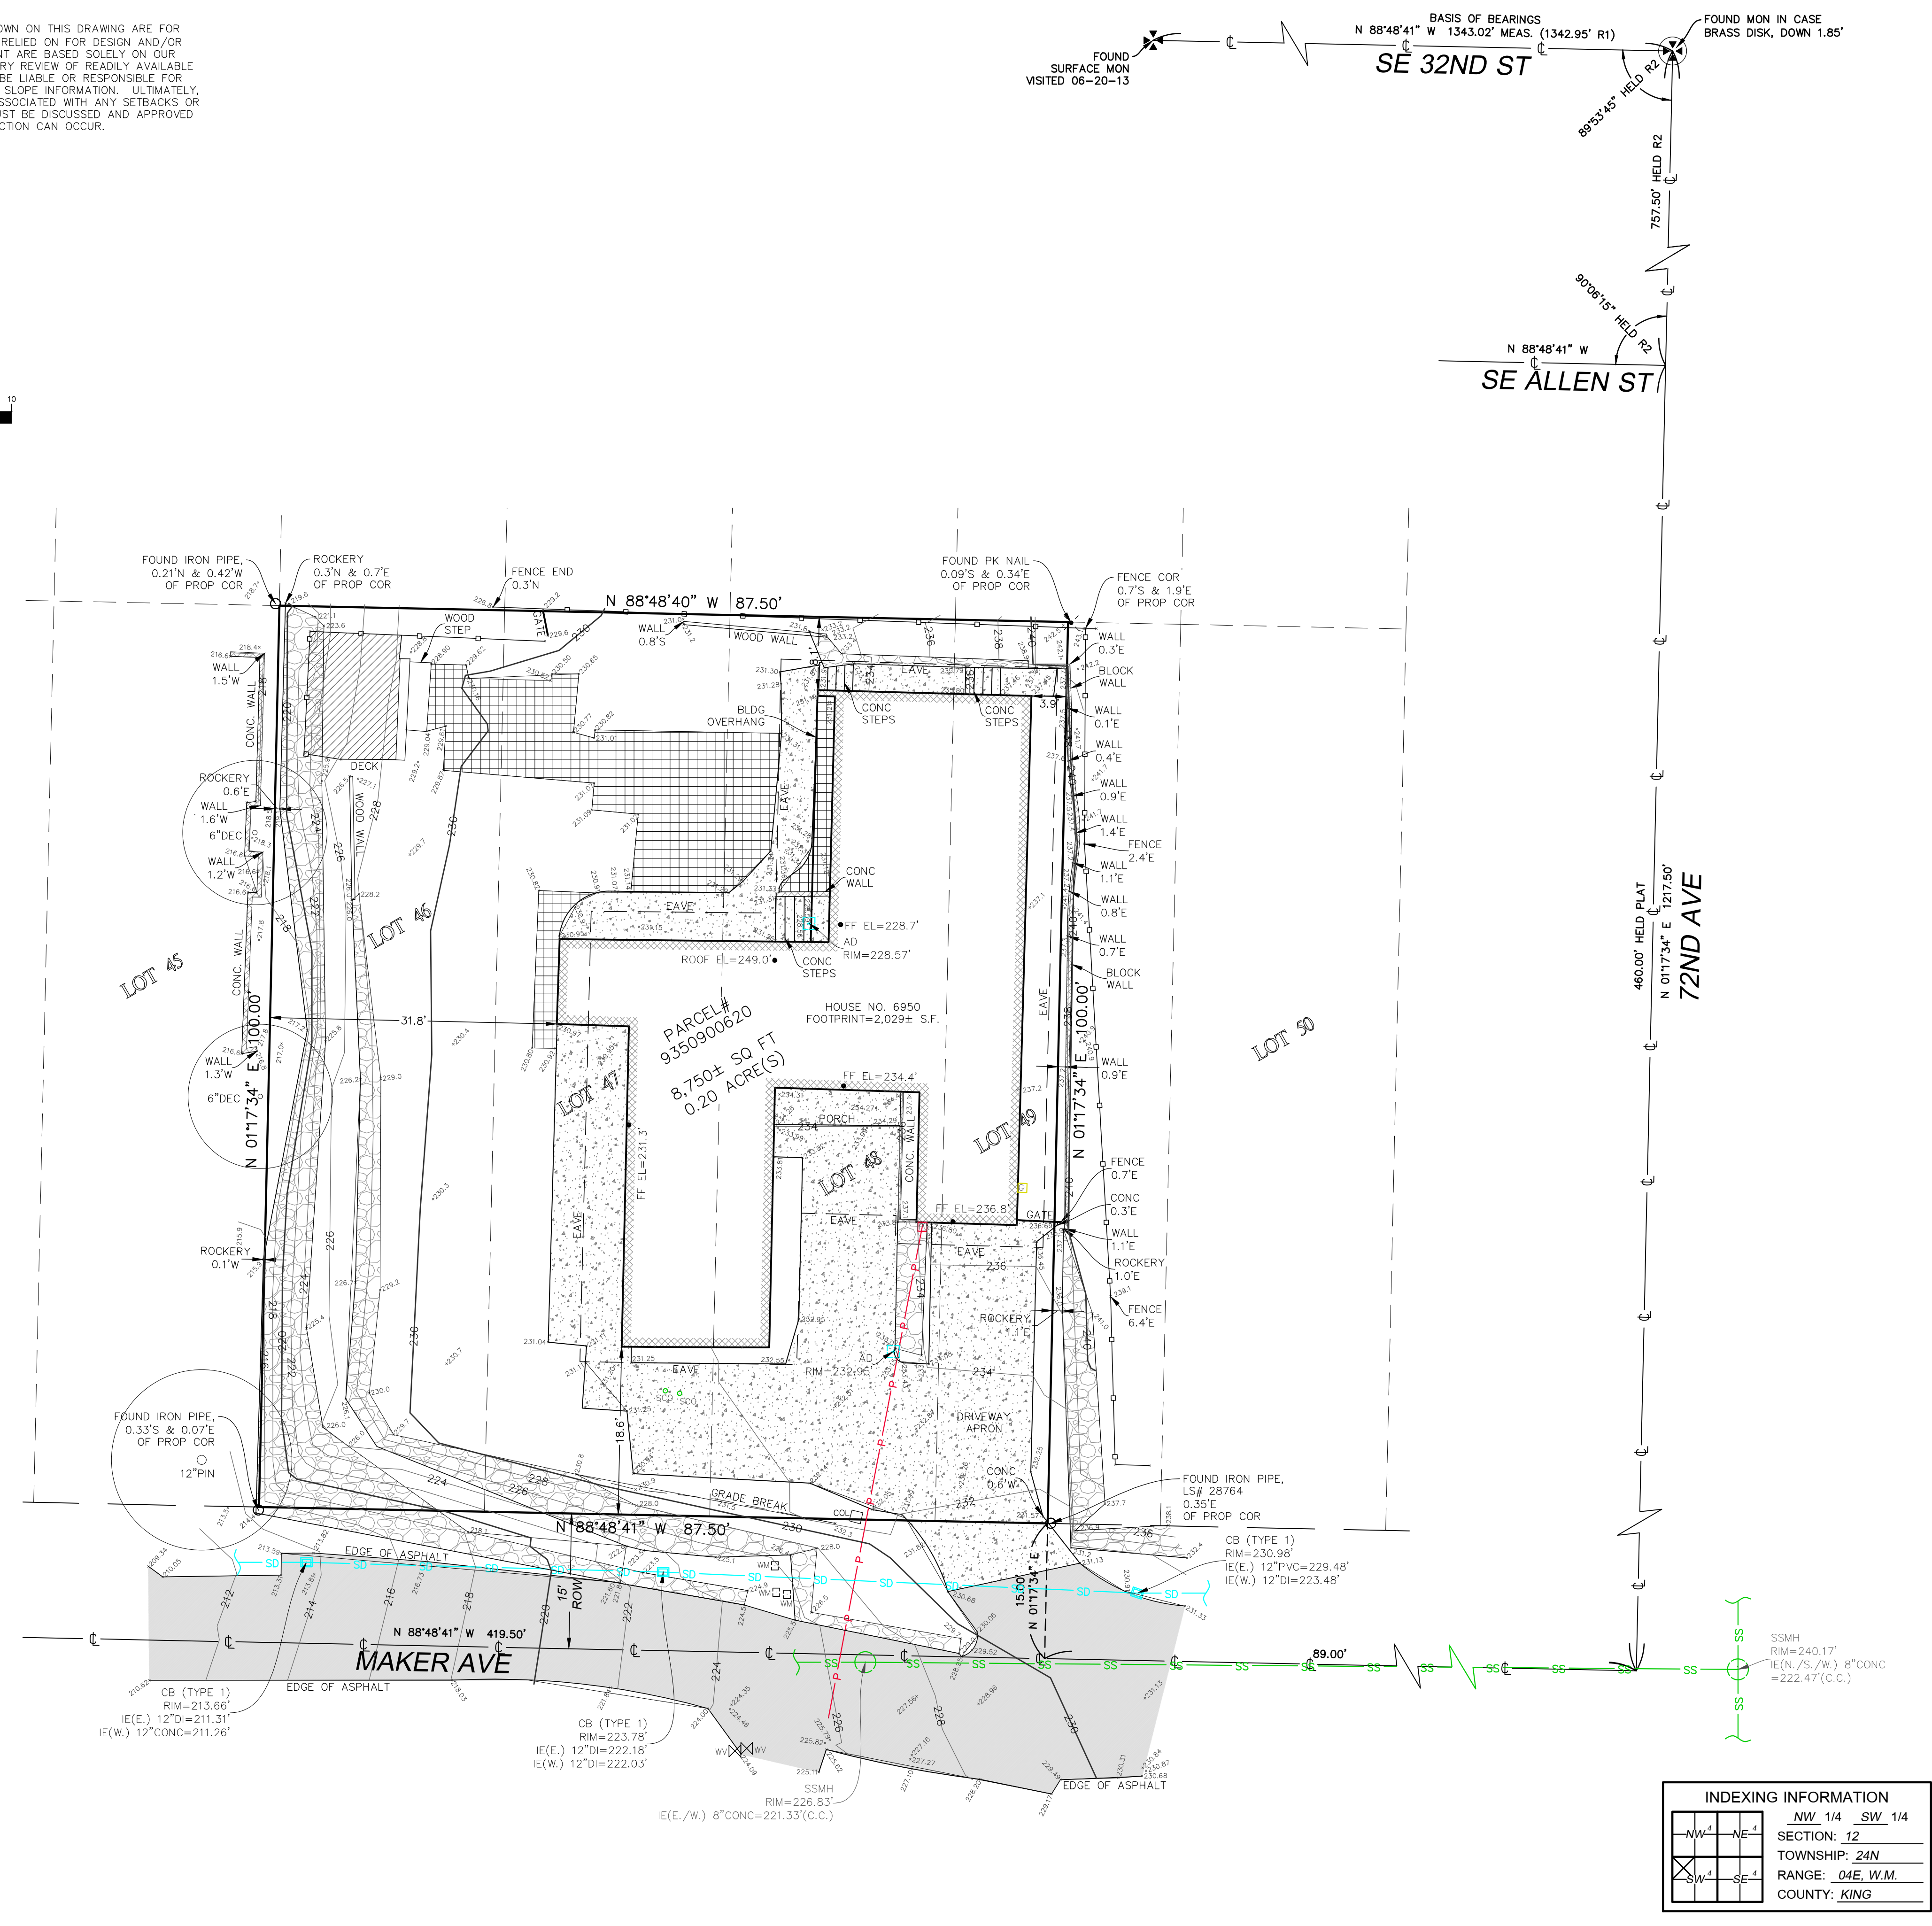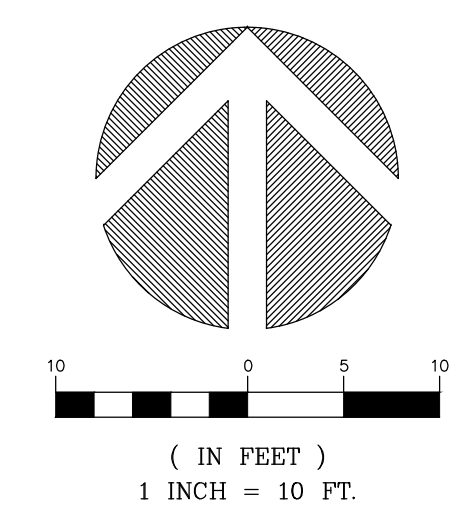


INDEXING INFORMATION

NW	1/4	SW	1/4
SECTION:	12		
TOWNSHIP:	24N		
RANGE:	04E, W.M.		
COUNTY:	KING		

measure success

TOPOGRAPHIC & BOUNDARY SURVEY
 PARCEL NO. 9350900620
STRAND RESIDENCE
 6950 SE MAKER STREET
 MERCER ISLAND, WA 98040

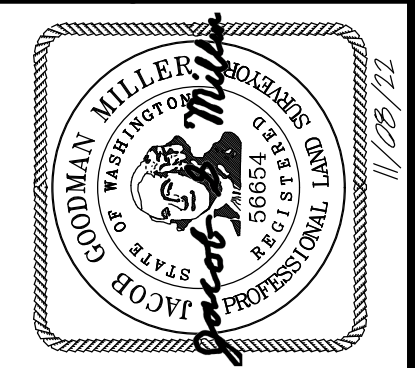


Terrane
 10801 Main Street, Suite 102, Bellevue, WA 98004
 phone 425.458.4488 support@terrane.net
 www.terrane.net


JOB NUMBER: 210007
DATE: 05/27/2021
DRAFTED BY: RSN
CHECKED BY: TBR / JGM
SCALE: 1" = 10'
REVISION HISTORY

DATE	DESCRIPTION
11/8/22	ADD CATCH BASIN


SHEET NUMBER
1 OF 1

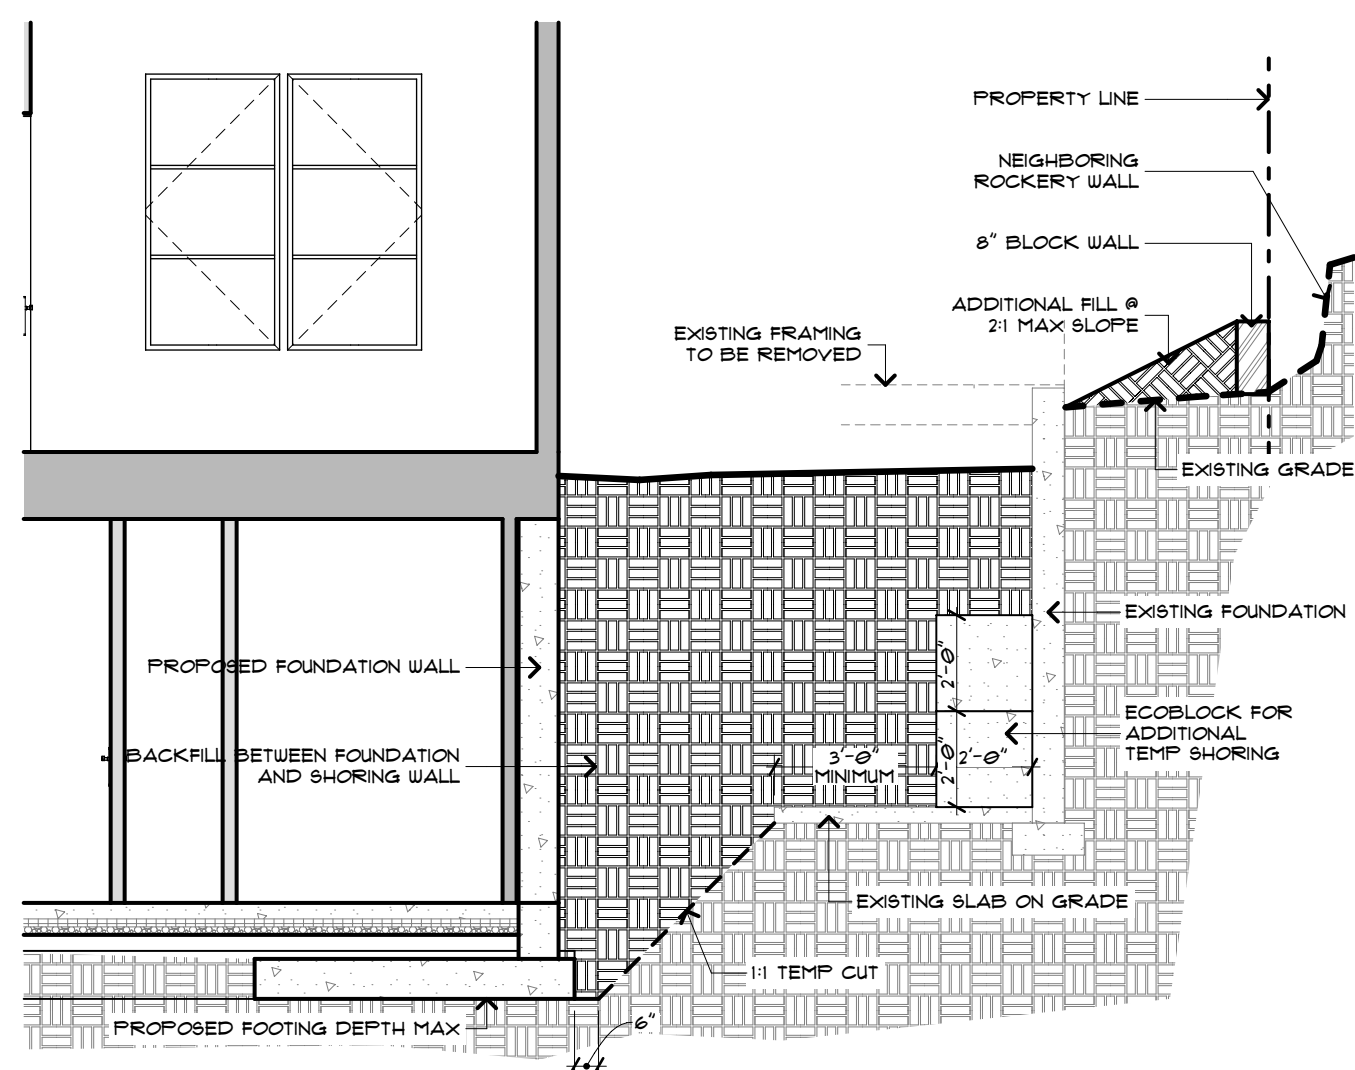


SECTION SH4 4
SCALE: 1/4" = 1'-0"

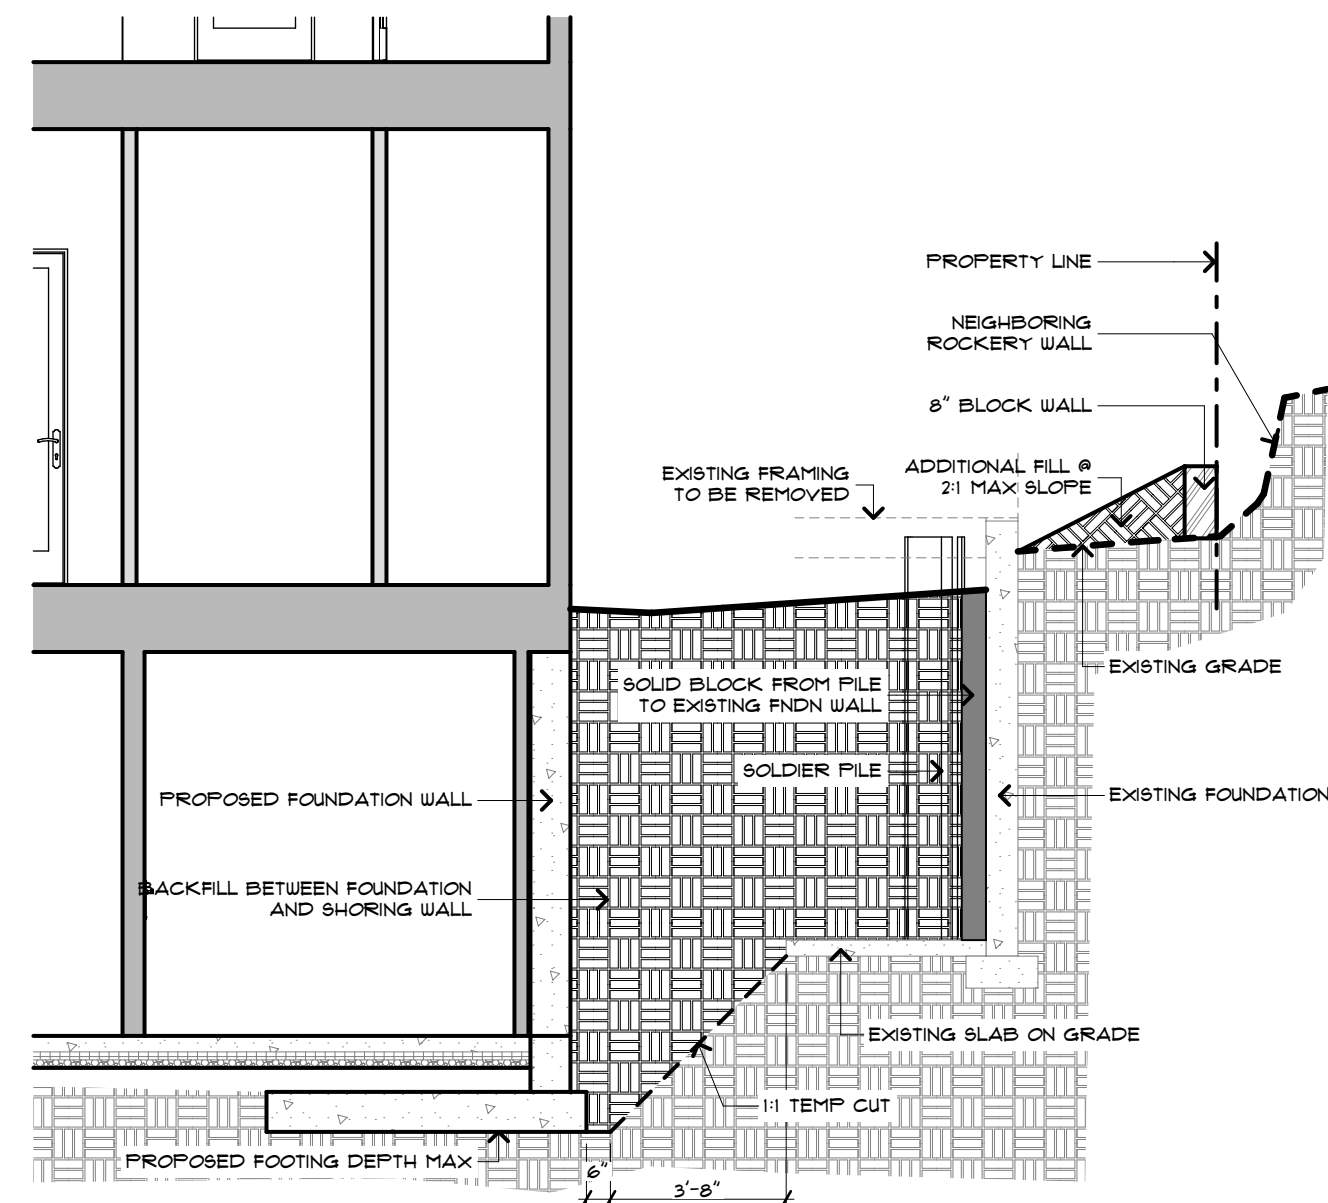


SECTION SH3 3
SCALE: 1/4" = 1'-0"

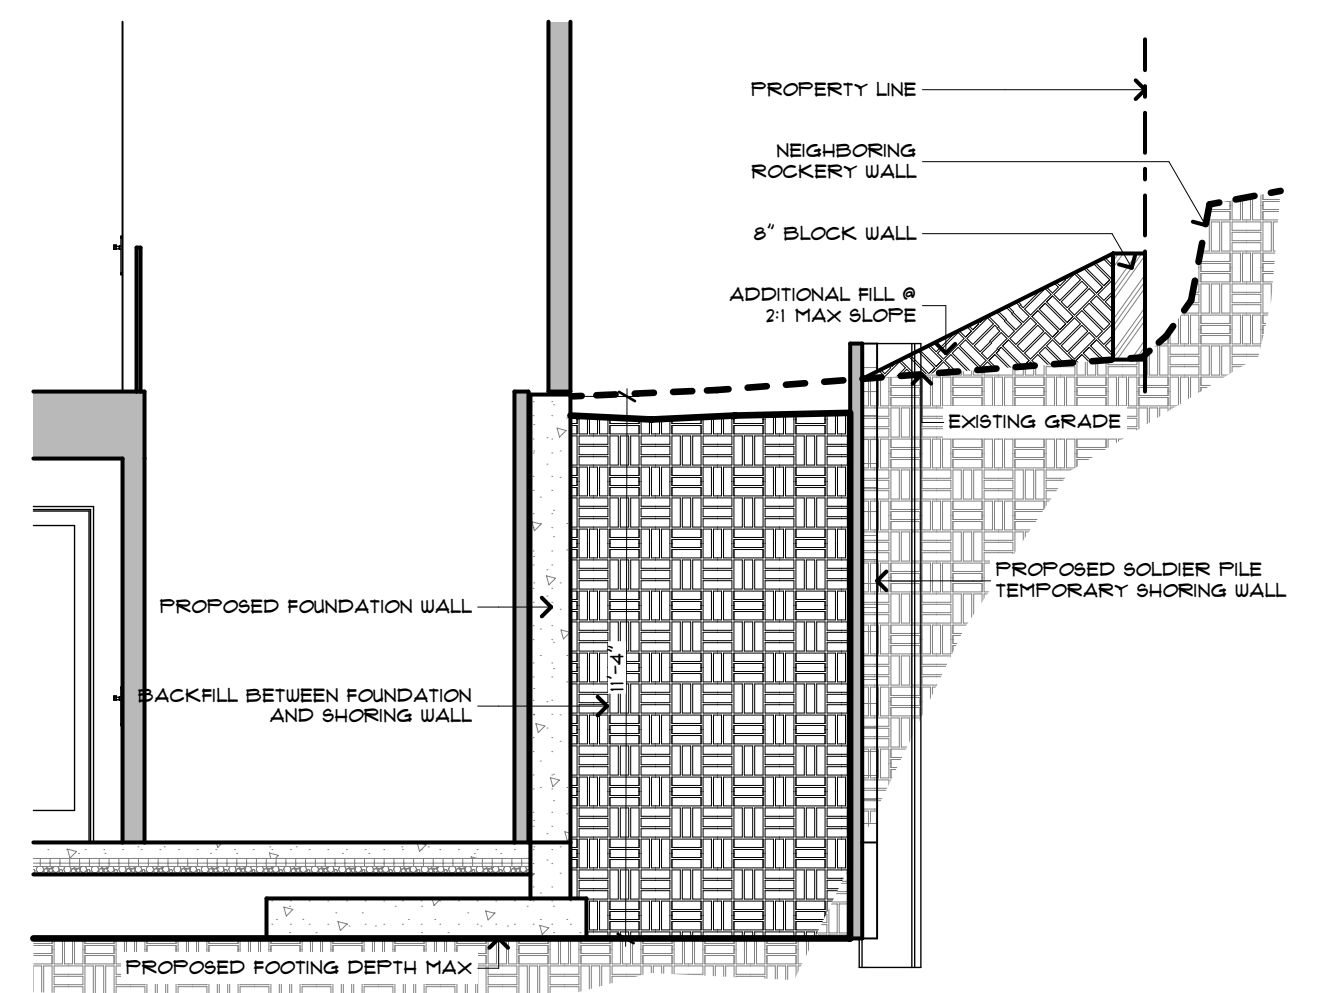

SECTION SH2 2
SCALE: 1/4" = 1'-0"

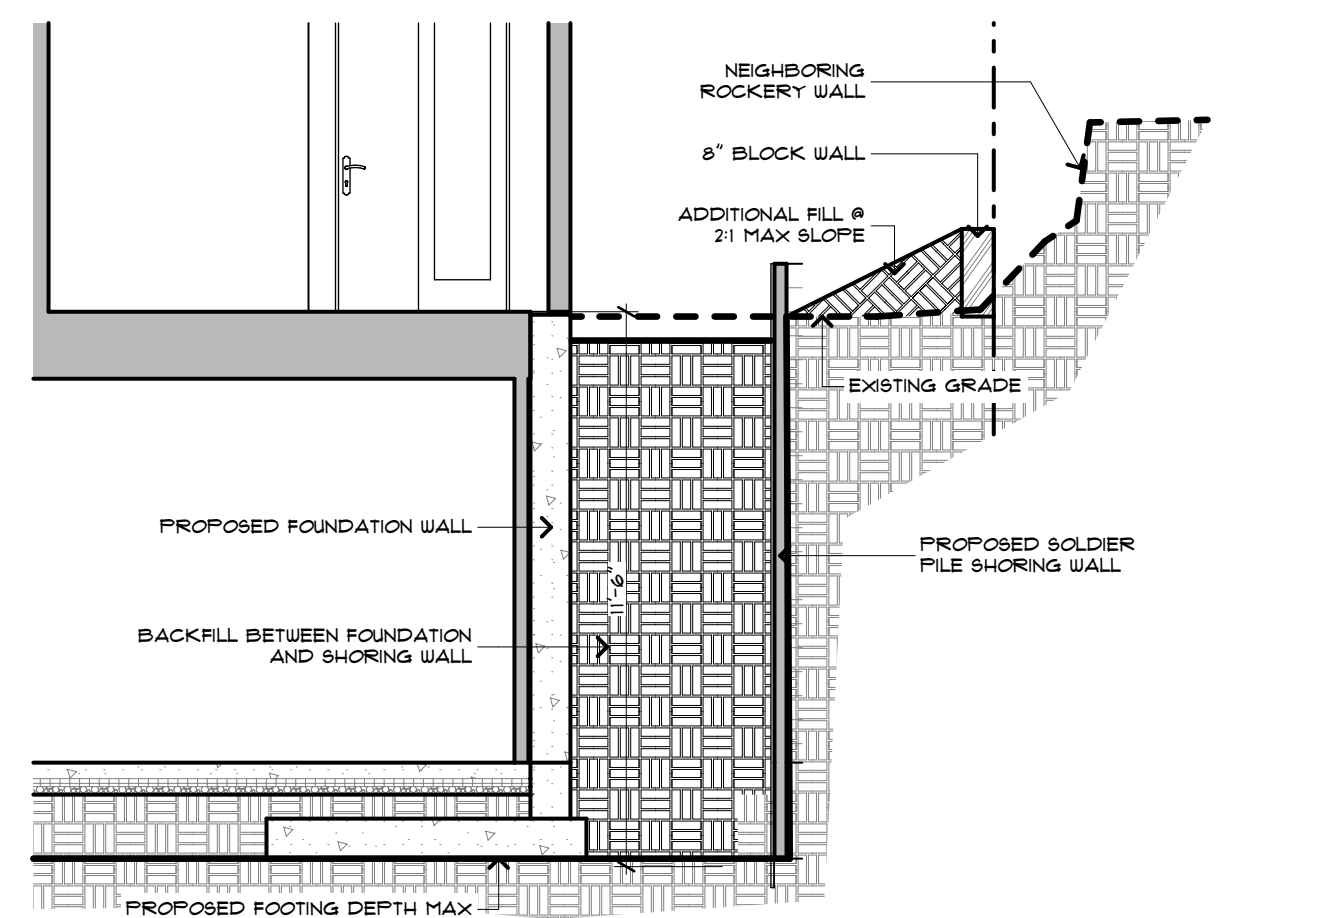

SECTION SH1 1
SCALE: 1/4" = 1'-0"

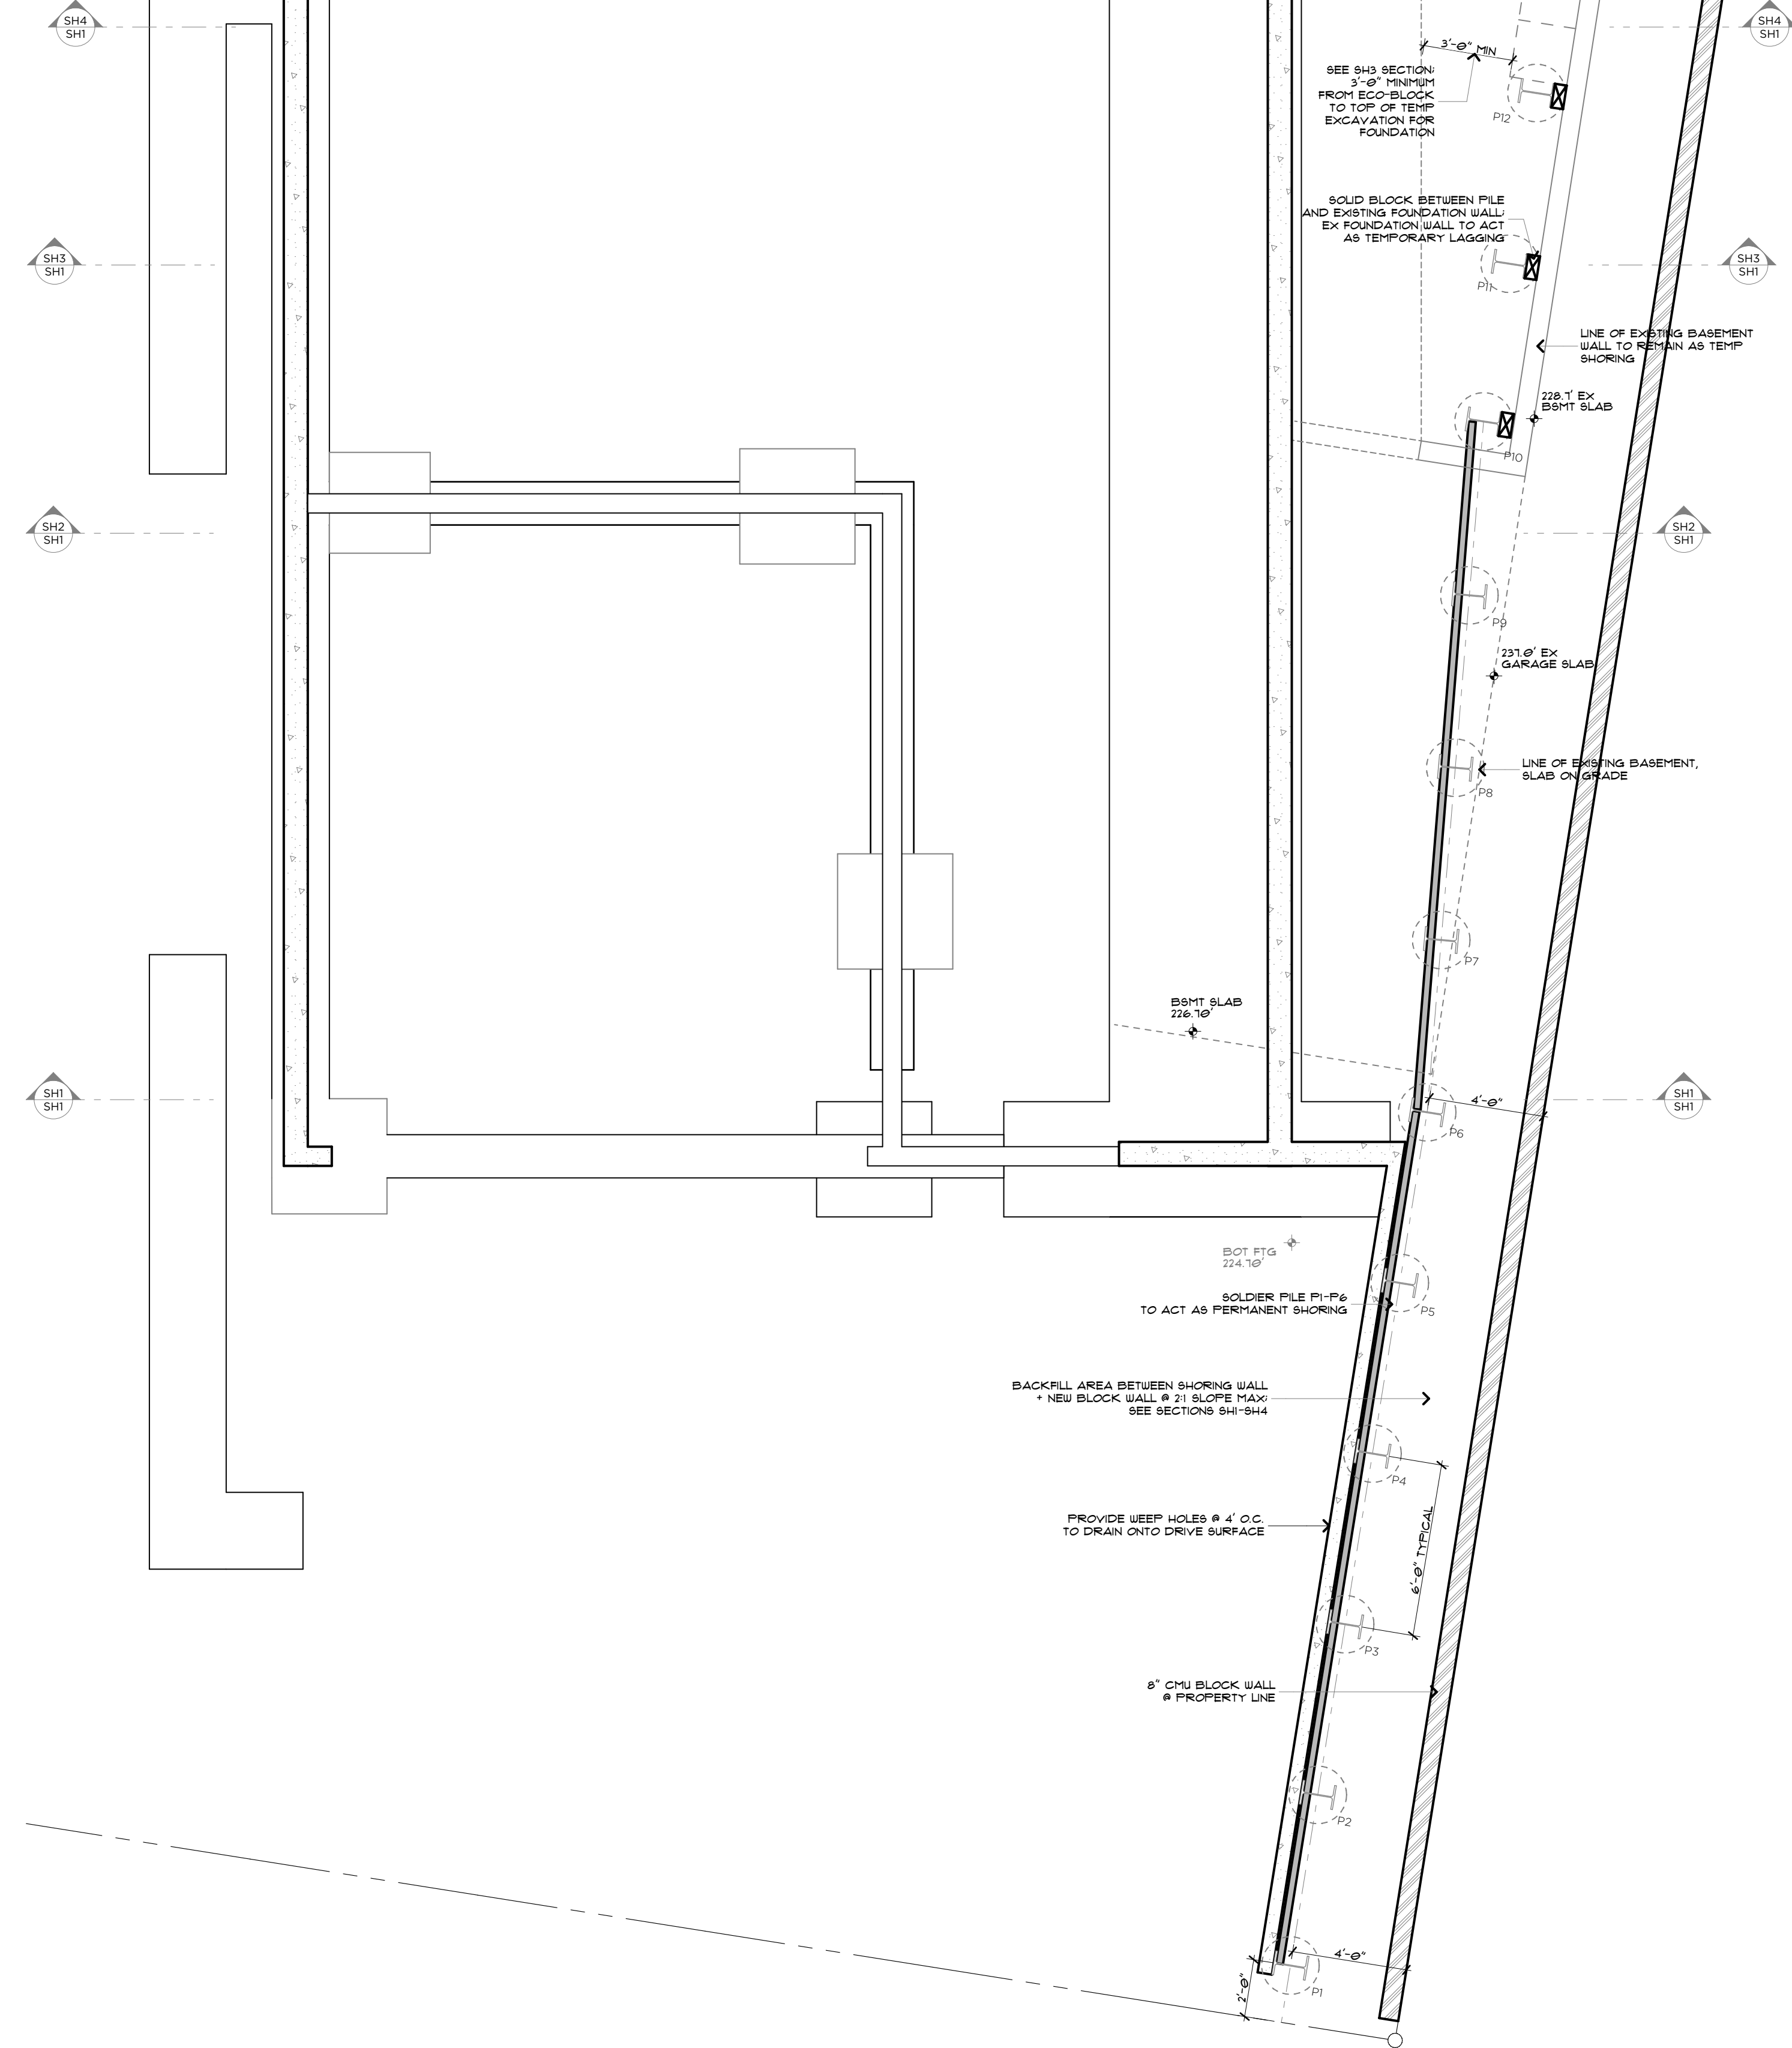

TEMPORARY SHORING PLAN
SCALE: 1/4" = 1'-0"

General Structural Notes

The Following Apply Unless Noted Otherwise on the Drawings

Criteria

- CODE REQUIREMENTS: ALL DESIGN AND CONSTRUCTION SHALL CONFORM TO THE REQUIREMENTS OF THE INTERNATIONAL BUILDING CODE, 2018 EDITION.
- REFERENCE DOCUMENTS:
 - TOPOGRAPHIC AND BOUNDARY SURVEY BY Terrane DATED May 27, 2021
 - REPORT ON GEOTECHNICAL INVESTIGATION BY Geotech Consultants, INC, DATED MARCH 21 2022, (Proj #JN-22007)
- DESIGN LOADS: THE SOIL PRESSURE INDICATED ON THE SOIL PRESSURE DIAGRAMS WHERE USED FOR DESIGN.
- SOILS INSPECTION: INSPECTION BY THE SOILS ENGINEER SHALL BE PERFORMED FOR PILE PLACEMENT. ALL PREPARED SOIL BEARING SURFACES SHALL BE INSPECTED BY THE SOILS ENGINEER PRIOR TO PLACEMENT OF PILE. SOIL COMPACTION SHALL BE SUPERVISED/TESTED BY THE GEOTECHNICAL ENGINEER.
- SPECIAL INSPECTION: SPECIAL INSPECTION OF THE FOLLOWING TYPES OF CONSTRUCTION SHALL BE PROVIDED IN ACCORDANCE WITH SECTIONS 110 AND 1701 OF THE INTERNATIONAL BUILDING CODE AND THE PROJECT SPECIFICATIONS BY A QUALIFIED TESTING AGENCY DESIGNATED BY THE ARCHITECT, AND RETAINED BY THE BUILDING OWNER. THE ARCHITECT, STRUCTURAL ENGINEER, AND BUILDING DEPARTMENT SHALL BE FURNISHED WITH COPIES OF ALL INSPECTION AND TEST RESULTS.

-STRUCTURAL STEEL FABRICATION AND ERECTION (INCLUDING FIELD WELDING AND HIGH-STRENGTH FIELD BOLTING)

- UTILITY LOCATION: THE SHORING CONTRACTOR SHALL DETERMINE THE LOCATION OF ALL ADJACENT UNDERGROUND UTILITIES PRIOR TO DRILLING PILE HOLES OR CUTTING OR DIGGING IN STREETS OR ALLEYS. THE UTILITIES INFORMATION SHOWN ON THE PLANS MAY BE NOT COMPLETE.
- SPECIAL CONDITIONS: CONTRACTOR SHALL VERIFY ALL DIMENSIONS OF EXISTING STRUCTURES IN THE FIELD AND SHALL NOTIFY THE ENGINEER OF ALL FIELD CHANGES PRIOR TO FABRICATION AND INSTALLATION.
- SOILS: SEE REPORT OF GEOTECHNICAL INVESTIGATION FOR MORE COMPLETE INFORMATION, INCLUDING RECOMMENDATIONS FOR SHORING IN GENERAL, SHORING MONITORING, EXCAVATION, LAGGING, AND DRAINAGE.
- SAWN LUMBER: SAWN LUMBER SHALL CONFORM TO "GRADING AND DRESSING RULES," WEST COAST LUMBER INSPECTION BUREAU (WCLIB), LATEST EDITION. LUMBER SHALL BE THE SPECIES AND GRADE NOTED IN THE LAGGING TABLE.

TIMBER LAGGING SHALL BE PRESSURE TREATED WITH WATERBORNE PRESERVATIVES IN ACCORDANCE WITH AWPB STANDARD U1 AND SHALL MEET A USE CATEGORY OF UC4B OR BETTER. LAGGING SHALL BE 4X10 UNLESS OTHERWISE NOTED ON DRAWINGS.

- STEEL SPECIFICATIONS: DESIGN, FABRICATION AND ERECTION SHALL BE IN ACCORDANCE WITH THE LATEST EDITIONS OF THE FOLLOWING SPECIFICATIONS:

- STRUCTURAL STEEL: AISC SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS—ALLOWABLE STRESS DESIGN.
- WELDING: AWS D1.1 (AWS PREQUALIFIED JOINT DETAILS USE 1/4" MINIMUM WELDS UNLESS NOTED OTHERWISE).
- WELDER CERTIFICATION: WASHINGTON ASSOCIATION OF BUILDING OFFICIALS (WABO).vv

- STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING REQUIREMENTS:

TYPE OF MEMBER	ASTM SPECIFICATION	Fy
WIDE FLANGE	A992	50 KSI
PIPE	A53	35 KSI
PLATES, SHAPES, ANGLES, AND RODS	A36	36 KSI
STRUCTURAL BOLTS	A325-N	
WOOD CONNECTION BOLTS	A307	
WELDING ELECTRODES	E70XX	

Concrete

- CONCRETE: CONCRETE WORK SHALL CONFORM TO ALL REQUIREMENTS OF CHAPTER 19 OF THE 2018 IBC. CONCRETE STRENGTHS SHALL BE VERIFIED BY STANDARD CYLINDER TESTS, UNLESS APPROVED OTHERWISE. REQUIRED ULTIMATE COMPRESSIVE STRENGTH OF STRUCTURAL GROUT SHALL BE REACHED BY 7 DAYS FOR TIEBACKS AND 28 DAYS FOR PILES.

f _c (psi)	Minimum Cement Per Cubic Yard	Max. Water Per 94 LB Cement	Use
-----	1-1/2 Sacks	-----	Pile lean concrete
3,000	6 Sacks (PILING)	6 Gallons	Pile struct. grout

CONCRETE WALL SHALL ATTAIN A 28-DAY STRENGTH OF f_c=3,000 PSI

AS AN ALTERNATIVE TO THE ABOVE, THE CONTRACTOR SHALL SUBMIT CONCRETE MIX DESIGNS FOR APPROVAL TWO WEEKS PRIOR TO PLACING ANY CONCRETE. THE ALTERNATE MIX DESIGN WILL BE REVIEWED FOR CONFORMANCE TO ACI 318 Ch. 5 WITH SBC REVISIONS.


- ALL CONCRETE WITH SURFACES EXPOSED TO WEATHER OR STANDING WATER SHALL BE AIR-ENTRAINED WITH AN AIR-ENTRAINING AGENT CONFORMING TO ASTM C260, C494, AND C618. TOTAL AIR CONTENT FOR FROST-RESISTANT CONCRETE SHALL BE IN ACCORDANCE WITH TABLE ACI 318 TABLE 4.2.1 MODERATE EXPOSURE.
- REINFORCING STEEL SHALL CONFORM TO ASTM A615 (INCLUDING SUPPLEMENT S1), GRADE 60, f_y=60,000 PSI. EXCEPTIONS: ANY BARS SPECIFICALLY SO NOTED ON THE DRAWINGS SHALL BE GRADE 40, f_y=40,000 PSI. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A-185. SPIRAL REINFORCEMENT SHALL BE PLAIN WIRE CONFORMING TO ASTM A615, GRADE 60, f_y=60,000 PSI.

Pipe and Lagging Construction

- DEMOLITION: SHORING AND SOIL EXCAVATION SHALL BE DONE SIMULTANEOUSLY.
- VERIFICATION: DIMENSIONS AND LOCATION OF EXISTING STRUCTURES SHALL BE VERIFIED PRIOR TO FABRICATION AND INSTALLATION OF ANY STRUCTURAL MEMBER. NOTIFY ENGINEER ABOUT ANY DISCREPANCIES PRIOR TO FABRICATION.
- STEEL PILE PLACEMENT TOLERANCES:
 - 1" INSIDE PERPENDICULAR TO SHORING WALL.
 - 1" OUTSIDE PERPENDICULAR TO SHORING WALL.
 - 3" LATERALLY.
- LAGGING: TIMBER LAGGING SHALL BE INSTALLED IN ALL AREAS. VOIDS BETWEEN LAGGING AND SOIL SHALL BE BACKFILLED PER THE GEOTECHNICAL ENGINEERS RECOMMENDATIONS. DRAINAGE BEHIND THE WALL MUST BE MAINTAINED. IT IS CONTRACTOR'S RESPONSIBILITY TO LIMIT THE AMOUNT OF EXPOSED SOIL WITHOUT LAGGING TO AVOID LOSS OF SOIL. MAXIMUM HEIGHT OF 4 FEET IS RECOMMENDED. SPECIAL CARE SHOULD BE TAKEN TO AVOID GROUND LOSS DURING EXCAVATION.
- SHORING MONITORING: A SYSTEMATIC PROGRAM OF OBSERVATION SHALL BE CONDUCTED DURING THE PROJECT EXECUTION TO DETERMINE THE EFFECT OF CONSTRUCTION ON ADJACENT FACILITIES AND STRUCTURES IN ORDER TO PROTECT THEM FROM DAMAGE. REFER TO REPORT OF GEOTECHNICAL INVESTIGATION FOR RECOMMENDATIONS. FIELD DATA AND MEASUREMENTS ARE TO BE SUBMITTED TO STRUCTURAL AND GEOTECHNICAL ENGINEER FOR REVIEW.

MONITORING PLAN SHALL INCLUDE THE FOLLOWING:

- THE TOP OF EVERY OTHER PILE SHALL BE MONITORED.
- MULTIPLE REFERENCE POINTS SHOULD BE ESTABLISHED SUFFICIENTLY FAR AWAY FROM THE SHORING TO ACT AS CONTROL POINTS FOR THE MONITORING PLAN
- ESTABLISH A BASELINE READING OF MONITORING POINTS ON THE GROUND SURFACE AND SETTLEMENT-SENSITIVE STRUCTURES BEHIND THE SHORING WALL ALIGNMENT PRIOR TO EXCAVATION AND INSTALLATION OF THE SHORING SYSTEMS.
- A LICENSED SURVEYOR MUST DO THE SURVEYING AT LEAST ONCE A WEEK.
- SURVEY FREQUENCY CAN BE DECREASED AFTER THE SHORING SYSTEM HAS BEEN INSTALLED AND EXCAVATION IS COMPLETE IF THE DATA INDICATES LITTLE OR NO ADDITIONAL MOVEMENT. SURVEYING MUST CONTINUE UNTIL THE PERMANENT STRUCTURE IS COMPLETE UP TO THE TOP OF THE SHORING WALL. THE SURVEY FREQUENCY WILL BE DETERMINED BY THE GEOTECHNICAL ENGINEER AFTER REVIEW AND APPROVAL BY THE CITY OF MERCER ISLAND BUILDING OFFICIAL (COMBO)
- THE GEOTECHNICAL ENGINEER SHALL REVIEW SURVEY DATA AND PROVIDE AN EVALUATION OF WALL PERFORMANCE ALONG WITH SURVEY DATA TO COMBO ON AT LEAST A WEEKLY BASIS. IMMEDIATELY AND DIRECTLY, NOTIFY COMBO IF ANY UNUSUAL OR SIGNIFICANTLY INCREASED MOVEMENT OCCURS.
- IMMEDIATELY AND DIRECTLY NOTIFY THE GEOTECHNICAL AND STRUCTURAL ENGINEERS, IF 0.5 INCHES OF MOVEMENT OCCURS BETWEEN TWO CONSECUTIVE READINGS AND WHEN TOTAL MOVEMENTS REACH 0.5 INCH. AT THAT AMOUNT OF MOVEMENT, THE ENGINEERS AND DESIGNERS SHALL DETERMINE THE CAUSE OF DISPLACEMENT AND DEVELOP REMEDIAL MEASURES SUFFICIENT TO LIMIT TOTAL WALL MOVEMENTS TO WHAT HAS BEEN DEFINED AS ACCEPTABLE BY THE DESIGN TEAM.

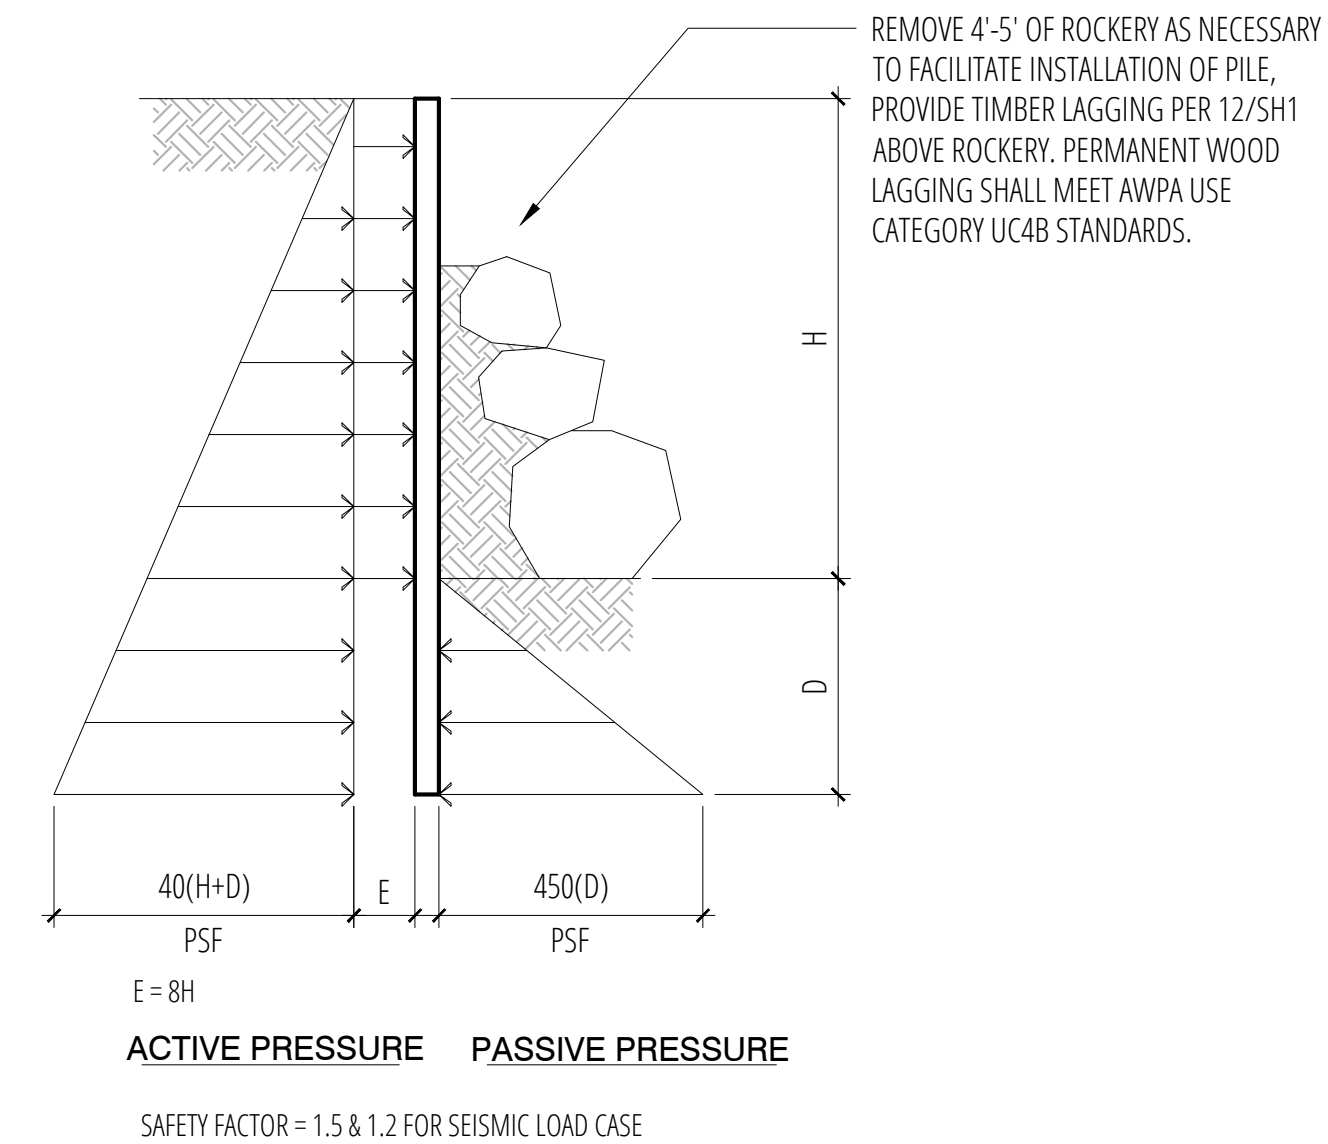


ACTIVE PRESSURE PASSIVE PRESSURE

SAFETY FACTOR = 1.5 & 1.2 FOR SEISMIC LOAD CASE

3 West Stabilization Wall Loading Diagram

SCALE: 3/4"=1'-0"

4 SCALE: 3/4"=1'-0"

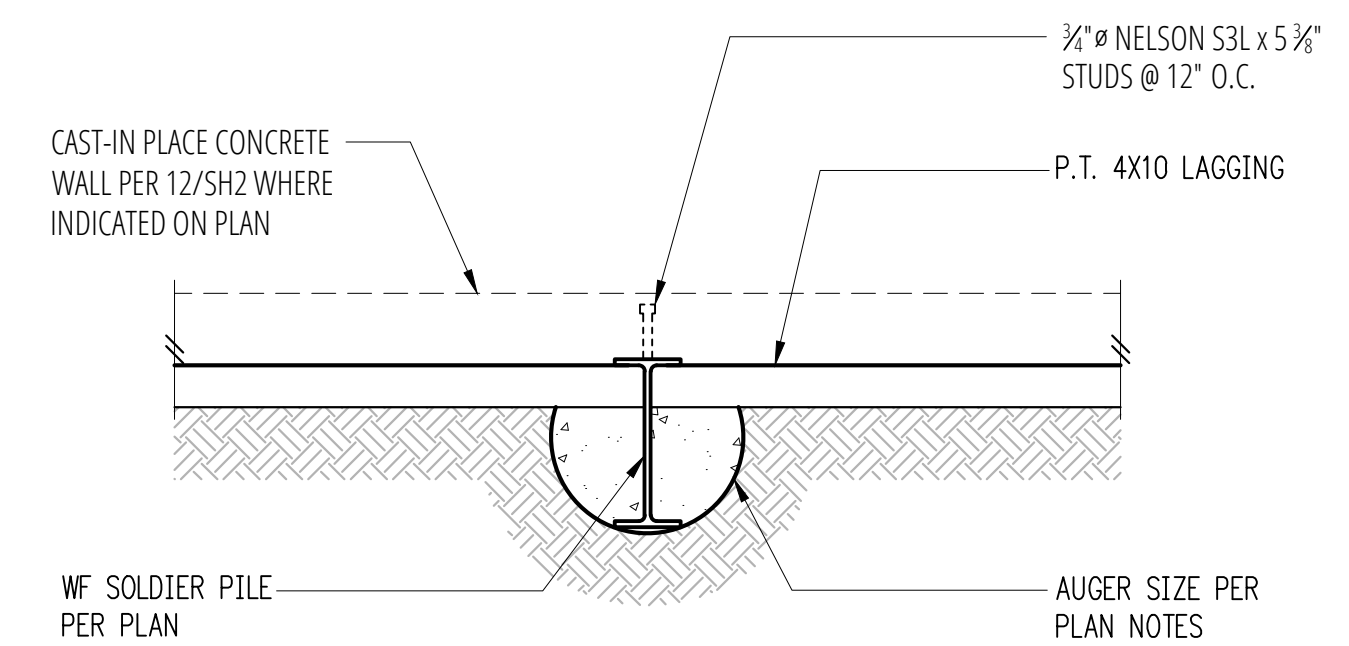


Pile Mark	Auger Dia.	Wide Flange	Max. Height H (ft.)	Min Embed D (ft.)	Min. X (ft.) Above Top of Excavation	Type
P1	24"	W16x100	11'-6"	20'-0"	1'-0"	Cantilever
P2	24"	W16x100	11'-6"	20'-0"	1'-0"	Cantilever
P3	24"	W16x100	11'-6"	20'-0"	1'-0"	Cantilever
P4	24"	W16x100	11'-6"	20'-0"	1'-0"	Cantilever
P5	24"	W16x100	11'-6"	20'-0"	1'-0"	Cantilever
P6	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P7	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P8	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P9	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P10	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P11	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P12	24"	W14x68	11'-6"	15'-0"	1'-0"	Cantilever
P13-P37	24"	W12x40	10'-0"	12'-0"	0'-0"	Cantilever

7 Pile Schedule

SCALE:


8 Typical Pile Plan

SCALE: 3/4"=1'-0"

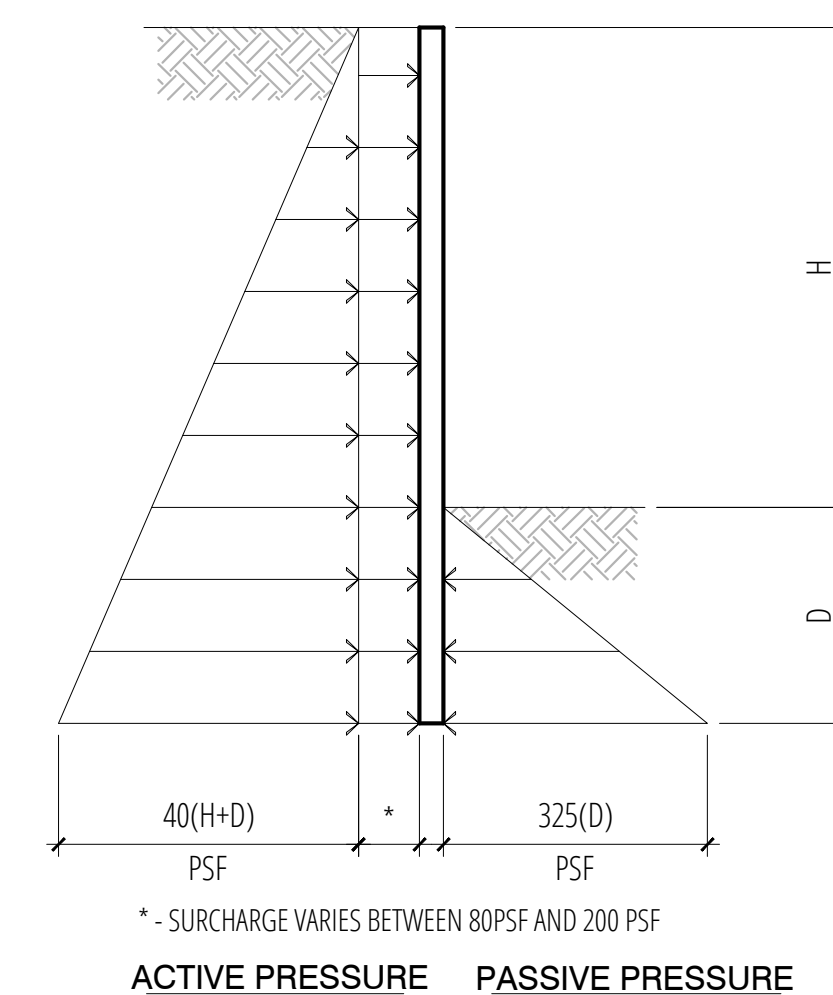


11 Pile Loading Diagram

SCALE: 3/4"=1'-0"

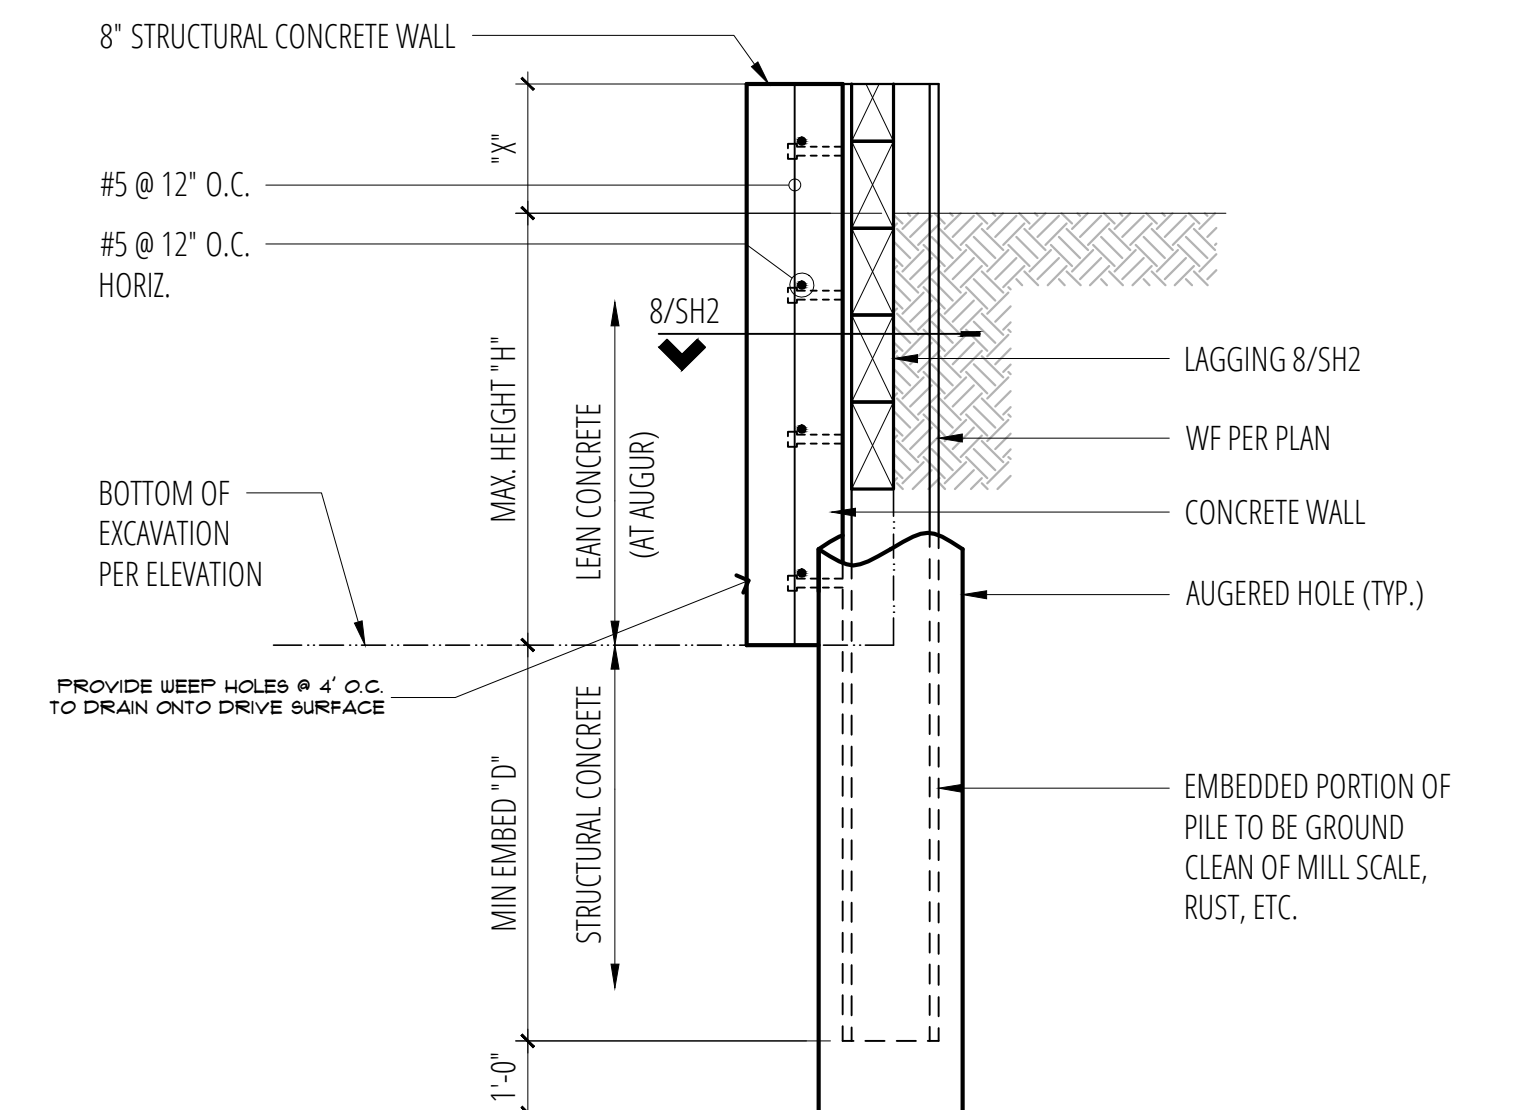

12 Cantilever Pile

SCALE: 3/4"=1'-0"

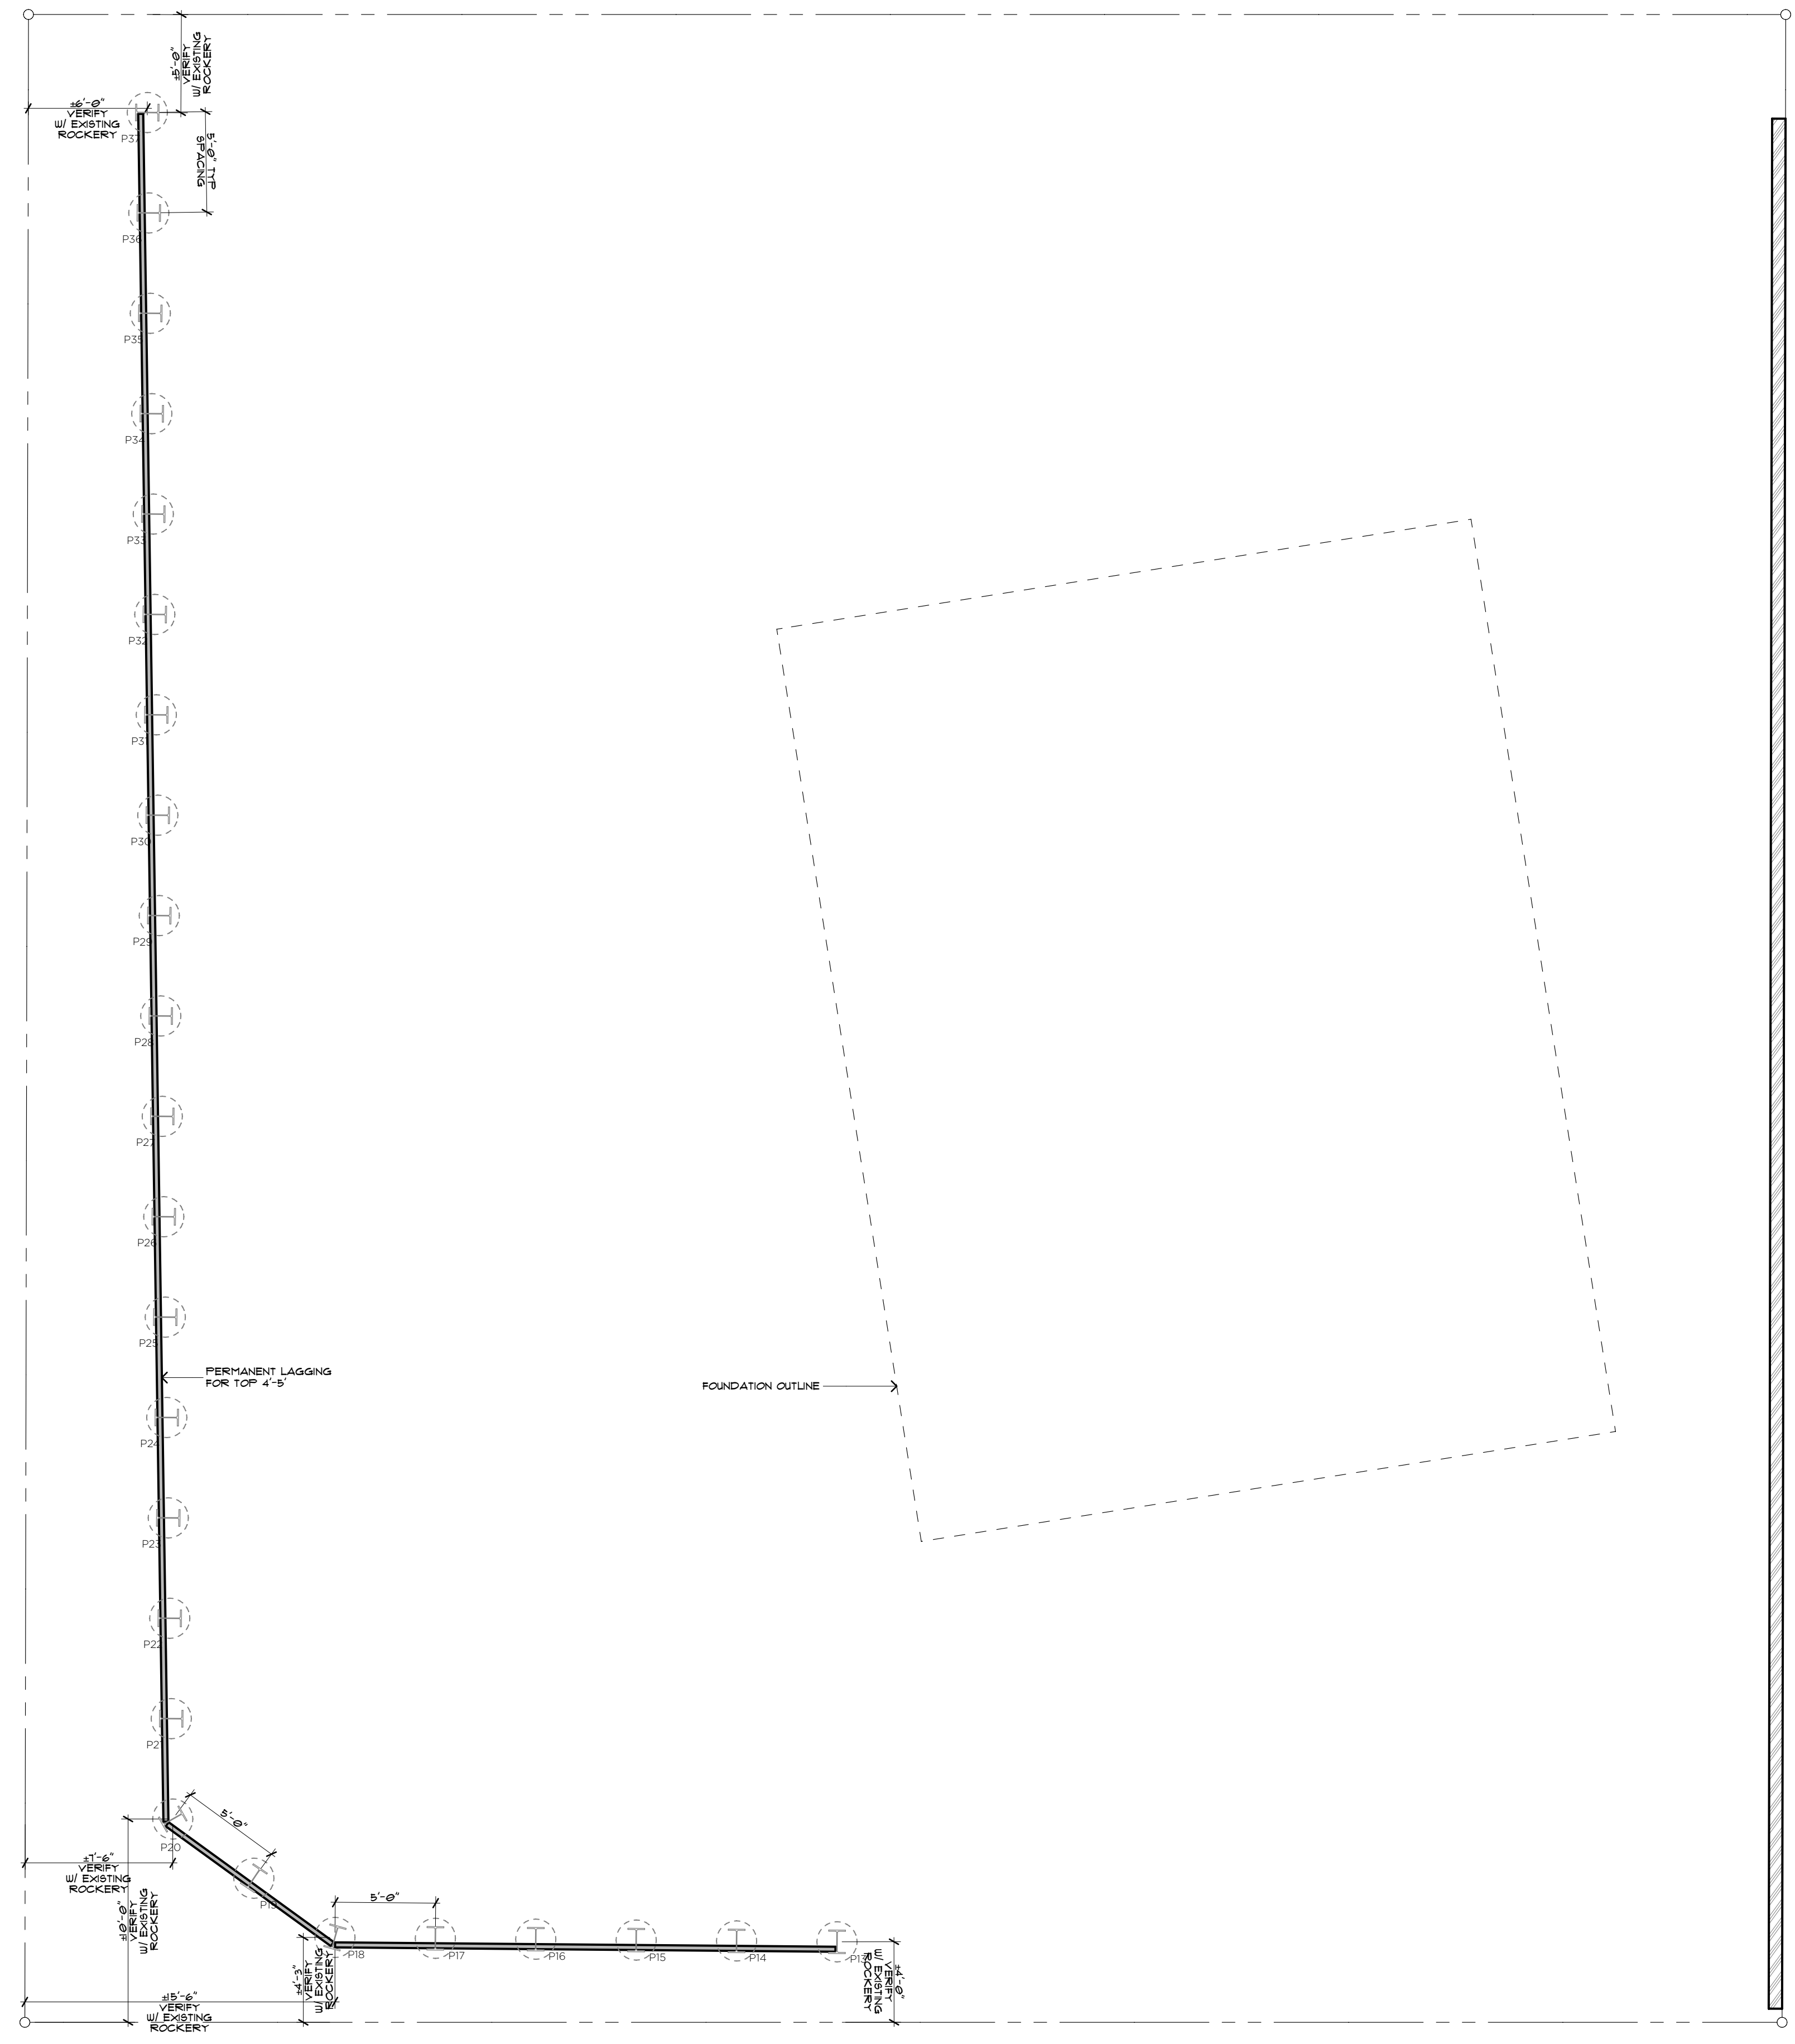

PERMANENT SHORING PLAN

SCALE: 3/16" = 1'-0"

1

MERCER RESIDENCE
6950 SE MAKER ST MERCER ISLAND, WA



PERMANENT SHORING PLAN

RELEASE PERMIT CORRECTIONS 2 JUNE 2023

SH 3

MAKER AVE
APPROVED 8/20/23

NW 1/4, SW 1/4 SECTION 12, TOWNSHIP 24 N, RANGE 4 E, W.M.
CITY OF MERCER ISLAND, KING COUNTY, WASHINGTON

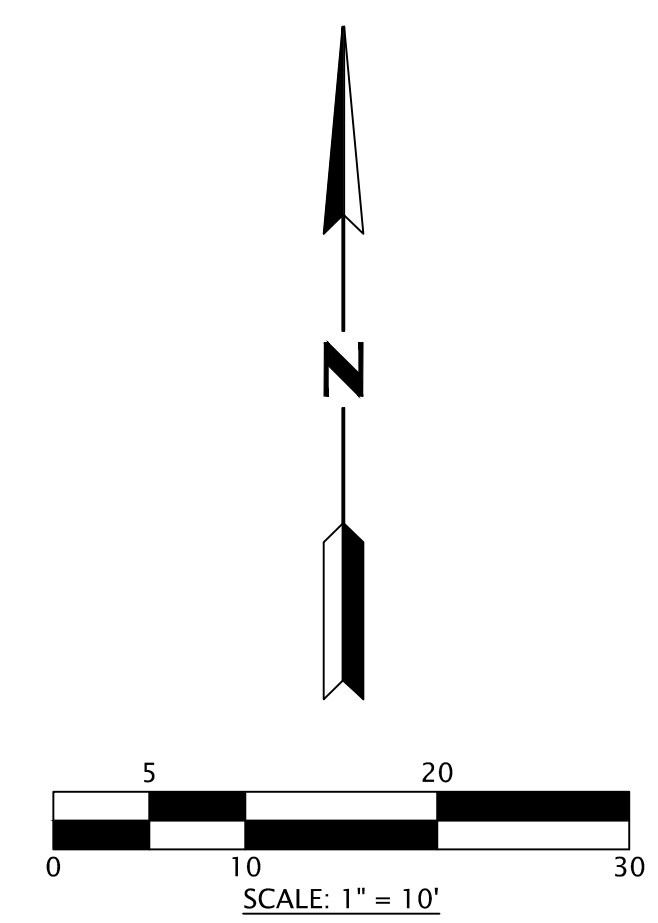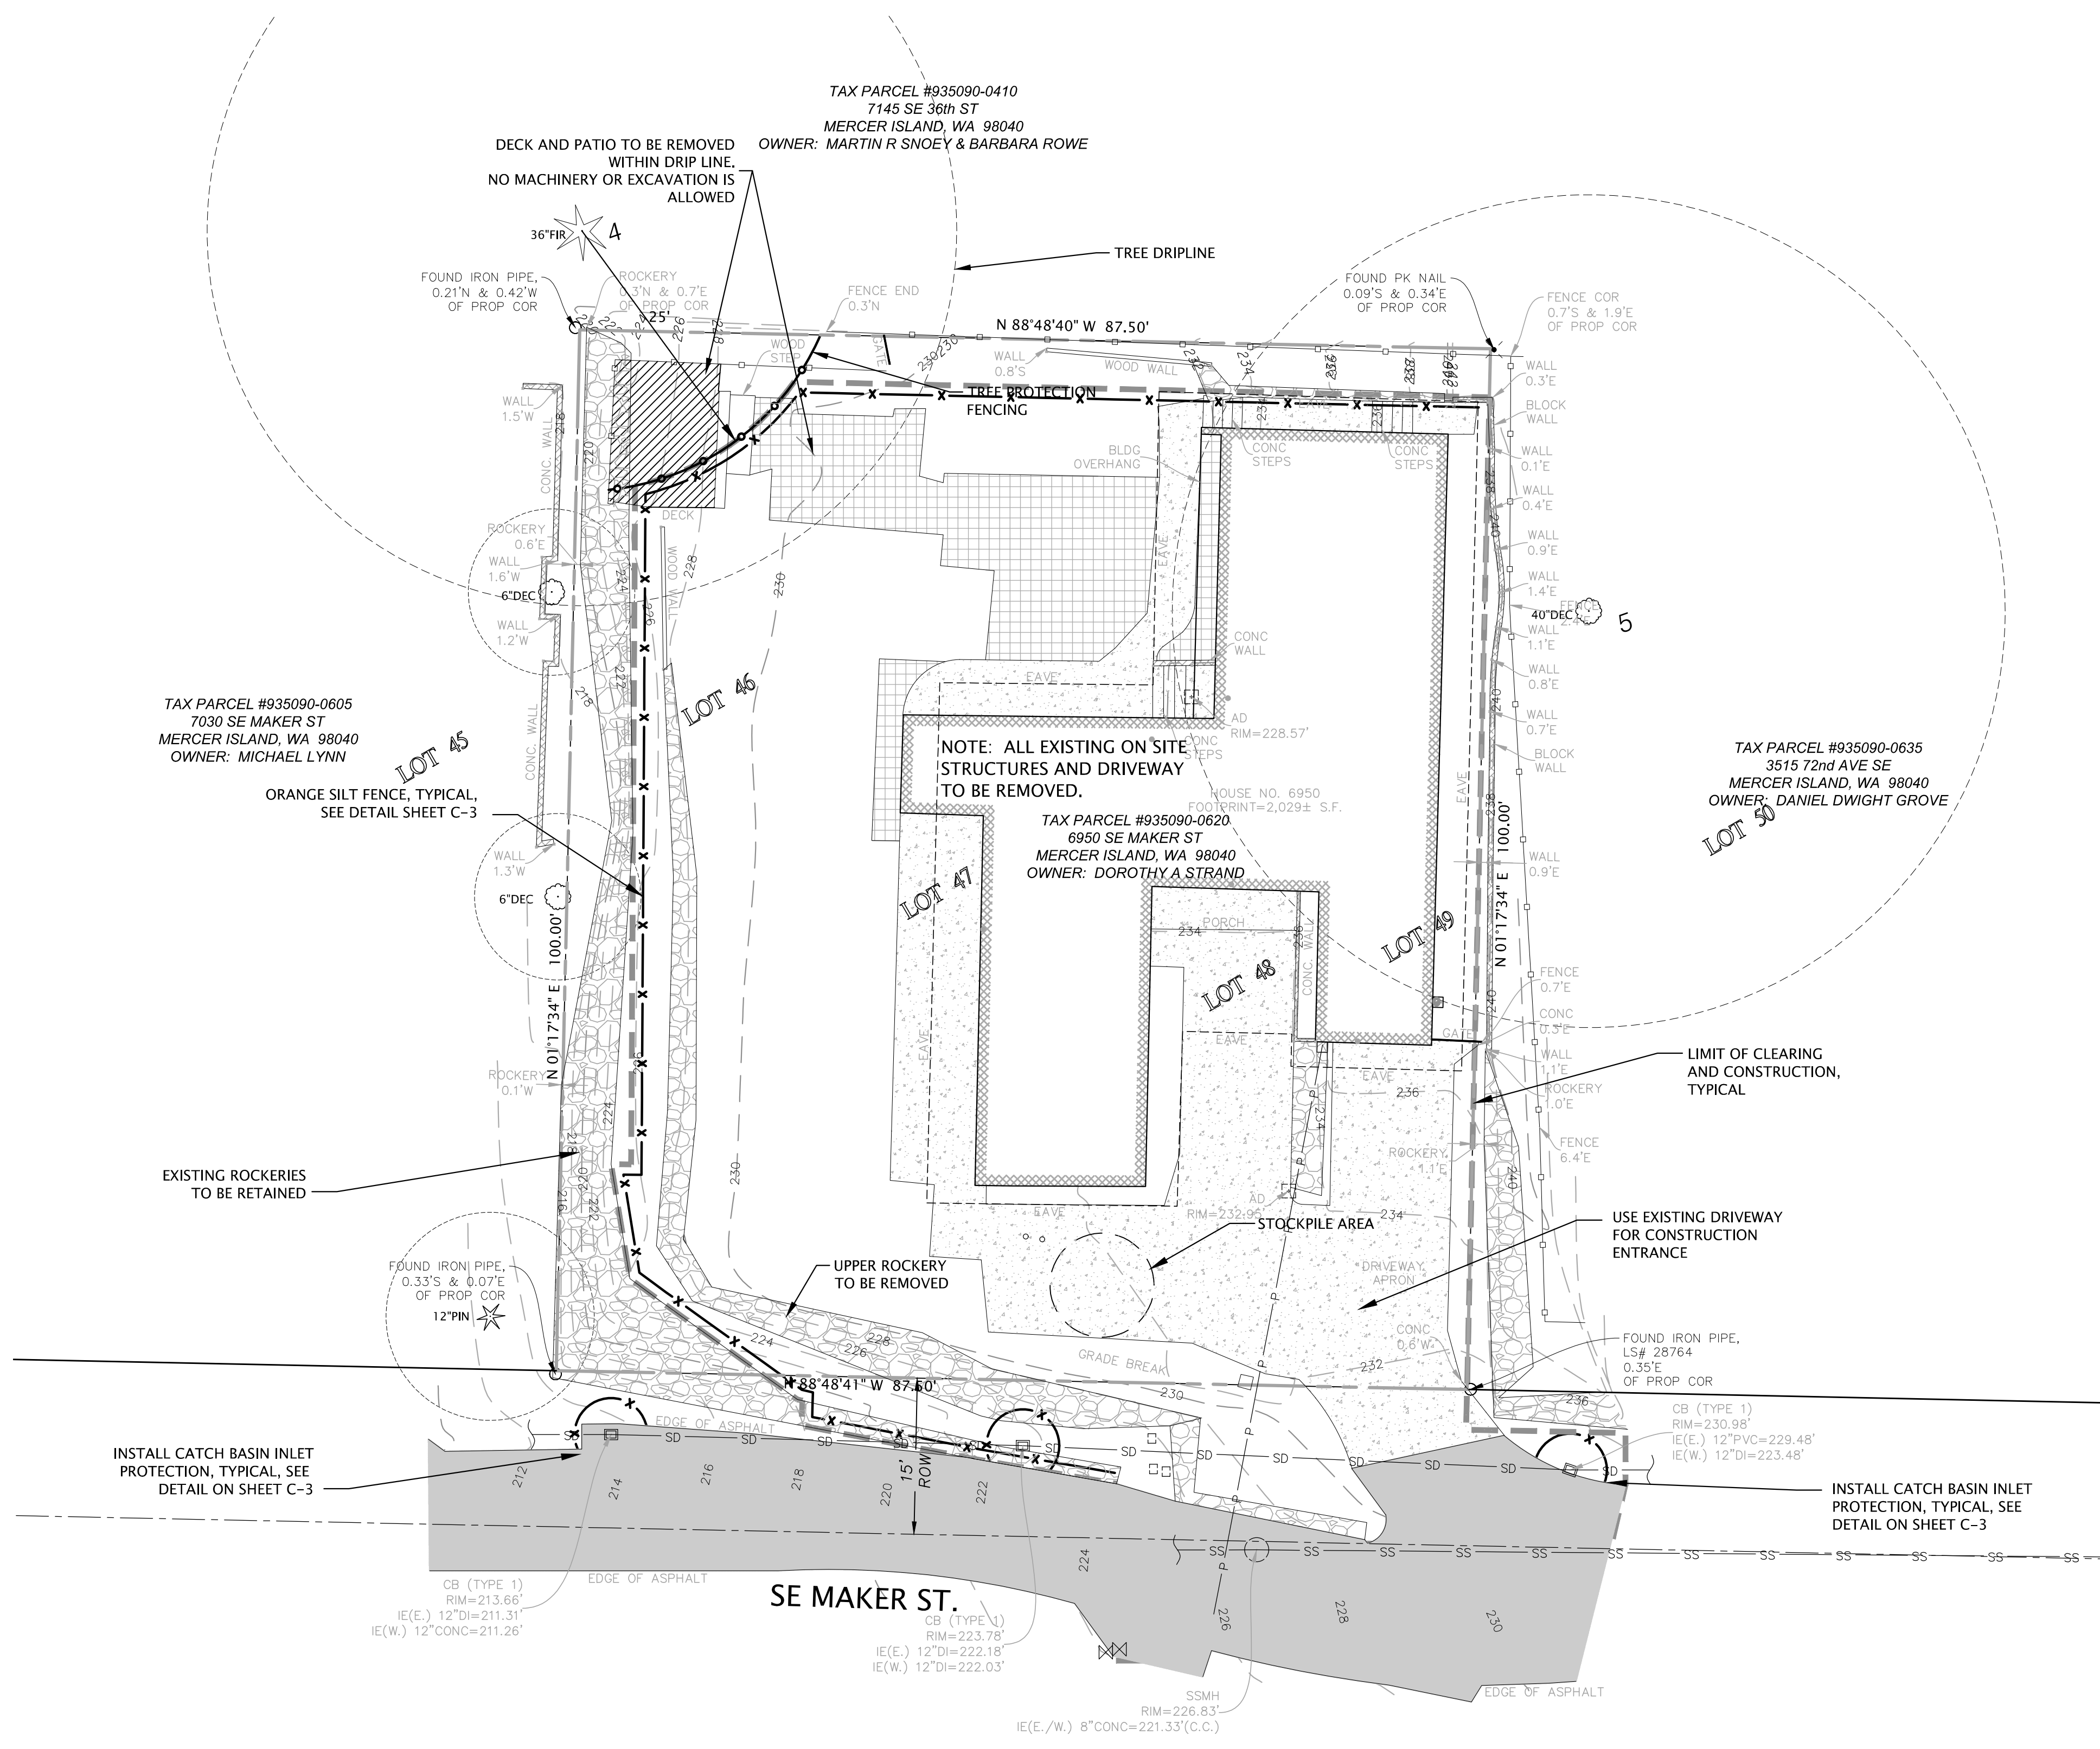

- LEGEND**
- AREA DRAIN
 - ASPHALT SURFACE
 - BUILDING
 - CENTERLINE ROW
 - COLUMN
 - CONCRETE SURFACE
 - RETAINING WALL
 - DECK
 - FENCE LINE (WOOD)
 - GAS METER
 - INLET (TYPE 1)
 - MONUMENT IN CASE (FOUND)
 - MONUMENT (SURFACE, FOUND)
 - NAIL AS NOTED
 - PAVER SURFACE
 - POWER METER
 - POWER (OVERHEAD)
 - ROCKERY
 - SEWER LINE
 - SEWER MANHOLE
 - SEWER CLEANOUT
 - SEWER (AS NOTED)
 - WATER LINE
 - WATER METER
 - WATER VALVE

- LEGEND (EROSION)**
- EXISTING CONTOUR LINE
 - PROPOSED CONTOUR LINE
 - PROPOSED SILT FENCE
 - PROPOSED LIMIT OF CONSTRUCTION
 - PROPOSED CATCH BASIN INSERT
 - EXISTING TREE TO BE RETAINED
 - EXISTING TREE TO BE REMOVED
 - TREE PROTECTION


SURVEY NOTE
EXISTING SURVEY INFORMATION SHOWN HEREON IS BASED ON SURVEY BY TERRANE SURVEYING & MAPPING, AND ELECTRONIC DRAWING FILES AS PROVIDED ON 03/25/2022. SURVEY INFORMATION HAS NOT BEEN FIELD VERIFIED BY GOLDSMITH.

Digitally signed by Mark Barber
Date: 2023.08.25
14:01:35-07'00'



GOLDSMITH
LAND DEVELOPMENT SERVICES
11400 SE 8th St, Suite 450, Bellevue, WA 98004 | PO Box 3565, Bellevue, WA 98009
T 425-462-1080 www.goldsmithengineering.com

PLOTTED:	2023/08/25 13:20	Eoregon
DRAWN:		
DESIGNED:		
APPROVED:		
FIELD BOOK:		
PAGE #:		

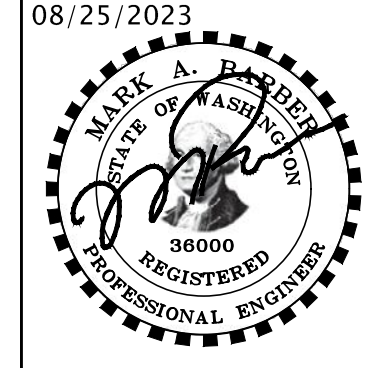

DOROTHY STRAND
TESC PLAN FOR STRAND PROPERTY
6950 SE MAKER ST., CITY OF MERCER ISLAND KING COUNTY, WASHINGTON

JOB NO. 22038
SHEET
C-1

L:\2023\2023-08-25 DEVELOPMENT\CAD\HOST DRAWINGS\BUILDING PERMIT\22038R01.DWG 23/08/25 13:20

L:\2023\22038\3 DEVELOPMENT\CAD\HOST DRAWINGS\BUILDING PERMIT\22038R01.DWG

NW ¼, SW ¼ SECTION 12, TOWNSHIP 24 N, RANGE 4 E, W.M.
CITY OF MERCER ISLAND, KING COUNTY, WASHINGTON

**STORM & ROOF DRAINAGE SYSTEM
STRUCTURE TABLE**

NAME	TYPE	VERTICAL	I.E. IN / OUT
CB # 1	TYPE 1, EXISTING	RIM = 213.66	12" SD D.I. IN (E) = 211.31 12" CONC. D.I. OUT (W) = 211.26
CB # 2	TYPE 1, EXISTING TIE INTO	RIM = 223.78	12" EX. SD D.I. IN (E) = 222.18 6" SD PVC IN (N) = 222.03 12" SD D.I. OUT (W) = 222.03
CB # 3	TYPE 1, W/ OIL & WATER SEPARATOR	RIM = 230.77	4" RD PVC IN (N) = 224.90 4" TRENCH RD PCV IN (E) = 224.90 6" SD PVC OUT (S) = 224.90
TRENCH DRAIN	TRENCH DRAIN	RIM = 226.44	4" TRENCH RD PCV OUT (W) = 225.60
X-CB	TYPE I CB	RIM = 230.98	12" PVC IN (E) = 229.48 12" EX. SD D.I. OUT (W) = 229.48
YD # 1	YARD DRAIN	RIM = 230.68	4" RD PVC IN (E) = 227.25 4" RD PVC OUT (S) = 227.25
YD # 2	YARD DRAIN	RIM = 233.08	4" RD PVC IN (S) = 230.57 4" RD PVC OUT (W) = 230.57

**STORM & ROOF DRAINAGE SYSTEM
PIPE TABLE**


PIPE	SIZE	LENGTH	PIPE INFORMATION
1	12"	40 LF	SD D.I. @ 27.09%
2	6"	29 LF	SD PVC @ 9.97%
3	4"	50 LF	RD PVC @ 4.68%
4	4"	44 LF	RD PVC @ 7.46%
5	4"	8 LF	TRENCH RD PCV @ 8.91%
6	12"	53 LF	EX. SD D.I. @ 13.87%
7	4"	47 LF	RD PVC @ 5.75%

**SANITARY SEWER SYSTEM
STRUCTURE TABLE**

NAME	TYPE	VERTICAL	I.E. IN / OUT
EX-SSMH # 1	SSMH, EXISTING	RIM = 226.83	6" PVC IN (N) = 221.91 8" D.I. IN (E) = 221.33 8" D.I. OUT (W) = 221.33
HOUSE	LOWER LEVEL FF	RIM = 226.47	6" PVC OUT (S) = 222.86
SSCO # 1	CLEAN OUT W/ TRAFFIC RATED LID	RIM = 227.93	6" PVC IN (N) = 222.63 6" PVC OUT (SW) = 222.63
SSCO # 2	CLEAN OUT W/ TRAFFIC RATED LID	RIM = 228.70	6" PVC IN (NE) = 222.31 6" PVC OUT (S) = 222.31

**SANITARY SEWER SYSTEM
PIPE TABLE**

PIPE	SIZE	LENGTH	PIPE INFORMATION
1	6"	12 LF	PVC @ 2.00%
2	6"	16 LF	PVC @ 2.00%
3	6"	20 LF	PVC @ 2.00%

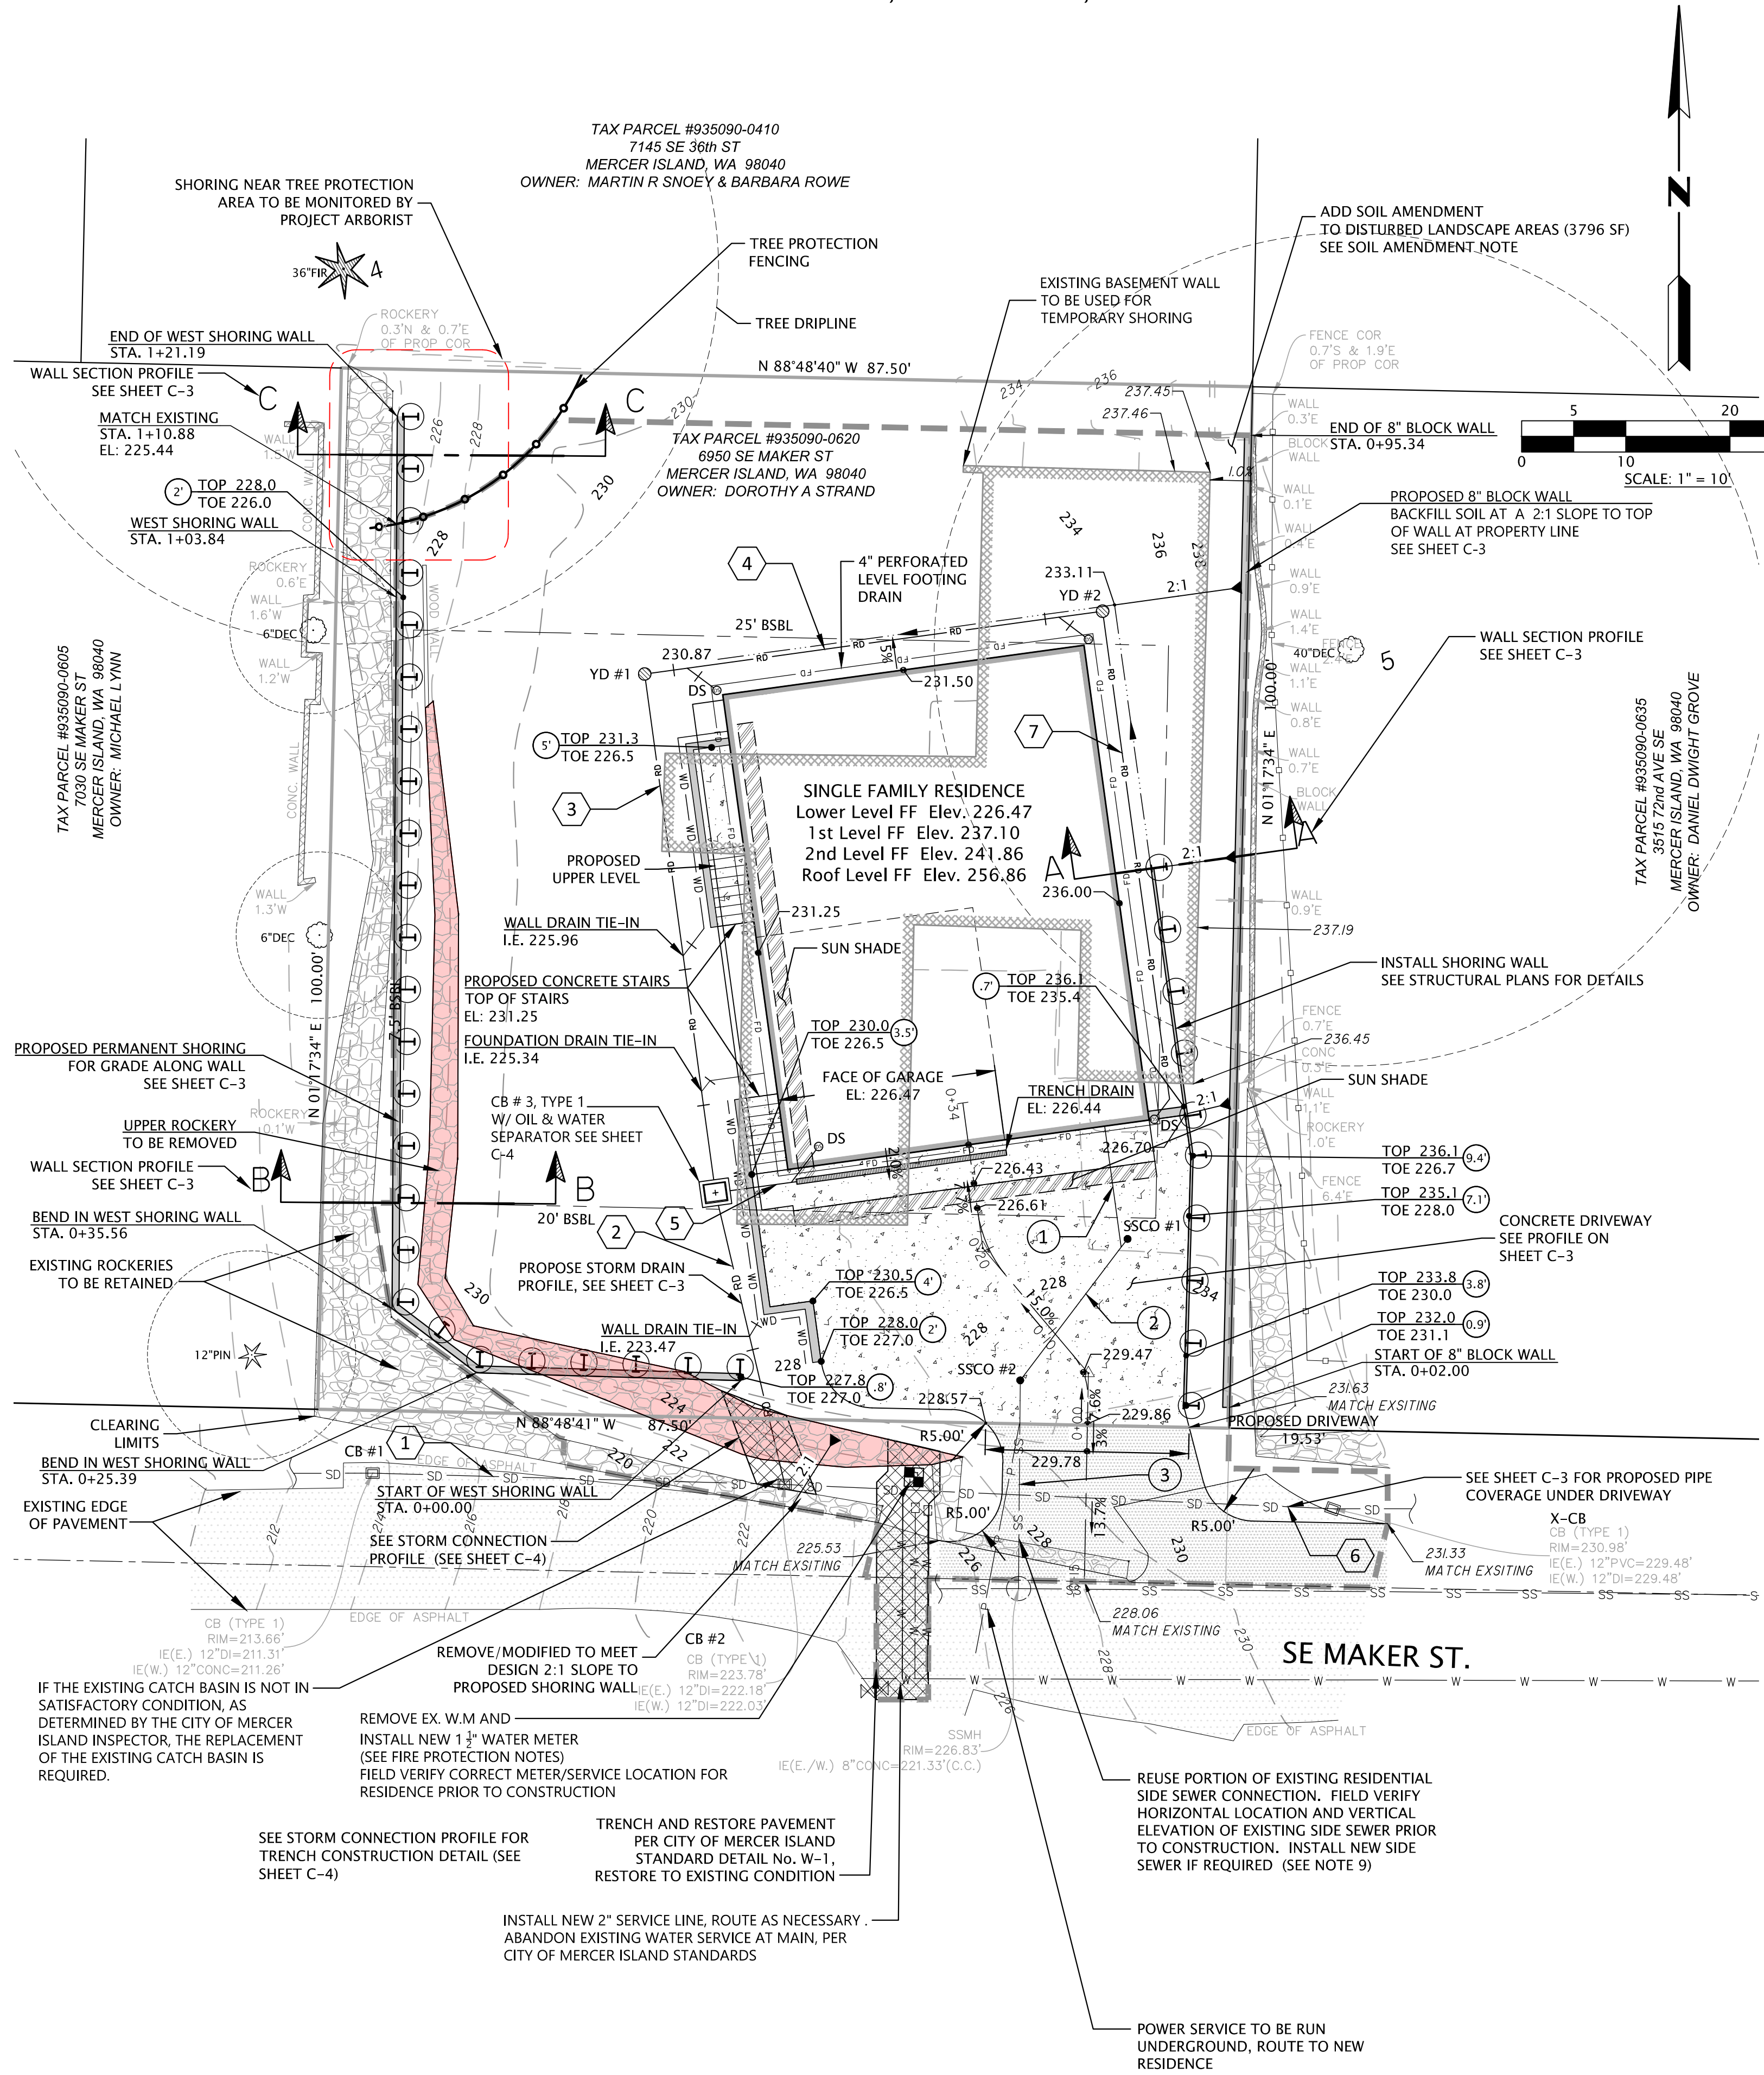

NOTES

- DEMOLISH EXISTING HOUSE, PATIO, DECK, WALKWAY, WALL AND DRIVEWAY PRIOR TO PROPOSED CONSTRUCTION.
- SITE AREA: 8,750 SF (0.20 AC)
- IMPERVIOUS CALCULATIONS:
ON-SITE
HOUSE = 1,888 SF
CONCRETE DRIVEWAY = 804 SF
DECK = 61 SF
STAIRS = 13 SF
RETAINING WALLS = 49 SF
NEW AND REPLACED SUBTOTAL = 2,815 SF
EX. ROCKERY / WALL = 736 SF
TOTAL IMPERVIOUS = 3,537 SF (40% OF LOT AREA)
OFF-SITE
ASPHALT DRIVEWAY = 485 SF
TOTAL PROJECT IMPERVIOUS = 4,022 SF
- EARTHWORK QUANTITY:
CUT = 662.75 CY
FILL = 19.92 CY
- ROOF DRAIN PIPES SHALL MEET MATERIAL STANDARDS FOR SDR35 FOR PVC PIPE AND N-12 FOR SMOOTH-BORE HDPE PIPE.
- FOOTING DRAIN PIPES SHALL MEET MATERIAL STANDARDS FOR D2729 FOR PVC, WITH THE PERFORATIONS DIRECTED DOWNWARD.
- CONTRACTOR SHALL COMPLY WITH THE CITY OF MERCER ISLAND "STORM DRAINAGE REQUIREMENTS" FOR ALL NEW CONSTRUCTION OF DRAINAGE SYSTEM IMPROVEMENTS, INCLUDING ROOF DRAINS, FOOTING DRAINS, AND DRIVEWAY/PARKING AREA DRAINS.
- CONTRACTOR TO COORDINATE EXACT LOCATION OF THE NEW METER WITH THE CITY'S WATER DEPARTMENT DURING CONSTRUCTION.
- THE TV INSPECTION OF THE EXISTING SIDE SEWER TO THE CITY SEWER MAIN ON SE MAKER ST IS REQUIRED PRIOR TO ANY WORK RELATED TO THE SIDE SEWER. IF THE RESULT OF THE TV INSPECTION IS NOT IN SATISFACTORY CONDITION, AS DETERMINED BY THE CITY OF MERCER ISLAND INSPECTOR, THE REPLACEMENT OF THE EXISTING SIDE SEWER IS REQUIRED.

LEGEND (DEVELOPED)

- PROPOSED CONCRETE
- PROPOSED ASPHALT PAVEMENT
- TRENCH RESTORATION
- PROPOSED WALL TO BE REMOVED
- PROPOSED SANITARY SIDE SEWER
- PROPOSED SANITARY SIDE SEWER CLEANOUT
- PROPOSED WATER SERVICE LINE
- PROPOSED WATER METER
- PROPOSED YARD DRAIN
- PROPOSED ROOF DRAIN PIPE
- PROPOSED ROOF DRAIN CLEANOUT
- PROPOSED FOOTING DRAIN PIPE
- PROPOSED FOOTING DRAIN PIPE
- PROPOSED DOWNSPOUT
- PROPOSED CONTOUR LINE
- PROPOSED CATCH BASIN, TYPE I

FIRE PROTECTION NOTES:

- FIRE SPRINKLER REQUIRED
- BUILDER AND FIRE PROTECTION DESIGNER TO CONFIRM METER AND WATER SERVICE SIZE PRIOR TO CONSTRUCTION OF WATER SERVICE

SURVEY NOTE

EXISTING SURVEY INFORMATION SHOWN HEREON IS BASED ON SURVEY BY TERRANE SURVEYING & MAPPING, AND ELECTRONIC DRAWING FILES AS PROVIDED ON 03/25/2022. SURVEY INFORMATION HAS NOT BEEN FIELD VERIFIED BY GOLDSMITH.

TEMPORARY SHORING

TEMPORARY SHORING SHALL BE INSTALLED AT THE DIRECTION OF THE PROJECT GEOTECHNICAL ENGINEER.

SOIL AMENDMENT NOTE

STOCKPILE AND COMPOST AMENDED DISTURBED LANDSCAPED AREAS PER CITY OF MERCER ISLAND POST-CONSTRUCTION SOIL MANAGEMENT
TOP SOIL LAYER SHALL HAVE A MINIMUM DEPTH OF 8" AND A ORGANIC CONTENT OF 5% IN TURF AREAS AND 10% IN PLANTER BEDS. SUBSOIL BELOW TOP SOIL LAYER SHALL BE SCARIFIED TO A DEPTH OF 4" BELOW TOPSOIL LAYER. PLANTER BEDS SHALL BE MULCH WITH 2" OF ORGANIC MATERIAL.
THE LAWN AND LANDSCAPE AREAS ARE REQUIRED TO PROVIDE POST-CONSTRUCTION SOIL QUALITY AND DEPTH IN ACCORDANCE WITH BMP T5.13. THE PROJECT CIVIL ENGINEER MUST PROVIDE A LETTER OF CERTIFICATION TO ENSURE THAT THE LAWN AND LANDSCAPE AREAS ARE MEETING THE POST-CONSTRUCTION SOIL QUALITY AND DEPTH REQUIREMENTS SPECIFIED ON THE APPROVED PLAN SET PRIOR TO FINAL INSPECTION OF THE PROJECT.



GOLDSMITH
LAND DEVELOPMENT SERVICES
11400 SE 8th St, Suite 450, Bellevue, WA 98004 | PO Box 3565, Bellevue, WA 98009
T 425 462 1080 www.goldsmithengineering.com

PLOTTED: 2023/08/25 13:52 Eoregon
DRAWN:
DESIGNED:
APPROVED:
FIELD BOOK:
PAGE #:

08/25/2023
DOROTHY STRAND
REGISTERED PROFESSIONAL ENGINEER
36000


DOROTHY STRAND
GRADING, DRAINAGE AND UTILITY PLAN
FOR
STRAND PROPERTY
6950 SE MAKER ST., CITY OF MERCER ISLAND KING COUNTY, WASHINGTON

JOB NO. 22038
SHEET
C-2


L:\2023\2023-3 DEVELOPMENT\CAD\HOST DRAWINGS\BUILDING PERMIT\22038P01.dwg 23/08/25 13:52

L:\2023\22038\3 DEVELOPMENT\CAD\HOST DRAWINGS\BUILDING PERMIT\22038P01.dwg


NW ¼, SW ¼ SECTION 12, TOWNSHIP 24 N, RANGE 4 E, W.M.
CITY OF MERCER ISLAND, KING COUNTY, WASHINGTON

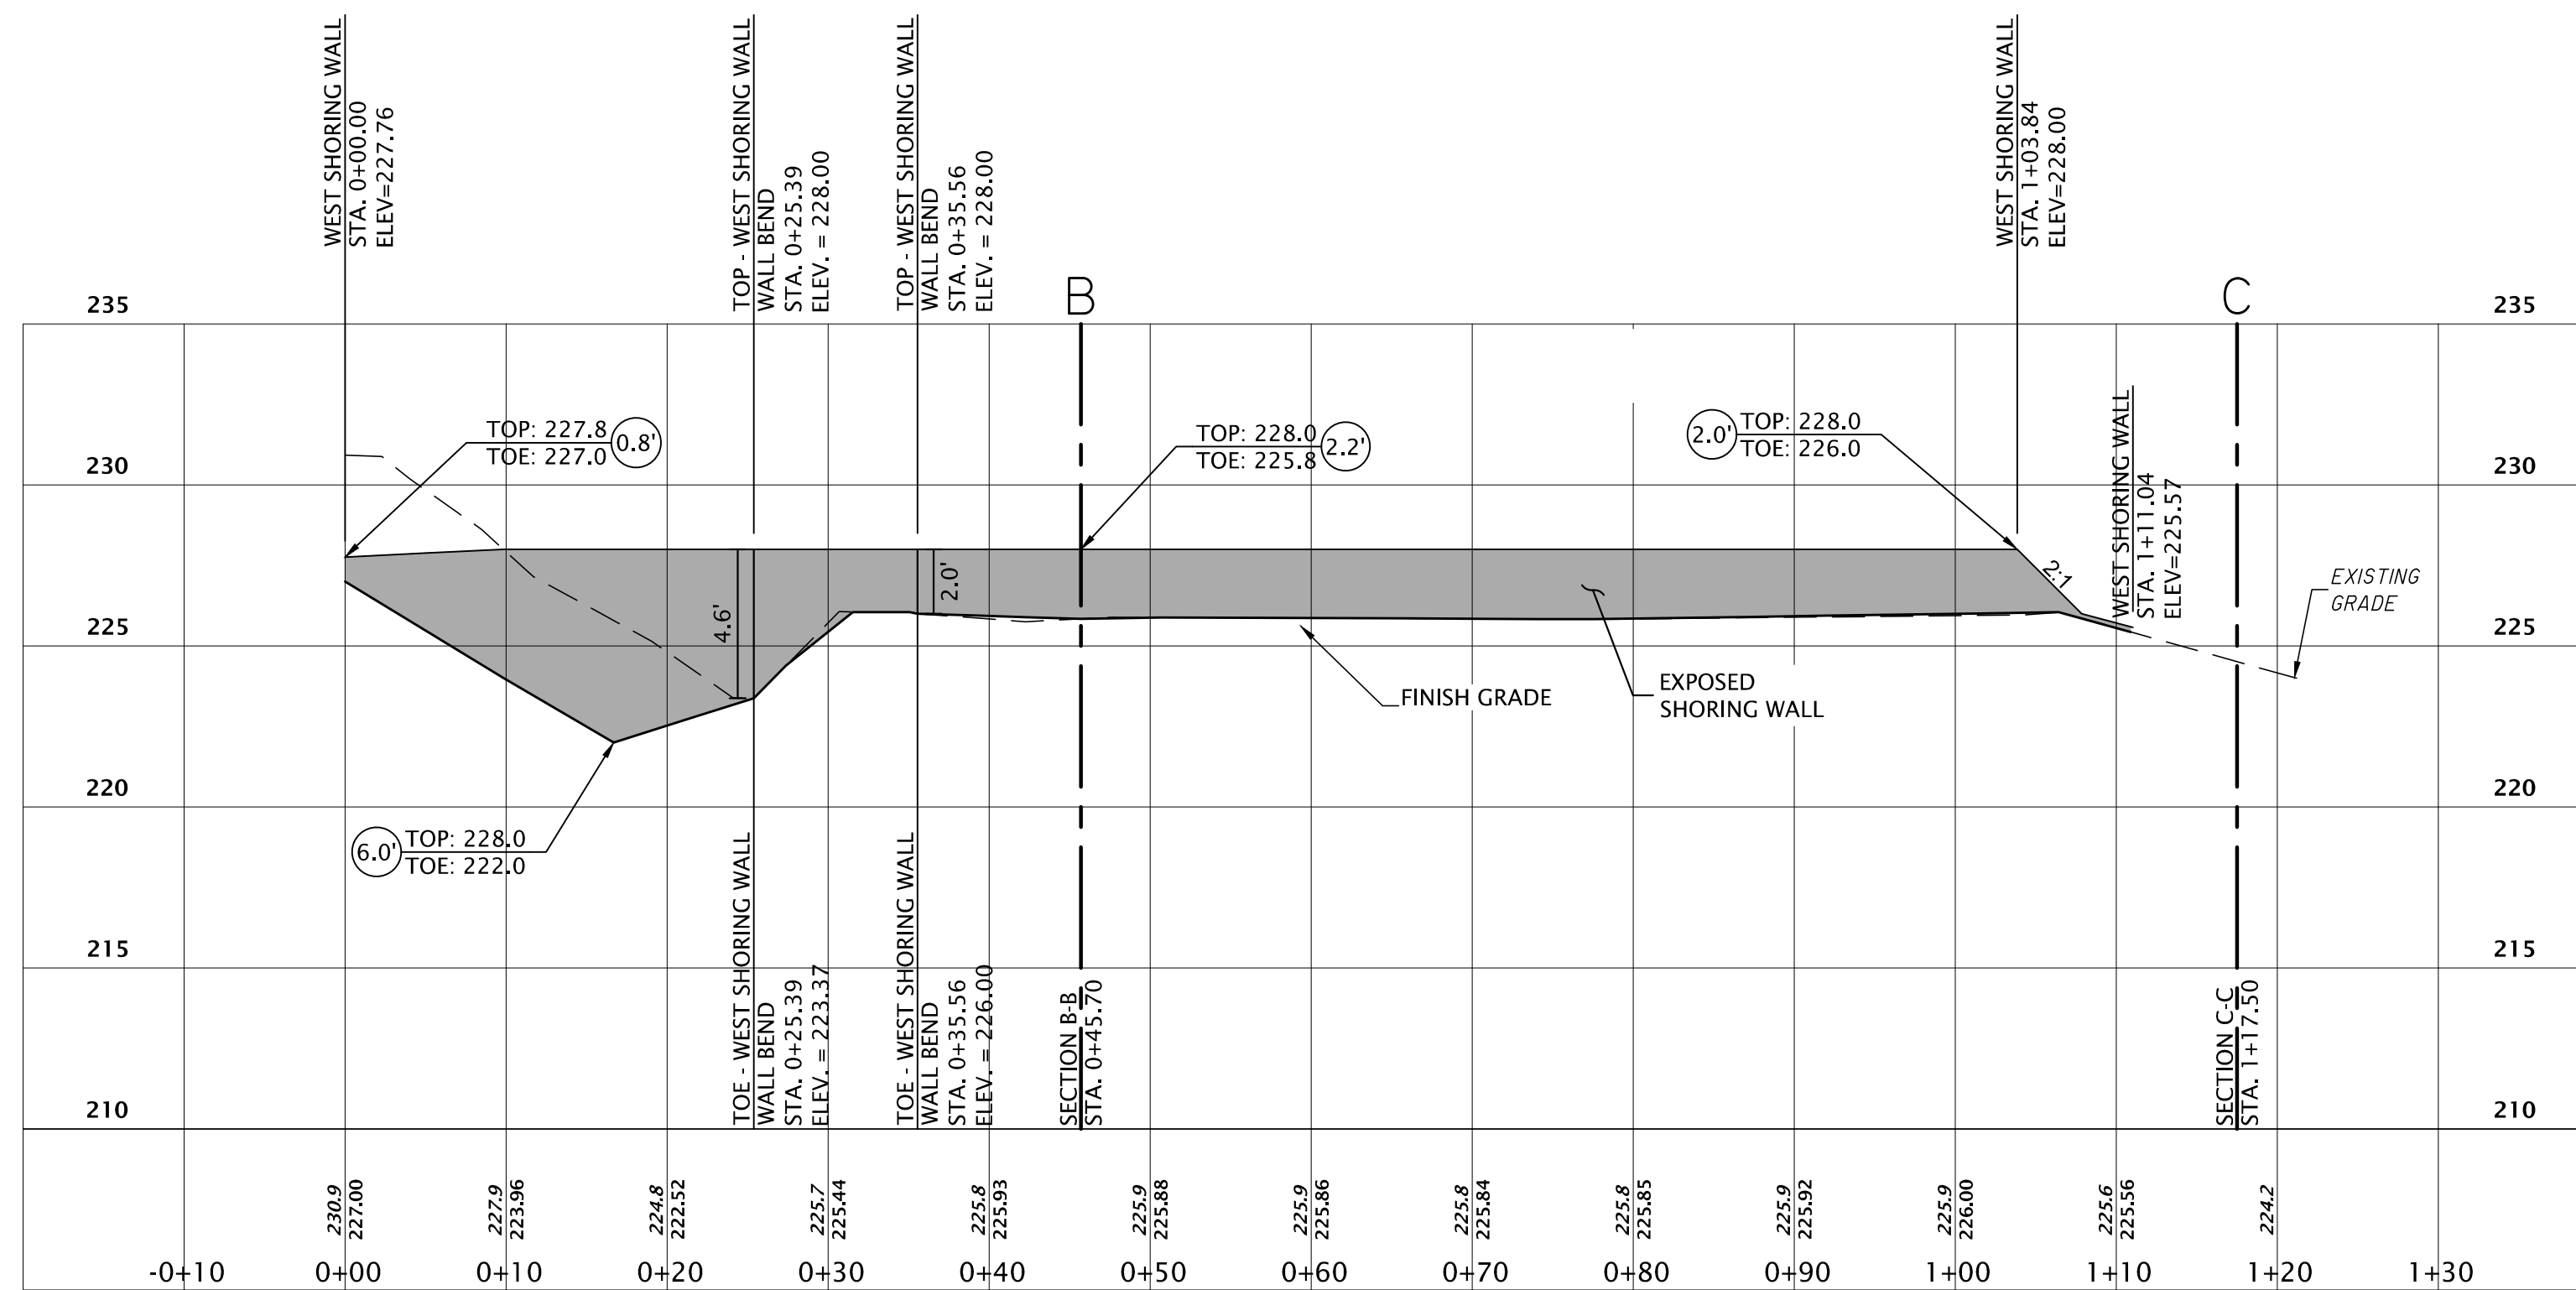

WEST SHORING WALL PROFILE
STA. -0+10.00 TO STA. 1+30.00
1" = 10.00' HORIZ.
1" = 5.00' VERT.

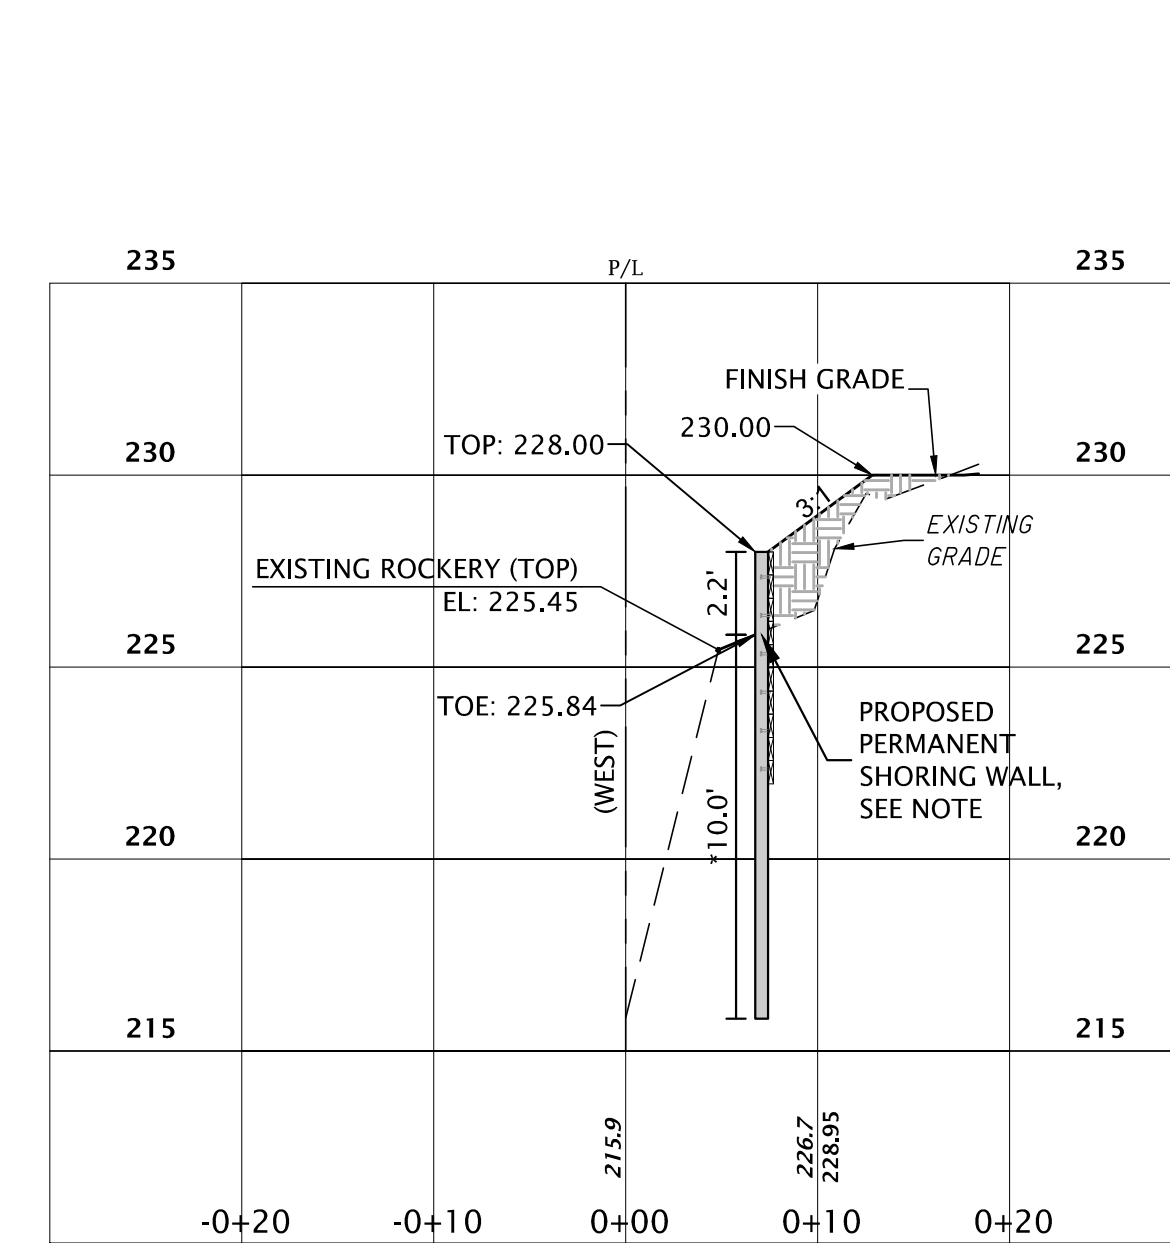


WEST SHORING WALL SECTION B-B PROFILE
STA. -0+20.00 TO STA. 0+20.00
1" = 10.00' HORIZ.
1" = 5.00' VERT.

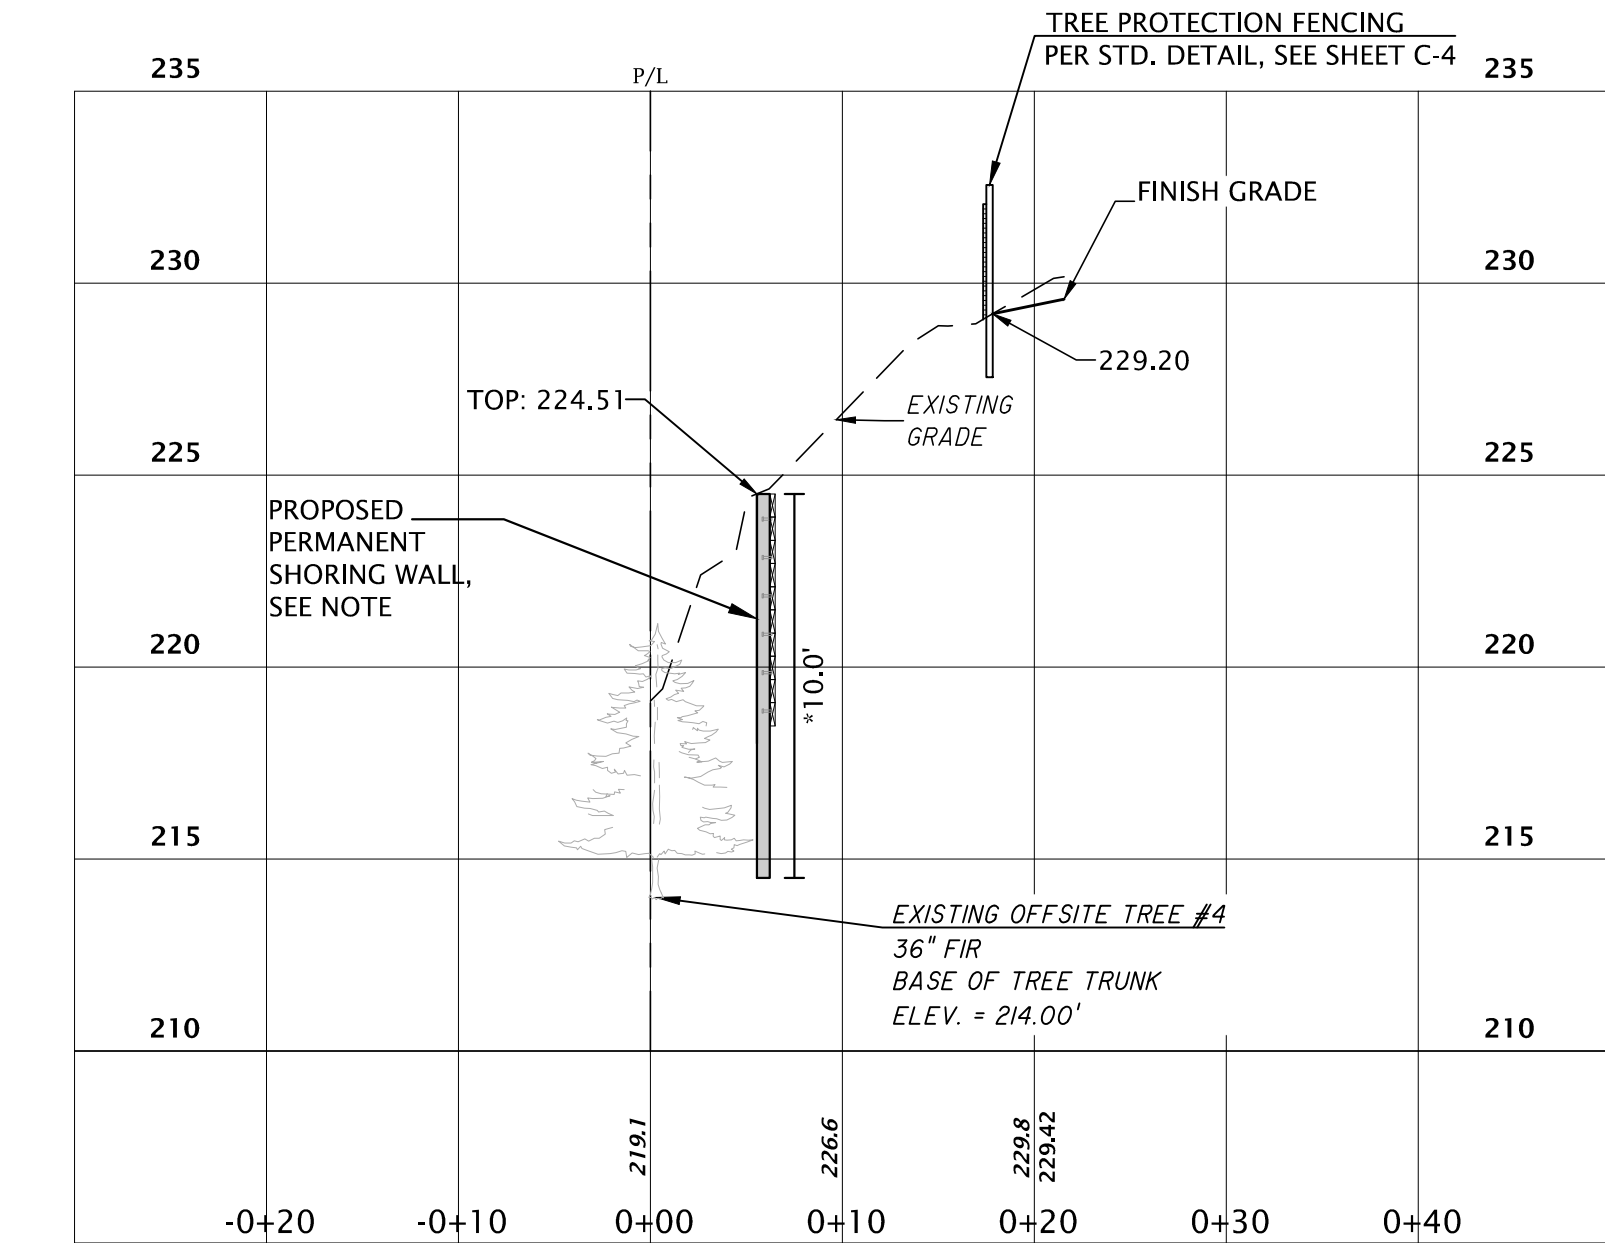


WEST SHORING WALL SECTION C-C PROFILE
STA. -0+20.00 TO STA. 0+40.00
1" = 10.00' HORIZ.
1" = 5.00' VERT.


PERMANENT SHORING WALL NOTES:
*MINIMUM EMBED WALL DEPTH = 10 FEET
REFERENCE PERMANENT SHORING PLANS

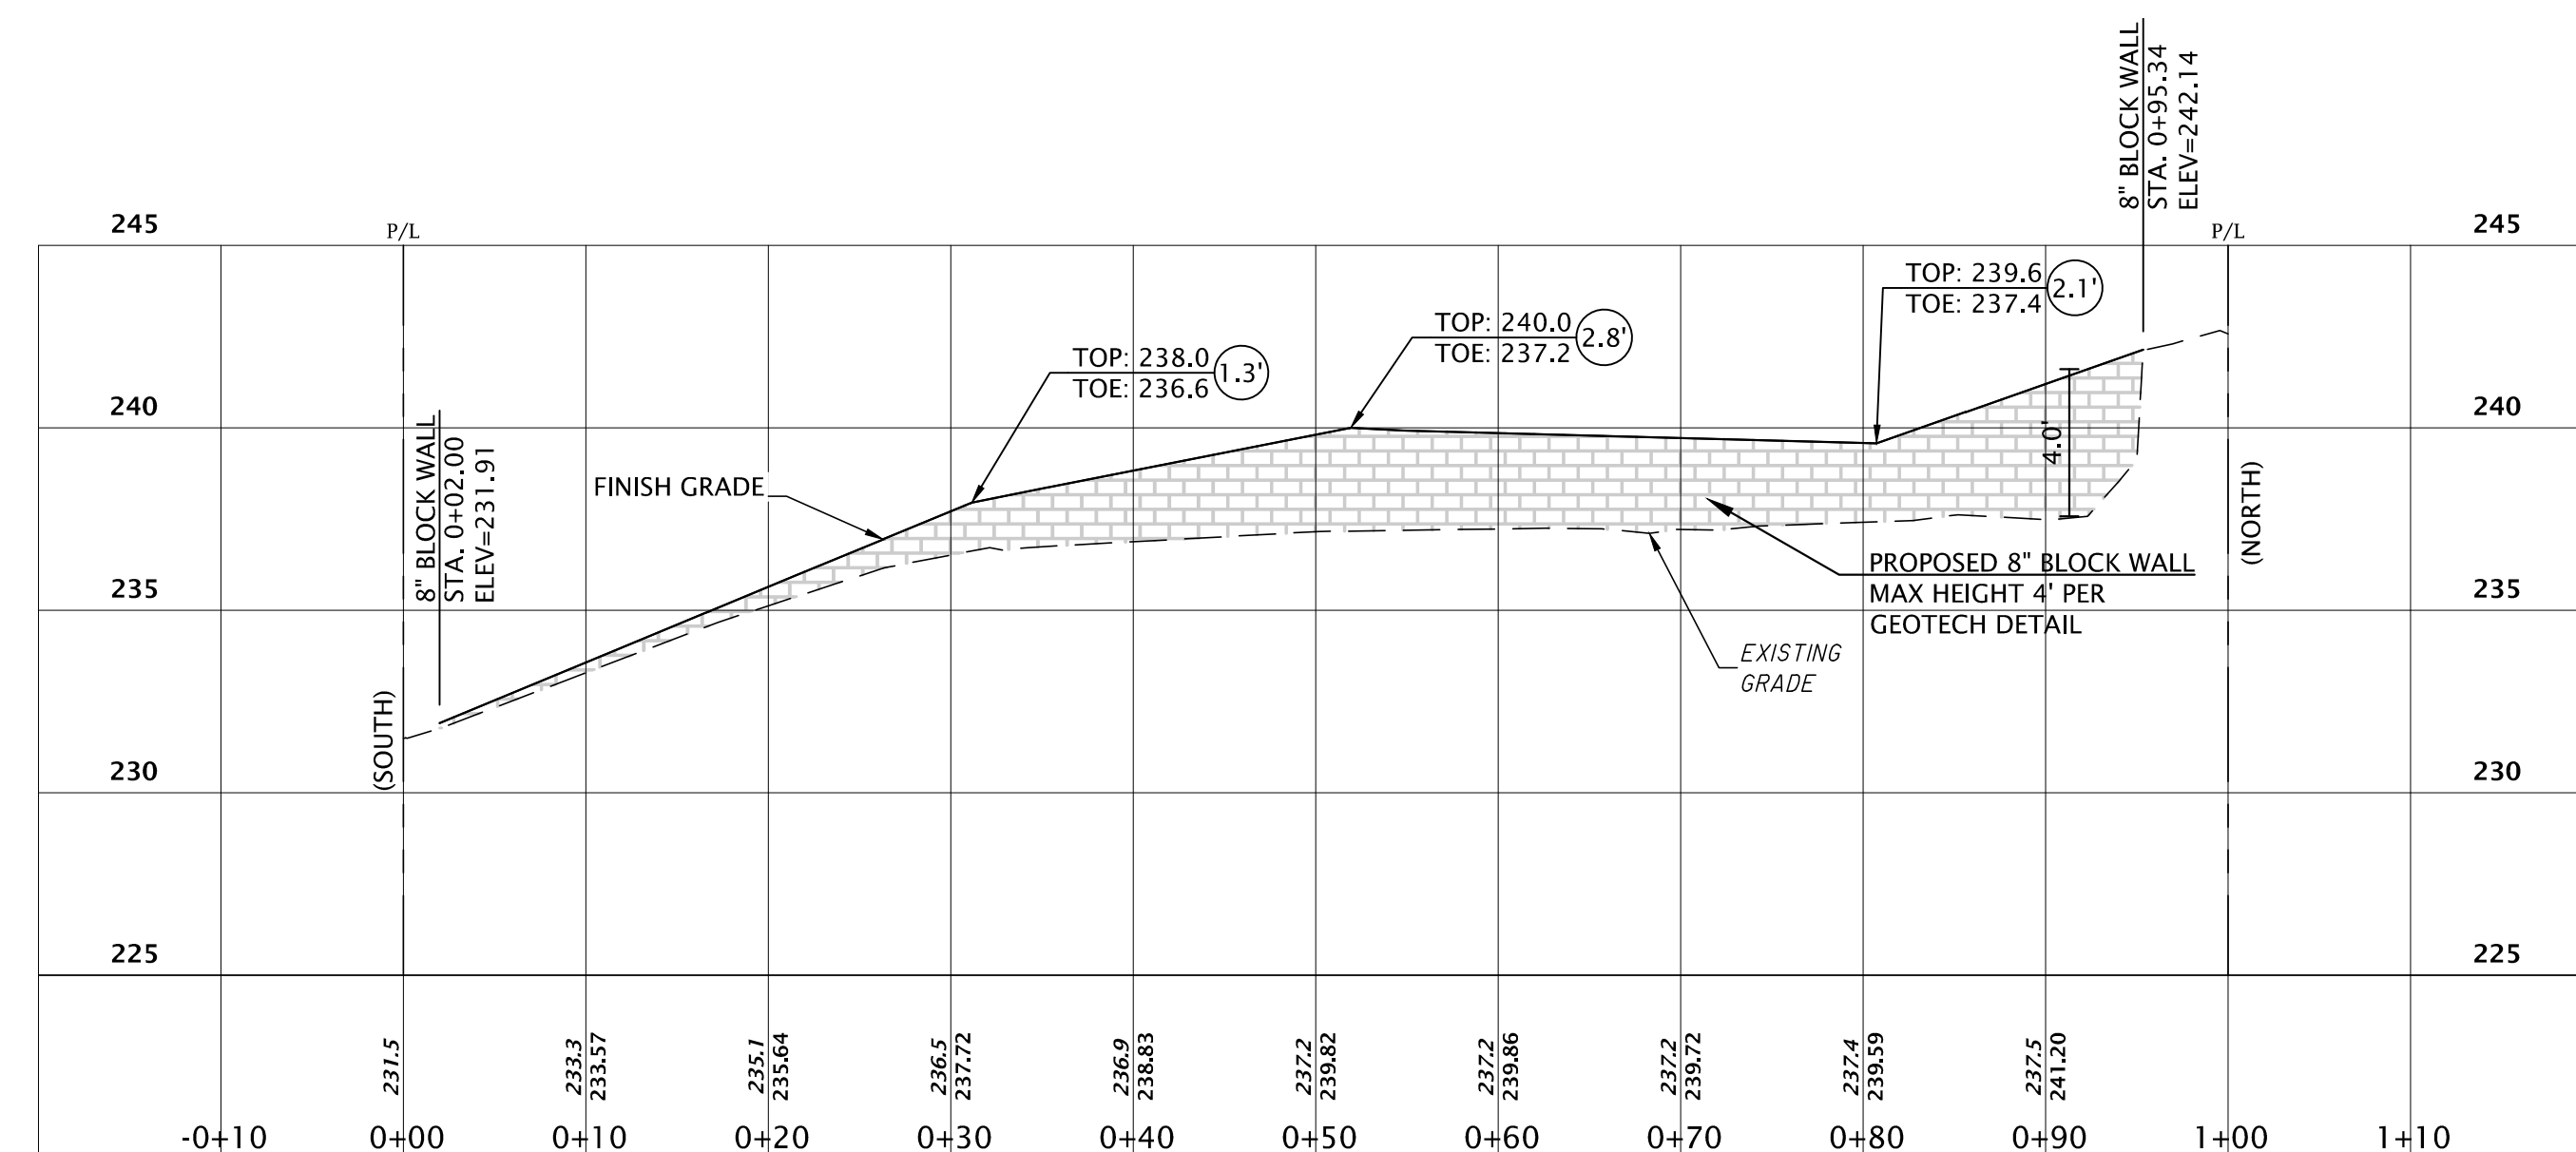

EAST PROPERTY LINE PROFILE
STA. -0+10.00 TO STA. 1+10.00
1" = 10.00' HORIZ.
1" = 5.00' VERT.

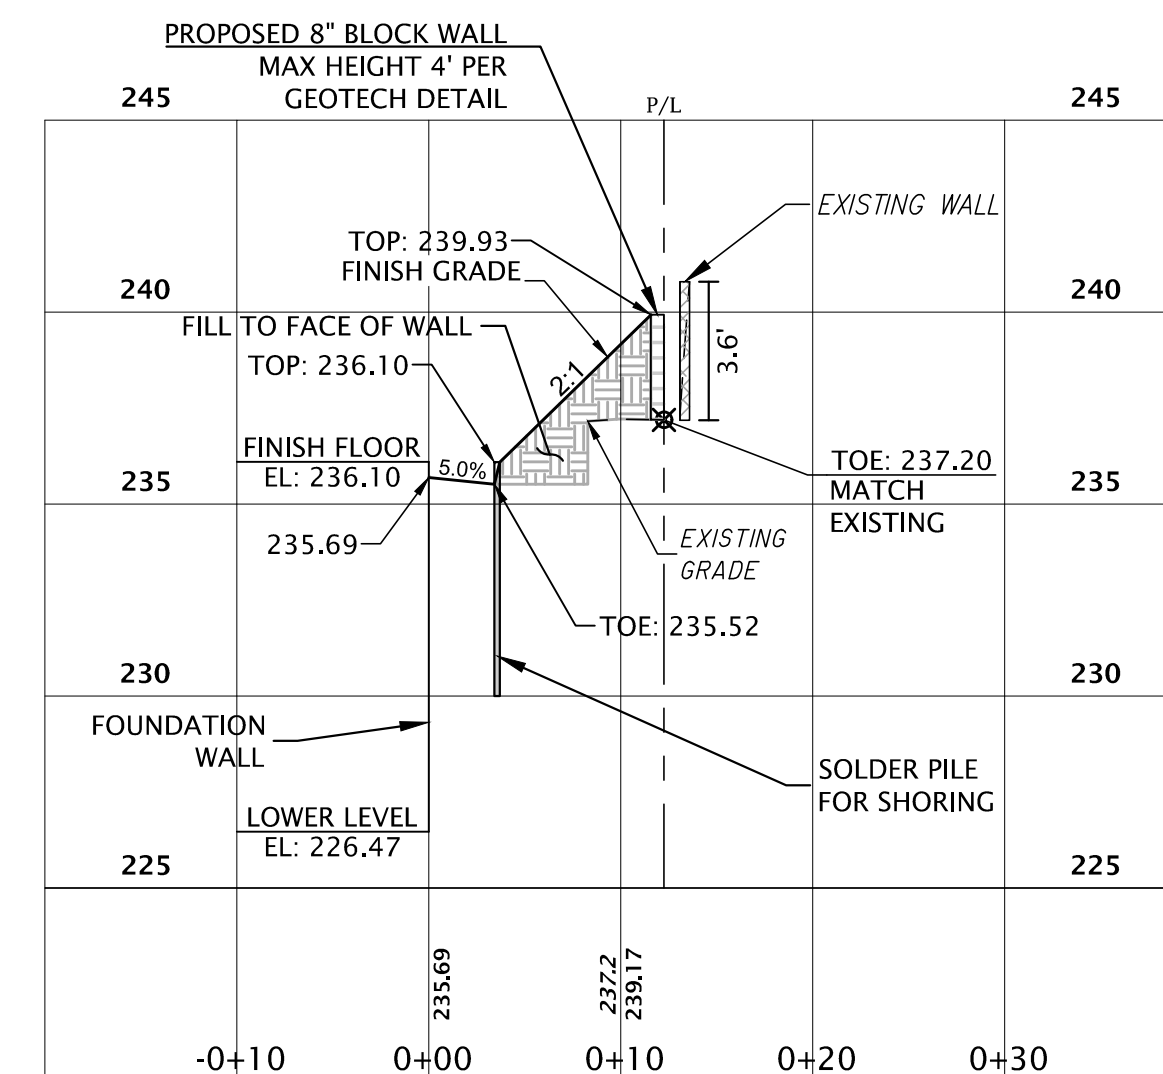


WALL SECTION A-A PROFILE
STA. -0+10.00 TO STA. 0+30.00
1" = 10.00' HORIZ.
1" = 5.00' VERT.

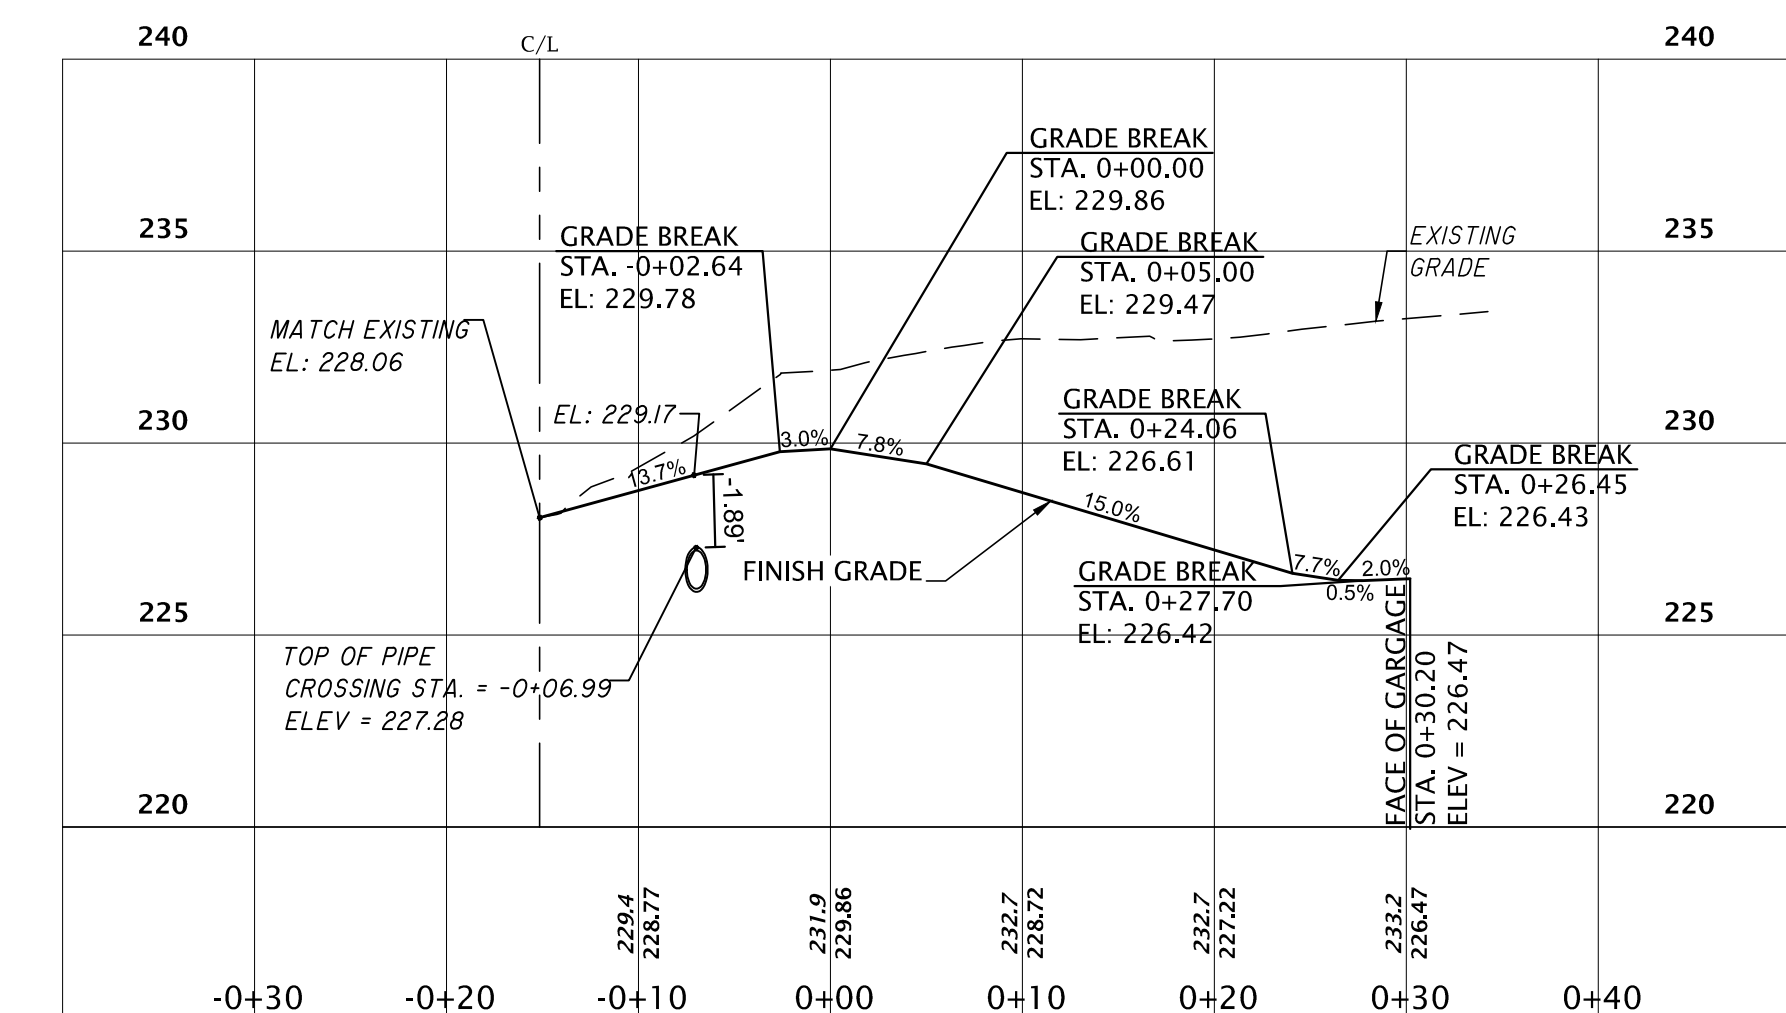

PROPOSE DRIVEWAY PROFILE
STA. -0+30.00 TO STA. 0+40.00
1" = 10.00' HORIZ.
1" = 5.00' VERT.



NW ¼, SW ¼ SECTION 12, TOWNSHIP 24 N, RANGE 4 E, W.M.
CITY OF MERCER ISLAND, KING COUNTY, WASHINGTON

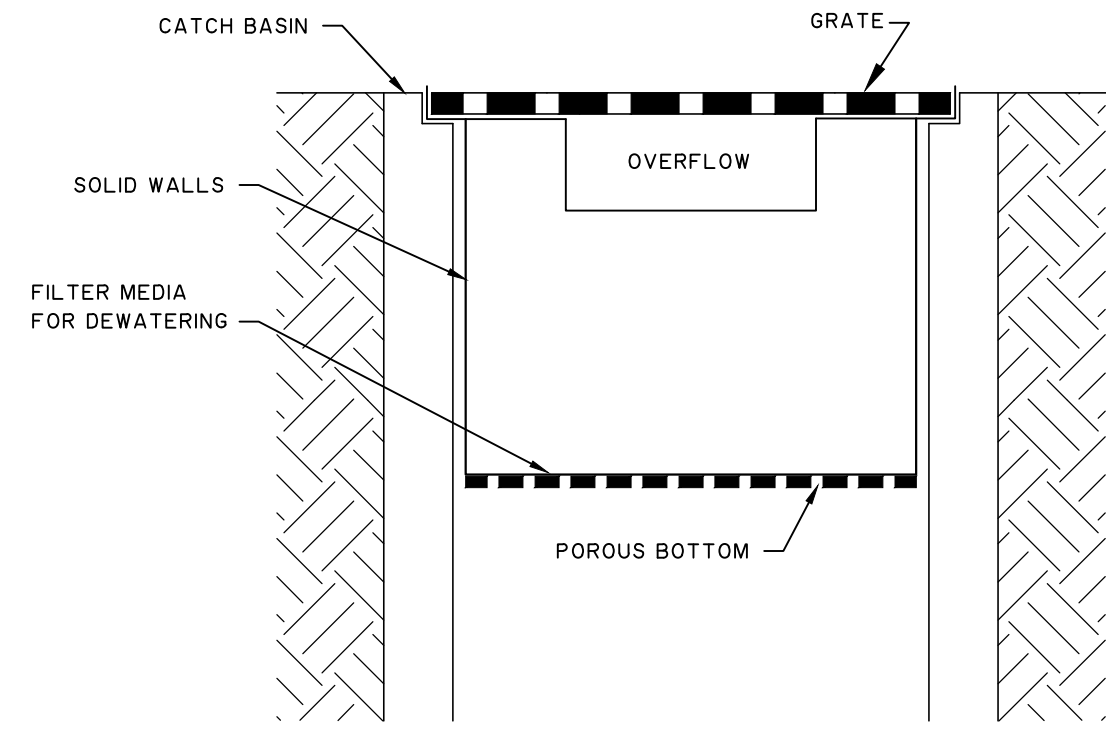


NOTE: THIS DETAIL IS ONLY SCHEMATIC. ANY INSERT IS ALLOWED THAT HAS A MIN. 0.5 C.F. OF STORAGE, THE MEANS TO DEWATER THE STORED SEDIMENT, AN OVERFLOW, AND CAN BE EASILY MAINTAINED.

MAINTENANCE STANDARDS

1. ANY ACCUMULATED SEDIMENT ON OR AROUND THE FILTER FABRIC PROTECTION SHALL BE REMOVED IMMEDIATELY. SEDIMENT SHALL NOT BE REMOVED WITH WATER, AN ALL SEDIMENT MUST BE DISPOSED OF AS FILL ON-SITE OR HAULED OFF-SITE.
2. ANY SEDIMENT IN THE CATCH BASIN INSERT SHALL BE REMOVED WHEN THE SEDIMENT HAS FILLED ONE-THIRD OF THE AVAILABLE STORAGE. THE FILTER MEDIA FOR THE INSERT SHALL BE CLEANED OR REPLACED AT LEAST MONTHLY.
3. REGULAR MAINTENANCE IS CRITICAL FOR BOTH FORMS OF CATCH BASIN PROTECTION. UNLIKE MANY FORMS OF PROTECTION THAT FAIL GRADUALLY, CATCH BASIN PROTECTION WILL FAIL SUDDENLY AND COMPLETELY IF NOT MAINTAINED PROPERLY.

CATCH BASIN INSERT DETAIL

NTS

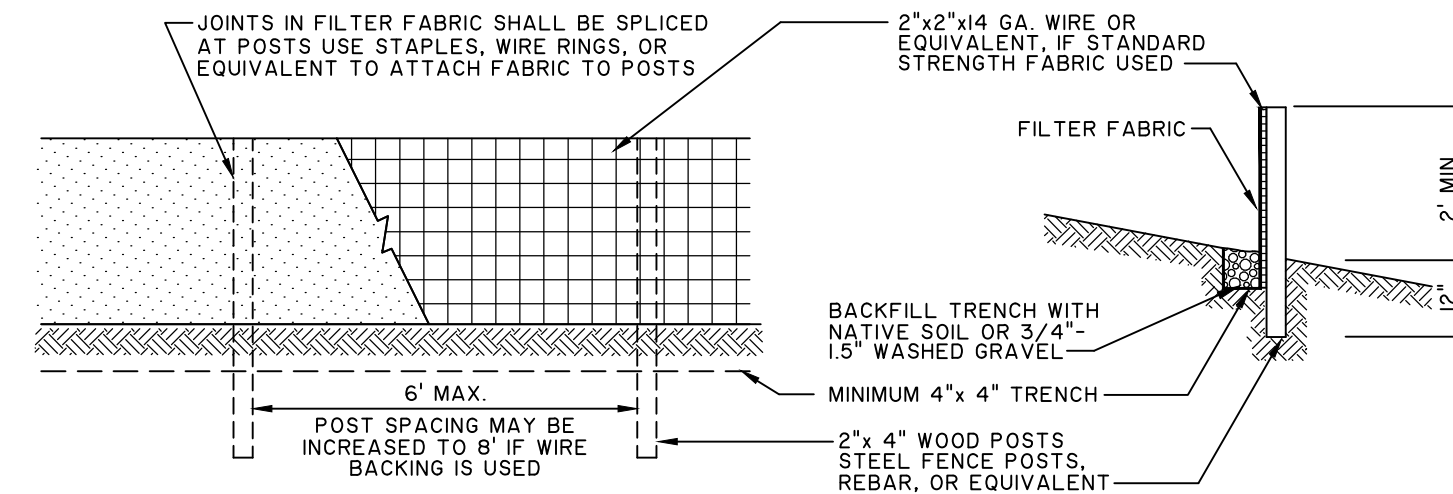


NOTE: FILTER FABRIC FENCES SHALL BE INSTALLED ALONG CONTOUR WHENEVER POSSIBLE.

MAINTENANCE STANDARDS

1. ANY DAMAGE SHALL BE REPAIRED IMMEDIATELY.
2. IF CONCENTRATED FLOWS ARE EVIDENT UPHILL OF THE FENCE, THEY MUST BE INTERCEPTED AND CONVEYED TO A SEDIMENT TRAP OR POND.
3. IT IS IMPORTANT TO CHECK THE UPHILL SIDE OF THE FENCE FOR SIGNS OF THE FENCE CLOGGING AND ACTING AS A BARRIER TO FLOW AND THEN CAUSING CHANNELIZATION OF FLOWS PARALLELED TO THE FENCE. IF THIS OCCURS, REPLACE THE FENCE AND/OR REMOVE THE TRAPPED SEDIMENT.
4. SEDIMENT MUST BE REMOVED WHEN THE SEDIMENT IS 6" HIGH.
5. IF THE FILTER FABRIC HAS DETERIORATED DUE TO ULTRAVIOLET BREAKDOWN, IT SHALL BE REPLACED.

SILT FENCE

NTS

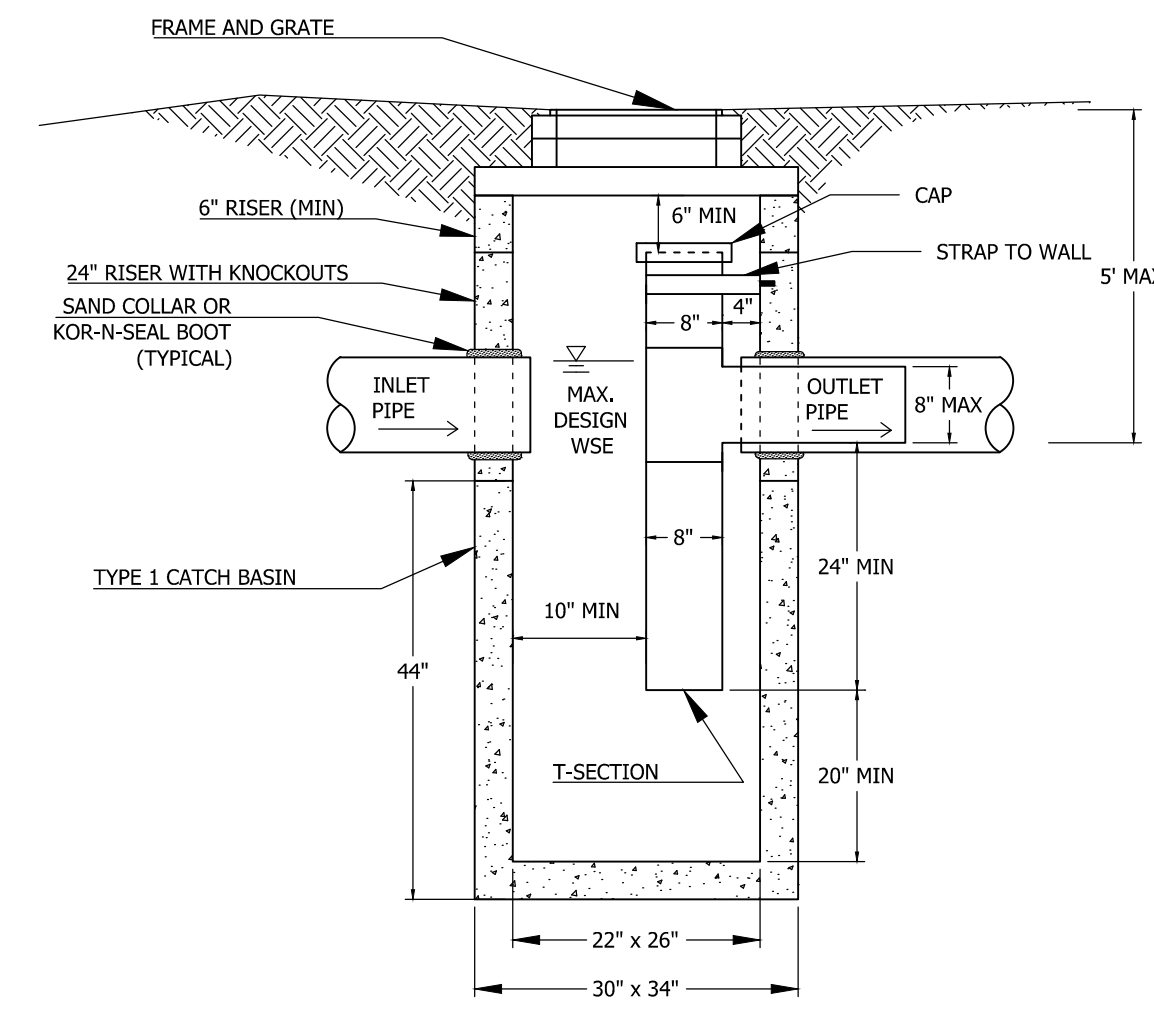

NOTES


1. MAX. OUTLET PIPE DIAMETER IS 8 INCHES. VERTICAL RISER SECTION SHALL BE ALIGNED PLUMB VERTICALLY. HORIZONTAL RISER SECTION SHALL MATCH OUTLET PIPE SLOPE.
2. ALL METAL PARTS AND SURFACES MUST BE CORROSION RESISTANT. STEEL HARDWARE SHALL BE GALVANIZED. PIPES SHALL BE PVC. COMPLETE CORROSION PROTECTION MUST BE ASSURED.
3. APPLY NON-SHRINK GROUT TO INSIDE AND OUTSIDE OF ALL JOINTS, RINGS, RISERS AND FRAMES.
4. SLIP SMOOTH-BORE HORIZONTAL LEG OF FLOW CONTROL TEE INSIDE CARRIER PIPE.
5. NO FLOW CONTROL JOINT OUTSIDE OF STRUCTURE.

CB TYPE 1 W/ OIL & WATER SEPARATOR

NTS


STANDARD TESC PLAN NOTES:

1. APPROVAL OF THIS EROSION/SEDIMENTATION CONTROL (ESC) PLAN DOES NOT CONSTITUTE AN APPROVAL OF PERMANENT ROAD OR DRAINAGE DESIGN (E.G. SIZE AND LOCATION OF ROADS, PIPES, RESTRICTORS, CHANNELS, RETENTION FACILITIES, UTILITIES, ETC.).
2. THE IMPLEMENTATION OF THESE ESC PLANS AND THE CONSTRUCTION, MAINTENANCE, REPLACEMENT, AND UPGRADING OF THESE ESC FACILITIES IS THE RESPONSIBILITY OF THE APPLICANT/CONTRACTOR UNTIL ALL CONSTRUCTION IS COMPLETED AND APPROVED AND VEGETATION/LANDSCAPING IS ESTABLISHED.
3. THE BOUNDARIES OF THE CLEARING LIMITS SHOWN ON THIS PLAN SHALL BE CLEARLY FLAGGED IN THE FIELD PRIOR TO CONSTRUCTION. DURING THE CONSTRUCTION PERIOD, NO DISTURBANCE BEYOND THE FLAGGED CLEARING LIMITS SHALL BE PERMITTED. THE FLAGGING SHALL BE MAINTAINED BY THE APPLICANT/CONTRACTOR FOR THE DURATION OF CONSTRUCTION.
4. THE ESC FACILITIES SHOWN ON THIS PLAN MUST BE CONSTRUCTED IN CONJUNCTION WITH ALL CLEARING AND GRADING ACTIVITIES, AND IN SUCH A MANNER AS TO INSURE THAT SEDIMENT AND SEDIMENT LADEN WATER DO NOT ENTER THE DRAINAGE SYSTEM, ROADWAYS, OR VIOLATE APPLICABLE WATER STANDARDS.
5. THE ESC FACILITIES SHOWN ON THIS PLAN ARE THE MINIMUM REQUIREMENTS FOR ANTICIPATED SITE CONDITIONS. DURING THE CONSTRUCTION PERIOD, THESE ESC FACILITIES SHALL BE UPGRADED AS NEEDED FOR UNEXPECTED STORM EVENTS AND TO INSURE THAT SEDIMENT AND SEDIMENT-LADEN WATER DO NOT LEAVE THE SITE.
6. THE ESC FACILITIES SHALL BE INSPECTED DAILY BY THE APPLICANT/CONTRACTOR AND MAINTAINED AS NECESSARY TO ENSURE THEIR CONTINUED FUNCTIONING.
7. THE ESC FACILITIES ON INACTIVE SITES SHALL BE INSPECTED AND MAINTAINED A MINIMUM OF ONCE A MONTH OR WITHIN THE 48 HOURS FOLLOWING A MAJOR STORM EVENT.
8. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE WITHIN A TRAPPED CATCH BASIN. ALL CATCH BASINS AND CONVEYANCE LINES SHALL BE CLEANED PRIOR TO PAVING. THE CLEANING OPERATION SHALL NOT FLUSH SEDIMENT LADEN WATER INTO THE DOWNSTREAM SYSTEM.
9. STABILIZED CONSTRUCTION ENTRANCES SHALL BE INSTALLED AT THE BEGINNING OF CONSTRUCTION AND MAINTAINED FOR THE DURATION OF THE PROJECT. ADDITIONAL MEASURES MAY BE REQUIRED TO INSURE THAT ALL PAVED AREAS ARE KEPT CLEAN FOR THE DURATION OF THE PROJECT.

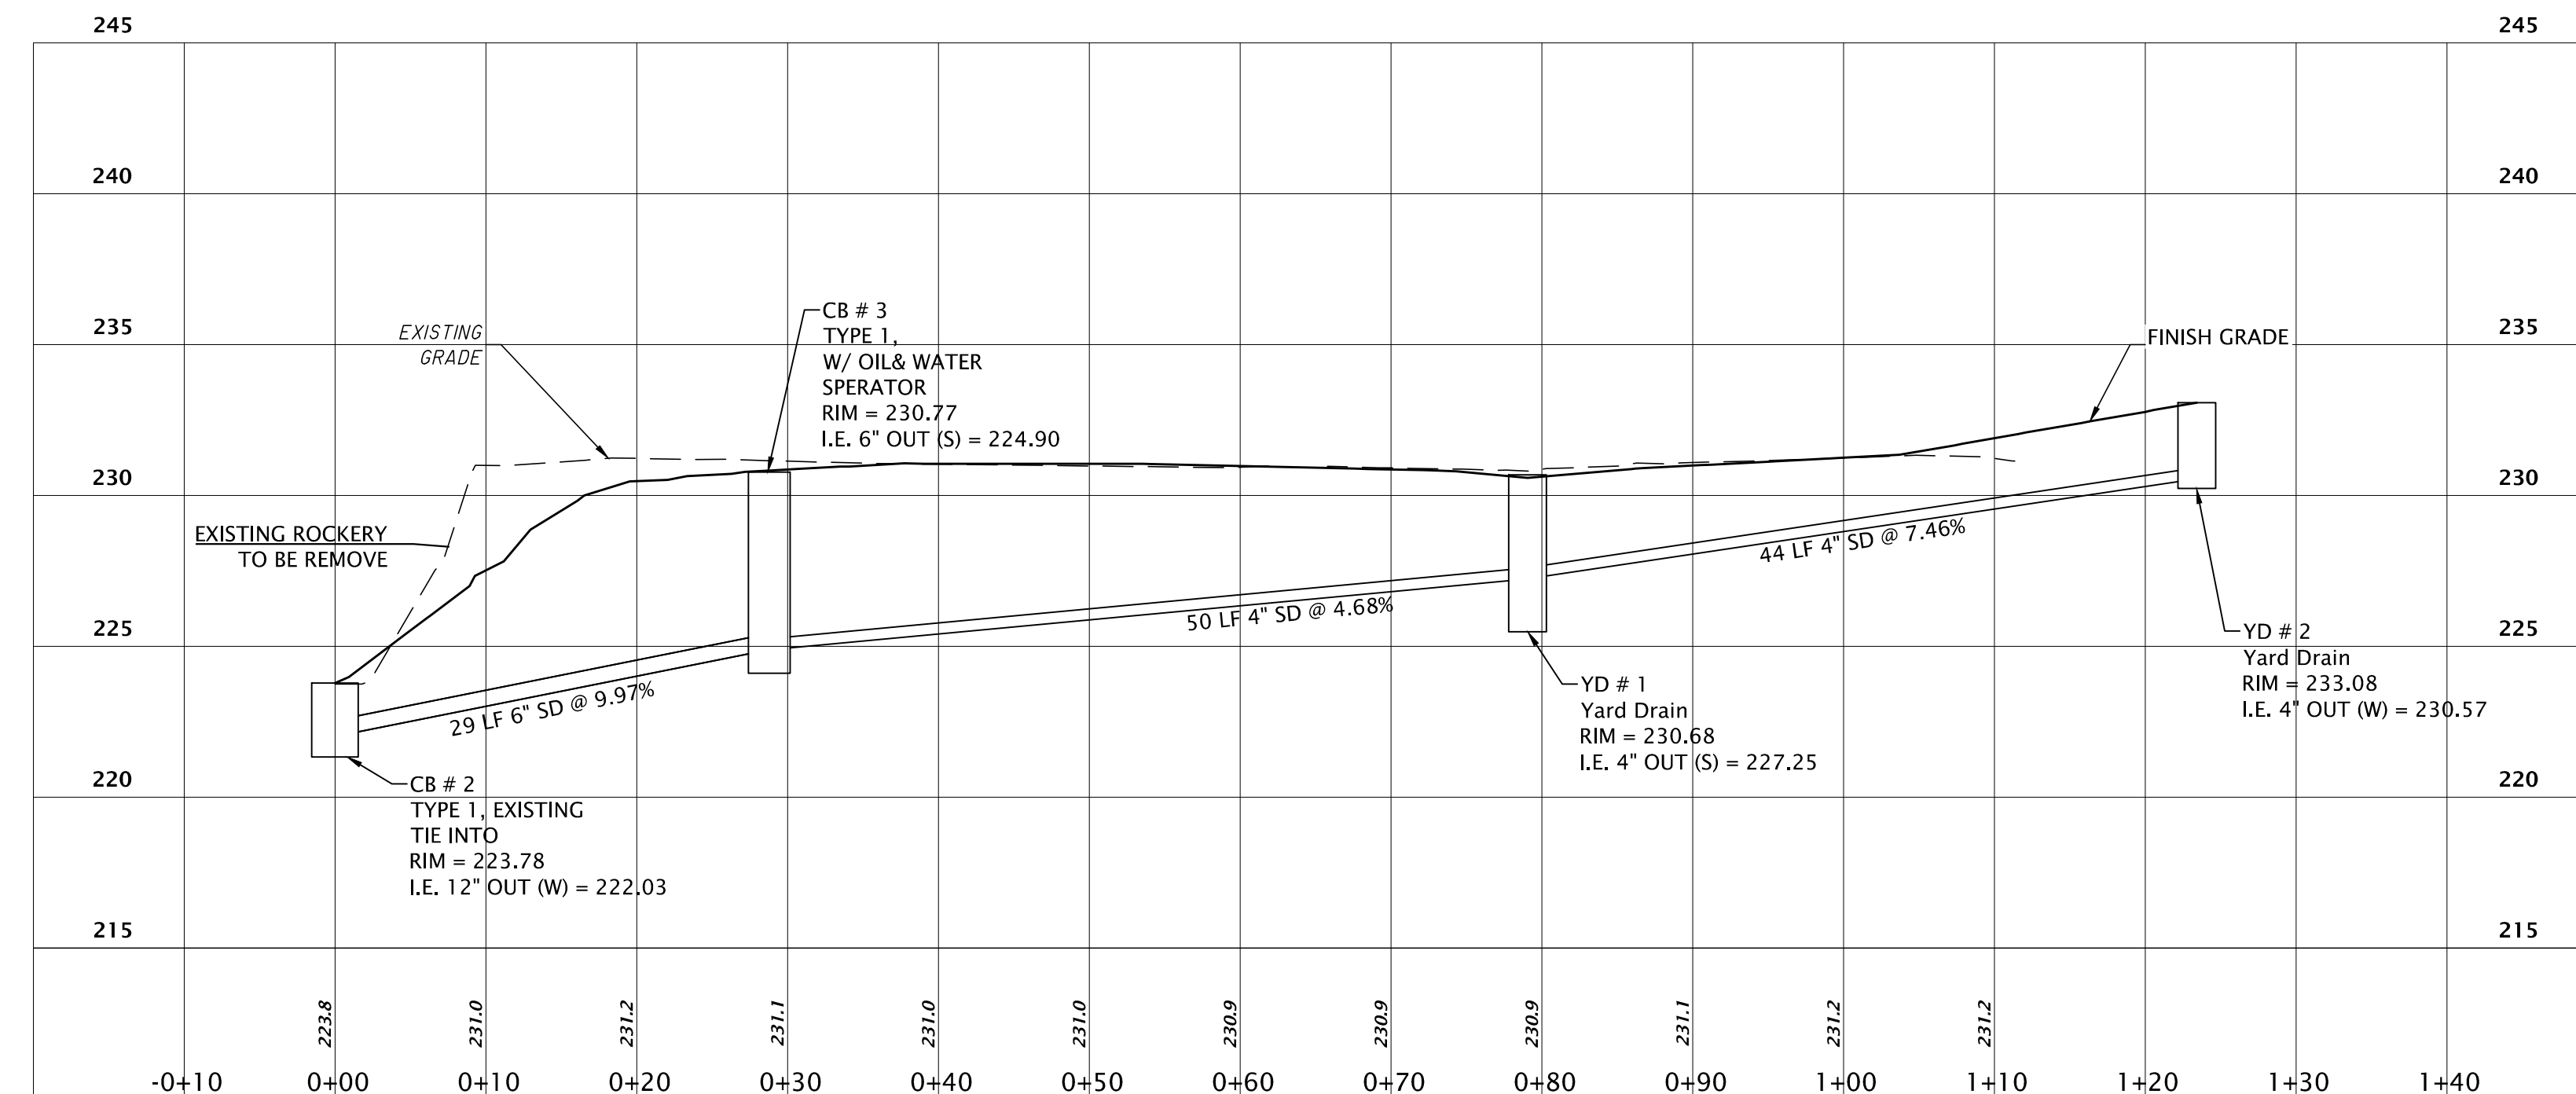

PROPOSE RESIDENTIAL STORM DRAIN CONNECTION PROFILE

STA. -0+10.00 TO STA. 1+40.00
1"=10.00' HORIZ.
1"=5.00' VERT.

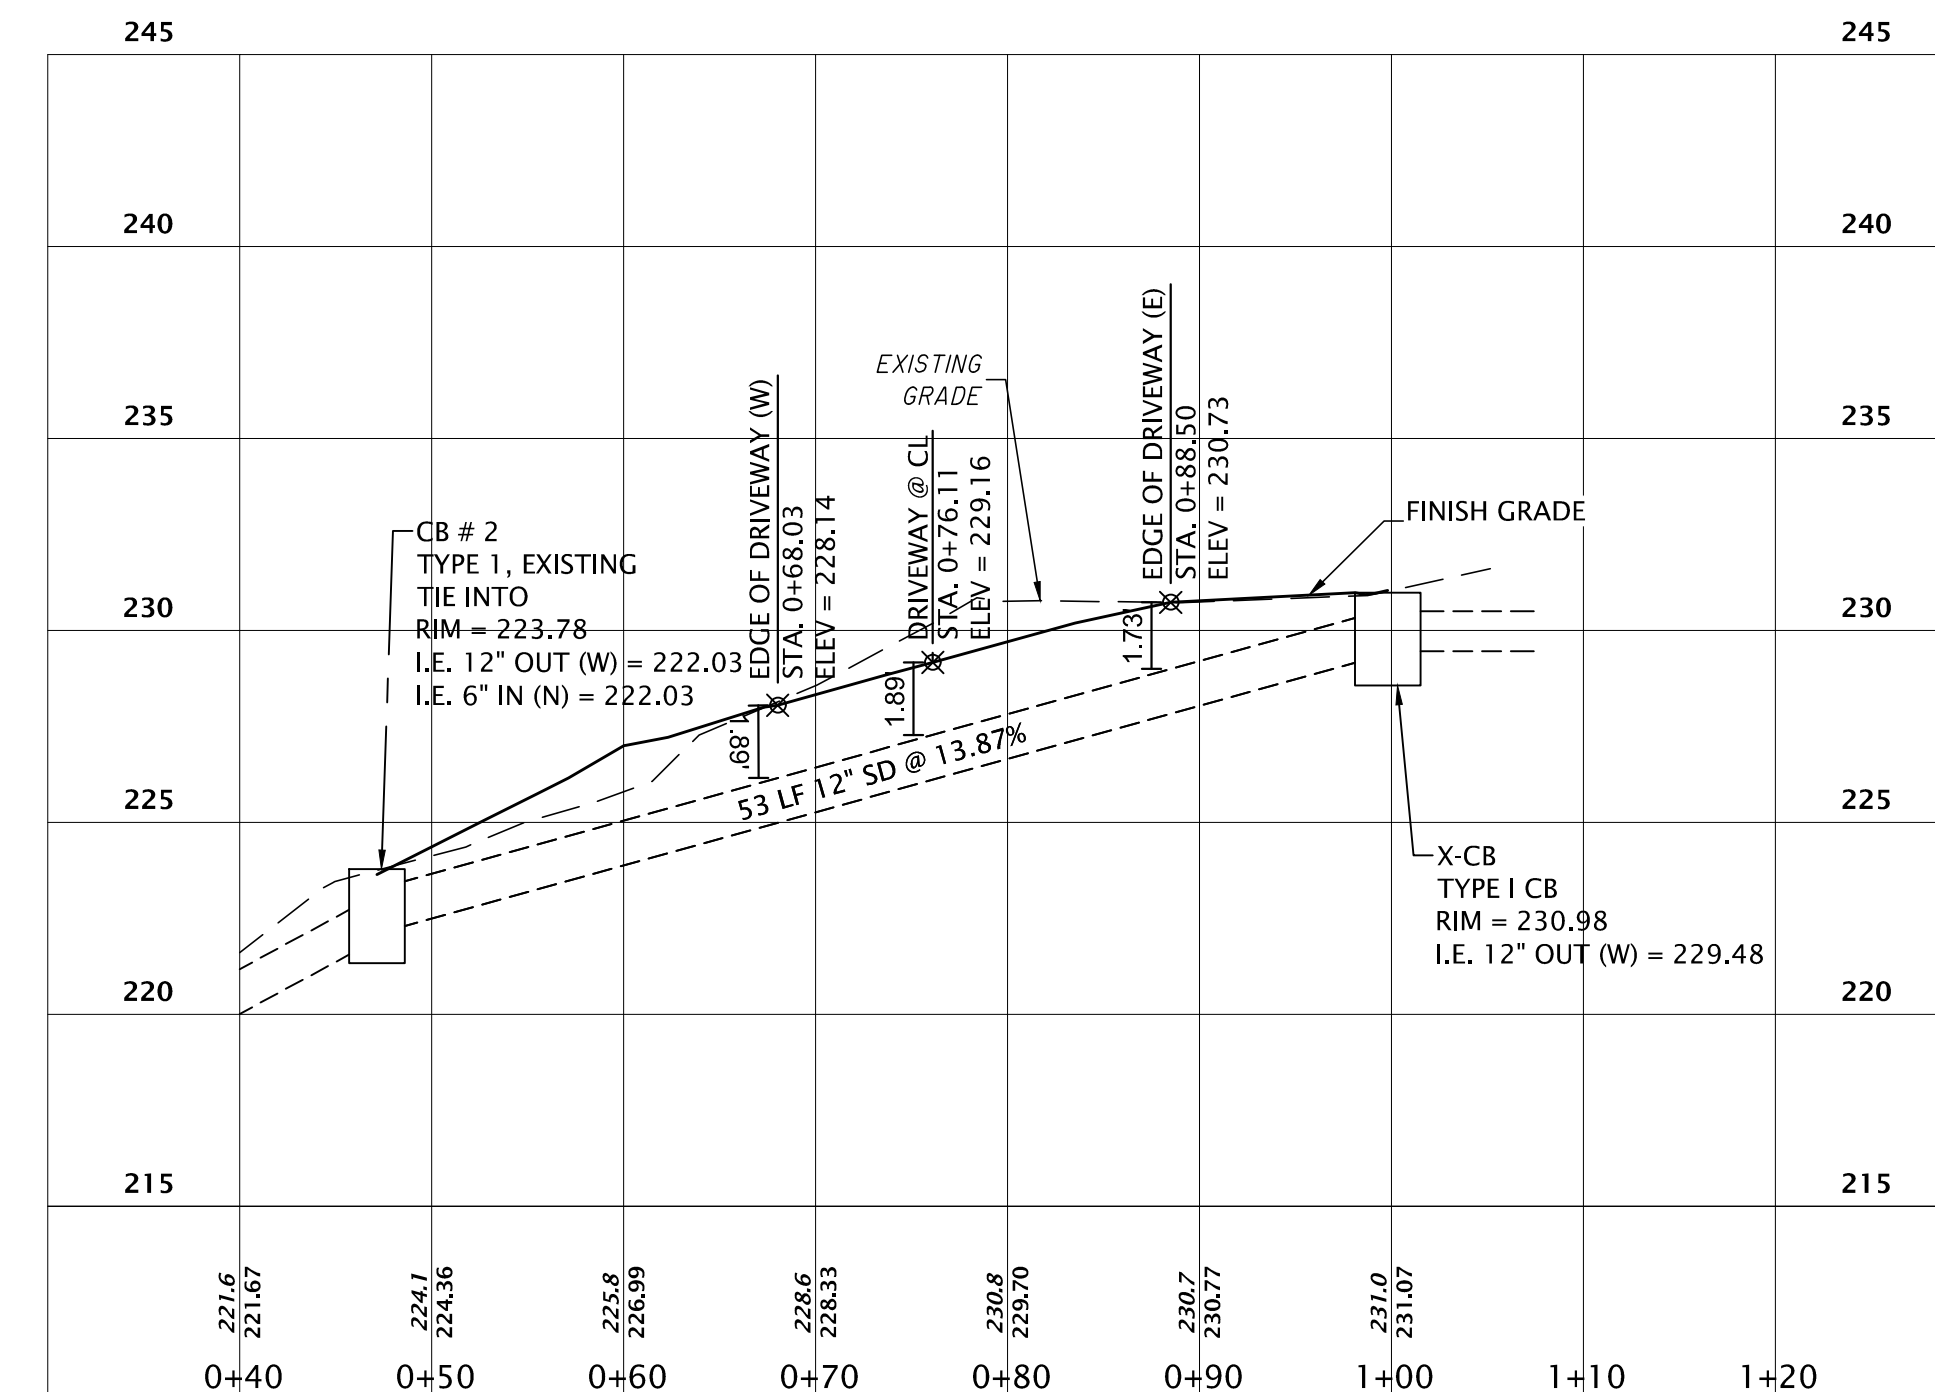

EXISTING SE MARKER ST. STORM PROFILE

STA. 0+40.00 TO STA. 1+20.00
1"=10.00' HORIZ.
1"=5.00' VERT.

