

Simple Heating System Size: Washington State

This heating system sizing calculator is based on the Prescriptive Requirements of the 2015 Washington State Energy Code (WSEC) and ACCA Manuals J and S. This calculator will calculate heating loads only. ACCA procedures for sizing cooling systems should be used to determine cooling loads.

The glazing (window) and door portion of this calculator assumes the installed glazing and door products have an area weighted average U-factor of 0.30. The incorporated insulation requirements are the minimum prescriptive amounts specified by the 2015 WSEC.

Please fill out all of the green drop-downs and boxes that are applicable to your project. As you make selections in the drop-downs for each section, some values will be calculated for you. If you do not see the selection you need in the drop-down options, please call the WSU Energy Extension Program at (360) 956-2042 for assistance.

Project Information

Ogden Point Residence - Main House
 3675 W Mercer Way
 Mercer Island, WA 98040

Contact Information

Heating System Type:

All Other Systems Heat Pump

To see detailed instructions for each section, place your cursor on the word "Instructions".

Design Temperature

[Instructions](#)

Mercer Island

Design Temperature Difference (ΔT) 45
 $\Delta T = \text{Indoor (70 degrees)} - \text{Outdoor Design Temp}$

Area of Building

Conditioned Floor Area

[Instructions](#)

Conditioned Floor Area (sq ft)

9,122

Average Ceiling Height

[Instructions](#)

Average Ceiling Height (ft)

9.0

Conditioned Volume
 82,098

Glazing and Doors

[Instructions](#)

U-Factor X Area = UA
 0.30 X 2,168 = 650.25

U-Factor X Area = UA
 0.50 X [] = ---

Skylights

[Instructions](#)

U-Factor X Area = UA
 0.026 X 3,571 = 92.85

Insulation

Attic

[Instructions](#)

R-49

Single Rafter or Joist Vaulted Ceilings

[Instructions](#)

Select R-Value

U-Factor X Area = UA
 No selection X [] = ---

Above Grade Walls (see Figure 1)

[Instructions](#)

R-21 Intermediate

U-Factor X Area = UA
 0.056 X 6,200 = 347.20

Floors

[Instructions](#)

R-30

U-Factor X Area = UA
 0.029 X 912 = 26.45

Below Grade Walls (see Figure 1)

[Instructions](#)

R-21 Interior

U-Factor X Area = UA
 0.042 X 468 = 19.66

Slab Below Grade (see Figure 1)

[Instructions](#)

R-5 Thermal Break at slab edge

F-Factor X Length = UA
 0.570 X 14 = 7.98

Slab on Grade (see Figure 1)

[Instructions](#)

R-10 Perimeter


F-Factor X Length = UA
 0.540 X 307 = 165.78

Location of Ducts

[Instructions](#)

Unconditioned Space

Duct Leakage Coefficient
 1.10

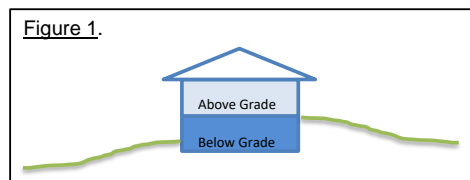

| | |
|---|--------------------|
| Sum of UA | 1310.16 |
| Envelope Heat Load | 58,957 Btu / Hour |
| <i>Sum of UA X ΔT</i> | |
| Air Leakage Heat Load | 39,900 Btu / Hour |
| <i>Volume X 0.6 X ΔT X .018</i> | |
| Building Design Heat Load | 98,857 Btu / Hour |
| <i>Air Leakage + Envelope Heat Loss</i> | |
| Building and Duct Heat Load | 108,743 Btu / Hour |
| <i>Ducts in unconditioned space: Sum of Building Heat Loss X 1.10</i> | |
| <i>Ducts in conditioned space: Sum of Building Heat Loss X 1</i> | |
| Maximum Heat Equipment Output | 152,240 Btu / Hour |
| <i>Building and Duct Heat Loss X 1.40 for Forced Air Furnace</i> | |
| <i>Building and Duct Heat Loss X 1.25 for Heat Pump</i> | |