



DISH Wireless L.L.C. SITE ID:

SESEA00010B

DISH Wireless L.L.C. SITE ADDRESS:

**8477 SE 68TH STREET
MERCER ISLAND, WA 98040**

WASHINGTON CODE OF COMPLIANCE

ALL WORK SHALL BE PERFORMED AND MATERIALS INSTALLED IN ACCORDANCE WITH THE CURRENT EDITIONS OF THE FOLLOWING CODES AS ADOPTED BY THE LOCAL GOVERNING AUTHORITIES. NOTHING IN THESE PLANS IS TO BE CONSTRUED TO PERMIT WORK NOT CONFORMING TO THESE CODES

CODE TYPE	CODE
BUILDING	2021 IBC W/ W.A.C. AMENDMENTS
MECHANICAL	2021 IMC W/ W.A.C. AMENDMENTS
ELECTRICAL	2020 NEC W/ W.A.C. AMENDMENTS

SHEET INDEX

SHEET NO.	SHEET TITLE
T-1	TITLE SHEET
LS-1	SITE SURVEY
A-1	OVERALL AND ENLARGED SITE PLAN
A-2.1	EXISTING AND FINAL ELEVATION
A-2.2	ANTENNA LAYOUT AND SCHEDULE
A-3	EQUIPMENT PLATFORM AND H-FRAME DETAILS
A-4	EQUIPMENT DETAILS
A-5	EQUIPMENT DETAILS
A-6	EQUIPMENT DETAILS
E-1	ELECTRICAL/FIBER ROUTE PLAN AND NOTES
E-2	ELECTRICAL DETAILS
E-3	ELECTRICAL ONE-LINE, FAULT CALCS & PANEL SCHEDULE
G-1	GROUNDING PLANS AND NOTES
G-2	GROUNDING DETAILS
G-3	GROUNDING DETAILS
RF-1	RF CABLE COLOR CODE
GN-1	LEGEND AND ABBREVIATIONS
GN-2	GENERAL NOTES
GN-3	GENERAL NOTES
GN-4	GENERAL NOTES

SCOPE OF WORK

THIS IS NOT AN ALL INCLUSIVE LIST. CONTRACTOR SHALL UTILIZE SPECIFIED EQUIPMENT PART OR ENGINEER APPROVED EQUIVALENT. CONTRACTOR SHALL VERIFY ALL NEEDED EQUIPMENT TO PROVIDE A FUNCTIONAL SITE. THE PROJECT GENERALLY CONSISTS OF THE FOLLOWING:

- TOWER SCOPE OF WORK:**
- INSTALL PROPOSED 20' TOWER EXTENSION WITH 60" CANISTER
 - INSTALL (3) PROPOSED PANEL ANTENNAS (1 PER SECTOR)
 - INSTALL (2) PROPOSED ANTENNA FLUSH MOUNTS
 - INSTALL (6) DIPLEXERS
 - INSTALL (3) BIAS Ts
 - INSTALL PROPOSED JUMPERS
 - INSTALL (12) PROPOSED COAX CABLES
 - INSTALL (1) PROPOSED CABLE CLAMP

- GROUND SCOPE OF WORK:**
- REMOVE SECTION OF FENCE
 - INSTALL 6'-0" x 8'-0" CHAIN-LINK FENCE
 - INSTALL (3) PROPOSED CHAIN-LINK GATE
 - INSTALL (1) PROPOSED CONCRETE PAD
 - INSTALL (1) PROPOSED CABLE TRAY
 - INSTALL (1) PROPOSED PPC CABINET
 - INSTALL (6) PROPOSED RRRUS
 - INSTALL (6) DIPLEXERS
 - INSTALL (1) PROPOSED EQUIPMENT CABINET
 - INSTALL (1) PROPOSED POWER CONDUIT
 - INSTALL (1) PROPOSED TELCO CONDUIT
 - INSTALL (1) PROPOSED TELCO-FIBER BOX
 - INSTALL (1) PROPOSED GPS UNIT
 - INSTALL (1) PROPOSED SAFETY SWITCH (IF REQUIRED)
 - INSTALL (1) PROPOSED FIBER NID (IF REQUIRED)
 - INSTALL (1) PROPOSED METER SOCKET

SITE PHOTO



UNDERGROUND SERVICE ALERT - WASHINGTON 811
UTILITY NOTIFICATION CENTER OF WASHINGTON
(800) 424-5555
WWW.WASHINGTON811.COM

CALL 2 WORKING DAYS UTILITY NOTIFICATION PRIOR TO CONSTRUCTION

GENERAL NOTES

THE FACILITY IS UNMANNED AND NOT FOR HUMAN HABITATION. A TECHNICIAN WILL VISIT THE SITE AS REQUIRED FOR ROUTINE MAINTENANCE. THE PROJECT WILL NOT RESULT IN ANY SIGNIFICANT DISTURBANCE OR EFFECT ON DRAINAGE. NO SANITARY SEWER SERVICE, POTABLE WATER, OR TRASH DISPOSAL IS REQUIRED AND NO COMMERCIAL SIGNAGE IS PROPOSED.

11"x17" PLOT WILL BE HALF SCALE UNLESS OTHERWISE NOTED

CONTRACTOR SHALL VERIFY ALL PLANS, EXISTING DIMENSIONS, AND CONDITIONS ON THE JOB SITE, AND SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK.

SITE INFORMATION

PROPERTY OWNER: PUGET SOUND ENERGY
ADDRESS: PO BOX 91269, BOT-01H
BELLEVUE, WA 98009-9269

TOWER TYPE: CONCEALMENT

TOWER CO SITE ID: 880416

TOWER APP NUMBER: 559192

COUNTY: KING

LATITUDE (NAD 83): 47° 32' 30.00" N
47.541667

LONGITUDE (NAD 83): 122° 13' 25.00" W
-122.223611

ZONING JURISDICTION: CITY OF MERCER ISLAND

ZONING DISTRICT: R-9. 6

PARCEL NUMBER: 3024059095

OCCUPANCY GROUP: U

CONSTRUCTION TYPE: II-B

POWER COMPANY: PUGET SOUND ENERGY

TELEPHONE COMPANY: TBD

PROJECT DIRECTORY

APPLICANT: DISH Wireless L.L.C.
5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120

TOWER OWNER: CROWN CASTLE USA INC.
2000 CORPORATE DRIVE
CANONSBURG, PA 15317
(877) 486-9377

SITE DESIGNER: POD
11490 BLUEGRASS PARKWAY
LOUISVILLE, KY 40299
(502) 437-5252

SITE ACQUISITION: ANDREW MAGOON
(602) 845-1783


CONSTRUCTION MANAGER: MIKE MURPHY
(206) 779-6346

RF ENGINEER: MOHAMED ALFASI
(303) 706-4536

DIRECTIONS

- DIRECTIONS FROM SEATTLE-TACOMA INTERNATIONAL AIRPORT:**
- 1.) GET ON WA-518 E IN TUKWILA FROM AIRPORT EXPRESSWAY
 - 2.) TAKE I-5 N AND I-90 E TO ISLAND CREST WAY IN MERCER ISLAND. TAKE EXIT 7B FROM I-90 E
 - 3.) FOLLOW ISLAND CREST WAY TO SE 68TH ST

VICINITY MAP

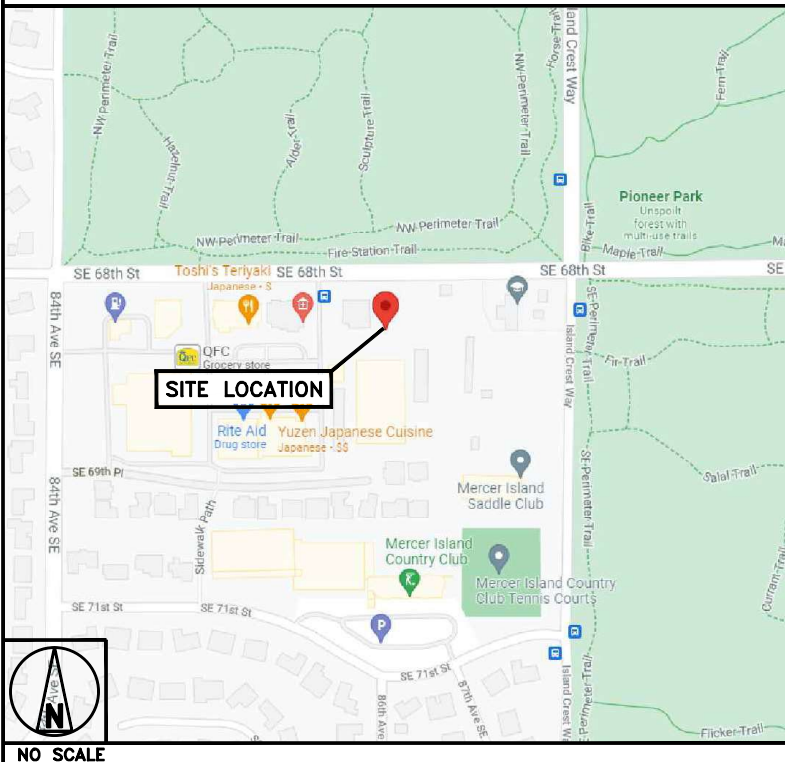

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM	CHECKED BY: EEW	APPROVED BY: AH
RFDS REV #: 0	09/09/2021	

CONSTRUCTION DOCUMENTS


REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
TITLE SHEET

SHEET NUMBER
T-1

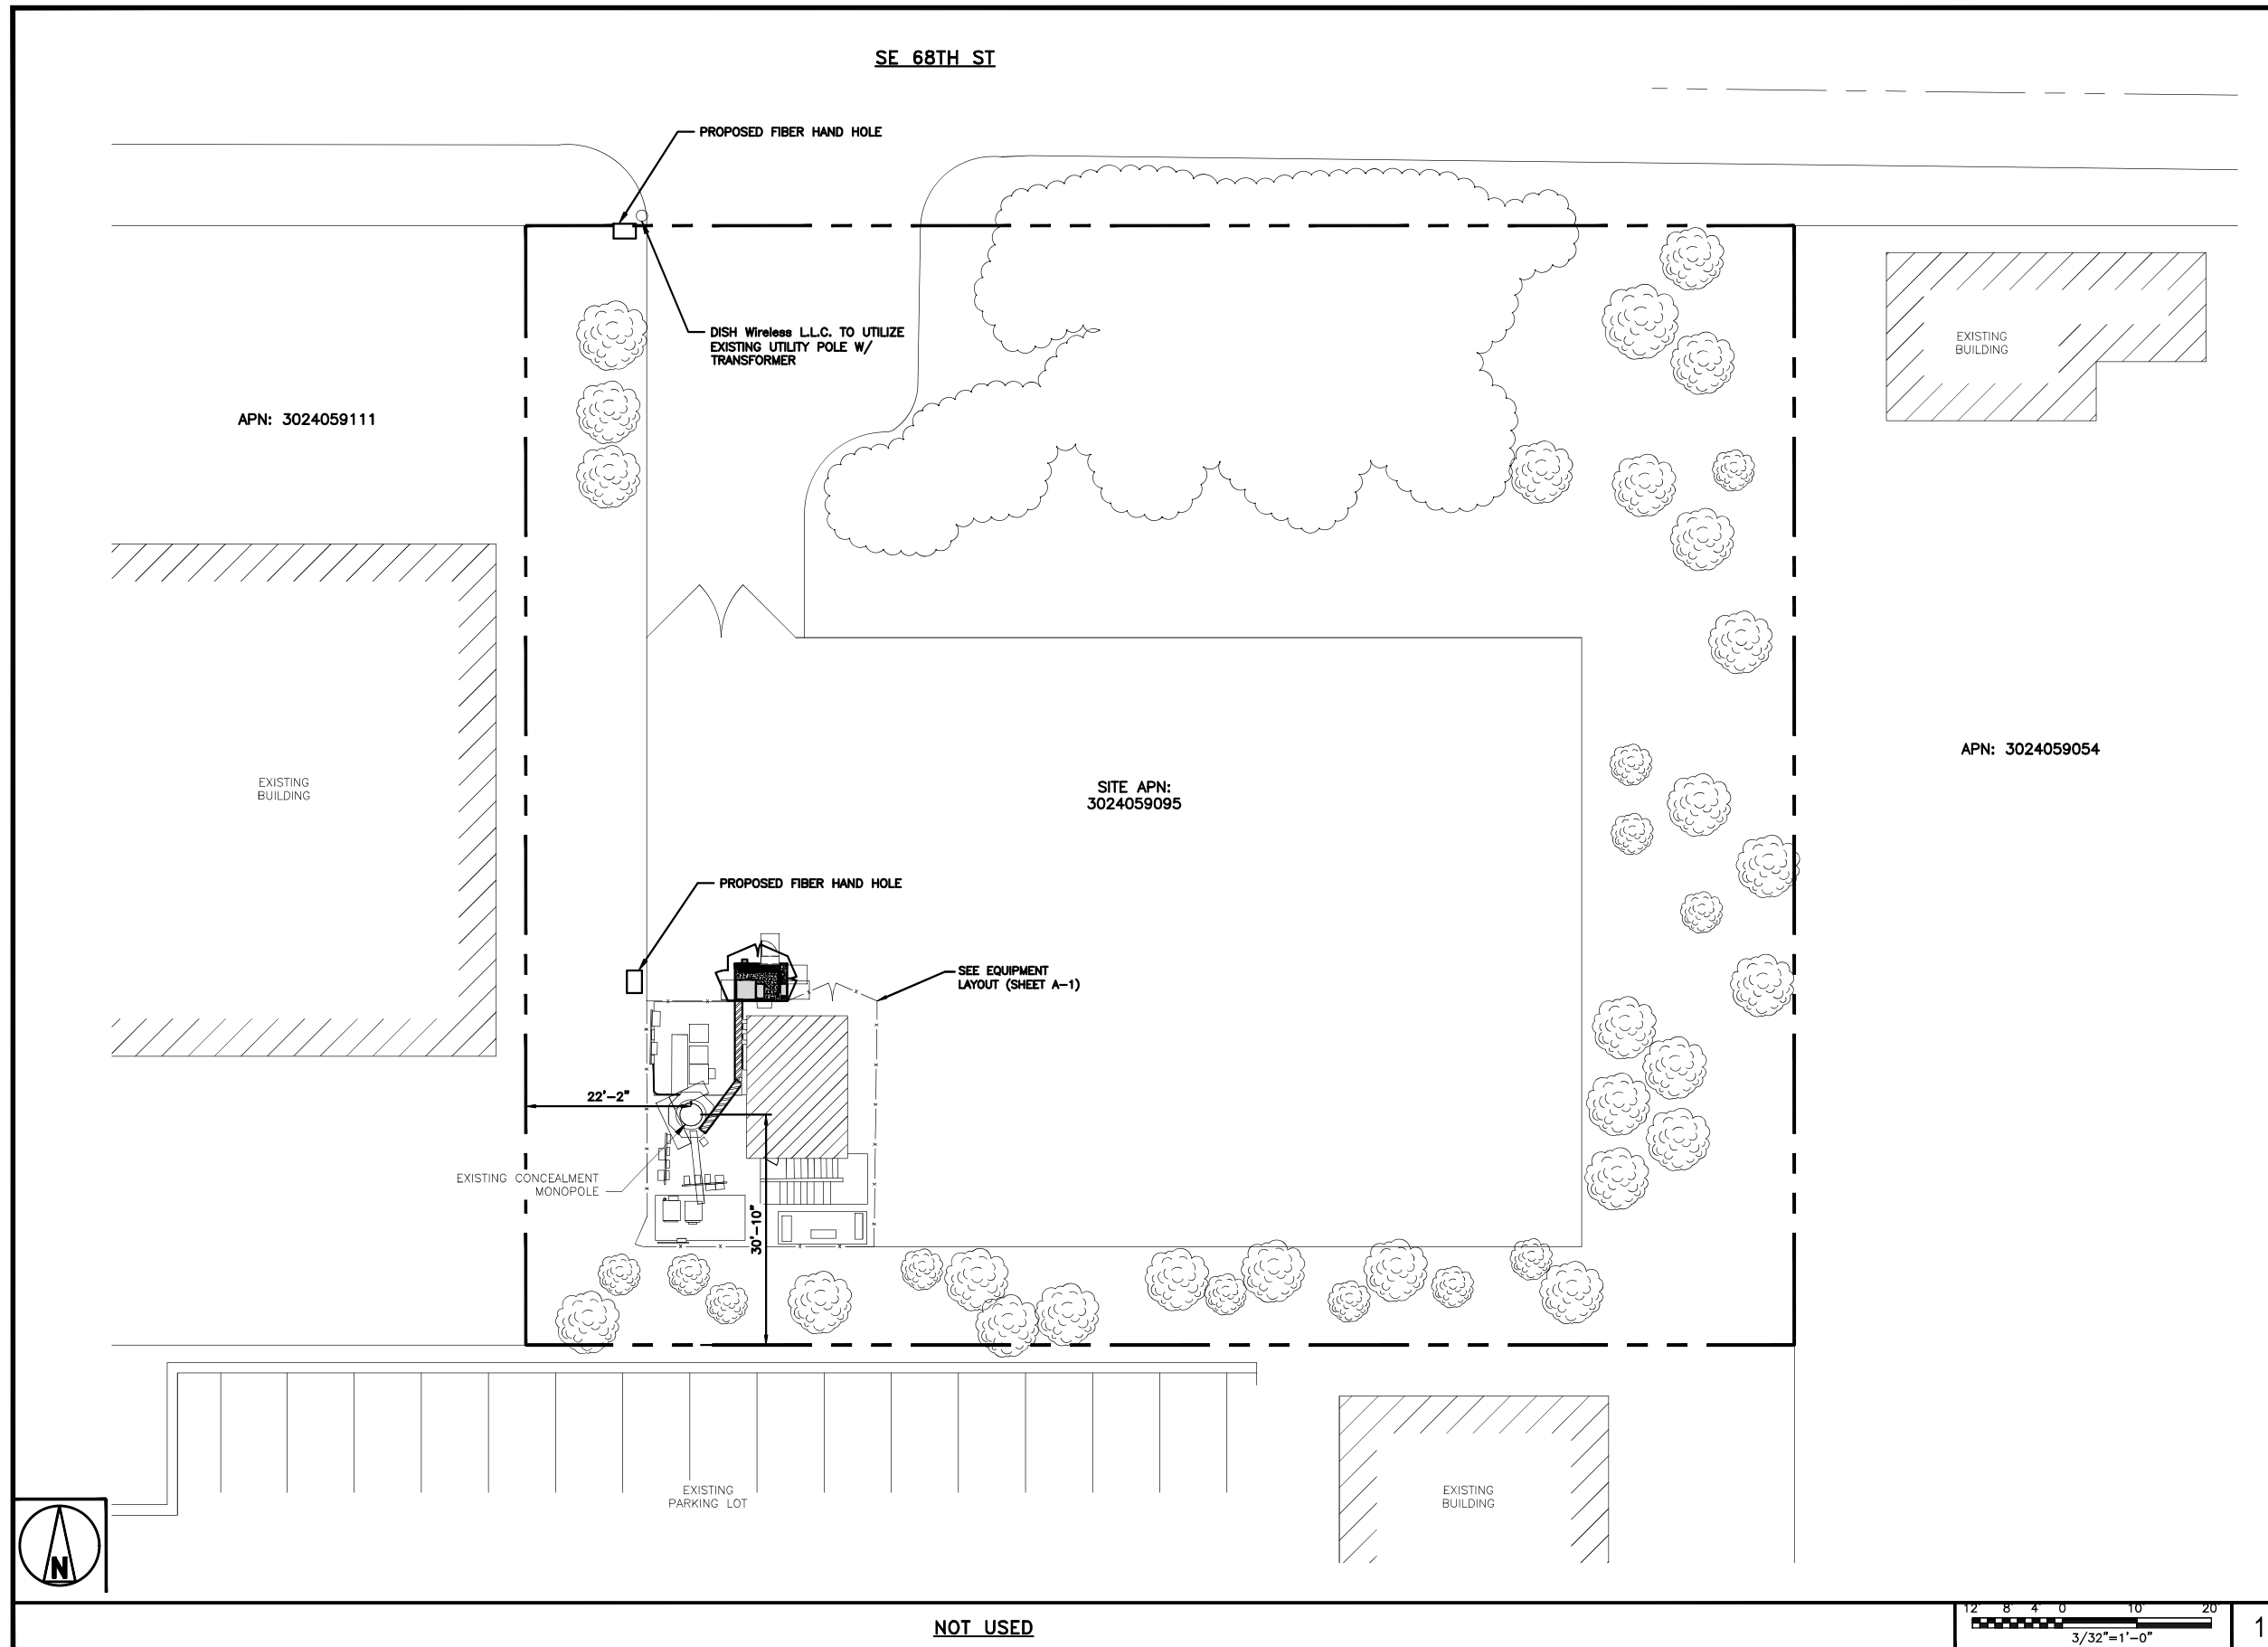

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299

FOR REFERENCE
PURPOSES ONLY

IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION


A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040



SHEET TITLE
SITE SURVEY

SHEET NUMBER
LS-1

NOT USED



1

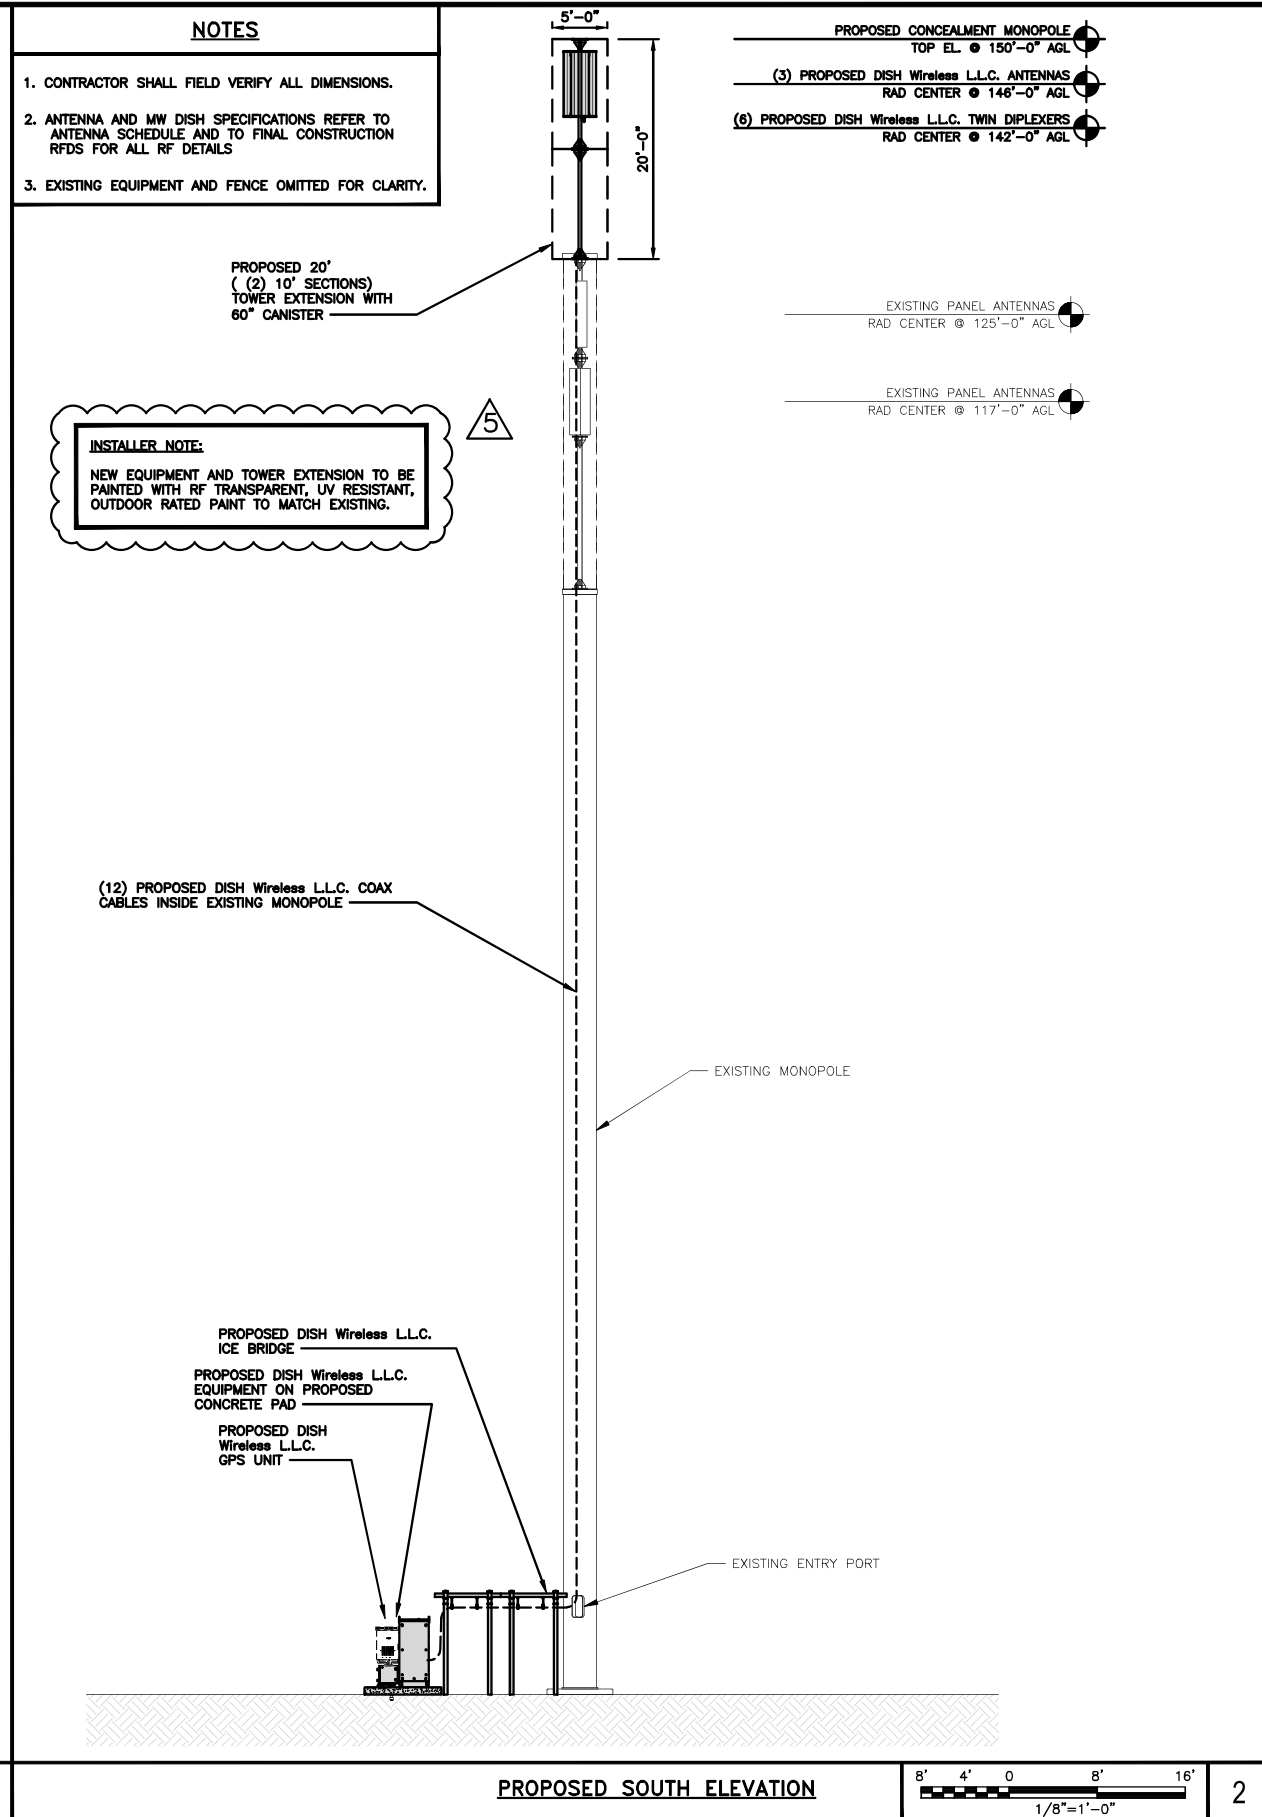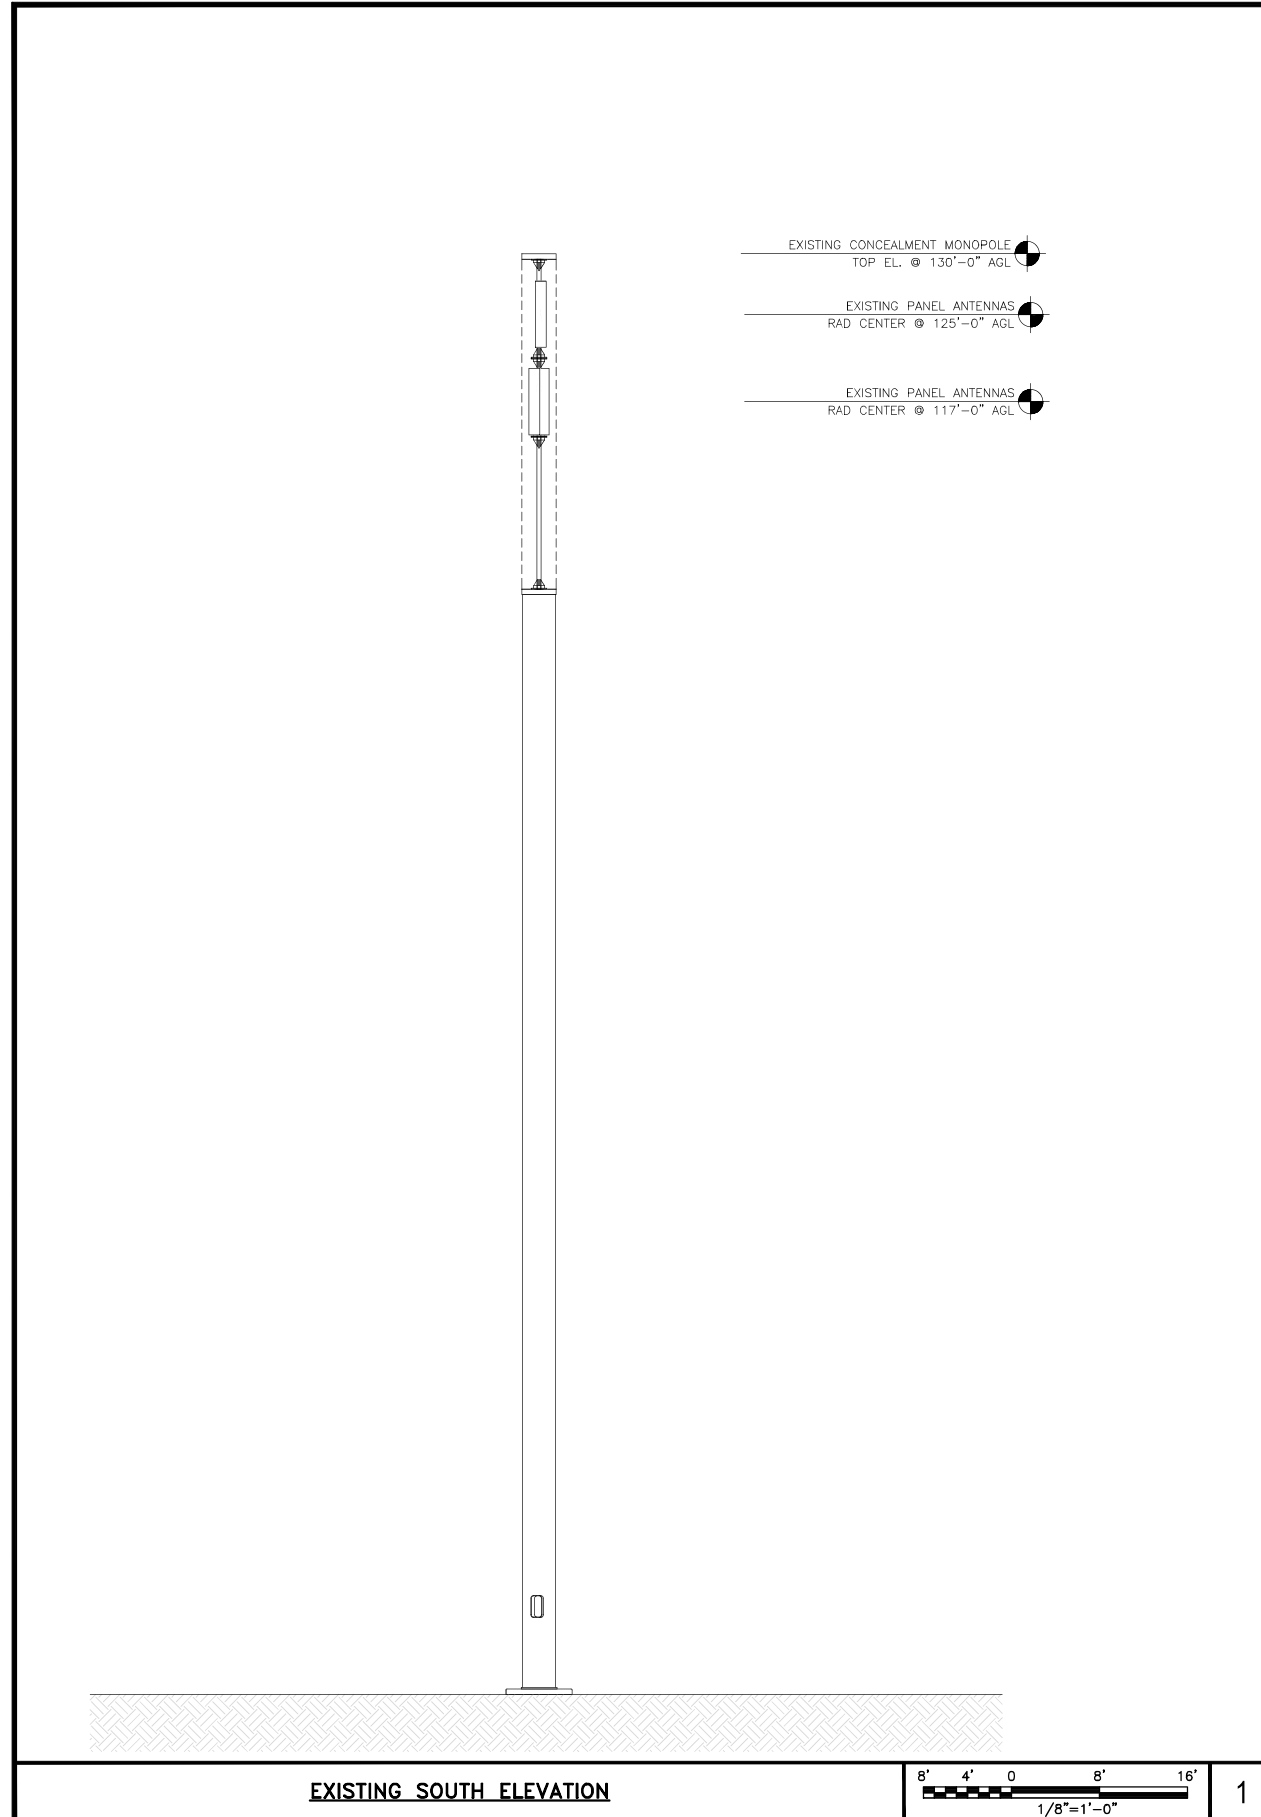

- NOTES**
1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS.
 2. ANTENNA AND MW DISH SPECIFICATIONS REFER TO ANTENNA SCHEDULE AND TO FINAL CONSTRUCTION RFDS FOR ALL RF DETAILS
 3. EXISTING EQUIPMENT AND FENCE OMITTED FOR CLARITY.

INSTALLER NOTE:
NEW EQUIPMENT AND TOWER EXTENSION TO BE PAINTED WITH RF TRANSPARENT, UV RESISTANT, OUTDOOR RATED PAINT TO MATCH EXISTING.

- PROPOSED CONCEALMENT MONOPOLE TOP EL. @ 150'-0" AGL
- (3) PROPOSED DISH Wireless L.L.C. ANTENNAS RAD CENTER @ 146'-0" AGL
- (6) PROPOSED DISH Wireless L.L.C. TWIN DIPLEXERS RAD CENTER @ 142'-0" AGL


EXISTING PANEL ANTENNAS RAD CENTER @ 125'-0" AGL

EXISTING PANEL ANTENNAS RAD CENTER @ 117'-0" AGL


(12) PROPOSED DISH Wireless L.L.C. COAX CABLES INSIDE EXISTING MONOPOLE

- PROPOSED DISH Wireless L.L.C. ICE BRIDGE
- PROPOSED DISH Wireless L.L.C. EQUIPMENT ON PROPOSED CONCRETE PAD
- PROPOSED DISH Wireless L.L.C. GPS UNIT


EXISTING ENTRY PORT



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS

REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
5	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION

SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
EXISTING AND FINAL ELEVATIONS

SHEET NUMBER
A-2.1

EXISTING SOUTH ELEVATION



1

PROPOSED SOUTH ELEVATION


2

INSTALLER NOTE:
 NEW EQUIPMENT AND TOWER EXTENSION TO BE PAINTED WITH RF TRANSPARENT, UV RESISTANT, OUTDOOR RATED PAINT TO MATCH EXISTING.

5

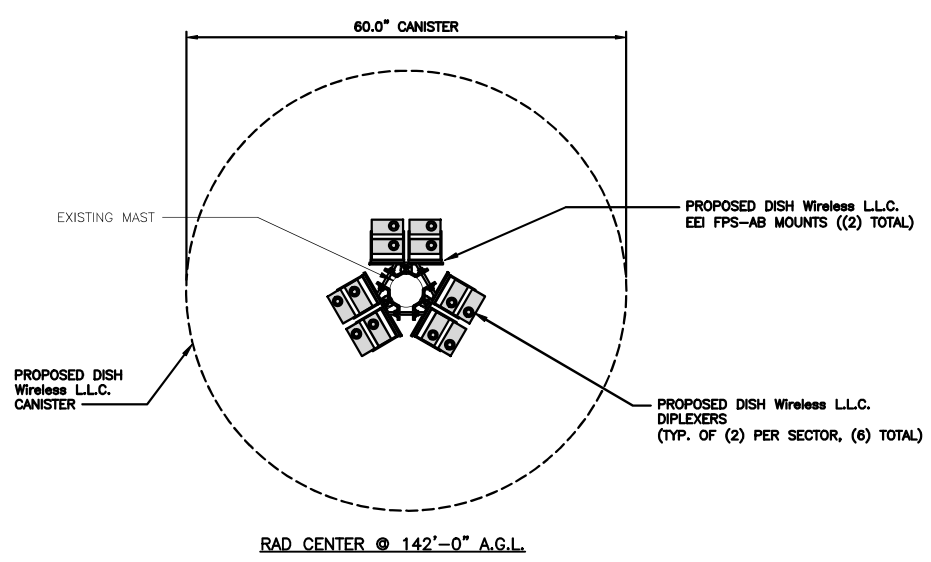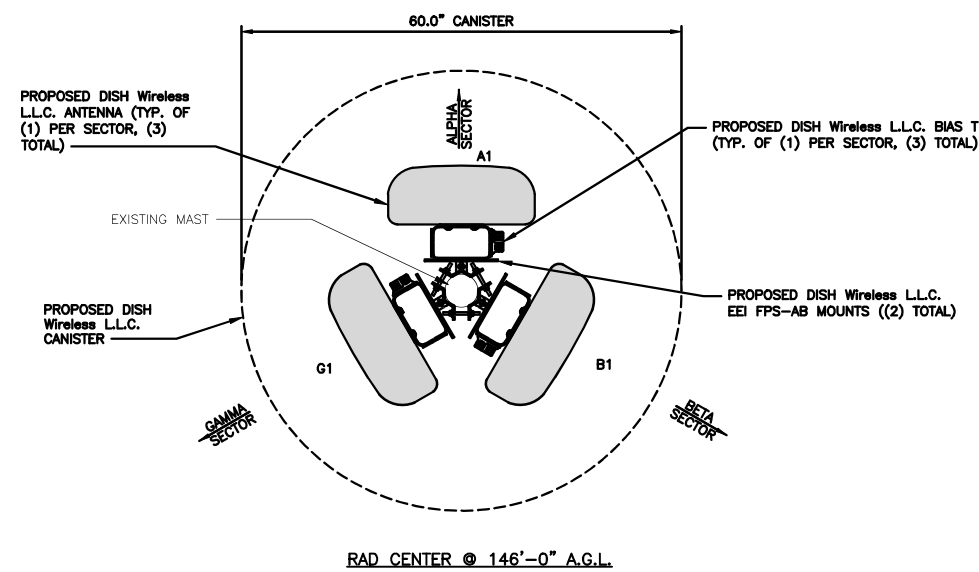

ANTENNA LAYOUT



2

SECTOR	POSITION	ANTENNA						TRANSMISSION CABLE
		EXISTING OR PROPOSED	MANUFACTURER - MODEL NUMBER	TECHNOLOGY	SIZE (HxW)	AZIMUTH	RAD CENTER	
ALPHA	A1	PROPOSED	JMA WIRELESS - MX08FRO665-21	5G	72.0" x 20.0"	0°	146'-0"	(12) COAX CABLES (200' LONG)
BETA	B1	PROPOSED	JMA WIRELESS - MX08FRO665-21	5G	72.0" x 20.0"	120°	146'-0"	
GAMMA	G1	PROPOSED	JMA WIRELESS - MX08FRO665-21	5G	72.0" x 20.0"	240°	146'-0"	

SECTOR	POSITION	RRH (GROUND MOUNTED)		NOTES	SECTOR	QUANTITY	TOWER MOUNTED EQUIPMENT	
		MANUFACTURER - MODEL NUMBER	TECHNOLOGY				MANUFACTURER - MODEL NUMBER	MANUFACTURER - MODEL NUMBER
ALPHA	A1 ON GROUND	FUJITSU - TA08025-B604	---	1. CONTRACTOR TO REFER TO FINAL CONSTRUCTION RFDS FOR ALL RF DETAILS. 2. ANTENNA AND RRH MODELS MAY CHANGE DUE TO EQUIPMENT AVAILABILITY. ALL EQUIPMENT CHANGES MUST BE APPROVED AND REMAIN IN COMPLIANCE WITH THE PROPOSED DESIGN AND STRUCTURAL ANALYSES.	ALPHA	2	KAEUS - DBC0115F1V91-2	KAEUS - SBT0001F1V1
	A1 ON GROUND	FUJITSU - TA08025-B605	---					
BETA	B1 ON GROUND	FUJITSU - TA08025-B604	---		BETA	2	KAEUS - DBC0115F1V91-2	KAEUS - SBT0001F1V1
	B1 ON GROUND	FUJITSU - TA08025-B605	---					
GAMMA	C1 ON GROUND	FUJITSU - TA08025-B604	---		GAMMA	2	KAEUS - DBC0115F1V91-2	KAEUS - SBT0001F1V1
	C1 ON GROUND	FUJITSU - TA08025-B605	---					

ANTENNA SCHEDULE

NO SCALE 3

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120

11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH
RFDS REV #:	0	09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
5	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
ANTENNA LAYOUT AND SCHEDULE

SHEET NUMBER
A-2.2

- NOTES**
1. CONTRACTOR TO BURY PLATFORM FEET WITH A MINIMUM OF 2" OF FILL PER EXISTING SITE SURFACE
 2. WEED BARRIER FABRIC TO BE ADDED AT DISCRETION OF DISH Wireless L.L.C. CONSTRUCTION MANAGER AT TIME OF CONSTRUCTION. ONE SHEET 8'x8' INSTALLED UNDER ALL FOUR FEET OF THE PLATFORM (4 MIL BLACK PLASTIC)
 3. EQUIPMENT CABINET OMITTED FOR CLARITY.



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



11/10/2023

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH
RFDS REV #:	0	09/09/2021

CONSTRUCTION DOCUMENTS

REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION


A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION

SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040


SHEET TITLE
EQUIPMENT PLATFORM AND H-FRAME DETAILS

SHEET NUMBER
A-3

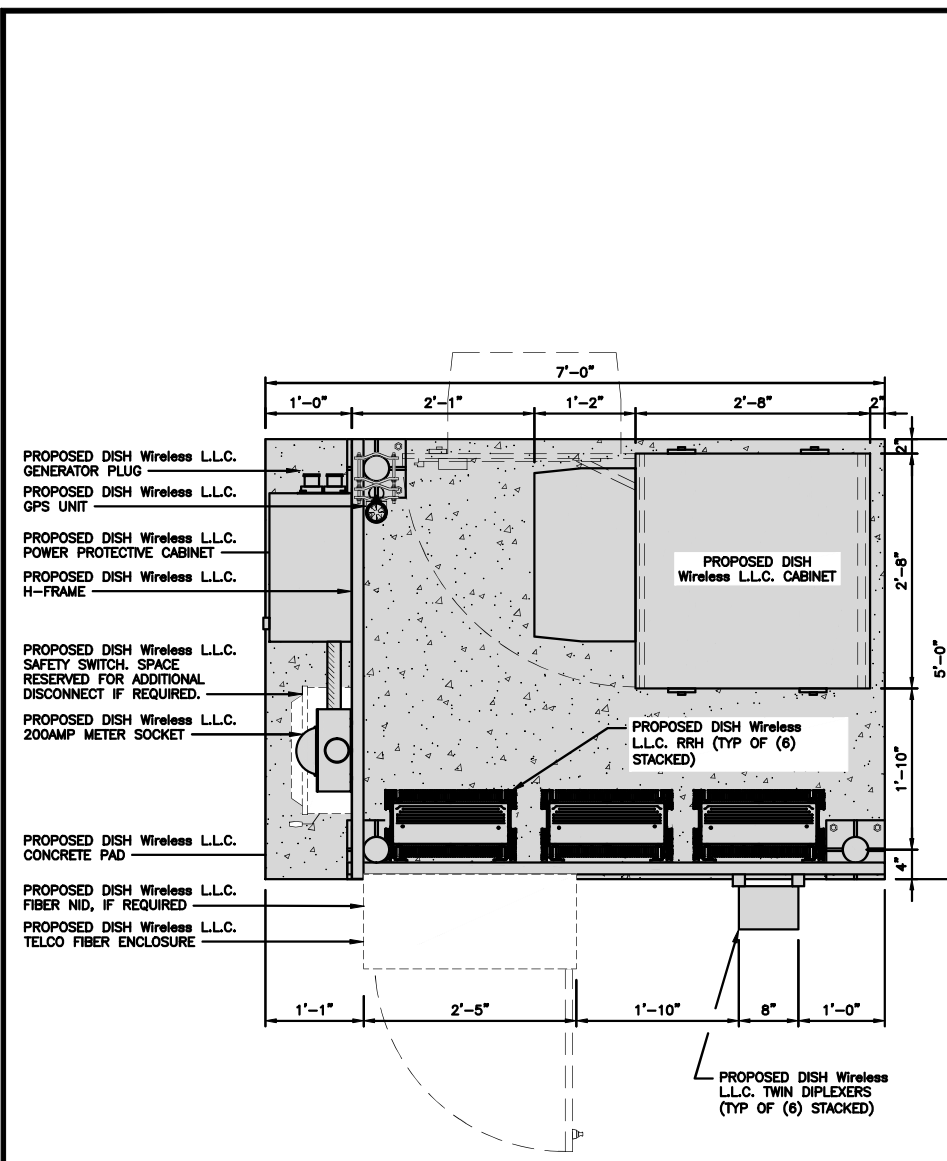


PLATFORM EQUIPMENT PLAN

NO SCALE 1

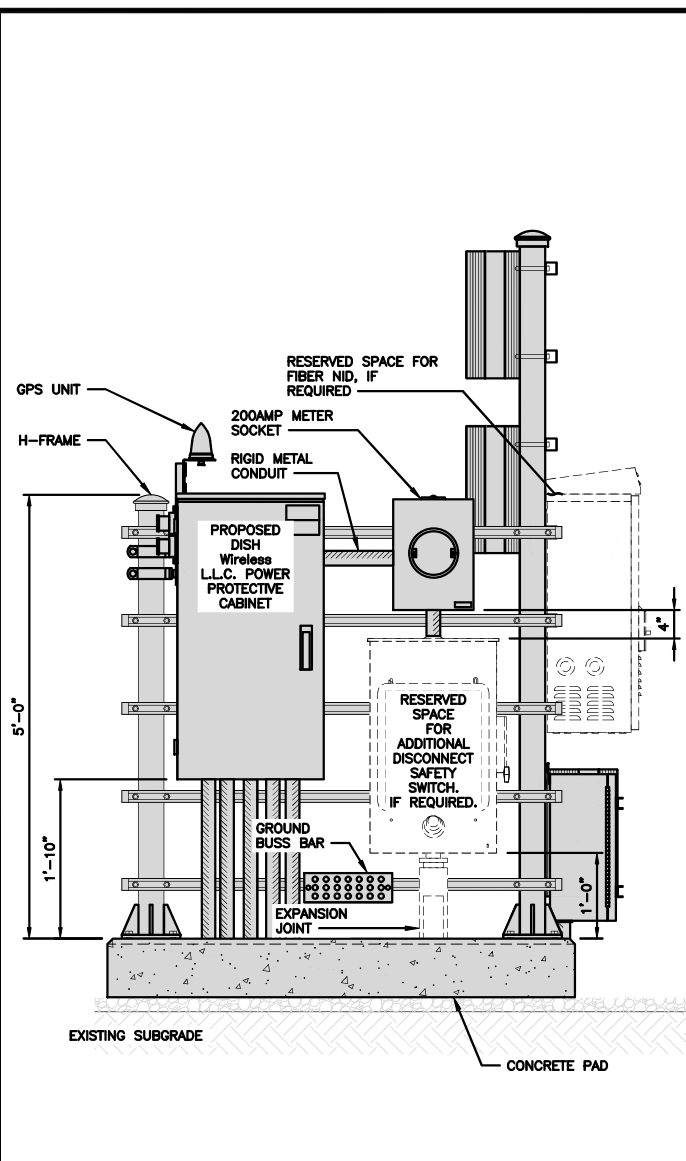


H-FRAME EQUIPMENT ELEVATION

NO SCALE 2

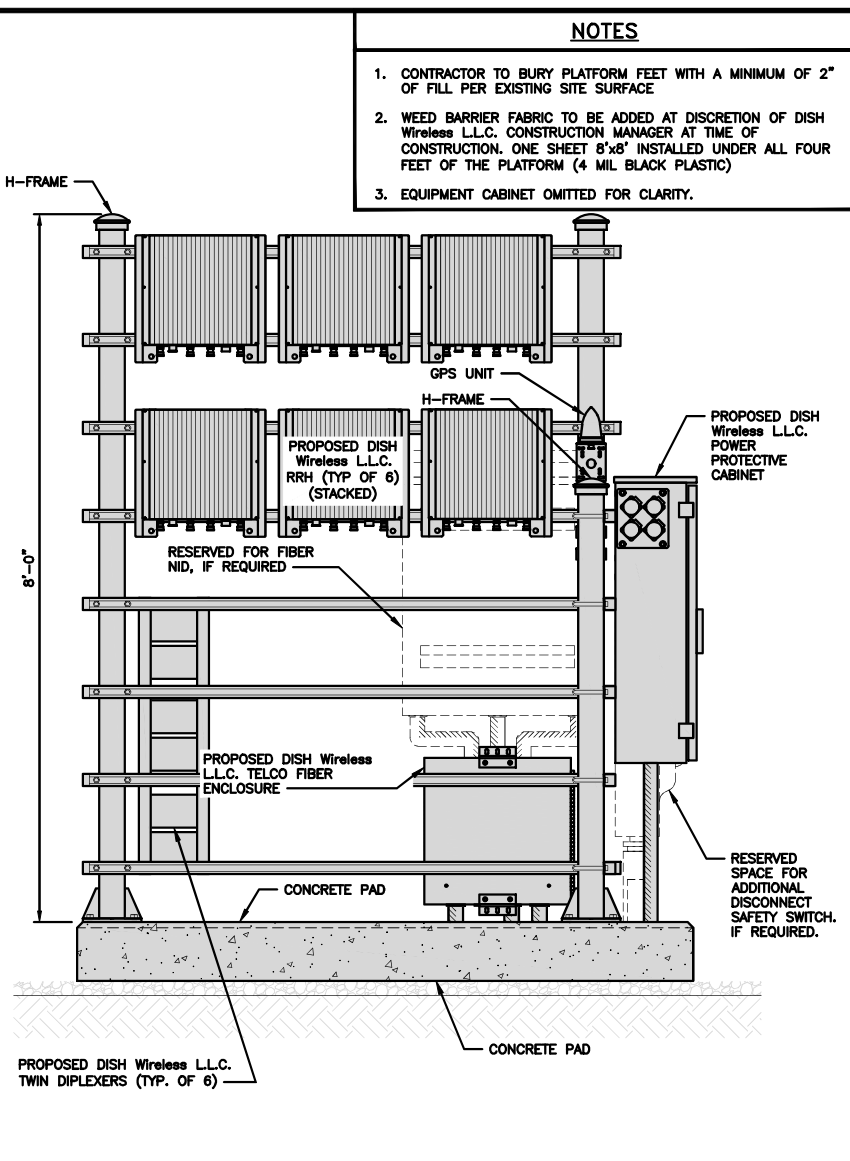


STAGGERED H-FRAME DETAIL

NO SCALE 4

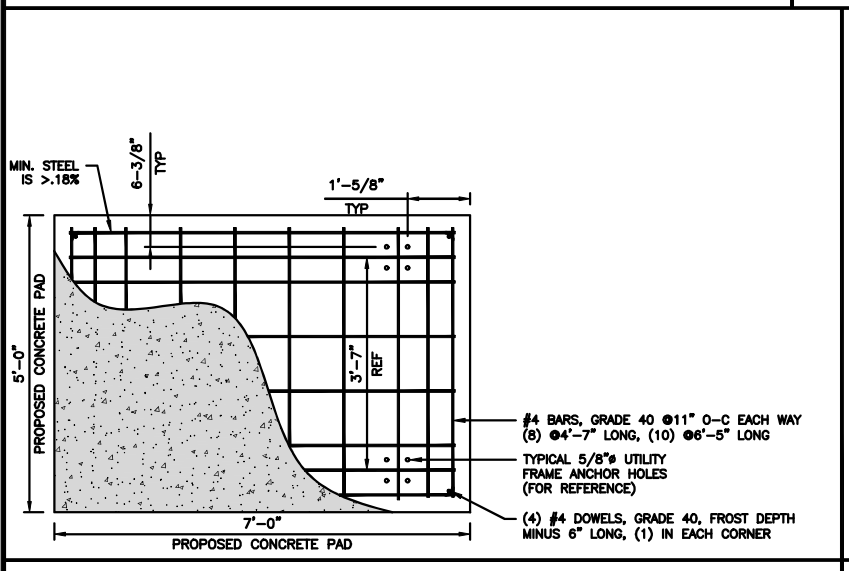

CONCRETE PAD WITH FOOTERS DETAIL

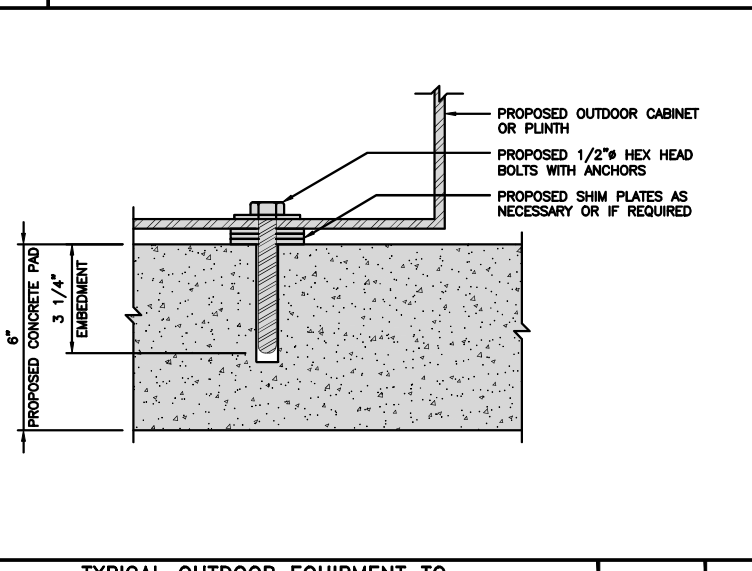












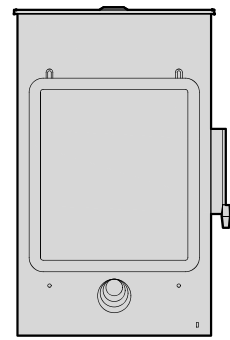















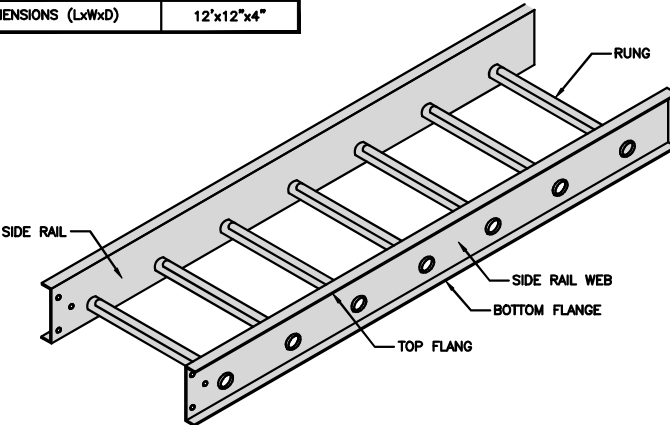
TYPICAL OUTDOOR EQUIPMENT TO CONCRETE SLAB ANCHORAGE




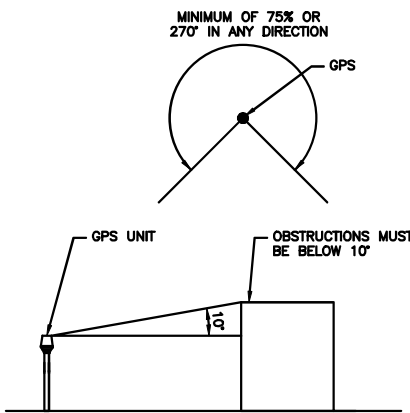
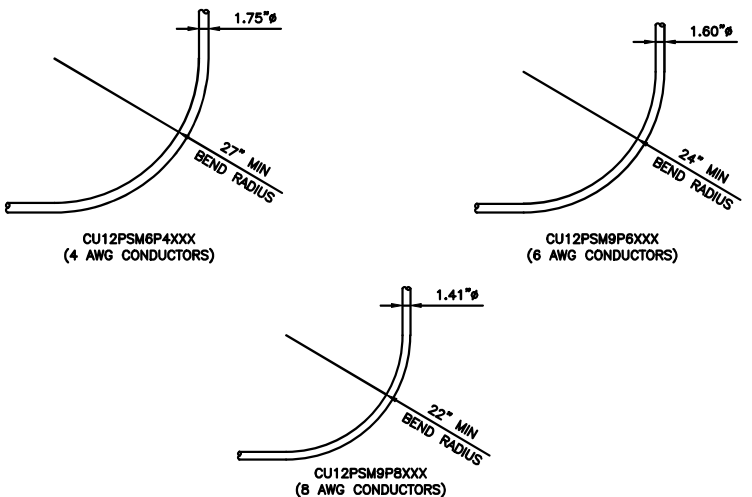







NO SCALE 3

KENWOOD T1701KT5-5S H-FRAME	
UNISTRUT/SUPPORT RAILS QTY	5
WEIGHT	173.6 lbs

STAGGERED H-FRAME DETAIL

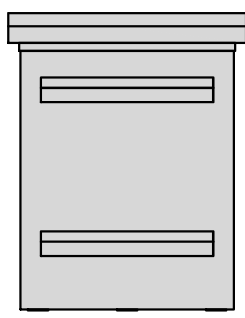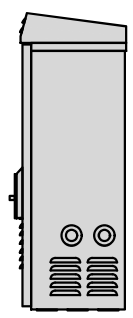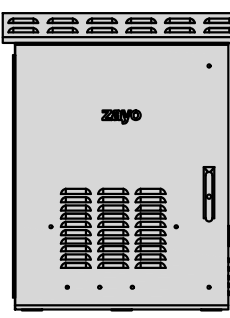NO SCALE 4

<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">CHARLES INDUSTRY HEX CUBE-PM639155N4</th> </tr> <tr> <td>DIMENSIONS (HxWxD)</td> <td>74"x32"x32"</td> </tr> <tr> <td>POWER PLANT</td> <td>-48VDC ABB/600W</td> </tr> <tr> <td>TOTAL WEIGHT (EMPTY)</td> <td>408 lbs</td> </tr> </table>    	CHARLES INDUSTRY HEX CUBE-PM639155N4		DIMENSIONS (HxWxD)	74"x32"x32"	POWER PLANT	-48VDC ABB/600W	TOTAL WEIGHT (EMPTY)	408 lbs	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">RAYCAP PPC RDIAC-2465-P-240-MTS</th> </tr> <tr> <td>ENCLOSURE DIMENSIONS (HxWxD)</td> <td>39"x22.855"x12.593</td> </tr> <tr> <td>WEIGHT:</td> <td>80 lbs</td> </tr> <tr> <td>OPERATING AC VOLTAGE</td> <td>240/120 1 PHASE 3W+G</td> </tr> </table>     	RAYCAP PPC RDIAC-2465-P-240-MTS		ENCLOSURE DIMENSIONS (HxWxD)	39"x22.855"x12.593	WEIGHT:	80 lbs	OPERATING AC VOLTAGE	240/120 1 PHASE 3W+G	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">SQUARE D SAFETY SWITCHES D224NRB</th> </tr> <tr> <td>ENCLOSURE DIM (HxWxD)</td> <td>29.25"x19.00"x8.50"</td> </tr> <tr> <td>ENCLOSURE TYPE</td> <td>NEMA 3R RAINPROOF</td> </tr> <tr> <td>UL LISTED</td> <td>FILE E-2875</td> </tr> </table>   	SQUARE D SAFETY SWITCHES D224NRB		ENCLOSURE DIM (HxWxD)	29.25"x19.00"x8.50"	ENCLOSURE TYPE	NEMA 3R RAINPROOF	UL LISTED	FILE E-2875	 <p>5701 SOUTH SANTA FE DRIVE LITTLETON, CO 80120</p>  <p>11490 BLUEGRASS PKWY LOUISVILLE, KY 40299</p>								
CHARLES INDUSTRY HEX CUBE-PM639155N4																																			
DIMENSIONS (HxWxD)	74"x32"x32"																																		
POWER PLANT	-48VDC ABB/600W																																		
TOTAL WEIGHT (EMPTY)	408 lbs																																		
RAYCAP PPC RDIAC-2465-P-240-MTS																																			
ENCLOSURE DIMENSIONS (HxWxD)	39"x22.855"x12.593																																		
WEIGHT:	80 lbs																																		
OPERATING AC VOLTAGE	240/120 1 PHASE 3W+G																																		
SQUARE D SAFETY SWITCHES D224NRB																																			
ENCLOSURE DIM (HxWxD)	29.25"x19.00"x8.50"																																		
ENCLOSURE TYPE	NEMA 3R RAINPROOF																																		
UL LISTED	FILE E-2875																																		
CABINET DETAIL	POWER PROTECTION CABINET (PPC) DETAIL	SAFETY SWITCH DETAIL	NO SCALE 1 NO SCALE 2 NO SCALE 3																																
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">EATON METER SOCKET UNRRS213BEUSE</th> </tr> <tr> <td>METER SOCKET TYPE</td> <td>RING</td> </tr> <tr> <td>ENCLOSURE DIM (HxWxD)</td> <td>16"x12"x6"</td> </tr> <tr> <td>MAIN AMPERE RATING</td> <td>200A</td> </tr> <tr> <td>WEIGHT</td> <td>18 LBS</td> </tr> </table>    	EATON METER SOCKET UNRRS213BEUSE		METER SOCKET TYPE	RING	ENCLOSURE DIM (HxWxD)	16"x12"x6"	MAIN AMPERE RATING	200A	WEIGHT	18 LBS	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">ZAYO 5RU (LEFT SWING DOOR) FIBER NID ENCLOSURE</th> </tr> <tr> <td>DIMENSIONS (HxWxD)</td> <td>36.1"x29"x12.9"</td> </tr> <tr> <td>WEIGHT</td> <td>85 lbs</td> </tr> </table>    	ZAYO 5RU (LEFT SWING DOOR) FIBER NID ENCLOSURE		DIMENSIONS (HxWxD)	36.1"x29"x12.9"	WEIGHT	85 lbs	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">CHARLES CFIT-PF2020DSH1 FIBER TELCO ENCLOSURE</th> </tr> <tr> <td>ENCLOSURE DIMS (HxWxD)</td> <td>20"x20"x9"</td> </tr> <tr> <td>ENCLOSURE WEIGHT</td> <td>20 lbs</td> </tr> <tr> <td>MOUNTING</td> <td>WALL</td> </tr> <tr> <td>COMPLIANCE</td> <td>TYPE 4</td> </tr> </table>    	CHARLES CFIT-PF2020DSH1 FIBER TELCO ENCLOSURE		ENCLOSURE DIMS (HxWxD)	20"x20"x9"	ENCLOSURE WEIGHT	20 lbs	MOUNTING	WALL	COMPLIANCE	TYPE 4	 <p>IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.</p> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td>DRAWN BY:</td> <td>CHECKED BY:</td> <td>APPROVED BY:</td> </tr> <tr> <td>AJM</td> <td>EEW</td> <td>AH</td> </tr> </table> <p>RFDS REV #: 0 09/09/2021</p>	DRAWN BY:	CHECKED BY:	APPROVED BY:	AJM	EEW	AH
EATON METER SOCKET UNRRS213BEUSE																																			
METER SOCKET TYPE	RING																																		
ENCLOSURE DIM (HxWxD)	16"x12"x6"																																		
MAIN AMPERE RATING	200A																																		
WEIGHT	18 LBS																																		
ZAYO 5RU (LEFT SWING DOOR) FIBER NID ENCLOSURE																																			
DIMENSIONS (HxWxD)	36.1"x29"x12.9"																																		
WEIGHT	85 lbs																																		
CHARLES CFIT-PF2020DSH1 FIBER TELCO ENCLOSURE																																			
ENCLOSURE DIMS (HxWxD)	20"x20"x9"																																		
ENCLOSURE WEIGHT	20 lbs																																		
MOUNTING	WALL																																		
COMPLIANCE	TYPE 4																																		
DRAWN BY:	CHECKED BY:	APPROVED BY:																																	
AJM	EEW	AH																																	
METER SOCKET DETAIL	FIBER NID ENCLOSURE DETAIL	FIBER TELCO ENCLOSURE DETAIL	NO SCALE 4 NO SCALE 5 NO SCALE 6																																
<p style="text-align: center;">NOT USED</p>	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="2">COMMSCOPE LT-12-4D CABLE TRAY</th> </tr> <tr> <td>DIMENSIONS (LxWxD)</td> <td>12'x12"x4"</td> </tr> </table> 	COMMSCOPE LT-12-4D CABLE TRAY		DIMENSIONS (LxWxD)	12'x12"x4"	<p style="text-align: center;">NOT USED</p>	<p style="text-align: center;">CONSTRUCTION DOCUMENTS</p> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="3">SUBMITTALS</th> </tr> <tr> <th>REV</th> <th>DATE</th> <th>DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>A</td> <td>01/04/2022</td> <td>ISSUED FOR REVIEW</td> </tr> <tr> <td>0</td> <td>01/20/2022</td> <td>ISSUED FOR CONSTRUCTION</td> </tr> <tr> <td>1</td> <td>02/09/2022</td> <td>ISSUED FOR CONSTRUCTION</td> </tr> <tr> <td>2</td> <td>02/18/2022</td> <td>ISSUED FOR CONSTRUCTION</td> </tr> <tr> <td>3</td> <td>04/21/2022</td> <td>ISSUED FOR CONSTRUCTION</td> </tr> <tr> <td>4</td> <td>08/07/2023</td> <td>ISSUED FOR CONSTRUCTION</td> </tr> <tr> <td>▲</td> <td>11/10/2023</td> <td>JURISDICTION REVISION</td> </tr> </tbody> </table> <p>A&E PROJECT NUMBER 880416</p> <p>DISH Wireless L.L.C. PROJECT INFORMATION</p> <p>SESEA00010B 8477 SE 68TH STREET MERCER ISLAND, WA 98040</p> <p>SHEET TITLE EQUIPMENT DETAILS</p> <p>SHEET NUMBER A-4</p>	SUBMITTALS			REV	DATE	DESCRIPTION	A	01/04/2022	ISSUED FOR REVIEW	0	01/20/2022	ISSUED FOR CONSTRUCTION	1	02/09/2022	ISSUED FOR CONSTRUCTION	2	02/18/2022	ISSUED FOR CONSTRUCTION	3	04/21/2022	ISSUED FOR CONSTRUCTION	4	08/07/2023	ISSUED FOR CONSTRUCTION	▲	11/10/2023	JURISDICTION REVISION	
COMMSCOPE LT-12-4D CABLE TRAY																																			
DIMENSIONS (LxWxD)	12'x12"x4"																																		
SUBMITTALS																																			
REV	DATE	DESCRIPTION																																	
A	01/04/2022	ISSUED FOR REVIEW																																	
0	01/20/2022	ISSUED FOR CONSTRUCTION																																	
1	02/09/2022	ISSUED FOR CONSTRUCTION																																	
2	02/18/2022	ISSUED FOR CONSTRUCTION																																	
3	04/21/2022	ISSUED FOR CONSTRUCTION																																	
4	08/07/2023	ISSUED FOR CONSTRUCTION																																	
▲	11/10/2023	JURISDICTION REVISION																																	
NOT USED	CABLE TRAY DETAIL	NOT USED	NO SCALE 7 NO SCALE 8 NO SCALE 9																																
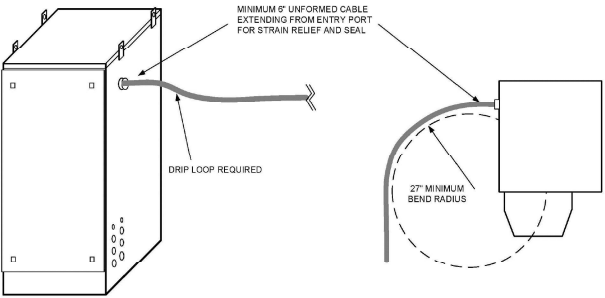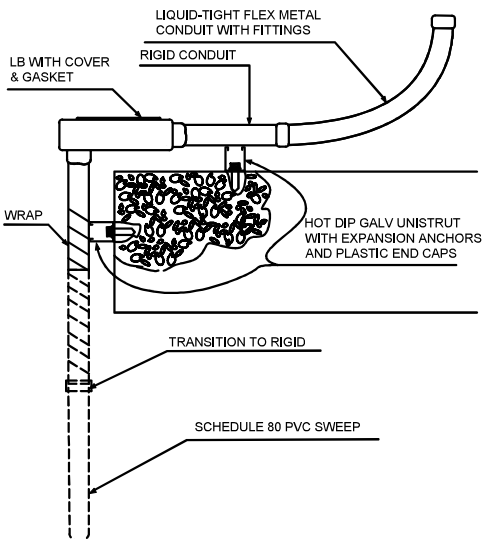
<table border="1"> <tr> <th colspan="2">PCTEL GPSGL-TMG-SPI-40NCB</th> </tr> <tr> <td>DIMENSIONS (DIAxH) MM/INCH</td> <td>81x184mm 3.2"x7.25"</td> </tr> <tr> <td>WEIGHT W/ACCESSORIES</td> <td>075 lbs</td> </tr> <tr> <td>CONNECTOR</td> <td>N-FEMALE</td> </tr> <tr> <td>FREQUENCY RANGE</td> <td>1590 ± 30MHz</td> </tr> </table>  <p>BACK</p>  <p>SIDE</p>	PCTEL GPSGL-TMG-SPI-40NCB		DIMENSIONS (DIAxH) MM/INCH	81x184mm 3.2"x7.25"	WEIGHT W/ACCESSORIES	075 lbs	CONNECTOR	N-FEMALE	FREQUENCY RANGE	1590 ± 30MHz	<p>TOP</p>  <p>TOP</p>	 <p>MINIMUM OF 75% OR 270° IN ANY DIRECTION</p> <p>GPS</p> <p>GPS UNIT</p> <p>OBSTRUCTIONS MUST BE BELOW 10'</p>	 <p>1.75"φ</p> <p>27" MIN BEND RADIUS</p> <p>CU12PSM6P4XXX (4 AWG CONDUCTORS)</p> <p>1.60"φ</p> <p>24" MIN BEND RADIUS</p> <p>CU12PSM9P6XXX (6 AWG CONDUCTORS)</p> <p>1.41"φ</p> <p>22" MIN BEND RADIUS</p> <p>CU12PSM9P8XXX (8 AWG CONDUCTORS)</p>	 <p>5701 SOUTH SANTA FE DRIVE LITTLETON, CO 80120</p>
PCTEL GPSGL-TMG-SPI-40NCB														
DIMENSIONS (DIAxH) MM/INCH	81x184mm 3.2"x7.25"													
WEIGHT W/ACCESSORIES	075 lbs													
CONNECTOR	N-FEMALE													
FREQUENCY RANGE	1590 ± 30MHz													
<p>GPS DETAIL</p> <p>NO SCALE</p> <p>1</p>	<p>GPS MINIMUM SKY VIEW REQUIREMENTS</p> <p>NO SCALE</p> <p>2</p>	<p>CABLES UNLIMITED HYBRID CABLE MINIMUM BEND RADIUS</p> <p>NO SCALE</p> <p>3</p>	<p>CONSTRUCTION DOCUMENTS</p>	 <p>11/10/2023</p>										
<table border="1"> <tr> <th colspan="2">KAEUS DBC0115F1V91-2</th> </tr> <tr> <td>DIMENSIONS (DIAxH) MM/INCH</td> <td>4.25x5.59x5.28</td> </tr> <tr> <td>WEIGHT</td> <td>7.06 lbs</td> </tr> </table>  <p>BACK</p>  <p>SIDE</p>	KAEUS DBC0115F1V91-2		DIMENSIONS (DIAxH) MM/INCH	4.25x5.59x5.28	WEIGHT	7.06 lbs	<p>TOP</p>  <p>TOP</p>	 <p>MINIMUM 6" UNFORMED CABLE EXTENDING FROM ENTRY PORT FOR STRAIN RELIEF AND SEAL</p> <p>DRIP LOOP REQUIRED</p> <p>27" MINIMUM BEND RADIUS</p>	<p>CONDUIT DETAIL</p> <p>NO SCALE</p> <p>6</p>	<p>IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.</p> <p>DRAWN BY: AJM</p> <p>CHECKED BY: EEW</p> <p>APPROVED BY: AH</p> <p>RFDS REV #: 0</p> <p>09/09/2021</p>				
KAEUS DBC0115F1V91-2														
DIMENSIONS (DIAxH) MM/INCH	4.25x5.59x5.28													
WEIGHT	7.06 lbs													
<p>DIPLEXER DETAIL</p> <p>NO SCALE</p> <p>4</p>	<p>DRIP LOOP - BEND RADIUS - CABLE ENTRY DETAIL</p> <p>NO SCALE</p> <p>5</p>	<p>CONDUIT DETAIL</p> <p>NO SCALE</p> <p>6</p>	<p>CONSTRUCTION DOCUMENTS</p>	<p>CONSTRUCTION DOCUMENTS</p>										
<p>NOT USED</p> <p>NO SCALE</p> <p>7</p>	<p>CABINET CONDUIT DETAIL</p> <p>NO SCALE</p> <p>8</p>	 <p>LIQUID-TIGHT FLEX METAL CONDUIT WITH FITTINGS</p> <p>LB WITH COVER & GASKET</p> <p>RIGID CONDUIT</p> <p>WRAP</p> <p>HOT DIP GALV UNISTRUT WITH EXPANSION ANCHORS AND PLASTIC END CAPS</p> <p>TRANSITION TO RIGID</p> <p>SCHEDULE 80 PVC SWEEP</p>	<p>90 DEGREE ICE BRIDGE DETAIL</p> <p>NO SCALE</p> <p>9</p>	<p>CONSTRUCTION DOCUMENTS</p>										
<p>NOT USED</p> <p>NO SCALE</p> <p>7</p>	<p>CABINET CONDUIT DETAIL</p> <p>NO SCALE</p> <p>8</p>	<p>90 DEGREE ICE BRIDGE DETAIL</p> <p>NO SCALE</p> <p>9</p>	<p>CONSTRUCTION DOCUMENTS</p>	<p>CONSTRUCTION DOCUMENTS</p>										

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM

CHECKED BY: EEW

APPROVED BY: AH

RFDS REV #: 0

09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS

REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416


DISH Wireless L.L.C.
PROJECT INFORMATION

SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040


SHEET TITLE
EQUIPMENT DETAILS

SHEET NUMBER
A-5


FUJITSU DUAL BAND TA08025-B604	
DIMENSIONS (HxWxD)	14.9"x15.7"x7.8"
WEIGHT	63.9 lbs
CONNECTOR TYPE	4.3-10 RF CONNECTOR
POWER SUPPLY	DC -58~-36V




PLAN



BACK




SIDE




FRONT


FUJITSU TRIPLE BAND TA08025-B605	
DIMENSIONS (HxWxD)	14.9"x15.7"x9"
WEIGHT	74.95 lbs
CONNECTOR TYPE	4.3-10 RF CONNECTOR
POWER SUPPLY	DC -58~-36V




PLAN



BACK




SIDE



FRONT

EEI FPS-AB TRIAD FLUH MOUNT	
DESCRIPTION	PART # - QTY
TRIAD-FPS - 1/4" BRACKET ASSEMBLY	PART 1 - QTY: 6
TRIAD-AB - 1/4" HRPO GUSSET ASSEMBLY	PART 2 - QTY: 6
3/8"x5-1/2" A36 THREADED ROD	PART 3 - QTY: 6
3/8"x1-1/4" A307 BOLT	PART 4 - QTY: 6
3/8" HEX NUT	PART 5 - QTY: 6
3/8" FLAT WASHER	PART 6 - QTY: 6
3/8" LOCK WASHER	PART 7 - QTY: 6
TOTAL WEIGHT	±8 lbs

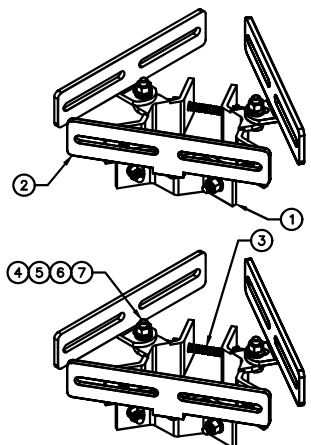

NOTE:
OR DISH Wireless L.L.C.
APPROVED EQUIVALENT



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299


RRH DETAIL NO SCALE 1

RRH DETAIL NO SCALE 2


MAST MOUNT DETAIL NO SCALE 3

NOT USED NO SCALE 4


JMA MX08FRO665-21	
DIMENSIONS (HxWxD)	72"x20.0"x8.0"
RF PORTS, CONNECTOR TYPE	8 x 4.3-10 FEMALE
WEIGHT	64.5 lbs
WEIGHT WITH BRACKETS	82.5 lbs



PLAN


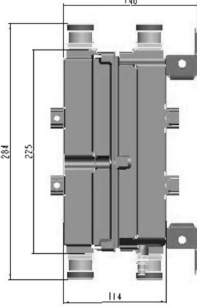



SIDE



FRONT

CDX623T-DS-T E15V95P63	
DIMENSIONS (HxWxD) MM	225x126x115
WEIGHT	10.41 lbs
CONNECTOR	7-16 DIN-FEMALE

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM CHECKED BY: EEW APPROVED BY: AH
RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS


NOT USED NO SCALE 4

ANTENNA DETAIL NO SCALE 5


DIPLEXER DETAIL NO SCALE 6

NOT USED NO SCALE 7


RAYCAP STEALTH SMOOTH MULTI-PART	
RADOME OUTSIDE DIAMETERS	24"-60" DIA.
APPROX. MATERIAL THICKNESS	3/16"
MAX. HEIGHT	12'-0"
CONNECTION	BOLTS OR STRAPS



PLAN

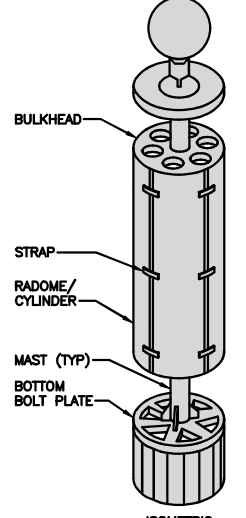

ISOMETRIC

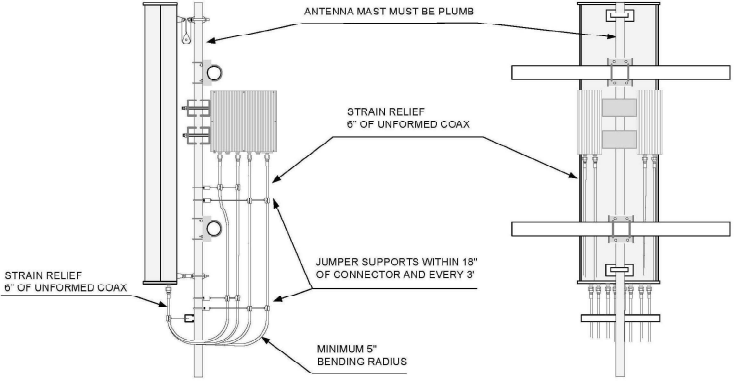

ANTENNA MAST MUST BE PLUMB

STRAIN RELIEF 6" OF UNFORMED COAX

JUMPER SUPPORTS WITHIN 18" OF CONNECTOR AND EVERY 3'

MINIMUM 5" BENDING RADIUS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
EQUIPMENT DETAILS

SHEET NUMBER
A-6

NOT USED NO SCALE 7

RADOME CANISTER DETAIL NO SCALE 8


JUMPER SUPPORTS BEND RADIUS AND STRAIN RELIEF NO SCALE 9

NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL PROPOSED UNDERGROUND UTILITY CONDUIT ROUTE.
2. ANTENNAS AND MOUNTS OMITTED FOR CLARITY.
3. DUE TO UTILITY EASEMENT RIGHTS SPECIFIED IN THE GROUND LEASE, CUSTOMER MAY INSTALL EQUIPMENT WITHIN SPECIFIED UTILITY EASEMENT AREA. "PWR" AND "FBR" PATH DEPICTED ON A-1 AND E-1 REPRESENT PLANNED ROUTING BASED ON BEST AVAILABLE INFORMATION INCLUDING BUT NOT LIMITED TO A SURVEY, EXHIBITS, METES AND BOUNDS OF THE UTILITY EASEMENT, FIELD VERIFICATION, PRIOR PROJECT DOCUMENTATION AND OTHER REAL PROPERTY RIGHTS DOCUMENTS. WHEN INSTALLING THE UTILITIES PLEASE LOCATE AND FOLLOW EXISTING PATH. IF EXISTING PATH IS MATERIALLY INCONSISTENT WITH "PWR" AND "FBR" PATH DEPICTED ON A-1 AND E-1 AND SAID VARIANCE IS NOT NOTED ON CDs, PLEASE NOTIFY TOWER OWNER AS FURTHER COORDINATION MAY BE NEEDED.

DC POWER WIRING SHALL BE COLOR CODED AT EACH END FOR IDENTIFYING +24V AND -48V CONDUCTORS. RED MARKINGS SHALL IDENTIFY +24V AND BLUE MARKINGS SHALL IDENTIFY -48V.

1. CONTRACTOR SHALL INSPECT THE EXISTING CONDITIONS PRIOR TO SUBMITTING A BID. ANY QUESTIONS ARISING DURING THE BID PERIOD IN REGARDS TO THE CONTRACTOR'S FUNCTIONS, THE SCOPE OF WORK, OR ANY OTHER ISSUE RELATED TO THIS PROJECT SHALL BE BROUGHT UP DURING THE BID PERIOD WITH THE PROJECT MANAGER FOR CLARIFICATION, NOT AFTER THE CONTRACT HAS BEEN AWARDED.
2. ALL ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH CURRENT NATIONAL ELECTRICAL CODES AND ALL STATE AND LOCAL CODES, LAWS, AND ORDINANCES. PROVIDE ALL COMPONENTS AND WIRING SIZES AS REQUIRED TO MEET NEC STANDARDS.
3. LOCATION OF EQUIPMENT, CONDUIT AND DEVICES SHOWN ON THE DRAWINGS ARE APPROXIMATE AND SHALL BE COORDINATED WITH FIELD CONDITIONS PRIOR TO CONSTRUCTION.
4. CONDUIT ROUGH-IN SHALL BE COORDINATED WITH THE MECHANICAL EQUIPMENT TO AVOID LOCATION CONFLICTS. VERIFY WITH THE MECHANICAL EQUIPMENT CONTRACTOR AND COMPLY AS REQUIRED.
5. CONTRACTOR SHALL PROVIDE ALL BREAKERS, CONDUITS AND CIRCUITS AS REQUIRED FOR A COMPLETE SYSTEM.
6. CONTRACTOR SHALL PROVIDE PULL BOXES AND JUNCTION BOXES AS REQUIRED BY THE NEC ARTICLE 314.
7. CONTRACTOR SHALL PROVIDE ALL STRAIN RELIEF AND CABLE SUPPORTS FOR ALL CABLE ASSEMBLIES. INSTALLATION SHALL BE IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS.
8. ALL DISCONNECTS AND CONTROLLING DEVICES SHALL BE PROVIDED WITH ENGRAVED PHENOLIC NAMEPLATES INDICATING EQUIPMENT CONTROLLED, BRANCH CIRCUITS INSTALLED ON, AND PANEL FIELD LOCATIONS FED FROM.
9. INSTALL AN EQUIPMENT GROUNDING CONDUCTOR IN ALL CONDUITS PER THE SPECIFICATIONS AND NEC 250. THE EQUIPMENT GROUNDING CONDUCTORS SHALL BE BONDED AT ALL JUNCTION BOXES, PULL BOXES, AND ALL DISCONNECT SWITCHES, AND EQUIPMENT CABINETS.
10. ALL NEW MATERIAL SHALL HAVE A U.L. LABEL.
11. PANEL SCHEDULE LOADING AND CIRCUIT ARRANGEMENTS REFLECT POST-CONSTRUCTION EQUIPMENT.
12. CONTRACTOR SHALL BE RESPONSIBLE FOR AS-BUILT PANEL SCHEDULE AND SITE DRAWINGS.
13. ALL TRENCHES IN COMPOUND TO BE HAND DUG

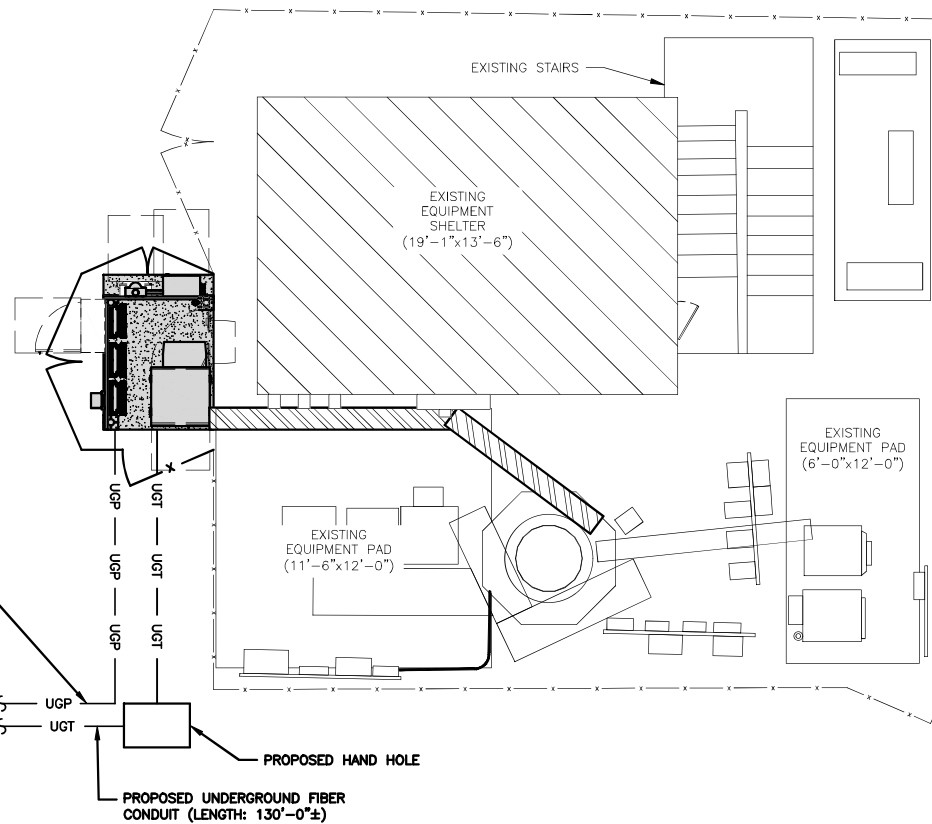

PROPOSED UNDERGROUND POWER CONDUIT (LENGTH: 170'-0"±)


UGP
UGT

PROPOSED HAND HOLE

PROPOSED UNDERGROUND FIBER CONDUIT (LENGTH: 130'-0"±)



UTILITY ROUTE PLAN



1

ELECTRICAL NOTES

NO SCALE

2



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM CHECKED BY: EEW APPROVED BY: AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416


DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
ELECTRICAL/FIBER ROUTE PLAN AND NOTES

SHEET NUMBER

E-1


CARLON EXPANSION FITTINGS				
COUPLING END PART#	MALE TERMINAL ADAPTER END PART#	SIZE	STD CTN QTY.	TRAVEL LENGTH
E945D	E945DX	1/2"	20	4"
E945E	E945EX	3/4"	15	4"
E945F	E945FX	1"	10	4"
E945G	E945GX	1 1/4"	5	4"
E945H	E945HX	1 1/2"	5	4"
E945J	E945JX	2"	15	8"
E945K	E945KX	2 1/2"	10	8"
E945L	E945LX	3"	10	8"
E945M	E945MX	3 1/2"	5	8"
E945N	E945NX	4"	5	8"
E945P	E945PX	5"	1	8"
E945R	E945RX	6"	1	8"

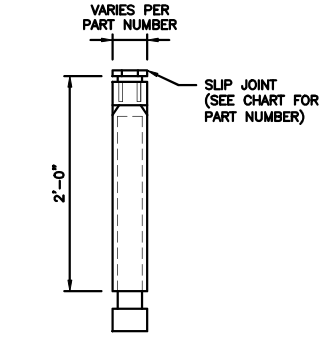

NOTE: CONTRACTOR TO INSTALL EXPANSION FITTING SLIP JOINT AT METER CENTER CONDUIT TERMINATION, AS PER LOCAL UTILITY POLICY, ORDINANCE AND/OR SPECIFIED REQUIREMENT.

TRENCHING NOTES


1. CONTRACTOR SHALL RESTORE THE TRENCH TO ITS ORIGINAL CONDITIONS BY EITHER SEEDING OR SODDING GRASS AREAS, OR REPLACING ASPHALT OR CONCRETE AREAS TO ITS ORIGINAL CROSS SECTION.
2. TRENCHING SAFETY; INCLUDING, BUT NOT LIMITED TO SOIL CLASSIFICATION, SLOPING, AND SHORING, SHALL BE GOVERNED BY THE CURRENT OSHA TRENCHING AND EXCAVATION SAFETY STANDARDS.
3. ALL CONDUITS SHALL BE INSTALLED IN COMPLIANCE WITH THE CURRENT NATIONAL ELECTRIC CODE (NEC) OR AS REQUIRED BY THE LOCAL JURISDICTION, WHICHEVER IS THE MOST STRINGENT.

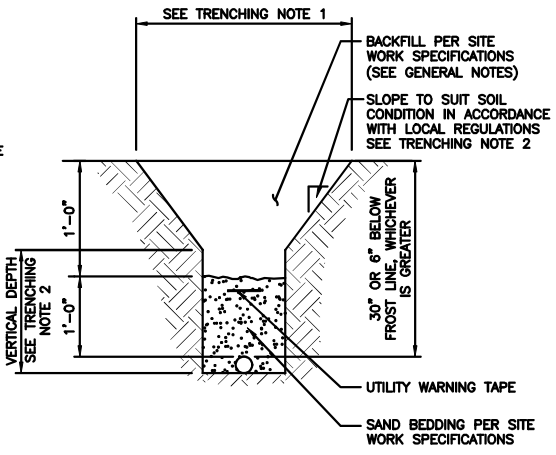

EXPANSION JOINT DETAIL NO SCALE 1

TYPICAL UNDERGROUND TRENCH DETAIL NO SCALE 2

NOT USED NO SCALE 3

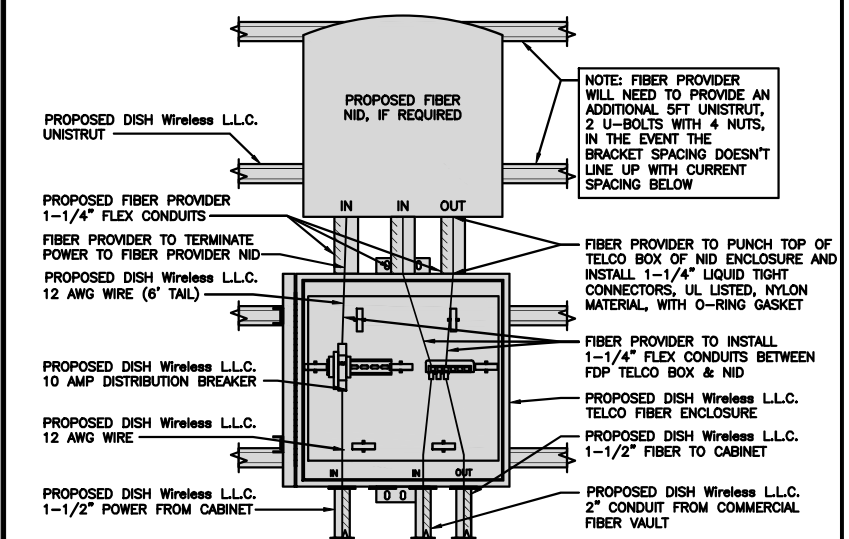

NOTE: FIBER PROVIDER WILL NEED TO PROVIDE AN ADDITIONAL 5FT UNISTRUT, 2 U-BOLTS WITH 4 NUTS, IN THE EVENT THE BRACKET SPACING DOESN'T LINE UP WITH CURRENT SPACING BELOW

LIT TELCO BOX - INTERIOR WIRING LAYOUT (OPTIONAL) NO SCALE 4

NOT USED NO SCALE 5

NOT USED NO SCALE 6

NOT USED NO SCALE 7

NOT USED NO SCALE 8

NOT USED NO SCALE 9



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM CHECKED BY: EEW APPROVED BY: AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS


SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
ELECTRICAL DETAILS

SHEET NUMBER
E-2

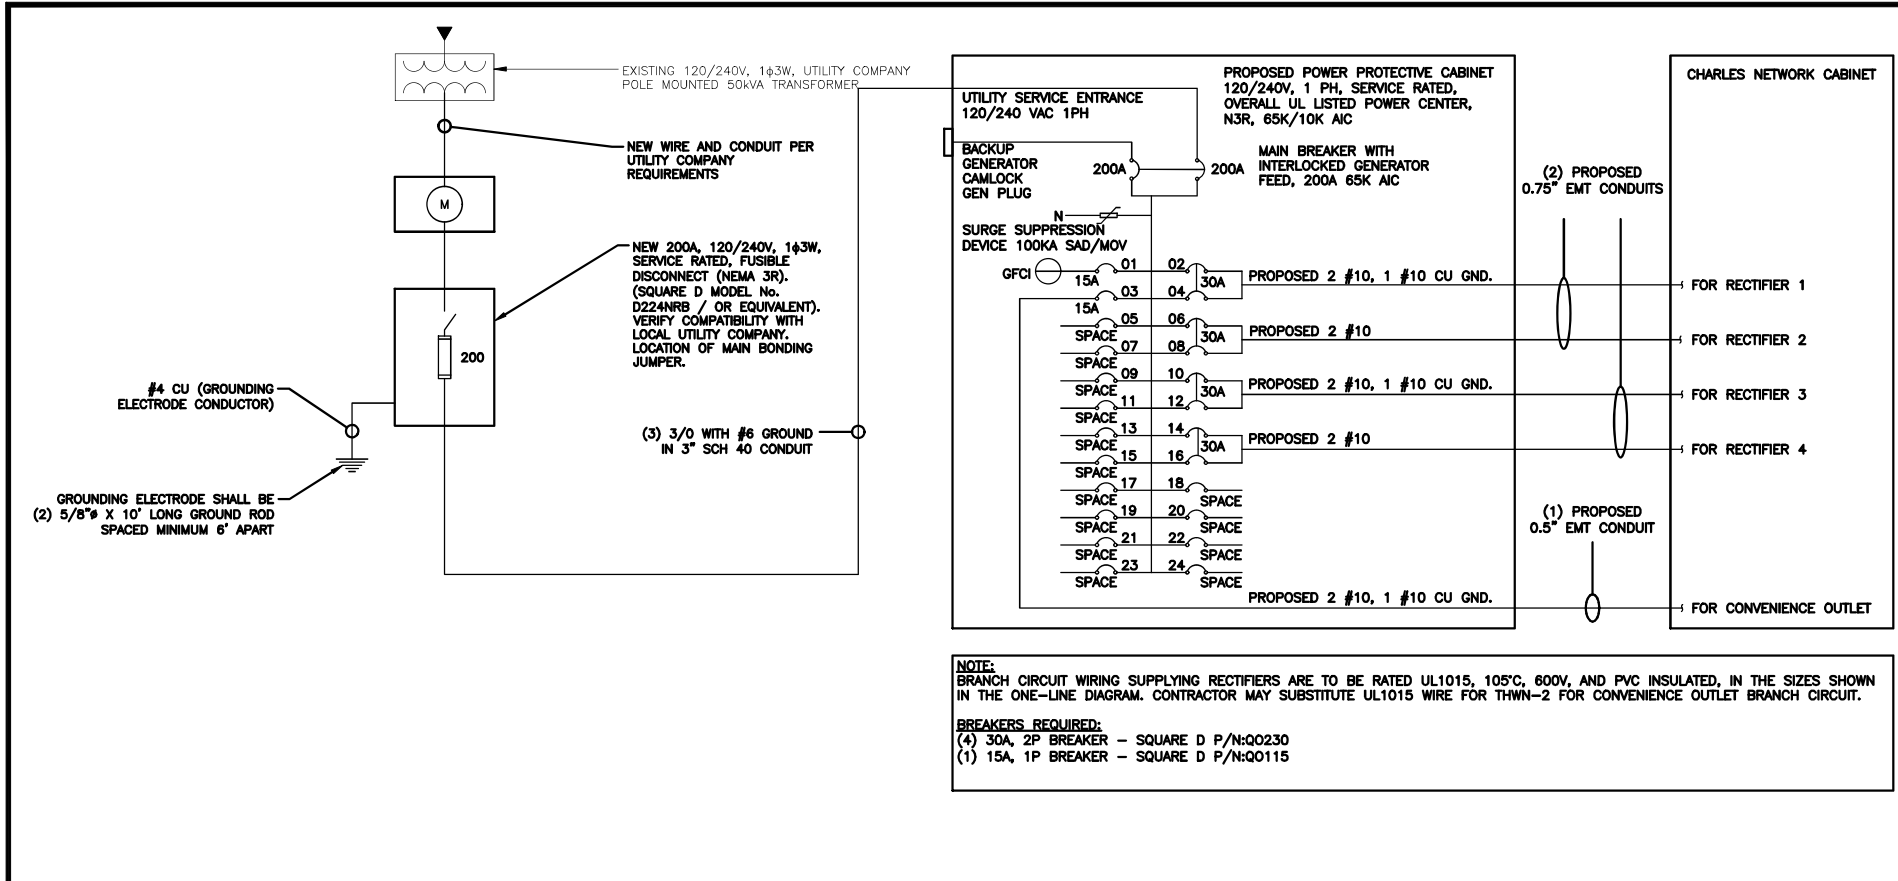

NOTES

THE ENGINEER OF RECORD HAS PERFORMED ALL REQUIRED SHORT CIRCUIT CALCULATIONS AND THE AIC RATINGS FOR EACH DEVICE IS ADEQUATE TO PROTECT THE EQUIPMENT AND THE ELECTRICAL SYSTEM.

THE ENGINEER OF RECORD HAS PERFORMED ALL REQUIRED VOLTAGE DROP CALCULATIONS AND ALL BRANCH CIRCUIT AND FEEDERS COMPLY WITH THE NEC (LISTED ON T-1) ARTICLE 210.19(A)(1) FPN NO. 4.

THE (2) CONDUITS WITH (4) CURRENT CARRYING CONDUCTORS EACH, SHALL APPLY THE ADJUSTMENT FACTOR OF 80% PER 2014/17 NEC TABLE 310.15(B)(3)(a) OR 2020 NEC TABLE 310.15(C)(1) FOR UL1015 WIRE.

#12 FOR 15A-20A/1P BREAKER: 0.8 x 30A = 24.0A
#10 FOR 25A-30A/2P BREAKER: 0.8 x 40A = 32.0A
#8 FOR 35A-40A/2P BREAKER: 0.8 x 55A = 44.0A
#6 FOR 45A-60A/2P BREAKER: 0.8 x 75A = 60.0A

CONDUIT SIZING: AT 40% FILL PER NEC CHAPTER 9, TABLE 4, ARTICLE 358.
0.5" CONDUIT - 0.122 SQ. IN AREA
0.75" CONDUIT - 0.213 SQ. IN AREA
2.0" CONDUIT - 1.316 SQ. IN AREA
3.0" CONDUIT - 2.907 SQ. IN AREA

CABINET CONVENIENCE OUTLET CONDUCTORS (1 CONDUIT): USING THWN-2, CU.

#10 - 0.0211 SQ. IN X 2 = 0.0422 SQ. IN
#10 - 0.0211 SQ. IN X 1 = 0.0211 SQ. IN <GROUND
TOTAL = 0.0633 SQ. IN

0.5" EMT CONDUIT IS ADEQUATE TO HANDLE THE TOTAL OF (3) WIRES, INCLUDING GROUND WIRE, AS INDICATED ABOVE.

RECTIFIER CONDUCTORS (2 CONDUITS): USING UL1015, CU.

#10 - 0.0266 SQ. IN X 4 = 0.1064 SQ. IN
#10 - 0.0082 SQ. IN X 1 = 0.0082 SQ. IN <BARE GROUND
TOTAL = 0.1146 SQ. IN

0.75" EMT CONDUIT IS ADEQUATE TO HANDLE THE TOTAL OF (5) WIRES, INCLUDING GROUND WIRE, AS INDICATED ABOVE.

PPC FEED CONDUCTORS (1 CONDUIT): USING THWN, CU.

3/0 - 0.2679 SQ. IN X 3 = 0.8037 SQ. IN
#6 - 0.0507 SQ. IN X 1 = 0.0507 SQ. IN <GROUND
TOTAL = 0.8544 SQ. IN

3.0" SCH 40 PVC CONDUIT IS ADEQUATE TO HANDLE THE TOTAL OF (4) WIRES, INCLUDING GROUND WIRE, AS INDICATED ABOVE.

dish wireless.

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120

POD
POWER OF DESIGN

11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299

HERKENROT
STATE OF WASHINGTON
REGISTERED PROFESSIONAL ENGINEER
283801
11/10/2023

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM | CHECKED BY: EEW | APPROVED BY: AH

RFDS REV #: 0 | 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS

REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION

SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
ELECTRICAL ONE-LINE, FAULT CALCS & PANEL SCHEDULE

SHEET NUMBER
E-3


PPC ONE-LINE DIAGRAM NO SCALE 1

PROPOSED CHARLES PANEL SCHEDULE

LOAD SERVED	VOLT AMPS (WATTS)		TRIP	CKT #	PHASE	CKT #	TRIP	VOLT AMPS (WATTS)		LOAD SERVED
	L1	L2						L1	L2	
PPC GFCI OUTLET	180	180	15A	1	A	2	30A	2880	2880	ABB/GE INFINITY RECTIFIER 1
CHARLES GFCI OUTLET	180	180	15A	3	B	4	30A	2880	2880	ABB/GE INFINITY RECTIFIER 2
-SPACE-				5	A	6	30A	2880	2880	ABB/GE INFINITY RECTIFIER 3
-SPACE-				7	B	8	30A	2880	2880	ABB/GE INFINITY RECTIFIER 4
-SPACE-				9	A	10	30A	2880	2880	-SPACE-
-SPACE-				11	B	12	30A	2880	2880	-SPACE-
-SPACE-				13	A	14	30A	2880	2880	-SPACE-
-SPACE-				15	B	16	30A	2880	2880	-SPACE-
-SPACE-				17	A	18				-SPACE-
-SPACE-				19	B	20				-SPACE-
-SPACE-				21	A	22				-SPACE-
-SPACE-				23	B	24				-SPACE-
VOLTAGE AMPS	180	180						11520	11520	
200A MCB, 1ϕ, 24 SPACE, 120/240V				L1	L2			VOLTAGE AMPS		
MB RATING: 65,000 AIC				11700	11700			98	98	AMPS
								98	98	MAX AMPS
								123	123	MAX 125%


PANEL SCHEDULE NO SCALE 2

NOT USED NO SCALE 3

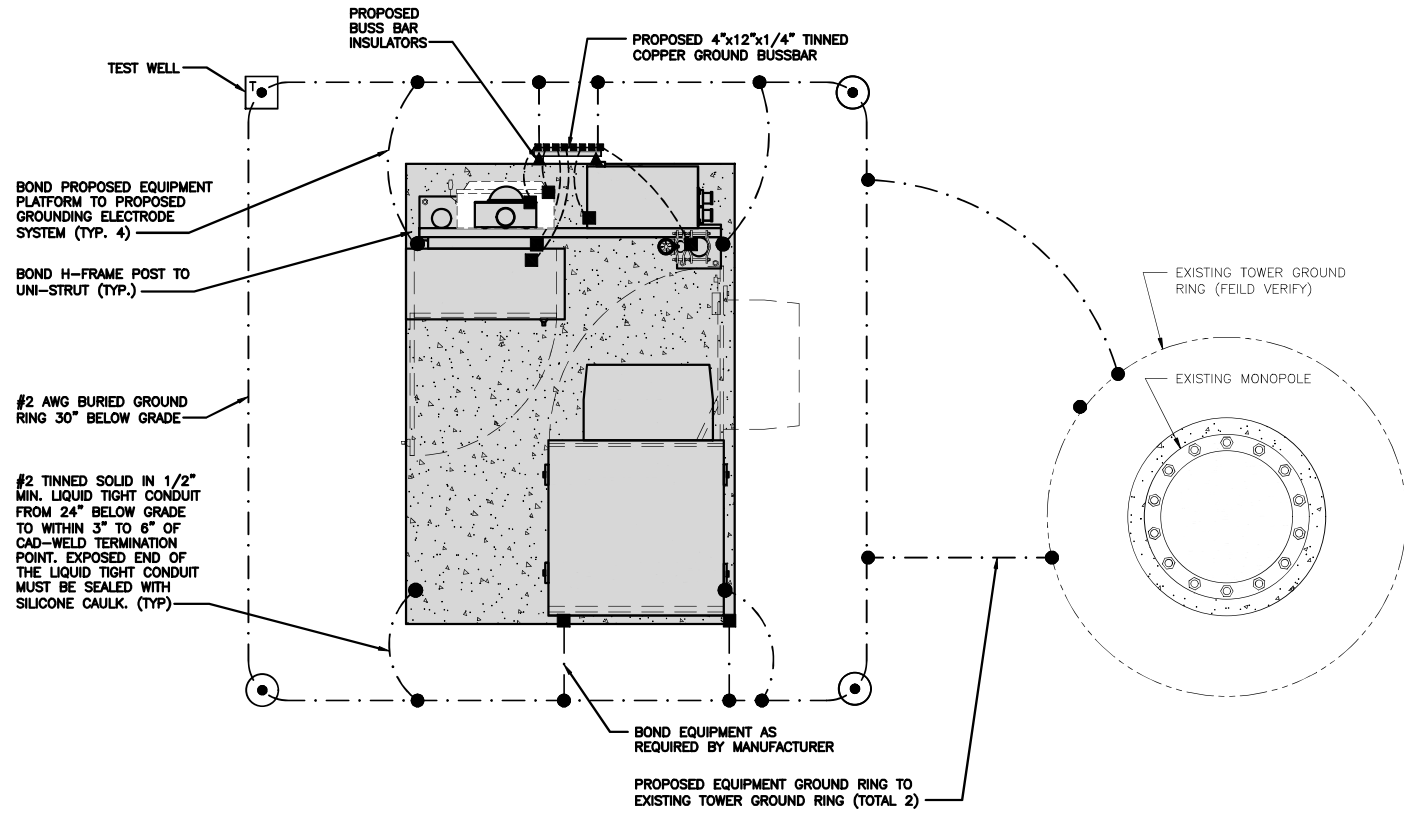


TYPICAL EQUIPMENT GROUNDING PLAN

NO SCALE 1

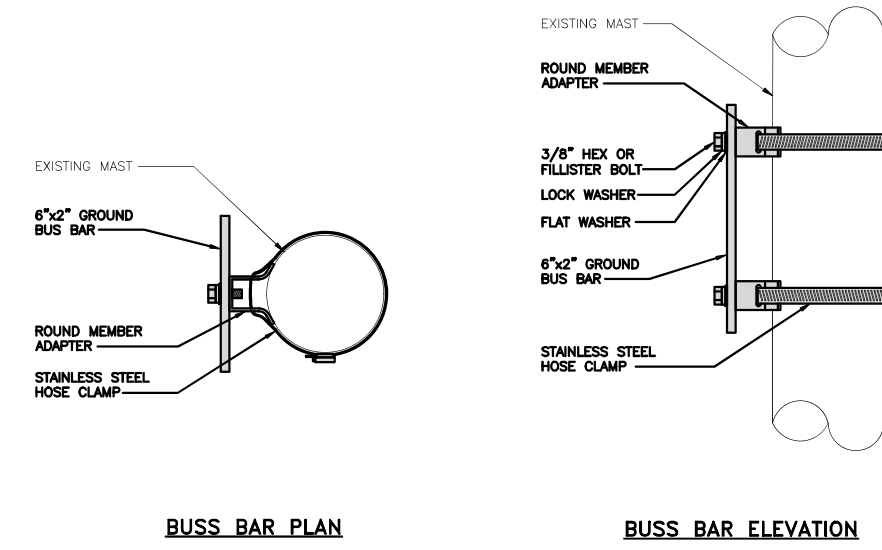

BUSS BAR PLAN


BUSS BAR ELEVATION

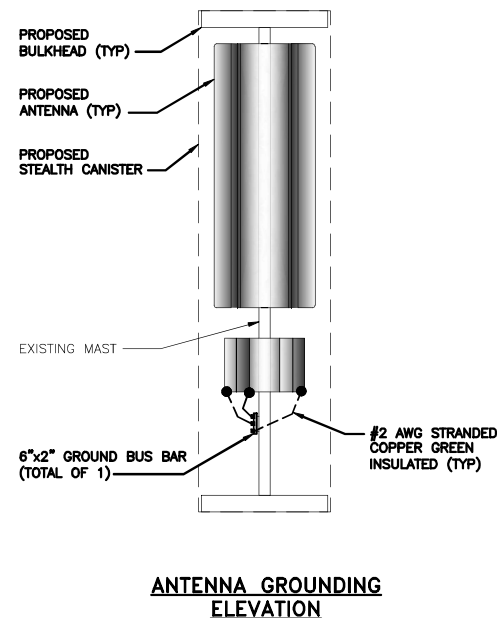

ANTENNA GROUNDING ELEVATION

TYPICAL ANTENNA GROUNDING DETAIL

NO SCALE 2

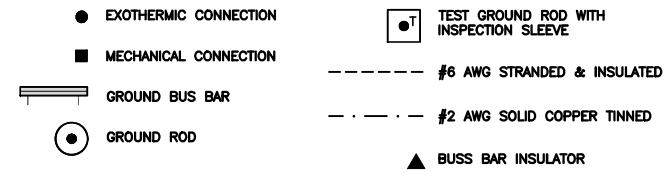

GROUNDING LEGEND

- GROUNDING IS SHOWN DIAGRAMMATICALLY ONLY.
- CONTRACTOR SHALL GROUND ALL EQUIPMENT AS A COMPLETE SYSTEM. GROUNDING SHALL BE IN COMPLIANCE WITH NEC SECTION 250 AND DISH Wireless L.L.C. GROUNDING AND BONDING REQUIREMENTS AND MANUFACTURER'S SPECIFICATIONS.
- ALL GROUND CONDUCTORS SHALL BE COPPER; NO ALUMINUM CONDUCTORS SHALL BE USED.

GROUNDING KEY NOTES

- (A) EXTERIOR GROUND RING: #2 AWG SOLID COPPER, BURIED AT A DEPTH OF AT LEAST 30 INCHES BELOW GRADE, OR 6 INCHES BELOW THE FROST LINE AND APPROXIMATELY 24 INCHES FROM THE EXTERIOR WALL OR FOOTING.
- (B) TOWER GROUND RING: THE GROUND RING SYSTEM SHALL BE INSTALLED AROUND AN ANTENNA TOWER'S LEGS, AND/OR GUY ANCHORS, WHERE SEPARATE SYSTEMS HAVE BEEN PROVIDED FOR THE TOWER AND THE BUILDING, AT LEAST TWO BONDS SHALL BE MADE BETWEEN THE TOWER RING GROUND SYSTEM AND THE BUILDING RING GROUND SYSTEM USING MINIMUM #2 AWG SOLID COPPER CONDUCTORS.
- (C) INTERIOR GROUND RING: #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTOR EXTENDED AROUND THE PERIMETER OF THE EQUIPMENT AREA. ALL NON-TELECOMMUNICATIONS RELATED METALLIC OBJECTS FOUND WITHIN A SITE SHALL BE GROUNDED TO THE INTERIOR GROUND RING WITH #6 AWG STRANDED GREEN INSULATED CONDUCTOR.
- (D) BOND TO INTERIOR GROUND RING: #2 AWG SOLID TINNED COPPER WIRE PRIMARY BONDS SHALL BE PROVIDED AT LEAST AT FOUR POINTS ON THE INTERIOR GROUND RING, LOCATED AT THE CORNERS OF THE BUILDING.
- (E) GROUND ROD: UL LISTED COPPER CLAD STEEL. MINIMUM 1/2" DIAMETER BY EIGHT FEET LONG. GROUND RODS SHALL BE INSTALLED WITH INSPECTION SLEEVES. GROUND RODS SHALL BE DRIVEN TO THE DEPTH OF GROUND RING CONDUCTOR.
- (F) CELL REFERENCE GROUND BAR: POINT OF GROUND REFERENCE FOR ALL COMMUNICATIONS EQUIPMENT FRAMES. ALL BONDS ARE MADE WITH #2 AWG UNLESS NOTED OTHERWISE STRANDED GREEN INSULATED COPPER CONDUCTORS. BOND TO GROUND RING WITH (2) #2 SOLID TINNED COPPER CONDUCTORS.
- (G) HATCH PLATE GROUND BAR: BOND TO THE INTERIOR GROUND RING WITH TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS. WHEN A HATCH-PLATE AND A CELL REFERENCE GROUND BAR ARE BOTH PRESENT, THE CRGB MUST BE CONNECTED TO THE HATCH-PLATE AND TO THE INTERIOR GROUND RING USING (2) TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS EACH.
- (H) EXTERIOR CABLE ENTRY PORT GROUND BARS: LOCATED AT THE ENTRANCE TO THE CELL SITE BUILDING. BOND TO GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTORS WITH AN EXOTHERMIC WELD AND INSPECTION SLEEVE.
- (I) TELCO GROUND BAR: BOND TO BOTH CELL REFERENCE GROUND BAR AND EXTERIOR GROUND RING.
- (J) FRAME BONDING: THE BONDING POINT FOR TELECOM EQUIPMENT FRAMES SHALL BE THE GROUND BUS THAT IS NOT ISOLATED FROM THE EQUIPMENTS METAL FRAMEWORK.
- (K) INTERIOR UNIT BONDS: METAL FRAMES, CABINETS AND INDIVIDUAL METALLIC UNITS LOCATED WITH THE AREA OF THE INTERIOR GROUND RING REQUIRE A #6 AWG STRANDED GREEN INSULATED COPPER BOND TO THE INTERIOR GROUND RING.
- (L) FENCE AND GATE GROUNDING: METAL FENCES WITHIN 7 FEET OF THE EXTERIOR GROUND RING OR OBJECTS BONDED TO THE EXTERIOR GROUND RING SHALL BE BONDED TO THE GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTOR AT AN INTERVAL NOT EXCEEDING 25 FEET. BONDS SHALL BE MADE AT EACH GATE POST AND ACROSS GATE OPENINGS.
- (M) EXTERIOR UNIT BONDS: METALLIC OBJECTS, EXTERNAL TO OR MOUNTED TO THE BUILDING, SHALL BE BONDED TO THE EXTERIOR GROUND RING. USING #2 TINNED SOLID COPPER WIRE
- (N) ICE BRIDGE SUPPORTS: EACH ICE BRIDGE LEG SHALL BE BONDED TO THE GROUND RING WITH #2 AWG BARE TINNED COPPER CONDUCTOR. PROVIDE EXOTHERMIC WELDS AT BOTH THE ICE BRIDGE LEG AND BURIED GROUND RING.
- (O) DURING ALL DC POWER SYSTEM CHANGES INCLUDING DC SYSTEM CHANGE OUTS, RECTIFIER REPLACEMENTS OR ADDITIONS, BREAKER DISTRIBUTION CHANGES, BATTERY ADDITIONS, BATTERY REPLACEMENTS AND INSTALLATIONS OR CHANGES TO DC CONVERTER SYSTEMS IT SHALL BE REQUIRED THAT SERVICE CONTRACTORS VERIFY ALL DC POWER SYSTEMS ARE EQUIPPED WITH A MASTER DC SYSTEM RETURN GROUND CONDUCTOR FROM THE DC POWER SYSTEM COMMON RETURN BUS DIRECTLY CONNECTED TO THE CELL SITE REFERENCE GROUND BAR
- (P) TOWER TOP COLLECTOR BUSS BAR IS TO BE MECHANICALLY BONDED TO PROPOSED ANTENNA MOUNT. REFER TO DISH Wireless L.L.C. GROUNDING NOTES.

GROUNDING KEY NOTES

NO SCALE 3



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM CHECKED BY: EEW APPROVED BY: AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416


DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
GROUNDING PLANS
AND NOTES

SHEET NUMBER

G-1

NOTES
EQUIPMENT CABINET OMITTED FOR CLARITY

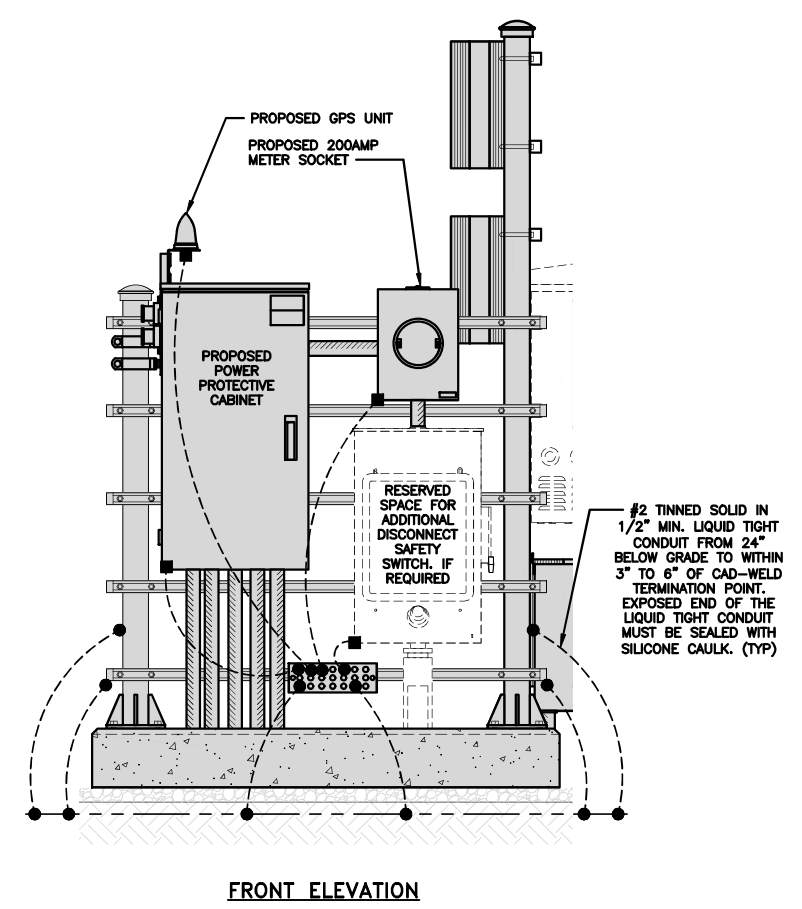

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH
RFDS REV #:	0	09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION


A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
GROUNDING DETAILS


SHEET NUMBER
G-2

NOT USED NO SCALE 1

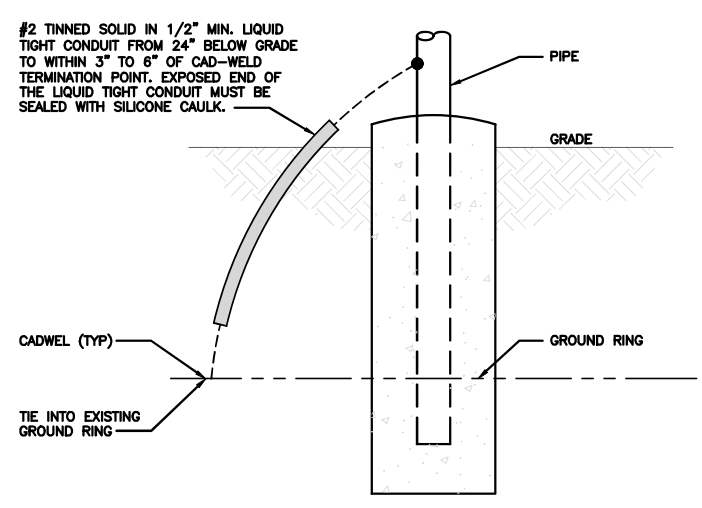


TRANSITIONING GROUND DETAIL NO SCALE 5

H-FRAME GROUNDING DETAIL NO SCALE 4


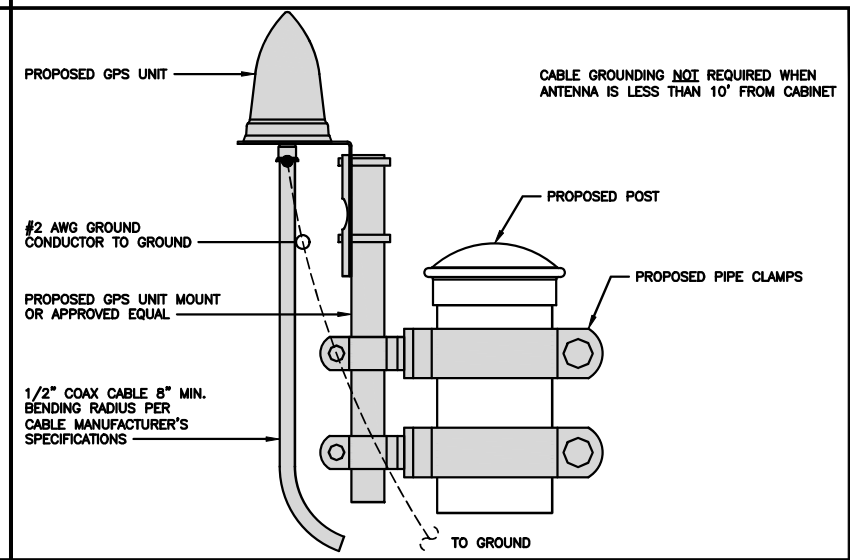


TYPICAL GPS UNIT GROUNDING NO SCALE 6

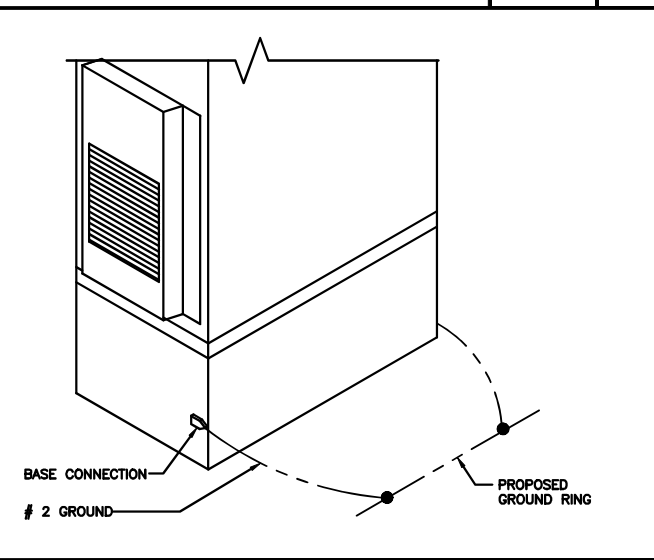

OUTDOOR CABINET GROUNDING NO SCALE 7



- EXOTHERMIC WELD (2) TWO, #2 AWG BARE TINNED SOLID COPPER CONDUCTORS TO GROUND BAR. ROUTE CONDUCTORS TO BURIED GROUND RING AND PROVIDE PARALLEL EXOTHERMIC WELD.
- ALL EXTERIOR GROUNDING HARDWARE SHALL BE STAINLESS STEEL 3/8" DIAMETER OR LARGER. ALL HARDWARE 18-8 STAINLESS STEEL INCLUDING LOCK WASHERS, COAT ALL SURFACES WITH AN ANTI-OXIDANT COMPOUND BEFORE MATING.
- FOR GROUND BOND TO STEEL ONLY: COAT ALL SURFACES WITH AN ANTI-OXIDANT COMPOUND BEFORE MATING.
- DO NOT INSTALL CABLE GROUNDING KIT AT A BEND AND ALWAYS DIRECT GROUND CONDUCTOR DOWN TO GROUNDING BUS.
- NUT & WASHER SHALL BE PLACED ON THE FRONT SIDE OF THE GROUND BAR AND BOLTED ON THE BACK SIDE.
- ALL GROUNDING PARTS AND EQUIPMENT TO BE SUPPLIED AND INSTALLED BY CONTRACTOR.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLING ADDITIONAL GROUND BAR AS REQUIRED.
- ENSURE THE WIRE INSULATION TERMINATION IS WITHIN 1/8" OF THE BARREL (NO SHINERS).

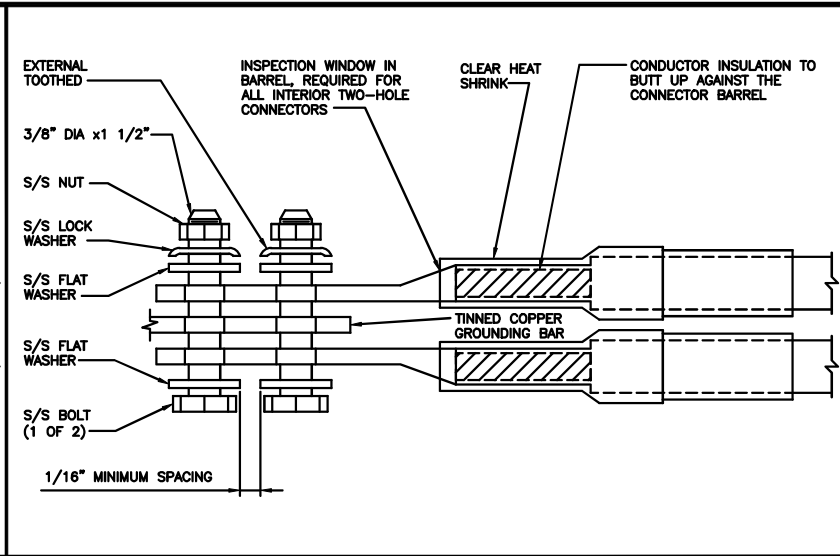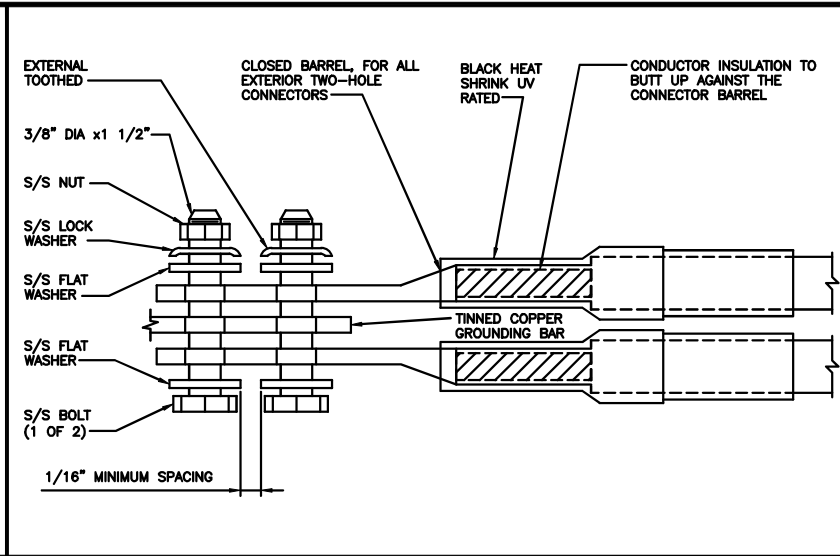

TYPICAL GROUNDING NOTES NO SCALE 1

TYPICAL EXTERIOR TWO HOLE LUG NO SCALE 2

TYPICAL INTERIOR TWO HOLE LUG NO SCALE 3

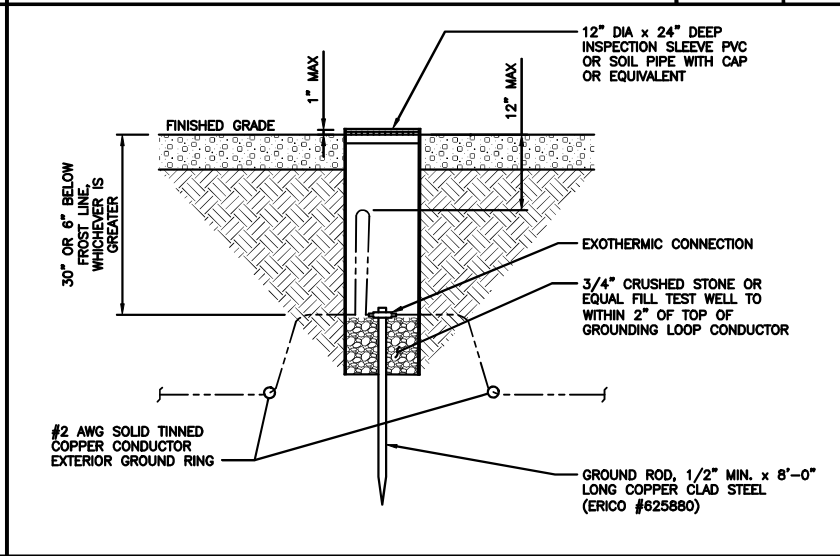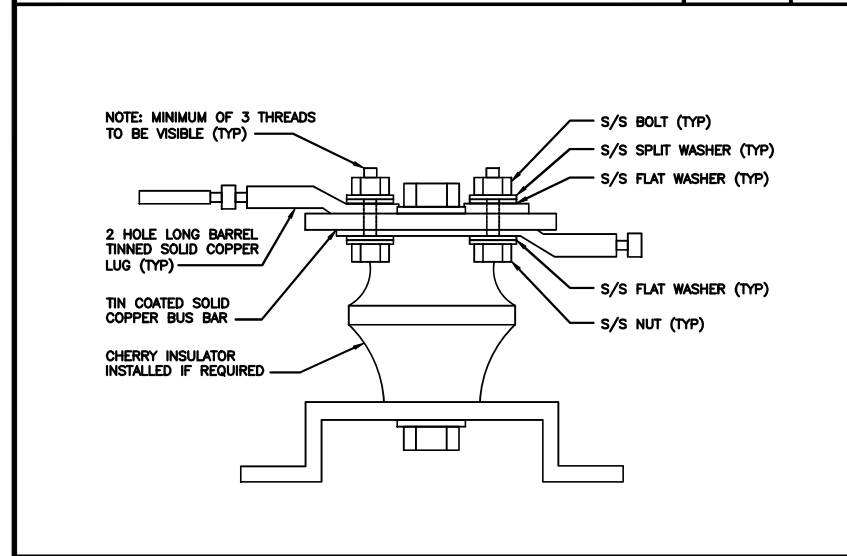

NOT USED NO SCALE 6

LUG DETAIL NO SCALE 4

TYPICAL TEST GROUND ROD WITH INSPECTION SLEEVE NO SCALE 5

NOT USED NO SCALE 7

NOT USED NO SCALE 8

NOT USED NO SCALE 9

dish wireless.
5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120

POD
POWER OF DESIGN
11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299

11/10/2023

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM CHECKED BY: EEW APPROVED BY: AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
5	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
GROUNDING DETAILS

SHEET NUMBER
G-3

HYBRID/DISCREET CABLES		3/4" TAPE WIDTHS WITH 3/4" SPACING											
<p>LOW-BAND RRH (600 MHz N71 BASEBAND) + (850 MHz N26 BAND) + (700 MHz N29 BAND) - OPTIONAL PER MARKET</p> <p>ADD FREQUENCY COLOR TO SECTOR BAND (CBRS WILL USE YELLOW BAND)</p>	ALPHA RRH				BETA RRH				GAMMA RRH				
	PORT 1 + SLANT	PORT 2 - SLANT	PORT 3 + SLANT	PORT 4 - SLANT	PORT 1 + SLANT	PORT 2 - SLANT	PORT 3 + SLANT	PORT 4 - SLANT	PORT 1 + SLANT	PORT 2 - SLANT	PORT 3 + SLANT	PORT 4 - SLANT	
	RED	RED	RED	RED	BLUE	BLUE	BLUE	BLUE	GREEN	GREEN	GREEN	GREEN	
<p>MID-BAND RRH (AWS BANDS N66+N70)</p> <p>ADD FREQUENCY COLOR TO SECTOR BAND (CBRS WILL USE YELLOW BANDS)</p>	ALPHA RRH				BETA RRH				GAMMA RRH				
	PORT 1 + SLANT	PORT 2 - SLANT	PORT 3 + SLANT	PORT 4 - SLANT	PORT 1 + SLANT	PORT 2 - SLANT	PORT 3 + SLANT	PORT 4 - SLANT	PORT 1 + SLANT	PORT 2 - SLANT	PORT 3 + SLANT	PORT 4 - SLANT	
	RED	RED	RED	RED	BLUE	BLUE	BLUE	BLUE	GREEN	GREEN	GREEN	GREEN	
<p>HYBRID/DISCREET CABLES</p> <p>INCLUDE SECTOR BANDS BEING SUPPORTED ALONG WITH FREQUENCY BANDS.</p> <p>EXAMPLE 1 - HYBRID, OR DISCREET, SUPPORTS ALL SECTORS, BOTH LOW-BANDS AND MID-BANDS.</p> <p>EXAMPLE 2 - HYBRID, OR DISCREET, SUPPORTS CBRS ONLY, ALL SECTORS.</p> <p>EXAMPLE 3 - MAIN COAX WITH GROUND MOUNTED RRHS.</p>		EXAMPLE 1	EXAMPLE 2	EXAMPLE 3	CANISTER COAX #1 (ALPHA)	CANISTER COAX #2 (ALPHA)							
<p>FIBER JUMPERS TO RRHs</p> <p>LOW-BAND HHR FIBER CABLES HAVE SECTOR STRIPE ONLY.</p>		LOW BAND RRH	MID BAND RRH	LOW BAND RRH	MID BAND RRH	LOW BAND RRH	MID BAND RRH						
<p>POWER CABLES TO RRHs</p> <p>LOW-BAND RRH POWER CABLES HAVE SECTOR STRIPE ONLY.</p>		LOW BAND RRH	MID BAND RRH	LOW BAND RRH	MID BAND RRH	LOW BAND RRH	MID BAND RRH						
<p>RET MOTORS AT ANTENNAS</p> <p>RET CONTROL IS HANDLED BY THE MID-BAND RRH WHEN ONE SET OF RET PORTS EXIST ON ANTENNA.</p> <p>SEPARATE RET CABLES ARE USED WHEN ANTENNA PORTS PROVIDE INPUTS FOR BOTH LOW AND MID BANDS.</p>		ANTENNA 1 MID BAND	ANTENNA 1 MID BAND	ANTENNA 1 MID BAND	ANTENNA 1 MID BAND	ANTENNA 1 MID BAND	ANTENNA 1 MID BAND						
<p>MICROWAVE RADIO LINKS</p> <p>LINKS WILL HAVE A 1.5-2 INCH WHITE WRAP WITH THE AZIMUTH COLOR OVERLAPPING IN THE MIDDLE.</p> <p>ADD ADDITIONAL SECTOR COLOR BANDS FOR EACH ADDITIONAL MW RADIO.</p> <p>MICROWAVE CABLES WILL REQUIRE P-TOUCH LABELS INSIDE THE CABINET TO IDENTIFY THE LOCAL AND REMOTE SITE ID'S.</p>		FORWARD AZIMUTH OF 0-120 DEGREES		FORWARD AZIMUTH OF 120-240 DEGREES		FORWARD AZIMUTH OF 240-359 DEGREES							
		PRIMARY	SECONDARY	PRIMARY	SECONDARY	PRIMARY	SECONDARY						
		WHITE	WHITE	WHITE	WHITE	WHITE	WHITE						
		RED	RED	BLUE	BLUE	GREEN	GREEN						
		WHITE	WHITE	WHITE	WHITE	WHITE	WHITE						
		RED	RED	BLUE	BLUE	GREEN	GREEN						
		WHITE	WHITE	WHITE	WHITE	WHITE	WHITE						

RF CABLE COLOR CODES

NO SCALE

1

NOT USED

NO SCALE

4

LOW BANDS (N71+N26)
OPTIONAL - (N29)

ORANGE

AWS
(N66+N70+H-BLOCK)

PURPLE

CBRS TECH
(3 GHz)

YELLOW

NEGATIVE SLANT PORT
ON ANT/RRH

WHITE

ALPHA SECTOR

RED

BETA SECTOR

BLUE

GAMMA SECTOR

GREEN

COLOR IDENTIFIER

NO SCALE

2

NOT USED

NO SCALE

3

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120

11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299

FOR REFERENCE PURPOSES ONLY

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY: AJM | CHECKED BY: EEW | APPROVED BY: AH

RFDS REV #: 0 | 09/09/2021

CONSTRUCTION DOCUMENTS

REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
RF
CABLE COLOR CODE

SHEET NUMBER
RF-1

EXOTHERMIC CONNECTION	
MECHANICAL CONNECTION	
BUSS BAR INSULATOR	
CHEMICAL ELECTROLYTIC GROUNDING SYSTEM	
TEST CHEMICAL ELECTROLYTIC GROUNDING SYSTEM	
EXOTHERMIC WITH INSPECTION SLEEVE	
GROUNDING BAR	
GROUND ROD	
TEST GROUND ROD WITH INSPECTION SLEEVE	
SINGLE POLE SWITCH	
DUPLEX RECEPTACLE	
DUPLEX GFCI RECEPTACLE	
FLUORESCENT LIGHTING FIXTURE (2) TWO LAMPS 48-T8	
SMOKE DETECTION (DC)	
EMERGENCY LIGHTING (DC)	
SECURITY LIGHT W/PHOTOCELL LITHONIA ALXW LED-1-25A400/51K-SR4-120-PE-DBBTXD	
CHAIN LINK FENCE	
WOOD/WROUGHT IRON FENCE	
WALL STRUCTURE	
LEASE AREA	
PROPERTY LINE (PL)	
SETBACKS	
ICE BRIDGE	
CABLE TRAY	
WATER LINE	
UNDERGROUND POWER	
UNDERGROUND TELCO	
OVERHEAD POWER	
OVERHEAD TELCO	
UNDERGROUND TELCO/POWER	
ABOVE GROUND POWER	
ABOVE GROUND TELCO	
ABOVE GROUND TELCO/POWER	
WORKPOINT	
SECTION REFERENCE	
DETAIL REFERENCE	

LEGEND

AB	ANCHOR BOLT	IN	INCH
ABV	ABOVE	INT	INTERIOR
AC	ALTERNATING CURRENT	LB(S)	POUND(S)
ADDL	ADDITIONAL	LF	LINEAR FEET
AFF	ABOVE FINISHED FLOOR	LTE	LONG TERM EVOLUTION
AFG	ABOVE FINISHED GRADE	MAS	MASONRY
AGL	ABOVE GROUND LEVEL	MAX	MAXIMUM
AIC	AMPERAGE INTERRUPTION CAPACITY	MB	MACHINE BOLT
ALUM	ALUMINUM	MECH	MECHANICAL
ALT	ALTERNATE	MFR	MANUFACTURER
ANT	ANTENNA	MGB	MASTER GROUND BAR
APPROX	APPROXIMATE	MIN	MINIMUM
ARCH	ARCHITECTURAL	MISC	MISCELLANEOUS
ATS	AUTOMATIC TRANSFER SWITCH	MTL	METAL
AWG	AMERICAN WIRE GAUGE	MTS	MANUAL TRANSFER SWITCH
BATT	BATTERY	MW	MICROWAVE
BLDG	BUILDING	NEC	NATIONAL ELECTRIC CODE
BLK	BLOCK	NM	NEWTON METERS
BLKG	BLOCKING	NO.	NUMBER
BM	BEAM	#	NUMBER
BTC	BARE TINNED COPPER CONDUCTOR	NTS	NOT TO SCALE
BOF	BOTTOM OF FOOTING	OC	ON-CENTER
CAB	CABINET	OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
CANT	CANTILEVERED	OPNG	OPENING
CHG	CHARGING	P/C	PRECAST CONCRETE
CLG	CEILING	PCS	PERSONAL COMMUNICATION SERVICES
CLR	CLEAR	PCU	PRIMARY CONTROL UNIT
COL	COLUMN	PRC	PRIMARY RADIO CABINET
COMM	COMMON	PP	POLARIZING PRESERVING
CONC	CONCRETE	PSF	POUNDS PER SQUARE FOOT
CONSTR	CONSTRUCTION	PSI	POUNDS PER SQUARE INCH
DBL	DOUBLE	PT	PRESSURE TREATED
DC	DIRECT CURRENT	PWR	POWER CABINET
DEPT	DEPARTMENT	QTY	QUANTITY
DF	DOUGLAS FIR	RAD	RADIUS
DIA	DIAMETER	RECT	RECTIFIER
DIAG	DIAGONAL	REF	REFERENCE
DIM	DIMENSION	REINF	REINFORCEMENT
DWG	DRAWING	REQ'D	REQUIRED
DWL	DOWEL	RET	REMOTE ELECTRIC TILT
EA	EACH	RF	RADIO FREQUENCY
EC	ELECTRICAL CONDUCTOR	RMC	RIGID METALLIC CONDUIT
EL	ELEVATION	RRH	REMOTE RADIO HEAD
ELEC	ELECTRICAL	RRU	REMOTE RADIO UNIT
EMT	ELECTRICAL METALLIC TUBING	RWY	RACEWAY
ENG	ENGINEER	SCH	SCHEDULE
EQ	EQUAL	SHT	SHEET
EXP	EXPANSION	SIAD	SMART INTEGRATED ACCESS DEVICE
EXT	EXTERIOR	SIM	SIMILAR
EW	EACH WAY	SPEC	SPECIFICATION
FAB	FABRICATION	SQ	SQUARE
FF	FINISH FLOOR	SS	STAINLESS STEEL
FG	FINISH GRADE	STD	STANDARD
FIF	FACILITY INTERFACE FRAME	STL	STEEL
FIN	FINISH(ED)	TEMP	TEMPORARY
FLR	FLOOR	THK	THICKNESS
FDN	FOUNDATION	TMA	TOWER MOUNTED AMPLIFIER
FOC	FACE OF CONCRETE	TN	TOE NAIL
FOM	FACE OF MASONRY	TOA	TOP OF ANTENNA
FOS	FACE OF STUD	TOC	TOP OF CURB
FOW	FACE OF WALL	TOP	TOP OF FOUNDATION
FS	FINISH SURFACE	TOP	TOP OF PLATE (PARAPET)
FT	FOOT	TOS	TOP OF STEEL
FTG	FOOTING	TOW	TOP OF WALL
GA	GAUGE	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSION
GEN	GENERATOR	TYP	TYPICAL
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	UG	UNDERGROUND
GLB	GLUE LAMINATED BEAM	UL	UNDERWRITERS LABORATORY
GLV	GALVANIZED	UNO	UNLESS NOTED OTHERWISE
GPS	GLOBAL POSITIONING SYSTEM	UMTS	UNIVERSAL MOBILE TELECOMMUNICATIONS SYSTEM
GND	GROUND	UPS	UNINTERRUPTIBLE POWER SYSTEM (DC POWER PLANT)
GSM	GLOBAL SYSTEM FOR MOBILE	VIF	VERIFIED IN FIELD
HDG	HOT DIPPED GALVANIZED	W	WIDE
HDR	HEADER	W/	WITH
HGR	HANGER	WD	WOOD
HVAC	HEAT/VENTILATION/AIR CONDITIONING	WP	WEATHERPROOF
HT	HEIGHT	WT	WEIGHT
IGR	INTERIOR GROUND RING		

ABBREVIATIONS



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
LEGEND AND ABBREVIATIONS

SHEET NUMBER
GN-1

SIGN TYPES		
TYPE	COLOR	COLOR CODE PURPOSE
INFORMATION	GREEN	"INFORMATIONAL SIGN" TO NOTIFY OTHERS OF SITE OWNERSHIP & CONTACT NUMBER AND POTENTIAL RF EXPOSURE.
NOTICE	BLUE	"NOTICE BEYOND THIS POINT" RF FIELDS BEYOND THIS POINT MAY EXCEED THE FCC GENERAL PUBLIC EXPOSURE LIMIT. OBEY ALL POSTED SIGNS AND SITE GUIDELINES FOR WORKING IN RF ENVIRONMENTS. IN ACCORDANCE WITH FEDERAL COMMUNICATIONS COMMISSION RULES ON RADIO FREQUENCY EMISSIONS 47 CFR-1.1307(b)
CAUTION	YELLOW	"CAUTION BEYOND THIS POINT" RF FIELDS BEYOND THIS POINT MAY EXCEED THE FCC GENERAL PUBLIC EXPOSURE LIMIT. OBEY ALL POSTED SIGNS AND SITE GUIDELINES FOR WORKING IN RF ENVIRONMENTS. IN ACCORDANCE WITH FEDERAL COMMUNICATIONS COMMISSION RULES ON RADIO FREQUENCY EMISSIONS 47 CFR-1.1307(b)
WARNING	ORANGE/RED	"WARNING BEYOND THIS POINT" RF FIELDS AT THIS SITE EXCEED FCC RULES FOR HUMAN EXPOSURE. FAILURE TO OBEY ALL POSTED SIGNS AND SITE GUIDELINES FOR WORKING IN RF ENVIRONMENTS COULD RESULT IN SERIOUS INJURY. IN ACCORDANCE WITH FEDERAL COMMUNICATIONS COMMISSION RULES ON RADIO FREQUENCY EMISSIONS 47 CFR-1.1307(b)

- SIGN PLACEMENT:**
- RF SIGNAGE PLACEMENT SHALL FOLLOW THE RECOMMENDATIONS OF AN EXISTING EME REPORT, CREATED BY A THIRD PARTY PREVIOUSLY AUTHORIZED BY DISH Wireless L.L.C.
 - INFORMATION SIGN (GREEN) SHALL BE LOCATED ON EXISTING DISH Wireless L.L.C. EQUIPMENT.
 - A) IF THE INFORMATION SIGN IS A STICKER, IT SHALL BE PLACED ON EXISTING DISH Wireless L.L.C. EQUIPMENT CABINET.
 - B) IF THE INFORMATION SIGN IS A METAL SIGN IT SHALL BE PLACED ON EXISTING DISH Wireless L.L.C. H-FRAME WITH A SECURE ATTACH METHOD.
 - IF EME REPORT IS NOT AVAILABLE AT THE TIME OF CREATION OF CONSTRUCTION DOCUMENTS; PLEASE CONTACT DISH Wireless L.L.C. CONSTRUCTION MANAGER FOR FURTHER INSTRUCTION ON HOW TO PROCEED.
- NOTES:**
1. FOR DISH Wireless L.L.C. LOGO, SEE DISH Wireless L.L.C. DESIGN SPECIFICATIONS (PROVIDED BY DISH Wireless L.L.C.)
 2. SITE ID SHALL BE APPLIED TO SIGNS USING "LASER ENGRAVING" OR ANY OTHER WEATHER RESISTANT METHOD (DISH Wireless L.L.C. APPROVAL REQUIRED)
 3. TEXT FOR SIGNAGE SHALL INDICATE CORRECT SITE NAME AND NUMBER AS PER DISH Wireless L.L.C. CONSTRUCTION MANAGER RECOMMENDATIONS.
 4. CABINET/SHELTER MOUNTING APPLICATION REQUIRES ANOTHER PLATE APPLIED TO THE FACE OF THE CABINET WITH WATER PROOF POLYURETHANE ADHESIVE
 5. ALL SIGNS WILL BE SECURED WITH EITHER STAINLESS STEEL ZIP TIES OR STAINLESS STEEL TECH SCREWS
 6. ALL SIGNS TO BE 8.5"x11" AND MADE WITH 0.04" OF ALUMINUM MATERIAL

INFORMATION

This is an access point to an area with transmitting antennas.

Obey all signs and barriers beyond this point.
Call the DISH Wireless L.L.C. NOC at 1-866-624-6874

Site ID: _____

THIS SIGN IS FOR REFERENCE PURPOSES ONLY

NOTICE

Transmitting Antenna(s)

Radio frequency fields beyond this point **MAY EXCEED** the FCC Occupational exposure limit.

Obey all posted signs and site guidelines for working in radio frequency environments.

Call the DISH Wireless L.L.C. NOC at 1-866-624-6874 prior to working beyond this point.

Site ID: _____

dish

THIS SIGN IS FOR REFERENCE PURPOSES ONLY

CAUTION

Transmitting Antenna(s)

Radio frequency fields beyond this point **MAY EXCEED** the FCC Occupational exposure limit.

Obey all posted signs and site guidelines for working in radio frequency environments.

Call the DISH Wireless L.L.C. NOC at 1-866-624-6874 prior to working beyond this point.

Site ID: _____

dish

THIS SIGN IS FOR REFERENCE PURPOSES ONLY

WARNING

Transmitting Antenna(s)

Radio frequency fields beyond this point **EXCEED** the FCC Occupational exposure limit.

Obey all posted signs and site guidelines for working in radio frequency environments.

Call the DISH Wireless L.L.C. NOC at 1-866-624-6874 prior to working beyond this point.

Site ID: _____

dish

THIS SIGN IS FOR REFERENCE PURPOSES ONLY

5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120

POWER OF DESIGN
11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299

11/10/2023

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
GENERAL NOTES

SHEET NUMBER
GN-2

CONCRETE, FOUNDATIONS, AND REINFORCING STEEL:

1. ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE ACI 301, ACI 318, ACI 336, ASTM A184, ASTM A185 AND THE DESIGN AND CONSTRUCTION SPECIFICATION FOR CAST-IN-PLACE CONCRETE.
2. UNLESS NOTED OTHERWISE, SOIL BEARING PRESSURE USED FOR DESIGN OF SLABS AND FOUNDATIONS IS ASSUMED TO BE 1000 psf.
3. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH (f'c) OF 3000 psi AT 28 DAYS, UNLESS NOTED OTHERWISE. NO MORE THAN 90 MINUTES SHALL ELAPSE FROM BATCH TIME TO TIME OF PLACEMENT UNLESS APPROVED BY THE ENGINEER OF RECORD. TEMPERATURE OF CONCRETE SHALL NOT EXCEED 90°F AT TIME OF PLACEMENT.
4. CONCRETE EXPOSED TO FREEZE–THAW CYCLES SHALL CONTAIN AIR ENTRAINING ADMIXTURES. AMOUNT OF AIR ENTRAINMENT TO BE BASED ON SIZE OF AGGREGATE AND F3 CLASS EXPOSURE (VERY SEVERE). CEMENT USED TO BE TYPE II PORTLAND CEMENT WITH A MAXIMUM WATER–TO–CEMENT RATIO (W/C) OF 0.45.
5. ALL STEEL REINFORCING SHALL CONFORM TO ASTM A615. ALL WELDED WIRE FABRIC (WWF) SHALL CONFORM TO ASTM A185. ALL SPLICES SHALL BE CLASS "B" TENSION SPLICES, UNLESS NOTED OTHERWISE. ALL HOOKS SHALL BE STANDARD 90 DEGREE HOOKS, UNLESS NOTED OTHERWISE. YIELD STRENGTH (Fy) OF STANDARD DEFORMED BARS ARE AS FOLLOWS:
 #4 BARS AND SMALLER 40 ksi
 #5 BARS AND LARGER 60 ksi
6. THE FOLLOWING MINIMUM CONCRETE COVER SHALL BE PROVIDED FOR REINFORCING STEEL UNLESS SHOWN OTHERWISE ON DRAWINGS:
 - CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3"
 - CONCRETE EXPOSED TO EARTH OR WEATHER:
 - #6 BARS AND LARGER 2"
 - #5 BARS AND SMALLER 1–1/2"
 - CONCRETE NOT EXPOSED TO EARTH OR WEATHER:
 - SLAB AND WALLS 3/4"
 - BEAMS AND COLUMNS 1–1/2"
7. A TOOLED EDGE OR A 3/4" CHAMFER SHALL BE PROVIDED AT ALL EXPOSED EDGES OF CONCRETE, UNLESS NOTED OTHERWISE, IN ACCORDANCE WITH ACI 301 SECTION 4.2.4.

ELECTRICAL INSTALLATION NOTES:

1. ALL ELECTRICAL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS, NEC AND ALL APPLICABLE FEDERAL, STATE, AND LOCAL CODES/ORDINANCES.
2. CONDUIT ROUTINGS ARE SCHEMATIC. CONTRACTOR SHALL INSTALL CONDUITS SO THAT ACCESS TO EQUIPMENT IS NOT BLOCKED AND TRIP HAZARDS ARE ELIMINATED.
3. WIRING, RACEWAY AND SUPPORT METHODS AND MATERIALS SHALL COMPLY WITH THE REQUIREMENTS OF THE NEC.
4. ALL CIRCUITS SHALL BE SEGREGATED AND MAINTAIN MINIMUM CABLE SEPARATION AS REQUIRED BY THE NEC.
- 4.1. ALL EQUIPMENT SHALL BEAR THE UNDERWRITERS LABORATORIES LABEL OF APPROVAL, AND SHALL CONFORM TO REQUIREMENT OF THE NATIONAL ELECTRICAL CODE.
- 4.2. ALL OVERCURRENT DEVICES SHALL HAVE AN INTERRUPTING CURRENT RATING THAT SHALL BE GREATER THAN THE SHORT CIRCUIT CURRENT TO WHICH THEY ARE SUBJECTED, 22,000 AIC MINIMUM. VERIFY AVAILABLE SHORT CIRCUIT CURRENT DOES NOT EXCEED THE RATING OF ELECTRICAL EQUIPMENT IN ACCORDANCE WITH ARTICLE 110.24 NEC OR THE MOST CURRENT ADOPTED CODE PRE THE GOVERNING JURISDICTION.
5. EACH END OF EVERY POWER PHASE CONDUCTOR, GROUNDING CONDUCTOR, AND TELCO CONDUCTOR OR CABLE SHALL BE LABELED WITH COLOR–CODED INSULATION OR ELECTRICAL TAPE (3M BRAND, 1/2" PLASTIC ELECTRICAL TAPE WITH UV PROTECTION, OR EQUAL). THE IDENTIFICATION METHOD SHALL CONFORM WITH NEC AND OSHA.
6. ALL ELECTRICAL COMPONENTS SHALL BE CLEARLY LABELED WITH LAMICOID TAGS SHOWING THEIR RATED VOLTAGE, PHASE CONFIGURATION, WIRE CONFIGURATION, POWER OR AMPACITY RATING AND BRANCH CIRCUIT ID NUMBERS (i.e. PANEL BOARD AND CIRCUIT ID'S).
7. PANEL BOARDS (ID NUMBERS) SHALL BE CLEARLY LABELED WITH PLASTIC LABELS.
8. TIE WRAPS ARE NOT ALLOWED.
9. ALL POWER AND EQUIPMENT GROUND WIRING IN TUBING OR CONDUIT SHALL BE SINGLE COPPER CONDUCTOR (#14 OR LARGER) WITH TYPE THHW, THWN, THWN–2, XHHW, XHHW–2, THW, THW–2, RHW, OR RHW–2 INSULATION UNLESS OTHERWISE SPECIFIED.
10. SUPPLEMENTAL EQUIPMENT GROUND WIRING LOCATED INDOORS SHALL BE SINGLE COPPER CONDUCTOR (#6 OR LARGER) WITH TYPE THHW, THWN, THWN–2, XHHW, XHHW–2, THW, THW–2, RHW, OR RHW–2 INSULATION UNLESS OTHERWISE SPECIFIED.
11. POWER AND CONTROL WIRING IN FLEXIBLE CORD SHALL BE MULTI–CONDUCTOR, TYPE SOOW CORD (#14 OR LARGER) UNLESS OTHERWISE SPECIFIED.
12. POWER AND CONTROL WIRING FOR USE IN CABLE TRAY SHALL BE MULTI–CONDUCTOR, TYPE TC CABLE (#14 OR LARGER), WITH TYPE THHW, THWN, THWN–2, XHHW, XHHW–2, THW, THW–2, RHW, OR RHW–2 INSULATION UNLESS OTHERWISE SPECIFIED.
13. ALL POWER AND GROUNDING CONNECTIONS SHALL BE CRIMP–STYLE, COMPRESSION WIRE LUGS AND WIRE NUTS BY THOMAS AND BETTS (OR EQUAL). LUGS AND WIRE NUTS SHALL BE RATED FOR OPERATION NOT LESS THAN 75° C (90° C IF AVAILABLE).
14. RACEWAY AND CABLE TRAY SHALL BE LISTED OR LABELED FOR ELECTRICAL USE IN ACCORDANCE WITH NEMA, UL, ANSI/IEEE AND NEC.
15. ELECTRICAL METALLIC TUBING (EMT), INTERMEDIATE METAL CONDUIT (IMC), OR RIGID METAL CONDUIT (RMC) SHALL BE USED FOR EXPOSED INDOOR LOCATIONS.


16. ELECTRICAL METALLIC TUBING (EMT) OR METAL–CLAD CABLE (MC) SHALL BE USED FOR CONCEALED INDOOR LOCATIONS.
17. SCHEDULE 40 PVC UNDERGROUND ON STRAIGHTS AND SCHEDULE 80 PVC FOR ALL ELBOWS/90s AND ALL APPROVED ABOVE GRADE PVC CONDUIT.
18. LIQUID–TIGHT FLEXIBLE METALLIC CONDUIT (LIQUID–TITE FLEX) SHALL BE USED INDOORS AND OUTDOORS, WHERE VIBRATION OCCURS OR FLEXIBILITY IS NEEDED.
19. CONDUIT AND TUBING FITTINGS SHALL BE THREADED OR COMPRESSION–TYPE AND APPROVED FOR THE LOCATION USED. SET SCREW FITTINGS ARE NOT ACCEPTABLE.
20. CABINETS, BOXES AND WIRE WAYS SHALL BE LABELED FOR ELECTRICAL USE IN ACCORDANCE WITH NEMA, UL, ANSI/IEEE AND THE NEC.
21. WIREWAYS SHALL BE METAL WITH AN ENAMEL FINISH AND INCLUDE A HINGED COVER, DESIGNED TO SWING OPEN DOWNWARDS (WIREMOLD SPECIMATE WIREWAY).
22. SLOTTED WIRING DUCT SHALL BE PVC AND INCLUDE COVER (PANDUIT TYPE E OR EQUAL).
23. CONDUITS SHALL BE FASTENED SECURELY IN PLACE WITH APPROVED NON–PERFORATED STRAPS AND HANGERS. EXPLOSIVE DEVICES (i.e. POWDER–ACTUATED) FOR ATTACHING HANGERS TO STRUCTURE WILL NOT BE PERMITTED. CLOSELY FOLLOW THE LINES OF THE STRUCTURE, MAINTAIN CLOSE PROXIMITY TO THE STRUCTURE AND KEEP CONDUITS IN TIGHT ENVELOPES. CHANGES IN DIRECTION TO ROUTE AROUND OBSTACLES SHALL BE MADE WITH CONDUIT OUTLET BODIES. CONDUIT SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER. PARALLEL AND PERPENDICULAR TO STRUCTURE WALL AND CEILING LINES. ALL CONDUIT SHALL BE FISHED TO CLEAR OBSTRUCTIONS. ENDS OF CONDUITS SHALL BE TEMPORARILY CAPPED FLUSH TO FINISH GRADE TO PREVENT CONCRETE, PLASTER OR DIRT FROM ENTERING. CONDUITS SHALL BE RIGIDLY CLAMPED TO BOXES BY GALVANIZED MALLEABLE IRON BUSHING ON INSIDE AND GALVANIZED MALLEABLE IRON LOCKNUT ON OUTSIDE AND INSIDE.
24. EQUIPMENT CABINETS, TERMINAL BOXES, JUNCTION BOXES AND PULL BOXES SHALL BE GALVANIZED OR EPOXY–COATED SHEET STEEL SHALL MEET OR EXCEED UL 50 AND BE RATED NEMA 1 (OR BETTER) FOR INTERIOR LOCATIONS AND NEMA 3 (OR BETTER) FOR EXTERIOR LOCATIONS.
25. METAL RECEPTACLE, SWITCH AND DEVICE BOXES SHALL BE GALVANIZED, EPOXY–COATED OR NON–CORRODING; SHALL MEET OR EXCEED UL 514A AND NEMA OS 1 AND BE RATED NEMA 1 (OR BETTER) FOR INTERIOR LOCATIONS AND WEATHER PROTECTED (WP OR BETTER) FOR EXTERIOR LOCATIONS.
26. NONMETALLIC RECEPTACLE, SWITCH AND DEVICE BOXES SHALL MEET OR EXCEED NEMA OS 2 (NEWEST REVISION) AND BE RATED NEMA 1 (OR BETTER) FOR INTERIOR LOCATIONS AND WEATHER PROTECTED (WP OR BETTER) FOR EXTERIOR LOCATIONS.
27. THE CONTRACTOR SHALL NOTIFY AND OBTAIN NECESSARY AUTHORIZATION FROM THE CARRIER AND/OR DISH Wireless L.L.C. AND TOWER OWNER BEFORE COMMENCING WORK ON THE AC POWER DISTRIBUTION PANELS.
28. THE CONTRACTOR SHALL PROVIDE NECESSARY TAGGING ON THE BREAKERS, CABLES AND DISTRIBUTION PANELS IN ACCORDANCE WITH THE APPLICABLE CODES AND STANDARDS TO SAFEGUARD LIFE AND PROPERTY.
29. INSTALL LAMICOID LABEL ON THE METER CENTER TO SHOW "DISH Wireless L.L.C."
30. ALL EMPTY/SPARE CONDUITS THAT ARE INSTALLED ARE TO HAVE A METERED MULE TAPE PULL CORD INSTALLED.



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH
RFDS REV #: 0		09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
Δ	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
GENERAL NOTES

SHEET NUMBER
GN-3

GROUNDING NOTES:

1. ALL GROUND ELECTRODE SYSTEMS (INCLUDING TELECOMMUNICATION, RADIO, LIGHTNING PROTECTION AND AC POWER GES'S) SHALL BE BONDED TOGETHER AT OR BELOW GRADE, BY TWO OR MORE COPPER BONDING CONDUCTORS IN ACCORDANCE WITH THE NEC.
2. THE CONTRACTOR SHALL PERFORM IEEE FALL-OF-POTENTIAL RESISTANCE TO EARTH TESTING (PER IEEE 1100 AND 81) FOR GROUND ELECTRODE SYSTEMS, THE CONTRACTOR SHALL FURNISH AND INSTALL SUPPLEMENTAL GROUND ELECTRODES AS NEEDED TO ACHIEVE A TEST RESULT OF 5 OHMS OR LESS.
3. THE CONTRACTOR IS RESPONSIBLE FOR PROPERLY SEQUENCING GROUNDING AND UNDERGROUND CONDUIT INSTALLATION AS TO PREVENT ANY LOSS OF CONTINUITY IN THE GROUNDING SYSTEM OR DAMAGE TO THE CONDUIT AND PROVIDE TESTING RESULTS.
4. METAL CONDUIT AND TRAY SHALL BE GROUNDED AND MADE ELECTRICALLY CONTINUOUS WITH LISTED BONDING FITTINGS OR BY BONDING ACROSS THE DISCONTINUITY WITH #6 COPPER WIRE UL APPROVED GROUNDING TYPE CONDUIT CLAMPS.
5. METAL RACEWAY SHALL NOT BE USED AS THE NEC REQUIRED EQUIPMENT GROUND CONDUCTOR. STRANDED COPPER CONDUCTORS WITH GREEN INSULATION, SIZED IN ACCORDANCE WITH THE NEC, SHALL BE FURNISHED AND INSTALLED WITH THE POWER CIRCUITS TO BTS EQUIPMENT.
6. EACH CABINET FRAME SHALL BE DIRECTLY CONNECTED TO THE MASTER GROUND BAR WITH GREEN INSULATED SUPPLEMENTAL EQUIPMENT GROUND WIRES, #6 STRANDED COPPER OR LARGER FOR INDOOR BTS; #2 BARE SOLID TINNED COPPER FOR OUTDOOR BTS.
7. CONNECTIONS TO THE GROUND BUS SHALL NOT BE DOUBLED UP OR STACKED BACK TO BACK CONNECTIONS ON OPPOSITE SIDE OF THE GROUND BUS ARE PERMITTED.
8. ALL EXTERIOR GROUND CONDUCTORS BETWEEN EQUIPMENT/GROUND BARS AND THE GROUND RING SHALL BE #2 SOLID TINNED COPPER UNLESS OTHERWISE INDICATED.
9. ALUMINUM CONDUCTOR OR COPPER CLAD STEEL CONDUCTOR SHALL NOT BE USED FOR GROUNDING CONNECTIONS.
10. USE OF 90° BENDS IN THE PROTECTION GROUNDING CONDUCTORS SHALL BE AVOIDED WHEN 45° BENDS CAN BE ADEQUATELY SUPPORTED.
11. EXOTHERMIC WELDS SHALL BE USED FOR ALL GROUNDING CONNECTIONS BELOW GRADE.
12. ALL GROUND CONNECTIONS ABOVE GRADE (INTERIOR AND EXTERIOR) SHALL BE FORMED USING HIGH PRESS CRIMPS.
13. COMPRESSION GROUND CONNECTIONS MAY BE REPLACED BY EXOTHERMIC WELD CONNECTIONS.
14. ICE BRIDGE BONDING CONDUCTORS SHALL BE EXOTHERMICALLY BONDED OR BOLTED TO THE BRIDGE AND THE TOWER GROUND BAR.
15. APPROVED ANTIOXIDANT COATINGS (i.e. CONDUCTIVE GEL OR PASTE) SHALL BE USED ON ALL COMPRESSION AND BOLTED GROUND CONNECTIONS.
16. ALL EXTERIOR GROUND CONNECTIONS SHALL BE COATED WITH A CORROSION RESISTANT MATERIAL.
17. MISCELLANEOUS ELECTRICAL AND NON-ELECTRICAL METAL BOXES, FRAMES AND SUPPORTS SHALL BE BONDED TO THE GROUND RING, IN ACCORDANCE WITH THE NEC.
18. BOND ALL METALLIC OBJECTS WITHIN 6 ft OF MAIN GROUND RING WITH (1) #2 BARE SOLID TINNED COPPER GROUND CONDUCTOR.
19. GROUND CONDUCTORS USED FOR THE FACILITY GROUNDING AND LIGHTNING PROTECTION SYSTEMS SHALL NOT BE ROUTED THROUGH METALLIC OBJECTS THAT FORM A RING AROUND THE CONDUCTOR, SUCH AS METALLIC CONDUITS, METAL SUPPORT CLIPS OR SLEEVES THROUGH WALLS OR FLOORS. WHEN IT IS REQUIRED TO BE HOUSED IN CONDUIT TO MEET CODE REQUIREMENTS OR LOCAL CONDITIONS, NON-METALLIC MATERIAL SUCH AS PVC CONDUIT SHALL BE USED. WHERE USE OF METAL CONDUIT IS UNAVOIDABLE (i.e., NONMETALLIC CONDUIT PROHIBITED BY LOCAL CODE) THE GROUND CONDUCTOR SHALL BE BONDED TO EACH END OF THE METAL CONDUIT.
20. ALL GROUNDS THAT TRANSITION FROM BELOW GRADE TO ABOVE GRADE MUST BE #2 BARE SOLID TINNED COPPER IN 3/4" NON-METALLIC, FLEXIBLE CONDUIT FROM 24" BELOW GRADE TO WITHIN 3" TO 6" OF CAD-WELD TERMINATION POINT. THE EXPOSED END OF THE CONDUIT MUST BE SEALED WITH SILICONE CAULK. (ADD TRANSITIONING GROUND STANDARD DETAIL AS WELL).
21. BUILDINGS WHERE THE MAIN GROUNDING CONDUCTORS ARE REQUIRED TO BE ROUTED TO GRADE, THE CONTRACTOR SHALL ROUTE TWO GROUNDING CONDUCTORS FROM THE ROOFTOP, TOWERS, AND WATER TOWERS GROUNDING RING, TO THE EXISTING GROUNDING SYSTEM, THE GROUNDING CONDUCTORS SHALL NOT BE SMALLER THAN 2/0 COPPER. ROOFTOP GROUNDING RING SHALL BE BONDED TO THE EXISTING GROUNDING SYSTEM, THE BUILDING STEEL COLUMNS, LIGHTNING PROTECTION SYSTEM, AND BUILDING MAIN WATER LINE (FERROUS OR NONFERROUS METAL PIPING ONLY). DO NOT ATTACH GROUNDING TO FIRE SPRINKLER SYSTEM PIPES.



5701 SOUTH SANTA FE DRIVE
LITTLETON, CO 80120



11490 BLUEGRASS PKWY
LOUISVILLE, KY 40299



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

DRAWN BY:	CHECKED BY:	APPROVED BY:
AJM	EEW	AH

RFDS REV #: 0 09/09/2021

CONSTRUCTION DOCUMENTS

SUBMITTALS		
REV	DATE	DESCRIPTION
A	01/04/2022	ISSUED FOR REVIEW
0	01/20/2022	ISSUED FOR CONSTRUCTION
1	02/09/2022	ISSUED FOR CONSTRUCTION
2	02/18/2022	ISSUED FOR CONSTRUCTION
3	04/21/2022	ISSUED FOR CONSTRUCTION
4	08/07/2023	ISSUED FOR CONSTRUCTION
△	11/10/2023	JURISDICTION REVISION

A&E PROJECT NUMBER
880416

DISH Wireless L.L.C.
PROJECT INFORMATION
SESEA00010B
8477 SE 68TH STREET
MERCER ISLAND, WA 98040

SHEET TITLE
GENERAL NOTES

SHEET NUMBER
GN-4