

# **GENERAL NOTES:**

#### MATERIALS SPEC LIST:

**Boat Lifts:** Aluminum

- SL10014ARW 146" x 191"
- SL2008AR2D2 52" x 66" (Jetski Lift)

Decking Material: FRPP - Fiberglass reinforced polypropylene

Open Air percentage:

\* Surface - 43%

## Sewer:

\* All sewer is field verified by probing the lake bed manually during the allowed work windows for the area.

#### Piles:

- All new piles are epoxy coated steel piles \*size varies, see plan set
- \* Piles are driven using the vibro method

#### CODE REFERENCES: Mercer Island

#### We are applying for the permit to be reviewed under the:

#### "Alternative Development Standards" per MIMC 19.13050(F)(3).

The code official shall approve moorage facilities not in compliance with the development standards in subsection (F)(1) or (F)(2) of this section subject to both U.S. Army Corps of Engineers and Washington Department of Fish and Wildlife approval to an alternate project design. The following requirements and all other applicable provisions in this chapter shall be met:

i. The dock must be no larger than authorized through state and federal approval; Ch. 19.13 Shoreline Master Program | Mercer Island City Code Page 30 of 34 The Mercer Island City Code is current through Ordinance 20C-13, passed June 16, 2020.

## The dock will be no larger than authorized.

ii. The maximum width must comply with the width of moorage facilities standards specified in standards specified in subsection D of this section (Table D);

#### The maximum width will comply.

iii. The minimum water depth must be no shallower than authorized through state and federal approval;

#### The minimum water depth will be no shallower than authorized.

Applicant: iv. The applicant must demonstrate to the code official's satisfaction that the proposed project will not create a net loss in ecological function of the shorelands; and

NNL report attached.

v. The applicant must provide the city with documentation of approval of the moorage facilities by both the U.S. Army Corps of Engineers and the Washington Department of Fish and Wildlife.

Under review by CORPS and WDFW.

Mitigation" Disturbance of bank vegetation shall be limited to the minimum amount necessary to accomplish the project. Disturbed bank vegetation shall be replaced with native, locally adapted herbaceous and/or woody vegetation. Herbaceous plantings shall occur within 48 hours of the completion of construction. Woody vegetation components shall be planted in the fall or early winter, whichever occurs first. The applicant shall take appropriate measures to ensure revegetation success;

Last permit issued for property: SHL9904-212 03/17/1999

Dock established/constructed: 10/08/1981



Seaborn Pile Driving 1080 W Ewing St Seattle, WA 98119

Office: 206-236-1700 ext. 3 www.seabornpiledriving.com Scope of Work: We propose toremove (80) Inft of skirting, drive(14) 8" steel piles, install 326 sqft of extensions, permit the existing PWC lift, and relocate the existing boat lift.

SHEET A2.0

ast Updated: 9/14/2022 12:02 PM Zion

King ( Lake '


: Hanover Residence 6460 E Mercer Way Mercer Island, WA 98040


SIMPSON TYLER G & ANDREA 3454 E MERCER WAY 98040


Owners:


Adjacent (
KONERU DHEERA
6610 E MERCER W

NWS-2021-XXX

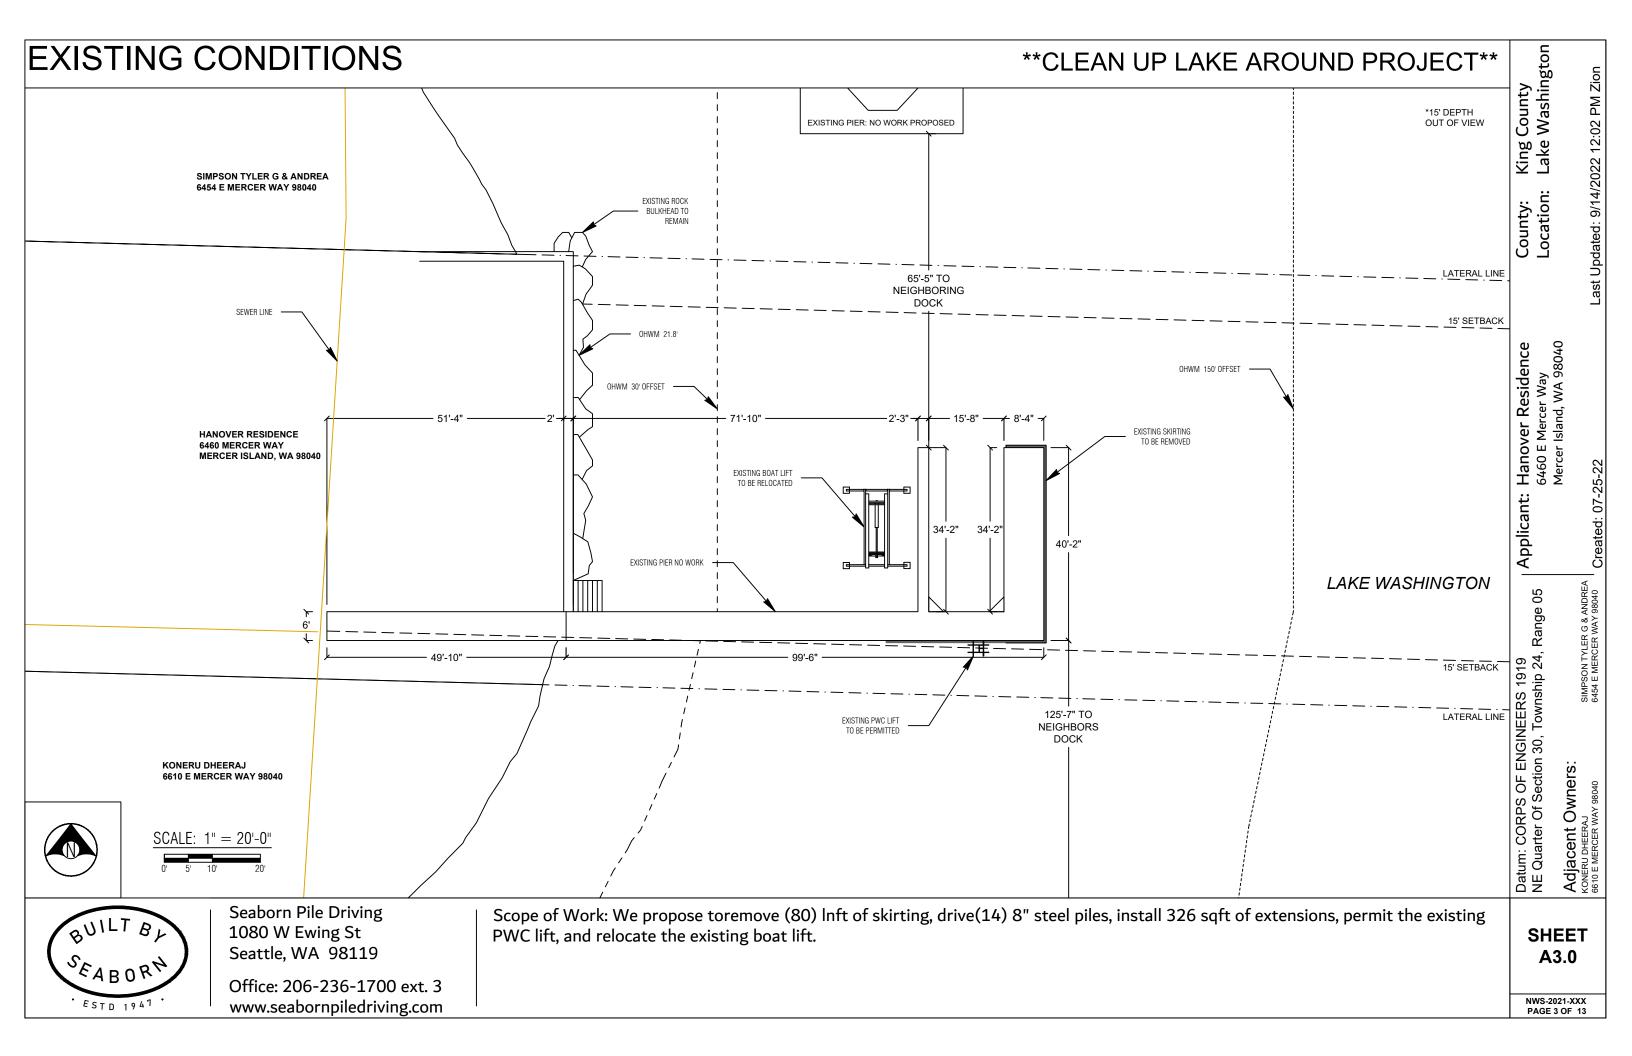

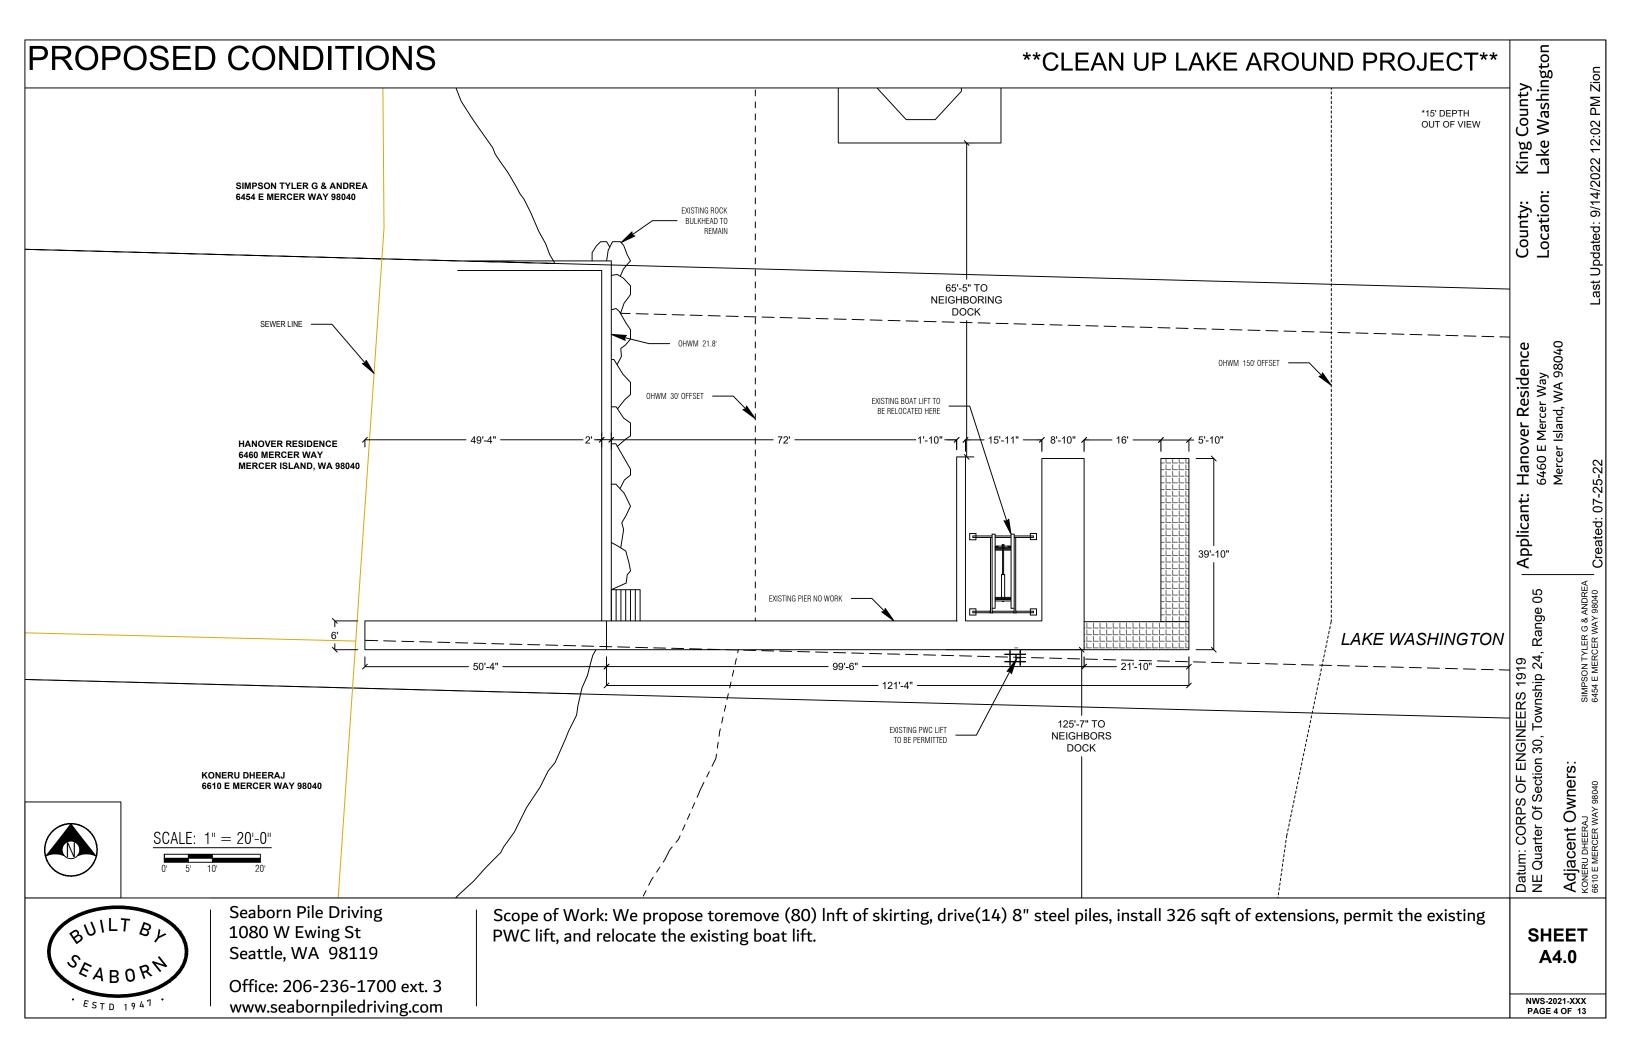

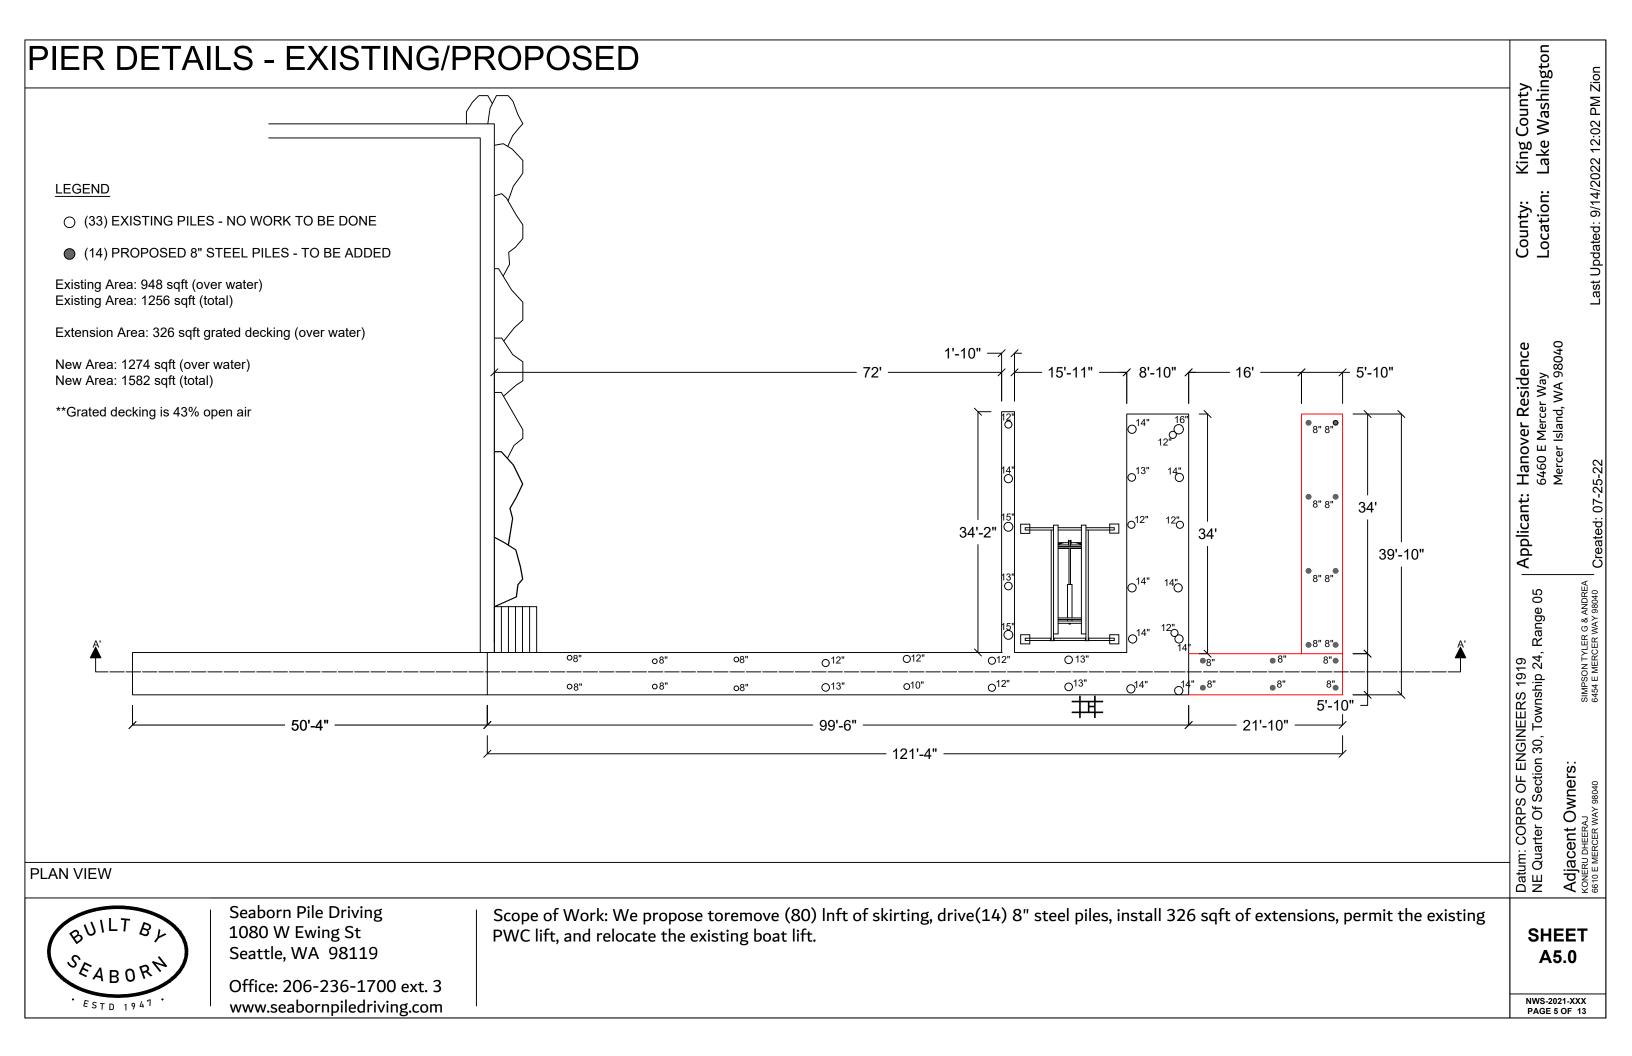

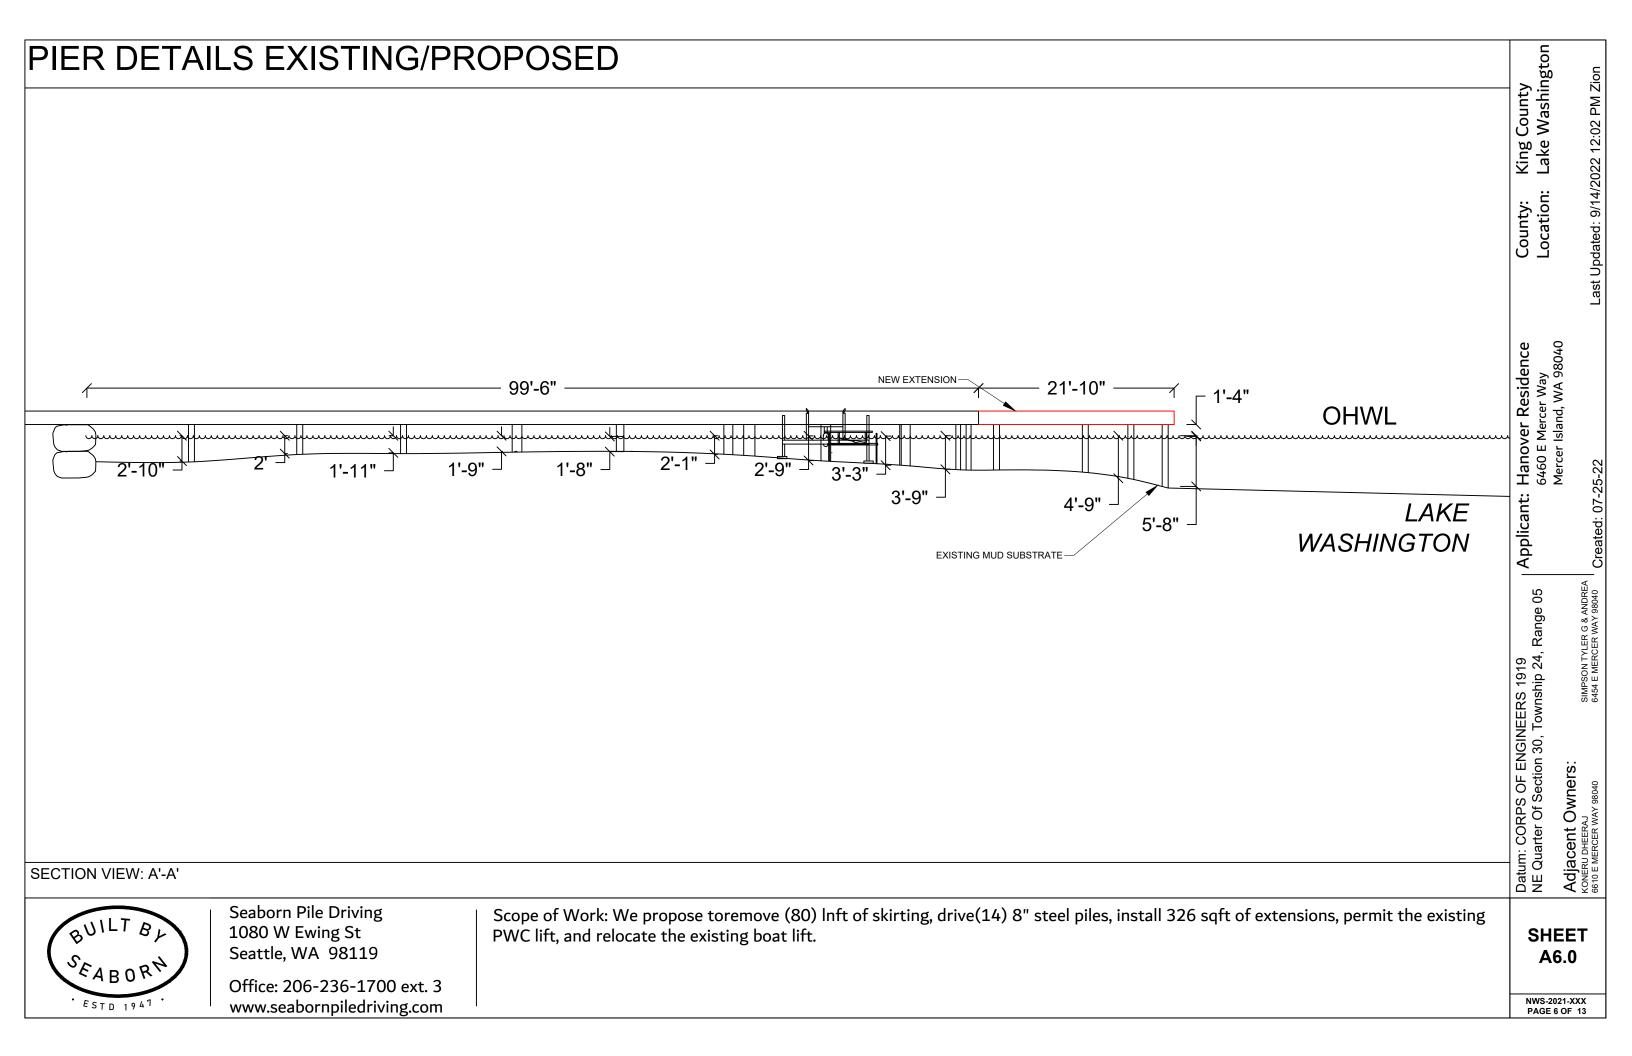

# **BMP INFORMATION** DETAIL 1.1 DETAIL 1.2 Containment **EXISTING** LAKEBED/SOIL **DETAIL 1.1 & 1.2**

#### BMP NOTES:

A. Constant vigilance shall be kept for the presence of protected fish species during all aspects of the proposed action, particularly during in-water activities such as vessel movement, deployment of anchors & spuds, pile driving, dredging, and placement of gravels and other fill.

- 1. The project manager shall designate an appropriate number of competent observers to survey the project site and adjacent areas for protected species, including the presence of fish as conditions allow.
- 2. Visual surveys shall be made prior to the start of work each day, and prior to resumption of work following any break of more than an hour. Periodic additional visual surveys throughout the work day are strongly recommended.
- 3. All in-water work shall be done during the in-water work window for the waterbody. Where there is a difference between the USCOE and WDFW work windows, the overlap of the two shall apply.
- 4. All pile driving and extraction shall be postponed or halted when obvious aggregations or schooling of fish are observed within 50 yards of that work, and shall only begin/resume after the animals have voluntarily departed the area.
- 5. When piloting vessels, vessel operators shall operate at speeds and power settings to avoid grounding vessels, and minimize substrate scour and mobilization of bottom sediments.
- B. No contamination of the marine environment shall result from project-related activities.
- 1. Appropriate materials to contain and clean potential spills shall be stored and readily available at the work site and/or aboard project-related vessels.
- 2. The project manager and heavy equipment operators shall perform daily pre-work equipment inspections for cleanliness and leaks. All heavy equipment operations shall be postponed or halted should a leak be detected, and shall not proceed until the leak is repaired and the equipment is cleaned.
- 3. To the greatest extent practicable, utilize biodegradable oils for equipment that would be operated in or near water.
- 4. Fueling of land-based vehicles and equipment shall take place at least 50 feet away from the water, preferably over an impervious surface. Fueling of vessels shall be done at approved fueling facilities.
- 5. Turbidity and siltation from project-related work shall be minimized and contained through the appropriate use of erosion control practices, effective silt containment devices, and the curtailment of work during adverse weather and tidal/flow conditions.
- 6. All wastes shall be collected and contained for proper disposal at approved upland disposal sites appropriate for the material(s).
- 7. When removing piles and other similarly treated wood, containment booms must fully enclose the work area. Wood debris, oils, and any other materials released into lake waters must be collected, removed, and properly disposed of at approved disposal sites.
- 8. All in- and over-water wood cutting would be limited to the minimum required to remove the subject wood component, and all cutting work should be enclosed within floating containment booms.
- 9. When removing piles, no actions shall be taken that would cause adhering sediments to return to lake waters.
- 10. Above-water containment shall be installed around removed piles to prevent sediment laden waters from returning to lake waters.
- 11. Construction staging (including stocking of materials, etc.) will occur on the supply barge.
- 12. All Exposed wood to be used on the project will be treated with a cheminite treatment.



Seaborn Pile Driving 1080 W Ewing St Seattle, WA 98119

Office: 206-236-1700 ext. 3 www.seabornpiledriving.com

Scope of Work: We propose toremove (80) Inft of skirting, drive(14) 8" steel piles, install 326 sqft of extensions, permit the existing PWC lift, and relocate the existing boat lift.

SHEET A7.0

County Washington

King ( Lake

Hanover Residence 6460 E Mercer Way Mercer Island, WA 98040

Applicant:

Datum: CORPS OF ENGINEERS 1919 NE Quarter Of Section 30, Township 24, Range 05 SIMPSON TYLER G & ANDREA 3454 E MERCER WAY 98040


Owners:


Adjacent (
KONERU DHEERA
6610 E MERCER W

ast Updated: 9/14/2022 12:02 PM Zion-

NWS-2021-XXX

# MITIGATION PLAN

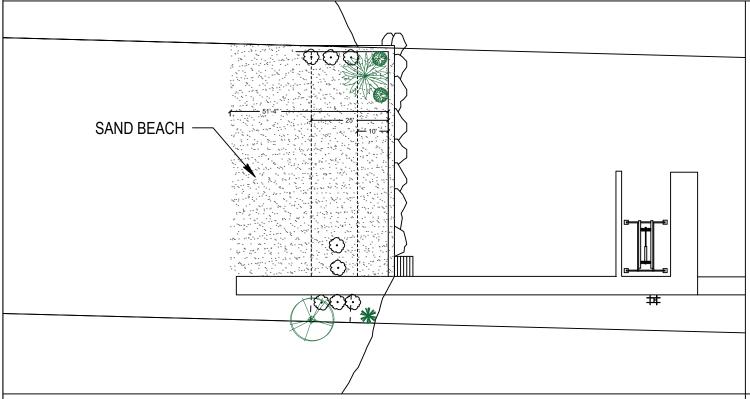

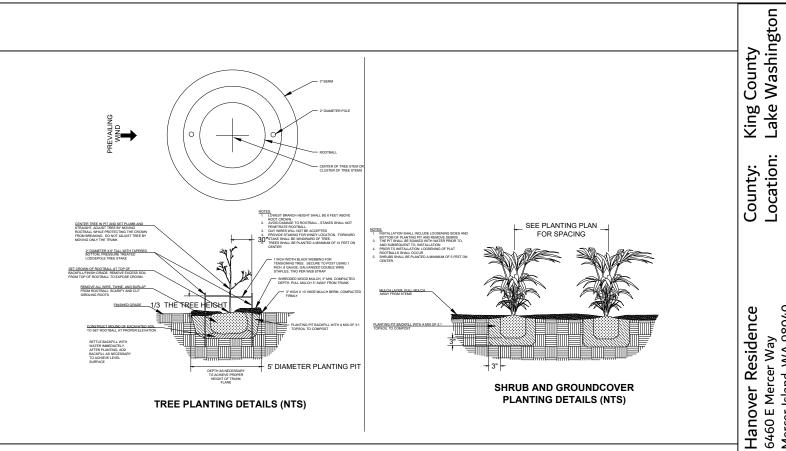

## Notes:

- 1. Shrubs are show, and shall be planted, at least five feet on center. Trees are show, and shall be planted, at least ten feet to center.
- 2. The property owner will implement and abide by the shoreline planting plan. The plants shall be installed before or concurrent with the work authorized by this permit. A report, as-built drawing and photographs demonstrating the plants have been installed or a report on the status of project construction will be submitted to the U.S. Army Corps of Engineers, Seattle District, Regulatory Branch, within 12 months from the date of permit issuance. This reporting requirement may be met by completing and submitting a U.S. Army Corps of Engineers approved Report for Mitigation Work Completion form.
- 3. The property owner will maintain and monitor the survival of installed shoreline plantings for five years after the U.S. Army Corps of Engineers accepts the as-built report. Installed plants shall achieve 100% survival during monitoring Years 1 and 2. Installed plants shall achieve at least 80% survival during monitoring Years 3, 4 and 5. Percent survival is based on the total number of plants installed in accordance with the approved riparian planting plan. Individual plants that die will be replaced with native riparian species in order to meet the survival performance standards.
- 4. The property owner will provide annual monitoring reports for five years (Monitoring Years 1-5). Each annual monitoring report will include written and photographic documentation on plant mortality and replanting efforts and will document whether the performance standards are being met. Photos will be taken from established points and used repeatedly for each monitoring year. In addition to photos at designated points, photo documentation will include a panoramic view of the entire planting area. Submitted photos will be formatted on standard 8 1/2 x 11" paper, dated with the date the photo was taken, and clearly labeled with the direction from which the photo was taken. The photo location points will be identified on an appropriate drawing. Annual shoreline planting monitoring reports will be submitted to the U.S. Army Corps of Engineers, Seattle District, Regulatory Branch, by November 31 of each monitoring year. This reporting requirement may be met by completing and submitting a U.S. Army Corps of Engineers approved Mitigation Planting Monitoring Report form.

## PROPOSED PLANTING SPECIES/QUANTITIES

SYMBOL	LATIN NAME	COMMON NAME	QTY	SIZE
	Thuja plicata	Western Red Cedar	1	3 ft
	Salix Lucida	Pacific Willow	1	3 ft
	Salix sitchensis	Sittka Willow	2	1 gal / 3 gal
	Salix scouleriana	Scouler willow	1	1 gal / 3 gal

PLANTS: Shrubs to be installed 5ft on center and trees to be installed 10ft on center.

SEABORN

SEABORN

Seaborn Pile Driving 1080 W Ewing St Seattle, WA 98119

Office: 206-236-1700 ext. 3 www.seabornpiledriving.com

Scope of Work: We propose toremove (80) Inft of skirting, drive(14) 8" steel piles, install 326 sqft of extensions, permit the existing PWC lift, and relocate the existing boat lift.

SHEET A8.0

Adjacent Owners: KONERU DHEERAJ 6610 E MERCER WAY 98040

Applicant:

Datum: CORPS OF ENGINEERS 1919 NE Quarter Of Section 30, Township 24, Range 05 ast Updated: 9/14/2022 12:02 PM Zior-

NWS-2021-XXX PAGE 8 OF 13

